



Radiation Branch Environmental Monitoring Summary for 2005

June 2006

NOTE: Items within these environmental summaries have been removed due to confidential homeland security information under The Texas Public Information Act and House Bill 9, Gov. § code 418.

Texas Department of State Health Services
1100 West 49th Street
Austin, Texas 78756-3189
512-834-6688

Publication #22-12142

Table of Contents

Introduction	3
Fixed Nuclear Facilities	5
Comanche Peak Steam Electric Station	7-16
South Texas Project	17-25
Radioactive Waste Processors	27
Nuclear Sources and Services, Inc.	29-31
Waste Control Specialists	33-35
Research Reactors	37
Texas A & M University Nuclear Science Center	39-42
University of Texas Nuclear Engineering Teaching Laboratory	43-45
Other Facilities	47
Gammatron, Inc.	49-50
GeoCo, Inc.	51-52
Isotech Laboratories, Inc.	53-54
Iso-Tex, Inc.	55-56
Pantex	57-62
Radiation Technology, Inc.	63-64
Rhodia, Inc.	65-66
Thermo MeasureTech	67-68
U.T. Systems Interim Waste Storage Facility	69-70
Appendices	71
Department of Energy Quality Assessment Program Results	73
Department of Energy Quality Assessment Program Letter	74
Texas Department of State Health Services Laboratory Detection Limits	75-76

This page intentionally blank

Introduction

This is the ninth annual reporting of environmental monitoring results to be produced as an internal document. The document consists of the data collected for each monitoring point at each facility. The data are presented in the same manner as in the past. Limits of detection were not included with data in an effort to reduce the space required for data entry. A listing of expected limits of detection for various media, geometries, and radionuclides is found in the appendices. Maps of the facilities are included, but details have been omitted. Specific information about individual facilities can be found in the license files. Copies of this and the previous documents for 1993-1997 and individual reports for 1998-2004 can be made available through an open records request.

All analyses of environmental media, i.e., soil, air, water, vegetation, are performed by the Texas Department of State Health Services, Laboratory Services Section. The Laboratory Services Section operates a highly capable radio-chemistry program. Currently the Environmental Sciences Branch participates in a program sponsored by the U.S. Department of Energy, referred to as DOELAP (Department of Energy Laboratory Accreditation Program). It was developed by the U.S. Department of Energy in order to provide quality assurance and control for D.O.E. contractors. The most recent results of the Laboratory Services Section's performance in these "cross checks" can be found in the appendices to this document or on the internet at the following location (<http://www.eml.doe.gov/qap/reports/>).

Thermoluminescent dosimeter (TLD) readings are performed by the staff of the Radiation Branch. The Radiation Branch maintains a Harshaw/Bicron Model 6600 TLD reader. Staff of Landauer, Inc. also perform TLD readings (for the facilities that have neutron sources). Approximately two hundred TLD's are exchanged and read each calendar quarter. Background is subtracted from all station readings except for Comanche Peak Steam Electric Station, South Texas Project, and Pantex. Background is not subtracted from these three locations because the readings should be ambient doses.

Analysis of sample data from the monitored facilities indicated no release of radioactive material to the environment that exceeded the regulatory or license limits of the Texas Department of State Health Services or any other agency such as the U.S. Nuclear Regulatory Commission or the U.S. Department of Energy. Some of the TLD readings at a few of the monitored facilities exceeded 100 mrem for the year. All licensed facilities are required by rule to document that exposures from conducting operations do not cause doses in excess of the regulatory limits to employees or individual members of the general public. The documentation is maintained for inspection by the Radiation Branch. Licensees are allowed to use mitigating factors, such as occupancy and distance to nearest occupied areas, in demonstrating compliance with those limits.

Any questions should be directed to Robert E. Free at 512-834-6770, ext. 2022 or robert.free@dshs.state.tx.us.

Robert Free

This page intentionally blank

Fixed Nuclear Facilities


This page intentionally blank

Comanche Peak Steam Electric Station


Radiation Branch Site No. 031

Comanche Peak Steam Electric Station (CPSES) is a two-unit nuclear-fueled power plant, owned and operated by TXU Energy, is located in Somervell County four and one-half miles northwest of Glen Rose and approximately 80 miles southwest of downtown Dallas.

CPSES, TXU Energy's sole nuclear power plant, with an operating capacity of 2,300 megawatts annually [two Westinghouse 1,150 megawatt (electric) pressurized water reactor units], began operation in 1990, although fuel had been received on site in 1982-1983. The plant has approximately 1,300 employees. The Radiation Branch surveillance program consists of sampling air, water, sediment, fish, food products, and vegetation and TLD monitoring.

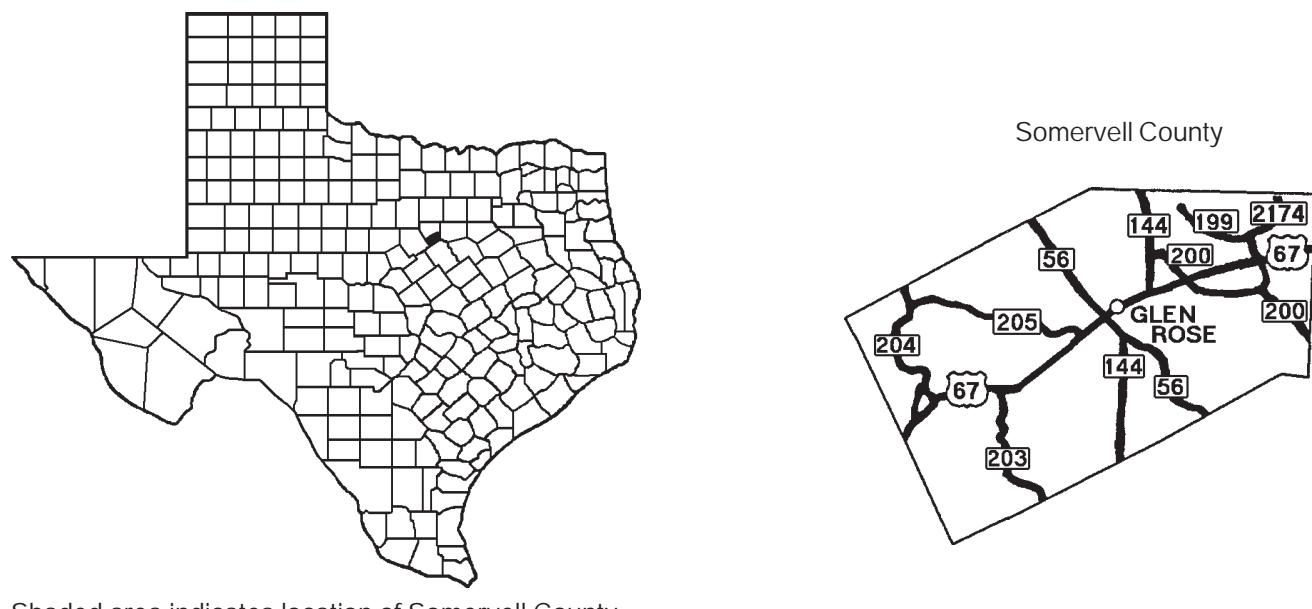



Shaded area indicates location of Somervell County




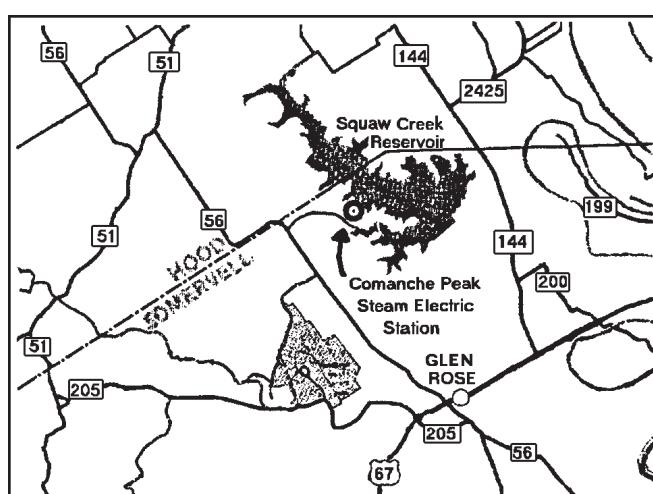


Comanche Peak Steam Electric Station

Monitoring Station Locations

Note: Sample type not indicated on maps.

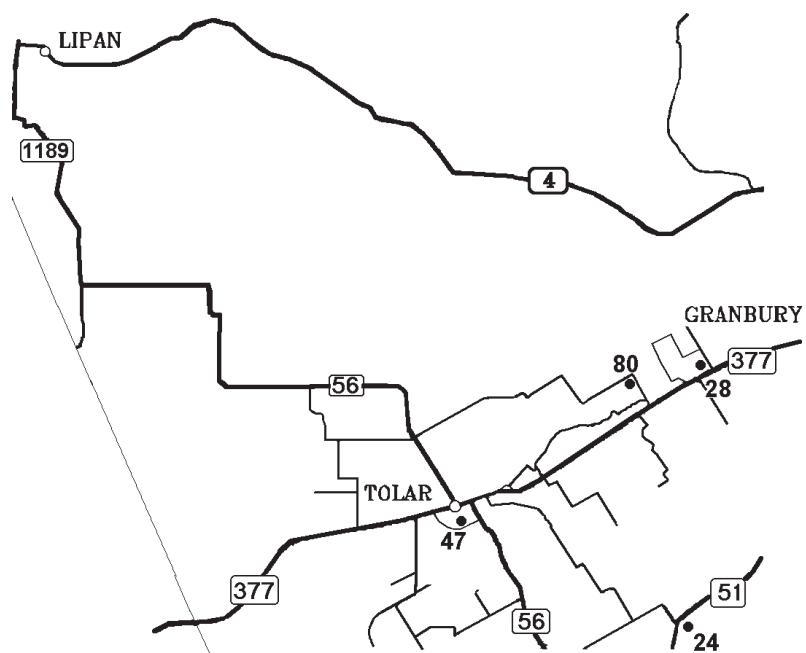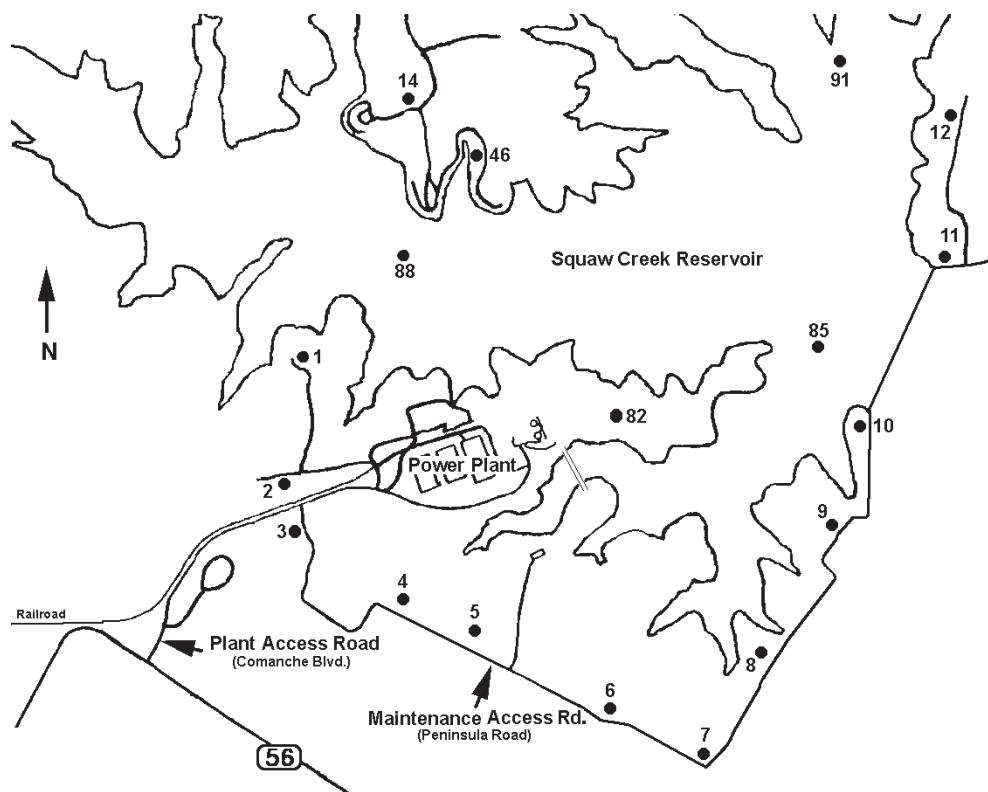

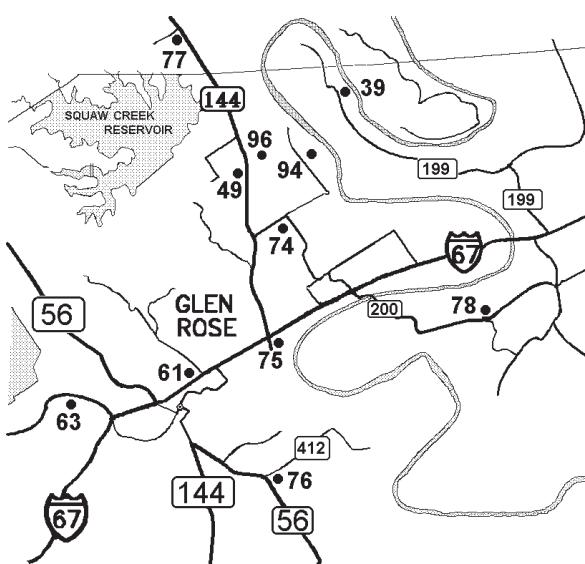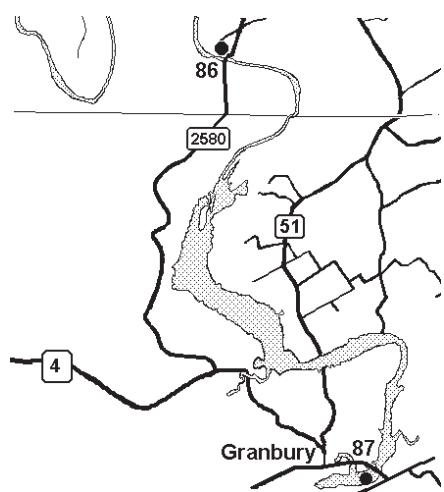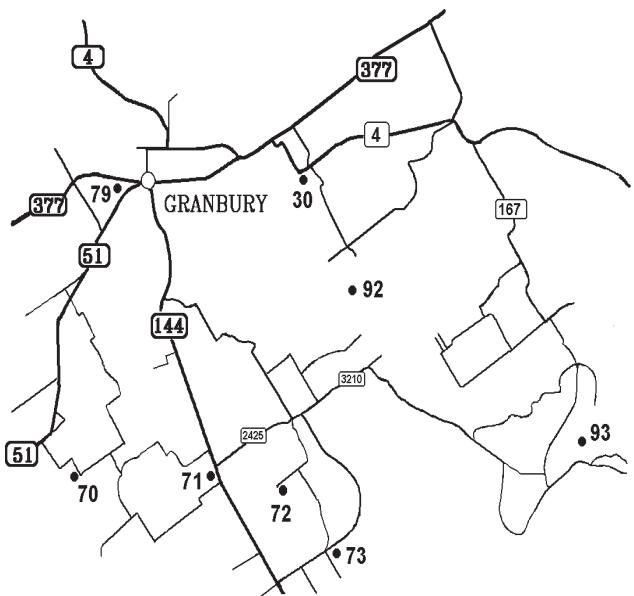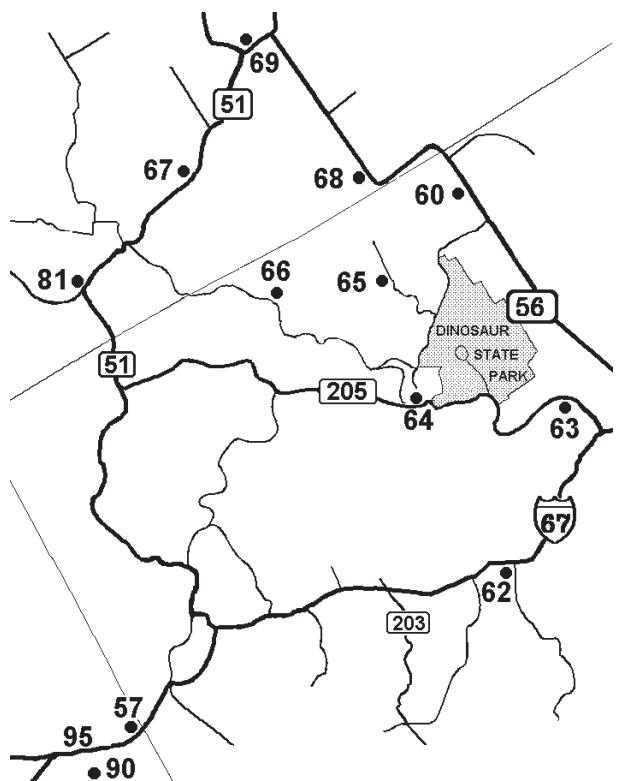

Comanche Peak Steam Electric Station

Thermoluminescent Dosimeter (TLD) Monitoring Results¹
(quarterly and annual readings are in mrem)

Station	Q1	Q2	Q3	Q4	Annual	
					Dose	Notes
01	15.3	11.3	16.8	15.8	59.2	
02	16.4	12.9	16.8	16.7	62.8	
03	12.3	9.7	14.4	13.0	49.4	
04	15.3	12.1	16.8	15.8	60.0	
05	14.3	11.3	15.6	14.9	56.1	
06	14.3	11.3	16.8	17.6	60.0	
07	14.3	11.3	15.6	14.9	56.1	
08	15.3	12.1	18.0	14.9	60.3	
09	16.4	12.9	16.8	16.7	62.8	
10	14.3	11.3	14.4	14.9	54.9	
11	14.3	10.5	15.6	14.9	55.3	
12	16.4	13.7	18.0	16.7	64.8	
14	16.7	11.2	15.6	14.9	58.4	
24	15.5	12.0	16.8	16.7	61.0	
28	17.6	12.0	16.8	16.5	62.9	
30	15.5	11.3	16.5	16.7	60.0	
39	15.5	11.9	--	14.9	56.4	² Q3 TLD missing
46	14.5	11.2	15.6	14.9	56.2	
47	15.5	12.0	16.8	15.6	59.9	
49	15.5	12.8	18.0	16.7	63.0	
60	14.5	12.0	15.6	15.8	57.9	
61	14.5	12.1	15.4	14.9	56.9	
62	14.5	11.2	15.6	14.9	56.2	
63	16.5	12.8	16.8	17.6	63.7	
64	15.5	12.0	16.8	15.8	60.1	
65	13.4	10.4	14.4	13.0	51.2	
66	14.5	12.0	16.8	14.9	58.2	
67	14.5	11.2	15.6	14.9	56.2	
68	14.5	11.2	15.6	14.9	56.2	
69	13.4	10.4	14.4	12.9	51.1	
70	--	10.4	15.6	13.9	53.2	² Q1 TLD reading unavailable
71	15.5	11.2	15.6	14.9	57.2	
72	14.5	10.4	15.6	15.8	56.3	
73	14.5	11.2	15.6	15.8	57.1	
74	14.5	11.9	17.0	15.8	59.2	
75	--	11.3	15.4	--	53.4	² Q1 and 4 TLD readings unavailable
76	13.4	10.5	15.4	14.9	54.2	
77	13.4	11.3	15.4	13.9	54.0	
78	15.5	11.9	15.8	15.8	59.0	
79	14.5	11.2	15.6	16.7	58.0	
80	15.5	12.8	16.8	15.6	60.7	
81	15.5	12.8	18.0	15.8	62.1	
82	16.4	12.9	18.0	16.7	64.0	

NOTE: ¹ Background is not subtracted from the data.

² If data are missing during a quarter, an average of known quarter readings for that year and location is used to fill in for the missing data.

Environmental Sample Results

Comanche Peak Steam Electric Station

Date	Lab No.	Station	Beta	Ba-140	Co-58	Co-60	Cs-134	Cs-137	Fe-59	H-3	I-131	La-140	Mn-54	Nb-95	Zn-65	Zr-95
Air Iodine pCi/m ³																
2005-01-04	ER050002 01										<6E-3					
2005-01-04	ER050004 57										<7E-3					
2005-01-11	ER050039 01										<7E-3					
2005-01-11	ER050037 57										<7E-3					
2005-01-18	ER050053 01										<5E-3					
2005-01-18	ER050055 57										<6E-3					
2005-01-25	ER050070 01										<9E-3					
2005-01-25	ER050068 57										<9E-3					
2005-02-01	ER050074 01										<4E-3					
2005-02-01	ER050076 57										<8E-3*					
2005-02-08	ER050089 01										<6E-3					
2005-02-08	ER050091 57										<7E-3					
2005-02-15	ER050109 01										<5E-3					
2005-02-15	ER050111 57										<5E-3					
2005-02-22	ER050113 01										<4E-3					
2005-02-22	ER050115 57										<5E-3					
2005-03-01	ER050126 01										<5E-3					
2005-03-01	ER050124 57										<4E-3					
2005-03-08	ER050136 01										<7E-3					
2005-03-08	ER050138 57										<7E-3					
2005-03-15	ER050151 01										<3E-3					
2005-03-15	ER050149 57										<7E-3					
2005-03-22	ER050165 01										<6E-3					
2005-03-22	ER050167 57										<7E-3					
2005-03-29	ER050187 01										<7E-3					
2005-03-29	ER050189 57										<7E-3					
2005-04-05	ER050203 01										<4E-3					
2005-04-05	ER050205 57										<5E-3					
2005-04-12	ER050217 01										<5E-3					
2005-04-12	ER050219 57										<6E-3					
2005-04-19	ER050236 01										<6E-3					
2005-04-19	ER050234 57										<7E-3					
2005-04-26	ER050248 01										<5E-3					
2005-04-26	ER050250 57										<5E-3					
2005-05-03	ER050271 01										<1.2E-2					
2005-05-03	ER050273 57										<8E-3					
2005-05-10	ER050269 01										<9E-3					
2005-05-10	ER050267 57										<9E-3					
2005-05-17	ER050275 01										<6E-3					
2005-05-17	ER050277 57										<6E-3					
2005-05-24	ER050288 01										<7E-3					
2005-05-24	ER050286 57										<6E-3					
2005-05-31	ER050310 01										<7E-3					
2005-05-31	ER050312 57										<7E-3					

*Flow was set at 30 lpm instead of 2 cfm.

Environmental Sample Results

Date	Lab. No.	Station	Beta	Ba-140	Co-58	Co-60	Cs-134	Cs-137	Fe-59	H-3	I-131	La-140	Mn-54	Nb-95	Zn-65	Zr-95
2005-06-07	ER050321 01										<7E-3					
2005-06-07	ER050323 57										<1.0E-2**					
2005-06-14	ER050334 01										<5E-3					
2005-06-14	ER050336 57										<5E-3					
2005-06-21	ER050342 01										<5E-3					
2005-06-21	ER050344 57										<8E-3					
2005-06-28	ER050351 01										<4E-3					
2005-06-28	ER050353 57										<5E-3					
2005-07-05	ER050380 01										<6E-3					
2005-07-05	ER050378 57										<9E-3					
2005-07-12	ER050385 01										<6E-3					
2005-07-12	ER050387 57										<7E-3					
2005-07-19	ER050408 01										<1.1E-2					
2005-07-19	ER050410 57										<7E-3					
2005-07-26	ER050431 01										<1.1E-2					
2005-07-26	ER050429 57										<9E-3					
2005-08-02	ER050438 01										<6E-3					
2005-08-02	ER050436 57										<6E-3					
2005-08-09	ER050445 01										<6E-3					
2005-08-09	ER050447 57										<5E-3					
2005-08-16	ER050454 01										<6E-3					
2005-08-16	ER050456 57										<6E-3					
2005-08-23	ER050445 01										<6E-3					
2005-08-23	ER050463 57										<6E-3					
2005-08-30	ER050473 01										<6E-3					
2005-08-30	ER050475 57										<7E-3					
2005-09-06	ER050487 01										<6E-3					
2005-09-06	ER050489 57										<5E-3					
2005-09-13	ER050497 01										<7E-3					
2005-09-13	ER050495 57										<6E-3					
2005-09-20	ER050504 01										<6E-3					
2005-09-20	ER050506 57										<6E-3					
2005-09-27	ER050512 01										<6E-3					
2005-09-27	ER050514 57										<7E-3					
2005-10-04	ER050528 01										<7E-3					
2005-10-04	ER050530 57										<7E-3					
2005-10-11	ER050568 01										<6E-3					
2005-10-11	ER050570 57										<6E-3					
2005-10-18	ER050588 01										<6E-3					
2005-10-18	ER050590 57										<7E-3					
2005-10-25	ER050605 01										<7E-3					
2005-10-25	ER050603 57										<7E-3					
2005-11-01	ER050615 01										<4E-3					
2005-11-01	ER050613 57										<6E-3					
2005-11-08	ER050622 01										<6E-3					
2005-11-08	ER050624 57										<6E-3					
2005-11-15	ER050635 01										<6E-3					
2005-11-15	ER050633 57										<6E-3					

**Sampler stopped prior to time of filter exchange.

Environmental Sample Results

Date	Lab. No.	Station	Beta	Ba-140	Co-58	Co-60	Cs-134	Cs-137	Fe-59	H-3	I-131	La-140	Mn-54	Nb-95	Zn-65	Zr-95
2005-11-22	ER050664 01									<1.1E-2						
2005-11-22	ER050662 57									<1.0E-2						
2005-11-29	ER050675 01									<6E-3						
2005-11-29	ER050673 57									<6E-3						
2005-12-06	ER050687 01									<7E-3						
2005-12-06	ER050685 57									<8E-3						
2005-12-13	ER050696 01									<3E-3						
2005-12-13	ER050694 57									<4E-3						
2005-12-20	ER050713 01									<4E-3						
2005-12-20	ER050711 57									<6E-3						
2005-12-27	ER050724 01									<7E-3						
2005-12-27	ER050726 57									<5E-3						
Air Particulate pCi/m ³																
2005-01-04	ER050001 01									1.6E-2						
2005-01-04	ER050003 57									1.5E-2						
2005-01-11	ER050038 01									3.3E-2						
2005-01-11	ER050036 57									2.8E-2						
2005-01-18	ER050052 01									3.7E-2						
2005-01-18	ER050054 57									3.2E-2						
2005-01-25	ER050069 01									4.9E-2						
2005-01-25	ER050067 57									4.4E-2						
2005-02-01	ER050075 01									2.2E-2						
2005-02-01	ER050077 57									2.6E-2*						
2005-02-08	ER050090 01									2.7E-2						
2005-02-08	ER050092 57									2.6E-2						
2005-02-15	ER050108 01									3.3E-2						
2005-02-15	ER050110 57									3.6E-2						
2005-02-22	ER050114 01									2.7E-2						
2005-02-22	ER050112 57									2.8E-2						
2005-03-01	ER050125 01									2.8E-2						
2005-03-01	ER050123 57									2.7E-2						
2005-03-08	ER050135 01									2.4E-2						
2005-03-08	ER050137 57									2.5E-2						
2005-03-15	ER050152 01									4.5E-2						
2005-03-15	ER050150 57									5.2E-2						
2005-03-22	ER050164 01									2.6E-2						
2005-03-22	ER050166 57									2.7E-2						
2005-03-29	ER050186 01									2.2E-2						
2005-03-29	ER050188 57									2.2E-2						
2005-04-05	ER050202 01									2.1E-2						
2005-04-05	ER050204 57									2.3E-2						
2005-04-12	ER050216 01									3.0E-2						
2005-04-12	ER050218 57									3.0E-2						
2005-04-19	ER050235 01									2.6E-2						
2005-04-19	ER050233 57									2.5E-2						
2005-04-26	ER050247 01									2.1E-2						
2005-04-26	ER050249 57									2.1E-2						

*Flow was set at 30 lpm instead of 2 cfm.

Environmental Sample Results

Date	Lab. No.	Station	Beta	Ba-140	Co-58	Co-60	Cs-134	Cs-137	Fe-59	H-3	I-131	La-140	Mn-54	Nb-95	Zn-65	Zr-95	
2005-05-03	ER050270 01		2.8E-2														
2005-05-03	ER050272 57		2.7E-2														
2005-05-10	ER050268 01		2.6E-2														
2005-05-10	ER050266 57		2.8E-2														
2005-05-17	ER050274 01		2.8E-2														
2005-05-17	ER050276 57		2.9E-2														
2005-05-24	ER050287 01		3.1E-2														
2005-05-24	ER050285 57		3.0E-2														
2005-05-31	ER050309 01		2.5E-2														
2005-05-31	ER050311 57		2.4E-2														
2005-06-07	ER050320 01		2.1E-2														
2005-06-07	ER050322 57		2.4E-2*														
2005-06-14	ER050333 01		1.8E-2														
2005-06-14	ER050335 57		1.5E-2														
2005-06-21	ER050341 01		3.0E-2														
2005-06-21	ER050343 57		2.6E-2														
2005-06-28	ER050350 01		3.2E-2														
2005-06-28	ER050352 57		3.2E-2														
2005-07-05	ER050379 01		2.0E-2														
2005-07-05	ER050377 57		1.8E-2														
2005-07-12	ER050386 01		2.3E-2														
2005-07-12	ER050388 57		2.2E-2														
2005-07-19	ER050409 01		1.9E-2														
2005-07-19	ER050411 57		1.8E-2														
2005-07-26	ER050432 01		1.9E-2														
2005-07-26	ER050430 57		1.6E-2														
2005-08-02	ER050439 01		2.5E-2														
2005-08-02	ER050437 57		2.3E-2														
2005-08-09	ER050446 01		2.3E-2														
2005-08-09	ER050448 57		2.3E-2														
2005-08-16	ER050455 01		1.8E-2														
2005-08-16	ER050457 57		1.6E-2														
2005-08-23	ER050464 01		1.5E-2														
2005-08-23	ER050462 57		1.5E-2														
2005-08-30	ER050474 01		1.9E-2														
2005-08-30	ER050476 57		2.1E-2														
2005-09-06	ER050486 01		4.3E-2														
2005-09-06	ER050488 57		2.9E-2														
2005-09-13	ER050496 01		3.5E-2														
2005-09-13	ER050494 57		2.8E-2														
2005-09-20	ER050503 01		1.9E-2														
2005-09-20	ER050505 57		1.4E-2														
2005-09-27	ER050511 01		2.4E-2														
2005-09-27	ER050513 57		2.1E-2														
2005-10-04	ER050527 01		2.9E-2														
2005-10-04	ER050529 57		2.4E-2														
2005-10-11	ER050567 01		2.1E-2														
2005-10-11	ER050569 57		1.7E-2														


**Sampler stopped prior to time of filter exchange.

South Texas Project


Radiation Branch Site No. 012

The South Texas Project (STP) is a commercial nuclear power plant operated by STP Nuclear Operating Company and is located 89 miles southwest of Houston and 14 miles south-southwest of Bay City. Two 1250 megawatt (electric) Westinghouse pressurized water reactor nuclear steam supply electrical generating units are in operation at the site. Unit 1 became operational in August of 1988 and Unit 2 in June of 1989.

STP Nuclear Operating Company is owned by AEP Central Power and Light Company, Austin Energy, City Public Service of San Antonio, and Reliant Energy HL&P. STP Nuclear Operating Company manages and operates the plant for its owners, who share its energy in proportion to their ownership interest. STP produces 2,500 megawatts of electricity annually, enough to serve more than one million homes in south central Texas. The Radiation Branch surveillance program consists of sampling air, water, sediment, fish, food products, and vegetation and TLD monitoring.





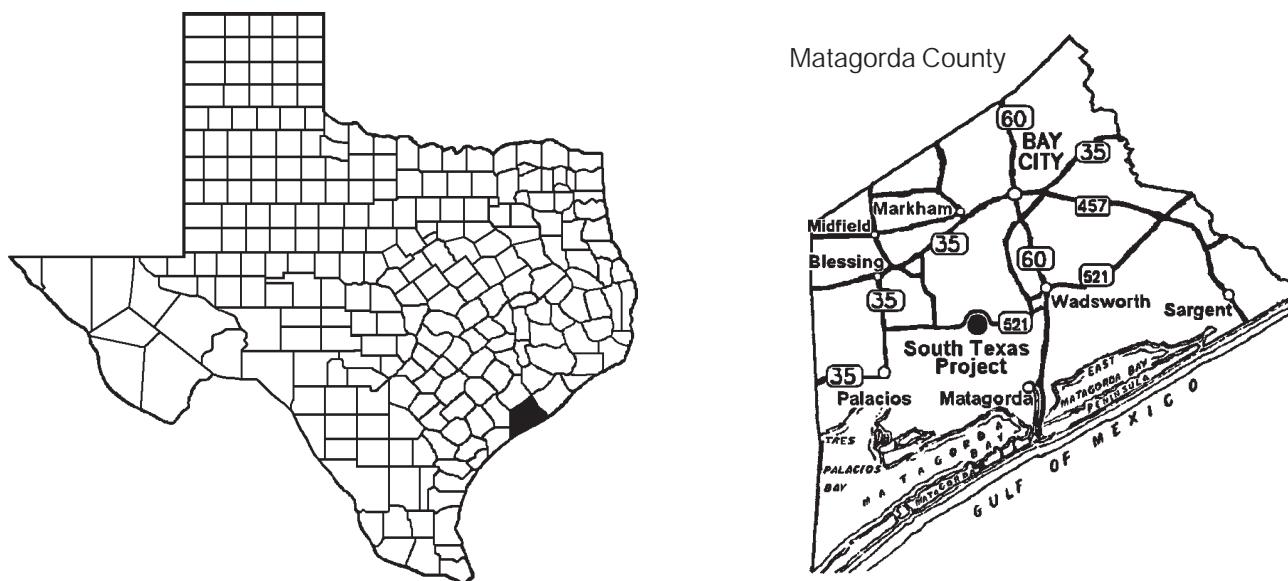


Shaded area indicates location of Matagorda County

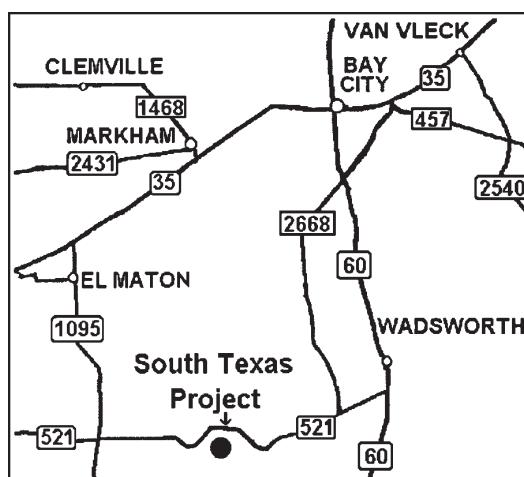

Monitoring Station Locations

Note: Sample type not indicated on maps.

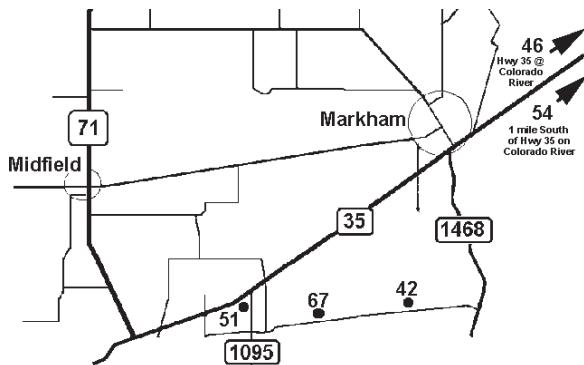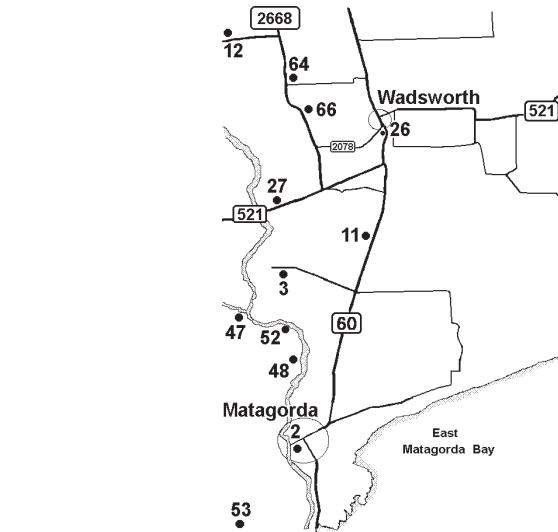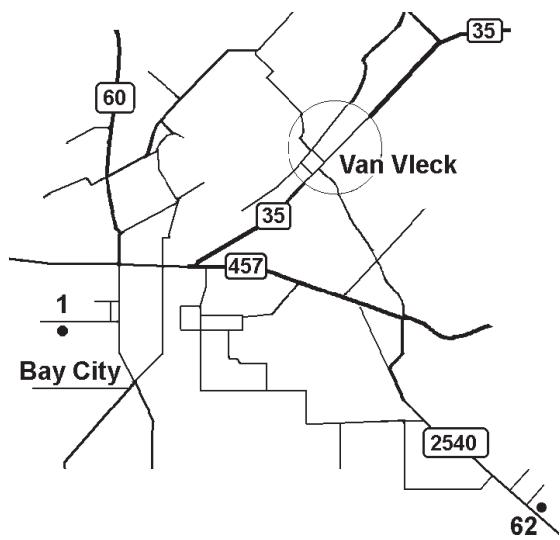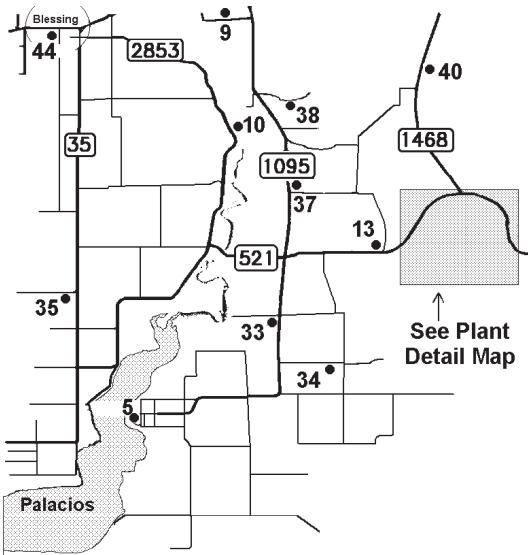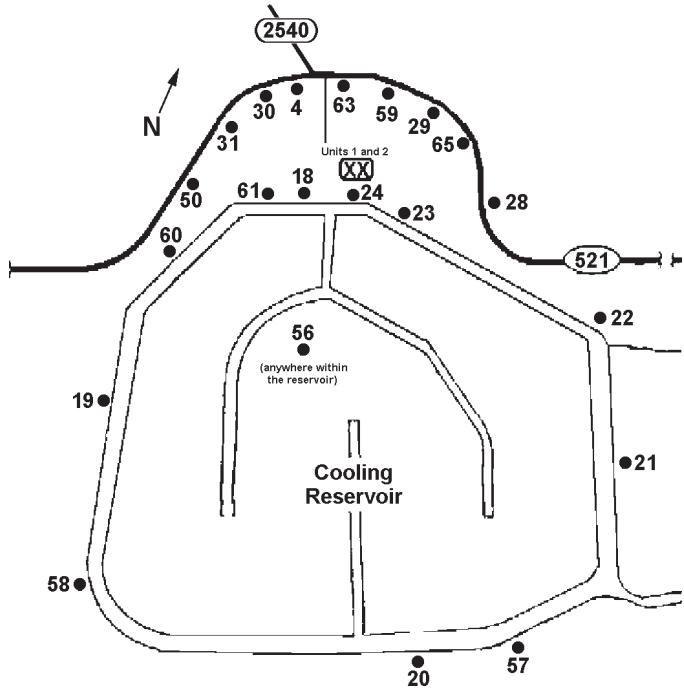

Thermoluminescent Dosimeter (TLD) Monitoring Results¹
 (quarterly and annual readings are in mrem)

Station	Q1	Q2	Q3	Q4	Annual	
					Dose	Notes
01	16.3	13.9	15.0	17.0	62.2	
02	16.3	13.9	15.0	17.0	62.2	
03	14.1	12.1	12.0	13.0	51.2	
04	17.3	15.8	15.0	17.0	65.1	
05	14.1	13.0	13.0	16.0	56.1	
09	16.3	15.8	16.0	18.0	66.1	
10	16.3	14.9	15.0	17.0	63.2	
11	16.3	13.9	14.0	16.0	60.2	
12	16.3	14.9	16.0	17.0	64.2	
13	17.3	15.8	16.0	17.0	66.1	
18	16.3	13.9	14.0	16.0	60.2	
19	15.2	13.9	13.0	17.0	59.1	
20	16.3	--	14.0	16.0	61.7	² Q2 TLD missing
21	15.2	13.0	13.0	16.0	57.2	
22	16.3	13.9	14.0	16.0	60.2	
23	16.3	13.9	14.0	17.0	61.2	
24	15.2	13.0	13.0	16.0	57.2	
26	15.2	13.0	13.0	15.0	56.2	
27	15.2	12.1	13.0	15.0	55.3	
28	17.3	13.9	15.0	18.0	64.2	
29	17.3	14.9	15.0	16.0	63.2	
30	16.3	13.9	14.0	17.0	61.2	
31	18.4	15.8	16.0	19.0	69.2	
33	17.3	15.8	15.0	17.0	65.1	
34	16.3	13.9	15.0	17.0	62.2	
35	16.3	13.9	14.0	17.0	61.2	
37	18.4	15.8	16.0	17.0	67.2	
38	17.3	13.0	14.0	17.0	61.3	
40	15.2	13.0	14.0	16.0	58.2	
42	20.6	16.7	18.0	20.0	75.3	
44	14.1	13.0	14.0	16.0	57.1	
50	18.4	16.7	17.0	20.0	72.1	
51	18.4	15.8	15.0	18.0	67.2	
57	16.3	13.0	14.0	17.0	60.3	
58	15.2	12.1	13.0	17.0	57.3	
59	16.3	14.9	15.0	18.0	64.2	
60	16.3	13.9	14.0	17.0	61.2	
61	16.3	13.0	14.0	16.0	59.3	
62	18.4	15.8	17.0	18.0	69.2	
63	17.3	13.9	15.0	18.0	64.2	
64	17.3	14.9	15.0	17.0	64.2	
65	17.3	13.9	15.0	17.0	63.2	
66	16.3	13.9	15.0	17.0	62.2	
67	16.3	15.8	16.0	18.0	66.1	

NOTE: ¹ Background is not subtracted from the data.

² If data are missing during a quarter, an average of known quarter readings for that year and location is used to fill in for the missing data.

South Texas Project

South Texas Project

Environmental Sample Results

Date	Lab No.	Station	Beta	Ba-140	Co-60	Cs-134	Cs-137	Fe-59	H-3	I-131	La-140	Mn-54	Nb-95	Zn-65	Zr-95
Air Iodine pCi/m ³															
2005-01-04	ER050016	30								<9E-3					
2005-01-04	ER050014	35								<8E-3					
2005-01-11	ER050043	30								<6E-3					
2005-01-11	ER050041	35								<5E-3					
2005-01-17	ER050051	30								<8E-3					
2005-01-17	ER050049	35								<7E-3					
2005-01-25	ER050066	30								<8E-3					
2005-01-25	ER050064	35								<7E-3					
2005-02-01	ER050081	30								<5E-3					
2005-02-01	ER050079	35								<7E-3					
2005-02-08	ER050096	30								<9E-3					
2005-02-08	ER050094	35								<8E-3					
2005-02-15	ER050107	30								<6E-3					
2005-02-15	ER050105	35								<6E-3					
2005-02-22	ER050122	30								<5E-3					
2005-02-22	ER050120	35								<6E-3					
2005-03-01	ER050147	30								<1.1E-2					
2005-03-01	ER050145	35								<1.6E-2					
2005-03-08	ER050142	30								<2.0E-2					
2005-03-08	ER050140	35								<8E-3					
2005-03-15	ER050156	30								<5E-3					
2005-03-15	ER050154	35								<5E-3					
2005-03-22	ER050161	30								<4E-3					
2005-03-22	ER050159	35								<5E-3					
2005-03-29	ER050171	30								<7E-3					
2005-03-29	ER050169	35								<6E-3					
2005-04-05	ER050209	30								<7E-3					
2005-04-05	ER050207	35								<7E-3					
2005-04-12	ER050223	30								<7E-3					
2005-04-12	ER050221	35								<6E-3					
2005-04-19	ER050232	30								<6E-3					
2005-04-19	ER050230	35								<6E-3					
2005-04-27	ER050257	30								<4.4 *					
2005-05-03	ER050255	35								<7E-3					
2005-05-03	ER050260	35								---	**				
2005-05-10	ER050264	30								<1.0E-2					
2005-05-10	ER050262	35								<6E-3					
2005-05-17	ER050282	30								<7E-3					
2005-05-17	ER050280	35								<7E-3					
2005-05-24	ER050292	30								<5E-3					
2005-05-24	ER050290	35								<5E-3					
2005-05-31	ER050319	30								<1.0E-2					
2005-05-31	ER050317	35								<9E-3					

*Units expressed as pCi/sample; loss of electrical power/instrument failure

**Sample unavailable

Environmental Sample Results

Date	Lab. No.	Station	Beta	Ba-140	Co-58	Co-60	Cs-134	Cs-137	Fe-59	H-3	I-131	La-140	Mn-54	Nb-95	Zn-65	Zr-95
2005-06-08	ER050328	30								<6E-3						
2005-06-08	ER050326	35								<4E-3						
2005-06-14	ER050340	30								<8E-3						
2005-06-14	ER050338	30								<8E-3						
2005-06-21	ER050348	30								<6E-3						
2005-06-21	ER050346	35								<6E-3						
2005-06-28	ER050361	30								<7E-3						
2005-06-28	ER050359	35								<9E-3						
2005-07-05	ER050384	30								<7E-3						
2005-07-05	ER050382	35								<1.0E-2						
2005-07-12	ER050392	30								<9E-3						
2005-07-12	ER050390	35								<8E-3						
2005-07-19	ER050423	30								<2.0E-2***						
2005-07-19	ER050421	35								<8E-3						
2005-07-26	ER050427	30								<4.3 *						
2005-07-26	ER050425	35								<3E-3						
2005-08-02	ER050443	30								<1.0E-2						
2005-08-02	ER050441	35								<8E-3						
2005-08-09	ER050452	30								<7E-3						
2005-08-09	ER050450	35								<3E-3						
2005-08-16	ER050461	30								<9E-3						
2005-08-16	ER050459	35								<8E-3						
2005-08-23	ER050469	30								<1.0E-2						
2005-08-23	ER050467	35								<9E-3						
2005-08-30	ER050480	30								<7E-3 ***						
2005-08-30	ER050478	35								<6E-3						
2005-09-07	ER050493	30								<5E-3						
2005-09-07	ER050491	35								<5E-3						
2005-09-13	ER050500	30								<1.0E-2***						
2005-09-13	ER050499	35								<7E-3						
2005-09-20	ER050510	30								<9E-3						
2005-09-20	ER050508	35								<8E-3						
2005-09-27	ER050522	30								<6E-3						
2005-09-27	ER050520	35								<6E-3						
2005-10-06	ER050558	30								<7E-3						
2005-10-06	ER050556	35								<7E-3						
2005-10-12	ER050577	30								<4E-3						
2005-10-12	ER050575	35								<6E-3						
2005-10-19	ER050598	30								<6E-3						
2005-10-19	ER050596	35								<6E-3						
2005-10-26	ER050610	30								<6E-3						
2005-10-26	ER050608	35								<5E-3						
2005-11-02	ER050619	30								<8E-3						
2005-11-02	ER050617	35								<8E-3						
2005-11-08	ER050629	30								<9E-3						
2005-11-08	ER050627	35								<5E-3						
2005-11-15	ER050652	30								<7E-3						
2005-11-15	ER050650	35								<6E-3						

*Units expressed as pCi/sample; loss of electrical power/instrument failure
 **Flow rate assumed to be 2.0 cfm at stop time:loss of electrical power/instrument failure

Environmental Sample Results

Date	Lab. No.	Station	Beta	Ba-140	Co-58	Co-60	Cs-134	Cs-137	Fe-59	H-3	I-131	La-140	Mn-54	Nb-95	Zn-65	Zr-95
2005-11-22	ER050660	30									<9E-3					
2005-11-22	ER050658	35									<9E-3					
2005-11-29	ER050682	30									<7E-3					
2005-11-29	ER050680	35									<6E-3					
2005-12-07	ER050691	30									<6E-3					
2005-12-07	ER050689	35									<6E-3					
2005-12-13	ER050703	30									<6E-3					
2005-12-13	ER050701	35									<8E-3					
2005-12-20	ER050717	30									<7E-3					
2005-12-20	ER050715	35									<1.0E-2					
2005-12-27	ER060008	30									<1.1E-2					
2005-12-27	ER060006	35									<1.1E-2					
Air Particulate pCi/m ³																
2005-01-04	ER050015	30									1.5E-2					
2005-01-04	ER050013	35									1.3E-2					
2005-01-11	ER050042	30									2.5E-2					
2005-01-11	ER050040	35									2.3E-2					
2005-01-17	ER050050	30									3.2E-2					
2005-01-17	ER050048	35									3.0E-2					
2005-01-25	ER050065	30									2.6E-2					
2005-01-25	ER050063	35									2.6E-2					
2005-02-01	ER050080	30									2.5E-2					
2005-02-01	ER050078	35									2.4E-2					
2005-02-08	ER050095	30									2.3E-2					
2005-02-08	ER050093	35									2.1E-2					
2005-02-15	ER050106	30									2.6E-2					
2005-02-15	ER050104	35									2.3E-2					
2005-02-22	ER050121	30									3.0E-2					
2005-02-22	ER050119	35									2.8E-2					
2005-03-01	ER050146	30									2.1E-2					
2005-03-01	ER050144	35									2.0E-2					
2005-03-08	ER050141	30									2.3E-2					
2005-03-08	ER050139	35									2.2E-2					
2005-03-15	ER050155	30									2.1E-2					
2005-03-15	ER050153	35									2.1E-2					
2005-03-22	ER050160	30									2.3E-2					
2005-03-22	ER050158	35									2.0E-2					
2005-03-29	ER050170	30									2.2E-2					
2005-03-29	ER050168	35									2.1E-2					
2005-04-05	ER050208	30									2.2E-2					
2005-04-05	ER050206	35									2.0E-2					
2005-04-12	ER050222	30									2.7E-2					
2005-04-12	ER050220	35									2.7E-2					
2005-04-19	ER050231	30									2.4E-2					
2005-04-19	ER050229	35									2.4E-2					
2005-04-27	ER050256	30									3.5*					
2005-04-27	ER050254	35									1.9E-2					

*Units expressed as pCi/sample; loss of electrical power/instrument failure

This page intentionally blank


Radioactive Waste

Processors


This page intentionally blank

Nuclear Sources and Services, Inc. Radiation Branch Site No. 023

The Nuclear Sources and Services, Inc. (NSSI) facility occupies approximately 5 acres in a light industrial area of Southeast Houston approximately 4 miles northwest of William P. Hobby Airport. The primary activities of NSSI currently are waste treatment, storage, and disposal of radioactive and chemical hazardous materials. NSSI receives wastes from a variety of offsite generators both inside and outside of Texas. At the conclusion of treatment or storage, the residues are shipped to permitted offsite facilities for disposal. The Radiation Branch surveillance program consists of soil sampling and TLD monitoring.

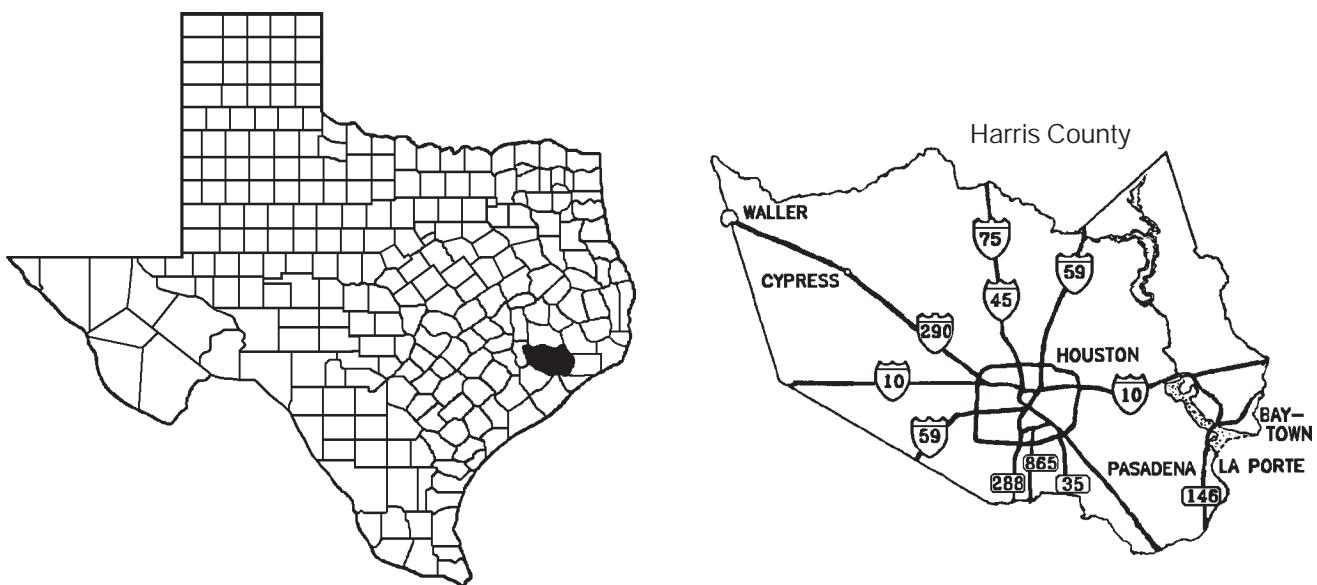


Shaded area indicates location of Harris County

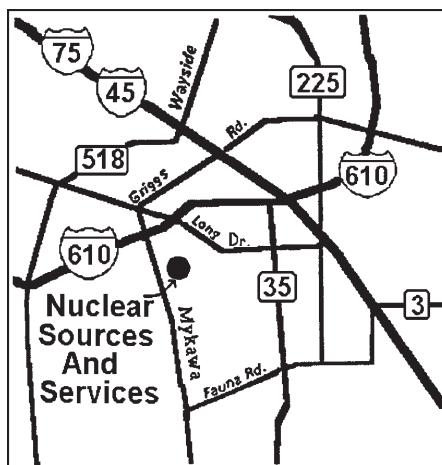

Monitoring Station Locations

◆ TLD Station ♥ Sample Station ♣ TLD & Sample Station

Homeland Security --
Diagram Removed

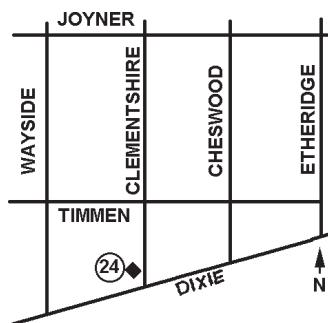

Thermoluminescent Dosimeter (TLD) Monitoring Results¹
 (quarterly and annual readings are in mrem)

Station	Q1	Q2	Q3	Q4	Annual ²	
					Dose	Notes
03	180.9	115.1	86.0	104.0	486.0	
04	41.7	13.9	14.0	16.0	85.6	
06	9.9	0.9	1.0	3.0	14.8	
07	106.3	10.2	9.0	22.0	147.5	
11	8.8	0.9	2.0	1.0	12.7	
12	16.4	1.9	4.0	10.0	32.3	
16	17.5	13.9	19.0	22.0	72.4	
18	15.3	0.9	1.0	4.0	21.2	
19	26.3	9.3	11.0	17.0	63.6	
20	27.4	12.1	12.0	13.0	64.5	
21	279.6	37.1	53.0	169.0	538.7	
22	3.3	0.9	2.0	1.0	7.2	
23	5.5	12.1	7.0	3.0	27.6	
24	17.5	13.9	13.0	16.0	60.4	Background
24	2.2	0.9	1.0	1.0	5.1	Background TLD provided by Landauer, Inc.
25	54.8	51.1	42.0	122.0	269.9	
41	82.2	17.6	13.0	17.0	129.8	

NOTE: ¹Combined neutron/gamma dosimeters are deployed at this facility. Exposure reported includes neutron and gamma doses.

²Occupancy factor not provided.

Environmental Sample Results


Date	Lab No.	Station	Alpha	Ra-226*	Am-241	Co-60	Cs-137	I-125	Ra-226	
Soil µCi/g										
2005-01-14	ER050046	26		1.3E-5	9E-7	<3E-7	<2E-7	3.7E-6	<3E-7	<3.5E-6
2005-01-14	ER050045	28		6.4E-5	8E-7	<5E-7	<4E-7	1.4E-6	<5E-7	<4.3E-6
2005-04-07	ER050213	26		2.7E-5	9E-7	<3E-7	<1E-7	1.9E-5	<4E-7	<4.3E-6
2005-04-07	ER050212	28		3.3E-5	1.2E-6	<3E-7	<2E-7	<2E-7	<3E-7	<2.7E-6
2005-07-14	ER050394	26		2.0E-5	1.0E-6	<3E-7	<2E-7	3.2E-6	<3E-7	<3.2E-6
2005-07-14	ER050395	28		2.7E-5	1.0E-6	<3E-7	<2E-7	<3E-7	<4E-7	3.1E-6
2005-10-13	ER050572	26		2.0E-5	8E-7	<3E-7	<2E-7	1.0E-6	<2E-7	<2.8E-6
2005-10-13	ER050573	28		2.6E-5	1.4E-6	<2E-7	<2E-7	<2E-7	<2E-7	<2.3E-6

NOTE: *Indicates the analysis was by alpha spectrometry, or if Ra-226, analysis by radon emanation.


This page intentionally blank

Waste Control Specialists Radiation Branch Site No. 048

Waste Control Specialists (WCS) facility occupies 14,400 acres, in Andrews County approximately 30 miles west of Andrews on the Texas-New Mexico border. Approximately 1,300 acres are devoted to low-level radioactive waste storage. The primary activities of WCS currently are treatment, storage, and disposal of radioactive and hazardous wastes. The Radiation Branch surveillance program consists of sampling water, sewage, and soil and TLD monitoring.

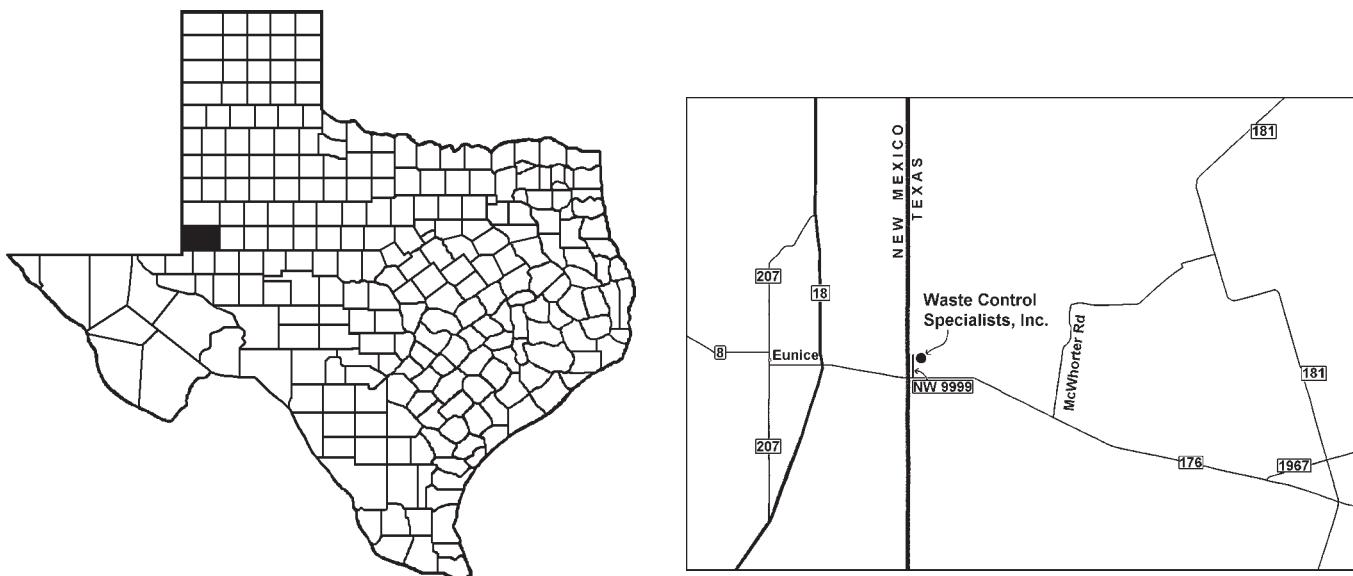


Shaded area indicates location of Andrews County

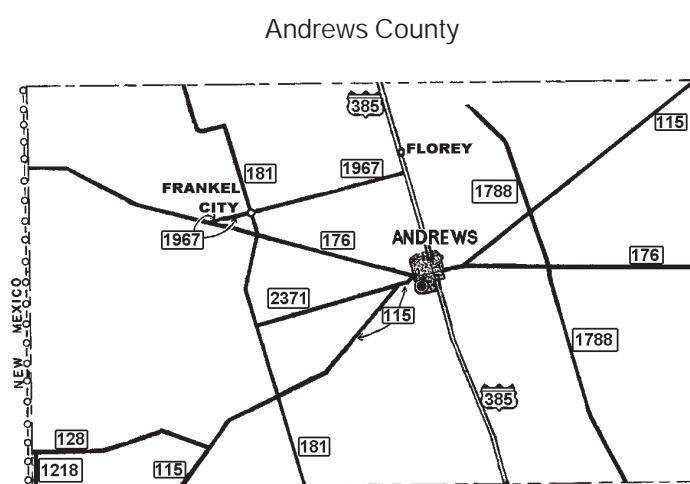

Monitoring Station Locations

◆ TLD Station	♥ Sample Station	♣ TLD & Sample Station
----------------------	-------------------------	-----------------------------------

Homeland Security --
Diagram Removed

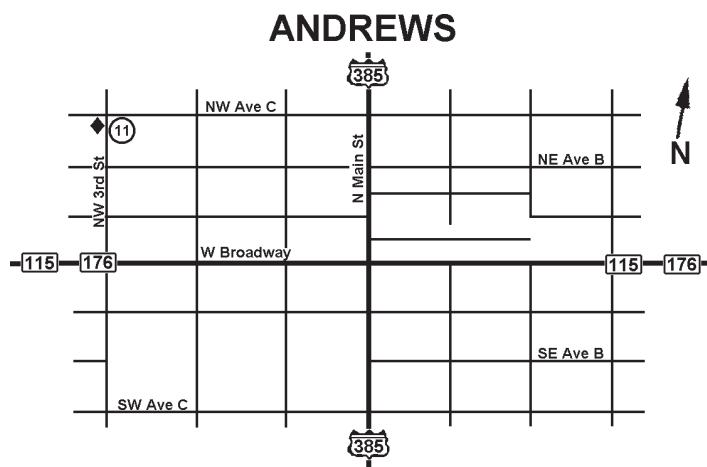

Thermoluminescent Dosimeter (TLD) Monitoring Results
(quarterly and annual readings are in mrem)

Station	Quarterly Readings				Annual*	
	Q1	Q2	Q3	Q4	Dose	Note
01	--	--	--	--	--	TLD removed due to future site expansion
02	0.0	0.0	0.0	0.0	0.0	
03	0.0	0.0	0.0	0.0	0.0	
04	0.0	0.0	0.0	0.0	0.0	
05	0.0	0.0	0.0	0.0	0.0	
11	22.5	18.4	20.4	21.9	83.2	Background

NOTE: *Value does not include 1/48 occupancy factor for TLD stations 2, 4, and 5 or 1/20 occupancy factor for TLD station 3.


This page intentionally blank

Research Reactors


This page intentionally blank

Texas A & M University Nuclear Science Center Radiation Branch Site No. 001

Texas A&M Nuclear Science Center (NSC) is located seven miles south of downtown Bryan just south of Easterwood Airport. NSC houses a one-megawatt TRIGA (Testing, Research, Isotope Production, General Atomics) research reactor that came online in 1961. The Radiation Branch surveillance program consists of sediment sampling and TLD monitoring.

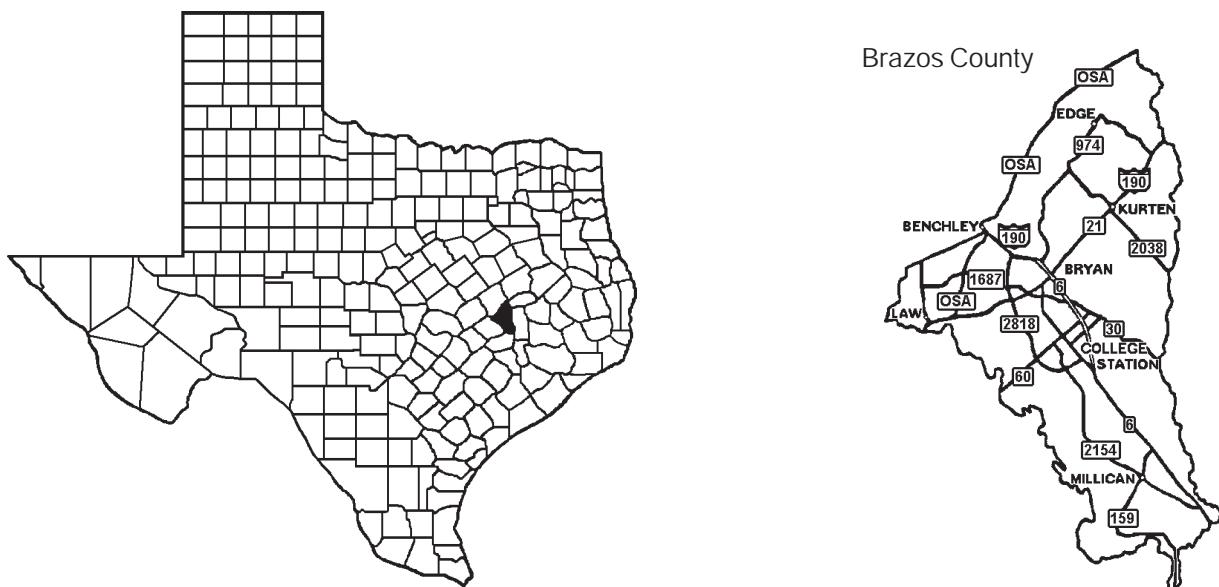


Shaded area indicates location of Brazos County

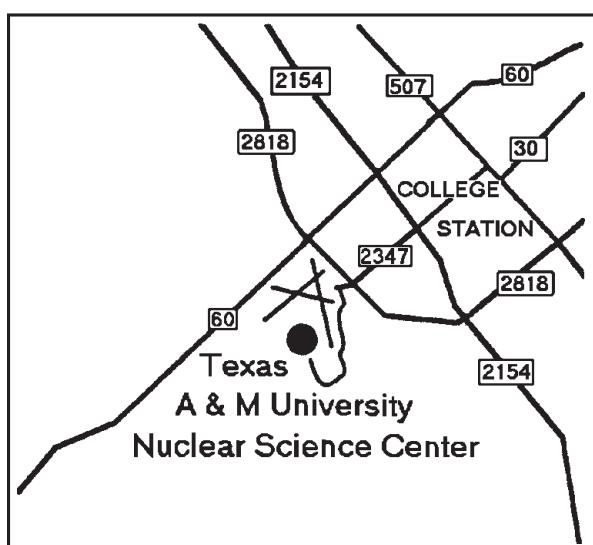

Monitoring Station Locations

◆ TLD Station ♥ Sample Station ♣ TLD & Sample Station

Homeland Security --
Diagram Removed

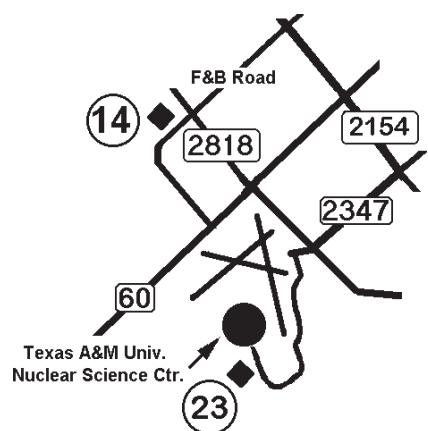

Thermoluminescent Dosimeter (TLD) Monitoring Results
(quarterly and annual readings are in mrem)

Station	Q1	Q2	Q3	Q4	Annual ²	
					Dose	Notes
02	3.7	5.6	4.8	4.4	18.5	
03	0.0	1.9	1.0	1.1	4.0	
04	6.1	9.4	6.5	5.7	27.7	
05	2.5	2.8	1.9	2.2	9.4	
10	0.0	2.8	1.0	0.0	3.8	
11	1.2	0.9	1.0	0.0	3.1	
14	22.1	--	16.3	--	76.8	Background; 1Q2 and 4 TLD missing
18	4.9	3.8	2.9	2.2	13.8	
19	2.5	0.9	2.9	4.4	10.7	
20	0.0	3.8	0.0	0.0	3.8	
21	0.0	0.0	0.0	0.0	0.0	
22	0.0	0.0	0.0	0.0	0.0	
23	22.1	14.1	15.3	20.8	72.3	Background

NOTE: ¹If data are missing during a quarter, an average of known quarter readings for that year and location is used to fill in for the missing data.

²Value does not include 1/16 occupancy factor.


Environmental Sample Results

Texas A & M University Nuclear Science Center


Date	Lab No.	Station	Ba-140	Co-58	Co-60	Cs-134	Cs-137	Fe-59	I-131	La-140	Mn-54	Nb-95	Sb-124	Sc-46	Zn-65	Zr-95
Sediment $\mu\text{Ci/g}$																
2005-01-26	ER050062	16	<1.8E-6	<4E-7	5E-7	<5E-7	<6E-7	<6E-7	<4E-7	<4E-7	<4E-7	<4E-7	4.8E-5	2.3E-5	<2.0E-6	<7E-7
2005-04-05	ER050215	16	<8E-7	<2E-7	1.2E-6	<2E-7	<2E-7	<3E-7	<3E-7	<2E-7	<2E-7	<2E-7	--	4.7E-6	<1.0E-6	<3E-7
2005-07-11	ER050398	16	<7E-7	<2E-7	6E-7	<2E-7	<2E-7	<2E-7	<3E-7	<2E-7	1.8E-6	<2E-7	2.3E-6	3.1E-6	<7E-7	<3E-7
2005-10-13	ER050593	16	<5E-7	<1E-7	6E-7	<1E-7	<1E-7	<2E-7	<1E-7	<1E-7	1.0E-6	<1E-7	4E-7	--	<3E-7	<2E-7

**University of Texas Nuclear
Engineering Teaching Laboratory
Radiation Branch Site No. 003**

U. T. Nuclear Engineering Teaching Laboratory (NETL) is located at the J. J. Pickle Research Center, approximately five miles north of the Texas Department of State Health Services main campus. NETL houses an above-ground, fixed-core 1.1 megawatt TRIGA (Testing, Research, Isotope Production, General Atomics) research reactor that came online in 1992. The Radiation Branch surveillance program consists of sampling water and sewage and TLD monitoring.

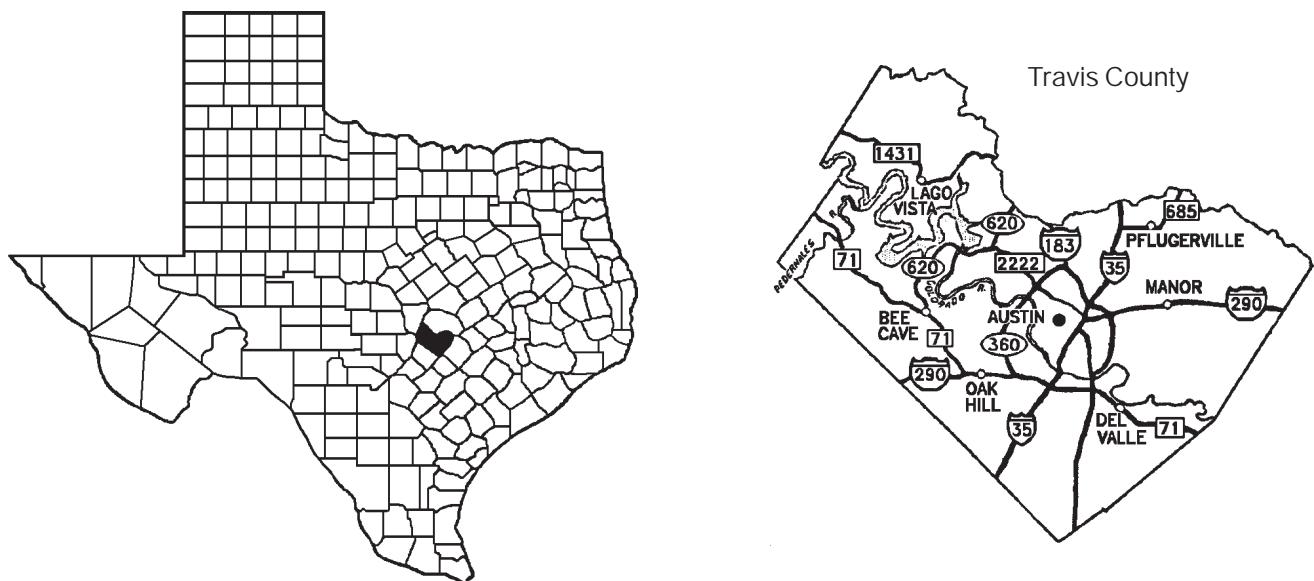


Shaded area indicates location of Travis County

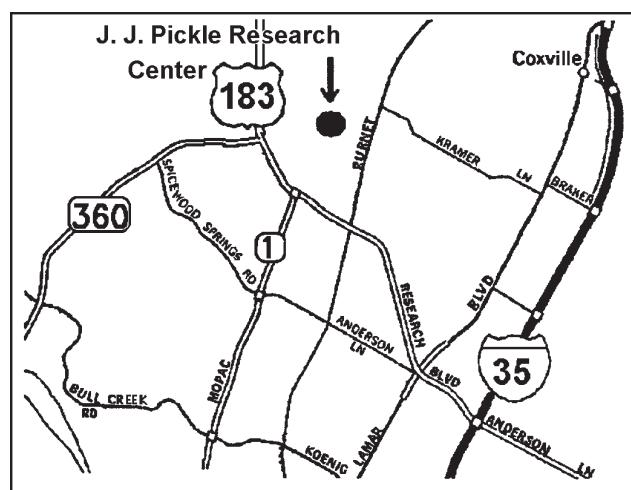

Monitoring Station Locations

◆ TLD Station	♥ Sample Station	♣ TLD & Sample Station
---------------	------------------	------------------------

Homeland Security --
Diagram Removed

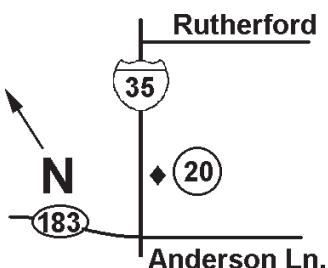

Thermoluminescent Dosimeter (TLD) Monitoring Results
(quarterly and annual readings are in mrem)

Station	Q1	Q2	Q3	Q4	Annual*	
					Dose	Note
01	0.0	0.0	0.0	0.0	0.0	
02	0.0	0.0	0.0	0.0	0.0	
03	0.0	0.0	0.0	0.0	0.0	
04	5.9	1.0	2.0	2.0	10.9	
05	1.0	1.0	0.0	8.0	10.0	
20	15.8	14.5	13.8	16.0	60.1	Background

NOTE: *Occupancy factor not provided.

University of Texas Nuclear Engineering Teaching Laboratory

Environmental Sample Results

Date	Lab No.	Station	Ba-140	Co-58	Co-60	Cs-134	Cs-137	Fe-59	H-3	I-131	La-140	Mn-54	Nb-95	Zn-65	Zr-95
Sewage $\mu\text{Ci/ml}$															
2005-01-20	ER050056	08	<2.1E-8	<6.1E-9	<6.2E-9	<5.4E-9	<6.4E-9	<1.2E-8	<1.0E-6	<6.3E-9	<7.4E-9	<6.1E-9	<6.2E-9	<1.3E-8	<1.1E-8
2005-04-22	ER050238	09	<2.2E-8	<6.1E-9	<7.7E-9	<6.5E-9	<6.6E-9	<1.3E-8	<1.0E-6	<6.1E-9	<7.1E-9	<6.7E-9	<6.5E-9	<1.6E-8	<1.2E-8
2005-07-19	ER050397	08	<3.4E-8	<6.7E-9	<7.7E-9	<6.1E-9	<6.8E-9	<1.5E-8	<1.5E-8	<1.3E-8	<1.2E-8	<6.5E-9	<7.1E-9	<1.5E-8	<1.3E-8
2005-10-19	ER050594	09	<1.4E-8	<3.9E-9	<4.2E-9	<3.9E-9	<4.5E-9	<7.0E-9	<1.0E-9	<4.5E-9	<4.1E-9	<4.9E-9	<4.1E-9	<3.8E-9	<8.7E-9

Surface water samples from Station 07 were unavailable in 2005.


This page intentionally blank

Other Facilities


This page intentionally blank

Gammatron, Inc.
Radiation Branch Site No. 018

Gammatron, Inc. is a manufacturer of sealed radioactive sources, specializing in Am241Be and Am241Li neutron sources and Cs137 gamma sources. The facility is located in an industrial area of Houston approximately 4 miles northwest of William P. Hobby Airport. The Radiation Branch surveillance program consists of soil sampling and TLD monitoring.

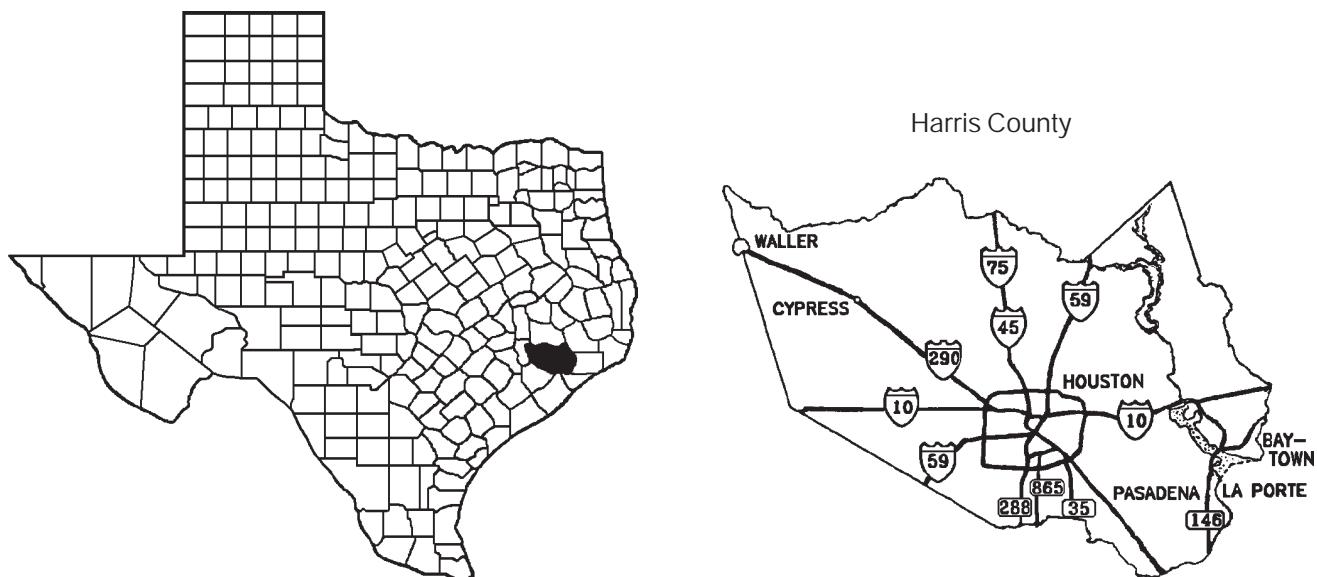


Shaded area indicates location of Harris County

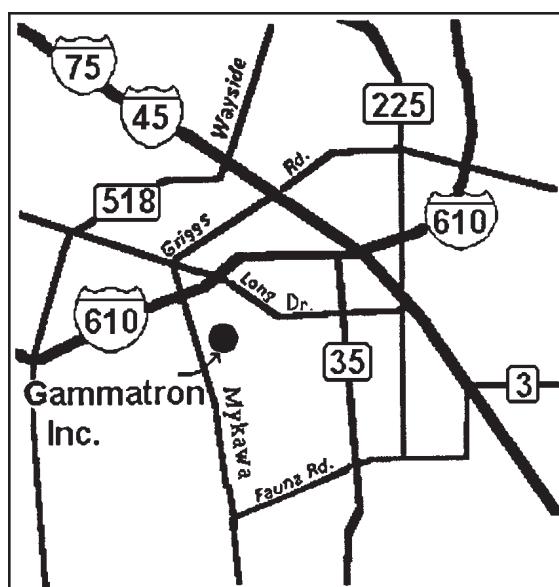

Monitoring Station Locations

◆ TLD Station	♥ Sample Station	♣ TLD & Sample Station
---------------	------------------	------------------------

Homeland Security --
Diagram Removed

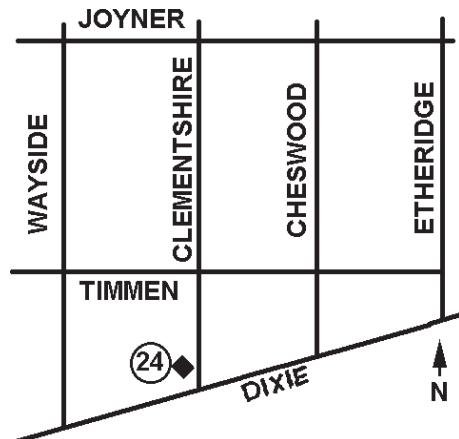

Thermoluminescent Dosimeter (TLD) Monitoring Results¹
(quarterly and annual readings are in mrem)

Station	Q1	Q2	Q3	Q4	Annual ²		Notes
					Dose		
03	118.4	125.4	116.0	142.0	501.8		
05	99.8	129.1	148.0	--	502.5		³ Q4 TLD missing
08	143.6	167.1	158.0	211.0	679.7		
24	17.5	13.9	13.0	16.0	60.4		Background
24	2.2	0.9	1.0	1.0	5.1		Background TLD provided by Landauer, Inc.
30	74.6	50.1	50.0	70.0	244.7		
31	16.4	8.4	8.0	11.0	43.8		
34	195.2	226.6	160.0	165.0	746.8		
40	58.1	21.4	15.0	51.0	145.5		Q2 photon and beta evaluation only; neutron component lost

NOTE: ¹Combined neutron/gamma dosimeters are deployed at this facility. Exposure reported includes neutron and gamma doses.

²Occupancy factor not provided.

³If data are missing during a quarter, an average of known quarter readings for that year and location is used to fill in for the missing data.



Environmental Sample Results

Date	Lab No.	Station	Alpha	Ra-226*	Am-241	Co-60	Cs-137	Ra-226
Soil µCi/g								
2005-01-14	ER050047	31		1.3E-5	8E-7	<1.1E-6	<2E-7	<2E-7
2005-04-07	ER050214	31		3.4E-5	1.0E-6	<3E-7	<2E-7	<2E-7
2005-07-14	ER050396	31		2.6E-5	2.2E-6	<3E-7	<2E-7	<2E-7
2005-10-13	ER050571	31		2.2E-5	1.0E-6	<3E-7	<2E-7	<2E-7


NOTE: *Indicates the analysis was by alpha spectrometry, or if Ra-226, analysis by radon emanation.

GeoCo, Inc.
Radiation Branch Site No. 051

GeoCo, Inc. is a tracer studies company specializing in oil and gas wells. The facility is located in Midland approximately six miles east of Midland-Odessa International Airport. The Radiation Branch surveillance program consists of TLD monitoring.

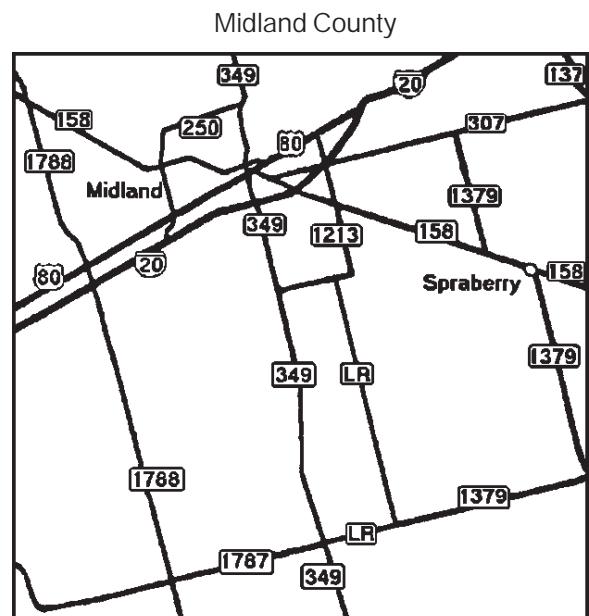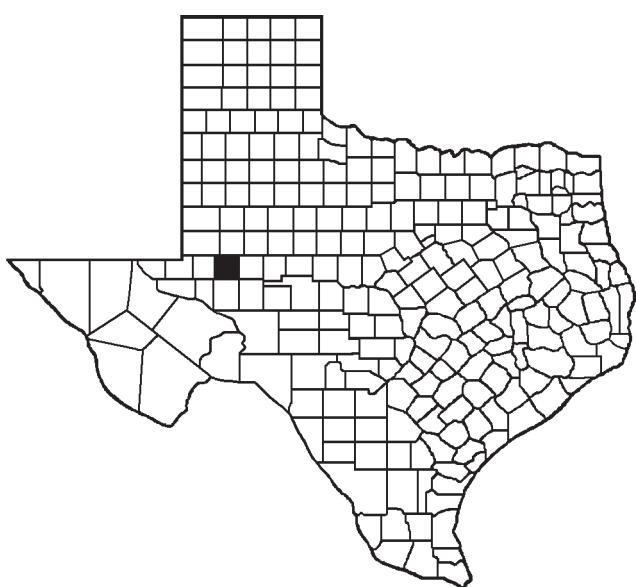

Shaded area indicates location of Midland County

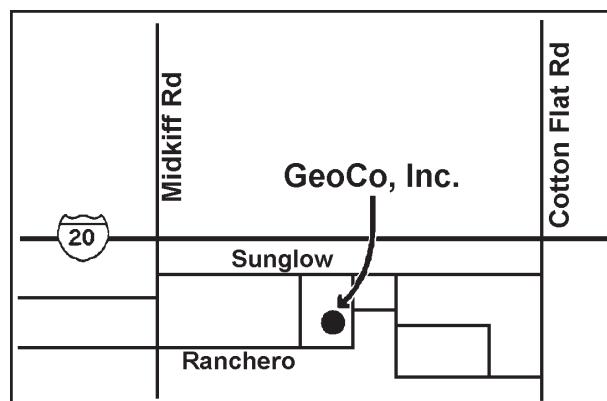

Monitoring Station Locations

◆ TLD Station ♥ Sample Station ♣ TLD & Sample Station

Homeland Security --
Diagram Removed




Thermoluminescent Dosimeter (TLD) Monitoring Results
(quarterly and annual readings are in mrem)

Station	Q1	Q2	Q3	Q4	Annual*	
					Dose	Notes
01	130.6	87.5	99.1	90.1	407.3	
08	20.3	15.6	17.4	19.3	72.6	Background


Note: *Value does not include 1/10 occupancy factor.

Isotech Laboratories, Inc. Radiation Branch Site No. 008

Isotech Laboratories, Inc. manufactures tracer material for the oil and gas industry, calibrates radiation detection instruments, and provides radiation safety training for well-logging and tracer services. The facility is located in Midland approximately six miles east of Midland-Odessa International Airport. The Radiation Branch surveillance program consists of TLD monitoring.

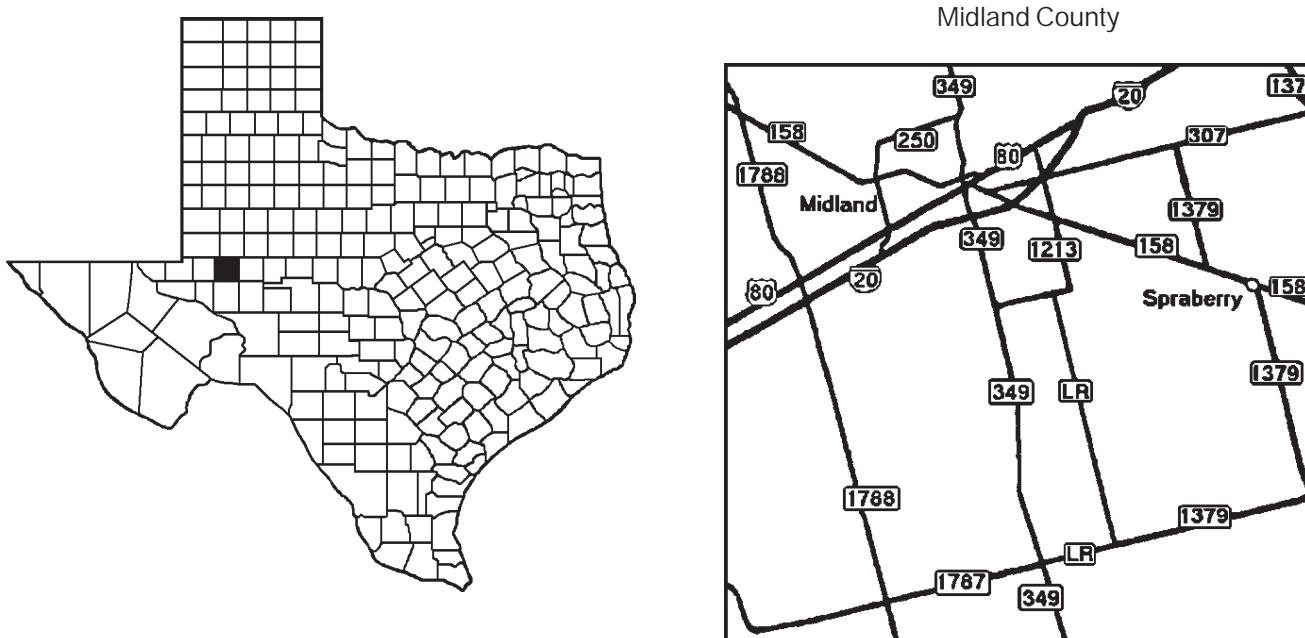

Shaded area indicates location of Midland County

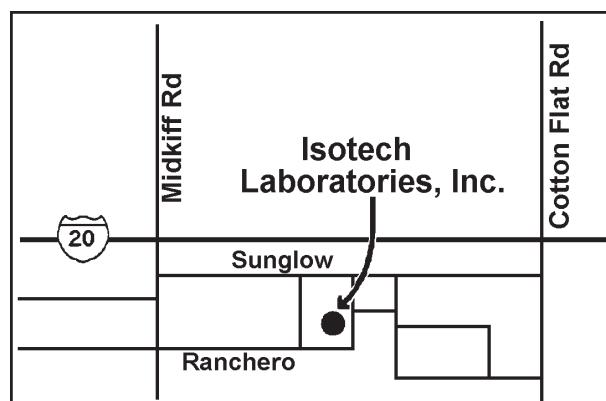

Monitoring Station Locations

◆ TLD Station ♥ Sample Station ♣ TLD & Sample Station

Homeland Security --
Diagram Removed




Thermoluminescent Dosimeter (TLD) Monitoring Results
(quarterly and annual readings are in mrem)

Station	Annual*				Notes
	Q1	Q2	Q3	Q4	
01	10.7	6.1	8.1	7.4	32.3
02	86.7	55.1	37.4	51.1	230.3
03	53.5	36.8	28.3	34.4	153.0
04	79.2	40.3	34.4	51.1	205.0
06	76.0	46.4	28.3	36.2	186.9
08	20.3	15.8	17.4	19.3	72.8
					Background


Note: *Value does not include 1/4 occupancy factor.

Iso-Tex, Inc. Radiation Branch Site No. 021

Iso-Tex, Inc. is an FDA licensed facility for drug manufacturing of radio-pharmaceuticals and radio-isotope labeling. The facility is located 17 miles south southeast of downtown Houston and approximately 5 miles southeast of Pearland on County Road 129. The Radiation Branch surveillance program consists of TLD monitoring.

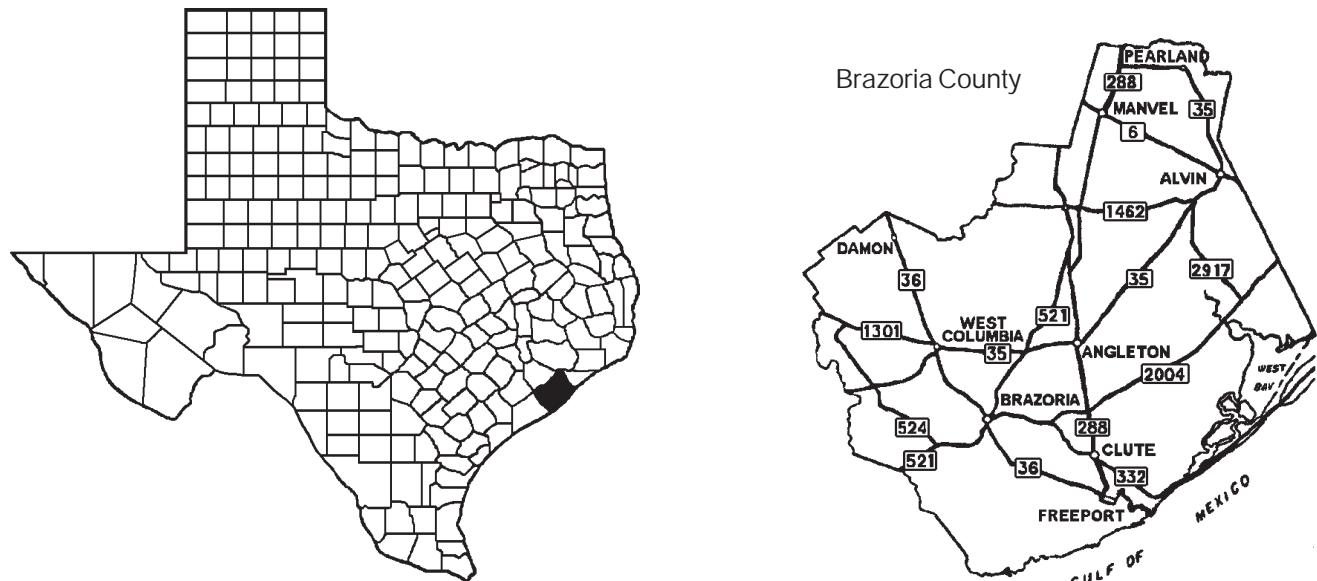


Shaded area indicates location of Brazoria County

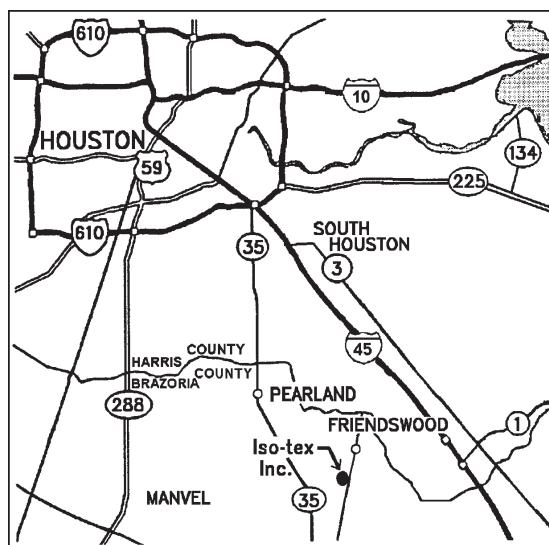

Monitoring Station Locations

◆ TLD Station	♥ Sample Station	♣ TLD & Sample Station
---------------	------------------	------------------------

Homeland Security --
Diagram Removed

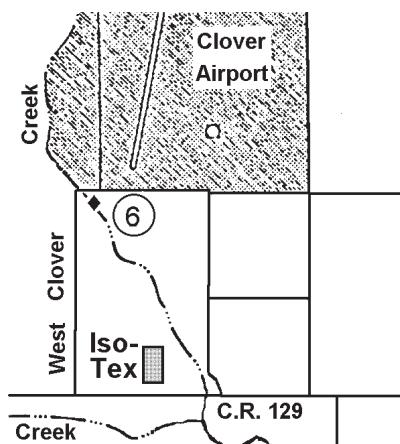

Thermoluminescent Dosimeter (TLD) Monitoring Results
(quarterly and annual readings are in mrem)

Station	Q1	Q2	Q3	Q4	Annual*	
					Dose	Notes
01	3.3	2.8	3.0	3.0	12.1	
06	18.9	13.9	12.0	14.0	58.8	Background
07	13.3	13.0	6.0	6.0	38.3	
10	4.4	2.8	3.0	4.0	14.2	

NOTE: *Occupancy factor not provided.


Pantex

Radiation Branch Site No. 005

The Pantex plant site is located in Carson County in the Texas Panhandle, north of U.S. Highway 60. The plant is located 17 miles (27 kilometers) northeast of downtown Amarillo. It is centered on a 16,000-acre site. The Pantex facility consists of 10,080 acres of U.S. Department of Energy (DOE) owned land and 5,856 acres of land leased from Texas Tech University, used as a safety and security buffer zone.

The Pantex plant is located on the Llano Estacado (staked plains) portion of the Great Plains at an elevation of approximately 3,500 feet (1,067 meters). The topography at Pantex plant is relatively flat, characterized by rolling grassy plains and numerous natural playa basins. The region is a semi-arid farming and ranching area. Pantex plant is surrounded by agricultural land, but several significant industrial facilities are also located nearby.




The Radiation Branch surveillance program consists of sampling air, water, soil, sediment, food products, and vegetation and TLD monitoring. Analysis of samples is concentrated on determining presence of any special nuclear material.

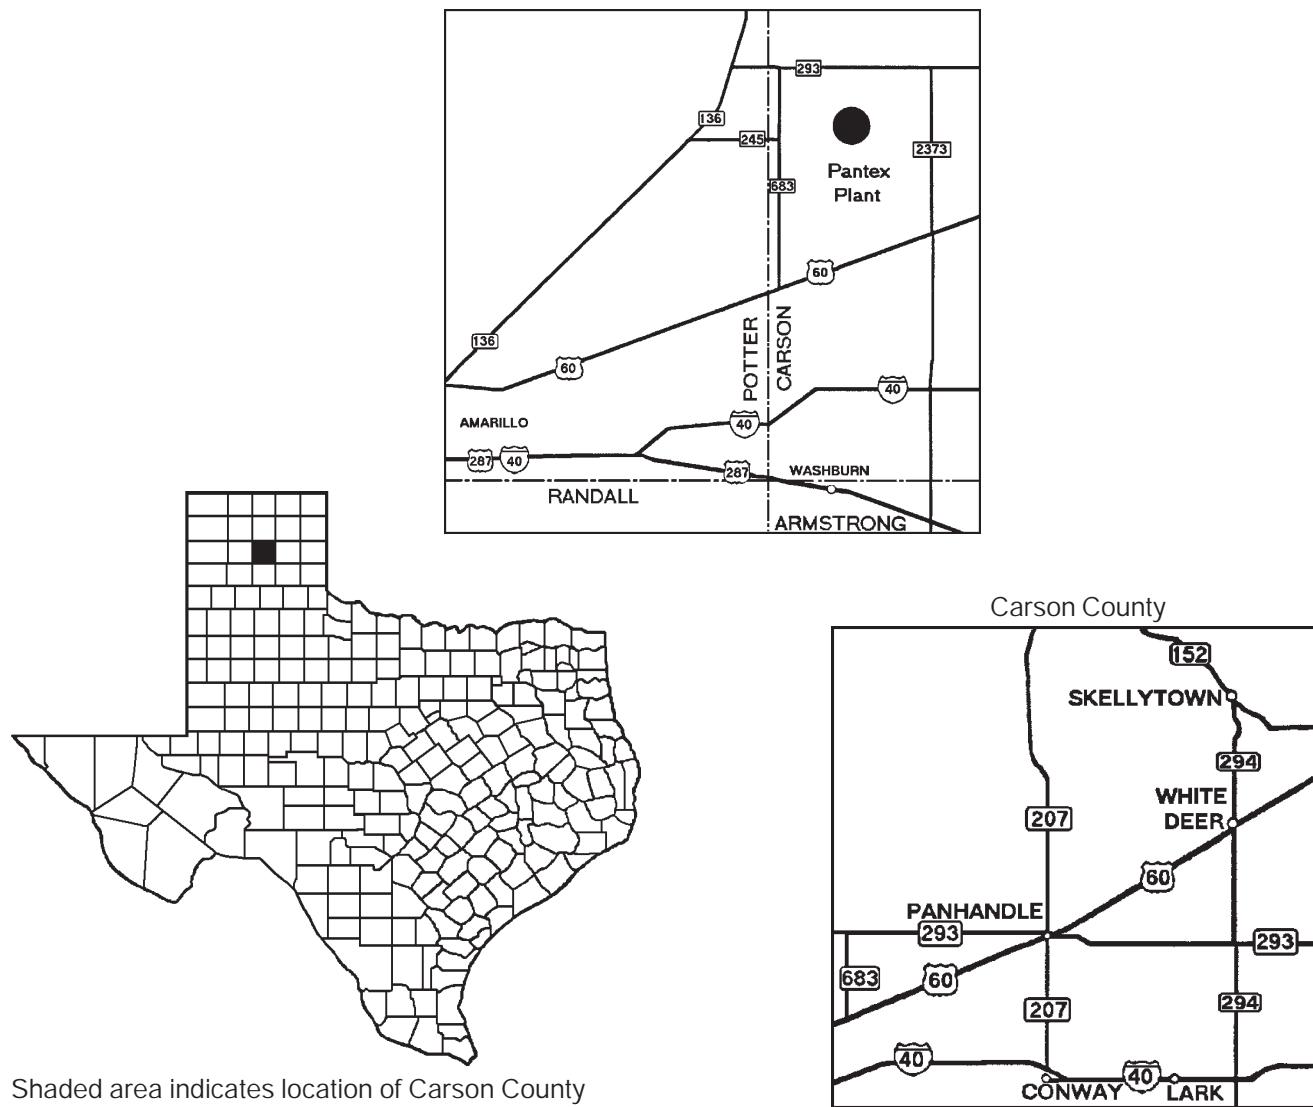


Shaded area indicates location of Carson County



Monitoring Station Locations

◆ TLD Station ♥ Sample Station ♣ TLD & Sample Station

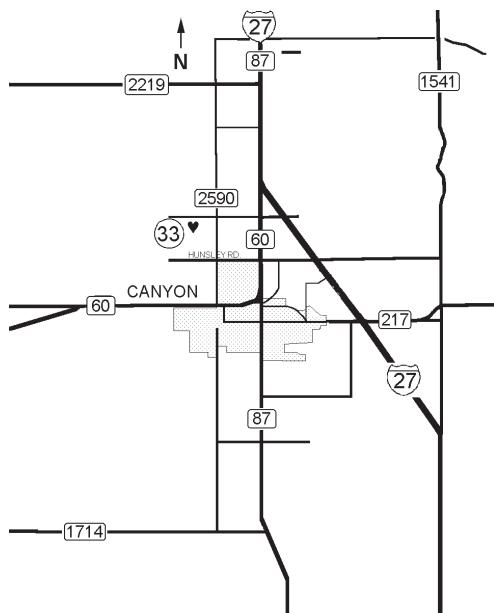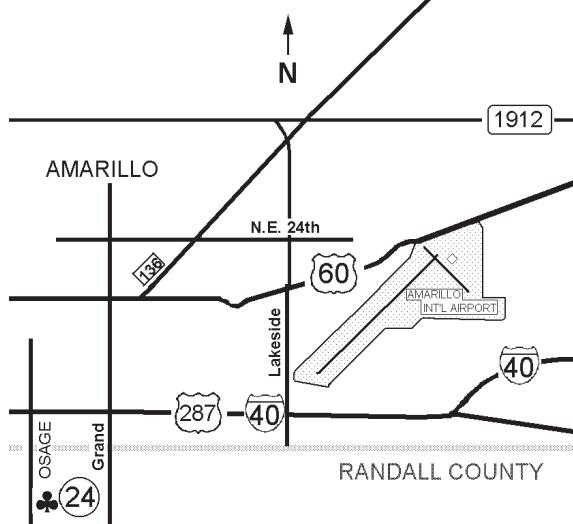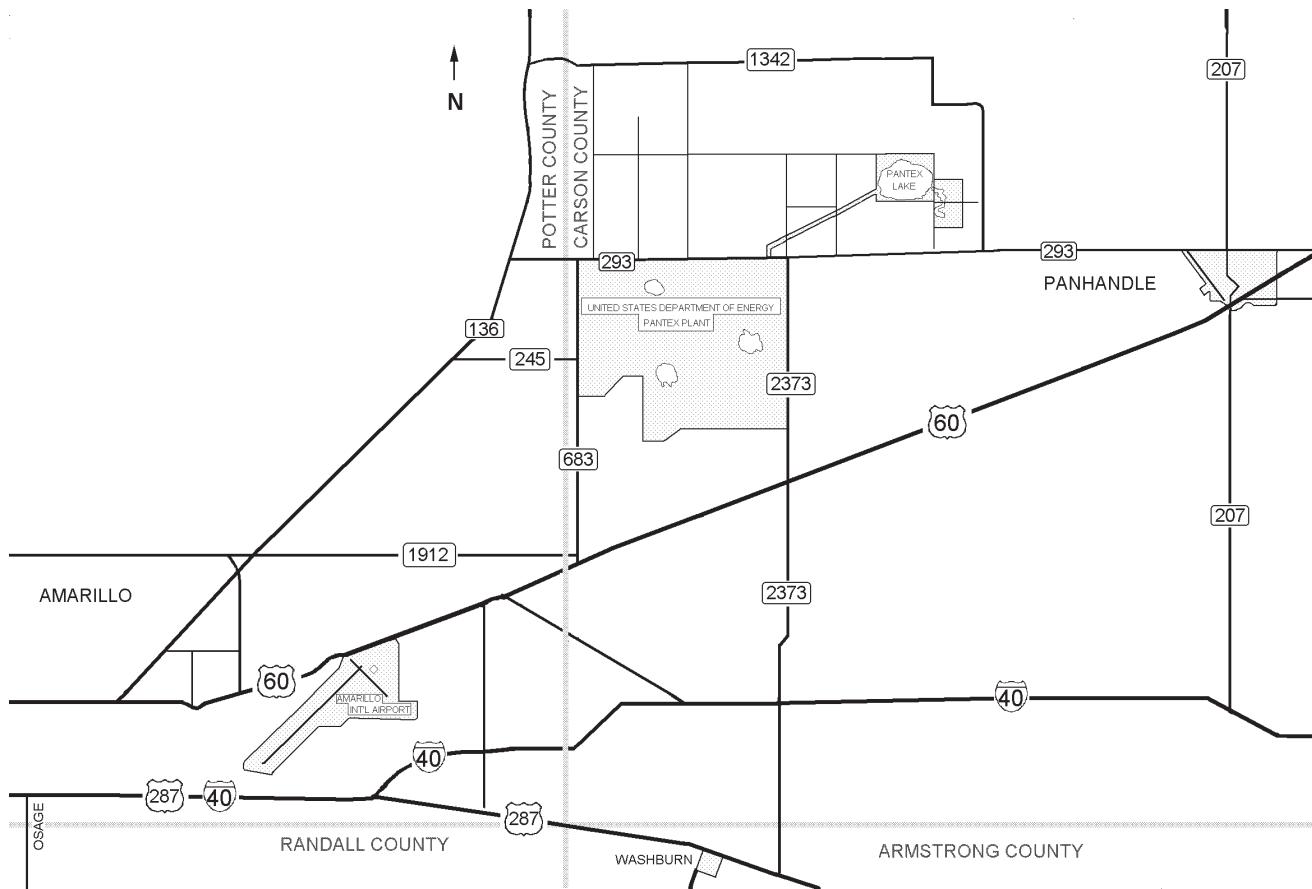

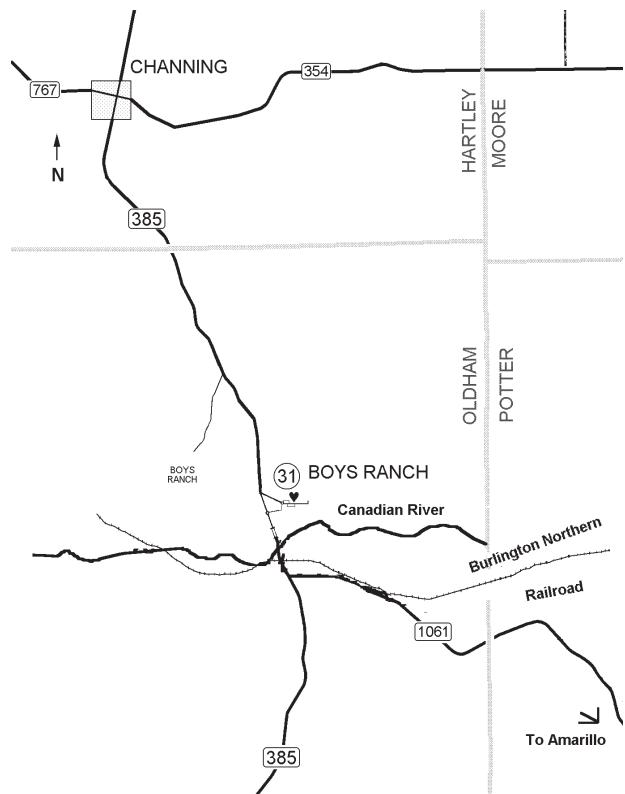

Homeland Security --
Diagram Removed

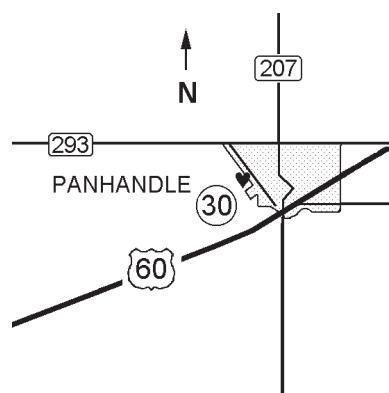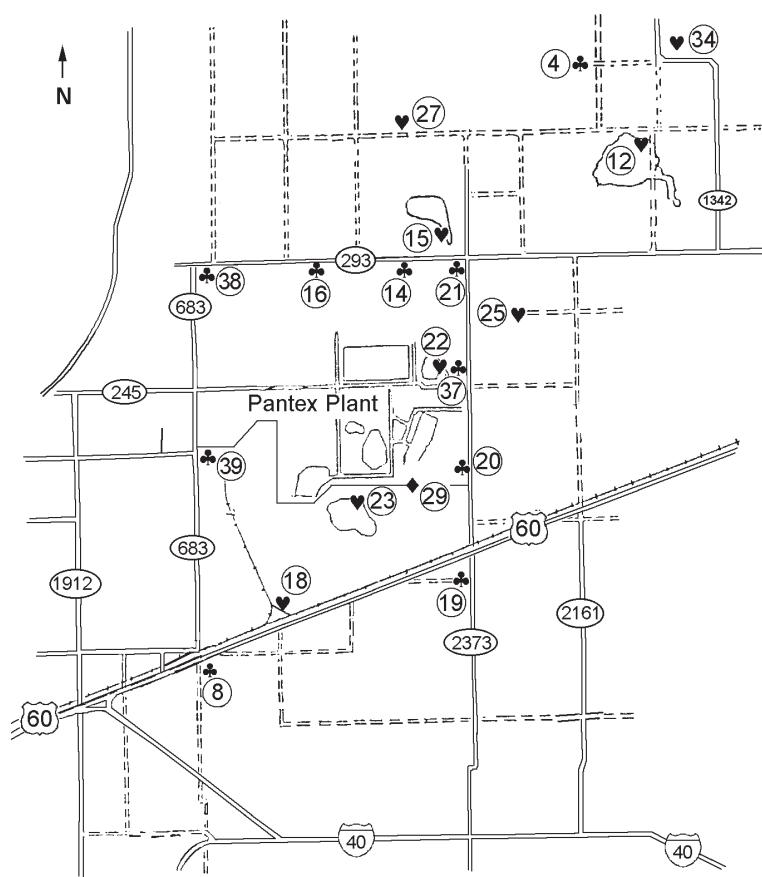



Date	Lab No.	Station	Pu-239*	U-234*	U-235*	U-238*	H-3**	Ra-226	U-238
Vegetation $\mu\text{Ci/g}$									
2005-03-29	ER050178 04		<1E-7	<1.0E-6	<1.0E-6	<1.0E-6	<1.0E-6	<9E-7	<8E-7
2005-03-29	ER050179 08		<1E-7	<1.0E-6	<1.0E-6	<1.0E-6	<1.0E-6	<1.6E-6	<1.1E-6
2005-03-29	ER050180 16		<1E-7	<1.0E-6	<1.0E-6	<1.0E-6	<1.0E-6	<8E-7	<5E-7
2005-03-29	ER050181 21		<1E-7	<1.0E-6	<1.0E-6	<1.0E-6	<1.0E-6	<1.1E-6	<9E-7
2005-07-06	ER050362 14		<1E-7	<1.0E-6	<1.0E-6	<1.0E-6	<1.0E-6	<1.2E-6	<8E-7
2005-07-06	ER050365 18		<1E-7	<1.0E-6	<1.0E-6	<1.0E-6	<1.0E-6	<1.0E-6	<7E-7
2005-07-06	ER050373 37		<1E-7	<1.0E-6	<1.0E-6	<1.0E-6	<1.0E-6	<1.3E-6	<1.1E-6
2005-07-06	ER050375 39		<1E-7	<1.0E-6	<1.0E-6	<1.0E-6	<1.0E-6	<1.0E-6	<7E-7
2005-11-15	ER050653 04		<1E-7	<1.0E-6	<1.0E-6	<1.0E-6	<1.0E-6	<1.0E-6	<7E-7
2005-11-15	ER050643 08		<1E-7	<1.0E-6	<1.0E-6	<1.0E-6	<1.0E-6	<9E-7	<8E-7
2005-11-15	ER050640 16		<1E-7	<1.0E-6	<1.0E-6	<1.0E-6	<1.0E-6	<9E-7	<6E-7
2005-11-15	ER050654 19		<1E-7	<1.0E-6	<1.0E-6	<1.0E-6	<1.0E-6	<8E-7	<7E-7
2005-11-15	ER050655 21		<1E-7	<1.0E-6	<1.0E-6	<1.0E-6	<1.0E-6	<1.1E-6	<7E-7
2005-11-15	ER050656 38		<1E-7	<1.0E-6	<1.0E-6	<1.0E-6	<1.0E-6	<1.1E-6	<1.0E-6
Water-Drinking $\mu\text{Ci/ml}$									
2005-01-10	ER050031 30		<1E-10	4.8E-9	<1.0E-9	1.9E-9	<1.0E-6	<4.8E-8	<4.5E-8
2005-03-29	ER050184 30		<1E-10	5.7E-9	<1.0E-9	2.7E-9	<1.0E-6	<4.9E-8	<4.6E-8
2005-07-06	ER050371 30		<1E-10	4.8E-9	<1.0E-9	2.1E-9	<1.0E-6	<4.9E-8	<4.5E-8
2005-11-14	ER050648 30		<1E-10	5.2E-9	<1.0E-9	2.4E-9	<1.0E-6	<5.1E-8	<4.8E-8
Water-Ground $\mu\text{Ci/ml}$									
2005-01-11	ER050032 27		<1E-10	4.5E-9	<1.0E-9	2.1E-9	<1.0E-6	<5.1E-8	<3.7E-8
2005-03-30	ER050183 27		<1E-10	4.5E-9	<1.0E-9	1.8E-9	<1.0E-6	<5.2E-8	<3.6E-8
2005-07-06	ER050370 27		<1E-10	4.1E-9	<1.0E-9	2.1E-9	<1.0E-6	<4.9E-8	<4.5E-8
2005-11-15	ER050647 27		<1E-10	4.8E-9	<1.0E-9	2.2E-9	<1.0E-6	<5.5E-8	<3.8E-8
Water-Surface $\mu\text{Ci/ml}$									
2005-01-11	ER050033 22		<1E-10	<1.0E-9	<1.0E-9	<1.0E-9	<1.0E-6	<4.8E-8	<4.5E-8
2005-01-11	ER050030 24		<1E-10	4.9E-9	<1.0E-9	2.2E-9	<1.0E-6	<4.7E-8	<4.5E-8
2005-03-30	ER050182 24		<1E-10	4.3E-9	<1.0E-9	2.2E-9	<1.0E-6	<4.9E-8	<4.6E-8
2005-07-06	ER050369 24		<1E-10	3.6E-9	<1.0E-9	2.1E-9	<1.0E-6	<5.2E-8	<3.6E-8
2005-07-07	ER050368 22		<1E-10	1.2E-9	<1.0E-9	<1.0E-9	<1.0E-6	<4.8E-8	<4.5E-8
2005-11-15	ER050646 24		<1E-10	4.3E-9	<1.0E-9	2.2E-9	<1.0E-6	<4.9E-8	<4.4E-8

NOTE: *Indicates the analysis was by alpha spectrometry, or if Ra-226, analysis by radon emanation.
**Indicates the tritium (H-3) analysis for vegetation and sediment is reported in $\mu\text{Ci/ml}$.

Radiation Technology, Inc.

Radiation Branch Site No. 050

Radiation Technology, Inc. (RTI), located six miles north of downtown Odessa, provides installation, repair, and maintenance of nuclear gauging devices and provides services for loading and unloading radioactive sources in nuclear gauges. Radiation Branch surveillance program consists of TLD monitoring.

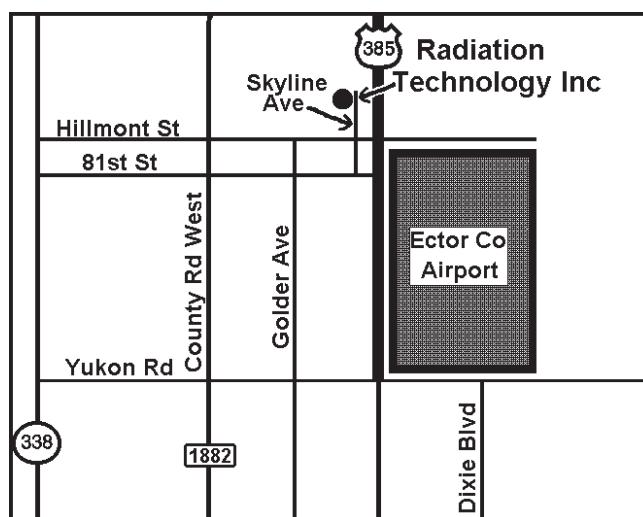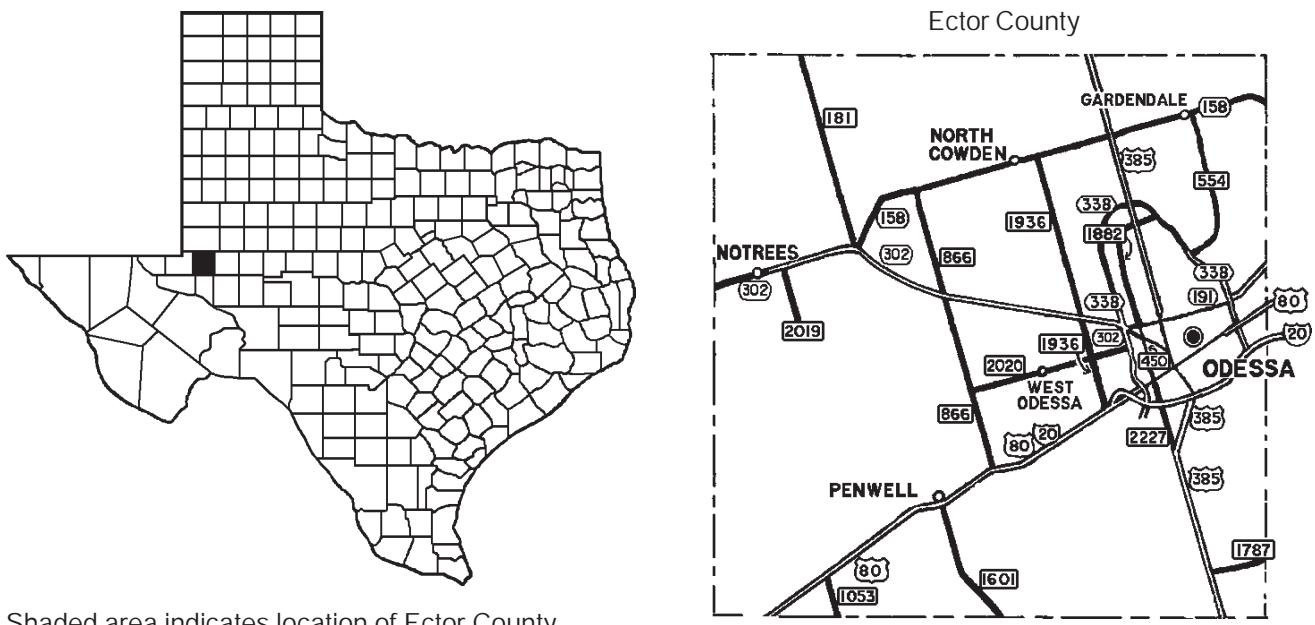

Monitoring Station Locations

◆ TLD Station ♥ Sample Station ♣ TLD & Sample Station

Homeland Security --
Diagram Removed



Thermoluminescent Dosimeter (TLD) Monitoring Results¹
(quarterly and annual readings are in mrem)


Station	Annual ²					Notes
	Q1	Q2	Q3	Q4	Dose	
01	18.2	18.4	36.8	53.3	126.7	
02	1407.8	1285.4	1157.4	1146.2	4996.8	
03	192.7	172.4	139.1	209.6	713.8	
04	38.5	35.9	42.9	48.7	166.0	
08	20.3	15.6	--	--	35.9	Background
08	--	--	3.1	5.5	8.6	Q3 and Q4 Background TLD provided by Landauer, Inc.

NOTE: ¹Combined neutron/gamma dosimeters are deployed at this facility. Exposure reported includes neutron and gamma doses.


²Occupancy factor not provided.

Rhodia, Inc. Radiation Branch Site No. 026

Rhodia, Inc. is an international specialty chemicals manufacturer. Rhodia's Freeport facility, located approximately 55 miles south of Houston, uses material containing uranium and thorium. The Radiation Branch surveillance program consists of TLD monitoring.

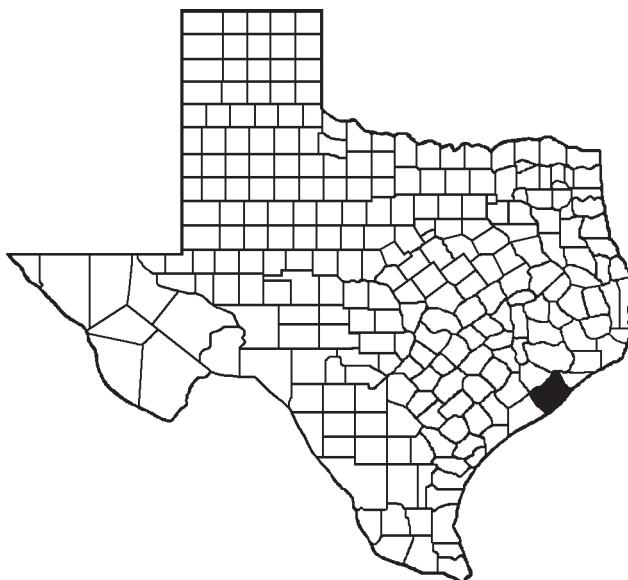

Shaded area indicates location of Brazoria County

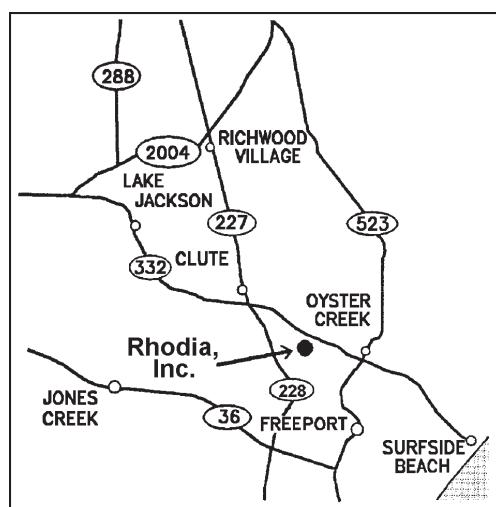

Monitoring Station Locations

◆ TLD Station	♥ Sample Station	♣ TLD & Sample Station
---------------	------------------	------------------------

Homeland Security --
Diagram Removed

Thermoluminescent Dosimeter (TLD) Monitoring Results
(quarterly and annual readings are in mrem)


Station	Q1	Q2	Q3	Q4	Annual*	
					Dose	Notes
01	0.0	0.0	0.0	0.0	0.0	
02	0.0	0.0	0.0	0.0	0.0	
04	7.6	6.5	7.0	8.0	29.1	
05	35.8	31.6	32.0	33.0	132.4	
06	29.3	27.9	26.0	29.0	112.2	
16	16.3	14.9	14.0	17.0	62.2	Background

Note: *Value does not include 1/16 occupancy factor.


Thermo MeasureTech Radiation Branch Site No. 004

During the third quarter of 2005 Thermo MeasureTech re-located to Sugar Land. The Radiation Branch performed the close-out survey (Round Rock location) in December 2005. Based on this survey, the Round Rock location was released for unrestricted use. Thermo MeasureTech was located just north of Round Rock in Williamson County. The Radiation Branch implemented a monitoring program in July of 1990 and collected baseline radiation data prior to the licensee moving any radioactive materials to the site. The major licensed activity at the facility was the manufacture and distribution of gauging devices and fluorescence analyzers.

Upon receipt of a statement from Thermo MeasureTech, that it no longer wished to pursue a license to process radioactive waste in 1992, the Radiation Branch removed the soil and vegetation sampling from the monitoring program. Consequently, reports after 1992 only contain the results of doses indicated by TLD's used to monitor ambient radiation levels at selected locations on and around the premises.

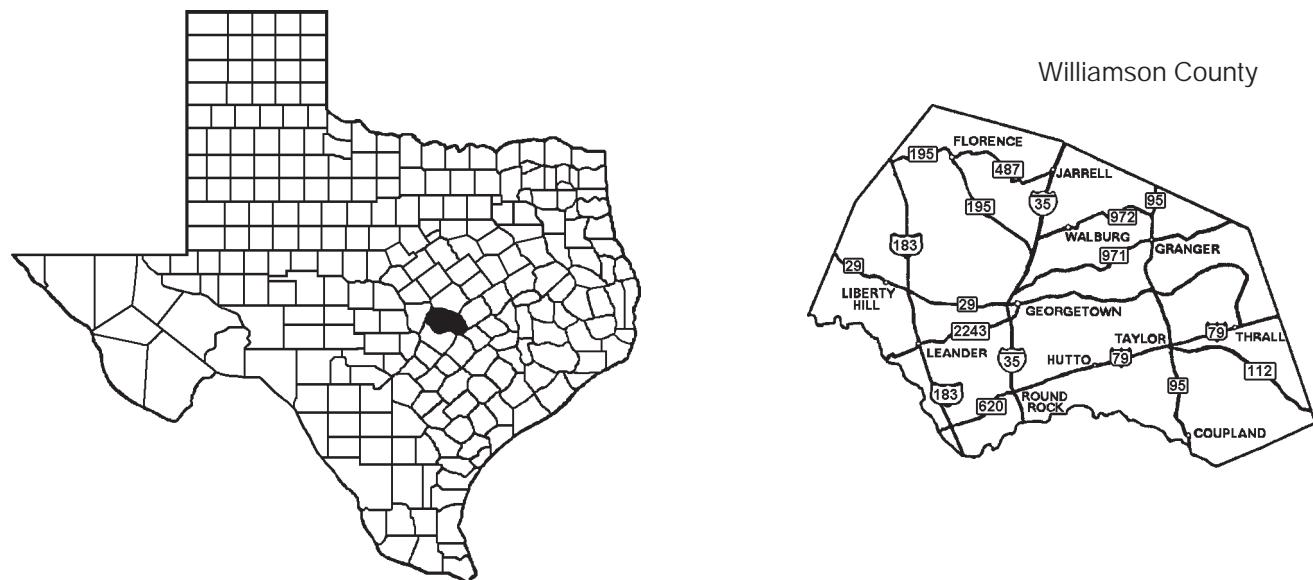


Shaded area indicates location of Williamson County

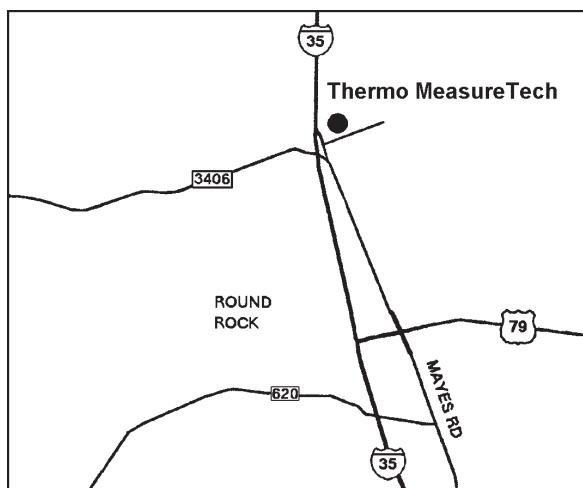

Monitoring Station Locations

◆ TLD Station	♥ Sample Station	♣ TLD & Sample Station
----------------------	-------------------------	-----------------------------------

**Homeland Security --
Diagram Removed**

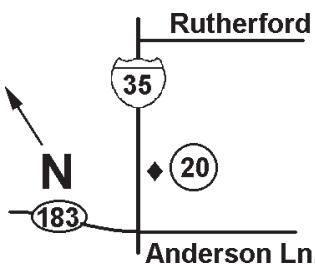

Thermoluminescent Dosimeter (TLD) Monitoring Results¹
(quarterly and annual readings are in mrem)

Station	Annual ²				Notes
	Q1	Q2	Q3	Q4 ³	
04	16.8	12.4	14.8	--	44.0
05	2491.6	2051.6	1876.4	--	6419.6
06	719.1	792.1	841.8	--	2353.0
07	2244.3	2401.2	2585.6	--	7231.1
08	2.0	1.0	4.9	--	7.9
09	4.0	4.1	7.4	--	15.5
10	1025.7	961.7	891.2	--	2878.6
11	780.4	732.1	761.6	--	2274.1
12	1151.3	1000.0	893.2	--	3044.5
13	1321.5	1284.3	1097.9	--	3703.7
20	15.8	14.5	13.8	--	Background
20	--	1.3	1.0	--	2.3 Q2 and Q3 Background TLD provided by Landauer, Inc.

NOTE: ¹Combined neutron/gamma dosimeters are deployed at this facility. Exposure reported includes neutron and gamma doses.



²Occupancy factor not provided.

³During the third quarter of 2005 the facility re-located to Sugar Land.

U. T. Systems Interim Waste Storage Facility

Radiation Branch Site No. 042


University of Texas Systems Interim Waste Storage Facility, located in Pecos County, provides temporary storage for low-level radioactive waste from several U.T. campuses throughout Texas. The Radiation Branch surveillance program consists of TLD monitoring.

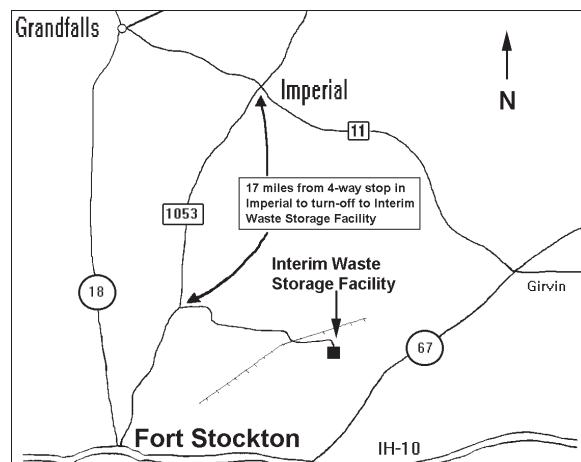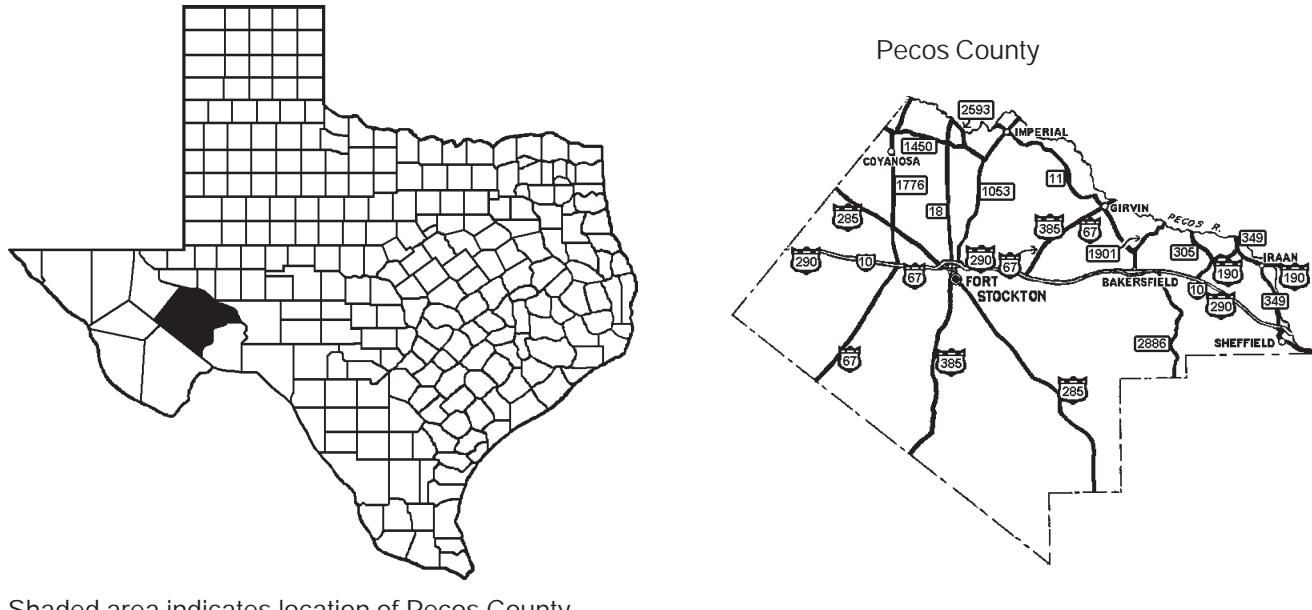

Monitoring Station Locations

◆ TLD Station	♥ Sample Station	♣ TLD & Sample Station
----------------------	-------------------------	-----------------------------------

Homeland Security --
Diagram Removed

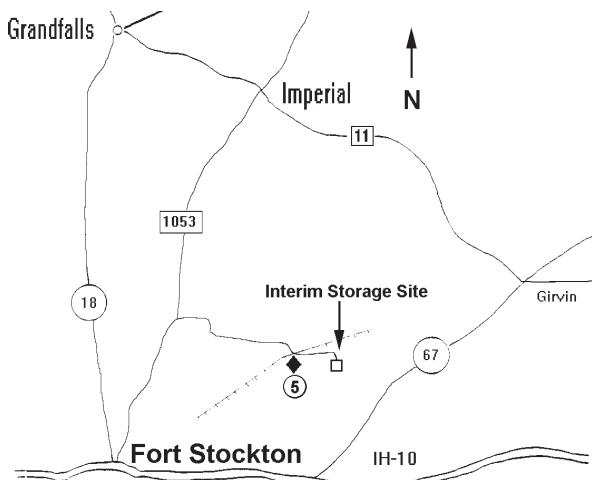

Thermoluminescent Dosimeter (TLD) Monitoring Results
(quarterly and annual readings are in mrem)

Station	Q1	Q2	Q3	Q4	Annual*	
					Dose	Note
01	1.0	1.9	2.0	0.0	4.9	
02	0.0	0.0	0.0	0.0	0.0	
03	0.0	0.0	0.0	0.0	0.0	
04	0.0	0.0	0.0	0.0	0.0	
05	23.8	19.2	20.0	25.0	88.0	Background

NOTE: *Occupancy factor not provided.

Appendices

This page intentionally blank

Department of Energy Quality Assessment Program Results

QAP 0403

QAP 60 Results by Laboratory

Lab: TX Texas Dept. of Health/Laboratories, Austin

No. Test	Radionuclide	Reported Value	Reported Error	EML Value	EML Error	Reported EML	Evaluation
Matrix: AI Air Filter Bq/filter							
1	AM241	0.115	0.01	0.1045	0.0025	1.100	A
1	CO60	37.5	0.4	35.4	0.85	1.059	A
1	CS134	16.7	0.2	18.2	0.402	0.918	A
1	CS137	28.9	0.5	26.4	0.86	1.095	A
1	Gross Alpha	1.19	0.08	1.2	0.12	0.992	A
1	Gross Beta	2.89	0.13	2.85	0.28	1.014	A
1	PU238	0.041	0.002	0.0405	0.0027	1.012	A
1	PU239	0.164	0.005	0.1644	0.0112	0.998	A
1	U234	0.092	0.005	0.0858	0.0008	1.072	A
1	U238	0.09	0.005	0.085	0.0029	1.059	A
Matrix: SO Soil Bq/kg							
1	AC228	52.4	1.8	49.0	1.96	1.069	A
1	AM241	13.9	0.9	13.0	0.43	1.069	A
1	BI212	51.2	8.2	50.43	4.61	1.015	A
1	BI214	52.3	1.9	58.4	2.2	0.896	A
1	CS137	1359.0	30.0	1323.0	66.17	1.027	A
1	K40	564.0	17.0	539.0	29.11	1.046	A
1	PB212	50.1	1.9	47.73	2.53	1.050	A
1	PB214	55.6	2.0	61.0	2.38	0.911	A
1	PU238	0.888	0.185	0.82	0.05	1.083	A
1	PU239	22.4	1.2	22.82	0.56	0.982	A
1	SR90	52.5	9.4	51.0 *	5.9	1.029	A
1	TH234	71.1	8.9	84.0	5.96	0.846	A
1	U234	84.6	2.7	87.22	1.97	0.970	A
1	U238	90.6	2.7	89.73	4.22	1.010	A
Matrix: VE Vegetation Bq/kg							
1	AM241	5.33	0.56	4.93	0.29	1.081	A
1	CO60	17.7	0.9	14.47	0.64	1.223	A
1	CS137	659.0	11.0	584.67	29.23	1.127	A
1	K40	837.0	25.0	720.0	37.92	1.163	A
1	PU238	0.592	0.159	0.455	0.0485	1.301	A
1	PU239	6.56	0.53	6.81	0.28	0.963	A
1	SR90	688.0	22.0	734.0 *	82.0	0.937	A
Matrix: WA Water Bq/L							
1	AM241	1.22	0.11	1.31	0.04	0.931	A
1	CO60	162.0	1.0	163.2	5.9	0.993	A
1	CS137	52.2	0.9	51.95	2.7	1.005	A
1	Gross Alpha	320.0	28.0	326.0	32.0	0.982	A
1	Gross Beta	1217.0	60.0	1170.0	117.0	1.040	A
1	H3	255.0	18.0	186.6	3.3	1.367	W
1	PU238	1.03	0.06	1.1	0.03	0.936	A
1	PU239	2.86	0.14	3.08	0.1	0.929	A
1	SR90	5.68	0.67	4.76 *	0.5	1.193	W
1	U234	2.26	0.09	2.28	0.02	0.991	A
1	U238	2.25	0.09	2.25	0.06	1.000	A

Values for elemental uranium are reported in µg/filter, g, or mL.

pCi/g or mL = Bq x 0.027

Evaluation: A=Acceptable, W=Acceptable with Warning, N=Not Acceptable

If the evaluation system is not appropriate for the types of analyses performed in your lab, apply site specific evaluation.

* Grand mean average used in lieu of experimentally determined EML value

Department of Homeland Security
Environmental Measurements Laboratory
201 Varick Street
New York, NY 10014-7447

March 1, 2004

To: Participants in Quality Assessment Program (QAP)
From: Mitchell D. Erickson, Laboratory Director

TERMINATION OF THE QUALITY ASSESSMENT PROGRAM

The Department of Energy's (DOE) Quality Assessment Program (QAP), managed by the Environmental Measurements Laboratory (EML), will be terminated after we issue the report for this current performance sample distribution (QAP 60).

The Program was established in 1976 to test the quality of the environmental radiological analysis being reported to DOE by its contractors for site cleanup and regulatory compliance. Since the Program's inception, DOE/EML successfully prepared, analyzed, and distributed thousands of performance samples to DOE contractors and other participants in the program. DOE/EML then collected, compiled, assessed, and reported the resulting analytical data, which was used by DOE program managers to select qualified contractors, monitor contractors' performance, and assure data quality. QAP data show continuous improvement in radiochemical analyses as labs gained proficiency and EML's QA scientists encouraged better performance through consultation, feedback, and new methods. Detailed information on QAP, including full reports, is available at <http://www.eml.doe.gov/qap/>.

EML is proud to have successfully managed the Program for 27 years on behalf of DOE; helping the Nation by ensuring that the quality of the radiological analysis from DOE contractors was demonstrated. We would also like to take this opportunity to thank all those individuals and organizations that have helped and supported us over the years.

EML transferred to the Science and Technology (S&T) Directorate of the Department of Homeland Security (DHS) on March 1, 2003. As we continue to respond to the challenges of our new mission, we need to redirect our proficiency testing (PT) activities to reflect our new mission. We will keep you informed as these new PT activities develop.

Laboratory Services Section
Environmental Sciences Branch

Detection Limits for Chemical Analysis Procedures
Sample Type

Isotope	Soil - Sediment		Air Filter		Water - Milk		Vegetation - Fish	
	µCi/g	pCi/kg	µCi/filter	pCi/filter	µCi/ml	pCi/l	µCi/g	pCi/kg
Alpha	6.1E-06	6.1E+03	7.0E-07	7.0E-01	3.3E-09	3.3E+00	3.3E-06	3.3E+03
Beta	1.2E-05	1.2E+04	1.3E-06	1.3E+00	6.6E-09	6.6E+00	6.6E-06	6.6E+03
C-14					3.0E-07	3.0E+02		
H-3			2.0E-06	2.0E+00	1.0E-06	1.0E+03		
Ra-226	4.0E-07	4.0E+02	8.0E-07	8.0E-01	8.0E-10	8.0E-01	4.0E-07	4.0E+02
Ra-228	1.9E-06	1.9E+03	3.9E-06	3.9E+00	3.9E-09	3.9E+00	1.9E-06	1.9E+03
Sr-89	9.0E-07	9.0E+02	1.7E-06	1.7E+00	1.7E-09	1.7E+00	9.0E-07	9.0E+02
Sr-90	1.3E-06	1.3E+03	2.7E-06	2.7E+00	2.7E-09	2.7E+00	1.3E-06	1.3E+03

Detection Limits for Alpha Spectroscopy
Sample Type

Isotope	Soil - Sediment		Air Filter		Water - Milk		Vegetation - Fish	
	µCi/g	pCi/kg	µCi/filter	pCi/filter	µCi/ml	pCi/l	µCi/g	pCi/kg
Am-241	1.0E-06	1.0E+03	1.0E-06	1.0E+00	1.0E-09	1.0E+00	1.0E-06	1.0E+03
Pu-239	2.0E-07	2.0E+02	2.0E-07	2.0E-01	2.0E-10	2.0E-01	2.0E-07	2.0E+02
Th-228	1.0E-06	1.0E+03	1.0E-06	1.0E+00	1.0E-09	1.0E+00	1.0E-06	1.0E+03
Th-230	1.0E-06	1.0E+03	1.0E-06	1.0E+00	1.0E-09	1.0E+00	1.0E-06	1.0E+03
Th-232	1.0E-06	1.0E+03	1.0E-06	1.0E+00	1.0E-09	1.0E+00	1.0E-06	1.0E+03
U-234	1.0E-06	1.0E+03	1.0E-06	1.0E+00	1.0E-09	1.0E+00	1.0E-06	1.0E+03
U-238	1.0E-06	1.0E+03	1.0E-06	1.0E+00	1.0E-09	1.0E+00	1.0E-06	1.0E+03