

BROOKHAVEN
NATIONAL LABORATORY

Managed by Brookhaven Science Associates
for the U.S. Department of Energy

July 10, 2008

Ms. Kathleen Newcomer
Suffolk County Department of Health Services
Office of Water Resources
Bureau of Drinking Water
Suite 1C
360 Yaphank Avenue
Yaphank, New York 11980

Dear Ms. Kathleen Newcomer:

Subject: Monthly Water Treatment Plant Reports
Reference: Suffolk County Minimum Monitoring Requirements for June 2008

In accordance with the requirements of the BNL Potable Water System Sampling Plan and the 2008 SCDHS Minimum Monitoring Requirements for the BNL Potable Water Supply, included please find the following attachments for your records:

- Attachment I: BNL Potable Water Monthly Operational Data for June.
- Attachment II: June 2008 Biweekly Water Quality Monitoring Data for the BNL Distribution System and Potable Water Wells.
- Attachment III: June 2008 Stage 1 Disinfectants & Disinfection Byproduct Rule Monitoring Data and Bacteriological Analyses for the BNL Distribution System.
- Attachment IV: 2008 Annual Asbestos Analysis for the BNL Potable Water Distribution System.
- Attachment V: 2008 Annual Synthetic Organic Chemical and Pesticides Analyses and Inorganic and Nitrate/Nitrite Analyses for the BNL Potable Water Wells.

Collection and analysis of these samples is performed in accordance with the guidelines of the BNL Quality Assurance program, the SCDHS Community Water Supply Monitoring Requirements, and the BNL Potable Water System Sampling Plan. Plant Engineering Division personnel using standard operating procedures collect routine monitoring samples; a contractor laboratory using standard methods of analysis performs the subsequent analyses. The Quality Assurance documentation is




Registered to
ISO 14001

available from the Environmental and Waste Management Services Division and Plant Engineering Divisions. Based on this information, we believe the values contained in these reports are representative of the BNL potable water system and review of the analytical data shows that BNL's potable water system complied with all drinking water requirements during this reporting period.

Should there be any questions regarding this report or the analytical or operational data contained herein, please call either J. Higbie at (631) 344-5919, R. Lee at (631) 344-3148, or W. Chaloupka at (631) 344-7136.

Sincerely,

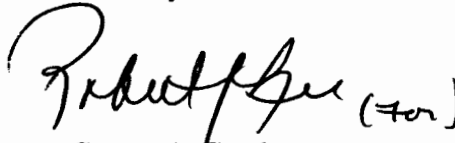

George A. Goode
Environmental & Waste Management Services
Division Manager

GAG/RJL:jlh

Attachments: As noted

cc:	L. Ambroszkiewicz, SCDHS	w/attachments
	W. Chaloupka	w/attachments
	G. Granzen	w/attachments
	G. Goode	w/o attachments
	J. Higbie	w/attachments
	R. Lee	w/attachments
	E. Murphy	w/attachments
	C. Parnell	w/o attachments
	P. Ponturo, SCDHS	w/o attachments
	L. Ross	w/o attachments

File: EC61ER.08

ATTACHMENT I

Brookhaven National Laboratory

Potable Water Supply

Monthly Operational Data for June 2008

for the BNL Potable Water System

NEW YORK STATE DEPARTMENT OF HEALTH

Bureau of Water Supply Protection

Water Systems Operation Report

Water Treatment Facility - Microbiological Sample Results

Public Water System Name	Reporting Month/Year	Date Report Submitted	Source Water Type(s)
Brookhaven National Laboratory	JUNE2008	6/30/2008	<input type="checkbox"/> Surface <input checked="" type="checkbox"/> Ground <input type="checkbox"/> GWUDI
Public Water System ID	County	Town, Village, or City	<input type="checkbox"/> Purchase with subsequent chlorination <input type="checkbox"/> Purchase w/out subsequent chlorination
5111891	Suffolk	Upton, New York 11973	

DATE	Source(s) in Use Well(s) No.:	Treated water volume (1,000 gallons/day)	Chlorination				Other Treatments / Readings				Daily Totalizer
			Gaseous		Liquid	Free chlorine residual at entry point (mg/l) (WTF-624)	Hypochlorite used/day (WTF - 624)	pH Lime Softening (WTF-624)	pH (Incoming RAW Water)		
			Cylinder weight (lbs.)	Chlorine used per day (lbs.)	Hypochlorite (gallons Hypochlorite in Tank)						
					127					973,263	
1		-	NA	NA							
2	4,7,6	1,527	NA	NA	110	0.45	17	7.1	5.7	974,790	
3	4,7,6	569	NA	NA	109	1.05	1	7.2	5.8	975,359	
4	4,7,6	593	NA	NA	102	1.15	7	7.0	5.9	975,952	
5	4,7,6	508	NA	NA	99	0.73	3	7.0	5.9	976,460	
6	4+7+6	525	NA	NA	90	0.68	9	7.0	5.7	976,985	
7		-									
8		-									
9	7,4,6	1,360	NA	NA	75	0.47	15	6.8	6.0	978,345	
10	7,4,6	69	NA	NA	75	0.54		6.6	6.0	978,414	
11	7,4,6	70	NA	NA	75	0.40		6.7	6.0	978,484	
12	7,4,6	69	NA	NA	75	1.05		6.7	6.0	978,553	
13	7,4,6	39	NA	NA	75	0.84		6.7	6.0	978,592	
14		-	NA	NA							
15		-	NA	NA							
16	7+4+6	68	NA	NA	75	0.96		6.9	6.0	978,660	
17	7+4+6	539	NA	NA	70	0.73	5	7.3	5.5	979,199	
18	7+4+6	670	NA	NA	60+100	0.76	10	7.1	5.4	979,869	
19	7+4+6	425	NA	NA	155	0.48	5	7.0	5.6	980,294	
20	7+4+6	474	NA	NA	150	0.58	5	7.1	5.4	980,768	
21		-	NA	NA							
22		-	NA	NA							
23	4+6+7	1,853	NA	NA	90	0.95	60	6.7	5.7	982,621	
24	7+4+6	680	NA	NA	110+90	1.20	10	6.7	5.4	983,301	
25	7+4+6	638	NA	NA	185	1.10	15	7.1	5.5	983,939	
26	7+4+6	636	NA	NA	180	1.20	5	8.0	5.6	984,575	
27	7+4+6	668	NA	NA	170	1.20	10	7.1	5.3	985,243	
28		-	NA	NA							
29			NA	NA							
30		1,937	NA	NA	155	1.10	15	7.0	5.4	987,180	
31		-	NA	NA							
Total		13,917	DAYS	30			192				
AVG.		463.90					10.11				

Chlorine Mix Ratio = _____ quarts/gallons of _____ % chlorine added to _____ gallons of water in crock

Reported by: WILLIAM CHALOUPKA Title: Water Systems Supervisor NYS DOH Operator Certification Number: NY0030392

Signature: *William Chaloupka* Date: 2 July 2008 Operator Grade Level: 1A-SW/GUI

NEW YORK STATE DEPARTMENT OF HEALTH

Bureau of Water Supply Protection

Water Systems Operation Report

Well No. 4 - Supply to Water Treatment Facility

Public Water System Name Brookhaven National Laboratory	Reporting Month/Year JUNE 2008	Date Report Submitted 6/30/2008	Source Water Type(s) <input type="checkbox"/> Surface <input checked="" type="checkbox"/> Ground <input type="checkbox"/> GWUDI
Public Water System ID 5111891	County Suffolk	Town, Village, or City Upton, New York 11973	<input type="checkbox"/> Purchase with subsequent chlorination <input type="checkbox"/> Purchase w/out subsequent chlorination

DATE	Source(s) in Use Well No.: 4	Treated water volume (1,000 gallons/day)	Chlorination				Other Treatments / Readings			
			Gaseous		Liquid	Free chlorine residual at entry point (mg/l)	Hypochlorite used/day		Daily Totalizer	
			Cylinder weight (lbs.)	Chlorine used per day (lbs.)	Hypochlorite (gallons Hypochlorite in Tank)					
					144					1,821,069
1		-	NA	NA						
2	4	1,504	NA	NA	120	0.40	24			1,822,573
3	4	541	NA	NA	110	0.36	10			1,823,114
4	4	636	NA	NA	100	0.40	10			1,823,750
5	4	580	NA	NA	90	0.38	10			1,824,330
6	4	536	NA	NA	84+66	0.10	6			1,824,866
7		-								
8		-								
9	4	228	NA	NA	147	0.08	3			1,825,094
10	4	-	NA	NA	147	0.10				1,825,094
11	4	-	NA	NA	147	0.08				1,825,094
12	4	-	NA	NA	147					1,825,094
13	4	-	NA	NA	147	0.09				1,825,094
14		-	NA	NA						
15		-	NA	NA						
16	4	-	NA	NA	147	0.05				1,825,094
17	4	153	NA	NA	144	0.01	3			1,825,247
18	4	17	NA	NA	143	0.03	1			1,825,264
19	4	95	NA	NA	141	0.04	2			1,825,359
20	4	45	NA	NA	141	0.40				1,825,404
21		-	NA	NA						
22		-	NA	NA						
23	4	160	NA	NA	138	0.01	3			1,825,564
24	4	663	NA	NA	126	0.04	12			1,826,227
25	4	143	NA	NA	123	1.00	3			1,826,370
26	4	199	NA	NA	120	0.17	3			1,826,569
27	4	196	NA	NA	117+33	0.11	3			1,826,765
28		-	NA	NA						
29		-	NA	NA						
30	4	437	NA	NA	140	0.20	10			1,827,202
31		-	NA	NA						
Total		6,133	DAYS	30			103			
AVG.		197.84				0.19	6.1			

Chlorine Mix Ratio = _____ quarts/gallons of _____ % chlorine added to _____ gallons of water in crock

Reported by: WILLIAM CHALOUPKA Title: Water Systems Supervisor NYS DOH Operator Certification Number: NY0030392

Signature: *William Chaloupka* Date: 2 July 2008 Operator Grade Level: 1A-SW/GUI

NEW YORK STATE DEPARTMENT OF HEALTH

Bureau of Water Supply Protection

Water Systems Operation Report

Well No. 6 - Supply to Water Treatment Facility

Public Water System Name	Reporting Month/Year	Date Report Submitted	Source Water Type(s)
Brookhaven National Laboratory	JUNE 2008	6/30/2008	<input type="checkbox"/> Surface <input checked="" type="checkbox"/> Ground <input type="checkbox"/> GWUDI
Public Water System ID	County	Town, Village, or City	<input type="checkbox"/> Purchase with subsequent chlorination
5111891	Suffolk	Upton, New York 11973	<input type="checkbox"/> Purchase w/out subsequent chlorination

DATE	Source(s) in Use Well No.: 6	Treated water volume (1,000 gallons/day)	Chlorination				Other Treatments / Readings			Daily Totalizer
			Gaseous		Liquid	Free chlorine residual at entry point (mg/l)	Hypochlorite used/day			
			Cylinder weight (lbs.)	Chlorine used per day (lbs.)	Hypochlorite (gallons Hypochlorite in Tank)					
					150					702,693
1		-	NA	NA						
2	6	-	NA	NA	148	0.40	2			702,693
3	6	-	NA	NA	148	0.36				702,693
4	6	-	NA	NA	148	0.40				702,693
5	6	-	NA	NA	148	0.38				702,693
6	6	68	NA	NA	148	0.10				702,761
7		-								
8		-								
9	6	35	NA	NA	147	0.08	1			702,796
10	6	-	NA	NA	147	0.10				702,796
11	6	-	NA	NA	147	0.08				702,796
12	6	-	NA	NA	147					702,796
13	6	-	NA	NA	147	0.08				702,796
14		-	NA	NA						
15		-	NA	NA						
16	6	-	NA	NA	147	0.05				702,796
17	6	89	NA	NA	145	0.01	2			702,885
18	6	-	NA	NA	145	0.03				702,885
19	6	-	NA	NA	145	0.04				702,885
20	6	-	NA	NA	145	0.40				702,885
21		-	NA	NA						
22		-	NA	NA						
23	6	2,277	NA	NA	144	0.01	1			705,162
24	6	79	NA	NA	142	0.04	2			705,241
25	6	50	NA	NA	141	1.00	1			705,291
26	6	120	NA	NA	138	0.17	3			705,411
27	6	81	NA	NA	135	0.11	3			705,492
28		-	NA	NA						
29		-	NA	NA						
30	6	214	NA	NA	129	0.20	6			705,706
31		-	NA	NA						
Total		3,013	DAYS	30			21			
AVG.		97.19				0.19	2.1			

Chlorine Mix Ratio = _____ quarts/gallons of _____ % chlorine added to _____ gallons of water in crock

Reported by: WILLIAM CHALOUPKA Title: Water Systems Supervisor NYS DOH Operator Certification Number: NY0030392

Signature: *William Chaloupka* Date: 2 July 2008 Operator Grade Level 1A-SW/GUI

NEW YORK STATE DEPARTMENT OF HEALTH

Bureau of Water Supply Protection

Water Systems Operation Report

Well No. 7 - Supply to Water Treatment Facility

Public Water System Name Brookhaven National Laboratory	Reporting Month/Year JUNE2008	Date Report Submitted 6/30/2008	Source Water Type(s) <input type="checkbox"/> Surface <input checked="" type="checkbox"/> Ground <input type="checkbox"/> GWUDI
Public Water System ID 5111891	County Suffolk	Town, Village, or City Upton, New York 11973	<input type="checkbox"/> Purchase with subsequent chlorination <input type="checkbox"/> Purchase w/out subsequent chlorination

DATE	Source(s) in Use Well No.: 7	Treated water volume (1,000 gallons/day)	Chlorination				Free chlorine residual at entry point (mg/l)	Other Treatments / Readings		Daily Totalizer
			Gaseous		Liquid	Hypochlorite used/day				
			Cylinder weight (lbs.)	Chlorine used per day (lbs.)	Hypochlorite (gallons Hypochlorite in Tank)					
					78				2,533,322	
1		-	NA	NA						
2	7	164	NA	NA	78	0.40			2,533,486	
3	7	93	NA	NA	76	0.36	2		2,533,579	
4	7	128	NA	NA	72	0.40	4		2,533,707	
5	7	18	NA	NA	72	0.38			2,533,725	
6	7	102	NA	NA	72+78	0.10			2,533,827	
7		-								
8		-								
9	7	1,250	NA	NA	129	0.08	21		2,535,077	
10	7	-	NA	NA	129	0.10			2,535,077	
11	7	-	NA	NA	129	0.08			2,535,077	
12	7	-	NA	NA	129				2,535,077	
13	7	-	NA	NA	129	0.09			2,535,077	
14		-	NA	NA						
15		-	NA	NA						
16	7	-	NA	NA	129	0.05			2,535,077	
17	7	544	NA	NA	120	0.01	9		2,535,621	
18	7	679	NA	NA	103	0.03	17		2,536,300	
19	7	413	NA	NA	90+60	0.04	13		2,536,713	
20	7	430	NA	NA	140	0.40	10		2,569,143	
21		-	NA	NA						
22		-	NA	NA						
23	7	2,805	NA	NA	33+99	0.01	107		2,571,948	
24	7	1	NA	NA	132	0.04			2,571,949	
25	7	611	NA	NA	115	1.00	17		2,572,560	
26	7	744	NA	NA	105	0.17	10		2,573,304	
27	7	750	NA	NA	86+64	0.11	19		2,574,054	
28		-	NA	NA						
29		-	NA	NA						
30	7	2,024	NA	NA	110	0.20	40		2,576,078	
31		-	NA	NA						
Total		10,756	DAYS	30	1897		269			
AVG.		346.97				0.20	19.2			

Chlorine Mix Ratio = _____ quarts/gallons of _____ % chlorine added to _____ gallons of water in crock

Reported by: **WILLIAM CHALOUKPA** Title: **Water Systems Supervisor** NYS DOH Operator Certification Number: **NY0030392**

Signature: *William Chaloupka* Date: *2 July 2008* Operator Grade Level **1A-SW/GUI**

NEW YORK STATE DEPARTMENT OF HEALTH

Bureau of Water Supply Protection

Water Systems Operation Report

Well No. 10 - Direct Supply to Distribution System

Public Water System Name Brookhaven National Laboratory	Reporting Month/Year JUNE 2008	Date Report Submitted 6/30/2008	Source Water Type(s) <input type="checkbox"/> Surface <input checked="" type="checkbox"/> Ground <input type="checkbox"/> GWDI
Public Water System ID 5111891	County Suffolk	Town, Village, or City Upton, New York 11973	<input type="checkbox"/> Purchase with subsequent chlorination <input type="checkbox"/> Purchase w/out subsequent chlorination

DATE	Source(s) in Use Well No.: 10	Treated water volume (1,000 gallons/day)	Chlorination				Other Treatments / Readings			Daily Totalizer
			Gaseous		Liquid	Free chlorine residual at entry point (mg/l)	Hypochlorite used/day	pH Sodium Hydroxide		
			Cylinder weight (lbs.)	Chlorine used per day (lbs.)	Hypochlorite (gallons) Hypochlorite in Tank					
		-	NA	NA					772,460	
1		-	NA	NA						
2	10	-	NA	NA	NR	NR	NR	NR	772,460	
3	10	-	NA	NA	NR	NR	NR	NR	772,460	
4	10	-	NA	NA	NR	NR	NR	NR	772,460	
5	10	-	NA	NA	NR	NR	NR	NR	772,460	
6	10	-	NA	NA	NR	NR	NR	NR	772,460	
7		-								
8		-								
9	10	-	NA	NA	NR	NR	NR	NR	772,460	
10	10	-	NA	NA	NR	NR	NR	NR	772,460	
11	10	-	NA	NA	NR	NR	NR	NR	772,460	
12	10	-	NA	NA	NR	NR	NR	NR	772,460	
13	10	-	NA	NA	NR	NR	NR	NR	772,460	
14		-	NA	NA						
15		-	NA	NA						
16	10	-	NA	NA	NR	NR	NR	NR	772,460	
17	10	-	NA	NA	NR	NR	NR	NR	772,460	
18	10	-	NA	NA	NR	NR	NR	NR	772,460	
19	10	-	NA	NA	NR	NR	NR	NR	772,460	
20	10	-	NA	NA	NR	NR	NR	NR	772,460	
21		-	NA	NA						
22		-	NA	NA						
23	10	-	NA	NA	NR	NR	NR	NR	772,460	
24	10	-	NA	NA	NR	NR	NR	NR	772,460	
25	10	-	NA	NA	NR	NR	NR	NR	772,460	
26	10	-	NA	NA	NR	NR	NR	NR	772,460	
27	10	-	NA	NA	NR	NR	NR	NR	772,460	
28		-	NA	NA						
29		-	NA	NA						
30	10	-	NA	NA	NR	NR	NR	NR	772,460	
31		-	NA	NA						
Total		-	DAYS	30						
AVG.		-								

Chlorine Mix Ratio = _____ quarts/gallons of _____ % chlorine added to _____ gallons of water in crock

Reported by: WILLIAM CHALOUPKA Title: Water Systems Supervisor NYS DOH Operator Certification Number: NY0030392

Signature: *William Chaloupka* Date: 2 July 2008 Operator Grade Level 1A-SW/GUI

NEW YORK STATE DEPARTMENT OF HEALTH

Bureau of Water Supply Protection

Water Systems Operation Report

Well No. 11 - Direct Supply to Distribution System

Public Water System Name Brookhaven National Laboratory	Reporting Month/Year JUNE 2008	Date Report Submitted 6/30/2008	Source Water Type(s) <input type="checkbox"/> Surface <input checked="" type="checkbox"/> Ground <input type="checkbox"/> GWUDI
Public Water System ID 5111891	County Suffolk	Town, Village, or City Upton, New York 11973	<input type="checkbox"/> Purchase with subsequent chlorination <input type="checkbox"/> Purchase w/out subsequent chlorination

DATE	Source(s) in Use Well No.: 11	Treated water volume (1,000 gallons/day)	Chlorination				Other Treatments / Readings			Daily Totalizer
			Gaseous		Liquid	Free chlorine residual at entry point (mg/l)	Hypochlorite used/day	pH Sodium Hydroxide		
			Cylinder weight (lbs.)	Chlorine used per day (lbs.)	Hypochlorite (gallons Hypochlorite in Tank)					
					141				741,857	
1		-	NA	NA						
2	11	-	NA	NA	141	NR	NR	NR	741,857	
3	11	-	NA	NA	141	NR	NR	NR	741,857	
4	11	-	NA	NA	141	NR	NR	NR	741,857	
5	11	-	NA	NA	141	NR	NR	NR	741,857	
6	11	59	NA	NA	141	NR	NR	NR	741,916	
7		-								
8		-								
9	11	62	NA	NA	132	NR	NR	NR	741,978	
10	11	898	NA	NA	90	1.05	42	6.6	742,876	
11	11	601	NA	NA	66+50	0.30	23	6.6	743,477	
12	11	799	NA	NA	102	1.05	14	NR	744,276	
13	11	714	NA	NA	84	0.84	18	NR	744,990	
14		-	NA	NA						
15		-	NA	NA						
16	11	1,971	NA	NA	45	0.96	39	6.8	746,961	
17	11	158	NA	NA	45	NR		NR	747,119	
18	11	-	NA	NA	45	NR	NR	NR	747,119	
19	11	305	NA	NA	33+111	NR	12	NR	747,424	
20	11	82	NA	NA	141	NR	3	NR	747,506	
21		-	NA	NA						
22		-	NA	NA						
23	11	-	NA	NA	141	NR	NR	NR	747,506	
24	11	-	NA	NA	141	NR	NR	NR	747,506	
25	11	-	NA	NA	141	NR	NR	NR	747,506	
26	11	-	NA	NA	141	NR	NR	NR	747,506	
27	11	6	NA	NA	141	NR	NR	NR	747,512	
28		-	NA	NA						
29		-	NA	NA						
30	11	-	NA	NA	141	NR	NR	NR	747,512	
31		-	NA	NA						
Total		5,655	DAYS	30			151			
AVG.		182.42				0.84	21.6			

Chlorine Mix Ratio = _____ quarts/gallons of _____ % chlorine added to _____ gallons of water in crock

Reported by: WILLIAM CHALOUPKA Title: Water Systems Supervisor NYS DOH Operator Certification Number: NY0030392

Signature: *William Chaloupka* Date: 2 July 2008 Operator Grade Level 1A-SW/GUI

NEW YORK STATE DEPARTMENT OF HEALTH

Bureau of Water Supply Protection

Water Systems Operation Report

Well No. 12 - Direct Supply to Distribution System

Public Water System Name Brookhaven National Laboratory	Reporting Month/Year JUNE 2008	Date Report Submitted 6/30/2008	Source Water Type(s) <input type="checkbox"/> Surface <input checked="" type="checkbox"/> Ground <input type="checkbox"/> GWUDI
Public Water System ID 5111891	County Suffolk	Town, Village, or City Upton, New York 11973	<input type="checkbox"/> Purchase with subsequent chlorination <input type="checkbox"/> Purchase w/out subsequent chlorination

DATE	Source(s) in Use Well No.: 12	Treated water volume (1,000 gallons/day)	Chlorination				Other Treatments / Readings			Daily Totalizer
			Gaseous		Liquid	Free chlorine residual at entry point (mg/l)	Hypochlorite used/day	pH Sodium Hydroxide		
			Cylinder weight (lbs.)	Chlorine used per day (lbs.)	Hypochlorite (gallons Hypochlorite in Tank)					
					117				866,530	
1		-	NA	NA						
2	12	-	NA	NA	117	NR	NR	NR	866,530	
3	12	-	NA	NA	117	NR	NR	NR	866,530	
4	12	-	NA	NA	117	NR	NR	NR	866,530	
5	12	13	NA	NA	117	NR	NR	NR	866,543	
6	12	63	NA	NA	117	NR	NR	NR	866,606	
7		-								
8		-								
9	12	39	NA	NA	114	NR	NR	NR	866,645	
10	12	257	NA	NA	111	NR	3	NR	866,902	
11	12	144	NA	NA	105	NR	6	NR	867,046	
12	12	-	NA	NA	105	NR		NR	867,046	
13	12	-	NA	NA	105	NR	NR	NR	867,046	
14		-	NA	NA						
15		-	NA	NA						
16	12	-	NA	NA	105	NR	NR	NR	867,046	
17	12	-	NA	NA	105	NR	NR	NR	867,046	
18	12	-	NA	NA	105	NR	NR	NR	867,046	
19	12	4	NA	NA	105	NR	NR	NR	867,050	
20	12	77	NA	NA	102	NR	3	NR	867,127	
21		-	NA	NA						
22		-	NA	NA						
23	12	-	NA	NA	102	NR	NR	NR	867,127	
24	12	-	NA	NA	102	NR	NR	NR	867,127	
25	12	-	NA	NA	102	NR	NR	NR	867,127	
26	12	-	NA	NA	102	NR	NR	NR	867,127	
27	12	-	NA	NA	102	NR	NR	NR	867,127	
28		-	NA	NA						
29		-	NA	NA						
30	12	-	NA	NA	102	NR	NR	NR	867,127	
31		-	NA	NA						
Total		597	DAYS	30			12			
AVG.		19.26					4.0			

Chlorine Mix Ratio = _____ quarts/gallons of _____ % chlorine added to _____ gallons of water in crock

Reported by: **WILLIAM CHALOUPKA** Title: **Water Systems Supervisor** NYS DOH Operator Certification Number: **NY0030392**

Signature: *William Chaloupka* Date: *2 July 2008* Operator Grade Level: **1A-SW/GUI**

6/30/2008

PUMP DATA _____ 2008

Date	PUMP DATA						Daily Total
	Well 4	Well 6	Well 7	JUNE (Month) Well10	Well11	Well12	
1	0	0	0	0	0	0	0
2	1,504	0	164	0	0	0	1,668
3	541	0	93	0	0	0	634
4	636	0	128	0	0	0	764
5	580	0	18	0	0	13	611
6	536	68	102	0	59	63	828
7	0	0	0	0	0	0	0
8	0	0	0	0	0	0	0
9	228	35	1,250	0	62	39	1,614
10	0	0	0	0	898	257	1,155
11	0	0	0	0	601	144	745
12	0	0	0	0	799	0	799
13	0	0	0	0	714	0	714
14	0	0	0	0	0	0	0
15	0	0	0	0	0	0	0
16	0	0	0	0	1,971	0	1,971
17	153	89	544	0	158	0	944
18	17	0	679	0	0	0	696
19	95	0	413	0	305	4	817
20	45	0	430	0	82	77	634
21	0	0	0	0	0	0	0
22	0	0	0	0	0	0	0
23	160	2,277	2,805	0	0	0	5,242
24	663	79	1	0	0	0	743
25	143	50	611	0	0	0	804
26	199	120	744	0	0	0	1,063
27	196	81	750	0	6	0	1,033
28	0	0	0	0	0	0	0
29	0	0	0	0	0	0	0
30	437	214	2,024	0	0	0	2,675
31	0	0	0	0	0	0	0
Total	6,133	3,013	10,756	0	5,655	597	26,154

	Totalizer This Month	Totalizer Last Month	Total(x1,000) Gallons
Well 4	1,827,202	1,821,069	6,133
Well 6	705,706	702,693	3,013
Well 7	2,576,078	2,533,322	42,756
Well 10	772,460	772,460	0
Well 11	747,512	741,857	5,655
Well 12	867,127	866,530	597

AGS Water Supply Meter	697,948	697,944	4.00
Biology Building - Well 9	6,793,150	6,793,150	0.00

Microbiological Samples and Free Chlorine Residual

Sample Location	Date of Sample	Sample Type 1.Routine 2.Repeat	Total Coliform Positive	E.coli Positive	Free Chlorine Residual (mg/l)	Population Served: <u>3,500</u>
B-49 WATER TOWER 094-273	6/6/2008	1	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No	0.63	Number of microbiological monitoring samples required: <u>4</u> Number of microbiological monitoring samples taken: <u>7</u> Did an M&R violation occur? <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No If "Yes," check reason (s) below: _____ Actual number of samples is fewer than required _____ Did not collect/analyze repeat sample. _____ Did not collect/analyze for E. coli for positive total coliform from routine/repeat Did an MCL violation occur? <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No If "Yes," check reason(s) below (see also Part 5, Table 6 for additional information). For systems collecting less than 40 samples per month: two or more of the samples (routine and /or repeat) are positive for total coliform (= total coliform <u>MCL</u> violation). For systems collecting 40 or more samples per month: more than 5% of the samples (routine and/or repeat) are positive for total coliform (= total coliform <u>MCL</u> violation). The original sample was E.coli positive and at least 1 repeat sample was positive for total Reminder: System must collect a minimum of five (5) routine microbiological monitoring samples during the month following a repeat sample collection. As required by 5-1.72, "Operation of a Public Water System," a copy of this form shall be sent to your local health department by the 10th calendar day of the next reporting period.
B-640 WATER TOWER 076-408	6/6/2008	1	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No	0.91	
B 1005 RHIC 045-12	6/6/2008	1	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No	0.74	
B 363 APART. LAUNDRY 109-19	6/6/2008	1	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No	0.35	
B-725 NSLS 075-602	6/6/2008	1	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No	0.45	
B 490 BLOCK 1 ACF 084-69	6/6/2008	1	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No	0.61	
B490 BLOCK 4 MRC 084-68	6/6/2008	1	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No	0.49	
FIELD DUP. B-725 075-602	6/6/2008	1	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No	0.45	
			<input type="checkbox"/> Yes <input type="checkbox"/> No	<input type="checkbox"/> Yes <input type="checkbox"/> No		
			<input type="checkbox"/> Yes <input type="checkbox"/> No	<input type="checkbox"/> Yes <input type="checkbox"/> No		
			<input type="checkbox"/> Yes <input type="checkbox"/> No	<input type="checkbox"/> Yes <input type="checkbox"/> No		
			<input type="checkbox"/> Yes <input type="checkbox"/> No	<input type="checkbox"/> Yes <input type="checkbox"/> No		
			<input type="checkbox"/> Yes <input type="checkbox"/> No	<input type="checkbox"/> Yes <input type="checkbox"/> No		
			<input type="checkbox"/> Yes <input type="checkbox"/> No	<input type="checkbox"/> Yes <input type="checkbox"/> No		
			<input type="checkbox"/> Yes <input type="checkbox"/> No	<input type="checkbox"/> Yes <input type="checkbox"/> No		
			<input type="checkbox"/> Yes <input type="checkbox"/> No	<input type="checkbox"/> Yes <input type="checkbox"/> No		

Sample Collector(s): JOHN KULESA

Name of NYSDOH Certified Laboratory: H2M Labs 575 Broad Hollow Road; Melville, N.Y. 11747

Did any MCL violation occur? If so, please describe: No

Did an emergency or low pressure problem occur? Did source water bypass an existing treatment process in the system? If so, please explain.
No

Comments: _____

ATTACHMENT II

Brookhaven National Laboratory

Potable Water Supply

June 2008 Biweekly Water Quality Monitoring Data

for the BNL Distribution System and Potable Water Wells

Attachment II
Table 1 - Summary of Water Quality Analyses
for the BNL Potable Water System
June 2008

Sample Location	Sample Date	pH (SU)	Temperature (Degrees F)	Conductivity (µmhos)	Alkalinity (mg/L)	Calcium (mg/L)
WTP	6/3/08	7.2	59	170	ANR	ANR
WTP	6/5/08	7.0	59	167	ANR	ANR
WTP	6/10/08	6.6	59	222	ANR	ANR
WTP	6/12/08	6.7	57	212	ANR	ANR
WTP	6/17/08	7.3	55	111	ANR	ANR
WTP	6/19/08	7.0	54	110	ANR	ANR
WTP	6/24/08	6.7	60	177	ANR	ANR
WTP	6/26/08	8.0	61	105	ANR	ANR
Well 11	6/10/08	6.6	55	NR	ANR	ANR

ANR- Analysis Not Required

NR- Not Reported

Note: Field parameters are only conducted for facilities that are in operation on the day of measurement.

ATTACHMENT III

Brookhaven National Laboratory

Potable Water Supply

June 2008 Stage 1 Disinfectants & Disinfection Byproduct Rule

Monitoring Data and Bacteriological Analyses for the BNL Distribution System

Attachment III

**June 2008 Stage 1 Disinfectants & Disinfection Byproduct Rule Monitoring Data
Table II - Maximum Residual Disinfectant Level (MRDL) Compliance**

Location	Total Residual Chlorine (mg/L)											
	July 07	Aug. 07	Sept. 07	Oct. 07	Nov. 07	Dec. 07	Jan. 08	Feb. 08	Mar. 08	Apr. 08	May 08	June 08
Bldg. 49 Water Tower	0.6	0.8	0.5	1.0	0.6	0.9	0.5	0.9	0.8	1.0	0.8	0.6
Bldg. 640 Water Tower	0.5	0.6	0.7	0.6	0.7	0.5	0.5	0.5	0.8	0.8	0.5	0.9
Bldg. 363 Apt. Laundry	0.4	0.5	0.4	0.4	0.3	0.6	0.5	0.6	0.4	0.5	0.3	0.7
Bldg. 1005 RHIC	0.5	0.5	0.5	0.6	0.5	0.7	0.5	0.8	0.7	0.9	0.6	0.4
Bldg. 930 LINAC	0.4	NS	1.0	NS	1.1	NS	0.7	NS	0.8	NS	1.0	NS
Bldg. 725 NSLS	NS	0.9	NS	0.7	NS	0.5	NS	1.1	NS	0.8	NS	0.5
Bldg. 490 Outpatient Clinic	0.9	NS	0.7	NS	0.8	NS	0.5	NS	0.9	NS	0.8	NS
Bldg. 490 Block 11	0.6	NS	0.4	NS	0.5	NS	0.5	NS	0.5	NS	0.7	NS
Bldg. 490 Block 1 ACF	NS	1.1	NS	0.9	NS	0.5	NS	0.4	NS	0.7	NS	0.6
Bldg. 490 Block 4 MRC	NS	0.6	NS	1.1	NS	0.9	NS	0.7	NS	0.5	NS	0.5
Monthly Average	0.6	0.7	0.6	0.8	0.6	0.7	0.5	0.7	0.7	0.7	0.7	0.6

NA - Not Applicable

NS - Not Scheduled for sampling

**Running Annual Average (mg/L) 0.7 (Total Residual Chlorine)
MRDL (mg/L) 4.0**

H2M LABS, INC.

575 Broad Hollow Road, Melville NY 11747
 (631) 694-3040. FAX: (631) 420-8436 NYSDOH ID# 10478

Brookhaven National Lab.-BNLM
 70 Bell Ave.
 Upton, NY 11973
 Attn To : Bob Lee

Federal ID 5111891

Collected : 8/6/2008 9:55:00 AM Point No : 094-273

Received : 8/6/2008 3:45:00 PM Location : B-49 Water Tower

Collected By : CLIENT

Copy : ORIGINAL

CC

LABORATORY RESULTS

Lab No. : 0806776-001A

Client ID. : 25083-001

Sample Information

Type : Potable Water

Origin : Distribution
 Routine

<u>Parameter(s)</u>	<u>Results</u>	<u>Qualifier</u>	<u>D.F.</u>	<u>Units</u>	<u>Limit</u>	<u>Method Number</u>	<u>Analyzed</u>
Total Coliform	Negative		1	N/A	Negative	M9223	06/07/2008 12:30 PM
E_Coliform	Absent		1	N/A	Absent	M9223	06/07/2008 12:30 PM
Residual Chlorine	0.6		1	mg/L		M4500-CI G	06/06/2008

Result(s) reported meet(s) Regulatory Limit(s).
 Result(s) flagged with * Exceed Regulatory Limit(s). Limit noted.
 D.F. = Dilution Factor

Date Reported : 6/25/2008

Joanna M. Alavin

H2M LABS, INC.

575 Broad Hollow Road, Melville NY 11747
 (631) 694-3040 . FAX: (631) 420-8436 NYSDOH ID# 10478

Brookhaven National Lab.-BNLM
 70 Bell Ave.
 Upton, NY 11973
 Attn To : Bob Lee

Federal ID 5111891

Collected : 6/8/2008 1:15:00 PM Point No : 076-408

Received : 6/8/2008 3:45:00 PM Location : B-640 Water Tower

Collected By : CLIENT

Copy : ORIGINAL

CC

LABORATORY RESULTS

Lab No. : 0806776-002A

Client ID. : 25083-002

Sample Information

Type : Potable Water

Origin : Distribution
 Routine

<u>Parameter(s)</u>	<u>Results</u>	<u>Qualifier</u>	<u>D.F.</u>	<u>Units</u>	<u>Limit</u>	<u>Method Number</u>	<u>Analyzed</u>
Total Coliform	Negative		1	N/A	Negative	M9223	06/07/2008 12:30 PM
E_Coliform	Absent		1	N/A	Absent	M9223	06/07/2008 12:30 PM
Residual Chlorine	0.9		1	mg/L		M4500-CI G	06/06/2008

Result(s) reported meet(s) Regulatory Limit(s).
 Result(s) flagged with * Exceed Regulatory Limit(s). Limit noted.
 D.F. = Dilution Factor

Date Reported : 6/25/2008

Joann M. Slavin

H2M LABS, INC.

575 Broad Hollow Road, Melville NY 11747
 (631)694-3040 .FAX: (631)420-8436 NYSDOH ID# 10478

Sample Information

Type : Potable Water
 Origin : Distribution
 Routine

LABORATORY RESULTS

Brookhaven National Lab.-BNLM
 70 Bell Ave.
 Upton, NY 11973
 Attn To : Bob Lee

Lab No. : 0806776-003A

Client ID. : 25083-003

Federal ID 5111891

Collected : 6/6/2008 7:59:00 AM Point No : 109-19

Received : 6/6/2008 3:45:00 PM Location : B-363 Apt.Laundry

Collected By : CLIENT


Copy : ORIGINAL

CC

<u>Parameter(s)</u>	<u>Results</u>	<u>Qualifier</u>	<u>D.F.</u>	<u>Units</u>	<u>Limit</u>	<u>Method Number</u>	<u>Analyzed</u>
Total Coliform	Negative		1	N/A	Negative	M9223	06/07/2008 12:30 PM
E_Coliform	Absent		1	N/A	Absent	M9223	06/07/2008 12:30 PM
Residual Chlorine	0.7		1	mg/L		M4500-C G	06/06/2008

Result(s) reported meet(s) Regulatory Limit(s).
 Result(s) flagged with * Exceed Regulatory Limit(s). Limit noted.
 D.F. = Dilution Factor

Date Reported : 6/25/2008



H2M LABS, INC.

575 Broad Hollow Road, Melville NY 11747
 (631)694-3040 .FAX: (631)420-8436 NYSDOH ID# 10478

Brookhaven National Lab.-BNLM
 70 Bell Ave.
 Upton, NY 11973
 Attn To : Bob Lee

Federal ID 5111891

Collected : 6/6/2008 8:20:00 AM Point No : 045-12
 Received : 6/6/2008 3:45:00 PM Location : B-1005 RHIC

Collected By : CLIENT

Copy : ORIGINAL

CC

LABORATORY RESULTS

Lab No. : 0806776-004A

Client ID. : 25083-004

Sample Information

Type : Potable Water
 Origin : Distribution
 Routine

<u>Parameter(s)</u>	<u>Results</u>	<u>Qualifier</u>	<u>D.F.</u>	<u>Units</u>	<u>Limit</u>	<u>Method Number</u>	<u>Analyzed</u>
Total Coliform	Negative		1	N/A	Negative	M9223	06/07/2008 12:30 PM
E_Coliform	Absent		1	N/A	Absent	M9223	06/07/2008 12:30 PM
Residual Chlorine	0.4		1	mg/L		M4500-Cl G	06/06/2008

Result(s) reported meet(s) Regulatory Limit(s).
 Result(s) flagged with * Exceed Regulatory Limit(s). Limit noted.
 D.F. = Dilution Factor

Date Reported : 6/25/2008

Jeanne M. Blawie

H2M LABS, INC.

575 Broad Hollow Road, Melville NY 11747
 (631) 694-3040 . FAX: (631) 420-8436 NYSDOH ID# 10478

Brookhaven National Lab.-BNLM

70 Bell Ave.

Upton, NY 11973

Attn To : Bob Lee

Federal ID 5111891

Collected : 6/6/2008 8:55:00 AM Point No : 075-602

Received : 6/8/2008 3:45:00 PM Location : B-725 NSLS

Collected By : CLIENT

Copy : ORIGINAL

CC

LABORATORY RESULTS

Lab No. : 0806776-005A

Client ID. : 25083-005

Sample Information

Type : Potable Water

Origin : Distribution

Routine

<u>Parameter(s)</u>	<u>Results</u>	<u>Qualifier</u>	<u>D.F.</u>	<u>Units</u>	<u>Limit</u>	<u>Method Number</u>	<u>Analyzed</u>
Total Coliform	Negative		1	N/A	Negative	M9223	06/07/2008 12:30 PM
E_Coliform	Absent		1	N/A	Absent	M9223	06/07/2008 12:30 PM
Residual Chlorine	0.5		1	mg/L		M4500-Cl G	06/06/2008

Result(s) reported meet(s) Regulatory Limit(s).

Result(s) flagged with * Exceed Regulatory Limit(s). Limit noted.

D.F. = Dilution Factor

Date Reported : 6/25/2008

Joann M. Blavin

H2M LABS, INC.575 Broad Hollow Road, Melville NY 11747
(631) 694-3040 . FAX: (631) 420-8436 NYSDOH ID# 10478Brookhaven National Lab.-BNLM
70 Bell Ave.
Upton, NY 11973
Attn To : Bob Lee**LABORATORY RESULTS**Lab No. : 0806776-006A
Client ID. : 25083-006**Sample Information**Type : Potable Water
Origin : Distribution
Routine

Federal ID 5111891

Collected : 6/6/2008 10:20:00 AM Point No : 084-69

Received : 6/6/2008 3:45:00 PM Location : B-490 Block 1 ACF

Collected By : CLIENT


Copy : ORIGINAL

CC

<u>Parameter(s)</u>	<u>Results</u>	<u>Qualifier</u>	<u>D.F.</u>	<u>Units</u>	<u>Limit</u>	<u>Method Number</u>	<u>Analyzed</u>
Total Coliform	Negative		1	N/A	Negative	M9223	06/07/2008 12:30 PM
E_Coliform	Absent		1	N/A	Absent	M9223	06/07/2008 12:30 PM
Residual Chlorine	0.6		1	mg/L		M4500-CI G	06/06/2008

Result(s) reported meet(s) Regulatory Limit(s).
 Result(s) flagged with * Exceed Regulatory Limit(s). Limit noted.
 D.F. = Dilution Factor

Date Reported : 6/25/2008



H2M LABS, INC.

575 Broad Hollow Road, Melville NY 11747
 (631) 694-3040 FAX: (631) 420-8436 NYSDOH ID# 10478

Brookhaven National Lab.-BNLM
 70 Bell Ave.
 Upton, NY 11973
 Attn To : Bob Lee

Federal ID 5111891

Collected : 6/6/2008 10:35:00 AM Point No : 084-68

Received : 6/6/2008 3:45:00 PM Location : B-490 Block 4 MRC

Collected By : CLIENT

Copy : ORIGINAL

CC

LABORATORY RESULTS

Lab No. : 0806776-007A

Client ID. : 25083-007

Sample Information

Type : Potable Water

Origin : Distribution

Routine

<u>Parameter(s)</u>	<u>Results</u>	<u>Qualifier</u>	<u>D.F.</u>	<u>Units</u>	<u>Limit</u>	<u>Method Number</u>	<u>Analyzed</u>
Total Coliform	Negative		1	N/A	Negative	M9223	06/07/2008 12:30 PM
E_Coliform	Absent		1	N/A	Absent	M9223	06/07/2008 12:30 PM
Residual Chlorine	0.5		1	mg/L		M4500-Cl G	06/06/2008

Result(s) reported meet(s) Regulatory Limit(s).
 Result(s) flagged with * Exceed Regulatory Limit(s). Limit noted.
 D.F. = Dilution Factor

Date Reported : 6/25/2008

Joann M. Alavin

H2M LABS, INC.

575 Broad Hollow Road, Melville NY 11747
 (631) 694-3040 FAX: (631) 420-8436 NYSDOH ID# 10478

Brookhaven National Lab.-BNLM
 70 Bell Ave.

Upton, NY 11973

Attn To : Bob Lee

Federal ID 5111891

Collected : 6/6/2008 8:55:00 AM Point No : 075-602

Received : 6/6/2008 3:45:00 PM Location : B-725 NSLS

Collected By : CLIENT

Copy : ORIGINAL

CC

LABORATORY RESULTS

Lab No. : 0806776-014A

Client ID. : 25083-014

Sample Information

Type : Potable Water

Origin : Distribution

Routine

<u>Parameter(s)</u>	<u>Results</u>	<u>Qualifier</u>	<u>D.F.</u>	<u>Units</u>	<u>Limit</u>	<u>Method Number</u>	<u>Analyzed</u>
Total Coliform	Negative		1	N/A	Negative	M9223	06/07/2008 12:30 PM
E_Coliform	Absent		1	N/A	Absent	M9223	06/07/2008 12:30 PM
Residual Chlorine	0.5		1	mg/L		M4500-Cl G	06/06/2008

Result(s) reported meet(s) Regulatory Limit(s).
 Result(s) flagged with * Exceed Regulatory Limit(s). Limit noted.
 D.F. = Dilution Factor

Date Reported : 6/25/2008

Joann M. Slavin

ATTACHMENT IV

Brookhaven National Laboratory

Potable Water Supply

2008 Annual Asbestos Analysis for the BNL Potable Water Distribution System



EMSL Analytical, Inc.

208 Stone Hinge Lane, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn: **H2M Labs**
575 Broad Hollow Road
Melville, NY 11747

Fax: (631) 694-4122 Phone: (631) 756-8000
Project: **PO#7686, BNLM**

Customer ID: HMMP77
Customer PO:
Received: 06/07/08 9:50 AM
EMSL Order: 060809773
EMSL Proj:
Analysis Date: 6/16/2008
Report Date: 6/17/2008

**Determination of Asbestos Structures in Water Performed by the 100.2 Method
(EPA/600/R-94/134)**

Sample ID	Sample Prep Date	# Fibers Asbestos	# Fibers Non-Asbestos	Type(s) Of Asbestos	Analytical Sensitivity (MFL)	Confidence Limits	Concentration Of Asbestos Fibers (MFL)	Comments
0806776-003A 060809773-0001	6/7/08	0	0		0.20	0.00-0.75	<0.20	

Concentration of Asbestos for all fiber size = <0.20 MFL

Analyst(s)

Zlatan Dimitrijevic (1)

Michelle McGowan, Laboratory Manager
or other approved signatory

Sample collection and containers provided by the client, acceptable bottle blank level is defined as $\leq 0.01\text{MFL} > 10\mu\text{m}$. ND=None Detected. This report may not be reproduced, except in full, without written permission by EMSL Analytical, Inc. The test results contained within this report meet the requirements of NELAC unless otherwise noted. This report relates only to the samples reported above. Samples received in good condition unless otherwise noted.
CA ELAP 2339, CT PH-0249, NY ELAP 11469, LELAP 04144

ATTACHMENT V

Brookhaven National Laboratory

Potable Water Supply

**2008 Annual Synthetic Organic Chemical and Pesticides Analyses and
Inorganic and Nitrate/Nitrite Analyses for the BNL Potable Water Wells**

H2M LABS, INC.

575 Broad Hollow Road, Melville NY 11747
(631)694-3040. FAX: (631)420-8436 NYSDOH ID# 10478

Brookhaven National Lab.-BNLM
70 Bell Ave.
Upton, NY 11973
Attn To : Bob Lee

LABORATORY RESULTS

Lab No. : 0806776-016A

Client ID. : 25083-016

Sample Information


Type : Potable Water
Origin : Raw Well
Routine

Federal ID : 5111891
Collected : 6/6/2008 Point No : 23
Received : 6/6/2008 3:45:00 PM Location : Well 4/6/7 Composite
Collected By : CLIENT
Copy : ORIGINAL
CC

Parameter(s)	Results	Qualifier	D.F.	Units	Limit	Method Number	Analyzed
1,2-Dibromoethane	< 0.02		1	µg/L	0.05	E504.1	06/10/2008 6:43 AM
1,2-Dibromoethane	< 0.02		1	µg/L	0.05	E504.1	06/10/2008 6:43 AM
1,2-Dibromo-3-chloropropane	< 0.02		1	µg/L	0.2	E504.1	06/10/2008 6:43 AM
1,2-Dibromo-3-chloropropane	< 0.02		1	µg/L	0.2	E504.1	06/10/2008 6:43 AM
Dalapon	< 0.70		1	µg/L	200	E515.1	06/19/2008 2:52 PM
Dalapon	< 0.70		1	µg/L	200	E515.1	06/19/2008 2:52 PM
Dicamba	< 0.08		1	µg/L	50	E515.1	06/19/2008 2:52 PM
Dicamba	< 0.08		1	µg/L	50	E515.1	06/19/2008 2:52 PM
2,4-D	< 0.25		1	µg/L	50	E515.1	06/19/2008 2:52 PM
2,4-D	< 0.25		1	µg/L	50	E515.1	06/19/2008 2:52 PM
Pentachlorophenol	< 0.20		1	µg/L	1	E515.1	06/19/2008 2:52 PM
Pentachlorophenol	< 0.20		1	µg/L	1	E515.1	06/19/2008 2:52 PM
2,4,5-TP (Silvex)	< 0.13		1	µg/L	10	E515.1	06/19/2008 2:52 PM
2,4,5-TP (Silvex)	< 0.13		1	µg/L	10	E515.1	06/19/2008 2:52 PM
Dinoseb	< 0.20		1	µg/L	7	E515.1	06/19/2008 2:52 PM
Dinoseb	< 0.20		1	µg/L	7	E515.1	06/19/2008 2:52 PM
Picloram	< 0.60		1	µg/L	500	E515.1	06/19/2008 2:52 PM
Picloram	< 0.60		1	µg/L	500	E515.1	06/19/2008 2:52 PM
Aldicarb sulfoxide	< 1.0		1	µg/L	4	E531.1	06/17/2008 9:56 AM
Aldicarb sulfone	< 1.0		1	µg/L	2	E531.1	06/17/2008 9:56 AM
Oxamyl	< 1.0		1	µg/L	200	E531.1	06/17/2008 9:56 AM
Methomyl	< 1.0		1	µg/L	50	E531.1	06/17/2008 9:56 AM
3-Hydroxycarbofuran	< 1.0		1	µg/L	50	E531.1	06/17/2008 9:56 AM
Aldicarb	< 1.0		1	µg/L	3	E531.1	06/17/2008 9:56 AM
Carbofuran	< 1.0		1	µg/L	40	E531.1	06/17/2008 9:56 AM
Carbaryl	< 1.0		1	µg/L	50	E531.1	06/17/2008 9:56 AM
Glyphosate	< 10		1	µg/L	700	E547	06/11/2008 12:30 AM
Diquat	< 1.0		1	µg/L	20	E549.1	06/11/2008 2:59 PM
Endothall	< 50		1	ug/L	100	E548.1	06/12/2008 12:34 PM

Result(s) reported meet(s) Regulatory Limit(s).
Result(s) flagged with * Exceed Regulatory Limit(s). Limit noted.
D.F. = Dilution Factor

Date Reported : 6/25/2008



H2M LABS, INC.

575 Broad Hollow Road, Melville NY 11747
(631) 694-3040. FAX: (631) 420-8436 NYSDOH ID# 10478

Brookhaven National Lab.-BNLM
70 Bell Ave.
Upton, NY 11973
Attn To : Bob Lee

Federal ID : 5111891
Collected : 6/6/2008 Point No : 24
Received : 6/6/2008 3:45:00 PM Location : Well 10/11/12 Composi
Collected By : CLIENT
Copy : ORIGINAL
CC

LABORATORY RESULTS

Lab No. : 0806776-015A

Client ID. : 25083-015


Sample Information

Type : Potable Water
Origin : Raw Well
Routine

Parameter(s)	Results	Qualifier	D.F.	Units	Limit	Method Number	Analyzed
1,2-Dibromoethane	< 0.02		1	µg/L	0.05	E504.1	06/10/2008 6:10 AM
1,2-Dibromoethane	< 0.02		1	µg/L	0.05	E504.1	06/10/2008 6:10 AM
1,2-Dibromo-3-chloropropane	< 0.02		1	µg/L	0.2	E504.1	06/10/2008 6:10 AM
1,2-Dibromo-3-chloropropane	< 0.02		1	µg/L	0.2	E504.1	06/10/2008 6:10 AM
Dalapon	< 0.70		1	µg/L	200	E515.1	06/19/2008 2:31 PM
Dalapon	< 0.70		1	µg/L	200	E515.1	06/19/2008 2:31 PM
Dicamba	< 0.08		1	µg/L	50	E515.1	06/19/2008 2:31 PM
Dicamba	< 0.08		1	µg/L	50	E515.1	06/19/2008 2:31 PM
2,4-D	< 0.25		1	µg/L	50	E515.1	06/19/2008 2:31 PM
2,4-D	< 0.25		1	µg/L	50	E515.1	06/19/2008 2:31 PM
Pentachlorophenol	< 0.20		1	µg/L	1	E515.1	06/19/2008 2:31 PM
Pentachlorophenol	< 0.20		1	µg/L	1	E515.1	06/19/2008 2:31 PM
2,4,5-TP (Silvex)	< 0.13		1	µg/L	10	E515.1	06/19/2008 2:31 PM
2,4,5-TP (Silvex)	< 0.13		1	µg/L	10	E515.1	06/19/2008 2:31 PM
Dinoseb	< 0.20		1	µg/L	7	E515.1	06/19/2008 2:31 PM
Dinoseb	< 0.20		1	µg/L	7	E515.1	06/19/2008 2:31 PM
Picloram	< 0.60		1	µg/L	500	E515.1	06/19/2008 2:31 PM
Picloram	< 0.60		1	µg/L	500	E515.1	06/19/2008 2:31 PM
Aldicarb sulfoxide	< 1.0		1	µg/L	4	E531.1	06/17/2008 8:53 AM
Aldicarb sulfone	< 1.0		1	µg/L	2	E531.1	06/17/2008 8:53 AM
Oxamyl	< 1.0		1	µg/L	200	E531.1	06/17/2008 8:53 AM
Methomyl	< 1.0		1	µg/L	50	E531.1	06/17/2008 8:53 AM
3-Hydroxycarbofuran	< 1.0		1	µg/L	50	E531.1	06/17/2008 8:53 AM
Aldicarb	< 1.0		1	µg/L	3	E531.1	06/17/2008 8:53 AM
Carbofuran	< 1.0		1	µg/L	40	E531.1	06/17/2008 8:53 AM
Carbaryl	< 1.0		1	µg/L	50	E531.1	06/17/2008 8:53 AM
Glyphosate	< 10		1	µg/L	700	E547	06/10/2008 11:59 PM
Diquat	< 1.0		1	µg/L	20	E549.1	06/11/2008 2:51 PM
Endothall	< 50		1	ug/L	100	E548.1	06/12/2008 12:17 PM

Result(s) reported meet(s) Regulatory Limit(s).
Result(s) flagged with * Exceed Regulatory Limit(s). Limit noted.
D.F. = Dilution Factor

Date Reported : 6/25/2008



H2M LABS, INC.

575 Broad Hollow Road, Melville NY 11747
 (631) 694-3040 FAX: (631) 420-8436 NYSDOH ID# 10478

Sample Information

Type : Potable Water
 Origin : Raw Well
 Routine

LABORATORY RESULTS

Lab No. : 0806776-013A

Client ID. : 25083-013


Brookhaven National Lab.-BNLM
 70 Bell Ave.
 Upton, NY 11973
 Attn To : Bob Lee

Federal ID : 5111891
 Collected : 6/6/2008 6:26:00 AM Point No : 083-20
 Received : 6/6/2008 3:45:00 PM Location : Well #4 Raw
 Collected By : CLIENT
 Copy : ORIGINAL
 CC

Parameter(s)	Results	Qualifier	D.F.	Units	Limit	Method Number	Analyzed
Lindane	< 0.025		1	µg/L	0.2	E505	06/11/2008 12:04 PM
Lindane	< 0.025		1	µg/L	0.2	E505	06/11/2008 12:04 PM
Heptachlor	< 0.025		1	µg/L	0.4	E505	06/11/2008 12:04 PM
Heptachlor	< 0.025		1	µg/L	0.4	E505	06/11/2008 12:04 PM
Aldrin	< 0.025		1	µg/L	5	E505	06/11/2008 12:04 PM
Aldrin	< 0.025		1	µg/L	5	E505	06/11/2008 12:04 PM
Chlordane	< 0.50		1	µg/L	2	E505	06/11/2008 12:04 PM
Chlordane	< 0.50		1	µg/L	2	E505	06/11/2008 12:04 PM
Heptachlor epoxide	< 0.025		1	µg/L	0.2	E505	06/11/2008 12:04 PM
Heptachlor epoxide	< 0.025		1	µg/L	0.2	E505	06/11/2008 12:04 PM
Dieldrin	< 0.050		1	µg/L	2	E505	06/11/2008 12:04 PM
Dieldrin	< 0.050		1	µg/L	2	E505	06/11/2008 12:04 PM
Endrin	< 0.050		1	µg/L	2	E505	06/11/2008 12:04 PM
Endrin	< 0.050		1	µg/L	2	E505	06/11/2008 12:04 PM
Methoxychlor	< 0.25		1	µg/L	40	E505	06/11/2008 12:04 PM
Methoxychlor	< 0.25		1	µg/L	40	E505	06/11/2008 12:04 PM
Toxaphene	< 2.5		1	µg/L	3	E505	06/11/2008 12:04 PM
Toxaphene	< 2.5		1	µg/L	3	E505	06/11/2008 12:04 PM
Total PCBs	< 0.50		1	µg/L	0.5	E505	06/11/2008 12:04 PM
Total PCBs	< 0.50		1	µg/L	0.5	E505	06/11/2008 12:04 PM
Barium	< 200		1	µg/L	2000	E200.7	06/17/2008 11:54 AM
Beryllium	< 3.0		1	µg/L	4	E200.7	06/17/2008 11:54 AM
Cadmium	< 5.0		1	µg/L	5	E200.7	06/17/2008 11:54 AM
Chromium	< 10		1	µg/L	100	E200.7	06/17/2008 11:54 AM
* Iron	* 1220	*	1	µg/L	300	E200.7	06/17/2008 11:54 AM
Manganese	222		1	µg/L	300	E200.7	06/17/2008 11:54 AM
Nickel	< 40.0		1	µg/L		E200.7	06/17/2008 11:54 AM
Silver	< 10		1	µg/L	100	E200.7	06/17/2008 11:54 AM
Sodium	19300		1	µg/L		E200.7	06/17/2008 11:54 AM
Zinc	< 20.0		1	µg/L	5000	E200.7	06/17/2008 11:54 AM
Arsenic	< 3.00		1	ug/l	10	E200.8	06/12/2008 10:20 AM
Lead	< 1.00		1	ug/l	15	E200.8	06/12/2008 10:20 AM
Selenium	< 5.00		1	ug/l	50	E200.8	06/12/2008 10:20 AM
Antimony	< 5.90		1	ug/l	6	E200.8	06/12/2008 10:20 AM
Thallium	< 1.90		1	ug/l	2	E200.8	06/12/2008 10:20 AM
Mercury	< 0.20		1	ug/l	2	E200.8	06/12/2008 10:20 AM
Hexachlorocyclopentadiene	< 0.64		1	µg/L	50	E525.2	06/17/2008 8:26 PM
Propachlor	< 1.0		1	µg/L	50	E525.2	06/17/2008 8:26 PM

Result(s) reported meet(s) Regulatory Limit(s).
 Result(s) flagged with * Exceed Regulatory Limit(s). Limit noted.
 D.F. = Dilution Factor

Date Reported : 6/25/2008



H2M LABS, INC.

575 Broad Hollow Road, Melville NY 11747
(631)694-3040. FAX: (631)420-8436 NYSDOH ID# 10478

Brookhaven National Lab.-BNLM
70 Bell Ave.
Upton, NY 11973
Attn To : Bob Lee

LABORATORY RESULTS

Lab No. : 0806776-013A

Client ID. : 25083-013

Sample Information


Type : Potable Water
Origin : Raw Well
Routine

Federal ID 5111891
Collected : 6/6/2008 6:26:00 AM Point No : 083-20
Received : 6/6/2008 3:45:00 PM Location : Well #4 Raw
Collected By : CLIENT
Copy : ORIGINAL
CC

Parameter(s)	Results	Qualifier	D.F.	Units	Limit	Method Number	Analyzed
Hexachlorobenzene	< 0.25		1	µg/L	1	E525.2	06/17/2008 8:26 PM
Simazine	< 0.50		1	µg/L	4	E525.2	06/17/2008 8:26 PM
Atrazine	< 0.50		1	µg/L	3	E525.2	06/17/2008 8:26 PM
Metribuzin	< 0.50		1	µg/L	50	E525.2	06/17/2008 8:26 PM
Alachlor	< 1.0		1	µg/L	2	E525.2	06/17/2008 8:26 PM
Metolachlor	< 1.0		1	µg/L	50	E525.2	06/17/2008 8:26 PM
Butachlor	< 1.0		1	µg/L	50	E525.2	06/17/2008 8:26 PM
bis(2-Ethylhexyl)adipate	< 1.0		1	µg/L	400	E525.2	06/17/2008 8:26 PM
Bis(2-ethylhexyl)phthalate	< 3.0		1	µg/L	6	E525.2	06/17/2008 8:26 PM
Benzo(a)pyrene	< 0.10		1	µg/L	0.2	E525.2	06/17/2008 8:26 PM

Result(s) reported meet(s) Regulatory Limit(s).
Result(s) flagged with * Exceed Regulatory Limit(s). Limit noted.
D.F. = Dilution Factor

Date Reported : 6/25/2008



H2M LABS, INC.

575 Broad Hollow Road, Melville NY 11747
(631) 694-3040. FAX: (631) 420-8436 NYSDOH ID# 10478

Brookhaven National Lab.-BNLM
70 Bell Ave.
Upton, NY 11973
Attn To : Bob Lee

LABORATORY RESULTS

Lab No. : 0806776-010A

Client ID. : 25083-010

Sample Information

Type : Potable Water
Origin : Raw Well
Routine

Federal ID : 5111891
Collected : 6/6/2008 6:43:00 AM Point No : 093-07
Received : 6/6/2008 3:45:00 PM Location : Well #6 Raw
Collected By : CLIENT


Copy : ORIGINAL

CC

Parameter(s)	Results	Qualifier	D.F.	Units	Limit	Method Number	Analyzed
Lindane	< 0.025		1	µg/L	0.2	E505	06/11/2008 10:02 AM
Lindane	< 0.025		1	µg/L	0.2	E505	06/11/2008 10:02 AM
Heptachlor	< 0.025		1	µg/L	0.4	E505	06/11/2008 10:02 AM
Heptachlor	< 0.025		1	µg/L	0.4	E505	06/11/2008 10:02 AM
Aldrin	< 0.025		1	µg/L	5	E505	06/11/2008 10:02 AM
Aldrin	< 0.025		1	µg/L	5	E505	06/11/2008 10:02 AM
Chlordane	< 0.50		1	µg/L	2	E505	06/11/2008 10:02 AM
Chlordane	< 0.50		1	µg/L	2	E505	06/11/2008 10:02 AM
Heptachlor epoxide	< 0.025		1	µg/L	0.2	E505	06/11/2008 10:02 AM
Heptachlor epoxide	< 0.025		1	µg/L	0.2	E505	06/11/2008 10:02 AM
Dieldrin	< 0.050		1	µg/L	2	E505	06/11/2008 10:02 AM
Dieldrin	< 0.050		1	µg/L	2	E505	06/11/2008 10:02 AM
Endrin	< 0.050		1	µg/L	2	E505	06/11/2008 10:02 AM
Endrin	< 0.050		1	µg/L	2	E505	06/11/2008 10:02 AM
Methoxychlor	< 0.25		1	µg/L	40	E505	06/11/2008 10:02 AM
Methoxychlor	< 0.25		1	µg/L	40	E505	06/11/2008 10:02 AM
Toxaphene	< 2.5		1	µg/L	3	E505	06/11/2008 10:02 AM
Toxaphene	< 2.5		1	µg/L	3	E505	06/11/2008 10:02 AM
Total PCBs	< 0.50		1	µg/L	0.5	E505	06/11/2008 10:02 AM
Total PCBs	< 0.50		1	µg/L	0.5	E505	06/11/2008 10:02 AM
Barium	< 200		1	µg/L	2000	E200.7	06/17/2008 11:18 AM
Beryllium	< 3.0		1	µg/L	4	E200.7	06/17/2008 11:18 AM
Cadmium	< 5.0		1	µg/L	5	E200.7	06/17/2008 11:18 AM
Chromium	< 10		1	µg/L	100	E200.7	06/17/2008 11:18 AM
* Iron	* 2680	*	1	µg/L	300	E200.7	06/17/2008 11:18 AM
Manganese	167		1	µg/L	300	E200.7	06/17/2008 11:18 AM
Nickel	< 40.0		1	µg/L		E200.7	06/17/2008 11:18 AM
Silver	< 10		1	µg/L	100	E200.7	06/17/2008 11:18 AM
Sodium	10100		1	µg/L		E200.7	06/17/2008 11:18 AM
Zinc	34.6		1	µg/L	5000	E200.7	06/17/2008 11:18 AM
Arsenic	< 3.00		1	ug/l	10	E200.8	06/12/2008 9:55 AM
Lead	< 1.00		1	ug/l	15	E200.8	06/12/2008 9:55 AM
Selenium	< 5.00		1	ug/l	50	E200.8	06/12/2008 9:55 AM
Antimony	< 5.90		1	ug/l	6	E200.8	06/12/2008 9:55 AM
Thallium	< 1.90		1	ug/l	2	E200.8	06/12/2008 9:55 AM
Mercury	< 0.20		1	ug/l	2	E200.8	06/12/2008 9:55 AM
Hexachlorocyclopentadiene	< 0.64		1	µg/L	50	E525.2	06/17/2008 6:50 PM
Propachlor	< 1.0		1	µg/L	50	E525.2	06/17/2008 6:50 PM

Result(s) reported meet(s) Regulatory Limit(s).
Result(s) flagged with * Exceed Regulatory Limit(s). Limit noted.
D.F. = Dilution Factor

Date Reported : 6/25/2008



H2M LABS, INC.

575 Broad Hollow Road, Melville NY 11747
(631) 694-3040 . FAX: (631) 420-8436 NYSDOH ID# 10478

Brookhaven National Lab.-BNLM
70 Bell Ave.

Upton, NY 11973

Attn To : Bob Lee

Federal ID 5111891

Collected : 6/6/2008 6:43:00 AM Point No : 093-07

Received : 6/6/2008 3:45:00 PM Location : Well #6 Raw

Collected By : CLIENT

Copy : ORIGINAL

CC

LABORATORY RESULTS

Lab No. : 0806776-010A

Client ID. : 25083-010

Sample Information

Type : Potable Water


Origin : Raw Well

Routine

<u>Parameter(s)</u>	<u>Results</u>	<u>Qualifier</u>	<u>D.F.</u>	<u>Units</u>	<u>Limit</u>	<u>Method Number</u>	<u>Analyzed</u>
Hexachlorobenzene	< 0.25		1	µg/L	1	E525.2	06/17/2008 6:50 PM
Simazine	< 0.50		1	µg/L	4	E525.2	06/17/2008 6:50 PM
Atrazine	< 0.50		1	µg/L	3	E525.2	06/17/2008 6:50 PM
Metribuzin	< 0.50		1	µg/L	50	E525.2	06/17/2008 6:50 PM
Alachlor	< 1.0		1	µg/L	2	E525.2	06/17/2008 6:50 PM
Metolachlor	< 1.0		1	µg/L	50	E525.2	06/17/2008 6:50 PM
Butachlor	< 1.0		1	µg/L	50	E525.2	06/17/2008 6:50 PM
bis(2-Ethylhexyl)adipate	< 1.0		1	µg/L	400	E525.2	06/17/2008 6:50 PM
Bis(2-ethylhexyl)phthalate	< 3.0		1	µg/L	6	E525.2	06/17/2008 6:50 PM
Benzo(a)pyrene	< 0.10		1	µg/L	0.2	E525.2	06/17/2008 6:50 PM

Result(s) reported meet(s) Regulatory Limit(s).
Result(s) flagged with * Exceed Regulatory Limit(s). Limit noted.
D.F. = Dilution Factor

Date Reported : 6/25/2008



H2M LABS, INC.

575 Broad Hollow Road, Melville NY 11747
(631)694-3040 .FAX: (631)420-8436 NYSDOH ID# 10478

Brookhaven National Lab.-BNLM
70 Bell Ave.

Upton, NY 11973

Attn To : Bob Lee

Federal ID 5111891

Collected : 6/6/2008 6:35:00 AM Point No : 092-03

Received : 6/6/2008 3:45:00 PM Location : Well #7 Raw

Collected By : CLIENT

Copy : ORIGINAL

CC

LABORATORY RESULTS

Lab No. : 0806776-011A

Client ID. : 25083-011

Sample Information

Type : Potable Water


Origin : Raw Well

Routine

Parameter(s)	Results	Qualifier	D.F.	Units	Limit	Method Number	Analyzed
Lindane	< 0.025		1	µg/L	0.2	E505	06/11/2008 10:43 AM
Lindane	< 0.025		1	µg/L	0.2	E505	06/11/2008 10:43 AM
Heptachlor	< 0.025		1	µg/L	0.4	E505	06/11/2008 10:43 AM
Heptachlor	< 0.025		1	µg/L	0.4	E505	06/11/2008 10:43 AM
Aldrin	< 0.025		1	µg/L	5	E505	06/11/2008 10:43 AM
Aldrin	< 0.025		1	µg/L	5	E505	06/11/2008 10:43 AM
Chlordane	< 0.50		1	µg/L	2	E505	06/11/2008 10:43 AM
Chlordane	< 0.50		1	µg/L	2	E505	06/11/2008 10:43 AM
Heptachlor epoxide	< 0.025		1	µg/L	0.2	E505	06/11/2008 10:43 AM
Heptachlor epoxide	< 0.025		1	µg/L	0.2	E505	06/11/2008 10:43 AM
Dieldrin	< 0.050		1	µg/L	2	E505	06/11/2008 10:43 AM
Dieldrin	< 0.050		1	µg/L	2	E505	06/11/2008 10:43 AM
Endrin	< 0.050		1	µg/L	2	E505	06/11/2008 10:43 AM
Endrin	< 0.050		1	µg/L	2	E505	06/11/2008 10:43 AM
Methoxychlor	< 0.25		1	µg/L	40	E505	06/11/2008 10:43 AM
Methoxychlor	< 0.25		1	µg/L	40	E505	06/11/2008 10:43 AM
Toxaphene	< 2.5		1	µg/L	3	E505	06/11/2008 10:43 AM
Toxaphene	< 2.5		1	µg/L	3	E505	06/11/2008 10:43 AM
Total PCBs	< 0.50		1	µg/L	0.5	E505	06/11/2008 10:43 AM
Total PCBs	< 0.50		1	µg/L	0.5	E505	06/11/2008 10:43 AM
Barium	< 200		1	µg/L	2000	E200.7	06/17/2008 11:25 AM
Beryllium	< 3.0		1	µg/L	4	E200.7	06/17/2008 11:25 AM
Cadmium	< 5.0		1	µg/L	5	E200.7	06/17/2008 11:25 AM
Chromium	< 10		1	µg/L	100	E200.7	06/17/2008 11:25 AM
* Iron	* 2280	*	1	µg/L	300	E200.7	06/17/2008 11:25 AM
Manganese	69.7		1	µg/L	300	E200.7	06/17/2008 11:25 AM
Nickel	< 40.0		1	µg/L		E200.7	06/17/2008 11:25 AM
Silver	< 10		1	µg/L	100	E200.7	06/17/2008 11:25 AM
Sodium	17800		1	µg/L		E200.7	06/17/2008 11:25 AM
Zinc	< 20.0		1	µg/L	5000	E200.7	06/17/2008 11:25 AM
Arsenic	< 3.00		1	ug/l	10	E200.8	06/12/2008 10:00 AM
Lead	< 1.00		1	ug/l	15	E200.8	06/12/2008 10:00 AM
Selenium	< 5.00		1	ug/l	50	E200.8	06/12/2008 10:00 AM
Antimony	< 5.90		1	ug/l	6	E200.8	06/12/2008 10:00 AM
Thallium	< 1.90		1	ug/l	2	E200.8	06/12/2008 10:00 AM
Mercury	< 0.20		1	ug/l	2	E200.8	06/12/2008 10:00 AM
Hexachlorocyclopentadiene	< 0.64		1	µg/L	50	E525.2	06/17/2008 7:22 PM
Propachlor	< 1.0		1	µg/L	50	E525.2	06/17/2008 7:22 PM

Result(s) reported meet(s) Regulatory Limit(s).
Result(s) flagged with * Exceed Regulatory Limit(s). Limit noted.
D.F. = Dilution Factor

Date Reported : 6/25/2008



H2M LABS, INC.

575 Broad Hollow Road, Melville NY 11747
(631) 694-3040 . FAX: (631) 420-8436 NYSDOH ID# 10478

Brookhaven National Lab.-BNLM
70 Bell Ave.
Upton, NY 11973
Attn To : Bob Lee

LABORATORY RESULTS

Lab No. : 0806776-011A

Client ID. : 25083-011

Sample Information


Type : Potable Water
Origin : Raw Well
Routine

Federal ID 5111891
Collected : 6/6/2008 6:35:00 AM Point No : 092-03
Received : 6/6/2008 3:45:00 PM Location : Well #7 Raw
Collected By : CLIENT
Copy : ORIGINAL
CC

<u>Parameter(s)</u>	<u>Results</u>	<u>Qualifier</u>	<u>D.F.</u>	<u>Units</u>	<u>Limit</u>	<u>Method Number</u>	<u>Analyzed</u>
Hexachlorobenzene	< 0.25		1	µg/L	1	E525.2	06/17/2008 7:22 PM
Simazine	< 0.50		1	µg/L	4	E525.2	06/17/2008 7:22 PM
Atrazine	< 0.50		1	µg/L	3	E525.2	06/17/2008 7:22 PM
Metribuzin	< 0.50		1	µg/L	50	E525.2	06/17/2008 7:22 PM
Alachlor	< 1.0		1	µg/L	2	E525.2	06/17/2008 7:22 PM
Metolachlor	< 1.0		1	µg/L	50	E525.2	06/17/2008 7:22 PM
Butachlor	< 1.0		1	µg/L	50	E525.2	06/17/2008 7:22 PM
bis(2-Ethylhexyl)adipate	< 1.0		1	µg/L	400	E525.2	06/17/2008 7:22 PM
Bis(2-ethylhexyl)phthalate	< 3.0		1	µg/L	6	E525.2	06/17/2008 7:22 PM
Benzo(a)pyrene	< 0.10		1	µg/L	0.2	E525.2	06/17/2008 7:22 PM

Result(s) reported meet(s) Regulatory Limit(s).
Result(s) flagged with * Exceed Regulatory Limit(s). Limit noted.
D.F. = Dilution Factor

Date Reported : 6/25/2008



Laboratory Manager

H2M LABS, INC.

575 Broad Hollow Road, Melville NY 11747
(631) 694-3040. FAX: (631) 420-8436 NYSDOH ID# 10478

Brookhaven National Lab.-BNLM
70 Bell Ave.
Upton, NY 11973
Attn To : Bob Lee

LABORATORY RESULTS

Lab No. : 0806776-012A

Client ID. : 25083-012

Sample Information


Type : Potable Water
Origin : Raw Well
Routine

Federal ID : 5111891
Collected : 6/6/2008 7:07:00 AM Point No : 055-09
Received : 6/6/2008 3:45:00 PM Location : Well #10 Raw
Collected By : CLIENT
Copy : ORIGINAL
CC

Parameter(s)	Results	Qualifier	D.F.	Units	Limit	Method Number	Analyzed
Lindane	< 0.025		1	µg/L	0.2	E505	06/11/2008 11:23 AM
Lindane	< 0.025		1	µg/L	0.2	E505	06/11/2008 11:23 AM
Heptachlor	< 0.025		1	µg/L	0.4	E505	06/11/2008 11:23 AM
Heptachlor	< 0.025		1	µg/L	0.4	E505	06/11/2008 11:23 AM
Aldrin	< 0.025		1	µg/L	5	E505	06/11/2008 11:23 AM
Aldrin	< 0.025		1	µg/L	5	E505	06/11/2008 11:23 AM
Chlordane	< 0.50		1	µg/L	2	E505	06/11/2008 11:23 AM
Chlordane	< 0.50		1	µg/L	2	E505	06/11/2008 11:23 AM
Heptachlor epoxide	< 0.025		1	µg/L	0.2	E505	06/11/2008 11:23 AM
Heptachlor epoxide	< 0.025		1	µg/L	0.2	E505	06/11/2008 11:23 AM
Dieldrin	< 0.050		1	µg/L	2	E505	06/11/2008 11:23 AM
Dieldrin	< 0.050		1	µg/L	2	E505	06/11/2008 11:23 AM
Endrin	< 0.050		1	µg/L	2	E505	06/11/2008 11:23 AM
Endrin	< 0.050		1	µg/L	2	E505	06/11/2008 11:23 AM
Methoxychlor	< 0.25		1	µg/L	40	E505	06/11/2008 11:23 AM
Methoxychlor	< 0.25		1	µg/L	40	E505	06/11/2008 11:23 AM
Toxaphene	< 2.5		1	µg/L	3	E505	06/11/2008 11:23 AM
Toxaphene	< 2.5		1	µg/L	3	E505	06/11/2008 11:23 AM
Total PCBs	< 0.50		1	µg/L	0.5	E505	06/11/2008 11:23 AM
Total PCBs	< 0.50		1	µg/L	0.5	E505	06/11/2008 11:23 AM
Barium	< 200		1	µg/L	2000	E200.7	06/17/2008 11:32 AM
Beryllium	< 3.0		1	µg/L	4	E200.7	06/17/2008 11:32 AM
Cadmium	< 5.0		1	µg/L	5	E200.7	06/17/2008 11:32 AM
Chromium	< 10		1	µg/L	100	E200.7	06/17/2008 11:32 AM
Iron	29.4		1	µg/L	300	E200.7	06/17/2008 11:32 AM
Manganese	< 10		1	µg/L	300	E200.7	06/17/2008 11:32 AM
Nickel	< 40.0		1	µg/L		E200.7	06/17/2008 11:32 AM
Silver	< 10		1	µg/L	100	E200.7	06/17/2008 11:32 AM
Sodium	17000		1	µg/L		E200.7	06/17/2008 11:32 AM
Zinc	< 20.0		1	µg/L	5000	E200.7	06/17/2008 11:32 AM
Arsenic	< 3.00		1	ug/l	10	E200.8	06/12/2008 10:05 AM
Lead	< 1.00		1	ug/l	15	E200.8	06/12/2008 10:05 AM
Selenium	< 5.00		1	ug/l	50	E200.8	06/12/2008 10:05 AM
Antimony	< 5.90		1	ug/l	6	E200.8	06/12/2008 10:05 AM
Thallium	< 1.90		1	ug/l	2	E200.8	06/12/2008 10:05 AM
Mercury	< 0.20		1	ug/l	2	E200.8	06/12/2008 10:05 AM
Hexachlorocyclopentadiene	< 0.64		1	µg/L	50	E525.2	06/17/2008 7:54 PM
Propachlor	< 1.0		1	µg/L	50	E525.2	06/17/2008 7:54 PM

Result(s) reported meet(s) Regulatory Limit(s).
Result(s) flagged with * Exceed Regulatory Limit(s). Limit noted.
D.F. = Dilution Factor

Date Reported : 6/25/2008



H2M LABS, INC.

575 Broad Hollow Road, Melville NY 11747
(631) 694-3040 . FAX: (631) 420-8436 NYSDOH ID# 10478

Brookhaven National Lab.-BNLM
70 Bell Ave.
Upton, NY 11973
Attn To : Bob Lee

LABORATORY RESULTS

Lab No. : 0806776-012A
Client ID. : 25083-012

Sample Information


Type : Potable Water
Origin : Raw Well
Routine

Federal ID : 5111891
Collected : 6/6/2008 7:07:00 AM Point No : 055-09
Received : 6/6/2008 3:45:00 PM Location : Well #10 Raw
Collected By : CLIENT
Copy : ORIGINAL
CC

<u>Parameter(s)</u>	<u>Results</u>	<u>Qualifier</u>	<u>D.F.</u>	<u>Units</u>	<u>Limit</u>	<u>Method Number</u>	<u>Analyzed</u>
Hexachlorobenzene	< 0.25		1	µg/L	1	E525.2	06/17/2008 7:54 PM
Simazine	< 0.50		1	µg/L	4	E525.2	06/17/2008 7:54 PM
Atrazine	< 0.50		1	µg/L	3	E525.2	06/17/2008 7:54 PM
Metribuzin	< 0.50		1	µg/L	50	E525.2	06/17/2008 7:54 PM
Alachlor	< 1.0		1	µg/L	2	E525.2	06/17/2008 7:54 PM
Metolachlor	< 1.0		1	µg/L	50	E525.2	06/17/2008 7:54 PM
Butachlor	< 1.0		1	µg/L	50	E525.2	06/17/2008 7:54 PM
bis(2-Ethylhexyl)adipate	< 1.0		1	µg/L	400	E525.2	06/17/2008 7:54 PM
Bis(2-ethylhexyl)phthalate	< 3.0		1	µg/L	6	E525.2	06/17/2008 7:54 PM
Benzo(a)pyrene	< 0.10		1	µg/L	0.2	E525.2	06/17/2008 7:54 PM

Result(s) reported meet(s) Regulatory Limit(s).
Result(s) flagged with * Exceed Regulatory Limit(s). Limit noted.
D.F. = Dilution Factor

Date Reported : 6/25/2008



Laboratory Manager

H2M LABS, INC.

575 Broad Hollow Road, Melville NY 11747
 (631) 694-3040. FAX: (631) 420-8436 NYSDOH ID# 10478

Brookhaven National Lab.-BNLM
 70 Bell Ave.
 Upton, NY 11973
 Attn To : Bob Lee

LABORATORY RESULTS

Lab No. : 0806776-009A
 Client ID. : 25083-009

Sample Information


Type : Potable Water
 Origin : Raw Well
 Routine

Federal ID : 5111891
 Collected : 6/6/2008 7:13:00 AM Point No : 056-19
 Received : 6/6/2008 3:45:00 PM Location : Well #11 Raw
 Collected By : CLIENT
 Copy : ORIGINAL
 CC

Parameter(s)	Results	Qualifier	D.F.	Units	Limit	Method Number	Analyzed
Lindane	< 0.025		1	µg/L	0.2	E505	06/11/2008 9:22 AM
Lindane	< 0.025		1	µg/L	0.2	E505	06/11/2008 9:22 AM
Heptachlor	< 0.025		1	µg/L	0.4	E505	06/11/2008 9:22 AM
Heptachlor	< 0.025		1	µg/L	0.4	E505	06/11/2008 9:22 AM
Aldrin	< 0.025		1	µg/L	5	E505	06/11/2008 9:22 AM
Aldrin	< 0.025		1	µg/L	5	E505	06/11/2008 9:22 AM
Chlordane	< 0.50		1	µg/L	2	E505	06/11/2008 9:22 AM
Chlordane	< 0.50		1	µg/L	2	E505	06/11/2008 9:22 AM
Heptachlor epoxide	< 0.025		1	µg/L	0.2	E505	06/11/2008 9:22 AM
Heptachlor epoxide	< 0.025		1	µg/L	0.2	E505	06/11/2008 9:22 AM
Dieldrin	< 0.050		1	µg/L	2	E505	06/11/2008 9:22 AM
Dieldrin	< 0.050		1	µg/L	2	E505	06/11/2008 9:22 AM
Endrin	< 0.050		1	µg/L	2	E505	06/11/2008 9:22 AM
Endrin	< 0.050		1	µg/L	2	E505	06/11/2008 9:22 AM
Methoxychlor	< 0.25		1	µg/L	40	E505	06/11/2008 9:22 AM
Methoxychlor	< 0.25		1	µg/L	40	E505	06/11/2008 9:22 AM
Toxaphene	< 2.5		1	µg/L	3	E505	06/11/2008 9:22 AM
Toxaphene	< 2.5		1	µg/L	3	E505	06/11/2008 9:22 AM
Total PCBs	< 0.50		1	µg/L	0.5	E505	06/11/2008 9:22 AM
Total PCBs	< 0.50		1	µg/L	0.5	E505	06/11/2008 9:22 AM
Barium	< 200		1	µg/L	2000	E200.7	06/17/2008 11:10 AM
Beryllium	< 3.0		1	µg/L	4	E200.7	06/17/2008 11:10 AM
Cadmium	< 5.0		1	µg/L	5	E200.7	06/17/2008 11:10 AM
Chromium	< 10		1	µg/L	100	E200.7	06/17/2008 11:10 AM
Iron	< 20.0		1	µg/L	300	E200.7	06/17/2008 11:10 AM
Manganese	< 10		1	µg/L	300	E200.7	06/17/2008 11:10 AM
Nickel	< 40.0		1	µg/L		E200.7	06/17/2008 11:10 AM
Silver	< 10		1	µg/L	100	E200.7	06/17/2008 11:10 AM
Sodium	25500		1	µg/L		E200.7	06/17/2008 11:10 AM
Zinc	< 20.0		1	µg/L	5000	E200.7	06/17/2008 11:10 AM
Arsenic	< 3.00		1	ug/l	10	E200.8	06/12/2008 9:50 AM
Lead	< 1.00		1	ug/l	15	E200.8	06/12/2008 9:50 AM
Selenium	< 5.00		1	ug/l	50	E200.8	06/12/2008 9:50 AM
Antimony	< 5.90		1	ug/l	6	E200.8	06/12/2008 9:50 AM
Thallium	< 1.90		1	ug/l	2	E200.8	06/12/2008 9:50 AM
Mercury	< 0.20		1	ug/l	2	E200.8	06/12/2008 9:50 AM
Hexachlorocyclopentadiene	< 0.64		1	µg/L	50	E525.2	06/17/2008 6:19 PM
Propachlor	< 1.0		1	µg/L	50	E525.2	06/17/2008 6:19 PM

Result(s) reported meet(s) Regulatory Limit(s).
 Result(s) flagged with * Exceed Regulatory Limit(s). Limit noted.
 D.F. = Dilution Factor

Date Reported : 6/25/2008



H2M LABS, INC.

575 Broad Hollow Road, Melville NY 11747
(631)694-3040. FAX: (631)420-8436 NYSDOH ID#10478

Brookhaven National Lab.-BNLM
70 Bell Ave.
Upton, NY 11973
Attn To : Bob Lee

LABORATORY RESULTS

Lab No. : 0806776-009A

Client ID. : 25083-009

Sample Information


Type : Potable Water
Origin : Raw Well
Routine

Federal ID : 5111891
Collected : 6/6/2008 7:13:00 AM Point No : 056-19
Received : 6/6/2008 3:45:00 PM Location : Well #11 Raw
Collected By : CLIENT
Copy : ORIGINAL
CC

Parameter(s)	Results	Qualifier	D.F.	Units	Limit	Method Number	Analyzed
Hexachlorobenzene	< 0.25		1	µg/L	1	E525.2	06/17/2008 6:19 PM
Simazine	< 0.50		1	µg/L	4	E525.2	06/17/2008 6:19 PM
Atrazine	< 0.50		1	µg/L	3	E525.2	06/17/2008 6:19 PM
Metribuzin	< 0.50		1	µg/L	50	E525.2	06/17/2008 6:19 PM
Alachlor	< 1.0		1	µg/L	2	E525.2	06/17/2008 6:19 PM
Metolachlor	< 1.0		1	µg/L	50	E525.2	06/17/2008 6:19 PM
Butachlor	< 1.0		1	µg/L	50	E525.2	06/17/2008 6:19 PM
bis(2-Ethylhexyl)adipate	< 1.0		1	µg/L	400	E525.2	06/17/2008 6:19 PM
Bis(2-ethylhexyl)phthalate	< 3.0		1	µg/L	6	E525.2	06/17/2008 6:19 PM
Benzo(a)pyrene	< 0.10		1	µg/L	0.2	E525.2	06/17/2008 6:19 PM

Result(s) reported meet(s) Regulatory Limit(s).
Result(s) flagged with * Exceed Regulatory Limit(s). Limit noted.
D.F. = Dilution Factor

Date Reported : 6/25/2008



Laboratory Manager

H2M LABS, INC.

575 Broad Hollow Road, Melville NY 11747
 (631)694-3040. FAX: (631)420-8436 NYSDOHID#10478

Brookhaven National Lab.-BNLM
 70 Bell Ave.
 Upton, NY 11973
 Attn To : Bob Lee

LABORATORY RESULTS

Lab No. : 0806776-008A
 Client ID. : 25083-008


Sample Information
 Type : Potable Water
 Origin : Raw Well
 Routine

Federal ID : 5111891
 Collected : 6/6/2008 7:20:00 AM Point No : 056-20
 Received : 6/6/2008 3:45:00 PM Location : Well #12 Raw
 Collected By : CLIENT
 Copy : ORIGINAL
 CC

Parameter(s)	Results	Qualifier	D.F.	Units	Limit	Method Number	Analyzed
Lindane	< 0.025		1	µg/L	0.2	E505	06/11/2008 8:42 AM
Lindane	< 0.025		1	µg/L	0.2	E505	06/11/2008 8:42 AM
Heptachlor	< 0.025		1	µg/L	0.4	E505	06/11/2008 8:42 AM
Heptachlor	< 0.025		1	µg/L	0.4	E505	06/11/2008 8:42 AM
Aldrin	< 0.025		1	µg/L	5	E505	06/11/2008 8:42 AM
Aldrin	< 0.025		1	µg/L	5	E505	06/11/2008 8:42 AM
Chlordane	< 0.50		1	µg/L	2	E505	06/11/2008 8:42 AM
Chlordane	< 0.50		1	µg/L	2	E505	06/11/2008 8:42 AM
Heptachlor epoxide	< 0.025		1	µg/L	0.2	E505	06/11/2008 8:42 AM
Heptachlor epoxide	< 0.025		1	µg/L	0.2	E505	06/11/2008 8:42 AM
Dieldrin	< 0.050		1	µg/L	2	E505	06/11/2008 8:42 AM
Dieldrin	< 0.050		1	µg/L	2	E505	06/11/2008 8:42 AM
Endrin	< 0.050		1	µg/L	2	E505	06/11/2008 8:42 AM
Endrin	< 0.050		1	µg/L	2	E505	06/11/2008 8:42 AM
Methoxychlor	< 0.25		1	µg/L	40	E505	06/11/2008 8:42 AM
Methoxychlor	< 0.25		1	µg/L	40	E505	06/11/2008 8:42 AM
Toxaphene	< 2.5		1	µg/L	3	E505	06/11/2008 8:42 AM
Toxaphene	< 2.5		1	µg/L	3	E505	06/11/2008 8:42 AM
Total PCBs	< 0.50		1	µg/L	0.5	E505	06/11/2008 8:42 AM
Total PCBs	< 0.50		1	µg/L	0.5	E505	06/11/2008 8:42 AM
Barium	< 200		1	µg/L	2000	E200.7	06/17/2008 10:41 AM
Beryllium	< 3.0		1	µg/L	4	E200.7	06/17/2008 10:41 AM
Cadmium	< 5.0		1	µg/L	5	E200.7	06/17/2008 10:41 AM
Chromium	< 10		1	µg/L	100	E200.7	06/17/2008 10:41 AM
Iron	86.4		1	µg/L	300	E200.7	06/17/2008 10:41 AM
Manganese	< 10		1	µg/L	300	E200.7	06/17/2008 10:41 AM
Nickel	< 40.0		1	µg/L		E200.7	06/17/2008 10:41 AM
Silver	< 10		1	µg/L	100	E200.7	06/17/2008 10:41 AM
Sodium	18700		1	µg/L		E200.7	06/17/2008 10:41 AM
Zinc	< 20.0		1	µg/L	5000	E200.7	06/17/2008 10:41 AM
Arsenic	< 3.00		1	ug/l	10	E200.8	06/12/2008 9:30 AM
Lead	< 1.00		1	ug/l	15	E200.8	06/12/2008 9:30 AM
Selenium	< 5.00		1	ug/l	50	E200.8	06/12/2008 9:30 AM
Antimony	< 5.90		1	ug/l	6	E200.8	06/12/2008 9:30 AM
Thallium	< 1.90		1	ug/l	2	E200.8	06/12/2008 9:30 AM
Mercury	< 0.20		1	ug/l	2	E200.8	06/12/2008 9:30 AM
Hexachlorocyclopentadiene	< 0.64		1	µg/L	50	E525.2	06/17/2008 5:47 PM
Propachlor	< 1.0		1	µg/L	50	E525.2	06/17/2008 5:47 PM

Result(s) reported meet(s) Regulatory Limit(s).
 Result(s) flagged with * Exceed Regulatory Limit(s). Limit noted.
 D.F. = Dilution Factor

Date Reported : 6/25/2008



H2M LABS, INC.

575 Broad Hollow Road, Melville NY 11747
(631) 694-3040 . FAX: (631) 420-8436 NYSDOH ID# 10478

Brookhaven National Lab.-BNLM
70 Bell Ave.

Upton, NY 11973

Attn To : Bob Lee

Federal ID 5111891

Collected : 6/6/2008 7:20:00 AM Point No : 056-20

Received : 6/6/2008 3:45:00 PM Location : Well #12 Raw

Collected By : CLIENT

Copy : ORIGINAL

CC

LABORATORY RESULTS

Lab No. : 0806776-008A

Client ID. : 25083-008

Sample Information

Type : Potable Water

Origin : Raw Well

Routine


Parameter(s)	Results	Qualifier	D.F.	Units	Limit	Method Number	Analyzed
Hexachlorobenzene	< 0.25		1	µg/L	1	E525.2	06/17/2008 5:47 PM
Simazine	< 0.50		1	µg/L	4	E525.2	06/17/2008 5:47 PM
Atrazine	< 0.50		1	µg/L	3	E525.2	06/17/2008 5:47 PM
Metribuzin	< 0.50		1	µg/L	50	E525.2	06/17/2008 5:47 PM
Alachlor	< 1.0		1	µg/L	2	E525.2	06/17/2008 5:47 PM
Metolachlor	< 1.0		1	µg/L	50	E525.2	06/17/2008 5:47 PM
Butachlor	< 1.0		1	µg/L	50	E525.2	06/17/2008 5:47 PM
bis(2-Ethylhexyl)adipate	< 1.0		1	µg/L	400	E525.2	06/17/2008 5:47 PM
Bis(2-ethylhexyl)phthalate	< 3.0		1	µg/L	6	E525.2	06/17/2008 5:47 PM
Benzo(a)pyrene	< 0.10		1	µg/L	0.2	E525.2	06/17/2008 5:47 PM

Result(s) reported meet(s) Regulatory Limit(s).

Result(s) flagged with * Exceed Regulatory Limit(s). Limit noted.

D.F. = Dilution Factor

Date Reported : 6/25/2008



Laboratory Manager



81 Cornell Avenue, Bldg. 120
Upton, NY 11973

BROOKHAVEN
NATIONAL LABORATORY

FACSIMILE TRANSMITTAL SHEET

Fax #: 631-344-6079

Date:	July 10, 2008
To:	Ms. Kathleen Newcomer
Company:	Suffolk County Department of Health Services
Fax #:	631-852-5787
From:	Jennifer Higbie
Phone Ext.:	631-344-5919 (or email: Higbie@bnl.gov)

Number of Pages (including cover sheet):	
---	--

Comments: Attached is a letter from George Goode with the Subject: Monthly Water Treatment Plant reports for June 2008. Included with the letter are Attachment I: BNL Potable Water Supply Operational Data for June and Attachment III: May 2008 Stage 1 Disinfectants & Disinfection Byproduct Rule Monitoring Data and Bacteriological Analyses for the BNL Distribution System

 *** TX REPORT ***

TRANSMISSION OK

TX/RX NO 1213
 CONNECTION TEL 98525787
 CONNECTION ID
 ST. TIME 07/10 09:03
 USAGE T 09'26
 PGS. SENT 25
 RESULT OK



81 Cornell Avenue, Bldg. 120
 Upton, NY 11973

BROOKHAVEN
 NATIONAL LABORATORY

FACSIMILE TRANSMITTAL SHEET

Fax #: 631-344-6079

Date:	July 10, 2008
To:	Ms. Kathleen Newcomer
Company:	Suffolk County Department of Health Services
Fax #:	631-852-5787
From:	Jennifer Higbie
Phone Ext.:	631-344-5919 (or email: Higbie@bnl.gov)

Number of Pages (including cover sheet):	
--	--

<p>Comments:</p> <p>Attached is a letter from George Goode with the Subject: Monthly Water Treatment Plant reports for June 2008.</p> <p>Included with the letter are</p> <p>Attachment I: BNL Potable Water Supply Operational Data for June</p> <p>and</p> <p>Attachment III: June 2008 Stage 1 Disinfectants & Disinfection Byproduct Rule</p>
--