

THE COST OF CARBON CAPTURE

Jeremy David and Howard Herzog

Massachusetts Institute of Technology (MIT), Cambridge, MA, USA

ABSTRACT

We have conducted a detailed analysis of costs associated with today's technology for CO₂ separation and capture at three types of power plants: integrated coal gasification combined cycles (IGCC), pulverized coal-fired simple cycles (PC), and natural gas-fired combined cycles (NGCC). The analysis was based on studies from the literature that analyzed the economics of capturing CO₂ emitted at power plants. In this paper, we present a composite cost model and perform a sensitivity analysis to identify the cost-drivers for capture. We conclude that with new developments, CO₂ capture and sequestration can become a cost-effective mitigation pathway.

INTRODUCTION

Fossil fuels currently supply over 85% of the world's energy needs and will remain in abundant supply well into the 21st century. They have been a major contributor to the high standard of living enjoyed by the industrialized world. However, their future is clouded because of the environmental and economic threat posed by possible climate change, commonly referred to as the "greenhouse effect". The major greenhouse gas is carbon dioxide (CO₂) and the major source of anthropogenic CO₂ is the combustion of fossil fuels. If we can develop technology to capture and sequester the fossil fuel CO₂ in a cost-effective and environmentally sound manner, we will be able to enjoy the benefits of fossil fuel use throughout the next century.

We have conducted a comparison of published studies from the past several years that analyzed the economics of capturing CO₂ at Integrated coal Gasification Combined Cycle (IGCC) power plants (six studies), Pulverized Coal (PC) power plants (four studies), and Natural Gas Combined Cycle (NGCC) power plants (four studies). MEA scrubbing of flue gas was used to capture the CO₂ in the PC and NGCC plants, but IGCC plants allow the use of more energy efficient scrubbing processes involving physical absorption to capture CO₂ from the high pressure synthesis gas. All studies were made using commercially available technology and include the cost of compressing the captured CO₂ to about 100 atm for pipeline transportation. The results do not include cost of CO₂ transportation and injection, which will add about \$10/tonne of CO₂ avoided. Initial results were presented at GHGT-4 (Herzog, 1999), while detailed results of this analysis are presented in David (2000).

COMPOSITE COST MODEL OF CO₂ CAPTURE

Based on our analysis of the literature studies, we developed a composite cost model for CO₂ capture. The cost model developed uses six independent inputs, which were extracted from the literature studies we analyzed. Three first inputs characterize the reference (no capture) plant:

- Capital cost, in \$/kW;
- Cost of electricity due to operation and maintenance, in mills/kWh;
- Heat rate, in Btu/kWh, defined on the lower heating value (LHV) basis.

We correlated the quantity of CO₂ emitted (E), in kg/kWh, as a function of heat rate for a given type of power plant (IGCC, PC or NGCC).

The second three inputs characterize the capture plant:

- Incremental capital cost, in \$/kg of CO₂ processed per hour;
- Incremental cost of electricity due to operation and maintenance, in mills/kg of CO₂ processed;
- Energy requirements of the capture process, in kWh/kg of CO₂ processed.

The capture efficiency is usually about 90% in the studies reviewed. To compare the different types of capture plants on a similar basis, the capture efficiency needs to be kept constant. Consequently, we set the capture efficiency at a constant value of 90%.

The symmetry of the cost model inputs is shown in Table 1. The generation costs are normalized by the reference power plant output, while the capture costs are normalized by the quantity of CO₂ processed (which is directly related to the quantity and type of fuel burnt at the plant). These six parameters can be reasonably viewed as independent of each other. The inputs from the literature studies we analyzed are averaged for each type of power plant to obtain the composite cost model inputs shown in Table 2.

Table 1: Cost Model Inputs

	Reference Plant	Capture Plant
Capital Costs	\$/kW	\$/kg of CO ₂ processed per hour)
O&M Costs	mills/kWh	mills/kg of CO ₂ processed
Energy Requirements	Btu/kWh	kWh/kg of CO ₂ processed

It can be seen that NGCC power plants have the highest incremental capital cost and the highest energy requirements for the capture (0.354 kWh/kg of CO₂ processed), due to the low content of CO₂ in the flue gas (about 3%). Post-combustion decarbonization at PC plants is somewhat less energy intensive than at NGCC plants, 0.317 kWh/kg of CO₂ processed, because of the higher content of CO₂ in the flue gas (about 13%). Finally, the carbon dioxide is in a concentrated flow under a fairly high pressure at IGCC plants, so these plants have the lowest energy requirements (0.194 kWh/kg of CO₂ processed).

Table 2 reports the costs obtained for each type of power generation. We found that carbon dioxide capture increases the busbar electricity cost (COE) from 5.0 to 6.7 ¢/kWh at IGCC plants, from 4.4 to 7.7 ¢/kWh at PC plants, and, finally, from 3.3 to 4.9 ¢/kWh at NGCC plants.

Today, reference PC plants are slightly less expensive than reference IGCC plants. However, IGCC plants will become more economical than PC plants if carbon sequestration becomes necessary. Natural gas is always more competitive than coal for both reference and capture plants, assuming today's fuel prices remain constant. If gas prices rise relative to coal in the future, IGCC capture plants could then compete with NGCC capture plants.

Table 2: Cost Model for Capture Plants, in 2000 and 2012

Cycle	IGCC	IGCC	PC	PC	NGCC	NGCC
Data Description	2000	2012	2000	2012	2000	2012
Input						
Capital Cost, \$/kW	1401	1145	1150	1095	542	525
O&M, mills/kWh	7.9	6.1	7.4	6.1	2.5	2.4
Heat Rate (LHV), Btu/kWh	8081	7137	8277	8042	6201	5677
Incremental Capital Cost, \$(/kg/h)	305	275	529	476	921	829
Incremental O&M, mills/kg	2.65	2.39	5.56	5.00	5.20	4.68
Energy Requirements, kWh/kg	0.194	0.135	0.317	0.196	0.354	0.297
Basis						
Yearly Operating Hours, hrs/yr	6570	6570	6570	6570	6570	6570
Capital Charge Rate, %/yr	15	15	15	15	15	15
Fuel Cost (LHV), \$/MMBtu	1.24	1.24	1.24	1.24	2.93	2.93
Capture Efficiency, %	90	90	90	90	90	90
Reference Plant						
CO ₂ Emitted, kg/kWh	0.752	0.664	0.789	0.766	0.368	0.337
coe: CAPITAL, mills/kWh	32.0	26.1	26.3	25.0	12.4	12.0
coe: FUEL, mills/kWh	10.0	8.8	10.3	10.0	18.2	16.6
coe: O&M, mills/kWh	7.9	6.1	7.4	6.1	2.5	2.4
Cost of Electricity, ¢/kWh	4.99	4.10	4.39	4.10	3.30	3.10
Thermal Efficiency (LHV), %	42.2	47.8	41.2	42.4	55.0	60.1
Capture Plant						
Relative Power Output, %	85.4	91.0	75.0	85.0	87.0	90.0
Heat Rate (LHV), Btu/kWh	9462	7843	11037	9461	7131	6308
Capital Cost, \$/kW	1909	1459	2090	1718	1013	894
CO ₂ Emitted, kg/kWh	0.088	0.073	0.105	0.090	0.042	0.037
coe: CAPITAL, mills/kWh	43.6	33.3	47.7	39.2	23.1	20.4
coe: FUEL, mills/kWh	11.7	9.7	13.7	11.7	20.9	18.5
coe: O&M, mills/kWh	11.6	8.4	15.7	11.6	5.1	4.4
Cost of Electricity, ¢/kWh	6.69	5.14	7.71	6.26	4.91	4.33
Thermal Efficiency (LHV), %	36.1	43.5	30.9	36.1	47.8	54.1
Comparison						
Incremental coe, ¢/kWh	1.70	1.04	3.32	2.16	1.61	1.23
Energy Penalty, %	14.6	9.0	25.0	15.0	13.0	10.0
Mitigation Cost, Capture vs. Ref., \$/tonne of CO ₂ avoided	26	18	49	32	49	41

The mitigation cost (MC) in \$/tonne CO₂ avoided is given by the following equation:

$$MC = \frac{COE_{cap} - COE_{ref}}{E_{ref} - E_{cap}} \quad (1)$$

The mitigation cost can be calculated by comparing a capture plant to any reference plant (e.g., capture IGCC vs. reference IGCC, PC or NGCC). Fig. 1 plots the cost of electricity vs. CO₂ emissions of the three reference plants and of an IGCC capture plant. The mitigation cost, which is simply the slope of the connecting lines shown on Fig. 1, varies depending on the reference plant chosen for the base case: IGCC (\$26 per tonne of CO₂ avoided), PC (\$33 per tonne of CO₂ avoided), and NGCC (\$121 per tonne of CO₂ avoided). Furthermore, the y-intercept of each line gives the cost of electricity that a zero emission technology must beat to be competitive with the IGCC sequestration option (7.76 cents per kWh based on a NGCC reference plant). It can be argued that NGCC plants should be the basis because they are the most popular plants being built today. This yields mitigation costs of \$121 per tonne of CO₂ avoided for a capture IGCC plant, \$168 per tonne of CO₂ avoided for a capture PC plant and \$49 per tonne of CO₂ avoided for a capture NGCC plant.

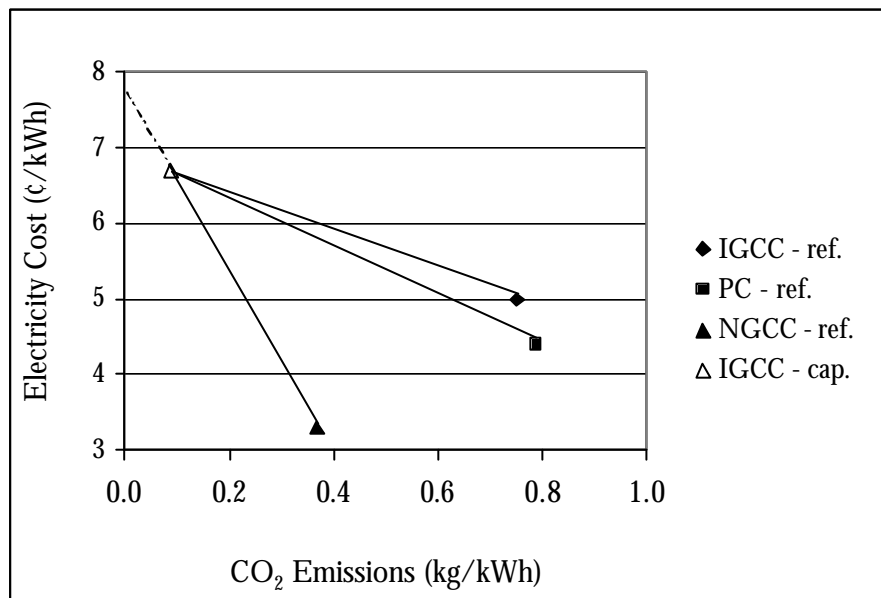


Figure 1: Calculating Mitigation Costs

IDENTIFICATION OF COST-DRIVERS AND FUTURE ECONOMICS

The six inputs of the cost model (see Table 2, year 2000 plants) are treated as independent variables. A sensitivity analysis (i.e., the inputs are decreased by 10% one by one for each type of power plant) is performed to identify the key inputs affecting the economics of the capture. Figures 2 and 3 show the change in incremental cost of electricity and mitigation cost at IGCC, PC, and NGCC power plants for a 10% decrease in each input. Note that a 10% decrease in heat rate is equivalent to an 11.1% increase in efficiency. Observations that can be drawn from Figs. 2 and 3 include:

- The key cost drivers are heat rate, energy required for capture, and capital costs of capture.
- Improving heat rates is extremely important for improving the economics of carbon sequestration. This supports a mitigation strategy that focuses on improved efficiency in the near-term, with sequestration becoming more important in the longer-term.

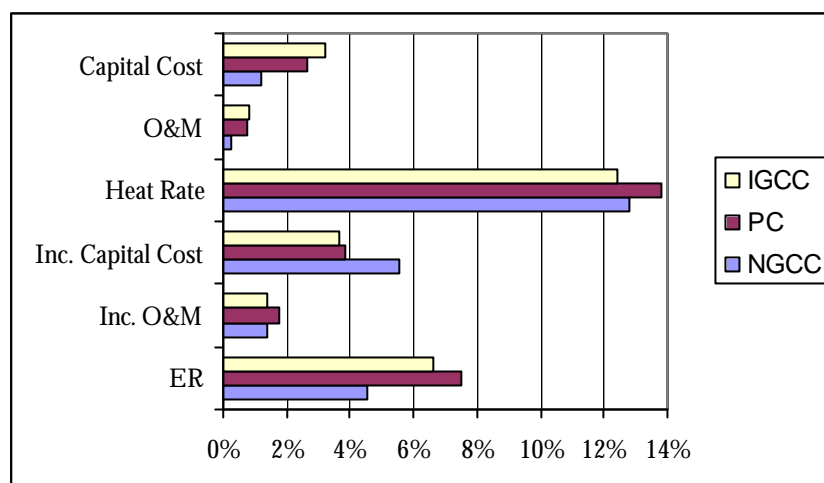


Figure 2: Incremental cost of electricity sensitivity to the cost model inputs. Decrease in incremental cost of electricity for a 10% decrease in each of the six inputs.

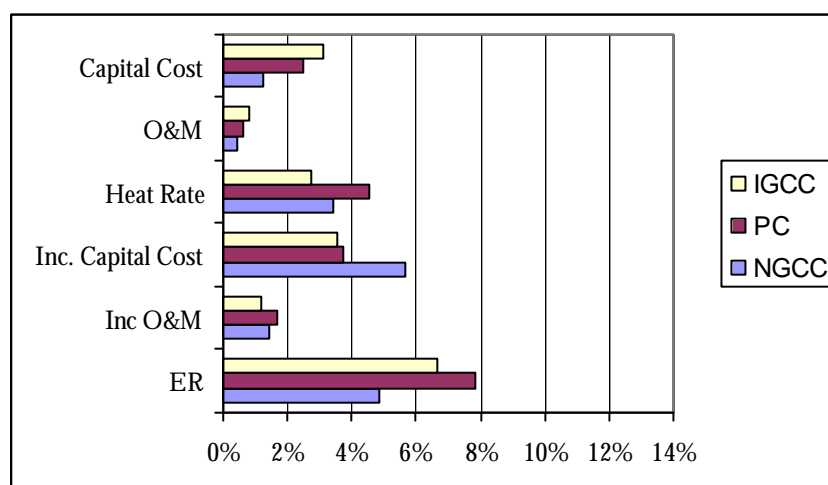


Figure 3: Mitigation cost sensitivity to the cost model inputs. Decrease in mitigation cost for a decrease in each of the six inputs..

FUTURE ECONOMICS

Technological improvements in power generation and capture technology can lower the capture costs. For instance, capital investment can be lowered and efficiency increased at the reference plant. Moreover, it is likely that improved solvents and system components will reduce the capital and energy costs for synthesis gas or flue gas treatment to separate and capture CO₂.

The capture costs in 2012 can be predicted by using the cost model. The 2012 capital costs, costs of operation and maintenance, and heat rates are taken from CURC (1998). Reductions in capital cost and gains in heat rate are significant at IGCC plants (above 10%), but limited at PC and NGCC plants (under 10%), which are more mature. The energy requirements are obtained by using the energy penalties given by Herzog and Drake (1993) at IGCC power plants, and by Mimura *et al.* (1997) at PC and NGCC power plants. The highest reductions in energy requirements for the capture processes are predicted to be at IGCC and PC plants (above 30%). Finally, it is assumed that the incremental capital cost, and the incremental cost of electricity due to operation and maintenance will be lowered by 10% from their 2000 level.

Table 2 gathers the economic performance of CO₂ capture at IGCC, PC and NGCC power plants in 2012. Although the capture costs are expected to decrease more at IGCC and PC plants than at NGCC plants, the overall economics are still more favorable at NGCC plants. New technologies like coal gasification show the most long-term promise, with incremental costs for CO₂ sequestration at IGCC power plants being potentially reduced to about 1¢/kWh in the next decade.

CONCLUSION

Based on the studies analyzed, there is a consensus that using today's capture technology would add 1.5-2¢/kWh to the busbar cost of electricity for an IGCC or NGCC power plant. For a PC plant, the incremental cost of electricity would be over 3¢/kWh. The strongest opportunities for lowering the capture costs in the future were identified as gains in heat rates and reductions in the amount of energy required by the separation. New technologies like coal gasification show the most long-term promise, with incremental costs for CO₂ sequestration at IGCC power plants being potentially reduced to about 1¢/kWh in the next decade. To put the costs presented here in context, further analysis with economic models is required (see Biggs *et al.*, 2000).

Opportunities for future cost reductions will include the investigation of innovative technologies, including new types of power plants and power cycles. Moreover, system-level analyses should be performed to minimize not only capture costs, but also the sequestration costs associated with transportation and injection.

REFERENCES

CURC (Coal Utilization Research Council), *Incentives and Research & Development for Early Commercial Applications of Clean Coal Technology* (November 1998).

Biggs S, H Herzog, H Jacoby and J Reilly, "Economic Modeling of CO₂ Capture and Sequestration," these proceedings (2000).

David J, "Economic Evaluation of Leading Technology Options for Sequestration of Carbon Dioxide," M.S. Thesis, Technology and Policy Program, MIT, Cambridge, MA (2000). Available at: <<http://web.mit.edu/sequestration/JeremyDavid.pdf>>

Herzog H and E Drake, "Long-Term Advanced CO₂ Capture Options," Cheltenham, U.K.: IEA/93/0E6; IEA Greenhouse Gas R&D Programme (1993).

Herzog H, "The Economics of CO₂ Capture," P Reimer, B Eliasson, A Wokaum, eds., *Greenhouse Gas Control Technologies*, Oxford: Elsevier Science Ltd., pp. 101-106 (1999).

Mimura T, H Simayoshi, T Suda, M Iijima and S Mituoka, "Development of Energy Saving Technology for Flue Gas Carbon Dioxide Recovery by Chemical Absorption Method and Steam System in Power Plant," *Energy Convers. Mgmt.* Vol. 38, Suppl., pp. S57-S62 (1997).

ACKNOWLEDGEMENTS

This work was conducted with support from the U.S. Department of Energy under award number DE-FG02-99ER62748. We gratefully acknowledge this support, as well as the encouragement of the program managers, John Houghton (BER program, Office of Science) and Bob Kane (Office of Fossil Energy).