


# Wells Sampled by the TWDB for Water Quality Analysis in 2005 (593 samples)

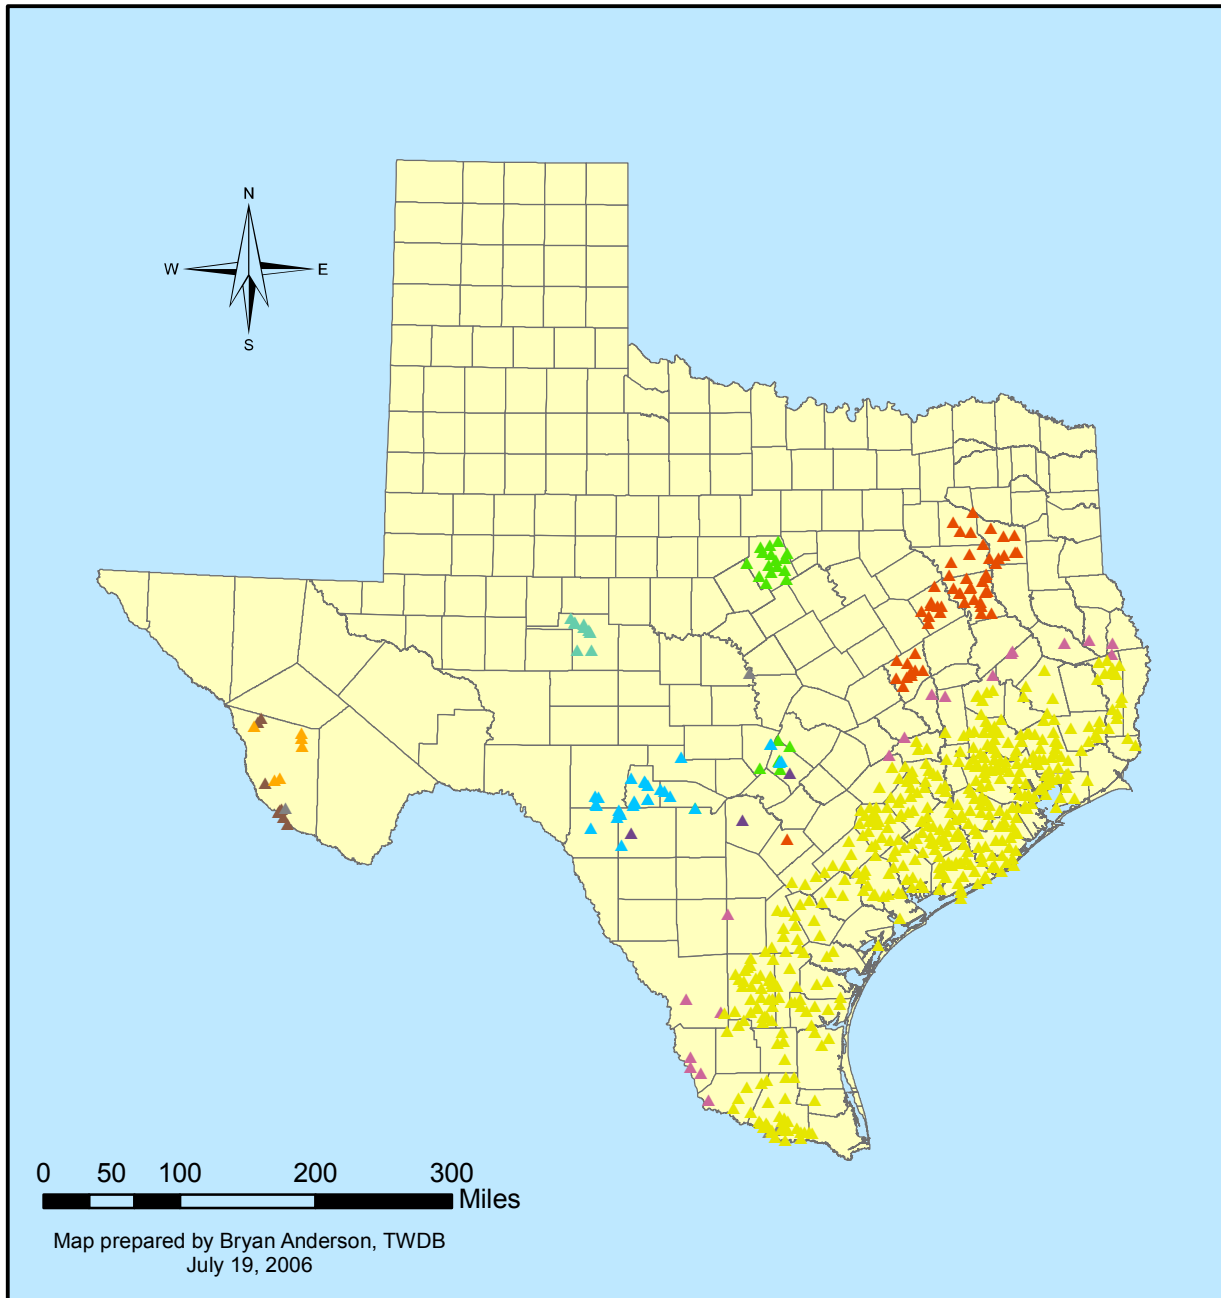

## Aquifer

(number of wells sampled)

- ▲ Carrizo-Wilcox (54)
- ▲ Edwards (BFZ) (3)
- ▲ Edwards-Trinity (Plateau) (28)
- ▲ Gulf Coast (440)
- ▲ Igneous (6)
- ▲ Lipan (9)
- ▲ Other (4)
- ▲ Trinity (23)
- ▲ West Texas Bolsons (8)
- ▲ Yegua-Jackson (18)

## Maximum Contaminant Levels (MCLs)

Of all samples collected by the TWDB in 2005, 7.7 percent exceeded the MCL for gross alpha radiation, 6.0 percent for lead, 2.0 percent for nitrate-nitrite, 1.8 percent for arsenic, and less than 1 percent each for fluoride, gross beta radiation, and thallium.

See the 2005 summary for complete results.