




ISO-NE Daily Report

Friday October 01, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$	
Connecticut	36.64	35.00	32.86	32.80	34.07	36.40	39.60	39.48	43.00	50.29	52.27	49.77	48.03	46.71	40.78	39.34	38.92	38.64	49.00	47.19	39.14	38.58	34.61	36.79	40.83	43.48
NEMass/Boston	35.92	34.51	32.49	32.50	33.72	35.93	38.28	38.16	41.58	48.53	50.35	47.82	46.16	44.84	39.40	38.11	37.64	37.34	43.95	45.40	37.88	37.31	33.88	35.95	39.49	41.77
New Hampshire	36.50	34.98	32.85	32.89	34.19	36.56	38.96	38.66	42.00	48.93	50.72	48.33	46.53	45.19	39.66	38.44	37.95	37.57	44.17	45.60	38.11	37.53	34.07	36.36	39.86	42.09
Maine	35.53	33.99	31.92	31.85	33.29	35.77	37.95	37.56	40.77	46.79	48.33	46.45	44.73	43.32	38.47	37.47	36.96	36.60	42.78	44.23	37.05	36.39	33.01	35.70	38.62	40.68
Mass Hub	36.31	34.85	32.79	32.80	34.03	36.24	38.78	38.51	41.92	48.96	50.78	48.13	46.41	45.11	39.57	38.19	37.74	37.51	44.33	45.90	38.21	37.62	33.99	36.30	39.79	42.06
Cleared Load (GW)	11.8	11.2	10.8	10.8	10.8	11.6	14.2	15.4	15.8	16.1	16.2	16.2	16.1	16.0	15.7	15.4	15.2	15.1	15.9	16.0	15.1	13.9	12.3	11.2		

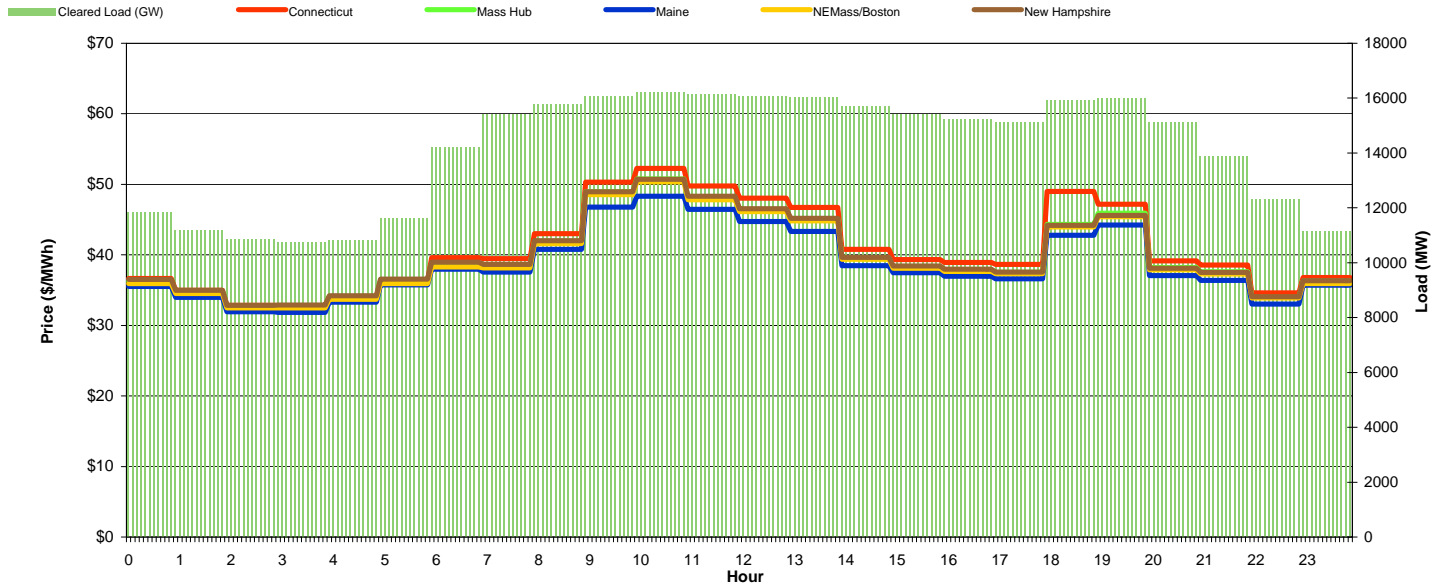

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$	
Connecticut	39.72	39.74	36.52	34.38	35.00	33.79	44.14	43.84	43.07	48.78	56.48	52.69	53.77	41.19	37.00	38.39	37.87	37.35	36.26	37.68	34.33	31.41	31.08	30.37	39.79	41.32
NEMass/Boston	38.89	39.18	36.19	34.10	34.62	33.27	43.02	42.88	42.23	47.98	55.34	51.73	52.93	40.64	36.57	37.80	37.23	36.71	35.60	36.81	33.53	30.97	30.61	30.05	39.12	40.60
New Hampshire	38.76	39.11	36.09	33.97	34.47	33.07	42.84	42.67	41.83	47.42	54.61	51.05	52.33	40.30	36.29	37.53	37.05	36.51	35.39	36.65	33.41	30.78	30.37	29.94	38.85	40.26
Maine	36.98	37.51	34.61	32.61	32.97	31.70	41.07	41.01	39.68	44.86	51.40	48.08	49.17	38.19	34.27	35.39	35.26	34.79	33.76	35.19	32.35	29.78	28.97	28.92	37.02	38.26
Mass Hub	39.12	39.35	36.31	34.21	34.75	33.40	43.18	42.92	42.22	47.92	55.28	51.65	52.85	40.56	36.50	37.79	37.25	36.75	35.66	36.93	33.68	31.04	30.76	30.19	39.18	40.61
DA Forecast Load (GW)	12.84	12.21	11.87	11.72	11.90	12.97	15.04	16.36	17.05	17.51	17.87	17.98	17.89	17.90	17.68	17.39	17.07	16.77	16.92	16.76	15.90	14.73	13.39	12.03		
Forecast Error %	6.7%	7.0%	6.9%	7.0%	7.4%	6.5%	3.9%	3.6%	2.9%	2.7%	2.2%	1.7%	0.8%	-0.9%	-2.2%	-2.8%	-2.4%	-1.4%	-2.1%	-2.3%	-1.5%	-0.3%	2.2%	3.3%		

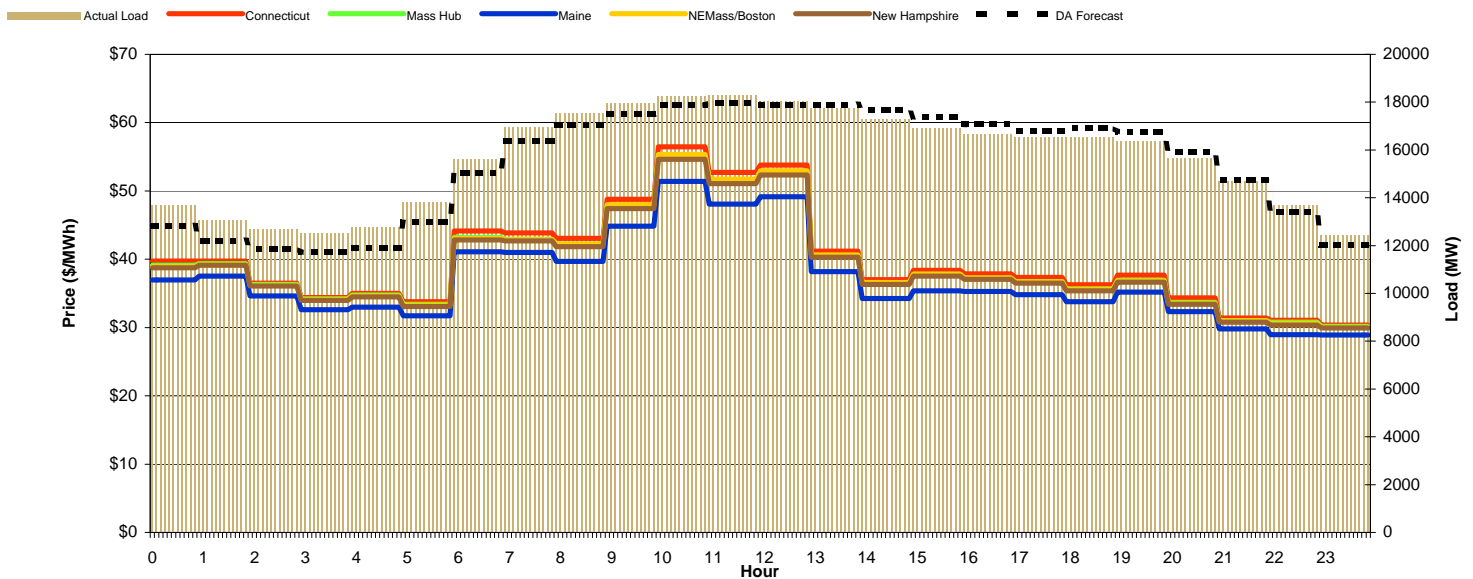




ISO-NE Daily Report

Saturday October 02, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	36.83	34.33	30.23	28.35	28.31	30.44	32.38	34.18	36.60	42.49	44.96	46.54	42.34	39.42	39.51	39.66	39.83	43.83	51.72	52.14	44.09	38.21	35.38	34.04	38.58	41.93	All	On Pk
NEMass/Boston	36.08	33.75	29.88	28.01	28.02	30.12	32.24	34.07	36.28	41.89	44.11	45.61	41.53	38.78	38.79	38.86	39.01	42.82	50.54	50.63	43.00	37.51	34.98	33.55	37.92	41.15		
New Hampshire	36.24	33.85	29.88	28.00	27.98	30.14	32.51	34.33	36.68	42.39	44.64	46.14	41.89	39.09	39.11	39.19	39.43	43.37	51.48	51.49	43.71	37.97	35.27	33.77	38.27	41.64		
Maine	35.19	32.87	28.94	27.19	27.17	29.37	31.88	33.75	36.03	41.50	43.39	45.05	40.62	37.81	37.93	38.05	38.30	42.00	50.18	50.12	42.56	37.05	33.93	32.35	37.22	40.52		
Mass Hub	36.49	34.10	30.12	28.21	28.18	30.27	32.36	34.15	36.48	42.15	44.28	45.89	41.79	39.00	39.01	39.10	39.35	43.21	51.05	51.18	43.36	37.69	35.11	33.74	38.18	41.43		
Cleared Load (GW)	10.9	10.4	9.8	9.5	9.5	10.1	10.5	10.9	12.4	13.3	13.4	13.5	13.4	13.1	13.0	12.9	13.0	13.2	14.0	14.0	13.2	12.4	11.2	10.4				

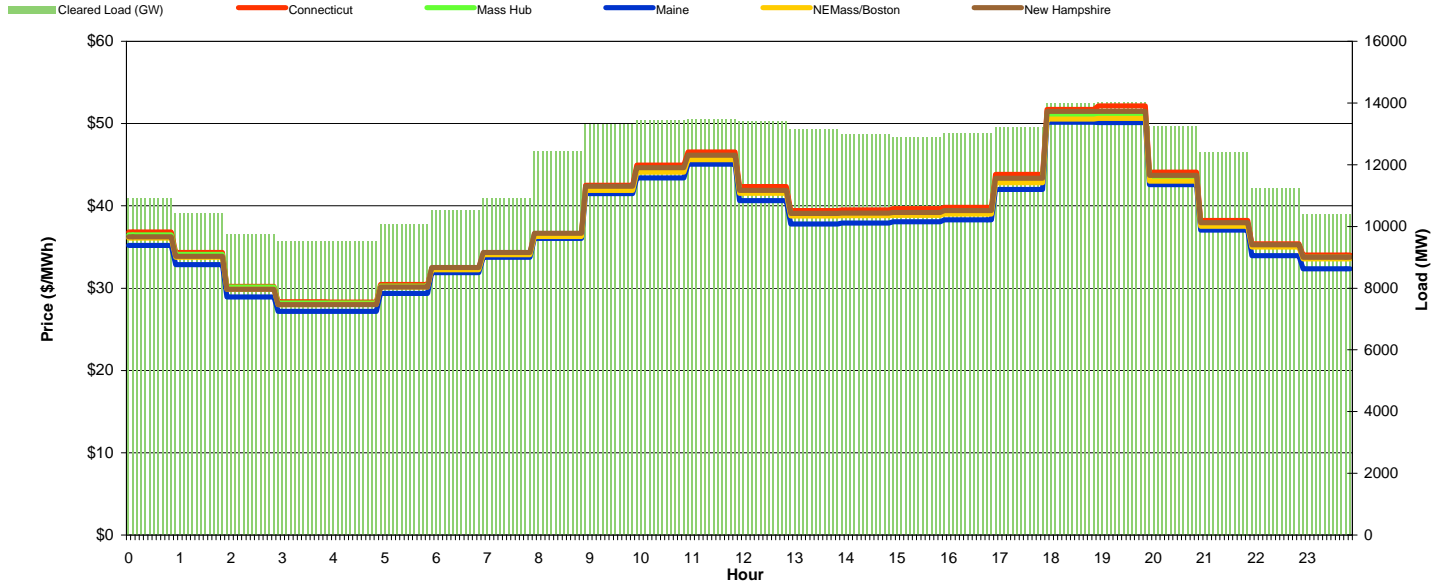

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	33.34	28.59	28.11	26.38	2.23	0.00	29.24	30.20	31.21	38.75	44.25	36.38	36.36	35.93	33.65	35.19	33.26	35.08	31.97	36.32	34.15	31.37	34.57	31.70	30.76	34.92	All	On Pk
NEMass/Boston	33.02	28.30	27.85	26.13	2.21	0.00	28.92	29.84	30.93	38.36	43.65	35.98	36.01	35.57	33.22	34.76	32.97	34.82	31.90	35.93	33.95	31.16	34.36	31.47	30.47	34.59		
New Hampshire	32.98	28.09	27.65	25.90	2.19	0.00	28.80	29.76	31.07	38.68	44.03	36.24	36.14	35.61	33.21	34.72	32.93	34.87	31.98	36.17	34.11	31.17	34.32	31.39	30.50	34.69		
Maine	32.46	27.08	26.89	25.20	2.14	0.00	28.32	29.34	30.56	37.76	42.99	35.37	35.07	34.50	32.14	33.64	32.06	34.03	31.39	35.49	33.49	30.43	33.33	30.39	29.75	33.85		
Mass Hub	33.18	28.46	28.01	26.27	2.22	0.00	29.12	30.00	31.04	38.48	43.83	36.09	36.08	35.63	33.29	34.83	33.02	34.86	31.86	35.94	33.94	31.18	34.45	31.56	30.56	34.66		
DA Forecast Load (GW)	10.68	10.11	9.76	9.63	9.63	9.92	10.52	11.35	12.42	13.30	13.67	13.76	13.62	13.39	13.19	13.10	13.22	13.52	13.80	14.27	14.03	13.24	12.19	11.19				
Forecast Error %	6.9%	6.8%	6.7%	5.8%	5.7%	5.3%	5.1%	1.9%	2.0%	0.8%	0.4%	0.2%	0.5%	1.0%	1.2%	1.4%	1.1%	0.4%	1.4%	1.2%	-0.1%	0.3%	0.8%	0.3%				

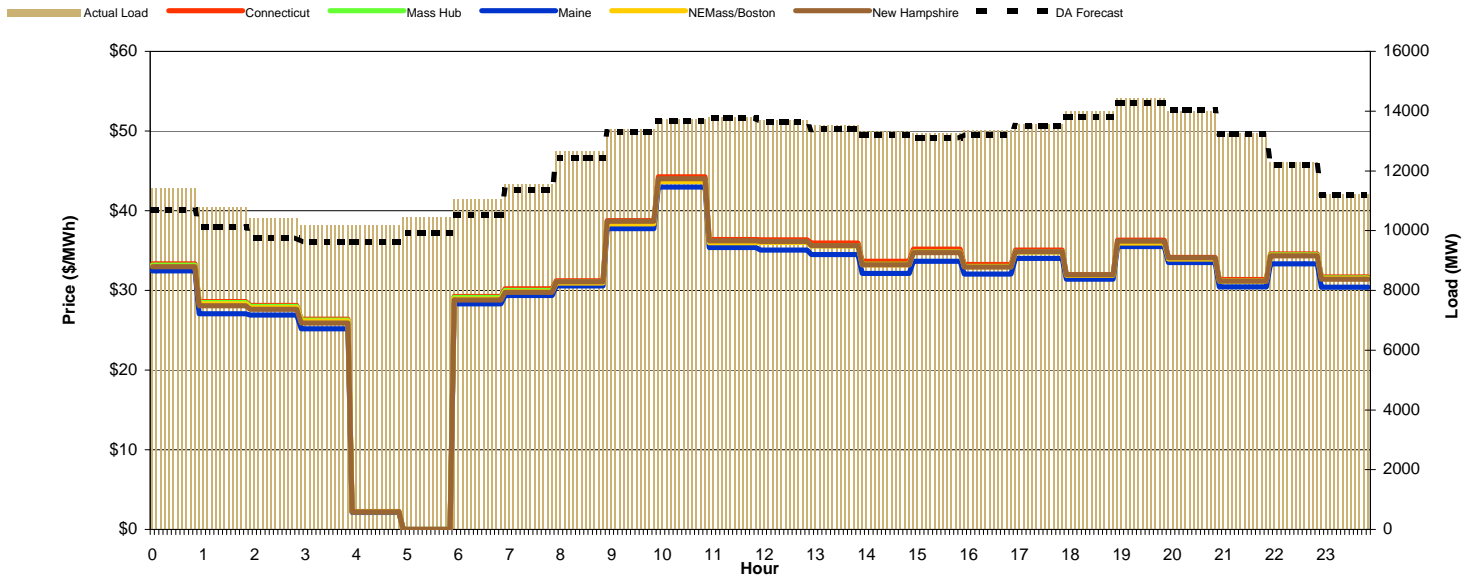




ISO-NE Daily Report

Sunday October 03, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	29.67	26.75	22.16	20.24	17.56	21.39	26.25	27.80	34.11	36.14	35.12	36.53	36.77	35.17	34.32	33.84	36.37	39.41	51.55	51.51	41.78	35.80	34.30	30.21	33.11	37.53	All	On Pk
NEMass/Boston	29.47	26.47	21.94	20.07	17.42	21.26	26.12	27.83	34.02	35.97	34.84	36.25	36.45	34.87	34.01	33.47	35.95	38.70	50.73	50.53	41.02	35.47	34.14	29.99	32.79	37.14	33.11	37.53
New Hampshire	29.59	26.55	22.00	20.13	17.49	21.31	26.31	28.04	34.53	36.64	35.36	36.78	37.02	35.33	34.45	33.94	36.47	39.40	51.75	51.43	41.69	35.89	34.52	30.20	33.20	37.70	33.20	37.70
Maine	28.77	25.91	21.35	19.59	17.09	20.85	26.11	27.76	34.20	36.03	34.95	36.20	36.48	34.77	33.88	33.39	35.89	38.63	50.80	50.32	41.10	35.55	33.83	29.50	32.62	37.11	32.62	37.11
Mass Hub	29.61	26.60	22.04	20.15	17.49	21.32	26.17	27.86	34.10	36.08	35.00	36.38	36.52	35.00	34.15	33.61	36.11	38.99	51.33	51.02	41.34	35.63	34.18	30.07	32.95	37.33	32.95	37.33
Cleared Load (GW)	9.9	9.4	9.3	9.2	9.2	9.3	9.4	9.7	11.0	11.9	12.4	12.7	12.6	12.5	12.3	12.3	12.6	13.4	14.4	14.2	13.5	12.3	10.9	9.9				

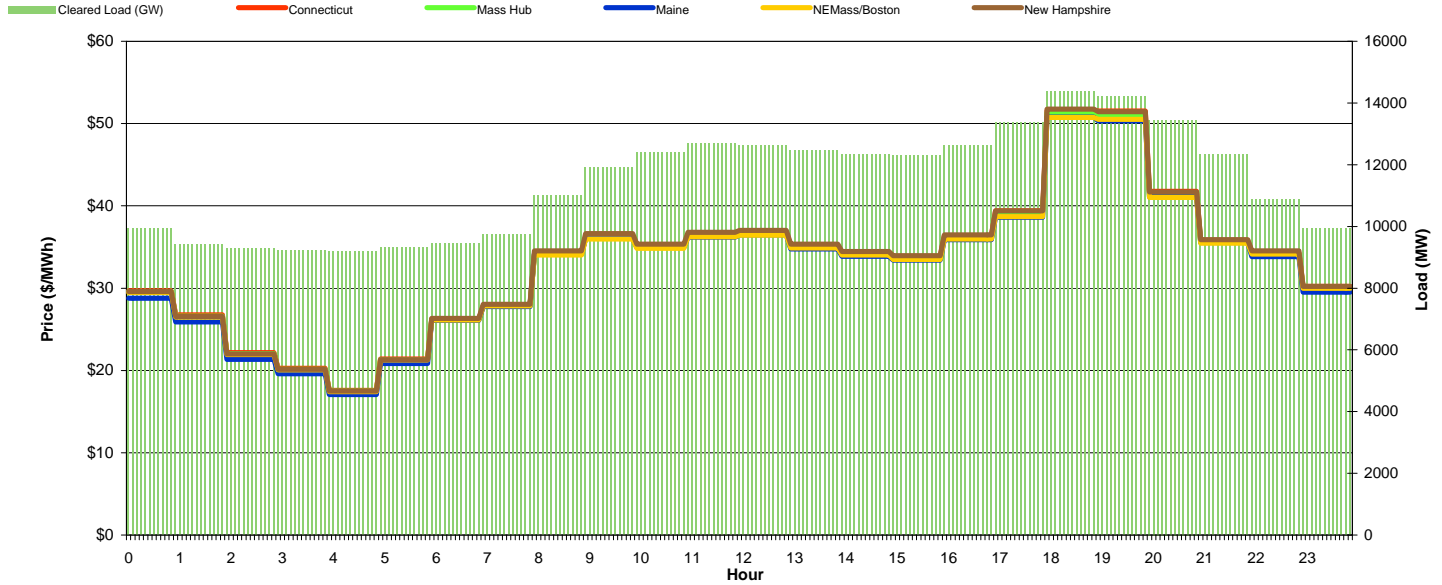

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	32.44	35.94	34.59	33.20	32.68	34.21	36.41	28.06	32.73	36.84	33.93	33.84	35.61	37.63	32.05	30.77	32.64	34.93	44.67	37.28	37.25	32.36	31.88	30.74	34.28	34.53	All	On Pk
NEMass/Boston	32.46	35.98	34.67	33.25	32.85	34.51	36.89	28.14	32.67	36.59	33.69	33.74	35.47	37.33	31.83	30.57	32.41	34.79	44.64	37.15	36.96	32.09	31.64	30.77	34.21	34.36	34.21	34.36
New Hampshire	32.45	35.99	34.65	33.26	32.86	34.56	36.99	28.32	33.08	37.03	33.91	33.91	35.61	37.48	31.95	30.66	32.57	35.05	45.06	37.61	37.31	32.15	31.59	30.71	34.37	34.58	34.37	34.58
Maine	31.83	35.27	34.04	32.81	32.60	34.38	36.86	28.21	33.09	36.54	33.39	33.48	35.07	36.83	31.67	30.39	32.33	34.88	44.97	37.63	37.16	31.79	31.03	30.53	34.03	34.28	34.03	34.28
Mass Hub	32.54	36.08	34.74	33.33	32.89	34.52	36.86	28.17	32.76	36.72	33.81	33.82	35.56	37.46	31.93	30.66	32.51	34.87	44.65	37.20	37.05	32.18	31.76	30.84	34.29	34.44	34.29	34.44
DA Forecast Load (GW)	10.66	10.08	9.76	9.60	9.61	9.82	10.26	10.95	11.92	12.70	13.12	13.37	13.43	13.30	13.18	13.17	13.40	13.90	14.63	14.90	14.46	13.54	12.40	11.24				
Forecast Error %	-2.7%	0.1%	0.2%	0.0%	-0.1%	-0.1%	-0.3%	-3.0%	-2.7%	-2.2%	-2.0%	-2.1%	-2.0%	-1.6%	-1.7%	-1.6%	-1.6%	-1.7%	-0.4%	0.7%	0.0%	-1.0%	-1.9%	-1.9%				

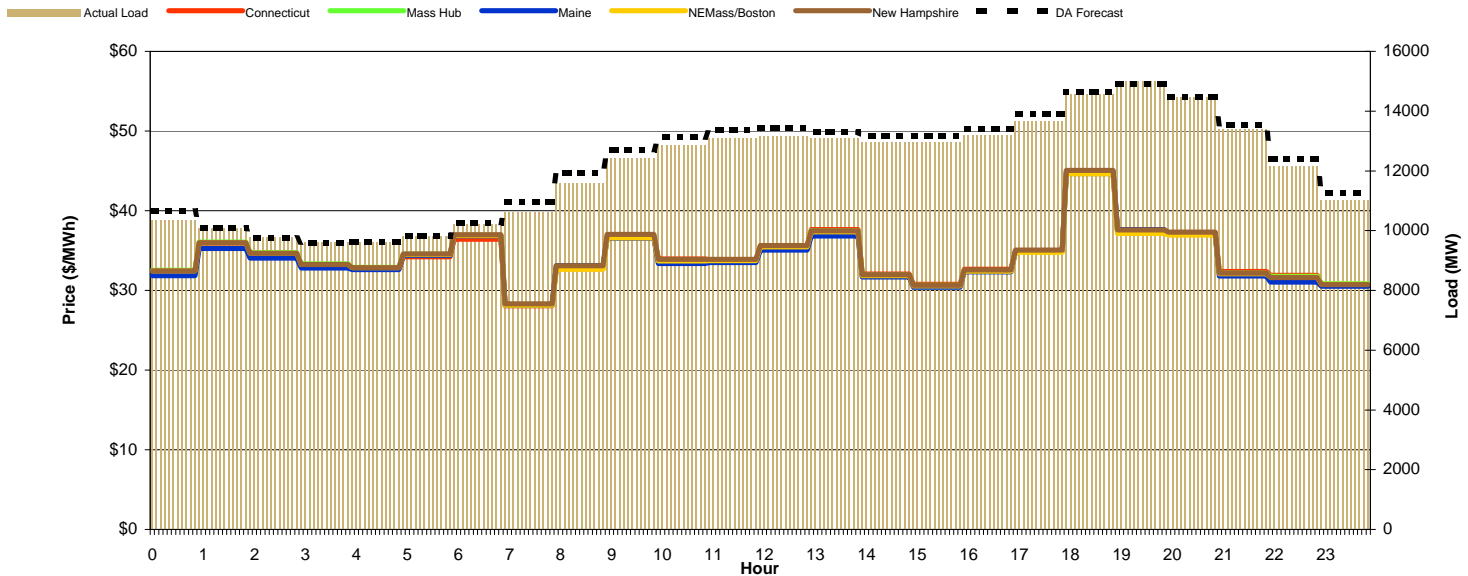




ISO-NE Daily Report

Monday October 04, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	32.51	29.83	22.40	21.23	26.63	32.42	36.54	37.86	38.62	42.18	47.70	47.86	41.82	39.66	39.42	39.46	39.68	43.64	56.03	55.82	45.00	38.32	33.88	35.12	38.48	42.93	All	On Pk
NEMass/Boston	32.24	29.78	22.40	21.31	26.71	32.48	36.28	37.14	37.86	41.26	46.47	46.59	40.82	38.91	38.53	38.52	38.70	42.54	54.26	53.95	43.81	37.42	33.38	35.01	37.77	41.89		
New Hampshire	32.39	29.81	22.36	21.31	26.76	32.61	36.93	37.76	38.51	41.92	47.25	47.36	41.48	39.51	39.14	39.09	39.26	43.25	55.40	55.04	44.55	37.94	33.79	35.32	38.28	42.58		
Maine	31.79	29.35	22.02	21.02	26.35	32.10	36.80	37.14	38.01	41.18	46.12	46.15	40.68	38.85	38.50	38.36	38.50	42.42	53.84	53.45	43.43	37.16	33.28	34.74	37.55	41.69		
Mass Hub	32.51	29.98	22.53	21.41	26.82	32.72	36.55	37.35	38.04	41.49	46.77	46.88	40.94	39.00	38.61	38.61	38.81	42.72	54.68	54.42	44.05	37.59	33.49	35.13	37.96	42.09		
Cleared Load (GW)	9.9	9.5	9.2	9.5	9.5	10.1	12.5	13.7	14.1	14.6	14.8	14.8	14.6	14.7	14.4	14.4	14.4	14.7	15.9	15.8	14.5	13.5	12.0	10.5				

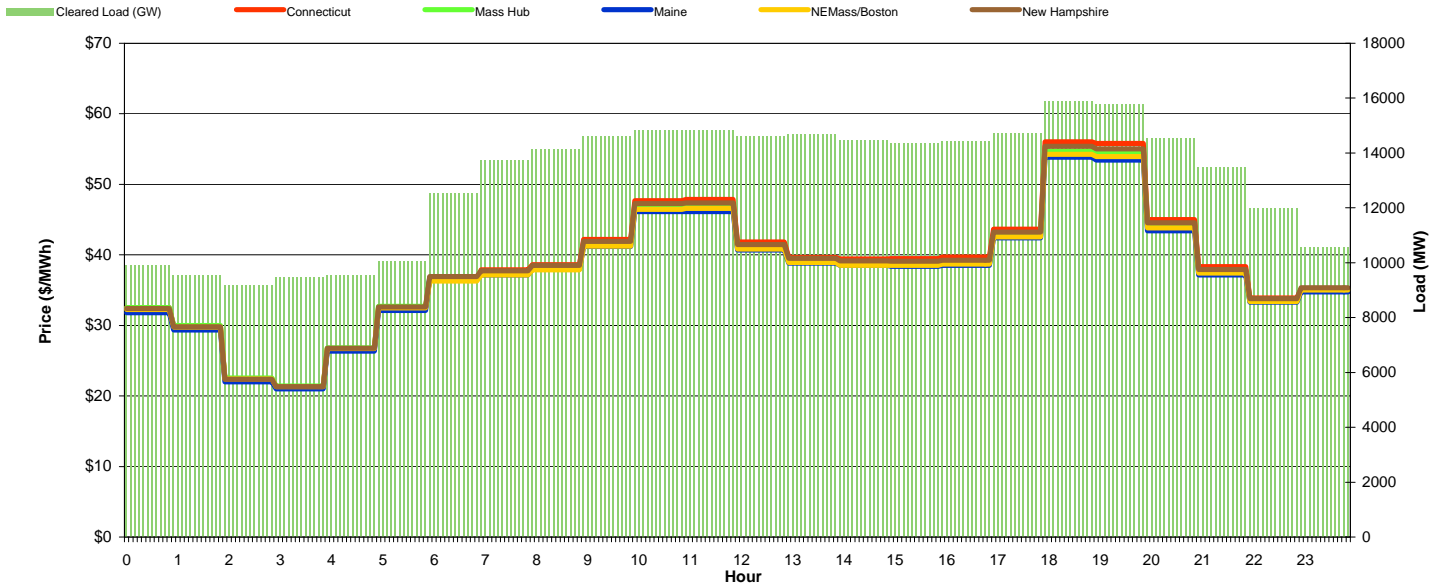

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	28.77	27.92	24.83	1.27	0.00	30.63	38.35	37.37	37.49	40.40	38.58	37.19	38.94	38.35	37.58	36.17	37.96	40.76	42.79	35.60	35.27	32.19	30.39	28.15	32.37	37.31	All	On Pk
NEMass/Boston	28.88	28.05	24.96	1.27	0.00	30.59	37.95	36.80	36.96	39.79	37.98	36.82	38.47	37.81	36.94	35.61	37.37	40.29	42.03	35.05	35.06	31.87	30.05	28.04	32.03	36.81		
New Hampshire	28.78	27.91	24.84	1.27	0.00	30.71	38.24	37.20	37.33	40.19	38.35	37.06	38.67	38.02	37.06	35.66	37.40	40.36	42.32	35.29	35.20	31.87	29.97	28.01	32.15	37.00		
Maine	28.71	27.82	24.78	1.26	0.00	30.79	38.22	37.14	37.11	40.01	38.00	36.28	37.69	36.97	35.76	34.48	36.18	39.22	41.53	34.44	34.24	31.04	29.19	27.57	31.60	36.21		
Mass Hub	28.97	28.12	25.03	1.28	0.00	30.75	38.15	36.90	37.01	39.84	38.01	36.89	38.55	37.90	37.06	35.71	37.48	40.37	42.12	35.09	35.09	31.95	30.17	28.11	32.11	36.88		
DA Forecast Load (GW)	10.40	9.97	9.74	9.73	10.01	11.12	13.22	14.51	15.03	15.30	15.55	15.62	15.60	15.54	15.41	15.37	15.56	15.97	16.56	16.40	15.79	14.68	13.21	11.81				
Forecast Error %	0.5%	0.9%	1.1%	1.0%	1.2%	0.1%	-1.6%	-1.6%	-2.0%	-1.8%	-1.7%	-1.6%	-1.8%	-1.4%	-1.6%	-2.0%	-2.2%	-2.0%	-1.3%	0.2%	-0.7%	-0.9%	-0.9%	-0.7%				

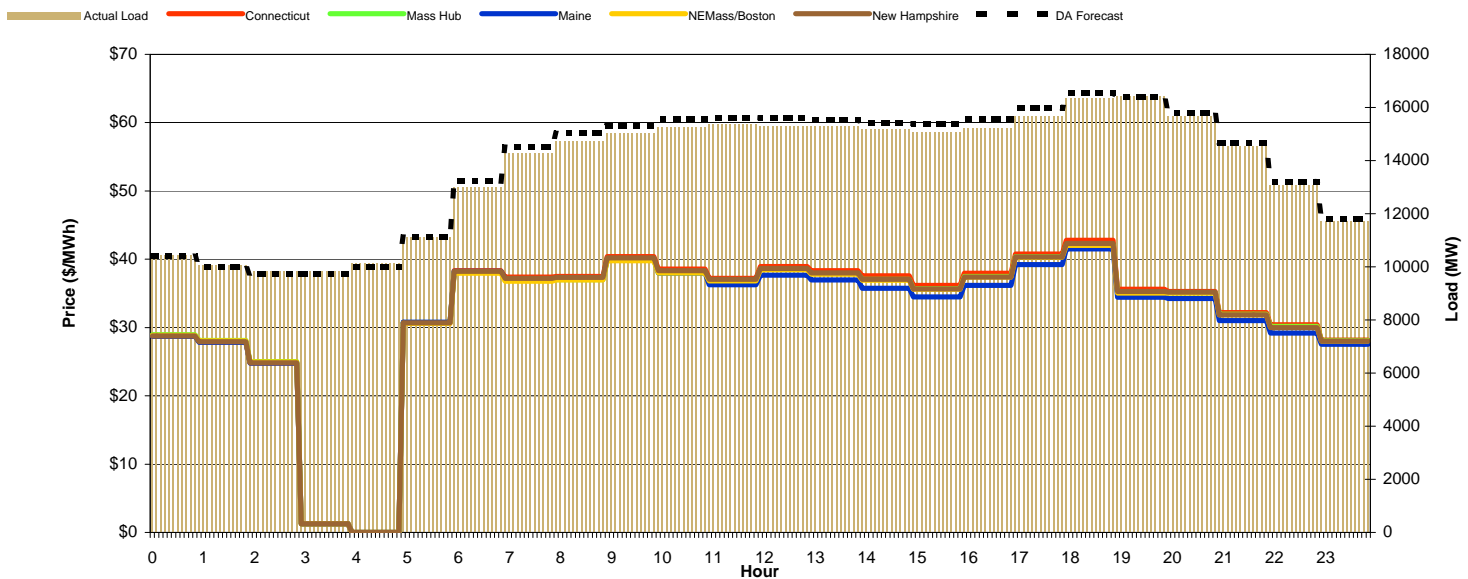




ISO-NE Daily Report

Tuesday October 05, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	29.71	25.79	18.65	16.59	19.74	28.10	34.33	37.26	40.63	42.85	44.93	44.44	42.77	42.77	43.85	42.96	42.04	42.79	51.67	51.66	40.68	36.16	32.22	31.15	36.82	42.48	All	On Pk
NEMass/Boston	29.22	25.52	18.63	16.62	19.78	27.99	34.08	36.43	39.54	41.80	43.93	43.45	41.86	41.83	42.73	41.81	40.91	41.72	50.59	50.58	39.78	35.21	31.65	31.08	36.11	41.49		
New Hampshire	29.42	25.58	18.73	16.70	19.90	28.18	34.62	37.06	40.23	42.43	44.58	44.07	42.33	42.31	43.25	42.31	41.47	42.37	51.69	51.54	40.38	35.62	31.96	31.29	36.58	42.10		
Maine	28.93	25.14	18.52	16.42	19.57	27.96	36.34	36.66	40.00	41.92	43.72	43.01	40.90	41.09	42.11	41.21	40.44	41.46	50.33	50.32	39.28	34.73	31.32	30.68	35.92	41.16		
Mass Hub	29.51	25.74	18.70	16.67	19.82	28.19	34.28	36.58	39.68	41.95	44.03	43.42	41.90	41.87	42.81	41.90	41.02	41.82	50.77	50.73	39.88	35.37	31.76	31.17	36.23	41.59		
Cleared Load (GW)	10.3	9.7	9.4	9.5	9.7	10.4	12.5	13.7	14.1	14.5	14.8	15.1	14.7	14.7	14.6	14.4	14.5	14.7	15.6	15.3	14.7	13.5	12.1	11.0				

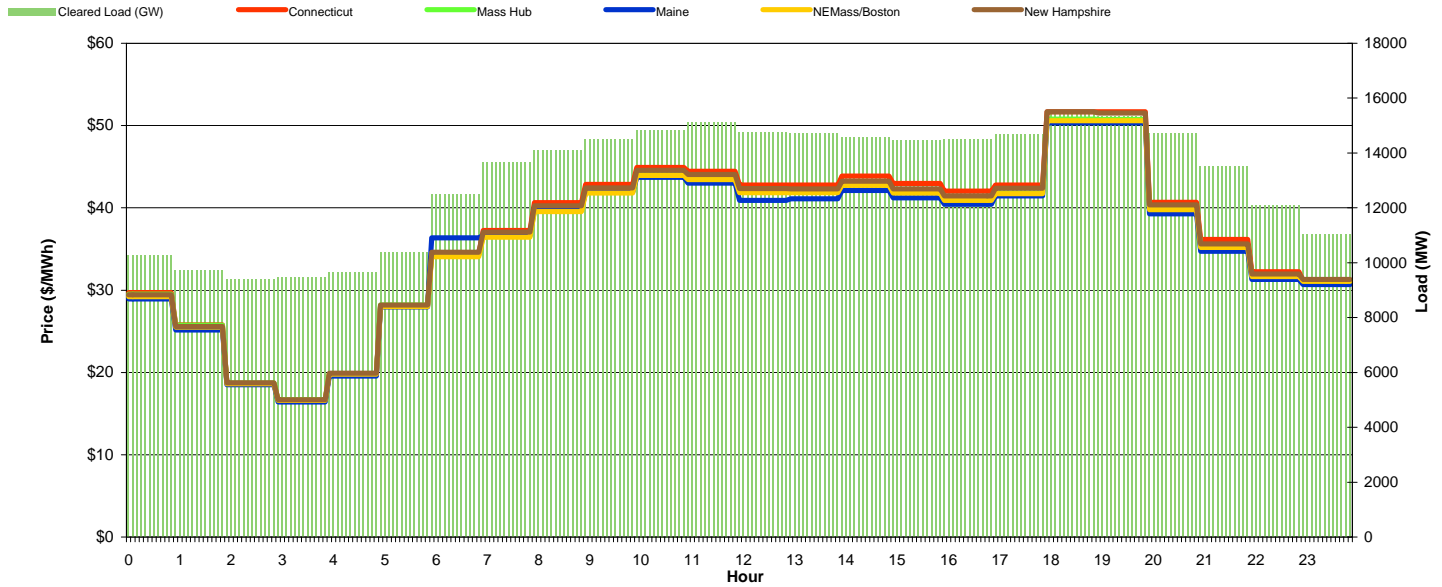

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	29.36	31.94	30.54	27.22	28.68	31.84	47.58	45.46	45.18	42.69	53.25	37.18	36.48	36.71	37.82	39.20	44.13	44.77	40.65	46.79	44.93	35.71	33.80	33.79	38.57	41.55	All	On Pk
NEMass/Boston	29.26	31.74	30.39	27.26	28.76	31.87	47.36	44.70	44.18	41.89	52.45	36.72	36.03	36.23	37.14	38.37	43.11	43.90	40.17	46.20	44.11	34.86	33.12	33.65	38.06	40.82		
New Hampshire	29.24	31.81	30.47	27.26	28.80	32.08	47.85	45.12	44.64	42.21	52.69	36.81	36.08	36.26	37.14	38.37	43.15	43.95	40.28	46.45	44.41	35.01	33.28	33.75	38.21	40.99		
Maine	28.87	31.71	30.46	27.26	28.81	32.11	47.52	44.40	43.79	41.20	51.35	35.74	35.07	35.20	36.00	37.23	42.02	42.67	39.24	45.26	43.51	34.11	32.47	33.06	37.46	39.95		
Mass Hub	29.38	31.93	30.57	27.35	28.85	31.99	47.60	44.83	44.42	41.90	52.42	36.80	36.11	36.31	37.25	38.50	43.27	43.93	40.13	46.19	44.21	35.06	33.33	33.74	38.17	40.92		
DA Forecast Load (GW)	10.75	10.26	9.98	9.92	10.18	11.21	13.34	14.56	14.92	15.19	15.44	15.55	15.63	15.66	15.53	15.41	15.44	15.69	16.42	16.52	15.90	14.79	13.35	11.87				
Forecast Error %	1.3%	2.3%	3.0%	2.6%	2.4%	1.7%	-0.2%	-0.2%	0.6%	0.7%	0.6%	0.5%	-0.3%	-0.6%	-0.7%	-0.3%	0.5%	1.4%	0.2%	0.2%	-0.3%	-0.4%	-1.4%	-0.6%				

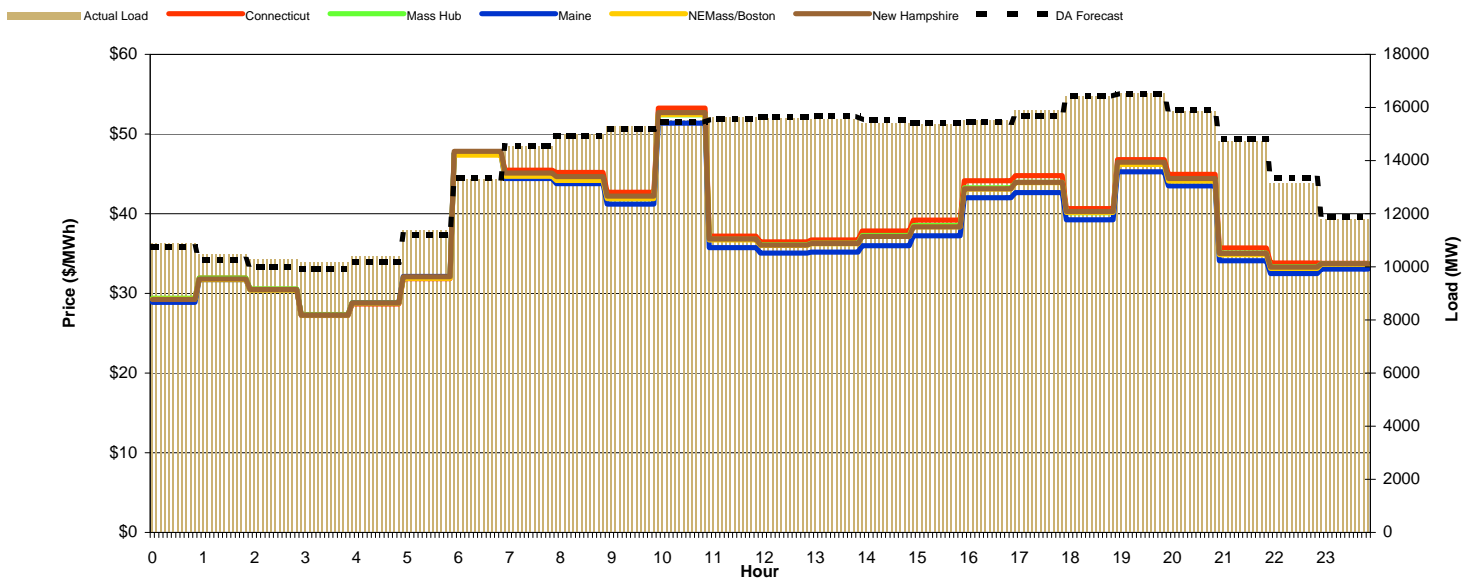




ISO-NE Daily Report

Wednesday October 06, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	30.39	27.14	23.81	26.44	26.93	31.45	39.15	45.94	48.64	48.87	49.50	48.17	47.29	47.72	46.15	44.55	44.59	47.59	52.68	51.36	46.55	39.56	38.00	35.16	41.15	46.70	All	On Pk
NEMass/Boston	30.68	27.48	24.05	26.62	27.22	31.70	38.71	45.00	47.56	48.03	48.70	47.49	46.47	46.99	45.42	43.90	43.86	46.85	51.88	50.96	45.73	38.52	37.18	35.00	40.67	45.91		
New Hampshire	30.59	27.37	23.89	26.46	27.09	31.70	39.08	45.28	47.70	48.23	48.81	47.52	46.50	46.96	45.40	43.89	43.87	47.00	52.43	51.24	45.83	38.53	36.83	34.63	40.70	46.00		
Maine	30.15	26.95	23.51	25.90	26.57	31.42	38.33	43.86	45.88	46.65	47.00	45.46	44.71	45.30	43.72	42.29	42.23	45.50	51.26	49.69	44.00	37.25	35.16	33.63	39.43	44.37		
Mass Hub	30.63	27.45	24.00	26.59	27.16	31.69	38.84	44.95	47.41	47.91	48.46	47.14	46.13	46.59	45.11	43.49	43.54	46.46	51.53	50.45	45.45	38.47	37.18	35.05	40.49	45.64		
Cleared Load (GW)	10.0	9.6	9.2	9.0	9.2	10.4	12.8	13.6	13.9	14.4	14.5	14.7	14.5	14.5	14.6	14.4	14.4	14.6	15.7	15.1	14.4	13.2	11.9	10.6				

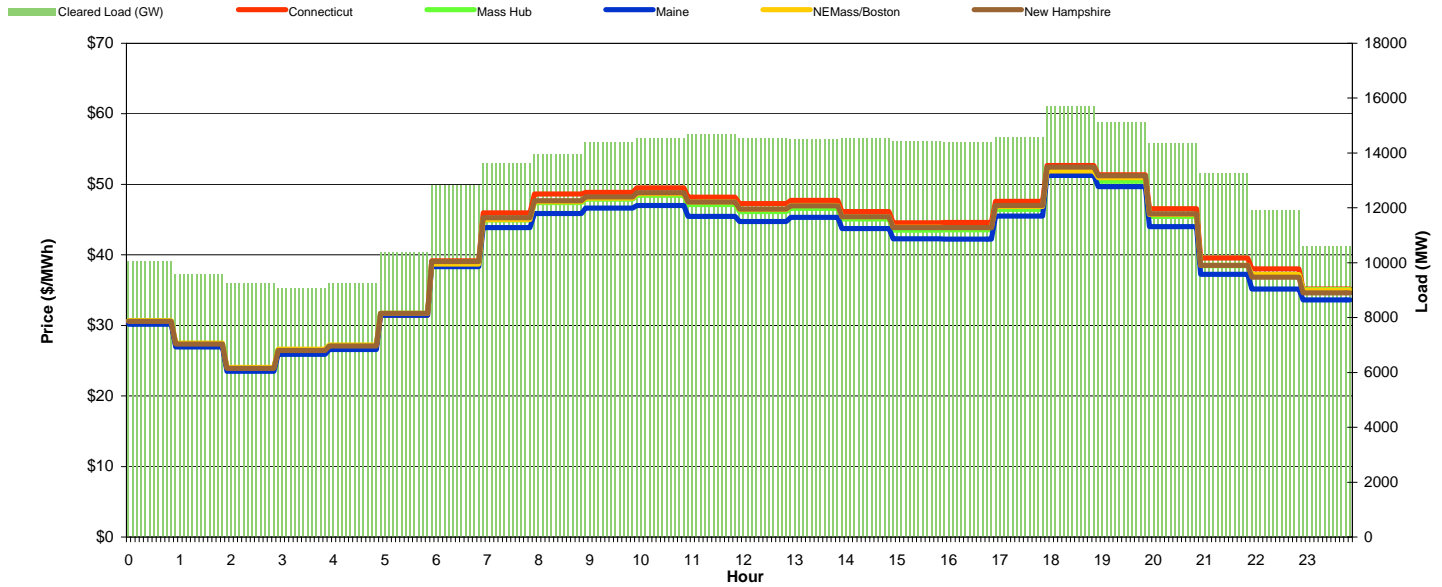

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	36.48	31.04	29.19	31.45	30.32	30.85	41.50	60.95	62.56	48.38	56.61	57.51	38.52	46.77	54.06	51.05	57.73	46.62	47.36	49.75	42.80	34.87	32.90	34.31	43.90	49.28	All	On Pk
NEMass/Boston	36.66	31.44	29.67	31.83	30.66	31.07	41.34	60.17	61.74	47.92	56.14	57.04	38.39	46.51	53.71	50.80	57.38	46.37	46.88	49.53	42.25	34.12	32.46	34.26	43.68	48.84		
New Hampshire	36.54	31.27	29.49	31.68	30.57	31.09	41.49	60.43	61.98	47.95	56.09	56.89	38.21	46.37	53.57	50.78	57.36	46.34	47.00	49.54	42.20	33.97	32.13	33.92	43.62	48.80		
Maine	35.74	30.64	28.88	31.02	29.98	30.59	40.75	58.90	60.43	46.55	53.93	54.27	36.44	44.53	51.51	49.04	55.14	44.40	45.34	47.46	40.33	32.31	30.67	32.63	42.15	46.95		
Mass Hub	36.64	31.35	29.53	31.76	30.59	31.00	41.21	59.95	61.47	47.62	55.85	56.80	38.19	46.26	53.46	50.56	57.13	46.09	46.62	49.22	42.09	34.13	32.46	34.25	43.51	48.62		
DA Forecast Load (GW)	10.87	10.40	10.12	10.04	10.28	11.31	13.47	14.81	15.27	15.59	15.89	15.98	15.96	15.94	15.81	15.70	15.76	16.02	16.50	16.56	15.86	14.77	13.36	11.93				
Forecast Error %	2.2%	0.1%	-0.3%	2.5%	2.6%	1.7%	-1.6%	-0.6%	-0.2%	-0.1%	-0.4%	-0.2%	-0.5%	-0.6%	-0.9%	-0.8%	-0.6%	-0.1%	-0.3%	-0.5%	-0.4%	-0.7%	-1.6%	0.2%				

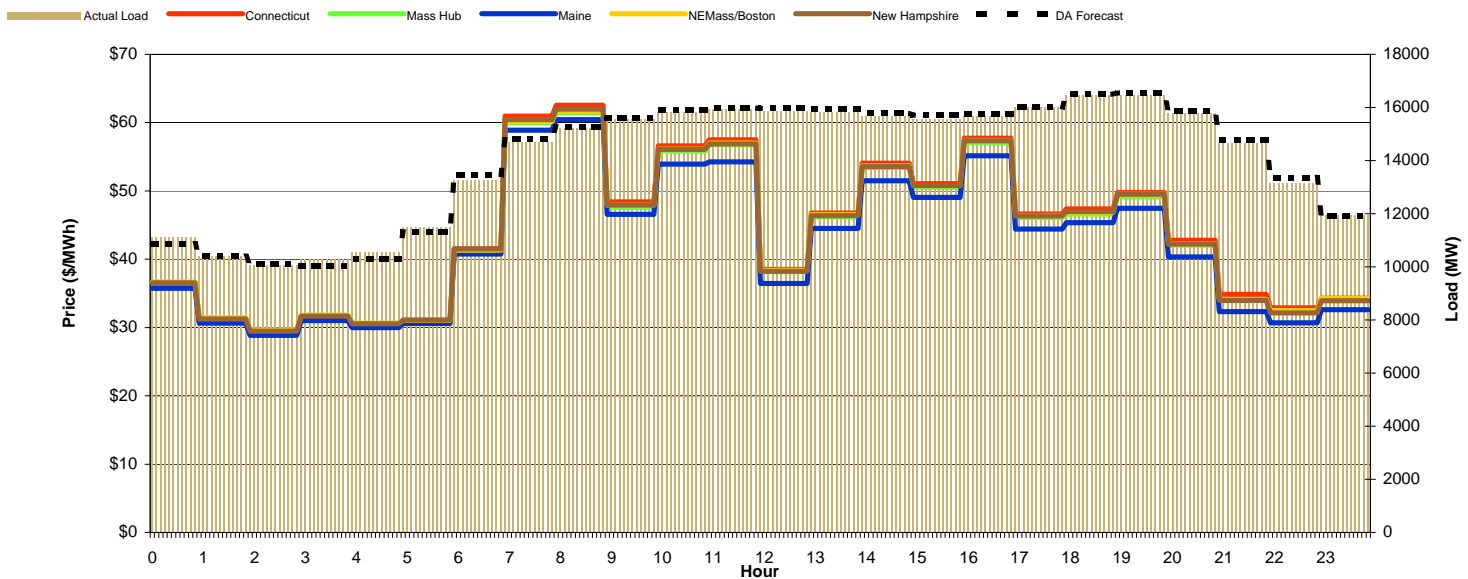




ISO-NE Daily Report

Thursday October 07, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	29.70	28.04	26.65	25.37	25.73	30.81	37.35	39.57	42.03	41.68	41.39	41.84	42.88	41.42	38.83	37.45	40.50	43.00	51.37	49.16	43.64	36.84	36.13	33.75	37.71	41.73	All	On Pk
NEMass/Boston	29.81	28.15	26.75	25.49	25.88	30.89	36.38	38.24	40.83	40.51	40.32	40.76	41.80	40.29	37.82	36.55	39.29	41.99	51.26	48.87	42.64	35.84	35.41	33.59	37.06	40.78		
New Hampshire	29.83	28.15	26.69	25.44	25.87	31.01	36.87	38.76	41.20	40.82	40.58	40.92	41.83	40.43	37.96	36.68	39.48	42.04	50.70	48.43	42.88	36.23	35.51	33.76	37.17	40.90		
Maine	29.03	27.52	26.04	24.82	25.25	30.40	35.73	37.42	39.68	39.16	38.80	39.01	39.85	38.63	36.41	35.17	37.69	40.04	48.08	45.94	40.78	34.83	33.87	33.21	35.72	39.09		
Mass Hub	29.74	28.15	26.75	25.50	25.88	30.91	36.86	38.66	41.12	40.67	40.38	40.81	41.75	40.31	37.84	36.54	39.33	41.98	50.35	48.27	42.57	35.96	35.55	33.72	37.07	40.76		
Cleared Load (GW)	10.0	9.8	9.5	9.6	9.7	10.4	13.2	14.5	14.8	14.9	14.9	14.9	14.8	14.8	14.8	14.6	14.6	14.8	15.6	15.5	14.7	13.5	12.0	10.7				

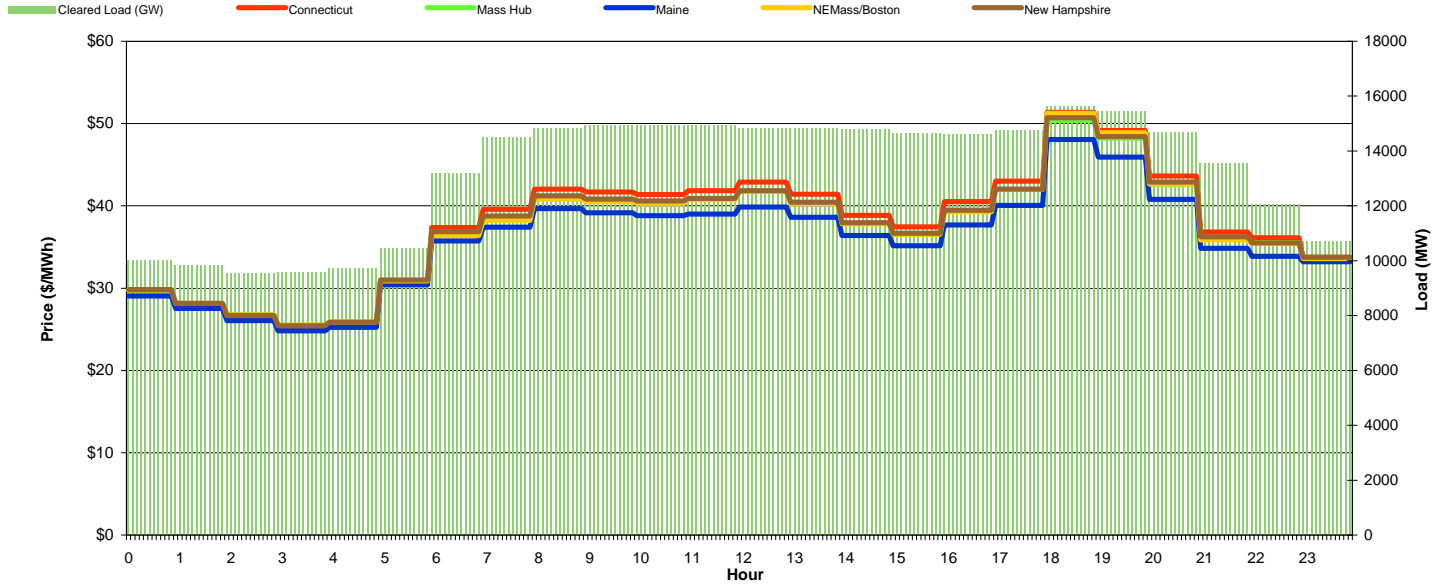

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	35.87	30.07	29.71	28.14	27.27	28.85	35.93	34.40	35.47	36.09	37.66	37.86	36.57	36.54	34.90	33.56	37.63	36.45	41.36	45.87	38.26	32.62	29.78	28.36	34.55	36.56	All	On Pk
NEMass/Boston	35.97	30.37	29.99	28.32	27.44	28.96	35.50	33.70	34.78	35.31	36.79	36.98	35.69	35.61	34.07	32.89	36.60	35.56	40.76	45.09	37.38	31.78	29.26	28.13	34.04	35.77		
New Hampshire	35.86	30.35	29.99	28.34	27.48	29.13	35.91	34.06	34.98	35.44	36.88	37.07	35.75	35.64	34.10	32.89	36.57	35.59	40.88	45.34	37.64	31.91	29.19	28.07	34.13	35.87		
Maine	34.85	29.70	29.40	27.89	27.13	28.43	34.65	32.98	33.78	33.86	34.93	35.08	33.90	33.77	32.42	31.35	34.51	33.74	39.01	43.12	35.70	30.22	27.58	27.00	32.71	34.12		
Mass Hub	35.96	30.31	29.95	28.32	27.46	29.00	35.70	33.91	34.93	35.46	36.94	37.13	35.84	35.77	34.22	33.01	36.80	35.73	40.80	45.18	37.52	31.98	29.41	28.22	34.15	35.91		
DA Forecast Load (GW)	10.82	10.34	10.05	10.01	10.23	11.23	13.28	14.54	14.97	15.24	15.47	15.60	15.58	15.62	15.46	15.30	15.29	15.51	16.11	16.22	15.66	14.64	13.21	11.79				
Forecast Error %	2.8%	2.1%	2.3%	2.4%	2.2%	1.4%	1.0%	-0.9%	-1.0%	-0.7%	-0.3%	-0.3%	-0.6%	-0.9%	-0.9%	-0.8%	-0.9%	-1.6%	-1.5%	0.3%	0.1%	-0.2%	-0.5%	-0.5%				

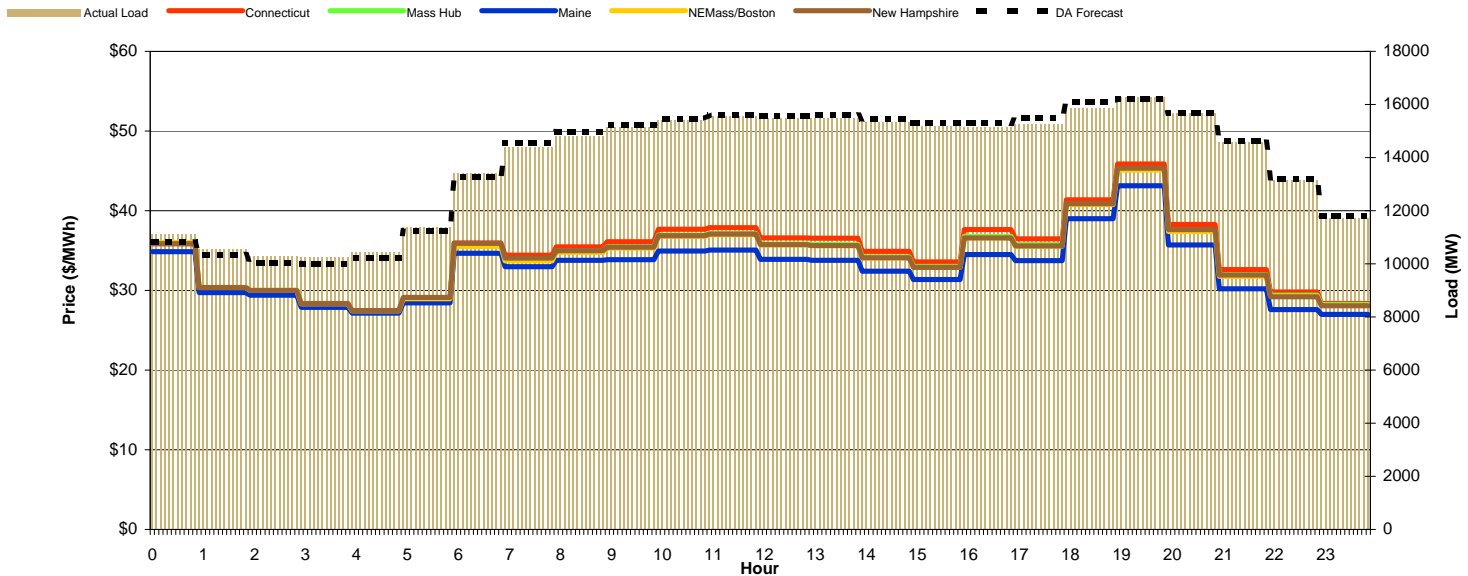




ISO-NE Daily Report

Friday October 08, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	29.88	28.60	25.73	25.64	27.36	29.64	36.94	43.38	42.00	46.38	48.75	48.89	47.10	48.99	49.06	45.53	48.74	43.52	48.98	49.03	43.35	39.03	34.40	33.37	40.18	45.45	All	On Pk
NEMass/Boston	29.86	28.59	25.74	25.74	27.42	29.69	36.35	42.32	41.13	45.43	47.66	47.66	45.94	47.68	47.65	44.40	47.06	42.43	47.68	47.70	42.33	38.15	33.92	33.20	39.41	44.32		
New Hampshire	30.32	29.01	26.06	26.07	27.78	30.15	37.13	43.01	41.81	46.00	48.12	48.05	46.13	47.95	47.87	44.53	47.21	42.63	48.07	48.04	42.66	38.49	34.25	33.52	39.79	44.68		
Maine	30.01	28.68	25.72	25.74	27.27	29.83	36.27	40.56	39.67	43.26	44.96	44.86	43.01	45.02	44.94	41.73	44.17	40.15	45.35	45.25	40.14	36.30	32.98	33.27	37.88	42.02		
Mass Hub	29.99	28.71	25.83	25.82	27.49	29.75	36.55	42.46	41.14	45.45	47.61	47.62	45.90	47.64	47.76	44.45	47.15	42.47	47.80	47.79	42.38	38.18	33.92	33.29	39.46	44.36		
Cleared Load (GW)	10.5	10.1	9.7	9.8	9.9	10.6	12.7	14.0	14.3	14.5	14.8	14.9	14.8	14.8	14.5	14.5	14.1	14.5	15.1	15.0	14.5	13.4	12.3	10.9				

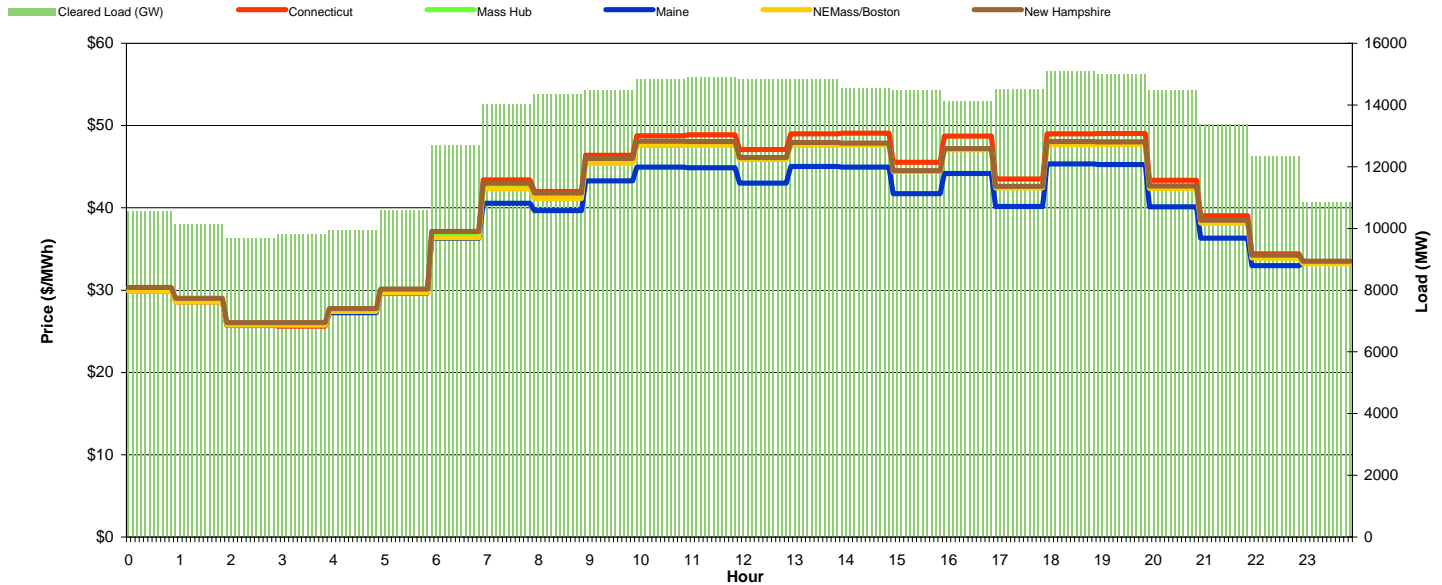

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	28.70	27.53	26.74	27.18	28.59	28.43	36.36	36.67	35.38	38.13	35.16	36.38	35.14	34.23	34.93	36.10	39.17	37.48	46.48	35.21	38.38	32.83	29.92	29.81	33.96	36.35	All	On Pk
NEMass/Boston	28.69	27.64	26.81	27.24	28.57	28.31	35.88	35.75	34.63	37.31	34.39	35.59	34.52	33.59	34.29	35.44	38.26	36.76	45.57	34.67	37.59	32.08	29.51	29.74	33.45	35.62		
New Hampshire	28.78	27.72	26.86	27.30	28.73	28.42	36.20	36.05	34.79	37.46	34.50	35.66	34.39	33.46	34.12	35.23	38.01	36.49	45.36	34.57	37.40	31.93	29.36	29.78	33.44	35.55		
Maine	28.21	27.18	26.22	26.68	28.11	27.40	34.78	34.23	32.95	35.19	32.46	33.58	32.42	31.64	32.22	33.22	35.85	34.61	43.23	33.15	35.73	30.48	28.18	29.43	31.96	33.70		
Mass Hub	28.77	27.72	26.90	27.34	28.69	28.43	36.04	35.99	34.82	37.49	34.48	35.65	34.54	33.61	34.39	35.54	38.31	36.83	45.68	34.74	37.72	32.24	29.62	29.77	33.55	35.73		
DA Forecast Load (GW)	10.75	10.23	9.97	9.91	10.15	11.08	12.99	14.23	14.76	15.10	15.33	15.42	15.41	15.40	15.26	15.09	15.08	15.20	15.45	15.42	14.98	14.16	13.00	11.73				
Forecast Error %	1.3%	2.4%	2.4%	2.1%	1.9%	0.9%	-1.0%	-0.9%	-0.9%	-0.8%	-0.6%	-0.6%	-0.8%	-0.8%	-0.8%	-0.5%	-0.9%	-1.9%	-1.0%	0.4%	-0.5%	-0.8%	-0.9%	-1.1%				

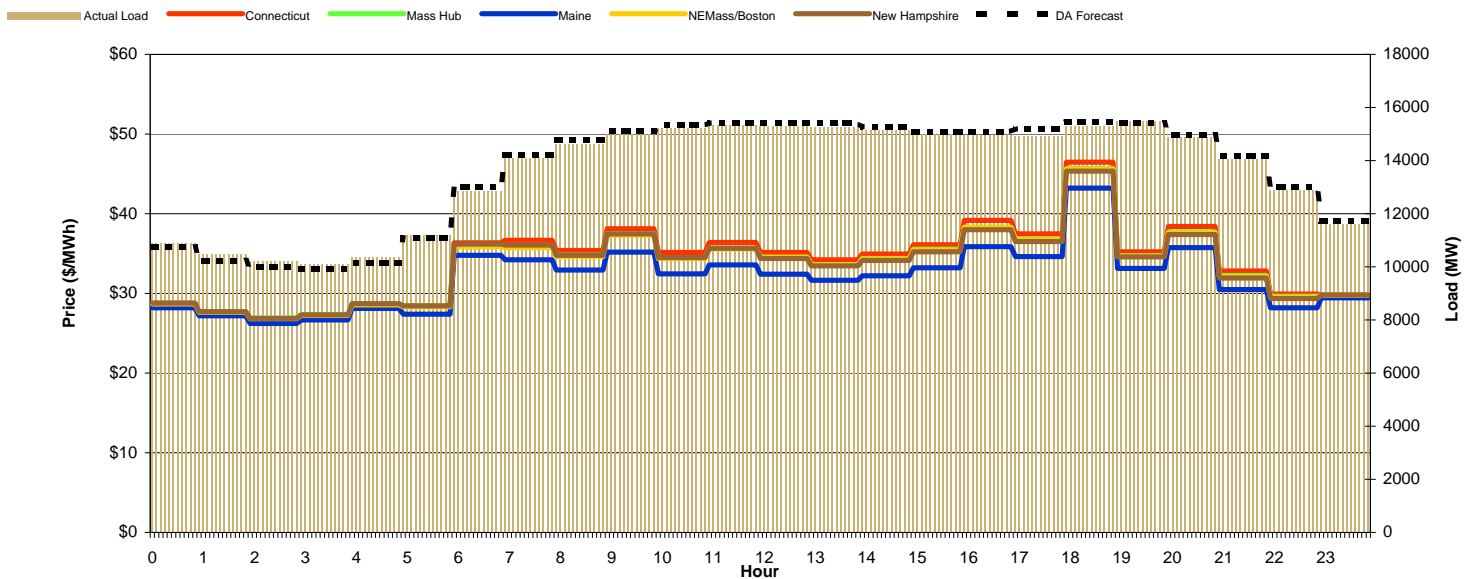




ISO-NE Daily Report

Saturday October 09, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	34.02	27.16	23.15	20.44	20.96	25.62	30.20	30.87	36.66	41.16	45.41	45.58	40.00	37.96	37.28	36.70	36.62	38.64	48.55	48.31	41.95	37.80	34.67	33.12	35.53	39.89	All	On Pk
NEMass/Boston	33.99	27.56	23.55	20.80	21.35	25.97	30.44	30.85	36.39	40.12	44.24	44.34	38.98	37.06	36.48	36.30	36.21	38.15	47.61	47.57	41.41	37.20	34.41	32.99	35.17	39.21		
New Hampshire	34.37	27.86	23.72	20.93	21.47	26.23	30.70	31.25	37.05	40.92	45.01	45.07	39.49	37.51	37.00	36.76	36.82	38.86	48.69	48.53	42.09	37.83	34.91	33.51	35.69	39.86		
Maine	33.70	27.76	23.65	20.85	21.41	26.12	30.18	30.98	36.52	40.08	43.72	43.00	38.45	36.58	36.23	36.00	36.27	38.20	47.96	47.68	41.00	36.81	33.86	32.67	34.99	38.96		
Mass Hub	34.15	27.56	23.49	20.77	21.31	25.95	30.49	30.95	36.55	40.37	44.47	44.59	39.15	37.24	36.64	36.41	36.30	38.25	47.83	47.71	41.52	37.39	34.53	33.12	35.28	39.37		
Cleared Load (GW)	10.1	9.7	9.0	8.9	9.0	9.2	9.6	10.5	11.7	12.3	12.5	12.4	12.3	12.1	12.0	11.9	12.1	12.6	13.4	13.3	12.8	12.0	11.2	10.3				

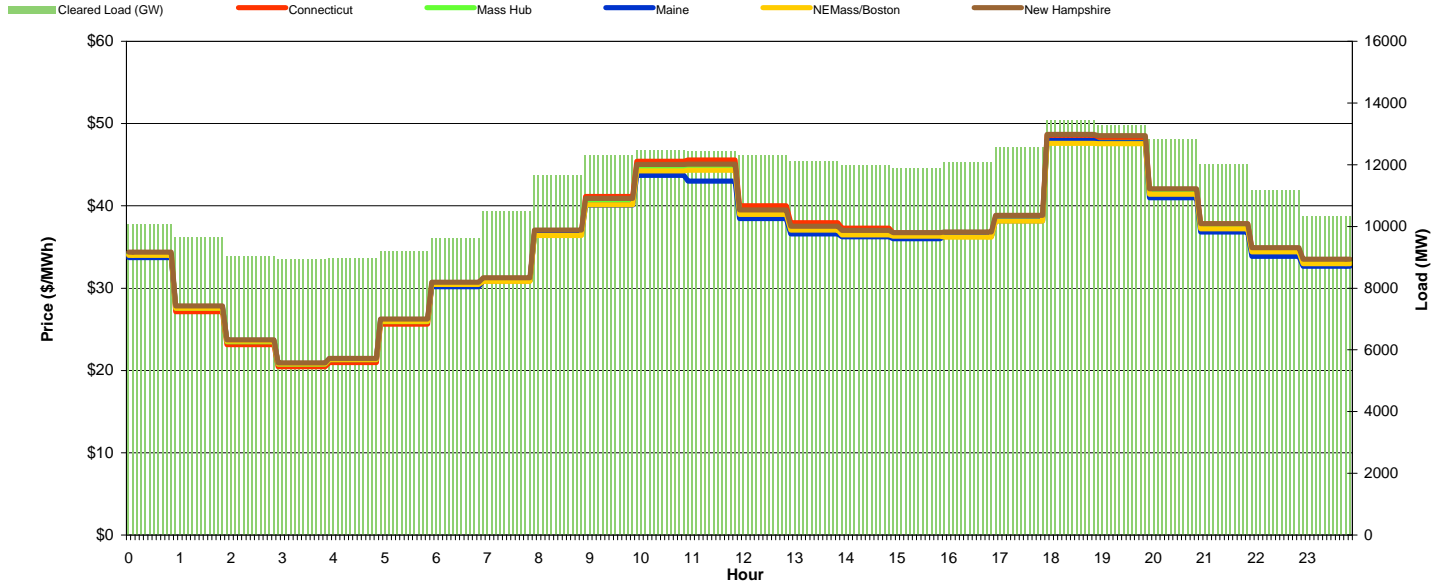

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	29.72	33.89	28.69	26.82	27.12	27.44	35.00	29.24	36.11	38.86	40.19	38.25	36.99	33.18	30.02	34.47	33.46	35.47	36.89	37.08	43.39	36.31	33.06	29.14	33.78	35.81	All	On Pk
NEMass/Boston	29.66	34.49	29.12	27.25	27.57	27.84	35.19	29.07	35.68	38.40	39.65	37.75	36.50	32.73	29.67	34.01	33.02	34.94	36.42	36.62	42.94	35.84	32.79	29.05	33.59	35.38		
New Hampshire	29.79	34.70	29.29	27.42	27.76	28.01	35.37	29.36	36.07	38.81	39.92	37.98	36.66	32.81	29.71	34.21	33.25	35.24	36.91	37.12	43.40	36.19	32.98	29.19	33.84	35.66		
Maine	29.29	34.45	29.04	27.26	27.66	27.59	34.69	28.88	35.03	37.46	38.25	36.75	35.51	31.70	28.66	33.06	32.30	34.14	36.02	36.12	41.89	34.95	32.02	28.44	32.97	34.55		
Mass Hub	29.74	34.39	29.07	27.21	27.52	27.80	35.22	29.15	35.78	38.51	39.75	37.82	36.56	32.80	29.71	34.06	33.07	35.01	36.44	36.63	43.00	35.97	32.88	29.11	33.63	35.45		
DA Forecast Load (GW)	10.71	10.12	9.79	9.60	9.65	9.99	10.70	11.60	12.68	13.40	13.71	13.80	13.69	13.43	13.25	13.13	13.21	13.55	14.14	14.42	14.05	13.37	12.43	11.36				
Forecast Error %	-0.4%	-0.3%	-0.4%	0.1%	-0.2%	-0.3%	-0.6%	-1.6%	-1.4%	-1.0%	-1.1%	-1.7%	-2.1%	-2.0%	-2.4%	-2.3%	-2.1%	-2.0%	-1.0%	-1.0%	-1.7%	-1.6%	-1.9%	-1.4%				

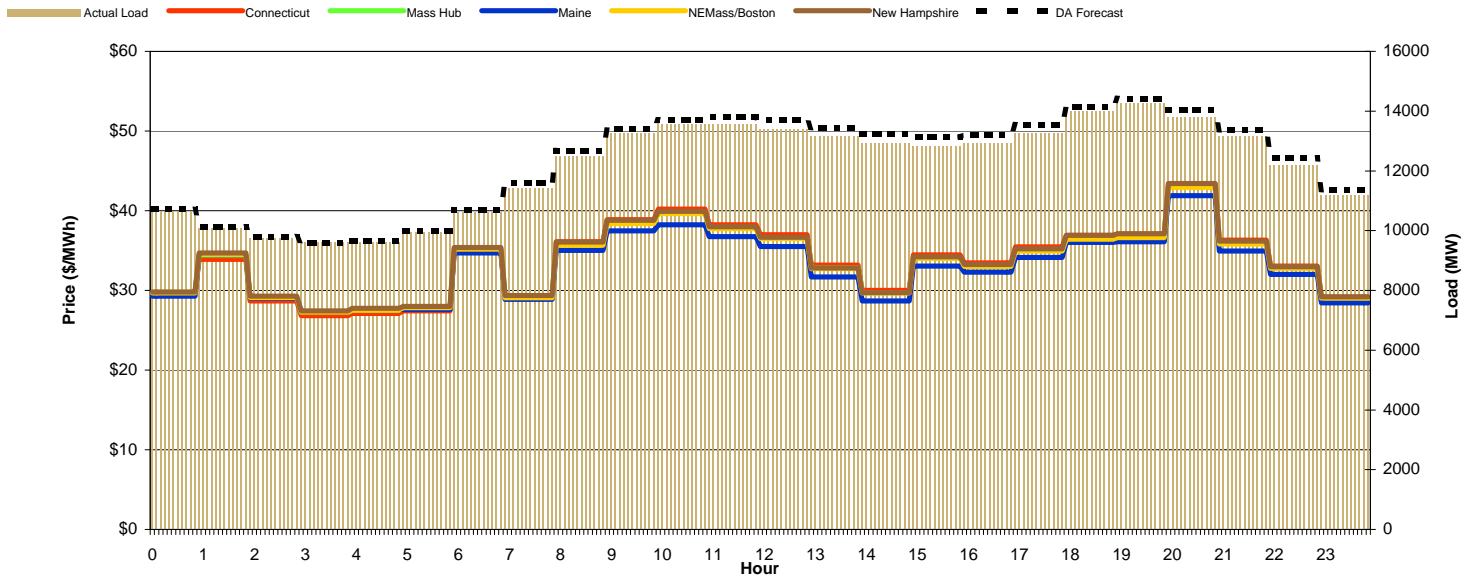




ISO-NE Daily Report

Sunday October 10, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	32.26	29.16	26.20	26.07	25.94	26.97	32.37	29.80	33.94	35.29	35.59	36.34	36.53	36.37	35.62	36.48	36.62	39.95	52.64	48.46	42.94	37.94	35.08	32.17	35.03	38.10	All	On Pk
NEMass/Boston	32.82	29.72	26.65	26.38	26.31	27.47	32.79	30.26	34.25	35.47	35.60	36.32	36.40	36.29	35.61	36.39	36.47	39.72	52.10	47.89	42.75	37.71	35.07	32.34	35.12	38.02		
New Hampshire	33.17	29.98	26.88	26.63	26.52	27.66	33.14	30.63	34.71	36.03	36.16	36.81	36.92	36.78	36.05	36.98	37.20	40.57	53.50	49.02	43.39	38.23	35.37	32.61	35.62	38.65		
Maine	32.47	29.31	26.34	26.05	25.99	27.15	32.85	30.41	34.19	35.56	35.49	36.12	36.22	36.06	35.28	36.34	36.72	39.90	53.00	48.00	42.35	37.27	34.17	31.83	34.96	37.94		
Mass Hub	32.80	29.74	26.69	26.45	26.34	27.52	32.84	30.15	34.15	35.43	35.60	36.31	36.39	36.26	35.55	36.38	36.51	39.78	52.35	48.03	42.80	37.81	35.10	32.42	35.14	38.04		
Cleared Load (GW)	10.0	9.7	9.4	9.0	9.1	9.7	9.7	10.0	10.9	11.7	12.1	12.3	12.2	11.8	11.8	11.7	12.2	12.6	14.1	13.9	13.1	12.1	11.0	10.2				

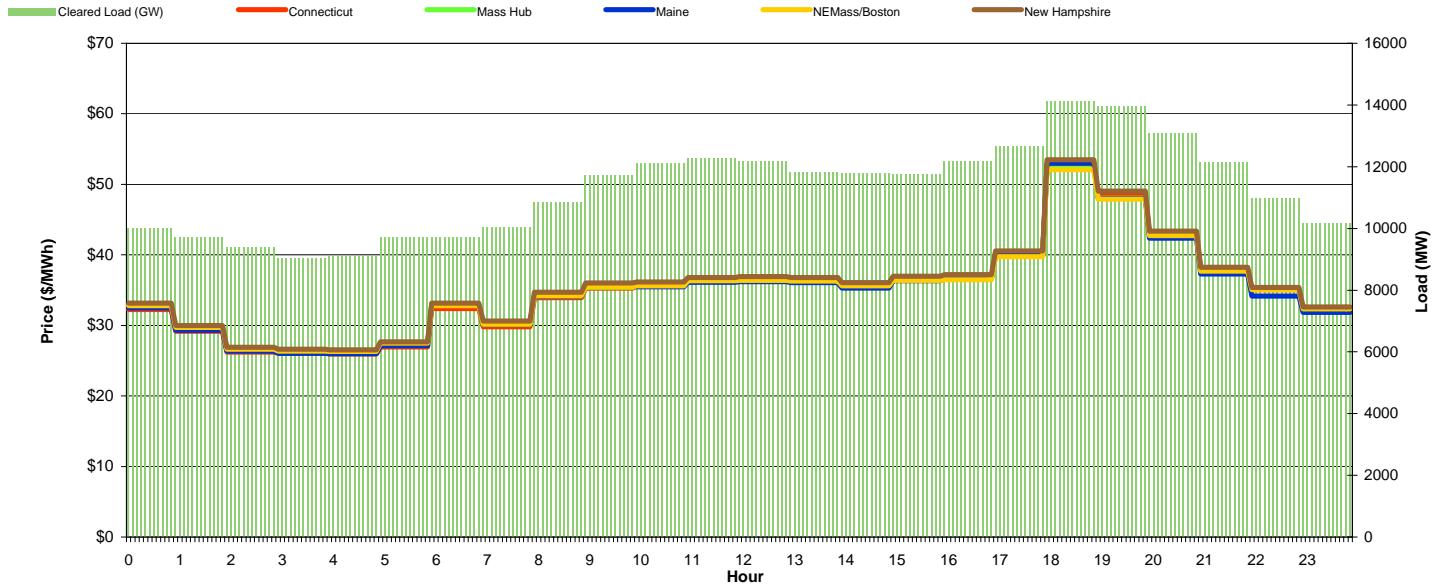

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	32.29	31.94	27.78	27.66	27.07	27.37	35.53	30.42	35.11	32.62	31.93	35.54	34.66	35.97	37.41	31.23	31.42	35.48	48.11	34.90	38.52	37.29	32.85	29.65	33.45	35.22	All	On Pk
NEMass/Boston	32.66	32.34	28.11	28.03	27.47	27.71	35.86	30.61	35.47	32.79	31.99	35.52	34.53	35.82	37.13	31.00	31.27	35.27	47.88	34.67	38.33	36.87	32.57	29.67	33.48	35.11		
New Hampshire	32.81	32.53	28.22	28.13	27.56	27.87	36.21	30.89	35.91	33.28	32.38	35.91	34.88	36.13	37.45	31.28	31.55	35.64	48.62	35.26	38.82	37.33	32.94	29.89	33.81	35.52		
Maine	31.97	31.81	27.60	27.50	26.97	27.29	35.53	30.36	34.97	32.43	31.40	34.71	33.60	34.67	36.04	30.16	30.45	34.52	47.27	34.36	37.63	36.15	32.04	29.04	32.85	34.42		
Mass Hub	32.63	32.37	28.11	28.03	27.45	27.74	35.93	30.68	35.46	32.80	32.00	35.55	34.58	35.88	37.23	31.08	31.33	35.34	47.88	34.68	38.34	36.96	32.66	29.71	33.52	35.15		
DA Forecast Load (GW)	10.40	9.88	9.57	9.44	9.47	9.69	10.19	10.82	11.81	12.52	12.85	12.98	12.96	12.80	12.65	12.64	12.87	13.34	14.22	14.51	14.18	13.23	12.07	10.99				
Forecast Error %	-0.4%	2.4%	2.7%	3.0%	3.0%	3.1%	3.0%	1.8%	0.2%	0.3%	0.1%	-0.1%	0.0%	0.1%	0.3%	0.1%	0.0%	-0.2%	-0.3%	-0.3%	-1.7%	-0.7%	0.2%	0.6%				

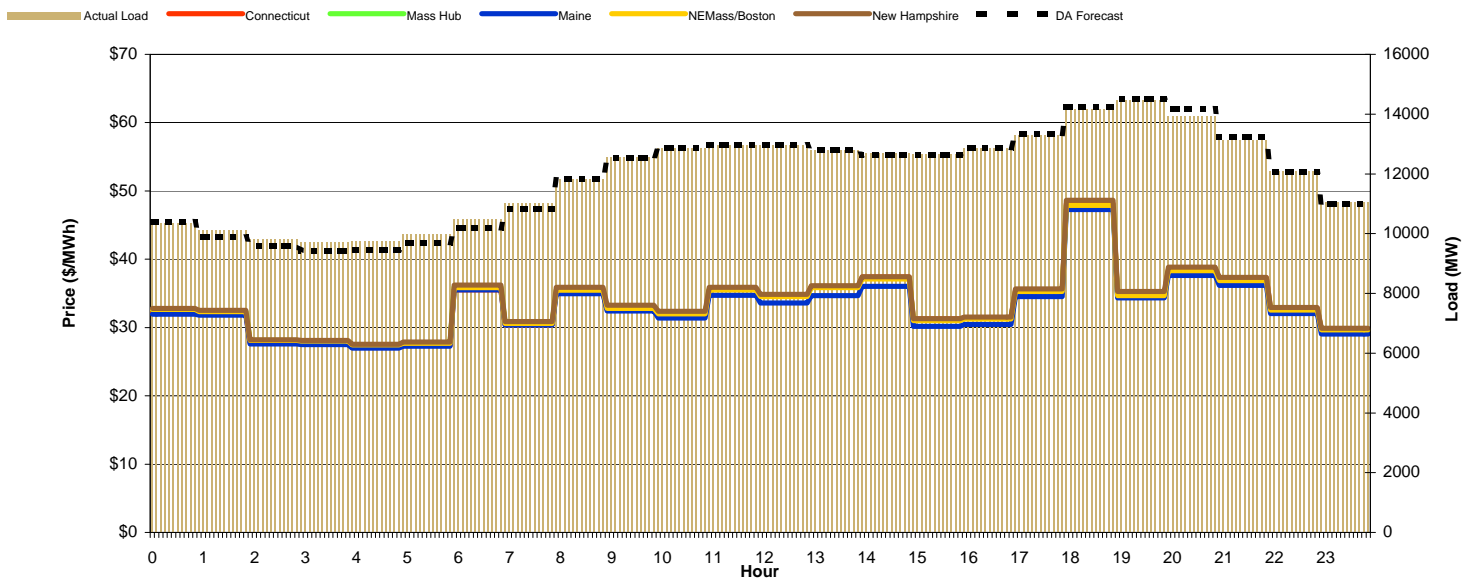




ISO-NE Daily Report

Monday October 11, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$				
																									All	On Pk			
Connecticut	26.96	23.41	17.91	19.87	19.00	27.24	33.06	36.61	37.52	37.99	38.49	41.06	43.76	42.82	39.48	38.08	38.97	40.23	48.60	48.47	40.82	35.74	29.14	28.74	28.74	34.75	39.86		
NEMass/Boston	27.01	23.60	18.10	20.05	19.22	27.39	33.10	35.96	36.89	37.32	37.78	40.33	42.81	41.84	38.62	37.32	38.17	39.49	47.70	47.63	40.07	35.11	28.76	28.89	34.30	39.11			
New Hampshire	27.24	23.78	18.22	20.21	19.37	27.63	33.43	36.26	37.29	37.89	38.34	40.85	43.37	42.30	39.07	37.74	38.62	39.92	48.57	48.32	40.46	35.37	28.94	29.22	34.68	39.58			
Maine	27.15	23.78	18.19	20.21	19.46	27.66	33.41	35.63	36.47	37.03	37.42	40.02	42.34	41.15	38.23	36.90	37.73	39.00	47.88	47.17	39.58	34.69	28.24	29.30	34.11	38.72			
Mass Hub	27.13	23.67	18.13	20.11	19.26	27.52	33.22	36.12	37.04	37.48	37.92	40.48	43.00	42.04	38.77	37.43	38.28	39.57	47.87	47.78	40.21	35.27	28.84	28.97	34.42	39.26			
Cleared Load (GW)	9.8	9.4	9.3	9.2	9.4	9.7	11.7	12.8	13.4	13.8	14.2	14.1	14.0	14.0	13.9	13.8	13.9	14.1	15.2	15.0	14.2	12.9	11.5	10.3					

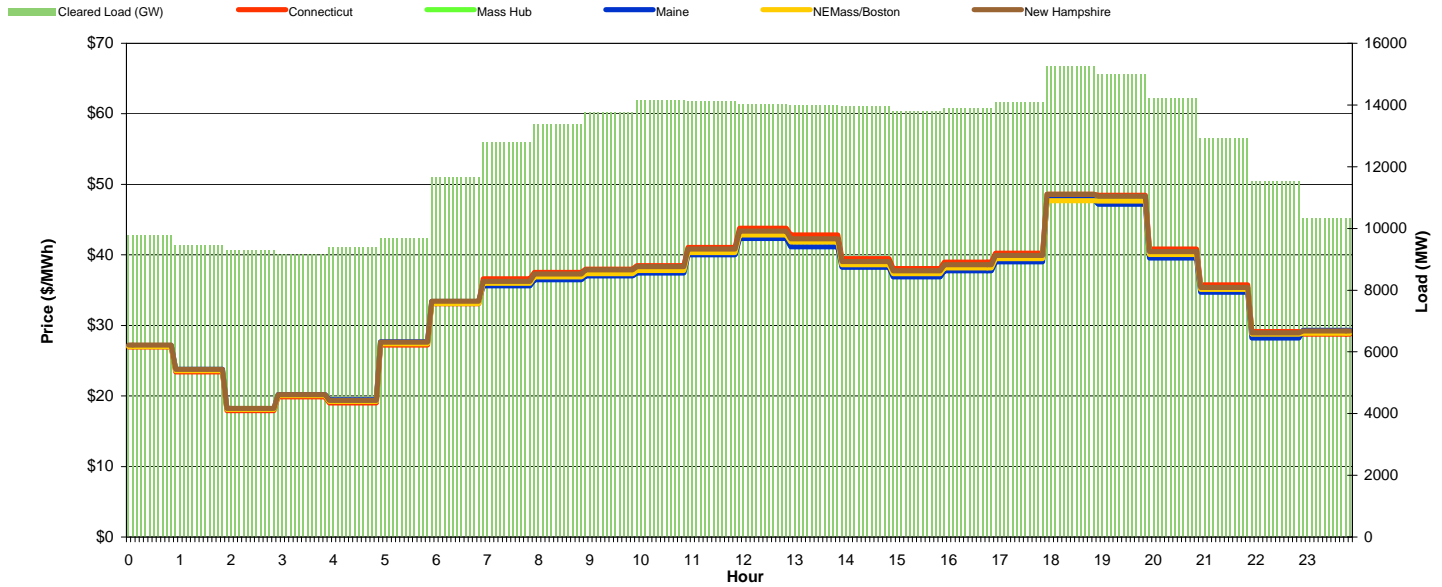

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
																									All	On Pk		
Connecticut	32.92	27.81	27.66	26.83	26.34	31.20	27.92	32.64	36.55	45.44	38.52	49.54	45.09	41.15	47.05	39.65	41.38	41.03	55.21	38.19	40.31	48.95	33.09	30.34	37.70	42.11		
NEMass/Boston	33.14	27.99	27.81	26.95	26.52	31.29	27.74	32.30	36.11	44.88	38.10	49.04	44.38	40.39	46.18	38.95	40.67	40.46	54.47	37.67	39.72	47.99	32.51	30.21	37.31	41.49		
New Hampshire	33.50	28.29	28.13	27.24	26.78	31.61	28.01	32.67	36.55	45.41	38.44	49.50	44.68	40.54	46.28	39.05	40.74	40.59	54.85	37.93	39.85	48.04	32.49	30.27	37.56	41.73		
Maine	33.38	28.13	28.02	27.23	26.79	31.42	27.51	31.90	35.74	44.26	37.18	48.28	43.10	39.00	44.55	37.64	39.27	39.45	53.68	36.93	38.83	46.86	31.71	30.21	36.71	40.52		
Mass Hub	33.17	28.04	27.88	27.03	26.58	31.42	27.90	32.48	36.31	45.10	38.28	49.10	44.51	40.53	46.41	39.21	40.93	40.70	54.70	37.85	39.94	48.37	32.77	30.36	37.48	41.70		
DA Forecast Load (GW)	10.11	9.69	9.49	9.46	9.75	10.56	12.05	13.22	13.99	14.57	14.88	14.93	14.83	14.72	14.56	14.47	14.64	15.12	16.00	16.05	15.39	14.29	12.84	11.43				
Forecast Error %	3.7%	4.4%	3.7%	3.7%	2.7%	1.1%	-3.3%	-4.6%	-2.7%	-1.5%	-0.6%	0.1%	0.0%	0.4%	0.5%	0.8%	0.4%	-0.4%	-0.7%	0.0%	-0.3%	-0.6%	-0.6%	0.1%				

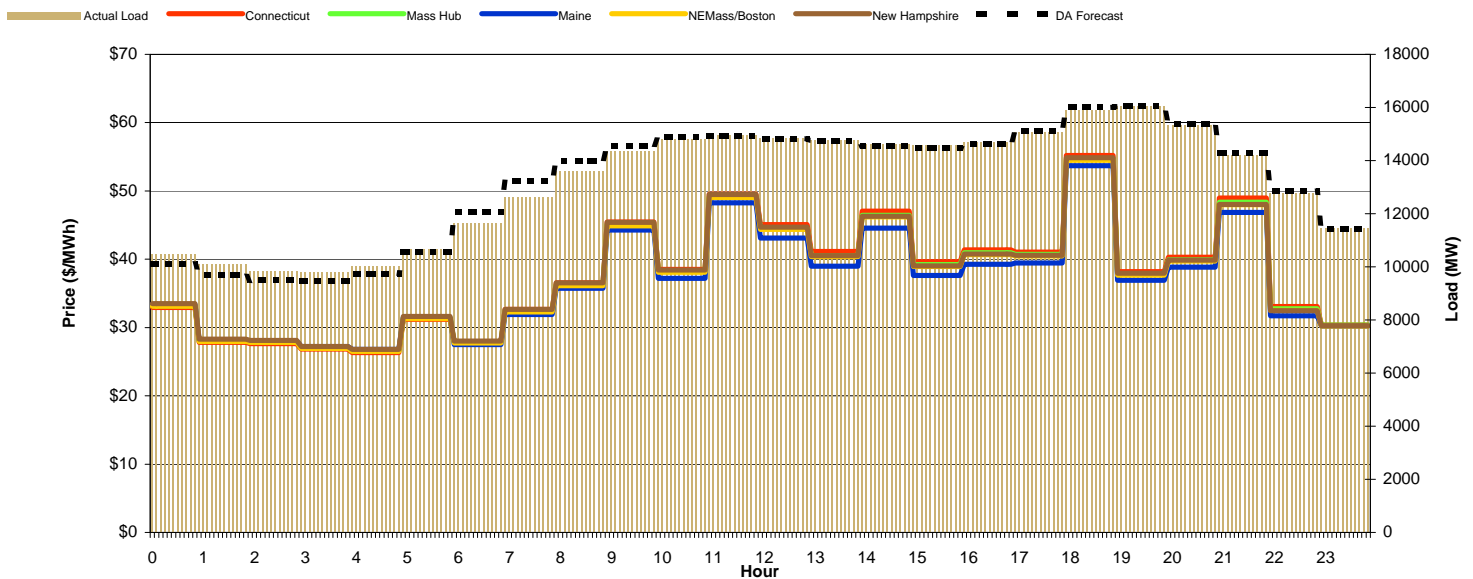




ISO-NE Daily Report

Tuesday October 12, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	28.66	26.56	25.75	25.77	26.72	30.19	37.16	42.05	41.81	42.67	45.50	44.95	47.98	45.70	42.40	41.84	42.29	43.94	49.47	48.86	44.36	36.77	34.24	31.91	38.65	43.43	All	On Pk
NEMass/Boston	28.84	26.74	25.87	25.92	26.93	30.49	36.74	41.32	41.09	42.00	44.66	44.11	47.03	44.74	41.61	41.04	41.44	43.07	48.62	47.91	43.48	36.08	33.80	32.00	38.15	42.63		
New Hampshire	29.10	26.93	26.07	26.14	27.17	30.89	37.38	41.84	41.58	42.45	45.01	44.40	47.25	44.97	41.79	41.22	41.64	43.35	49.24	48.43	43.78	36.35	34.07	32.31	38.47	42.96		
Maine	29.01	26.79	25.96	25.99	26.99	30.76	36.93	40.79	40.51	41.32	43.57	43.00	45.57	43.12	40.59	40.06	40.47	41.93	48.34	47.21	42.28	35.60	33.32	32.33	37.60	41.73		
Mass Hub	28.97	26.87	26.02	26.09	27.07	30.65	37.04	41.53	41.23	42.10	44.68	44.12	47.14	44.85	41.62	41.05	41.49	43.15	48.71	47.97	43.56	36.23	33.90	32.14	38.26	42.71		
Cleared Load (GW)	9.9	9.5	9.2	9.2	9.4	10.3	12.7	13.5	14.0	14.2	14.3	14.4	14.1	14.1	14.1	13.9	14.0	14.2	15.7	15.0	14.1	13.4	11.8	10.5				

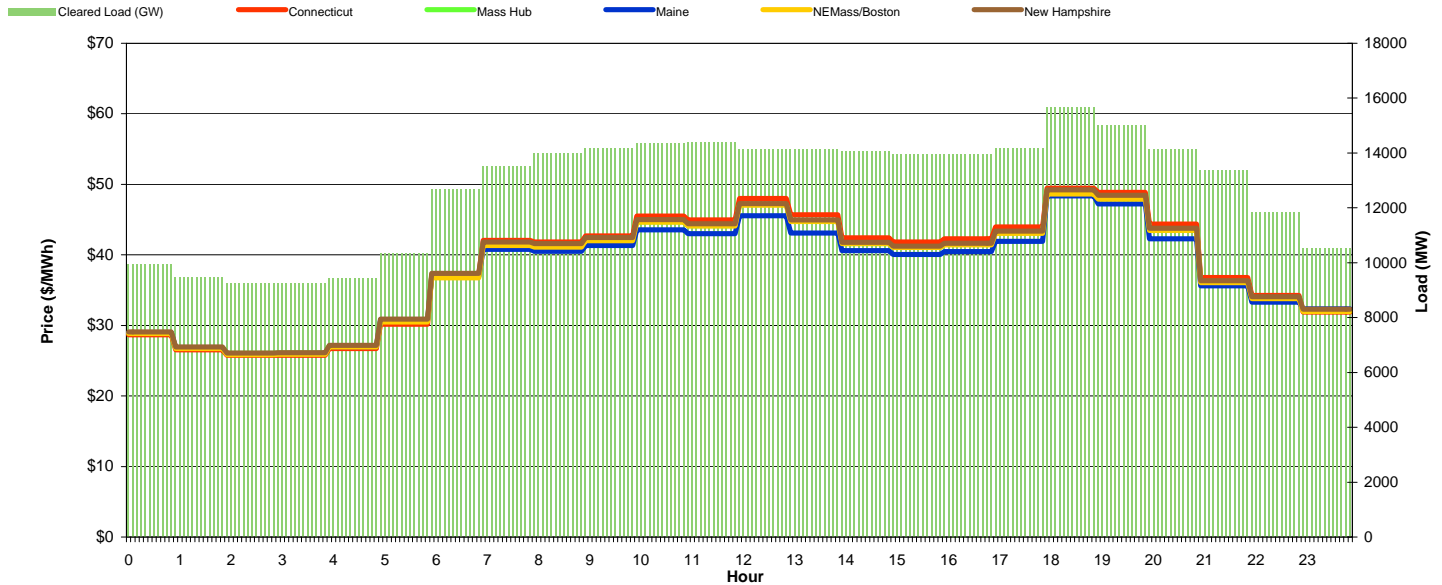

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	30.61	30.58	29.40	29.14	29.31	28.57	44.40	38.84	38.44	49.32	45.20	40.94	48.69	54.45	39.71	39.86	47.90	57.16	46.91	61.87	38.11	34.47	30.72	28.75	40.14	44.54	All	On Pk
NEMass/Boston	30.82	30.71	29.49	29.27	29.47	28.69	44.15	38.44	38.00	48.70	44.57	40.35	47.91	53.53	39.03	39.21	47.16	56.48	46.78	61.14	37.62	33.96	30.31	28.68	39.77	43.95		
New Hampshire	31.02	30.93	29.72	29.55	29.80	29.02	44.76	38.98	38.40	49.14	44.85	40.54	48.03	53.68	39.10	39.30	47.22	56.64	47.09	61.60	37.82	34.08	30.36	28.74	40.02	44.18		
Maine	31.25	31.06	29.81	29.74	30.01	29.17	44.70	38.72	37.85	48.02	43.79	39.44	46.54	51.93	37.73	38.01	45.60	54.82	46.21	60.23	36.63	33.19	29.42	28.03	39.25	43.01		
Mass Hub	30.91	30.87	29.67	29.44	29.62	28.81	44.37	38.65	38.19	48.91	44.68	40.45	48.03	53.66	39.14	39.40	47.38	56.71	46.82	61.24	37.72	34.13	30.51	28.81	39.92	44.10		
DA Forecast Load (GW)	10.50	10.06	9.85	9.81	10.06	11.06	13.08	14.40	14.80	14.98	15.14	15.16	15.09	15.11	15.00	14.93	14.98	15.35	16.15	16.07	15.40	14.32	12.94	11.63				
Forecast Error %	0.5%	2.1%	2.6%	2.6%	2.4%	0.4%	-0.8%	-0.3%	-0.3%	0.1%	0.3%	1.2%	1.6%	1.6%	1.4%	0.8%	0.6%	0.5%	0.3%	1.5%	1.5%	1.1%	0.2%	-0.2%				

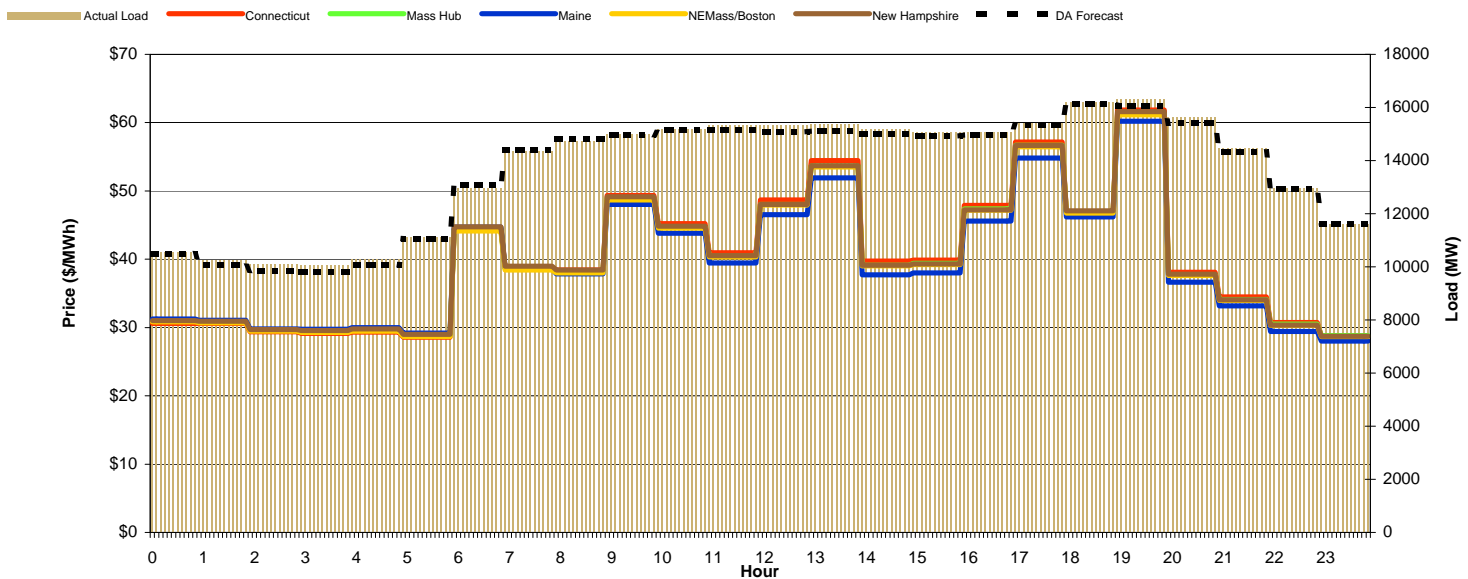




ISO-NE Daily Report

Wednesday October 13, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
	All	On Pk																										
Connecticut	28.09	27.58	26.65	25.00	26.58	30.16	36.13	38.09	39.77	42.65	43.26	44.41	44.53	45.29	42.68	42.33	42.61	42.61	50.29	48.94	43.77	37.18	32.36	30.36	37.97	42.55		
NEMass/Boston	28.06	27.55	26.59	25.04	26.60	30.35	35.73	37.34	39.08	41.83	42.26	43.41	43.50	44.18	41.65	41.29	41.50	41.52	48.91	47.70	42.75	36.29	31.77	30.28	37.30	41.56		
New Hampshire	28.29	27.78	26.82	25.23	26.82	30.80	36.65	38.16	39.62	42.36	42.65	43.76	43.78	44.52	41.96	41.59	41.85	41.89	49.71	48.35	43.37	36.82	31.90	30.25	37.71	42.02		
Maine	27.76	27.28	26.41	24.86	26.40	30.51	36.80	37.76	39.02	40.96	41.26	42.01	42.00	42.49	40.66	40.33	40.63	40.81	49.11	47.75	41.92	36.54	31.10	29.41	36.82	40.90		
Mass Hub	28.42	27.89	26.88	25.27	26.86	30.75	36.21	37.52	39.13	41.88	42.32	43.49	43.59	44.29	41.70	41.33	41.60	41.61	49.04	47.76	42.82	36.39	31.91	30.50	37.47	41.65		
Cleared Load (GW)	10.5	10.2	9.6	9.7	9.9	10.9	13.3	13.9	13.9	13.8	14.0	14.1	14.1	14.0	14.0	13.8	14.0	14.0	15.4	15.0	14.3	13.3	11.9	10.7				

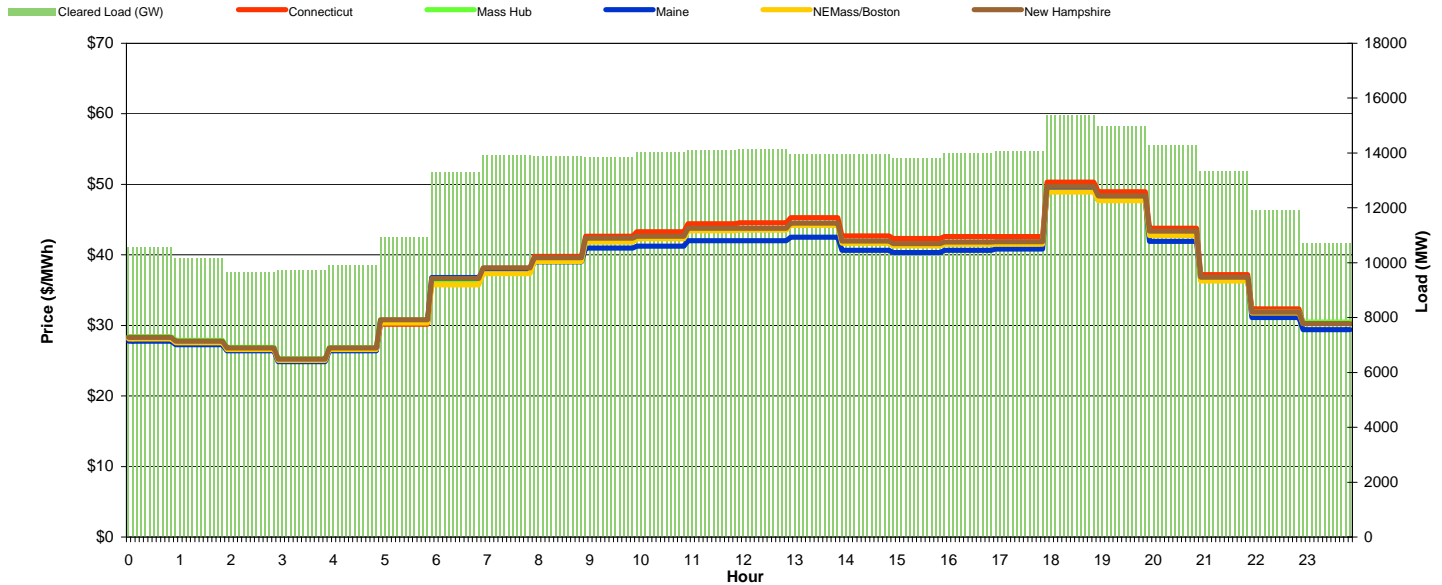

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
	All	On Pk																										
Connecticut	28.41	28.10	27.51	27.35	27.26	28.36	39.38	37.13	40.79	48.46	41.91	36.89	35.78	42.25	34.88	38.33	41.53	42.03	55.22	39.24	50.22	46.01	35.00	32.43	37.69	41.60		
NEMass/Boston	28.45	28.21	27.65	27.50	27.45	28.50	39.22	36.85	40.50	48.05	41.55	36.76	35.65	41.82	34.42	37.89	40.99	41.51	54.88	38.93	49.59	45.30	34.51	32.30	37.44	41.20		
New Hampshire	28.54	28.38	27.80	27.67	27.64	28.88	39.93	37.45	41.01	48.50	41.77	36.87	35.69	41.90	34.48	37.92	41.02	41.61	55.13	39.08	49.76	45.48	34.49	32.23	37.63	41.39		
Maine	27.89	27.93	27.39	27.34	27.33	28.64	39.70	37.17	40.66	47.50	40.84	36.01	34.73	40.56	33.29	36.61	39.57	40.38	54.01	38.16	47.89	43.88	33.27	31.34	36.75	40.28		
Mass Hub	28.61	28.38	27.81	27.66	27.59	28.65	39.41	36.99	40.62	48.14	41.72	36.86	35.73	41.90	34.52	38.02	41.14	41.62	54.85	38.95	49.72	45.53	34.77	32.55	37.57	41.32		
DA Forecast Load (GW)	10.70	10.23	10.01	10.00	10.27	11.32	13.40	14.62	14.92	15.17	15.31	15.31	15.18	15.20	14.98	14.92	15.00	15.36	15.94	16.02	15.45	14.39	12.89	11.55				
Forecast Error %	2.0%	2.2%	1.9%	1.6%	1.6%	1.1%	-0.9%	-1.1%	-0.8%	-1.3%	-1.3%	-1.1%	-0.5%	-0.6%	0.1%	-0.2%	-0.3%	-1.1%	0.3%	1.4%	0.9%	0.7%	1.3%	3.3%				

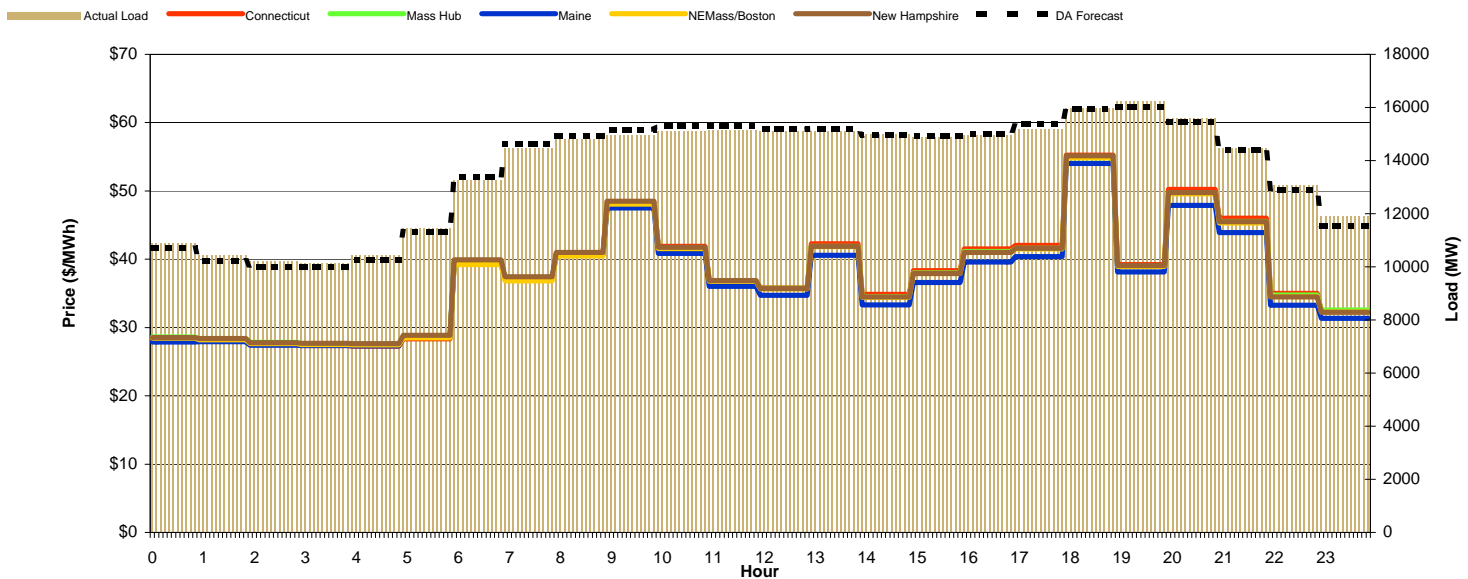




ISO-NE Daily Report

Thursday October 14, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	30.27	28.57	26.83	26.74	27.95	30.00	36.11	38.34	38.49	40.39	41.24	43.65	42.19	42.42	40.52	38.97	39.75	45.00	51.12	48.47	40.00	36.94	33.35	32.27	37.48	41.30	All	On Pk
NEMass/Boston	30.17	28.51	26.80	26.79	28.00	30.07	35.72	37.73	38.08	39.83	40.63	42.91	41.54	41.66	39.82	38.31	39.03	44.02	50.09	47.61	39.42	36.24	33.00	32.10	37.00	40.62		
New Hampshire	30.21	28.62	26.87	26.88	28.09	30.21	36.40	38.38	38.73	40.34	41.02	43.26	41.89	42.03	40.22	38.69	39.44	44.46	50.75	48.15	39.95	36.57	33.18	32.20	37.36	41.07		
Maine	29.34	27.93	26.23	26.27	27.46	29.48	36.42	38.00	38.56	39.73	40.18	42.09	41.04	41.02	39.21	37.84	38.58	43.13	49.57	46.96	39.01	35.85	32.29	31.34	36.56	40.19		
Mass Hub	30.48	28.77	27.00	26.99	28.21	30.40	36.07	38.09	38.31	40.09	40.88	43.23	41.83	41.96	40.08	38.52	39.25	44.36	50.48	47.96	39.64	36.52	33.25	32.42	37.28	40.90		
Cleared Load (GW)	10.3	9.8	9.4	9.6	9.7	10.4	13.0	14.0	14.3	14.6	14.8	15.0	15.0	14.9	14.7	14.6	14.7	15.0	15.9	15.6	14.8	13.5	11.9	10.9				

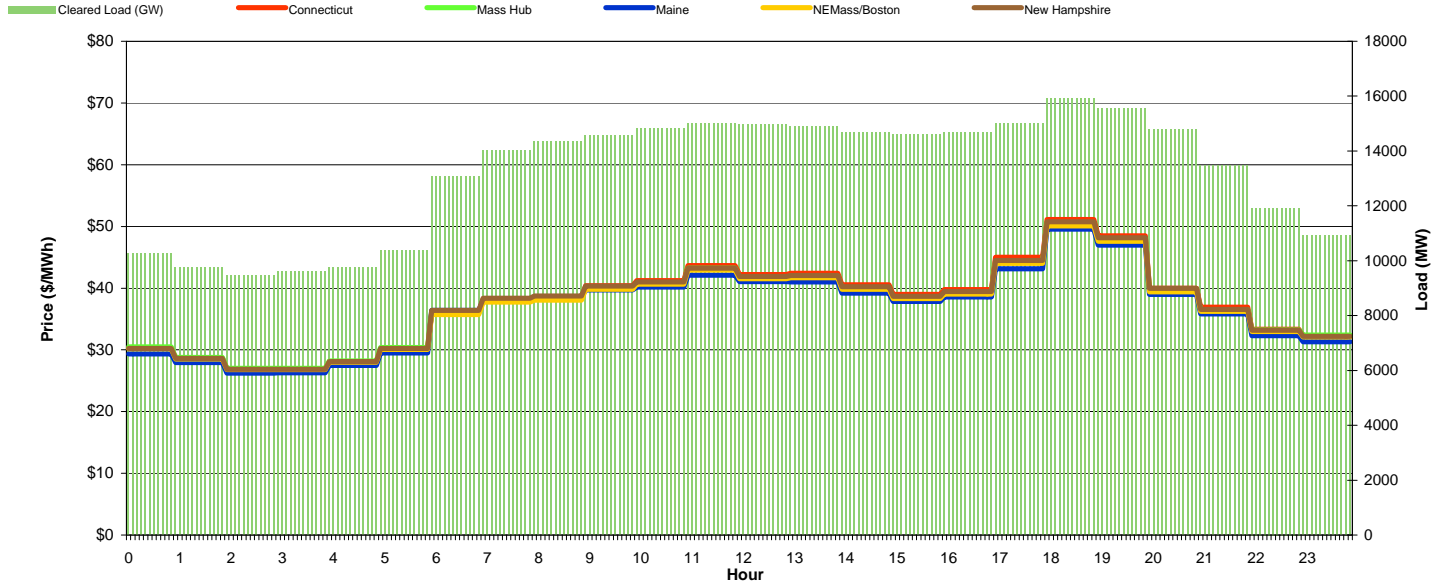

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	31.66	30.11	29.69	28.94	28.84	30.07	35.57	36.34	37.41	37.53	37.93	40.32	39.24	38.93	36.93	37.09	39.15	55.23	67.17	43.63	42.72	33.96	32.90	31.58	37.62	41.03	All	On Pk
NEMass/Boston	31.54	30.16	29.88	29.17	29.08	30.25	35.46	35.93	37.07	37.06	37.42	39.69	38.63	38.28	36.39	36.56	38.58	54.38	66.32	42.96	42.03	33.36	32.46	31.35	37.25	40.45		
New Hampshire	31.53	30.16	29.88	29.18	29.15	30.55	35.98	36.57	37.62	37.56	37.86	40.08	38.95	38.59	36.68	36.81	38.84	54.73	66.83	43.29	42.26	33.36	32.32	31.15	37.50	40.77		
Maine	30.69	29.43	29.19	28.65	28.77	30.39	35.78	36.30	37.33	37.05	37.25	39.26	38.22	37.89	36.14	36.24	38.19	53.80	65.80	42.64	41.19	32.23	30.97	29.77	36.80	40.03		
Mass Hub	31.81	30.36	30.04	29.30	29.18	30.36	35.63	36.11	37.17	37.19	37.57	39.86	38.76	38.43	36.52	36.68	38.69	54.45	66.33	42.96	42.07	33.50	32.64	31.56	37.38	40.56		
DA Forecast Load (GW)	10.70	10.23	10.03	10.00	10.27	11.32	13.43	14.71	15.02	15.24	15.38	15.41	15.36	15.36	15.20	15.11	15.23	15.58	16.20	16.25	15.53	14.46	13.00	11.62				
Forecast Error %	3.1%	2.6%	2.5%	2.6%	2.4%	2.1%	-0.2%	-1.1%	-1.3%	-1.6%	-1.4%	-1.3%	-1.4%	-1.4%	-1.3%	-1.5%	-1.7%	-0.9%	0.7%	0.3%	1.0%	0.9%	0.7%	3.9%				

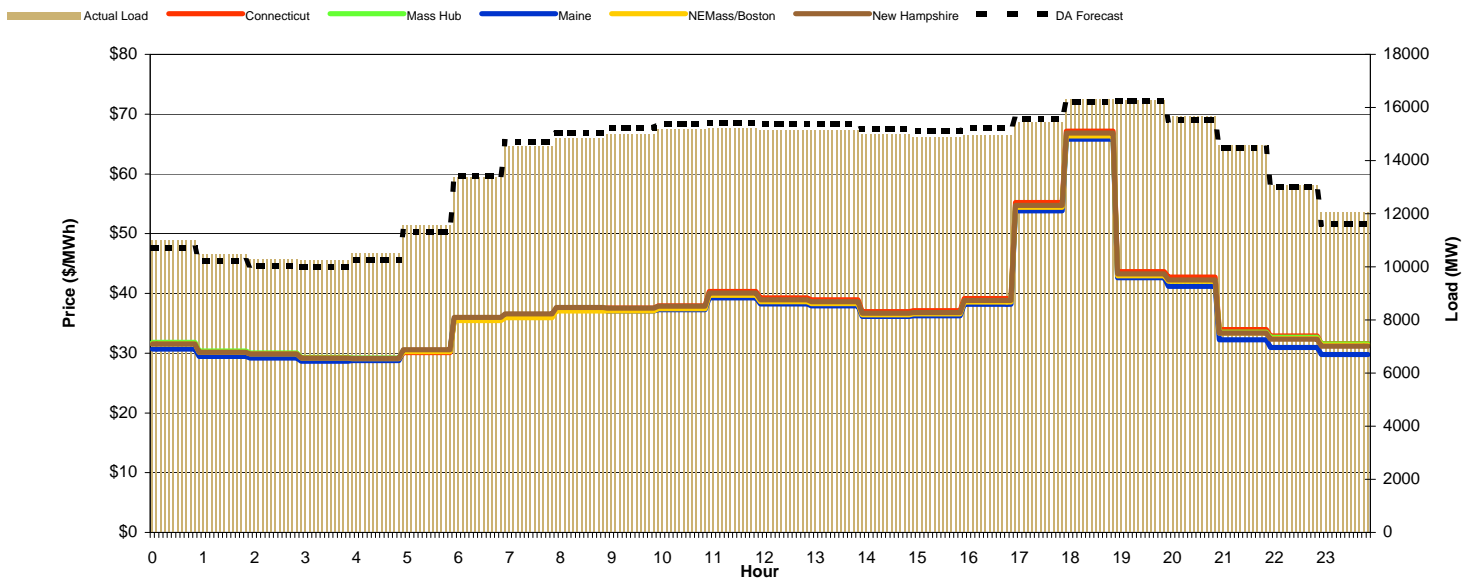




ISO-NE Daily Report

Friday October 15, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	30.00	26.38	19.24	14.91	15.03	30.05	37.15	42.77	42.69	46.50	48.52	45.25	43.71	42.56	42.88	40.36	40.22	42.61	51.44	43.08	41.45	37.24	34.27	32.74	37.13	42.85	All	On Pk
NEMass/Boston	29.70	26.24	19.17	14.87	15.00	29.64	36.26	41.40	41.58	45.15	46.98	43.96	42.44	41.40	41.38	39.06	38.89	41.23	49.66	41.43	40.00	36.19	33.52	32.53	36.15	41.52		
New Hampshire	29.62	26.27	19.20	14.91	15.04	29.73	36.60	42.03	42.23	45.78	47.56	44.44	42.80	41.78	41.72	39.45	39.25	41.53	50.17	41.79	40.34	36.45	33.53	32.63	36.45	41.93		
Maine	28.63	25.60	18.77	14.64	14.72	28.94	36.05	41.15	41.45	44.05	45.40	43.00	41.27	40.42	40.11	38.23	38.17	40.22	48.46	40.69	39.02	35.69	32.60	32.72	35.42	40.62		
Mass Hub	29.95	26.43	19.29	14.95	15.08	29.86	36.73	41.68	41.75	45.35	47.22	44.16	42.63	41.52	41.55	39.21	39.04	41.41	50.03	41.55	40.23	36.37	33.70	32.75	36.35	41.71		
Cleared Load (GW)	10.4	9.7	9.5	9.6	9.7	10.2	12.6	13.4	14.0	14.0	14.3	14.7	14.7	14.7	14.2	14.2	14.2	14.5	15.5	14.8	14.1	13.1	11.9	10.7				

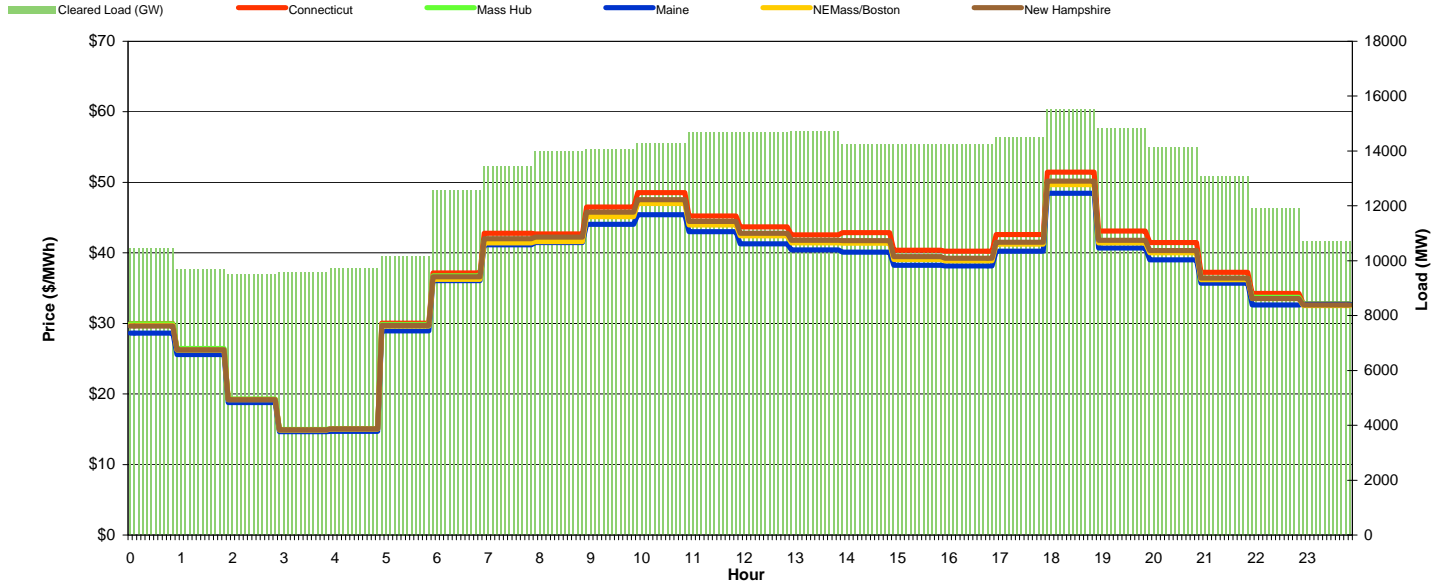

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	34.46	29.30	30.32	29.19	28.98	33.33	38.66	37.97	56.31	63.39	40.92	33.79	33.49	35.15	37.49	34.96	36.73	41.81	45.90	37.43	38.29	37.92	31.59	30.33	37.40	40.20	All	On Pk
NEMass/Boston	34.16	29.07	30.23	29.22	28.99	33.19	38.05	36.96	55.24	62.07	40.15	33.39	33.23	34.78	36.90	34.43	36.20	41.22	45.04	36.87	37.60	37.21	31.19	30.17	36.90	39.53		
New Hampshire	34.02	28.99	30.22	29.21	28.93	33.24	38.15	37.12	55.54	62.39	40.27	33.41	33.18	34.77	36.96	34.45	36.26	41.29	45.13	36.87	37.59	37.07	30.88	29.80	36.91	39.57		
Maine	32.93	28.07	29.58	28.67	28.26	32.40	37.14	35.97	54.12	60.49	39.04	32.20	31.82	33.42	35.53	32.95	34.73	39.68	43.58	35.52	36.00	35.56	29.34	28.37	35.64	38.12		
Mass Hub	34.41	29.29	30.39	29.32	29.10	33.36	38.30	37.26	55.51	62.39	40.33	33.47	33.28	34.88	37.06	34.57	36.34	41.37	45.22	37.01	37.78	37.43	31.34	30.28	37.07	39.70		
DA Forecast Load (GW)	10.83	10.29	10.04	9.97	10.20	11.20	13.24	14.59	15.03	15.35	15.53	15.55	15.46	15.35	15.18	15.07	15.17	15.47	16.10	15.79	15.12	14.25	13.09	11.87				
Forecast Error %	2.8%	3.4%	0.3%	0.5%	-0.1%	-1.0%	-0.8%	-0.3%	-0.2%	-0.7%	-0.6%	-0.6%	-0.9%	-0.7%	-0.9%	-1.1%	-1.1%	-0.9%	-1.1%	-0.5%	-0.1%	0.1%	0.0%	0.0%				

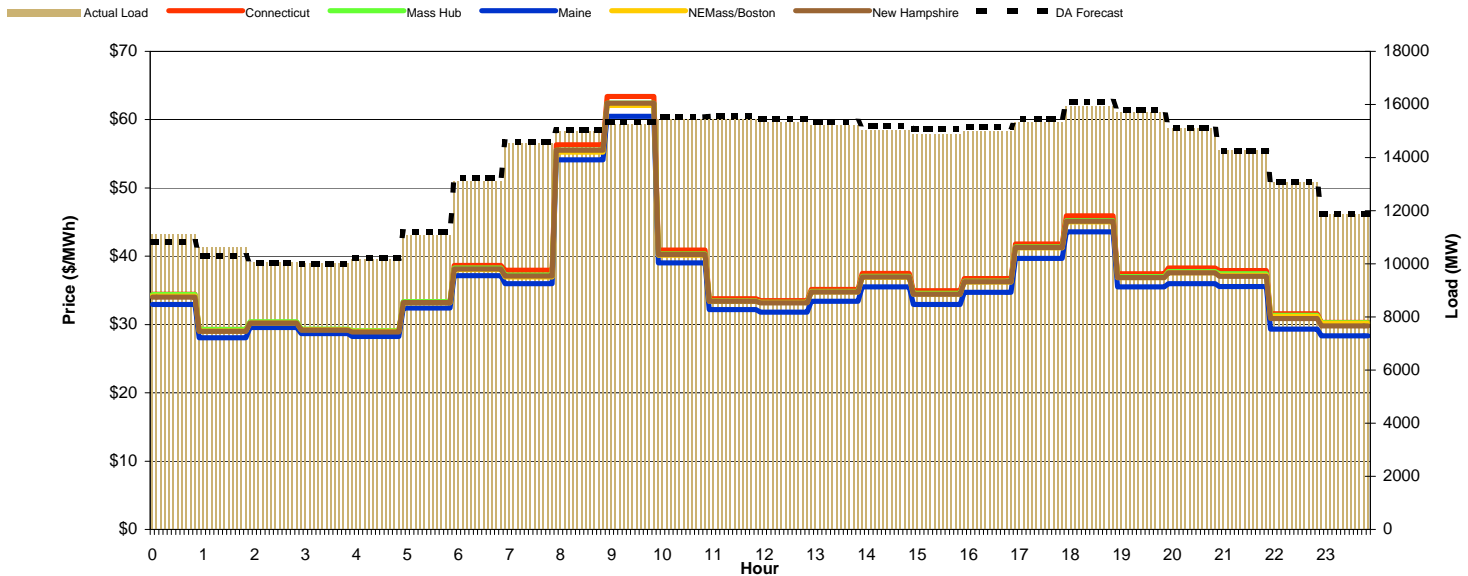




ISO-NE Daily Report

Saturday October 16, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	32.77	29.71	26.46	24.95	25.00	28.01	31.73	33.99	36.66	38.96	41.25	40.79	36.74	35.85	35.83	35.74	36.14	41.72	48.91	44.09	39.68	36.37	34.28	32.97	35.36	38.56	All	On Pk
NEMass/Boston	32.74	29.83	26.55	25.08	25.10	28.23	31.87	33.68	36.10	38.28	40.40	39.80	35.95	35.09	35.07	34.96	35.26	40.65	57.00	48.92	38.78	35.63	33.88	32.95	35.49	38.72		
New Hampshire	32.78	29.91	26.61	25.11	25.16	28.34	31.97	33.89	36.42	38.60	40.64	40.05	36.17	35.30	35.34	35.25	35.57	40.90	48.04	43.22	39.10	35.85	34.24	33.31	35.07	38.04		
Maine	32.09	29.32	26.19	24.73	24.72	27.96	31.71	33.21	36.05	37.98	39.81	39.18	35.58	34.61	34.59	34.49	34.90	39.96	46.83	42.15	38.27	35.23	33.45	33.02	34.42	37.27		
Mass Hub	32.95	30.00	26.63	25.15	25.17	28.34	32.00	33.73	36.23	38.48	40.65	40.07	36.11	35.24	35.23	35.10	35.43	40.89	47.94	43.08	38.94	35.75	33.91	33.14	35.01	37.92		
Cleared Load (GW)	10.2	9.9	9.3	9.3	9.3	9.9	10.1	10.9	12.3	13.2	13.4	13.3	13.0	12.6	12.4	12.4	12.6	13.2	14.0	13.4	13.2	12.3	11.2	10.3				

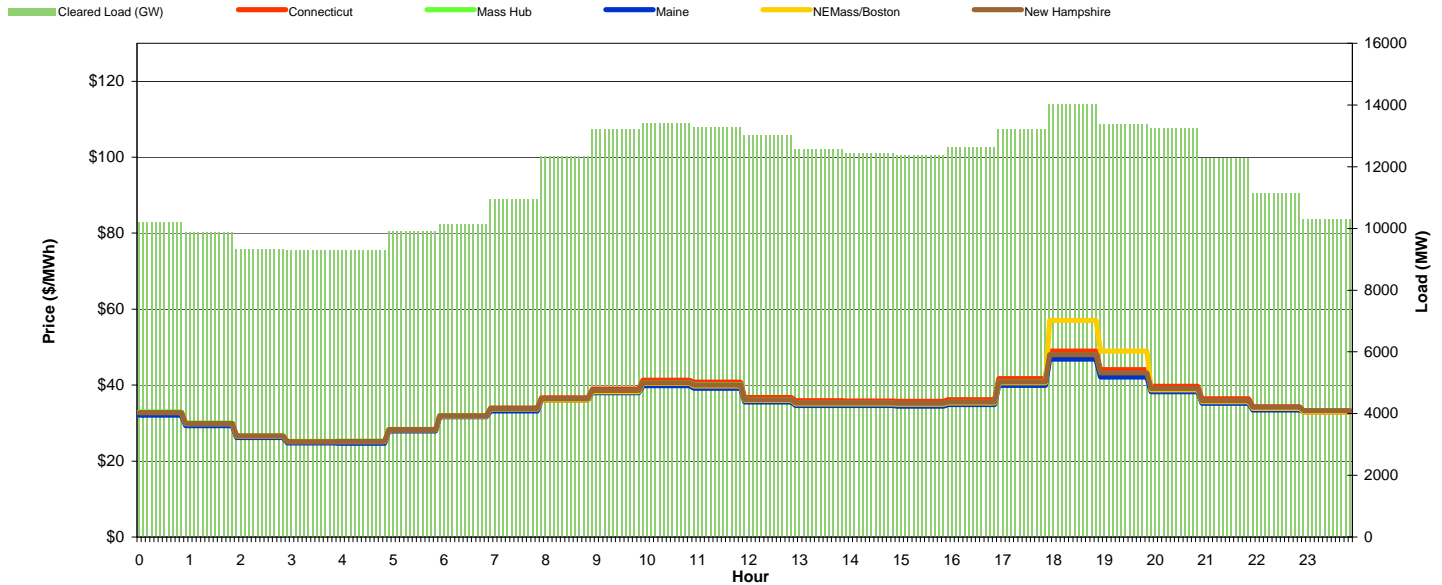

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	35.51	29.22	27.91	27.05	27.12	30.49	55.15	55.64	120.23	29.07	36.44	37.36	36.60	33.39	32.04	31.26	28.95	32.81	37.03	37.17	32.54	31.76	38.33	31.12	38.09	40.66	All	On Pk
NEMass/Boston	35.56	29.31	28.05	27.25	27.39	30.82	55.46	55.54	119.17	28.74	36.00	36.80	36.02	32.88	31.63	30.95	28.64	32.45	36.58	36.56	32.16	31.38	37.99	31.10	37.85	40.22		
New Hampshire	35.38	29.22	28.00	27.17	27.34	30.84	55.58	55.69	119.81	28.99	36.12	36.86	36.04	32.89	31.66	30.99	28.65	32.57	36.76	36.66	32.23	31.34	37.86	31.12	37.91	40.32		
Maine	34.12	28.22	27.23	26.41	26.67	30.13	54.29	53.94	115.78	28.13	35.06	35.96	35.26	32.18	30.98	30.30	27.94	31.86	35.95	35.89	31.57	30.69	36.61	30.40	36.90	39.26		
Mass Hub	35.65	29.38	28.11	27.28	27.40	30.85	55.59	55.75	119.74	28.86	36.17	36.99	36.19	33.03	31.75	31.05	28.72	32.54	36.68	36.70	32.24	31.48	38.14	31.19	37.98	40.38		
DA Forecast Load (GW)	11.04	10.49	10.19	10.05	10.11	10.46	11.27	12.18	13.23	13.92	14.19	14.13	13.94	13.66	13.44	13.33	13.47	13.94	14.85	14.90	14.37	13.64	12.68	11.66				
Forecast Error %	-1.3%	-1.2%	-1.6%	-1.5%	-1.7%	-1.6%	-1.6%	-2.1%	-2.1%	-2.2%	-2.1%	-1.5%	-1.3%	-1.2%	-1.1%	-1.2%	-1.4%	-1.8%	-2.0%	-2.1%	-1.7%	-1.4%	-1.4%	-1.2%				

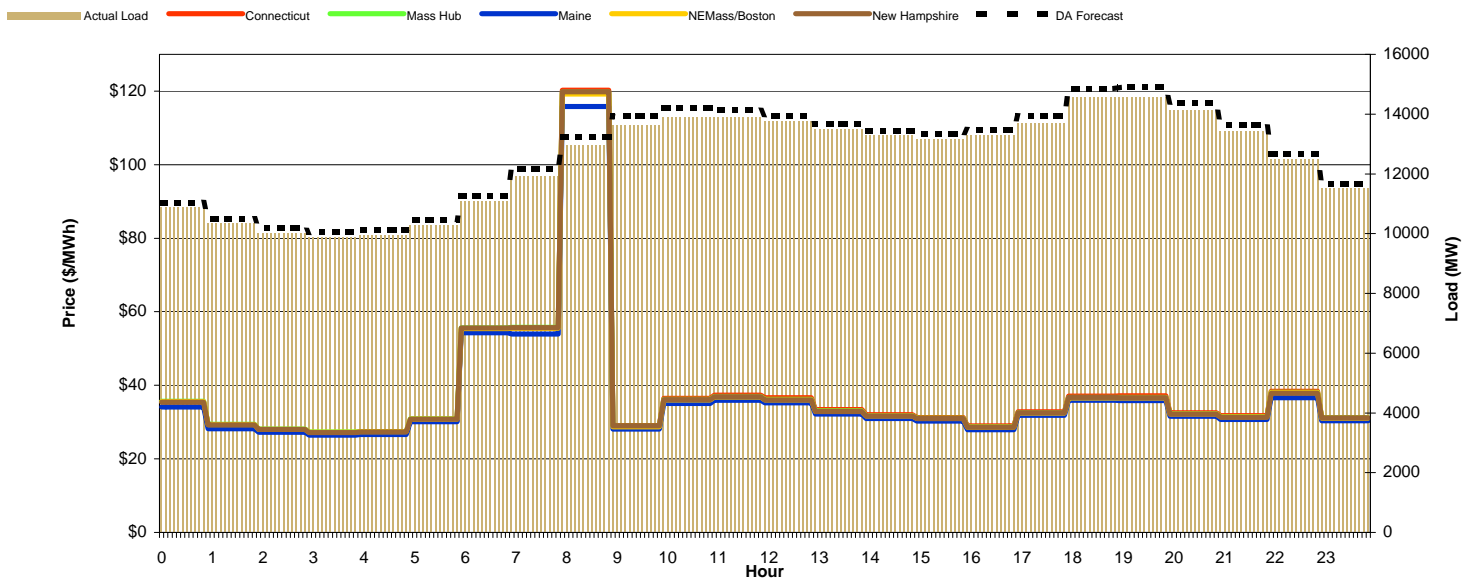




ISO-NE Daily Report

Sunday October 17, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	32.40	27.93	26.88	26.73	26.15	28.58	28.81	32.85	34.13	36.36	36.23	36.56	35.97	35.52	33.54	34.62	35.85	42.96	52.90	47.36	42.79	36.13	33.31	30.39	34.79	37.94	All	On Pk
NEMass/Boston	32.42	28.12	27.13	26.97	26.35	28.72	29.02	32.71	33.82	35.86	35.60	35.88	35.33	34.94	33.02	34.04	35.10	41.87	51.69	46.30	41.73	35.38	32.99	30.40	34.39	37.27		
New Hampshire	32.68	28.36	27.24	27.12	26.50	28.92	29.31	33.16	34.11	36.10	35.84	36.09	35.56	35.16	33.36	34.27	35.36	42.15	52.08	46.45	41.91	35.48	33.23	30.55	34.62	37.52		
Maine	32.17	28.07	26.74	26.88	26.26	28.57	29.18	33.02	33.82	35.83	35.31	35.54	34.97	34.46	32.97	33.45	34.71	41.06	50.51	44.86	40.59	34.67	32.44	29.95	34.00	36.76		
Mass Hub	32.75	28.33	27.28	27.13	26.52	29.04	29.26	32.93	34.11	36.12	35.75	36.06	35.45	35.00	33.11	34.21	35.26	42.18	52.08	46.53	42.00	35.61	33.06	30.50	34.59	37.47		
Cleared Load (GW)	10.2	9.8	9.4	9.2	9.1	9.7	9.8	10.5	11.7	12.4	12.3	12.6	12.4	12.0	12.0	12.1	12.6	13.4	14.3	13.7	13.3	12.2	10.8	10.0				

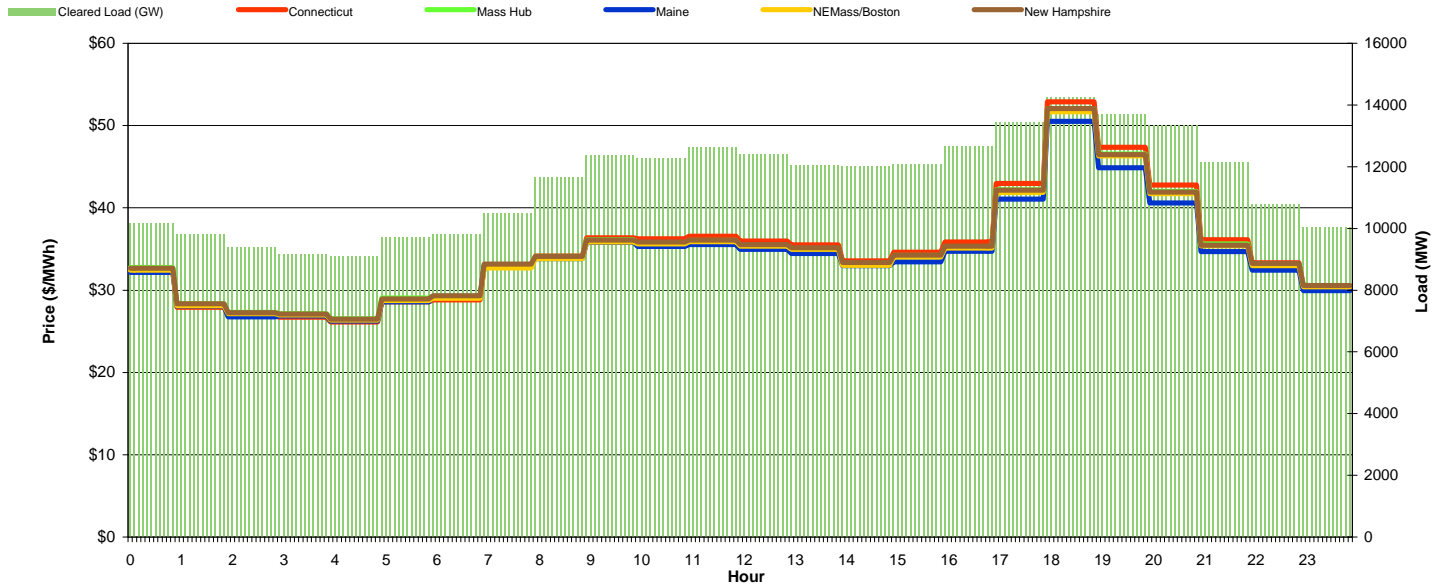

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	30.47	28.21	27.26	26.94	27.05	30.30	28.94	29.56	35.13	33.05	36.17	36.02	36.42	35.28	34.18	35.28	31.50	32.85	51.76	36.18	34.33	34.05	32.74	29.04	33.03	35.28	All	On Pk
NEMass/Boston	30.62	28.46	27.60	27.30	27.42	30.65	29.25	29.71	35.00	32.85	35.75	35.49	35.90	34.89	33.92	35.03	31.25	32.63	51.09	35.61	33.95	33.54	32.56	29.16	32.90	34.95		
New Hampshire	30.73	28.49	27.58	27.30	27.44	30.69	29.36	29.90	35.15	32.98	35.72	35.41	35.75	34.71	33.77	34.90	31.18	32.71	51.20	35.71	33.87	33.36	32.48	29.05	32.89	34.93		
Maine	30.15	27.94	27.05	26.94	27.11	30.25	29.13	29.85	34.58	32.58	34.89	34.51	34.68	33.60	32.68	34.12	30.39	32.03	49.60	35.06	33.09	32.33	31.63	28.30	32.19	34.10		
Mass Hub	30.69	28.48	27.58	27.27	27.39	30.65	29.26	29.76	35.13	32.97	35.92	35.68	36.08	35.04	34.03	35.14	31.34	32.70	51.20	35.74	34.02	33.66	32.61	29.16	32.98	35.06		
DA Forecast Load (GW)	10.73	10.20	9.90	9.77	9.81	10.03	10.55	11.16	12.14	12.80	13.11	13.23	13.25	13.08	12.93	12.87	13.14	13.71	14.71	14.83	14.39	13.47	12.30	11.18				
Forecast Error %	-0.8%	-1.0%	-1.0%	-0.9%	-1.2%	-0.9%	-0.5%	-0.7%	-0.5%	0.0%	-0.1%	0.0%	0.4%	1.0%	1.1%	1.6%	1.0%	1.2%	1.6%	1.4%	0.4%	-0.4%	-0.8%	-0.9%				

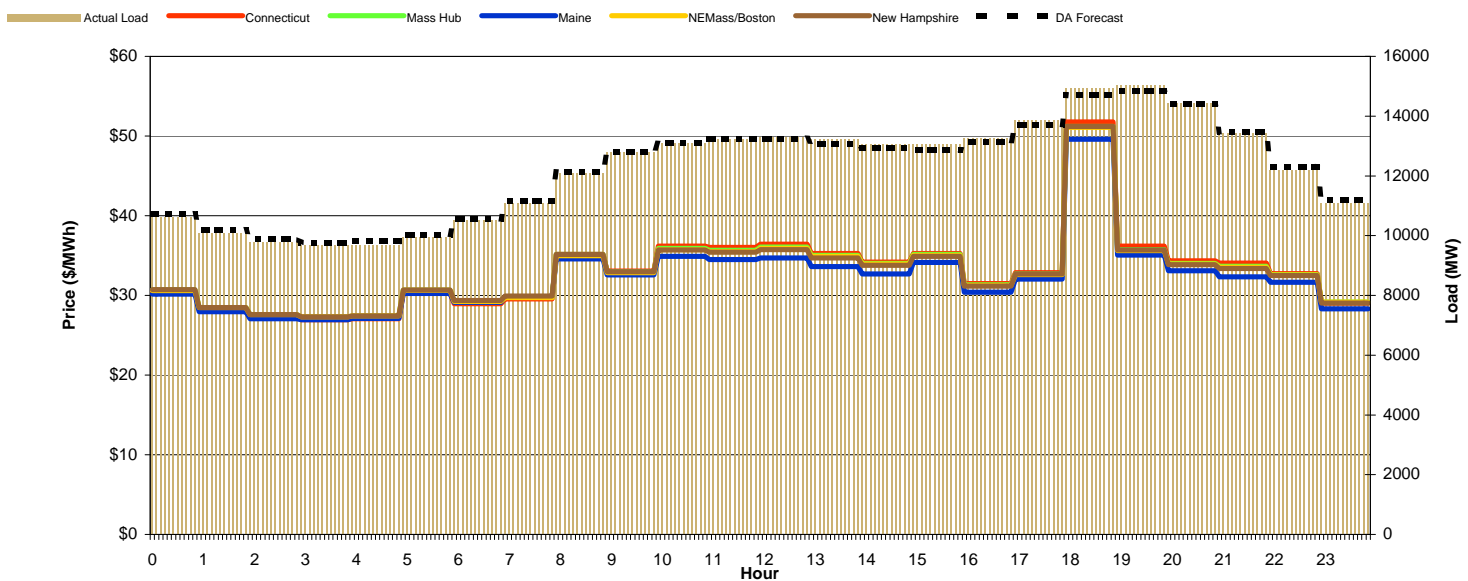




ISO-NE Daily Report

Monday October 18, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	26.90	25.75	17.59	14.37	24.28	29.03	37.01	38.50	39.81	43.37	43.18	42.58	41.13	39.64	39.17	38.27	40.45	47.84	61.22	48.76	40.52	36.85	34.48	32.78	36.81	42.24	All	On Pk
NEMass/Boston	27.13	25.99	17.73	14.49	24.43	29.30	36.48	37.67	38.84	42.51	42.26	41.62	40.22	38.78	38.21	37.36	39.42	46.72	59.51	47.64	39.54	36.06	33.85	32.77	36.19	41.26		
New Hampshire	27.17	25.98	17.75	14.53	24.46	29.44	36.95	38.12	39.23	42.82	42.56	41.87	40.43	39.02	38.45	37.59	39.60	46.98	60.03	47.95	39.84	36.35	33.96	32.87	36.41	41.55		
Maine	26.70	25.39	17.37	14.24	23.92	29.00	36.32	37.32	38.32	41.58	41.22	40.41	39.00	37.85	37.29	36.51	38.24	45.19	57.56	46.03	38.48	35.60	32.82	32.26	35.36	40.21		
Mass Hub	27.16	26.02	17.76	14.51	24.46	29.33	36.82	37.83	38.99	42.69	42.44	41.73	40.34	38.90	38.36	37.51	39.58	46.86	59.79	47.77	39.66	36.18	33.95	32.88	36.31	41.41		
Cleared Load (GW)	9.7	9.4	9.3	9.3	9.3	10.0	12.6	13.8	14.2	14.4	14.5	14.5	14.4	14.4	14.1	14.0	14.2	14.5	15.3	15.1	14.3	13.2	11.7	10.3				

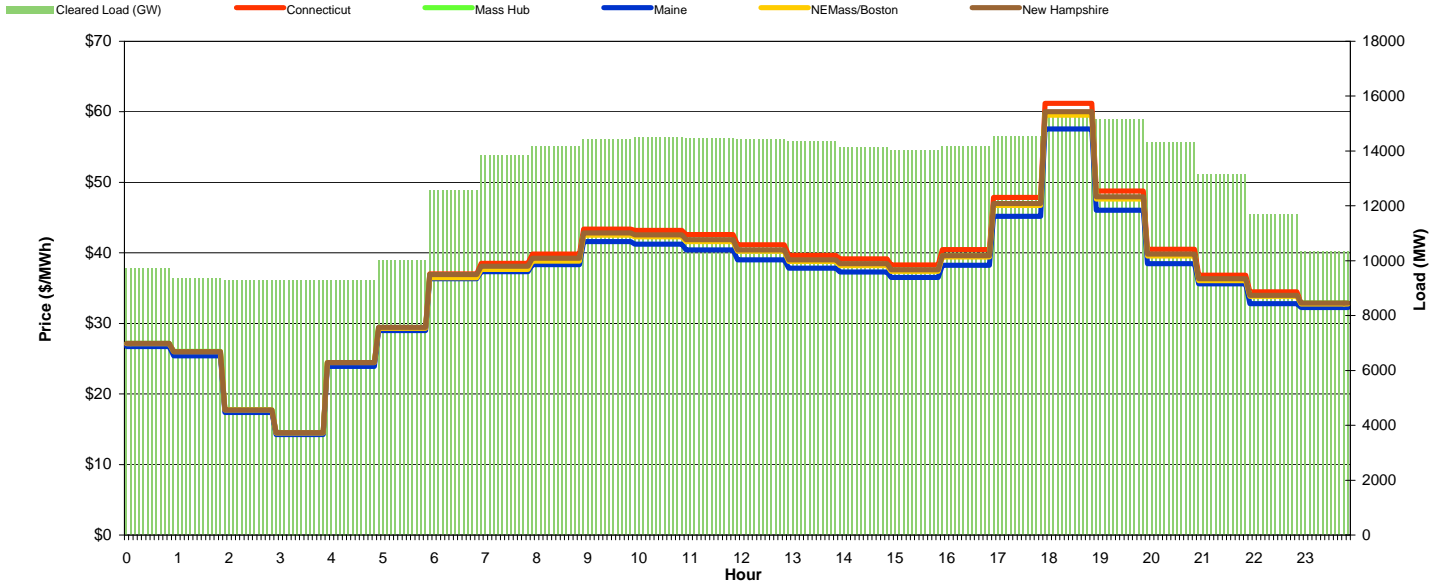

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	27.91	25.90	24.46	25.94	26.11	26.17	34.98	31.93	36.51	36.77	33.79	37.73	38.41	36.35	33.88	32.69	36.03	39.90	57.63	39.51	41.53	33.14	28.21	27.03	33.85	37.13	All	On Pk
NEMass/Boston	28.21	26.23	24.81	26.25	26.35	26.37	34.67	31.36	35.83	36.23	33.34	37.03	37.44	35.50	33.21	32.09	35.30	39.08	56.25	38.75	40.55	32.55	27.80	26.79	33.42	36.39		
New Hampshire	28.09	26.15	24.73	26.17	26.27	26.29	34.76	31.45	35.93	36.27	33.44	37.11	37.51	35.52	33.22	32.06	35.29	39.12	56.48	38.93	40.63	32.58	27.69	26.62	33.43	36.45		
Maine	27.47	25.57	24.23	25.56	25.62	25.70	33.86	30.35	34.54	34.96	32.28	35.79	36.16	34.07	31.71	30.56	33.62	37.36	53.82	37.45	38.71	31.25	26.41	25.48	32.19	34.94		
Mass Hub	28.19	26.21	24.77	26.23	26.36	26.38	34.82	31.54	36.03	36.40	33.49	37.23	37.69	35.72	33.38	32.24	35.47	39.30	56.46	38.86	40.78	32.75	27.95	26.92	33.55	36.58		
DA Forecast Load (GW)	10.36	9.95	9.81	9.84	10.19	11.28	13.44	14.80	15.13	15.36	15.50	15.50	15.39	15.34	15.14	15.02	15.15	15.66	16.48	16.49	15.86	14.71	13.22	11.85				
Forecast Error %	-1.0%	-1.3%	-1.8%	-2.1%	-2.3%	-2.4%	-2.2%	-2.4%	-2.1%	-2.1%	-1.8%	-1.5%	-1.3%	-1.3%	-1.2%	-1.8%	-1.9%	-1.8%	-0.3%	-0.5%	-1.0%	-1.4%	-1.2%	-1.4%				

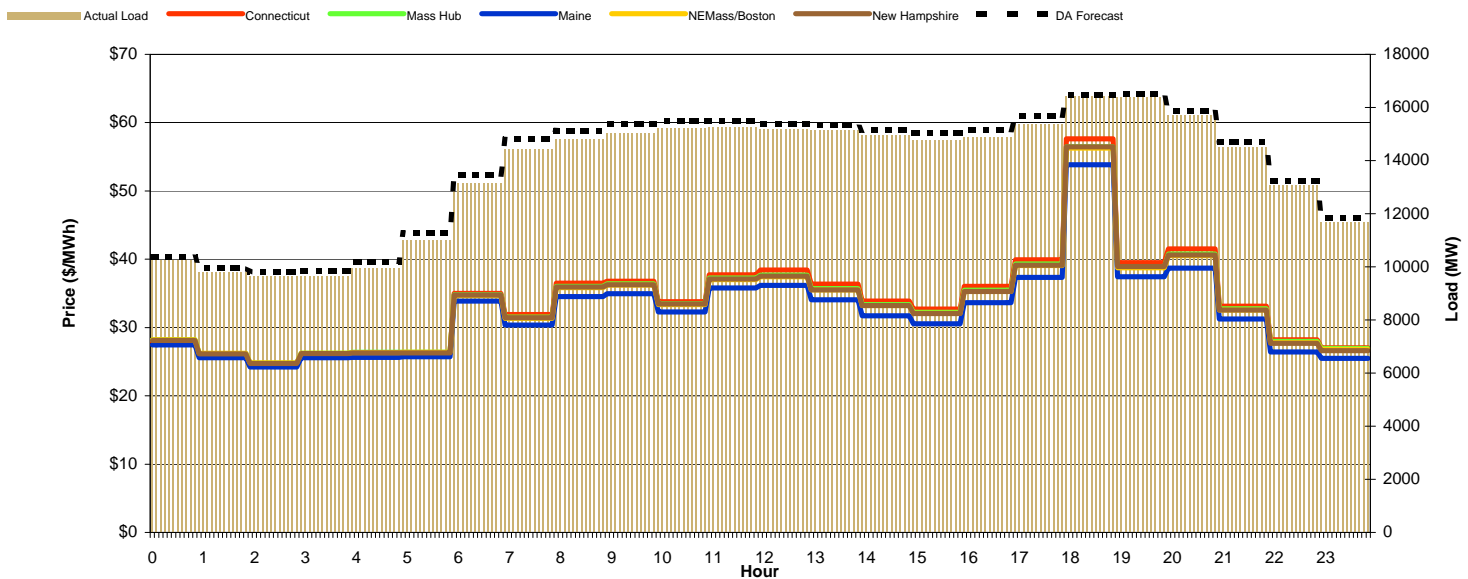




ISO-NE Daily Report

Tuesday October 19, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	29.74	24.54	19.72	18.56	24.27	29.80	35.43	37.75	35.98	37.33	37.36	37.28	38.49	38.04	36.58	36.51	36.54	39.00	51.15	43.09	37.42	35.60	34.31	32.29	34.45	38.28	All	On Pk
NEMass/Boston	30.04	24.76	19.89	18.71	24.48	30.08	34.88	36.54	35.07	36.49	36.54	36.41	37.51	37.07	35.62	35.53	35.59	37.78	49.39	41.70	36.48	34.57	33.47	32.37	33.79	37.24		
New Hampshire	30.13	24.79	19.92	18.75	24.59	30.25	35.30	37.20	35.68	37.07	37.10	36.87	37.91	37.49	36.03	35.92	36.01	38.21	50.19	42.27	36.93	34.84	33.62	32.31	34.14	37.71		
Maine	29.37	24.22	19.50	18.44	24.25	29.88	35.05	37.07	35.65	36.87	36.86	36.61	37.28	36.88	35.41	35.28	35.41	37.62	49.37	41.47	36.40	34.17	32.74	31.69	33.65	37.19		
Mass Hub	30.17	24.89	20.00	18.81	24.60	30.17	35.22	36.87	35.24	36.59	36.66	36.49	37.64	37.20	35.73	35.62	35.73	37.92	49.63	41.80	36.62	34.78	33.63	32.49	33.94	37.38		
Cleared Load (GW)	10.2	10.2	10.1	10.1	10.0	10.5	12.8	13.8	14.3	14.6	14.7	14.6	14.8	14.7	14.4	14.2	14.4	14.9	15.9	15.2	14.6	13.2	11.6	10.2				

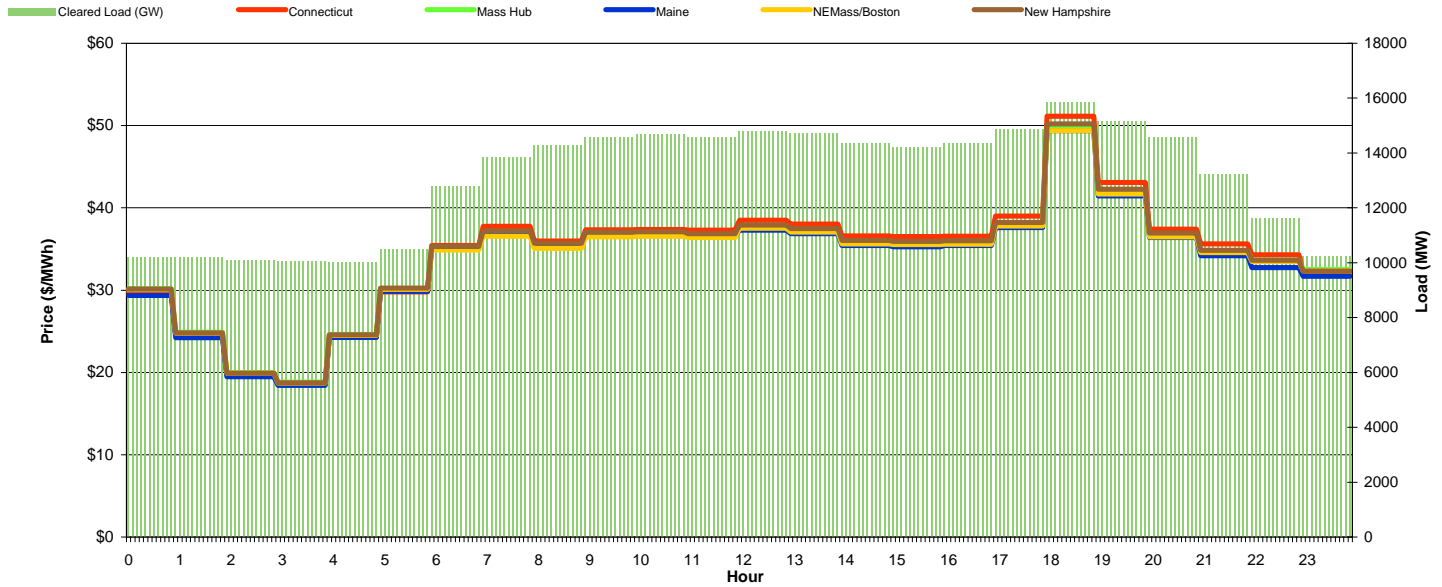

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	27.48	25.00	26.78	26.87	28.80	39.77	39.22	36.21	35.67	34.45	35.67	36.42	36.23	35.64	33.56	34.40	36.26	37.69	54.26	50.44	40.40	35.80	32.57	37.97	35.73	37.85	All	On Pk
NEMass/Boston	27.48	25.18	26.96	27.06	28.99	40.00	38.57	35.12	34.86	33.82	34.97	35.61	35.35	34.78	32.88	33.67	35.39	36.77	52.42	48.87	39.27	34.81	31.80	37.66	35.10	36.90		
New Hampshire	27.35	25.09	26.89	27.02	29.04	40.16	38.99	35.53	35.23	34.13	35.28	35.90	35.58	35.05	33.10	33.91	35.67	37.11	53.16	49.60	39.78	35.06	31.84	37.91	35.35	37.25		
Maine	26.43	24.28	26.10	26.30	28.41	39.35	38.03	34.75	34.53	33.48	34.50	34.97	34.71	34.21	32.30	33.20	34.98	36.41	52.13	48.91	39.07	34.28	30.84	36.98	34.55	36.45		
Mass Hub	27.60	25.26	27.05	27.15	29.09	40.16	38.91	35.44	35.11	34.01	35.18	35.85	35.61	35.03	33.08	33.89	35.64	37.05	52.85	49.25	39.58	35.12	32.08	37.88	35.33	37.17		
DA Forecast Load (GW)	10.83	10.36	10.16	10.14	10.44	11.48	13.53	14.73	15.03	15.26	15.37	15.36	15.28	15.28	15.12	15.12	15.24	15.71	16.49	16.45	15.78	14.65	13.15	11.80				
Forecast Error %	2.0%	1.9%	1.9%	1.9%	1.6%	1.7%	0.3%	1.7%	1.3%	0.0%	-0.6%	-0.7%	-0.9%	-1.2%	-1.3%	-2.1%	-2.3%	-2.5%	-0.5%	0.0%	0.1%	0.3%	0.5%	0.3%				

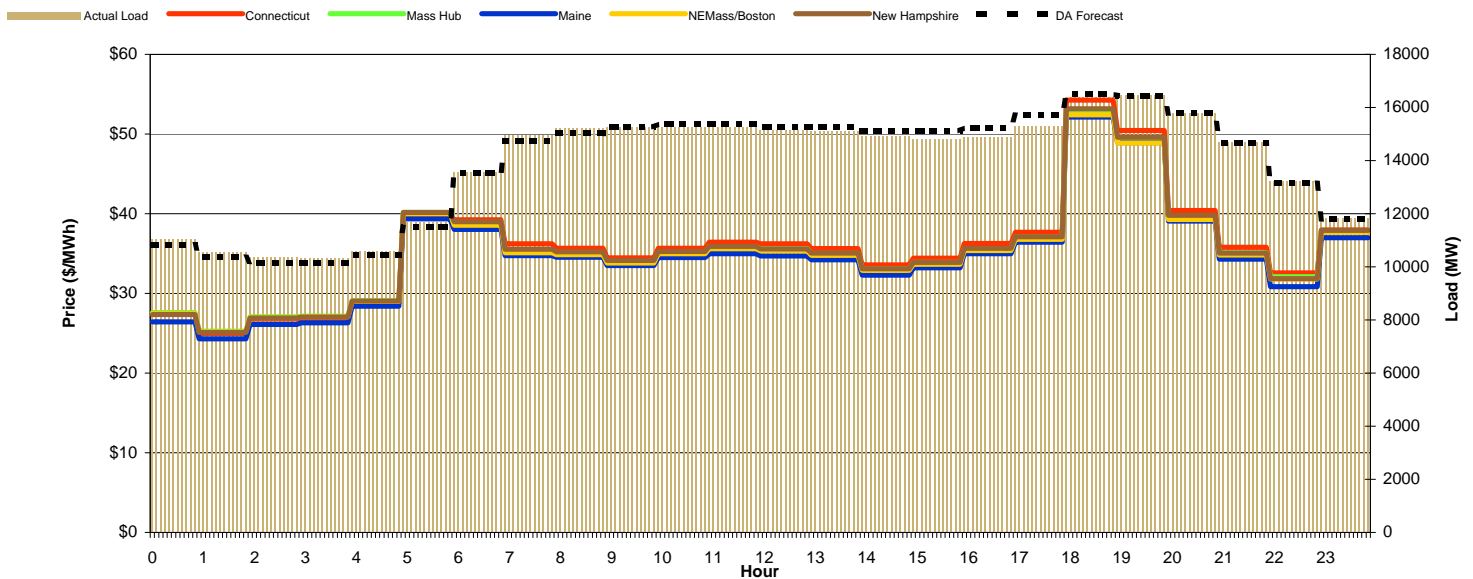




ISO-NE Daily Report

Wednesday October 20, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	29.05	27.85	27.38	26.95	27.47	30.07	36.29	40.98	38.94	37.88	38.67	38.78	40.40	40.38	37.64	37.50	37.97	41.77	57.39	49.28	40.15	36.30	33.56	30.42	36.79	40.47	All	On Pk
NEMass/Boston	29.15	28.20	27.72	27.32	27.90	30.25	35.26	39.33	37.42	36.67	37.38	37.46	38.89	38.89	36.31	36.18	36.65	40.31	55.40	47.48	38.87	35.06	32.88	30.27	35.89	39.07		
New Hampshire	29.41	28.57	28.05	27.66	28.28	30.63	35.98	39.98	37.98	37.16	37.79	37.87	39.28	39.31	36.67	36.53	37.04	40.83	56.42	48.21	39.37	35.35	33.09	30.49	36.33	39.56		
Maine	28.90	27.92	27.45	27.08	27.65	30.22	39.22	38.87	37.11	36.35	36.92	36.98	38.14	38.12	35.66	35.51	36.08	40.12	55.52	47.32	38.50	34.27	32.03	29.87	35.66	38.59		
Mass Hub	29.38	28.42	27.89	27.49	28.07	30.46	35.86	39.82	37.71	36.95	37.70	37.79	39.31	39.30	36.63	36.51	36.98	40.57	55.76	47.64	39.18	35.41	33.09	30.48	36.18	39.40		
Cleared Load (GW)	10.3	9.9	9.6	9.5	9.7	10.5	13.0	13.7	14.1	14.5	14.7	14.7	14.8	14.7	14.4	14.3	14.5	15.0	15.7	14.7	14.5	13.4	11.8	10.5				

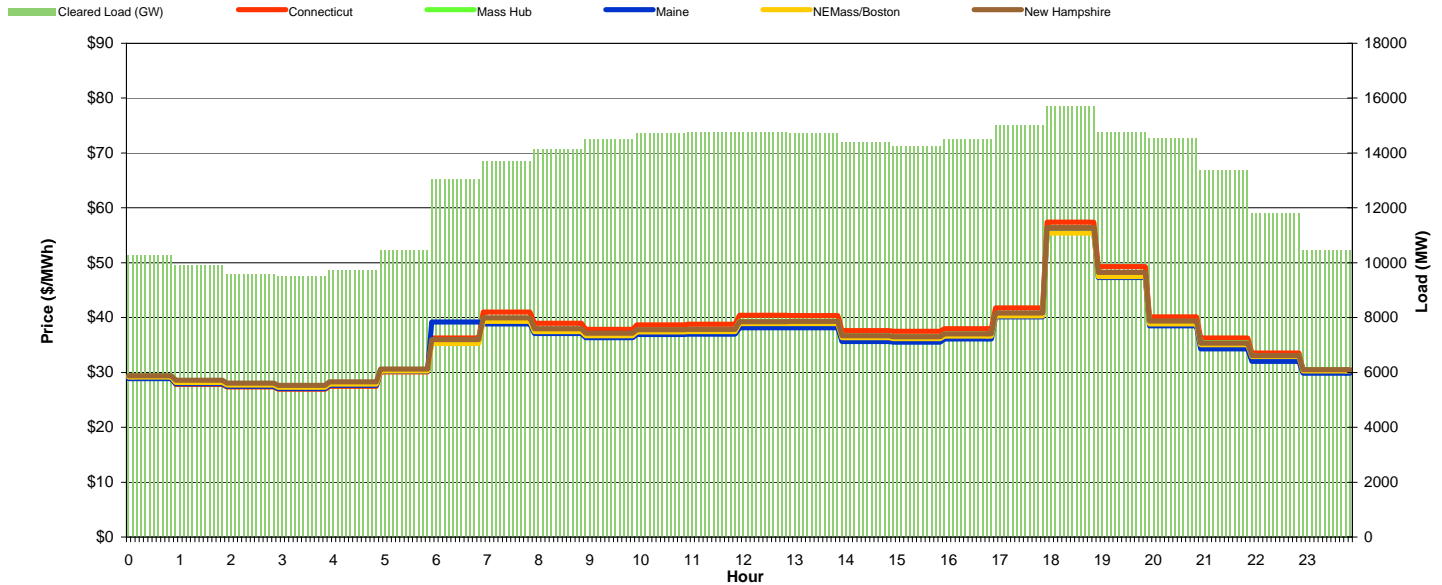

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	34.56	28.79	28.97	28.46	29.03	28.92	50.31	78.60	53.31	39.84	61.07	34.73	36.18	37.56	33.07	34.66	35.88	52.32	42.04	47.86	38.33	38.96	35.33	32.99	40.07	43.73	All	On Pk
NEMass/Boston	34.44	29.02	29.29	28.69	29.24	28.84	48.83	75.68	51.38	38.78	59.69	33.70	35.10	36.41	32.30	33.88	35.12	51.24	40.74	46.08	37.11	37.80	34.74	32.83	39.21	42.48		
New Hampshire	34.80	29.23	29.61	29.00	29.54	29.14	49.75	77.22	52.24	39.33	60.30	33.96	35.26	36.68	32.49	34.05	35.30	51.75	41.39	46.82	37.53	38.14	34.94	33.05	39.65	42.96		
Maine	33.91	28.46	29.03	28.50	29.07	28.75	49.13	75.46	50.10	37.94	57.96	32.68	33.71	35.10	31.05	32.51	33.76	50.16	40.62	45.73	36.43	37.08	33.70	32.11	38.46	41.50		
Mass Hub	34.71	29.18	29.44	28.86	29.42	29.00	49.34	76.59	51.93	39.07	60.17	34.01	35.41	36.71	32.53	34.12	35.35	51.54	41.03	46.51	37.45	38.18	34.98	33.04	39.52	42.85		
DA Forecast Load (GW)	10.90	10.40	10.20	10.18	10.47	11.56	13.68	14.94	15.18	15.32	15.44	15.41	15.33	15.32	15.14	15.04	15.16	15.60	16.41	16.39	15.75	14.63	13.14	11.77				
Forecast Error %	2.7%	3.5%	3.0%	2.8%	2.2%	-0.9%	-0.3%	0.1%	0.0%	-0.5%	-0.7%	-0.5%	-0.5%	-0.5%	-0.7%	-1.2%	-1.5%	-1.1%	-0.3%	-0.3%	-0.5%	-0.3%	-0.3%	2.0%				

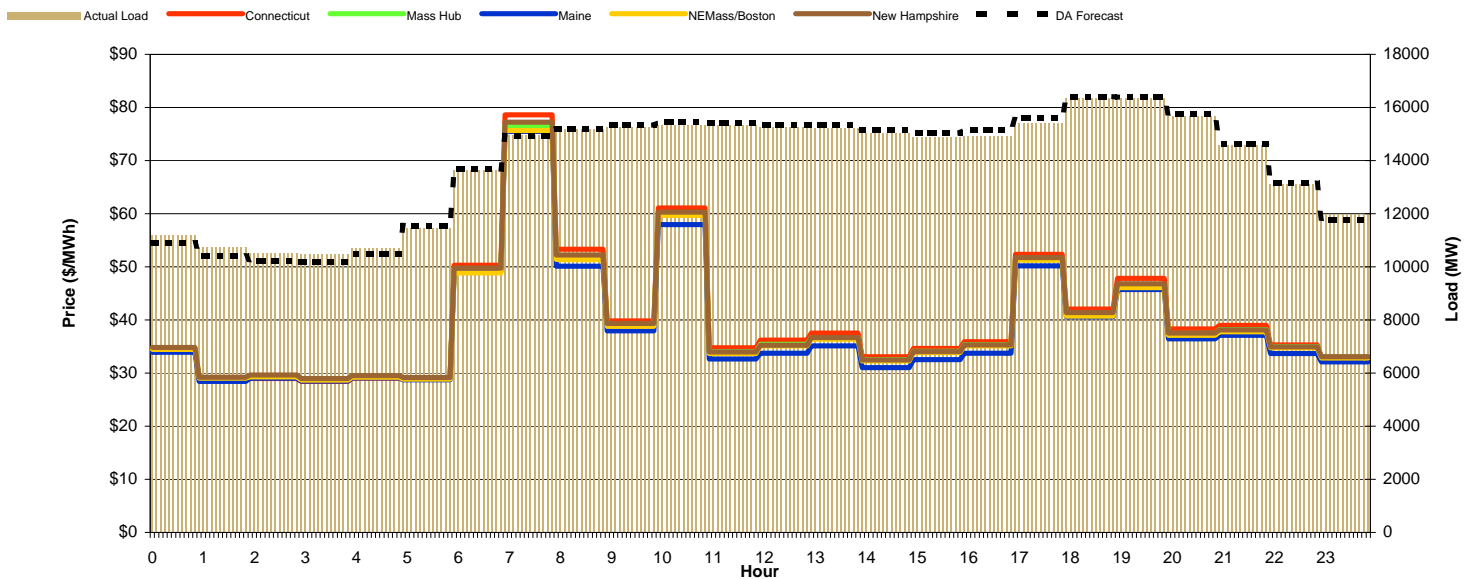




ISO-NE Daily Report

Thursday October 21, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
																									All	On Pk		
Connecticut	30.40	28.00	25.25	25.25	26.99	28.39	37.73	43.72	40.84	40.93	40.54	38.29	37.56	37.63	36.54	36.26	36.39	40.83	55.99	46.90	38.38	36.91	34.33	32.73	36.53	40.13	35.35	38.04
NEMass/Boston	30.45	28.24	25.48	25.46	27.29	28.54	36.64	42.49	43.95	42.68	40.15	38.28	36.64	36.65	35.84	35.39	35.52	39.84	54.39	45.76	37.39	35.88	33.78	32.65	36.22	39.65	34.76	37.13
New Hampshire	30.80	28.52	25.74	25.71	27.62	28.85	37.44	43.28	44.06	42.89	40.67	38.70	37.14	37.13	36.09	35.81	35.93	40.40	55.42	46.43	38.01	36.36	34.06	32.99	36.67	40.15	35.01	37.36
Maine	29.97	27.80	25.11	25.09	26.99	28.34	37.15	42.13	42.55	41.64	39.65	37.81	36.41	36.28	35.36	35.10	35.00	39.41	54.00	44.95	37.05	35.32	32.94	31.99	35.75	39.10	34.02	36.21
Mass Hub	30.70	28.44	25.64	25.58	27.42	28.83	37.42	43.35	46.86	44.79	40.87	39.09	37.01	37.01	35.98	35.72	35.87	40.23	55.05	46.25	37.81	36.35	34.09	32.86	36.80	40.40	35.02	37.43
Cleared Load (GW)	10.3	10.0	9.8	9.6	9.9	10.4	13.4	14.5	15.0	15.2	15.2	15.2	15.2	15.0	14.9	14.8	15.0	15.4	16.5	15.9	15.2	14.0	12.5	10.5				

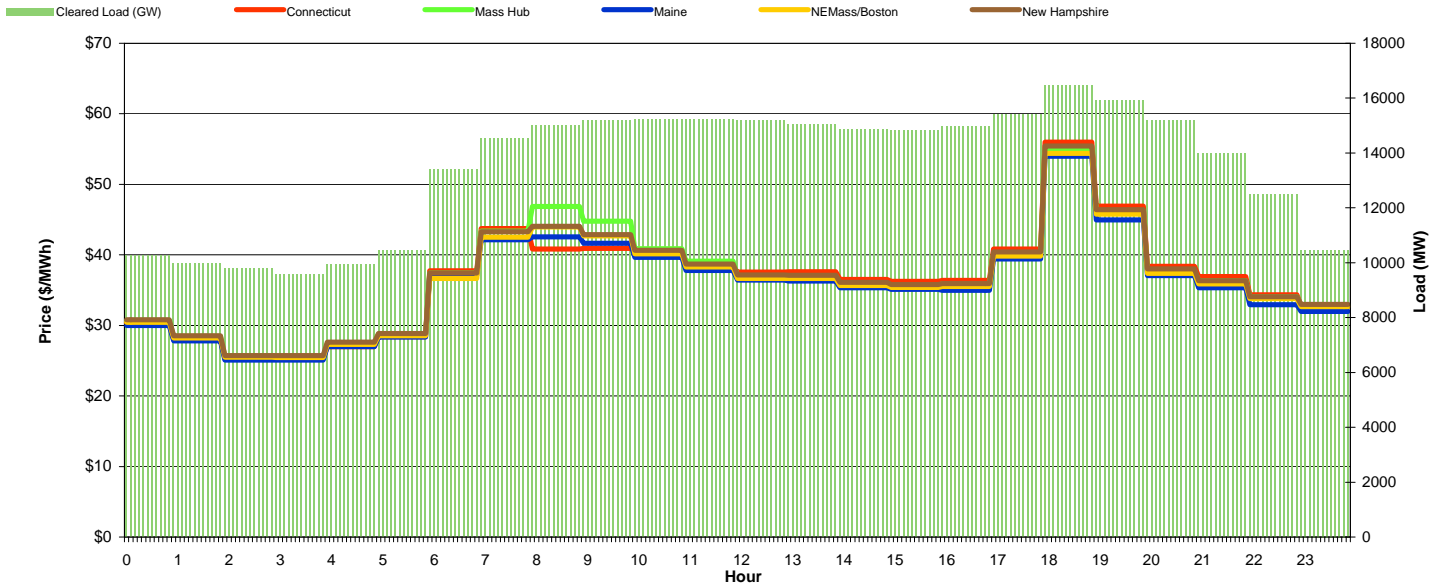

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
																									All	On Pk		
Connecticut	29.64	28.06	28.16	28.19	27.81	29.29	36.48	37.63	39.90	43.66	40.06	36.74	36.94	37.69	34.86	33.81	34.10	35.72	42.46	45.49	42.31	34.85	32.47	32.03	35.35	38.04	35.35	38.04
NEMass/Boston	29.73	28.40	28.48	28.52	28.17	29.37	35.89	36.84	38.85	42.20	38.98	35.90	36.15	36.73	34.04	33.23	33.53	35.15	41.54	44.34	41.03	33.76	31.73	31.71	34.76	37.13	34.76	37.13
New Hampshire	29.98	28.63	28.70	28.75	28.46	29.72	36.45	37.29	39.30	42.57	39.30	36.13	36.33	36.93	34.19	33.38	33.66	35.42	41.94	44.60	41.29	33.86	31.62	31.74	35.01	37.36	35.01	37.36
Maine	29.32	27.96	27.96	28.07	27.97	29.32	36.08	36.51	38.35	41.50	38.26	35.20	35.45	35.84	33.25	32.43	32.42	34.52	40.89	42.65	39.54	32.51	30.01	30.36	34.02	36.21	34.02	36.21
Mass Hub	29.88	28.50	28.58	28.63	28.27	29.53	36.15	37.04	39.21	42.61	39.35	36.21	36.43	37.04	34.31	33.45	33.75	35.40	41.83	44.69	41.45	34.12	32.02	31.93	35.02	37.43	35.02	37.43
DA Forecast Load (GW)	10.84	10.36	10.16	10.13	10.41	11.48	13.64	14.96	15.25	15.40	15.46	15.43	15.34	15.30	15.13	15.03	15.13	15.53	16.46	16.38	15.75	14.69	13.26	11.92				
Forecast Error %	2.5%	2.6%	2.5%	2.4%	2.4%	1.6%	-0.8%	-1.4%	-0.8%	0.1%	1.0%	1.6%	1.7%	1.6%	1.0%	0.7%	0.3%	-0.2%	0.0%	0.5%	0.8%	0.7%	0.4%	0.2%				

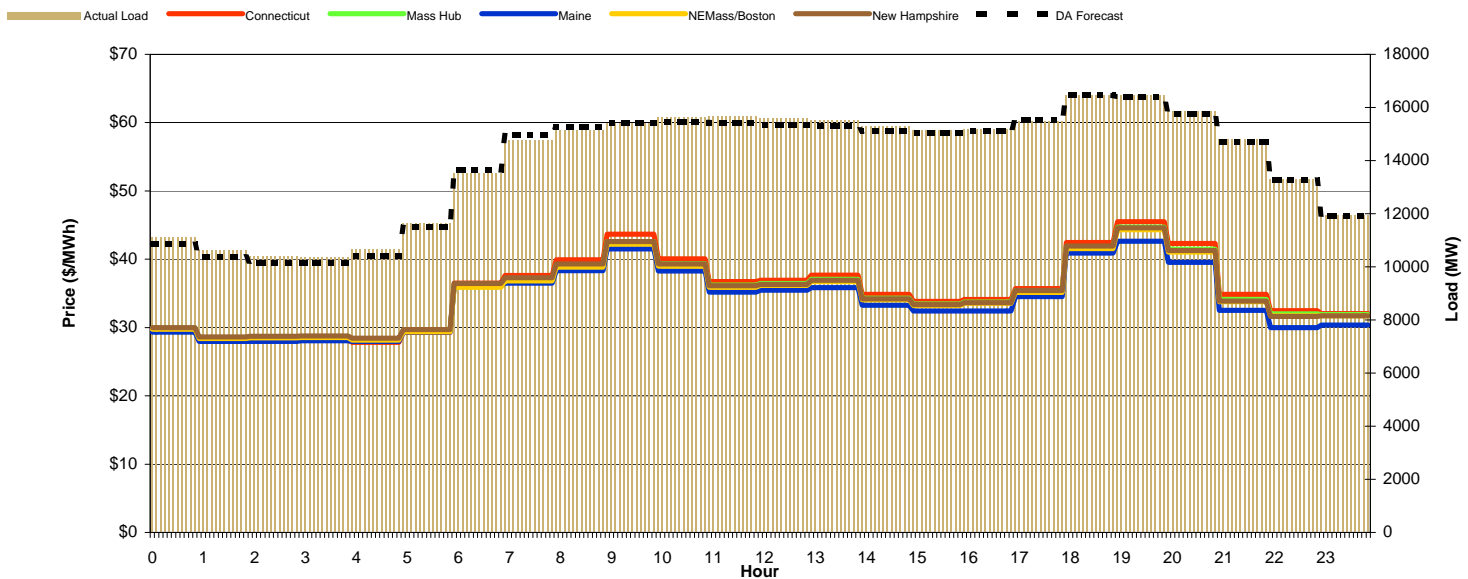




ISO-NE Daily Report

Friday October 22, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	33.06	30.49	28.12	27.93	29.78	32.61	39.94	45.84	47.02	47.09	45.00	42.95	38.05	37.64	37.29	37.07	37.45	45.02	51.12	45.42	38.37	36.86	34.55	32.77	38.39	41.67	All	On Pk
NEMass/Boston	33.12	30.78	28.47	28.32	30.15	32.80	38.84	44.69	45.75	45.74	43.74	41.72	36.90	36.38	36.21	36.09	36.38	42.85	49.10	43.72	37.20	35.91	33.89	32.68	37.56	40.39		
New Hampshire	33.53	31.13	28.82	28.67	30.49	33.19	39.60	45.38	46.31	46.27	44.17	42.20	37.29	36.70	36.48	36.36	36.69	43.17	49.50	44.04	37.55	35.98	33.88	32.71	37.92	40.75		
Maine	32.71	30.38	28.26	28.17	29.79	32.75	39.00	44.00	44.87	44.80	42.81	41.26	36.67	35.95	35.60	35.57	35.86	41.72	47.76	42.52	36.65	34.83	32.61	31.80	36.93	39.59		
Mass Hub	33.38	31.00	28.62	28.46	30.41	33.10	39.56	45.23	46.31	46.31	44.18	42.02	37.16	36.63	36.48	36.35	36.64	43.21	49.57	44.08	37.50	36.23	34.14	32.91	37.90	40.75		
Cleared Load (GW)	10.5	10.2	9.8	9.8	10.1	10.6	13.8	14.7	14.7	14.8	14.9	14.8	14.7	14.5	14.2	14.0	14.3	14.9	15.7	15.0	14.6	13.5	12.3	11.0				

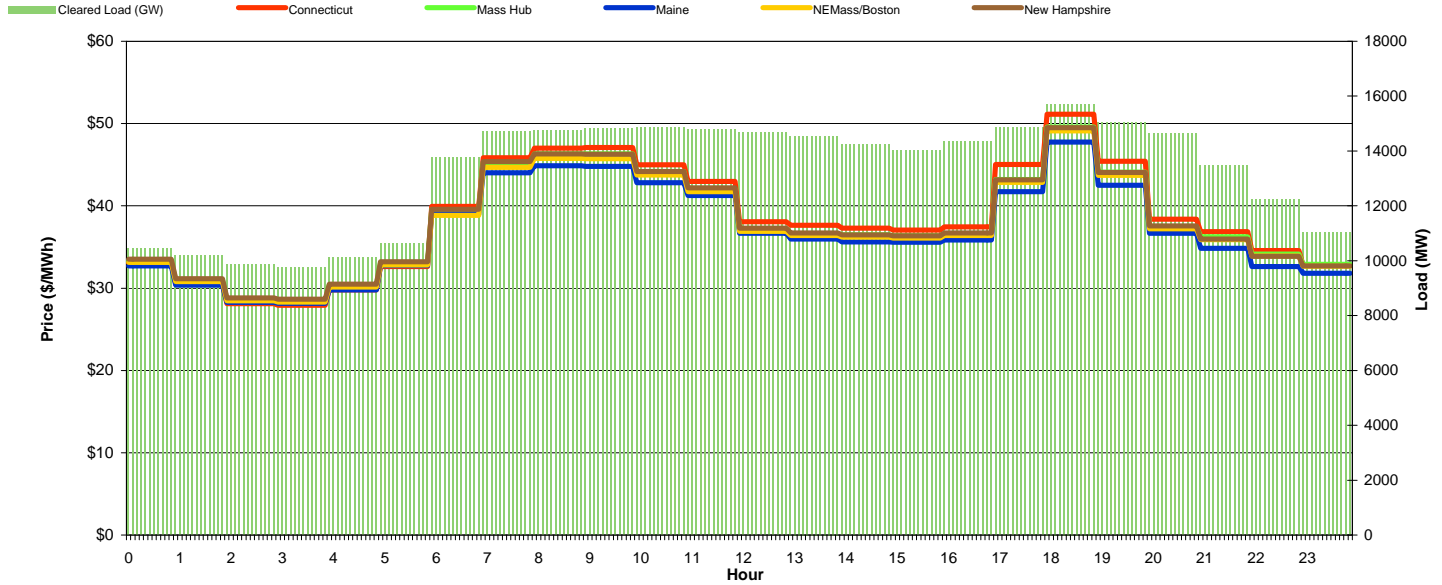

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	33.98	30.44	27.69	26.31	26.23	26.73	33.57	34.30	33.37	33.84	34.15	33.66	32.06	33.66	31.92	31.26	32.46	34.40	38.60	37.82	41.24	38.44	34.08	29.62	32.91	34.70	All	On Pk
NEMass/Boston	33.98	30.69	28.06	26.72	26.55	26.78	33.02	33.65	32.89	33.24	33.38	33.01	31.58	33.09	31.48	30.97	32.05	33.91	37.78	36.96	40.03	37.15	33.32	29.35	32.49	34.03		
New Hampshire	34.12	30.82	28.12	26.83	26.64	26.91	33.43	33.97	33.11	33.35	33.43	33.06	31.58	33.11	31.42	30.82	31.88	33.78	37.67	36.79	39.95	37.04	33.04	29.13	32.50	34.00		
Maine	32.81	29.76	27.22	26.05	25.92	26.18	32.64	32.90	31.98	32.05	31.73	31.52	30.09	31.60	30.02	29.35	30.41	32.17	36.02	35.03	38.40	35.46	31.39	27.88	31.19	32.51		
Mass Hub	34.18	30.84	28.14	26.78	26.63	26.90	33.28	33.92	33.11	33.48	33.67	33.28	31.81	33.36	31.71	31.16	32.26	34.13	38.08	37.25	40.42	37.59	33.62	29.52	32.71	34.30		
DA Forecast Load (GW)	11.11	10.66	10.46	10.44	10.77	11.85	14.05	15.41	15.70	15.86	15.91	15.81	15.59	15.46	15.23	15.05	15.13	15.64	16.40	16.12	15.58	14.73	13.54	12.28				
Forecast Error %	1.3%	1.8%	1.8%	1.4%	0.7%	-0.6%	-3.0%	-2.9%	-2.8%	-2.9%	-2.7%	-2.3%	-1.9%	-1.7%	-1.5%	-1.1%	-1.0%	-1.9%	-1.2%	-0.4%	-0.6%	0.1%	0.5%	0.5%				

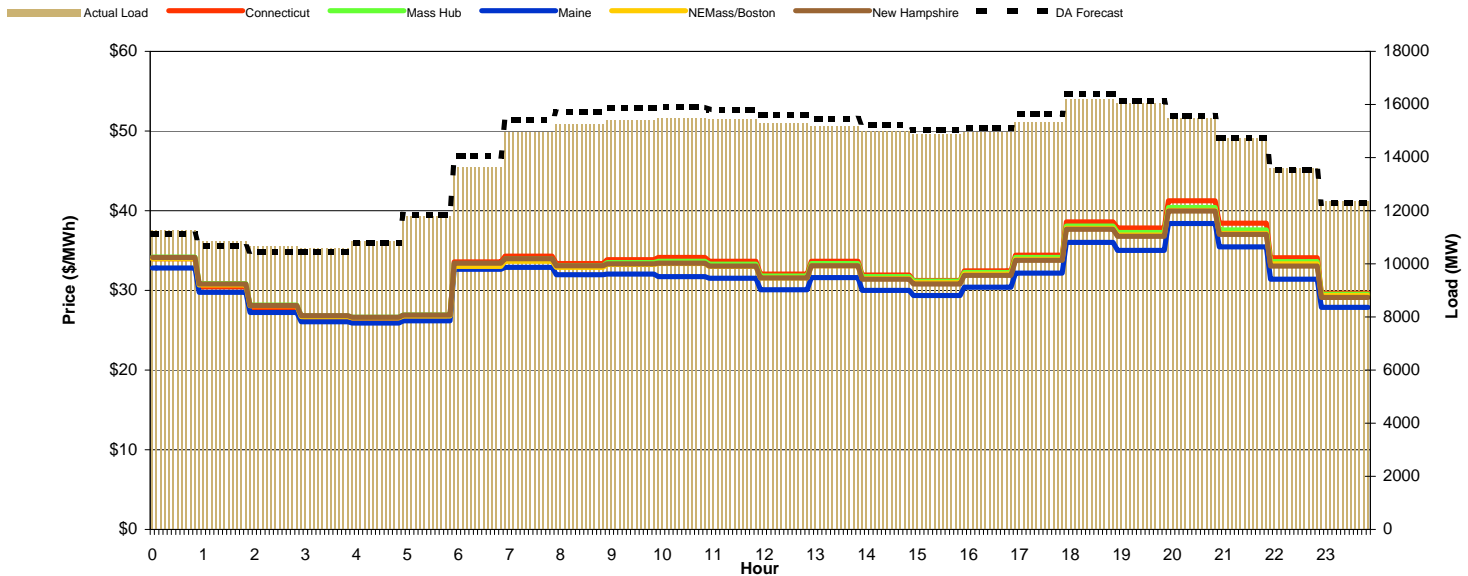




ISO-NE Daily Report

Saturday October 23, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	32.76	28.25	26.19	25.39	25.44	27.31	32.79	33.78	40.09	40.09	42.00	42.00	39.43	34.87	37.01	36.80	37.16	40.82	52.47	41.00	39.06	36.58	32.89	29.63	35.58	39.13	All	On Pk
NEMass/Boston	32.95	28.60	26.57	25.80	25.90	27.67	32.96	33.47	36.14	36.57	36.32	36.22	35.87	33.67	32.62	32.65	32.82	36.14	48.53	40.59	38.52	36.22	32.78	29.65	33.72	36.20		
New Hampshire	33.20	28.82	26.79	26.01	26.12	27.94	33.41	34.02	36.63	36.93	36.71	36.60	36.19	33.98	32.89	32.95	33.16	36.44	48.92	40.92	38.84	36.64	32.99	29.73	34.03	36.55		
Maine	32.13	27.90	26.00	25.28	25.44	27.15	32.58	33.28	35.60	35.58	35.42	35.42	35.09	33.28	32.17	32.22	32.51	35.38	46.96	39.39	37.34	35.47	31.82	28.82	33.01	35.43		
Mass Hub	33.20	28.80	26.72	25.91	26.01	27.83	33.21	33.71	35.81	36.35	36.02	35.76	35.59	33.75	32.08	32.17	32.30	35.63	48.14	40.69	38.73	36.39	32.90	29.85	33.65	36.00		
Cleared Load (GW)	10.6	10.4	10.1	9.8	9.9	10.2	10.8	11.7	12.7	13.1	13.1	13.0	12.7	12.3	12.1	12.1	12.3	13.2	13.7	13.5	13.1	12.2	11.2	10.5				

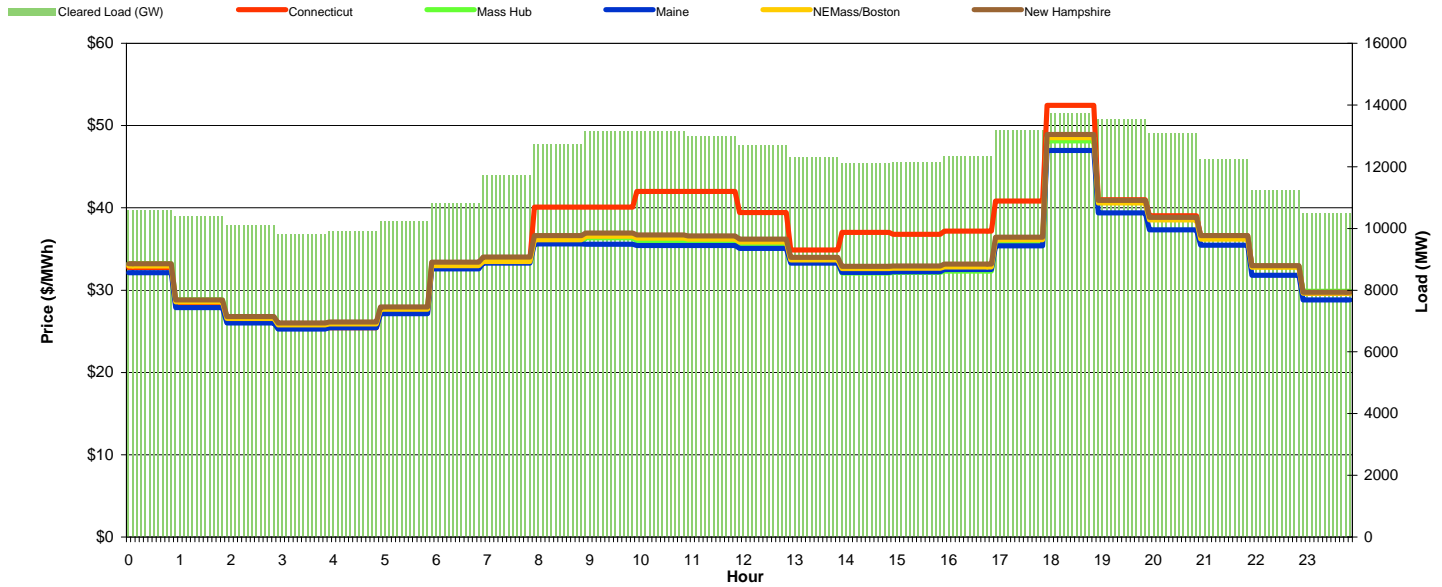

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	29.09	25.76	25.48	26.48	27.11	26.78	29.82	34.31	37.17	43.36	38.72	35.92	34.15	33.48	28.17	27.06	29.63	31.00	43.34	33.59	38.04	41.69	32.98	32.74	32.74	35.16	All	On Pk
NEMass/Boston	29.10	25.92	25.74	26.81	27.44	27.15	29.96	34.19	36.97	43.04	38.37	35.61	33.97	33.34	28.18	27.19	29.74	31.04	43.29	33.35	37.81	41.36	32.84	32.68	32.71	35.02		
New Hampshire	29.01	25.88	25.72	26.82	27.46	27.20	30.19	34.45	37.07	43.08	38.40	35.58	33.92	33.36	28.20	27.26	29.85	31.02	43.24	33.32	37.84	41.59	32.93	32.78	32.76	35.07		
Maine	27.79	24.76	24.79	25.86	26.43	26.27	29.44	33.40	35.75	41.03	36.66	33.95	32.57	32.32	27.31	26.59	29.20	29.98	41.52	32.02	36.32	40.26	31.88	31.89	31.58	33.80		
Mass Hub	29.24	26.00	25.78	26.87	27.51	27.19	30.06	34.35	37.12	43.24	38.55	35.77	34.08	33.44	28.23	27.20	29.76	31.08	43.32	33.40	37.87	41.51	32.95	32.81	32.81	35.12		
DA Forecast Load (GW)	11.25	10.72	10.44	10.33	10.42	10.81	11.65	12.51	13.53	14.11	14.27	14.17	13.93	13.65	13.36	13.27	13.40	13.84	14.81	14.90	14.42	13.68	12.75	11.71				
Forecast Error %	1.2%	1.0%	0.5%	0.3%	0.0%	-0.2%	-0.6%	-0.5%	-0.9%	-0.8%	-0.7%	-1.1%	-1.3%	-1.6%	-1.6%	-1.9%	-1.7%	-1.0%	-0.4%	-1.8%	-1.9%	-1.4%	-1.1%	-0.9%				

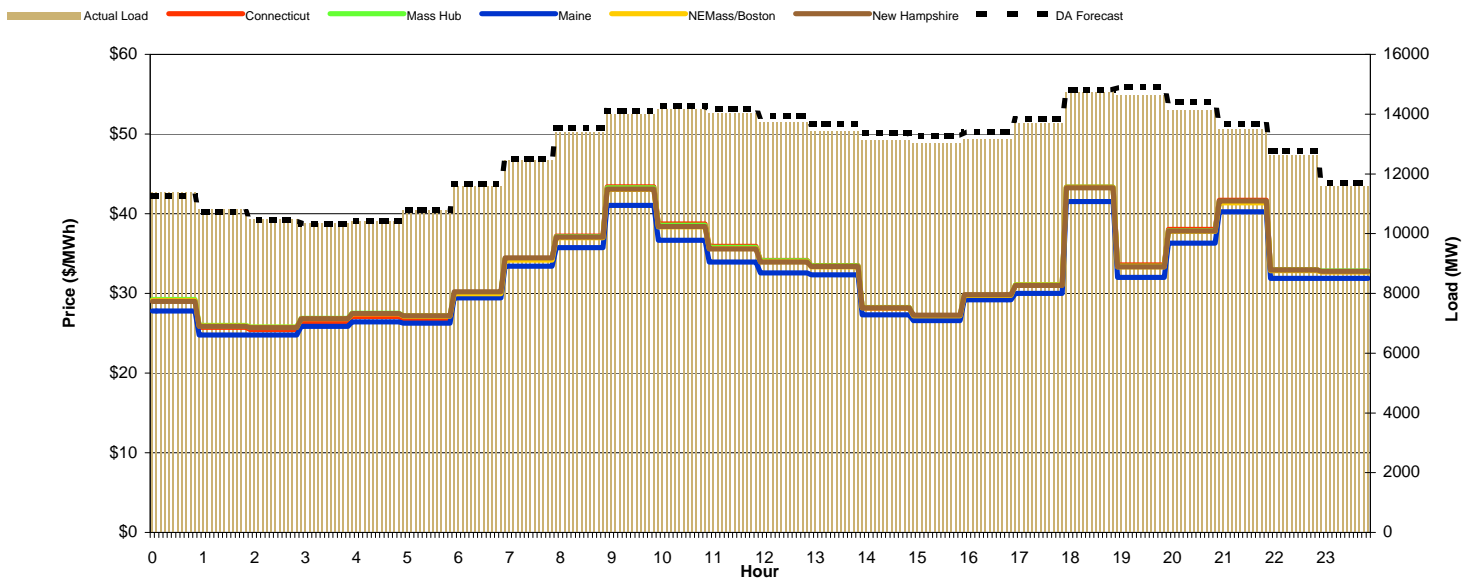




ISO-NE Daily Report

Sunday October 24, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$				
Connecticut	29.94	25.86	25.20	21.82	22.32	25.17	25.67	28.51	32.46	33.23	33.31	35.84	33.43	33.22	33.28	33.30	35.57	39.58	50.82	43.08	36.98	33.42	30.00	29.88	29.88	32.16	35.38	All	On Pk
NEMass/Boston	30.19	26.12	25.51	22.23	22.67	25.58	26.05	28.90	32.63	33.27	33.26	35.67	33.27	33.12	33.13	33.13	35.35	39.22	50.25	42.67	36.59	33.17	29.93	30.08	32.17	35.22			
New Hampshire	30.47	26.34	25.71	22.37	22.84	25.83	26.38	29.33	33.27	33.83	33.73	36.14	33.72	33.54	33.59	33.62	35.80	39.65	50.98	43.15	36.93	33.56	30.17	30.39	32.56	35.69			
Maine	30.00	25.95	25.27	22.00	22.45	25.49	26.15	28.95	32.94	33.31	33.15	35.21	33.13	33.14	33.00	33.13	35.01	38.54	49.52	41.76	35.86	33.01	29.39	30.00	31.93	34.94			
Mass Hub	30.39	26.30	25.66	22.31	22.76	25.70	26.16	28.96	32.75	33.40	33.37	35.86	33.40	33.22	33.24	33.25	35.50	39.41	50.51	42.75	36.75	33.28	29.99	30.19	32.30	35.35			
Cleared Load (GW)	10.1	9.9	9.4	9.4	9.4	9.7	10.0	10.8	11.7	12.7	12.8	13.0	12.7	12.4	12.1	12.2	12.8	13.5	14.5	13.7	13.3	12.2	11.0	9.9					

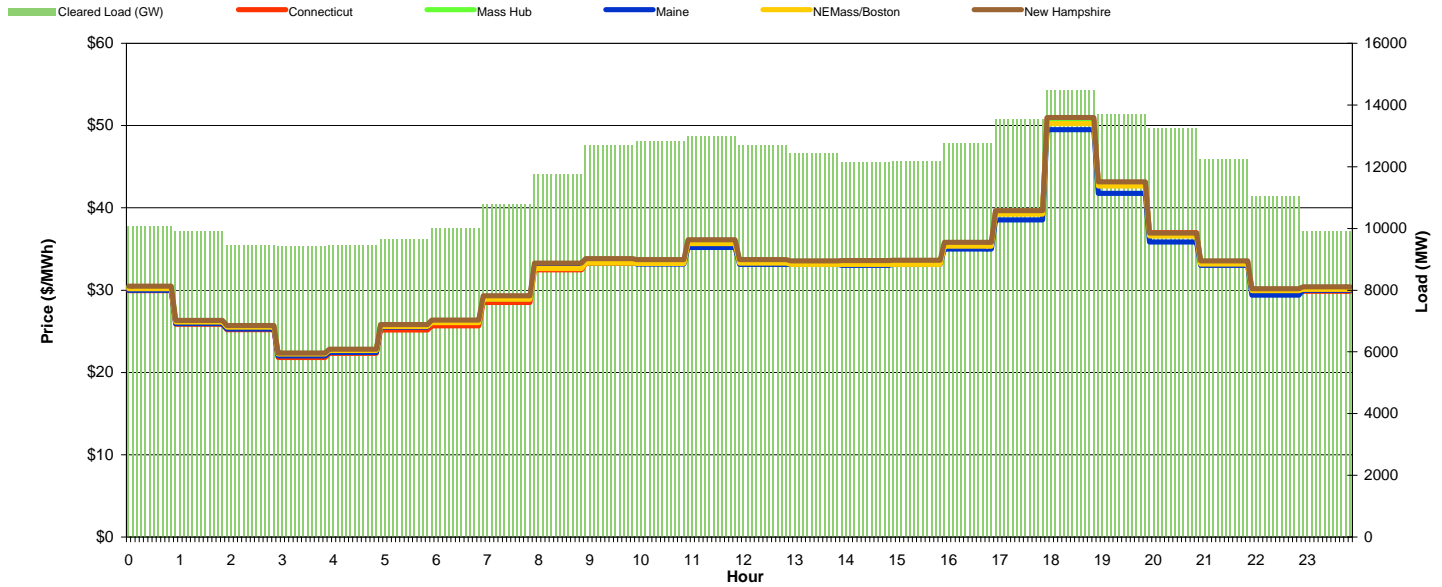

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	33.42	30.11	26.33	25.47	25.59	27.82	32.85	27.41	32.40	34.42	37.15	37.45	36.79	34.81	34.88	33.52	34.56	38.32	39.23	34.45	31.60	30.42	33.58	32.96	32.73	34.44	All	On Pk
NEMass/Boston	33.66	30.57	26.77	25.97	26.09	28.34	33.39	27.80	32.72	34.52	37.23	37.51	36.78	34.85	34.95	33.63	34.67	38.45	39.19	34.21	31.35	30.42	33.68	33.09	32.91	34.50		
New Hampshire	33.88	30.79	26.94	26.14	26.26	28.57	33.82	28.17	33.27	34.96	37.68	37.98	37.15	35.21	35.39	34.05	35.07	38.71	39.48	34.39	31.41	30.57	33.86	33.31	33.21	34.83		
Maine	33.12	30.35	26.59	25.92	26.04	28.29	33.59	27.97	33.06	34.59	37.12	37.38	36.59	35.00	35.14	33.83	34.86	38.00	38.70	33.57	30.49	30.01	33.11	32.60	32.75	34.34		
Mass Hub	33.76	30.61	26.82	26.01	26.13	28.39	33.49	27.82	32.77	34.59	37.30	37.58	36.87	34.92	35.01	33.65	34.68	38.43	39.18	34.25	31.39	30.42	33.69	33.15	32.95	34.53		
DA Forecast Load (GW)	10.87	10.35	10.05	9.93	9.94	10.21	10.76	11.41	12.39	13.11	13.50	13.67	13.69	13.54	13.37	13.33	13.57	14.14	15.16	15.28	14.68	13.67	12.44	11.31				
Forecast Error %	-0.9%	-1.1%	1.1%	1.4%	1.3%	0.9%	0.9%	-1.8%	-1.4%	-0.3%	0.0%	0.5%	1.1%	1.9%	2.2%	2.2%	2.9%	4.1%	2.4%	0.0%	0.3%	-0.1%	0.0%	-0.3%				

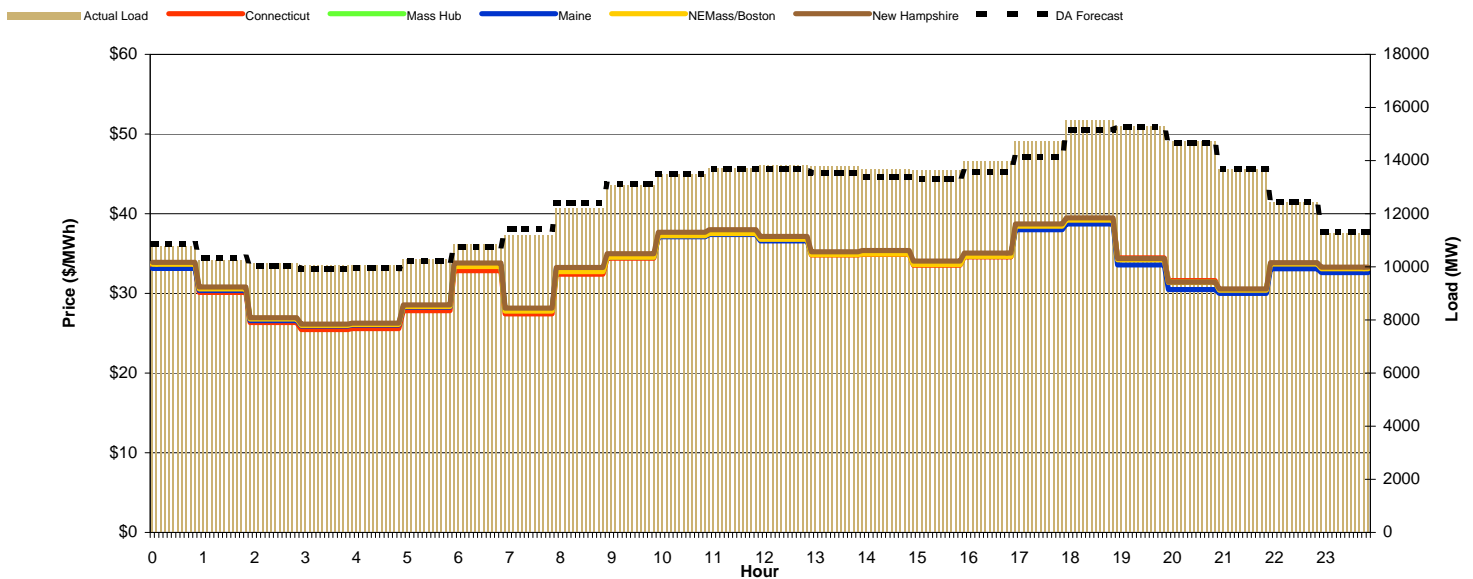




ISO-NE Daily Report

Monday October 25, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	25.57	19.61	19.51	19.37	19.36	29.55	36.02	42.00	40.95	39.92	44.43	45.10	45.18	45.76	40.60	37.59	40.00	51.00	57.34	49.31	38.74	35.70	33.46	31.23	36.97	42.94	All	On Pk
NEMass/Boston	25.87	19.92	19.80	19.66	19.72	29.90	35.66	41.03	39.81	38.73	43.10	43.71	43.81	43.50	39.33	36.43	38.79	41.54	49.84	44.19	37.47	34.77	32.70	31.10	35.43	40.55		
New Hampshire	26.08	20.04	19.93	19.81	19.89	30.50	36.68	42.11	40.82	39.41	43.54	44.07	44.12	43.89	39.92	36.90	39.35	42.10	50.73	44.80	37.95	35.31	33.19	31.41	35.94	41.14		
Maine	25.67	19.71	19.55	19.46	19.56	30.05	42.00	50.00	40.00	38.49	41.86	42.00	42.00	42.15	39.00	36.36	38.55	40.74	48.00	42.71	37.07	34.71	27.45	25.24	35.10	40.07		
Mass Hub	25.92	19.95	19.85	19.73	19.76	30.04	36.04	41.39	40.19	39.09	43.46	44.03	44.11	43.83	39.62	36.68	39.07	41.75	50.23	44.49	37.78	35.04	32.96	31.32	35.68	40.86		
Cleared Load (GW)	9.8	9.6	9.4	9.4	9.7	10.3	12.6	13.9	14.5	14.8	14.8	14.8	14.8	14.7	14.6	14.4	14.6	15.1	15.7	15.0	14.6	13.4	12.0	10.8				

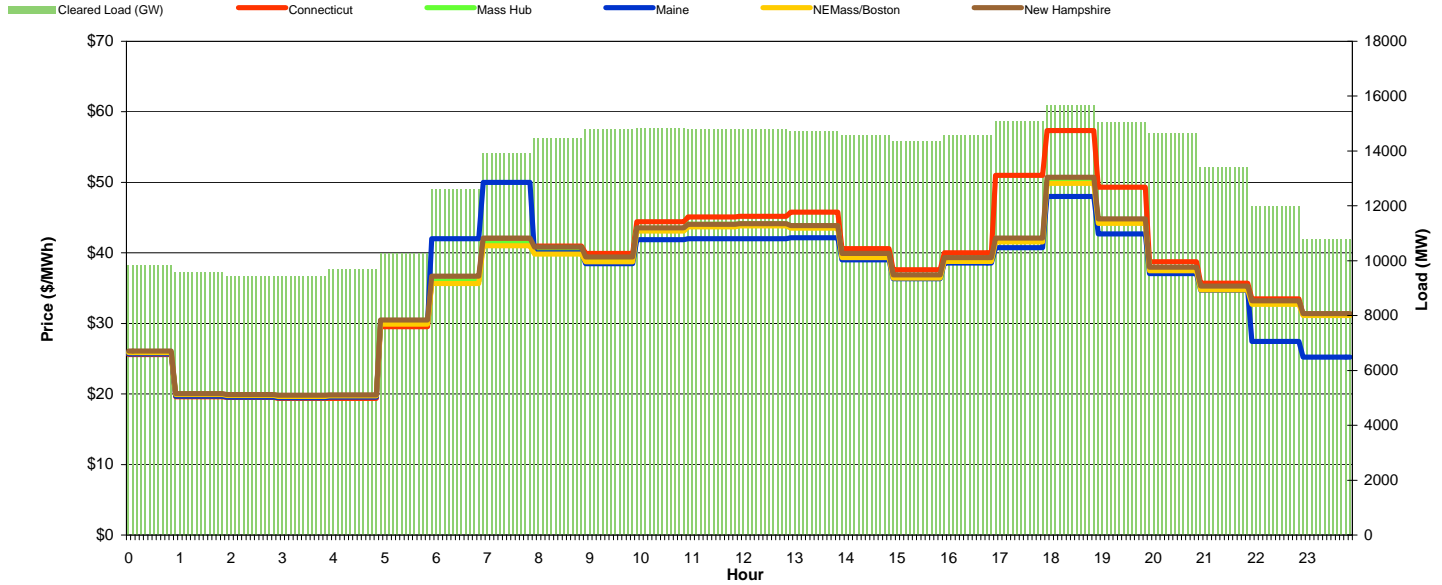

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	27.21	25.67	25.48	25.46	23.68	30.27	36.92	37.60	36.44	36.43	36.73	38.25	38.45	40.42	40.70	36.80	37.79	43.02	58.52	51.22	38.25	32.49	25.88	26.11	35.41	39.31	All	On Pk
NEMass/Boston	27.62	26.13	25.91	25.91	24.10	30.61	36.83	37.05	35.85	35.79	36.03	37.34	37.57	39.36	39.60	35.99	36.80	42.12	56.86	49.97	37.25	31.81	25.45	26.04	34.92	38.43		
New Hampshire	27.79	26.31	26.09	26.12	24.18	30.88	37.26	37.43	36.02	35.99	36.19	37.53	37.71	39.51	39.79	36.19	37.05	42.37	57.14	50.14	37.36	31.95	25.43	25.97	35.10	38.61		
Maine	27.42	26.13	25.88	26.02	23.71	30.31	36.91	37.19	35.74	35.51	35.63	36.82	37.03	38.81	39.02	35.67	36.44	41.57	55.72	48.78	36.33	31.20	24.51	25.05	34.48	37.87		
Mass Hub	27.61	26.14	25.94	25.93	24.11	30.71	36.96	37.17	36.06	36.03	36.29	37.61	37.83	39.65	39.89	36.21	37.07	42.26	57.15	50.21	37.53	32.02	25.60	26.12	35.09	38.66		
DA Forecast Load (GW)	10.43	9.95	9.76	9.73	10.05	11.10	13.16	14.46	14.99	15.54	15.76	15.85	15.90	15.93	15.75	15.67	15.86	16.29	17.10	16.91	16.06	14.81	13.26	11.85				
Forecast Error %	0.2%	2.8%	2.9%	2.9%	2.4%	1.9%	0.1%	1.3%	0.3%	-1.8%	-1.6%	-1.8%	-2.5%	-2.9%	-2.8%	-2.9%	-3.3%	-2.0%	-1.5%	-2.2%	-1.6%	-1.3%	-0.9%	-0.8%				

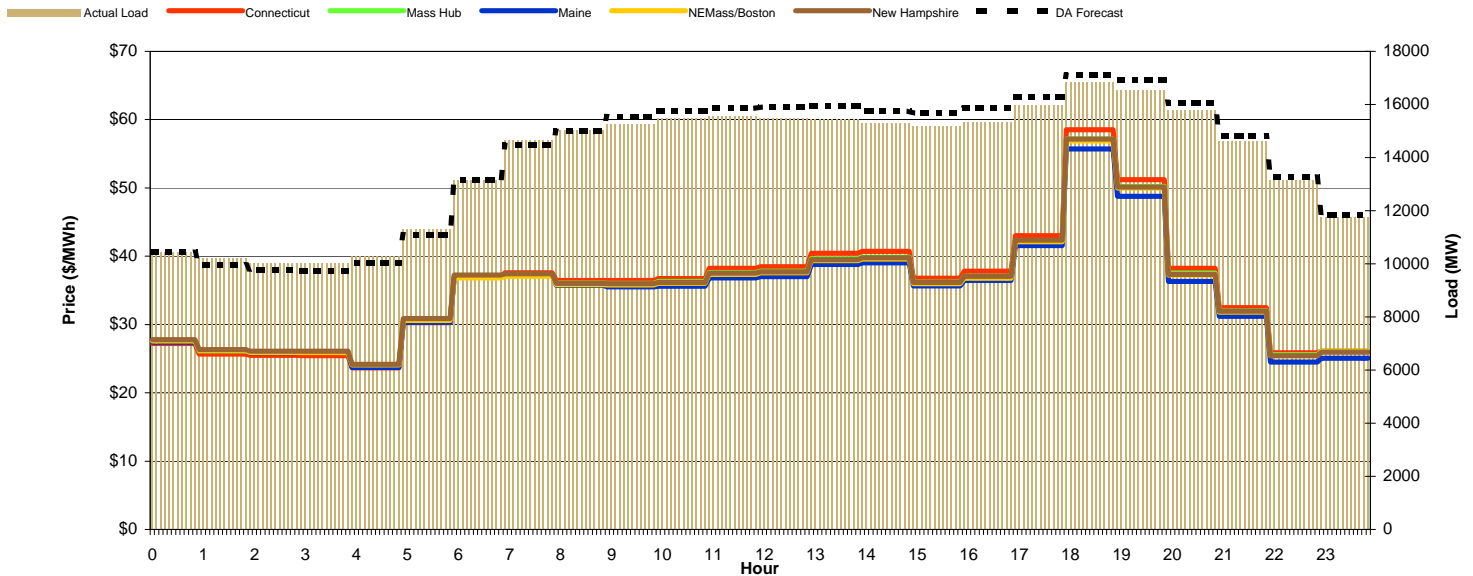




ISO-NE Daily Report

Tuesday October 26, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	26.87	24.60	22.99	22.93	23.87	29.59	34.83	42.00	42.73	45.60	50.48	49.55	47.75	50.42	48.01	48.02	48.03	52.00	56.00	50.32	45.40	37.30	33.80	31.11	40.18	46.71	All	On Pk
NEMass/Boston	26.84	24.63	22.98	22.96	23.88	29.62	34.15	36.53	37.05	38.55	40.62	40.60	39.24	39.75	38.22	37.59	38.25	39.19	49.01	38.52	37.55	34.22	32.79	30.78	34.73	38.61		
New Hampshire	26.97	24.69	23.04	23.02	23.98	29.87	34.71	37.98	38.70	40.12	42.76	42.38	40.91	41.87	40.14	39.63	40.31	40.78	50.49	39.79	39.42	35.22	33.27	31.14	35.88	40.24		
Maine	26.27	24.12	22.41	22.33	23.38	29.41	34.41	37.04	37.86	39.00	41.44	41.03	39.49	39.98	38.39	38.00	38.74	39.67	48.93	38.76	37.86	34.46	32.63	32.22	34.91	38.96		
Mass Hub	27.04	24.80	23.17	23.15	24.04	29.88	34.61	37.61	38.12	39.72	42.28	42.06	40.61	41.56	39.84	39.31	39.90	40.20	50.20	39.32	38.97	34.81	33.09	31.02	35.64	39.85		
Cleared Load (GW)	10.2	9.9	9.8	9.7	9.8	10.4	12.9	14.0	14.6	14.8	15.1	15.1	15.1	15.0	14.8	14.6	14.7	15.4	15.8	15.5	14.6	13.5	12.0	10.7				

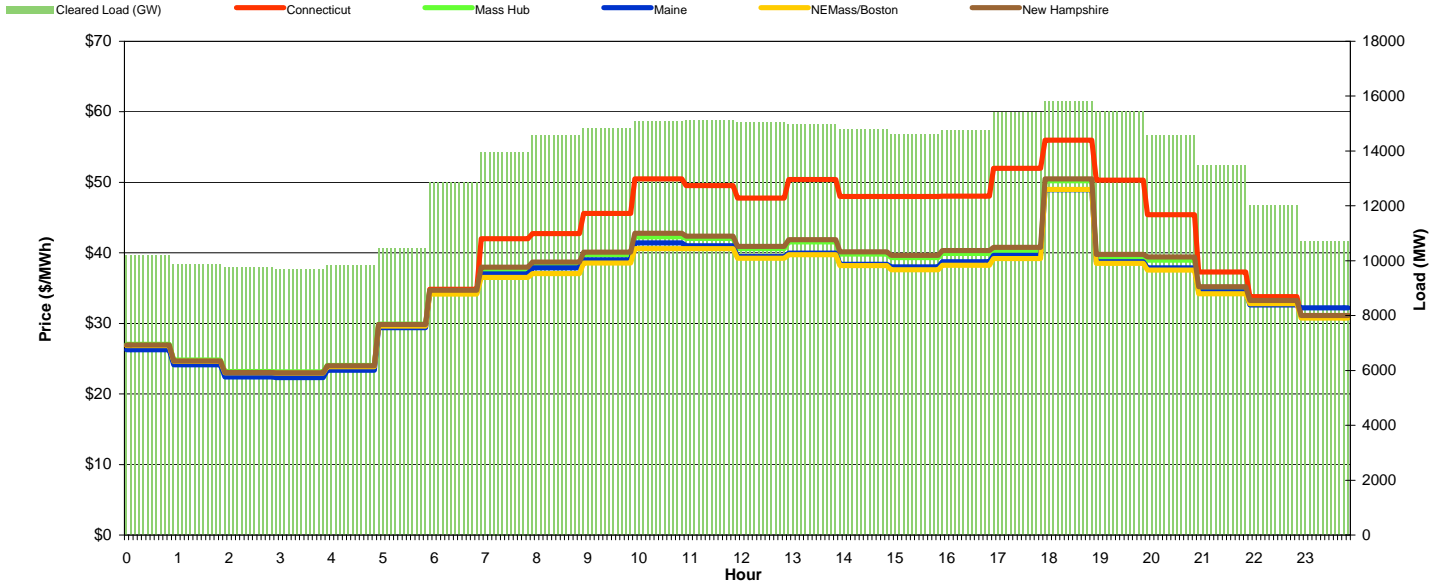

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	29.56	30.38	26.44	25.58	25.82	25.37	31.47	32.55	34.38	37.27	39.81	41.37	40.66	39.15	35.98	34.32	35.31	46.39	48.32	44.18	37.69	30.78	29.55	28.15	34.60	37.98	All	On Pk
NEMass/Boston	29.73	30.42	26.61	25.81	26.08	25.64	31.40	32.04	33.72	36.49	38.83	40.38	39.72	38.30	35.39	33.72	34.67	45.41	47.23	42.72	36.72	30.14	29.06	28.07	34.10	37.16		
New Hampshire	29.70	30.37	26.59	25.78	26.10	25.72	31.73	32.39	33.97	36.74	39.10	40.61	39.90	38.48	35.54	33.82	34.76	45.56	47.46	42.84	36.87	30.22	29.06	28.02	34.22	37.33		
Maine	29.09	29.81	26.14	25.38	25.76	25.47	31.48	31.97	33.45	36.29	38.54	39.89	39.02	37.67	34.99	33.17	34.02	44.44	46.14	41.58	35.81	29.61	28.30	27.46	33.56	36.56		
Mass Hub	29.82	30.62	26.75	25.91	26.16	25.67	31.48	32.20	33.89	36.68	39.08	40.58	39.91	38.47	35.49	33.84	34.79	45.56	47.34	42.93	36.95	30.31	29.24	28.16	34.24	37.33		
DA Forecast Load (GW)	10.70	10.20	9.94	9.90	10.14	11.20	13.41	14.77	15.23	15.62	15.94	16.07	16.12	16.13	16.01	15.91	16.06	16.41	17.15	16.91	16.06	14.85	13.32	11.91				
Forecast Error %	1.2%	3.5%	4.0%	3.5%	3.4%	0.4%	-1.1%	-0.8%	-1.7%	-2.2%	-2.1%	-1.5%	-1.7%	-1.5%	-1.8%	-2.6%	-3.4%	-2.4%	-1.5%	-1.6%	-1.0%	-0.7%	-0.6%	-0.3%				

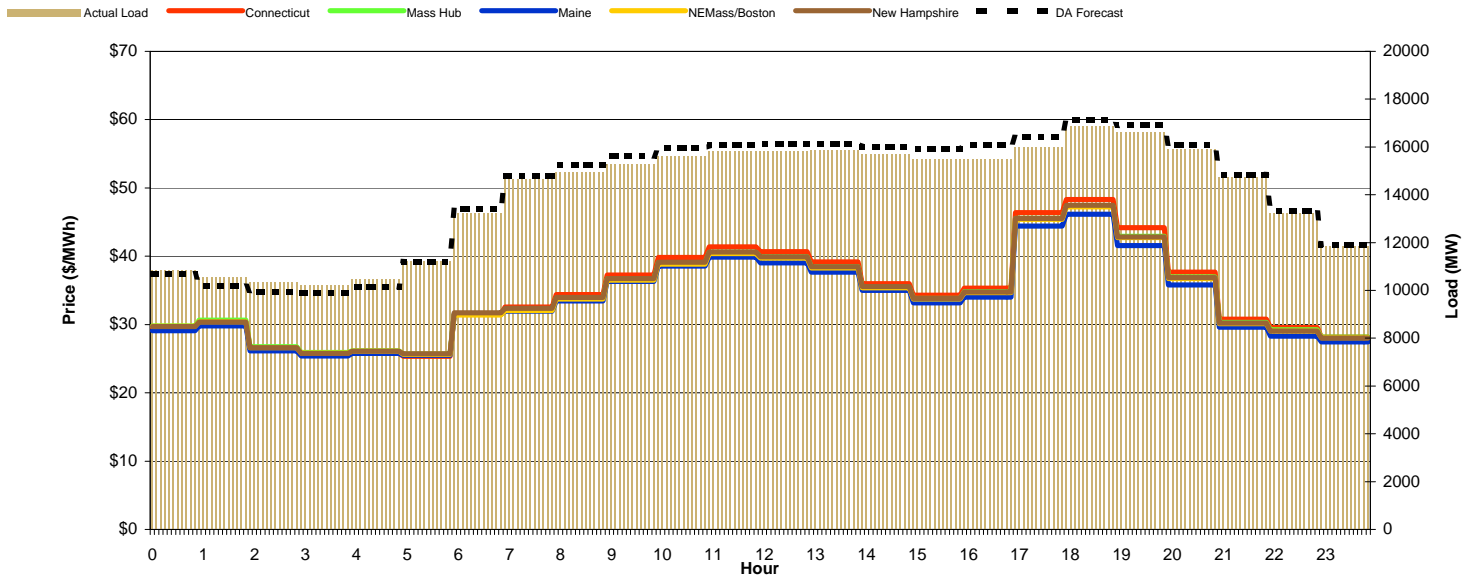




ISO-NE Daily Report

Wednesday October 27, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	28.20	24.72	20.28	19.87	22.05	27.61	34.66	39.00	40.53	43.15	47.85	47.96	47.24	47.83	46.06	45.22	43.67	50.09	56.17	53.00	42.27	36.54	33.33	30.24	38.65	44.99	All	On Pk
NEMass/Boston	28.11	24.72	20.34	19.96	22.16	27.76	34.17	36.10	37.31	39.08	40.47	41.72	41.51	41.56	39.19	38.63	38.52	43.45	50.24	45.06	36.07	34.57	32.72	30.18	35.15	39.76		
New Hampshire	28.38	24.94	20.46	20.09	22.32	28.10	34.88	37.36	38.57	40.29	41.53	42.81	42.92	42.90	40.71	40.18	39.43	44.80	51.47	46.68	36.80	35.39	32.98	30.52	36.02	40.93		
Maine	27.76	24.39	19.94	19.64	21.84	27.81	34.77	36.85	37.78	39.28	40.49	41.74	41.61	41.48	39.12	38.65	38.23	43.57	49.96	44.99	35.72	34.89	32.28	30.39	35.13	39.79		
Mass Hub	28.27	24.85	20.42	20.02	22.23	27.87	34.51	36.80	38.02	39.91	41.10	42.36	42.42	42.57	40.43	39.87	39.26	44.44	51.26	46.42	36.44	34.98	32.91	30.26	35.73	40.57		
Cleared Load (GW)	10.3	9.9	9.8	9.8	9.8	10.6	12.8	14.6	15.1	15.3	15.4	15.6	15.5	15.4	15.1	15.0	15.3	15.5	16.1	15.4	15.0	13.6	12.1	10.7				

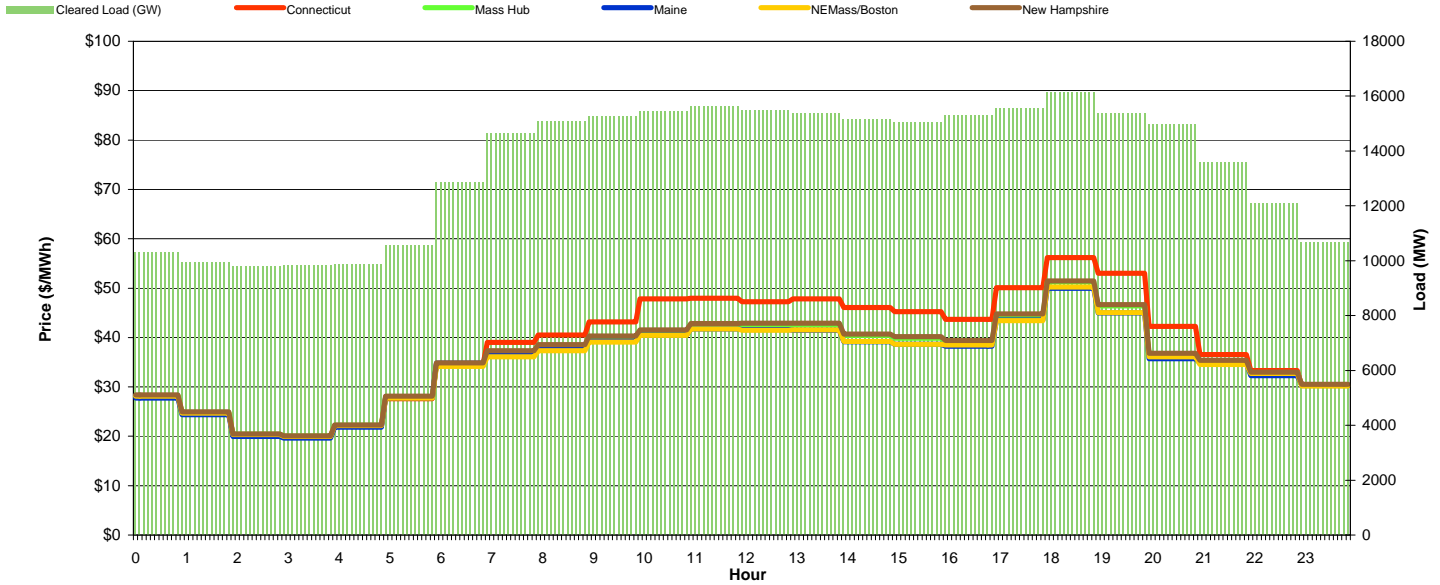

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	26.74	24.45	23.84	24.01	25.25	27.09	41.47	36.23	37.48	53.37	52.45	39.60	52.47	89.72	51.79	45.74	40.38	90.15	53.82	52.72	34.65	31.17	29.24	27.65	42.15	49.44	All	On Pk
NEMass/Boston	26.92	24.64	23.98	24.16	25.40	27.28	41.06	35.18	34.88	39.47	39.40	34.94	39.04	56.42	38.73	35.86	35.55	59.36	40.01	38.99	32.50	30.78	29.01	27.63	35.05	38.76		
New Hampshire	26.87	24.56	23.91	24.09	25.30	27.23	41.15	35.34	35.23	41.99	41.79	35.55	41.47	62.97	41.14	37.42	36.06	64.88	42.35	41.11	32.45	30.42	28.62	27.22	36.21	40.55		
Maine	26.40	24.11	23.47	23.70	25.01	26.99	40.44	34.70	34.47	40.44	40.18	34.43	39.92	60.18	39.82	36.13	35.10	62.28	40.83	39.10	31.57	29.86	28.10	26.72	35.16	39.19		
Mass Hub	26.94	24.65	24.00	24.18	25.44	27.31	41.25	35.45	35.36	42.04	41.85	35.71	41.42	62.49	41.16	37.65	36.36	64.99	42.55	41.55	32.87	30.83	29.07	27.66	36.37	40.71		
DA Forecast Load (GW)	10.87	10.41	10.14	10.10	10.39	11.46	13.59	15.04	15.64	16.01	16.37	16.51	16.47	16.53	16.37	16.25	16.25	16.41	16.90	16.71	16.05	14.82	13.25	11.81				
Forecast Error %	0.8%	0.4%	0.5%	0.2%	0.1%	-0.3%	0.0%	1.0%	0.2%	-0.1%	-0.3%	0.0%	-0.1%	-0.4%	-0.4%	-0.2%	0.6%	2.6%	2.5%	1.8%	1.5%	2.2%	2.4%	2.9%				

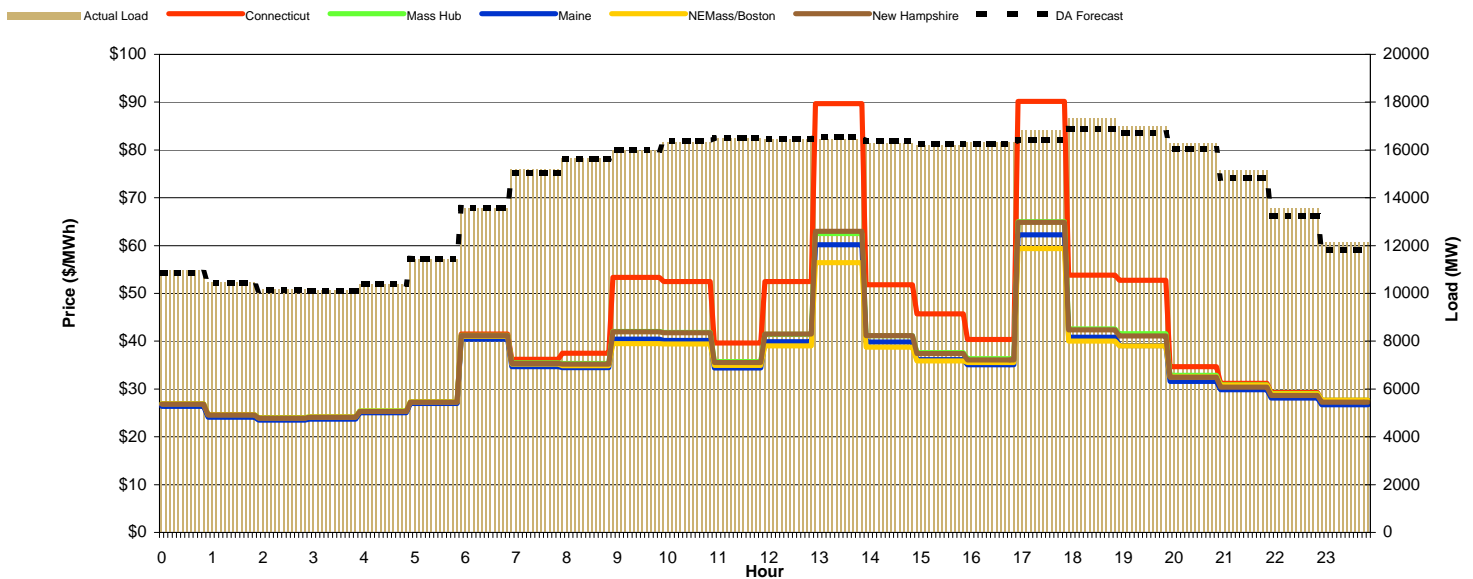




ISO-NE Daily Report

Thursday October 28, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$				
Connecticut	29.13	24.94	23.66	18.93	23.87	27.32	34.47	36.35	37.19	39.07	39.74	40.40	37.18	36.90	36.95	36.10	37.25	41.74	52.61	41.00	36.32	35.13	29.98	28.22	28.22	34.35	38.37	All	On Pk
NEMass/Boston	28.99	24.93	23.65	19.01	23.95	27.62	34.27	35.57	36.12	37.22	38.77	38.72	36.41	36.22	35.58	34.96	36.16	39.88	49.17	39.50	35.51	34.46	29.84	28.28	28.28	33.53	37.13		
New Hampshire	29.14	24.96	23.66	19.02	23.99	27.76	34.50	35.90	36.49	37.83	39.06	39.09	36.63	36.40	35.90	35.23	36.48	40.28	49.77	39.97	35.80	34.72	29.97	28.38	28.38	33.79	37.47		
Maine	28.53	24.43	23.13	18.67	23.57	27.36	34.04	35.26	35.66	37.06	37.86	37.93	35.79	35.65	35.00	34.34	35.63	39.21	47.93	39.02	34.96	33.89	29.13	28.16	28.16	33.01	36.52		
Mass Hub	29.21	25.05	23.75	19.05	24.03	27.73	34.58	35.83	36.34	37.54	38.97	39.03	36.54	36.34	35.79	35.14	36.33	40.29	49.90	39.78	35.70	34.63	29.86	28.36	28.36	33.74	37.38		
Cleared Load (GW)	10.5	10.0	9.8	9.9	10.0	10.5	12.9	14.3	14.7	14.9	15.1	15.1	15.1	15.0	14.7	14.6	14.8	15.6	15.9	15.6	14.7	13.3	11.8	10.4					

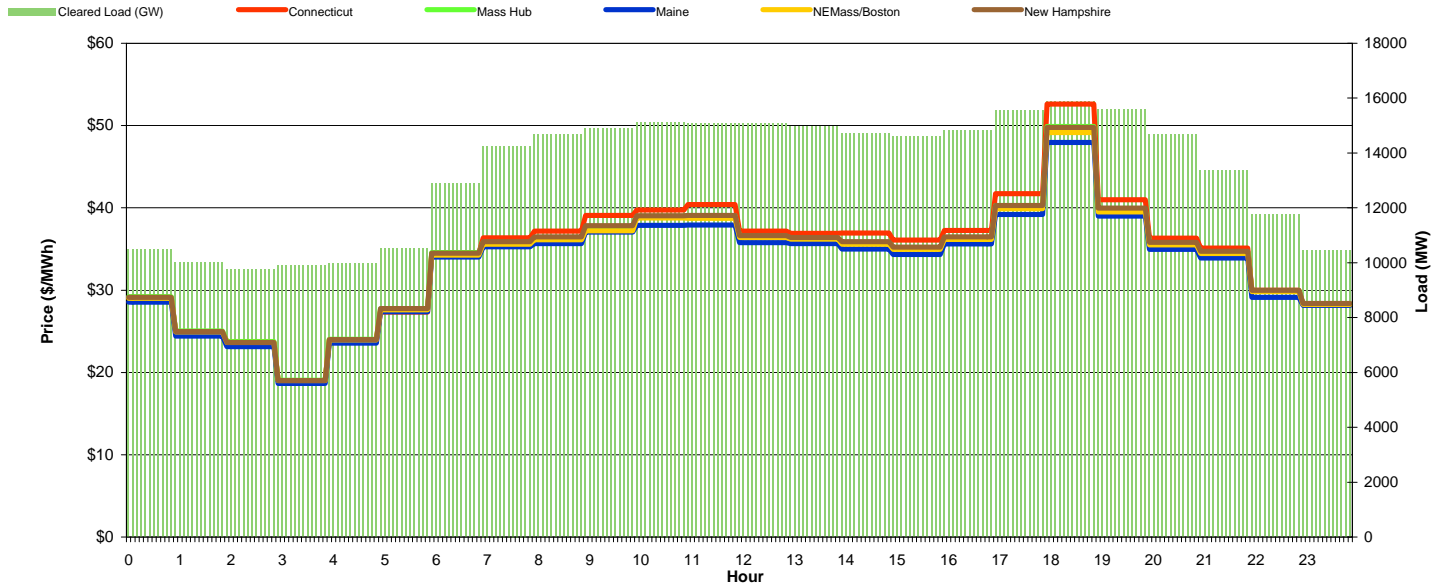

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$				
Connecticut	29.83	27.82	26.01	24.76	25.73	27.46	34.26	35.21	34.63	36.24	49.89	50.17	32.69	34.50	35.18	33.70	30.59	31.62	49.77	32.66	42.46	31.59	26.24	24.11	24.11	33.63	36.70	All	On Pk
NEMass/Boston	29.88	27.92	26.14	24.94	25.91	27.66	34.19	34.52	33.95	34.73	38.41	38.60	30.85	33.43	33.41	31.82	30.13	31.12	38.55	32.10	35.23	30.82	25.92	24.06	24.06	31.43	33.35		
New Hampshire	29.58	27.64	25.87	24.71	25.70	27.43	34.05	34.42	33.83	34.65	39.86	40.02	30.74	33.21	33.29	31.78	29.85	30.91	40.09	31.87	36.04	30.62	25.64	23.74	23.74	31.48	33.55		
Maine	29.15	27.37	25.63	24.39	25.37	26.91	33.46	33.65	33.18	33.88	38.56	38.36	29.78	32.20	32.42	30.82	29.02	30.21	38.61	31.10	34.68	29.83	24.98	23.21	23.21	30.70	32.58		
Mass Hub	29.97	27.99	26.19	24.97	25.96	27.73	34.32	34.74	34.15	35.06	40.48	40.70	31.21	33.64	33.77	32.17	30.24	31.23	40.54	32.23	36.64	31.07	26.07	24.14	24.14	31.88	34.00		
DA Forecast Load (GW)	10.92	10.42	10.17	10.12	10.34	11.32	13.44	14.70	15.14	15.49	15.75	15.83	15.82	15.89	15.73	15.53	15.52	15.90	16.75	16.53	15.78	14.58	13.06	11.66					
Forecast Error %	4.6%	3.9%	3.4%	2.5%	2.3%	1.8%	-0.7%	0.0%	-0.8%	-0.5%	0.0%	0.0%	-0.3%	-0.9%	-0.8%	-0.5%	-1.1%	-2.0%	-1.6%	-1.5%	-1.1%	-0.8%	-0.7%	-0.8%					

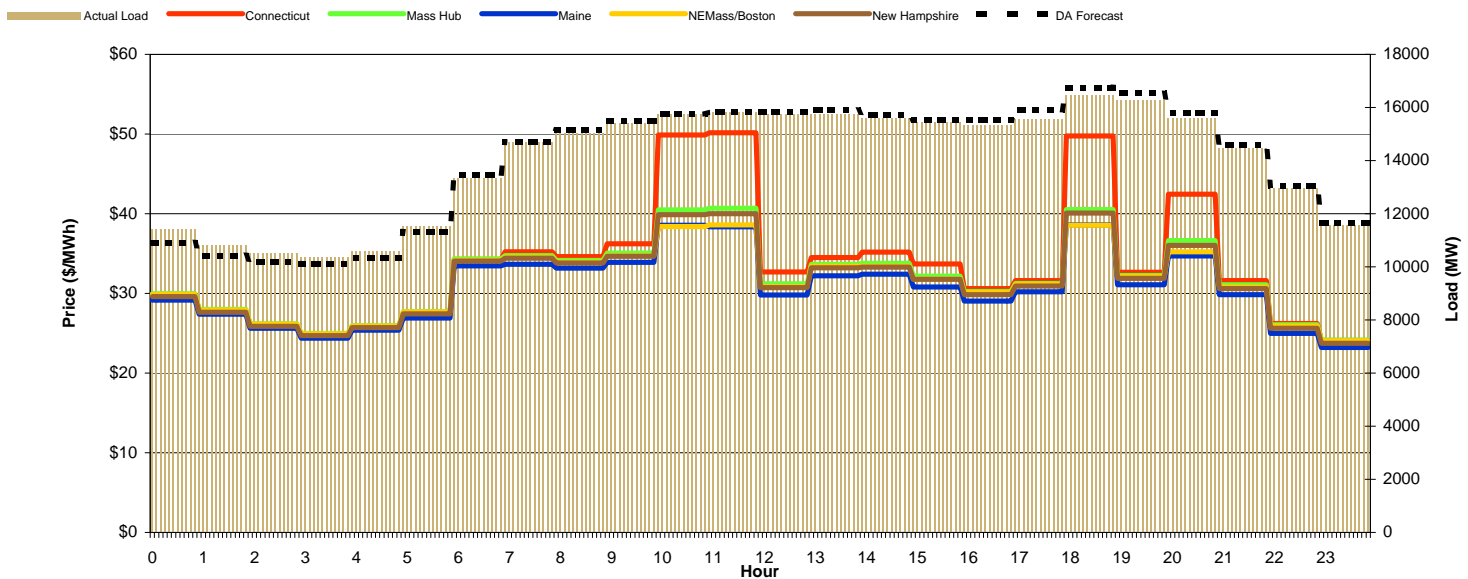




ISO-NE Daily Report

Friday October 29, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	27.63	25.90	23.39	21.99	22.73	28.82	35.26	42.71	44.00	44.00	45.28	44.00	43.82	41.92	39.86	38.19	39.28	53.00	56.05	44.94	40.96	36.51	33.00	32.79	37.75	42.97	All	On Pk
NEMass/Boston	28.03	26.29	23.81	22.33	23.17	29.39	35.22	37.87	38.39	39.02	39.42	38.65	38.12	37.28	35.68	34.63	35.98	45.62	49.32	40.26	36.90	35.01	32.63	32.84	34.83	38.42		
New Hampshire	28.04	26.29	23.74	22.29	23.14	29.54	35.47	38.81	39.24	39.67	40.01	39.10	38.59	37.61	35.91	34.76	36.11	46.41	50.03	40.83	37.24	34.98	32.50	32.65	35.12	38.86		
Maine	27.29	25.54	23.06	21.67	22.55	28.97	34.90	37.41	37.93	38.24	38.55	37.83	37.36	36.47	34.80	33.77	35.00	44.50	48.10	39.38	35.86	33.85	31.21	32.03	34.01	37.52		
Mass Hub	28.09	26.36	23.80	22.38	23.16	29.41	35.49	38.78	39.30	39.82	40.37	39.45	38.98	37.98	36.28	35.15	36.48	46.70	50.40	40.90	37.56	35.27	32.74	33.03	35.33	39.14		
Cleared Load (GW)	10.0	9.5	9.3	9.4	9.6	10.1	12.7	13.8	14.0	14.2	14.2	14.2	14.1	14.0	13.6	13.6	13.7	14.7	15.2	14.6	13.9	12.8	11.6	10.4				

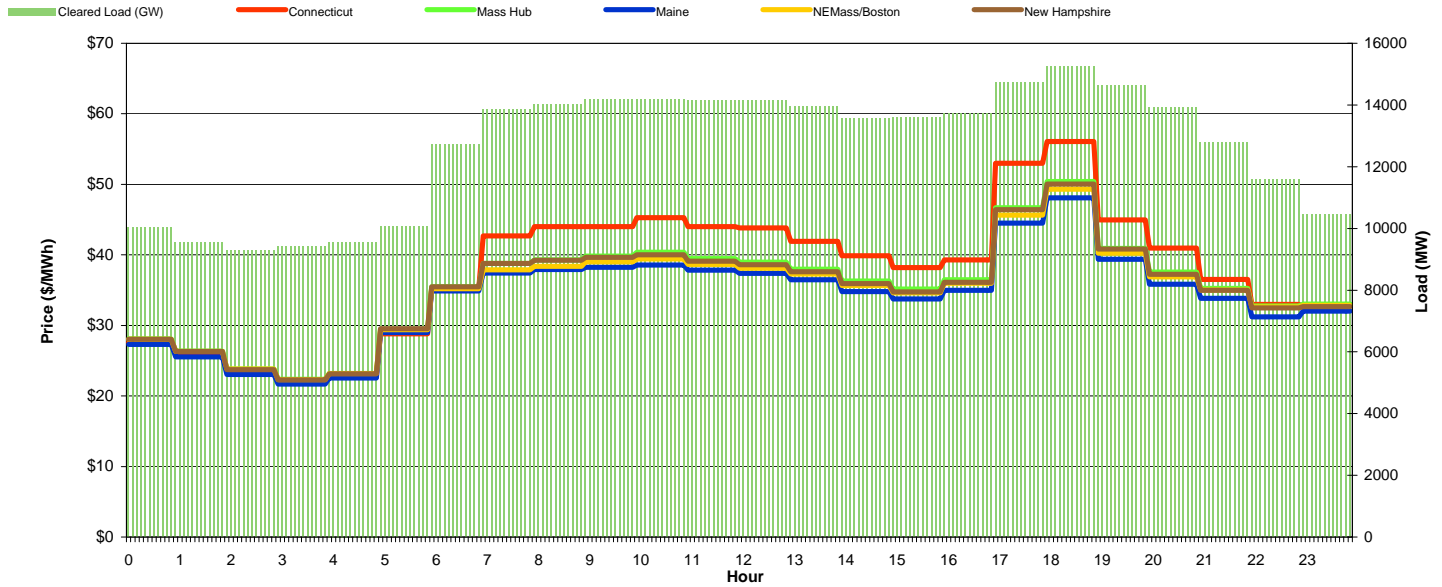

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	26.02	25.29	24.07	23.55	24.29	24.20	29.32	32.58	33.38	33.96	35.01	36.25	34.94	35.85	36.66	34.39	35.55	35.92	48.74	45.59	31.94	34.21	30.66	28.85	32.55	35.98	All	On Pk
NEMass/Boston	26.24	25.53	24.30	23.75	24.43	24.11	29.05	31.97	32.65	33.12	34.12	35.32	34.12	35.06	35.89	33.80	35.08	35.62	47.68	44.57	31.31	33.64	30.23	28.70	32.10	35.26		
New Hampshire	25.97	25.28	24.06	23.51	24.19	23.87	28.90	31.82	32.45	32.86	33.83	34.99	33.78	34.68	35.46	33.39	34.70	35.32	47.38	44.27	31.03	33.26	29.75	28.26	31.79	34.94		
Maine	25.43	24.86	23.64	23.11	23.88	23.45	28.42	31.08	31.72	32.23	33.19	34.28	33.15	33.99	34.64	32.61	33.92	34.46	45.80	42.58	30.06	32.23	28.68	27.21	31.03	34.04		
Mass Hub	26.30	25.61	24.39	23.85	24.55	24.27	29.27	32.25	32.96	33.45	34.44	35.64	34.41	35.33	36.15	34.00	35.25	35.74	47.93	44.91	31.55	33.91	30.48	28.89	32.31	35.53		
DA Forecast Load (GW)	10.61	10.09	9.86	9.80	10.04	11.02	13.10	14.41	14.83	15.13	15.31	15.31	15.12	14.99	14.76	14.59	14.65	15.19	15.91	15.61	14.93	14.08	12.89	11.72				
Forecast Error %	-0.3%	-0.1%	1.8%	1.7%	1.2%	-0.7%	-2.1%	-2.0%	-2.6%	-2.5%	-2.3%	-2.0%	-1.4%	-1.2%	-1.1%	-1.0%	-0.9%	-1.7%	-1.3%	-1.1%	-0.6%	-0.3%	0.4%	0.5%				

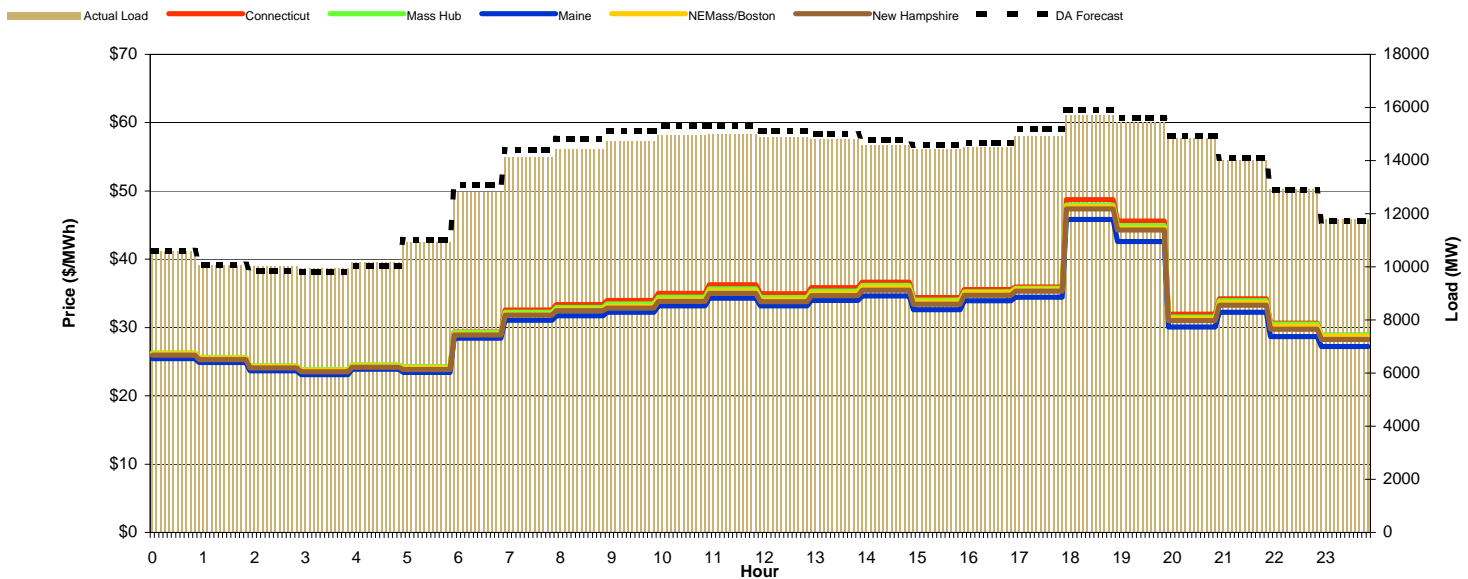




ISO-NE Daily Report

Saturday October 30, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$	
Connecticut	31.31	30.96	26.92	26.48	27.97	28.38	32.17	32.61	34.65	35.18	35.28	35.25	34.84	34.13	32.83	32.02	33.90	37.89	43.98	35.51	35.38	34.81	32.78	32.16	33.22	35.07
NEMass/Boston	31.41	31.26	27.20	26.75	28.10	28.70	32.63	32.42	34.31	34.64	34.67	34.62	34.36	33.79	32.66	31.79	33.53	37.11	43.20	34.89	34.57	34.22	32.36	32.09	32.97	34.57
New Hampshire	31.18	31.17	27.09	26.63	28.05	28.67	32.58	32.24	34.15	34.47	34.54	34.43	34.09	33.56	32.46	31.61	33.39	37.16	42.97	34.90	34.46	33.94	31.97	31.58	32.80	34.40
Maine	30.33	30.23	26.27	25.87	27.24	27.97	31.91	31.53	33.67	33.79	33.91	33.69	33.21	32.62	31.62	30.77	32.53	36.62	41.94	34.48	33.70	33.11	30.82	30.83	32.03	33.63
Mass Hub	31.65	31.46	27.30	26.87	28.28	28.84	32.78	32.62	34.59	34.91	34.95	34.87	34.57	33.96	32.82	31.94	33.79	37.43	43.53	35.06	34.84	34.51	32.62	32.32	33.19	34.81
Cleared Load (GW)	10.3	9.9	9.3	9.2	9.3	9.7	10.5	11.3	12.7	13.3	13.5	13.3	12.8	12.6	12.3	12.2	12.4	14.0	14.3	13.6	12.9	11.8	11.0	10.2		

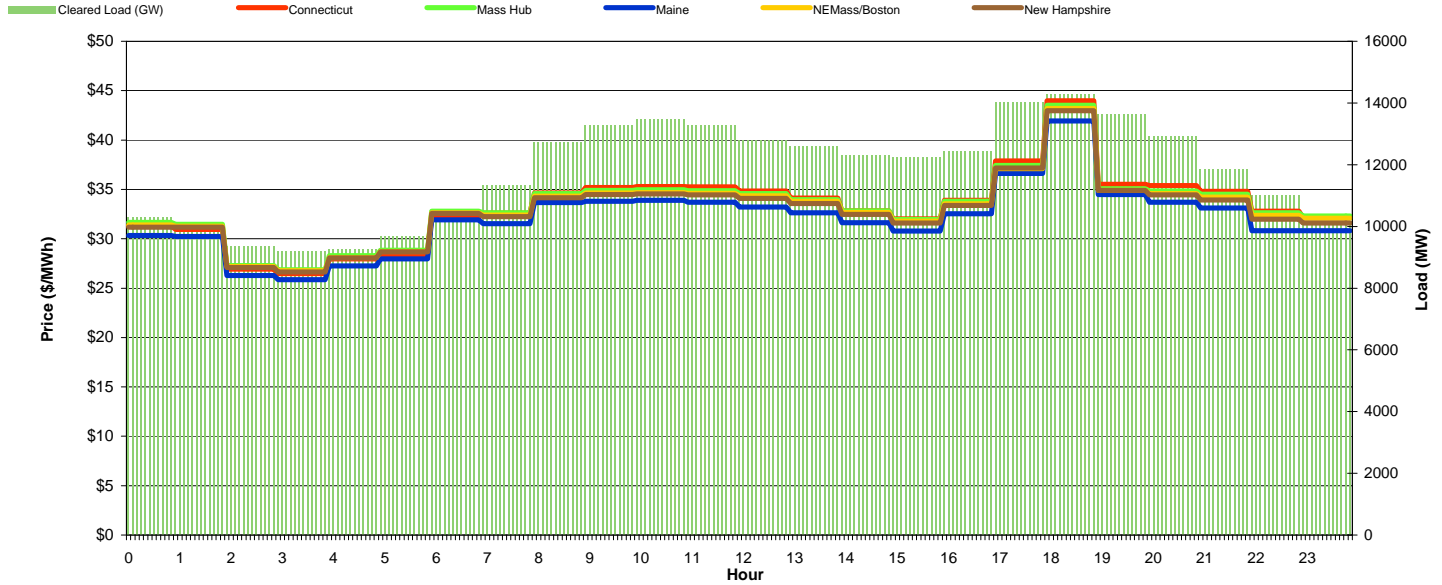

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$	
Connecticut	30.53	38.04	27.64	28.09	27.62	26.84	28.91	30.83	30.92	33.28	32.36	35.60	35.92	32.53	28.84	32.68	33.64	33.14	36.03	34.11	35.75	37.67	32.28	32.10	32.31	33.47
NEMass/Boston	30.61	38.15	28.03	28.42	27.96	27.01	28.97	30.59	30.69	32.88	31.95	35.07	35.53	32.24	28.72	32.55	33.41	32.78	35.39	33.32	34.95	37.08	31.73	31.70	32.07	33.06
New Hampshire	30.26	37.79	27.85	28.24	27.80	26.83	28.70	30.33	30.45	32.60	31.64	34.69	35.12	31.90	28.45	32.30	33.13	32.62	35.18	33.14	34.77	36.69	31.36	31.41	31.80	32.77
Maine	29.37	36.47	27.09	27.39	27.02	26.01	27.91	29.53	29.61	31.64	30.55	33.43	33.98	30.79	27.46	31.34	32.05	31.81	34.36	32.35	33.88	35.76	30.43	30.67	30.87	31.81
Mass Hub	30.78	38.37	28.10	28.54	28.07	27.15	29.17	30.87	30.92	33.13	32.19	35.35	35.78	32.46	28.87	32.75	33.64	33.05	35.74	33.71	35.34	37.37	32.05	32.00	32.31	33.33
DA Forecast Load (GW)	10.89	10.40	10.08	10.00	10.09	10.51	11.34	12.23	13.22	13.76	13.92	13.82	13.62	13.35	13.12	13.05	13.26	13.74	14.70	14.66	14.23	13.50	12.55	11.52		
Forecast Error %	-0.3%	-0.9%	-0.6%	-1.0%	-1.4%	-1.8%	-2.0%	-1.6%	-1.6%	-0.8%	-0.4%	0.0%	0.2%	0.3%	0.4%	0.5%	0.8%	2.5%	1.4%	-0.4%	-1.1%	-0.9%	-1.1%	-1.0%		

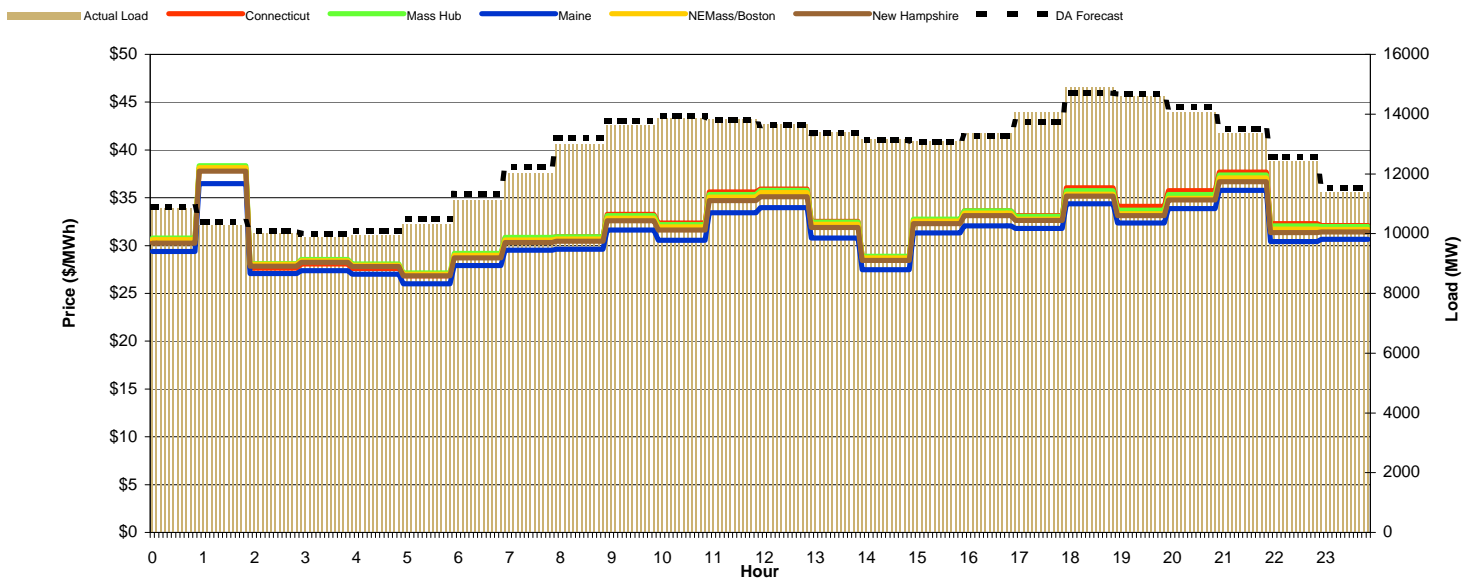




ISO-NE Daily Report

Sunday October 31, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%

Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
																										All	On Pk	
Connecticut	29.31	27.73	26.60	25.91	26.19	27.33	28.54	31.74	32.72	33.11	34.47	34.82	34.22	33.29	33.06	33.02	35.35	42.08	46.44	38.25	35.77	35.23	32.97	32.42	32.94	35.41		
NEMass/Boston	29.75	28.28	27.06	26.40	26.67	27.92	28.97	31.85	32.41	32.70	33.75	34.20	33.51	32.73	32.53	32.51	34.41	40.96	45.15	37.11	34.67	34.38	32.53	32.51	32.62	34.71		
New Hampshire	29.67	28.31	27.09	26.41	26.67	27.95	29.19	32.06	32.59	32.98	33.70	34.36	33.44	32.87	32.58	32.61	34.38	41.10	45.37	37.24	34.76	34.29	32.80	32.70	32.71	34.82		
Maine	29.32	27.93	26.65	25.95	26.21	27.51	28.82	31.63	32.11	32.67	33.14	33.77	32.76	32.12	31.77	31.91	33.52	40.14	44.22	36.52	33.87	33.24	32.17	31.80	32.07	34.10		
Mass Hub	29.83	28.30	27.10	26.45	26.72	27.92	29.07	31.99	32.75	33.10	34.16	34.61	33.90	33.09	32.86	32.84	34.87	41.47	45.69	37.56	35.13	34.77	32.84	32.71	32.91	35.10		
Cleared Load (GW)	9.6	9.2	9.0	8.8	8.9	9.0	9.6	10.1	11.6	12.5	12.8	12.8	12.6	12.5	12.2	12.2	12.7	14.1	14.2	13.6	13.2	12.0	10.9	9.9				

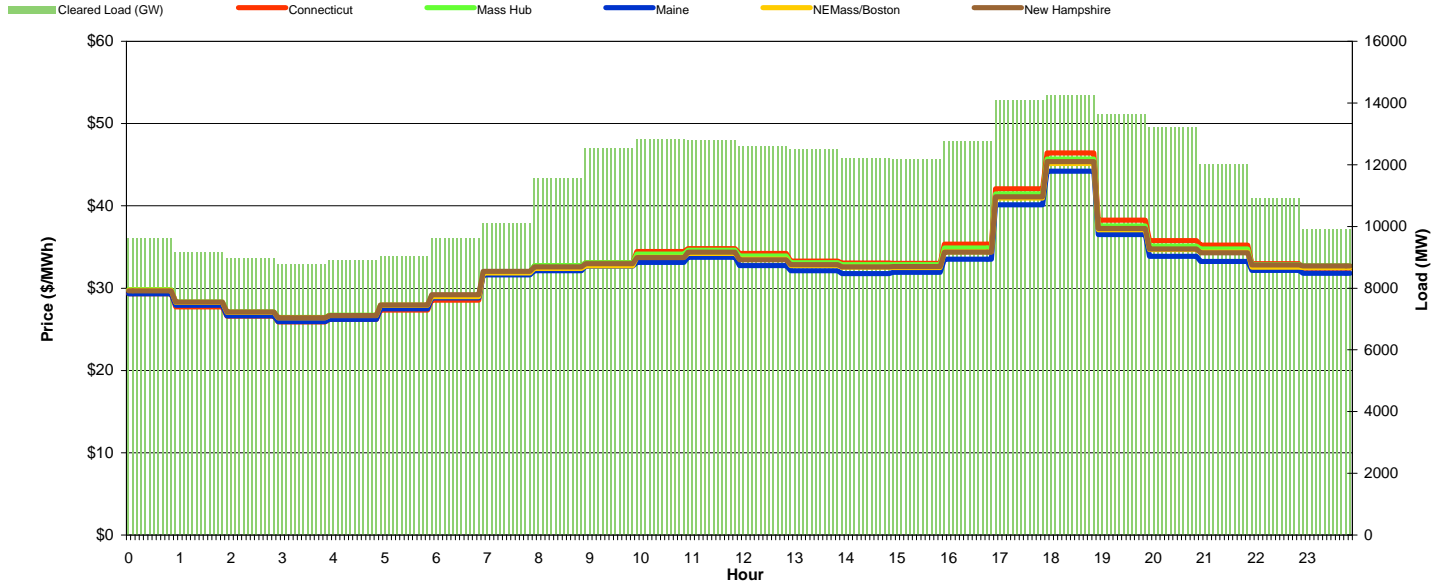

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
																										All	On Pk	
Connecticut	33.74	35.07	35.48	30.23	31.48	27.29	27.40	26.53	31.30	33.35	30.86	35.55	39.23	35.94	33.85	32.74	30.68	30.76	27.90	36.29	36.74	43.54	34.20	36.94	33.21	33.72		
NEMass/Boston	34.00	35.61	36.05	30.72	32.03	27.85	27.86	26.65	31.25	33.03	30.56	35.10	38.51	35.33	33.34	32.29	30.28	30.52	27.41	35.63	35.86	42.90	33.99	37.13	33.08	33.29		
New Hampshire	33.75	35.58	36.13	30.77	32.03	27.77	27.67	26.47	31.18	33.08	30.48	35.00	38.34	35.21	33.22	32.20	30.25	30.57	27.46	35.68	35.98	42.71	33.82	37.17	33.02	33.23		
Maine	33.32	35.19	35.68	30.44	31.54	27.43	27.18	26.05	30.72	32.68	30.01	34.54	37.57	34.49	32.44	31.48	29.55	29.99	27.00	34.98	35.19	41.44	32.89	36.38	32.42	32.56		
Mass Hub	34.16	35.70	36.18	30.82	32.14	27.87	27.90	26.76	31.47	33.37	30.85	35.46	38.97	35.74	33.70	32.63	30.58	30.72	27.64	36.00	36.31	43.28	34.24	37.29	33.32	33.61		
DA Forecast Load (GW)	10.63	10.03	9.65	9.53	9.50	9.77	10.47	11.10	11.96	12.71	13.05	13.22	13.24	13.09	12.95	12.95	13.28	14.06	15.20	15.19	14.68	13.68	12.51	11.44				
Forecast Error %	-0.6%	0.0%	3.7%	3.1%	3.6%	0.4%	-2.3%	-1.7%	-1.4%	-0.9%	-0.2%	0.5%	1.1%	1.8%	2.3%	2.7%	2.0%	0.1%	-4.0%	-5.2%	-2.9%	-0.5%	0.0%	-0.4%				

