




# ISO-NE Daily Report

Monday November 01, 2010

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$				
																										All	On Pk		
Connecticut	32.20	32.31	32.29	29.41	32.28	29.81	37.10	37.23	39.00	37.08	38.22	36.19	35.63	35.82	35.09	35.06	37.64	51.17	51.45	46.99	39.91	36.71	32.93	32.58	32.58	36.84	39.13		
NEMass/Boston	32.45	32.48	32.52	29.78	32.54	29.93	36.41	36.22	37.66	36.03	36.81	35.07	34.58	34.80	34.11	34.09	36.39	49.12	49.69	45.36	38.38	35.77	32.59	32.58	36.06	37.92			
New Hampshire	32.69	32.83	32.90	30.10	32.94	30.22	37.07	36.90	38.28	36.58	37.33	35.50	34.95	35.19	34.45	34.47	36.63	49.42	49.92	45.67	38.70	36.14	33.01	32.81	36.45	38.32			
Maine	31.96	31.97	32.05	29.43	32.05	29.87	37.97	36.51	37.59	36.14	36.58	34.92	34.35	34.54	33.60	33.77	35.90	48.03	48.74	44.34	37.73	35.64	32.36	32.03	35.75	37.55			
Mass Hub	32.74	32.85	32.92	30.07	32.87	30.31	37.10	36.81	38.29	36.55	37.37	35.55	35.00	35.23	34.48	34.49	36.88	49.67	50.39	45.95	38.94	36.16	32.83	32.86	36.51	38.41			
Cleared Load (GW)	9.9	9.6	9.8	9.8	9.8	10.7	13.2	14.4	14.5	14.6	14.7	14.6	14.2	14.2	13.9	14.0	14.7	15.4	16.1	15.2	14.6	13.3	12.2	10.8					

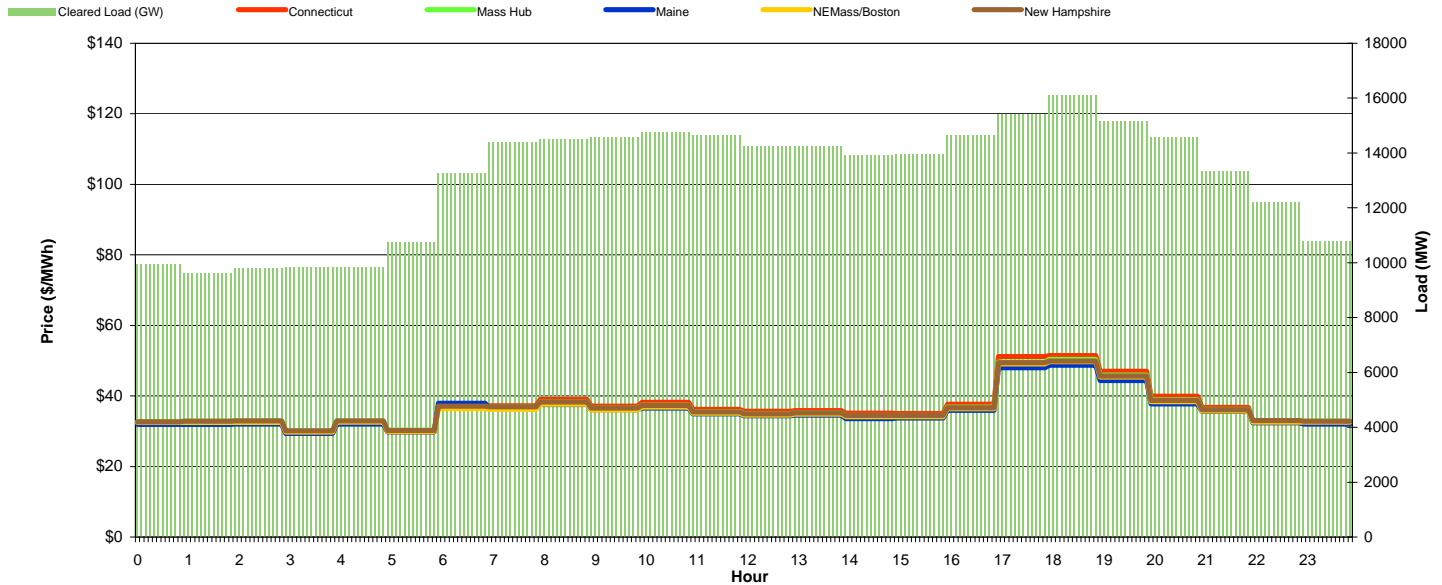

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
																										All	On Pk	
Connecticut	32.19	32.49	33.73	29.10	33.66	31.18	44.01	39.44	51.77	51.08	126.00	35.06	35.31	41.17	37.97	35.69	36.41	52.69	40.69	49.86	38.94	36.22	32.55	31.40	42.03	46.30		
NEMass/Boston	32.56	32.80	34.12	29.41	33.82	31.28	43.48	38.50	50.59	49.82	122.57	34.59	34.75	40.41	37.21	34.83	35.60	51.34	39.84	48.80	37.91	35.24	32.01	31.21	41.36	45.25		
New Hampshire	32.78	33.08	34.41	29.63	34.03	31.44	43.97	38.79	51.01	50.07	123.09	34.66	34.87	40.62	37.45	35.03	35.75	51.58	40.09	48.89	37.84	35.30	32.06	31.14	41.57	45.44		
Maine	32.04	32.41	33.70	29.09	33.48	30.97	43.43	38.03	50.24	48.78	119.47	33.63	34.18	39.63	36.70	34.34	35.07	50.47	39.44	47.23	36.57	34.66	31.69	30.56	40.66	44.38		
Mass Hub	32.68	32.95	34.31	29.57	34.12	31.55	43.98	38.94	51.16	50.41	124.08	34.98	35.14	40.90	37.64	35.26	36.01	51.91	40.26	49.40	38.41	35.73	32.36	31.51	41.80	45.79		
DA Forecast Load (GW)	10.73	10.33	10.19	10.21	10.58	11.69	13.88	15.24	15.45	15.52	15.56	15.47	15.27	15.12	14.88	14.69	14.86	15.58	16.60	16.57	15.98	14.85	13.38	12.05				
Forecast Error %	-0.8%	-0.6%	1.9%	2.1%	1.7%	-0.7%	-0.8%	-0.1%	0.5%	0.2%	1.0%	1.0%	1.1%	1.3%	1.5%	2.2%	2.6%	3.6%	3.4%	1.8%	1.2%	1.4%	1.7%	2.0%				

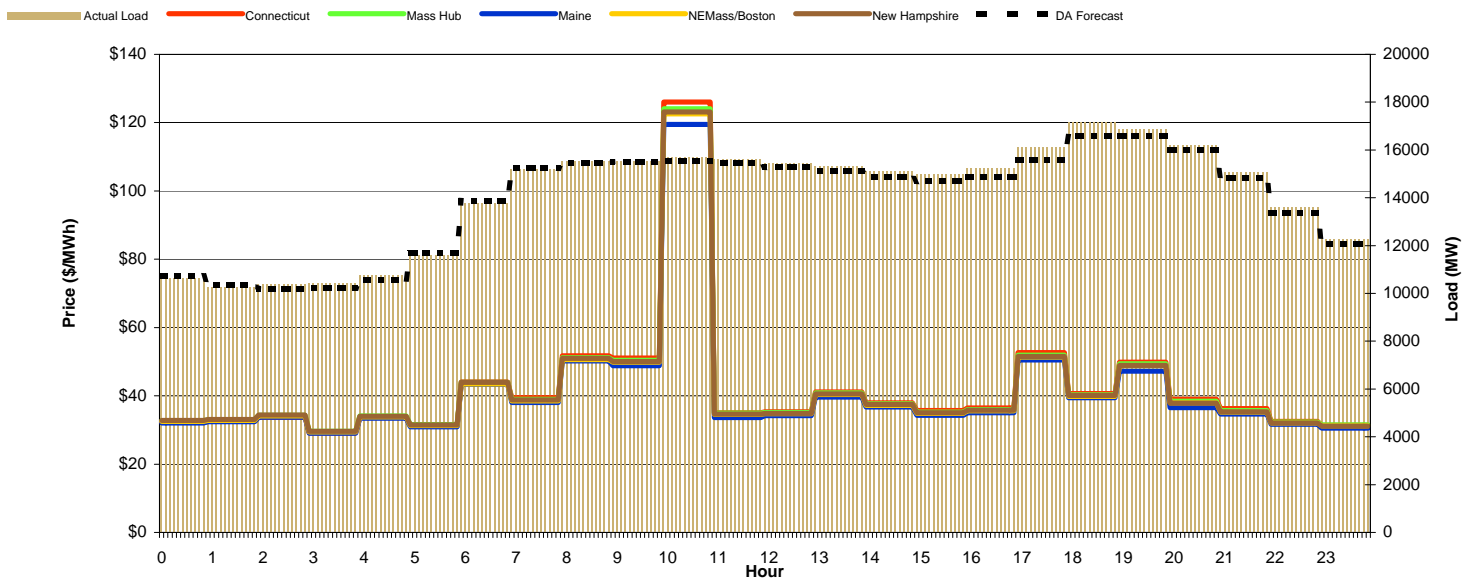




# ISO-NE Daily Report

Tuesday November 02, 2010

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	32.88	32.00	30.66	30.63	32.19	34.35	46.19	47.76	47.13	46.27	48.76	45.03	44.53	41.32	37.98	37.91	45.79	53.71	53.36	53.00	47.65	40.54	36.47	33.64	41.66	45.45	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	32.74	32.00	30.75	30.69	32.28	34.18	45.18	46.18	45.50	44.77	46.16	42.88	40.63	39.10	36.67	36.68	42.84	50.17	51.19	48.84	45.64	39.15	35.82	33.39	40.14	43.26		
<b>New Hampshire</b>	32.81	32.13	30.84	30.79	32.42	34.48	45.60	46.52	45.75	44.96	46.60	43.29	41.36	39.57	36.96	36.99	43.36	50.67	51.59	49.60	45.94	39.29	36.06	33.47	40.46	43.66		
<b>Maine</b>	32.20	31.58	30.31	30.22	31.93	34.29	44.36	44.86	44.10	43.45	44.89	42.00	40.08	38.45	36.29	36.41	42.26	49.11	50.29	47.93	44.35	38.50	35.73	32.81	39.43	42.42		
<b>Mass Hub</b>	33.09	32.34	31.08	31.03	32.62	34.66	45.88	46.78	46.05	45.24	46.86	43.44	41.51	39.58	36.97	37.01	43.58	51.17	51.89	49.82	46.29	39.65	36.16	33.75	40.69	43.88		
<b>Cleared Load (GW)</b>	10.8	10.3	10.4	10.3	10.5	11.3	13.4	14.4	14.5	14.6	14.4	14.5	14.3	14.2	14.1	14.2	14.4	15.6	15.9	15.0	14.5	13.6	12.3	11.0				

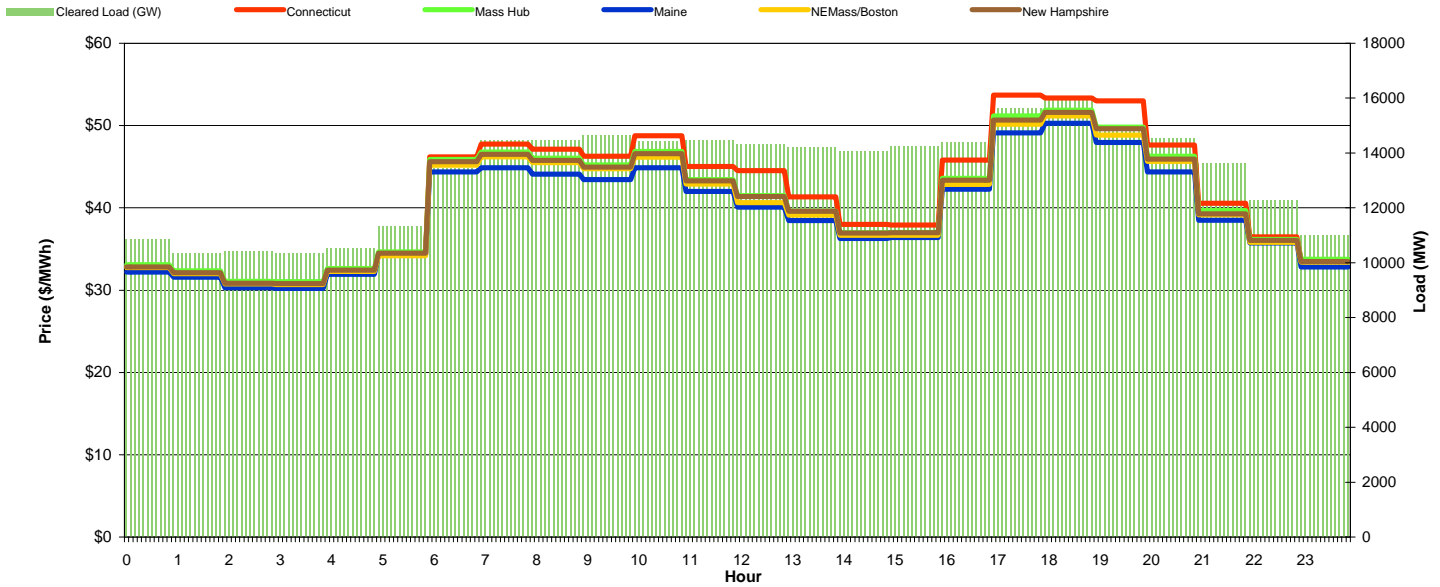

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	32.75	31.41	29.30	29.53	29.95	32.85	38.23	44.19	38.81	40.28	38.39	35.51	39.37	35.37	37.61	33.36	34.40	36.52	46.57	36.53	36.38	37.04	35.74	35.58	36.07	37.88	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	32.65	31.38	29.37	29.55	29.99	32.79	37.46	42.60	37.51	38.76	36.86	33.86	37.85	34.13	36.48	32.40	33.34	35.21	44.50	34.82	35.19	35.65	34.79	35.07	35.09	36.50		
<b>New Hampshire</b>	32.56	31.29	29.22	29.39	29.83	32.72	37.59	42.77	37.59	38.83	37.00	34.02	37.99	34.31	36.81	32.60	33.47	35.30	44.72	35.05	35.27	35.72	34.70	35.08	35.16	36.63		
<b>Maine</b>	32.05	30.80	28.77	28.87	29.27	32.14	36.90	41.52	36.57	37.69	35.93	33.11	36.99	33.62	35.96	32.02	32.91	34.59	43.76	34.35	34.48	34.99	33.99	34.53	34.41	35.78		
<b>Mass Hub</b>	32.97	31.67	29.59	29.79	30.23	33.06	37.92	43.24	37.97	39.37	37.49	34.48	38.42	34.61	36.99	32.84	33.82	35.76	45.25	35.41	35.73	36.28	35.27	35.50	35.57	37.06		
<b>DA Forecast Load (GW)</b>	11.62	11.17	10.98	10.94	11.25	12.37	14.61	15.89	15.94	15.83	15.79	15.65	15.50	15.34	15.11	15.09	15.31	16.14	17.12	16.86	16.45	15.50	14.01	12.38				
<b>Forecast Error %</b>	-0.3%	-0.7%	-1.1%	-1.2%	-1.5%	-2.1%	-5.2%	-4.1%	-2.7%	-1.0%	-0.2%	0.6%	0.3%	0.2%	-0.3%	-1.4%	-2.1%	-2.3%	-0.8%	0.0%	-1.2%	-1.7%	-1.7%	0.7%				

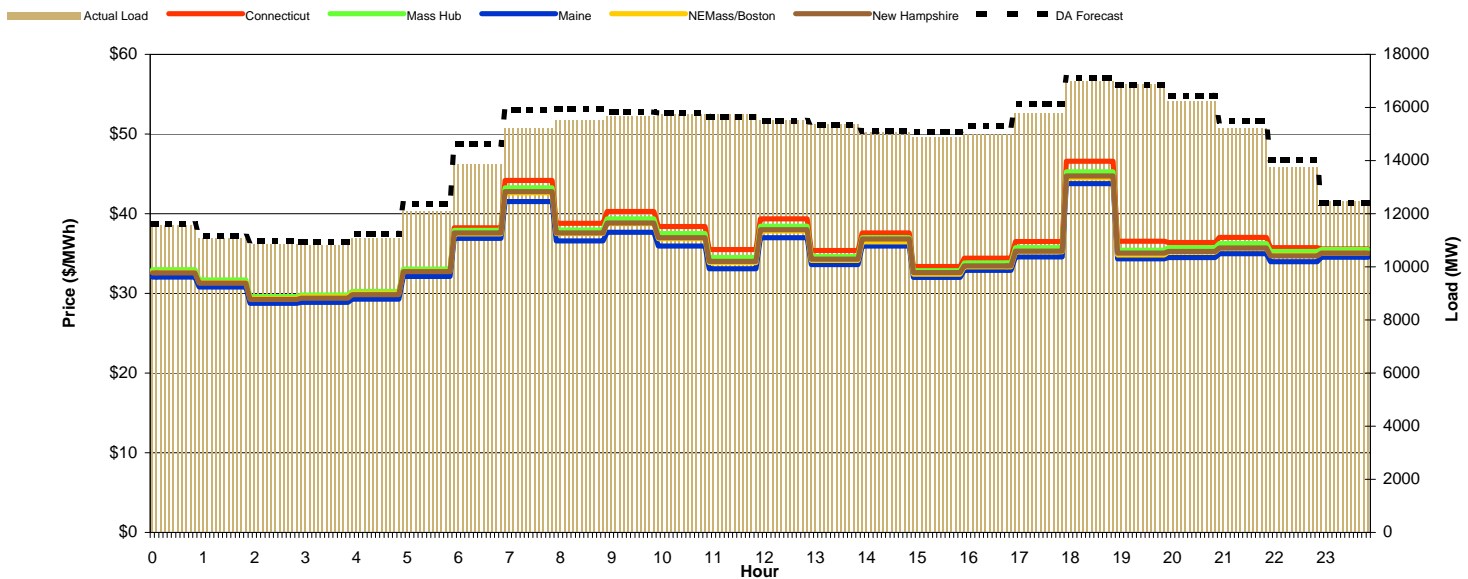




# ISO-NE Daily Report

Wednesday November 03, 2010

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	32.68	31.86	31.56	31.67	31.70	34.60	42.78	48.00	47.41	48.20	48.00	43.24	40.45	38.51	38.80	37.70	42.49	50.56	51.68	49.15	45.53	39.99	35.00	34.44	40.67	44.04	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	32.50	31.90	31.67	31.68	31.77	34.23	41.93	45.96	45.39	46.10	45.89	41.66	39.18	37.37	37.27	36.49	41.03	48.65	49.23	47.30	43.85	38.58	34.40	34.02	39.50	42.40		
<b>New Hampshire</b>	32.36	31.79	31.58	31.65	31.77	34.33	42.40	46.23	45.45	46.00	45.94	41.77	39.29	37.47	37.39	36.55	41.07	48.58	49.36	47.34	43.81	38.72	34.35	33.82	39.54	42.46		
<b>Maine</b>	31.81	31.14	30.95	31.04	31.22	33.93	43.71	44.81	43.93	44.10	44.29	40.67	38.31	36.81	36.67	36.01	40.36	47.15	47.98	46.02	42.64	38.19	34.01	33.18	38.71	41.37		
<b>Mass Hub</b>	32.88	32.17	31.95	32.01	32.09	34.74	42.54	46.49	45.85	46.48	46.31	41.94	39.49	37.58	37.52	36.66	41.38	49.17	49.89	47.82	44.29	38.86	34.51	34.35	39.87	42.77		
<b>Cleared Load (GW)</b>	10.9	10.5	10.5	10.5	10.6	11.3	13.9	14.5	14.5	14.5	14.5	14.6	14.7	14.5	14.0	14.0	14.6	15.7	15.8	15.4	14.6	13.5	12.1	10.7				

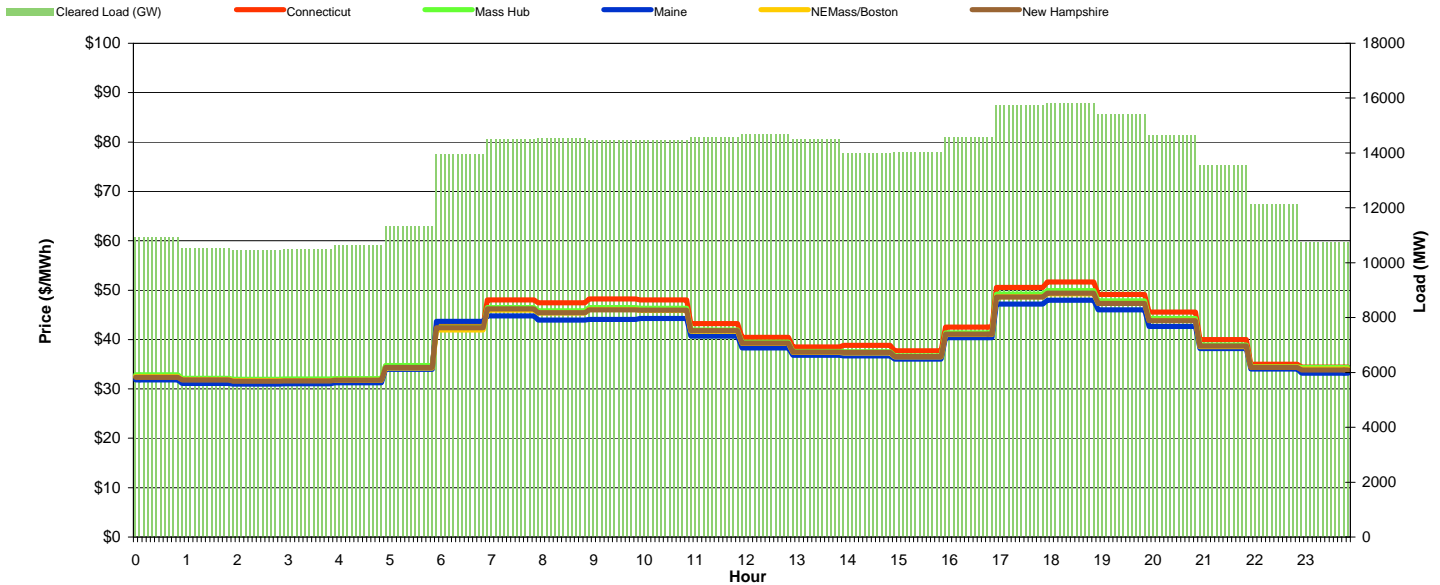

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	33.81	32.92	32.63	32.90	32.92	43.21	93.59	45.01	48.62	52.34	38.70	37.76	37.38	39.94	37.88	35.09	35.92	45.94	39.44	42.87	41.37	38.11	35.68	36.29	41.26	40.75	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	33.40	32.84	32.68	32.94	32.84	42.67	91.87	43.92	47.32	51.01	37.46	36.39	36.47	38.88	36.82	34.32	35.24	45.13	38.15	41.52	40.27	37.08	35.10	35.91	40.43	39.69		
<b>New Hampshire</b>	33.42	32.72	32.51	32.80	32.78	42.69	92.20	44.00	47.36	51.04	37.53	36.46	36.49	38.93	36.82	34.28	35.21	45.04	38.24	41.49	40.16	37.04	35.03	35.74	40.42	39.70		
<b>Maine</b>	32.89	32.27	32.04	32.39	32.39	42.05	90.99	42.90	46.12	49.78	36.60	35.42	35.60	38.03	35.93	33.74	34.80	44.27	37.56	40.67	39.20	36.34	34.62	35.24	39.66	38.85		
<b>Mass Hub</b>	33.85	33.13	32.91	33.18	33.15	43.18	92.90	44.33	47.77	51.48	37.91	36.86	36.83	39.29	37.21	34.61	35.52	45.44	38.50	41.85	40.55	37.40	35.36	36.15	40.81	40.06		
<b>DA Forecast Load (GW)</b>	11.44	10.97	10.76	10.74	11.09	12.21	14.41	15.73	15.90	15.83	15.85	15.82	15.65	15.51	15.30	15.25	15.49	16.16	17.09	16.97	16.44	15.32	13.74	12.36				
<b>Forecast Error %</b>	3.7%	3.9%	4.1%	4.1%	3.6%	0.8%	0.4%	0.8%	0.9%	1.3%	0.6%	-0.5%	-1.6%	-1.7%	-1.7%	-2.3%	-2.9%	-1.8%	-0.4%	-0.8%	-1.4%	-1.2%	-0.7%	0.2%				

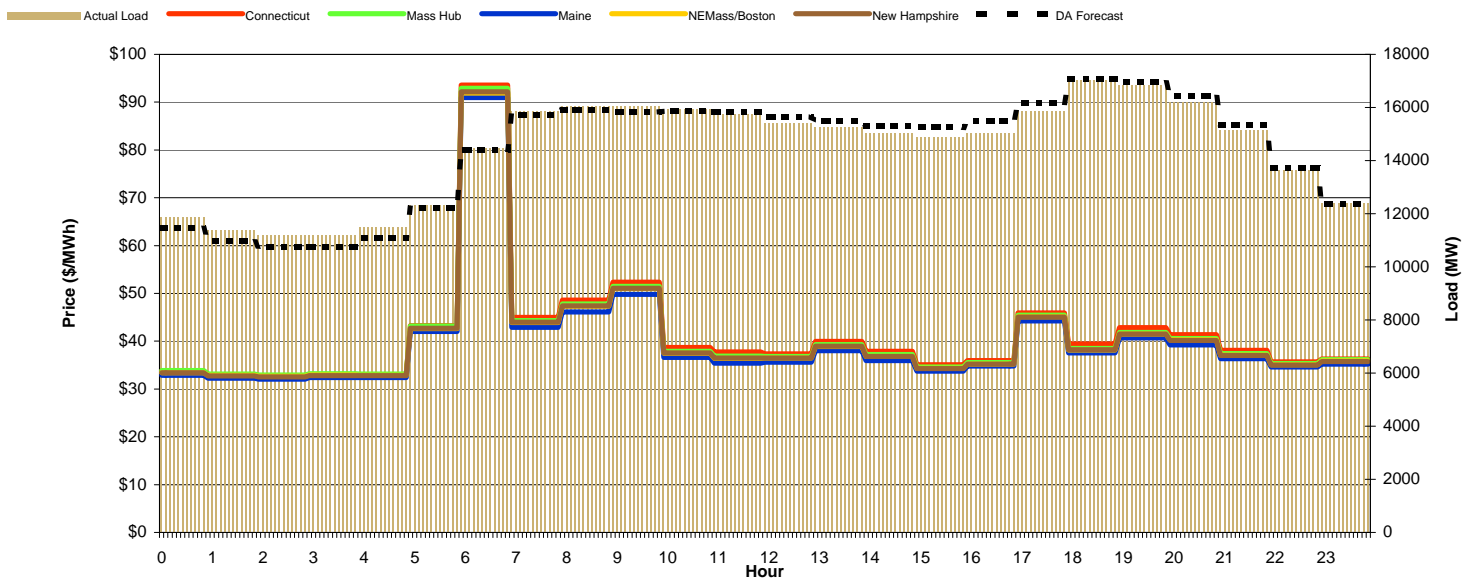




# ISO-NE Daily Report

Thursday November 04, 2010

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	33.52	32.52	31.72	32.48	32.43	34.92	42.34	46.58	46.55	48.49	48.90	48.00	48.03	48.00	44.33	43.51	48.59	52.97	59.33	51.55	46.44	40.20	36.60	35.64	43.07	47.38	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	33.54	32.65	32.03	32.56	32.62	34.89	41.81	45.04	44.85	46.63	46.72	45.88	46.05	46.12	42.66	41.80	46.26	50.22	56.43	49.11	44.47	38.91	36.02	35.28	41.77	45.45		
<b>New Hampshire</b>	33.41	32.48	31.90	32.40	32.49	34.92	42.01	45.06	44.85	46.61	46.78	45.92	46.00	45.97	42.59	41.84	46.45	50.45	56.69	49.24	44.53	38.99	36.19	35.32	41.80	45.51		
<b>Maine</b>	33.03	32.02	31.46	31.96	32.11	37.89	41.63	44.14	43.79	45.31	45.41	44.67	44.64	44.59	41.66	41.15	45.33	49.27	55.56	48.06	43.75	38.68	35.91	34.70	41.11	44.50		
<b>Mass Hub</b>	33.90	32.98	32.29	32.92	32.94	35.30	42.35	45.65	45.34	47.13	47.31	46.35	46.49	46.48	42.97	42.23	46.99	50.95	57.35	49.80	45.08	39.30	36.20	35.54	42.24	45.98		
<b>Cleared Load (GW)</b>	10.7	10.4	10.2	10.1	10.4	11.1	13.2	14.2	14.3	14.2	14.4	14.2	14.1	13.9	14.0	14.0	14.3	15.4	15.3	15.0	14.2	13.3	11.8	10.6				

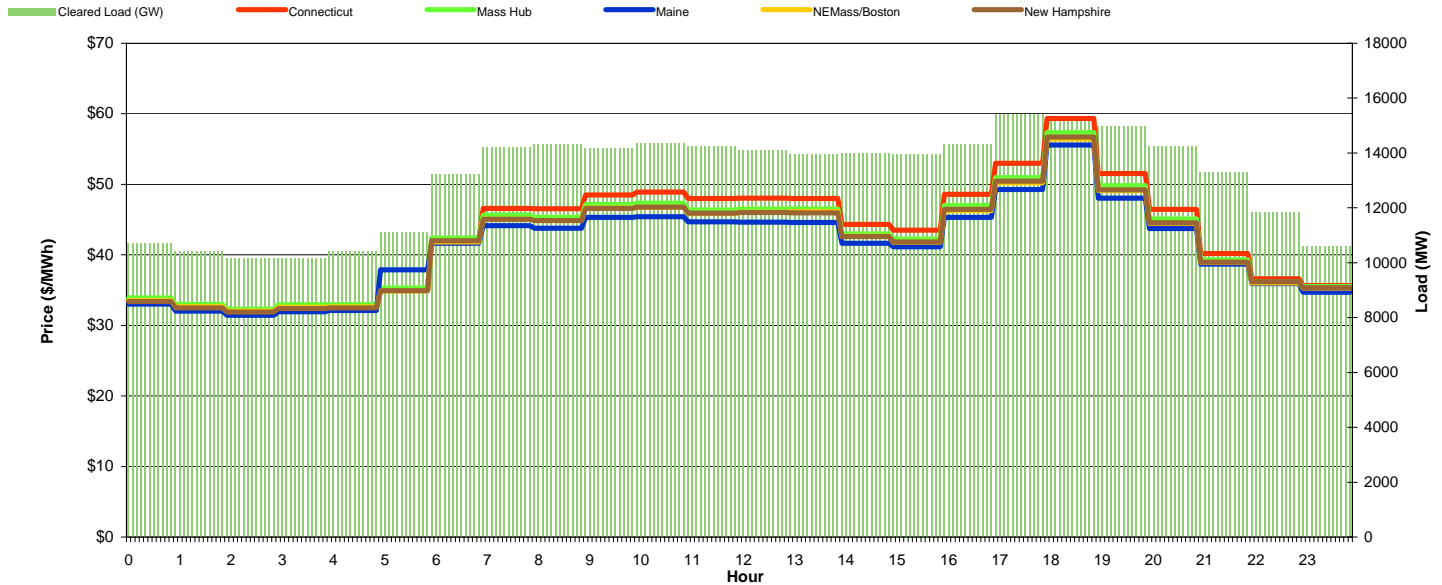

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	34.61	32.39	31.56	32.12	32.46	34.10	40.72	45.14	44.84	51.04	39.46	42.21	40.03	39.25	35.10	35.25	34.29	38.28	37.51	34.73	35.14	39.41	49.17	44.83	38.49	40.05	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	34.66	32.51	31.86	32.39	32.66	34.07	40.55	44.08	43.50	49.17	38.06	40.62	38.46	37.74	33.90	34.08	33.11	36.69	35.83	33.15	34.10	38.24	48.04	44.47	37.58	38.67		
<b>New Hampshire</b>	34.45	32.32	31.72	32.25	32.50	33.96	40.47	43.98	43.38	49.11	38.09	40.65	38.53	37.84	33.98	34.12	33.16	36.76	35.89	33.06	33.74	37.83	47.73	44.40	37.50	38.62		
<b>Maine</b>	34.08	31.92	31.39	31.96	32.21	33.72	40.31	43.15	42.28	47.77	37.16	39.53	37.51	37.04	33.47	33.61	32.64	35.94	34.96	31.74	32.03	36.11	46.13	43.58	36.68	37.57		
<b>Mass Hub</b>	34.84	32.67	31.97	32.52	32.81	34.25	40.71	44.31	43.77	49.61	38.40	41.02	38.92	38.19	34.25	34.44	33.45	37.12	36.32	33.61	34.42	38.62	48.46	44.72	37.89	39.06		
<b>DA Forecast Load (GW)</b>	11.44	10.90	10.75	10.71	10.98	12.05	14.26	15.56	15.77	15.85	16.01	15.93	15.90	15.88	15.78	15.82	16.25	17.10	17.26	16.88	16.24	15.22	13.75	12.26				
<b>Forecast Error %</b>	2.4%	3.2%	2.3%	2.0%	1.8%	1.2%	-1.5%	-0.2%	0.2%	1.7%	1.3%	2.1%	1.8%	1.8%	1.5%	0.9%	-0.2%	-1.3%	-0.5%	-0.4%	-1.0%	-1.7%	-2.0%	-1.3%				

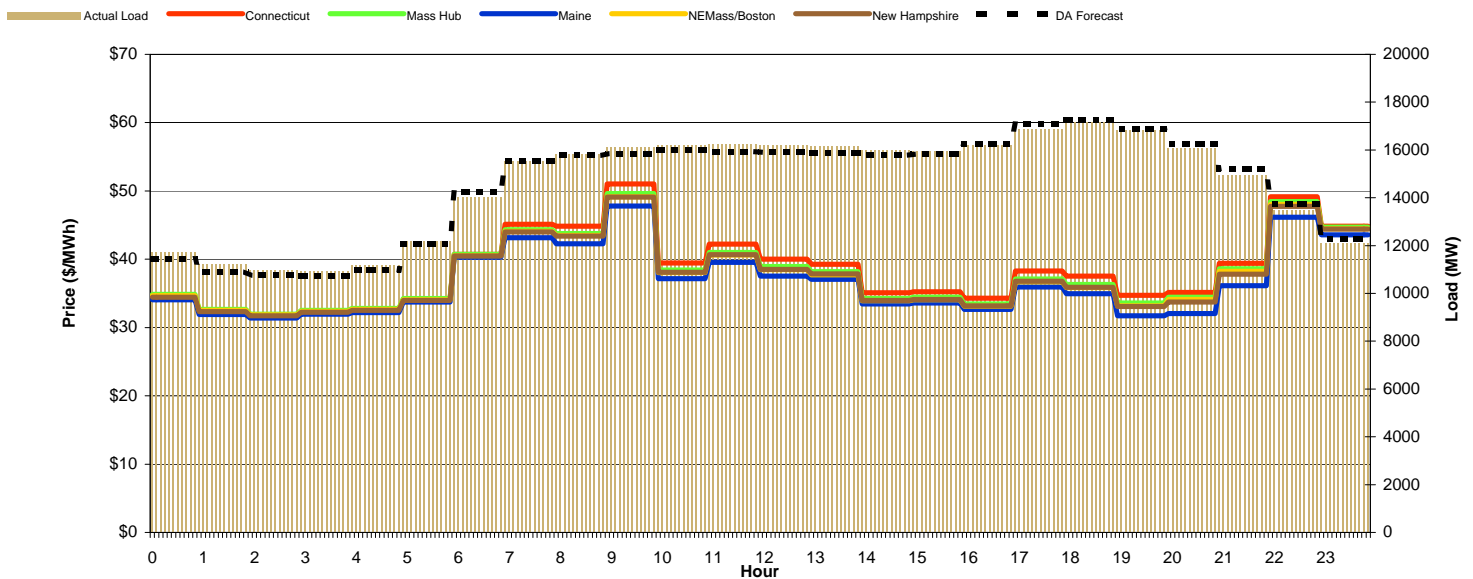




# ISO-NE Daily Report

Friday November 05, 2010

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	32.51	31.95	30.75	30.41	31.13	32.64	38.71	41.15	42.21	42.36	43.46	42.53	42.32	40.63	39.02	39.33	40.22	48.15	51.10	47.34	42.00	38.58	37.80	36.95	39.30	42.39	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	32.71	32.32	31.18	30.84	31.55	33.09	38.29	39.98	40.98	40.93	41.97	41.03	41.16	39.60	38.11	38.32	39.10	46.35	49.09	45.50	40.55	37.60	37.15	36.87	38.51	41.09		
<b>New Hampshire</b>	32.59	32.21	31.10	30.74	31.50	33.04	38.73	40.28	41.10	41.17	42.08	41.09	41.15	39.59	38.11	38.27	39.04	46.32	48.93	45.44	40.43	37.50	36.97	36.62	38.50	41.09		
<b>Maine</b>	32.00	31.62	30.49	30.12	30.87	32.63	38.66	39.50	40.20	40.36	41.08	39.94	40.17	38.69	37.37	37.38	38.25	44.99	47.32	44.00	39.37	36.61	36.05	36.31	37.67	40.08		
<b>Mass Hub</b>	32.82	32.39	31.21	30.87	31.59	33.13	38.55	40.18	41.19	41.31	42.30	41.31	41.29	39.80	38.23	38.42	39.26	46.76	49.79	45.95	40.91	37.78	37.21	37.03	38.72	41.36		
<b>Cleared Load (GW)</b>	10.0	9.9	9.6	9.5	9.7	10.3	12.9	13.8	14.1	14.5	14.4	14.3	14.0	14.1	14.0	13.9	14.1	14.6	14.9	14.2	13.7	12.5	11.3	10.3				

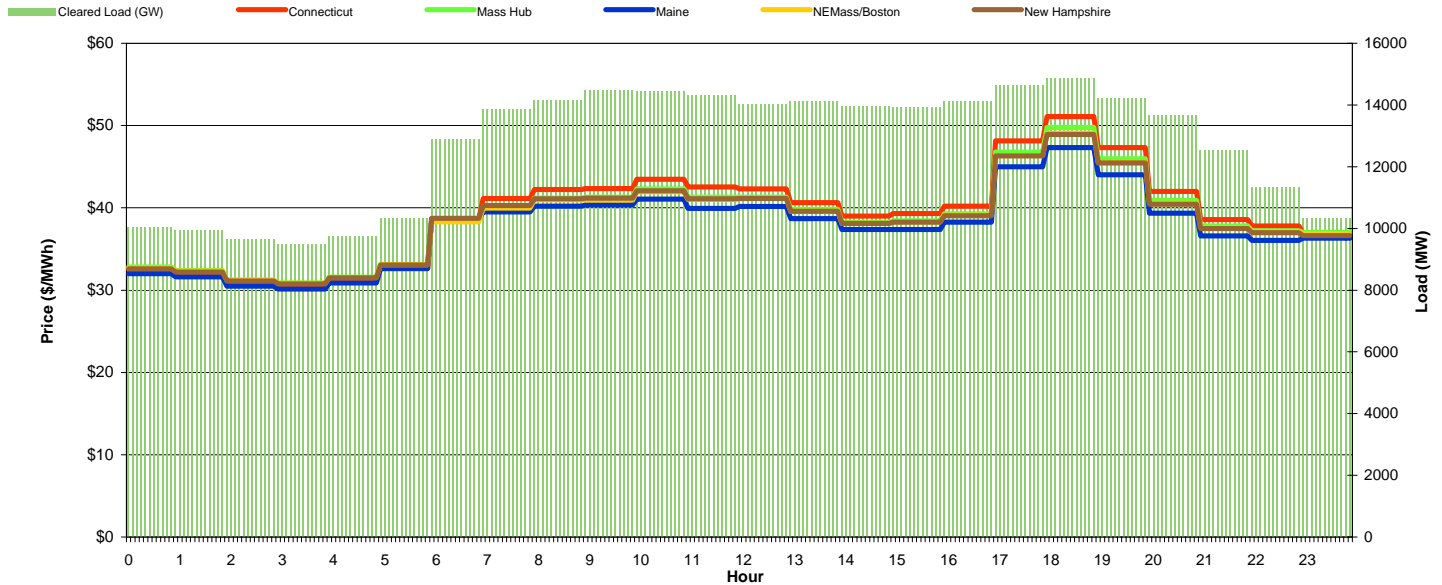

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	33.90	32.30	31.42	31.50	32.06	32.24	39.94	48.46	38.66	42.78	40.46	44.81	38.49	35.76	34.61	33.67	33.92	38.64	41.12	40.53	35.93	37.29	34.47	33.26	36.93	38.73	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	34.09	32.59	31.84	31.94	32.43	32.44	39.66	47.30	37.54	41.30	39.02	43.13	37.12	34.65	33.69	32.82	33.09	37.61	39.74	39.13	34.76	36.21	33.77	32.89	36.20	37.56		
<b>New Hampshire</b>	33.85	32.33	31.59	31.72	32.22	32.23	39.50	47.10	37.44	41.19	38.95	43.06	37.02	34.48	33.44	32.60	32.89	37.35	39.56	38.92	34.62	35.89	33.29	32.31	35.98	37.36		
<b>Maine</b>	33.24	31.66	31.01	31.12	31.68	31.78	38.92	45.73	36.43	39.81	37.58	41.57	35.85	33.38	32.34	31.70	32.02	36.06	38.14	37.48	33.52	34.76	32.35	31.25	34.97	36.17		
<b>Mass Hub</b>	34.12	32.64	31.86	31.95	32.47	32.55	39.89	47.72	37.91	41.83	39.55	43.74	37.63	35.08	34.05	33.14	33.40	38.01	40.23	39.66	35.22	36.63	34.04	33.13	36.52	37.99		
<b>DA Forecast Load (GW)</b>	11.18	10.72	10.47	10.38	10.68	11.70	13.73	15.10	15.48	15.72	15.87	15.81	15.68	15.57	15.43	15.30	15.75	16.39	16.57	16.07	15.37	14.53	13.41	12.16				
<b>Forecast Error %</b>	-0.3%	1.7%	1.3%	1.5%	0.7%	-0.3%	-2.6%	-0.6%	-0.9%	-1.0%	-1.0%	-0.4%	-0.8%	-0.9%	-1.4%	-1.9%	-4.6%	-5.1%	-2.4%	-2.0%	-1.7%	-1.4%	-1.3%	-0.8%				

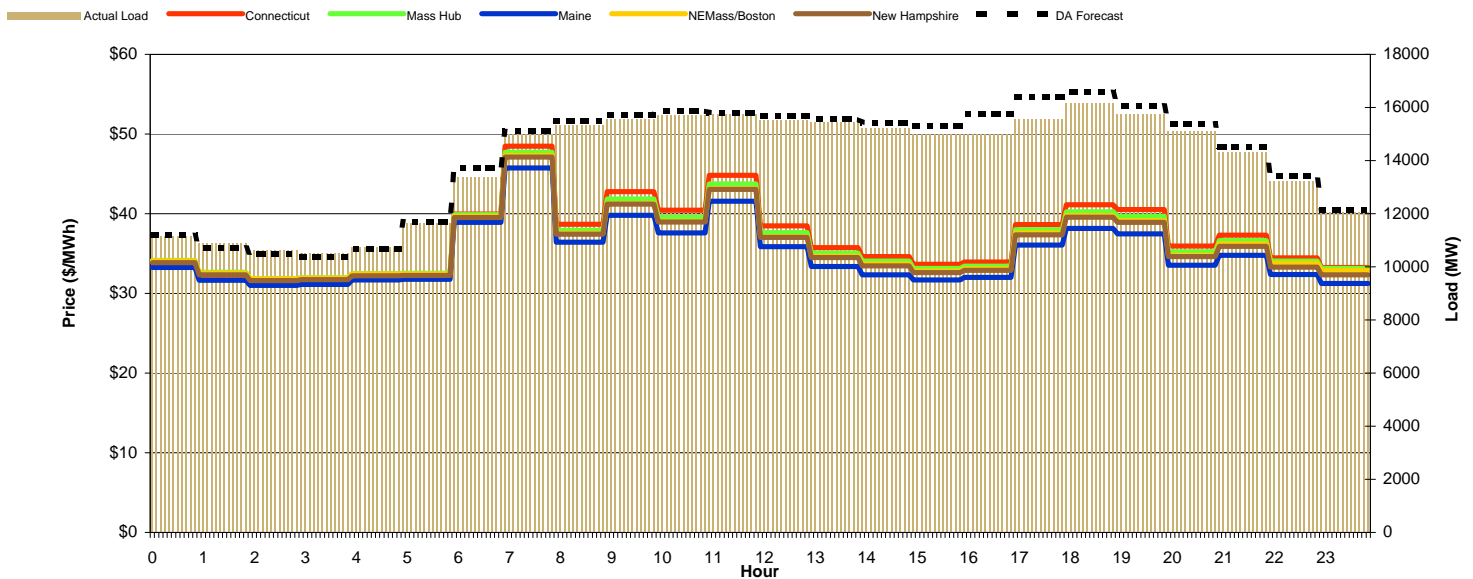




# ISO-NE Daily Report

Saturday November 06, 2010

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	35.69	34.25	33.05	32.99	34.09	34.12	37.40	41.43	47.00	51.58	52.79	52.73	42.19	39.00	39.18	38.71	42.80	59.10	51.73	51.81	50.00	41.66	39.27	38.43	42.54	46.31	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	35.26	34.20	33.05	33.01	34.07	33.96	36.62	39.66	44.80	48.98	49.60	49.09	40.06	37.36	37.45	37.11	40.75	55.87	49.23	49.08	47.50	39.54	37.47	37.22	40.87	43.97		
<b>New Hampshire</b>	34.73	33.69	32.52	32.41	33.51	33.53	36.19	39.24	44.28	48.28	48.86	47.76	39.39	36.86	36.93	36.54	40.15	54.92	48.56	48.20	46.61	38.87	36.84	36.41	40.22	43.27		
<b>Maine</b>	34.24	33.30	31.99	31.94	32.97	32.97	35.64	38.32	43.17	46.54	46.62	46.29	38.03	36.03	36.06	35.71	38.90	52.81	46.87	46.34	45.13	37.89	35.66	35.60	39.13	41.90		
<b>Mass Hub</b>	35.70	34.51	33.34	33.29	34.39	34.32	37.20	40.58	45.97	50.18	51.31	50.77	40.91	38.03	38.16	37.77	41.61	57.34	50.41	50.28	48.61	40.54	38.39	37.93	41.73	45.05		
<b>Cleared Load (GW)</b>	10.3	9.8	9.4	9.3	9.5	9.8	10.6	11.5	12.7	12.9	13.3	13.0	12.8	12.5	12.3	12.4	13.0	13.7	14.3	13.6	12.7	12.6	11.5	10.2				

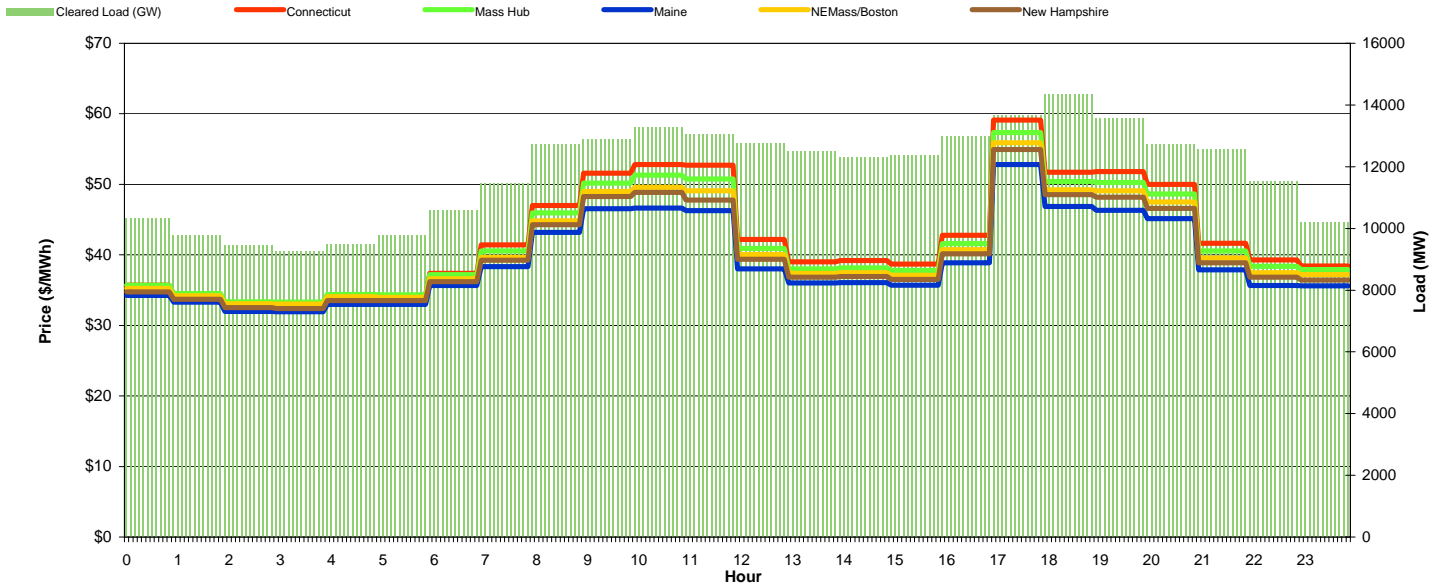

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	34.22	33.07	33.18	33.63	33.13	35.51	33.52	34.03	36.54	37.22	38.40	49.44	34.03	33.90	34.14	33.58	34.96	41.04	42.62	35.92	37.64	35.73	34.53	34.96	36.04	37.11	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	34.00	33.05	33.23	33.70	33.24	35.48	33.08	32.81	35.00	35.57	36.70	47.58	33.00	32.76	33.23	32.73	33.88	39.50	40.90	34.35	36.36	34.34	33.38	34.30	35.09	35.76		
<b>New Hampshire</b>	33.41	32.36	32.53	33.01	32.58	34.92	32.58	32.24	34.61	35.22	36.39	47.32	32.73	32.46	32.92	32.45	33.56	39.12	40.49	33.93	35.85	33.74	32.72	33.66	34.62	35.36		
<b>Maine</b>	32.58	31.59	31.78	32.27	32.02	34.41	32.19	31.44	33.99	34.53	35.78	46.87	32.03	31.98	32.48	32.11	32.96	38.43	39.68	33.25	35.28	33.11	32.00	33.23	34.00	34.75		
<b>Mass Hub</b>	34.22	33.22	33.40	33.88	33.40	35.74	33.48	33.38	35.63	36.21	37.31	48.19	33.41	33.21	33.64	33.10	34.32	40.07	41.51	34.93	36.87	34.91	33.90	34.71	35.53	36.29		
<b>DA Forecast Load (GW)</b>	11.20	10.68	10.38	10.29	10.37	10.77	11.59	12.54	13.56	14.19	14.45	14.39	14.20	13.90	13.66	13.61	13.89	14.66	15.49	15.17	14.58	13.90	12.94	11.92				
<b>Forecast Error %</b>	-0.7%	-0.8%	-0.6%	-1.1%	-1.4%	-1.1%	-1.2%	-0.3%	-0.8%	0.3%	1.0%	1.1%	0.6%	0.7%	0.3%	-0.2%	-0.4%	0.5%	-0.5%	-0.8%	-0.3%	0.0%	0.6%	0.5%				

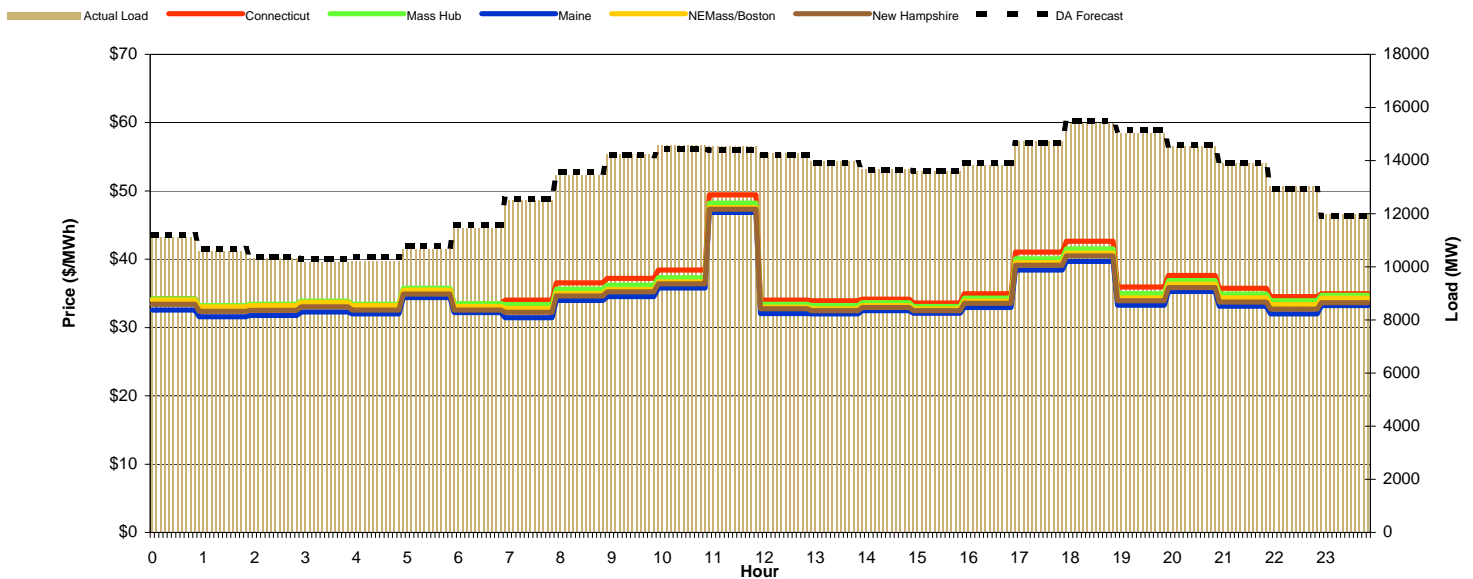




# ISO-NE Daily Report

Sunday November 07, 2010

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
	All	On Pk																										
Connecticut	34.29	34.07	32.98	33.20	33.54	34.31	34.31	35.15	36.15	38.00	39.54	37.47	38.43	37.74	36.35	38.20	50.84	57.64	51.61	45.71	39.04	39.98	#N/A	#N/A	#N/A	#N/A		
NEMass/Boston	34.14	34.03	33.02	33.23	33.47	34.13	34.14	34.46	35.34	36.81	38.25	36.35	37.02	36.45	35.24	36.83	48.96	55.55	49.28	44.14	37.70	38.55	#N/A	#N/A	#N/A	#N/A		
New Hampshire	33.78	33.65	32.60	32.76	33.01	33.77	33.79	34.15	35.10	36.41	37.64	35.95	36.51	36.02	34.93	36.39	48.11	54.82	48.62	43.38	37.09	37.83	#N/A	#N/A	#N/A	#N/A		
Maine	34.87	34.73	34.65	34.00	34.64	34.87	38.00	42.07	34.92	35.82	36.74	35.37	35.68	35.48	34.83	35.71	46.51	52.89	46.95	42.06	36.00	36.76	#N/A	#N/A	#N/A	#N/A		
Mass Hub	34.52	34.43	33.38	33.60	33.88	34.58	34.52	35.03	36.00	37.60	39.05	37.01	37.77	37.15	35.84	37.55	50.31	56.99	50.40	44.92	38.44	39.33	#N/A	#N/A	#N/A	#N/A		
Cleared Load (GW)	10.0	9.9	9.4	9.7	9.6	9.7	10.1	10.1	10.8	12.0	12.8	13.1	13.2	13.0	12.6	12.5	12.7	13.9	14.9	14.7	14.1	13.7	12.8	11.5				

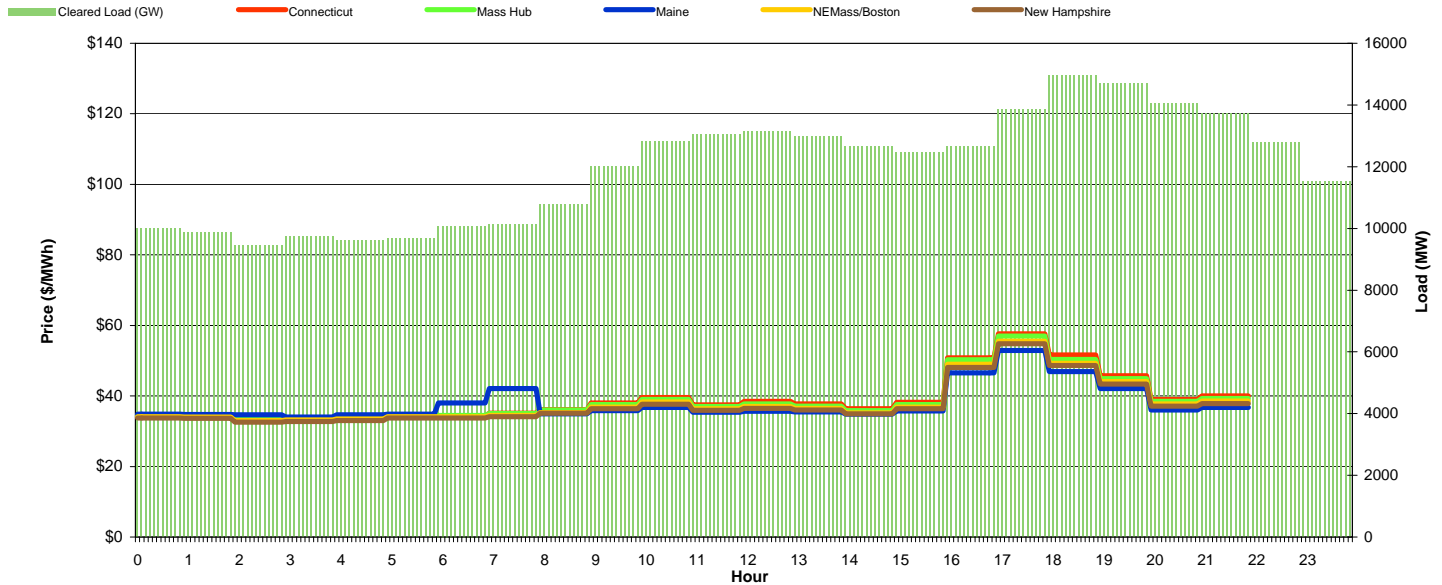

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
	All	On Pk																										
Connecticut	34.38	34.69	32.92	33.66	34.74	32.72	33.25	33.99	45.23	33.68	38.27	35.21	34.90	34.50	34.46	36.80	133.32	56.78	33.63	32.96	32.99	33.16	#N/A	#N/A	#N/A	#N/A		
NEMass/Boston	34.07	34.64	32.83	33.60	34.71	32.50	33.06	33.36	44.32	33.07	37.57	34.32	33.91	33.50	33.62	35.94	130.99	55.54	33.07	32.42	32.44	32.51	#N/A	#N/A	#N/A	#N/A		
New Hampshire	33.48	34.02	32.21	33.01	34.11	31.95	32.55	32.99	43.99	32.83	37.23	34.03	33.65	33.17	33.27	35.69	130.21	55.37	32.87	32.33	32.25	32.15	#N/A	#N/A	#N/A	#N/A		
Maine	33.16	33.82	31.93	32.73	33.80	31.58	32.11	32.60	43.43	32.43	36.58	33.60	33.42	32.73	32.79	35.43	128.46	54.61	32.32	31.77	31.33	31.24	#N/A	#N/A	#N/A	#N/A		
Mass Hub	34.41	34.90	33.15	33.92	35.02	32.84	33.36	33.80	44.91	33.43	38.01	34.80	34.40	33.99	34.07	36.39	132.23	56.18	33.28	32.68	32.74	32.85	#N/A	#N/A	#N/A	#N/A		
DA Forecast Load (GW)	11.19	10.64	10.64	10.34	10.27	10.45	10.88	11.45	12.25	13.17	13.78	14.02	13.98	13.82	13.59	13.46	13.66	14.76	15.95	15.81	15.57	15.00	14.01	12.84				
Forecast Error %	-0.5%	-0.4%	-1.0%	0.6%	1.1%	0.7%	0.6%	-1.3%	-0.6%	0.3%	0.1%	-0.4%	0.2%	1.6%	3.0%	3.7%	3.9%	2.8%	2.2%	2.5%	0.6%	-0.2%	-0.7%	-1.1%				

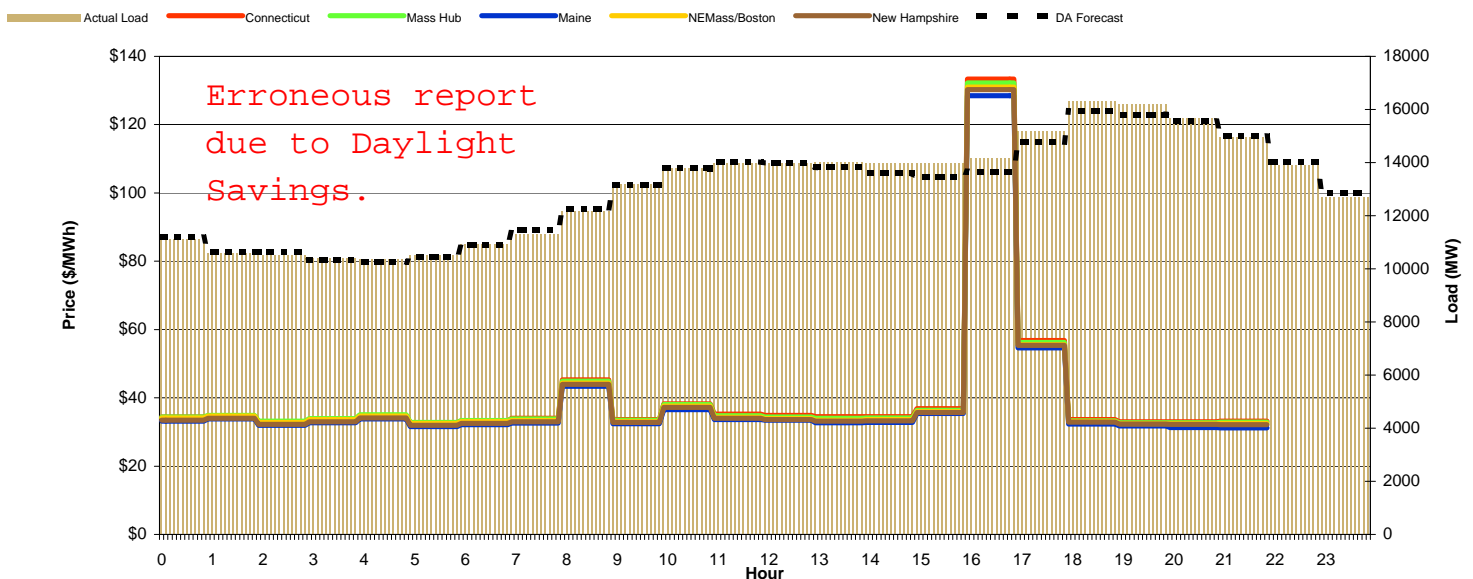




# ISO-NE Daily Report

Monday November 08, 2010

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	33.77	32.90	32.63	33.00	34.18	35.79	52.59	60.62	52.00	51.74	52.69	53.72	51.16	51.05	47.83	46.82	56.34	72.76	61.82	56.00	50.76	48.61	39.96	35.52	47.68	53.37	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	33.59	32.79	32.59	32.84	33.94	34.85	50.46	57.35	49.77	49.66	50.62	51.41	49.17	49.14	46.27	45.46	54.41	70.79	60.19	54.10	49.12	47.23	39.19	35.27	46.26	51.49		
<b>New Hampshire</b>	32.96	32.13	31.94	32.20	33.31	34.34	49.56	53.74	48.98	48.84	49.72	50.49	48.39	48.41	45.69	45.01	53.97	70.55	59.78	53.78	48.80	46.71	38.75	35.08	45.55	50.73		
<b>Maine</b>	32.57	31.72	31.51	31.77	32.91	34.03	47.64	52.17	47.14	47.00	47.84	48.41	46.74	46.82	44.43	44.17	52.71	67.80	57.00	51.62	46.91	44.88	37.70	34.61	44.17	48.96		
<b>Mass Hub</b>	33.99	33.17	32.98	33.29	34.43	35.43	51.50	59.45	50.73	50.53	51.49	52.30	49.98	49.91	47.00	46.13	55.34	71.79	61.07	54.79	49.82	47.86	39.69	35.54	47.01	52.37		
<b>Cleared Load (GW)</b>	10.1	9.9	9.8	9.8	10.0	10.9	13.0	13.8	14.5	14.5	14.8	14.6	14.2	14.1	13.9	13.9	15.2	15.6	15.6	14.9	14.2	12.9	11.9	10.6				

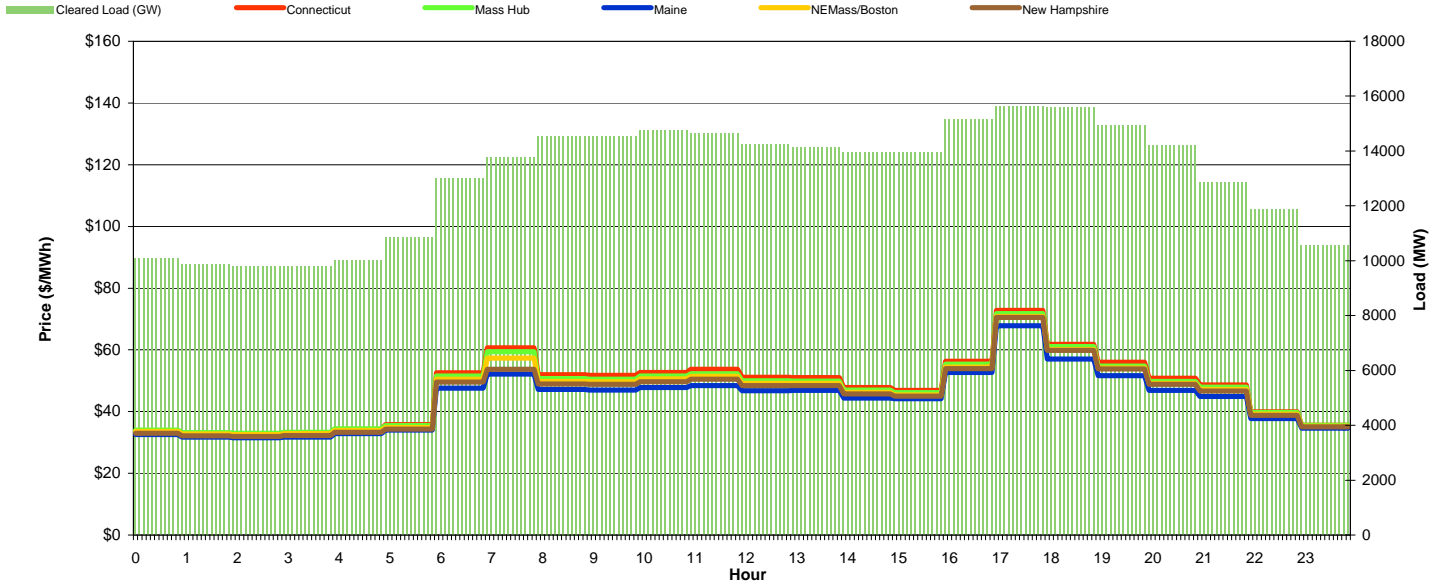

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	41.44	48.76	43.50	42.85	55.29	53.07	151.63	45.14	39.02	44.70	47.59	48.47	44.88	48.72	50.42	55.68	55.86	43.68	43.74	52.42	42.32	37.36	36.25	35.74	50.36	46.02	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	41.50	48.48	43.21	42.64	54.93	52.21	147.24	43.23	37.58	42.95	45.97	46.92	43.21	46.87	48.25	53.43	53.58	41.97	42.13	49.97	40.35	36.24	35.08	35.07	48.88	44.23		
<b>New Hampshire</b>	40.95	47.81	42.63	42.10	54.16	51.96	146.89	42.98	37.28	42.54	45.41	46.51	42.99	46.63	48.06	53.25	53.30	41.67	41.88	49.68	40.06	35.72	34.45	34.59	48.48	43.90		
<b>Maine</b>	40.48	47.17	42.12	41.63	53.08	51.48	142.73	41.70	35.98	40.72	43.27	44.33	41.05	44.43	45.90	51.27	51.04	39.79	40.34	47.56	38.40	34.05	32.71	33.53	46.87	42.03		
<b>Mass Hub</b>	41.76	48.95	43.65	43.04	55.45	52.77	149.24	44.01	38.14	43.60	46.60	47.54	43.84	47.58	49.07	54.26	54.40	42.62	42.76	50.84	41.03	36.71	35.63	35.52	49.54	44.91		
<b>DA Forecast Load (GW)</b>	11.13	10.74	10.58	10.57	11.00	12.23	14.40	15.82	16.16	16.45	16.65	16.61	16.56	16.51	16.39	16.58	17.68	18.37	18.19	17.62	16.74	15.53	13.94	12.45				
<b>Forecast Error %</b>	-1.5%	1.8%	2.3%	2.9%	2.7%	0.2%	-0.7%	-1.1%	-0.6%	-1.1%	-1.1%	-0.9%	-1.8%	-2.2%	-2.4%	-2.9%	-4.3%	-2.5%	-2.7%	-2.7%	-2.4%	-2.8%	-2.5%	-1.8%				

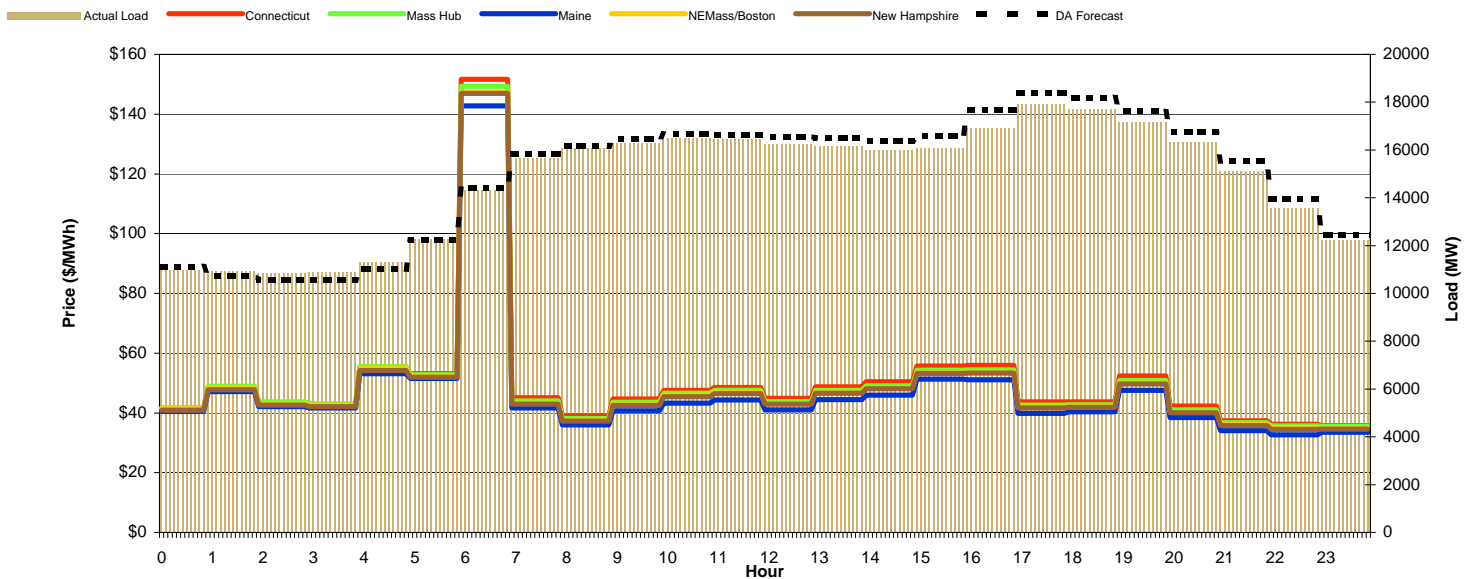






# ISO-NE Daily Report

Tuesday November 09, 2010

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	35.72	34.50	34.45	34.37	34.32	38.13	51.85	50.51	48.11	47.80	48.30	47.98	48.24	47.93	45.29	45.79	55.00	61.57	57.07	53.13	47.65	44.35	38.28	36.24	45.27	49.19	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	34.87	34.19	34.14	34.16	34.18	36.92	50.17	48.86	46.40	46.21	46.52	46.39	46.50	46.24	43.86	44.22	52.60	59.15	54.94	50.87	45.94	42.83	37.11	35.50	43.87	47.42		
<b>New Hampshire</b>	34.62	33.81	33.78	33.67	33.75	36.56	49.78	48.62	46.24	45.97	46.26	46.20	46.33	46.01	43.78	44.18	52.45	58.87	54.83	50.70	45.89	42.50	36.87	35.50	43.63	47.23		
<b>Maine</b>	34.00	33.11	33.08	32.85	33.05	35.29	47.19	46.45	43.77	43.86	44.00	44.04	44.00	43.68	41.81	42.30	49.54	55.03	52.14	47.64	43.31	40.20	35.36	34.69	41.68	44.82		
<b>Mass Hub</b>	35.48	34.68	34.63	34.62	34.58	37.65	51.05	49.45	47.03	46.79	47.10	46.94	47.03	46.86	44.39	44.79	53.51	59.88	55.61	51.69	46.57	43.47	37.55	36.03	44.47	48.04		
<b>Cleared Load (GW)</b>	10.6	10.3	10.1	10.1	10.2	10.9	13.3	14.3	14.4	14.7	14.7	14.9	14.6	14.6	14.6	14.5	15.4	16.1	15.9	15.4	14.6	13.2	12.1	10.7				

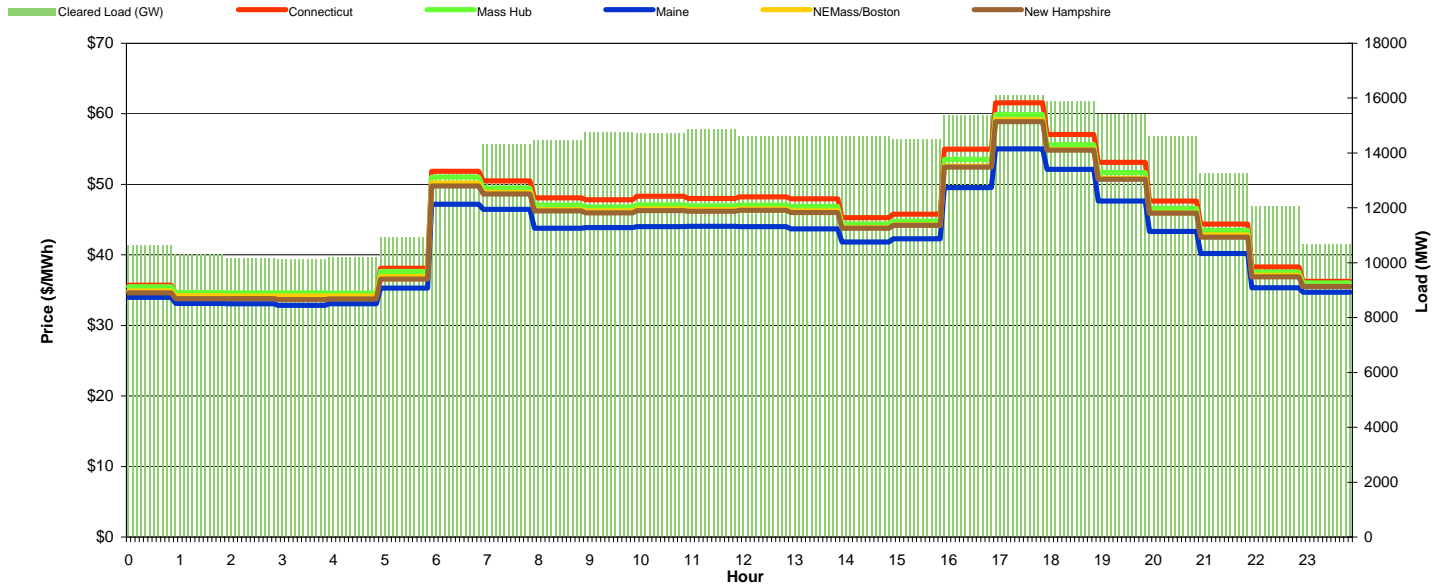

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	39.92	40.95	34.99	34.50	34.13	35.35	48.63	50.19	39.72	39.65	45.08	41.21	40.16	42.47	41.44	42.46	51.97	58.20	44.11	42.64	42.46	41.12	38.74	37.60	41.99	43.85	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	39.01	40.31	34.67	34.20	33.80	34.40	46.93	48.26	38.32	38.45	43.51	39.38	38.52	40.68	39.71	40.80	49.62	55.58	42.36	40.99	41.39	39.67	37.47	36.78	40.62	42.17		
<b>New Hampshire</b>	38.70	39.92	34.30	33.79	33.40	34.14	46.68	47.87	38.12	38.26	43.26	39.19	38.35	40.53	39.56	40.66	49.41	55.10	42.11	40.90	41.16	39.32	36.99	36.36	40.34	41.92		
<b>Maine</b>	37.62	38.95	33.66	33.13	32.82	33.39	44.89	45.38	36.42	36.84	41.34	37.20	36.50	38.45	37.65	38.88	47.18	51.54	39.95	39.21	39.55	37.46	35.17	34.92	38.67	39.92		
<b>Mass Hub</b>	39.60	40.82	35.05	34.55	34.14	34.90	47.67	49.01	38.87	39.01	44.20	40.11	39.19	41.40	40.39	41.46	50.43	56.41	42.98	41.60	41.86	40.33	38.11	37.29	41.22	42.84		
<b>DA Forecast Load (GW)</b>	11.35	10.99	10.76	10.72	11.06	12.22	14.25	15.44	15.71	15.93	15.99	15.91	15.77	15.68	15.53	15.59	16.52	17.55	17.32	16.81	16.07	14.84	13.39	12.11				
<b>Forecast Error %</b>	2.1%	1.9%	1.8%	1.9%	1.6%	0.5%	-0.9%	-1.3%	-1.2%	-2.1%	-2.0%	-1.5%	-1.1%	-0.9%	-1.0%	-1.4%	-0.7%	-0.5%	-0.8%	-1.2%	-0.6%	-0.9%	-1.6%					

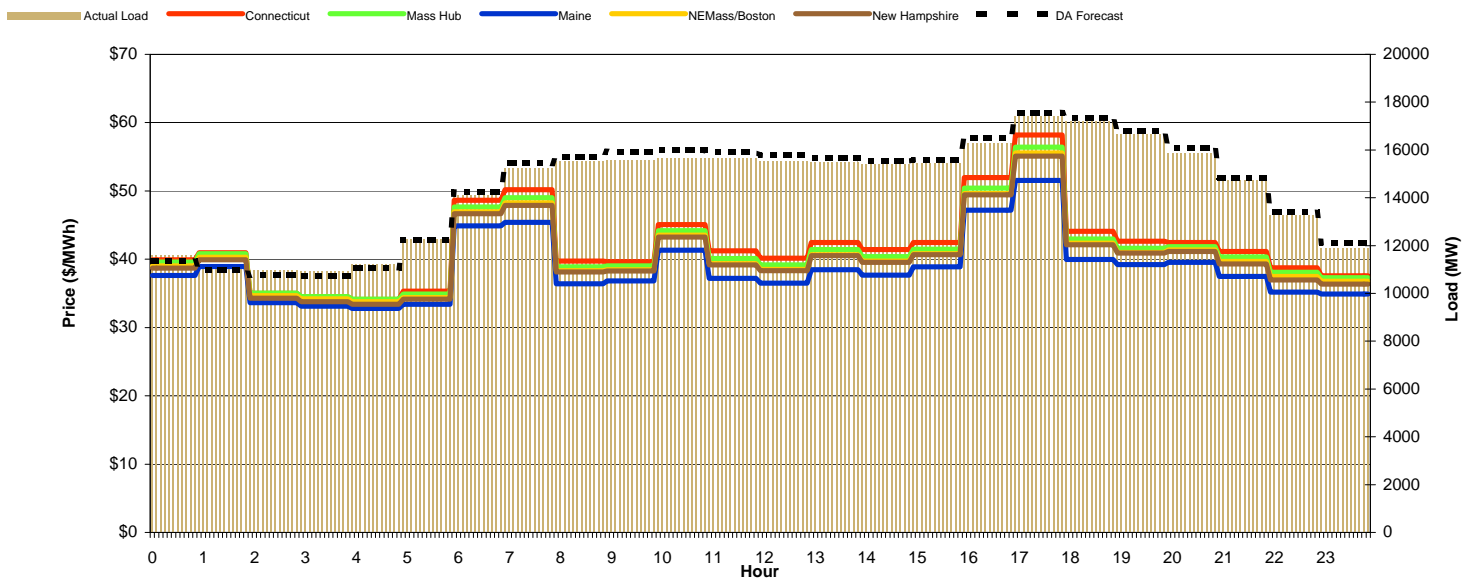




# ISO-NE Daily Report

Wednesday November 10, 2010

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	37.46	35.96	35.47	34.94	34.76	38.56	50.00	53.08	54.16	53.93	52.77	51.54	51.23	49.40	48.45	51.25	57.43	72.40	63.43	55.90	51.56	49.94	43.99	41.00	48.69	53.78	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	36.79	35.48	35.13	34.64	34.63	37.90	48.41	50.19	51.07	50.94	50.10	48.99	48.90	47.28	46.37	48.86	54.73	67.21	60.03	53.23	48.98	47.78	42.42	40.35	46.68	51.07		
<b>New Hampshire</b>	36.61	35.37	34.98	34.51	34.48	37.81	48.65	50.29	50.97	50.65	49.87	48.79	48.64	46.95	45.94	48.59	54.35	66.67	59.50	52.96	48.75	47.41	42.16	39.94	46.45	50.78		
<b>Maine</b>	35.25	34.44	34.12	33.54	33.62	36.62	46.99	48.13	48.73	48.21	47.70	46.49	46.33	44.69	43.61	46.23	51.79	62.49	55.29	50.10	46.31	45.23	41.03	38.96	44.41	48.27		
<b>Mass Hub</b>	37.33	36.02	35.63	35.11	35.00	38.45	49.55	51.57	52.40	52.21	51.31	50.15	50.00	48.30	47.37	50.01	55.92	69.82	61.24	54.31	50.11	48.83	43.11	40.77	47.69	52.29		
<b>Cleared Load (GW)</b>	9.9	9.7	9.5	9.5	9.6	10.5	13.1	14.2	14.1	14.3	14.5	14.5	14.3	14.1	13.9	13.9	15.1	15.3	15.2	15.0	14.3	13.1	11.7	10.5				

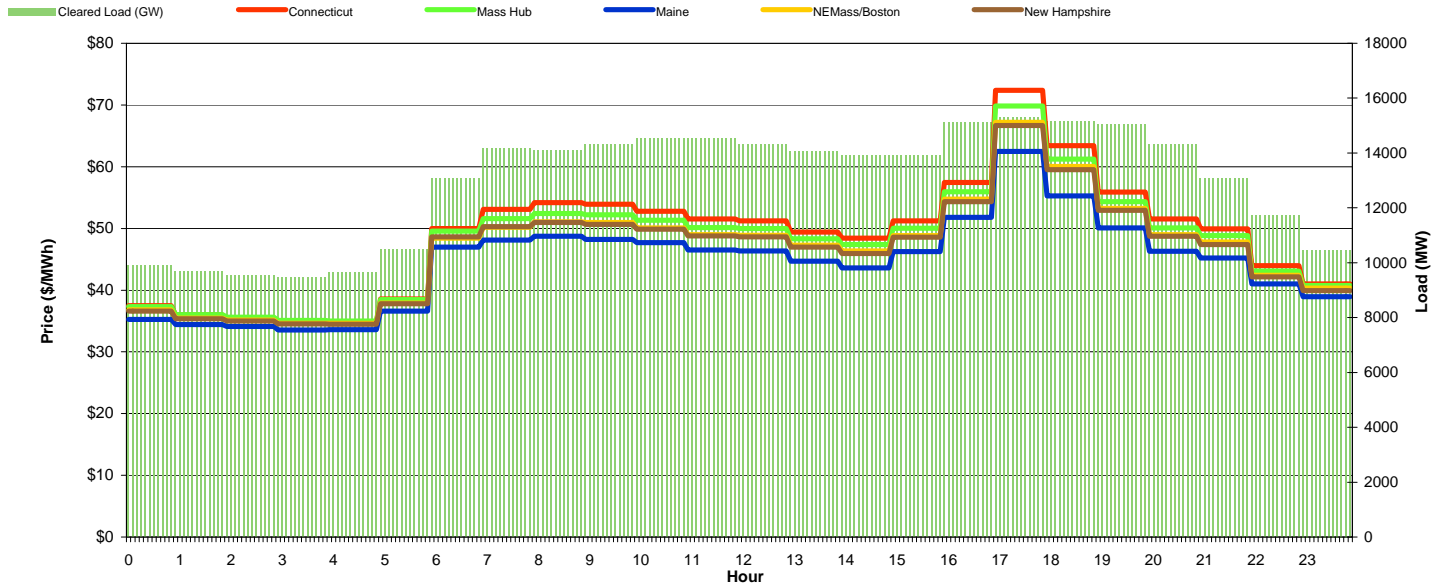

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	39.59	36.18	34.09	33.54	32.23	33.20	39.78	42.38	46.28	41.41	41.37	47.46	44.83	48.56	40.66	39.62	48.01	45.75	44.38	51.46	51.44	44.90	43.30	39.45	42.08	45.11	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	39.00	35.72	33.74	33.38	32.07	32.80	39.04	41.03	44.41	39.77	39.84	45.43	42.94	46.63	39.33	38.58	46.67	43.97	42.29	49.51	49.33	43.40	41.89	38.83	40.82	43.44		
<b>New Hampshire</b>	38.81	35.46	33.50	33.13	31.85	32.63	38.95	40.93	44.16	39.45	39.50	45.07	42.58	46.15	39.02	38.28	46.22	43.49	41.94	49.19	48.90	42.90	41.33	38.39	40.49	43.07		
<b>Maine</b>	37.74	34.24	32.48	32.21	30.99	31.49	37.78	39.61	42.42	37.74	37.72	42.86	40.38	43.57	37.14	36.71	44.23	40.83	39.55	47.06	46.61	40.94	39.42	37.31	38.79	41.05		
<b>Mass Hub</b>	39.46	36.13	34.10	33.67	32.33	33.07	39.49	41.64	45.15	40.42	40.46	46.21	43.66	47.33	39.80	39.02	47.18	44.52	42.91	50.11	50.10	44.05	42.58	39.26	41.36	44.07		
<b>DA Forecast Load (GW)</b>	11.24	10.73	10.50	10.46	10.81	11.99	14.03	15.22	15.51	15.71	15.82	15.78	15.59	15.45	15.32	15.40	16.30	17.41	17.16	16.80	16.09	14.92	13.47	12.26				
<b>Forecast Error %</b>	-1.5%	1.3%	1.7%	1.4%	0.8%	-0.7%	-1.9%	-1.6%	-0.9%	-1.5%	-1.8%	-2.0%	-1.7%	-1.0%	-0.9%	-1.7%	-2.4%	-1.5%	-0.8%	-1.8%	-1.6%	-0.7%	0.1%	-0.5%				

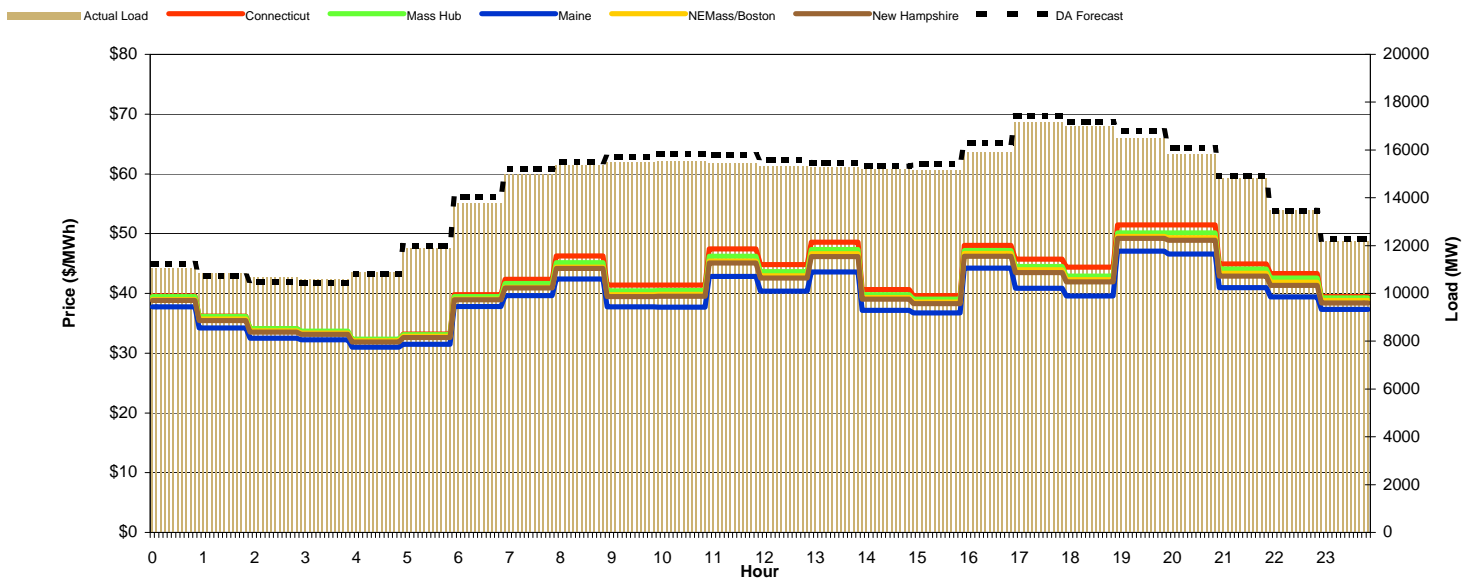




# ISO-NE Daily Report

Thursday November 11, 2010

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
	All	On Pk																										
Connecticut	35.95	35.05	34.94	34.90	34.90	36.57	47.88	49.12	50.55	48.75	50.09	48.44	46.77	46.03	44.97	46.02	53.02	69.61	59.89	53.00	48.21	46.10	42.48	43.40	46.11	50.19		
NEMass/Boston	35.65	34.83	34.79	34.70	34.75	36.33	46.72	47.57	48.90	47.14	48.32	46.73	45.20	44.62	43.71	44.77	51.27	67.11	57.82	51.16	46.70	44.84	41.71	42.77	44.92	48.60		
New Hampshire	35.62	34.97	34.88	34.70	34.91	36.51	46.81	47.77	48.89	46.96	48.09	46.63	45.08	44.47	43.51	44.55	50.82	66.36	57.19	50.82	46.30	44.32	41.42	42.32	44.75	48.32		
Maine	34.87	34.75	34.63	33.95	34.81	36.42	45.75	46.54	47.09	45.31	46.00	45.00	43.60	43.22	42.27	43.26	49.38	63.51	54.85	49.38	44.76	42.95	40.76	42.19	43.55	46.74		
Mass Hub	36.03	35.23	35.22	35.15	35.15	36.70	47.55	48.21	49.57	47.78	48.99	47.35	45.75	45.12	44.08	45.20	51.89	67.82	58.38	51.73	47.20	45.35	41.95	43.21	45.44	49.15		
Cleared Load (GW)	10.3	10.2	10.0	10.0	10.3	10.9	13.2	14.1	14.4	14.7	14.6	14.6	14.3	14.1	13.9	14.1	15.0	15.5	15.5	15.2	14.6	13.5	11.9	10.2				

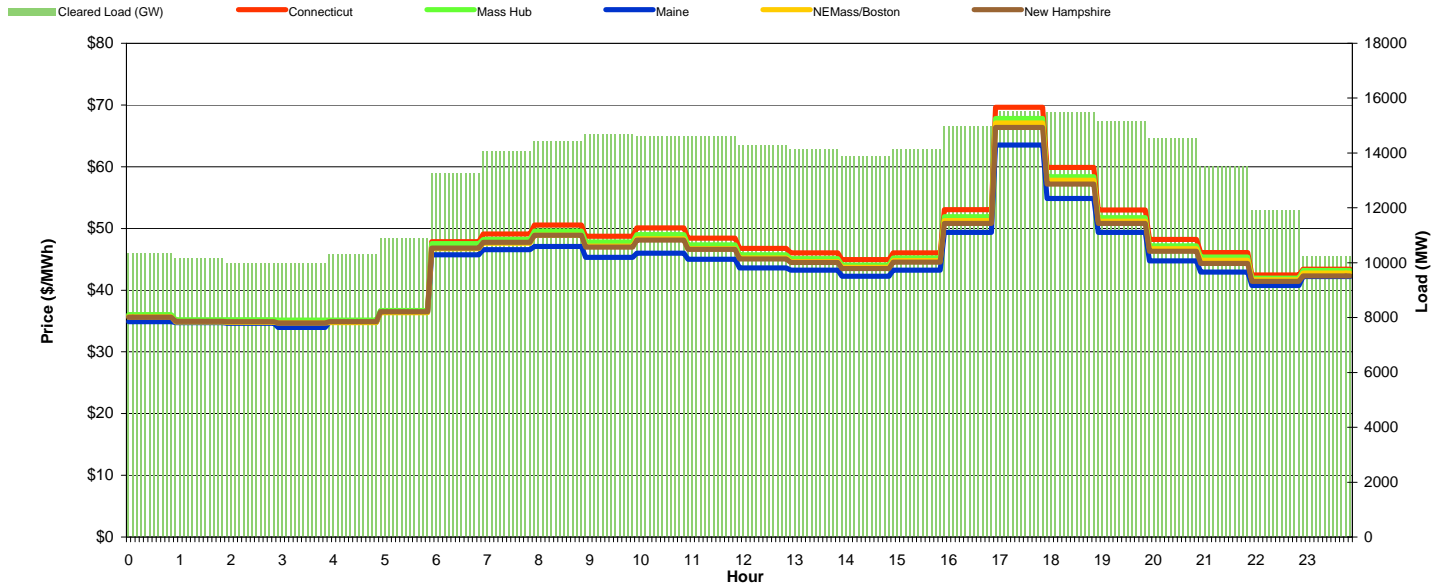

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
	All	On Pk																										
Connecticut	43.55	50.30	45.13	39.84	41.18	39.71	39.18	39.98	42.08	43.65	42.94	40.57	40.42	41.76	38.70	38.07	42.23	48.79	47.55	45.17	45.15	41.50	38.67	34.84	42.12	42.33		
NEMass/Boston	43.43	50.13	44.98	39.75	40.96	39.38	38.32	38.96	40.85	42.21	41.39	38.88	38.71	40.09	37.37	36.93	40.85	46.67	45.36	43.47	43.90	40.38	37.79	34.49	41.05	40.86		
New Hampshire	43.28	49.75	44.71	39.64	40.78	39.19	38.32	39.01	40.78	42.16	41.25	38.74	38.56	39.89	37.09	36.63	40.44	46.12	44.91	43.10	43.45	39.87	37.15	33.92	40.78	40.57		
Maine	43.02	48.27	44.06	39.47	40.16	38.52	37.39	38.01	39.66	41.06	39.93	37.28	36.88	38.02	35.37	35.14	39.10	44.00	42.93	41.56	41.96	38.52	35.77	32.62	39.53	39.07		
Mass Hub	43.75	50.58	45.40	40.10	41.33	39.70	38.77	39.44	41.39	42.82	41.96	39.47	39.33	40.75	37.88	37.35	41.29	47.24	45.94	44.02	44.37	40.83	38.20	34.74	41.53	41.39		
DA Forecast Load (GW)	11.38	10.92	10.71	10.68	11.03	11.98	13.63	14.68	15.16	15.47	15.45	15.40	15.27	15.15	14.97	15.09	16.25	17.38	17.13	16.77	16.04	14.93	13.50	12.19				
Forecast Error %	-0.5%	2.0%	2.3%	2.4%	1.9%	-0.9%	-2.5%	-2.2%	-0.8%	-1.1%	-0.4%	-0.6%	-0.9%	-0.9%	-0.8%	-1.7%	-3.7%	-1.9%	-1.2%	-1.8%	-1.5%	-1.0%	-0.5%	-0.1%				

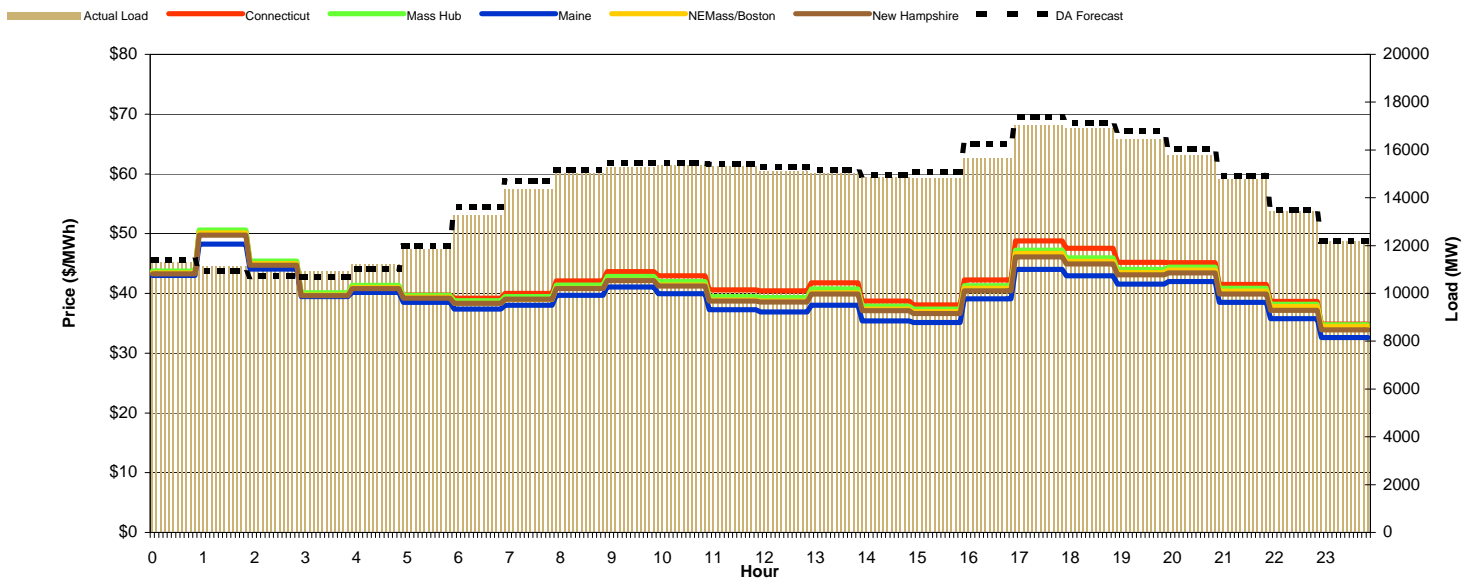




# ISO-NE Daily Report

Friday November 12, 2010

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$				
<b>Connecticut</b>	37.50	36.41	35.63	35.56	33.80	36.25	52.35	49.92	41.63	51.14	55.28	54.40	50.90	48.60	44.20	46.66	50.35	64.34	52.84	50.55	48.00	42.35	40.90	38.75	38.75	45.76	49.50	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	37.00	35.86	35.24	35.23	35.98	37.57	54.51	49.18	49.45	52.49	52.04	49.17	49.10	46.89	42.69	45.13	49.11	62.00	51.19	49.09	46.35	41.15	40.01	38.32	45.20	48.44			
<b>New Hampshire</b>	36.65	35.62	35.06	35.04	35.33	36.95	53.69	48.72	47.98	51.88	52.08	49.56	48.63	46.53	42.33	44.84	48.74	61.63	50.90	48.69	46.04	41.01	39.69	37.87	44.81	48.08			
<b>Maine</b>	36.31	35.64	35.32	35.34	35.11	36.84	53.73	48.58	48.20	51.50	51.34	48.83	48.07	46.00	42.00	44.65	48.90	59.87	51.35	48.57	45.71	40.51	39.24	37.74	44.56	47.71			
<b>Mass Hub</b>	37.42	36.30	35.63	35.60	36.21	38.04	54.87	49.44	49.84	52.85	52.42	49.51	49.49	47.28	43.06	45.57	49.57	62.58	51.61	49.58	46.90	41.70	40.43	38.77	45.61	48.86			
<b>Cleared Load (GW)</b>	10.4	10.1	9.8	9.9	10.0	10.9	12.4	13.7	14.1	13.9	13.9	13.7	13.2	13.2	13.2	13.3	14.5	14.9	15.1	14.5	13.6	13.4	12.0	10.9					

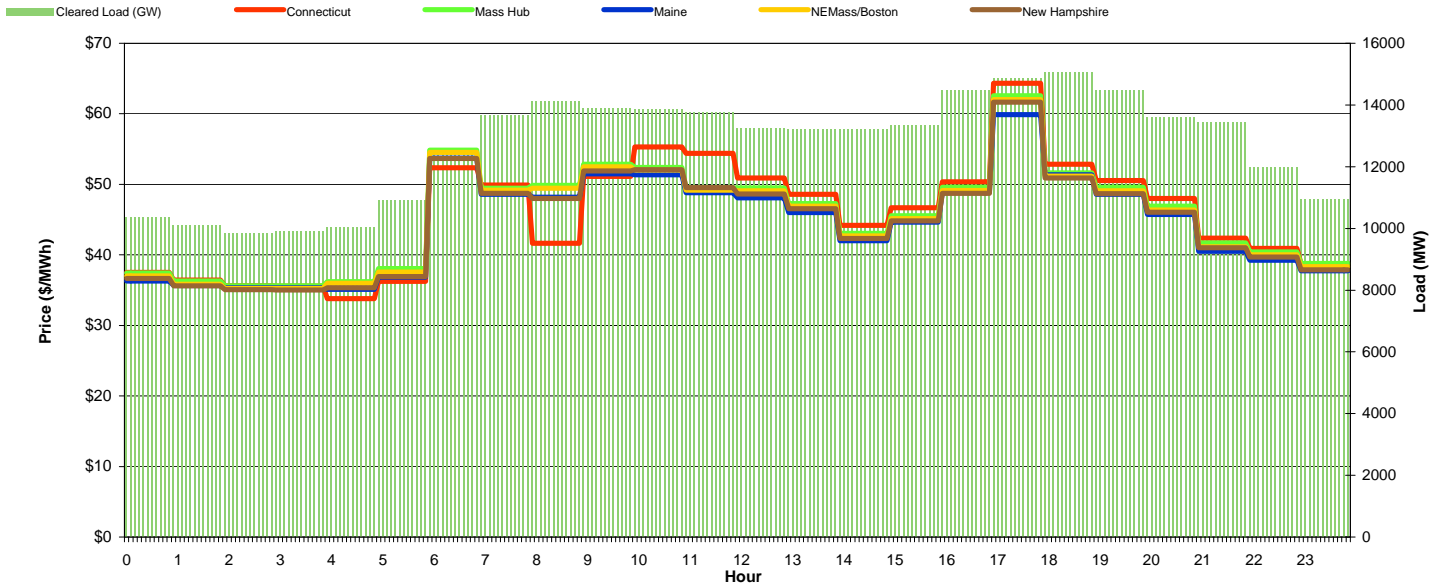

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	35.97	36.34	35.06	34.33	34.19	51.20	62.23	64.10	36.73	36.54	36.11	36.31	41.59	36.72	36.45	36.59	46.69	47.54	38.12	42.83	37.23	35.33	35.51	34.55	40.34	40.27	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	35.76	36.08	34.77	34.02	33.92	50.12	60.90	62.43	35.82	35.57	34.88	35.00	40.16	35.49	35.38	35.58	45.15	45.71	36.81	41.64	35.93	34.28	34.66	34.14	39.34	39.03		
<b>New Hampshire</b>	35.34	35.73	34.45	33.67	33.55	49.97	60.72	62.13	35.54	35.44	34.83	34.83	39.96	35.25	35.10	35.28	44.80	45.50	36.59	41.45	35.76	34.14	34.38	33.80	39.09	38.81		
<b>Maine</b>	34.61	35.37	33.99	33.20	33.17	49.86	60.65	61.84	35.47	35.46	34.91	34.76	39.94	35.22	35.11	35.30	45.03	45.63	36.21	41.23	35.50	33.89	34.13	33.49	38.92	38.73		
<b>Mass Hub</b>	36.00	36.31	35.03	34.29	34.17	50.75	61.64	63.08	36.11	35.83	35.17	35.36	40.57	35.83	35.68	35.87	45.55	46.14	37.12	42.00	36.35	34.63	35.00	34.39	39.70	39.39		
<b>DA Forecast Load (GW)</b>	11.26	10.84	10.65	10.61	10.95	12.07	14.02	15.07	15.41	15.38	15.33	15.29	15.14	15.03	14.79	14.82	15.69	16.71	16.33	15.84	15.20	14.29	13.14	11.97				
<b>Forecast Error %</b>	0.3%	0.5%	0.4%	0.6%	0.4%	-0.4%	-0.9%	-0.5%	-0.8%	-0.4%	0.0%	-0.6%	-1.0%	-0.9%	-0.5%	-1.2%	-2.2%	-1.3%	-0.4%	-1.0%	-0.8%	-0.1%	0.1%	0.4%				

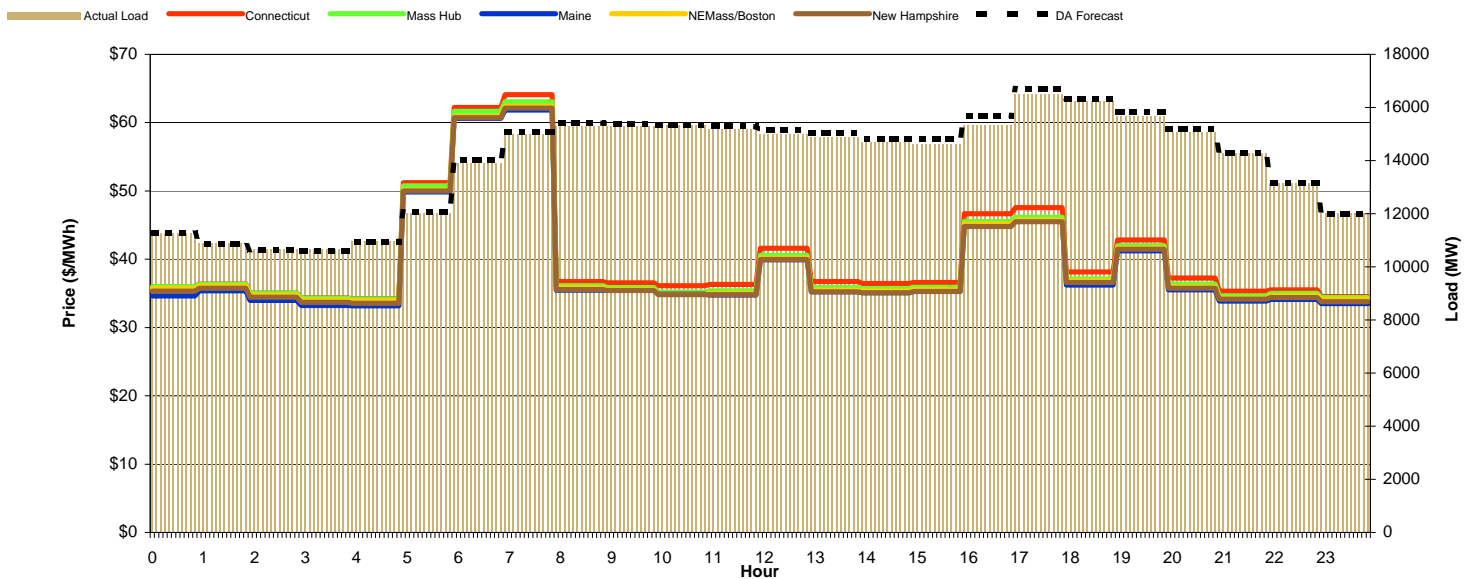




# ISO-NE Daily Report

Saturday November 13, 2010

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
	All	On Pk																										
Connecticut	37.66	35.02	33.57	33.27	34.65	35.70	36.04	35.28	36.67	40.73	43.66	42.15	41.17	36.50	34.28	34.50	42.53	52.99	50.53	46.26	45.37	38.38	35.59	38.32	39.20	41.04		
NEMass/Boston	36.99	34.64	33.25	33.09	34.32	35.20	35.55	34.20	35.74	39.77	42.58	41.10	39.77	35.60	33.31	33.73	41.61	51.55	49.14	45.09	43.83	37.06	34.55	37.68	38.31	39.91		
New Hampshire	36.55	34.38	32.92	32.76	34.01	34.81	35.28	34.03	35.73	39.69	42.41	40.94	39.60	35.39	33.08	33.52	41.52	51.45	48.98	44.81	43.64	36.95	34.34	37.31	38.09	39.76		
Maine	36.01	34.41	32.94	32.80	34.01	34.31	35.08	33.92	35.90	40.06	42.67	41.24	39.66	35.64	33.31	33.80	41.90	51.69	49.57	44.97	43.62	36.98	34.62	37.12	38.18	39.97		
Mass Hub	37.49	35.11	33.67	33.50	34.76	35.74	35.97	34.54	36.10	40.11	42.86	41.40	40.11	35.81	33.54	33.92	41.79	51.74	49.25	45.26	44.08	37.33	34.80	38.11	38.62	40.17		
Cleared Load (GW)	10.4	10.4	9.7	9.8	9.7	9.9	10.5	11.4	12.6	13.0	13.1	13.0	12.5	12.5	12.2	12.3	13.4	14.0	13.4	13.1	12.6	12.4	11.4	10.2				

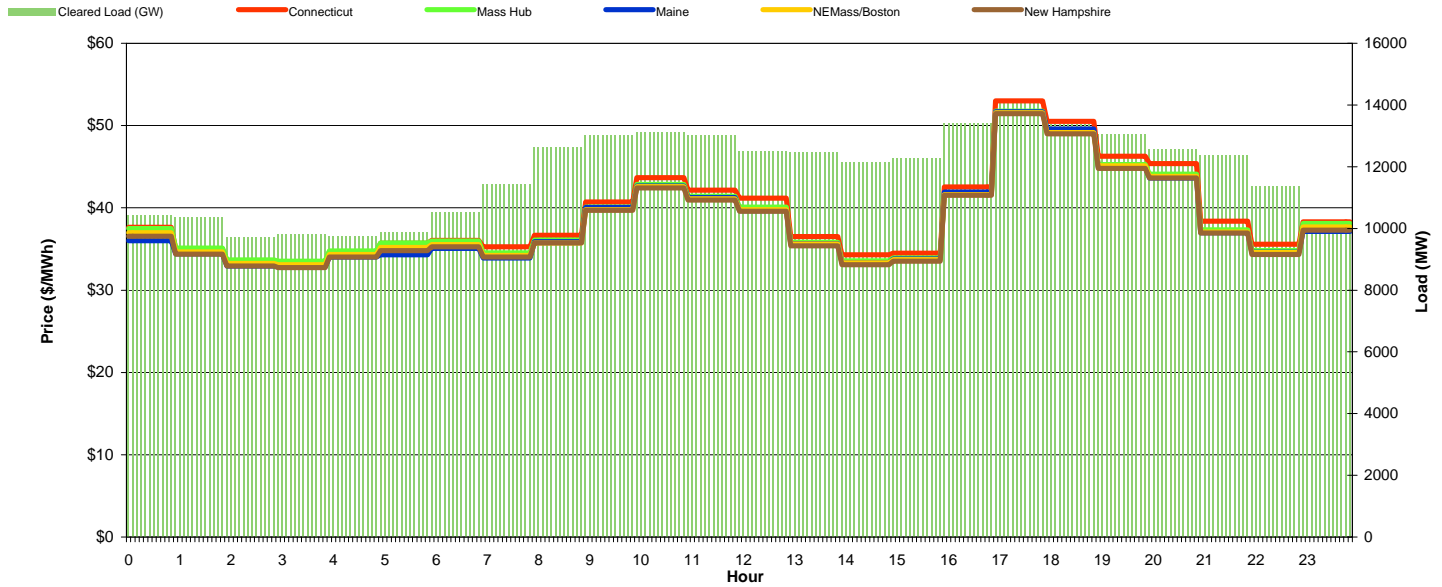

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
	All	On Pk																										
Connecticut	51.74	45.96	53.23	35.68	34.21	39.55	35.92	38.04	36.79	35.07	35.72	38.29	39.20	40.64	35.16	32.70	46.42	49.70	36.13	35.07	41.22	36.80	35.33	36.72	39.39	38.27		
NEMass/Boston	51.47	45.70	52.74	35.33	33.81	38.97	35.43	37.09	35.86	34.19	34.78	37.29	37.71	39.40	34.21	31.81	45.46	47.89	35.06	34.33	39.89	35.61	34.30	36.17	38.52	37.18		
New Hampshire	50.87	45.11	52.21	34.98	33.48	38.92	35.30	36.88	35.68	33.98	34.55	37.07	37.53	39.18	33.98	31.59	45.05	47.47	34.84	34.16	39.72	35.35	33.99	35.70	38.23	36.94		
Maine	50.35	44.60	51.73	34.61	33.16	38.96	35.08	36.67	35.58	33.87	34.24	36.72	37.20	38.77	33.60	31.21	44.52	46.65	34.50	33.88	39.33	34.90	33.34	35.06	37.86	36.56		
Mass Hub	51.79	46.02	53.21	35.64	34.12	39.36	35.71	37.51	36.31	34.59	35.18	37.71	38.23	39.86	34.47	32.06	45.70	48.29	35.31	34.51	40.23	35.98	34.66	36.44	38.87	37.54		
DA Forecast Load (GW)	11.10	10.61	10.35	10.28	10.42	10.91	11.63	12.41	13.35	13.87	14.02	13.86	13.62	13.40	13.22	13.28	14.47	15.66	15.41	14.79	14.21	13.52	12.57	11.58				
Forecast Error %	2.7%	3.6%	4.0%	3.9%	3.7%	3.3%	0.8%	1.2%	0.6%	-0.1%	-0.7%	-0.7%	-0.7%	-1.3%	-1.4%	-1.5%	-3.1%	-2.1%	-2.1%	-1.4%	-0.8%	-0.8%	-0.4%	-0.1%				

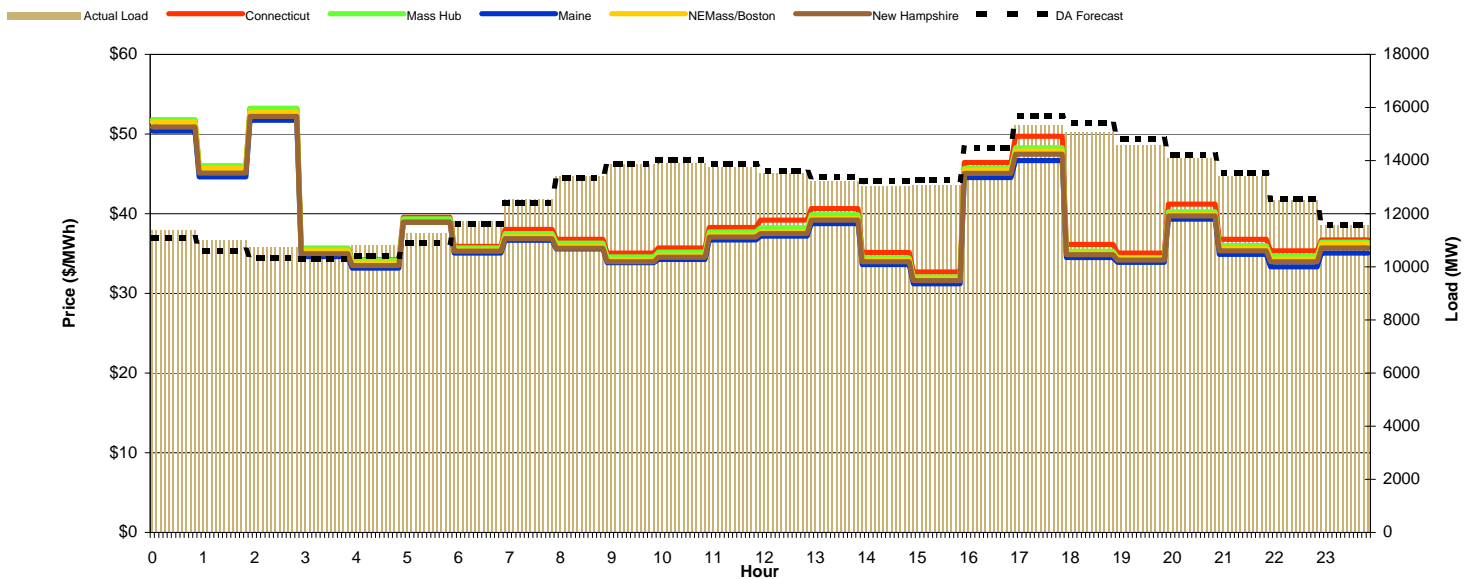




# ISO-NE Daily Report

Sunday November 14, 2010

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	39.63	35.88	34.73	34.58	34.43	34.29	34.53	33.27	36.19	37.21	38.75	39.22	42.81	38.91	39.42	41.80	50.44	63.81	63.37	50.50	48.80	39.05	35.57	36.39	40.98	43.70	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	39.09	35.75	34.73	34.61	34.48	34.33	34.45	32.64	35.49	36.41	37.85	38.44	41.65	38.05	38.49	40.63	49.23	62.51	62.24	49.47	47.91	37.95	34.88	36.00	40.30	42.74		
<b>New Hampshire</b>	38.70	35.40	34.36	34.22	34.07	33.97	33.91	32.25	35.17	36.26	37.69	38.21	41.40	37.78	38.23	40.39	49.19	62.22	61.95	49.10	47.44	37.54	34.66	35.62	39.99	42.47		
<b>Maine</b>	37.97	35.26	34.39	34.07	34.01	34.03	33.43	31.86	35.07	36.61	37.79	38.52	41.40	38.05	38.41	40.48	49.59	60.75	62.48	49.36	47.34	37.32	34.96	35.53	39.95	42.50		
<b>Mass Hub</b>	39.50	36.04	34.98	34.89	34.72	34.54	34.71	32.88	35.66	36.55	38.02	38.56	41.81	38.14	38.59	40.78	49.31	62.77	62.31	49.52	48.00	38.09	34.93	36.20	40.48	42.87		
<b>Cleared Load (GW)</b>	9.9	9.9	9.7	9.6	9.4	9.5	9.8	10.6	11.2	12.0	12.2	12.4	12.0	12.1	11.9	11.8	13.0	13.8	13.6	13.2	12.7	12.0	11.0	10.0				

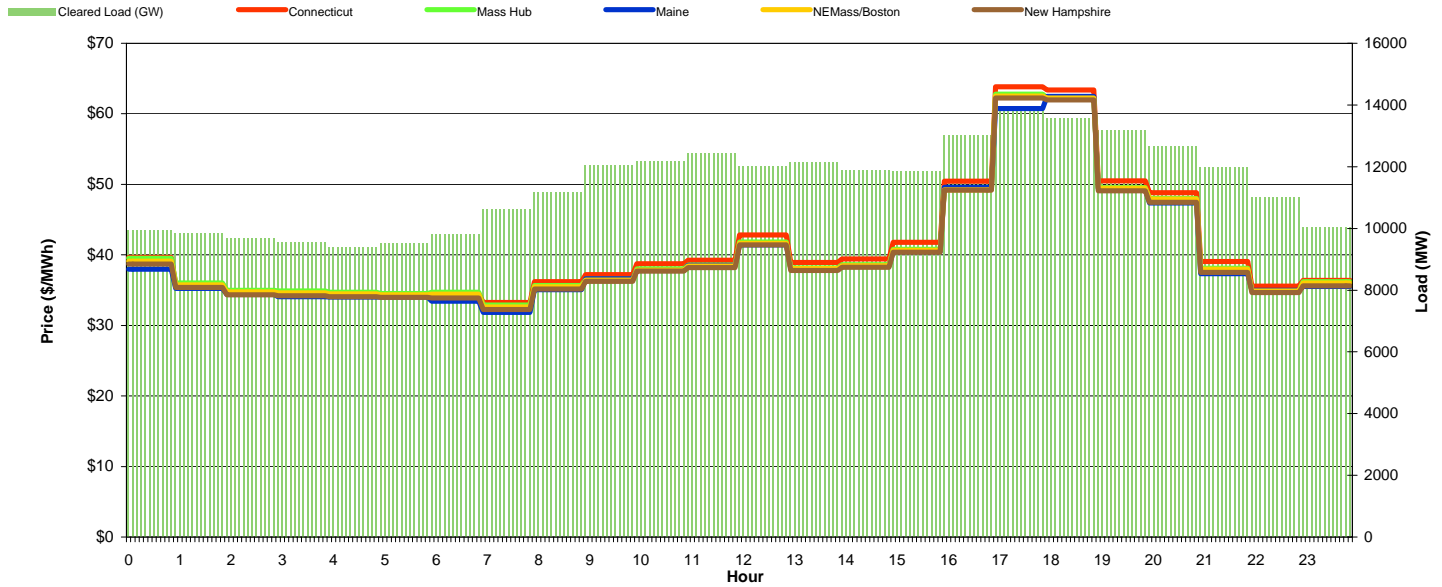

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	36.42	33.43	34.13	36.13	50.24	34.98	40.19	39.46	35.61	36.05	33.81	35.44	39.12	34.86	33.79	31.48	41.50	38.67	42.44	46.27	43.81	40.71	45.54	34.96	38.29	38.66	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	35.93	33.26	34.15	36.15	50.37	34.99	40.26	38.91	34.92	35.21	33.09	34.94	38.29	34.28	33.25	30.97	40.67	37.62	41.26	44.99	42.81	39.66	44.58	34.65	37.72	37.84		
<b>New Hampshire</b>	35.48	32.82	33.64	35.63	49.79	34.44	39.65	38.44	34.67	34.87	32.78	34.53	37.81	33.76	32.73	30.52	40.14	37.04	40.84	44.52	42.29	39.14	44.05	34.14	37.24	37.38		
<b>Maine</b>	34.74	32.18	32.98	34.94	49.62	33.94	39.09	38.13	34.53	34.76	32.56	34.03	37.19	33.17	31.96	29.75	39.39	35.80	39.98	43.76	41.39	38.21	42.95	33.36	36.60	36.72		
<b>Mass Hub</b>	36.18	33.44	34.28	36.29	50.52	35.12	40.36	39.14	35.11	35.43	33.27	35.05	38.48	34.40	33.36	31.05	40.78	37.77	41.39	45.18	42.92	39.85	44.79	34.77	37.87	38.00		
<b>DA Forecast Load (GW)</b>	10.90	10.42	10.17	10.06	10.15	10.48	11.01	11.71	12.62	13.27	13.57	13.69	13.70	13.46	13.38	13.54	14.68	16.30	16.15	15.49	14.76	13.70	12.50	11.40				
<b>Forecast Error %</b>	-0.7%	2.6%	2.6%	2.8%	2.5%	2.2%	1.8%	1.4%	-0.9%	-1.4%	-1.9%	-2.3%	-2.4%	-1.5%	-1.5%	-0.8%	-0.4%	-2.0%	-2.2%	-1.2%	-0.6%	-0.3%	0.0%	0.3%				

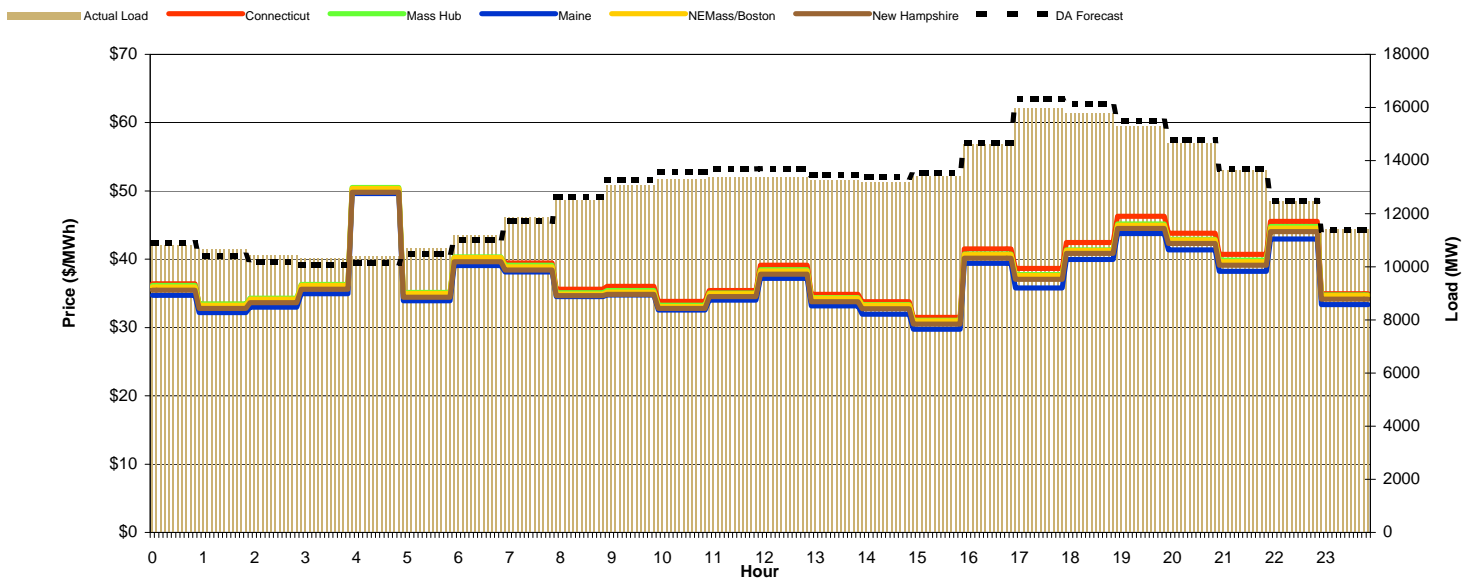




# ISO-NE Daily Report

Monday November 15, 2010

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	35.47	34.41	33.67	31.49	31.55	38.13	61.45	44.74	45.29	45.36	46.18	45.57	45.20	45.26	44.95	44.32	60.66	71.43	63.00	56.98	50.37	40.83	34.28	36.16	45.28	49.03	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	35.65	34.63	34.07	31.99	32.15	38.74	62.33	49.69	49.98	50.20	51.24	50.22	49.92	49.95	49.98	49.34	59.31	70.14	61.81	55.62	49.27	40.00	33.70	36.02	46.91	51.27		
<b>New Hampshire</b>	35.35	34.39	33.78	31.77	31.96	38.48	61.84	48.92	49.05	49.25	50.28	49.25	48.90	48.91	48.88	48.26	59.24	69.91	61.59	55.42	48.99	39.77	33.23	35.52	46.37	50.62		
<b>Maine</b>	35.30	34.77	34.10	34.10	34.10	38.50	60.28	47.74	47.87	48.37	49.17	48.06	47.57	47.54	47.54	47.05	57.40	67.56	59.79	53.60	47.28	38.78	32.34	34.87	45.57	49.23		
<b>Mass Hub</b>	35.89	34.90	34.29	32.14	32.26	38.90	62.37	47.42	47.67	47.85	48.78	47.97	47.62	47.63	47.42	46.87	59.32	70.00	61.74	55.59	49.30	40.10	33.80	36.29	46.09	49.94		
<b>Cleared Load (GW)</b>	10.3	10.2	9.9	9.6	9.9	10.6	12.1	13.6	14.1	14.3	14.5	14.5	14.3	14.0	13.8	13.8	14.8	14.9	15.0	14.6	14.0	13.3	12.0	10.7				

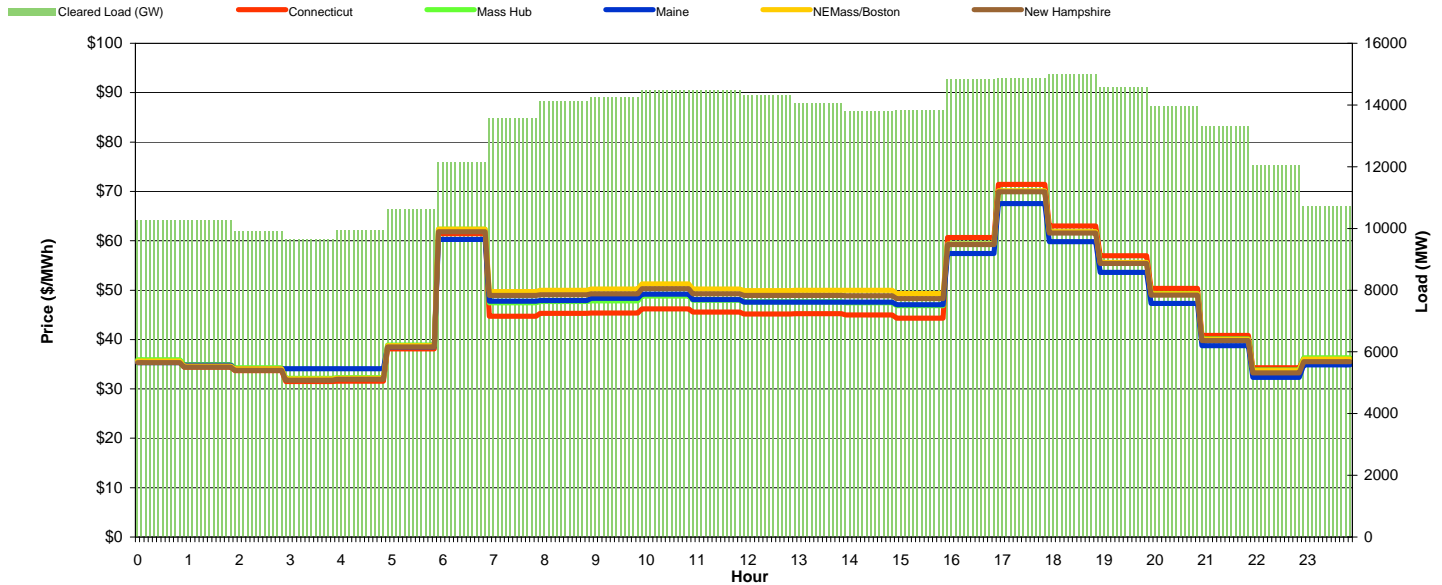

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	34.83	33.39	31.38	31.61	31.49	38.87	62.30	71.94	49.15	41.45	48.83	38.42	39.27	44.84	38.23	42.16	73.65	87.57	54.93	55.40	46.37	36.02	34.37	34.05	45.86	50.16	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	34.80	33.50	31.74	32.06	32.03	39.25	63.10	71.96	50.04	43.24	50.26	37.58	38.65	43.96	37.39	41.59	71.95	85.18	53.49	54.29	45.47	35.30	34.01	34.03	45.62	49.65		
<b>New Hampshire</b>	34.34	33.15	31.45	31.81	31.78	38.91	62.47	71.39	49.77	43.05	50.03	37.41	38.44	43.69	37.21	41.40	71.50	84.49	52.98	53.83	45.07	34.90	33.47	33.47	45.25	49.29		
<b>Maine</b>	33.60	32.65	31.34	31.81	31.68	38.23	61.24	69.74	48.78	42.08	48.82	36.33	37.01	42.02	35.65	39.87	68.12	79.55	50.00	51.11	43.06	33.23	31.89	32.23	43.75	47.33		
<b>Mass Hub</b>	34.96	33.65	31.81	32.11	32.05	39.29	62.91	71.90	49.96	43.04	50.03	37.70	38.73	44.11	37.58	41.69	72.11	85.44	53.71	54.54	45.66	35.55	34.21	34.19	45.71	49.75		
<b>DA Forecast Load (GW)</b>	10.63	10.25	10.07	10.13	10.54	11.69	13.79	15.12	15.52	15.73	15.88	15.82	15.78	15.74	15.65	15.70	16.70	17.80	17.41	16.78	15.93	14.71	13.22	11.86				
<b>Forecast Error %</b>	2.5%	1.9%	1.6%	0.9%	0.2%	-2.3%	-3.0%	-3.2%	-3.0%	-2.8%	-2.6%	-2.2%	-2.3%	-2.1%	-2.6%	-2.2%	-2.2%	-2.7%	-1.7%	-1.3%	-1.0%	-0.6%	-0.6%	0.4%				

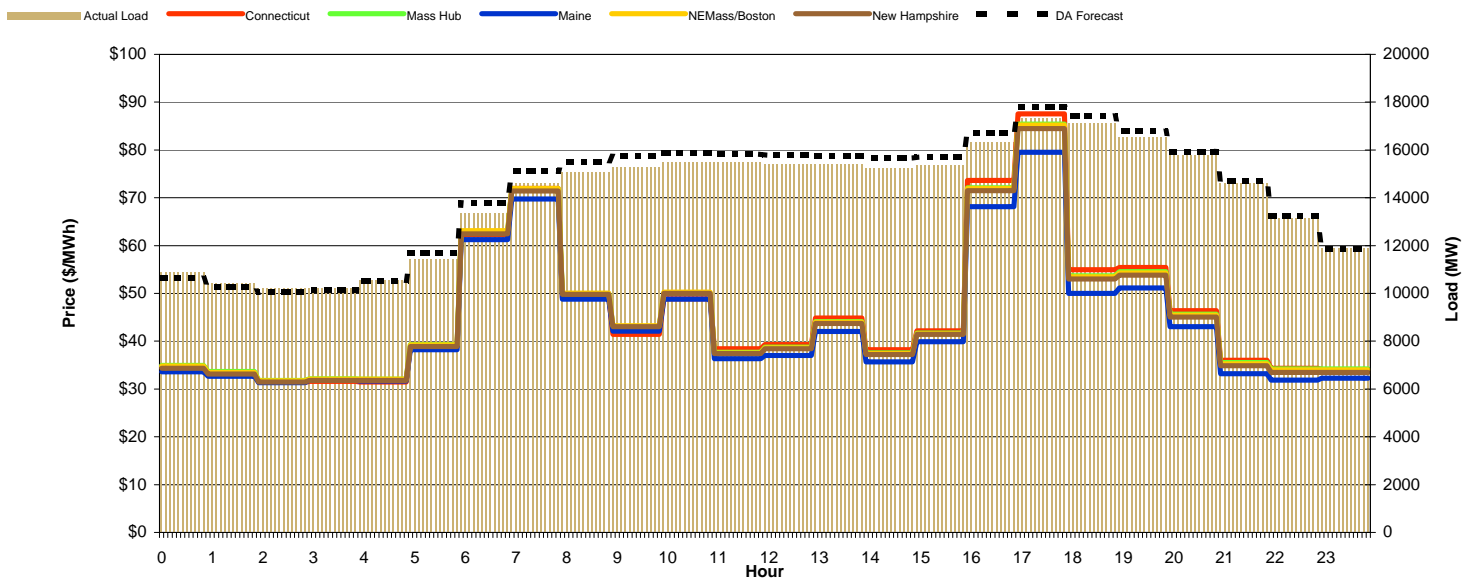




# ISO-NE Daily Report

Tuesday November 16, 2010

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$				
<b>Connecticut</b>	34.56	33.69	31.60	31.41	33.54	35.26	57.55	51.83	52.28	52.96	51.40	51.06	49.74	49.35	49.39	50.55	63.33	73.76	62.48	57.71	52.68	45.68	40.81	38.62	38.62	47.97	53.44	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	34.77	34.14	32.03	31.90	34.05	35.72	67.44	54.13	52.54	52.31	50.59	52.14	50.35	49.65	49.45	52.62	66.11	72.50	61.19	56.35	51.65	44.84	40.14	38.17	48.53	53.54			
<b>New Hampshire</b>	34.70	34.03	31.95	31.76	33.96	35.75	66.72	54.12	52.61	52.49	50.58	51.85	50.15	49.47	49.26	52.25	65.58	72.29	60.51	55.71	51.20	44.38	39.74	37.72	48.28	53.26			
<b>Maine</b>	33.98	33.19	31.19	30.97	33.23	35.40	65.10	52.43	48.00	48.26	47.81	48.74	46.86	46.17	45.77	47.94	53.59	69.80	58.39	53.70	49.44	43.06	39.05	36.94	45.79	49.94			
<b>Mass Hub</b>	35.09	34.40	32.28	32.09	34.28	35.90	63.61	53.09	52.42	52.47	50.79	51.36	49.89	49.29	49.15	51.64	64.75	72.69	61.40	56.64	51.99	45.24	40.46	38.59	48.31	53.33			
<b>Cleared Load (GW)</b>	10.6	10.2	10.0	9.9	10.0	11.1	12.9	14.1	14.2	14.2	14.2	13.9	14.0	13.9	13.7	13.7	15.0	15.0	15.2	14.5	14.0	12.7	11.5	10.3					

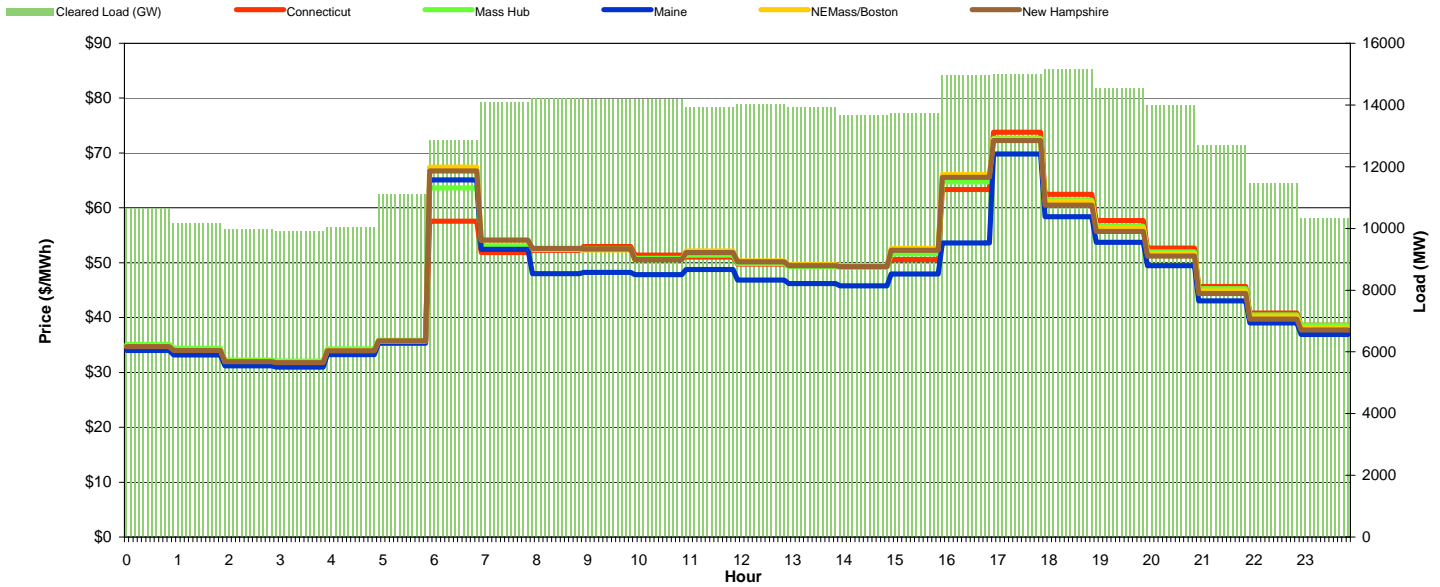

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	32.44	30.86	30.87	31.12	30.79	32.45	57.08	40.03	41.36	40.53	39.89	41.81	49.40	48.33	47.62	38.35	50.84	70.17	55.40	48.08	42.56	44.40	38.62	34.12	42.38	46.09	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	32.60	31.19	31.16	31.41	31.09	32.55	71.96	40.03	40.88	40.02	39.27	41.17	48.50	47.27	46.55	37.63	49.70	67.96	54.19	46.92	41.33	43.51	37.95	33.90	42.45	45.18		
<b>New Hampshire</b>	32.38	30.97	30.99	31.27	30.95	32.52	72.02	40.14	40.88	39.93	39.13	40.97	48.30	47.04	46.36	37.52	49.36	66.97	53.44	46.35	40.77	42.79	37.32	33.24	42.15	44.83		
<b>Maine</b>	31.67	30.33	30.36	30.65	30.44	31.76	70.05	39.46	40.51	39.28	38.06	39.69	45.73	44.82	44.06	36.64	47.10	63.19	51.10	44.61	39.30	40.92	35.81	31.85	40.72	43.14		
<b>Mass Hub</b>	32.79	31.32	31.31	31.59	31.23	32.74	69.35	40.13	41.06	40.17	39.46	41.37	48.78	47.56	46.79	37.74	49.84	68.15	54.41	47.12	41.55	43.82	38.27	34.12	42.53	45.39		
<b>DA Forecast Load (GW)</b>	11.02	10.55	10.33	10.29	10.65	11.79	13.91	15.15	15.50	15.60	15.69	15.61	15.52	15.47	15.39	15.63	16.66	17.90	17.15	16.55	15.77	14.61	13.20	11.88				
<b>Forecast Error %</b>	1.3%	1.3%	1.2%	1.3%	0.5%	-0.2%	-1.5%	-2.7%	-3.0%	-3.0%	-3.4%	-2.2%	-2.1%	-1.9%	-2.0%	-2.9%	-2.6%	-3.9%	-1.0%	-0.4%	-0.5%	0.6%	1.1%	-0.5%				

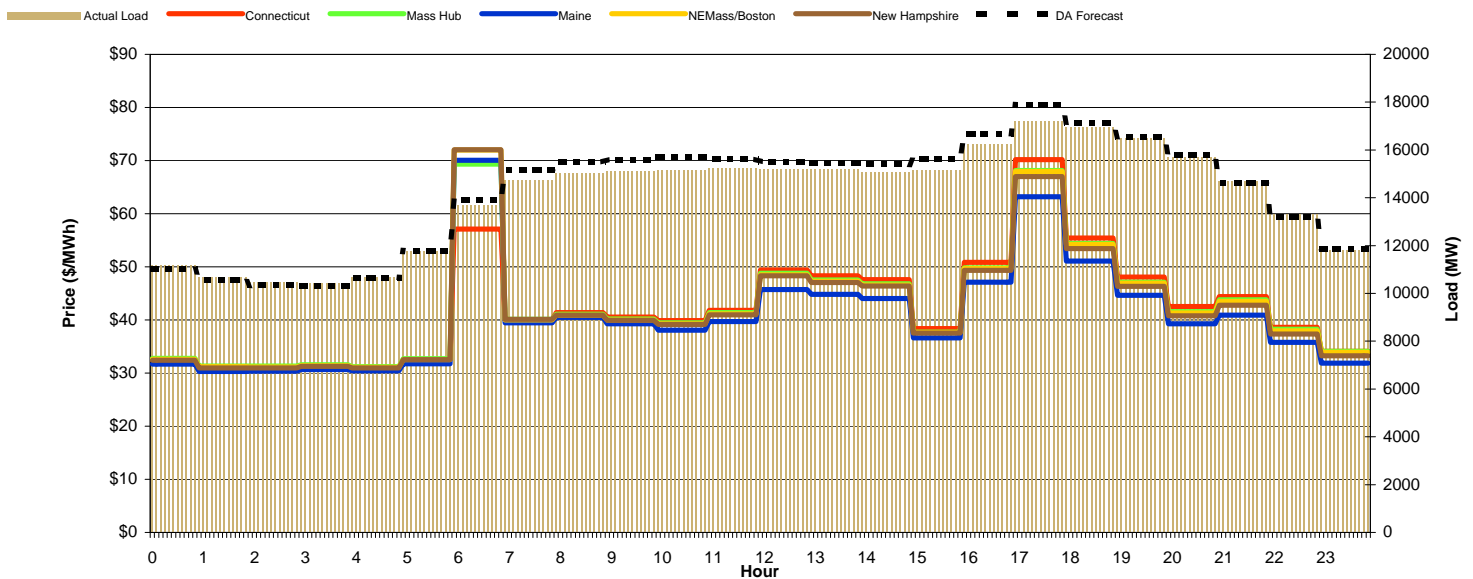






# ISO-NE Daily Report

Wednesday November 17, 2010

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	36.10	33.69	33.20	32.99	33.63	36.55	50.13	49.40	49.85	49.70	49.81	50.03	49.65	49.00	46.57	47.76	59.11	72.27	59.75	53.98	49.91	38.45	37.01	36.60	46.05	50.77	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	36.10	34.22	33.76	33.59	34.22	36.95	50.39	49.21	49.38	49.32	49.38	49.40	49.31	48.66	46.23	47.48	58.45	71.73	58.73	53.27	49.33	38.23	36.91	36.64	45.87	50.31		
<b>New Hampshire</b>	35.73	33.90	33.42	33.28	33.94	36.70	50.13	49.08	49.20	49.01	49.14	49.17	48.98	48.32	45.95	47.24	58.21	71.56	58.40	52.96	49.13	38.11	36.76	36.45	45.62	50.08		
<b>Maine</b>	34.73	33.38	32.83	32.66	33.35	35.62	48.51	47.27	47.53	47.50	47.66	47.67	47.36	46.72	44.55	45.81	55.93	68.92	55.96	51.21	47.35	37.02	35.64	35.43	44.19	48.38		
<b>Mass Hub</b>	36.46	34.45	33.98	33.77	34.43	37.24	50.71	49.19	49.21	49.02	49.09	49.19	48.89	48.29	46.00	47.15	58.38	71.53	58.48	53.33	49.35	38.30	36.88	36.83	45.84	50.14		
<b>Cleared Load (GW)</b>	10.0	9.8	9.6	9.5	9.8	10.5	13.2	13.7	14.1	14.1	14.2	14.2	13.9	13.8	13.7	13.8	15.2	15.7	15.3	14.7	14.1	13.1	11.7	10.5				

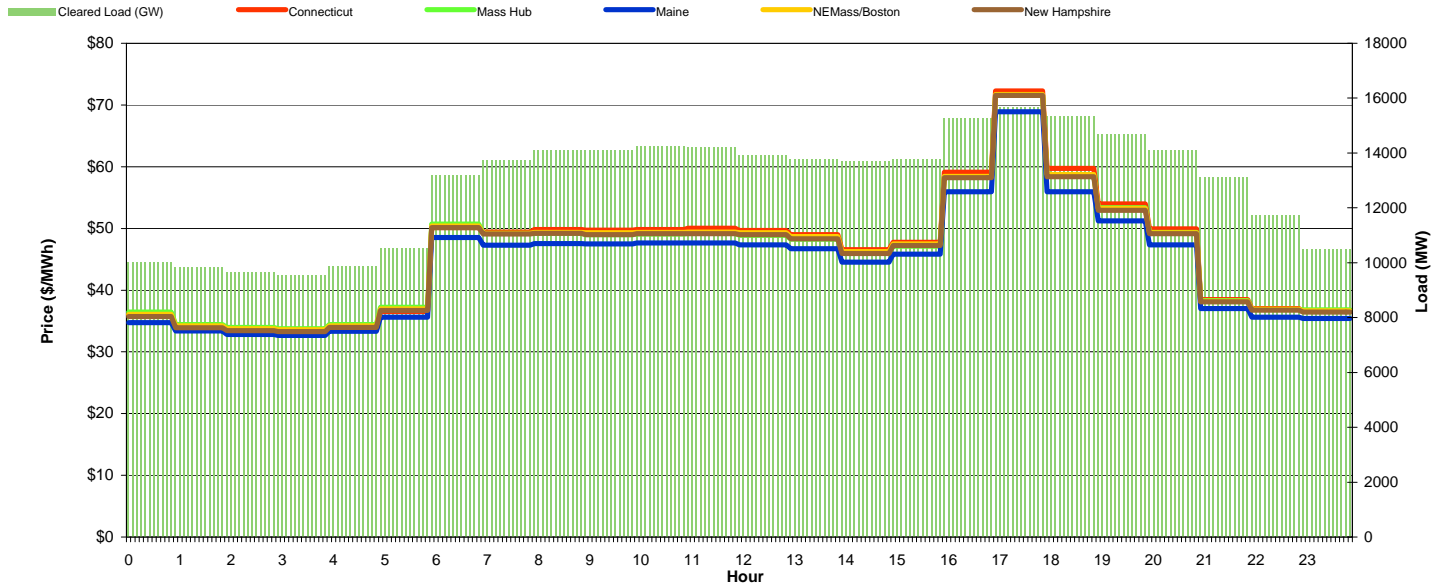

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	36.27	34.37	32.18	32.60	32.82	35.12	51.39	58.41	51.18	45.28	42.57	41.52	39.09	49.65	41.57	40.18	47.84	58.52	58.07	52.76	57.69	36.68	40.87	38.85	43.98	47.62	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	36.66	34.95	32.97	33.39	33.45	35.58	51.80	58.30	50.86	45.15	42.47	41.30	38.99	49.45	41.45	40.18	47.44	57.76	57.08	52.19	56.92	36.32	40.72	38.95	43.93	47.29		
<b>New Hampshire</b>	36.22	34.61	32.65	33.09	33.20	35.37	51.41	57.69	50.34	44.66	42.03	40.78	38.38	48.60	40.84	39.68	46.68	56.77	56.18	51.52	56.23	35.84	40.09	38.33	43.38	46.64		
<b>Maine</b>	35.71	34.23	32.23	32.55	32.62	34.66	49.63	55.10	47.92	42.93	40.47	39.21	36.82	46.49	39.33	38.35	44.60	53.80	52.96	49.25	53.70	34.25	38.32	36.53	41.74	44.59		
<b>Mass Hub</b>	36.76	35.03	32.96	33.38	33.49	35.65	51.81	58.28	51.00	45.19	42.50	41.35	39.00	49.51	41.49	40.16	47.47	57.74	57.12	52.09	56.90	36.38	40.78	39.03	43.96	47.31		
<b>DA Forecast Load (GW)</b>	10.91	10.45	10.22	10.16	10.46	11.53	13.62	14.88	15.28	15.51	15.70	15.69	15.67	15.64	15.55	15.64	16.56	17.45	17.13	16.57	15.81	14.66	13.24	11.98				
<b>Forecast Error %</b>	0.9%	3.0%	3.1%	3.5%	3.1%	1.8%	-0.5%	0.3%	0.4%	-0.5%	-1.3%	-1.5%	-2.3%	-2.3%	-2.9%	-3.6%	-3.2%	-2.3%	-1.7%	-1.5%	-1.3%	-0.8%	-1.2%	-1.6%				

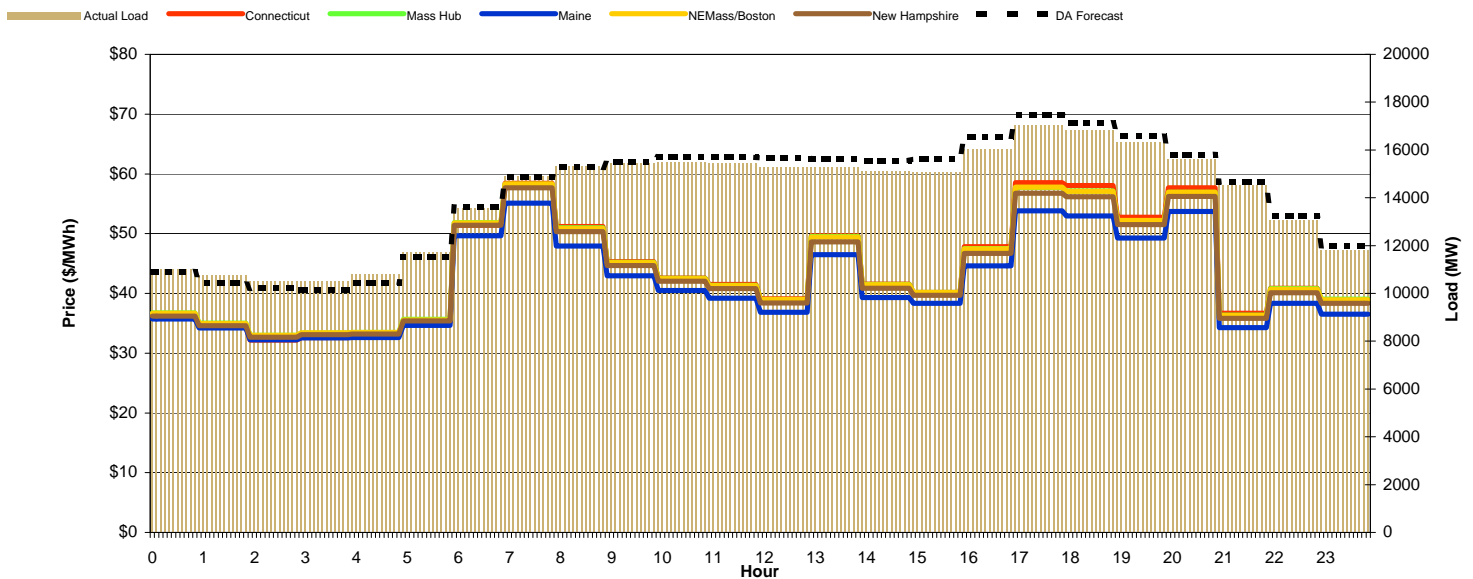




# ISO-NE Daily Report

Thursday November 18, 2010

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	36.65	33.88	33.23	33.29	33.44	36.40	51.14	50.29	49.81	49.86	50.00	50.21	49.98	49.77	48.75	48.83	60.15	67.09	59.58	55.18	50.16	46.76	39.89	39.40	46.82	51.64	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	36.93	34.51	34.10	34.09	34.24	36.90	52.10	49.51	49.31	49.30	49.36	49.38	49.30	49.10	48.11	48.25	59.06	66.21	58.37	54.37	49.37	45.62	39.31	39.53	46.51	50.87		
<b>New Hampshire</b>	36.58	34.29	33.80	33.82	34.02	36.66	51.50	49.12	48.66	48.65	48.84	48.89	48.76	48.62	47.63	47.84	58.59	65.78	57.76	53.92	48.80	45.15	38.93	39.22	46.08	50.37		
<b>Maine</b>	35.50	33.76	33.17	33.28	33.53	35.71	48.96	46.37	45.89	45.85	46.16	46.04	45.97	46.05	45.06	45.58	55.03	62.56	54.57	51.23	46.25	43.06	37.75	38.18	43.98	47.71		
<b>Mass Hub</b>	37.07	34.63	34.13	34.16	34.28	37.00	52.06	49.69	49.21	49.18	49.11	49.18	49.00	48.70	47.92	48.00	59.05	66.04	58.21	54.29	49.45	45.82	39.46	39.61	46.47	50.77		
<b>Cleared Load (GW)</b>	10.3	10.0	9.8	9.6	9.9	10.8	13.3	14.3	14.0	14.0	14.1	14.3	13.8	13.8	13.7	13.7	15.1	15.5	15.2	14.6	14.1	12.8	11.9	10.6				

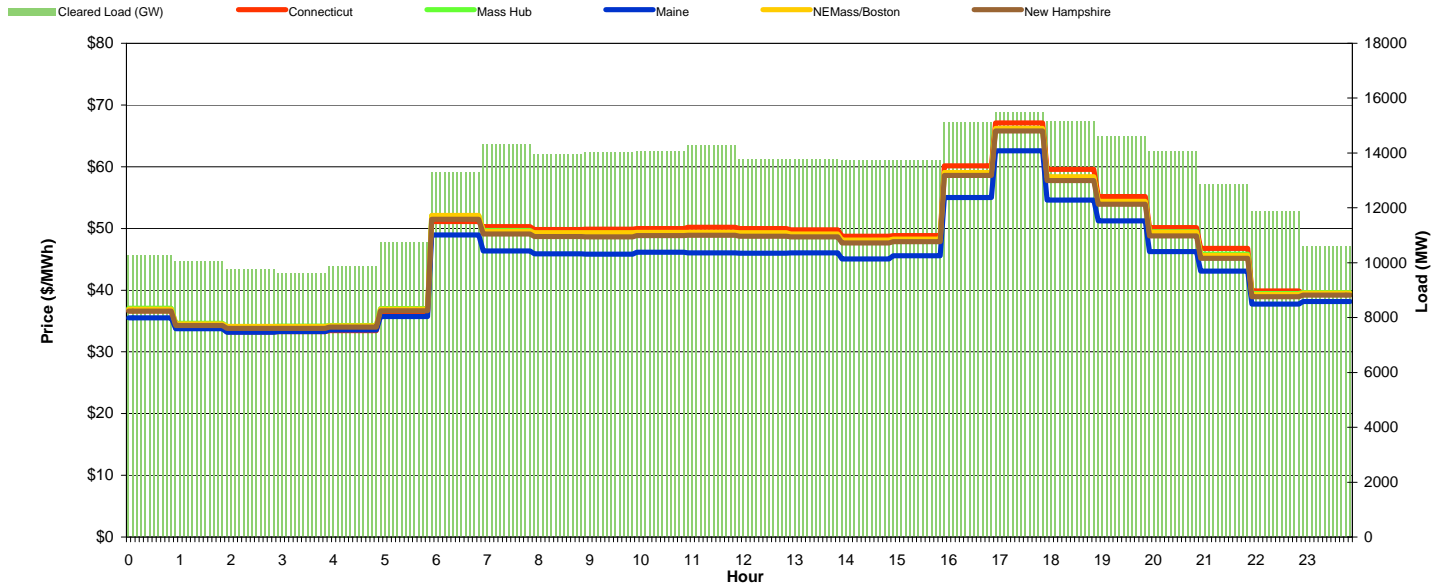

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	31.57	32.15	31.41	32.57	32.93	38.61	42.02	39.15	41.06	44.82	39.53	36.47	37.79	42.08	39.29	40.04	62.85	53.04	43.41	48.98	42.32	41.73	41.72	37.44	40.54	43.39	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	31.87	32.76	32.03	33.08	33.48	38.91	42.32	38.89	40.62	44.11	39.07	35.92	37.24	41.43	38.77	39.57	61.53	52.12	42.41	47.76	41.37	40.98	41.13	37.47	40.20	42.68		
<b>New Hampshire</b>	31.38	32.38	31.68	32.80	33.19	38.51	41.84	38.39	40.12	43.58	38.60	35.41	36.63	40.76	38.14	38.95	60.59	51.37	41.85	47.27	40.87	40.37	40.48	37.01	39.67	42.09		
<b>Maine</b>	30.14	31.63	31.11	32.09	32.56	36.95	40.02	36.84	38.40	41.39	36.87	33.59	34.57	38.42	36.04	36.87	56.22	47.98	39.20	44.70	38.76	38.14	38.40	35.17	37.75	39.77		
<b>Mass Hub</b>	31.90	32.87	32.14	33.25	33.62	39.15	42.40	39.06	40.80	44.25	39.18	36.08	37.40	41.63	38.92	39.66	61.70	52.11	42.45	47.82	41.42	41.11	41.39	37.56	40.33	42.81		
<b>DA Forecast Load (GW)</b>	11.17	10.74	10.52	10.51	10.84	12.01	14.13	15.37	15.65	15.73	15.79	15.76	15.62	15.58	15.45	15.52	16.56	17.60	17.25	16.74	15.99	14.95	13.51	12.19				
<b>Forecast Error %</b>	-2.3%	-0.6%	-0.2%	-0.5%	-0.7%	-1.0%	-3.2%	-4.5%	-4.5%	-4.2%	-3.8%	-3.8%	-3.6%	-3.6%	-3.3%	-3.4%	-2.8%	-2.5%	-1.4%	-0.9%	-0.3%	-0.3%	-0.4%	-0.5%				

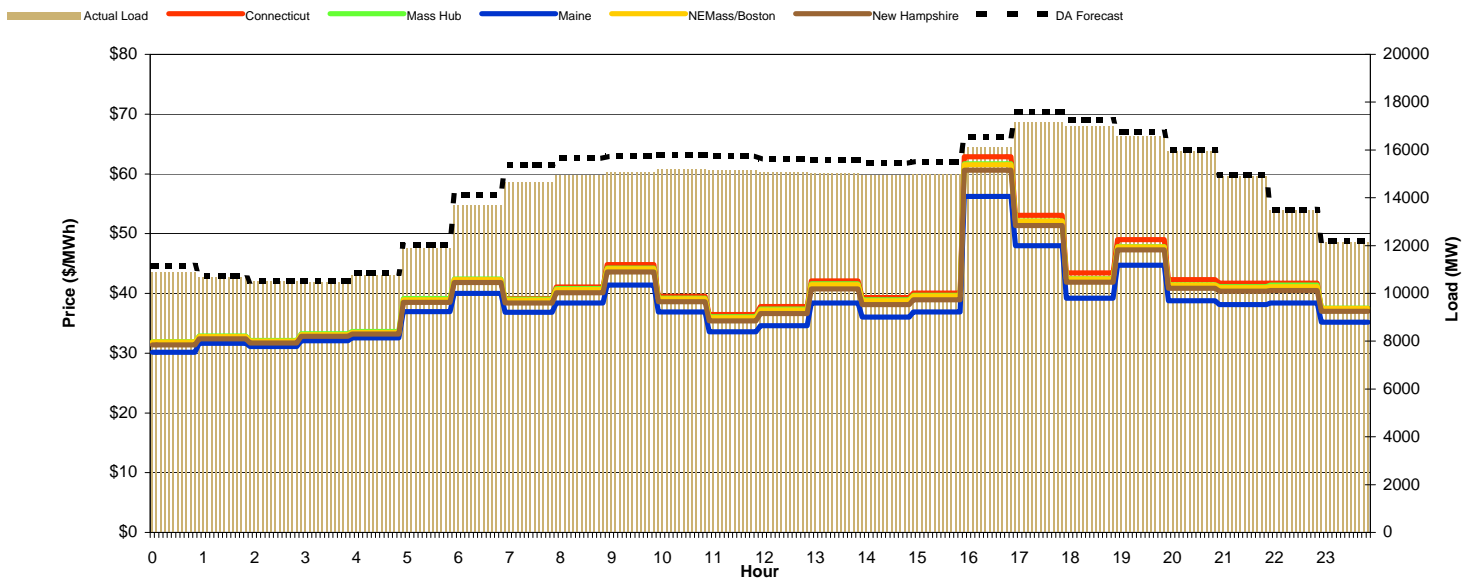




# ISO-NE Daily Report

Friday November 19, 2010

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	34.77	34.66	34.20	34.44	34.56	39.00	53.00	55.55	51.00	50.06	50.02	49.89	47.36	47.00	45.14	46.01	56.62	66.84	58.85	55.50	53.72	48.65	45.80	42.01	47.28	51.75	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	35.25	35.22	34.81	35.07	35.18	39.80	55.91	54.60	49.99	49.33	49.31	49.26	49.47	47.89	46.76	48.38	57.52	65.55	57.61	54.29	52.39	47.47	44.80	41.67	47.40	51.54		
<b>New Hampshire</b>	35.03	35.07	34.70	34.92	35.06	39.60	55.30	54.35	49.80	49.11	49.08	49.00	48.89	47.42	46.21	47.70	56.98	65.04	57.00	53.81	51.83	46.95	44.17	41.11	47.01	51.08		
<b>Maine</b>	33.94	34.47	34.04	34.26	34.47	38.51	53.15	51.49	47.67	47.05	46.94	46.75	47.00	45.45	44.46	45.68	54.51	62.30	54.66	51.48	49.26	44.84	42.48	40.29	45.21	48.88		
<b>Mass Hub</b>	35.34	35.50	35.09	35.49	35.60	40.11	55.53	55.00	49.88	49.17	49.05	48.84	48.00	47.00	45.67	47.00	56.72	65.24	57.31	54.29	52.49	47.61	45.00	41.89	47.20	51.14		
<b>Cleared Load (GW)</b>	10.6	10.3	10.2	10.2	10.5	11.3	13.6	14.7	14.6	14.6	14.6	14.4	14.2	14.2	14.1	14.1	15.2	15.6	15.2	14.6	14.2	13.3	12.2	11.0				

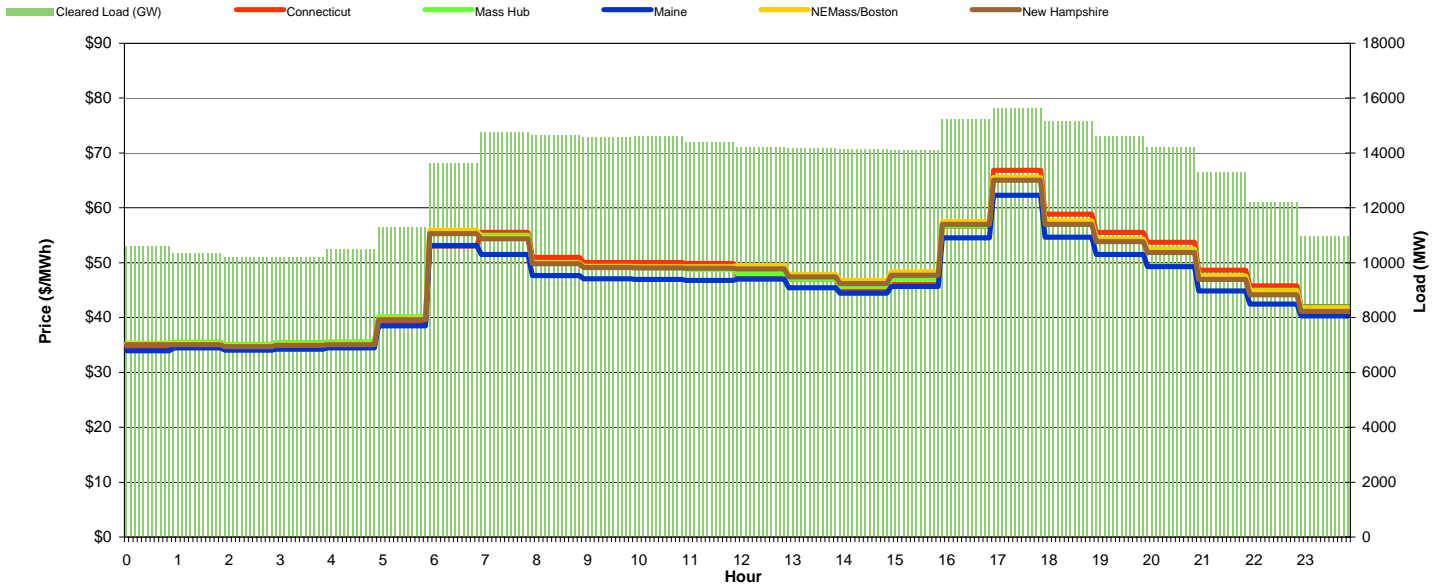

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	35.97	33.46	33.16	33.09	33.22	37.07	49.38	41.28	37.89	38.33	38.77	39.01	38.64	37.81	38.29	43.32	75.98	75.69	64.69	40.81	39.79	41.46	46.02	40.05	43.05	46.11	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	36.40	33.99	33.75	33.70	33.74	37.56	49.82	40.93	37.34	37.62	38.04	38.31	37.87	37.03	37.80	42.79	74.71	74.02	63.31	40.09	38.77	40.47	44.82	39.51	42.60	45.25		
<b>New Hampshire</b>	36.13	33.70	33.49	33.43	33.41	37.28	49.40	40.54	36.94	37.19	37.65	37.87	37.39	36.56	37.27	42.16	73.73	73.12	62.41	39.46	38.10	39.77	43.96	38.74	42.07	44.63		
<b>Maine</b>	35.21	32.76	32.68	32.59	32.23	36.01	47.26	38.84	35.42	35.53	35.98	36.13	35.56	34.69	35.52	40.13	69.88	69.12	58.81	37.75	36.15	37.51	41.80	37.16	40.20	42.43		
<b>Mass Hub</b>	36.53	34.14	33.88	33.82	33.90	37.68	49.88	41.12	37.53	37.83	38.24	38.50	38.05	37.20	37.87	42.87	74.73	74.14	63.36	40.19	38.96	40.68	45.12	39.68	42.75	45.40		
<b>DA Forecast Load (GW)</b>	11.08	10.66	10.47	10.47	10.87	11.95	13.91	15.09	15.41	15.51	15.51	15.45	15.25	15.17	15.06	15.09	16.11	17.01	16.70	16.14	15.52	14.68	13.53	12.32				
<b>Forecast Error %</b>	3.8%	4.2%	3.9%	3.8%	3.0%	2.2%	1.0%	0.3%	-0.3%	0.0%	0.6%	1.6%	2.3%	2.2%	1.8%	2.0%	3.0%	3.8%	4.6%	1.9%	2.4%	2.7%	3.1%	4.0%				

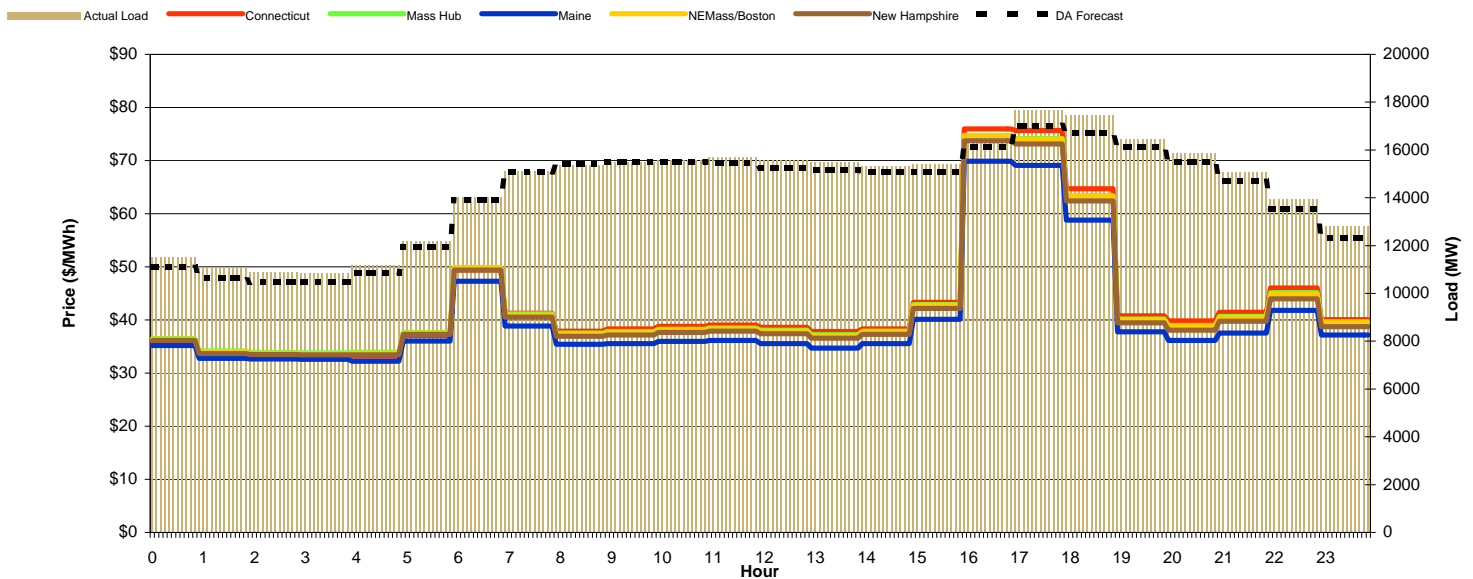




# ISO-NE Daily Report

Saturday November 20, 2010

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	39.20	36.79	35.34	35.30	34.65	36.22	43.40	44.15	49.73	50.08	50.50	50.22	49.68	42.42	36.81	38.13	53.33	68.79	55.75	53.32	49.86	43.42	44.28	42.11	45.15	48.78	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	39.04	36.84	35.45	35.47	34.71	36.14	43.30	43.67	49.11	49.25	49.65	49.42	49.13	42.15	36.70	38.04	52.67	68.00	54.93	52.52	49.25	43.00	43.70	41.76	44.75	48.20		
<b>New Hampshire</b>	38.37	36.36	35.05	35.06	34.28	35.75	42.76	43.26	48.62	48.68	49.07	48.76	48.40	41.53	36.20	37.58	52.12	67.35	54.22	51.77	48.47	42.40	43.12	41.20	44.18	47.60		
<b>Maine</b>	37.16	35.63	34.63	34.62	33.72	34.99	41.57	41.91	47.02	46.94	47.31	46.85	46.45	40.22	35.43	36.86	50.52	65.02	52.39	49.92	46.57	41.19	41.82	40.00	42.86	46.03		
<b>Mass Hub</b>	39.21	37.04	35.59	35.61	35.04	36.30	43.39	43.96	49.45	49.51	49.87	49.63	49.27	42.26	36.79	38.08	52.98	68.06	55.00	52.69	49.38	43.04	43.82	41.84	44.91	48.36		
<b>Cleared Load (GW)</b>	10.4	10.4	10.2	10.2	9.8	10.0	10.6	11.9	12.8	13.1	13.2	13.2	12.7	12.5	12.1	12.2	13.2	13.9	13.7	13.3	13.0	12.4	11.5	10.6				

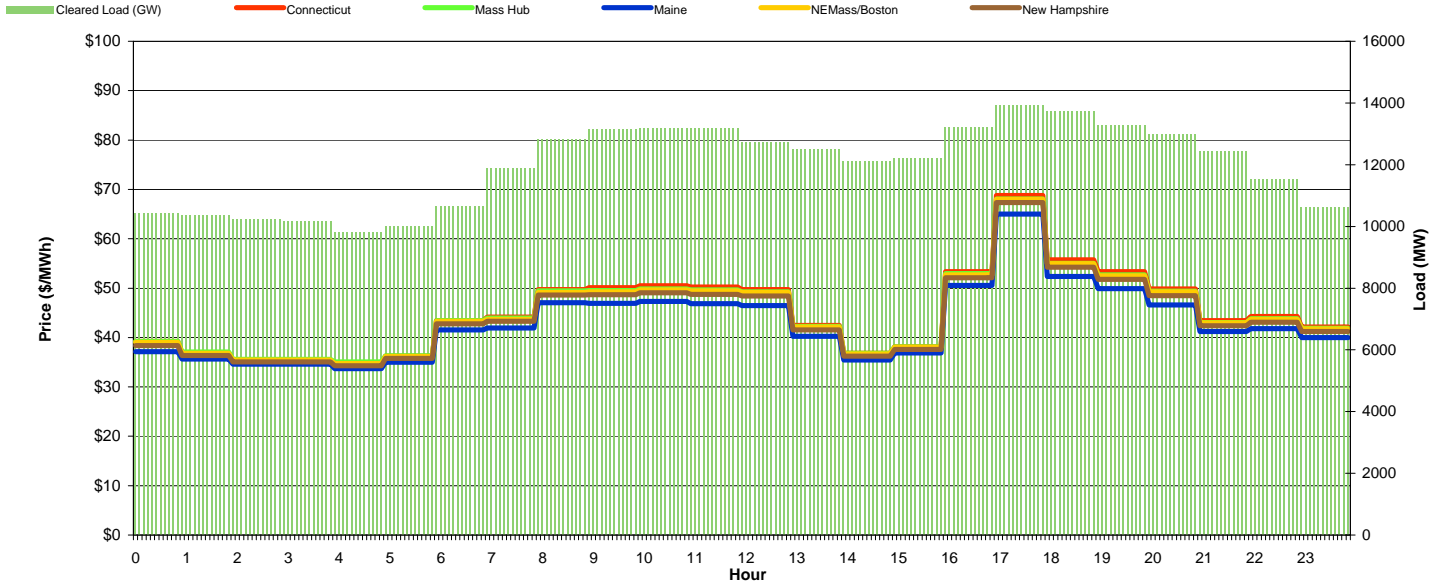

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	37.46	35.76	34.05	33.54	33.83	37.10	38.96	78.92	85.87	64.37	46.07	35.58	35.88	35.44	33.97	34.23	48.32	39.69	38.32	41.30	40.34	41.53	37.81	35.92	42.68	46.10	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	37.40	35.74	34.26	33.90	34.29	37.34	39.05	77.25	83.30	62.54	44.72	34.69	34.99	35.00	33.75	34.17	47.93	39.36	37.97	40.79	39.74	41.02	37.25	35.45	42.16	45.28		
<b>New Hampshire</b>	36.64	35.03	33.63	33.31	33.73	36.79	38.47	76.32	82.50	61.79	44.01	34.09	34.45	34.40	33.24	33.69	47.42	39.04	37.56	40.30	39.27	40.40	36.58	34.79	41.56	44.69		
<b>Maine</b>	35.32	33.86	32.69	32.51	33.11	36.14	37.63	74.09	80.12	59.85	42.51	32.91	33.53	33.25	32.20	32.90	46.59	38.45	36.90	39.54	38.53	39.26	35.34	33.41	40.44	43.50		
<b>Mass Hub</b>	37.48	35.94	34.44	34.03	34.39	37.35	39.04	77.46	83.61	62.90	45.00	34.84	35.13	35.00	33.70	34.09	47.80	39.16	37.80	40.77	39.73	41.05	37.36	35.56	42.23	45.34		
<b>DA Forecast Load (GW)</b>	11.65	11.11	10.83	10.71	10.82	11.26	12.06	12.84	13.74	14.25	14.41	14.27	14.06	13.78	13.60	13.64	14.80	15.87	15.73	15.28	14.78	14.09	13.18	12.14				
<b>Forecast Error %</b>	1.9%	4.1%	4.8%	4.9%	4.5%	2.0%	1.6%	5.6%	6.5%	6.9%	6.5%	5.9%	5.3%	2.0%	1.1%	1.0%	0.6%	0.8%	0.4%	0.3%	-0.1%	0.3%	0.0%	0.8%				

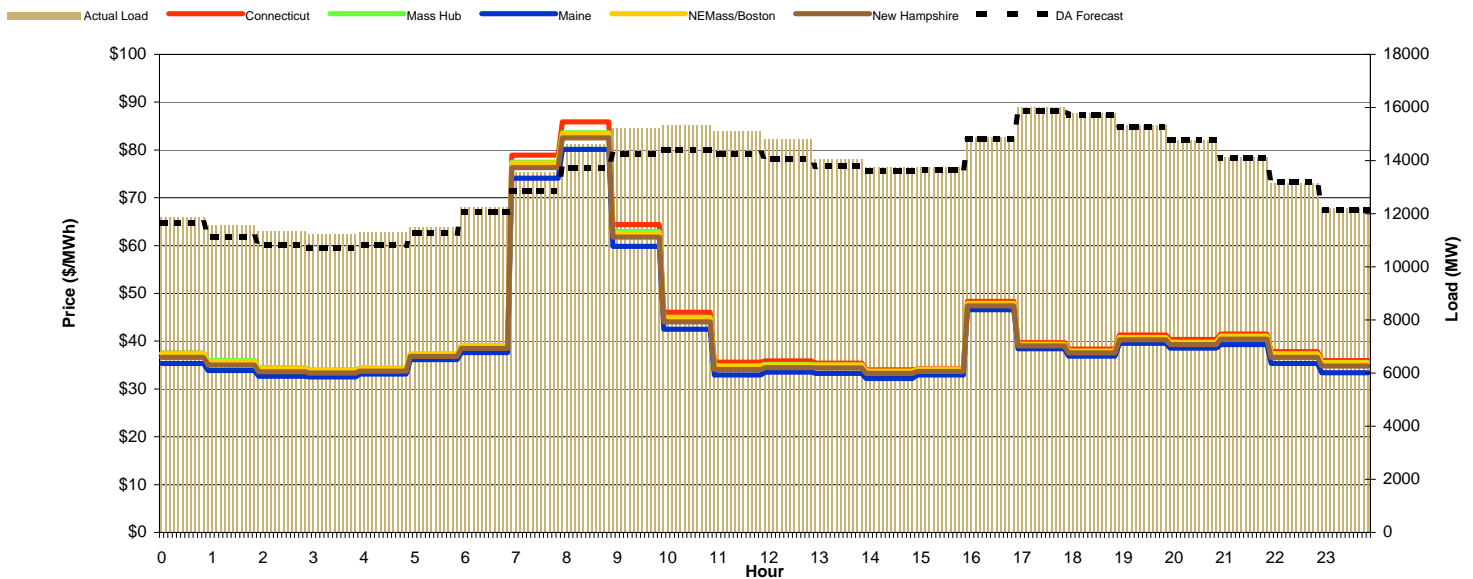




# ISO-NE Daily Report

Sunday November 21, 2010

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	39.39	39.51	36.27	35.19	35.39	36.32	39.30	37.12	38.78	38.88	40.22	40.91	44.57	40.23	37.29	40.21	55.54	73.20	64.83	54.29	50.56	44.54	41.16	38.01	43.40	46.40	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	39.31	39.50	36.36	35.29	35.47	36.44	39.55	36.60	38.39	38.33	39.58	40.24	43.81	39.58	36.71	39.61	54.27	72.03	63.68	52.89	49.29	43.73	40.46	37.89	42.88	45.58		
<b>New Hampshire</b>	38.79	39.08	36.02	34.99	35.15	36.09	39.17	36.24	37.94	38.02	39.15	39.78	43.33	39.12	36.31	39.12	53.71	71.52	63.04	52.21	48.64	43.43	39.96	37.35	42.42	45.10		
<b>Maine</b>	37.43	37.80	35.26	34.12	34.11	35.22	38.12	35.40	37.19	37.44	38.52	39.04	42.38	38.26	35.72	38.47	52.38	70.00	61.57	51.00	47.46	42.78	39.01	36.62	41.47	44.16		
<b>Mass Hub</b>	39.56	39.92	36.62	35.51	35.69	36.76	39.83	37.14	38.69	38.55	39.81	40.47	44.05	39.81	36.91	39.81	54.81	72.35	64.04	53.23	49.66	43.92	40.71	38.00	43.16	45.87		
<b>Cleared Load (GW)</b>	10.8	10.9	10.6	10.2	10.3	10.6	11.0	11.7	12.2	12.8	13.0	13.0	13.0	12.9	12.7	12.9	14.3	14.9	14.9	14.2	14.0	13.0	12.0	11.0				

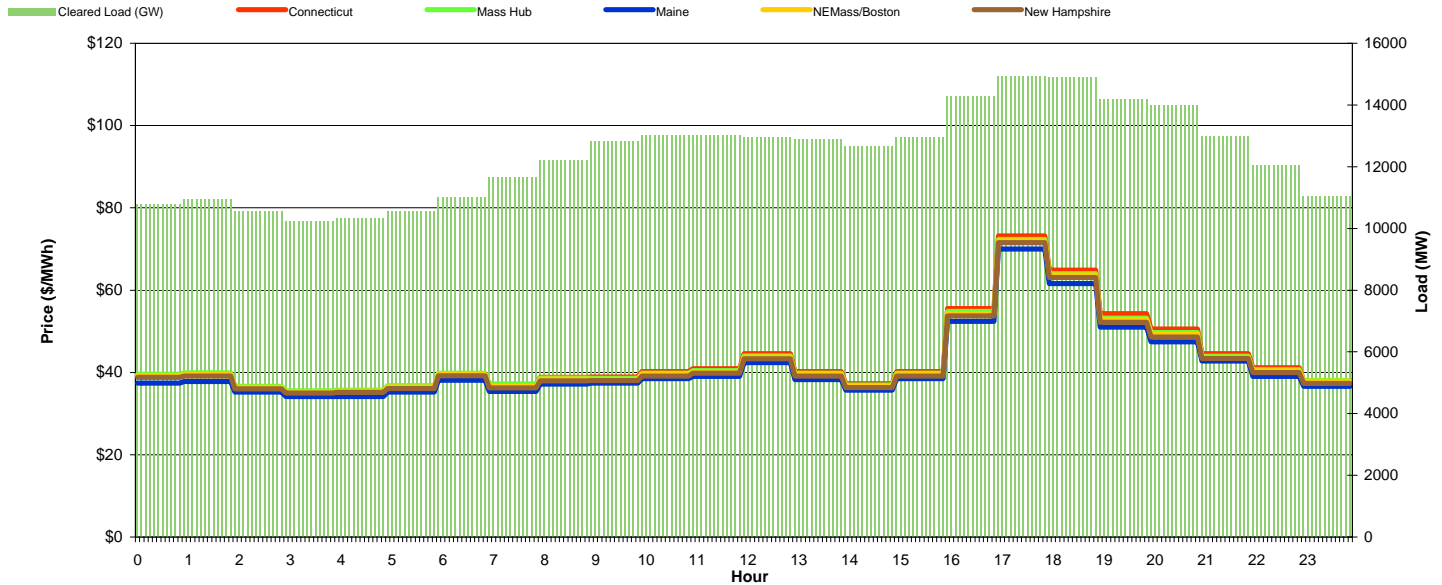

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	35.46	35.36	35.13	34.78	34.96	35.28	37.30	35.97	38.35	37.42	36.71	37.20	42.34	38.15	35.98	37.94	59.59	107.05	46.54	45.43	39.99	39.05	44.06	39.02	42.04	45.11	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	35.45	35.38	35.13	35.00	35.21	35.39	37.44	35.68	38.07	36.99	36.26	36.65	41.69	37.63	35.71	37.63	58.87	105.06	45.68	44.68	39.46	38.90	43.76	39.23	41.71	44.55		
<b>New Hampshire</b>	34.89	34.86	34.61	34.57	34.80	34.93	36.96	35.27	37.64	36.68	35.86	36.17	41.11	37.09	35.18	37.13	58.34	104.20	45.26	44.28	39.02	38.39	43.08	38.57	41.20	44.04		
<b>Maine</b>	33.65	33.60	33.49	33.96	34.17	33.99	36.00	34.27	36.67	35.85	34.99	35.25	39.91	36.06	34.35	36.32	56.84	102.46	44.55	43.67	38.44	37.63	42.08	37.91	40.25	43.08		
<b>Mass Hub</b>	35.63	35.60	35.37	35.17	35.35	35.58	37.49	35.79	38.17	37.09	36.35	36.78	41.85	37.73	35.72	37.65	58.90	105.20	45.72	44.76	39.50	38.85	43.81	39.18	41.80	44.62		
<b>DA Forecast Load (GW)</b>	11.55	11.08	10.83	10.76	10.79	11.24	11.79	12.46	13.37	13.90	14.16	14.17	14.14	13.97	13.86	14.05	15.31	16.60	16.52	16.12	15.47	14.49	13.26	12.14				
<b>Forecast Error %</b>	0.5%	0.7%	1.0%	0.9%	1.3%	0.2%	-1.4%	-1.9%	-1.6%	-0.9%	-1.3%	-0.6%	-0.7%	-0.2%	0.1%	0.2%	0.5%	0.8%	0.8%	0.7%	0.8%	0.8%	0.7%	0.6%				

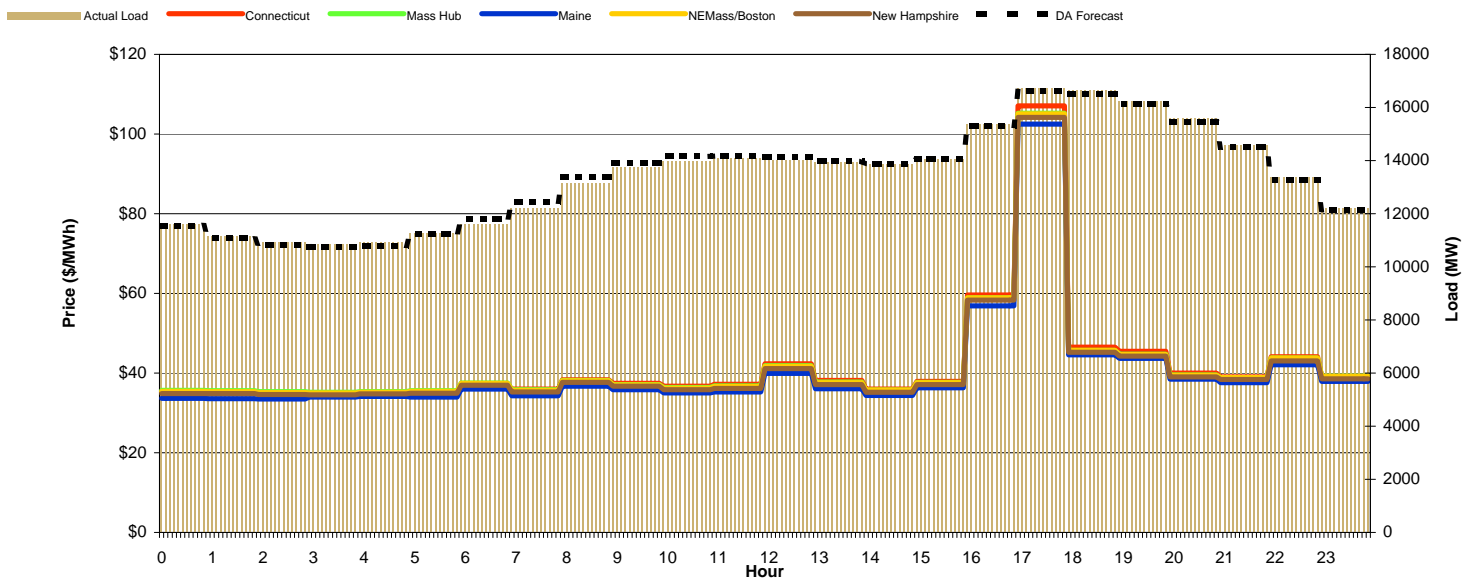




# ISO-NE Daily Report

Monday November 22, 2010

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$				
<b>Connecticut</b>	39.66	36.48	34.84	35.07	35.82	39.38	43.70	46.15	42.75	44.84	44.01	44.89	42.26	40.80	40.44	39.13	50.48	60.46	50.57	47.50	38.00	38.40	34.91	33.04	33.04	41.82	44.10	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	39.74	36.57	35.15	35.42	36.16	39.14	43.60	44.86	41.63	43.77	42.91	43.82	41.56	39.97	39.62	38.42	49.43	59.14	49.39	46.60	37.42	37.90	34.59	33.47	41.26	43.19			
<b>New Hampshire</b>	39.26	36.20	34.87	35.08	35.85	39.10	43.55	44.73	41.51	43.56	42.93	43.80	41.41	39.87	39.51	38.24	49.32	59.16	49.20	46.36	37.27	37.77	34.40	33.33	41.10	43.07			
<b>Maine</b>	38.27	35.40	34.65	34.34	30.70	38.07	42.71	43.48	40.38	42.45	41.86	42.72	40.37	38.81	38.39	37.37	48.10	50.88	48.11	45.28	36.61	37.07	33.62	32.95	39.69	41.59			
<b>Mass Hub</b>	39.91	36.75	35.25	35.52	36.25	39.66	44.24	45.00	41.60	43.67	42.89	43.84	41.56	40.00	39.69	38.49	49.56	58.79	49.31	46.35	37.34	37.80	34.45	33.54	41.31	43.15			
<b>Cleared Load (GW)</b>	10.8	10.6	10.6	10.4	10.9	11.7	14.0	14.4	14.4	14.5	14.6	14.6	14.7	14.4	14.4	14.5	15.7	16.2	15.8	15.2	14.7	13.4	12.0	10.9					

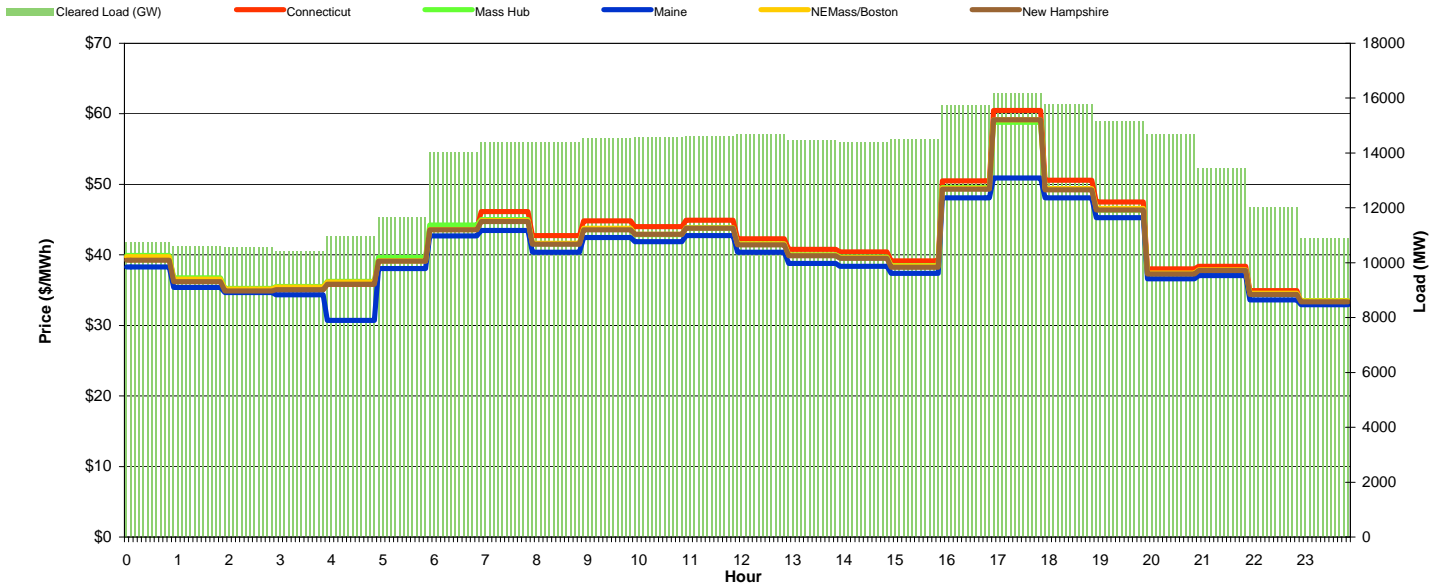

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	34.82	34.38	33.23	33.25	31.85	34.75	44.11	58.07	44.78	43.38	41.20	43.05	36.98	41.02	34.91	34.69	51.22	40.12	37.88	35.85	35.12	35.91	35.48	36.66	38.86	40.60	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	35.03	34.73	33.80	33.88	32.32	35.14	44.71	57.91	44.32	42.95	40.83	42.58	36.52	40.62	34.80	34.69	51.06	39.88	37.40	35.62	34.91	35.65	35.21	37.02	38.82	40.31		
<b>New Hampshire</b>	34.56	34.42	33.50	33.62	32.07	34.96	44.45	57.55	43.99	42.62	40.68	42.43	36.40	40.48	34.71	34.52	50.74	39.62	37.34	35.55	34.79	35.39	34.86	36.85	38.59	40.10		
<b>Maine</b>	33.92	34.16	33.17	33.45	31.60	34.38	43.50	56.19	43.08	41.91	40.12	41.86	36.03	39.97	34.30	34.11	49.90	39.10	37.26	35.50	34.51	35.05	34.26	36.77	38.09	39.57		
<b>Mass Hub</b>	35.08	34.76	33.77	33.84	32.34	35.17	44.62	57.89	44.46	42.96	40.86	42.61	36.63	40.71	34.83	34.69	51.00	39.73	37.47	35.64	34.96	35.79	35.42	37.14	38.85	40.35		
<b>DA Forecast Load (GW)</b>	11.55	11.08	10.89	10.94	11.30	12.51	14.56	15.84	16.19	16.35	16.47	16.32	16.20	16.08	15.98	16.00	17.12	18.14	17.74	17.10	16.25	15.03	13.52	12.11				
<b>Forecast Error %</b>	3.7%	5.8%	5.5%	4.7%	4.3%	1.1%	-2.2%	-2.3%	-2.1%	-2.0%	-1.9%	-0.8%	-0.4%	-1.4%	-2.5%	-2.3%	-3.5%	-3.6%	-2.3%	-1.8%	-1.6%	-1.1%	-0.4%	1.4%				

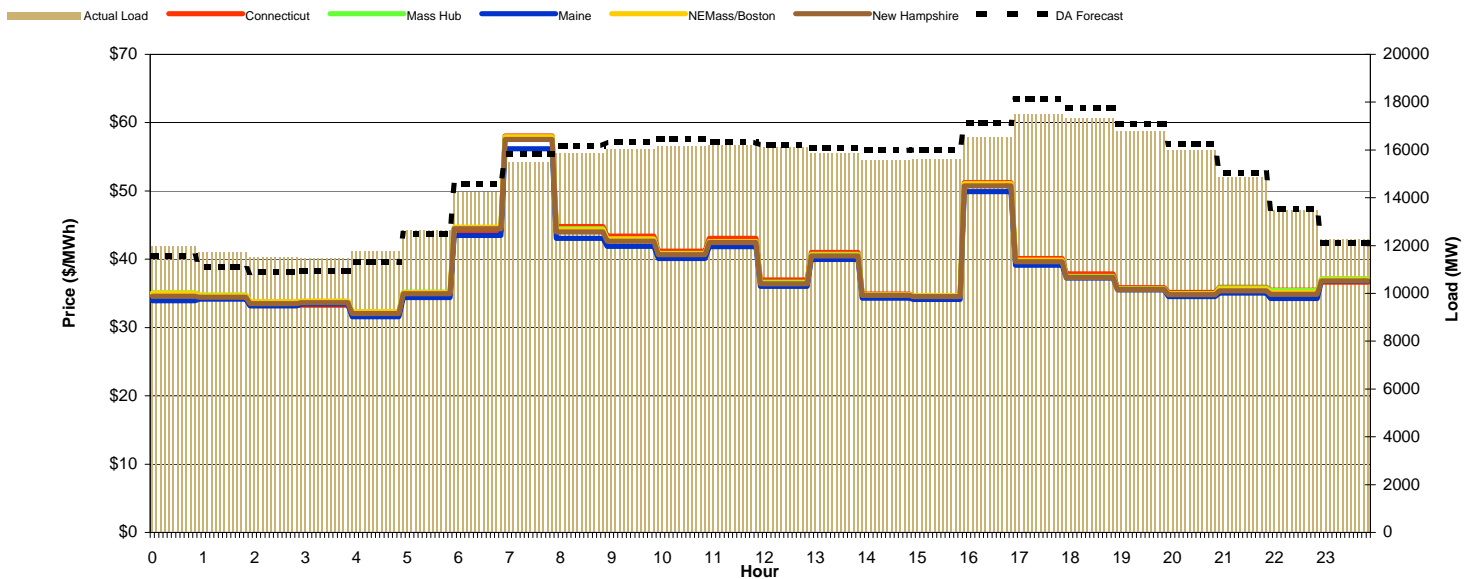




# ISO-NE Daily Report

Tuesday November 23, 2010

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	34.79	34.35	33.81	33.66	33.81	35.09	40.94	49.34	49.69	49.70	49.87	50.04	49.89	50.38	50.15	50.13	56.06	60.65	52.65	50.85	50.41	42.74	38.63	36.12	45.16	50.07	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	35.62	35.22	34.84	34.73	34.87	35.96	41.24	49.30	49.35	49.31	49.33	49.32	49.40	49.26	49.29	49.32	54.54	59.25	51.43	49.54	49.22	41.93	38.20	36.56	44.88	49.25		
<b>New Hampshire</b>	35.29	34.93	34.57	34.46	34.62	35.73	41.23	49.12	48.94	48.75	48.66	48.70	48.66	48.70	48.60	48.65	54.40	58.63	50.97	49.20	48.84	41.57	37.78	36.18	44.47	48.76		
<b>Maine</b>	35.18	34.76	34.32	34.23	34.34	35.69	42.43	48.76	47.97	47.67	47.68	47.80	47.70	47.68	47.60	47.70	52.92	56.68	49.95	47.98	47.74	40.50	36.92	35.41	43.73	47.70		
<b>Mass Hub</b>	35.30	34.95	34.48	34.36	34.48	35.54	41.13	48.57	48.69	48.65	48.77	48.81	48.74	48.90	48.72	48.82	54.42	58.89	51.13	49.25	48.90	41.51	37.84	36.27	44.46	48.79		
<b>Cleared Load (GW)</b>	10.1	9.9	9.8	9.8	9.8	10.4	12.5	13.4	13.5	13.5	13.5	13.6	13.4	13.3	12.9	13.2	14.6	15.6	15.0	14.4	13.6	12.7	11.6	10.6				

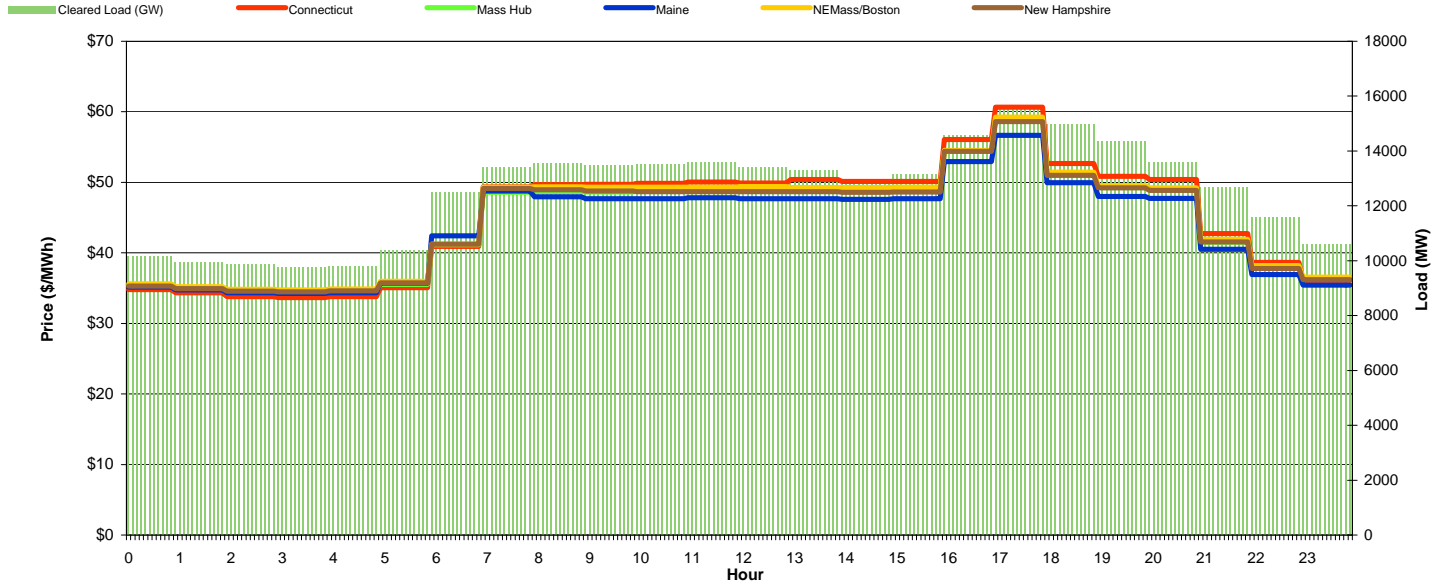

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	36.46	35.49	34.82	34.13	34.25	45.38	57.77	49.94	36.79	49.83	57.41	55.83	51.95	45.61	46.33	52.36	59.95	56.39	47.22	51.71	42.40	37.44	50.98	43.43	46.41	49.51	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	36.95	36.43	36.07	35.41	35.40	46.39	58.61	50.19	36.95	49.61	57.17	55.58	51.79	45.33	45.86	52.19	59.31	55.67	46.37	50.71	41.98	37.24	50.98	44.13	46.51	49.18		
<b>New Hampshire</b>	36.70	36.04	35.75	35.05	35.04	46.07	58.12	49.91	36.72	49.20	56.62	55.10	51.41	45.02	45.50	51.68	58.81	55.15	46.10	50.54	41.72	36.87	50.07	43.31	46.10	48.78		
<b>Maine</b>	36.32	35.73	35.75	35.02	35.04	45.91	57.47	49.69	36.33	48.40	55.23	53.96	50.63	44.38	44.78	50.75	57.50	54.06	45.65	49.36	40.63	35.77	48.39	41.88	45.36	47.84		
<b>Mass Hub</b>	37.04	36.31	35.84	35.19	35.20	46.29	58.35	49.98	36.86	49.62	57.18	55.60	51.80	45.38	45.95	52.17	59.33	55.78	46.50	50.96	42.11	37.30	50.94	43.94	46.48	49.22		
<b>DA Forecast Load (GW)</b>	11.20	10.74	10.49	10.44	10.76	11.93	13.95	15.23	15.56	15.70	15.79	15.75	15.64	15.59	15.48	15.52	16.57	17.56	17.21	16.70	15.95	14.83	13.35	11.98				
<b>Forecast Error %</b>	3.5%	5.2%	7.8%	7.6%	5.3%	1.2%	-2.8%	-3.8%	-3.8%	-3.8%	-3.4%	-2.9%	-2.3%	-1.8%	-1.3%	-1.0%	-1.8%	-2.7%	-1.8%	-1.6%	-1.4%	-0.9%	0.1%	0.6%				

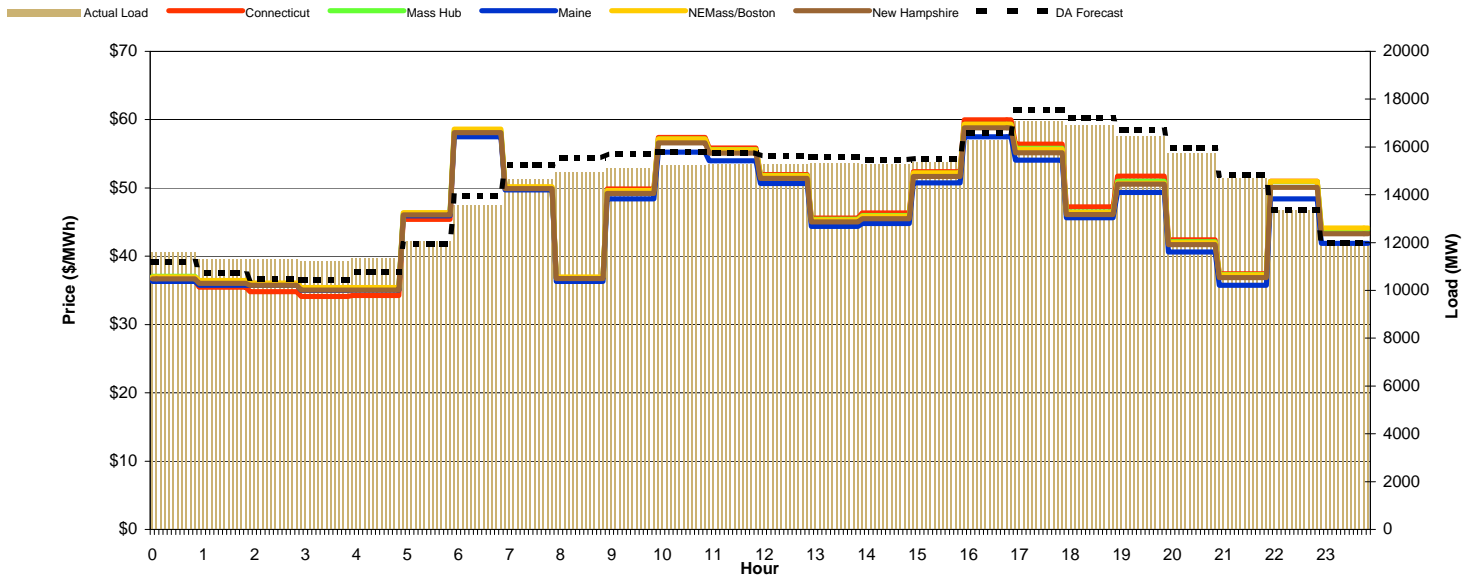




# ISO-NE Daily Report

Wednesday November 24, 2010

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	36.74	36.28	36.61	36.61	36.33	38.96	58.24	49.83	49.85	49.92	50.36	50.48	50.06	49.82	45.03	49.77	55.79	63.14	58.37	53.26	53.79	50.76	47.00	46.66	48.07	51.70	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	37.57	36.93	37.44	37.45	37.14	40.12	58.44	49.21	49.18	49.23	49.43	49.44	49.27	49.18	44.54	49.17	54.58	61.41	56.81	51.89	52.11	49.46	46.08	46.72	47.62	50.69		
<b>New Hampshire</b>	37.09	36.46	37.04	37.04	36.68	39.75	58.14	48.89	48.73	48.75	49.05	49.26	49.05	48.87	44.22	48.92	54.20	60.95	56.39	51.78	51.98	49.06	45.40	45.75	47.23	50.34		
<b>Maine</b>	36.36	35.47	36.36	36.29	35.59	39.24	57.11	48.31	47.97	47.84	48.30	48.68	48.35	48.16	43.59	48.22	53.44	59.98	55.58	50.89	51.03	48.04	43.93	44.00	46.36	49.52		
<b>Mass Hub</b>	37.50	37.05	37.50	37.48	37.17	40.00	58.89	49.13	49.05	49.13	49.42	49.50	49.17	49.02	44.31	48.99	54.78	61.35	56.80	51.86	52.32	49.63	46.24	46.89	47.63	50.67		
<b>Cleared Load (GW)</b>	10.5	10.3	10.6	10.6	10.6	10.9	13.2	14.1	14.2	14.4	14.6	14.7	14.3	13.9	13.7	14.0	15.4	16.1	15.6	15.3	14.7	14.0	12.8	11.5				

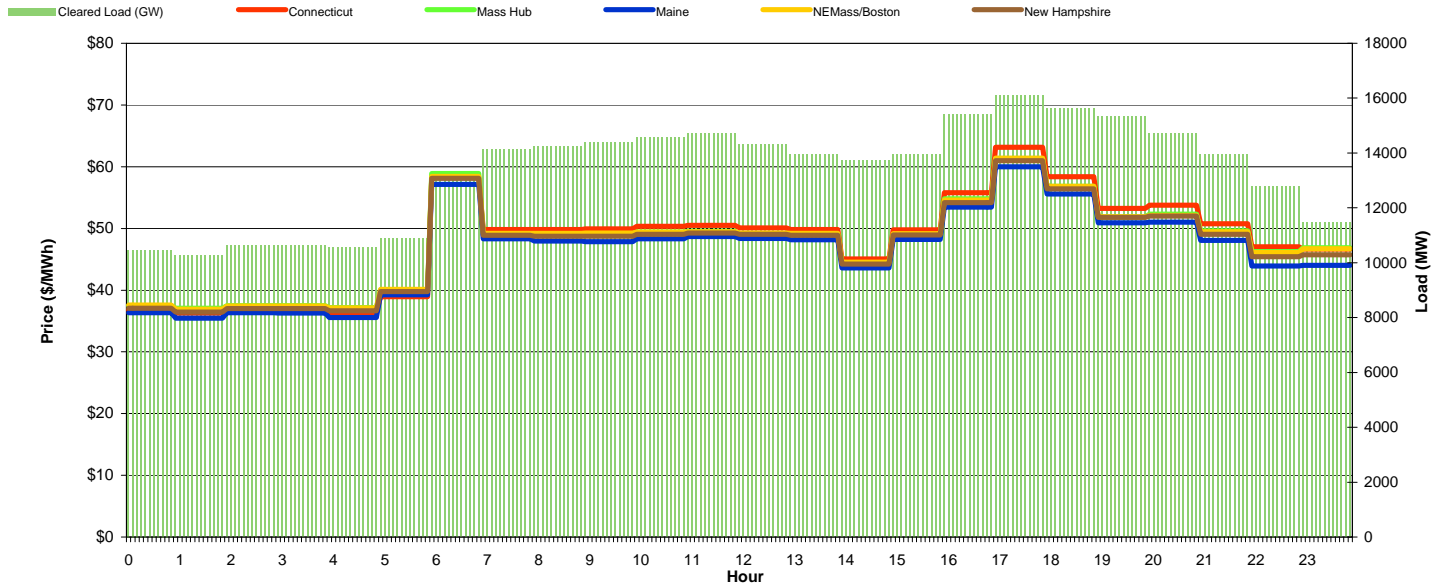

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	35.93	35.73	34.73	35.48	35.69	35.57	43.10	48.07	41.61	52.67	40.09	39.54	41.58	46.74	40.46	41.92	67.28	72.31	48.61	41.81	41.47	44.15	51.44	40.20	44.01	47.48	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	36.78	36.80	35.55	36.26	36.55	36.34	43.62	47.63	41.20	52.38	39.66	39.06	40.92	46.03	39.89	41.32	66.32	71.40	48.05	41.30	40.45	43.03	50.77	40.50	43.83	46.84		
<b>New Hampshire</b>	36.16	36.34	35.01	35.73	36.08	36.01	43.19	47.13	40.80	51.86	39.28	38.78	40.76	45.89	39.76	41.09	65.79	70.70	47.61	41.02	40.19	42.70	49.91	39.57	43.39	46.45		
<b>Maine</b>	35.04	35.73	33.68	34.35	34.91	35.16	42.33	45.95	39.92	50.84	38.57	38.25	40.06	45.11	39.17	40.22	64.58	69.37	46.57	40.16	39.29	41.58	47.98	38.01	42.37	45.48		
<b>Mass Hub</b>	36.66	36.64	35.49	36.24	36.48	36.26	43.57	47.87	41.41	52.56	39.85	39.27	41.21	46.37	40.16	41.60	66.66	71.70	48.27	41.48	40.79	43.48	51.06	40.39	43.98	47.11		
<b>DA Forecast Load (GW)</b>	10.98	10.53	10.36	10.38	10.73	11.89	13.90	15.10	15.41	15.51	15.54	15.55	15.39	15.31	15.16	15.26	16.37	17.38	17.36	16.96	16.29	15.25	13.77	12.40				
<b>Forecast Error %</b>	5.1%	7.7%	9.7%	9.3%	7.4%	1.0%	-3.2%	-2.7%	-0.8%	0.6%	1.3%	1.2%	1.2%	1.0%	1.2%	0.8%	0.4%	0.8%	0.0%	-0.3%	-0.2%	0.8%	2.7%	3.4%				

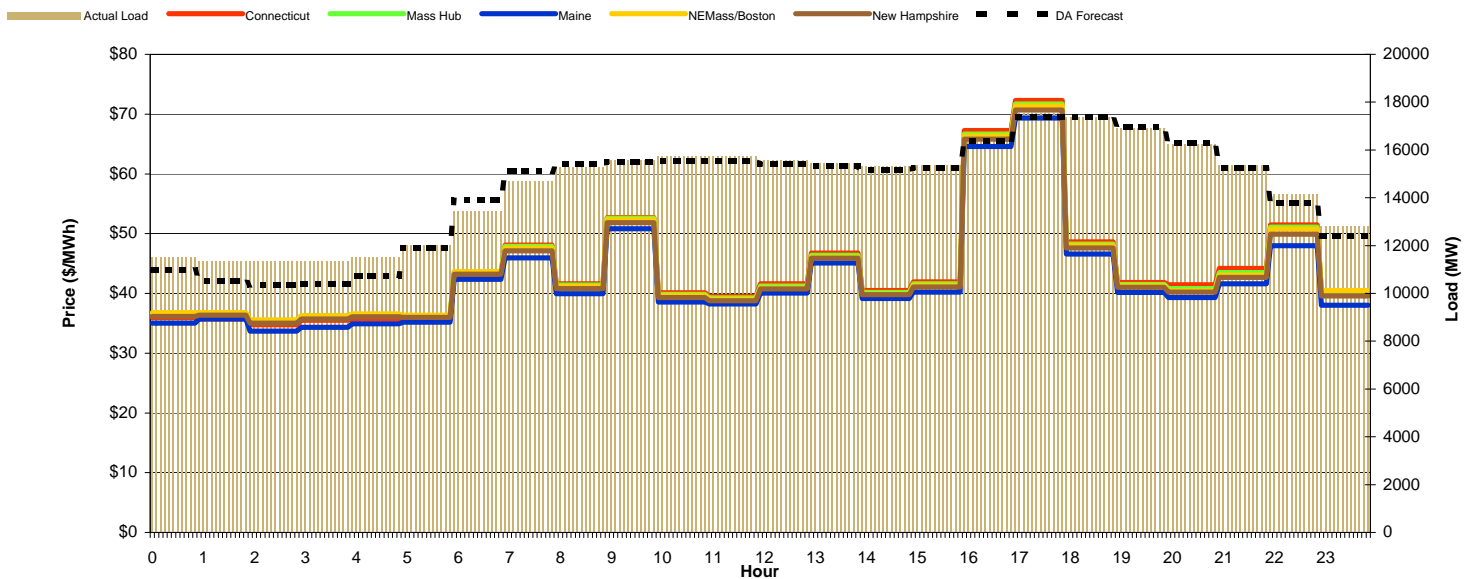






# ISO-NE Daily Report

Thursday November 25, 2010

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	43.32	40.48	39.34	36.28	37.00	40.00	42.19	43.86	49.64	54.00	54.20	54.17	50.15	44.37	40.56	40.29	44.10	50.38	52.01	50.15	49.95	49.79	44.64	43.00	45.58	48.27	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	43.32	40.43	39.91	36.90	37.57	40.62	42.76	43.59	48.96	52.75	52.88	52.85	49.08	43.72	39.88	39.79	43.62	49.29	50.77	49.10	49.07	49.01	44.18	43.09	45.13	47.41		
<b>New Hampshire</b>	42.67	39.93	39.22	36.32	36.96	40.13	42.37	43.40	48.66	52.42	52.39	52.32	48.49	43.06	39.43	39.37	43.15	48.91	50.34	48.53	48.43	48.61	43.86	42.46	44.64	46.96		
<b>Maine</b>	41.43	38.67	38.17	35.38	35.93	39.65	41.88	42.92	48.24	52.12	51.84	51.75	47.78	42.15	38.67	38.79	42.95	48.68	49.85	47.59	47.39	47.60	43.11	41.61	43.92	46.34		
<b>Mass Hub</b>	43.60	40.85	40.02	36.99	37.67	40.65	42.80	43.91	49.50	53.62	53.75	53.72	49.60	43.95	40.12	39.93	43.94	49.83	51.32	49.51	49.43	49.41	44.52	43.29	45.50	47.88		
<b>Cleared Load (GW)</b>	10.5	10.7	10.4	10.4	10.4	10.3	11.1	12.1	13.0	13.8	14.0	14.0	13.5	12.7	12.1	12.1	13.1	13.8	13.9	13.6	13.2	12.5	11.6	10.6				

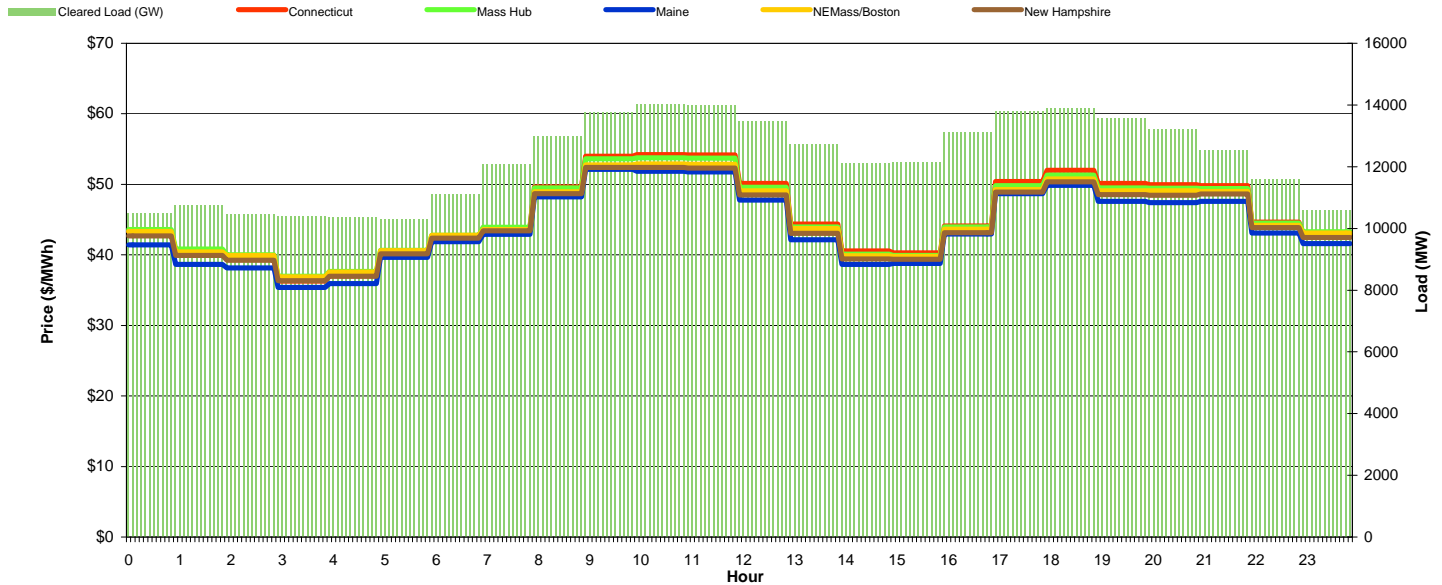

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	45.53	41.80	35.71	36.12	35.38	37.99	38.92	38.43	49.36	55.31	43.99	42.04	40.33	40.83	36.28	35.40	35.43	35.71	36.55	38.77	39.57	42.33	41.58	36.78	40.01	40.74	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	45.99	42.13	36.27	36.99	36.16	38.85	39.68	38.74	49.14	54.39	43.29	41.34	39.64	40.19	35.83	35.13	35.48	35.54	36.38	38.53	39.22	42.27	41.85	37.11	40.01	40.44		
<b>New Hampshire</b>	45.03	41.35	35.68	36.35	35.50	38.14	39.09	38.26	48.81	54.01	42.90	40.89	39.19	39.69	35.46	34.84	35.05	35.12	35.81	38.00	38.63	41.73	41.30	36.67	39.48	39.98		
<b>Maine</b>	43.26	39.65	34.28	35.04	34.22	37.21	38.44	37.71	48.12	52.96	42.07	40.10	38.37	38.73	34.59	34.32	34.92	34.92	35.20	37.37	37.72	40.89	40.51	35.86	38.60	39.28		
<b>Mass Hub</b>	45.90	42.19	36.25	36.84	36.02	38.63	39.49	38.72	49.36	54.79	43.55	41.58	39.88	40.43	36.01	35.25	35.48	35.61	36.49	38.69	39.44	42.38	41.85	37.17	40.08	40.59		
<b>DA Forecast Load (GW)</b>	12.05	11.45	11.09	10.94	11.04	11.56	12.27	13.07	14.26	15.09	15.56	15.49	15.05	14.17	13.40	13.09	13.62	14.02	14.03	14.01	13.90	13.50	12.75	11.80				
<b>Forecast Error %</b>	-1.7%	3.1%	7.1%	6.0%	6.0%	-0.8%	-0.8%	0.0%	-0.1%	0.4%	0.3%	0.8%	0.7%	1.2%	2.1%	3.0%	2.4%	1.7%	1.1%	-0.9%	-1.3%	-1.5%	-1.6%	0.9%				

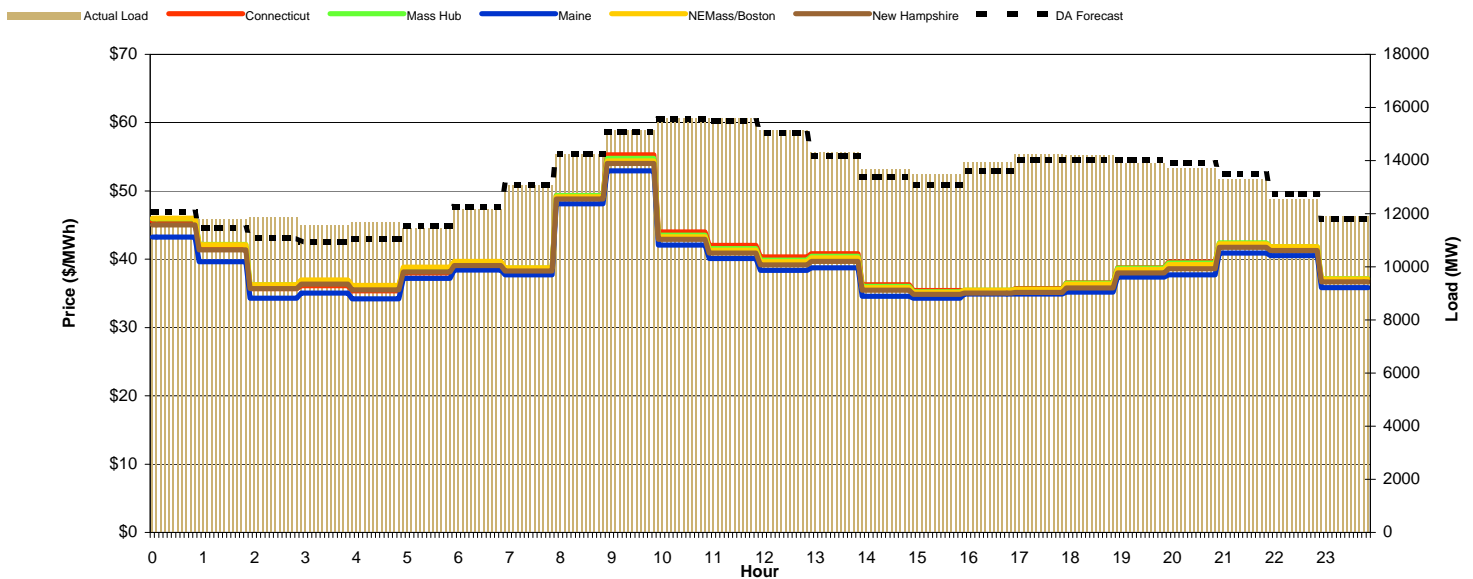




# ISO-NE Daily Report

Friday November 26, 2010

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	37.76	35.71	34.76	34.66	34.90	36.74	39.01	40.25	45.30	49.76	50.03	50.24	50.11	50.18	50.20	50.20	57.01	62.10	60.21	60.00	51.68	50.05	45.52	44.00	46.68	51.43	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	38.21	36.23	35.35	35.30	35.56	37.43	39.57	40.42	45.19	49.18	49.24	49.39	49.22	49.20	49.15	49.23	55.67	60.76	58.65	58.27	50.49	49.34	45.26	44.39	46.28	50.54		
<b>New Hampshire</b>	37.80	35.89	34.97	34.95	35.38	37.17	39.37	40.13	44.67	48.63	48.74	48.95	48.77	48.72	48.66	48.83	55.28	60.32	58.15	57.74	50.09	49.02	44.82	43.95	45.88	50.10		
<b>Maine</b>	37.35	35.35	34.41	34.39	35.49	36.99	39.48	40.26	44.61	48.05	48.15	48.15	47.97	47.86	47.83	48.05	55.00	60.00	57.58	56.98	50.00	48.45	44.00	43.34	45.41	49.56		
<b>Mass Hub</b>	38.29	36.37	35.50	35.41	35.63	37.50	39.65	40.10	44.91	49.14	49.27	49.44	49.24	49.26	49.24	49.23	55.93	60.88	58.79	58.54	50.55	49.31	45.19	44.53	46.33	50.56		
<b>Cleared Load (GW)</b>	10.7	10.6	10.5	10.3	10.5	10.7	11.5	12.2	13.0	13.5	13.8	13.8	13.6	13.4	13.2	13.4	14.5	15.2	14.9	14.4	14.1	13.1	12.4	11.3				

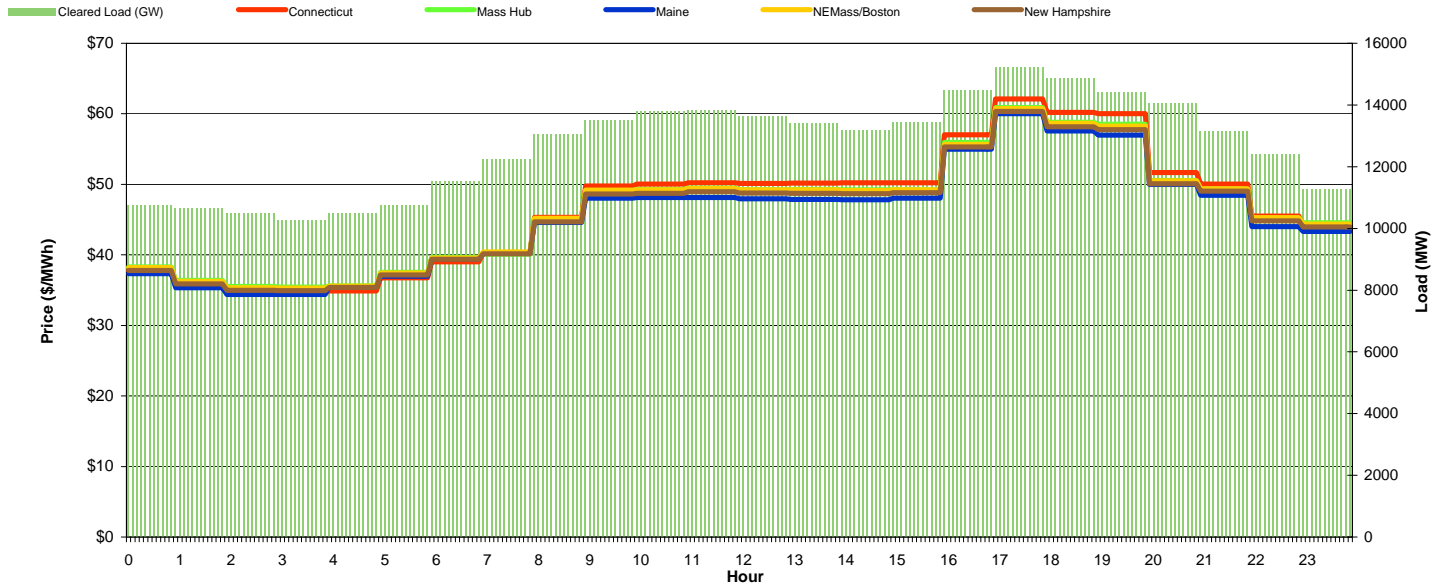

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	33.74	41.92	34.35	34.20	32.42	34.95	37.83	34.63	34.74	36.55	39.36	42.75	42.38	48.11	38.72	38.14	49.49	52.79	42.80	39.73	37.54	37.29	37.89	35.86	39.09	40.81	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	34.26	42.73	35.22	35.12	33.12	35.78	38.66	35.15	35.09	36.73	39.13	42.23	41.74	47.45	38.32	37.76	48.80	51.60	41.64	38.92	36.90	37.01	38.07	36.21	39.07	40.41		
<b>New Hampshire</b>	33.80	42.23	34.84	34.80	32.84	35.45	38.26	34.72	34.67	36.33	38.80	41.92	41.44	47.06	38.01	37.45	48.37	51.32	41.39	38.56	36.64	36.75	37.66	35.73	38.71	40.07		
<b>Maine</b>	33.15	41.82	34.72	34.72	32.42	35.16	38.27	34.74	34.41	35.96	38.28	41.28	40.76	46.36	37.55	37.01	48.00	50.70	40.72	37.73	36.06	35.95	36.74	34.70	38.22	39.52		
<b>Mass Hub</b>	34.24	42.66	35.13	35.01	33.07	35.66	38.49	34.97	34.98	36.68	39.21	42.41	41.98	47.70	38.48	37.89	49.00	51.92	42.00	39.18	37.11	37.11	37.99	36.08	39.12	40.54		
<b>DA Forecast Load (GW)</b>	10.94	10.51	10.35	10.30	10.58	11.20	12.05	12.73	13.64	14.31	14.65	14.74	14.71	14.48	14.34	14.46	15.58	16.65	16.20	15.69	15.15	14.45	13.52	12.41				
<b>Forecast Error %</b>	5.3%	8.0%	9.7%	10.6%	9.5%	4.3%	-0.1%	-0.6%	-1.1%	-1.0%	-0.5%	-0.5%	-1.1%	-0.8%	-1.2%	-1.7%	-2.3%	-2.9%	-1.2%	-0.5%	-0.2%	-0.2%	-0.3%	0.3%				

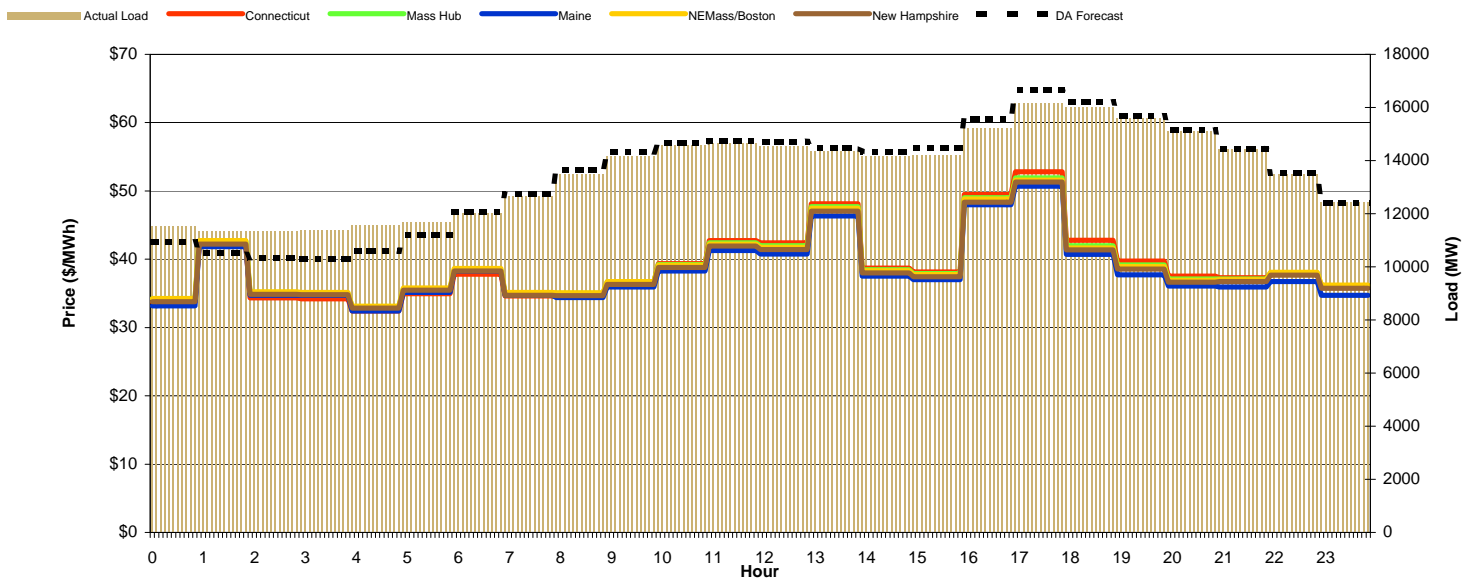




# ISO-NE Daily Report

Saturday November 27, 2010

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$				
<b>Connecticut</b>	39.71	39.53	38.81	38.21	38.32	39.00	57.98	48.94	44.18	49.87	50.05	49.86	49.69	43.95	39.66	42.99	49.76	59.23	54.50	52.18	50.15	45.02	45.55	43.45	43.45	46.27	48.47	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	40.00	39.86	39.34	38.77	38.90	39.67	58.67	48.98	43.70	49.12	49.15	49.11	49.04	43.69	39.49	42.81	49.11	58.09	53.34	51.03	49.15	44.29	45.16	43.73	46.01	47.83			
<b>New Hampshire</b>	39.59	39.47	38.94	38.39	38.51	39.29	58.22	48.86	43.47	48.70	48.66	48.54	48.52	43.21	39.11	42.42	48.96	57.77	53.05	50.59	48.84	43.93	44.85	43.30	45.63	47.47			
<b>Maine</b>	38.69	38.48	38.13	37.57	37.77	38.55	57.88	48.65	43.23	48.10	48.06	47.88	47.77	42.45	38.63	41.85	48.41	57.35	52.61	49.83	48.13	43.21	44.00	42.29	44.98	46.89			
<b>Mass Hub</b>	40.13	40.10	39.50	38.96	39.05	39.65	58.81	49.00	43.92	49.43	49.41	49.30	49.20	43.71	39.45	42.80	49.42	58.40	53.61	51.24	49.31	44.51	45.30	43.88	46.17	48.00			
<b>Cleared Load (GW)</b>	10.6	10.7	10.6	10.4	10.5	10.4	11.2	12.0	12.8	13.6	13.5	13.4	13.1	12.9	12.6	12.8	14.1	14.7	14.5	14.0	13.7	13.1	12.3	11.2					

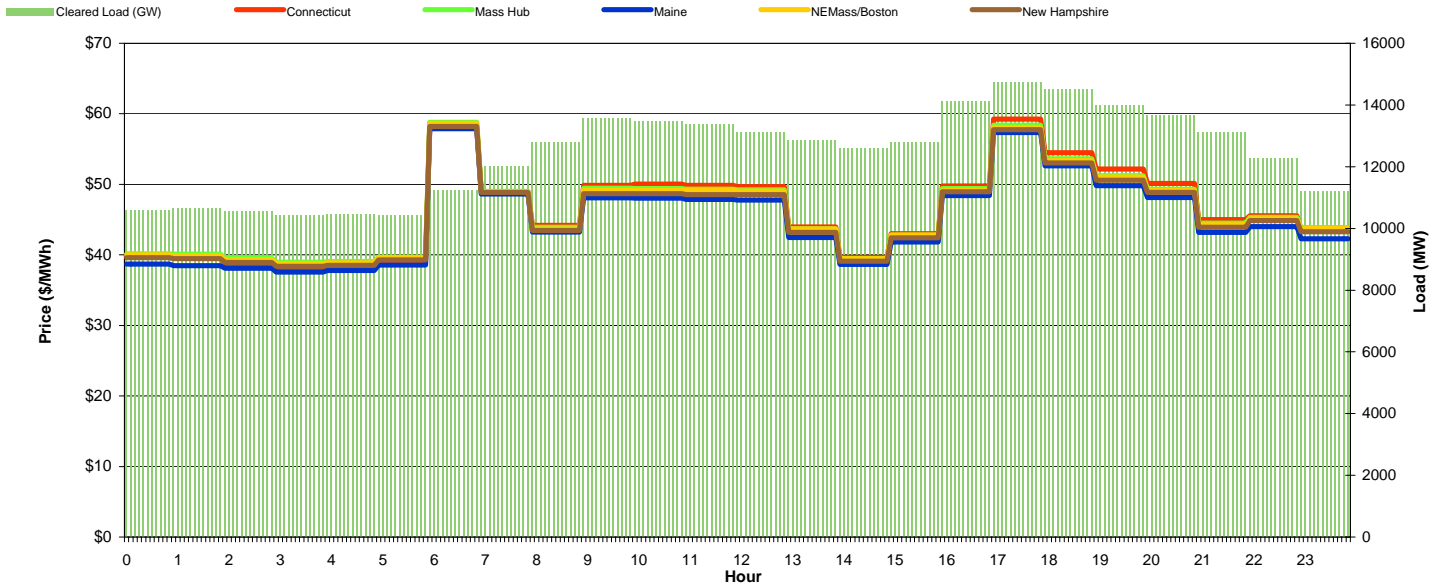

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	39.50	34.34	33.62	33.43	33.81	30.56	31.30	28.30	36.21	35.73	37.51	43.41	49.60	42.57	40.19	48.55	58.75	54.19	41.75	43.14	49.16	42.77	50.76	60.17	41.64	43.91	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	40.09	34.99	34.36	34.22	34.63	31.21	31.95	28.42	36.11	35.53	37.21	42.74	48.71	42.06	39.73	47.97	57.90	53.27	41.12	42.02	47.75	41.73	49.88	60.33	41.41	43.26		
<b>New Hampshire</b>	39.54	34.52	33.94	33.83	34.27	30.97	31.67	28.22	35.86	35.22	36.99	42.41	48.21	41.64	39.43	47.64	57.37	52.71	40.61	41.58	47.24	41.38	49.48	59.54	41.01	42.87		
<b>Maine</b>	38.43	33.77	33.21	33.08	33.64	30.58	31.25	27.76	35.40	34.76	36.81	41.98	47.38	40.85	38.88	46.94	56.44	51.69	39.90	40.68	46.21	40.42	48.39	57.97	40.27	42.16		
<b>Mass Hub</b>	39.93	34.86	34.24	34.09	34.49	31.12	31.87	28.46	36.23	35.65	37.37	43.01	49.05	42.30	39.95	48.24	58.17	53.52	41.29	42.35	48.24	42.12	50.27	60.26	41.55	43.51		
<b>DA Forecast Load (GW)</b>	11.71	11.23	10.97	10.93	11.02	11.51	12.14	12.89	13.90	14.45	14.61	14.45	14.27	13.94	13.79	14.02	15.33	16.30	16.03	15.65	15.07	14.38	13.44	12.39				
<b>Forecast Error %</b>	0.5%	3.4%	4.8%	4.6%	2.9%	-0.5%	-0.5%	-0.8%	-2.7%	-2.0%	-1.4%	-0.2%	0.4%	1.2%	1.3%	1.0%	0.4%	0.7%	1.4%	1.0%	1.8%	2.2%	2.6%	3.4%				

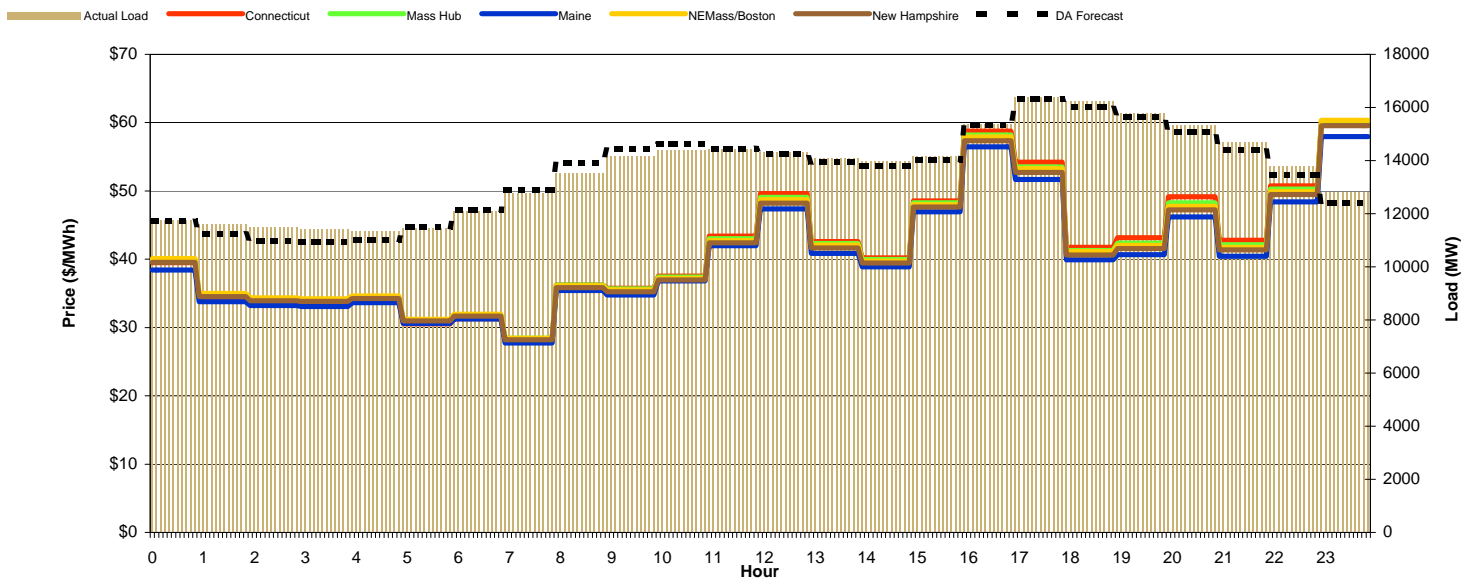




# ISO-NE Daily Report

Sunday November 28, 2010

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	35.47	35.20	34.53	33.79	34.38	34.80	34.89	34.93	37.27	40.03	47.88	47.80	47.88	45.12	40.35	45.04	60.58	69.13	62.45	60.00	55.11	49.88	40.18	35.80	44.27	48.98	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	35.60	35.59	35.25	34.60	35.10	35.50	35.66	35.17	37.42	40.07	47.84	47.75	47.90	45.15	40.36	44.90	59.90	68.29	61.63	58.80	53.90	49.02	40.01	36.25	44.24	48.63		
<b>New Hampshire</b>	35.41	35.21	34.86	34.37	34.79	34.99	35.58	35.12	37.41	39.89	47.57	47.45	47.63	44.95	40.17	44.79	59.88	67.88	61.35	58.47	53.75	48.85	39.77	35.85	44.00	48.43		
<b>Maine</b>	35.06	34.43	34.14	34.15	34.64	34.20	35.77	34.83	37.35	39.74	47.28	47.21	47.31	44.51	39.85	44.40	58.77	66.25	60.04	57.06	52.40	48.07	39.15	35.32	43.41	47.76		
<b>Mass Hub</b>	35.82	35.82	35.31	34.54	35.10	35.47	35.59	35.13	37.36	40.07	47.74	47.64	47.73	44.98	40.11	44.79	60.29	68.58	61.56	58.95	54.07	49.14	40.20	36.39	44.27	48.65		
<b>Cleared Load (GW)</b>	10.6	10.6	10.3	10.0	10.1	10.4	11.2	11.4	12.3	12.7	12.8	12.8	12.8	12.5	12.3	12.5	14.1	15.2	14.7	14.3	13.8	13.0	12.3	11.2				

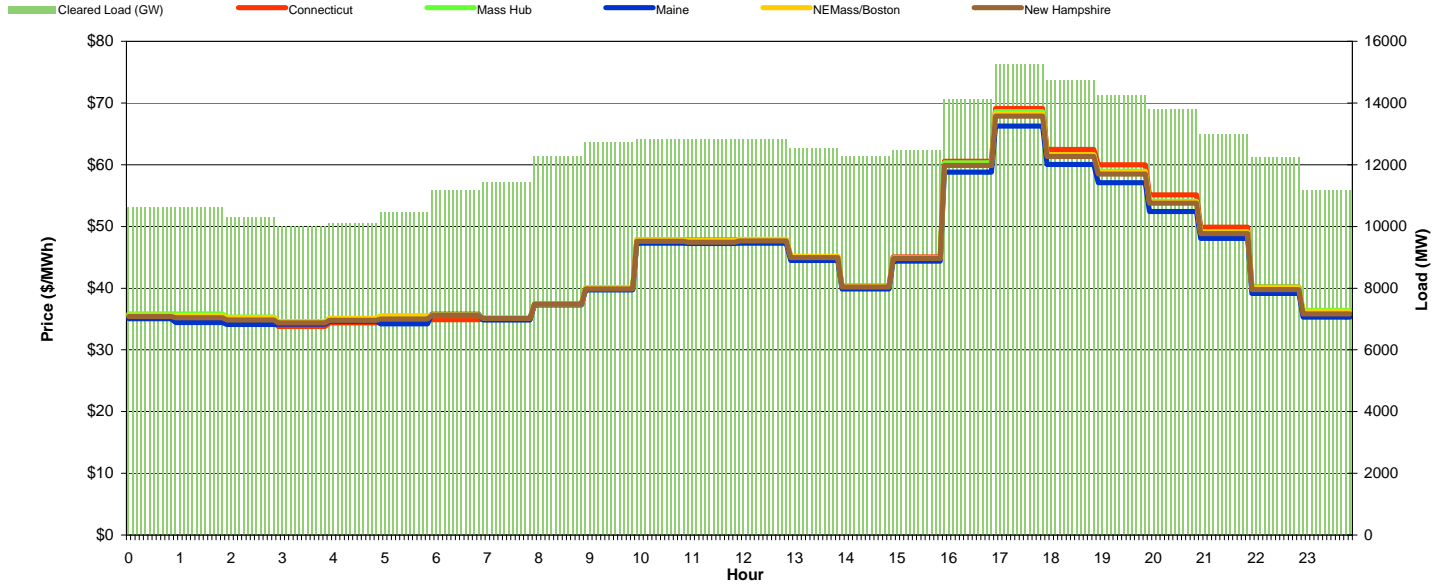

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	51.99	40.37	37.01	36.94	39.05	41.25	36.85	47.42	39.95	45.10	46.73	48.11	52.74	39.47	36.70	40.99	53.45	39.02	42.16	46.83	48.82	43.28	47.21	50.08	43.81	44.87	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	52.16	40.70	37.75	37.73	39.81	42.14	37.55	47.77	39.97	45.13	46.52	47.95	52.63	39.38	36.75	40.71	52.20	37.86	41.03	45.30	47.06	41.97	46.45	49.69	43.59	44.29		
<b>New Hampshire</b>	51.51	40.32	37.37	37.38	39.41	41.72	37.28	47.67	39.83	44.94	46.25	47.59	52.25	39.10	36.46	40.42	51.69	37.49	40.57	44.79	46.65	41.69	45.92	49.13	43.23	43.96		
<b>Maine</b>	50.30	39.87	37.08	37.08	39.13	41.52	36.66	47.09	39.64	44.84	45.92	47.30	51.70	38.44	35.90	39.64	50.13	36.43	39.46	43.47	45.27	40.81	44.62	47.77	42.50	43.17		
<b>Mass Hub</b>	52.11	40.66	37.56	37.53	39.64	41.94	37.45	47.85	40.10	45.25	46.72	48.14	52.83	39.53	36.85	40.85	52.58	38.17	41.31	45.67	47.49	42.37	46.73	49.92	43.72	44.53		
<b>DA Forecast Load (GW)</b>	11.69	11.21	10.99	10.89	10.98	11.33	11.98	12.52	13.41	13.98	14.19	14.19	14.15	13.98	13.89	14.06	15.41	16.80	16.55	16.20	15.55	14.59	13.38	12.24				
<b>Forecast Error %</b>	2.3%	2.3%	3.3%	4.4%	4.1%	1.9%	0.3%	0.7%	0.3%	0.8%	1.1%	1.6%	1.5%	1.6%	1.3%	1.7%	1.9%	1.3%	2.5%	2.2%	2.6%	1.7%	0.9%	1.5%				

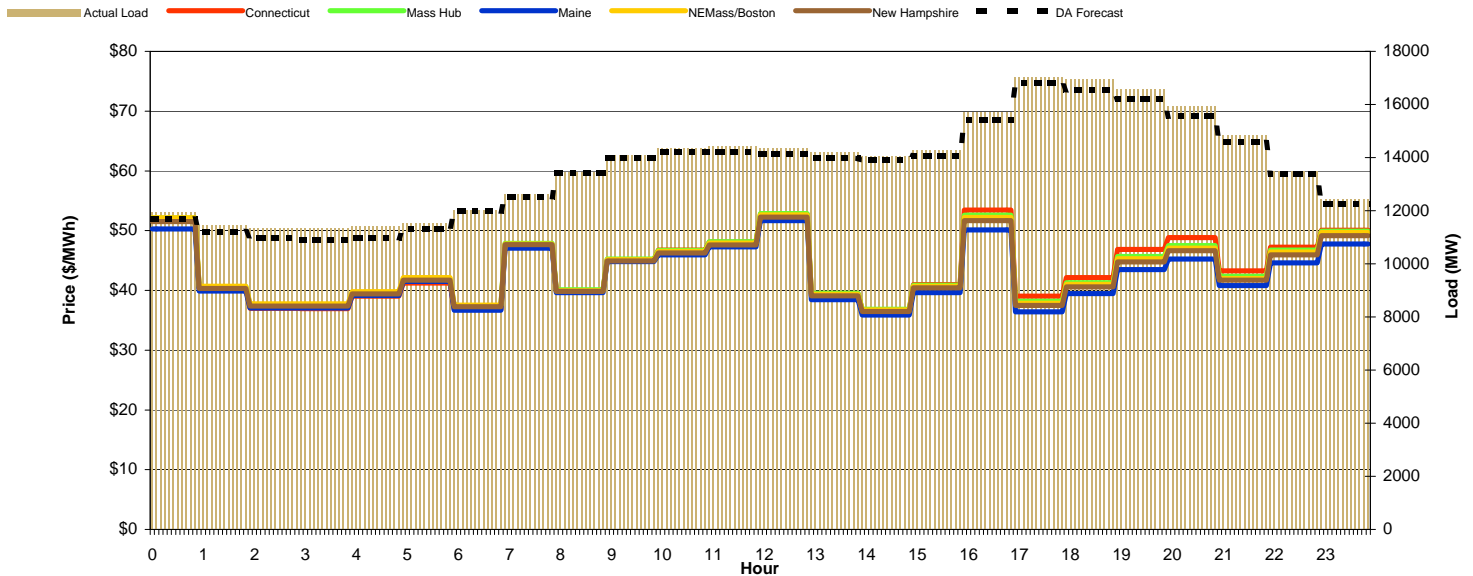




# ISO-NE Daily Report

Monday November 29, 2010

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	36.98	35.20	35.04	34.90	35.39	38.88	59.50	50.42	50.80	51.27	52.89	52.19	50.62	50.65	50.35	50.22	60.84	71.96	63.10	57.00	53.05	50.23	44.00	37.03	48.85	53.72	All	On Pk
<b>NEMass/Boston</b>	36.94	35.48	35.23	35.15	35.60	39.31	59.16	49.18	49.42	50.02	51.62	50.74	49.29	49.40	49.17	49.20	58.80	68.96	60.41	53.64	51.38	49.07	43.41	37.37	47.83	52.11	48.85	53.72
<b>New Hampshire</b>	36.58	35.25	35.02	34.88	35.38	38.99	58.62	49.01	49.28	49.65	51.14	50.33	49.06	49.11	48.84	48.84	58.69	68.59	60.00	53.22	51.21	49.10	43.27	37.12	47.55	51.83	47.55	51.83
<b>Maine</b>	35.63	34.89	34.68	34.00	34.73	38.25	57.71	47.90	48.00	48.40	49.83	49.26	47.89	47.89	47.61	47.44	57.08	66.72	58.67	51.93	49.93	48.38	42.27	36.43	46.48	50.58	46.48	50.58
<b>Mass Hub</b>	37.40	35.73	35.53	35.46	35.97	39.60	59.75	49.40	49.64	50.15	51.75	50.90	49.40	49.52	49.26	49.30	59.11	69.18	60.40	53.67	51.62	49.19	43.37	37.45	48.03	52.24	48.03	52.24
<b>Cleared Load (GW)</b>	10.9	11.1	10.9	10.8	11.0	11.6	13.2	14.4	14.6	14.7	14.7	14.6	14.3	14.2	14.0	14.2	15.4	16.3	15.9	15.6	14.8	13.6	12.3	11.3				

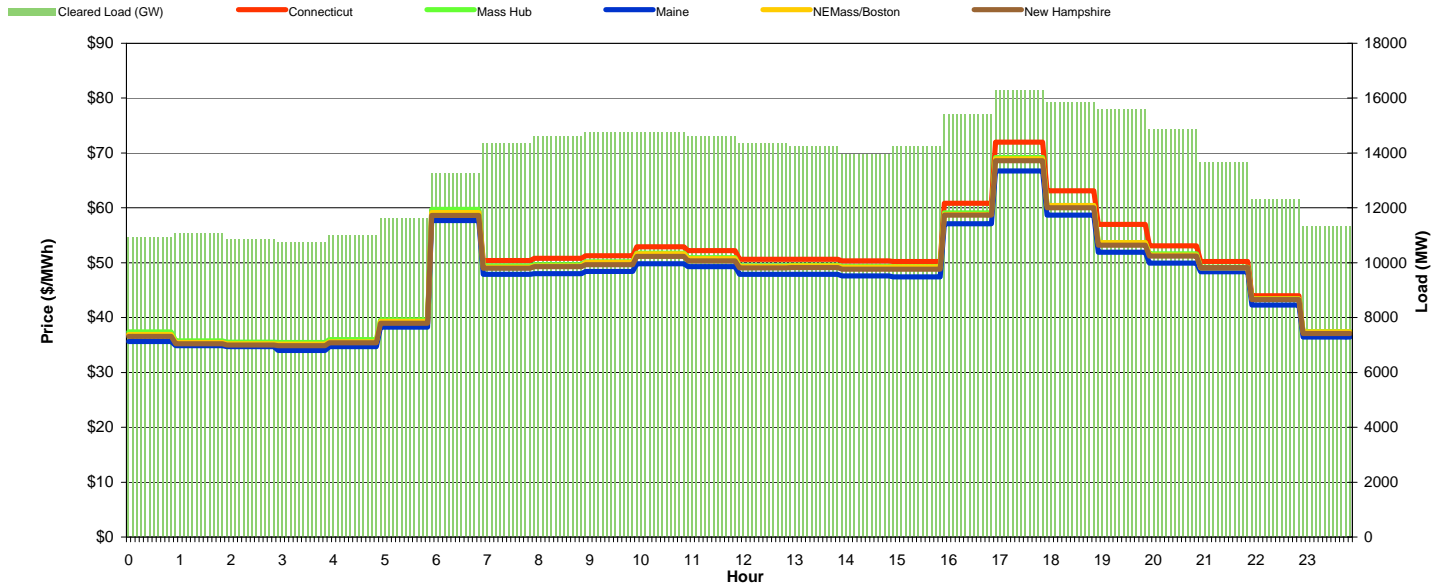

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	57.53	49.40	41.11	38.87	40.35	44.63	74.93	60.17	59.15	53.61	43.06	40.00	38.01	36.92	36.99	38.92	63.91	77.31	46.91	52.03	60.13	54.08	59.07	68.92	51.50	51.27	All	On Pk
<b>NEMass/Boston</b>	56.86	49.09	40.83	38.70	40.21	44.05	74.20	59.18	57.56	51.79	41.67	38.67	36.79	35.74	35.94	37.85	61.88	75.06	45.30	50.49	57.65	52.35	58.10	68.66	50.36	49.75	50.36	49.75
<b>New Hampshire</b>	56.14	48.42	40.28	38.21	39.74	43.63	73.40	58.62	56.99	51.36	41.30	38.35	36.45	35.36	35.45	37.30	60.95	73.85	44.38	49.54	56.56	51.37	56.89	67.32	49.66	49.05	49.66	49.05
<b>Maine</b>	54.09	46.71	38.92	37.32	38.88	42.63	72.43	57.61	55.75	50.18	40.34	37.58	35.75	34.79	34.82	36.51	59.58	71.99	42.70	48.12	54.69	49.89	55.73	65.95	48.46	47.88	48.46	47.88
<b>Mass Hub</b>	57.37	49.48	41.17	39.00	40.47	44.44	74.54	59.56	58.06	52.35	42.12	39.08	37.15	36.11	36.29	38.18	62.38	75.47	45.65	50.80	58.22	52.78	58.27	68.87	50.74	50.15	50.74	50.15
<b>DA Forecast Load (GW)</b>	11.59	11.19	11.05	11.09	11.51	12.71	14.86	16.03	16.27	16.32	16.28	16.15	15.96	15.84	15.70	15.84	17.04	18.40	18.08	17.63	16.84	15.67	14.12	12.70				
<b>Forecast Error %</b>	4.4%	9.2%	9.8%	9.8%	7.2%	3.3%	0.2%	0.2%	0.1%	-0.5%	-0.8%	-1.3%	-1.4%	-0.2%	-0.4%	-1.9%	-1.1%	-1.1%	0.6%	0.8%	1.6%	1.5%	1.5%	2.7%				

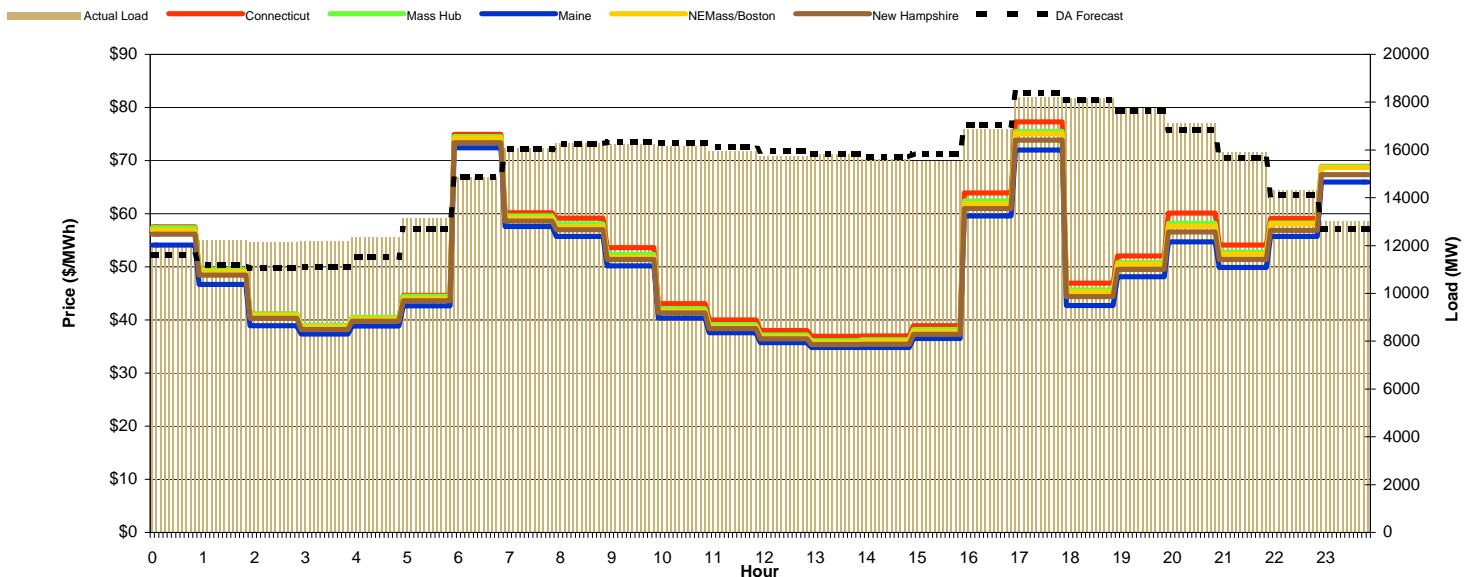




# ISO-NE Daily Report

Tuesday November 30, 2010

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%

## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$	
<b>Connecticut</b>	48.30	44.11	43.05	43.00	43.21	46.01	62.74	63.00	60.00	63.00	63.00	63.00	60.00	58.00	56.00	56.00	68.00	81.03	76.40	73.85	66.19	52.16	47.60	47.09	57.70	62.95
<b>NEMass/Boston</b>	47.31	43.39	42.41	42.56	42.88	45.61	61.16	49.29	51.69	49.62	49.40	49.39	49.38	49.38	49.25	49.26	50.67	54.84	50.67	49.61	49.59	49.40	45.88	46.58	48.72	49.83
<b>New Hampshire</b>	46.73	43.00	41.99	42.08	42.41	44.95	60.53	48.96	51.33	49.08	48.85	48.95	48.96	48.89	48.76	48.78	50.25	54.41	50.12	49.01	49.02	49.16	45.27	45.88	48.22	49.36
<b>Maine</b>	45.92	42.34	41.24	41.36	41.74	44.33	59.90	48.54	50.32	48.04	47.41	47.58	47.72	47.73	47.67	47.70	49.34	53.77	49.21	47.87	47.65	48.59	44.48	45.20	47.32	48.35
<b>Mass Hub</b>	47.81	43.85	42.92	42.98	43.20	45.86	61.89	49.74	52.13	49.90	49.61	49.65	49.53	49.51	49.31	49.18	51.04	55.05	51.00	49.92	49.94	49.58	45.79	46.63	49.00	50.06
<b>Cleared Load (GW)</b>	10.7	10.8	10.6	10.6	10.7	11.2	13.7	14.9	14.9	14.7	14.6	14.5	14.3	14.1	13.9	13.9	15.4	16.1	15.5	15.1	14.8	13.3	11.9	10.9		

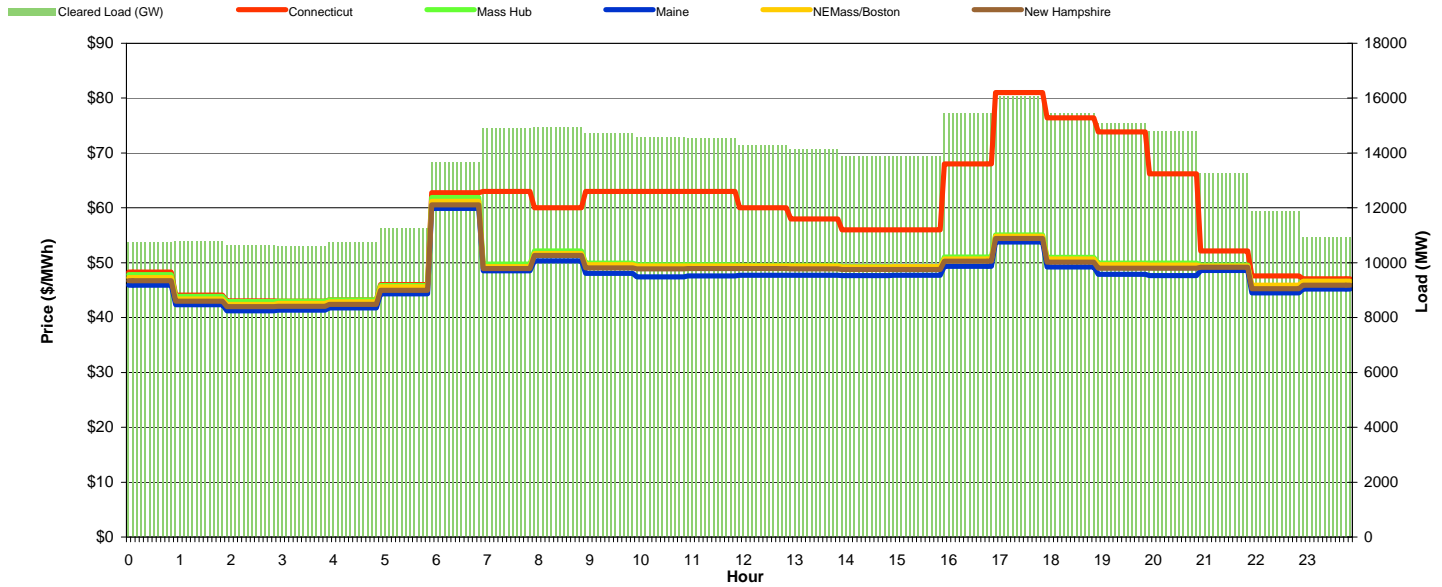

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$	
<b>Connecticut</b>	53.19	58.96	45.48	40.71	38.95	43.26	54.07	49.51	44.07	47.35	48.14	47.39	47.80	49.28	54.65	56.46	65.49	64.80	74.18	48.23	49.77	47.97	40.69	42.50	50.54	52.24
<b>NEMass/Boston</b>	52.82	58.11	45.05	40.41	38.65	42.49	52.89	47.22	42.30	45.40	46.02	45.28	45.66	47.11	52.21	53.92	60.05	56.80	50.75	45.99	47.35	45.77	39.51	42.32	47.67	48.21
<b>New Hampshire</b>	51.99	57.16	44.47	39.91	38.14	42.01	52.46	46.82	41.90	44.93	45.56	44.84	45.22	46.57	51.42	53.16	59.08	55.82	49.92	45.42	46.78	45.24	38.85	41.58	47.05	47.60
<b>Maine</b>	50.85	55.84	43.66	39.19	37.30	41.12	51.62	45.98	41.04	43.94	44.41	43.47	44.00	45.38	49.97	51.65	57.42	54.18	48.48	44.06	45.06	44.05	37.89	40.68	45.89	46.31
<b>Mass Hub</b>	53.15	58.82	45.64	40.92	39.11	43.09	53.45	47.83	42.85	46.03	46.55	45.70	46.10	47.58	52.90	54.68	60.78	57.29	50.62	46.48	47.97	46.40	39.85	42.34	48.17	48.73
<b>DA Forecast Load (GW)</b>	11.85	11.40	11.20	11.20	11.57	12.77	14.89	16.09	16.25	16.29	16.32	16.18	16.14	16.11	16.06	16.20	17.43	18.34	17.98	17.36	16.60	15.41	13.85	12.39		
<b>Forecast Error %</b>	3.2%	6.9%	9.4%	9.8%	6.9%	2.1%	-0.7%	-1.3%	-1.3%	-1.5%	-1.5%	-1.0%	-1.5%	-1.6%	-1.8%	-1.4%	-1.0%	-1.3%	-0.2%	0.8%	0.9%	0.8%	0.3%	-0.1%		

