




# ISO-NE Daily Report

Thursday September 01, 2011

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	37.98	30.34	27.99	27.60	27.79	32.42	34.95	36.27	34.66	38.69	41.16	40.38	44.93	46.13	45.51	46.46	46.77	43.88	39.06	41.57	39.26	37.69	34.05	33.81	37.89	41.03	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	37.13	29.84	27.77	27.45	27.58	31.96	34.73	35.84	33.83	37.33	39.69	38.85	43.11	44.29	43.81	44.52	45.00	42.16	37.64	40.10	37.84	36.57	33.29	33.16	36.81	39.62		
<b>New Hampshire</b>	36.95	29.77	27.66	27.35	27.50	31.96	34.71	35.69	33.68	37.20	39.48	38.77	42.98	44.16	43.67	44.35	44.78	42.01	37.54	40.02	37.68	36.49	33.37	33.24	36.71	39.49		
<b>Maine</b>	36.82	29.89	27.71	27.39	27.58	32.04	34.32	34.76	32.75	36.23	38.15	37.69	41.54	42.76	42.40	42.97	43.31	40.63	36.53	38.92	36.46	35.41	32.95	33.14	35.93	38.34		
<b>Mass Hub</b>	37.50	30.13	27.95	27.65	27.79	32.28	35.03	36.24	34.24	37.91	40.26	39.42	43.73	44.86	44.36	45.11	45.59	42.71	38.16	40.69	38.41	37.10	33.71	33.46	37.26	40.16		
<b>Cleared Load (GW)</b>	11.1	10.5	10.5	10.6	10.5	10.9	12.3	13.6	14.7	15.5	16.1	16.6	16.6	16.6	16.8	16.8	16.7	16.4	16.2	16.4	16.1	14.8	13.5	11.6				

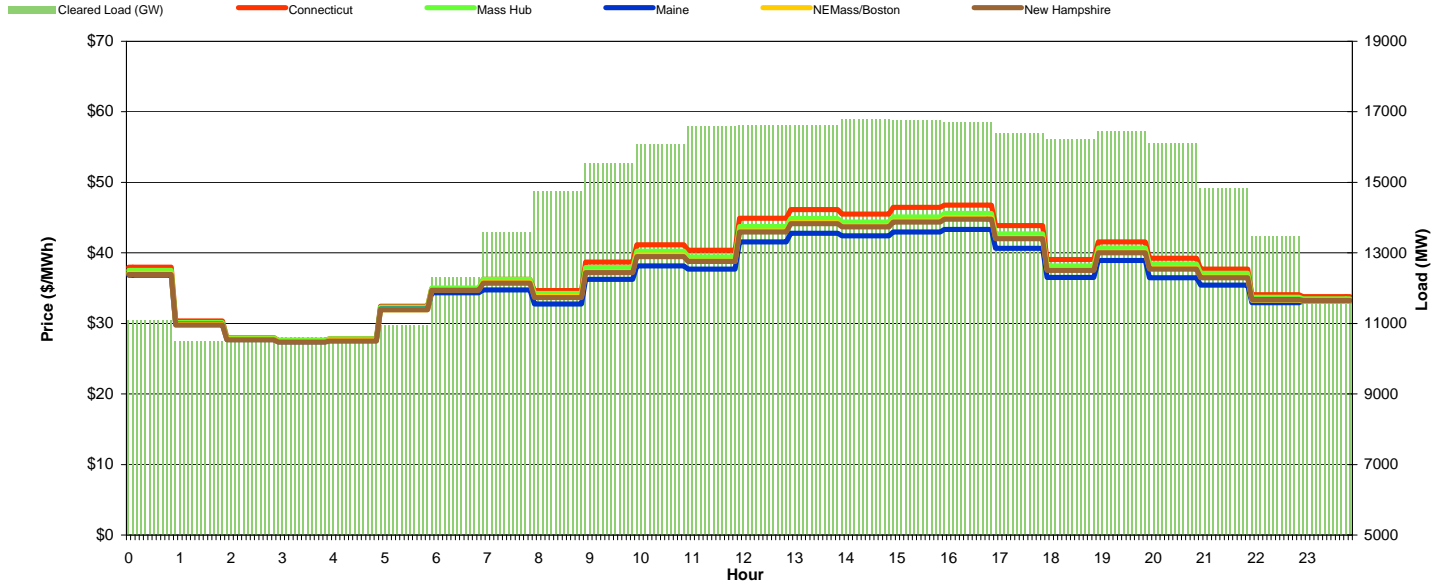

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	44.77	40.27	39.43	37.53	37.66	35.63	36.44	37.21	36.26	43.51	47.32	48.83	50.50	58.94	52.67	52.61	50.92	42.97	37.45	42.11	44.56	38.24	38.76	42.11	43.20	45.18	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	43.98	39.76	39.13	37.43	37.66	35.50	36.05	36.62	35.48	42.00	45.43	46.88	48.34	56.38	50.37	49.94	47.91	40.83	35.86	40.48	42.54	36.66	37.56	41.25	41.84	43.33		
<b>New Hampshire</b>	43.80	39.65	38.95	37.27	37.53	35.42	35.98	36.41	35.38	41.89	45.27	46.69	48.07	56.06	50.11	49.71	47.71	40.68	35.80	40.44	42.40	36.46	37.50	41.30	41.69	43.16		
<b>Maine</b>	43.80	39.80	39.02	37.33	37.68	35.24	35.33	35.25	34.42	40.48	43.22	44.46	45.65	53.38	47.97	47.60	45.49	38.63	34.22	38.82	40.50	34.83	36.44	41.01	40.44	41.34		
<b>Mass Hub</b>	44.47	40.17	39.44	37.68	37.90	35.76	36.41	37.02	35.85	42.52	46.05	47.50	49.01	57.10	50.98	50.59	48.57	41.49	36.37	41.02	43.18	37.19	38.04	41.69	42.33	43.91		
<b>DA Forecast Load (GW)</b>	11.93	11.29	10.88	10.73	10.87	11.68	13.08	14.45	15.38	16.12	16.71	17.05	17.20	17.38	17.39	17.31	17.25	17.04	16.64	16.65	16.61	15.65	14.21	12.79				
<b>Forecast Error %</b>	2.7%	4.4%	7.7%	9.9%	10.2%	3.5%	2.5%	1.7%	1.8%	2.4%	3.5%	4.5%	5.0%	5.6%	5.5%	4.7%	3.3%	2.4%	1.8%	2.1%	2.4%	2.3%	1.9%	1.4%				

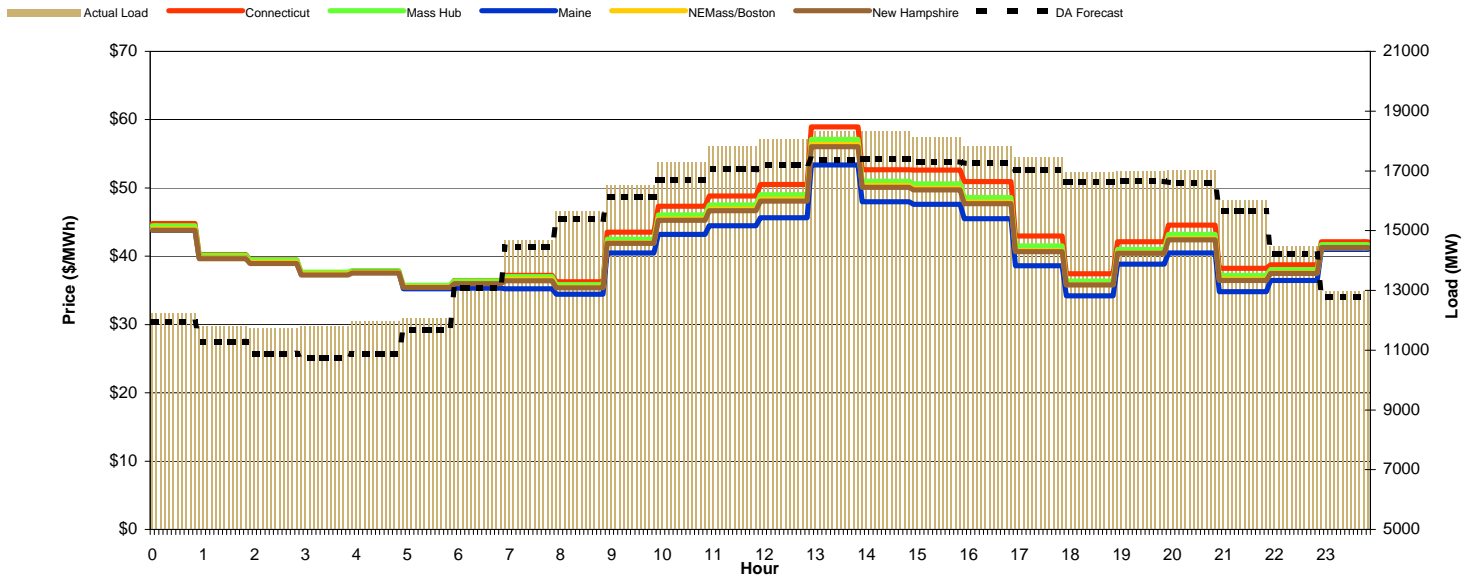




# ISO-NE Daily Report

Friday September 02, 2011

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	38.38	36.85	33.43	32.74	32.91	36.95	40.06	36.83	38.62	41.26	44.77	45.60	47.00	46.53	46.66	47.04	46.64	45.84	43.97	45.32	42.50	39.31	37.00	35.14	40.89	43.43	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	38.04	36.48	33.16	32.48	32.60	36.63	40.08	36.51	37.94	40.60	43.76	44.30	45.46	45.07	45.16	45.52	45.14	44.25	42.59	44.07	41.38	38.23	35.95	34.89	40.01	42.25		
<b>New Hampshire</b>	38.25	36.75	33.44	32.76	32.91	36.97	40.50	36.73	38.20	40.81	44.06	44.60	45.75	45.34	45.42	45.71	45.35	44.52	42.85	44.28	41.59	38.38	36.01	35.21	40.27	42.48		
<b>Maine</b>	37.99	36.39	33.27	32.61	32.75	36.67	40.34	35.67	37.04	39.42	42.21	42.62	43.71	43.46	43.49	43.83	43.61	42.67	41.16	42.47	40.06	37.00	34.72	35.01	39.09	40.82		
<b>Mass Hub</b>	38.40	36.94	33.57	32.87	33.01	37.03	40.44	38.05	39.72	41.10	44.29	44.66	46.06	45.61	45.71	46.71	45.82	44.91	43.04	44.60	42.54	38.85	36.55	35.16	40.65	43.01		
<b>Cleared Load (GW)</b>	10.8	10.7	10.4	10.1	10.3	10.8	11.7	13.5	14.4	15.0	15.4	15.6	15.9	16.0	16.0	16.1	16.0	15.5	15.1	15.3	15.1	14.2	13.1	11.5				

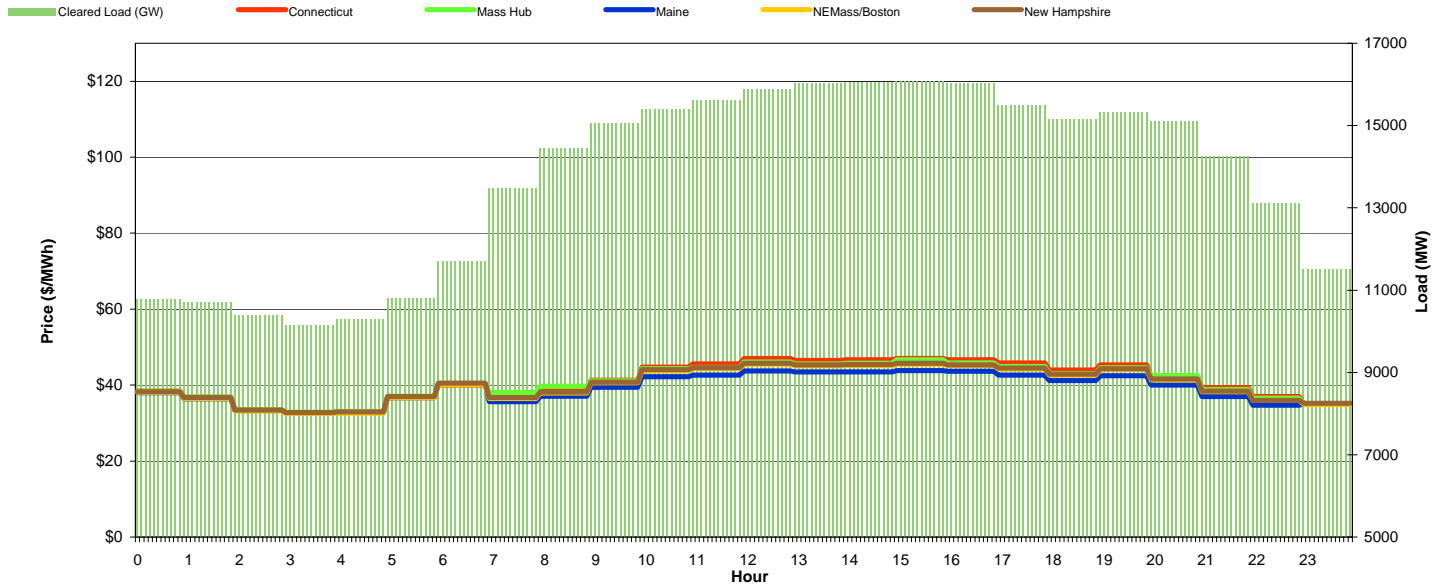

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	50.21	61.98	56.34	38.81	63.22	116.84	38.43	34.98	44.69	41.46	50.58	54.41	52.95	58.03	61.02	58.90	62.47	65.51	37.52	39.18	39.55	36.58	34.22	34.90	51.37	48.25	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	49.82	61.76	56.30	39.04	63.55	117.13	38.35	34.83	44.05	40.74	49.34	52.70	51.16	55.92	58.84	56.57	59.89	62.90	36.16	37.84	38.11	35.30	33.14	34.38	50.32	46.71		
<b>New Hampshire</b>	49.92	62.07	56.51	39.15	63.81	117.81	38.37	34.75	44.06	40.85	49.48	52.82	51.35	56.10	58.83	56.77	60.04	63.07	36.29	37.98	38.23	35.32	33.05	34.47	50.46	46.81		
<b>Maine</b>	49.59	61.49	56.16	38.96	63.63	117.06	37.61	33.57	42.49	39.30	47.09	49.94	48.85	53.46	55.93	53.96	56.82	59.69	34.44	36.10	36.14	33.50	31.39	33.65	48.78	44.54		
<b>Mass Hub</b>	50.28	62.34	56.72	39.26	63.88	118.00	38.61	35.03	44.35	41.04	49.76	53.22	51.69	56.48	59.23	57.17	60.57	63.64	36.56	38.24	38.57	35.75	33.54	34.67	50.78	47.18		
<b>DA Forecast Load (GW)</b>	11.93	11.25	10.88	10.71	10.83	11.60	12.99	14.09	14.83	15.43	15.96	16.24	16.36	16.48	16.52	16.40	16.27	16.05	15.64	15.89	15.61	14.77	13.56	12.26				
<b>Forecast Error %</b>	-0.1%	4.3%	7.2%	7.5%	9.6%	6.4%	0.1%	0.9%	2.9%	3.6%	4.2%	5.0%	5.4%	5.9%	6.1%	6.2%	6.3%	5.9%	5.0%	2.8%	4.4%	4.1%	4.0%	3.9%				

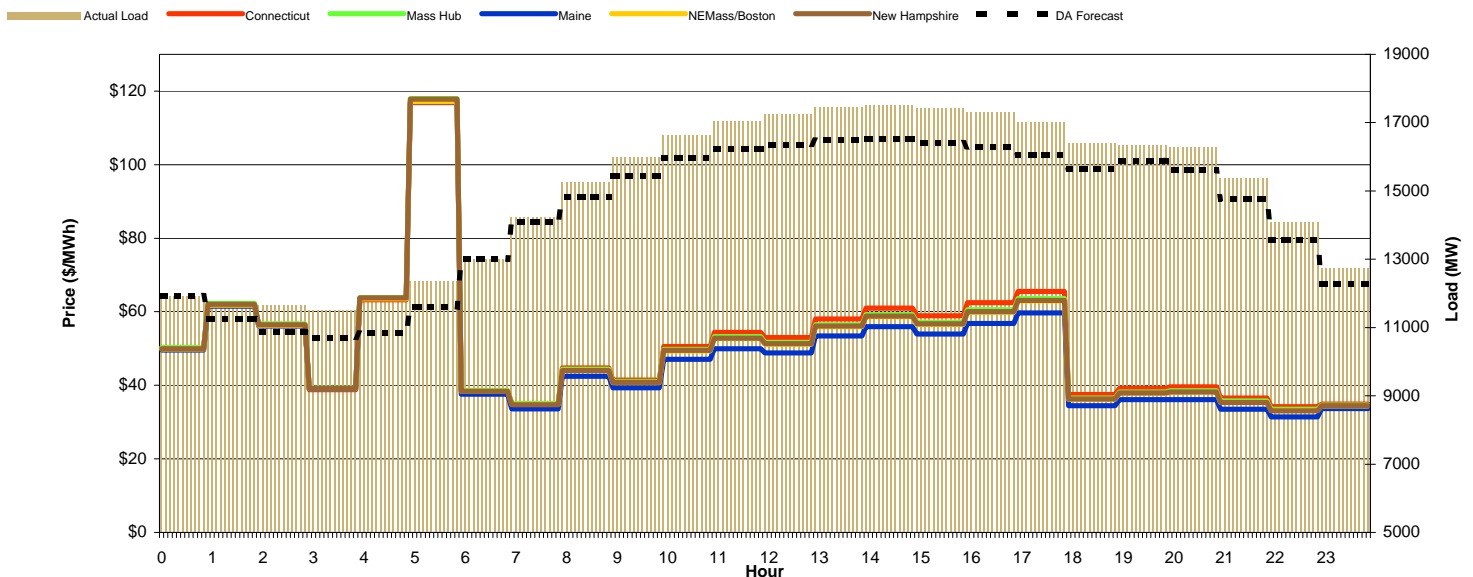




# ISO-NE Daily Report

Saturday September 03, 2011

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$	
<b>Connecticut</b>	39.91	36.85	36.53	33.78	32.71	35.93	37.97	36.51	35.51	37.06	38.88	38.85	43.28	44.10	47.47	48.79	53.81	48.75	46.74	48.87	47.05	39.11	37.56	37.96	41.00	43.27
<b>NEMass/Boston</b>	40.13	37.48	37.00	34.28	33.39	36.74	38.41	36.55	35.57	36.66	38.23	38.27	42.28	43.08	46.24	47.26	52.07	47.23	45.39	47.48	45.91	38.53	37.05	37.72	40.54	42.36
<b>New Hampshire</b>	40.40	37.61	37.18	34.46	33.65	36.94	38.69	36.68	35.66	36.67	38.13	38.21	42.25	43.05	46.14	47.09	51.96	47.19	45.49	47.51	45.96	38.76	37.04	37.80	40.61	42.36
<b>Maine</b>	40.15	37.31	36.80	34.30	33.49	36.62	38.55	35.80	34.77	35.68	37.05	37.15	41.03	41.83	44.67	45.31	49.97	45.41	44.19	45.79	44.53	37.86	35.83	37.09	39.63	41.05
<b>Mass Hub</b>	40.53	37.77	37.34	34.55	33.75	37.09	38.65	36.82	35.77	37.05	40.10	38.59	44.00	45.00	46.80	49.16	53.75	48.86	45.98	48.90	47.34	40.03	37.38	38.15	41.39	43.47
<b>Cleared Load (GW)</b>	11.5	11.2	11.2	11.1	10.9	11.2	11.2	11.7	13.1	14.3	15.1	15.5	15.9	16.0	16.1	16.1	16.0	16.1	15.9	16.1	16.0	15.4	14.2	13.0		

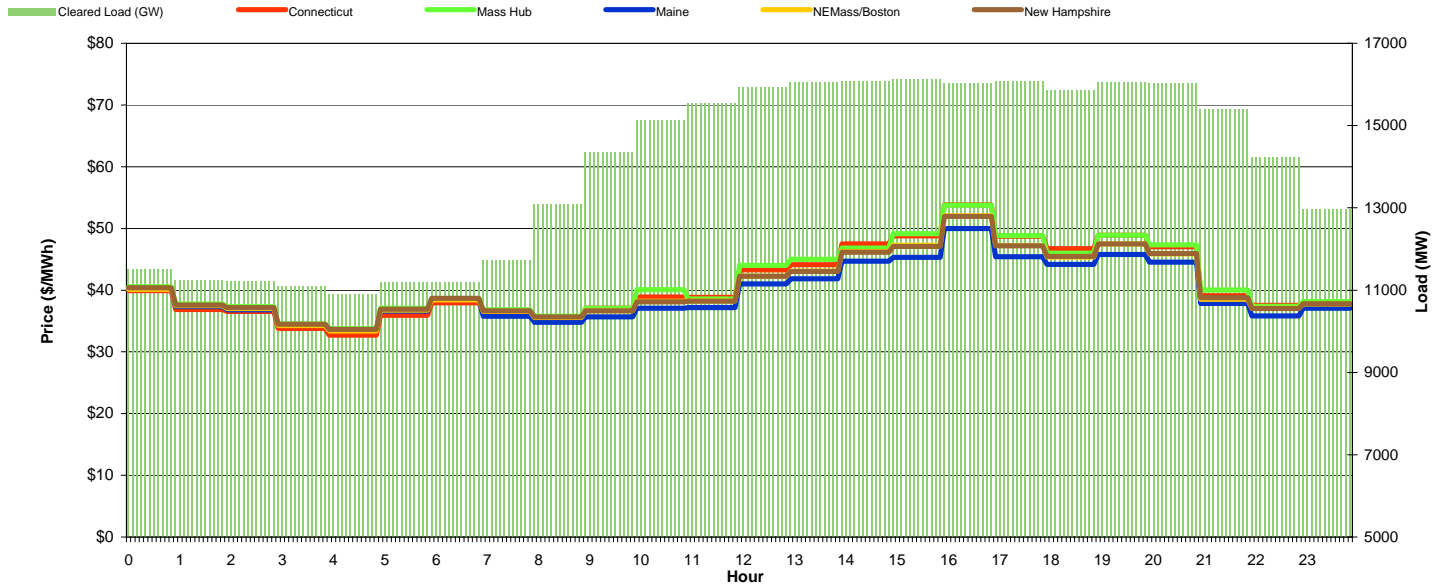

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$	
<b>Connecticut</b>	38.36	32.07	31.24	32.35	32.62	32.78	32.95	31.67	31.36	32.63	33.96	35.25	43.30	48.06	61.55	64.88	72.20	69.60	57.91	71.98	67.35	57.01	47.38	53.53	46.33	51.63
<b>NEMass/Boston</b>	38.38	32.31	31.49	32.67	33.16	33.10	32.95	31.50	31.14	32.15	33.14	34.45	41.97	46.55	59.44	62.25	69.26	66.75	55.35	67.00	65.01	54.99	45.64	51.77	45.10	49.79
<b>New Hampshire</b>	38.49	32.39	31.58	32.73	33.28	33.21	32.96	31.50	31.12	32.24	33.17	34.49	42.02	46.57	59.38	62.15	69.11	66.62	55.33	67.07	65.06	55.23	45.75	51.82	45.14	49.80
<b>Maine</b>	37.97	31.96	31.14	32.19	32.88	32.61	31.79	30.32	30.07	31.32	32.14	33.45	40.48	44.72	56.61	58.91	65.40	62.62	52.18	63.69	61.53	52.43	43.37	49.56	43.31	47.45
<b>Mass Hub</b>	38.51	32.39	31.58	32.79	33.29	33.25	33.13	31.61	31.21	32.30	33.37	34.65	42.30	46.87	59.88	62.78	69.80	67.26	55.77	67.22	65.48	55.43	46.06	52.20	45.38	50.12
<b>DA Forecast Load (GW)</b>	11.45	10.81	10.51	10.37	10.38	10.68	11.28	12.33	13.55	14.65	15.30	15.67	15.76	15.84	15.86	15.82	15.83	16.00	15.88	16.73	16.24	15.49	14.44	13.25		
<b>Forecast Error %</b>	4.0%	7.3%	9.2%	11.6%	11.4%	10.4%	6.1%	0.6%	-2.0%	-2.4%	-1.5%	-0.2%	2.4%	4.5%	6.8%	9.3%	10.9%	10.3%	9.8%	5.4%	8.7%	8.5%	8.3%	7.7%		

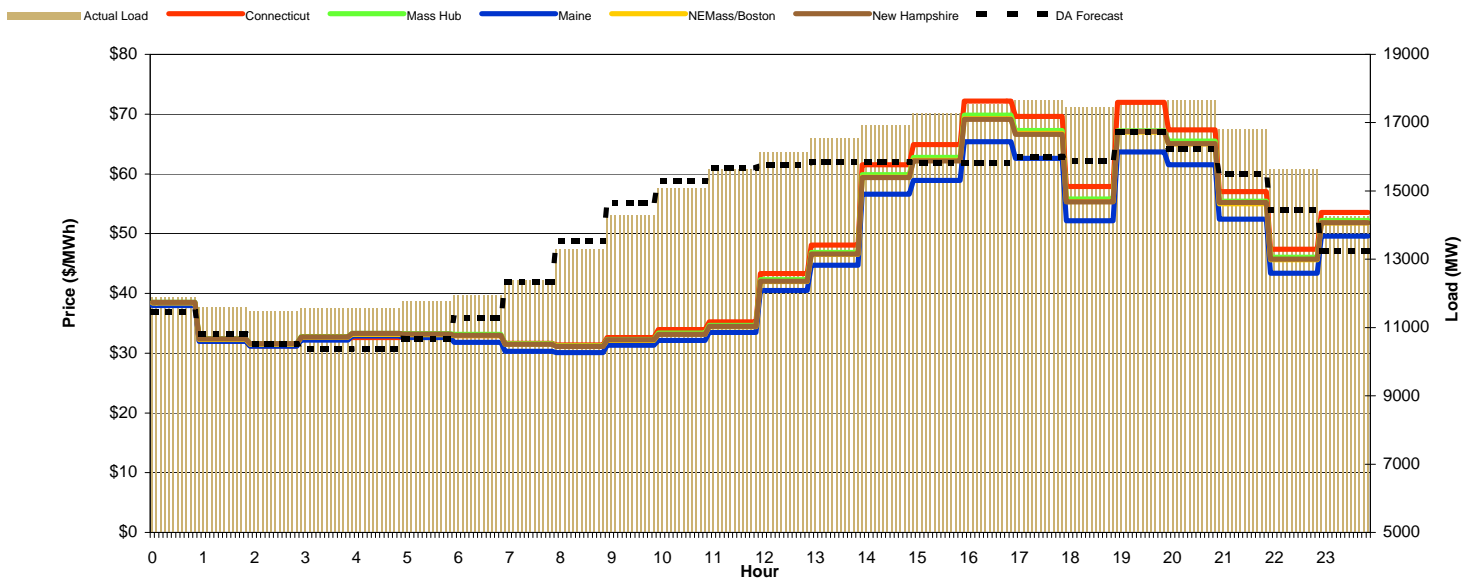




# ISO-NE Daily Report

Sunday September 04, 2011

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	39.33	36.37	34.09	33.53	32.68	33.40	33.53	35.17	37.78	40.13	44.70	51.07	55.70	56.34	58.54	60.17	61.50	59.48	71.59	65.14	59.54	46.35	40.50	38.75	46.89	52.73	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	38.49	35.72	33.49	33.00	32.33	33.16	33.10	34.39	36.71	38.76	43.05	48.88	53.35	53.43	56.05	57.52	58.72	56.86	53.56	56.17	56.94	44.46	38.98	37.99	44.38	49.24		
<b>New Hampshire</b>	38.48	35.60	33.43	32.92	32.23	33.02	33.14	34.24	36.70	38.96	43.27	49.10	53.50	53.41	56.00	57.46	58.65	56.88	53.39	56.12	57.01	44.73	39.05	38.09	44.39	49.28		
<b>Maine</b>	37.71	34.80	32.74	32.22	31.58	32.36	32.73	32.94	35.49	37.84	41.65	46.96	51.00	51.23	53.55	55.00	56.11	54.56	51.31	54.11	54.79	43.09	37.56	37.18	42.85	47.32		
<b>Mass Hub</b>	38.96	36.17	33.95	33.45	32.72	33.51	33.53	34.81	37.22	39.26	43.63	49.59	54.10	54.07	56.77	58.30	59.54	57.57	52.61	56.16	57.74	45.07	39.49	38.34	44.86	49.75		
<b>Cleared Load (GW)</b>	12.4	11.6	11.5	11.1	11.1	11.3	11.5	11.8	13.2	14.4	15.2	15.8	16.1	16.4	16.5	16.5	16.7	16.7	16.5	16.6	16.3	15.5	14.6	13.3				

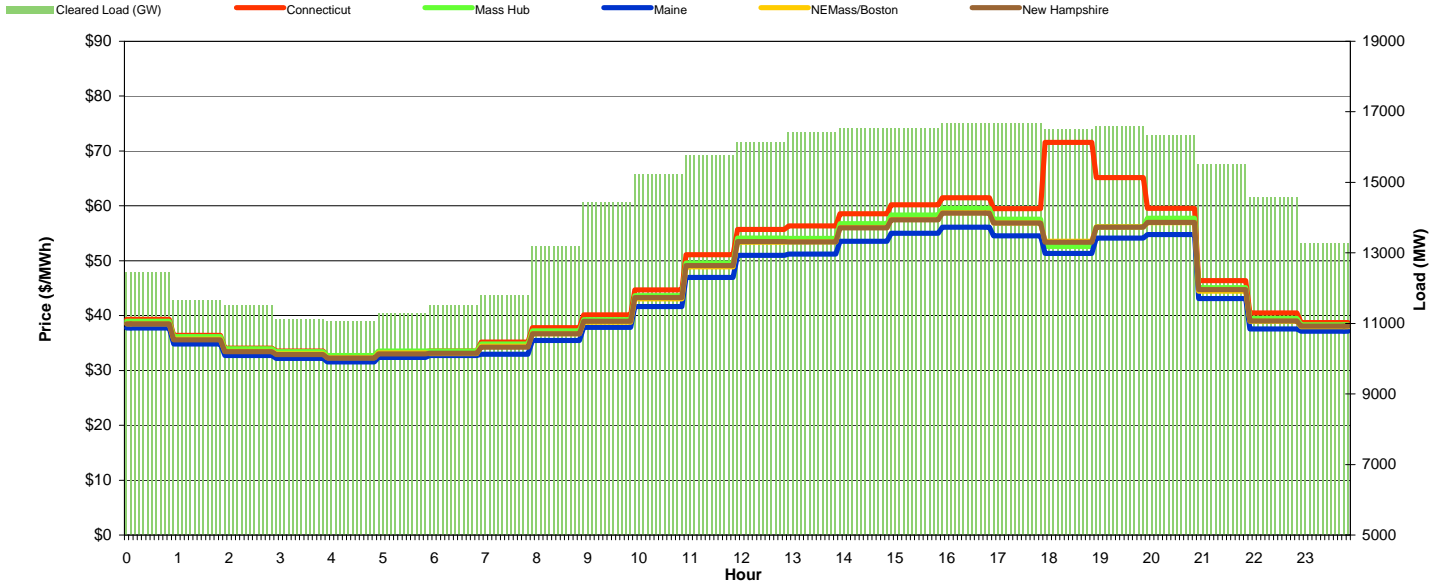

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	56.10	53.45	50.33	46.96	36.46	42.77	39.82	34.77	34.92	36.92	44.45	72.39	73.94	66.08	76.41	78.83	67.22	45.51	50.33	65.04	59.89	42.48	36.76	39.87	52.15	55.37	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	54.74	52.68	49.78	46.50	36.11	42.33	39.32	34.16	33.96	35.71	42.73	69.22	70.96	62.98	69.60	75.77	64.73	43.90	48.45	62.54	57.35	40.72	35.23	38.93	50.35	53.00		
<b>New Hampshire</b>	54.73	52.50	49.57	46.33	35.98	42.19	39.19	34.09	34.03	36.00	43.08	69.62	71.21	63.04	69.64	75.79	64.81	44.00	48.67	62.95	57.67	40.96	35.34	39.01	50.43	53.18		
<b>Maine</b>	53.30	51.11	48.17	45.14	35.08	41.01	37.93	32.55	32.63	34.57	40.97	65.36	66.68	57.12	62.21	67.59	58.75	41.52	46.32	60.23	54.96	38.93	33.53	37.70	47.64	49.62		
<b>Mass Hub</b>	55.16	52.93	50.06	46.80	36.36	42.65	39.59	34.43	34.23	35.97	43.09	69.83	71.35	63.33	70.01	76.12	65.08	44.14	48.73	62.85	57.72	40.99	35.50	39.10	50.67	53.34		
<b>DA Forecast Load (GW)</b>	12.50	11.77	11.32	11.04	10.87	11.14	11.49	12.32	13.60	14.94	15.85	16.53	16.92	17.21	17.31	17.38	17.60	17.72	17.63	18.30	17.65	16.58	15.10	13.70				
<b>Forecast Error %</b>	5.1%	5.2%	9.1%	11.0%	12.9%	11.2%	7.4%	7.1%	2.8%	0.3%	0.8%	2.3%	3.9%	4.3%	5.1%	5.7%	5.0%	3.6%	2.3%	-0.8%	1.6%	2.9%	5.6%	8.0%				

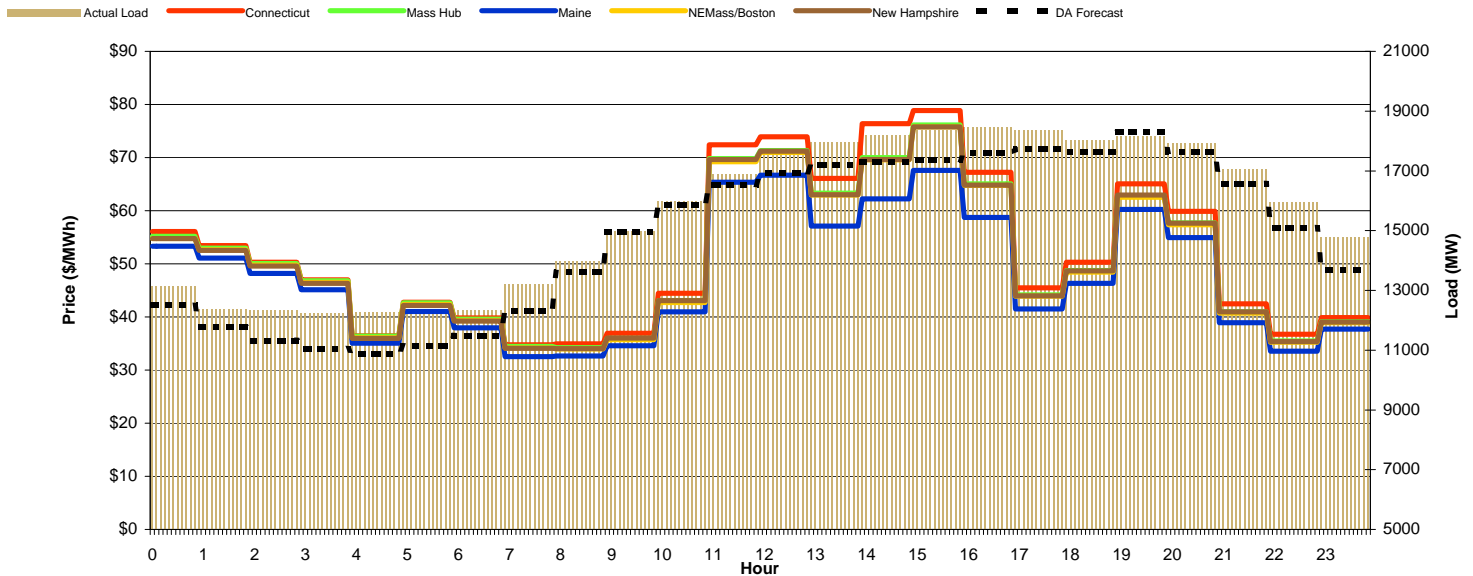




# ISO-NE Daily Report

Monday September 05, 2011

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$	
<b>Connecticut</b>	39.34	37.25	39.46	38.92	36.84	38.68	37.33	37.36	42.23	41.04	42.52	47.53	49.42	51.49	51.22	53.84	55.57	53.74	47.45	56.48	46.65	42.90	39.62	39.00	44.41	47.44
<b>NEMass/Boston</b>	38.90	37.05	39.33	38.86	36.76	38.55	37.21	36.91	41.23	39.86	41.00	45.57	47.45	49.39	49.00	51.59	51.96	50.80	45.72	54.45	45.08	41.39	38.39	38.68	43.13	45.61
<b>New Hampshire</b>	38.84	36.90	39.10	38.66	36.56	38.39	37.15	36.57	41.08	40.03	41.25	45.73	47.53	49.35	48.77	51.28	51.60	50.53	45.61	54.20	45.00	41.48	38.32	38.66	43.02	45.52
<b>Maine</b>	38.15	36.14	38.10	37.60	35.62	37.40	36.59	35.12	39.61	38.77	39.90	43.66	45.41	46.86	46.39	48.70	49.00	48.00	43.70	51.39	43.04	40.00	37.03	38.27	41.44	43.54
<b>Mass Hub</b>	39.14	37.22	39.58	39.13	36.99	38.79	37.37	36.98	41.35	40.14	41.35	46.07	47.93	49.93	49.58	52.20	52.50	51.42	46.30	55.31	45.58	41.85	38.79	38.81	43.51	46.08
<b>Cleared Load (GW)</b>	12.5	12.0	11.8	11.6	11.5	11.7	11.7	12.1	13.1	14.6	15.4	15.8	16.0	16.1	16.3	16.3	16.4	16.4	16.4	16.7	16.3	15.1	13.9	12.6		

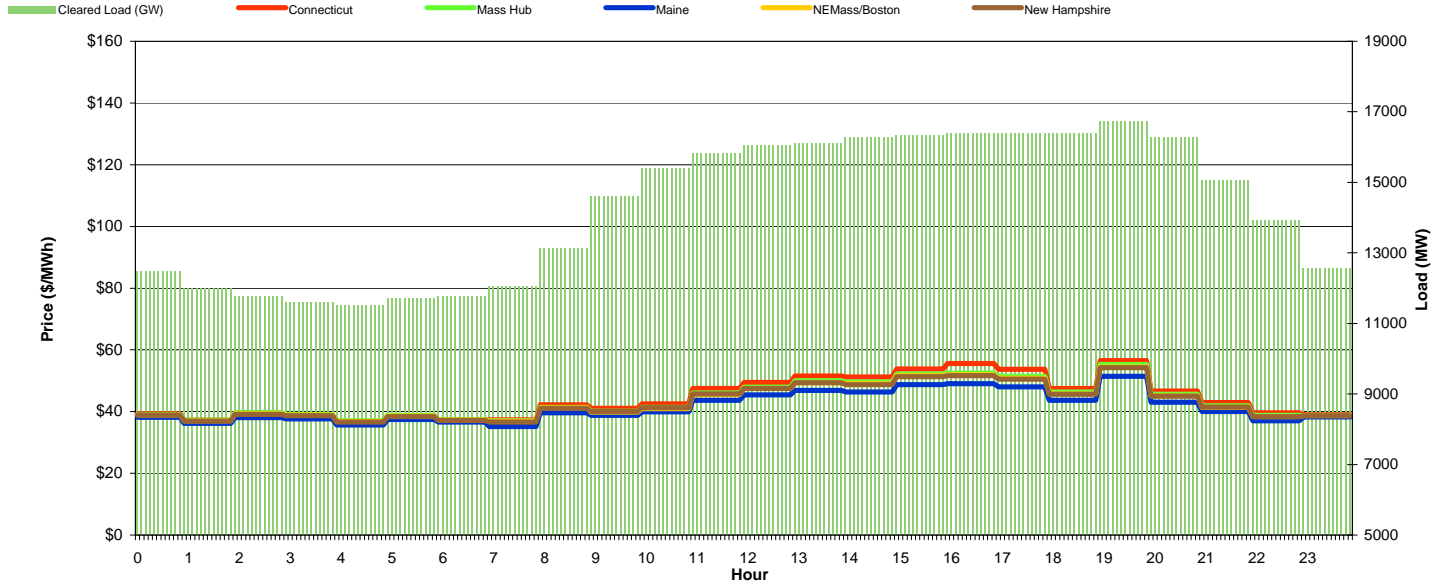

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$	
<b>Connecticut</b>	48.09	39.96	62.31	38.25	36.13	35.25	35.08	35.98	38.31	56.81	68.80	73.81	73.43	77.32	73.78	59.92	58.86	51.94	51.98	147.16	88.45	35.94	37.86	35.49	56.70	64.40
<b>NEMass/Boston</b>	47.35	39.43	61.69	37.84	35.87	34.90	34.81	35.55	37.42	55.09	66.61	71.59	71.63	75.58	72.06	58.45	57.48	50.68	50.68	143.92	86.59	35.20	37.07	35.12	55.53	62.85
<b>New Hampshire</b>	47.29	39.25	61.48	37.69	35.74	34.74	34.57	35.29	37.29	55.23	66.72	71.60	71.47	75.29	71.54	58.11	57.23	50.54	50.52	143.43	86.21	34.97	36.77	34.93	55.33	62.64
<b>Maine</b>	45.99	37.79	59.56	36.32	34.72	33.33	33.13	33.65	35.62	52.65	63.08	67.22	63.85	66.91	64.14	54.41	54.04	47.64	47.31	134.73	81.25	32.97	35.00	33.75	52.04	58.40
<b>Mass Hub</b>	47.37	39.44	61.84	37.99	35.96	35.03	34.84	35.55	37.51	55.34	66.88	71.79	71.62	75.50	72.03	58.52	57.60	50.81	50.80	144.25	86.78	35.25	37.18	35.20	55.63	62.96
<b>DA Forecast Load (GW)</b>	12.85	12.10	11.70	11.45	11.38	11.59	11.91	12.64	13.74	15.01	15.94	16.47	16.79	16.89	16.89	16.92	17.12	17.04	17.08	17.52	17.28	16.15	14.75	13.35		
<b>Forecast Error %</b>	4.5%	7.0%	10.5%	13.3%	13.7%	13.7%	10.2%	7.0%	6.3%	7.0%	8.4%	10.5%	12.1%	12.9%	12.8%	12.2%	10.6%	11.1%	9.9%	8.9%	9.4%	9.6%	9.1%	10.5%		

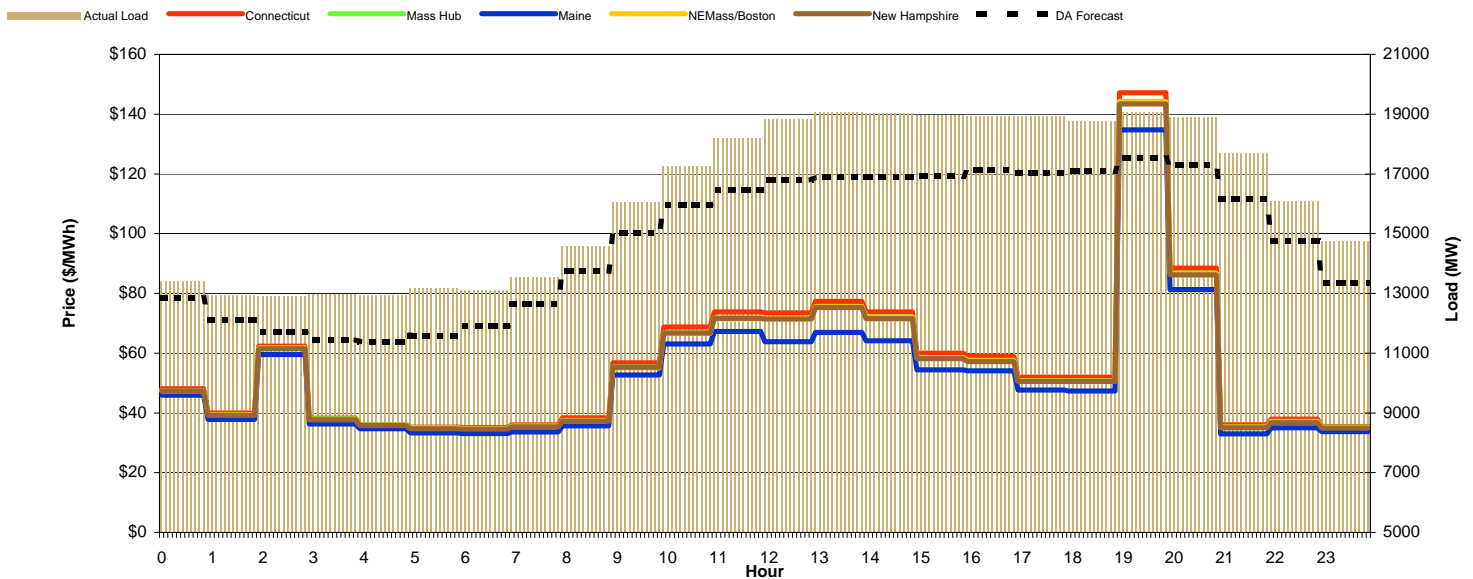




# ISO-NE Daily Report

Tuesday September 06, 2011

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	37.15	36.45	33.27	32.36	33.26	37.31	37.16	39.96	40.96	42.65	47.57	50.40	49.14	51.61	50.69	49.64	51.17	50.02	46.20	51.46	44.00	39.91	38.51	35.29	42.76	46.49	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	36.68	35.82	32.80	31.95	32.74	36.71	36.93	39.00	40.00	41.43	46.00	48.70	47.49	49.88	49.06	48.00	49.51	48.21	44.69	49.72	42.47	38.71	37.37	34.69	41.61	45.02		
<b>New Hampshire</b>	36.82	36.03	32.98	32.15	32.95	37.03	37.23	39.35	40.30	41.70	46.19	48.85	47.63	50.00	49.18	48.13	49.67	48.40	44.85	49.86	42.64	38.93	37.84	35.07	41.82	45.22		
<b>Maine</b>	36.37	35.34	32.49	31.80	32.42	36.44	36.72	38.23	39.18	40.58	44.33	47.00	46.00	48.17	47.55	46.55	48.00	46.70	43.15	47.57	41.06	37.42	37.32	34.82	40.63	43.68		
<b>Mass Hub</b>	37.08	36.41	33.32	32.43	33.27	37.26	37.34	39.52	40.53	42.01	46.70	49.38	48.03	50.45	49.66	48.57	50.13	48.86	45.33	50.54	43.13	39.25	37.90	35.09	42.17	45.62		
<b>Cleared Load (GW)</b>	12.3	12.7	12.4	12.2	12.4	12.6	13.3	14.6	15.1	15.7	16.0	16.1	16.2	16.2	16.2	16.1	16.2	15.9	16.1	16.2	15.9	14.9	13.3	12.3				

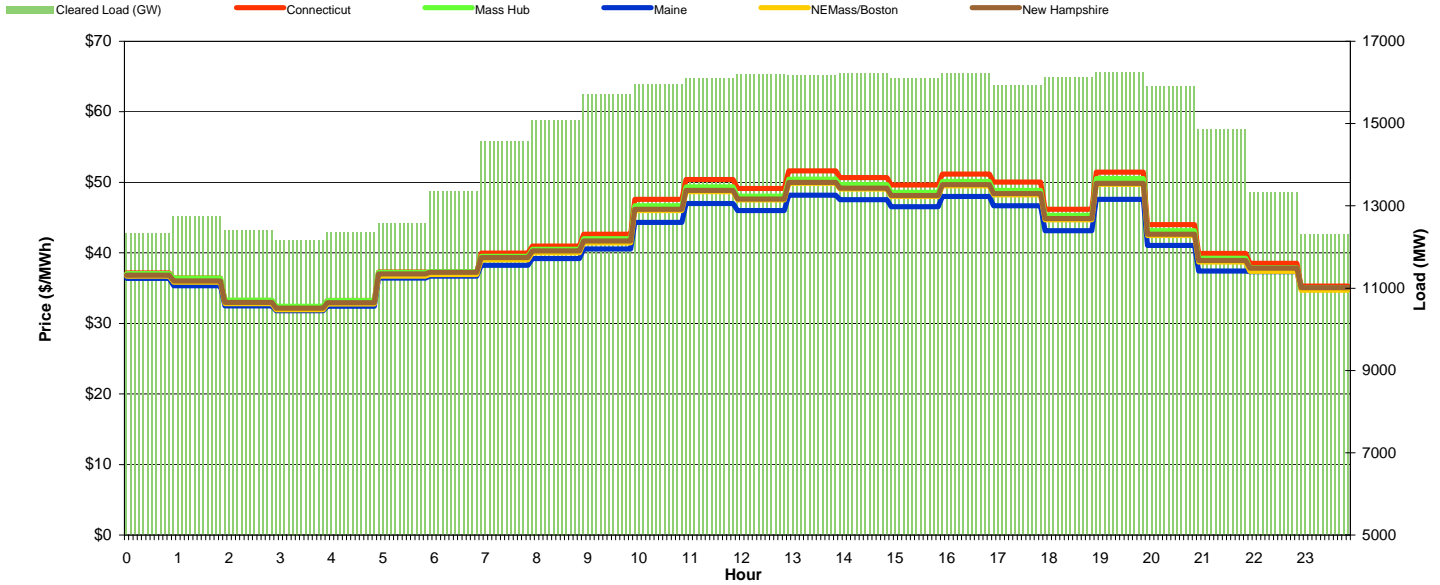

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	57.33	50.97	35.92	33.16	35.62	38.77	36.00	37.11	35.10	40.45	40.71	47.52	42.21	37.55	36.28	35.36	42.17	46.32	34.58	40.95	36.38	33.07	29.05	29.81	38.85	38.43	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	56.72	50.32	35.43	32.80	35.19	38.14	35.40	36.22	34.16	39.22	39.41	45.82	40.64	36.29	35.25	34.29	40.83	44.56	33.52	39.74	35.13	32.10	28.19	29.22	37.86	37.21		
<b>New Hampshire</b>	56.58	50.28	35.43	32.80	35.23	38.25	35.54	36.37	34.12	39.19	39.40	45.86	40.70	36.35	35.28	34.35	40.86	44.63	33.60	39.85	35.19	32.02	27.94	29.08	37.87	37.23		
<b>Maine</b>	55.11	49.07	34.65	32.13	34.40	37.08	34.31	35.24	32.98	37.93	38.04	44.10	39.08	34.85	33.86	33.03	39.10	42.51	32.30	38.22	33.57	30.56	26.46	27.91	36.52	35.74		
<b>Mass Hub</b>	57.00	50.79	35.81	33.13	35.58	38.58	35.63	36.43	34.36	39.48	39.68	46.25	41.08	36.64	35.52	34.55	41.22	45.10	33.82	40.09	35.49	32.37	28.43	29.48	38.19	37.53		
<b>DA Forecast Load (GW)</b>	12.44	11.88	11.58	11.40	11.54	12.29	13.57	14.84	15.70	16.28	16.72	16.93	16.95	16.96	16.82	16.72	16.76	16.60	16.40	16.71	16.42	15.31	13.89	12.51				
<b>Forecast Error %</b>	11.3%	16.4%	18.7%	17.6%	16.1%	11.0%	6.8%	3.2%	1.3%	0.5%	0.0%	-0.2%	-0.4%	-0.4%	-0.5%	-1.1%	-1.4%	0.2%	1.7%	1.2%	0.2%	0.1%	-0.6%	2.5%				

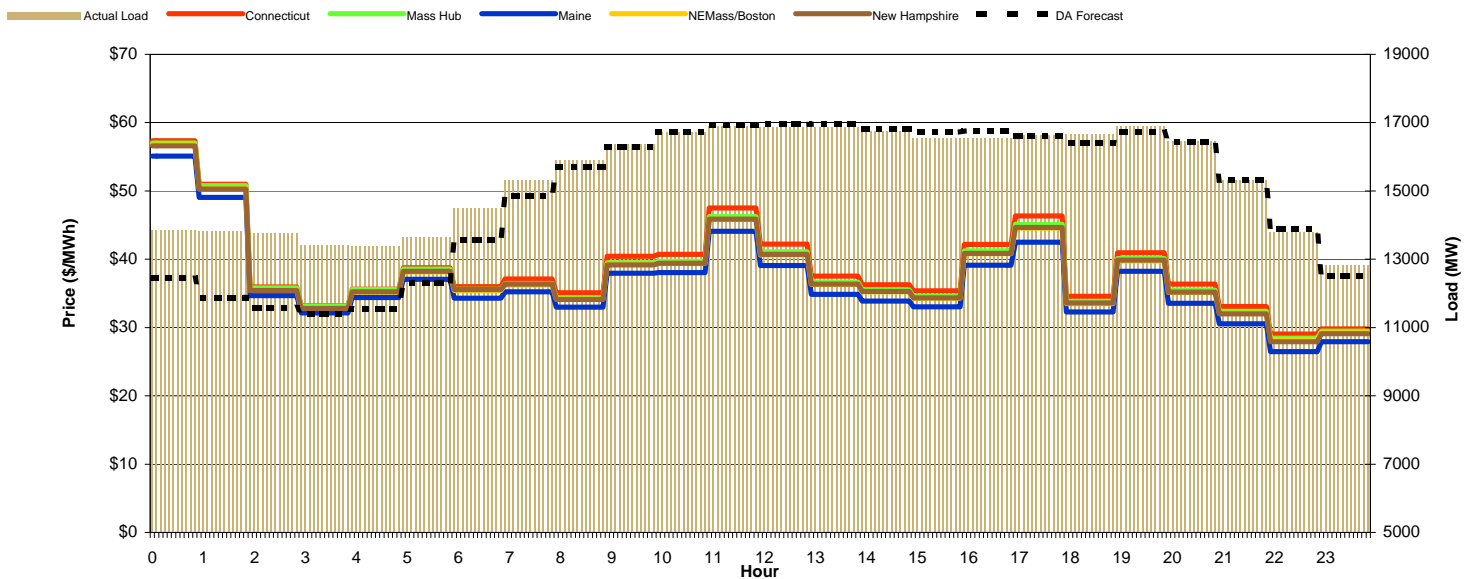




# ISO-NE Daily Report

Wednesday September 07, 2011

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	35.39	32.87	31.55	31.37	31.49	33.65	38.00	38.92	38.20	39.57	41.02	42.34	42.00	42.47	39.70	39.78	40.18	41.55	41.34	48.89	41.65	38.82	37.65	34.15	38.44	40.88	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	34.76	32.46	31.24	31.09	31.17	33.20	37.48	37.85	36.71	37.76	39.06	40.15	39.81	40.15	37.82	37.86	38.16	39.33	39.10	46.23	39.38	37.13	36.48	33.50	37.00	38.94		
<b>New Hampshire</b>	34.88	32.49	31.27	31.09	31.25	33.39	37.99	38.17	36.81	37.77	39.12	40.09	39.73	40.04	37.74	37.78	38.13	39.27	39.07	46.08	39.34	37.28	36.72	33.60	37.05	38.95		
<b>Maine</b>	33.74	31.40	30.31	30.14	30.35	32.30	37.03	36.58	35.52	36.46	37.77	38.67	38.31	38.58	36.21	36.32	36.69	37.67	37.52	43.69	37.83	35.77	35.33	32.44	35.69	37.43		
<b>Mass Hub</b>	35.19	32.82	31.55	31.37	31.49	33.55	37.90	38.36	37.28	38.43	39.77	40.93	40.55	40.88	38.41	38.46	38.83	40.07	39.87	47.22	40.22	37.75	36.96	33.83	37.57	39.62		
<b>Cleared Load (GW)</b>	11.5	11.0	10.6	10.4	10.6	11.2	12.6	14.0	14.7	15.3	15.8	16.0	16.0	15.9	15.8	15.8	15.9	15.8	15.7	16.1	15.8	14.3	13.1	11.8				

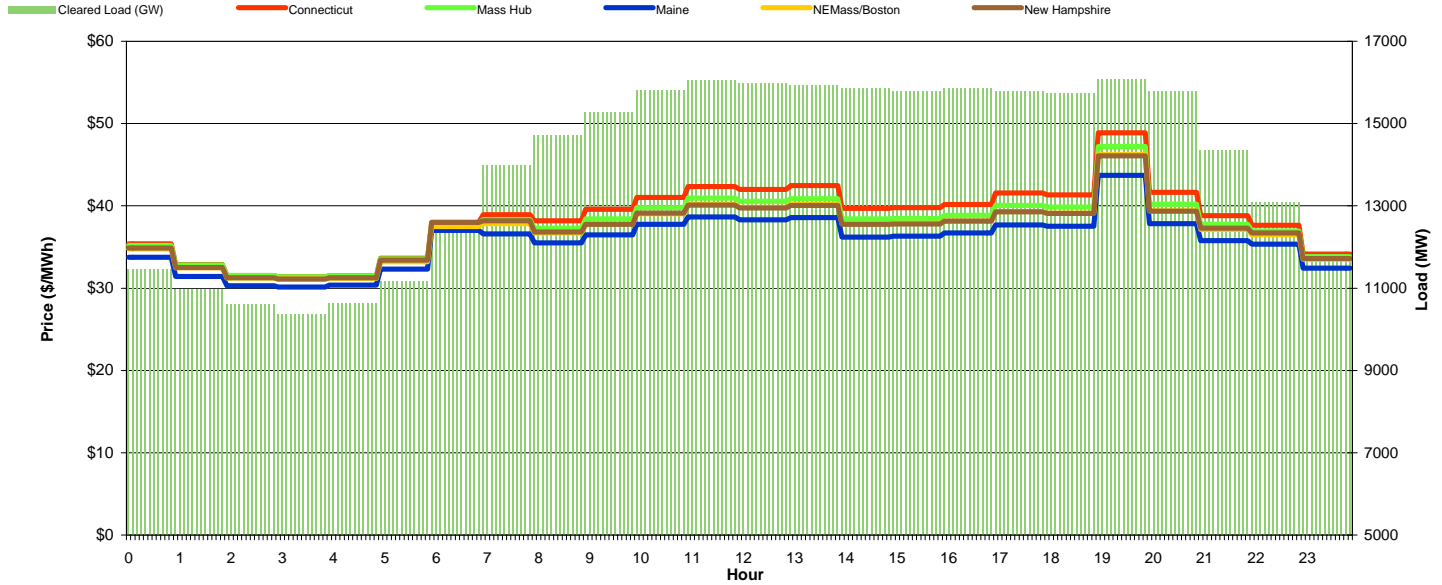

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$				
<b>Connecticut</b>	31.54	30.98	28.39	26.50	26.07	30.83	40.46	39.62	35.00	34.71	35.46	36.79	37.46	38.44	35.84	35.03	35.27	39.31	38.05	43.27	37.32	33.06	30.05	29.60	34.54	36.54	<b>All</b>	<b>On Pk</b>	
<b>NEMass/Boston</b>	31.17	30.59	28.05	26.21	25.83	30.50	39.83	38.36	33.74	33.30	33.96	35.06	35.62	36.55	34.09	33.46	33.68	37.41	36.15	40.94	35.26	31.59	29.05	29.02	33.31	34.89			
<b>New Hampshire</b>	31.02	30.39	27.88	26.06	25.70	30.36	39.92	38.38	33.75	33.22	33.87	34.94	35.48	36.41	33.90	33.28	33.53	37.34	36.08	40.84	35.14	31.35	28.77	28.72	33.18	34.77			
<b>Maine</b>	29.73	29.09	26.76	25.04	24.79	29.19	38.59	36.84	32.54	32.01	32.70	33.51	33.94	34.79	32.33	32.03	32.33	36.00	34.67	39.20	33.59	30.08	27.68	27.75	31.88	33.39			
<b>Mass Hub</b>	31.42	30.82	28.25	26.39	25.98	30.70	40.18	38.84	34.15	33.74	34.43	35.60	36.20	37.15	34.62	33.91	34.13	38.01	36.78	41.70	35.93	32.06	29.34	29.21	33.73	35.41			
<b>DA Forecast Load (GW)</b>	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
<b>Forecast Error %</b>	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!		

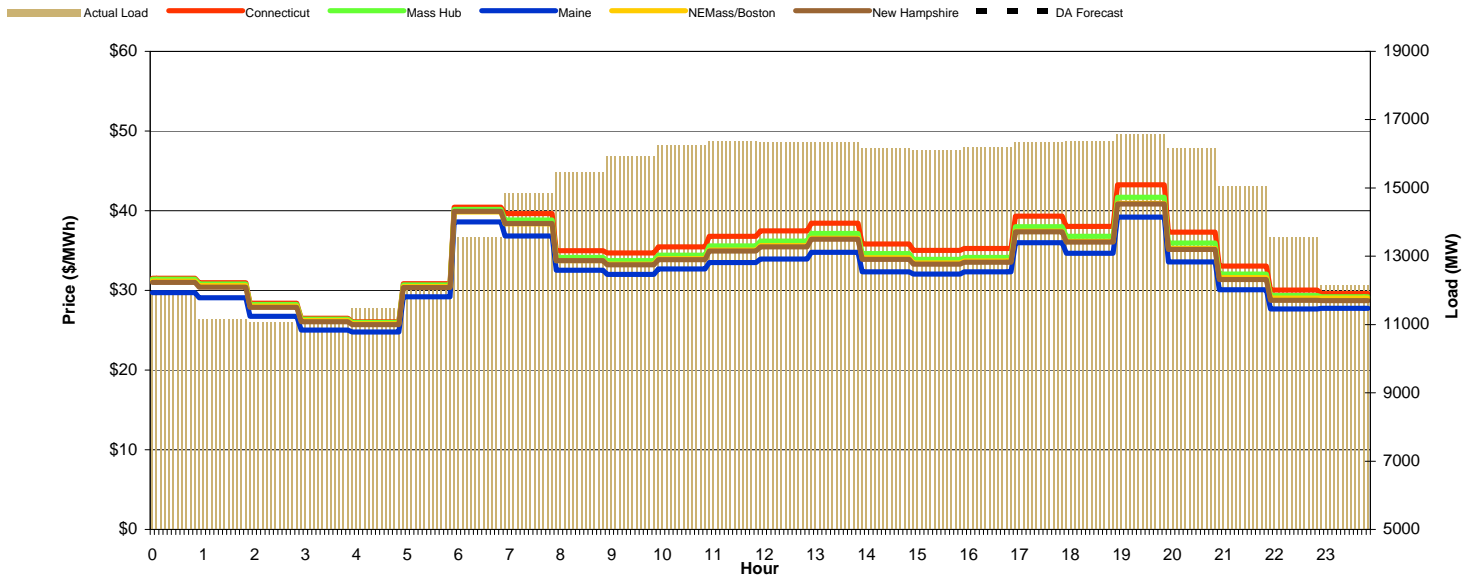




# ISO-NE Daily Report

Thursday September 08, 2011

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	33.35	29.84	26.72	25.08	25.34	31.47	37.54	38.10	38.39	40.41	42.18	46.47	46.34	46.91	46.25	46.00	46.29	45.67	44.69	47.70	41.60	38.58	37.21	36.68	39.12	43.30	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	32.72	29.19	26.18	24.49	24.82	30.93	36.40	36.65	36.70	38.66	40.21	44.03	43.73	44.20	43.57	43.34	43.62	43.09	42.27	45.30	39.53	36.89	36.08	35.58	37.42	41.12		
<b>New Hampshire</b>	32.48	28.89	25.92	24.30	24.63	30.77	36.49	36.60	36.57	38.59	40.24	43.92	43.65	44.12	43.48	43.27	43.58	43.03	42.24	45.31	39.56	36.84	36.08	35.50	37.34	41.07		
<b>Maine</b>	31.54	27.99	25.21	23.69	24.06	29.86	35.72	35.39	35.48	37.53	38.98	41.86	41.64	42.00	41.42	41.38	41.63	41.09	40.47	43.27	38.09	35.73	34.94	34.55	35.98	39.43		
<b>Mass Hub</b>	33.08	29.46	26.39	24.72	25.02	31.22	36.96	37.25	37.36	39.30	40.91	44.78	44.36	44.78	44.13	43.95	44.32	43.88	43.13	46.12	40.29	37.52	36.53	36.00	37.98	41.79		
<b>Cleared Load (GW)</b>	11.4	10.8	10.6	10.7	10.6	11.1	12.7	14.0	14.7	15.2	15.9	15.8	15.6	15.6	15.6	15.6	15.6	15.7	15.9	16.0	15.9	14.6	13.3	11.8				

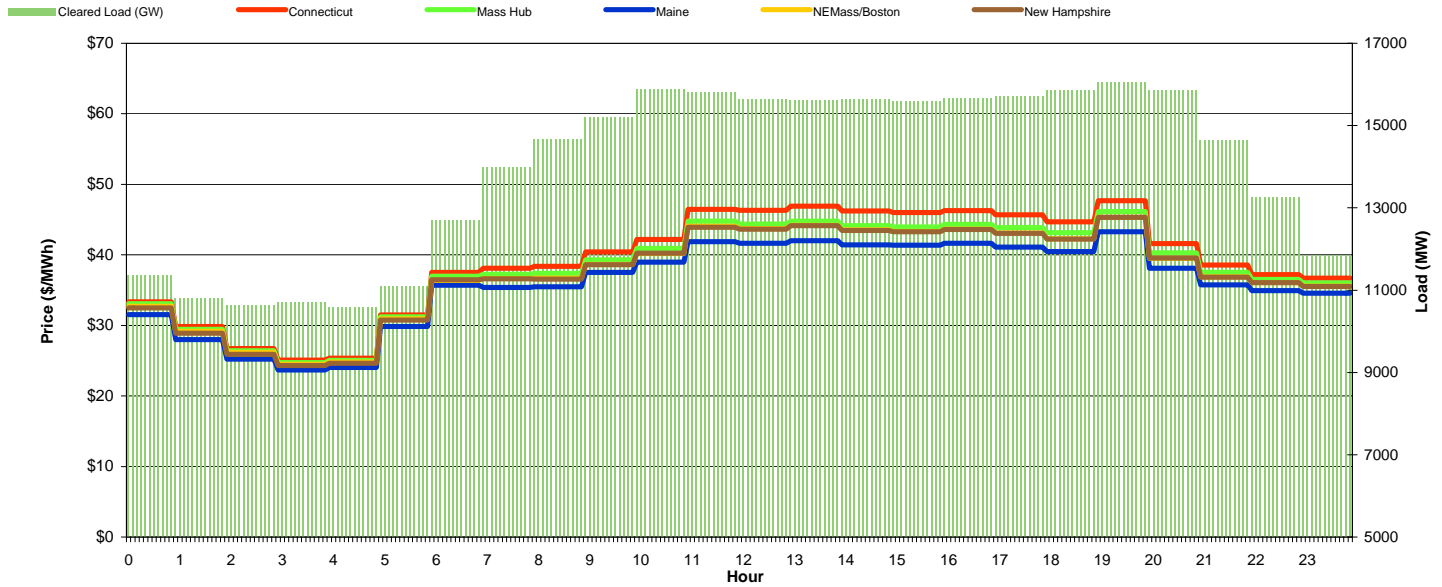

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	32.50	13.62	13.05	29.73	30.10	32.23	47.60	44.06	37.98	42.04	47.06	45.72	50.47	53.60	57.88	59.18	57.25	56.35	57.58	55.98	46.35	40.18	35.11	33.69	42.47	49.17	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	31.98	13.32	12.72	28.84	29.23	31.90	46.99	42.63	36.44	40.32	44.84	43.45	47.74	50.60	54.28	55.16	53.18	52.60	54.10	52.87	41.01	34.45	33.72	32.74	40.21	46.09		
<b>New Hampshire</b>	31.56	13.15	12.59	28.60	29.01	31.64	46.81	42.62	36.50	40.44	44.98	43.53	47.81	50.74	54.42	55.21	53.24	52.70	54.24	53.05	41.13	34.38	33.56	32.57	40.19	46.16		
<b>Maine</b>	30.56	12.75	12.25	27.88	28.22	30.84	44.80	41.29	35.75	39.60	43.60	42.22	45.98	48.42	51.24	51.60	49.92	49.46	50.68	49.76	38.99	32.83	31.98	31.26	38.41	43.96		
<b>Mass Hub</b>	32.16	13.42	12.83	29.15	29.52	32.03	47.17	43.06	36.92	40.87	45.49	44.09	48.48	51.35	55.19	56.16	54.11	53.58	55.13	53.81	41.67	34.87	34.16	33.05	40.76	46.81		
<b>DA Forecast Load (GW)</b>	11.39	10.89	10.58	10.52	10.75	11.78	13.66	14.84	15.44	15.91	16.31	16.52	16.57	16.68	16.65	16.54	16.57	16.52	16.49	16.83	16.41	15.32	13.91	12.51				
<b>Forecast Error %</b>	-1.6%	-0.8%	3.1%	2.8%	0.7%	-2.5%	-2.1%	-0.4%	-0.1%	-0.2%	-0.5%	-0.3%	0.0%	0.5%	0.6%	0.9%	0.8%	0.8%	0.4%	0.1%	1.4%	1.4%	0.8%	0.6%				

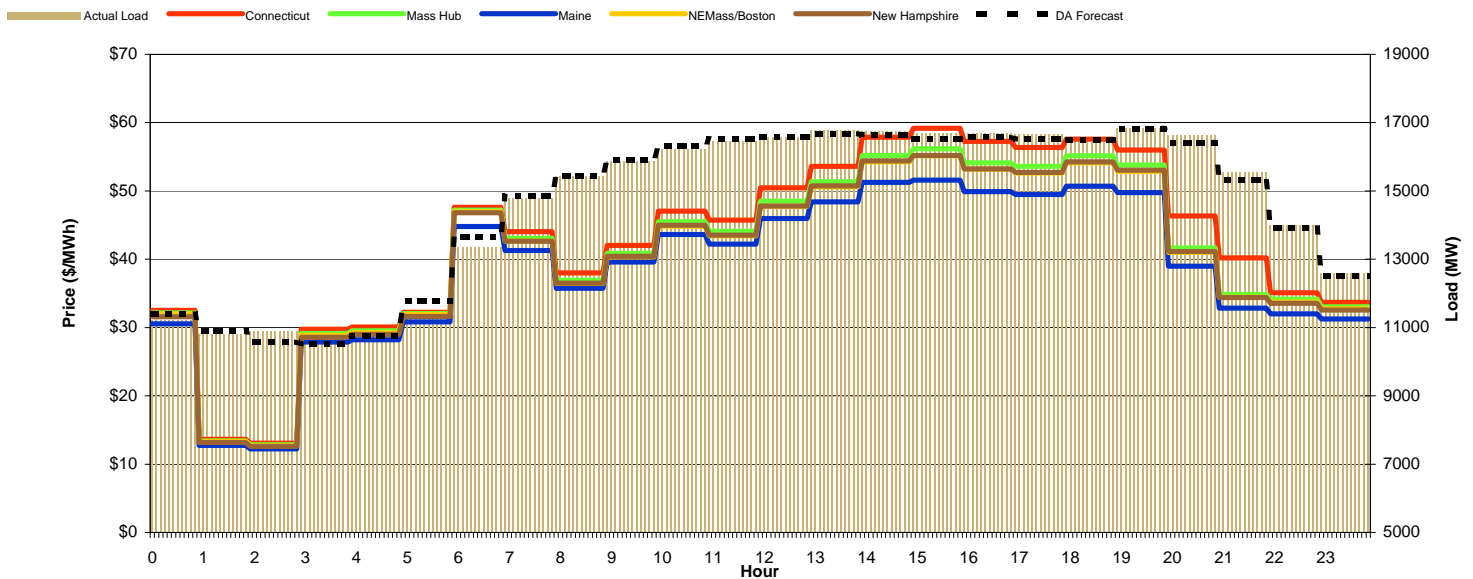






# ISO-NE Daily Report

Friday September 09, 2011

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	41.20	36.54	34.25	31.77	31.40	37.02	40.00	39.53	40.36	45.00	53.13	55.79	59.30	60.35	63.14	62.77	62.69	60.38	57.15	59.13	54.13	42.00	38.24	38.17	47.64	53.32	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	39.70	35.41	33.10	30.80	30.37	35.97	38.73	37.90	38.45	42.50	49.83	52.56	55.80	56.68	59.17	58.62	58.70	56.57	53.52	55.53	50.71	39.62	36.62	36.89	45.16	50.17		
<b>New Hampshire</b>	39.39	35.27	33.03	30.69	30.28	35.91	38.42	37.66	38.40	42.58	49.86	52.50	55.63	56.44	58.94	58.30	58.40	56.29	53.32	55.33	50.58	39.40	36.35	36.80	44.99	50.00		
<b>Maine</b>	37.95	34.04	31.89	29.72	29.35	34.73	37.18	35.99	36.87	40.81	46.59	48.70	51.00	51.64	53.86	53.00	53.35	51.49	49.02	50.86	46.89	37.61	35.06	36.12	42.24	46.42		
<b>Mass Hub</b>	40.41	36.05	33.79	31.37	30.88	36.52	39.52	38.68	39.31	43.53	51.04	53.69	57.02	57.82	60.37	59.91	59.72	57.59	54.67	56.72	51.83	40.39	37.17	37.43	46.06	51.22		
<b>Cleared Load (GW)</b>	11.5	11.2	10.9	10.8	10.7	11.4	13.5	14.9	15.7	16.4	16.7	17.2	17.4	17.8	17.8	17.7	17.6	17.4	17.1	17.3	16.8	15.9	14.5	12.7				

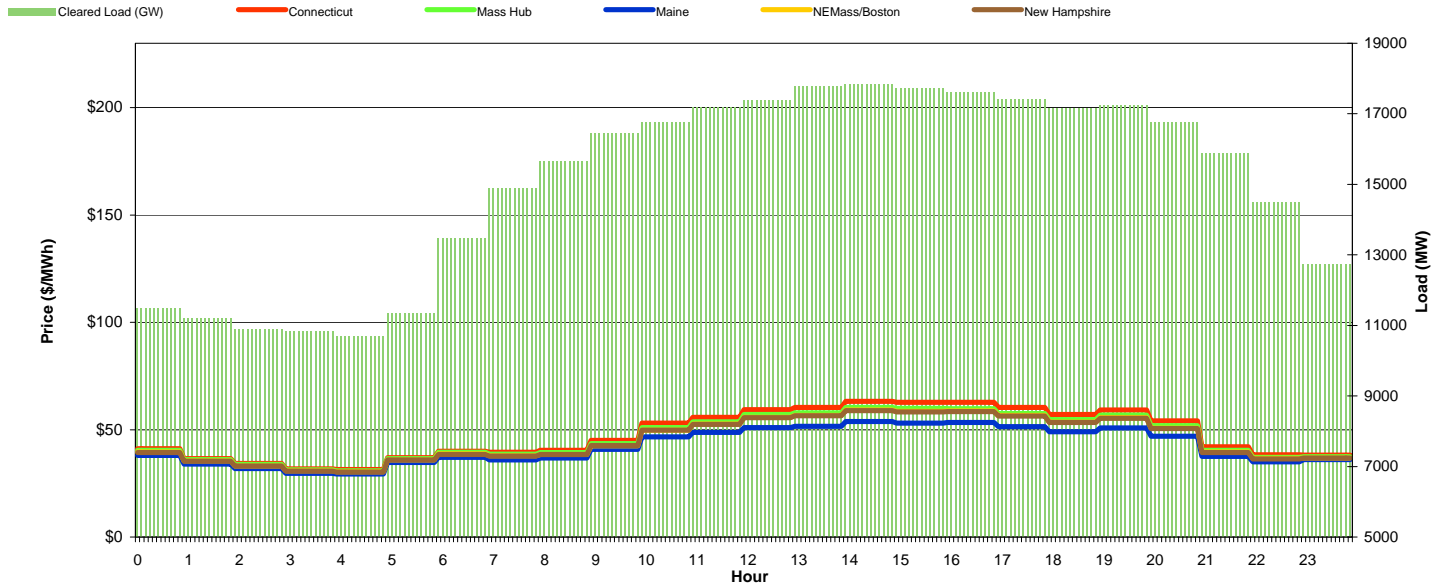

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	34.61	35.55	35.46	35.13	35.10	35.04	35.38	35.25	33.55	37.23	40.85	45.52	57.23	57.57	178.16	40.14	83.24	64.52	34.29	36.58	37.30	34.47	32.01	30.27	46.85	52.99	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	33.35	34.16	34.03	33.82	33.71	33.67	33.96	33.62	31.94	35.01	37.52	38.12	38.66	35.54	40.09	37.98	40.14	33.97	32.30	34.22	33.57	31.33	30.31	29.17	34.59	35.27		
<b>New Hampshire</b>	33.13	33.98	33.92	33.71	33.56	33.53	33.83	33.51	31.91	35.15	37.63	38.12	38.60	35.42	39.63	37.69	39.66	33.72	32.12	34.09	33.48	31.12	29.90	28.75	34.42	35.11		
<b>Maine</b>	31.72	32.45	32.54	32.35	32.03	31.90	32.17	32.01	30.70	33.91	36.37	36.48	36.52	33.30	34.94	35.68	36.55	31.24	30.27	32.22	31.57	29.50	28.22	27.33	32.58	33.09		
<b>Mass Hub</b>	33.76	34.68	34.61	34.43	34.34	34.29	34.49	34.11	32.40	35.63	38.13	38.40	38.06	34.47	29.07	38.51	37.44	31.99	32.76	34.76	34.07	31.74	30.73	29.49	34.27	34.52		
<b>DA Forecast Load (GW)</b>	11.68	11.10	10.79	10.70	10.86	11.95	13.87	15.24	16.01	16.74	17.22	17.58	17.80	18.03	18.09	18.07	18.00	17.73	17.29	17.61	17.07	16.08	14.74	13.29				
<b>Forecast Error %</b>	-0.7%	3.5%	4.5%	5.9%	7.2%	5.2%	-0.5%	-2.4%	-2.6%	-2.9%	-2.4%	-2.4%	-2.4%	-2.3%	-1.8%	-1.2%	-0.6%	-0.6%	-1.2%	-2.8%	-1.3%	-1.6%	-1.8%	-2.1%				

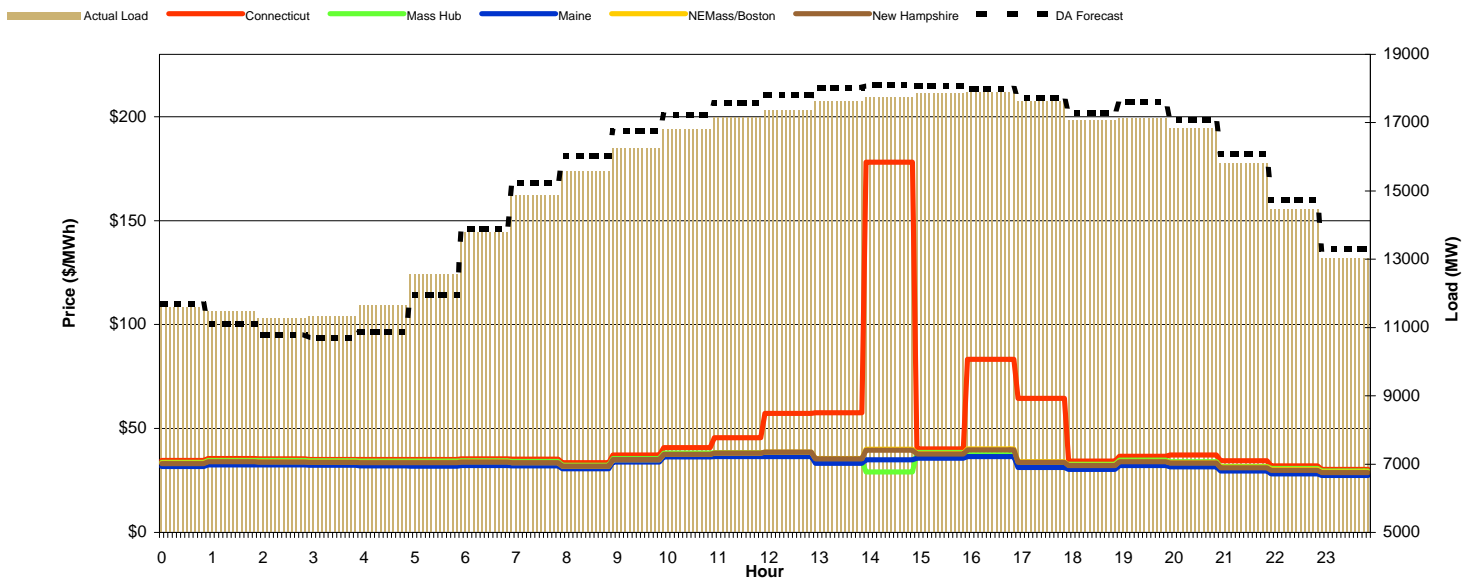




# ISO-NE Daily Report

Saturday September 10, 2011

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	35.35	33.73	33.37	31.14	30.83	30.98	30.76	36.14	36.58	37.72	41.71	41.99	42.25	42.25	42.13	41.38	42.22	41.16	40.43	42.48	41.40	37.90	36.87	36.17	37.79	40.29	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	34.71	33.02	32.97	30.79	30.52	30.63	30.60	35.75	35.94	36.65	40.19	40.37	40.52	40.50	40.36	39.71	40.46	39.57	38.89	40.56	39.77	36.69	36.00	35.74	36.70	38.87		
<b>New Hampshire</b>	34.41	32.75	32.57	30.56	30.33	30.39	30.43	35.62	36.02	36.65	40.21	40.28	40.39	40.41	40.27	39.59	40.37	39.46	38.82	40.61	39.79	36.59	35.91	35.27	36.57	38.81		
<b>Maine</b>	32.97	31.39	31.14	29.70	29.48	29.42	29.69	34.87	35.13	35.83	39.01	39.00	39.01	39.27	39.15	38.31	38.89	38.18	37.78	39.41	38.61	35.64	34.74	33.87	35.44	37.68		
<b>Mass Hub</b>	34.98	33.42	33.31	31.04	30.77	30.82	30.67	35.82	36.11	36.99	40.66	40.87	41.00	40.99	40.87	40.18	40.97	40.00	39.31	41.13	40.24	36.96	36.24	35.80	37.05	39.27		
<b>Cleared Load (GW)</b>	11.7	11.6	11.3	10.9	10.8	10.8	10.7	11.6	13.0	14.1	14.7	14.9	14.9	14.9	14.8	14.8	14.8	14.6	14.6	15.1	14.6	13.8	12.6	11.4				

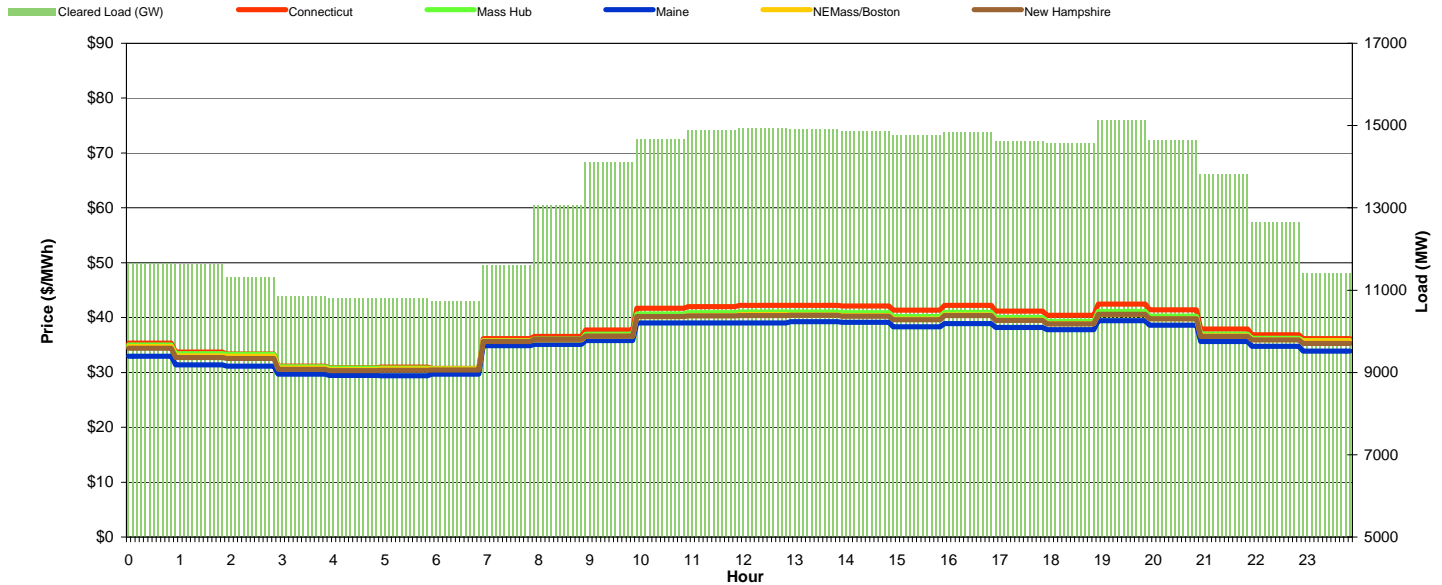

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	32.95	37.33	33.79	31.69	31.16	34.14	32.36	33.10	36.45	38.13	38.49	39.34	41.31	43.54	44.32	49.99	49.54	39.81	39.12	64.68	68.54	60.44	36.34	36.54	41.38	45.20	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	32.01	36.37	33.05	31.01	30.53	33.46	31.85	32.50	35.30	36.49	36.58	37.09	38.74	40.74	41.12	46.24	44.86	35.52	34.95	37.27	36.52	34.39	34.95	35.77	36.14	37.71		
<b>New Hampshire</b>	31.53	35.86	32.63	30.63	30.16	33.07	31.49	32.24	35.06	36.37	36.47	36.95	38.51	40.49	40.87	46.00	44.64	35.40	34.91	37.22	36.44	34.16	34.77	35.33	35.88	37.53		
<b>Maine</b>	29.90	33.97	31.04	29.29	28.88	31.62	30.16	31.10	33.58	34.96	35.11	35.61	36.89	38.88	39.34	44.12	42.74	34.15	33.72	35.61	34.39	32.34	33.34	33.84	34.36	35.99		
<b>Mass Hub</b>	32.24	36.60	33.31	31.27	30.77	33.71	31.97	32.61	35.55	36.90	37.07	37.69	39.41	41.48	41.85	47.21	45.74	35.95	35.34	35.91	34.72	32.79	35.26	35.90	36.30	37.84		
<b>DA Forecast Load (GW)</b>	12.05	11.33	10.89	10.66	10.61	10.93	11.57	12.44	13.64	14.50	15.11	15.36	15.41	15.35	15.29	15.23	15.23	15.26	15.14	15.58	15.12	14.34	13.26	12.15				
<b>Forecast Error %</b>	-1.2%	2.8%	6.4%	6.2%	6.2%	5.6%	-1.0%	-2.6%	-1.8%	-1.0%	-0.8%	-0.3%	0.4%	1.1%	1.5%	1.9%	1.9%	1.1%	0.1%	-1.2%	0.6%	0.3%	0.2%	-0.3%				

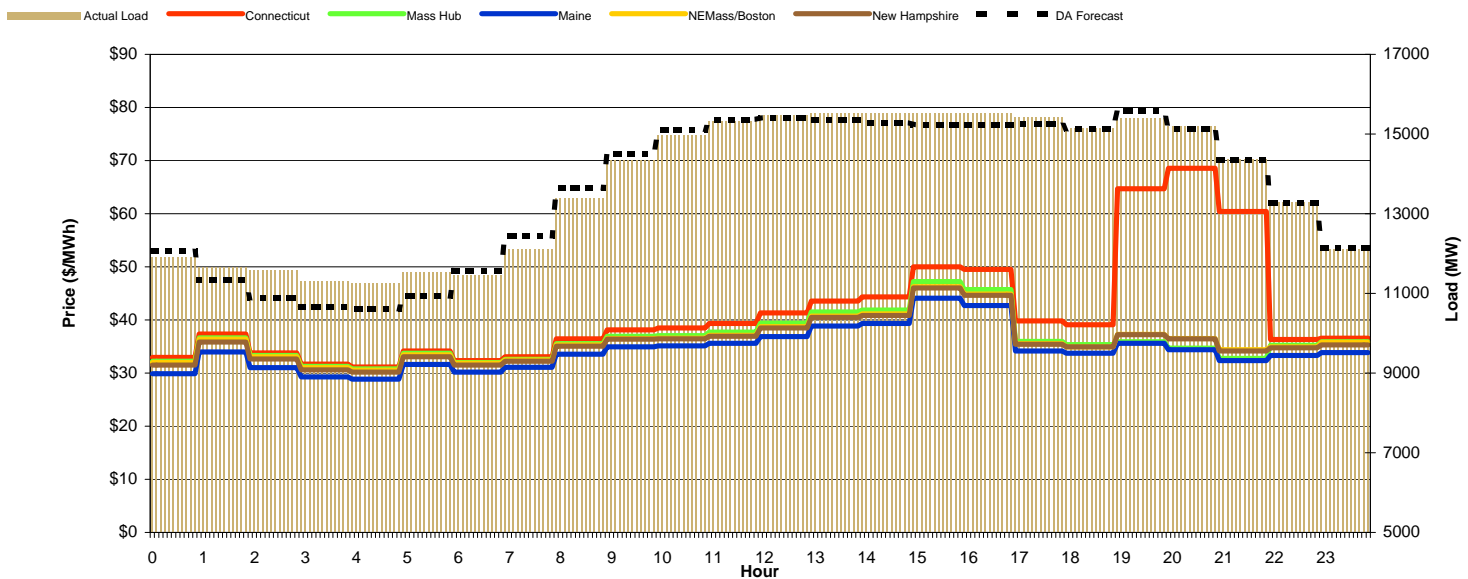




# ISO-NE Daily Report

Sunday September 11, 2011

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	32.09	31.25	26.73	26.75	26.38	27.24	31.22	32.55	36.30	37.22	37.29	37.89	38.33	38.18	38.19	38.20	38.69	38.67	42.32	47.27	42.25	37.78	36.89	36.08	35.66	38.63	All	On Pk
<b>NEMass/Boston</b>	31.38	30.58	26.10	26.13	25.82	26.76	30.65	31.61	35.51	36.34	36.33	36.51	36.67	36.56	36.53	36.54	37.09	37.06	40.48	45.15	40.52	36.47	35.75	35.67	34.51	37.20		
<b>New Hampshire</b>	31.36	30.40	25.92	25.99	25.68	26.61	30.60	31.72	35.70	36.43	36.39	36.42	36.62	36.49	36.49	36.49	37.15	37.19	40.61	45.04	40.32	36.47	35.61	35.79	34.48	37.20		
<b>Maine</b>	30.38	29.40	24.95	25.21	24.90	25.86	30.00	31.11	34.88	35.71	35.66	35.49	35.63	35.77	35.64	35.56	36.28	36.37	39.45	43.20	39.15	35.53	34.32	35.23	33.57	36.23		
<b>Mass Hub</b>	31.61	30.74	26.30	26.36	26.03	26.92	30.83	31.87	35.79	36.63	36.62	36.92	37.17	37.02	37.01	37.00	37.60	37.59	41.12	45.91	41.13	36.90	36.09	35.85	34.88	37.65		
<b>Cleared Load (GW)</b>	10.6	9.9	10.0	9.8	9.8	9.8	9.8	10.4	11.6	12.6	13.2	13.7	13.9	13.9	13.7	13.8	14.1	14.4	14.6	15.0	14.6	13.6	12.5	11.3				

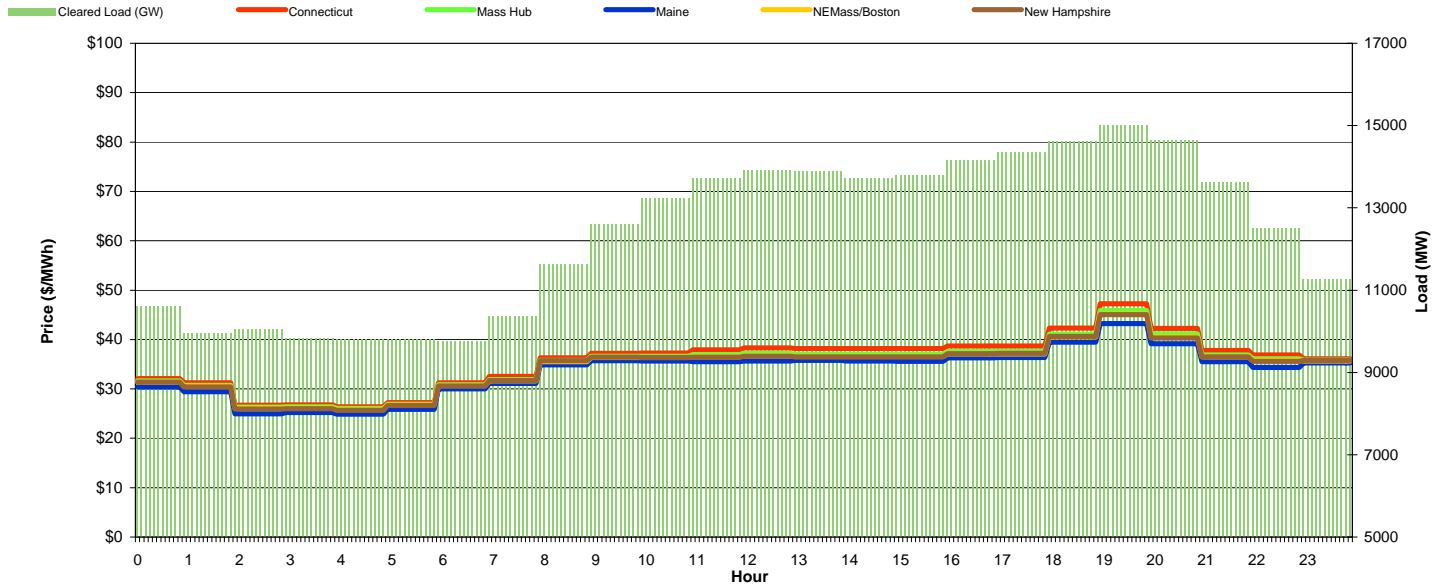

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$				
<b>Connecticut</b>	36.67	31.36	30.39	30.10	29.99	30.04	31.11	31.97	32.61	32.12	34.14	35.04	36.73	35.72	37.83	38.14	38.60	39.04	38.41	71.53	77.77	58.11	31.54	32.43	38.39	41.83	All	On Pk	
<b>NEMass/Boston</b>	35.85	30.60	29.51	29.23	29.13	29.30	30.52	31.27	31.83	31.21	32.97	33.50	34.87	33.93	35.77	36.07	36.38	36.80	36.33	41.67	35.30	33.11	30.08	31.76	33.21	34.44			
<b>New Hampshire</b>	35.51	30.31	29.22	28.99	28.85	29.04	30.29	31.18	31.71	31.08	32.92	33.46	34.83	33.85	35.69	36.02	36.31	36.72	36.32	41.60	35.12	32.67	29.60	31.41	33.03	34.32			
<b>Maine</b>	34.03	29.04	27.98	28.00	27.70	27.95	29.32	30.38	30.77	30.11	31.99	32.41	33.66	32.86	34.52	34.67	34.91	35.36	35.04	39.65	33.05	30.93	28.19	29.95	31.77	33.03			
<b>Mass Hub</b>	36.00	30.74	29.72	29.45	29.35	29.50	30.65	31.41	32.00	31.46	33.28	33.92	35.39	34.41	36.36	36.66	37.03	37.45	36.90	40.08	32.43	31.53	30.34	31.93	33.25	34.42			
<b>DA Forecast Load (GW)</b>	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
<b>Forecast Error %</b>	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!		

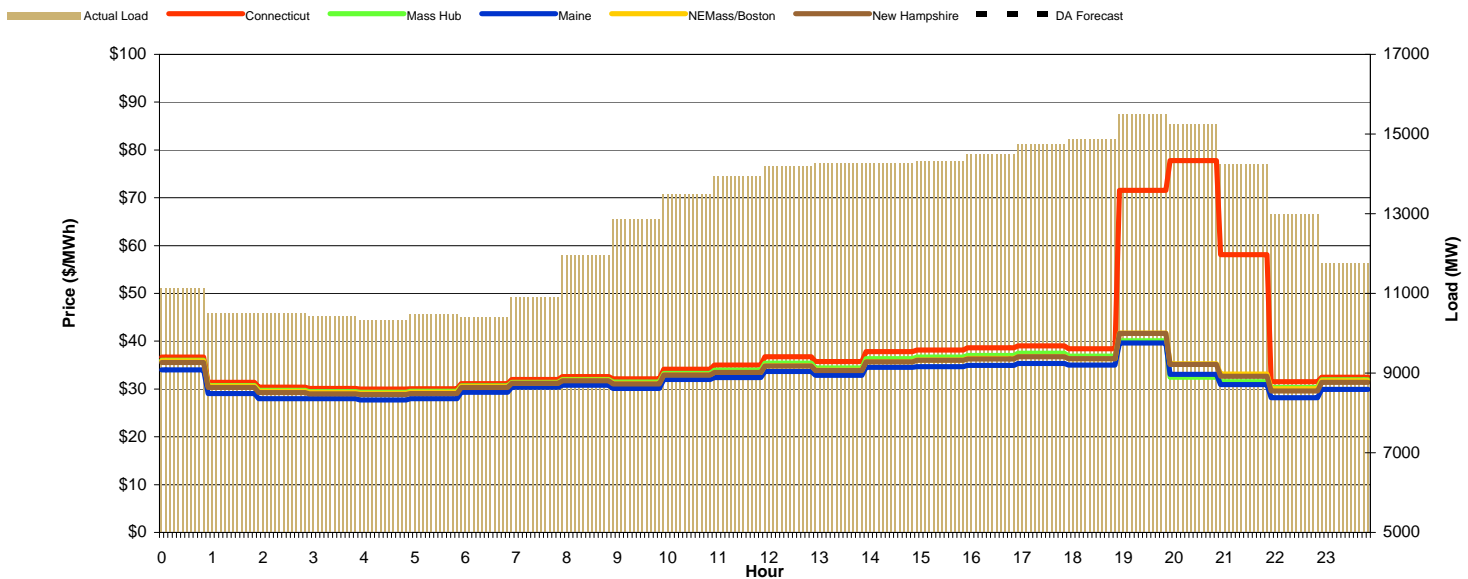




# ISO-NE Daily Report

Monday September 12, 2011

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	32.46	30.88	25.68	23.94	25.56	33.11	36.11	37.91	38.79	40.26	42.20	49.14	53.84	56.27	58.58	59.21	59.10	54.60	52.29	58.47	47.00	39.90	37.74	36.00	42.88	49.08	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	32.18	30.80	25.61	23.94	25.62	32.96	35.88	37.14	37.76	39.01	40.74	46.84	51.12	53.81	54.89	55.17	55.26	52.62	48.71	54.64	45.20	38.54	36.81	35.48	41.28	46.77		
<b>New Hampshire</b>	32.02	30.58	25.46	23.84	25.47	32.95	35.97	37.26	37.71	38.99	40.77	46.78	50.92	53.60	54.49	54.72	54.95	52.37	48.49	54.49	45.08	38.49	36.75	35.56	41.15	46.62		
<b>Maine</b>	31.09	29.63	24.64	23.18	24.61	32.02	35.34	36.31	36.64	37.59	39.33	44.58	48.00	50.20	51.05	51.03	51.42	49.03	45.96	50.92	42.91	37.28	35.82	35.25	39.33	44.25		
<b>Mass Hub</b>	32.32	30.85	25.68	23.97	25.64	33.12	36.01	37.30	38.00	39.25	41.00	47.12	51.43	54.01	54.79	55.06	55.15	52.93	48.84	54.75	45.55	38.80	36.96	35.56	41.42	46.93		
<b>Cleared Load (GW)</b>	10.6	10.3	10.4	10.5	10.5	10.9	12.5	14.1	15.0	15.7	16.4	16.8	16.9	17.2	17.4	17.3	17.3	17.3	17.1	17.1	17.0	15.6	14.2	12.4				

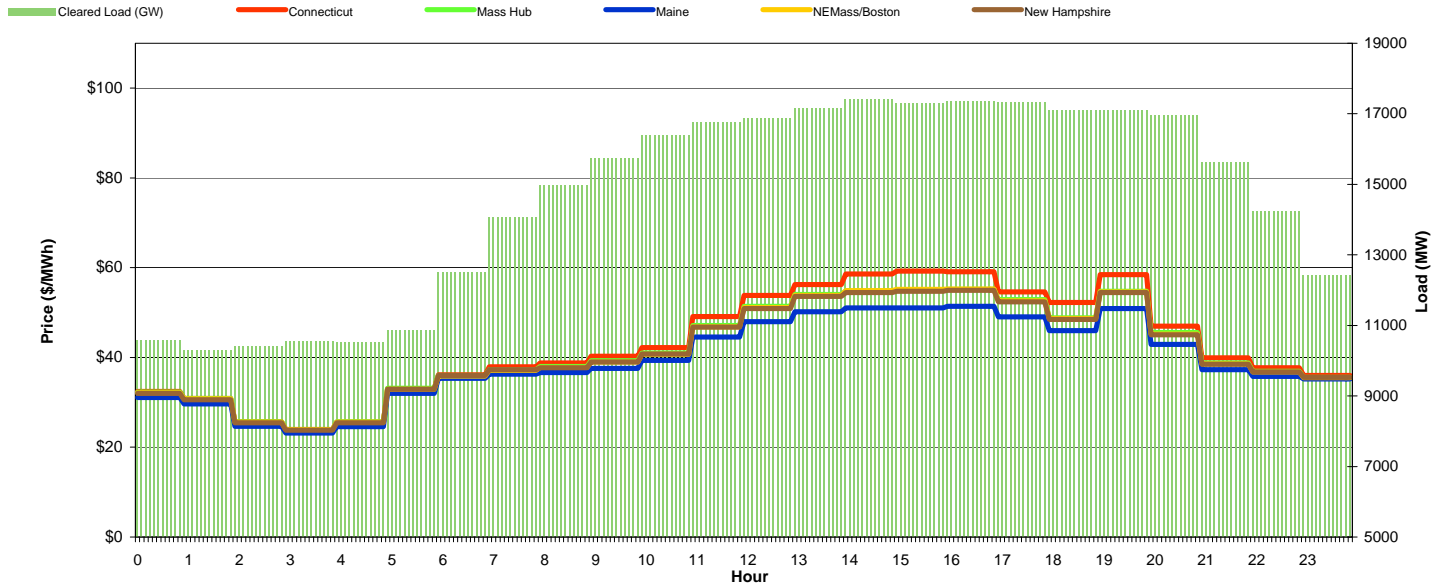

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	28.38	26.87	33.21	33.40	32.47	37.39	38.75	39.16	36.76	38.94	52.28	54.30	51.32	59.57	66.20	62.52	67.98	69.08	68.44	74.39	58.18	38.63	36.07	33.51	47.41	54.61	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	27.88	26.40	32.76	33.09	32.27	36.93	38.14	38.15	35.55	37.39	49.69	51.69	49.17	77.18	96.63	51.60	52.90	56.88	49.42	59.82	51.45	37.14	34.80	32.79	45.41	51.84		
<b>New Hampshire</b>	27.53	26.11	32.40	32.75	31.94	36.67	37.88	37.87	35.33	37.26	49.48	51.36	48.76	56.35	54.65	50.88	52.13	56.27	49.07	59.52	51.25	36.94	34.60	32.64	42.49	47.61		
<b>Maine</b>	26.20	24.82	30.51	30.89	30.31	34.99	36.47	36.35	33.76	35.59	46.09	47.86	46.01	52.26	50.48	47.79	48.69	52.34	46.31	55.28	48.04	35.40	33.34	31.79	40.07	44.72		
<b>Mass Hub</b>	27.99	26.53	32.93	33.24	32.36	37.09	38.25	38.31	35.77	37.71	50.25	52.22	49.51	57.28	55.32	51.54	53.11	57.16	49.46	60.03	51.85	37.41	35.03	32.91	43.05	48.25		
<b>DA Forecast Load (GW)</b>	10.85	10.35	10.14	10.09	10.36	11.38	13.11	14.53	15.26	16.05	16.73	17.16	17.38	17.75	17.86	17.85	17.93	17.92	17.62	18.03	17.36	16.19	14.56	13.00				
<b>Forecast Error %</b>	0.6%	3.1%	8.2%	10.9%	8.9%	5.7%	1.9%	1.5%	2.4%	2.3%	2.7%	2.8%	3.5%	3.6%	3.9%	4.4%	4.3%	3.8%	3.6%	3.1%	4.5%	4.0%	3.9%	4.6%				

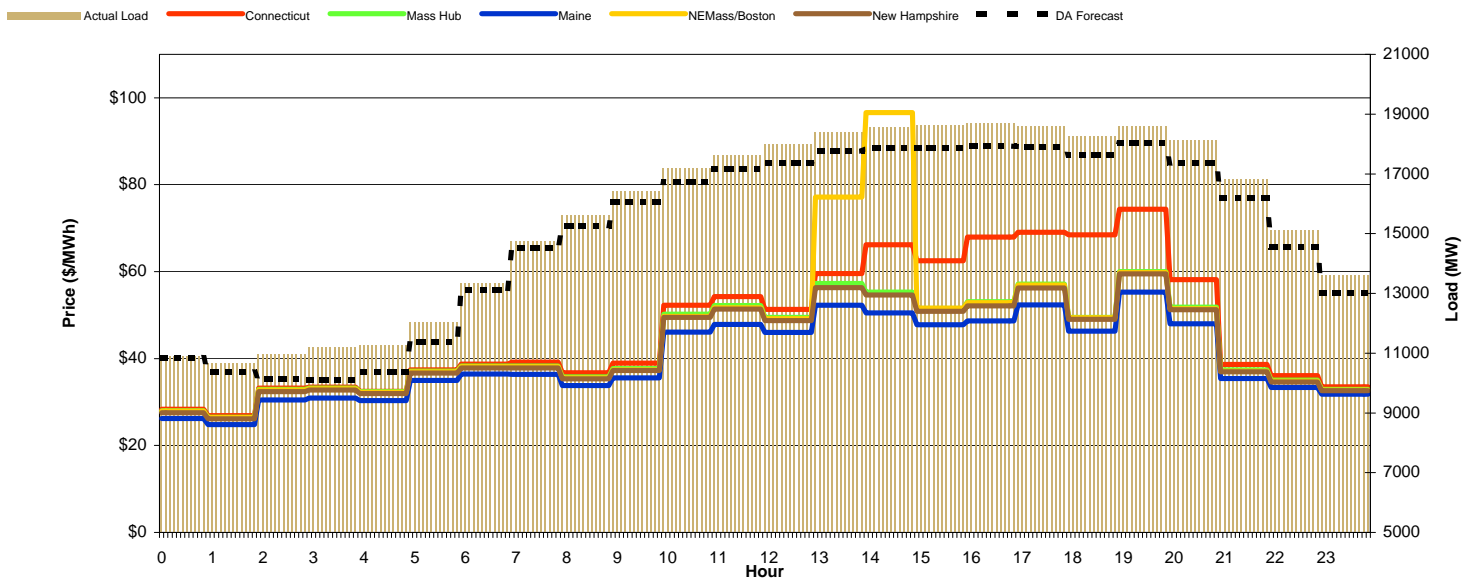




# ISO-NE Daily Report

Tuesday September 13, 2011

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	36.34	35.39	34.54	34.40	35.00	33.65	38.41	38.65	39.85	44.61	46.46	54.48	57.26	60.00	66.00	62.00	62.00	60.00	54.72	59.64	51.30	40.61	39.00	37.50	46.74	52.29	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	35.80	34.69	33.87	33.71	34.32	33.34	37.88	37.55	38.41	42.80	43.96	52.21	55.27	57.01	57.95	58.19	58.29	54.57	52.17	57.00	48.33	38.48	37.62	36.47	44.58	49.36		
<b>New Hampshire</b>	35.84	34.85	34.04	33.93	34.60	33.52	38.10	37.73	38.33	42.83	43.75	51.80	54.45	55.82	56.61	56.81	56.98	53.74	51.60	56.14	48.03	38.31	37.71	36.59	44.25	48.79		
<b>Maine</b>	35.08	33.96	33.18	33.11	33.81	32.81	37.49	36.80	37.22	41.39	41.63	48.12	50.12	51.22	51.75	51.96	52.14	49.63	47.79	51.47	45.01	36.55	37.08	36.13	41.89	45.62		
<b>Mass Hub</b>	36.12	35.13	34.35	34.21	34.84	33.58	38.19	37.91	38.86	43.22	44.20	52.56	55.45	57.09	57.82	57.92	58.16	54.90	52.66	57.36	48.91	38.98	38.09	36.89	44.89	49.63		
<b>Cleared Load (GW)</b>	12.4	12.1	11.8	11.8	12.0	11.9	13.4	14.7	15.8	16.5	17.1	17.7	18.3	18.8	19.0	18.9	18.9	18.7	18.2	18.7	17.7	16.6	14.9	13.1				

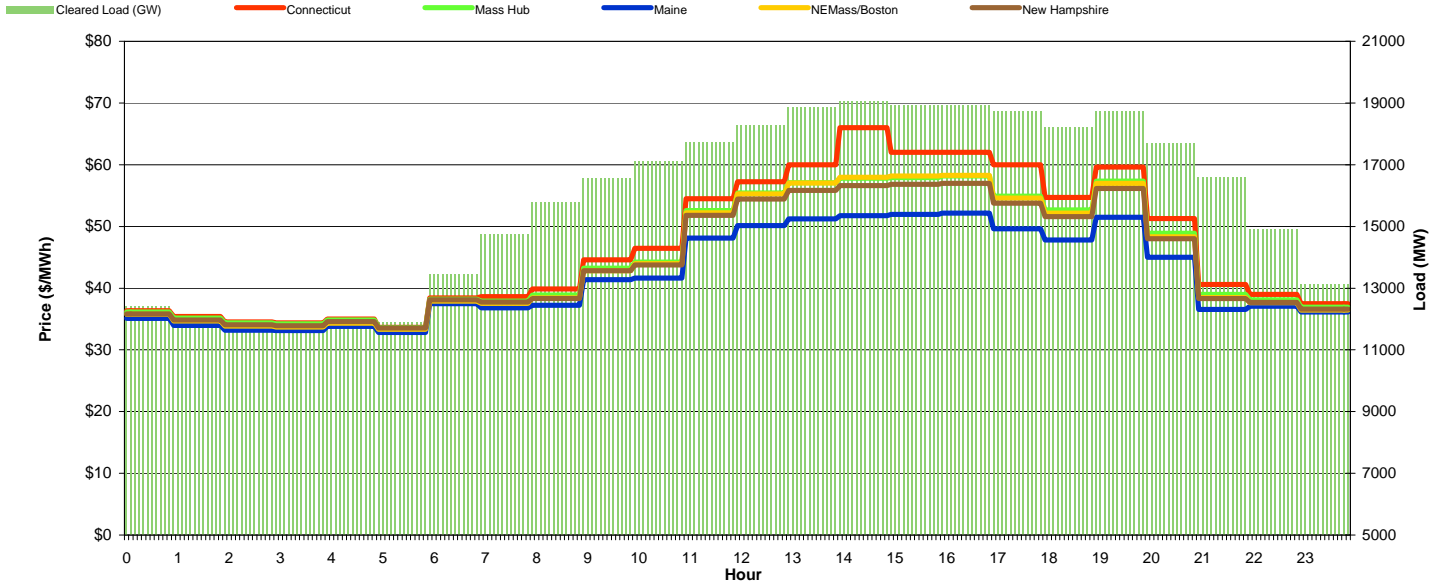

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	34.75	36.36	34.75	35.07	35.35	36.96	36.81	36.45	35.68	40.98	46.73	54.68	49.25	50.13	50.43	50.08	51.74	44.33	42.78	56.66	48.41	40.42	37.58	34.52	42.54	46.02	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	34.03	35.36	33.91	34.25	34.55	36.24	35.97	35.49	34.54	39.45	44.95	52.35	47.19	46.26	46.73	45.29	43.79	40.53	39.66	52.65	45.16	37.06	35.11	33.65	40.17	42.89		
<b>New Hampshire</b>	33.97	35.46	34.03	34.41	34.72	36.42	36.03	35.56	34.52	39.36	44.57	51.72	46.50	45.35	45.76	44.35	42.82	39.72	39.03	51.78	44.56	36.70	34.82	33.45	39.82	42.32		
<b>Maine</b>	33.05	34.39	33.16	33.62	33.86	35.67	35.12	34.96	33.86	38.27	42.49	48.57	42.53	40.75	41.57	40.20	39.76	36.87	36.42	47.35	41.19	34.47	32.94	32.07	37.63	39.51		
<b>Mass Hub</b>	34.22	35.76	34.30	34.66	34.97	36.59	36.24	35.65	34.70	39.69	45.23	52.75	47.52	46.36	47.02	45.23	44.57	40.57	39.82	52.84	45.43	37.24	35.35	33.89	40.44	43.12		
<b>DA Forecast Load (GW)</b>	12.05	11.40	11.08	10.92	11.07	12.06	13.82	15.18	15.97	16.80	17.56	18.10	18.46	18.83	18.98	18.94	19.01	18.88	18.43	18.71	18.15	16.90	15.21	13.62				
<b>Forecast Error %</b>	5.7%	10.7%	12.0%	14.0%	14.0%	8.6%	3.9%	0.5%	0.7%	0.7%	1.2%	2.0%	2.3%	2.3%	2.4%	3.1%	2.7%	2.1%	1.8%	2.2%	3.5%	3.1%	3.0%	4.1%				

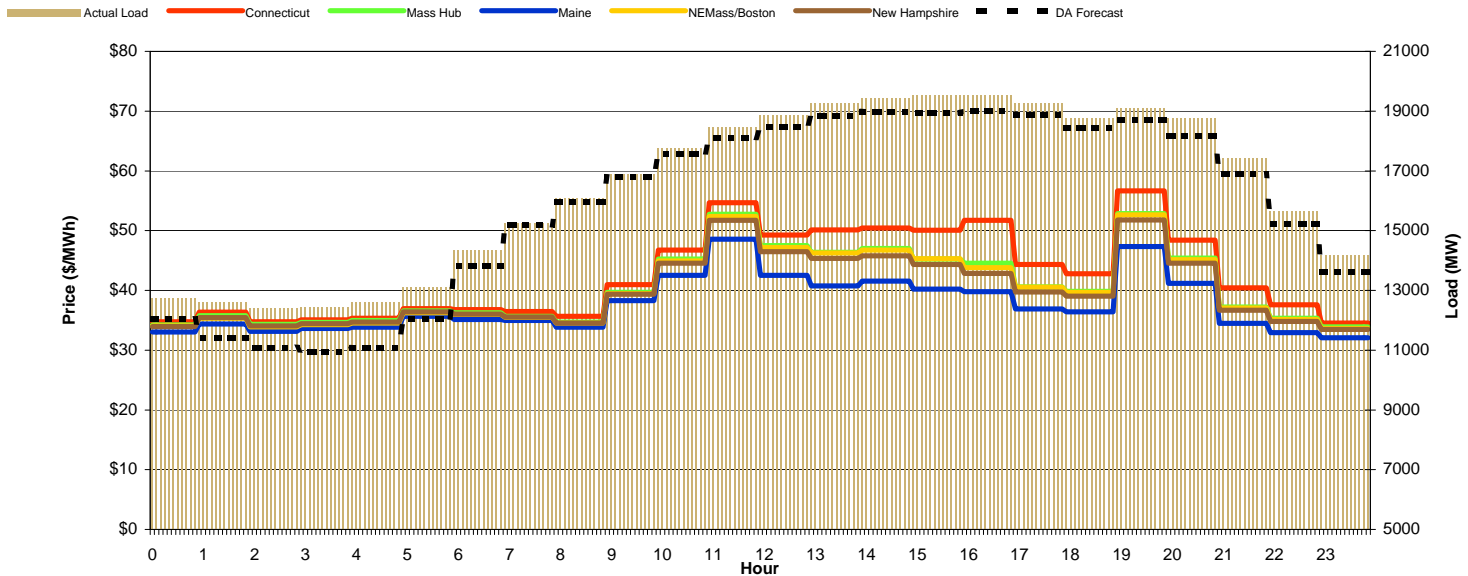




# ISO-NE Daily Report

Wednesday September 14, 2011

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	36.15	35.31	34.47	33.82	33.78	35.92	37.80	38.98	40.68	46.77	51.95	57.64	60.06	60.19	59.16	58.79	58.05	56.62	51.93	58.27	49.22	41.28	38.01	35.39	46.26	51.73	All	On Pk
NEMass/Boston	35.14	34.31	33.58	33.10	33.07	35.13	36.92	37.61	39.09	44.65	49.67	56.14	58.73	58.80	57.96	57.23	56.12	54.45	49.71	56.26	47.36	39.75	37.06	34.91	44.86	50.04		
New Hampshire	35.28	34.45	33.76	33.31	33.25	35.43	37.04	37.46	38.86	44.39	49.30	55.17	57.41	57.37	56.46	55.76	55.02	53.62	48.98	55.61	46.83	39.20	36.94	34.96	44.41	49.27		
Maine	33.95	33.07	32.57	32.38	32.29	34.41	36.00	35.88	36.89	41.74	45.77	50.48	52.28	52.30	51.53	51.00	50.37	49.27	45.79	50.85	43.77	36.98	35.93	34.12	41.65	45.68		
Mass Hub	35.61	34.85	34.10	33.54	33.52	35.54	37.27	38.16	39.66	45.28	50.16	56.27	58.55	58.56	57.73	57.10	56.43	54.89	50.13	56.82	47.88	40.20	37.34	35.05	45.19	50.32		
Cleared Load (GW)	12.8	12.6	12.4	12.1	12.4	12.7	13.5	15.4	16.2	16.9	17.4	18.2	18.5	18.8	18.9	18.9	18.9	18.4	18.3	18.5	17.7	16.3	14.7	12.9				

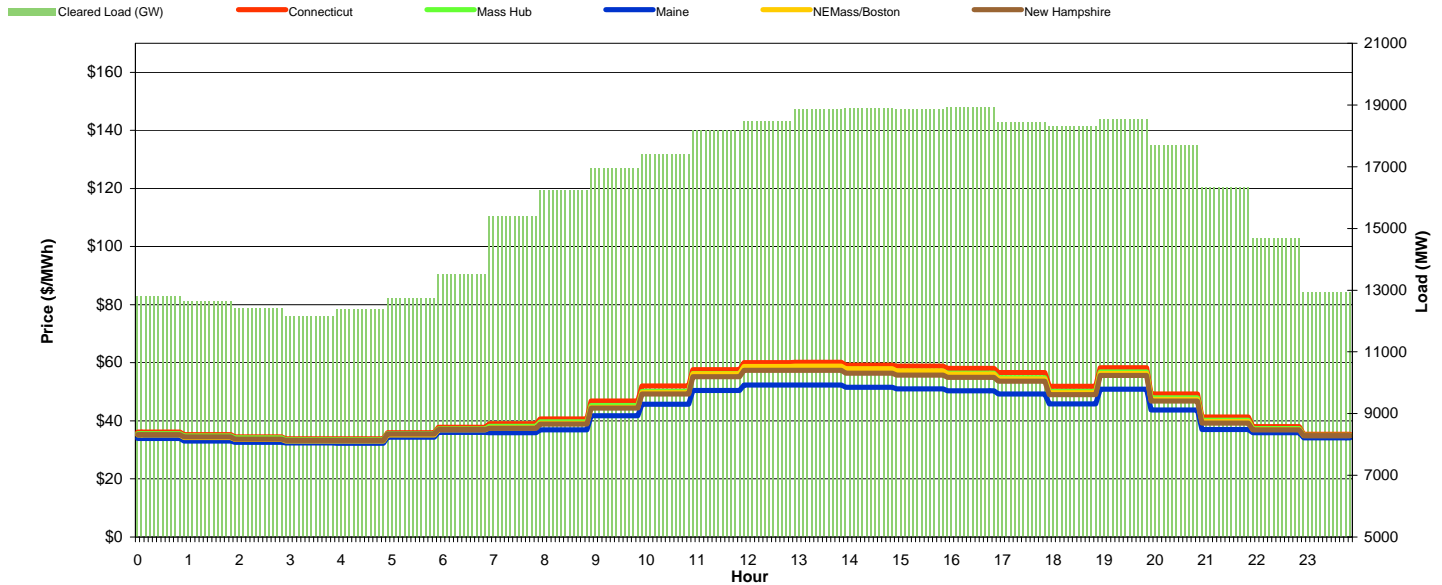

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	42.05	37.95	37.36	36.02	35.36	40.81	42.26	41.54	37.64	50.43	56.39	58.28	77.68	155.58	55.21	55.82	56.29	134.86	48.25	60.77	58.52	44.18	37.53	39.29	55.84	64.31	All	On Pk
NEMass/Boston	40.58	36.58	36.12	35.02	34.53	39.50	41.12	39.99	36.14	48.11	53.89	56.29	69.38	117.91	54.50	55.20	54.76	130.81	46.81	60.14	56.74	42.58	36.27	38.59	52.57	59.97		
New Hampshire	40.54	36.72	36.34	35.29	34.73	39.70	41.04	39.82	36.01	47.70	53.28	55.19	68.13	111.71	51.65	51.53	53.60	128.20	46.02	58.45	55.94	42.06	35.84	38.37	51.58	58.45		
Maine	38.39	35.03	34.82	34.24	33.55	38.07	39.13	37.57	33.96	44.13	48.49	50.06	60.62	95.43	47.59	47.34	49.10	109.36	42.82	53.45	51.02	39.20	33.97	37.21	47.27	52.76		
Mass Hub	41.10	37.18	36.73	35.53	34.97	40.05	41.41	40.31	36.40	48.51	54.26	56.14	70.11	117.60	52.67	52.64	54.63	130.77	46.88	59.28	56.85	42.80	36.48	38.68	52.58	59.77		
DA Forecast Load (GW)	12.62	11.96	11.58	11.43	11.63	12.65	14.57	15.93	16.72	17.45	18.16	18.59	18.87	19.17	19.24	19.22	19.15	18.94	18.77	19.02	18.37	17.00	15.28	13.65				
Forecast Error %	7.3%	12.5%	15.8%	15.8%	15.1%	9.9%	1.1%	0.7%	1.4%	2.2%	2.8%	3.9%	4.7%	4.8%	4.8%	5.5%	6.1%	5.9%	4.7%	5.4%	6.5%	6.7%	6.6%	7.8%				

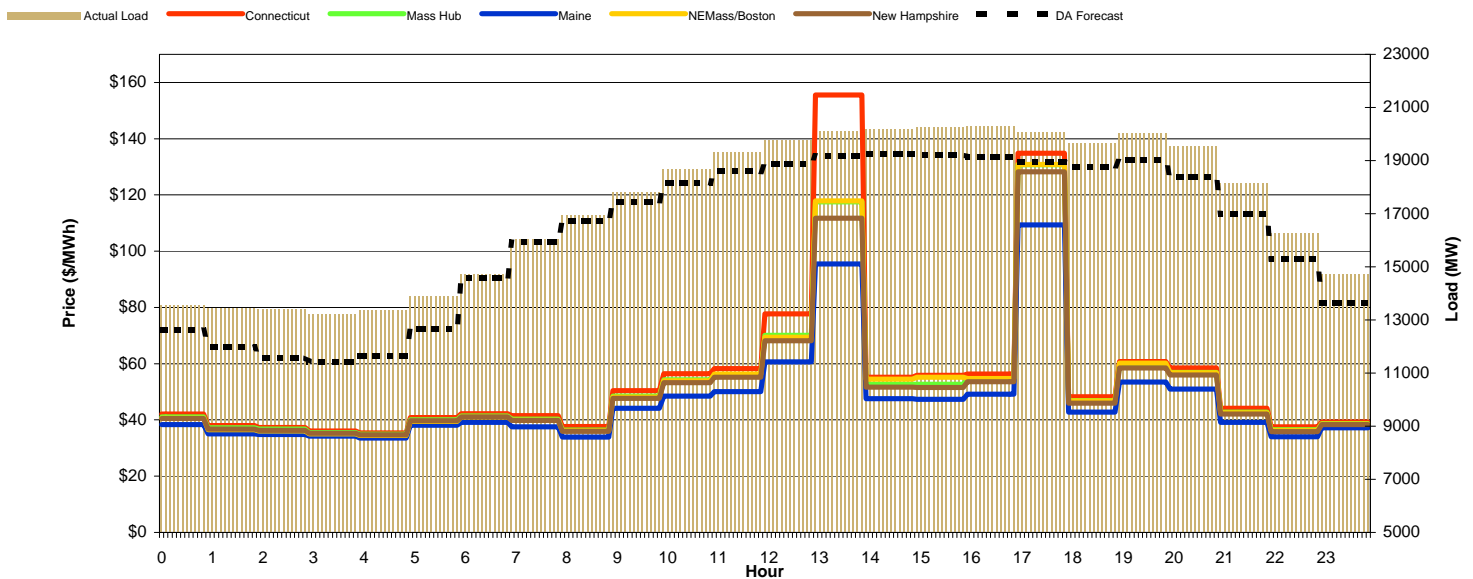




# ISO-NE Daily Report

Thursday September 15, 2011

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	38.90	36.65	37.00	34.79	36.49	36.96	37.87	38.90	40.59	41.46	46.90	48.45	42.71	42.35	40.98	41.00	41.01	39.38	39.20	40.20	39.52	38.57	36.75	32.77	39.56	41.12	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	38.46	36.30	36.62	34.61	36.18	36.76	37.13	37.71	39.12	40.01	45.24	46.69	41.13	40.75	39.39	39.34	39.32	37.98	37.91	39.03	38.22	37.65	36.49	32.92	38.54	39.75		
<b>New Hampshire</b>	38.34	36.30	36.59	34.61	36.27	36.81	37.10	37.57	38.97	39.85	45.04	46.46	40.91	40.44	39.09	39.00	39.01	37.71	37.69	38.95	38.07	37.48	36.54	32.84	38.40	39.55		
<b>Maine</b>	37.70	35.57	35.96	34.15	35.91	36.50	36.44	36.10	37.08	37.95	42.78	43.77	38.94	38.53	37.33	37.26	37.22	36.09	36.10	37.55	36.59	36.03	35.74	32.43	37.07	37.82		
<b>Mass Hub</b>	38.71	36.53	36.96	34.85	36.44	36.89	37.45	38.18	39.64	40.52	45.81	47.22	41.59	41.21	39.82	39.77	39.79	38.34	38.24	39.43	38.65	38.02	36.58	32.77	38.89	40.18		
<b>Cleared Load (GW)</b>	12.4	12.0	11.9	11.5	11.7	11.8	13.5	14.8	15.5	16.2	16.7	16.7	16.8	16.9	16.7	16.5	16.5	16.3	16.3	16.7	16.2	14.9	13.3	11.6				

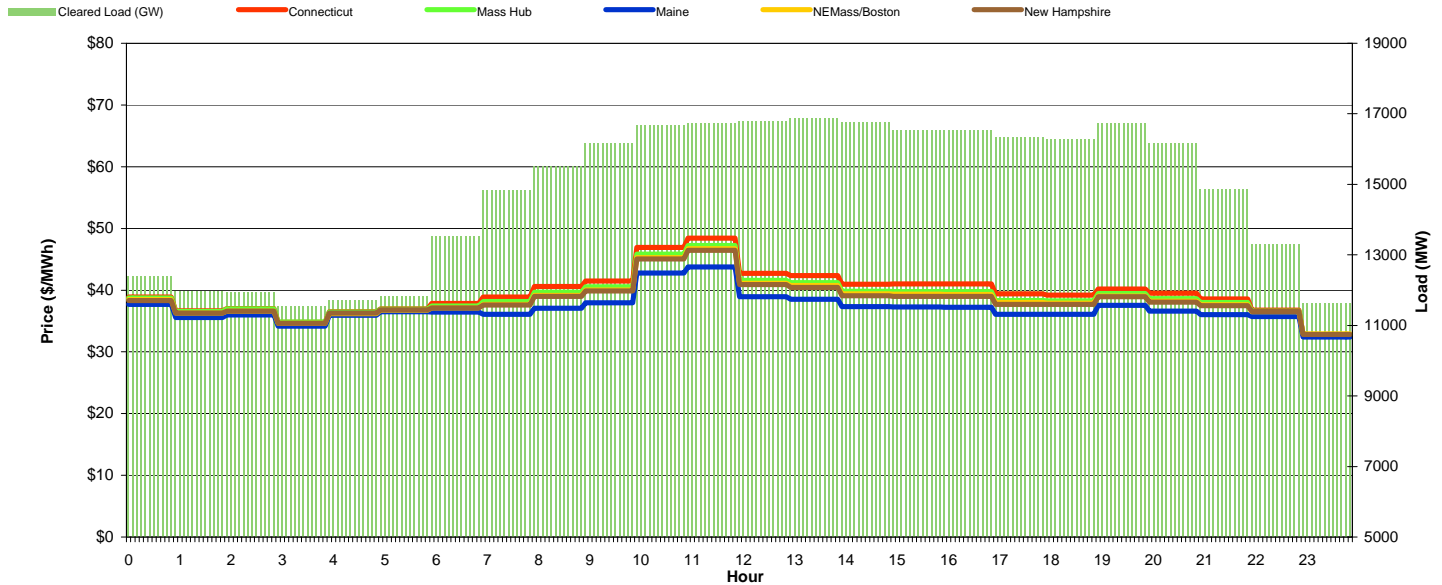

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	49.21	41.42	54.14	46.45	55.78	38.03	66.72	52.25	56.15	54.88	60.23	70.99	65.72	49.12	36.80	36.91	38.66	38.61	37.84	37.51	37.39	37.04	31.26	29.28	46.77	46.34	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	48.60	40.61	53.10	45.76	54.91	37.26	65.39	50.83	54.07	52.87	58.27	68.73	65.22	57.25	50.57	50.37	43.16	37.48	36.78	36.55	36.28	36.25	30.82	29.18	47.51	47.84		
<b>New Hampshire</b>	48.31	40.32	52.81	45.66	54.77	37.03	64.67	50.37	53.75	52.50	57.81	68.65	62.99	47.14	35.26	35.29	36.79	36.97	36.40	36.20	35.96	35.86	30.42	28.81	45.20	44.52		
<b>Maine</b>	47.21	39.03	51.29	44.99	54.04	35.94	62.65	48.23	51.21	49.47	53.69	63.84	58.90	44.47	33.31	33.35	34.79	35.08	34.44	34.35	34.15	34.19	28.94	27.50	43.13	42.03		
<b>Mass Hub</b>	48.61	40.71	53.42	46.01	55.22	37.43	65.48	51.01	54.39	53.16	58.42	68.79	63.53	47.85	35.88	35.92	37.50	37.61	36.93	36.69	36.49	36.37	30.84	29.12	45.72	45.09		
<b>DA Forecast Load (GW)</b>	12.85	12.18	11.74	11.53	11.66	12.66	14.46	15.81	16.43	17.00	17.50	17.72	17.65	17.73	17.64	17.44	17.26	17.07	16.88	17.08	16.54	15.22	13.64	12.16				
<b>Forecast Error %</b>	5.7%	7.9%	11.5%	13.6%	13.9%	8.2%	4.6%	4.1%	4.5%	4.3%	4.9%	5.9%	6.7%	5.6%	3.5%	2.1%	1.8%	1.4%	0.8%	-0.2%	-1.2%	-1.2%	-1.5%	-0.1%				

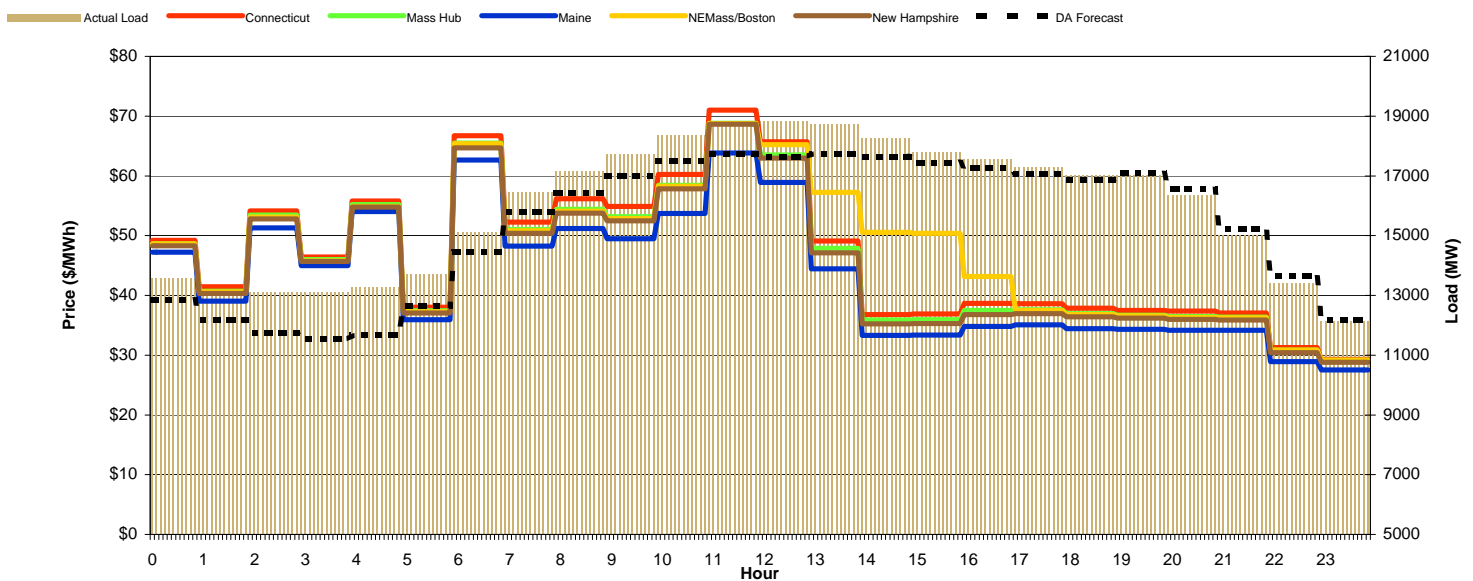




# ISO-NE Daily Report

Friday September 16, 2011

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	34.86	34.23	33.10	31.94	31.86	33.33	37.39	38.81	38.80	40.34	40.60	41.04	42.00	41.99	42.09	41.64	42.14	40.86	40.91	48.06	41.00	38.37	37.65	35.30	38.68	41.02	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	34.61	33.93	32.97	31.87	31.83	33.20	36.96	37.81	37.70	39.14	39.32	39.64	40.38	40.44	40.05	39.54	39.40	39.38	39.37	46.30	39.62	37.28	36.96	35.13	37.62	39.52		
<b>New Hampshire</b>	34.49	33.86	32.84	31.72	31.68	33.19	37.21	37.90	37.80	39.29	39.46	39.74	40.41	40.39	39.99	39.46	39.38	39.46	39.50	46.50	39.79	37.32	37.19	35.12	37.65	39.60		
<b>Maine</b>	33.10	32.43	31.53	30.45	30.47	31.93	35.94	36.10	36.09	37.54	37.49	37.73	38.38	38.45	38.05	37.60	37.65	37.52	37.53	43.80	38.01	35.67	35.93	34.10	35.98	37.72		
<b>Mass Hub</b>	34.66	34.00	32.95	31.82	31.76	33.13	37.17	38.12	37.78	39.40	39.62	39.97	40.76	40.82	40.37	39.83	39.60	39.74	39.74	46.82	40.00	37.40	36.92	35.11	37.81	39.81		
<b>Cleared Load (GW)</b>	10.6	10.6	10.2	10.0	10.0	10.5	12.1	13.5	13.7	14.2	14.8	15.1	15.2	15.2	15.1	14.9	14.9	14.9	14.9	15.0	14.5	13.3	12.2	11.1				

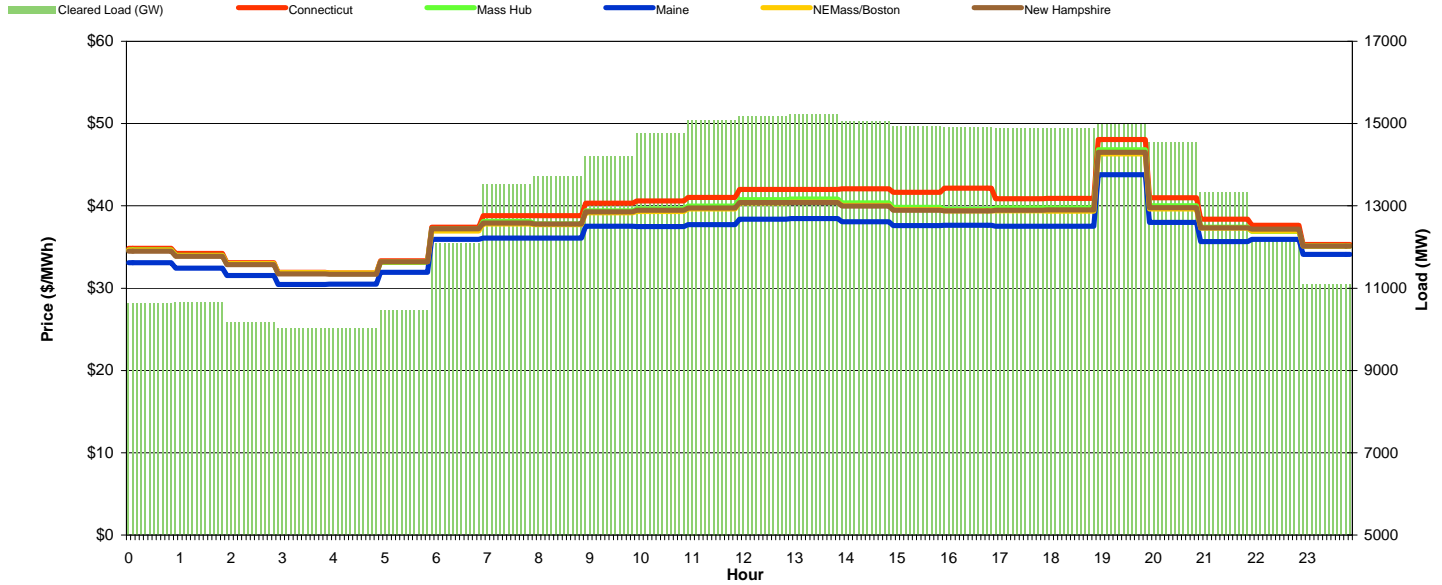

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	33.09	33.93	34.46	33.82	32.83	32.91	35.60	34.56	35.02	35.15	34.69	33.76	32.28	33.11	33.53	33.64	33.12	31.64	32.24	35.30	34.97	33.46	33.39	32.88	33.72	33.74	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	33.06	33.90	34.41	33.75	32.83	32.79	35.24	34.09	34.42	34.48	33.92	32.96	31.59	32.39	32.66	32.79	32.36	31.02	31.57	34.42	34.01	32.80	32.99	32.75	33.22	33.03		
<b>New Hampshire</b>	32.67	33.60	34.17	33.52	32.63	32.66	35.16	33.96	34.34	34.43	33.80	32.78	31.34	32.13	32.41	32.53	32.09	30.81	31.46	34.44	34.01	32.68	32.89	32.66	33.05	32.88		
<b>Maine</b>	31.06	31.85	32.45	31.83	31.14	31.11	33.51	32.44	32.72	32.71	31.82	30.90	29.63	30.41	30.62	30.72	30.47	29.26	29.81	32.83	32.30	30.96	31.31	31.32	31.38	31.18		
<b>Mass Hub</b>	33.00	33.93	34.51	33.86	32.91	32.89	35.30	34.14	34.51	34.61	34.06	33.10	31.69	32.49	32.80	32.92	32.47	31.09	31.66	34.60	34.23	32.95	33.05	32.73	33.31	33.15		
<b>DA Forecast Load (GW)</b>	10.75	10.20	9.86	9.80	10.02	10.93	12.73	13.99	14.61	15.05	15.35	15.53	15.51	15.51	15.35	15.19	15.07	14.94	14.80	15.41	15.01	14.02	12.76	11.49				
<b>Forecast Error %</b>	3.7%	10.9%	15.3%	14.8%	11.7%	7.6%	-0.5%	-1.5%	-1.9%	-2.5%	-2.5%	-3.1%	-3.1%	-3.0%	-2.8%	-2.4%	-2.1%	-2.1%	-1.9%	-2.4%	-1.8%	-0.7%	0.0%	0.1%				

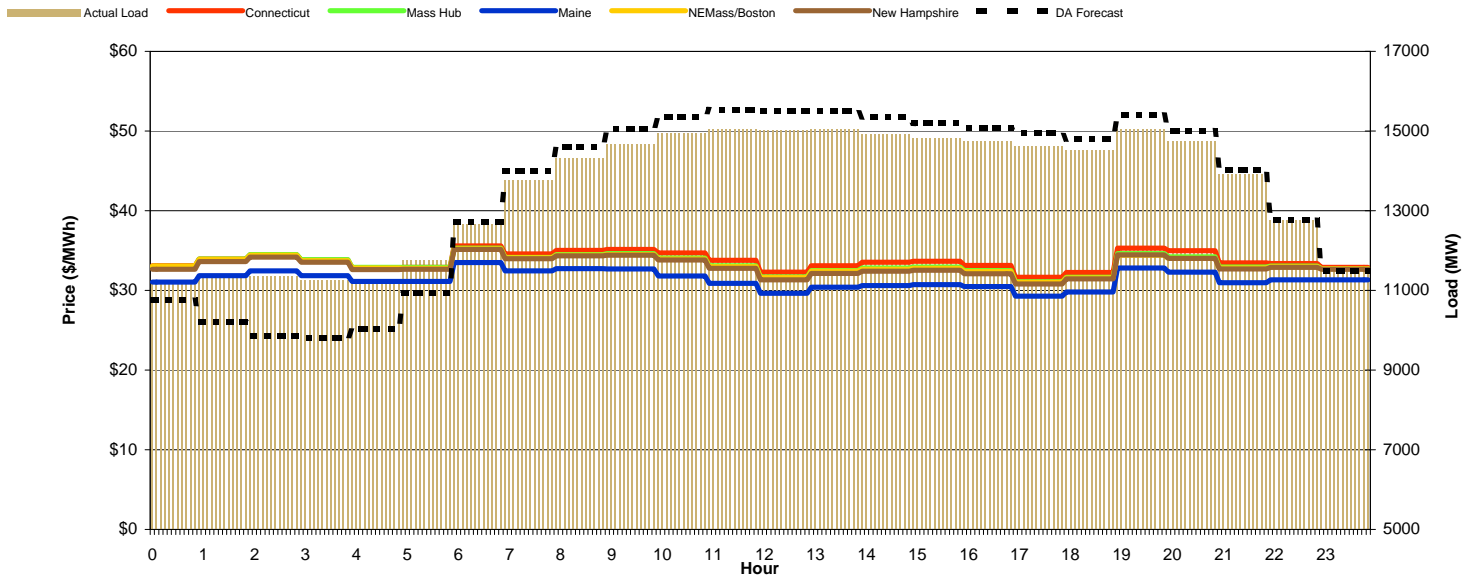






# ISO-NE Daily Report

Saturday September 17, 2011

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$	
<b>Connecticut</b>	35.12	33.65	30.79	31.44	30.99	31.18	33.27	35.24	36.44	40.21	39.67	40.18	39.48	39.95	41.10	39.06	38.33	39.82	42.80	44.56	40.60	38.47	35.38	34.33	37.17	39.46
<b>NEMass/Boston</b>	35.24	33.94	31.36	31.78	31.46	31.55	33.58	35.08	36.10	39.61	39.05	39.53	38.83	39.34	39.45	38.54	37.74	39.18	42.05	44.02	40.12	37.93	35.19	34.51	36.88	38.86
<b>New Hampshire</b>	35.20	33.90	31.20	31.72	31.37	31.54	33.72	34.95	35.94	39.42	38.77	39.24	38.54	39.14	39.19	38.32	37.40	38.85	41.71	43.55	39.82	37.76	34.94	34.28	36.69	38.60
<b>Maine</b>	34.14	33.00	30.38	30.96	30.66	30.87	32.91	33.58	34.33	37.54	37.05	37.45	36.80	37.18	37.19	36.46	35.66	36.96	39.60	41.16	37.95	35.93	33.38	32.81	35.16	36.76
<b>Mass Hub</b>	35.29	33.96	31.25	31.76	31.37	31.53	33.57	35.00	36.11	39.73	39.15	39.61	38.88	39.37	39.31	38.55	37.82	39.26	42.15	44.01	40.10	37.95	35.14	34.49	36.89	38.88
<b>Cleared Load (GW)</b>	10.4	10.0	9.7	9.7	9.7	9.7	10.3	10.8	11.9	12.6	13.0	13.0	13.0	12.9	12.8	12.8	12.9	13.0	13.2	13.5	13.3	12.4	11.4	10.7		

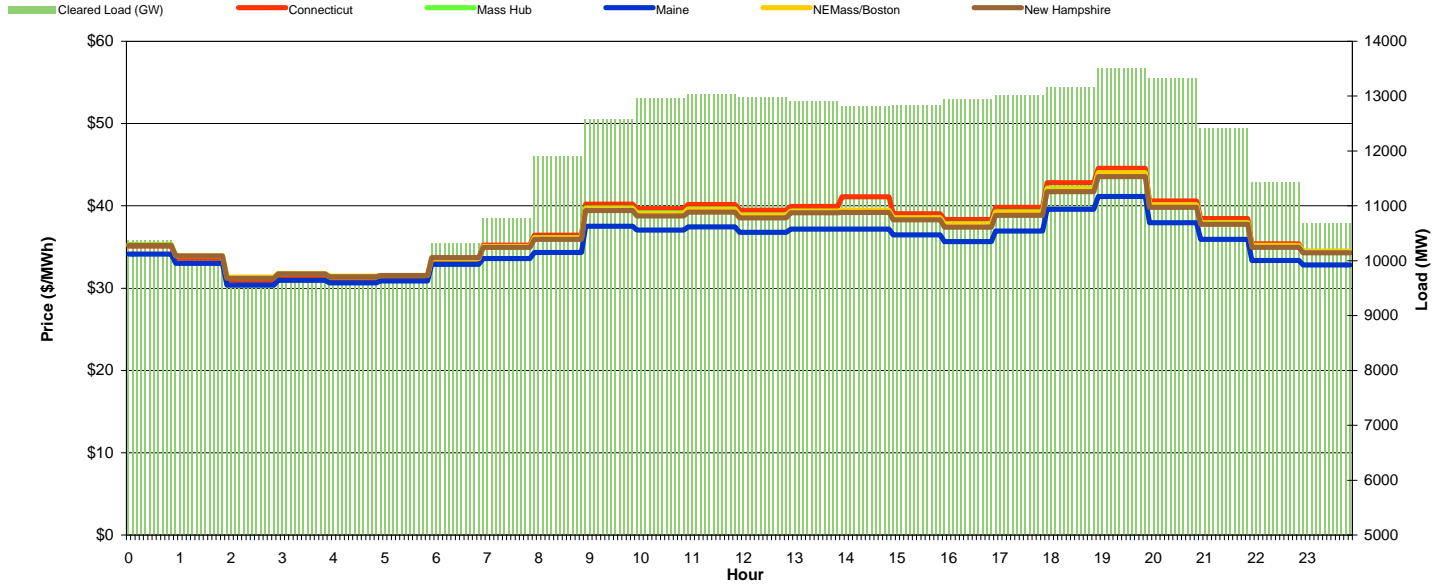

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$	
<b>Connecticut</b>	31.59	30.73	29.85	31.79	29.84	31.60	30.92	32.58	33.34	34.89	38.39	38.73	39.56	39.29	38.96	36.62	35.72	38.21	40.61	46.79	37.15	34.43	31.66	30.61	35.16	37.31
<b>NEMass/Boston</b>	31.59	30.82	29.94	31.90	29.97	31.74	30.94	32.61	33.24	34.38	34.31	34.12	34.95	34.67	34.26	33.53	33.11	34.23	39.54	46.40	36.84	34.17	31.59	30.62	33.73	35.12
<b>New Hampshire</b>	31.43	30.63	29.77	31.78	29.87	31.66	30.84	32.41	33.00	34.15	33.97	33.71	34.54	34.36	33.96	33.25	32.74	33.91	39.28	46.03	36.54	33.88	31.28	30.42	33.48	34.81
<b>Maine</b>	30.04	29.29	28.45	30.51	28.76	30.56	29.78	31.12	31.46	32.46	32.27	31.92	32.77	32.53	32.22	31.70	31.39	32.49	37.70	43.67	34.97	32.24	29.90	29.06	31.97	33.18
<b>Mass Hub</b>	31.57	30.81	29.95	31.94	29.98	31.74	30.94	32.57	33.23	34.44	34.02	33.75	34.61	34.33	33.93	33.27	32.91	33.94	39.62	46.49	36.91	34.23	31.58	30.60	33.64	34.99
<b>DA Forecast Load (GW)</b>	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00		
<b>Forecast Error %</b>	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!		

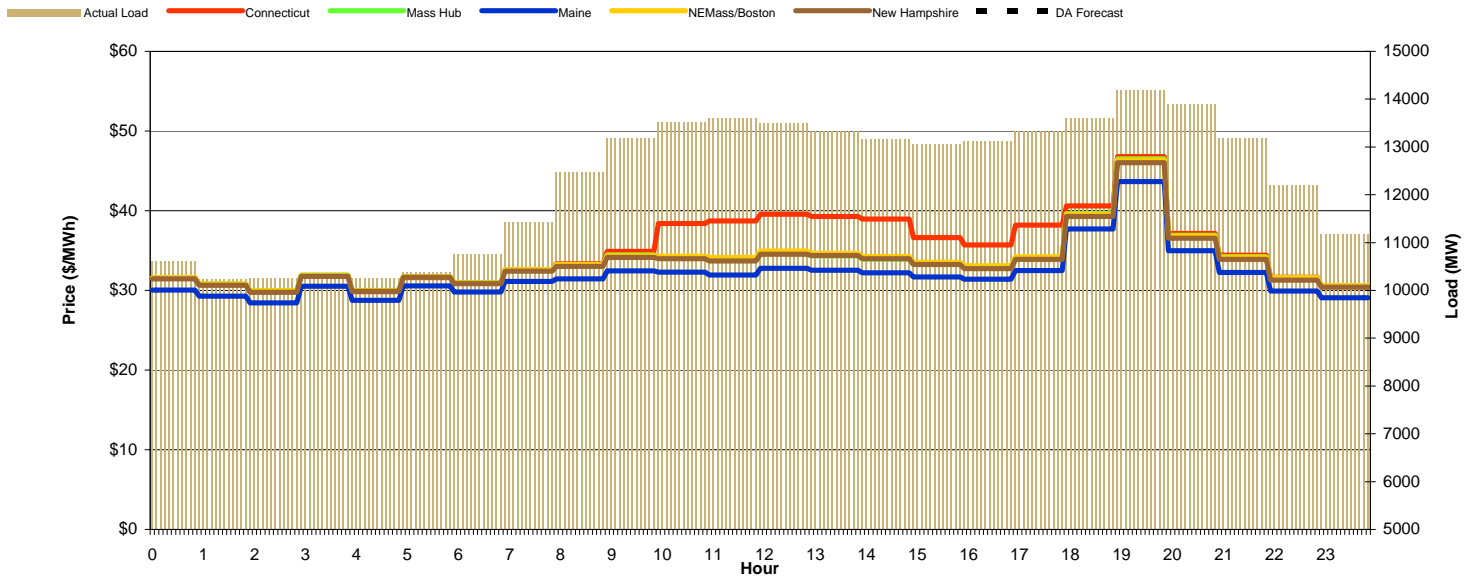




# ISO-NE Daily Report

Sunday September 18, 2011

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	30.19	28.09	25.38	24.73	24.68	25.87	27.89	30.11	31.82	34.58	33.40	35.85	37.16	35.88	35.19	35.86	36.00	34.66	40.00	47.84	42.54	34.01	33.62	32.76	33.25	36.16	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	30.40	28.26	25.47	24.86	24.84	25.97	28.16	30.30	32.17	33.97	32.40	32.88	33.19	32.85	32.70	32.84	32.97	34.55	39.90	47.68	42.29	33.94	33.77	33.08	32.48	34.90		
<b>New Hampshire</b>	30.28	28.06	25.36	24.75	24.74	25.89	28.10	30.34	32.38	34.05	32.14	32.56	32.83	32.45	32.29	32.45	32.60	34.27	39.66	47.28	41.97	33.77	33.62	33.03	32.29	34.67		
<b>Maine</b>	29.19	27.00	24.35	23.91	23.91	25.00	27.35	29.53	31.56	32.94	31.00	31.42	31.62	31.25	31.00	31.13	31.33	32.79	37.85	44.56	39.98	32.26	32.07	31.87	31.04	33.27		
<b>Mass Hub</b>	30.42	28.25	25.57	24.92	24.89	26.07	28.12	30.23	32.07	33.78	32.21	32.47	32.60	32.38	32.31	32.39	32.50	34.58	39.98	47.76	42.42	33.97	33.72	33.01	32.36	34.71		
<b>Cleared Load (GW)</b>	9.9	9.6	9.7	9.7	9.7	9.6	9.6	9.7	10.9	11.8	12.3	12.7	12.7	12.7	12.6	12.6	12.8	13.0	13.5	13.7	13.4	12.7	11.5	10.5				

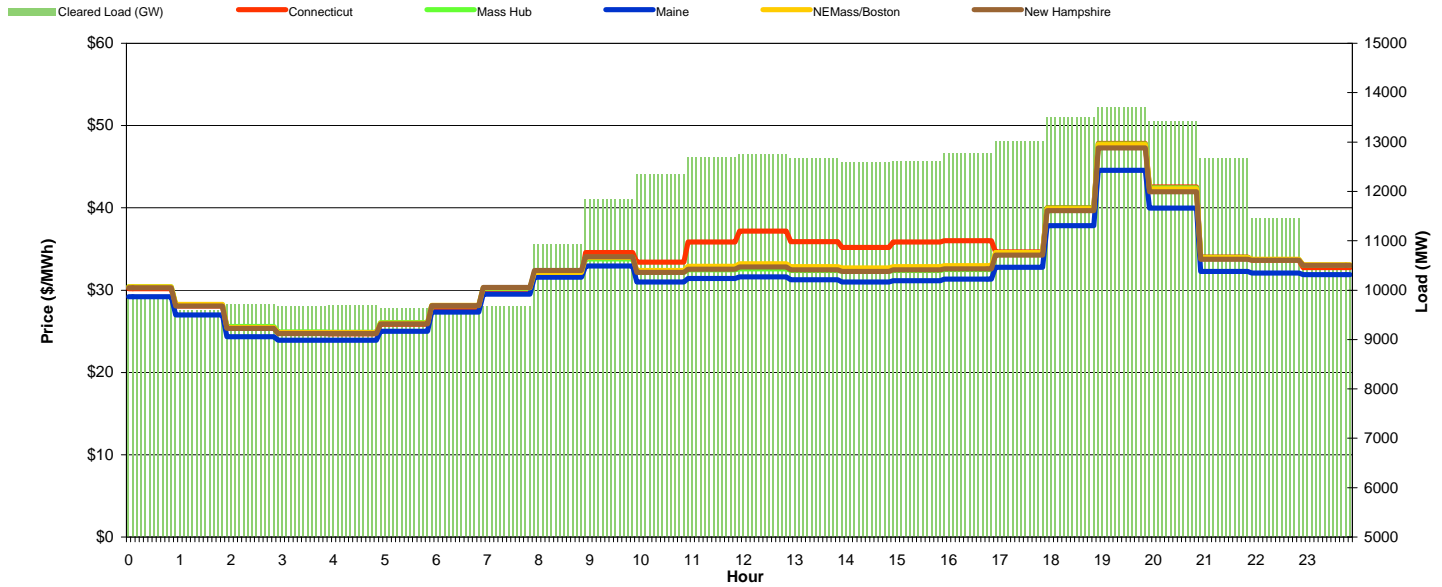

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	30.34	29.47	29.83	31.07	30.87	30.13	29.41	32.05	35.77	33.01	32.69	33.95	34.09	33.52	33.15	33.00	33.49	34.38	34.92	40.26	36.30	31.97	30.68	26.19	32.52	33.95	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	30.37	29.54	29.86	31.11	30.94	30.24	29.66	32.22	35.65	33.11	32.73	33.90	34.02	33.48	33.13	33.07	33.53	34.41	35.02	40.49	36.43	32.08	30.91	26.45	32.60	34.01		
<b>New Hampshire</b>	30.25	29.38	29.75	31.05	30.95	30.25	29.66	32.31	35.78	33.06	32.58	33.70	33.80	33.20	32.82	32.79	33.27	34.19	34.82	40.24	36.17	31.80	30.54	26.25	32.44	33.82		
<b>Maine</b>	28.99	28.21	28.63	29.97	29.99	29.35	28.80	31.39	34.51	31.81	31.36	32.45	32.51	31.97	31.49	31.55	32.10	33.00	33.65	38.79	34.83	30.49	29.22	25.34	31.27	32.57		
<b>Mass Hub</b>	30.39	29.54	29.91	31.18	31.01	30.30	29.64	32.23	35.76	33.12	32.75	33.97	34.09	33.54	33.18	33.09	33.57	34.46	35.04	40.42	36.39	32.03	30.82	26.35	32.62	34.03		
<b>DA Forecast Load (GW)</b>	10.37	9.82	9.50	9.38	9.37	9.63	10.00	10.69	11.63	12.37	12.84	13.09	13.21	13.08	13.05	13.02	13.25	13.61	14.16	14.71	14.26	13.30	12.08	10.95				
<b>Forecast Error %</b>	1.7%	2.7%	7.1%	8.7%	10.1%	7.2%	2.4%	-0.9%	0.2%	0.9%	0.7%	0.6%	0.4%	0.9%	0.7%	1.2%	1.2%	0.8%	-1.2%	-0.1%	1.0%	0.4%	-0.3%	-0.4%				

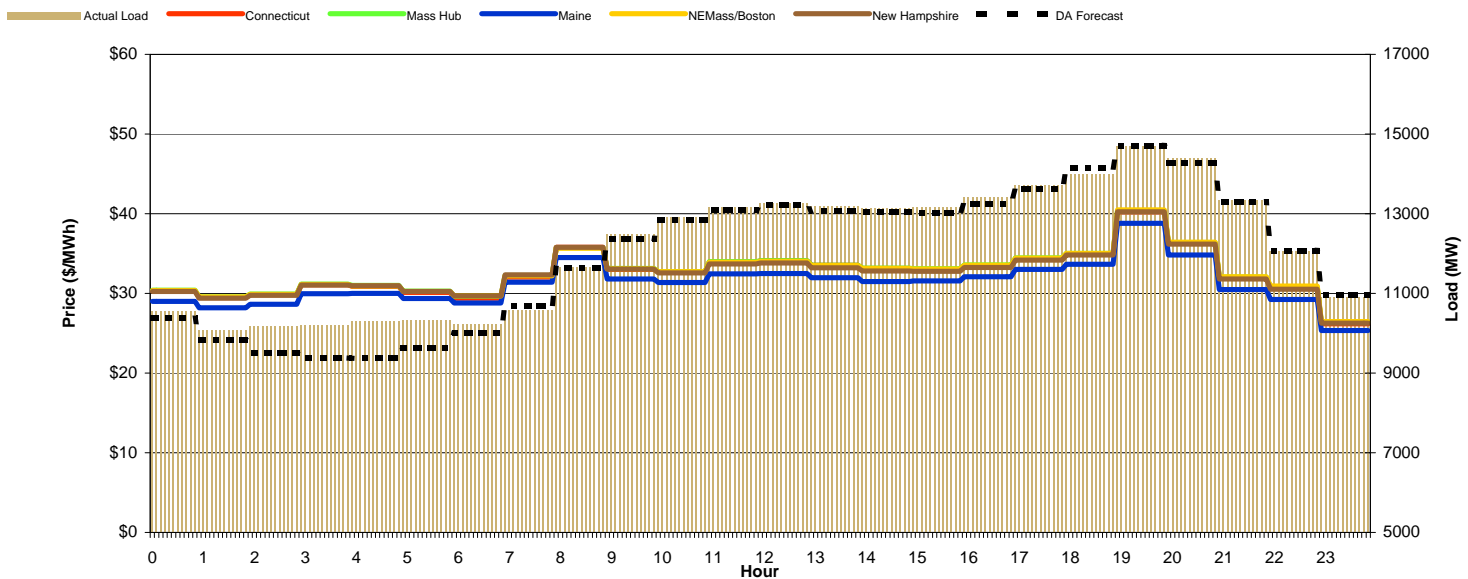




# ISO-NE Daily Report

Monday September 19, 2011

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	30.04	21.01	17.85	15.48	21.00	31.98	34.43	35.79	38.20	38.57	38.64	36.97	39.07	38.31	38.88	39.27	38.91	38.66	41.44	48.20	40.90	36.46	33.95	31.83	34.41	38.89	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	29.94	21.16	17.80	15.44	20.95	31.76	34.58	35.85	38.13	38.50	38.53	36.96	39.06	38.51	38.98	39.23	38.95	38.73	40.51	48.24	40.17	36.33	34.21	31.55	34.34	38.81		
<b>New Hampshire</b>	29.85	21.07	17.69	15.37	20.83	31.81	34.93	36.04	38.07	38.30	38.37	36.73	38.70	38.16	38.61	38.81	38.58	38.38	40.11	47.74	39.85	36.15	34.31	31.55	34.17	38.56		
<b>Maine</b>	28.75	20.40	17.15	15.02	20.37	30.99	34.50	35.59	36.98	37.07	37.27	35.84	37.64	37.12	37.55	37.57	37.34	37.15	38.76	45.53	38.48	34.73	33.32	30.52	33.15	37.37		
<b>Mass Hub</b>	30.11	21.14	17.90	15.52	21.04	32.01	34.73	35.92	38.22	38.54	38.50	36.82	38.98	38.38	38.91	39.16	38.93	38.71	40.46	48.25	40.15	36.46	34.25	31.74	34.37	38.79		
<b>Cleared Load (GW)</b>	9.7	9.3	9.8	9.7	9.7	10.1	12.3	13.2	13.9	14.3	14.7	15.0	15.1	15.2	15.1	15.1	15.1	15.1	15.1	15.6	15.0	13.9	12.6	11.2				

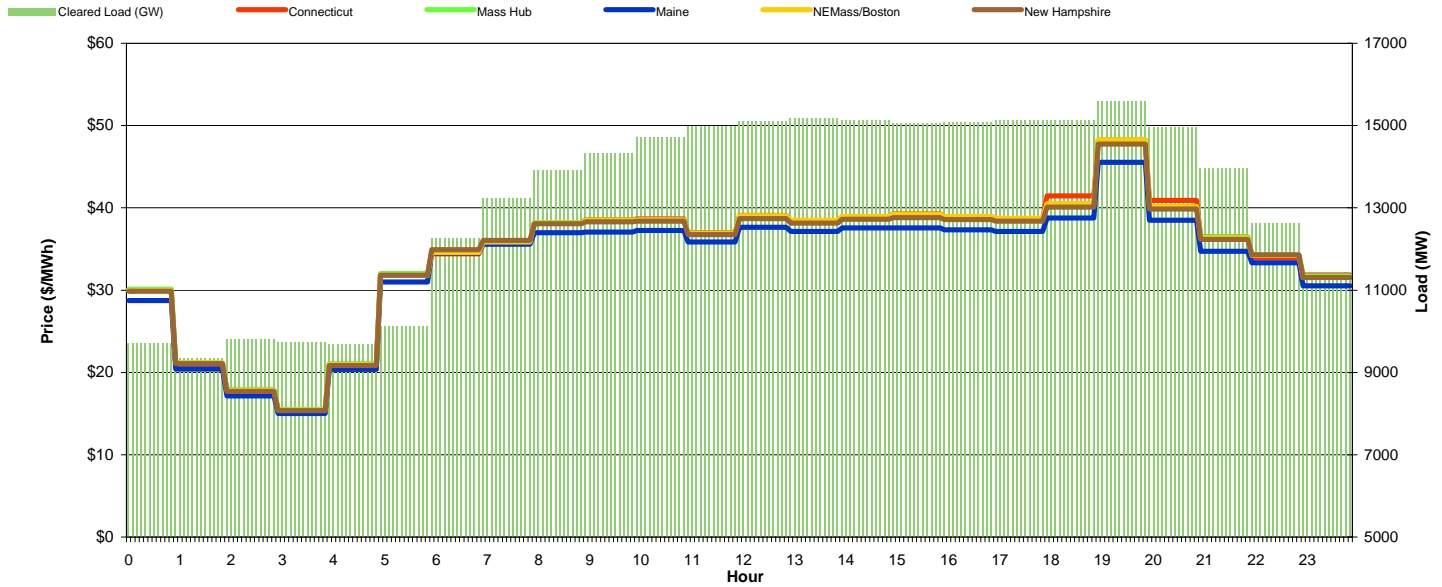

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	24.29	22.38	30.29	29.05	29.80	23.18	30.27	31.08	31.03	33.46	36.77	31.83	33.58	33.92	35.85	34.32	34.90	35.07	39.60	44.27	37.78	31.05	29.11	28.18	32.13	34.60	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	24.39	22.46	30.23	28.90	29.79	23.34	30.48	31.20	31.19	33.59	36.86	32.04	33.68	34.09	35.96	34.38	34.97	35.13	39.64	44.28	37.75	31.01	29.26	28.12	32.20	34.69		
<b>New Hampshire</b>	24.18	22.31	30.15	28.80	29.75	23.34	30.56	31.21	31.14	33.53	36.79	31.82	33.42	33.82	35.64	34.06	34.64	34.84	39.36	43.87	37.50	30.81	29.14	28.03	32.03	34.47		
<b>Maine</b>	23.31	21.57	29.29	28.06	29.22	22.94	30.31	30.73	30.46	32.68	35.76	31.02	32.46	32.87	34.60	33.06	33.67	33.85	38.13	42.35	36.32	29.77	28.25	27.09	31.16	33.50		
<b>Mass Hub</b>	24.36	22.46	30.36	29.06	29.91	23.35	30.46	31.21	31.16	33.55	36.81	31.94	33.61	34.00	35.88	34.30	34.87	35.06	39.60	44.19	37.69	31.01	29.21	28.13	32.17	34.63		
<b>DA Forecast Load (GW)</b>	10.17	9.74	9.54	9.55	9.87	10.94	12.89	14.18	14.73	15.14	15.53	15.74	15.83	15.86	15.77	15.66	15.65	15.73	15.89	16.37	15.81	14.55	12.95	11.55				
<b>Forecast Error %</b>	-0.7%	1.9%	7.2%	6.9%	3.9%	-1.5%	-2.6%	-2.6%	-2.6%	-2.4%	-2.3%	-2.4%	-2.9%	-2.6%	-2.7%	-2.6%	-2.4%	-2.5%	-2.5%	-1.4%	-1.5%	-1.2%	-0.4%	0.0%				

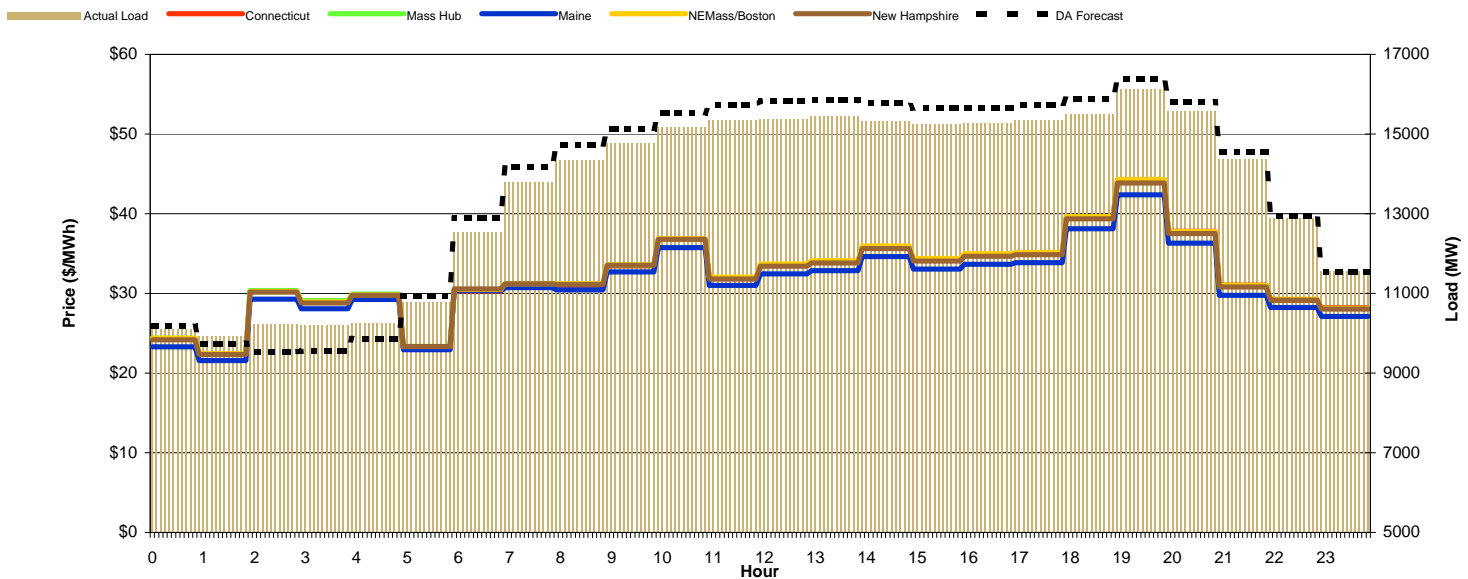




# ISO-NE Daily Report

Tuesday September 20, 2011

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$				
<b>Connecticut</b>	34.52	29.31	28.03	28.01	29.03	35.15	35.77	37.49	39.37	39.08	45.59	49.19	46.44	53.00	53.00	47.00	47.00	44.67	44.48	59.88	47.81	39.56	36.31	35.80	35.80	41.06	45.62	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	33.97	29.41	28.37	28.40	29.28	34.77	35.54	37.09	38.72	38.50	44.90	48.75	46.07	46.95	44.91	43.99	41.71	43.91	44.03	48.10	47.12	39.00	36.08	35.13	39.36	43.11			
<b>New Hampshire</b>	34.08	29.33	28.18	28.18	29.20	34.93	35.64	37.01	38.49	38.33	44.62	48.29	45.67	46.37	44.30	43.46	41.17	43.26	43.44	47.44	46.55	38.57	35.97	35.04	39.06	42.68			
<b>Maine</b>	33.27	28.71	27.61	27.60	28.81	34.20	34.86	36.00	37.00	36.86	42.35	45.30	43.32	44.00	42.28	41.58	39.57	41.44	41.37	44.83	43.67	36.86	35.15	34.09	37.53	40.72			
<b>Mass Hub</b>	34.20	29.41	28.26	28.23	29.17	35.00	35.78	37.26	39.05	38.78	45.15	48.91	46.13	47.02	44.97	44.10	41.60	43.74	44.02	48.03	47.21	39.17	36.17	35.41	39.45	43.21			
<b>Cleared Load (GW)</b>	10.3	9.8	9.5	9.4	9.6	10.5	12.4	13.6	14.2	14.7	15.0	15.1	15.0	15.2	15.2	15.2	15.2	15.3	15.2	15.7	14.7	14.0	12.7	11.3					

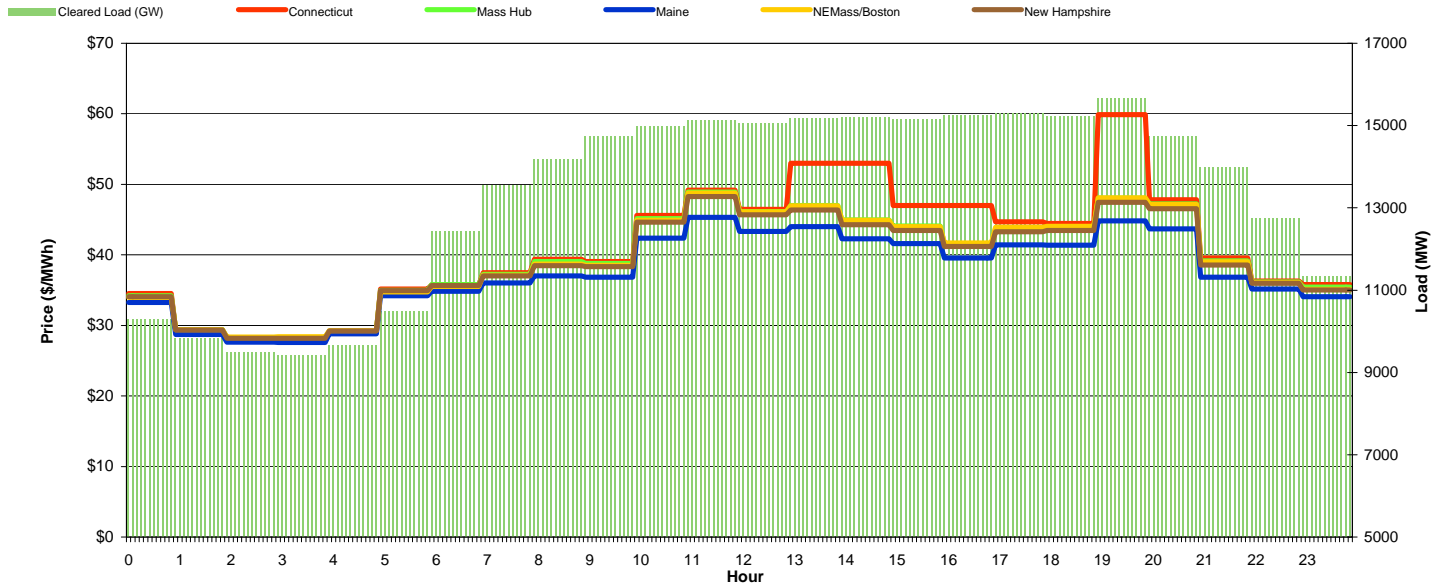

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	31.43	24.86	1.65	0.00	0.00	31.45	35.86	36.24	36.14	38.23	43.47	38.18	41.27	37.79	36.59	37.44	36.71	38.21	50.53	51.13	54.24	33.12	31.07	31.31	33.21	40.02	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	31.19	24.83	1.64	0.00	0.00	31.21	35.47	35.90	35.64	37.75	42.96	37.89	40.99	37.54	36.45	37.27	36.66	38.16	49.76	49.14	51.53	32.97	31.10	31.08	32.80	39.48		
<b>New Hampshire</b>	31.13	24.74	1.64	0.00	0.00	31.19	35.42	35.92	35.63	37.76	42.85	37.74	40.76	37.20	36.07	36.86	36.25	37.67	49.19	48.55	51.03	32.64	30.83	30.85	32.58	39.18		
<b>Maine</b>	30.46	24.25	1.60	0.00	0.00	30.53	34.54	35.10	34.67	36.56	41.27	36.44	39.30	36.03	35.05	35.76	35.11	36.30	46.36	46.05	47.77	31.26	30.01	30.02	31.44	37.69		
<b>Mass Hub</b>	31.26	24.84	1.64	0.00	0.00	31.26	35.58	36.00	35.75	37.94	43.14	37.98	41.07	37.59	36.39	37.22	36.54	38.05	49.66	48.84	51.31	32.97	31.04	31.15	32.80	39.47		
<b>DA Forecast Load (GW)</b>	10.60	10.13	9.90	9.83	10.07	11.09	13.01	14.31	14.81	15.38	15.82	16.07	16.15	16.26	16.22	16.15	16.23	16.32	16.64	16.82	16.17	14.98	13.43	12.01				
<b>Forecast Error %</b>	0.2%	-0.2%	0.1%	1.9%	1.3%	-0.5%	-0.6%	-0.3%	0.5%	-1.2%	-1.7%	-1.8%	-2.2%	-2.8%	-3.1%	-3.1%	-3.0%	-2.7%	-3.1%	-1.4%	-1.0%	-1.1%	-1.2%	-1.1%				

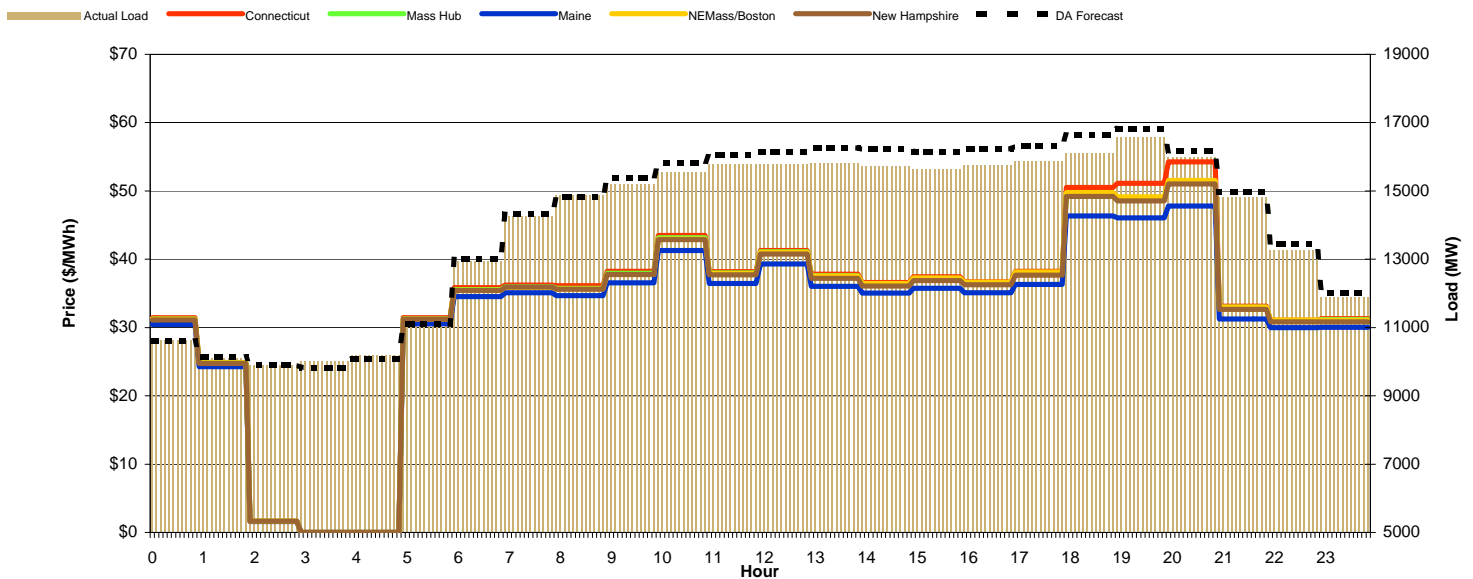




# ISO-NE Daily Report

Wednesday September 21, 2011

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	35.40	30.07	29.04	27.49	29.46	34.66	36.48	38.11	40.00	54.92	57.71	59.28	68.22	63.66	66.56	67.10	64.88	62.32	63.34	64.54	62.77	49.25	37.00	44.58	49.45	57.48	All	On Pk
<b>NEMass/Boston</b>	35.97	30.40	29.26	27.89	29.79	35.36	37.12	38.40	38.63	40.19	44.75	45.00	44.37	43.04	42.85	44.78	43.40	45.00	45.62	47.17	41.65	37.26	37.35	36.97	39.26	42.47		
<b>New Hampshire</b>	35.58	30.17	29.07	27.70	29.69	35.22	36.83	38.20	38.39	40.08	44.59	44.78	44.14	42.71	42.49	44.37	43.18	44.75	45.25	46.76	41.49	36.95	36.91	36.55	38.99	42.19		
<b>Maine</b>	34.75	29.40	28.35	27.24	29.21	34.65	36.14	37.05	36.94	38.32	42.31	42.64	42.19	40.96	40.73	42.25	41.36	42.72	42.89	44.70	39.54	35.35	35.55	35.49	37.53	40.34		
<b>Mass Hub</b>	35.59	30.09	28.98	27.66	29.43	34.92	36.97	38.28	38.63	40.17	44.91	45.03	44.27	42.96	42.74	44.71	43.09	44.88	45.59	47.05	41.62	37.19	37.15	36.99	39.12	42.39		
<b>Cleared Load (GW)</b>	10.0	9.7	9.4	9.5	9.5	10.1	12.6	13.7	14.5	15.0	15.6	16.0	16.1	16.3	16.2	16.1	15.8	15.9	16.0	16.4	15.6	14.7	13.2	11.6				

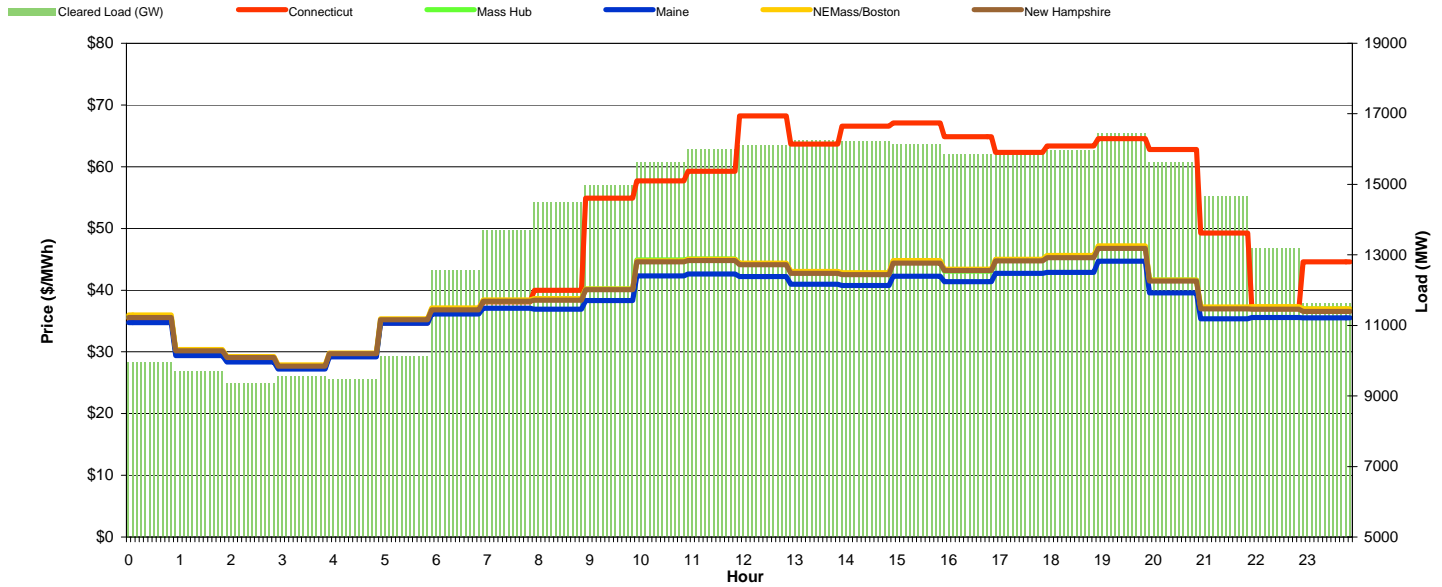

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	42.93	37.12	34.41	29.96	29.47	26.94	35.87	40.15	36.00	35.64	38.31	50.31	48.03	57.22	49.06	43.09	45.85	42.29	35.63	62.99	63.15	45.16	30.74	21.46	40.91	45.23	All	On Pk
<b>NEMass/Boston</b>	43.13	37.59	35.03	30.56	30.01	27.30	36.34	40.51	36.01	35.43	38.15	40.11	39.39	38.91	37.15	39.01	44.29	42.02	35.63	36.66	38.01	32.05	30.76	21.51	36.07	37.76		
<b>New Hampshire</b>	42.80	37.25	34.74	30.34	29.80	27.05	35.95	40.07	35.75	35.34	38.00	39.87	39.11	38.49	36.72	38.54	43.75	41.55	35.31	36.26	37.74	31.71	30.41	21.24	35.74	37.41		
<b>Maine</b>	41.69	36.40	34.07	29.95	29.42	26.42	35.00	38.76	34.59	34.20	36.67	38.27	37.68	36.98	35.42	37.29	42.00	39.82	34.23	35.02	36.05	30.35	29.21	20.37	34.58	36.03		
<b>Mass Hub</b>	43.13	37.49	34.89	30.43	29.90	27.19	36.09	40.25	35.89	35.44	38.16	40.18	39.41	38.94	37.09	38.83	44.12	41.95	35.50	36.37	37.85	31.87	30.65	21.44	35.96	37.66		
<b>DA Forecast Load (GW)</b>	10.86	10.33	10.04	10.00	10.22	11.26	13.15	14.63	15.30	15.88	16.40	16.72	16.87	17.14	17.11	17.09	17.14	17.01	16.90	17.28	16.81	15.59	13.99	12.52				
<b>Forecast Error %</b>	2.8%	3.4%	4.4%	5.2%	5.2%	2.2%	-0.4%	-2.1%	-2.4%	-2.7%	-2.7%	-2.7%	-2.7%	-2.7%	-2.5%	-2.8%	-3.2%	-3.1%	-2.3%	-0.6%	-0.8%	-0.3%	0.2%	0.6%				

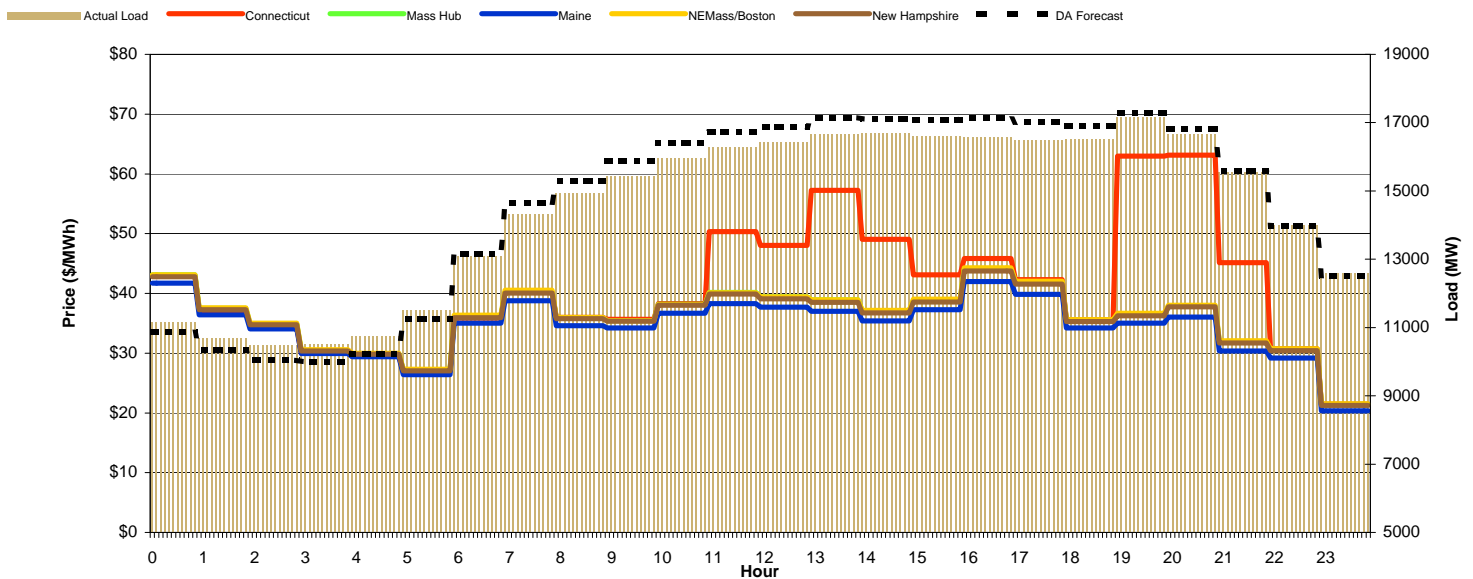




# ISO-NE Daily Report

Thursday September 22, 2011

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	32.41	30.46	28.45	29.25	29.71	32.29	36.85	39.91	41.00	47.92	51.60	52.67	53.00	55.00	57.00	60.00	59.74	53.00	55.00	60.00	58.84	48.56	37.00	36.51	45.26	51.89	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	32.60	30.56	28.53	29.25	29.74	32.47	36.84	39.87	38.48	47.63	48.21	48.23	48.27	47.00	46.59	47.95	47.79	45.26	48.76	52.09	45.19	39.01	36.90	35.74	40.96	45.45		
<b>New Hampshire</b>	32.54	30.44	28.44	29.20	29.76	32.50	37.00	39.85	38.48	47.54	48.03	48.02	47.80	46.61	46.19	47.49	47.28	44.91	48.31	51.63	45.00	38.80	36.75	35.66	40.76	45.17		
<b>Maine</b>	31.41	29.07	27.33	28.15	28.84	31.48	36.27	38.44	37.08	44.62	45.13	45.20	45.32	44.43	44.06	45.01	44.89	43.00	45.62	49.14	42.73	37.04	35.42	34.58	38.93	42.95		
<b>Mass Hub</b>	32.73	30.69	28.67	29.39	29.87	32.61	37.00	40.00	38.69	47.68	48.00	48.00	47.57	46.56	46.00	47.53	47.20	44.76	48.43	51.71	45.10	39.00	37.02	35.99	40.84	45.20		
<b>Cleared Load (GW)</b>	11.5	11.2	10.9	10.8	10.9	11.5	13.4	14.3	15.1	15.4	16.0	16.3	16.5	16.7	16.7	16.6	16.5	16.6	16.9	16.9	16.0	15.0	13.7	12.1				

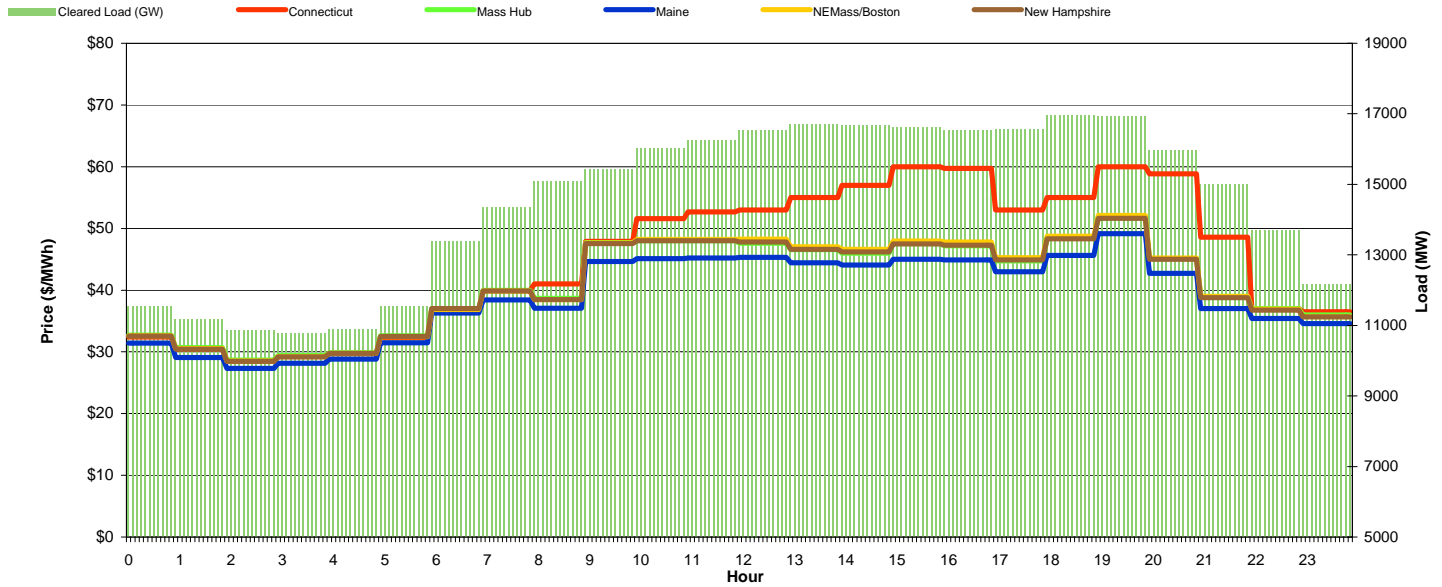

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	30.73	32.22	32.29	32.86	33.21	30.23	35.15	41.28	47.34	50.87	53.95	56.54	54.69	55.81	54.85	54.81	58.20	52.59	66.13	67.38	59.11	41.60	35.38	32.16	46.22	53.16	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	30.74	31.92	31.98	32.53	32.86	30.21	34.97	40.90	46.84	50.64	53.85	54.88	52.98	53.42	52.21	52.40	58.06	41.62	59.07	68.00	56.47	39.98	35.36	32.32	44.76	51.04		
<b>New Hampshire</b>	30.49	31.75	31.88	32.49	32.83	30.04	34.85	40.75	46.57	50.33	53.45	54.34	52.30	52.52	51.29	51.40	56.93	40.87	58.11	66.90	55.71	39.45	34.90	31.88	44.25	50.36		
<b>Maine</b>	29.33	30.33	30.63	31.50	31.87	29.11	33.84	39.41	44.28	47.57	50.43	50.92	49.26	49.44	48.34	48.46	53.05	39.30	55.03	61.96	53.22	37.80	33.53	30.62	42.05	47.63		
<b>Mass Hub</b>	30.76	32.13	32.22	32.78	33.12	30.27	35.02	40.94	46.90	50.69	53.83	54.71	52.72	53.00	51.83	52.01	57.64	41.29	58.56	67.36	56.02	39.82	35.23	32.18	44.63	50.78		
<b>DA Forecast Load (GW)</b>	11.33	10.83	10.53	10.43	10.66	11.74	13.73	14.99	15.61	16.25	16.78	17.10	17.25	17.45	17.43	17.38	17.37	17.33	17.34	17.73	17.22	16.13	14.54	13.06				
<b>Forecast Error %</b>	3.6%	8.0%	9.9%	10.0%	10.1%	6.1%	2.6%	3.3%	3.6%	2.8%	2.2%	1.8%	1.5%	1.3%	1.6%	1.9%	2.3%	2.4%	3.1%	3.4%	3.3%	2.7%	3.3%	3.9%				

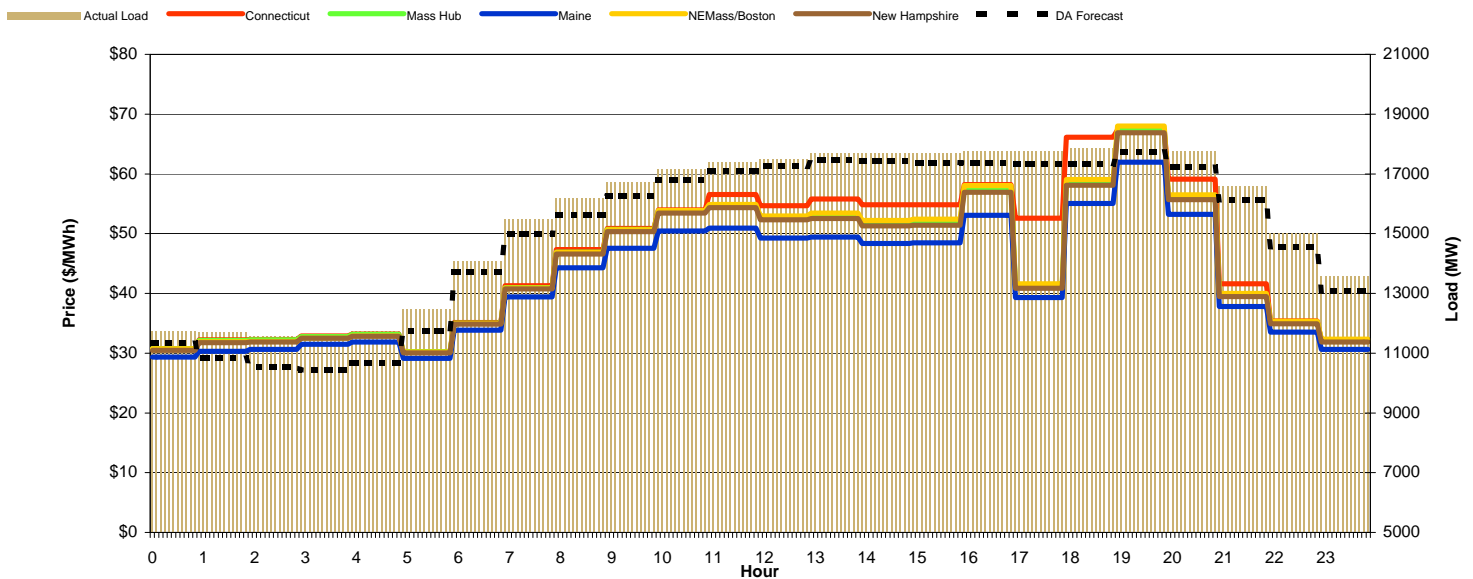




# ISO-NE Daily Report

Friday September 23, 2011

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	31.32	29.36	28.66	28.46	28.69	31.00	36.58	38.66	38.92	47.37	49.62	45.00	50.92	50.15	47.06	48.66	48.29	46.88	43.34	53.02	44.00	37.92	35.90	35.30	40.63	45.36	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	31.45	29.40	28.85	28.77	28.89	31.11	36.74	39.05	39.06	47.56	50.00	50.87	52.23	51.00	47.41	48.82	48.38	46.82	43.48	48.83	44.06	37.86	35.27	34.74	40.86	45.67		
<b>New Hampshire</b>	31.40	29.31	28.76	28.67	28.90	31.18	36.78	38.88	38.83	47.14	49.54	49.60	51.04	49.90	46.63	48.04	47.69	46.17	43.02	48.24	43.67	37.50	34.74	34.64	40.43	45.04		
<b>Maine</b>	30.08	28.09	27.69	27.78	28.04	30.23	36.00	38.00	37.53	45.19	47.45	47.77	49.00	47.86	44.83	46.07	45.88	44.38	41.57	46.39	41.97	36.10	32.92	33.23	38.92	43.31		
<b>Mass Hub</b>	31.62	29.56	28.91	28.80	28.99	31.23	36.86	39.14	39.18	47.62	49.97	49.81	51.44	50.48	47.29	48.81	48.38	46.86	43.48	48.86	44.12	37.97	35.53	34.93	40.83	45.56		
<b>Cleared Load (GW)</b>	11.6	11.2	10.8	10.7	10.9	11.6	13.2	14.2	14.9	15.2	15.5	15.9	15.8	15.8	15.6	15.6	15.4	15.6	15.7	15.2	14.2	12.8	11.4					

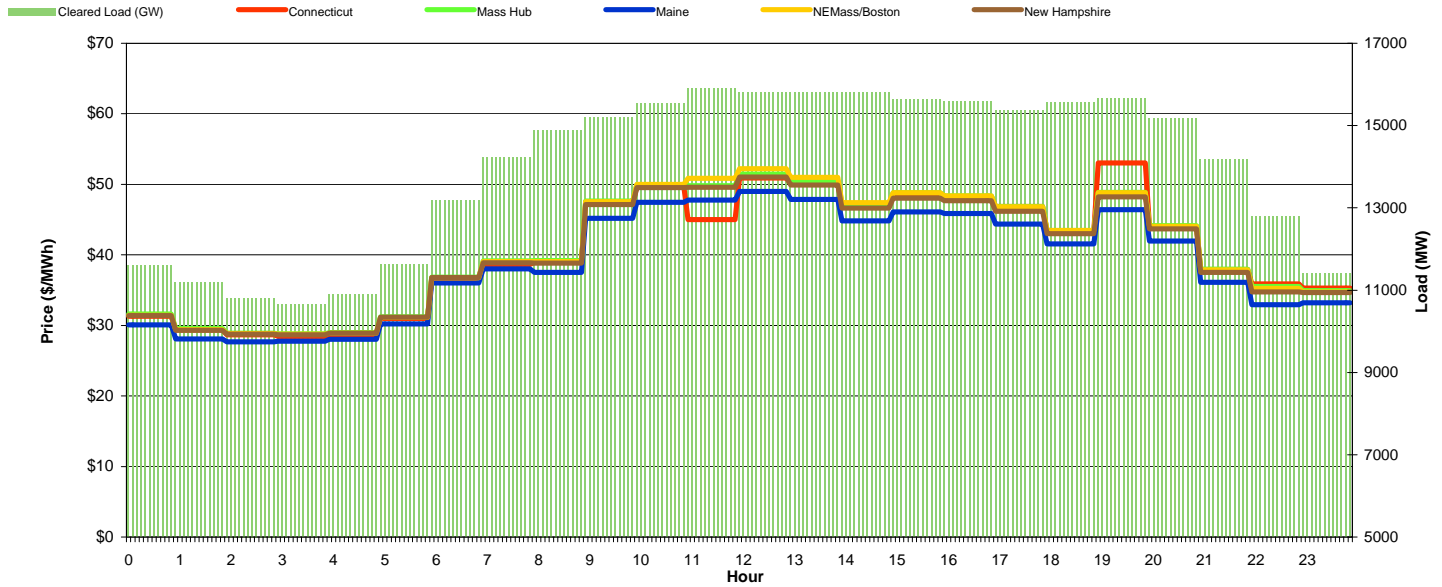

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	32.07	32.78	32.11	32.18	33.46	32.14	35.28	42.23	51.67	53.20	54.19	54.97	55.77	60.83	58.30	50.93	52.83	55.32	54.21	51.02	57.25	48.09	46.26	33.01	46.25	52.94	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	32.17	32.74	32.02	32.07	33.29	32.19	35.25	39.77	48.79	51.42	52.89	55.39	56.24	61.29	58.86	51.35	52.32	54.73	51.90	44.79	52.88	42.21	33.97	33.02	44.65	50.55		
<b>New Hampshire</b>	31.91	32.60	31.95	32.03	33.27	32.06	35.05	39.60	48.46	50.93	52.27	54.70	55.53	60.42	58.15	50.68	51.50	53.88	51.21	44.21	52.42	41.88	33.50	32.73	44.21	49.96		
<b>Maine</b>	30.67	31.28	30.70	31.00	32.30	31.00	33.98	38.01	46.32	48.96	50.14	52.29	53.15	57.87	56.44	48.93	49.09	51.38	49.17	42.67	50.38	40.36	31.92	31.47	42.48	47.94		
<b>Mass Hub</b>	32.10	32.75	32.10	32.16	33.39	32.19	35.17	39.66	48.66	51.15	52.44	54.91	55.75	60.77	58.36	51.01	52.05	54.43	51.60	44.44	52.70	42.15	33.94	32.92	44.45	50.25		
<b>DA Forecast Load (GW)</b>	11.94	11.39	11.07	10.92	11.16	12.16	14.10	15.39	16.06	16.65	17.12	17.31	17.36	17.44	17.29	17.23	17.22	17.01	16.86	17.10	16.51	15.48	14.21	12.88				
<b>Forecast Error %</b>	6.2%	8.1%	10.6%	10.7%	10.2%	7.7%	2.4%	2.5%	2.8%	2.6%	2.4%	2.0%	1.5%	1.3%	0.6%	0.4%	1.6%	2.9%	2.1%	2.4%	3.2%	3.9%	4.9%					

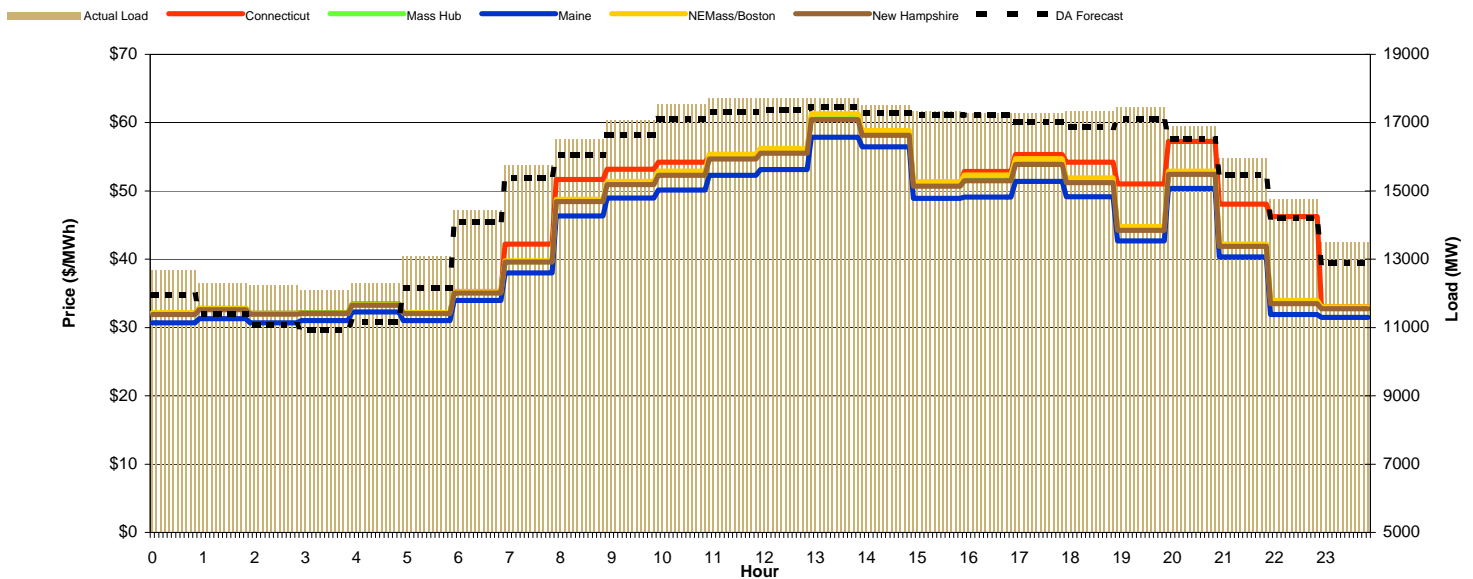




# ISO-NE Daily Report

Saturday September 24, 2011

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	47.30	38.00	34.62	34.46	33.83	36.65	34.58	34.49	40.00	49.45	52.19	52.36	52.21	52.22	61.46	55.00	57.00	57.00	63.59	67.31	51.31	57.20	54.87	36.49	48.07	53.60	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	39.58	35.89	34.70	34.44	33.85	36.84	35.14	34.88	40.57	42.24	49.26	53.43	52.11	51.88	43.59	47.58	48.15	47.00	44.29	51.00	48.58	38.17	37.24	36.91	42.39	45.62		
<b>New Hampshire</b>	39.88	36.16	34.97	34.78	34.22	37.38	35.73	35.22	41.01	42.91	50.05	52.07	50.86	50.58	44.03	48.02	48.65	47.55	43.63	49.70	47.87	38.65	37.43	36.88	42.43	45.51		
<b>Maine</b>	38.78	35.21	33.96	34.00	33.51	36.04	34.76	43.00	39.68	48.00	48.53	49.78	49.00	49.33	48.88	49.06	49.53	48.94	42.84	49.00	47.00	37.93	36.59	35.91	42.47	46.07		
<b>Mass Hub</b>	39.54	35.89	34.73	34.58	33.95	36.89	35.07	34.70	40.25	42.04	49.00	51.04	49.85	49.64	43.33	47.33	47.81	46.63	42.79	48.73	46.95	37.94	36.95	36.78	41.77	44.69		
<b>Cleared Load (GW)</b>	11.4	11.3	11.1	11.1	11.1	11.3	11.4	11.8	13.1	14.0	14.5	14.7	14.8	14.8	14.7	14.9	15.0	15.0	15.2	15.4	14.6	13.7	12.6	11.9				

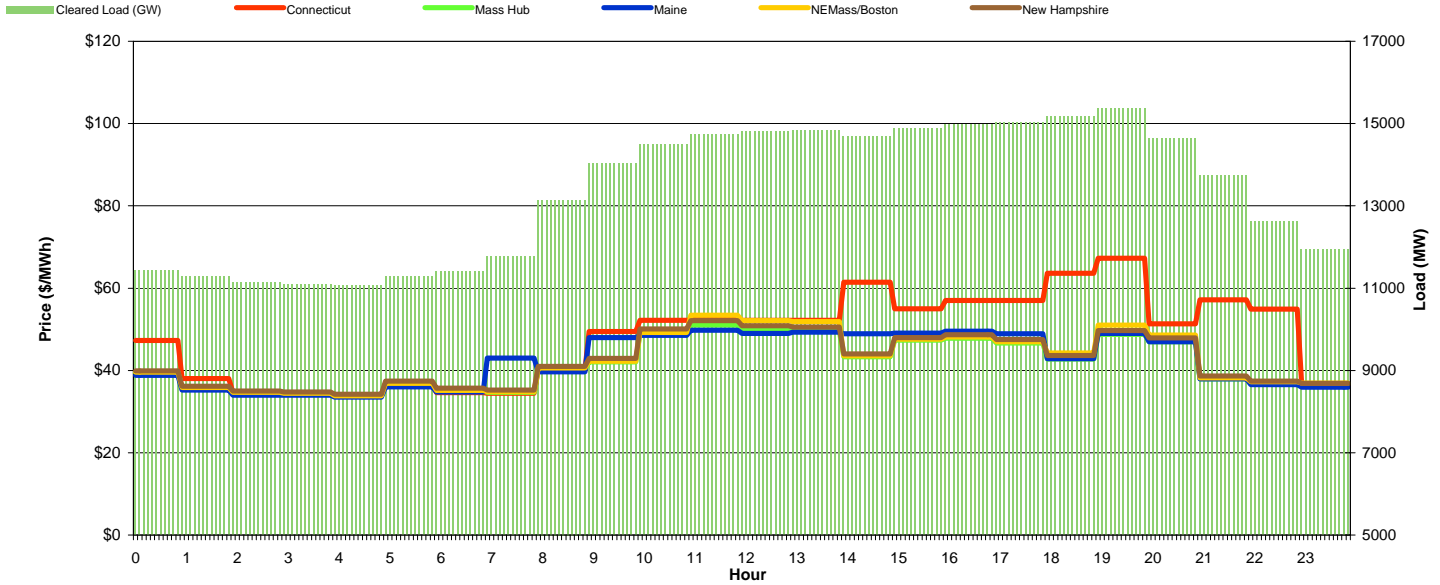

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	58.25	40.34	45.71	62.40	48.33	70.04	48.85	48.54	54.70	68.52	74.29	61.59	70.14	56.39	49.81	54.69	59.87	67.96	113.61	106.23	85.34	57.99	50.68	59.13	63.06	67.52	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	58.60	40.83	46.05	62.70	48.83	71.28	49.77	49.31	55.77	69.66	93.60	71.55	71.54	64.03	53.11	57.75	54.41	50.86	51.55	64.72	62.12	39.45	48.33	60.33	58.17	59.86		
<b>New Hampshire</b>	58.58	41.01	46.30	63.11	49.26	72.13	50.33	49.74	56.18	70.20	91.64	70.64	71.86	63.51	53.08	57.76	54.66	50.90	51.60	64.86	62.50	39.72	48.20	59.85	58.23	59.82		
<b>Maine</b>	57.22	40.21	45.22	62.18	48.69	72.59	50.67	50.05	55.77	69.88	91.96	70.29	71.24	63.34	52.89	57.38	54.20	49.21	49.25	62.21	60.10	38.41	46.61	57.77	57.39	58.92		
<b>Mass Hub</b>	58.31	40.62	45.91	62.64	48.74	71.02	49.50	48.99	55.27	69.11	88.52	68.76	70.73	61.86	52.05	56.73	53.70	50.38	50.97	63.94	61.60	39.17	47.84	59.76	57.34	58.73		
<b>DA Forecast Load (GW)</b>	12.03	11.42	11.07	10.85	10.90	11.32	12.12	13.00	14.16	15.13	15.79	16.10	16.17	16.16	16.04	16.04	16.15	16.21	16.31	16.68	16.19	15.31	14.19	12.98				
<b>Forecast Error %</b>	4.6%	7.9%	8.7%	11.2%	12.9%	10.1%	5.0%	4.3%	3.2%	3.3%	3.2%	3.5%	4.2%	4.2%	4.7%	4.8%	4.6%	4.5%	5.1%	4.8%	4.9%	5.3%	5.8%	7.4%				

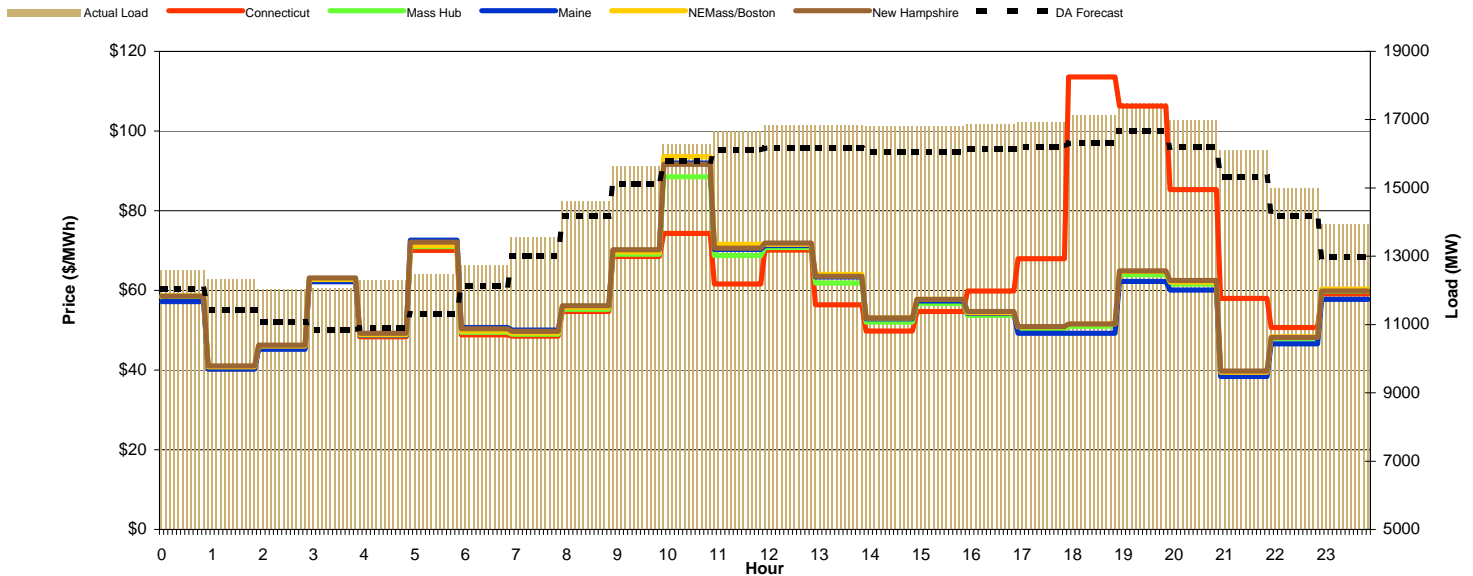






# ISO-NE Daily Report

Sunday September 25, 2011

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	34.97	34.83	34.00	32.42	31.62	32.33	34.54	34.84	34.80	37.26	38.45	47.00	50.00	50.39	53.00	54.00	60.00	60.00	71.49	73.27	67.55	48.17	36.80	35.55	45.30	51.06	All	On Pk
<b>NEMass/Boston</b>	35.48	35.39	34.95	33.20	32.36	33.14	35.20	35.26	35.58	37.85	38.90	44.91	48.68	46.09	48.86	48.66	49.50	49.61	55.95	60.84	48.63	39.24	37.27	35.95	41.73	45.36	41.73	45.36
<b>New Hampshire</b>	35.42	35.62	35.12	33.35	32.50	33.28	35.40	35.36	35.65	38.09	39.22	45.22	48.95	46.42	49.15	48.93	49.74	49.90	56.37	61.01	48.89	39.45	37.26	35.87	41.92	45.60	41.92	45.60
<b>Maine</b>	34.03	34.15	33.47	31.98	31.18	32.03	34.21	34.34	34.69	37.23	38.25	43.81	47.15	45.00	47.44	47.16	48.03	48.15	54.44	59.08	47.01	38.21	36.05	34.53	40.48	44.13	40.48	44.13
<b>Mass Hub</b>	35.49	35.45	35.02	33.24	32.37	33.14	35.08	35.31	35.41	37.73	38.82	44.83	48.56	45.93	48.75	48.56	49.43	49.51	55.86	60.29	48.50	39.07	37.12	35.87	41.64	45.23	41.64	45.23
<b>Cleared Load (GW)</b>	12.5	11.9	11.8	11.6	11.6	11.7	11.6	12.2	12.6	13.7	14.4	14.7	14.8	15.0	14.9	14.9	15.1	15.2	15.3	15.6	15.1	14.1	13.1	12.4				

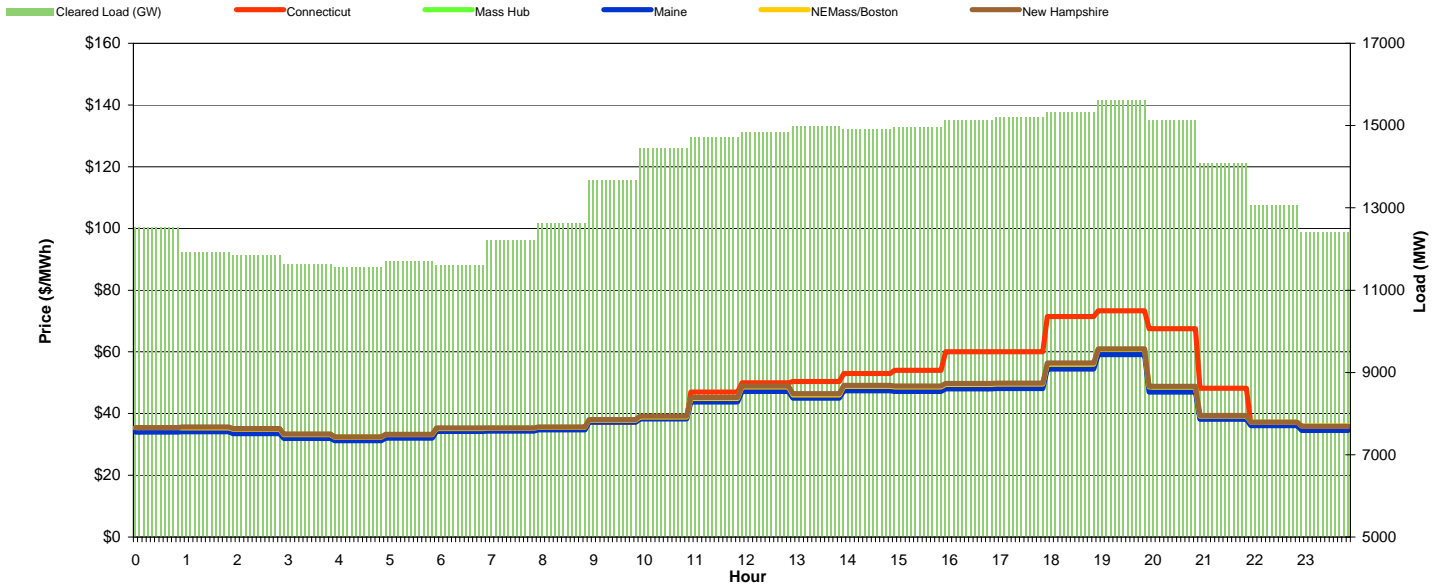

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	34.97	37.31	33.33	32.35	32.45	38.10	45.88	34.43	33.26	34.19	47.88	58.55	62.55	67.24	75.13	108.50	115.92	88.92	90.87	148.04	101.02	61.19	46.94	50.39	61.64	73.41	All	On Pk
<b>NEMass/Boston</b>	35.59	37.98	33.99	33.00	33.16	38.74	46.40	34.97	33.86	34.70	48.42	59.29	62.57	58.09	53.78	49.93	55.99	59.41	61.77	63.44	55.73	43.27	41.55	50.87	46.94	51.05	46.94	51.05
<b>New Hampshire</b>	35.23	37.82	33.91	32.96	33.14	38.76	46.35	34.90	33.95	34.86	48.61	59.37	62.54	58.13	53.75	49.90	55.73	59.15	61.58	61.35	54.96	42.99	40.97	50.16	46.71	50.80	46.71	50.80
<b>Maine</b>	33.69	36.23	32.46	31.76	32.04	37.42	44.78	34.02	33.04	33.95	46.96	57.31	60.31	55.77	51.26	47.29	52.55	56.12	58.64	58.25	52.09	40.67	38.84	47.32	44.70	48.57	44.70	48.57
<b>Mass Hub</b>	35.38	37.80	33.84	32.87	33.02	38.63	46.28	34.76	33.62	34.46	48.09	58.77	61.96	57.46	53.12	49.16	55.30	58.84	61.14	60.39	54.55	42.88	41.13	50.54	46.42	50.35	46.42	50.35
<b>DA Forecast Load (GW)</b>	12.45	11.78	11.38	11.12	11.01	11.25	11.69	12.41	13.48	14.51	15.27	15.78	16.10	16.19	16.20	16.28	16.52	16.77	17.03	17.57	17.05	15.97	14.60	13.30				
<b>Forecast Error %</b>	7.5%	10.9%	12.9%	13.2%	13.5%	12.2%	9.7%	6.1%	5.7%	2.2%	1.2%	2.8%	4.2%	5.4%	5.8%	5.3%	4.0%	3.6%	4.0%	4.2%	3.6%	2.8%	2.5%	5.6%				

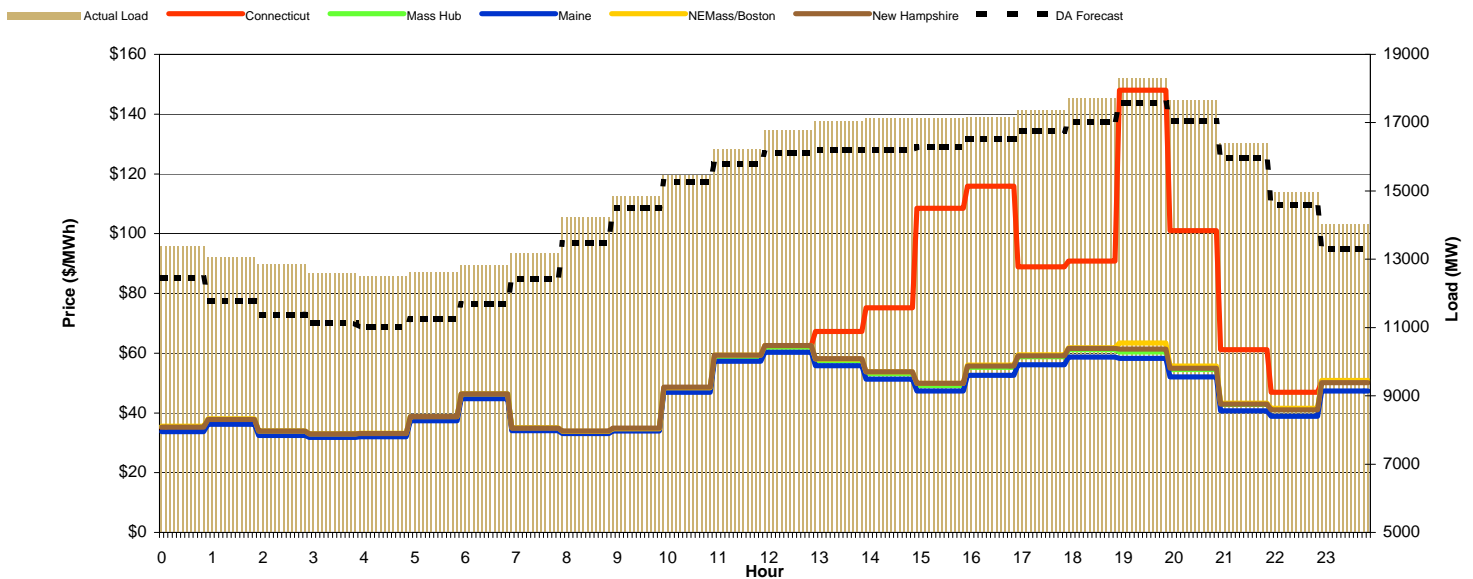




# ISO-NE Daily Report

Monday September 26, 2011

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$	
<b>Connecticut</b>	39.48	33.60	35.07	33.60	34.20	35.57	39.10	44.74	50.07	62.25	77.01	79.47	83.32	83.56	80.53	80.03	78.91	74.01	73.12	75.07	68.36	49.83	39.84	37.00	57.82	68.76
<b>NEMass/Boston</b>	39.87	33.95	35.24	33.75	34.41	35.83	39.20	45.19	50.47	52.84	62.01	65.15	69.58	69.50	67.40	68.47	68.59	61.94	59.61	64.47	57.87	47.82	40.06	36.91	51.67	59.44
<b>New Hampshire</b>	39.68	33.76	35.17	33.64	34.36	35.61	39.26	45.20	50.33	52.67	61.82	64.38	67.23	66.86	66.94	67.93	68.13	61.66	59.34	63.98	57.41	47.61	39.66	36.55	51.22	58.82
<b>Maine</b>	38.00	32.47	33.69	32.18	33.14	34.45	38.24	44.14	49.13	50.50	58.76	61.27	64.08	63.64	63.80	64.80	64.99	58.70	56.74	60.96	52.94	45.73	39.14	35.55	49.04	56.21
<b>Mass Hub</b>	39.91	33.98	35.42	33.91	34.52	35.90	39.26	45.24	50.38	53.00	62.00	64.49	67.52	67.00	67.10	68.14	68.38	62.00	59.50	64.13	58.00	48.00	40.17	36.98	51.46	59.07
<b>Cleared Load (GW)</b>	11.7	11.5	11.5	11.2	11.2	12.0	13.4	14.5	15.0	15.9	16.6	16.9	17.1	17.3	17.2	17.2	17.2	17.1	17.2	17.4	16.8	15.1	13.9	12.3		

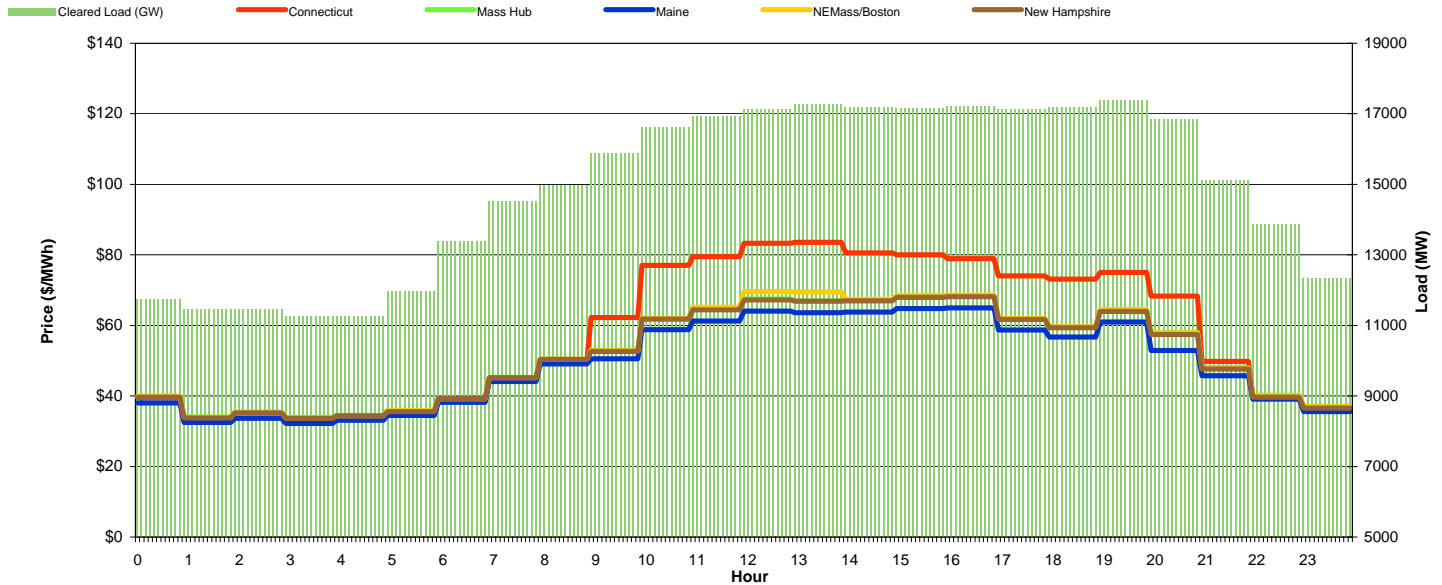

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$	
<b>Connecticut</b>	43.76	38.82	35.57	32.90	34.11	32.89	53.51	54.05	60.17	53.67	58.39	68.58	100.23	132.49	100.05	84.52	79.64	73.13	93.17	110.58	46.53	48.79	42.63	36.71	63.12	75.41
<b>NEMass/Boston</b>	43.93	38.89	35.63	32.90	34.09	32.82	53.42	54.40	60.53	53.92	58.53	66.35	61.39	73.20	88.66	90.14	98.38	88.75	99.69	124.44	52.62	48.97	42.36	36.53	61.27	72.65
<b>New Hampshire</b>	43.44	38.43	35.19	32.48	33.72	32.49	53.00	53.97	60.05	53.50	57.80	65.20	60.24	71.59	86.88	83.05	77.93	71.49	83.25	109.86	46.54	48.46	42.06	36.23	57.37	66.99
<b>Maine</b>	41.08	36.35	33.31	30.77	32.28	31.28	51.13	52.43	58.26	51.56	54.82	61.55	56.64	66.72	81.57	78.16	73.10	67.18	78.59	104.25	44.22	45.96	40.46	34.91	54.44	63.47
<b>Mass Hub</b>	43.80	38.84	35.63	32.93	34.11	32.80	53.19	53.92	60.09	53.61	58.19	65.92	60.72	72.43	87.90	84.19	79.25	72.61	84.13	110.75	46.84	48.76	42.32	36.55	57.90	67.60
<b>DA Forecast Load (GW)</b>	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00		
<b>Forecast Error %</b>	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!		

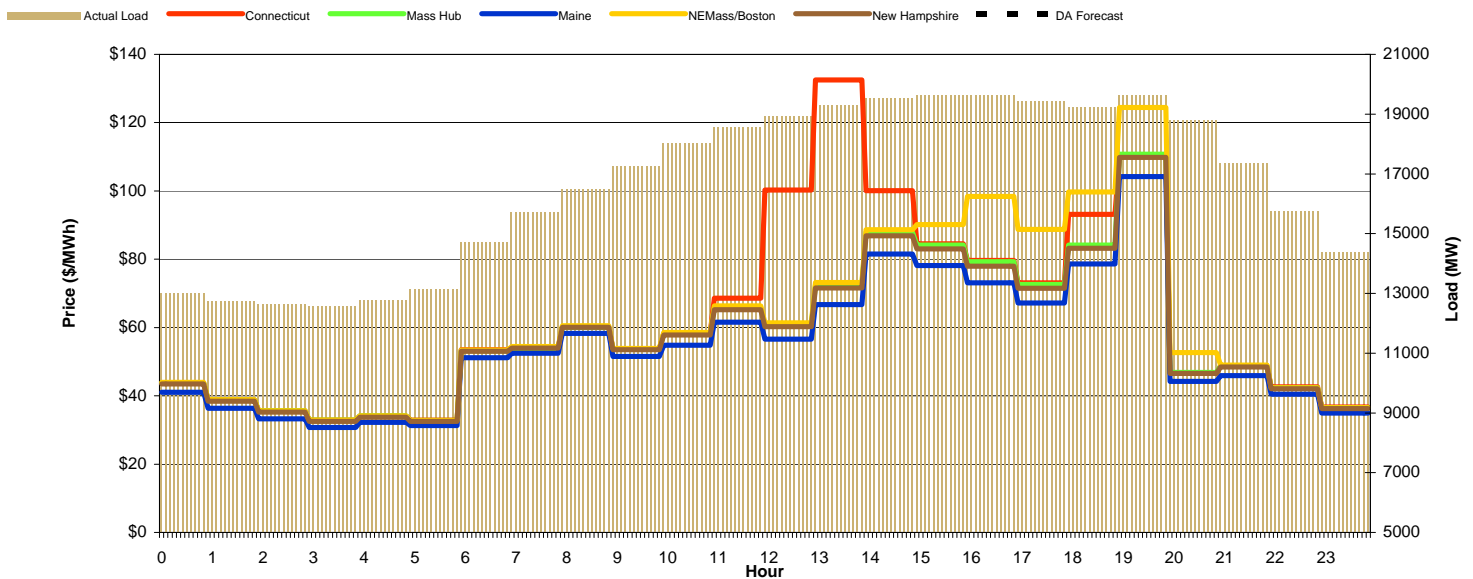




# ISO-NE Daily Report

Tuesday September 27, 2011

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$		
<b>Connecticut</b>	38.18	36.13	35.61	33.24	34.12	36.13	39.99	45.00	50.43	56.81	59.92	59.63	72.00	72.23	72.79	72.00	69.23	57.57	55.15	74.00	56.96	45.84	38.17	36.10	36.10	51.97	59.86
<b>NEMass/Boston</b>	38.50	36.76	35.85	33.32	34.36	36.42	40.15	44.95	50.43	56.78	60.35	60.45	62.41	62.53	60.08	58.51	58.32	57.81	55.52	59.85	56.88	45.53	38.46	36.30	36.30	49.19	55.55
<b>New Hampshire</b>	38.17	36.50	35.66	33.19	34.27	36.25	39.94	44.72	50.28	56.51	59.92	60.03	61.34	61.67	59.28	57.75	57.62	57.33	55.13	59.10	56.61	45.45	37.99	35.95	35.95	48.78	55.05
<b>Maine</b>	37.65	35.82	35.07	32.04	33.17	35.78	39.05	44.78	49.06	54.79	58.00	57.87	62.00	62.61	60.13	58.57	58.26	55.49	53.54	61.83	54.65	44.10	37.33	35.34	35.34	48.21	54.56
<b>Mass Hub</b>	38.74	37.11	36.12	33.60	34.59	36.61	40.28	45.01	50.49	56.82	60.34	60.32	62.99	62.66	60.28	58.65	58.50	57.99	55.66	60.16	57.16	45.91	38.54	36.23	36.23	49.37	55.72
<b>Cleared Load (GW)</b>	12.3	12.1	11.7	11.3	11.5	11.9	13.6	14.5	15.1	15.5	16.2	16.7	17.0	16.9	17.0	16.9	16.8	16.7	16.9	16.9	16.2	15.0	13.5	12.0	12.0		

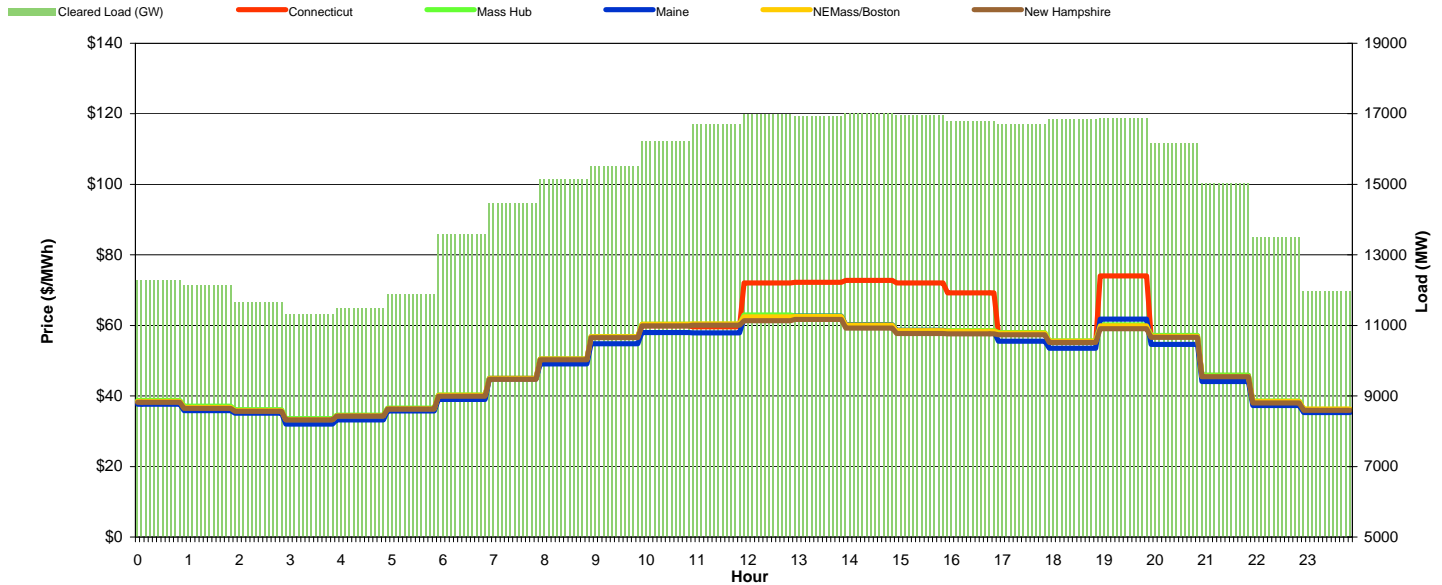

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$		
<b>Connecticut</b>	40.52	37.16	33.47	33.77	34.02	36.05	39.91	55.07	60.51	55.97	51.09	56.98	58.46	59.52	62.24	114.82	130.38	86.85	62.85	58.95	59.37	47.27	38.19	40.01	40.01	56.39	66.16
<b>NEMass/Boston</b>	40.10	36.86	33.35	33.61	33.81	35.79	39.89	55.07	60.63	55.93	51.44	66.77	75.35	77.63	78.43	79.58	73.65	70.38	80.09	74.65	59.47	46.99	38.23	40.14	40.14	55.74	65.27
<b>New Hampshire</b>	39.80	36.66	33.17	33.40	33.64	35.73	39.88	55.08	60.62	55.74	51.07	57.15	58.43	59.57	60.65	61.68	55.45	53.80	62.96	59.08	59.10	46.70	37.75	39.58	39.58	49.45	55.93
<b>Maine</b>	38.14	35.20	31.85	31.97	32.25	34.68	38.82	53.77	59.44	54.23	49.54	55.18	56.50	57.52	58.59	59.33	53.10	51.53	61.01	57.14	56.84	44.90	36.25	38.00	38.00	47.74	54.05
<b>Mass Hub</b>	40.34	37.11	33.52	33.78	33.99	35.96	39.84	54.96	60.46	55.80	51.16	57.25	58.76	59.93	60.89	61.96	55.66	54.14	63.21	59.14	59.22	46.92	38.08	39.99	39.99	49.67	56.10
<b>DA Forecast Load (GW)</b>	12.65	12.03	11.71	11.39	11.57	12.28	14.25	15.52	16.16	16.79	17.34	17.71	17.95	18.18	18.16	18.04	18.00	17.97	18.13	18.60	17.64	16.28	14.65	13.14	13.14		
<b>Forecast Error %</b>	6.6%	10.2%	10.0%	11.6%	11.3%	12.1%	2.8%	0.9%	0.8%	0.2%	0.3%	0.8%	1.2%	1.9%	3.0%	3.8%	3.5%	1.8%	1.2%	0.5%	1.7%	2.3%	2.3%	3.4%	3.4%		

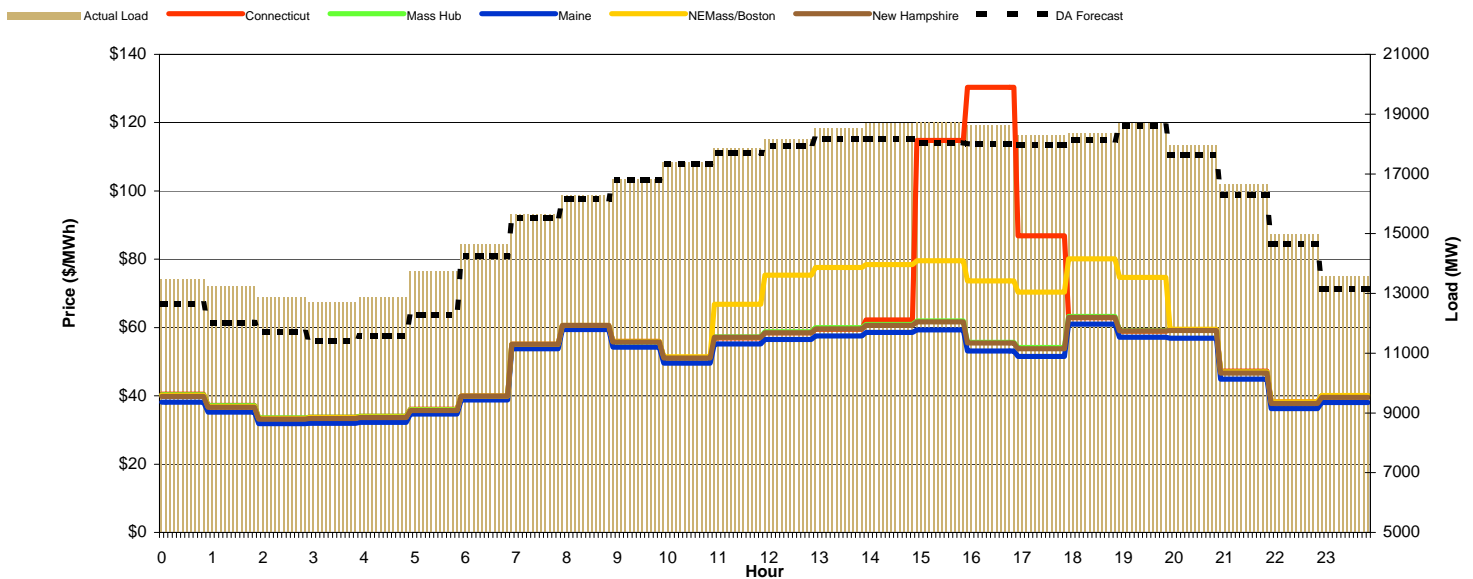




# ISO-NE Daily Report

Wednesday September 28, 2011

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	37.33	36.53	35.07	34.66	34.55	39.23	39.10	43.62	44.57	46.49	52.40	50.33	50.01	54.59	53.46	52.02	53.16	45.50	43.95	49.85	40.33	38.25	37.71	35.91	43.69	47.27	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	37.55	36.62	35.03	34.68	34.67	39.29	39.44	43.72	44.96	46.93	53.84	52.06	52.35	57.10	55.08	54.12	54.96	47.39	45.53	50.59	42.16	37.97	37.56	35.95	44.56	48.52		
<b>New Hampshire</b>	37.20	36.41	34.90	34.51	34.53	38.97	39.51	44.03	45.31	47.17	52.62	50.85	50.66	55.43	53.29	51.90	52.86	45.98	44.17	49.12	40.16	37.67	37.25	35.79	43.76	47.40		
<b>Maine</b>	36.21	35.26	34.38	33.96	33.56	37.87	38.73	43.67	42.96	46.64	51.37	50.00	50.25	54.94	52.14	50.99	51.86	45.87	43.94	48.28	39.30	37.00	36.18	35.00	42.93	46.59		
<b>Mass Hub</b>	37.71	36.79	35.30	34.90	34.80	39.48	39.58	43.66	44.77	46.68	52.61	50.79	50.32	55.00	53.56	52.00	52.91	45.59	43.76	49.34	40.22	37.97	37.68	36.02	43.81	47.30		
<b>Cleared Load (GW)</b>	11.1	10.8	10.5	10.4	10.4	11.1	12.9	14.0	14.5	15.1	15.3	15.7	15.7	15.7	15.5	15.3	15.2	15.3	15.9	16.2	15.7	14.4	12.6	11.3				

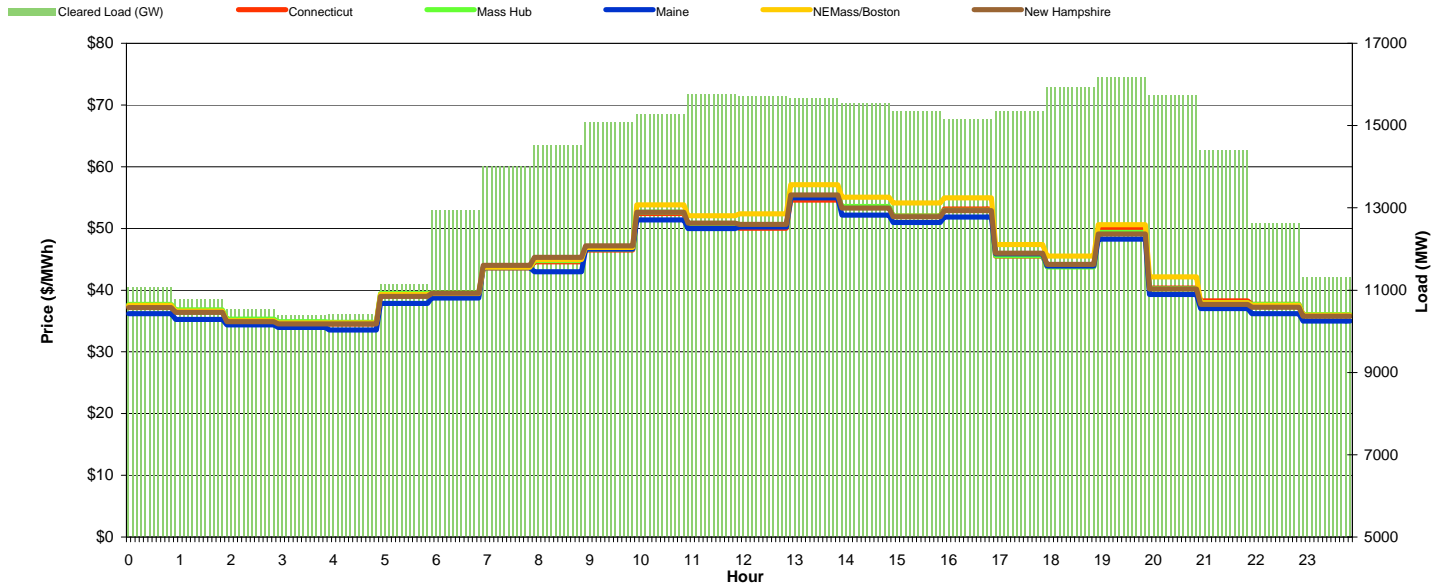

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	39.31	39.03	39.24	37.47	36.10	40.53	43.79	51.91	55.83	54.26	59.87	60.20	66.07	59.69	56.16	57.52	57.09	42.49	56.87	55.84	58.89	45.41	36.33	32.34	49.26	54.65	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	39.46	39.13	39.24	37.53	36.28	40.60	43.73	51.82	55.63	54.37	59.95	60.48	66.26	60.13	56.82	58.05	57.45	42.93	57.13	56.02	58.81	45.21	36.38	32.21	49.40	54.84		
<b>New Hampshire</b>	38.98	38.67	38.84	37.19	35.97	40.30	43.60	51.87	55.61	54.31	59.71	60.09	65.67	59.53	56.24	57.47	56.87	42.54	56.72	55.61	58.45	44.85	36.09	31.91	49.05	54.48		
<b>Maine</b>	37.44	37.07	37.13	35.88	34.72	38.98	42.80	51.10	54.24	53.02	57.81	58.16	63.61	57.55	54.66	55.61	54.92	41.21	54.89	53.84	56.31	43.03	34.87	30.73	47.48	52.80		
<b>Mass Hub</b>	39.40	39.26	39.45	37.70	36.38	40.70	43.77	51.81	55.60	54.15	59.71	60.16	65.97	59.76	56.41	57.71	57.16	42.66	56.84	55.77	58.69	45.15	36.26	32.17	49.28	54.61		
<b>DA Forecast Load (GW)</b>	12.01	11.37	11.00	10.82	11.04	12.06	14.07	15.42	16.06	16.55	16.98	17.21	17.31	17.42	17.36	17.30	17.29	17.34	17.50	17.95	17.31	15.88	14.23	12.73				
<b>Forecast Error %</b>	4.8%	9.3%	12.5%	13.0%	10.2%	6.4%	1.4%	-0.3%	-0.5%	-0.3%	0.0%	0.7%	1.0%	1.1%	1.0%	0.6%	-0.2%	-1.1%	-0.9%	-1.6%	-1.9%	-0.5%	0.1%	1.9%				

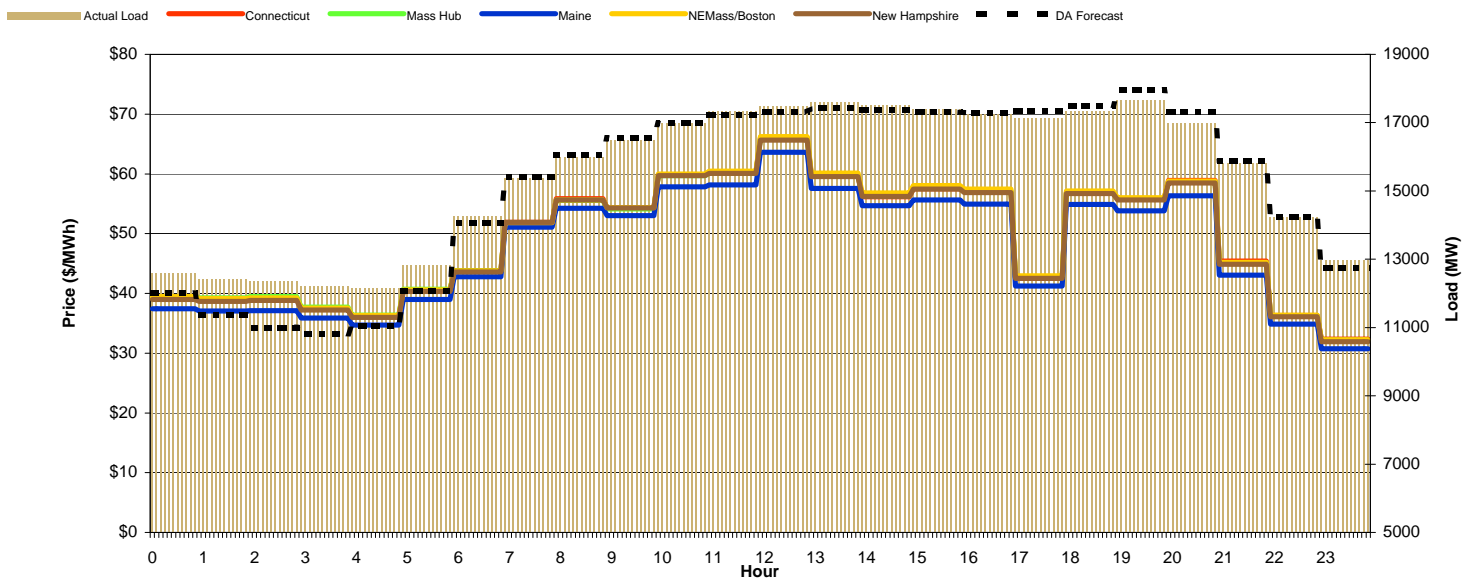




# ISO-NE Daily Report

Thursday September 29, 2011

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%

## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	36.63	36.31	34.43	34.00	34.52	36.13	37.89	40.82	44.21	48.41	50.71	51.85	54.10	54.03	53.83	52.50	52.15	48.57	53.81	56.21	50.00	41.33	37.38	35.63	44.81	49.37	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	36.73	36.37	34.46	34.22	34.79	36.62	37.91	40.50	43.76	47.94	51.19	53.50	55.00	55.10	54.55	53.04	52.95	49.68	54.54	57.00	49.64	41.06	37.15	35.95	45.15	49.79		
<b>New Hampshire</b>	36.67	36.42	34.56	34.30	34.86	36.79	37.99	40.84	44.14	48.25	51.01	51.98	53.36	53.15	53.35	51.60	51.88	48.49	53.28	56.27	49.17	40.69	37.01	36.14	44.68	49.03		
<b>Maine</b>	35.92	35.46	33.51	33.69	34.31	36.44	37.75	40.34	43.66	47.75	50.42	51.00	52.33	52.10	52.77	50.54	51.27	48.33	52.18	56.28	47.97	39.55	36.65	36.15	44.02	48.32		
<b>Mass Hub</b>	36.90	36.61	34.72	34.40	34.91	36.74	38.12	40.66	43.94	48.07	50.68	52.19	53.75	53.56	53.20	51.85	51.66	48.13	53.30	55.75	49.34	40.83	37.18	35.88	44.68	49.01		
<b>Cleared Load (GW)</b>	11.3	11.2	11.0	11.1	11.2	11.7	13.3	15.1	15.6	15.9	16.1	16.4	16.4	16.5	16.5	16.5	16.5	16.5	16.8	16.9	16.3	15.2	13.7	11.9				

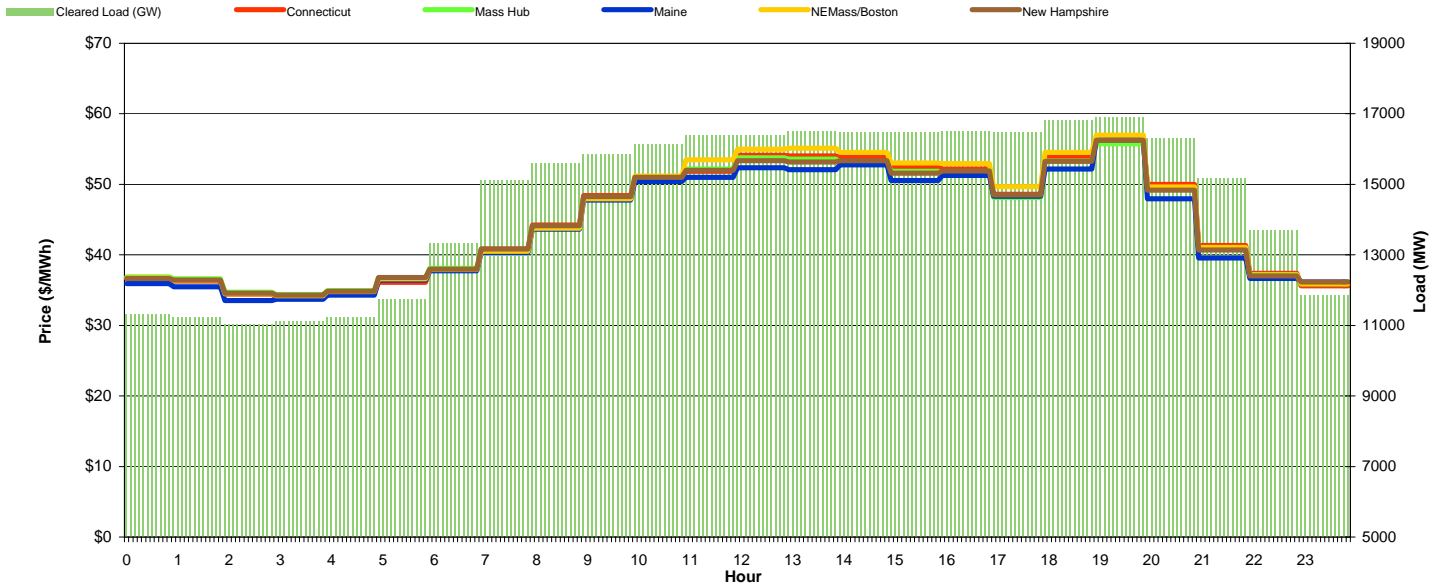

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	34.99	35.71	34.97	36.11	36.19	35.31	40.08	45.65	55.52	58.52	56.40	53.84	58.39	58.13	57.93	55.38	54.84	59.87	55.90	45.69	43.02	35.93	35.24	35.51	46.63	51.89	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	34.83	35.55	34.86	36.04	36.08	35.18	39.77	44.89	54.41	57.39	55.65	52.93	57.15	57.10	57.07	54.36	54.05	58.88	55.20	45.20	42.38	35.52	35.14	35.51	46.05	51.08		
<b>New Hampshire</b>	34.59	35.31	34.65	35.89	35.91	35.12	39.81	44.95	54.37	57.27	55.47	52.71	56.78	56.66	56.51	53.89	53.63	58.52	54.96	45.01	42.29	35.36	34.98	35.32	45.83	50.84		
<b>Maine</b>	33.47	34.12	33.42	34.88	35.10	34.52	39.43	44.29	53.03	55.73	54.02	51.18	55.12	54.97	54.91	52.47	52.31	56.93	53.69	43.83	40.98	34.23	34.03	34.41	44.63	49.48		
<b>Mass Hub</b>	34.92	35.71	35.01	36.19	36.24	35.31	39.84	45.04	54.62	57.54	55.63	52.99	57.29	57.16	57.08	54.43	54.05	58.99	55.24	45.21	42.47	35.56	35.10	35.52	46.13	51.15		
<b>DA Forecast Load (GW)</b>	11.73	11.18	10.91	10.83	11.09	12.14	14.25	15.60	16.19	16.68	17.11	17.32	17.39	17.46	17.37	17.26	17.30	17.39	17.71	18.10	17.28	16.05	14.46	12.98				
<b>Forecast Error %</b>	7.1%	10.1%	10.0%	12.0%	9.3%	5.7%	-1.6%	-1.6%	-0.6%	-0.2%	-0.3%	-0.5%	-0.7%	-0.3%	-0.3%	-0.1%	-0.1%	0.2%	-0.7%	-3.2%	-3.0%	-3.1%	-3.3%	-0.1%				

