




ISO-NE Daily Report

Tuesday November 01, 2011

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$	
Connecticut	34.08	32.11	32.04	32.01	32.04	37.22	42.13	48.83	44.15	46.62	44.13	43.74	43.36	40.58	40.64	40.46	43.89	45.69	47.76	44.46	42.96	41.91	38.67	37.08	40.69	43.62
NEMass/Boston	33.92	32.13	32.16	32.11	32.08	36.98	39.94	43.23	41.34	42.75	41.76	41.25	40.94	38.53	38.52	38.36	41.63	44.17	46.37	42.75	41.28	39.63	36.64	36.91	38.97	41.20
New Hampshire	33.88	32.15	32.21	32.15	32.26	37.18	40.33	44.11	41.73	43.16	41.96	41.50	41.16	38.80	38.83	38.62	41.84	44.20	46.48	42.91	41.38	39.83	36.70	37.00	39.18	41.45
Maine	33.09	31.34	31.69	31.62	32.03	37.12	39.88	43.04	41.04	42.28	41.35	40.81	40.36	38.32	38.29	38.17	41.41	43.92	46.25	42.85	40.91	39.25	36.11	36.62	38.66	40.90
Mass Hub	34.35	32.44	32.40	32.36	32.37	37.43	40.90	45.58	42.61	44.47	42.78	42.23	41.88	39.33	39.34	39.23	42.36	44.66	46.88	43.42	41.86	40.40	37.11	37.35	39.74	42.13
Cleared Load (GW)	9.5	8.9	8.7	8.5	8.8	9.8	12.1	13.0	13.0	13.1	13.1	12.9	12.8	12.8	12.7	12.6	13.0	13.4	13.6	13.5	13.1	12.2	11.1	10.0		

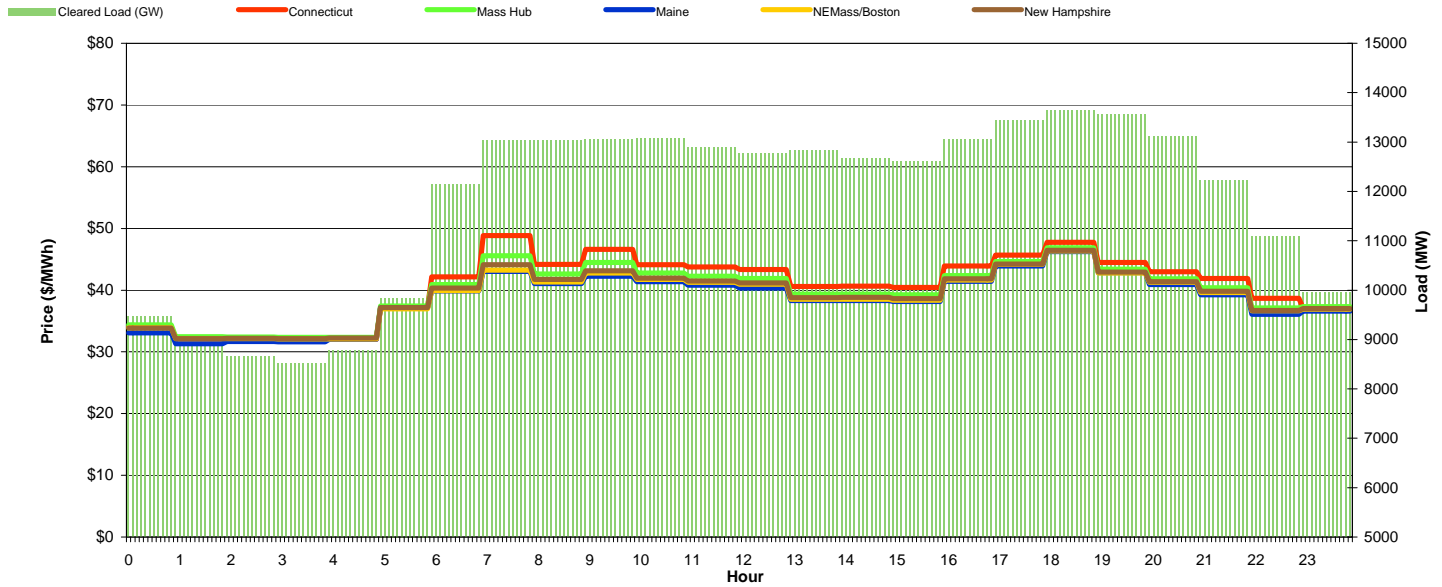

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$	
Connecticut	30.71	32.22	32.14	32.69	34.83	51.99	50.75	55.72	46.71	51.23	51.10	51.56	48.67	35.60	33.80	38.23	37.95	49.31	67.97	65.21	55.60	50.66	37.87	37.40	45.00	48.57
NEMass/Boston	30.61	32.05	32.00	32.60	34.71	52.30	50.77	55.14	45.33	49.69	49.64	50.12	47.29	34.85	33.30	37.51	37.24	48.76	68.21	65.47	54.87	49.17	36.96	37.08	44.40	47.72
New Hampshire	30.45	31.87	31.87	32.54	34.73	52.47	51.09	55.51	45.79	50.02	49.83	50.31	47.50	35.04	33.40	37.60	37.27	48.85	68.12	65.21	54.74	49.01	36.85	37.01	44.46	47.82
Maine	29.59	31.02	31.40	32.40	34.82	53.19	52.15	56.23	46.54	50.78	50.18	50.69	47.87	35.31	33.41	37.41	37.11	49.32	69.36	65.82	54.30	47.89	36.23	36.36	44.56	48.03
Mass Hub	30.69	32.24	32.17	32.75	34.88	52.42	50.93	55.53	45.98	50.43	50.41	50.87	48.03	35.34	33.72	38.05	37.76	49.31	68.55	65.82	55.52	50.11	37.56	37.48	44.86	48.31
DA Forecast Load (GW)	10.01	9.55	9.31	9.27	9.53	10.47	12.58	13.94	14.25	14.44	14.56	14.57	14.43	14.32	14.14	13.93	13.99	14.54	15.60	15.43	14.95	13.91	12.45	11.14		
Forecast Error %	0.6%	1.7%	2.4%	2.9%	2.6%	2.0%	-1.4%	-2.3%	-2.5%	-2.5%	-2.7%	-2.9%	-2.8%	-2.8%	-2.2%	-1.2%	-0.2%	-0.2%	0.0%	-0.4%	0.3%	1.5%	2.9%			

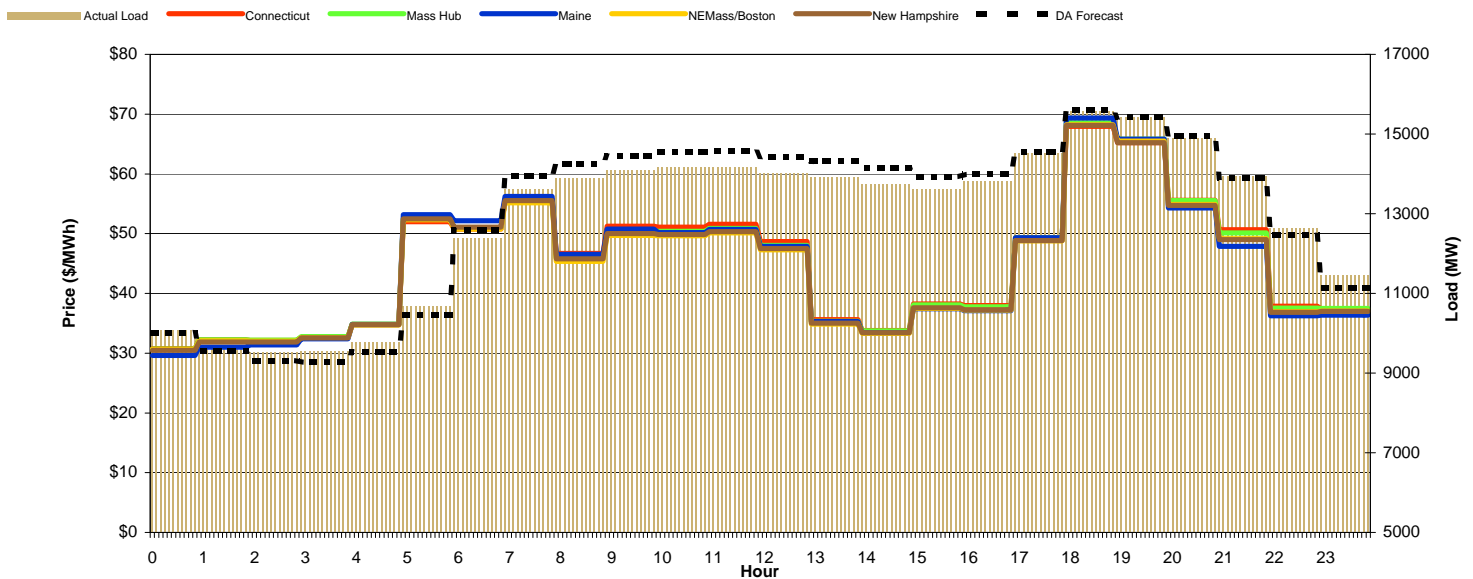




ISO-NE Daily Report

Wednesday November 02, 2011

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
																										All	On Pk	
Connecticut	34.43	32.38	32.33	32.32	33.19	37.02	41.91	49.82	41.79	41.27	43.84	40.13	40.08	39.83	39.61	39.48	39.03	47.94	51.62	47.52	39.59	38.90	36.30	32.72	39.71	42.30		
NEMass/Boston	33.11	31.48	31.44	31.45	31.99	36.28	40.09	47.63	39.75	39.46	41.88	38.44	38.46	38.29	38.26	38.62	47.22	50.49	46.52	38.74	38.21	36.10	32.79	38.54	41.02			
New Hampshire	33.22	31.63	31.56	31.58	32.21	36.52	40.56	48.14	40.16	39.82	42.14	38.69	38.77	38.67	38.48	38.51	38.85	47.42	50.83	46.71	38.97	38.41	36.23	32.83	38.79	41.30		
Maine	32.30	30.78	30.64	30.63	31.36	36.20	40.46	47.48	41.79	41.76	42.00	38.76	38.79	38.75	38.03	38.32	38.65	47.05	50.65	46.59	38.79	38.27	36.00	32.35	38.60	41.36		
Mass Hub	33.62	31.86	31.85	31.87	32.51	36.88	41.28	48.69	40.53	40.15	42.65	38.97	38.99	38.80	38.64	38.60	38.96	47.70	50.46	46.86	39.22	38.60	36.30	33.11	39.05	41.51		
Cleared Load (GW)	10.3	9.8	9.8	9.8	10.1	10.8	13.0	13.6	13.5	13.6	13.6	13.2	13.0	13.0	12.8	12.7	13.2	14.0	13.8	13.8	13.5	12.4	11.3	10.0				

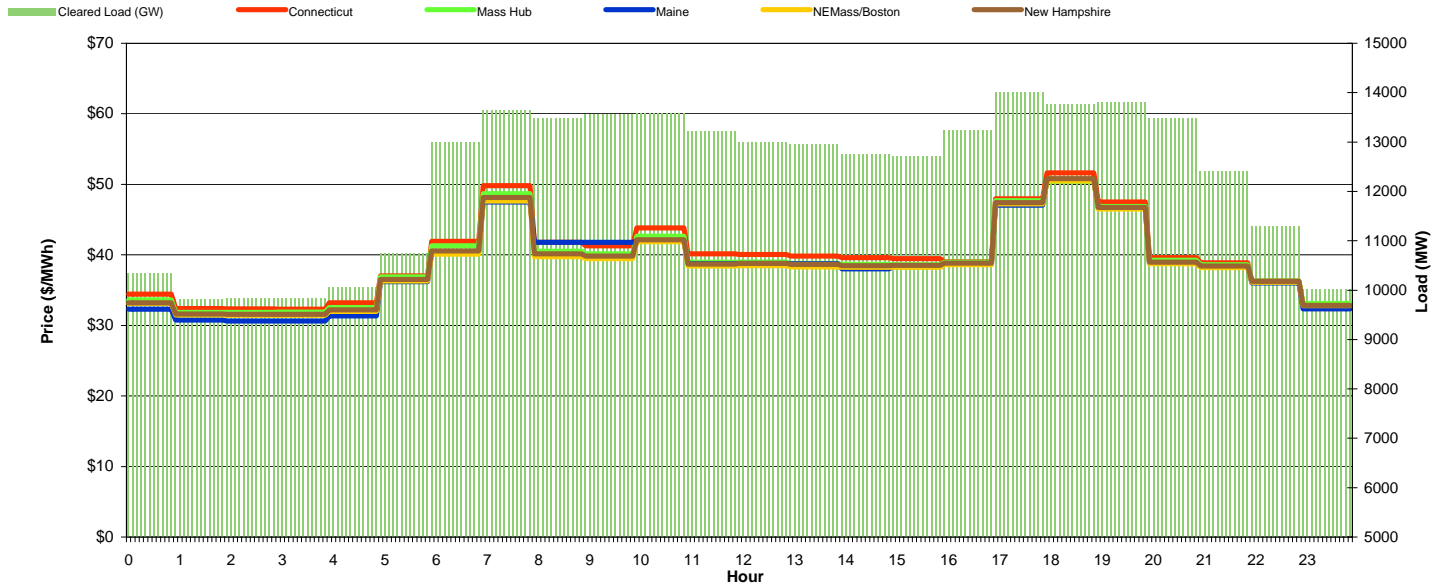

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
																										All	On Pk	
Connecticut	37.68	32.63	34.05	36.08	35.04	38.11	51.93	48.00	59.69	48.69	42.34	49.30	40.84	42.13	34.28	43.88	34.08	36.24	46.40	45.39	43.10	34.95	36.39	34.21	41.06	42.86		
NEMass/Boston	37.20	32.34	33.51	35.36	34.70	38.13	51.32	47.02	57.80	47.10	40.95	47.43	39.46	41.27	34.03	43.21	33.41	35.60	45.23	44.03	40.95	33.08	35.70	33.90	40.11	41.64		
New Hampshire	37.10	32.27	33.46	35.34	34.75	38.33	51.74	47.42	58.36	47.51	41.25	47.97	39.85	41.69	34.47	43.79	33.68	35.85	45.58	44.31	41.21	33.21	35.76	33.93	40.37	41.99		
Maine	36.04	31.47	32.59	34.44	34.40	38.74	52.68	48.06	58.86	47.86	41.30	48.11	39.79	41.42	34.63	43.87	33.51	35.70	45.33	43.78	40.46	32.74	35.25	33.37	40.18	41.92		
Mass Hub	37.65	32.69	33.98	35.92	35.12	38.48	52.04	47.81	59.07	48.17	41.85	48.52	40.33	41.93	34.35	43.74	33.87	36.07	45.97	44.81	41.68	33.50	36.06	34.16	40.74	42.36		
DA Forecast Load (GW)	10.60	10.21	10.02	10.10	10.32	11.39	13.44	14.72	14.86	14.92	14.87	14.78	14.59	14.50	14.30	14.21	14.66	15.23	15.91	15.58	15.17	14.16	12.75	11.40				
Forecast Error %	5.2%	5.8%	9.5%	9.5%	5.2%	0.5%	-2.0%	-2.4%	-2.0%	-2.0%	-1.5%	-1.7%	-1.9%	-2.1%	-2.0%	-2.0%	-3.7%	-2.9%	-0.5%	0.8%	-0.3%	0.0%	0.4%	4.1%				

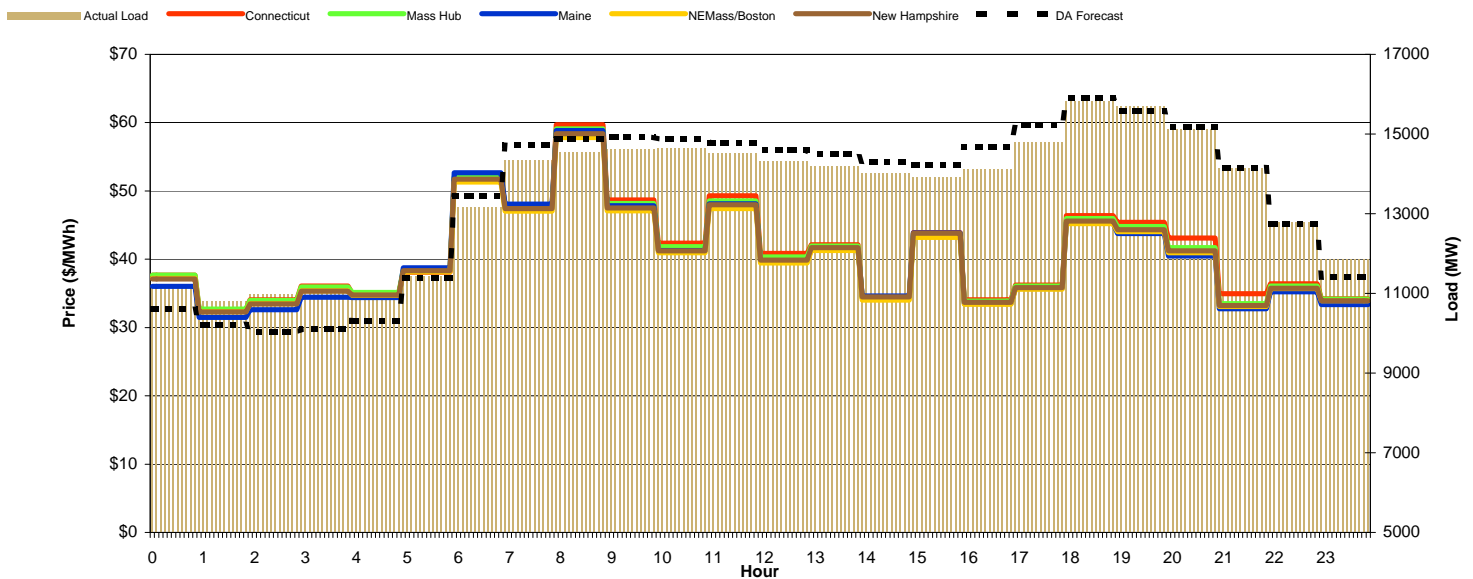




ISO-NE Daily Report

Thursday November 03, 2011

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	34.42	32.79	31.62	31.95	32.86	35.90	39.92	47.39	43.41	43.95	39.44	38.29	38.13	37.94	38.05	38.11	37.96	47.94	52.95	47.20	40.03	40.07	37.11	35.69	39.30	41.75	All	On Pk
NEMass/Boston	33.88	32.00	31.14	31.41	32.18	35.49	39.02	46.35	41.97	42.59	38.43	37.45	37.32	37.23	37.22	37.32	37.42	47.08	52.14	46.18	39.10	39.47	36.89	35.68	38.54	40.89		
New Hampshire	34.07	32.29	31.49	31.73	32.43	35.89	39.58	46.86	42.50	43.15	38.82	37.82	37.55	37.49	37.48	37.57	37.65	47.42	52.42	46.43	39.39	39.54	36.77	35.67	38.83	41.18		
Maine	33.24	31.48	30.84	30.99	31.56	35.50	39.96	46.55	42.12	42.66	38.36	37.45	36.86	37.06	37.02	37.12	37.19	46.95	51.98	46.03	38.82	38.95	36.24	35.04	38.33	40.71		
Mass Hub	34.50	32.68	31.70	32.03	32.87	36.23	40.02	47.59	43.00	43.49	39.32	38.07	37.82	37.68	37.69	37.78	38.05	48.00	53.00	47.00	39.88	40.00	37.21	35.85	39.23	41.60		
Cleared Load (GW)	11.1	10.6	10.5	10.5	10.7	11.4	13.3	14.5	14.1	14.2	14.4	14.0	13.8	13.7	13.5	13.5	13.9	14.7	15.1	14.7	14.2	12.9	11.6	10.4				

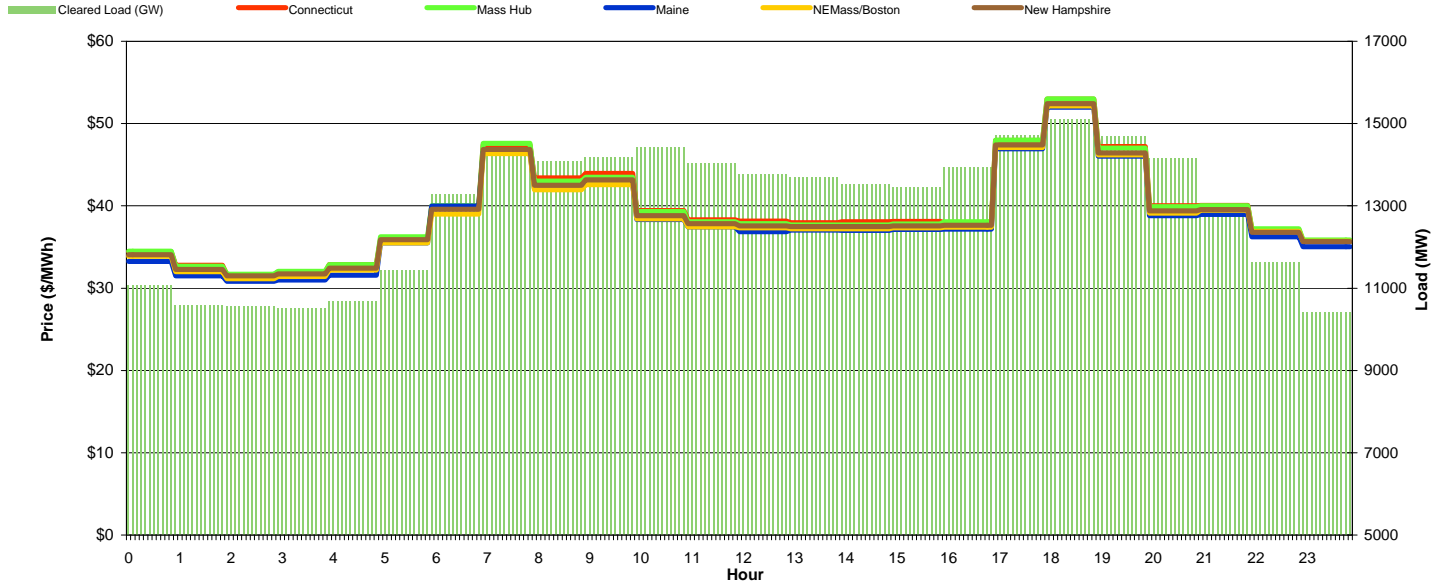

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	36.52	33.28	31.29	31.98	32.55	33.54	42.85	39.05	40.58	34.95	34.76	34.33	34.18	33.54	31.72	31.43	31.20	39.12	42.89	46.24	38.84	35.00	32.60	33.27	35.65	36.28	All	On Pk
NEMass/Boston	36.14	32.82	31.05	31.74	32.25	33.39	42.42	38.07	38.50	32.67	32.43	32.59	33.14	32.44	30.66	30.45	30.29	38.14	41.76	44.55	37.41	33.99	32.06	33.09	34.67	34.95		
New Hampshire	36.08	32.81	31.10	31.82	32.31	33.49	42.64	38.35	38.69	32.82	32.56	32.74	33.33	32.63	30.78	30.59	30.42	38.28	41.80	44.55	37.54	33.94	31.88	32.95	34.75	35.06		
Maine	35.26	32.00	30.39	31.14	31.63	33.10	42.79	38.38	38.29	32.31	31.64	31.92	32.61	31.78	29.93	29.87	29.76	37.21	40.67	43.16	36.40	33.17	31.22	32.23	34.04	34.27		
Mass Hub	36.49	33.22	31.36	32.04	32.59	33.74	42.85	38.60	39.01	33.06	32.76	32.97	33.65	32.97	31.13	30.89	30.72	38.66	42.35	45.32	38.08	34.45	32.33	33.29	35.11	35.43		
DA Forecast Load (GW)	10.66	10.21	10.00	10.02	10.32	11.41	13.57	14.75	14.99	15.08	15.08	15.04	14.89	14.82	14.63	14.78	15.22	15.98	16.70	16.26	15.60	14.53	13.09	11.66				
Forecast Error %	10.1%	13.8%	14.2%	13.6%	13.1%	7.7%	-1.3%	-1.5%	-1.6%	-1.8%	-0.1%	-1.4%	-1.7%	-0.6%	-1.6%	-3.6%	-5.1%	-4.4%	-3.4%	-2.2%	-2.0%	-1.8%	-1.8%	2.1%				

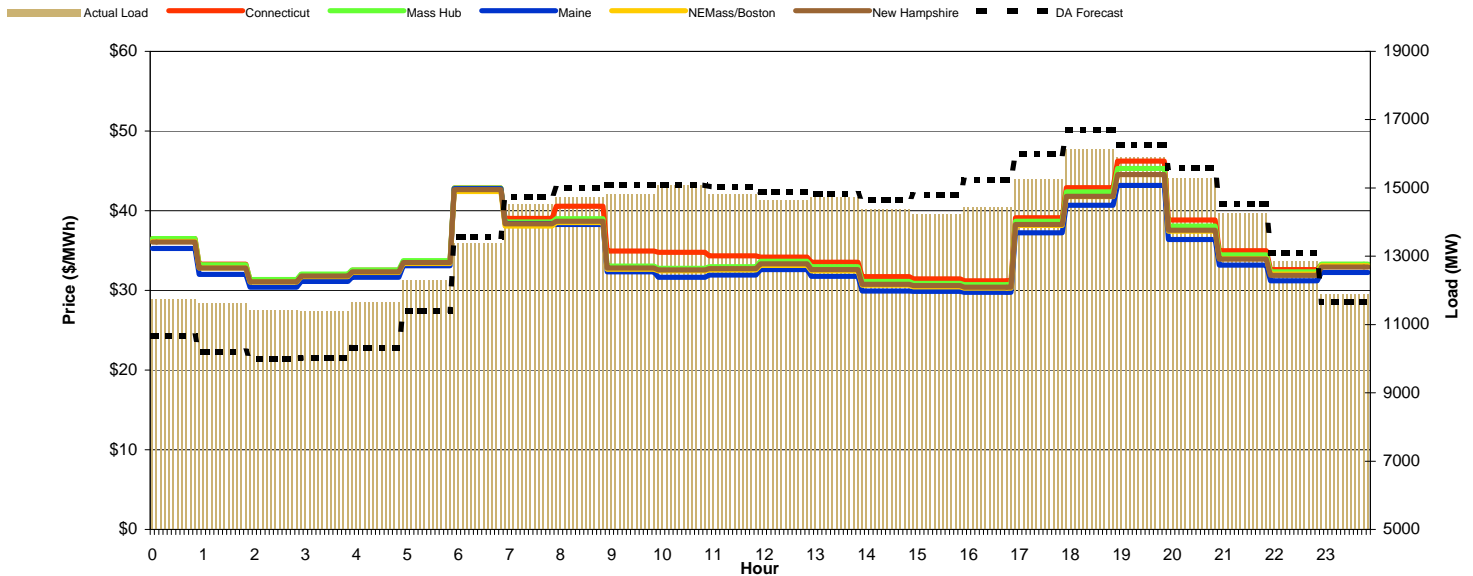




ISO-NE Daily Report

Friday November 04, 2011

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	35.12	32.66	32.55	32.55	32.48	35.57	40.38	43.77	44.06	45.58	42.09	41.89	41.71	41.80	40.53	39.75	39.90	48.44	55.09	46.78	42.14	40.01	38.58	37.73	40.47	43.26	All	On Pk
NEMass/Boston	35.17	32.55	32.53	32.51	32.57	35.75	39.82	43.15	43.08	44.38	41.07	40.82	40.63	40.74	39.67	38.99	39.23	47.72	53.99	45.85	41.33	39.34	38.41	37.85	39.88	42.40		
New Hampshire	35.01	32.51	32.38	32.37	32.46	35.77	39.82	43.16	43.25	44.49	41.21	40.95	40.50	40.63	39.57	38.84	38.98	47.36	53.61	45.50	40.94	39.05	38.34	37.78	39.77	42.27		
Maine	34.11	31.88	31.55	31.55	31.83	35.27	39.26	42.49	42.46	43.34	40.32	39.68	39.15	39.23	38.28	37.61	37.98	46.03	52.26	44.10	39.47	38.10	37.68	37.18	38.78	41.14		
Mass Hub	35.57	33.01	32.87	32.86	32.92	36.11	40.53	43.86	43.66	44.88	41.00	40.88	41.00	41.16	40.00	39.28	39.30	48.42	54.40	46.38	41.88	39.91	38.78	38.25	40.29	42.80		
Cleared Load (GW)	10.0	9.6	9.5	9.4	9.6	10.3	12.7	13.7	13.5	13.4	13.0	13.0	13.0	13.0	13.0	12.8	13.0	14.2	14.3	14.2	13.6	13.1	12.0	10.8				

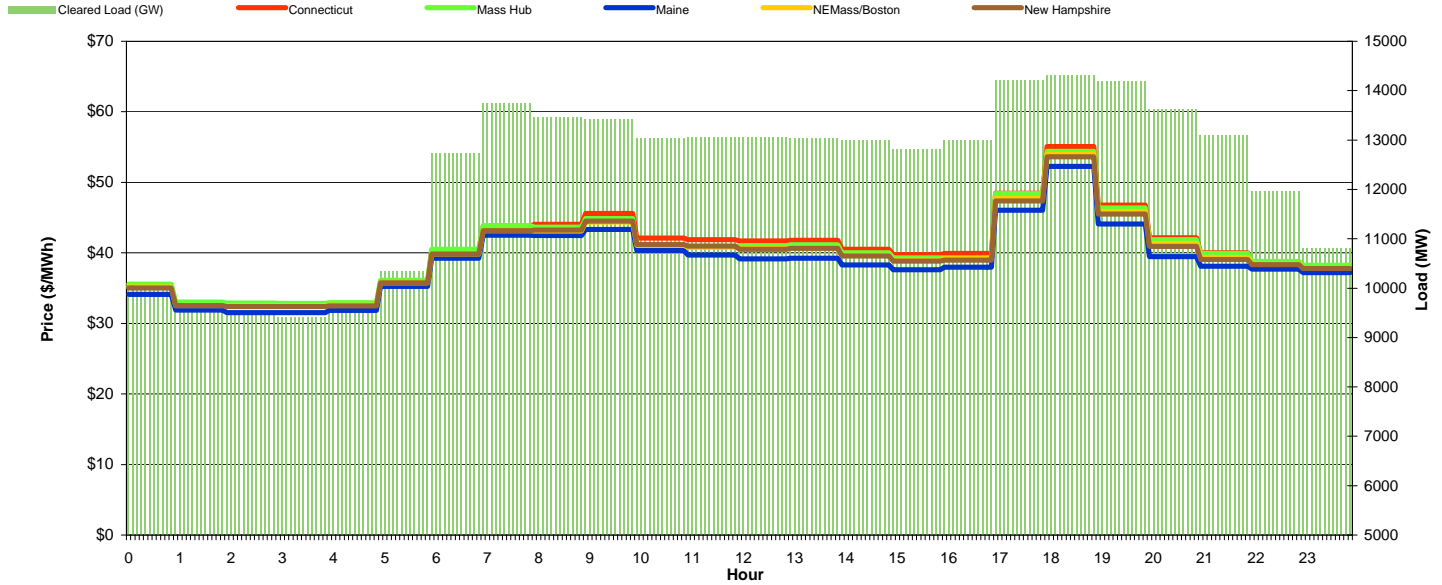

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	37.20	34.69	35.94	37.08	32.97	37.46	41.47	44.76	45.53	53.65	54.82	53.72	44.36	41.39	40.12	41.84	41.67	46.97	62.67	49.29	44.07	38.38	43.54	36.80	43.35	46.67	All	On Pk
NEMass/Boston	37.10	34.74	35.90	37.00	33.00	37.51	40.99	44.21	44.55	52.08	52.92	52.25	43.14	40.17	38.91	40.66	40.55	46.11	61.37	48.04	42.79	37.44	42.94	36.75	42.55	45.51		
New Hampshire	36.80	34.38	35.55	36.66	32.68	37.32	40.85	44.15	44.62	52.14	52.79	51.99	42.86	39.86	38.61	40.38	40.26	45.81	60.77	47.58	42.42	37.12	42.51	36.38	42.27	45.24		
Maine	35.87	33.56	34.71	35.74	31.92	36.75	40.16	43.44	44.08	51.24	51.01	49.94	41.23	38.23	37.00	38.98	38.85	44.21	58.34	45.32	40.36	35.67	41.11	35.29	40.96	43.69		
Mass Hub	37.37	34.97	36.18	37.30	33.23	37.80	41.42	44.69	45.17	52.93	53.89	53.09	43.85	40.84	39.59	41.35	41.21	46.75	62.23	48.83	43.56	38.08	43.48	37.05	43.12	46.22		
DA Forecast Load (GW)	10.83	10.35	10.12	10.08	10.35	11.36	13.47	14.84	15.17	15.35	15.50	15.47	15.33	15.23	15.04	14.88	14.97	15.49	16.13	15.83	15.24	14.42	13.26	12.04				
Forecast Error %	4.6%	4.2%	5.1%	6.8%	3.9%	1.8%	-3.1%	-3.0%	-2.9%	-2.5%	-2.6%	-3.2%	-3.6%	-3.8%	-3.8%	-3.7%	-3.3%	-2.4%	-0.7%	-0.7%	-0.4%	0.0%	0.4%	0.9%				

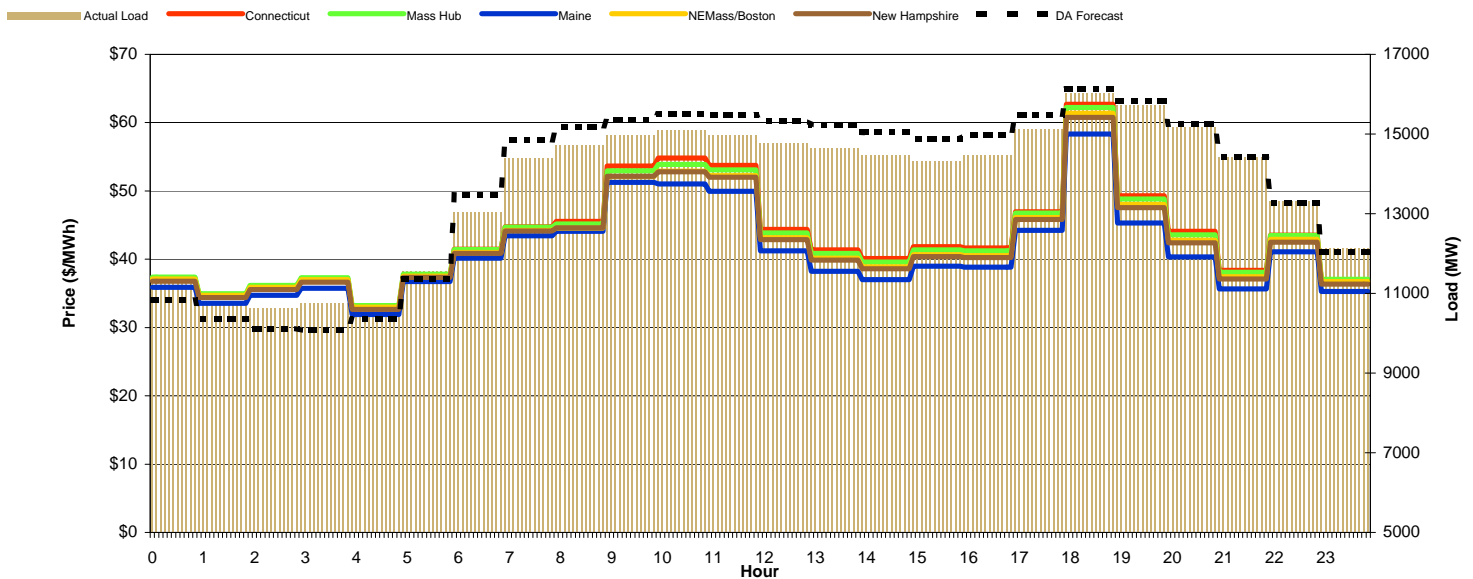




ISO-NE Daily Report

Saturday November 05, 2011

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$				
Connecticut	38.00	38.12	36.00	36.07	36.29	36.00	37.38	40.25	44.22	46.85	42.61	39.97	39.76	38.91	38.15	37.68	39.64	42.30	56.28	42.82	42.63	39.81	38.22	38.70	38.70	40.28	41.88	All	On Pk
NEMass/Boston	37.70	38.11	35.89	35.92	36.22	35.77	36.87	39.15	42.94	45.47	41.48	39.24	39.11	38.38	37.67	37.26	39.21	41.65	55.27	41.99	41.96	39.27	37.86	38.53	39.71	41.12			
New Hampshire	37.51	37.82	35.69	35.74	35.95	35.65	36.60	38.99	42.74	45.31	41.32	39.01	38.74	37.99	37.30	36.89	38.85	41.29	54.79	41.52	41.47	38.76	37.34	37.80	39.38	40.77			
Maine	36.64	36.99	35.02	35.00	35.10	35.06	35.93	38.24	42.07	44.59	40.91	38.74	38.36	37.59	36.87	36.50	38.60	40.78	54.42	41.10	40.92	38.41	36.85	37.10	38.82	40.31			
Mass Hub	38.30	38.58	36.38	36.44	36.62	36.26	37.50	39.78	43.65	46.19	42.06	39.56	39.39	38.63	37.88	37.46	39.48	42.15	56.00	42.46	42.45	39.65	38.20	38.94	40.17	41.56			
Cleared Load (GW)	11.0	10.6	10.4	10.4	10.4	10.7	11.4	12.3	13.0	13.5	13.4	12.9	12.7	12.5	12.3	12.2	12.7	13.8	14.2	13.9	13.3	12.7	11.7	10.5					

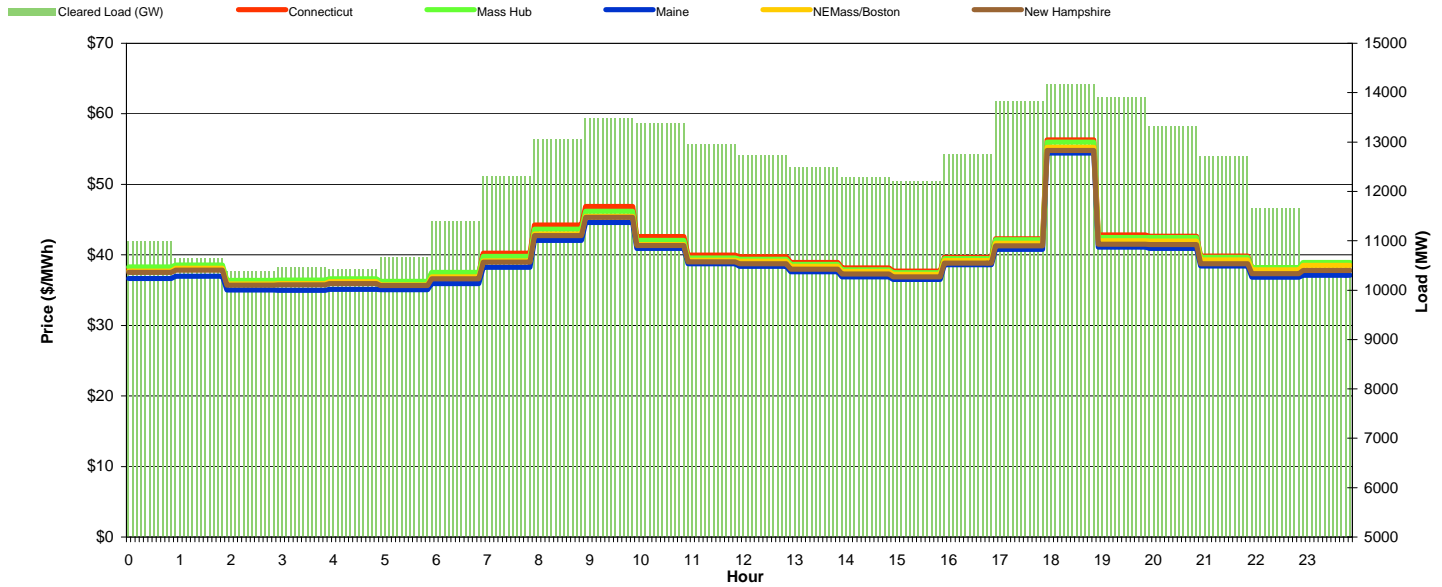

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$		
Connecticut	36.48	34.14	34.61	35.29	36.59	35.82	36.34	39.24	37.37	37.92	40.02	38.09	36.04	34.71	33.21	33.14	33.17	34.63	39.53	45.76	41.66	40.12	58.95	56.46	38.72	38.97	
NEMass/Boston	36.48	34.13	34.50	35.11	36.38	35.54	35.72	38.22	36.14	36.76	38.56	36.84	34.97	33.88	32.55	32.49	32.48	34.03	38.46	44.64	40.74	39.23	58.21	55.89	38.00	38.01	
New Hampshire	36.08	33.76	34.19	34.80	36.07	35.25	35.47	38.12	36.16	36.73	38.50	36.75	34.81	33.63	32.28	32.23	32.23	33.73	38.13	44.19	40.37	38.90	57.54	55.16	37.71	37.77	
Maine	35.03	32.73	33.26	33.80	35.02	34.24	34.55	37.05	34.99	35.71	37.52	35.87	34.07	32.95	31.50	31.51	31.67	33.04	37.26	43.22	39.58	38.34	56.83	54.35	36.84	36.94	
Mass Hub	36.74	34.39	34.82	35.46	36.77	35.94	36.22	38.85	36.84	37.42	39.32	37.50	35.55	34.37	32.96	32.90	32.91	34.47	39.09	45.37	41.40	39.88	58.95	56.60	38.53	38.61	
DA Forecast Load (GW)	10.88	10.37	10.11	10.06	10.12	10.53	11.35	12.28	13.32	13.83	14.02	13.81	13.51	13.19	12.91	12.83	13.19	13.94	14.93	14.50	14.07	13.40	12.49	11.56			
Forecast Error %	5.7%	6.5%	9.0%	10.2%	12.3%	8.8%	5.2%	4.8%	2.9%	2.9%	2.2%	2.8%	2.8%	2.7%	2.8%	2.5%	1.5%	2.1%	2.2%	3.9%	4.0%	4.9%	5.8%	6.3%			

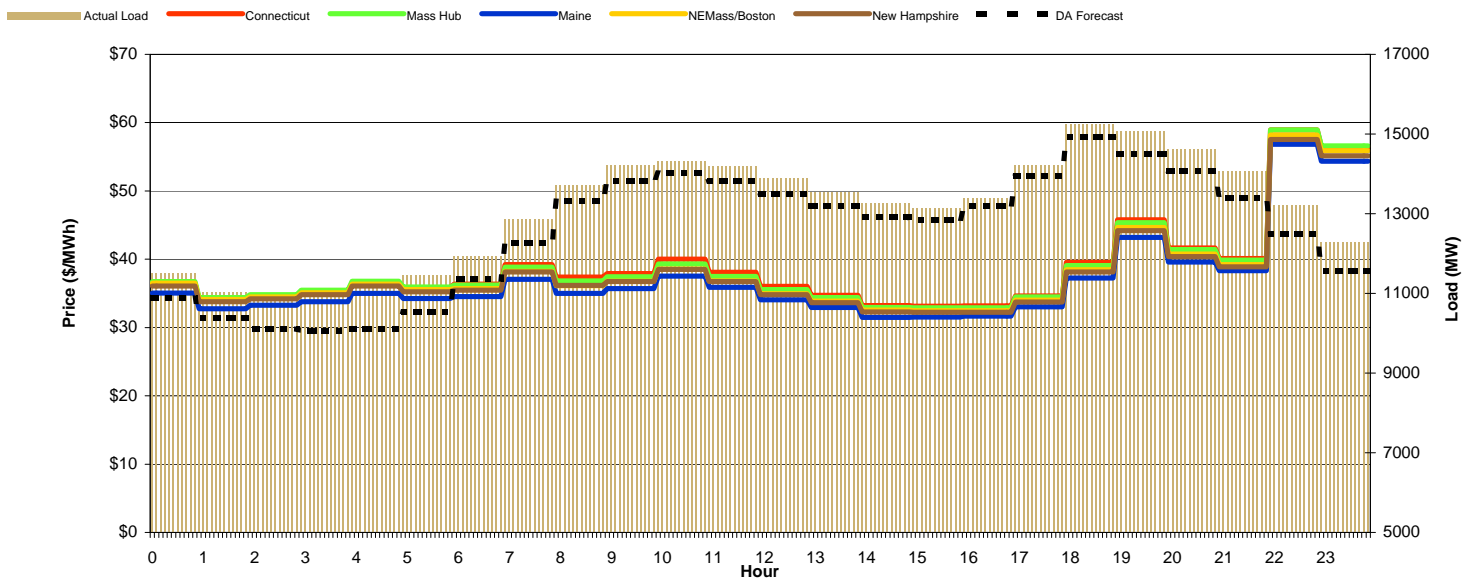



Daylight savings has resulted in some errors in today's report


ISO-NE Daily Report

Sunday November 06, 2011

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	39.20	36.00	33.97	33.99	34.05	33.92	37.05	36.84	39.29	39.80	38.54	38.36	38.00	37.67	37.24	37.88	41.13	55.00	54.12	43.00	41.72	40.46	39.21	#N/A	#N/A	41.14	All	On Pk
NEMass/Boston	38.83	35.82	34.01	34.01	34.02	33.75	36.88	36.32	38.67	38.99	37.65	37.55	37.19	37.14	36.69	37.19	40.24	53.69	52.84	42.02	40.64	39.48	38.91	#N/A	#N/A	40.33	#N/A	#N/A
New Hampshire	38.39	35.47	33.61	33.62	33.67	33.43	36.53	36.22	38.64	38.85	37.44	37.23	36.88	36.80	36.37	36.92	40.15	53.34	52.50	41.72	40.30	39.43	38.82	#N/A	#N/A	40.10	#N/A	#N/A
Maine	37.74	35.00	33.20	33.21	33.15	33.00	35.97	35.94	38.55	38.57	37.09	36.88	36.53	36.43	35.99	36.69	40.12	52.59	51.54	41.03	39.49	39.37	38.83	#N/A	#N/A	39.73	#N/A	#N/A
Mass Hub	39.47	36.39	34.43	34.42	34.45	34.24	37.42	36.73	39.15	39.54	38.16	38.01	37.65	37.50	37.04	37.60	40.88	54.72	53.79	42.50	41.18	39.98	39.11	36.68	39.21	40.85	39.21	40.85
Cleared Load (GW)	10.5	10.1	9.3	9.8	9.7	9.8	10.0	10.6	11.1	11.7	12.4	12.4	12.4	12.3	12.1	12.0	12.2	13.3	14.2	14.4	13.8	13.4	12.4	11.1				

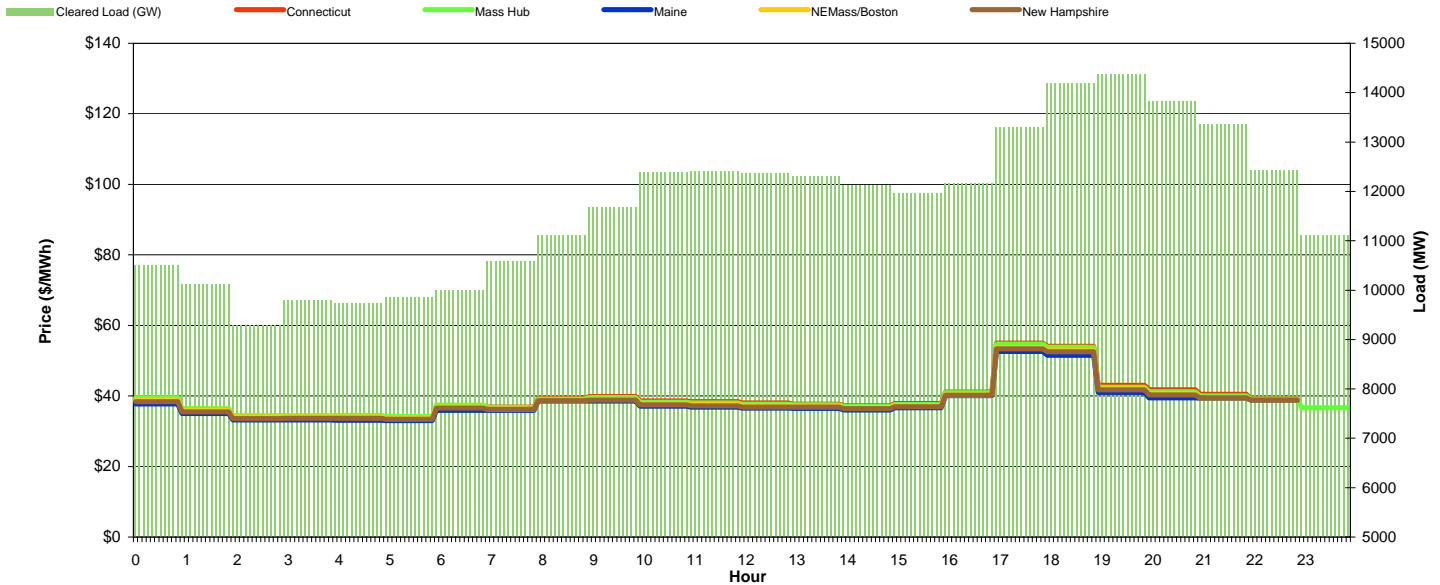

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	48.48	35.41	32.95	32.55	32.56	33.67	53.23	131.48	48.78	35.18	36.19	36.27	35.92	36.17	35.41	33.32	35.45	41.89	36.60	38.82	39.89	32.84	32.98	32.98	41.21	42.95	All	On Pk
NEMass/Boston	48.21	35.22	32.70	32.38	32.43	33.49	53.20	130.99	48.39	34.49	35.28	35.42	35.14	35.60	34.92	32.75	34.81	40.89	35.92	38.02	38.98	32.21	32.54	32.54	40.69	42.27	40.69	42.27
New Hampshire	47.47	34.76	32.27	31.94	31.98	33.07	52.53	129.62	48.30	34.30	35.04	35.14	34.80	35.26	34.54	32.43	34.54	40.50	35.43	37.48	38.53	31.75	32.06	32.06	40.24	41.86	40.24	41.86
Maine	46.63	34.07	31.62	31.20	31.11	32.26	51.24	127.60	47.91	33.71	34.41	34.53	34.09	34.57	33.87	31.94	34.31	39.62	34.51	36.38	37.64	31.07	31.25	31.25	39.45	41.09	39.45	41.09
Mass Hub	48.70	35.57	33.06	32.72	32.76	33.84	53.61	132.27	49.00	34.99	35.84	35.97	35.64	36.03	35.30	33.13	35.24	41.51	36.39	38.50	39.46	32.56	32.87	32.87	41.16	42.79	41.16	42.79
DA Forecast Load (GW)	11.03	10.48	10.48	10.27	10.26	10.28	10.56	11.01	11.75	12.60	13.09	13.10	13.01	12.90	12.55	12.49	12.80	14.38	16.11	15.90	15.44	14.89	13.71	13.71				
Forecast Error %	3.8%	5.6%	4.5%	5.6%	5.6%	7.1%	8.3%	7.3%	8.3%	6.8%	5.3%	5.2%	5.2%	4.9%	6.3%	6.0%	5.1%	0.3%	-2.0%	-1.7%	-1.8%	-1.8%	-1.3%	-9.7%				

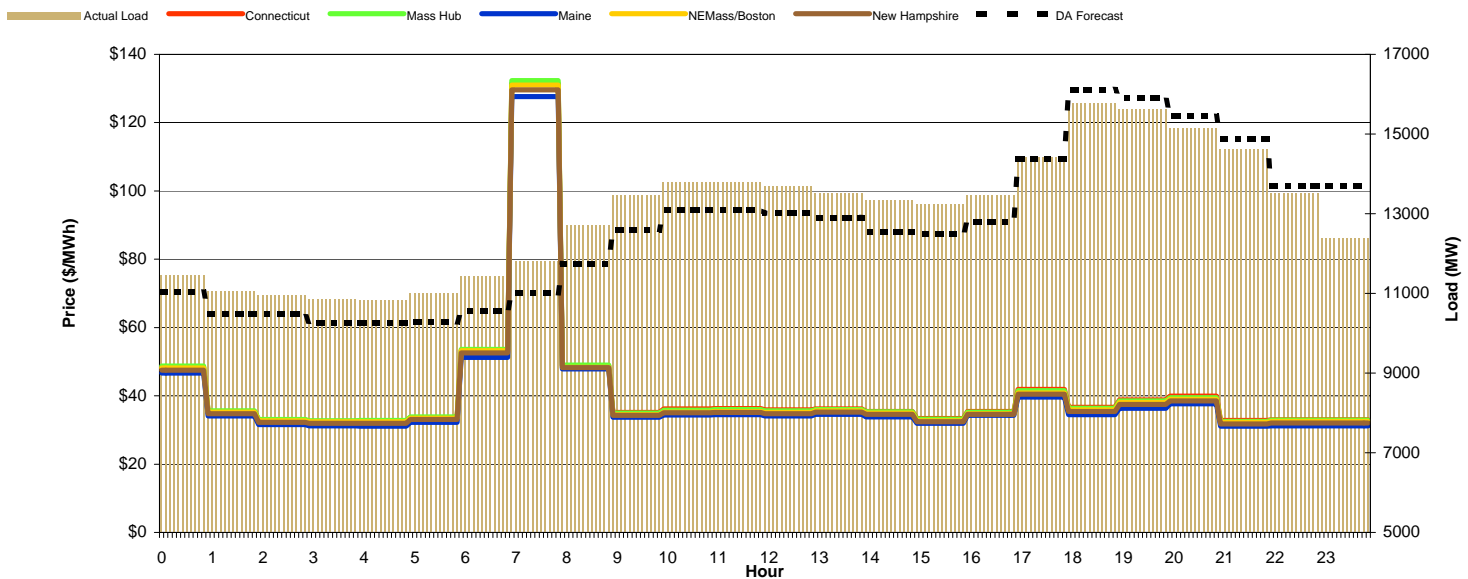




ISO-NE Daily Report

Monday November 07, 2011

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	34.13	33.65	33.66	33.15	33.83	37.41	40.33	40.00	40.77	40.37	44.05	42.83	40.87	39.41	39.53	39.39	48.47	59.39	59.14	44.41	43.00	40.74	37.85	36.92	40.97	43.76	All	On Pk
NEMass/Boston	33.72	33.35	33.38	32.86	33.45	37.28	39.51	39.09	39.50	39.13	42.53	41.59	39.60	38.36	38.48	38.45	46.93	57.77	57.33	43.15	42.07	39.82	37.52	36.76	40.07	42.58		
New Hampshire	33.66	33.23	33.29	32.80	33.48	37.42	39.57	39.08	39.59	39.23	42.70	41.64	39.54	38.26	38.34	38.26	46.90	57.44	56.98	42.84	41.35	39.05	37.03	36.33	39.92	42.39		
Maine	33.46	32.99	33.02	32.54	33.18	40.13	39.93	48.00	47.00	43.00	42.00	41.00	39.05	37.96	38.00	40.00	48.00	55.86	55.52	41.95	39.00	37.84	37.60	37.00	40.58	43.24		
Mass Hub	34.21	33.80	33.84	33.30	33.93	37.82	40.38	39.86	40.30	39.69	43.22	42.18	40.12	38.80	38.90	38.85	47.80	58.78	58.31	43.80	42.44	40.15	37.62	36.95	40.63	43.18		
Cleared Load (GW)	10.2	9.9	9.9	9.9	10.2	10.9	13.4	14.2	14.1	14.2	14.3	14.2	14.0	14.0	13.9	14.0	14.6	15.2	15.4	15.2	14.1	13.1	11.8	10.4				

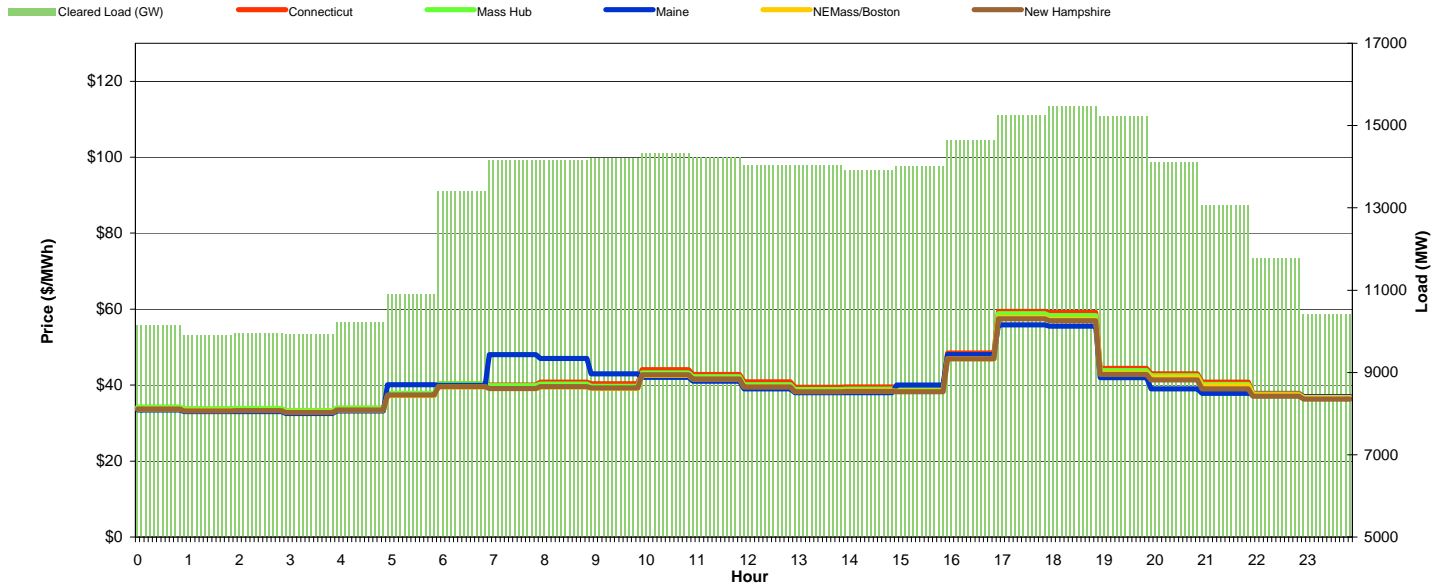

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	31.63	27.78	29.62	31.67	32.43	37.94	54.32	40.77	44.45	38.30	38.71	36.84	36.01	36.29	34.62	33.75	51.57	118.28	59.38	37.72	35.26	36.11	38.20	33.92	41.48	44.77	All	On Pk
NEMass/Boston	31.47	27.48	29.31	31.43	32.13	37.85	53.38	39.73	42.99	36.91	37.32	35.68	34.75	35.09	33.56	32.80	49.94	109.07	57.15	36.57	34.11	35.10	37.70	33.70	40.22	43.03		
New Hampshire	31.08	27.20	29.05	31.18	31.85	37.53	53.21	39.68	43.01	36.80	37.09	35.49	34.51	34.81	33.21	32.42	49.36	107.13	56.34	36.05	33.66	34.65	37.02	33.13	39.81	42.58		
Maine	30.38	26.55	28.42	30.54	31.17	37.35	53.26	39.13	42.37	35.79	35.98	34.61	33.48	33.79	32.26	31.50	47.81	103.75	53.52	34.44	32.18	33.71	35.92	31.97	38.75	41.27		
Mass Hub	31.75	27.79	29.64	31.78	32.52	38.17	54.08	40.42	43.86	37.72	38.20	36.43	35.49	35.81	34.20	33.42	51.06	113.76	58.63	37.38	34.85	35.76	38.21	34.07	41.04	44.08		
DA Forecast Load (GW)	11.00	10.80	10.74	10.85	11.34	12.79	14.94	16.15	16.43	16.53	16.51	16.42	16.21	16.05	15.87	15.98	16.71	17.88	17.69	17.10	16.24	14.93	13.38	12.03				
Forecast Error %	-0.4%	-1.1%	-0.7%	-0.2%	-0.6%	-6.2%	-6.9%	-7.7%	-8.1%	-8.4%	-8.1%	-7.7%	-7.5%	-6.9%	-7.0%	-7.7%	-7.4%	-5.6%	-5.2%	-4.9%	-4.7%	-4.3%	-3.9%	-3.7%				

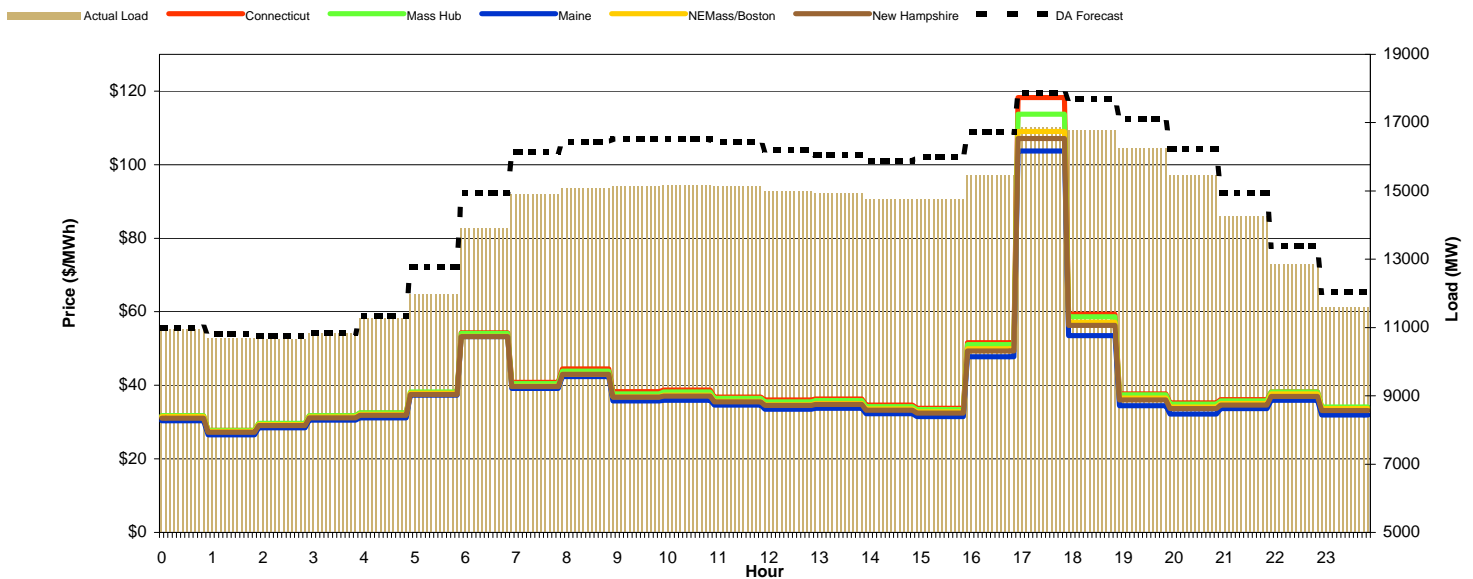




ISO-NE Daily Report

Tuesday November 08, 2011

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	32.40	31.73	30.87	30.06	31.62	32.58	39.85	40.96	39.41	38.60	38.47	38.44	38.42	35.55	34.03	34.72	38.66	55.70	47.40	38.30	38.26	36.13	35.38	36.05	37.23	39.28	All	On Pk
NEMass/Boston	32.17	31.38	30.57	29.68	31.32	32.13	39.23	39.74	38.15	45.24	42.00	41.00	39.64	59.29	46.72	59.38	61.35	65.15	61.02	57.97	41.53	38.11	40.00	35.58	43.26	48.52		
New Hampshire	31.86	31.18	30.41	29.55	31.21	31.84	38.78	39.45	37.94	37.19	37.22	37.21	37.03	34.08	32.73	33.36	37.31	53.19	41.47	37.04	36.93	34.63	34.21	35.23	35.88	37.56		
Maine	30.80	30.06	29.38	28.56	30.22	30.97	37.56	37.92	36.74	35.98	36.01	36.02	35.86	32.68	31.72	32.09	36.11	41.36	40.13	36.28	35.84	33.58	33.01	36.02	34.37	35.71		
Mass Hub	32.61	31.84	30.99	30.09	31.75	32.62	39.80	40.38	38.79	38.02	37.98	37.95	37.83	34.97	33.52	34.26	38.16	54.76	52.84	38.04	37.95	35.57	35.08	36.01	37.16	39.13		
Cleared Load (GW)	10.4	10.0	9.8	9.6	10.0	10.8	13.0	13.9	13.9	13.9	14.1	14.0	13.8	13.7	13.6	13.8	14.7	15.3	15.4	14.6	14.2	13.0	11.7	10.3				

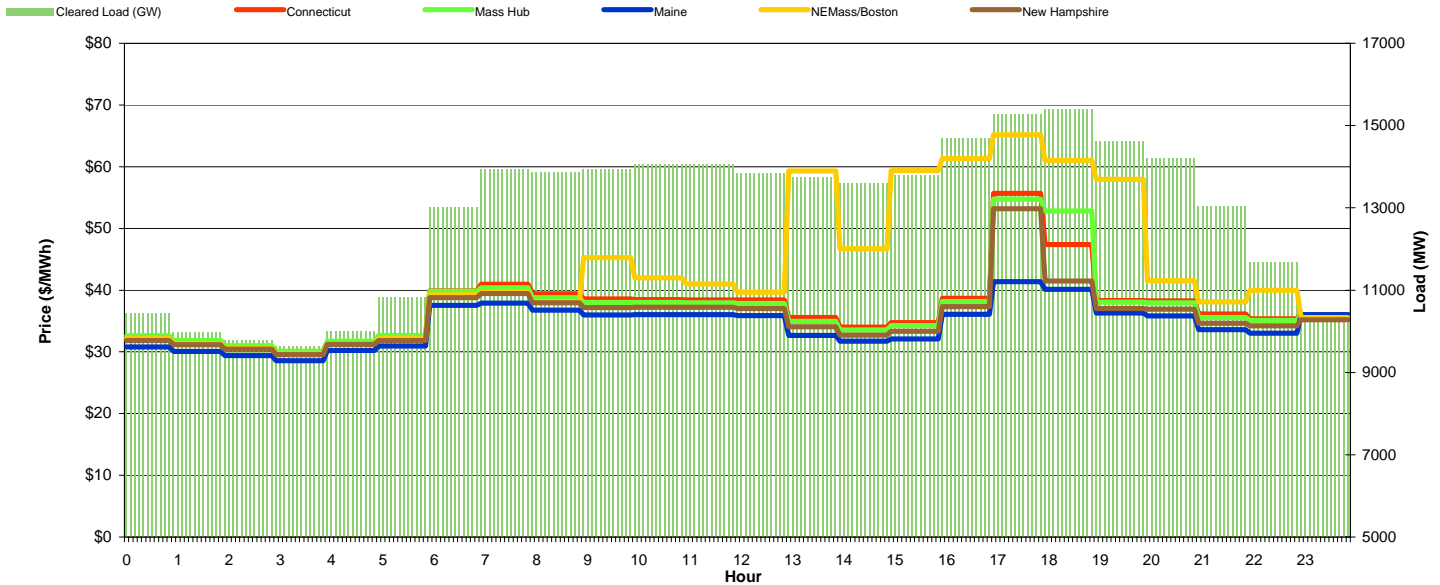

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	30.93	30.78	30.56	31.21	32.44	33.78	48.98	44.73	35.52	40.90	53.25	39.94	49.44	59.39	46.94	36.59	46.13	52.00	39.40	43.08	34.06	31.05	30.15	30.01	39.64	42.66	All	On Pk
NEMass/Boston	30.63	30.36	30.10	30.63	31.77	33.03	47.97	43.28	34.35	39.47	51.34	38.73	47.95	57.75	45.63	35.68	51.22	71.04	36.16	41.63	33.04	30.19	29.51	29.66	39.63	42.94		
New Hampshire	30.18	30.07	29.85	30.41	31.51	32.69	47.33	42.83	34.03	39.13	50.93	38.26	47.34	56.91	44.88	35.14	44.16	43.93	35.79	41.30	32.76	29.98	29.19	29.41	37.83	40.41		
Maine	28.96	28.97	28.80	29.46	30.50	31.63	40.10	37.91	32.40	31.05	30.86	30.53	30.42	30.56	30.43	30.78	40.53	31.65	31.36	39.82	31.80	29.10	28.16	28.75	31.86	32.34		
Mass Hub	31.02	30.78	30.52	31.09	32.26	33.53	48.73	44.15	35.04	40.35	52.50	39.54	48.92	58.88	46.48	36.26	45.45	45.51	36.78	42.37	33.59	30.66	29.79	29.84	38.92	41.64		
DA Forecast Load (GW)	10.85	10.40	10.13	10.12	10.44	11.58	13.48	14.75	15.02	15.12	15.21	15.19	15.14	15.14	15.02	14.96	15.88	16.84	16.66	16.15	15.41	14.29	12.85	11.54				
Forecast Error %	2.2%	4.7%	5.4%	5.5%	5.5%	2.2%	0.1%	-1.6%	-1.2%	-0.9%	-0.5%	0.0%	-0.2%	-0.3%	-0.5%	-0.5%	-2.2%	-0.5%	-0.3%	-0.6%	-0.9%	-1.2%	-1.6%	-1.5%				

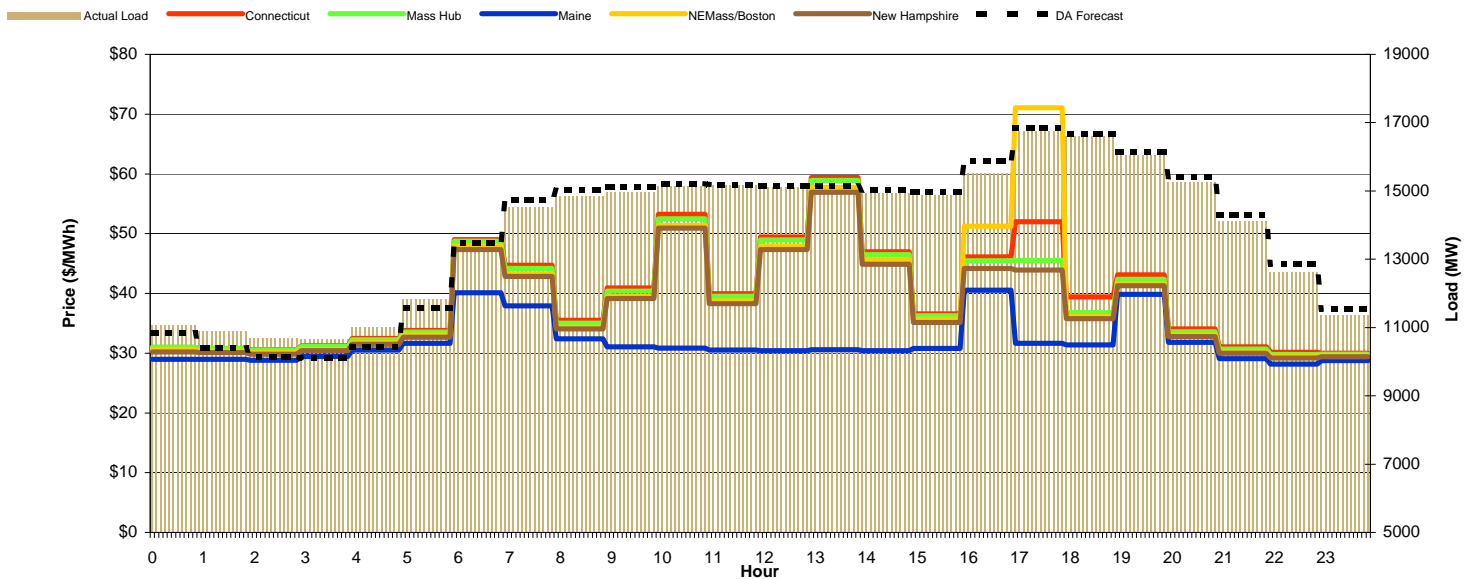




ISO-NE Daily Report

Wednesday November 09, 2011

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	30.71	28.90	26.35	26.30	28.32	31.60	38.79	38.46	38.51	38.68	39.36	39.48	39.38	38.80	38.25	36.89	41.76	58.20	51.64	39.25	38.52	37.45	35.17	33.71	37.27	40.61	All	On Pk
NEMass/Boston	30.45	28.52	26.05	25.89	27.97	31.35	37.88	37.28	37.29	37.37	38.13	38.22	38.06	37.53	37.08	35.85	40.00	55.94	49.62	37.69	37.15	36.51	34.33	33.17	36.22	39.25		
New Hampshire	30.38	28.43	25.99	25.87	27.94	31.38	37.85	37.36	37.45	37.60	38.31	38.41	38.20	37.68	37.24	35.92	40.35	56.00	49.79	37.82	37.10	36.47	34.24	33.00	36.28	39.37		
Maine	29.83	27.87	25.33	25.19	27.34	30.84	40.79	41.26	37.57	37.63	37.65	38.00	37.63	37.58	37.50	37.49	43.00	55.43	52.00	39.00	37.44	35.99	37.18	35.00	36.86	40.15		
Mass Hub	30.69	28.80	26.31	26.15	28.20	31.53	38.55	37.99	37.95	38.11	38.84	38.95	38.86	38.22	37.66	36.39	40.87	57.24	50.68	38.37	37.79	36.93	34.70	33.41	36.80	39.97		
Cleared Load (GW)	10.2	9.8	9.9	9.7	9.8	10.6	13.1	14.1	14.0	14.1	14.2	14.3	14.2	14.1	13.8	14.0	15.0	15.8	15.6	14.8	14.4	13.2	11.8	10.6				

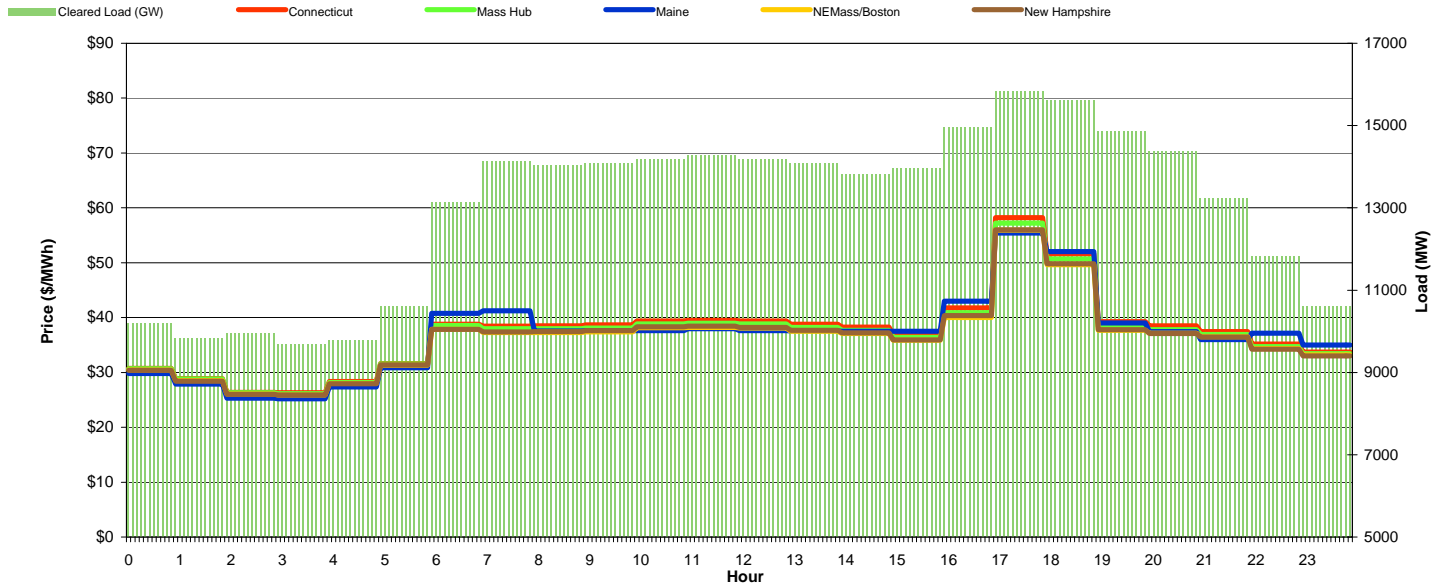

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	31.60	30.63	30.06	29.90	30.58	33.07	37.16	37.16	36.15	37.75	39.86	41.51	38.12	38.14	34.59	32.95	36.44	79.43	38.88	42.20	35.73	33.31	37.37	33.64	37.34	39.97	All	On Pk
NEMass/Boston	31.09	30.12	29.52	29.39	30.09	32.52	36.43	36.03	35.13	36.61	38.53	40.07	36.89	36.99	33.73	32.15	35.43	76.84	37.61	40.67	34.70	32.43	36.59	33.49	36.38	38.78		
New Hampshire	31.02	30.14	29.54	29.41	30.17	32.64	36.32	35.89	35.02	36.52	38.51	40.04	36.72	36.86	33.56	32.00	35.31	76.92	37.57	40.56	34.41	32.13	36.34	33.15	36.28	38.65		
Maine	30.37	29.67	29.22	29.20	30.15	32.91	36.52	35.71	34.79	36.07	38.23	39.73	36.25	36.61	33.34	31.95	35.44	77.14	37.61	40.43	33.94	31.41	35.76	32.70	36.05	38.40		
Mass Hub	31.36	30.38	29.77	29.64	30.33	32.82	36.84	36.54	35.59	37.11	39.13	40.72	37.42	37.48	34.05	32.45	35.81	77.86	38.10	41.40	35.27	32.94	37.13	33.74	36.83	39.31		
DA Forecast Load (GW)	10.65	10.19	9.95	9.94	10.26	11.37	13.27	14.50	14.83	15.01	15.10	15.06	15.08	15.08	14.98	14.91	15.82	16.79	16.56	16.06	15.31	14.15	12.76	11.46				
Forecast Error %	3.4%	5.0%	5.6%	5.5%	5.4%	3.2%	1.2%	-0.6%	-0.9%	-1.3%	-0.6%	0.0%	-0.8%	-0.6%	-1.0%	-0.9%	-2.4%	-0.6%	-0.3%	-0.3%	-0.4%	-0.1%	-0.3%	-0.3%				

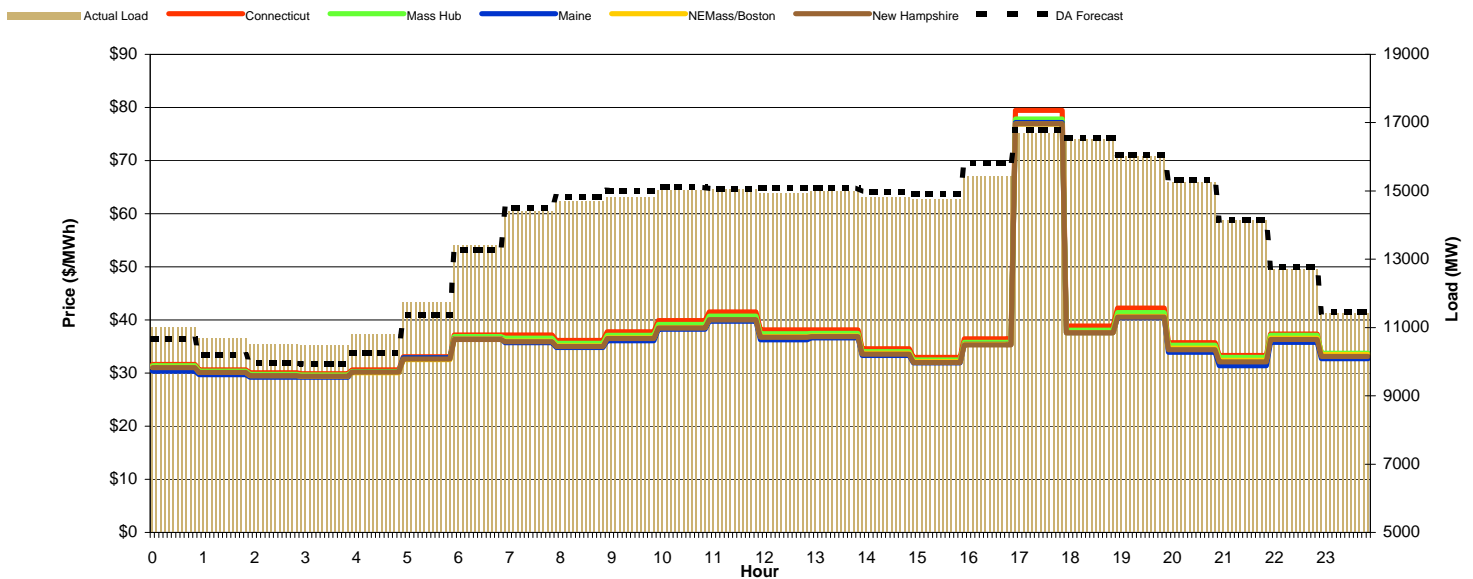




ISO-NE Daily Report

Thursday November 10, 2011

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	31.84	30.56	29.97	29.85	31.03	32.84	35.58	38.34	38.39	38.59	38.61	39.59	41.59	38.83	38.42	38.48	42.91	54.61	51.77	40.35	38.68	36.81	34.59	33.29	37.73	40.66	All	On Pk
NEMass/Boston	31.61	30.46	29.75	29.64	31.00	32.52	34.69	37.11	37.12	37.25	37.30	38.16	40.01	37.43	37.14	37.23	41.27	52.78	49.76	38.84	37.28	35.50	33.68	32.77	36.68	39.24		
New Hampshire	31.57	30.38	29.66	29.54	30.94	32.43	34.69	37.12	37.26	37.42	37.50	38.40	40.27	37.73	37.43	37.43	41.54	52.80	50.00	38.87	37.19	35.32	33.57	32.55	36.73	39.37		
Maine	30.99	30.38	30.33	28.81	30.42	40.09	66.44	37.42	37.60	38.49	41.00	42.03	41.00	41.00	41.00	42.15	49.00	56.00	55.00	38.33	37.74	34.90	37.22	34.02	40.06	41.87		
Mass Hub	31.83	30.62	29.95	29.81	31.14	32.73	35.36	37.88	37.80	37.97	37.98	38.98	40.86	38.25	37.81	37.90	42.14	54.02	50.81	39.49	37.98	36.21	34.15	33.05	37.28	40.01		
Cleared Load (GW)	9.7	9.6	9.3	9.3	9.6	10.3	12.6	14.0	14.0	14.2	14.5	14.6	14.7	14.7	14.4	14.4	15.1	15.9	15.5	14.7	13.9	13.0	11.8	10.6				

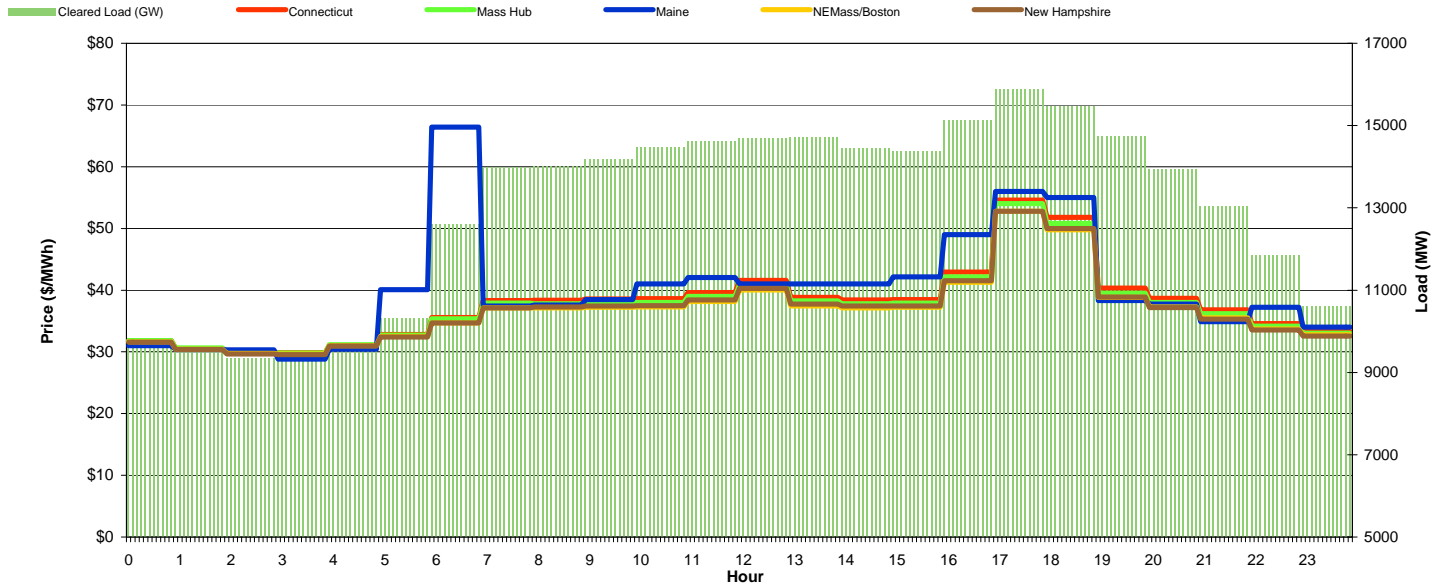

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	32.09	30.78	30.45	30.33	31.09	41.84	37.84	36.40	41.75	46.52	54.06	40.47	37.61	40.07	37.68	46.08	60.18	52.97	48.90	43.38	38.73	34.28	32.07	32.46	39.92	43.20	All	On Pk
NEMass/Boston	31.96	30.69	30.32	30.09	30.90	41.44	37.01	35.39	40.30	44.82	51.94	38.96	36.32	38.56	36.31	44.60	58.42	51.69	47.29	41.77	37.42	33.24	31.37	31.90	38.86	41.78		
New Hampshire	31.63	30.41	30.11	29.92	30.75	41.35	36.96	35.21	40.18	44.58	51.45	38.67	36.08	38.41	36.13	44.34	57.95	51.19	46.90	41.52	37.17	32.88	31.01	31.57	38.60	41.48		
Maine	31.21	29.97	29.66	29.34	30.51	41.51	36.88	34.91	39.46	43.48	49.93	37.78	35.13	37.32	35.17	43.47	56.70	50.42	45.81	40.29	36.29	31.80	29.87	30.56	37.81	40.49		
Mass Hub	32.14	30.85	30.49	30.28	31.08	41.73	37.44	35.88	40.97	45.60	52.92	39.64	36.86	39.17	36.86	45.26	59.27	52.39	48.04	42.48	38.03	33.75	31.73	32.23	39.38	42.43		
DA Forecast Load (GW)	10.62	10.15	9.91	9.88	10.17	11.27	13.29	14.53	14.97	15.20	15.36	15.31	15.29	15.28	15.19	15.19	16.14	16.94	16.58	16.09	15.30	14.14	12.79	11.48				
Forecast Error %	-0.5%	1.3%	2.2%	4.1%	2.1%	-0.9%	-1.6%	-1.8%	-1.3%	-1.0%	-0.3%	0.6%	0.5%	0.6%	1.1%	1.9%	-0.2%	-1.0%	-0.4%	-0.7%	-0.6%	0.2%	0.5%	1.1%				

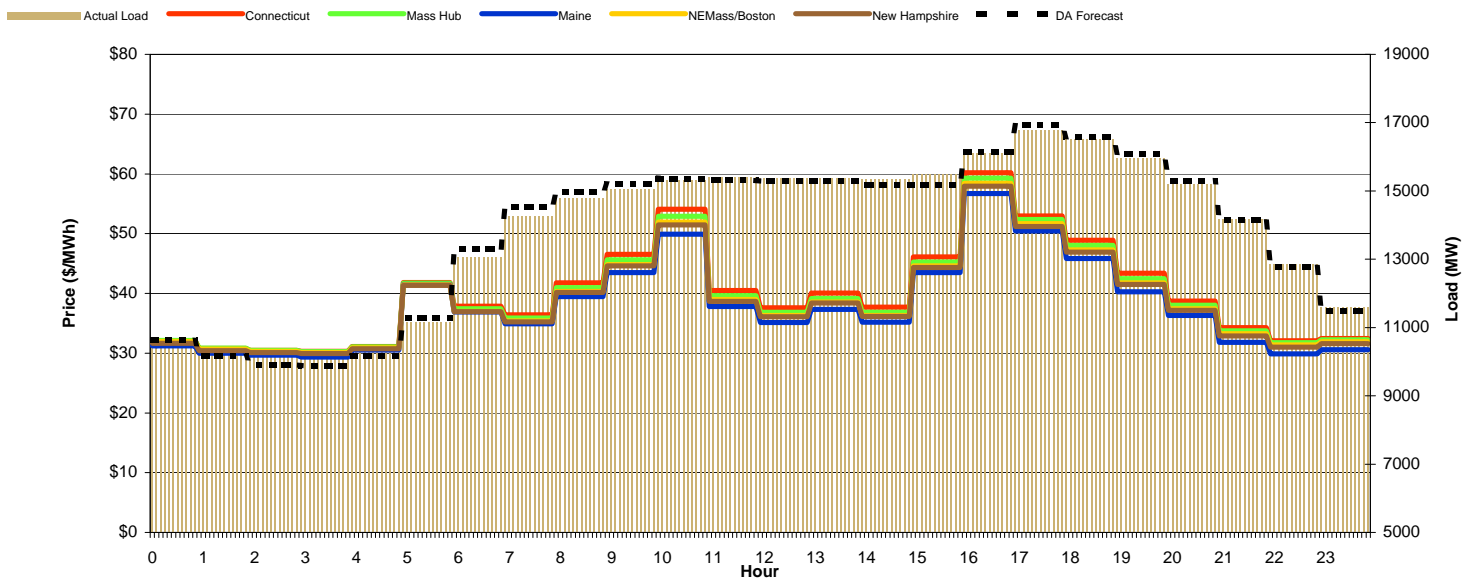




ISO-NE Daily Report

Friday November 11, 2011

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	33.87	32.77	32.24	32.23	32.18	34.51	39.88	38.88	40.16	39.56	40.39	40.83	39.01	38.77	38.74	38.82	39.51	55.16	47.74	49.34	41.05	38.81	36.80	33.70	38.96	41.47	All	On Pk
NEMass/Boston	32.51	31.59	31.03	30.98	31.08	33.18	38.63	37.35	38.29	37.86	38.54	38.87	37.27	37.13	37.19	37.12	37.87	52.98	45.77	46.81	39.03	37.18	35.41	32.76	37.35	39.67		
New Hampshire	32.80	31.82	31.33	31.29	31.33	33.42	38.65	37.37	38.31	37.91	38.66	39.02	37.32	37.16	37.17	37.07	37.83	52.65	45.37	46.62	38.74	37.05	35.48	32.78	37.38	39.61		
Maine	31.94	30.76	30.19	30.10	30.31	32.52	33.72	35.51	33.57	33.69	34.02	37.86	36.20	35.15	33.98	35.97	37.16	39.79	38.73	38.00	33.30	32.66	35.00	40.17	34.60	35.66		
Mass Hub	33.44	32.41	31.79	31.77	31.81	34.00	39.55	38.26	39.38	38.80	39.43	39.78	38.12	37.94	37.99	37.95	38.85	54.42	46.89	48.00	40.13	38.11	36.23	33.54	38.27	40.64		
Cleared Load (GW)	10.8	10.6	10.3	10.3	10.4	11.1	12.7	13.7	14.1	14.4	14.4	14.3	14.1	14.0	13.8	13.8	14.8	15.9	15.6	14.8	14.6	13.6	12.5	11.2				

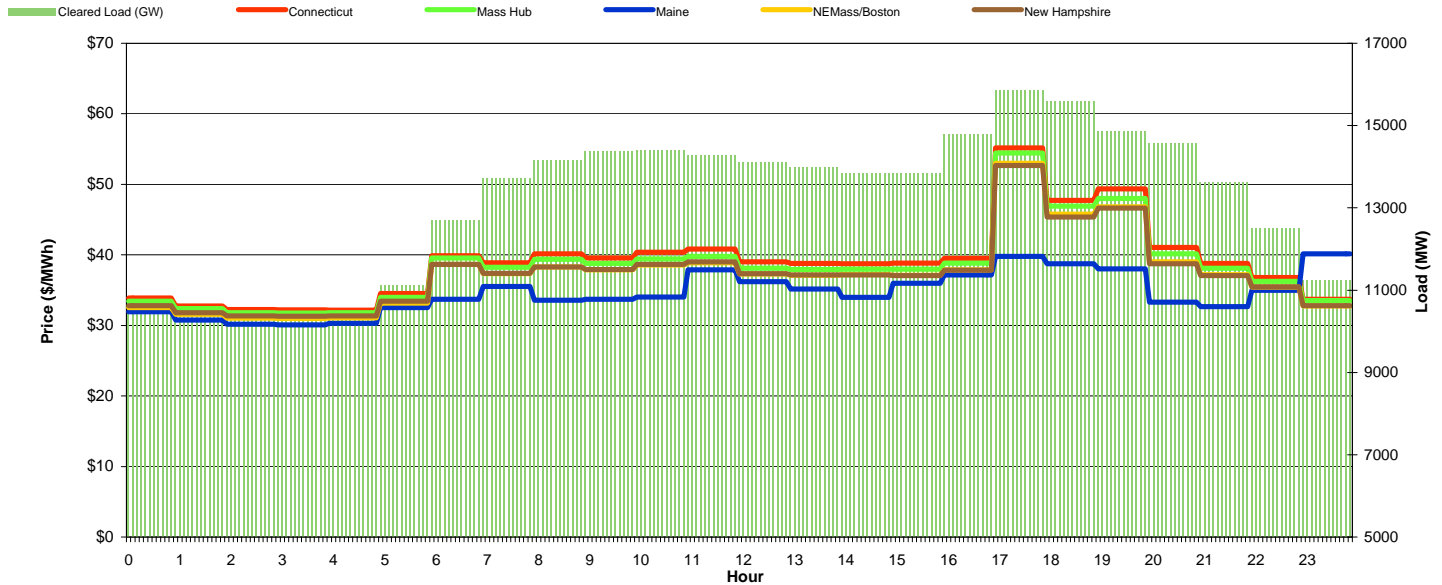

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	32.21	32.38	32.58	32.32	32.42	32.30	37.98	61.66	60.69	43.23	36.72	40.58	37.18	39.50	37.60	40.02	47.56	44.19	54.46	52.22	35.90	36.83	43.40	37.91	40.91	44.48	All	On Pk
NEMass/Boston	31.21	31.10	31.19	31.00	31.20	31.24	36.50	35.58	33.79	34.57	34.98	38.48	35.35	37.68	35.93	37.95	43.22	42.25	51.78	49.47	34.11	35.01	41.66	36.70	36.75	38.86		
New Hampshire	31.10	31.15	31.34	31.16	31.27	31.28	36.37	35.39	33.57	34.36	34.81	38.32	35.17	37.47	35.73	37.79	43.00	41.84	51.35	49.20	33.91	34.79	41.42	36.38	36.59	38.63		
Maine	30.17	28.54	29.47	27.72	29.43	29.29	25.26	33.47	32.13	32.51	32.64	33.05	33.00	32.66	32.32	32.12	32.71	32.13	32.07	32.19	30.01	30.10	37.74	34.90	31.48	32.55		
Mass Hub	31.68	31.67	31.79	31.58	31.74	31.76	37.18	36.55	34.63	35.30	35.68	39.31	36.09	38.40	36.58	38.69	44.04	43.00	52.78	50.47	34.78	35.75	42.33	37.22	37.46	39.65		
DA Forecast Load (GW)	10.72	10.24	9.99	10.00	10.27	11.08	12.45	13.53	14.30	14.77	15.00	15.02	14.87	14.74	14.68	14.72	15.84	17.02	16.73	16.10	15.37	14.28	13.07	11.88				
Forecast Error %	2.4%	7.8%	10.8%	9.7%	6.3%	1.4%	0.0%	0.8%	1.0%	0.5%	0.0%	-0.3%	-0.2%	0.2%	-0.1%	0.0%	-2.1%	-2.5%	-2.4%	-2.1%	-1.3%	0.6%	1.5%	2.5%				

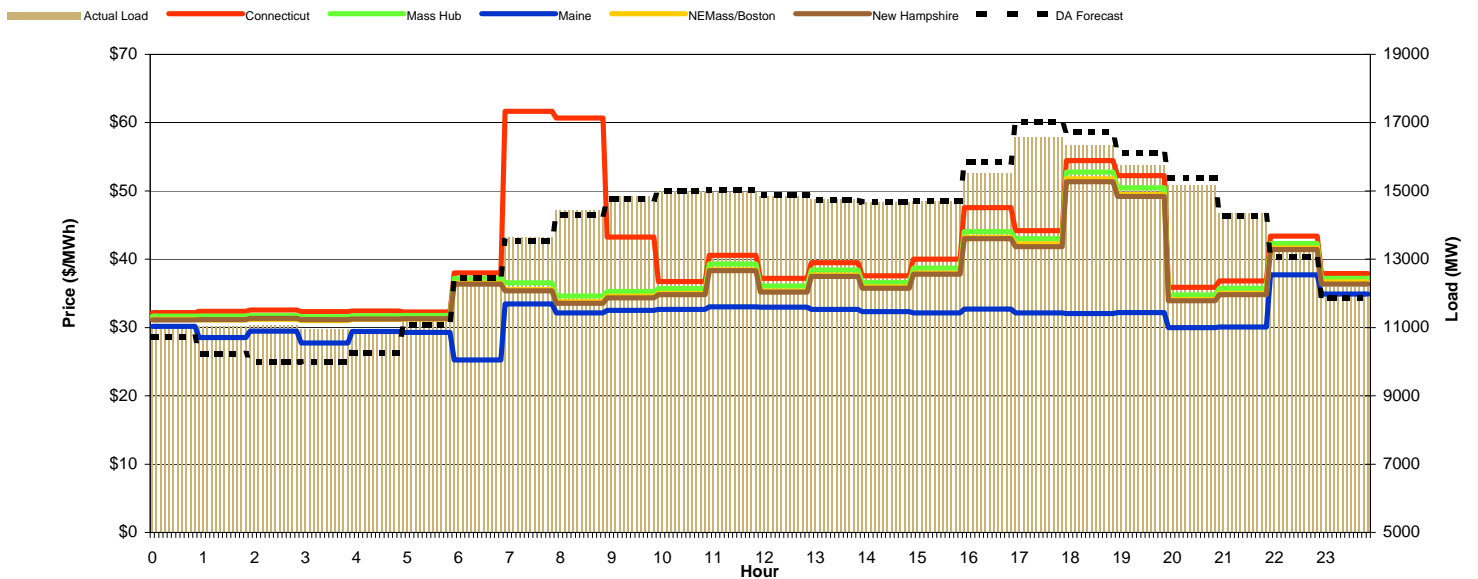




ISO-NE Daily Report

Saturday November 12, 2011

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$	
Connecticut	32.91	31.15	30.36	29.80	30.35	32.40	33.98	43.53	58.79	59.93	59.68	60.81	58.21	40.00	40.00	33.17	46.00	66.50	66.36	63.59	62.04	55.96	35.38	33.10	46.00	53.12
NEMass/Boston	31.69	30.24	29.44	28.93	29.47	31.30	32.52	32.94	36.94	38.33	36.99	35.86	34.84	33.52	31.88	31.88	35.68	40.20	39.08	37.09	35.34	33.14	33.92	31.93	33.88	35.48
New Hampshire	31.54	30.12	29.41	28.90	29.47	31.20	32.55	32.95	37.03	38.36	36.96	35.76	34.79	33.52	31.88	31.86	35.67	40.19	39.04	37.00	35.18	33.02	33.87	32.03	33.85	35.44
Maine	30.40	29.19	28.40	27.91	28.51	30.24	31.58	32.09	36.65	38.12	36.57	35.20	34.20	32.92	31.25	31.34	39.00	55.00	38.85	36.46	34.60	32.19	33.04	31.49	33.97	36.09
Mass Hub	32.42	30.86	30.03	29.52	30.07	31.95	33.39	33.94	37.94	39.31	37.89	36.78	35.73	34.22	32.53	32.45	36.49	41.55	40.08	37.83	36.14	34.03	34.64	32.62	34.68	36.35
Cleared Load (GW)	11.0	10.6	10.5	10.5	10.5	10.8	11.4	12.3	13.0	13.3	13.2	13.2	13.0	12.9	12.7	12.7	13.4	14.7	14.5	13.9	13.4	12.9	12.0	11.3		

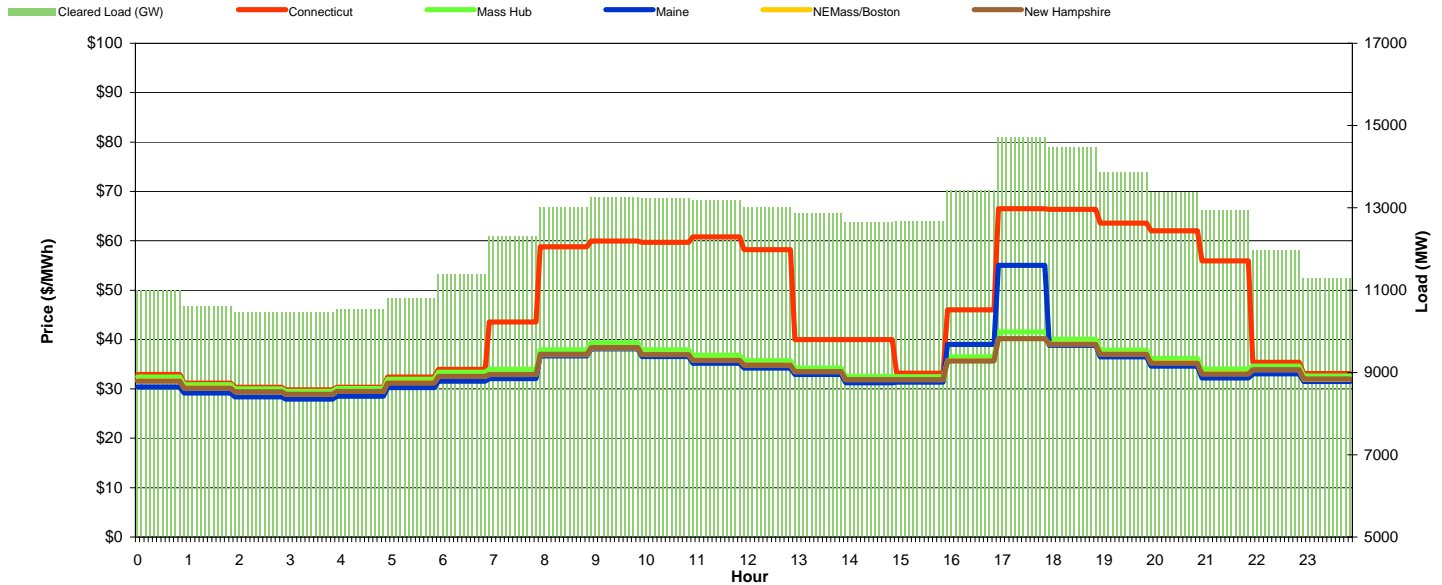

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$	
Connecticut	29.82	29.27	29.13	28.95	29.09	29.22	30.67	32.20	32.89	33.56	34.08	33.35	33.13	32.90	32.66	33.57	44.59	63.89	52.08	43.36	47.17	34.47	33.07	30.10	35.55	38.56
NEMass/Boston	28.87	28.29	28.17	27.98	28.09	28.13	29.49	30.77	31.42	32.09	32.55	31.89	31.70	31.51	31.34	32.15	42.88	39.74	43.87	41.54	45.17	32.87	31.76	29.20	32.98	35.20
New Hampshire	28.68	28.12	28.04	27.84	28.01	28.09	29.44	30.74	31.37	32.01	32.36	31.68	31.55	31.43	31.25	31.99	42.61	38.11	43.24	41.17	44.79	32.66	31.61	29.14	32.75	34.91
Maine	26.53	27.22	27.19	27.01	27.21	27.39	28.51	29.72	30.72	31.48	31.59	30.91	30.85	30.81	30.73	31.23	41.91	37.04	42.26	40.12	43.50	30.43	29.40	28.27	31.75	33.92
Mass Hub	29.28	28.68	28.56	28.37	28.49	28.58	30.00	31.36	32.03	32.71	33.20	32.51	32.30	32.10	31.94	32.89	43.84	89.52	59.12	42.52	46.23	33.67	32.45	29.67	36.25	39.90
DA Forecast Load (GW)	11.09	10.63	10.34	10.25	10.36	10.81	11.54	12.35	13.31	13.75	13.91	13.79	13.56	13.28	13.16	13.29	14.31	15.50	15.20	14.76	14.20	13.45	12.48	11.48		
Forecast Error %	2.2%	1.9%	4.4%	4.2%	4.2%	2.1%	1.8%	2.3%	1.4%	1.5%	1.0%	1.1%	1.2%	1.4%	0.8%	0.5%	0.1%	0.6%	1.0%	0.8%	0.8%	1.2%	1.6%	1.7%		

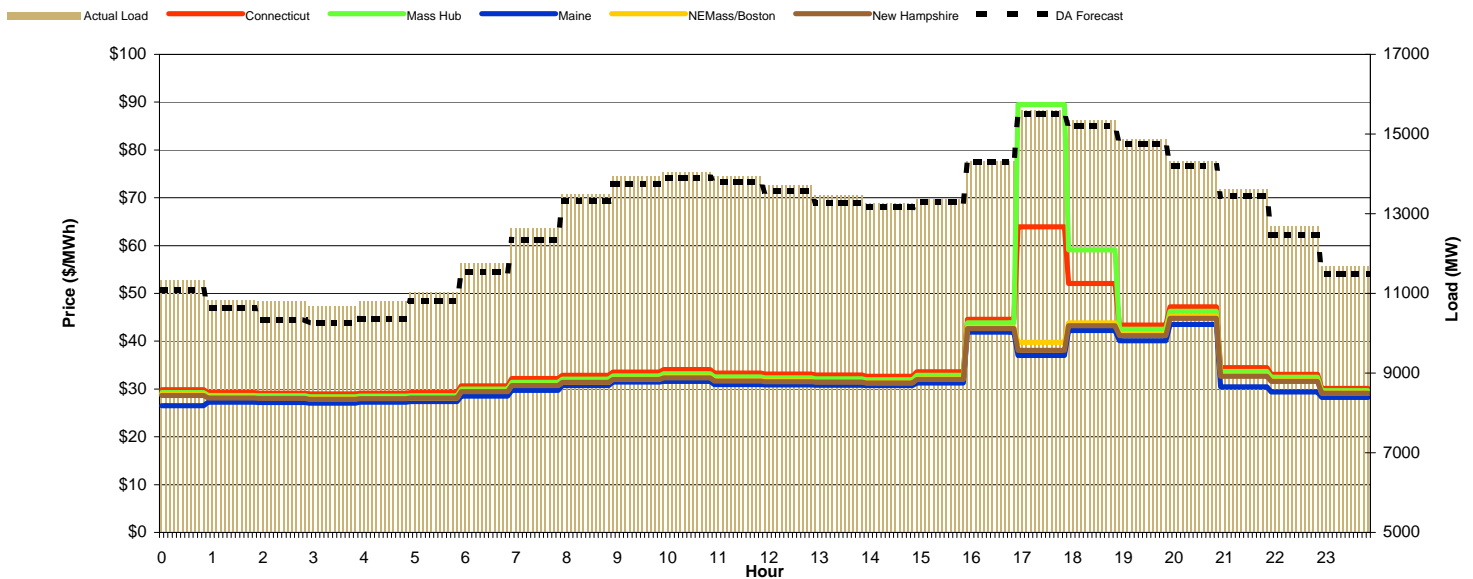




ISO-NE Daily Report

Sunday November 13, 2011

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$	
Connecticut	30.27	29.20	29.08	28.94	29.10	29.29	29.45	31.61	32.04	32.36	32.92	31.87	31.84	32.02	31.88	31.46	37.05	50.76	44.92	38.81	36.39	33.05	32.31	32.07	33.28	35.08
NEMass/Boston	29.10	27.93	27.97	27.81	28.01	28.14	28.27	30.46	30.97	31.32	31.72	30.73	30.70	30.89	30.71	30.50	35.69	48.36	42.82	37.31	34.86	31.85	31.10	30.81	32.00	33.75
New Hampshire	29.26	28.08	28.01	27.88	28.11	28.34	28.48	30.69	31.12	31.40	31.84	30.80	30.73	30.97	30.83	30.56	35.65	48.22	42.78	37.18	34.70	31.93	31.13	30.93	32.07	33.78
Maine	28.64	27.59	27.47	27.36	27.68	28.01	29.20	30.30	30.70	31.07	31.40	30.56	30.47	30.56	30.39	30.15	39.00	55.00	42.66	36.70	33.98	31.61	30.68	37.00	32.42	34.08
Mass Hub	29.78	28.61	28.55	28.40	28.61	28.81	28.91	31.16	31.73	32.07	32.42	31.44	31.41	31.58	31.41	31.11	36.72	50.12	44.20	38.13	35.79	32.52	31.74	31.37	32.77	34.60
Cleared Load (GW)	10.6	10.2	9.9	9.8	10.0	10.4	10.4	11.0	11.9	12.3	12.2	12.3	12.2	12.1	12.0	12.2	13.2	14.6	14.4	13.7	13.2	12.4	11.3	10.3		

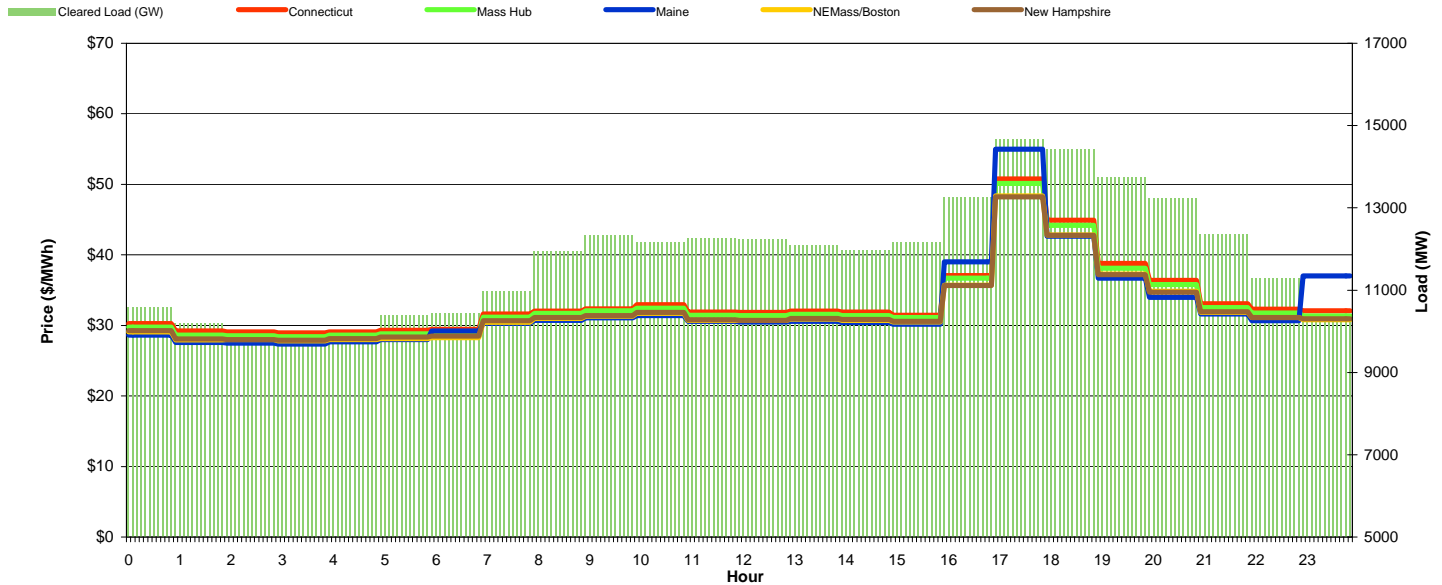

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$	
Connecticut	29.07	28.77	28.96	28.37	28.42	28.72	29.42	32.03	31.32	32.30	33.02	32.80	32.98	32.61	31.88	31.73	52.29	46.55	41.02	37.80	38.12	32.68	29.59	32.47	33.46	35.55
NEMass/Boston	27.97	27.56	27.80	27.29	27.32	27.58	28.28	30.71	30.09	31.08	31.68	31.52	31.64	31.32	30.65	30.61	50.52	44.35	35.34	36.18	36.42	31.37	28.32	31.35	31.96	33.86
New Hampshire	28.02	27.64	27.91	27.38	27.42	27.75	28.43	30.92	30.27	31.24	31.73	31.51	31.55	31.31	30.70	30.67	50.24	44.04	34.88	35.86	36.14	31.22	28.23	31.23	31.93	33.78
Maine	27.44	27.08	27.30	26.83	26.84	27.35	27.98	30.50	29.78	30.81	31.18	31.22	31.20	30.76	30.19	30.35	50.19	43.63	34.43	35.19	35.31	30.88	27.79	30.83	31.46	33.34
Mass Hub	28.46	28.08	28.30	27.75	27.79	28.08	28.79	31.27	30.68	31.70	32.34	32.17	32.31	31.95	31.24	31.17	51.44	45.32	44.77	36.95	37.21	32.01	28.89	31.82	32.94	35.09
DA Forecast Load (GW)	10.79	10.34	10.08	9.99	10.07	10.41	10.86	11.47	12.44	12.98	13.17	13.23	13.17	13.00	12.87	13.01	14.14	15.36	15.10	14.73	14.18	13.15	11.99	10.97		
Forecast Error %	3.2%	3.8%	6.1%	6.0%	5.8%	4.0%	1.5%	1.5%	0.8%	1.1%	1.5%	1.5%	1.5%	1.8%	2.4%	3.3%	4.0%	3.3%	3.7%	2.5%	1.9%	1.9%	2.5%	3.5%		

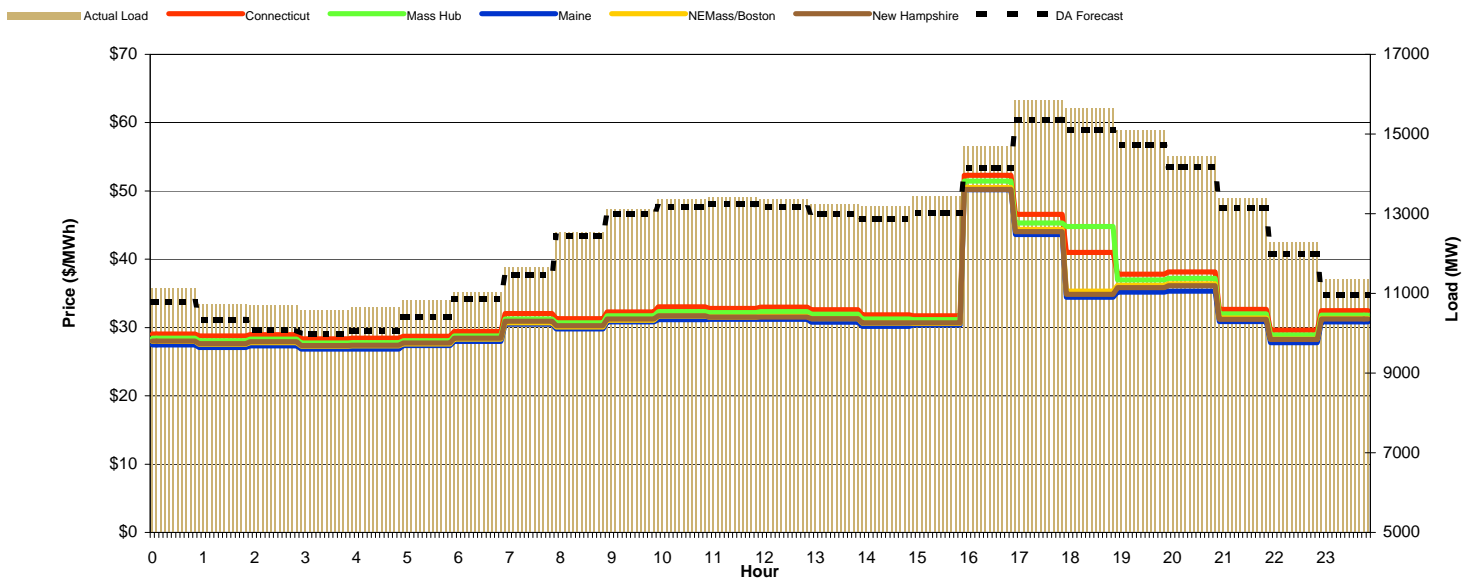




ISO-NE Daily Report

Monday November 14, 2011

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	33.00	30.81	29.22	29.17	31.09	35.48	40.15	40.73	39.42	41.06	44.00	43.99	43.00	43.00	41.08	41.95	51.37	65.15	52.77	48.26	42.57	40.00	37.07	33.18	40.73	44.71	All	On Pk
NEMass/Boston	32.16	30.02	28.38	28.33	30.44	34.59	38.68	38.91	37.21	38.91	40.48	39.97	40.59	40.11	38.97	39.91	49.20	62.37	50.53	43.11	38.91	37.04	35.56	32.09	38.60	41.99		
New Hampshire	32.30	30.21	28.55	28.51	30.67	34.77	38.93	38.98	37.46	39.30	40.99	40.43	41.00	40.54	39.33	40.38	49.63	62.16	50.42	43.55	39.36	37.36	35.79	32.23	38.87	42.29		
Maine	37.00	29.66	27.97	27.95	39.91	40.06	46.48	47.35	36.92	38.57	40.00	39.33	39.88	39.34	38.41	39.85	48.79	60.72	49.37	42.71	45.00	36.75	35.00	31.55	39.94	42.37		
Mass Hub	32.56	30.47	28.80	28.75	30.78	34.99	39.38	39.76	37.90	39.64	40.75	40.00	41.44	40.71	39.82	40.74	50.15	63.72	51.51	42.63	39.00	37.25	35.97	32.52	39.14	42.56		
Cleared Load (GW)	9.8	9.7	9.4	9.4	9.7	10.4	12.7	13.6	13.9	14.1	14.2	14.2	14.2	14.2	14.1	14.1	14.7	15.6	15.3	14.6	14.0	13.0	11.8	10.7				

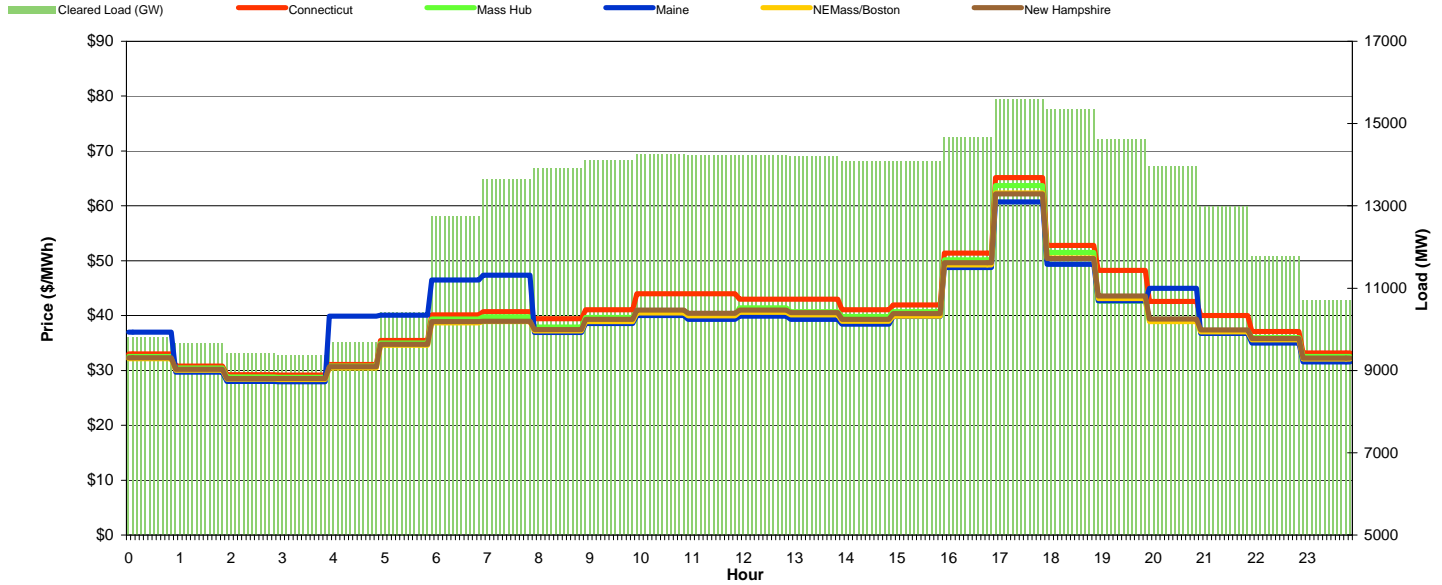

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	33.01	30.05	29.77	29.54	29.64	32.20	37.53	33.14	32.25	34.00	36.55	35.50	35.65	35.28	33.97	33.88	45.43	57.56	43.89	54.61	38.66	35.69	30.37	28.80	36.12	38.53	All	On Pk
NEMass/Boston	31.99	29.15	28.88	28.63	28.69	31.23	35.99	31.15	30.11	32.05	34.34	33.33	33.34	33.06	31.93	31.88	42.50	32.50	38.87	40.86	35.20	32.68	27.97	27.74	32.67	33.86		
New Hampshire	31.96	29.18	28.97	28.70	28.77	31.33	36.04	31.16	30.09	32.02	34.39	33.40	33.34	33.02	31.91	31.83	42.21	30.74	38.37	40.62	35.08	32.67	27.91	27.57	32.55	33.67		
Maine	31.44	28.63	28.40	27.97	27.80	30.63	35.31	30.38	29.09	30.33	30.23	29.66	29.81	30.06	29.39	30.31	39.30	28.43	29.64	29.03	31.18	31.97	27.40	26.82	30.13	30.39		
Mass Hub	32.42	29.54	29.27	29.02	29.08	31.61	36.49	31.62	30.48	32.57	35.00	33.96	33.97	33.74	32.56	32.50	43.47	83.09	45.28	41.88	35.51	32.95	28.08	28.10	35.51	37.92		
DA Forecast Load (GW)	10.33	9.97	9.79	9.80	10.18	11.30	13.19	14.40	14.82	15.03	15.21	15.21	15.17	15.10	14.96	14.99	15.99	17.10	16.60	16.13	15.35	14.16	12.72	11.43				
Forecast Error %	4.9%	5.7%	8.0%	7.8%	7.1%	2.9%	0.1%	-1.5%	-1.8%	-1.8%	-1.6%	-1.3%	-1.4%	-0.9%	-0.6%	0.1%	0.3%	-0.7%	0.7%	0.2%	0.2%	0.4%	0.4%	0.4%				

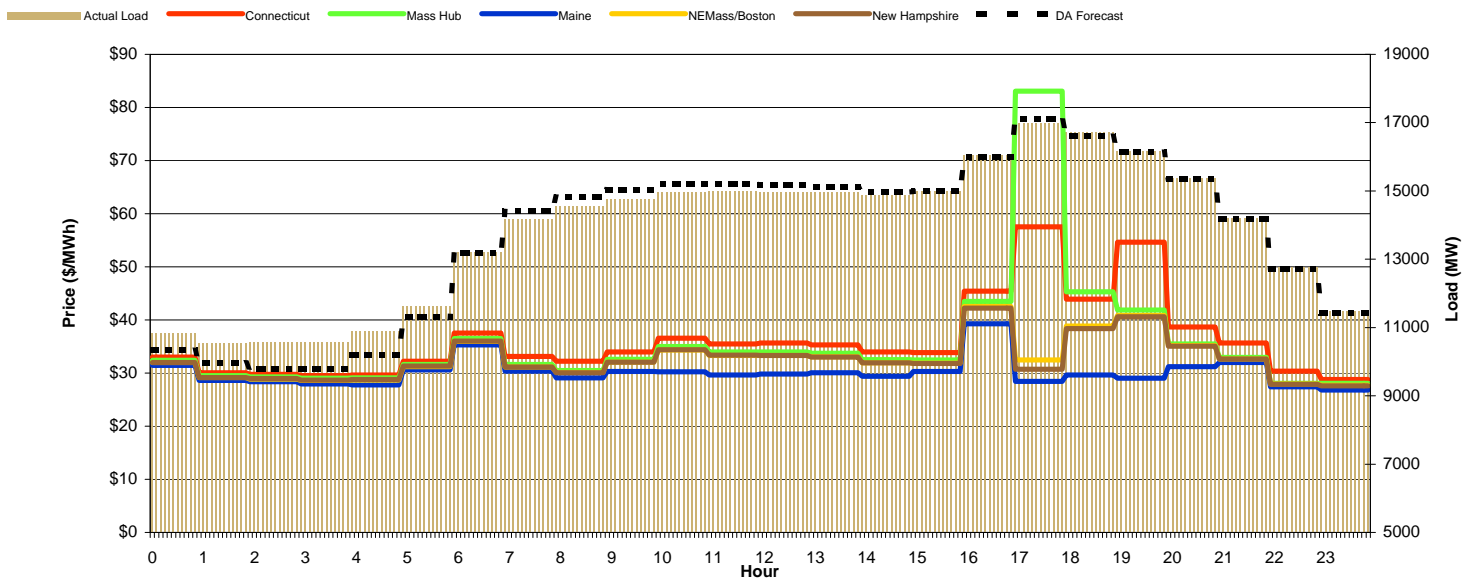




ISO-NE Daily Report

Tuesday November 15, 2011

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	27.26	27.26	26.43	24.83	27.20	29.07	33.66	37.02	37.35	38.53	41.04	41.82	41.84	41.63	40.89	37.78	41.39	58.42	49.57	45.00	40.97	35.56	31.52	30.32	36.93	41.27	All	On Pk
NEMass/Boston	26.65	26.44	25.65	24.15	26.44	28.69	32.65	34.50	35.45	36.57	37.16	37.31	37.30	37.29	37.22	36.23	39.30	55.61	47.24	40.30	37.17	32.20	30.56	29.60	34.65	38.21		
New Hampshire	26.70	26.57	25.74	24.21	26.62	28.76	32.59	34.53	35.62	36.71	37.36	37.60	37.60	37.55	37.46	36.36	39.44	55.37	47.12	40.34	37.20	32.28	30.66	29.71	34.75	38.33		
Maine	25.89	25.63	24.80	23.20	25.74	27.99	27.43	33.21	34.54	35.45	35.95	36.04	35.92	34.86	33.15	29.03	37.98	42.70	41.91	35.52	35.08	31.04	29.95	40.00	32.63	35.15		
Mass Hub	26.90	26.73	25.95	24.42	26.69	28.83	33.10	34.61	35.94	37.08	36.83	36.71	36.70	36.77	36.90	36.82	40.08	56.85	48.18	39.78	36.81	31.62	30.83	29.89	34.79	38.28		
Cleared Load (GW)	10.5	10.4	10.2	10.1	10.4	11.0	13.1	13.8	13.8	14.0	14.2	14.2	14.2	14.1	13.9	14.0	15.1	15.9	15.5	15.0	14.2	13.3	12.0	10.7				

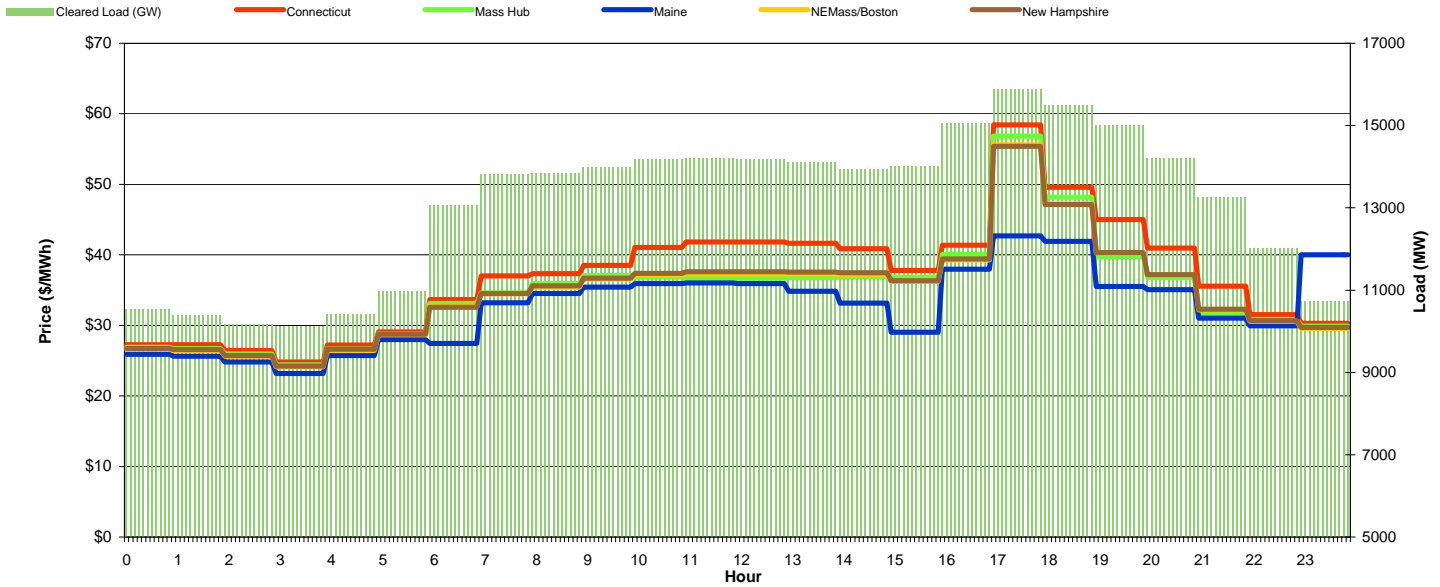

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	27.08	27.43	25.87	25.08	25.31	28.19	39.44	36.15	37.49	48.77	43.58	39.42	37.71	43.02	38.69	39.04	43.44	52.96	45.77	40.71	37.84	31.65	27.91	27.46	36.25	40.26	All	On Pk
NEMass/Boston	26.16	26.49	24.94	24.15	24.41	27.28	38.29	34.44	35.54	45.96	40.92	37.07	35.38	40.38	36.40	36.84	38.96	50.01	43.26	38.36	35.92	30.11	26.81	26.62	34.36	37.90		
New Hampshire	26.03	26.42	24.86	24.06	24.31	27.11	37.89	34.10	35.32	45.76	40.83	36.94	35.27	40.21	36.20	36.59	38.53	49.48	42.83	38.02	35.66	29.89	26.55	26.31	34.13	37.64		
Maine	25.28	25.74	24.18	23.24	23.45	26.14	24.70	26.92	27.00	27.23	27.19	27.42	26.91	26.37	26.90	25.76	27.63	26.96	27.11	25.86	20.70	24.10	22.29	25.22	25.60	26.02		
Mass Hub	26.46	26.78	25.22	24.43	24.68	27.56	38.74	35.04	36.28	47.02	41.87	37.86	36.14	41.24	37.12	37.55	44.76	51.02	44.13	39.13	36.56	30.61	27.16	26.88	35.18	38.97		
DA Forecast Load (GW)	10.72	10.23	9.98	9.93	10.25	11.33	13.35	14.43	14.85	15.22	15.41	15.38	15.35	15.27	15.18	15.19	16.15	16.95	16.59	16.08	15.37	14.11	12.83	11.60				
Forecast Error %	4.2%	6.6%	7.0%	7.1%	6.3%	2.4%	-1.5%	-0.9%	-1.2%	-2.0%	-1.7%	-1.1%	-1.4%	-0.7%	-1.0%	-0.9%	-1.0%	-0.2%	0.5%	0.4%	0.0%	1.0%	-0.4%	-1.0%				

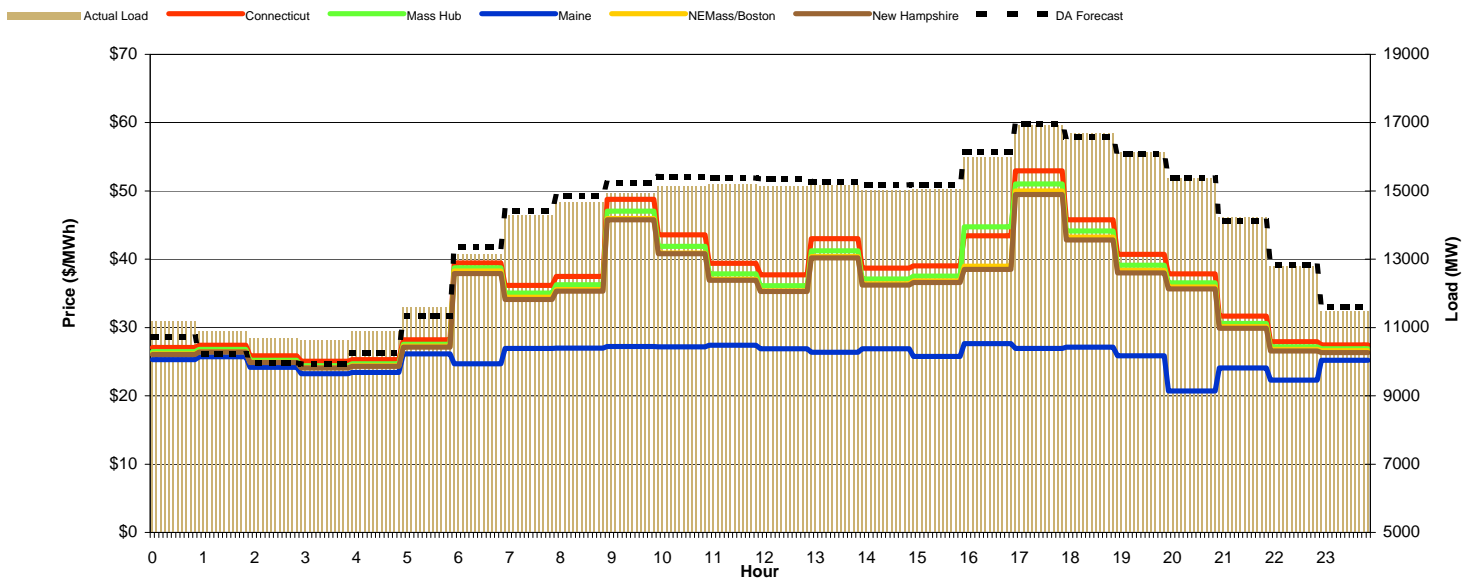




ISO-NE Daily Report

Wednesday November 16, 2011

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	28.32	25.76	25.81	25.06	26.68	31.35	37.65	39.17	38.96	39.31	39.15	39.23	39.15	40.92	38.96	39.09	43.92	59.35	50.96	45.48	40.28	39.38	33.12	30.16	37.38	41.65	All	On Pk
NEMass/Boston	27.57	25.03	25.06	24.36	25.99	30.62	36.32	36.37	36.98	37.25	37.26	37.29	37.29	39.00	37.22	37.37	41.93	57.02	48.62	41.83	38.14	35.97	32.02	29.35	35.66	39.47		
New Hampshire	27.58	25.00	25.08	24.37	25.99	30.71	36.39	36.49	37.20	37.35	37.32	37.38	37.40	39.06	37.24	37.40	41.89	56.48	48.45	41.91	38.25	36.10	31.95	29.35	35.68	39.49		
Maine	26.39	24.07	22.22	22.22	25.07	29.73	35.29	35.07	36.17	35.00	35.17	35.15	35.19	33.15	30.09	28.70	36.00	42.73	37.00	33.43	34.67	34.66	28.69	28.47	31.85	34.43		
Mass Hub	27.89	25.33	25.35	24.64	26.29	30.91	37.00	36.40	37.60	38.11	38.16	38.25	38.30	40.00	38.16	38.26	42.85	58.35	49.70	41.81	38.88	35.77	32.33	29.67	36.25	40.18		
Cleared Load (GW)	10.3	9.9	9.9	9.9	10.0	10.8	12.8	13.5	13.6	14.0	14.1	14.1	14.2	14.2	13.8	14.2	15.1	16.0	15.6	14.9	14.4	13.3	12.1	10.8				

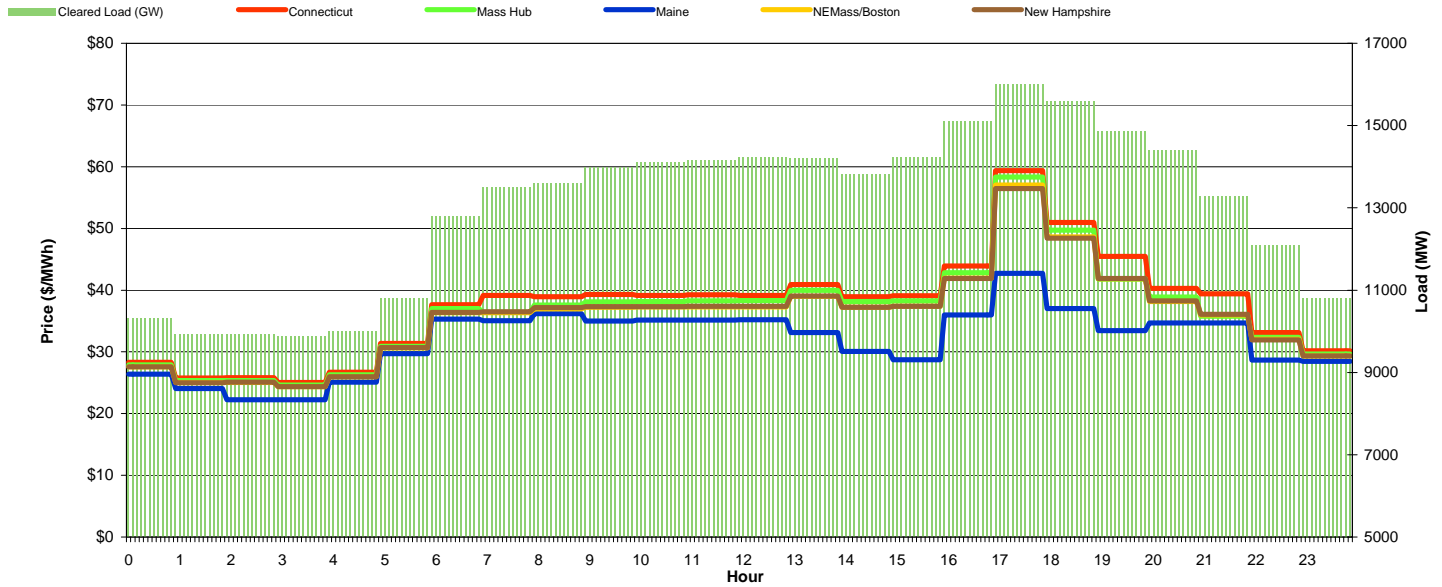

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	27.40	24.73	24.76	24.59	24.39	28.98	45.78	44.17	44.43	38.42	39.11	38.92	38.40	44.16	44.52	44.89	60.67	68.65	54.08	52.18	44.33	36.21	29.12	31.00	39.75	45.14	All	On Pk
NEMass/Boston	26.51	23.88	23.89	23.72	23.57	28.06	43.87	42.14	42.21	36.26	36.85	36.69	36.23	41.55	42.31	42.53	56.40	53.57	51.23	49.40	41.78	34.32	27.86	30.22	37.29	41.96		
New Hampshire	26.32	23.71	23.77	23.64	23.45	28.06	44.02	42.25	42.22	36.26	36.69	36.45	36.07	41.33	41.93	42.18	55.58	52.62	50.47	48.78	41.45	34.09	27.55	29.85	37.03	41.62		
Maine	25.37	22.95	23.00	22.86	22.74	27.55	43.23	41.65	41.41	35.43	35.46	34.34	34.88	31.07	32.33	27.71	35.85	38.42	36.80	31.94	28.49	25.66	25.97	18.08	30.97	33.59		
Mass Hub	26.77	24.13	24.15	23.98	23.82	28.35	44.65	42.92	43.00	36.99	37.70	37.53	37.05	42.41	43.00	43.27	57.43	54.63	52.20	50.30	42.54	34.89	28.20	30.43	37.93	42.75		
DA Forecast Load (GW)	10.66	10.18	9.95	9.93	10.23	11.34	13.28	14.45	14.86	15.10	15.25	15.20	15.27	15.21	15.26	16.30	17.15	16.72	16.26	15.45	14.27	12.88	11.59					
Forecast Error %	1.7%	4.3%	6.5%	7.0%	4.6%	1.0%	-0.9%	-0.8%	-1.0%	-1.2%	-1.0%	-0.2%	-0.6%	0.3%	0.9%	1.9%	1.4%	0.2%	1.2%	0.7%	0.8%	1.1%	0.6%	1.5%				

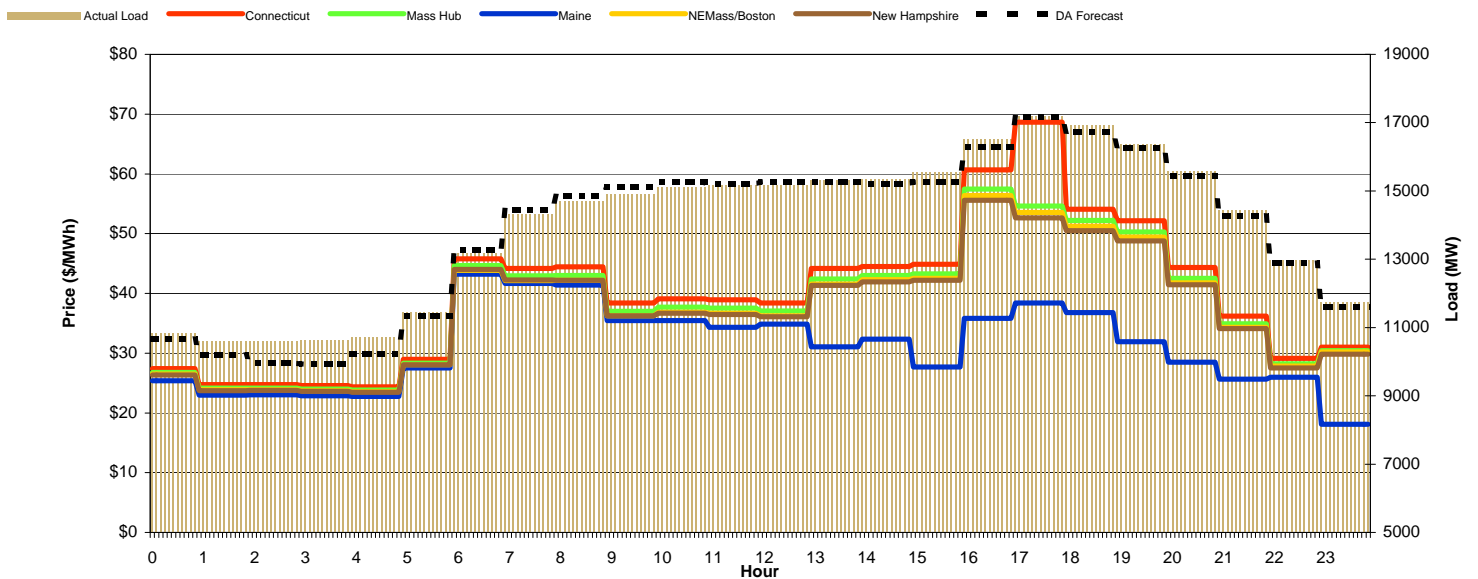




ISO-NE Daily Report

Thursday November 17, 2011

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	28.40	27.78	26.54	25.58	27.76	30.60	40.28	39.40	41.11	42.69	43.00	43.01	40.00	39.96	38.96	41.33	47.93	62.02	52.92	48.02	42.44	39.54	36.18	33.55	39.13	43.66	All	On Pk
NEMass/Boston	27.68	26.82	25.63	24.73	26.92	29.92	38.78	37.29	37.94	39.82	39.29	38.93	37.34	37.33	37.27	37.39	45.47	59.36	50.48	45.72	40.29	37.46	34.65	32.38	37.04	41.00	43.50	49.04
New Hampshire	27.40	26.64	25.46	24.54	26.76	29.62	38.70	37.13	37.78	39.62	39.10	38.80	37.20	37.18	37.04	37.18	45.06	58.17	49.85	45.24	40.04	37.14	34.31	32.19	36.76	40.68	41.17	46.16
Maine	26.46	25.80	24.69	23.70	25.73	28.63	38.15	30.73	36.33	37.83	30.17	28.85	27.97	27.58	27.25	27.74	39.17	43.65	41.46	37.76	28.92	36.08	33.11	31.59	31.64	33.41	32.29	33.69
Mass Hub	27.97	27.17	25.94	25.05	27.26	30.23	39.32	37.77	38.00	40.00	39.00	38.39	37.38	37.37	37.68	36.67	46.15	60.23	51.06	46.19	40.78	38.00	34.98	32.71	37.30	41.23	41.85	46.97
Cleared Load (GW)	10.2	10.0	9.9	9.9	10.0	11.0	13.2	14.2	14.2	14.3	14.3	14.3	14.3	14.4	14.3	14.5	15.3	16.4	15.9	15.5	14.8	13.9	12.5	11.4				

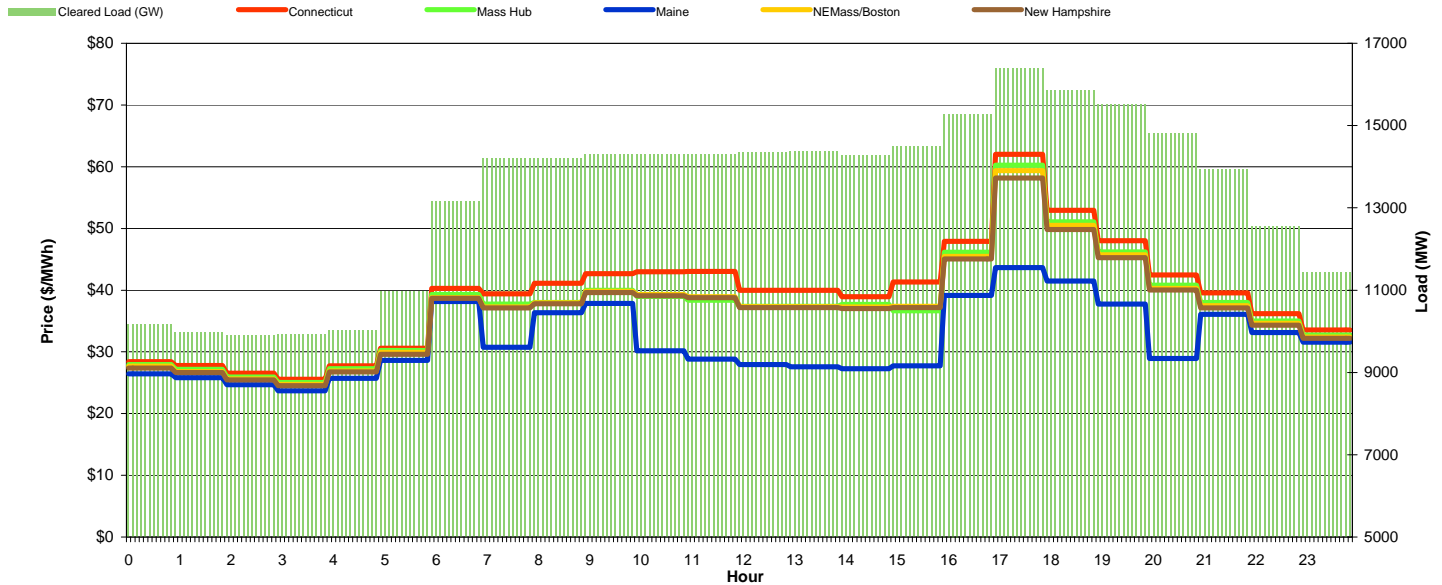

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	30.74	29.58	29.20	28.75	29.24	31.51	42.40	36.48	37.03	48.08	49.99	50.57	48.02	47.35	45.44	50.53	68.80	55.60	55.94	53.88	55.39	45.07	36.51	38.00	43.50	49.04	All	On Pk
NEMass/Boston	29.78	28.58	28.20	27.84	28.24	30.45	40.65	34.50	35.00	45.42	47.09	47.87	45.51	44.79	43.25	48.28	61.84	53.44	53.71	51.72	52.90	42.83	35.01	36.85	41.41	46.45	41.41	46.45
New Hampshire	29.59	28.41	28.07	27.66	28.12	30.41	40.63	34.49	34.97	45.39	46.96	47.62	45.36	44.67	43.24	48.13	61.19	52.74	53.08	51.15	52.40	42.54	34.68	36.50	41.17	46.16	41.17	46.16
Maine	28.85	27.03	26.43	26.25	26.40	29.87	40.08	33.33	33.07	27.86	27.96	27.02	27.74	27.82	31.11	38.87	46.25	42.92	42.48	39.92	39.25	28.48	24.92	31.14	32.29	33.69	32.29	33.69
Mass Hub	30.03	28.87	28.48	28.11	28.52	30.77	41.17	35.09	35.55	46.13	47.87	48.59	46.15	45.42	43.77	48.85	62.50	53.80	54.02	52.01	53.26	43.20	35.28	37.04	41.85	46.97	41.85	46.97
DA Forecast Load (GW)	10.74	10.30	10.07	10.12	10.42	11.58	13.68	14.82	15.18	15.38	15.51	15.57	15.44	15.44	15.39	15.46	16.53	17.43	17.19	16.79	16.07	14.92	13.56	12.26				
Forecast Error %	5.1%	7.3%	9.3%	6.2%	5.9%	1.9%	-2.3%	-2.1%	-2.1%	-1.6%	-0.9%	-0.8%	-0.2%	0.3%	0.8%	2.1%	1.3%	-0.1%	0.3%	0.1%	0.8%	1.3%	1.2%	1.6%				

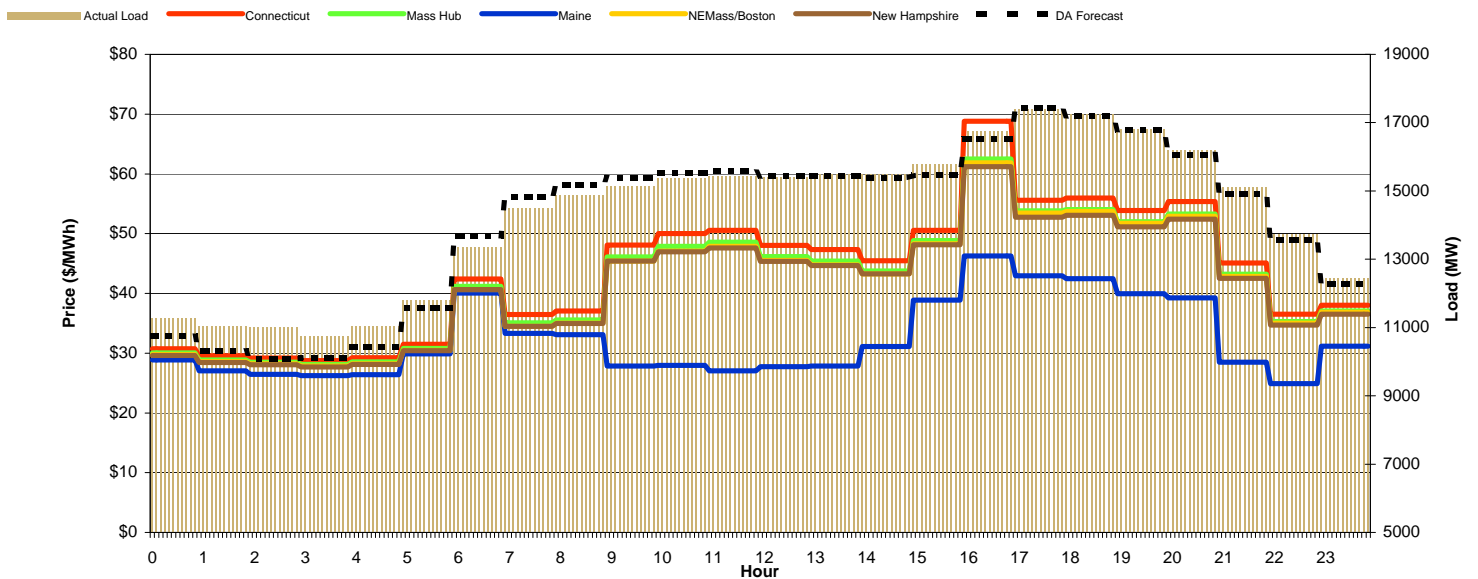




ISO-NE Daily Report

Friday November 18, 2011

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$				
Connecticut	35.97	33.18	32.81	32.55	38.24	41.70	61.39	63.01	62.80	62.90	67.60	58.59	66.40	60.29	61.33	55.11	60.34	60.02	53.07	45.18	40.00	37.33	36.00	36.30	36.30	50.09	55.62	All	On Pk
NEMass/Boston	34.69	31.96	31.57	31.45	30.15	37.46	39.29	38.27	36.03	36.01	36.32	36.01	33.40	33.08	32.93	32.99	36.58	57.08	50.13	43.00	38.10	35.75	34.57	35.22	36.75	38.14			
New Hampshire	34.54	31.87	31.57	31.44	31.27	37.73	42.34	39.80	37.78	37.48	37.52	36.64	35.92	35.21	36.93	36.05	37.06	56.32	49.81	42.76	37.88	35.54	34.26	34.84	37.61	39.19			
Maine	33.69	31.17	30.89	30.99	29.95	36.88	40.31	39.00	35.73	39.00	36.15	35.71	32.80	32.16	31.92	32.18	41.05	58.00	49.35	42.30	37.40	35.00	33.68	34.20	36.65	38.21			
Mass Hub	35.27	32.56	32.08	31.90	33.64	39.37	48.43	43.76	42.03	41.28	41.05	39.22	41.24	40.06	44.38	42.00	39.83	58.25	50.92	43.57	38.53	36.22	35.11	35.74	40.27	42.34			
Cleared Load (GW)	11.1	10.9	10.8	10.7	10.8	11.8	13.9	14.4	14.4	14.4	14.1	14.0	13.5	13.5	13.1	13.3	14.8	16.0	15.2	15.2	14.6	14.0	12.9	11.6					

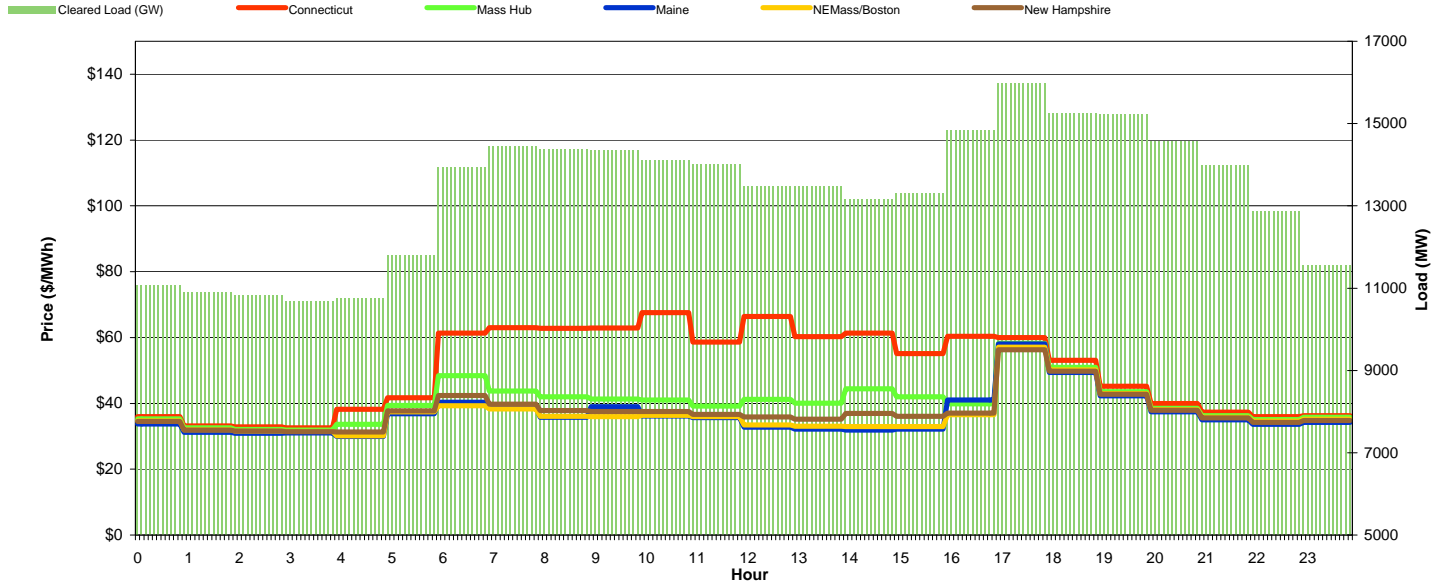

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	55.92	40.15	36.66	36.79	35.12	52.35	56.40	65.98	64.25	72.29	69.77	66.58	61.13	57.16	42.19	45.03	136.09	122.50	49.94	44.57	68.43	56.07	54.88	59.07	60.39	67.30		
NEMass/Boston	54.30	39.06	35.74	35.83	34.09	50.34	49.84	52.58	54.79	56.56	59.46	50.73	50.82	47.76	39.59	42.38	81.90	68.42	48.12	42.91	56.28	53.58	52.50	57.64	50.63	53.65		
New Hampshire	53.92	38.84	35.55	35.72	33.97	50.15	49.54	52.18	54.34	56.11	58.78	50.06	50.24	47.16	39.21	41.88	80.07	66.38	47.16	42.17	55.28	52.77	51.76	56.53	49.99	52.85		
Maine	32.91	31.86	31.05	30.89	31.10	32.87	48.40	50.76	52.81	54.50	55.11	40.54	43.10	45.23	37.69	40.29	77.45	64.52	46.14	41.31	54.00	51.88	50.75	55.67	45.87	50.38		
Mass Hub	54.58	39.34	36.01	36.07	34.39	51.27	51.13	54.11	59.12	61.80	62.94	55.70	54.15	50.80	40.62	43.45	98.23	84.61	49.05	43.80	57.01	54.31	53.26	58.34	53.50	57.69		
DA Forecast Load (GW)	11.25	10.85	10.62	10.64	11.01	12.13	14.03	15.16	15.40	15.47	15.45	15.31	15.10	14.97	14.81	14.85	15.79	16.77	16.56	16.12	15.45	14.63	13.46	12.34				
Forecast Error %	5.4%	5.0%	7.1%	7.3%	6.1%	4.2%	2.0%	1.2%	1.4%	1.0%	1.5%	1.7%	1.4%	1.6%	1.7%	1.7%	1.7%	2.1%	2.2%	2.0%	2.8%	3.2%	3.8%	3.6%				

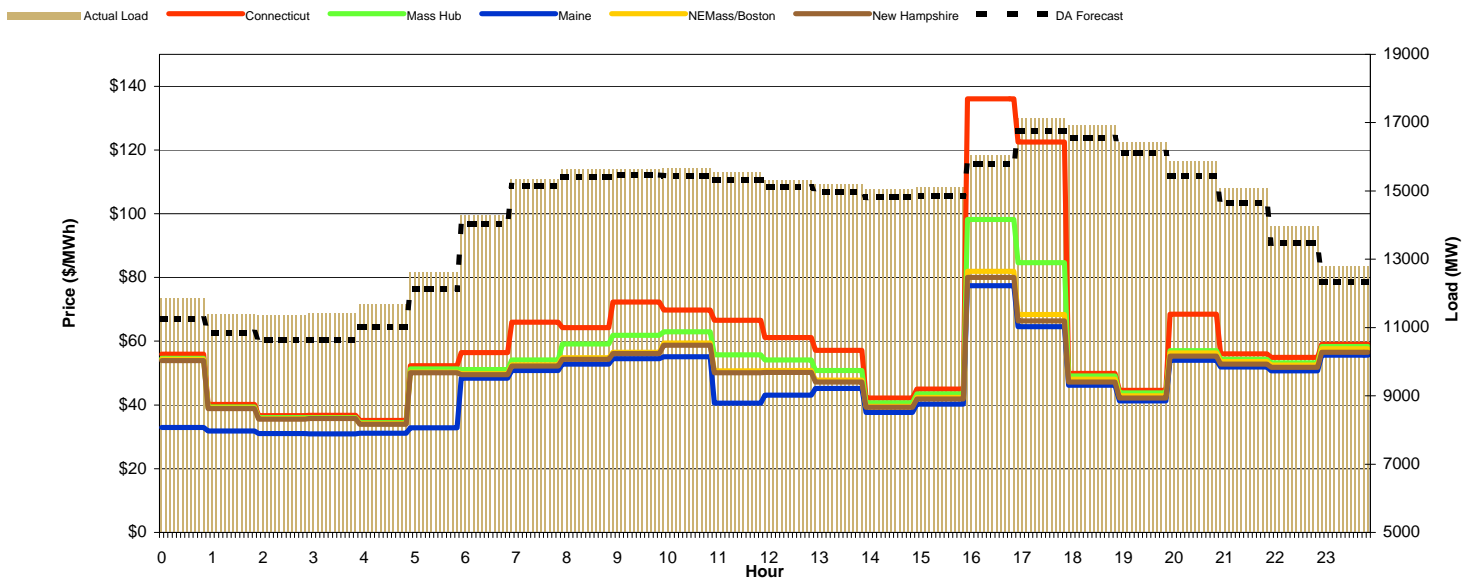




ISO-NE Daily Report

Saturday November 19, 2011

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	39.98	38.39	39.29	36.43	36.05	36.15	38.82	37.44	40.33	40.75	40.55	40.56	40.39	40.23	38.97	38.93	47.77	57.77	50.48	42.88	40.68	38.19	36.72	35.12	40.54	42.04	All	On Pk
NEMass/Boston	38.73	37.26	38.24	35.42	35.15	34.67	37.40	36.37	39.07	39.24	39.22	39.18	39.09	38.92	37.83	37.76	45.74	54.56	45.82	39.38	39.16	36.82	35.63	34.51	38.97	40.24		
New Hampshire	38.30	36.88	37.79	34.81	34.53	34.25	36.82	36.03	38.63	38.79	38.77	38.68	38.64	38.45	37.36	37.35	45.27	53.52	45.29	38.82	38.58	36.34	34.98	33.84	38.45	39.72		
Maine	37.44	36.00	36.86	33.95	33.63	33.48	36.33	35.87	38.41	38.66	38.65	38.29	38.28	38.04	37.08	37.14	45.08	53.67	44.92	38.38	38.06	35.98	34.44	33.16	37.99	39.43		
Mass Hub	39.42	37.97	38.90	35.99	35.61	35.22	37.94	36.92	39.65	39.81	39.86	39.79	39.68	39.49	38.35	38.28	46.69	54.99	45.35	38.83	39.38	37.15	35.81	34.51	39.40	40.63		
Cleared Load (GW)	11.2	11.0	10.8	10.9	11.0	11.2	11.6	12.3	13.0	13.4	13.4	13.2	12.9	12.6	12.5	12.6	13.9	15.0	14.3	13.9	13.3	12.5	11.6	10.6				

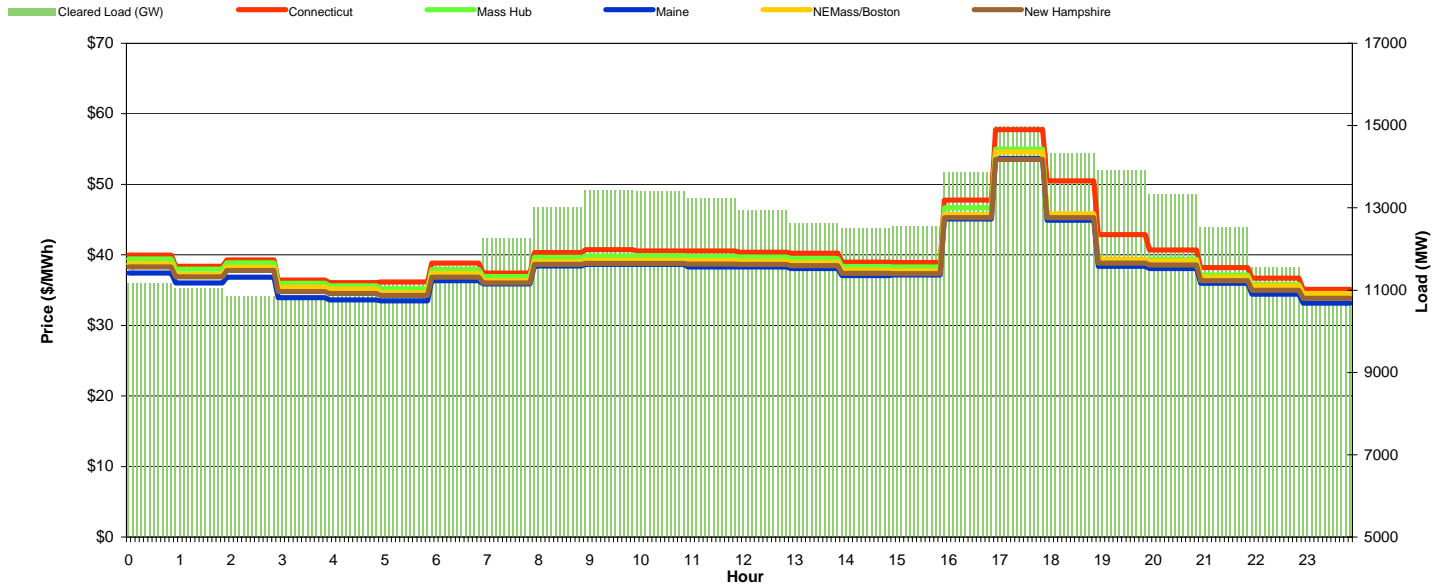

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	41.39	52.29	36.62	35.78	35.43	43.92	40.14	48.25	41.52	42.24	50.12	38.76	34.63	34.29	35.31	40.19	52.46	49.91	38.48	34.25	37.37	38.75	44.09	49.64	41.49	41.29	All	On Pk
NEMass/Boston	40.28	50.82	35.70	34.97	34.67	42.95	39.23	46.63	40.10	40.46	47.30	37.20	33.42	33.14	34.15	38.93	50.45	47.90	36.90	32.94	36.12	37.42	42.86	48.83	40.14	39.75		
New Hampshire	39.77	50.13	35.15	34.35	34.10	42.36	38.61	46.24	39.72	40.06	46.82	36.70	33.02	32.74	33.75	38.45	49.82	47.06	36.29	32.42	35.53	36.88	42.00	47.71	39.57	39.22		
Maine	39.24	49.31	34.58	33.76	33.69	42.04	38.46	46.16	39.39	39.63	46.07	36.12	32.59	32.41	33.46	38.28	49.86	47.22	36.27	32.35	35.25	36.66	41.57	46.97	39.22	38.96		
Mass Hub	40.84	51.51	36.12	35.31	34.97	43.30	39.61	47.24	40.73	41.22	48.30	37.78	33.88	33.57	34.53	39.35	51.15	48.65	37.43	33.37	36.54	37.85	43.23	49.06	40.65	40.30		
DA Forecast Load (GW)	11.60	11.14	10.85	10.78	10.90	11.44	12.18	13.00	13.82	14.27	14.30	14.13	13.89	13.57	13.43	13.59	14.67	15.73	15.55	15.05	14.47	13.71	12.77	11.78				
Forecast Error %	3.8%	5.4%	6.5%	6.3%	6.1%	4.7%	1.1%	1.1%	0.8%	1.1%	1.4%	1.1%	1.5%	1.3%	0.8%	0.9%	1.0%	0.7%	0.7%	0.9%	1.2%	1.0%	0.8%					

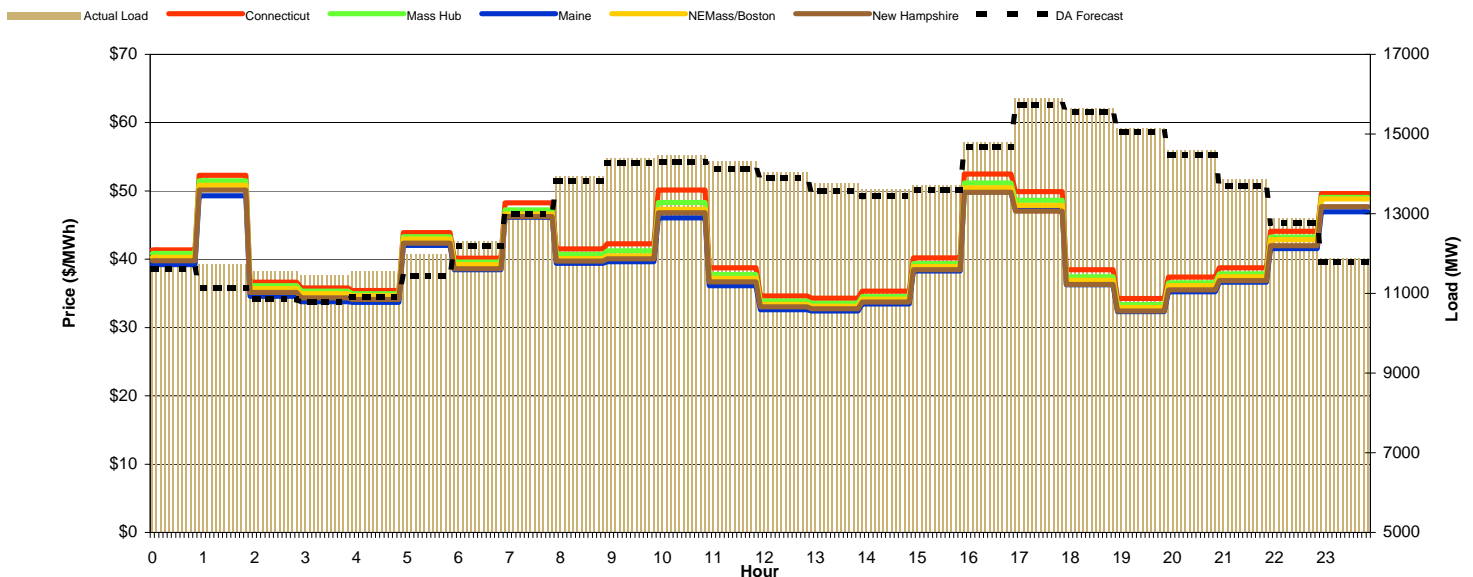




ISO-NE Daily Report

Sunday November 20, 2011

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	34.31	31.73	30.02	29.01	29.13	31.16	33.45	32.70	36.01	36.08	36.35	36.38	35.15	33.61	32.64	38.71	43.60	55.72	52.16	42.46	39.98	36.27	35.19	29.52	36.31	38.94	All	On Pk
NEMass/Boston	34.07	31.35	29.79	28.82	28.93	30.85	33.22	32.24	35.60	35.63	35.64	35.65	34.63	33.08	32.09	37.61	42.65	54.36	50.60	41.00	39.15	35.69	35.00	29.57	35.72	38.16		
New Hampshire	33.48	30.92	29.33	28.44	28.57	30.42	32.79	31.83	35.21	35.16	35.12	35.16	34.06	32.51	31.56	37.11	42.00	53.44	49.98	40.34	38.49	34.97	34.25	28.89	35.17	37.57		
Maine	32.91	30.31	28.57	27.73	27.95	29.68	32.15	31.50	34.92	35.01	34.94	34.88	33.70	32.15	31.20	37.00	41.60	53.55	49.91	39.86	37.91	34.53	33.79	28.49	34.76	37.28		
Mass Hub	34.19	31.55	30.00	28.98	29.06	31.06	33.35	32.39	35.68	35.77	35.88	35.87	34.73	33.16	32.23	37.87	43.14	55.19	51.27	41.18	39.42	35.82	35.07	29.66	35.94	38.42		
Cleared Load (GW)	11.2	10.9	10.8	10.6	10.6	10.9	11.1	11.1	11.6	12.2	12.4	12.5	12.4	12.2	12.1	12.4	14.1	15.1	14.8	14.2	13.6	12.6	11.5	10.7				

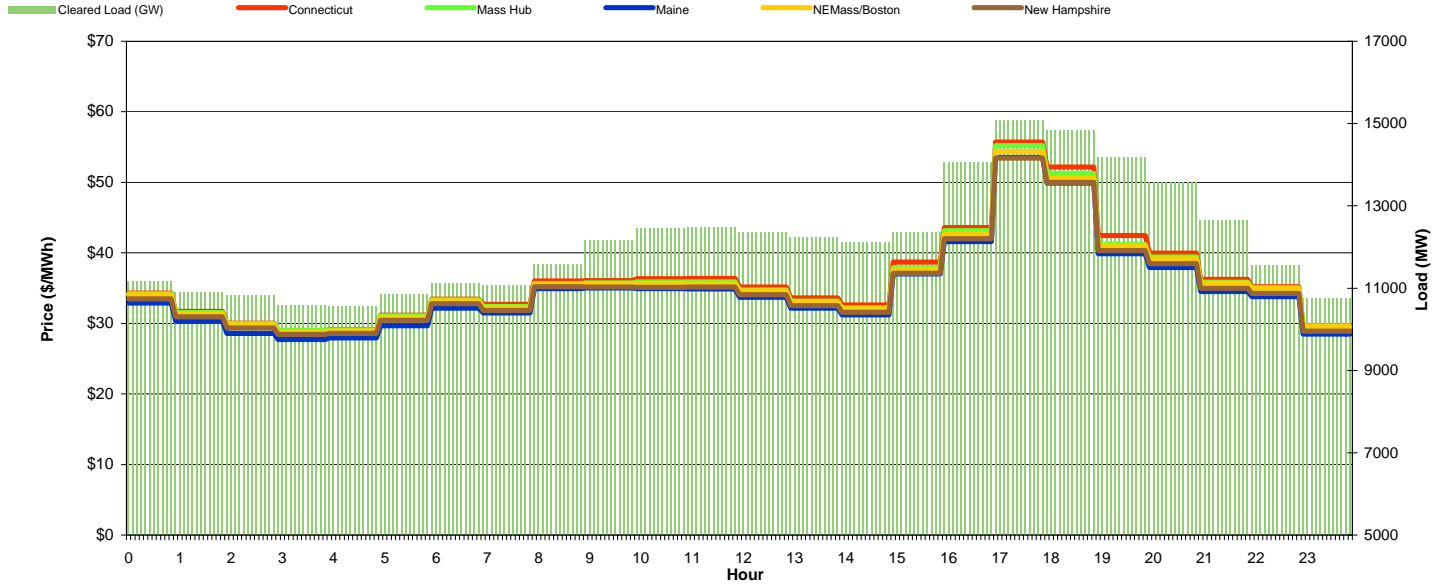

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	37.08	33.54	30.09	28.36	28.07	29.35	32.09	33.03	40.55	32.55	32.27	32.47	32.59	31.36	28.92	50.28	36.62	60.24	49.66	42.94	46.64	48.45	31.24	36.71	39.45	All	On Pk	
NEMass/Boston	36.76	33.29	29.90	28.11	27.84	29.17	31.94	32.66	40.24	32.04	31.89	32.11	32.21	32.18	30.95	28.59	41.93	36.20	53.98	48.01	41.84	45.66	47.99	31.08	35.69	38.03		
New Hampshire	36.02	32.69	29.39	27.71	27.47	28.81	31.56	32.22	39.69	31.46	31.26	31.54	31.61	31.53	30.33	28.06	41.07	35.28	52.72	46.96	40.98	44.62	46.75	30.33	35.00	37.26		
Maine	35.44	32.02	28.65	27.03	26.92	28.35	31.08	31.88	39.26	30.99	30.74	31.05	31.18	31.05	29.86	27.68	40.61	34.88	52.09	46.30	40.37	43.86	46.05	29.90	34.47	36.74		
Mass Hub	36.90	33.43	30.05	28.25	27.93	29.25	31.98	32.71	40.26	32.15	31.97	32.18	32.29	32.27	31.05	28.66	42.11	36.33	54.42	48.46	42.22	46.05	48.24	31.20	35.85	38.21		
DA Forecast Load (GW)	11.03	10.52	10.26	10.14	10.19	10.53	11.06	11.71	12.52	13.05	13.35	13.51	13.46	13.33	13.25	13.45	14.63	15.83	15.58	15.17	14.50	13.48	12.33	11.25				
Forecast Error %	3.0%	6.2%	9.4%	9.1%	8.6%	7.7%	7.0%	0.3%	-1.4%	0.0%	-0.4%	-1.1%	-0.8%	-0.7%	-0.9%	-1.3%	-0.3%	-0.2%	0.4%	-0.1%	-0.2%	0.1%	-0.4%	-0.2%				

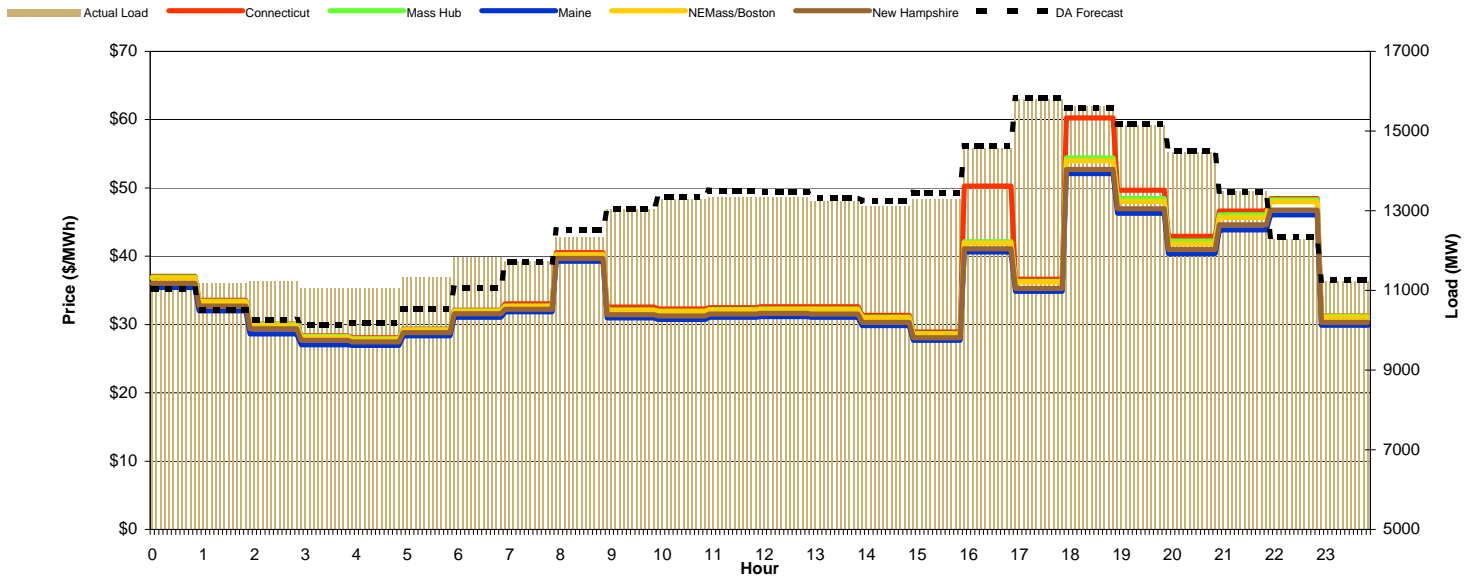




ISO-NE Daily Report

Monday November 21, 2011

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	28.45	27.34	26.44	25.53	27.24	30.23	35.40	36.96	37.15	36.42	36.59	37.05	36.54	36.46	34.43	36.45	45.04	58.44	50.41	44.66	37.60	34.47	32.15	29.81	35.89	39.43	All	On Pk
NEMass/Boston	28.20	27.09	26.17	25.30	26.99	30.21	35.10	35.85	35.84	35.82	35.77	35.81	35.83	35.88	33.94	35.91	41.35	55.02	48.75	42.77	36.59	33.79	31.79	29.74	34.98	38.17		
New Hampshire	27.84	26.77	25.84	24.96	26.65	29.72	34.72	35.38	35.38	35.31	35.33	35.33	35.33	35.36	33.49	35.40	40.87	53.09	47.72	42.02	35.93	33.19	30.97	29.02	34.40	37.51		
Maine	27.45	26.27	25.28	24.45	26.28	29.29	34.98	35.00	34.85	34.91	34.98	34.71	34.91	34.94	33.15	35.11	40.00	52.19	47.00	41.46	35.66	32.96	30.65	28.85	33.97	37.03		
Mass Hub	28.40	27.25	26.36	25.46	27.16	30.35	35.38	36.02	35.89	36.02	36.15	35.86	36.04	36.07	34.13	36.07	40.79	54.89	49.39	43.44	36.95	34.03	31.92	29.91	35.16	38.35		
Cleared Load (GW)	11.0	10.6	10.7	10.5	10.8	11.6	13.6	14.3	14.4	14.7	14.9	14.8	14.7	14.6	14.5	14.6	15.9	17.0	16.7	16.0	15.5	14.4	13.1	11.8				

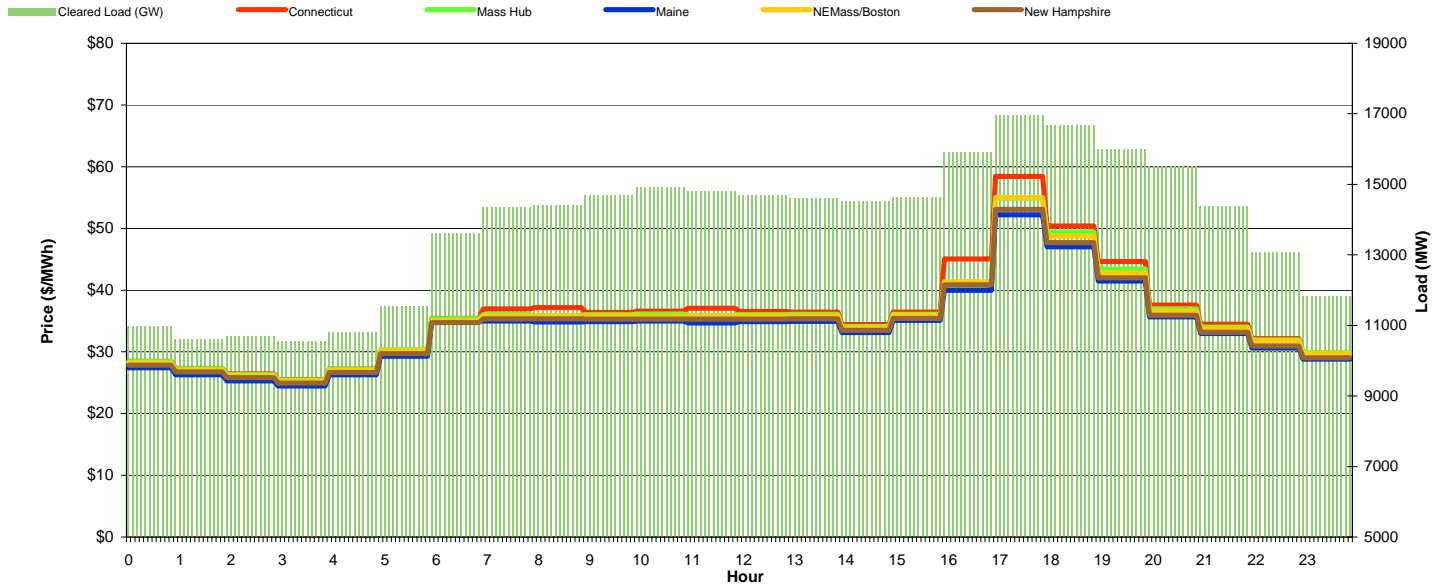

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	28.39	27.72	27.02	27.29	27.73	29.88	47.56	42.14	37.83	39.11	34.50	33.43	37.96	39.34	35.93	35.42	55.68	65.55	52.99	47.37	51.18	50.18	47.08	33.19	39.77	44.11	All	On Pk
NEMass/Boston	28.14	27.41	26.68	26.95	27.37	29.58	47.05	41.01	36.63	37.97	33.61	32.57	36.97	38.31	35.05	34.61	54.46	64.17	51.82	46.12	49.34	48.77	46.35	32.99	38.91	42.99		
New Hampshire	27.67	27.00	26.32	26.58	27.04	29.24	46.40	40.58	36.34	37.78	33.41	32.29	36.81	38.20	34.85	34.35	53.85	63.07	50.97	45.39	48.54	47.97	45.32	32.24	38.43	42.48		
Maine	27.19	26.53	25.76	25.96	26.47	28.90	46.23	40.06	35.58	37.14	33.05	31.68	36.26	37.68	34.62	34.46	53.48	61.86	49.95	44.73	47.59	47.16	44.62	31.81	37.87	41.87		
Mass Hub	28.32	27.60	26.88	27.14	27.55	29.77	47.33	41.40	37.05	38.42	33.97	32.91	37.35	38.72	35.38	34.90	54.94	64.76	52.33	46.63	50.05	49.32	46.66	33.12	39.27	43.42		
DA Forecast Load (GW)	10.53	10.15	9.97	10.02	10.40	11.60	13.68	14.89	15.24	15.38	15.54	15.51	15.34	15.32	15.24	15.35	16.47	17.63	17.33	16.90	16.10	14.95	13.46	12.15				
Forecast Error %	5.6%	6.1%	8.4%	8.4%	7.7%	1.9%	-2.7%	-3.0%	-2.9%	-2.5%	-3.2%	-3.1%	-2.4%	-2.7%	-3.0%	-3.2%	-2.5%	-1.9%	-0.5%	-0.3%	1.0%	1.6%	2.8%	2.8%				

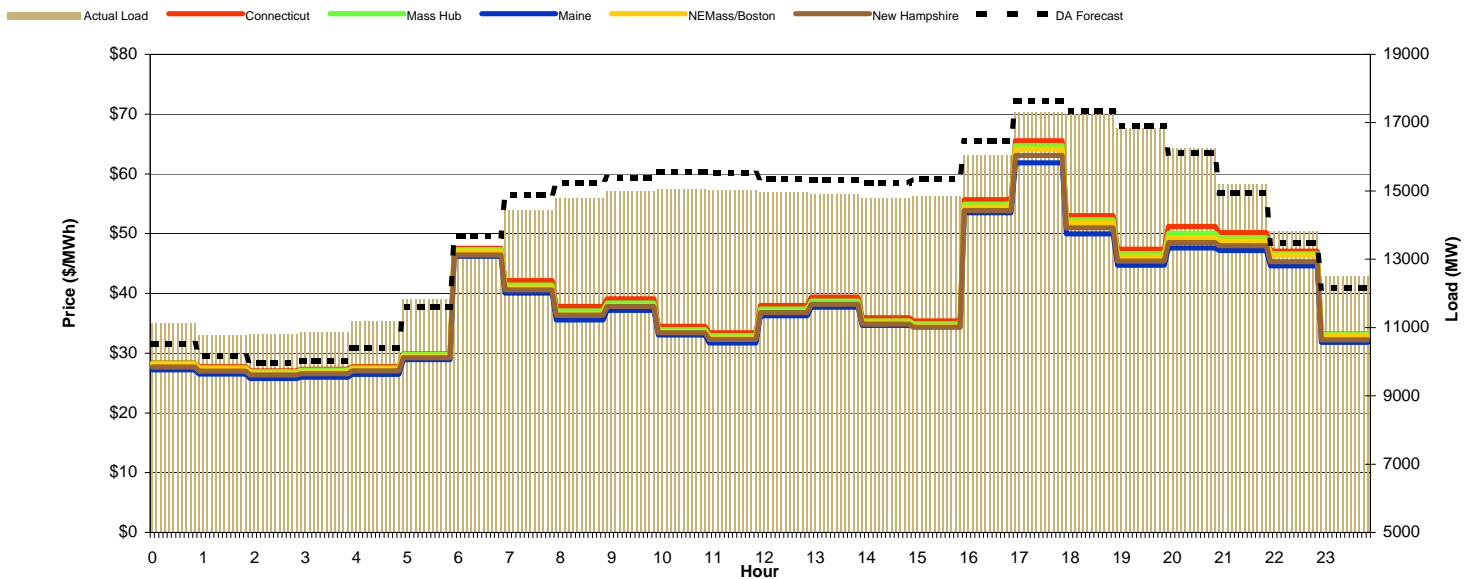




ISO-NE Daily Report

Tuesday November 22, 2011

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	34.72	32.14	31.29	31.56	31.58	34.39	39.96	42.94	44.21	42.96	39.61	39.45	38.79	38.12	37.10	36.98	45.27	51.93	48.98	42.69	38.77	37.23	35.15	32.14	38.67	41.26	All	On Pk
NEMass/Boston	34.54	31.90	31.20	31.37	31.51	34.31	38.82	41.39	42.47	41.28	38.05	37.93	37.35	36.72	35.90	35.89	43.91	50.38	47.30	41.09	37.40	36.08	34.43	31.85	37.63	39.85		
New Hampshire	33.85	31.34	30.69	30.86	30.95	33.60	38.37	41.07	41.98	40.81	37.47	37.34	36.80	36.13	35.30	35.29	43.34	49.14	46.27	40.38	36.65	35.33	33.61	30.97	36.98	39.18		
Maine	34.04	31.46	30.77	30.98	31.17	33.36	38.37	40.99	41.51	40.41	36.82	36.55	36.24	35.51	34.67	35.01	42.80	48.57	45.81	39.99	36.11	34.88	33.11	30.48	36.65	38.69		
Mass Hub	34.75	32.12	31.35	31.57	31.69	34.54	39.48	42.18	43.30	42.00	38.66	38.54	37.90	37.25	36.34	36.32	44.73	51.56	48.34	42.00	38.00	36.62	34.88	32.10	38.18	40.54		
Cleared Load (GW)	10.6	10.5	10.5	10.5	10.6	11.5	13.9	14.6	14.7	14.8	14.8	14.7	14.5	14.4	14.3	14.4	15.9	16.6	16.2	15.8	15.0	14.1	12.7	11.2				

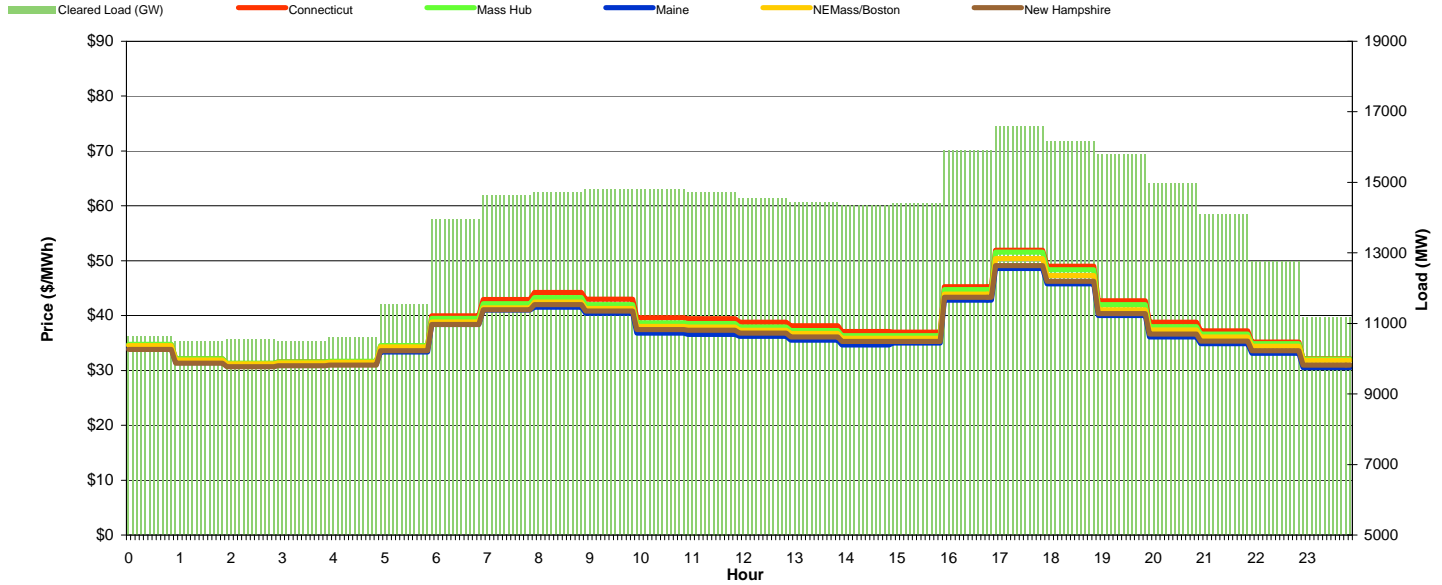

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	36.43	55.17	49.39	45.16	30.34	31.86	51.44	46.02	68.03	47.89	56.58	52.14	43.48	45.80	43.24	46.73	74.84	82.18	45.41	44.27	45.35	38.73	41.29	43.83	48.57	51.37	All	On Pk
NEMass/Boston	36.33	54.72	49.15	44.84	30.17	31.59	49.98	44.58	65.94	46.21	54.48	50.02	41.77	43.98	41.52	45.03	73.28	80.90	44.49	43.18	43.79	37.29	39.97	43.38	47.36	49.78		
New Hampshire	35.63	53.85	48.50	44.22	29.81	31.39	49.61	44.22	65.43	46.00	54.13	49.75	41.52	43.70	41.29	44.73	72.31	79.40	43.76	42.62	43.30	36.95	39.45	42.54	46.84	49.29		
Maine	35.50	54.07	48.82	44.47	29.94	31.56	48.94	44.13	65.23	45.69	53.61	49.32	41.04	43.09	40.99	44.58	72.09	78.56	42.96	41.79	42.45	36.38	38.87	41.44	46.48	48.80		
Mass Hub	36.46	54.98	49.37	45.09	30.36	31.82	50.66	45.16	66.78	46.83	55.21	50.72	42.32	44.56	42.04	45.53	73.81	81.46	44.85	43.59	44.33	37.78	40.47	43.65	47.83	50.34		
DA Forecast Load (GW)	11.39	10.98	10.80	10.85	11.22	12.36	14.47	15.53	15.67	15.64	15.64	15.53	15.44	15.37	15.23	15.37	16.56	17.60	17.38	16.93	16.13	15.01	13.47	12.13				
Forecast Error %	1.3%	2.5%	4.2%	3.5%	2.2%	-0.1%	-0.5%	-0.1%	0.8%	0.9%	0.7%	0.8%	0.1%	0.4%	1.1%	1.5%	1.0%	-0.5%	-0.1%	-0.1%	0.8%	1.5%	3.0%	3.5%				

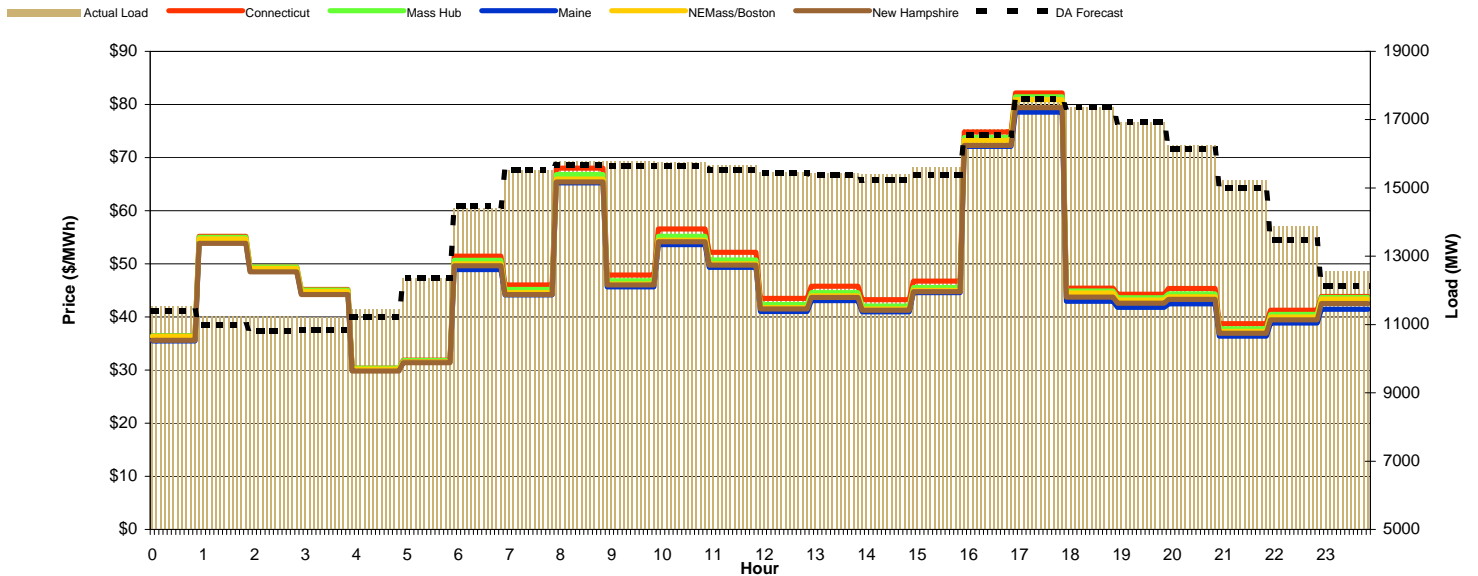




ISO-NE Daily Report

Wednesday November 23, 2011

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	31.00	31.24	30.13	29.21	30.39	31.76	37.41	38.52	41.12	41.59	46.00	50.02	49.02	48.02	47.02	46.00	66.86	75.96	71.06	67.80	45.00	38.45	36.27	33.99	44.33	50.54	All	On Pk
NEMass/Boston	30.50	30.81	30.00	29.19	30.32	31.31	36.79	37.56	40.01	40.08	37.47	40.26	39.62	38.07	37.21	37.20	51.09	52.27	47.60	41.08	37.28	37.15	35.13	33.52	37.56	40.57		
New Hampshire	30.11	30.44	29.68	28.89	29.96	31.07	36.56	37.15	39.54	39.67	37.01	39.70	39.06	37.54	36.71	36.67	50.22	50.96	46.49	40.15	36.58	36.61	34.70	33.06	37.02	39.92		
Maine	29.76	29.93	29.25	28.51	29.65	30.99	37.05	37.61	39.68	39.40	36.48	39.06	38.58	37.10	36.29	36.33	49.07	50.11	45.54	39.54	35.98	36.30	34.84	33.36	36.68	39.49		
Mass Hub	30.97	31.23	30.22	29.43	30.58	31.78	37.36	38.16	40.49	40.72	38.12	41.02	40.36	38.73	37.91	37.85	51.85	53.41	48.57	41.85	37.82	37.67	35.87	34.08	38.17	41.28		
Cleared Load (GW)	11.0	11.1	10.7	10.6	10.9	11.6	13.4	14.3	14.6	14.9	15.0	15.1	15.2	15.1	15.1	15.2	15.6	16.9	16.3	16.1	15.6	14.5	13.3	12.0				

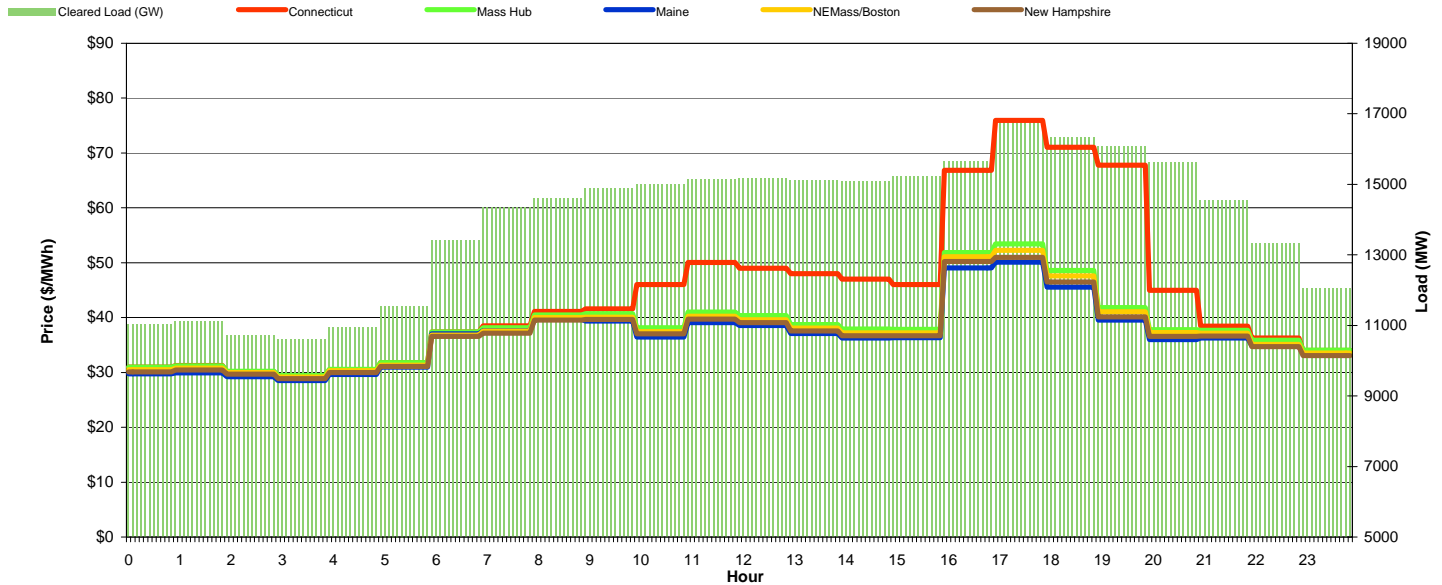

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	50.35	47.49	30.28	30.22	55.37	63.66	41.30	49.14	52.90	54.62	53.57	45.88	40.84	44.83	51.26	49.81	74.58	70.12	54.38	43.19	44.38	37.45	35.70	32.05	48.06	50.17	All	On Pk
NEMass/Boston	50.45	47.41	30.24	30.21	55.06	63.26	40.74	48.17	52.09	53.77	52.25	43.75	39.82	43.53	49.69	48.36	73.51	69.42	53.55	42.40	43.09	36.31	34.77	31.91	47.24	49.03		
New Hampshire	49.56	46.84	29.87	29.88	54.58	62.69	40.41	47.67	51.54	53.42	51.97	43.41	39.49	43.12	49.21	47.88	72.19	67.79	52.46	41.76	42.57	35.81	34.36	31.33	46.66	48.42		
Maine	49.10	46.37	29.59	29.73	54.86	63.78	41.17	48.85	52.91	55.07	53.12	43.20	39.35	42.78	48.77	47.53	71.72	66.65	51.36	41.11	42.13	35.25	34.11	31.22	46.66	48.37		
Mass Hub	50.63	47.71	30.44	30.40	55.47	63.72	41.13	48.73	52.55	54.21	52.79	44.27	40.24	44.03	50.28	48.89	74.04	69.97	54.09	42.86	43.61	36.75	35.15	32.06	47.67	49.53		
DA Forecast Load (GW)	11.50	10.98	10.74	10.70	11.03	12.13	14.15	15.38	15.77	15.94	16.12	16.18	16.07	16.10	16.03	16.18	17.22	18.14	17.74	17.25	16.46	15.39	13.98	12.64				
Forecast Error %	4.3%	9.9%	10.1%	10.1%	9.6%	3.2%	-2.9%	-2.2%	-0.2%	1.4%	2.0%	2.3%	2.7%	2.3%	2.3%	1.5%	0.1%	-1.9%	-1.6%	-2.0%	-1.3%	-0.6%	0.6%	0.8%				

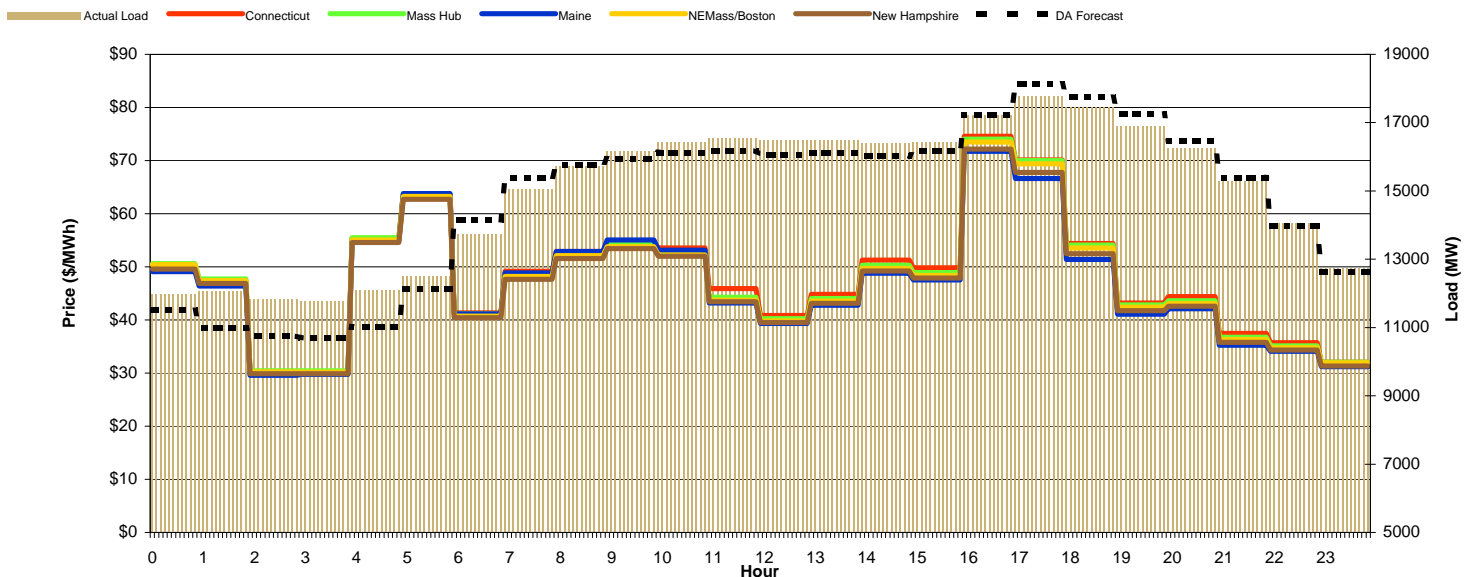




ISO-NE Daily Report

Thursday November 24, 2011

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	37.42	35.84	34.69	33.87	34.68	33.16	35.97	37.75	44.11	48.22	49.85	50.00	43.00	38.24	36.38	36.35	37.84	37.71	37.77	37.37	37.33	35.77	35.15	32.81	38.39	40.18	All	On Pk
NEMass/Boston	36.78	35.07	34.46	33.70	34.53	33.15	35.72	37.08	43.00	46.78	48.52	48.66	41.72	37.21	35.61	35.62	37.02	37.11	37.19	36.98	37.00	35.33	34.95	32.98	37.76	39.36		
New Hampshire	36.06	34.49	33.69	32.96	33.85	32.61	35.06	36.49	42.30	45.99	47.54	47.63	40.79	36.38	34.77	34.86	36.28	36.39	36.50	36.16	36.17	34.45	34.09	32.41	37.00	38.55		
Maine	35.59	33.93	33.10	32.48	33.48	32.86	35.59	37.10	43.01	46.56	48.00	48.03	41.01	36.35	34.73	35.09	36.59	36.76	36.83	36.22	36.09	34.18	33.86	32.58	37.08	38.78		
Mass Hub	37.11	35.47	34.64	33.89	34.68	33.30	35.99	37.88	44.15	48.00	49.64	49.82	42.67	37.56	35.87	35.86	37.23	37.27	37.35	37.11	37.00	35.40	35.01	32.91	38.16	39.86		
Cleared Load (GW)	11.4	11.2	10.8	10.8	10.9	11.2	11.7	12.9	13.6	13.9	14.2	14.2	13.7	13.0	12.5	12.4	13.1	13.7	13.7	13.4	12.9	12.2	11.6	10.6				

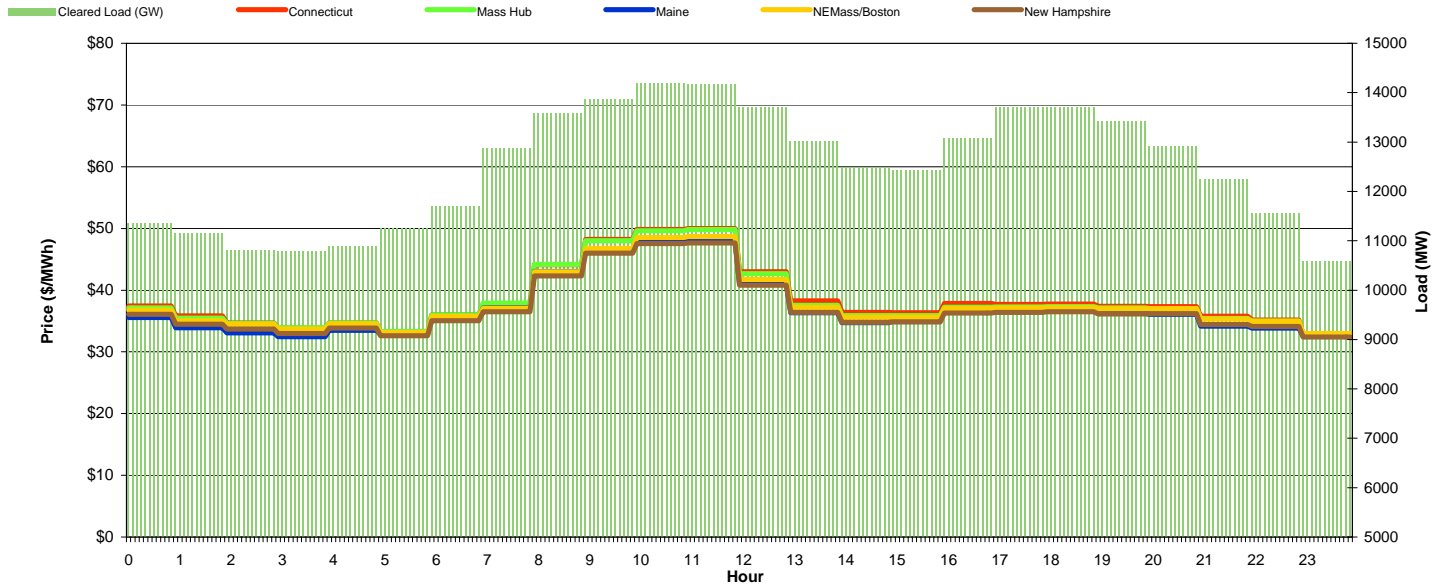

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	49.58	53.32	69.39	36.13	58.75	31.52	38.69	39.27	46.69	64.45	56.20	51.81	34.43	31.35	29.82	28.44	29.19	27.85	28.25	30.43	30.80	33.07	37.19	30.01	40.28	37.45	All	On Pk
NEMass/Boston	49.04	52.48	69.00	35.91	58.19	31.19	38.26	38.51	45.63	62.99	55.27	50.48	33.46	30.60	29.32	28.12	28.82	27.60	28.07	30.20	30.44	32.59	36.91	30.06	39.71	36.81		
New Hampshire	48.17	51.73	67.79	35.24	57.16	30.74	37.76	38.05	45.23	62.40	54.78	50.01	33.01	30.23	28.97	27.83	28.48	27.21	27.67	29.66	29.86	31.96	36.14	29.37	39.14	36.34		
Maine	47.56	51.39	67.31	34.66	56.83	31.01	38.53	38.89	46.64	64.31	56.36	51.51	33.75	30.87	29.40	28.50	29.07	27.71	28.16	29.95	29.87	31.72	35.69	29.02	39.53	37.03		
Mass Hub	49.38	52.90	69.33	36.11	58.49	31.38	38.51	38.86	46.05	63.61	55.72	50.99	33.80	30.81	29.44	28.19	28.91	27.68	28.15	30.33	30.59	32.78	36.97	30.01	39.96	37.06		
DA Forecast Load (GW)	11.76	11.18	10.85	10.73	10.84	11.30	12.12	12.94	14.02	14.88	15.28	15.31	14.86	13.97	13.23	12.85	13.36	13.83	13.85	13.80	13.63	13.24	12.50	11.61				
Forecast Error %	2.1%	6.5%	7.2%	7.0%	6.3%	4.3%	-0.1%	0.5%	-0.7%	-1.3%	-1.7%	-1.7%	-1.9%	-1.7%	-0.1%	0.3%	0.0%	-1.6%	-1.8%	-1.7%	-1.3%	-0.9%	-0.4%	1.2%				

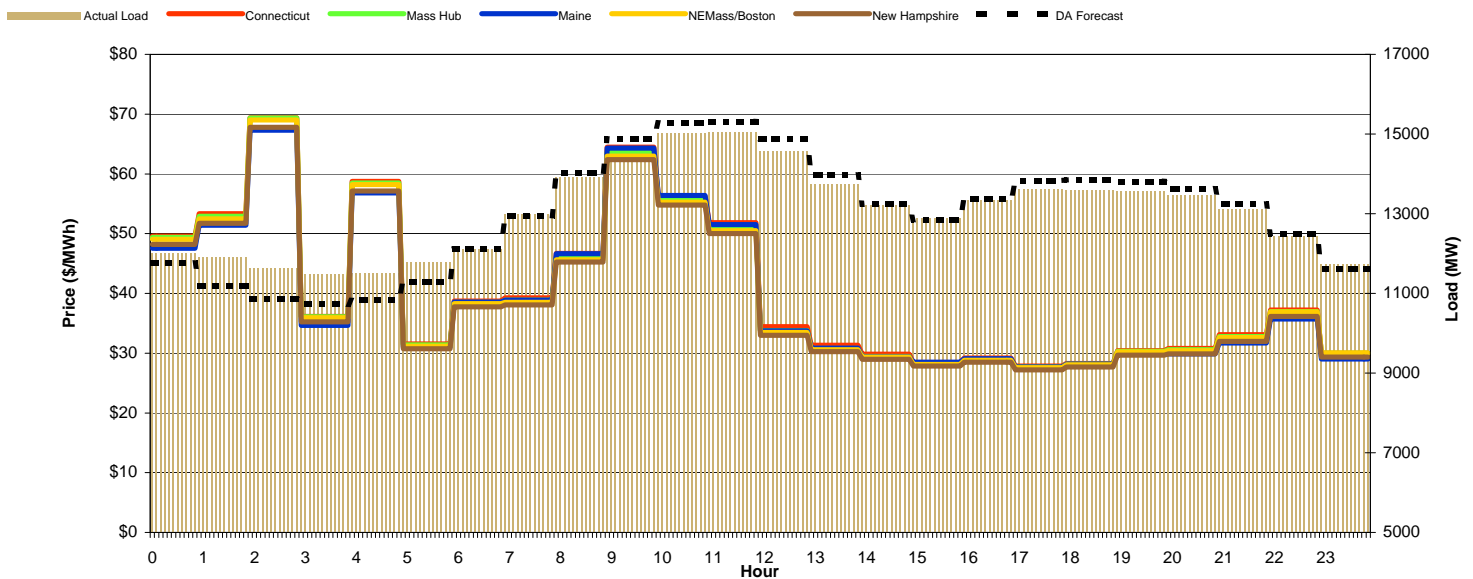




ISO-NE Daily Report

Friday November 25, 2011

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	30.81	30.72	27.80	27.10	27.77	30.62	31.61	31.21	33.29	36.58	40.51	34.55	33.76	33.57	33.17	33.54	46.26	51.78	44.18	34.21	33.51	31.51	30.80	30.93	34.16	36.40	All	On Pk
NEMass/Boston	30.76	30.85	27.85	27.21	27.88	30.86	31.97	31.46	33.29	36.32	40.00	34.10	33.38	33.24	32.89	33.22	45.62	50.60	43.28	33.75	33.27	31.18	30.68	30.98	33.94	36.02		
New Hampshire	30.20	30.24	27.45	26.89	27.54	30.46	31.50	31.00	32.72	35.70	39.23	33.49	32.77	32.61	32.26	32.58	44.86	49.74	42.40	33.07	32.61	30.55	30.05	30.58	33.35	35.35		
Maine	29.77	29.69	27.09	26.57	27.37	30.57	32.02	31.59	33.26	36.12	39.44	33.69	32.92	32.76	32.41	32.80	45.01	50.08	42.62	33.26	32.50	30.44	30.00	30.74	33.45	35.56		
Mass Hub	30.97	30.98	28.05	27.37	28.06	30.94	31.99	31.45	33.42	36.48	40.25	34.25	33.52	33.37	33.01	33.35	46.18	51.16	43.92	34.09	33.38	31.33	30.75	31.11	34.14	36.24		
Cleared Load (GW)	11.6	11.4	11.1	10.9	11.0	11.4	11.8	12.4	13.2	13.6	13.8	13.9	13.6	13.4	13.2	13.3	14.6	15.1	14.9	14.5	13.6	13.0	12.2	11.3				

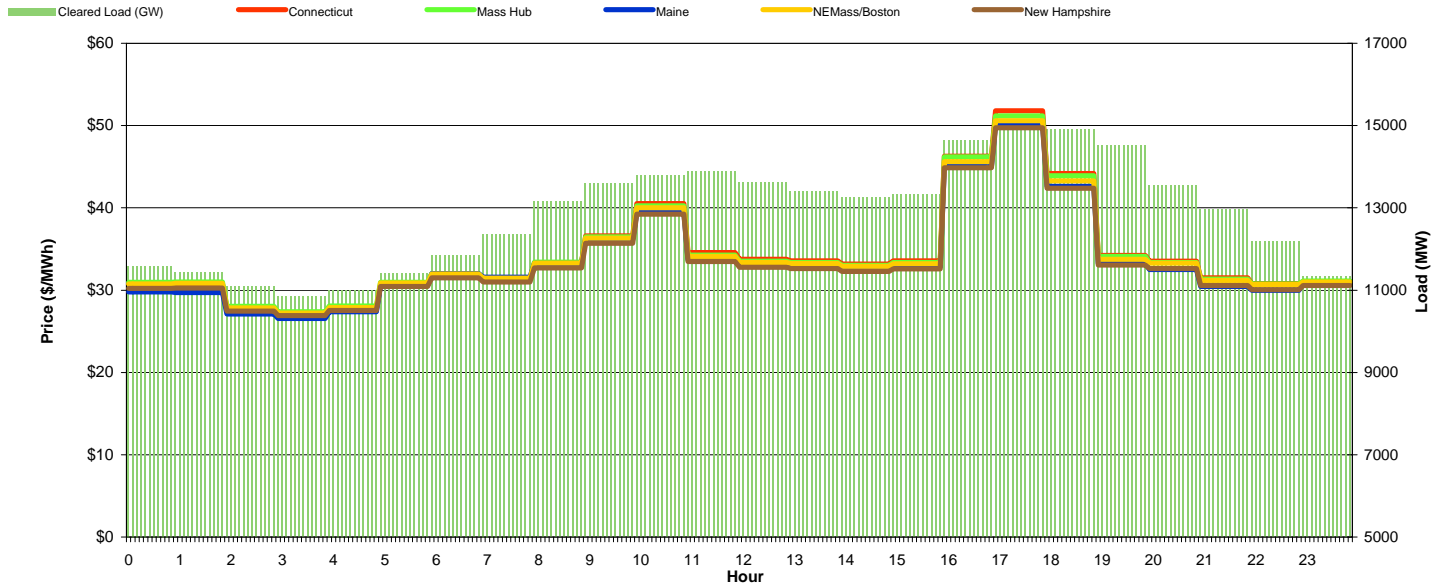

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	26.52	27.29	27.86	28.03	30.32	44.18	31.63	29.36	29.90	30.08	29.44	28.08	27.88	28.00	27.95	27.69	33.92	29.75	28.66	28.06	27.91	26.89	20.34	18.52	28.68	28.37	All	On Pk
NEMass/Boston	26.66	27.26	27.80	28.00	30.27	44.18	31.46	29.02	29.49	29.68	29.03	27.72	27.59	27.75	27.72	27.48	33.66	29.28	28.19	27.62	27.58	26.60	20.15	18.49	28.45	28.04		
New Hampshire	26.11	26.84	27.37	27.58	29.81	43.65	31.08	28.66	29.11	29.29	28.60	27.25	27.17	27.32	27.30	27.11	33.30	28.82	27.75	27.24	27.14	26.14	19.79	18.16	28.02	27.62		
Maine	25.73	26.43	26.97	27.34	29.60	44.02	31.44	29.00	29.54	29.64	28.88	27.23	27.14	27.22	27.36	27.25	33.41	28.87	27.70	26.98	26.87	25.78	19.49	17.86	27.99	27.65		
Mass Hub	26.65	27.32	27.87	28.06	30.35	44.30	31.60	29.21	29.72	29.88	29.20	27.86	27.70	27.86	27.83	27.57	33.78	29.44	28.36	27.80	27.72	26.70	20.22	18.49	28.56	28.18		
DA Forecast Load (GW)	10.84	10.41	10.22	10.23	10.47	11.13	11.99	12.70	13.51	14.09	14.33	14.38	14.27	13.97	13.84	13.89	15.02	15.90	15.63	15.19	14.69	13.94	12.96	11.89				
Forecast Error %	6.9%	11.4%	12.8%	12.7%	12.5%	7.6%	5.5%	4.3%	1.1%	-1.8%	-3.1%	-3.7%	-4.1%	-3.4%	-3.5%	-3.4%	-3.1%	-2.1%	-2.0%	-2.2%	-2.5%	-2.3%	-2.2%	-0.3%				

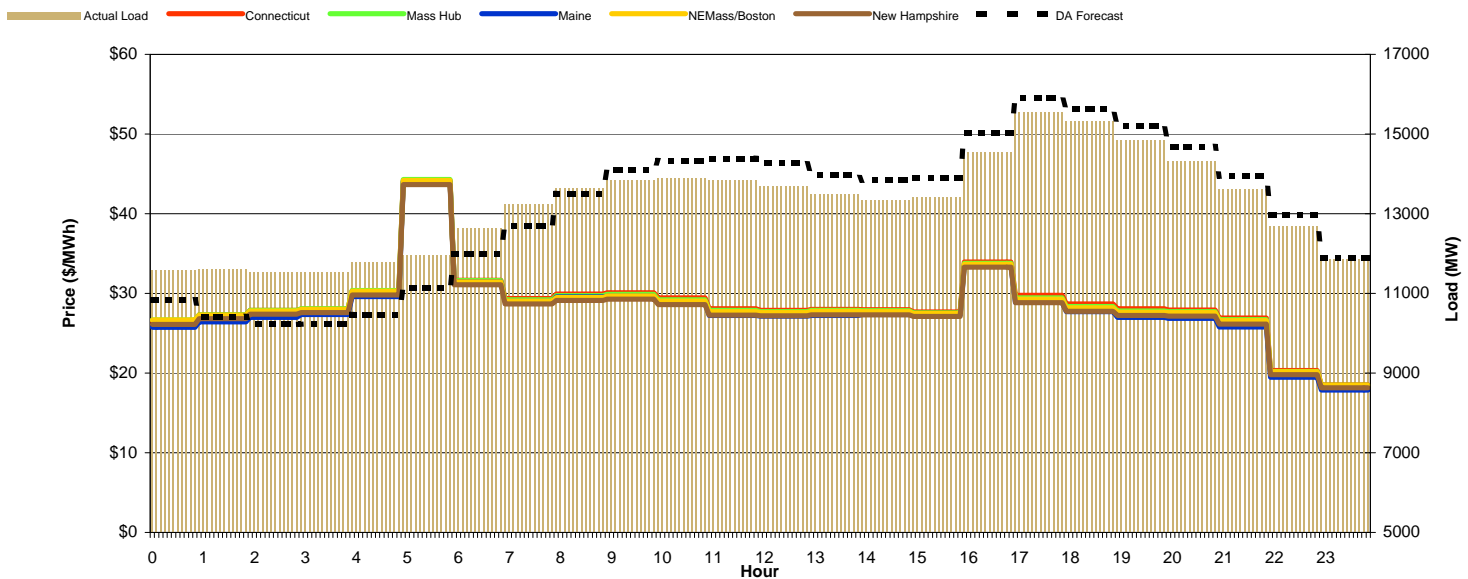




ISO-NE Daily Report

Saturday November 26, 2011

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	27.98	27.61	27.15	26.38	26.73	27.34	29.01	28.69	31.28	33.21	33.24	33.14	30.81	29.64	28.86	30.75	37.02	52.32	37.79	36.81	32.73	30.78	30.90	31.36	31.73	33.62	All	On Pk
NEMass/Boston	27.76	27.24	26.74	26.11	26.45	27.01	28.52	28.57	31.27	33.03	33.05	33.04	30.67	29.62	28.82	30.73	37.14	52.61	37.38	36.96	32.64	30.71	30.69	31.22	31.58	33.56		
New Hampshire	27.41	26.97	26.53	25.90	26.25	26.87	28.38	28.41	31.07	32.76	32.72	32.75	30.44	29.39	28.58	30.51	37.09	52.18	37.02	36.64	32.26	30.37	30.26	30.97	31.32	33.28		
Maine	27.24	26.76	26.26	25.67	26.14	26.81	28.57	28.91	31.84	33.10	33.18	33.20	30.85	29.89	29.04	31.18	37.96	53.41	38.01	37.30	32.80	30.95	30.69	32.02	31.74	33.89		
Mass Hub	27.88	27.47	26.89	26.24	26.60	27.18	28.75	28.67	31.36	33.25	33.28	33.18	30.76	29.65	28.90	30.76	37.07	52.45	37.61	36.78	32.74	30.75	30.81	31.30	31.68	33.63		
Cleared Load (GW)	11.0	10.8	10.2	10.3	10.3	10.3	11.0	11.6	12.5	13.0	13.1	13.0	12.7	12.5	12.3	12.7	14.0	14.6	14.2	13.6	13.2	12.7	11.8	10.7				

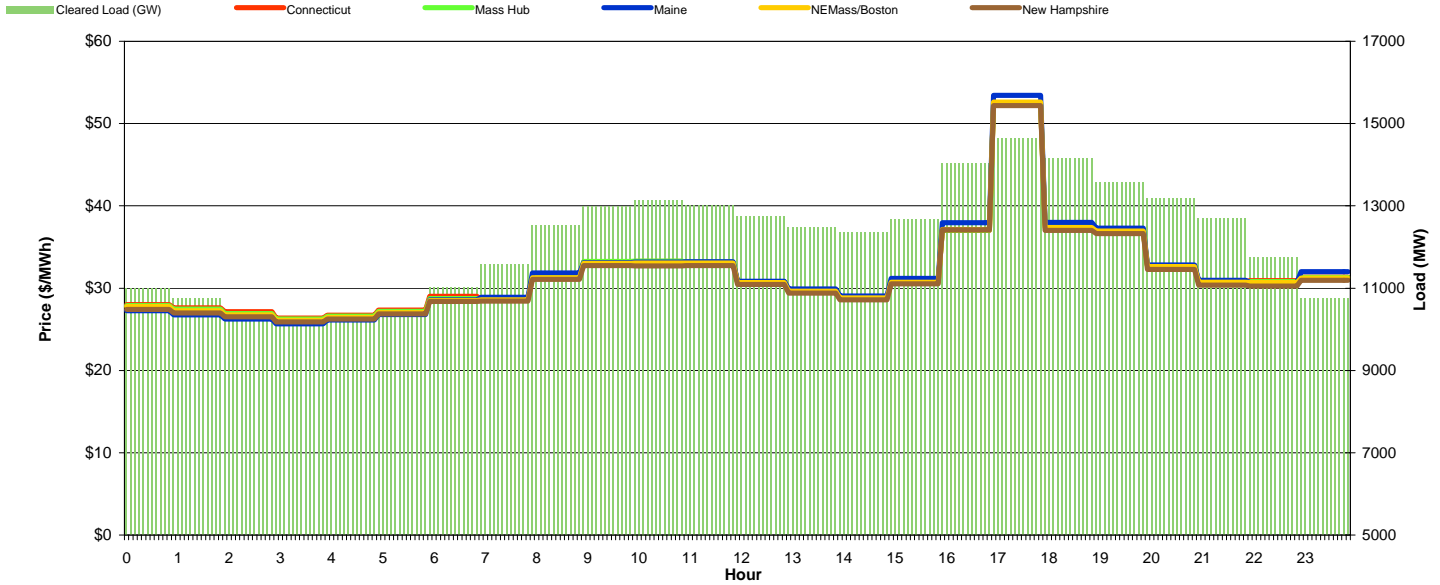

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	23.52	27.45	27.11	25.95	25.91	26.83	25.24	23.91	27.15	28.20	28.73	28.41	27.77	27.20	27.03	27.46	35.79	29.84	31.68	37.36	30.31	26.06	26.51	19.66	27.71	28.96	All	On Pk
NEMass/Boston	23.44	27.15	26.81	25.65	25.67	26.75	25.02	23.76	27.06	28.07	28.52	28.27	27.62	27.11	26.96	27.42	35.57	29.68	31.20	36.83	30.02	25.99	26.37	19.61	27.52	28.78		
New Hampshire	23.10	26.70	26.39	25.25	25.33	26.43	24.75	23.54	26.76	27.75	28.13	27.89	27.29	26.82	26.67	27.18	35.32	29.32	30.87	36.48	29.64	25.65	26.11	19.44	27.20	28.46		
Maine	22.65	26.24	25.93	24.72	24.95	26.30	24.48	23.58	27.26	28.14	28.65	28.28	27.49	27.06	26.93	27.74	36.06	30.12	31.58	37.07	29.96	26.04	26.58	19.81	27.40	28.91		
Mass Hub	23.45	27.25	26.91	25.76	25.76	26.76	25.09	23.81	27.11	28.14	28.62	28.34	27.65	27.11	26.96	27.41	35.65	29.73	31.36	37.04	30.14	26.03	26.41	19.61	27.59	28.84		
DA Forecast Load (GW)	10.70	10.23	9.97	9.91	9.99	10.43	11.07	11.75	12.78	13.37	13.48	13.41	13.19	12.88	12.72	12.84	13.94	14.94	14.75	14.32	13.80	13.04	12.14	11.17				
Forecast Error %	7.4%	6.5%	7.9%	8.4%	8.3%	4.7%	4.4%	2.0%	-0.8%	-0.8%	0.1%	0.4%	0.9%	1.5%	1.5%	1.4%	2.3%	1.8%	1.8%	1.7%	2.0%	2.8%	3.1%	3.1%				

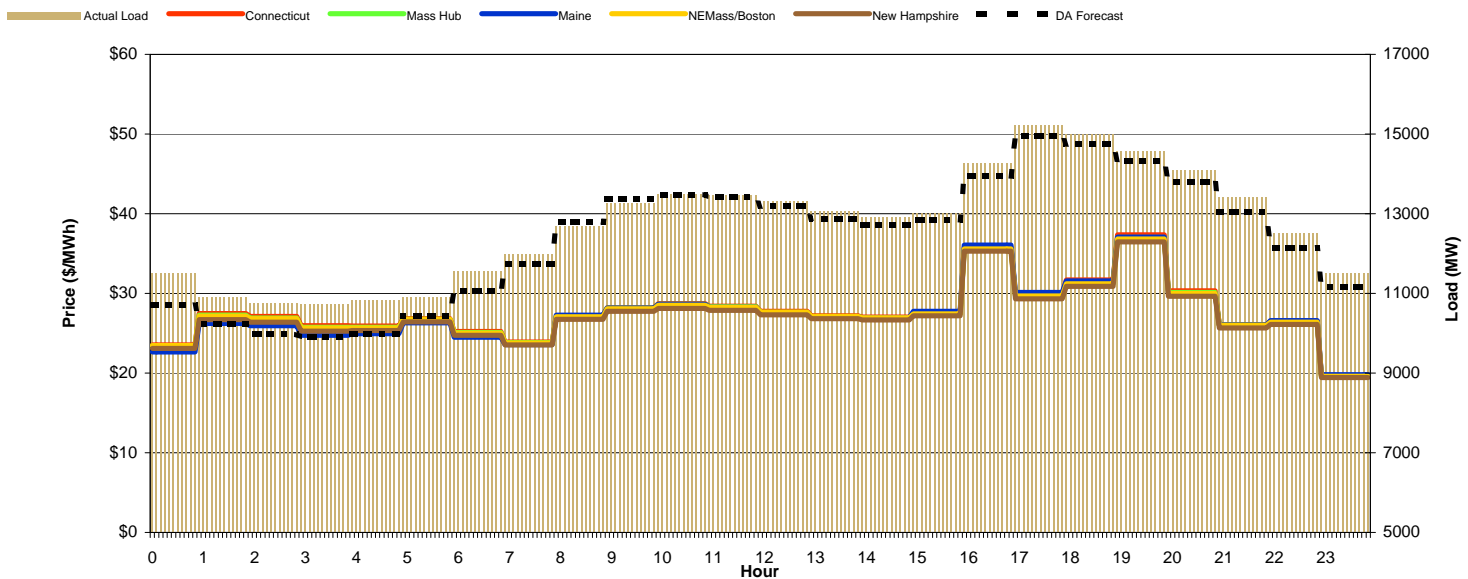




ISO-NE Daily Report

Sunday November 27, 2011

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$				
Connecticut	27.49	23.92	23.53	23.47	23.66	23.69	25.36	27.77	30.36	28.62	30.87	31.62	30.64	29.35	30.14	30.61	37.05	50.63	43.24	37.71	36.89	30.45	27.55	26.71	26.71	30.47	33.34	All	On Pk
NEMass/Boston	27.18	23.72	23.42	23.35	23.52	23.61	25.17	27.27	30.04	28.36	30.47	31.17	30.43	29.08	29.84	30.42	37.12	50.15	42.58	37.15	36.99	30.06	27.33	26.63	30.21	33.03			
New Hampshire	26.84	23.38	23.09	23.02	23.22	23.30	24.93	27.02	29.82	28.07	30.11	30.79	30.07	28.75	29.53	30.18	37.08	49.50	42.03	36.91	36.83	29.68	27.08	26.39	29.90	32.72			
Maine	27.04	23.48	23.15	23.08	23.31	23.51	25.14	27.54	30.46	28.52	30.49	31.19	30.18	28.89	29.65	30.54	37.45	49.77	42.12	37.30	36.90	29.63	27.20	26.42	30.12	32.99			
Mass Hub	27.41	23.89	23.56	23.49	23.67	23.75	25.32	27.37	30.13	28.46	30.61	31.29	30.55	29.21	29.98	30.59	37.06	50.60	42.95	37.40	36.85	30.31	27.42	26.72	30.36	33.17			
Cleared Load (GW)	10.2	9.7	9.7	9.6	9.6	9.7	10.0	10.3	11.3	12.0	12.2	12.2	12.2	12.1	12.0	12.5	14.0	14.9	14.5	14.1	13.5	12.6	11.4	10.4					

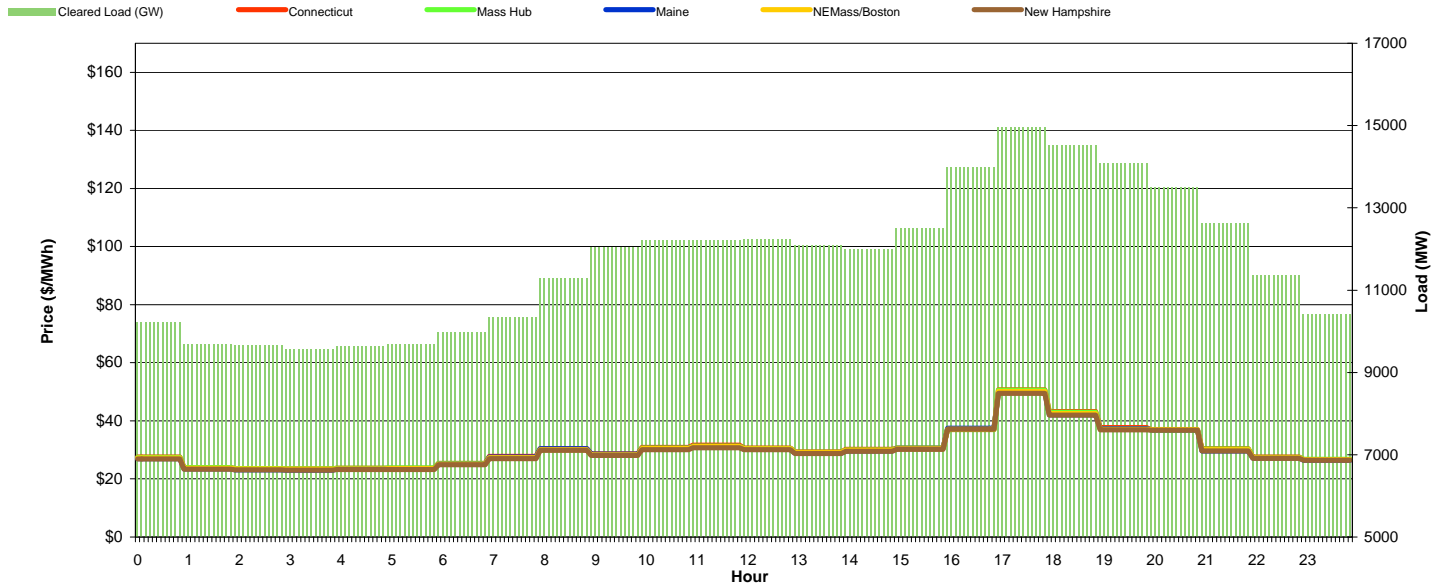

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	19.15	21.60	23.07	19.83	25.74	27.51	28.24	35.71	44.74	80.10	162.40	49.38	30.68	36.20	31.94	44.90	52.89	36.86	35.73	33.01	31.55	24.86	17.14	20.86	38.92	46.76	All	On Pk
NEMass/Boston	19.08	21.35	22.84	19.61	25.48	27.24	28.01	35.30	40.60	55.75	114.02	47.67	30.36	35.87	31.37	44.05	52.02	36.43	35.20	32.55	31.07	24.59	16.99	20.57	35.33	41.49		
New Hampshire	18.79	21.02	22.51	19.33	25.15	26.89	27.65	35.32	39.90	52.76	109.22	46.84	30.11	35.83	31.07	43.69	51.28	35.78	34.52	32.03	30.50	24.13	16.66	20.17	34.63	40.60		
Maine	18.89	21.07	22.54	19.33	25.34	27.16	27.92	35.76	41.09	55.95	116.09	47.84	30.40	36.15	31.43	44.41	52.08	36.11	34.77	32.31	30.33	23.97	16.42	19.82	35.30	41.57		
Mass Hub	19.13	21.47	22.96	19.72	25.61	27.39	28.14	35.50	41.10	58.13	118.76	48.00	30.49	36.00	31.55	44.35	52.33	36.61	35.41	32.73	31.28	24.71	17.05	20.72	35.80	42.13		
DA Forecast Load (GW)	10.61	10.14	9.87	9.78	9.85	10.19	10.68	11.26	12.18	12.79	13.07	13.23	13.19	13.09	13.06	13.29	14.68	15.89	15.61	15.07	14.35	13.30	12.11	11.04				
Forecast Error %	1.1%	0.7%	3.1%	3.2%	3.2%	2.1%	0.6%	1.2%	1.5%	2.3%	2.9%	2.8%	3.3%	3.4%	3.3%	3.3%	3.0%	1.3%	2.5%	3.1%	3.6%	3.4%	4.9%	7.3%				

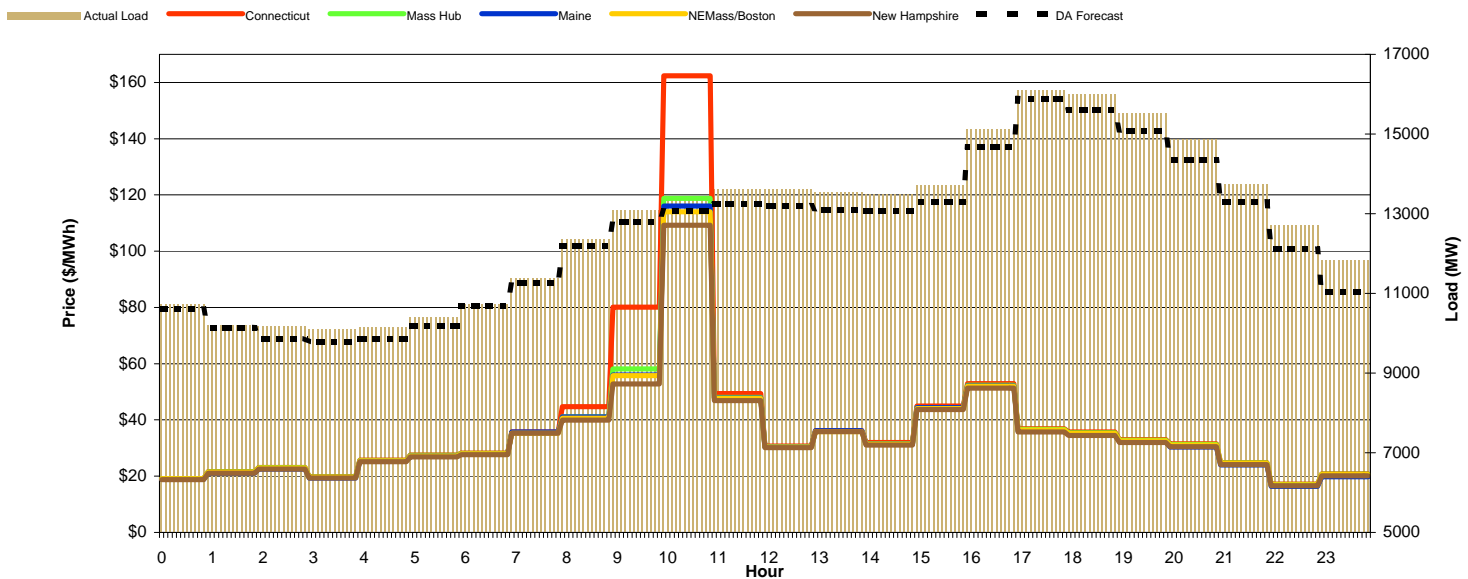




ISO-NE Daily Report

Monday November 28, 2011

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$	
Connecticut	24.18	19.06	19.92	17.31	22.27	26.92	35.22	34.55	33.61	33.57	33.58	33.54	32.73	31.22	32.73	32.73	49.98	60.25	48.27	34.55	33.54	28.93	29.29	28.06	32.33	36.44
NEMass/Boston	23.62	18.73	19.64	17.05	21.98	26.63	36.82	34.30	33.21	33.22	33.32	33.31	32.62	31.12	32.54	32.56	49.55	59.97	47.77	34.15	33.37	29.02	28.91	27.78	32.13	36.18
New Hampshire	23.35	18.46	19.41	16.89	21.77	26.54	36.88	34.14	32.85	32.89	33.04	33.00	32.31	30.83	32.24	32.22	48.89	58.92	47.11	33.73	33.11	28.81	28.61	27.48	31.81	35.79
Maine	22.98	18.03	19.03	16.58	21.50	26.57	37.26	34.40	33.22	33.15	33.37	33.23	32.48	31.11	32.50	32.75	49.00	59.39	47.36	33.88	33.26	29.33	28.92	27.60	31.95	36.08
Mass Hub	23.86	18.91	19.76	17.17	22.09	26.74	36.00	34.70	33.65	33.57	33.59	33.58	32.85	31.33	32.78	32.80	50.00	60.56	48.18	34.33	33.46	29.01	29.05	27.87	32.33	36.47
Cleared Load (GW)	10.5	10.5	10.2	10.2	10.2	11.0	13.1	14.3	14.4	14.4	14.5	14.5	14.3	14.2	14.1	14.2	15.6	16.2	15.8	15.3	14.6	13.5	12.2	10.9		

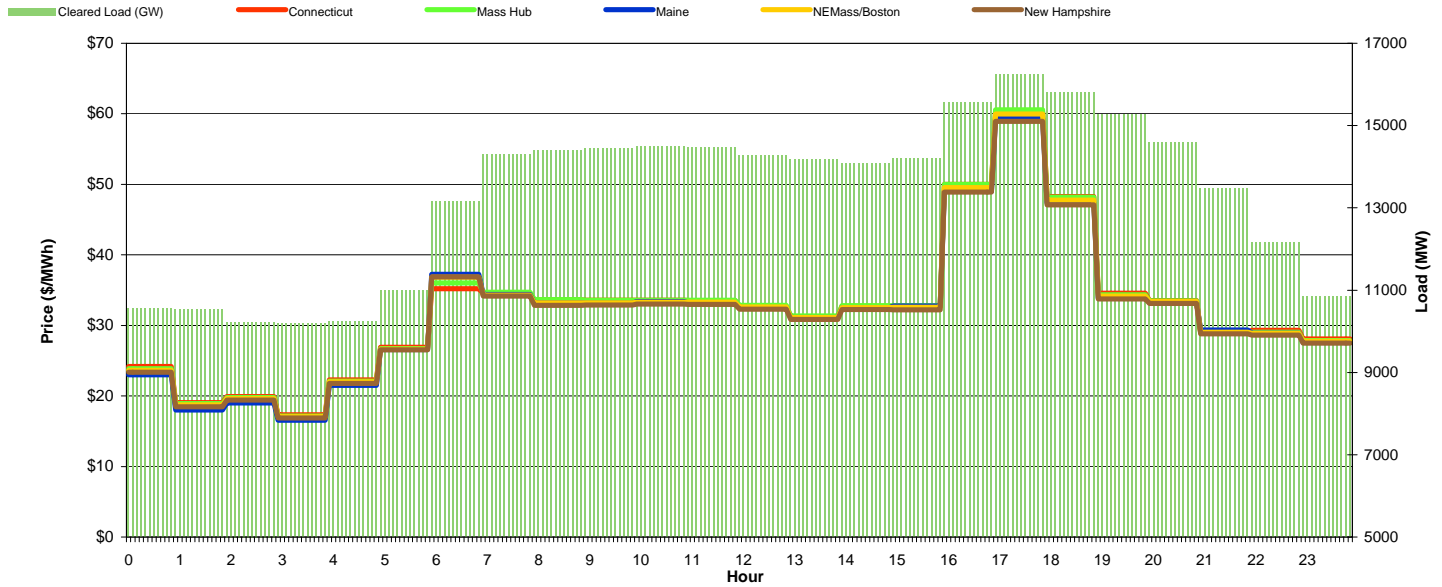

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$	
Connecticut	20.55	21.15	19.77	20.11	17.16	21.69	28.49	30.71	30.73	29.26	38.39	32.70	38.10	42.25	34.71	30.04	38.73	50.21	35.54	36.29	38.78	30.88	27.90	26.82	30.87	35.33
NEMass/Boston	20.10	20.54	19.27	19.70	16.92	21.60	28.47	30.29	30.14	28.68	37.70	32.26	37.78	42.17	34.62	30.03	38.71	52.18	35.34	35.83	38.15	30.57	27.56	26.48	30.63	35.13
New Hampshire	19.77	20.24	19.01	19.45	16.70	21.33	28.07	29.82	29.57	28.11	37.01	31.67	37.19	41.54	34.07	29.53	37.96	48.47	34.58	35.18	37.50	30.14	27.19	26.15	30.01	34.35
Maine	19.23	19.63	18.48	18.98	16.37	21.09	27.81	29.56	29.26	27.69	36.53	31.20	36.85	40.99	33.73	28.98	37.80	50.55	34.11	34.53	36.45	29.67	26.99	25.87	29.68	34.06
Mass Hub	20.28	20.77	19.46	19.86	17.03	21.69	28.60	30.51	30.39	28.93	38.01	32.50	38.00	42.29	34.71	30.10	38.81	52.78	35.48	36.04	38.40	30.69	27.68	26.63	30.82	35.33
DA Forecast Load (GW)	10.26	9.95	9.83	9.87	10.24	11.37	13.37	14.55	14.95	15.12	15.27	15.33	15.34	15.27	15.14	15.18	16.37	17.44	17.09	16.56	15.72	14.51	13.03	11.68		
Forecast Error %	9.9%	11.0%	10.8%	9.9%	7.7%	3.4%	1.2%	0.4%	-1.0%	-0.8%	-0.6%	-0.8%	-1.3%	-1.1%	-1.0%	-0.9%	-1.4%	-1.1%	-0.1%	-0.1%	0.5%	0.7%	0.5%	2.1%		

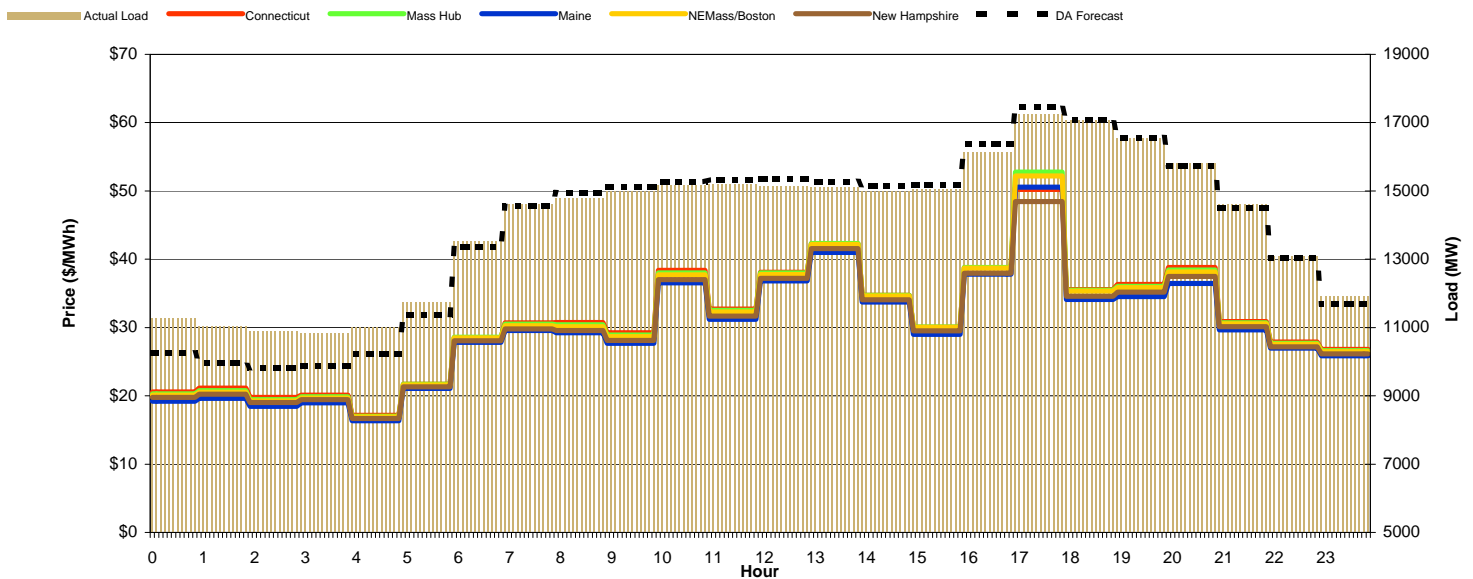




ISO-NE Daily Report

Tuesday November 29, 2011

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	30.29	28.89	25.22	25.47	25.33	28.81	32.33	33.00	32.74	33.22	33.41	33.52	33.45	33.34	33.00	33.36	47.84	58.00	47.61	35.00	32.85	30.42	29.48	30.43	33.63	36.27	All	On Pk
NEMass/Boston	29.78	28.47	25.08	25.25	25.20	28.76	32.60	33.01	32.78	33.29	33.36	33.38	33.39	33.28	33.04	33.42	47.66	57.77	47.44	34.82	32.93	30.66	29.55	30.53	33.56	36.24		
New Hampshire	29.47	28.30	24.86	25.07	24.98	28.55	32.31	32.51	32.19	32.63	32.75	32.75	32.69	32.53	32.34	32.82	46.57	56.20	46.24	34.11	32.12	30.12	29.05	29.94	32.96	35.48		
Maine	29.32	28.06	24.71	24.92	24.89	28.67	33.00	32.57	32.00	32.36	32.22	32.13	32.05	31.77	31.84	32.45	45.80	55.39	45.00	33.38	31.27	29.74	29.14	29.86	32.61	34.94		
Mass Hub	29.92	28.47	24.98	25.16	25.10	28.76	32.70	33.24	32.91	33.38	33.56	33.61	33.58	33.53	33.24	33.62	48.05	58.77	48.15	35.03	33.09	30.74	29.61	30.59	33.74	36.51		
Cleared Load (GW)	10.3	9.9	9.6	9.6	9.6	10.3	12.8	14.0	14.0	14.2	14.4	14.5	14.4	14.5	14.4	14.7	15.8	16.7	16.0	15.1	14.4	13.3	12.0	10.7				

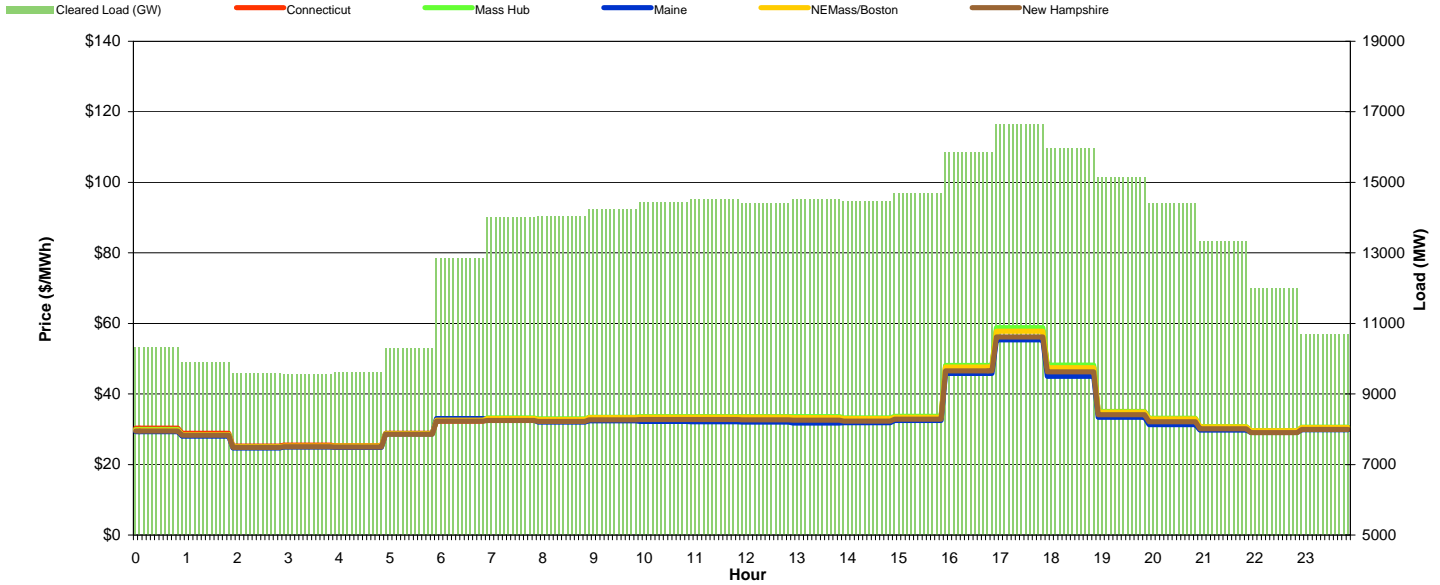

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	29.76	33.44	26.48	26.54	23.76	27.35	30.92	30.10	34.71	34.81	43.41	33.24	32.58	30.38	29.02	28.59	48.60	77.44	48.89	47.87	43.99	37.37	31.64	23.85	35.61	39.54	All	On Pk
NEMass/Boston	29.57	33.10	26.39	26.46	23.77	27.63	31.38	30.19	34.86	34.94	43.46	33.43	32.79	30.55	29.23	28.83	110.25	126.35	49.06	47.55	43.83	37.47	31.83	24.11	40.29	46.54		
New Hampshire	29.22	32.92	26.16	26.23	23.52	27.47	31.06	29.73	34.25	34.27	42.60	32.78	32.09	29.91	28.59	28.25	47.17	74.67	47.74	46.34	42.59	36.52	31.07	23.52	34.94	38.66		
Maine	29.04	32.67	26.01	26.13	23.47	27.67	31.44	29.67	34.03	33.94	41.97	32.45	31.73	29.51	28.12	28.08	45.99	80.33	46.20	44.69	40.85	35.32	30.45	23.17	34.71	38.33		
Mass Hub	29.64	33.18	26.41	26.48	23.77	27.51	31.23	30.15	34.80	34.86	43.38	33.34	32.70	30.48	29.15	28.74	48.81	86.32	49.05	47.65	43.90	37.46	31.78	24.05	36.04	40.16		
DA Forecast Load (GW)	10.83	10.35	10.09	10.06	10.37	11.49	13.50	14.74	15.13	15.37	15.58	15.59	15.66	15.61	15.57	15.72	16.85	17.49	17.16	16.62	15.75	14.53	13.05	11.66				
Forecast Error %	3.3%	6.0%	6.3%	5.9%	2.4%	-0.2%	-1.8%	-2.1%	-2.4%	-2.6%	-2.2%	-2.8%	-2.5%	-3.3%	-4.2%	-3.6%	-1.4%	-0.5%	-0.5%	0.5%	0.9%	0.6%	0.5%					

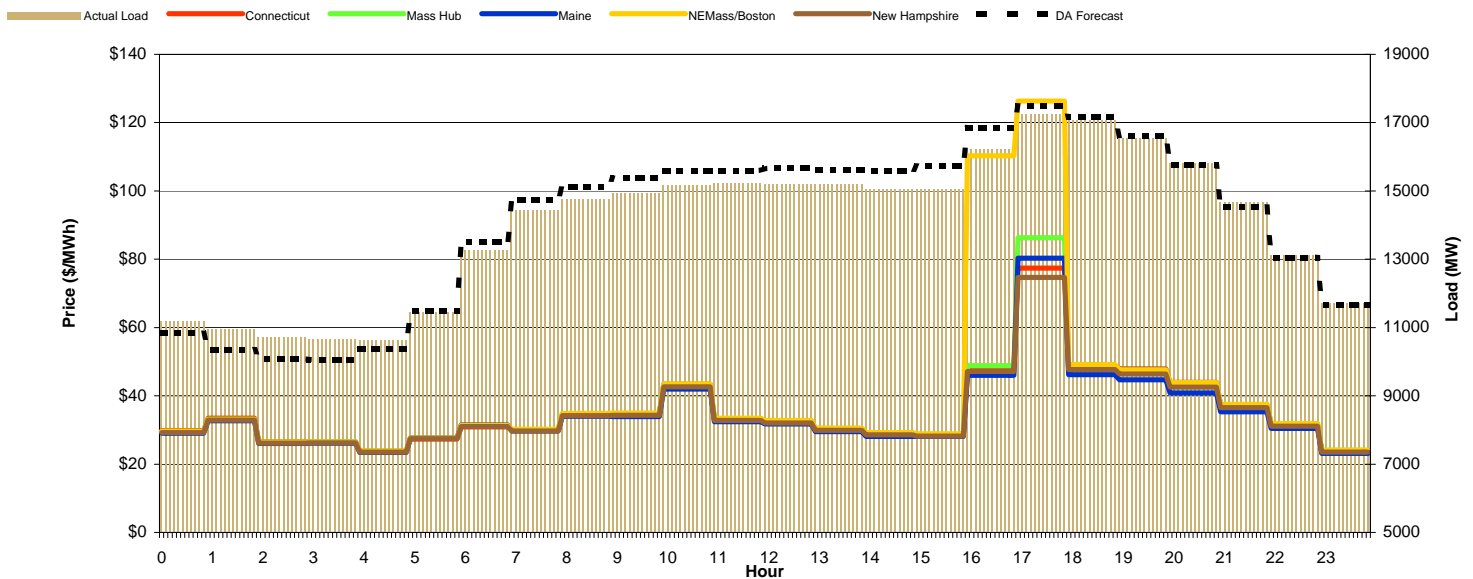




ISO-NE Daily Report

Wednesday November 30, 2011

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%

Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	28.51	26.14	25.16	19.85	26.12	29.26	34.75	34.25	33.69	33.90	34.59	34.03	33.78	33.76	33.68	33.71	44.99	58.29	48.61	37.33	34.24	33.41	33.29	32.95	34.10	37.22	All	On Pk
NEMass/Boston	28.44	26.13	25.08	19.85	26.14	29.43	34.58	33.75	33.21	33.37	33.99	33.45	33.34	33.36	33.34	33.36	44.46	57.67	47.94	36.65	33.83	33.25	33.14	33.06	33.78	36.76		
New Hampshire	27.92	25.69	24.69	19.56	25.72	28.97	33.97	33.06	32.53	32.64	33.33	32.91	32.68	32.78	32.74	43.52	56.02	46.74	36.02	33.18	32.92	32.62	32.55	33.15	36.03			
Maine	27.50	25.23	24.16	19.22	25.29	28.59	33.63	32.59	32.26	32.25	33.16	32.70	32.22	32.63	32.62	32.58	43.00	55.55	46.29	35.72	32.68	32.84	32.52	32.58	32.83	35.73		
Mass Hub	28.55	26.23	25.19	19.93	26.23	29.50	35.00	34.15	33.51	33.71	34.38	33.77	33.63	33.66	33.62	33.64	44.90	58.54	48.63	36.91	34.10	33.41	33.31	33.34	34.08	37.12		
Cleared Load (GW)	10.1	10.0	9.8	10.0	10.0	10.6	12.9	14.0	14.1	14.4	14.5	14.5	14.3	14.3	14.3	14.4	15.9	16.6	16.1	15.6	15.1	14.0	12.6	11.4				

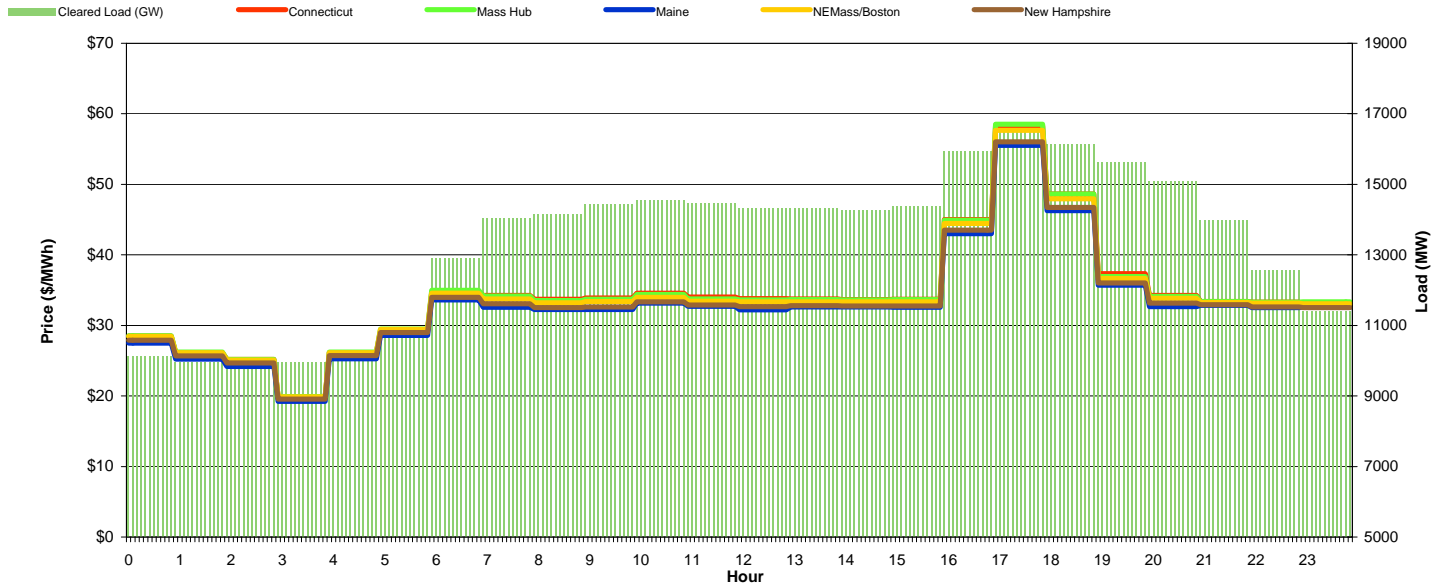

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	17.41	15.72	22.94	17.59	12.55	13.52	32.95	33.30	30.49	30.45	30.95	31.36	31.66	31.79	30.65	29.76	43.73	42.47	43.56	39.18	34.24	29.21	26.05	24.09	28.98	33.68	All	On Pk
NEMass/Boston	17.50	15.75	22.92	17.60	12.59	13.61	32.97	33.00	30.30	30.13	30.54	30.97	31.34	31.47	30.45	29.56	43.18	41.91	42.92	38.46	33.66	28.88	25.82	24.01	28.73	33.29		
New Hampshire	17.09	15.44	22.52	17.32	12.39	13.38	32.35	32.34	29.58	29.44	29.82	30.28	30.65	30.79	29.73	28.81	42.15	40.79	41.90	37.61	33.03	28.34	25.27	23.51	28.11	32.53		
Maine	16.76	15.10	22.13	17.05	12.20	13.32	32.21	32.02	29.27	29.09	29.37	29.80	30.25	30.44	29.42	28.34	41.50	40.27	41.23	36.84	32.35	27.97	25.02	23.24	27.72	32.07		
Mass Hub	17.48	15.74	22.90	17.58	12.58	13.61	33.07	33.20	30.44	30.27	30.71	31.15	31.50	31.63	30.56	29.64	43.38	42.14	43.19	38.74	33.89	28.99	25.92	24.08	28.85	33.46		
DA Forecast Load (GW)	10.87	10.35	10.11	10.11	10.40	11.54	13.62	14.84	15.19	15.35	15.50	15.40	15.32	15.29	15.23	15.33	16.64	17.60	17.30	16.74	15.97	14.72	13.24	11.88				
Forecast Error %	1.1%	4.5%	6.4%	5.4%	2.0%	-3.3%	-3.9%	-3.7%	-4.5%	-4.2%	-4.0%	-3.2%	-3.4%	-3.3%	-3.5%	-3.6%	-3.4%	-2.4%	-1.2%	-0.4%	0.2%	1.3%	1.1%	0.9%				

