




MISO Daily Report

Sunday May 1, 2011

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$			
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk		
Cinergy Hub	23.21	18.00	18.01	18.51	18.29	19.89	20.63	24.21	27.38	28.52	28.63	28.30	27.78	26.82	26.21	26.71	27.79	28.48	29.46	39.80	40.75	28.64	26.35	25.68	26.17	29.11		
First Energy Hub	26.04	19.86	20.07	20.60	20.35	22.62	22.81	32.18	35.30	35.94	35.28	34.00	31.72	33.13	33.38	34.13	33.67	34.93	37.09	49.49	48.77	33.76	28.24	27.77	31.30	35.69		
Illinois Hub	25.29	23.17	23.27	23.18	23.60	24.43	26.32	24.79	27.30	28.14	27.85	27.48	26.93	25.99	25.38	25.91	26.93	27.63	28.68	40.43	40.55	27.94	26.94	26.28	27.27	28.68		
Michigan Hub	20.59	16.12	15.91	16.48	16.17	16.96	18.59	21.52	25.10	27.81	28.43	28.45	28.74	25.43	24.42	24.81	27.55	28.29	29.57	37.36	38.53	27.11	24.93	23.92	24.70	28.00		
Minnesota Hub	5.95	1.58	1.03	1.31	1.45	5.20	5.81	10.38	21.61	21.70	21.71	21.54	21.52	21.26	21.15	21.55	21.64	22.75	26.69	40.47	48.55	29.25	21.76	20.39	18.18	24.60		
Wisconsin PS	17.81	14.14	14.21	14.00	21.19	20.45	20.72	23.40	28.65	29.53	29.44	28.27	27.68	27.17	26.55	26.97	27.27	27.35	27.59	34.46	36.99	29.39	25.49	24.15	25.12	28.51		
Cleared Load (GW)	49.2	48.5	47.5	47.3	48.3	50.6	53.4	56.8	58.9	59.7	59.9	59.2	58.6	57.4	56.8	56.7	56.7	56.5	56.7	60.1	61.1	56.6	52.2	5.0				

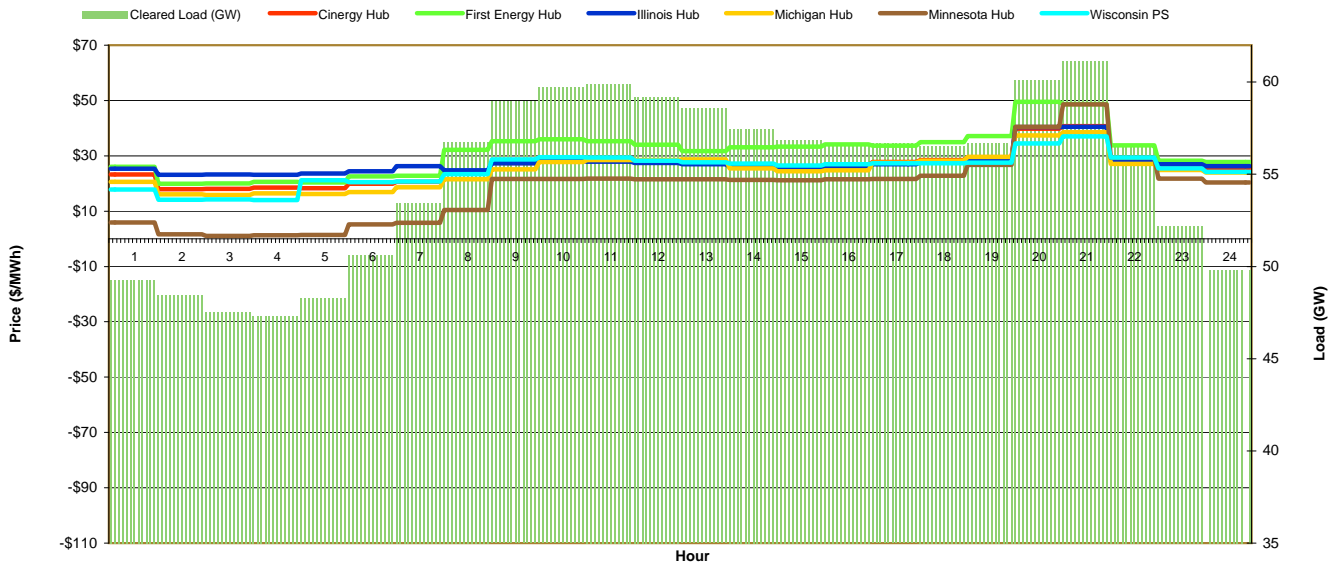

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$			
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk		
Cinergy Hub	2.24	12.06	17.03	21.31	17.62	22.65	20.01	13.81	24.18	29.82	25.49	27.50	25.95	23.26	24.09	24.97	25.93	28.61	34.90	34.20	40.67	30.94	28.23	19.09	23.94	27.66		
First Energy Hub	2.01	67.13	17.36	21.86	18.02	23.19	20.09	14.18	24.93	30.77	26.34	28.45	26.87	24.15	24.95	25.84	26.86	29.65	36.15	35.58	42.14	31.93	29.18	19.73	26.97	28.62		
Illinois Hub	33.82	-8.03	48.61	43.59	48.37	53.65	2.79	14.25	33.74	47.91	43.71	33.13	40.50	26.00	36.57	29.80	41.74	34.06	56.68	34.01	39.71	30.29	36.43	28.97	34.60	36.16		
Michigan Hub	2.01	-106.71	17.36	21.88	18.04	23.22	20.60	14.16	24.86	30.67	26.27	28.35	26.73	23.99	24.81	25.69	26.66	29.46	35.94	35.23	41.95	31.84	29.17	19.72	19.66	28.49		
Minnesota Hub	-30.34	-10.89	-16.08	2.64	-7.22	-3.02	8.10	4.06	15.35	14.13	21.00	21.62	13.41	19.89	18.52	19.20	21.41	30.68	16.43	34.01	41.63	31.82	21.17	10.98	12.44	21.52		
Wisconsin PS	2.07	-10.93	17.13	21.56	17.69	22.70	6.67	13.99	24.56	30.27	26.54	28.36	26.37	23.71	24.68	25.84	26.72	29.91	35.67	35.63	43.10	32.67	29.12	19.61	23.07	28.57		
Forecasted Load (GW)	53.2	51.6	51.0	50.9	51.4	52.9	53.3	55.3	57.7	59.2	59.6	59.4	58.7	58.2	57.6	57.3	57.2	57.2	57.4	58.7	60.0	57.6	54.7	53.0				
Forecast Error %	-3.3%	-3.7%	-4.0%	-3.5%	-3.3%	-3.2%	-0.5%	0.4%	0.4%	0.1%	-0.1%	-0.4%	-0.1%	-0.3%	-0.3%	-0.3%	0.0%	0.2%	-0.3%	-0.8%	-0.8%	0.1%	-0.2%	-3.0%				

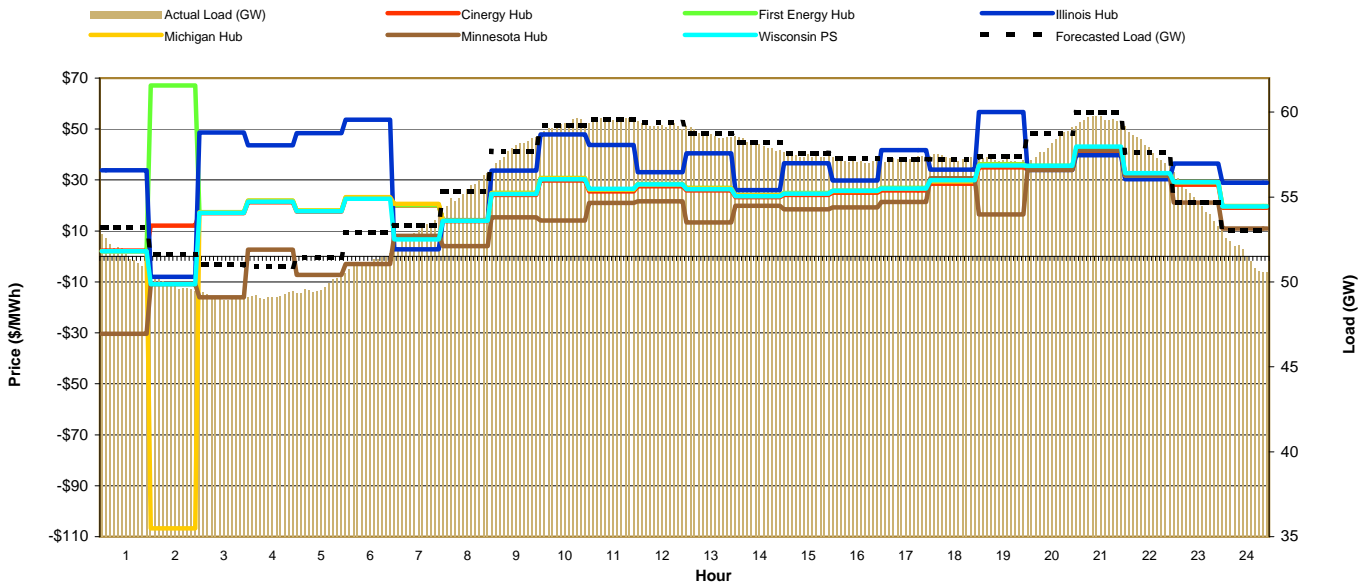




MISO Daily Report

Monday May 2, 2011

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
																									All	On Pk		
Cinergy Hub	23.70	23.06	22.38	23.41	25.87	38.80	39.96	44.86	48.17	51.46	50.86	46.41	49.26	47.00	47.02	43.06	44.21	44.41	44.00	57.19	52.13	41.26	30.65	28.28	40.31	46.37		
First Energy Hub	28.40	27.23	26.19	27.35	30.21	41.92	48.16	54.06	53.43	60.96	62.44	53.55	54.51	53.89	54.11	49.96	49.27	49.46	49.57	62.52	59.28	47.25	32.29	28.80	46.03	52.91		
Illinois Hub	25.13	24.59	24.52	24.94	26.99	38.98	39.34	43.75	47.15	63.36	66.11	63.73	65.71	63.07	62.11	55.73	57.25	57.62	57.47	76.30	59.73	51.60	37.14	33.99	48.60	57.99		
Michigan Hub	17.44	17.58	17.48	18.44	20.13	36.15	40.94	46.19	48.61	52.35	48.69	46.87	48.81	45.64	45.41	43.46	44.42	44.54	43.77	63.29	50.81	40.08	30.86	29.11	39.21	46.49		
Minnesota Hub	17.78	16.61	16.17	17.01	18.28	24.42	33.66	42.00	42.45	35.51	33.28	28.78	27.33	25.00	24.94	24.49	24.81	25.02	26.82	32.88	41.30	28.96	22.81	21.60	27.16	30.40		
Wisconsin PS	21.39	20.35	19.89	20.19	24.95	28.22	31.70	42.32	43.43	43.93	48.48	44.71	43.77	42.38	40.00	38.88	36.91	34.62	35.23	41.85	43.08	35.36	29.49	27.87	34.96	40.28		
Cleared Load (GW)	47.6	46.7	45.8	45.7	46.4	48.3	49.5	52.4	55.8	57.3	57.8	57.3	56.5	56.1	55.9	56.1	56.6	57.4	58.1	61.5	62.6	58.6	54.6	52				

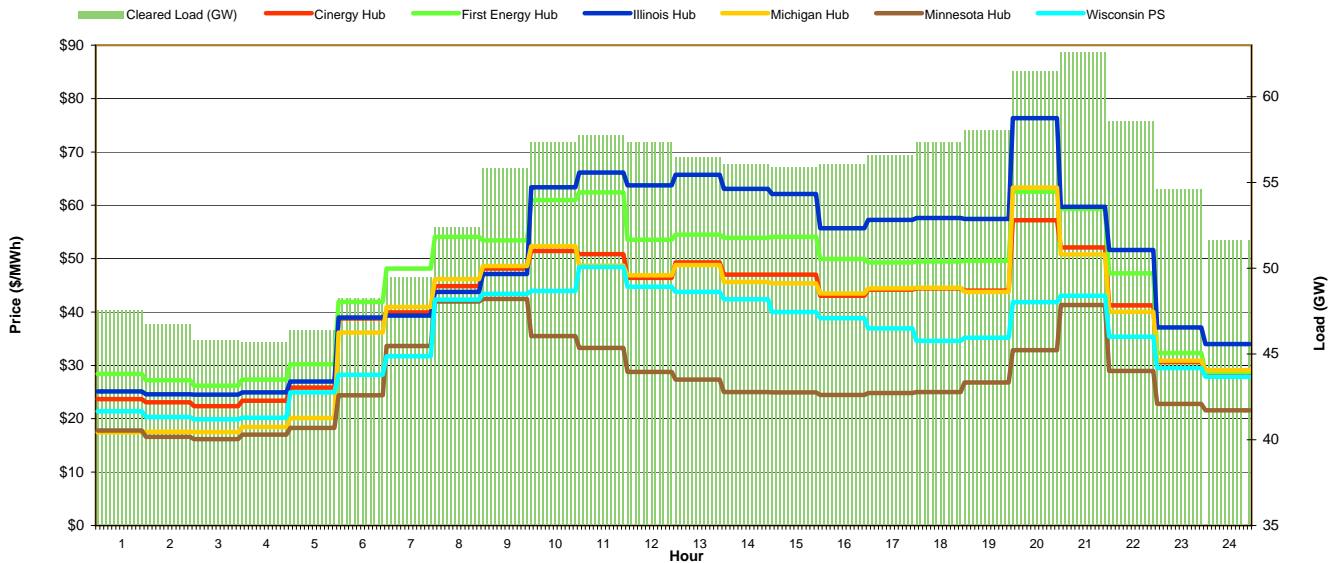

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
																									All	On Pk		
Cinergy Hub	20.23	15.97	19.91	21.52	30.52	33.35	54.38	29.78	26.30	27.30	45.14	29.99	33.98	35.10	29.48	28.62	42.42	39.62	61.95	79.35	33.02	30.69	26.70	24.79	34.17	37.47		
First Energy Hub	20.84	16.45	20.46	22.08	31.32	34.42	56.17	30.81	27.17	28.30	46.91	31.11	35.36	36.55	30.70	29.81	44.12	40.90	63.76	82.13	34.19	31.70	27.53	25.57	35.35	38.82		
Illinois Hub	27.78	23.49	25.91	31.37	58.09	46.27	52.62	29.00	26.35	38.97	44.05	29.25	33.09	35.29	34.67	33.09	61.37	51.53	85.78	76.67	32.12	29.96	26.05	24.02	39.87	41.70		
Michigan Hub	20.87	16.45	20.51	22.20	31.51	34.66	56.44	30.59	27.00	28.08	46.47	30.78	34.95	36.11	30.47	29.61	44.26	40.86	63.74	81.77	34.00	31.72	27.87	26.03	35.29	38.64		
Minnesota Hub	14.07	9.67	14.66	13.07	7.22	21.31	53.82	29.75	25.00	14.33	45.02	27.40	29.74	28.56	23.56	21.36	17.04	24.85	29.28	61.61	31.75	30.07	26.05	23.23	25.93	29.09		
Wisconsin PS	20.90	16.36	20.51	22.03	30.67	33.46	55.71	31.10	27.42	28.78	48.61	31.82	35.56	35.84	29.79	29.00	31.75	33.31	41.55	52.17	32.88	31.68	27.41	25.06	32.22	34.29		
Forecasted Load (GW)	50.5	49.2	48.5	48.4	48.7	49.6	50.9	52.4	54.5	55.0	55.9	55.9	55.9	55.7	55.4	55.6	56.4	57.0	57.5	59.4	61.5	59.7	56.3	52.9				
Forecast Error %	-2.9%	-3.7%	-3.5%	-4.2%	-4.2%	-3.5%	-4.5%	-2.3%	-1.1%	1.0%	1.1%	2.0%	2.0%	1.7%	1.6%	1.6%	1.2%	1.2%	1.6%	0.6%	-0.9%	-1.7%	-2.0%	-0.8%				

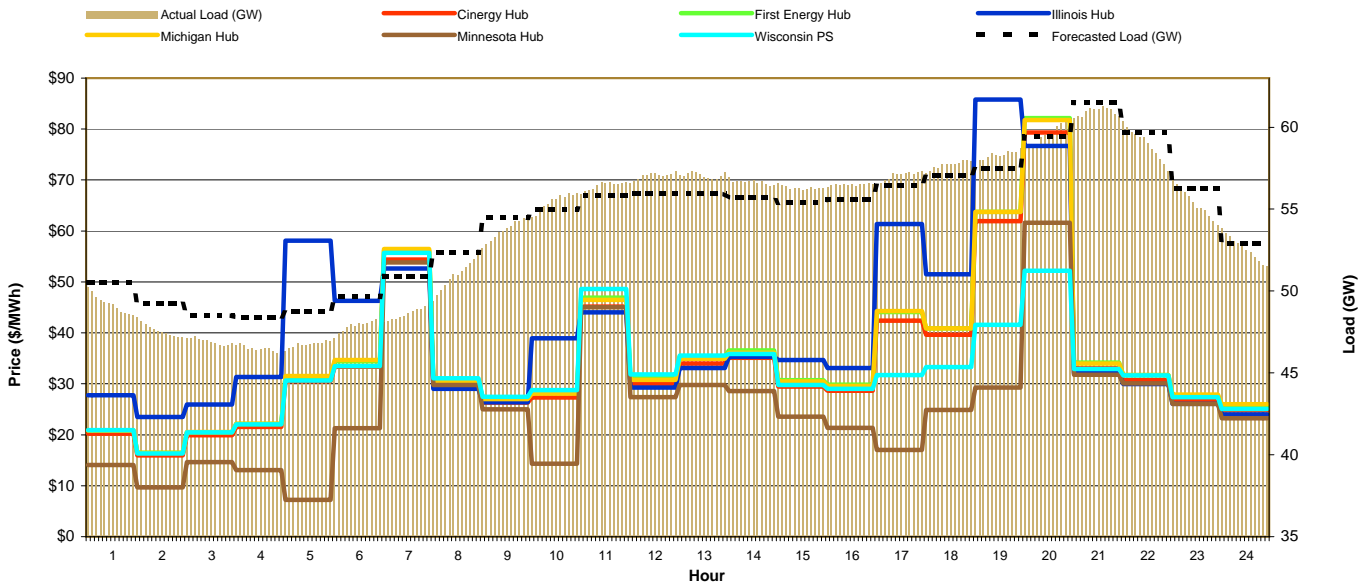




MISO Daily Report

Tuesday May 3, 2011

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$	
																									All	On Pk
Cinergy Hub	25.21	24.10	22.98	23.98	25.75	36.25	42.42	46.27	44.37	50.36	48.39	45.76	45.85	46.11	40.30	37.91	37.78	34.15	34.30	45.88	47.13	34.65	27.97	26.48	37.26	41.70
First Energy Hub	26.98	25.60	24.46	25.40	27.23	40.66	45.96	49.00	46.87	53.12	51.05	48.21	48.13	48.50	41.84	45.54	44.82	40.77	41.47	55.04	54.40	42.24	29.55	27.52	41.02	46.28
Illinois Hub	26.39	24.81	24.42	24.89	26.96	36.90	40.61	43.99	42.23	48.26	46.38	43.88	43.69	43.90	38.43	36.09	35.92	32.47	32.68	43.62	45.24	33.08	28.12	26.07	36.21	39.87
Michigan Hub	23.82	23.24	22.03	23.36	25.07	34.60	42.39	46.85	45.94	51.11	49.08	46.57	46.62	46.61	41.95	36.50	36.62	32.90	32.68	43.63	46.04	32.90	28.03	27.18	36.91	41.50
Minnesota Hub	19.33	18.04	17.67	17.72	19.49	25.57	37.57	51.97	52.00	49.66	47.38	44.85	40.55	40.56	34.46	31.32	30.43	27.91	27.81	34.84	46.08	29.59	20.44	18.67	32.66	38.12
Wisconsin PS	23.64	22.49	22.25	22.41	24.09	30.48	33.89	43.61	47.63	50.59	48.37	45.85	44.26	44.42	38.59	35.60	35.16	32.15	30.76	37.03	47.71	33.16	26.68	24.87	35.23	40.10
Cleared Load (GW)	49.4	48.6	48.5	49.2	52.0	59.5	64.3	67.4	68.1	69.5	68.9	68.5	68.4	67.6	66.2	65.7	65.3	64.4	63.8	65.7	67.3	63.5	59.3	5.6		

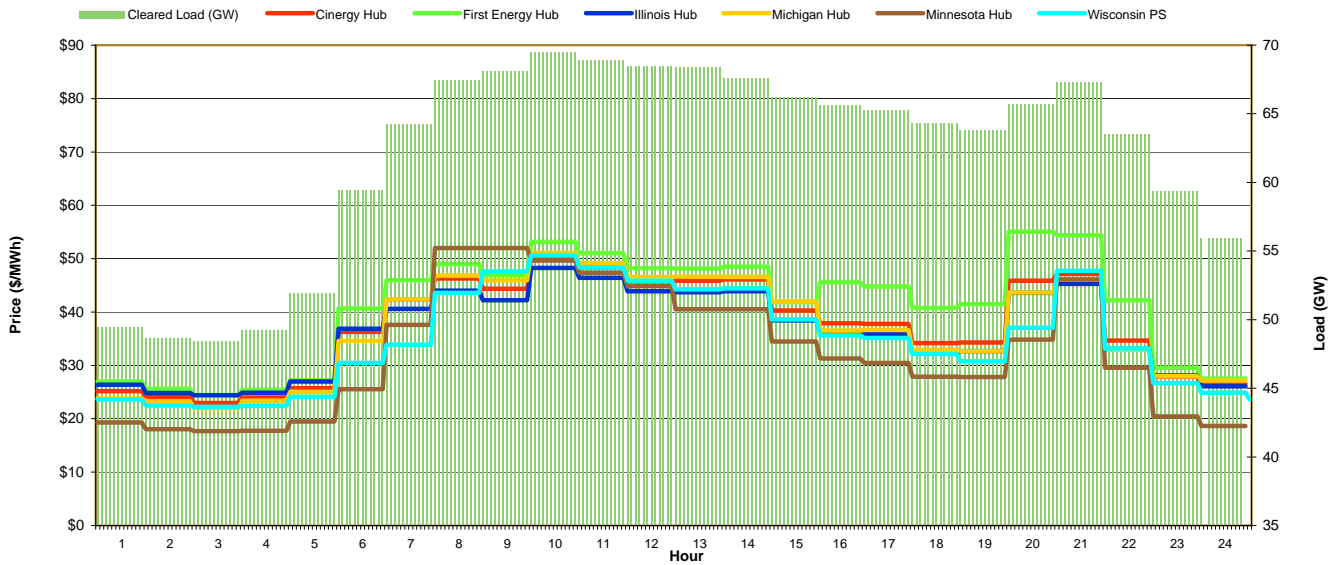

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$	
																									All	On Pk
Cinergy Hub	23.49	23.14	22.30	23.52	36.94	44.63	55.48	60.49	47.91	37.96	53.41	54.76	49.38	49.93	30.83	59.73	34.65	28.04	29.31	30.01	31.61	27.45	24.01	24.13	37.63	40.59
First Energy Hub	24.28	23.79	22.92	24.19	38.20	45.85	57.07	62.66	50.11	39.81	87.86	74.57	51.96	52.47	32.07	53.26	34.54	30.00	31.08	31.48	32.95	28.48	25.25	25.03	40.83	44.91
Illinois Hub	23.57	23.56	23.22	24.57	40.54	52.68	53.57	58.65	46.66	36.94	51.98	53.17	47.72	46.82	27.45	20.26	26.49	27.34	28.36	28.98	30.85	26.85	26.04	30.48	35.70	36.54
Michigan Hub	24.75	24.16	23.21	24.50	38.13	46.56	57.51	63.00	61.96	39.64	39.96	63.95	52.71	53.46	44.36	70.76	43.03	30.08	31.11	32.15	33.02	28.82	25.81	25.63	40.76	44.61
Minnesota Hub	20.21	20.24	19.52	19.65	29.64	33.27	46.46	56.95	37.82	36.31	50.11	50.02	44.08	44.65	26.98	25.92	26.89	26.77	27.56	28.14	30.81	26.96	20.71	14.39	31.84	35.04
Wisconsin PS	23.03	22.34	22.54	19.90	34.80	43.61	44.34	62.43	50.04	39.55	55.51	56.32	49.89	49.90	28.57	35.16	30.77	29.30	30.11	30.65	32.77	28.54	25.06	24.36	36.23	39.66
Forecasted Load (GW)	52.5	51.6	51.5	52.2	54.6	58.6	63.6	66.9	68.3	69.2	69.6	69.6	69.4	68.9	68.2	67.6	67.2	66.6	65.9	67.3	68.0	65.5	61.5	58.5		
Forecast Error %	-3.4%	-3.7%	-4.0%	-4.4%	-3.8%	-1.0%	-1.0%	-1.3%	-1.6%	-1.8%	-2.0%	-2.0%	-2.4%	-5.8%	-3.6%	-3.3%	-2.7%	-1.7%	-2.0%	-2.1%	-2.7%	-3.3%	-13.5%			

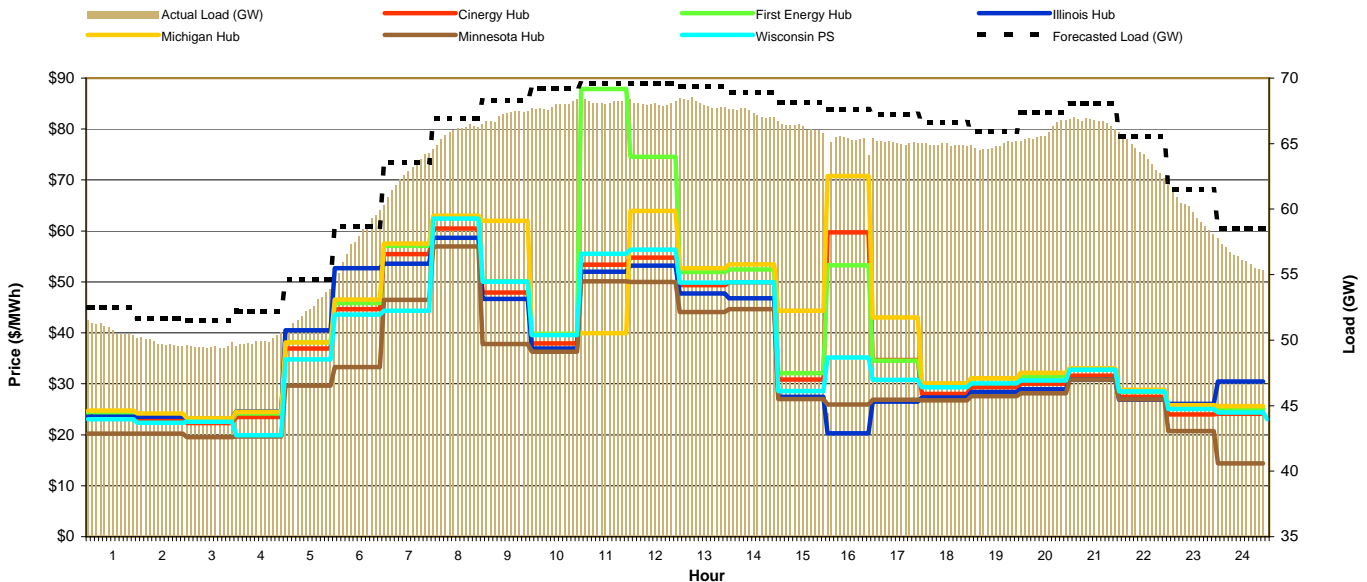




MISO Daily Report

Wednesday May 4, 2011

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
	All	On Pk																										
Cinergy Hub	26.91	26.50	25.55	27.31	30.13	45.47	48.39	48.47	48.88	49.86	49.70	47.98	48.28	46.80	42.21	40.09	39.49	34.83	37.09	46.64	47.43	37.10	28.48	26.55	39.59	43.33		
First Energy Hub	28.72	28.16	27.27	28.75	31.40	47.16	54.26	57.36	57.61	61.49	62.12	55.91	57.16	55.05	51.16	48.56	47.07	41.81	44.78	53.58	53.88	42.41	30.07	27.92	45.57	51.25		
Illinois Hub	25.02	24.49	23.56	23.99	25.37	37.80	52.57	46.36	46.23	51.63	50.67	48.07	46.73	44.45	40.52	35.70	37.71	33.21	35.17	44.44	45.04	35.38	27.22	25.19	37.77	41.78		
Michigan Hub	25.15	24.87	24.22	25.57	28.54	44.90	51.62	48.17	46.77	46.54	46.30	46.98	46.89	46.33	43.15	42.25	38.35	35.66	37.73	45.63	46.99	36.91	28.06	29.25	39.03	42.67		
Minnesota Hub	18.18	16.95	13.71	12.95	16.58	23.03	29.37	37.92	33.83	33.18	31.11	27.29	25.38	23.88	23.16	21.87	22.26	21.35	22.17	26.61	34.07	24.57	18.57	16.59	23.94	26.70		
Wisconsin PS	23.31	22.92	22.24	22.43	24.45	34.59	34.99	44.30	44.10	45.79	45.51	43.45	40.77	39.79	36.83	34.97	34.30	32.32	31.96	41.05	43.94	35.07	27.05	25.64	34.65	38.82		
Cleared Load (GW)	53.2	52.5	52.2	52.9	56.0	62.7	66.1	67.6	68.4	68.9	68.7	68.2	68.1	66.9	66.3	65.8	66.0	65.6	65.6	67.4	68.4	65.0	59.7	5.7				

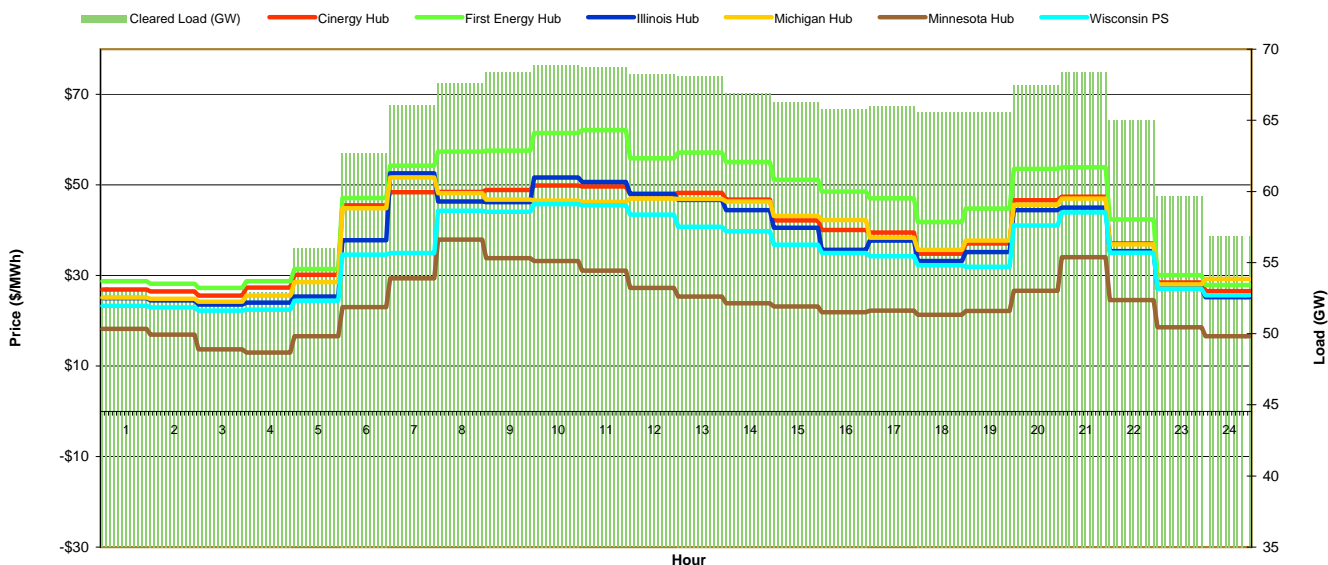

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
	All	On Pk																										
Cinergy Hub	25.90	2.17	19.13	18.98	23.06	29.25	29.53	32.22	30.50	33.03	42.09	26.64	33.33	31.71	27.33	26.25	27.45	25.45	21.78	33.28	32.54	30.45	24.95	26.75	27.24	29.94		
First Energy Hub	29.43	4.89	21.67	22.11	25.26	30.70	32.96	33.84	31.77	34.29	43.40	27.95	34.26	35.25	27.98	27.63	28.35	28.26	24.78	38.11	38.21	36.12	25.42	28.40	29.63	32.23		
Illinois Hub	34.67	12.26	21.28	16.35	21.78	35.79	34.10	32.44	30.53	51.26	71.16	30.71	58.32	55.64	41.53	35.80	41.44	38.42	41.79	62.75	53.91	52.44	57.84	51.47	40.99	47.25		
Michigan Hub	30.69	5.64	22.57	22.99	26.13	31.21	33.02	33.36	31.38	33.95	43.19	27.91	34.19	35.38	28.29	27.93	28.62	28.52	25.06	38.42	38.57	36.71	26.00	29.71	29.98	32.34		
Minnesota Hub	-4.65	-26.82	2.54	7.58	11.33	28.22	24.74	24.41	27.10	29.73	11.67	17.96	9.05	11.09	5.95	17.21	14.20	17.60	8.02	14.47	21.75	10.96	7.83	-17.93	11.42	15.56		
Wisconsin PS	9.82	-14.57	9.61	10.85	15.95	29.55	32.05	31.64	31.74	35.39	43.01	28.03	34.49	35.75	28.50	28.20	28.60	28.31	24.21	37.76	38.13	36.40	26.07	10.03	25.81	32.26		
Forecasted Load (GW)	55.6	54.3	53.8	54.3	56.6	61.1	64.7	67.8	68.8	69.3	69.3	69.1	68.8	68.3	67.4	66.6	65.9	65.1	64.6	65.8	67.2	65.2	61.5	58.7				
Forecast Error %	-2.8%	-2.9%	-3.0%	-2.9%	-2.8%	-1.1%	0.7%	-0.2%	-0.8%	-1.2%	-1.1%	-1.4%	-1.6%	-1.8%	-1.9%	-1.8%	-1.4%	-0.9%	-0.1%	-0.6%	-0.4%	-1.2%	-2.0%	-3.1%				

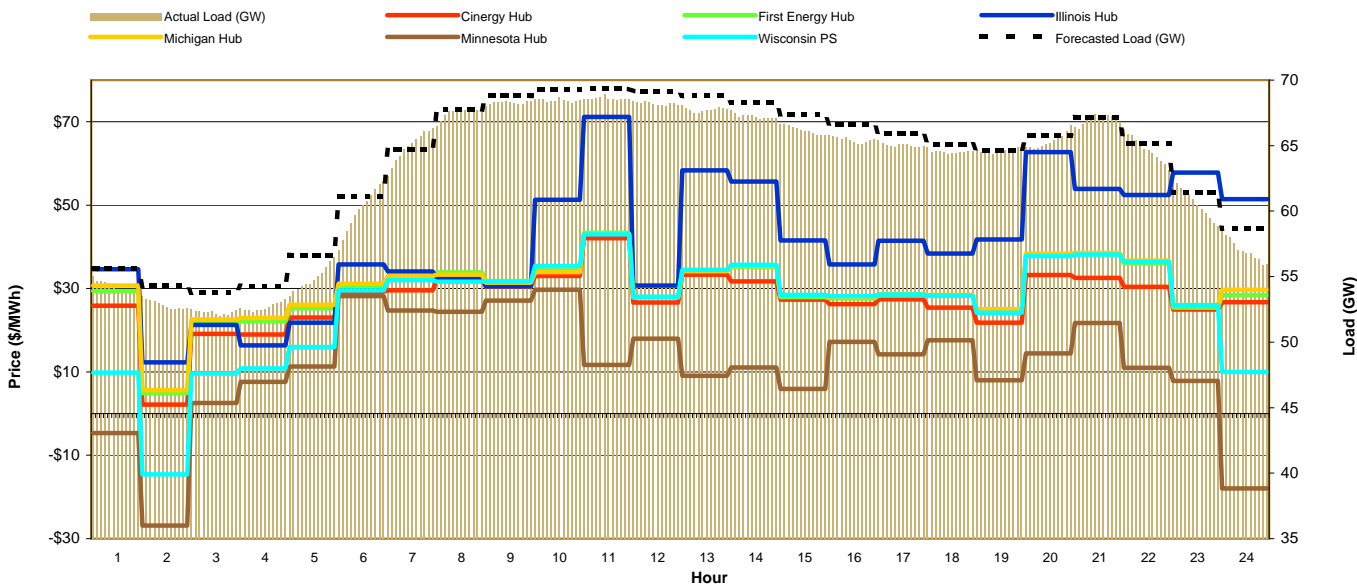




MISO Daily Report

Thursday May 5, 2011

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	24.03	22.47	22.09	23.69	25.39	43.52	47.25	47.57	46.04	45.62	43.65	43.79	46.49	44.82	42.55	42.99	40.41	37.02	36.43	45.11	46.43	32.45	28.88	25.63	37.68	41.89
First Energy Hub	25.49	23.92	23.59	25.35	27.17	43.62	47.90	50.32	49.70	49.69	47.83	46.77	47.49	45.24	42.23	41.83	39.72	37.15	36.70	46.00	50.37	32.80	29.43	26.84	39.05	43.33
Illinois Hub	24.86	24.38	23.13	22.51	23.92	33.26	39.39	39.64	42.16	43.60	42.08	42.13	39.21	42.34	39.52	35.54	35.89	35.10	34.69	43.12	44.58	34.58	26.58	23.77	34.83	38.80
Michigan Hub	23.97	22.31	21.88	23.77	25.64	43.91	46.53	46.53	46.51	46.46	45.07	45.56	46.70	46.83	45.49	44.06	41.74	38.71	38.07	46.87	46.51	33.92	30.96	28.94	38.62	43.12
Minnesota Hub	7.64	5.83	5.95	5.88	7.60	17.27	24.75	29.70	32.42	33.26	35.60	37.21	32.49	32.98	29.68	25.73	25.43	25.98	25.83	34.57	41.51	28.07	22.35	20.07	24.49	30.80
Wisconsin PS	18.92	17.46	16.60	17.17	19.86	29.15	40.49	42.52	44.85	43.99	44.20	44.21	40.59	40.93	41.05	34.24	35.00	35.42	35.25	45.14	47.05	32.95	28.47	25.03	34.19	39.74
Cleared Load (GW)	54.7	53.9	53.1	54.4	57.1	63.6	67.1	68.6	68.6	68.4	67.6	67.3	67.6	66.5	65.6	64.8	64.2	63.8	64.0	66.7	67.7	63.4	58.6	5.5		

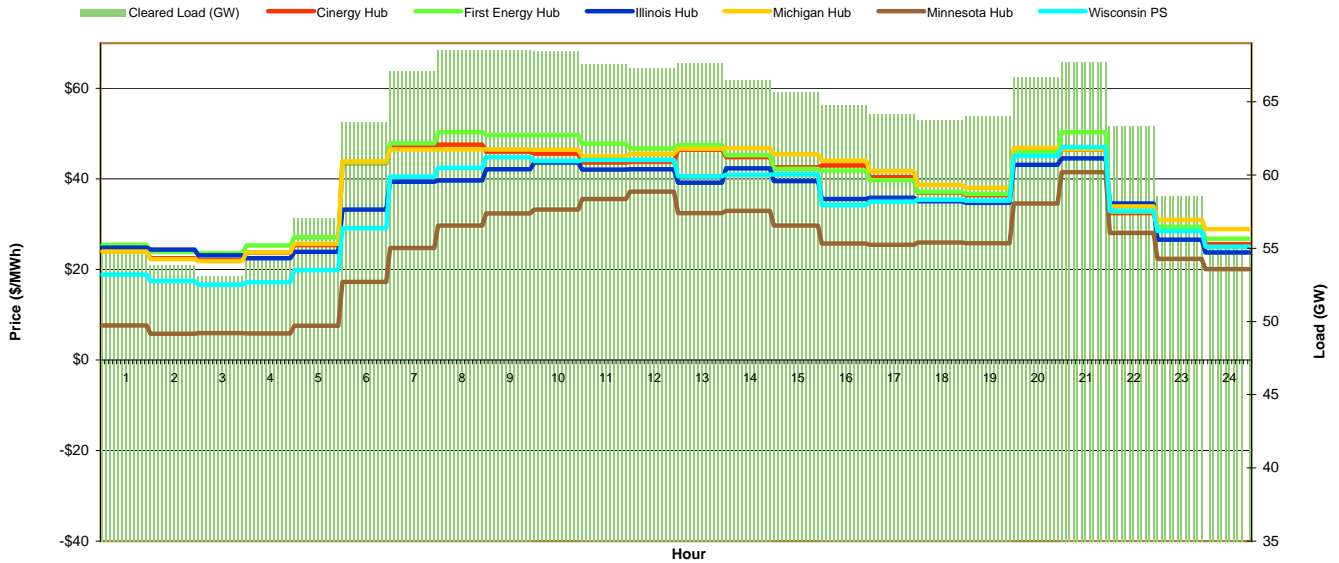

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	5.33	-25.42	17.94	6.48	13.66	62.06	25.49	26.61	34.55	24.50	25.14	24.95	31.56	24.66	28.57	25.07	24.09	25.48	24.25	27.58	28.77	27.25	23.81	22.55	23.12	26.68
First Energy Hub	5.69	-25.62	18.71	7.60	14.59	66.26	26.11	27.48	37.13	25.29	26.43	26.26	33.83	25.41	31.43	25.77	26.74	27.71	25.99	28.55	29.55	28.00	24.49	23.21	24.44	28.13
Illinois Hub	12.74	-26.54	9.90	-9.18	18.85	28.89	20.90	25.81	24.38	24.42	24.73	24.63	34.42	27.03	26.61	27.19	27.17	30.78	24.66	27.27	28.19	26.73	23.27	21.98	21.03	26.71
Michigan Hub	5.98	-25.89	19.69	9.22	15.82	69.53	26.53	27.76	38.20	25.69	26.84	26.65	34.57	25.93	32.50	26.43	27.42	28.25	26.42	28.85	29.84	28.42	25.11	23.73	25.15	28.68
Minnesota Hub	-13.52	-35.81	-5.05	-30.27	-26.21	10.19	19.46	25.09	20.63	22.73	24.25	23.74	17.32	20.95	21.28	21.36	19.57	18.36	23.63	25.86	27.75	26.87	23.10	21.33	12.61	22.66
Wisconsin PS	-1.16	-35.84	3.08	-27.29	-10.88	13.68	23.01	27.81	22.07	25.62	26.73	26.40	25.43	25.59	24.43	25.75	26.76	27.83	26.11	28.54	29.89	28.55	24.71	23.23	17.08	26.39
Forecasted Load (GW)	56.2	55.1	54.7	55.2	57.5	61.7	65.3	67.8	68.5	68.5	68.2	67.9	67.5	66.8	65.9	65.0	64.3	63.7	63.3	64.9	66.3	64.1	60.2	57.3		
Forecast Error %	-2.6%	-2.7%	-2.7%	-2.6%	-2.4%	-0.5%	0.7%	0.2%	-0.3%	0.0%	0.2%	-0.2%	-0.1%	-0.2%	-0.3%	-0.2%	-0.1%	0.1%	-0.1%	-1.2%	0.2%	0.3%	-0.6%	-1.4%		

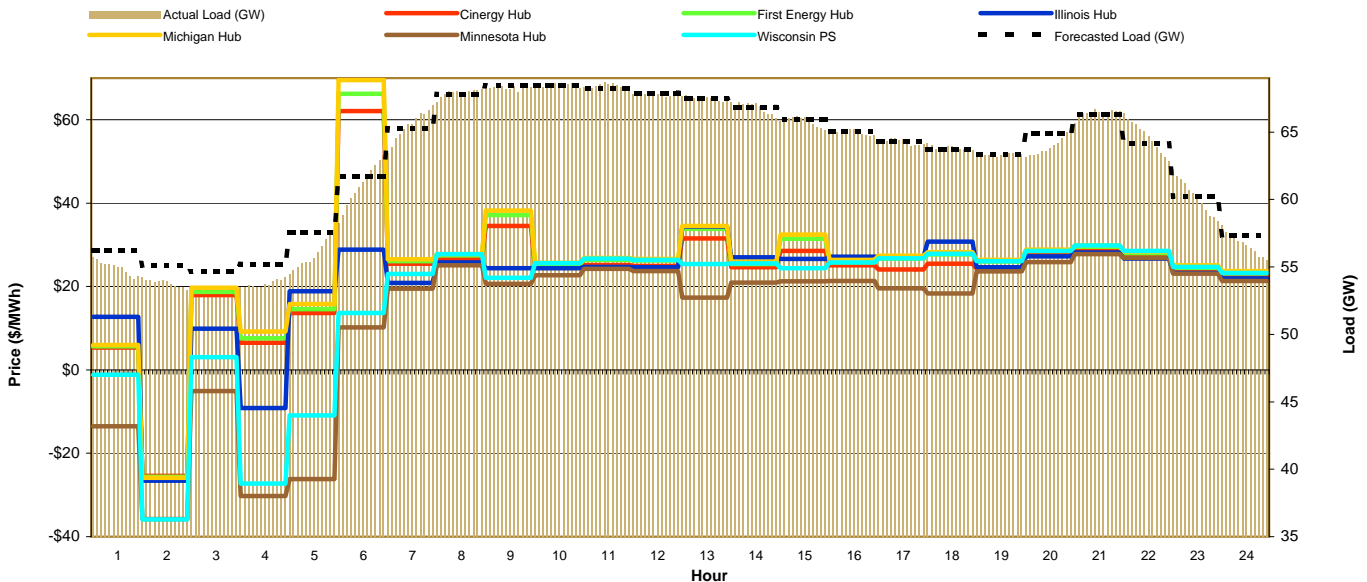




MISO Daily Report

Friday May 6, 2011

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
																									All	On Pk		
Cinergy Hub	20.96	16.97	16.83	19.01	23.98	35.00	33.51	35.77	35.26	36.98	36.62	35.87	38.76	34.53	35.42	30.86	30.68	29.61	29.25	31.43	34.94	28.79	26.68	24.99	30.11	33.22		
First Energy Hub	22.03	17.51	17.38	19.64	24.52	36.01	35.05	37.47	37.08	38.79	38.41	37.50	40.54	36.05	36.87	32.17	32.01	30.89	30.54	33.74	36.61	30.10	27.39	25.64	31.41	34.76		
Illinois Hub	19.12	17.13	16.93	17.42	19.97	32.35	34.08	34.68	34.39	39.68	38.64	38.87	44.25	40.10	37.25	33.45	33.57	31.68	32.23	36.97	40.95	33.75	28.98	25.95	31.77	36.22		
Michigan Hub	20.59	17.47	17.35	20.05	25.97	36.10	37.15	40.46	40.66	41.68	41.45	40.89	42.70	40.01	40.47	32.49	32.23	30.86	30.55	32.69	36.74	30.20	27.31	25.72	32.57	36.34		
Minnesota Hub	15.63	14.48	14.25	13.36	15.26	21.87	29.32	36.67	40.17	38.82	38.18	33.91	32.73	30.88	27.52	24.13	22.99	22.93	23.01	26.55	29.59	22.71	18.00	13.41	25.27	29.30		
Wisconsin PS	17.70	15.12	14.84	15.12	17.95	27.96	32.25	37.37	38.50	39.60	38.94	36.91	39.12	35.46	33.44	29.70	29.26	28.35	28.54	32.24	35.81	30.53	24.88	20.63	29.17	33.66		
Cleared Load (GW)	51.7	50.9	50.5	51.1	53.9	61.1	65.3	67.3	67.2	67.6	68.2	67.7	67.7	67.0	65.7	65.0	64.6	64.1	64.1	66.0	67.2	63.6	59.4	5.5				

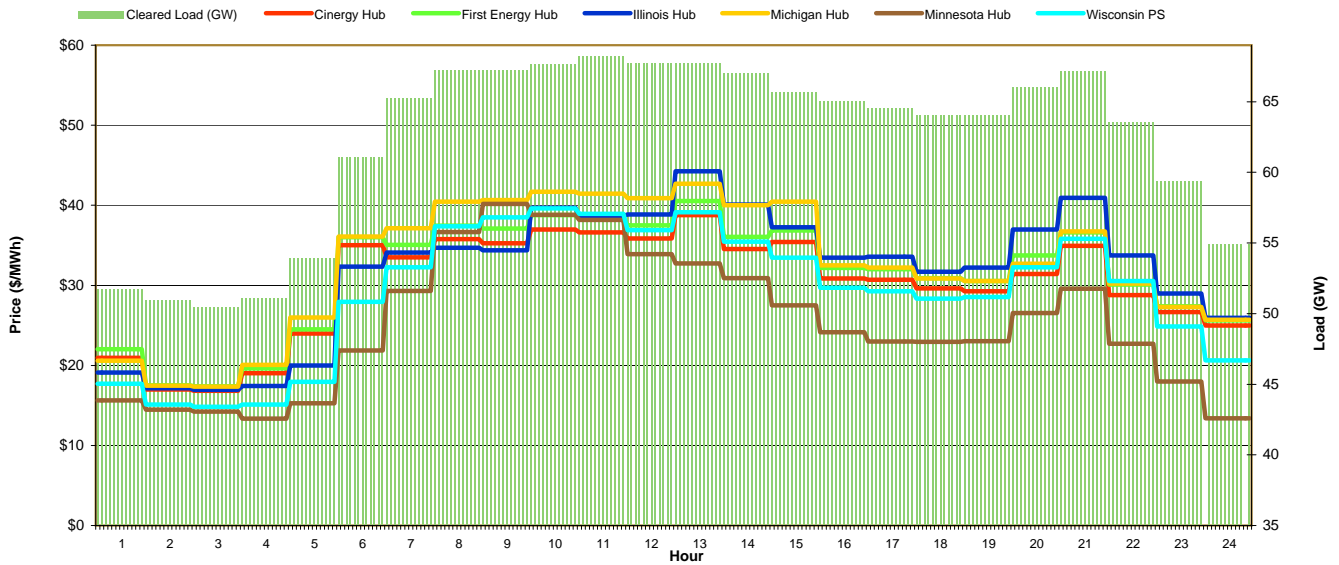

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
																									All	On Pk		
Cinergy Hub	21.44	16.99	18.26	20.68	31.55	29.68	38.57	29.29	28.73	30.33	29.60	28.92	38.14	28.51	32.75	26.69	28.13	25.97	25.22	28.36	32.81	27.66	23.16	20.29	27.57	29.02		
First Energy Hub	22.05	17.45	18.75	21.28	34.77	32.96	39.62	30.31	29.84	31.57	30.80	30.01	39.58	29.61	33.96	27.66	29.16	26.97	26.16	29.35	33.86	28.50	23.83	20.82	28.70	30.07		
Illinois Hub	26.35	16.56	22.05	26.01	21.37	16.64	48.78	34.12	28.19	31.59	31.25	32.84	54.25	32.84	42.51	31.69	35.15	25.68	32.73	38.19	46.65	40.59	35.29	38.22	32.90	35.85		
Michigan Hub	22.35	17.65	18.90	21.49	36.04	34.23	40.15	30.71	30.10	31.71	30.80	30.09	44.18	29.83	34.44	28.05	29.50	27.21	26.39	29.55	34.21	28.87	24.17	21.05	29.24	30.61		
Minnesota Hub	15.86	15.86	13.61	12.82	10.78	12.85	26.98	23.36	27.52	27.23	26.26	24.02	23.37	23.69	23.89	20.76	20.65	23.86	17.39	21.55	21.82	15.65	12.00	4.89	19.44	22.06		
Wisconsin PS	22.07	17.53	18.80	20.06	13.98	13.20	40.05	30.83	30.51	31.96	31.21	30.44	39.84	29.91	34.21	27.77	29.31	26.99	26.15	29.58	34.35	28.97	24.02	20.94	27.19	30.38		
Forecasted Load (GW)	55.5	54.3	53.9	54.5	56.7	61.0	65.1	67.2	67.9	68.2	68.3	68.2	67.8	67.3	66.4	65.5	64.7	63.8	63.5	64.7	66.1	63.5	59.8	57.0				
Forecast Error %	-2.2%	-2.2%	-2.3%	-2.4%	-1.9%	-0.8%	-0.5%	-0.1%	-0.7%	-0.7%	-0.8%	-1.4%	-1.2%	-1.2%	-1.1%	-1.0%	-1.0%	-1.0%	-0.8%	-1.1%	-0.6%	-0.6%	-2.1%	-3.7%				

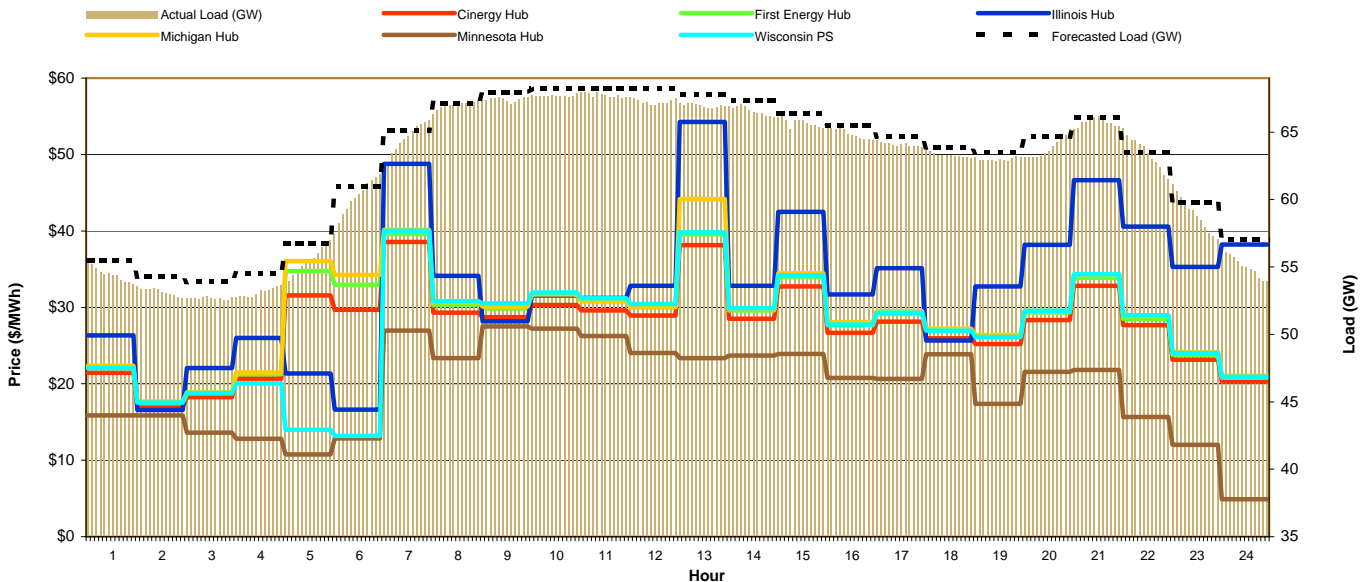




MISO Daily Report

Saturday May 7, 2011

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	24.05	22.96	22.37	22.66	22.64	22.80	24.75	33.00	37.26	35.57	36.53	33.62	31.45	30.58	30.06	29.63	29.89	29.76	28.85	32.48	37.18	29.80	23.63	22.11	28.90	31.83
First Energy Hub	25.46	24.47	23.84	24.13	23.73	23.67	27.88	37.74	40.92	38.01	41.07	35.92	32.66	31.75	31.27	30.78	31.09	31.07	29.99	36.38	39.21	30.78	25.04	23.25	30.84	33.98
Illinois Hub	24.62	23.03	22.82	22.98	23.09	24.40	26.14	31.84	37.79	37.15	38.23	35.49	32.93	31.59	31.23	31.35	31.53	31.70	30.42	33.45	38.39	33.01	25.13	23.16	30.06	33.20
Michigan Hub	23.15	21.31	21.00	21.26	22.00	25.04	23.74	31.02	37.91	37.39	36.69	34.75	32.34	31.63	31.05	30.48	30.78	30.46	29.74	32.16	37.33	31.15	22.76	21.76	29.04	32.35
Minnesota Hub	13.27	11.29	9.45	8.27	10.09	13.92	18.84	22.36	29.77	31.33	33.56	29.56	25.63	25.61	24.85	24.67	25.80	25.81	23.84	30.35	34.45	26.12	20.43	17.72	22.37	27.13
Wisconsin PS	17.44	15.34	14.64	14.87	15.03	20.99	23.52	29.52	35.61	36.02	37.78	34.16	30.82	30.13	29.48	29.57	30.25	30.28	29.61	33.70	38.44	30.89	23.61	21.34	27.21	31.86
Cleared Load (GW)	47.9	47.9	47.8	48.0	51.0	60.1	64.3	65.8	66.5	66.9	66.9	66.8	66.2	66.0	64.7	64.1	63.2	62.0	61.1	63.2	64.7	59.7	54.3	5.0		

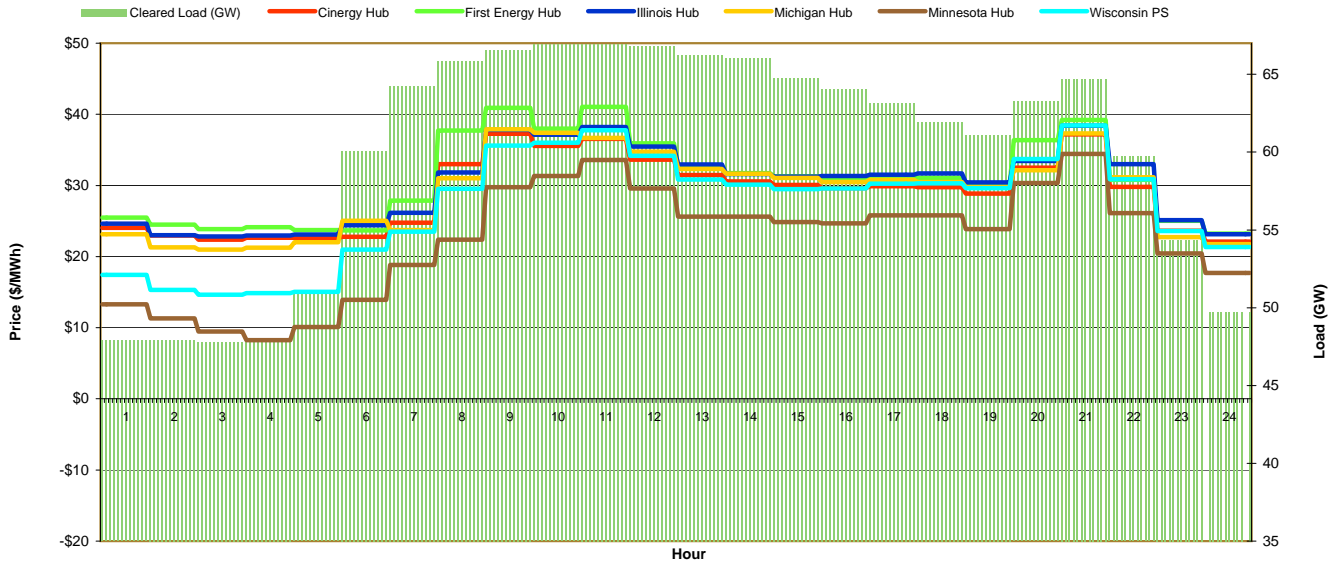

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	21.08	21.25	22.23	21.61	20.78	18.44	22.32	30.84	25.21	28.17	27.81	28.85	30.89	28.89	29.54	37.38	40.34	33.18	31.52	28.18	43.42	24.31	20.01	4.80	26.71	30.53
First Energy Hub	21.61	21.75	22.84	22.27	21.42	19.04	23.11	31.84	26.12	29.25	28.96	29.98	32.10	30.00	30.73	38.82	41.91	34.50	32.81	29.45	45.05	25.23	20.67	4.85	27.68	31.71
Illinois Hub	36.50	43.17	34.92	24.31	27.10	17.86	21.49	29.23	24.38	27.29	27.00	28.12	30.18	28.27	28.94	36.61	39.46	32.39	30.68	27.39	42.45	23.82	32.31	28.61	30.10	30.53
Michigan Hub	21.83	21.96	23.05	22.42	21.50	19.00	23.13	32.03	26.22	29.33	29.03	30.06	32.20	30.21	30.90	39.05	42.23	34.72	32.97	35.66	45.47	25.47	20.82	4.89	28.09	32.27
Minnesota Hub	7.18	2.04	7.36	15.58	13.31	16.77	20.18	28.14	23.61	26.34	26.25	27.18	29.04	27.38	28.03	35.29	38.07	31.48	29.80	26.75	41.25	23.06	8.93	-13.24	21.66	28.16
Wisconsin PS	21.52	21.46	14.14	16.01	21.10	18.83	21.93	28.24	26.06	29.22	28.93	30.06	32.08	29.90	30.49	38.48	41.44	34.05	32.17	28.67	44.62	25.10	20.54	4.81	26.66	31.25
Forecasted Load (GW)	54.3	53.1	52.6	53.0	55.1	59.1	63.4	65.1	66.1	66.7	66.7	66.5	66.2	65.6	65.0	64.1	63.2	62.2	61.4	61.6	62.8	60.8	56.9	54.1		
Forecast Error %	-3.1%	-3.5%	-3.4%	-3.8%	-3.3%	-1.8%	-1.8%	0.0%	-0.1%	-0.3%	-0.2%	0.0%	0.3%	-0.5%	-0.7%	-0.9%	-1.1%	-1.0%	-0.9%	0.3%	0.4%	0.4%	-1.2%			

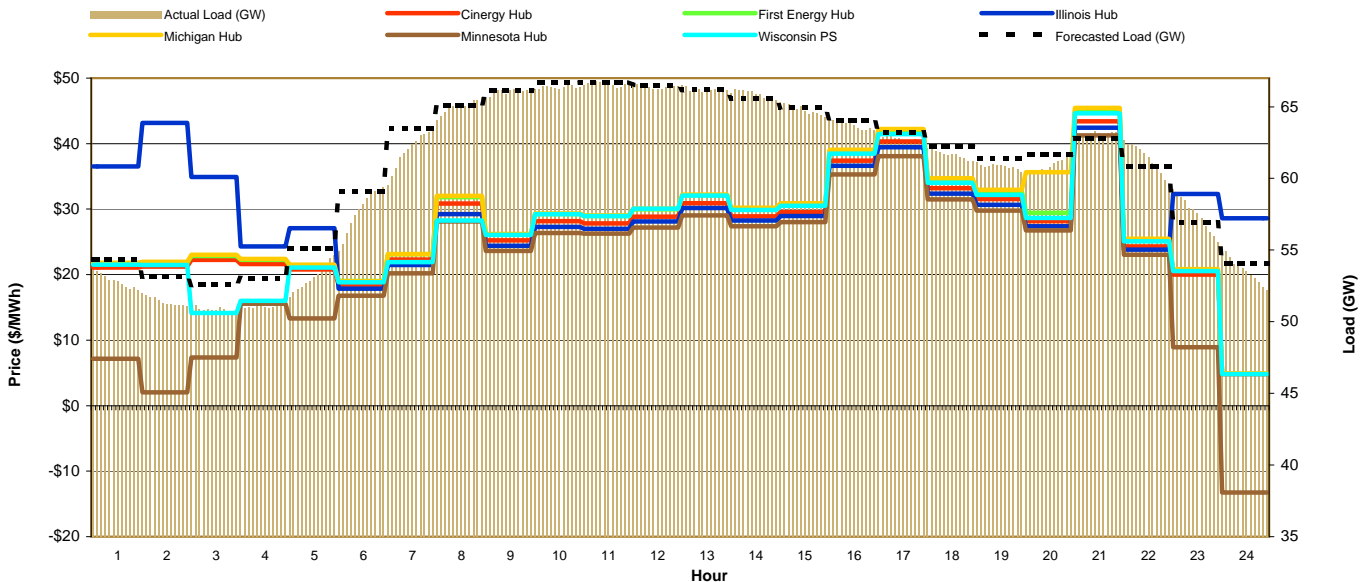




MISO Daily Report

Sunday May 8, 2011

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	20.34	19.75	18.72	19.33	18.67	19.91	22.69	23.94	25.81	27.47	29.03	29.69	30.12	29.70	30.11	30.42	30.40	30.27	30.78	34.63	38.70	30.62	24.27	22.45	26.58	29.75
First Energy Hub	22.70	22.17	20.95	21.77	21.06	22.38	24.09	25.83	27.54	28.97	30.03	31.11	31.14	31.11	31.10	31.36	31.45	31.14	31.62	35.98	39.66	31.39	25.06	23.37	28.04	30.91
Illinois Hub	23.13	23.27	23.70	22.39	23.62	22.69	23.61	24.90	28.22	31.19	32.87	33.85	35.76	34.87	33.55	33.83	33.80	34.27	35.68	39.54	46.91	35.90	32.29	28.68	30.77	34.21
Michigan Hub	17.63	17.00	16.31	16.42	15.71	17.11	22.69	23.82	26.01	27.91	29.60	30.08	30.70	30.04	30.45	30.73	30.53	31.12	31.76	34.38	40.29	31.92	23.82	21.59	26.15	30.20
Minnesota Hub	15.00	12.00	9.78	6.74	5.42	8.36	13.69	17.20	20.46	20.26	20.36	20.40	19.27	17.23	15.14	14.99	15.02	17.07	16.16	16.86	20.01	16.09	7.45	4.75	14.57	17.12
Wisconsin PS	19.53	17.64	16.57	14.81	15.78	20.04	21.24	22.48	25.57	27.03	27.83	28.31	28.75	28.00	26.94	27.05	27.02	28.03	28.40	30.88	35.91	28.75	21.69	18.07	24.43	27.66
Cleared Load (GW)	47.5	46.4	46.0	46.1	46.7	48.9	51.8	56.1	58.8	59.5	59.9	59.1	58.2	57.4	56.8	56.7	56.8	56.5	55.7	58.1	60.1	56.6	51.6	4.8		

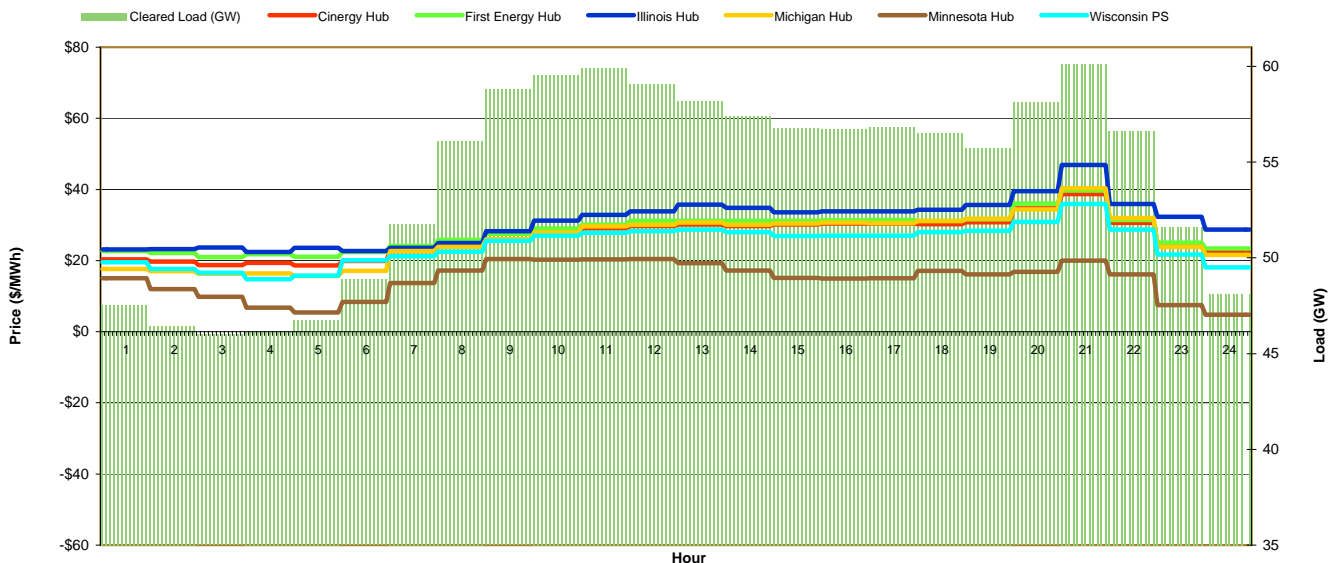

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	-56.36	5.98	-9.18	-8.55	-9.51	2.34	17.79	16.80	24.26	25.28	22.21	19.78	22.27	24.32	26.82	23.80	21.41	14.87	29.47	23.66	27.98	23.06	0.84	16.05	12.72	21.68
First Energy Hub	-58.25	5.93	-9.56	-8.93	-9.87	2.20	18.01	17.30	25.02	26.19	23.08	20.54	23.00	23.60	27.16	24.42	21.94	14.80	30.04	24.29	28.81	23.69	0.60	16.36	12.93	22.16
Illinois Hub	-55.00	50.92	9.71	16.97	12.21	42.30	79.23	19.62	31.66	35.25	32.44	20.88	33.18	31.60	23.69	32.65	22.80	19.42	28.56	22.55	27.24	22.48	0.05	15.45	23.99	25.25
Michigan Hub	-58.33	5.96	-9.60	-8.93	-9.86	2.24	18.01	17.28	24.99	26.12	23.01	20.50	22.99	21.39	26.38	24.41	21.94	14.02	29.70	24.28	29.15	24.02	0.28	16.42	12.77	21.90
Minnesota Hub	-52.99	-28.13	-22.04	-26.08	-24.12	-27.96	-30.88	12.44	15.77	14.95	24.11	16.96	5.22	-49.48	-6.81	2.41	-1.19	-28.36	12.11	6.60	13.88	10.25	-29.35	-6.74	-8.31	1.22
Wisconsin PS	-58.06	5.96	-9.36	-8.68	-9.52	2.33	17.84	17.16	25.08	26.06	23.98	20.33	22.90	-7.98	16.06	23.52	21.23	4.15	24.08	22.59	29.30	23.94	-3.28	15.27	10.20	18.07
Forecasted Load (GW)	52.2	50.6	49.7	49.5	49.8	51.1	52.1	54.6	56.2	57.8	58.3	58.2	57.8	57.2	56.8	56.7	56.7	56.5	56.4	56.9	58.4	57.0	53.9	52.0		
Forecast Error %	-3.2%	-3.4%	-3.2%	-3.1%	-2.2%	-2.3%	-1.2%	-0.4%	1.3%	1.1%	0.5%	0.3%	-0.1%	-0.2%	0.0%	0.2%	0.4%	0.6%	0.5%	0.9%	0.9%	0.4%	0.4%	-2.2%		

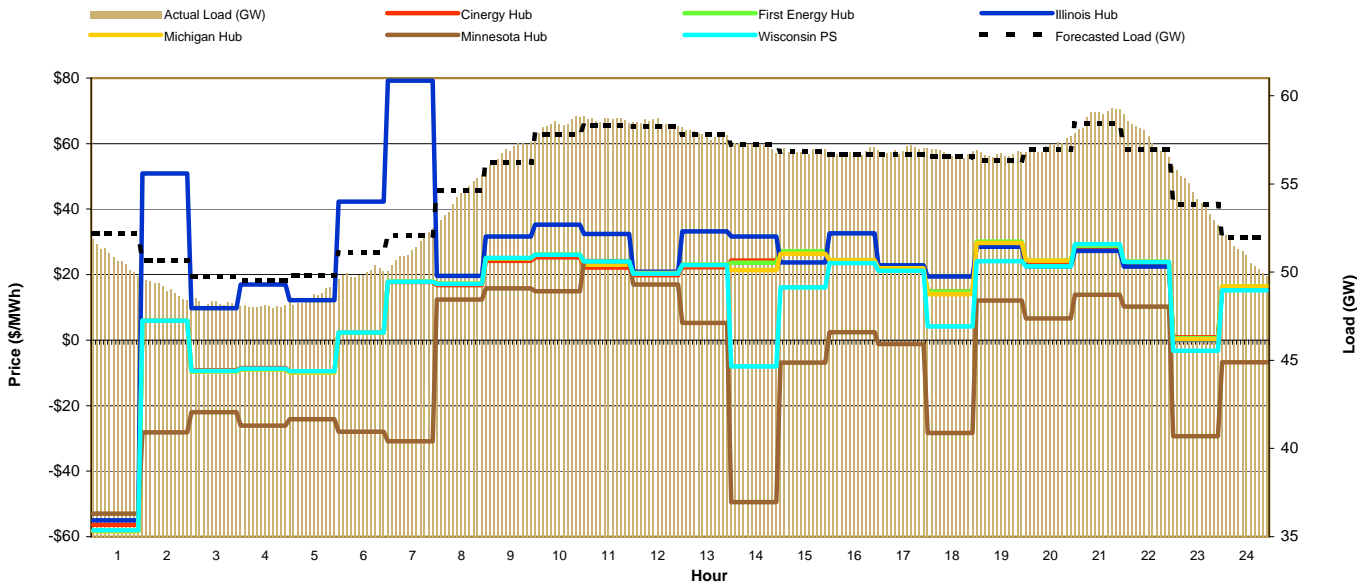




MISO Daily Report

Monday May 9, 2011

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
																									All	On Pk		
Cinergy Hub	18.71	17.59	17.35	18.67	22.37	30.88	30.49	34.92	36.36	41.78	42.20	43.27	45.25	42.99	42.43	41.32	41.49	41.84	38.79	41.84	41.86	31.70	25.08	22.35	33.81	39.57		
First Energy Hub	18.60	17.48	17.23	18.62	22.35	30.82	31.23	35.57	33.98	42.06	43.02	44.13	47.04	44.72	44.37	42.76	43.06	43.37	40.23	43.31	43.39	32.51	26.19	23.40	34.56	40.61		
Illinois Hub	28.11	27.15	26.97	27.55	30.12	40.02	43.74	44.13	41.05	49.85	50.83	51.72	55.83	54.52	55.33	50.75	51.55	53.37	48.93	52.03	53.37	40.34	33.49	26.68	43.23	49.19		
Michigan Hub	20.72	19.70	19.45	20.94	24.85	34.43	32.41	37.35	44.87	44.80	44.59	45.44	47.13	44.81	44.21	44.80	44.58	44.79	41.68	44.62	44.80	34.33	29.35	26.63	36.72	42.63		
Minnesota Hub	-0.94	-2.36	-2.58	-2.51	-0.88	4.59	18.14	21.60	23.77	23.49	24.95	24.59	24.68	23.93	23.65	23.19	22.70	23.46	22.19	23.15	26.22	21.18	15.07	7.16	16.19	22.99		
Wisconsin PS	12.46	11.00	10.84	10.68	13.42	22.83	33.25	33.91	34.70	39.23	39.80	40.48	42.39	40.05	39.21	38.79	39.17	39.92	37.03	39.25	40.18	31.08	24.43	21.20	30.63	37.47		
Cleared Load (GW)	45.3	44.6	44.2	44.4	45.2	46.3	48.6	51.4	54.1	55.0	55.3	55.8	55.7	55.5	55.4	56.0	56.6	57.2	57.5	58.4	61.7	58.0	53.2	5.0				

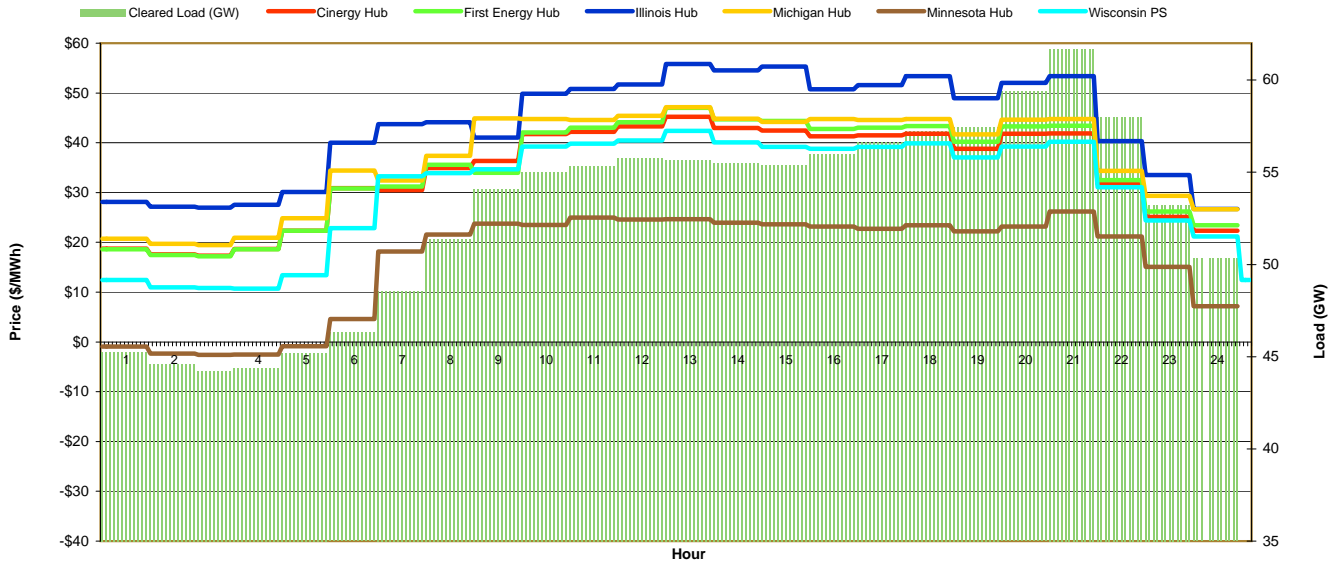

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
																									All	On Pk		
Cinergy Hub	9.66	17.57	12.56	5.42	16.11	26.07	21.29	25.48	25.95	26.60	27.29	29.04	24.77	26.95	31.30	24.64	26.36	38.58	24.29	44.48	26.50	22.67	22.84	21.33	24.07	27.98		
First Energy Hub	11.22	17.97	12.60	5.76	16.57	26.93	22.04	26.20	26.97	27.66	28.38	30.29	28.06	27.93	32.47	25.47	27.05	39.71	26.67	46.00	27.78	23.45	23.40	30.93	25.48	29.22		
Illinois Hub	4.06	16.28	9.63	-0.15	15.28	22.16	20.32	23.14	25.25	25.92	26.66	28.43	25.65	26.30	30.58	24.06	25.27	37.61	24.17	30.63	26.11	22.38	22.04	-1.41	21.27	26.51		
Michigan Hub	14.59	17.96	11.72	6.10	16.53	27.19	22.08	26.47	27.43	28.10	28.46	30.11	27.87	27.79	32.37	25.52	27.11	39.88	26.91	46.39	28.03	23.63	23.74	56.21	26.77	29.38		
Minnesota Hub	-39.07	10.22	-10.18	-0.37	10.57	2.81	18.16	23.61	25.38	20.58	14.04	30.23	25.75	13.17	20.87	13.76	18.43	13.83	16.56	27.99	18.46	17.19	16.98	-3.42	12.73	19.80		
Wisconsin PS	-11.78	14.70	1.11	-1.36	15.29	22.46	21.09	25.88	27.33	27.96	28.94	31.71	28.31	28.43	33.77	25.94	26.60	39.97	26.82	46.29	28.20	25.77	22.63	7.83	22.66	29.66		
Forecasted Load (GW)	49.3	47.7	46.9	46.7	47.0	47.7	48.6	50.5	52.9	54.0	55.0	55.5	55.7	55.7	55.7	56.2	56.9	57.3	57.6	58.7	60.9	59.0	55.2	52.9				
Forecast Error %	-19.5%	-2.1%	-2.4%	-2.8%	-2.7%	-3.1%	-3.4%	-0.8%	0.1%	0.8%	0.2%	-0.3%	-1.2%	-1.6%	-2.0%	-2.0%	-2.3%	-2.1%	-1.9%	-1.7%	-0.6%	0.3%	0.1%	-11.3%				

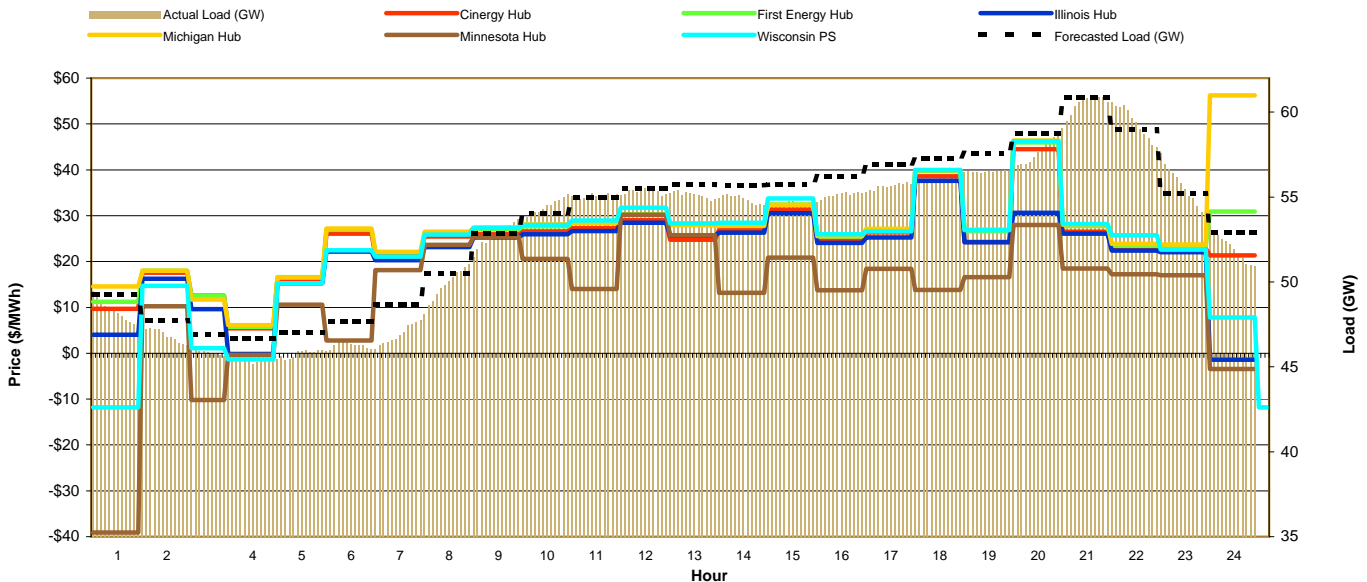




MISO Daily Report

Tuesday May 10, 2011

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	20.20	18.90	18.32	18.74	21.63	29.00	34.11	35.28	34.00	42.85	43.25	44.00	45.44	45.06	46.90	48.29	46.97	42.20	42.45	42.90	45.58	32.56	29.55	26.15	35.60	41.71
First Energy Hub	21.49	19.24	18.57	19.08	22.58	29.37	34.98	36.19	34.83	43.58	43.95	44.89	46.27	46.18	47.90	49.10	48.38	43.41	43.71	44.03	47.20	33.77	30.25	27.22	36.51	42.73
Illinois Hub	21.66	20.14	19.55	19.88	21.60	26.86	40.67	40.85	38.96	49.78	48.76	47.49	48.84	47.33	49.35	50.54	51.64	40.37	40.57	41.06	43.99	31.41	31.19	26.94	37.48	43.88
Michigan Hub	21.92	18.67	18.21	18.59	22.56	31.03	35.42	36.64	35.28	44.10	44.43	45.62	47.04	46.18	47.93	49.44	48.04	44.12	44.11	44.49	47.19	33.58	30.26	29.16	36.83	43.03
Minnesota Hub	5.72	4.98	4.43	5.29	6.02	14.16	23.77	26.67	27.98	30.97	31.28	31.20	30.84	30.70	31.14	32.21	38.49	36.10	35.14	38.27	49.72	32.33	23.46	20.04	25.45	32.91
Wisconsin PS	14.27	13.23	12.66	12.96	14.86	25.22	33.71	35.19	34.03	40.23	39.95	39.86	40.13	39.54	40.34	41.39	41.23	40.19	40.75	42.54	47.88	33.95	29.36	24.82	32.43	39.16
Cleared Load (GW)	46.4	46.3	46.1	46.6	48.6	55.6	62.3	65.6	67.2	68.5	69.7	70.5	70.9	70.7	70.4	70.3	69.7	68.6	67.5	68.8	70.7	65.8	60.0	5.5		

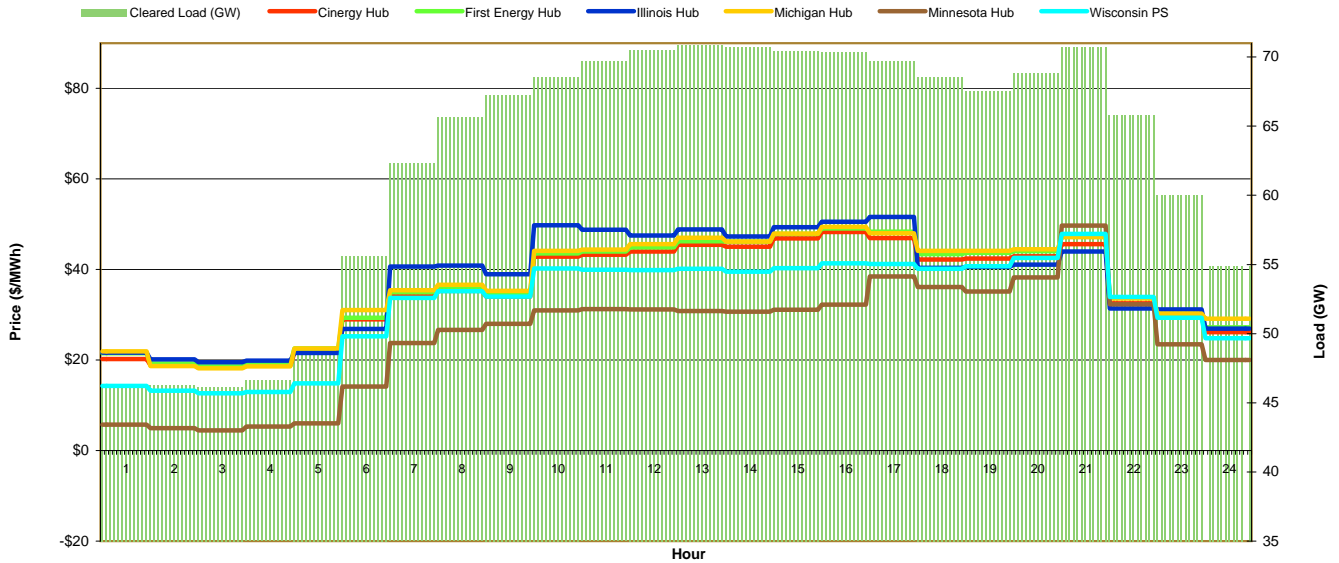

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	21.83	24.88	20.73	21.66	29.02	24.23	24.41	26.76	28.15	29.50	37.00	57.47	33.96	32.08	33.71	33.95	78.35	52.66	59.11	39.98	37.55	30.41	26.26	25.14	34.53	39.81
First Energy Hub	18.34	30.89	16.97	20.19	38.16	21.78	23.69	27.61	28.94	30.95	39.80	58.70	34.63	32.88	34.22	34.39	79.29	53.18	59.69	40.52	38.01	30.78	26.70	26.16	35.27	40.64
Illinois Hub	-14.27	-11.28	-17.95	1.92	7.59	-3.44	10.51	26.48	27.91	29.48	37.49	57.12	33.96	32.40	33.99	34.22	79.12	53.25	59.79	40.30	37.91	30.82	26.08	25.08	26.60	40.02
Michigan Hub	18.48	51.38	17.04	20.28	66.67	22.12	24.17	28.24	29.54	31.41	40.02	58.48	36.26	33.80	34.40	33.52	77.65	53.06	59.91	40.64	37.95	31.05	27.10	26.60	37.49	40.81
Minnesota Hub	14.72	7.97	12.73	15.65	8.57	18.60	21.09	21.37	27.40	28.79	34.85	58.16	27.56	27.01	26.48	34.08	81.70	55.94	47.22	43.25	40.26	32.46	24.54	23.78	30.59	38.19
Wisconsin PS	17.41	13.40	15.63	18.77	20.79	21.69	23.71	28.06	29.43	31.47	41.01	61.14	25.50	28.28	33.40	36.13	83.32	56.17	62.95	42.57	40.04	32.54	26.66	26.43	34.02	41.17
Forecasted Load (GW)	50.8	49.8	49.5	50.1	52.4	56.5	60.8	64.2	66.2	67.6	68.5	69.0	69.4	69.8	69.2	68.8	68.5	67.9	67.3	67.6	68.6	65.6	61.2	57.7		
Forecast Error %	-1.7%	-2.0%	-2.6%	-3.0%	-2.6%	-1.0%	0.4%	0.7%	0.9%	1.1%	0.9%	1.0%	0.6%	0.4%	0.5%	0.7%	0.8%	1.6%	1.3%	2.0%	2.2%	1.2%	-0.6%			

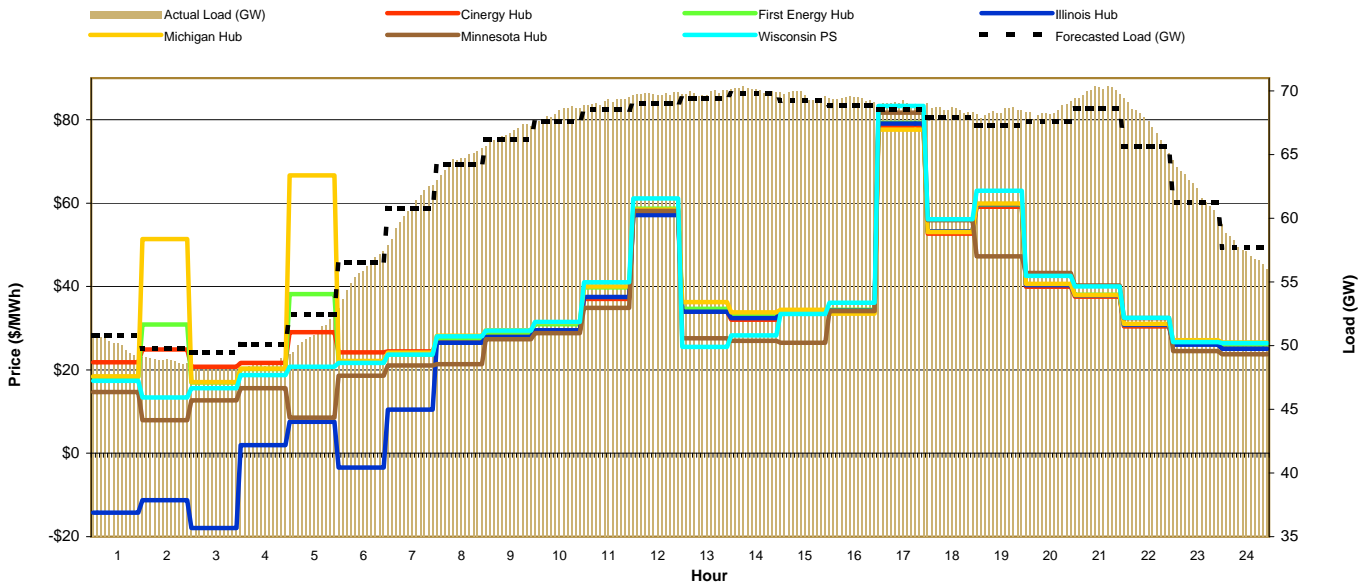




MISO Daily Report

Wednesday May 11, 2011

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	24.68	23.58	22.87	22.74	24.64	30.20	35.49	39.08	39.41	44.20	46.35	47.26	48.06	50.77	54.11	55.44	51.54	45.55	42.67	44.79	44.20	34.15	29.74	26.69	38.68	44.83
First Energy Hub	25.86	25.03	24.32	24.59	26.63	30.96	35.63	39.26	39.83	44.96	47.50	51.13	52.09	54.60	57.64	58.72	53.90	47.72	44.40	46.34	45.58	35.69	30.43	27.45	40.43	46.86
Illinois Hub	19.15	17.25	16.38	15.36	18.74	23.71	30.00	31.65	33.43	39.48	43.17	44.07	44.59	46.85	50.01	49.82	46.75	41.07	39.16	38.53	40.06	31.43	30.76	26.65	34.09	40.68
Michigan Hub	24.84	24.01	23.69	24.69	28.38	31.17	35.61	40.44	40.91	47.06	49.59	48.87	48.91	51.41	55.19	56.49	52.91	46.78	43.49	45.49	45.33	34.41	29.57	29.27	39.94	46.05
Minnesota Hub	16.44	14.23	13.63	13.04	14.43	19.92	25.66	31.31	33.68	37.56	41.33	41.87	42.47	44.51	43.68	48.57	47.74	42.71	33.95	39.35	39.91	31.95	23.09	20.42	31.73	38.98
Wisconsin PS	20.63	17.76	16.91	16.48	18.21	26.75	31.62	34.04	34.32	37.71	43.41	43.37	44.43	50.37	47.31	49.86	51.87	46.93	42.18	40.94	45.71	35.33	29.38	26.15	35.48	42.32
Cleared Load (GW)	50.0	49.0	48.1	48.4	51.4	58.8	64.5	67.8	69.9	71.7	73.1	74.2	76.0	76.1	76.5	75.8	74.4	73.1	73.6	74.4	70.3	64.0	5.8			

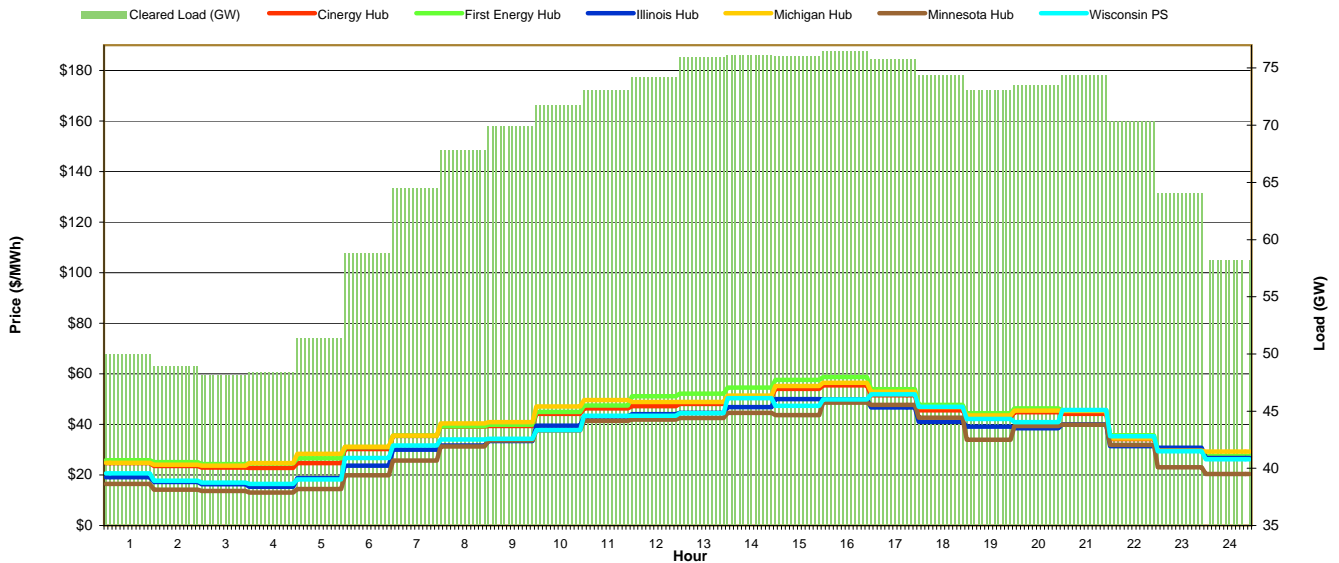

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	22.27	23.61	22.35	23.43	25.25	25.42	25.90	29.96	34.61	30.82	46.56	53.95	187.38	61.50	40.44	47.98	38.84	49.58	68.27	45.88	98.72	30.42	24.83	24.34	45.10	55.61
First Energy Hub	22.73	24.03	22.21	21.93	24.34	24.60	26.68	30.68	35.41	31.39	47.24	54.56	189.10	62.12	40.73	48.21	40.19	52.25	69.32	46.66	99.08	30.62	25.13	25.01	45.59	56.42
Illinois Hub	22.12	23.29	17.47	6.38	11.22	11.79	25.46	29.64	34.36	30.71	46.69	54.36	188.57	61.97	40.75	48.19	39.66	50.65	57.70	32.80	87.03	26.73	24.68	22.63	41.45	53.41
Michigan Hub	23.17	24.46	22.51	22.16	24.60	24.92	27.13	31.27	35.91	31.62	47.02	53.27	188.09	59.36	38.67	45.73	36.84	51.96	69.34	46.46	99.24	30.80	25.48	25.30	45.22	55.69
Minnesota Hub	21.01	21.27	19.37	18.97	20.99	22.05	41.49	28.82	32.20	28.57	43.29	51.15	172.83	38.59	37.52	40.36	36.04	39.31	48.74	36.41	55.11	28.61	23.29	21.70	38.65	46.30
Wisconsin PS	23.18	24.11	22.15	21.73	24.05	24.52	28.41	31.14	35.82	31.87	48.25	56.03	183.74	57.60	41.28	41.18	39.21	36.08	41.06	35.01	28.72	30.86	25.31	24.83	39.84	47.69
Forecasted Load (GW)	55.5	53.8	52.9	53.1	55.2	59.1	63.0	66.5	68.7	70.7	72.4	73.5	74.5	75.2	75.3	75.3	75.0	74.1	73.1	72.8	73.5	70.6	65.8	61.7		
Forecast Error %	-2.0%	-1.9%	-2.6%	-2.8%	-3.1%	-1.5%	0.2%	0.1%	0.0%	-0.3%	-0.8%	-0.8%	-1.1%	-1.2%	-1.0%	-0.4%	0.0%	0.8%	1.1%	1.2%	1.5%	0.5%	-0.7%			

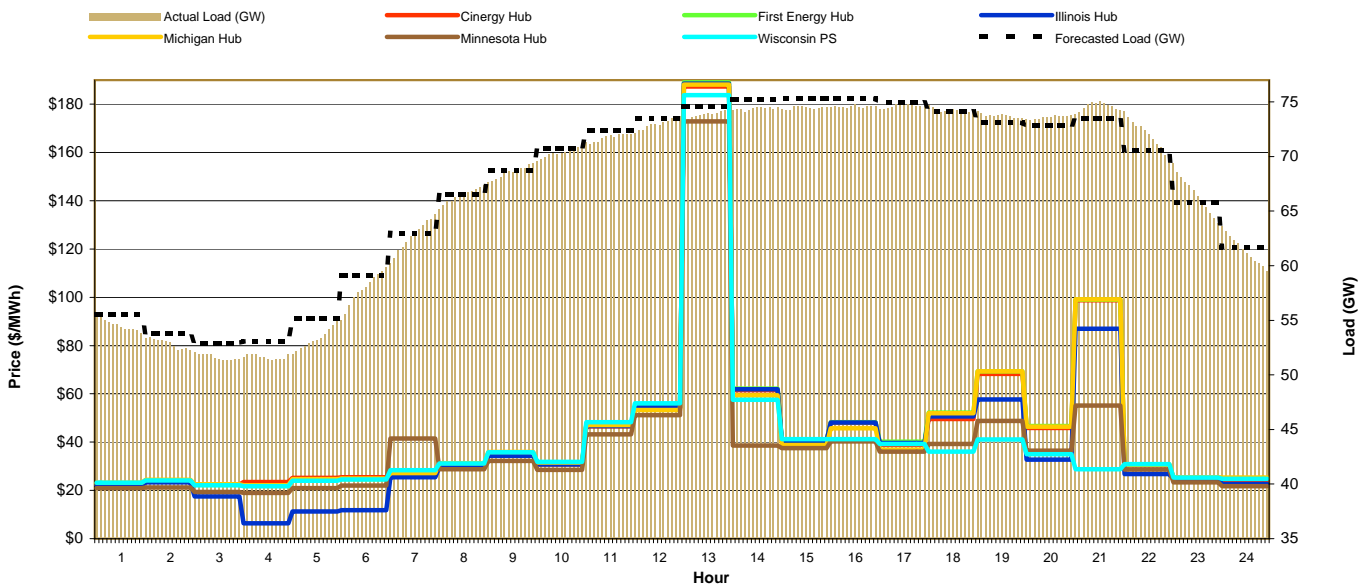




MISO Daily Report

Thursday May 12, 2011

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	24.29	22.77	22.42	22.52	23.09	28.74	30.90	33.83	35.65	42.41	45.05	49.18	51.73	50.87	50.87	49.69	47.14	45.44	42.82	41.99	42.46	33.83	29.33	25.71	37.20	43.27
First Energy Hub	24.77	23.27	22.85	22.94	23.42	28.96	31.64	35.11	37.27	44.28	48.52	51.48	54.67	54.65	53.74	52.01	49.29	47.51	44.84	44.01	44.17	35.02	29.88	27.18	38.81	45.40
Illinois Hub	19.34	17.91	17.42	17.26	17.80	26.29	27.70	32.66	34.63	41.17	43.64	47.56	50.26	49.51	56.60	55.32	51.21	51.39	49.49	49.00	49.74	36.80	33.54	26.48	37.61	45.78
Michigan Hub	23.98	22.17	21.90	21.98	22.95	29.33	32.89	35.66	38.70	44.00	45.65	50.30	54.00	53.30	53.52	51.61	48.71	46.88	44.18	43.99	44.37	35.50	30.76	31.64	38.67	45.07
Minnesota Hub	18.43	15.58	15.54	15.37	15.83	21.00	31.53	34.19	34.35	39.23	41.92	45.19	47.23	47.78	41.83	43.44	42.55	40.46	35.47	36.51	34.77	29.48	21.30	14.90	31.83	38.48
Wisconsin PS	21.39	19.65	19.47	19.34	19.81	26.96	32.15	35.55	37.78	44.61	47.34	51.39	54.29	53.72	53.44	52.51	49.61	47.88	44.68	44.66	44.51	35.10	29.23	23.88	37.87	45.39
Cleared Load (GW)	54.4	52.4	51.4	51.7	54.3	60.9	65.9	68.9	71.1	73.0	74.6	76.0	77.7	77.7	77.8	77.9	77.5	75.6	75.1	75.2	76.1	71.6	65.4	6.0		

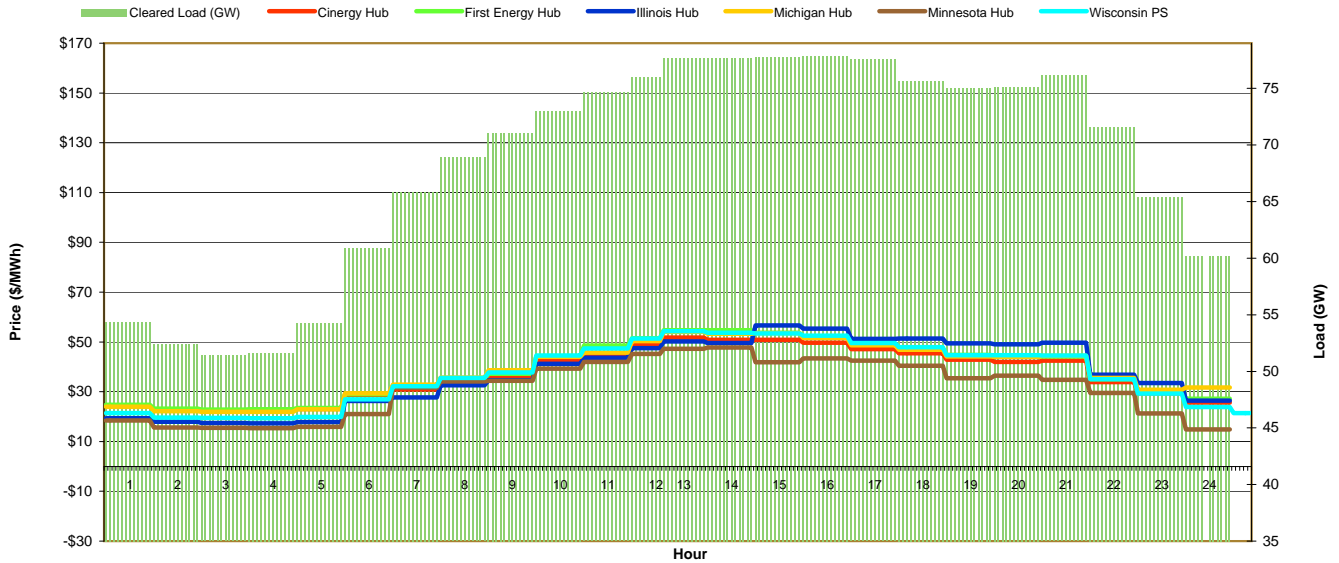

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	25.27	22.98	22.50	23.61	28.54	29.24	33.55	35.85	49.82	62.45	39.74	44.34	165.05	62.41	64.56	52.36	83.28	75.70	53.90	111.59	50.54	31.04	28.96	29.32	51.11	63.22
First Energy Hub	20.31	18.54	20.18	21.87	24.61	28.11	31.35	36.66	50.87	63.30	40.27	44.82	167.43	63.48	65.48	52.75	83.76	76.13	54.27	112.76	51.03	31.27	29.36	31.38	50.83	63.98
Illinois Hub	-22.85	-20.69	4.82	10.81	-5.93	15.56	10.45	35.41	49.25	61.92	39.54	44.16	165.05	62.58	66.90	53.37	84.06	76.38	54.21	111.76	50.55	31.08	28.97	29.79	43.21	63.45
Michigan Hub	20.43	18.59	20.18	21.83	24.64	28.28	31.56	36.90	51.34	63.29	39.97	44.32	163.86	60.59	62.50	50.61	80.13	72.66	53.00	112.75	51.00	31.54	29.86	31.96	50.07	62.77
Minnesota Hub	17.61	16.08	12.76	13.75	16.37	26.57	26.29	53.23	74.30	79.68	41.36	49.23	143.32	54.47	36.83	34.69	28.70	24.58	25.57	44.21	25.28	9.69	8.00	6.17	36.20	45.82
Wisconsin PS	20.10	18.25	19.80	21.42	24.12	27.67	31.08	36.59	51.06	64.47	41.00	45.45	166.50	63.13	63.44	52.45	84.77	77.26	54.95	112.41	49.18	31.09	29.31	31.65	50.71	63.94
Forecasted Load (GW)	57.1	55.8	53.9	54.0	56.3	61.2	65.1	67.9	70.3	72.3	74.0	75.4	76.6	77.3	77.4	77.1	76.5	75.6	74.6	74.1	74.9	72.1	67.4	62.0		
Forecast Error %	-32.0%	-0.9%	0.3%	-0.4%	-1.6%	-2.2%	-1.4%	0.3%	0.4%	0.6%	1.0%	0.7%	1.2%	1.0%	1.1%	1.4%	1.7%	2.3%	1.9%	1.8%	1.4%	0.2%	-1.8%	-10.0%		

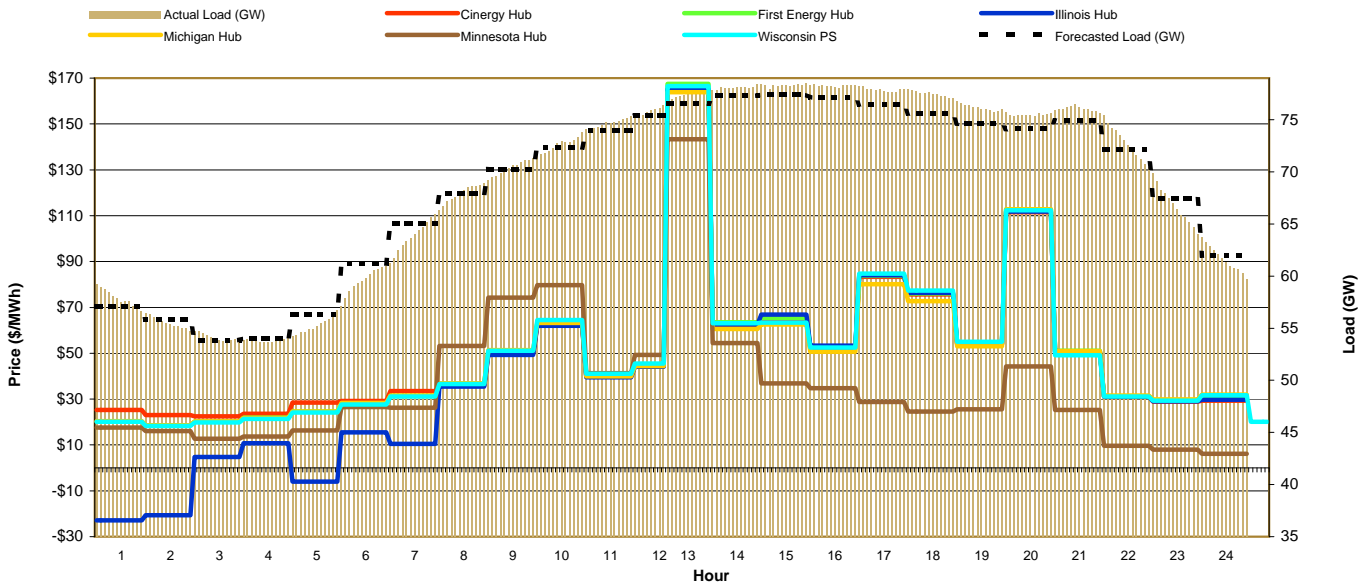




MISO Daily Report

Friday May 13, 2011

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	25.33	25.08	24.33	24.61	25.57	31.32	37.17	39.99	42.86	44.80	51.06	53.48	57.60	53.68	49.59	47.31	44.51	42.71	39.27	39.50	42.31	32.71	30.20	27.60	38.86	44.47
First Energy Hub	25.04	24.81	24.02	24.30	25.30	31.12	37.61	40.90	43.88	45.74	52.40	54.92	59.03	55.15	50.84	48.03	45.66	43.94	40.36	40.59	43.43	33.63	30.82	27.81	39.56	45.58
Illinois Hub	17.06	16.58	16.80	16.96	17.84	23.69	28.04	32.27	36.13	37.75	43.07	44.80	47.29	44.67	41.28	37.39	38.58	39.13	36.06	36.79	39.33	30.62	25.79	22.99	32.12	38.18
Michigan Hub	25.71	25.51	24.64	24.98	26.04	31.97	40.10	42.13	44.54	46.24	53.08	55.83	61.54	58.15	53.45	48.82	46.35	44.63	40.97	41.20	44.09	34.21	30.32	28.67	40.55	46.60
Minnesota Hub	13.88	7.48	6.61	5.99	8.12	18.80	27.93	33.64	33.26	34.68	35.66	35.50	34.44	30.27	27.13	24.92	23.06	22.62	21.78	21.85	22.41	20.36	10.51	6.41	21.97	27.01
Wisconsin PS	20.09	18.69	18.31	18.21	19.28	26.55	32.49	37.61	38.96	41.08	44.80	45.87	47.46	41.95	40.07	37.98	36.26	35.57	33.09	33.28	35.38	28.52	23.10	19.81	32.26	37.56
Cleared Load (GW)	56.2	54.6	53.2	53.1	55.3	61.3	65.5	68.7	70.7	72.1	73.7	74.4	75.5	75.6	75.6	75.9	76.0	74.7	73.6	73.0	73.7	68.9	62.0	5.7		

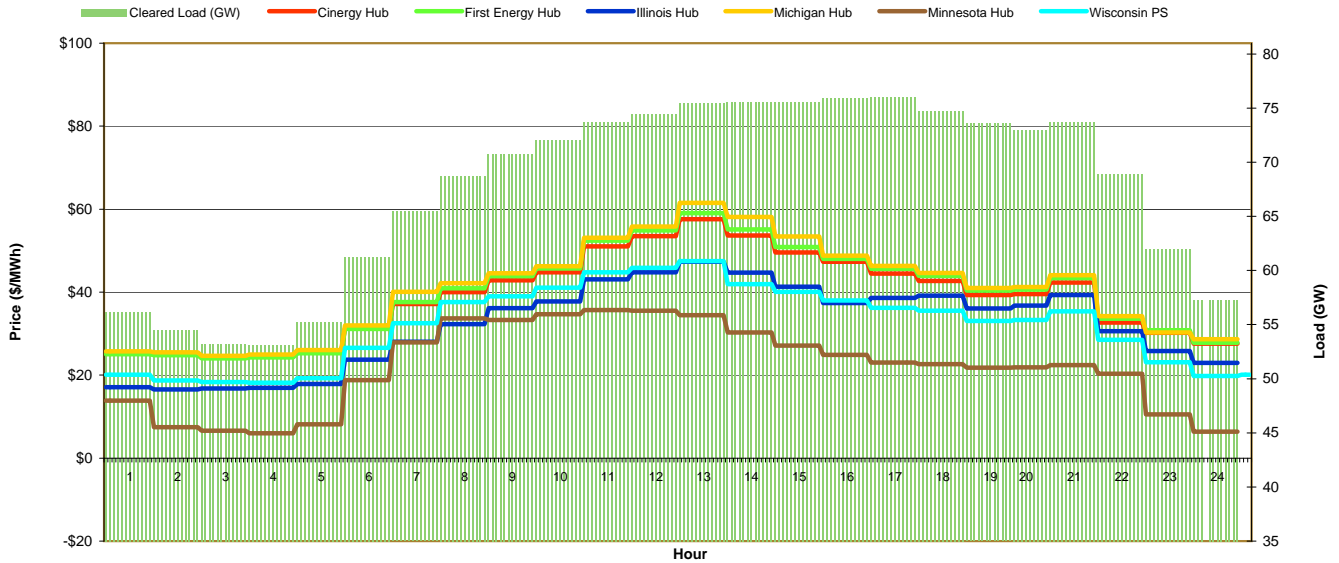

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	24.74	27.27	24.23	26.10	32.20	31.31	29.81	36.75	47.39	67.11	46.68	93.94	83.79	86.86	45.55	44.17	44.73	44.03	29.23	32.48	66.94	26.10	25.23	21.79	43.27	51.31
First Energy Hub	25.25	25.94	22.51	25.07	29.07	29.35	29.40	37.72	48.52	68.91	47.74	95.89	85.68	88.79	46.53	45.09	46.95	47.01	29.80	31.83	68.45	26.64	25.89	22.48	43.77	52.59
Illinois Hub	24.44	10.56	5.00	10.93	-1.29	5.31	17.32	36.24	47.01	66.59	43.91	93.07	79.91	82.57	44.08	42.19	42.20	43.92	28.33	19.88	63.65	25.09	24.42	21.05	36.52	48.94
Michigan Hub	25.70	26.34	22.76	25.36	29.51	29.82	29.82	38.16	48.85	69.03	47.58	95.32	85.09	88.68	46.53	45.40	47.18	47.33	30.10	32.26	69.21	27.04	26.25	22.61	44.00	52.75
Minnesota Hub	3.69	-2.38	-15.20	12.41	17.74	29.53	29.21	11.76	27.65	94.59	40.88	50.40	66.87	49.73	11.03	14.52	20.14	13.82	13.32	19.38	35.25	12.11	10.68	7.00	23.92	30.76
Wisconsin PS	24.93	25.47	20.46	25.02	28.79	29.64	29.84	38.02	50.45	72.88	49.82	97.57	86.04	87.43	45.41	44.03	45.82	46.31	29.73	31.56	67.85	26.73	25.86	22.09	43.82	52.84
Forecasted Load (GW)	59.2	56.9	55.4	55.4	57.1	61.4	65.2	68.4	71.0	73.0	74.8	76.1	77.0	77.8	77.9	77.7	77.1	75.9	74.4	73.6	73.9	71.0	65.9	61.4		
Forecast Error %	-19.1%	-2.2%	-1.9%	-2.0%	-1.9%	-1.8%	-0.3%	1.0%	0.7%	1.0%	1.2%	1.6%	2.3%	2.4%	2.6%	2.9%	3.2%	3.7%	3.9%	3.5%	3.5%	2.3%	1.2%	-8.9%		

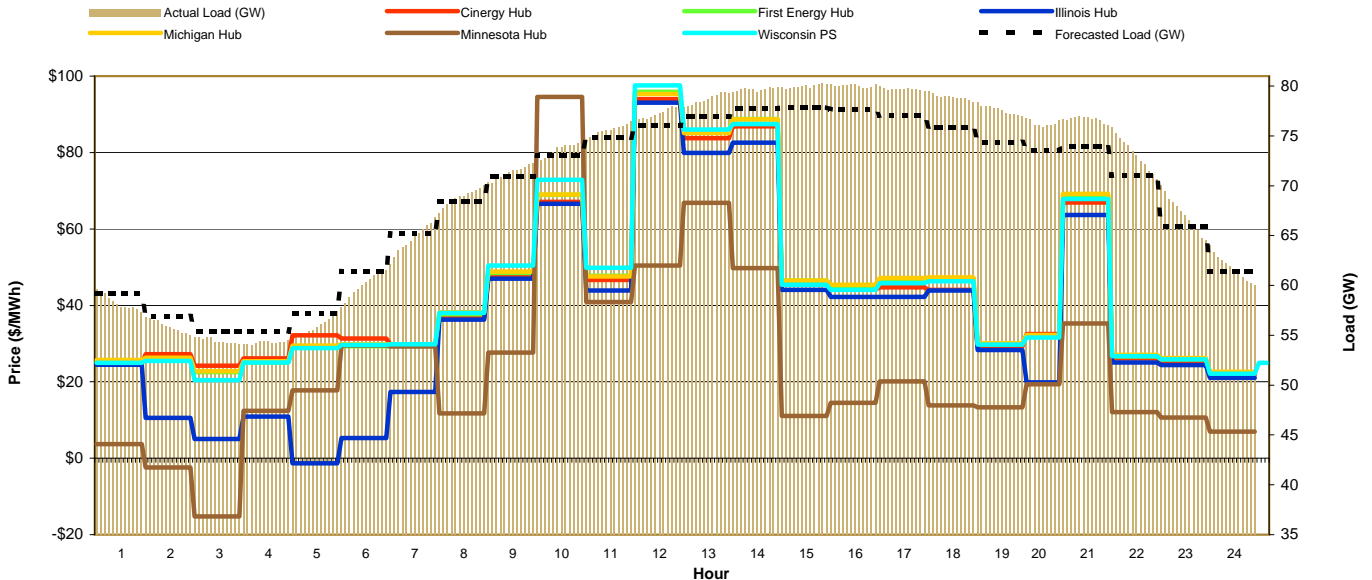




MISO Daily Report

Saturday May 14, 2011

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	24.10	22.85	21.75	21.64	21.20	23.47	25.27	28.23	32.00	36.39	34.32	35.33	34.00	31.25	30.09	30.20	30.20	29.65	28.54	29.95	32.00	28.49	22.55	22.87	28.18	30.82
First Energy Hub	25.56	23.99	22.79	22.61	22.40	24.48	25.50	31.34	36.46	41.59	38.60	40.51	35.96	35.01	32.64	31.31	31.28	31.29	31.32	32.26	33.40	29.64	24.17	23.45	30.32	33.55
Illinois Hub	15.00	14.20	13.63	13.91	13.41	15.06	16.94	25.62	30.55	30.67	31.07	33.12	31.85	29.22	27.32	27.38	27.40	28.58	27.55	28.86	31.03	27.50	19.76	19.64	24.14	28.59
Michigan Hub	24.08	23.44	20.54	20.44	19.53	22.46	25.29	27.71	32.41	35.25	33.45	34.28	34.45	31.01	30.13	30.87	30.92	30.37	28.64	30.40	33.04	29.30	21.09	23.87	28.04	30.83
Minnesota Hub	4.31	3.83	3.07	3.08	4.25	4.37	7.00	12.49	19.17	21.62	21.58	21.61	19.38	17.67	16.10	15.94	14.96	16.16	16.03	18.43	18.31	14.94	10.06	5.84	12.93	17.15
Wisconsin PS	18.23	16.61	15.43	15.31	16.04	17.89	20.87	27.46	31.71	35.54	34.51	35.32	33.57	30.48	28.93	28.92	28.86	28.62	27.88	28.98	31.55	27.64	21.49	17.42	25.80	30.09
Cleared Load (GW)	53.3	51.8	50.9	51.0	53.6	60.0	64.9	68.1	70.1	71.7	72.5	72.8	73.7	73.6	73.0	72.4	71.8	69.7	68.2	68.1	68.7	65.3	58.7	5.4		

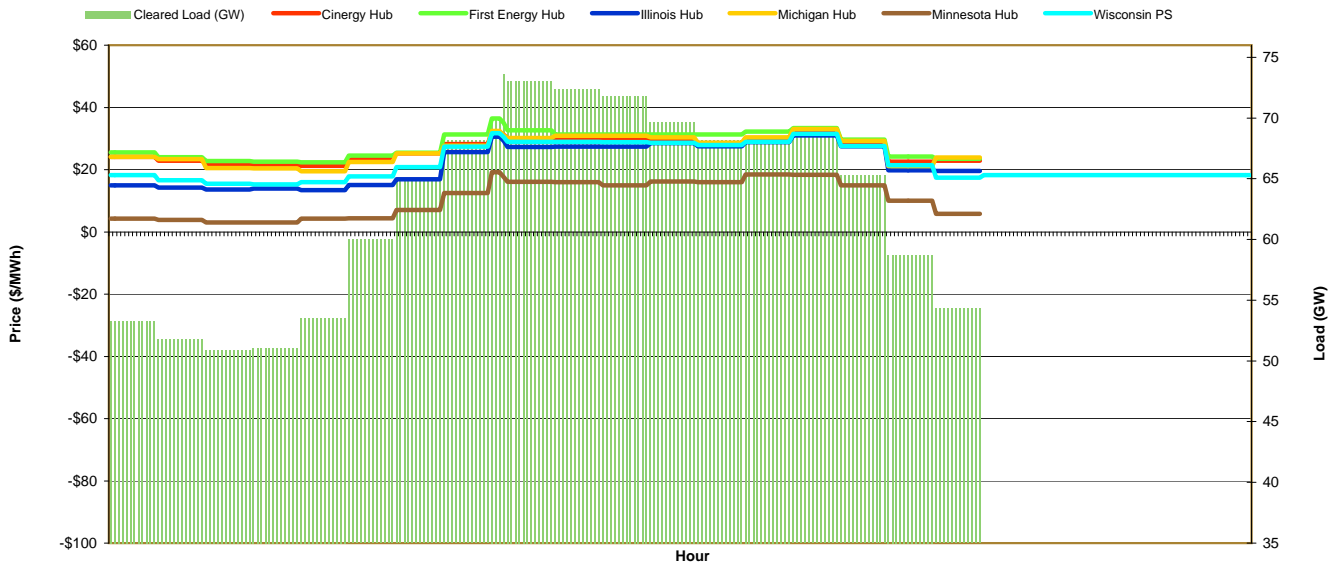

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	14.33	21.88	21.83	21.72	23.09	23.69	23.37	27.77	37.57	50.58	48.00	39.51	29.46	27.89	30.20	32.97	27.02	26.81	25.51	30.50	24.67	23.18	-16.76	19.11	28.41	29.06
First Energy Hub	14.58	21.07	20.16	22.03	22.75	24.36	24.06	28.32	37.87	52.28	49.65	40.81	30.41	28.85	31.28	34.17	28.06	27.83	26.24	31.66	25.66	24.22	21.26	23.71	28.80	32.41
Illinois Hub	13.06	11.04	5.57	18.82	14.55	22.81	22.59	24.37	32.07	49.01	46.65	38.46	28.67	27.08	29.26	31.94	26.14	26.02	22.93	29.55	23.99	22.43	-28.14	17.32	23.17	26.90
Michigan Hub	14.64	21.25	20.33	22.16	22.85	24.45	24.14	28.34	38.01	52.66	50.00	41.00	30.50	28.90	31.30	34.16	28.04	27.83	26.18	31.60	25.68	23.62	-94.95	11.50	23.51	25.18
Minnesota Hub	5.69	8.30	1.49	13.45	10.32	14.11	13.82	19.01	15.23	19.48	23.16	18.56	19.94	19.13	17.30	15.00	18.66	19.14	19.72	20.88	22.03	20.81	-26.57	16.60	14.39	16.34
Wisconsin PS	14.24	20.62	19.38	20.99	20.95	23.53	23.40	27.57	35.58	51.23	48.83	40.14	29.77	28.00	30.10	32.80	26.94	26.95	25.36	30.55	24.95	23.23	-29.26	18.02	25.58	28.29
Forecasted Load (GW)	59.3	57.0	55.7	55.5	57.2	61.2	64.9	68.0	70.5	72.4	73.7	74.6	75.0	75.1	74.5	73.6	72.5	70.8	68.8	67.7	68.2	65.7	61.0	57.5		
Forecast Error %	#####	-2.6%	-2.9%	-2.8%	-2.6%	-2.2%	-0.8%	0.4%	1.3%	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	-0.1%	-0.2%	-0.3%	-0.4%	-0.4%	-0.2%	0.6%	0.4%	0.0%	0.0%	-11.0%		

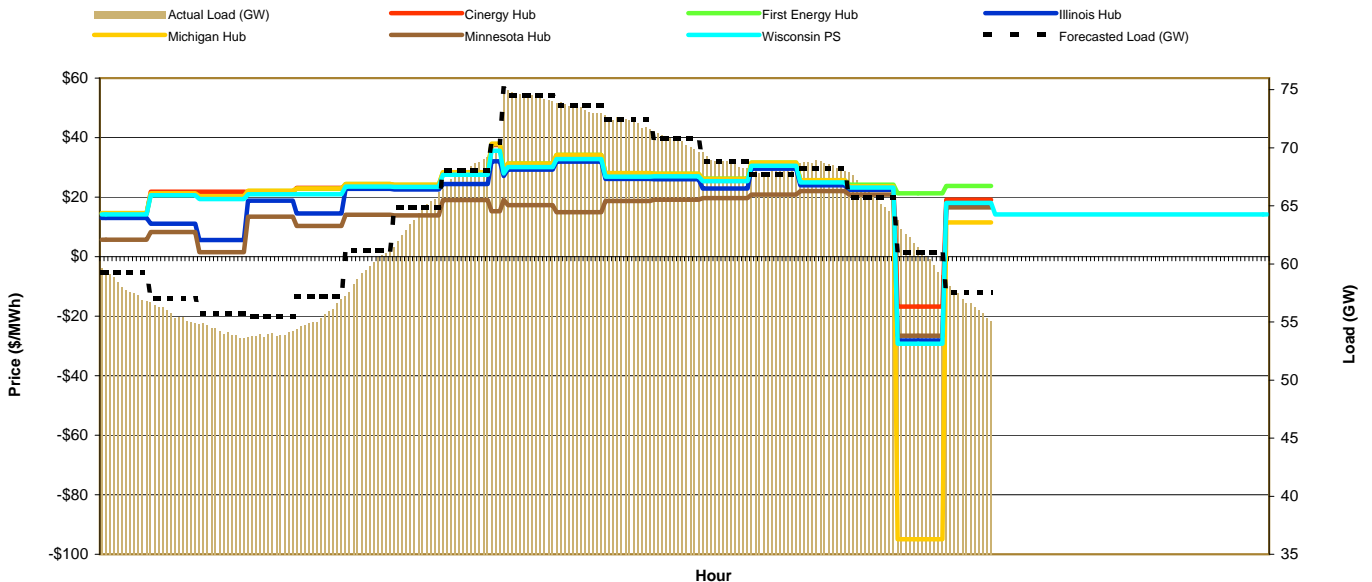




MISO Daily Report

Sunday May 15, 2011

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	19.80	18.90	17.92	17.43	17.57	18.69	23.44	24.50	27.13	28.13	28.03	26.59	26.21	25.45	25.45	25.67	26.83	26.96	27.63	29.82	33.44	28.71	21.99	22.64	24.54	27.03
First Energy Hub	20.72	20.05	18.72	18.50	19.38	20.68	24.72	28.20	29.97	31.23	31.23	27.48	27.17	26.29	26.30	26.55	27.87	27.93	28.61	31.14	34.68	29.72	23.44	23.45	26.00	28.61
Illinois Hub	14.24	12.91	12.00	11.66	12.00	15.28	20.75	22.93	24.99	25.92	25.92	25.38	25.31	24.53	24.50	24.70	24.82	25.02	25.70	27.71	33.46	27.10	20.77	20.73	22.01	25.55
Michigan Hub	18.19	16.49	15.51	15.00	13.88	16.09	23.43	23.95	26.68	27.71	27.60	27.38	27.08	26.20	26.21	26.46	27.95	27.98	28.65	30.78	34.27	29.69	21.60	23.77	24.27	27.51
Minnesota Hub	4.53	4.54	4.55	4.47	4.51	4.47	5.52	9.77	13.15	15.01	15.06	14.43	13.55	12.90	12.72	12.55	17.57	19.13	19.92	21.38	23.23	22.08	18.17	15.06	12.84	16.29
Wisconsin PS	15.66	15.21	14.80	14.57	14.48	15.29	17.64	22.20	26.32	27.29	27.17	26.49	26.24	25.44	25.33	25.47	23.68	24.09	24.90	26.80	33.93	27.29	21.64	19.78	22.57	25.89
Cleared Load (GW)	49.2	47.3	46.2	46.0	46.5	49.0	52.4	57.0	59.7	60.6	60.8	60.7	60.1	59.7	58.9	58.7	58.9	58.8	58.4	59.1	61.0	57.3	52.0	4.9		

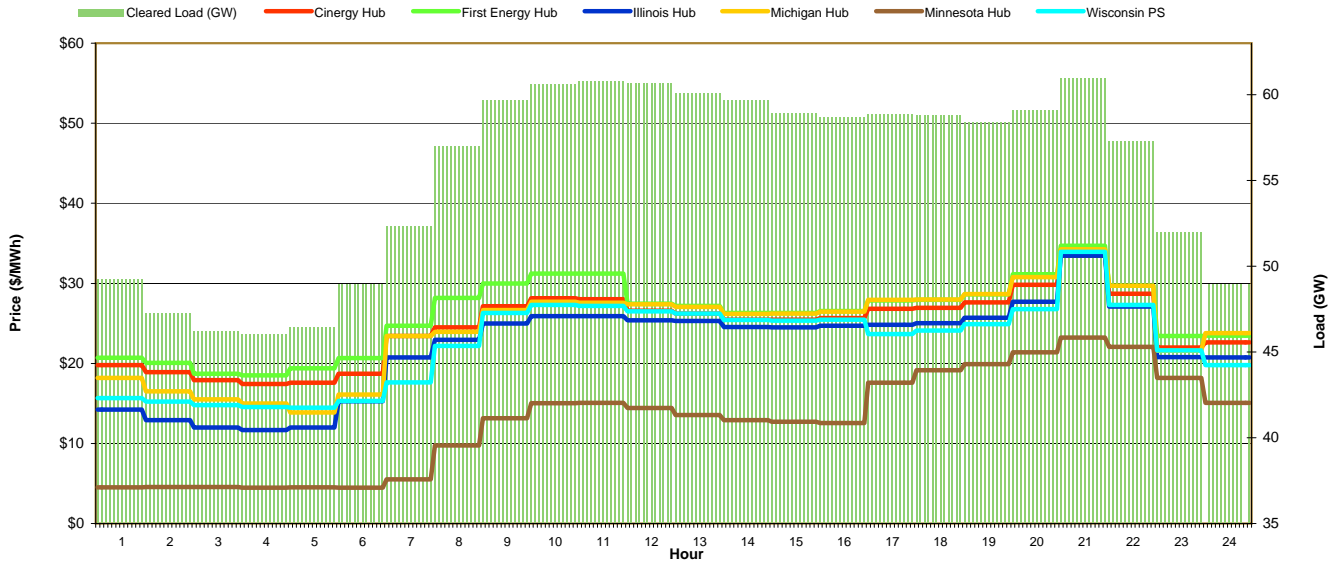

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	23.11	20.35	17.15	1.83	12.99	3.54	17.64	21.81	25.97	24.77	25.19	24.89	26.14	22.61	23.16	23.13	23.79	25.98	55.47	46.54	27.93	25.52	22.40	16.77	23.28	27.83
First Energy Hub	23.23	20.56	17.54	1.89	13.29	3.62	16.75	22.37	26.22	25.67	26.19	25.93	27.14	23.56	23.56	23.44	23.94	26.67	57.73	48.56	29.01	26.48	23.18	17.26	23.91	28.73
Illinois Hub	19.54	18.02	16.63	1.78	12.59	3.45	7.94	20.81	21.43	23.86	24.27	23.96	25.27	21.81	18.76	17.95	17.51	22.57	53.43	45.03	27.17	24.87	21.78	16.23	21.11	25.66
Michigan Hub	23.26	20.57	17.50	1.89	13.26	3.60	16.68	22.24	26.05	25.56	26.15	25.92	27.14	23.51	23.49	23.39	23.88	26.53	57.53	48.38	29.08	26.59	23.30	17.37	23.87	28.67
Minnesota Hub	16.03	15.13	14.65	1.54	11.02	3.03	11.66	18.86	22.10	21.31	21.91	21.52	5.69	14.34	11.72	14.64	16.15	18.84	40.02	40.55	24.88	22.80	12.38	10.21	17.12	20.48
Wisconsin PS	22.47	19.83	16.87	1.76	12.72	3.51	16.09	21.67	25.46	24.75	25.19	24.77	25.93	22.48	22.51	22.40	23.03	25.67	55.76	47.08	28.58	26.23	22.70	16.92	23.10	27.76
Forecasted Load (GW)	55.2	53.2	52.1	51.6	51.6	52.7	54.1	56.3	58.2	59.7	60.2	60.4	60.2	59.8	59.4	58.9	58.9	58.8	58.4	58.6	59.9	58.1	54.9	52.4		
Forecast Error %	-3.3%	-3.5%	-3.9%	-3.7%	-2.7%	-1.9%	-1.3%	0.1%	2.2%	2.7%	3.2%	2.7%	2.4%	2.0%	1.4%	1.7%	2.0%	1.9%	2.0%	1.9%	0.6%	0.5%	-0.3%	-2.0%		

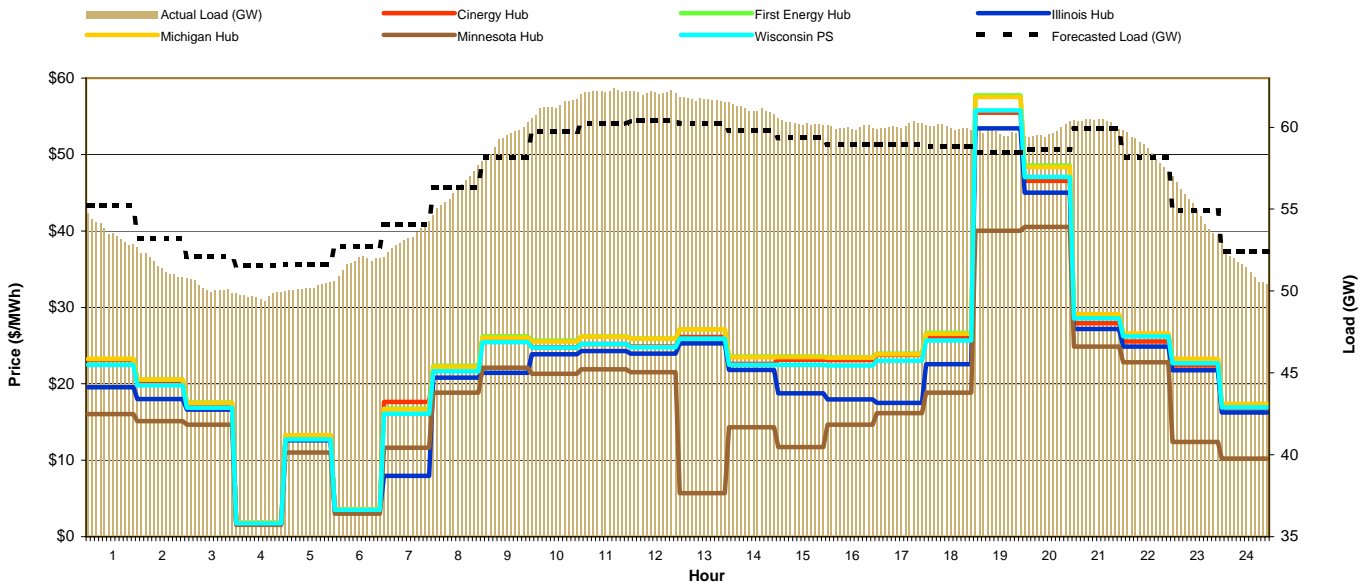




MISO Daily Report

Monday May 16, 2011

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	22.67	22.45	22.43	23.23	24.68	34.07	35.32	40.75	41.00	42.45	42.18	41.32	42.25	40.39	35.39	32.54	31.60	30.54	30.68	34.77	40.67	30.98	28.05	25.04	33.14	36.60
First Energy Hub	23.43	23.17	23.16	24.11	26.14	35.29	36.57	42.19	42.44	43.94	44.79	42.78	43.74	41.81	36.64	33.68	32.72	31.61	31.76	35.99	42.11	32.07	30.32	26.19	34.44	38.04
Illinois Hub	17.29	16.90	16.90	17.41	19.95	30.27	32.65	39.74	39.98	41.39	41.13	40.30	41.20	39.39	34.52	31.73	30.45	29.24	29.33	33.72	39.67	29.99	26.29	23.55	30.96	35.50
Michigan Hub	22.09	21.86	21.85	23.57	25.15	35.79	37.77	42.80	42.96	43.91	43.41	43.18	43.78	41.53	36.40	33.46	32.51	31.47	31.64	35.82	41.83	31.94	29.71	27.10	34.23	37.90
Minnesota Hub	13.14	12.16	12.44	13.40	15.86	21.07	30.20	39.75	39.99	41.40	41.15	40.31	41.21	39.40	34.53	31.74	30.73	27.73	27.34	31.95	39.68	27.90	19.86	16.90	28.74	34.67
Wisconsin PS	19.32	18.95	18.70	18.89	21.27	29.09	34.47	42.98	43.24	44.77	44.49	43.59	44.56	42.60	37.33	34.32	33.27	30.88	30.69	35.41	42.90	31.18	28.23	23.32	33.10	38.15
Cleared Load (GW)	45.8	44.4	43.5	43.6	44.0	45.8	48.4	51.7	54.7	56.2	56.3	56.5	56.3	55.9	55.7	56.1	56.8	57.3	57.4	59.0	62.2	58.6	52.7	5.0		

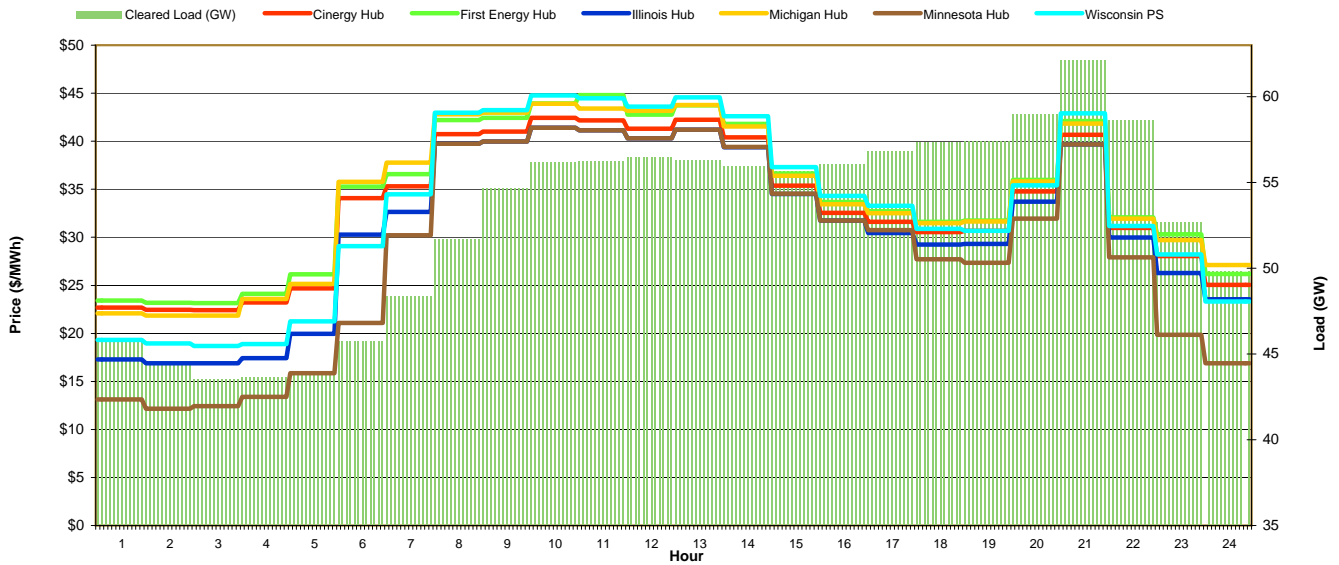

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	20.30	19.68	20.73	21.25	25.91	24.78	42.32	30.74	32.34	29.39	31.06	30.52	30.06	34.86	29.43	27.15	32.36	31.42	28.83	32.96	28.39	27.37	25.40	26.44	28.49	30.14
First Energy Hub	20.64	20.09	21.20	21.74	26.51	25.48	43.75	31.85	33.59	30.60	32.37	33.60	34.26	39.91	31.47	28.59	33.84	32.91	30.02	34.52	29.75	28.59	26.46	27.30	29.96	32.02
Illinois Hub	18.42	18.65	20.11	20.65	32.69	23.91	40.33	28.96	31.10	28.14	30.40	31.52	32.01	37.25	29.01	26.45	30.61	30.11	26.73	31.18	27.49	26.90	24.89	24.47	28.00	29.55
Michigan Hub	20.76	20.03	21.31	21.88	26.70	25.81	44.21	32.15	33.77	30.62	32.36	33.59	34.25	39.90	31.31	28.51	33.49	32.66	29.49	34.20	29.77	28.94	26.73	27.14	29.98	31.98
Minnesota Hub	12.77	12.20	16.80	15.71	17.02	21.43	37.39	27.90	30.09	27.74	28.78	29.34	29.66	34.33	27.12	24.53	22.34	24.82	16.08	23.27	24.08	25.66	23.29	13.94	23.60	26.19
Wisconsin PS	20.21	17.91	20.76	21.33	25.94	24.58	42.20	31.28	33.32	30.44	32.02	32.79	33.19	38.43	30.05	27.22	28.52	29.38	23.35	29.19	27.58	28.23	26.04	21.24	28.13	30.06
Forecasted Load (GW)	50.6	49.0	48.4	48.0	48.4	49.2	50.2	52.5	54.6	55.5	56.4	56.9	56.9	56.5	56.1	56.3	56.8	57.6	58.4	59.4	61.5	59.2	56.0	53.6		
Forecast Error %	-2.5%	-2.2%	-2.8%	-2.8%	-2.9%	-2.9%	-3.1%	-2.7%	-1.0%	0.4%	0.5%	0.6%	0.9%	0.7%	0.9%	0.8%	0.8%	0.6%	0.2%	0.1%	-1.7%	-0.1%	0.3%	-1.3%		

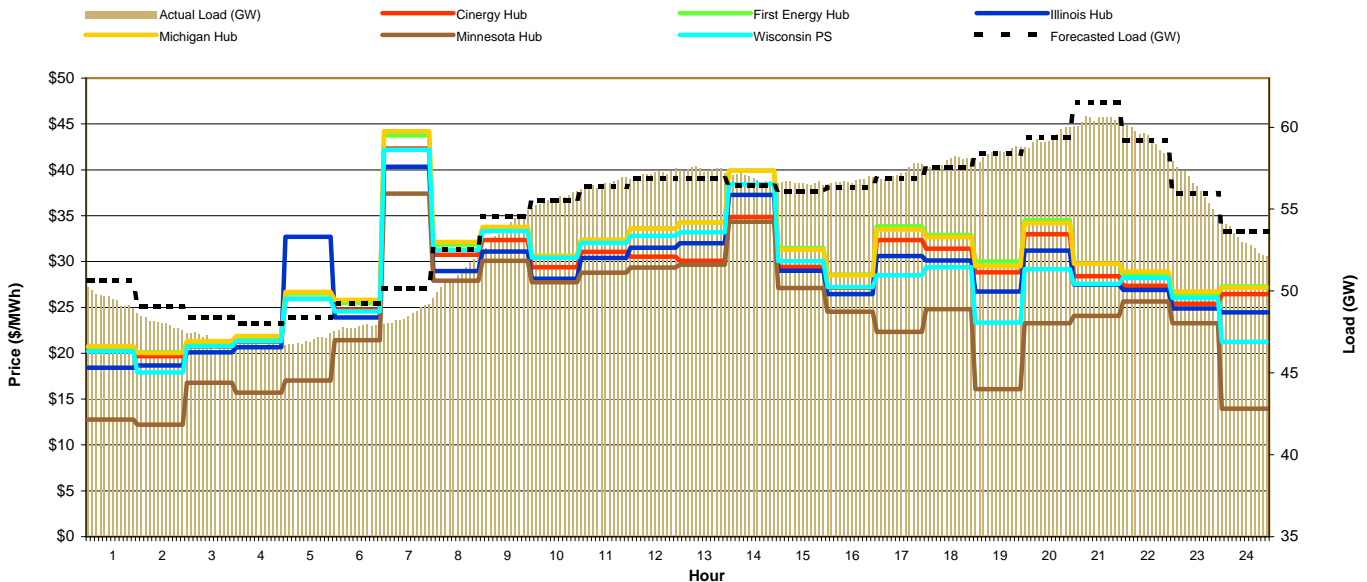




MISO Daily Report

Tuesday May 17, 2011

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$			
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk		
Cinergy Hub	25.14	24.68	24.34	24.81	27.23	34.59	43.03	43.78	44.00	43.95	45.63	46.09	45.02	43.14	42.61	38.04	35.61	36.37	44.70	48.45	34.19	24.96	23.67	37.00	41.28			
First Energy Hub	26.44	25.81	25.68	26.10	28.62	35.60	43.55	44.25	45.79	46.00	45.89	46.21	45.09	43.17	42.65	37.36	34.87	35.63	44.07	48.11	33.78	25.80	24.00	37.52	41.54			
Illinois Hub	23.37	21.84	21.48	21.80	25.73	32.92	41.43	42.90	42.22	42.45	42.41	42.55	41.71	40.29	38.02	37.33	28.19	25.55	26.50	34.10	39.72	26.97	21.80	20.59	32.58	35.79		
Michigan Hub	24.67	23.94	24.24	24.86	26.85	35.59	43.29	44.45	44.05	43.94	43.94	45.43	45.71	44.79	42.96	42.44	37.04	34.54	35.47	43.94	47.89	33.25	25.30	24.40	36.79	40.95		
Minnesota Hub	16.31	15.42	13.39	13.55	16.27	20.50	27.48	37.32	39.28	39.79	39.81	39.01	37.32	32.01	29.20	26.86	25.97	24.41	21.83	24.91	30.96	25.72	18.90	15.86	26.34	30.83		
Wisconsin PS	21.43	20.63	20.49	20.01	22.46	28.77	36.83	43.15	44.73	44.71	44.70	44.88	43.35	40.42	36.91	35.59	31.84	29.72	30.35	35.46	40.39	30.90	24.11	21.07	33.04	37.57		
Cleared Load (GW)	48.4	47.4	47.2	47.8	51.1	57.9	63.9	66.0	67.0	67.8	67.9	67.5	67.4	66.7	66.3	65.6	65.1	64.6	64.7	66.1	67.4	64.6	58.6	5.5				

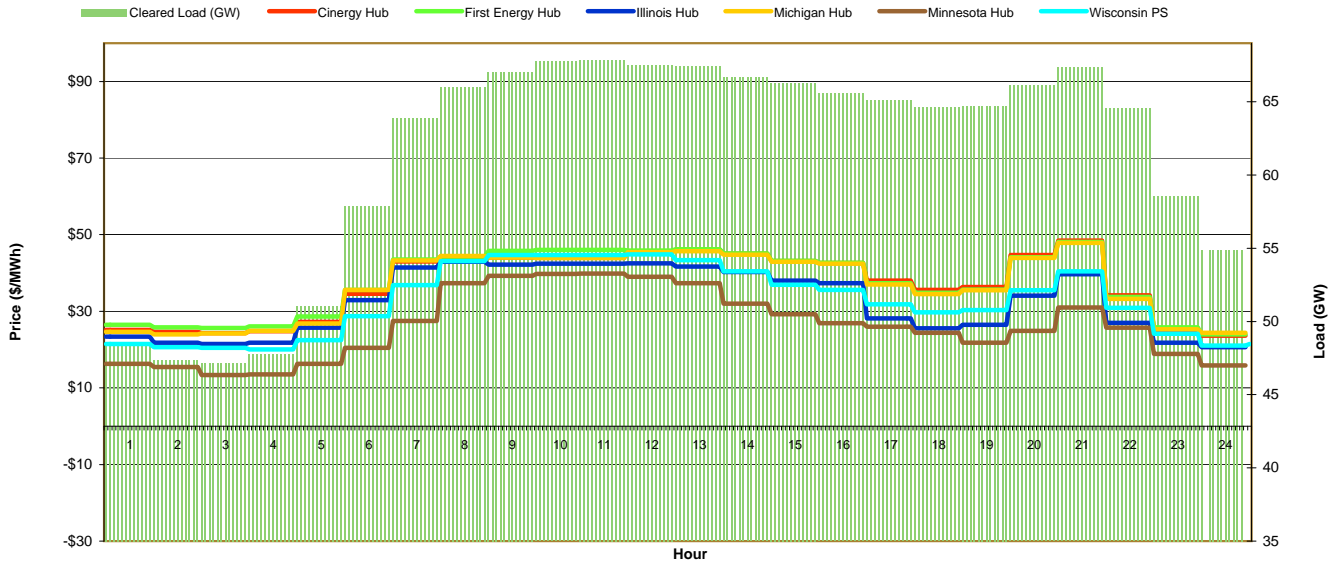

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$			
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk		
Cinergy Hub	23.55	21.93	21.64	27.03	31.17	34.42	53.48	33.66	31.42	42.53	62.81	44.44	65.81	37.32	45.98	62.50	66.18	51.07	42.35	35.48	29.44	30.84	28.71	23.16	39.46	44.41		
First Energy Hub	24.33	22.63	22.32	27.86	31.92	35.40	55.19	35.02	32.86	44.49	66.13	46.71	69.52	40.41	42.33	48.01	50.21	41.31	36.42	34.43	30.49	32.03	29.57	23.87	38.48	42.50		
Illinois Hub	22.70	21.14	20.99	30.11	28.76	31.33	49.40	32.48	30.46	40.98	60.93	42.16	63.57	37.12	16.94	-23.68	-23.92	-3.44	7.50	24.31	29.58	34.87	31.87	27.69	26.41	25.11		
Michigan Hub	24.50	22.81	22.55	28.13	31.69	37.80	56.89	34.83	32.73	44.25	65.46	46.26	68.85	40.32	42.38	48.07	50.20	41.07	36.28	34.32	30.48	32.09	29.54	23.84	38.56	42.32		
Minnesota Hub	19.32	18.47	19.09	19.03	16.23	22.24	34.72	28.32	34.14	50.71	81.39	69.08	97.65	55.74	49.93	62.94	54.18	21.75	20.02	22.23	24.06	21.15	14.32	9.19	36.08	44.23		
Wisconsin PS	22.65	21.31	21.60	25.98	24.88	26.74	43.66	32.81	31.43	42.89	63.57	44.34	65.62	38.65	33.38	23.82	23.63	22.10	23.22	27.88	29.43	31.68	26.44	21.64	32.05	35.05		
Forecasted Load (GW)	52.2	51.4	51.1	51.8	54.3	57.8	62.7	66.4	68.0	68.5	68.2	67.8	67.3	66.3	65.5	64.8	64.3	64.3	65.4	66.9	63.9	59.7	56.6					
Forecast Error %	-2.0%	-2.3%	-2.3%	-2.0%	-1.4%	0.6%	0.5%	-0.5%	-1.1%	-1.0%	-0.6%	-0.2%	-0.1%	-0.1%	0.1%	0.2%	0.5%	0.8%	0.1%	-1.1%	-1.5%	0.4%	-10.9%					

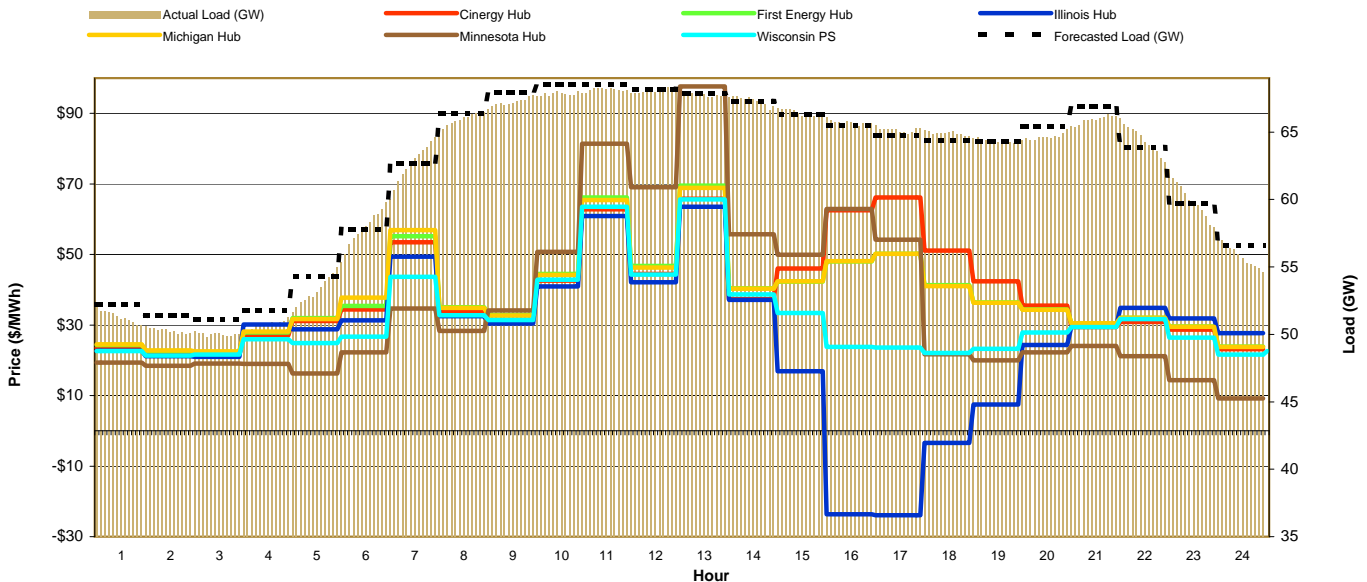




MISO Daily Report

Wednesday May 18, 2011

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	24.80	24.06	23.81	24.58	26.04	32.40	39.19	39.21	41.00	39.32	40.52	39.32	39.59	43.37	40.62	38.41	37.78	34.80	33.61	36.82	39.34	32.98	28.43	25.74	34.41	37.82
First Energy Hub	25.21	24.10	23.85	24.82	26.61	33.46	39.80	39.67	41.61	42.38	43.39	42.63	40.16	44.47	41.32	39.59	38.02	34.60	33.16	36.28	38.89	32.50	28.71	25.61	35.04	38.59
Illinois Hub	19.75	18.76	18.35	19.15	21.10	29.51	34.56	32.62	40.04	38.52	39.68	38.52	38.69	39.28	34.70	36.62	31.76	29.38	26.60	28.78	32.28	26.35	22.47	17.51	29.79	33.52
Michigan Hub	25.52	24.34	24.11	25.21	26.99	33.86	40.29	40.23	42.79	40.83	41.65	40.76	41.89	44.42	41.21	39.60	37.89	34.37	32.91	36.03	38.46	32.14	29.35	26.25	35.05	38.41
Minnesota Hub	11.54	6.08	6.07	6.09	11.64	16.69	23.02	31.45	36.49	35.17	36.25	35.16	35.25	33.92	28.86	26.99	25.95	25.13	24.87	26.76	33.42	27.65	21.44	17.95	24.33	30.30
Wisconsin PS	21.15	20.92	20.40	20.87	21.68	28.44	36.00	36.67	41.55	40.12	41.35	40.12	40.16	40.14	35.59	33.69	32.73	31.27	30.50	33.07	38.59	32.06	25.85	22.28	31.88	35.84
Cleared Load (GW)	51.6	50.3	49.6	50.4	53.9	60.4	65.0	66.9	67.3	68.0	68.1	68.2	68.1	67.4	66.7	66.1	65.5	65.2	64.9	65.5	67.3	64.3	57.3	5.3		

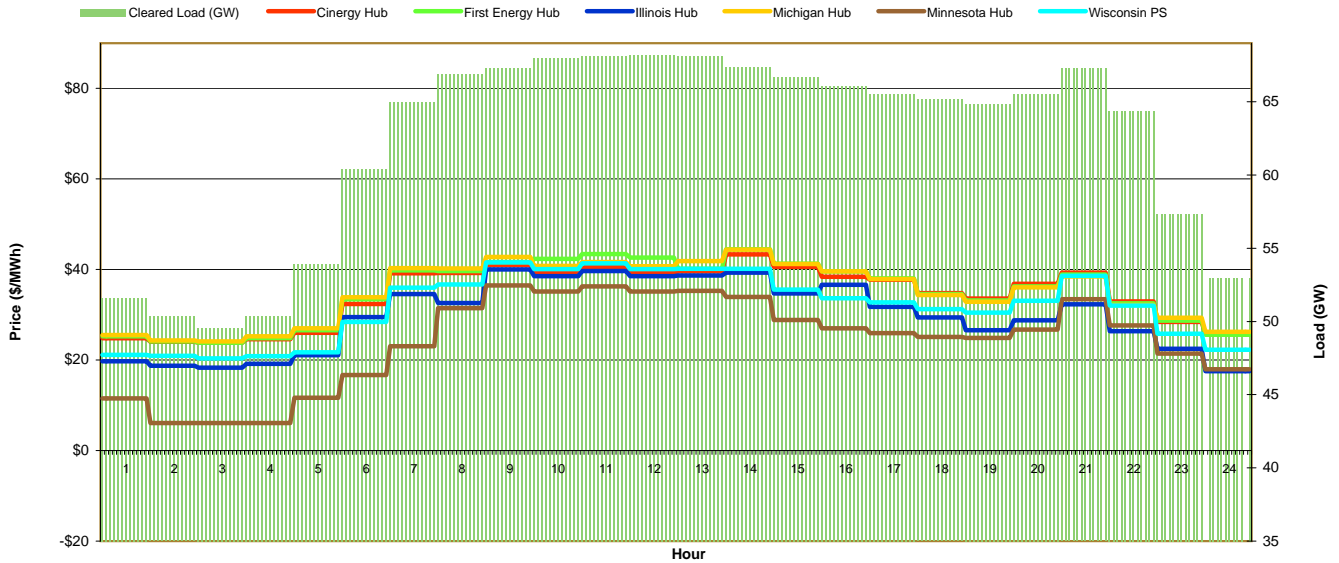

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	17.24	24.95	23.79	25.09	32.18	26.85	62.14	63.34	31.20	68.78	37.38	33.19	45.90	56.29	34.61	56.28	37.95	30.86	31.25	29.91	32.12	27.38	22.97	27.69	36.64	39.96
First Energy Hub	14.51	18.74	19.88	22.21	30.05	26.66	64.17	65.85	32.55	71.32	39.21	34.76	48.09	59.14	36.21	58.99	39.74	32.15	32.29	31.22	33.55	28.54	23.75	22.08	36.90	41.71
Illinois Hub	-0.47	-15.53	7.12	9.07	16.19	23.04	59.99	61.63	30.45	66.81	42.11	35.69	44.85	54.93	33.79	54.83	36.90	29.57	30.32	38.83	32.93	26.70	33.18	-1.94	31.29	40.85
Michigan Hub	14.57	25.64	19.95	22.28	36.04	27.30	64.52	66.05	32.60	70.92	38.75	34.37	47.76	58.92	36.25	59.06	39.79	32.08	31.98	31.44	33.60	28.80	24.15	21.74	37.44	41.66
Minnesota Hub	2.58	-0.68	5.73	13.07	15.90	17.02	54.72	59.10	29.33	64.95	35.67	31.82	43.51	85.00	37.27	69.59	39.07	25.87	24.67	19.53	28.20	45.89	30.28	20.69	33.28	41.86
Wisconsin PS	14.37	1.46	13.64	16.46	16.37	23.73	63.26	65.67	32.54	71.31	39.21	35.00	48.13	59.12	35.95	58.16	39.08	30.62	27.28	30.76	33.43	29.11	23.81	6.77	33.97	41.20
Forecasted Load (GW)	54.7	53.6	53.1	53.5	55.9	60.0	63.9	66.7	67.7	67.9	68.0	67.8	67.5	67.2	66.4	65.5	64.8	64.1	63.7	64.7	66.3	63.7	59.7	56.6		
Forecast Error %	-2.3%	-2.7%	-3.0%	-2.5%	-2.8%	-2.1%	-0.7%	-0.6%	-0.7%	0.0%	0.3%	0.6%	0.8%	0.4%	0.7%	1.3%	1.7%	2.0%	2.0%	0.8%	-0.5%	0.7%	-0.5%	-1.6%		

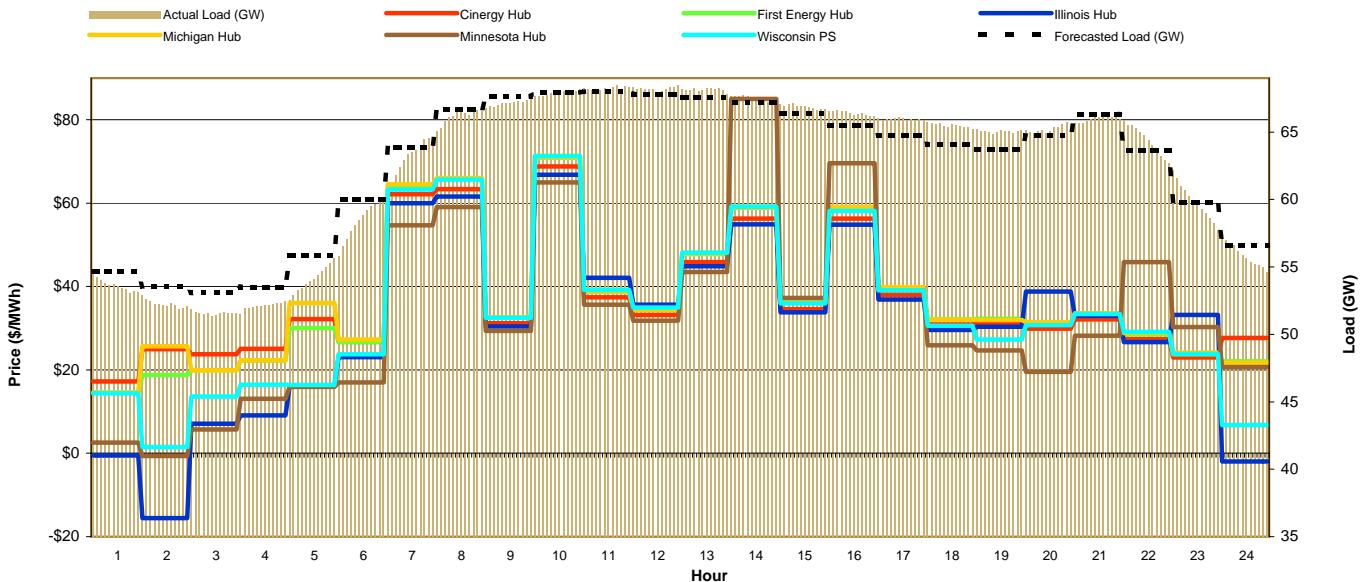




MISO Daily Report

Thursday May 19, 2011

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	23.24	22.66	22.08	22.39	24.73	31.56	41.36	38.82	40.70	43.95	42.82	43.08	42.47	42.16	44.88	44.43	44.30	34.27	31.50	33.12	39.95	32.43	27.60	24.50	34.96	39.16
First Energy Hub	23.65	23.30	22.70	23.08	25.92	31.21	40.58	38.25	40.50	43.68	42.64	42.98	42.34	42.00	44.24	43.78	43.37	34.42	31.72	33.25	40.12	32.71	28.15	24.85	34.98	39.01
Illinois Hub	12.00	11.95	12.00	11.83	13.52	20.41	27.68	30.20	37.63	39.95	38.69	40.24	39.07	38.83	39.22	38.02	31.18	31.78	32.03	33.41	43.59	35.75	29.10	26.23	29.76	36.17
Michigan Hub	25.10	24.82	24.04	24.61	28.41	31.29	40.35	37.73	40.73	43.67	43.03	43.24	42.84	42.61	44.07	43.80	42.92	33.87	31.23	32.74	39.51	32.29	28.20	24.93	35.25	38.91
Minnesota Hub	13.09	12.46	11.63	11.52	13.26	18.26	23.37	26.82	31.52	36.83	34.99	33.88	31.18	31.25	30.30	30.32	29.00	27.03	25.25	24.68	26.32	25.05	18.41	10.95	24.06	28.93
Wisconsin PS	19.39	18.71	18.23	18.30	19.92	27.03	34.38	35.83	38.74	41.11	40.21	40.49	39.93	39.88	40.07	38.61	37.16	33.05	30.75	32.20	38.87	32.84	26.75	21.29	31.82	36.65
Cleared Load (GW)	52.1	50.8	50.0	51.0	53.9	59.6	64.2	66.4	66.8	67.9	68.1	68.2	68.0	67.2	66.9	66.5	65.8	65.1	64.4	65.1	66.7	63.5	58.6	5.4		

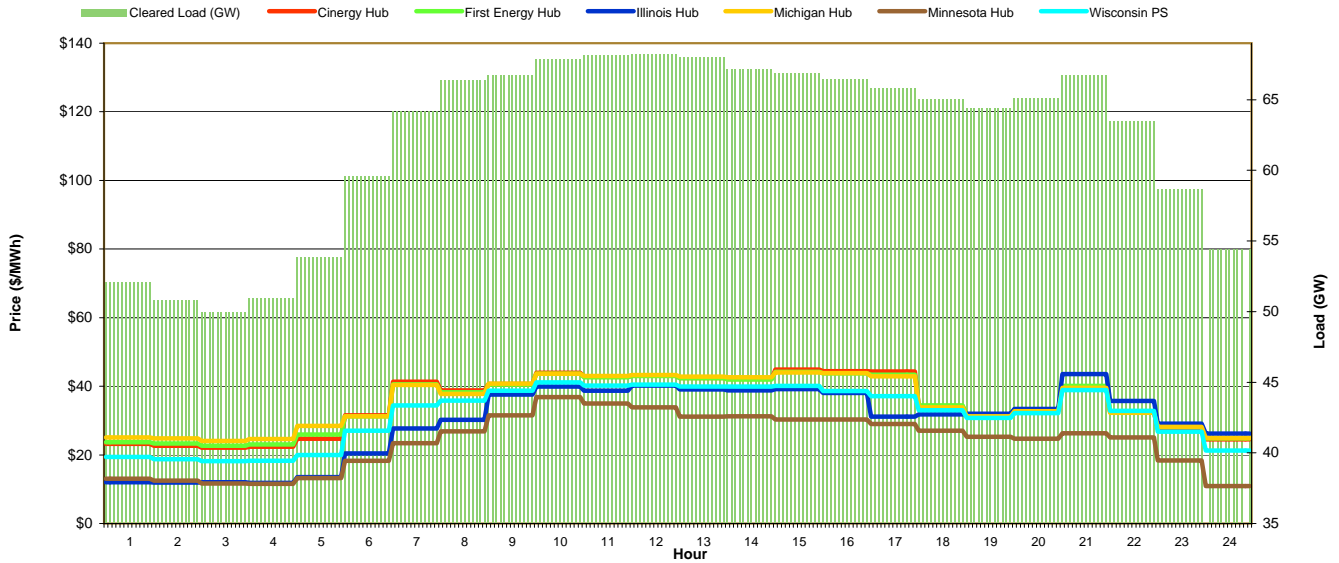

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	25.21	26.09	27.66	28.12	31.70	28.43	28.84	83.42	33.27	40.17	29.00	32.81	36.80	43.71	130.82	30.06	36.43	26.72	25.09	26.66	34.03	26.76	30.83	22.94	36.90	41.66
First Energy Hub	23.05	20.84	21.21	25.76	28.95	25.64	29.95	86.01	35.02	42.40	30.35	34.50	38.78	45.81	136.60	31.28	37.77	27.82	26.04	27.73	35.45	27.79	31.52	23.53	37.24	43.43
Illinois Hub	13.44	3.00	1.10	15.67	17.03	6.24	28.06	82.70	32.18	38.98	28.21	31.88	35.81	42.64	127.65	38.23	49.08	33.80	29.79	44.53	38.74	26.18	41.52	22.17	34.53	45.12
Michigan Hub	23.19	21.11	21.47	25.88	29.16	25.82	30.37	86.52	35.22	42.55	30.46	34.46	38.75	46.22	138.33	31.65	38.20	28.30	26.49	28.19	35.89	28.23	31.94	23.80	37.59	43.84
Minnesota Hub	23.52	22.40	20.44	14.77	17.82	24.65	41.67	82.92	39.22	73.28	51.44	78.39	68.20	61.11	139.37	29.77	28.05	42.33	19.84	21.01	30.93	36.33	15.32	18.96	41.74	51.09
Wisconsin PS	16.98	13.05	11.71	19.40	21.83	17.50	29.12	78.80	34.08	41.57	30.27	34.61	38.21	44.11	120.68	30.83	25.36	29.19	25.49	28.75	35.67	28.66	29.71	22.28	33.66	41.00
Forecasted Load (GW)	54.0	52.8	52.2	52.6	54.7	58.4	62.5	65.6	66.9	67.8	68.3	68.6	68.7	68.6	68.2	67.6	67.0	66.3	65.7	65.8	66.6	64.0	60.7	56.4		
Forecast Error %	-1.5%	-1.8%	-2.1%	-2.3%	-2.0%	0.3%	0.2%	-0.3%	-0.4%	-0.5%	-1.0%	-1.2%	-1.3%	-1.8%	-1.4%	-1.0%	-0.9%	-0.5%	-0.3%	-0.2%	0.4%	-1.8%	-1.1%			

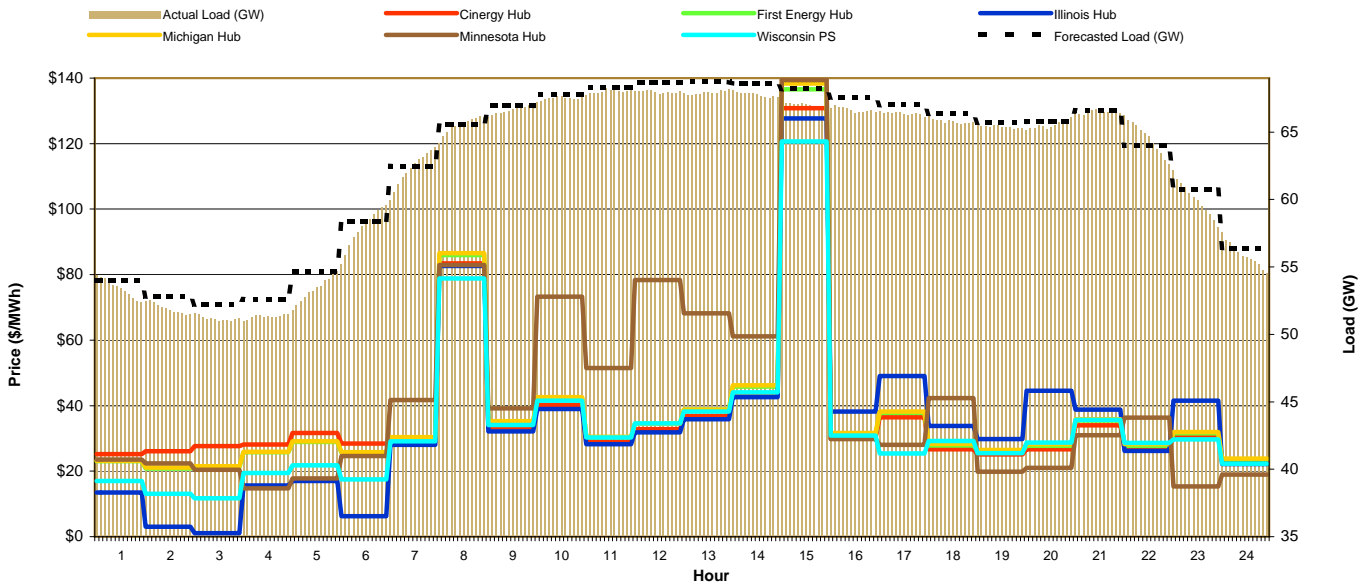




MISO Daily Report

Friday May 20, 2011

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$	
																									All	On Pk
Cinergy Hub	22.59	21.97	21.61	22.03	24.63	29.51	38.25	41.73	44.23	45.44	45.39	44.29	43.49	42.43	43.73	43.31	42.73	38.66	32.87	33.86	37.87	35.68	28.62	25.46	35.43	40.27
First Energy Hub	23.31	22.71	22.72	22.78	25.90	30.05	38.31	41.69	44.26	47.52	50.18	48.09	45.74	44.99	44.07	44.06	43.11	39.11	33.23	34.24	38.30	36.09	29.30	25.91	36.49	41.50
Illinois Hub	18.71	17.20	16.71	17.20	19.91	25.78	37.30	41.02	42.16	44.05	45.23	44.00	43.80	43.44	43.12	42.87	42.20	37.79	33.67	34.81	41.89	35.84	27.66	24.77	34.21	40.22
Michigan Hub	24.09	23.61	23.87	23.70	27.78	30.30	38.04	41.09	43.75	44.22	43.31	42.86	42.96	42.40	43.98	43.63	43.36	39.00	33.01	34.05	38.03	35.98	29.56	26.25	35.78	40.07
Minnesota Hub	12.87	8.57	8.35	7.67	8.48	16.28	24.02	29.60	31.36	38.00	41.70	42.55	42.68	38.32	37.86	35.00	31.50	27.65	26.36	26.36	30.26	24.74	20.26	12.65	25.96	32.76
Wisconsin PS	17.00	13.72	12.92	13.44	16.18	22.41	31.80	36.88	37.17	40.38	42.56	42.49	41.93	40.36	39.88	38.88	37.65	33.31	30.62	30.90	35.27	30.95	24.40	19.65	30.45	36.47
Cleared Load (GW)	50.5	49.5	48.5	49.1	52.0	58.0	64.6	66.7	67.6	68.2	69.4	69.3	70.0	69.1	68.6	68.4	67.8	67.0	65.9	66.4	68.1	64.2	58.5	5.4		

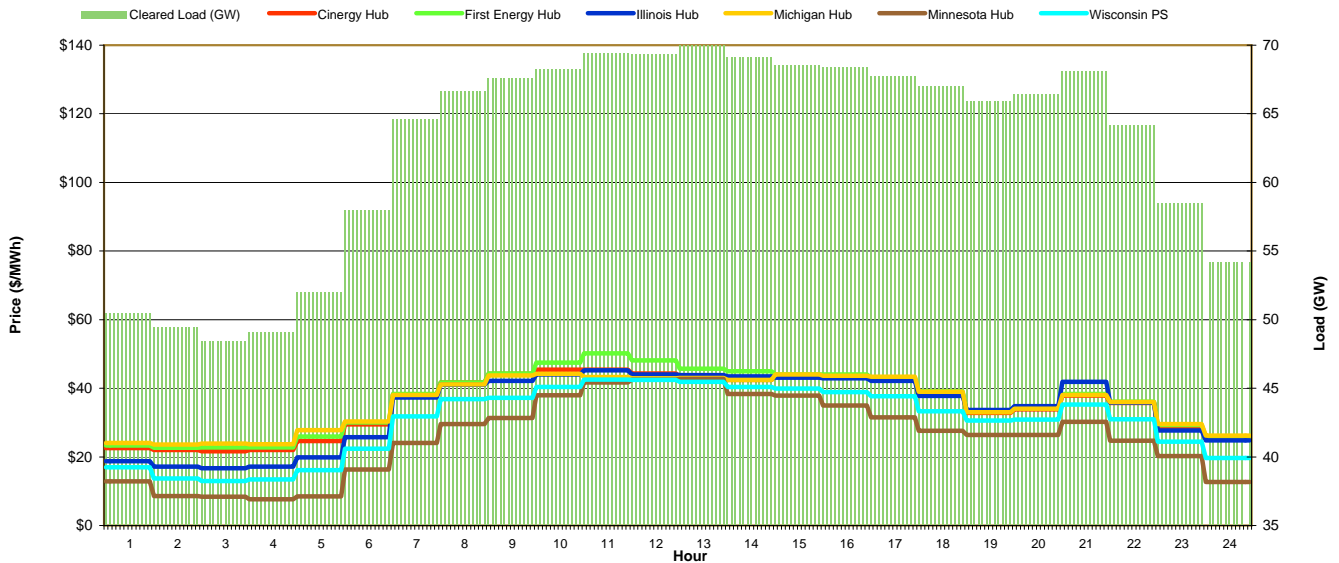

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$	
																									All	On Pk
Cinergy Hub	19.80	19.77	20.68	22.85	24.42	28.10	38.55	39.81	66.84	35.11	34.81	37.82	53.61	38.33	129.04	33.72	38.43	50.22	34.29	33.15	31.33	33.67	37.04	24.45	38.58	45.45
First Energy Hub	20.37	20.30	21.11	23.28	24.87	28.63	39.75	41.26	69.63	36.55	36.13	39.18	55.17	39.57	132.58	34.69	39.37	51.46	35.04	33.99	32.39	34.31	37.99	25.04	39.69	46.83
Illinois Hub	19.30	27.75	20.06	26.90	22.12	25.20	36.75	38.23	64.75	34.10	33.39	35.57	48.51	35.79	118.43	31.89	35.91	47.47	32.15	30.96	30.19	30.15	34.28	21.73	36.73	42.61
Michigan Hub	20.58	20.46	21.10	23.27	24.86	28.82	40.28	41.68	70.41	36.73	36.08	38.75	53.67	38.76	130.02	34.42	38.98	51.27	34.80	33.68	32.49	33.61	37.63	24.49	39.45	46.44
Minnesota Hub	20.02	14.58	15.10	12.45	16.91	22.11	31.84	49.95	118.73	35.62	28.79	45.30	21.18	23.97	52.98	24.07	24.33	36.63	23.91	22.50	41.32	10.63	16.96	15.13	30.21	36.05
Wisconsin PS	20.17	20.25	19.08	20.91	21.65	26.20	37.34	40.88	72.71	35.72	33.25	34.55	38.87	32.53	100.02	29.97	32.44	44.40	30.21	28.98	32.89	23.39	30.61	17.27	34.34	40.09
Forecasted Load (GW)	54.0	52.5	51.8	52.2	54.1	57.9	61.7	64.9	66.4	67.5	68.3	68.6	68.7	68.2	67.6	67.2	66.5	66.1	66.0	66.1	67.1	65.0	60.9	57.2		
Forecast Error %	-1.7%	-1.6%	-1.9%	-2.0%	-1.6%	-0.1%	1.1%	1.4%	1.2%	1.2%	0.6%	0.4%	0.6%	1.1%	1.3%	0.7%	0.9%	0.0%	-0.9%	-1.0%	-0.1%	0.1%	-0.7%	-1.6%		

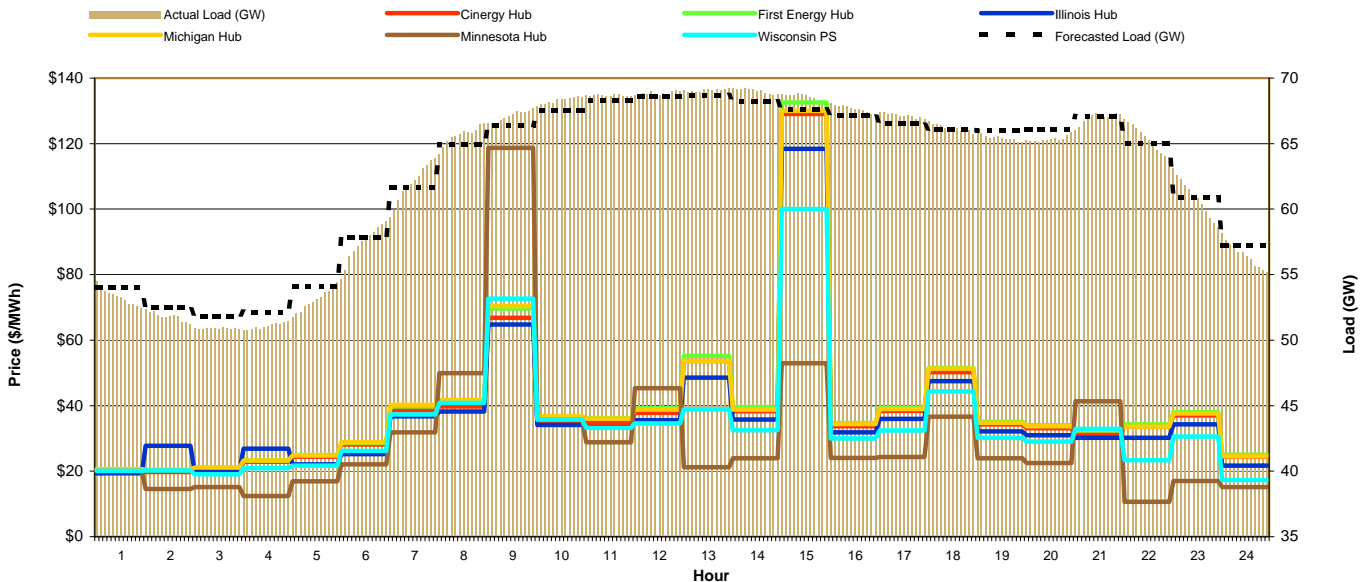




MISO Daily Report

Saturday May 21, 2011

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	25.60	24.70	23.66	24.16	23.91	24.80	26.07	29.80	35.18	42.29	41.96	42.45	39.57	39.27	41.94	42.82	43.10	42.64	36.94	41.61	45.90	35.14	30.78	27.43	34.66	39.46
First Energy Hub	27.12	26.22	25.02	25.59	25.63	26.39	27.34	32.10	39.36	45.54	46.68	45.82	43.34	42.60	45.42	46.19	49.15	47.45	38.26	46.44	51.47	36.46	31.70	27.94	37.47	43.00
Illinois Hub	22.88	22.55	21.97	21.56	21.59	25.84	26.52	31.56	36.36	40.00	39.11	40.51	39.83	39.80	41.90	42.73	44.43	43.56	38.22	40.16	43.09	37.56	33.49	27.53	34.28	39.52
Michigan Hub	24.25	23.86	22.35	22.93	23.16	22.98	26.38	30.07	34.60	42.40	41.48	42.90	39.60	39.71	42.50	43.26	42.65	42.25	38.09	40.96	44.90	36.30	30.27	28.08	34.41	39.50
Minnesota Hub	13.17	10.30	8.12	7.53	9.55	12.80	19.68	23.00	26.61	29.96	34.08	35.50	32.39	31.59	31.69	31.89	32.67	33.86	29.77	32.43	35.65	27.79	21.64	20.20	24.66	30.66
Wisconsin PS	19.73	17.92	16.18	16.13	17.50	19.64	23.82	28.65	33.30	37.05	39.55	40.78	38.42	37.96	39.00	39.40	41.07	41.28	36.16	39.60	43.22	34.71	29.35	24.93	31.47	37.47
Cleared Load (GW)	50.8	49.7	48.8	49.1	52.5	57.3	63.8	66.3	67.9	69.2	70.1	70.6	71.2	71.0	70.1	69.9	69.1	67.9	66.4	66.4	67.9	63.8	57.0	53		

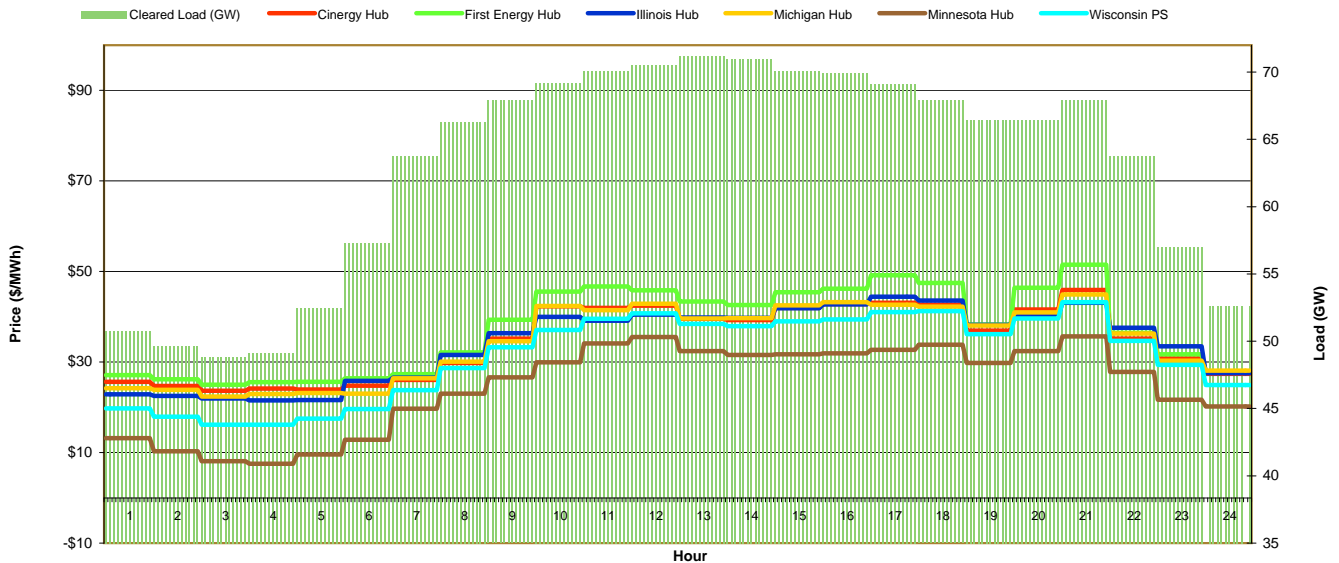

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	27.24	27.59	24.33	24.19	23.91	21.52	31.09	28.28	61.41	36.88	31.03	31.80	57.97	59.73	45.08	37.13	37.14	59.88	59.75	42.09	49.04	32.57	28.58	58.09	39.01	43.65
First Energy Hub	28.11	28.44	24.69	24.91	24.70	22.30	32.02	29.37	63.84	38.41	32.25	33.09	60.08	62.17	46.70	38.60	38.62	62.12	61.87	43.66	51.00	33.72	29.55	59.99	40.43	45.32
Illinois Hub	25.73	35.60	21.87	35.09	29.14	21.02	34.74	27.04	63.94	35.73	30.42	30.77	80.81	91.15	70.66	44.12	43.02	70.71	64.95	50.56	47.64	40.29	28.28	56.38	44.99	51.26
Michigan Hub	28.05	28.52	23.90	25.09	24.85	22.23	31.94	29.41	63.94	38.29	32.13	32.93	59.96	61.99	46.59	38.41	38.43	62.08	61.78	43.58	50.92	33.80	29.64	60.27	40.36	45.24
Minnesota Hub	22.44	16.08	-0.39	13.12	17.48	20.00	22.48	26.33	53.97	34.74	26.29	30.12	29.57	19.61	17.56	25.04	26.94	35.82	43.68	25.44	43.97	21.93	25.60	51.80	27.07	30.41
Wisconsin PS	24.96	26.57	12.66	24.06	23.88	21.59	29.99	28.42	62.12	37.24	30.53	30.93	40.96	28.15	35.76	28.30	31.46	32.02	48.70	31.10	45.01	29.03	27.98	57.85	32.88	35.48
Forecasted Load (GW)	54.8	53.2	52.4	52.5	54.3	57.6	61.6	65.0	66.9	68.3	69.3	70.1	70.6	71.0	70.8	70.4	70.0	69.0	67.7	66.8	67.4	65.3	60.6	57.4		
Forecast Error %	-2.8%	-3.1%	-3.2%	-3.1%	-2.8%	-1.4%	-0.2%	0.4%	0.4%	0.3%	0.3%	0.2%	-0.2%	-0.2%	-0.5%	-1.0%	-1.5%	-1.7%	-2.1%	-1.5%	-0.6%	-0.3%	-0.1%	-1.6%		

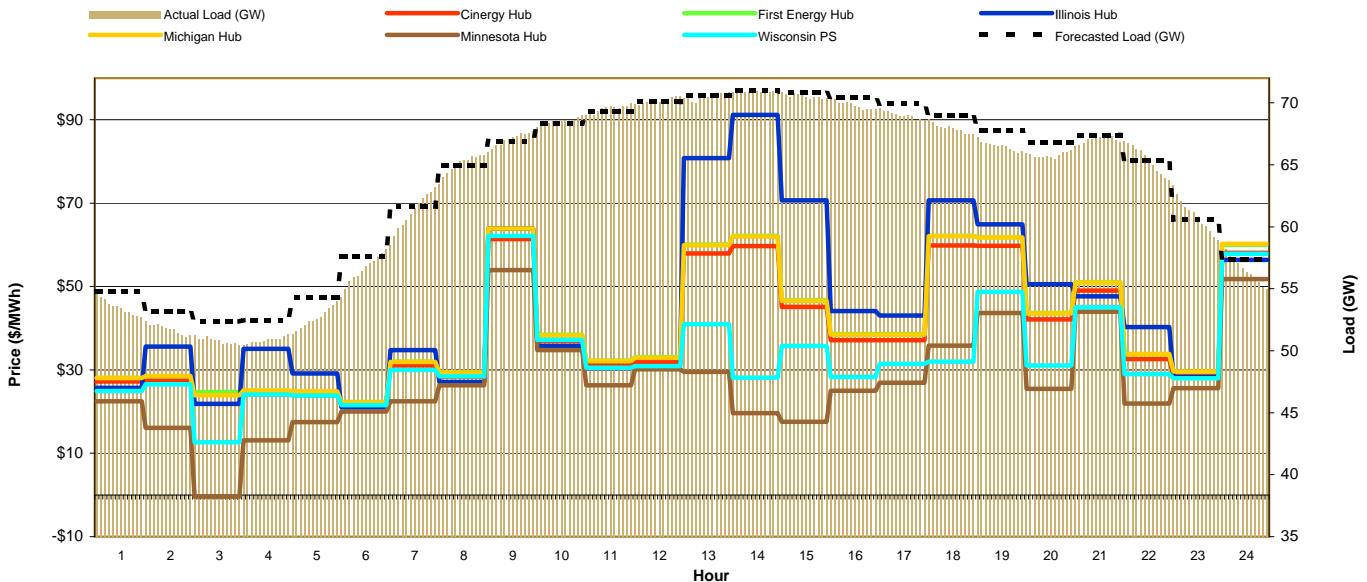




MISO Daily Report

Sunday May 22, 2011

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	24.94	23.85	22.81	22.58	21.96	20.37	23.63	26.60	32.35	34.00	34.72	38.88	41.51	45.00	44.39	45.40	45.73	44.47	42.67	48.68	45.92	36.80	30.73	29.52	34.48	39.87
First Energy Hub	26.96	25.35	24.27	24.03	23.53	22.14	24.89	27.65	36.97	38.67	40.23	40.52	43.23	46.87	47.86	51.57	52.59	49.35	46.33	50.66	50.37	38.94	31.75	30.27	37.29	43.35
Illinois Hub	29.98	28.70	29.32	28.99	27.98	27.97	31.52	30.89	38.17	43.18	44.43	51.14	56.71	60.90	59.53	61.35	64.92	60.26	57.90	67.09	60.44	46.56	38.79	36.01	45.11	52.64
Michigan Hub	24.15	22.24	21.02	20.54	19.37	17.18	23.00	27.17	31.67	33.90	34.25	40.55	43.28	46.58	45.15	44.93	44.87	44.65	43.32	50.55	46.67	38.13	30.93	29.39	34.31	40.41
Minnesota Hub	15.16	13.17	9.64	8.28	8.33	8.53	13.09	20.21	23.75	26.03	27.51	29.93	29.23	28.34	25.66	25.77	26.75	26.99	26.85	31.56	33.74	29.62	22.37	18.59	22.05	27.14
Wisconsin PS	23.23	21.34	19.67	18.71	18.26	18.62	22.73	26.19	31.75	34.85	35.70	39.98	42.64	44.70	43.35	44.34	46.03	43.98	41.97	48.51	47.07	37.84	30.89	28.38	33.78	39.98
Cleared Load (GW)	49.4	47.6	46.8	47.0	47.6	49.3	52.7	56.2	58.9	61.6	62.6	62.9	63.1	63.2	63.5	63.7	64.8	63.5	62.3	62.2	63.4	60.8	55.4	5.2		

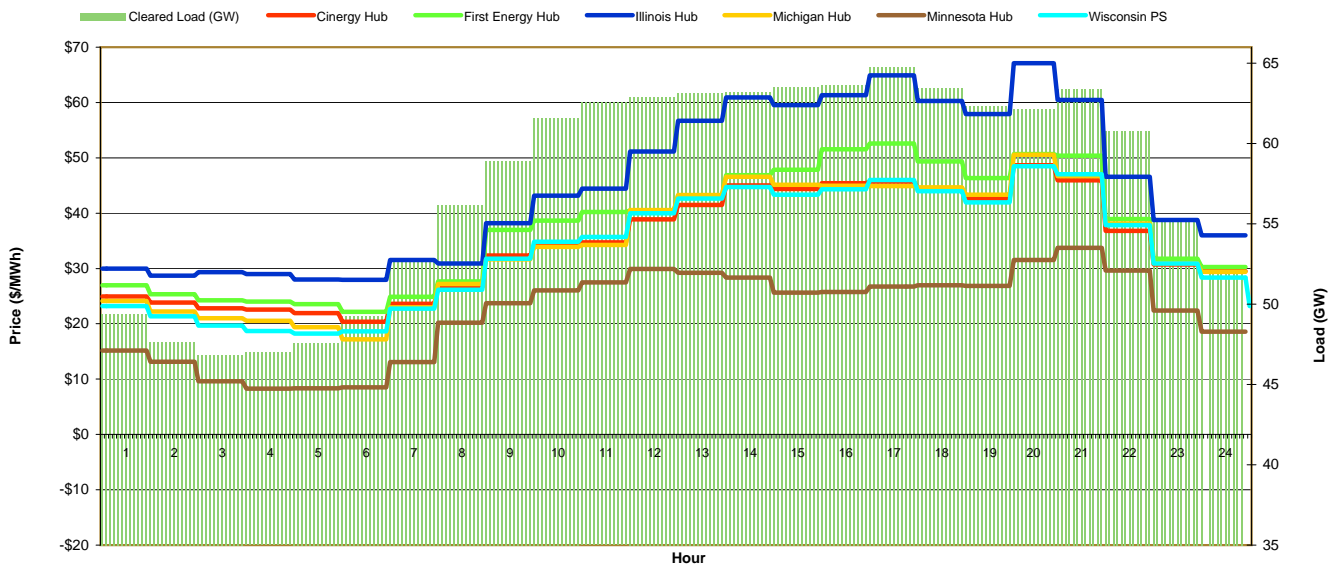

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	30.48	26.22	22.37	19.95	26.86	18.66	30.05	27.25	47.28	35.28	66.78	36.06	44.82	39.38	67.18	34.33	31.26	41.88	29.85	33.06	34.89	29.23	25.75	26.75	34.40	39.02
First Energy Hub	31.33	26.95	23.05	19.95	27.52	18.64	30.81	28.02	48.65	36.11	68.35	37.30	43.81	38.48	66.41	34.60	28.41	43.02	30.95	34.35	36.49	30.71	26.94	27.60	34.94	39.54
Illinois Hub	28.33	24.41	21.43	22.21	26.43	22.27	34.18	27.12	57.58	31.51	58.84	33.45	42.64	33.36	55.47	29.47	26.82	37.84	29.40	31.02	33.03	28.47	25.09	29.26	34.15	36.32
Michigan Hub	31.06	26.75	23.13	20.74	27.81	17.75	30.84	28.18	49.20	35.52	66.59	36.98	44.03	37.42	63.74	33.33	28.37	41.95	30.85	33.97	36.16	30.87	27.20	28.11	34.61	39.02
Minnesota Hub	17.67	15.76	17.78	-16.40	4.88	-17.37	15.52	22.44	32.27	10.51	15.86	32.66	15.70	8.19	-1.01	5.03	18.17	11.09	22.91	21.75	25.58	27.57	23.65	14.88	14.38	18.27
Wisconsin PS	25.24	21.95	21.03	19.76	27.26	6.09	27.80	26.27	47.95	23.53	41.52	30.18	42.17	23.70	32.28	19.72	27.41	29.89	28.33	28.11	30.81	29.04	25.28	26.19	27.56	30.38
Forecasted Load (GW)	54.4	52.3	51.0	50.5	50.7	51.4	53.1	55.6	58.0	60.3	61.7	62.7	63.1	63.5	63.7	64.1	64.4	64.1	63.4	62.8	63.5	61.9	58.4	55.2		
Forecast Error %	-2.2%	-2.1%	-2.3%	-2.2%	-2.1%	-1.7%	-1.3%	0.5%	2.2%	2.3%	2.5%	2.2%	2.0%	1.6%	1.2%	1.2%	1.0%	1.1%	1.6%	2.0%	2.0%	1.9%	1.3%	-8.9%		

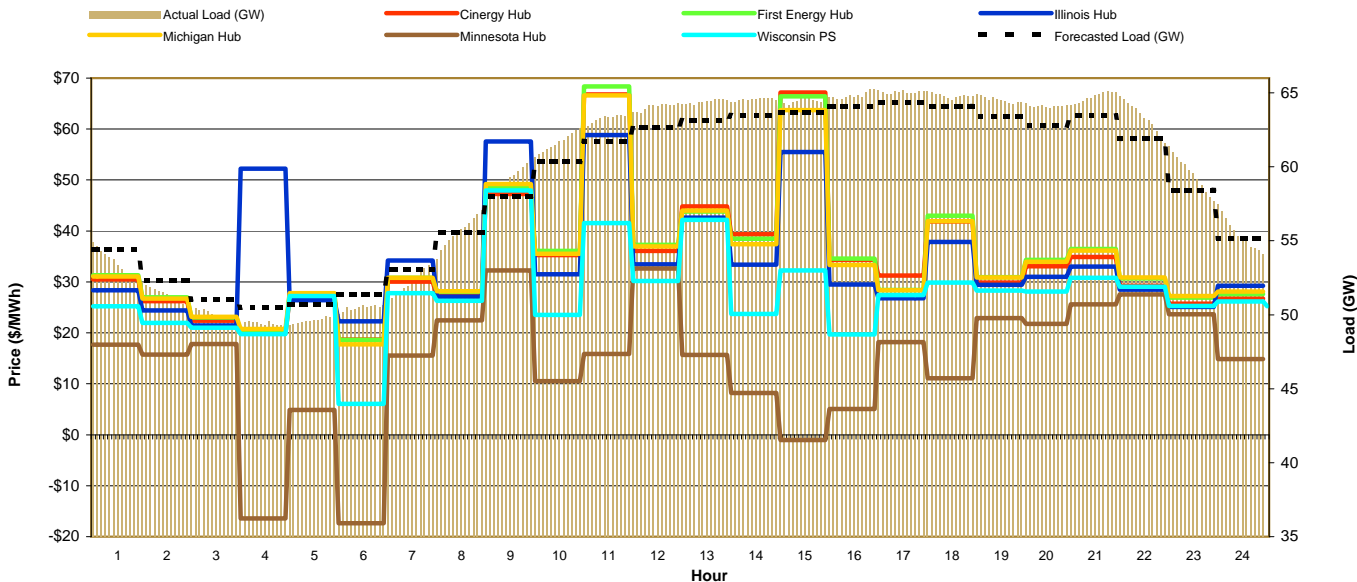




MISO Daily Report

Monday May 23, 2011

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	26.49	24.97	24.84	25.93	26.61	32.93	42.30	43.11	47.88	59.51	59.10	60.37	67.42	67.59	67.28	62.79	61.90	53.84	50.15	49.61	49.21	39.66	30.28	27.28	45.88	54.36
First Energy Hub	28.54	26.26	25.93	28.44	32.33	34.20	43.86	46.35	61.05	61.03	62.78	63.66	75.80	73.78	73.47	66.00	64.02	55.90	53.92	54.91	51.39	41.39	31.20	28.21	49.35	58.54
Illinois Hub	29.93	30.32	29.49	29.19	29.61	35.97	46.26	48.22	53.36	68.28	72.21	73.81	84.20	80.89	81.28	78.98	74.22	66.19	64.24	63.41	61.57	49.02	35.21	31.09	54.87	65.94
Michigan Hub	29.22	25.84	25.23	30.09	39.64	34.66	43.45	48.28	46.89	64.64	62.73	63.63	67.97	68.63	68.01	65.15	63.76	55.53	51.28	50.10	50.86	41.11	31.41	28.05	48.17	56.25
Minnesota Hub	12.14	7.78	6.66	5.70	7.63	18.27	27.12	23.45	27.44	30.50	30.16	30.58	32.79	32.88	32.49	32.01	31.30	29.96	28.11	28.37	29.35	25.07	21.26	19.51	23.77	29.11
Wisconsin PS	23.42	21.39	20.63	19.81	21.56	29.91	34.37	30.31	30.26	33.11	34.48	35.86	39.20	36.66	36.24	36.31	32.91	34.22	32.35	33.29	33.91	30.12	28.71	27.25	30.67	33.62
Cleared Load (GW)	47.9	46.4	45.5	45.2	46.0	45.6	48.2	52.6	57.0	59.6	62.3	64.6	65.4	66.1	67.1	68.2	69.5	68.9	68.1	67.8	69.8	66.2	60.9	5.6		

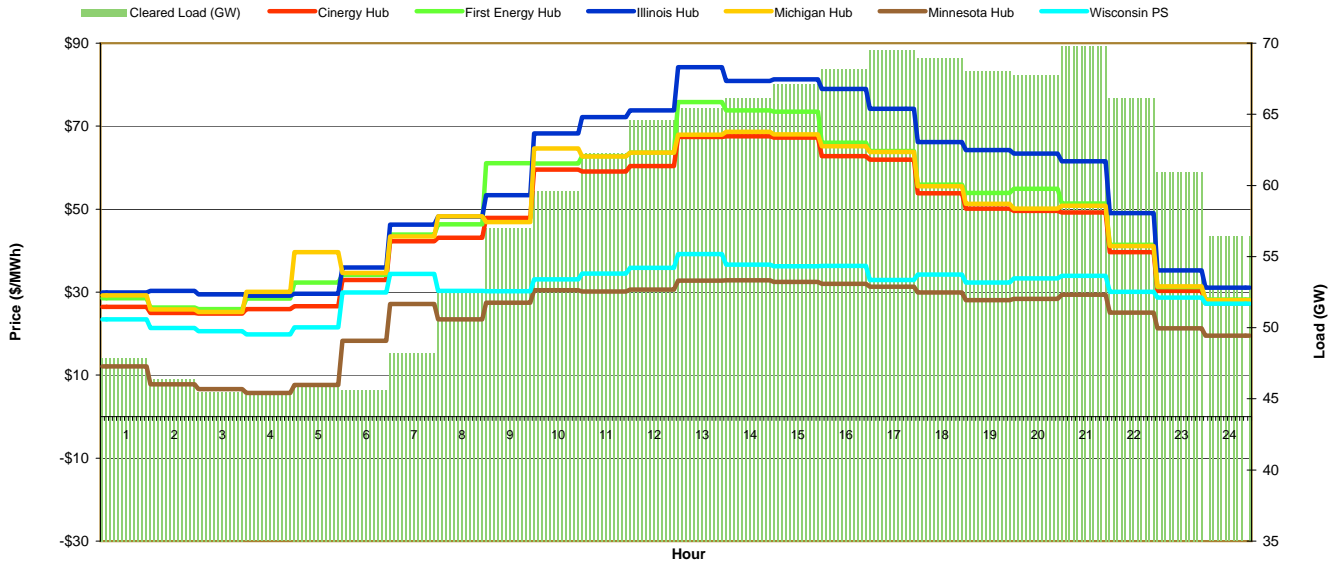

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	22.21	22.86	22.87	22.43	24.18	20.49	25.66	29.87	28.77	34.76	31.37	31.73	37.61	31.54	31.85	30.00	25.88	27.59	25.05	25.55	28.20	23.55	22.79	22.16	26.98	29.04
First Energy Hub	23.00	23.49	23.48	23.06	24.04	21.21	26.80	31.33	30.17	37.33	30.89	33.22	34.46	29.97	31.68	31.07	30.36	29.35	26.73	26.70	28.06	24.77	23.71	23.06	27.83	29.99
Illinois Hub	22.58	23.01	22.09	21.70	18.19	19.67	24.90	29.27	28.26	36.41	30.54	49.69	74.03	28.87	29.62	27.16	27.92	27.57	25.25	25.20	26.55	23.68	22.76	22.01	28.62	32.05
Michigan Hub	23.34	23.68	23.76	23.46	22.78	21.50	27.07	31.42	30.15	38.16	32.11	33.67	34.40	30.72	31.81	31.02	30.30	29.38	26.77	26.68	28.06	25.00	24.27	23.72	28.05	30.25
Minnesota Hub	16.89	14.07	3.72	10.34	-27.80	17.45	21.72	27.89	25.61	19.05	19.97	25.35	29.50	25.29	28.70	27.82	27.11	26.48	24.56	24.60	25.78	23.38	22.16	20.46	20.00	25.20
Wisconsin PS	22.03	19.83	21.51	21.55	4.49	19.89	26.33	30.69	29.46	36.61	31.04	32.40	31.45	30.05	31.01	30.12	29.43	28.64	26.33	26.36	27.82	25.03	23.86	22.81	26.20	29.39
Forecasted Load (GW)	53.2	51.1	49.8	49.2	49.2	49.3	50.5	53.9	56.9	59.1	61.5	63.4	65.0	66.0	66.8	67.5	68.0	68.0	67.7	67.5	68.5	66.4	62.4	58.9		
Forecast Error %	-1.6%	-1.9%	-2.2%	-2.0%	-2.3%	-3.0%	-3.2%	-3.0%	-1.0%	0.6%	1.2%	1.5%	1.3%	0.7%	0.3%	0.1%	0.2%	0.2%	-0.2%	-0.2%	-0.7%	-0.9%	-2.0%	-3.4%		

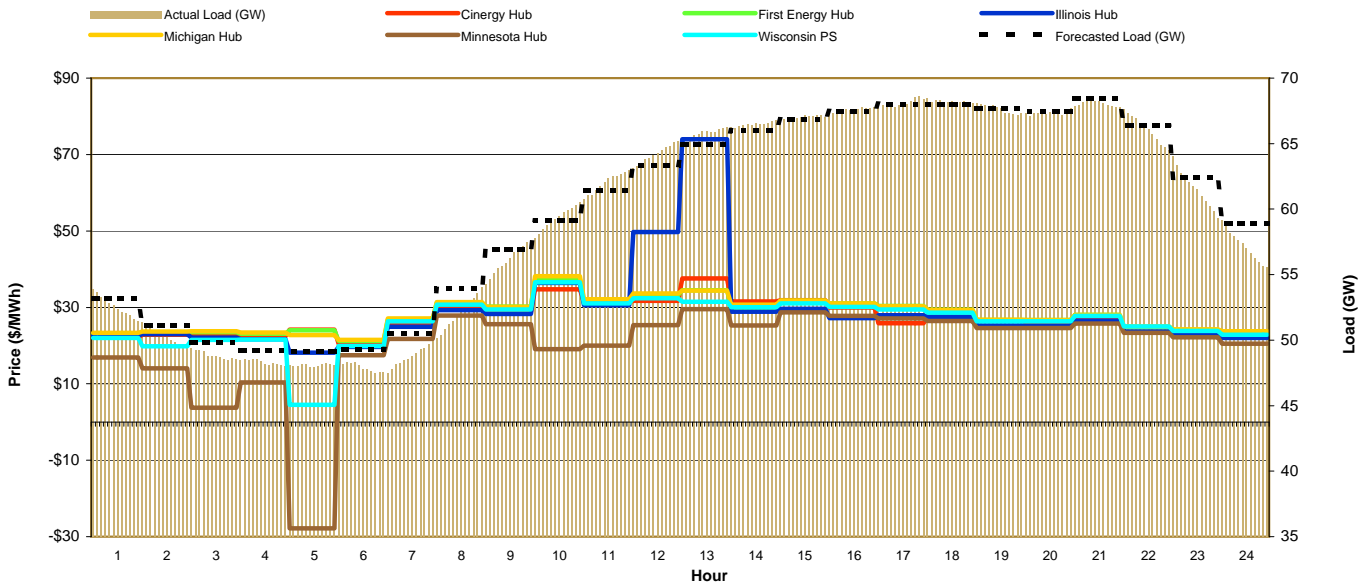




MISO Daily Report

Tuesday May 24, 2011

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	25.00	23.59	22.61	22.68	23.89	27.21	32.89	35.84	39.53	40.56	42.83	42.88	45.78	44.54	44.72	43.46	42.87	40.96	37.63	39.19	42.84	34.62	28.95	26.22	35.47	40.45
First Energy Hub	26.37	24.91	23.79	23.86	25.29	29.51	35.00	38.00	43.69	47.61	50.12	50.36	62.83	52.73	54.00	50.73	50.84	45.84	41.46	44.04	47.45	36.90	31.15	27.52	40.17	46.73
Illinois Hub	22.49	21.23	20.80	20.96	21.47	27.03	36.55	39.12	54.08	55.45	54.10	63.60	69.51	67.34	69.87	60.00	44.20	42.60	38.90	40.46	46.11	38.05	31.25	26.87	42.17	50.92
Michigan Hub	25.56	24.06	22.77	22.84	24.75	30.33	34.81	37.83	41.56	41.41	43.34	44.06	43.17	44.84	44.73	43.90	43.04	42.30	39.19	40.01	44.06	36.06	29.38	27.64	36.32	41.18
Minnesota Hub	17.02	16.10	15.08	14.86	15.05	19.32	25.80	30.04	35.46	36.45	37.42	39.24	41.41	33.06	29.21	26.03	26.39	26.10	24.57	24.98	25.49	23.41	18.66	12.53	25.57	29.87
Wisconsin PS	22.48	21.04	20.31	20.55	21.15	25.51	31.70	35.08	35.14	36.23	39.17	40.01	43.87	37.13	34.72	33.31	34.79	32.81	31.03	31.47	35.69	33.84	26.65	21.64	31.05	35.06
Cleared Load (GW)	54.0	52.3	51.5	52.5	55.4	60.5	68.1	70.8	73.5	75.2	77.1	78.5	79.9	79.9	79.7	79.2	78.5	76.9	75.7	75.1	75.4	71.4	65.2	6.1		

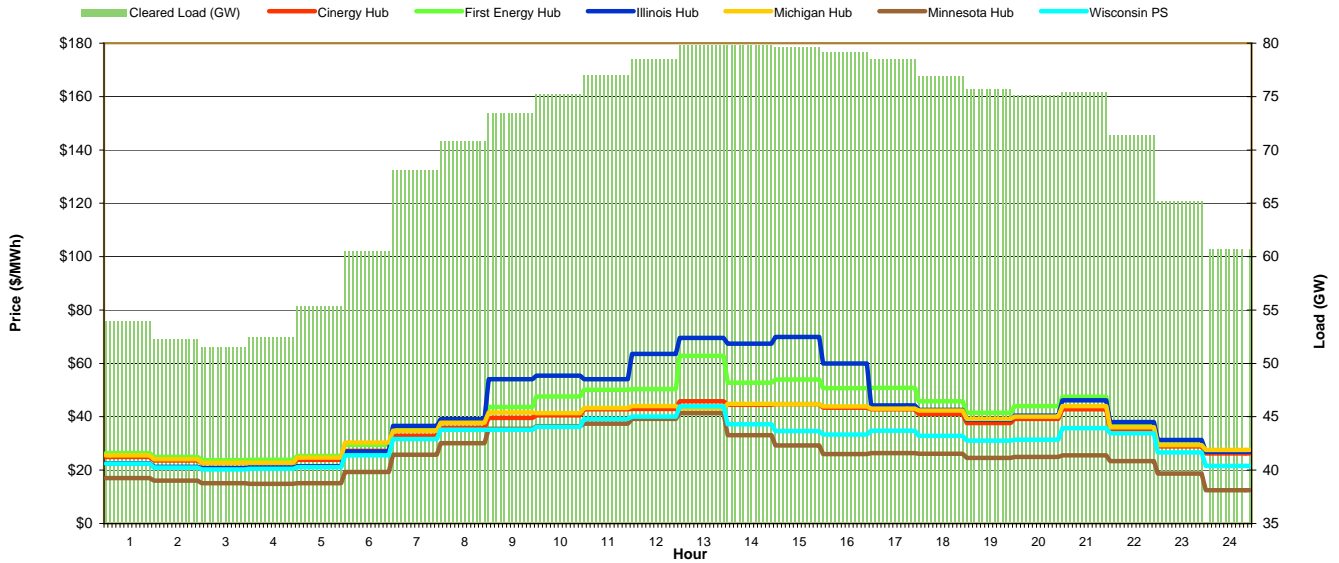

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	17.93	19.49	18.85	19.87	21.31	25.59	27.29	28.17	34.61	41.04	53.45	45.76	158.13	40.36	40.05	64.89	51.71	80.84	44.22	36.14	47.97	31.69	26.95	25.23	41.73	51.62
First Energy Hub	18.59	20.12	19.41	20.50	22.07	26.53	28.50	29.79	36.69	43.65	58.20	48.41	167.21	42.59	42.30	70.98	55.79	84.51	46.03	37.78	49.97	33.02	28.39	26.50	44.06	54.71
Illinois Hub	17.74	19.26	18.65	19.63	20.97	24.85	28.18	28.03	34.24	40.70	54.60	45.48	157.22	40.17	39.43	67.09	51.49	90.16	46.56	35.74	49.30	31.07	26.33	25.75	42.19	52.35
Michigan Hub	19.01	20.60	19.87	20.98	22.56	27.09	29.24	30.47	41.86	60.88	78.26	70.34	179.49	43.44	47.20	71.49	56.30	84.75	46.17	38.55	50.69	33.25	29.02	27.18	47.86	60.14
Minnesota Hub	16.63	17.86	17.25	18.10	18.93	21.52	25.06	27.25	39.93	41.78	53.64	44.48	152.52	37.27	34.30	37.51	14.44	34.42	8.67	24.75	24.26	32.88	25.31	21.86	32.94	39.59
Wisconsin PS	18.48	20.00	19.35	20.42	21.68	25.96	28.20	29.60	36.45	42.57	56.52	46.97	160.83	38.70	33.83	42.25	30.14	49.66	31.61	29.82	37.29	31.91	27.90	25.67	37.74	45.38
Forecasted Load (GW)	56.5	54.7	53.9	54.0	56.2	60.3	64.7	68.9	71.6	74.0	75.9	77.4	78.5	79.0	78.8	78.3	77.5	76.4	75.0	73.9	74.0	71.0	66.0	61.4		
Forecast Error %	-4.7%	-4.8%	-4.6%	-4.7%	-4.5%	-3.5%	-1.8%	-1.6%	-1.4%	-1.5%	-1.7%	-1.9%	-2.6%	-3.0%	-2.8%	-2.9%	-2.8%	-3.7%	-4.5%	-4.9%	-4.3%	-3.3%	-3.9%	-4.2%		

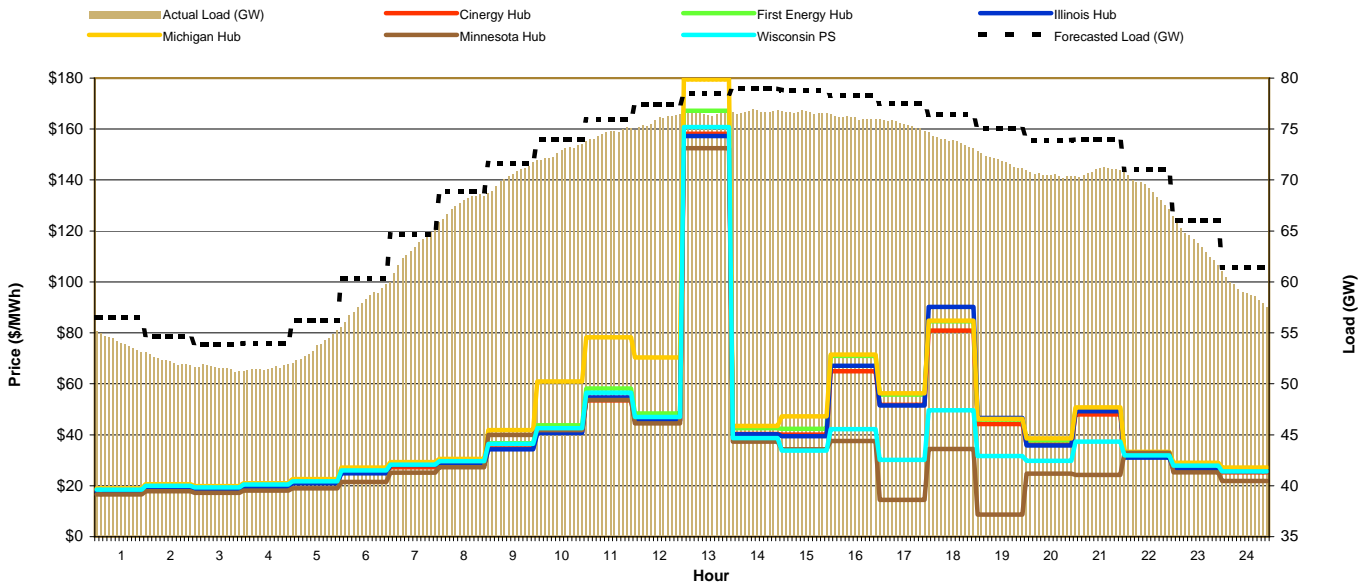




MISO Daily Report

Wednesday May 25, 2011

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	24.57	23.78	23.29	23.84	24.58	29.30	37.56	38.45	39.37	42.76	43.58	44.00	47.72	44.81	47.23	44.01	42.50	41.76	38.79	41.93	40.63	35.12	29.57	26.17	36.47	41.39
First Energy Hub	27.00	26.23	25.01	25.84	27.92	32.14	38.82	40.06	41.35	44.91	48.30	49.45	61.50	51.24	54.80	48.73	53.69	50.91	41.28	44.02	44.33	36.76	31.14	27.70	40.55	46.40
Illinois Hub	23.39	23.01	22.81	23.20	23.26	29.94	42.24	46.98	53.16	51.89	53.79	53.60	58.98	55.97	58.70	52.23	51.29	50.51	47.18	47.44	49.42	44.10	38.24	35.72	43.21	50.84
Michigan Hub	27.35	27.22	25.44	27.65	30.78	36.18	38.80	40.12	44.38	46.51	46.73	47.85	49.86	48.12	51.43	47.29	42.17	42.48	42.74	44.19	41.62	36.83	31.57	29.64	39.46	43.99
Minnesota Hub	6.67	6.59	6.15	5.98	6.61	7.36	23.52	25.01	27.14	26.88	27.33	27.98	29.38	27.24	26.46	25.01	24.07	23.93	23.02	24.32	23.37	14.68	7.89	19.58	24.94	
Wisconsin PS	17.14	16.46	16.36	16.31	17.03	19.71	34.35	36.96	40.12	41.38	42.14	42.53	44.71	43.49	43.41	38.57	36.86	35.62	33.71	37.63	39.39	35.15	29.03	23.48	32.56	38.79
Cleared Load (GW)	55.5	53.5	52.6	52.8	55.3	60.8	66.4	69.4	70.5	71.8	72.8	73.2	73.7	73.8	73.5	72.4	72.1	70.7	69.8	69.8	70.7	67.1	61.5	5.8		

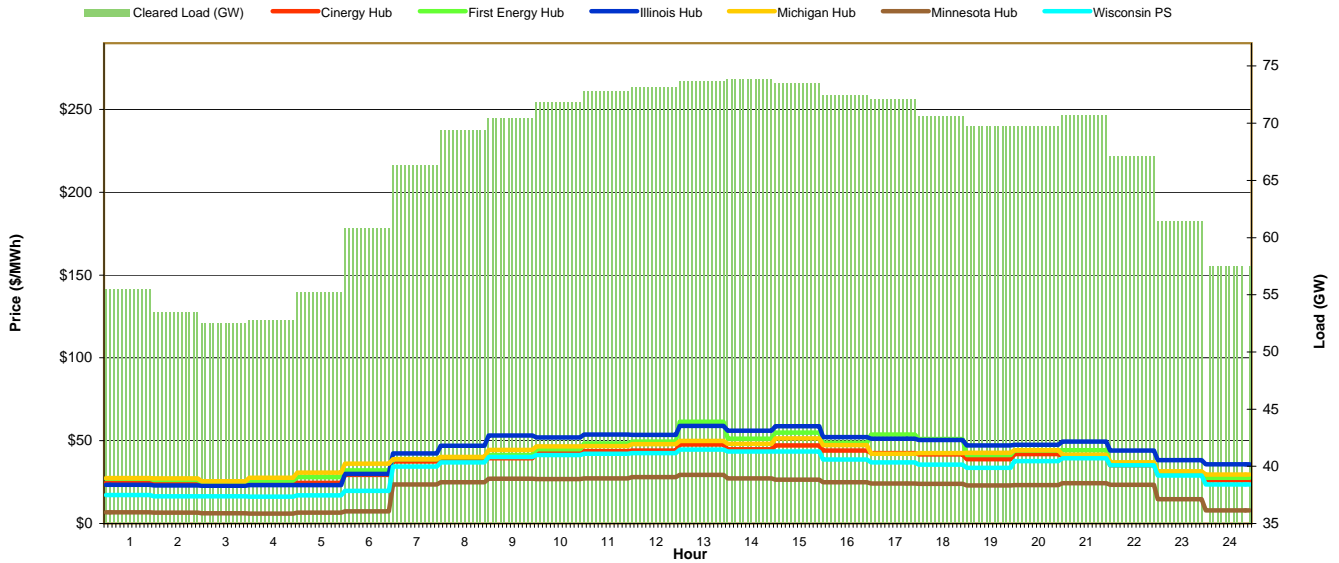

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	24.92	26.27	24.63	25.55	26.71	84.92	25.28	37.55	30.43	50.19	42.98	58.62	76.32	95.25	116.81	76.05	64.48	75.59	71.60	33.83	21.64	28.97	27.50	30.38	49.02	56.74
First Energy Hub	25.87	27.39	25.63	26.59	28.74	88.62	27.44	42.80	34.28	56.99	46.36	63.63	165.54	220.34	286.27	240.33	115.98	91.26	82.03	37.41	28.66	33.61	28.64	37.30	77.57	98.38
Illinois Hub	29.45	33.49	29.04	30.43	24.88	109.01	27.65	39.78	32.31	52.47	52.70	86.35	104.60	133.06	181.59	154.93	97.86	104.13	98.38	56.50	28.08	41.83	37.02	15.17	66.70	81.35
Michigan Hub	26.36	27.85	26.08	27.05	30.93	90.50	33.02	49.68	34.42	57.25	46.51	63.85	45.15	70.74	64.63	33.21	68.07	88.52	85.84	40.15	41.21	36.11	29.05	32.51	47.86	53.40
Minnesota Hub	6.30	11.40	14.07	16.02	13.62	26.42	23.99	23.29	23.61	38.72	19.98	14.45	37.35	36.79	29.81	19.41	14.12	8.05	12.34	14.02	24.55	22.16	16.87	3.39	19.61	22.22
Wisconsin PS	24.89	26.22	24.63	25.43	24.40	84.93	26.84	41.68	33.42	55.65	45.61	61.60	82.61	96.46	124.79	87.48	64.34	38.99	70.87	35.74	27.63	32.57	27.77	17.09	49.23	57.95
Forecasted Load (GW)	57.8	55.7	54.4	54.4	56.3	60.4	64.4	67.2	69.5	71.2	72.7	73.4	73.9	74.0	73.6	73.2	72.6	71.7	70.8	70.1	70.7	68.0	63.4	59.1		
Forecast Error %	-3.9%	-3.9%	-3.8%	-3.8%	-3.6%	-3.5%	-1.6%	0.3%	0.3%	0.6%	0.6%	1.1%	1.9%	2.6%	3.3%	3.8%	4.1%	3.7%	3.0%	2.3%	2.5%	2.5%	1.6%	0.9%		

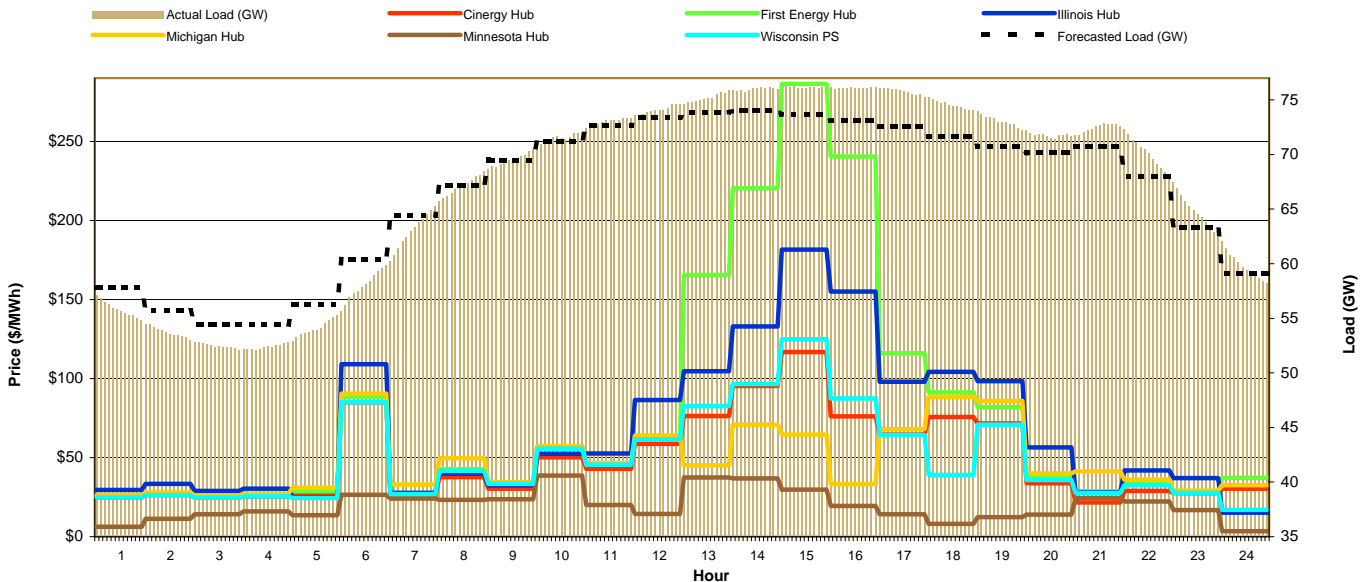




MISO Daily Report

Thursday May 26, 2011

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	25.01	23.66	23.10	23.34	24.83	29.43	36.61	42.20	43.27	44.44	44.73	43.50	48.29	44.73	45.97	41.97	42.49	40.53	37.77	38.79	40.97	35.66	27.86	25.39	36.44	41.45
First Energy Hub	26.42	24.66	23.99	24.37	26.71	31.15	41.14	51.13	50.46	51.35	52.89	55.94	68.15	59.63	55.21	49.13	56.02	46.28	39.58	40.57	44.77	38.20	31.03	27.36	42.34	49.40
Illinois Hub	28.56	27.61	27.02	27.08	28.46	36.60	51.37	42.24	51.90	55.65	56.30	60.00	76.57	66.80	56.48	45.49	46.26	44.00	39.01	43.54	43.58	37.58	31.33	26.31	43.74	49.80
Michigan Hub	26.08	25.35	24.46	25.10	28.62	30.73	39.69	41.37	44.43	46.64	46.93	44.56	47.31	43.90	46.00	45.23	42.80	43.96	40.69	40.92	42.02	36.94	31.90	30.29	38.16	42.85
Minnesota Hub	5.78	5.24	5.24	5.22	5.71	12.11	21.54	21.76	28.28	34.06	37.29	35.80	39.23	37.18	36.48	33.21	30.80	30.95	29.75	29.60	33.67	29.83	20.96	18.40	24.50	31.80
Wisconsin PS	21.14	19.92	19.54	19.79	20.88	25.54	33.52	36.78	35.14	36.72	37.27	35.86	38.51	35.94	34.79	32.87	33.54	33.02	33.72	34.06	38.53	34.66	27.49	23.67	30.95	34.93
Cleared Load (GW)	52.8	51.4	50.5	50.6	53.2	58.5	65.1	68.1	69.8	71.2	72.3	73.0	73.6	73.4	73.0	72.4	72.0	70.7	69.6	69.6	71.0	67.7	61.7	5.8		

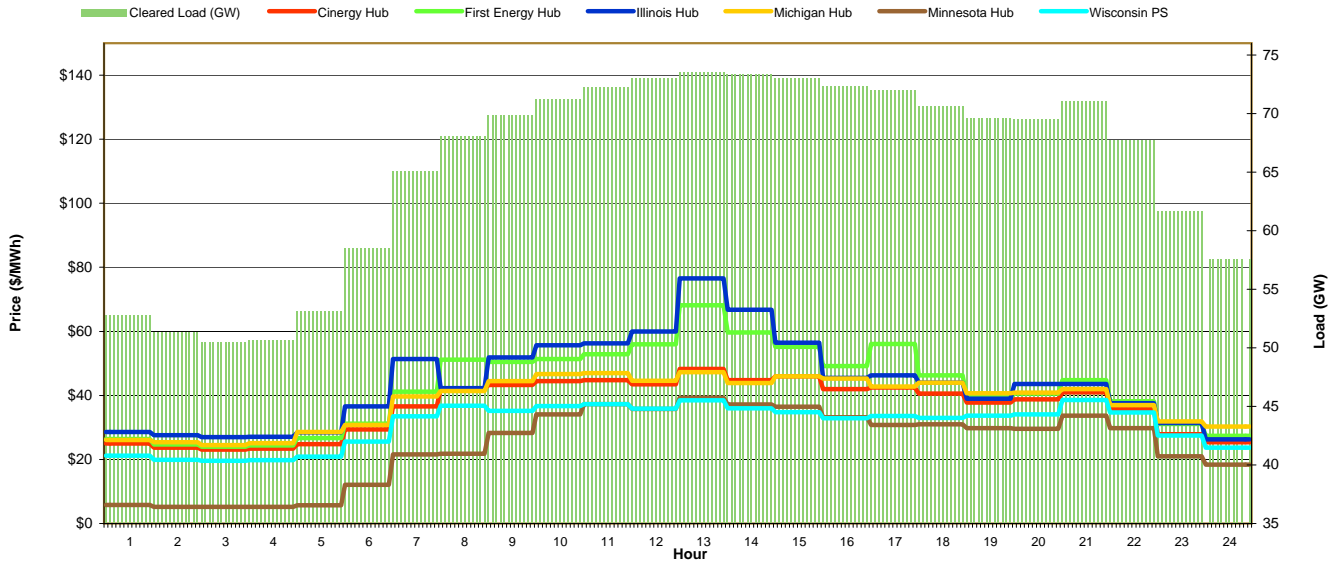

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	19.33	20.69	17.90	21.00	24.46	27.77	24.85	28.93	30.88	55.96	42.29	53.53	65.26	31.50	27.60	12.38	24.77	27.53	28.47	26.58	31.73	29.36	25.79	24.36	30.12	33.91
First Energy Hub	20.09	21.36	18.58	21.75	25.34	28.78	28.63	31.22	36.46	64.84	39.81	114.13	140.01	55.07	25.23	32.99	18.83	33.02	31.79	30.54	33.51	32.06	26.96	25.44	39.02	46.65
Illinois Hub	18.96	37.81	18.56	25.06	28.92	31.23	25.48	28.41	32.63	56.30	34.40	54.97	64.75	35.74	29.11	27.29	25.31	28.99	28.79	27.97	30.80	29.90	25.31	23.69	32.10	35.04
Michigan Hub	20.35	21.64	18.86	22.11	25.76	29.27	29.06	31.44	36.42	64.93	38.47	36.38	83.25	31.76	28.96	39.08	31.46	35.08	35.95	33.75	39.34	32.76	27.35	25.77	34.13	39.15
Minnesota Hub	16.27	4.76	15.05	8.91	16.76	17.78	24.34	27.71	32.56	53.08	35.43	57.32	68.57	38.73	30.43	28.43	25.99	29.92	28.79	27.47	30.23	29.82	24.85	22.53	28.99	35.58
Wisconsin PS	19.32	21.09	18.75	34.72	24.37	26.74	27.51	30.09	34.04	46.02	35.73	58.33	65.80	39.84	31.17	29.04	26.76	31.26	30.43	29.47	32.63	32.22	27.13	25.18	32.40	36.25
Forecasted Load (GW)	57.4	55.3	54.3	54.3	56.4	60.5	64.9	68.0	69.9	71.4	72.6	73.5	74.4	74.9	74.8	74.4	74.0	73.2	72.2	71.5	72.0	69.5	64.8	59.8		
Forecast Error %	-2.1%	-2.0%	-1.9%	-2.0%	-2.4%	-1.4%	-0.5%	-0.4%	-0.1%	0.2%	0.6%	0.5%	0.4%	0.2%	-0.1%	-0.7%	-1.0%	-1.4%	-2.4%	-4.5%	-4.6%	-5.5%	-4.6%			

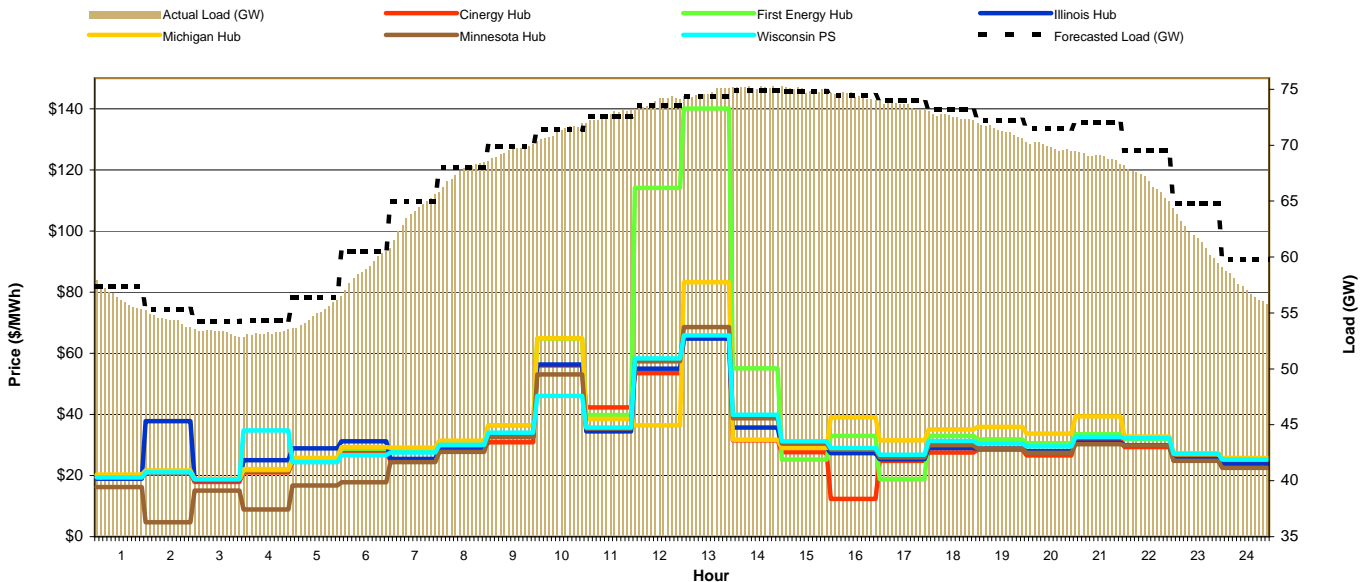




MISO Daily Report

Friday May 27, 2011

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
																									All	On Pk		
Cinergy Hub	24.84	23.70	22.92	23.17	25.03	29.15	33.80	37.25	39.38	40.12	40.64	41.53	42.68	40.15	39.75	36.66	33.01	31.10	29.73	29.55	32.36	28.49	25.06	24.01	32.25	35.47		
First Energy Hub	26.60	25.70	24.76	25.06	26.98	30.98	36.45	39.49	45.23	49.66	49.95	52.16	55.82	50.93	46.74	41.41	37.53	35.42	33.91	33.15	36.33	32.13	28.52	26.87	37.16	41.77		
Illinois Hub	23.62	23.23	22.55	22.82	24.41	29.13	32.06	42.21	38.30	37.72	43.91	43.05	45.15	41.75	40.40	37.72	33.09	30.76	29.30	29.13	31.91	27.75	24.69	23.06	32.41	36.05		
Michigan Hub	24.77	24.36	23.26	23.67	25.61	29.66	38.37	41.80	42.48	41.75	42.22	42.51	42.22	40.71	41.71	37.90	35.55	33.42	31.69	32.29	35.09	29.81	23.98	24.37	33.72	37.20		
Minnesota Hub	17.18	15.07	13.99	12.30	13.88	17.81	21.63	25.69	28.20	33.30	30.61	33.47	31.01	30.91	30.80	28.38	26.80	26.06	24.88	24.08	25.65	25.44	21.30	18.62	24.04	27.91		
Wisconsin PS	21.88	20.37	19.45	19.47	20.91	25.55	32.49	38.58	36.82	39.71	40.31	41.28	41.64	39.51	39.10	36.95	32.65	31.55	30.24	30.08	32.24	28.58	24.57	22.21	31.09	35.24		
Cleared Load (GW)	53.8	52.1	51.2	51.6	54.2	59.5	66.0	68.3	69.8	71.3	72.2	72.4	72.4	71.8	70.8	69.7	69.1	68.0	67.1	67.2	68.6	65.0	60.3	5.6				

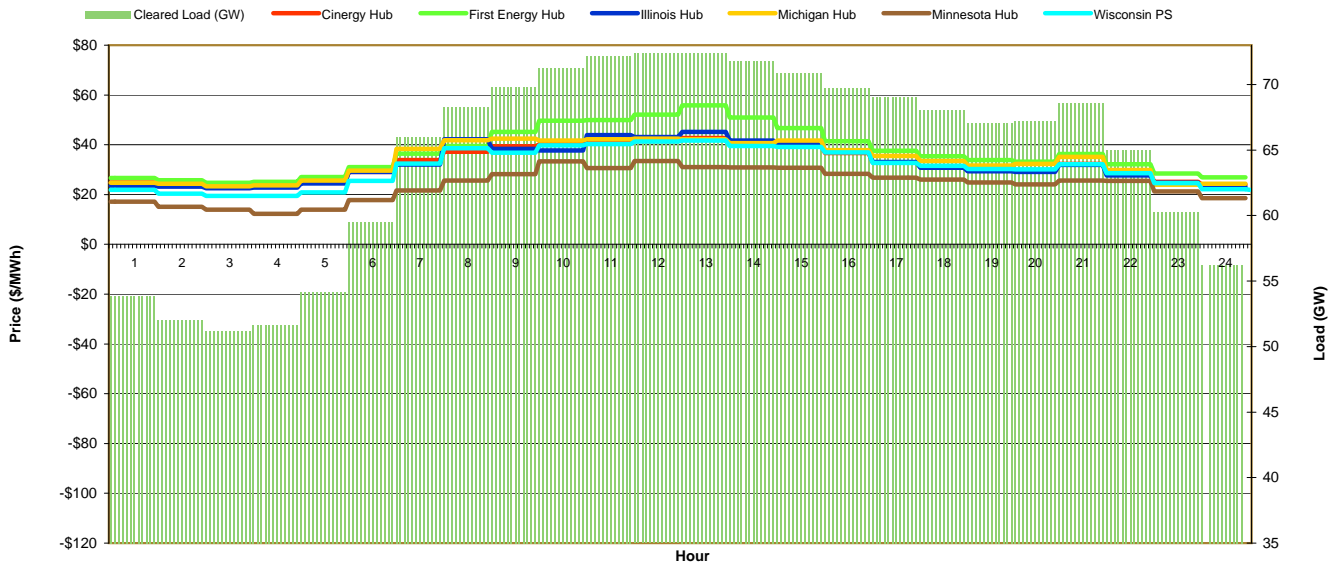

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
																									All	On Pk		
Cinergy Hub	22.20	22.33	21.61	23.02	22.38	23.60	37.20	27.92	29.93	28.76	27.86	26.89	26.74	25.94	27.57	26.98	25.94	25.03	24.88	25.22	29.92	23.13	21.58	14.24	25.45	26.52		
First Energy Hub	23.14	29.73	24.51	23.83	23.32	24.59	38.79	29.30	31.48	30.43	29.50	28.51	28.36	27.36	29.08	28.41	27.29	25.15	23.49	26.25	31.15	24.11	22.49	73.29	29.32	27.65		
Illinois Hub	21.42	19.41	20.27	41.95	24.95	25.20	57.02	27.26	26.52	25.70	27.30	26.37	26.22	25.46	27.05	26.45	25.36	24.23	26.21	33.49	40.96	22.74	21.11	-6.39	26.51	27.03		
Michigan Hub	23.42	9.74	18.44	24.19	23.60	25.00	39.50	29.80	31.86	37.55	30.19	30.23	31.95	27.43	29.30	28.55	27.54	26.34	26.37	26.65	31.63	24.48	22.74	-113.13	21.39	28.91		
Minnesota Hub	20.14	18.38	18.95	4.90	16.30	18.71	20.66	24.65	27.77	24.03	24.83	23.96	24.43	24.34	25.55	24.81	22.13	21.02	21.29	16.48	18.69	21.39	20.38	-6.36	19.89	22.86		
Wisconsin PS	22.71	20.58	21.54	23.55	22.99	24.19	38.40	30.18	31.74	31.62	30.13	29.26	28.71	27.56	29.06	28.28	27.54	24.68	25.62	25.96	30.84	24.04	22.32	-7.04	25.60	27.97		
Forecasted Load (GW)	57.5	55.7	54.8	55.0	56.8	60.4	63.8	67.4	69.4	70.7	71.2	71.8	71.9	71.6	71.1	70.1	69.3	68.3	67.5	67.2	68.5	66.5	62.5	58.2				
Forecast Error %	-5.8%	-5.8%	-5.7%	-5.8%	-5.0%	-3.4%	-1.2%	-1.7%	-2.0%	-2.3%	-2.1%	-2.5%	-2.5%	-3.2%	-3.0%	-2.9%	-2.7%	-2.8%	-2.8%	-3.5%	-2.8%	-3.9%	-13.0%					

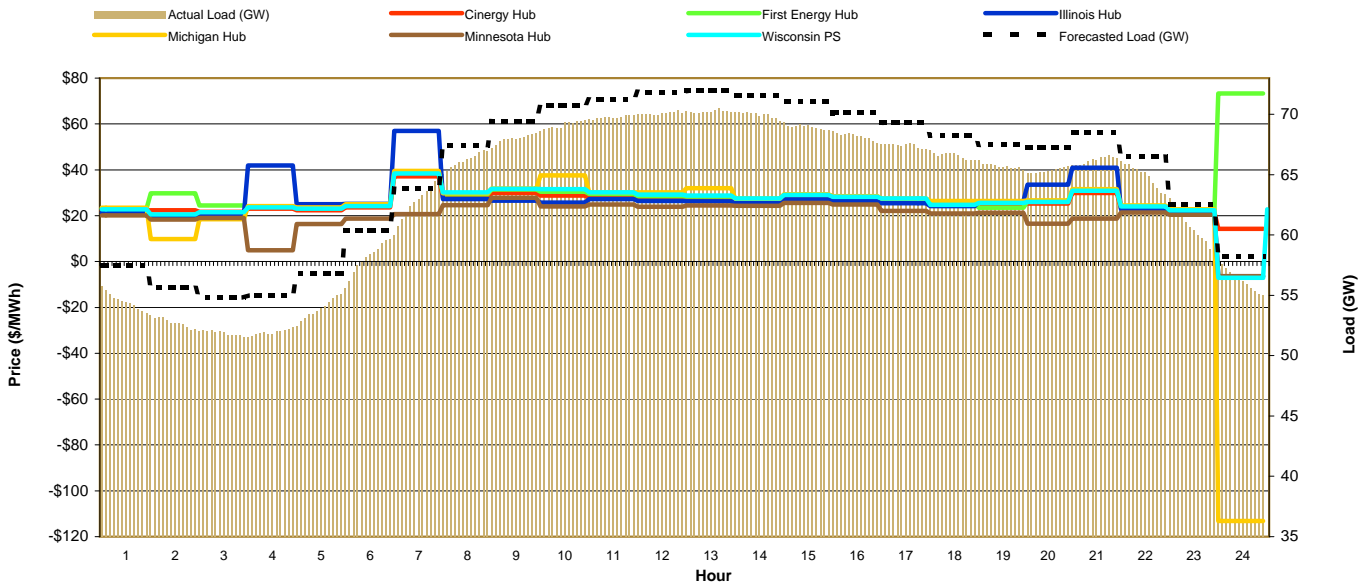




MISO Daily Report

Saturday May 28, 2011

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	20.99	20.01	18.67	18.39	18.58	18.77	22.29	24.83	28.00	29.38	30.37	31.56	33.09	33.63	33.90	35.32	37.21	35.98	32.51	32.00	38.43	32.75	25.23	23.96	28.16	32.14
First Energy Hub	22.77	21.72	20.33	20.03	20.22	19.88	23.82	26.26	31.73	32.07	36.65	39.86	39.93	43.27	41.50	42.88	44.11	43.43	35.13	35.90	42.59	35.16	26.32	24.92	32.10	37.30
Illinois Hub	21.07	21.74	20.40	20.49	20.31	20.02	22.43	23.86	26.95	28.92	29.73	32.24	36.49	35.78	38.03	37.93	38.39	39.14	36.07	35.22	44.26	36.81	27.67	25.01	29.96	34.22
Michigan Hub	19.77	18.75	17.31	17.00	17.23	18.68	22.29	25.44	28.94	32.44	31.91	32.14	34.22	33.64	35.22	37.50	41.46	40.19	35.28	35.13	42.74	36.85	25.49	24.45	29.34	34.29
Minnesota Hub	15.65	12.46	11.69	11.18	11.89	15.30	17.49	20.81	23.17	24.64	23.77	21.64	19.17	17.65	16.48	16.85	17.29	18.16	18.60	19.29	21.74	21.51	18.12	16.87	17.98	19.93
Wisconsin PS	19.28	18.27	17.41	17.32	17.60	18.47	20.87	23.56	26.61	28.55	29.70	30.21	31.08	30.11	31.30	31.42	31.92	32.92	30.36	29.81	35.82	31.64	23.88	21.93	26.25	29.93
Cleared Load (GW)	52.0	50.5	49.8	50.2	52.7	57.7	64.0	66.3	67.5	69.0	69.3	69.5	69.8	69.2	68.4	67.0	66.2	65.1	64.1	63.8	65.0	62.8	57.1	5.3		

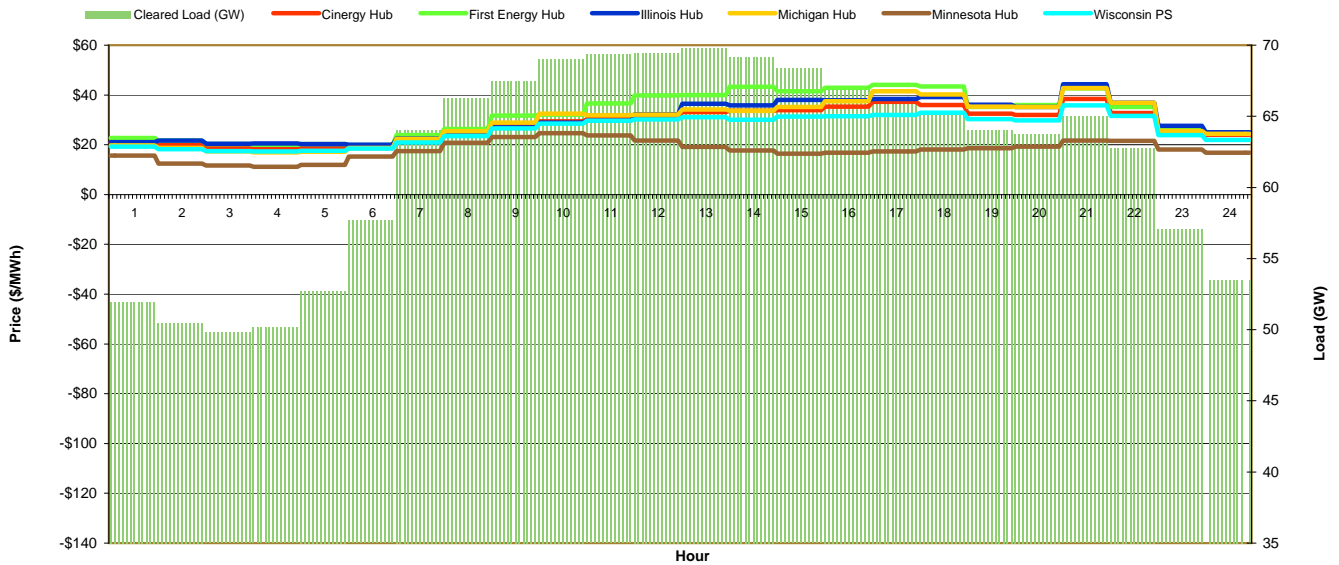

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	4.01	11.95	5.83	14.91	-5.33	14.02	17.69	22.11	24.45	23.95	24.20	23.86	20.08	21.62	22.57	24.36	29.24	22.94	24.34	32.76	25.45	23.74	19.94	3.20	18.83	24.10
First Energy Hub	28.55	15.84	22.20	23.60	51.94	15.28	18.44	22.90	24.92	19.55	20.55	20.99	20.57	22.35	23.40	25.15	29.26	23.77	25.19	34.08	26.71	24.75	20.73	26.02	24.45	24.05
Illinois Hub	-4.49	10.45	0.10	11.68	-25.11	13.37	17.16	21.45	23.62	23.16	23.39	22.84	19.36	20.38	21.44	22.49	22.65	21.43	22.68	42.78	28.47	22.68	19.13	-3.86	16.55	23.62
Michigan Hub	-48.89	4.96	-29.14	-2.27	-130.66	12.86	18.21	23.20	25.68	25.18	25.49	24.95	20.95	22.23	23.39	24.82	27.21	23.61	25.02	35.08	43.89	31.48	21.05	-45.29	8.46	26.45
Minnesota Hub	-3.91	9.91	0.13	9.90	-24.02	13.00	16.43	20.34	22.49	22.09	22.12	19.53	17.67	14.71	16.88	12.76	-26.10	10.49	9.24	2.78	18.73	21.31	18.25	-3.77	10.04	13.96
Wisconsin PS	-4.76	10.97	0.06	12.15	-26.56	14.09	18.06	22.61	24.92	24.46	24.69	23.17	20.14	19.36	21.02	19.72	2.18	20.08	21.19	29.52	25.13	23.75	20.05	-4.20	15.07	21.37
Forecasted Load (GW)	54.1	53.1	52.3	52.5	54.5	58.4	62.1	64.8	66.2	66.9	67.2	67.1	66.6	66.3	65.3	64.3	63.4	62.4	61.7	61.6	63.2	61.8	57.9	55.2		
Forecast Error %	-1.2%	-2.7%	-2.6%	-2.3%	-2.7%	-2.8%	-1.4%	-0.3%	0.1%	0.6%	0.6%	0.9%	1.1%	0.8%	0.7%	0.6%	0.8%	0.8%	0.6%	-0.2%	-1.0%	-1.6%	-4.0%			

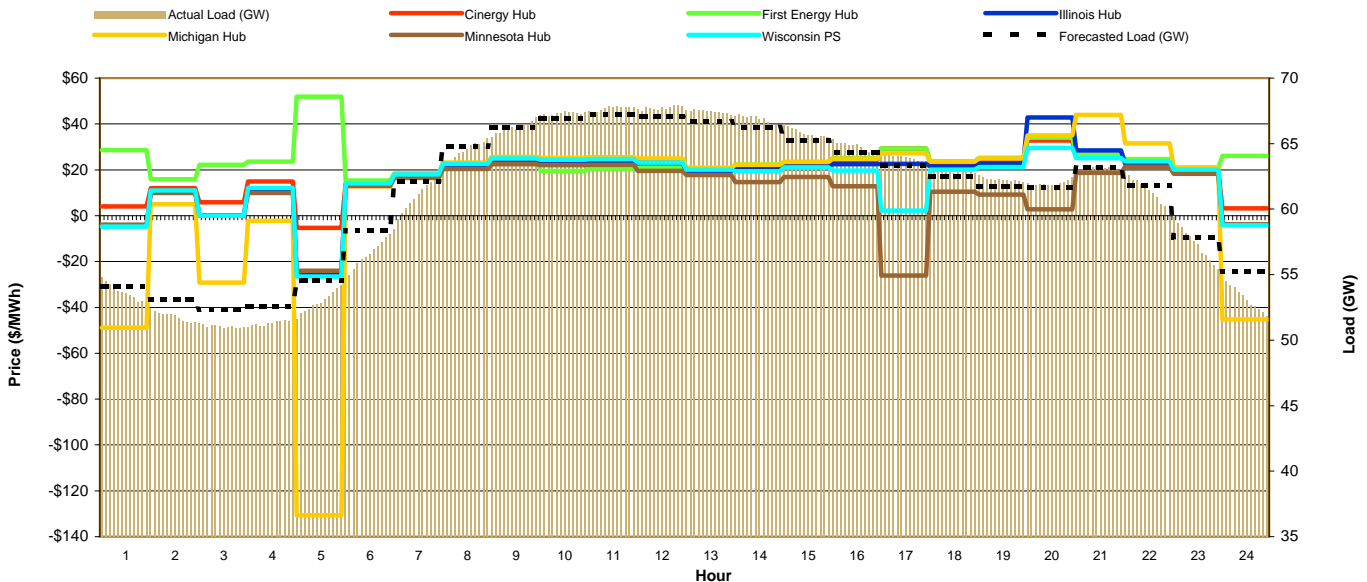




MISO Daily Report

Sunday May 29, 2011

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
	All	On Pk																										
Cinergy Hub	21.99	20.47	20.12	20.05	19.87	18.33	20.25	24.46	27.43	29.00	33.67	39.37	45.75	47.70	44.51	45.92	47.82	45.27	42.80	43.03	46.42	38.00	28.13	25.30	33.15	39.33		
First Energy Hub	26.66	25.28	24.43	24.28	24.12	22.40	24.24	27.02	31.15	31.57	39.00	43.22	48.44	54.57	57.05	60.71	66.33	57.78	53.57	51.35	53.30	39.85	30.71	28.66	39.40	46.60		
Illinois Hub	18.96	17.20	17.09	16.78	16.61	16.10	17.95	22.70	25.81	27.29	31.58	36.47	42.55	44.88	43.68	46.03	47.39	42.29	40.02	40.72	43.94	35.61	25.51	22.29	30.81	37.28		
Michigan Hub	13.86	11.40	12.23	12.13	11.71	11.35	14.26	22.51	26.47	29.24	33.68	38.89	46.28	46.38	40.26	40.35	40.10	40.59	41.87	43.16	45.27	38.28	25.14	20.06	29.39	37.40		
Minnesota Hub	11.23	8.51	8.88	9.29	9.67	13.64	15.58	17.56	19.87	21.29	21.80	22.40	21.84	21.68	20.83	19.83	20.12	21.16	21.57	19.72	21.83	20.95	11.78	5.06	16.92	20.26		
Wisconsin PS	16.11	14.03	14.09	14.19	14.44	15.76	17.85	21.10	23.90	25.83	28.87	31.60	34.55	35.70	34.74	35.92	37.26	35.96	35.24	35.24	38.51	31.77	20.96	16.46	26.25	31.69		
Cleared Load (GW)	49.4	47.5	46.8	46.7	47.5	48.7	51.2	55.0	58.5	60.6	61.8	62.3	62.6	62.5	62.6	62.8	63.1	62.8	62.2	61.8	63.6	61.9	56.4	5.3				

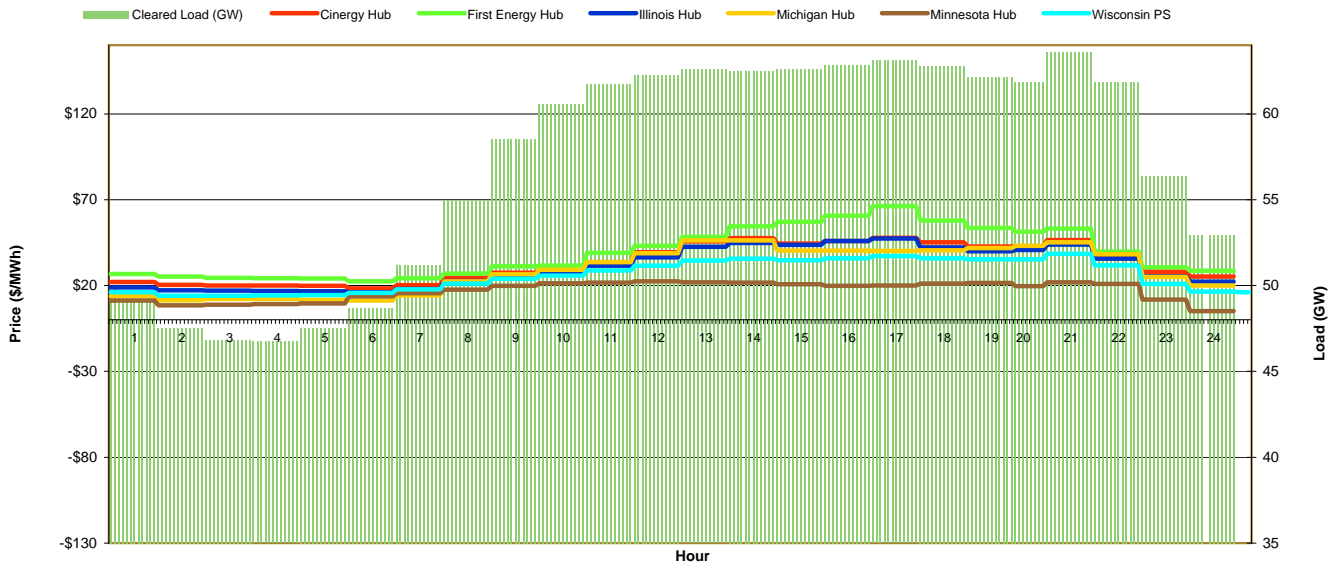

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
	All	On Pk																										
Cinergy Hub	20.59	19.57	18.37	17.74	16.78	13.21	17.52	21.72	24.78	31.75	41.92	35.98	52.36	39.63	33.56	60.51	69.10	60.75	67.02	32.91	30.96	41.94	21.18	22.87	33.86	41.63		
First Energy Hub	21.40	21.60	41.43	18.26	17.24	13.58	18.08	22.45	25.73	33.03	71.46	57.54	71.76	68.47	98.15	105.16	120.08	155.65	153.28	104.92	41.25	83.17	48.02	39.98	60.49	78.76		
Illinois Hub	18.87	11.21	10.42	17.07	16.20	12.75	16.85	20.63	21.94	24.34	36.64	25.89	22.00	31.50	-55.67	-27.09	-16.69	12.92	-35.57	-44.54	14.29	-0.77	-30.58	-93.91	0.36	-0.05		
Michigan Hub	21.78	20.53	-29.58	18.53	17.50	13.72	18.17	22.59	25.97	33.24	26.61	26.24	50.34	30.89	23.06	70.78	64.90	30.99	48.29	12.13	29.98	29.98	19.13	42.71	27.85	34.07		
Minnesota Hub	18.28	10.84	9.53	16.42	15.52	12.16	16.02	19.28	20.46	18.19	18.74	8.37	14.18	12.20	-54.55	-24.38	-15.27	5.94	-34.26	-42.99	12.85	-3.04	-30.99	-90.23	-2.78	-4.70		
Wisconsin PS	19.73	10.27	10.53	17.87	16.91	13.29	17.62	21.65	22.86	22.48	30.72	18.34	14.79	23.96	-75.62	-43.27	-32.93	2.98	-56.40	-61.72	12.09	-9.39	-42.78	-121.18	-6.97	-9.52		
Forecasted Load (GW)	52.2	50.4	49.3	48.9	49.4	50.2	51.9	54.1	56.2	57.9	59.0	59.4	59.6	59.8	60.0	60.6	61.1	61.1	60.7	60.3	61.7	60.7	57.4	54.9				
Forecast Error %	-29.4%	-3.5%	-3.4%	-3.4%	-3.7%	-4.3%	-4.9%	-2.8%	-0.9%	-0.5%	-0.6%	-1.2%	-1.7%	-2.2%	-2.4%	-3.1%	-3.1%	-3.2%	-3.1%	-2.2%	-2.9%	-2.9%	-2.6%	-14.0%				

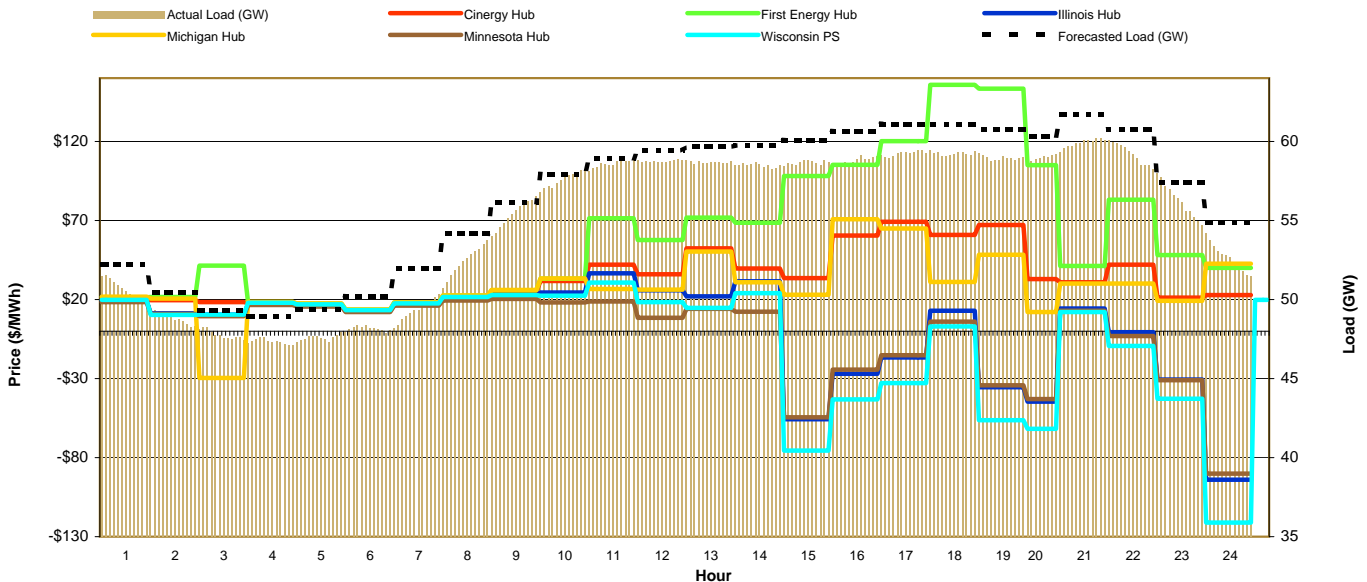




MISO Daily Report

Monday May 30, 2011

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	22.82	21.99	20.78	20.34	19.05	18.41	23.21	25.53	27.20	32.48	41.41	42.05	49.99	48.47	56.84	67.17	70.32	57.85	51.25	50.28	52.45	39.88	29.88	26.83	38.19	46.44
First Energy Hub	26.99	25.97	24.79	24.20	23.35	21.55	25.83	27.34	31.48	38.51	50.21	54.90	60.84	61.63	74.43	81.35	81.92	66.63	56.62	55.75	66.21	41.75	32.16	27.65	45.09	55.11
Illinois Hub	18.34	17.10	16.66	16.62	15.95	16.51	20.79	24.47	26.17	30.84	34.98	39.76	43.61	46.04	53.47	54.01	54.84	49.57	45.38	41.89	43.41	36.44	27.58	24.68	33.30	40.78
Michigan Hub	15.01	14.61	12.69	13.10	11.58	13.01	21.20	26.62	27.13	32.52	42.08	41.36	44.22	41.71	45.17	57.07	60.70	51.84	46.98	46.17	43.96	38.62	27.70	27.07	33.42	42.12
Minnesota Hub	4.38	3.05	2.13	-0.70	-3.45	-3.16	-4.31	3.47	5.04	6.08	13.57	16.13	16.27	17.63	17.71	19.27	20.60	20.65	20.65	19.98	21.53	18.38	11.18	5.52	10.48	15.51
Wisconsin PS	13.65	12.11	11.45	10.12	8.41	9.54	11.34	19.35	21.08	24.73	29.46	33.82	35.15	35.99	39.58	38.11	44.21	41.70	38.82	35.84	37.14	33.10	23.15	18.80	26.11	33.20
Cleared Load (GW)	48.3	46.6	45.5	45.1	45.4	45.3	47.8	51.9	56.7	59.7	62.6	64.1	65.3	65.8	67.1	68.0	68.5	68.6	67.6	66.6	67.9	65.6	59.6	5.7		

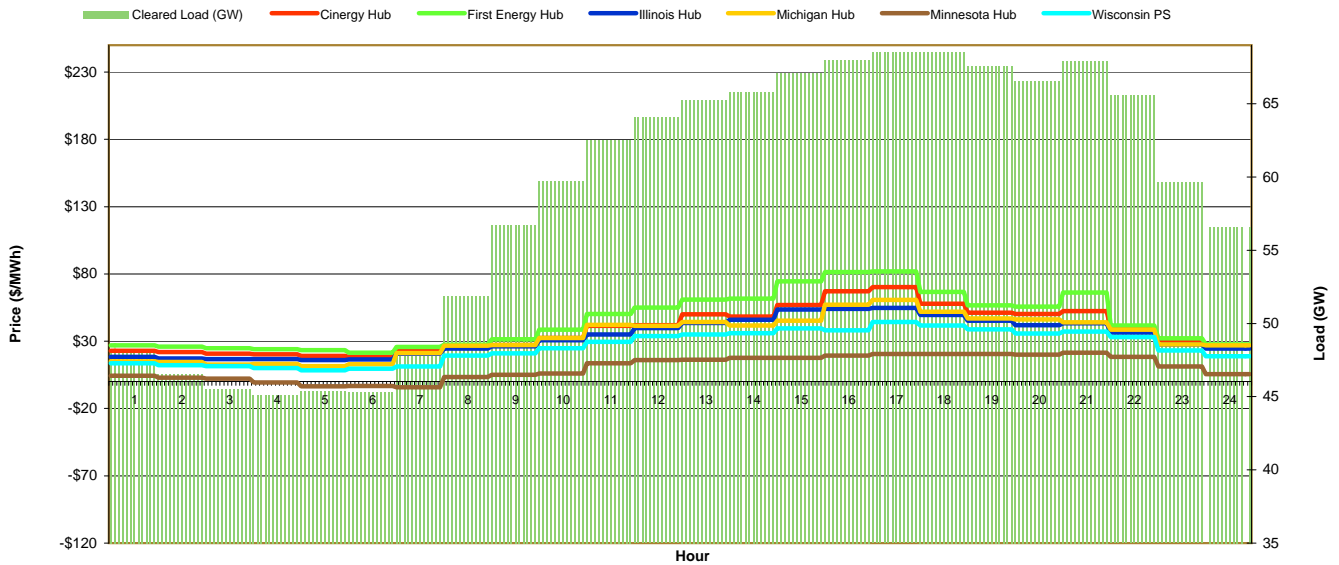

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	19.40	30.92	23.03	-28.06	17.13	15.67	18.93	22.26	29.45	58.04	55.68	55.22	35.16	50.76	87.91	164.27	42.01	77.46	194.26	185.17	83.51	91.15	58.03	40.64	59.50	80.65
First Energy Hub	23.89	48.42	38.33	-29.14	20.14	-16.11	19.61	23.08	39.51	101.04	98.53	99.27	49.27	98.45	127.61	240.48	52.40	77.57	196.29	187.12	82.87	102.80	64.70	44.74	74.62	102.56
Illinois Hub	-5.45	-37.60	-88.18	-27.86	-7.08	2.78	0.21	19.42	22.48	28.13	33.67	23.10	24.92	24.44	42.61	1.15	33.17	53.99	33.18	11.30	25.70	15.53	-6.90	18.43	10.05	24.12
Michigan Hub	23.29	37.32	40.56	-28.97	20.10	17.53	21.21	23.20	22.58	37.58	21.37	21.19	28.67	27.21	69.53	120.56	37.32	83.59	197.46	188.25	90.11	108.14	66.66	46.12	55.02	71.46
Minnesota Hub	-4.91	-47.02	-86.46	-28.02	-22.65	2.76	-3.09	18.91	-13.52	7.14	-5.15	21.91	18.45	17.02	20.73	27.45	21.80	29.23	29.71	18.44	15.60	7.67	-1.99	17.84	2.58	14.59
Wisconsin PS	-10.33	-57.50	-114.80	-29.74	-19.00	0.17	-4.99	19.77	7.52	16.13	17.02	25.79	22.41	20.41	37.26	37.62	30.38	49.68	34.83	27.24	31.51	0.81	-13.74	15.90	6.01	22.79
Forecasted Load (GW)	52.2	50.3	49.1	48.4	48.3	48.4	49.4	52.7	55.5	58.1	60.8	62.8	64.4	65.7	66.8	67.8	68.5	68.4	67.6	66.7	67.0	65.6	61.4	58.2		
Forecast Error %	-4.4%	-4.0%	-4.1%	-3.8%	-3.4%	-3.6%	-3.3%	-2.8%	-0.8%	0.4%	0.1%	-0.3%	-0.9%	-2.1%	-3.3%	-4.0%	-4.5%	-4.1%	-4.1%	-4.5%	-4.4%	-3.6%	-2.8%	-4.4%		

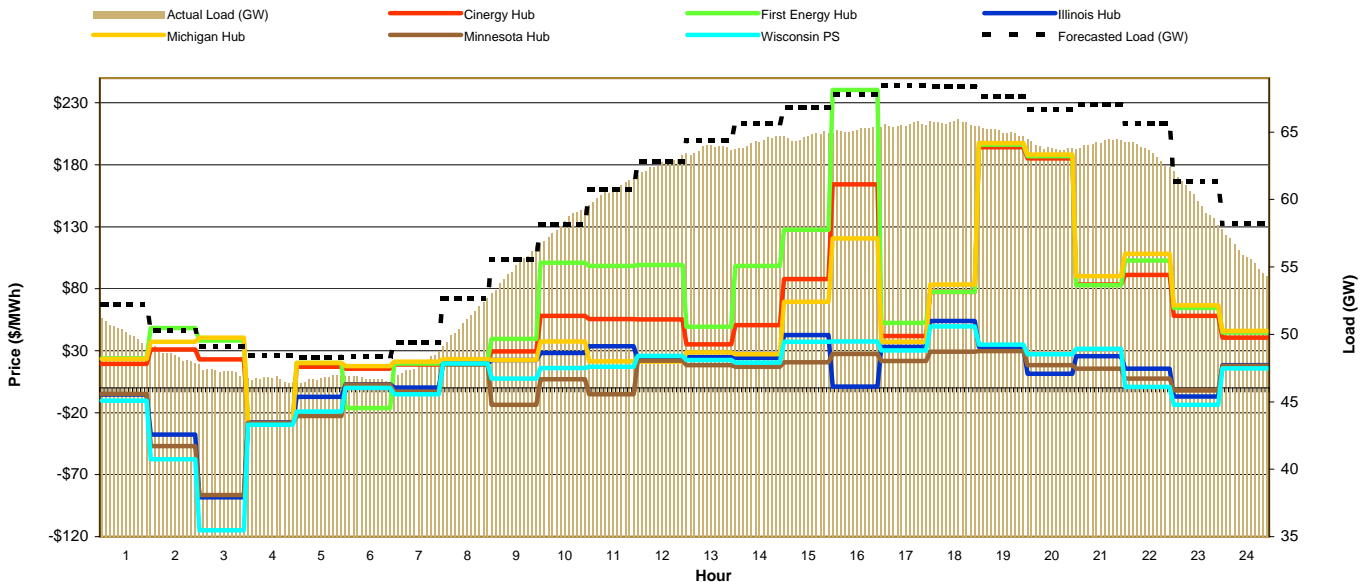



MISO Daily Report


Tuesday May 31, 2011

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%

Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
																									All	On Pk		
Cinergy Hub	24.07	21.54	20.73	20.87	22.04	25.40	28.96	33.32	44.24	54.61	60.00	72.01	80.00	81.50	83.25	80.00	75.74	69.32	58.24	58.93	54.63	42.33	28.94	25.88	48.61	61.07		
First Energy Hub	25.52	22.95	22.75	22.63	23.29	26.61	31.61	36.00	55.01	77.52	79.65	89.31	104.23	114.54	114.75	123.01	107.88	102.60	75.50	81.07	77.07	52.62	31.36	27.64	63.55	82.63		
Illinois Hub	19.45	16.76	15.39	16.09	18.23	24.17	27.62	32.05	39.81	42.51	55.28	65.07	77.32	78.01	83.49	80.76	76.77	69.64	61.19	58.10	55.41	38.45	26.99	24.46	45.96	58.80		
Michigan Hub	24.41	22.75	22.55	20.97	23.09	26.64	31.69	35.21	45.49	51.19	57.75	73.06	83.78	84.64	85.99	76.57	76.39	63.66	58.31	55.36	48.09	38.27	26.31	26.30	48.27	60.00		
Minnesota Hub	2.08	-0.15	-2.57	-2.84	-0.81	3.88	12.52	20.99	21.90	23.50	23.93	25.57	26.12	25.92	24.67	23.67	23.03	22.72	21.15	20.28	20.84	20.46	14.75	5.10	15.70	22.47		
Wisconsin PS	13.68	10.97	9.70	9.58	11.31	17.86	25.57	30.11	33.66	35.77	43.71	48.19	58.65	55.74	58.21	58.35	56.34	52.53	46.01	43.55	44.05	35.63	23.42	20.92	35.14	45.24		
Cleared Load (GW)	52.0	50.0	48.9	48.6	48.7	48.8	52.0	56.6	61.1	65.8	69.6	72.4	74.5	75.8	76.7	77.3	78.1	78.4	77.5	76.2	77.4	73.6	67.4	6.3				

■ Cleared Load (GW)
 ■ Cinergy Hub
 ■ First Energy Hub
 ■ Illinois Hub
 ■ Michigan Hub
 ■ Minnesota Hub
 ■ Wisconsin PS

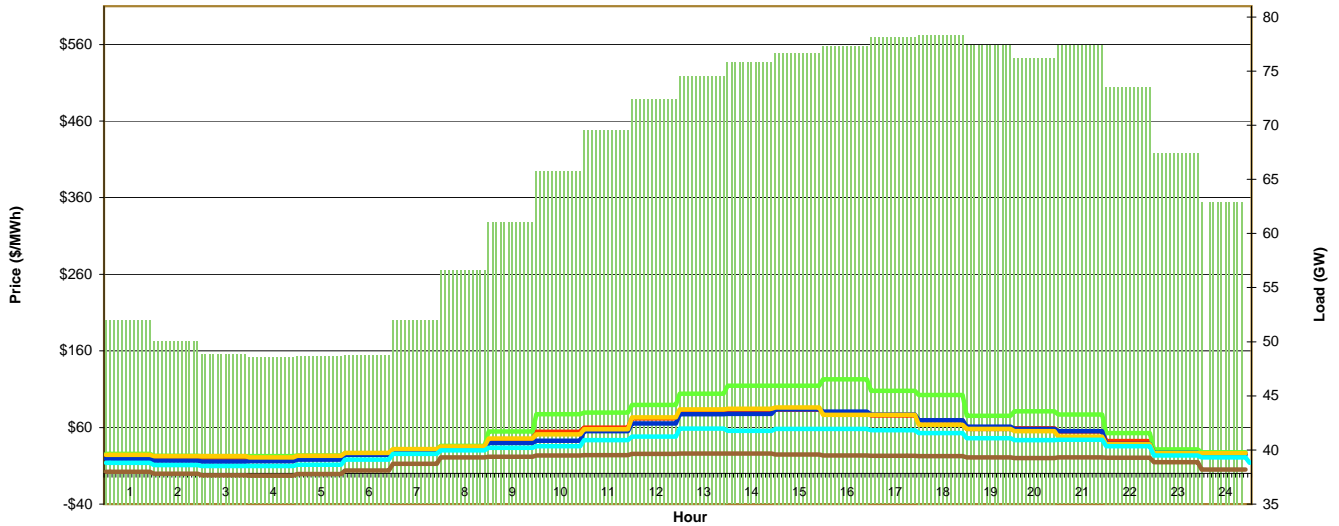

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
																									All	On Pk		
Cinergy Hub	19.72	25.25	21.23	20.93	25.31	25.46	57.56	213.25	132.08	101.85	238.50	111.04	348.29	377.79	514.48	568.91	283.54	93.02	67.94	100.56	261.15	69.48	46.51	32.57	156.52	220.52		
First Energy Hub	20.02	59.02	25.73	31.07	57.98	26.65	61.41	194.93	126.80	136.11	363.41	149.87	342.53	425.68	526.82	603.62	318.99	119.63	66.04	108.37	280.39	82.54	53.71	35.92	175.72	243.72		
Illinois Hub	15.18	-2.49	13.91	15.02	7.97	17.12	34.25	60.55	15.52	43.15	146.49	66.43	138.19	210.27	161.91	249.28	23.47	45.12	45.39	77.03	86.34	13.81	14.34	17.18	63.14	87.33		
Michigan Hub	20.23	-39.52	14.31	1.56	-39.45	28.27	71.66	211.18	139.12	94.00	186.35	115.36	337.29	397.35	500.89	583.96	286.89	118.61	77.73	107.82	281.73	75.92	60.21	40.46	153.00	223.40		
Minnesota Hub	-5.29	-2.46	-14.72	8.21	-6.11	-1.86	15.26	36.26	35.58	42.22	70.32	27.21	55.11	66.14	68.17	56.18	21.30	11.38	21.73	34.33	34.16	20.62	11.51	14.76	25.83	38.26		
Wisconsin PS	6.78	-6.02	1.60	12.90	1.36	29.10	51.52	98.74	59.85	69.01	112.51	47.34	130.93	154.77	193.45	166.01	61.85	35.94	36.10	56.39	54.63	26.30	9.96	15.41	59.43	82.11		
Forecasted Load (GW)	55.5	53.4	51.7	51.2	51.0	51.2	52.8	56.6	60.4	65.6	69.7	73.0	74.8	76.6	77.9	79.5	80.0	80.2	79.3	78.2	77.8	75.5	70.6	66.3				
Forecast Error %	-6.1%	-6.0%	-5.6%	-6.1%	-5.4%	-5.7%	-5.2%	-4.3%	-1.5%	-1.7%	-2.1%	-2.2%	-2.0%	-2.6%	-2.2%	-2.2%	-1.1%	-0.3%	0.5%	0.7%	1.7%	1.9%	0.6%	-9.7%				

■ Actual Load (GW)
 ■ Cinergy Hub
 ■ First Energy Hub
 ■ Illinois Hub
 ■ Michigan Hub
 ■ Minnesota Hub
 ■ Wisconsin PS
 ■ Forecasted Load (GW)

