




MISO Daily Report

Monday February 1, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	27.23	27.08	26.70	26.69	27.23	28.84	47.03	65.93	57.27	54.21	49.17	47.38	43.49	40.26	35.35	32.12	33.25	41.26	64.45	57.53	48.22	45.67	33.92	29.67	41.25	46.84
First Energy Hub	28.36	28.26	27.88	27.84	28.31	29.96	48.94	68.50	59.37	56.19	51.00	49.09	45.05	41.72	36.67	33.32	34.50	42.78	66.64	59.51	50.04	47.38	35.16	30.64	42.80	48.56
Illinois Hub	26.68	26.42	26.04	26.03	26.61	28.88	46.01	64.13	55.77	52.85	47.91	46.18	42.40	39.25	34.46	31.28	32.38	40.24	62.86	56.05	46.99	44.53	33.13	29.02	40.25	45.65
Michigan Hub	27.35	27.27	26.83	26.86	27.45	29.15	49.04	68.45	59.35	56.40	51.01	49.29	45.32	41.90	36.70	33.27	34.46	42.98	67.51	60.11	50.02	47.52	34.31	30.37	42.62	48.66
Minnesota Hub	24.95	24.48	23.98	23.89	24.48	25.16	42.77	62.07	53.82	51.01	46.50	44.57	40.93	37.88	33.25	30.18	31.25	38.85	60.73	55.77	45.67	43.16	31.49	27.62	38.52	44.20
Wisconsin PS	24.16	23.70	22.26	21.95	22.85	23.73	39.64	60.97	55.80	52.83	47.99	46.97	42.93	39.50	35.36	32.67	33.66	42.29	64.00	60.72	49.88	46.55	33.27	29.86	39.73	46.59
Cleared Load (GW)	64.8	63.2	62.3	62.8	64.0	66.8	71.7	76.7	77.2	77.8	77.8	77.4	76.5	75.5	74.2	72.9	73.1	74.7	77.5	78.1	77.7	74.7	71.4	6.8		

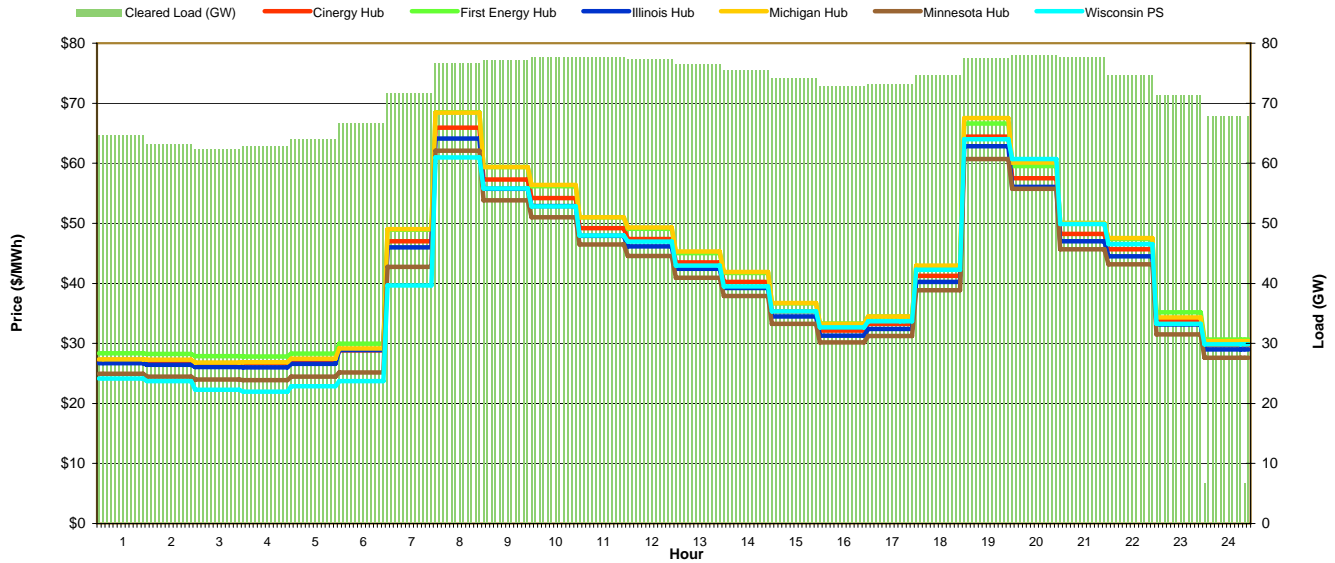

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	23.66	25.71	26.13	25.10	21.30	20.72	27.86	38.71	40.08	31.53	30.89	31.75	31.08	27.95	28.39	24.34	24.12	27.46	50.02	35.42	32.85	29.14	26.54	27.21	29.50	31.89
First Energy Hub	23.68	26.25	25.38	24.34	19.01	20.59	28.41	46.26	46.11	32.37	31.79	32.68	32.01	28.84	29.30	25.15	24.96	28.46	51.84	36.74	34.38	30.12	27.35	28.07	30.59	33.65
Illinois Hub	22.97	24.86	25.21	24.17	20.49	19.98	26.80	34.62	36.82	30.76	30.19	31.03	30.47	27.45	28.04	24.11	23.87	27.15	49.31	34.68	32.70	28.67	26.01	26.64	28.63	30.99
Michigan Hub	24.00	26.00	26.41	25.37	21.55	20.92	27.89	20.58	26.45	32.04	31.44	32.46	32.09	29.01	29.42	25.10	24.85	28.16	51.15	36.14	33.69	29.69	27.41	28.08	28.75	30.61
Minnesota Hub	22.64	24.26	24.68	23.57	18.95	18.90	25.19	34.04	37.95	37.51	40.27	41.19	39.95	32.94	49.15	32.55	38.04	28.39	70.24	54.77	39.59	32.27	28.42	27.91	34.31	39.83
Wisconsin PS	23.97	25.87	26.35	26.38	21.22	21.78	26.04	34.49	34.96	31.24	32.36	30.31	30.39	28.10	29.56	25.48	25.62	29.47	48.65	50.47	41.26	35.02	28.97	30.82	30.78	33.52
Forecasted Load (GW)	65.2	64.1	63.8	63.9	64.8	66.7	71.8	77.4	78.9	78.8	78.4	77.5	76.6	75.5	74.5	73.2	72.8	74.2	78.2	79.5	78.3	76.0	72.5	69.1		
Forecast Error %	-3.1%	-3.4%	-3.8%	-3.7%	-3.4%	-2.1%	-1.3%	-0.5%	-0.4%	-0.6%	-0.9%	-0.7%	-0.8%	-0.7%	-0.5%	-0.5%	-0.4%	-0.5%	-0.8%	-1.5%	-1.4%	-1.5%	-1.5%	-2.8%		

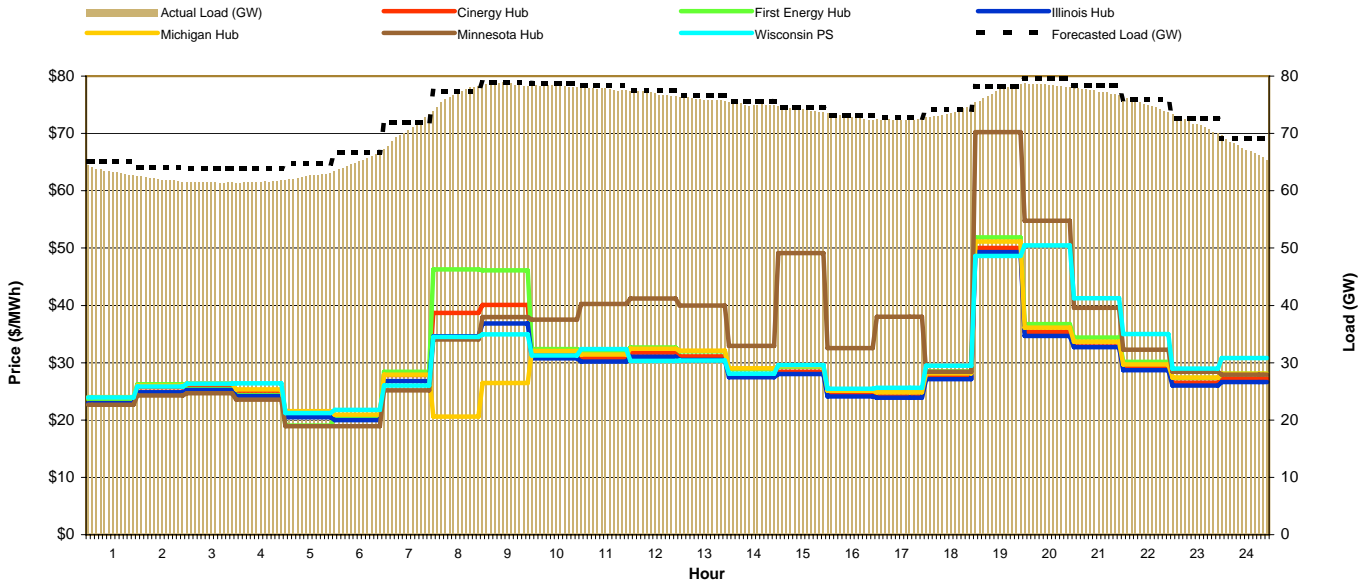




MISO Daily Report

Tuesday February 2, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	27.50	26.57	26.00	26.02	26.71	28.19	43.26	55.05	48.96	48.47	46.78	45.62	42.02	38.67	33.85	30.65	31.57	38.38	55.34	50.13	45.49	42.87	33.74	29.87	38.40	42.97
First Energy Hub	28.62	27.66	27.05	27.06	27.74	29.25	44.55	56.71	50.52	49.87	47.93	46.71	42.97	39.54	34.61	31.34	32.29	39.26	56.73	51.74	46.88	44.12	34.84	31.01	39.54	44.13
Illinois Hub	27.52	26.48	26.05	26.05	27.31	30.12	47.98	53.75	47.58	47.27	45.68	44.59	41.02	37.74	33.04	29.92	30.82	37.47	53.85	48.65	44.32	41.87	32.62	28.82	37.94	41.89
Michigan Hub	27.75	26.67	26.06	26.08	26.90	28.46	44.09	56.28	49.86	49.90	48.59	47.36	43.57	40.09	35.09	31.77	32.73	39.80	57.50	51.54	46.89	44.43	34.85	30.35	39.44	44.39
Minnesota Hub	24.15	22.81	21.94	21.90	22.06	22.16	37.58	54.61	52.11	50.74	48.26	45.38	41.87	38.49	33.65	30.45	31.38	38.13	60.62	57.64	49.40	43.88	31.23	27.24	37.82	44.24
Wisconsin PS	25.05	23.96	22.22	21.93	22.74	23.76	40.12	55.21	52.25	49.90	47.92	46.99	43.04	39.43	35.25	32.50	33.38	41.37	60.43	58.78	50.05	47.62	33.60	30.19	39.07	45.48
Cleared Load (GW)	63.2	61.8	61.0	60.8	61.7	64.5	68.9	74.0	74.2	73.6	73.3	72.8	72.2	71.9	71.0	69.8	70.0	71.2	75.4	75.5	73.7	71.7	69.1	6.6		

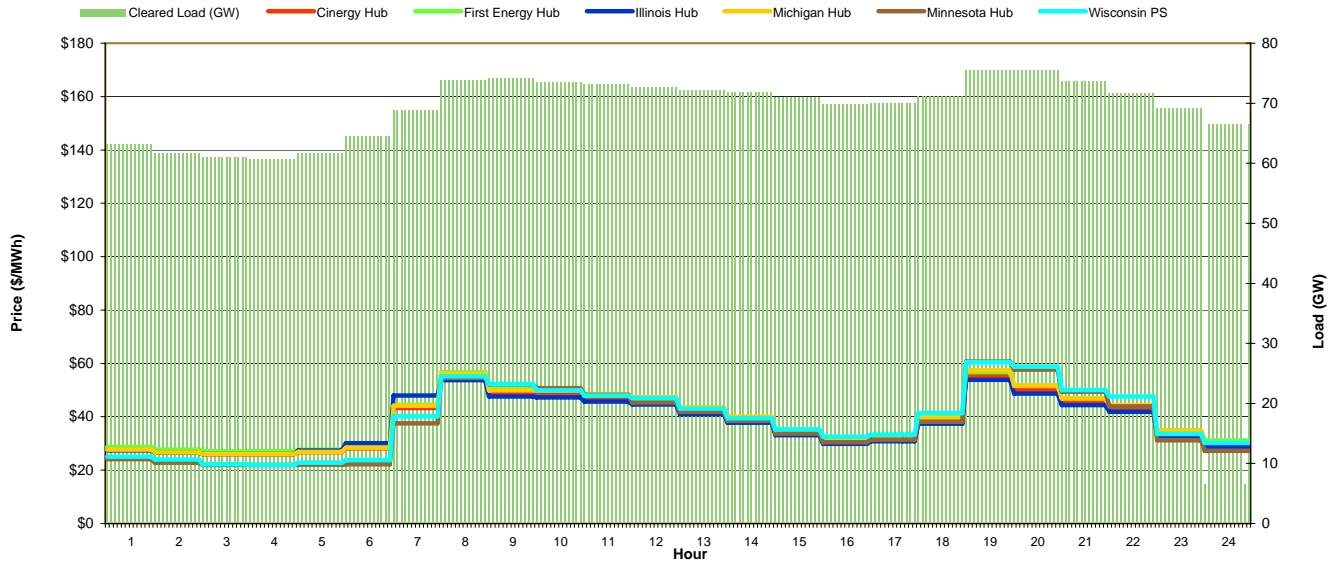

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	38.00	29.91	24.57	24.55	23.86	23.32	28.05	54.65	37.08	45.08	36.41	35.19	31.30	30.62	32.70	29.15	29.91	31.00	30.30	33.73	42.27	32.41	25.42	25.59	32.13	34.83
First Energy Hub	39.25	26.93	25.42	25.35	24.63	23.99	28.79	56.06	38.03	47.86	37.55	36.13	32.13	31.42	33.59	29.99	30.74	31.86	31.78	36.25	43.76	33.21	26.06	26.32	33.21	36.03
Illinois Hub	37.04	25.41	23.94	23.90	23.16	22.58	27.11	53.07	36.18	39.35	35.51	34.64	30.85	30.14	32.27	28.75	29.44	30.41	27.69	28.39	40.50	31.77	25.08	25.23	30.93	33.38
Michigan Hub	39.26	26.92	25.42	25.34	24.60	23.93	28.69	55.46	37.45	46.64	37.45	36.31	32.27	31.62	33.85	30.16	30.90	31.95	31.42	35.53	43.53	33.35	26.19	26.31	33.11	35.98
Minnesota Hub	38.50	25.74	23.70	23.34	22.46	22.12	26.64	55.33	48.36	177.38	45.20	37.44	32.55	31.62	33.34	29.19	29.61	30.86	88.52	162.80	70.72	36.37	26.41	25.36	47.65	58.48
Wisconsin PS	33.82	27.88	25.43	26.07	24.04	23.44	26.21	45.49	34.81	64.63	37.05	32.49	30.32	29.63	31.42	28.38	28.42	30.87	48.02	71.55	50.25	35.20	28.28	28.79	35.10	39.18
Forecasted Load (GW)	65.9	64.7	63.7	63.4	64.1	66.5	70.6	75.7	77.1	76.7	76.4	75.8	74.9	73.9	72.8	71.8	71.4	72.8	76.6	77.8	76.6	74.4	71.4	67.8		
Forecast Error %	-3.3%	-4.6%	-4.9%	-5.3%	-5.4%	-5.3%	-1.9%	-1.7%	-1.1%	-1.1%	-0.9%	-0.6%	-0.1%	0.3%	0.6%	1.0%	0.9%	0.3%	-0.3%	-0.2%	0.1%	-0.6%	-1.2%			

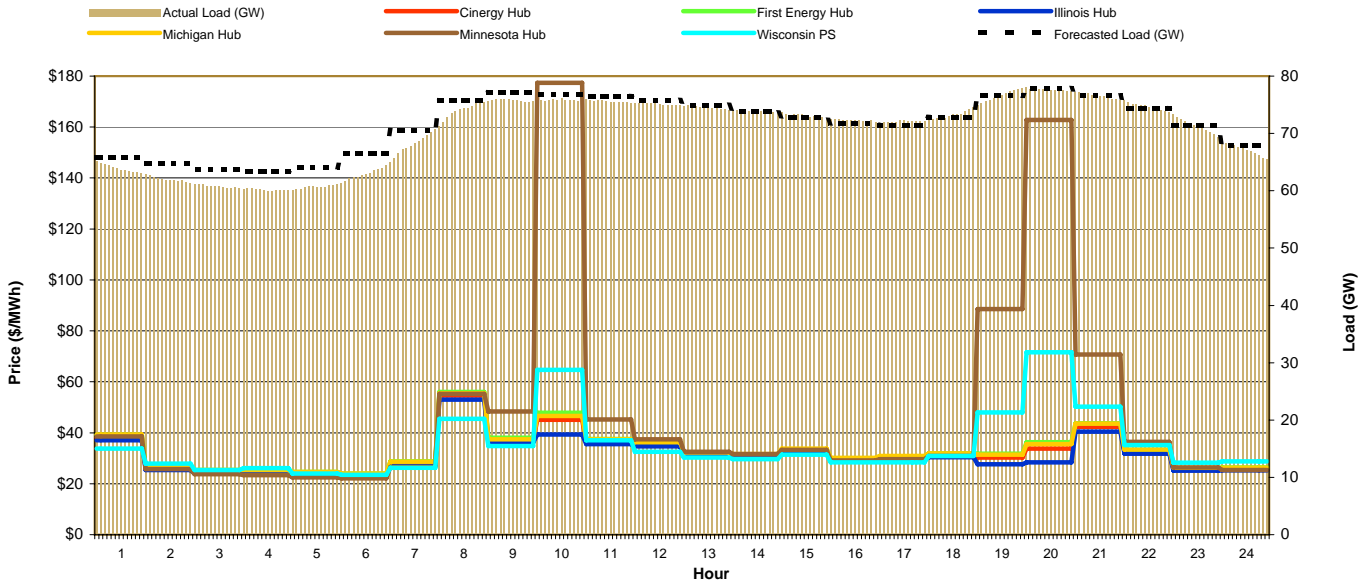




MISO Daily Report

Wednesday February 3, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	26.54	25.77	24.62	24.36	24.95	26.57	37.87	48.65	44.63	41.94	41.85	39.00	35.78	33.36	30.51	28.61	29.57	34.55	49.00	49.15	45.15	39.80	31.02	28.33	35.07	38.91
First Energy Hub	27.69	26.90	25.71	25.42	26.04	27.26	38.69	49.40	45.08	42.31	42.27	39.39	36.31	33.85	31.26	29.32	30.31	35.44	50.39	50.40	46.29	40.84	31.87	29.10	35.90	39.67
Illinois Hub	25.55	24.81	23.69	23.42	24.01	25.76	37.17	47.15	42.77	40.25	40.31	37.56	34.53	32.22	29.46	27.71	28.68	33.37	46.93	47.83	44.07	38.77	30.04	27.43	33.90	37.60
Michigan Hub	26.87	26.07	24.86	24.58	25.20	27.78	40.02	52.50	49.18	46.27	45.91	42.70	38.50	35.85	31.86	29.73	30.73	35.94	51.11	51.10	46.93	41.42	32.48	29.66	36.97	41.39
Minnesota Hub	24.33	23.44	22.38	22.13	22.68	24.24	37.62	58.80	63.00	59.98	57.00	52.46	45.43	41.78	37.35	33.13	33.59	42.13	67.78	54.09	47.95	41.65	28.83	26.20	40.33	47.81
Wisconsin PS	24.50	24.45	22.72	22.38	23.17	24.64	37.59	54.29	54.12	48.55	47.23	46.94	42.40	39.05	35.59	32.71	33.52	41.60	60.78	58.09	49.44	46.38	32.61	29.83	38.86	45.21
Cleared Load (GW)	63.3	61.3	60.3	60.0	61.0	63.5	68.3	74.4	73.4	73.5	72.8	72.7	72.4	72.0	70.7	69.3	69.7	71.3	74.7	75.3	73.6	72.3	69.1	6.6		

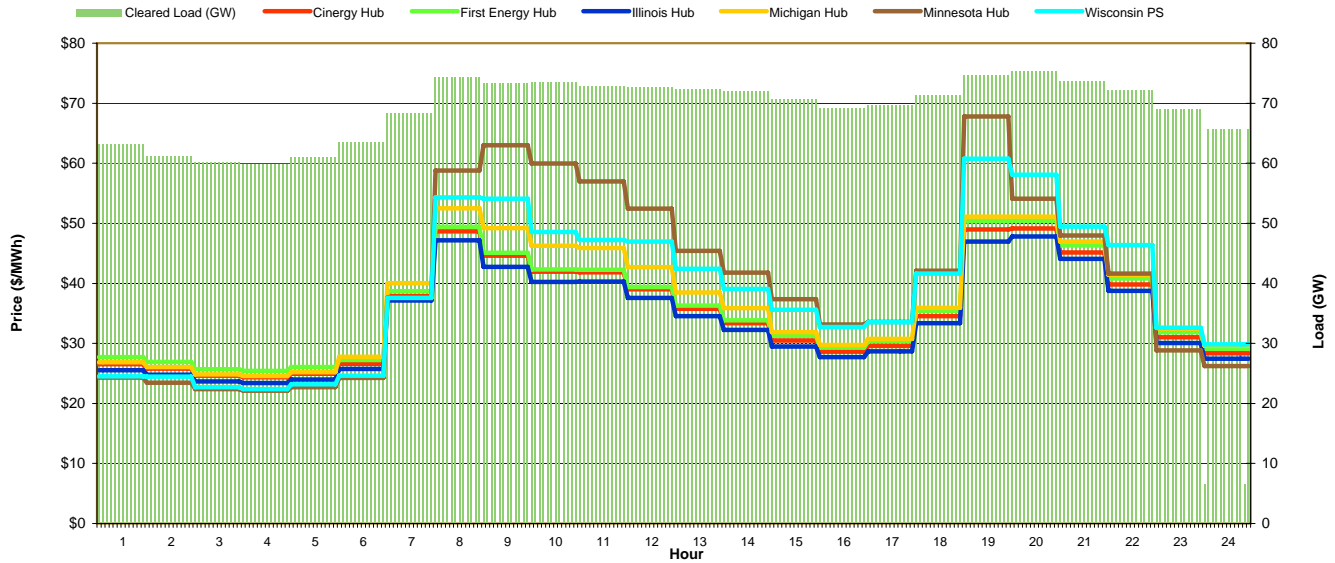

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	26.59	25.89	24.77	25.90	26.24	27.60	39.90	75.45	56.82	48.92	45.94	31.10	35.14	37.88	27.10	27.31	26.24	24.36	53.35	33.68	45.60	32.66	25.63	28.48	35.52	39.20
First Energy Hub	27.38	26.72	25.58	26.72	27.08	28.44	40.74	77.18	58.13	50.01	46.95	31.83	36.05	38.86	27.85	28.19	27.12	25.16	54.73	34.39	46.46	33.27	26.20	29.26	36.43	40.15
Illinois Hub	26.11	25.26	24.11	25.10	25.38	26.61	38.48	73.92	56.23	48.32	45.36	30.74	34.61	37.12	26.54	26.73	25.62	23.79	52.41	33.24	44.92	32.13	25.19	27.81	34.82	38.55
Michigan Hub	27.35	26.58	25.44	26.55	26.94	28.28	40.76	77.33	58.26	50.26	47.20	31.98	36.19	39.02	27.87	28.04	26.92	25.01	54.54	34.44	46.57	33.40	26.32	29.31	36.44	40.21
Minnesota Hub	26.26	25.35	23.98	24.87	25.04	25.89	36.15	74.28	52.10	50.30	45.80	30.46	34.21	36.61	26.05	25.80	24.70	23.09	51.78	33.55	44.80	31.69	25.15	27.61	34.40	38.15
Wisconsin PS	29.61	26.25	25.61	27.03	25.72	26.22	33.64	60.19	47.16	42.86	42.07	29.34	32.69	34.38	27.46	26.76	26.01	26.75	51.64	44.75	46.40	35.46	27.58	28.64	34.34	37.59
Forecasted Load (GW)	65.0	63.9	62.8	62.6	63.3	65.8	70.1	75.6	76.8	76.6	76.4	75.9	75.0	74.0	72.9	61.7	62.0	72.9	76.4	77.7	76.7	74.6	72.1	68.0		
Forecast Error %	-2.0%	-3.1%	-2.8%	-2.8%	-2.7%	-2.5%	-0.4%	0.4%	0.7%	0.5%	0.2%	-0.1%	-0.2%	0.1%	0.2%	14.6%	13.9%	0.5%	1.0%	0.6%	0.8%	0.8%	-0.7%	-0.7%		

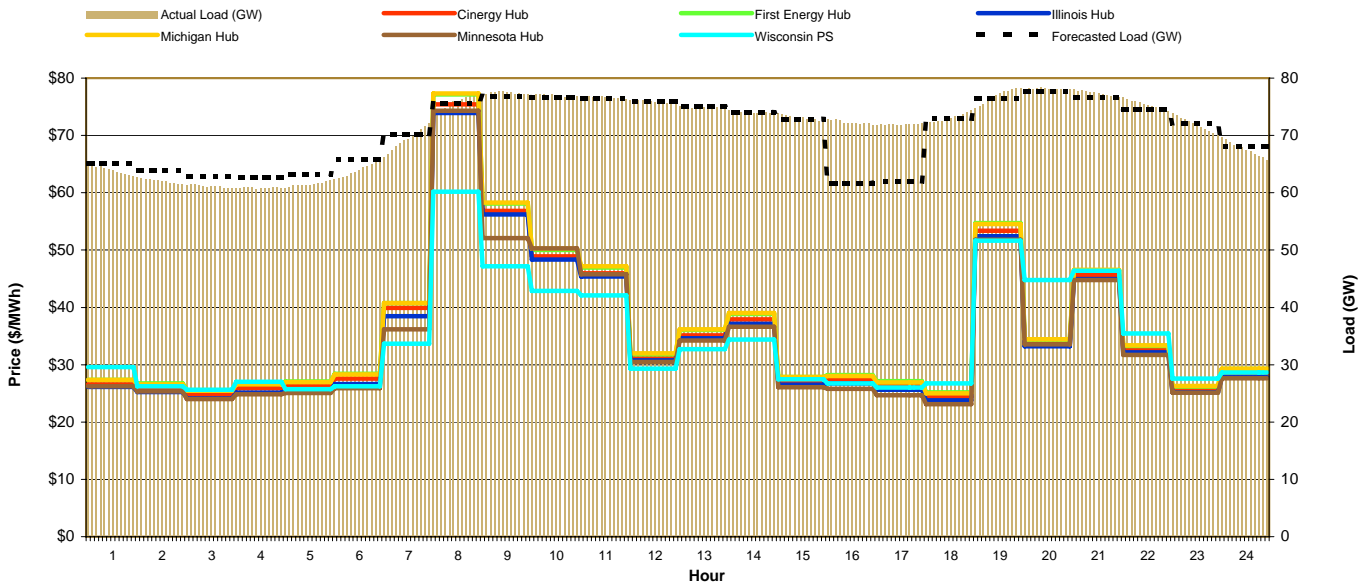




MISO Daily Report

Thursday February 4, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	26.96	25.22	25.00	24.92	25.14	28.42	42.42	52.58	48.99	48.02	46.33	45.50	41.06	36.03	34.12	31.69	31.67	36.63	49.45	48.19	45.19	40.00	29.97	27.77	37.14	41.59
First Energy Hub	27.83	26.00	25.75	25.84	25.90	29.22	43.61	54.13	50.40	49.35	47.55	46.66	42.04	36.88	34.94	32.41	32.40	37.50	50.84	49.49	46.42	41.05	30.76	28.49	38.14	42.68
Illinois Hub	27.75	25.13	25.01	24.80	25.17	31.06	50.27	51.40	47.64	46.76	45.17	44.41	40.13	35.19	33.34	30.93	30.92	35.71	47.81	46.73	44.13	39.16	28.99	26.85	36.85	40.53
Michigan Hub	27.95	26.08	25.85	25.41	25.99	29.43	43.54	54.07	50.57	49.58	48.20	47.32	42.63	37.39	35.42	32.86	32.85	38.02	51.55	50.17	47.07	41.62	31.36	29.04	38.50	43.17
Minnesota Hub	23.29	22.36	22.07	22.00	22.18	23.10	34.99	52.69	53.56	51.89	50.96	46.79	41.57	36.48	34.64	32.08	32.02	38.42	63.18	57.68	48.50	41.02	27.86	25.73	37.71	44.33
Wisconsin PS	25.54	24.59	23.36	22.90	23.41	25.81	40.52	53.55	53.54	49.89	48.20	48.48	42.51	37.74	35.52	33.27	33.50	40.55	58.29	57.73	50.25	44.06	31.83	29.72	38.95	44.93
Cleared Load (GW)	63.6	62.0	60.8	60.7	61.3	64.6	69.4	75.4	74.6	74.0	73.5	72.9	72.4	72.0	70.9	69.7	69.8	71.4	75.3	75.2	73.2	71.6	69.0	6.6		

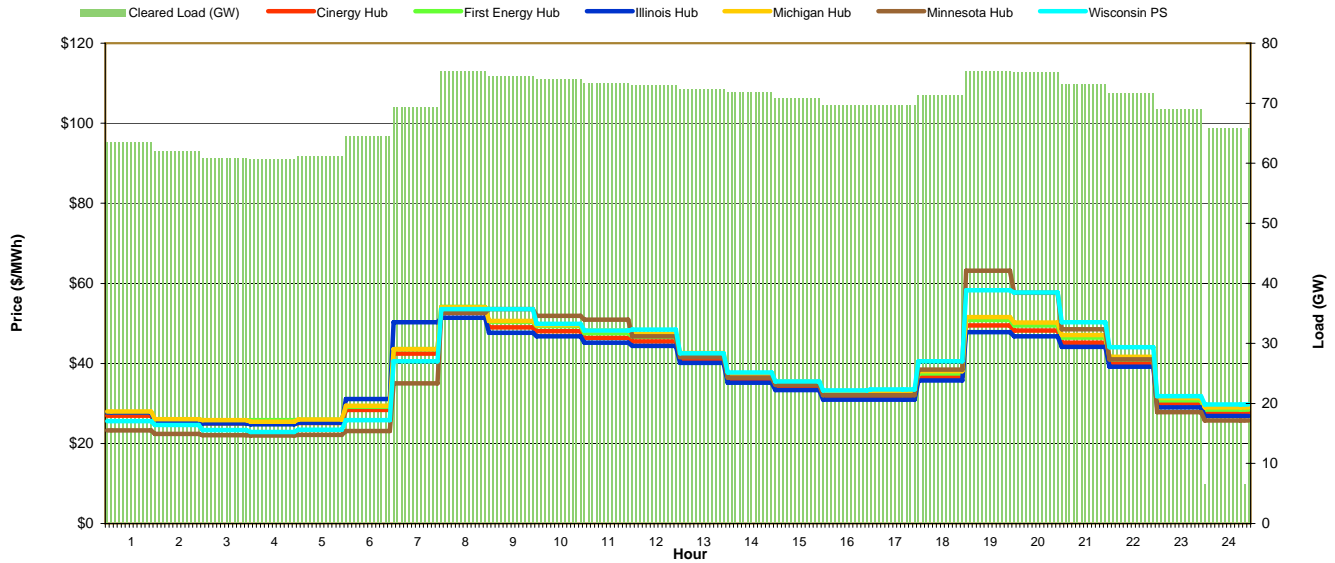

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	23.39	24.74	25.98	25.03	26.53	25.74	32.63	80.54	57.62	51.48	60.98	34.17	38.10	47.65	32.34	28.44	29.95	33.41	50.19	69.87	38.78	37.50	27.21	23.53	38.58	44.89
First Energy Hub	24.07	25.46	26.71	25.80	27.37	26.47	33.44	81.84	58.77	52.52	62.35	34.85	38.79	48.63	33.03	29.09	30.67	34.27	52.48	72.17	39.65	38.32	27.83	24.22	39.53	45.95
Illinois Hub	22.76	24.03	25.12	23.57	23.56	21.80	24.83	78.54	56.32	50.49	59.91	33.82	37.76	47.27	32.09	28.17	29.53	32.76	50.37	69.28	37.99	36.74	26.63	22.90	37.34	44.23
Michigan Hub	24.03	25.39	26.68	25.77	27.55	26.76	34.21	82.01	58.91	52.59	62.44	34.97	39.13	48.87	33.19	29.07	30.69	34.30	52.54	72.51	39.85	38.47	28.02	24.28	39.68	46.10
Minnesota Hub	22.81	24.50	25.46	23.74	23.79	23.25	24.10	82.43	111.23	65.57	118.48	56.71	41.65	51.25	35.56	31.77	33.02	35.80	56.82	79.64	45.56	41.39	29.35	24.72	46.19	57.26
Wisconsin PS	24.07	25.47	26.49	26.02	24.20	22.54	23.37	65.35	51.29	45.38	55.41	32.91	35.37	41.69	31.51	28.23	29.28	33.44	50.65	70.23	41.63	38.58	28.38	25.14	36.53	42.46
Forecasted Load (GW)	65.2	64.2	63.1	62.8	63.5	66.2	70.2	75.7	76.9	76.4	75.8	75.1	74.1	73.1	72.0	71.0	71.3	72.0	75.4	76.7	75.7	73.5	70.9	66.9		
Forecast Error %	-2.0%	-3.2%	-3.2%	-3.2%	-3.2%	-3.2%	-1.0%	-0.5%	0.0%	0.2%	0.6%	0.7%	1.0%	1.5%	1.7%	0.7%	1.3%	1.6%	0.7%	0.4%	0.7%	-0.7%	-1.2%			

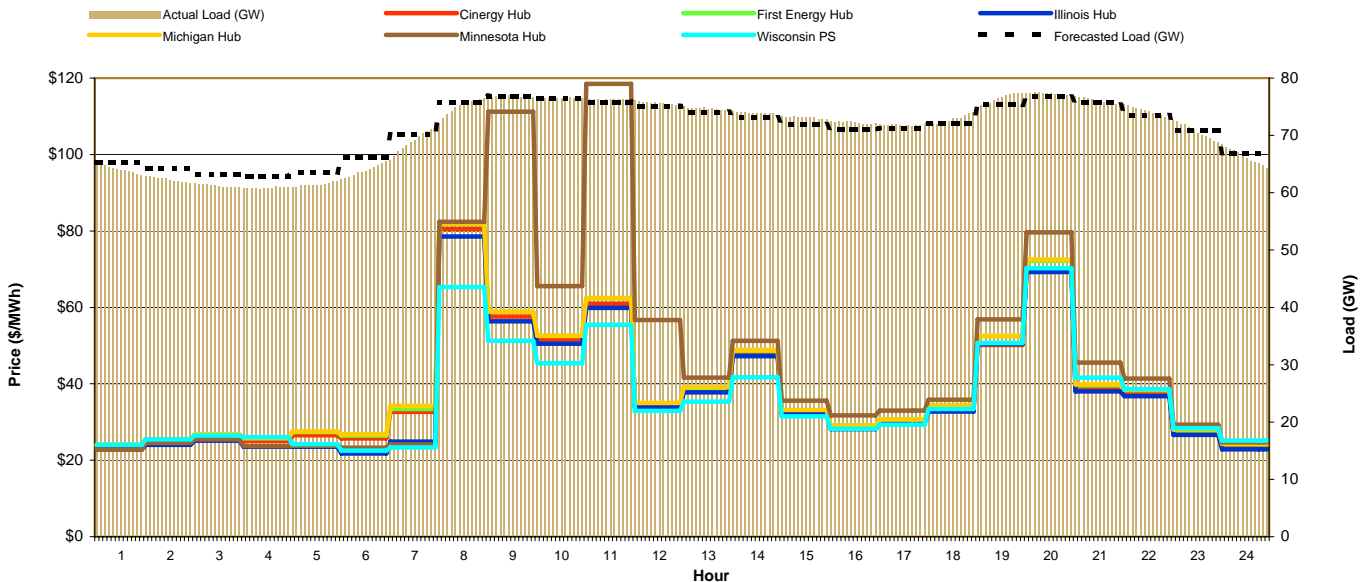




MISO Daily Report

Friday February 5, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$			
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk		
Cinergy Hub	25.26	24.46	24.00	23.84	23.90	24.63	30.21	46.47	41.13	43.51	41.66	41.00	40.84	37.27	33.20	30.03	29.65	32.35	43.66	41.11	40.98	33.96	27.73	26.91	33.66	37.78		
First Energy Hub	26.24	25.54	24.94	24.78	24.84	25.58	31.10	47.77	42.30	44.63	42.76	42.03	41.84	38.19	34.05	30.78	30.34	33.09	44.72	42.12	41.97	34.83	28.53	27.59	34.61	38.75		
Illinois Hub	24.33	23.52	23.12	22.96	23.02	23.71	29.54	45.43	39.89	42.29	40.55	40.00	39.87	36.43	32.42	29.32	28.95	31.57	42.52	40.05	40.04	33.16	26.79	26.01	32.73	36.83		
Michigan Hub	25.54	24.69	24.23	24.06	24.13	24.88	31.10	47.94	42.88	45.25	43.36	42.62	42.42	38.72	34.33	31.07	30.76	33.55	45.35	42.72	42.56	35.32	28.77	28.12	34.77	39.23		
Minnesota Hub	22.92	22.24	21.76	21.62	21.69	22.32	30.04	46.28	50.54	48.34	45.43	41.60	41.23	37.57	33.60	30.59	30.31	33.18	46.32	44.15	41.67	34.30	25.28	24.56	34.06	39.40		
Wisconsin PS	24.51	24.07	22.61	22.08	22.51	23.41	32.49	49.78	48.63	48.35	46.28	45.56	44.24	40.67	36.19	33.39	32.69	38.68	55.64	53.09	46.78	41.16	29.92	28.64	37.14	43.19		
Cleared Load (GW)	61.6	59.9	58.8	58.5	59.2	62.4	67.9	74.9	74.2	74.1	74.4	73.9	73.6	72.7	71.8	70.4	70.5	72.0	75.3	74.2	72.1	70.8	67.1	63				

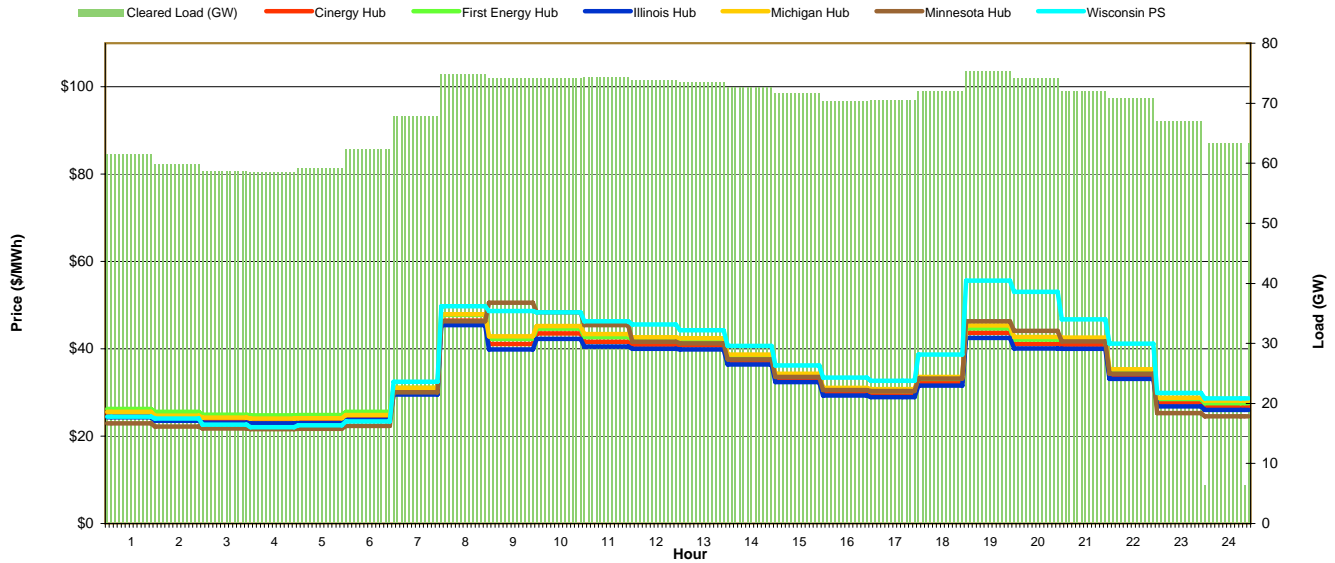

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$			
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk		
Cinergy Hub	24.80	23.81	24.20	25.59	25.70	23.67	24.56	32.55	35.90	36.78	38.34	34.61	38.25	44.71	98.59	32.56	32.71	32.74	34.67	36.12	39.93	28.70	28.95	30.02	34.52	39.13		
First Energy Hub	25.71	24.66	25.03	26.54	26.56	24.46	25.19	33.26	36.59	37.54	39.22	35.45	39.20	45.89	101.38	33.55	33.68	33.73	35.64	37.02	40.95	29.39	29.81	31.09	35.48	40.14		
Illinois Hub	23.98	22.45	21.70	19.70	23.35	20.54	21.57	31.41	34.85	35.70	37.22	33.65	37.21	43.29	95.09	31.37	31.47	31.54	33.65	35.15	38.76	27.87	28.09	28.88	32.85	37.90		
Michigan Hub	25.56	24.49	24.98	26.75	26.63	24.59	25.38	33.47	36.88	37.73	39.44	35.74	39.48	46.18	102.52	33.78	33.77	33.79	35.70	37.13	41.31	29.78	30.14	31.33	35.69	40.43		
Minnesota Hub	25.30	23.01	21.98	19.86	23.66	20.91	21.65	32.55	38.13	37.97	38.84	34.63	37.53	42.87	93.59	30.65	30.44	30.41	33.59	36.12	39.21	27.88	27.39	28.03	33.18	38.24		
Wisconsin PS	24.93	24.25	23.60	22.27	23.98	21.70	22.03	32.21	33.46	34.06	36.57	31.34	34.23	37.92	72.69	29.22	29.48	31.58	37.67	45.09	40.98	31.69	28.63	28.39	32.42	36.68		
Forecasted Load (GW)	64.7	62.6	61.4	60.8	61.3	63.7	68.4	72.3	73.9	74.0	74.1	73.7	73.2	72.6	71.6	70.7	70.3	71.0	73.0	73.5	72.4	70.4	67.5	63.9				
Forecast Error %	-3.5%	-3.7%	-3.8%	-3.6%	-3.5%	-3.5%	-2.7%	0.2%	0.5%	0.5%	0.8%	1.5%	1.6%	1.7%	2.0%	2.0%	2.6%	2.8%	3.2%	2.1%	2.1%	1.9%	2.3%					

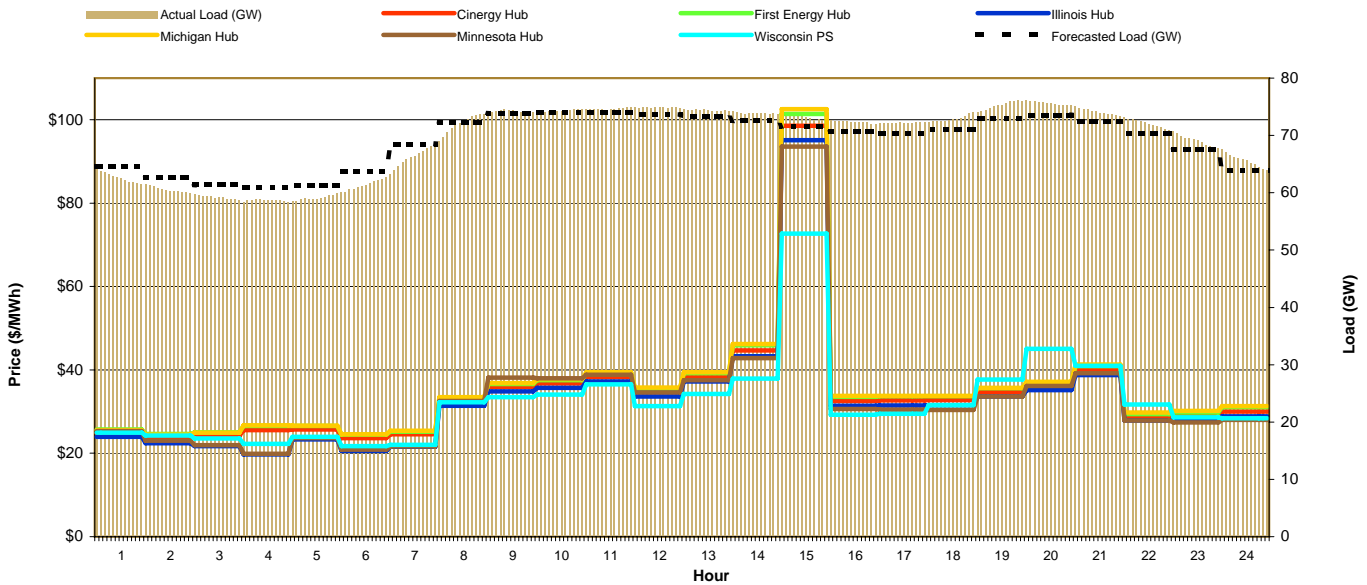




MISO Daily Report

Saturday February 6, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	28.18	27.79	26.89	26.27	26.18	26.98	28.23	33.59	37.14	44.41	48.82	45.86	41.41	33.93	32.37	30.40	30.83	39.46	55.84	53.89	53.13	46.55	38.46	33.68	37.10	41.63
First Energy Hub	29.47	29.11	28.73	28.39	28.31	28.37	29.69	35.28	39.79	47.89	52.37	49.04	44.47	36.88	35.15	33.11	33.73	42.04	61.29	59.65	59.12	50.60	40.23	35.23	39.91	45.04
Illinois Hub	27.22	26.82	26.01	25.18	25.00	27.30	27.82	34.13	36.19	43.39	47.72	44.82	40.46	33.11	31.58	29.63	30.04	38.50	54.57	52.68	51.96	45.46	37.40	32.67	36.24	40.73
Michigan Hub	26.99	26.44	24.80	23.62	23.57	25.40	27.25	32.75	36.02	43.86	48.42	45.57	40.99	33.11	31.57	29.52	29.88	38.99	54.80	52.66	51.82	45.80	37.59	32.73	36.01	40.83
Minnesota Hub	25.63	24.87	23.50	23.05	23.10	23.00	27.44	33.61	38.50	46.27	50.89	47.79	43.13	35.28	33.65	31.19	31.89	41.04	58.22	56.20	55.44	47.91	36.78	31.94	37.10	42.99
Wisconsin PS	23.74	23.28	21.37	20.92	21.31	22.35	28.75	40.76	43.75	46.74	49.14	46.98	42.48	36.50	34.53	31.99	32.95	42.44	59.98	60.01	54.86	47.71	36.92	32.31	37.57	44.23
Cleared Load (GW)	59.9	57.5	56.6	56.0	55.9	57.7	60.2	63.1	64.3	66.2	66.8	66.3	65.9	65.4	64.7	64.2	64.3	65.9	69.5	70.0	68.2	66.9	64.8	62.2		

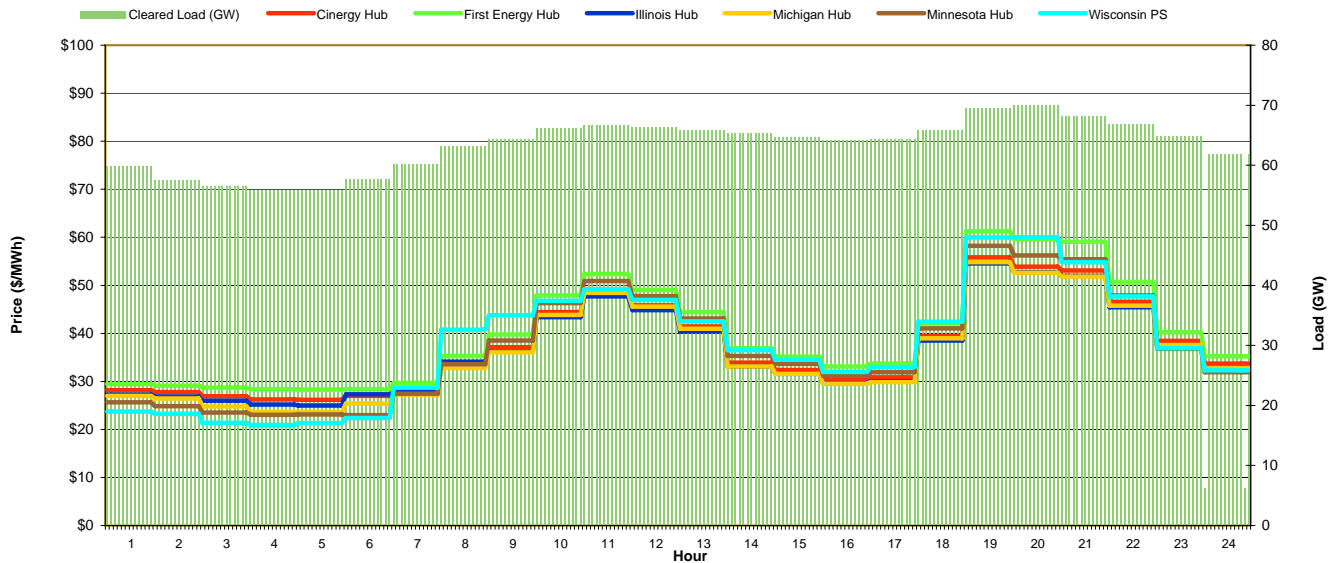

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	36.60	43.58	32.79	39.94	26.99	32.52	31.74	35.94	39.89	62.48	28.50	36.83	54.69	72.05	39.48	29.31	32.49	41.56	87.04	68.10	68.39	62.46	45.73	43.17	45.51	50.31
First Energy Hub	37.88	45.03	33.87	41.41	27.98	33.62	32.71	37.09	41.10	64.27	29.38	38.05	56.41	74.29	40.79	30.42	33.72	43.14	90.56	70.66	70.77	64.65	47.28	44.58	47.07	52.04
Illinois Hub	35.03	41.57	28.83	34.28	25.19	31.13	30.51	34.29	38.23	59.81	27.26	35.19	52.10	68.76	37.87	28.09	31.10	39.84	83.69	65.83	66.08	60.27	44.17	41.54	43.36	48.29
Michigan Hub	37.97	45.29	34.07	41.74	28.05	33.71	32.73	37.09	41.00	64.05	29.58	37.77	56.02	73.90	40.34	29.87	33.05	42.19	88.35	68.40	68.80	63.20	46.57	46.38	46.67	51.26
Minnesota Hub	25.96	34.29	23.48	27.41	22.89	25.21	22.41	31.38	35.24	55.68	26.64	34.53	50.88	66.75	37.72	28.52	31.46	40.40	87.71	71.84	71.22	63.93	45.59	42.69	41.83	48.72
Wisconsin PS	31.16	35.84	27.36	31.32	24.85	28.44	27.60	32.87	34.12	48.28	28.92	31.53	43.09	53.52	33.87	26.92	29.05	37.01	71.47	65.73	59.24	53.00	38.89	28.78	38.45	42.97
Forecasted Load (GW)	61.5	60.8	59.7	59.2	59.0	59.7	61.4	63.9	65.3	67.4	68.6	68.8	67.8	67.0	66.9	66.2	66.2	67.8	70.4	71.7	71.0	69.5	67.2	64.6		
Forecast Error %	0.8%	-1.5%	-1.9%	-1.9%	-1.6%	-1.2%	-0.5%	-0.4%	0.4%	0.4%	0.0%	-0.3%	-0.2%	-0.8%	-2.8%	-2.9%	-2.7%	-2.5%	0.3%	0.0%	-0.2%	-0.2%	-0.2%	-1.0%		

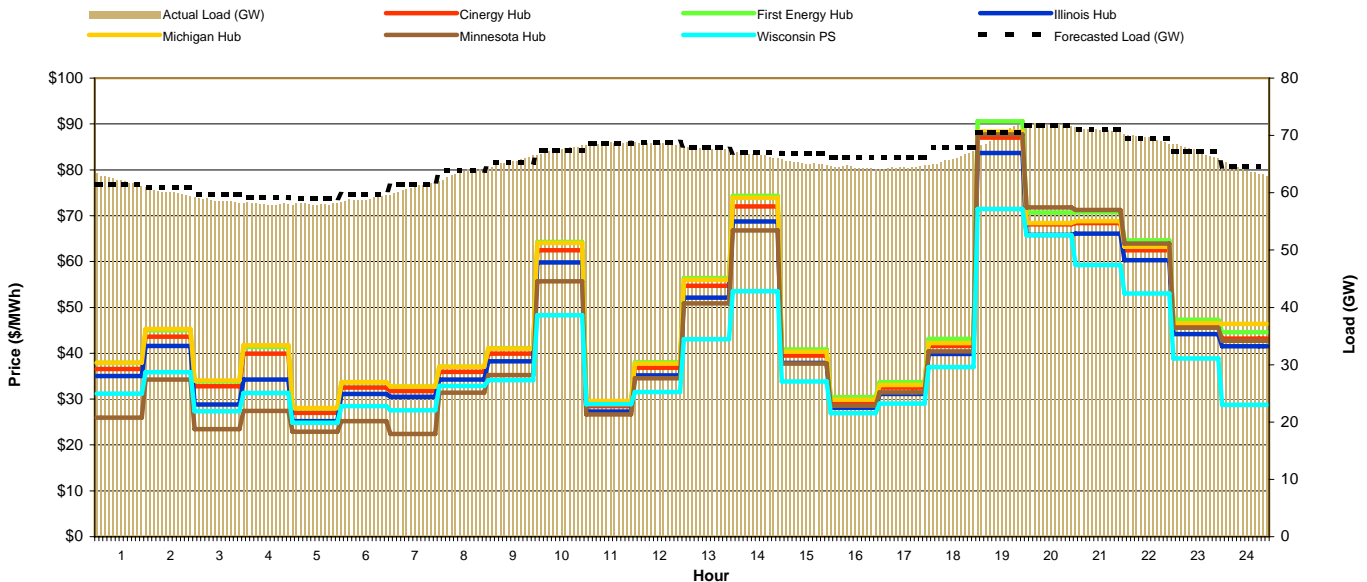




MISO Daily Report

Sunday February 7, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	32.90	31.62	30.62	29.70	29.51	28.47	30.13	33.57	34.57	38.15	38.29	37.17	35.44	33.20	30.56	29.40	30.83	38.15	49.15	51.17	48.06	43.95	37.47	31.77	35.58	38.07
First Energy Hub	34.02	32.68	31.62	30.66	30.46	29.48	31.39	34.89	35.92	39.65	39.63	38.48	36.68	34.35	31.62	30.46	31.89	39.45	50.76	52.82	49.64	45.47	38.67	32.68	36.81	39.40
Illinois Hub	31.94	30.68	29.70	30.30	30.62	29.54	31.08	32.76	33.73	37.27	37.45	36.36	34.65	32.44	29.85	28.71	30.11	37.28	48.09	50.05	47.01	42.98	36.57	30.88	35.00	37.21
Michigan Hub	32.71	31.39	30.41	29.49	29.30	28.00	29.90	33.63	34.64	38.54	39.10	37.90	36.13	33.80	31.12	29.88	31.39	38.81	50.97	52.28	49.06	44.77	37.93	32.09	35.97	38.75
Minnesota Hub	31.48	30.23	27.79	25.63	25.11	24.50	28.84	34.74	35.96	39.73	39.97	38.81	36.98	34.62	31.85	30.64	32.13	39.80	51.71	53.86	50.51	46.10	36.09	30.47	35.73	39.59
Wisconsin PS	28.82	28.38	24.30	23.37	23.73	24.12	30.67	40.59	42.07	41.77	41.19	40.88	38.19	35.29	32.42	31.19	32.31	41.28	55.46	58.09	51.27	47.00	36.46	31.30	36.67	41.59
Cleared Load (GW)	60.3	59.1	58.6	58.2	58.5	59.7	61.4	62.7	63.6	65.3	65.2	64.9	64.6	64.0	63.6	62.9	63.7	66.3	70.0	70.0	69.2	68.7	66.3	64.4		

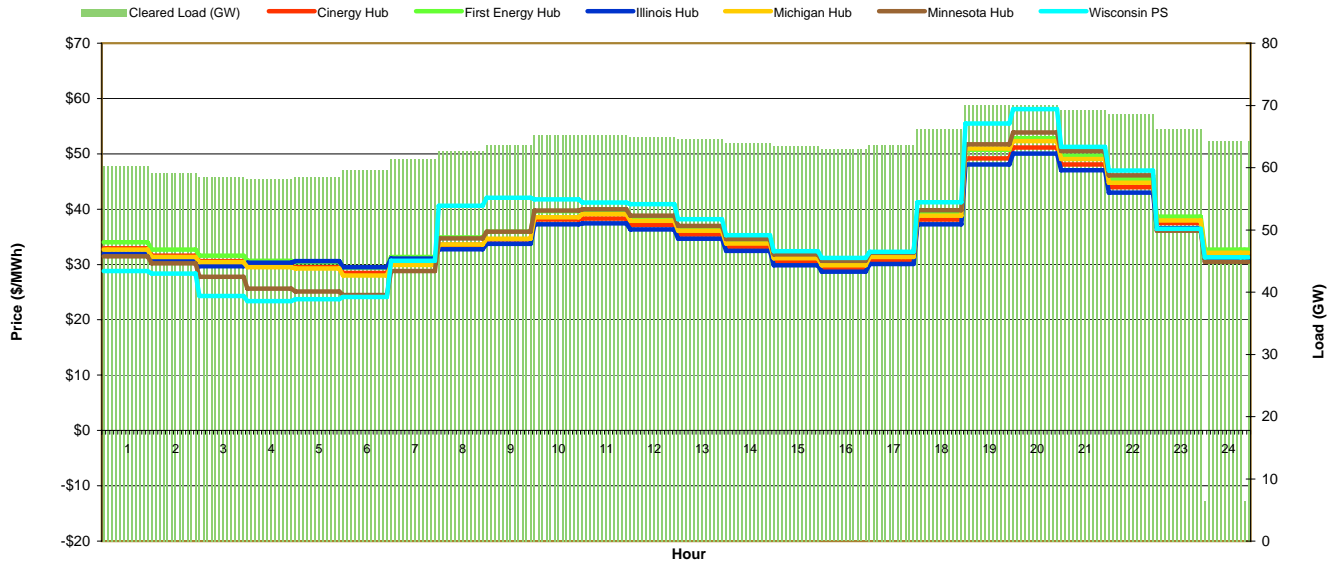

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	30.78	53.42	31.40	32.64	29.41	34.29	47.20	36.50	26.20	25.04	25.89	28.41	29.49	28.19	26.97	28.21	22.79	24.58	31.08	25.86	31.27	28.33	29.37	25.74	30.54	28.01
First Energy Hub	31.72	54.91	32.22	33.46	30.16	35.20	48.21	37.17	26.72	25.62	26.53	29.17	30.30	29.01	27.80	29.10	23.49	25.32	32.10	26.62	32.07	29.02	30.02	26.37	31.35	28.75
Illinois Hub	29.55	51.20	30.04	31.27	28.14	32.84	45.24	34.91	25.01	23.99	24.84	27.27	28.34	27.11	25.95	27.07	21.83	23.48	29.83	24.90	30.09	27.15	28.11	24.60	29.28	26.87
Michigan Hub	35.99	63.09	40.27	42.33	38.45	43.22	51.01	38.60	26.66	25.52	26.52	29.25	30.34	28.93	27.64	28.94	23.35	25.09	31.84	26.44	31.79	28.74	29.77	26.30	33.34	28.71
Minnesota Hub	30.12	50.60	29.03	29.54	26.34	30.42	42.16	32.83	24.05	23.24	23.87	26.06	27.15	26.15	25.14	26.16	21.01	22.44	28.88	24.60	29.38	25.76	26.76	22.84	28.11	25.84
Wisconsin PS	12.38	15.38	1.78	-0.02	-1.53	1.93	28.43	29.05	25.82	25.29	27.48	26.40	27.71	26.76	26.32	26.35	22.96	26.09	34.93	37.99	35.18	31.09	28.63	25.50	22.58	28.63
Forecasted Load (GW)	62.1	60.4	59.4	59.5	59.6	60.3	61.4	62.8	63.4	64.4	64.9	64.9	64.7	64.3	63.8	63.9	64.4	66.2	70.1	71.9	71.3	69.7	67.2	64.4		
Forecast Error %	-1.6%	-1.3%	-1.6%	-2.4%	-2.6%	-2.4%	-1.7%	-0.7%	0.5%	0.8%	0.0%	-0.4%	-0.5%	-0.7%	-1.1%	-0.9%	-1.1%	-2.7%	-2.5%	-2.2%	0.0%	0.1%				

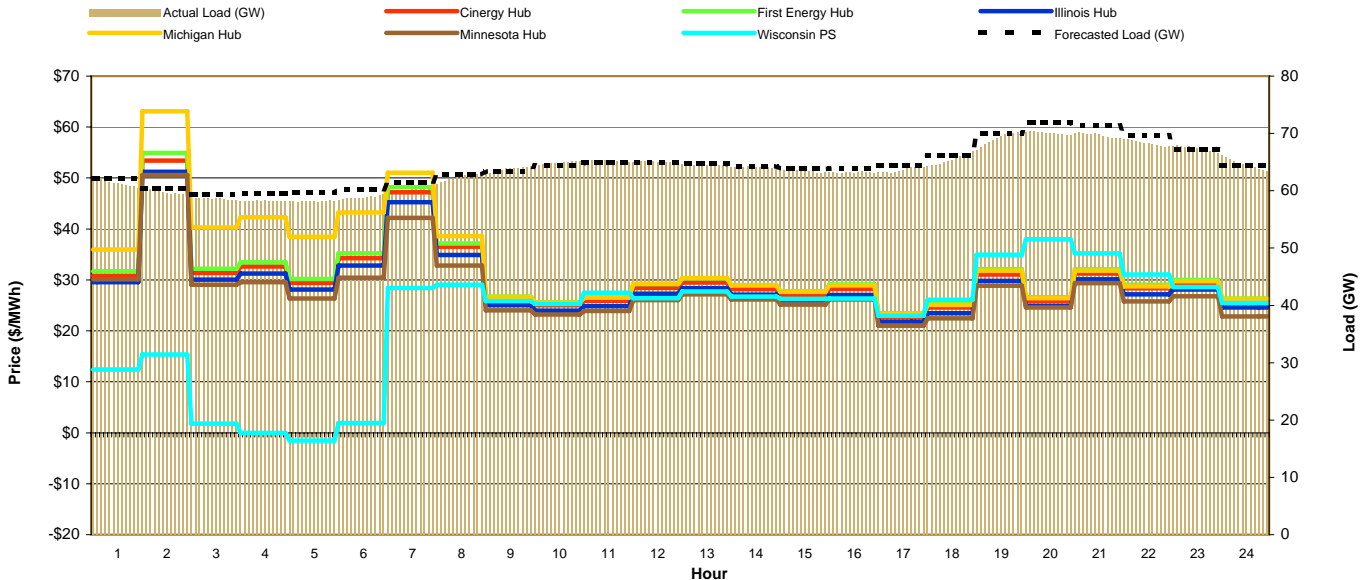




MISO Daily Report

Monday February 8, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$			
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk		
Cinergy Hub	28.07	28.24	28.34	27.98	28.39	31.15	47.70	58.06	52.00	51.66	51.67	50.22	46.23	40.29	36.08	33.15	34.96	41.25	66.50	61.26	51.76	47.09	33.69	30.75	41.94	47.24		
First Energy Hub	29.07	29.23	29.33	28.97	29.26	32.12	49.27	60.12	53.94	53.63	53.52	51.51	47.29	41.13	36.96	34.15	36.05	42.51	68.84	63.42	53.63	48.73	34.82	31.51	43.29	48.77		
Illinois Hub	28.35	27.08	27.06	26.83	27.86	32.21	54.13	58.44	50.71	50.53	50.71	49.52	45.62	39.79	35.61	32.66	34.43	40.41	64.95	59.82	50.53	46.02	32.70	29.91	41.50	46.40		
Michigan Hub	27.68	27.85	28.00	27.62	28.24	31.10	48.05	58.37	52.18	52.20	51.80	48.06	41.96	37.07	33.59	35.44	41.92	67.28	61.91	52.20	47.75	33.59	31.32	42.39	47.97			
Minnesota Hub	24.39	24.45	24.11	23.22	22.33	24.02	37.52	57.74	54.07	53.90	50.09	44.92	41.15	34.61	30.34	28.18	30.41	39.81	69.31	63.83	53.91	49.12	32.23	29.54	39.30	45.85		
Wisconsin PS	23.75	23.66	21.05	21.37	21.92	23.65	34.92	58.57	54.07	52.12	54.18	55.84	51.29	46.05	42.21	38.98	40.27	45.92	67.48	65.15	53.98	49.14	33.81	31.20	42.11	50.57		
Cleared Load (GW)	63.1	61.6	61.1	61.3	62.3	64.8	69.8	76.0	75.8	76.7	76.4	76.0	75.5	75.2	74.2	73.1	73.2	74.2	77.6	78.0	76.8	74.3	70.8	6.8				

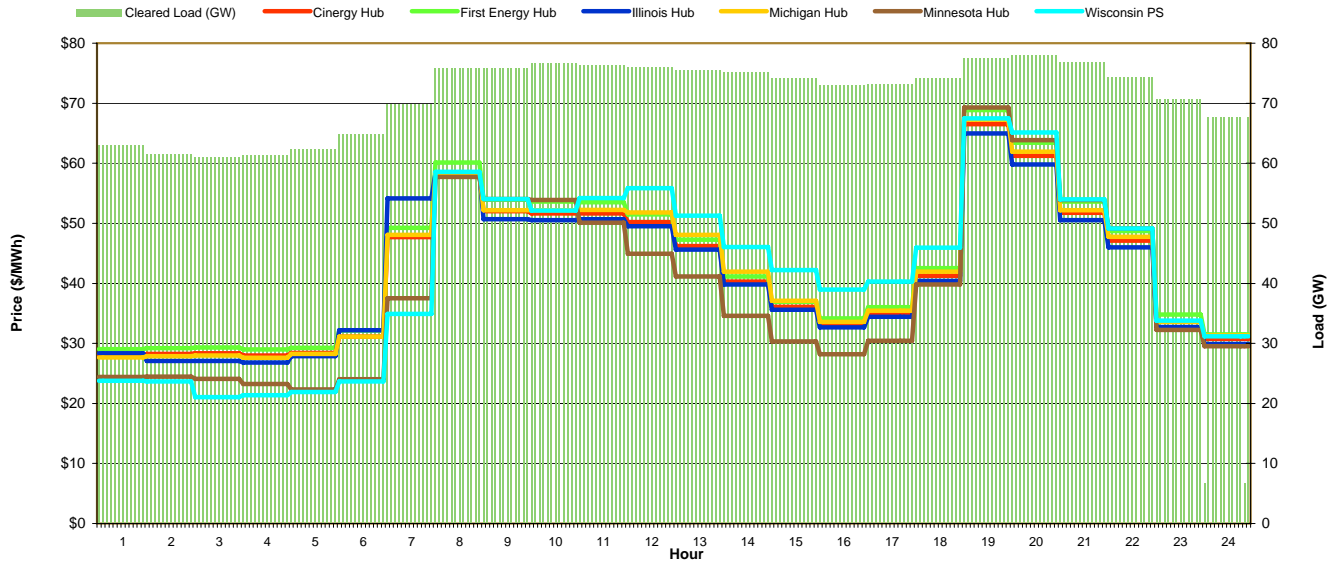

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$			
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk		
Cinergy Hub	26.35	26.89	29.55	27.80	30.26	24.90	51.55	26.45	32.04	26.52	45.02	30.97	59.46	30.65	35.23	28.76	28.82	32.13	76.85	55.05	37.80	31.14	27.37	25.89	35.31	37.77		
First Energy Hub	27.07	28.20	30.35	28.57	31.18	25.51	52.92	26.92	32.70	27.11	46.11	31.70	60.71	31.29	36.02	29.40	29.49	32.86	78.64	56.32	38.63	31.86	28.07	26.69	36.18	38.61		
Illinois Hub	22.02	22.00	23.67	22.70	22.43	22.11	39.44	25.57	30.87	25.66	43.83	30.10	57.37	29.64	34.38	28.12	28.04	31.28	75.01	53.84	36.90	30.25	26.64	25.08	32.79	36.72		
Michigan Hub	27.17	26.56	30.49	28.65	31.48	25.51	54.14	26.77	32.38	26.80	45.60	31.54	60.67	31.30	35.91	29.22	29.23	32.58	77.24	55.38	37.98	31.65	28.01	26.54	35.95	38.27		
Minnesota Hub	19.88	19.88	21.08	20.12	19.28	19.33	13.76	16.87	28.66	20.95	22.60	23.84	52.23	27.36	32.01	26.12	26.11	29.29	72.60	54.09	37.15	29.93	25.96	24.51	28.48	32.86		
Wisconsin PS	22.20	22.76	23.81	24.11	21.39	22.06	11.97	30.82	30.33	28.07	45.27	30.61	47.51	28.48	32.31	27.26	27.38	31.48	65.58	57.62	39.87	33.63	28.12	26.37	31.63	36.52		
Forecasted Load (GW)	62.9	61.5	60.8	60.9	61.7	64.6	70.0	75.5	77.3	77.1	76.8	76.2	75.4	74.3	73.3	72.3	71.8	73.5	77.5	79.3	77.8	75.2	72.0	68.1				
Forecast Error %	-1.7%	-1.5%	-1.1%	-0.9%	-0.6%	-1.0%	0.2%	-0.1%	-0.1%	-0.2%	-0.3%	-0.6%	-0.2%	0.3%	0.5%	1.1%	0.4%	0.4%	0.0%	0.6%	0.8%	0.4%	0.0%					

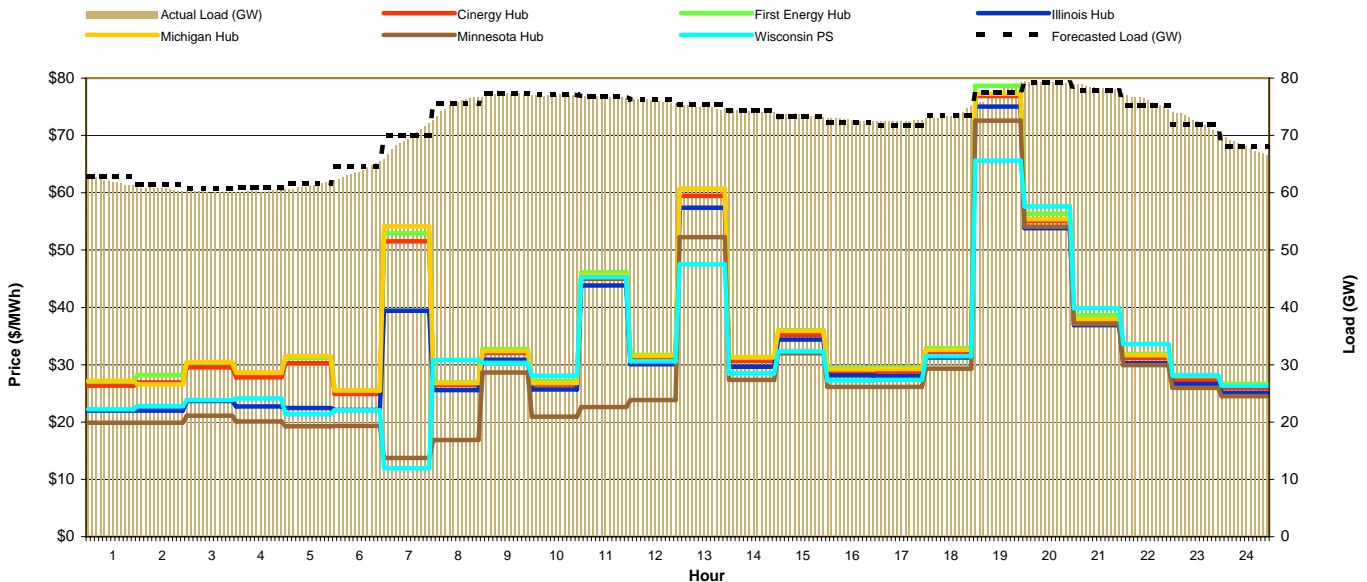




MISO Daily Report

Tuesday February 9, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	27.79	26.81	26.19	26.19	27.00	30.10	41.12	51.68	48.86	47.55	49.75	50.16	44.84	40.78	37.89	33.74	35.11	40.64	56.04	52.23	46.94	40.82	34.54	29.55	39.43	44.47
First Energy Hub	28.72	27.83	27.18	27.19	27.89	31.34	42.16	52.89	50.02	48.78	50.82	51.19	45.76	41.61	38.63	34.41	35.79	41.43	57.48	53.70	48.15	41.81	35.88	30.21	40.45	45.52
Illinois Hub	26.65	26.95	25.85	26.12	26.52	28.10	42.97	56.04	48.43	47.16	49.40	49.79	44.57	40.54	37.69	33.54	34.90	40.51	55.60	51.70	46.49	40.48	33.50	27.23	39.20	44.40
Michigan Hub	27.75	26.55	25.89	25.91	26.92	30.24	41.85	52.72	49.90	48.55	51.12	51.49	46.06	41.88	38.89	34.64	36.01	41.68	57.31	52.93	47.85	41.87	34.67	30.17	40.12	45.47
Minnesota Hub	21.18	20.18	19.50	19.51	19.82	19.55	28.89	43.89	52.28	53.06	48.93	46.95	42.64	38.29	33.31	31.19	27.93	37.13	61.51	58.87	53.24	45.90	35.13	29.75	37.03	44.39
Wisconsin PS	24.10	23.33	21.62	21.44	21.96	22.75	36.66	56.89	53.52	50.08	51.90	52.64	49.37	45.11	42.95	38.37	39.09	48.99	61.15	59.05	50.83	44.95	34.47	30.39	40.90	48.71
Cleared Load (GW)	63.1	62.2	61.4	61.5	62.6	65.5	70.0	75.7	75.6	76.0	75.6	74.8	74.9	74.5	73.8	72.9	73.6	74.3	77.9	78.3	76.6	74.3	71.4	6.8		

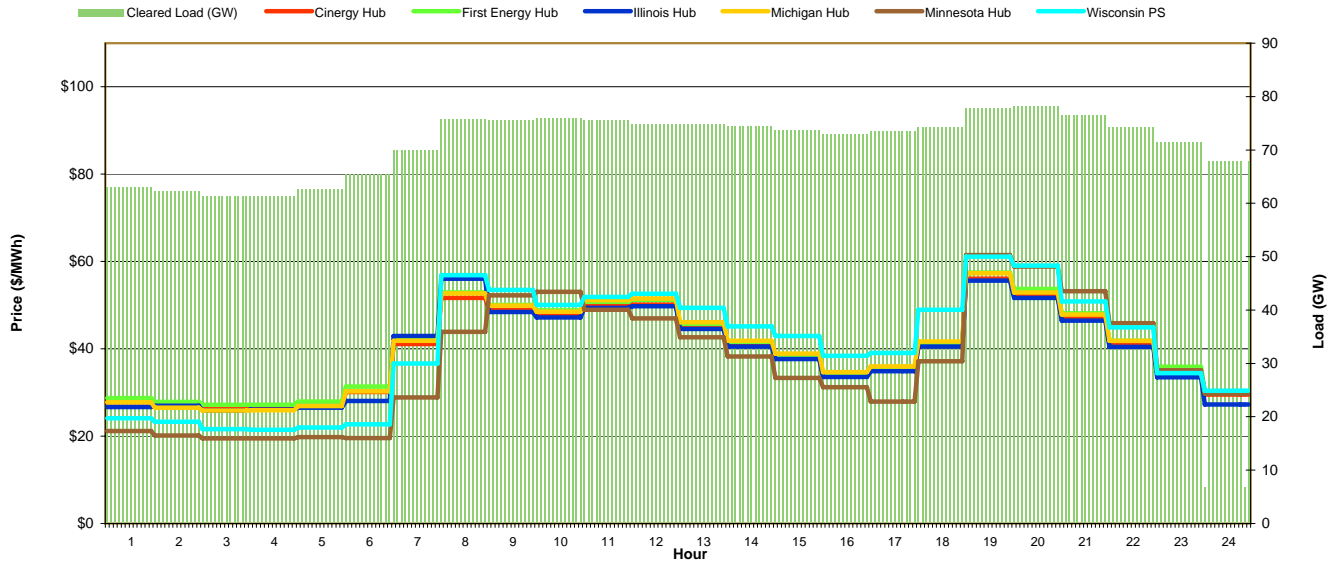

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	28.24	25.92	23.54	24.90	25.91	28.86	105.85	34.96	43.68	41.96	46.85	42.81	37.96	42.06	46.91	31.58	27.98	31.89	57.05	62.81	53.79	35.57	34.53	29.60	40.22	42.02
First Energy Hub	29.22	26.84	24.32	25.64	26.63	29.59	107.50	35.70	44.56	42.77	47.86	43.79	38.84	42.98	47.95	32.26	28.69	32.72	58.25	64.06	54.74	36.19	35.17	30.23	41.10	42.91
Illinois Hub	27.13	24.87	22.69	23.91	24.82	27.60	99.17	33.93	42.69	41.18	45.88	41.90	37.10	41.03	45.71	30.69	27.04	30.69	55.09	60.87	52.10	34.48	33.42	28.45	38.85	40.86
Michigan Hub	29.02	26.62	24.14	25.45	26.50	29.54	106.58	35.89	44.66	42.91	48.03	44.09	39.25	43.57	48.67	32.67	28.81	32.74	57.99	63.43	54.31	36.14	35.40	30.42	41.12	43.04
Minnesota Hub	26.31	23.93	21.14	17.08	22.79	24.85	30.68	30.05	39.77	39.11	38.46	39.68	34.65	38.46	40.70	27.91	25.05	28.37	52.56	60.08	50.98	33.24	32.08	27.29	33.55	38.20
Wisconsin PS	26.77	25.76	24.31	25.66	24.87	25.90	29.92	33.54	38.16	37.08	41.87	36.49	33.78	36.32	39.79	28.96	26.74	31.17	52.38	62.46	49.87	35.94	32.12	28.15	34.50	38.54
Forecasted Load (GW)	65.9	64.9	63.8	63.2	63.2	65.7	70.2	76.1	77.9	77.9	77.9	77.5	76.8	76.1	75.1	74.3	75.1	76.3	78.5	79.7	78.8	76.6	73.7	69.9		
Forecast Error %	-1.6%	-3.1%	-3.0%	-2.5%	-1.3%	-1.2%	0.0%	-0.6%	-1.1%	-0.6%	-0.3%	-0.1%	0.4%	0.7%	1.3%	1.3%	0.2%	0.2%	2.2%	2.6%	2.3%	2.1%	1.2%	0.9%		

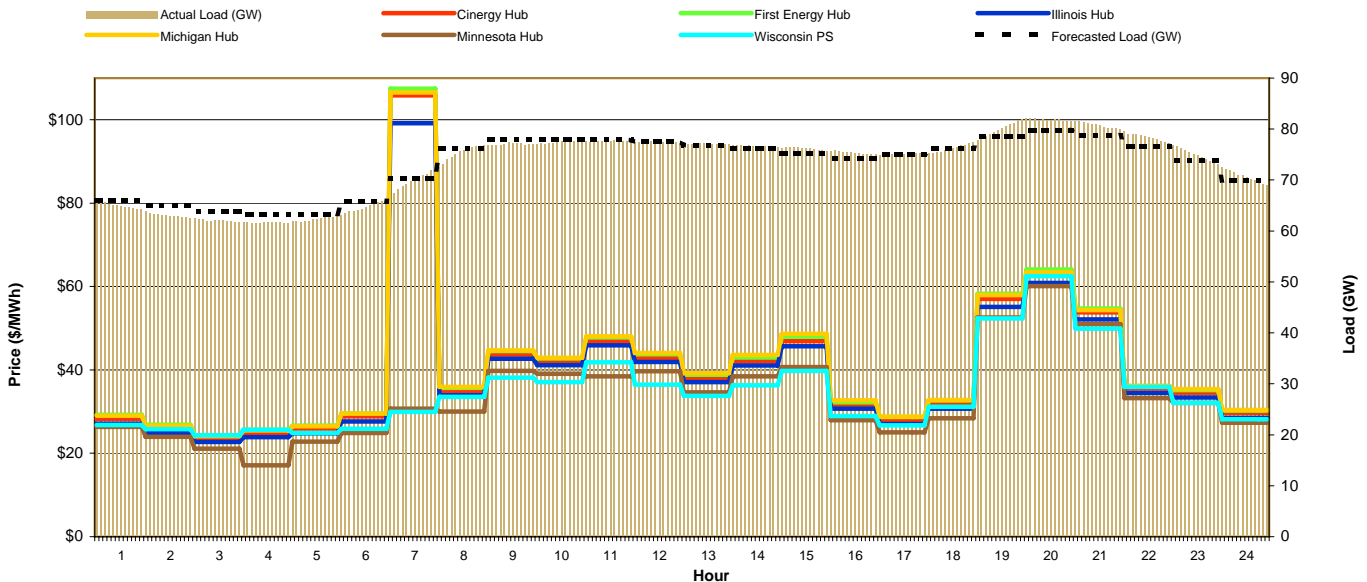




MISO Daily Report

Wednesday February 10, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$			
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk		
Cinergy Hub	27.75	27.31	27.14	26.98	27.74	31.40	46.62	55.32	52.47	52.39	52.21	50.66	47.82	42.69	38.27	33.86	34.71	40.33	62.91	64.30	50.87	44.98	40.11	33.02	42.16	47.74		
First Energy Hub	28.89	28.46	28.26	28.12	28.87	32.92	48.46	57.03	54.60	54.47	54.74	53.08	49.30	43.90	39.50	35.11	35.82	41.55	64.92	66.16	53.14	46.48	41.70	34.58	43.75	49.47		
Illinois Hub	26.89	26.29	26.17	26.13	26.89	24.48	37.16	54.81	52.02	51.94	51.87	50.33	47.41	42.30	37.85	33.48	34.36	40.02	62.38	63.62	50.34	44.52	38.97	31.91	40.92	47.26		
Michigan Hub	27.68	27.07	26.92	26.75	27.58	31.61	47.58	55.94	52.82	52.75	52.45	50.89	48.35	43.31	38.42	33.86	34.99	40.95	63.88	64.90	50.89	45.37	40.28	32.61	42.41	48.13		
Minnesota Hub	27.06	25.89	24.70	24.46	24.55	24.83	41.25	60.56	57.53	57.47	57.29	55.59	52.37	46.75	41.80	36.65	36.83	44.21	69.04	70.30	55.60	49.27	39.80	32.66	44.02	51.94		
Wisconsin PS	25.29	22.87	20.38	20.42	21.11	22.59	35.76	56.09	54.68	52.79	51.99	51.07	47.61	42.73	38.69	35.23	36.47	43.24	65.26	67.37	53.47	47.78	38.17	32.66	40.99	48.91		
Cleared Load (GW)	64.8	62.8	61.9	61.9	62.5	65.2	70.1	75.3	75.7	75.5	75.4	75.3	75.0	74.6	74.0	72.9	73.0	73.6	77.0	77.0	76.7	74.3	71.1	6.8				

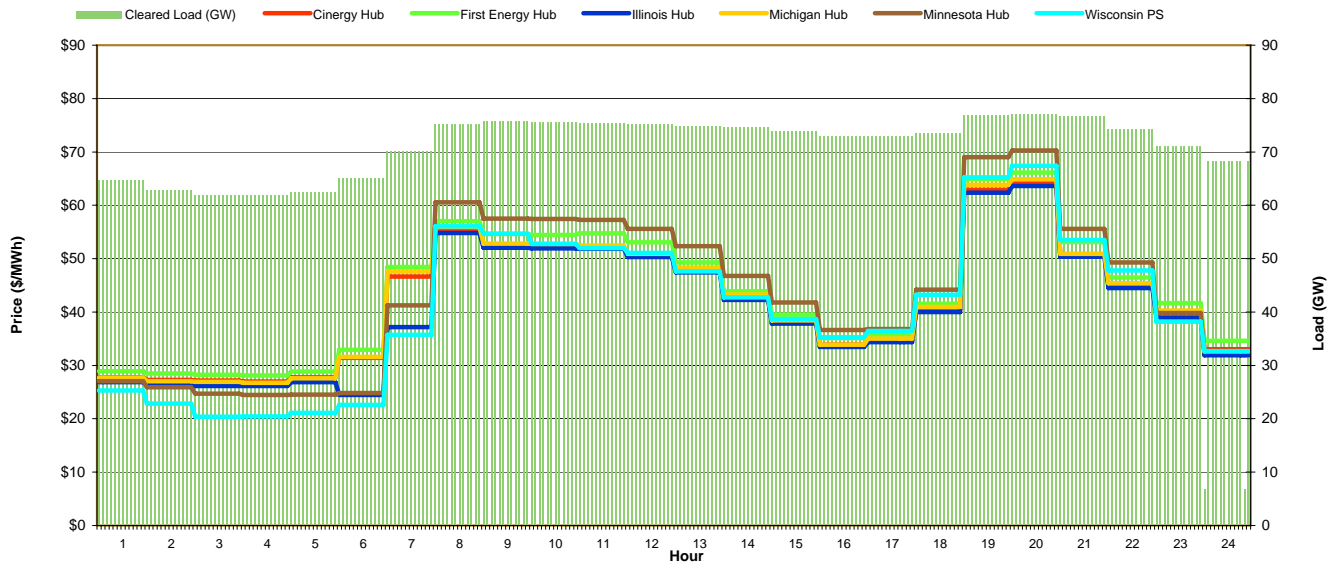

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$			
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk		
Cinergy Hub	31.29	52.86	27.18	28.56	27.83	27.06	27.81	51.53	37.17	71.46	84.46	45.33	35.94	33.48	33.46	38.61	26.45	27.95	45.89	64.60	32.85	27.02	32.05	28.66	39.15	43.02		
First Energy Hub	32.33	54.43	27.85	29.87	28.67	27.96	28.30	53.35	37.84	73.20	86.65	46.72	37.00	34.42	34.37	39.63	27.17	28.71	47.03	65.97	33.55	27.58	32.83	29.59	40.21	44.13		
Illinois Hub	29.43	48.25	25.73	26.59	25.18	23.27	26.36	49.87	35.57	68.39	80.34	43.21	31.86	30.95	31.44	35.99	24.20	26.40	43.76	61.93	31.50	25.96	30.82	27.86	36.87	40.76		
Michigan Hub	32.31	54.41	27.66	29.71	28.57	27.98	27.92	52.17	36.85	71.35	84.53	45.95	36.61	34.12	34.13	39.44	27.11	28.51	46.40	64.87	33.00	27.15	32.69	29.66	39.71	43.43		
Minnesota Hub	28.01	45.64	24.28	24.72	23.77	21.78	13.95	47.93	33.85	68.04	78.66	41.93	28.58	29.50	29.95	33.61	22.28	24.76	41.90	61.36	31.48	26.04	30.65	28.04	35.03	39.41		
Wisconsin PS	27.82	40.31	26.10	26.83	23.26	22.79	25.12	44.04	33.15	55.25	64.38	37.13	27.55	28.94	29.92	31.79	24.13	28.34	44.67	63.18	36.25	30.80	31.15	28.39	34.64	38.17		
Forecasted Load (GW)	67.3	66.3	65.1	64.8	65.3	67.8	71.6	76.8	78.0	78.1	78.1	77.7	77.2	76.3	75.3	75.6	75.4	76.6	79.3	80.6	79.5	77.4	74.5	70.6				
Forecast Error %	0.1%	-1.1%	-1.0%	-0.9%	-0.9%	-1.3%	-0.1%	-0.2%	0.1%	0.5%	0.3%	0.1%	-0.2%	-0.5%	-0.2%	-2.0%	-2.5%	-2.6%	-1.3%	-0.4%	-0.1%	-0.2%	-1.1%	-1.3%				

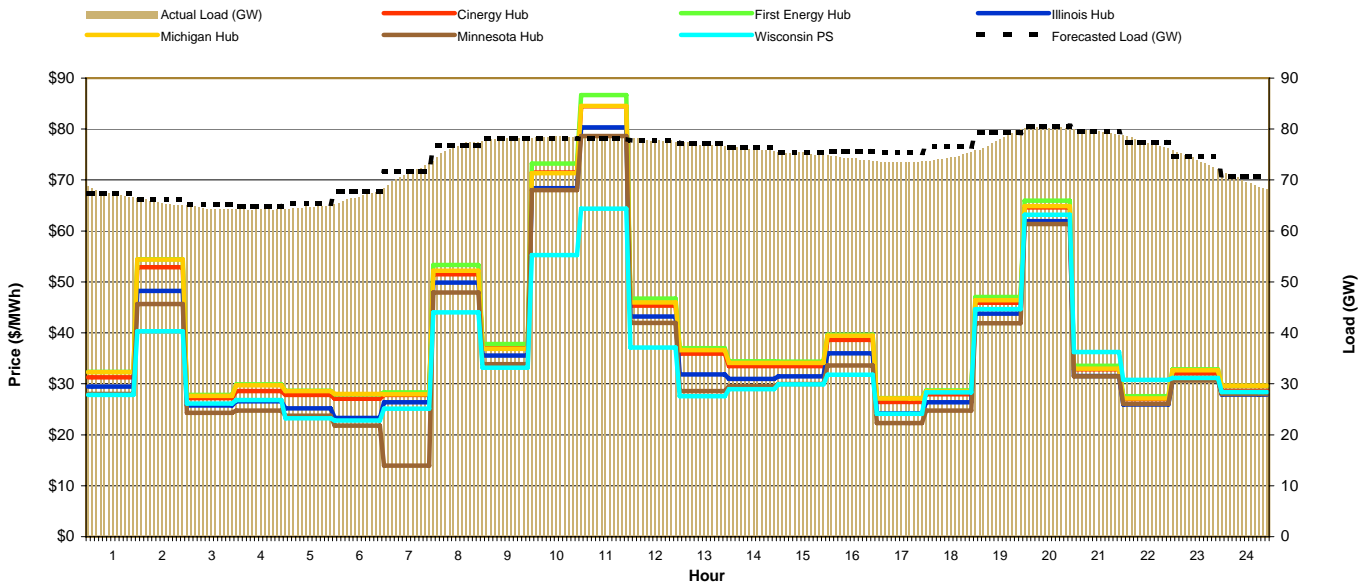




MISO Daily Report

Thursday February 11, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	31.84	30.68	29.12	29.05	29.98	33.43	49.70	58.00	57.67	57.00	53.71	49.59	45.81	40.49	37.55	33.41	33.36	37.94	57.60	62.13	51.04	42.09	41.26	37.79	42.93	47.42
First Energy Hub	32.95	32.08	30.46	30.42	31.35	34.69	51.54	59.93	59.73	58.90	55.57	51.35	47.14	41.63	38.63	34.42	34.31	38.99	59.36	64.10	52.76	43.60	43.06	37.73	44.36	48.97
Illinois Hub	31.13	29.93	28.40	28.36	28.06	27.78	43.92	57.58	57.18	56.55	53.32	49.23	45.53	40.25	37.28	33.11	33.09	37.69	57.17	61.59	50.60	41.72	40.08	36.88	41.93	47.00
Michigan Hub	32.90	30.89	29.28	29.24	30.30	34.96	50.66	58.94	58.24	57.83	54.49	50.25	46.83	41.51	38.29	33.80	33.94	38.86	58.73	63.06	51.67	42.48	41.46	38.83	43.64	48.15
Minnesota Hub	31.88	30.57	29.00	28.96	28.64	27.71	47.07	62.36	63.27	62.58	59.00	54.47	50.33	44.49	41.16	36.56	36.55	41.62	63.27	68.15	55.99	46.16	41.03	37.77	45.36	51.69
Wisconsin PS	28.43	27.97	25.97	25.77	25.70	24.06	38.72	55.93	58.30	56.03	53.08	50.36	46.32	41.31	38.31	34.84	35.08	41.62	61.61	66.01	53.71	45.81	38.99	36.05	42.08	48.58
Cleared Load (GW)	66.9	65.3	64.5	64.5	65.2	67.4	71.9	77.4	77.7	77.2	77.2	76.3	75.8	75.0	74.0	72.5	72.6	73.8	77.4	78.4	77.0	75.0	71.6	6.9		

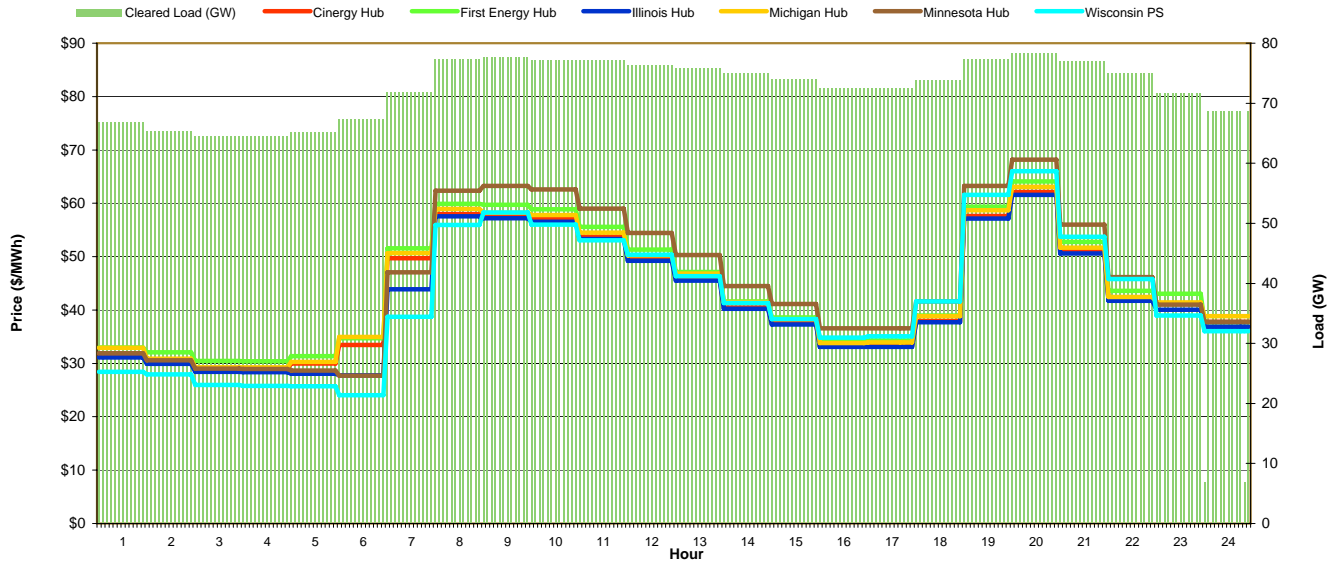

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	24.01	25.59	25.08	26.82	25.99	25.95	28.39	78.23	42.74	37.70	30.00	33.25	31.15	33.33	31.43	28.89	28.78	27.23	45.19	37.80	41.97	37.60	41.66	27.47	34.01	37.93
First Energy Hub	24.56	26.22	25.70	27.55	26.67	26.51	28.94	80.10	43.87	38.70	30.80	34.32	32.12	34.35	32.38	29.81	29.73	28.07	46.68	38.88	43.28	38.71	42.56	28.14	34.94	39.02
Illinois Hub	22.91	24.28	23.63	21.96	22.23	23.58	26.90	75.41	41.47	36.42	28.91	32.11	29.94	31.98	30.13	27.68	27.58	26.11	43.45	36.59	40.76	36.58	40.21	26.51	32.39	36.58
Michigan Hub	24.59	26.19	25.61	27.70	26.79	26.61	28.84	79.17	42.95	37.66	29.97	33.59	31.79	34.06	32.16	29.60	29.54	27.80	46.06	38.25	42.54	38.29	42.70	28.48	34.62	38.51
Minnesota Hub	22.74	24.06	22.99	20.86	20.95	22.22	25.20	73.06	41.58	36.30	28.75	31.77	29.23	31.14	29.77	27.19	27.03	25.92	43.03	37.00	41.02	36.50	39.98	26.79	31.88	36.20
Wisconsin PS	24.21	25.74	25.37	24.14	23.04	24.02	26.26	63.12	38.21	34.79	31.23	30.93	29.89	31.09	30.00	27.44	27.27	28.29	44.59	45.97	42.49	37.61	37.23	27.50	32.52	36.26
Forecasted Load (GW)	67.7	66.9	65.9	65.8	66.6	69.0	72.9	77.9	78.6	78.3	78.0	77.2	76.2	75.3	74.2	73.4	74.2	75.8	78.5	80.0	78.9	76.8	74.0	70.2		
Forecast Error %	-1.8%	-3.1%	-3.4%	-3.5%	-3.6%	-3.2%	-1.2%	-0.1%	0.7%	0.4%	-0.4%	-0.7%	-0.9%	-1.1%	-1.0%	-1.4%	-3.2%	-2.9%	-2.4%	-1.9%	-1.5%	-1.7%	-1.5%			

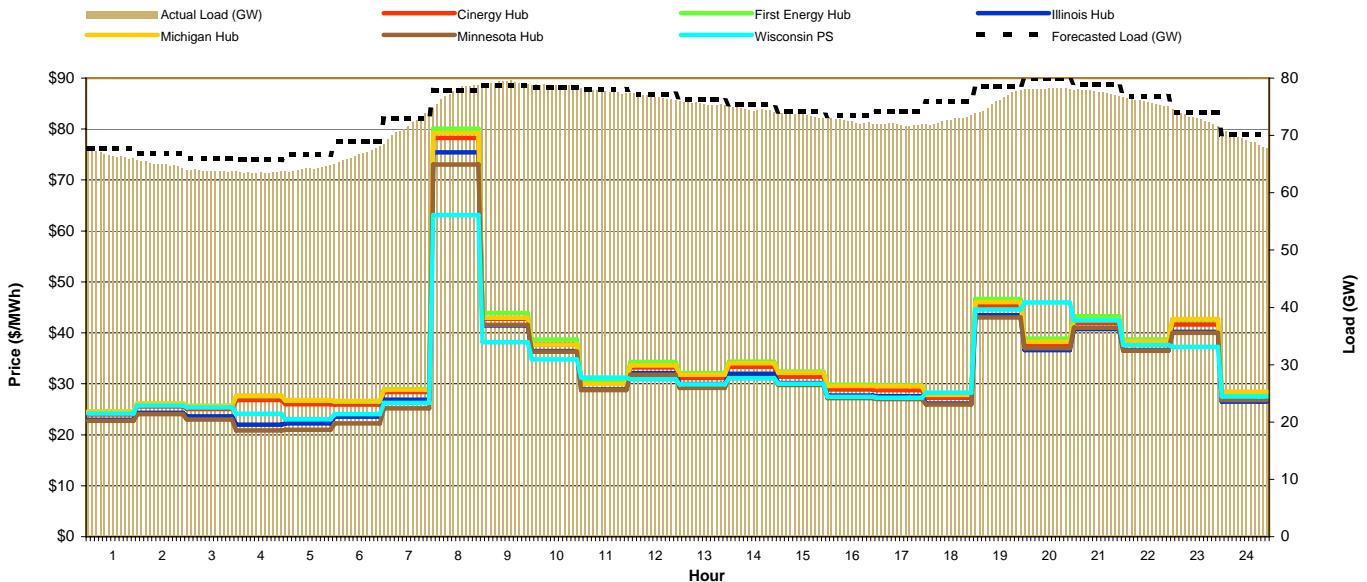




MISO Daily Report

Friday February 12, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	29.00	28.31	27.35	27.27	27.75	28.42	40.31	54.21	51.76	50.22	49.19	43.93	40.26	36.40	34.22	30.06	29.43	31.88	47.36	47.71	43.19	36.59	33.27	30.49	37.44	41.23
First Energy Hub	29.87	29.18	28.19	28.08	28.57	29.27	41.26	55.88	53.42	51.73	50.53	44.98	41.19	37.23	35.06	30.78	30.17	32.65	48.62	48.97	44.32	37.57	34.61	31.45	38.48	42.36
Illinois Hub	28.22	27.58	26.62	26.51	26.99	27.56	40.01	53.72	51.24	49.73	48.77	43.62	39.94	36.11	33.91	29.78	29.15	31.63	47.06	47.40	42.90	36.33	32.36	29.72	36.95	40.85
Michigan Hub	29.83	29.15	28.15	28.05	28.54	29.23	41.50	55.03	52.33	50.97	50.25	45.23	41.42	37.45	35.01	30.77	30.08	32.73	48.65	49.01	44.33	37.47	33.54	31.40	38.34	42.14
Minnesota Hub	28.91	27.94	26.76	26.67	27.01	27.74	43.61	59.44	56.69	55.04	53.98	48.28	44.21	39.97	37.52	32.96	32.27	35.00	52.07	52.45	47.46	40.18	33.06	30.43	39.99	45.04
Wisconsin PS	26.43	25.91	23.93	23.67	24.19	24.91	38.62	55.37	54.13	51.24	49.89	46.44	42.43	38.43	35.98	32.54	32.36	37.40	54.52	56.07	48.32	42.03	33.70	31.18	38.74	44.43
Cleared Load (GW)	65.3	63.6	62.3	62.4	63.2	65.1	70.0	75.7	75.5	76.1	75.5	74.5	73.8	73.2	72.1	70.6	70.0	71.0	74.3	74.8	72.9	71.5	68.9	6.5		

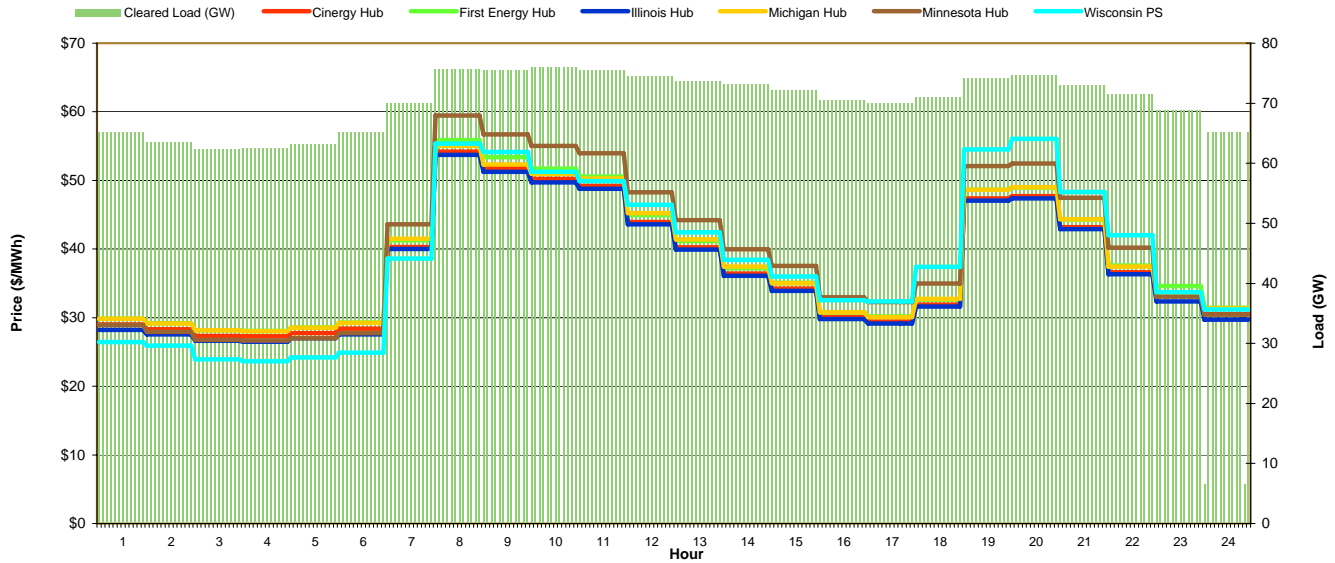

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	25.81	26.46	28.69	26.94	26.97	27.16	29.98	43.03	44.97	33.34	33.24	29.74	28.11	28.61	27.28	25.32	29.18	42.16	35.06	37.27	31.39	46.01	31.68	32.03	34.06	
First Energy Hub	26.85	27.36	29.88	27.84	27.73	27.78	30.64	43.96	45.97	34.05	34.12	31.04	30.60	28.98	29.53	28.16	26.14	30.12	43.47	36.11	38.56	32.24	47.50	32.58	32.97	
Illinois Hub	24.96	25.17	27.55	25.68	25.50	25.55	28.18	41.04	43.16	31.90	31.94	29.02	28.57	26.95	27.41	26.13	24.22	27.84	40.39	33.90	36.07	30.12	44.41	30.34	30.67	
Michigan Hub	27.06	27.39	30.04	28.00	27.90	27.99	30.77	43.85	45.40	33.61	33.94	31.13	30.94	29.38	29.84	28.50	26.37	30.37	44.02	36.50	38.77	32.41	47.72	32.77	33.11	
Minnesota Hub	24.89	24.83	26.93	24.93	24.67	24.52	27.77	42.48	46.29	34.12	33.89	30.64	30.06	28.19	28.08	26.32	24.02	27.39	40.11	34.78	36.58	29.91	44.46	31.24	31.13	
Wisconsin PS	25.56	26.20	27.91	27.37	25.76	25.57	27.29	39.55	39.65	31.76	33.48	28.76	28.99	27.61	28.15	26.46	25.06	29.43	42.57	44.62	39.71	33.60	40.45	30.27	31.49	
Forecasted Load (GW)	67.3	66.4	65.2	64.9	65.5	67.7	71.7	76.5	78.0	77.2	76.5	76.0	74.8	73.8	72.6	71.4	70.8	71.6	74.7	76.0	74.7	72.9	70.2	66.7		
Forecast Error %	-1.8%	-3.4%	-3.1%	-3.0%	-3.1%	-2.6%	-0.9%	-0.1%	-0.2%	0.4%	0.0%	-0.9%	-1.0%	-1.3%	-1.1%	-1.0%	-0.9%	-1.2%	-1.4%	-1.3%	-1.1%	-0.9%	-0.6%	-0.2%		

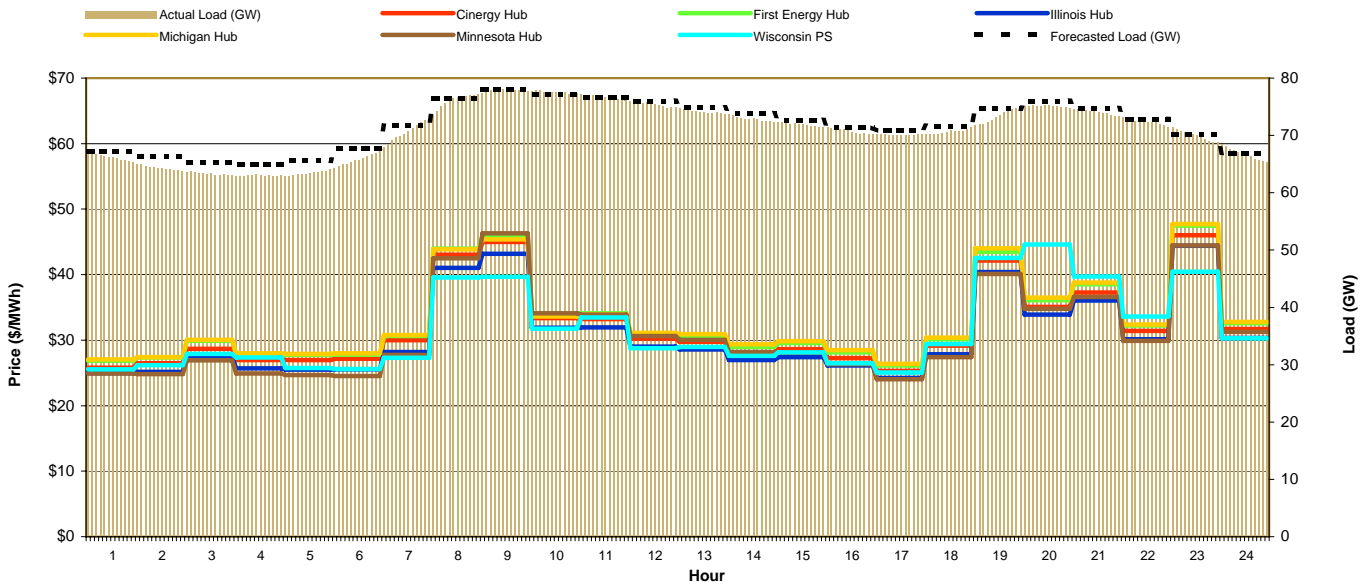




MISO Daily Report

Saturday February 13, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	29.15	29.54	27.99	27.68	27.17	27.34	29.44	34.00	37.00	41.18	42.00	39.18	36.17	31.49	29.62	28.14	28.61	30.84	42.37	42.27	40.54	37.06	31.92	28.62	33.31	35.77
First Energy Hub	30.05	30.56	29.01	28.68	28.12	28.17	30.41	35.01	37.99	42.29	43.14	40.23	37.12	32.31	30.39	28.87	29.35	31.63	43.48	43.38	41.63	38.07	32.92	29.34	34.26	36.74
Illinois Hub	27.83	28.22	26.78	26.47	25.94	25.95	28.59	33.20	36.15	40.26	41.06	38.29	35.34	30.73	28.91	27.46	27.91	30.09	41.47	41.37	39.69	36.28	30.54	27.40	32.33	34.92
Michigan Hub	29.26	29.46	27.92	27.59	27.03	27.52	29.32	34.29	37.57	41.86	42.72	39.83	36.72	31.90	30.00	28.48	28.96	31.24	43.08	42.98	41.21	37.65	32.16	29.21	33.67	36.29
Minnesota Hub	25.42	25.74	24.43	24.14	23.66	23.85	26.41	30.77	33.53	37.34	38.08	35.50	32.76	28.49	26.80	25.45	25.87	27.90	38.40	38.31	36.75	33.60	27.89	25.06	29.84	32.34
Wisconsin PS	25.46	26.14	24.24	23.86	23.91	23.97	30.37	40.10	42.61	43.54	43.40	41.69	38.26	33.84	31.71	30.18	30.74	35.52	49.46	50.71	44.98	41.01	31.75	28.95	34.85	39.34
Cleared Load (GW)	63.0	61.9	61.0	60.7	60.8	62.4	64.4	65.7	66.5	69.0	69.5	68.0	67.1	66.3	65.5	64.3	64.6	66.0	70.3	70.9	70.1	67.9	66.0	64		

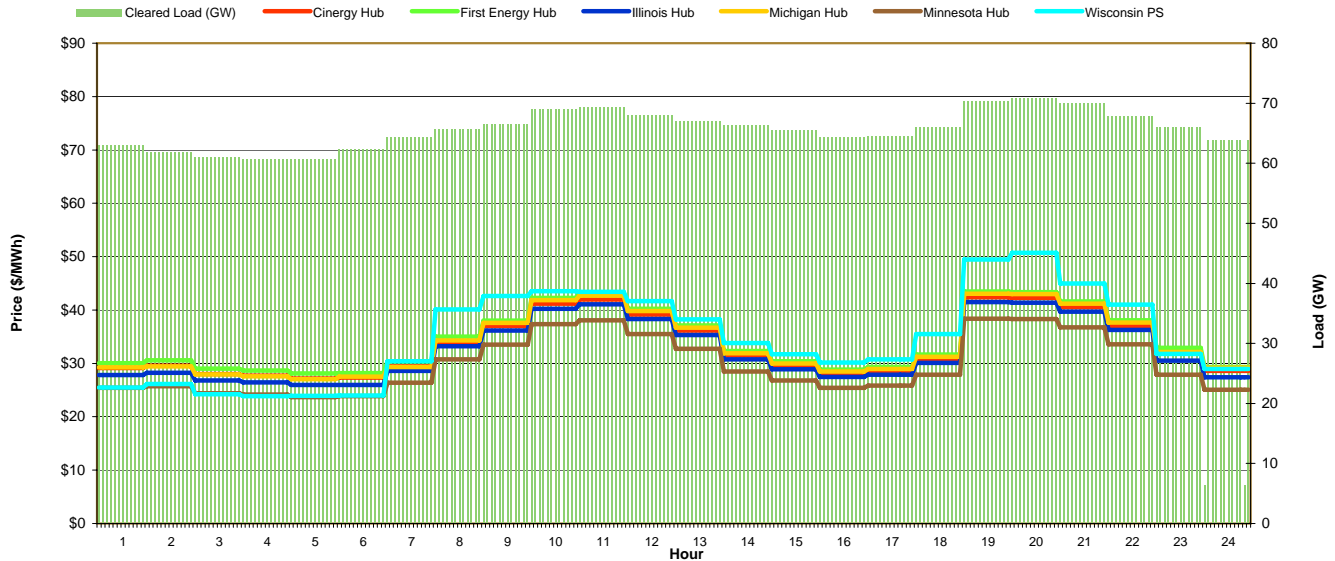

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	34.66	52.48	61.22	31.57	28.17	30.20	41.20	27.83	79.08	34.78	30.25	29.76	27.43	29.68	27.31	37.54	25.71	24.61	50.00	41.99	41.19	56.60	27.36	25.22	37.33	36.95
First Energy Hub	35.74	54.16	62.75	32.32	28.86	30.96	42.16	28.57	80.94	35.69	31.08	30.61	28.25	30.64	28.27	38.87	26.67	25.55	51.73	43.31	42.51	58.34	28.13	25.86	38.42	38.07
Illinois Hub	32.89	49.94	58.01	29.90	26.58	25.26	33.19	26.35	74.88	33.04	28.82	28.40	26.17	28.23	25.92	35.54	24.30	23.24	47.28	39.95	39.14	53.71	25.93	21.77	34.94	35.06
Michigan Hub	35.90	54.40	62.92	32.49	29.04	31.07	42.32	28.59	81.38	35.79	31.08	30.63	28.27	30.62	28.21	39.01	26.69	25.49	51.69	43.30	42.61	58.56	28.28	26.07	38.52	38.14
Minnesota Hub	33.84	51.01	58.14	30.01	27.04	29.03	38.93	26.86	76.44	33.81	30.41	30.51	27.80	29.25	26.53	35.95	24.17	22.99	46.36	40.34	39.56	54.69	26.09	23.44	35.97	35.74
Wisconsin PS	31.18	43.18	48.50	30.23	26.65	27.64	34.08	28.67	60.48	31.88	31.01	28.22	27.19	28.25	26.91	32.83	25.14	26.37	47.25	48.60	41.79	49.84	27.57	25.32	34.53	35.13
Forecasted Load (GW)	64.2	63.2	62.0	62.6	62.7	63.8	65.4	66.1	67.6	69.0	69.5	69.0	67.9	67.2	66.6	65.7	65.4	66.1	70.0	71.7	70.8	69.4	67.3	65.1		
Forecast Error %	-1.2%	-2.8%	-3.0%	-4.7%	-4.9%	-5.2%	-4.1%	-1.3%	-0.8%	-0.2%	-0.3%	-1.0%	-1.4%	-2.7%	-3.6%	-3.6%	-3.2%	-2.2%	-2.4%	-1.5%	-1.3%	-1.1%	-1.2%	-2.1%		

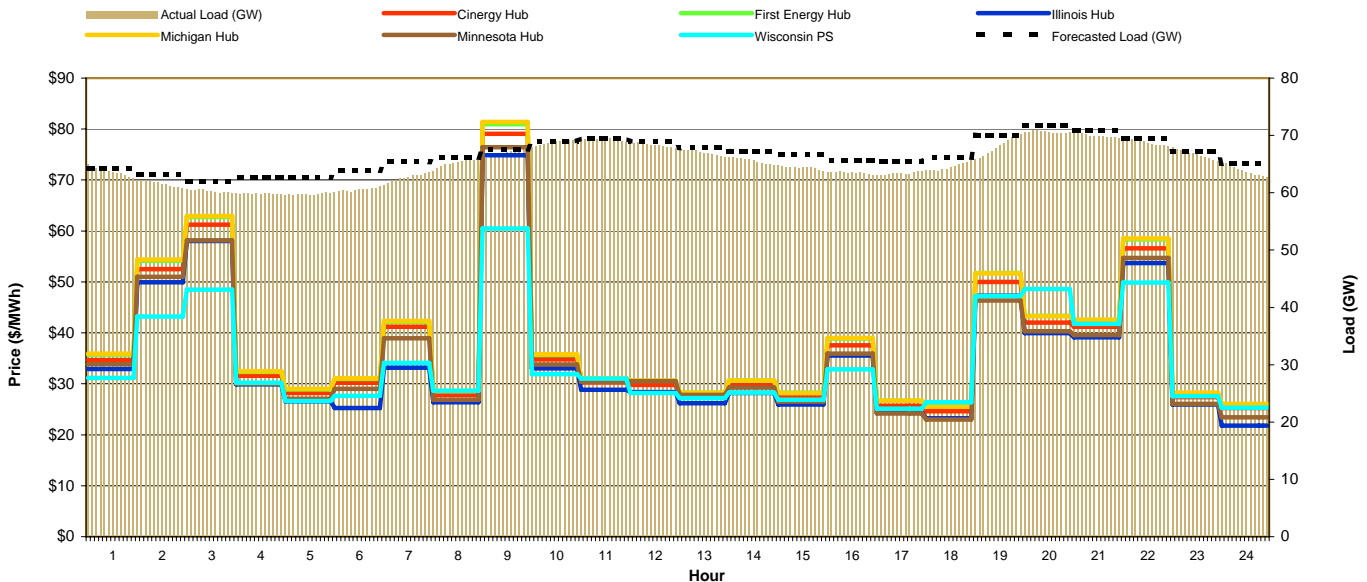




MISO Daily Report

Sunday February 14, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$	
																									All	On Pk
Cinergy Hub	31.16	32.81	31.22	29.50	28.42	28.05	29.23	28.28	28.08	30.78	30.21	29.84	29.02	28.14	25.43	25.01	25.22	28.28	40.64	43.10	39.67	34.51	28.41	26.64	30.49	30.91
First Energy Hub	31.99	33.88	31.94	30.47	29.30	28.91	29.67	29.00	28.82	31.56	30.96	30.57	29.69	28.71	26.01	25.68	25.85	29.03	41.63	44.17	40.72	35.41	29.18	27.25	31.27	31.69
Illinois Hub	29.27	31.39	29.93	28.22	27.17	26.11	27.31	26.93	27.40	30.09	29.51	29.15	28.39	27.57	24.88	24.41	24.64	27.60	39.80	42.17	38.80	33.73	27.14	25.50	29.46	30.14
Michigan Hub	31.62	32.91	31.98	29.56	28.47	28.13	29.40	28.52	28.28	31.17	30.57	30.20	29.44	28.63	25.79	25.18	25.52	28.63	41.43	43.90	40.26	34.99	28.76	27.29	30.86	31.33
Minnesota Hub	25.18	24.67	22.16	20.55	19.78	19.07	19.60	20.11	21.91	26.82	26.81	26.40	23.42	20.59	20.46	20.48	20.69	26.53	36.24	39.92	36.62	31.53	25.61	21.26	24.85	26.51
Wisconsin PS	26.01	27.41	25.43	23.91	23.85	23.54	29.84	37.07	37.24	37.28	36.14	36.18	35.56	35.12	31.14	28.94	29.39	33.62	49.16	51.26	44.39	39.30	29.44	26.93	33.26	36.95
Cleared Load (GW)	62.5	61.6	60.7	60.2	60.5	61.6	62.8	63.4	63.8	65.6	65.4	65.3	65.0	64.1	63.3	63.9	66.2	71.2	71.9	71.2	69.8	67.4	6.6			

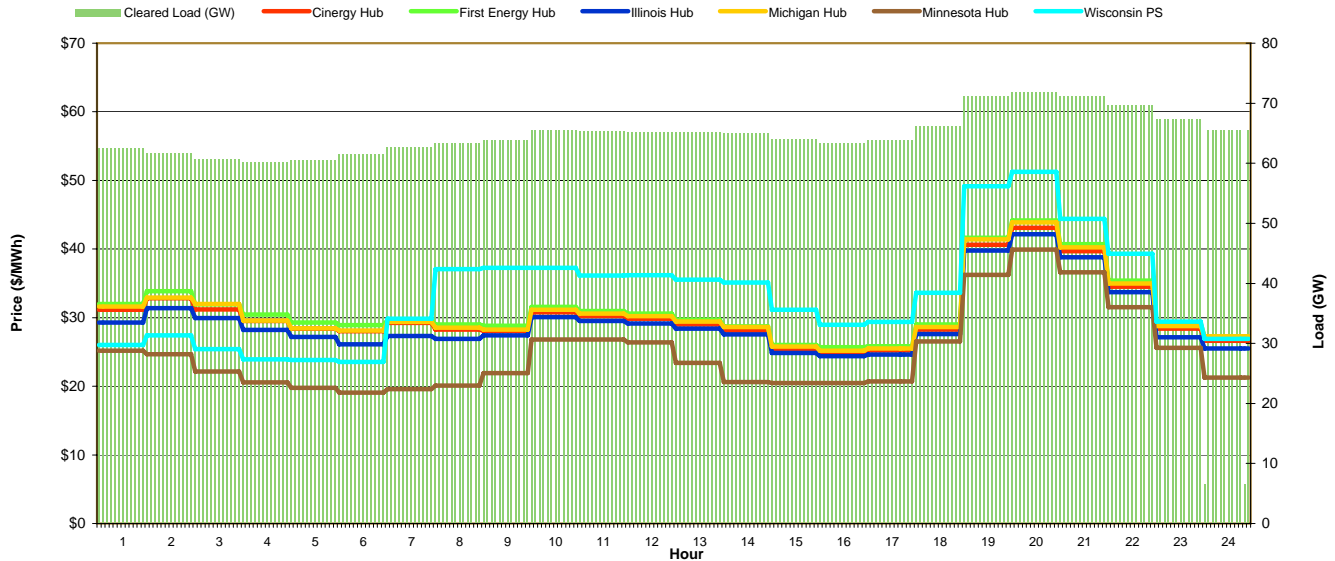

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$	
																									All	On Pk
Cinergy Hub	27.76	26.40	27.47	33.83	21.80	23.83	23.99	25.91	30.42	26.54	27.56	26.40	25.54	24.08	24.30	24.74	27.28	30.79	49.54	32.44	30.51	31.46	26.32	25.37	28.10	28.99
First Energy Hub	27.34	26.76	28.35	35.03	22.28	24.17	24.56	26.57	31.31	27.24	28.38	27.26	26.47	24.97	25.14	25.73	28.35	31.96	50.98	33.29	31.35	32.28	27.16	26.24	28.88	29.90
Illinois Hub	10.54	16.65	20.17	17.72	20.80	17.18	21.36	21.24	22.12	23.34	23.46	22.30	20.47	19.97	23.62	20.23	22.25	25.34	47.46	31.21	29.26	30.16	22.09	20.19	22.88	25.28
Michigan Hub	27.55	27.20	29.05	36.25	22.57	24.44	24.81	26.72	31.58	27.20	28.47	27.37	26.71	25.14	25.19	25.88	28.64	32.34	51.31	33.60	31.67	32.71	27.72	26.85	29.21	30.14
Minnesota Hub	24.44	20.28	19.67	17.87	19.77	20.46	18.63	19.27	19.87	21.59	21.76	20.49	18.52	18.12	8.76	17.82	15.07	46.66	32.24	29.23	27.96	28.47	20.29	16.27	21.81	22.88
Wisconsin PS	25.34	21.99	22.01	20.04	22.49	22.77	21.23	23.90	22.34	24.49	26.20	22.61	21.68	21.33	22.72	21.13	22.23	26.53	47.19	42.49	34.92	33.48	24.11	21.90	25.63	27.33
Forecasted Load (GW)	61.8	61.1	60.2	59.8	59.7	60.2	61.7	62.9	63.0	64.0	64.6	64.1	63.6	63.1	62.6	62.0	62.2	64.2	69.3	71.8	71.1	69.4	67.1	64.1		
Forecast Error %	-0.9%	-2.8%	-3.0%	-3.0%	-2.9%	-2.7%	-1.5%	0.3%	1.2%	0.7%	1.1%	1.4%	1.6%	1.3%	1.5%	2.1%	1.8%	6.4%	0.5%	0.1%	0.6%	0.8%	0.6%	1.0%		

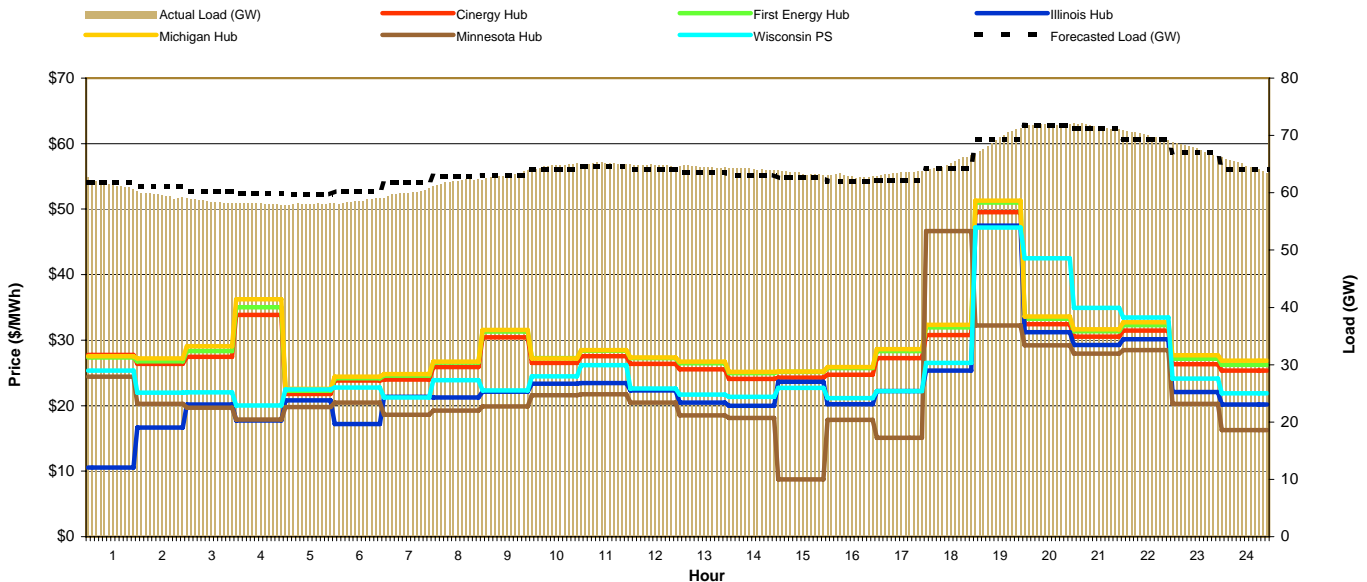




MISO Daily Report

Monday February 15, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	25.33	25.00	24.79	24.54	25.08	26.38	35.97	48.82	48.44	49.87	49.87	49.85	46.25	41.02	37.57	32.66	33.10	38.12	57.34	62.94	49.85	44.89	34.76	29.09	39.23	45.33
First Energy Hub	25.60	25.19	24.94	24.65	25.21	26.51	36.32	49.96	49.60	51.06	51.06	51.06	47.33	41.97	38.43	33.40	33.86	39.00	58.70	64.44	51.06	45.84	35.46	29.55	40.00	46.39
Illinois Hub	17.97	17.86	17.25	16.63	17.22	18.22	28.11	47.19	47.35	48.74	48.74	48.75	45.18	40.07	36.68	31.88	32.31	37.24	56.03	61.51	48.74	42.07	31.55	24.57	35.91	44.00
Michigan Hub	25.43	25.14	24.93	24.52	25.12	26.35	35.81	49.29	49.29	50.74	50.74	50.74	47.04	41.73	38.19	33.20	33.64	38.76	58.33	64.03	50.74	45.56	35.30	29.51	39.76	46.08
Minnesota Hub	18.94	18.74	18.42	17.96	18.15	18.33	21.61	32.82	42.87	44.19	45.09	44.64	41.84	37.01	33.94	29.50	29.92	34.00	51.83	56.97	45.14	40.54	30.28	25.26	33.25	40.04
Wisconsin PS	21.22	21.62	20.43	20.19	20.24	21.37	31.38	46.85	50.27	49.42	48.74	48.84	45.03	40.15	37.08	33.31	33.88	39.95	59.41	64.41	51.23	46.18	33.56	28.72	38.06	45.52
Cleared Load (GW)	62.7	61.4	60.9	60.8	61.8	63.9	69.8	73.9	74.2	75.2	75.4	74.6	74.7	73.8	73.2	72.2	72.5	73.6	77.1	77.6	76.5	73.8	71.4	6.7		

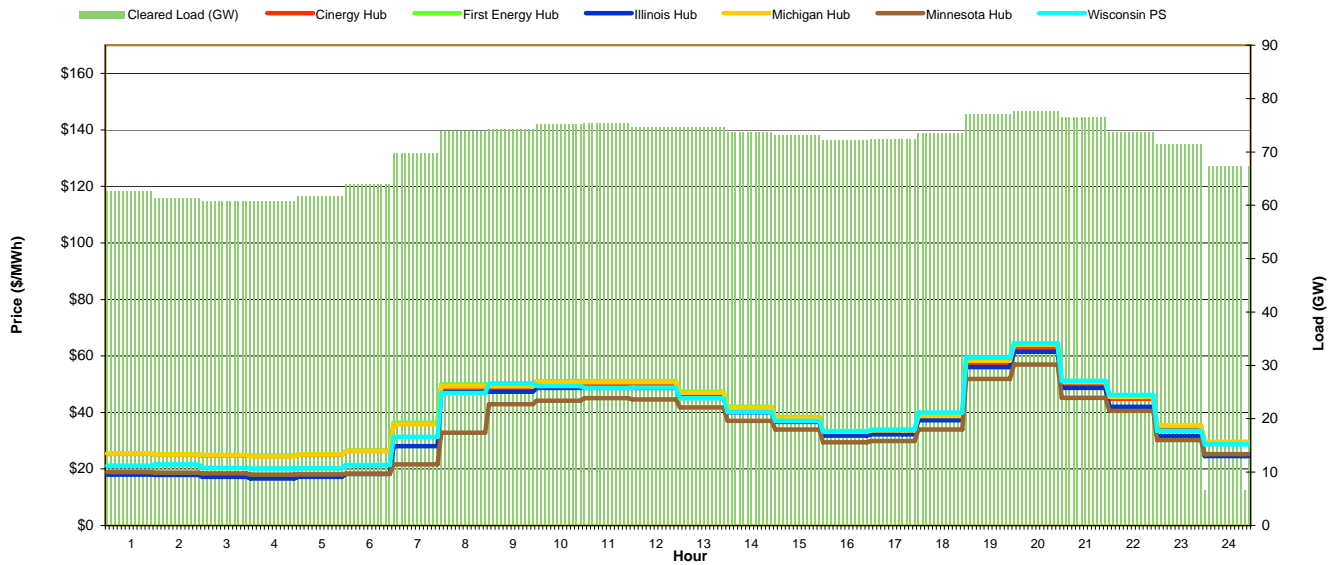

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	26.08	24.23	25.63	24.85	26.17	27.54	30.62	60.05	89.95	93.34	56.77	160.23	48.36	53.25	31.19	31.49	53.91	65.51	52.17	55.07	49.04	47.80	27.88	24.16	49.39	61.00
First Energy Hub	26.96	25.04	26.63	25.72	27.14	28.54	31.56	61.28	91.83	95.16	57.90	163.22	49.24	54.35	31.81	32.24	55.32	67.17	53.39	56.09	49.96	48.74	28.45	24.76	50.52	62.26
Illinois Hub	20.43	19.08	19.19	19.56	19.43	20.34	23.24	56.40	85.98	89.45	54.44	153.47	46.31	49.06	29.84	29.43	49.66	62.38	49.99	52.98	47.09	45.76	26.76	23.07	45.56	58.06
Michigan Hub	27.57	25.58	27.11	26.18	27.67	29.08	32.30	62.19	93.01	96.53	58.95	167.13	50.32	55.74	32.52	32.82	56.18	68.15	53.98	56.54	50.37	49.41	28.95	25.17	51.39	63.30
Minnesota Hub	18.71	17.61	17.54	17.88	17.87	18.94	21.40	20.32	59.81	63.45	27.54	115.99	28.92	33.75	24.60	22.24	45.76	58.07	47.41	51.58	45.73	43.59	23.76	19.43	35.91	44.53
Wisconsin PS	21.15	20.96	20.96	22.16	20.27	20.59	22.20	54.33	66.73	69.18	47.24	110.31	39.63	40.99	29.40	27.94	41.96	52.22	48.33	56.86	46.65	43.41	27.64	24.55	40.65	50.18
Forecasted Load (GW)	62.5	62.1	61.5	61.6	62.4	64.8	68.5	73.6	75.7	76.5	76.8	76.6	75.9	75.0	73.9	72.7	72.1	73.4	77.1	79.2	78.3	76.1	73.3	69.2		
Forecast Error %	-0.4%	-2.1%	-2.2%	-2.2%	-2.0%	-1.9%	-0.6%	-0.7%	-0.9%	-0.2%	0.2%	0.4%	0.6%	0.9%	1.3%	2.1%	2.6%	2.2%	1.1%	0.8%	0.6%	0.1%	-1.0%	-0.7%		

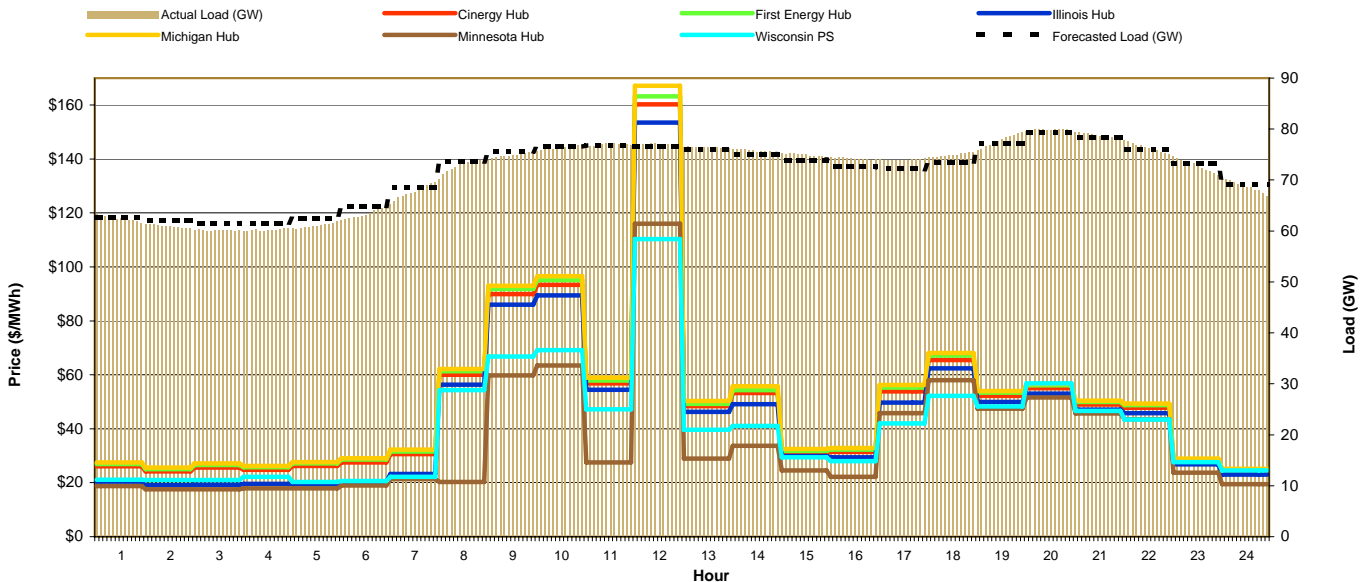




MISO Daily Report

Tuesday February 16, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
	All	On Pk																										
Cinergy Hub	26.50	26.35	26.30	26.16	26.74	29.01	41.42	50.04	46.97	47.59	47.04	39.88	37.63	35.74	32.24	29.93	30.16	31.90	48.59	55.12	48.43	38.33	32.95	28.56	36.82	40.78		
First Energy Hub	27.27	27.03	26.99	26.82	27.43	29.78	42.68	51.57	48.35	49.00	48.43	41.02	38.70	36.76	33.15	30.80	31.05	32.80	49.98	56.69	49.82	39.44	33.79	29.26	37.86	41.96		
Illinois Hub	20.89	21.20	20.75	20.83	20.75	21.84	31.81	45.24	45.26	45.86	45.33	38.39	36.19	34.09	31.02	27.85	27.06	30.71	46.77	53.05	46.63	36.91	31.31	26.70	33.60	38.85		
Michigan Hub	27.50	27.06	27.06	26.83	27.56	29.98	42.14	50.72	47.38	48.02	47.46	40.19	37.92	36.03	32.48	30.24	30.55	32.14	48.98	55.55	48.82	38.65	33.70	29.24	37.34	41.18		
Minnesota Hub	20.20	18.50	18.29	16.92	17.05	18.15	21.20	41.77	37.15	37.72	39.10	32.65	30.85	28.90	25.11	21.90	20.67	22.68	38.57	45.70	39.45	29.85	25.36	21.07	27.87	32.34		
Wisconsin PS	20.66	20.92	19.66	19.11	19.08	19.84	29.53	49.12	50.29	48.90	47.82	43.09	40.10	38.25	35.26	31.92	31.34	37.03	55.97	61.18	51.26	43.81	34.91	30.56	36.65	43.76		
Cleared Load (GW)	65.2	63.1	62.0	62.0	62.9	65.6	70.8	76.8	76.0	76.4	75.9	75.6	75.1	74.5	73.3	72.4	72.7	73.5	77.1	77.9	76.0	74.0	71.2	6.7				

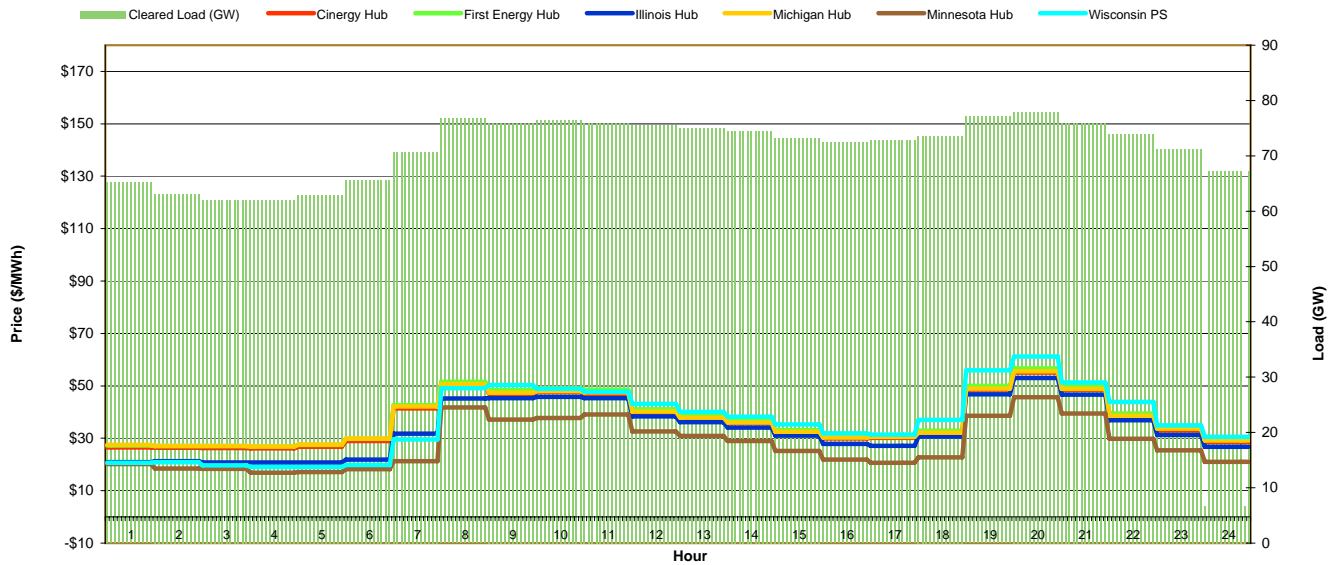

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
	All	On Pk																										
Cinergy Hub	24.00	31.84	25.91	24.60	25.16	25.56	22.22	24.29	31.00	28.67	53.45	31.26	28.01	32.90	30.09	28.46	25.38	25.79	68.53	175.07	50.33	28.85	25.98	25.52	37.20	43.00		
First Energy Hub	22.37	31.07	24.22	24.27	25.75	22.31	22.58	24.79	31.63	29.38	54.82	32.11	28.78	33.84	30.94	27.73	25.74	26.01	70.38	179.38	51.53	29.50	26.53	26.18	37.58	43.94		
Illinois Hub	6.46	7.48	3.09	8.74	17.23	-3.98	19.95	23.08	29.56	27.34	50.92	29.79	26.73	31.33	28.60	11.46	19.39	19.11	65.60	168.11	48.41	27.73	25.01	24.46	29.82	39.51		
Michigan Hub	22.84	31.02	24.82	24.79	26.22	22.51	22.80	25.01	31.92	29.53	55.28	32.36	29.11	34.30	31.35	28.01	25.95	26.26	70.79	179.85	51.80	29.92	26.69	26.54	37.91	44.27		
Minnesota Hub	17.87	-2.11	15.24	18.21	16.34	14.46	20.36	22.36	29.01	26.43	48.64	28.20	25.24	29.31	26.45	19.74	11.37	21.87	62.22	162.71	46.84	26.44	22.25	19.39	30.37	38.07		
Wisconsin PS	21.29	14.45	21.66	22.31	21.68	21.57	22.05	26.53	29.59	28.00	45.69	28.83	27.38	31.12	29.14	26.52	29.57	26.70	61.15	139.00	58.08	43.28	31.03	29.59	34.84	41.35		
Forecasted Load (GW)	66.8	65.0	65.1	65.0	65.9	68.8	73.1	78.7	80.2	80.1	79.7	79.0	78.2	77.3	76.4	75.3	75.1	76.3	79.8	81.0	79.9	77.6	74.7	70.8				
Forecast Error %	-2.4%	-2.7%	-4.9%	-5.4%	-5.7%	-6.3%	-4.8%	-5.0%	-4.7%	-4.1%	-3.9%	-3.9%	-3.7%	-3.2%	-2.7%	-2.6%	-2.9%	-3.4%	-4.1%	-2.9%	-2.7%	-2.6%	-3.3%	-4.0%				

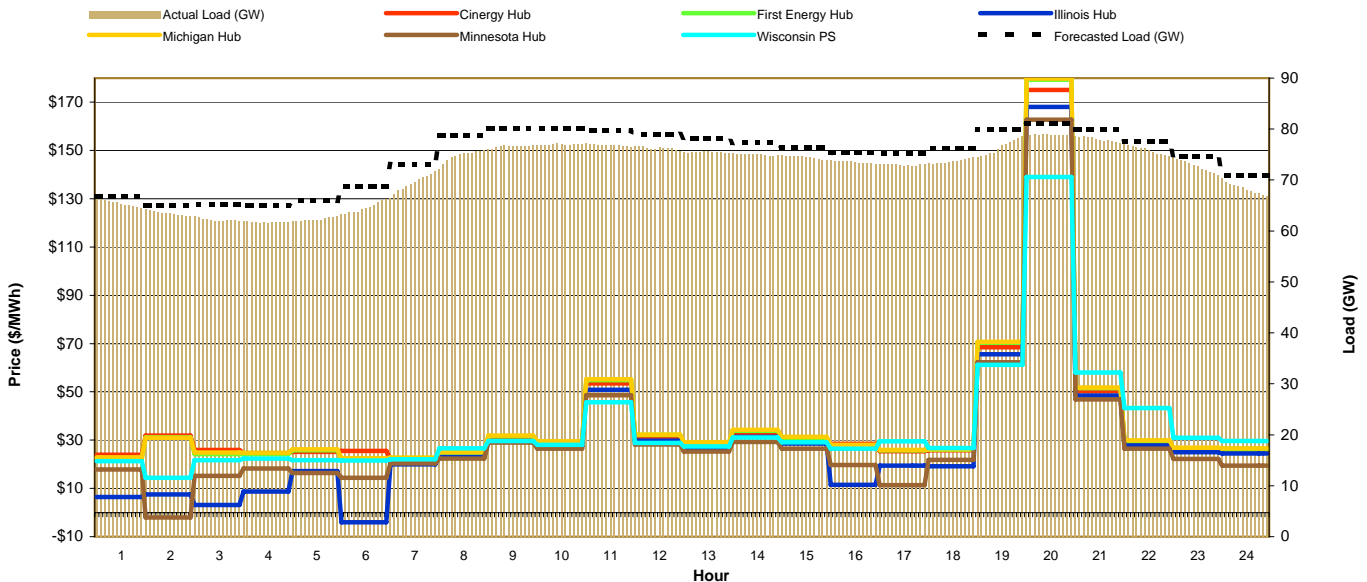




MISO Daily Report

Wednesday February 17, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$			
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk		
Cinergy Hub	26.41	27.00	26.41	26.31	27.31	29.47	38.30	53.64	52.72	52.75	52.90	42.59	41.39	35.77	31.05	32.83	37.46	53.13	61.77	52.22	49.94	38.33	29.66	40.50	46.33			
First Energy Hub	26.59	27.17	26.63	26.51	27.64	29.55	38.48	55.26	54.42	54.42	54.42	43.80	42.58	36.80	31.95	33.81	38.54	54.88	63.54	53.71	51.39	38.86	29.96	41.47	47.68			
Illinois Hub	18.92	19.05	18.71	18.45	19.00	19.43	29.64	51.69	50.90	50.91	50.91	40.97	39.82	34.41	29.10	29.14	35.43	51.33	59.42	50.23	48.06	33.20	24.61	36.43	44.15			
Michigan Hub	26.44	26.95	26.52	26.41	27.65	29.46	37.70	54.13	53.32	53.32	53.32	42.91	41.71	36.05	31.35	33.30	37.80	53.76	62.24	52.61	50.34	38.74	29.87	40.80	46.76			
Minnesota Hub	20.13	19.65	19.75	19.66	20.48	22.83	35.41	51.04	50.27	50.27	50.27	40.46	39.33	33.98	28.70	28.68	34.96	50.69	58.68	49.61	47.46	35.51	27.40	36.90	43.76			
Wisconsin PS	23.10	23.43	22.11	21.72	22.22	25.86	37.02	54.36	54.33	52.45	51.74	51.87	43.52	41.45	36.76	32.28	32.13	40.26	57.89	64.88	53.79	50.58	36.40	30.70	40.04	47.17		
Cleared Load (GW)	3.0	6.0	9.0	12.0	15.0	18.0	21.0	24.0	27.0	30.0	33.0	36.0	39.0	42.0	45.0	48.0	51.0	54.0	57.0	60.0	63.0	66.0	69.0	7.2				

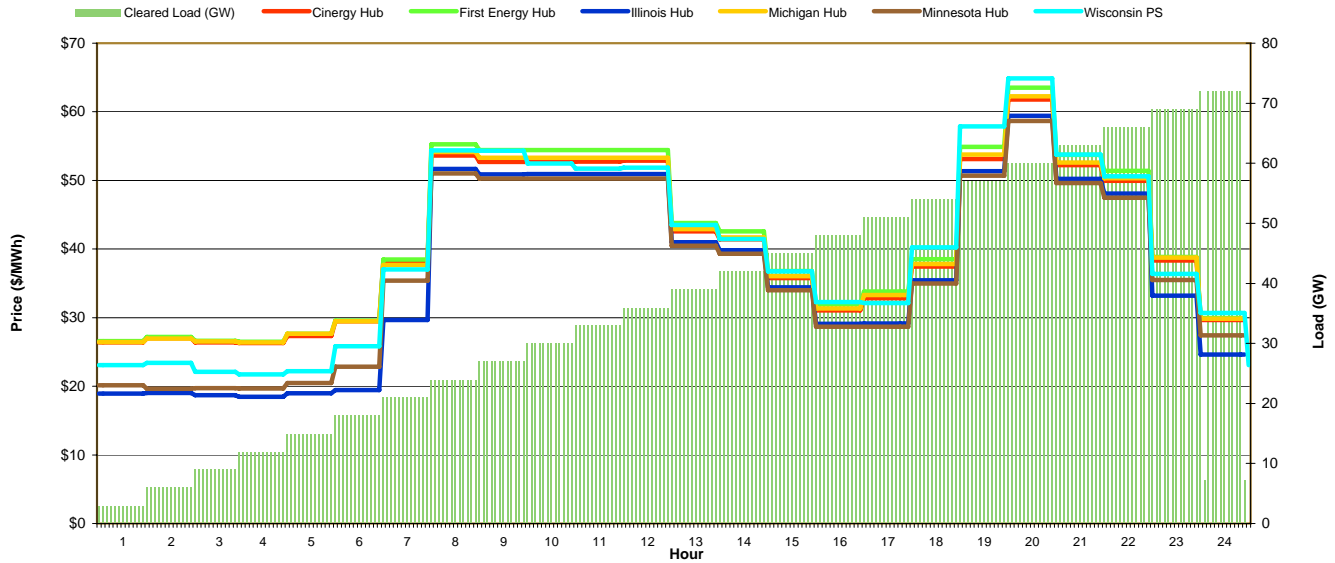

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$			
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk		
Cinergy Hub	29.81	26.12	31.62	26.88	33.41	25.29	29.22	46.38	53.26	48.24	49.46	36.38	28.65	27.81	26.18	24.99	24.49	26.27	48.61	34.44	29.63	30.92	37.58	27.58	33.47	35.83		
First Energy Hub	31.07	26.91	32.80	27.71	34.63	26.01	30.10	48.54	55.04	49.50	50.69	37.29	29.44	28.67	27.02	25.82	25.28	27.08	50.12	35.31	30.39	31.69	38.51	28.40	34.50	36.90		
Illinois Hub	16.02	21.16	19.63	22.05	21.32	20.64	26.63	45.22	50.87	46.88	47.73	35.13	27.72	26.87	25.19	23.96	23.44	25.09	46.56	33.23	28.56	29.73	36.03	26.30	30.25	34.51		
Michigan Hub	32.21	27.42	33.93	28.28	35.66	26.42	30.32	48.62	54.78	49.58	50.79	37.37	29.52	28.66	26.99	25.78	25.16	26.93	50.09	35.26	30.31	31.73	38.91	28.85	34.73	36.91		
Minnesota Hub	13.05	13.99	14.55	17.18	18.73	19.10	25.46	46.64	54.82	49.23	49.88	36.82	28.82	27.75	25.72	24.12	23.18	24.76	46.33	34.54	29.95	30.76	36.75	25.83	29.92	35.63		
Wisconsin PS	16.04	22.15	19.73	23.72	20.05	21.08	25.32	41.80	44.72	41.59	43.98	32.49	28.01	27.25	26.46	24.85	24.51	27.67	47.07	44.26	34.84	33.68	34.80	27.23	30.55	34.87		
Forecasted Load (GW)	3.0	6.0	9.0	12.0	15.0	18.0	21.0	24.0	27.0	30.0	33.0	36.0	39.0	42.0	45.0	48.0	51.0	54.0	57.0	60.0	63.0	66.0	69.0	72.0				
Forecast Error %	-48.1%	-14.0%	-7.5%	-4.6%	-1.9%	-0.3%	0.9%	1.8%	2.4%	3.0%	3.4%	3.7%	4.0%	4.3%	4.5%	4.7%	4.8%	5.0%	5.4%	5.1%	5.2%	5.3%	5.4%	6.0%	5.5%	-3.2%		

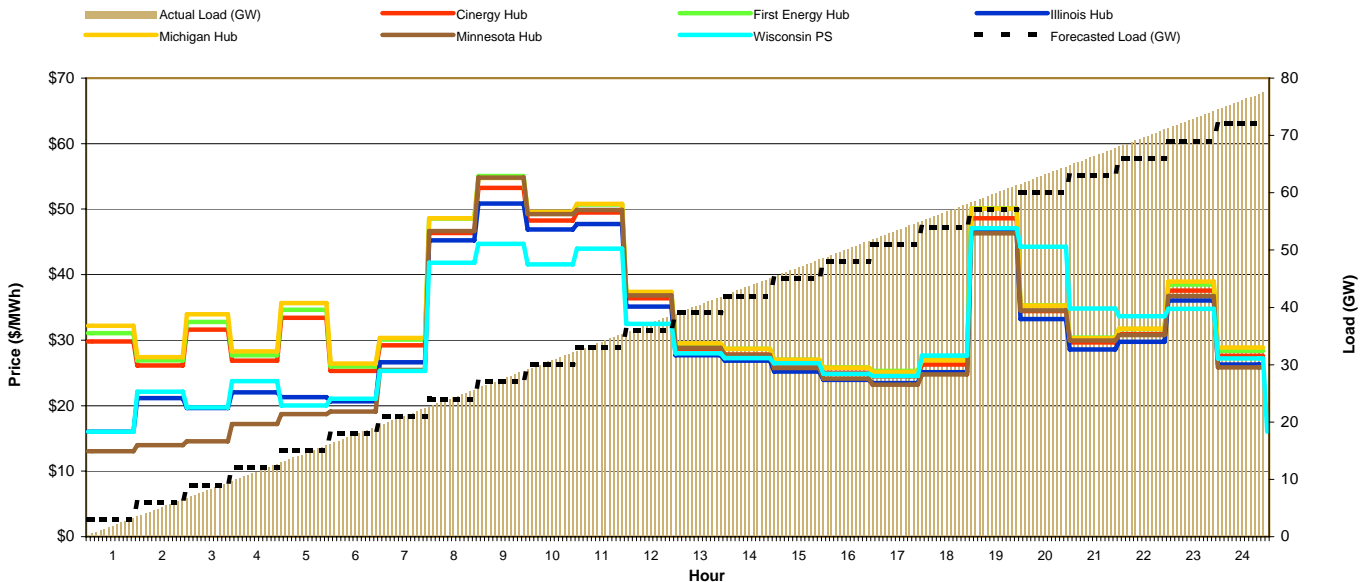




MISO Daily Report

Thursday February 18, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	27.23	26.63	26.39	26.20	27.03	29.26	37.45	53.10	50.97	51.05	51.06	47.12	41.24	37.71	33.56	29.68	29.47	33.15	50.75	54.00	51.20	41.45	31.83	28.25	38.16	42.96
First Energy Hub	27.62	27.03	26.81	26.61	27.55	29.80	38.49	54.75	52.83	52.78	52.73	48.67	42.53	38.88	34.57	30.54	30.35	34.16	52.29	55.73	52.74	42.72	32.47	28.72	39.22	44.30
Illinois Hub	21.30	20.91	20.33	20.29	21.17	22.37	34.32	51.16	48.99	49.04	49.32	45.52	39.77	36.35	32.33	28.56	28.38	31.94	48.90	51.62	49.27	39.95	28.76	24.86	35.23	41.24
Michigan Hub	27.65	27.06	26.89	26.67	27.64	29.91	37.78	53.63	51.69	51.67	51.66	47.68	41.66	38.08	33.87	29.92	29.73	33.46	51.23	54.52	51.66	41.85	32.37	28.63	38.62	43.42
Minnesota Hub	23.41	22.79	21.96	22.01	22.38	23.88	34.51	51.36	55.38	52.26	48.70	44.95	39.27	35.90	31.92	28.20	28.02	31.54	48.30	58.93	49.64	39.45	29.66	26.24	36.28	42.09
Wisconsin PS	23.54	23.29	21.47	21.38	21.94	23.29	36.34	54.61	55.02	52.49	50.98	48.59	43.95	40.39	36.50	32.94	32.77	37.88	56.34	61.57	53.42	44.87	32.34	29.18	38.96	45.92
Cleared Load (GW)	3.0	6.0	9.0	12.0	15.0	18.0	21.0	24.0	27.0	30.0	33.0	36.0	39.0	42.0	45.0	48.0	51.0	54.0	57.0	60.0	63.0	66.0	69.0	7.2		

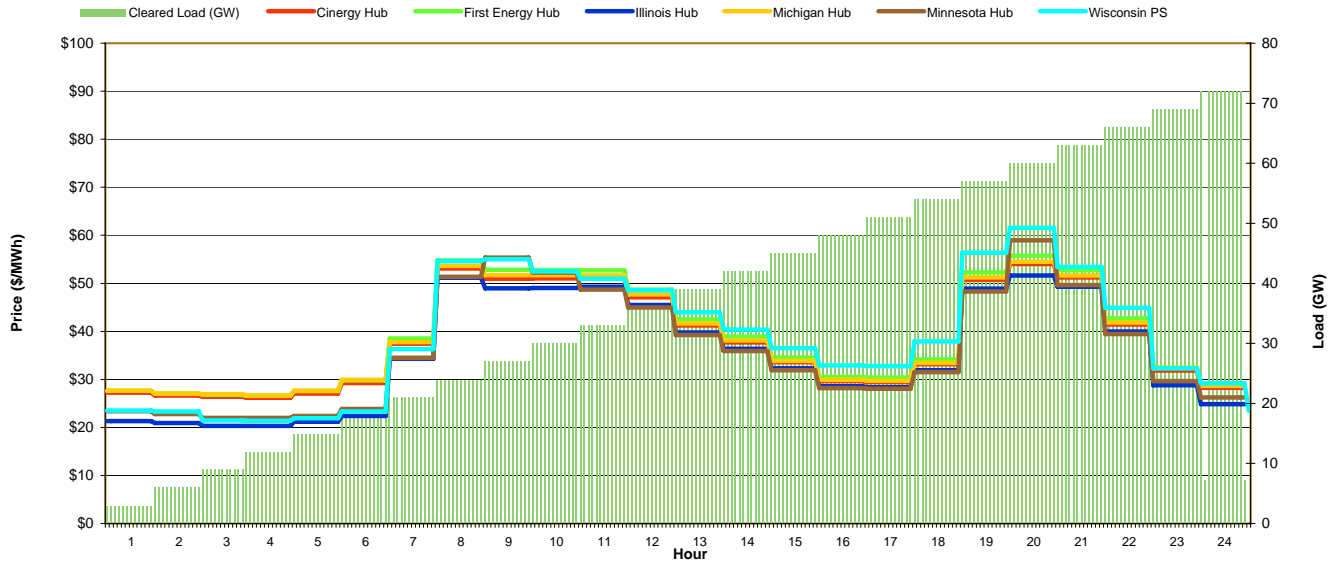

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$		
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk	
Cinergy Hub	29.99	26.80	24.55	26.16	28.94	28.07	34.19	78.91	45.40	53.85	41.68	29.83	30.79	30.77	32.00	25.69	23.93	23.13	32.91	29.66	47.91	40.49	25.42	24.48	33.98	37.02	
First Energy Hub	31.21	27.96	25.40	26.99	29.89	28.98	34.98	80.93	46.83	55.64	42.80	31.26	36.10	38.33	38.22	26.54	24.77	23.75	33.80	31.08	49.11	41.46	26.13	25.25	35.73	39.17	
Illinois Hub	20.90	21.86	20.98	21.35	22.02	22.06	32.36	75.76	39.79	47.92	39.27	28.65	29.59	29.47	30.62	24.51	22.80	22.04	31.45	23.70	45.15	38.78	24.37	23.33	30.78	34.62	
Michigan Hub	32.16	28.58	25.83	27.44	30.57	29.60	35.28	81.15	46.79	55.93	43.14	31.01	32.06	32.18	33.50	26.82	24.93	23.97	34.16	31.25	49.54	42.01	26.44	25.47	35.41	38.43	
Minnesota Hub	20.24	21.41	20.39	20.45	21.24	21.72	32.62	81.27	69.42	80.95	45.76	34.00	32.22	32.01	33.16	25.96	23.75	22.89	33.19	97.73	60.20	41.93	25.30	23.33	38.38	46.23	
Wisconsin PS	21.01	23.06	22.94	23.63	22.16	22.20	29.93	63.07	40.41	46.88	39.00	29.14	29.90	29.65	30.73	25.58	24.38	25.76	36.97	52.18	47.92	40.29	26.86	25.22	32.45	36.79	
Forecasted Load (GW)	3.0	6.0	9.0	12.0	15.0	18.0	21.0	24.0	27.0	30.0	33.0	36.0	39.0	42.0	45.0	48.0	51.0	54.0	57.0	60.0	63.0	66.0	69.0	72.0			
Forecast Error %	-48.1%	-14.0%	-7.5%	-4.6%	-1.9%	-0.3%	0.9%	1.8%	2.4%	3.0%	3.4%	3.7%	4.0%	4.3%	4.5%	4.8%	4.8%	5.0%	5.1%	5.2%	5.3%	5.4%	5.5%	5.6%	-3.2%		

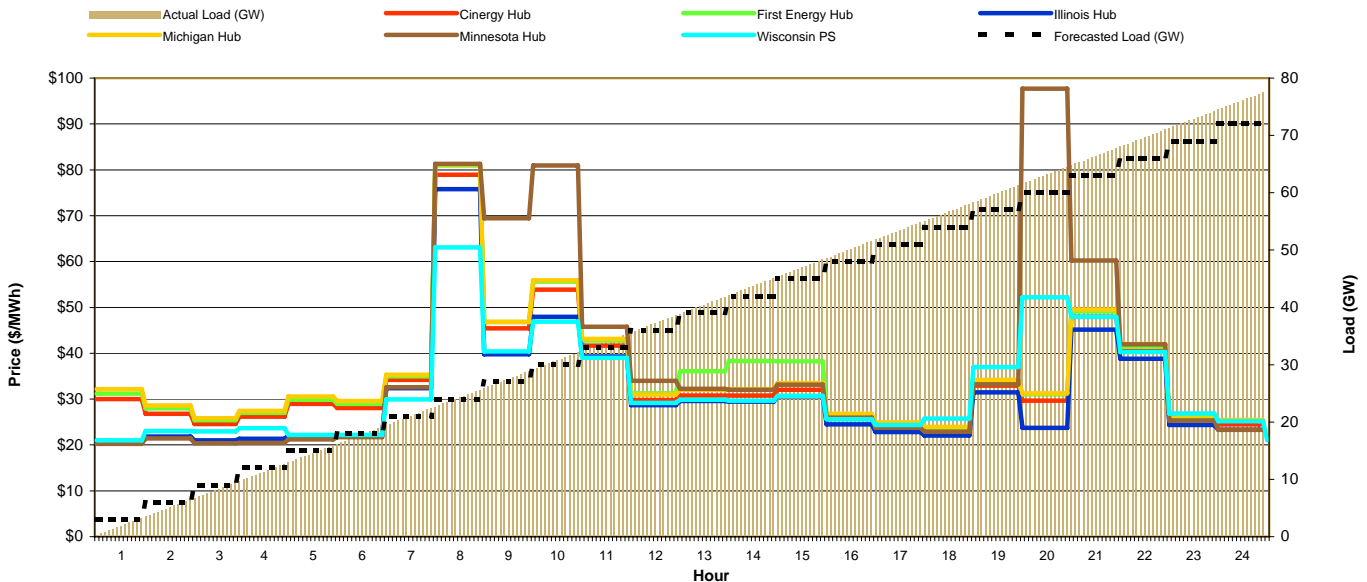




MISO Daily Report

Friday February 19, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	27.25	26.70	26.03	25.97	26.74	28.58	39.06	50.98	48.18	47.52	47.88	42.56	42.56	38.30	34.39	30.25	30.29	34.45	48.26	50.45	48.20	40.75	34.71	30.59	37.53	41.86
First Energy Hub	28.02	27.47	26.76	26.67	27.51	29.40	40.22	52.64	50.00	49.22	49.43	43.96	43.88	39.47	35.43	31.16	31.16	35.45	49.74	51.97	49.57	41.91	35.71	31.42	38.67	43.17
Illinois Hub	24.12	23.49	22.79	22.27	22.65	24.11	37.62	49.00	45.93	45.13	45.92	40.66	40.90	36.85	32.87	28.95	29.10	33.10	46.42	48.28	46.32	39.20	32.64	29.00	35.31	40.08
Michigan Hub	28.05	27.51	26.80	26.73	27.60	29.50	39.40	51.53	48.86	48.09	48.38	43.01	42.97	38.66	34.71	30.52	30.53	34.72	48.71	50.86	48.56	41.05	35.55	31.31	38.07	42.29
Minnesota Hub	23.52	21.56	20.76	20.79	21.21	22.39	37.15	52.05	58.48	58.56	50.01	47.22	42.31	37.07	33.51	29.32	29.26	33.26	47.10	52.51	46.25	38.71	38.44	30.05	37.15	43.38
Wisconsin PS	23.37	23.30	21.80	21.38	21.80	23.10	38.29	53.41	54.34	51.86	49.31	46.42	43.75	39.31	35.76	32.40	32.62	38.75	54.57	58.32	51.14	44.29	36.56	31.39	38.63	45.17
Cleared Load (GW)	57.8	55.8	54.6	54.2	54.6	55.5	57.3	60.0	60.9	62.1	63.0	63.0	62.0	61.1	60.2	60.0	61.0	65.9	68.4	68.2	67.6	66.6	63.7	61.3		

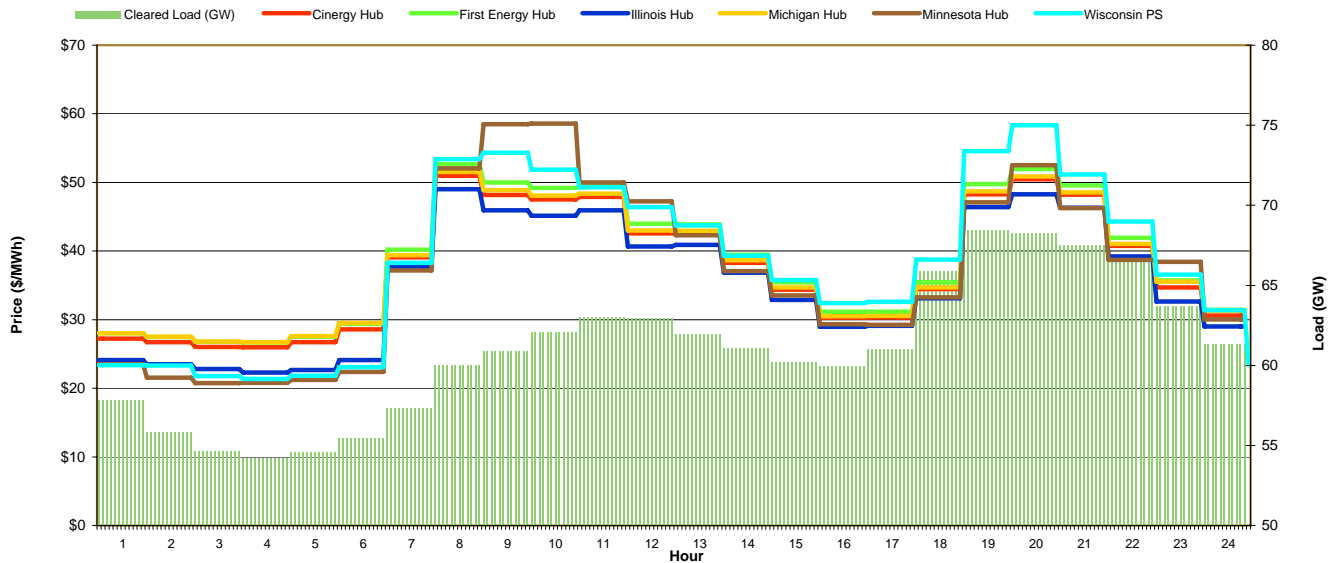

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	33.15	25.48	26.53	25.94	25.86	27.00	35.54	49.02	43.63	37.14	36.68	28.87	25.99	25.57	24.66	23.64	23.15	23.67	59.72	27.56	27.10	27.84	31.35	25.58	30.86	32.22
First Energy Hub	34.40	26.17	27.27	26.54	26.49	27.57	36.03	49.62	44.14	37.66	37.34	29.49	26.65	26.26	25.30	24.22	23.75	24.18	60.88	28.04	27.60	28.38	32.01	26.10	31.50	32.85
Illinois Hub	22.36	23.44	22.35	24.37	22.74	23.07	33.46	46.90	42.16	36.02	35.62	28.14	25.29	24.84	23.96	22.96	22.44	23.05	58.09	26.87	26.38	26.99	30.29	24.55	29.01	31.25
Michigan Hub	35.20	26.34	27.59	26.71	26.78	28.06	36.43	50.03	44.32	37.98	37.86	30.00	27.10	26.68	25.78	24.66	24.11	24.54	61.90	28.46	28.03	28.63	32.44	26.35	31.92	33.30
Minnesota Hub	22.08	23.34	21.87	23.68	21.69	21.55	31.98	47.22	44.35	38.02	36.95	29.46	26.52	25.68	24.56	23.50	22.98	23.58	60.58	28.97	28.24	28.13	31.32	25.21	29.64	32.50
Wisconsin PS	21.72	24.86	23.75	26.37	23.39	23.08	30.36	42.62	38.37	34.30	35.47	27.74	26.42	25.84	25.46	24.06	23.79	26.25	55.31	40.01	33.39	31.75	30.83	26.08	30.05	32.60
Forecasted Load (GW)	59.9	57.9	56.7	56.1	56.0	56.4	57.7	59.8	61.5	62.7	63.3	64.0	63.9	63.6	62.9	62.5	63.1	65.9	69.9	70.3	69.3	67.5	65.7	62.7		
Forecast Error %	-3.0%	-2.8%	-2.9%	-2.7%	-2.4%	-2.3%	-2.0%	-1.9%	-1.8%	-1.5%	-0.7%	-2.2%	-2.2%	-1.9%	-1.6%	-1.5%	-1.4%	-0.7%	0.2%	-0.2%	-0.3%	-0.5%	-2.2%	-12.9%		

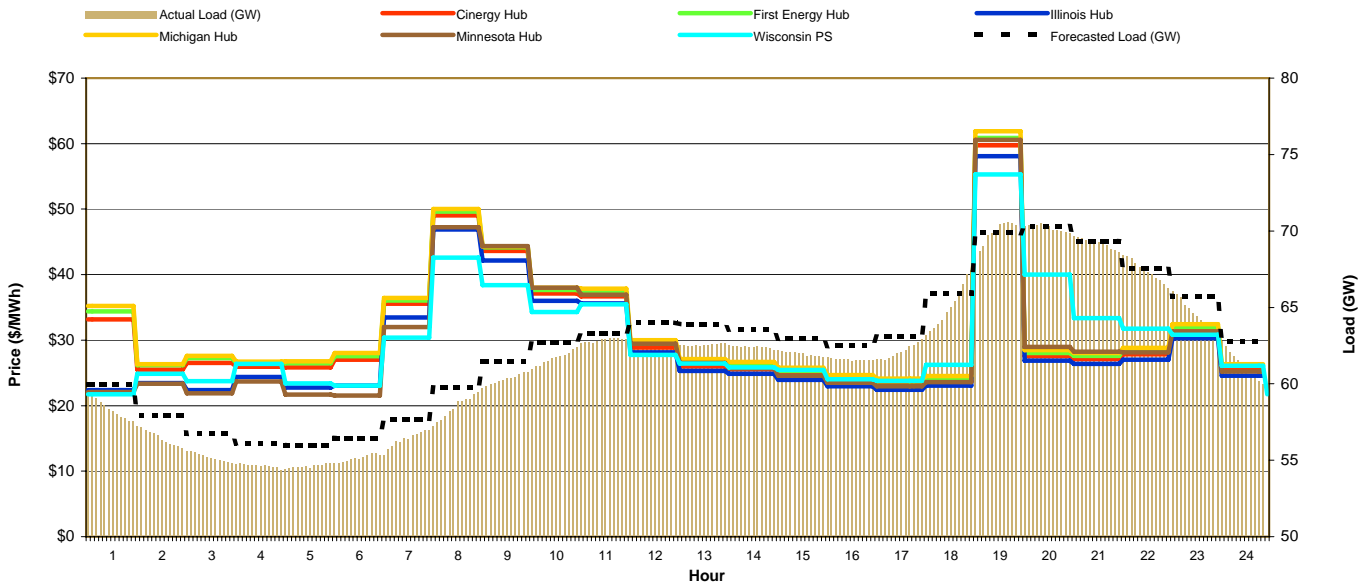




MISO Daily Report

Saturday February 20, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	29.01	28.08	27.20	25.90	25.62	26.94	28.52	30.89	35.75	44.11	45.71	42.61	34.46	29.76	28.87	27.18	27.56	29.72	40.00	45.73	40.09	36.44	31.20	27.98	32.89	35.63
First Energy Hub	29.67	28.98	27.80	26.69	26.34	27.84	29.28	31.46	36.42	44.95	46.59	43.40	35.11	30.31	29.41	27.69	28.07	30.27	40.75	46.58	40.83	37.12	32.09	28.77	33.60	36.32
Illinois Hub	26.24	25.48	24.44	23.42	22.87	24.41	26.69	29.51	34.15	42.15	43.69	40.70	32.92	28.43	27.58	25.96	26.33	28.39	38.21	43.69	38.29	34.81	29.88	26.79	31.04	34.04
Michigan Hub	29.99	28.61	28.10	26.40	26.22	27.20	28.96	32.19	37.25	45.98	47.66	44.40	35.91	31.01	30.09	28.32	28.72	30.97	41.68	47.66	41.77	37.97	32.43	29.08	34.11	37.13
Minnesota Hub	25.80	24.93	24.16	22.99	22.45	23.83	25.11	27.39	31.70	39.13	40.55	37.78	30.56	26.39	25.60	24.10	24.44	26.35	35.47	40.55	35.54	32.31	27.91	25.03	29.17	31.61
Wisconsin PS	25.83	25.62	24.09	23.09	23.04	24.48	29.62	37.33	40.91	44.39	44.73	42.90	36.30	32.00	30.54	28.92	29.41	34.09	46.91	51.86	43.69	39.70	31.83	28.98	34.18	38.47
Cleared Load (GW)	57.8	55.8	54.6	54.2	54.6	55.5	57.3	60.0	60.9	62.1	63.0	63.0	62.0	61.1	60.2	60.0	61.0	65.9	68.4	68.2	67.6	66.6	63.7	61.3		

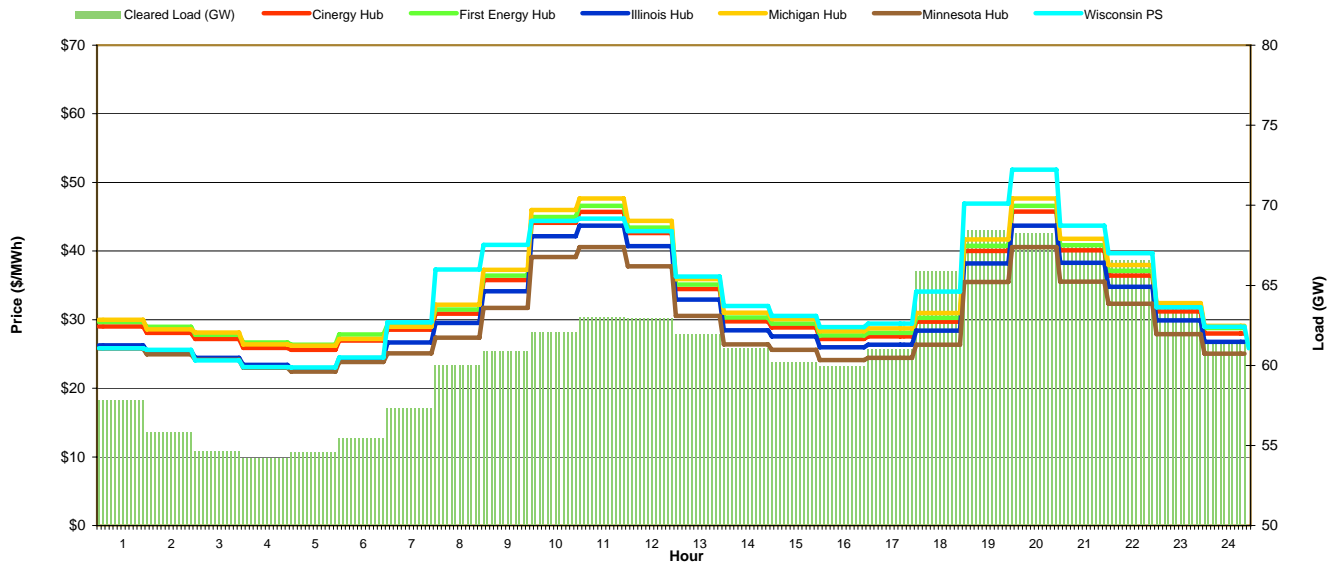

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	28.26	28.29	25.26	46.54	25.91	26.92	27.63	23.19	52.17	32.65	36.92	27.55	23.31	22.43	23.12	22.53	22.84	24.99	62.09	29.23	28.31	32.70	24.72	21.26	29.95	30.55
First Energy Hub	28.89	28.93	25.86	47.63	25.50	26.15	26.74	23.58	51.77	33.11	37.46	28.01	23.71	22.80	23.51	22.94	23.25	25.46	62.99	29.65	28.81	33.30	25.18	21.67	30.29	30.97
Illinois Hub	26.97	26.89	23.98	44.15	15.94	13.58	13.81	22.08	41.52	30.90	35.33	26.45	22.36	21.59	22.17	24.54	21.84	31.71	79.08	66.79	27.32	31.46	23.75	20.37	29.77	33.06
Michigan Hub	29.15	29.18	26.01	47.99	25.72	26.33	27.01	23.69	51.95	33.40	37.79	28.31	24.04	23.11	23.81	23.16	23.50	25.71	63.75	30.01	29.12	33.76	25.54	21.92	30.58	31.29
Minnesota Hub	27.56	27.08	24.11	44.17	23.36	23.94	24.11	21.74	49.03	32.34	37.71	28.24	23.66	22.49	22.47	21.45	21.57	23.80	60.21	29.78	29.06	32.84	24.70	20.72	29.01	30.07
Wisconsin PS	26.77	27.21	25.49	39.79	24.41	24.50	24.50	25.57	42.33	30.93	35.71	26.81	24.57	23.71	24.27	23.05	23.36	26.80	56.27	40.86	33.97	34.82	26.34	23.17	29.80	31.21
Forecasted Load (GW)	59.9	57.9	56.7	56.1	56.0	56.4	57.7	59.8	61.5	62.7	63.3	64.0	63.9	63.6	62.9	62.5	63.1	65.9	69.9	70.3	69.3	67.5	65.7	62.7		
Forecast Error %	-3.0%	-2.8%	-2.9%	-2.7%	-2.4%	-2.3%	-2.0%	-1.9%	-1.8%	-1.5%	-0.7%	-2.2%	-2.2%	-1.9%	-1.6%	-1.5%	-1.4%	-0.7%	0.2%	-0.2%	-0.3%	-0.5%	-2.2%		-12.9%	

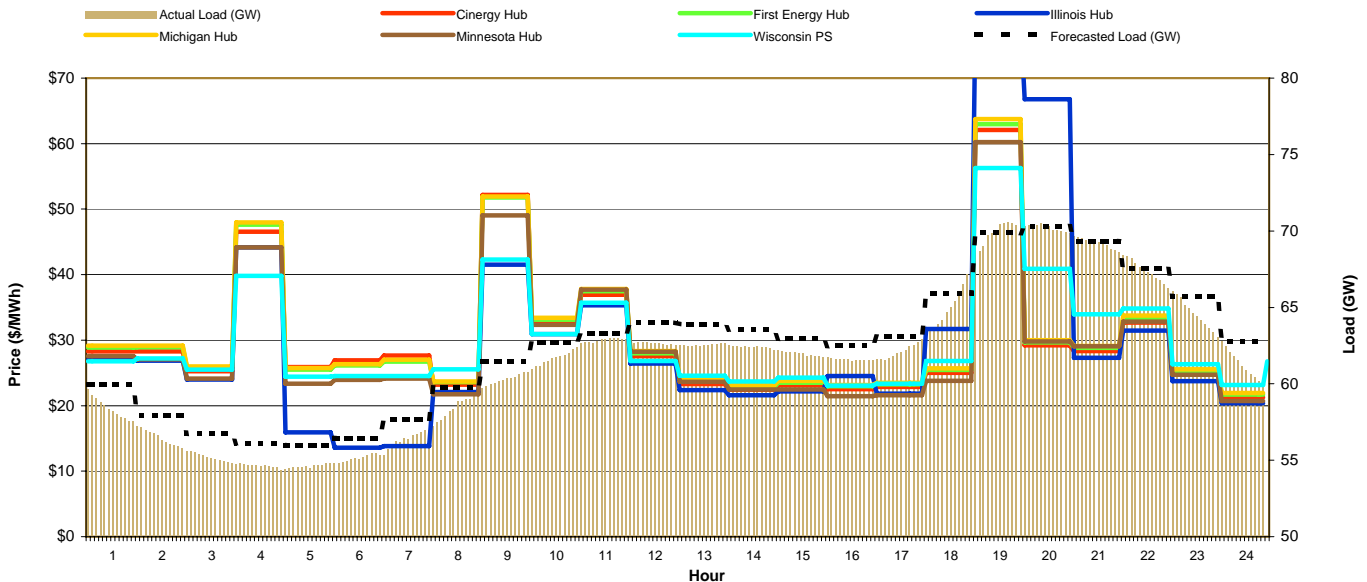




MISO Daily Report

Sunday February 21, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	25.00	25.20	24.21	23.37	22.74	23.19	24.42	24.70	25.46	27.51	27.45	27.26	26.84	26.10	25.30	24.39	24.92	28.45	39.56	44.45	38.08	30.84	26.28	24.70	27.52	29.22
First Energy Hub	25.32	25.52	24.45	23.64	22.93	23.62	24.52	25.07	25.62	27.58	27.46	27.26	26.92	26.19	25.41	24.51	25.04	28.62	40.30	45.29	38.83	31.42	26.84	25.01	27.81	29.52
Illinois Hub	17.13	17.17	15.10	12.37	10.88	12.53	15.19	17.56	20.00	22.83	22.35	22.14	22.39	21.90	21.38	20.72	21.13	24.42	37.79	42.43	36.21	29.47	21.95	17.65	21.78	25.29
Michigan Hub	25.60	25.79	24.71	23.38	22.67	22.74	24.76	24.80	26.17	28.18	28.09	27.89	27.54	26.80	26.00	25.08	25.62	29.28	41.23	46.33	39.74	32.15	27.13	25.28	28.21	30.13
Minnesota Hub	22.03	22.20	21.27	20.37	19.76	20.13	21.24	21.52	22.29	23.99	23.89	23.72	23.43	22.79	22.11	21.33	21.79	24.99	35.08	39.65	34.72	27.35	23.34	21.76	24.20	25.75
Wisconsin PS	23.13	23.66	22.03	21.21	21.16	21.83	26.84	33.12	34.17	33.56	32.80	32.84	31.20	29.43	28.05	26.94	27.52	33.06	46.64	51.07	44.64	36.15	28.56	26.64	30.68	34.36
Cleared Load (GW)	57.8	55.8	54.6	54.2	54.6	55.5	57.3	60.0	60.9	62.1	63.0	63.0	62.0	61.1	60.2	60.0	61.0	65.9	68.4	68.2	67.6	66.6	63.7	61.3		

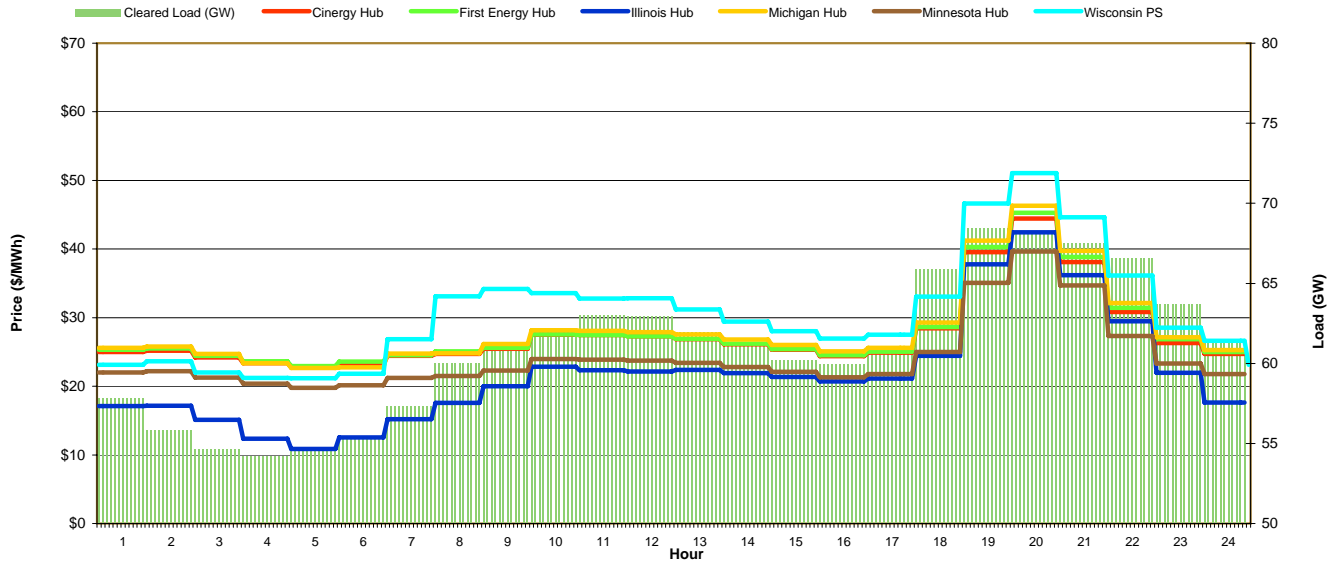

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	26.01	26.15	23.45	23.32	21.34	22.11	23.00	26.42	25.23	25.55	28.14	27.05	24.36	24.24	23.30	23.87	23.97	29.00	89.25	29.81	36.37	46.75	25.13	20.76	28.94	31.78
First Energy Hub	26.12	26.66	23.90	23.80	21.78	22.59	21.72	23.10	24.10	25.76	28.76	27.65	24.86	24.68	23.71	24.32	23.91	27.33	90.56	30.21	36.95	47.48	25.62	21.18	29.03	31.81
Illinois Hub	22.46	24.92	22.42	22.24	20.35	21.03	11.45	2.99	14.48	22.14	26.80	25.81	23.30	23.27	22.37	22.88	19.85	14.58	85.73	28.63	34.87	44.82	24.05	19.91	25.04	27.26
Michigan Hub	26.45	26.94	24.12	23.95	21.92	22.75	21.88	23.31	24.26	25.94	29.15	28.05	25.24	24.97	23.97	24.63	24.24	27.76	92.77	30.89	37.67	48.51	26.22	21.61	29.47	32.35
Minnesota Hub	25.07	25.35	22.48	21.90	19.90	20.52	19.88	20.81	22.09	23.99	27.24	26.21	23.62	23.25	22.08	22.27	21.69	24.84	84.46	29.50	36.41	46.26	24.37	19.85	27.25	29.94
Wisconsin PS	25.07	25.92	24.29	24.83	22.07	22.22	21.39	25.00	24.31	25.54	29.23	25.88	24.75	24.50	24.17	23.77	23.60	27.84	73.79	41.04	39.26	44.18	26.50	22.86	28.83	31.46
Forecasted Load (GW)	59.9	57.9	56.7	56.1	56.0	56.4	57.7	59.8	61.5	62.7	63.3	64.0	63.9	63.6	62.9	62.5	63.1	65.9	69.9	70.3	69.3	67.5	65.7	62.7		
Forecast Error %	-3.0%	-2.8%	-2.9%	-2.7%	-2.4%	-2.3%	-1.9%	-1.8%	-1.5%	-0.7%	-2.2%	-2.2%	-1.9%	-1.6%	-1.5%	-1.4%	-0.7%	0.2%	-0.2%	-0.3%	-0.5%	-2.2%	-12.9%			

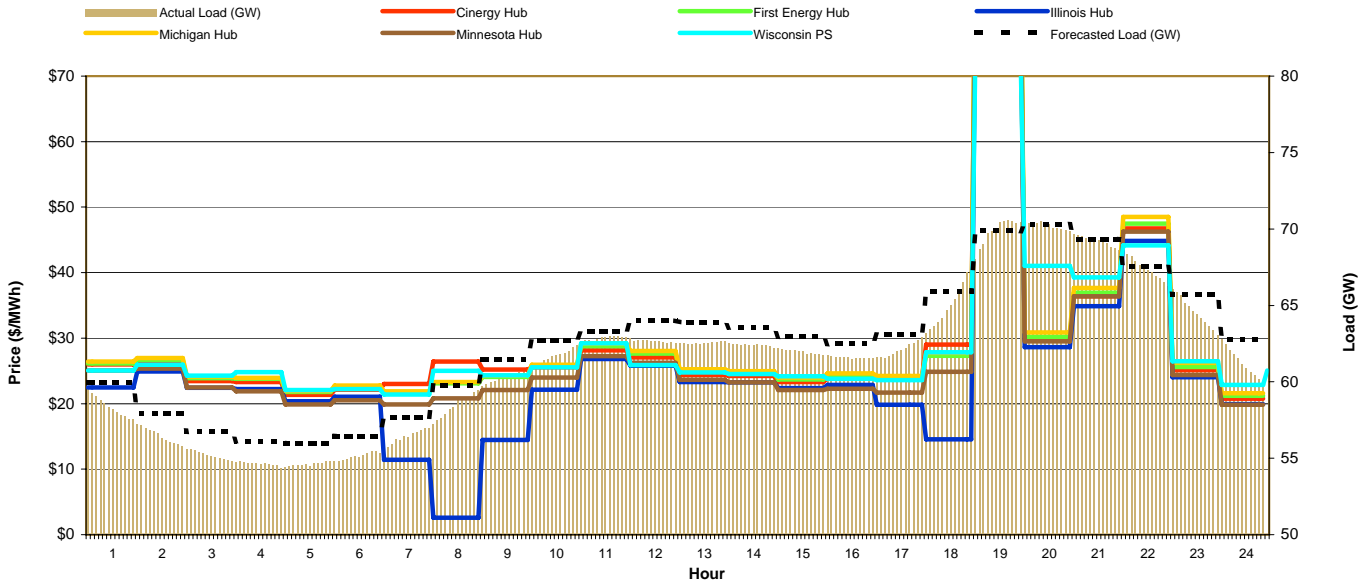




MISO Daily Report

Monday February 22, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	23.31	23.48	22.85	22.81	23.23	24.86	35.08	46.88	46.48	47.84	46.88	46.09	42.00	41.00	37.27	33.83	35.84	40.86	55.82	62.66	50.38	41.36	32.13	27.42	37.93	44.21
First Energy Hub	23.69	23.88	23.22	23.20	23.64	25.36	34.78	46.75	46.55	48.37	47.26	46.57	42.43	41.43	37.61	34.08	36.06	41.21	56.67	63.91	51.33	42.18	32.96	27.89	38.38	44.71
Illinois Hub	17.12	17.60	16.73	17.00	17.72	20.07	26.56	37.42	38.25	42.88	41.41	41.57	38.03	37.14	33.50	30.03	31.58	36.57	51.29	59.50	48.04	39.29	29.70	23.12	33.01	39.76
Michigan Hub	23.94	24.14	23.47	23.45	23.89	25.63	35.59	47.83	47.65	49.51	48.36	47.65	43.42	42.39	38.48	34.86	36.89	42.16	58.00	65.40	52.53	43.18	33.31	28.19	39.16	45.73
Minnesota Hub	20.61	20.89	20.33	20.18	19.58	21.51	30.41	40.65	44.46	47.00	44.82	42.87	37.60	36.20	33.09	29.86	31.53	36.12	54.73	60.77	46.17	38.81	28.66	24.25	34.63	40.83
Wisconsin PS	22.10	22.64	21.26	21.07	21.69	23.19	33.31	46.91	47.64	48.22	45.77	44.99	40.84	38.73	35.43	32.62	34.05	40.63	59.12	64.30	50.65	46.02	32.41	28.44	37.58	44.27
Cleared Load (GW)	3.0	6.0	9.0	12.0	15.0	18.0	21.0	24.0	27.0	30.0	33.0	36.0	39.0	42.0	45.0	48.0	51.0	54.0	57.0	60.0	63.0	66.0	69.0	7.2		

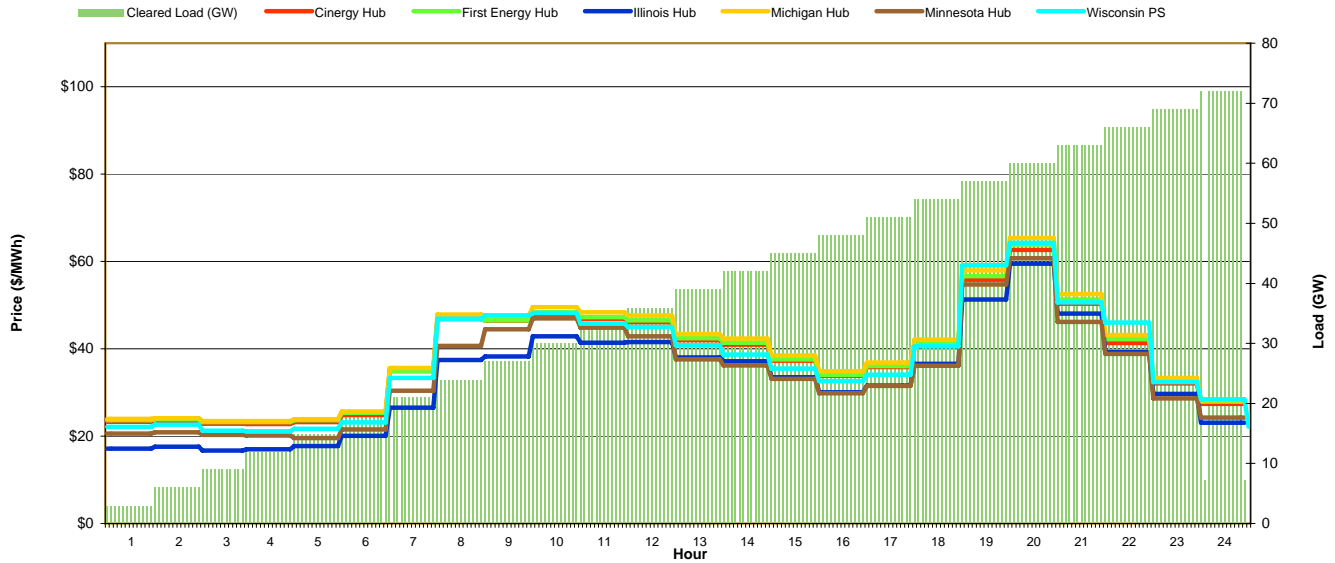

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$		
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk	
Cinergy Hub	20.88	21.74	21.75	21.76	23.01	23.32	43.30	34.04	31.40	61.99	57.86	44.44	47.71	69.51	40.93	30.44	40.56	36.17	40.15	47.93	32.45	32.51	27.41	31.88	36.80	42.22	
First Energy Hub	21.27	22.17	22.19	22.21	23.45	23.75	43.90	34.40	31.69	62.36	58.32	44.83	48.20	70.36	41.46	30.84	41.15	36.62	40.67	48.46	32.78	32.85	27.73	32.39	37.25	42.67	
Illinois Hub	19.81	20.84	20.89	20.94	22.10	22.33	41.37	32.77	30.49	60.05	55.98	43.11	46.27	67.23	39.58	29.43	39.20	35.06	39.28	47.13	31.93	31.87	26.78	30.85	35.64	41.01	
Michigan Hub	21.68	22.56	22.54	22.55	23.85	24.21	44.84	34.91	32.02	63.03	59.10	45.69	49.37	72.58	42.90	31.81	42.23	37.47	41.36	49.24	33.07	33.21	28.21	32.91	37.97	43.51	
Minnesota Hub	26.31	20.30	20.09	20.09	21.26	21.89	40.65	43.05	37.97	67.06	62.08	47.76	50.08	70.87	41.21	31.16	41.28	36.64	40.62	100.69	50.44	67.24	28.13	31.34	42.43	51.02	
Wisconsin PS	22.10	23.15	23.32	24.08	23.39	23.35	36.04	34.21	31.35	52.14	50.53	38.81	41.19	55.27	36.39	28.85	35.78	34.78	42.04	57.29	39.13	37.86	28.22	30.16	35.39	40.24	
Forecasted Load (GW)	3.0	6.0	9.0	12.0	15.0	18.0	21.0	24.0	27.0	30.0	33.0	36.0	39.0	42.0	45.0	48.0	51.0	54.0	57.0	60.0	63.0	66.0	69.0	72.0			
Forecast Error %	-48.1%	-14.0%	-7.5%	-4.6%	-1.9%	0.9%	1.8%	2.4%	3.0%	3.4%	3.7%	4.0%	4.3%	4.5%	4.7%	4.8%	5.0%	5.1%	5.2%	5.3%	5.4%	5.5%	5.5%	5.5%	-3.2%		

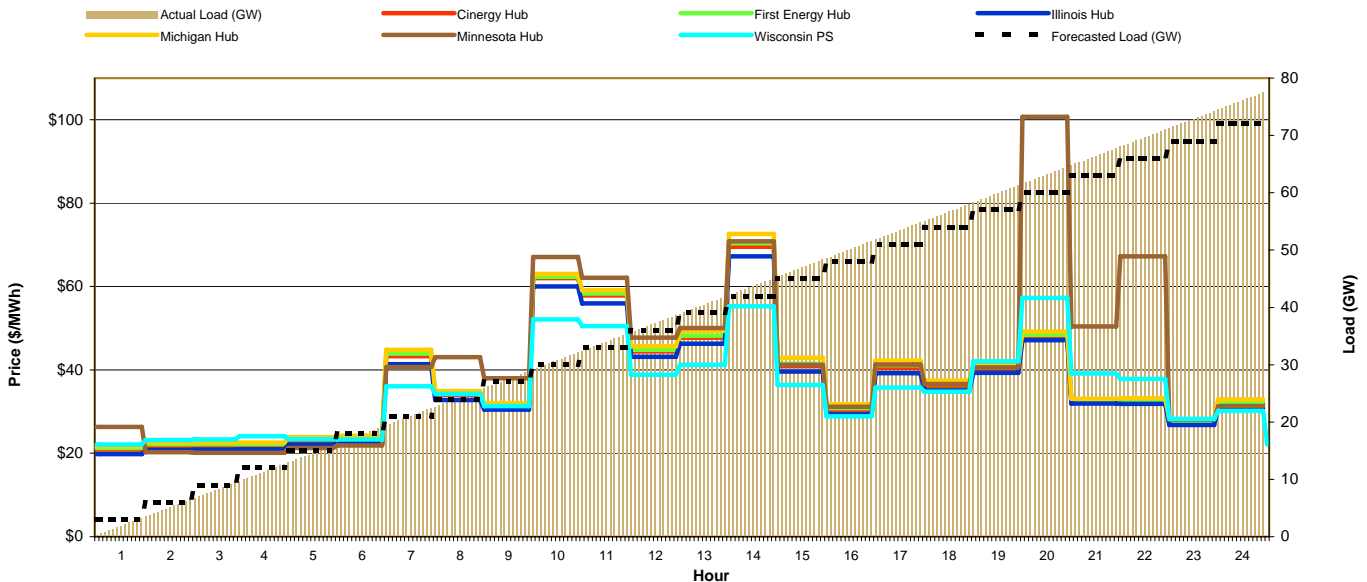




MISO Daily Report

Tuesday February 23, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	26.87	26.20	25.87	25.88	26.37	28.77	39.55	47.22	46.21	47.00	44.70	41.02	37.44	33.94	32.85	29.81	29.90	33.53	46.85	53.94	44.72	38.80	32.00	28.72	36.17	40.00
First Energy Hub	27.39	26.74	26.41	26.44	26.98	29.43	40.29	48.41	47.41	48.21	45.83	42.05	38.26	34.77	33.63	30.54	30.64	34.36	48.04	55.31	45.85	39.78	32.86	29.49	37.05	41.00
Illinois Hub	23.54	23.28	22.46	22.36	21.86	24.08	36.13	45.12	44.03	44.79	42.64	39.13	36.10	32.46	31.45	28.52	28.60	32.07	44.76	51.52	42.71	37.06	30.40	27.29	33.85	38.21
Michigan Hub	27.75	27.09	26.78	26.82	27.45	29.91	40.85	49.05	48.04	48.86	46.45	42.63	38.87	35.23	34.09	30.95	31.04	34.81	48.67	56.05	46.46	40.31	33.29	29.88	37.56	41.55
Minnesota Hub	26.00	25.23	24.00	24.00	23.25	25.11	33.66	50.98	51.56	51.77	47.51	41.58	35.74	32.91	30.24	28.88	29.31	32.50	51.50	61.32	50.07	43.14	31.36	27.56	36.63	41.90
Wisconsin PS	24.43	24.42	22.48	22.29	22.02	24.08	41.42	49.57	51.27	49.86	48.51	46.75	41.08	36.79	36.23	32.49	32.13	37.88	53.32	59.75	48.88	43.31	32.47	29.57	37.96	43.77
Cleared Load (GW)	60.6	58.7	58.2	58.2	59.1	62.0	67.2	72.6	72.7	73.3	73.3	73.1	72.8	72.4	71.5	70.5	70.7	71.9	75.0	76.5	74.9	72.5	69.4	6.6		

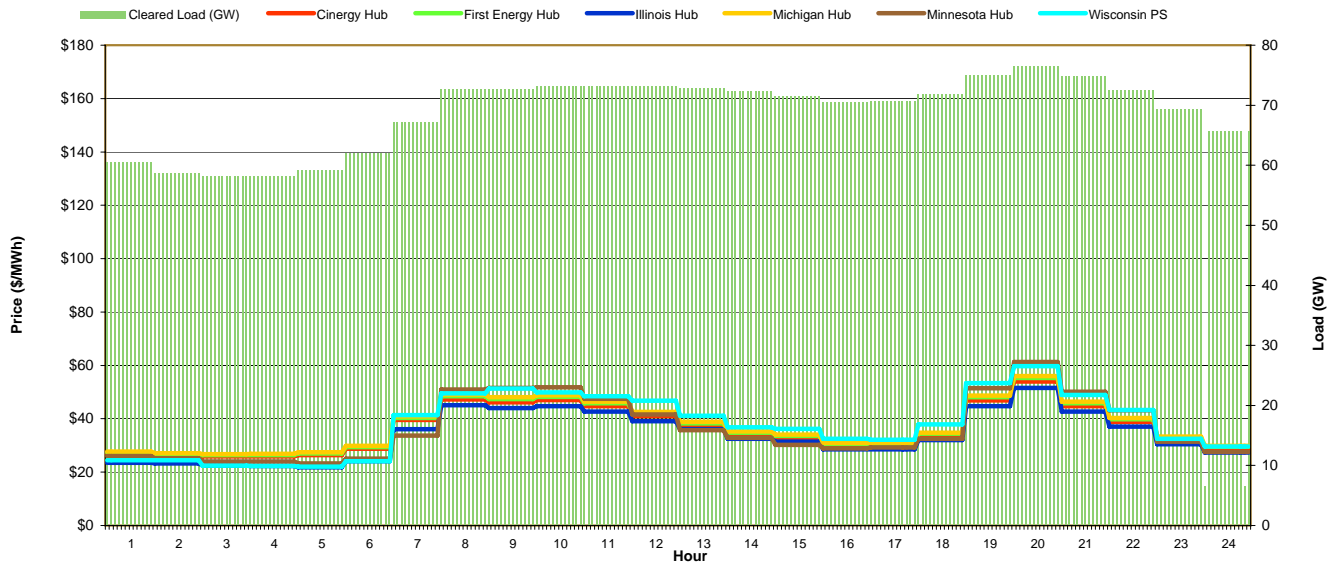

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	29.64	28.32	27.14	26.17	27.80	29.64	25.13	23.31	26.21	35.40	44.66	42.79	41.64	34.60	26.61	27.32	25.79	29.18	53.57	58.73	51.94	64.41	33.50	28.42	35.00	38.73
First Energy Hub	30.20	28.85	27.64	26.65	28.30	30.10	25.44	23.57	26.45	35.76	45.28	43.50	42.40	35.27	27.17	27.97	26.42	29.79	54.48	59.59	52.66	65.16	33.99	26.98	35.57	39.34
Illinois Hub	28.37	27.00	25.87	24.96	26.48	28.18	23.99	22.63	25.67	34.72	43.74	41.80	40.62	33.71	25.87	26.50	24.89	28.23	51.94	57.37	50.73	63.17	32.69	25.66	33.95	37.77
Michigan Hub	30.77	29.39	28.13	27.00	28.64	30.51	25.69	23.76	26.62	36.08	45.65	43.93	43.03	35.88	27.59	28.34	26.71	29.97	54.84	60.23	53.25	66.41	34.80	27.43	36.03	39.82
Minnesota Hub	28.07	26.37	25.02	23.99	25.56	27.04	22.63	22.55	25.36	33.79	42.10	39.68	48.32	32.95	24.41	21.29	28.80	20.00	68.08	174.72	129.97	88.33	46.41	23.76	43.72	52.92
Wisconsin PS	27.43	27.05	26.44	26.51	26.03	26.84	23.77	26.22	26.98	33.28	40.94	36.93	37.24	32.13	26.73	27.09	26.02	29.70	51.92	68.92	55.48	57.83	33.31	26.59	34.22	38.17
Forecasted Load (GW)	63.3	62.1	61.2	61.0	61.7	64.4	68.5	73.8	75.3	75.4	75.2	74.6	73.6	72.7	71.9	71.0	70.7	71.9	75.6	77.2	76.1	74.0	70.9	67.1		
Forecast Error %	-1.8%	-2.9%	-3.0%	-3.0%	-3.1%	-2.9%	-0.6%	-0.4%	-0.6%	-0.5%	-0.6%	-0.7%	-0.5%	0.0%	0.2%	0.1%	0.4%	-0.3%	-1.8%	-0.3%	0.5%	0.8%	0.4%	0.5%		

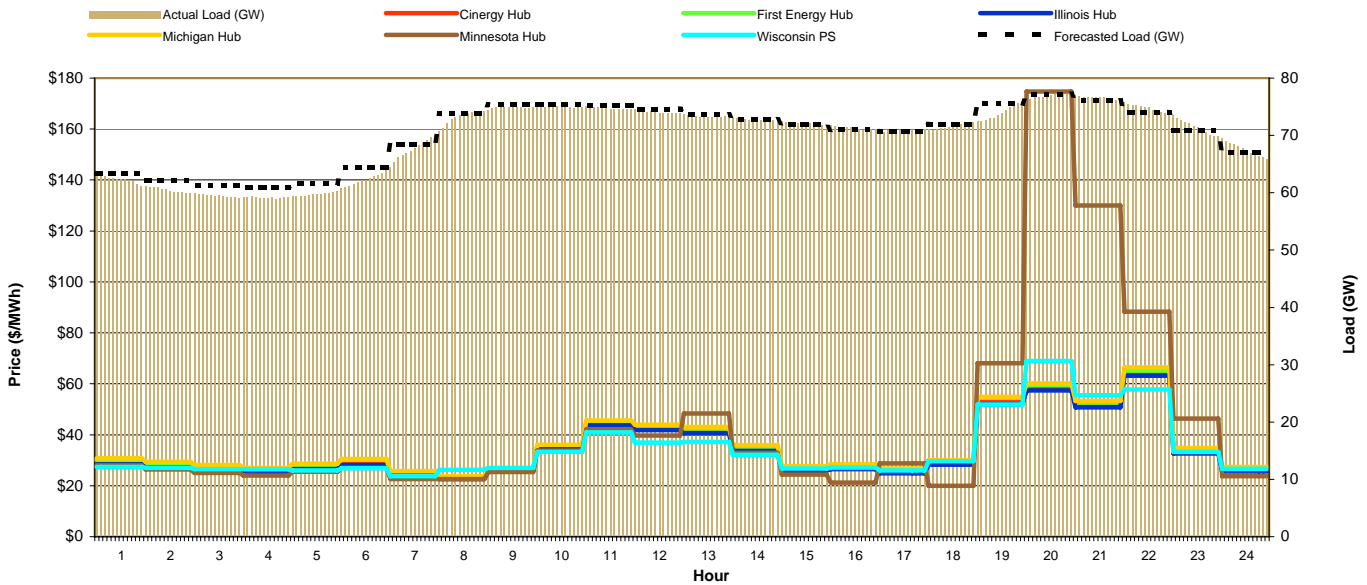




MISO Daily Report

Wednesday February 24, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
																									All	On Pk		
Cinergy Hub	26.94	26.50	26.25	26.25	26.84	30.70	37.31	49.82	47.97	48.56	47.25	45.56	41.28	40.17	37.25	32.38	32.48	34.95	49.99	57.74	47.51	44.59	36.66	30.83	38.57	43.39		
First Energy Hub	27.66	27.21	26.96	26.96	27.56	31.53	38.27	51.14	49.21	49.93	48.55	47.03	42.32	41.18	38.19	33.20	33.29	35.83	51.25	59.20	48.71	45.71	37.67	31.67	39.59	44.53		
Illinois Hub	25.58	25.17	24.94	24.94	25.50	29.16	35.69	47.58	45.76	46.23	45.03	43.41	39.45	38.39	35.60	30.95	31.04	33.40	47.76	55.16	45.38	42.61	34.86	29.30	36.79	41.41		
Michigan Hub	28.02	27.57	27.31	27.31	27.92	31.94	38.77	51.59	49.86	50.25	48.91	46.69	42.87	41.72	38.69	33.63	33.73	36.30	51.93	59.98	49.35	46.31	38.16	32.08	40.04	45.00		
Minnesota Hub	26.65	26.00	25.29	25.00	25.55	29.24	37.14	53.18	53.42	53.66	51.06	47.99	42.89	41.60	38.58	33.55	33.63	36.55	52.96	61.55	50.83	46.18	34.53	29.03	39.84	45.76		
Wisconsin PS	24.65	24.76	23.62	23.43	24.20	27.09	36.69	51.33	51.70	50.26	48.84	46.91	42.20	40.11	37.24	33.42	33.73	38.74	55.93	62.28	50.73	46.80	35.30	30.77	39.20	45.34		
Cleared Load (GW)	63.0	61.5	60.6	60.5	61.3	64.2	69.6	74.2	74.8	75.2	74.8	73.5	73.0	72.0	70.9	70.7	70.8	71.8	74.9	76.9	76.0	73.3	70.1	6.7				

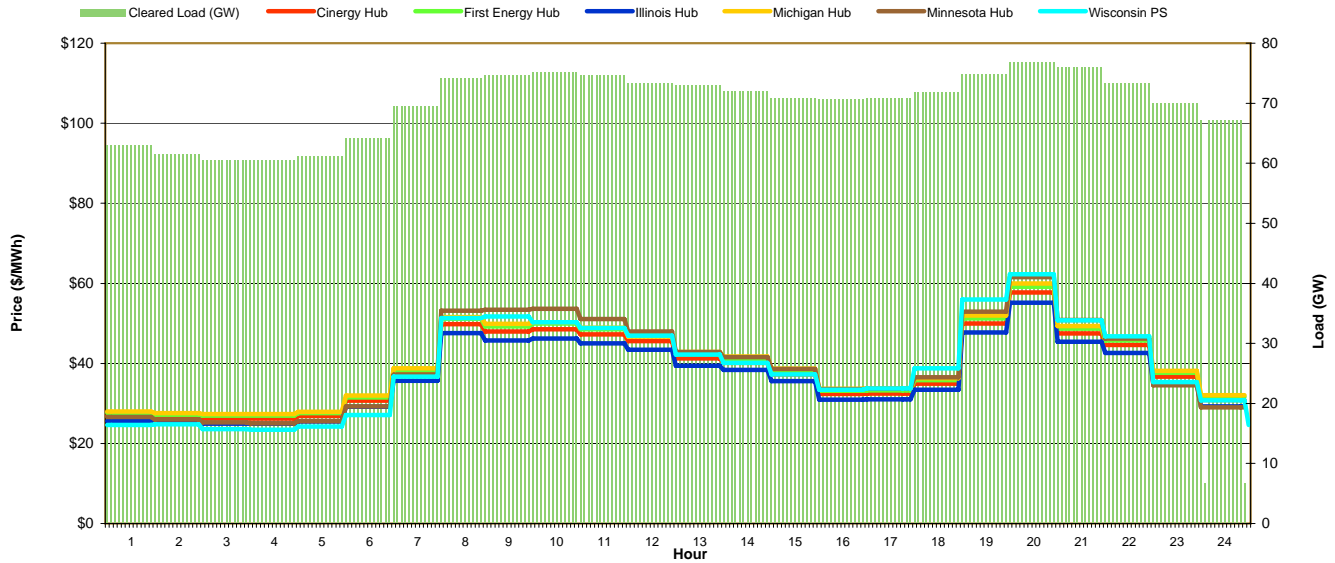

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
																									All	On Pk		
Cinergy Hub	26.22	29.24	26.84	25.86	25.41	25.65	33.45	43.52	47.75	38.47	30.43	114.46	39.16	38.69	62.72	30.39	29.06	27.43	33.99	47.17	68.05	38.08	39.67	31.56	39.72	45.57		
First Energy Hub	26.91	29.96	27.49	26.46	25.96	26.15	33.99	44.25	48.52	39.03	30.90	116.24	39.81	39.37	63.83	30.96	29.60	27.95	34.59	47.71	68.84	38.59	40.33	32.13	40.40	46.28		
Illinois Hub	25.17	27.98	25.65	24.73	24.19	24.43	31.91	41.96	46.41	37.67	29.81	111.63	38.20	37.58	60.79	29.34	28.07	26.53	33.03	46.24	66.47	37.08	38.40	30.32	38.48	44.33		
Michigan Hub	27.22	30.34	27.80	26.72	26.20	26.35	34.32	44.56	48.68	39.15	30.99	116.89	40.17	39.94	65.06	31.63	30.13	28.16	34.54	47.67	68.90	38.68	40.78	32.51	40.72	46.62		
Minnesota Hub	24.08	18.14	19.33	14.10	19.11	20.58	19.88	50.19	80.88	67.48	34.80	115.26	38.65	37.58	61.10	29.06	27.50	26.00	32.80	48.44	67.80	37.11	37.33	29.14	39.85	49.50		
Wisconsin PS	25.30	27.66	26.25	26.38	24.41	24.30	28.90	39.54	43.22	37.34	31.74	84.04	34.83	34.16	50.33	28.27	27.68	28.67	37.43	53.18	60.47	38.05	35.40	29.21	36.53	41.52		
Forecasted Load (GW)	65.0	63.2	62.4	62.1	62.9	65.4	69.6	75.1	76.4	76.3	76.1	75.4	74.5	73.8	72.8	71.7	71.5	72.8	76.7	78.2	77.4	75.4	72.6	69.0				
Forecast Error %	-1.4%	-1.1%	-1.4%	-1.4%	-1.1%	-0.9%	1.3%	0.8%	0.6%	0.4%	0.2%	0.1%	0.6%	0.6%	0.9%	1.3%	1.1%	0.5%	-1.0%	1.1%	1.5%	1.4%	0.5%	-9.1%				

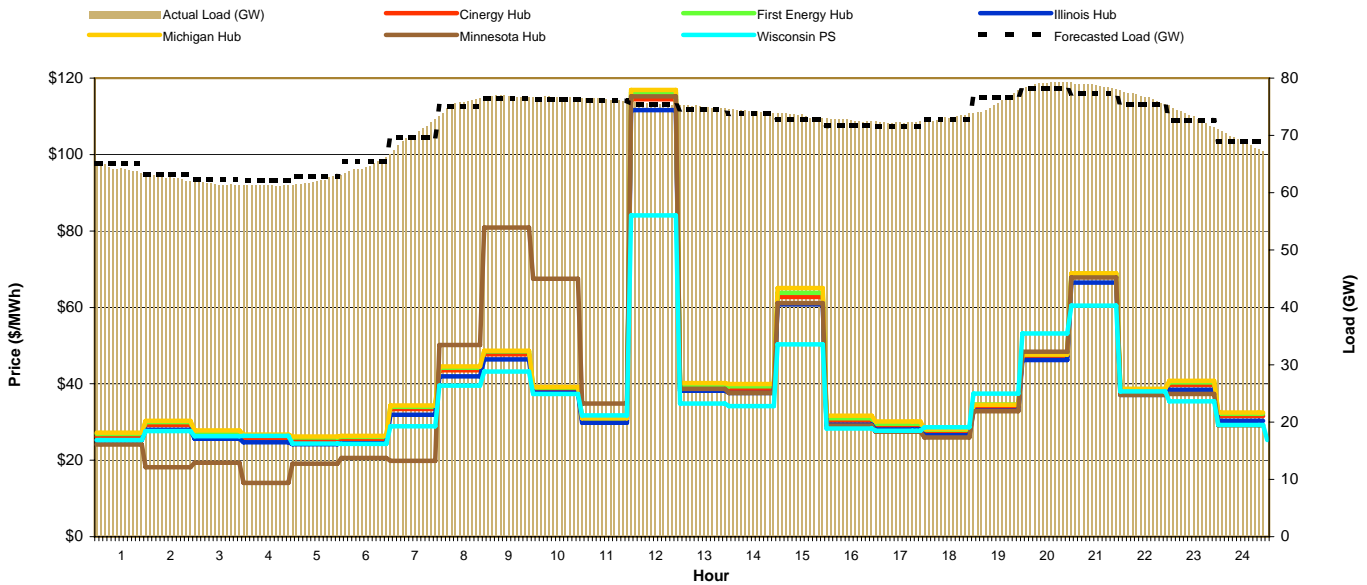




MISO Daily Report

Thursday February 25, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	Hour																								Avg. Hr \$			
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk		
Cinergy Hub	29.33	29.35	28.32	28.12	28.47	31.50	43.73	50.86	45.14	44.90	44.74	44.80	40.76	41.88	37.86	32.55	32.05	36.58	48.68	58.01	49.06	44.79	38.07	36.97	39.44	43.17		
First Energy Hub	30.12	30.15	29.07	28.87	29.23	32.35	44.88	52.15	46.30	46.13	45.93	45.94	41.80	42.93	38.81	33.36	32.86	37.50	49.94	59.56	50.31	45.93	39.11	37.99	40.47	44.29		
Illinois Hub	27.87	27.89	26.92	26.73	27.04	29.93	41.84	48.53	42.82	42.54	42.50	42.78	38.91	40.03	36.18	31.10	30.63	34.95	46.37	55.06	46.72	42.79	36.16	35.16	37.56	41.13		
Michigan Hub	30.51	30.54	29.45	29.25	29.61	32.77	45.46	52.84	46.93	46.74	46.53	46.54	42.35	43.50	39.32	33.80	33.29	37.99	50.60	60.34	50.98	46.54	39.62	38.49	41.00	44.87		
Minnesota Hub	27.61	27.00	25.19	25.83	25.48	29.65	45.33	55.41	52.09	54.23	51.21	47.74	43.38	43.49	39.66	33.84	33.19	38.25	54.60	68.69	55.44	48.47	37.14	34.83	41.57	47.30		
Wisconsin PS	26.09	26.52	24.00	23.78	24.45	27.56	41.01	52.38	49.72	49.08	47.58	46.72	42.61	41.36	37.73	33.57	33.48	39.86	55.51	64.19	52.17	47.22	36.73	34.72	39.92	45.62		
Cleared Load (GW)	63.8	62.1	61.6	61.4	62.4	65.5	69.5	75.3	76.2	75.5	75.1	74.4	73.1	72.5	71.6	69.9	70.0	71.1	74.3	76.2	75.4	72.7	69.8	6.6				

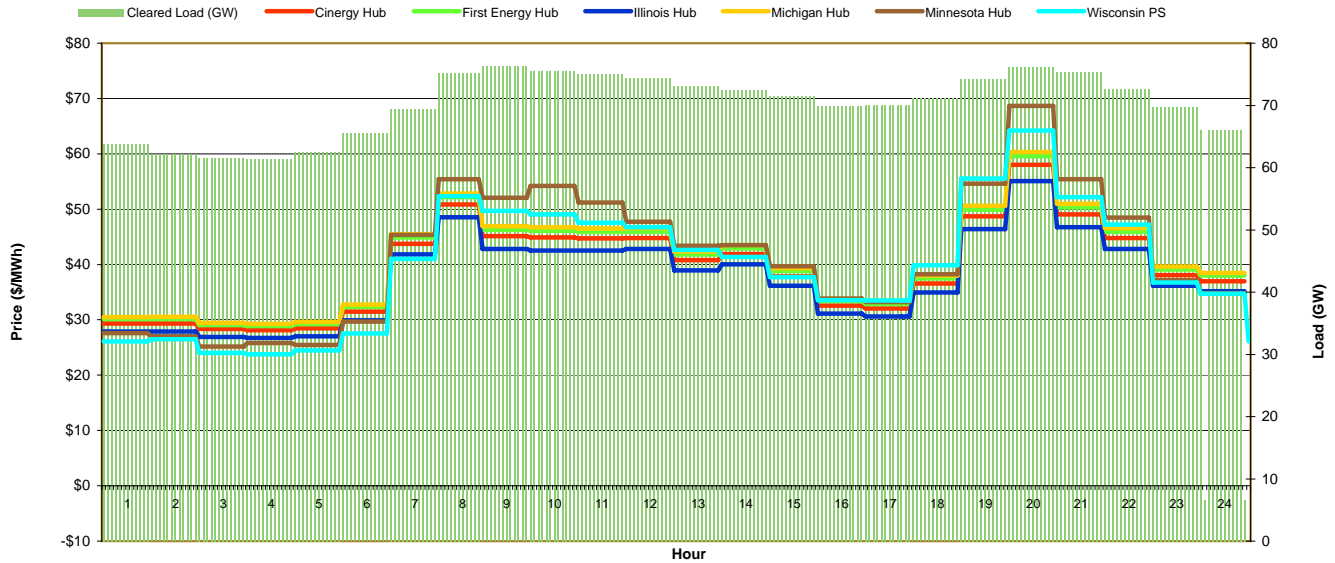

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	Hour																								Avg. Hr \$			
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk		
Cinergy Hub	71.47	44.03	41.25	30.03	31.02	27.22	34.13	39.49	39.68	37.15	31.52	31.23	32.51	31.20	30.49	29.78	28.05	27.43	33.06	50.30	37.97	37.85	29.90	30.19	35.71	34.23		
First Energy Hub	71.12	37.48	35.90	29.17	28.99	27.66	34.58	39.81	40.02	37.52	31.89	31.67	33.05	31.79	31.12	30.43	28.76	28.10	33.78	51.14	38.57	38.45	30.42	30.86	35.51	34.78		
Illinois Hub	56.58	-7.29	1.20	19.67	12.54	25.05	32.25	37.82	38.45	36.14	30.72	30.42	31.58	30.20	29.43	28.57	26.80	26.21	31.74	48.83	36.86	36.63	28.85	28.89	29.09	33.08		
Michigan Hub	72.13	38.04	36.47	29.49	29.21	27.81	34.70	39.83	39.88	37.47	31.98	31.95	33.56	32.41	31.80	31.15	29.42	28.67	34.16	51.66	39.12	39.09	31.18	31.69	35.95	35.21		
Minnesota Hub	62.29	32.88	30.82	24.90	24.49	23.33	29.10	35.83	37.84	35.47	29.75	29.38	30.67	29.50	28.86	27.71	25.37	24.59	30.41	48.30	37.02	36.43	28.33	28.00	32.14	32.22		
Wisconsin PS	51.82	31.92	30.92	27.72	25.79	24.86	28.90	36.08	35.45	34.06	32.04	29.17	30.59	29.45	29.20	27.93	26.58	28.14	36.38	54.67	40.13	37.92	29.44	28.83	32.83	33.58		
Forecasted Load (GW)	66.8	64.4	63.4	63.2	64.0	66.4	71.2	76.3	77.4	77.2	76.7	75.9	74.8	74.1	73.1	72.1	71.7	73.1	77.0	78.9	77.9	75.9	73.3	69.5				
Forecast Error %	-1.5%	-0.4%	-0.1%	-0.3%	-0.3%	-0.1%	1.0%	0.7%	0.8%	0.6%	0.2%	-0.2%	-0.2%	-0.5%	-0.2%	-0.2%	-0.3%	-1.4%	-3.2%	-1.4%	-0.5%	-0.4%	-1.3%	-11.0%				

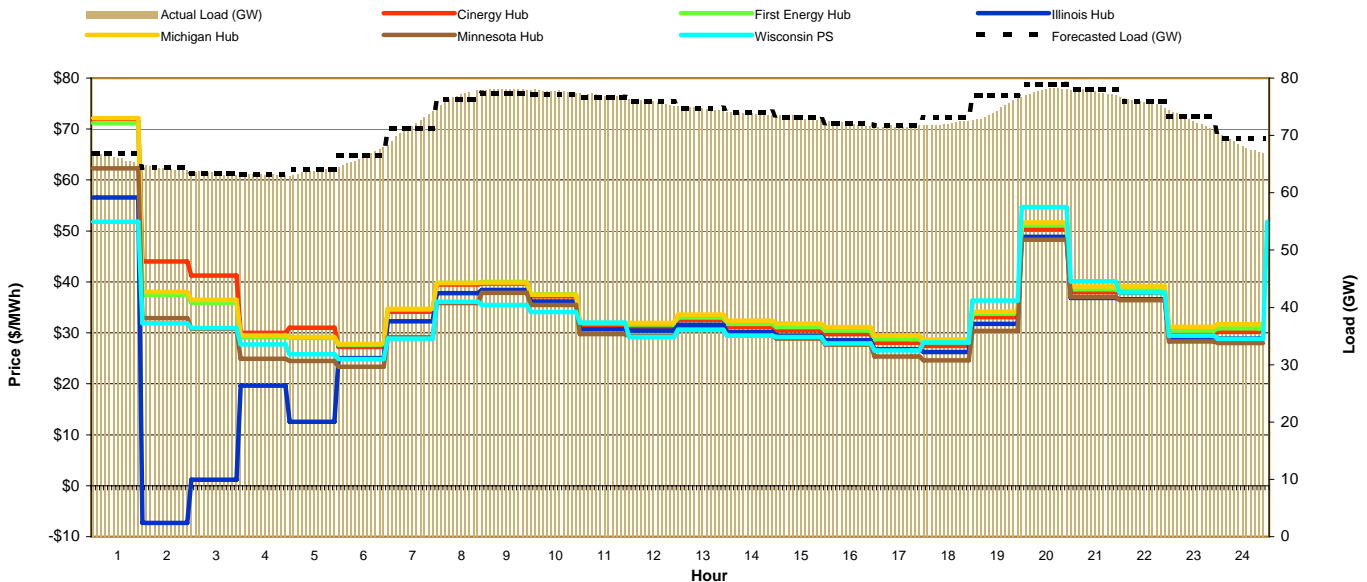




MISO Daily Report

Friday February 26, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	33.13	32.09	29.99	29.24	29.54	29.97	40.31	50.83	48.44	46.83	46.04	43.88	40.24	37.29	34.18	30.77	30.36	32.27	45.16	46.38	43.87	37.39	36.90	31.61	37.78	40.68
First Energy Hub	32.94	31.99	30.01	29.29	29.62	30.05	40.63	52.11	49.67	48.02	47.20	44.98	41.26	38.25	35.05	31.55	31.12	33.08	46.30	47.58	44.98	38.33	37.98	32.58	38.52	41.72
Illinois Hub	23.94	23.33	22.64	22.11	21.83	22.98	33.21	48.58	46.28	44.67	43.99	41.92	38.41	35.56	32.62	29.41	29.01	30.84	43.16	44.14	41.87	35.73	35.15	30.15	34.23	38.83
Michigan Hub	33.37	32.40	30.40	29.68	30.06	30.44	41.16	52.79	50.32	48.66	47.83	45.58	41.80	38.76	35.51	31.97	31.53	33.52	46.91	48.22	45.58	38.83	38.47	33.00	39.03	42.27
Minnesota Hub	30.18	29.31	27.49	26.57	26.21	27.46	41.04	52.64	51.39	50.32	48.31	45.66	42.22	39.45	35.86	31.87	31.44	33.42	47.39	49.22	45.92	38.72	34.82	29.87	38.20	42.42
Wisconsin PS	27.85	27.67	25.47	24.62	24.65	26.04	38.23	51.84	51.20	48.37	47.03	45.68	42.03	39.25	35.76	32.55	32.53	37.12	51.90	56.65	48.52	41.65	35.49	31.34	38.48	43.60
Cleared Load (GW)	64.9	63.3	62.4	62.2	63.0	65.4	69.4	74.2	74.8	74.9	74.5	74.0	72.3	71.7	70.8	68.8	68.3	69.0	71.3	73.2	72.1	70.4	67.1	63		

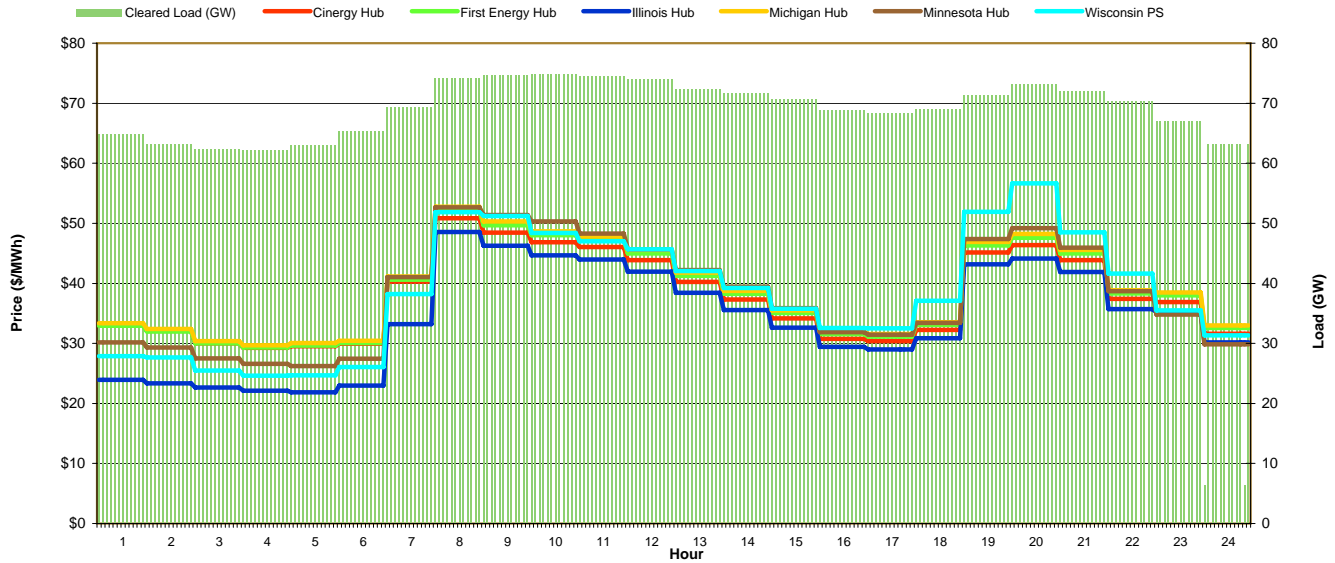

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	32.40	32.11	29.92	29.77	35.37	26.07	34.19	38.03	55.13	72.76	41.25	65.57	45.50	31.35	50.68	30.47	30.16	33.98	33.37	39.37	34.21	46.26	33.37	33.14	38.93	42.59
First Energy Hub	33.23	32.90	30.74	30.62	36.56	26.80	34.94	38.78	56.34	74.52	42.40	67.62	47.00	32.45	52.44	31.56	31.23	35.17	34.48	40.53	35.23	47.61	34.36	34.05	40.07	43.86
Illinois Hub	30.66	29.84	26.60	26.53	24.72	24.59	32.12	36.15	52.89	69.95	39.71	63.17	43.70	30.07	48.45	28.90	27.58	31.76	31.54	37.69	32.95	44.53	32.05	31.62	36.57	40.69
Michigan Hub	34.23	33.90	31.62	31.42	37.93	27.34	35.42	39.03	56.62	75.24	43.05	68.95	48.05	33.47	54.04	32.32	31.87	35.85	34.75	40.87	35.48	48.21	34.96	34.59	40.80	44.55
Minnesota Hub	29.24	27.91	24.40	24.14	22.09	22.93	29.56	35.07	52.48	69.34	39.11	61.14	42.06	29.17	46.52	27.48	25.93	30.02	29.98	36.11	31.45	42.09	30.23	27.82	34.84	39.26
Wisconsin PS	29.03	28.89	26.59	27.24	23.24	24.74	29.43	35.54	45.85	57.70	38.39	51.66	38.73	29.32	42.26	28.08	27.08	31.99	36.21	46.87	37.24	42.97	31.37	30.25	35.03	38.83
Forecasted Load (GW)	67.0	65.2	64.2	63.9	64.5	66.7	71.4	76.3	77.4	77.2	76.8	75.5	74.2	73.0	71.8	70.7	70.1	70.7	73.9	75.2	74.1	72.3	69.6	66.1		
Forecast Error %	-2.7%	-2.6%	-2.5%	-2.4%	-2.2%	-1.7%	-1.1%	-1.4%	-1.3%	-1.3%	-1.4%	-0.9%	-0.8%	-0.7%	-0.5%	-0.6%	-1.0%	-1.5%	-1.7%	-1.2%	-1.2%	-1.1%	-1.2%			

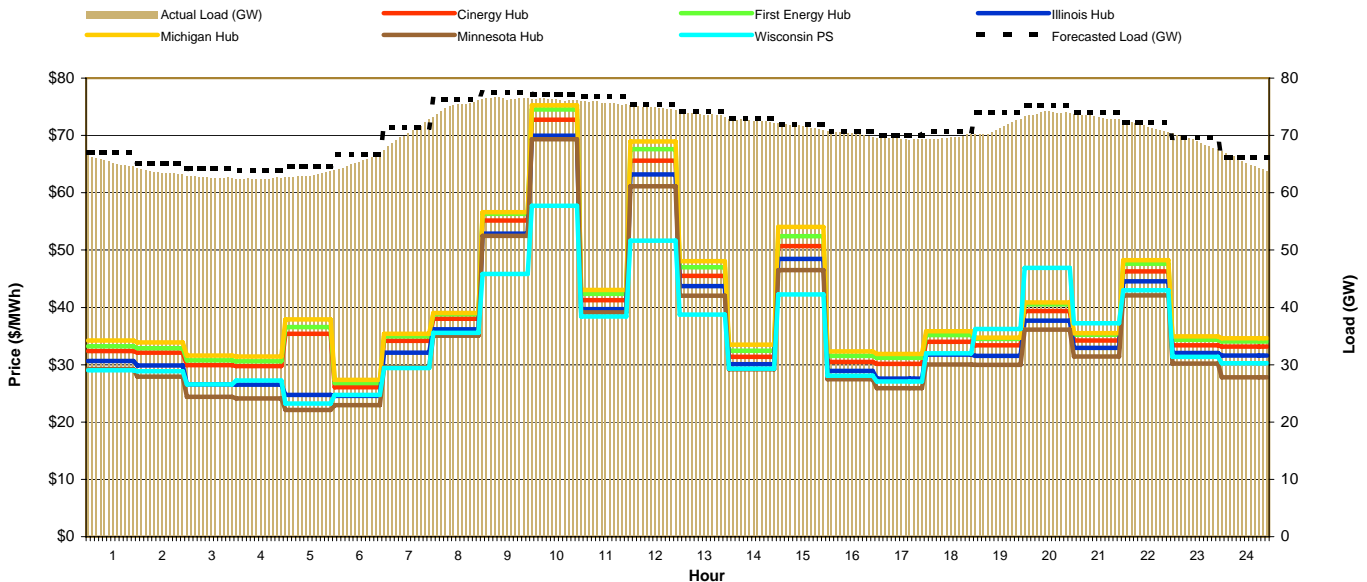




MISO Daily Report

Saturday February 27, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$			
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk		
Cinergy Hub	32.21	32.30	31.31	30.48	29.30	30.28	32.24	35.26	44.58	49.60	48.63	44.57	38.54	34.15	30.56	29.26	29.37	32.08	48.54	50.64	47.05	44.56	37.97	31.29	37.28	40.34		
First Energy Hub	32.59	32.60	31.55	30.74	29.70	30.73	32.53	35.63	44.91	50.13	49.14	45.04	38.95	34.51	30.88	29.57	29.71	32.42	49.06	51.18	47.55	45.04	38.82	31.94	37.71	40.78		
Illinois Hub	28.28	27.75	26.71	25.24	23.95	24.44	25.00	32.69	42.58	48.02	47.08	43.15	37.31	33.06	29.58	28.17	27.75	31.06	46.99	49.03	45.55	43.14	36.56	29.69	34.70	38.86		
Michigan Hub	33.18	33.21	32.14	31.36	30.35	31.43	33.52	36.51	45.97	51.31	50.30	46.10	39.86	35.32	31.61	30.28	30.44	33.19	50.21	52.38	48.67	46.10	39.53	32.52	38.56	41.74		
Minnesota Hub	30.29	30.19	29.09	27.51	25.37	25.74	28.59	35.78	46.37	51.79	50.77	46.52	40.24	35.64	31.90	30.37	30.01	33.63	50.68	53.00	49.24	47.74	36.08	29.68	37.34	41.86		
Wisconsin PS	28.10	28.42	26.69	25.30	24.04	24.61	29.20	40.66	48.08	49.82	48.47	45.89	40.41	36.13	32.83	31.26	31.11	36.89	54.24	56.97	49.96	46.71	36.56	31.39	37.66	42.87		
Cleared Load (GW)	60.6	59.3	58.5	58.0	57.8	59.2	61.7	62.9	63.8	65.3	65.7	64.8	64.0	62.9	62.0	61.0	61.2	62.2	65.0	66.7	66.0	64.5	61.8	5.9				

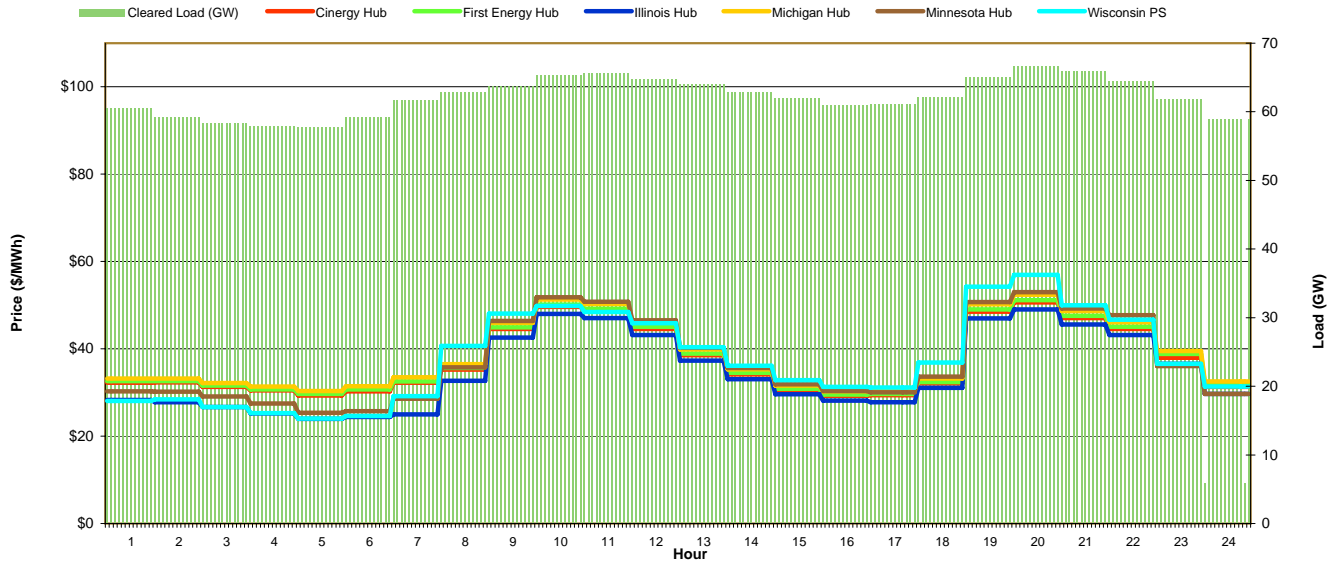

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$			
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk		
Cinergy Hub	52.27	64.85	32.64	31.14	29.97	30.11	31.98	34.75	59.68	55.39	51.15	53.47	64.20	28.01	28.37	31.60	27.15	38.80	45.76	97.96	54.68	40.76	34.83	40.04	44.15	46.66		
First Energy Hub	54.54	68.01	33.72	32.36	30.92	31.32	33.07	35.82	61.41	56.92	52.59	55.20	66.43	28.83	29.35	32.71	28.14	40.10	47.18	101.19	56.47	42.09	35.79	41.08	45.64	48.14		
Illinois Hub	28.63	57.96	30.33	29.22	27.32	27.07	29.30	33.27	57.14	52.97	49.19	51.42	61.87	26.82	27.03	29.84	24.84	36.57	43.46	93.93	52.47	39.13	33.24	38.05	40.88	44.57		
Michigan Hub	56.76	69.42	34.38	33.07	31.64	32.07	33.65	36.27	62.42	57.64	53.01	55.27	66.78	29.05	29.59	33.15	28.54	40.58	47.53	101.35	56.46	42.19	36.06	41.67	46.19	48.49		
Minnesota Hub	13.40	55.55	29.46	28.38	26.46	25.98	27.71	31.93	56.28	53.01	50.09	52.96	63.64	27.32	26.82	28.81	23.91	35.17	42.62	102.13	52.89	39.19	32.58	37.39	40.15	44.96		
Wisconsin PS	23.82	46.67	29.22	29.28	26.47	25.86	26.97	32.71	47.37	44.79	44.25	43.12	50.79	26.88	27.30	28.38	25.01	35.00	44.58	85.54	50.66	39.53	32.40	35.03	37.57	41.14		
Forecasted Load (GW)	62.6	61.2	60.4	59.9	59.9	60.7	62.3	63.9	65.5	66.9	67.5	66.9	65.7	64.5	63.6	62.7	62.6	63.5	67.0	68.9	68.1	66.7	64.5	61.5				
Forecast Error %	-1.0%	-2.5%	-3.3%	-3.1%	-3.1%	-2.9%	-1.2%	-0.7%	-0.4%	-0.5%	-0.3%	0.0%	0.0%	-0.5%	0.0%	0.2%	-0.3%	-0.1%	-1.5%	-0.6%	0.0%	-0.3%	-0.5%					

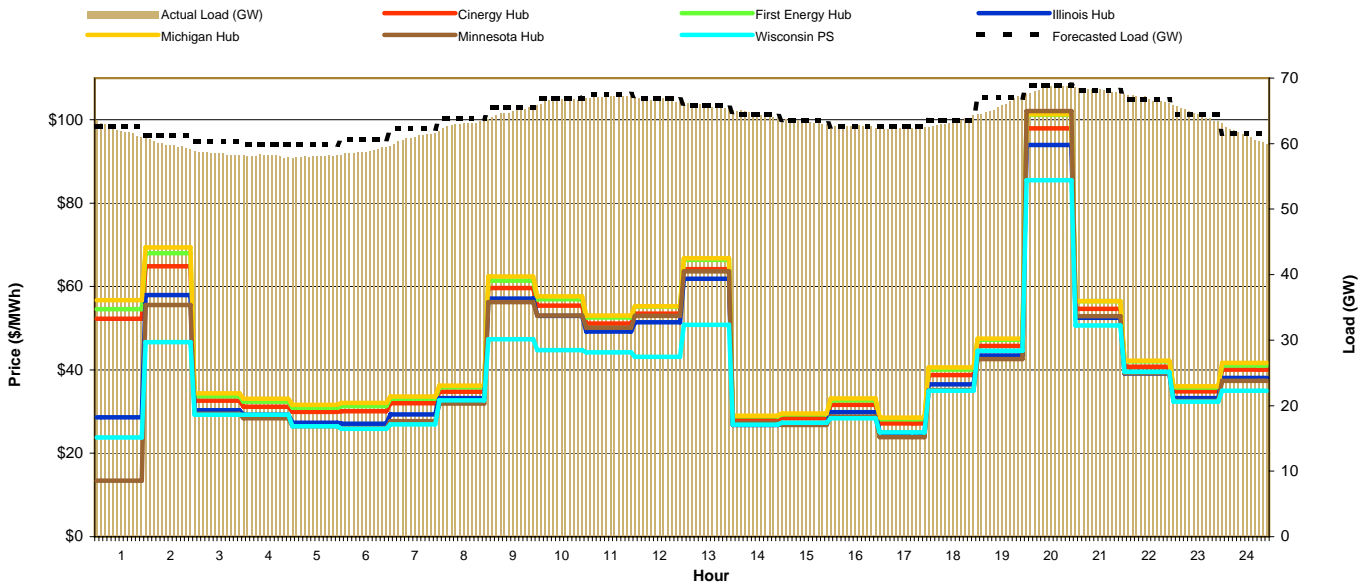




MISO Daily Report

Sunday February 28, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%

Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	32.15	32.11	31.55	30.11	29.06	29.96	30.92	33.54	37.26	43.40	41.19	40.41	35.41	34.93	32.42	30.61	30.84	33.54	44.54	50.01	46.50	44.25	36.46	30.76	35.91	38.46
First Energy Hub	32.64	32.60	32.07	30.62	29.62	30.55	31.18	33.86	37.74	43.98	41.73	40.93	35.83	35.35	32.80	30.97	31.18	33.93	45.08	50.60	47.09	44.84	37.31	31.45	36.41	38.95
Illinois Hub	28.84	28.77	27.00	25.06	23.22	23.30	24.88	30.65	36.15	42.13	39.97	39.22	34.33	33.86	31.42	29.66	29.87	32.50	43.19	48.47	45.11	42.96	35.15	29.60	33.55	37.17
Michigan Hub	33.25	33.21	32.75	31.31	30.36	31.28	32.07	34.66	38.63	45.01	42.71	41.90	36.68	36.18	33.57	31.70	31.92	34.73	46.15	51.80	48.20	45.90	38.00	32.03	37.25	39.86
Minnesota Hub	30.58	30.46	28.22	26.23	24.10	24.33	28.87	34.94	39.00	45.39	43.12	42.23	36.98	36.47	33.89	31.97	32.22	35.17	46.57	52.40	48.76	46.43	34.69	29.24	35.93	40.01
Wisconsin PS	28.16	28.53	25.98	24.30	23.01	23.50	29.73	40.31	43.41	45.72	43.54	43.17	38.38	36.70	34.14	32.37	32.73	37.93	51.64	56.59	49.65	46.48	35.60	31.08	36.78	41.77
Cleared Load (GW)	56.5	55.3	54.9	54.4	54.7	55.7	56.9	57.7	59.7	60.5	60.3	60.0	60.2	59.8	59.6	59.1	59.7	60.6	65.2	67.3	66.7	64.5	62.3	6.0		

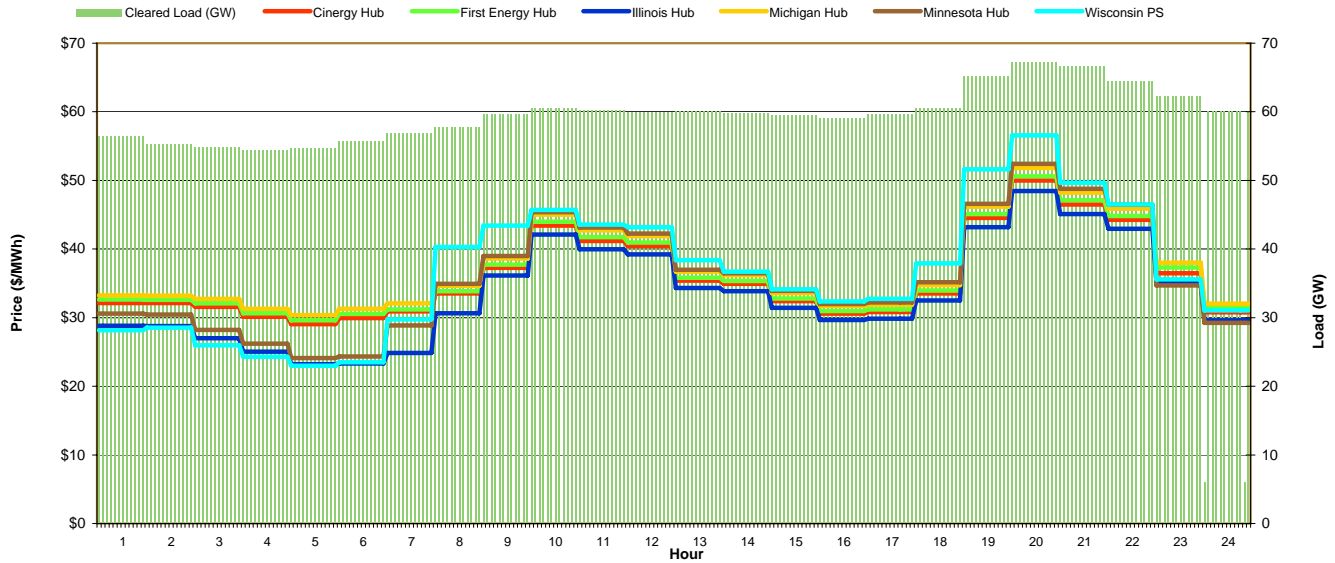

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	38.01	37.40	29.91	30.96	26.98	27.52	31.71	30.14	31.65	36.56	36.39	60.04	29.84	30.50	27.13	29.51	25.32	27.30	29.72	33.53	64.71	34.75	27.33	35.86	33.87	34.65
First Energy Hub	39.44	38.36	30.59	31.63	27.63	28.20	32.51	30.75	32.30	37.32	37.20	61.28	30.50	31.25	27.83	29.32	26.10	27.76	30.49	34.21	66.02	35.43	27.89	36.91	34.62	35.35
Illinois Hub	23.15	32.90	27.47	29.48	25.65	26.09	30.06	28.29	28.79	34.55	34.50	56.88	28.31	28.91	25.67	23.60	23.91	24.49	28.22	32.05	61.76	33.18	26.10	34.23	31.18	32.45
Michigan Hub	41.06	39.30	31.15	32.07	27.90	28.45	32.82	31.13	32.78	37.78	37.79	62.28	30.99	31.67	28.04	29.57	26.46	28.18	30.96	34.73	66.72	35.89	28.47	37.88	35.17	35.84
Minnesota Hub	22.43	32.68	27.03	28.89	25.30	25.63	29.68	28.17	28.13	33.95	34.06	56.82	28.93	29.64	26.30	25.64	24.12	25.10	27.54	32.31	61.67	32.99	26.29	33.81	31.13	32.60
Wisconsin PS	22.06	31.11	27.91	30.20	26.12	26.13	28.49	30.08	28.78	32.98	34.55	47.22	28.45	28.88	26.90	26.09	25.03	27.79	34.17	43.49	57.64	35.75	27.96	32.81	31.69	33.49
Forecasted Load (GW)	58.6	57.0	56.3	55.8	55.8	56.4	57.9	59.7	60.6	61.7	62.2	61.9	61.4	61.4	61.1	60.6	60.9	62.4	66.3	68.4	67.9	66.4	64.3	62.1		
Forecast Error %	-0.2%	-0.3%	-1.1%	-1.1%	-1.1%	-1.2%	-1.2%	-1.8%	-0.8%	-0.4%	-0.3%	-0.2%	-0.2%	-1.1%	-1.7%	-1.8%	-2.1%	-2.2%	-3.1%	-0.7%	-0.4%	-0.8%	-2.0%	-3.3%		

