




# MISO Daily Report

Monday March 1, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	29.03	28.13	27.59	27.44	27.86	33.02	43.49	48.84	51.92	55.11	50.43	50.72	46.64	44.53	41.06	37.73	36.41	36.05	53.90	61.20	52.08	44.27	36.37	34.85	41.61	46.70
First Energy Hub	29.54	28.67	28.10	27.94	28.36	33.69	44.43	49.55	53.93	57.15	52.01	52.33	48.15	45.94	42.29	38.84	37.00	39.72	55.20	62.32	53.04	45.50	37.21	35.56	42.77	48.14
Illinois Hub	26.20	25.48	25.05	24.94	25.38	30.85	38.90	45.72	42.88	46.54	44.51	44.51	40.50	38.92	36.31	33.48	35.31	37.91	50.53	59.03	50.34	40.73	34.40	32.17	37.94	42.60
Michigan Hub	30.02	29.13	28.56	28.40	28.82	34.22	45.32	50.32	52.50	55.94	51.53	51.73	47.46	45.36	41.89	38.50	37.57	40.33	55.38	63.14	53.76	45.36	37.80	36.13	42.88	48.04
Minnesota Hub	25.69	24.94	24.43	24.29	24.66	29.27	37.41	45.24	45.19	48.50	45.44	45.48	41.55	39.81	36.93	33.98	34.26	36.78	49.82	57.43	48.94	40.51	32.43	30.92	37.66	42.64
Wisconsin PS	25.21	25.10	23.79	23.52	24.17	27.79	37.54	50.18	50.68	51.22	48.23	48.39	44.15	41.65	38.68	35.95	36.19	41.34	57.19	63.54	52.88	45.70	34.49	32.58	40.01	46.28
Cleared Load (GW)	58.6	57.1	56.5	56.5	57.7	60.9	67.6	71.6	72.6	73.0	73.1	72.5	71.5	70.6	69.2	67.4	67.8	68.4	71.9	74.4	72.8	71.0	67.4	64		

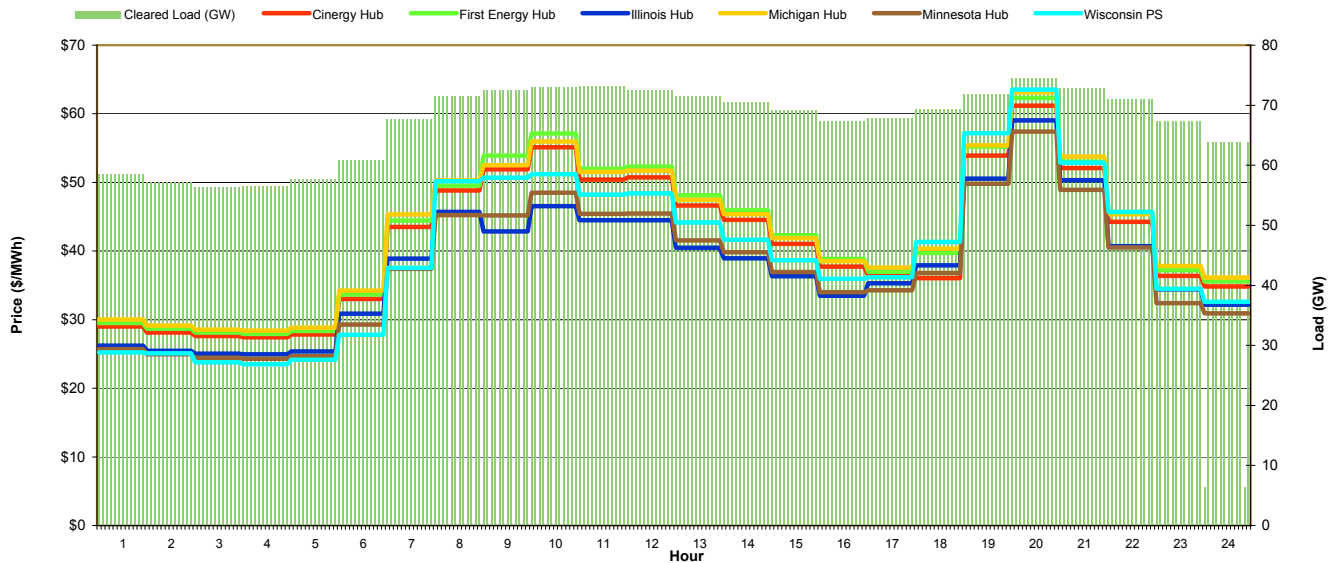

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	23.62	25.92	26.12	26.29	25.27	25.78	29.36	33.02	28.86	30.48	36.05	46.42	38.45	41.57	43.20	33.06	34.15	32.51	34.09	44.61	40.90	35.02	28.58	31.03	33.10	36.31
First Energy Hub	24.14	26.77	26.85	26.99	25.93	26.38	29.85	33.42	29.35	31.06	36.78	47.37	39.13	42.37	44.17	33.79	34.95	33.31	34.96	45.59	41.69	35.67	29.10	31.61	33.80	37.04
Illinois Hub	21.80	24.28	24.41	24.19	22.33	22.30	27.76	31.49	27.76	29.39	33.73	43.69	37.04	40.03	40.53	31.73	32.66	31.13	32.71	43.10	39.56	33.84	27.58	29.78	31.37	34.75
Michigan Hub	24.71	27.33	27.39	27.55	26.46	27.06	30.47	34.10	29.75	31.32	37.05	47.45	39.57	43.23	45.32	34.63	35.73	33.78	35.10	45.74	42.03	36.34	29.65	32.38	34.35	37.56
Minnesota Hub	21.87	23.94	23.74	23.22	21.46	21.29	26.24	31.42	28.54	30.19	35.59	45.71	37.57	39.82	41.34	31.92	32.61	30.70	32.36	43.67	40.85	34.67	28.02	30.18	31.54	35.31
Wisconsin PS	23.92	25.84	26.14	26.61	23.69	23.22	26.97	32.82	29.09	30.43	35.59	39.85	34.82	36.47	38.02	30.62	31.38	32.14	37.65	51.57	42.87	36.81	29.51	30.42	32.35	35.60
Forecasted Load (GW)	59.2	57.9	57.4	57.7	59.1	62.8	68.2	72.1	73.2	73.3	73.2	72.6	71.8	70.8	69.5	68.3	67.6	68.4	71.5	74.7	73.6	71.1	67.7	64.4		
Forecast Error %	-2.7%	-2.9%	-3.2%	-3.4%	-4.0%	-5.4%	-4.3%	-2.3%	-1.3%	-1.0%	-1.1%	-0.9%	-0.8%	-0.5%	0.3%	0.9%	1.2%	0.7%	-0.4%	-0.6%	0.2%	0.6%	0.6%	-0.3%		

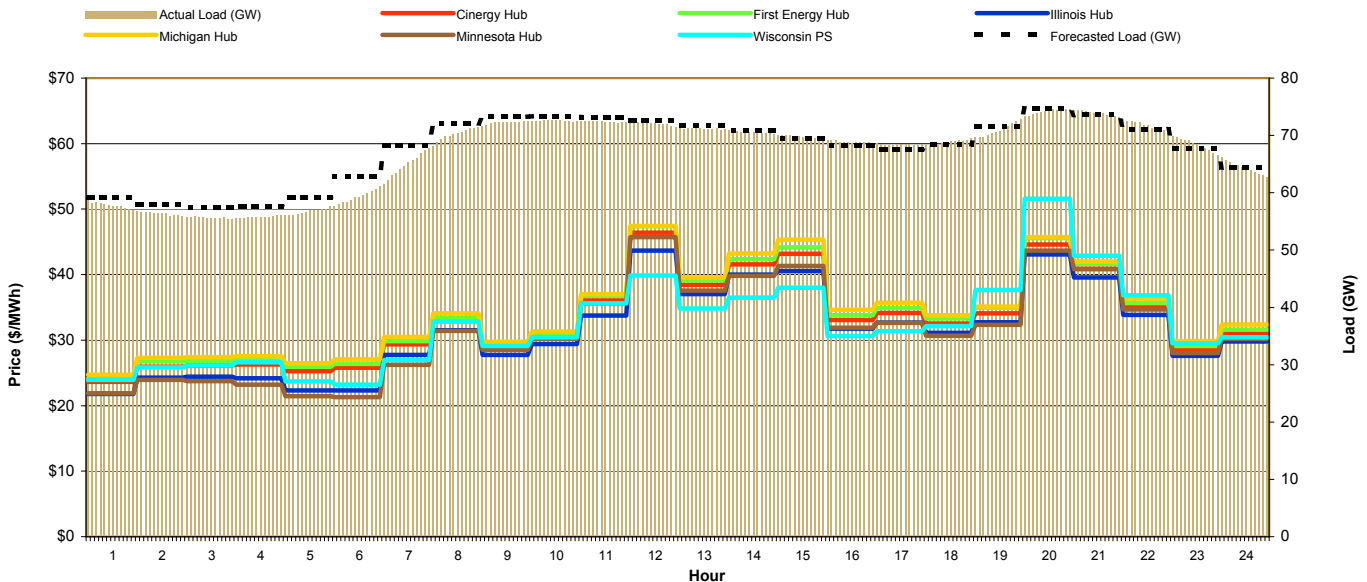




# MISO Daily Report

Tuesday March 2, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	31.19	29.68	29.21	28.99	29.58	34.99	45.90	49.16	49.91	50.19	51.40	49.10	44.78	42.59	41.10	37.77	34.34	37.85	49.11	61.13	48.09	44.38	36.91	34.76	41.34	45.49
First Energy Hub	31.52	30.03	29.60	29.40	29.95	35.46	46.46	50.01	51.04	51.25	52.94	50.75	46.31	43.99	42.42	38.91	34.90	38.47	49.91	62.13	48.92	45.17	37.74	35.47	42.20	46.55
Illinois Hub	26.13	24.66	23.59	23.23	24.07	28.38	36.25	47.77	47.86	48.18	46.45	43.21	39.30	37.64	36.43	33.92	33.33	36.73	47.66	59.33	46.72	43.14	34.90	32.08	37.54	42.66
Michigan Hub	32.01	30.51	30.12	29.93	30.46	35.92	46.94	50.79	51.84	52.05	52.75	50.15	45.70	43.50	41.99	38.66	35.44	39.06	50.68	63.09	49.68	45.86	38.33	36.02	42.56	46.85
Minnesota Hub	27.68	25.77	24.48	24.04	25.03	30.61	39.44	46.31	47.23	47.43	46.96	44.18	40.18	38.35	37.08	34.30	32.31	35.61	46.21	57.52	45.30	41.83	32.79	30.84	37.56	42.10
Wisconsin PS	26.44	25.64	23.66	23.15	24.32	28.73	39.38	50.52	51.62	49.94	49.07	47.32	43.06	40.47	38.98	36.34	34.76	40.45	54.28	63.50	50.28	46.13	34.67	32.53	39.80	45.71
Cleared Load (GW)	57.8	55.8	54.6	54.2	54.6	55.5	57.3	60.0	60.9	62.1	63.0	63.0	62.0	61.1	60.2	60.0	61.0	65.9	68.4	68.2	67.6	66.6	63.7	61.3		

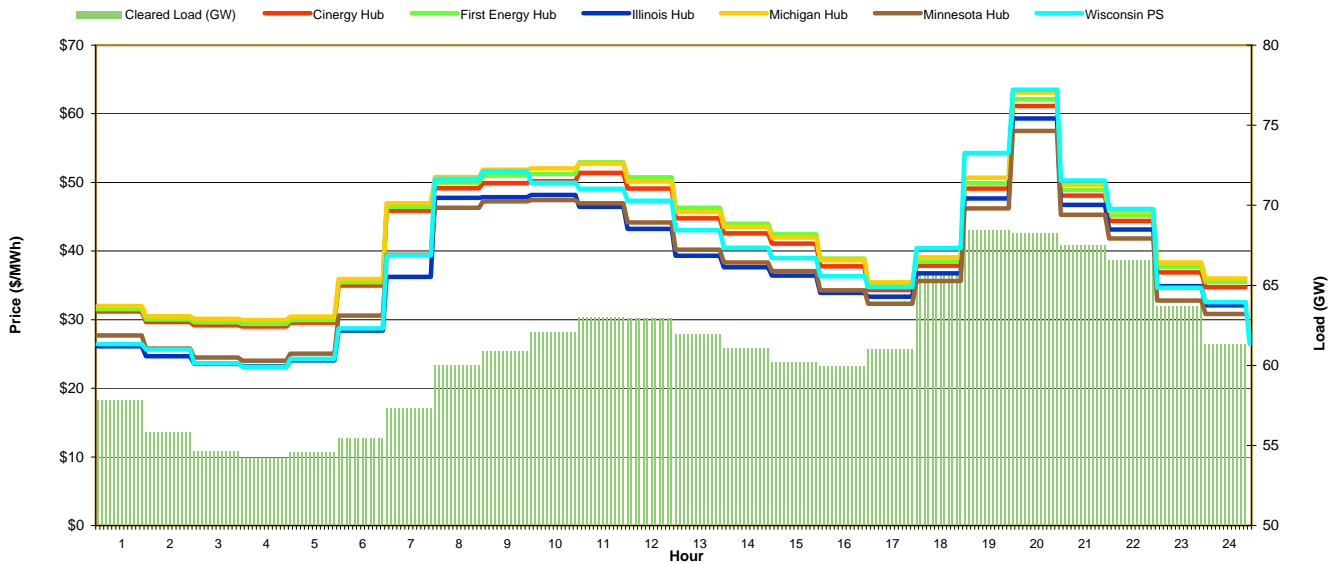

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	19.36	20.01	20.14	15.86	14.09	11.17	30.06	42.68	23.86	24.45	27.11	22.80	24.36	25.06	23.88	22.84	22.31	34.19	27.12	32.76	38.65	31.09	21.50	22.66	24.92	27.79
First Energy Hub	19.46	20.54	20.96	16.53	14.59	11.70	31.12	43.87	24.65	25.35	28.10	23.64	25.26	26.07	24.81	23.69	23.11	35.53	28.02	33.94	39.95	32.18	22.16	23.13	25.77	28.77
Illinois Hub	8.10	12.83	7.69	12.93	12.89	9.01	15.30	40.81	22.15	23.31	24.61	22.05	22.68	23.54	21.89	21.64	19.67	27.93	26.18	26.71	33.71	22.62	20.37	20.98	20.82	24.99
Michigan Hub	25.50	24.34	26.77	21.99	15.30	12.47	36.83	45.75	28.19	30.86	29.64	24.46	30.07	28.76	26.89	24.94	24.23	58.24	28.45	34.58	40.82	33.50	22.61	23.69	29.13	32.01
Minnesota Hub	-44.21	-10.12	8.49	19.56	15.13	16.15	12.99	33.85	22.28	23.51	25.43	21.26	21.45	23.11	21.81	20.93	19.36	31.92	26.65	31.50	26.84	14.71	6.82	11.32	16.70	23.21
Wisconsin PS	0.15	18.27	8.23	19.04	21.71	25.53	14.85	41.23	19.77	16.50	28.49	24.06	16.08	21.53	22.01	22.38	21.37	34.11	33.97	44.11	45.41	32.27	30.43	28.09	24.57	28.36
Forecasted Load (GW)	59.9	57.9	56.7	56.1	56.0	56.4	57.7	59.8	61.5	62.7	63.3	64.0	63.9	63.6	62.9	62.5	63.1	65.9	69.9	70.3	69.3	67.5	65.7	62.7		
Forecast Error %	-3.0%	-2.8%	-2.9%	-2.7%	-2.4%	-2.3%	-1.9%	-1.8%	-1.5%	-0.7%	-2.2%	-2.2%	-1.9%	-1.6%	-1.5%	-1.4%	-0.2%	0.2%	-0.2%	-0.3%	-0.5%	-2.2%	-12.9%			

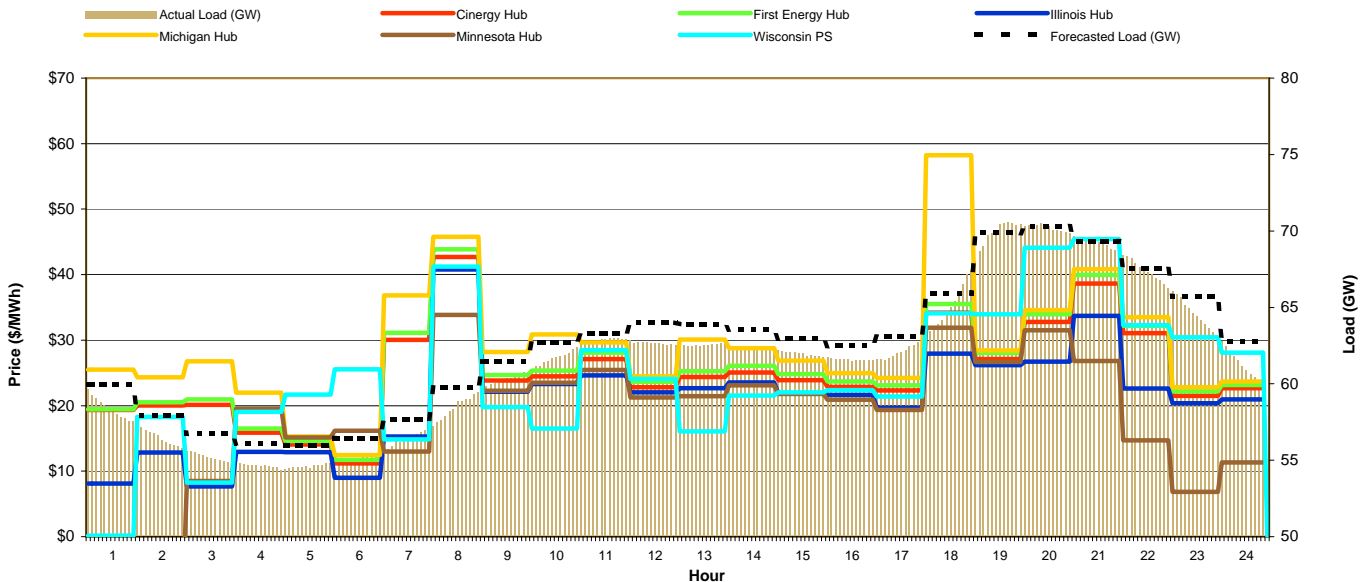




# MISO Daily Report

Wednesday March 3, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	29.95	28.67	28.34	28.02	29.48	34.25	45.23	46.03	46.40	46.00	44.95	43.99	40.07	37.46	35.47	31.91	31.66	34.18	44.03	48.20	43.99	41.23	34.07	31.82	37.73	40.60
First Energy Hub	30.36	28.98	28.58	28.29	29.59	34.44	44.69	46.77	47.16	46.75	45.68	44.70	40.72	38.15	36.62	32.80	32.50	34.96	44.75	48.98	44.70	41.91	34.79	32.50	38.31	41.37
Illinois Hub	25.97	24.82	24.37	23.84	24.94	29.34	38.63	44.65	45.04	44.64	43.62	42.69	38.89	36.43	34.97	31.32	31.04	33.39	42.73	46.78	42.69	40.02	32.17	30.05	35.54	39.44
Michigan Hub	30.84	29.45	29.05	28.79	30.07	35.03	45.43	47.56	47.89	47.47	46.42	45.40	41.35	38.74	37.18	33.30	33.00	35.50	45.44	49.74	45.39	42.55	35.33	33.01	38.91	42.02
Minnesota Hub	26.57	25.08	24.55	23.80	25.28	29.29	40.25	43.31	43.66	43.17	42.29	41.39	37.71	35.32	33.91	30.37	30.09	32.37	41.43	44.99	41.39	38.80	30.22	28.24	34.73	38.15
Wisconsin PS	25.73	25.19	23.85	23.14	24.64	27.92	39.02	48.38	49.14	47.05	45.69	45.17	41.14	38.10	36.26	33.14	33.19	38.12	50.83	54.90	47.50	44.00	32.87	30.72	37.74	42.84
Cleared Load (GW)	60.9	59.1	58.5	58.6	59.5	62.8	67.6	71.2	72.4	72.7	72.1	71.6	70.8	70.0	69.2	67.6	66.9	68.4	70.1	73.8	71.7	69.7	66.9	64		

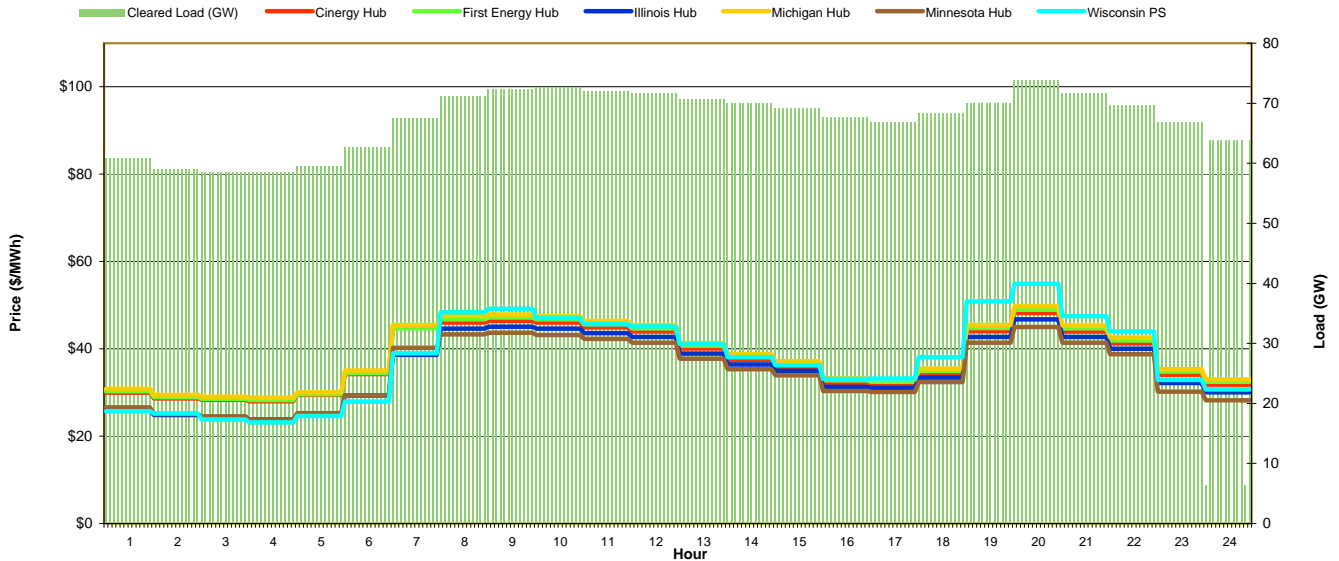

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	29.67	29.70	29.59	31.60	38.83	27.11	38.31	45.94	41.19	46.86	48.81	100.15	36.93	43.18	35.17	32.25	33.64	38.65	39.31	44.82	48.27	45.40	33.54	28.16	40.30	44.63
First Energy Hub	30.33	30.32	30.18	32.20	39.73	27.70	39.04	46.71	41.97	47.86	49.96	102.82	37.94	44.43	36.22	33.20	34.69	39.89	40.47	46.01	49.45	46.45	34.39	29.00	41.29	45.78
Illinois Hub	28.06	27.91	27.34	29.13	35.23	25.48	36.20	43.70	39.54	44.99	46.67	95.56	35.21	41.12	33.45	30.65	31.85	36.52	37.26	42.78	46.16	43.37	32.00	26.75	38.21	42.55
Michigan Hub	31.14	31.08	30.96	33.00	40.62	28.03	39.29	46.64	41.74	47.77	50.00	103.61	38.34	45.00	36.60	33.42	35.01	40.10	40.63	46.08	49.83	47.05	34.90	29.33	41.67	46.05
Minnesota Hub	28.52	28.08	27.13	28.72	34.51	24.88	34.36	43.48	40.56	46.04	47.15	95.87	35.39	40.69	33.31	30.48	31.54	35.53	36.56	43.19	47.13	44.15	32.38	27.32	38.21	42.72
Wisconsin PS	28.34	28.74	28.39	30.35	32.91	25.91	32.90	41.28	37.12	40.83	43.42	74.45	33.35	37.39	32.54	29.95	30.89	35.94	40.91	51.72	48.04	43.96	32.58	28.12	37.08	40.90
Forecasted Load (GW)	61.9	60.1	59.3	59.3	60.3	63.2	68.5	73.0	74.0	73.9	73.7	73.0	72.1	71.2	70.0	68.7	68.1	68.8	71.7	74.7	74.0	71.8	69.1	65.3		
Forecast Error %	-0.4%	-0.4%	-0.6%	-0.9%	-1.3%	-1.9%	-1.2%	-0.6%	-0.3%	-0.5%	-1.1%	-1.2%	-1.3%	-1.3%	-0.9%	-0.4%	-0.5%	-0.6%	-1.9%	-1.3%	-0.6%	0.0%	-0.5%	-0.8%		

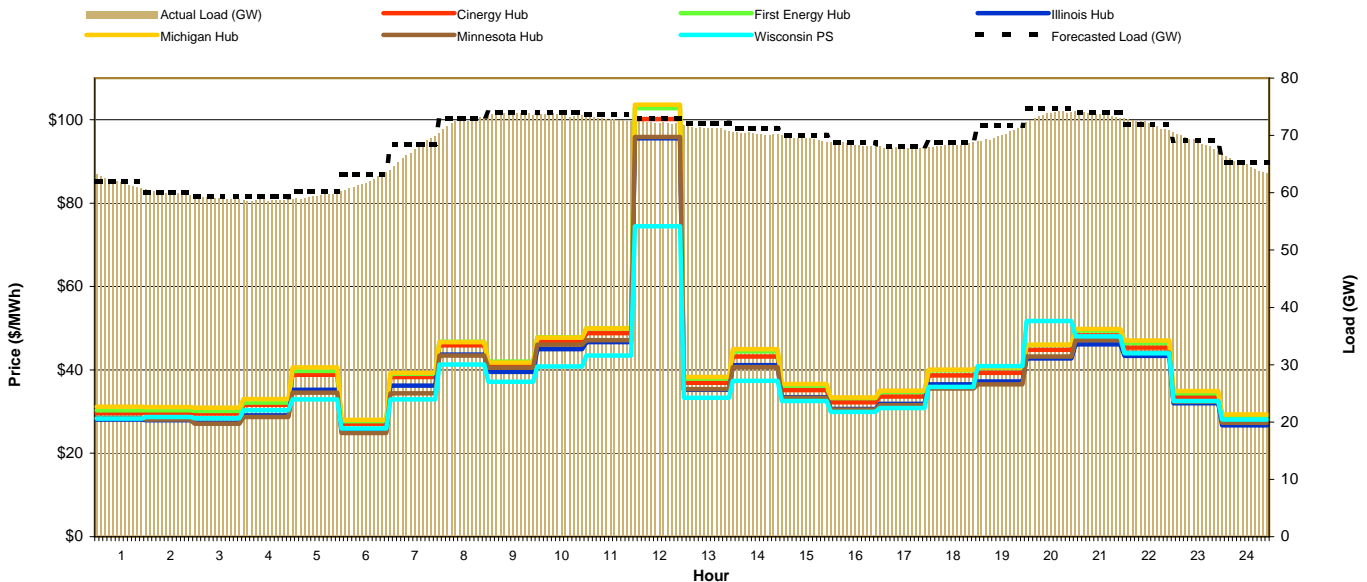




# MISO Daily Report

Thursday March 4, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
																									All	On Pk		
Cinergy Hub	30.88	29.66	30.20	30.00	31.32	36.91	50.21	52.31	51.28	50.62	51.50	48.11	43.78	41.72	37.29	31.60	31.08	32.64	43.78	53.16	47.83	42.53	34.28	31.05	40.16	43.34		
First Energy Hub	31.25	30.04	30.18	30.10	31.44	36.49	49.86	53.17	52.13	51.45	52.35	48.91	44.50	42.89	38.73	32.56	31.67	33.27	44.47	54.02	48.61	43.22	34.96	31.12	40.72	44.18		
Illinois Hub	27.21	26.51	25.32	25.70	26.82	29.40	42.81	50.78	49.78	49.14	50.00	46.71	42.50	40.96	36.99	31.12	30.26	31.82	42.57	51.59	46.40	41.28	32.42	26.84	37.71	42.15		
Michigan Hub	31.75	30.51	30.67	30.58	31.94	37.10	50.49	53.99	52.93	52.24	53.15	49.66	45.19	43.55	39.33	33.06	32.16	33.79	45.18	54.85	49.36	43.89	35.53	31.49	41.35	44.87		
Minnesota Hub	26.71	25.94	25.48	25.54	26.71	29.48	41.49	49.23	48.27	47.64	48.47	45.29	41.21	39.72	35.87	29.02	28.71	28.73	36.22	50.23	45.60	40.11	26.55	21.77	36.00	40.05		
Wisconsin PS	26.02	25.84	24.64	24.50	25.73	28.16	39.79	52.52	52.34	50.06	49.96	47.86	43.57	41.18	37.58	33.47	32.93	37.88	52.70	58.19	50.51	44.86	34.61	31.28	39.42	45.01		
Cleared Load (GW)	61.3	59.3	59.1	59.2	60.1	62.9	66.9	70.4	71.4	71.6	70.8	70.4	69.7	68.3	67.9	66.7	66.7	67.6	69.1	71.9	71.2	69.4	66.3	63				

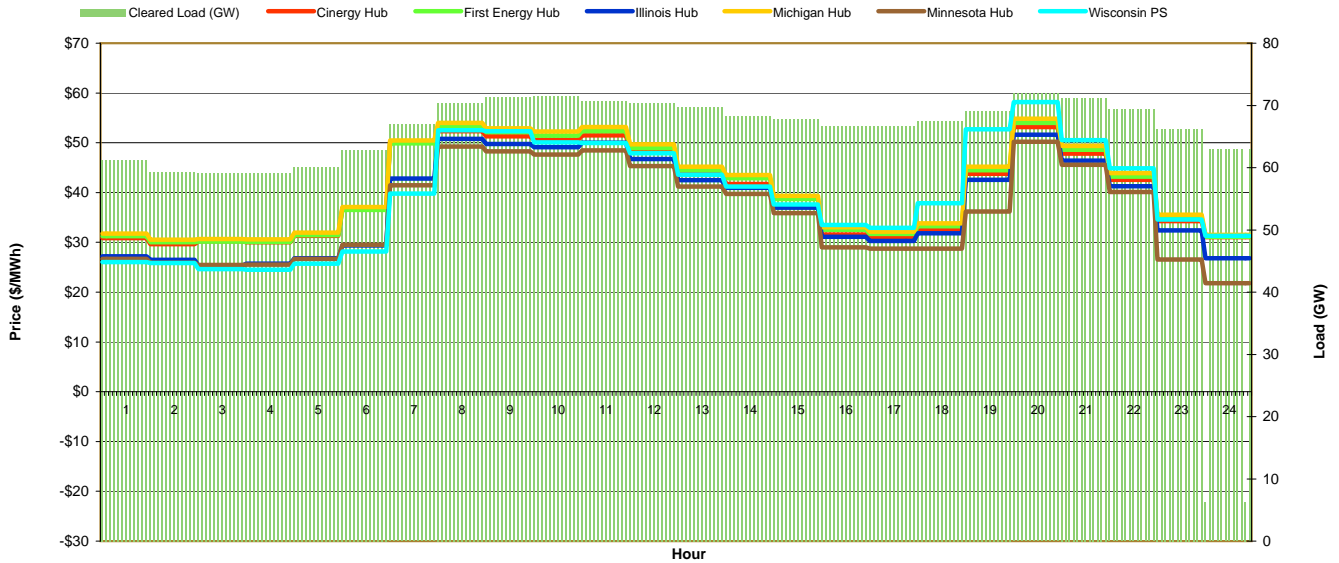

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
																									All	On Pk		
Cinergy Hub	33.87	30.21	42.19	31.97	27.35	26.00	52.04	43.15	51.53	27.72	27.04	25.16	27.33	25.68	25.33	24.32	24.77	26.83	32.07	29.73	27.90	27.68	37.02	50.33	32.38	30.20		
First Energy Hub	38.80	33.11	47.31	32.67	27.74	26.67	49.43	44.05	52.71	28.44	27.72	25.82	26.61	27.48	25.46	23.62	22.85	23.52	33.10	30.65	28.83	28.57	38.20	51.04	33.10	30.48		
Illinois Hub	25.65	25.23	23.64	23.91	21.91	21.95	41.85	40.62	48.95	26.49	25.81	24.00	7.99	-1.08	-5.52	-1.84	-23.69	-25.91	37.81	28.41	26.63	26.39	35.18	44.86	20.80	16.89		
Michigan Hub	33.75	30.62	44.43	32.58	28.05	26.96	49.18	43.55	52.24	28.38	27.81	26.13	27.21	28.29	26.19	24.14	23.40	24.10	33.84	31.10	29.33	29.16	39.17	51.21	32.95	30.88		
Minnesota Hub	30.59	27.79	26.71	28.19	24.29	21.40	43.10	40.23	49.99	27.29	26.08	23.91	24.01	24.45	22.53	20.81	20.18	20.40	23.35	27.32	25.65	24.94	32.81	8.47	26.85	27.12		
Wisconsin PS	29.78	28.44	26.42	29.82	25.53	23.22	29.84	39.04	43.88	28.22	29.33	25.35	26.22	26.44	25.43	23.53	23.17	25.70	36.11	41.26	33.88	31.62	34.73	30.08	29.88	30.87		
Forecasted Load (GW)	62.5	60.7	59.9	59.8	60.7	63.6	68.7	73.2	74.0	73.8	73.5	72.7	71.7	70.6	69.3	68.2	67.6	68.2	71.3	74.3	73.7	71.7	68.7	65.1				
Forecast Error %	-0.9%	-1.0%	-1.0%	-1.0%	-1.3%	-1.2%	0.0%	0.2%	-0.1%	-0.9%	-1.8%	-2.3%	-2.2%	-2.3%	-2.0%	-2.8%	-3.3%	-4.3%	-2.2%	-1.2%	-0.4%	-0.7%	-1.0%					

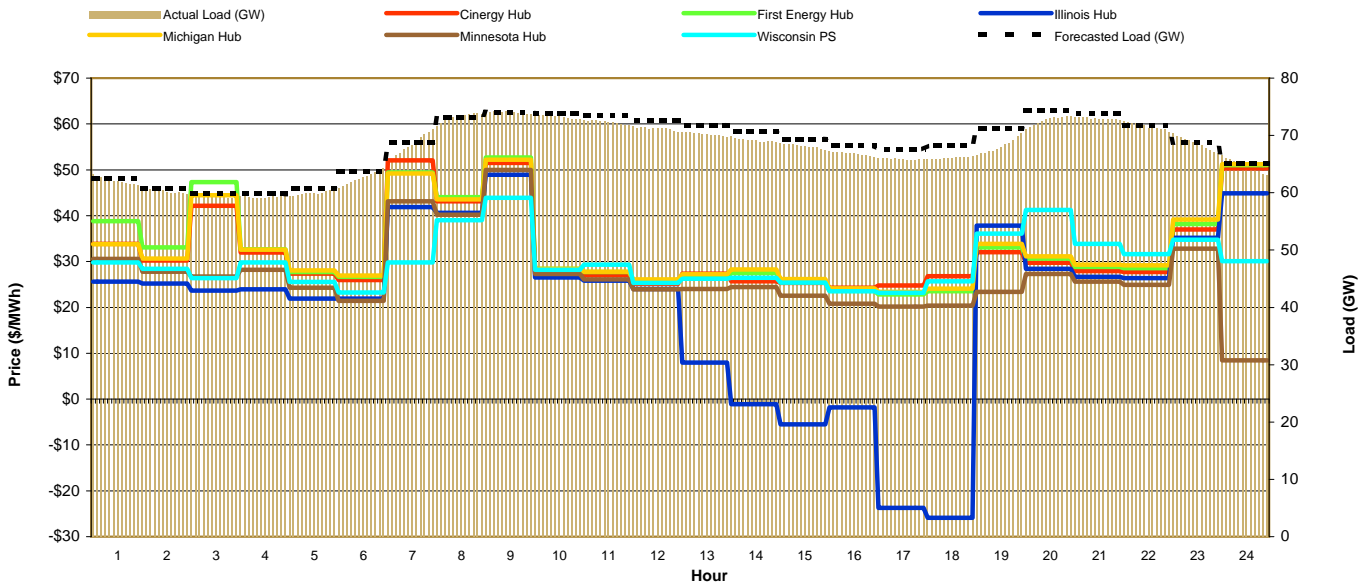




# MISO Daily Report

Friday March 5, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	29.62	27.64	27.72	27.75	28.51	31.04	40.17	43.83	44.52	43.94	42.40	40.34	35.50	31.16	28.88	26.87	26.28	27.20	33.47	41.44	37.11	32.05	27.27	27.30	33.42	35.14
First Energy Hub	30.89	28.26	28.39	28.44	29.17	31.95	39.86	44.54	45.15	44.54	42.95	40.91	36.04	31.70	29.24	27.13	26.55	27.63	34.02	42.11	37.71	32.53	27.64	27.78	33.96	35.65
Illinois Hub	25.30	23.00	22.59	22.65	23.49	25.04	33.07	42.54	42.25	41.49	39.64	37.93	34.12	30.09	26.36	24.83	24.45	26.41	32.48	40.21	36.01	30.94	24.97	25.09	30.62	33.42
Michigan Hub	29.96	28.64	28.84	28.88	29.62	32.42	40.69	45.23	45.84	45.23	43.60	41.54	36.59	32.19	29.70	27.55	26.96	28.06	34.54	42.76	38.29	33.03	28.06	28.08	34.43	36.20
Minnesota Hub	24.97	22.75	22.12	22.08	22.95	23.62	33.24	41.24	41.80	41.23	39.96	39.11	33.37	31.21	29.33	24.68	23.45	25.02	31.92	40.03	35.87	31.23	22.80	21.38	30.22	33.27
Wisconsin PS	24.47	23.27	21.79	21.59	22.47	23.17	34.03	46.89	47.78	45.53	44.11	44.45	38.04	36.58	34.41	30.00	30.06	33.88	43.84	50.45	42.98	37.84	28.69	26.84	34.72	39.72
Cleared Load (GW)	61.7	60.3	60.0	60.1	60.7	62.7	68.1	70.7	71.5	71.4	71.1	70.4	69.7	68.7	66.7	65.2	64.4	64.9	66.9	69.3	68.3	67.1	64.3	6.1		

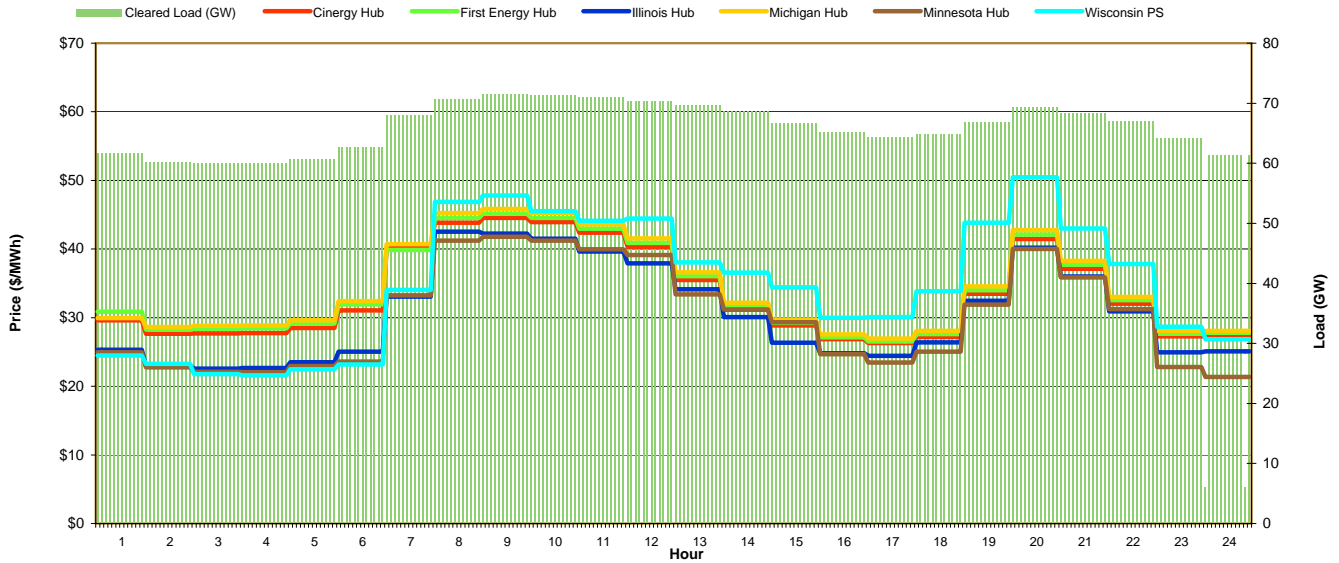

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	27.77	25.25	23.70	23.18	26.04	28.48	61.17	31.42	33.69	30.40	25.82	26.44	25.90	28.76	30.91	24.52	23.90	24.41	39.78	37.66	28.90	30.62	25.36	25.78	29.58	29.28
First Energy Hub	28.99	26.18	24.50	23.91	26.72	29.14	62.50	31.88	34.34	31.10	26.46	27.11	26.72	30.19	32.09	25.45	24.75	25.32	40.84	38.50	29.59	31.28	25.93	26.47	30.42	30.10
Illinois Hub	16.11	18.78	20.02	20.30	22.12	23.24	45.37	28.78	32.05	28.93	24.63	25.28	24.46	25.73	29.39	23.36	22.79	23.68	56.39	36.29	27.78	28.87	23.96	24.62	27.21	28.90
Michigan Hub	30.45	27.18	25.21	24.43	27.32	29.92	64.38	32.67	34.98	31.79	27.21	27.98	27.67	31.47	32.97	26.04	25.27	25.83	41.81	39.74	30.58	32.01	26.42	27.03	31.27	30.90
Minnesota Hub	14.81	17.76	18.48	18.51	18.57	18.37	34.50	27.74	31.73	28.34	24.08	24.67	26.80	42.96	28.56	22.60	21.70	21.80	22.69	34.83	26.39	22.46	19.19	23.50	24.63	26.66
Wisconsin PS	17.93	21.27	22.59	23.59	22.86	22.80	35.11	30.88	32.14	29.92	28.49	26.32	30.51	53.70	29.88	24.95	24.62	26.85	41.50	46.88	34.49	32.16	25.86	26.41	29.65	32.45
Forecasted Load (GW)	62.0	60.2	59.3	59.1	59.9	62.6	67.5	71.5	72.2	71.9	71.4	70.4	69.2	68.1	66.8	65.3	64.2	64.2	66.5	69.3	69.1	67.5	64.8	61.7		
Forecast Error %	-1.4%	-0.9%	-0.7%	-0.9%	-0.7%	-0.8%	0.1%	0.5%	0.6%	-0.1%	-0.4%	-0.9%	-0.8%	-0.9%	-0.6%	-0.6%	-0.5%	-0.8%	-2.2%	-0.9%	-0.5%	-0.1%	0.3%	0.1%		

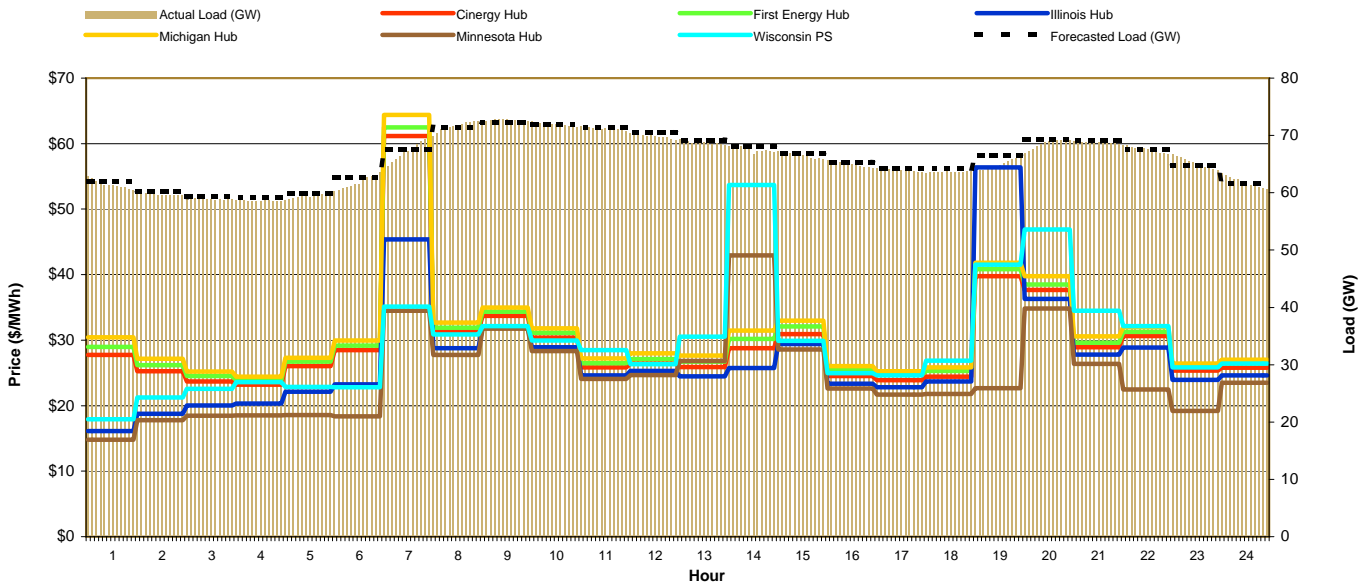




# MISO Daily Report

Saturday March 6, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$			
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk		
Cinergy Hub	30.25	28.99	28.68	26.85	26.73	27.45	29.13	29.65	34.37	35.77	34.48	30.76	27.20	25.15	24.40	23.85	23.75	24.81	28.77	34.98	30.33	28.84	25.61	24.91	28.57	28.92		
First Energy Hub	29.48	28.50	28.18	26.70	26.57	27.26	28.72	29.88	34.94	36.44	35.24	31.47	27.81	25.68	24.82	24.24	24.10	25.18	29.42	35.80	31.03	29.49	26.27	25.22	28.85	29.49		
Illinois Hub	20.00	19.48	19.77	19.70	19.61	20.00	21.00	25.76	32.08	33.89	33.07	29.63	26.13	24.15	22.97	22.36	22.06	23.06	27.68	33.69	29.15	27.71	24.35	21.72	24.96	27.36		
Michigan Hub	29.79	28.76	28.42	26.90	26.75	27.42	29.03	30.19	35.27	36.91	35.96	32.16	28.41	26.23	25.35	24.75	24.63	25.75	30.07	36.59	31.70	30.14	26.77	25.57	29.31	30.06		
Minnesota Hub	18.95	17.97	16.86	16.20	15.58	15.57	17.85	19.89	22.00	26.63	30.20	27.69	26.55	21.38	19.96	19.36	19.61	20.11	25.58	31.65	30.22	28.77	24.45	19.44	22.19	24.63		
Wisconsin PS	23.22	23.27	21.82	21.05	21.20	21.77	27.37	34.50	37.52	37.64	39.80	38.04	33.06	31.32	29.98	28.85	29.14	33.63	42.00	47.92	38.78	36.09	28.62	25.79	31.35	35.43		
Cleared Load (GW)	57.9	56.0	55.3	54.3	54.2	55.4	58.2	60.9	62.9	64.0	64.0	63.4	61.9	60.1	58.6	57.5	57.4	58.8	62.0	65.1	63.6	62.3	59.0	5.6				

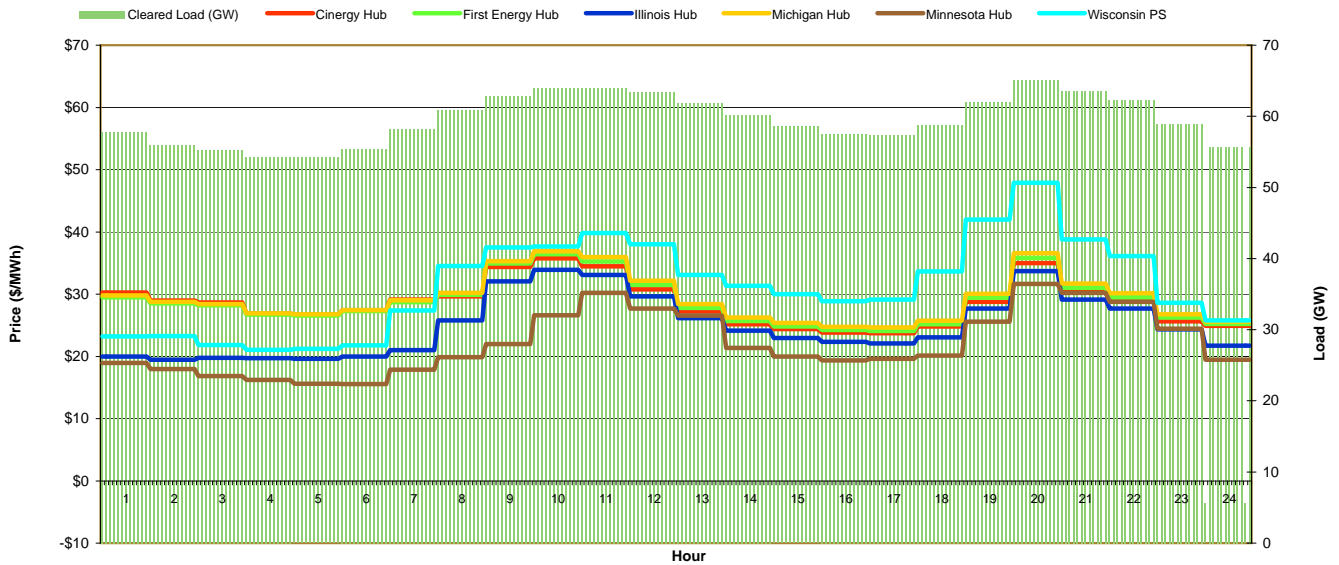

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$			
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk		
Cinergy Hub	23.79	51.86	34.36	30.41	34.39	47.50	66.61	27.91	28.86	29.24	39.52	25.74	25.24	22.94	21.32	20.94	21.45	21.69	44.51	35.64	27.29	26.73	24.42	21.85	31.43	27.72		
First Energy Hub	23.79	52.25	34.26	30.68	34.95	48.41	67.69	28.30	29.33	29.81	40.33	26.37	25.91	23.56	21.86	21.42	21.96	22.24	45.57	36.40	27.89	27.40	25.12	22.52	32.00	28.34		
Illinois Hub	20.48	46.61	29.22	23.96	27.14	58.34	58.70	26.11	27.51	27.92	37.88	24.71	24.20	22.01	20.52	20.51	23.27	22.72	43.28	34.09	25.62	25.45	23.36	20.76	29.77	26.82		
Michigan Hub	23.34	52.11	33.54	30.65	35.29	49.04	68.09	28.57	29.57	30.19	40.94	26.77	26.28	23.85	22.08	21.66	22.21	22.53	46.29	37.22	28.55	27.63	25.29	22.57	32.27	28.74		
Minnesota Hub	-3.16	15.40	-6.39	5.02	13.19	20.61	33.55	20.78	20.64	25.62	35.28	23.02	22.56	20.52	18.80	18.07	16.92	17.85	39.49	30.87	24.92	24.51	22.14	19.32	19.98	23.87		
Wisconsin PS	17.61	33.26	19.56	19.77	23.03	34.81	41.32	27.57	27.40	29.03	37.70	25.72	25.93	24.11	23.32	22.35	22.80	24.89	44.74	47.53	39.03	33.14	26.21	23.66	28.94	30.09		
Forecasted Load (GW)	59.0	57.1	56.0	55.3	55.2	55.4	57.5	60.3	62.3	63.1	62.7	61.8	60.5	59.3	58.3	57.5	57.3	58.2	61.3	64.3	64.1	62.9	60.7	58.2				
Forecast Error %	-0.3%	-0.2%	-0.2%	0.7%	1.4%	3.1%	3.2%	1.5%	0.6%	0.8%	1.2%	1.5%	1.4%	0.7%	-0.1%	-0.7%	-1.1%	-1.6%	-3.2%	-1.5%	-1.2%	-1.2%	-1.1%					

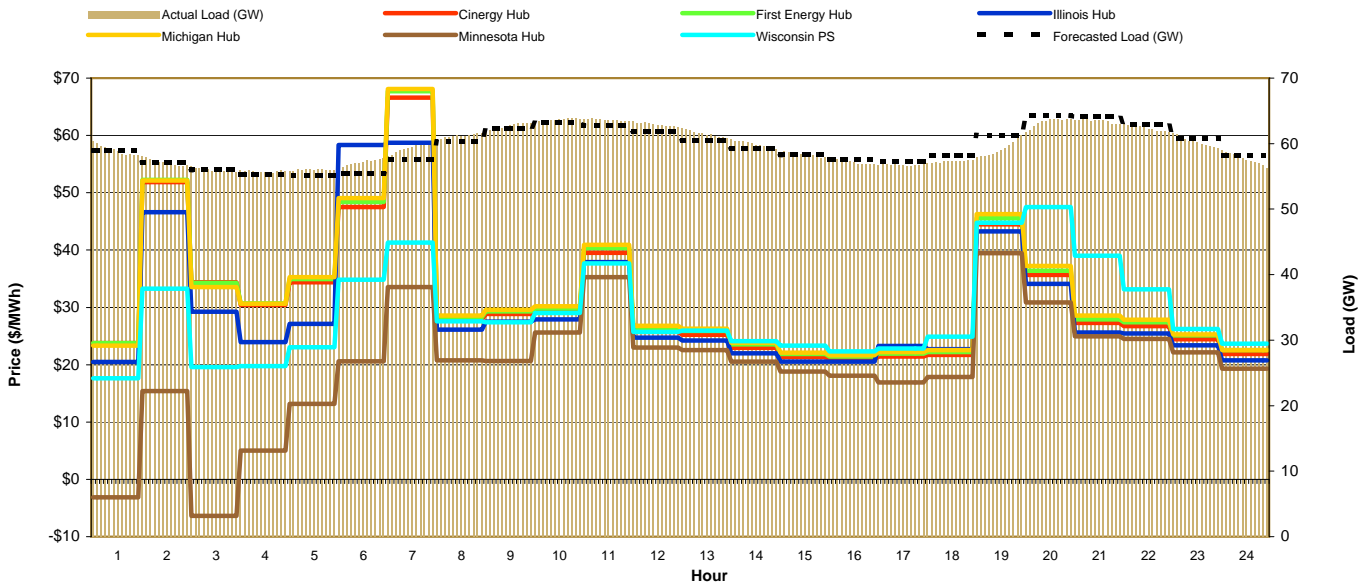




# MISO Daily Report

Sunday March 7, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$			
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk		
Cinergy Hub	25.48	25.36	25.13	24.35	24.21	24.55	25.87	24.69	25.11	25.82	25.51	25.15	24.36	23.90	23.07	22.36	22.87	24.25	30.92	39.71	32.94	28.81	24.04	22.51	25.87	26.47		
First Energy Hub	25.51	25.23	24.97	24.31	24.41	24.67	25.63	25.00	25.45	26.35	26.05	25.68	24.82	24.33	23.50	22.81	23.36	24.78	31.59	40.58	33.67	29.45	24.64	23.08	26.24	27.00		
Illinois Hub	20.00	18.91	18.43	18.75	19.36	19.66	20.00	22.20	22.54	24.57	24.42	24.03	22.95	22.42	21.71	21.26	21.89	23.28	29.68	38.13	31.63	27.67	22.85	21.33	23.24	25.08		
Michigan Hub	25.83	25.55	25.28	24.62	24.38	24.93	26.04	25.42	26.00	26.92	26.62	26.24	25.36	24.86	24.01	23.31	23.87	25.32	32.28	41.46	34.40	30.09	25.12	23.52	26.73	27.58		
Minnesota Hub	18.75	18.57	18.17	18.06	17.47	17.99	18.50	20.67	24.03	24.83	24.59	24.23	23.34	22.86	22.10	21.50	22.05	23.41	29.84	38.33	31.80	27.81	22.35	20.93	23.01	25.23		
Wisconsin PS	22.14	22.40	21.21	20.79	20.67	21.31	26.07	33.24	35.05	33.76	32.91	32.82	30.82	29.16	27.76	26.81	27.43	31.70	42.42	49.68	40.51	36.04	27.56	25.79	29.92	33.60		
Cleared Load (GW)	53.5	51.8	51.2	50.8	51.1	51.9	54.2	55.7	57.8	58.9	58.7	58.5	58.1	57.8	57.0	56.6	57.1	58.4	62.3	64.8	64.1	62.3	58.4	5.5				

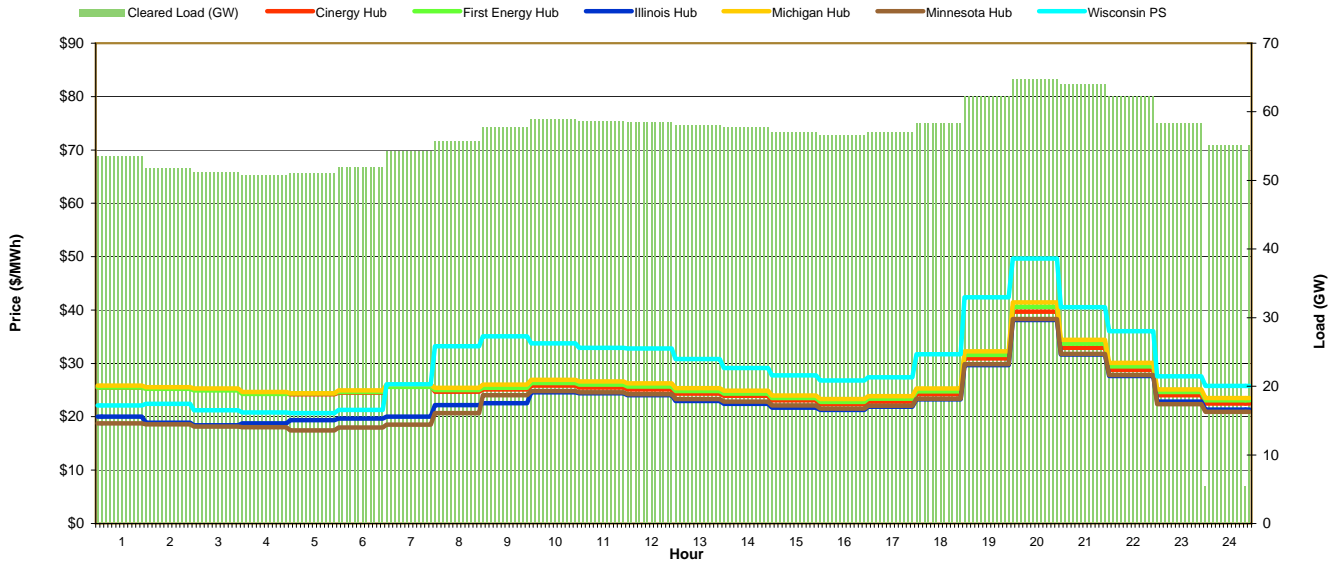

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$			
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk		
Cinergy Hub	24.57	22.90	22.55	22.31	28.33	24.68	34.13	24.49	25.71	26.19	25.26	24.25	25.16	23.72	22.73	21.61	22.33	24.44	81.24	64.06	27.84	45.41	25.25	21.76	29.62	31.86		
First Energy Hub	25.41	23.67	23.30	23.06	29.56	25.55	35.62	25.28	26.56	27.02	26.10	25.10	26.00	24.45	23.40	22.23	22.95	25.11	83.44	65.66	28.56	46.76	26.10	22.50	30.56	32.80		
Illinois Hub	23.02	21.56	21.16	19.51	18.61	21.10	21.70	22.10	23.08	24.68	23.95	23.09	24.02	22.72	21.84	20.78	21.39	23.47	77.68	61.34	26.72	43.42	24.17	20.81	27.16	30.28		
Michigan Hub	25.44	23.45	23.03	22.97	29.83	25.39	35.90	25.07	26.50	27.07	26.25	25.24	26.06	24.47	23.48	22.35	23.10	25.27	84.72	67.08	29.01	47.35	26.35	22.71	30.75	33.09		
Minnesota Hub	22.06	20.34	19.83	18.21	17.33	19.77	19.83	20.78	21.33	23.09	22.70	22.00	22.95	21.57	20.50	19.31	19.87	21.99	66.92	54.35	26.99	43.84	23.94	20.27	25.41	28.26		
Wisconsin PS	24.45	24.03	23.92	23.30	20.06	22.53	21.35	25.91	25.18	26.63	27.82	24.57	25.81	24.68	24.33	22.86	23.44	26.91	70.49	65.71	34.05	43.94	26.88	23.82	29.28	32.45		
Forecasted Load (GW)	56.2	54.5	53.4	52.8	52.8	53.0	54.4	56.1	57.0	58.0	58.4	58.1	57.6	56.7	56.2	55.7	55.9	57.3	60.4	64.1	63.7	62.1	59.7	57.1				
Forecast Error %	-2.3%	-2.1%	-2.0%	-1.4%	-1.6%	-0.4%	0.0%	-1.1%	0.2%	0.6%	0.2%	0.1%	0.2%	0.4%	-0.2%	0.1%	0.0%	-0.5%	-0.1%	0.2%	0.3%	0.0%	-0.6%					

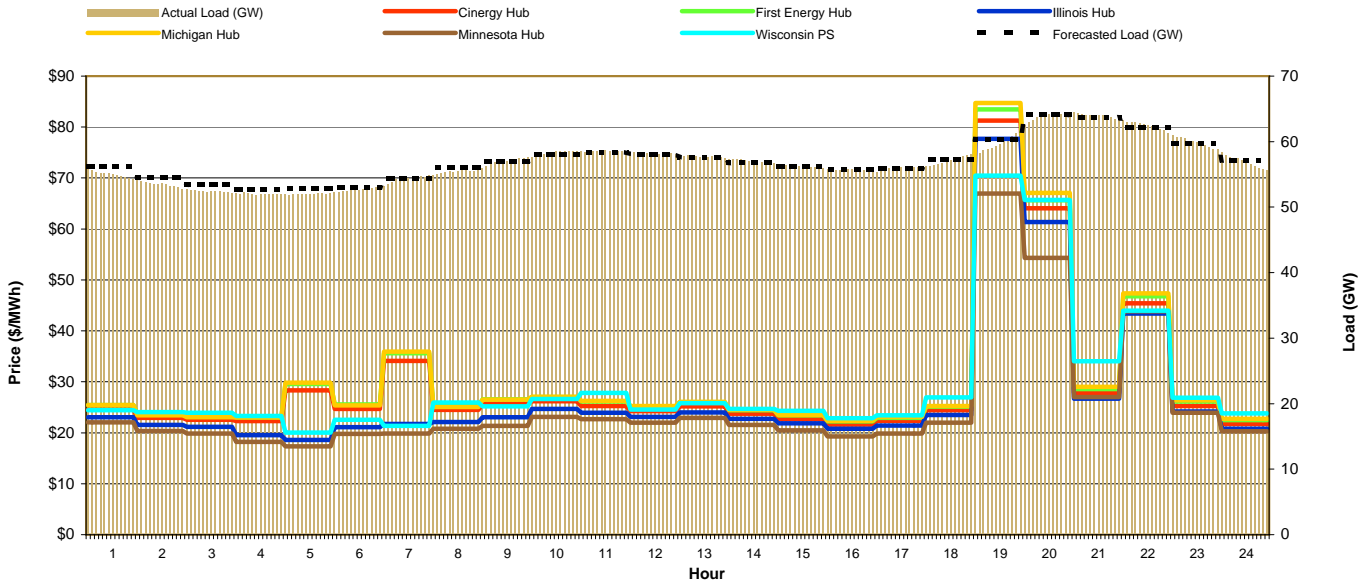




# MISO Daily Report

Monday March 8, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	22.06	21.55	21.49	21.83	22.64	25.39	39.89	35.22	38.48	39.71	36.75	35.72	33.90	30.93	27.61	26.03	25.63	26.52	32.08	41.35	35.29	28.32	24.00	23.19	29.82	32.35
First Energy Hub	21.96	21.28	21.22	21.83	22.87	25.38	38.13	36.00	39.33	40.58	37.56	36.50	34.64	31.61	28.21	26.60	26.19	27.10	32.79	42.26	36.07	28.94	24.59	23.75	30.22	33.06
Illinois Hub	16.47	15.07	15.10	16.87	19.17	20.33	25.98	33.82	36.95	38.13	35.29	34.30	32.35	29.53	26.28	24.88	24.51	25.35	30.80	39.70	33.89	27.19	22.59	21.70	26.93	30.97
Michigan Hub	22.39	21.69	21.63	22.25	23.31	25.87	39.05	36.78	40.19	41.47	38.38	37.30	35.40	32.29	28.82	27.18	26.76	27.69	33.50	43.18	36.85	29.57	25.06	24.17	30.87	33.78
Minnesota Hub	19.22	18.77	18.76	19.52	19.35	21.27	29.92	34.00	37.15	38.33	35.48	34.48	32.72	29.85	26.64	25.13	24.79	25.74	30.97	39.91	34.44	28.14	18.88	19.39	27.62	31.04
Wisconsin PS	21.65	21.47	20.45	20.67	22.23	24.01	36.23	41.52	44.22	43.21	40.53	39.99	37.33	34.01	30.87	29.25	29.23	33.15	43.20	50.77	42.10	35.72	29.30	26.76	33.24	37.78
Cleared Load (GW)	53.8	52.8	52.7	54.2	56.0	59.1	65.7	67.7	68.6	68.8	68.8	68.9	67.8	66.9	65.8	64.4	64.0	64.9	67.2	69.8	68.4	66.5	62.5	6.0		

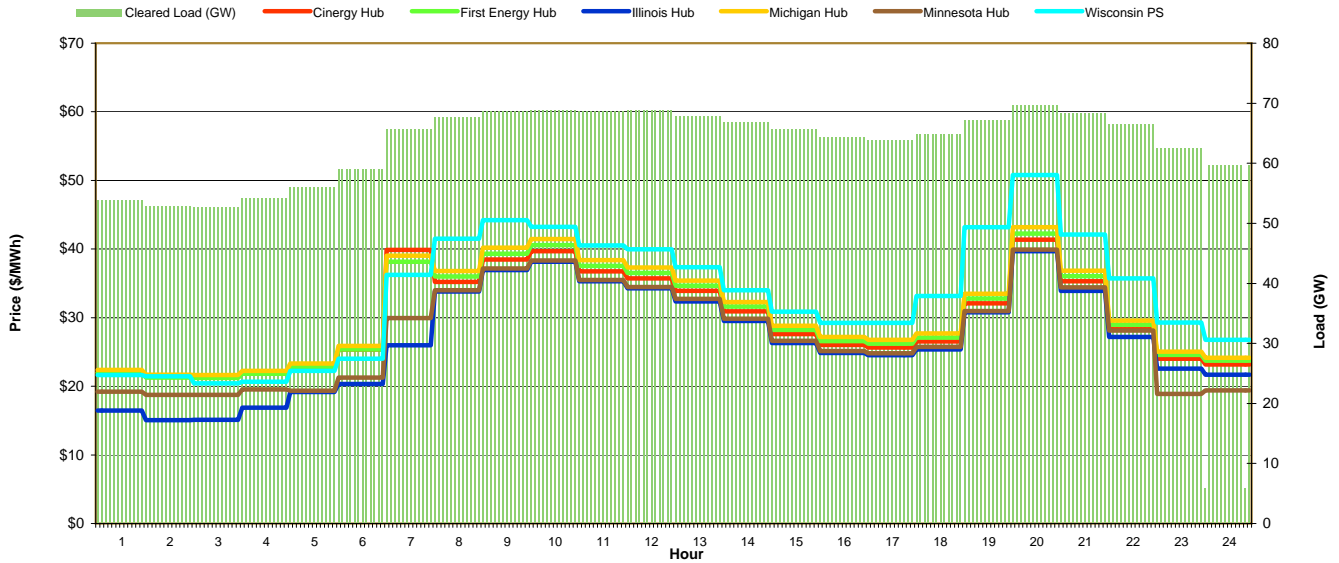

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	21.22	19.85	20.88	20.70	22.46	36.39	54.75	36.61	33.59	28.25	29.35	27.20	30.29	28.05	26.96	25.53	22.96	24.16	47.92	29.62	27.28	26.77	21.96	17.63	28.35	29.16
First Energy Hub	21.88	20.38	21.39	21.20	23.06	38.00	56.59	37.23	34.10	28.80	29.91	27.84	31.12	28.93	27.88	26.35	23.72	24.88	49.20	30.22	27.85	27.44	22.57	18.16	29.11	29.88
Illinois Hub	20.31	19.01	19.95	19.77	20.40	17.40	33.38	32.43	32.20	27.17	28.22	26.21	29.16	26.94	25.89	24.59	22.15	23.31	46.22	28.65	26.42	25.89	21.19	16.99	25.58	27.92
Michigan Hub	22.05	20.51	21.52	21.30	23.27	39.30	58.31	37.95	34.70	29.39	30.74	28.56	31.94	29.60	28.34	26.75	24.08	25.27	50.20	31.01	28.44	27.90	22.65	18.37	29.68	30.48
Minnesota Hub	19.74	18.26	18.96	18.81	19.07	16.09	31.07	31.72	32.69	27.46	28.38	26.15	28.96	26.55	25.49	24.05	21.40	22.50	44.76	28.73	26.81	25.74	20.21	16.22	24.99	27.60
Wisconsin PS	22.58	22.24	23.07	23.69	22.43	17.89	28.44	33.16	32.21	28.65	30.99	26.93	29.59	27.78	27.42	25.74	24.05	26.85	47.40	41.55	33.82	31.41	24.79	21.11	28.07	30.77
Forecasted Load (GW)	55.2	53.9	53.5	53.8	55.2	58.6	64.2	67.8	69.4	69.8	69.6	68.9	67.9	66.8	65.7	64.5	63.7	63.9	66.3	69.7	68.7	66.5	63.1	59.6		
Forecast Error %	-1.4%	-1.5%	-2.0%	-2.3%	-3.0%	-3.7%	-2.8%	-0.6%	-0.3%	-0.3%	0.1%	0.3%	0.8%	1.0%	1.0%	0.7%	0.4%	-0.3%	0.1%	1.1%	1.2%	1.1%	1.2%	1.1%	0.1%	

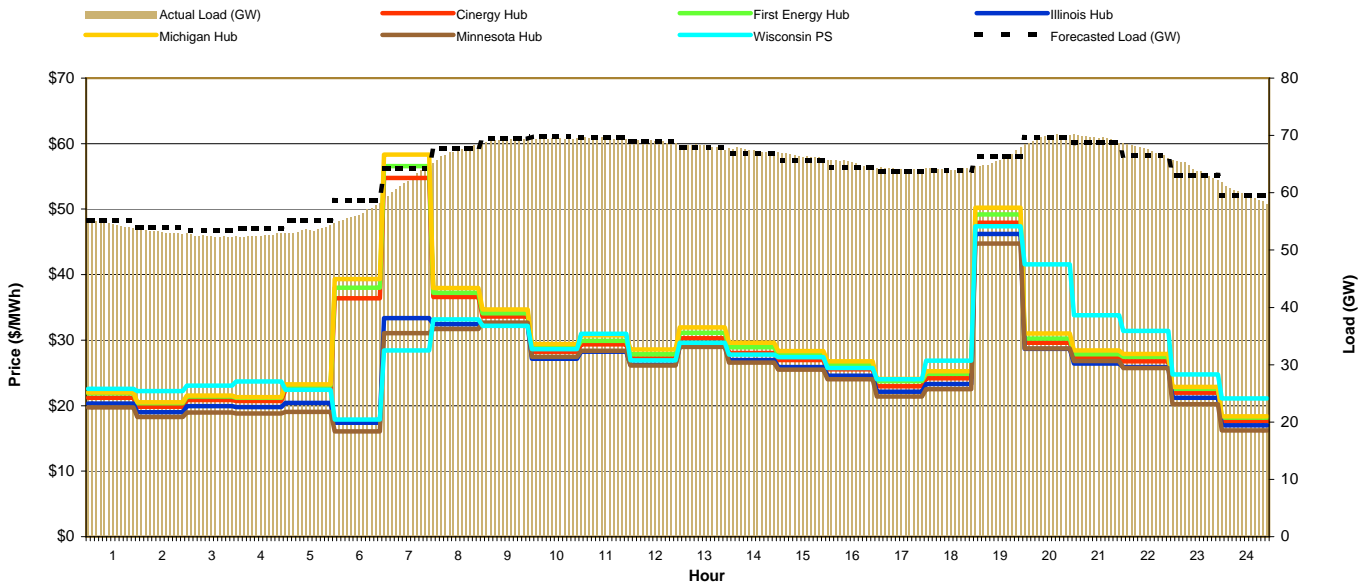






# MISO Daily Report

Tuesday March 9, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$			
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk		
Cinergy Hub	22.39	21.81	21.82	22.06	23.36	27.71	38.77	35.29	36.29	35.43	35.35	34.38	32.98	30.41	28.56	27.26	27.01	28.15	33.68	40.00	34.26	28.31	24.38	23.03	29.70	31.98		
First Energy Hub	22.85	22.22	22.23	22.46	23.70	28.49	39.69	36.30	37.34	36.46	36.37	35.37	33.94	31.29	29.37	28.02	27.76	28.93	34.64	41.16	35.25	29.13	24.97	23.60	30.48	32.89		
Illinois Hub	20.19	19.54	19.57	19.67	20.48	23.44	32.75	33.63	34.56	33.74	33.67	32.76	31.44	28.99	27.22	26.01	25.78	26.88	32.10	38.10	32.63	26.96	22.69	21.44	27.68	30.45		
Michigan Hub	23.17	22.50	22.49	22.72	23.98	27.72	39.49	37.11	38.18	37.28	37.19	36.16	34.69	31.99	30.03	28.66	28.40	29.60	35.43	42.08	36.05	29.78	25.33	23.93	31.00	33.62		
Minnesota Hub	18.51	16.69	16.34	16.38	17.24	18.20	18.98	28.21	33.20	32.92	31.63	28.25	26.73	24.32	22.36	21.41	21.58	21.91	29.80	37.18	31.85	26.67	19.53	18.78	24.11	27.35		
Wisconsin PS	20.97	20.65	19.57	19.48	20.53	22.03	35.24	43.64	42.94	40.27	40.11	40.79	38.54	35.50	33.51	32.06	31.93	36.39	44.93	49.80	41.34	35.67	27.09	25.10	33.25	38.41		
Cleared Load (GW)	56.0	54.4	54.0	54.4	56.0	59.7	66.7	68.1	68.4	68.8	68.9	68.7	68.5	67.7	66.0	65.0	64.8	65.9	68.4	70.6	68.3	65.9	61.6	5.8				

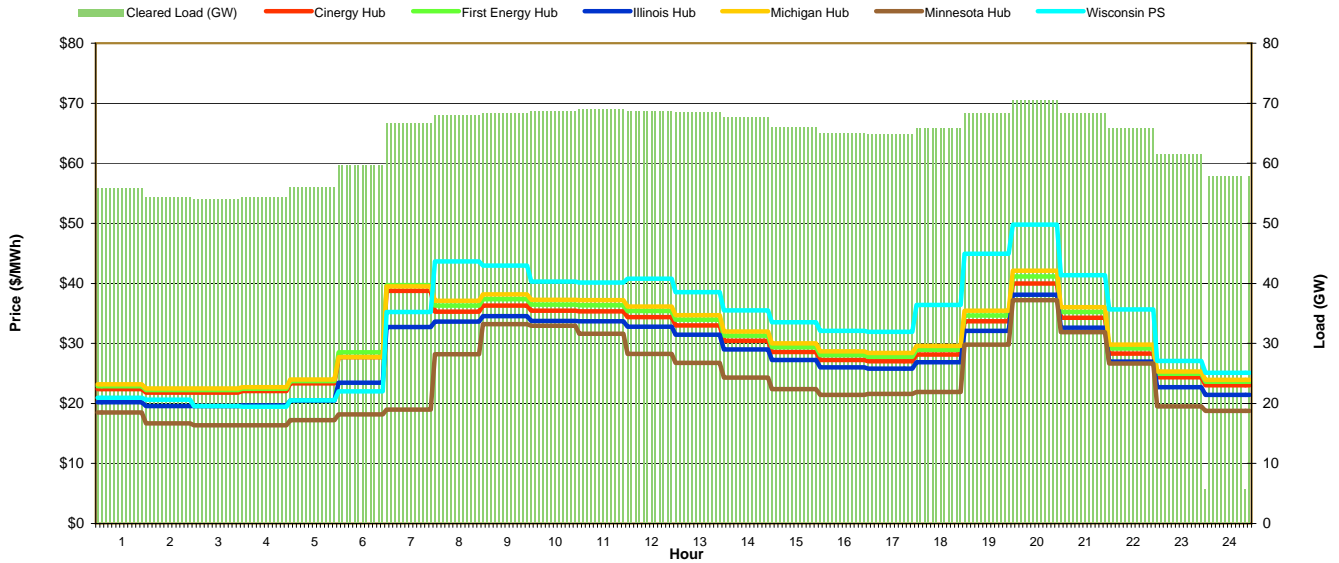

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$			
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk		
Cinergy Hub	20.87	20.51	20.85	20.84	24.14	22.91	49.81	37.01	31.94	35.00	35.68	33.05	30.19	35.14	48.04	27.65	29.90	29.08	74.51	54.96	36.08	49.84	24.53	18.90	33.81	38.29		
First Energy Hub	21.48	21.12	21.49	21.50	25.06	23.61	51.46	37.88	32.73	35.99	36.71	34.00	31.08	36.18	49.38	28.46	30.87	29.94	76.88	56.59	37.15	51.41	25.43	19.61	34.83	39.42		
Illinois Hub	20.06	19.65	19.37	19.02	18.62	19.21	36.83	35.15	30.57	33.71	34.36	31.99	29.23	33.96	46.35	26.64	28.71	27.95	71.38	52.85	34.66	47.79	23.50	18.17	31.66	36.80		
Michigan Hub	21.65	21.23	21.56	21.59	25.42	23.92	52.44	38.30	33.17	36.74	37.57	34.84	31.73	36.91	50.47	29.06	31.38	30.31	77.89	57.52	37.83	52.38	25.79	19.82	35.40	40.12		
Minnesota Hub	19.27	18.54	18.23	18.00	17.76	18.05	34.18	34.11	30.33	33.60	33.94	32.78	30.02	34.62	47.06	27.09	29.21	28.63	74.13	55.47	36.19	48.10	23.24	17.78	31.68	37.41		
Wisconsin PS	22.44	22.64	22.58	23.09	20.92	21.26	32.30	35.56	31.12	33.52	35.31	31.17	29.76	32.84	41.93	27.25	28.80	30.40	66.25	59.31	39.74	46.80	26.38	21.95	32.64	37.26		
Forecasted Load (GW)	57.4	55.8	54.9	54.7	55.7	58.8	63.7	67.9	69.1	69.3	69.2	68.7	68.0	67.1	65.9	64.7	64.1	64.7	67.1	69.2	68.6	66.4	63.4	59.2				
Forecast Error %	-1.5%	-1.7%	-1.8%	-2.0%	-2.7%	-3.1%	-1.6%	-1.0%	-0.6%	-0.9%	-0.6%	-0.5%	-0.4%	0.1%	0.8%	1.1%	1.5%	1.1%	0.1%	0.9%	0.8%	0.8%	-0.3%	-0.3%				

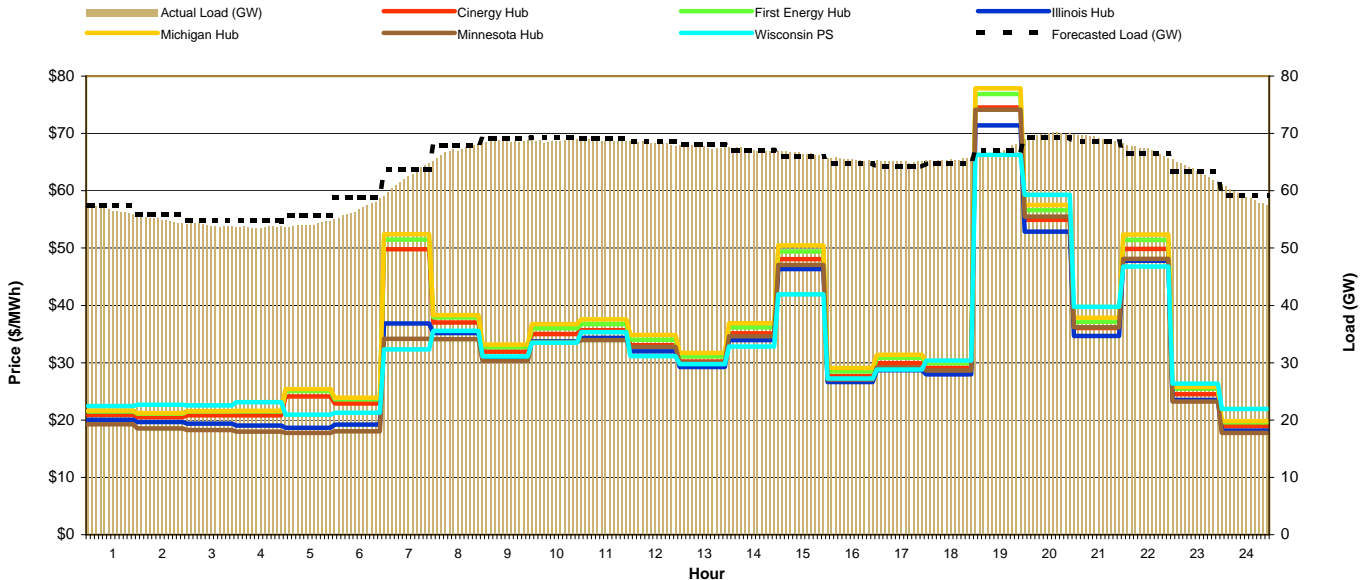




# MISO Daily Report

Wednesday March 10, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	21.80	20.95	21.02	20.91	22.12	26.00	38.57	35.80	39.95	40.10	40.11	37.89	38.66	35.70	32.41	29.33	28.78	31.09	41.65	47.93	40.97	34.37	25.93	22.82	32.29	36.29
First Energy Hub	22.51	21.71	21.77	21.67	22.89	26.07	37.79	36.84	41.11	41.26	41.27	38.99	39.78	36.74	33.35	30.18	29.62	32.00	42.85	49.32	42.16	35.37	26.55	23.32	33.13	37.34
Illinois Hub	18.88	17.44	17.52	17.46	18.95	20.93	24.36	34.09	38.04	38.19	38.20	36.08	35.74	33.97	29.72	27.68	27.41	29.61	39.66	45.64	39.02	32.74	23.76	20.36	29.39	34.35
Michigan Hub	21.91	20.78	20.84	20.74	22.18	26.54	38.78	37.67	42.04	42.20	42.20	39.87	40.68	37.57	34.10	30.86	30.29	32.72	43.82	50.43	43.11	36.17	27.04	23.61	33.59	38.17
Minnesota Hub	19.60	18.99	18.72	18.73	18.78	19.60	21.66	33.27	37.12	37.26	37.27	35.21	35.93	33.17	30.12	27.25	26.74	28.89	38.70	44.54	38.07	31.94	24.06	20.08	28.99	33.72
Wisconsin PS	21.26	21.09	20.05	19.88	20.88	22.82	35.48	41.91	45.24	43.49	42.80	41.49	40.74	37.27	34.34	31.60	31.45	36.44	49.72	55.20	45.91	39.78	28.69	26.25	34.74	40.38
Cleared Load (GW)	54.9	53.0	52.6	52.7	54.4	58.3	65.5	66.1	66.6	66.7	66.4	66.7	65.9	65.2	64.6	63.8	63.6	64.3	65.3	67.7	66.3	63.9	60.1	5.7		

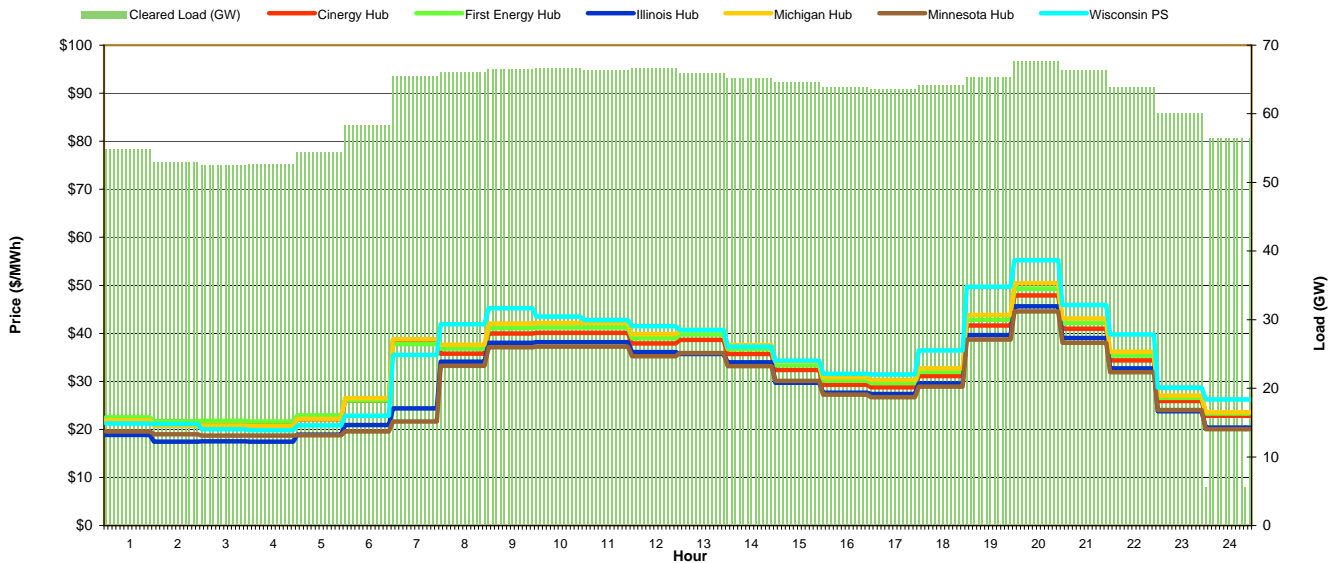

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	19.66	20.12	19.19	19.97	20.11	30.26	35.02	92.94	25.14	29.37	27.69	25.64	27.95	30.92	29.98	29.65	26.81	26.04	26.79	36.67	38.33	31.78	25.84	18.94	29.78	33.22
First Energy Hub	20.36	20.78	19.82	20.69	21.19	32.02	35.41	94.28	25.80	30.25	28.58	26.54	28.96	32.02	31.08	30.73	27.74	26.92	27.56	37.62	39.33	32.64	26.69	19.66	30.69	34.17
Illinois Hub	18.55	17.98	16.43	16.07	8.33	8.43	16.97	89.08	24.31	28.20	26.47	24.49	26.67	29.49	28.57	28.26	25.62	24.95	25.77	35.40	36.88	30.50	24.73	18.12	26.26	31.84
Michigan Hub	20.56	20.99	20.09	21.02	21.98	33.54	36.91	96.15	26.21	30.81	29.13	26.95	29.50	32.73	31.73	31.29	28.20	27.32	27.89	37.83	39.71	33.14	27.07	19.89	31.28	34.73
Minnesota Hub	18.05	17.39	16.03	15.74	8.26	8.17	16.10	86.09	23.89	27.71	26.05	24.32	26.31	29.09	28.20	27.75	24.97	24.38	25.60	36.20	38.02	31.29	24.65	17.68	25.91	31.53
Wisconsin PS	21.32	21.35	20.45	20.83	12.96	11.46	17.79	73.17	26.39	29.34	29.74	25.74	27.85	29.66	29.34	28.36	26.36	27.84	32.84	46.24	40.96	34.41	27.14	21.81	28.47	33.46
Forecasted Load (GW)	56.9	55.1	54.0	53.7	54.5	57.0	61.6	65.7	67.4	68.0	68.2	67.8	67.3	66.6	65.7	64.5	63.8	64.1	65.2	67.4	66.7	64.4	60.6	57.0		
Forecast Error %	-2.2%	-2.8%	-3.7%	-4.0%	-4.6%	-4.3%	-2.2%	-1.1%	-1.0%	-1.0%	-1.2%	-0.5%	-0.5%	-0.2%	0.5%	1.1%	1.0%	0.5%	0.7%	1.8%	2.1%	2.1%	2.6%	1.7%		

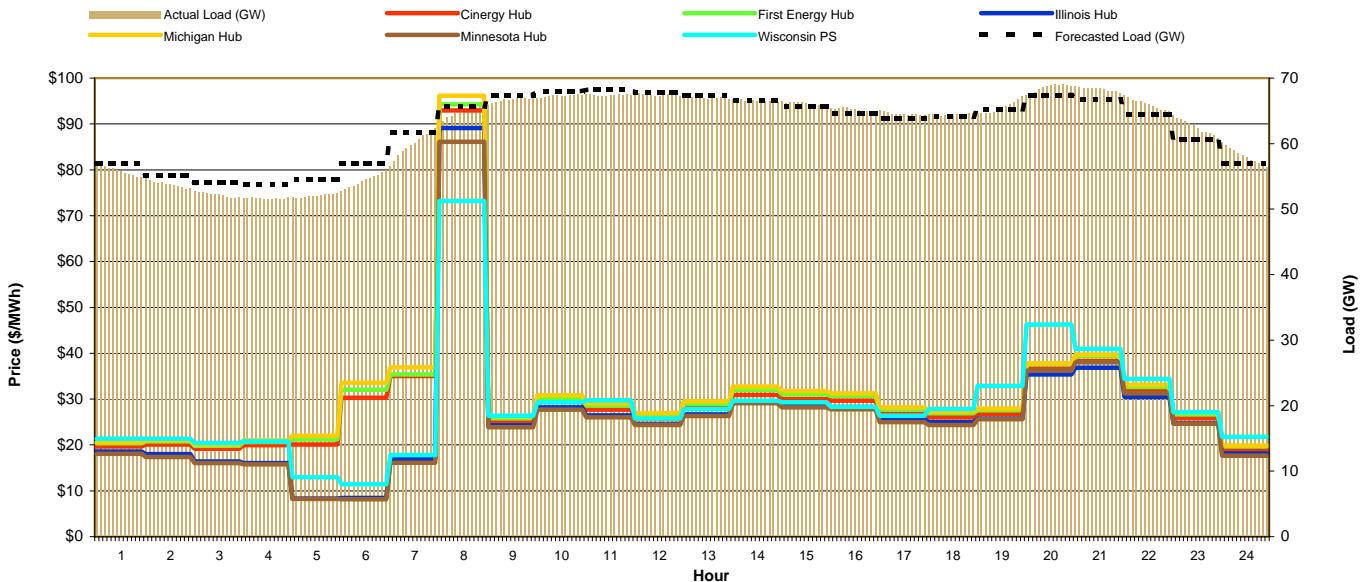




# MISO Daily Report

Thursday March 11, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	20.53	19.44	19.30	19.30	19.88	24.20	35.43	33.46	30.73	30.64	30.05	31.83	31.14	30.62	28.93	27.04	26.68	27.17	33.71	37.71	33.46	28.41	23.69	21.81	27.72	30.33
First Energy Hub	20.83	19.70	19.54	19.57	20.30	24.89	35.79	34.42	31.63	31.53	30.91	32.75	32.04	31.50	29.73	27.78	27.42	27.92	34.67	38.80	34.42	29.22	24.08	22.04	28.40	31.18
Illinois Hub	17.33	16.35	16.06	16.22	17.83	20.34	23.81	31.88	29.26	29.18	28.63	28.47	27.29	25.49	24.17	23.60	23.81	25.93	32.13	35.91	31.88	27.07	20.57	18.35	24.65	27.83
Michigan Hub	21.21	20.07	19.90	19.93	20.68	25.50	36.99	35.20	32.35	32.24	31.60	33.49	32.76	32.21	30.42	28.43	28.06	28.57	35.44	39.67	35.20	29.87	24.52	22.44	29.03	31.88
Minnesota Hub	18.87	17.86	17.71	17.73	18.20	19.09	19.07	27.60	28.55	26.68	23.63	26.09	27.53	26.56	22.28	20.00	20.13	20.73	24.73	32.90	27.86	22.21	18.78	19.66	22.69	24.77
Wisconsin PS	20.52	20.22	19.15	19.00	19.79	20.71	31.03	41.95	39.13	38.03	38.05	39.30	36.52	35.21	34.37	32.57	32.58	35.76	47.43	49.32	42.44	37.72	28.62	25.04	32.68	38.06
Cleared Load (GW)	52.4	50.7	50.2	50.3	52.2	56.6	64.4	66.4	66.4	66.7	67.1	67.1	67.5	66.4	65.8	64.8	64.1	65.0	67.7	69.3	67.2	64.4	59.7	5.6		

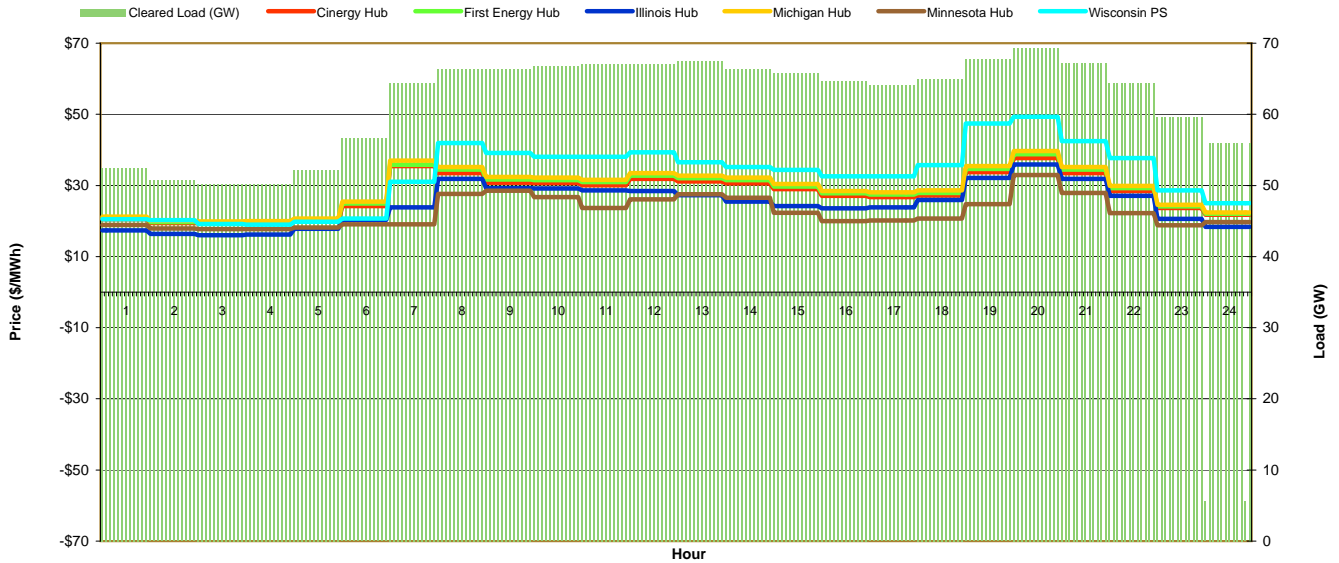

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	16.87	16.68	16.79	-3.56	-31.26	12.14	20.73	24.24	35.71	25.79	26.22	25.99	27.77	29.29	27.99	26.69	25.54	24.14	43.31	38.63	30.25	30.35	22.22	20.10	22.19	29.01
First Energy Hub	17.49	17.38	17.50	-3.30	-31.28	12.86	21.55	24.78	36.84	26.68	27.22	26.97	28.72	30.23	28.87	27.54	26.38	24.85	44.49	39.49	31.00	31.06	22.80	20.71	22.95	29.87
Illinois Hub	15.84	12.16	11.43	-12.99	-54.10	3.35	10.33	23.12	34.07	24.64	25.18	25.07	26.54	27.95	26.74	25.49	24.37	23.08	41.52	37.29	29.12	29.09	21.28	19.29	18.74	27.78
Michigan Hub	17.66	17.75	17.94	-2.75	-30.10	13.43	22.51	25.18	37.36	27.14	27.75	27.62	29.37	30.92	29.36	27.87	26.66	25.17	45.15	40.10	31.51	31.62	23.08	20.85	23.46	30.37
Minnesota Hub	15.72	12.37	11.49	-12.53	-52.99	3.08	9.13	21.85	32.42	23.13	23.54	23.24	25.45	27.00	25.97	24.62	23.30	22.10	40.36	36.95	29.03	28.81	20.75	18.56	18.06	26.78
Wisconsin PS	19.39	17.08	16.68	-0.09	-31.88	9.47	13.69	26.74	33.05	26.44	28.31	25.52	27.39	28.20	27.72	26.12	25.37	26.49	43.83	47.39	35.36	33.36	24.64	22.52	23.03	30.37
Forecasted Load (GW)	55.0	52.6	51.5	51.3	51.7	54.5	60.0	64.2	65.9	66.6	66.8	66.5	65.9	65.3	64.3	63.2	62.8	63.1	64.5	67.0	66.4	63.5	59.8	56.0		
Forecast Error %	-1.1%	-0.4%	-0.6%	-0.9%	-0.6%	-1.3%	-1.2%	0.0%	0.7%	1.1%	1.3%	1.8%	2.0%	2.3%	3.0%	2.9%	2.6%	2.8%	2.4%	2.4%	3.8%	4.0%	3.4%			

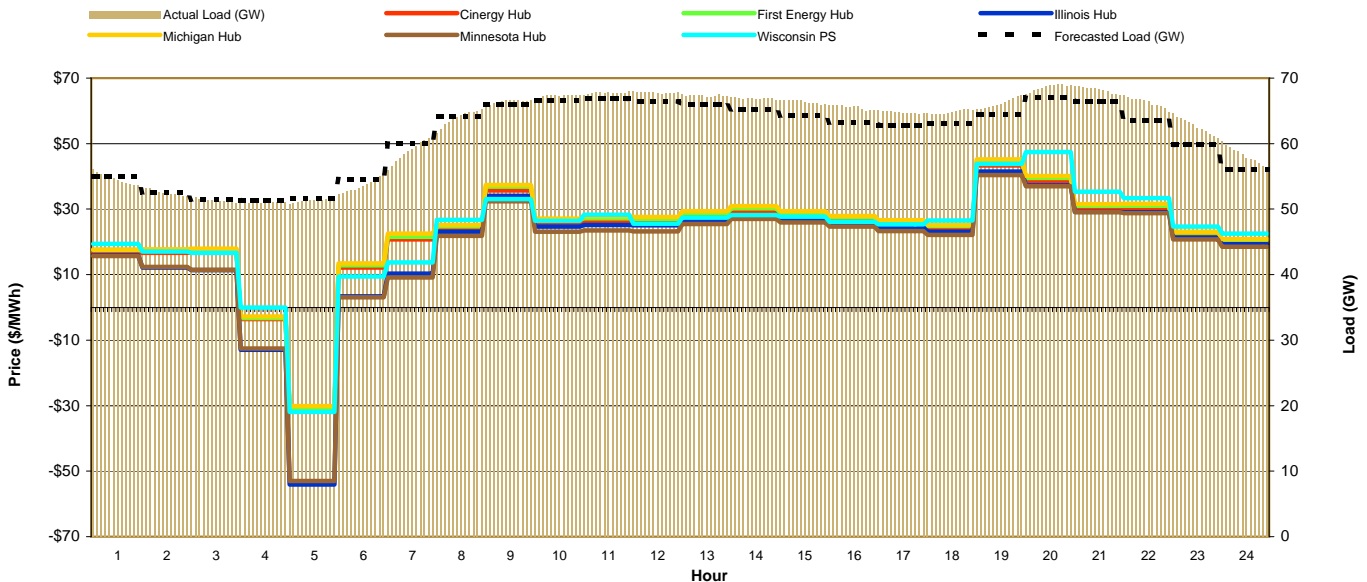




# MISO Daily Report

Friday March 12, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
																									All	On Pk		
Cinergy Hub	18.58	18.43	19.52	19.44	20.51	24.13	31.65	36.35	39.25	39.24	40.00	38.17	40.00	36.37	33.79	29.02	28.23	28.41	36.35	39.77	34.96	28.01	23.22	21.06	30.19	34.45		
First Energy Hub	18.62	18.54	20.03	19.85	20.96	24.71	32.54	37.40	40.39	40.37	41.16	39.28	41.08	37.41	34.76	29.86	29.05	29.24	37.40	40.92	35.97	28.83	23.72	21.34	30.98	35.43		
Illinois Hub	14.75	14.50	14.73	14.10	14.58	19.77	30.03	34.62	37.38	37.37	38.09	36.35	37.53	34.51	32.05	27.61	26.37	27.06	34.62	37.87	33.29	26.68	21.07	17.78	27.61	32.65		
Michigan Hub	18.97	18.69	19.77	19.65	21.18	25.30	33.27	38.25	41.30	41.29	42.09	40.17	42.01	38.25	35.54	30.54	29.70	29.90	38.25	41.84	36.79	29.48	24.17	21.73	31.59	36.22		
Minnesota Hub	16.50	15.80	14.94	14.92	14.85	16.93	26.57	33.78	36.47	36.46	37.17	35.47	37.10	33.94	31.49	27.00	26.23	26.58	34.00	36.96	32.68	26.33	19.49	18.76	27.10	31.95		
Wisconsin PS	19.15	19.20	17.37	17.04	16.95	20.22	32.78	42.23	44.68	42.84	42.66	41.59	41.35	37.63	34.99	31.23	31.00	34.39	46.03	49.65	41.82	35.46	27.93	24.79	33.04	39.09		
Cleared Load (GW)	49.1	46.6	46.2	46.1	47.3	52.3	60.4	63.2	64.1	64.6	64.7	64.8	63.8	62.8	62.7	61.7	61.2	61.5	63.0	64.7	62.9	61.0	56.5	5.2				

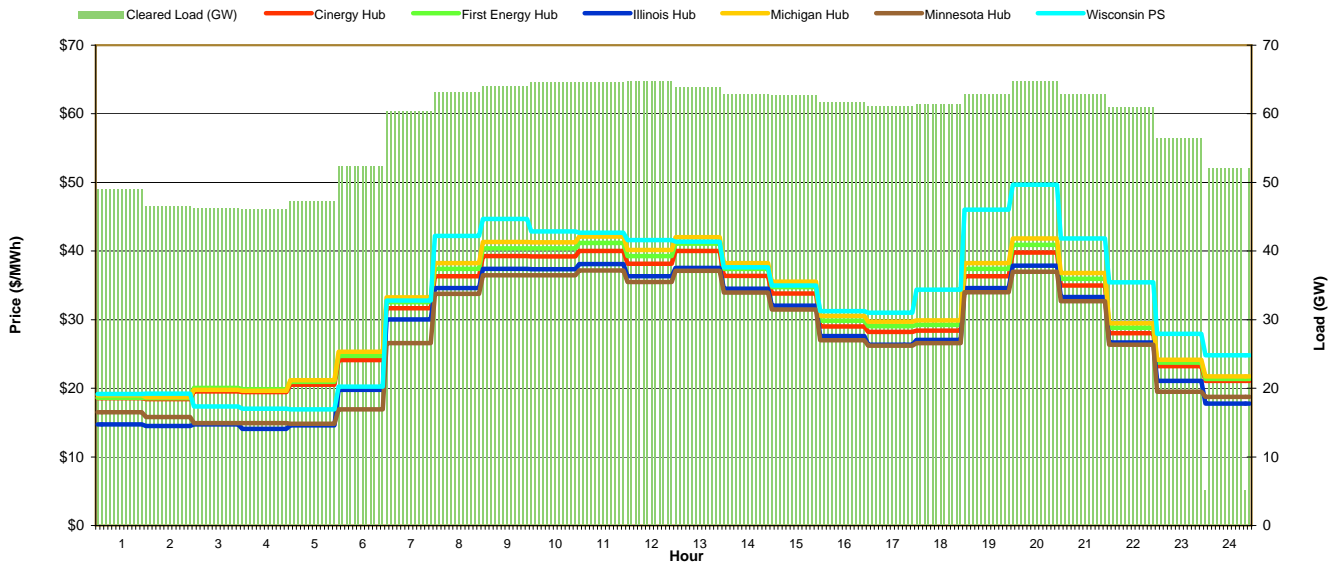

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
																									All	On Pk		
Cinergy Hub	22.62	22.29	21.44	21.30	22.08	22.76	46.67	36.74	45.72	36.26	40.75	46.76	45.00	52.28	59.89	28.66	30.14	28.77	28.80	28.70	27.37	26.32	27.67	42.72	33.82	36.86		
First Energy Hub	23.42	22.92	21.98	21.79	22.58	23.21	47.36	37.25	46.41	36.90	41.57	47.66	45.92	53.53	61.42	29.29	30.85	29.46	29.50	29.34	27.92	26.92	28.45	44.00	34.57	37.65		
Illinois Hub	19.98	21.41	20.29	20.42	20.55	20.58	41.99	34.12	43.77	34.83	39.21	45.23	43.61	50.55	57.91	27.59	28.89	27.55	27.58	27.51	26.17	25.08	26.37	40.18	32.14	35.37		
Michigan Hub	23.58	23.00	22.08	21.86	22.74	23.46	48.27	37.95	47.03	37.33	42.09	48.30	46.62	54.20	62.18	29.55	31.19	29.79	29.77	29.61	28.15	27.25	28.67	44.61	34.98	38.12		
Minnesota Hub	18.64	19.71	18.67	18.78	18.76	18.64	37.96	32.21	43.03	34.94	39.33	44.90	42.96	49.23	56.07	26.63	27.56	26.32	26.37	26.67	25.21	23.84	24.65	37.84	30.79	34.37		
Wisconsin PS	21.72	23.40	22.77	23.61	22.09	21.71	35.47	33.82	39.54	33.56	38.17	39.54	38.87	43.23	48.39	27.15	28.21	29.38	33.56	39.94	32.73	29.97	27.68	36.20	32.11	35.23		
Forecasted Load (GW)	54.5	52.6	51.5	51.2	52.0	54.0	59.1	63.9	66.0	66.7	66.9	66.5	65.5	64.5	63.5	62.3	61.3	60.9	61.4	64.1	63.6	61.3	58.6	54.6				
Forecast Error %	-0.1%	-0.2%	-0.3%	-0.8%	-1.4%	-0.7%	-0.1%	-0.5%	-0.1%	0.3%	0.7%	1.6%	2.5%	3.0%	3.4%	3.9%	4.5%	5.1%	5.8%	3.7%	3.0%	4.1%	4.0%	4.7%				

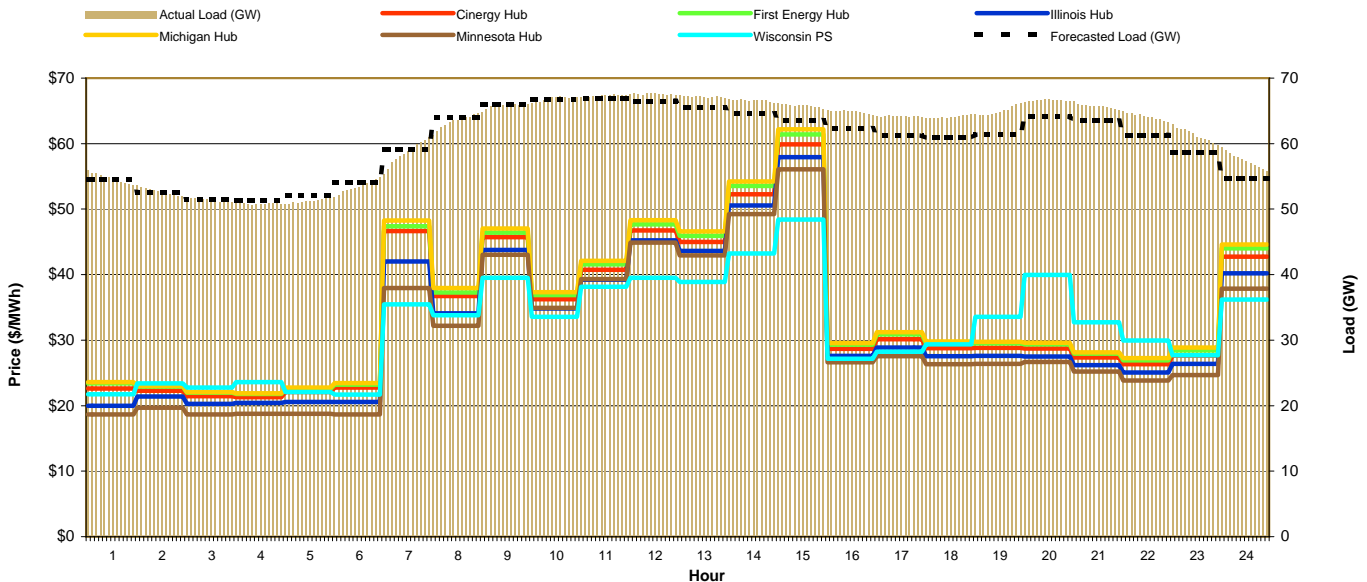




# MISO Daily Report

Saturday March 13, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$			
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk		
Cinergy Hub	21.44	21.57	21.21	20.67	20.56	21.22	24.28	25.27	29.06	29.56	29.90	29.16	28.40	27.69	26.70	25.80	25.72	27.17	30.99	39.23	29.50	27.52	25.26	22.25	26.26	28.56		
First Energy Hub	21.92	22.08	21.66	21.07	21.04	21.71	25.03	25.99	29.95	30.33	30.69	29.92	29.14	28.41	27.40	26.48	26.38	27.88	31.79	40.25	30.26	28.24	25.87	22.78	26.93	29.31		
Illinois Hub	19.93	19.17	18.40	18.00	17.68	17.82	20.18	22.68	24.25	28.43	28.76	28.05	27.31	26.63	25.68	24.82	24.73	26.13	29.81	37.73	28.37	26.47	24.05	21.18	24.43	27.12		
Michigan Hub	22.11	22.32	21.90	21.29	21.29	22.02	25.89	26.82	30.99	31.20	31.57	30.78	29.97	29.23	28.19	27.24	27.14	28.68	32.70	41.40	31.13	29.05	26.08	22.97	27.58	30.14		
Minnesota Hub	19.26	18.67	18.15	17.37	16.94	17.00	18.98	22.92	22.75	29.08	29.59	29.02	27.51	27.00	26.07	25.50	25.43	26.75	27.63	37.66	28.19	26.49	23.06	20.32	24.22	27.17		
Wisconsin PS	20.98	20.88	19.34	18.72	18.63	19.26	24.83	33.62	35.73	36.72	36.22	35.87	33.91	32.11	30.53	29.37	29.56	33.87	43.75	49.74	38.47	35.45	28.31	25.56	30.48	35.20		
Cleared Load (GW)	48.9	47.5	46.8	46.2	47.2	49.3	52.0	54.0	55.8	56.5	56.9	56.8	56.5	55.5	55.0	54.9	55.6	56.9	60.3	62.2	61.1	58.5	55.2	5.2				

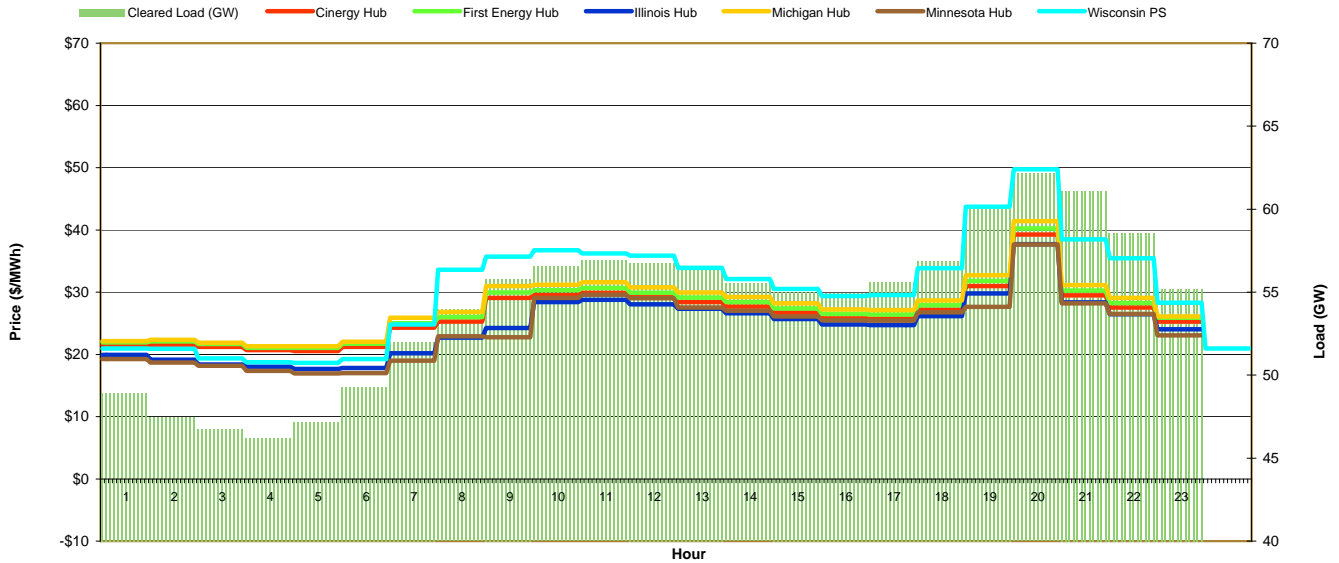

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$			
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk		
Cinergy Hub	23.46	22.70	39.18	21.63	21.00	22.16	24.72	23.57	30.21	31.03	43.97	37.48	34.95	32.99	28.32	28.09	28.12	28.35	28.63	26.38	34.73	39.40	44.88	27.03	30.12	32.57		
First Energy Hub	24.37	23.65	42.08	23.26	21.56	22.76	25.29	24.25	30.96	31.82	45.24	38.32	36.20	33.99	29.29	29.22	29.21	29.40	29.68	27.23	35.51	40.31	46.67	27.95	31.18	33.58		
Illinois Hub	20.68	20.51	2.47	-0.72	18.18	18.78	23.08	20.99	28.72	29.92	42.24	35.00	31.19	35.54	26.90	24.14	25.40	26.81	27.31	25.33	31.98	35.71	38.32	23.63	25.50	30.34		
Michigan Hub	24.70	23.88	44.39	24.66	21.76	23.00	25.41	24.32	30.99	31.95	45.51	38.05	36.35	34.02	29.22	29.30	29.31	29.40	29.60	27.30	35.28	40.06	47.48	28.10	31.42	33.63		
Minnesota Hub	19.81	19.15	0.99	-1.28	16.84	17.43	21.44	18.98	21.79	27.00	37.97	21.92	27.76	26.17	25.18	22.14	23.41	24.96	18.88	21.58	15.86	16.77	35.74	19.04	20.81	24.13		
Wisconsin PS	22.06	22.42	5.42	6.32	20.29	20.30	23.09	24.16	27.78	29.05	38.86	28.30	28.97	29.42	26.79	23.81	25.04	28.23	35.56	38.68	31.85	31.54	34.84	23.80	26.11	30.18		
Forecasted Load (GW)	58.9	57.2	56.1	55.8	56.3	57.9	59.6	61.0	62.6	63.1	63.8	63.2	62.4	61.8	61.8	62.5	63.7	65.7	68.2	67.8	65.0	62.4	59.2					
Forecast Error %	#####	-12.4%	-13.1%	-13.9%	-14.5%	-15.4%	-15.0%	-14.0%	-13.6%	-10.9%	-10.2%	-9.7%	-7.9%	-7.4%	-7.0%	-6.8%	-7.1%	-7.7%	-8.2%	-7.3%	-7.3%	-7.5%	-19.1%	#DIV/0!				

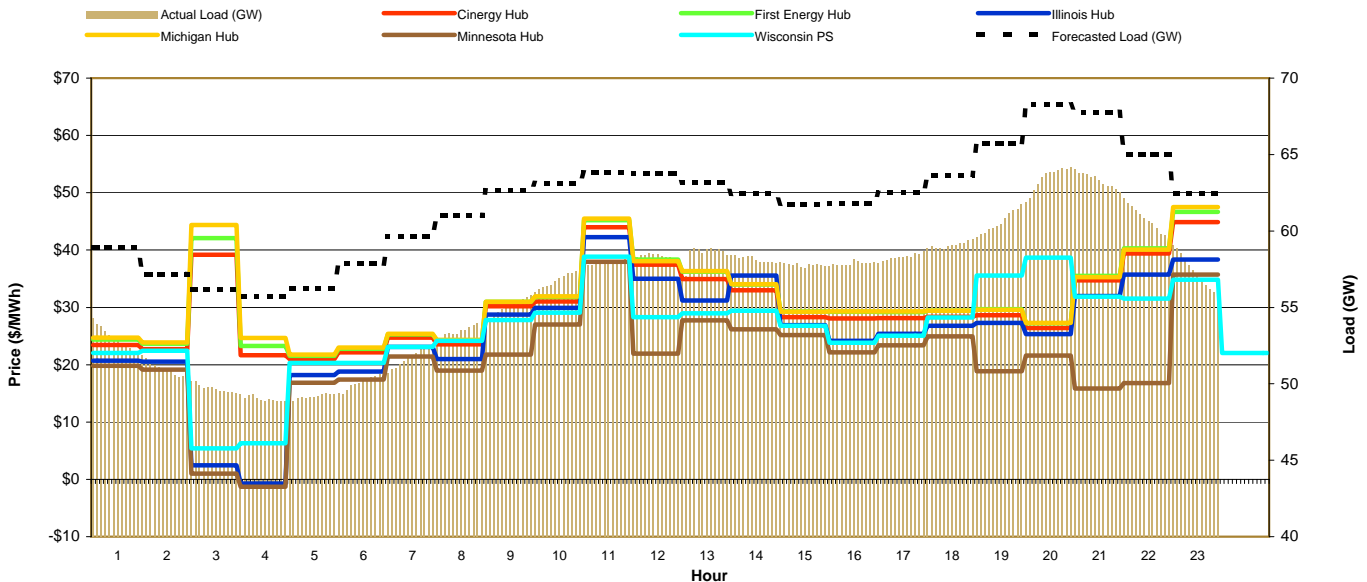




# MISO Daily Report

Sunday March 14, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	22.44	21.79	22.14	22.05	21.91	23.01	25.30	24.65	25.45	26.81	27.34	27.20	26.81	26.78	25.59	25.48	26.49	28.55	34.15	47.48	35.04	28.65	24.48	22.08	26.74	28.81
First Energy Hub	22.91	22.17	23.05	23.02	22.92	24.28	26.41	25.47	26.12	27.51	28.05	27.90	27.51	27.48	26.25	26.14	27.18	29.29	35.04	48.71	35.96	29.40	25.07	22.60	27.52	29.57
Illinois Hub	18.55	18.40	18.00	17.84	17.88	18.33	20.30	21.61	24.49	25.79	26.29	26.16	25.79	25.76	24.61	24.50	25.48	27.46	32.85	45.67	33.71	27.56	23.30	21.01	24.64	27.56
Michigan Hub	23.20	22.41	22.03	22.01	21.70	22.62	25.85	25.38	26.87	28.30	28.85	28.71	28.30	28.27	27.01	26.89	27.96	30.13	36.04	50.11	36.99	30.24	25.27	22.79	27.83	30.33
Minnesota Hub	18.48	18.49	17.95	17.44	17.33	18.00	20.91	22.45	24.33	25.62	26.12	25.99	25.62	25.59	24.45	24.35	25.34	27.28	32.64	45.37	33.49	27.38	22.02	19.86	24.44	27.38
Wisconsin PS	20.47	20.98	19.53	18.94	19.33	20.13	26.37	33.71	35.68	34.77	34.44	34.50	32.81	31.48	29.76	29.13	30.08	34.80	44.97	55.39	42.27	36.22	27.79	25.44	30.79	35.49
Cleared Load (GW)	48.9	47.5	46.8	46.2	47.2	49.3	52.0	54.0	55.8	56.5	56.9	56.8	56.5	55.5	55.0	54.9	55.6	56.9	60.3	62.2	61.1	58.5	55.2	5.2		

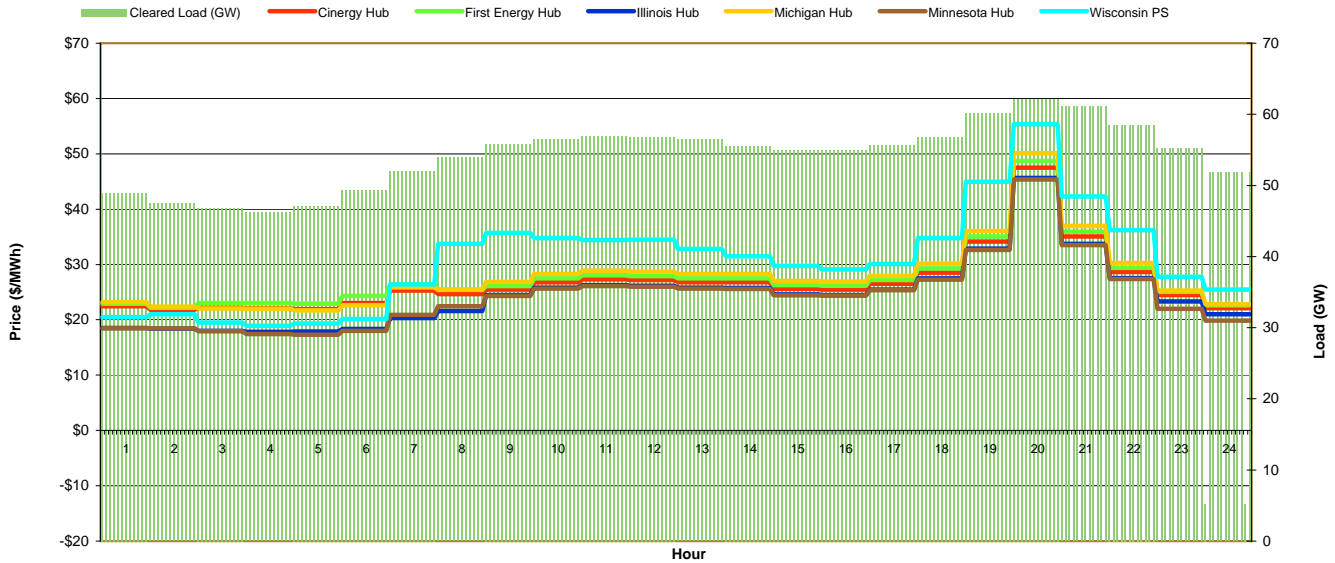

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	27.60	24.45	36.97	24.96	28.13	28.70	29.14	27.91	26.01	27.24	44.34	27.70	33.97	27.65	28.49	26.99	26.71	24.69	28.18	35.96	26.60	30.31	24.74	25.54	28.87	29.22
First Energy Hub	28.84	25.32	38.88	26.13	29.72	30.08	30.25	29.03	26.82	28.14	45.83	28.64	35.20	28.69	29.64	28.07	27.72	25.52	29.13	36.81	27.31	31.13	25.17	25.38	29.89	30.18
Illinois Hub	17.34	18.08	14.20	12.29	7.59	13.35	19.65	16.44	21.59	23.36	44.50	24.59	28.97	25.04	23.57	21.89	23.80	21.60	24.54	34.14	25.71	29.22	22.85	20.52	22.28	25.74
Michigan Hub	29.66	26.01	40.60	27.15	31.11	31.13	30.87	29.69	27.01	28.39	46.40	28.96	35.56	28.70	29.82	28.38	27.94	25.80	29.54	36.65	27.35	31.28	25.12	24.42	30.31	30.41
Minnesota Hub	15.74	16.47	12.56	11.42	6.82	12.32	18.28	14.95	20.04	21.17	29.74	22.04	26.04	23.34	21.90	20.27	19.75	19.90	19.30	25.28	23.58	21.26	13.87	-15.14	17.54	21.40
Wisconsin PS	18.50	20.13	15.47	16.58	10.84	15.16	19.79	20.00	23.10	24.32	35.53	24.09	27.33	25.10	24.07	22.22	22.85	24.34	29.15	41.97	31.96	34.62	22.86	12.12	23.42	27.09
Forecasted Load (GW)	58.9	57.2	56.1	55.8	56.3	57.9	59.6	61.0	62.6	63.1	63.8	63.2	62.4	61.8	61.8	62.5	63.7	65.7	68.2	67.8	65.0	62.4	59.2			
Forecast Error %	-11.6%	-12.4%	-13.1%	-13.9%	-14.5%	-15.4%	-15.0%	-14.0%	-13.6%	-10.9%	-10.2%	-9.7%	-7.9%	-7.4%	-7.0%	-6.8%	-7.1%	-7.7%	-8.2%	-7.3%	-7.3%	-7.5%	-9.4%	-9.3%		

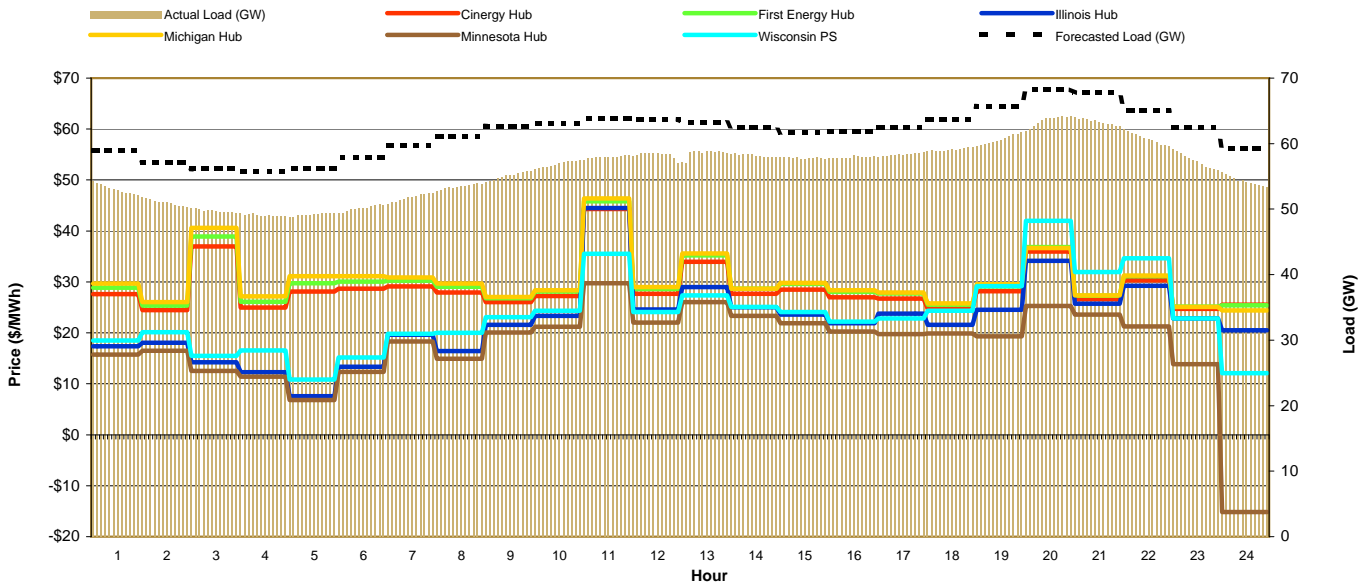




# MISO Daily Report

Monday March 15, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	22.04	21.60	21.69	22.03	23.40	41.00	48.73	39.61	40.03	40.90	39.00	38.50	38.33	36.29	34.90	33.00	30.43	30.62	39.14	49.78	38.16	29.35	26.41	23.67	33.69	36.53
First Energy Hub	22.65	22.21	22.32	22.68	24.12	40.61	48.59	40.63	41.06	42.00	39.89	39.24	39.08	36.91	35.47	33.59	31.01	31.23	39.94	50.84	39.00	29.94	26.86	24.15	34.33	37.29
Illinois Hub	19.16	18.70	18.27	18.60	19.00	21.56	39.06	38.09	38.49	39.70	38.12	38.13	37.98	36.27	34.76	32.76	30.11	30.24	38.48	48.87	37.28	28.97	25.91	22.49	31.29	35.89
Michigan Hub	22.95	22.50	22.65	23.04	24.53	41.65	50.10	41.79	42.24	45.57	43.11	43.39	43.33	41.68	40.32	37.68	34.28	34.26	43.45	55.02	41.74	32.77	29.14	26.44	36.82	40.61
Minnesota Hub	17.99	17.55	17.02	16.63	17.21	20.45	36.70	37.84	38.24	33.08	33.06	31.33	30.86	28.11	26.52	26.07	24.91	25.52	33.26	42.70	33.61	24.62	20.26	16.57	27.09	30.62
Wisconsin PS	20.12	20.21	18.81	18.52	19.16	22.17	43.62	44.88	45.66	44.93	43.53	44.26	42.65	40.44	38.67	36.36	34.33	37.62	49.90	58.76	45.47	37.98	30.41	27.04	36.06	42.24
Cleared Load (GW)	50.3	50.1	50.1	50.9	53.2	60.3	67.5	67.6	68.0	68.6	68.6	68.4	67.9	67.0	65.6	64.6	64.7	65.1	66.9	69.3	66.9	64.1	60.0	5.6		

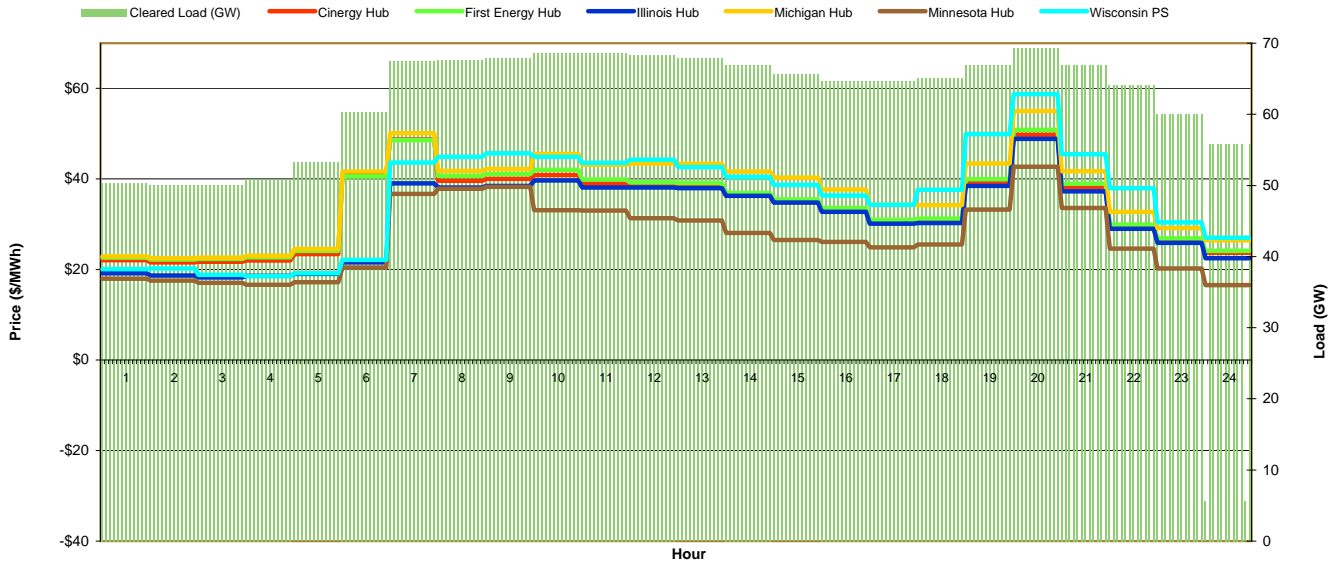

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	21.70	16.07	19.12	17.51	20.37	25.29	31.61	64.99	27.66	29.82	56.89	63.56	29.42	30.48	29.81	27.63	24.20	24.70	24.86	28.94	34.36	23.93	22.73	22.09	29.91	34.00
First Energy Hub	22.26	16.41	18.77	17.71	20.65	25.61	32.22	66.27	28.33	30.64	58.30	65.19	30.18	31.25	30.59	28.39	24.86	25.33	25.51	29.66	35.13	24.53	23.27	22.68	30.57	34.84
Illinois Hub	19.30	14.71	15.11	-0.15	18.50	23.65	30.09	62.25	26.57	28.64	54.64	60.97	28.18	29.23	28.57	26.38	23.51	23.81	23.99	27.75	33.03	23.06	21.86	20.63	27.68	32.65
Michigan Hub	22.61	16.67	17.67	17.35	20.76	25.43	32.05	66.03	28.18	30.43	58.03	65.23	30.14	31.22	30.70	28.49	24.96	25.37	25.38	29.49	35.30	24.77	23.52	23.02	30.53	34.83
Minnesota Hub	18.20	13.82	-18.44	-35.45	15.58	18.36	28.81	60.16	25.34	27.55	53.15	59.93	27.33	28.15	27.16	24.62	19.77	20.80	20.38	25.89	31.53	21.59	19.51	19.34	23.05	30.80
Wisconsin PS	21.23	18.86	9.22	-3.02	20.40	23.06	28.62	53.71	27.61	29.20	49.05	51.04	28.44	28.92	28.72	26.37	24.31	26.52	30.79	40.12	37.58	28.67	24.48	23.17	28.21	33.47
Forecasted Load (GW)	52.5	51.7	51.6	52.3	54.8	60.0	65.9	68.4	68.9	69.0	68.8	68.0	67.1	66.2	65.0	64.2	63.8	63.6	64.9	67.1	66.5	63.4	59.1	55.9		
Forecast Error %	-0.7%	-1.2%	-1.8%	-1.7%	-1.6%	-0.9%	0.0%	0.1%	-0.3%	0.0%	0.4%	1.3%	2.1%	2.4%	2.5%	2.7%	2.5%	2.0%	2.6%	2.0%	1.8%	1.7%	1.7%			

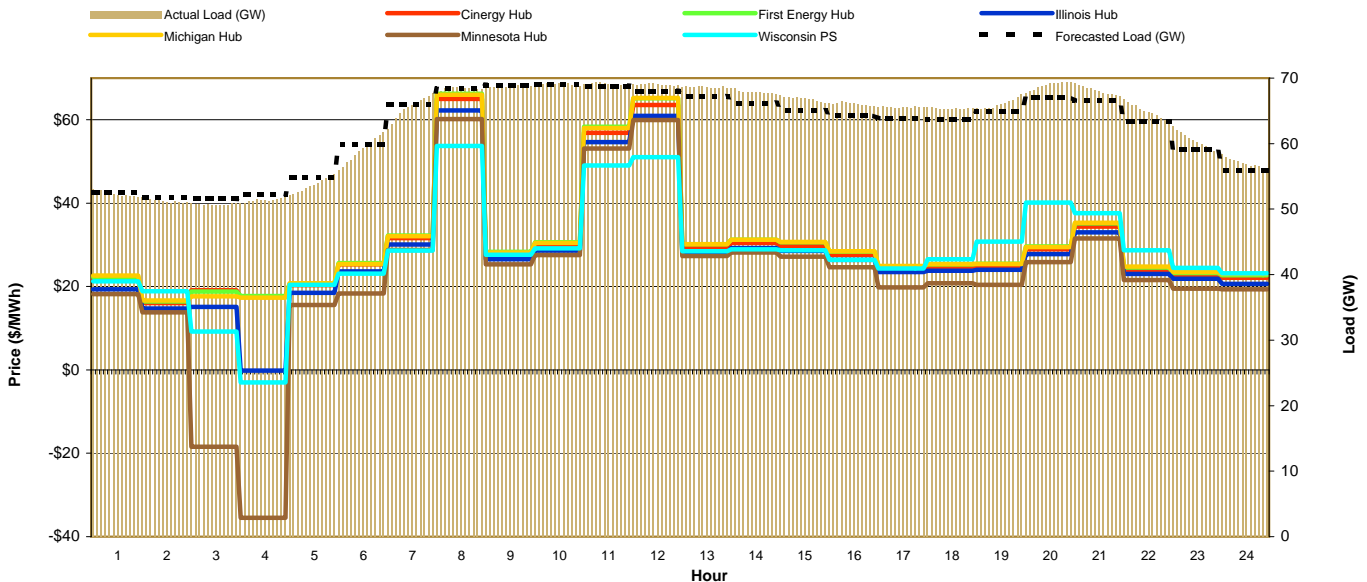




# MISO Daily Report

Tuesday March 16, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	22.00	22.84	23.55	23.65	26.15	34.44	41.62	40.93	39.44	39.44	39.33	38.48	39.31	33.13	29.72	28.01	27.76	27.85	34.85	41.78	36.68	27.41	24.62	23.32	31.93	34.30
First Energy Hub	22.82	23.71	24.55	24.64	27.37	36.30	43.61	42.33	40.79	40.67	39.80	40.76	34.33	30.74	28.97	28.71	28.80	36.05	43.21	37.94	28.35	25.49	24.19	23.12	31.93	35.48
Illinois Hub	19.51	19.63	19.68	19.69	21.24	28.49	36.54	39.13	37.70	37.70	37.55	36.10	36.67	31.26	28.41	26.77	26.53	26.62	33.32	39.94	35.07	26.21	22.35	20.80	29.45	32.58
Michigan Hub	23.07	24.00	24.90	24.99	27.84	36.99	44.84	43.26	41.68	41.56	40.67	41.67	35.10	31.41	29.60	29.33	29.43	36.83	44.15	38.77	28.97	25.76	24.46	23.79	33.79	36.24
Minnesota Hub	15.67	15.04	13.78	13.78	14.00	17.81	27.77	37.62	36.25	36.25	36.15	35.38	35.55	29.98	27.30	25.73	25.51	25.59	32.03	38.40	33.71	25.20	19.33	17.14	26.46	31.25
Wisconsin PS	19.15	19.25	17.61	17.47	18.14	21.53	33.31	45.19	44.69	42.82	42.04	41.64	40.83	35.39	32.17	30.47	30.55	33.88	44.87	50.83	42.81	34.93	25.78	23.59	32.87	38.68
Cleared Load (GW)	50.8	50.4	50.5	50.9	53.5	59.3	67.2	67.6	67.6	67.4	67.1	66.7	66.2	66.2	65.3	64.5	63.6	63.7	65.4	67.7	65.5	62.9	58.5	5.4		

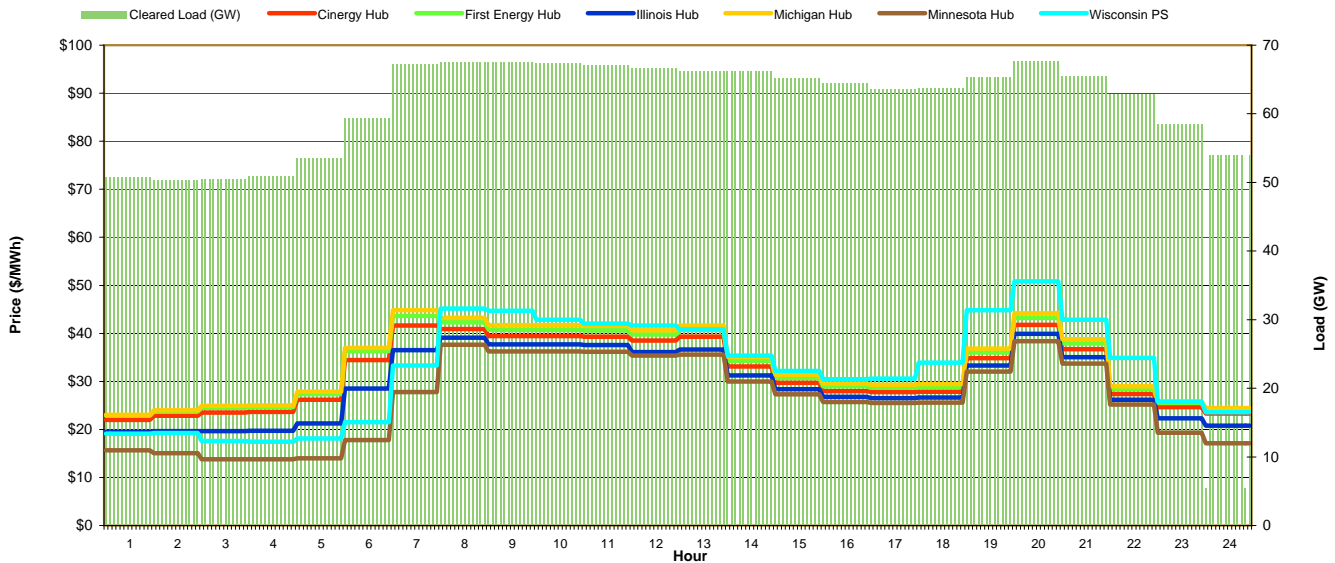

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	21.65	23.89	21.77	23.91	34.35	26.95	37.75	35.31	53.36	32.76	26.86	47.61	28.98	25.56	23.82	24.08	24.78	25.22	28.32	92.37	35.35	23.37	21.26	21.63	31.70	34.31
First Energy Hub	24.71	26.28	22.92	24.57	34.99	27.62	38.72	36.33	54.88	33.70	27.60	48.83	29.70	26.20	24.45	24.74	25.51	25.95	29.15	95.05	36.33	24.03	21.89	22.26	32.77	35.27
Illinois Hub	20.03	22.57	20.83	22.49	24.21	24.67	35.92	33.80	51.24	31.53	25.92	46.06	28.06	24.74	23.04	23.22	23.87	24.34	27.24	89.21	34.26	22.66	20.53	20.77	30.05	33.11
Michigan Hub	25.15	26.82	23.21	26.42	40.47	27.71	38.45	36.04	55.03	34.03	27.95	49.47	30.19	26.67	24.79	24.94	25.68	26.09	29.46	96.87	36.97	24.35	22.07	22.49	33.39	35.66
Minnesota Hub	13.17	17.14	18.33	18.18	16.24	23.92	34.41	33.17	50.73	31.38	25.69	45.34	28.07	24.46	22.50	22.47	23.17	23.68	26.14	87.04	33.84	22.44	19.97	19.87	28.39	32.51
Wisconsin PS	19.08	22.21	22.68	23.63	20.33	25.13	32.67	34.18	44.93	31.27	28.99	40.35	28.44	25.88	24.96	24.31	24.89	27.16	33.45	83.46	38.62	28.75	24.10	23.47	30.54	33.98
Forecasted Load (GW)	54.6	53.4	52.9	53.5	56.0	61.7	67.1	69.0	69.4	69.5	69.1	68.3	67.4	66.4	65.2	64.6	64.2	64.2	65.6	67.6	67.2	63.9	59.4	56.2		
Forecast Error %	-0.3%	-0.5%	-0.7%	-0.7%	-1.4%	-0.2%	-0.5%	-1.0%	-1.7%	-1.6%	-1.1%	-0.9%	-0.9%	-1.0%	-1.9%	-2.7%	-3.0%	-3.9%	-1.4%	-1.5%	-1.2%	-0.8%	-1.0%			

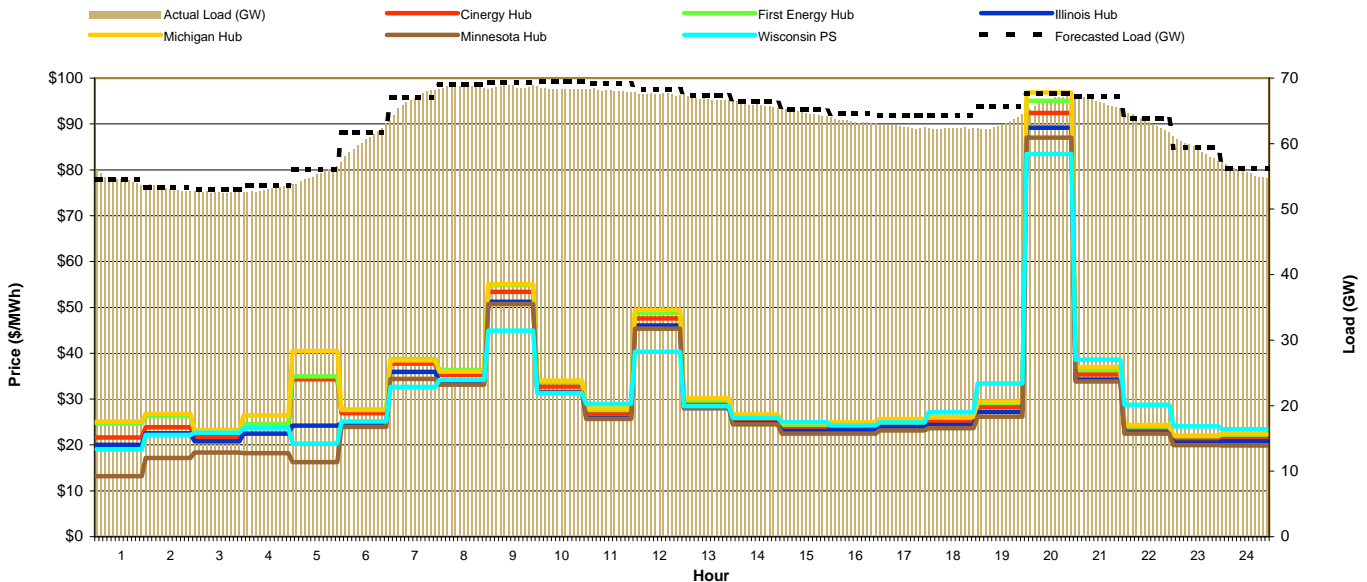






# MISO Daily Report

Wednesday March 17, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	24.62	24.01	24.69	24.79	27.89	39.33	45.12	39.88	40.75	39.91	39.97	39.83	37.31	33.61	31.52	28.73	27.98	27.92	33.23	39.74	33.61	28.93	26.65	24.06	32.67	34.35
First Energy Hub	25.57	24.93	25.69	25.79	29.03	40.93	46.74	41.24	41.10	41.10	41.10	41.10	38.23	34.75	32.60	29.71	28.93	28.87	34.40	41.10	34.75	30.05	27.73	25.02	33.77	35.42
Illinois Hub	21.33	20.67	20.70	20.83	23.35	32.52	42.05	38.12	37.99	37.99	37.99	37.99	35.34	32.13	30.13	27.47	26.74	26.69	31.42	37.99	32.13	26.13	23.21	20.88	30.07	32.47
Michigan Hub	25.97	25.33	26.14	26.24	29.55	41.70	47.83	42.14	42.00	42.00	42.00	42.00	39.07	35.51	33.31	30.36	29.56	29.50	35.17	42.00	35.51	30.81	28.14	25.40	34.47	36.19
Minnesota Hub	16.15	15.36	14.08	14.28	15.81	21.09	38.14	36.65	36.52	36.53	36.53	33.98	30.89	28.97	26.41	25.71	25.66	29.46	36.53	30.25	21.25	17.22	15.15	26.63	30.57	
Wisconsin PS	19.41	19.29	17.66	17.62	19.25	24.01	39.90	44.43	44.85	43.01	42.32	42.48	39.20	35.63	33.34	30.92	30.66	33.93	43.14	49.46	40.76	33.13	25.05	22.87	33.01	38.27
Cleared Load (GW)	51.0	49.7	49.7	50.3	53.2	59.0	65.6	67.0	66.6	66.0	66.0	65.5	65.2	64.3	63.2	62.4	61.7	61.8	63.2	66.0	64.6	62.2	57.6	5.4		

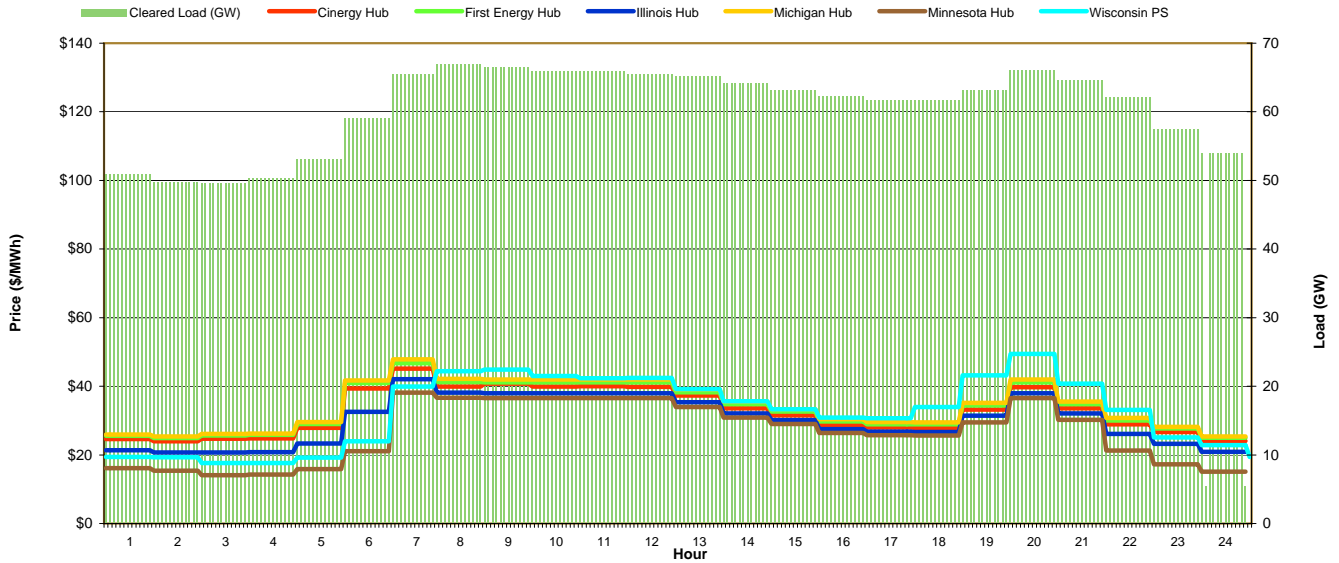

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	22.91	22.78	22.05	22.61	24.95	31.86	128.90	38.35	52.53	58.97	29.10	30.78	31.41	31.91	35.17	31.96	26.17	24.98	30.94	38.10	34.89	24.38	21.08	19.89	34.86	33.80
First Energy Hub	23.47	23.15	22.56	22.95	25.46	32.69	132.59	39.62	54.28	61.02	30.02	31.73	32.35	32.87	36.29	33.01	27.03	25.78	31.95	39.33	35.94	25.10	21.70	20.42	35.89	34.88
Illinois Hub	22.05	21.54	21.18	20.84	23.55	30.25	123.40	37.10	51.06	57.38	28.42	30.06	30.66	31.16	34.30	31.12	25.46	24.31	30.06	36.98	33.99	23.72	20.47	19.24	33.68	32.89
Michigan Hub	23.71	23.14	22.73	22.77	25.56	32.63	131.75	39.51	54.88	62.03	30.53	32.33	33.06	33.53	36.96	33.47	27.33	26.05	32.34	39.77	36.42	25.39	21.92	20.67	36.19	35.35
Minnesota Hub	17.36	12.89	19.36	7.54	18.56	28.78	120.84	37.11	50.67	56.95	28.34	29.79	29.97	30.17	32.81	29.61	24.11	22.72	27.68	34.69	31.58	22.05	19.01	17.77	31.27	31.70
Wisconsin PS	23.34	21.23	23.43	20.19	23.27	28.80	92.66	36.22	44.34	48.73	30.55	29.07	29.95	30.10	32.51	29.56	25.87	27.05	35.07	46.46	38.13	29.07	23.76	22.25	32.98	33.53
Forecasted Load (GW)	54.9	53.8	53.5	54.1	56.6	62.1	66.9	68.5	68.5	68.2	67.7	66.9	66.1	65.0	63.7	62.2	62.2	63.8	66.3	65.9	62.4	58.6	55.4			
Forecast Error %	-2.6%	-2.6%	-2.6%	-2.5%	-2.4%	-1.9%	-0.1%	0.1%	0.1%	0.1%	-0.2%	-0.3%	-0.2%	0.3%	0.7%	0.2%	-0.4%	-1.5%	-3.1%	-1.5%	-1.2%	-0.5%	-1.0%	-10.0%		

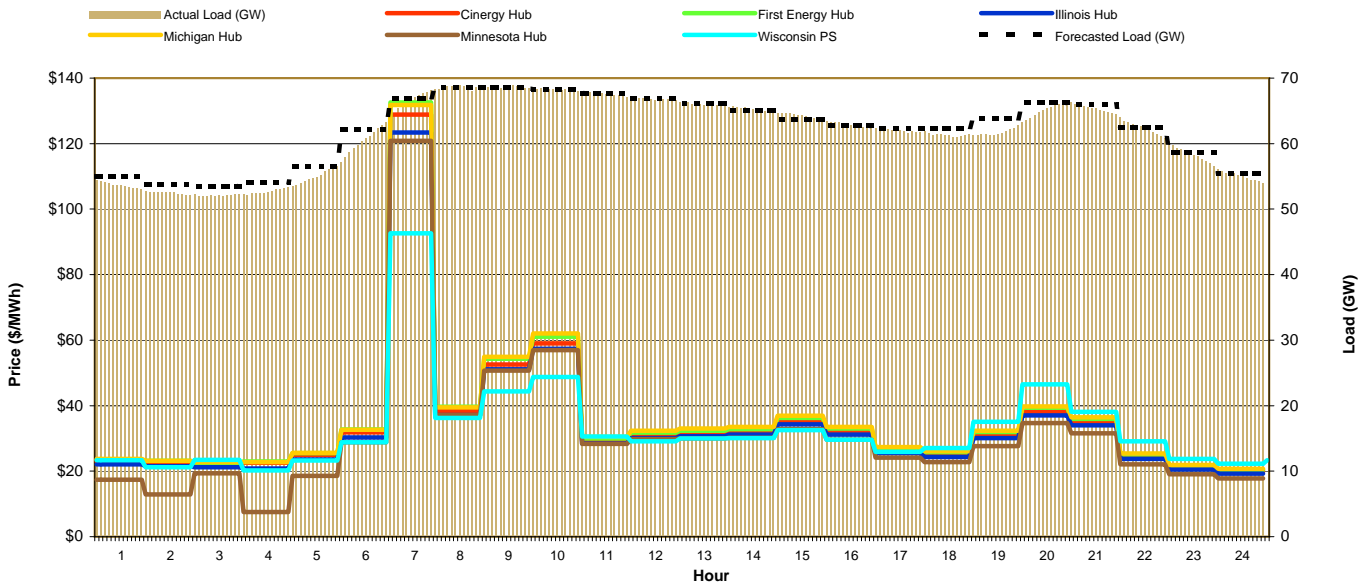




# MISO Daily Report

Thursday March 18, 2010

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$			
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk		
<b>Cinergy Hub</b>	22.83	22.18	23.43	23.85	25.21	35.46	42.89	38.52	37.45	37.36	35.29	32.44	30.26	27.89	27.04	26.79	26.21	30.06	40.67	32.10	26.94	23.44	21.59	30.30	31.86			
<b>First Energy Hub</b>	23.67	23.00	24.30	24.76	26.17	36.85	44.44	39.86	38.73	38.64	36.49	33.54	31.29	28.84	27.97	27.80	27.13	31.09	42.06	33.19	27.85	24.15	22.42	31.37	32.95			
<b>Illinois Hub</b>	20.23	19.39	19.68	19.84	20.93	29.93	39.76	36.58	35.71	35.60	35.61	33.64	30.95	28.89	26.66	25.78	25.08	25.02	28.74	38.89	30.70	25.77	22.47	20.39	28.18	30.38		
<b>Michigan Hub</b>	24.00	23.34	24.63	25.11	26.54	37.38	45.48	40.75	39.58	39.48	37.29	34.27	31.97	29.47	28.58	28.45	27.73	31.77	42.97	33.91	28.45	24.34	22.63	31.98	33.66			
<b>Minnesota Hub</b>	13.67	12.03	11.85	11.41	12.00	18.65	32.24	32.06	34.42	34.34	34.34	31.15	28.96	27.30	25.51	24.85	23.03	23.92	27.63	36.70	27.93	22.85	19.90	17.62	24.35	28.43		
<b>Wisconsin PS</b>	19.31	18.90	16.76	16.45	17.39	23.03	39.80	44.36	43.08	41.12	40.46	39.92	36.47	33.57	30.96	29.61	28.81	32.70	41.67	50.09	39.75	34.62	27.22	24.58	32.11	37.15		
<b>Cleared Load (GW)</b>	50.0	48.9	49.6	49.9	52.6	60.1	67.5	67.9	67.5	66.7	66.6	66.7	66.7	65.3	64.0	63.0	61.9	61.5	63.6	67.3	64.9	61.0	56.3	5.2				

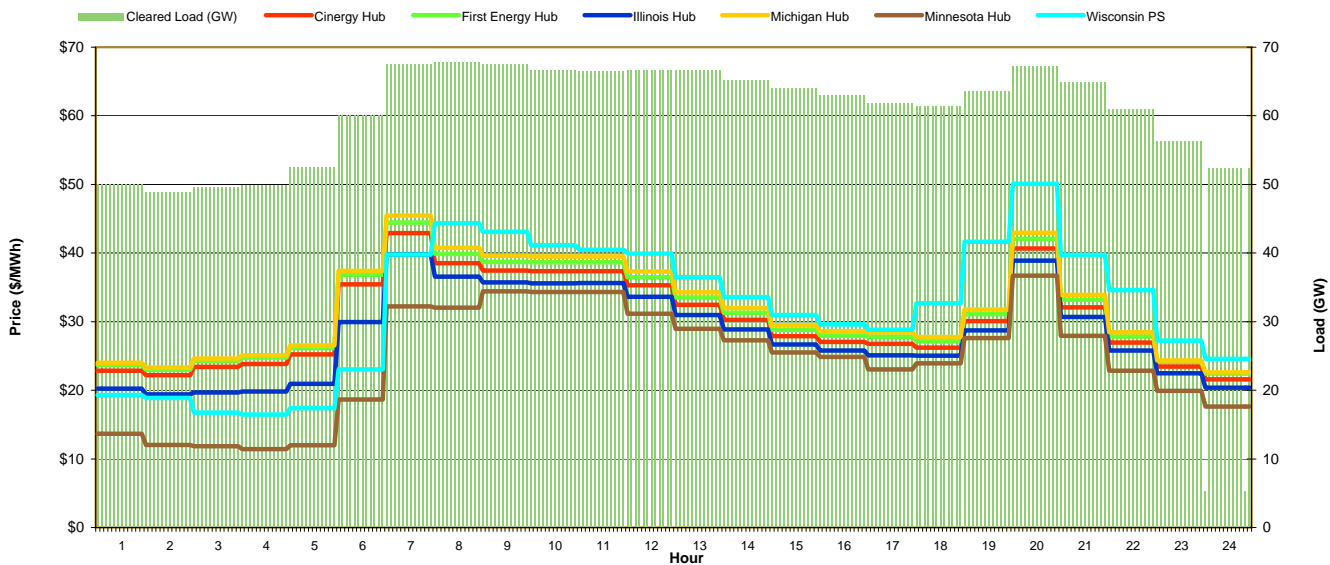

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$			
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk		
<b>Cinergy Hub</b>	22.75	20.91	21.15	25.59	36.47	54.98	56.26	25.35	26.91	28.14	34.14	25.75	25.96	26.89	24.19	23.52	24.06	23.25	21.31	25.29	24.30	22.54	21.65	10.86	27.18	25.20		
<b>First Energy Hub</b>	25.03	21.97	22.68	26.56	37.65	55.23	57.23	25.95	27.65	28.92	35.12	26.49	26.80	27.79	24.96	24.32	24.86	23.97	21.93	26.04	24.99	23.16	22.28	10.65	28.01	25.95		
<b>Illinois Hub</b>	19.26	19.61	18.88	17.27	21.10	47.44	54.28	24.52	25.95	27.21	32.65	23.29	23.25	23.63	21.79	22.67	23.19	22.45	20.63	24.43	23.45	21.79	20.94	9.51	24.55	23.87		
<b>Michigan Hub</b>	25.59	22.30	23.09	27.30	41.08	56.69	57.51	26.14	28.09	29.22	35.66	26.78	27.20	28.16	25.22	24.51	25.01	24.17	22.11	26.32	25.30	23.45	22.59	15.60	28.71	26.25		
<b>Minnesota Hub</b>	10.09	16.35	15.39	16.05	16.35	4.94	52.20	23.70	24.64	26.04	32.10	24.48	24.23	25.17	22.39	21.38	21.74	20.85	19.22	23.07	22.24	20.36	19.39	1.29	20.99	23.19		
<b>Wisconsin PS</b>	17.29	21.29	20.77	20.81	19.37	27.01	45.17	27.44	27.03	28.08	33.35	24.74	26.22	26.73	23.19	23.91	24.32	25.72	28.75	37.90	31.03	27.93	24.13	11.19	25.97	27.53		
<b>Forecasted Load (GW)</b>	53.8	52.7	52.3	52.9	55.4	61.2	66.6	68.2	68.2	67.8	67.3	66.6	65.9	65.0	63.9	62.9	62.3	62.0	63.5	65.8	65.3	62.0	57.8	54.6				
<b>Forecast Error %</b>	-1.5%	-1.4%	-1.5%	-1.0%	-0.8%	-1.2%	-0.2%	-0.1%	-0.3%	-0.3%	-0.6%	-0.4%	0.0%	-0.2%	-0.5%	-0.8%	-1.2%	-2.6%	-0.6%	-0.5%	-0.1%	0.1%	-0.2%					

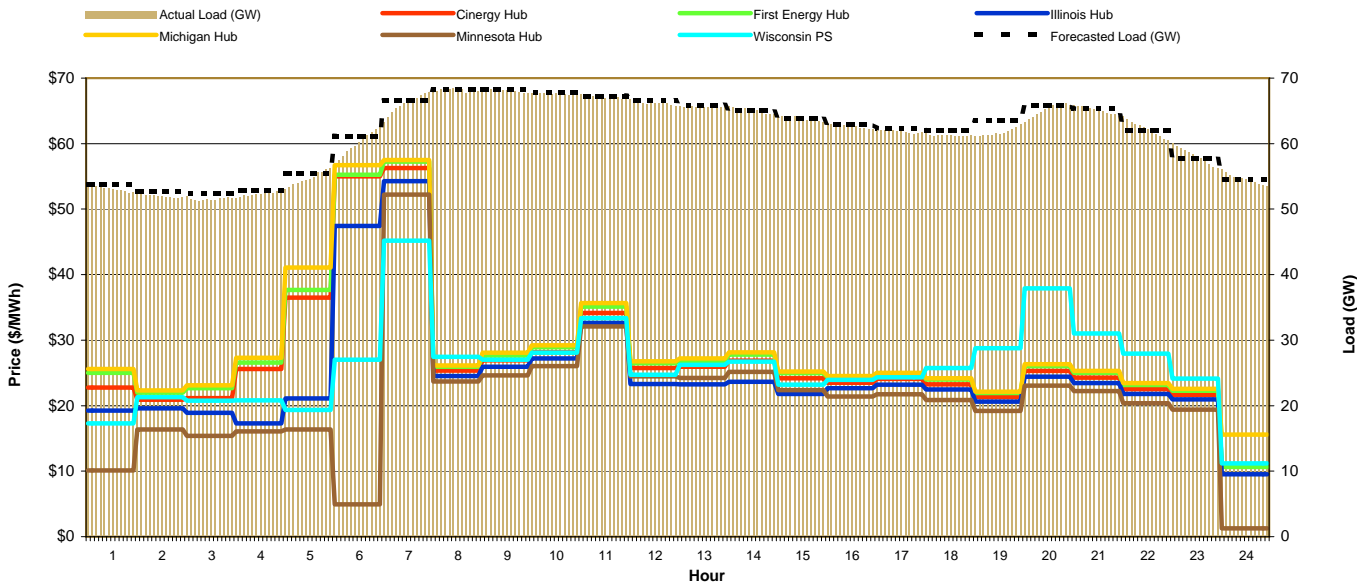




# MISO Daily Report

Friday March 19, 2010

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$			
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk		
Cinergy Hub	21.04	20.43	20.53	21.47	23.06	31.44	37.59	34.70	34.31	33.88	31.91	30.67	30.78	28.95	27.87	25.84	25.11	24.50	27.47	35.91	30.48	25.70	22.36	21.35	27.81	29.40		
First Energy Hub	21.67	21.03	21.14	22.15	23.79	32.34	38.88	35.89	35.49	35.04	33.01	31.72	31.83	29.93	28.82	26.71	25.96	25.34	28.41	37.14	31.52	26.58	23.05	22.01	28.73	30.40		
Illinois Hub	19.51	18.85	18.66	18.24	19.28	25.73	35.81	33.18	32.81	32.39	30.51	29.32	29.43	27.68	26.66	24.71	24.01	23.42	26.26	34.33	29.14	24.58	21.42	20.40	26.10	28.12		
Michigan Hub	21.75	21.09	21.22	22.33	24.01	32.58	39.64	36.67	36.26	35.80	33.73	32.41	32.53	30.59	29.44	27.29	26.52	25.89	29.02	37.94	32.20	27.16	23.24	22.16	29.23	31.04		
Minnesota Hub	16.55	15.27	14.98	14.54	15.76	18.50	32.54	31.90	31.54	31.14	29.33	27.53	27.52	25.23	22.41	21.42	21.47	22.13	25.24	33.00	28.01	23.62	21.06	19.28	23.75	26.41		
Wisconsin PS	19.79	19.58	18.40	17.69	18.68	22.29	36.17	40.97	41.21	39.08	37.08	36.73	35.45	33.21	32.53	30.17	29.56	31.81	39.93	46.89	38.66	33.79	26.51	24.80	31.29	35.85		
Cleared Load (GW)	50.0	48.7	48.9	49.6	52.6	59.1	66.7	66.3	67.0	67.2	67.1	66.6	65.8	64.8	63.6	62.4	61.2	60.6	61.5	65.2	62.1	59.1	54.6	5.1				

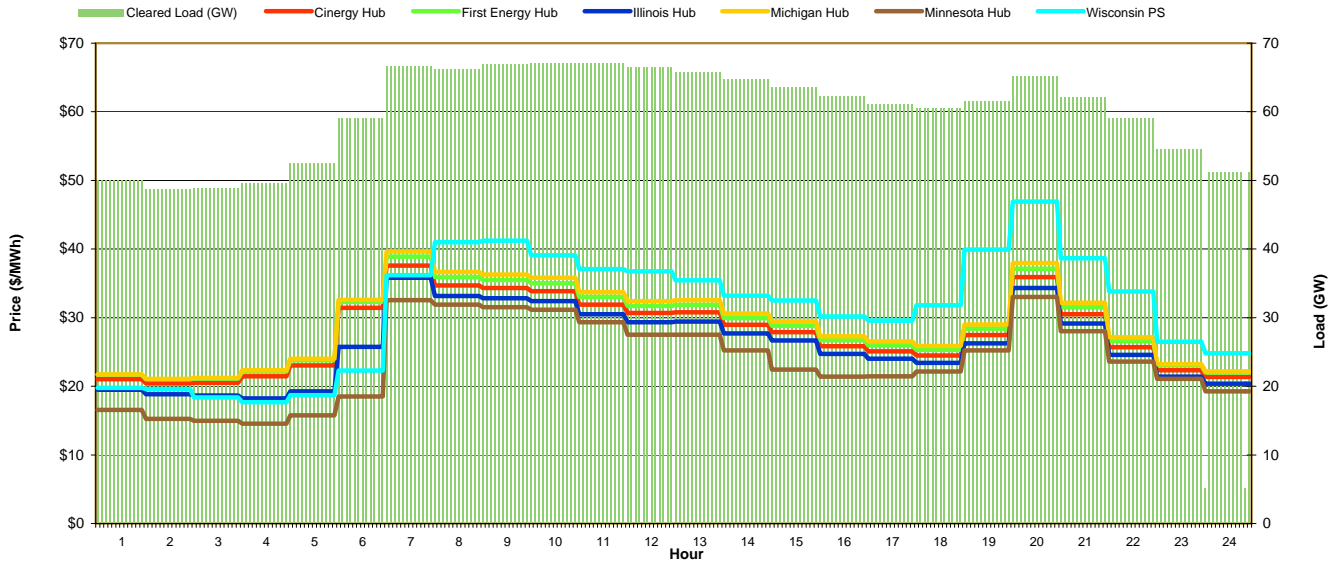

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$			
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk		
Cinergy Hub	21.13	21.59	20.76	21.06	23.21	32.24	36.69	28.35	24.36	24.99	29.68	24.77	30.59	24.85	23.79	22.35	21.90	21.75	22.91	29.56	27.72	22.58	22.22	20.70	24.99	25.15		
First Energy Hub	21.70	22.27	21.32	21.23	23.64	28.92	30.55	29.13	25.06	25.73	30.64	25.54	29.54	25.60	24.52	22.98	22.56	22.33	23.47	30.25	28.40	23.10	22.81	21.33	25.11	25.73		
Illinois Hub	13.08	14.61	17.06	18.13	20.52	22.55	28.41	27.20	23.45	24.09	28.67	23.93	31.49	23.90	22.93	21.56	21.09	21.04	22.15	28.54	26.80	21.81	21.41	19.92	22.68	24.38		
Michigan Hub	24.57	23.84	21.60	25.25	25.64	29.18	30.66	29.36	25.29	25.99	31.01	25.96	30.28	25.93	24.80	23.18	22.62	22.40	23.67	30.59	28.70	23.28	22.99	21.44	25.76	26.00		
Minnesota Hub	8.89	12.26	13.30	11.61	16.48	19.74	26.76	26.05	22.44	21.72	25.96	22.00	14.75	20.26	21.55	20.10	19.83	19.91	21.00	27.49	26.16	21.10	20.79	19.36	19.98	21.94		
Wisconsin PS	12.79	17.45	19.74	19.29	20.96	22.12	27.62	29.65	25.68	26.62	31.53	25.39	26.98	26.66	24.88	23.11	22.98	24.98	30.03	41.05	33.59	28.09	24.68	22.93	25.37	27.87		
Forecasted Load (GW)	53.4	52.2	51.7	52.2	54.5	59.3	64.4	66.3	66.7	66.4	65.9	65.3	64.5	63.7	62.7	61.6	60.7	59.6	60.2	62.7	62.5	59.0	55.4	52.3				
Forecast Error %	-2.2%	-2.2%	-1.7%	-1.7%	-1.5%	-0.6%	0.5%	0.7%	0.2%	0.8%	1.1%	1.2%	1.4%	1.3%	0.9%	0.7%	0.8%	1.5%	0.7%	0.8%	0.2%	1.7%	1.9%	1.8%				

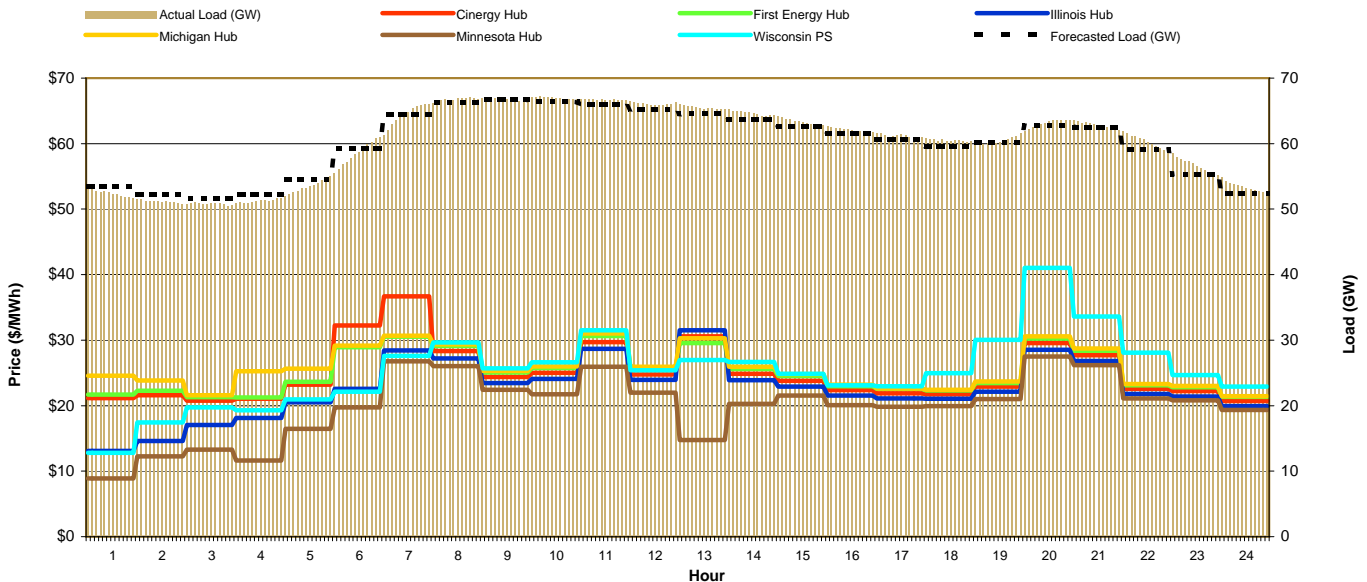




# MISO Daily Report

Saturday March 20, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	21.95	21.59	21.53	21.28	21.59	23.89	28.00	29.91	34.29	37.25	37.76	37.55	34.05	30.00	27.59	27.04	27.29	28.56	32.42	39.55	36.52	30.00	24.01	23.74	29.06	32.11
First Energy Hub	22.76	22.40	22.37	22.11	22.44	24.74	28.81	30.56	35.15	38.15	38.61	38.39	34.83	30.68	28.24	27.68	27.94	29.26	33.21	40.54	37.39	30.77	24.48	24.25	29.82	32.87
Illinois Hub	20.07	19.57	19.18	18.90	19.28	21.46	26.28	28.07	32.49	35.26	35.75	35.53	32.26	28.41	26.20	25.69	25.95	27.23	30.88	37.76	34.70	28.72	22.89	22.73	27.30	30.49
Michigan Hub	22.12	21.77	21.74	21.48	21.80	24.15	28.29	30.49	35.16	38.15	38.65	38.42	34.87	30.72	28.30	27.74	28.01	29.37	33.32	40.70	37.47	30.92	24.71	24.51	29.70	32.94
Minnesota Hub	17.94	17.25	16.99	16.53	17.00	18.67	20.49	20.70	26.30	28.44	29.77	29.34	27.10	23.76	22.32	22.06	22.62	24.54	27.29	34.48	30.13	27.20	19.58	20.54	23.38	25.98
Wisconsin PS	19.68	19.74	18.53	18.11	18.87	20.63	28.24	35.30	39.39	39.31	39.26	39.19	35.78	31.94	29.95	29.05	29.57	33.99	42.70	48.80	41.44	36.45	26.92	25.97	31.20	36.19
Cleared Load (GW)	50.2	49.9	49.4	49.1	50.0	52.8	55.8	58.3	59.7	61.1	61.1	60.5	60.0	59.0	58.3	57.8	57.8	58.4	59.7	62.7	60.4	58.7	54.8	52		

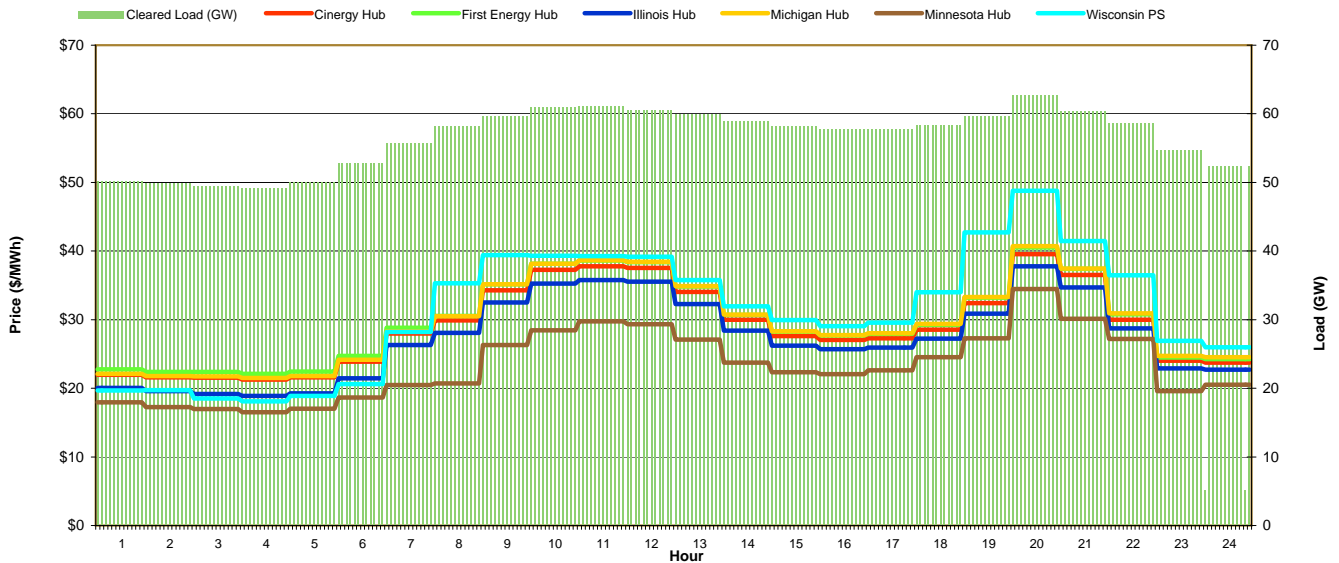

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	19.53	18.52	20.69	20.12	21.82	34.85	45.85	30.46	39.53	40.32	35.76	32.83	25.65	27.12	29.25	26.13	36.61	37.27	26.31	37.93	36.62	28.08	25.97	22.79	30.00	32.24
First Energy Hub	20.09	18.97	21.27	20.61	22.40	35.85	47.10	31.34	39.75	41.48	36.79	33.75	26.36	27.91	30.15	26.92	37.69	38.23	27.03	38.92	37.52	28.74	26.67	23.38	30.79	33.08
Illinois Hub	18.78	17.81	18.47	19.27	20.64	32.75	43.46	28.32	36.78	38.33	34.17	31.44	24.64	26.11	28.16	25.18	35.31	36.03	25.34	36.53	35.35	27.16	25.08	21.99	28.63	30.87
Michigan Hub	20.10	19.00	21.38	20.57	22.39	35.78	46.98	31.30	39.83	41.57	36.94	33.86	26.46	28.02	30.25	27.02	37.85	38.51	27.14	38.87	37.62	28.95	26.81	23.50	30.86	33.19
Minnesota Hub	18.24	17.69	18.20	18.93	20.22	32.26	43.26	28.14	37.09	39.60	36.17	33.26	25.75	26.56	28.41	25.24	35.42	36.28	25.12	37.24	36.20	27.38	24.84	22.01	28.90	31.42
Wisconsin PS	21.26	21.29	21.74	23.26	22.69	30.69	37.82	30.04	34.69	35.96	34.76	30.23	25.99	26.74	28.44	25.61	32.72	35.23	31.97	46.43	39.27	31.57	26.94	24.26	29.98	32.29
Forecasted Load (GW)	51.3	49.8	49.0	48.7	49.5	51.5	54.0	56.2	58.1	59.8	59.9	59.4	58.5	57.6	56.6	55.9	55.6	55.6	57.3	59.7	59.6	57.3	54.3	51.7		
Forecast Error %	-0.5%	-0.3%	0.1%	0.7%	1.2%	1.1%	1.7%	1.5%	2.0%	1.2%	1.3%	1.1%	1.1%	1.0%	1.1%	1.6%	2.9%	2.6%	2.9%	1.7%	1.7%	2.1%	2.4%	2.3%		

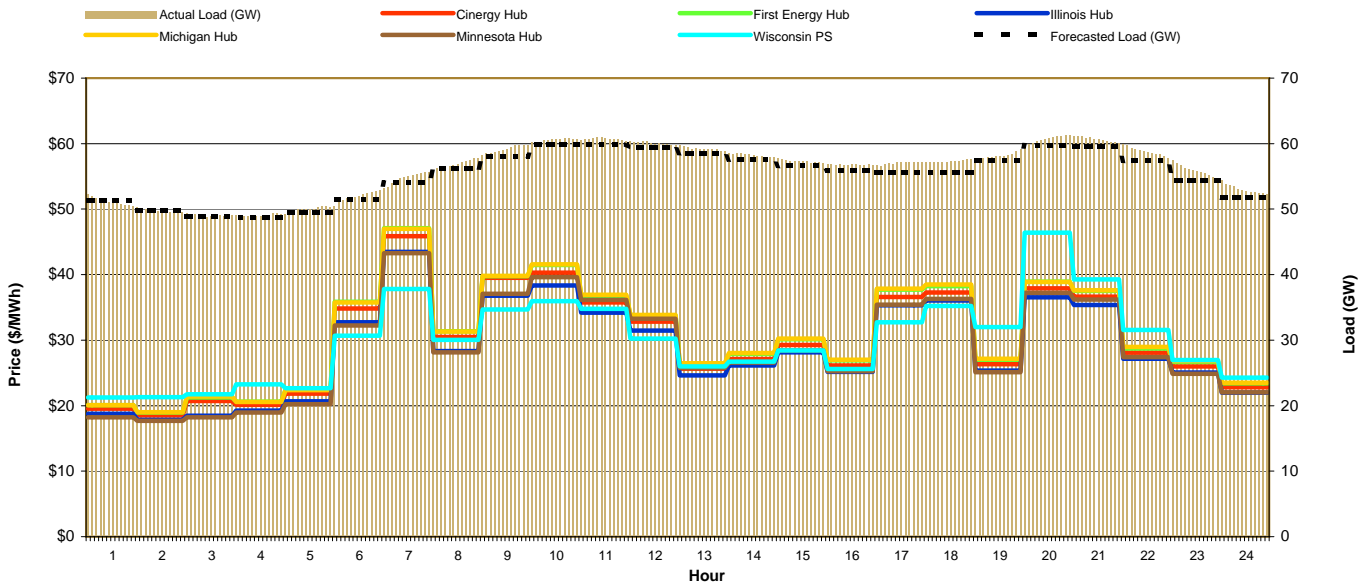




# MISO Daily Report

Sunday March 21, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	22.98	22.00	22.77	22.10	22.09	24.32	26.02	25.81	27.76	28.10	28.27	27.67	27.54	25.68	24.67	24.94	25.79	27.21	31.69	42.02	35.59	28.75	23.91	22.41	26.67	28.46
First Energy Hub	23.82	22.83	23.66	22.97	22.95	25.23	26.99	26.57	28.47	28.82	28.99	28.38	28.25	26.34	25.30	25.58	26.45	27.90	32.50	43.10	36.50	29.49	24.37	22.87	27.43	29.19
Illinois Hub	20.72	20.10	20.08	19.63	19.91	21.89	24.79	24.68	26.58	26.90	27.07	26.49	26.37	24.59	23.62	23.88	24.69	26.05	30.34	40.23	34.08	27.53	22.79	21.44	25.19	27.24
Michigan Hub	23.01	21.99	22.84	22.15	22.11	24.43	26.18	26.41	28.62	28.97	29.14	28.53	28.40	26.47	25.43	25.72	26.58	28.05	32.67	43.32	36.69	29.64	24.60	23.15	27.30	29.33
Minnesota Hub	17.82	18.00	17.63	17.29	17.92	19.67	23.54	23.44	25.25	25.55	25.71	25.17	25.05	23.35	22.43	22.69	23.45	24.74	28.82	38.22	32.37	26.15	19.88	20.30	23.52	25.77
Wisconsin PS	20.31	20.54	19.28	18.93	19.59	21.35	28.79	34.78	36.60	34.99	34.42	34.18	32.67	30.12	28.55	28.19	28.99	33.25	42.51	50.67	41.81	35.61	26.59	25.25	30.33	34.62
Cleared Load (GW)	49.1	48.3	47.9	47.8	49.0	51.8	54.1	55.7	57.6	58.0	58.2	57.8	57.6	56.7	56.0	56.2	56.7	58.0	60.9	63.9	62.5	59.9	55.6	52		

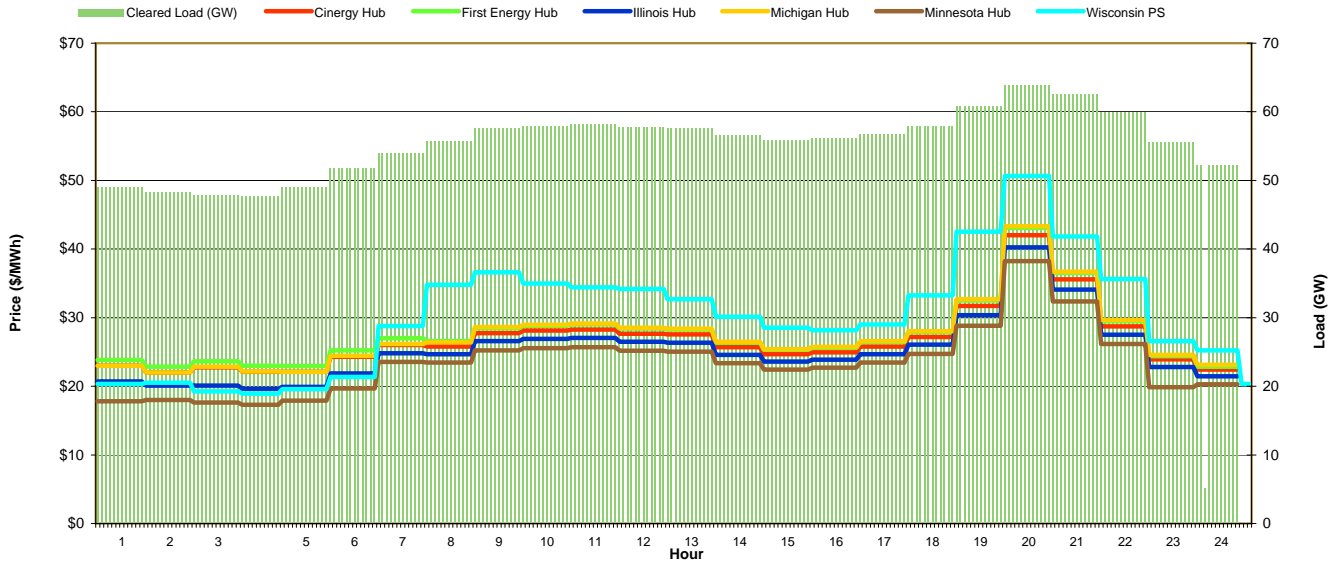

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	21.38	21.23	21.50	19.79	21.58	22.49	24.05	48.70	26.02	32.13	28.97	38.49	61.33	24.82	22.18	21.84	24.76	25.97	24.87	33.78	24.90	22.93	28.49	21.78	27.67	30.64
First Energy Hub	21.90	21.67	21.92	20.22	22.06	23.03	24.61	49.84	26.65	32.89	29.64	39.46	62.87	25.45	22.76	22.35	25.33	26.54	25.47	34.53	25.49	23.55	29.29	22.38	28.33	31.38
Illinois Hub	20.65	20.50	20.77	19.13	20.80	21.67	23.10	46.47	24.77	30.63	27.62	36.65	58.60	23.74	21.24	20.88	23.61	24.78	23.72	32.29	23.91	22.00	27.28	20.79	26.48	29.26
Michigan Hub	21.92	21.70	21.95	20.22	22.08	22.99	24.53	49.59	26.62	33.00	29.84	39.69	63.14	25.45	22.68	22.27	25.26	26.54	25.37	34.57	25.48	23.57	29.37	22.45	28.35	31.40
Minnesota Hub	20.64	20.47	20.55	18.73	20.33	21.30	23.13	45.19	24.96	31.73	28.57	37.89	61.61	25.22	21.76	21.05	23.88	25.32	24.43	32.51	24.57	22.36	26.91	20.94	26.84	29.87
Wisconsin PS	22.50	23.01	23.39	23.02	22.66	22.98	23.67	42.00	26.24	30.58	30.07	33.60	49.57	25.19	23.59	22.56	24.60	27.47	31.10	43.41	31.57	28.23	28.59	23.60	28.47	31.15
Forecasted Load (GW)	50.7	49.5	48.9	48.9	49.8	51.6	53.0	54.0	55.3	56.4	56.3	55.8	55.1	54.3	53.3	53.0	53.5	54.5	56.8	60.1	60.2	57.8	55.2	52.6		
Forecast Error %	-16.2%	0.3%	0.4%	0.1%	-0.6%	-1.4%	-0.2%	1.4%	2.2%	2.1%	2.7%	3.5%	4.0%	4.2%	4.7%	4.5%	4.5%	4.5%	5.6%	6.0%	2.0%	2.1%	0.9%	-9.0%		

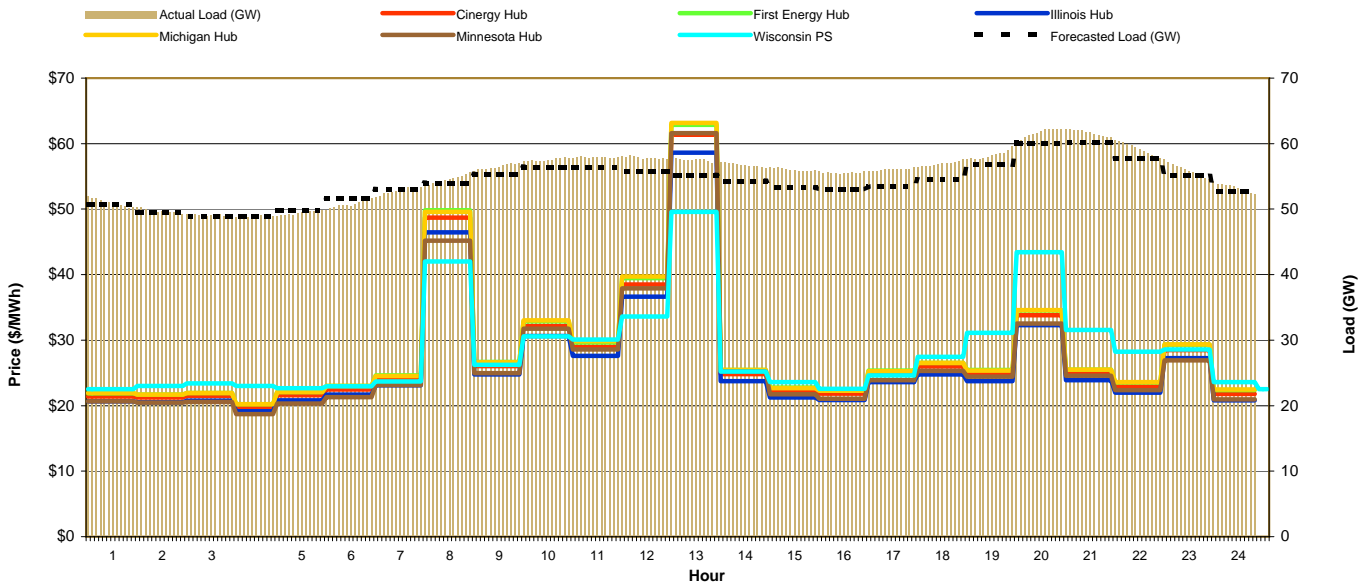




# MISO Daily Report

Monday March 22, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	22.82	22.59	22.91	23.31	25.98	34.73	44.33	42.59	42.04	41.26	40.48	38.04	35.61	32.43	31.96	29.43	28.64	29.15	34.20	45.14	36.17	28.02	25.00	23.34	32.51	35.01
First Energy Hub	23.30	23.06	23.41	23.82	26.64	35.51	45.47	43.68	43.12	42.32	41.52	39.01	36.74	33.73	33.49	30.66	29.98	30.31	35.62	46.53	37.16	28.79	25.53	23.89	33.47	36.14
Illinois Hub	20.98	20.75	20.58	20.82	21.65	30.19	42.45	40.78	40.25	39.51	38.76	36.42	34.19	31.24	30.89	28.36	27.67	28.07	32.95	43.32	34.65	26.82	23.69	22.13	30.71	33.60
Michigan Hub	23.57	23.32	23.69	24.12	27.07	35.93	45.74	43.92	43.35	42.55	41.74	39.22	36.99	34.00	33.81	30.92	30.27	30.56	35.92	46.85	37.37	28.96	25.77	24.14	33.74	36.39
Minnesota Hub	18.45	17.90	17.51	17.68	18.61	24.40	40.32	38.74	38.23	37.54	36.82	34.60	31.81	28.28	27.18	25.40	24.38	25.44	29.69	40.41	32.68	25.17	18.90	17.59	27.82	30.95
Wisconsin PS	20.66	20.63	19.59	19.48	20.37	25.90	41.00	45.93	46.06	43.71	42.50	41.04	38.15	34.88	33.82	31.45	31.26	34.81	44.52	52.88	42.23	35.16	26.87	25.22	34.09	39.08
Cleared Load (GW)	50.7	49.7	50.1	50.7	53.9	61.3	66.4	67.1	67.6	67.9	67.7	67.2	66.6	65.2	64.4	64.0	64.2	65.9	67.9	66.2	63.2	59.8	5.6			

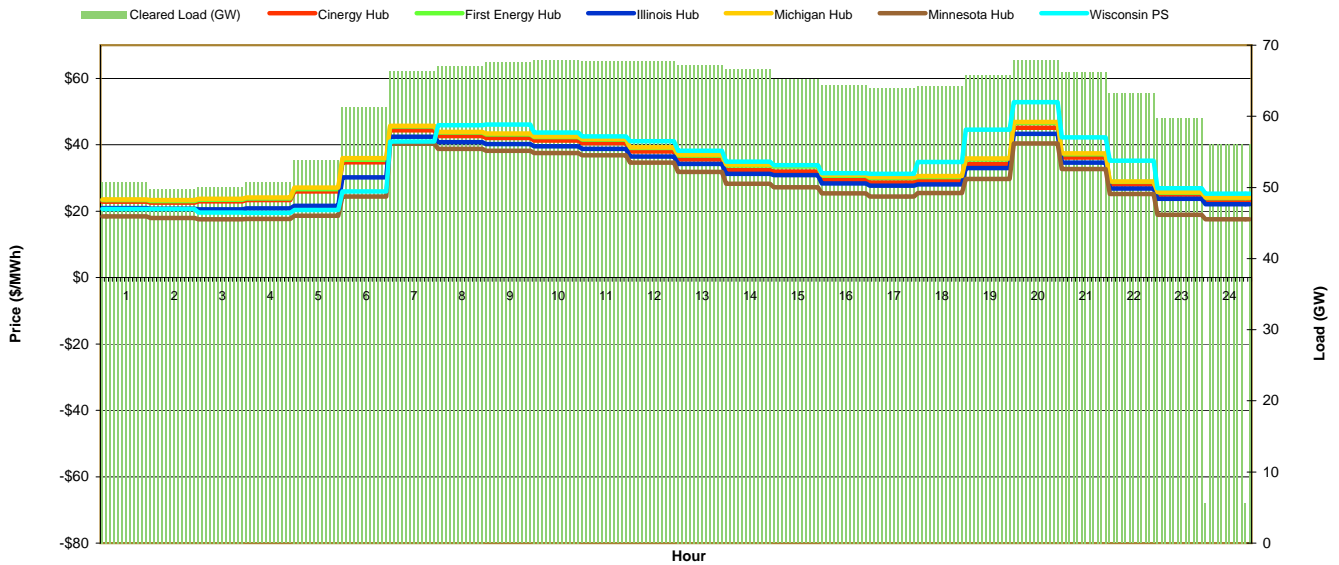

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	22.76	23.56	22.16	19.99	33.63	23.97	27.67	28.89	51.66	27.05	43.33	31.84	29.04	25.97	27.83	30.79	28.93	28.72	25.26	28.65	31.10	24.37	24.73	34.27	29.01	30.51
First Energy Hub	23.44	24.28	22.78	20.46	33.66	24.45	28.21	29.50	52.86	27.80	44.49	32.62	29.79	26.62	28.52	30.34	29.32	29.48	25.88	29.21	31.71	24.87	23.85	35.81	29.58	31.05
Illinois Hub	19.90	19.15	19.06	18.06	29.76	21.79	26.05	27.60	49.35	25.82	41.47	30.41	27.65	24.71	25.83	25.12	24.93	21.93	22.90	27.17	29.53	22.40	15.20	11.85	25.32	27.63
Michigan Hub	23.61	24.60	23.02	20.64	32.98	24.46	27.86	29.06	52.22	27.47	44.18	32.62	30.02	26.90	28.77	30.73	29.61	29.87	25.96	29.20	31.77	24.99	21.06	37.25	29.54	30.90
Minnesota Hub	19.48	18.72	18.52	17.54	4.68	21.95	26.87	29.38	52.75	27.06	43.61	31.31	27.73	24.48	24.24	20.03	27.72	20.10	22.16	27.62	38.87	25.10	-77.39	11.30	20.99	22.80
Wisconsin PS	21.74	21.61	21.99	22.23	21.16	23.29	26.28	30.53	44.93	27.90	40.77	29.97	28.36	26.08	26.95	25.51	26.26	24.93	30.58	40.29	36.41	28.97	-9.72	14.64	26.32	28.67
Forecasted Load (GW)	51.7	51.0	50.9	51.7	54.2	59.1	65.4	68.2	68.6	68.8	68.4	67.7	66.9	65.9	64.7	63.8	63.3	63.3	64.6	67.5	66.7	63.6	59.9	56.3		
Forecast Error %	-0.7%	-0.4%	-0.3%	-0.5%	-0.4%	1.1%	1.2%	0.3%	0.5%	0.7%	1.0%	1.4%	1.8%	2.1%	2.2%	2.4%	2.6%	2.3%	1.4%	0.2%	0.8%	0.5%	-0.8%	-0.3%		

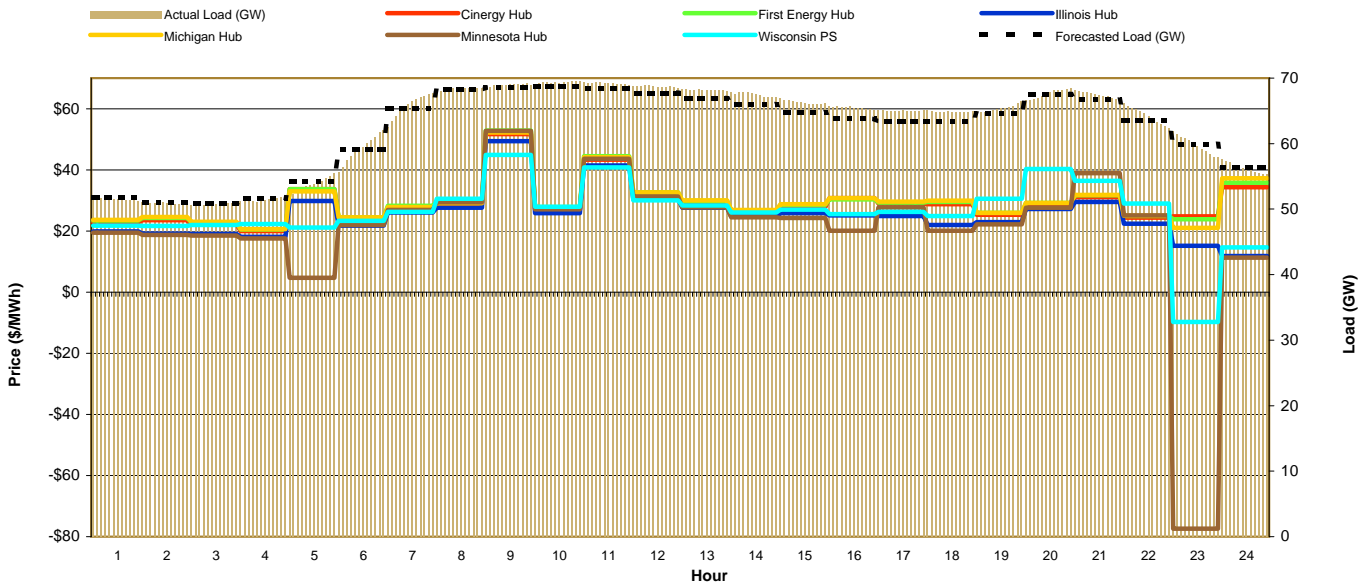




# MISO Daily Report

Tuesday March 23, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
																									All	On Pk		
Cinergy Hub	23.72	23.02	23.06	23.70	26.58	35.40	46.72	38.34	37.47	37.36	37.02	36.55	34.09	32.19	28.36	26.53	26.13	26.03	27.76	38.45	31.64	27.13	24.42	22.99	30.61	31.84		
First Energy Hub	24.23	23.56	23.58	24.26	27.24	36.12	47.96	39.47	38.56	38.55	38.49	38.40	36.60	35.29	30.19	28.41	27.78	27.33	29.09	39.85	33.06	28.28	25.19	23.71	31.88	33.41		
Illinois Hub	21.28	20.54	20.47	20.51	21.95	29.32	44.65	37.05	36.20	36.14	35.93	35.65	33.09	31.18	27.84	26.10	25.56	25.22	26.76	37.30	30.75	26.17	23.22	21.89	28.95	30.89		
Michigan Hub	24.45	23.80	23.82	24.53	27.60	37.04	48.29	39.88	38.96	38.96	38.95	38.93	38.44	38.09	30.67	28.89	28.20	27.64	29.79	40.46	33.47	28.57	25.42	23.93	32.45	34.08		
Minnesota Hub	15.85	15.47	15.42	15.43	16.16	20.04	37.74	35.38	33.12	32.61	29.90	27.69	24.72	21.60	19.63	21.09	21.59	21.33	22.97	34.45	28.71	23.83	17.56	23.76	26.03			
Wisconsin PS	20.07	20.12	19.01	18.78	19.84	24.70	41.07	43.40	44.89	43.35	44.28	45.14	42.88	40.97	36.64	31.31	29.85	32.49	39.77	48.87	39.79	36.38	26.61	25.11	33.97	39.16		
Cleared Load (GW)	52.9	51.9	52.1	52.8	56.1	61.8	66.8	68.0	67.9	67.7	67.2	66.4	66.1	65.2	64.4	63.3	62.6	62.4	64.0	67.4	65.6	62.4	58.3	5.5				

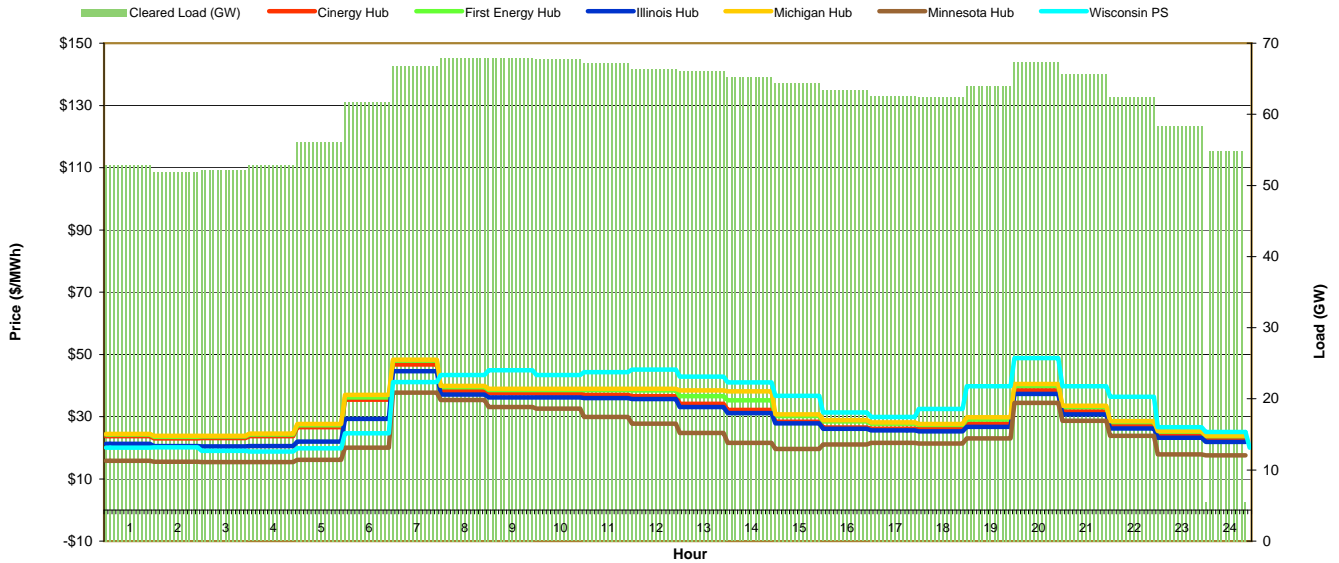

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
																									All	On Pk		
Cinergy Hub	22.86	30.58	22.34	24.35	36.86	32.44	85.32	37.38	65.45	75.72	143.43	35.26	33.01	36.70	30.46	27.92	62.18	21.73	67.73	66.95	24.19	23.74	26.49	21.90	44.20	49.01		
First Energy Hub	23.58	31.99	22.82	25.02	38.18	33.01	83.45	37.41	60.17	70.61	143.43	31.78	30.86	34.49	29.07	26.16	49.28	21.96	54.13	65.28	24.39	23.66	23.92	21.47	41.92	45.41		
Illinois Hub	14.37	7.73	17.83	16.02	14.75	25.64	76.16	35.19	51.54	61.29	128.19	25.95	26.70	29.41	25.14	21.98	0.50	17.30	-9.15	38.25	21.49	21.67	7.37	14.20	28.73	31.43		
Michigan Hub	24.25	33.58	23.31	25.78	39.98	33.70	84.04	37.39	60.34	71.15	146.02	32.22	31.30	34.90	29.29	26.27	49.56	21.97	54.54	65.93	24.81	24.05	24.17	21.79	42.51	45.87		
Minnesota Hub	16.66	7.47	17.00	23.11	13.60	24.22	75.98	34.79	55.97	65.45	131.25	29.09	28.44	31.67	26.82	24.08	20.33	19.96	25.13	58.92	22.87	21.81	10.40	15.58	33.36	37.94		
Wisconsin PS	17.58	11.47	21.11	20.78	15.93	25.26	55.12	35.31	37.65	44.75	90.89	19.16	23.59	23.83	23.41	19.27	23.07	24.68	31.50	63.57	31.08	27.50	17.49	20.64	30.19	33.55		
Forecasted Load (GW)	55.2	54.1	53.7	54.3	56.6	61.5	67.9	69.8	69.7	69.4	68.8	68.0	67.0	66.0	64.8	64.1	63.7	63.6	64.5	66.9	66.4	63.1	59.5	56.0				
Forecast Error %	-2.0%	-2.1%	-2.0%	-1.9%	-1.5%	-0.4%	-0.8%	-1.0%	-1.2%	-1.3%	-1.2%	-1.2%	-0.9%	-0.8%	-0.8%	-1.7%	-2.4%	-3.2%	-4.1%	-2.4%	-1.9%	-1.3%	-2.4%	-12.3%				

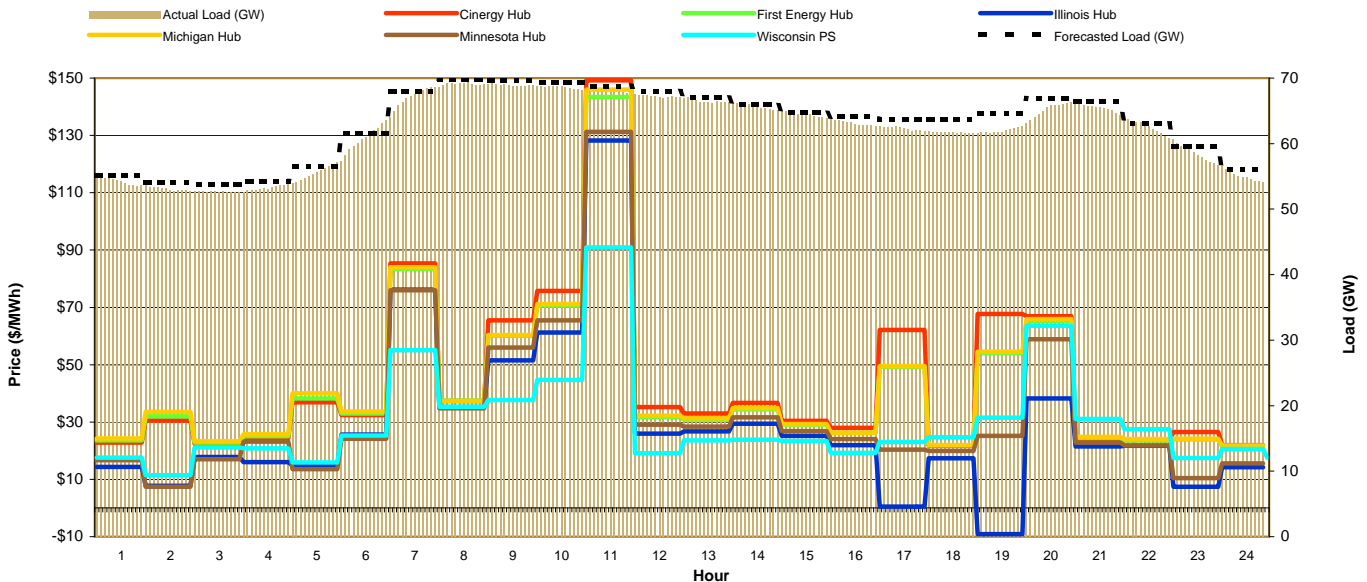




# MISO Daily Report

Wednesday March 24, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	23.14	22.75	22.64	23.07	25.64	34.46	45.63	38.68	38.72	37.63	38.77	35.98	34.31	32.86	29.04	27.69	26.61	26.32	28.81	38.33	33.76	27.70	23.44	22.10	30.75	32.42
First Energy Hub	23.71	23.31	23.21	23.64	26.31	35.68	46.35	39.33	39.33	38.10	39.33	36.52	34.88	33.62	29.73	28.33	27.26	27.05	29.61	39.33	34.70	28.49	23.93	22.55	31.43	33.10
Illinois Hub	19.53	19.00	18.86	18.93	19.97	25.74	43.16	36.63	36.57	35.42	36.64	34.01	32.53	31.53	27.88	26.57	25.57	25.38	27.78	36.90	32.56	26.73	22.18	20.12	28.34	30.93
Michigan Hub	24.05	23.65	23.55	24.00	26.79	37.67	46.82	39.73	39.73	38.48	39.73	36.89	35.23	33.96	30.03	28.62	27.54	27.33	29.92	39.74	35.06	28.78	24.14	22.79	31.84	33.43
Minnesota Hub	16.60	15.84	15.88	15.92	16.57	18.93	41.57	35.35	35.28	34.28	35.35	32.76	31.28	30.14	26.65	25.40	24.44	24.25	26.55	35.27	31.11	25.54	18.46	16.99	26.27	29.51
Wisconsin PS	19.20	19.16	18.15	17.93	18.76	21.88	40.94	42.59	42.84	40.30	40.58	38.91	36.62	35.00	31.57	30.11	29.66	32.83	40.79	48.44	40.83	35.11	25.83	23.69	32.15	37.00
Cleared Load (GW)	53.2	52.3	52.6	53.3	56.3	62.2	67.8	67.5	67.2	66.7	66.3	66.0	65.6	64.6	63.7	62.8	62.6	63.7	67.0	65.4	62.8	58.2	5.5			

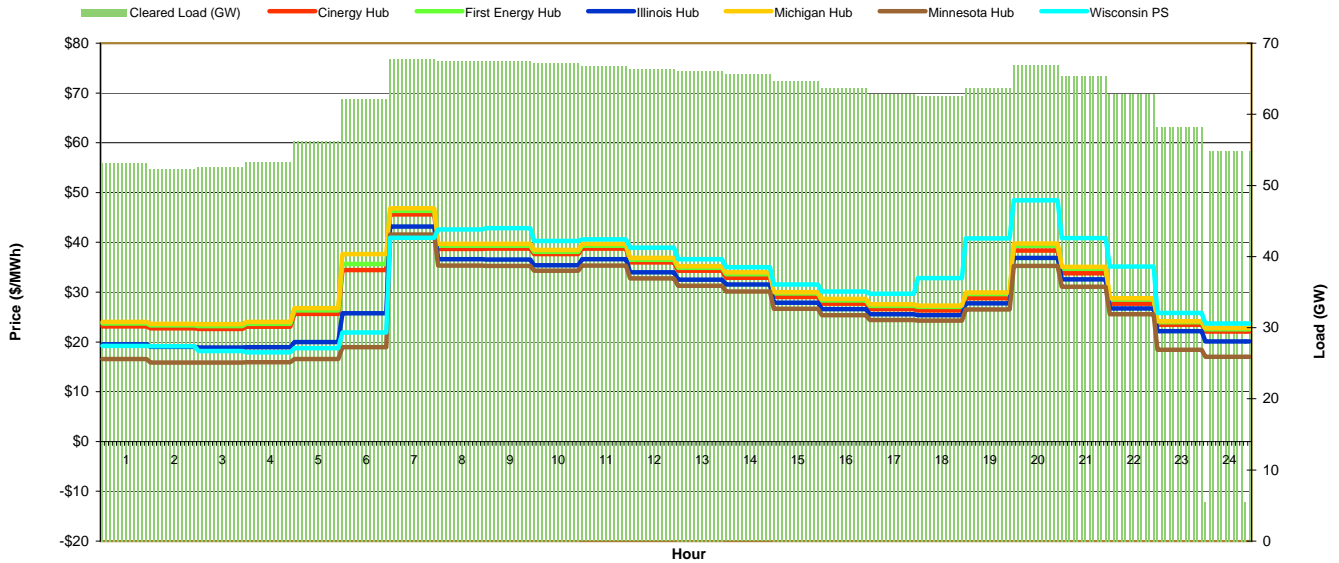

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	20.02	8.12	20.14	26.94	23.11	46.63	24.43	27.45	27.70	30.24	69.05	54.93	38.29	26.72	22.78	23.35	23.00	22.21	25.77	27.05	23.31	27.61	18.06	17.17	28.09	30.47
First Energy Hub	18.42	7.57	20.85	28.94	23.07	40.92	24.68	27.45	30.08	32.83	70.41	56.00	39.23	27.38	23.35	23.93	23.57	22.68	25.17	27.00	23.82	22.03	18.43	16.74	28.11	30.84
Illinois Hub	7.86	2.66	10.15	-13.11	16.00	16.68	23.41	25.48	25.31	28.17	65.89	52.43	36.65	25.57	21.82	22.30	21.96	21.23	17.33	22.08	22.20	-8.07	16.67	12.09	20.53	26.06
Michigan Hub	18.59	7.66	21.70	31.40	23.73	41.42	24.74	27.53	27.85	30.88	71.32	56.73	39.81	27.98	23.91	24.44	23.95	23.00	25.59	27.56	24.35	22.53	18.77	16.94	28.43	31.01
Minnesota Hub	10.55	4.74	10.99	-9.16	15.92	24.94	29.27	26.12	26.39	29.59	69.29	55.47	38.41	26.67	22.62	22.66	22.35	21.52	23.20	24.86	22.93	19.69	16.69	12.41	23.67	29.28
Wisconsin PS	16.94	12.77	15.98	-1.34	19.82	23.31	24.73	28.22	26.63	29.16	58.32	45.84	34.93	26.89	24.59	24.08	24.01	25.43	31.08	38.77	30.73	26.14	21.54	18.48	26.13	31.02
Forecasted Load (GW)	54.4	53.3	52.9	53.6	56.0	61.5	67.3	68.5	68.5	68.3	67.7	67.0	66.0	65.0	63.9	63.0	62.5	62.2	63.0	65.6	65.3	62.3	58.1	55.0		
Forecast Error %	-3.3%	-3.3%	-3.3%	-3.2%	-2.7%	-2.5%	-2.1%	-1.4%	-1.1%	-1.1%	-1.2%	-1.1%	-0.5%	-0.3%	-0.3%	-0.4%	-0.8%	-0.6%	-0.9%	-0.1%	-0.3%	-0.6%	-0.9%	-1.6%		

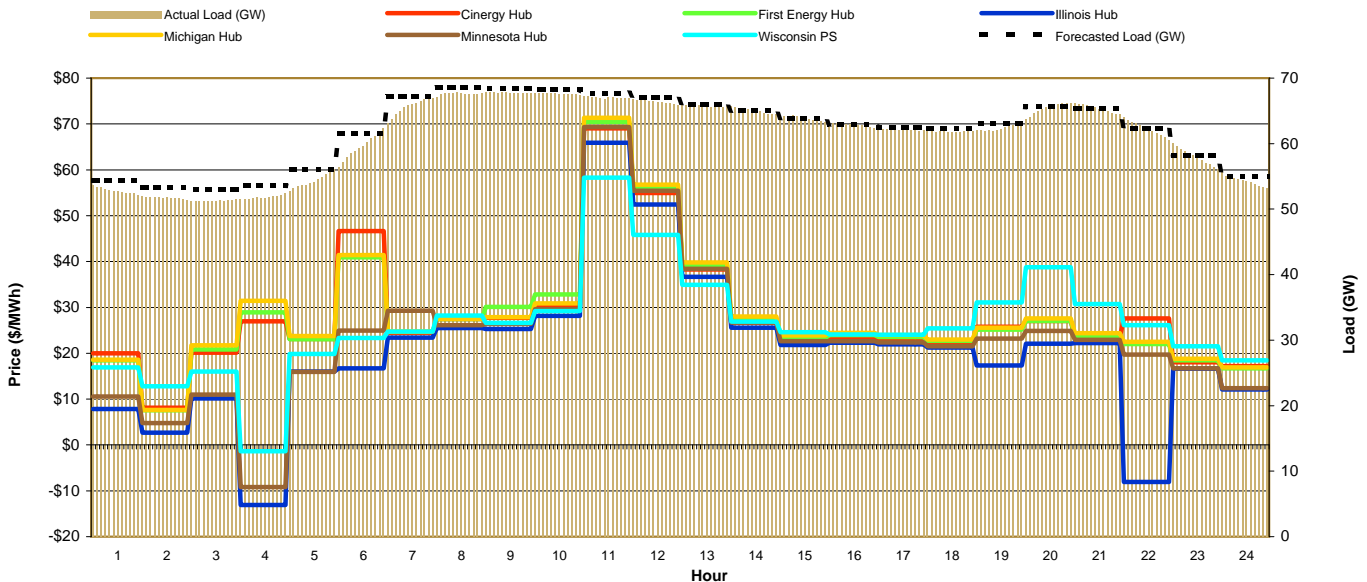






# MISO Daily Report

Thursday March 25, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$	
																									All	On Pk
Cinergy Hub	22.47	21.56	21.80	22.11	25.05	36.14	42.45	36.05	36.01	35.11	36.01	34.06	33.04	30.86	29.10	27.71	27.83	28.93	33.38	42.90	38.51	28.23	25.98	24.78	30.84	32.73
First Energy Hub	22.15	21.28	21.56	22.27	24.37	34.76	41.21	36.60	36.85	36.33	36.71	35.72	34.95	33.30	31.93	29.20	28.45	29.28	34.65	43.24	38.72	29.03	26.90	25.24	31.45	33.87
Illinois Hub	16.50	16.32	15.92	15.73	15.73	16.98	28.83	32.69	33.00	33.11	34.14	32.06	31.09	28.93	27.00	25.08	25.91	25.57	27.07	37.04	32.82	27.12	17.42	16.52	25.52	29.38
Michigan Hub	22.35	21.44	21.90	23.24	24.63	37.82	41.68	36.95	37.77	37.92	37.06	38.28	38.06	37.60	37.22	31.75	28.79	29.59	38.03	43.70	39.14	29.33	30.51	27.95	33.03	35.73
Minnesota Hub	16.16	15.32	15.01	14.67	15.42	17.00	33.00	34.23	33.76	33.46	34.58	32.28	31.01	28.39	26.56	24.69	26.56	26.82	27.90	37.75	33.68	26.41	19.31	18.01	25.92	29.84
Wisconsin PS	17.54	16.85	16.49	15.71	17.23	22.35	35.21	34.90	34.37	33.91	34.90	32.98	32.05	29.98	28.42	26.97	27.79	28.13	30.74	40.87	36.46	28.36	21.91	20.59	27.69	31.42
Cleared Load (GW)	50.4	49.5	49.7	50.3	52.6	59.0	66.4	67.6	67.8	67.9	67.8	67.0	66.9	66.1	64.9	63.8	63.5	63.4	64.3	67.3	65.7	63.1	59.0	5.6		

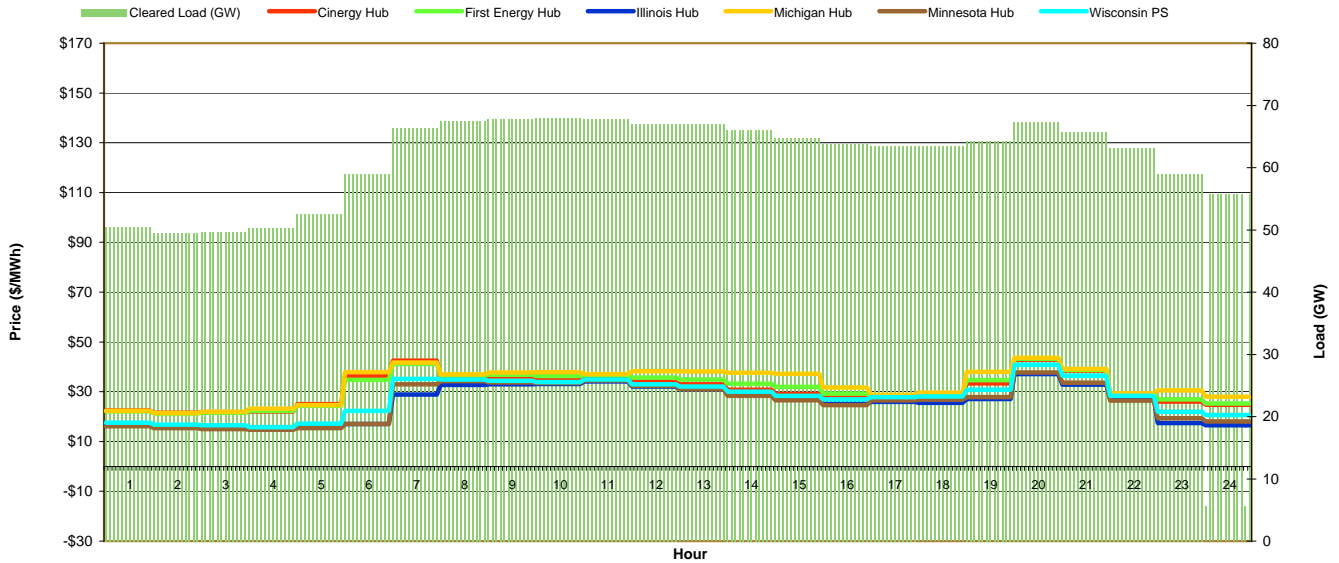

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$	
																									All	On Pk
Cinergy Hub	16.79	15.69	15.14	19.72	18.40	62.63	24.82	25.22	26.16	25.62	30.08	50.97	30.63	31.47	31.85	125.25	32.66	42.39	25.47	44.99	46.21	22.98	23.73	35.36	34.34	38.48
First Energy Hub	17.14	16.03	15.48	20.32	18.73	59.79	25.26	25.85	25.70	26.43	28.73	49.25	29.31	29.87	29.01	112.30	25.30	37.12	25.69	46.23	47.38	23.50	24.27	73.91	34.69	36.62
Illinois Hub	16.08	14.01	13.22	12.92	17.39	23.20	23.66	24.01	20.81	24.33	21.62	33.15	16.88	13.50	5.69	36.92	-24.11	1.47	20.93	42.80	44.21	22.02	22.67	15.00	19.27	20.43
Michigan Hub	17.26	16.16	15.61	20.75	18.84	61.25	25.51	26.00	25.93	26.78	29.11	49.68	29.58	30.21	29.34	113.70	25.56	37.51	25.91	46.76	47.97	23.80	24.59	161.04	38.70	37.03
Minnesota Hub	16.50	14.17	13.39	13.19	20.52	32.07	23.95	24.99	24.89	25.48	27.69	47.44	28.32	28.88	27.94	85.90	24.05	32.04	24.68	45.68	48.28	23.60	23.27	20.49	29.06	33.95
Wisconsin PS	17.07	14.53	13.62	12.41	18.48	26.84	25.25	25.88	22.72	26.20	23.09	44.07	27.01	29.55	28.58	92.81	24.77	33.62	25.18	46.35	47.97	23.73	24.02	16.22	28.75	34.09
Forecasted Load (GW)	52.9	51.7	51.2	51.7	53.5	58.7	64.7	66.6	67.2	67.3	67.2	66.8	66.3	65.5	64.7	63.9	63.5	63.5	64.5	67.5	67.1	64.2	60.8	57.4		
Forecast Error %	-1.6%	-1.7%	-1.6%	-1.4%	-0.4%	0.0%	0.3%	0.7%	0.9%	1.5%	1.7%	2.2%	2.6%	3.2%	3.4%	3.8%	4.1%	4.4%	2.9%	3.4%	3.1%	2.2%	2.7%			

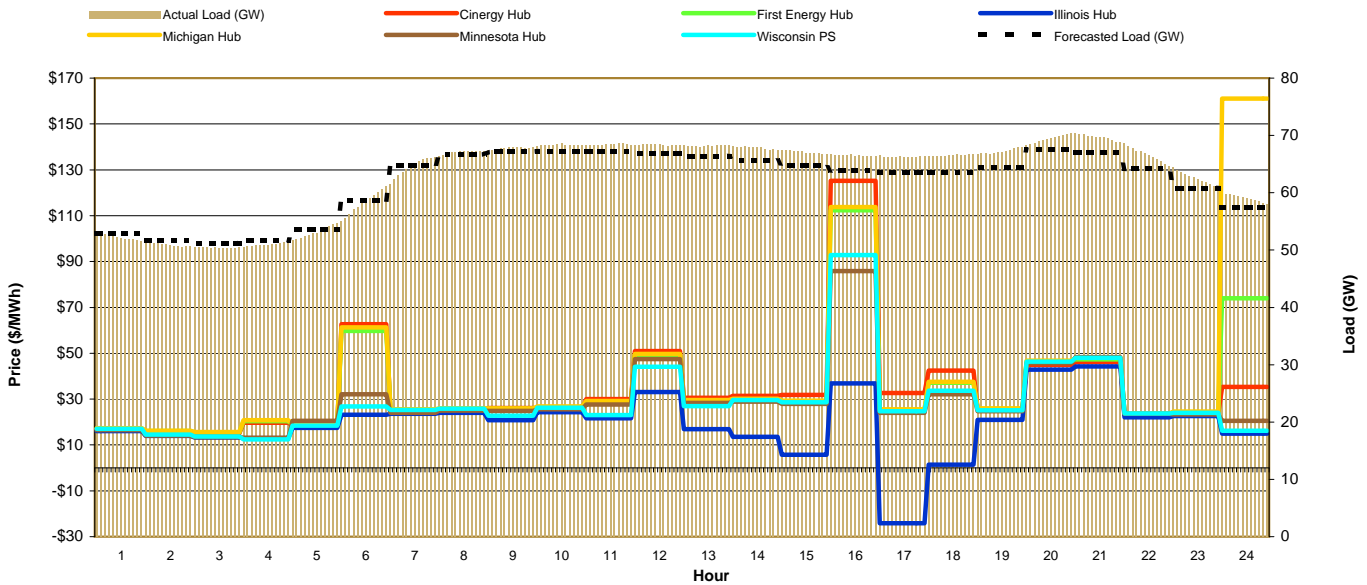




# MISO Daily Report

Friday March 26, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	24.64	22.47	23.21	23.34	26.50	38.83	49.25	41.15	40.88	40.51	38.30	33.63	32.94	31.01	27.53	29.70	27.63	27.06	30.71	45.23	35.10	28.01	25.89	25.11	32.03	33.46
First Energy Hub	23.96	22.70	23.41	24.26	27.65	37.99	47.83	42.31	41.98	41.51	39.08	35.37	34.83	33.18	29.38	28.60	27.22	26.83	30.15	43.28	34.10	27.55	25.14	24.26	32.19	33.78
Illinois Hub	15.91	15.92	15.76	15.62	16.19	21.16	33.51	39.58	39.14	38.03	34.68	29.32	28.70	24.85	22.44	18.13	19.85	20.18	21.62	26.66	22.83	19.10	16.70	15.68	23.82	26.36
Michigan Hub	24.37	23.81	24.64	27.07	31.86	38.97	48.41	42.80	42.29	41.76	39.31	38.29	38.14	37.69	33.13	28.78	27.37	26.97	30.27	43.43	34.22	27.66	25.29	24.42	33.37	34.84
Minnesota Hub	16.46	15.26	15.06	14.87	15.87	18.28	34.43	35.86	33.38	31.64	29.65	27.48	24.94	22.62	20.25	18.89	19.77	19.54	19.94	24.96	22.14	19.36	15.57	15.15	22.14	24.12
Wisconsin PS	18.79	17.53	17.49	17.15	18.49	22.88	40.44	40.26	38.81	37.55	35.10	30.70	29.13	26.80	24.40	23.16	23.23	23.09	25.31	33.83	27.93	23.87	20.16	19.02	26.46	28.96
Cleared Load (GW)	1.0	4.0	7.0	10.0	13.0	16.0	19.0	22.0	25.0	28.0	31.0	34.0	37.0	40.0	43.0	46.0	49.0	52.0	55.0	58.0	61.0	64.0	67.0	7.0		

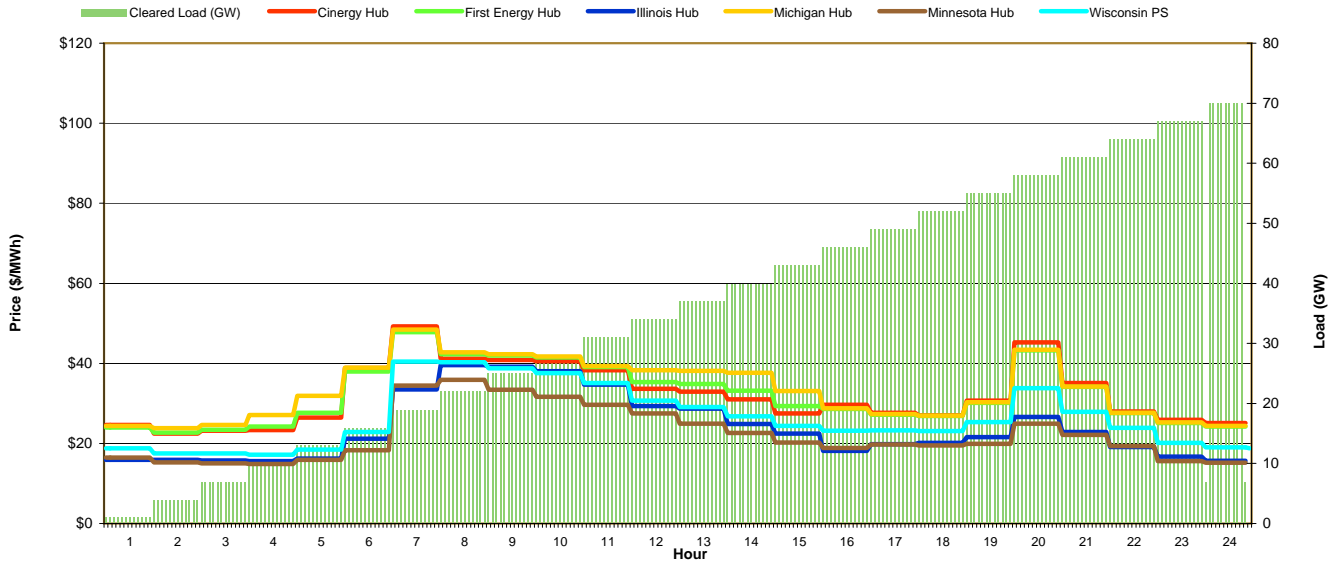

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	18.14	21.14	19.94	21.99	20.07	24.72	112.32	34.81	26.14	29.53	27.27	29.05	73.80	25.25	24.11	24.09	21.21	20.38	47.69	44.24	25.63	22.48	20.95	22.56	31.56	31.04
First Energy Hub	18.47	21.57	20.29	22.37	20.35	25.05	113.18	35.53	26.79	30.37	28.05	29.79	75.83	25.93	24.70	24.72	21.86	20.94	43.32	45.21	25.04	21.20	21.62	23.35	31.90	31.31
Illinois Hub	17.45	18.65	18.49	18.75	16.96	21.87	102.72	33.06	24.89	28.11	26.05	27.77	70.43	24.15	21.88	19.98	18.71	18.54	17.53	41.75	15.93	8.20	17.72	15.47	26.88	25.92
Michigan Hub	18.80	22.17	20.82	23.03	21.06	25.53	110.46	35.29	26.64	30.27	28.19	30.27	77.58	26.51	25.09	25.26	22.28	21.28	43.53	46.04	25.51	21.56	22.02	24.01	32.22	31.71
Minnesota Hub	17.85	18.79	18.31	18.48	19.98	29.18	27.66	49.40	25.16	36.50	37.74	39.87	94.51	24.52	19.31	19.64	18.16	18.05	20.44	41.40	22.31	18.11	16.96	14.85	27.80	31.38
Wisconsin PS	18.43	19.19	19.09	19.00	17.58	23.48	72.85	36.89	26.72	31.10	29.31	31.16	77.75	25.84	22.07	29.19	20.16	19.73	29.08	44.64	24.52	20.05	18.13	14.81	28.78	30.40
Forecasted Load (GW)	3.0	6.0	9.0	12.0	15.0	18.0	21.0	24.0	27.0	30.0	33.0	36.0	39.0	42.0	45.0	48.0	51.0	54.0	57.0	60.0	63.0	66.0	69.0	72.0		
Forecast Error %	#####	#####	-90.5%	-83.9%	-80.2%	-77.8%	-76.1%	-74.9%	-73.9%	-73.2%	-72.5%	-72.0%	-71.6%	-71.3%	-70.9%	-70.7%	-70.4%	-70.2%	-70.0%	-69.9%	-69.7%	-69.6%	-69.4%	-69.3%		

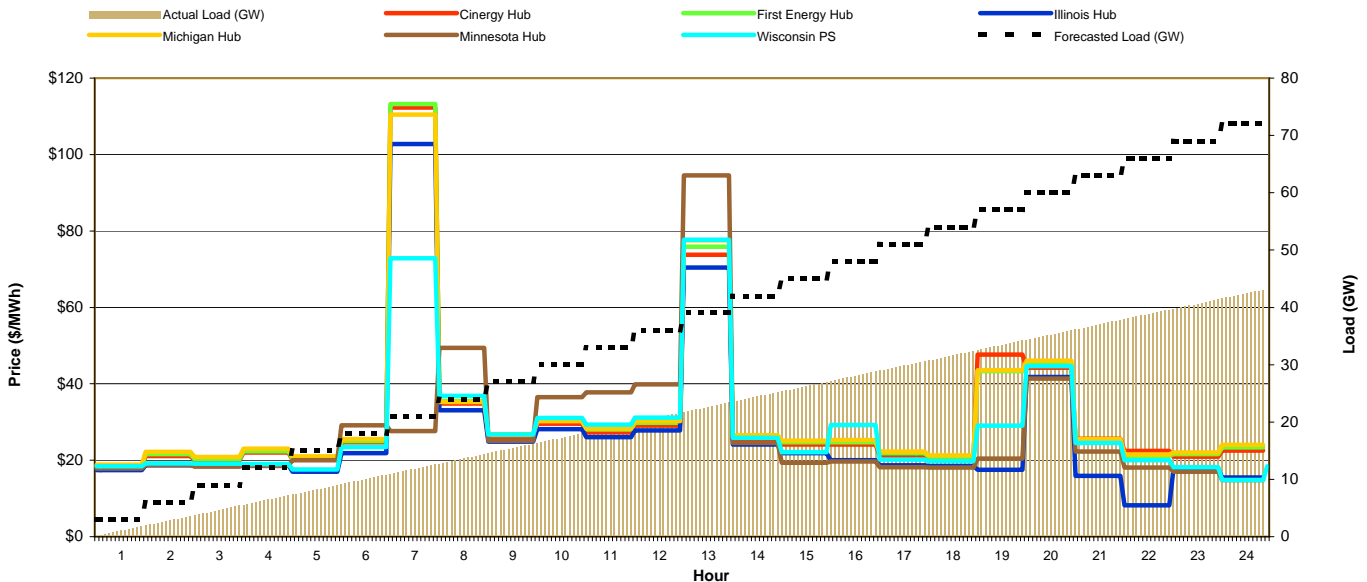




# MISO Daily Report

Saturday March 27, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	25.98	25.18	24.87	24.63	25.09	27.52	30.71	29.02	33.84	34.87	33.18	29.09	26.82	24.83	23.89	23.16	23.04	23.85	25.17	34.89	29.79	27.34	24.07	22.44	27.22	27.93
First Energy Hub	25.21	24.48	24.14	24.01	24.40	26.95	31.38	31.83	35.42	36.15	34.90	31.99	28.52	27.05	25.97	25.38	25.13	25.99	29.00	35.21	30.12	27.55	23.79	22.15	28.20	29.63
Illinois Hub	17.00	16.95	16.78	16.89	16.69	19.78	22.81	23.96	28.96	29.81	28.16	25.98	23.76	21.79	20.87	20.43	20.67	21.41	22.35	30.14	26.27	23.67	18.94	17.55	22.15	24.20
Michigan Hub	25.21	24.46	24.13	24.01	24.43	26.92	33.60	37.16	37.94	38.12	37.85	37.23	31.34	31.01	29.68	29.39	28.81	29.76	36.28	35.52	30.38	27.68	23.79	22.16	30.29	32.62
Minnesota Hub	16.76	15.66	15.70	15.56	15.92	17.34	18.79	20.14	23.58	29.41	28.67	27.10	25.14	22.67	21.74	21.60	21.40	22.55	22.64	31.70	27.08	21.33	16.33	15.31	21.42	23.94
Wisconsin PS	18.39	17.40	17.15	16.98	17.12	19.82	23.05	24.73	29.96	32.51	31.38	28.31	26.40	23.76	22.77	22.37	22.51	23.30	23.55	33.86	28.93	24.54	19.56	17.92	23.59	26.15
Cleared Load (GW)	1.0	4.0	7.0	10.0	13.0	16.0	19.0	22.0	25.0	28.0	31.0	34.0	37.0	40.0	43.0	46.0	49.0	52.0	55.0	58.0	61.0	64.0	67.0	7.0		

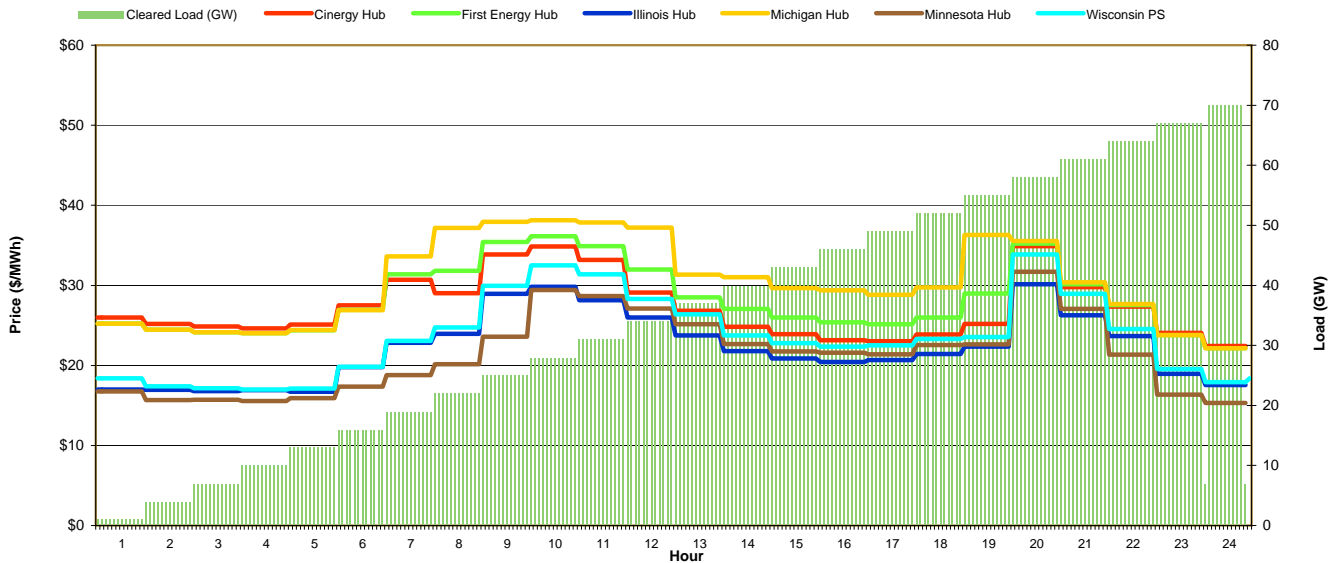

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	20.95	21.63	22.89	22.89	26.99	21.16	24.73	30.22	27.17	25.94	27.00	48.59	22.97	22.69	20.47	20.51	20.66	21.99	21.90	26.26	23.04	40.63	19.16	22.27	25.11	26.20
First Energy Hub	21.50	22.25	23.64	23.63	27.98	21.75	25.34	28.21	26.19	24.71	26.31	50.17	22.67	23.46	21.09	21.10	21.24	22.61	22.48	26.92	23.66	41.72	19.67	22.99	25.47	26.39
Illinois Hub	18.16	17.57	15.82	16.48	14.97	17.06	19.94	7.51	13.44	11.25	15.31	46.25	14.80	21.66	19.64	19.68	19.82	21.03	21.10	25.28	22.14	38.96	18.39	17.50	19.74	21.02
Michigan Hub	21.87	22.71	24.27	24.22	29.03	22.28	25.92	28.74	26.64	25.05	26.73	51.06	23.05	23.77	21.34	21.37	21.56	22.93	22.97	27.61	24.20	42.57	19.90	23.45	25.97	26.84
Minnesota Hub	16.39	16.00	14.40	14.69	12.71	16.37	18.97	22.15	21.81	21.85	23.44	45.11	20.53	21.25	18.98	18.92	18.93	18.89	20.01	23.78	21.24	37.45	17.74	16.88	20.77	23.26
Wisconsin PS	18.07	17.17	14.70	15.38	12.47	17.20	20.08	24.12	23.84	23.83	25.40	48.58	21.97	22.70	20.49	20.54	20.70	21.44	22.03	26.44	23.27	40.92	19.31	17.41	22.42	25.35
Forecasted Load (GW)	3.0	6.0	9.0	12.0	15.0	18.0	21.0	24.0	27.0	30.0	33.0	36.0	39.0	42.0	45.0	48.0	51.0	54.0	57.0	60.0	63.0	66.0	69.0	72.0		
Forecast Error %	#####	#####	-90.5%	-83.9%	-80.2%	-77.8%	-76.1%	-74.9%	-73.9%	-73.2%	-72.5%	-72.0%	-71.6%	-71.3%	-70.9%	-70.7%	-70.4%	-70.2%	-70.0%	-69.9%	-69.7%	-69.6%	-69.4%	-86.9%		

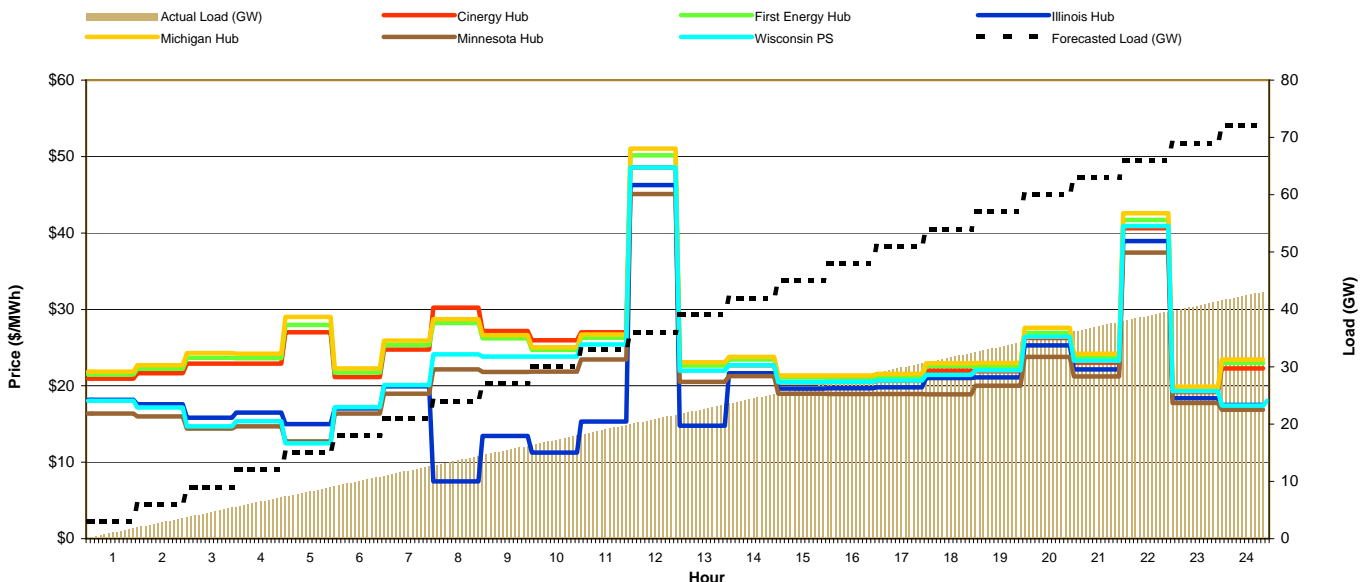




# MISO Daily Report

Sunday March 28, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	20.74	20.74	20.78	20.60	20.82	21.24	24.17	23.97	24.93	25.51	25.93	25.23	25.21	24.10	23.45	24.85	25.18	25.64	28.98	35.55	31.52	26.94	24.67	23.14	24.75	26.35
First Energy Hub	20.63	20.58	20.76	20.60	20.84	21.14	23.75	23.89	24.87	25.53	26.01	25.32	25.30	24.26	23.63	24.36	24.75	25.22	28.83	35.98	31.99	27.25	24.18	22.58	24.68	26.34
Illinois Hub	15.68	15.26	15.00	14.24	13.93	14.43	16.41	17.70	18.42	19.41	20.16	19.65	19.55	19.28	19.01	16.74	17.34	17.79	22.34	30.31	27.48	23.03	17.88	16.29	18.64	20.38
Michigan Hub	20.65	20.57	20.82	20.70	20.97	21.23	23.83	23.96	24.95	25.64	26.14	25.51	25.52	24.47	23.83	24.58	24.97	25.45	29.09	36.30	32.28	27.49	24.30	22.69	24.83	26.53
Minnesota Hub	16.32	15.57	15.59	15.45	15.70	16.36	18.83	19.79	21.73	23.60	24.50	24.71	24.96	23.81	21.70	21.20	22.30	22.88	25.94	36.50	33.43	26.36	20.37	18.82	21.93	24.61
Wisconsin PS	17.76	17.36	16.75	16.40	16.28	17.20	21.04	21.48	22.87	24.24	25.66	25.21	25.41	24.02	23.29	23.01	23.44	23.91	27.60	45.01	42.34	30.53	21.87	20.22	23.87	26.87
Cleared Load (GW)	1.0	4.0	7.0	10.0	13.0	16.0	19.0	22.0	25.0	28.0	31.0	34.0	37.0	40.0	43.0	46.0	49.0	52.0	55.0	58.0	61.0	64.0	67.0	7.0		

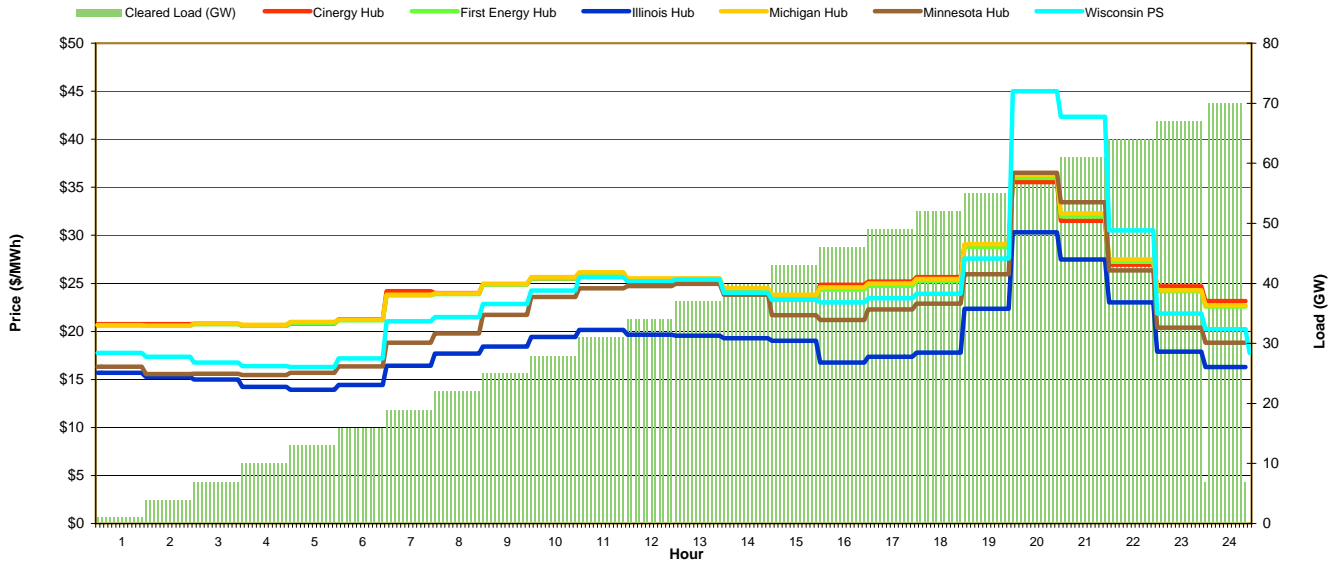

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	22.76	21.19	18.69	16.03	16.72	19.12	21.50	22.17	21.93	21.87	22.50	24.25	22.86	22.06	22.92	19.85	20.69	21.41	22.82	25.60	25.37	23.56	20.70	20.08	21.53	22.54
First Energy Hub	23.56	21.87	19.26	16.44	17.15	19.69	22.18	22.77	22.44	22.43	23.16	24.98	23.57	22.79	24.00	20.53	21.34	22.07	23.50	26.36	26.11	24.29	21.34	20.69	22.19	23.23
Illinois Hub	14.69	15.89	15.06	15.43	16.06	17.08	16.10	17.62	20.51	20.68	20.73	21.53	21.01	20.57	9.57	17.80	19.05	20.14	21.52	24.44	24.28	22.63	19.95	19.35	18.82	20.13
Michigan Hub	24.33	22.45	19.66	16.55	17.22	19.85	22.56	23.17	22.75	22.76	23.54	25.41	23.84	23.00	25.00	20.90	21.72	22.44	23.85	26.56	26.48	24.65	21.64	21.01	22.56	23.61
Minnesota Hub	14.79	16.07	15.33	17.33	20.67	26.09	18.32	17.89	20.01	20.08	20.04	21.01	20.48	20.01	9.29	21.81	18.65	19.75	20.99	24.44	25.03	23.10	19.82	18.99	19.58	20.15
Wisconsin PS	13.83	15.66	15.18	16.30	17.18	18.61	15.98	17.64	21.30	21.54	21.44	22.20	21.83	21.44	7.22	18.94	19.86	21.17	22.55	25.99	26.08	24.10	20.96	20.19	19.46	20.89
Forecasted Load (GW)	3.0	6.0	9.0	12.0	15.0	18.0	21.0	24.0	27.0	30.0	33.0	36.0	39.0	42.0	45.0	48.0	51.0	54.0	57.0	60.0	63.0	66.0	69.0	72.0		
Forecast Error %	#####	#####	-90.5%	-83.9%	-80.2%	-77.8%	-76.1%	-74.9%	-73.9%	-73.2%	-72.5%	-72.0%	-71.6%	-71.3%	-70.9%	-70.7%	-70.4%	-70.2%	-70.0%	-69.9%	-69.7%	-69.6%	-69.4%	-69.4%	-86.9%	

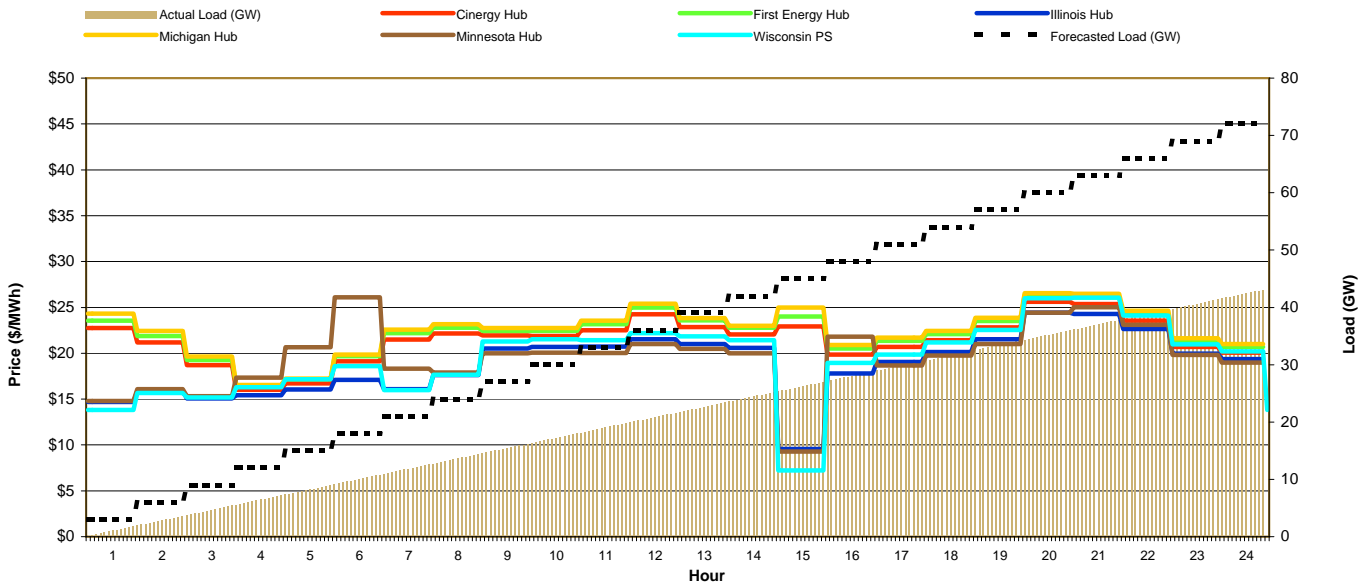




# MISO Daily Report

Monday March 29, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	21.73	21.60	21.69	21.53	24.32	35.00	45.93	44.74	40.96	39.86	40.56	37.43	32.90	33.20	30.19	31.32	29.62	29.90	33.11	43.12	37.43	27.52	25.94	24.93	32.27	34.86
First Energy Hub	21.80	21.57	21.73	21.59	24.12	33.98	46.68	45.90	42.00	40.73	41.43	38.28	33.68	33.92	30.81	30.79	29.24	29.70	32.95	43.15	37.36	27.91	25.80	25.02	32.51	35.23
Illinois Hub	17.74	17.40	17.56	17.60	18.02	22.28	42.10	42.58	38.93	36.51	36.95	34.56	30.67	30.42	27.29	20.82	20.26	22.94	26.33	35.66	30.46	24.31	20.94	18.69	27.13	29.98
Michigan Hub	21.93	21.68	21.84	21.69	24.28	34.19	47.08	46.29	42.36	41.08	41.79	38.61	33.97	34.22	31.08	31.07	29.52	29.98	33.25	43.53	37.69	28.16	25.81	25.18	32.76	35.53
Minnesota Hub	17.23	16.64	16.73	16.38	17.88	21.90	42.41	42.51	38.90	42.00	43.63	40.47	35.94	36.40	33.12	28.72	27.50	26.81	32.04	44.18	38.12	28.32	22.66	19.86	30.43	35.08
Wisconsin PS	18.06	17.87	17.85	17.72	19.43	25.54	46.89	45.13	41.17	40.43	41.23	38.05	33.34	33.74	30.75	31.57	30.45	31.06	32.31	41.39	35.69	28.02	22.79	19.38	30.83	34.82
Cleared Load (GW)	49.3	48.7	49.2	49.4	52.0	60.1	66.2	67.1	68.1	68.0	67.4	67.1	66.3	64.9	63.8	62.9	62.3	62.2	63.7	66.7	65.1	62.2	57.3	5.4		

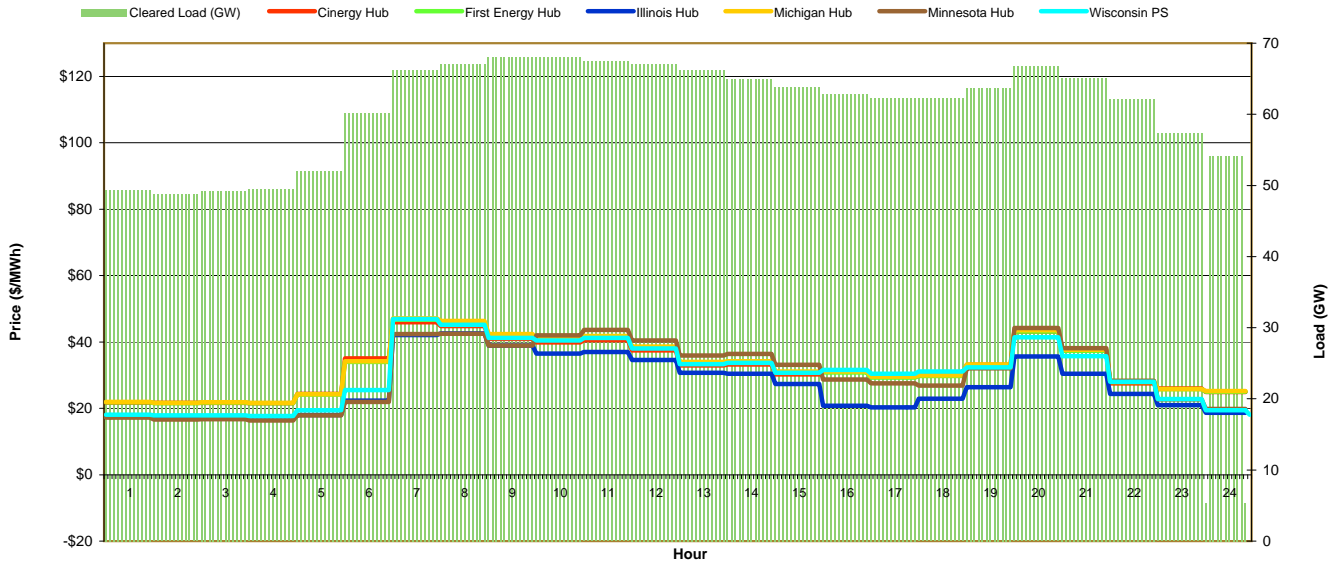

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	20.38	20.24	19.96	19.72	20.07	38.11	31.06	26.77	26.28	116.29	30.61	41.01	49.68	72.52	31.48	20.47	27.97	27.40	30.16	38.27	29.08	27.22	24.80	21.21	33.78	38.75
First Energy Hub	20.98	20.81	20.51	20.24	20.54	39.34	31.73	27.51	27.05	120.15	31.62	42.36	49.81	74.18	32.69	21.25	26.90	28.65	31.94	39.41	30.12	28.54	26.37	24.02	34.86	39.91
Illinois Hub	19.61	19.43	19.13	18.70	18.99	22.40	29.30	25.60	25.22	111.61	29.46	39.45	41.64	66.47	28.26	18.35	14.58	23.94	25.67	35.28	27.31	22.94	19.64	13.46	29.85	34.71
Michigan Hub	21.37	21.25	20.88	20.56	20.92	41.01	32.38	27.77	27.14	120.22	31.88	43.12	51.01	76.64	33.75	21.92	27.28	29.37	32.71	40.29	30.82	29.49	27.43	25.17	35.60	40.68
Minnesota Hub	19.34	18.97	18.66	18.21	18.44	20.99	28.45	25.37	25.17	112.39	29.42	31.98	42.33	65.43	28.33	24.23	20.90	22.63	16.38	-19.22	21.46	14.17	15.39	17.36	26.53	29.77
Wisconsin PS	20.45	20.20	19.97	19.57	19.90	20.43	31.18	27.71	27.37	120.89	31.89	42.78	38.59	70.14	27.35	18.27	16.52	21.86	20.40	67.10	30.34	17.80	12.97	1.11	31.03	37.00
Forecasted Load (GW)	53.4	52.8	52.7	52.3	54.5	59.9	66.5	69.2	69.6	69.5	69.0	68.2	67.3	66.4	65.2	64.3	63.9	63.8	65.1	68.0	67.6	64.4	60.5	57.0		
Forecast Error %	-4.1%	-4.0%	-3.9%	-1.2%	-0.2%	0.7%	-0.4%	-1.3%	-0.9%	-0.7%	0.0%	0.2%	0.3%	0.1%	-0.4%	-1.5%	-1.8%	-3.2%	-2.9%	-1.8%	-2.0%	-2.6%	-12.6%			

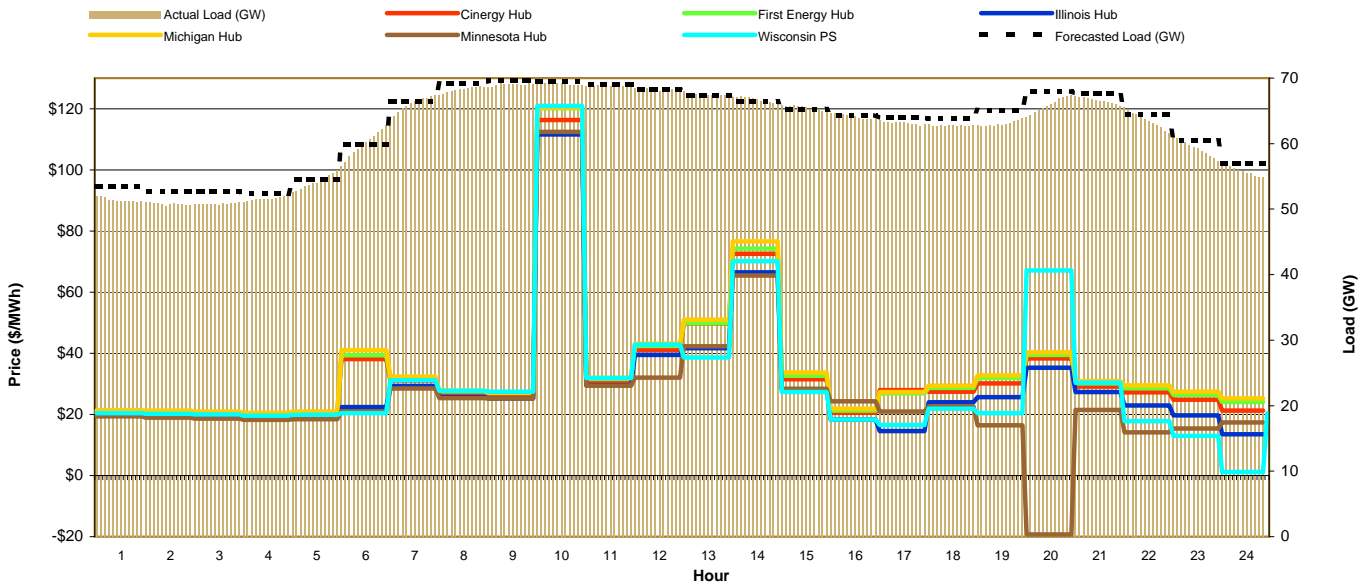




# MISO Daily Report

Tuesday March 30, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	23.42	22.21	21.90	22.86	25.05	37.00	48.35	36.26	36.08	37.11	36.88	32.62	31.70	29.66	27.97	27.32	26.77	26.48	28.75	38.67	31.59	26.21	24.27	23.30	30.10	31.15
First Energy Hub	23.65	22.53	22.25	23.16	24.84	36.64	46.49	37.26	36.62	37.26	37.27	32.97	31.80	29.77	28.05	27.24	26.74	26.27	28.40	37.79	31.64	26.29	24.23	23.19	30.10	31.23
Illinois Hub	16.74	16.58	16.53	16.12	16.37	21.84	30.87	34.28	30.94	27.30	29.76	26.24	23.61	22.15	20.85	19.67	18.45	17.67	18.43	24.40	24.49	19.82	16.50	14.16	21.82	23.41
Michigan Hub	23.87	22.72	22.43	23.44	25.01	37.08	46.71	37.67	37.01	37.67	37.67	33.32	32.14	30.08	28.35	27.53	27.06	26.55	28.71	38.20	31.96	26.57	24.35	23.39	30.40	31.55
Minnesota Hub	16.99	16.08	15.46	16.16	17.73	18.84	24.51	30.96	30.00	30.30	31.32	27.45	25.25	24.99	22.56	22.16	21.43	20.89	21.16	27.32	26.77	20.00	18.41	18.12	22.70	25.06
Wisconsin PS	16.97	16.61	16.49	16.53	17.72	24.91	42.17	43.89	43.16	42.80	43.58	38.08	37.79	34.29	32.95	31.04	29.15	30.13	31.83	41.14	33.96	30.26	20.49	17.81	30.57	35.28
Cleared Load (GW)	51.6	50.9	51.0	51.7	54.9	61.4	68.2	68.8	68.8	68.6	68.6	67.5	66.9	66.1	64.9	63.8	62.9	62.3	63.7	67.6	65.9	62.2	56.9	5.4		

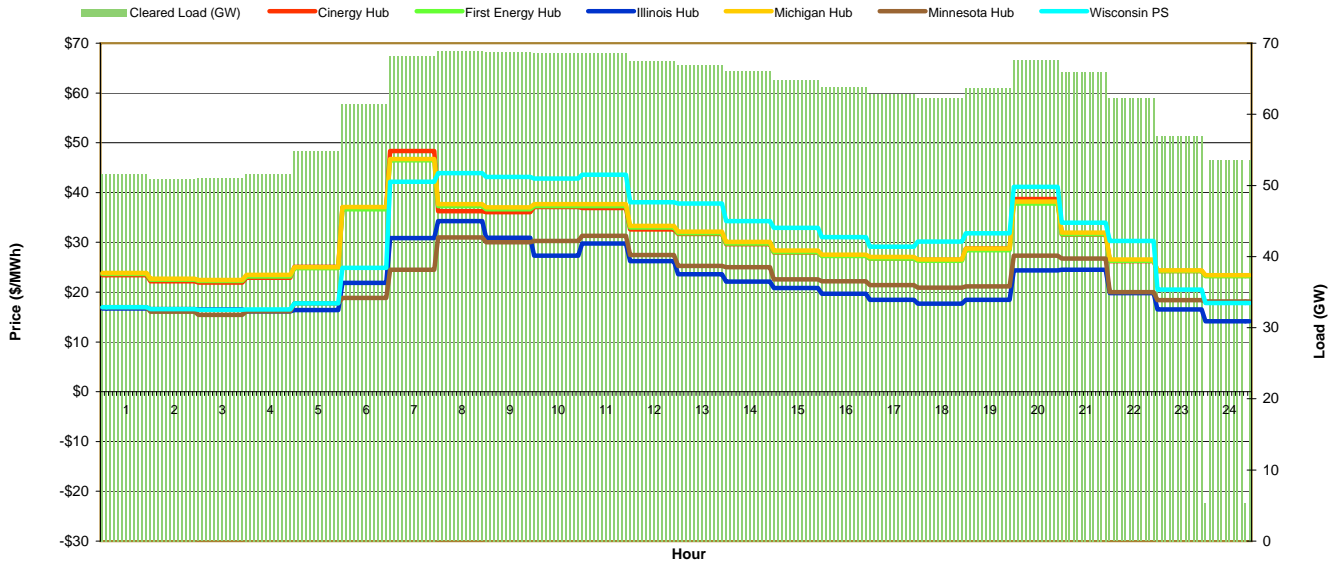

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	22.09	15.74	18.41	20.78	14.42	54.43	32.99	36.64	25.59	26.55	23.80	33.18	26.03	25.43	24.87	21.37	20.87	19.29	21.64	24.02	21.42	17.28	-4.35	10.07	23.02	22.73
First Energy Hub	24.85	23.15	25.65	20.36	12.88	53.88	32.33	38.03	25.66	26.45	22.07	30.64	26.15	26.07	25.74	22.12	21.61	19.98	22.35	24.71	22.12	17.74	-5.93	10.36	23.71	22.84
Illinois Hub	17.53	12.60	16.14	18.69	12.58	35.22	27.99	28.36	20.80	23.24	0.66	2.68	16.79	22.15	20.64	18.41	18.29	17.38	18.73	22.06	19.80	16.40	-9.59	5.68	16.80	16.05
Michigan Hub	25.76	24.27	29.16	32.00	25.37	60.02	36.30	39.31	26.51	31.26	22.78	31.61	26.96	27.00	26.77	22.93	22.26	20.46	22.94	25.28	22.63	18.24	-4.31	10.65	26.10	23.91
Minnesota Hub	5.39	-6.55	-5.02	-2.38	-8.31	34.13	27.57	22.43	26.87	17.73	29.95	21.83	17.87	18.72	20.82	13.29	17.13	17.28	23.78	20.92	28.43	15.74	-11.20	-6.78	14.15	18.85
Wisconsin PS	8.58	-2.77	-0.66	2.15	-4.37	37.92	28.30	26.83	25.71	21.10	21.33	22.57	20.46	21.08	14.08	14.04	15.14	15.96	15.87	23.00	21.60	17.24	-23.64	3.42	14.37	17.02
Forecasted Load (GW)	54.7	53.7	53.3	53.9	56.2	61.2	67.3	69.3	69.3	69.0	68.5	67.7	67.0	66.3	65.1	64.2	63.8	63.6	64.6	67.1	66.8	63.9	60.1	56.3		
Forecast Error %	-2.1%	-2.1%	-2.3%	-1.6%	-1.0%	-0.1%	-1.3%	-1.5%	-1.4%	-1.4%	-1.6%	-1.5%	-1.3%	-1.3%	-1.2%	-1.5%	-2.4%	-3.0%	-4.3%	-3.2%	-2.4%	-3.0%	-4.1%	-4.0%		

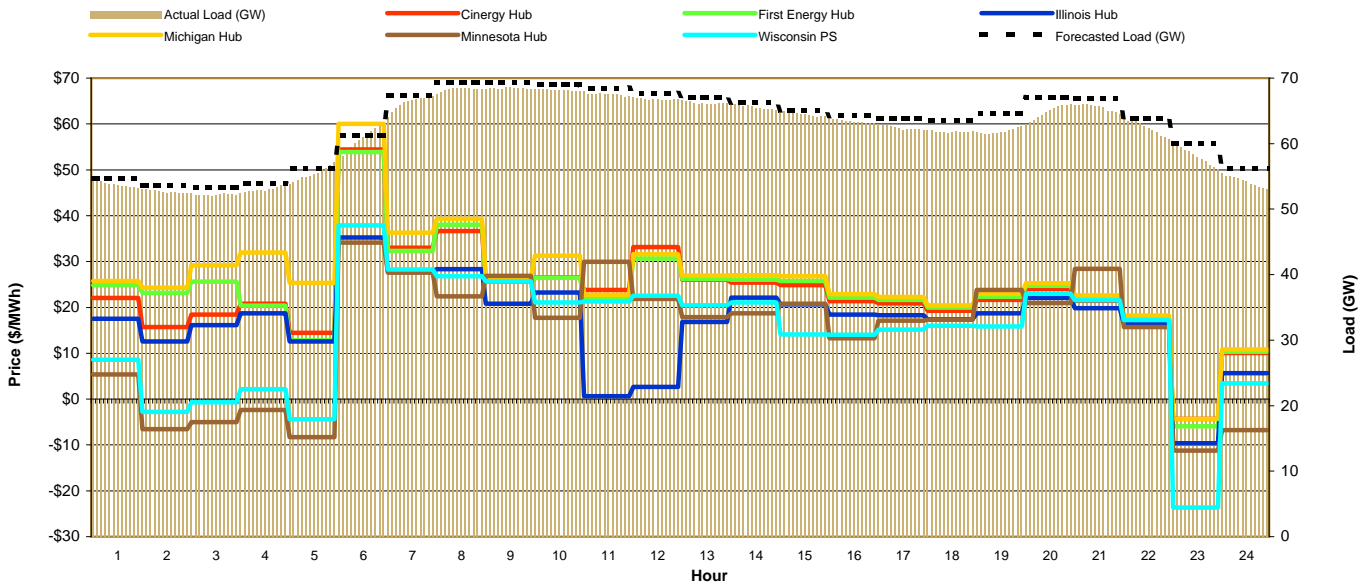




# MISO Daily Report

Wednesday March 31, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%

## Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$			
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk		
Cinergy Hub	20.71	19.28	19.60	19.89	21.33	34.21	37.45	30.36	32.04	34.42	34.85	32.16	32.34	30.30	29.11	27.79	26.61	26.53	27.43	36.09	29.39	24.17	20.79	20.77	27.82	29.65		
First Energy Hub	20.48	19.18	19.55	19.73	21.04	33.82	36.68	31.06	32.77	34.17	34.67	32.08	32.23	30.36	29.20	27.94	27.03	27.02	28.04	36.48	30.16	24.88	21.14	20.37	27.92	29.95		
Illinois Hub	14.91	14.65	14.11	14.47	15.00	19.16	23.54	26.90	28.95	22.64	23.34	22.13	22.04	22.02	21.26	22.04	23.12	23.49	25.10	31.12	27.44	22.84	19.33	16.02	21.48	23.99		
Michigan Hub	20.59	19.27	19.70	19.86	21.15	34.22	36.93	31.37	33.09	34.48	34.98	32.37	32.52	30.64	29.47	28.20	27.27	27.26	28.29	36.82	30.43	25.10	21.21	20.46	28.15	30.22		
Minnesota Hub	10.83	10.00	9.64	9.52	10.51	14.97	19.69	26.00	28.05	22.09	22.36	27.61	20.81	20.10	20.01	19.80	19.52	19.56	19.82	26.49	21.16	24.05	18.37	16.49	19.06	22.24		
Wisconsin PS	14.86	13.92	13.23	13.74	14.58	20.06	27.40	30.55	33.21	34.44	35.20	31.74	32.91	33.84	32.73	28.22	27.13	27.18	28.20	35.78	30.54	24.56	20.12	18.24	25.93	30.39		
Cleared Load (GW)	49.8	48.8	48.9	48.9	51.6	60.3	65.6	66.3	66.6	66.6	66.7	66.5	66.2	65.5	64.3	63.4	62.2	61.8	62.6	65.9	64.8	60.5	55.2	5.2				

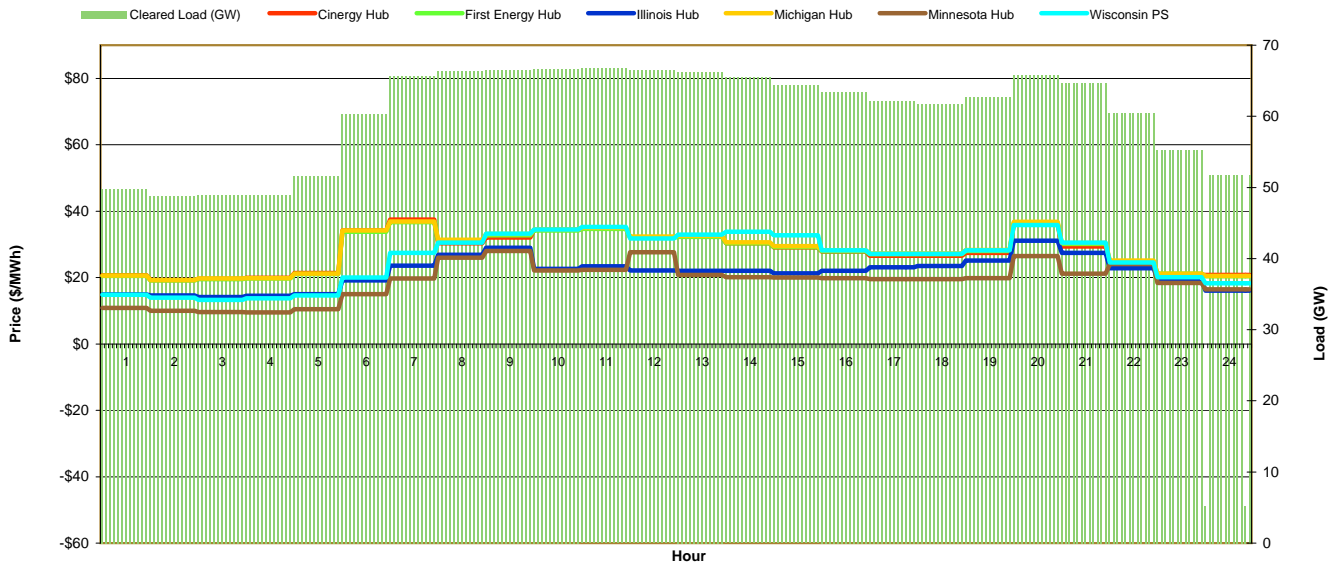

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$			
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk		
Cinergy Hub	16.87	15.93	7.47	18.02	24.62	81.60	23.79	27.20	25.41	22.91	21.70	21.58	21.67	22.91	23.64	21.93	21.66	20.47	20.56	25.87	23.32	19.80	17.22	18.04	23.51	22.37		
First Energy Hub	17.44	16.91	10.01	20.60	26.52	77.63	23.87	27.35	26.03	23.41	22.33	22.18	22.23	22.86	23.98	22.47	21.19	20.59	18.21	25.85	23.89	20.32	17.69	19.51	23.88	22.54		
Illinois Hub	11.97	11.47	-15.89	-4.49	7.73	14.09	21.30	22.30	22.70	21.05	20.62	20.54	20.56	23.38	23.13	20.89	20.74	19.59	19.76	24.58	21.53	18.84	16.43	15.83	16.61	21.04		
Michigan Hub	18.00	17.37	11.77	22.19	31.29	82.59	24.17	27.65	26.52	23.79	22.66	22.50	22.60	23.64	24.68	22.90	22.52	21.17	21.24	26.91	24.32	20.52	17.77	19.74	24.94	23.21		
Minnesota Hub	-0.15	1.58	-33.36	-14.58	-1.64	13.56	21.06	19.65	19.49	21.71	20.61	20.73	19.41	-58.67	-9.30	21.33	21.37	20.14	20.38	25.00	24.26	19.21	16.30	11.21	9.14	13.85		
Wisconsin PS	11.12	3.53	-35.76	-17.37	-3.00	14.56	23.66	23.24	21.80	23.11	22.07	22.09	23.64	71.64	43.62	22.63	22.52	21.42	21.72	27.02	24.69	20.62	17.74	13.29	18.31	26.85		
Forecasted Load (GW)	53.6	52.3	51.7	52.1	54.3	59.1	64.6	66.6	67.1	67.3	67.3	67.2	66.9	66.2	65.6	64.9	64.4	64.0	64.4	66.7	66.4	63.4	59.5	55.6				
Forecast Error %	-3.1%	-3.3%	-3.4%	-2.9%	-2.7%	-1.3%	-1.6%	-2.1%	-2.4%	-2.3%	-2.3%	-2.2%	-1.5%	-1.9%	-2.5%	-3.0%	-3.6%	-4.6%	-3.8%	-2.7%	-3.3%	-5.3%	-5.2%					

