




MISO Daily Report

Saturday May 1, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$			
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk		
Cinergy Hub	20.25	19.00	18.81	18.55	18.77	19.63	22.01	25.35	28.99	30.76	33.11	34.37	33.05	30.80	30.32	30.64	30.93	29.75	27.86	37.02	37.84	28.30	21.46	21.00	27.02	30.66		
First Energy Hub	21.42	20.83	22.20	21.98	22.20	23.13	22.88	27.42	30.77	32.56	34.85	35.45	33.66	32.38	31.84	32.54	32.68	31.77	30.13	37.64	38.32	30.69	23.57	22.36	28.89	32.27		
Illinois Hub	16.34	15.63	14.21	13.96	14.37	16.99	14.16	17.38	21.77	24.81	25.91	26.66	26.37	25.21	24.97	25.39	24.93	24.40	23.57	29.07	29.53	24.36	19.68	16.85	21.52	24.63		
Michigan Hub	25.93	27.57	35.33	35.25	35.33	35.49	28.92	37.35	38.53	39.23	41.92	40.38	36.45	38.00	37.17	39.13	39.18	38.86	37.56	40.95	41.20	38.25	30.21	27.66	36.08	38.40		
Minnesota Hub	19.22	19.22	19.13	18.52	18.68	20.31	23.97	27.39	33.57	37.17	41.00	41.00	38.23	34.94	32.38	29.90	31.61	29.64	28.35	36.26	38.90	28.47	20.26	19.19	28.64	33.07		
Wisconsin PS	16.01	15.22	15.06	14.62	14.76	16.29	18.95	21.41	26.37	28.64	30.86	31.46	29.17	26.85	26.12	25.85	25.81	25.73	24.99	32.29	36.41	26.40	19.30	17.86	23.60	27.35		
Cleared Load (GW)	45.6	44.5	44.3	43.9	44.5	48.0	49.9	53.8	57.6	59.3	60.0	60.3	59.9	59.0	58.9	58.7	59.0	58.5	57.1	58.9	59.5	56.8	50.2	4.6				

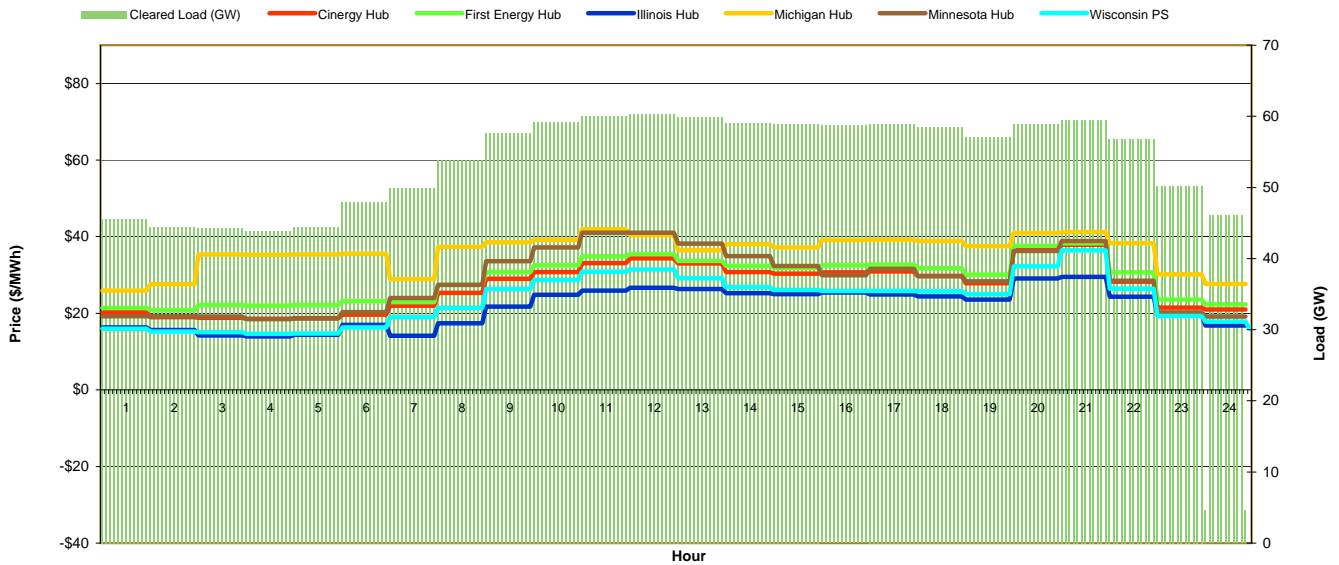

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$			
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk		
Cinergy Hub	22.96	20.36	19.17	19.60	25.26	20.20	19.05	23.02	24.57	24.77	24.47	23.81	23.41	23.89	26.10	23.78	23.61	22.72	23.79	24.18	38.15	23.93	22.03	21.72	23.52	24.76		
First Energy Hub	33.33	20.79	19.56	20.05	37.56	20.72	19.53	23.60	25.29	25.55	25.28	24.62	24.20	24.66	26.48	24.51	24.32	23.40	24.45	24.97	39.51	24.74	22.69	22.34	25.09	25.52		
Illinois Hub	16.22	17.97	17.99	18.70	17.43	19.33	18.24	21.99	23.55	23.83	23.49	22.79	22.34	22.79	25.47	22.70	22.56	21.75	22.80	23.15	36.63	23.06	21.21	20.85	21.95	23.76		
Michigan Hub	71.75	21.23	19.84	20.39	80.81	20.83	19.71	23.81	25.49	25.71	25.30	24.56	24.16	24.79	26.84	24.66	24.42	23.50	24.63	25.13	39.74	24.94	22.93	22.57	28.66	25.66		
Minnesota Hub	22.16	22.33	17.83	24.10	18.73	18.93	18.58	21.45	22.85	23.29	24.55	37.73	49.28	41.35	8.85	19.48	19.84	20.20	19.76	22.60	36.51	23.82	21.12	20.41	23.99	25.79		
Wisconsin PS	16.60	17.74	18.09	18.89	17.69	19.59	18.56	22.40	24.02	24.38	24.25	23.35	22.02	15.63	-30.41	17.93	18.98	20.41	18.44	23.54	37.69	23.88	21.61	20.94	19.01	19.26		
Forecasted Load (GW)	51.1	49.1	47.9	47.3	47.6	48.7	49.1	52.0	55.0	57.3	58.6	58.9	59.1	58.9	58.7	58.9	59.0	58.7	57.9	58.1	59.5	57.6	53.8	50.7				
Forecast Error %	-1.5%	-1.3%	-1.2%	-1.2%	-1.0%	-0.2%	1.5%	0.9%	1.1%	0.7%	-0.1%	-0.4%	-1.5%	-2.2%	-2.5%	-3.1%	-3.2%	-3.3%	-2.1%	-1.4%	-1.6%	-1.4%	-1.2%	-11.7%				

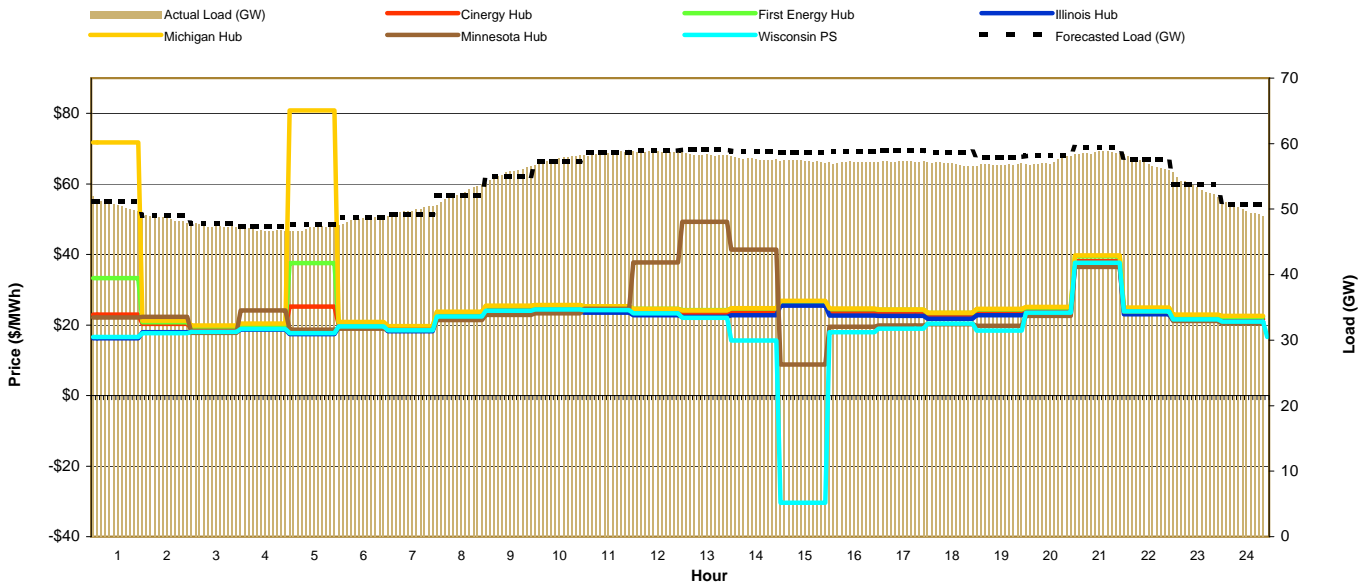




MISO Daily Report

Sunday May 2, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	21.00	19.84	19.10	19.12	19.37	19.66	22.00	23.41	25.96	27.72	28.64	28.92	29.20	28.64	28.41	28.18	28.74	28.38	28.25	37.09	39.37	29.37	23.18	21.41	26.04	28.97
First Energy Hub	22.26	20.63	20.99	22.76	23.51	21.51	24.22	24.50	27.85	30.51	31.08	31.46	31.84	31.09	30.63	29.81	30.31	30.37	29.92	38.34	40.60	31.97	29.96	24.70	28.37	31.27
Illinois Hub	16.72	16.23	15.92	15.48	15.46	18.07	16.97	21.38	24.24	25.26	26.80	26.96	27.23	25.97	25.43	25.45	26.55	25.58	25.52	35.79	38.05	27.42	18.62	15.18	23.18	26.64
Michigan Hub	26.85	23.71	27.86	36.26	38.99	27.35	32.86	26.80	32.40	38.51	37.27	38.09	38.75	37.95	36.92	33.91	33.70	35.71	33.93	38.94	40.74	38.59	55.15	38.19	35.39	37.34
Minnesota Hub	19.30	18.51	17.93	17.52	17.63	18.32	19.56	21.33	23.23	26.15	27.19	27.69	29.11	27.82	27.51	27.89	28.06	27.73	28.61	33.56	36.79	28.46	20.25	18.87	24.54	27.59
Wisconsin PS	16.27	16.00	15.94	15.63	15.44	15.79	17.31	19.57	21.86	23.11	23.91	23.93	24.15	23.55	23.41	23.33	23.84	24.76	28.16	30.05	35.35	29.03	19.12	18.04	21.98	24.82
Cleared Load (GW)	45.0	43.8	43.5	43.2	43.8	44.8	46.9	49.3	53.0	54.4	55.8	56.2	56.4	56.1	56.0	55.7	56.6	56.3	55.9	58.6	59.2	56.0	51.4	4.8		

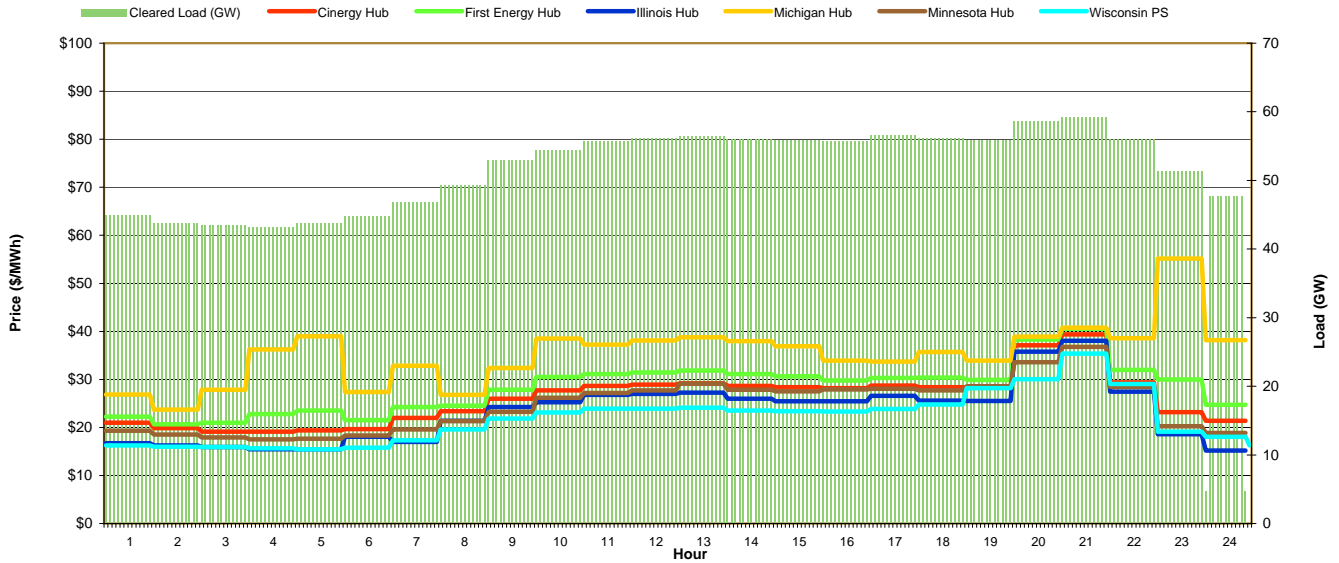

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	19.43	18.30	16.83	18.61	17.83	18.77	18.60	24.65	23.86	26.49	27.38	28.10	39.12	24.91	24.10	24.49	37.99	27.99	25.32	22.95	95.05	25.63	18.30	18.56	26.80	31.02
First Energy Hub	19.91	18.67	17.08	18.80	18.04	19.04	18.90	25.03	24.14	26.86	27.85	28.63	39.94	25.39	24.58	24.97	38.79	28.57	25.86	23.48	97.60	26.25	18.56	18.75	27.32	31.66
Illinois Hub	18.68	17.66	16.23	17.95	17.15	18.09	17.91	23.70	22.98	25.49	26.34	27.01	37.60	24.05	23.23	23.53	36.50	26.89	24.33	22.05	90.86	24.55	17.77	17.97	25.77	29.81
Michigan Hub	20.14	18.89	17.31	19.08	18.26	19.16	19.01	25.15	24.20	26.99	28.00	28.80	40.14	25.39	24.57	24.89	38.62	28.41	25.75	23.37	97.21	26.23	18.67	18.94	27.38	31.65
Minnesota Hub	18.26	17.51	16.14	17.99	17.45	18.74	18.36	24.35	23.47	25.77	26.43	36.87	92.18	27.04	22.93	22.98	36.52	28.26	32.61	24.32	87.31	24.51	17.90	19.03	29.04	34.59
Wisconsin PS	18.70	17.78	16.35	18.13	17.44	18.52	18.31	24.30	23.56	26.11	26.98	28.75	44.37	24.98	23.63	23.89	37.08	27.51	25.84	22.37	93.54	25.57	18.25	18.58	26.69	31.04
Forecasted Load (GW)	48.4	46.7	45.6	45.2	45.5	46.2	47.0	48.6	51.3	53.3	54.5	55.2	55.1	55.0	54.6	54.7	55.0	55.2	56.0	58.1	56.9	53.6	50.9			
Forecast Error %	-2.4%	-2.1%	-1.8%	-1.7%	-2.2%	-1.8%	-2.2%	-0.5%	-0.5%	-0.2%	0.3%	1.0%	1.6%	1.6%	1.9%	2.8%	3.6%	4.3%	4.6%	4.9%	3.4%	1.8%	0.9%			-10.8%

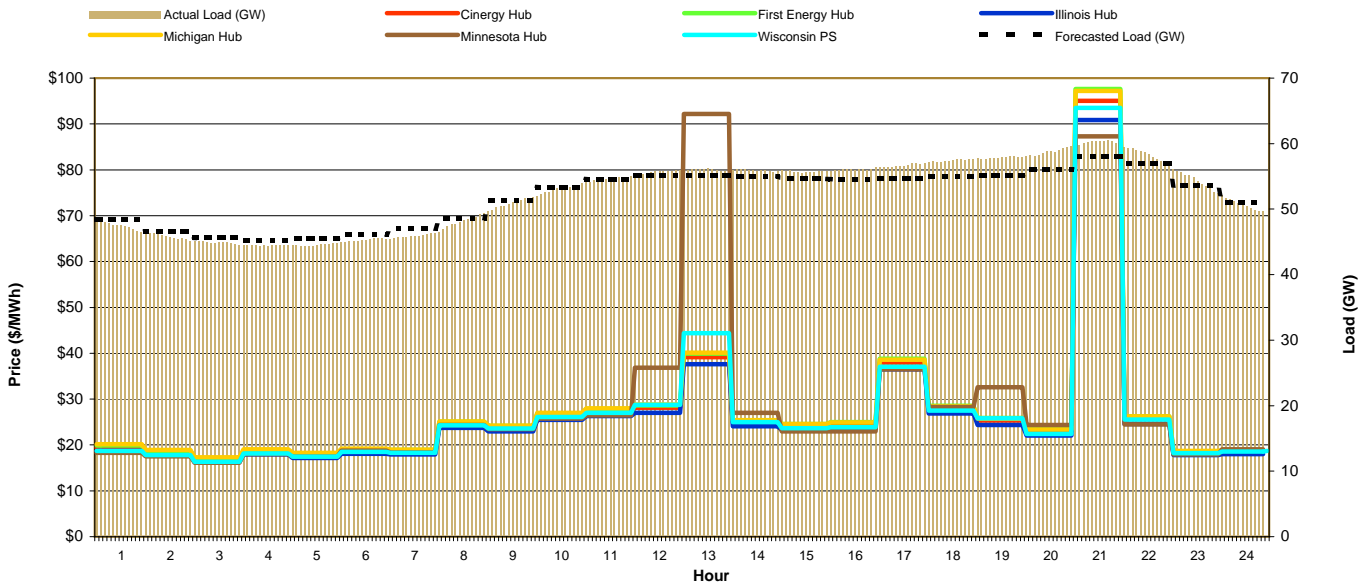




MISO Daily Report

Monday May 3, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	19.04	18.86	18.05	18.26	19.85	24.24	26.50	31.23	33.79	38.92	40.00	41.13	41.19	41.03	40.88	40.65	37.33	32.16	29.42	35.96	40.00	26.60	23.22	21.39	30.82	35.84
First Energy Hub	21.62	22.47	20.87	20.76	20.84	26.57	29.61	33.50	35.24	40.53	41.48	42.49	42.53	42.45	42.41	42.17	39.26	34.69	32.07	37.13	41.30	28.97	24.37	24.01	32.81	37.54
Illinois Hub	16.72	16.24	15.91	16.27	16.10	22.23	24.36	29.48	32.32	37.40	38.53	38.99	39.55	37.79	35.80	34.53	32.37	29.93	27.47	34.72	38.56	24.40	21.95	18.47	28.34	33.36
Michigan Hub	30.58	35.40	30.66	29.29	24.66	33.95	38.13	38.30	36.49	41.98	42.31	42.68	42.68	42.64	42.60	42.59	41.61	40.07	38.24	37.24	41.42	34.43	27.01	33.21	37.01	39.52
Minnesota Hub	18.33	17.61	17.13	17.37	18.55	22.24	25.95	31.11	34.60	38.96	40.37	41.74	39.66	39.46	37.32	36.54	35.53	32.41	29.66	36.47	40.59	27.58	22.84	20.19	30.09	35.30
Wisconsin PS	17.24	16.68	16.36	16.74	17.49	20.81	25.89	31.26	34.49	39.61	40.85	41.39	43.69	41.93	40.41	38.28	34.44	31.78	29.21	36.78	40.90	26.53	22.55	19.54	30.20	35.88
Cleared Load (GW)	47.3	46.1	45.8	46.4	47.9	55.5	61.3	64.3	65.6	67.2	67.9	68.2	68.6	68.1	67.4	66.9	66.4	65.4	64.1	65.3	65.8	62.0	56.7	5.3		

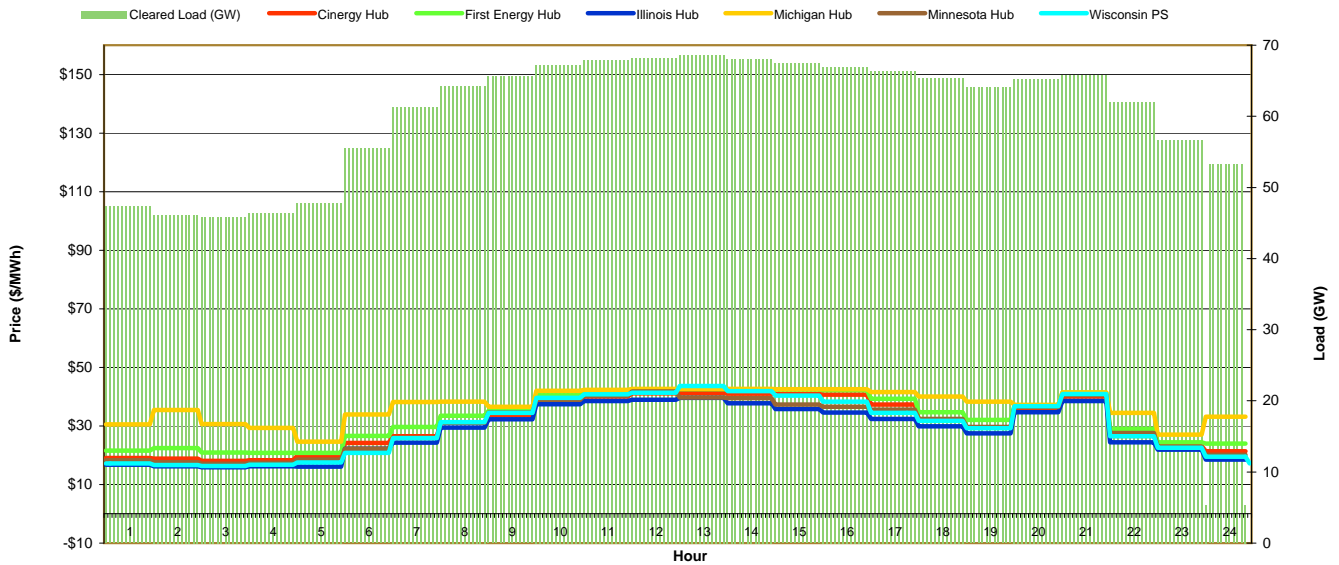

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	23.98	19.29	19.53	19.12	19.89	22.79	30.05	91.89	154.16	29.97	43.00	62.39	40.78	62.06	70.83	40.25	51.89	47.14	49.39	108.94	57.66	27.26	22.29	20.40	47.29	59.99
First Energy Hub	39.72	19.49	19.77	19.38	20.20	23.16	30.66	93.94	158.32	30.74	44.21	64.19	41.97	63.80	72.75	41.41	53.02	48.13	50.42	111.62	59.00	27.84	22.74	20.73	49.05	61.51
Illinois Hub	14.03	18.54	18.69	18.22	18.94	21.73	28.71	88.20	148.03	25.56	39.67	57.63	38.42	58.15	35.34	-0.10	40.49	30.88	41.46	99.01	54.39	26.07	21.38	19.56	40.13	50.29
Michigan Hub	99.03	19.75	20.02	19.69	20.44	23.31	30.79	94.06	158.16	30.72	44.09	63.85	41.60	63.28	72.48	41.26	53.09	48.15	50.73	111.93	59.15	28.00	22.86	20.87	51.55	61.46
Minnesota Hub	17.04	18.80	18.85	18.29	19.07	21.75	28.26	88.25	150.24	25.81	40.51	47.72	23.57	54.07	38.09	20.09	32.70	38.95	48.10	105.77	56.48	28.04	29.42	20.00	41.24	51.74
Wisconsin PS	14.58	18.99	19.07	18.55	19.40	22.35	29.75	92.26	155.85	22.28	74.77	93.68	69.52	83.11	99.66	61.30	36.16	27.13	26.06	89.92	55.07	27.04	23.19	20.06	49.99	64.81
Forecasted Load (GW)	49.4	48.2	47.7	48.1	50.0	54.1	58.8	62.3	64.3	65.8	66.9	67.4	67.8	68.2	67.2	66.6	65.9	64.8	63.8	63.8	65.1	62.4	58.4	54.4		
Forecast Error %	-2.2%	-2.1%	-1.8%	-1.6%	-0.9%	0.7%	0.5%	1.4%	1.7%	1.5%	1.0%	1.2%	1.1%	0.4%	0.9%	1.0%	1.3%	1.6%	1.9%	1.5%	0.9%	-1.3%	-11.5%			

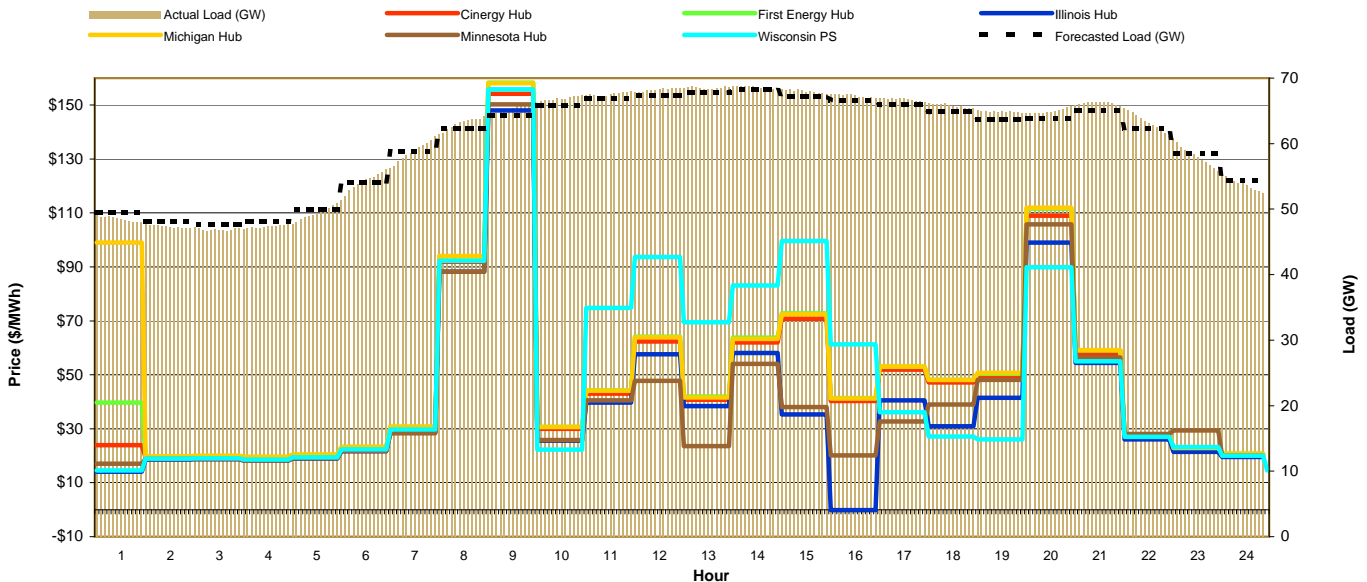




MISO Daily Report

Tuesday May 4, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	Day																								Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	20.94	19.98	19.32	19.62	20.74	24.02	29.50	33.73	37.00	43.47	47.13	50.87	51.13	51.09	49.93	46.42	46.21	40.38	33.81	44.85	45.50	31.90	22.91	22.02	35.52	42.27
First Energy Hub	24.65	23.45	22.39	23.10	24.15	27.04	33.18	36.08	38.92	45.10	48.89	52.37	50.39	52.88	51.96	48.18	47.93	41.87	35.08	46.51	47.35	33.13	24.04	24.34	37.62	43.79
Illinois Hub	16.86	16.73	16.67	16.56	16.60	20.54	26.06	31.05	34.79	41.17	44.71	46.41	46.08	47.92	47.41	44.14	43.87	38.42	32.16	42.73	43.29	30.33	21.32	17.52	32.64	39.74
Michigan Hub	36.13	30.06	26.88	28.86	31.41	36.00	43.59	40.28	41.21	45.60	49.43	52.96	50.97	53.49	52.09	48.73	48.45	42.35	35.47	47.03	47.50	33.49	25.70	31.89	40.82	44.67
Minnesota Hub	19.65	18.91	18.60	19.06	19.41	23.74	24.68	27.80	27.83	29.41	32.23	38.33	41.50	44.58	45.09	44.90	39.66	26.87	24.31	27.37	32.86	26.10	21.77	20.11	28.95	33.16
Wisconsin PS	17.02	15.88	15.98	16.16	16.19	19.60	30.71	38.00	45.59	57.47	63.41	64.78	60.79	64.69	64.49	59.89	57.80	54.21	42.85	58.22	62.57	39.43	21.20	18.52	41.89	53.46
Cleared Load (GW)	49.8	48.4	47.6	48.1	50.4	56.2	62.5	65.6	66.3	67.4	67.4	67.8	68.6	68.8	68.2	68.0	67.4	66.8	65.6	67.2	68.4	63.9	57.6	5.3		

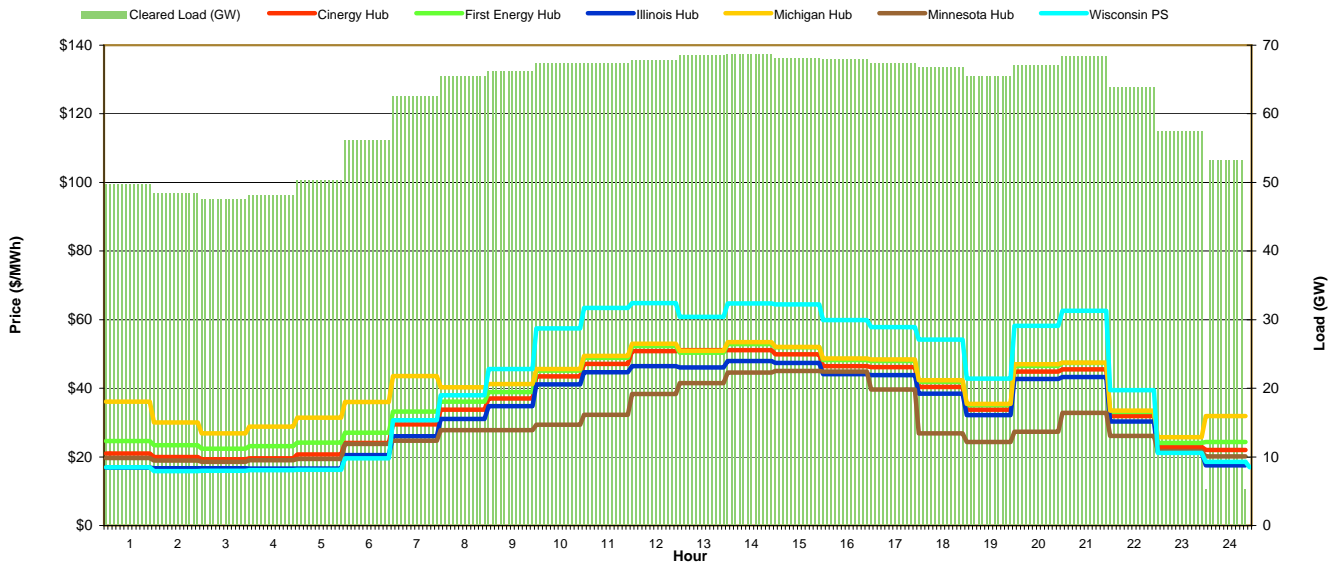

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	Day																								Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	22.02	20.17	21.42	22.73	25.79	29.38	42.81	28.30	54.99	57.26	37.72	69.86	31.86	96.99	39.32	28.39	50.57	37.04	26.38	26.09	28.36	26.88	22.49	21.30	36.17	41.41
First Energy Hub	22.28	20.39	21.65	23.00	26.10	29.83	43.49	28.92	58.72	72.21	41.96	72.90	32.90	114.07	47.07	32.52	59.68	42.31	26.51	24.58	27.91	27.35	22.87	21.65	39.20	45.78
Illinois Hub	19.48	16.80	17.59	19.20	20.90	25.52	37.86	26.94	46.65	21.73	28.09	62.31	14.77	57.04	22.64	21.34	25.71	20.95	24.06	22.36	23.36	25.66	21.49	20.26	26.78	29.07
Michigan Hub	22.58	20.70	22.00	23.34	26.54	30.38	44.13	29.36	56.87	58.71	39.00	72.54	33.07	99.05	40.61	29.53	51.18	37.17	26.59	24.58	27.38	27.46	23.05	21.94	36.99	42.26
Minnesota Hub	20.87	18.89	19.89	21.02	22.67	48.03	39.21	44.13	49.81	33.14	37.51	63.35	27.98	55.21	21.02	26.68	26.33	39.13	24.27	22.38	23.42	26.31	22.33	20.64	31.43	33.94
Wisconsin PS	14.60	8.61	7.44	10.73	10.48	48.49	74.50	46.86	53.00	68.83	59.41	97.74	35.77	80.36	52.40	26.72	55.55	75.06	33.17	22.56	26.83	27.14	22.76	21.24	40.84	49.01
Forecasted Load (GW)	51.9	50.3	49.7	50.8	53.7	57.6	61.7	64.5	66.0	67.2	68.0	68.6	69.0	69.1	68.9	68.5	67.4	66.3	65.5	65.9	66.3	64.3	60.0	55.5		
Forecast Error %	-1.9%	-1.7%	-2.0%	-3.8%	-5.2%	-3.6%	-2.9%	-1.4%	-1.3%	-1.1%	-0.8%	-1.0%	-0.9%	-0.7%	-0.6%	-0.9%	-0.2%	0.0%	0.3%	-0.2%	1.2%	-0.6%	-2.4%	-12.1%		

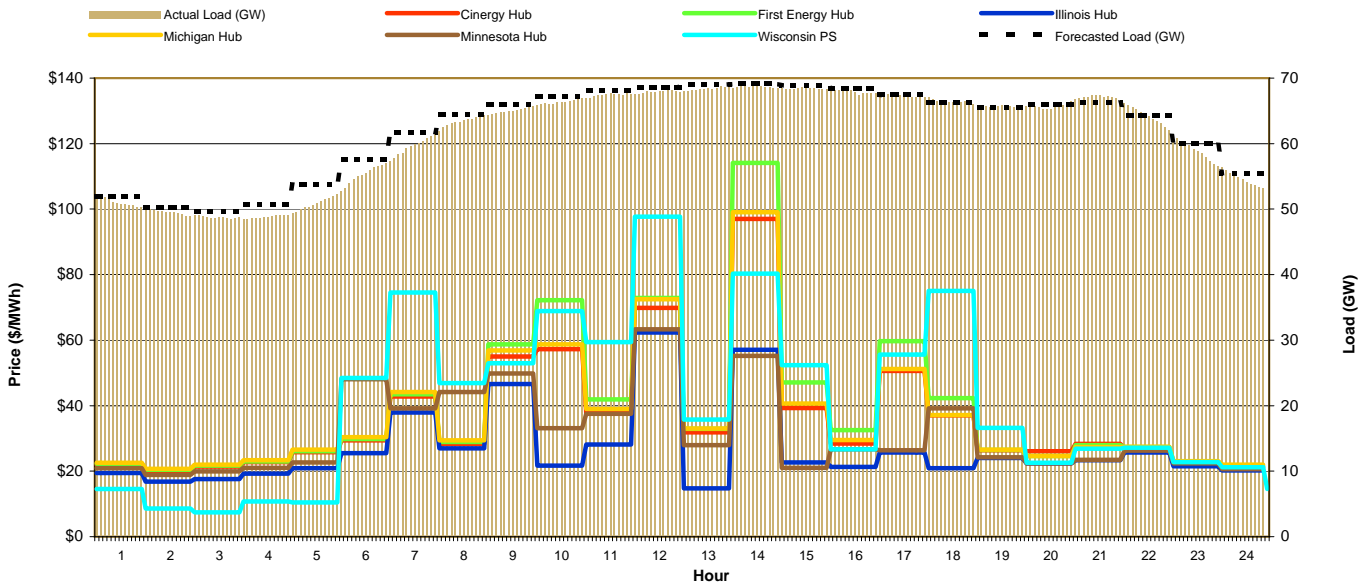




MISO Daily Report

Wednesday May 5, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	20.35	19.48	19.05	19.10	20.29	24.39	29.74	32.81	34.56	40.38	41.62	46.65	47.48	47.93	48.35	51.41	49.23	43.07	33.91	43.55	46.74	29.79	23.40	21.22	34.77	41.31
First Energy Hub	23.09	22.02	21.01	21.40	23.64	27.69	32.63	35.33	36.81	42.14	43.11	48.34	48.95	49.38	49.77	52.94	50.95	44.60	36.02	45.17	48.50	31.69	26.80	24.73	36.95	43.16
Illinois Hub	14.78	14.29	12.61	12.65	13.24	21.31	25.56	29.06	30.34	35.29	36.88	41.61	42.77	42.67	43.14	46.44	45.98	40.20	31.47	41.36	44.39	27.78	20.46	18.24	30.52	37.49
Michigan Hub	32.80	30.91	28.39	30.04	36.19	37.62	40.60	40.84	41.34	44.60	44.34	49.84	49.51	49.94	50.34	53.43	51.29	45.04	39.43	45.68	49.04	34.70	37.30	35.93	41.63	45.42
Minnesota Hub	19.32	18.72	18.47	18.72	19.57	23.76	26.05	26.73	28.41	31.22	32.55	34.30	34.37	34.99	34.08	31.76	27.33	24.59	25.15	30.64	36.17	27.42	23.09	20.44	26.99	30.18
Wisconsin PS	16.94	16.00	15.71	15.59	16.89	27.98	40.04	45.12	51.53	61.70	61.67	63.99	64.33	63.99	61.32	62.10	61.47	47.82	40.90	57.17	58.00	34.96	20.64	18.21	42.67	53.54
Cleared Load (GW)	49.8	48.3	47.5	47.9	50.4	56.2	63.7	66.4	67.3	68.1	69.1	69.4	69.9	70.5	70.0	69.1	68.6	67.5	66.2	67.8	68.8	64.5	57.6	5.3		

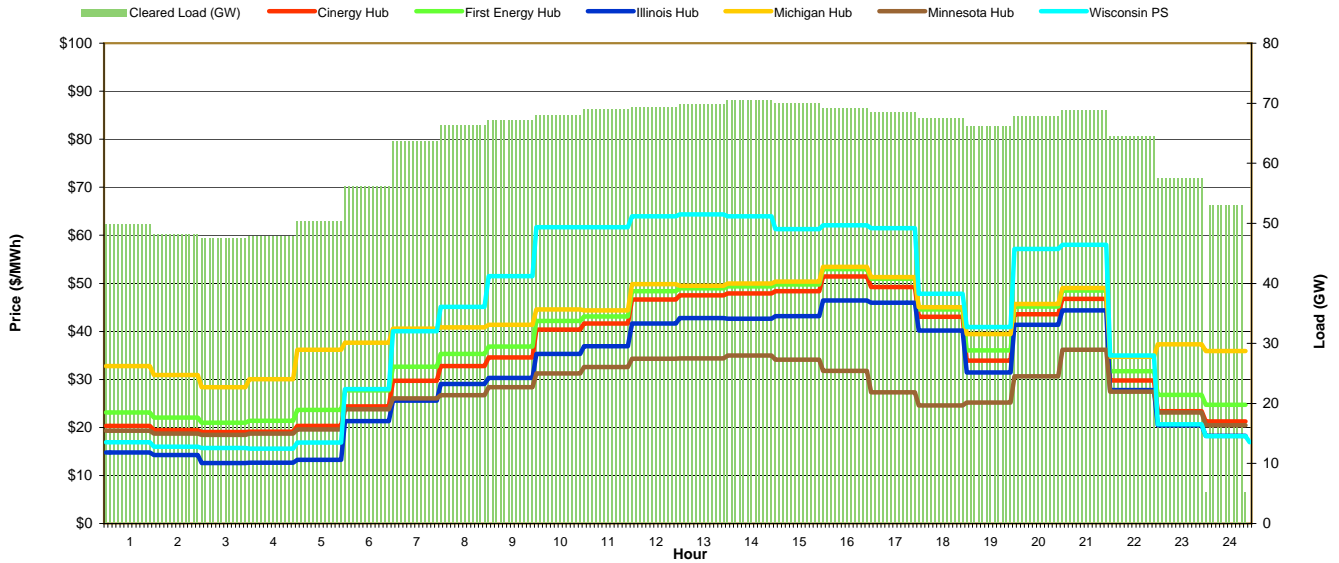

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	20.67	15.89	18.78	8.12	19.55	21.77	26.47	23.86	25.42	32.21	32.93	28.53	27.43	34.46	53.32	58.25	30.66	29.79	35.26	23.68	24.32	24.92	22.62	20.04	27.46	31.73
First Energy Hub	20.31	16.08	18.98	8.20	19.40	20.27	24.89	24.09	25.73	32.70	33.54	29.13	27.98	35.19	54.45	56.99	31.14	30.20	32.83	23.97	24.56	25.11	22.78	20.12	27.44	31.90
Illinois Hub	11.51	14.02	16.91	6.80	15.94	18.85	23.60	22.98	24.61	31.16	31.35	27.53	26.40	32.21	49.41	53.86	28.83	27.08	30.90	20.74	22.94	24.01	21.73	18.97	25.10	29.73
Michigan Hub	29.54	16.39	19.34	8.35	22.73	20.91	25.40	24.59	26.14	33.26	34.10	29.57	28.34	35.69	55.14	62.80	31.17	30.14	35.77	24.05	24.79	25.51	23.37	20.67	28.66	32.78
Minnesota Hub	13.55	15.18	18.01	7.75	17.28	19.58	17.07	26.13	11.69	22.83	21.15	24.79	23.57	23.87	41.07	23.30	6.01	21.05	17.63	12.59	21.98	23.81	21.90	19.26	19.63	21.46
Wisconsin PS	6.57	10.66	14.14	3.96	12.66	30.41	55.67	38.40	57.07	58.25	44.83	30.77	29.43	40.78	55.30	32.37	57.75	31.04	42.86	27.73	23.90	24.91	22.47	18.96	32.12	38.61
Forecasted Load (GW)	53.0	51.3	50.4	50.5	52.2	55.7	60.2	63.8	65.6	66.8	67.7	68.4	69.1	69.4	69.1	68.7	67.9	66.5	65.2	65.3	66.4	63.9	59.9	55.7		
Forecast Error %	-2.8%	-2.8%	-2.7%	-2.0%	-0.3%	-0.5%	-0.4%	-0.1%	-0.1%	0.1%	0.5%	0.6%	0.7%	0.3%	-0.1%	-0.1%	0.7%	1.7%	1.6%	1.4%	0.4%	-2.1%	-12.1%			

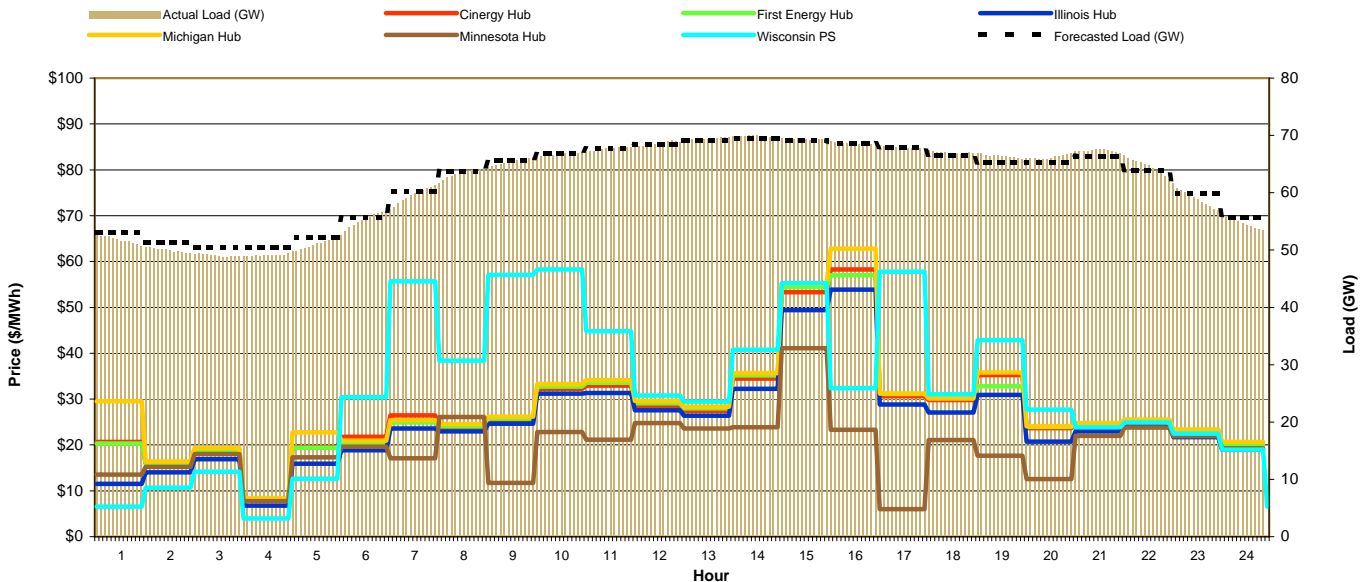




MISO Daily Report

Thursday May 6, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
																									All	On Pk		
Cinergy Hub	21.38	20.67	20.23	20.56	21.67	26.12	29.95	34.95	36.87	40.88	42.37	42.53	42.55	42.77	42.62	42.13	39.99	36.43	31.65	41.19	43.42	28.12	24.29	21.76	33.13	38.30		
First Energy Hub	23.73	23.15	22.18	22.78	23.36	28.81	33.09	37.95	39.28	41.78	43.10	43.12	43.21	43.34	43.12	43.12	40.88	37.69	33.82	41.95	44.02	29.73	26.55	23.34	34.71	39.54		
Illinois Hub	15.50	16.32	15.90	15.88	17.24	22.73	26.28	31.87	34.38	31.84	32.33	32.64	33.78	33.29	32.80	36.08	33.99	31.02	27.15	32.53	35.35	26.07	21.64	19.32	27.33	31.67		
Michigan Hub	32.00	31.15	28.20	30.00	28.28	36.18	41.24	42.71	42.23	43.12	44.25	43.61	43.69	43.82	43.60	43.59	41.33	41.79	38.77	43.16	44.50	31.98	32.15	26.73	38.25	41.52		
Minnesota Hub	19.51	19.10	18.49	18.74	19.59	23.85	25.64	31.56	35.02	37.07	38.29	38.71	38.70	38.90	37.99	37.47	34.88	32.40	29.19	34.21	38.54	25.92	23.03	20.03	29.87	34.49		
Wisconsin PS	15.01	14.73	13.85	14.30	14.90	19.82	27.94	35.28	43.51	46.20	47.76	50.67	48.50	49.05	44.82	42.02	40.80	35.29	28.75	41.26	42.54	26.89	19.92	16.71	32.52	40.20		
Cleared Load (GW)	49.0	47.5	46.6	46.7	48.2	54.2	60.5	63.1	63.4	64.4	64.5	65.7	66.0	65.7	65.1	64.2	64.1	62.9	62.2	64.0	65.0	61.2	55.4	5.1				

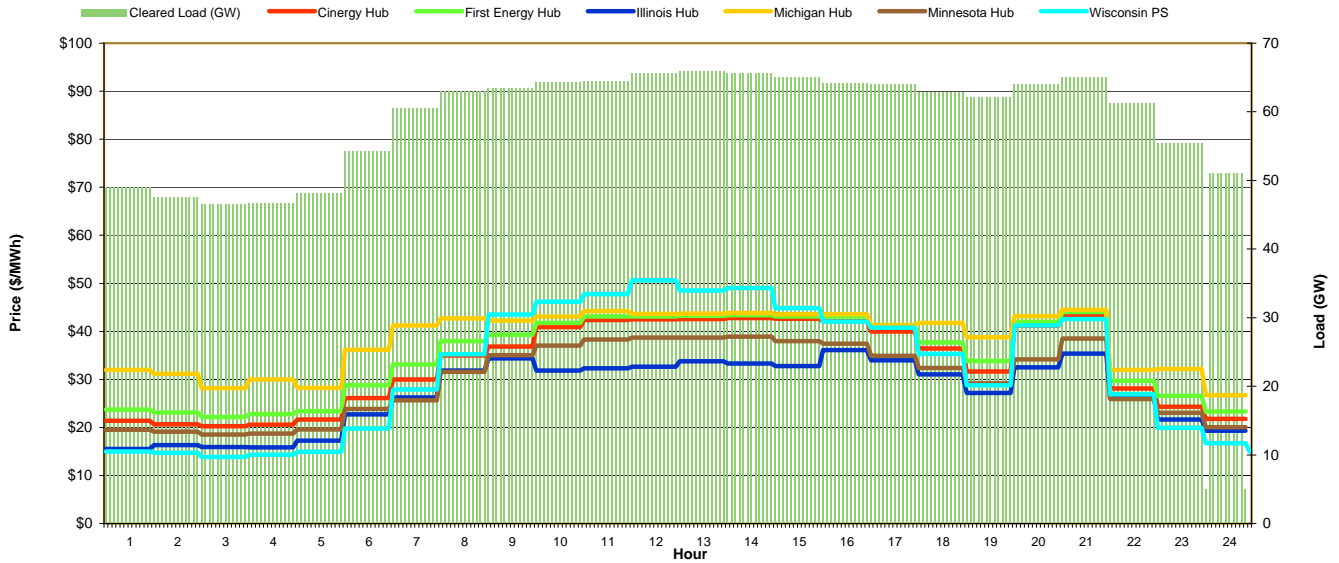

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
																									All	On Pk		
Cinergy Hub	22.84	20.59	20.93	22.43	22.39	23.20	25.60	35.90	50.79	39.74	37.53	44.15	37.74	35.30	73.48	34.44	27.74	80.07	50.23	30.52	89.78	25.71	20.83	19.14	37.13	44.62		
First Energy Hub	24.91	20.65	21.00	22.53	22.76	23.33	25.75	36.19	51.45	40.27	38.08	44.57	38.16	35.70	74.26	34.78	27.96	80.58	50.43	30.75	90.62	25.91	22.30	19.75	37.61	45.13		
Illinois Hub	19.51	19.60	18.44	19.68	20.39	22.18	24.52	34.44	48.68	38.20	36.21	42.58	36.39	34.10	70.82	33.29	26.87	77.27	48.42	29.45	85.63	24.87	21.48	18.58	35.48	43.04		
Michigan Hub	33.44	21.21	21.55	23.06	24.23	23.88	26.21	36.68	51.92	40.46	38.10	44.57	38.13	35.70	74.44	34.85	28.20	81.72	51.41	31.13	91.61	26.24	22.72	20.26	38.41	45.49		
Minnesota Hub	21.05	19.70	19.96	21.28	21.12	22.58	25.06	41.26	60.68	45.42	42.38	45.06	38.28	35.84	73.15	33.56	27.07	77.06	48.34	28.98	85.64	24.77	21.39	19.03	37.44	45.56		
Wisconsin PS	15.95	19.84	13.58	14.36	18.21	23.28	25.89	37.86	54.49	42.32	39.99	45.66	38.80	36.33	74.78	34.62	27.87	79.81	49.71	30.22	85.43	25.73	22.14	17.76	36.44	45.36		
Forecasted Load (GW)	52.8	51.1	50.2	50.4	52.0	55.3	59.9	63.1	64.5	65.4	66.3	66.7	67.0	66.8	66.2	65.5	64.9	64.0	63.2	63.8	64.9	62.3	57.9	54.6				
Forecast Error %	-2.3%	-2.8%	-2.9%	-2.5%	-2.2%	-0.7%	-0.4%	0.1%	0.5%	0.6%	0.0%	-0.4%	-0.7%	-0.5%	-0.3%	-0.2%	-0.2%	0.2%	0.3%	-0.1%	0.9%	0.6%	-0.2%	-11.5%				

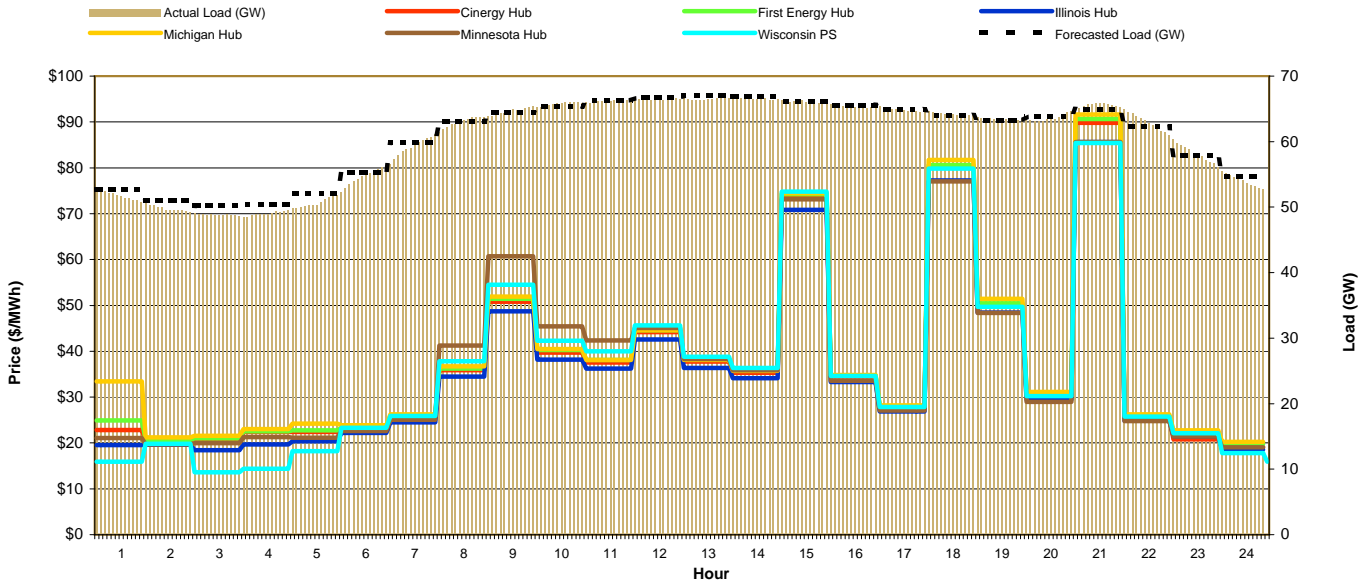




MISO Daily Report

Friday May 7, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	20.93	20.42	20.08	20.38	20.93	24.42	28.69	32.73	34.04	36.73	36.14	36.39	37.97	40.03	39.91	35.88	31.21	27.72	26.71	30.26	35.03	25.65	21.16	20.33	29.32	32.97
First Energy Hub	22.45	22.54	22.00	22.39	22.16	26.73	30.42	33.55	34.66	36.76	37.49	37.48	38.73	40.21	39.86	36.75	32.05	27.74	26.77	31.21	36.23	26.43	22.32	21.33	30.34	33.64
Illinois Hub	16.02	15.95	15.77	15.47	15.77	21.59	19.94	25.12	22.03	20.91	24.10	22.55	22.31	24.66	22.19	23.07	22.44	17.20	17.58	22.66	25.77	19.90	18.90	16.93	20.37	21.96
Michigan Hub	25.82	27.42	26.29	27.12	24.88	32.48	37.14	35.37	36.91	38.82	41.42	41.41	41.86	42.33	42.17	41.16	35.09	30.47	28.91	34.66	40.99	28.90	24.72	23.93	33.76	36.57
Minnesota Hub	19.53	18.80	18.42	18.53	19.19	23.00	25.29	34.29	31.13	32.38	33.57	33.86	35.01	32.21	28.62	25.81	24.81	23.40	22.43	23.51	24.15	24.57	21.55	19.62	25.57	28.21
Wisconsin PS	15.24	15.13	14.29	14.53	15.18	19.49	27.38	33.66	37.94	42.37	42.18	41.68	41.00	44.64	42.16	38.47	34.84	31.44	29.19	34.32	40.18	25.64	20.33	19.16	30.02	36.25
Cleared Load (GW)	49.1	48.0	47.2	47.6	49.1	55.1	61.4	65.0	66.5	67.9	67.7	67.9	67.9	67.5	66.6	65.7	65.0	63.8	62.1	63.9	64.9	60.5	54.0	5.0		

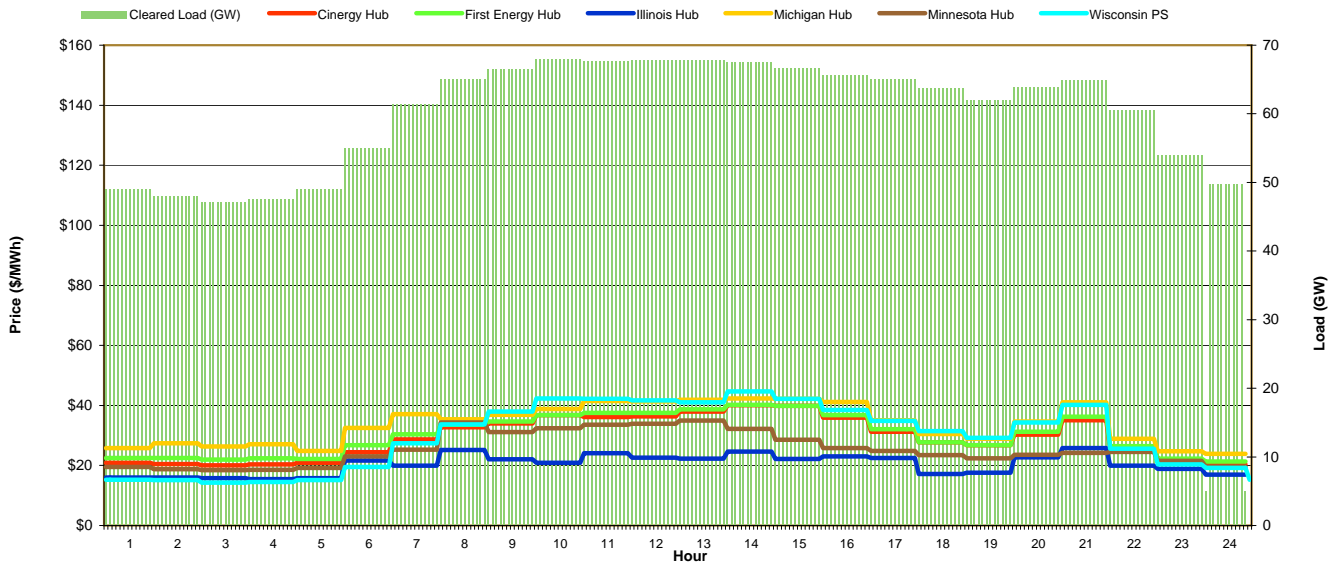

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	19.82	18.97	20.34	21.71	23.06	82.61	24.42	28.48	60.67	32.56	27.34	45.31	33.03	38.25	37.84	39.59	51.11	36.00	29.59	26.23	24.98	20.35	19.96	18.70	32.54	34.46
First Energy Hub	19.94	19.06	20.45	21.84	23.25	83.15	24.57	28.76	61.33	32.91	27.58	45.68	33.74	38.96	38.61	41.14	53.64	39.11	29.90	26.36	25.10	20.38	20.01	18.85	33.10	35.20
Illinois Hub	17.98	16.61	17.74	19.05	19.45	76.29	23.30	27.61	58.61	31.56	26.52	43.78	32.19	37.63	37.86	39.34	48.68	32.86	26.08	21.40	22.40	19.04	17.89	16.24	30.42	32.72
Michigan Hub	20.50	19.60	21.04	22.47	23.94	86.20	25.38	29.66	63.29	33.92	28.44	47.07	34.49	39.74	39.32	42.05	54.95	40.11	30.64	26.86	25.77	20.87	20.55	19.23	34.00	36.11
Minnesota Hub	18.90	18.27	19.44	20.57	21.85	79.69	23.63	28.23	60.46	32.62	35.68	81.29	58.89	58.43	46.45	43.30	50.48	64.17	19.23	16.75	30.44	34.40	33.26	38.09	38.94	43.38
Wisconsin PS	14.50	11.39	12.20	13.49	11.62	70.95	23.55	29.18	62.43	33.44	29.07	70.22	55.10	48.41	44.42	78.89	97.16	42.46	69.85	61.01	60.48	20.29	17.90	10.71	41.19	51.27
Forecasted Load (GW)	51.9	50.5	49.8	50.0	51.2	55.0	59.4	62.7	64.5	65.7	66.3	66.6	66.7	66.5	65.7	64.9	64.0	62.8	62.0	62.5	63.1	60.9	56.5	52.0		
Forecast Error %	-1.8%	-1.9%	-1.7%	-1.6%	0.1%	1.1%	1.4%	1.6%	1.9%	2.0%	2.3%	2.6%	2.5%	2.5%	2.4%	2.2%	2.5%	3.0%	2.8%	1.5%	0.6%	0.1%	0.6%	-7.7%		

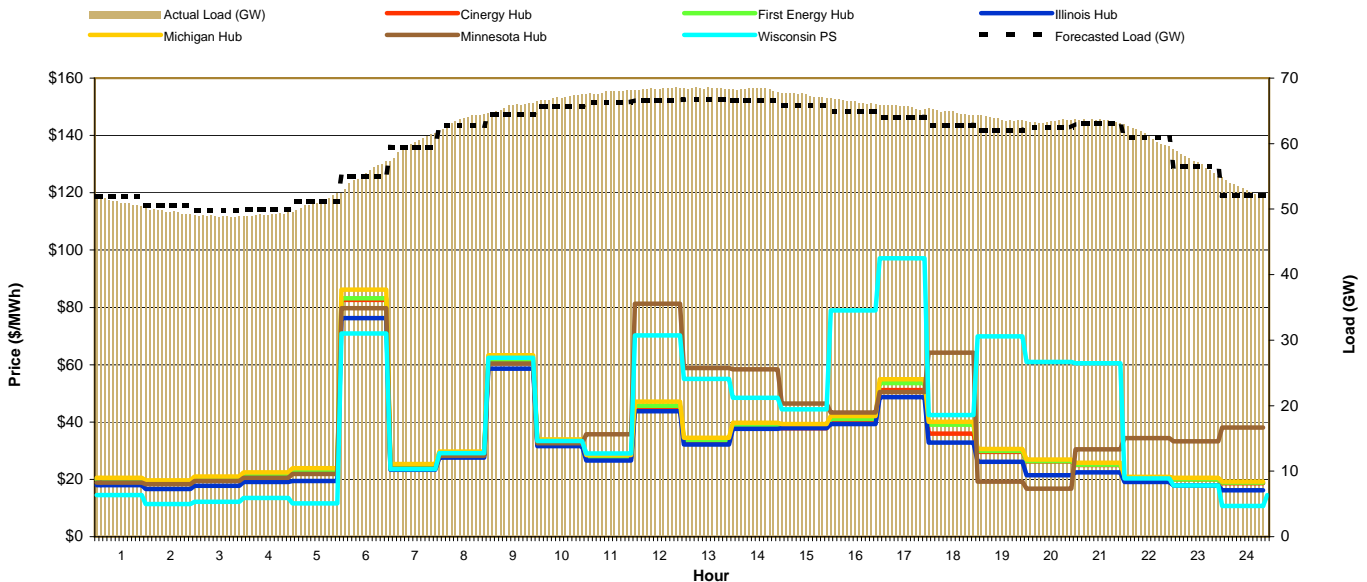




MISO Daily Report

Saturday May 8, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$			
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk		
Cinergy Hub	20.37	19.99	19.25	19.13	19.41	21.45	23.63	29.37	30.00	31.62	32.91	33.72	30.53	29.48	28.52	27.69	28.19	27.92	26.54	33.55	37.65	28.67	23.12	21.43	26.84	29.97		
First Energy Hub	20.83	20.37	20.43	20.91	21.37	22.75	24.18	30.52	31.31	33.88	35.00	35.64	33.03	31.52	30.20	29.14	29.70	29.99	28.09	35.36	38.69	30.19	23.79	21.79	28.28	31.63		
Illinois Hub	18.05	17.89	17.38	16.84	17.11	18.13	20.36	24.06	27.16	27.86	29.15	29.56	27.33	26.60	25.44	25.00	25.42	25.04	24.56	31.45	35.86	26.90	20.62	18.81	24.02	27.00		
Michigan Hub	22.21	21.54	24.68	27.55	28.66	28.30	25.48	33.80	33.54	39.64	40.01	40.22	39.36	36.29	34.01	32.05	32.79	35.09	31.07	38.37	38.47	32.67	26.47	23.45	31.91	35.24		
Minnesota Hub	20.08	19.21	19.22	18.93	19.11	20.07	20.92	25.15	29.30	30.46	31.41	31.65	29.39	28.14	26.37	25.87	26.15	26.07	24.83	31.25	33.66	26.66	21.99	20.41	25.26	28.02		
Wisconsin PS	16.93	16.02	15.58	15.73	15.70	19.11	22.46	26.66	29.40	30.32	31.62	32.55	29.29	28.48	27.36	26.80	27.26	26.91	25.97	33.04	40.14	28.26	22.17	20.62	25.35	29.14		
Cleared Load (GW)	46.4	45.1	44.7	44.8	46.0	48.2	50.8	55.6	58.0	58.2	58.2	58.0	57.0	56.3	55.8	54.8	54.9	54.7	54.2	56.2	58.2	55.2	50.2	4.7				

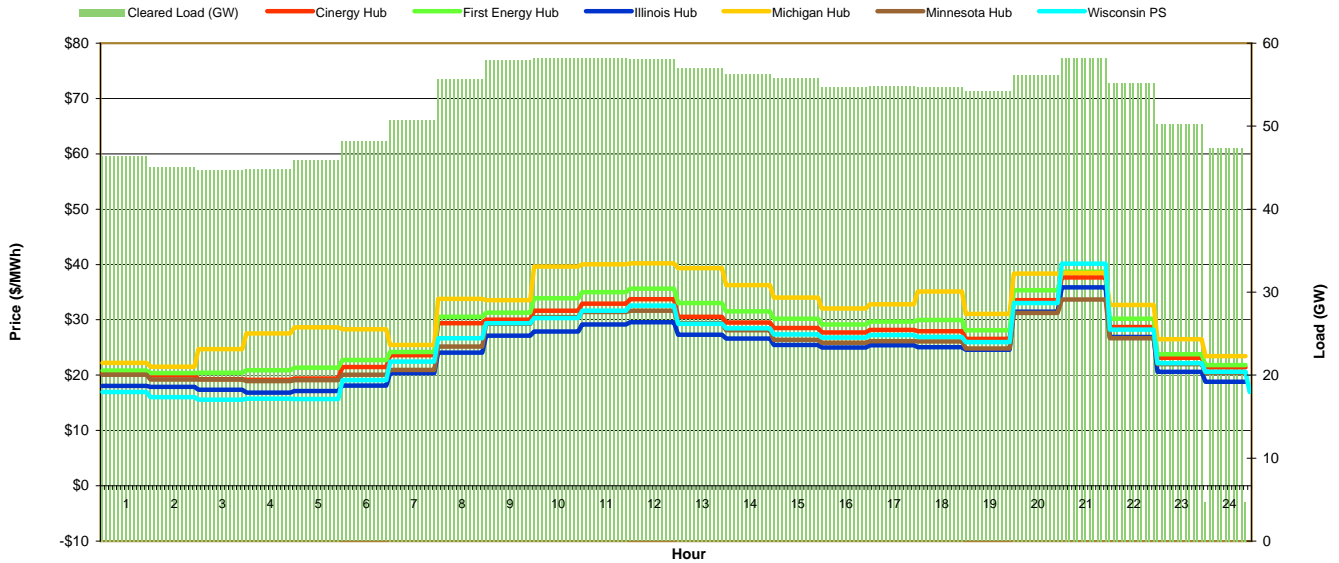

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$			
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk		
Cinergy Hub	21.48	18.28	21.85	19.96	16.09	13.12	28.45	47.02	29.78	26.71	43.39	32.17	40.40	27.26	22.07	24.24	24.74	23.55	23.35	24.29	29.07	27.52	23.01	20.63	26.18	29.29		
First Energy Hub	21.91	18.49	32.51	25.43	17.40	13.25	28.80	47.83	30.25	27.12	44.07	32.70	41.06	26.09	21.80	24.69	25.27	24.00	23.81	24.77	29.63	28.01	23.40	20.96	27.22	29.66		
Illinois Hub	11.56	16.30	14.88	16.05	14.74	12.58	27.19	40.03	28.37	25.56	60.85	41.01	54.34	32.87	21.25	23.35	23.81	22.71	22.55	23.45	28.13	26.75	22.34	19.98	26.28	31.09		
Michigan Hub	22.71	18.90	74.06	46.41	22.09	13.45	29.30	49.10	30.95	27.79	45.11	33.40	41.95	28.36	22.87	25.12	25.73	24.40	24.23	25.14	30.27	28.70	24.04	21.54	30.65	30.45		
Minnesota Hub	39.24	22.07	17.72	27.07	25.60	20.13	35.81	42.36	36.27	29.17	27.36	22.41	26.73	20.88	20.60	22.69	23.15	22.34	22.34	22.60	26.88	26.78	22.82	20.19	25.97	25.96		
Wisconsin PS	-0.09	14.16	14.77	16.23	14.93	12.80	27.46	38.83	28.57	25.95	42.16	31.30	39.49	26.63	21.49	23.59	24.11	23.08	22.96	23.67	28.40	27.30	22.83	20.28	23.79	28.15		
Forecasted Load (GW)	50.5	49.1	48.3	47.9	48.8	50.1	51.6	54.2	56.7	58.0	58.2	57.9	57.2	56.6	55.9	55.7	55.8	55.7	55.7	56.9	57.9	56.4	53.3	50.2				
Forecast Error %	-0.5%	-1.4%	-1.8%	-1.5%	-1.8%	-1.9%	-1.9%	-0.8%	-0.2%	0.2%	0.3%	0.2%	-0.1%	-0.4%	-0.8%	-1.2%	-1.2%	-1.3%	-2.2%	-0.3%	0.3%	0.2%	-9.3%					

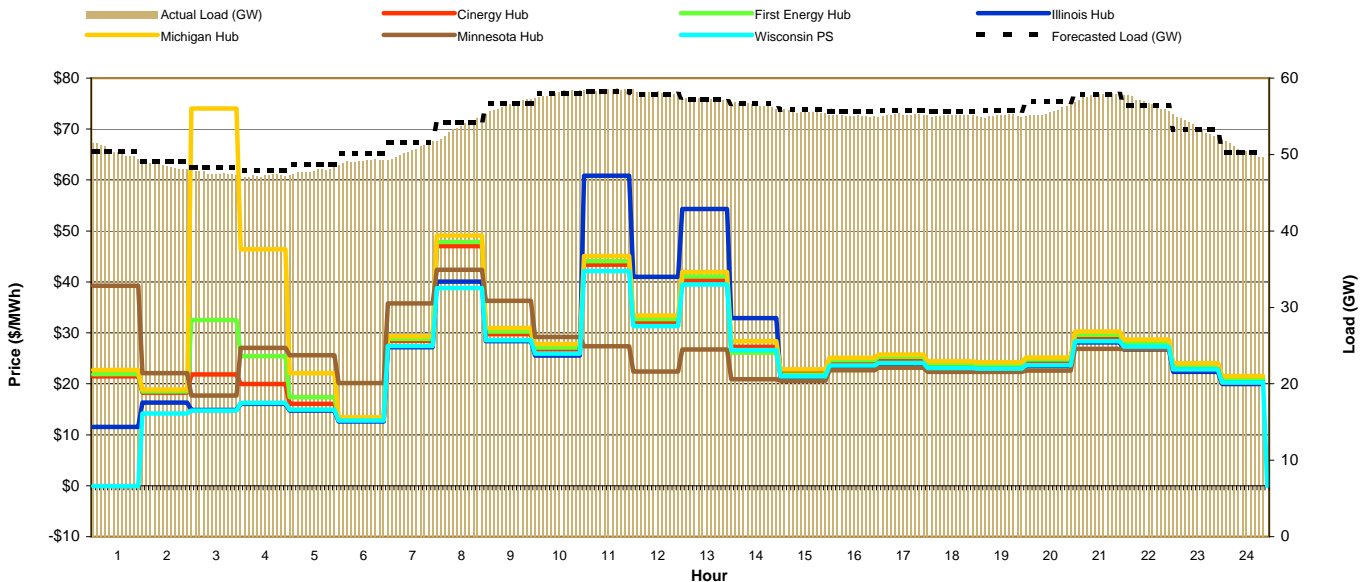




MISO Daily Report

Sunday May 9, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	20.37	20.08	19.49	19.30	19.68	20.04	21.29	24.30	24.76	25.08	25.01	24.48	24.39	23.87	23.52	23.24	23.52	23.69	23.94	26.99	35.09	24.86	20.45	19.17	23.19	24.82
First Energy Hub	21.03	21.70	20.83	20.65	20.34	20.42	22.02	26.50	26.28	27.47	27.28	25.89	25.36	24.71	24.48	24.25	24.72	25.01	25.49	29.28	36.44	26.62	23.88	22.79	24.73	26.48
Illinois Hub	19.26	18.77	18.02	17.51	17.30	17.62	16.66	19.89	23.11	22.86	22.90	23.05	22.62	22.11	20.98	21.77	22.13	22.21	24.83	33.17	23.06	17.79	16.48	21.12	22.83	
Michigan Hub	23.12	27.64	25.66	25.69	23.13	22.10	24.29	32.87	29.13	33.47	32.84	28.35	26.27	25.17	25.44	25.80	26.66	27.25	28.52	34.82	37.90	30.28	35.95	35.61	28.67	30.05
Minnesota Hub	22.26	20.94	20.58	20.80	20.95	20.81	21.77	24.25	26.50	26.97	26.89	25.15	25.70	25.06	24.53	24.35	24.64	25.92	27.37	30.61	42.72	30.50	23.38	20.68	25.14	27.16
Wisconsin PS	19.18	18.46	17.91	17.69	17.72	18.34	20.48	22.70	24.31	24.13	24.12	24.09	24.24	23.79	23.35	22.87	23.22	23.39	23.45	26.31	36.43	24.43	18.15	16.79	22.31	24.31
Cleared Load (GW)	45.5	45.1	44.7	44.5	44.8	45.7	48.4	52.7	54.4	55.2	55.4	55.3	55.0	54.4	53.6	53.4	54.0	54.6	54.8	58.2	61.2	56.5	51.9	4.9		

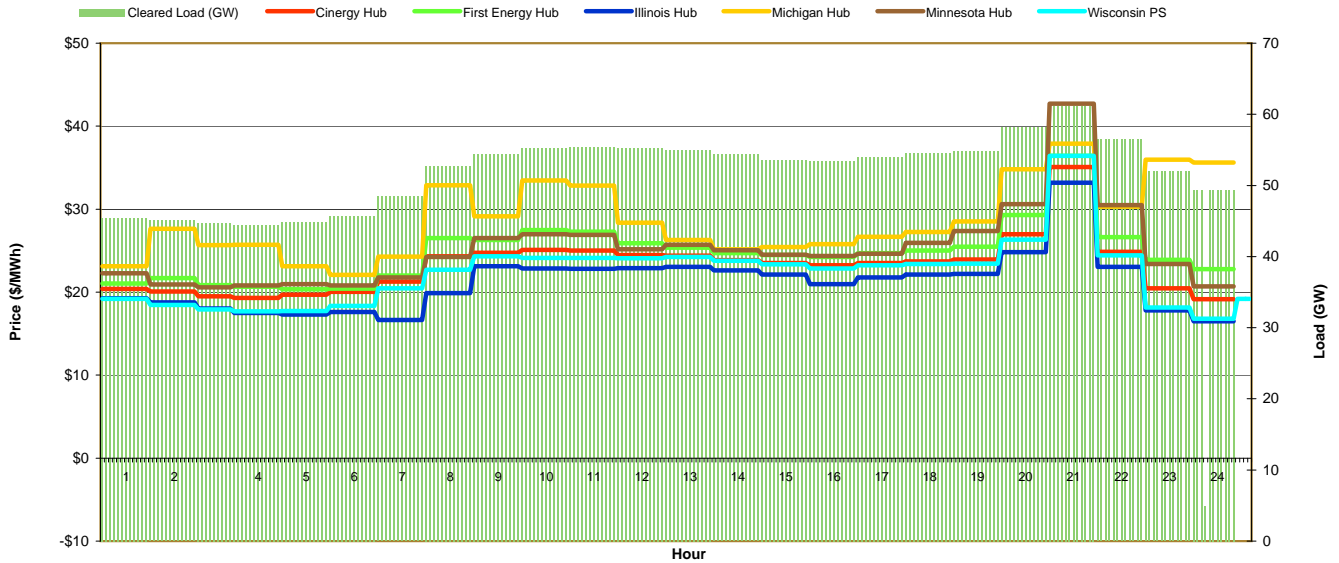

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	18.98	20.15	18.96	20.50	19.60	19.12	21.37	21.90	25.15	23.49	22.23	20.96	19.50	18.92	18.64	19.46	18.95	18.58	18.38	19.37	21.59	21.48	3.44	10.66	19.22	19.50
First Energy Hub	19.24	20.38	19.15	20.71	19.81	19.36	21.64	22.18	25.53	23.91	22.64	21.31	19.81	19.21	18.93	19.78	19.25	18.85	18.61	19.59	21.84	25.03	12.79	12.24	20.07	20.58
Illinois Hub	18.38	19.49	18.27	19.75	18.90	18.44	20.59	21.14	24.29	22.79	21.59	20.34	18.92	18.35	18.10	18.87	18.37	18.02	17.81	18.78	20.94	19.00	-1.89	9.56	18.28	18.46
Michigan Hub	19.75	20.97	19.66	21.13	20.11	19.64	22.02	22.73	26.31	24.62	23.30	21.97	20.45	19.77	19.45	20.33	19.80	19.40	19.21	20.22	22.63	38.93	49.73	18.11	22.93	24.30
Minnesota Hub	18.67	19.76	18.26	19.73	18.98	18.60	20.56	20.91	24.32	23.13	21.72	20.34	18.95	18.38	18.27	20.46	20.06	20.11	27.17	20.69	20.88	23.82	11.29	11.22	19.85	20.66
Wisconsin PS	18.63	19.71	18.40	19.91	19.09	18.65	20.79	21.39	24.78	23.41	22.13	20.80	19.35	18.76	18.55	19.45	18.91	18.65	19.25	19.34	21.43	19.96	-0.69	10.01	18.78	19.09
Forecasted Load (GW)	48.3	47.1	47.4	47.4	48.0	48.7	49.6	51.8	52.8	53.5	53.7	53.5	53.1	52.5	52.1	52.2	52.6	53.2	54.1	55.9	57.6	56.7	53.4	50.1		
Forecast Error %	-25.2%	-0.2%	-2.2%	-2.3%	-2.7%	-2.8%	-2.4%	-2.0%	0.2%	0.2%	-0.1%	-0.6%	-1.0%	-1.4%	-1.7%	-1.8%	-2.1%	-2.7%	-3.3%	-3.6%	-0.6%	-1.1%	-0.9%	-10.1%		

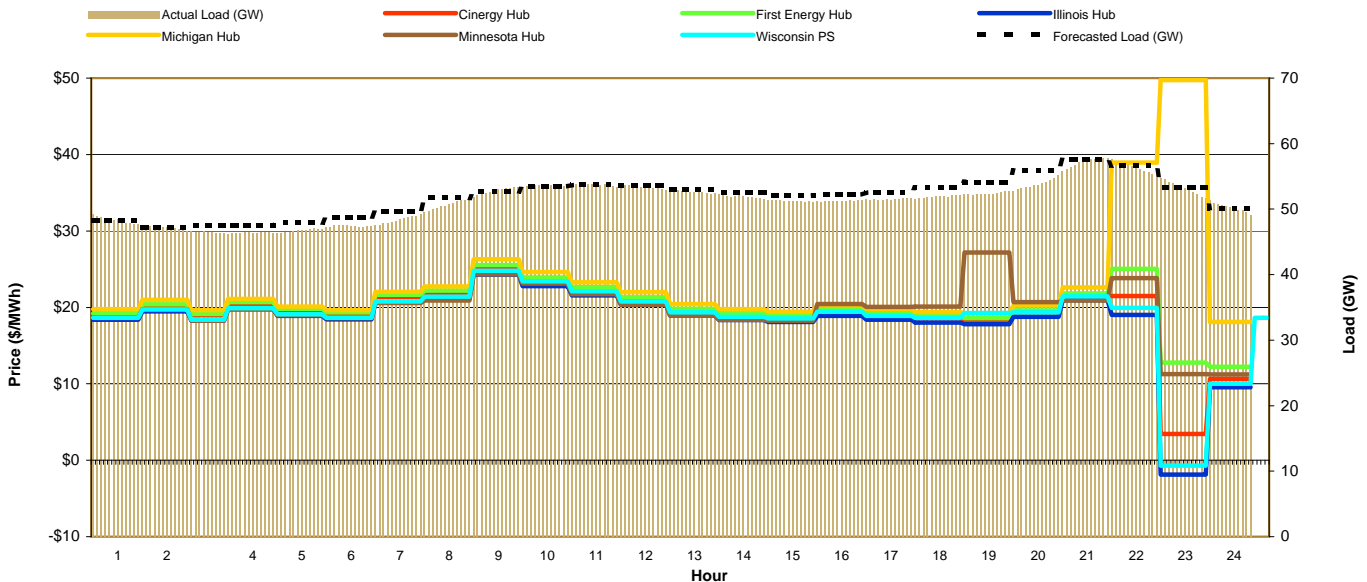




MISO Daily Report

Monday May 10, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$			
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk		
Cinergy Hub	18.50	18.03	18.00	18.39	20.64	23.42	28.79	31.03	32.38	34.94	34.29	33.83	32.95	32.25	30.29	27.20	26.77	26.06	25.29	27.79	33.55	24.08	20.40	18.74	26.57	29.57		
First Energy Hub	21.32	20.71	20.76	19.96	21.70	26.01	31.65	33.37	35.06	37.02	37.71	36.06	34.85	34.55	32.98	30.27	29.20	28.67	27.85	29.55	35.51	26.10	24.30	22.45	29.07	32.07		
Illinois Hub	16.52	16.18	16.11	15.39	14.48	19.24	26.05	27.77	29.84	32.66	31.28	31.48	30.83	29.90	27.81	24.35	23.73	22.72	21.65	23.71	29.34	19.85	17.39	16.37	23.53	26.52		
Michigan Hub	32.00	30.70	30.62	26.74	27.96	36.33	40.06	39.41	41.16	40.69	46.17	40.37	38.10	39.72	39.34	38.42	38.27	37.68	35.98	34.00	40.03	35.71	38.07	35.48	36.79	38.95		
Minnesota Hub	19.86	19.24	19.13	19.22	20.00	26.57	27.28	31.08	32.83	36.54	32.94	33.89	31.83	30.25	27.26	24.87	30.39	29.95	27.12	30.75	35.81	24.68	20.88	19.25	27.15	30.07		
Wisconsin PS	16.85	16.46	16.42	17.03	18.06	21.41	33.03	33.56	36.32	40.30	40.74	41.35	41.22	40.52	38.65	34.27	26.05	25.28	24.38	27.51	32.83	22.52	17.79	16.33	28.28	32.70		
Cleared Load (GW)	48.1	47.2	47.2	47.5	50.6	57.6	65.1	68.0	68.2	68.9	68.9	69.0	68.6	68.1	67.2	66.0	65.2	64.5	64.1	66.4	68.3	62.7	56.7	5.2				

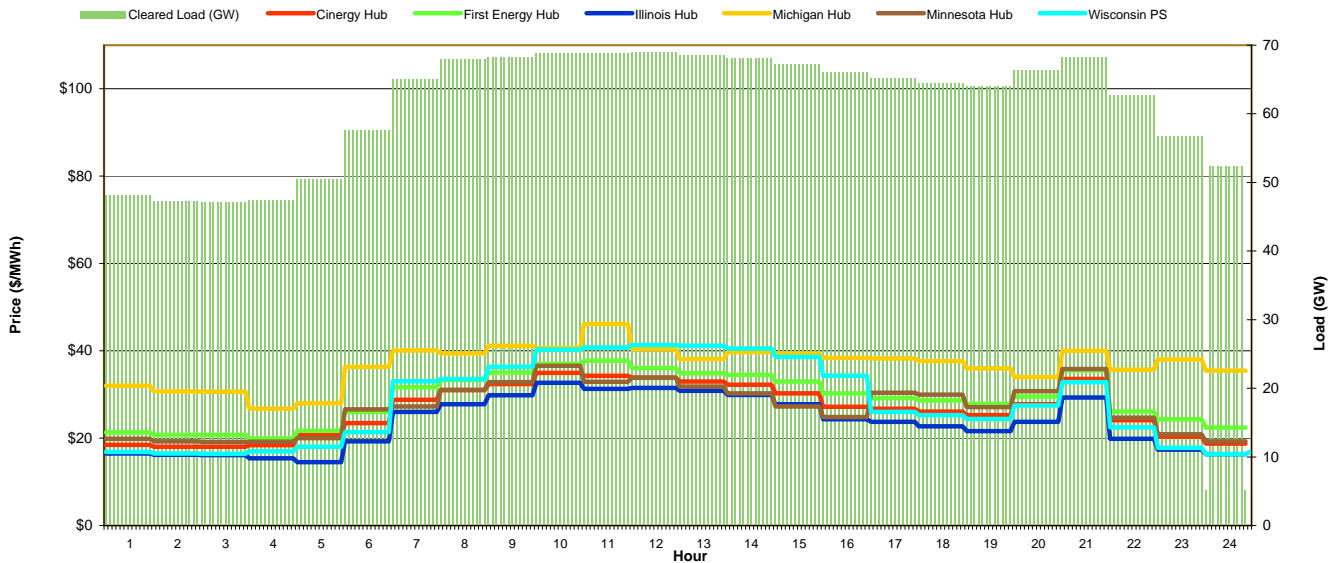

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$			
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk		
Cinergy Hub	16.58	16.89	16.90	16.27	17.26	18.10	20.92	22.77	24.79	31.15	25.27	23.70	24.88	24.52	24.45	22.44	23.56	24.31	23.65	24.83	32.75	22.59	16.41	16.00	22.12	24.50		
First Energy Hub	17.44	17.76	17.10	16.49	17.46	18.23	21.10	23.01	24.27	28.52	24.49	23.61	25.28	24.92	24.85	22.80	23.92	24.70	24.05	25.23	33.34	39.20	19.94	16.40	23.09	25.76		
Illinois Hub	15.61	15.89	16.26	16.04	25.79	17.33	22.37	21.95	16.19	1.29	13.67	18.91	23.80	23.58	23.50	21.55	22.66	23.41	22.77	24.76	31.80	12.54	13.91	15.33	19.20	19.77		
Michigan Hub	20.35	20.77	17.45	16.79	17.77	18.69	21.60	23.51	24.87	29.19	25.14	24.25	25.97	25.63	25.52	23.49	24.75	25.58	24.94	26.10	34.65	104.90	34.07	17.52	27.23	31.41		
Minnesota Hub	21.53	16.77	16.38	15.61	13.48	19.90	27.97	20.56	25.29	25.15	27.98	18.69	16.60	15.28	17.28	20.78	27.59	25.34	24.22	25.95	14.88	14.72	14.26	15.26	20.06	20.91		
Wisconsin PS	16.61	16.37	16.70	16.10	17.44	18.14	21.13	33.41	37.37	53.85	34.59	45.35	54.18	26.80	26.07	22.42	24.12	24.56	23.87	25.05	40.28	12.93	14.52	15.97	26.57	31.21		
Forecasted Load (GW)	48.2	47.5	47.4	48.2	50.7	56.6	61.2	63.8	64.7	65.3	65.6	65.7	65.5	65.0	64.0	63.0	62.1	61.5	61.2	63.1	64.4	61.1	57.1	53.5				
Forecast Error %	0.2%	0.2%	0.3%	0.2%	0.4%	-1.7%	-1.1%	-0.3%	0.2%	0.5%	0.6%	0.4%	0.3%	0.5%	0.3%	0.7%	1.5%	2.2%	2.7%	1.2%	0.9%	1.2%	-0.2%	-10.4%				

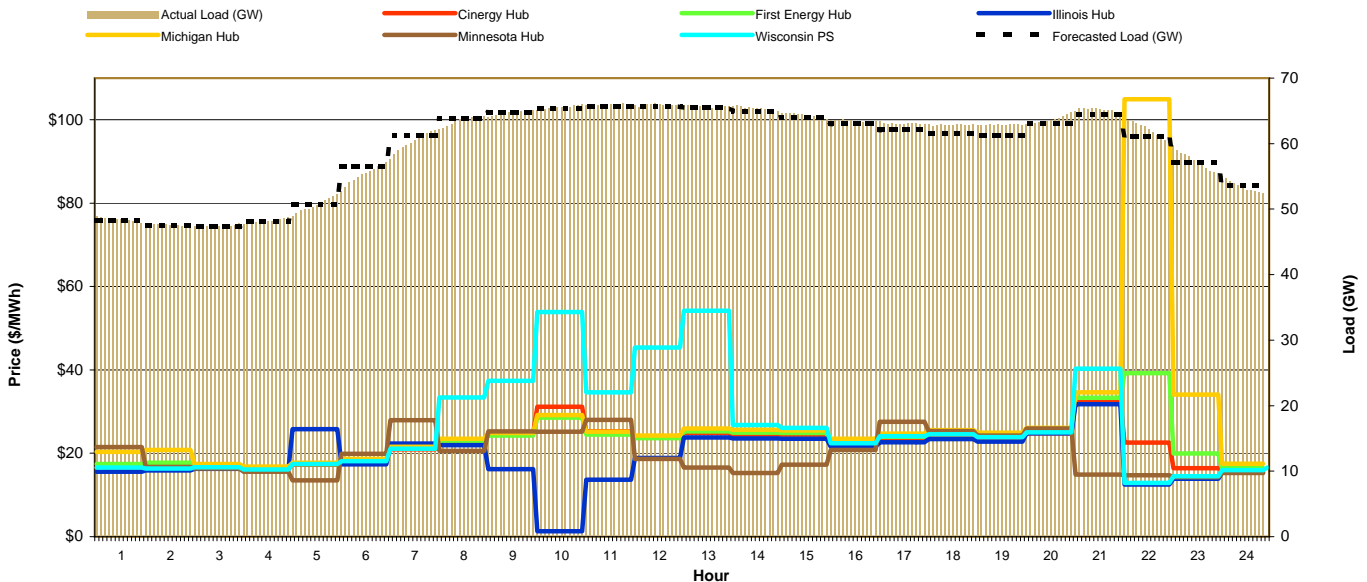




MISO Daily Report

Tuesday May 11, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	21.00	20.09	19.99	19.92	19.64	22.60	33.03	31.00	30.00	31.26	31.00	29.53	28.24	26.89	25.33	24.73	25.35	38.72	41.16	34.85	30.10	25.00	23.16	22.08	27.28	29.77
First Energy Hub	21.61	20.72	20.60	20.54	20.22	23.23	34.46	32.89	31.96	33.22	33.02	31.79	30.14	29.58	27.10	26.75	27.25	40.21	42.84	36.27	32.04	25.97	23.81	22.88	28.71	31.55
Illinois Hub	14.99	14.07	13.92	13.70	14.18	14.99	20.81	28.34	27.71	28.99	28.63	26.87	25.60	23.36	22.66	21.74	22.29	37.21	39.39	33.35	27.59	23.26	18.64	14.08	23.18	27.23
Michigan Hub	22.10	21.27	21.16	21.10	20.70	23.79	35.68	36.83	35.80	36.72	36.73	36.83	33.91	36.74	31.89	33.06	33.93	40.64	43.53	36.72	35.80	26.74	24.17	23.79	31.23	35.00
Minnesota Hub	10.62	10.41	9.21	9.08	9.19	6.71	16.08	19.81	23.62	24.69	25.46	23.48	23.29	20.58	19.73	19.41	18.57	33.61	39.00	33.50	22.10	17.52	15.66	11.98	19.30	23.75
Wisconsin PS	17.75	15.89	15.70	15.53	15.54	23.04	38.36	42.96	43.88	43.42	43.61	41.33	41.21	39.75	40.35	34.72	32.83	40.03	52.22	43.41	35.33	35.64	26.55	19.00	33.25	39.83
Cleared Load (GW)	57.8	55.8	54.6	54.2	54.6	55.5	57.3	60.0	60.9	62.1	63.0	63.0	62.0	61.1	60.2	60.0	61.0	65.9	68.4	68.2	67.6	66.6	63.7	61.3		

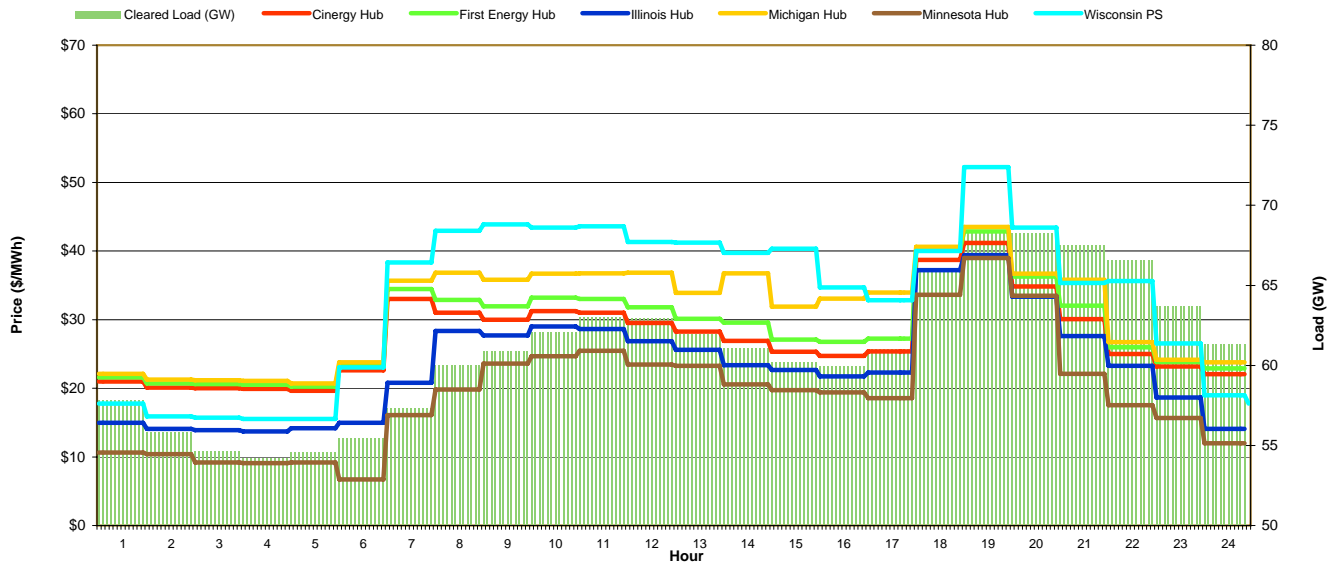

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	19.36	20.01	20.14	15.86	14.09	11.17	30.06	42.68	23.86	24.45	27.11	22.80	24.36	25.06	23.88	22.84	22.31	34.19	27.12	32.76	38.65	31.09	21.50	22.66	24.92	27.79
First Energy Hub	19.46	20.54	20.96	16.53	14.59	11.70	31.12	43.87	24.65	25.35	28.10	23.64	25.26	26.07	24.81	23.69	23.11	35.53	28.02	33.94	39.95	32.18	22.16	23.13	25.77	28.77
Illinois Hub	8.10	12.83	7.69	12.93	12.89	9.01	15.30	40.81	22.15	23.31	24.61	22.05	22.68	23.54	21.89	21.64	19.67	27.93	26.18	26.71	33.71	22.62	20.37	20.98	20.82	24.99
Michigan Hub	25.50	24.34	26.77	21.99	15.30	12.47	36.83	45.75	28.19	30.86	29.64	24.46	30.07	28.76	26.89	24.94	24.23	58.24	28.45	34.58	40.82	33.50	22.61	23.69	29.13	32.01
Minnesota Hub	-44.21	-10.12	8.49	19.56	15.13	16.15	12.99	33.85	22.28	23.51	25.43	21.26	21.45	23.11	21.81	20.93	19.36	31.92	26.65	31.50	26.84	14.71	6.82	11.32	16.70	23.21
Wisconsin PS	-12.43	13.79	-1.66	13.39	19.63	25.82	10.40	45.83	15.80	10.83	26.41	23.77	10.91	19.37	19.58	21.16	19.45	35.61	29.02	34.69	45.92	28.99	30.84	28.26	21.47	26.13
Forecasted Load (GW)	59.9	57.9	56.7	56.1	56.0	56.4	57.7	59.8	61.5	62.7	63.3	64.0	63.9	63.6	62.9	62.5	63.1	65.9	69.9	70.3	69.3	67.5	65.7	62.7		
Forecast Error %	-3.0%	-2.8%	-2.9%	-2.7%	-2.4%	-2.3%	-2.0%	-1.9%	-1.8%	-1.5%	-0.7%	-2.2%	-2.2%	-1.9%	-1.6%	-1.5%	-1.4%	0.2%	0.2%	-0.2%	-0.3%	-0.5%	-2.2%	-12.9%		

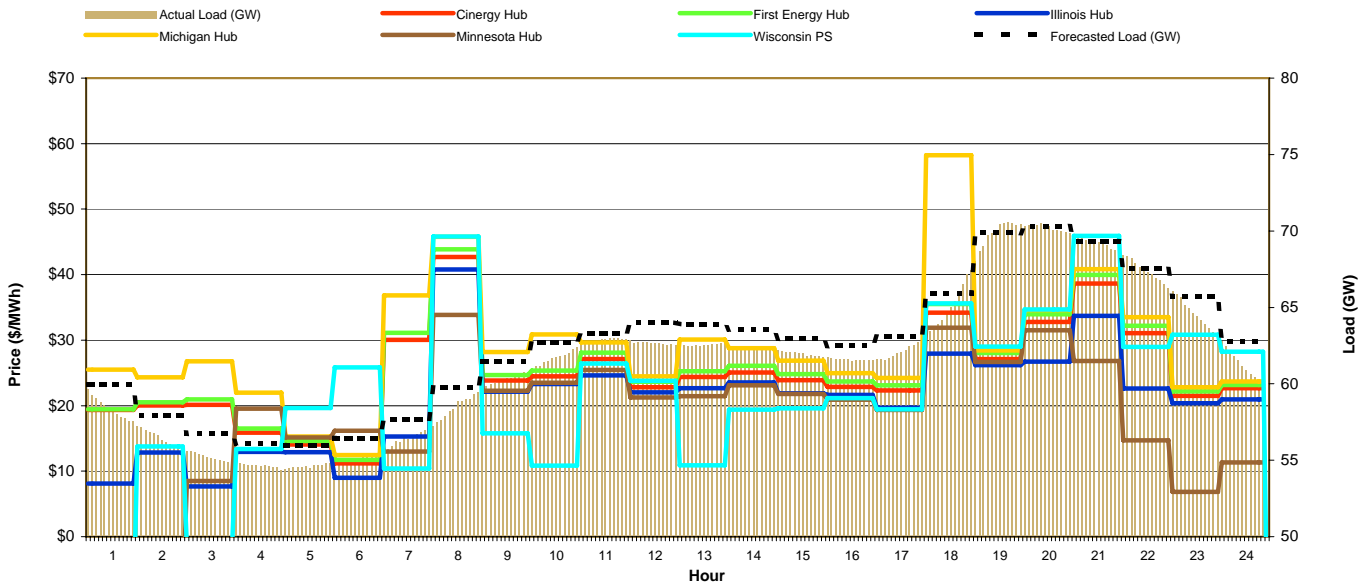




MISO Daily Report

Wednesday May 12, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	20.70	19.96	19.58	19.75	20.85	23.11	28.98	31.39	36.04	37.03	36.86	37.65	35.59	35.36	36.78	33.55	31.98	27.57	25.10	30.74	36.86	24.68	22.26	20.68	28.88	32.47
First Energy Hub	23.60	23.21	22.73	23.04	24.67	25.76	31.24	32.64	37.19	38.36	38.20	38.89	37.12	37.02	38.07	35.12	30.87	28.61	27.59	31.88	37.67	26.71	25.23	23.56	30.79	33.82
Illinois Hub	16.49	16.66	16.44	16.60	16.83	20.36	25.81	29.42	33.51	34.47	34.22	36.60	35.90	36.51	39.52	34.36	32.53	27.01	26.37	24.72	34.91	23.10	19.24	16.76	27.01	31.40
Michigan Hub	37.12	36.94	36.00	36.88	43.98	37.89	39.92	36.59	42.35	42.42	42.36	42.61	41.98	41.94	42.31	41.41	40.87	34.97	33.20	38.04	39.31	39.15	40.93	37.12	39.43	40.03
Minnesota Hub	19.02	18.40	17.95	18.10	18.70	21.98	29.03	32.24	36.78	37.88	37.16	38.81	35.38	33.85	32.26	29.81	28.58	27.81	29.08	32.10	37.62	29.47	20.55	19.07	28.40	32.46
Wisconsin PS	18.17	17.51	17.22	17.29	17.59	21.05	27.83	31.12	35.72	36.78	36.53	37.73	35.43	35.31	36.59	33.20	31.77	30.80	29.80	31.89	37.25	27.08	19.89	18.17	28.40	32.93
Cleared Load (GW)	49.9	48.2	47.4	48.1	51.2	56.6	62.9	66.2	66.7	67.3	67.5	67.9	68.3	68.2	67.7	66.8	66.1	65.3	64.3	66.1	67.9	63.3	57.2	5.3		

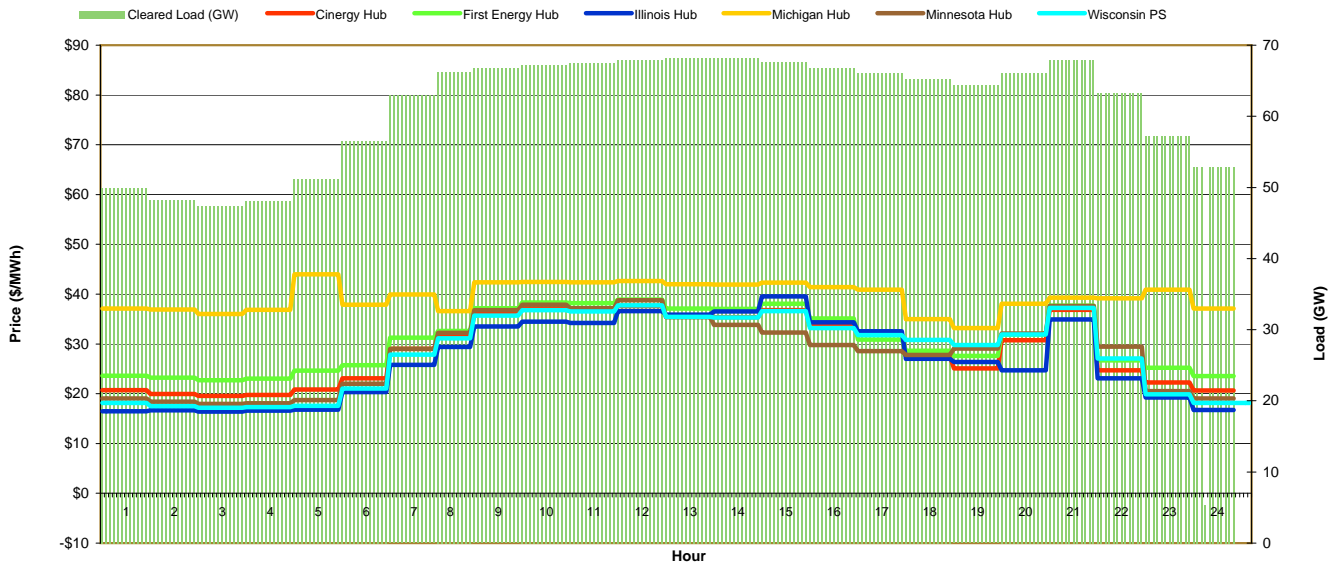

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	23.68	21.74	21.56	21.32	23.53	33.31	53.58	31.35	31.32	28.35	37.45	39.13	40.02	29.59	28.20	33.33	31.01	29.22	41.92	26.84	28.22	24.13	22.83	21.39	30.13	31.43
First Energy Hub	37.14	22.83	22.69	22.86	25.21	35.20	65.96	32.94	32.89	29.97	39.17	41.74	42.34	31.17	31.86	38.47	31.95	33.71	46.67	27.74	29.14	24.98	24.02	21.98	32.61	33.67
Illinois Hub	16.15	20.93	20.71	20.07	22.66	31.63	51.49	30.17	30.22	27.78	36.36	38.73	39.52	29.16	29.43	35.29	29.38	30.88	43.23	25.86	27.25	23.11	22.05	20.17	29.26	31.15
Michigan Hub	84.91	29.21	28.96	25.90	28.45	37.43	56.24	33.11	33.13	30.09	39.14	41.64	42.38	31.42	32.06	38.71	32.15	33.67	46.98	27.87	29.30	25.04	24.02	21.98	35.58	33.81
Minnesota Hub	20.43	21.08	20.46	19.52	21.67	31.14	49.65	71.66	69.90	27.25	34.72	25.53	11.33	21.24	16.95	16.86	28.67	30.71	42.24	24.93	26.84	23.35	22.49	20.49	29.13	30.92
Wisconsin PS	16.91	-0.89	-2.58	20.33	22.51	32.49	53.82	36.65	36.57	29.67	38.38	56.31	77.52	39.80	46.02	58.64	30.91	32.86	45.39	26.94	28.74	24.55	23.38	21.27	33.17	39.52
Forecasted Load (GW)	52.8	51.4	50.7	51.0	53.0	56.6	61.5	65.1	66.4	67.0	67.7	67.9	68.0	68.1	67.8	67.4	67.1	66.5	65.8	66.4	67.3	65.0	60.6	56.2		
Forecast Error %	-27.3%	-1.9%	-1.9%	-1.9%	-1.7%	0.2%	0.4%	0.1%	-0.2%	-0.2%	-0.4%	-0.8%	-0.9%	-1.2%	-2.0%	-2.3%	-2.2%	-2.0%	-1.5%	-1.2%	-1.0%	-2.2%	-3.1%	-12.2%		

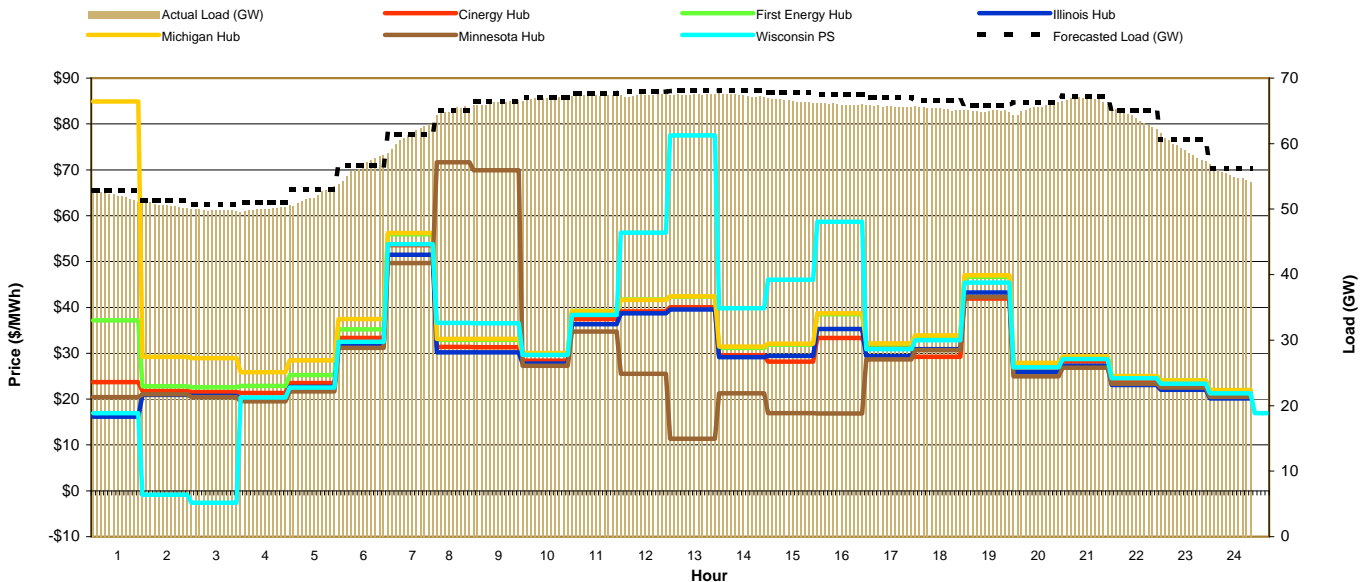




MISO Daily Report

Thursday May 13, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	21.22	20.70	20.27	20.55	22.00	26.06	33.59	37.60	42.38	43.06	44.23	44.19	44.65	45.18	45.81	47.50	45.00	41.56	35.56	41.00	44.40	33.14	24.27	21.30	35.22	41.22
First Energy Hub	24.24	23.40	22.75	23.03	23.08	28.57	35.69	38.77	42.87	43.73	44.87	44.38	44.51	44.86	45.51	46.17	44.43	41.31	36.61	41.26	44.40	33.33	25.50	24.40	36.15	41.41
Illinois Hub	17.15	16.65	16.42	16.47	18.35	23.38	30.35	34.29	39.15	39.20	40.76	41.12	39.42	38.15	38.35	30.13	37.93	33.63	29.82	34.73	37.33	29.27	22.17	18.15	30.10	35.34
Michigan Hub	37.52	35.40	33.82	34.22	28.60	39.04	43.70	42.90	44.27	46.17	47.06	44.80	44.93	45.29	45.87	46.45	44.78	42.87	42.02	43.65	44.78	37.30	30.76	37.55	40.99	43.37
Minnesota Hub	19.36	18.51	18.10	18.32	19.13	25.61	32.82	36.98	42.72	42.51	43.95	44.51	43.62	44.28	42.69	39.32	41.12	39.99	34.26	38.32	41.22	33.25	24.88	20.44	33.58	39.60
Wisconsin PS	18.78	18.40	18.11	18.34	19.49	24.31	32.61	37.15	42.52	42.58	43.89	44.18	43.04	43.81	43.29	41.68	41.64	38.61	33.47	38.47	41.43	32.03	23.37	19.07	33.34	39.45
Cleared Load (GW)	51.4	49.3	48.5	48.7	50.7	57.1	64.0	66.1	67.7	68.4	68.8	69.9	69.9	69.8	69.4	68.4	67.8	67.0	66.2	67.2	68.4	64.8	58.3	5.4		

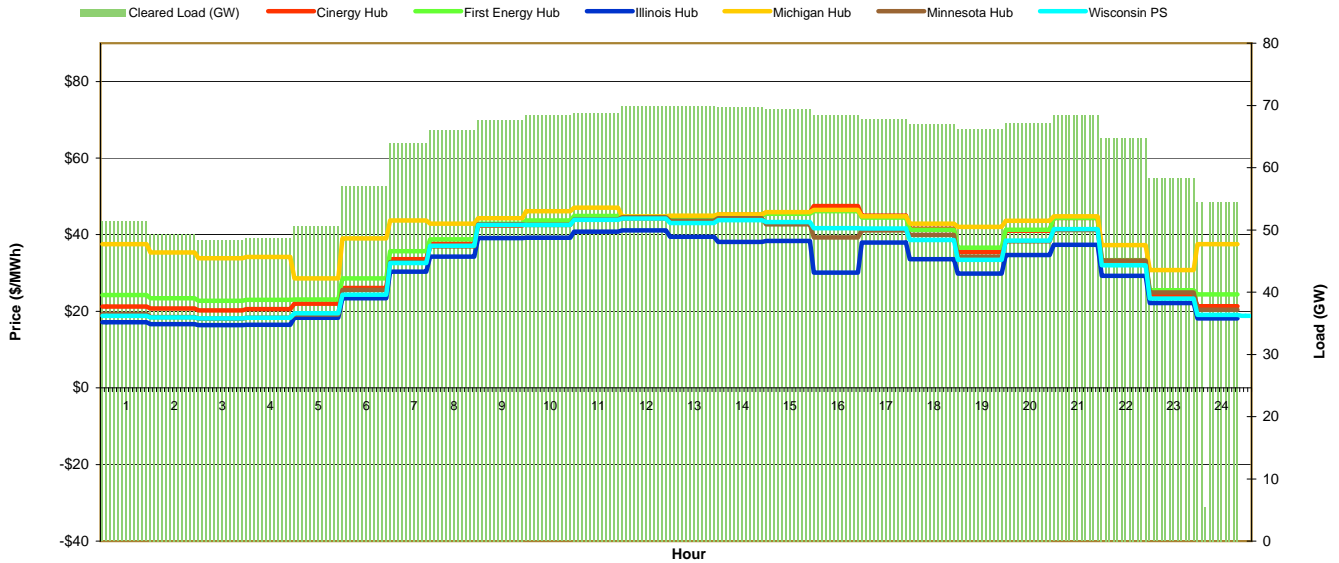

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	20.60	20.65	20.56	21.25	24.06	23.80	26.23	84.47	27.00	37.86	37.57	35.99	42.68	35.98	39.47	33.12	31.99	25.03	26.01	28.73	31.03	24.00	24.93	20.83	30.99	35.37
First Energy Hub	21.17	21.25	21.19	25.14	24.81	24.50	27.03	87.24	27.92	37.10	34.79	36.12	37.22	34.35	32.15	30.74	32.63	25.64	26.66	29.38	31.76	24.58	25.54	21.35	30.84	34.61
Illinois Hub	19.64	19.67	18.36	18.34	22.96	22.72	25.15	81.61	26.08	34.57	32.37	33.49	-34.35	23.80	-29.02	2.90	32.48	24.53	27.00	36.71	35.54	23.15	24.02	19.88	22.57	23.43
Michigan Hub	21.17	21.30	21.33	37.66	24.89	24.60	27.21	88.09	28.04	37.21	34.82	35.93	37.02	34.19	31.92	30.48	32.34	25.51	26.62	29.33	31.51	24.53	25.65	21.27	31.36	34.57
Minnesota Hub	19.68	19.60	18.39	18.84	23.01	22.78	24.97	81.33	25.54	33.49	31.02	32.03	32.75	25.78	21.48	21.64	15.74	22.41	18.53	17.31	22.83	22.38	23.41	19.34	25.60	27.98
Wisconsin PS	20.19	20.07	18.63	18.65	23.62	23.38	26.09	85.23	27.27	36.02	33.51	34.88	35.70	32.91	30.69	29.30	31.40	24.94	25.58	27.96	30.30	23.97	25.00	20.51	29.41	33.41
Forecasted Load (GW)	53.0	51.5	50.7	51.0	52.3	56.7	61.4	64.7	66.4	67.7	68.6	69.3	69.7	69.8	69.3	68.8	68.3	67.5	66.6	66.7	67.8	65.1	60.7	56.4		
Forecast Error %	-18.0%	-1.3%	-1.3%	-1.3%	0.3%	0.9%	1.4%	2.1%	1.6%	1.6%	1.5%	0.8%	0.5%	0.4%	0.5%	0.6%	0.3%	0.2%	0.5%	0.4%	0.6%	0.3%	-0.5%	-10.2%		

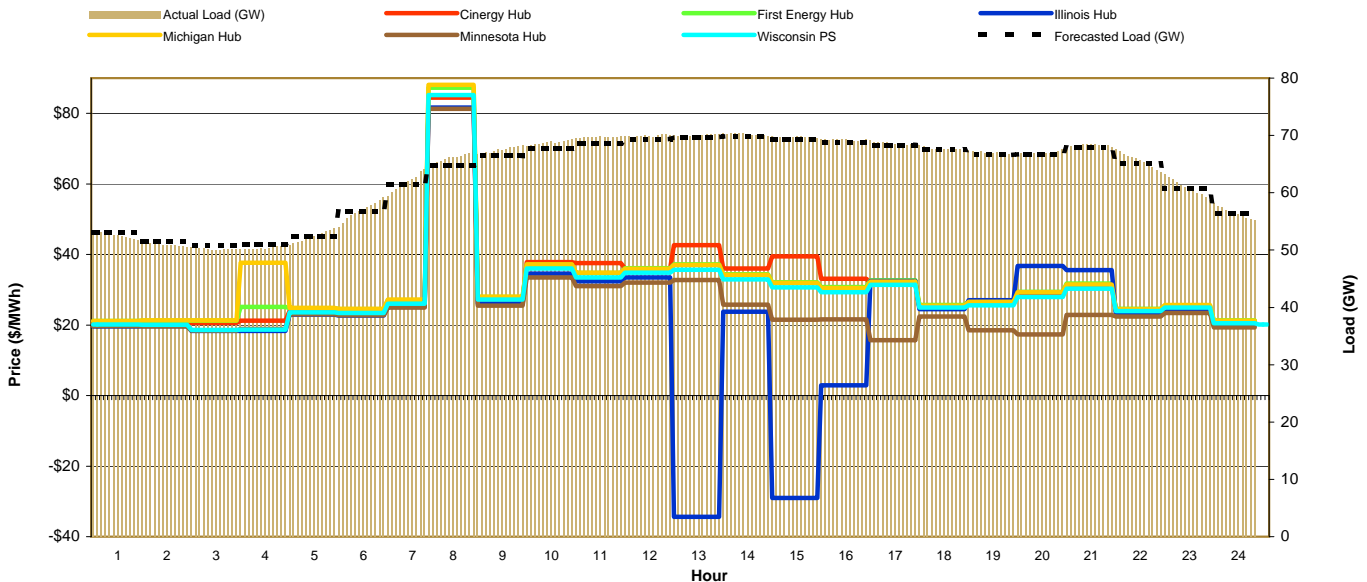




MISO Daily Report

Friday May 14, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	21.72	20.55	20.38	20.48	21.43	24.60	30.05	35.28	39.53	41.34	43.20	43.53	42.66	40.86	39.63	37.49	35.51	31.60	29.71	31.99	36.71	29.67	23.94	22.20	31.84	36.42
First Energy Hub	24.22	22.38	21.57	21.34	22.36	27.22	32.31	36.87	40.60	42.70	43.81	43.87	43.29	41.49	39.98	37.88	37.16	32.98	31.26	33.67	37.14	28.25	24.73	24.54	32.98	37.23
Illinois Hub	19.16	18.12	17.87	17.98	18.24	21.91	27.92	33.43	37.89	38.83	41.06	40.84	41.96	39.60	38.57	37.21	33.71	30.05	28.09	30.22	35.58	28.60	22.46	19.89	29.97	34.88
Michigan Hub	34.70	27.39	25.65	24.01	27.07	38.19	40.86	42.46	43.86	46.99	44.88	44.09	44.67	43.02	40.23	38.15	42.56	37.39	36.41	39.34	37.44	32.37	27.95	34.09	37.24	40.11
Minnesota Hub	19.83	19.07	18.86	18.89	19.34	26.04	27.48	38.49	39.43	37.95	40.61	41.80	38.61	37.49	36.57	35.41	34.99	31.94	29.35	30.89	35.80	29.60	22.47	20.14	30.46	35.09
Wisconsin PS	19.04	18.55	18.02	18.18	18.46	22.63	32.70	36.82	43.28	41.19	41.26	41.75	39.13	38.36	37.41	35.52	33.82	31.42	29.32	31.45	36.99	29.75	23.16	20.49	30.78	35.66
Cleared Load (GW)	52.1	50.4	49.4	49.0	51.3	57.3	63.4	65.8	66.7	67.0	67.3	67.4	67.5	67.0	66.5	65.6	64.1	63.1	61.6	62.2	63.7	60.2	54.4	5.1		

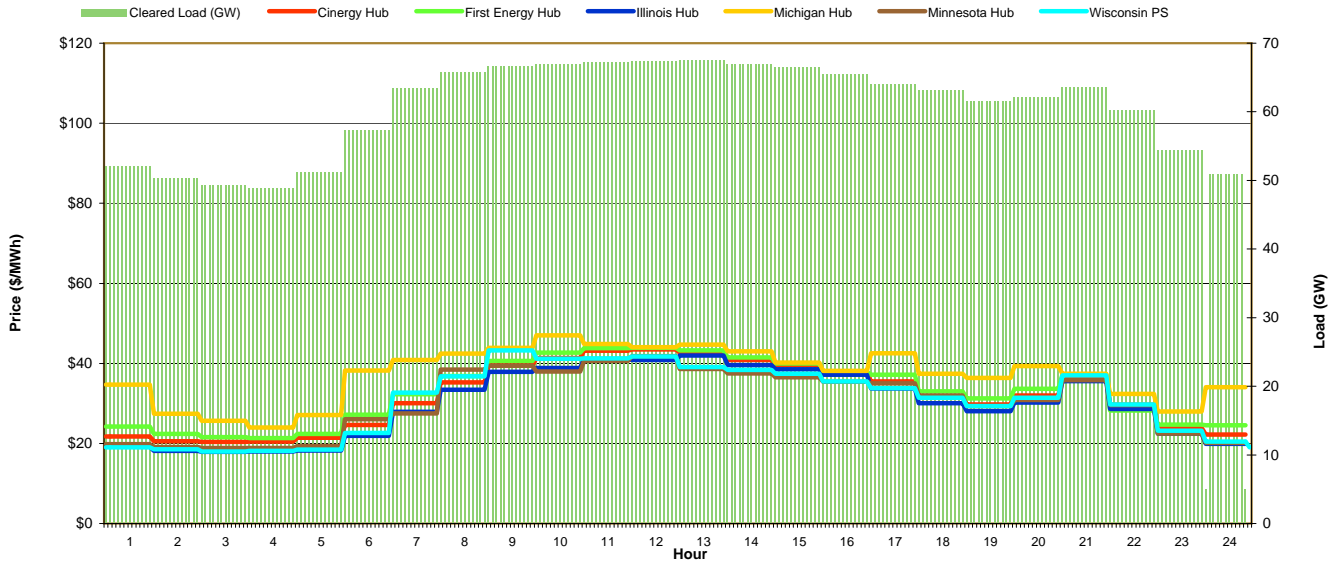

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	20.68	20.63	21.09	20.86	20.42	22.53	37.20	39.65	108.11	65.11	84.78	53.91	66.58	62.20	52.22	42.23	117.87	34.10	26.79	25.01	45.83	27.63	20.88	20.71	44.04	54.56
First Energy Hub	21.14	21.07	21.09	21.40	20.94	23.06	38.09	40.79	107.67	62.98	78.20	52.43	60.29	61.24	51.28	41.61	116.61	34.41	27.57	25.70	47.18	28.43	20.43	19.90	43.48	53.55
Illinois Hub	19.78	19.56	15.99	19.80	19.52	20.82	37.35	38.10	93.07	50.31	54.83	44.44	49.00	54.69	45.28	36.69	99.59	30.70	25.65	24.02	44.07	26.68	20.17	20.01	37.92	46.08
Michigan Hub	21.08	21.03	20.98	21.25	20.86	23.05	37.82	40.41	105.72	61.52	76.37	51.33	59.20	60.28	50.42	40.89	115.00	33.99	27.31	25.34	46.58	28.19	21.25	21.22	42.96	52.74
Minnesota Hub	18.42	14.37	9.91	16.71	18.79	19.99	24.99	36.35	95.65	55.08	67.77	45.37	50.85	43.94	43.50	35.89	85.10	29.57	25.04	22.99	41.36	25.90	20.30	19.95	36.16	45.29
Wisconsin PS	20.09	19.85	19.75	20.01	19.86	21.10	36.32	39.20	102.98	59.62	73.75	49.37	42.32	54.13	47.41	38.64	74.55	30.05	26.23	24.53	45.04	27.50	20.96	20.63	38.91	47.26
Forecasted Load (GW)	54.3	52.4	51.4	51.4	53.1	56.5	61.0	64.4	66.1	67.0	67.5	67.6	67.5	67.1	66.3	65.5	64.7	63.5	62.5	62.2	63.0	60.2	56.2	52.3		
Forecast Error %	-2.2%	-2.2%	-2.1%	-1.9%	-1.7%	-0.5%	-0.3%	-0.5%	-0.7%	-0.5%	-0.7%	-0.4%	-0.4%	-0.1%	-0.2%	-0.8%	-1.0%	-1.6%	-2.4%	-3.0%	-1.7%	0.2%	0.0%	-10.0%		

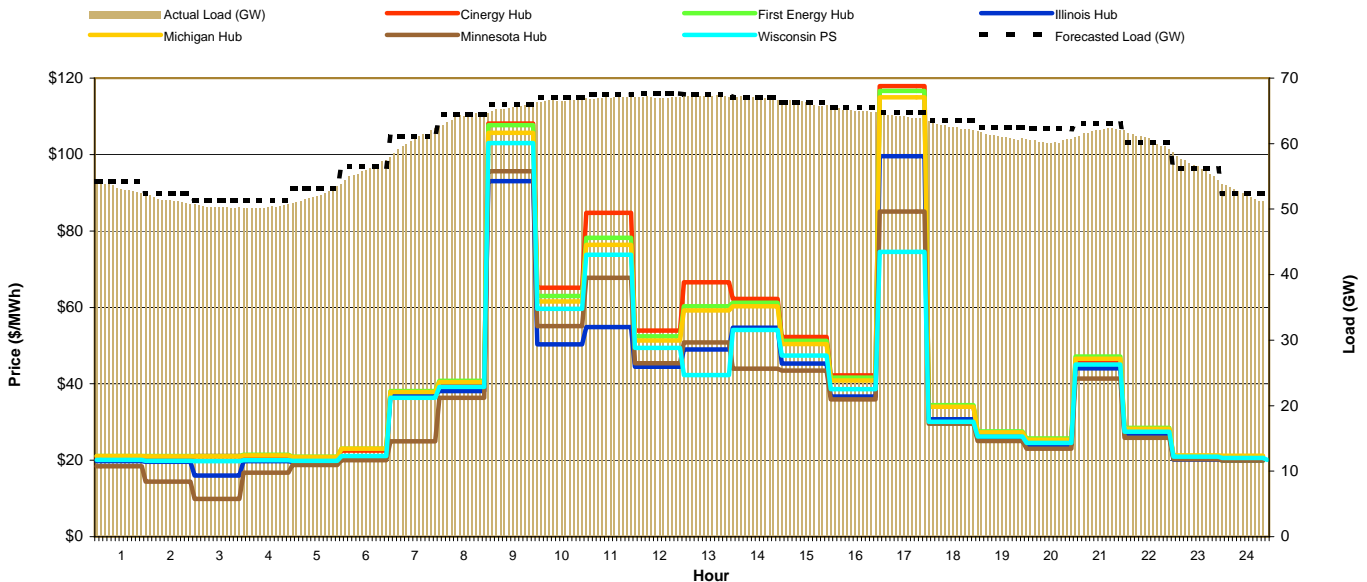




MISO Daily Report

Saturday May 15, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	22.84	21.68	20.43	20.31	20.56	21.38	22.77	27.68	30.09	32.02	33.44	31.74	30.97	28.96	28.59	27.84	28.42	28.15	27.09	28.84	34.93	27.33	23.19	21.28	26.69	29.33
First Energy Hub	25.08	24.40	21.36	20.84	21.12	21.85	23.33	27.26	29.82	33.08	33.99	32.98	30.63	28.65	28.61	27.14	27.49	27.27	26.54	28.32	34.71	26.48	23.68	22.90	26.98	29.17
Illinois Hub	19.98	18.49	18.30	18.57	18.34	19.34	21.78	26.42	28.60	30.44	32.12	30.09	29.30	27.23	26.64	25.88	26.68	26.85	25.88	27.45	33.25	26.08	22.21	19.72	24.99	27.82
Michigan Hub	33.82	38.14	24.91	22.71	23.31	23.59	24.75	30.30	34.14	36.20	35.02	36.81	36.29	31.37	31.18	29.51	30.01	29.32	28.26	30.81	36.94	29.31	24.86	28.72	30.43	31.90
Minnesota Hub	21.79	19.97	19.64	19.53	19.69	20.89	21.83	26.60	28.49	30.82	33.37	31.56	31.35	29.27	28.48	27.92	27.93	27.97	26.65	28.64	34.44	27.22	22.80	20.33	26.13	28.97
Wisconsin PS	21.37	19.57	19.68	19.81	19.98	20.90	23.10	28.13	30.53	32.44	34.36	32.27	31.54	29.68	29.19	28.52	28.96	28.80	27.67	29.42	35.64	27.86	22.92	20.35	26.78	29.87
Cleared Load (GW)	48.1	46.6	45.0	44.6	45.2	46.9	49.0	54.5	56.7	57.7	58.1	57.8	57.3	57.0	56.6	56.2	56.5	56.4	55.1	56.5	58.0	55.6	51.4	4.9		

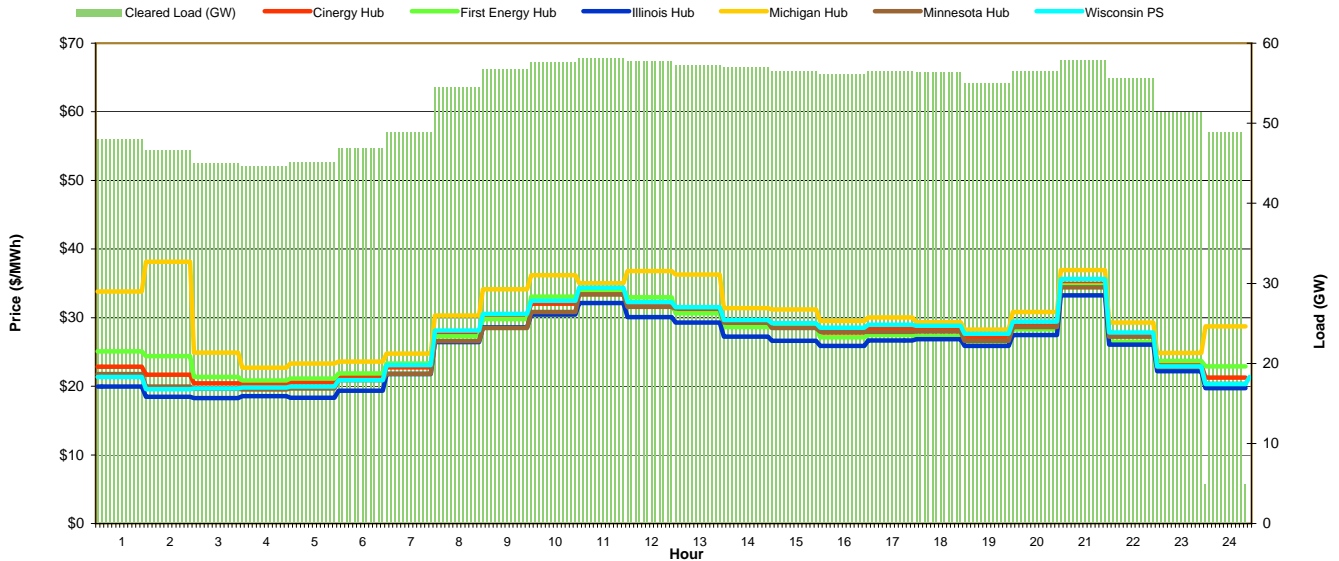

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	47.10	25.18	21.87	22.05	22.65	22.07	23.07	40.57	65.40	28.71	53.13	27.79	28.49	25.66	26.99	29.70	31.64	23.55	23.64	36.21	25.65	24.08	18.11	18.35	29.65	31.83
First Energy Hub	48.49	27.70	26.59	22.72	23.38	23.03	23.77	41.70	67.03	29.47	54.53	28.50	29.25	26.33	26.17	24.21	18.19	8.73	22.18	32.96	26.40	18.78	16.70	18.83	28.57	29.45
Illinois Hub	45.41	23.17	18.68	21.20	21.72	20.93	22.05	38.87	62.74	27.62	51.21	26.70	27.29	24.54	25.77	28.32	30.21	22.53	22.56	34.55	24.56	23.12	17.38	17.59	28.28	30.50
Michigan Hub	48.73	34.87	42.94	22.86	23.46	24.20	23.73	41.91	67.54	29.69	54.86	28.74	29.44	26.40	27.73	30.61	32.63	24.18	24.30	37.35	26.57	24.86	18.61	18.84	31.88	32.84
Minnesota Hub	45.04	23.09	19.12	20.79	21.27	20.73	21.49	37.71	60.77	27.23	47.83	24.05	26.90	24.27	25.58	27.97	29.44	21.84	21.98	33.58	24.21	23.18	17.37	17.06	27.60	29.62
Wisconsin PS	46.46	23.55	18.96	21.49	22.05	21.35	22.51	39.80	64.10	28.33	52.68	27.23	27.72	24.92	26.14	28.67	30.51	22.78	22.87	34.89	25.02	23.70	17.73	17.69	28.80	31.07
Forecasted Load (GW)	50.0	48.5	47.7	47.8	48.0	48.8	49.8	52.7	55.3	57.0	57.7	57.3	57.3	56.8	56.3	56.3	56.4	56.3	56.1	56.5	57.5	56.5	53.1	50.3		
Forecast Error %	-1.7%	-1.9%	-2.2%	-3.0%	-2.1%	-2.2%	-0.7%	-0.1%	0.4%	0.1%	-0.1%	-0.2%	-0.2%	-0.5%	-0.6%	-0.9%	-1.0%	-1.4%	-1.7%	-1.6%	-0.9%	-1.3%	-1.5%	-12.0%		

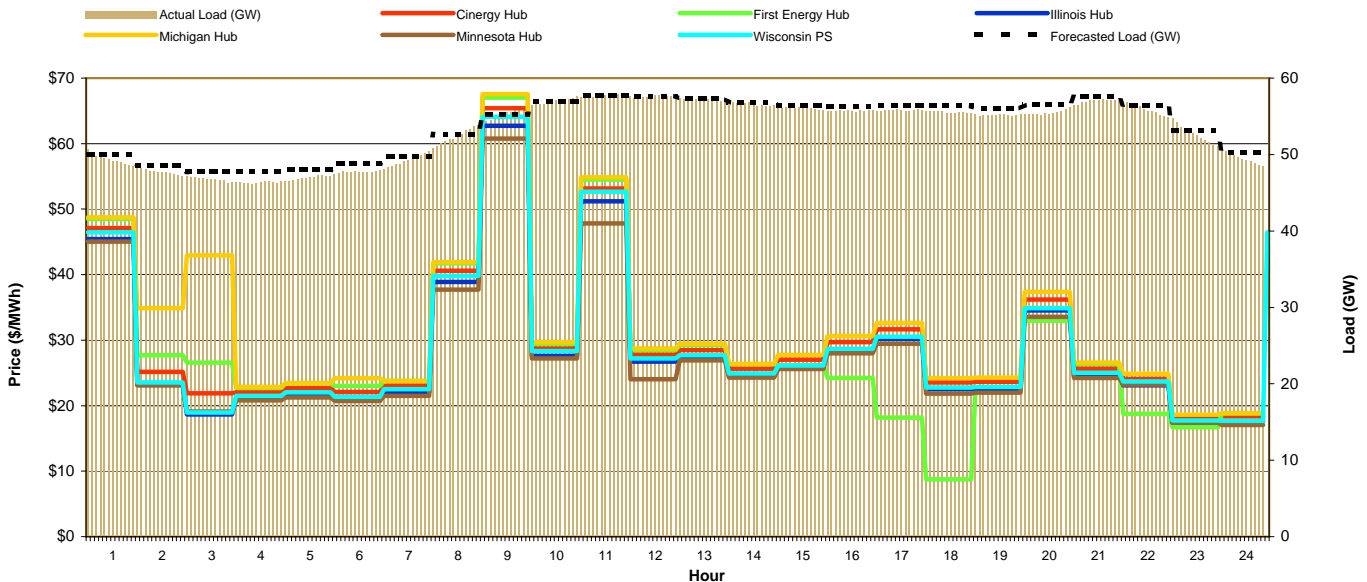




MISO Daily Report

Sunday May 16, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	20.32	19.55	19.00	18.93	19.37	19.58	21.22	23.28	24.45	24.65	25.50	25.95	25.85	25.64	25.40	25.35	26.43	26.58	26.97	29.43	36.80	26.66	22.10	20.60	24.15	26.32
First Energy Hub	20.99	19.98	19.80	19.72	20.07	20.05	21.86	23.38	24.46	24.61	25.13	25.15	25.08	25.03	24.96	24.88	25.46	25.59	25.85	27.30	33.13	25.62	22.44	20.43	23.79	25.50
Illinois Hub	16.57	15.15	14.98	13.89	14.68	15.42	16.20	20.30	22.64	23.66	24.47	24.86	24.77	24.59	24.36	24.31	25.21	25.28	25.61	27.88	34.63	25.50	18.56	15.37	21.62	24.79
Michigan Hub	24.41	22.86	22.07	21.73	22.31	22.96	24.15	24.08	25.46	25.76	26.61	27.03	26.93	26.73	26.50	26.44	27.51	27.67	28.06	30.51	37.80	28.01	24.40	21.47	25.89	27.47
Minnesota Hub	18.81	18.03	17.44	17.20	17.72	18.33	19.25	21.17	22.54	22.83	24.37	24.85	24.62	24.90	24.65	24.48	25.70	26.07	26.07	28.98	35.02	25.63	20.89	19.20	22.86	25.17
Wisconsin PS	19.30	18.52	17.90	17.64	18.19	18.61	20.63	22.94	24.70	25.01	25.97	26.44	26.32	26.16	25.92	25.85	26.98	27.16	27.51	30.09	36.21	27.15	21.32	19.71	24.01	26.61
Cleared Load (GW)	49.9	48.2	47.4	48.1	51.2	56.6	62.9	66.2	66.7	67.3	67.5	67.9	68.3	68.2	67.7	66.8	66.1	65.3	64.3	66.1	67.9	63.3	57.2	5.3		

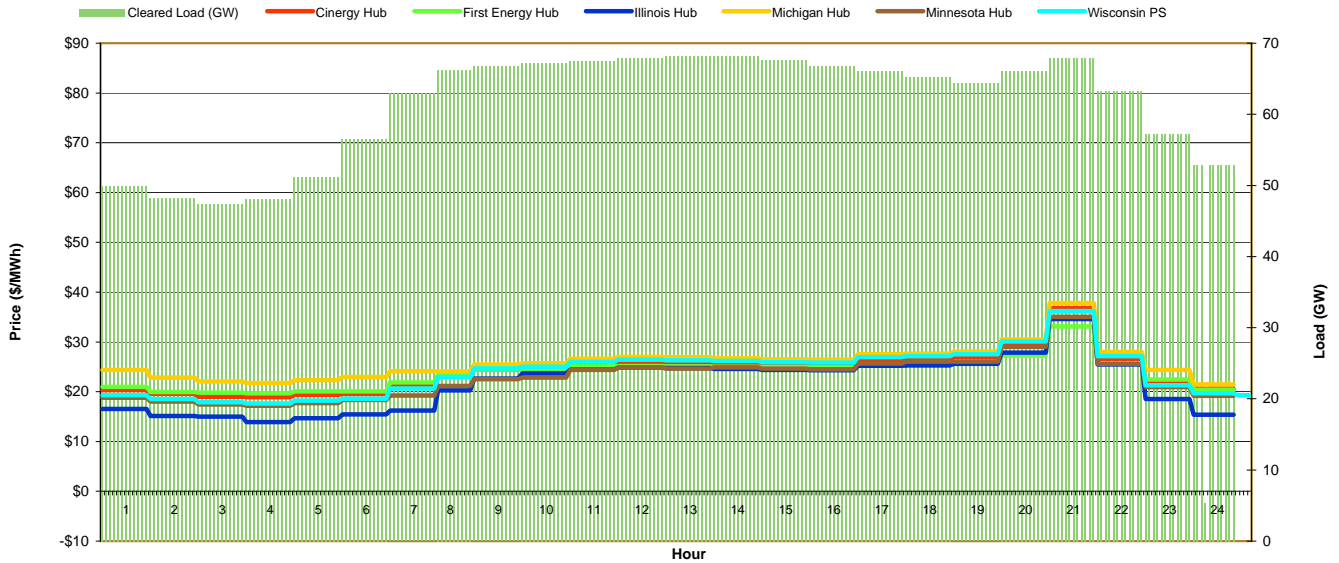

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	23.68	21.74	21.56	21.32	23.53	33.31	53.58	31.35	31.32	28.35	37.45	39.13	40.02	29.59	28.20	33.33	31.01	29.22	41.92	26.84	28.22	24.13	22.83	21.39	30.13	31.43
First Energy Hub	37.14	22.83	22.69	22.86	25.21	35.20	65.96	32.94	32.89	29.97	39.17	41.74	42.34	31.17	31.86	38.47	31.95	33.71	46.67	27.74	29.14	24.98	24.02	21.98	32.61	33.67
Illinois Hub	16.15	20.93	20.71	20.07	22.66	31.63	51.49	30.17	30.22	27.78	36.36	38.73	39.52	29.16	29.43	35.29	29.38	30.88	43.23	25.86	27.25	23.11	22.05	20.17	29.26	31.15
Michigan Hub	84.91	29.21	28.96	25.90	28.45	37.43	56.24	33.11	33.13	30.09	39.14	41.64	42.38	31.42	32.06	38.71	32.15	33.67	46.98	27.87	29.30	25.04	24.02	21.98	35.58	33.81
Minnesota Hub	20.43	21.08	20.46	19.52	21.67	31.14	49.65	71.66	69.90	27.25	34.72	25.53	11.33	21.24	16.95	16.86	28.67	30.71	42.24	24.93	26.84	23.35	22.49	20.49	29.13	30.92
Wisconsin PS	16.91	-0.89	-2.58	20.33	22.51	32.49	53.82	36.65	36.57	29.67	38.38	56.31	77.52	39.80	46.02	58.64	30.91	32.86	45.39	26.94	28.74	24.55	23.38	21.27	33.17	39.52
Forecasted Load (GW)	52.8	51.4	50.7	51.0	53.0	56.6	61.5	65.1	66.4	67.0	67.7	67.9	68.0	68.1	67.8	67.4	67.1	66.5	65.8	66.4	67.3	65.0	60.6	56.2		
Forecast Error %	-27.3%	-1.9%	-1.9%	-1.9%	0.2%	0.4%	0.1%	-0.2%	-0.2%	-0.4%	-0.8%	-0.9%	-1.2%	-2.0%	-2.3%	-2.2%	-2.0%	-1.5%	-1.2%	-1.0%	-2.2%	-3.1%	-12.2%			

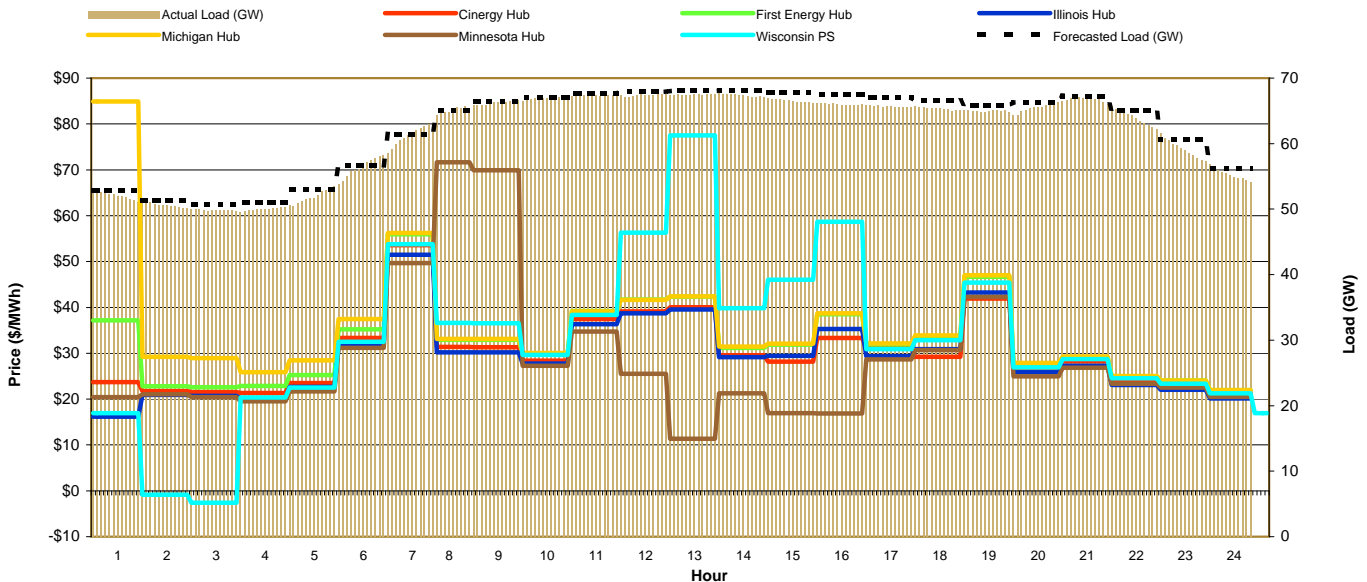




MISO Daily Report

Monday May 17, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	20.21	19.38	19.16	19.84	21.03	24.82	30.07	36.96	40.78	44.70	44.50	44.53	45.56	44.27	44.14	41.46	38.98	34.51	32.91	34.78	42.13	31.67	23.78	21.98	33.42	39.10
First Energy Hub	20.63	19.97	19.72	20.27	21.42	27.06	32.40	38.63	42.00	44.73	44.46	44.51	45.46	44.26	44.56	42.64	39.16	35.45	34.68	36.22	42.55	30.24	25.17	24.65	34.20	39.67
Illinois Hub	15.89	15.95	15.69	15.99	14.43	22.02	27.88	33.71	37.60	41.30	41.24	41.30	42.12	41.03	40.85	38.29	35.96	31.89	30.31	32.06	38.87	29.37	22.28	19.76	30.24	36.14
Michigan Hub	23.50	23.04	22.71	22.98	25.62	36.04	41.70	49.73	51.42	48.03	46.51	46.60	47.35	46.17	49.54	51.13	46.14	42.32	41.86	42.39	47.03	41.45	30.13	35.65	39.96	45.49
Minnesota Hub	18.66	17.90	17.66	18.16	18.48	23.14	26.70	33.62	37.09	42.58	43.33	43.38	44.14	44.61	44.81	43.76	38.83	33.95	32.72	33.32	42.00	30.47	23.44	20.09	32.20	38.25
Wisconsin PS	19.15	18.28	18.02	18.41	19.09	23.30	29.48	34.06	38.04	41.04	41.06	41.16	41.73	40.78	40.69	38.50	36.41	32.82	31.35	32.88	38.96	30.62	22.91	20.34	31.21	36.44
Cleared Load (GW)	45.8	44.6	44.2	44.9	47.9	54.1	61.2	63.8	65.1	65.4	66.0	66.1	66.1	65.9	65.5	64.8	64.2	63.9	63.2	63.6	64.5	61.7	55.5	5.2		

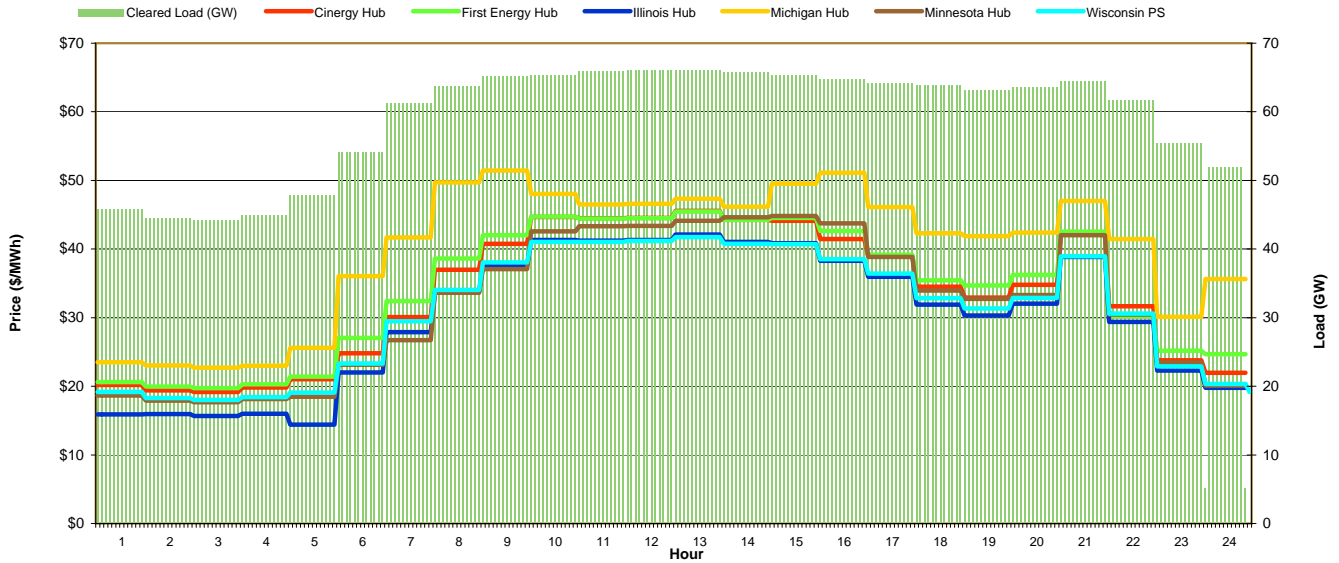

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	17.90	17.15	20.67	20.32	20.65	24.68	25.50	32.48	33.11	32.05	38.18	28.24	28.55	30.59	36.44	29.15	40.76	31.75	27.00	27.57	26.11	26.15	20.28	20.18	27.31	30.53
First Energy Hub	18.44	17.61	21.36	20.87	21.27	27.25	26.31	33.62	34.35	33.33	39.71	29.30	29.65	31.79	37.82	30.22	42.25	32.89	27.98	28.68	27.19	27.21	28.39	20.97	28.69	32.15
Illinois Hub	16.84	16.39	13.94	18.18	19.52	22.29	24.13	31.13	31.88	30.93	36.92	27.39	27.55	29.59	35.04	28.10	39.39	30.68	26.08	26.66	25.38	25.38	15.34	19.51	25.76	29.22
Michigan Hub	18.41	17.50	21.55	20.65	21.10	21.07	26.12	33.40	34.13	33.10	39.34	28.87	29.22	31.49	37.60	30.11	42.22	32.91	28.05	28.62	27.03	27.12	60.31	20.87	29.62	33.97
Minnesota Hub	16.86	15.71	13.17	17.41	19.11	23.02	23.35	30.62	31.50	30.92	36.41	27.30	27.26	29.39	34.89	28.42	40.50	31.93	27.01	27.10	26.09	26.58	18.65	20.65	25.99	29.66
Wisconsin PS	17.06	16.62	12.46	17.86	19.76	23.08	24.73	32.24	32.91	32.03	37.97	28.16	28.41	30.63	36.17	28.98	40.79	31.77	26.88	27.36	26.19	26.31	16.40	20.36	26.46	30.20
Forecasted Load (GW)	48.7	47.6	47.3	47.9	50.1	54.1	59.2	62.7	64.5	65.8	66.5	66.8	66.9	66.7	66.0	65.3	64.5	63.4	62.6	63.1	64.1	61.6	57.6	53.7		
Forecast Error %	-1.6%	-1.9%	-1.8%	-1.8%	-1.5%	-0.2%	-0.2%	0.1%	0.3%	0.2%	0.3%	0.2%	-0.1%	0.0%	0.6%	0.6%	1.5%	2.2%	1.7%	1.0%	1.2%	-0.2%	-10.0%			

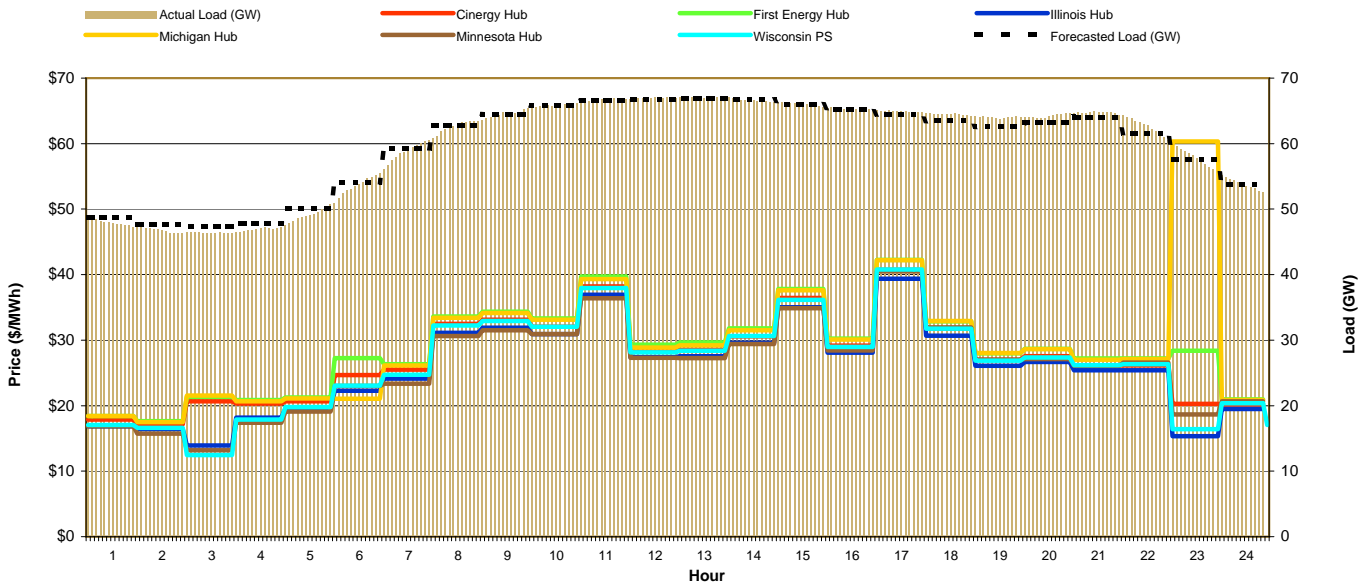




MISO Daily Report

Tuesday May 18, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$			
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk		
Cinergy Hub	22.08	21.11	21.02	21.57	22.48	25.19	30.43	37.59	39.39	41.18	41.51	41.59	42.36	40.96	40.69	38.03	36.90	32.58	30.37	31.84	38.51	28.32	24.20	21.44	32.14	36.63		
First Energy Hub	24.34	23.17	23.02	23.52	24.64	27.98	33.32	40.08	41.87	43.56	44.06	44.16	44.54	43.25	43.00	40.70	39.21	35.37	32.61	34.71	40.66	30.56	26.83	24.15	34.55	39.07		
Illinois Hub	19.29	18.61	18.23	18.43	19.10	22.78	27.40	34.10	36.97	39.55	40.11	40.03	40.70	39.20	38.91	36.23	34.51	30.05	28.22	29.27	36.16	26.23	21.49	19.30	29.79	34.48		
Michigan Hub	30.63	28.83	28.30	28.34	30.19	37.72	40.94	44.07	44.68	45.25	45.43	46.55	45.59	45.15	45.06	44.26	43.75	42.43	37.72	42.20	44.47	35.92	39.50	32.64	39.57	43.25		
Minnesota Hub	19.10	18.19	18.02	18.19	18.58	21.96	26.92	33.58	36.00	38.66	39.54	40.95	41.08	40.28	39.83	37.46	36.03	29.79	27.48	28.91	36.02	26.85	22.21	19.61	29.80	34.67		
Wisconsin PS	19.18	18.32	18.06	18.16	18.53	22.27	28.38	35.12	38.27	41.10	41.73	41.66	42.31	40.80	40.48	37.72	35.97	31.33	29.39	30.54	37.67	27.36	22.07	19.82	30.67	35.84		
Cleared Load (GW)	49.0	47.3	46.6	47.3	49.3	55.2	61.9	64.5	66.1	66.5	67.0	67.3	67.4	67.1	67.0	66.9	66.5	65.4	64.5	65.4	66.8	63.0	57.1	5.3				

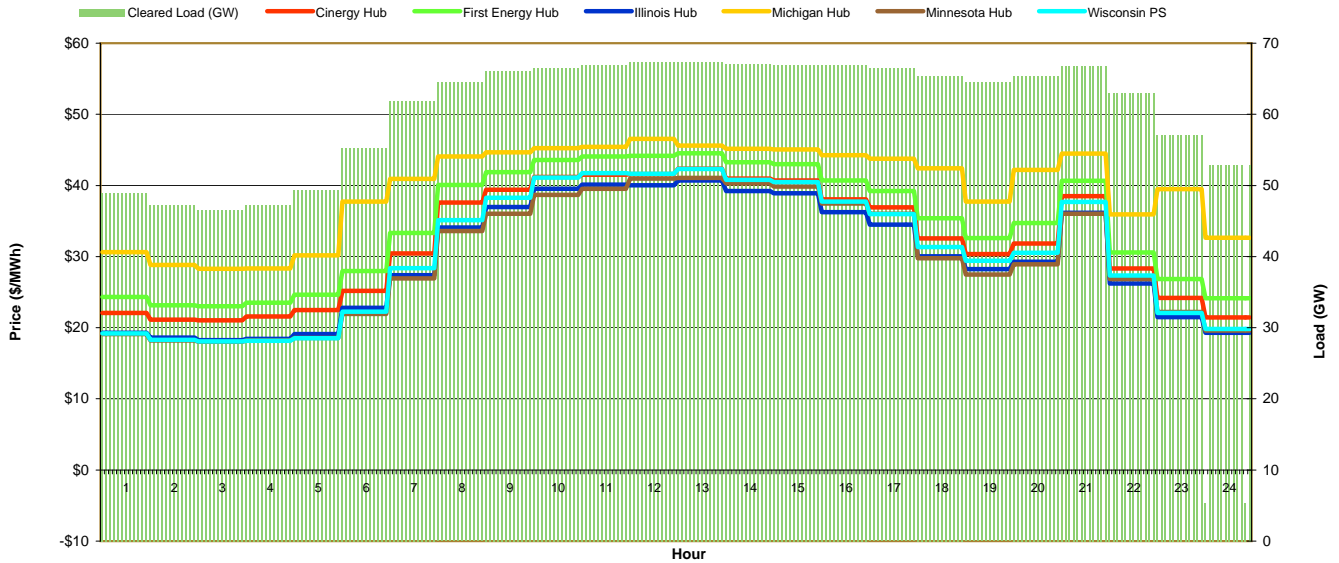

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$			
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk		
Cinergy Hub	21.33	20.76	22.34	22.13	23.34	27.88	23.53	24.95	23.76	25.68	28.96	28.68	31.08	40.75	24.57	25.26	24.65	24.25	24.46	24.11	26.48	24.63	20.71	21.57	25.24	26.44		
First Energy Hub	23.30	21.49	23.16	23.08	24.22	34.91	24.38	26.81	26.33	27.78	32.01	29.80	32.49	45.59	25.40	26.19	25.59	25.14	25.31	24.98	27.31	25.48	19.83	19.43	26.67	27.88		
Illinois Hub	19.67	19.92	18.74	15.24	21.03	22.91	22.53	24.85	24.22	25.37	29.29	27.33	29.92	42.24	23.48	24.12	23.54	23.15	23.35	23.08	25.51	23.74	19.80	17.50	23.77	25.81		
Michigan Hub	28.49	21.37	23.23	23.28	24.12	57.94	24.34	26.81	26.25	27.48	31.93	29.86	32.68	45.94	25.52	26.32	25.68	25.20	25.41	25.04	27.48	25.63	21.63	52.53	29.34	28.05		
Minnesota Hub	20.70	20.21	18.90	15.32	21.13	21.04	21.79	24.43	23.73	24.87	28.96	27.15	27.27	35.31	23.33	24.37	23.78	23.59	23.87	22.01	21.08	24.44	52.01	8.70	24.08	26.89		
Wisconsin PS	20.31	20.22	18.38	14.07	21.17	16.91	22.09	25.47	24.99	26.33	30.47	28.35	25.65	28.99	24.03	25.05	24.45	23.94	24.24	20.93	16.27	24.90	22.81	-6.78	21.80	24.80		
Forecasted Load (GW)	51.5	50.1	49.4	49.8	51.7	55.6	60.6	63.9	65.3	66.3	66.9	67.1	67.0	66.7	66.1	65.5	64.9	64.1	63.4	63.7	64.7	62.6	58.5	54.2				
Forecast Error %	-0.9%	-1.0%	-0.9%	-1.3%	-0.9%	0.0%	-0.6%	-0.6%	-0.5%	0.0%	0.2%	0.4%	0.6%	0.7%	0.8%	0.6%	0.4%	0.6%	0.1%	0.3%	0.1%	-1.0%	-0.5%					

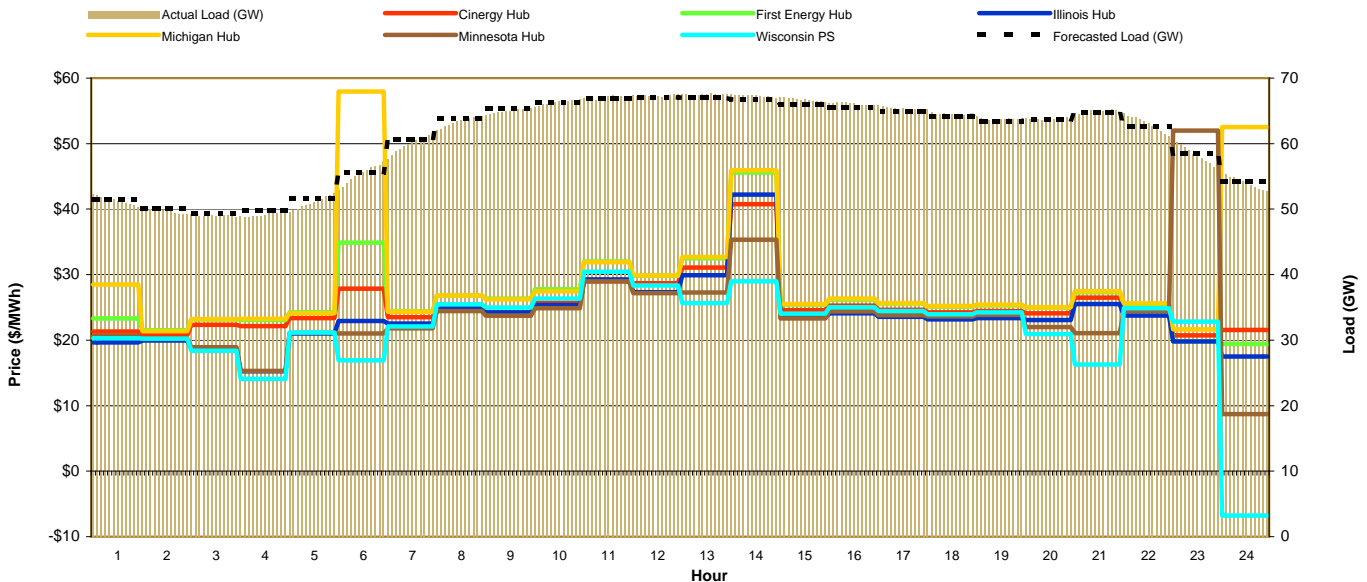




MISO Daily Report

Wednesday May 19, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	20.39	19.28	19.18	19.55	20.90	23.86	26.31	29.42	32.54	34.11	34.34	34.91	35.25	33.81	33.64	32.77	31.56	29.15	27.19	28.17	32.16	26.60	23.45	21.63	27.92	31.19
First Energy Hub	22.23	20.80	20.62	20.77	22.02	26.16	29.55	32.70	35.49	36.91	36.05	37.02	37.55	35.70	35.55	35.33	34.26	31.15	28.89	30.45	35.10	28.12	24.48	22.62	29.98	33.42
Illinois Hub	18.79	17.88	17.72	17.62	18.85	21.66	23.68	25.00	29.97	31.57	32.38	32.45	32.88	31.69	31.52	30.07	29.05	27.11	25.40	26.01	29.51	24.54	21.98	20.46	25.74	28.82
Michigan Hub	27.31	24.76	24.20	23.19	23.84	33.80	39.28	41.97	42.93	43.34	38.25	40.93	42.19	38.85	38.80	41.32	41.01	35.38	32.15	35.98	42.79	34.32	27.58	24.13	34.93	38.61
Minnesota Hub	18.92	17.99	17.93	17.88	18.44	22.27	25.42	30.34	33.75	34.25	37.02	38.59	40.17	39.75	40.26	39.01	37.35	34.75	30.47	30.52	34.31	29.07	26.70	21.31	29.85	34.77
Wisconsin PS	18.28	17.38	17.14	17.04	17.71	20.68	24.92	28.17	31.94	33.64	34.86	35.33	35.03	33.90	33.75	32.53	31.11	29.23	27.17	27.74	31.45	26.19	22.98	19.58	26.99	30.94
Cleared Load (GW)	50.4	48.9	48.2	48.3	50.5	56.3	62.3	65.3	66.9	67.5	68.4	68.6	68.7	68.7	68.4	68.0	66.8	65.7	64.4	64.8	66.7	63.1	57.3	5.3		

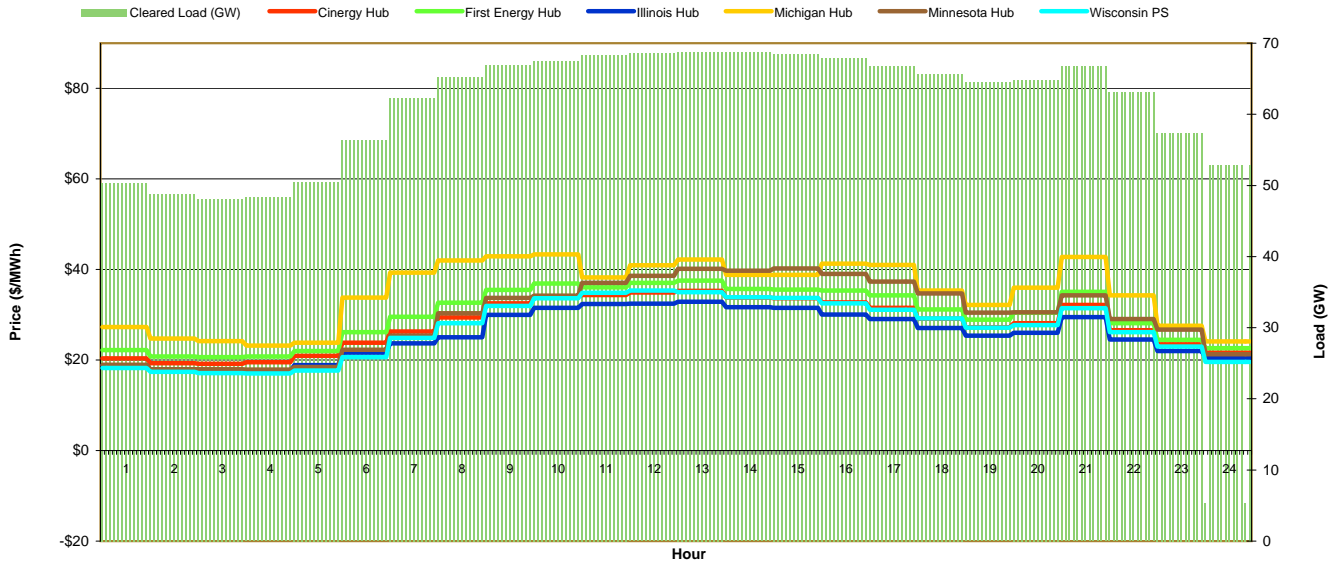

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	14.42	16.24	23.45	22.56	27.45	23.42	24.61	25.31	27.84	26.46	26.68	27.06	29.13	29.60	26.85	25.30	25.83	26.52	25.25	28.07	83.36	25.51	22.06	21.35	27.26	30.05
First Energy Hub	11.81	14.90	12.83	8.77	1.81	17.71	25.42	26.16	28.77	27.32	27.56	27.91	30.03	30.45	27.66	26.08	26.55	27.26	25.82	28.54	84.58	25.82	22.48	21.80	25.34	30.81
Illinois Hub	13.86	15.25	9.91	7.43	16.77	21.19	22.83	24.29	26.75	25.44	25.67	25.99	27.90	28.35	25.70	24.17	24.73	25.31	24.19	26.93	80.21	24.71	21.31	20.47	24.56	28.85
Michigan Hub	14.95	16.87	25.35	24.55	29.11	24.28	25.68	26.40	29.18	27.74	28.02	28.47	30.76	31.29	28.39	26.74	27.18	27.95	26.53	29.56	88.13	26.86	23.09	22.22	28.72	31.64
Minnesota Hub	41.43	50.92	29.56	21.24	27.33	42.34	26.83	26.44	32.37	29.63	33.87	46.14	41.43	39.80	34.86	40.16	35.72	62.71	30.59	31.35	80.88	31.93	23.27	21.73	36.77	38.82
Wisconsin PS	-4.90	12.67	-0.15	6.06	14.66	24.08	23.33	25.11	28.03	27.30	28.27	30.52	30.93	31.10	28.12	27.38	27.31	31.55	26.29	28.77	84.16	26.86	22.69	21.47	25.07	31.52
Forecasted Load (GW)	52.9	50.5	49.8	49.9	51.6	55.9	60.6	63.9	65.3	66.4	67.2	67.5	67.6	67.5	67.0	66.5	66.0	65.1	64.2	64.6	65.6	63.7	59.4	55.0		
Forecast Error %	-3.4%	-1.8%	-1.9%	-1.7%	-0.9%	-1.7%	-1.6%	-1.1%	-0.7%	-0.4%	-0.4%	-0.2%	0.1%	0.2%	0.4%	0.2%	-0.1%	-0.2%	-0.3%	-0.9%	-0.4%	-0.5%	-1.4%	-1.5%		

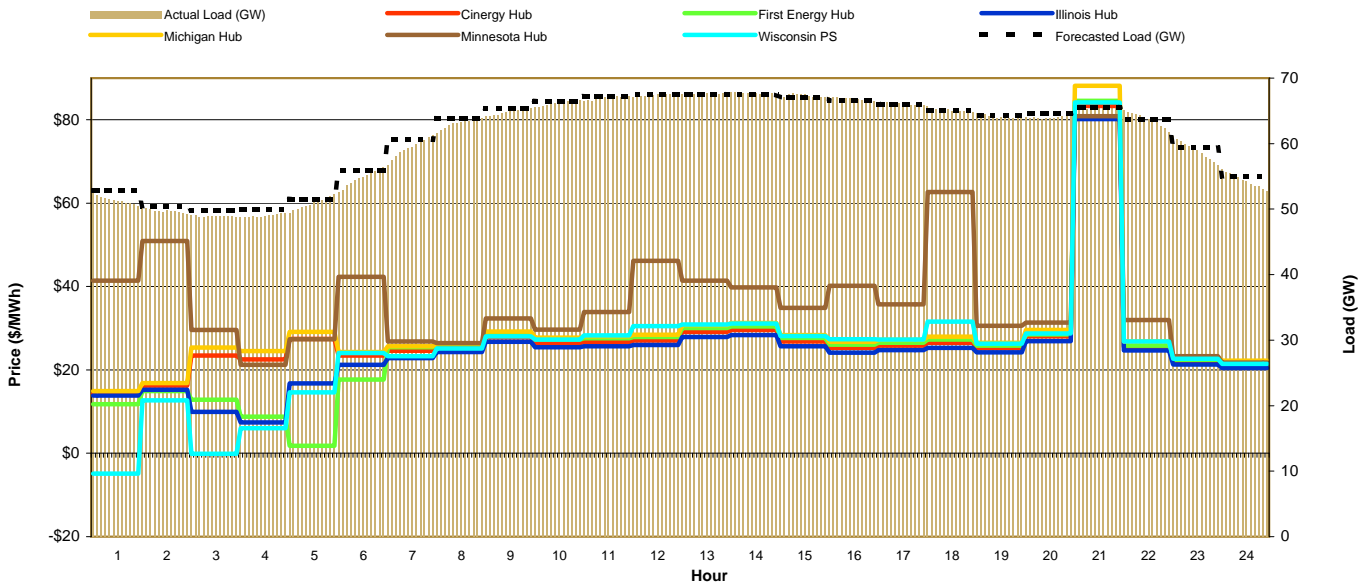




MISO Daily Report

Thursday May 20, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	21.43	20.07	19.76	20.04	21.39	25.17	28.60	30.88	35.49	36.87	37.85	40.05	40.90	40.44	40.05	41.31	38.15	34.22	30.15	30.28	36.41	29.60	24.81	22.40	31.10	35.47
First Energy Hub	22.23	21.10	20.83	20.84	22.85	26.35	29.05	30.73	34.20	35.91	37.39	40.81	41.70	43.39	40.61	39.80	36.19	33.77	30.19	30.44	34.03	27.82	23.78	22.68	31.11	35.05
Illinois Hub	19.22	18.19	17.87	18.29	18.66	22.81	26.55	28.36	33.00	34.00	35.51	37.69	38.28	38.07	37.06	37.17	36.07	31.64	27.59	27.71	34.65	27.67	23.24	20.46	28.74	32.98
Michigan Hub	33.25	29.42	29.32	28.29	38.17	37.30	36.03	40.32	42.74	43.67	44.16	44.99	43.07	43.33	43.13	42.65	39.46	42.36	40.40	41.18	37.83	35.21	29.70	31.73	38.24	40.89
Minnesota Hub	23.64	21.89	21.11	21.17	21.59	27.64	28.91	32.36	35.34	37.19	38.11	41.20	40.39	41.02	41.11	41.19	37.11	35.27	31.64	29.85	35.95	30.85	25.59	20.99	31.71	35.89
Wisconsin PS	18.84	17.77	17.10	17.13	17.31	21.10	25.78	29.81	33.79	35.07	36.45	38.70	38.67	38.75	37.80	37.65	36.31	32.82	28.96	29.09	36.35	29.31	23.31	19.51	29.06	33.93
Cleared Load (GW)	48.7	47.5	46.9	47.4	49.1	54.4	62.2	65.5	66.9	67.8	68.2	68.7	69.1	69.0	68.8	68.5	68.3	66.9	65.9	66.0	67.4	63.6	57.9	5.4		

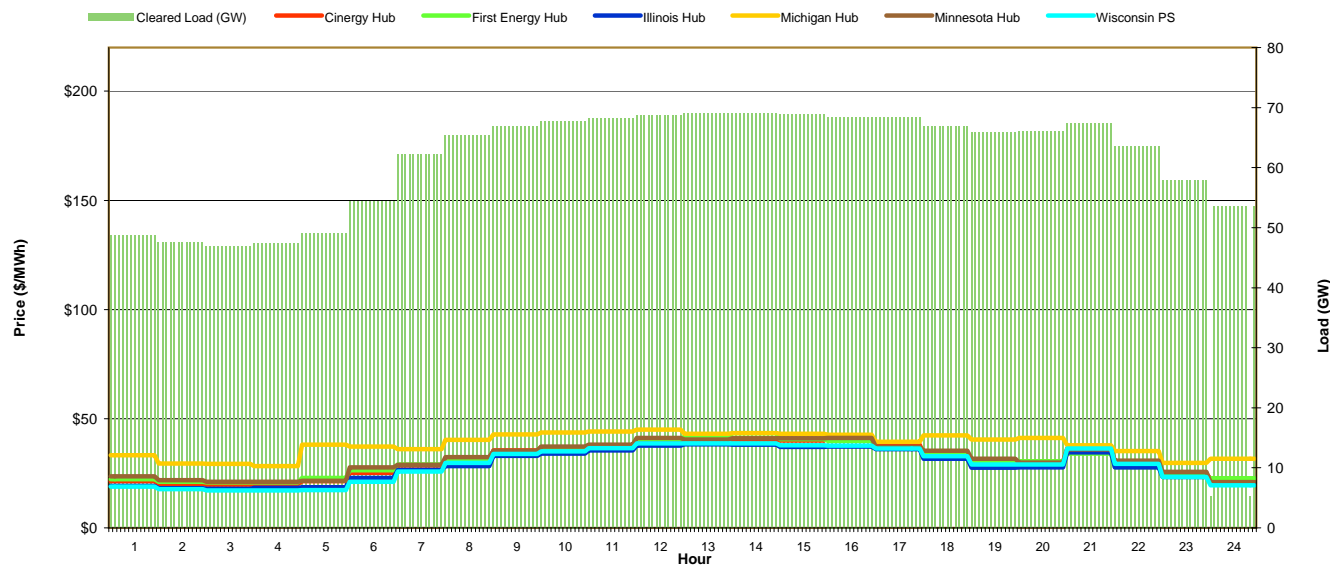

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	22.17	18.85	20.51	21.96	23.24	24.97	27.39	42.05	37.42	28.93	35.13	28.31	32.35	63.28	31.70	34.41	33.91	27.43	60.16	29.50	31.61	31.53	26.61	18.75	31.34	35.90
First Energy Hub	23.59	19.28	20.95	22.48	23.77	25.52	27.96	42.89	37.16	29.60	40.43	30.29	33.29	65.04	39.45	35.40	34.84	28.46	92.84	30.36	39.67	32.36	29.60	29.34	34.77	40.11
Illinois Hub	20.67	17.97	19.12	18.29	18.89	21.97	25.67	40.44	34.97	27.67	33.44	26.86	30.65	60.38	30.14	34.71	32.62	26.09	39.81	28.10	30.10	30.12	24.11	12.24	28.54	33.14
Michigan Hub	27.65	19.87	21.31	22.93	24.25	25.94	28.50	43.87	38.02	30.33	37.06	29.88	34.10	66.75	33.80	36.52	35.74	29.42	212.86	30.94	33.19	33.16	39.11	67.94	41.80	47.80
Minnesota Hub	21.60	18.32	19.39	18.35	19.02	21.61	24.54	39.50	34.99	30.21	46.28	34.44	33.00	44.73	29.37	25.51	20.79	24.04	41.94	27.93	30.18	31.52	26.62	17.89	28.41	32.57
Wisconsin PS	21.42	18.46	19.47	18.05	18.67	22.02	26.02	41.59	36.35	29.12	36.28	28.98	32.27	62.43	31.65	33.90	33.20	26.75	40.84	28.89	31.12	31.52	25.42	13.30	29.49	34.39
Forecasted Load (GW)	52.0	51.2	50.3	50.5	52.2	55.4	60.1	63.6	65.5	66.9	67.9	68.6	68.9	69.1	68.8	68.4	67.8	66.9	65.6	65.7	66.6	64.2	60.1	55.8		
Forecast Error %	-1.1%	-2.7%	-2.7%	-2.6%	-2.0%	-0.3%	-0.1%	0.4%	0.8%	1.1%	1.3%	1.1%	1.0%	1.3%	0.9%	0.4%	-0.2%	-0.7%	0.1%	0.1%	0.4%	0.0%	-1.1%	-1.2%		

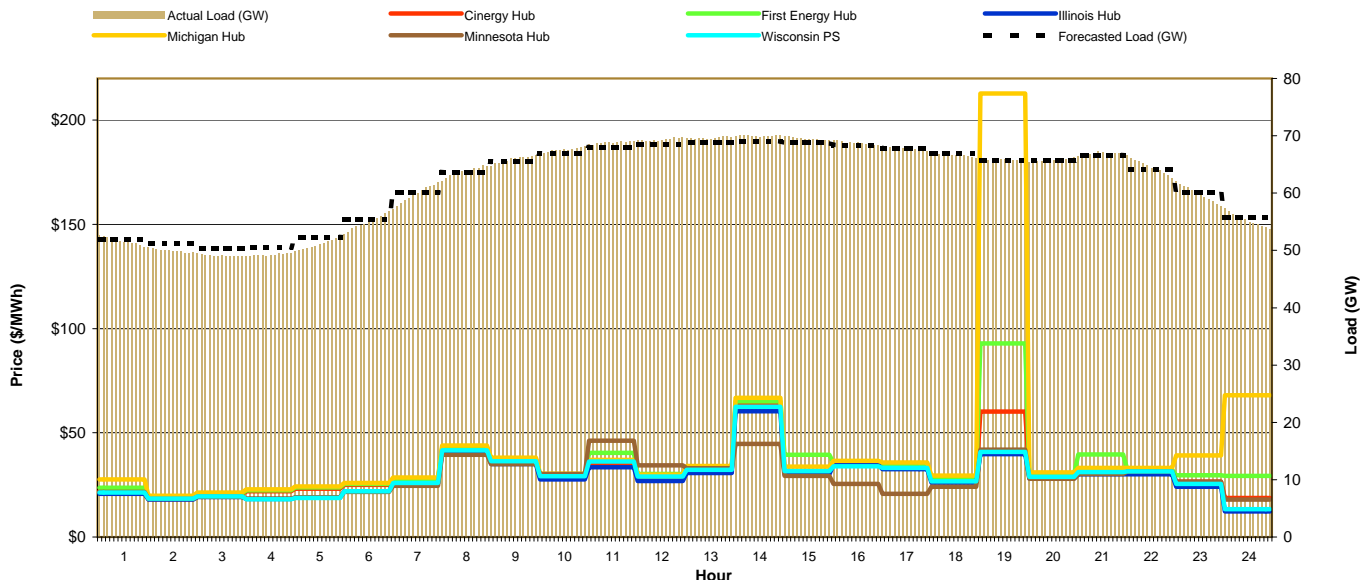




MISO Daily Report

Friday May 21, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$			
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk		
Cinergy Hub	21.33	20.18	19.79	20.05	21.10	24.23	29.56	33.30	38.04	40.78	43.40	42.02	43.09	41.87	41.13	40.61	39.54	34.88	31.58	32.05	35.73	30.47	25.13	22.85	32.20	37.10		
First Energy Hub	22.64	21.44	21.07	21.32	22.29	25.32	31.10	34.54	39.02	41.81	44.05	42.76	43.66	42.52	40.43	39.38	40.71	36.07	32.63	33.11	36.92	29.69	26.15	23.58	33.01	37.72		
Illinois Hub	19.87	18.87	18.51	18.77	19.80	22.80	27.68	31.25	35.91	38.72	41.44	40.14	41.19	40.03	39.33	38.82	37.53	33.33	30.15	30.58	34.10	28.91	23.55	21.79	30.54	35.31		
Michigan Hub	26.50	24.47	23.91	24.15	25.07	28.24	34.83	38.34	42.68	44.15	45.28	43.31	44.45	43.20	42.43	41.88	43.03	35.96	32.53	33.05	36.80	32.43	27.42	23.86	34.92	39.18		
Minnesota Hub	19.28	18.55	17.82	17.83	18.61	20.85	25.67	30.38	34.55	37.36	39.88	38.99	39.78	38.74	37.75	37.24	35.96	32.42	29.05	29.29	32.75	28.15	25.90	22.57	29.56	34.26		
Wisconsin PS	18.95	18.12	17.57	17.69	18.54	21.13	26.96	32.47	37.28	40.22	43.02	41.72	42.79	41.59	40.76	40.25	38.95	34.63	31.30	31.74	35.40	30.06	24.62	22.11	31.16	36.67		
Cleared Load (GW)	51.4	49.6	48.8	49.0	50.7	55.9	62.6	65.9	67.2	67.5	67.7	68.1	68.4	67.7	67.3	66.9	65.9	64.6	63.5	63.7	65.3	62.0	55.8	5.2				

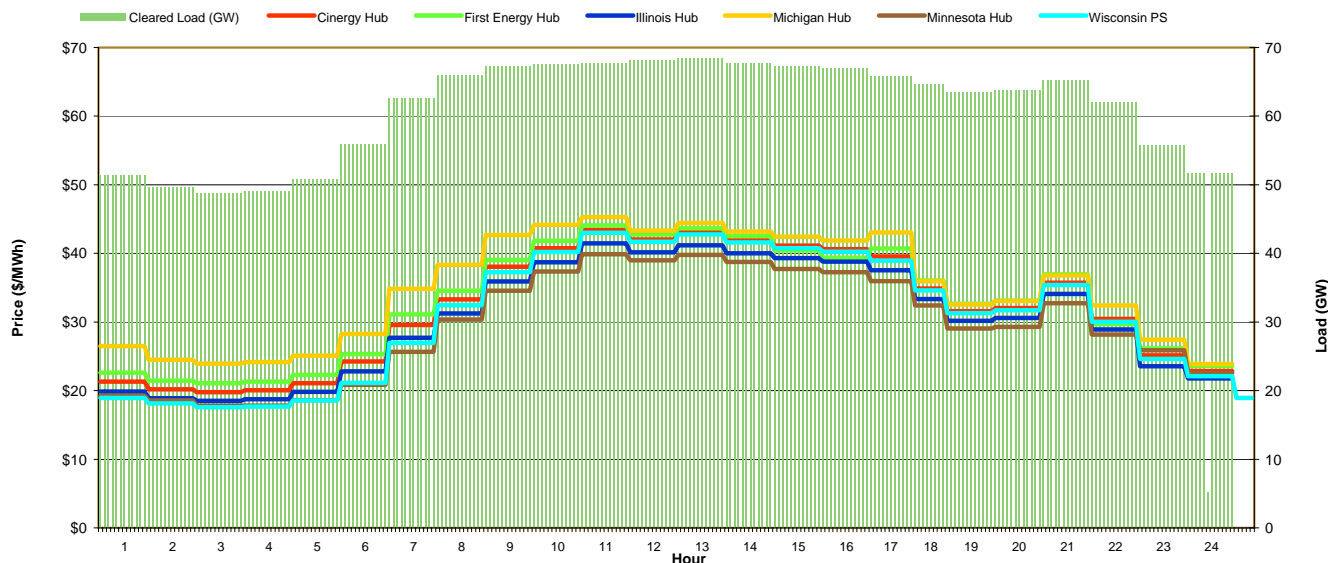

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$			
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk		
Cinergy Hub	18.24	20.53	18.52	21.89	22.07	24.33	23.41	25.84	25.78	30.90	56.48	30.86	49.50	57.91	32.55	27.93	30.90	28.08	27.28	31.59	25.86	38.01	22.87	23.03	29.77	33.90		
First Energy Hub	18.66	28.99	21.38	35.11	33.61	26.91	23.88	26.45	26.57	32.86	62.99	33.90	52.84	59.70	33.49	28.70	31.71	28.81	29.12	32.56	26.81	39.01	23.50	23.72	32.55	35.56		
Illinois Hub	17.43	18.68	17.73	17.27	20.34	23.26	22.56	25.02	24.92	29.25	54.86	30.02	48.01	56.09	31.61	27.18	30.02	27.24	27.45	30.58	25.24	37.06	22.24	22.21	28.59	32.92		
Michigan Hub	19.02	21.54	19.30	52.32	24.48	25.38	24.33	27.02	27.04	37.85	59.06	32.26	51.63	60.24	33.82	28.99	32.18	29.26	29.65	33.18	27.20	39.59	23.74	23.94	32.63	35.79		
Minnesota Hub	18.28	19.20	18.10	18.62	20.55	23.72	22.40	25.11	25.09	29.83	55.55	30.30	47.81	55.77	31.23	26.76	29.44	26.72	26.90	29.56	24.14	36.10	22.49	23.13	28.62	32.68		
Wisconsin PS	18.20	19.10	18.23	17.60	20.67	23.91	23.10	25.77	25.84	30.45	57.04	31.30	50.04	58.36	32.61	28.06	31.00	28.14	28.29	31.25	25.78	38.00	22.96	22.96	29.53	34.05		
Forecasted Load (GW)	54.6	52.9	52.0	52.2	53.7	56.9	61.3	64.4	66.3	67.6	68.3	68.6	68.8	68.8	68.2	67.4	66.1	64.5	62.9	62.7	63.5	61.8	57.0	52.8				
Forecast Error %	-39.4%	-4.8%	-5.2%	-4.9%	-4.1%	-1.9%	-1.5%	-0.3%	-0.4%	-0.4%	-0.5%	-0.6%	-1.0%	-1.4%	-1.6%	-1.3%	-0.4%	0.2%	-0.1%	-0.2%	-0.1%	0.9%	-7.4%					

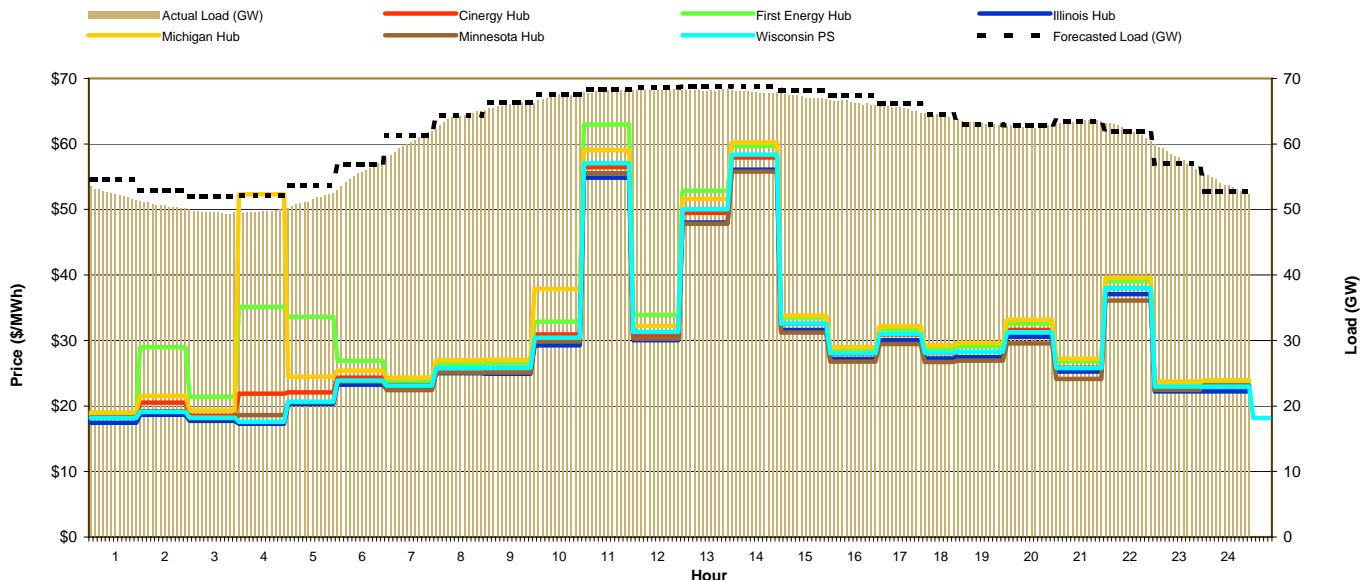




MISO Daily Report

Saturday May 22, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$			
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk		
Cinergy Hub	22.91	21.61	20.66	20.23	20.37	20.69	22.48	24.51	25.64	27.68	30.18	31.02	31.69	32.96	34.25	35.51	37.31	36.60	32.10	31.37	38.34	28.02	24.23	22.18	28.02	31.34		
First Energy Hub	24.30	24.05	22.78	22.31	22.44	22.66	26.12	28.39	27.45	29.50	32.06	32.89	33.39	34.21	35.53	36.83	38.69	37.96	33.36	32.71	39.76	29.78	25.44	23.13	29.82	33.00		
Illinois Hub	21.47	19.63	18.87	18.48	18.62	18.98	20.29	22.19	24.40	26.41	28.77	29.59	30.23	31.71	32.99	34.18	35.82	35.16	30.91	30.16	36.88	26.77	22.86	21.03	26.52	29.94		
Michigan Hub	27.14	31.19	28.75	28.16	28.23	27.99	36.43	38.55	29.97	31.70	34.23	34.94	34.75	33.81	35.12	36.39	38.19	37.48	33.21	32.94	39.28	31.77	27.46	24.39	32.59	34.36		
Minnesota Hub	22.65	20.31	20.26	20.10	20.42	21.88	24.62	30.43	32.06	35.50	35.71	35.73	35.93	35.78	34.57	35.64	37.10	36.76	33.47	32.50	38.09	35.21	27.31	23.59	30.23	34.49		
Wisconsin PS	20.84	18.50	18.16	17.74	17.75	18.07	19.59	23.95	25.68	28.64	29.38	29.65	30.62	30.89	29.97	31.21	33.43	32.75	28.58	28.03	33.89	28.74	21.18	18.66	25.66	29.16		
Cleared Load (GW)	49.3	48.1	47.2	46.9	47.6	49.0	51.0	55.8	58.9	61.1	62.9	63.4	63.5	63.4	63.6	63.9	64.6	64.7	63.7	63.2	65.4	62.2	56.9	5.3				

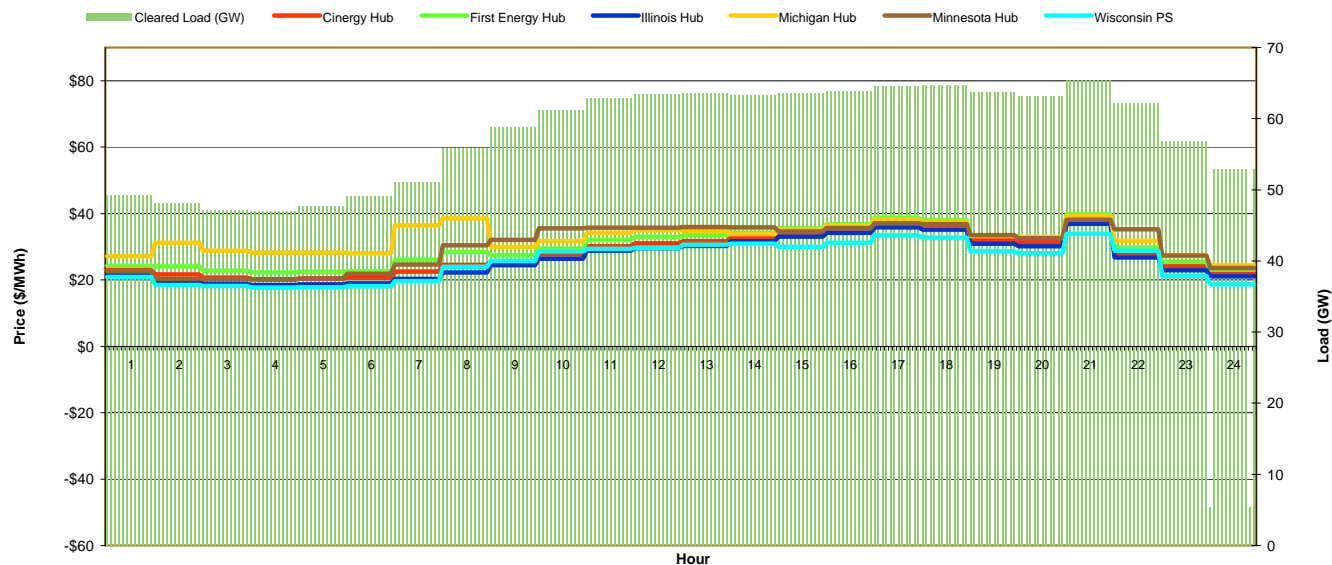

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$			
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk		
Cinergy Hub	22.55	20.79	19.47	22.61	17.90	-18.57	20.27	22.55	24.54	31.30	24.10	24.83	24.80	31.12	29.32	24.50	24.91	27.03	25.64	24.07	25.68	23.69	19.90	19.24	22.18	25.50		
First Energy Hub	23.19	23.35	19.93	35.34	18.31	-18.99	20.71	23.09	24.95	31.80	24.67	25.35	25.33	31.75	30.84	25.84	25.59	27.55	26.26	24.56	26.16	24.23	20.27	19.79	23.33	26.14		
Illinois Hub	20.88	15.13	18.61	17.14	22.45	-12.08	19.59	21.69	23.61	30.05	23.07	24.21	22.87	26.93	25.64	29.68	24.73	28.19	25.02	28.84	31.75	22.86	19.03	16.49	21.93	25.51		
Michigan Hub	23.63	31.73	20.28	82.43	18.50	-19.18	20.90	23.35	25.46	32.54	25.15	25.84	25.82	31.44	30.30	26.51	26.27	28.35	27.06	25.13	26.82	24.97	20.85	20.91	26.04	26.62		
Minnesota Hub	25.39	15.35	18.21	15.31	13.17	-11.32	25.39	20.68	14.00	23.28	21.36	21.13	22.10	6.77	-1.26	15.57	21.46	21.84	23.11	18.14	18.45	22.68	19.72	16.89	16.98	18.06		
Wisconsin PS	21.61	2.08	18.58	14.99	17.45	-49.87	-23.16	-18.75	-25.06	-17.16	10.71	21.68	22.48	13.06	2.86	-6.20	21.76	19.87	24.01	23.57	25.15	23.55	19.69	16.46	7.47	10.08		
Forecasted Load (GW)	50.2	48.3	47.7	47.4	48.0	48.9	50.4	52.7	55.9	58.5	59.8	60.6	61.0	61.4	62.0	63.0	63.8	64.1	63.5	62.9	63.4	61.7	57.4	52.9				
Forecast Error %	1.2%	1.3%	0.1%	0.3%	-0.1%	-0.2%	0.3%	2.6%	2.5%	1.9%	1.8%	1.5%	0.8%	-0.1%	-0.9%	-1.8%	-2.0%	-2.2%	-1.6%	-1.7%	-1.0%	0.1%	1.0%	2.3%				

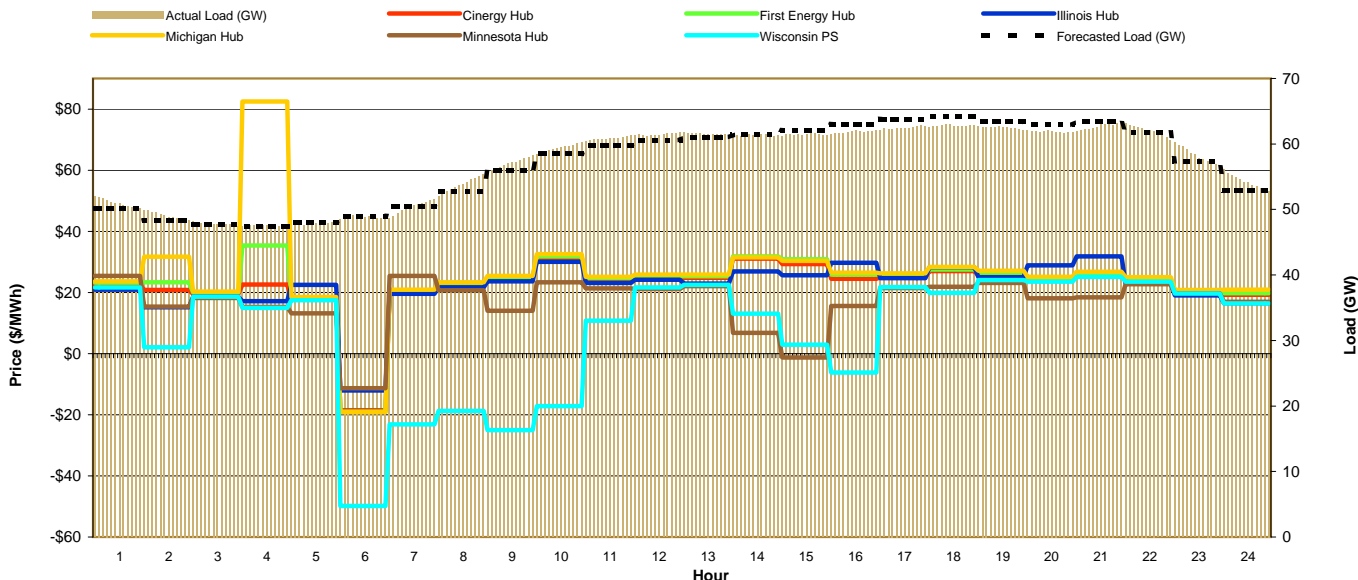




MISO Daily Report

Sunday May 23, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	20.56	19.60	18.43	17.82	18.14	18.14	21.07	22.77	25.53	28.34	31.98	33.98	37.17	43.00	46.66	48.41	49.77	51.94	48.05	45.96	51.24	42.39	27.61	24.63	33.05	39.68
First Energy Hub	21.74	21.47	20.09	19.41	19.69	19.41	22.56	23.67	26.56	29.73	33.71	35.30	38.58	44.62	48.48	50.28	51.71	53.97	49.93	47.75	53.25	44.09	28.37	25.96	34.60	41.25
Illinois Hub	19.34	18.39	16.99	16.50	16.83	16.93	20.07	22.00	24.70	27.28	30.71	32.90	36.00	41.66	45.18	46.89	48.20	50.29	46.53	44.51	49.63	41.05	26.36	22.95	31.75	38.37
Michigan Hub	24.13	26.66	24.64	23.81	23.81	22.47	25.11	23.49	26.36	30.55	35.20	35.90	39.29	45.39	50.50	52.27	53.42	55.37	51.75	49.66	54.96	43.73	28.37	30.46	36.55	42.26
Minnesota Hub	20.22	18.68	16.98	15.43	16.50	16.53	19.21	24.27	29.31	30.27	32.99	34.37	36.00	39.47	44.46	44.22	46.82	50.11	48.75	43.54	47.32	43.86	28.41	22.51	32.09	39.01
Wisconsin PS	15.38	14.29	12.71	11.70	12.55	12.45	15.16	17.87	23.32	24.52	29.09	30.02	28.23	31.52	35.98	34.81	37.83	41.69	43.51	39.82	42.46	41.90	26.36	21.17	26.84	33.06
Cleared Load (GW)	50.0	48.8	47.6	47.2	47.6	46.9	50.0	54.2	58.0	62.1	65.4	67.7	69.0	69.7	70.6	72.3	73.9	73.8	72.8	71.6	73.6	69.9	64.7	6.0		

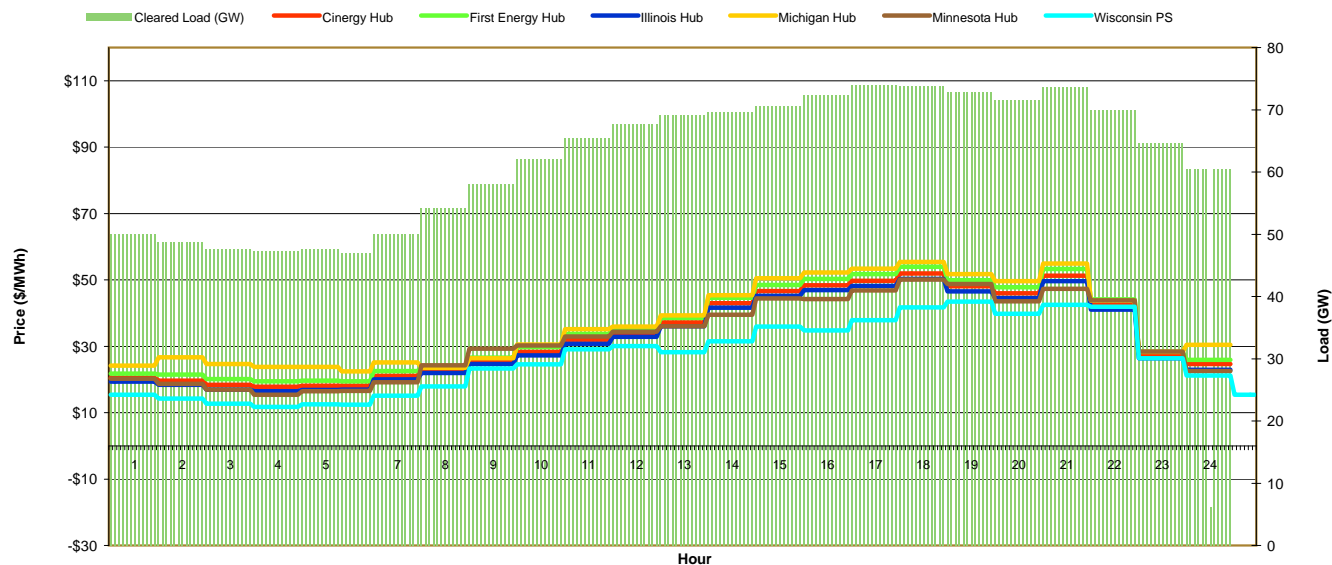

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	4.36	16.06	14.78	15.73	17.02	-24.96	-22.53	19.47	20.58	22.72	22.75	24.85	26.60	28.96	28.99	28.96	46.46	29.60	30.98	86.38	68.34	29.57	24.62	22.29	24.27	33.74
First Energy Hub	4.45	18.59	15.03	16.00	17.30	-25.34	-22.89	19.78	20.19	22.93	22.92	25.06	26.74	29.04	30.96	33.80	56.75	29.75	31.21	85.94	68.20	29.52	24.62	22.32	25.12	34.84
Illinois Hub	4.11	13.89	14.20	15.14	16.38	-24.02	-21.63	18.70	19.72	21.78	21.87	23.88	25.66	28.06	30.03	32.77	55.17	29.06	30.70	84.56	66.95	29.03	24.16	21.77	24.25	33.88
Michigan Hub	4.55	28.56	15.30	16.27	17.57	-25.63	-23.19	20.04	21.26	23.51	23.55	25.72	27.53	29.98	31.88	34.52	57.71	30.33	31.88	87.86	69.91	30.31	25.33	22.98	26.16	35.71
Minnesota Hub	5.69	14.55	14.41	15.22	16.56	-24.54	-22.10	19.41	20.02	21.88	21.39	23.49	25.73	28.35	30.49	32.71	55.14	35.86	36.14	118.99	99.93	72.94	52.70	23.45	30.77	43.45
Wisconsin PS	4.35	14.17	14.56	15.56	16.87	-24.78	-22.38	19.53	20.52	22.62	22.54	24.58	26.50	28.88	30.77	33.45	55.99	29.77	32.07	91.73	72.94	34.95	28.27	22.89	25.68	35.94
Forecasted Load (GW)	50.5	49.2	47.8	47.1	46.9	46.6	47.5	51.1	55.3	58.5	61.9	64.6	66.6	68.2	69.6	71.0	72.0	72.6	72.1	71.5	72.1	70.1	64.6	59.8		
Forecast Error %	-40.5%	-0.5%	-0.1%	0.2%	0.4%	0.2%	0.6%	0.3%	0.3%	1.1%	0.9%	0.6%	0.6%	0.4%	0.3%	0.4%	1.2%	1.5%	2.3%	2.6%	3.2%	3.7%	4.2%	-4.5%		

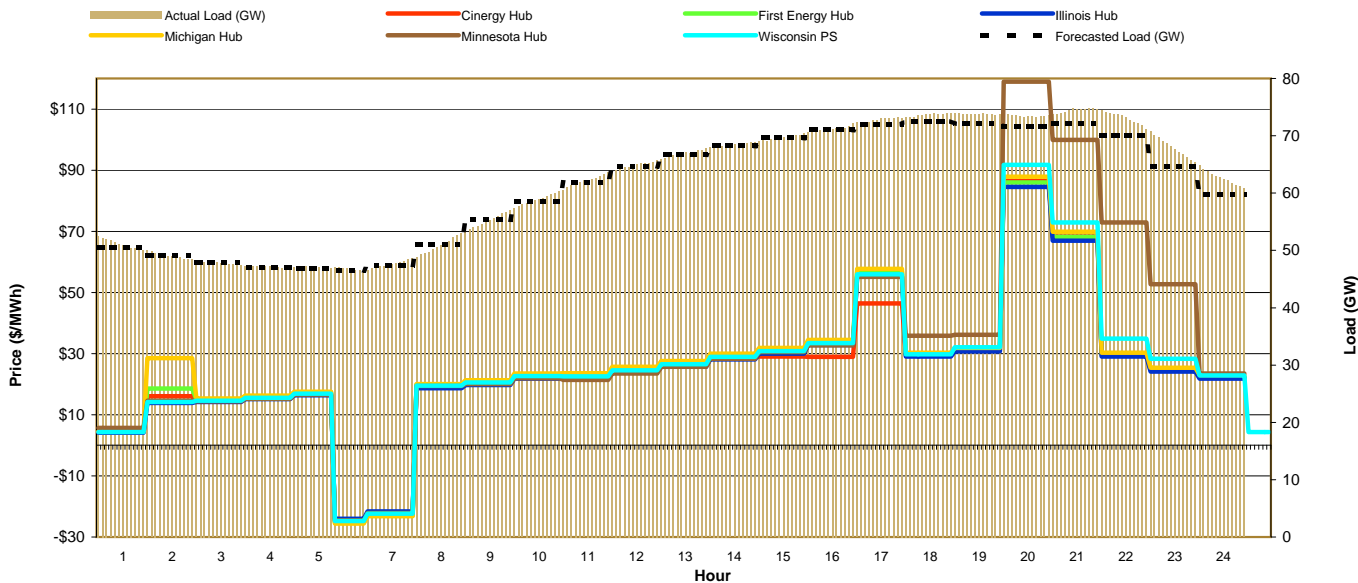




MISO Daily Report

Monday May 24, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	21.07	19.64	18.76	18.71	19.90	22.46	26.66	28.79	33.00	37.58	42.37	47.15	53.65	59.49	62.13	64.38	60.56	56.88	50.12	47.07	50.36	40.76	27.78	24.67	38.91	47.63
First Energy Hub	22.91	21.53	20.27	20.45	21.99	24.51	29.01	30.79	30.41	33.16	43.05	37.65	55.62	54.84	64.25	66.58	54.83	43.55	37.24	36.16	41.19	32.58	26.19	24.79	36.40	43.01
Illinois Hub	20.12	18.73	17.57	17.51	19.39	21.22	24.07	26.73	31.55	34.96	39.96	45.00	57.49	65.05	69.14	71.71	61.12	54.56	47.43	44.49	47.75	39.10	25.69	22.59	38.46	47.61
Michigan Hub	29.42	27.41	24.03	25.11	27.93	29.95	34.50	40.62	42.96	50.22	50.77	50.57	56.79	64.04	65.28	67.45	63.52	60.02	55.20	55.33	54.88	46.75	40.76	40.33	45.99	54.07
Minnesota Hub	20.59	19.12	18.79	18.64	19.13	22.31	28.40	32.38	36.67	37.59	44.02	44.34	49.24	53.63	55.88	55.88	52.21	48.33	48.95	47.52	50.47	44.06	30.38	26.93	37.73	45.72
Wisconsin PS	19.71	18.37	17.80	17.62	18.60	21.18	25.81	28.26	33.25	37.48	43.47	50.16	55.76	64.69	65.67	68.05	65.65	64.62	52.67	48.21	52.73	42.89	26.69	22.93	40.09	50.01
Cleared Load (GW)	56.5	54.5	53.4	53.7	56.3	61.0	68.6	73.6	77.0	80.2	82.8	85.1	87.0	88.3	89.4	89.6	89.2	87.8	85.9	83.9	84.7	79.5	71.4	6.6		

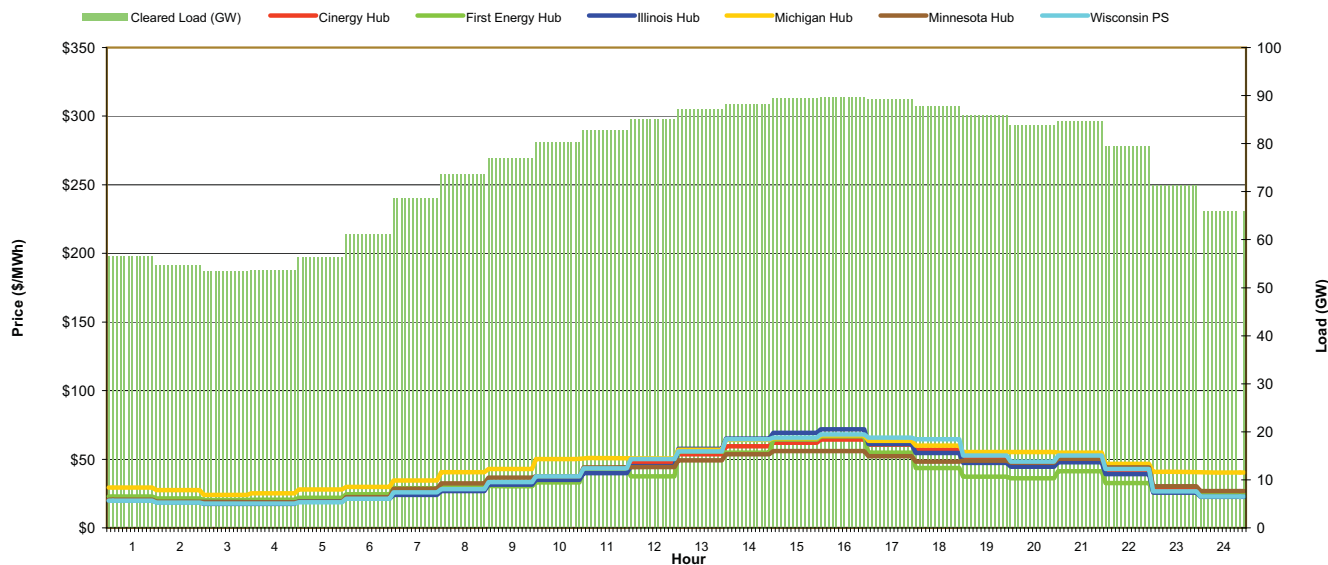

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	23.64	19.21	17.72	19.21	20.28	22.90	25.35	27.67	57.90	44.71	87.73	46.66	61.08	78.65	71.15	60.50	165.64	171.72	52.98	51.29	142.44	33.72	26.92	26.83	56.50	73.80
First Energy Hub	33.68	19.36	17.89	19.38	21.04	27.64	25.35	28.90	58.89	37.87	89.05	50.17	55.84	73.31	45.94	22.27	162.62	167.83	47.74	26.86	69.35	16.35	25.94	26.74	48.75	61.18
Illinois Hub	16.02	18.69	17.20	18.64	19.34	19.49	24.68	28.37	72.13	55.56	132.82	154.71	290.65	284.74	237.56	178.20	331.21	342.84	48.35	33.26	139.95	26.14	25.74	26.35	105.94	148.89
Michigan Hub	78.71	19.83	18.26	19.73	23.71	46.92	26.18	29.96	75.70	57.64	92.29	52.02	57.89	75.16	66.57	65.25	172.63	173.81	49.70	34.94	147.66	33.99	27.05	28.05	61.40	75.77
Minnesota Hub	24.68	18.98	17.12	18.41	19.01	21.73	36.97	67.47	131.21	111.27	147.38	106.76	104.71	144.87	118.10	123.88	231.06	204.29	77.50	81.67	215.67	94.04	62.09	66.14	93.54	126.37
Wisconsin PS	17.59	19.48	17.80	19.26	19.93	20.56	27.27	34.53	83.68	64.65	101.88	62.56	65.99	86.96	76.88	74.42	186.73	154.22	49.43	40.59	157.04	40.98	31.36	32.09	61.91	81.99
Forecasted Load (GW)	57.5	55.3	54.1	53.9	55.6	58.6	63.6	68.9	73.5	77.6	81.3	84.3	86.6	87.9	88.5	88.7	88.4	87.4	86.0	84.3	83.4	79.9	72.6	66.5		
Forecast Error %	2.0%	1.6%	1.2%	1.2%	3.2%	4.2%	4.8%	4.7%	4.4%	4.1%	3.5%	3.3%	3.3%	3.5%	3.7%	3.8%	4.0%	3.5%	2.9%	2.6%	2.7%	2.7%	2.2%			

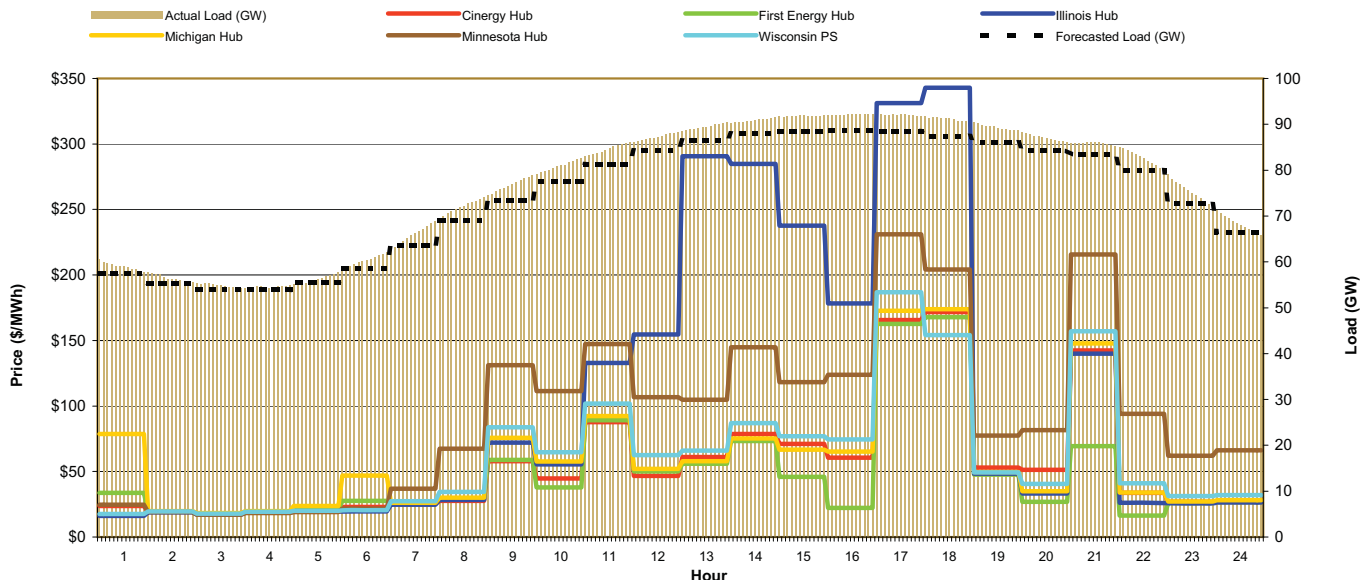




MISO Daily Report

Tuesday May 25, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
																									All	On Pk		
Cinergy Hub	23.45	21.09	19.97	20.05	20.95	23.97	30.61	34.00	36.44	41.90	47.96	56.51	64.70	71.41	72.97	73.77	70.73	65.66	57.81	53.68	53.47	41.26	30.83	27.29	44.19	54.57		
First Energy Hub	24.06	22.80	21.87	21.94	23.06	25.71	30.23	32.51	32.81	47.71	51.76	56.40	60.93	68.78	70.43	72.23	68.30	65.03	59.03	53.25	55.13	43.95	27.77	25.72	44.23	54.13		
Illinois Hub	22.10	20.57	19.89	20.12	19.96	20.99	27.63	33.44	37.14	46.38	53.24	58.22	68.22	78.41	81.19	82.93	66.70	63.96	54.85	50.92	51.82	40.71	28.46	24.89	44.70	56.04		
Michigan Hub	37.36	33.82	29.15	29.17	36.31	42.22	46.06	51.56	46.57	55.05	60.00	59.81	64.55	72.71	74.02	75.89	71.90	68.27	69.56	63.39	63.14	51.75	35.72	39.85	53.24	61.49		
Minnesota Hub	27.11	21.84	20.74	20.16	21.46	26.70	32.35	39.43	45.69	48.72	51.03	56.33	60.69	68.06	68.95	70.01	67.75	64.26	53.29	49.80	54.01	44.25	36.30	26.77	44.82	54.91		
Wisconsin PS	22.24	19.74	19.01	19.03	19.27	22.09	29.51	35.76	39.76	46.01	48.93	55.50	61.20	68.84	70.14	71.43	68.36	62.97	55.36	53.63	49.44	41.71	28.86	25.53	43.09	53.62		
Cleared Load (GW)	62.6	60.2	58.4	58.2	59.9	64.8	72.0	75.9	79.1	81.7	84.4	86.7	88.1	88.8	89.6	89.4	89.4	87.7	85.5	84.3	84.4	79.4	70.3	6.6				

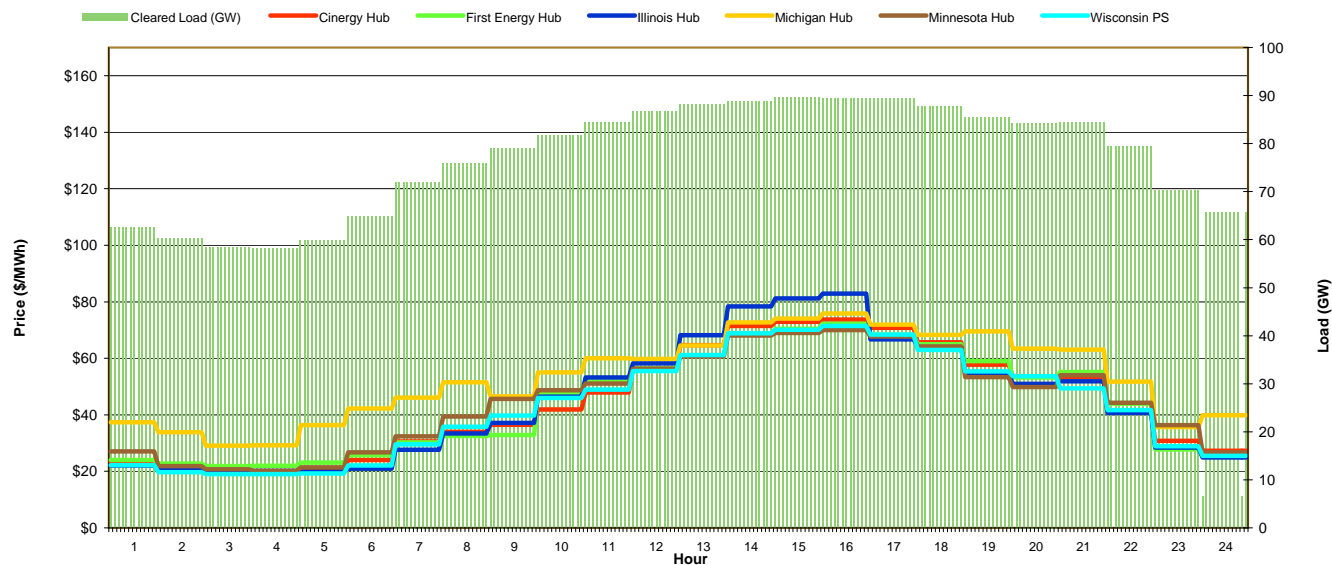

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
																									All	On Pk		
Cinergy Hub	24.28	20.86	18.94	20.61	20.51	19.77	21.94	26.49	27.84	43.82	48.19	33.18	106.01	61.41	56.75	67.07	77.59	48.15	31.61	29.41	42.20	38.26	27.70	26.84	39.14	47.86		
First Energy Hub	24.01	21.01	19.10	20.80	22.57	19.91	22.12	26.79	30.13	47.11	48.75	33.36	106.97	62.06	57.29	66.34	76.89	48.51	31.77	29.52	42.40	38.40	27.81	26.39	39.58	48.38		
Illinois Hub	23.57	20.47	18.52	20.09	18.91	19.15	21.30	25.92	27.85	55.16	160.05	33.08	105.71	33.26	56.59	65.20	75.70	47.87	31.47	29.17	41.74	37.98	27.35	25.86	42.58	53.38		
Michigan Hub	25.26	21.85	19.77	21.46	30.37	20.51	22.86	27.88	35.22	49.25	51.26	35.20	112.74	64.96	59.76	68.94	80.01	50.62	33.28	30.98	44.36	40.18	29.18	27.62	41.81	50.86		
Minnesota Hub	55.64	30.36	21.29	19.66	18.94	19.11	21.22	26.60	28.59	36.36	47.55	44.32	105.46	59.38	56.36	60.19	83.28	50.16	34.70	27.66	35.64	35.52	28.39	26.71	40.55	47.51		
Wisconsin PS	27.91	22.29	19.41	20.67	19.58	20.01	22.33	27.50	29.65	16.21	18.56	34.58	85.35	51.51	50.41	45.68	53.81	35.77	29.31	25.61	35.48	34.00	28.77	27.29	32.57	37.63		
Forecasted Load (GW)	65.0	61.9	59.9	59.2	60.5	64.1	69.4	75.1	78.3	82.3	85.5	88.1	90.0	91.3	91.8	91.8	91.3	90.2	88.2	86.0	85.0	81.1	74.2	67.8				
Forecast Error %	-3.1%	-3.4%	-3.6%	-3.8%	-3.7%	-3.6%	-3.1%	-2.0%	-2.8%	-3.2%	-3.3%	-3.3%	-2.9%	-2.7%	-2.6%	-2.5%	-3.0%	-3.2%	-3.5%	-3.3%	-3.3%	-3.4%	-3.9%	-3.9%				

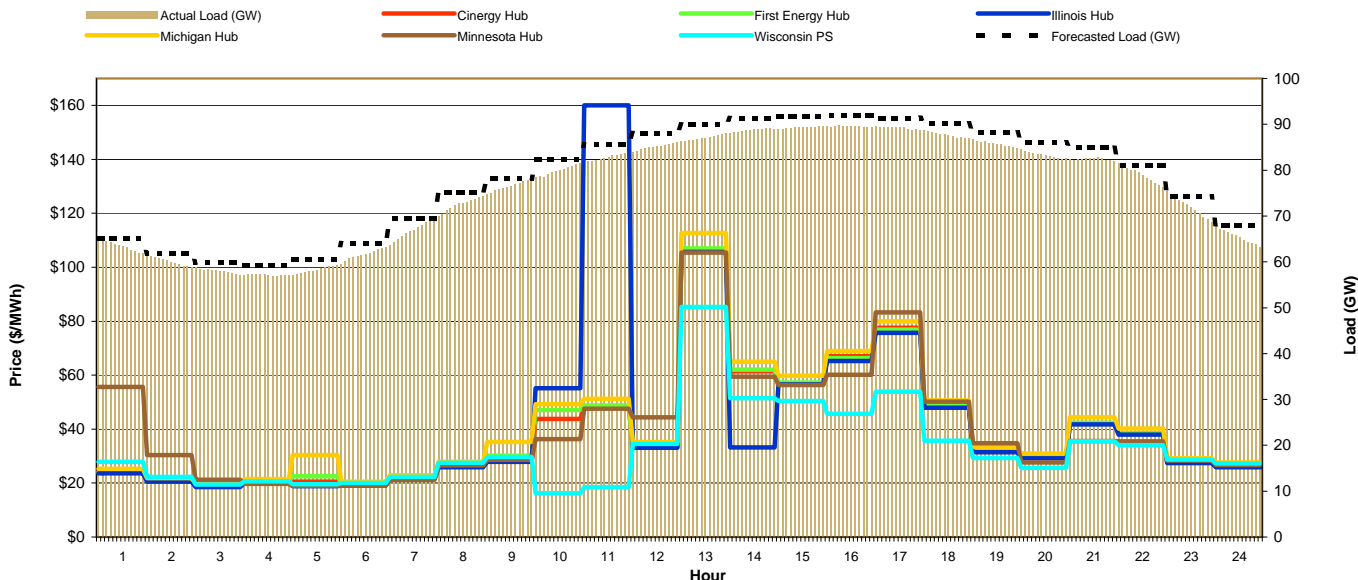




MISO Daily Report

Wednesday May 26, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	24.01	21.60	20.38	20.21	20.92	24.17	29.42	35.97	35.38	40.49	45.55	51.72	59.52	68.37	72.97	75.00	65.59	61.43	53.60	48.74	50.73	39.61	28.08	25.08	42.44	52.05
First Energy Hub	24.33	22.76	22.19	22.09	23.10	25.57	27.89	31.94	32.43	39.54	45.53	30.17	31.23	29.74	64.59	68.56	66.76	61.49	56.00	50.71	50.31	39.14	27.79	24.97	38.28	45.37
Illinois Hub	21.41	19.00	18.57	18.37	18.12	19.09	24.24	30.51	39.21	46.97	59.20	66.91	71.84	80.74	82.13	90.46	88.42	75.92	64.64	57.29	53.41	36.11	25.06	22.53	47.09	60.55
Michigan Hub	37.58	30.54	29.27	29.36	36.12	42.95	49.50	49.55	45.25	50.80	59.46	62.88	64.60	68.31	69.78	73.51	70.37	69.75	68.19	63.12	60.80	47.76	44.02	38.20	52.57	60.51
Minnesota Hub	22.95	20.87	19.70	19.65	19.93	23.32	27.26	35.75	38.53	39.48	44.16	48.10	49.67	49.69	51.95	55.55	49.35	51.85	47.39	43.66	48.06	37.87	30.01	25.02	37.49	45.07
Wisconsin PS	22.01	20.18	19.09	18.91	19.07	21.69	26.09	31.77	36.76	39.16	43.84	44.87	46.10	49.83	51.41	54.51	52.89	51.88	49.71	47.40	49.60	37.91	26.14	23.28	36.84	44.61
Cleared Load (GW)	61.2	58.6	57.0	56.6	58.3	62.8	69.4	74.0	76.6	80.4	83.6	85.4	87.6	89.1	89.7	89.6	89.5	88.3	85.5	84.1	84.1	79.3	71.0	6.5		

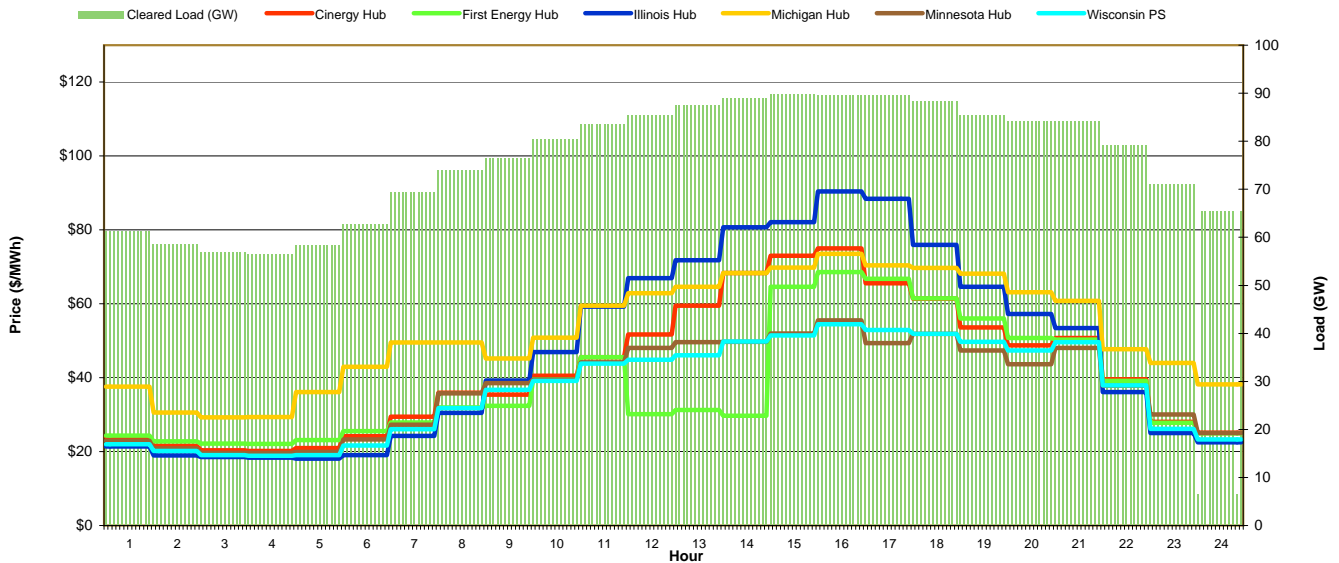

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	27.71	20.68	21.91	22.32	21.14	23.75	29.05	36.34	28.62	65.36	61.26	51.39	77.07	66.12	65.51	60.10	57.82	50.65	32.00	44.66	38.66	30.45	23.65	20.70	40.71	49.35
First Energy Hub	37.15	20.91	27.71	29.32	21.87	27.27	48.00	54.73	28.73	70.18	73.91	62.04	18.63	15.19	16.17	51.46	58.45	50.99	0.42	42.47	4.66	19.71	23.91	20.91	34.37	36.98
Illinois Hub	16.76	20.22	18.04	17.82	20.14	21.08	18.34	25.73	27.99	41.37	51.31	44.73	76.07	60.77	54.37	59.24	56.77	49.65	31.39	39.00	37.03	29.95	23.22	20.85	35.91	44.29
Michigan Hub	87.90	21.64	51.17	57.10	24.73	41.09	117.76	125.97	30.24	93.93	124.58	107.45	80.58	68.26	68.60	63.20	60.86	53.19	34.46	57.97	48.31	32.00	24.74	21.65	62.39	67.15
Minnesota Hub	20.00	20.24	18.67	18.88	20.06	20.34	21.96	29.67	28.74	39.92	36.35	36.29	37.72	24.52	26.41	28.17	37.72	34.22	28.49	26.06	31.76	25.34	23.44	18.93	27.25	30.93
Wisconsin PS	18.01	20.95	18.71	18.55	20.87	21.80	20.20	28.07	29.90	39.76	44.71	36.46	56.29	46.98	31.11	52.86	43.28	36.91	29.86	26.96	21.62	28.08	24.39	20.90	30.72	36.08
Forecasted Load (GW)	63.5	60.4	58.5	58.0	59.5	63.1	67.9	73.0	76.9	80.5	83.8	86.3	88.2	89.7	90.4	90.7	90.5	89.4	87.6	85.5	84.4	80.7	73.5	67.5		
Forecast Error %	-4.5%	-4.5%	-4.5%	-4.5%	-4.3%	-3.9%	-1.8%	-1.5%	-1.1%	-1.2%	-1.4%	-1.1%	-0.9%	-0.7%	-0.4%	-0.6%	-1.2%	-2.4%	-2.9%	-2.9%	-2.9%	-2.6%	-3.4%			

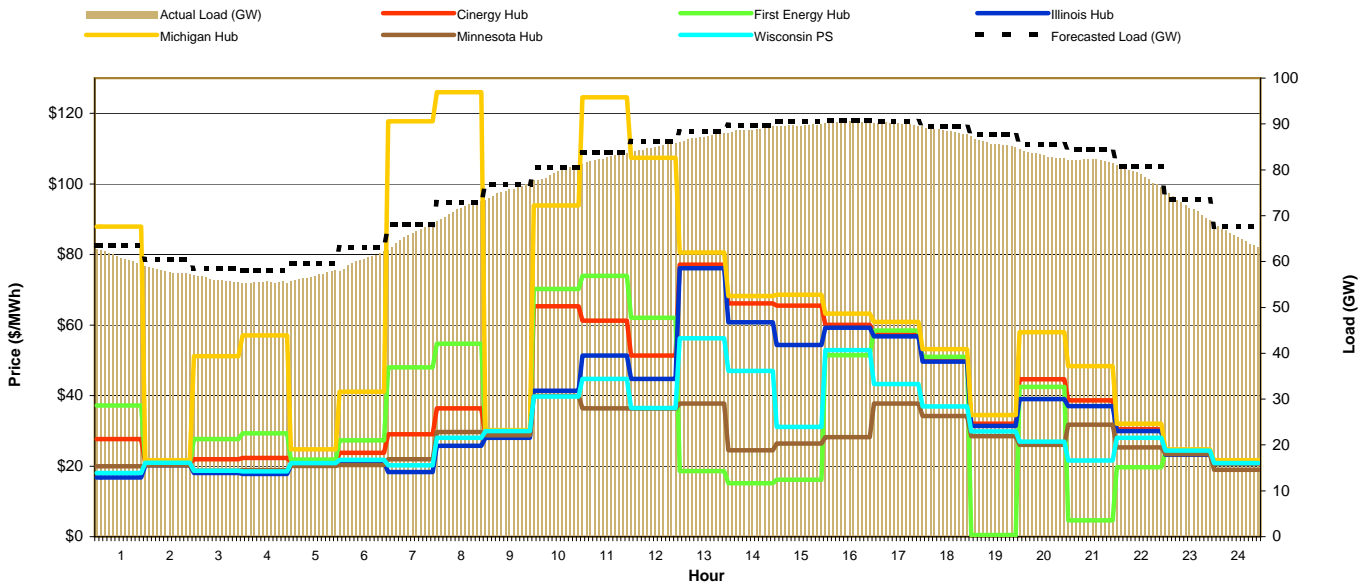




MISO Daily Report

Thursday May 27, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	21.31	20.00	19.37	19.24	19.77	21.66	24.62	28.05	33.06	38.51	41.00	45.99	53.45	60.12	60.30	60.57	57.62	53.14	42.12	38.94	38.73	29.95	23.80	20.76	36.34	44.08
First Energy Hub	23.28	22.74	22.49	22.50	22.70	24.51	26.79	28.35	30.69	35.25	40.60	46.17	54.98	63.91	62.03	57.71	52.73	43.76	36.22	34.24	34.63	28.25	24.64	22.57	35.91	42.14
Illinois Hub	18.82	17.39	16.77	16.68	17.64	16.57	20.85	24.95	29.63	37.12	44.99	49.30	52.30	57.74	59.00	59.38	55.52	49.79	43.19	38.46	36.78	27.12	22.06	18.91	34.62	42.96
Michigan Hub	37.30	36.60	36.69	36.65	36.82	40.90	42.70	41.97	42.77	50.94	52.65	56.50	64.06	70.59	71.70	69.96	65.55	57.84	52.24	49.44	50.09	40.40	30.98	31.31	48.61	54.23
Minnesota Hub	20.40	19.01	18.02	17.89	18.26	19.85	22.54	29.44	31.15	36.18	40.60	45.28	48.13	44.98	44.40	47.42	44.09	42.41	37.48	29.48	31.58	28.20	25.72	20.52	31.79	37.91
Wisconsin PS	19.22	17.85	17.11	16.97	17.55	18.80	22.41	26.68	32.23	33.53	37.45	42.23	46.28	43.68	42.13	40.61	41.90	41.98	41.03	33.23	34.72	27.59	23.00	19.36	30.73	36.76
Cleared Load (GW)	60.5	57.6	56.1	55.7	57.6	61.8	68.3	73.2	75.9	78.8	81.6	82.9	84.4	85.5	85.5	85.8	85.4	83.9	81.9	79.7	80.3	75.2	67.8	62.2		

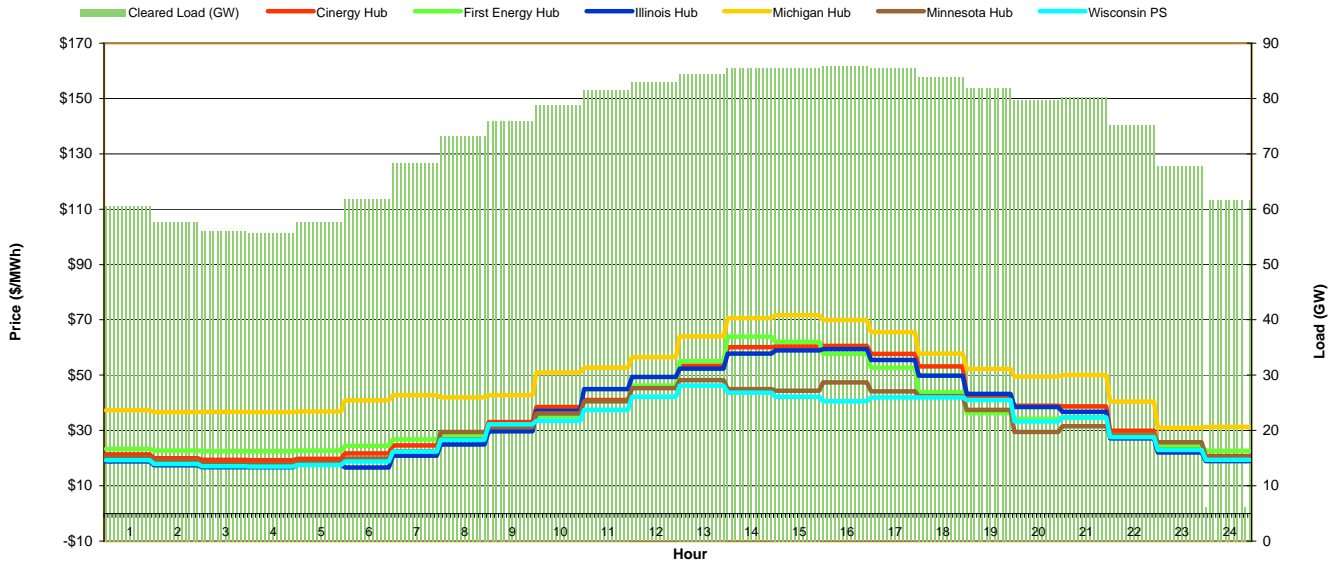

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	21.97	15.75	11.27	17.07	20.56	21.70	25.89	31.00	28.47	45.91	155.59	90.68	75.32	69.28	59.47	70.46	45.00	37.34	27.69	29.02	28.46	24.60	18.02	14.63	41.63	52.94
First Energy Hub	22.20	7.90	-1.21	13.01	23.03	22.27	32.62	50.41	28.77	21.63	139.15	87.46	45.67	49.04	27.09	61.67	55.30	42.44	26.21	28.94	29.61	29.19	25.33	18.43	36.92	46.74
Illinois Hub	37.99	14.99	8.90	16.69	18.70	20.50	21.13	20.41	27.26	44.98	122.13	86.58	58.47	40.94	42.91	48.01	45.80	40.24	26.95	26.19	26.94	27.93	23.73	17.38	36.07	44.34
Michigan Hub	23.00	18.77	26.73	17.91	30.85	23.66	55.61	115.62	30.04	50.41	160.96	92.15	77.13	63.02	54.44	71.03	57.57	44.31	30.61	30.28	33.15	30.31	27.21	18.89	49.32	60.52
Minnesota Hub	-7.86	12.26	5.73	15.33	15.63	17.32	14.85	19.49	18.81	22.31	32.81	40.90	32.81	33.96	38.37	35.99	28.99	32.29	25.77	26.61	25.79	26.51	23.20	16.82	23.11	29.04
Wisconsin PS	14.18	14.11	7.29	16.99	18.07	20.14	19.04	21.88	16.80	27.40	53.67	51.82	38.15	43.52	45.39	56.88	49.90	41.75	27.83	28.62	28.14	29.43	24.98	18.08	29.75	36.63
Forecasted Load (GW)	62.5	59.4	57.6	57.0	58.5	61.7	66.3	71.6	75.3	78.4	81.1	83.1	84.7	85.8	86.5	86.7	85.9	84.2	82.3	80.2	79.1	75.5	68.6	63.1		
Forecast Error %	-3.0%	-3.2%	-2.7%	-2.7%	-2.5%	-1.7%	-0.2%	0.0%	0.3%	0.8%	1.2%	1.6%	1.9%	2.0%	1.9%	1.6%	1.8%	1.9%	1.1%	0.7%	0.7%	1.1%	1.3%	0.4%		

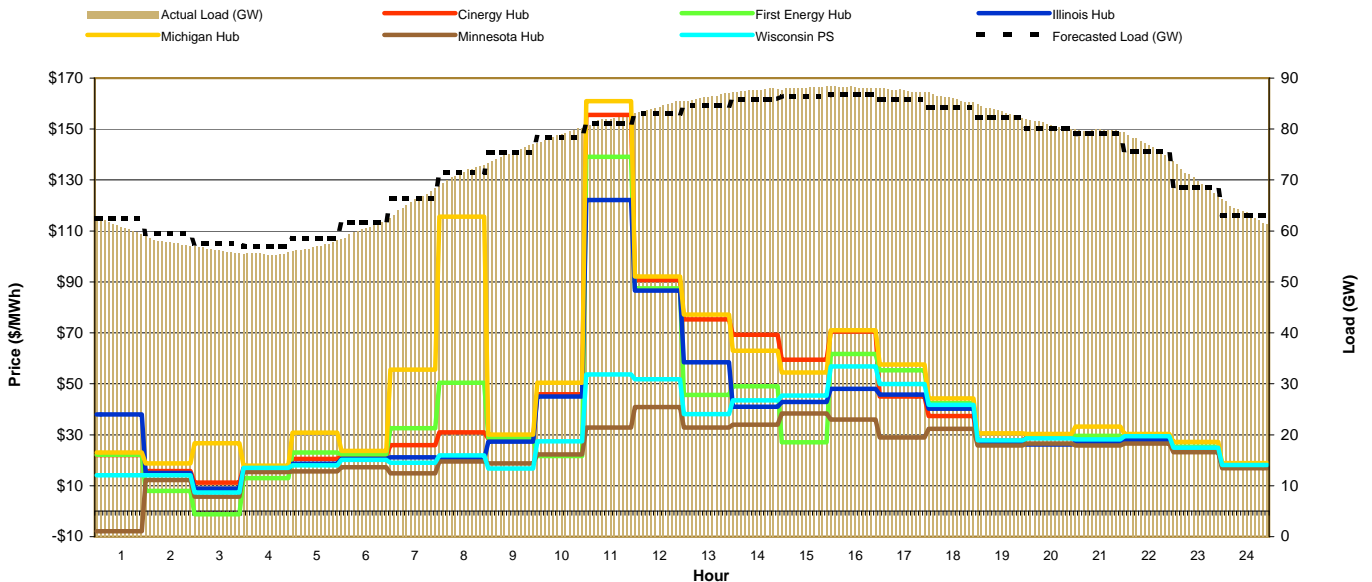




MISO Daily Report

Friday May 28, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$	
																									All	On Pk
Cinergy Hub	23.09	20.43	19.54	19.72	21.21	22.70	24.45	26.51	29.19	34.31	39.12	37.50	44.23	49.33	48.64	50.15	46.70	41.07	33.15	30.57	34.51	28.28	24.11	22.80	32.14	37.34
First Energy Hub	24.43	22.87	21.86	21.83	23.75	25.40	27.29	27.41	28.12	32.52	37.35	35.02	41.42	46.00	45.86	46.25	32.02	31.04	29.99	30.80	31.61	27.01	23.68	22.78	30.68	34.13
Illinois Hub	19.89	17.82	17.11	17.35	18.45	19.72	21.15	23.26	25.71	29.75	33.84	32.92	38.92	43.02	42.76	44.08	41.46	36.70	29.58	26.99	31.09	25.78	22.45	19.58	28.31	33.02
Michigan Hub	38.47	33.28	31.24	30.42	34.08	37.41	39.02	39.30	40.10	44.54	47.29	46.12	47.12	50.09	51.57	54.89	53.94	46.29	42.20	40.65	41.88	35.26	27.79	24.02	40.71	44.31
Minnesota Hub	18.87	17.71	16.26	15.41	16.00	18.72	19.43	21.74	22.36	24.75	29.42	33.40	33.17	33.86	41.63	41.12	44.64	40.72	31.87	29.95	30.64	29.34	24.97	21.19	27.38	32.10
Wisconsin PS	17.86	16.74	15.97	15.89	16.59	18.10	19.95	21.92	25.16	26.98	31.75	33.13	37.90	34.76	42.62	44.78	40.22	39.04	32.09	28.25	30.14	26.53	21.99	19.79	27.42	32.33
Cleared Load (GW)	56.9	54.6	53.2	53.1	54.8	58.5	64.0	68.4	71.6	74.4	76.5	78.1	79.7	79.8	79.9	80.0	79.7	77.8	75.3	73.3	74.0	69.7	62.7	5.7		

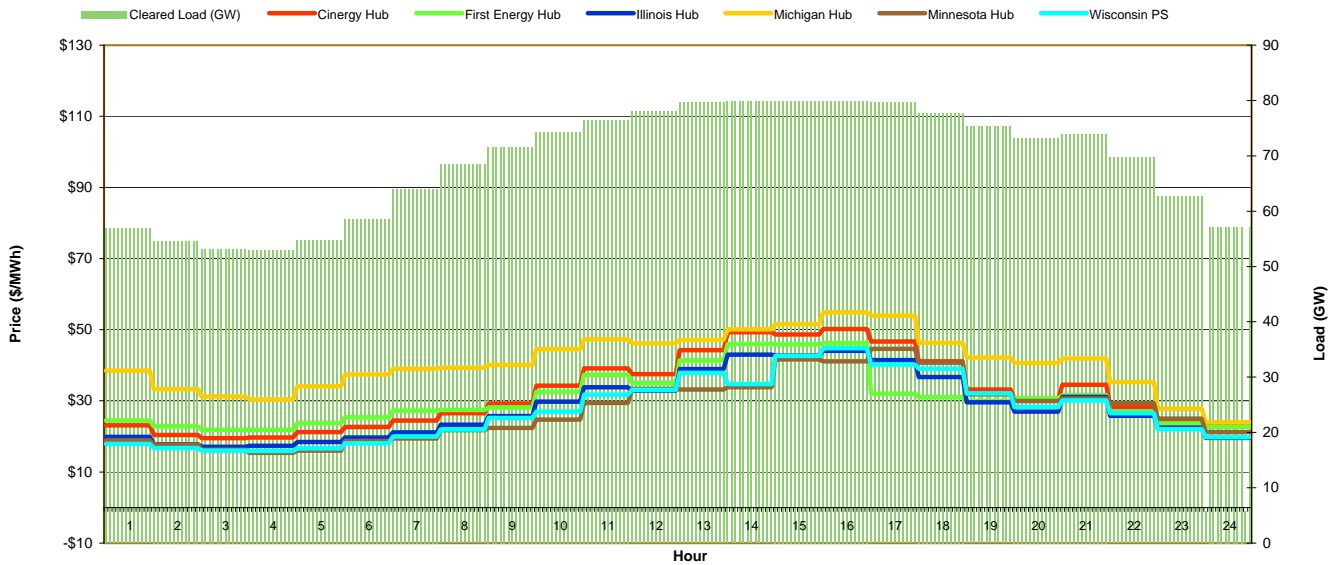

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$	
																									All	On Pk
Cinergy Hub	18.60	17.82	13.06	12.40	19.18	19.28	21.95	25.75	32.44	26.39	70.30	32.38	58.39	121.99	60.69	48.09	48.64	40.53	42.28	28.74	62.83	24.64	24.35	21.07	37.16	46.78
First Energy Hub	20.21	20.13	13.80	14.37	22.14	21.43	24.98	26.22	38.52	26.91	71.44	13.18	34.27	111.01	-3.65	11.03	51.09	19.49	42.39	29.04	63.43	24.90	24.41	23.97	31.03	36.48
Illinois Hub	17.52	16.13	12.21	10.25	17.06	17.10	19.63	24.74	28.41	25.46	68.12	31.50	56.74	118.53	60.38	59.17	49.26	39.64	40.88	27.88	60.82	23.95	23.61	25.22	36.43	46.19
Michigan Hub	24.83	27.31	15.68	20.50	31.08	27.54	34.48	26.94	58.45	28.33	74.22	35.33	63.05	129.32	69.41	64.94	52.70	42.81	44.02	30.38	66.49	26.03	25.62	34.00	43.89	52.38
Minnesota Hub	20.37	17.74	12.54	10.34	18.44	21.90	21.03	25.03	26.99	23.90	63.39	28.82	45.18	103.01	57.06	56.00	47.06	38.21	38.92	30.16	63.33	22.84	23.00	5.89	34.21	43.31
Wisconsin PS	18.26	16.88	12.60	10.43	17.71	18.20	20.83	26.19	29.92	26.77	71.75	33.19	59.50	123.86	63.87	61.29	51.14	41.18	42.22	28.95	63.32	25.03	24.54	9.97	37.40	48.29
Forecasted Load (GW)	61.3	58.6	57.0	56.5	57.8	60.9	65.5	69.8	73.0	75.6	78.0	79.7	81.1	82.3	82.8	83.0	82.4	80.6	78.4	76.5	75.3	72.1	66.1	60.6		
Forecast Error %	-4.5%	-4.7%	-5.2%	-5.5%	-5.3%	-5.4%	-4.7%	-3.3%	-2.3%	-1.8%	-1.5%	-1.0%	-0.5%	0.2%	0.5%	0.8%	1.5%	2.1%	1.5%	-0.1%	-0.3%	0.4%	0.6%	0.4%		

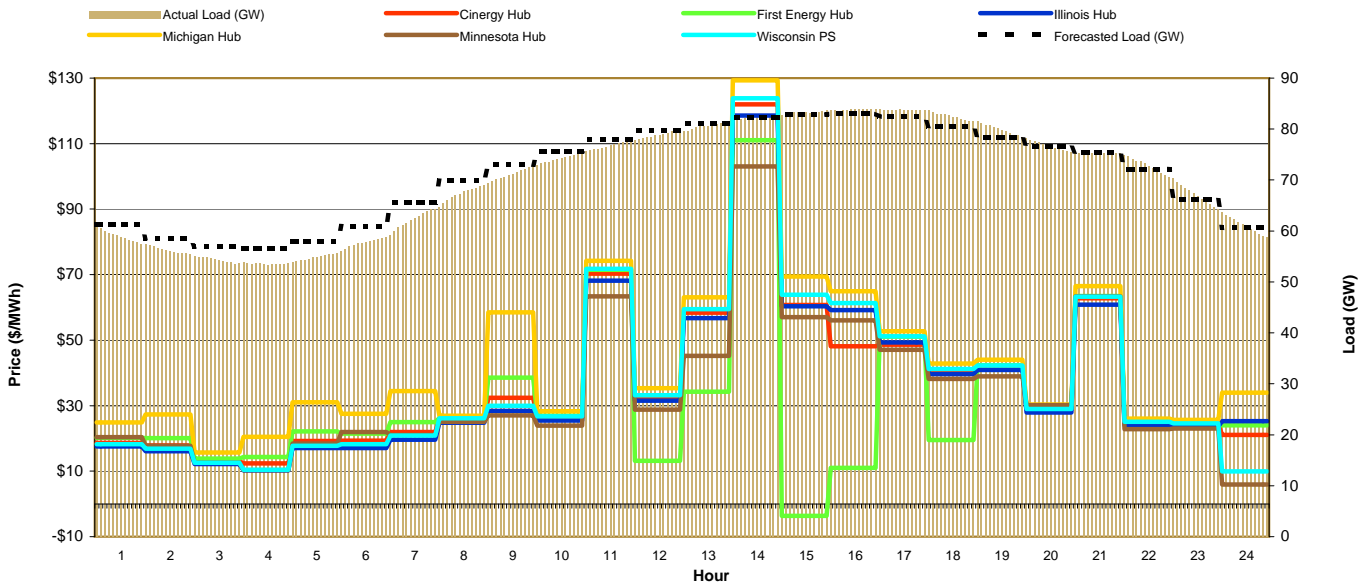




MISO Daily Report

Saturday May 29, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	22.81	22.15	20.72	20.43	20.44	19.01	22.61	24.20	25.69	28.95	33.37	35.38	38.82	43.10	45.94	48.69	50.63	46.37	41.74	37.01	43.28	31.81	24.77	23.49	32.14	37.48
First Energy Hub	22.73	22.77	21.39	21.04	21.10	19.69	23.26	25.09	25.65	26.99	29.73	30.85	32.58	35.67	37.67	39.40	47.63	45.21	37.83	37.15	43.07	29.90	24.90	24.01	30.22	34.33
Illinois Hub	21.14	19.46	18.92	18.49	18.57	17.49	20.94	23.16	24.93	27.99	32.10	34.06	37.80	42.27	45.03	48.04	50.09	46.21	41.07	36.45	42.31	30.43	23.49	21.86	30.93	36.59
Michigan Hub	24.16	27.41	26.07	25.59	25.48	23.51	30.37	29.89	28.73	34.71	41.41	42.03	43.14	44.47	47.31	50.05	52.02	47.53	42.89	40.56	44.30	40.91	26.03	26.75	36.06	41.00
Minnesota Hub	18.61	17.19	15.43	13.72	14.39	14.88	17.01	19.30	21.57	25.68	29.17	28.86	31.47	34.30	37.42	42.45	45.99	45.76	36.35	34.90	36.97	27.93	23.53	19.82	27.20	32.60
Wisconsin PS	18.74	17.59	16.25	14.96	15.35	15.24	18.26	20.69	22.52	25.92	29.48	30.33	33.37	36.96	39.62	43.73	46.28	44.34	37.10	34.59	37.89	28.02	22.23	19.62	27.88	33.31
Cleared Load (GW)	52.2	50.1	48.9	48.3	48.6	47.9	50.9	56.0	59.9	63.5	66.1	67.7	68.7	69.9	70.9	71.8	72.4	72.2	70.6	69.2	70.2	67.5	61.3	5.7		

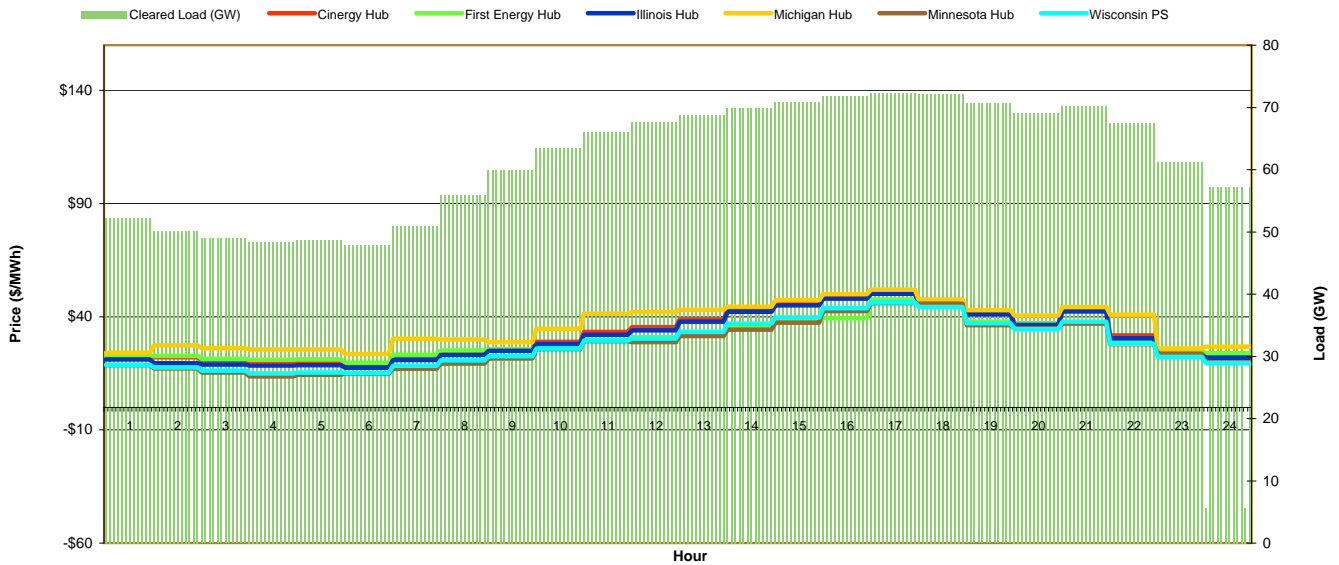

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	-5.37	23.27	22.44	18.67	18.65	9.10	21.47	22.09	30.15	26.59	28.43	113.35	37.18	35.45	49.80	117.23	55.02	38.35	54.06	50.05	75.80	38.78	21.98	19.12	38.32	49.52
First Energy Hub	14.67	29.23	50.72	19.10	19.98	9.27	22.31	22.55	30.67	27.27	29.11	113.11	38.34	35.95	50.53	119.11	55.94	38.99	54.84	50.56	76.76	39.26	22.27	22.21	41.36	50.33
Illinois Hub	-1.68	34.08	6.84	17.98	11.69	8.28	19.58	21.22	29.21	25.54	27.33	107.61	36.46	34.37	48.44	114.52	53.88	37.60	52.82	48.72	73.90	37.93	21.41	18.85	36.94	48.19
Michigan Hub	87.66	49.59	150.81	19.61	23.25	9.61	24.09	23.00	31.33	27.94	29.82	116.00	39.22	36.65	51.24	120.31	56.33	39.42	55.82	51.73	78.89	40.33	22.94	33.28	50.79	51.31
Minnesota Hub	-59.86	8.93	10.43	17.23	10.86	0.66	16.67	20.34	14.94	23.44	25.64	77.33	33.79	32.06	45.48	108.23	51.67	36.24	50.17	46.09	69.18	35.59	25.44	14.89	29.81	43.48
Wisconsin PS	-38.61	19.96	6.81	18.19	10.28	3.93	18.53	21.63	2.59	24.71	27.84	62.72	36.52	34.92	49.18	116.10	54.67	38.36	53.58	49.13	74.70	38.53	22.38	17.15	31.82	44.22
Forecasted Load (GW)	57.7	55.0	53.3	52.3	52.0	51.3	52.8	57.0	61.6	65.4	68.4	70.6	72.0	73.1	74.0	75.0	75.5	75.1	73.9	72.6	72.1	69.7	63.8	58.7		
Forecast Error %	-2.7%	-3.6%	-3.7%	-4.2%	-4.1%	-3.1%	-2.5%	-2.3%	-1.7%	-0.5%	0.0%	1.0%	1.7%	2.5%	3.1%	3.5%	3.9%	4.2%	4.0%	2.2%	1.0%	1.2%	2.0%	2.0%		

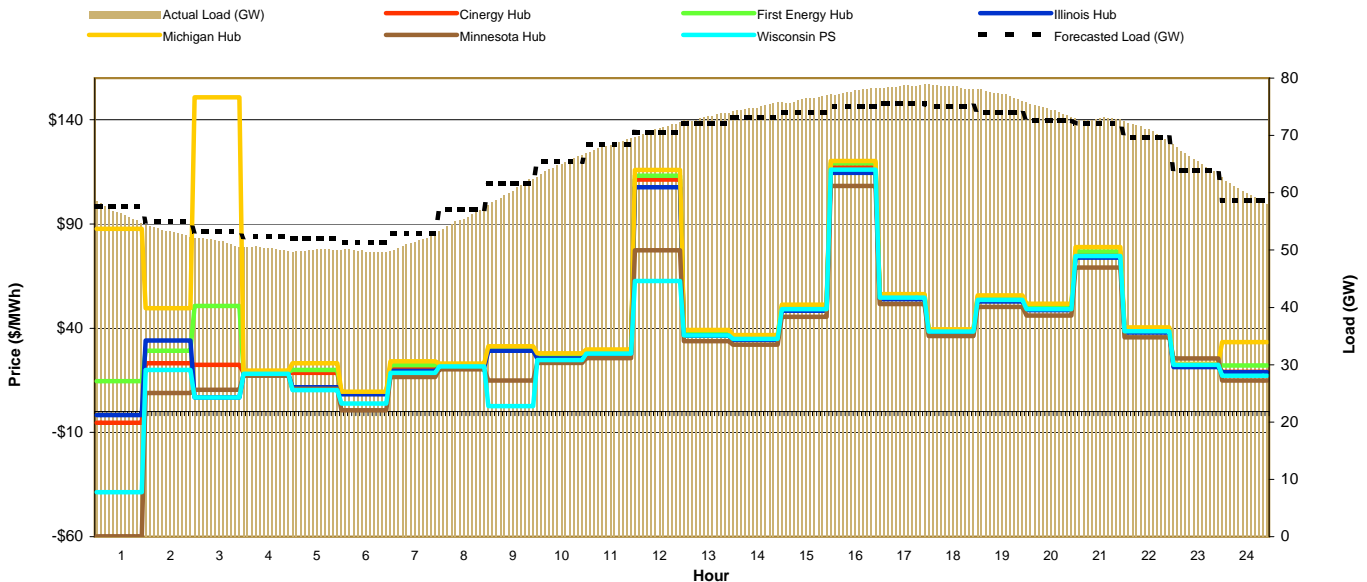




MISO Daily Report

Sunday May 30, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	20.62	19.65	18.11	16.70	17.42	14.85	20.69	22.92	24.22	28.19	37.13	38.59	44.18	44.43	48.14	51.98	54.88	50.60	43.93	39.81	43.76	32.96	25.57	23.61	32.62	39.46
First Energy Hub	22.30	20.84	19.36	17.62	18.11	15.47	20.84	22.56	24.02	27.95	36.48	39.03	43.83	44.35	48.02	50.35	49.99	45.49	35.91	33.35	40.54	28.71	24.92	24.63	31.44	37.22
Illinois Hub	18.73	17.73	16.40	15.69	16.19	14.75	18.61	20.10	23.61	27.32	34.31	37.07	42.97	43.63	46.61	50.35	57.15	49.96	43.62	39.62	45.62	32.76	23.55	20.98	31.56	38.64
Michigan Hub	29.64	26.38	25.22	21.98	21.62	18.32	22.56	23.23	24.69	28.76	38.49	42.97	45.08	45.58	49.09	53.21	55.98	51.41	44.61	40.48	44.55	37.03	33.82	38.08	35.95	41.19
Minnesota Hub	13.66	11.11	9.51	7.49	9.00	5.48	8.68	17.66	19.40	20.50	26.91	28.99	32.39	35.85	26.97	30.12	36.84	38.20	36.28	36.07	36.46	34.36	21.18	18.98	23.42	29.89
Wisconsin PS	14.13	12.74	11.54	10.47	11.80	9.10	12.77	19.16	21.24	23.87	29.55	32.24	37.24	39.35	35.98	39.26	45.96	45.00	40.83	38.25	40.88	33.32	22.16	19.64	26.93	34.02
Cleared Load (GW)	51.6	49.5	48.1	47.3	46.9	46.4	48.3	52.8	57.3	62.1	66.7	67.7	69.2	71.5	72.2	73.2	74.1	73.3	71.2	70.2	71.5	67.5	62.3	5.8		

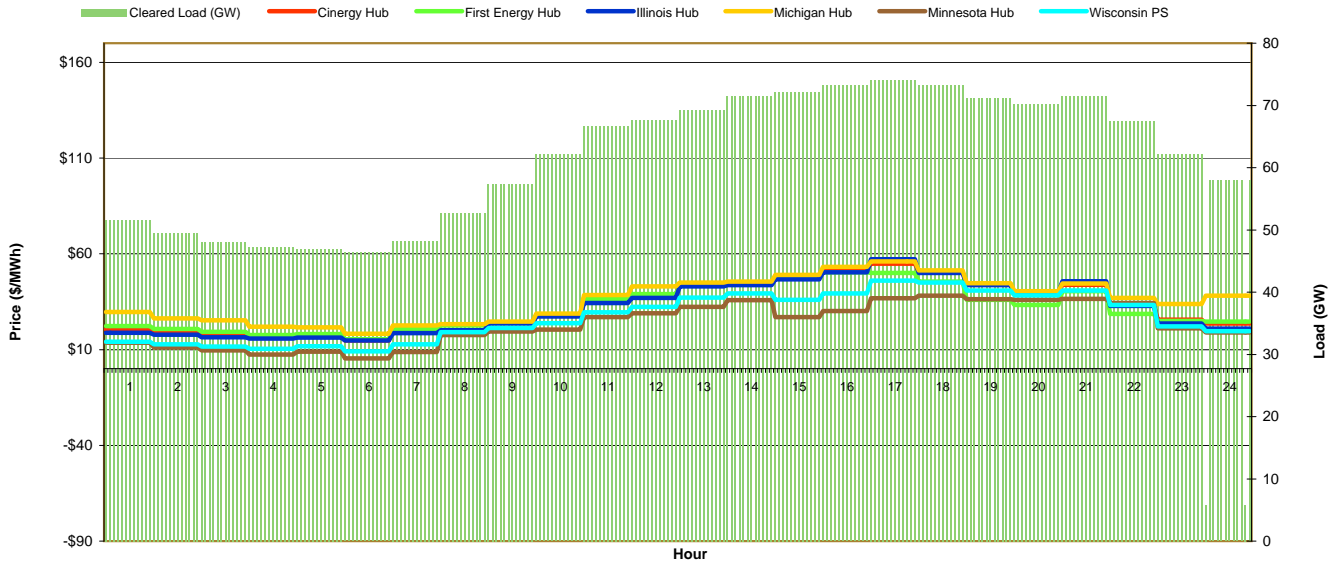

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	21.52	15.39	9.79	17.18	17.15	13.21	18.84	23.65	29.55	25.50	25.59	34.36	34.75	40.41	130.28	51.57	60.57	60.63	44.68	28.92	66.47	39.93	22.61	20.88	35.56	44.97
First Energy Hub	35.78	15.59	10.14	17.97	17.35	13.32	19.26	24.35	29.98	25.85	25.90	34.66	34.99	40.66	129.98	51.08	60.98	61.04	44.95	29.10	67.18	40.34	22.83	21.02	36.43	45.24
Illinois Hub	17.68	14.94	9.38	16.31	16.61	12.84	20.06	23.13	28.42	24.61	24.83	33.43	33.99	39.72	129.98	52.19	59.89	60.04	44.01	28.42	65.22	39.24	22.20	20.39	34.90	44.33
Michigan Hub	89.12	15.93	11.10	20.31	17.55	13.44	20.37	26.16	30.59	26.38	26.35	35.31	35.55	41.41	133.59	52.91	62.48	62.61	46.37	30.07	69.23	41.74	23.65	21.76	39.75	46.53
Minnesota Hub	12.60	18.15	9.22	15.98	16.09	12.41	16.00	21.22	26.87	23.12	23.02	30.75	31.54	30.68	-59.26	-81.35	17.08	21.45	19.01	13.80	33.92	37.05	20.96	18.99	13.72	13.12
Wisconsin PS	13.11	15.50	9.52	16.57	16.85	12.98	18.40	23.07	28.97	25.17	25.49	34.39	34.92	44.19	160.70	126.92	71.51	65.86	59.77	37.71	83.80	40.48	22.86	20.79	42.06	55.36
Forecasted Load (GW)	56.7	54.3	52.4	51.2	50.7	49.9	50.1	53.8	58.9	63.6	67.8	71.0	73.5	75.2	76.5	77.4	78.0	77.5	76.0	73.9	73.3	71.0	65.8	60.6		
Forecast Error %	-2.2%	-3.5%	-3.5%	-3.5%	-3.7%	-3.6%	-1.0%	-0.2%	0.1%	0.1%	-0.1%	-0.2%	-0.2%	-0.1%	0.0%	-0.2%	-0.4%	-0.8%	-1.6%	-2.0%	-1.6%	-1.3%	-0.9%			

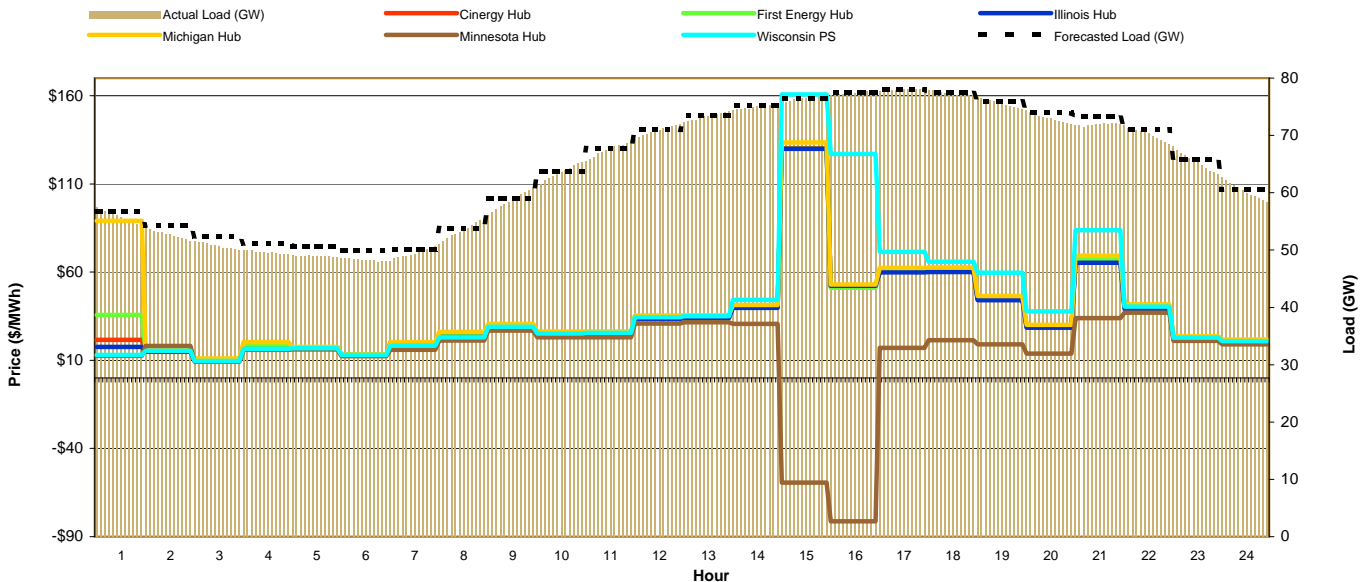




MISO Daily Report

Monday May 31, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%

Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	22.72	19.94	18.24	18.63	19.00	14.31	17.54	24.06	24.72	28.14	40.19	42.61	43.19	44.32	46.21	46.66	47.84	44.16	36.66	33.23	45.41	29.95	23.73	22.21	31.40	37.57
First Energy Hub	23.93	21.93	20.29	20.27	20.42	15.42	18.65	25.10	24.75	29.40	34.70	37.17	40.71	44.27	45.42	45.05	46.18	44.02	37.57	32.31	38.48	27.01	24.69	23.15	30.87	36.05
Illinois Hub	19.07	17.43	16.36	16.48	16.65	14.17	16.83	21.92	24.28	26.44	33.14	38.84	41.62	40.85	40.62	43.54	47.45	42.48	36.11	32.43	41.33	29.29	21.55	18.26	29.05	35.12
Michigan Hub	37.78	33.03	29.23	27.73	27.05	20.27	24.00	31.02	25.93	35.49	46.38	44.53	44.79	46.05	48.22	48.77	49.38	45.39	42.44	41.39	47.01	34.02	29.25	30.30	37.06	41.25
Minnesota Hub	17.90	17.26	15.53	14.78	13.88	13.39	14.35	17.55	18.47	20.20	23.76	27.05	27.87	28.79	29.28	29.65	34.76	36.08	31.66	28.91	35.23	24.79	20.26	19.25	23.36	27.14
Wisconsin PS	18.08	17.18	16.02	15.74	15.32	13.90	16.13	20.72	22.18	23.96	27.76	32.02	34.57	34.56	34.15	35.96	41.29	39.99	34.81	31.25	38.12	27.54	20.64	19.48	26.30	31.22
Cleared Load (GW)	53.3	50.4	48.6	47.8	48.0	46.0	48.5	54.6	58.3	62.6	67.1	69.2	69.6	70.4	71.0	72.0	72.6	72.2	70.9	70.0	71.8	67.2	61.0	5.7		

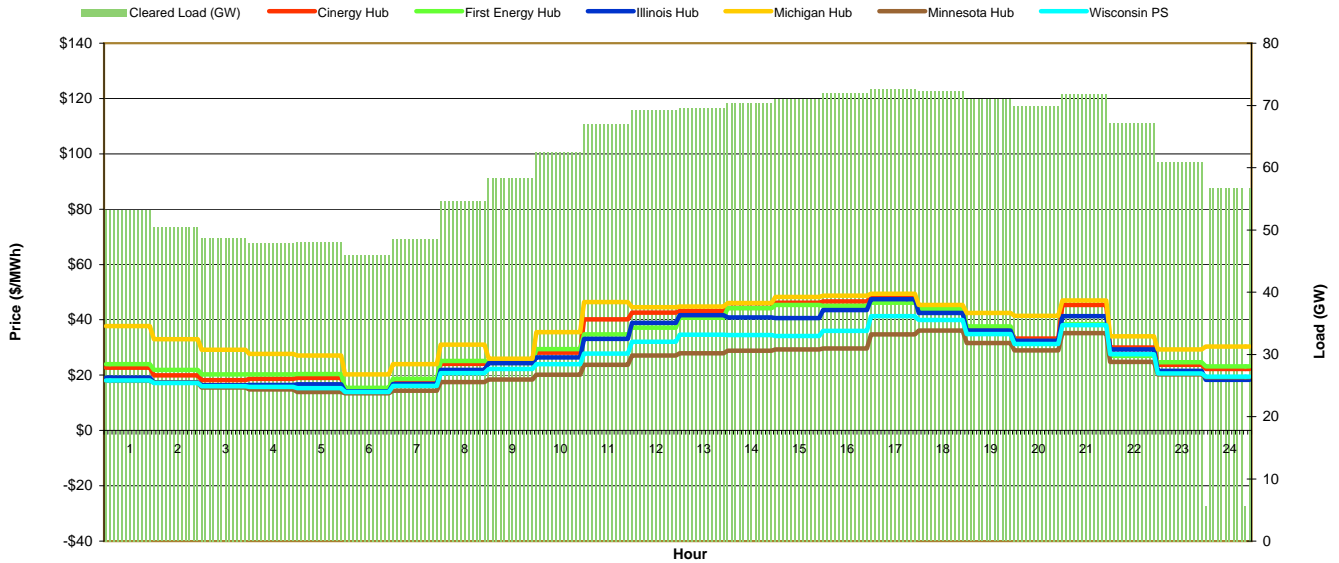

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	20.80	20.68	20.19	18.12	18.27	-30.64	20.90	26.32	30.38	53.14	130.83	40.32	27.18	26.34	29.59	35.35	28.28	27.64	27.23	25.92	24.62	24.95	20.57	18.29	28.55	36.17
First Energy Hub	20.97	20.90	20.45	18.39	18.52	-31.16	21.24	31.46	31.20	54.41	134.37	38.19	27.93	26.97	30.36	34.43	28.98	28.29	27.84	26.59	25.29	25.54	20.96	18.61	29.20	37.05
Illinois Hub	20.25	20.02	19.46	17.45	18.32	-24.46	22.71	24.00	37.26	49.98	125.46	35.58	25.95	25.27	28.35	32.11	27.16	26.70	26.34	25.01	23.85	24.30	20.06	17.76	27.87	34.84
Michigan Hub	21.58	21.53	21.03	18.82	18.89	-31.57	21.64	48.40	32.71	56.08	137.50	38.83	28.39	27.22	30.61	34.75	29.25	28.63	28.23	26.87	25.49	25.95	21.34	18.93	30.46	38.77
Minnesota Hub	19.21	19.00	18.48	16.56	16.23	-32.12	14.94	19.75	19.91	32.00	102.48	26.20	24.50	23.86	26.88	30.42	26.36	26.37	26.32	24.88	23.59	24.04	19.89	17.64	23.64	29.84
Wisconsin PS	20.56	20.18	19.58	17.54	17.77	-29.80	19.18	22.36	28.84	42.19	118.85	22.02	26.11	25.41	28.43	32.12	27.41	27.20	26.95	25.66	24.62	25.20	20.74	18.28	26.14	32.75
Forecasted Load (GW)	56.6	53.6	51.6	50.5	50.2	49.9	51.1	55.2	60.4	65.0	68.9	71.6	73.3	74.4	75.1	75.8	76.3	75.8	75.0	73.1	73.3	71.6	66.3	61.7		
Forecast Error %	-1.4%	-1.1%	-0.6%	-0.2%	0.2%	0.6%	0.6%	-0.2%	-0.9%	-0.5%	-0.3%	-0.8%	-2.3%	-4.2%	-5.1%	-6.1%	-6.3%	-6.8%	-5.7%	-6.7%	-7.1%	-7.0%	-8.3%			

