




MISO Daily Report

Friday October 1, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	Day-Ahead Prices and Cleared Load																								Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	16.78	14.61	14.68	17.40	21.27	29.20	38.92	32.98	34.45	34.31	34.54	35.36	33.72	33.48	33.48	31.16	28.88	27.97	38.49	36.25	26.32	24.25	20.11	20.45	28.29	31.61
First Energy Hub	16.57	14.38	14.44	17.62	21.55	29.53	38.60	33.44	35.14	34.96	35.04	35.49	33.91	33.89	33.68	31.61	29.43	28.34	39.20	37.12	26.74	24.62	20.18	20.36	28.58	32.05
Illinois Hub	10.23	8.38	8.30	11.14	14.73	25.69	26.76	27.53	32.60	33.35	32.66	31.18	30.21	31.24	30.22	29.64	28.08	26.44	36.93	33.14	24.56	22.51	17.18	16.01	24.53	29.22
Michigan Hub	17.19	14.99	15.08	18.42	22.40	30.56	39.29	33.92	35.63	35.34	35.44	35.87	34.28	34.26	34.03	31.95	29.77	28.65	39.42	37.42	27.09	25.02	20.81	21.09	29.08	32.43
Minnesota Hub	8.81	4.60	3.61	3.25	10.61	18.78	27.06	29.31	31.62	34.58	34.38	34.39	33.35	34.66	31.79	32.31	31.86	32.35	38.55	35.03	29.84	23.60	18.76	14.52	24.90	31.65
Wisconsin PS	8.63	5.06	4.46	4.19	10.50	22.81	27.97	28.53	32.34	34.29	34.69	34.96	33.62	33.75	31.74	30.70	29.52	28.64	37.24	33.10	26.17	22.59	18.48	14.99	24.54	30.65
Cleared Load (GW)	44.2	43.6	43.4	43.9	48.2	58.4	64.5	65.1	65.8	66.7	67.3	67.4	67.6	67.3	66.6	66.0	65.3	64.3	68.2	67.7	63.6	58.9	51.3	4.8		

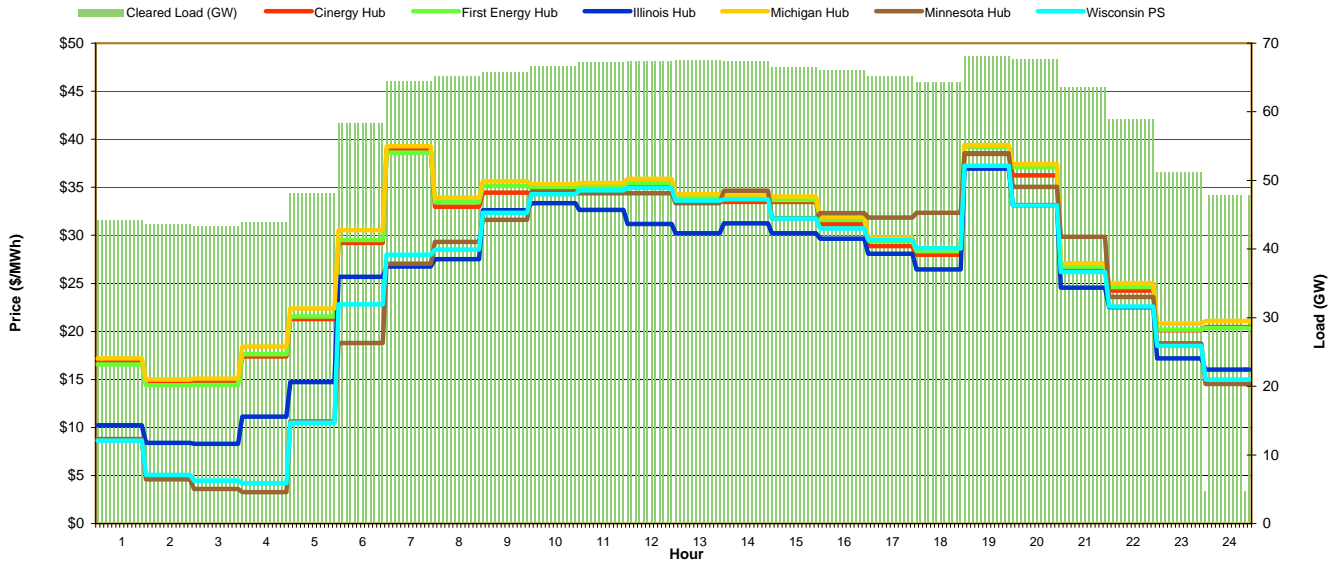

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	Preliminary Real-Time Prices with Forecasted and Actual System Load																								Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	21.45	20.71	20.15	21.29	21.30	24.05	24.14	36.53	31.18	25.45	26.10	27.25	26.78	41.07	29.75	24.66	24.25	0.80	13.89	23.02	23.93	23.50	21.25	20.22	23.86	24.96
First Energy Hub	21.70	21.21	20.62	21.86	21.79	24.60	24.68	37.47	32.00	26.17	26.78	27.93	27.39	41.95	30.39	25.17	24.75	0.80	14.18	23.49	24.48	24.16	21.85	20.86	24.43	25.56
Illinois Hub	17.44	19.06	18.24	17.53	18.75	21.79	23.18	35.43	30.00	24.46	25.19	26.31	25.87	39.77	28.80	23.84	22.72	0.77	13.47	22.12	22.56	19.03	17.81	12.28	21.93	23.63
Michigan Hub	22.46	21.44	20.84	22.17	22.14	25.17	25.28	38.28	32.66	26.59	27.21	28.49	27.90	42.77	31.14	25.82	25.30	0.79	14.62	24.24	25.23	25.13	22.47	21.59	24.99	26.17
Minnesota Hub	16.41	18.10	17.47	16.59	17.49	20.54	22.60	35.24	29.89	24.71	25.73	26.77	25.79	39.07	27.77	22.42	19.71	0.80	13.13	19.95	19.04	18.69	25.05	11.45	21.43	23.36
Wisconsin PS	16.92	19.12	18.30	17.12	18.64	21.97	24.09	37.35	31.66	25.82	26.74	27.94	27.22	41.65	29.83	24.45	21.16	0.89	14.10	22.48	22.11	18.96	18.51	10.78	22.41	24.43
Forecasted Load (GW)	52.9	51.3	50.4	50.5	52.5	56.4	61.8	63.5	64.7	65.7	66.2	66.3	66.4	66.1	65.4	64.7	64.1	63.3	63.9	64.5	63.0	59.9	56.9	53.2		
Forecast Error %	-1.7%	-1.8%	-1.9%	-2.1%	-2.2%	-0.2%	-0.4%	-0.4%	-0.1%	0.3%	0.7%	0.9%	1.0%	1.1%	1.1%	1.2%	0.9%	0.5%	0.3%	0.3%	0.0%	0.2%	-1.5%	-1.3%		

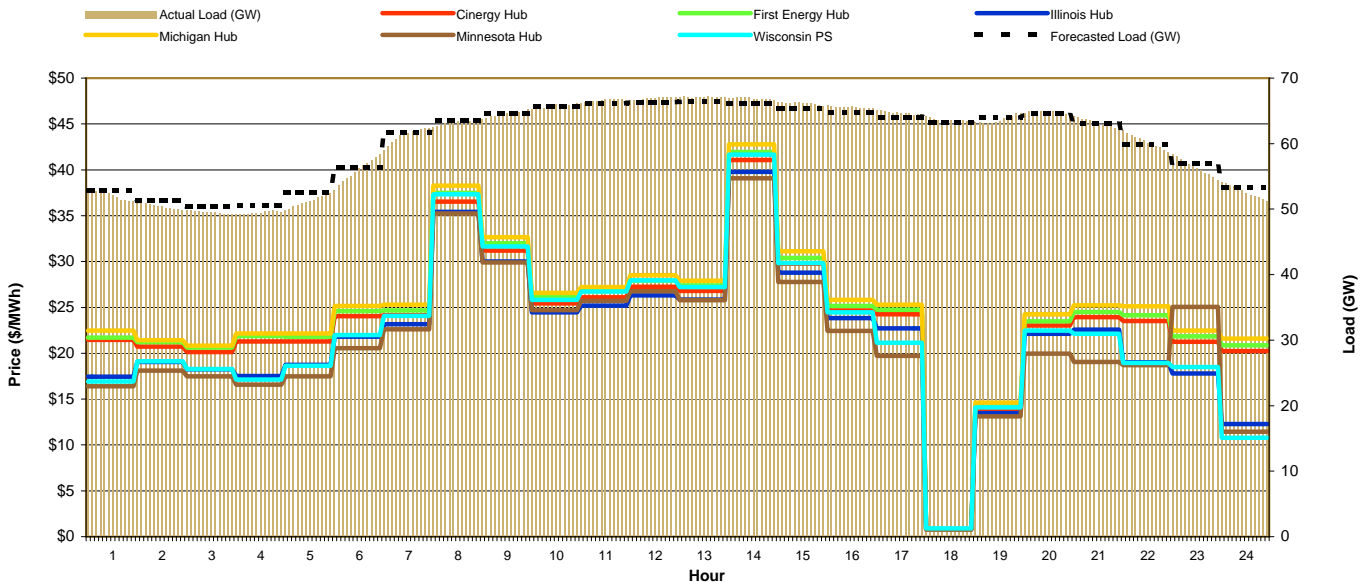




MISO Daily Report

Saturday October 2, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	20.16	19.81	19.46	19.89	20.49	22.12	22.72	25.66	27.81	40.47	37.67	35.20	32.75	30.82	30.07	30.07	30.27	25.16	35.32	30.38	26.01	24.85	20.91	19.12	26.97	30.21
First Energy Hub	21.57	21.28	20.96	21.08	21.44	22.94	23.28	26.28	27.78	33.41	31.70	30.12	28.24	27.03	26.88	26.88	27.20	25.75	36.19	31.14	26.66	25.47	21.57	19.47	26.01	28.27
Illinois Hub	18.43	17.44	16.45	16.60	17.14	19.47	21.54	24.29	25.54	25.02	24.75	23.84	22.03	21.43	21.44	21.11	21.88	24.07	34.05	29.58	25.33	23.85	19.47	15.67	22.10	24.23
Michigan Hub	18.77	18.25	17.62	18.51	19.51	21.65	24.06	27.16	28.76	34.24	32.56	30.99	29.08	27.75	27.53	27.42	27.82	26.38	37.00	32.03	27.32	26.08	20.57	18.43	25.81	28.92
Minnesota Hub	12.88	8.95	6.83	6.78	8.75	14.62	19.10	20.33	20.63	23.57	22.77	22.57	20.64	20.18	20.19	20.48	20.74	21.90	28.86	26.91	23.35	19.80	17.23	15.22	18.47	21.88
Wisconsin PS	14.23	11.04	8.87	8.97	11.88	16.50	19.47	20.85	23.15	29.49	28.45	26.80	25.25	24.43	24.42	25.30	25.56	25.79	34.70	30.85	26.76	24.03	19.70	17.20	21.82	25.97
Cleared Load (GW)	46.0	44.8	44.2	44.9	46.3	49.1	52.8	56.0	58.7	59.9	58.8	58.6	57.5	56.5	56.0	55.9	56.0	57.0	63.3	61.8	58.3	55.1	49.7	4.6		

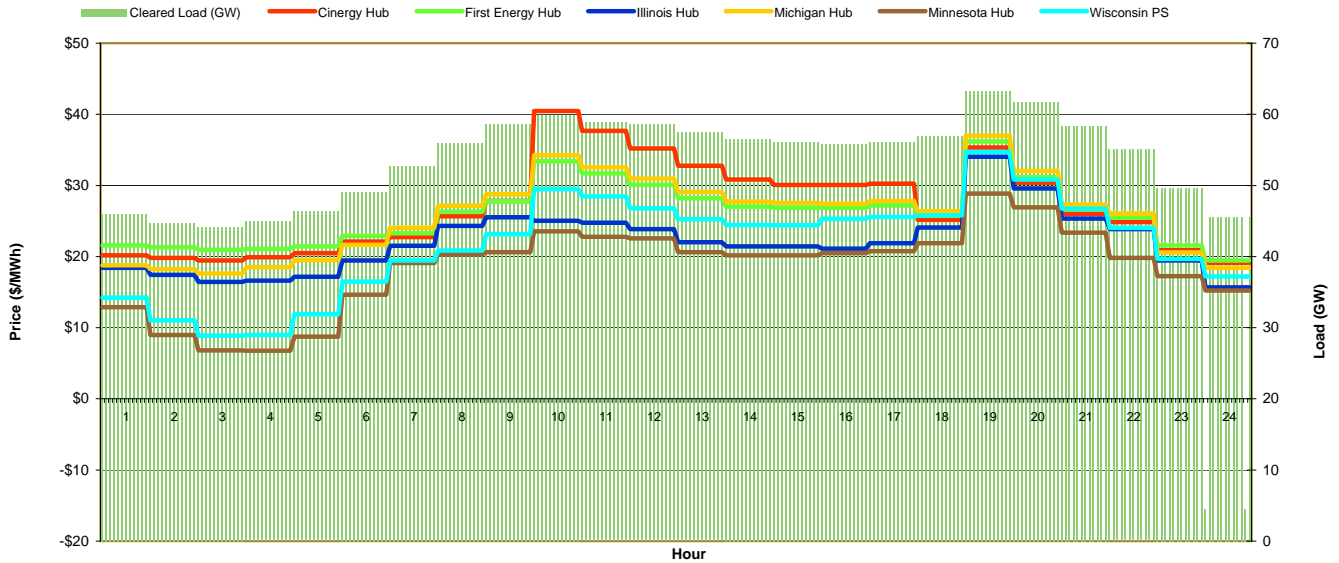

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	18.30	20.44	17.91	17.90	19.76	24.58	22.44	27.66	25.67	21.71	25.11	22.90	23.16	22.83	21.53	21.52	22.25	21.12	25.22	24.41	33.24	24.61	20.14	14.04	22.44	23.94
First Energy Hub	18.65	35.49	18.19	18.17	20.14	25.21	22.31	26.03	26.55	22.47	25.99	23.70	23.96	23.61	22.21	22.20	22.95	21.81	25.99	25.16	34.30	25.38	20.68	14.37	23.56	24.56
Illinois Hub	17.23	9.46	15.02	15.59	15.99	16.75	19.07	20.22	20.53	20.20	21.48	20.30	20.38	20.33	20.22	19.43	20.31	18.89	23.59	23.25	30.23	23.22	19.01	13.13	19.33	21.35
Michigan Hub	18.91	-14.72	18.65	18.56	20.69	26.10	22.88	28.16	27.41	25.11	27.42	24.25	25.67	24.79	23.20	23.71	24.36	22.92	26.50	25.64	35.03	25.73	20.65	14.41	22.34	25.67
Minnesota Hub	17.67	8.07	14.54	14.89	14.82	15.91	18.52	19.40	20.83	20.52	21.29	19.77	19.28	20.26	20.18	19.34	20.14	18.90	24.16	23.97	30.98	23.91	19.64	13.48	19.19	21.41
Wisconsin PS	17.67	7.46	14.74	15.37	15.13	15.32	19.04	18.40	20.47	10.67	16.20	20.41	11.14	15.70	16.28	12.55	14.40	16.29	24.53	24.28	30.93	23.50	19.31	13.40	17.21	18.44
Forecasted Load (GW)	51.0	49.4	48.4	48.1	48.7	50.7	52.2	54.3	56.9	58.5	58.7	58.2	57.5	56.9	56.2	55.9	56.2	57.0	59.4	60.5	59.1	56.7	53.3	51.1		
Forecast Error %	-2.6%	-2.6%	-2.6%	-2.5%	-2.8%	-3.0%	-0.6%	-0.6%	-0.3%	-0.7%	-0.2%	0.3%	0.3%	0.2%	0.1%	0.2%	0.3%	-0.8%	-2.3%	-1.3%	-0.8%	-0.7%	-0.6%	-2.3%		

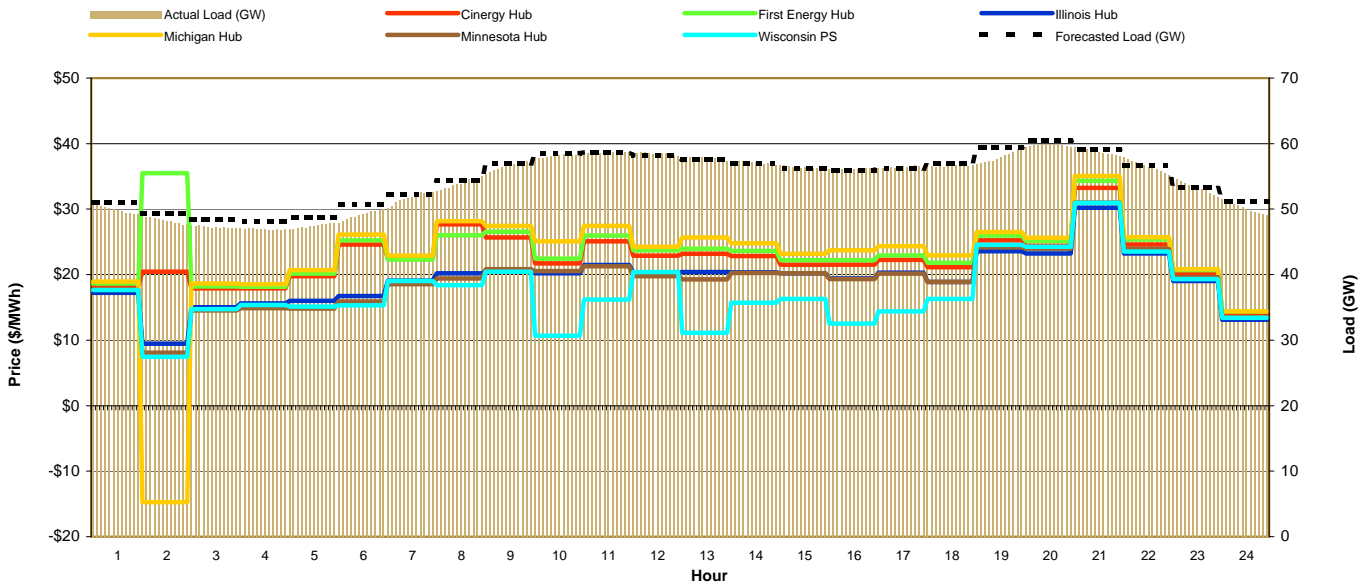




MISO Daily Report

Sunday October 3, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	19.84	19.07	18.33	18.11	18.78	20.80	22.63	23.12	24.48	25.66	25.80	24.67	24.42	24.37	24.26	24.56	24.88	25.52	40.54	35.74	27.93	25.13	21.79	21.46	24.25	26.43
First Energy Hub	24.10	22.92	21.78	21.21	22.01	24.09	24.50	23.69	25.08	25.75	25.81	24.63	24.39	24.35	24.24	24.52	24.90	26.15	41.50	36.63	28.64	25.75	22.02	22.18	25.45	26.75
Illinois Hub	15.50	11.75	11.31	11.22	12.00	16.54	21.43	22.00	23.27	23.68	23.64	22.64	22.38	22.30	22.16	22.43	22.80	24.35	38.56	34.51	26.21	23.85	20.48	19.60	21.44	24.70
Michigan Hub	15.79	14.17	13.88	14.03	14.67	17.55	22.43	24.31	25.75	26.40	26.48	25.24	25.01	24.97	24.87	25.16	25.54	26.82	42.11	37.64	29.39	26.44	22.61	21.50	23.87	27.42
Minnesota Hub	15.59	13.49	13.03	12.98	13.01	13.53	16.19	18.31	19.70	21.70	21.33	22.37	21.89	21.15	20.46	20.83	21.43	23.19	34.74	32.97	24.43	20.85	16.97	12.15	19.68	22.65
Wisconsin PS	16.82	15.30	14.96	14.53	15.01	16.73	19.28	20.64	22.35	23.56	22.94	22.89	22.47	22.27	21.31	21.51	22.56	23.71	36.30	36.15	25.16	22.92	19.01	16.81	21.46	24.11
Cleared Load (GW)	45.8	44.9	44.0	44.0	45.3	47.5	50.0	51.5	54.0	55.5	55.8	55.9	55.2	54.6	54.0	54.8	55.6	57.3	63.5	63.1	59.6	56.4	51.7	4.9		

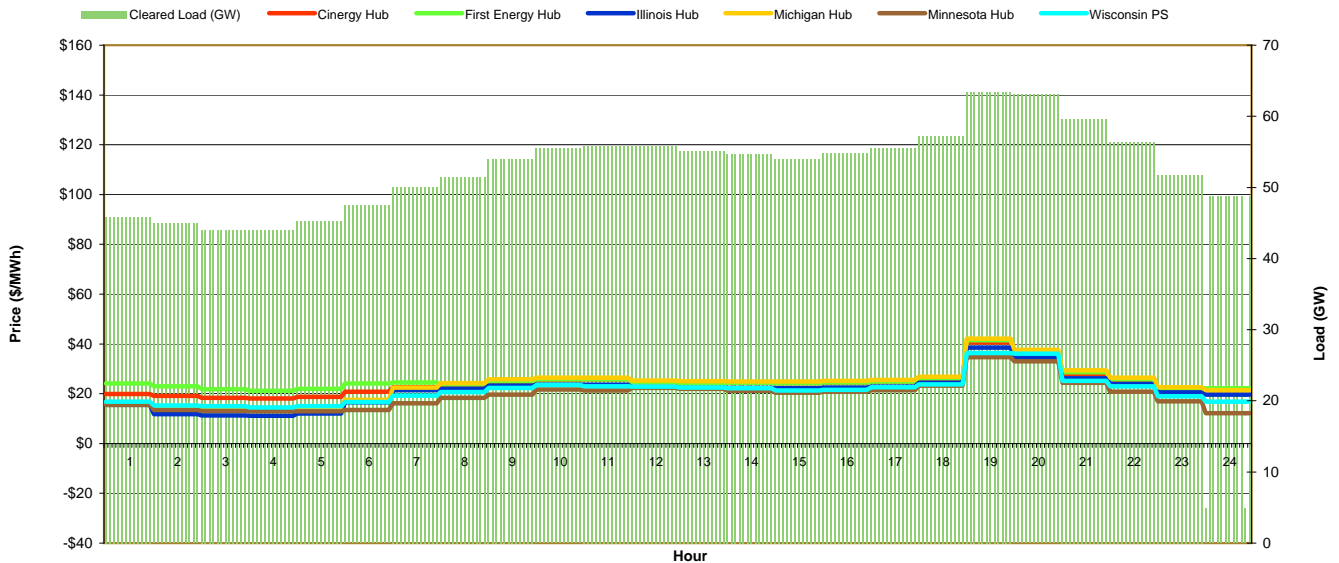

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	9.71	12.55	3.66	5.76	15.49	21.89	21.13	23.05	25.06	27.98	31.08	23.54	23.76	23.42	22.83	24.02	30.45	21.67	33.02	35.48	23.92	23.75	19.96	16.85	21.67	25.81
First Energy Hub	10.40	13.06	3.69	5.94	15.67	22.39	21.48	23.54	25.63	28.78	64.39	24.19	24.39	24.10	23.46	24.73	31.50	22.24	33.86	36.37	24.55	24.29	20.34	16.95	23.58	28.52
Illinois Hub	-9.98	1.08	3.35	0.68	13.36	13.61	17.46	17.91	20.60	20.34	14.21	20.23	20.46	18.96	19.77	19.95	19.09	20.02	31.06	34.38	22.41	22.43	18.83	24.62	16.87	21.29
Michigan Hub	11.80	13.88	3.73	6.34	15.91	23.15	21.89	23.98	26.08	29.59	153.23	24.65	24.90	24.61	23.88	25.25	32.64	22.70	34.49	37.08	25.16	24.75	20.58	18.36	27.86	34.60
Minnesota Hub	-9.32	1.40	3.29	0.51	12.63	12.55	16.23	16.93	19.68	19.33	16.81	19.15	19.15	17.79	18.47	18.74	17.64	18.75	30.01	33.32	20.83	17.62	13.37	-37.32	13.23	19.85
Wisconsin PS	-15.44	-1.87	3.37	-0.73	13.06	11.74	17.01	17.29	20.41	19.24	13.86	20.20	20.38	18.47	19.60	19.59	16.69	20.30	32.07	35.96	22.99	22.22	18.22	-8.50	14.84	21.09
Forecasted Load (GW)	49.6	48.3	47.6	47.4	47.9	49.4	50.8	52.4	53.5	54.7	55.2	55.0	55.0	54.5	54.0	54.2	55.2	57.0	60.3	61.6	60.0	57.4	54.5	52.3		
Forecast Error %	-3.9%	-4.2%	-4.3%	-4.4%	-4.9%	-4.9%	-3.8%	-3.4%	-0.8%	-0.4%	0.0%	0.3%	1.0%	1.3%	1.4%	1.7%	1.1%	-0.4%	-1.6%	0.4%	0.7%	0.1%	-0.9%	-2.2%		

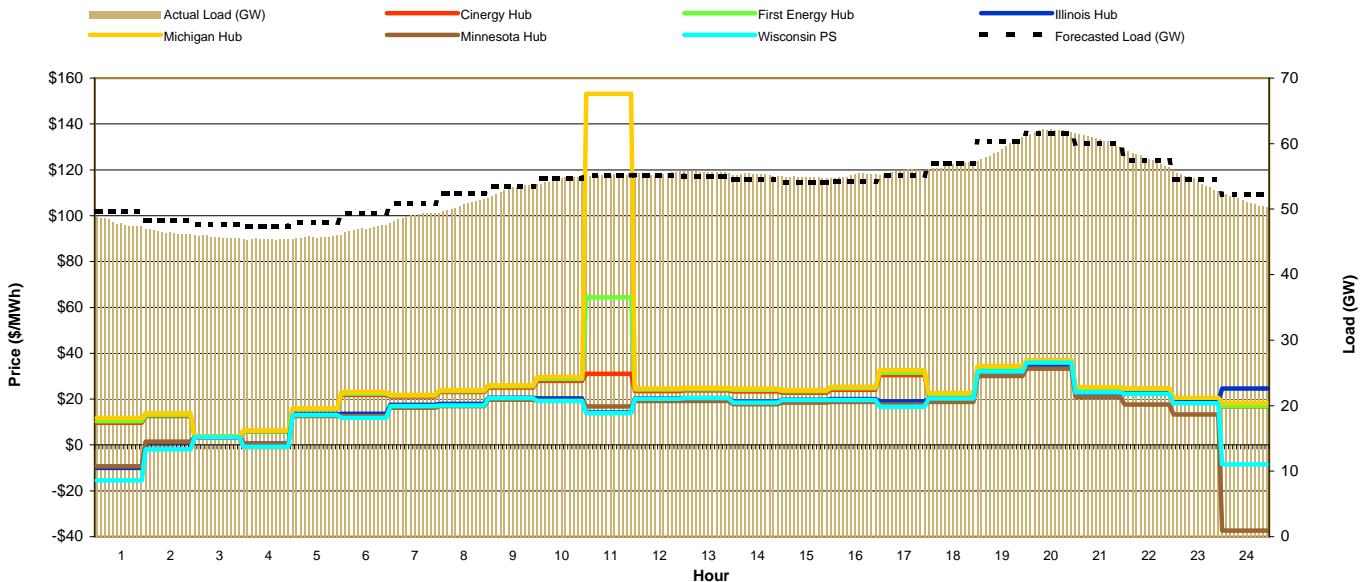




MISO Daily Report

Monday October 4, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	20.02	17.18	16.99	14.39	20.41	29.00	42.88	37.64	33.43	36.05	35.78	32.32	31.57	30.64	27.33	26.74	26.12	26.73	45.76	35.67	29.11	26.00	21.81	21.13	28.53	31.42
First Energy Hub	20.12	17.59	17.29	16.28	22.23	32.23	44.46	39.23	35.88	37.37	36.50	33.01	32.53	32.32	30.30	29.79	28.43	29.93	43.34	37.65	31.69	27.13	22.62	21.18	29.96	32.98
Illinois Hub	10.04	8.43	8.80	8.08	10.55	21.57	29.45	31.73	31.92	34.57	34.84	31.65	30.46	29.61	25.94	25.30	24.90	25.10	40.72	34.49	27.67	24.56	20.98	13.30	24.36	29.65
Michigan Hub	21.04	19.88	18.81	22.07	27.75	40.26	47.00	41.15	40.87	39.76	37.38	33.79	34.00	35.59	36.41	36.14	33.18	36.82	44.49	41.64	37.29	29.26	24.64	23.48	33.45	36.40
Minnesota Hub	4.56	3.60	3.62	3.77	4.68	18.91	27.76	29.22	29.41	30.02	33.84	30.44	29.48	28.67	27.01	26.34	24.03	26.64	31.27	30.83	28.15	22.18	18.27	8.11	21.70	27.86
Wisconsin PS	8.96	7.92	8.26	8.78	10.92	20.67	29.64	28.56	38.00	41.63	43.42	41.65	40.93	39.61	37.30	34.62	24.17	24.68	35.23	33.15	25.78	22.94	19.56	15.93	26.76	33.20
Cleared Load (GW)	45.9	46.3	46.4	46.9	50.7	60.0	68.5	69.3	69.4	70.5	70.2	69.5	69.2	68.8	67.8	67.1	66.8	66.8	71.7	70.9	68.0	63.8	57.3	5.3		

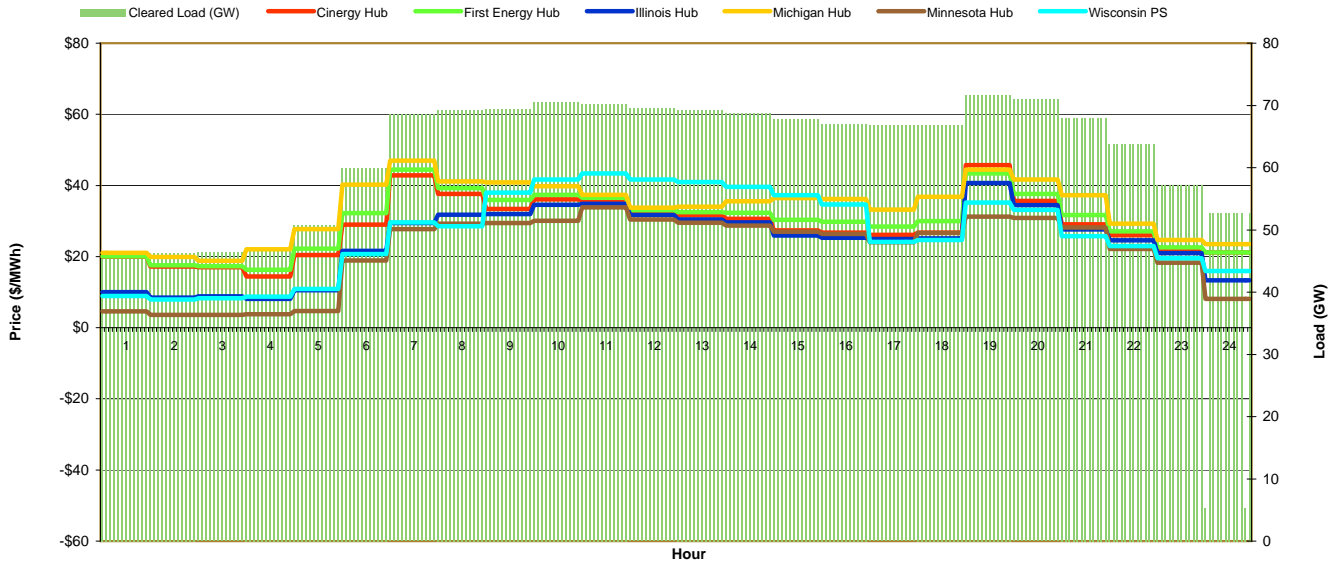

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	-42.74	21.04	15.20	-2.11	28.48	32.16	29.75	27.95	34.58	28.02	32.04	28.91	27.59	27.41	28.82	25.78	24.93	24.93	27.05	48.19	26.91	22.76	21.48	17.97	23.21	28.58
First Energy Hub	-43.34	26.44	31.19	4.59	28.77	32.56	30.35	28.62	35.47	28.79	33.02	29.72	28.40	28.21	29.60	26.46	25.58	25.58	27.83	49.46	27.46	23.41	26.92	18.33	25.14	29.66
Illinois Hub	-42.69	15.11	6.85	-7.04	22.83	30.58	28.80	27.21	33.59	27.31	31.07	27.84	26.64	26.59	27.73	24.67	24.00	23.91	26.18	46.85	25.58	21.21	21.21	26.63	21.78	27.60
Michigan Hub	-43.79	41.24	75.78	22.62	30.70	33.34	31.30	29.29	36.18	29.24	33.66	30.41	29.21	29.12	30.53	27.21	26.26	26.15	28.48	50.89	28.04	24.39	40.00	18.94	29.55	31.19
Minnesota Hub	-47.51	14.03	5.90	-20.85	-22.55	26.70	41.64	37.06	13.39	26.94	60.94	29.17	33.33	32.77	27.70	22.33	23.60	21.56	27.21	70.19	21.75	18.15	-3.95	8.94	19.52	28.88
Wisconsin PS	-51.80	14.58	6.42	-11.29	1.18	30.80	30.55	28.81	44.67	31.19	34.57	31.06	29.48	30.13	28.52	24.98	24.64	24.35	27.50	51.52	25.74	20.46	11.29	18.34	21.15	29.30
Forecasted Load (GW)	49.8	50.0	48.8	49.6	52.0	58.1	64.6	67.9	68.7	69.1	69.3	67.1	66.8	66.2	65.5	64.9	64.8	65.6	67.7	68.2	66.1	62.7	58.8	55.2		
Forecast Error %	-0.7%	-2.4%	-0.6%	-0.8%	-0.5%	-1.1%	-1.3%	-3.2%	-3.3%	-3.0%	-2.8%	-0.1%	0.2%	0.4%	0.5%	-1.5%	-2.3%	-3.3%	-2.1%	0.4%	0.4%	0.0%	-1.4%	-1.4%		

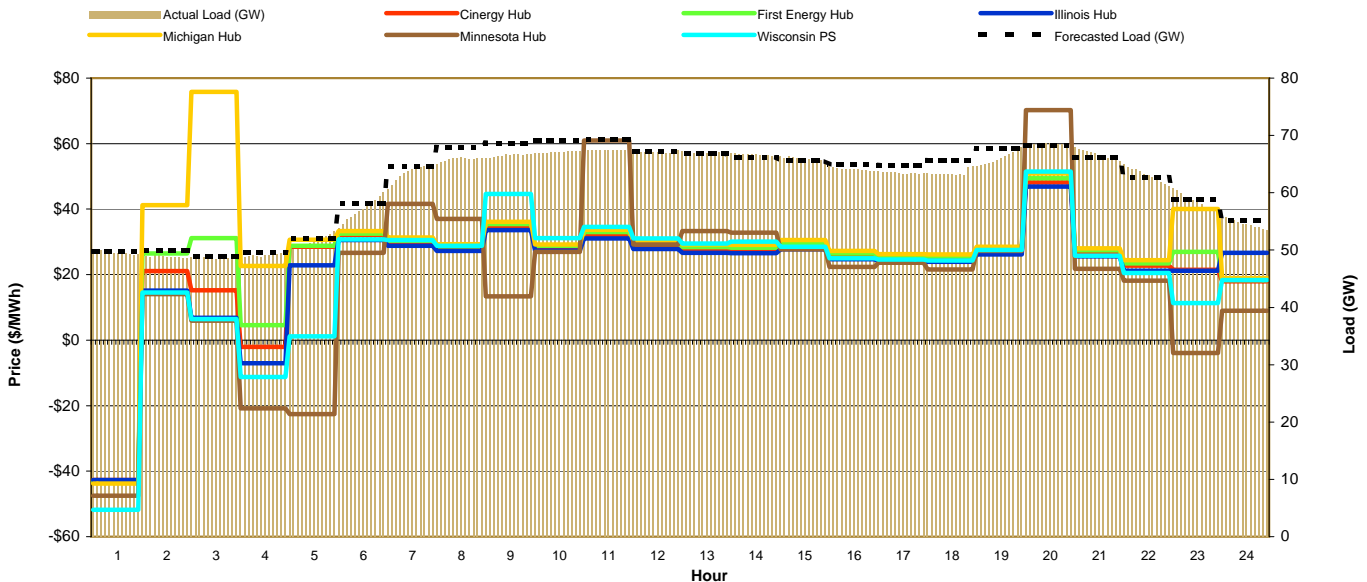




MISO Daily Report

Tuesday October 5, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	20.41	20.68	20.79	21.36	24.74	33.29	40.45	35.82	39.45	39.74	37.91	36.57	36.98	37.16	34.66	33.63	30.68	31.47	41.64	37.28	32.86	27.36	23.19	22.52	31.69	34.78
First Energy Hub	20.32	20.77	20.75	21.07	25.14	33.82	41.27	36.56	39.91	40.34	38.57	37.29	37.57	37.68	35.34	34.25	31.34	32.15	47.54	38.16	33.56	27.98	23.27	22.94	32.40	35.72
Illinois Hub	14.62	14.40	13.25	14.45	16.44	29.36	38.37	34.40	39.74	39.09	37.41	36.02	36.20	36.37	33.41	32.43	29.63	29.70	39.92	36.14	31.63	25.94	19.87	16.79	28.98	33.62
Michigan Hub	20.92	21.37	21.28	21.57	27.12	34.54	42.09	37.22	40.80	41.25	39.40	37.95	38.47	38.49	35.91	34.81	31.93	32.77	43.50	38.94	34.04	28.47	23.61	24.75	32.97	36.10
Minnesota Hub	3.12	2.45	1.74	1.90	2.49	19.02	25.58	28.08	30.25	32.92	33.68	29.28	30.24	30.22	27.49	25.45	24.41	24.45	35.94	35.03	28.31	20.73	18.86	8.38	21.67	28.46
Wisconsin PS	9.97	8.94	8.81	9.27	14.19	25.99	35.56	34.12	34.67	34.87	34.16	32.84	35.43	34.57	31.02	29.94	27.86	28.16	39.85	37.97	32.29	23.87	19.55	15.97	26.66	31.95
Cleared Load (GW)	45.8	45.7	45.9	46.5	51.0	60.4	67.1	67.7	67.5	68.4	68.6	68.2	68.3	67.8	66.7	66.3	65.7	65.7	69.9	69.3	66.4	61.9	55.3	5.1		

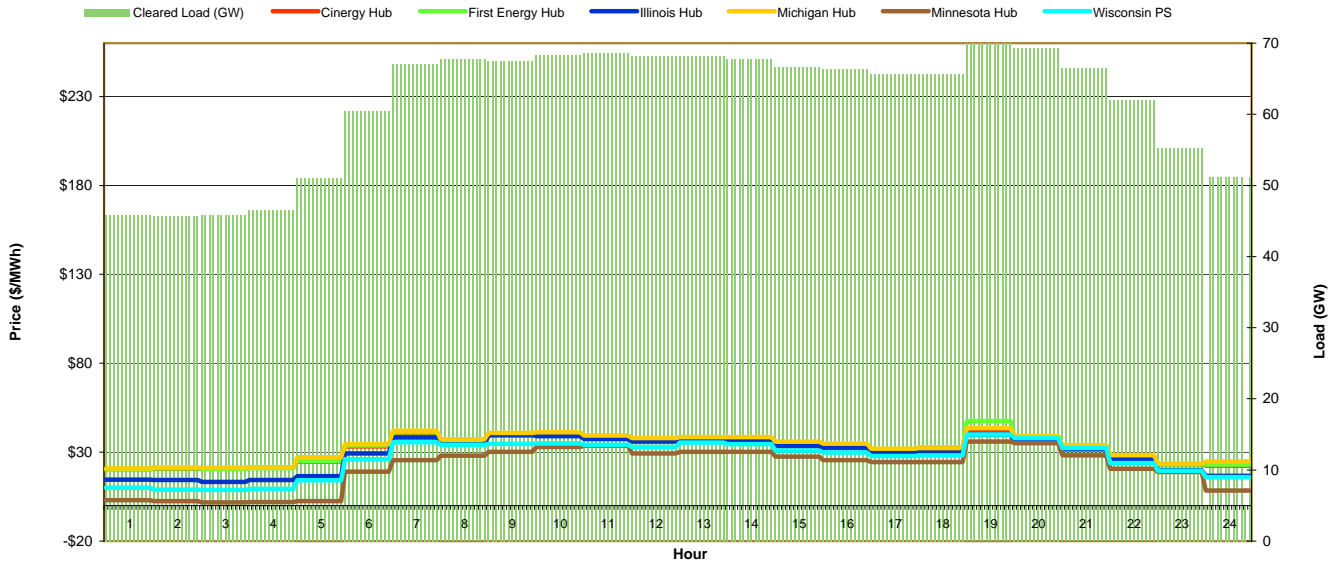

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	25.28	21.85	20.62	21.64	25.96	94.27	24.10	25.71	23.45	52.23	24.65	37.72	25.32	28.92	28.79	25.90	24.50	23.27	45.55	40.18	23.53	24.99	19.03	15.11	30.11	29.61
First Energy Hub	45.45	22.80	20.89	22.03	52.17	136.45	24.58	26.33	24.10	68.33	25.44	38.95	26.17	29.91	29.99	26.88	25.34	24.09	47.10	41.55	24.50	48.54	26.59	19.62	36.58	33.36
Illinois Hub	16.40	20.02	19.63	18.81	14.09	41.12	23.31	24.95	22.19	42.67	23.63	36.38	27.82	40.25	43.69	28.64	27.13	24.44	43.61	39.03	27.22	23.97	30.86	37.73	29.07	31.66
Michigan Hub	97.50	25.06	21.36	22.62	119.74	253.40	25.38	27.18	24.90	107.81	26.02	39.98	26.85	30.82	31.45	27.99	26.02	24.67	47.92	42.28	25.76	108.94	45.74	30.96	52.51	41.52
Minnesota Hub	17.95	8.56	16.95	17.70	8.63	-0.29	23.87	31.77	25.45	60.98	30.64	56.27	33.63	46.74	42.34	33.71	28.09	27.59	58.54	55.15	13.48	-5.13	4.13	-12.40	26.01	33.96
Wisconsin PS	16.04	19.52	20.20	18.91	15.85	56.59	25.41	26.70	24.45	46.89	25.49	39.15	26.21	30.03	29.61	26.51	25.06	23.75	46.78	41.40	25.47	18.91	16.59	12.49	27.41	29.56
Forecasted Load (GW)	52.7	52.4	50.8	51.3	53.5	59.4	65.6	68.4	68.8	69.1	69.3	67.4	67.3	67.1	66.3	65.6	65.4	65.9	67.9	68.2	66.2	62.8	59.0	55.5		
Forecast Error %	-0.6%	-2.2%	-0.4%	-0.1%	0.2%	-0.6%	-1.1%	-2.8%	-3.0%	-2.9%	-3.3%	-0.3%	-0.1%	-0.1%	0.1%	0.3%	-0.3%	-1.4%	-2.0%	0.3%	0.2%	-0.3%	-1.7%	-1.6%		

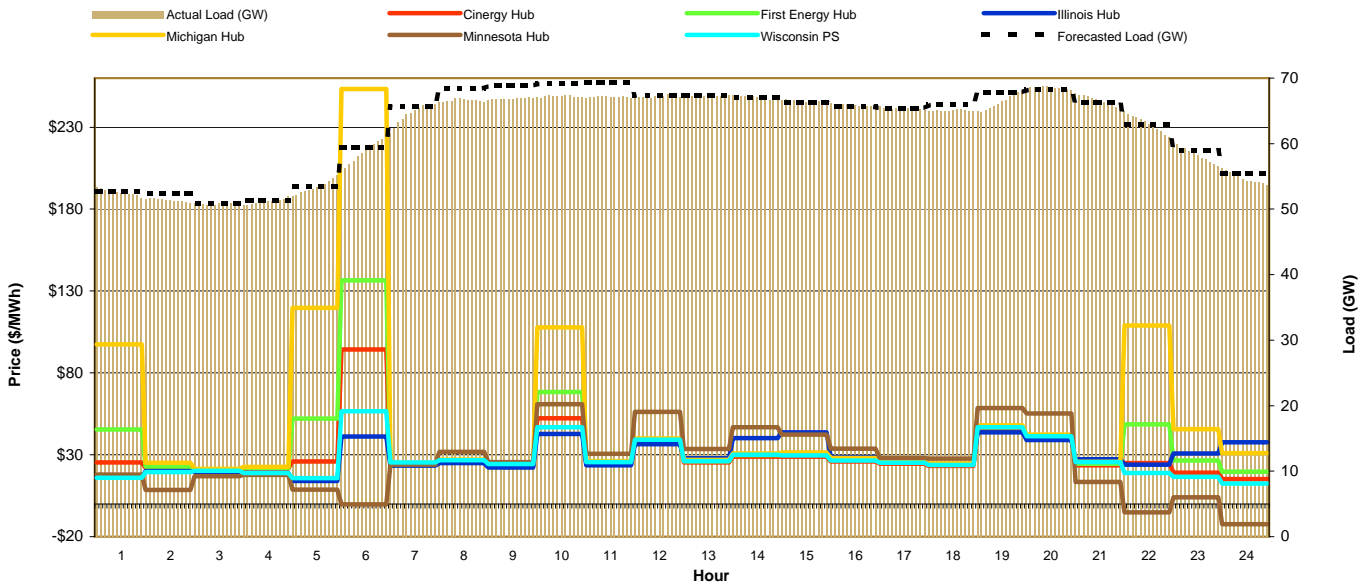




MISO Daily Report

Wednesday October 6, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	19.54	19.22	19.37	19.98	22.58	30.92	34.00	28.73	29.17	31.88	33.70	33.84	34.06	33.65	27.71	27.78	28.25	28.07	38.53	34.05	27.55	24.71	22.50	21.51	27.97	30.26
First Energy Hub	21.39	20.81	20.99	21.38	24.21	34.07	36.07	30.84	31.29	33.86	35.03	33.94	34.93	33.96	28.47	28.60	28.89	28.86	39.11	35.05	28.35	25.41	23.52	22.92	29.25	31.26
Illinois Hub	14.71	10.88	10.88	10.88	11.32	24.98	30.22	26.03	27.41	30.43	32.53	32.90	32.94	32.81	26.76	26.92	27.50	27.19	37.64	32.81	26.80	23.81	21.97	20.47	25.03	29.15
Michigan Hub	26.04	25.78	25.86	26.05	30.19	41.62	40.15	34.43	35.51	37.65	37.46	34.88	35.66	34.88	28.95	29.06	29.43	29.29	40.24	35.55	28.75	25.77	25.32	26.03	31.86	32.68
Minnesota Hub	2.62	2.88	2.92	2.69	0.95	12.25	20.92	22.37	23.23	26.99	28.23	25.63	25.53	25.32	22.26	21.94	21.03	21.85	30.83	31.96	24.62	21.32	16.32	10.77	18.56	24.34
Wisconsin PS	12.12	8.72	8.58	9.40	15.68	24.96	31.60	29.13	30.86	32.92	34.79	34.63	35.67	34.96	29.48	29.62	29.21	28.23	40.03	36.39	28.43	23.38	20.61	19.13	26.19	31.14
Cleared Load (GW)	48.5	48.3	48.0	48.7	52.8	61.9	67.3	67.4	67.4	68.4	68.6	68.4	68.5	68.4	67.9	67.1	66.5	66.0	70.0	69.5	66.7	61.9	56.2	5.2		

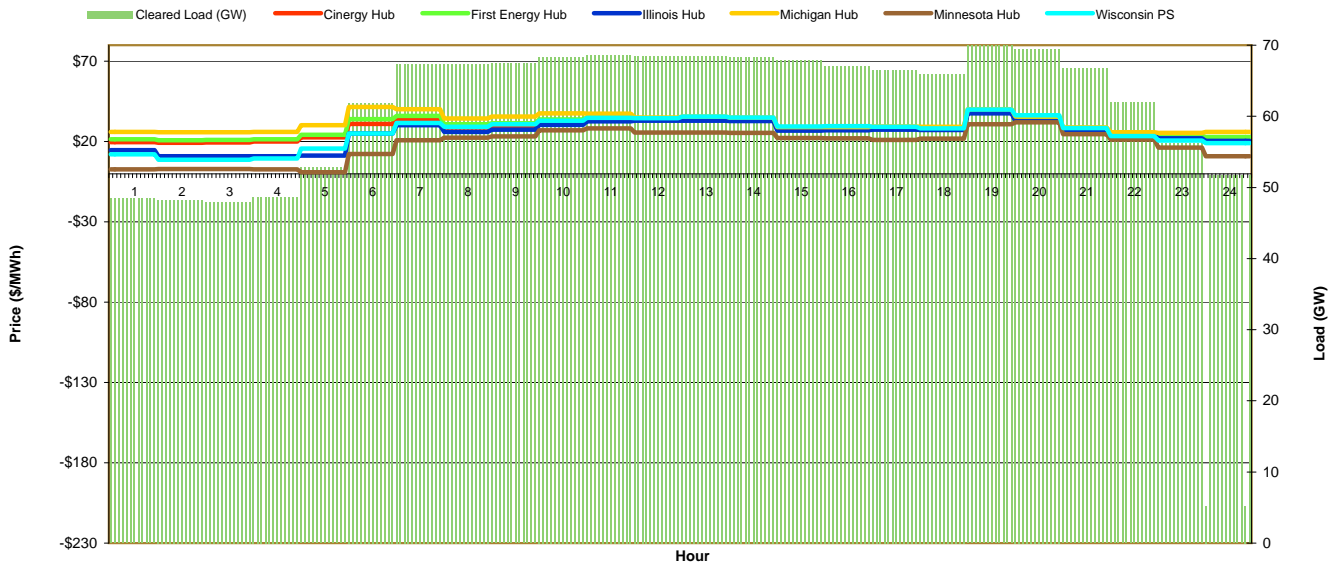

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	-15.36	-17.33	20.04	20.40	20.38	26.20	40.09	23.64	26.66	31.76	37.10	51.87	31.71	24.92	24.15	23.86	24.47	23.64	24.47	24.96	23.79	22.08	20.65	15.76	22.91	27.48
First Energy Hub	-15.48	-16.42	20.67	21.16	21.02	39.48	41.23	24.42	27.52	32.81	38.43	53.82	32.88	25.95	25.25	24.79	25.35	24.54	25.34	25.82	24.60	22.89	21.42	16.27	24.32	28.49
Illinois Hub	9.01	8.91	22.13	22.63	15.80	24.04	36.12	21.89	28.70	30.12	34.95	49.23	30.30	23.87	21.97	22.74	23.35	22.51	22.63	23.67	22.14	20.81	18.77	15.97	23.84	26.10
Michigan Hub	-15.39	-13.86	21.32	21.92	21.68	73.10	42.47	25.24	28.54	33.94	39.67	55.49	33.86	26.74	25.88	25.26	25.72	24.87	25.65	26.12	24.95	23.20	21.69	16.32	26.43	29.18
Minnesota Hub	-79.78	-227.74	-11.03	-8.15	-16.88	1.29	-37.19	24.78	31.25	19.75	24.55	34.64	18.84	20.39	18.95	17.83	23.70	25.61	25.56	21.88	20.26	20.73	15.36	10.32	-0.21	22.76
Wisconsin PS	-25.12	-1.63	17.66	12.79	25.73	19.97	67.31	24.57	28.30	32.68	38.38	53.67	32.68	26.27	25.35	24.70	25.29	24.54	25.41	27.11	25.05	22.02	20.16	16.71	24.56	28.51
Forecasted Load (GW)	53.6	52.3	51.6	51.9	54.1	58.0	63.8	65.6	66.1	66.9	67.5	67.7	68.0	68.0	67.6	67.0	66.4	66.1	67.7	68.7	66.8	63.1	58.4	54.3		
Forecast Error %	-2.7%	-2.7%	-3.0%	-2.5%	0.8%	0.7%	0.5%	0.3%	0.0%	0.1%	0.3%	0.1%	0.0%	-0.3%	-0.2%	0.0%	0.0%	-0.5%	-0.5%	0.6%	0.2%	0.0%	0.2%	0.8%		

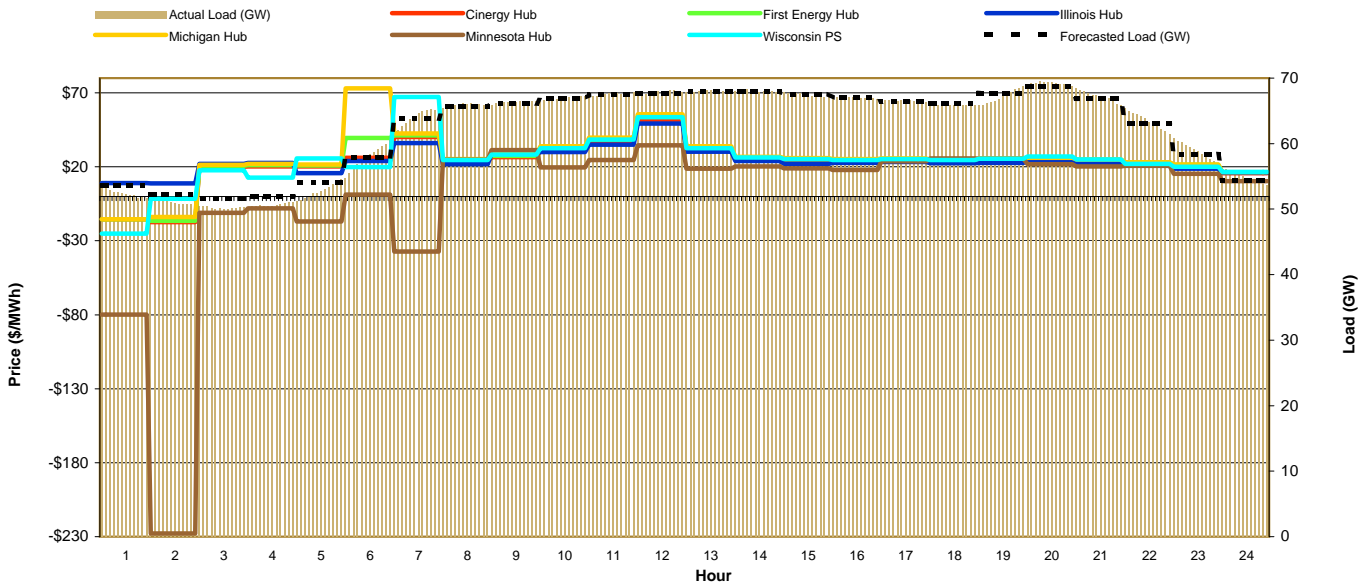




MISO Daily Report

Thursday October 7, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	19.74	19.25	18.68	19.31	23.07	31.00	33.92	28.76	30.15	32.41	34.29	33.92	33.87	34.83	33.40	30.86	29.45	30.04	41.17	37.32	29.08	25.43	22.92	21.47	28.93	31.74
First Energy Hub	21.04	19.90	19.20	19.61	23.98	33.67	39.66	31.92	33.42	34.45	36.96	36.56	36.58	37.99	35.26	33.08	31.40	33.28	42.61	38.62	31.77	27.84	23.83	22.72	31.06	34.10
Illinois Hub	18.07	18.06	16.42	18.60	20.55	25.83	29.93	26.36	27.56	30.61	32.74	32.23	32.64	33.20	31.09	29.60	28.29	28.23	39.45	36.34	27.43	23.90	21.97	20.37	27.06	30.10
Michigan Hub	23.79	20.92	19.49	19.92	25.24	41.00	54.37	38.38	40.07	37.73	41.79	41.29	41.53	44.06	37.75	36.98	34.70	39.93	43.59	39.69	37.02	32.67	25.34	25.48	35.11	38.28
Minnesota Hub	2.77	2.80	2.77	2.88	2.87	14.17	20.90	23.55	23.36	29.52	29.92	28.39	28.68	31.52	27.62	25.06	25.74	24.07	38.76	36.32	27.15	21.28	18.74	3.65	20.52	27.48
Wisconsin PS	13.02	13.29	10.96	11.00	16.78	25.09	32.42	31.19	32.42	33.54	35.82	35.16	35.39	35.56	33.29	32.60	31.04	29.75	43.01	40.21	30.04	23.80	20.82	19.76	27.75	32.73
Cleared Load (GW)	45.5	45.0	44.1	44.7	48.8	58.8	64.7	65.3	66.1	67.1	67.3	67.1	67.5	67.6	66.4	66.0	65.7	66.0	69.0	68.6	65.9	61.5	54.7	5.1		

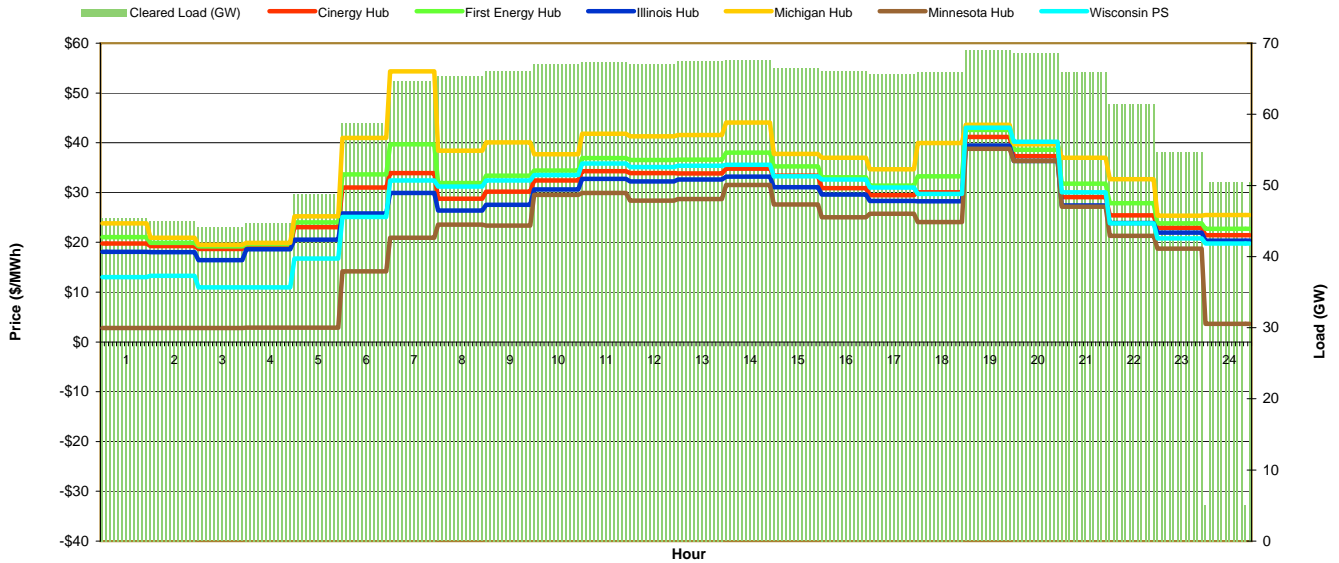

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	18.97	17.05	17.23	18.04	20.97	24.52	29.08	24.48	25.49	29.92	37.01	29.51	32.87	49.25	30.41	30.23	33.16	27.00	50.58	31.22	28.52	22.06	19.90	22.10	27.90	31.35
First Energy Hub	19.11	17.48	17.69	18.53	21.69	25.29	29.93	25.30	26.34	30.91	38.31	30.47	33.89	50.73	31.30	31.03	34.02	27.71	51.97	32.12	29.31	22.60	20.37	56.86	30.12	32.27
Illinois Hub	14.91	16.31	16.09	16.50	15.67	21.12	28.38	23.90	24.47	28.38	35.31	27.99	31.64	47.27	29.72	29.54	32.27	26.33	48.46	30.28	27.74	21.43	19.32	13.54	26.11	30.25
Michigan Hub	17.84	17.40	17.65	18.49	22.00	25.76	30.53	25.71	26.80	31.45	39.02	30.94	34.26	51.22	31.57	31.31	34.30	27.90	52.35	32.27	29.60	22.67	20.53	-32.46	26.64	32.63
Minnesota Hub	-17.84	14.47	15.08	15.37	14.43	19.89	23.54	19.78	21.92	12.83	47.00	28.30	30.54	44.81	29.55	28.62	29.63	26.15	34.70	44.15	49.54	20.07	19.90	18.99	24.64	30.47
Wisconsin PS	7.34	16.71	16.59	16.85	15.04	21.33	31.34	26.66	26.92	36.54	38.47	31.53	34.16	51.51	31.05	30.98	34.35	27.45	57.52	33.12	29.60	24.29	24.22	14.30	28.24	33.65
Forecasted Load (GW)	53.8	52.3	51.6	51.8	53.8	57.7	63.7	65.6	66.5	67.2	67.8	68.0	68.3	68.3	67.8	67.3	66.8	66.6	68.0	68.7	66.7	63.1	59.2	56.2		
Forecast Error %	-3.4%	-3.5%	-3.8%	-3.7%	-3.3%	-0.7%	-0.9%	-1.1%	-1.0%	-0.7%	-0.4%	-0.1%	0.4%	0.7%	0.9%	0.8%	0.8%	-0.2%	-0.3%	0.9%	0.3%	-0.3%	-2.0%	-3.6%		

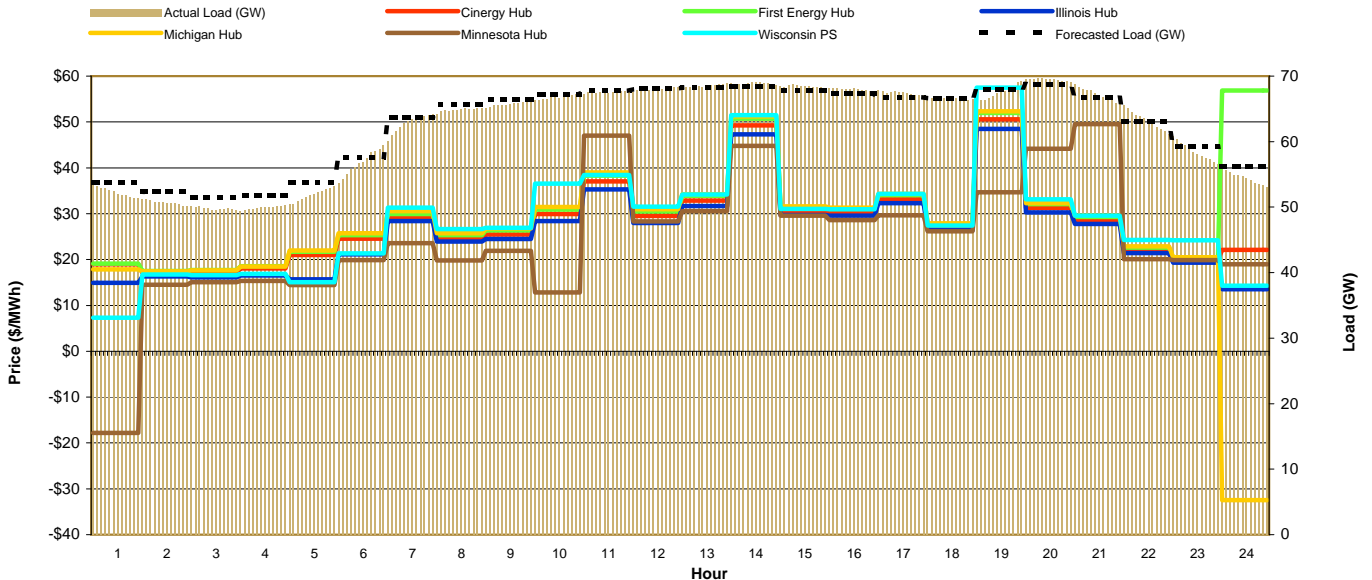




MISO Daily Report

Friday October 8, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$			
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk		
Cinergy Hub	20.10	18.24	18.45	19.14	21.62	29.40	29.21	25.80	26.58	28.44	30.09	31.29	31.83	34.15	33.27	31.31	30.87	27.99	34.87	33.63	27.63	23.60	21.73	20.84	27.09	29.57		
First Energy Hub	21.55	19.54	19.73	20.35	22.57	31.57	31.59	29.02	29.79	31.12	31.97	33.36	33.19	35.85	34.57	33.49	32.94	30.11	36.21	35.42	29.89	24.89	21.96	21.00	28.82	31.49		
Illinois Hub	14.94	12.71	11.22	11.66	14.33	21.41	24.38	23.77	24.54	26.54	28.46	29.52	30.34	31.97	31.27	30.72	29.71	26.38	33.86	31.72	25.71	22.50	18.50	16.73	23.87	27.84		
Michigan Hub	20.30	18.77	18.63	19.18	24.38	36.84	36.66	35.89	36.53	36.80	34.94	36.77	34.77	38.12	35.89	37.22	36.42	33.94	37.51	37.99	34.05	26.82	22.21	21.35	31.33	34.74		
Minnesota Hub	3.43	1.59	1.25	1.25	2.42	11.22	19.64	21.41	22.36	27.19	31.55	33.88	32.95	34.69	35.70	32.98	31.98	26.49	34.72	33.66	31.15	22.87	19.30	15.46	22.05	29.56		
Wisconsin PS	15.67	13.37	12.17	11.87	17.10	22.82	27.90	27.40	28.19	29.61	31.65	32.04	33.22	35.71	33.89	31.38	30.99	28.51	36.55	34.94	27.50	23.81	21.19	18.79	26.09	30.41		
Cleared Load (GW)	45.4	45.3	45.1	45.6	48.7	58.8	64.7	64.6	65.4	66.5	67.7	67.5	68.0	68.0	67.4	66.9	66.0	65.3	67.7	66.8	63.9	59.3	53.6	4.9				

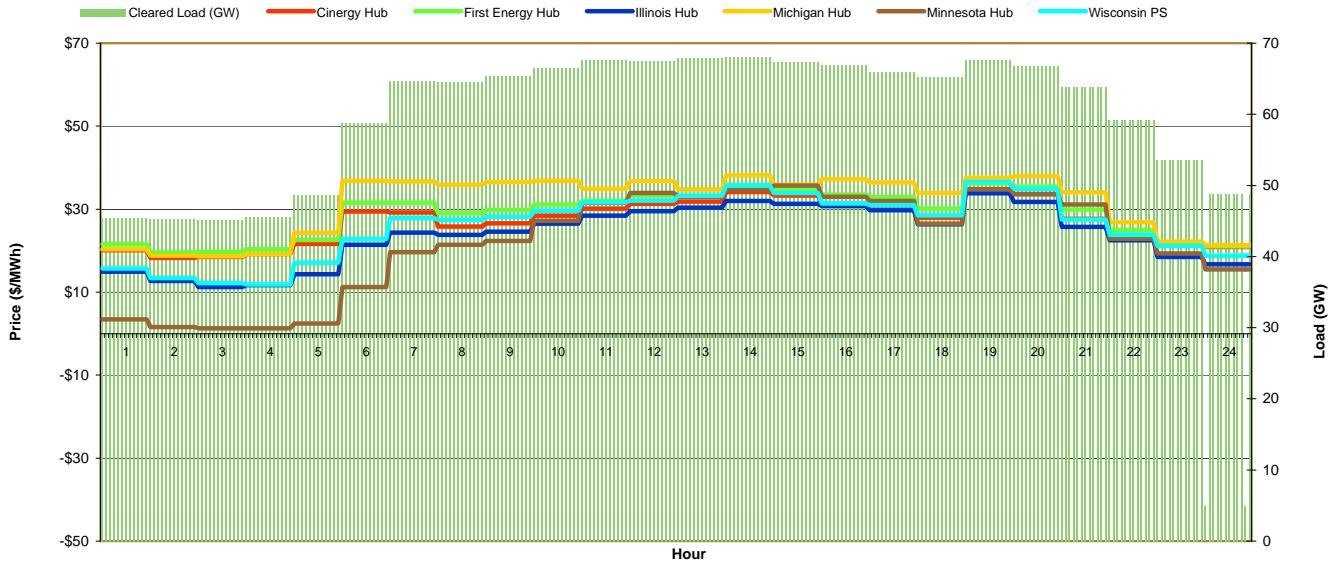

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$			
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk		
Cinergy Hub	18.54	24.08	19.33	20.75	24.75	24.37	36.82	23.92	29.94	37.78	41.77	26.89	26.62	40.17	34.33	33.93	36.38	24.98	25.46	25.41	22.64	20.30	18.45	18.57	27.34	29.31		
First Energy Hub	18.96	24.51	19.16	20.93	37.49	26.36	37.56	24.71	38.99	38.64	42.80	27.54	27.22	40.97	34.89	34.44	37.00	25.38	25.91	25.89	23.10	20.71	18.79	18.90	28.79	30.44		
Illinois Hub	17.84	19.51	12.56	17.33	16.81	22.64	35.04	22.97	25.05	34.72	40.47	25.44	25.58	37.45	32.61	32.22	32.93	23.80	23.39	24.60	22.00	19.53	17.80	17.46	24.99	27.54		
Michigan Hub	19.18	24.09	16.76	19.89	69.46	30.72	38.18	25.85	61.94	39.69	43.76	28.08	27.72	41.67	35.51	35.15	37.64	25.75	26.34	26.37	23.62	21.12	19.01	19.03	31.52	32.45		
Minnesota Hub	28.07	3.01	-44.24	-7.84	4.19	2.44	28.58	9.08	15.97	35.94	39.75	26.84	26.82	40.09	34.41	33.83	36.47	25.16	25.71	25.14	19.68	13.99	21.57	22.10	19.45	26.90		
Wisconsin PS	18.53	15.49	-2.49	11.06	13.66	29.48	60.21	29.92	31.03	38.95	43.03	27.50	27.22	40.82	34.70	34.15	36.50	25.05	25.81	25.72	23.62	23.03	19.13	18.03	27.09	30.38		
Forecasted Load (GW)	52.9	52.3	50.5	50.7	52.5	58.0	63.7	66.6	67.6	68.8	69.6	68.2	68.6	69.0	69.0	68.9	68.2	67.0	67.0	67.3	65.5	62.5	58.3	54.6				
Forecast Error %	-2.2%	-4.0%	-2.0%	-2.1%	-1.7%	-2.2%	-2.2%	-3.6%	-3.5%	-3.5%	-3.1%	-0.1%	-0.5%	-0.5%	-0.9%	-1.3%	-1.3%	-1.2%	-1.0%	-0.6%	-1.0%	-1.2%	-1.1%	-1.4%				

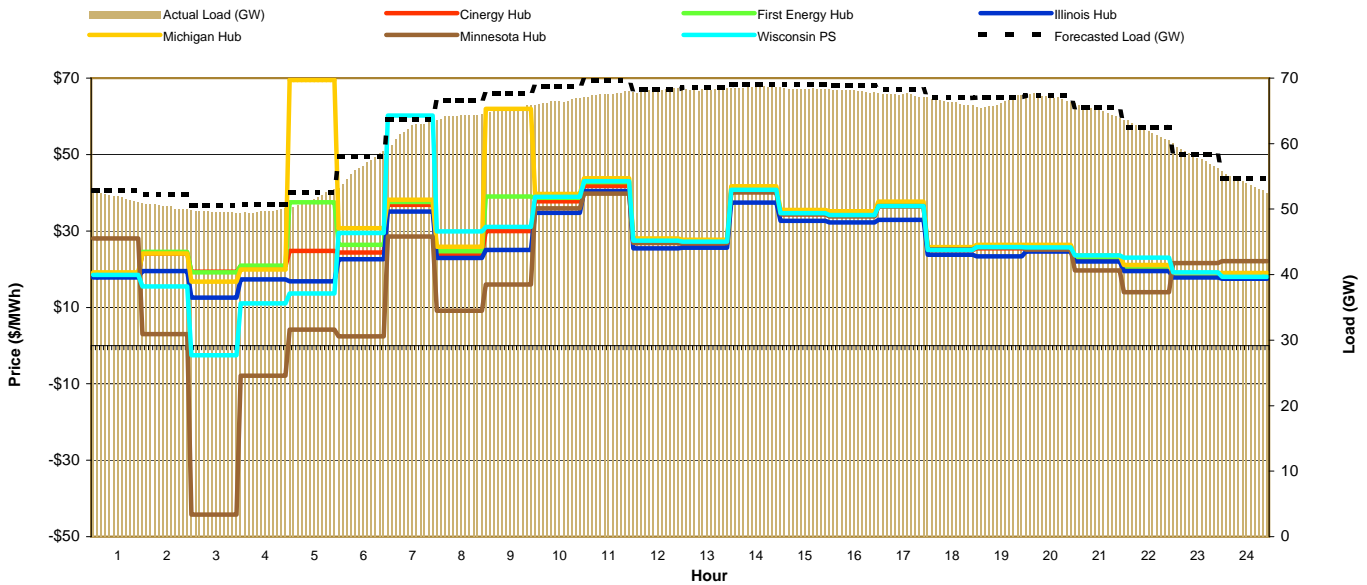




MISO Daily Report

Saturday October 9, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$			
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk		
Cinergy Hub	18.63	17.09	15.97	15.73	18.32	21.80	23.30	25.48	27.28	30.96	32.97	31.98	32.16	32.36	32.21	32.23	32.61	33.37	41.02	36.70	29.47	26.34	22.14	21.23	27.14	31.21		
First Energy Hub	21.25	19.84	18.84	18.58	20.69	23.91	24.31	26.03	28.04	32.36	33.43	32.59	33.13	33.32	33.17	33.19	33.58	34.37	42.25	37.81	30.36	27.31	24.63	23.49	28.60	32.22		
Illinois Hub	13.32	12.81	11.49	11.49	13.83	19.92	21.00	23.01	23.86	28.01	29.62	27.66	31.74	31.85	31.73	31.72	32.10	32.36	40.48	35.36	28.11	24.77	19.36	17.38	24.71	29.48		
Michigan Hub	17.39	16.23	15.99	15.25	17.91	21.38	25.93	27.26	29.91	34.61	34.40	33.52	34.07	34.27	34.11	34.13	34.54	35.35	43.45	38.90	31.22	28.49	23.55	19.99	28.41	33.24		
Minnesota Hub	5.36	5.37	5.67	5.41	4.90	5.13	15.39	20.62	27.04	25.83	30.45	29.96	31.59	30.81	31.72	31.22	32.39	34.74	39.55	40.11	29.00	25.17	19.10	12.75	22.47	29.96		
Wisconsin PS	18.41	15.37	13.64	14.30	16.87	20.64	23.06	24.64	26.67	29.70	34.26	33.31	33.75	34.27	33.73	33.84	34.18	34.77	43.81	38.64	31.55	25.20	21.00	19.18	27.28	32.08		
Cleared Load (GW)	46.0	45.3	44.2	44.4	45.6	48.7	52.6	55.1	58.7	62.2	62.3	62.2	62.4	62.3	62.3	62.9	63.5	63.4	65.2	64.7	62.6	58.4	51.8	4.8				

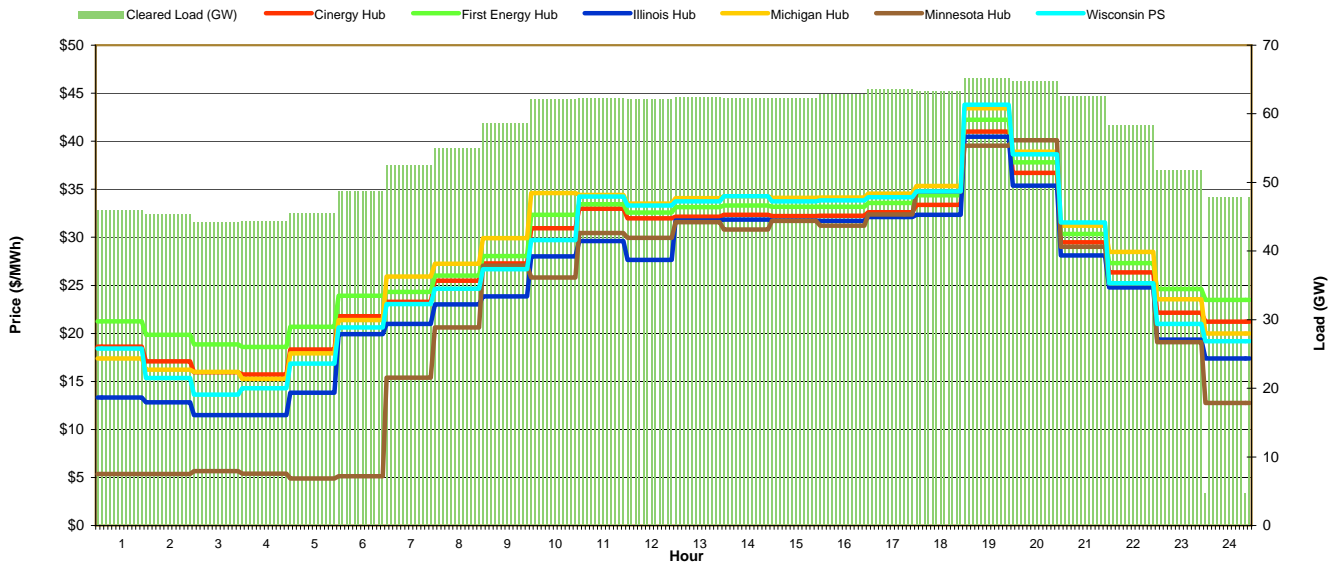

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$			
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk		
Cinergy Hub	17.87	17.32	17.05	14.91	12.53	18.81	23.85	22.35	24.32	23.52	26.47	38.18	22.57	24.93	29.49	28.05	28.11	25.08	28.14	23.90	23.21	22.76	22.58	15.04	22.96	25.85		
First Energy Hub	18.23	17.54	17.28	15.06	12.67	19.05	24.17	21.89	24.78	24.04	27.14	39.21	23.15	25.47	30.11	28.63	28.69	25.58	28.72	24.40	23.73	23.23	29.67	16.09	23.69	26.78		
Illinois Hub	14.92	16.69	16.45	14.42	12.12	17.93	22.52	16.77	21.72	22.72	25.65	36.95	21.88	24.24	28.63	27.31	27.41	24.46	27.48	23.43	22.68	22.19	18.73	14.22	21.73	24.52		
Michigan Hub	18.58	17.83	17.62	15.25	12.71	19.04	24.34	22.16	25.30	24.37	27.46	39.54	23.38	25.83	30.50	28.84	28.89	25.76	29.03	24.69	24.12	23.61	48.23	18.56	24.82	28.23		
Minnesota Hub	33.97	36.73	22.81	14.10	11.84	13.08	15.67	18.45	19.59	22.69	25.07	37.92	22.57	24.69	28.78	27.37	28.04	25.36	28.52	24.46	22.90	22.12	19.90	14.16	23.67	24.90		
Wisconsin PS	15.07	17.50	17.21	15.04	12.67	20.51	25.91	21.36	23.15	23.80	27.00	38.35	22.77	25.11	29.44	27.91	28.22	25.21	28.59	24.50	23.59	23.00	19.37	14.56	22.91	25.71		
Forecasted Load (GW)	52.2	51.3	49.1	48.6	49.0	51.6	54.1	55.6	57.4	59.6	60.9	61.7	62.3	62.9	63.4	63.9	64.2	64.0	64.6	65.0	62.7	59.5	56.5	53.6				
Forecast Error %	-2.4%	-4.3%	-2.3%	-2.0%	-1.8%	-3.5%	-3.4%	-2.4%	-0.7%	-0.8%	-0.9%	-0.8%	-1.1%	-1.5%	-1.5%	-1.4%	-1.3%	-1.8%	-1.5%	-1.0%	-0.9%	-0.9%	-2.5%	-3.6%				

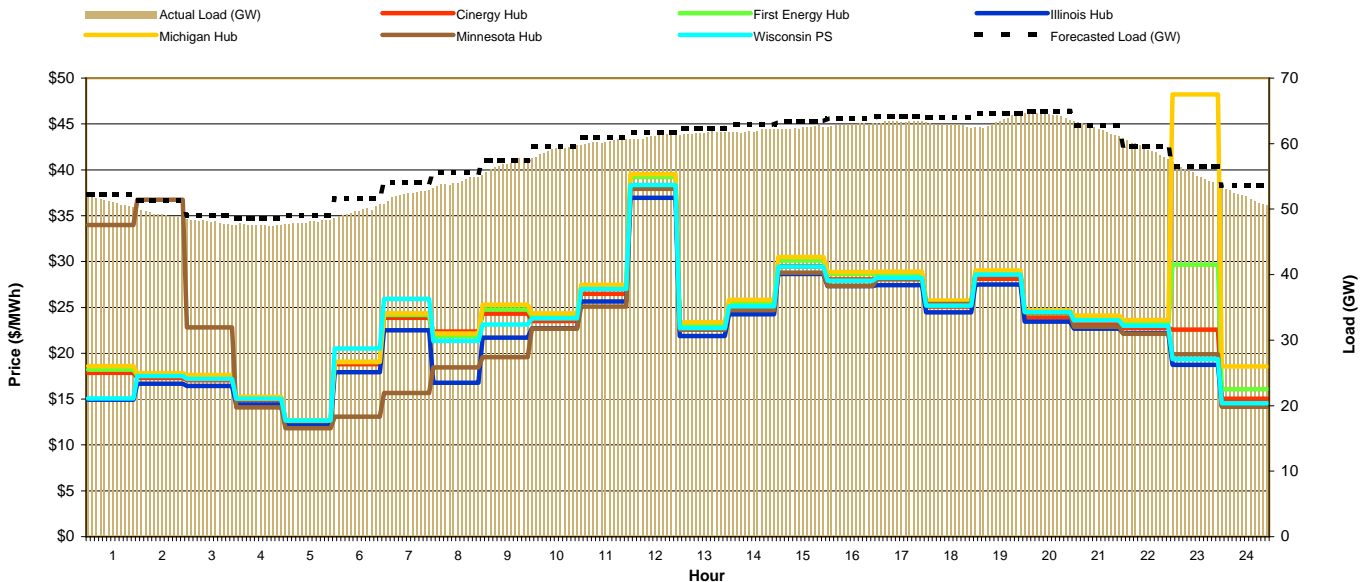




MISO Daily Report

Sunday October 10, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
																									All	On Pk		
Cinergy Hub	19.23	16.98	16.79	16.50	16.94	19.90	21.41	22.09	23.79	24.66	26.13	26.60	27.95	28.59	30.50	31.05	32.62	33.15	45.38	44.06	32.71	26.22	22.60	21.81	26.15	29.88		
First Energy Hub	23.08	20.86	21.17	21.14	21.20	22.83	24.09	23.30	25.29	25.61	26.77	27.39	28.77	29.42	31.38	31.94	33.56	34.12	46.73	45.37	33.68	26.99	24.06	23.76	28.02	30.90		
Illinois Hub	14.19	13.01	12.64	12.22	12.92	15.93	19.34	20.63	22.35	23.99	24.46	25.42	26.98	27.77	29.76	30.28	31.92	31.95	44.40	43.22	32.42	25.71	21.96	21.07	24.36	28.95		
Michigan Hub	15.60	14.31	13.98	14.00	14.41	19.15	23.44	25.53	28.10	26.90	27.53	28.16	29.59	30.25	32.26	32.83	34.51	35.08	48.05	46.66	34.64	27.75	23.77	20.75	26.97	31.98		
Minnesota Hub	14.08	8.89	7.57	7.70	9.95	9.81	11.43	15.87	19.25	21.78	24.18	25.17	25.71	24.27	26.49	26.56	27.25	29.73	42.19	43.48	31.99	24.24	19.32	17.25	21.42	26.72		
Wisconsin PS	17.87	17.01	16.68	16.56	16.98	19.93	20.81	21.29	23.42	25.85	27.04	27.55	27.64	28.17	28.51	29.28	31.04	32.97	47.47	45.76	33.94	26.01	22.93	20.43	26.05	29.93		
Cleared Load (GW)	45.6	44.3	43.3	43.0	43.9	45.6	49.4	51.7	54.4	56.8	58.2	59.7	60.7	61.9	62.4	63.5	64.3	65.0	67.1	67.3	64.7	60.5	54.2	5.0				

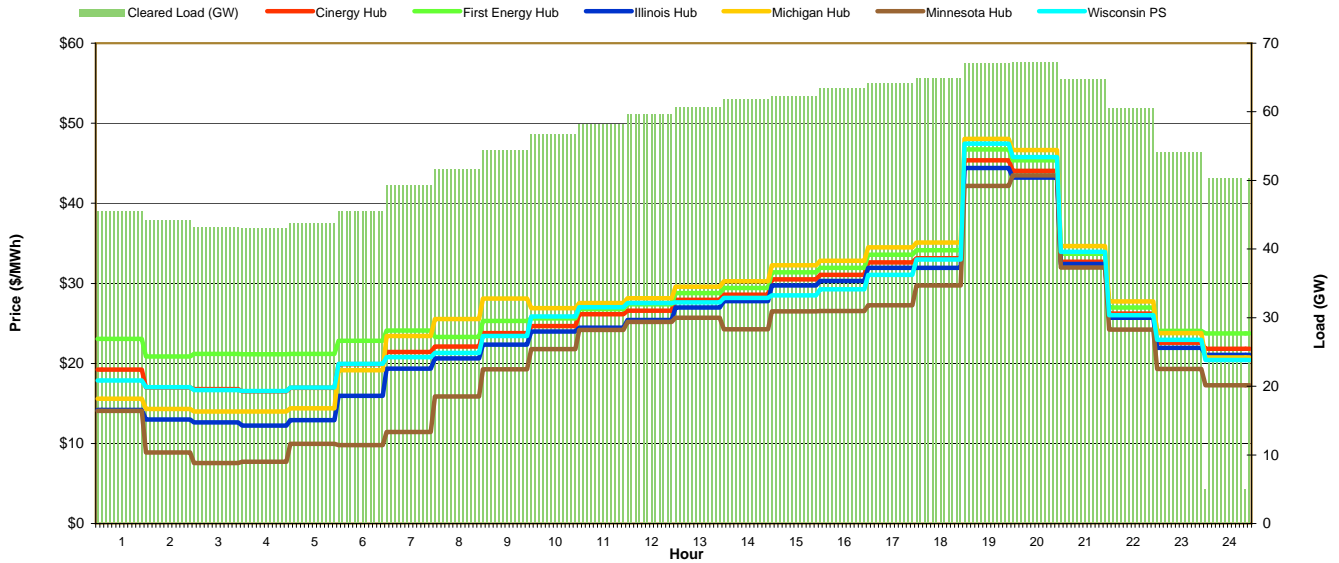

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
																									All	On Pk		
Cinergy Hub	14.88	16.85	16.83	16.63	17.12	17.73	20.56	19.21	23.66	22.89	23.69	24.03	28.21	26.94	32.36	32.32	25.84	21.40	41.52	24.87	22.90	22.50	21.92	22.94	23.24	25.89		
First Energy Hub	14.99	16.93	16.90	16.74	17.23	17.87	27.03	19.43	24.00	23.26	24.06	24.36	28.61	27.35	32.76	32.74	26.15	21.62	42.11	25.26	23.28	22.85	22.21	30.73	24.10	26.25		
Illinois Hub	20.65	16.45	16.55	16.23	16.75	17.25	16.93	18.32	22.52	22.06	22.41	23.31	27.27	26.01	31.07	30.97	24.82	20.71	40.11	23.95	22.20	21.71	21.24	18.73	22.43	24.92		
Michigan Hub	15.10	17.08	17.04	16.85	17.37	18.01	44.35	19.63	24.23	23.49	24.35	24.74	29.15	27.84	33.38	33.32	26.54	21.91	42.61	25.76	23.81	23.36	22.64	51.60	26.02	26.69		
Minnesota Hub	9.89	16.18	15.85	15.70	16.09	16.69	17.40	18.54	22.94	22.36	23.41	23.84	27.63	26.36	31.30	31.42	25.42	21.91	42.44	29.04	24.09	22.53	21.79	20.21	22.63	25.94		
Wisconsin PS	14.86	16.86	16.78	16.56	17.01	17.63	17.47	19.24	23.78	23.05	23.88	24.17	28.08	26.76	31.50	31.62	25.55	21.59	42.27	26.13	23.57	22.66	22.15	19.39	23.02	26.00		
Forecasted Load (GW)	50.3	48.9	47.9	47.7	47.9	49.0	50.7	53.3	56.0	58.0	59.9	61.6	63.0	64.3	65.5	66.3	66.3	67.3	67.9	65.4	61.6	57.3	53.6					
Forecast Error %	-2.9%	-3.7%	-3.7%	-4.1%	-4.5%	-4.6%	-4.3%	-1.3%	-1.4%	-2.0%	-2.3%	-2.5%	-2.6%	-3.6%	-4.2%	-4.9%	-4.9%	-4.7%	-2.8%	-2.1%	-2.5%	-2.3%	-2.4%	-2.0%				

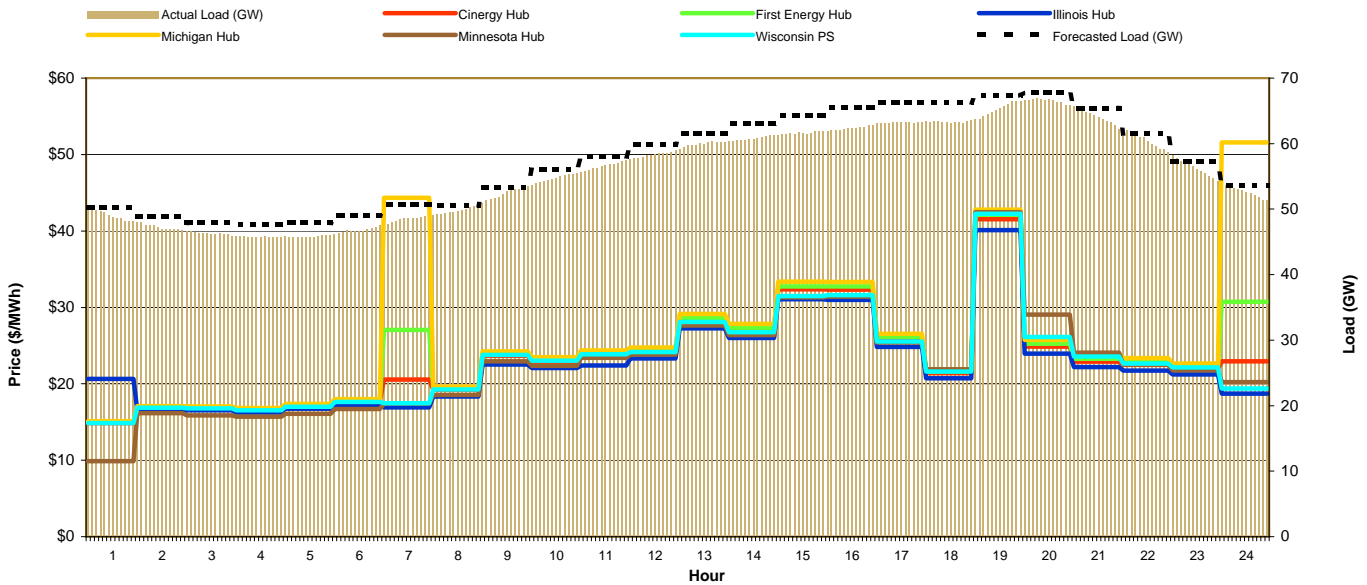




MISO Daily Report

Monday October 11, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	18.71	17.89	18.91	19.41	20.39	27.22	29.60	27.09	29.28	30.82	35.13	34.66	36.59	37.08	38.37	35.16	35.02	35.10	38.09	35.01	29.15	25.54	23.97	21.98	29.17	32.88
First Energy Hub	20.99	20.44	20.95	21.69	24.81	30.20	32.43	29.68	31.44	32.75	36.44	36.07	37.90	38.30	39.50	36.06	36.05	36.07	39.23	36.14	30.29	28.42	25.27	24.44	31.07	34.35
Illinois Hub	16.36	15.97	15.93	16.48	16.75	20.24	25.56	25.06	27.30	28.94	33.27	32.90	34.75	35.13	35.59	31.66	32.66	32.69	36.07	33.09	27.41	22.23	22.15	19.52	26.57	30.68
Michigan Hub	19.38	19.08	19.33	20.41	27.11	30.70	38.38	35.35	35.83	36.20	37.47	37.11	38.97	39.40	40.63	37.11	37.11	37.11	40.34	37.19	31.22	34.98	26.27	23.67	32.51	36.39
Minnesota Hub	14.76	14.18	13.25	13.22	15.00	20.10	26.61	29.16	29.00	32.12	35.74	35.71	36.37	37.25	37.48	35.26	36.10	35.03	37.91	36.39	33.21	26.40	22.60	17.93	27.95	33.48
Wisconsin PS	17.27	16.57	15.78	16.12	18.42	23.30	26.70	27.04	29.34	31.58	36.22	36.27	37.62	38.29	39.35	36.25	36.46	36.09	38.93	36.59	31.79	25.68	23.99	19.94	28.98	33.84
Cleared Load (GW)	46.3	46.0	45.6	46.2	49.9	58.1	64.9	65.2	67.0	69.1	70.4	71.4	72.4	72.7	72.6	72.5	71.7	71.4	73.2	72.8	68.8	64.5	59.2	5.4		

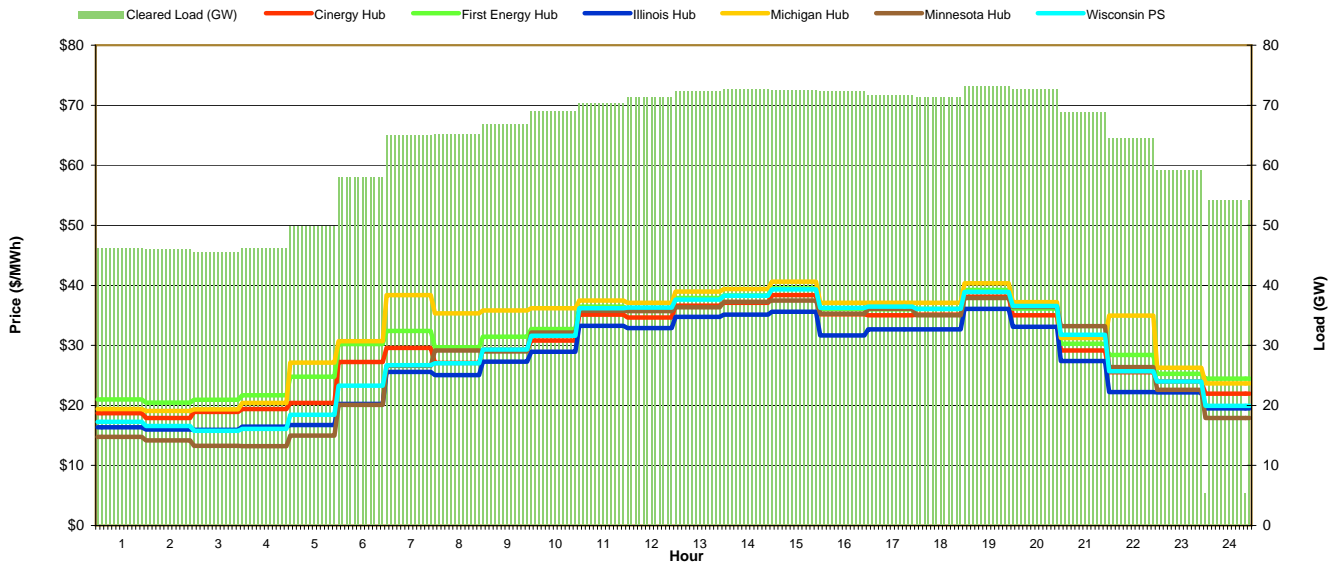

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	19.77	19.11	18.74	17.38	19.61	19.88	22.48	25.63	24.90	30.97	44.49	48.07	35.59	49.65	38.22	31.22	32.47	29.81	33.04	24.42	27.98	24.68	22.53	19.59	28.34	32.73
First Energy Hub	19.96	19.27	18.83	17.43	33.48	20.00	22.83	26.09	25.37	31.60	45.42	49.11	36.37	50.62	38.77	31.62	32.98	30.27	33.62	24.78	28.34	24.96	22.77	30.67	29.80	33.29
Illinois Hub	19.24	18.55	18.18	16.85	12.09	19.39	22.00	25.14	24.32	30.33	43.41	46.30	34.95	48.53	37.55	30.67	31.63	28.57	32.15	24.17	27.57	24.33	21.87	14.15	27.16	31.97
Michigan Hub	20.27	19.52	19.10	17.73	71.88	20.27	23.33	26.74	25.99	32.26	46.26	49.73	36.77	51.13	38.86	31.68	33.08	30.43	33.88	24.99	28.68	25.30	23.15	57.39	32.85	33.68
Minnesota Hub	19.11	17.88	17.48	16.29	13.62	18.91	21.68	25.44	24.74	31.01	45.13	49.22	35.99	50.37	38.78	31.89	33.12	30.66	33.78	26.00	29.54	26.15	22.80	16.08	28.15	33.41
Wisconsin PS	19.76	18.85	18.51	17.27	12.71	20.28	23.29	26.90	25.97	32.19	46.49	50.47	37.09	51.60	39.30	31.94	33.11	30.54	33.99	25.62	29.26	25.80	23.04	14.93	28.70	33.95
Forecasted Load (GW)	50.3	49.8	49.8	50.3	51.6	56.8	62.1	64.6	66.6	68.5	69.9	71.0	71.9	72.5	72.6	72.2	71.6	70.9	71.7	72.3	69.6	65.1	59.9	56.4		
Forecast Error %	-0.1%	-1.5%	-2.7%	-2.9%	-1.4%	-1.5%	-0.2%	-0.9%	-1.3%	-1.0%	-0.5%	0.0%	0.7%	0.9%	1.0%	0.8%	0.7%	0.4%	1.3%	0.5%	0.0%	-0.3%	0.1%	-0.9%		

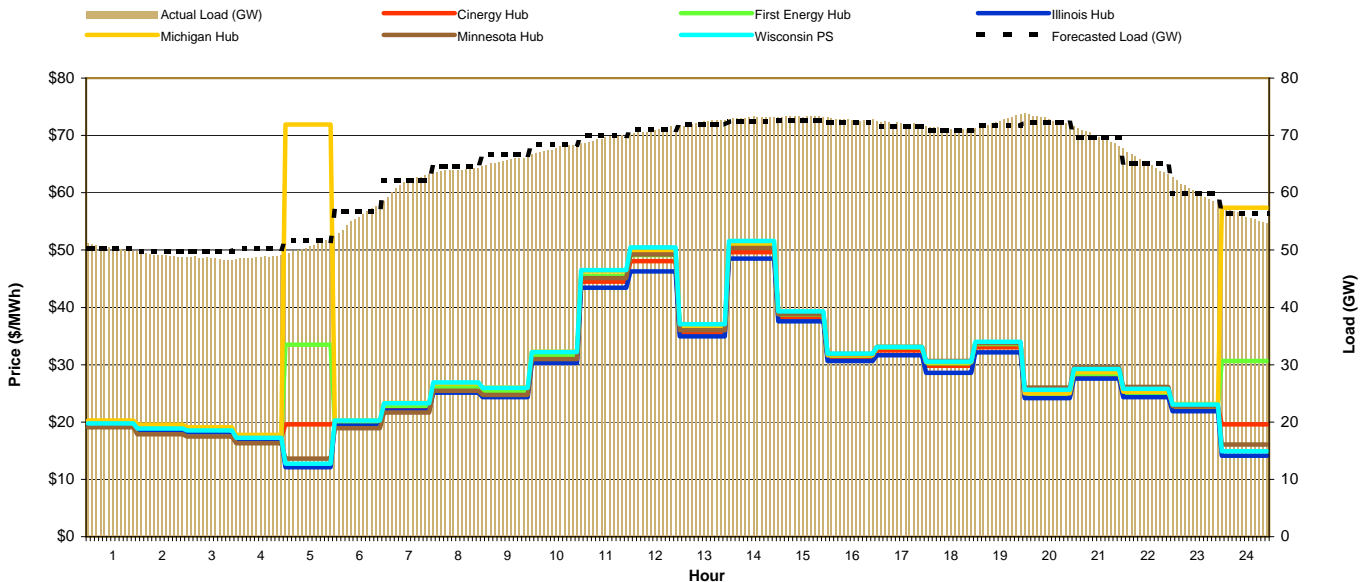




MISO Daily Report

Tuesday October 12, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	20.01	19.20	19.33	19.63	21.00	25.39	29.83	28.81	28.78	32.25	33.27	37.20	36.69	36.94	36.67	35.04	32.47	31.41	37.40	36.68	28.60	25.06	23.14	22.00	29.03	32.53
First Energy Hub	20.46	19.60	19.69	20.01	22.47	27.42	31.74	31.10	31.25	33.72	34.76	37.69	37.74	38.01	37.74	36.04	34.36	33.47	37.84	37.38	30.87	26.46	24.14	22.99	30.29	33.91
Illinois Hub	16.93	16.50	16.56	16.53	16.58	18.34	25.05	25.36	27.12	28.92	31.24	34.50	35.94	36.24	36.03	34.01	31.83	30.59	33.93	33.86	26.95	24.54	22.16	20.09	26.66	30.83
Michigan Hub	21.20	20.14	20.15	20.63	26.07	32.94	36.54	36.42	36.46	37.07	37.33	38.06	38.07	38.35	38.08	36.32	37.15	36.91	38.07	37.60	34.80	28.39	25.53	24.43	32.36	35.91
Minnesota Hub	16.08	14.82	14.61	14.56	15.28	19.88	27.59	28.04	27.83	31.09	33.98	36.71	38.92	41.62	41.87	39.40	37.13	34.00	36.48	37.13	31.49	23.45	19.43	12.61	28.08	33.66
Wisconsin PS	18.36	17.30	16.91	17.06	18.19	22.03	28.09	28.15	28.46	31.46	33.34	36.94	37.90	38.41	38.22	35.56	33.35	31.11	35.45	35.75	28.66	23.94	21.16	17.89	28.07	32.36
Cleared Load (GW)	50.5	49.0	48.2	48.8	52.0	58.7	64.5	65.2	65.9	67.3	68.3	68.9	69.9	70.1	70.0	69.4	68.9	68.8	71.2	70.3	67.1	62.4	57.6	5.3		

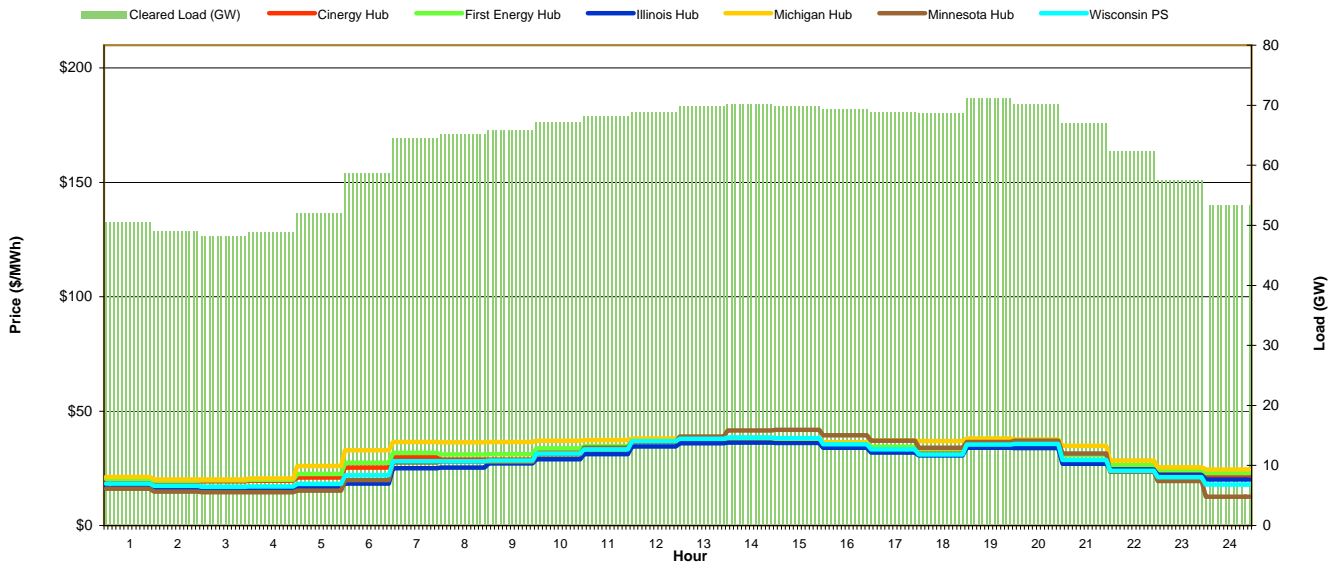

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	19.14	18.09	18.15	20.70	21.64	42.59	36.89	32.87	25.87	28.78	29.76	30.09	44.04	39.32	24.96	44.25	32.82	24.16	114.02	26.03	27.70	22.37	19.63	18.96	31.78	35.42
First Energy Hub	21.23	18.95	19.77	30.59	38.39	88.22	37.37	33.60	26.52	29.57	30.68	30.85	45.04	40.10	25.36	44.03	30.04	24.59	116.31	26.51	28.28	22.92	20.10	19.34	35.35	35.91
Illinois Hub	17.70	17.25	16.92	15.38	13.03	19.03	35.28	31.79	25.15	27.59	28.52	29.16	42.47	37.98	24.13	49.51	39.81	23.63	124.14	25.43	27.07	29.27	20.39	29.96	31.27	36.63
Michigan Hub	26.31	20.76	23.34	55.24	80.67	206.02	38.23	34.45	27.06	30.13	31.15	31.16	45.36	40.29	25.49	44.66	30.44	24.86	117.54	26.75	28.72	23.18	20.38	19.59	43.82	36.35
Minnesota Hub	17.81	17.04	16.53	15.88	14.52	22.29	33.65	44.08	25.50	49.82	44.74	57.29	82.14	79.74	29.26	39.74	24.92	24.64	82.46	27.57	26.39	15.58	15.41	7.80	33.95	41.83
Wisconsin PS	18.38	17.82	17.39	15.98	13.84	21.28	36.97	35.12	26.65	31.48	32.13	33.67	49.10	44.42	26.11	24.51	25.52	24.45	94.99	26.99	20.51	22.52	19.86	18.94	29.11	33.62
Forecasted Load (GW)	54.2	52.5	51.5	51.7	53.8	58.6	63.9	66.0	67.1	68.4	69.4	70.1	70.7	71.2	71.3	71.1	70.7	70.0	70.6	70.7	68.5	64.3	60.4	56.4		
Forecast Error %	-2.4%	-2.6%	-2.3%	-2.8%	-3.0%	-0.7%	-1.0%	-1.4%	-1.2%	-0.8%	-0.2%	-0.2%	-0.4%	-1.1%	-1.5%	-1.8%	-2.2%	-0.2%	0.5%	-0.1%	-0.4%	-1.8%	-2.1%			

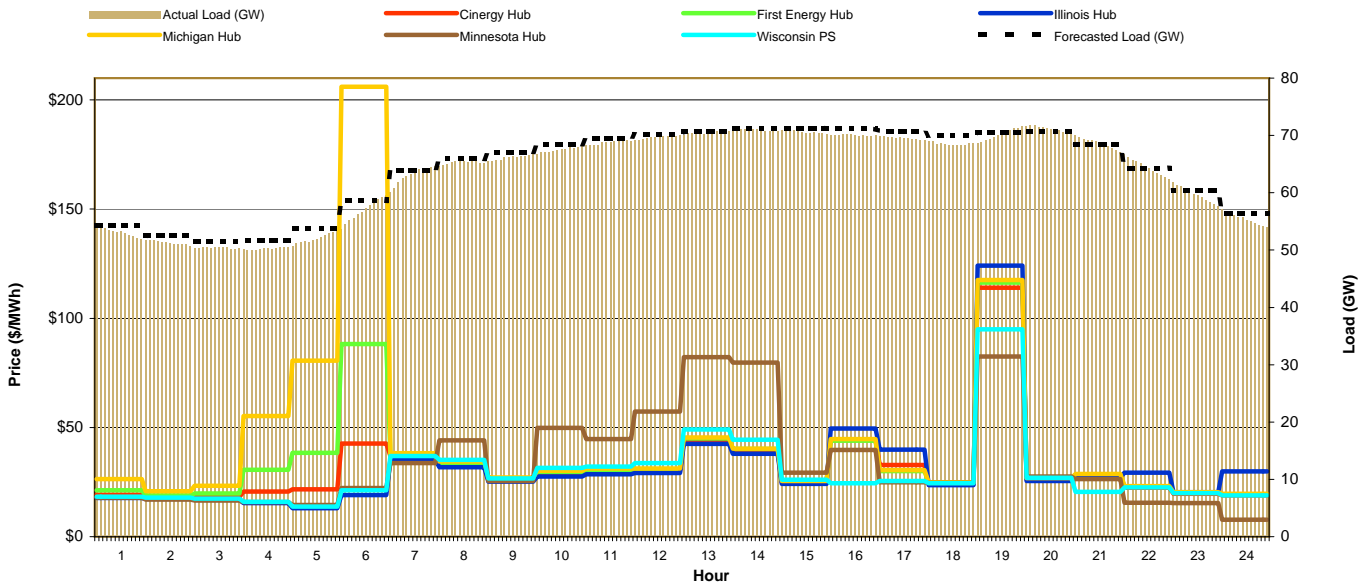




MISO Daily Report

Wednesday October 13, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	21.53	21.02	20.79	21.36	22.56	28.58	34.66	31.16	32.47	34.09	37.02	37.00	36.97	36.76	37.11	35.62	31.28	31.32	46.06	38.17	31.43	26.87	24.13	22.70	30.86	34.22
First Energy Hub	23.07	22.51	22.22	23.13	25.53	29.96	35.31	32.50	33.82	35.23	37.36	37.36	37.28	37.37	37.30	35.88	30.88	31.17	45.01	38.64	31.39	27.57	24.83	22.80	31.59	34.60
Illinois Hub	15.67	15.99	15.00	15.00	15.41	24.59	28.55	27.03	29.13	29.01	30.85	30.81	30.84	31.99	29.33	28.76	28.29	27.33	35.40	34.68	30.37	24.43	21.83	18.48	25.78	29.38
Michigan Hub	27.33	26.53	26.37	28.75	34.22	36.94	37.51	34.71	36.91	37.95	37.86	37.86	37.84	37.86	37.84	36.43	34.00	35.55	45.60	39.46	34.33	29.69	29.18	27.64	34.52	36.44
Minnesota Hub	9.01	5.39	4.32	4.54	8.41	19.66	32.06	34.32	35.97	33.95	35.96	36.33	34.09	36.47	34.62	31.78	29.95	29.14	39.72	37.66	31.68	27.17	21.80	16.12	26.26	33.16
Wisconsin PS	13.66	10.89	10.25	10.37	13.32	20.86	30.44	29.93	32.07	30.47	32.51	33.24	32.38	33.49	32.33	30.30	29.15	28.06	38.61	36.58	32.01	27.09	23.52	18.53	26.25	31.36
Cleared Load (GW)	49.6	49.0	48.3	49.2	51.9	58.8	65.7	65.6	66.7	67.3	67.6	68.1	68.2	67.3	66.8	66.2	66.0	68.6	67.5	65.6	61.3	57.1	5.3			

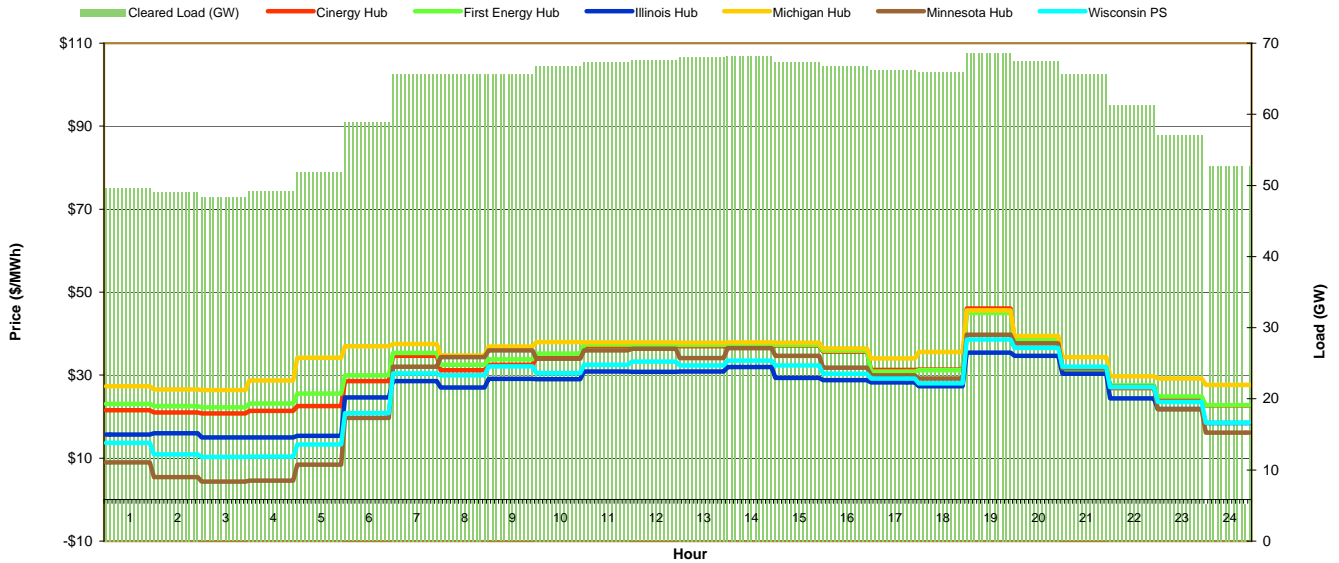

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	25.30	16.19	19.17	20.24	19.63	27.84	37.62	59.87	34.53	63.47	28.84	29.87	42.87	38.20	31.06	35.30	25.21	26.01	99.80	49.12	33.83	28.46	20.17	18.54	34.63	40.41
First Energy Hub	25.65	16.36	19.36	20.48	19.92	28.42	38.35	61.47	33.94	65.19	29.69	30.72	38.76	35.88	30.13	48.23	30.42	32.43	102.46	50.31	34.61	48.63	22.30	19.05	36.78	43.45
Illinois Hub	50.86	23.75	38.71	24.64	26.83	36.00	35.91	56.52	24.66	61.66	27.73	31.36	23.68	26.52	24.55	40.01	22.77	23.22	104.56	47.93	34.83	17.95	19.03	17.98	35.07	36.69
Michigan Hub	25.92	16.56	19.59	21.15	20.12	28.70	38.92	65.32	44.80	66.44	30.22	31.34	36.13	34.35	30.51	82.52	43.38	48.84	105.06	51.30	35.49	103.20	27.54	19.88	42.80	52.28
Minnesota Hub	-1.97	0.72	-3.66	6.76	7.84	19.51	31.91	71.95	28.42	60.76	27.99	28.64	25.50	26.22	23.13	19.56	21.81	22.33	95.02	48.36	33.59	22.30	19.34	17.65	27.24	35.93
Wisconsin PS	23.79	14.00	17.33	18.01	18.62	27.64	37.33	60.26	19.49	65.24	29.70	30.75	29.38	29.91	26.04	27.86	23.31	23.59	102.79	50.96	34.97	19.85	19.82	18.73	32.05	37.12
Forecasted Load (GW)	54.5	52.9	52.1	52.3	54.4	57.9	63.9	65.8	66.5	67.3	67.8	67.9	67.9	67.7	67.1	66.5	66.2	66.1	67.7	68.5	66.3	62.8	60.0	56.1		
Forecast Error %	-3.4%	-3.5%	-3.5%	-3.4%	-3.5%	-0.3%	-0.1%	0.1%	-0.5%	-0.3%	0.2%	0.7%	1.2%	1.4%	1.3%	0.3%	0.3%	0.2%	0.7%	0.3%	0.0%	-0.6%	-4.0%	-3.6%		

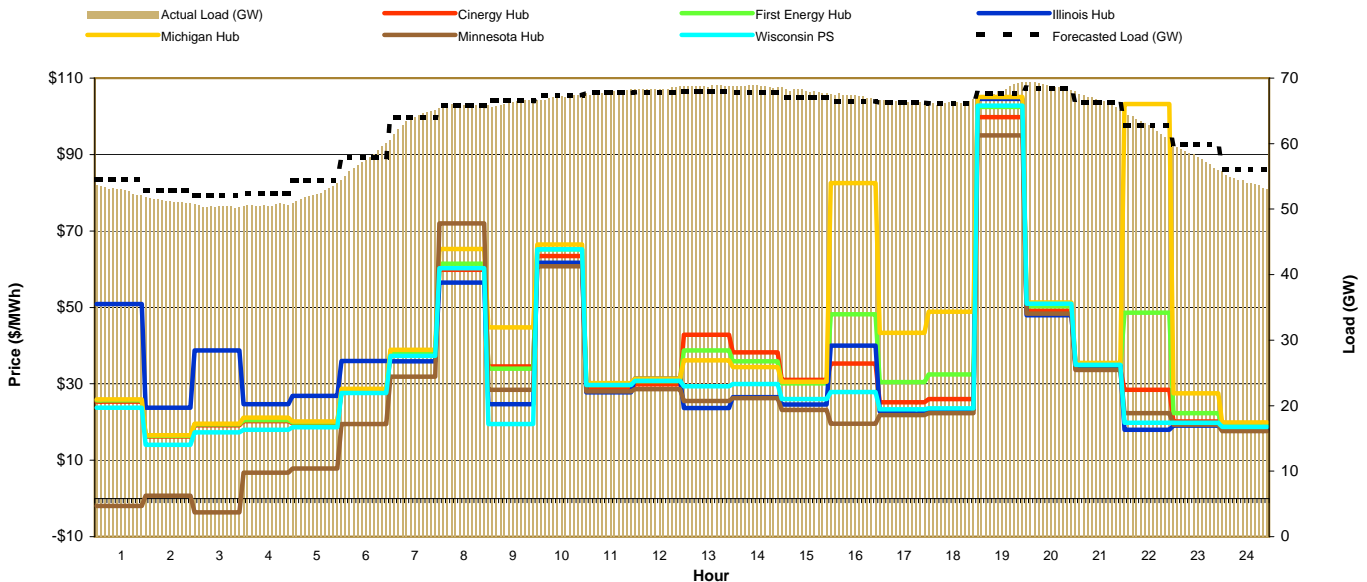




MISO Daily Report

Thursday October 14, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	20.42	20.03	20.23	21.24	22.35	29.11	35.75	30.58	30.88	30.88	30.60	30.68	30.18	29.30	27.05	26.73	25.90	26.54	32.68	29.69	26.18	23.88	22.50	20.67	26.84	28.39
First Energy Hub	21.89	21.47	21.54	22.43	23.56	30.75	36.45	32.29	32.36	32.15	32.25	33.02	32.80	32.32	30.27	29.31	27.79	28.95	34.44	32.28	28.08	25.14	24.30	22.55	26.88	30.48
Illinois Hub	18.61	18.29	18.26	19.12	19.97	24.68	30.54	29.67	29.20	31.82	34.07	33.61	33.64	30.40	25.88	25.66	25.14	25.46	32.14	28.81	25.63	23.22	20.42	18.74	25.96	28.42
Michigan Hub	25.07	24.78	24.59	25.20	26.15	34.48	38.97	35.19	35.43	33.64	34.50	37.24	37.85	38.54	37.28	34.58	31.20	33.84	36.84	37.30	31.38	26.89	28.08	26.69	32.32	34.36
Minnesota Hub	11.87	9.12	5.76	5.68	9.00	21.07	33.93	38.02	34.78	34.62	35.04	34.77	32.80	33.71	31.62	29.79	28.69	27.49	36.60	33.99	29.67	26.49	19.51	14.03	25.75	31.72
Wisconsin PS	14.97	13.37	11.20	11.33	13.69	22.64	32.10	31.24	30.33	31.04	31.82	31.56	30.49	29.80	27.30	26.37	25.83	25.60	33.55	30.32	26.87	24.23	20.75	17.36	24.74	28.57
Cleared Load (GW)	49.0	48.2	48.2	49.1	51.8	60.0	66.5	66.9	67.1	67.1	67.4	67.1	67.3	67.2	66.4	66.0	65.6	65.8	69.9	68.5	65.6	61.0	56.6	5.2		

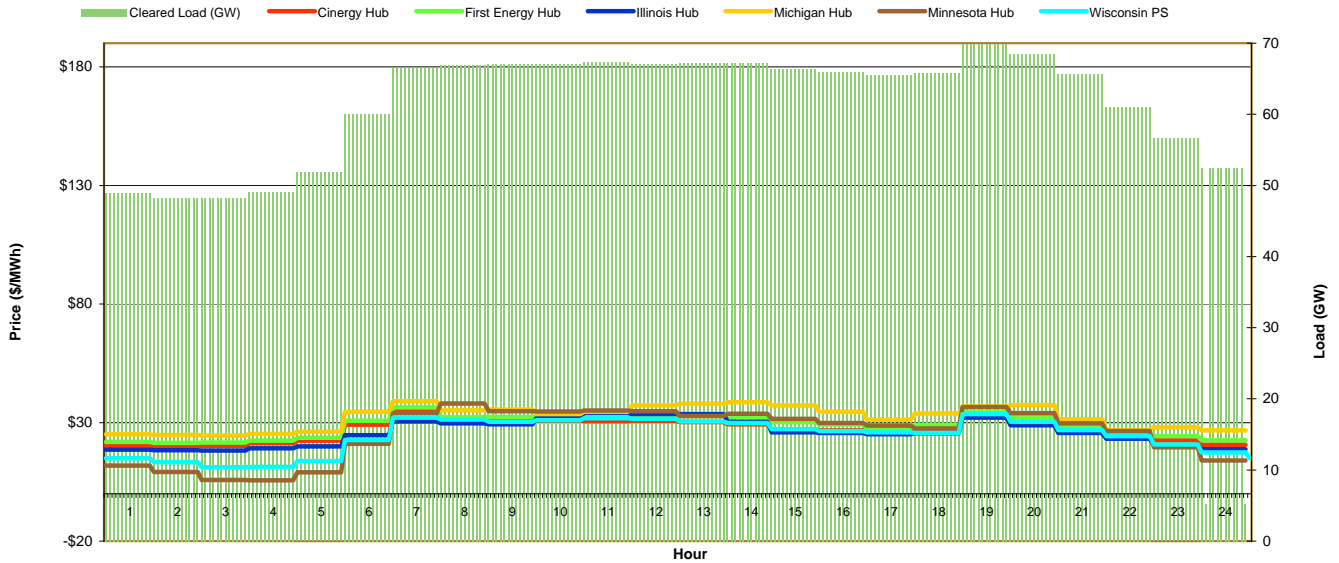

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	17.51	16.83	17.62	17.13	26.63	36.40	32.91	29.99	24.31	26.81	26.99	39.89	35.27	22.89	23.42	25.69	26.96	24.52	26.65	30.41	27.46	21.44	26.05	17.33	25.88	27.42
First Energy Hub	17.80	17.08	17.88	17.40	32.58	74.57	33.55	30.80	24.96	27.63	27.87	73.15	61.26	23.86	24.42	26.12	34.26	31.95	27.25	43.33	54.09	37.10	47.39	18.74	34.38	37.22
Illinois Hub	20.51	16.57	19.51	22.30	20.28	12.51	33.60	29.39	32.31	28.44	29.32	28.67	21.98	22.65	21.64	23.11	12.07	18.03	26.04	23.24	13.29	12.90	3.68	16.56	21.19	21.67
Michigan Hub	18.01	17.26	18.05	17.53	53.94	182.28	34.34	31.64	25.69	28.47	28.75	162.88	131.16	25.29	25.90	27.68	52.90	51.63	27.94	77.82	126.02	79.28	110.07	21.83	57.35	63.32
Minnesota Hub	14.12	15.73	14.67	11.73	7.87	15.66	23.62	22.75	29.86	27.12	30.02	26.78	27.55	28.80	24.08	4.18	16.65	19.29	26.43	26.77	18.57	16.67	9.81	15.74	19.77	22.21
Wisconsin PS	17.77	17.02	17.71	17.17	15.56	14.76	39.45	47.86	25.99	27.90	28.42	25.67	24.48	24.38	23.33	-16.09	12.47	19.36	27.86	25.88	16.12	14.81	8.31	17.02	20.55	21.05
Forecasted Load (GW)	54.1	52.7	52.0	52.4	54.5	59.3	64.5	66.0	66.1	66.8	67.3	67.5	67.4	67.2	66.6	66.0	65.6	65.6	67.6	68.6	66.6	63.0	59.5	55.7		
Forecast Error %	-4.1%	-4.2%	-4.3%	-4.4%	-4.7%	-3.4%	-1.0%	-0.3%	-0.2%	-0.4%	-0.3%	0.0%	-0.1%	-0.4%	-0.4%	-0.7%	-1.1%	-1.1%	-0.3%	-0.1%	-0.5%	-0.7%	-2.7%	-11.4%		

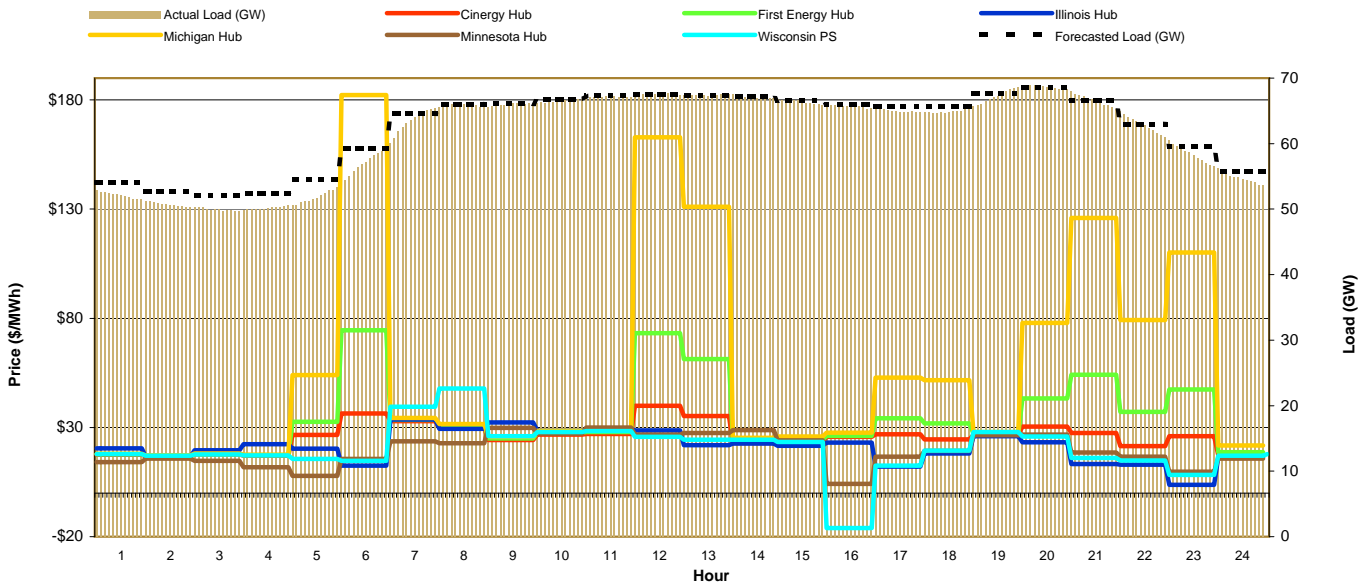




MISO Daily Report

Friday October 15, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$			
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk		
Cinergy Hub	19.57	18.68	18.82	19.39	21.42	26.92	34.99	33.94	34.04	35.57	37.75	36.02	34.00	33.00	30.15	29.39	28.34	28.73	35.19	31.34	31.42	29.52	23.11	23.21	28.94	31.97		
First Energy Hub	21.09	20.02	20.07	20.73	23.68	29.82	36.43	35.17	35.67	37.03	38.84	37.47	35.88	34.84	31.94	31.02	30.21	30.43	36.27	32.90	31.92	29.97	24.25	24.17	30.41	33.36		
Illinois Hub	18.07	17.47	17.56	17.78	18.43	23.49	34.50	35.35	35.02	38.09	40.97	38.06	34.42	33.40	30.49	25.64	28.23	27.40	34.37	29.85	26.57	26.45	21.61	20.59	28.08	31.62		
Michigan Hub	24.41	22.93	22.83	23.87	29.07	36.24	38.80	36.66	38.15	38.97	39.46	39.09	38.43	37.31	34.30	33.84	32.86	32.73	36.70	34.69	32.40	30.50	25.87	25.81	32.75	35.12		
Minnesota Hub	10.95	9.89	7.84	9.99	12.25	19.85	30.47	32.13	31.56	33.01	36.87	35.67	33.35	32.46	28.76	27.36	27.02	33.77	31.47	28.77	24.29	20.93	11.02	24.90	30.33			
Wisconsin PS	13.37	11.37	8.98	9.98	12.56	21.21	28.55	29.37	29.89	33.89	37.51	36.79	33.98	32.92	27.91	26.62	26.64	26.27	34.37	30.53	28.59	24.96	20.21	14.74	25.04	30.03		
Cleared Load (GW)	48.6	48.0	47.7	48.4	51.6	60.2	66.8	66.7	66.8	67.2	67.3	67.0	66.9	66.6	65.9	64.8	64.2	64.4	66.6	65.7	63.5	59.9	53.9	5.1				

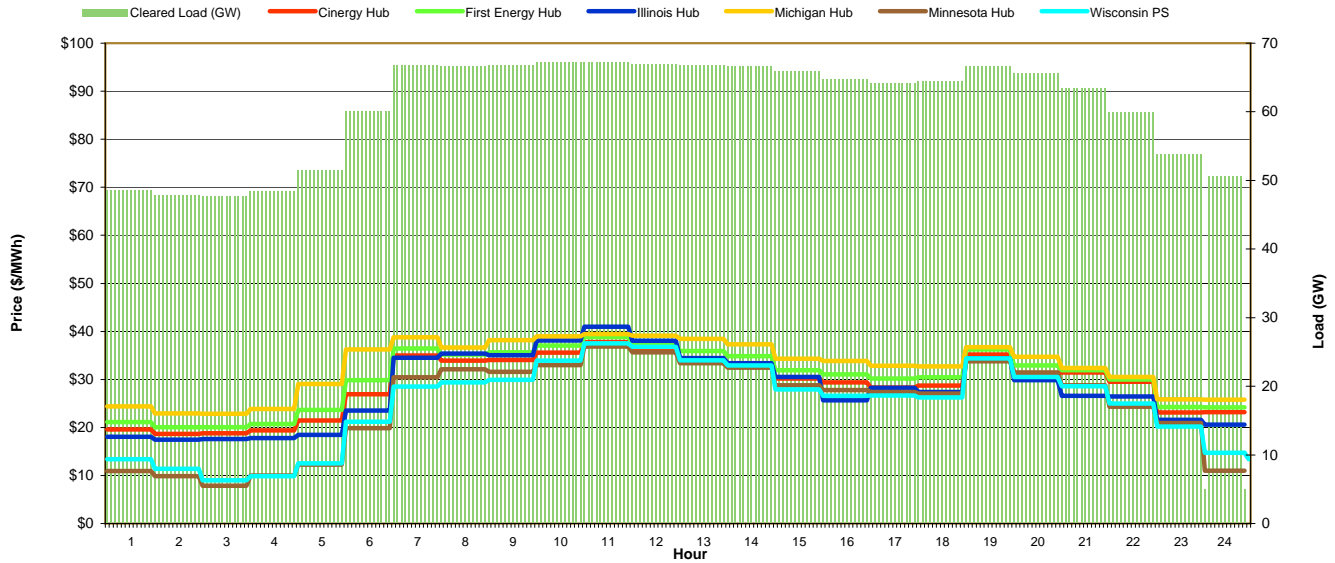

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$			
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk		
Cinergy Hub	17.64	37.05	26.94	26.90	44.09	37.38	58.73	43.33	25.59	25.72	26.65	30.33	35.65	26.70	25.86	37.26	27.71	22.31	77.26	45.79	25.46	19.62	20.61	20.52	32.71	32.24		
First Energy Hub	20.48	32.63	24.02	25.32	51.60	35.26	55.11	52.41	27.29	27.48	28.54	41.08	60.40	30.35	27.56	40.47	28.84	23.00	70.12	41.28	24.38	20.18	21.09	20.58	34.56	35.28		
Illinois Hub	16.03	4.52	9.31	13.59	8.50	23.31	35.02	52.07	25.99	26.19	27.35	42.30	65.16	29.04	26.28	15.05	19.89	21.66	69.21	36.85	21.96	19.01	21.25	20.69	27.09	32.45		
Michigan Hub	27.92	34.04	23.05	25.50	83.45	34.21	53.36	53.35	27.76	27.94	29.01	41.73	61.44	30.86	28.00	41.14	29.20	23.17	70.51	41.69	24.64	20.39	21.31	20.82	36.44	35.76		
Minnesota Hub	15.21	10.56	12.11	15.24	15.27	26.43	42.14	53.81	28.40	32.01	29.58	41.77	60.64	30.98	27.97	85.89	42.06	27.40	99.43	67.36	50.74	40.29	19.47	15.19	37.08	46.11		
Wisconsin PS	15.58	14.63	14.93	17.79	18.09	28.91	45.17	53.65	27.67	28.35	29.25	41.97	61.20	30.82	28.20	45.12	30.31	23.50	73.46	44.13	26.93	22.00	20.10	3.53	31.05	36.66		
Forecasted Load (GW)	53.8	52.4	51.6	51.9	53.1	57.2	63.1	65.1	65.6	66.2	66.4	66.3	65.9	65.5	64.6	63.8	63.1	62.5	63.6	64.4	63.0	60.2	56.3	53.8				
Forecast Error %	-3.2%	-3.0%	-3.1%	-2.9%	-1.4%	0.2%	-0.2%	0.0%	0.0%	0.3%	0.4%	0.3%	0.5%	0.5%	0.4%	0.2%	0.0%	0.0%	0.9%	0.5%	0.0%	-0.1%	0.4%	-11.5%				

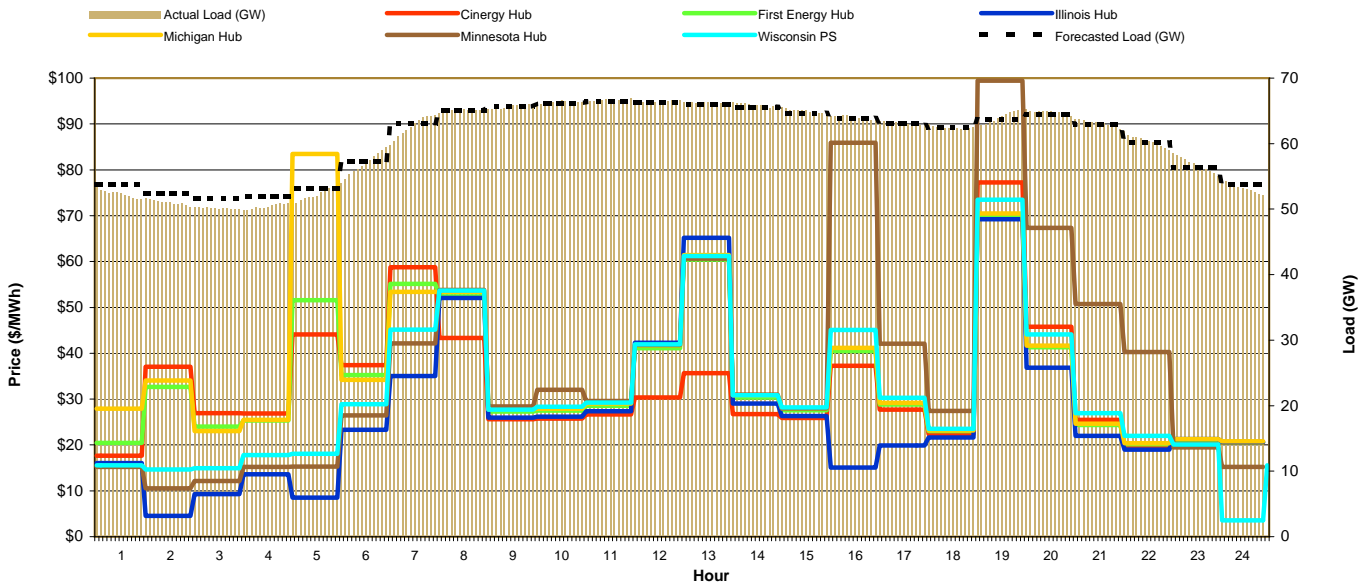




MISO Daily Report

Saturday October 16, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	22.50	20.32	19.07	19.57	19.65	22.68	25.69	26.79	28.32	28.57	27.99	26.25	25.62	25.18	24.79	24.90	25.24	26.52	37.00	28.73	25.23	23.76	20.10	18.40	24.70	26.56
First Energy Hub	24.44	22.50	22.44	21.58	21.72	24.51	27.28	28.29	30.19	30.29	30.04	28.58	28.15	27.36	26.76	26.67	27.31	29.19	37.53	30.49	27.65	26.30	22.66	22.05	26.83	28.59
Illinois Hub	15.94	14.78	12.24	13.55	13.60	16.78	23.98	22.03	24.56	25.84	24.83	25.00	24.40	24.01	23.69	23.75	24.04	24.64	35.66	26.42	24.26	22.54	18.00	16.53	21.71	24.60
Michigan Hub	24.33	23.32	24.97	26.18	27.69	30.10	30.46	32.00	34.43	33.96	34.46	33.15	33.21	31.63	30.58	30.01	31.26	34.45	38.19	33.99	32.29	31.26	28.37	30.05	30.85	32.70
Minnesota Hub	9.69	6.21	5.60	5.55	5.60	6.92	18.56	19.77	24.87	27.23	27.63	27.68	27.11	26.87	25.12	23.27	23.97	26.75	33.37	31.28	27.02	21.90	19.02	17.13	20.34	25.80
Wisconsin PS	11.24	9.90	9.35	9.33	9.82	12.01	18.92	20.05	23.28	24.59	24.71	24.17	23.20	22.81	21.78	21.40	22.18	23.57	29.19	29.16	25.42	21.70	18.44	16.31	19.69	23.48
Cleared Load (GW)	47.1	46.6	45.1	45.6	46.9	49.5	53.9	56.6	58.9	60.7	60.2	59.3	58.3	57.6	57.0	56.9	57.3	58.6	62.9	60.6	58.6	55.4	50.6	4.7		

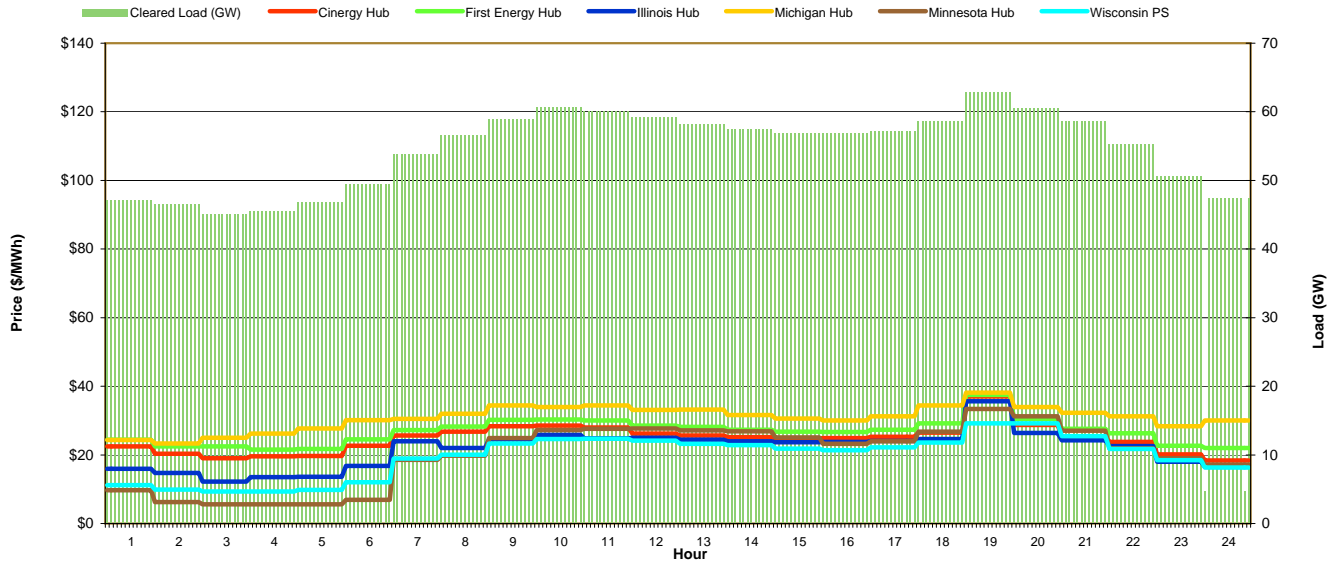

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	27.45	18.24	19.24	24.97	20.25	24.12	22.50	27.49	37.97	24.26	25.28	24.68	23.84	23.40	21.57	23.33	22.44	22.11	27.57	25.99	22.43	20.95	19.46	20.18	23.74	24.55
First Energy Hub	58.04	18.53	19.42	25.66	22.78	24.71	23.05	28.09	33.37	24.90	26.06	25.46	24.48	23.88	22.12	23.95	23.06	22.74	28.41	26.74	23.03	21.51	19.90	28.17	25.75	24.86
Illinois Hub	2.16	31.39	18.51	4.42	16.48	19.10	18.13	21.64	26.29	23.34	23.42	21.66	21.95	21.09	20.52	21.55	20.20	20.32	26.43	24.57	21.44	20.11	19.17	17.26	20.05	22.11
Michigan Hub	132.02	18.70	19.67	28.12	28.15	25.41	23.61	28.92	34.24	25.37	26.58	26.00	24.91	24.33	22.41	24.32	23.42	23.07	28.79	27.14	23.32	21.70	20.02	45.18	30.23	25.28
Minnesota Hub	8.02	5.59	15.20	4.52	13.32	11.27	16.41	19.84	28.89	27.93	39.45	23.17	21.60	20.63	15.24	17.64	19.40	19.58	25.99	24.61	17.31	16.08	11.74	8.67	18.00	21.82
Wisconsin PS	10.20	16.15	16.28	1.60	14.00	16.67	17.36	21.07	28.79	24.80	25.98	22.45	22.73	21.67	20.32	21.50	20.53	20.72	27.38	25.79	21.59	20.12	18.22	15.44	19.64	22.73
Forecasted Load (GW)	52.0	50.6	49.7	49.6	50.4	52.5	54.4	55.8	57.5	58.2	58.6	58.3	57.7	57.1	56.6	56.3	56.4	56.9	59.4	60.6	59.3	56.8	53.4	51.2		
Forecast Error %	-2.3%	-2.5%	-2.6%	-3.0%	-2.8%	-2.5%	-0.9%	0.2%	0.3%	1.3%	0.9%	0.8%	0.7%	0.5%	0.6%	1.0%	1.2%	0.7%	0.7%	-0.1%	-0.6%	-0.6%	-0.8%	-2.5%		

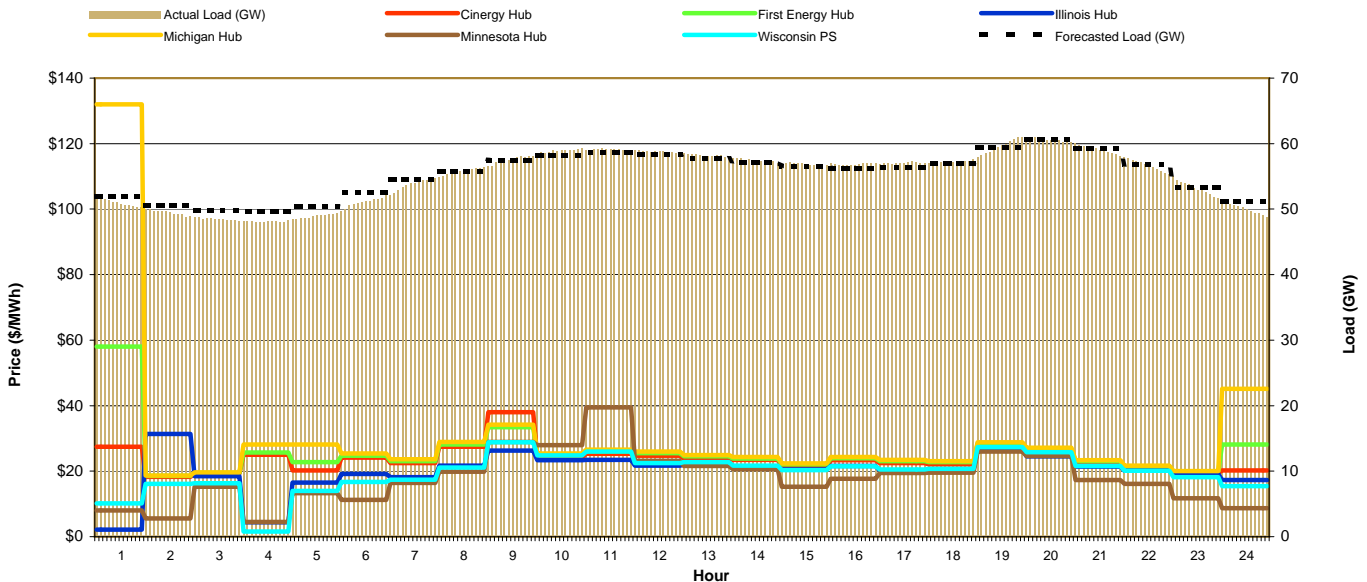




MISO Daily Report

Sunday October 17, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	20.05	19.25	18.64	18.53	18.56	20.05	23.33	23.89	24.82	25.24	25.99	26.28	26.08	25.79	25.92	26.97	27.83	31.25	43.79	38.20	31.77	26.29	22.26	20.80	25.48	28.27
First Energy Hub	21.65	21.43	21.34	21.39	21.59	23.25	26.11	25.10	25.52	26.05	26.55	26.64	26.39	26.12	26.13	27.10	27.16	29.45	44.13	37.97	31.71	26.80	23.44	22.11	26.46	28.52
Illinois Hub	13.76	14.15	12.86	12.49	12.20	13.45	19.12	21.75	24.00	24.84	23.08	23.32	23.28	23.27	23.28	23.99	24.97	26.70	41.64	31.45	27.16	24.15	17.44	16.98	21.64	25.27
Michigan Hub	26.92	25.52	24.29	23.25	23.12	24.61	27.55	25.07	26.58	27.20	27.75	27.46	27.06	26.78	26.57	27.44	28.65	31.78	44.48	38.27	31.95	27.86	27.67	26.27	28.09	29.54
Minnesota Hub	15.11	13.34	12.71	13.40	14.32	15.95	18.64	20.19	23.97	25.66	26.39	26.71	25.97	25.93	25.17	26.20	27.13	30.38	46.23	42.80	36.33	30.08	21.38	17.70	24.24	28.78
Wisconsin PS	14.77	12.26	9.39	10.81	12.88	15.87	19.18	20.54	22.65	24.26	25.46	25.82	25.80	25.37	24.47	25.52	26.28	27.94	44.92	38.96	32.60	26.71	19.99	17.76	22.92	27.33
Cleared Load (GW)	46.0	44.8	43.9	43.9	44.5	46.0	49.7	51.3	53.8	55.4	56.0	56.1	56.0	56.0	55.5	56.0	56.5	58.3	61.5	61.4	60.0	57.2	52.5	4.9		

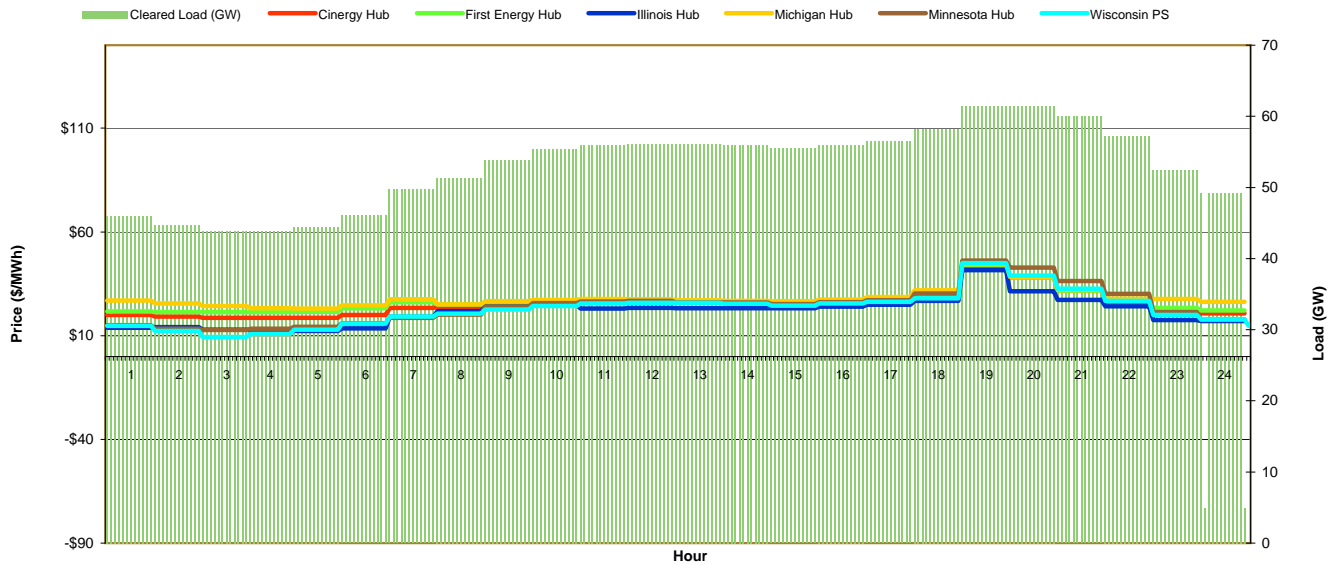

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	19.29	22.60	20.12	20.30	19.38	25.34	25.94	22.41	24.85	25.14	23.47	22.74	23.37	23.08	23.16	22.66	24.56	23.15	31.59	24.49	22.46	19.65	26.40	16.32	23.02	23.95
First Energy Hub	30.11	33.08	20.60	20.72	19.77	79.85	45.14	22.84	25.42	25.61	23.90	23.06	23.69	23.38	23.43	22.90	24.85	23.48	32.14	24.95	22.88	19.97	58.82	16.52	28.63	26.33
Illinois Hub	14.78	2.64	12.17	14.74	15.10	5.20	16.90	19.24	21.02	23.90	22.59	21.96	22.62	22.28	22.25	21.85	23.47	22.27	30.27	23.74	21.74	19.02	10.09	15.81	18.57	21.77
Michigan Hub	53.59	56.17	21.23	21.13	20.07	-88.66	87.61	23.11	25.83	25.90	24.19	23.33	23.96	23.66	23.67	23.12	25.14	23.74	32.42	25.21	23.15	20.23	145.41	16.73	29.16	32.00
Minnesota Hub	4.80	-8.29	3.72	8.17	9.41	0.00	19.79	19.80	21.77	24.71	23.35	22.90	23.63	23.32	23.27	22.43	24.40	23.01	31.81	25.15	22.63	19.15	14.02	15.41	17.43	22.83
Wisconsin PS	13.01	-4.86	9.13	12.65	13.47	-0.17	17.81	19.55	21.29	24.66	23.26	22.61	23.29	23.00	23.04	22.42	24.35	23.11	32.08	25.00	22.72	19.61	10.14	16.25	18.22	22.51
Forecasted Load (GW)	49.0	48.1	47.3	46.9	47.4	49.0	51.2	52.3	53.0	54.0	54.7	55.4	55.8	55.8	55.8	56.0	56.6	57.6	60.5	62.2	60.6	57.6	54.0	52.3		
Forecast Error %	-2.4%	-3.7%	-3.9%	-3.4%	-3.6%	-4.4%	-4.8%	-3.8%	-0.9%	0.1%	0.4%	0.2%	-0.2%	-0.4%	-0.6%	-0.6%	-0.3%	0.1%	1.2%	-0.1%	-0.7%	-1.1%	-0.8%	-12.7%		

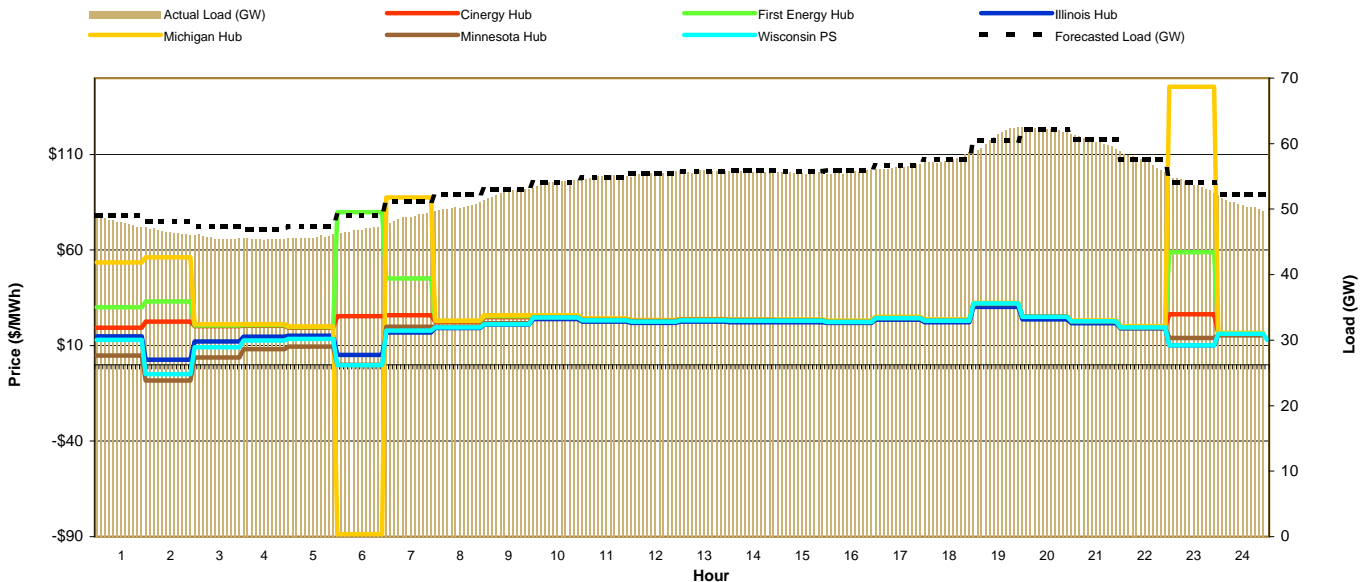




MISO Daily Report

Monday October 18, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$	
																									All	On Pk
Cinergy Hub	21.48	21.31	21.34	21.59	25.40	32.13	42.56	34.44	35.68	38.69	40.90	38.74	38.43	36.04	33.03	30.26	30.38	31.48	40.96	34.79	29.00	24.90	22.61	21.57	31.15	33.77
First Energy Hub	22.10	21.92	21.59	21.69	25.03	31.98	41.40	34.79	35.52	37.37	39.25	37.41	37.26	35.53	30.92	30.05	30.21	31.71	41.70	35.73	30.99	25.97	23.84	22.68	31.11	33.64
Illinois Hub	13.24	13.58	13.67	14.31	15.45	20.23	26.84	26.45	28.86	28.44	30.85	27.35	27.21	26.74	25.99	24.89	25.43	31.25	42.91	35.14	28.11	24.47	24.17	21.80	24.89	28.64
Michigan Hub	26.21	25.74	24.53	24.13	27.73	35.72	41.82	37.92	37.25	37.74	39.62	37.76	37.62	36.84	34.13	35.31	36.30	37.22	42.03	36.78	35.11	30.14	27.63	28.24	33.90	36.21
Minnesota Hub	11.14	11.15	10.94	11.01	13.87	21.45	28.90	35.71	34.50	35.65	38.28	36.36	33.51	32.59	30.01	28.89	28.94	30.62	43.04	36.41	30.49	27.13	21.34	17.33	27.05	32.72
Wisconsin PS	13.11	13.74	13.53	13.76	16.34	23.21	28.10	32.43	33.27	32.47	37.22	35.78	32.70	32.22	28.63	28.20	27.86	28.86	42.34	35.88	29.29	25.42	21.96	19.10	26.89	31.53
Cleared Load (GW)	47.6	47.3	47.2	47.5	51.1	60.7	66.8	66.6	66.9	67.6	68.1	68.5	68.2	67.6	66.7	66.2	66.2	67.4	70.8	68.9	66.8	62.7	58.4	5.4		

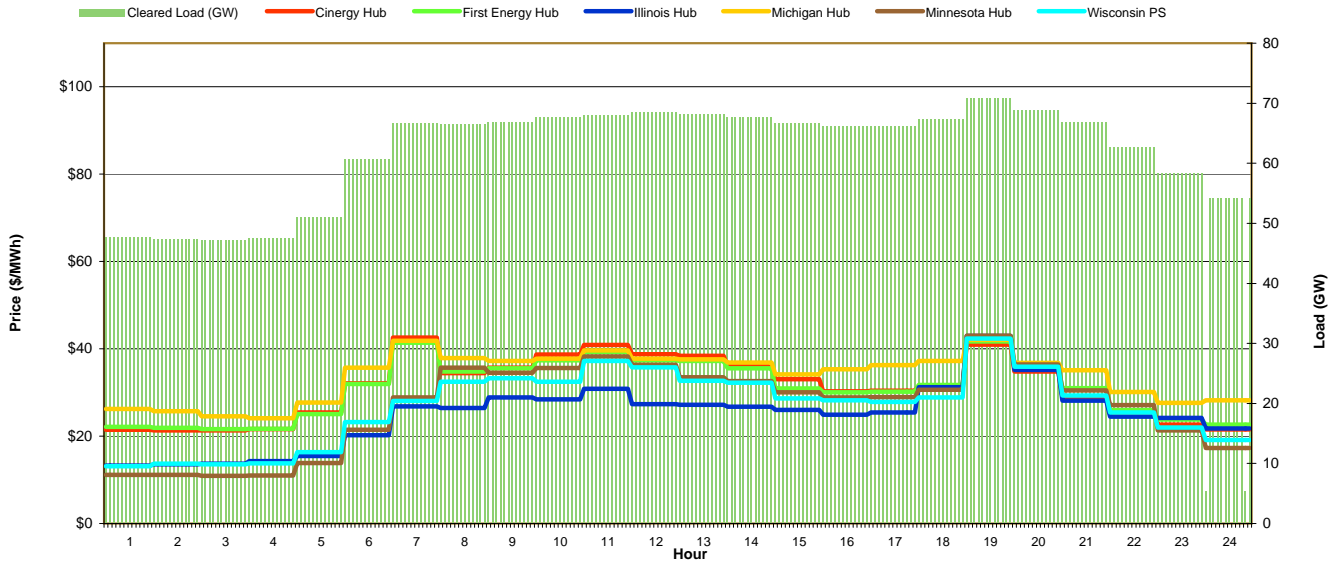

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$	
																									All	On Pk
Cinergy Hub	15.53	14.63	17.12	17.72	16.10	20.82	25.82	38.75	66.17	43.21	26.96	28.67	56.32	33.44	31.37	62.18	57.73	54.17	108.92	52.56	29.78	23.20	26.40	20.16	36.99	46.24
First Energy Hub	15.74	14.83	17.38	18.34	16.41	21.34	26.56	39.99	65.85	42.28	27.92	26.71	42.73	31.17	32.39	46.00	43.78	41.33	96.83	41.93	28.11	23.84	48.87	21.99	34.68	42.48
Illinois Hub	15.04	14.16	22.09	20.35	16.63	21.35	25.07	37.75	61.40	37.44	25.83	22.27	21.27	25.37	29.04	20.48	21.97	19.62	74.96	27.35	23.87	21.44	16.89	19.30	26.71	30.43
Michigan Hub	15.92	15.00	17.57	19.54	16.60	21.67	27.14	40.97	67.87	43.16	30.61	27.27	61.44	35.38	39.61	72.49	63.36	64.57	99.03	42.36	28.85	28.81	109.48	25.60	42.26	53.45
Minnesota Hub	14.39	13.38	11.17	12.30	13.84	18.08	24.36	42.03	54.78	41.28	27.11	25.93	40.68	29.09	30.18	41.71	39.68	37.05	89.74	39.56	26.28	21.38	18.89	18.14	30.46	37.84
Wisconsin PS	15.44	14.52	16.70	16.58	16.01	20.83	26.22	40.44	61.80	42.31	25.75	26.52	24.23	26.93	25.14	19.82	24.20	17.35	93.59	40.76	27.13	18.99	14.49	19.68	28.14	33.09
Forecasted Load (GW)	50.6	49.8	49.6	50.3	51.8	57.5	63.6	65.6	66.0	66.6	67.0	67.1	67.2	66.9	66.3	65.6	65.1	65.1	67.7	68.4	66.3	62.6	58.4	56.0		
Forecast Error %	-3.7%	-4.2%	-4.4%	-4.1%	-2.1%	-0.9%	0.0%	-0.2%	0.2%	0.2%	0.2%	0.2%	0.3%	0.2%	0.2%	0.3%	0.5%	1.3%	1.1%	0.6%	0.0%	-0.1%	-0.8%	-3.3%		

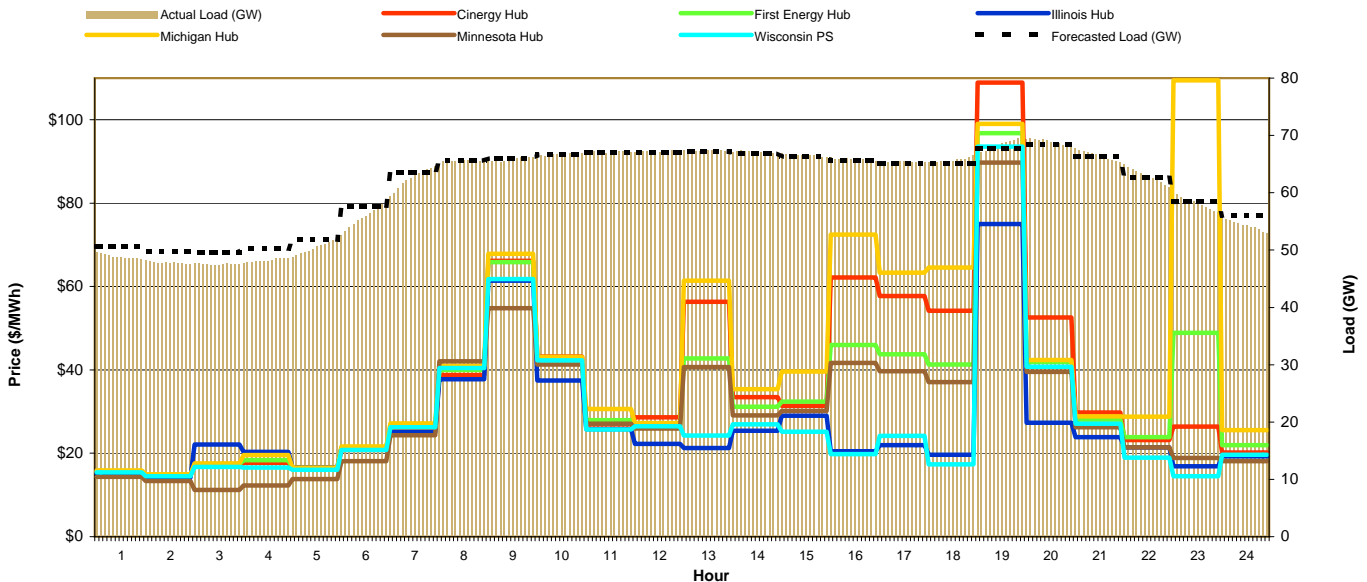




MISO Daily Report

Tuesday October 19, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	18.87	18.51	18.51	18.94	22.09	28.80	39.16	32.34	31.03	32.51	32.74	30.76	30.90	30.83	28.90	28.25	27.51	28.92	36.99	32.50	29.49	25.39	23.07	20.62	27.82	30.13
First Energy Hub	21.41	20.72	20.56	21.14	24.31	31.46	40.39	33.98	32.90	34.12	34.77	32.71	32.78	32.65	30.79	30.18	29.41	30.63	38.04	34.39	30.54	26.68	24.12	21.92	29.61	31.79
Illinois Hub	16.30	16.14	16.13	16.27	17.33	25.06	35.02	31.56	30.04	31.38	31.48	29.62	29.95	30.04	27.94	26.97	26.38	28.05	36.22	31.56	28.68	24.51	22.20	19.16	26.17	29.16
Michigan Hub	27.84	26.30	25.78	26.78	30.60	37.76	43.12	36.90	36.44	36.96	38.61	36.35	36.31	36.05	34.36	33.93	32.94	33.65	39.02	37.67	33.71	32.15	27.67	24.81	33.57	35.17
Minnesota Hub	15.16	14.25	13.92	14.52	15.12	20.46	29.85	36.75	33.83	34.50	34.58	34.09	32.05	29.73	27.24	26.40	26.62	27.43	39.61	33.47	30.17	26.34	20.85	16.20	26.38	30.85
Wisconsin PS	17.03	16.30	16.08	16.65	17.99	23.73	32.76	34.70	32.49	34.01	34.30	32.72	32.26	31.56	28.16	27.20	27.16	27.45	39.11	33.65	30.55	26.18	21.64	18.12	27.16	30.82
Cleared Load (GW)	49.6	49.0	48.5	49.3	52.8	61.5	66.8	66.9	66.8	67.6	67.7	67.5	67.4	67.3	66.4	65.7	65.3	66.5	69.4	68.1	66.4	61.9	57.2	5.3		

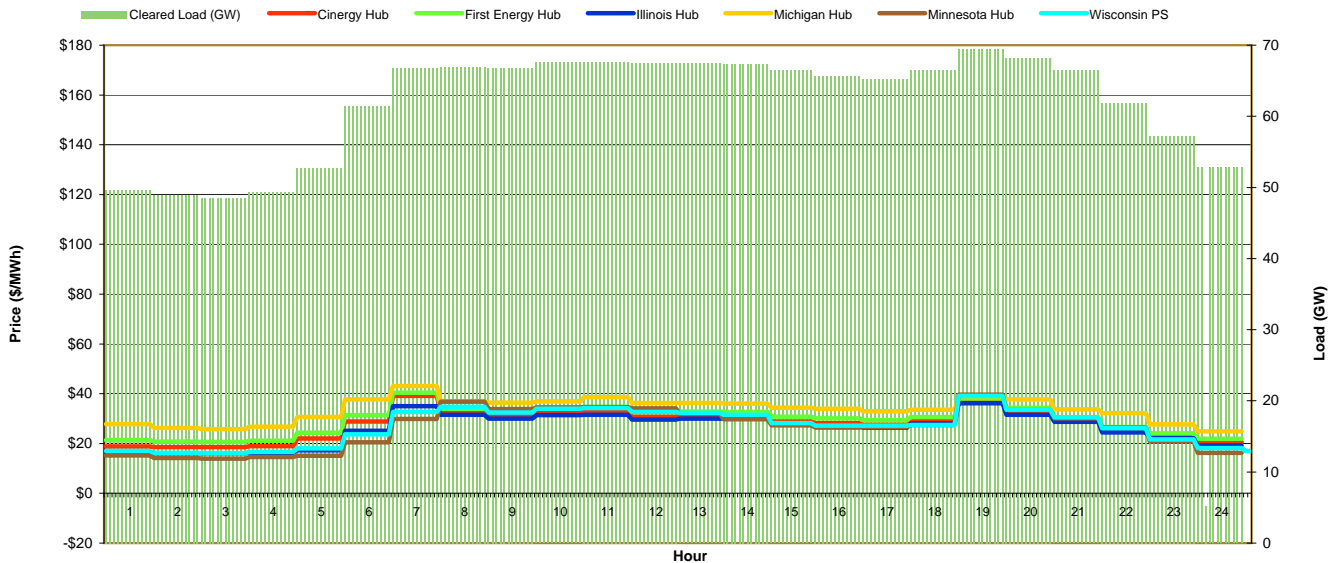

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	19.10	19.16	19.40	20.28	17.48	36.15	90.34	28.83	25.44	24.96	25.88	24.07	23.97	27.58	33.68	23.33	32.76	26.05	32.40	39.28	24.39	22.52	18.74	18.38	28.09	27.12
First Energy Hub	19.52	19.53	19.78	20.69	17.85	36.50	89.70	29.89	26.43	25.97	26.89	25.01	24.91	38.62	75.13	28.02	70.48	38.59	33.80	31.21	25.62	23.54	19.33	30.32	33.22	33.97
Illinois Hub	16.52	18.53	19.77	16.69	12.12	28.36	77.51	27.71	24.60	23.85	24.83	22.72	22.83	22.95	18.22	20.68	18.58	21.30	30.86	19.37	23.53	21.84	18.18	16.22	23.66	22.63
Michigan Hub	29.53	30.66	31.74	42.42	44.21	60.03	113.63	31.30	26.89	26.36	27.26	25.29	25.88	65.23	178.07	38.45	163.57	68.32	34.54	31.96	26.83	24.65	19.70	59.82	51.10	50.89
Minnesota Hub	17.14	15.31	14.44	16.12	14.21	20.22	54.40	19.04	25.08	24.06	24.05	23.00	22.96	23.81	23.18	21.21	22.85	22.53	31.15	28.50	23.07	21.29	16.44	-1.26	21.78	23.26
Wisconsin PS	9.58	8.44	7.85	-1.04	-9.73	11.42	59.92	28.76	25.88	25.15	26.12	24.34	21.82	21.24	20.28	21.97	22.43	23.28	32.72	29.97	24.36	22.77	18.33	8.28	20.17	24.34
Forecasted Load (GW)	53.2	52.9	52.2	52.6	54.0	58.5	65.0	66.6	66.6	67.0	67.2	67.3	67.3	66.9	66.2	65.6	65.2	65.5	67.8	68.3	66.4	62.8	58.4	54.9		
Forecast Error %	-10.6%	-4.5%	-4.1%	-3.6%	-2.0%	0.0%	0.1%	0.3%	0.3%	-0.3%	-0.4%	-0.7%	-0.6%	-0.7%	-1.1%	-1.2%	-1.0%	0.7%	0.5%	0.1%	-0.3%	-0.3%	-9.7%			

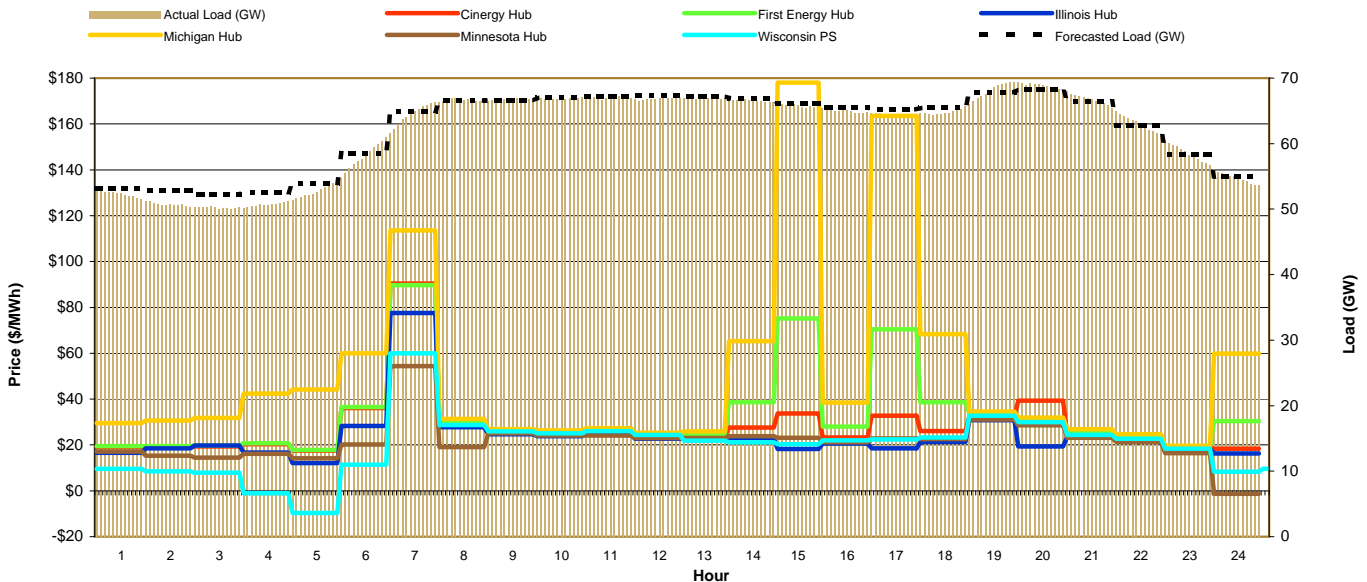




MISO Daily Report

Wednesday October 20, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
																									All	On Pk		
Cinergy Hub	20.81	20.96	21.45	21.85	23.02	29.58	41.62	34.00	33.07	33.86	32.00	31.56	31.40	30.21	30.00	28.91	27.93	29.58	41.47	32.96	27.82	24.64	23.19	22.62	28.94	30.79		
First Energy Hub	22.60	22.39	22.58	23.23	25.97	32.91	43.17	35.77	34.61	35.32	33.73	33.14	32.94	31.99	31.87	30.58	29.87	41.05	43.07	34.93	30.03	26.64	25.21	24.06	31.15	33.17		
Illinois Hub	17.70	18.05	18.12	17.69	19.14	25.34	31.48	29.58	30.52	31.22	30.92	30.00	29.03	27.80	26.81	25.97	26.26	27.19	39.71	31.74	26.58	23.44	21.56	20.92	26.12	28.65		
Michigan Hub	29.71	28.21	27.85	28.92	34.20	40.61	45.21	38.60	36.89	37.30	36.68	36.16	36.50	36.11	35.10	34.10	33.88	36.70	45.18	38.48	34.49	30.73	31.62	28.75	35.08	36.16		
Minnesota Hub	8.74	6.02	5.77	5.75	6.05	19.43	27.18	33.91	32.34	33.18	35.05	34.00	30.87	29.36	28.12	27.53	27.65	27.02	40.56	38.23	29.50	23.92	18.55	14.69	24.31	30.61		
Wisconsin PS	10.01	8.38	7.56	7.39	8.08	20.01	27.61	30.77	30.92	31.88	33.50	32.53	30.32	28.99	26.73	25.97	25.72	26.03	40.95	34.68	27.09	23.40	19.13	16.15	23.90	29.28		
Cleared Load (GW)	50.5	49.6	49.5	50.0	53.3	61.4	68.0	68.1	67.8	68.1	68.1	67.7	67.7	67.7	67.0	66.4	65.7	67.2	70.9	68.5	66.5	62.0	57.1	5.3				

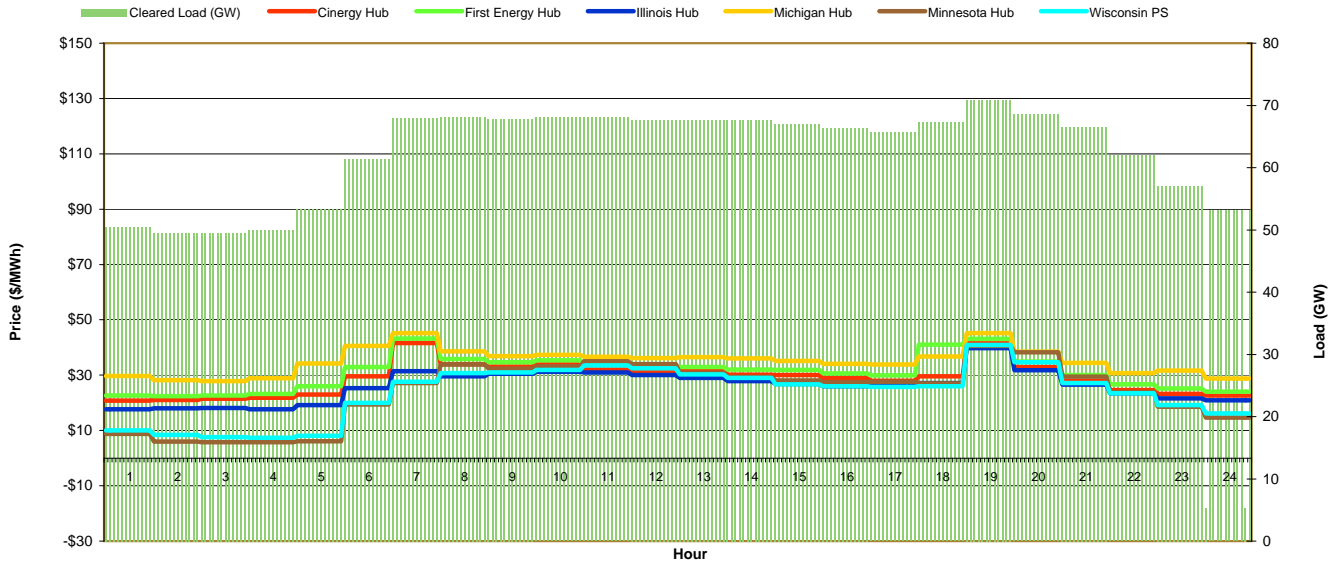

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
																									All	On Pk		
Cinergy Hub	21.91	23.82	20.26	25.15	-3.16	28.59	73.52	27.08	36.08	57.25	37.48	23.46	22.06	23.02	23.61	28.25	31.92	22.65	28.31	26.58	25.13	23.70	20.38	10.85	27.41	28.56		
First Energy Hub	31.67	25.25	21.57	58.32	-3.37	29.89	58.01	27.07	37.69	59.80	39.11	24.49	23.02	23.94	24.48	40.32	63.51	23.48	29.22	27.65	26.10	24.56	29.39	25.23	32.10	32.74		
Illinois Hub	20.81	12.55	6.85	-0.24	3.75	18.64	16.99	23.80	34.50	54.88	36.09	22.62	21.13	22.79	22.68	23.16	19.81	21.74	26.16	25.55	24.23	23.07	16.68	5.43	20.99	26.18		
Michigan Hub	57.99	27.57	23.49	140.58	-3.44	30.78	59.42	27.40	38.17	60.59	39.59	24.85	23.47	24.43	24.95	67.06	134.85	24.08	29.94	28.39	26.74	25.12	49.58	58.86	43.52	40.58		
Minnesota Hub	-20.66	7.50	4.08	1.49	-12.03	15.84	38.38	25.31	35.14	56.90	37.53	36.34	25.85	24.69	20.09	17.24	18.68	21.31	26.80	23.58	20.56	17.86	13.45	6.73	19.28	26.33		
Wisconsin PS	1.72	9.16	3.52	-2.11	-4.34	17.25	44.91	26.70	36.87	58.88	38.79	25.58	24.55	26.71	23.48	23.83	23.03	23.83	28.52	26.69	24.28	22.85	16.73	6.36	21.99	28.21		
Forecasted Load (GW)	54.1	52.8	52.2	52.6	54.1	58.5	64.9	66.2	66.3	66.8	67.0	67.0	66.9	66.6	65.8	65.2	64.9	65.1	67.5	68.2	66.0	62.4	59.7	56.2				
Forecast Error %	-3.0%	-2.9%	-3.0%	-2.9%	-1.4%	0.9%	1.1%	1.4%	1.0%	0.5%	0.5%	0.4%	0.4%	0.6%	0.8%	0.7%	0.6%	0.6%	1.4%	0.8%	0.8%	0.6%	-2.4%	-3.0%				

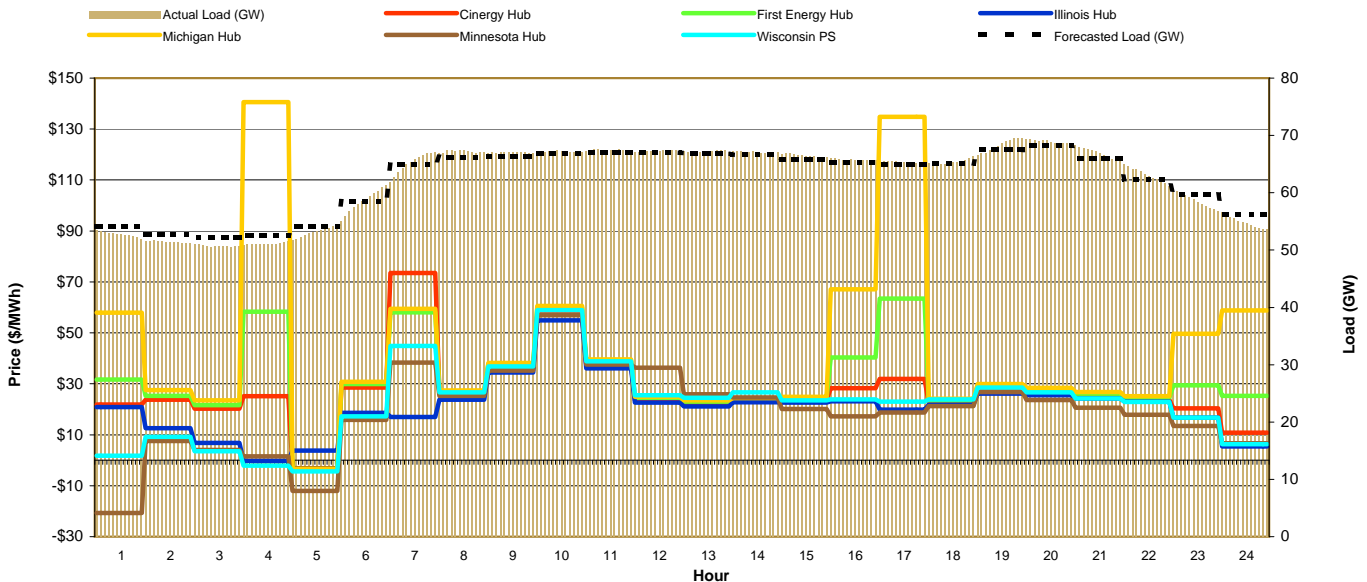




MISO Daily Report

Thursday October 21, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	19.89	19.73	19.78	20.27	23.89	29.50	42.75	32.55	32.47	34.47	35.15	31.91	31.77	31.70	30.34	30.09	29.61	32.00	45.28	37.61	31.66	26.34	23.02	22.66	29.77	32.25
First Energy Hub	21.86	21.39	21.34	21.80	25.37	31.88	43.00	33.34	33.38	35.21	36.26	33.35	33.32	33.03	31.93	31.61	31.64	41.05	45.66	37.51	32.37	28.11	24.75	24.03	31.38	33.91
Illinois Hub	15.57	15.00	15.00	15.00	16.69	23.92	27.93	28.58	28.72	31.08	32.88	28.54	28.46	28.23	27.30	26.63	27.17	29.65	45.90	33.81	30.46	24.84	21.86	20.75	26.00	29.63
Michigan Hub	27.20	26.32	26.07	26.69	30.90	39.17	46.25	37.02	37.03	37.86	37.72	37.00	37.26	36.92	36.10	36.55	36.56	37.79	46.81	38.47	33.17	31.69	28.41	27.59	34.86	36.65
Minnesota Hub	8.25	8.56	9.27	10.00	12.96	20.58	31.42	30.95	30.81	33.34	34.81	32.08	29.53	29.74	27.47	25.90	25.96	27.64	44.03	41.01	31.37	25.93	21.01	17.54	25.42	30.72
Wisconsin PS	12.71	11.65	11.61	11.72	13.94	22.88	34.18	32.11	32.20	34.66	36.47	32.76	31.87	31.60	30.18	27.65	27.53	29.58	46.39	39.71	32.94	26.84	22.81	17.98	27.16	32.20
Cleared Load (GW)	49.6	49.0	48.6	49.0	52.1	61.0	68.0	68.0	67.6	68.1	68.0	68.0	68.0	67.4	66.5	65.9	65.7	67.0	69.9	68.5	66.7	62.5	57.5	5.3		

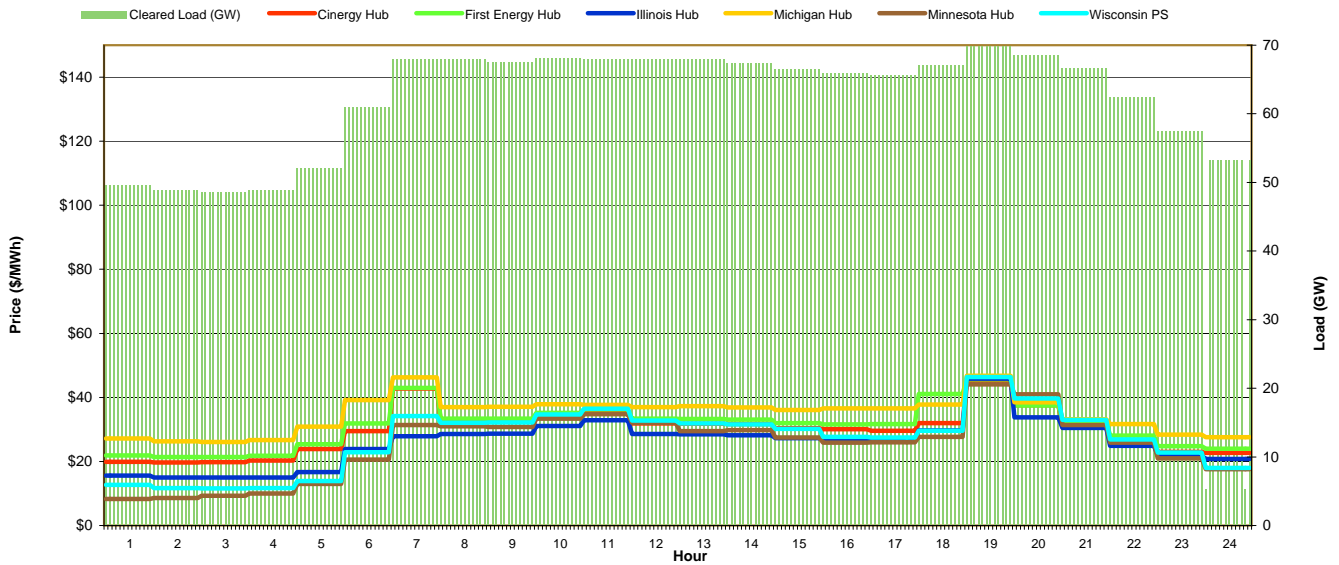

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	17.50	18.39	17.62	15.86	31.62	59.97	22.81	25.41	27.68	25.61	26.31	30.70	28.50	26.38	24.92	25.05	25.10	24.44	51.47	30.14	27.80	26.59	20.89	19.72	27.10	27.94
First Energy Hub	17.65	18.69	17.97	16.13	25.03	48.00	23.45	27.02	41.04	26.67	27.53	27.57	27.33	27.32	25.88	26.06	26.04	25.42	53.73	33.12	29.06	27.48	21.53	20.25	27.50	29.55
Illinois Hub	15.73	16.43	18.85	15.29	3.18	7.29	21.01	24.03	21.91	24.43	24.98	20.49	22.29	24.78	23.70	23.84	24.06	23.43	49.15	25.39	26.26	25.76	20.25	18.93	21.73	25.30
Michigan Hub	17.72	19.28	18.14	16.26	19.29	37.70	23.78	28.98	70.58	27.28	28.22	28.07	27.79	27.83	26.44	26.66	26.68	26.03	55.10	34.44	29.86	28.18	22.02	20.63	28.62	32.14
Minnesota Hub	15.33	13.53	9.71	7.93	10.00	19.51	21.31	25.36	25.65	26.28	36.13	26.63	26.27	26.39	25.11	25.07	25.34	27.15	86.66	143.90	55.76	27.87	21.06	18.98	31.12	39.41
Wisconsin PS	16.93	16.76	16.66	13.39	12.73	24.81	22.52	25.91	24.32	26.27	27.13	27.03	26.72	26.91	25.54	25.30	25.47	25.01	53.89	56.01	28.99	28.00	21.86	20.28	25.77	29.64
Forecasted Load (GW)	54.0	52.8	52.2	52.5	53.8	58.5	65.0	66.7	66.9	67.2	67.5	67.5	67.5	67.1	66.4	65.9	65.7	65.9	68.6	68.9	67.1	63.6	59.6	57.7		
Forecast Error %	-3.2%	-3.7%	-3.6%	-3.4%	-1.7%	-0.4%	-1.1%	-0.6%	-0.6%	-0.2%	-0.7%	-0.7%	-1.1%	-1.4%	-1.7%	-1.7%	-2.1%	-1.8%	-1.2%	-0.6%	-0.9%	-0.9%	-1.2%	-4.3%		

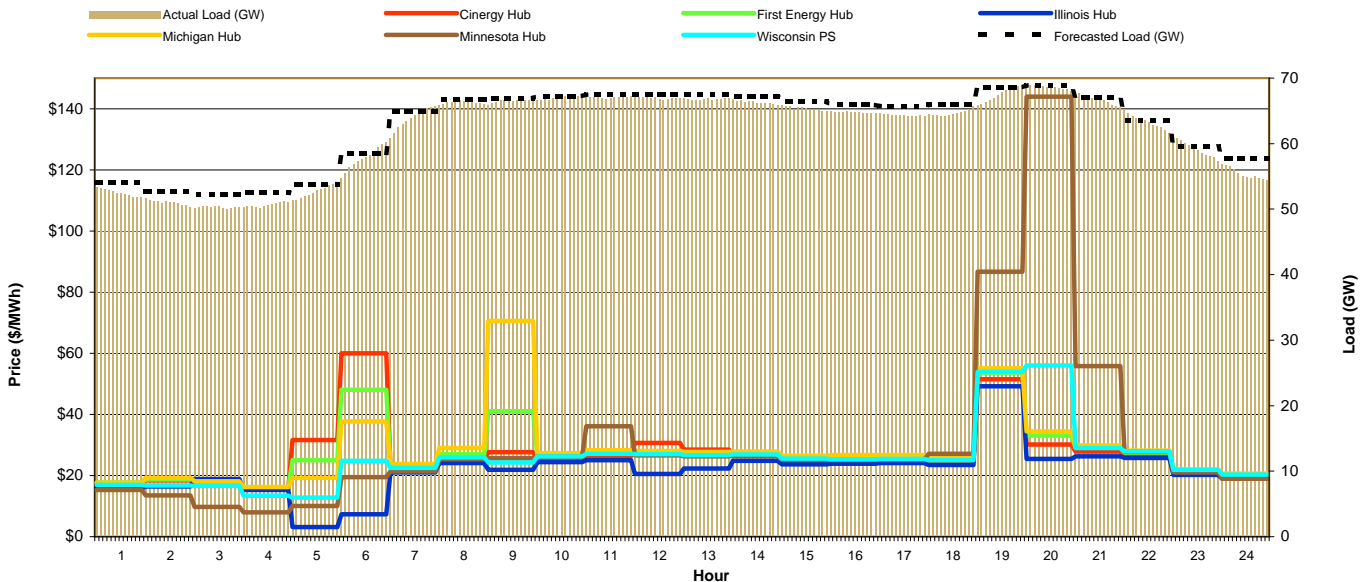




MISO Daily Report

Friday October 22, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	20.72	20.27	20.18	20.76	23.60	33.62	43.95	37.42	33.58	35.59	36.96	33.95	31.66	30.36	28.74	27.66	26.73	29.09	34.00	29.26	27.16	25.36	22.46	21.76	28.95	30.62
First Energy Hub	22.33	21.81	21.47	22.24	24.69	34.00	41.80	36.98	34.45	35.91	36.87	34.42	32.64	31.77	30.82	29.60	28.93	30.82	35.18	30.65	28.19	26.74	23.70	22.12	29.92	31.73
Illinois Hub	16.63	16.32	16.59	16.79	17.76	24.53	26.44	29.92	28.12	29.31	30.13	29.21	27.06	26.92	26.03	25.64	25.02	26.40	33.90	28.39	26.22	23.70	20.07	16.81	24.50	27.25
Michigan Hub	27.11	26.30	25.29	26.60	28.91	37.69	42.82	37.93	37.28	37.63	37.88	37.25	36.80	36.27	36.06	34.55	33.87	34.86	37.40	32.94	29.87	29.59	27.05	24.53	33.19	34.83
Minnesota Hub	16.38	12.61	11.21	10.33	13.14	22.87	32.30	39.14	35.03	37.39	38.42	36.01	33.00	30.67	28.37	27.27	27.13	28.96	35.40	31.63	29.22	26.77	21.54	16.09	26.70	31.62
Wisconsin PS	15.32	13.09	11.89	11.75	14.11	22.67	37.20	36.03	32.81	34.84	36.04	33.87	31.33	30.19	28.67	27.83	27.07	29.03	34.75	30.53	29.12	25.70	21.44	18.17	26.39	30.58
Cleared Load (GW)	50.8	50.5	49.9	50.8	53.6	61.8	68.2	67.3	67.6	67.8	67.8	66.9	67.0	66.6	65.1	64.7	64.0	65.6	67.5	66.1	63.9	60.3	55.6	5.1		

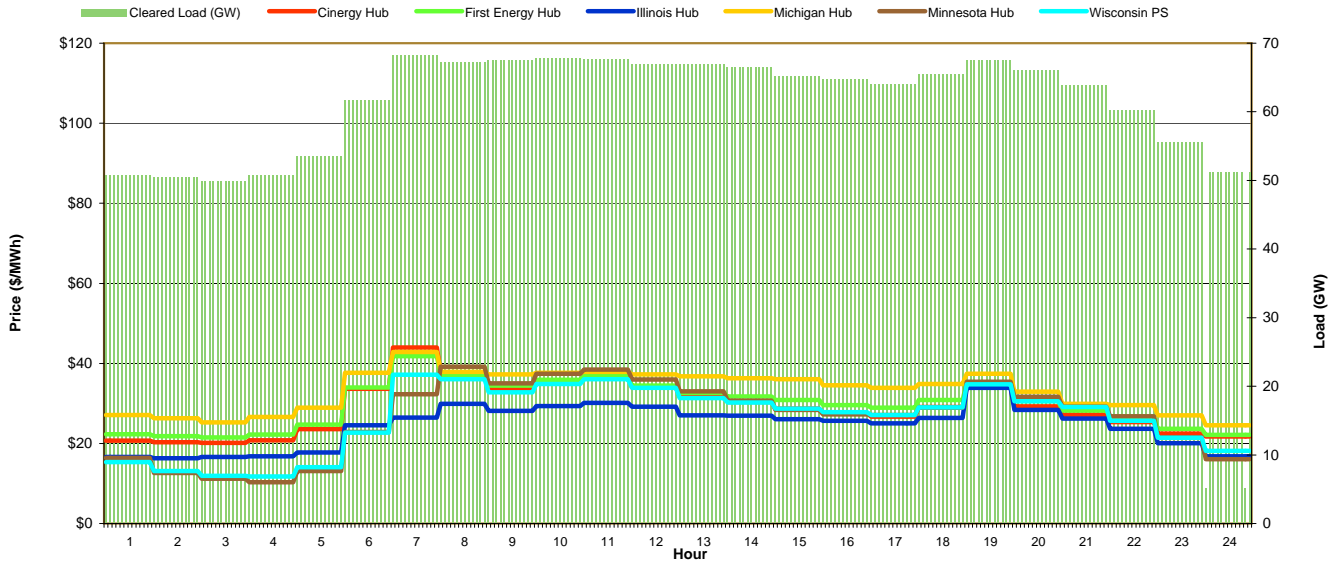

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	18.01	23.09	17.60	17.75	21.27	48.57	43.46	42.36	34.90	30.55	105.55	22.34	24.01	24.41	24.94	23.30	22.60	23.16	38.22	23.79	22.02	19.10	19.83	16.37	29.47	31.32
First Energy Hub	18.42	49.94	17.97	18.14	19.69	38.00	44.75	43.69	32.19	31.31	97.39	23.10	24.62	25.19	25.73	23.80	23.23	23.82	39.37	24.49	22.66	19.60	19.47	16.51	30.13	31.23
Illinois Hub	17.25	11.78	16.92	17.05	14.27	5.16	41.52	40.37	24.95	27.81	84.05	21.25	22.79	23.55	24.09	23.00	22.00	22.53	37.16	23.31	21.66	18.63	16.06	15.77	24.71	28.33
Michigan Hub	18.77	119.17	18.26	18.42	18.30	28.11	45.43	44.45	32.80	32.00	100.81	23.51	25.15	25.71	26.37	24.38	23.83	24.38	40.56	25.22	23.33	20.17	19.20	16.61	33.12	31.99
Minnesota Hub	16.96	14.22	16.09	32.39	25.43	20.75	51.46	51.82	36.01	30.27	53.44	22.39	23.27	24.09	24.50	21.07	21.84	22.90	37.95	22.99	20.37	21.78	17.18	14.73	26.83	28.24
Wisconsin PS	18.36	13.53	17.82	19.32	17.33	18.17	46.35	45.33	32.74	31.34	75.95	27.15	24.49	25.10	25.56	23.64	23.26	24.07	40.56	26.22	23.21	20.47	18.48	16.13	27.27	30.47
Forecasted Load (GW)	54.1	53.7	52.1	52.4	53.7	59.9	65.7	66.1	66.6	66.9	67.0	66.4	65.9	65.2	64.2	63.3	62.6	62.3	64.2	64.4	63.1	60.3	56.5	53.4		
Forecast Error %	-1.8%	-3.2%	-1.4%	-1.4%	0.5%	-1.2%	-1.3%	1.1%	0.6%	0.2%	-0.8%	-0.4%	-0.2%	-0.2%	0.0%	-0.2%	-0.3%	0.0%	0.5%	0.2%	0.0%	0.3%	-0.2%			

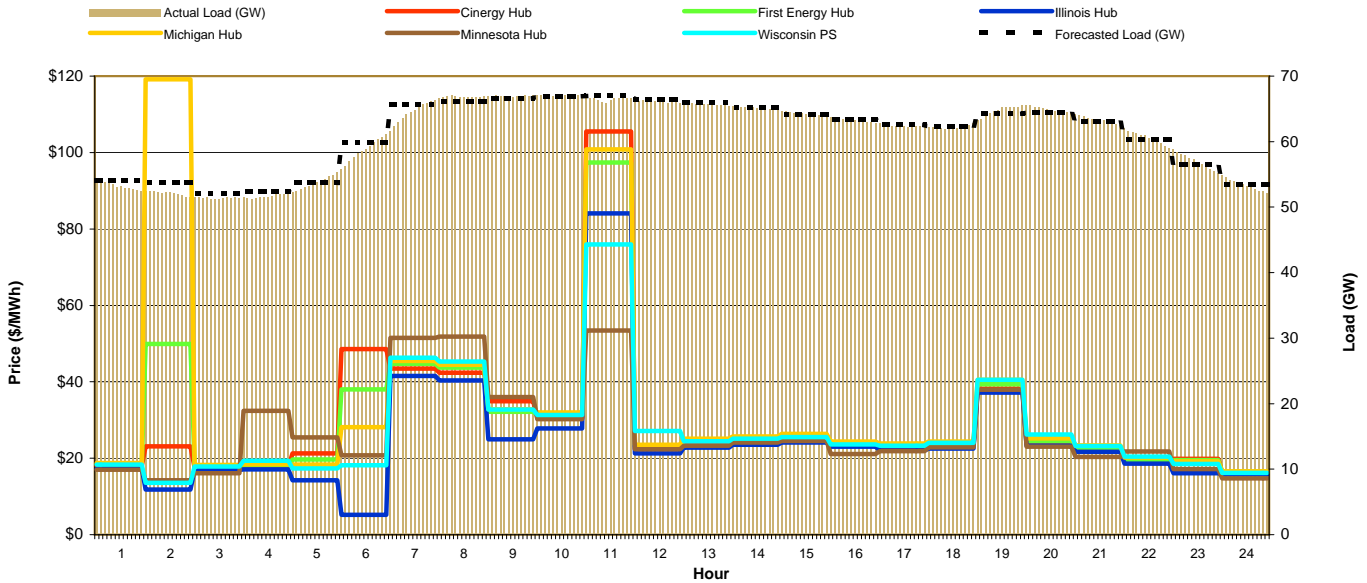




MISO Daily Report

Saturday October 23, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	20.56	19.98	19.54	19.78	20.27	22.17	25.42	26.98	26.84	27.85	28.32	27.32	26.13	25.28	24.85	25.08	27.10	28.83	38.97	30.30	27.34	25.10	22.25	19.94	25.26	27.41
First Energy Hub	21.76	21.57	21.00	21.24	21.47	23.48	26.59	27.48	28.08	29.23	29.75	28.91	27.58	26.79	26.29	26.57	28.08	30.18	40.29	31.42	28.18	26.62	23.39	21.36	26.55	28.68
Illinois Hub	16.60	16.59	15.39	15.82	15.59	19.25	22.41	23.45	24.16	25.71	26.73	26.14	24.94	24.29	23.88	24.10	25.37	27.14	36.60	28.16	25.55	23.30	20.98	18.42	22.94	25.66
Michigan Hub	25.10	25.65	25.18	25.36	25.21	27.21	30.39	29.91	31.02	32.07	32.37	31.91	30.41	29.31	28.73	29.15	30.45	33.20	47.15	34.40	29.81	29.82	25.67	24.27	29.74	31.59
Minnesota Hub	12.11	11.28	10.95	10.66	11.91	14.50	20.17	25.13	27.47	29.87	31.39	29.77	27.66	26.11	25.38	25.66	25.63	28.10	44.48	42.58	32.89	23.40	19.26	15.05	23.81	29.05
Wisconsin PS	16.08	15.13	14.52	14.19	14.83	17.87	22.28	25.06	26.39	27.93	28.81	27.86	26.54	25.67	25.22	25.44	26.13	28.14	40.23	33.26	28.41	24.60	21.14	17.76	23.89	27.55
Cleared Load (GW)	48.1	47.0	46.0	46.1	46.6	49.3	54.5	56.2	58.1	59.5	59.8	59.4	58.8	58.5	57.9	57.9	58.3	60.0	62.9	61.0	59.1	55.8	51.2	4.7		

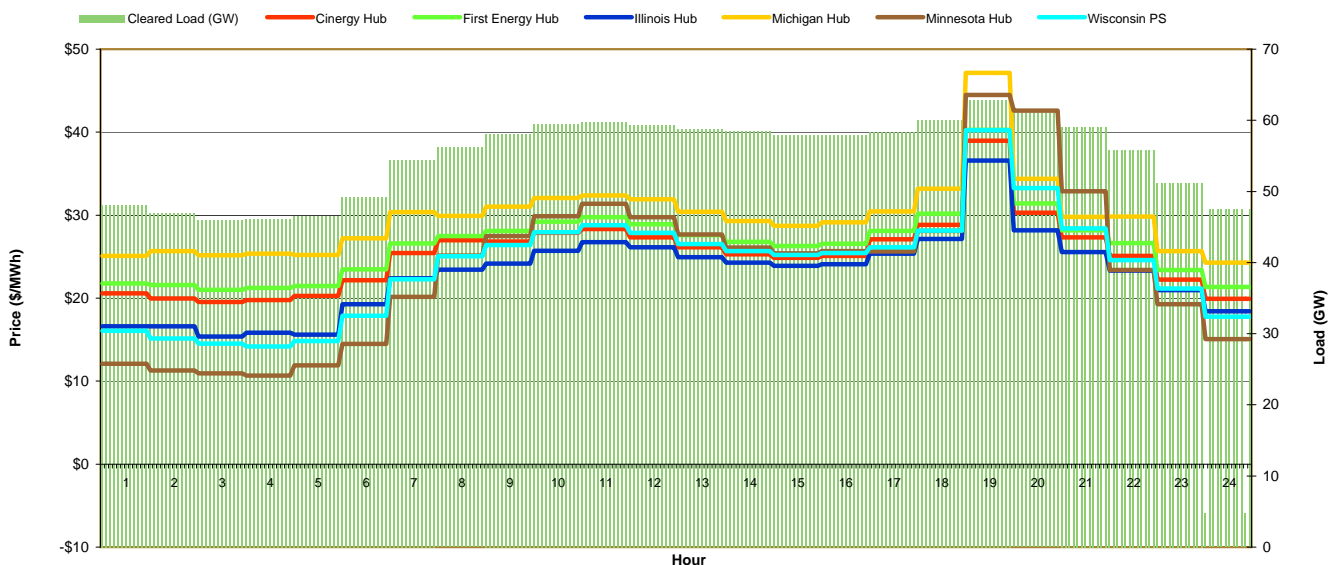

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	20.04	21.32	21.42	20.63	37.46	25.47	22.21	25.03	27.66	29.04	26.24	25.44	24.76	24.17	22.53	23.52	22.95	24.85	28.95	23.07	21.60	19.77	19.08	16.89	23.92	24.29
First Energy Hub	20.09	22.91	21.84	20.95	31.04	24.19	22.66	25.54	28.29	29.68	26.82	26.02	25.32	24.72	23.03	24.04	23.48	25.47	29.69	23.64	22.13	20.20	19.43	17.44	24.11	24.84
Illinois Hub	15.71	1.85	17.80	18.95	10.20	17.56	20.20	22.47	26.05	27.65	25.11	24.32	23.60	23.08	21.66	22.57	22.09	23.98	27.84	22.20	20.80	19.08	18.36	15.95	20.38	23.18
Michigan Hub	20.18	26.12	22.37	21.30	25.29	22.89	23.17	26.19	37.91	32.44	27.79	26.93	26.21	25.54	23.75	24.89	24.34	26.38	30.81	24.39	22.89	20.89	20.00	18.52	25.05	26.33
Minnesota Hub	15.58	1.91	15.61	11.29	15.62	18.54	19.65	22.53	26.52	28.98	26.53	25.99	25.27	24.48	22.77	23.43	22.90	25.24	43.54	25.78	23.67	19.41	18.46	16.08	21.66	25.34
Wisconsin PS	16.88	-1.21	17.30	16.70	19.14	20.68	21.26	24.09	28.44	30.42	27.77	27.01	26.21	25.48	23.71	24.59	24.08	26.38	32.71	24.85	23.02	20.78	19.81	17.07	22.38	25.58
Forecasted Load (GW)	57.3	51.6	50.6	49.9	53.7	57.5	58.5	60.7	58.2	61.0	55.4	59.0	58.0	53.7	51.4	57.4	59.5	49.7	58.8	57.7	57.1	50.1	51.6	57.2		
Forecast Error %	-13.0%	-4.9%	-5.0%	-3.9%	-10.3%	-13.9%	-9.7%	-9.0%	-0.5%	-2.2%	7.9%	1.6%	2.4%	8.6%	11.4%	0.8%	-2.7%	15.7%	4.1%	5.4%	3.6%	11.8%	3.6%	-13.5%		

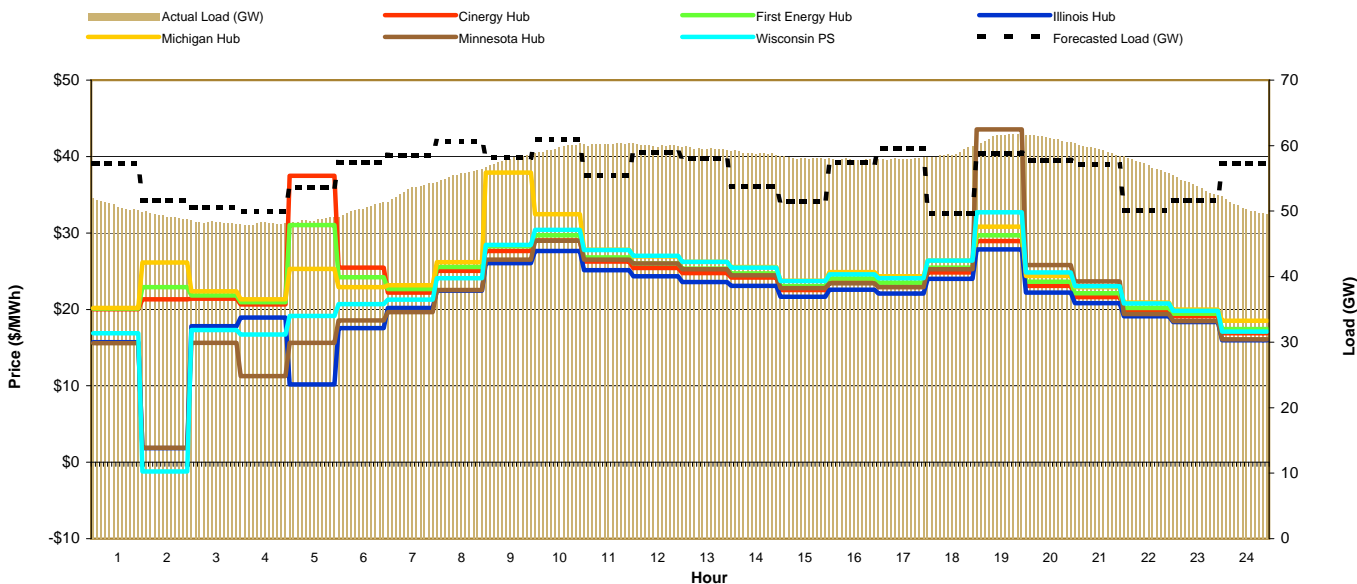




MISO Daily Report

Sunday October 24, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$			
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk		
Cinergy Hub	19.00	17.15	15.26	15.39	17.12	19.65	22.00	22.05	23.89	24.57	25.91	25.66	25.23	25.15	25.53	25.30	26.14	29.24	40.45	33.45	28.42	24.40	20.95	19.46	23.81	26.65		
First Energy Hub	20.65	19.19	17.38	17.54	18.55	21.21	23.63	23.18	24.96	25.92	27.08	26.92	26.58	26.47	26.73	26.62	27.04	30.42	42.25	34.98	29.90	26.08	22.91	21.49	25.32	28.00		
Illinois Hub	15.71	15.23	14.56	15.11	14.90	16.19	17.89	19.93	21.43	23.03	23.83	23.85	23.87	23.95	24.05	23.86	24.70	26.92	42.19	30.62	26.56	23.28	19.85	16.77	22.01	25.12		
Michigan Hub	24.93	23.93	21.83	22.06	21.95	25.30	27.44	24.72	26.62	27.85	28.61	28.78	28.61	27.90	28.04	28.60	29.47	31.19	43.18	35.77	30.78	28.10	26.50	26.21	27.85	29.67		
Minnesota Hub	13.48	11.75	11.42	12.16	12.13	13.70	18.01	19.39	22.08	23.28	25.50	26.22	26.43	26.35	25.60	26.17	26.81	36.01	56.42	56.47	39.31	26.21	18.98	15.52	24.56	30.08		
Wisconsin PS	15.65	14.19	13.49	13.90	14.17	15.60	19.41	20.84	23.28	24.45	25.69	25.83	25.73	25.72	25.77	25.85	26.69	31.61	45.30	39.57	32.03	25.18	20.73	17.23	23.66	27.77		
Cleared Load (GW)	45.2	44.4	43.6	43.5	44.0	45.3	49.7	51.1	54.0	55.6	56.7	57.2	57.3	57.2	57.3	58.0	58.9	61.4	64.9	63.2	61.0	57.5	52.4	4.9				

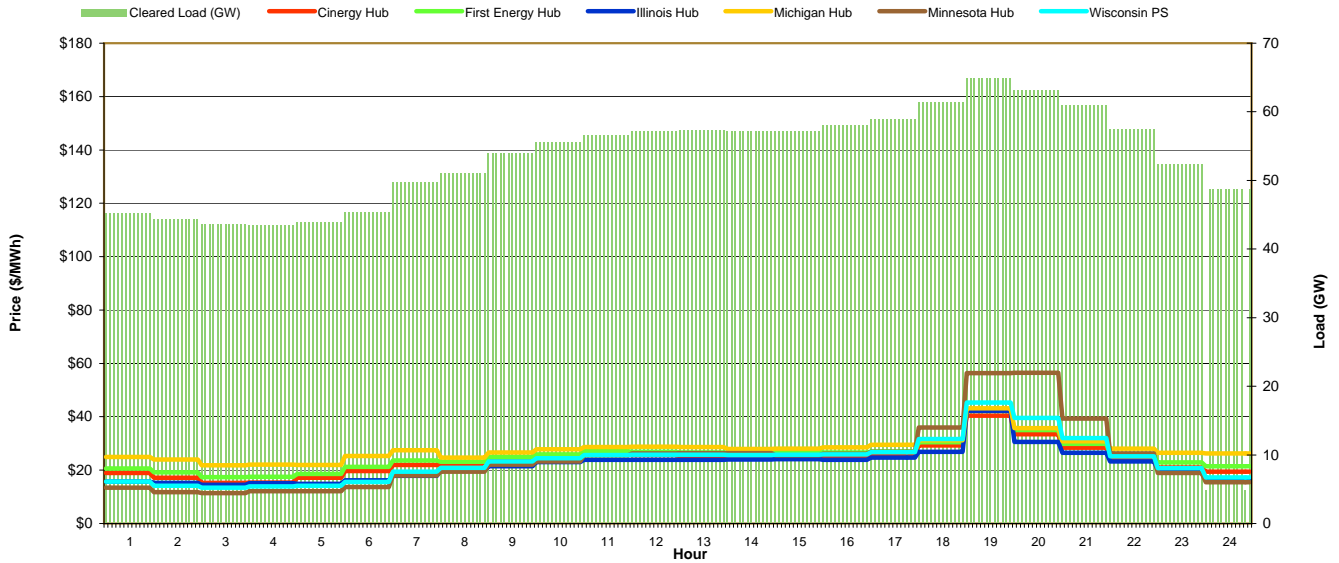

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$			
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk		
Cinergy Hub	16.76	21.71	17.68	17.11	16.94	16.89	32.00	20.79	22.49	24.96	23.35	24.79	25.00	24.05	23.27	42.19	28.34	42.63	34.43	76.10	24.48	22.30	20.61	21.15	26.67	29.99		
First Energy Hub	29.35	46.88	19.00	18.25	17.73	17.23	27.09	20.53	22.91	25.05	23.86	25.37	25.60	24.62	23.84	43.47	29.05	43.76	36.66	79.84	25.17	22.90	22.26	27.34	29.07	30.93		
Illinois Hub	10.44	9.36	16.48	15.99	16.00	16.16	9.98	17.56	21.48	22.27	22.23	23.60	23.84	22.96	22.27	40.49	27.27	41.12	29.96	69.61	23.61	21.59	19.49	17.96	23.41	28.08		
Michigan Hub	62.93	114.30	22.01	20.81	19.33	17.52	22.62	20.25	23.34	25.28	24.40	25.91	26.12	25.10	24.39	45.32	29.95	45.15	39.00	82.35	25.84	23.58	25.98	43.59	34.79	32.00		
Minnesota Hub	12.17	12.67	16.40	15.68	15.54	15.73	15.84	18.58	22.30	23.85	23.55	25.27	25.69	24.64	23.72	42.55	29.11	45.33	129.06	170.54	26.10	22.92	20.27	19.12	33.19	42.09		
Wisconsin PS	11.58	10.82	17.35	16.70	16.68	16.92	17.97	19.60	23.17	24.74	24.20	25.86	26.21	25.18	24.33	43.93	29.63	45.20	57.88	103.66	25.57	23.19	20.78	19.18	27.93	33.94		
Forecasted Load (GW)	47.6	59.0	55.5	48.9	55.1	57.6	58.8	47.9	57.8	58.0	62.9	62.1	48.0	49.5	49.5	52.9	56.1	63.9	50.7	57.8	59.5	48.0	56.9	52.7				
Forecast Error %	0.9%	-26.7%	-21.6%	-8.3%	-21.4%	-24.2%	-22.0%	5.0%	-9.9%	-6.6%	-12.9%	-9.8%	15.9%	12.7%	12.5%	6.8%	3.3%	-7.1%	8.3%	1.9%	16.9%	-4.7%	-3.0%					

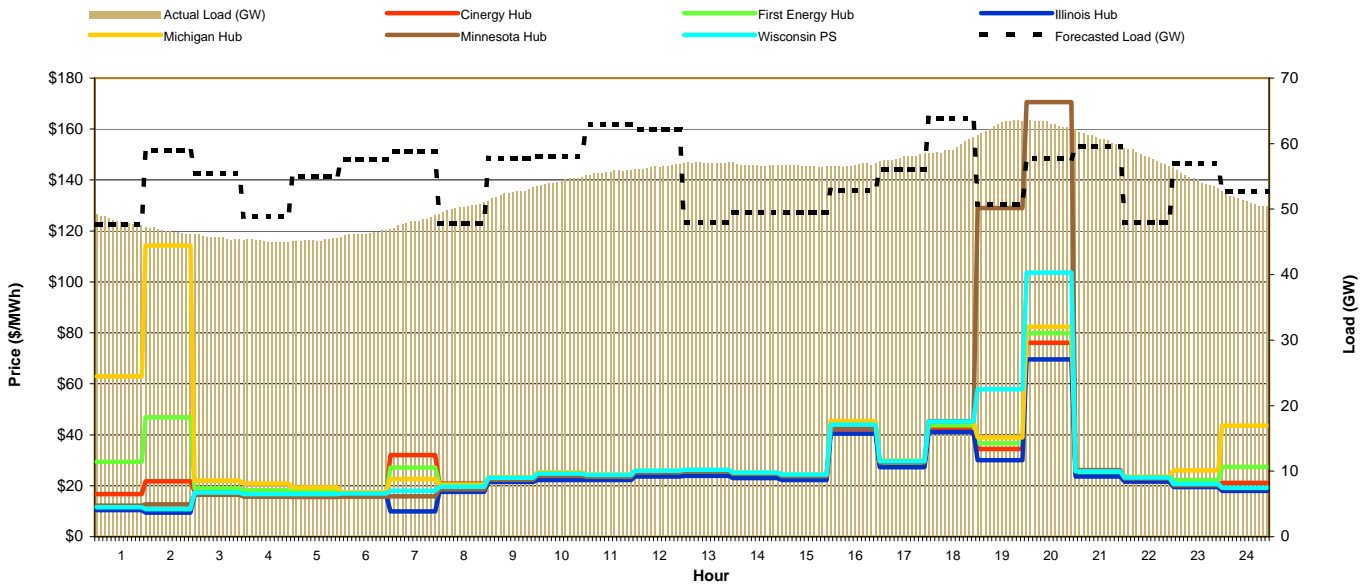




MISO Daily Report

Monday October 25, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	19.63	19.88	19.82	19.96	23.28	32.66	43.92	35.89	33.95	33.97	35.36	36.68	37.29	36.26	35.01	36.57	35.22	37.79	41.67	36.81	32.59	26.20	22.75	20.96	31.42	34.63
First Energy Hub	21.83	22.02	21.53	21.89	24.49	32.42	44.05	36.51	35.04	35.48	36.94	38.47	39.19	38.02	36.70	38.48	36.96	39.74	43.28	38.41	34.03	28.07	24.71	23.06	32.97	36.25
Illinois Hub	15.78	15.63	15.69	15.41	14.78	18.90	24.69	27.62	30.92	32.85	42.51	38.51	41.71	42.60	36.61	36.64	32.04	38.93	48.51	35.55	31.00	24.91	20.02	19.53	29.22	35.06
Michigan Hub	27.40	27.25	25.56	26.09	27.25	33.97	45.13	37.26	35.77	36.22	37.71	39.27	40.07	38.86	37.49	39.38	37.79	40.66	44.18	39.21	34.75	30.55	27.72	27.08	34.86	37.31
Minnesota Hub	15.63	15.36	15.13	15.88	16.53	24.45	34.88	41.38	38.71	40.75	42.85	42.57	43.13	41.62	40.02	39.41	39.58	40.33	50.55	44.47	36.21	29.51	19.59	15.89	32.68	39.42
Wisconsin PS	16.11	15.93	15.46	15.68	16.16	24.27	30.62	32.78	32.26	35.31	37.65	36.88	36.72	35.77	33.63	32.02	31.77	31.89	43.47	38.48	30.00	26.26	21.51	18.37	28.71	33.52
Cleared Load (GW)	46.5	46.6	46.3	47.0	49.3	58.2	65.6	66.8	67.6	68.9	69.8	70.3	70.6	70.4	69.9	69.3	69.3	70.3	72.9	71.3	68.2	63.9	58.1	5.4		

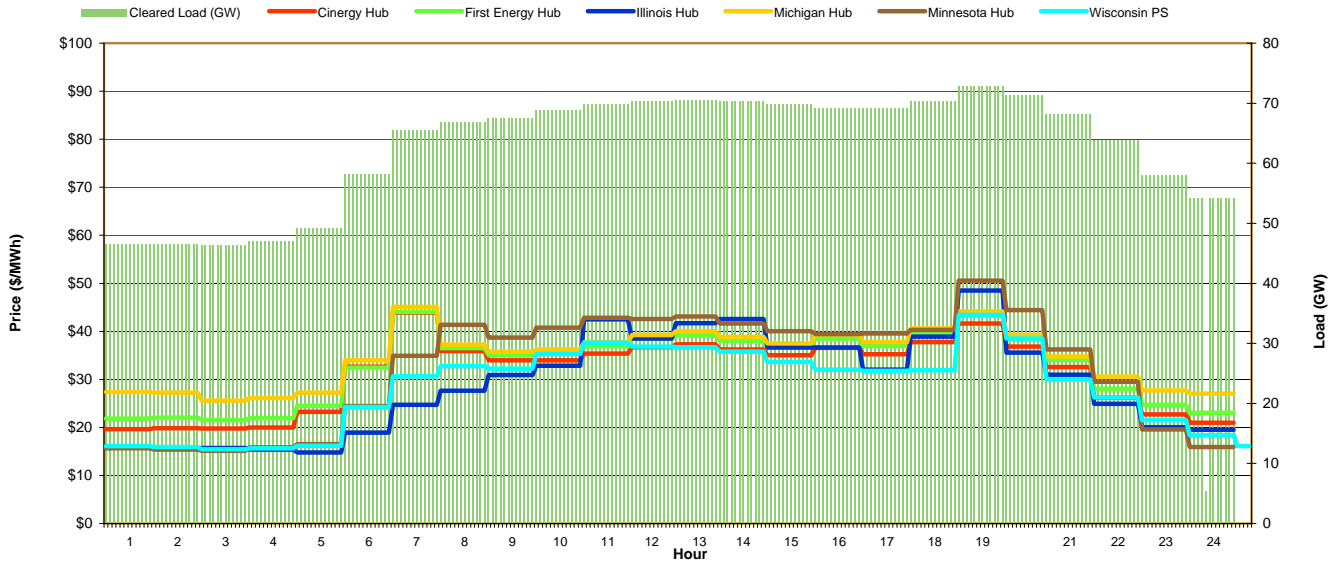

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	19.56	17.34	18.08	21.30	21.58	60.05	40.08	26.89	25.49	25.67	25.42	25.20	25.41	27.26	24.81	24.93	23.50	27.10	32.18	26.19	23.83	20.46	16.34	15.76	25.60	25.04
First Energy Hub	28.39	17.99	19.99	41.44	22.67	63.84	41.04	27.66	26.33	26.54	26.28	26.11	26.30	28.17	25.59	25.50	24.18	27.93	33.39	27.14	24.62	21.10	16.56	15.86	27.28	25.84
Illinois Hub	15.01	16.56	16.69	11.45	13.93	11.55	38.60	25.88	24.54	24.74	24.55	24.27	24.48	26.25	23.94	24.12	22.65	26.02	30.76	25.04	23.25	20.21	16.26	15.69	21.94	24.19
Michigan Hub	51.79	19.36	24.71	95.46	28.06	57.25	42.61	28.64	27.09	28.07	27.39	26.64	26.84	28.83	26.19	26.11	24.82	28.48	34.41	28.19	25.09	21.58	16.97	16.19	31.70	26.58
Minnesota Hub	16.50	16.60	16.58	13.47	15.20	21.88	45.06	46.99	34.20	30.26	33.90	28.64	28.45	34.03	25.22	23.08	23.45	25.77	31.85	25.68	22.36	18.76	13.66	12.52	25.17	27.89
Wisconsin PS	16.09	17.41	17.49	12.51	16.65	27.51	42.27	30.55	29.19	27.52	32.93	27.90	26.80	29.20	25.93	25.77	26.18	28.31	37.45	27.52	24.75	21.39	16.58	15.71	25.15	27.37
Forecasted Load (GW)	51.4	50.3	49.9	50.2	52.2	56.1	62.5	65.0	66.3	67.9	68.9	69.4	69.9	69.8	69.2	68.8	68.4	68.5	70.5	70.0	67.9	63.9	60.0	56.1		
Forecast Error %	-30.6%	-4.9%	-5.0%	-4.8%	-3.8%	-0.7%	-0.1%	0.6%	-0.4%	-1.1%	-1.3%	-1.3%	-2.0%	-2.0%	-2.5%	-3.0%	-2.7%	-1.5%	-0.2%	-0.5%	-1.1%	-0.9%	-2.2%	-11.3%		

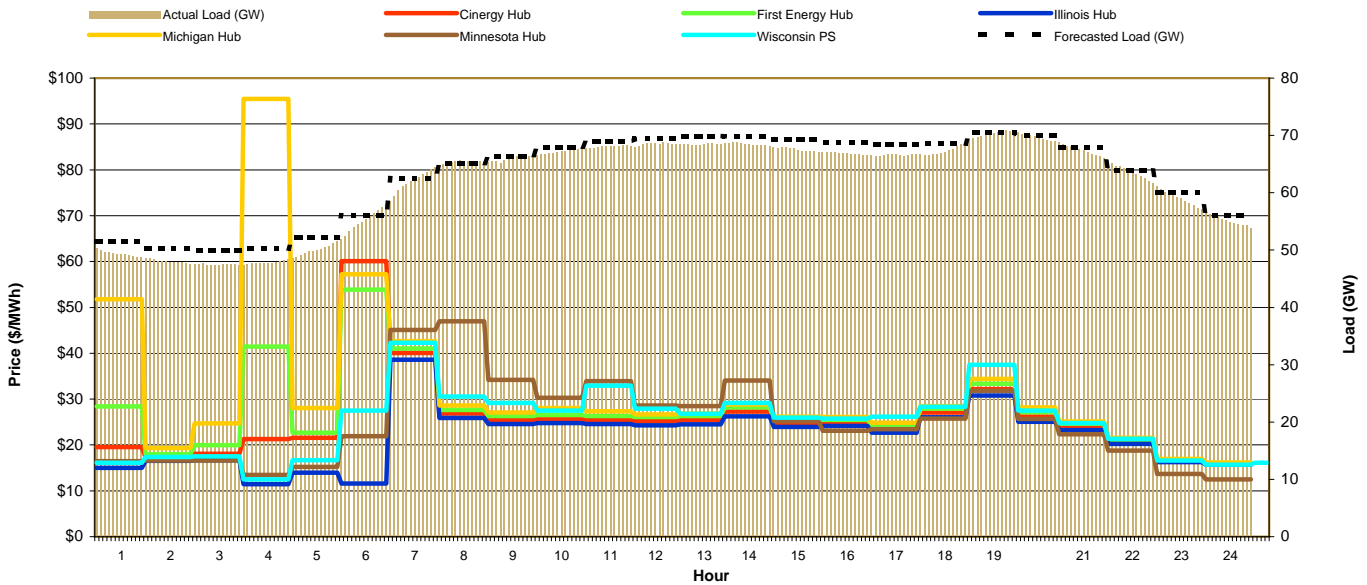




MISO Daily Report

Tuesday October 26, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
																									All	On Pk		
Cinergy Hub	20.38	19.88	19.95	20.62	23.63	33.75	42.75	31.04	31.73	32.05	33.81	35.29	38.83	36.30	33.20	31.86	30.19	35.49	43.72	34.57	28.14	24.40	21.59	19.87	30.13	32.64		
First Energy Hub	21.96	21.17	20.82	21.42	24.43	33.48	42.58	32.57	32.88	33.27	35.14	35.81	38.89	36.64	33.85	33.02	31.22	36.84	45.43	35.96	29.65	26.34	23.89	22.33	31.19	33.78		
Illinois Hub	15.38	15.28	15.55	15.78	15.00	17.90	25.98	26.58	30.51	31.03	34.37	29.75	35.20	30.76	29.27	29.92	26.81	28.62	42.84	32.79	25.99	22.53	19.32	16.78	25.58	29.77		
Michigan Hub	28.75	27.22	26.42	27.40	31.00	37.69	43.49	35.50	35.88	35.29	36.63	38.10	41.59	38.56	35.81	34.82	33.08	36.67	46.40	36.80	31.62	29.16	28.46	27.49	34.33	35.90		
Minnesota Hub	5.73	5.30	3.98	3.58	5.52	10.96	31.66	36.60	37.13	36.00	36.71	36.57	33.78	30.81	28.07	28.95	32.21	35.56	44.85	40.78	29.88	24.57	15.99	10.08	25.22	33.03		
Wisconsin PS	6.95	5.93	2.84	2.69	5.93	22.64	30.93	31.40	30.30	31.53	32.74	33.34	34.06	30.63	28.76	29.33	29.92	33.02	43.80	34.75	29.06	24.56	19.37	16.60	24.63	31.03		
Cleared Load (GW)	51.7	50.8	49.9	50.7	53.3	60.5	68.2	68.4	69.0	69.2	69.6	69.6	69.4	69.3	68.9	68.5	67.7	69.2	71.4	70.3	67.0	62.6	57.9	5.4				

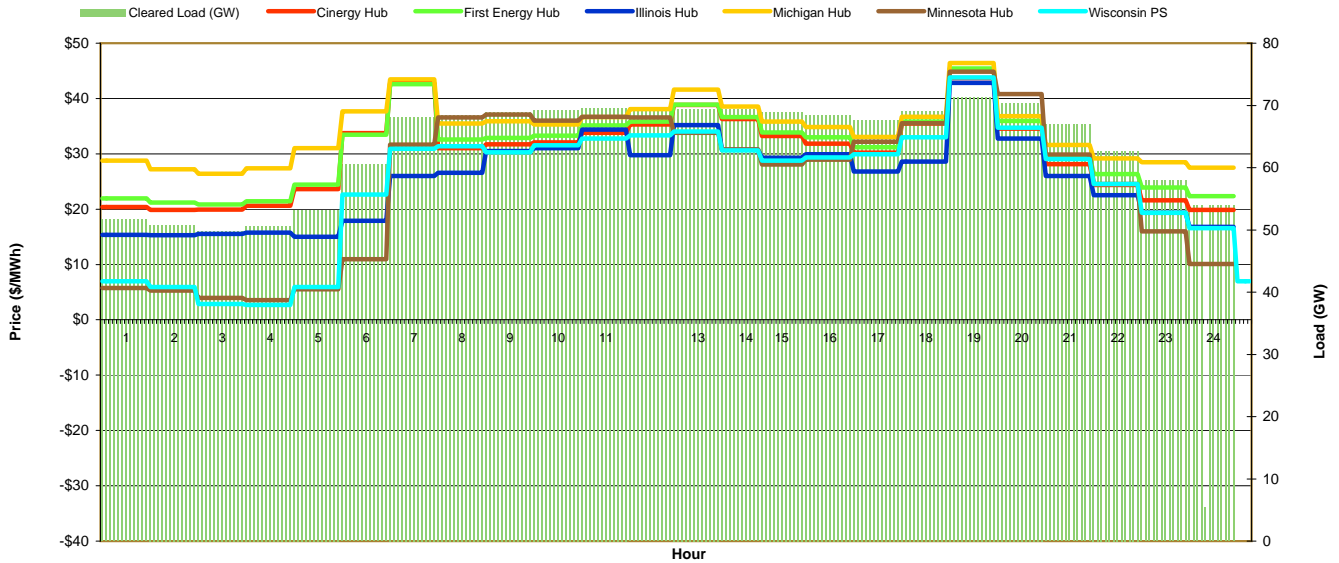

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
																									All	On Pk		
Cinergy Hub	15.21	11.68	10.18	18.37	5.84	28.58	34.35	35.68	25.10	27.60	25.78	23.76	25.71	25.15	25.31	24.74	23.01	23.60	25.79	25.18	25.91	20.52	18.81	13.29	22.46	25.10		
First Energy Hub	15.30	9.57	8.87	18.73	3.23	22.33	24.09	24.34	25.85	26.51	26.28	24.56	25.90	25.40	25.04	24.64	23.30	24.22	26.08	25.98	26.29	21.09	18.88	13.56	21.25	24.65		
Illinois Hub	15.19	19.34	16.74	3.38	11.98	27.00	22.20	22.64	23.97	28.84	25.07	23.15	24.55	25.39	18.59	21.96	18.86	21.68	24.26	24.19	25.11	19.90	19.99	16.92	20.87	23.01		
Michigan Hub	15.59	9.67	8.96	20.04	3.24	22.82	24.61	24.96	26.44	27.00	26.67	24.88	26.27	25.69	25.40	25.11	23.42	24.21	26.15	26.11	26.73	21.34	19.04	13.63	21.58	24.96		
Minnesota Hub	11.93	-12.95	-11.65	-11.89	-15.28	-0.67	19.96	21.35	41.83	29.21	24.45	26.81	25.48	23.67	21.88	-4.47	25.98	24.33	27.81	24.63	3.27	18.94	6.22	11.62	13.85	21.34		
Wisconsin PS	15.08	9.14	8.13	-5.40	3.09	19.71	23.93	25.02	28.10	25.32	21.12	24.09	23.31	24.41	15.02	-35.66	23.77	24.70	26.94	26.39	-17.40	21.13	16.61	12.42	14.96	17.05		
Forecasted Load (GW)	54.5	53.0	52.2	52.5	54.4	58.2	64.1	66.4	67.0	68.0	68.7	68.9	68.7	68.1	67.3	66.5	66.0	66.3	68.6	68.4	66.2	62.3	59.2	55.9				
Forecast Error %	-29.8%	-4.0%	-4.0%	-4.1%	-3.9%	-0.8%	0.1%	1.1%	0.4%	-0.7%	-1.2%	-1.7%	-1.6%	-1.1%	-1.3%	-1.1%	-0.9%	-0.1%	0.0%	-0.5%	-0.6%	-0.6%	-2.5%	-12.4%				

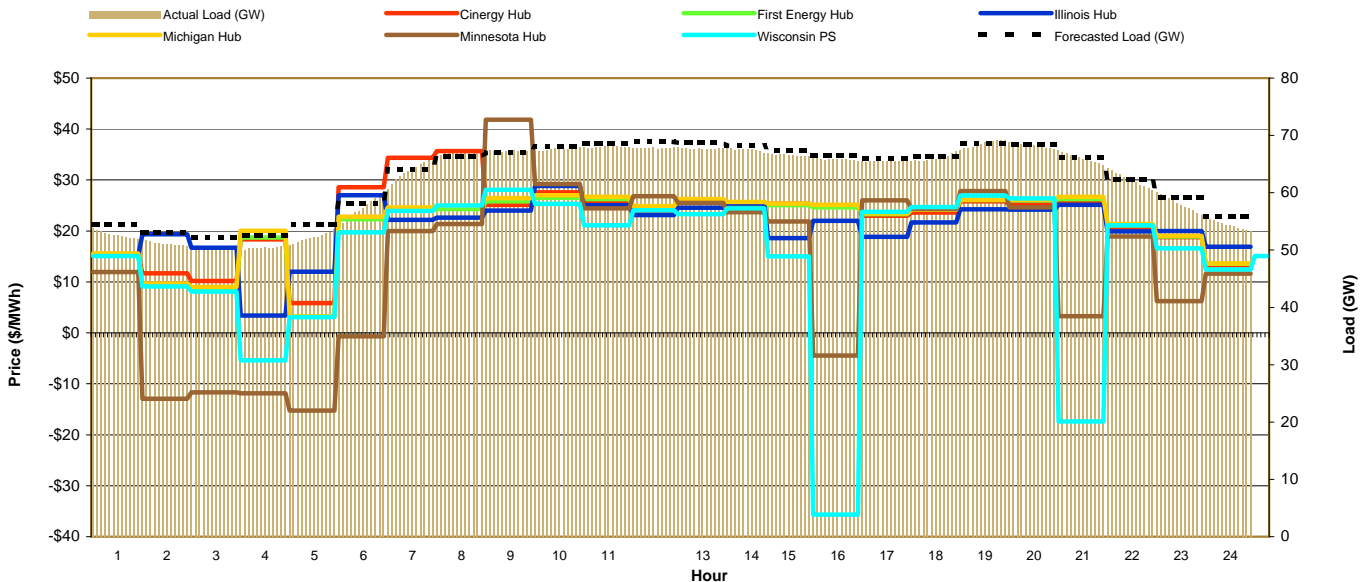




MISO Daily Report

Wednesday October 27, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$			
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk		
Cinergy Hub	17.02	17.50	16.29	18.57	22.46	31.57	36.97	28.92	29.44	31.75	30.57	31.27	31.95	30.23	28.56	28.30	28.27	31.38	37.41	32.61	26.86	23.86	21.78	20.11	27.24	29.57		
First Energy Hub	19.45	19.77	18.64	20.77	22.82	31.59	36.63	30.97	31.14	33.35	32.71	33.15	33.62	32.04	30.62	30.28	30.03	32.86	37.98	33.83	28.69	25.86	23.76	22.10	28.86	31.31		
Illinois Hub	15.60	15.37	15.34	15.66	15.76	21.45	26.30	24.68	25.52	26.47	26.90	27.10	27.02	26.50	25.66	25.51	25.21	26.24	31.33	29.83	24.60	22.50	19.83	18.55	23.29	25.93		
Michigan Hub	24.77	24.70	23.79	25.41	25.74	35.00	37.67	34.93	34.22	36.57	35.76	35.75	34.09	33.03	32.55	32.35	35.82	38.90	35.08	31.44	28.98	27.74	26.33	31.93	33.94			
Minnesota Hub	5.75	4.32	3.84	3.17	5.44	15.29	26.62	35.31	35.76	35.00	33.60	33.37	32.90	32.95	30.81	31.75	30.03	35.00	44.69	40.28	30.50	25.10	17.84	10.89	25.01	32.81		
Wisconsin PS	7.44	6.36	7.26	6.46	8.75	20.31	27.15	28.47	29.24	29.60	30.26	32.01	31.24	30.55	27.25	27.11	26.63	30.24	39.47	33.45	26.74	23.20	22.32	17.88	23.72	29.23		
Cleared Load (GW)	48.1	47.6	47.7	48.0	50.4	59.6	68.0	67.3	67.2	67.4	67.5	67.6	67.6	67.1	66.3	65.6	65.5	67.2	70.0	69.0	66.0	61.7	56.9	5.3				

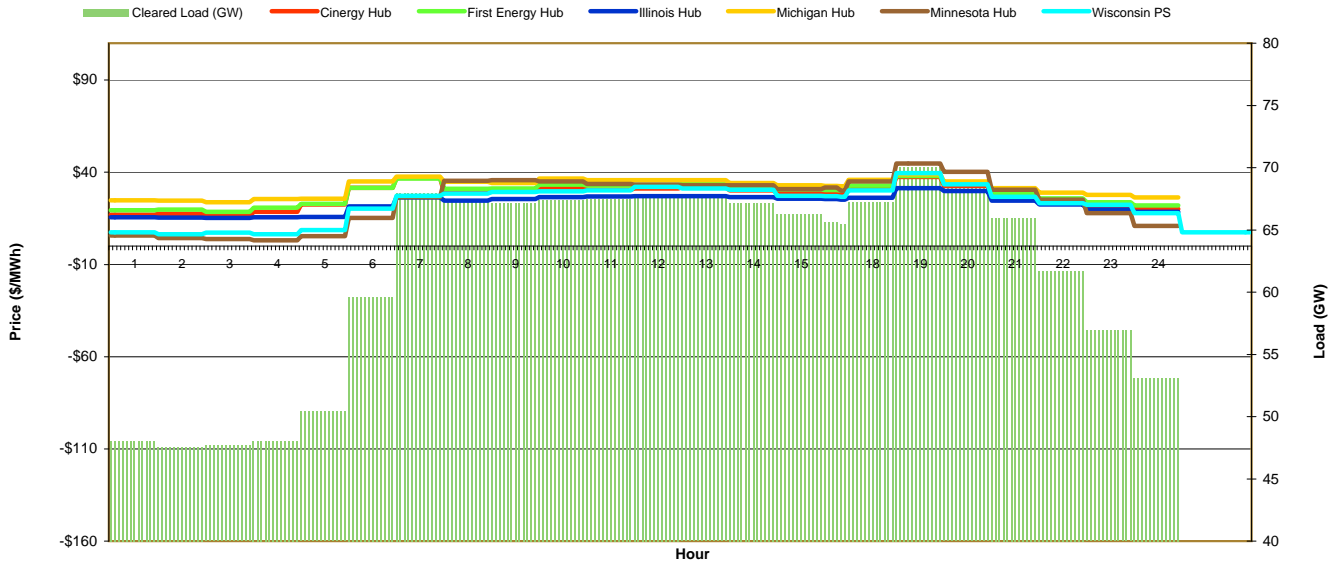

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$			
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk		
Cinergy Hub	22.48	18.69	20.09	21.92	22.36	68.55	25.27	25.02	24.81	36.42	30.76	26.47	28.99	34.45	27.80	26.76	26.25	32.43	78.37	25.32	27.73	21.57	19.45	15.09	29.46	30.79		
First Energy Hub	22.52	19.34	21.03	22.54	22.99	67.48	25.63	25.98	25.78	38.01	32.01	27.56	30.10	36.17	28.88	27.62	27.21	33.61	81.22	26.22	28.32	22.29	19.79	15.48	30.32	31.92		
Illinois Hub	18.58	12.96	3.94	8.82	14.64	41.88	22.84	24.05	23.83	35.07	29.80	25.56	29.42	28.28	25.66	19.10	24.75	31.35	75.49	24.34	26.94	20.79	18.94	14.62	25.07	28.96		
Michigan Hub	22.59	19.74	22.06	23.43	23.49	69.15	26.07	26.44	26.34	38.64	32.52	27.86	30.06	31.67	27.91	28.26	27.71	33.55	81.25	26.34	28.97	22.56	24.62	25.35	31.11	32.17		
Minnesota Hub	16.73	12.74	16.22	-4.89	8.70	-65.68	21.83	24.27	27.22	39.98	34.58	24.82	15.67	18.04	21.17	17.43	26.13	31.65	101.63	26.09	11.32	21.31	17.49	11.98	28.68			
Wisconsin PS	-10.50	12.55	1.16	1.20	10.36	-142.11	24.41	26.51	26.12	37.51	32.25	26.55	26.22	25.01	19.22	17.03	24.72	28.69	76.14	24.58	-8.23	20.78	-26.33	-22.03	10.49	23.55		
Forecasted Load (GW)	53.5	51.7	51.0	51.3	52.9	58.5	64.3	65.8	65.9	66.9	67.1	67.1	67.2	66.7	65.8	65.3	65.0	65.6	68.5	68.2	66.4	62.7	60.0	56.6				
Forecast Error %	#####	-2.3%	-2.2%	-2.3%	-0.8%	-1.1%	-0.1%	0.7%	0.6%	-0.4%	-0.1%	-0.1%	-0.4%	-0.3%	-0.6%	-0.7%	-0.1%	-0.1%	0.3%	0.2%	-0.2%	0.0%	-2.7%	-12.8%				

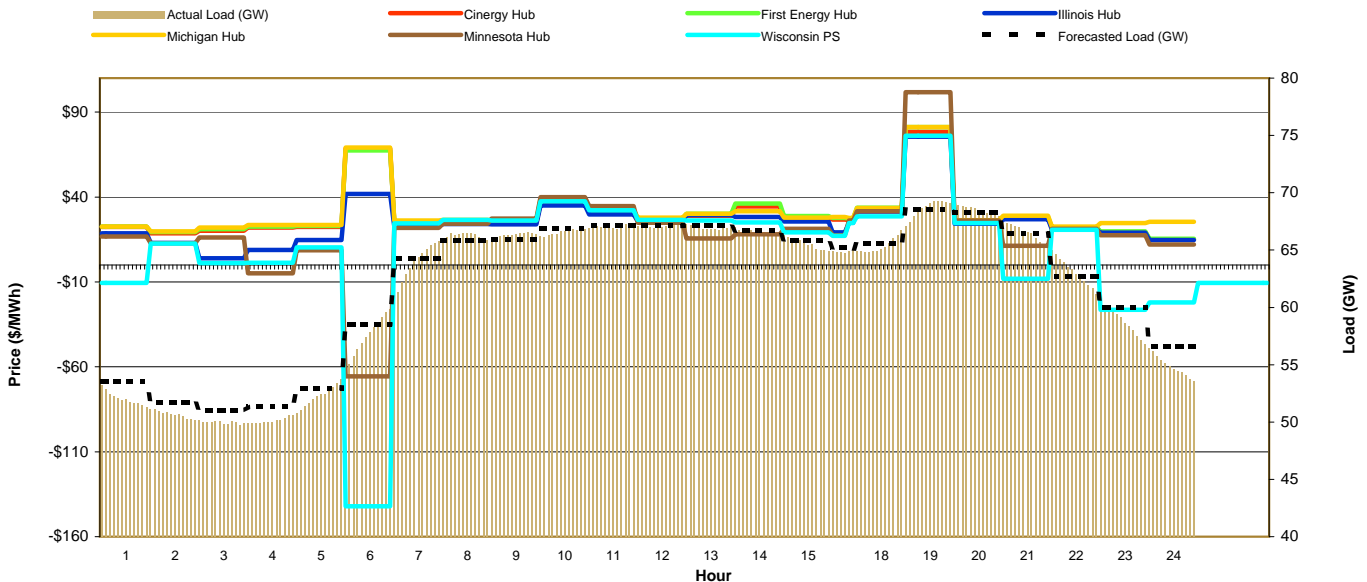




MISO Daily Report

Thursday October 28, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	18.50	17.79	16.48	17.50	21.02	32.75	42.21	33.47	33.90	36.48	37.66	35.75	38.59	35.89	34.78	31.96	32.88	36.93	48.30	37.70	34.61	29.40	24.17	23.09	31.33	35.15
First Energy Hub	20.18	19.38	17.98	18.57	21.43	33.45	40.31	35.15	35.23	37.36	37.39	35.98	36.76	34.72	33.67	33.19	33.76	37.60	50.87	39.59	36.02	30.60	24.67	23.46	31.97	35.79
Illinois Hub	15.17	15.40	15.83	15.00	15.80	25.31	23.13	62.46	56.33	74.39	49.34	34.46	21.00	20.97	20.86	25.90	23.95	27.32	72.44	55.16	40.27	24.65	20.37	19.13	32.28	39.37
Michigan Hub	24.32	23.22	22.00	21.15	23.30	35.73	41.51	37.79	37.81	38.41	38.41	37.64	38.23	36.88	35.14	34.68	35.03	38.50	52.13	40.64	36.91	31.39	25.14	24.24	33.76	37.17
Minnesota Hub	6.55	5.54	5.55	5.50	5.79	13.78	26.78	31.89	33.56	33.85	33.08	30.77	32.54	30.76	28.93	28.27	29.10	37.32	57.61	54.52	40.73	28.39	21.02	19.15	26.71	34.52
Wisconsin PS	7.73	7.89	7.92	7.39	8.04	19.95	28.48	29.91	29.38	31.15	33.06	31.14	30.96	30.07	28.66	27.56	27.80	37.37	51.91	39.71	35.94	28.54	27.91	22.54	26.29	32.56
Cleared Load (GW)	50.1	50.1	49.4	49.1	52.6	60.7	67.7	68.4	68.6	68.6	68.5	67.9	67.6	67.2	66.5	65.9	65.9	68.4	69.9	69.2	67.1	64.0	58.2	5.4		

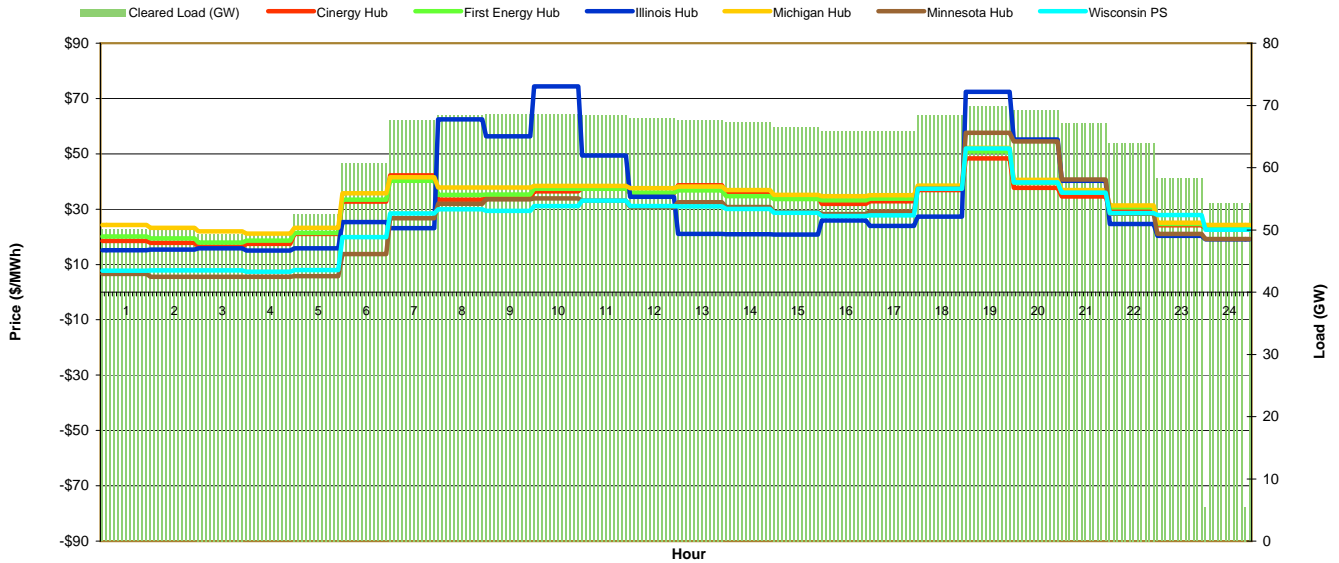

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	17.49	11.50	15.21	12.56	25.87	28.00	45.36	33.87	32.51	57.54	34.40	59.13	32.95	31.06	36.40	28.30	23.40	31.72	28.98	35.38	27.14	24.49	23.22	22.01	29.94	33.78
First Energy Hub	17.22	11.66	15.45	12.91	19.26	24.06	38.60	30.00	27.35	41.91	31.59	43.71	29.36	28.18	29.94	24.54	24.19	30.83	29.82	36.75	28.03	25.24	23.86	22.58	26.96	30.33
Illinois Hub	17.43	11.19	14.72	12.01	-32.58	-14.71	-23.93	-6.30	-17.58	-81.68	1.59	-77.33	-6.00	-1.29	-25.48	-10.11	22.43	12.45	27.46	32.57	25.98	23.50	22.38	21.16	-2.17	-3.59
Michigan Hub	22.23	11.65	25.79	12.98	22.31	30.93	43.15	30.90	27.72	46.47	32.37	45.35	31.58	29.18	32.81	27.26	25.25	30.93	29.81	36.53	28.04	25.56	24.21	22.74	28.99	31.50
Minnesota Hub	-18.38	3.77	7.02	11.14	-6.55	21.01	34.61	28.32	25.69	39.46	29.69	41.35	27.56	26.30	27.73	22.27	22.36	29.35	30.45	84.58	29.48	24.82	24.32	24.78	24.63	32.11
Wisconsin PS	-73.69	-2.88	-37.54	11.65	-43.13	-2.04	21.73	28.35	27.15	24.65	29.08	39.17	21.91	25.12	19.85	15.73	21.13	30.94	30.88	52.20	28.30	25.45	24.58	23.65	14.26	27.78
Forecasted Load (GW)	54.4	53.0	52.5	52.8	54.3	58.7	65.3	67.6	67.9	68.3	68.5	68.2	68.1	67.6	66.8	66.3	66.1	66.9	69.6	69.7	68.3	65.0	60.8	58.3		
Forecast Error %	-3.5%	-3.9%	-4.1%	-3.8%	-2.4%	-0.3%	-1.2%	-0.7%	-0.8%	-0.5%	-0.6%	-0.4%	-0.9%	-1.2%	-1.0%	-1.1%	-0.8%	0.2%	0.5%	0.3%	-0.3%	-0.5%	-0.4%	-2.0%		

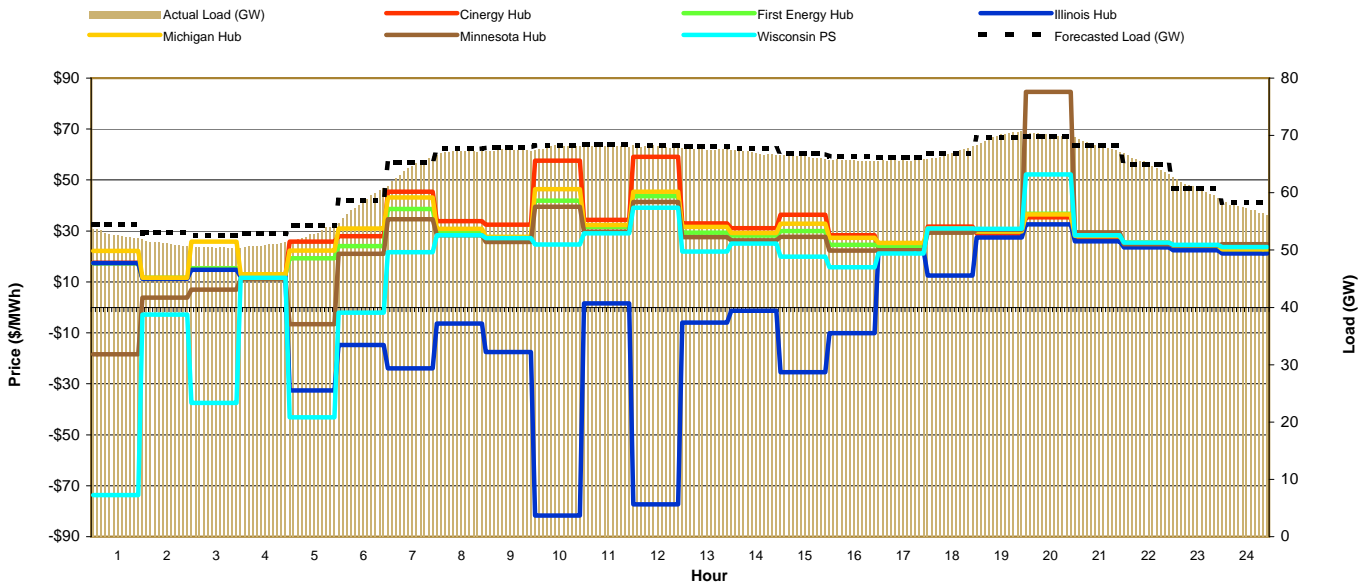




MISO Daily Report

Friday October 29, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	23.50	23.65	23.55	23.46	25.91	36.34	47.03	41.52	39.18	38.95	35.40	33.98	33.34	29.17	27.02	26.39	26.83	32.08	40.23	34.17	29.88	26.92	24.85	23.50	31.12	32.49
First Energy Hub	22.91	23.20	23.06	23.03	24.83	34.81	45.51	40.98	37.35	37.34	35.66	34.15	33.41	30.82	28.29	27.64	27.74	33.06	40.03	34.28	30.23	27.24	24.57	23.13	30.97	32.67
Illinois Hub	8.00	8.00	7.79	8.00	7.94	13.60	19.33	22.79	22.17	22.08	21.47	20.28	19.31	18.27	17.78	16.45	16.24	17.74	24.85	20.28	18.68	15.93	12.02	10.90	16.25	19.15
Michigan Hub	23.96	24.48	24.37	24.34	25.14	35.48	46.69	42.01	38.26	38.25	36.54	35.01	34.55	34.77	31.07	29.92	29.82	36.45	41.09	35.13	31.23	27.93	24.93	23.49	32.29	34.19
Minnesota Hub	16.53	16.57	16.14	16.22	17.54	25.71	40.61	41.42	39.93	39.45	36.54	34.16	31.04	28.44	26.15	23.70	22.81	25.65	36.58	32.50	28.30	25.33	19.14	16.53	27.37	30.70
Wisconsin PS	16.28	16.05	15.44	15.48	16.52	26.11	38.98	39.15	37.21	37.10	34.83	32.46	29.71	27.70	25.75	24.41	24.35	27.82	37.51	33.07	28.89	26.00	22.27	19.34	27.18	30.51
Cleared Load (GW)	52.3	52.4	52.1	52.5	54.9	62.5	68.5	69.1	69.3	69.4	69.4	68.1	67.3	66.6	65.2	64.3	63.9	65.9	68.8	66.9	64.8	61.3	56.4	5.2		

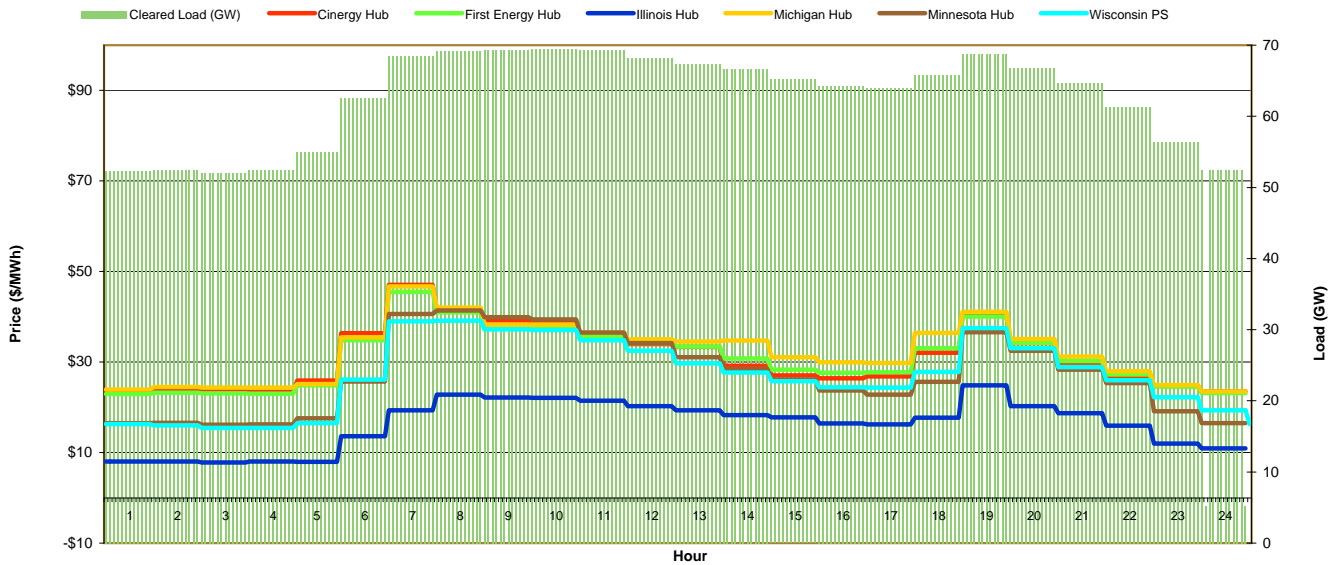

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	22.04	21.42	21.42	21.83	22.26	24.81	27.45	25.34	24.45	26.98	28.11	30.17	46.63	20.98	23.43	24.28	22.22	25.27	23.46	22.77	27.74	22.99	18.86	32.97	25.33	25.86
First Energy Hub	22.54	21.82	21.78	22.24	22.67	25.31	28.08	26.04	25.03	27.33	28.11	29.46	44.01	21.53	24.17	25.06	22.58	25.54	24.02	24.09	46.82	23.60	19.36	33.51	26.45	27.30
Illinois Hub	21.17	20.69	20.74	21.14	21.56	24.01	26.64	24.52	22.29	21.48	19.77	15.46	7.69	18.15	10.95	6.80	17.70	18.71	22.88	21.63	18.35	22.03	18.00	7.01	18.72	17.90
Michigan Hub	22.79	22.13	22.01	22.47	24.94	25.72	28.43	26.26	25.15	27.48	28.46	30.12	45.66	22.13	25.48	26.67	23.23	26.26	24.43	26.75	96.60	24.33	19.95	36.33	29.32	31.19
Minnesota Hub	22.05	21.12	20.95	20.98	21.11	23.74	27.56	48.59	27.15	25.10	26.82	20.07	15.46	19.95	18.93	13.71	17.89	18.72	23.74	22.29	22.86	30.33	21.00	10.69	22.63	23.29
Wisconsin PS	22.78	21.99	21.94	22.16	14.49	25.39	29.11	28.98	24.78	22.87	20.60	14.35	1.02	19.93	12.02	6.19	18.39	18.78	25.15	23.56	22.85	24.28	18.33	-2.54	19.06	18.88
Forecasted Load (GW)	56.6	55.3	54.8	54.9	56.3	60.4	66.5	68.8	68.8	68.7	68.1	67.2	66.2	65.2	63.8	63.0	62.8	62.8	65.3	65.2	64.2	61.7	58.2	54.9		
Forecast Error %	-3.1%	-3.3%	-3.4%	-2.9%	-1.3%	0.5%	0.2%	0.1%	-0.1%	-0.2%	-0.4%	-0.4%	-0.3%	-0.3%	-1.0%	-1.5%	-0.3%	0.5%	0.7%	0.0%	0.1%	0.0%	-9.0%			

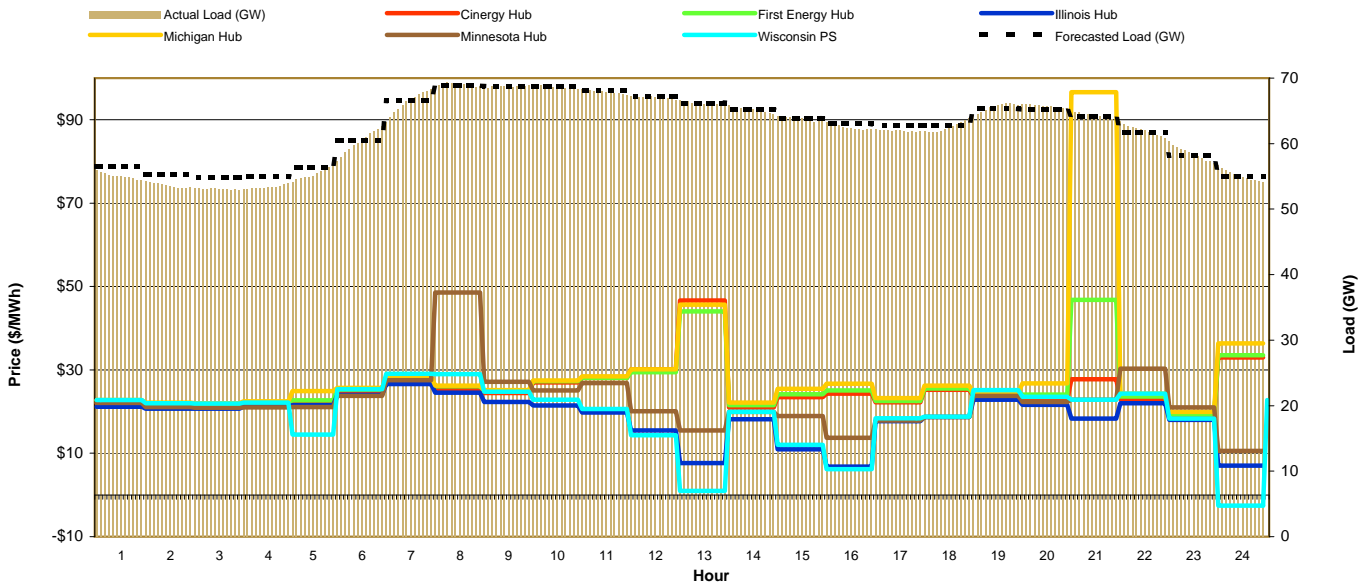




MISO Daily Report

Saturday October 30, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	24.11	24.15	23.73	23.87	23.36	25.13	28.51	29.34	31.75	31.52	31.68	29.35	26.36	25.13	24.58	24.61	25.00	29.53	35.87	31.33	28.46	25.05	22.47	22.19	26.96	28.25
First Energy Hub	25.00	25.20	24.94	25.03	24.33	26.02	29.77	30.44	33.05	32.81	32.98	30.55	27.43	26.16	25.58	25.62	26.02	30.73	37.49	32.80	29.62	26.07	22.99	22.93	28.07	29.40
Illinois Hub	20.45	20.31	18.95	18.99	18.48	21.23	23.22	25.33	30.49	30.26	30.42	28.18	25.31	24.13	23.60	23.63	24.00	28.35	34.42	30.05	27.33	24.05	21.96	19.53	24.69	26.97
Michigan Hub	25.67	26.40	26.11	26.07	24.79	26.49	30.63	31.23	33.84	33.59	33.77	31.28	28.09	26.78	26.19	26.23	26.64	31.47	38.39	33.58	30.33	26.70	23.24	23.25	28.78	30.08
Minnesota Hub	16.05	14.77	15.87	15.52	16.00	17.86	23.19	27.03	32.50	32.26	32.43	30.04	26.98	25.72	25.16	25.19	25.59	30.22	37.14	32.60	29.13	25.64	20.62	18.23	24.82	28.64
Wisconsin PS	18.45	17.69	17.36	17.08	17.17	19.82	23.18	26.99	32.65	32.40	32.57	30.18	27.10	25.85	25.29	25.32	25.72	30.36	37.03	32.40	29.26	25.76	22.59	19.51	25.49	28.84
Cleared Load (GW)	51.0	50.4	49.8	49.7	49.8	52.7	57.0	58.7	60.1	60.9	60.5	59.3	58.5	57.4	56.6	56.7	56.8	59.3	62.8	60.9	59.0	56.5	52.7	5.0		

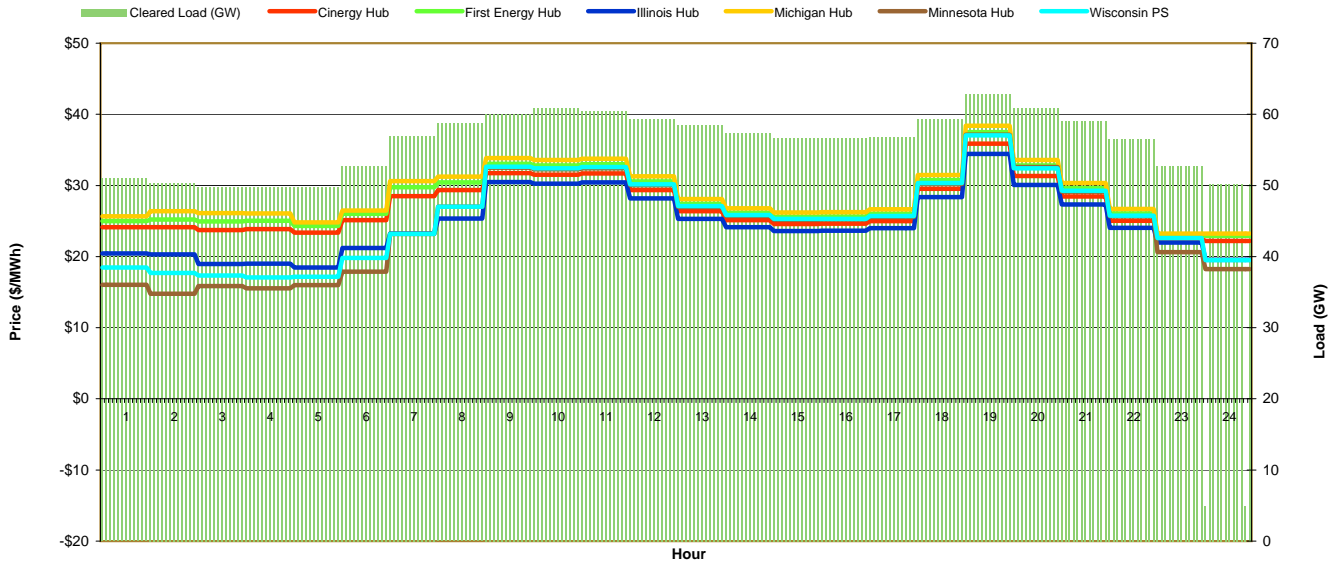

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	39.48	26.11	25.24	31.99	29.67	42.69	34.29	40.32	36.48	32.66	35.67	28.19	22.71	21.66	22.16	23.19	23.07	24.24	24.78	27.71	22.42	21.37	19.82	20.49	28.18	26.65
First Energy Hub	40.97	27.20	25.83	32.87	30.66	44.02	34.49	41.60	36.82	33.56	36.74	29.01	23.36	22.25	22.75	23.28	23.62	24.93	25.51	28.55	23.09	21.91	20.28	20.86	28.92	27.33
Illinois Hub	10.11	17.49	15.34	17.82	12.86	24.43	30.20	20.88	31.79	31.12	33.93	26.88	21.62	20.62	21.07	20.78	21.95	23.29	23.86	26.68	21.50	20.52	19.04	19.75	22.23	24.10
Michigan Hub	43.27	28.04	26.94	34.29	32.14	47.97	37.98	43.60	40.36	34.15	37.41	29.55	23.89	22.80	23.27	26.12	24.53	25.50	26.00	29.21	23.67	22.43	20.73	21.27	30.21	28.33
Minnesota Hub	-16.38	7.85	1.73	13.01	11.93	23.84	28.33	21.20	32.85	33.79	37.64	29.63	23.23	21.45	21.42	21.87	22.55	24.54	26.24	29.42	23.08	21.64	18.59	15.80	20.64	25.57
Wisconsin PS	1.34	14.79	13.12	14.32	9.69	18.99	28.74	18.46	31.34	33.75	37.03	29.26	23.34	22.00	22.25	19.90	22.91	24.98	26.16	29.19	23.18	21.90	19.91	19.93	21.93	25.34
Forecasted Load (GW)	54.1	53.0	52.3	52.1	52.1	54.4	56.8	58.0	58.8	59.7	59.5	58.9	58.1	57.2	56.3	55.9	56.3	57.5	60.4	60.4	59.3	57.1	53.9	52.3		
Forecast Error %	-2.6%	-3.4%	-3.2%	-3.1%	-1.6%	-2.3%	-1.3%	0.6%	2.0%	2.1%	2.0%	1.5%	0.9%	0.6%	0.5%	0.8%	0.3%	0.0%	0.1%	-0.1%	-1.0%	-1.1%	-1.0%	-3.0%		

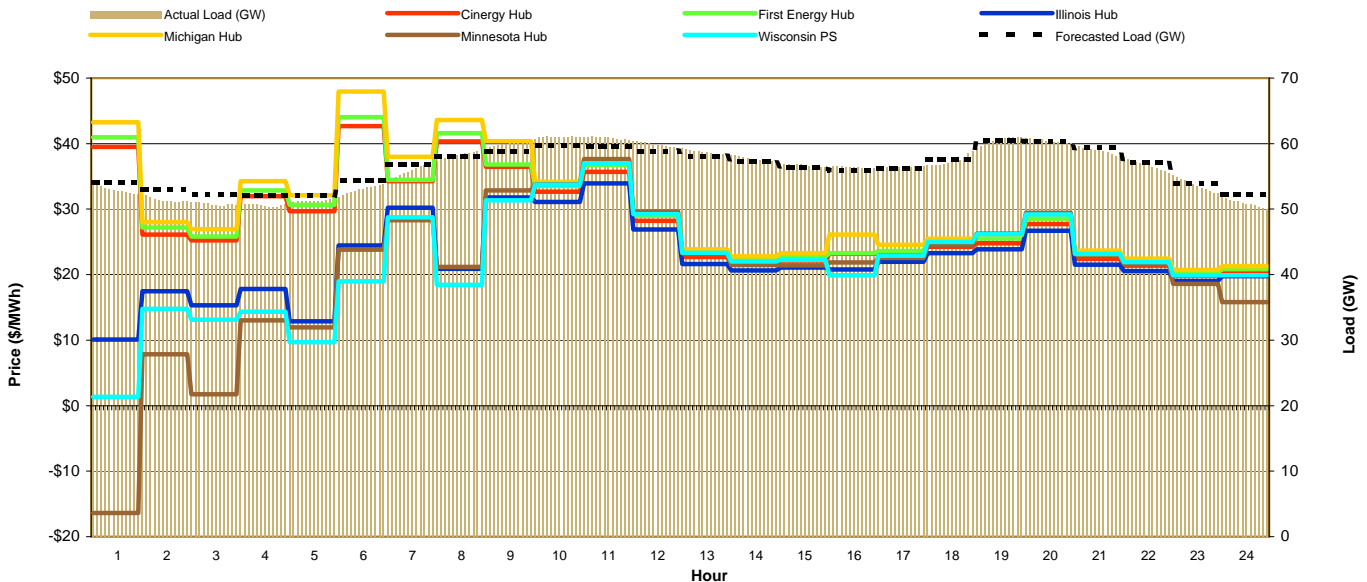




MISO Daily Report

Sunday October 31, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%

Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	23.24	23.33	23.11	22.84	23.13	23.62	23.51	24.21	26.54	26.84	26.16	25.13	24.92	24.42	23.91	24.33	25.18	29.97	42.00	32.35	30.20	25.45	22.55	21.81	25.78	27.14
First Energy Hub	23.48	23.27	22.84	22.69	22.79	23.26	24.52	25.20	27.35	27.65	27.10	26.16	25.93	25.42	24.89	25.33	26.18	31.22	43.80	33.84	31.48	26.50	23.12	22.60	26.53	28.20
Illinois Hub	11.16	12.00	10.21	12.00	11.20	10.89	22.10	23.24	24.10	24.37	24.52	24.13	23.92	23.45	22.96	23.36	24.04	28.75	40.20	30.85	28.93	24.45	21.49	18.64	21.71	25.80
Michigan Hub	23.91	23.38	23.29	23.13	23.18	23.30	25.14	25.80	27.99	28.30	27.75	26.78	26.55	26.02	25.48	25.93	26.80	31.98	44.89	34.68	32.27	27.13	23.38	22.93	27.08	28.86
Minnesota Hub	15.36	14.26	13.61	13.71	15.19	16.64	21.96	24.78	26.33	26.63	26.41	25.72	25.50	25.00	24.47	24.91	25.69	32.84	47.75	43.93	33.42	26.06	20.29	17.27	24.49	28.73
Wisconsin PS	17.03	16.00	15.06	15.16	16.41	18.23	21.27	24.92	26.56	26.85	26.58	25.85	25.63	25.11	24.61	25.04	25.82	30.91	43.94	34.40	31.45	26.18	22.16	18.29	24.31	27.87
Cleared Load (GW)	48.2	47.2	46.5	46.5	47.5	49.2	51.8	53.7	56.1	56.9	56.1	55.7	55.1	54.6	54.9	55.6	60.1	63.7	62.9	60.5	57.6	53.5	5.0			

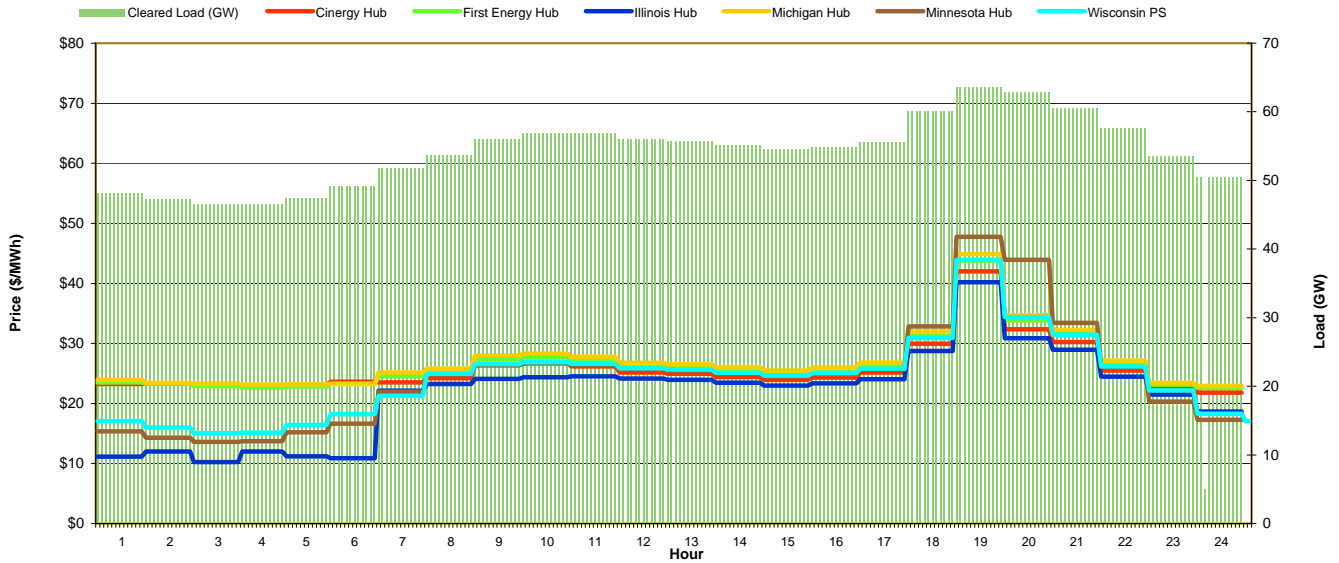

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$		
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk	
Cinergy Hub	20.21	23.93	20.09	18.01	24.84	25.06	24.13	23.80	25.26	25.37	24.59	24.51	25.46	25.84	26.52	26.16	25.35	21.90	24.94	24.74	29.46	23.69	22.07	24.56	24.19	24.98	
First Energy Hub	20.56	24.51	20.40	18.21	25.33	24.69	24.26	24.22	25.79	25.92	25.20	25.11	26.09	26.51	27.27	26.89	26.12	22.63	25.73	25.51	30.30	24.34	22.64	38.06	25.26	25.64	
Illinois Hub	19.42	14.00	17.47	17.35	17.36	21.58	20.08	21.82	23.90	24.47	23.73	23.74	24.67	25.10	25.71	25.32	24.51	21.20	24.08	23.85	28.38	22.86	21.35	17.65	22.07	24.04	
Michigan Hub	21.01	25.53	20.89	18.58	26.28	28.94	26.58	25.28	26.57	26.74	26.00	25.95	27.00	27.34	28.13	27.70	26.85	23.23	26.42	26.31	31.38	25.25	23.51	73.57	27.71	26.48	
Minnesota Hub	13.61	12.94	17.02	17.00	16.63	22.52	20.40	22.25	24.69	25.73	24.88	24.69	25.55	25.81	26.43	26.06	25.30	22.01	25.79	25.26	29.53	23.47	21.22	17.45	22.34	24.92	
Wisconsin PS	19.97	12.20	17.40	17.72	16.14	18.72	18.80	22.28	24.99	25.94	25.21	25.25	26.24	26.54	27.11	26.62	25.79	22.40	26.14	25.61	30.07	24.01	22.15	17.79	22.71	25.39	
Forecasted Load (GW)	51.0	48.8	48.2	48.2	49.7	51.3	52.5	53.7	55.7	55.8	56.0	55.9	55.8	55.2	54.8	54.9	55.6	57.5	61.1	61.6	60.5	58.1	55.0	52.8			
Forecast Error %	-13.0%	-2.1%	-2.2%	-2.5%	-4.3%	-4.9%	-2.4%	-1.4%	-2.0%	-0.4%	-0.3%	0.1%	0.1%	0.2%	0.4%	0.4%	0.0%	-0.5%	0.0%	0.0%	-1.7%	-2.0%	-1.5%	-0.7%	-0.3%	-0.1%	-9.9%

