




# MISO Daily Report

Tuesday February 1, 2011

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	Hour																								Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	28.29	26.42	26.19	25.92	26.14	27.96	36.80	46.14	45.40	46.12	45.18	44.52	40.31	37.48	34.69	32.73	33.38	39.48	49.60	46.72	43.10	35.07	31.85	30.43	36.66	40.74
First Energy Hub	29.74	28.37	27.96	27.56	27.73	29.39	37.40	47.83	46.81	47.63	46.68	46.03	41.66	38.89	36.06	34.08	34.78	40.71	51.30	48.14	44.49	36.16	32.60	29.79	37.99	42.12
Illinois Hub	19.47	18.98	19.03	19.47	19.04	21.02	28.89	41.79	42.81	44.21	43.57	41.11	37.01	32.86	28.99	26.68	27.86	36.02	48.06	43.97	39.38	32.31	27.88	22.18	31.77	37.16
Michigan Hub	35.03	32.76	31.77	30.78	30.70	31.95	37.64	48.07	46.82	47.65	46.68	46.15	41.74	39.12	36.37	34.39	35.03	40.84	51.30	48.16	44.60	36.18	33.33	32.15	39.13	42.28
Minnesota Hub	20.21	19.62	18.74	17.87	17.00	17.27	21.10	33.26	39.76	41.91	43.05	41.47	36.85	32.33	28.21	24.23	23.95	32.37	46.87	42.56	38.65	32.27	21.41	20.67	29.65	34.95
Wisconsin PS	20.94	19.47	18.57	18.51	18.31	20.54	27.43	39.70	46.58	46.17	46.97	43.35	41.53	36.23	31.90	29.11	29.87	35.51	53.81	46.82	41.12	33.86	29.40	25.20	33.37	39.49
Cleared Load (GW)	66.1	64.6	64.0	63.8	64.9	67.9	74.2	80.1	80.6	81.0	81.4	80.7	80.5	80.2	79.3	78.5	78.9	81.3	84.6	82.7	81.6	79.5	74.9	7.0		

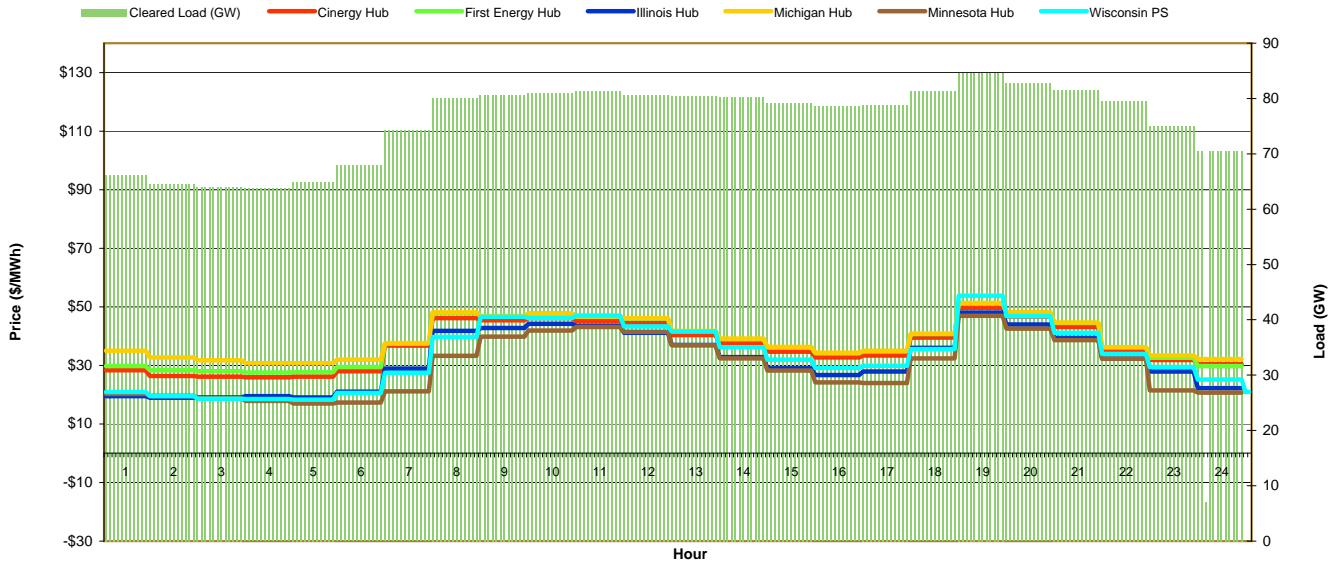

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	Hour																								Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	23.46	23.31	23.60	25.09	25.64	28.53	39.94	51.50	32.27	39.32	34.27	34.83	86.36	56.53	31.61	27.92	31.09	32.05	32.74	34.45	29.80	26.07	23.51	29.22	34.30	37.77
First Energy Hub	24.01	23.84	24.11	25.71	26.26	28.95	40.51	52.29	32.90	40.22	35.11	37.13	91.44	62.09	40.32	33.60	34.40	33.66	35.49	35.33	30.59	26.94	26.17	47.77	37.04	40.48
Illinois Hub	22.76	22.59	22.82	24.16	24.03	26.45	38.23	49.83	31.27	38.09	33.13	35.10	86.62	58.96	38.23	31.82	32.52	31.86	33.83	33.99	29.57	25.99	25.19	18.29	33.97	38.50
Michigan Hub	25.03	24.87	25.07	26.67	27.30	30.00	42.12	54.21	33.88	41.55	36.32	38.58	94.74	64.21	41.53	34.47	35.30	34.39	36.22	36.22	31.55	27.98	27.19	131.81	41.72	41.77
Minnesota Hub	18.36	19.78	18.97	16.67	9.22	1.64	21.08	44.42	27.58	24.92	26.81	30.86	56.63	34.78	18.50	15.60	21.64	10.36	22.43	30.04	18.20	20.50	6.40	14.05	22.06	25.60
Wisconsin PS	25.76	24.48	21.80	18.24	19.33	-20.13	-2.88	33.24	26.35	30.24	32.95	33.01	41.09	37.38	37.11	30.58	29.91	31.80	36.53	35.19	31.55	27.32	29.04	18.79	26.19	32.70
Forecasted Load (GW)	68.5	66.9	65.8	66.4	67.1	68.9	74.2	78.9	80.5	80.5	80.4	79.9	79.2	78.6	78.0	77.3	77.2	78.7	82.3	83.3	82.2	79.9	76.4	72.7		
Forecast Error %	-9.3%	-0.4%	-0.6%	-2.1%	-1.9%	-1.2%	-0.7%	-0.5%	0.3%	1.2%	2.1%	3.0%	3.4%	3.9%	3.6%	3.5%	3.3%	2.5%	0.6%	-0.9%	-1.8%	-2.0%	-11.3%			

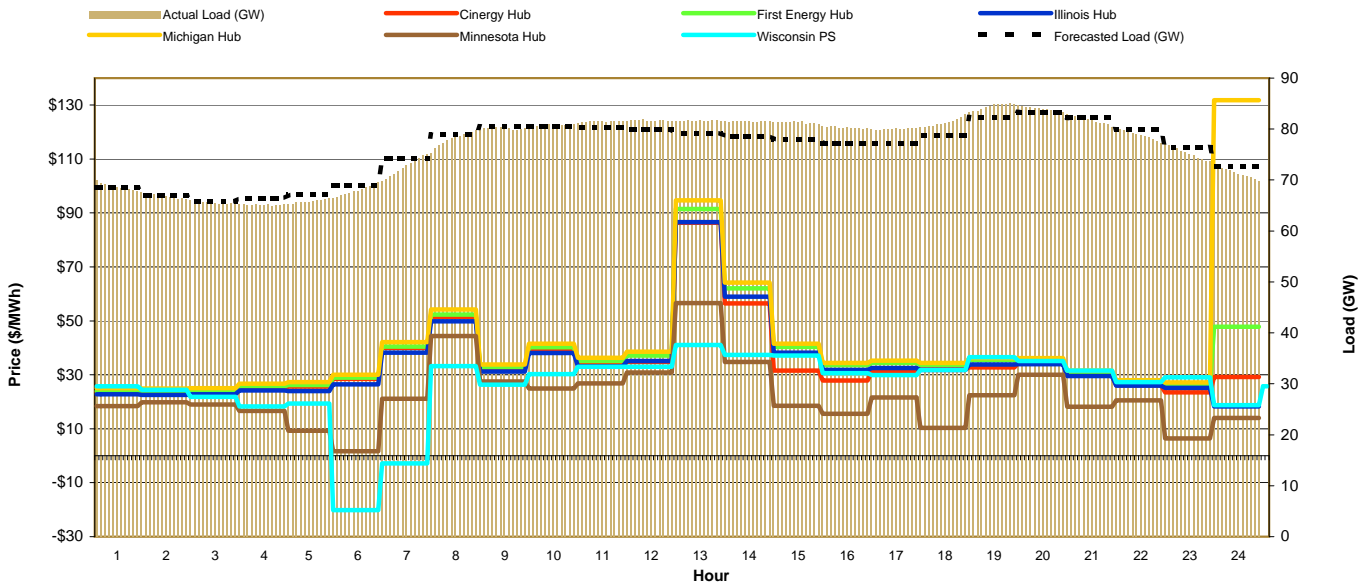




# MISO Daily Report

Wednesday February 2, 2011

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	26.21	25.79	25.48	25.28	25.34	26.25	33.55	44.25	44.72	43.29	43.58	43.66	40.81	36.68	35.26	32.53	33.87	42.42	53.45	49.68	48.75	42.93	34.15	30.82	37.03	41.88
First Energy Hub	28.23	27.57	27.17	26.92	26.58	27.39	34.57	45.65	46.18	44.70	45.00	44.98	42.13	37.87	36.38	33.66	34.95	43.76	55.21	51.28	50.29	44.24	35.25	31.94	38.41	43.22
Illinois Hub	21.25	20.96	20.81	21.00	21.18	22.37	32.05	42.91	43.28	41.89	42.17	42.27	39.49	35.50	34.12	31.49	32.78	41.06	51.73	48.08	47.17	41.52	33.12	29.83	34.92	40.54
Michigan Hub	32.87	31.42	30.86	30.54	29.11	29.45	34.60	45.85	46.19	44.67	44.96	45.31	42.07	37.88	36.40	33.68	34.98	43.81	55.21	51.31	50.34	44.29	36.21	33.14	39.38	43.32
Minnesota Hub	16.58	16.88	15.53	14.75	14.18	15.43	23.97	36.09	43.81	42.73	42.87	41.62	38.66	33.71	30.75	28.13	29.68	36.69	50.11	44.91	43.15	35.84	23.28	21.91	30.89	37.63
Wisconsin PS	22.79	21.78	20.92	20.30	20.35	21.80	30.12	36.69	44.83	44.66	44.44	43.50	39.90	35.55	33.81	30.71	31.29	36.92	57.25	47.56	43.06	36.41	31.22	27.99	34.32	39.86
Cleared Load (GW)	66.8	65.3	64.7	64.5	64.7	67.4	74.4	81.6	82.1	82.6	82.5	81.7	81.4	80.9	79.9	78.8	79.2	81.9	84.8	84.7	83.0	81.2	77.4	7.3		

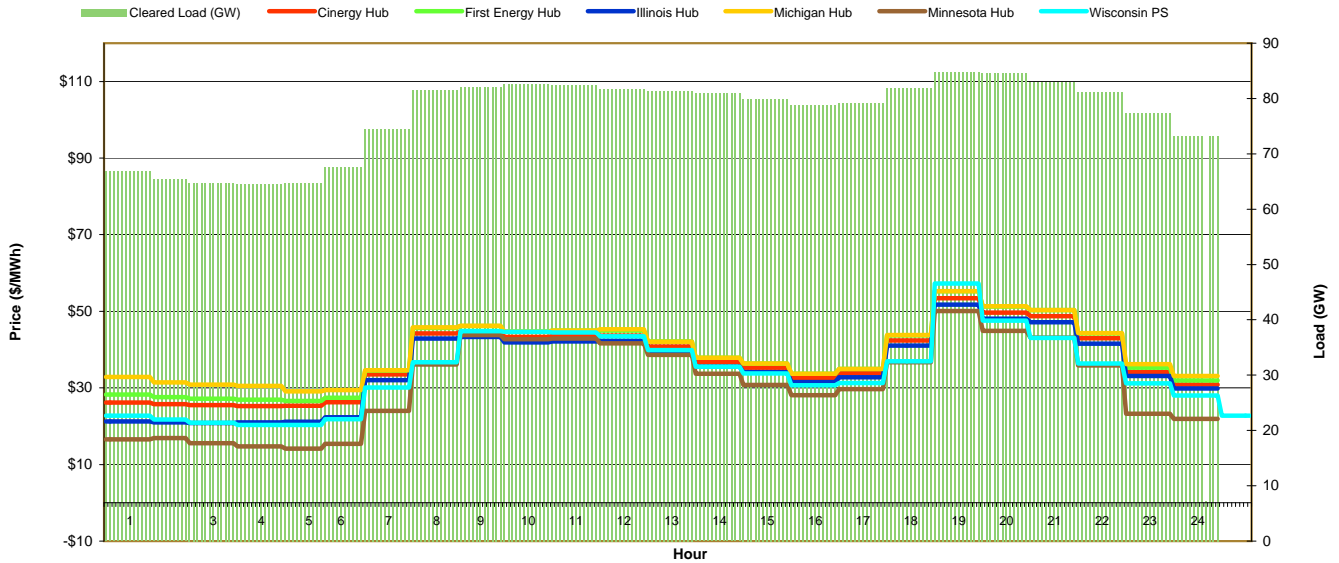

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	22.73	25.20	22.22	20.44	18.46	19.67	17.68	20.73	22.65	23.61	24.26	25.96	26.42	27.98	27.13	27.87	26.06	24.94	33.88	31.14	28.98	28.39	25.26	24.53	24.84	26.58
First Energy Hub	38.60	38.65	22.58	20.96	18.95	20.17	18.12	21.21	23.22	24.28	25.05	26.86	27.40	28.63	28.09	29.49	27.14	25.84	35.08	32.01	29.82	29.16	26.02	25.11	26.77	27.46
Illinois Hub	11.43	15.07	19.08	19.98	17.99	18.95	16.63	20.05	21.92	22.82	23.41	24.94	25.36	22.32	26.03	27.35	25.27	24.25	33.09	30.48	28.36	27.77	24.84	24.04	22.98	25.52
Michigan Hub	118.12	105.52	22.09	21.58	19.41	20.51	18.36	21.45	23.39	24.42	25.41	27.36	27.88	29.15	28.69	30.14	27.60	26.14	35.56	32.46	30.26	29.77	26.60	25.90	33.24	27.89
Minnesota Hub	14.43	16.83	-8.99	7.61	16.71	17.47	25.54	24.95	24.02	24.32	24.34	25.67	26.09	27.07	26.70	28.23	25.46	25.11	34.43	32.70	30.00	27.28	25.70	20.56	22.69	27.00
Wisconsin PS	12.50	17.14	16.50	26.32	19.32	19.78	16.79	21.50	23.58	24.53	25.09	26.49	26.65	27.30	27.09	28.14	24.81	25.82	35.37	32.42	30.06	29.71	26.30	27.24	24.60	27.18
Forecasted Load (GW)	69.7	67.9	67.9	67.6	68.3	70.5	74.1	79.6	81.2	81.5	81.3	81.1	80.6	80.1	79.6	79.1	79.0	80.0	83.6	85.1	84.4	82.3	79.3	75.3		
Forecast Error %	-62.5%	-2.7%	-4.2%	-4.2%	-4.5%	-5.2%	-5.2%	-6.9%	-6.5%	-5.7%	-4.5%	-3.9%	-3.6%	-3.6%	-3.8%	-3.9%	-3.8%	-2.9%	-1.6%	-1.8%	-2.7%	-3.1%	-12.4%			

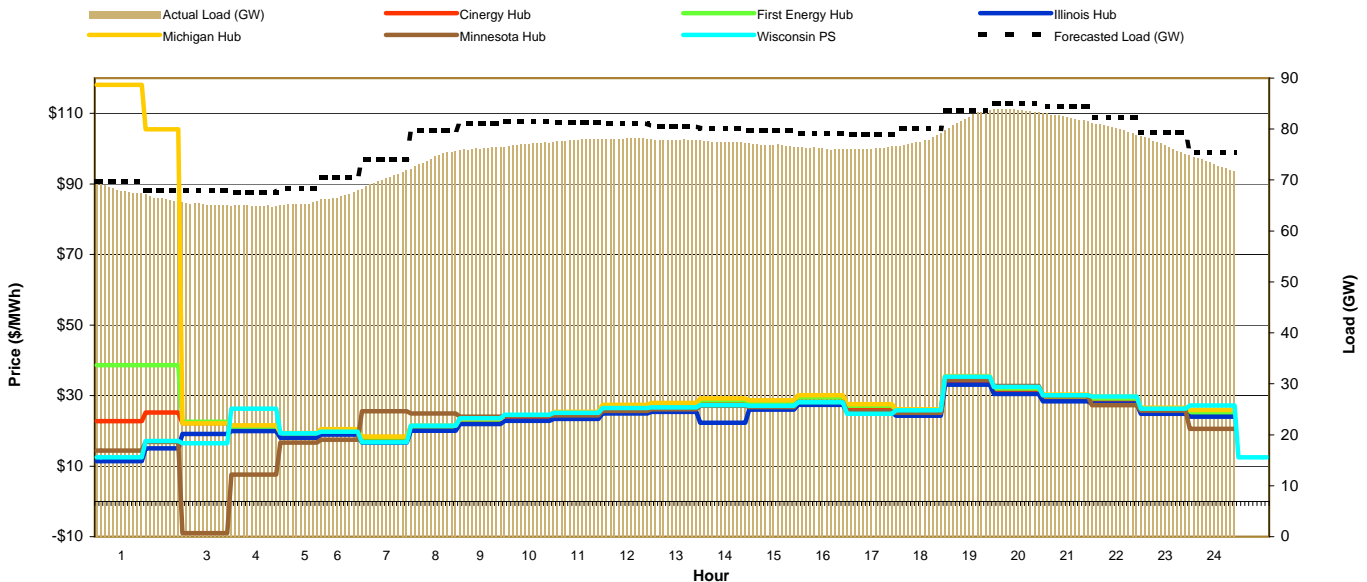




# MISO Daily Report

Thursday February 3, 2011

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	27.89	27.26	26.89	26.83	27.17	29.64	40.00	50.72	47.60	49.00	47.61	44.33	39.62	37.37	34.46	32.33	32.70	40.04	51.62	50.17	46.39	42.86	36.17	29.31	38.25	42.69
First Energy Hub	30.16	29.28	28.72	28.66	28.74	30.69	41.33	52.27	49.11	50.50	49.07	45.71	40.85	38.52	35.62	33.41	33.86	41.26	53.27	51.78	47.86	44.15	37.66	31.66	39.76	44.06
Illinois Hub	25.55	25.03	24.81	24.76	25.21	27.85	35.93	47.50	45.13	46.00	44.68	41.81	37.33	35.27	32.59	30.61	31.01	37.82	49.35	47.91	44.11	40.67	34.23	27.37	35.94	40.38
Michigan Hub	37.26	35.26	33.84	33.80	32.61	31.81	40.97	51.67	48.69	49.90	48.50	45.25	40.42	38.15	35.27	33.11	33.56	40.89	53.01	51.50	47.52	43.82	39.89	38.06	41.03	43.82
Minnesota Hub	16.74	15.44	14.93	14.21	14.15	14.45	20.85	28.25	27.98	25.83	25.76	24.41	21.48	21.21	20.96	20.47	20.49	21.57	33.63	36.59	31.86	25.93	20.86	19.29	22.39	25.46
Wisconsin PS	27.04	26.35	25.74	25.46	25.56	26.23	30.35	46.26	50.97	49.58	47.95	45.81	40.02	36.47	35.05	32.14	31.69	36.82	56.88	53.01	48.36	41.36	33.97	28.58	37.57	42.89
Cleared Load (GW)	70.9	69.2	68.4	68.3	69.0	71.5	78.2	84.6	84.3	83.7	83.7	83.2	82.3	81.0	79.8	78.6	78.5	81.7	85.2	84.7	84.0	82.1	78.3	7.4		

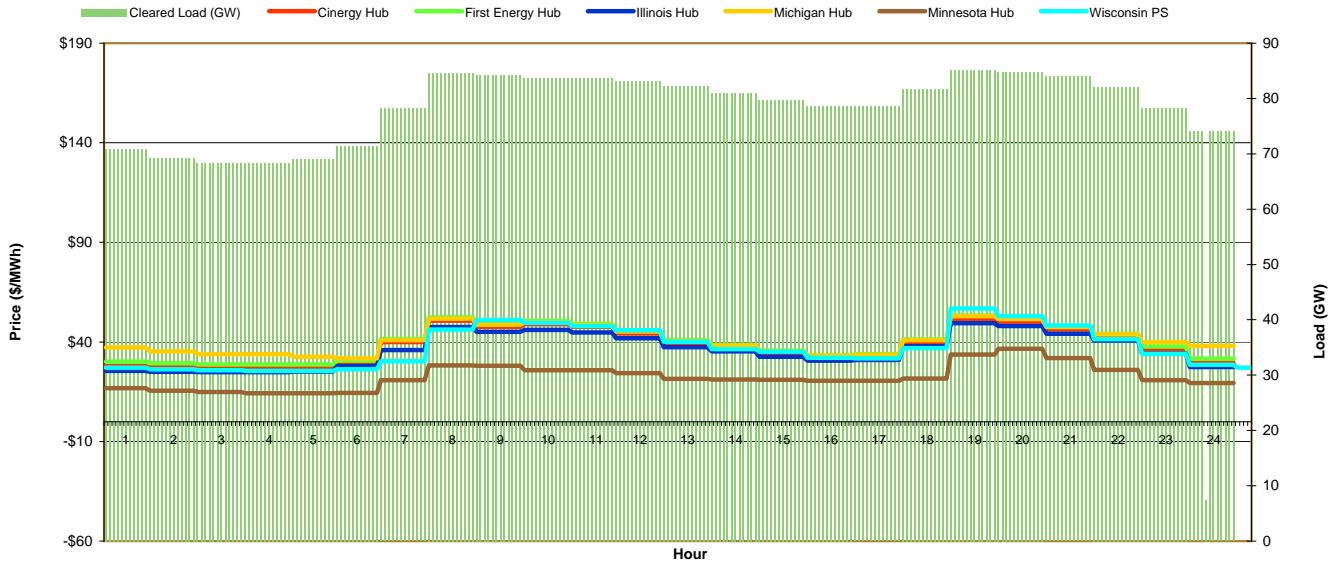

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	24.75	26.18	27.66	26.56	25.71	32.73	44.98	48.74	46.09	46.35	42.05	42.11	35.27	28.53	28.55	25.29	26.54	28.88	178.07	64.84	31.68	48.57	31.54	35.14	41.53	47.07
First Energy Hub	25.23	26.71	27.87	26.91	25.77	33.06	45.67	49.63	46.88	47.08	42.75	42.80	35.89	29.17	29.19	25.83	27.07	29.46	181.56	65.97	32.44	49.62	32.24	35.45	42.26	47.97
Illinois Hub	24.10	25.30	22.85	23.38	19.75	27.85	40.15	45.64	43.37	43.78	39.79	40.23	34.07	28.10	28.04	24.81	25.97	27.07	168.08	59.41	30.98	47.13	29.46	28.25	36.65	44.75
Michigan Hub	26.11	27.62	27.10	26.80	24.34	32.38	45.67	50.15	47.14	47.60	43.52	43.52	36.83	30.17	30.22	26.67	27.96	30.06	184.56	66.45	33.61	51.33	32.90	34.12	42.78	48.92
Minnesota Hub	17.84	21.28	-28.43	-10.14	-53.53	-18.88	3.73	25.76	22.24	-3.88	16.75	-0.35	11.42	2.29	18.23	16.46	17.44	9.93	79.83	23.89	29.38	33.29	18.84	-18.69	9.78	20.10
Wisconsin PS	27.48	26.27	21.98	24.30	20.54	23.91	34.93	44.09	43.17	49.68	40.49	44.33	39.43	37.00	32.09	28.77	20.80	27.49	71.03	37.62	29.57	27.24	26.34	7.54	32.75	37.44
Forecasted Load (GW)	72.2	69.6	68.9	68.6	70.2	70.9	75.7	80.7	81.9	82.1	81.7	80.6	79.4	78.4	77.2	76.7	76.7	77.5	81.3	83.3	82.7	80.9	77.8	73.7		
Forecast Error %	-31.0%	-1.3%	-1.2%	-0.9%	-1.9%	0.9%	1.0%	2.0%	2.2%	1.3%	1.0%	0.7%	0.6%	0.7%	1.0%	0.0%	-0.5%	0.0%	0.8%	1.0%	0.6%	0.6%	0.2%	-8.5%		

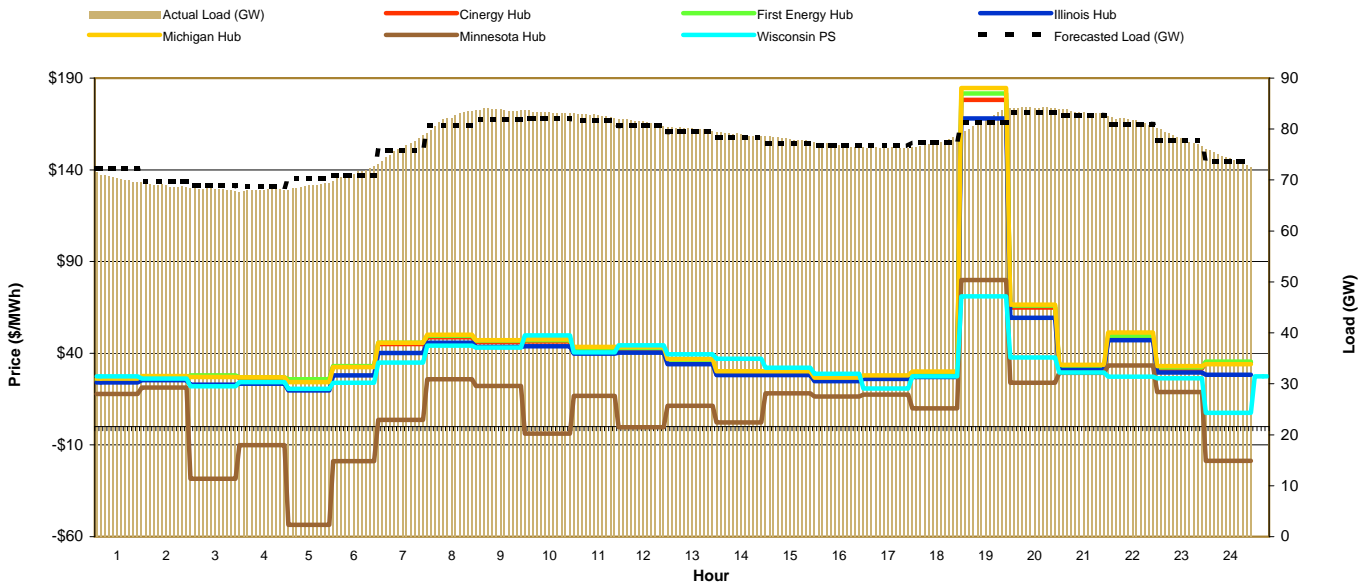




# MISO Daily Report

Friday February 4, 2011

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	35.00	35.00	34.26	33.94	34.71	39.13	51.88	56.14	52.45	52.13	51.18	47.49	40.71	36.17	32.31	30.75	31.00	35.62	46.91	43.25	39.47	36.09	31.87	30.05	39.90	41.47
First Energy Hub	34.88	33.90	32.74	33.19	33.79	37.15	53.15	57.67	53.83	53.55	52.57	48.79	41.85	38.07	33.66	32.00	32.12	36.67	48.33	44.56	40.68	37.39	32.34	30.48	40.56	42.76
Illinois Hub	28.16	27.82	27.11	27.12	27.61	28.77	41.17	61.49	49.81	49.09	48.24	44.66	38.33	33.85	30.50	29.09	29.40	35.62	44.79	41.61	37.83	34.49	30.68	26.52	36.41	39.97
Michigan Hub	37.83	37.31	36.31	36.20	37.79	40.81	53.01	57.26	53.33	53.00	52.02	48.28	41.42	40.01	34.50	32.73	32.52	36.57	48.08	44.41	40.54	37.84	35.06	35.06	41.75	42.97
Minnesota Hub	13.13	12.14	9.05	8.99	7.98	7.59	19.90	23.19	23.54	22.68	23.31	22.01	21.37	20.91	19.73	19.87	20.03	21.25	29.19	29.19	26.38	23.27	20.34	18.26	19.30	22.89
Wisconsin PS	25.79	25.30	24.57	24.64	24.31	25.76	31.00	47.03	48.07	49.58	47.96	45.71	40.81	36.60	33.48	31.07	30.59	35.69	51.87	47.55	43.81	38.71	31.58	27.08	36.19	41.25
Cleared Load (GW)	69.2	67.7	66.9	66.9	67.9	70.3	75.7	81.2	81.5	80.7	80.3	79.1	78.3	77.0	75.7	74.2	74.1	76.1	79.4	78.1	77.2	75.0	72.1	6.8		

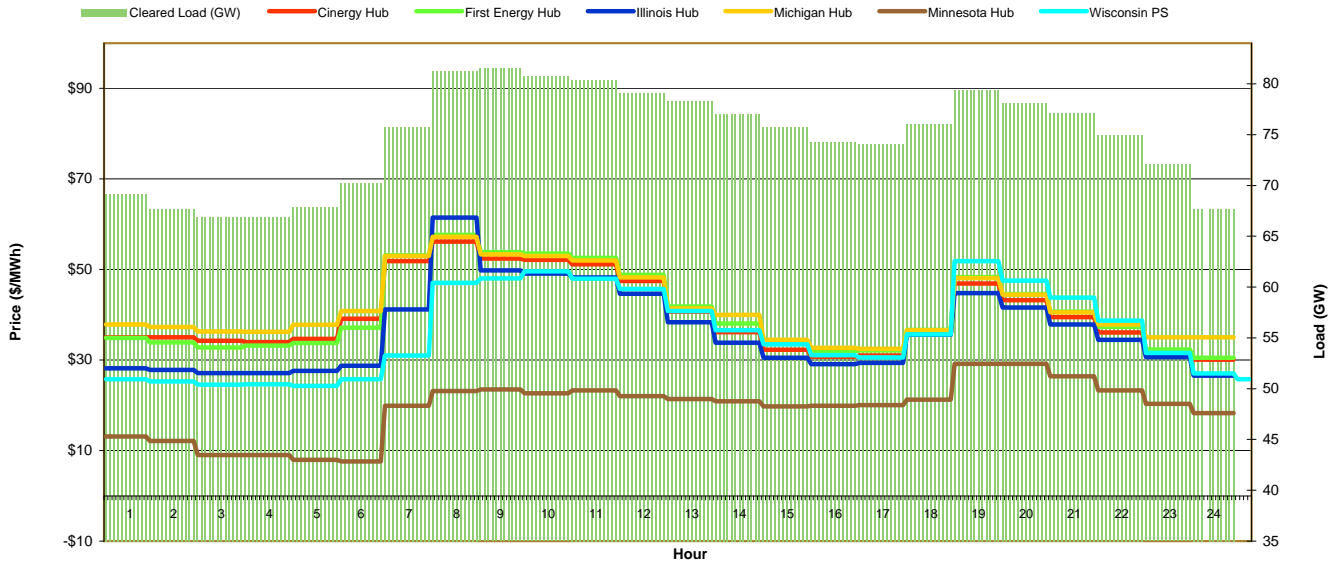

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	26.98	33.06	28.47	26.86	30.06	29.12	69.38	84.03	36.20	32.93	58.12	37.40	30.85	32.72	25.14	28.66	25.92	27.56	90.56	37.67	33.82	32.91	28.41	25.59	38.02	40.18
First Energy Hub	27.51	27.80	25.41	22.67	25.20	21.60	69.85	73.78	35.07	33.74	59.92	37.07	32.15	34.23	23.03	24.98	22.17	22.49	92.99	37.77	34.70	33.77	27.93	23.05	36.20	39.11
Illinois Hub	24.55	28.15	24.78	25.54	27.84	27.08	63.90	78.76	32.76	31.34	53.51	35.52	30.42	33.00	25.70	27.73	25.05	26.60	87.77	36.71	32.95	32.00	27.59	24.75	36.00	38.59
Michigan Hub	27.80	32.95	29.05	28.61	31.19	30.01	70.84	86.45	36.63	34.56	60.50	39.54	33.43	36.47	28.36	30.63	27.69	29.25	96.24	40.16	36.25	35.24	30.40	27.42	39.99	42.61
Minnesota Hub	12.03	-3.54	-1.97	18.60	18.72	19.11	41.65	59.91	14.36	27.45	23.85	26.95	22.87	20.73	22.47	20.78	23.32	25.06	83.57	35.46	31.38	30.25	26.28	23.65	25.96	30.92
Wisconsin PS	20.28	16.17	13.53	23.79	25.24	24.84	57.43	76.37	26.90	32.11	43.80	34.32	31.66	20.06	27.06	18.14	26.05	27.92	92.94	38.89	34.46	33.37	28.85	25.93	33.34	37.05
Forecasted Load (GW)	71.3	70.6	68.8	68.6	69.2	72.4	76.8	81.0	82.2	81.5	80.7	79.4	78.3	76.9	75.6	74.4	74.0	75.2	78.1	78.9	77.8	76.0	73.4	69.1		
Forecast Error %	-27.8%	-1.9%	-0.3%	-0.6%	-0.8%	-1.8%	-1.1%	0.6%	0.6%	0.6%	0.7%	0.8%	0.0%	0.0%	-0.3%	-0.5%	-0.9%	-1.6%	-0.6%	-0.4%	-0.5%	-0.6%	-0.8%	-9.8%		

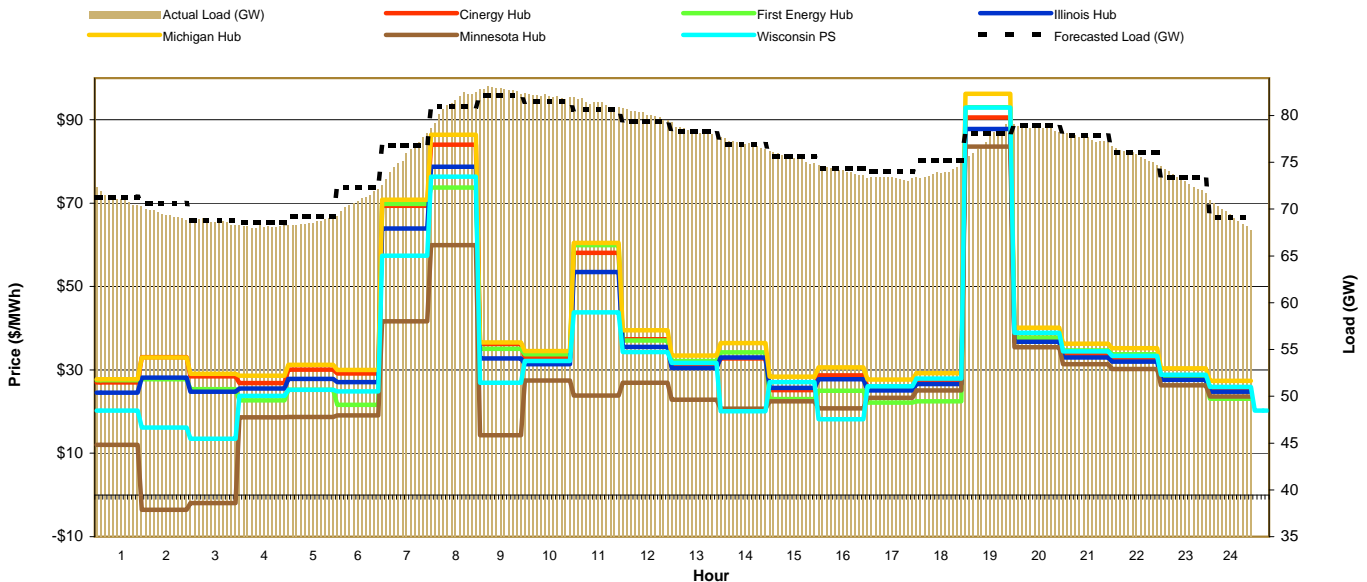




# MISO Daily Report

Saturday February 5, 2011

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	30.16	30.65	29.45	28.49	28.06	28.81	30.46	35.01	36.15	38.86	44.08	39.03	35.88	31.88	30.61	29.69	30.96	36.95	48.65	45.33	40.21	35.74	30.59	30.01	34.40	36.85
First Energy Hub	29.03	28.79	27.82	27.23	26.88	27.36	30.03	32.83	36.33	39.48	45.10	39.94	35.50	31.79	30.68	30.12	30.86	36.31	49.71	45.93	40.10	36.10	31.00	29.10	34.08	36.99
Illinois Hub	23.42	25.00	24.82	23.15	22.69	25.15	26.64	29.71	30.92	37.17	42.11	37.44	30.62	26.45	25.17	24.69	25.04	30.82	45.63	38.94	34.58	29.62	26.35	23.33	29.56	32.20
Michigan Hub	33.26	32.48	30.69	29.92	29.16	29.85	31.56	36.16	37.48	41.83	46.62	41.41	38.28	33.19	32.71	32.15	33.12	39.42	51.01	47.18	42.22	37.03	31.83	30.73	36.22	38.85
Minnesota Hub	19.28	18.78	17.92	17.65	17.21	18.39	20.50	23.66	26.98	33.18	37.85	34.76	28.38	24.50	22.98	21.68	21.55	24.25	34.73	33.05	26.83	23.84	20.36	19.52	24.49	27.41
Wisconsin PS	24.78	23.95	23.33	22.42	21.96	23.25	25.44	27.31	31.09	37.52	42.59	38.41	32.62	28.54	27.09	25.94	26.43	29.06	43.30	40.51	34.12	30.30	25.77	25.09	29.61	32.53
Cleared Load (GW)	63.3	61.5	60.0	59.4	59.2	61.0	64.5	67.5	69.2	71.3	71.5	70.9	69.9	68.6	67.9	67.0	67.5	70.2	73.9	72.9	71.9	70.4	67.2	64		

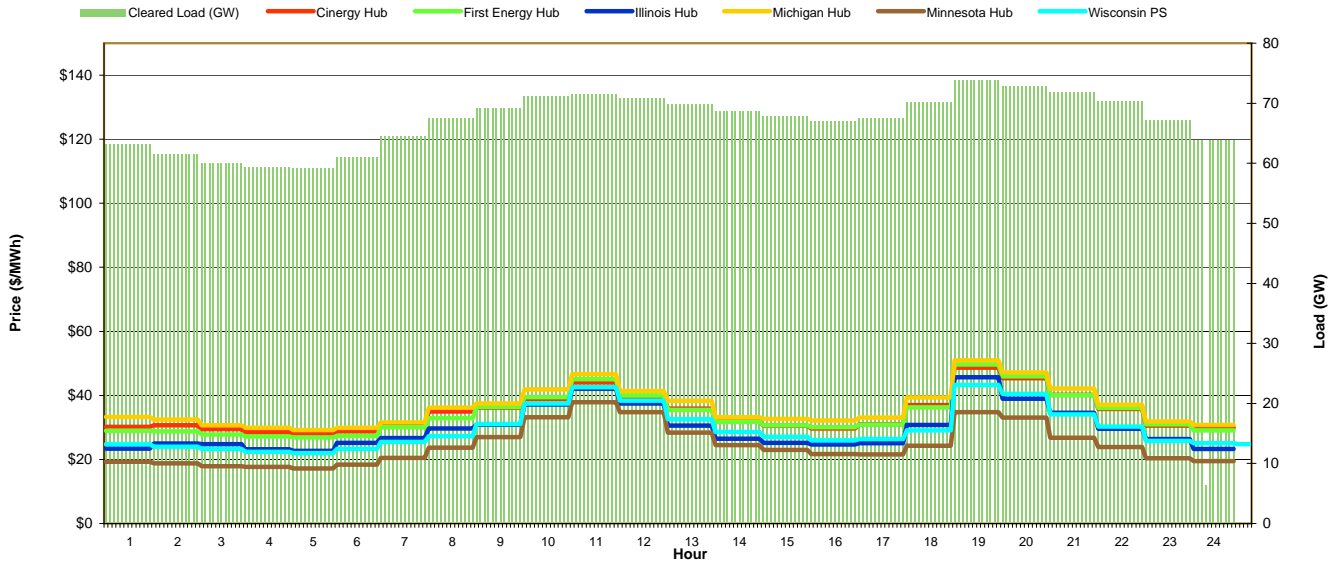

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	21.97	25.42	34.41	28.25	26.36	26.90	46.90	134.27	37.47	91.49	80.56	44.23	68.36	38.82	31.93	29.78	30.06	30.51	78.13	58.86	68.30	42.28	27.16	26.55	47.04	55.76
First Energy Hub	22.49	26.02	35.18	28.81	24.41	27.42	47.77	136.76	37.99	92.86	81.92	44.86	69.43	37.35	28.63	24.87	27.60	21.07	80.30	60.39	69.96	43.26	27.82	24.84	46.75	55.32
Illinois Hub	21.29	24.52	33.15	27.18	25.41	25.96	45.27	129.60	36.31	88.86	78.33	42.93	66.31	37.62	30.80	28.68	28.88	29.33	75.54	57.13	66.22	40.93	26.18	25.73	45.51	53.98
Michigan Hub	23.40	27.15	36.68	30.04	28.00	28.52	49.56	141.76	39.10	95.03	83.52	45.91	71.31	40.52	33.44	31.29	31.66	31.97	81.69	61.30	71.69	44.56	28.61	27.97	49.36	58.34
Minnesota Hub	20.03	22.56	30.05	24.49	22.81	23.38	41.22	121.88	34.94	86.75	76.55	42.01	64.58	36.29	29.29	27.28	27.54	29.27	73.57	56.86	64.47	39.04	23.52	23.82	43.43	52.12
Wisconsin PS	22.32	25.37	33.86	27.64	25.78	26.45	46.39	133.81	37.73	92.69	81.60	44.62	68.99	39.07	32.01	29.76	30.04	30.69	80.51	61.04	69.75	42.55	26.65	26.49	47.32	56.34
Forecasted Load (GW)	66.2	64.1	63.2	62.6	62.6	64.5	66.6	68.4	69.6	71.1	71.5	70.8	69.7	68.4	67.5	66.7	66.9	68.3	72.4	73.2	71.9	70.3	67.8	64.5		
Forecast Error %	-25.5%	-0.6%	-1.1%	-1.1%	-1.4%	-2.9%	-2.7%	-1.3%	-0.2%	0.7%	1.4%	2.0%	2.4%	2.6%	2.2%	2.3%	2.1%	2.2%	2.8%	1.6%	1.9%	2.0%	1.4%	-8.3%		

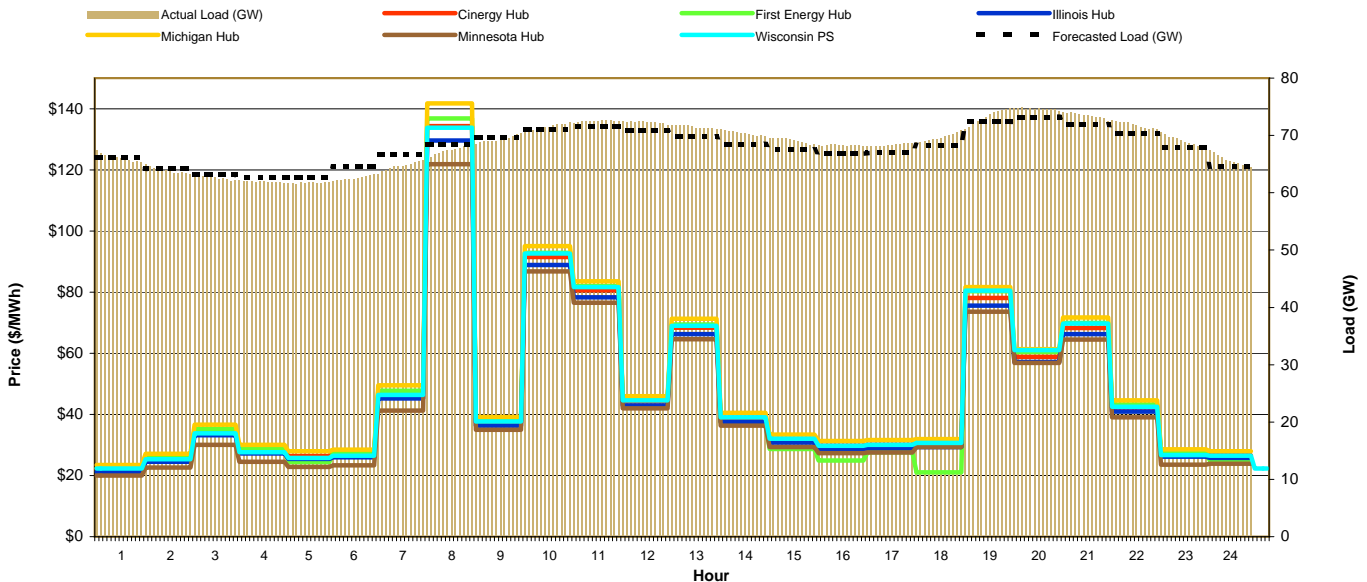




# MISO Daily Report

Sunday February 6, 2011

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	27.70	27.38	26.57	26.40	26.03	26.08	27.50	29.59	30.16	31.65	30.91	29.49	29.23	28.41	26.94	26.76	28.12	31.75	43.85	38.73	35.25	32.27	28.86	27.37	29.88	31.37
First Energy Hub	27.20	26.96	26.39	26.04	25.81	26.11	27.20	29.58	30.09	31.51	30.91	29.66	29.46	28.49	27.09	26.89	28.10	31.67	44.42	39.59	36.02	32.98	29.24	28.25	29.99	31.61
Illinois Hub	21.86	22.90	22.08	21.69	20.88	21.37	21.49	23.69	24.28	25.08	25.06	24.98	25.28	23.30	22.28	22.07	22.43	25.40	37.99	36.51	33.06	30.26	25.91	24.32	25.17	26.72
Michigan Hub	28.42	28.42	27.56	27.42	27.04	27.21	28.41	30.46	30.90	32.35	31.74	30.49	30.27	29.28	27.87	27.65	28.89	32.54	45.62	40.78	37.03	33.90	30.06	30.40	31.03	32.49
Minnesota Hub	18.81	18.61	17.99	17.52	16.53	16.02	18.04	19.18	19.74	20.48	20.53	20.48	20.20	19.63	19.05	18.89	19.44	21.39	30.79	29.66	25.56	23.04	19.52	18.27	20.39	21.72
Wisconsin PS	23.56	23.75	23.01	22.56	21.72	21.38	22.83	24.08	24.76	25.69	25.72	25.50	25.25	24.60	24.02	23.41	24.13	26.84	38.51	35.57	31.74	29.08	25.57	23.87	25.71	27.15
Cleared Load (GW)	60.9	60.0	59.1	58.6	58.5	59.8	61.7	64.3	65.6	67.6	68.2	67.5	66.8	65.9	64.8	64.4	65.5	69.6	73.9	74.0	72.9	71.4	67.2	6.5		

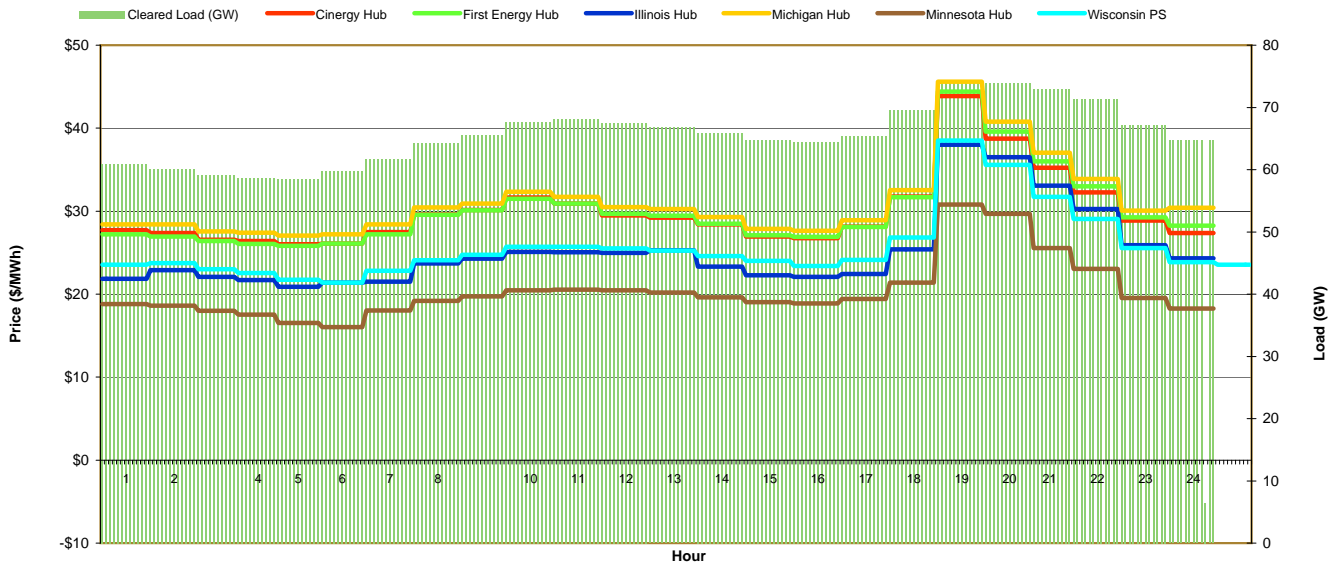

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	25.70	25.72	25.18	26.26	24.17	20.93	23.39	30.82	24.58	25.26	25.21	25.63	26.99	25.05	25.43	27.55	24.13	31.46	29.01	24.76	25.37	23.88	25.41	21.64	25.56	26.28
First Energy Hub	24.29	23.51	21.97	22.62	21.35	19.85	21.56	29.88	24.92	25.61	25.63	26.14	27.52	25.59	25.96	27.90	24.64	31.48	28.47	25.19	25.81	24.28	25.88	22.11	25.09	26.56
Illinois Hub	24.89	24.95	24.46	25.19	22.89	20.33	22.44	27.48	23.47	24.53	24.63	24.94	25.90	24.64	24.64	23.71	26.82	36.43	27.96	23.98	24.46	23.28	24.60	21.21	24.91	25.72
Michigan Hub	27.03	27.03	26.32	27.36	24.99	21.83	24.20	31.00	25.41	26.37	26.44	26.87	28.22	26.56	26.79	27.52	25.55	32.75	30.49	26.04	26.59	25.24	26.67	23.04	26.69	27.42
Minnesota Hub	22.44	21.92	19.81	19.92	16.03	18.12	18.03	8.02	18.72	22.09	22.26	21.27	19.66	22.60	19.49	-2.08	19.71	15.91	22.36	20.06	19.98	21.19	21.08	19.80	18.68	18.27
Wisconsin PS	25.36	25.22	24.20	24.19	20.94	20.39	21.67	20.01	22.69	25.02	25.24	24.99	24.78	25.37	24.04	13.47	24.70	27.59	27.11	23.59	23.86	23.76	24.57	22.11	23.53	23.80
Forecasted Load (GW)	62.9	61.3	60.3	59.9	61.5	62.1	63.6	65.4	65.3	67.1	67.7	67.5	67.1	66.9	66.5	66.2	66.5	68.0	71.6	73.3	72.8	71.2	68.9	66.4		
Forecast Error %	-67.2%	-0.9%	-1.9%	-2.3%	-5.3%	-5.6%	-5.9%	-5.5%	-2.4%	-2.4%	-1.8%	-1.3%	-1.0%	-0.8%	-0.4%	0.0%	0.4%	0.8%	-1.0%	-4.0%	-4.8%	-4.4%	-3.2%	-12.0%		

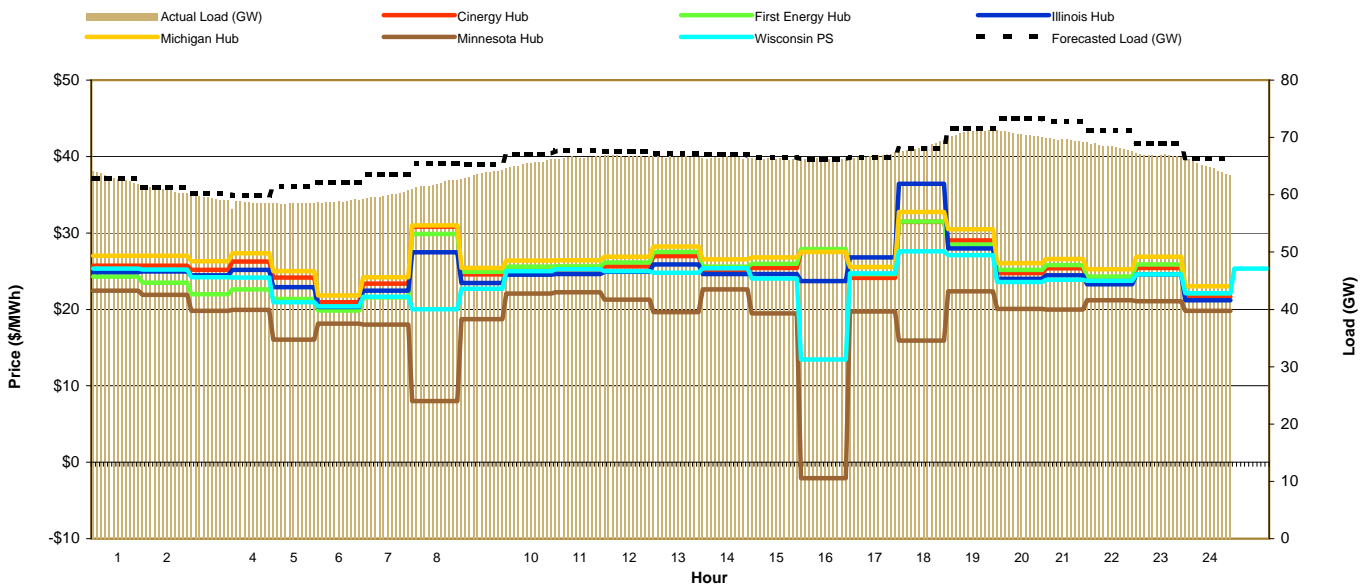




# MISO Daily Report

Monday February 7, 2011

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	26.37	26.10	25.80	25.78	26.52	29.67	37.58	48.59	45.91	50.22	50.41	48.51	48.58	44.75	42.06	38.89	39.23	46.49	66.62	59.79	51.21	48.16	38.28	38.27	41.82	47.98
First Energy Hub	26.94	26.36	26.12	26.11	26.75	30.07	38.64	49.89	44.95	47.58	48.85	47.89	47.94	40.46	37.35	35.40	35.56	42.83	64.59	58.28	50.34	42.25	33.63	32.41	40.05	45.49
Illinois Hub	24.62	24.38	24.08	24.07	24.73	27.48	35.15	46.19	44.76	39.76	39.72	41.23	41.26	35.76	33.64	31.40	31.48	36.79	52.77	46.23	41.95	37.19	29.13	25.47	34.97	39.33
Michigan Hub	27.68	27.46	27.14	27.12	27.89	31.20	39.58	52.43	50.12	50.11	50.10	50.14	50.13	47.71	41.75	39.19	39.19	48.29	68.27	59.20	52.12	47.48	37.45	35.27	42.79	48.98
Minnesota Hub	18.38	18.02	17.66	17.71	17.80	18.73	22.33	28.89	35.72	36.75	36.78	38.09	37.26	32.97	31.77	29.62	29.98	34.19	54.03	48.61	43.56	36.81	28.95	24.23	30.79	36.50
Wisconsin PS	23.23	22.82	22.45	22.47	22.76	24.43	28.54	34.31	36.98	37.05	37.03	38.85	37.14	34.16	32.77	31.07	31.21	35.03	58.62	53.24	47.26	37.69	31.68	27.49	33.68	38.38
Cleared Load (GW)	62.0	61.1	60.5	60.6	61.7	64.8	71.7	78.6	79.2	79.7	79.9	79.4	79.3	78.7	77.8	77.2	77.2	79.1	83.0	83.1	81.8	79.8	76.1	7.2		

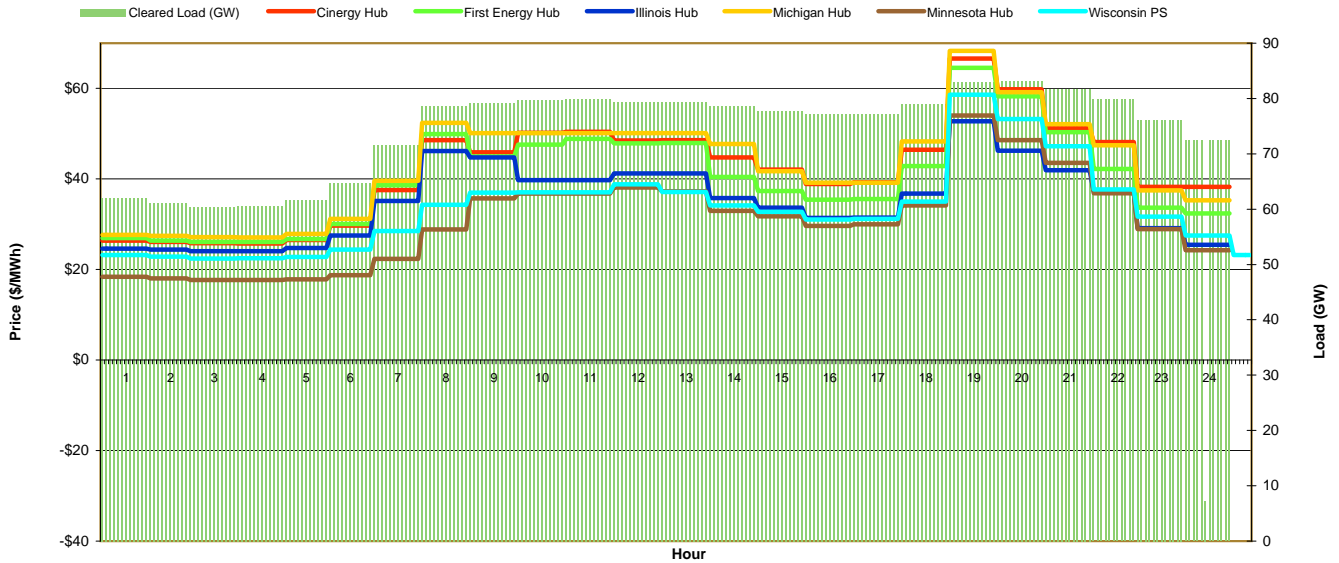

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	19.20	15.99	17.66	14.25	19.53	23.02	31.64	30.79	27.88	27.66	29.31	29.04	30.13	32.82	26.95	26.68	27.66	28.17	31.57	34.49	30.98	27.41	24.98	23.78	26.32	29.16
First Energy Hub	18.14	14.11	15.15	11.79	16.97	20.23	31.65	31.29	28.43	28.29	30.08	29.81	30.92	33.64	27.64	27.40	28.47	29.00	32.47	35.41	31.99	28.19	25.62	24.33	26.29	29.92
Illinois Hub	18.77	15.57	17.15	13.85	19.01	22.30	30.55	30.04	27.39	27.28	28.92	28.65	29.82	32.37	26.61	26.28	27.21	27.79	31.22	34.20	30.75	27.06	24.57	23.33	25.86	28.76
Michigan Hub	20.35	16.94	18.60	14.95	20.45	24.15	32.89	31.96	29.11	29.07	30.94	30.78	32.06	35.23	28.93	28.60	29.70	30.14	33.44	36.14	32.56	29.01	26.57	25.35	27.83	30.89
Minnesota Hub	17.65	14.47	15.41	12.60	17.80	20.75	-4.71	27.02	27.08	26.59	28.27	27.80	28.95	30.00	25.31	24.83	21.59	24.67	30.66	34.69	30.94	26.57	23.34	16.50	22.87	27.39
Wisconsin PS	19.50	16.08	17.42	14.08	19.52	22.89	-36.23	25.68	28.20	28.23	29.69	29.40	30.60	31.11	27.26	26.97	27.47	28.66	32.54	35.58	31.73	27.82	25.33	22.69	23.42	29.14
Forecasted Load (GW)	62.9	61.6	61.1	61.1	62.2	65.8	69.9	75.9	78.0	78.3	78.5	78.3	77.8	77.4	76.8	76.2	76.2	77.6	80.9	82.3	81.4	79.1	75.9	72.5		
Forecast Error %	-35.9%	-2.4%	-3.1%	-2.9%	-3.4%	-4.4%	-1.9%	-1.2%	-1.5%	-1.2%	-0.8%	-0.5%	-0.6%	-0.5%	-0.4%	-0.4%	-0.2%	0.6%	0.9%	0.8%	0.8%	0.6%	-9.3%			

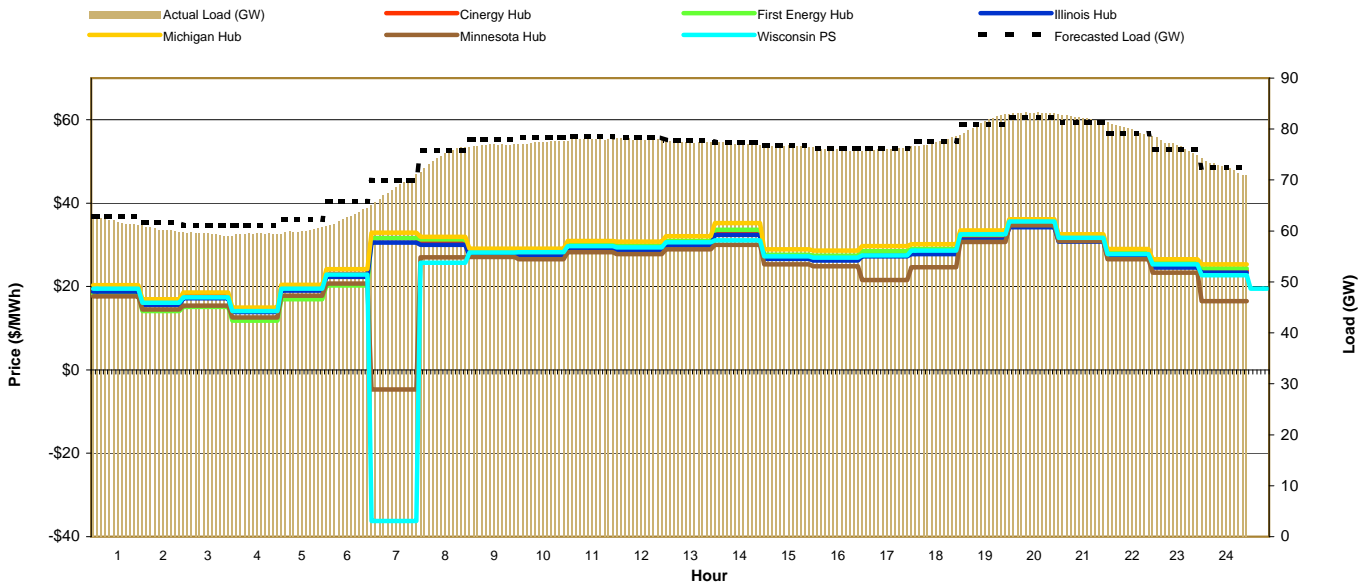




# MISO Daily Report

Tuesday February 8, 2011

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	28.14	27.60	27.25	26.65	27.65	30.00	38.24	56.92	52.72	53.41	52.26	48.66	43.95	39.47	36.45	33.50	32.42	39.31	61.00	52.87	49.84	41.82	34.66	31.72	40.27	45.58
First Energy Hub	30.39	29.12	28.63	27.69	28.79	30.62	39.04	57.12	53.33	53.85	52.75	49.28	43.82	38.00	35.75	33.91	32.83	38.05	61.00	53.10	50.06	42.25	34.94	32.06	40.68	45.63
Illinois Hub	24.78	24.66	24.51	23.69	25.00	28.78	37.50	55.78	51.68	52.19	51.25	47.76	43.43	39.54	36.25	32.99	31.95	39.29	59.78	51.40	48.52	41.03	33.47	30.15	38.97	44.77
Michigan Hub	35.22	32.14	31.36	30.87	32.09	36.30	40.64	62.42	57.04	57.85	57.07	52.91	50.05	48.99	43.31	36.96	35.83	48.05	67.66	56.97	53.72	45.60	37.80	34.42	45.22	50.76
Minnesota Hub	21.20	20.69	20.40	20.40	20.76	21.76	32.41	46.64	44.98	46.85	45.94	42.42	39.07	34.22	31.89	29.71	29.01	33.74	52.00	45.98	42.52	35.45	26.39	20.98	33.56	39.18
Wisconsin PS	25.06	24.33	23.92	23.67	23.66	25.01	31.70	43.07	42.30	45.55	44.84	41.70	39.45	34.40	32.31	30.20	29.81	33.70	50.54	45.88	40.82	35.01	29.73	26.93	34.31	38.71
Cleared Load (GW)	69.5	68.2	67.5	67.1	68.3	71.6	77.1	82.7	83.2	83.2	83.3	83.1	82.6	82.0	81.1	80.3	80.2	82.2	86.7	86.4	85.1	83.3	79.7	7.6		

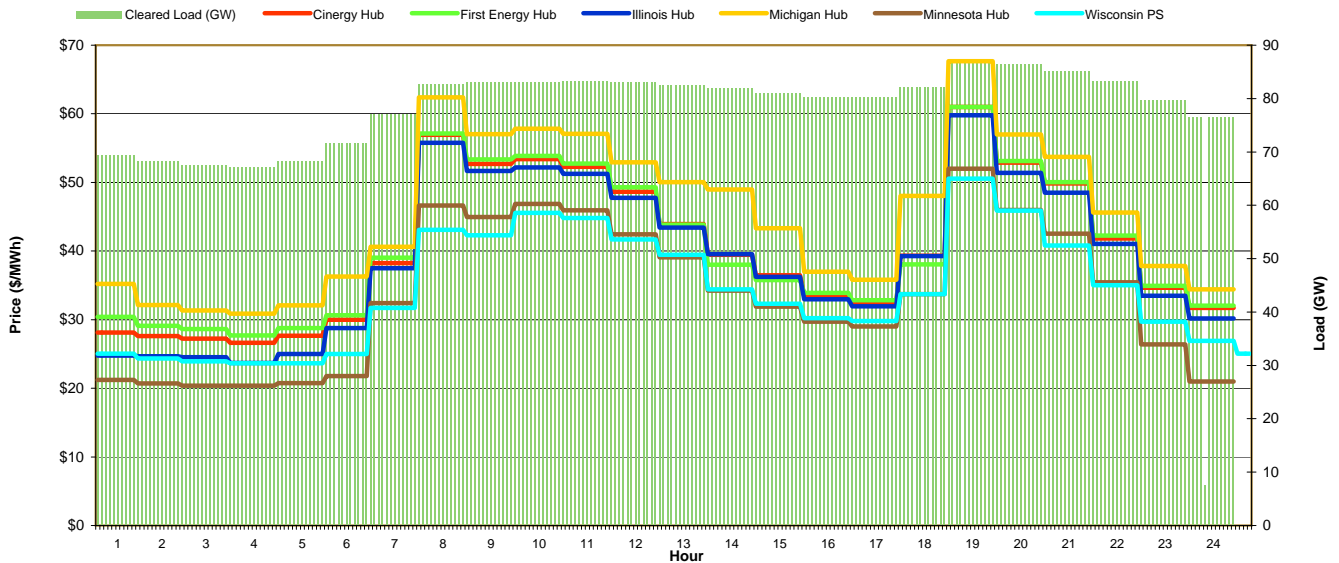

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	23.82	24.50	23.92	25.59	24.36	26.85	40.79	31.17	30.03	31.30	33.76	31.42	28.81	27.72	26.09	25.39	25.40	27.55	65.63	40.20	36.51	38.49	29.53	27.50	31.10	33.06
First Energy Hub	24.30	25.04	23.77	23.64	24.90	27.28	40.76	31.92	29.71	33.12	33.55	30.76	27.81	27.19	24.24	23.05	20.82	23.46	67.64	40.56	36.70	38.93	28.01	25.85	30.54	32.34
Illinois Hub	23.14	23.78	23.11	24.04	23.42	25.77	39.67	30.17	29.34	31.41	33.15	31.04	28.27	27.05	25.46	24.79	24.76	26.87	64.29	39.17	34.78	37.02	28.69	26.64	30.24	32.27
Michigan Hub	25.21	25.93	25.32	26.72	25.75	28.17	42.75	32.54	31.52	33.71	35.50	33.12	30.29	29.36	27.60	26.89	26.78	29.10	68.79	41.45	37.11	39.59	30.79	28.87	32.62	34.63
Minnesota Hub	16.17	16.62	16.99	16.95	21.08	21.87	18.87	29.81	29.77	32.22	34.21	32.04	22.17	27.10	25.03	23.97	23.67	25.41	63.78	39.33	34.37	29.69	26.73	24.38	31.21	31.21
Wisconsin PS	23.21	24.29	23.56	22.04	23.47	25.83	2.89	28.86	10.29	32.97	34.37	32.24	29.37	27.99	26.35	25.65	25.47	26.84	66.84	40.31	35.65	25.03	28.45	27.14	27.88	31.04
Forecasted Load (GW)	69.5	68.0	67.3	67.1	68.9	71.4	76.1	81.0	82.3	82.6	82.3	81.9	81.3	80.7	80.1	79.4	79.4	80.8	84.0	85.7	84.9	82.9	79.6	76.3		
Forecast Error %	-30.9%	-0.7%	-1.0%	-0.7%	-1.9%	-1.1%	0.1%	1.0%	1.1%	0.5%	0.5%	0.4%	-0.1%	-0.5%	-0.7%	-0.6%	-0.8%	-0.6%	1.1%	1.5%	1.3%	1.6%	1.6%	-8.0%		

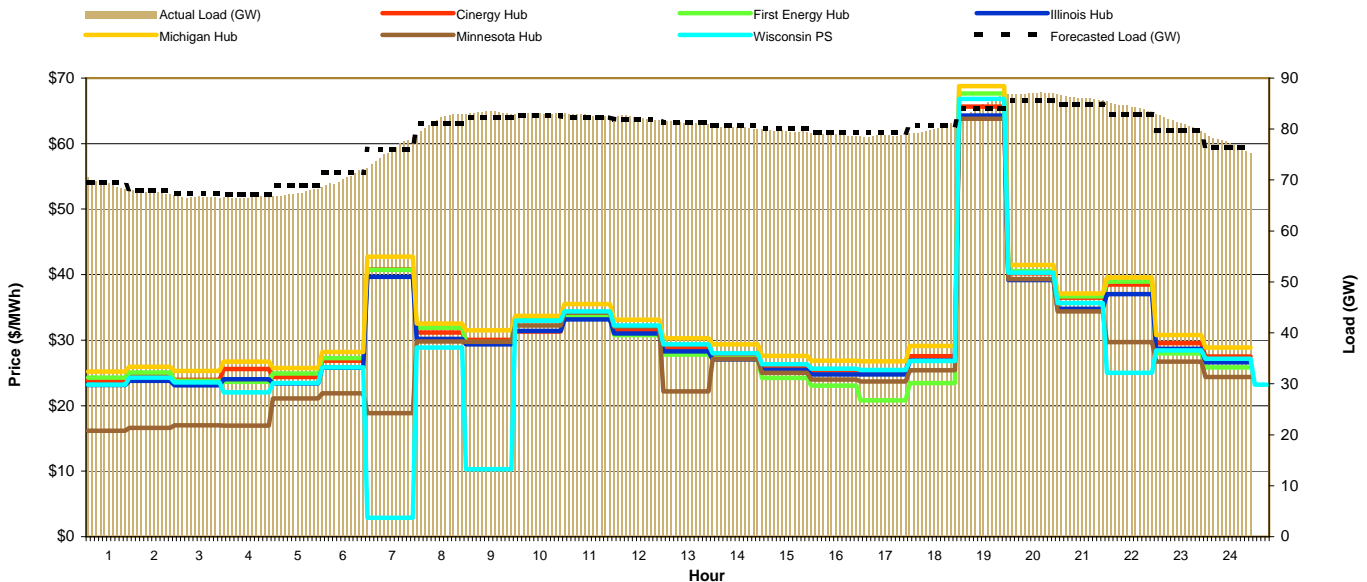






# MISO Daily Report

Wednesday February 9, 2011

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	32.85	34.95	33.62	32.27	31.31	32.91	44.97	59.17	53.14	55.17	53.59	50.33	44.97	41.13	37.17	35.15	33.91	40.34	60.50	53.77	49.98	46.08	40.35	38.72	43.18	47.17
First Energy Hub	30.77	31.49	30.69	30.00	29.54	31.10	42.03	57.47	51.42	54.24	52.51	49.07	44.29	39.84	36.65	34.41	33.81	38.54	60.20	52.60	48.54	44.41	38.11	35.64	41.56	46.01
Illinois Hub	30.69	32.59	31.30	30.05	29.29	30.82	42.13	56.79	51.82	54.06	52.62	49.56	44.25	40.52	36.78	34.69	33.75	39.99	59.80	53.16	49.39	45.62	38.94	36.67	41.89	46.36
Michigan Hub	34.18	37.00	35.58	33.56	32.64	35.03	48.22	63.90	57.36	59.51	58.19	54.85	49.00	44.80	40.57	37.52	36.54	43.25	64.66	57.53	53.43	49.34	42.69	40.51	46.24	50.82
Minnesota Hub	18.20	17.50	17.08	17.04	17.06	17.96	25.09	40.61	43.95	45.92	44.45	42.20	38.62	35.35	32.59	30.34	34.75	52.36	49.96	45.16	40.13	29.93	24.88	33.00	39.83	
Wisconsin PS	25.72	25.76	25.13	24.73	24.34	25.19	29.15	37.36	36.52	40.67	40.10	39.36	37.88	34.30	32.49	31.24	30.60	33.90	49.00	49.35	43.81	36.85	31.40	28.82	33.90	37.80
Cleared Load (GW)	72.9	71.3	70.6	70.6	71.2	73.5	80.1	85.4	84.9	84.8	84.4	83.4	82.4	81.3	80.3	79.3	79.2	81.3	86.2	86.1	85.3	82.8	79.5	7.7		

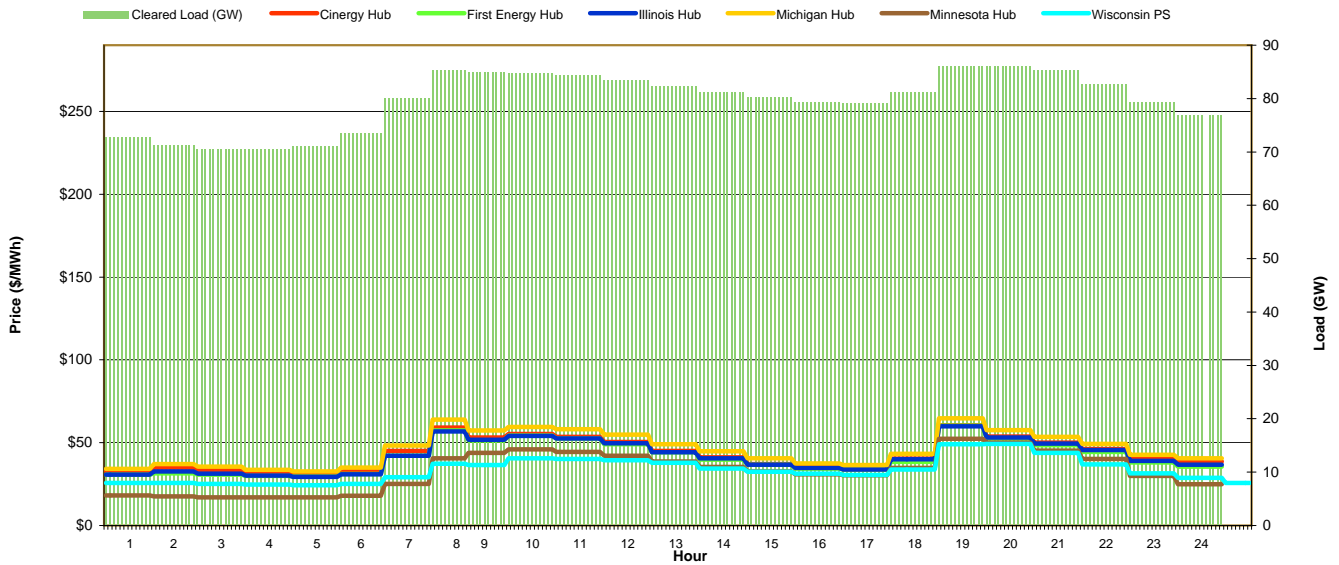

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	28.29	29.73	29.46	28.47	27.83	28.37	282.42	217.04	44.25	35.80	40.50	36.49	32.55	35.38	32.56	29.39	28.03	29.10	33.39	36.85	36.11	52.65	38.96	32.32	51.91	47.44
First Energy Hub	26.08	28.49	27.85	25.61	24.59	23.00	266.45	219.63	43.41	36.98	40.97	36.74	32.90	32.92	32.67	27.33	30.91	30.56	34.37	37.85	37.06	54.13	37.53	32.33	50.85	47.87
Illinois Hub	27.35	28.32	27.89	26.82	26.55	26.83	267.69	208.70	42.84	34.46	39.22	35.51	31.69	34.36	31.53	29.22	29.01	28.56	32.35	35.93	35.14	51.05	37.74	31.84	50.03	46.08
Michigan Hub	29.79	31.22	30.85	29.75	29.15	29.35	289.81	224.89	45.49	36.99	42.05	37.82	33.75	36.97	34.18	31.80	31.74	30.80	34.44	38.01	37.28	54.60	40.88	34.59	54.01	49.48
Minnesota Hub	18.50	18.69	20.16	19.22	20.69	11.20	128.55	138.94	31.59	34.06	38.89	35.73	31.89	34.12	31.11	29.10	27.75	27.94	32.67	37.74	36.70	52.87	38.26	30.31	38.61	41.21
Wisconsin PS	19.43	28.78	23.60	24.07	22.75	26.57	26.15	91.51	38.41	35.71	40.22	36.36	32.82	35.25	32.47	30.00	29.24	29.53	33.96	37.77	36.62	52.71	38.74	31.23	34.74	39.45
Forecasted Load (GW)	73.7	72.1	72.2	72.1	72.8	75.0	78.4	83.4	84.7	84.3	83.6	82.5	81.3	80.2	79.3	78.3	78.1	79.5	84.2	86.5	85.4	83.2	79.9	75.9		
Forecast Error %	-49.5%	0.0%	-1.7%	-1.8%	-2.0%	-1.4%	1.1%	1.3%	1.2%	1.7%	2.0%	2.2%	2.2%	2.6%	2.8%	2.9%	3.1%	2.4%	1.2%	0.6%	1.1%	1.5%	1.6%	-7.0%		

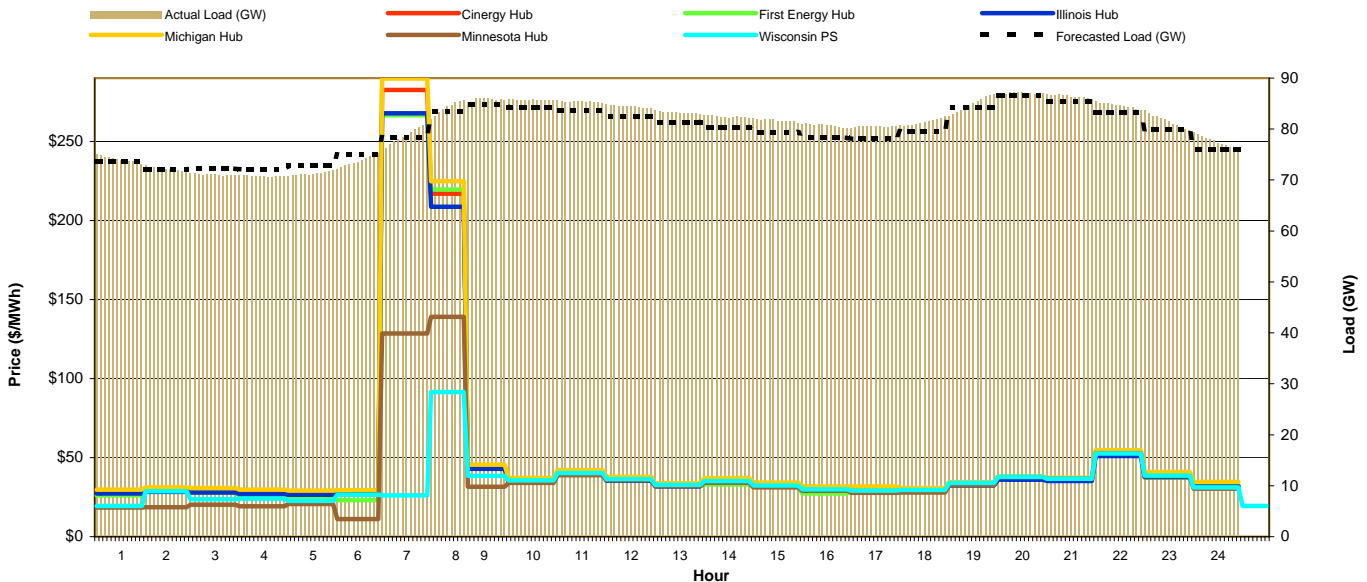




# MISO Daily Report

Thursday February 10, 2011

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	34.07	34.05	33.24	32.32	32.83	35.55	48.03	62.28	52.30	47.66	48.24	46.15	44.00	37.18	35.11	32.74	32.16	36.67	53.80	48.67	46.51	41.52	32.73	31.62	40.81	43.61
First Energy Hub	33.54	33.69	32.91	32.06	32.59	34.84	48.09	63.76	53.23	49.00	49.56	47.34	44.81	38.05	35.27	33.47	32.91	37.52	55.25	49.99	47.80	42.50	33.40	32.34	41.41	44.62
Illinois Hub	32.22	32.21	31.35	30.54	31.00	33.40	46.20	61.06	51.31	46.83	47.39	45.35	43.20	36.37	34.34	32.02	31.44	35.86	52.76	47.73	45.71	40.62	31.03	29.83	39.57	42.69
Michigan Hub	35.81	35.61	34.73	33.83	34.34	37.02	50.41	66.00	55.51	50.71	51.29	49.07	47.04	39.37	37.16	34.66	34.04	38.81	57.15	51.70	49.44	43.95	34.28	33.11	43.13	46.26
Minnesota Hub	22.77	22.37	21.04	20.97	20.98	21.20	33.40	50.99	44.91	42.96	42.45	39.80	38.23	32.91	30.91	29.04	29.28	32.08	49.96	46.03	40.70	35.76	23.81	20.46	33.04	38.11
Wisconsin PS	26.67	26.40	25.60	25.19	25.06	25.65	31.69	43.65	38.49	40.06	38.97	36.31	35.81	31.64	30.44	29.56	28.89	30.79	49.16	47.49	38.74	35.97	28.91	26.07	33.21	36.55
Cleared Load (GW)	74.5	73.7	73.0	72.9	73.3	75.6	81.3	86.2	86.0	85.7	85.5	83.5	82.1	81.4	80.0	79.0	78.7	80.9	85.7	85.7	84.2	82.2	78.7	7.5		

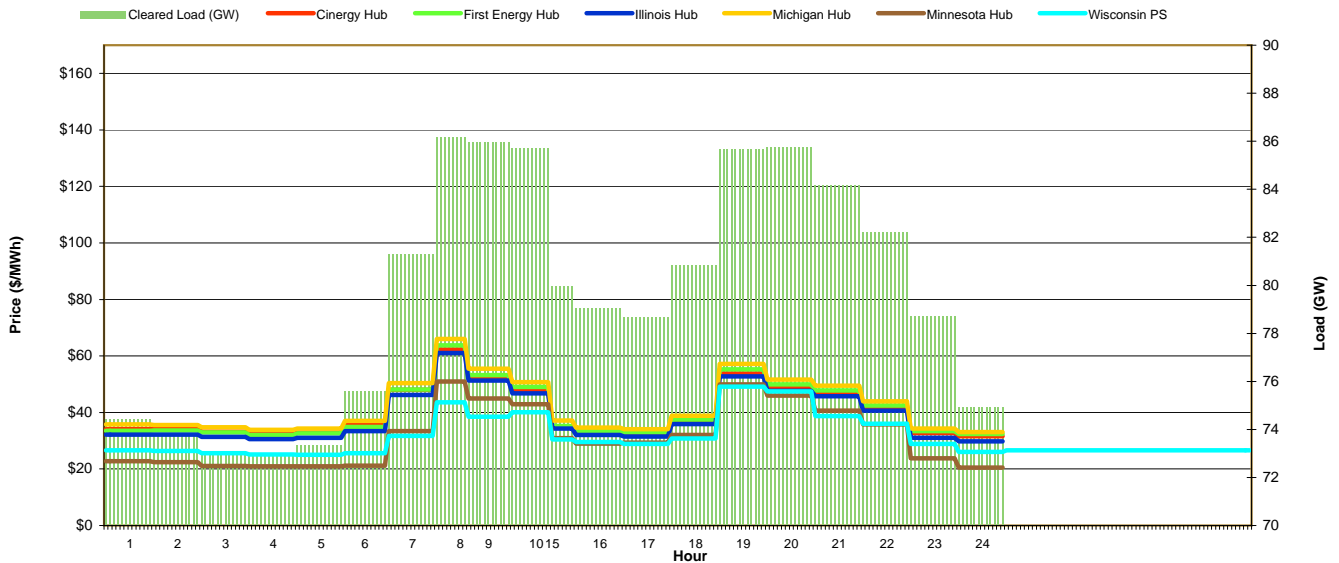

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	40.05	29.16	27.95	27.66	29.55	27.41	28.41	34.70	39.33	38.43	30.87	44.70	31.94	28.62	26.56	26.40	27.20	27.56	137.08	38.98	156.04	33.62	28.43	30.40	41.29	46.90
First Energy Hub	41.08	29.68	28.39	27.96	29.84	27.70	28.84	35.28	40.10	39.27	31.60	45.92	32.83	29.29	27.31	27.19	27.90	30.42	142.55	43.63	164.51	37.65	32.98	36.09	43.25	49.28
Illinois Hub	38.83	28.11	26.91	26.36	27.24	26.39	27.02	33.16	37.93	37.06	29.75	43.08	30.89	29.76	26.52	25.63	26.23	28.65	132.82	40.74	153.27	34.97	30.61	34.17	40.67	46.32
Michigan Hub	42.57	30.97	29.69	29.18	30.76	28.80	29.47	35.91	40.50	39.73	32.05	46.84	33.59	29.99	28.02	28.00	28.90	31.42	144.23	44.22	167.45	38.46	33.67	38.55	44.30	50.20
Minnesota Hub	32.96	24.82	24.31	21.37	12.88	19.98	26.98	30.35	36.77	35.45	29.08	42.20	30.55	30.87	26.52	25.08	25.38	28.38	133.50	43.03	161.52	36.10	31.50	35.10	39.36	46.64
Wisconsin PS	32.17	26.58	27.31	25.69	23.09	26.84	28.38	35.37	40.11	38.62	31.26	45.32	32.27	31.01	27.72	26.96	27.47	30.07	140.73	43.23	161.34	36.29	32.50	36.37	41.94	48.76
Forecasted Load (GW)	75.5	73.0	72.4	73.2	74.1	76.0	80.4	85.9	86.8	86.4	85.1	84.3	82.8	81.6	80.6	79.6	79.5	80.8	84.9	87.1	86.4	83.9	80.6	76.2		
Forecast Error %	#####	-0.1%	-0.2%	-1.3%	-1.2%	-0.2%	1.0%	0.8%	1.0%	-0.7%	#DIV/0!	#DIV/0!	#DIV/0!	-1.6%	-1.6%	-2.1%	-2.1%	-2.1%	-2.0%	-1.9%	-2.0%	-1.3%	-1.5%	-10.0%		

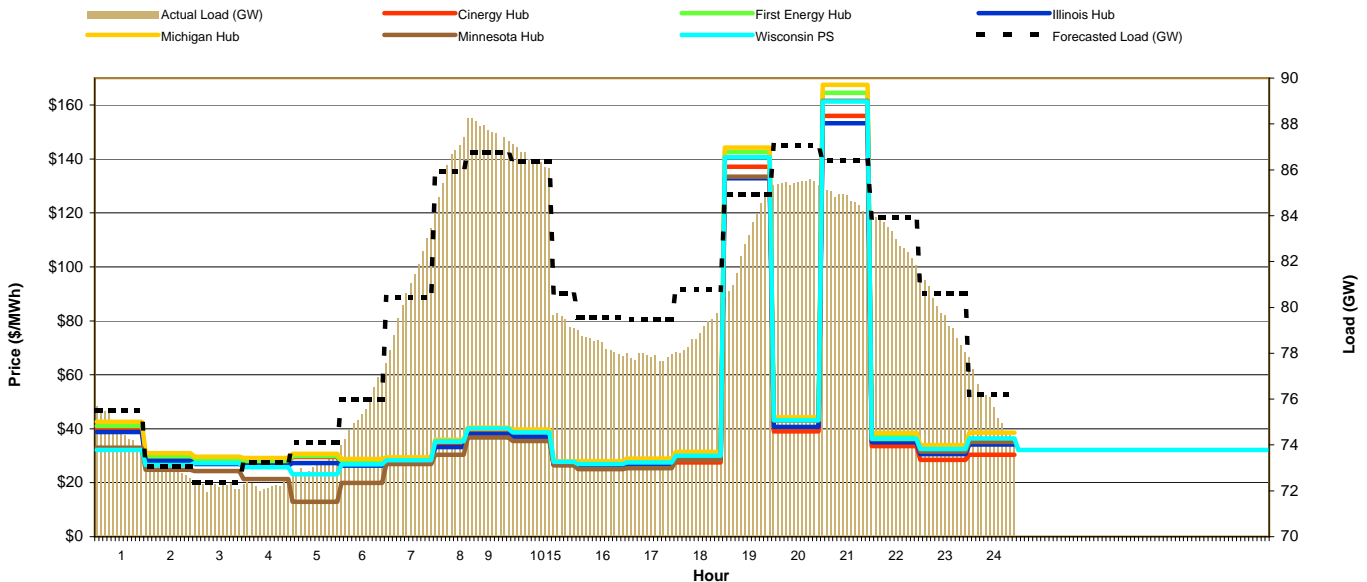




# MISO Daily Report

Friday February 11, 2011

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	29.97	29.25	28.97	28.67	29.13	29.59	38.56	51.73	44.85	43.15	39.25	37.03	34.54	34.37	31.25	30.27	30.14	31.45	40.28	37.63	33.45	31.07	29.58	30.99	34.38	36.25
First Energy Hub	30.86	29.99	29.69	29.47	29.76	30.24	39.43	52.90	45.99	44.18	40.19	37.95	35.44	35.23	31.97	30.95	30.79	32.17	41.23	38.51	34.34	31.98	30.46	31.25	35.21	37.14
Illinois Hub	28.65	27.00	26.62	26.52	26.50	27.44	37.73	50.62	43.89	42.18	38.36	36.22	33.85	33.67	30.62	29.66	29.09	30.78	39.38	36.80	32.81	30.56	26.47	24.83	32.93	35.31
Michigan Hub	31.95	31.36	31.11	30.94	30.72	31.27	40.79	54.72	47.56	45.69	41.57	39.25	36.65	36.43	33.07	32.01	31.84	33.26	42.62	39.79	35.49	33.04	31.58	32.43	36.46	38.41
Minnesota Hub	21.78	21.32	21.08	20.84	20.54	21.36	33.06	44.28	43.76	41.36	38.24	35.48	31.23	29.70	24.98	22.68	21.63	22.87	31.10	31.26	28.44	23.70	19.79	18.92	27.89	30.66
Wisconsin PS	28.92	25.63	24.87	24.67	24.66	25.41	30.00	40.13	45.88	42.66	40.10	37.86	32.79	31.62	34.36	30.75	30.58	30.62	43.11	38.42	34.27	31.55	28.43	26.61	32.66	35.82
Cleared Load (GW)	72.7	70.6	69.4	69.3	70.0	72.3	78.0	82.4	81.3	80.8	80.8	79.5	78.4	77.1	75.8	74.2	74.0	75.7	78.8	77.8	76.9	75.2	71.3	6.8		

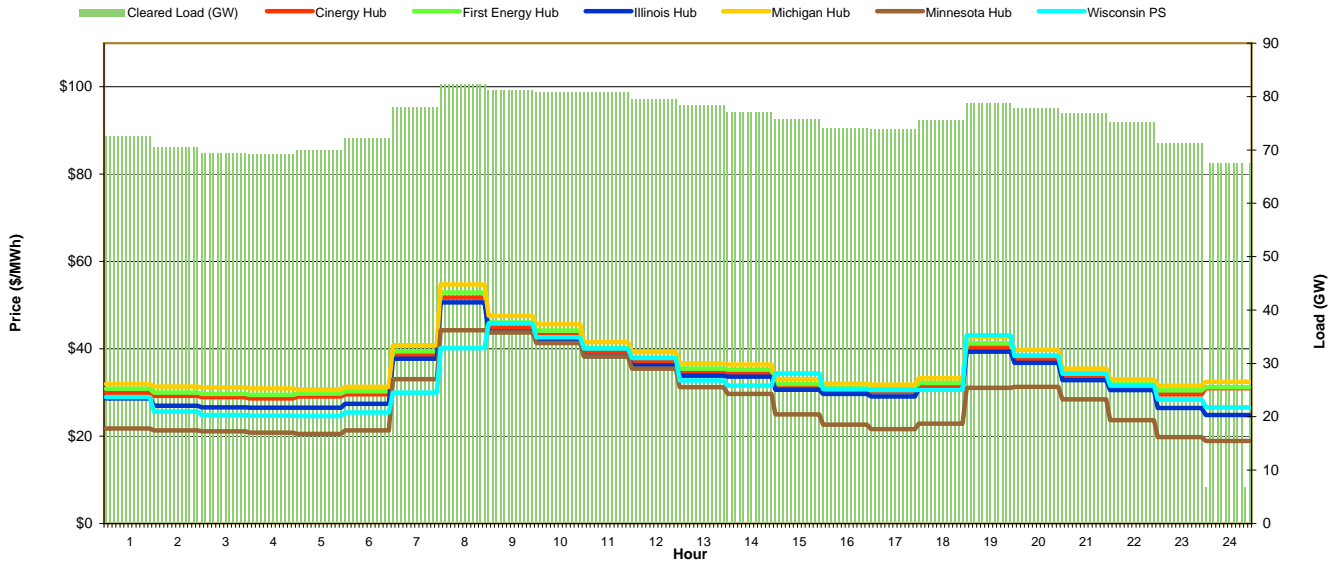

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	26.18	30.07	26.75	28.12	32.84	30.66	103.94	60.16	65.53	80.38	28.46	32.52	27.31	27.29	24.95	25.20	24.76	25.90	46.04	40.17	40.60	28.03	24.57	28.82	37.89	37.62
First Energy Hub	25.36	36.01	29.92	32.22	34.44	32.10	107.10	62.00	67.66	83.21	29.41	35.26	30.36	30.21	27.28	27.53	26.94	28.41	50.04	43.03	40.69	30.26	26.42	30.03	40.25	39.92
Illinois Hub	27.30	30.46	27.59	27.21	28.80	26.83	94.01	55.70	62.53	76.71	27.28	32.68	28.14	26.56	25.39	25.23	24.23	26.20	45.48	38.87	25.30	23.49	21.96	21.01	35.37	35.36
Michigan Hub	30.89	38.33	31.59	33.50	35.74	32.92	109.05	62.77	68.24	85.47	30.31	36.57	31.82	31.59	28.45	28.81	42.54	46.79	76.04	68.17	69.86	63.48	58.40	39.03	49.18	51.83
Minnesota Hub	27.49	32.37	26.55	27.72	29.38	27.63	93.75	56.53	65.74	78.85	28.04	47.81	31.11	8.70	8.30	18.75	17.02	17.27	34.56	35.41	13.18	18.94	4.38	14.39	31.83	30.29
Wisconsin PS	28.38	23.49	27.37	22.19	22.36	20.74	86.45	54.47	43.31	80.06	28.73	34.72	29.56	34.92	45.36	32.78	35.04	27.96	44.05	41.44	31.36	24.10	29.11	23.39	36.30	38.56
Forecasted Load (GW)	72.4	72.1	71.2	68.8	71.3	72.2	78.6	82.1	83.3	83.3	82.5	81.3	80.0	79.7	77.6	76.4	75.9	76.2	79.4	80.4	79.0	77.1	73.0	69.1		
Forecast Error %	0.0%	-1.9%	-2.2%	0.7%	-1.9%	0.1%	-1.4%	0.7%	0.3%	-0.5%	-0.8%	-0.9%	-1.2%	-2.3%	-1.0%	-1.0%	-1.2%	-1.0%	-1.6%	-1.5%	-1.4%	-1.4%	0.0%	0.5%		

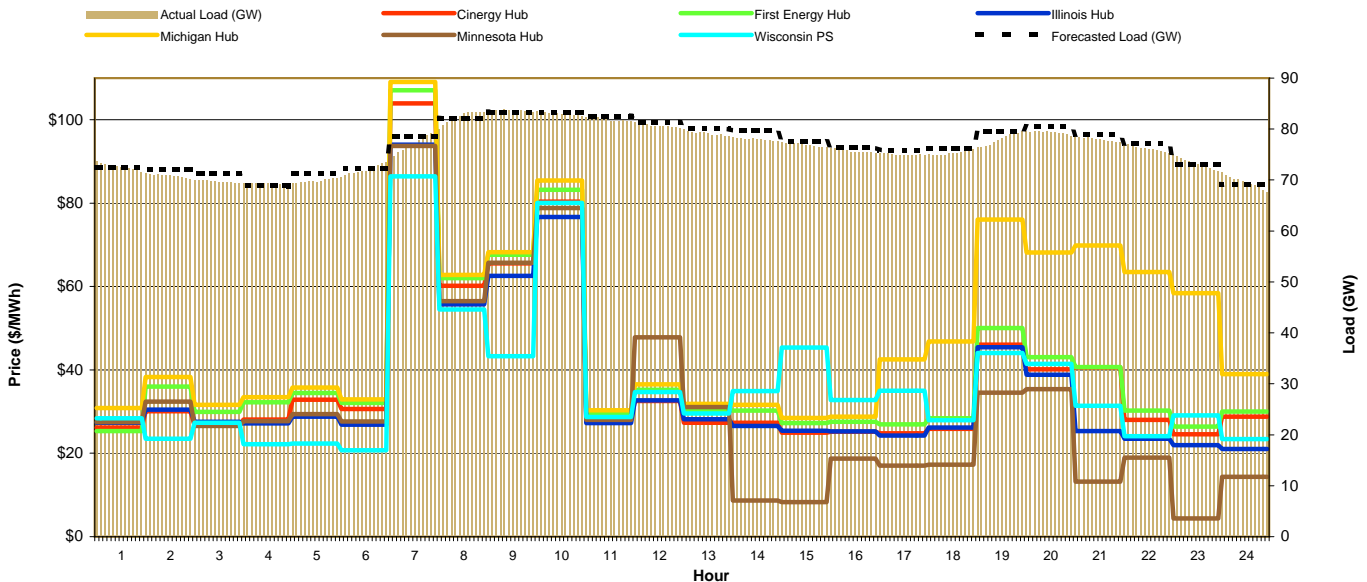




# MISO Daily Report

Saturday February 12, 2011

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	28.98	29.15	28.46	26.44	25.83	26.91	29.64	37.05	41.04	49.03	50.39	34.89	31.48	29.07	29.01	29.21	33.47	47.84	44.46	44.37	35.77	29.89	28.73	34.75	38.11	
First Energy Hub	29.63	29.83	29.10	27.23	26.96	27.65	30.45	37.35	42.59	50.03	51.05	43.40	37.20	33.75	30.54	30.21	30.49	35.30	47.54	45.12	45.07	37.22	33.27	29.63	35.86	39.38
Illinois Hub	20.56	20.28	20.45	20.20	20.00	22.76	22.92	24.10	24.88	27.94	26.40	23.96	23.21	22.06	21.37	20.80	21.02	22.92	28.18	25.77	23.50	23.07	22.57	21.90	22.95	23.86
Michigan Hub	31.01	31.09	30.37	28.49	29.60	29.64	31.93	39.17	44.66	52.30	53.38	45.38	42.99	38.73	33.64	32.42	32.99	41.72	49.57	47.18	47.17	41.60	42.47	32.00	38.73	42.84
Minnesota Hub	17.93	17.16	16.42	16.05	16.45	16.87	19.99	20.62	21.82	23.38	24.39	21.46	20.62	19.72	18.05	17.70	18.41	20.53	24.01	23.73	20.98	20.32	16.70	16.43	19.57	20.78
Wisconsin PS	20.79	20.32	19.40	17.81	18.69	20.07	22.45	23.59	26.19	29.01	29.02	27.45	25.85	23.71	23.13	22.60	22.70	25.43	31.11	28.80	27.36	24.81	23.50	20.33	23.92	25.89
Cleared Load (GW)	62.9	61.4	59.8	59.1	59.2	60.5	64.6	67.8	69.5	70.7	71.4	70.4	69.1	67.4	65.6	65.1	65.4	68.0	72.9	71.6	70.8	68.4	64.4	6.1		

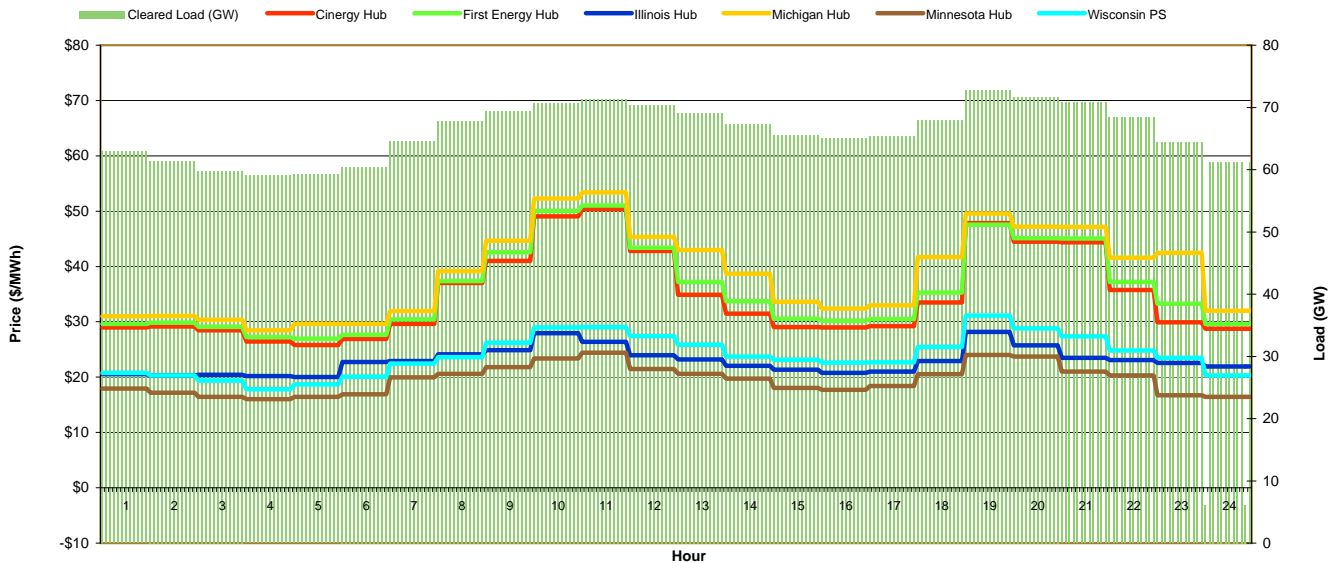

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	28.24	40.25	29.18	25.58	21.19	28.84	26.17	28.26	28.89	29.95	27.75	27.94	28.17	25.20	24.29	28.02	29.83	30.10	48.91	30.32	27.40	28.27	23.79	27.04	28.90	29.19
First Energy Hub	25.31	41.95	30.48	26.81	21.23	30.15	27.31	30.04	30.24	31.26	28.97	29.22	29.47	26.36	25.35	29.48	31.17	32.70	51.42	30.63	29.08	30.18	26.06	28.27	30.13	30.73
Illinois Hub	-1.81	26.56	19.23	16.75	17.91	16.71	22.08	24.28	24.62	23.46	24.05	23.20	24.47	22.15	22.70	14.78	16.27	16.70	41.31	17.42	22.49	20.94	21.72	15.82	20.58	22.54
Michigan Hub	25.98	43.89	32.12	28.25	22.44	31.28	27.90	44.27	43.92	31.95	29.44	49.07	60.54	54.55	47.15	58.85	62.54	64.50	78.05	59.25	61.26	62.03	52.75	29.55	45.90	53.76
Minnesota Hub	9.76	12.63	16.10	16.46	18.70	14.96	20.07	21.59	19.90	20.03	20.45	19.78	20.05	19.90	18.66	11.50	13.79	15.28	38.66	23.29	20.33	16.23	16.56	8.31	18.04	19.75
Wisconsin PS	23.56	21.44	17.30	15.00	17.03	14.49	22.13	24.53	27.67	24.60	25.23	25.23	27.07	24.12	24.39	13.25	14.56	15.43	43.32	26.81	23.27	21.14	22.86	15.00	22.06	23.96
Forecasted Load (GW)	66.5	63.6	62.3	61.6	63.1	62.3	64.5	67.2	69.7	70.8	71.4	71.2	71.8	68.9	67.6	67.6	67.0	68.6	71.8	73.2	71.7	71.8	67.6	64.4		
Forecast Error %	-1.0%	0.1%	0.1%	-0.1%	-2.7%	-0.1%	-0.1%	-0.1%	-1.3%	-0.9%	-1.4%	-2.3%	-5.2%	-3.6%	-3.9%	-5.4%	-4.4%	-4.7%	-3.7%	-2.9%	-2.0%	-4.5%	-2.1%	-2.0%		

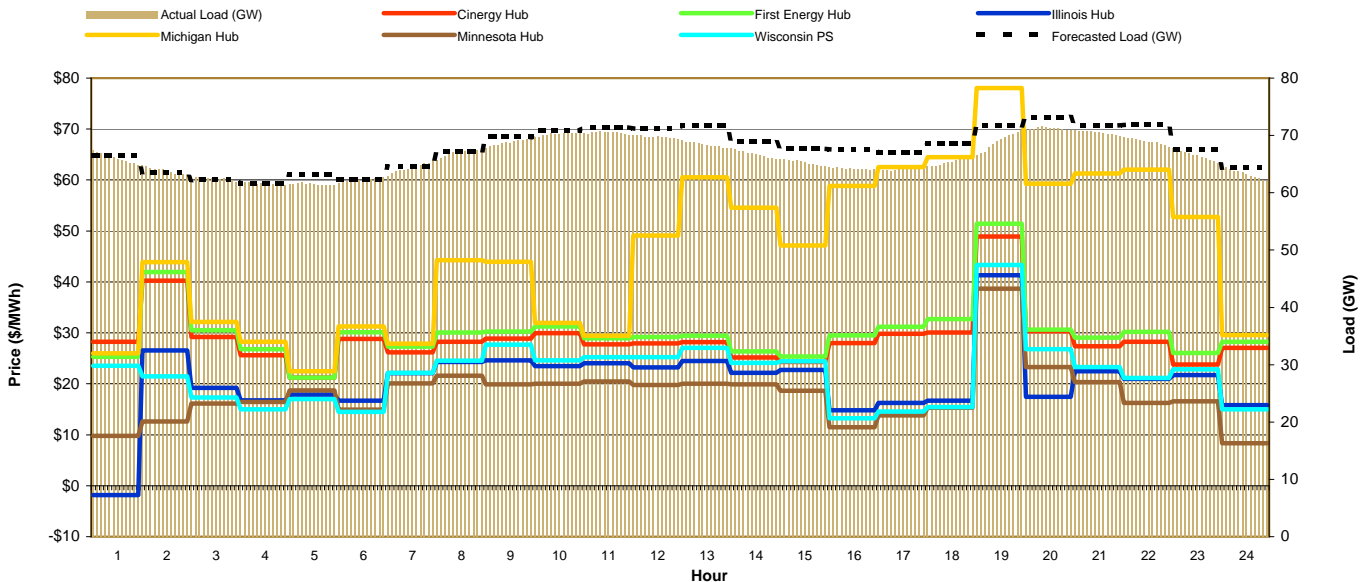




# MISO Daily Report

Sunday February 13, 2011

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$			
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk		
Cinergy Hub	27.53	26.86	26.63	25.48	25.42	25.31	25.88	28.30	28.09	28.57	28.40	27.93	27.51	27.23	26.68	26.52	27.00	28.52	39.40	35.78	31.45	29.01	26.69	25.81	28.17	29.19		
First Energy Hub	27.86	28.53	27.51	26.37	26.28	25.96	27.00	29.07	28.55	29.11	28.88	28.25	27.74	27.43	26.84	26.88	27.53	29.42	39.75	36.06	32.58	29.88	26.95	26.71	28.80	29.68		
Illinois Hub	16.69	16.07	16.89	16.72	16.88	18.35	18.23	20.48	20.68	21.43	21.37	19.59	18.19	18.13	17.57	17.95	17.71	21.70	29.61	25.90	24.73	20.50	18.17	17.10	19.61	20.86		
Michigan Hub	29.86	34.09	30.90	29.53	29.42	28.38	29.73	31.15	31.10	31.84	32.23	31.54	30.93	30.64	29.46	30.34	33.48	37.76	45.96	41.42	39.99	37.99	30.17	30.85	32.87	34.13		
Minnesota Hub	9.10	10.36	5.10	3.54	3.54	3.56	5.31	12.32	16.95	17.77	17.73	18.44	17.00	15.46	14.57	14.40	15.24	17.16	22.23	21.21	19.23	17.24	13.75	7.76	13.29	16.92		
Wisconsin PS	15.47	14.71	9.90	7.79	9.04	9.22	11.33	19.93	22.05	22.33	22.17	21.93	21.07	21.03	19.53	19.87	20.52	23.54	28.88	26.97	25.41	23.43	21.45	17.53	18.96	22.51		
Cleared Load (GW)	57.9	58.1	57.5	56.5	56.4	57.4	58.8	61.6	63.3	64.8	64.9	64.6	63.8	62.9	61.9	61.8	62.7	66.2	73.0	71.7	70.5	67.5	63.7	61.1				

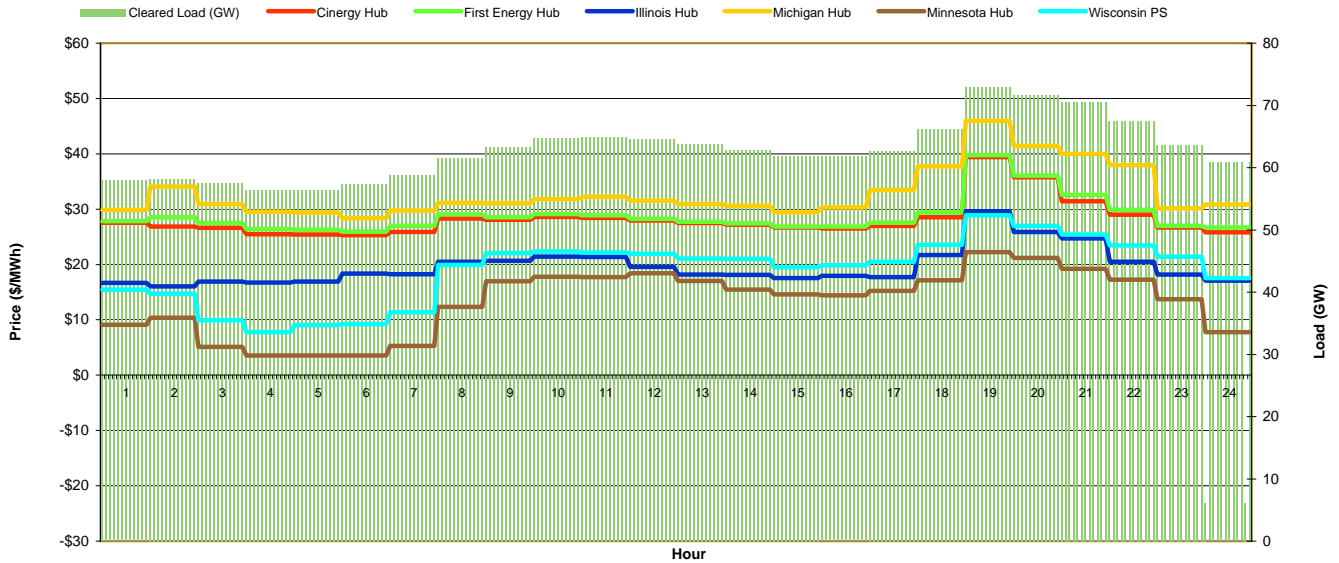

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$			
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk		
Cinergy Hub	18.57	29.54	24.40	27.23	27.03	23.34	25.08	24.81	27.49	25.40	23.21	22.75	22.04	-4.60	13.93	23.44	15.18	22.21	46.69	27.26	24.65	26.19	21.04	22.18	23.29	22.61		
First Energy Hub	19.85	31.21	25.51	28.57	28.38	24.61	26.06	25.87	28.79	26.58	24.30	23.70	22.94	-4.84	14.51	24.76	16.02	23.12	48.52	28.32	25.69	27.42	21.75	22.96	24.36	23.59		
Illinois Hub	6.27	3.26	9.13	5.76	6.33	-0.55	18.18	14.71	10.69	15.82	16.41	13.72	16.29	-4.87	9.58	3.31	3.30	15.58	44.56	26.09	22.90	18.91	20.04	13.70	12.88	15.44		
Michigan Hub	20.89	33.29	26.84	30.29	30.05	26.39	26.82	27.76	30.11	31.57	34.35	24.59	23.63	-4.92	14.98	26.34	16.97	23.72	59.78	29.36	41.50	42.67	27.48	23.68	27.86	28.13		
Minnesota Hub	-3.43	-8.91	-15.98	-23.90	-12.89	-26.57	5.35	0.16	-16.16	9.40	2.26	-8.50	5.77	-23.75	8.93	2.19	-0.65	2.67	28.69	10.43	13.39	14.57	2.85	-13.14	-1.97	3.27		
Wisconsin PS	5.21	-1.75	7.95	2.26	1.32	-4.84	17.28	15.53	13.68	15.32	17.69	15.86	16.76	-2.13	9.09	-1.19	2.84	15.79	48.30	27.57	24.28	19.23	21.35	13.34	12.53	16.25		
Forecasted Load (GW)	60.6	58.8	58.2	59.1	58.9	59.5	61.1	61.2	62.1	63.1	63.5	63.4	63.0	62.7	62.7	62.5	62.9	64.0	68.1	69.6	68.7	67.4	65.5	63.6				
Forecast Error %	-0.5%	-0.7%	-1.9%	-4.3%	-4.1%	-4.5%	-4.6%	-1.7%	-0.9%	-0.5%	-0.6%	-1.1%	-1.6%	-2.5%	-4.2%	-4.8%	-5.1%	-4.1%	-3.5%	-0.9%	-0.2%	-0.8%	-2.0%	-4.2%				

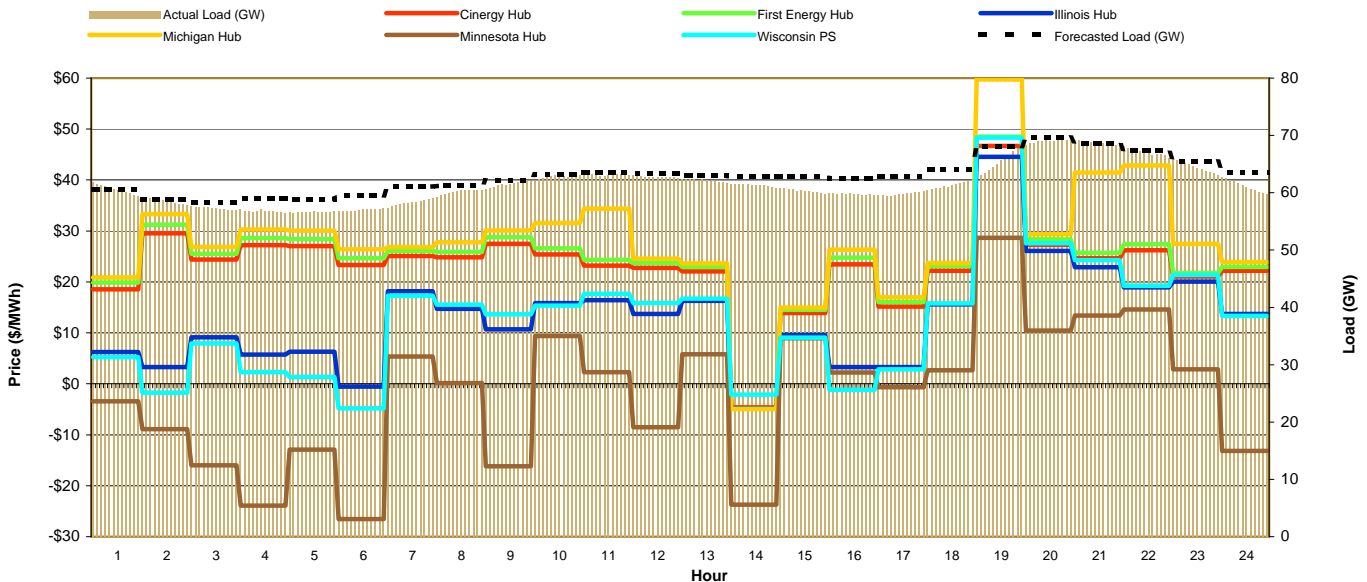




# MISO Daily Report

Monday February 14, 2011

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	23.44	23.12	23.14	23.22	23.54	24.73	29.24	40.84	35.79	36.86	37.62	36.95	35.57	32.63	29.73	28.59	29.12	32.37	49.38	46.49	43.60	34.40	27.84	25.54	32.24	36.11
First Energy Hub	24.82	24.62	24.02	23.71	24.00	25.19	30.33	41.39	36.83	37.89	37.96	37.28	35.69	32.16	28.88	27.91	28.15	31.13	50.21	47.98	45.33	34.45	27.83	27.90	32.74	36.32
Illinois Hub	14.64	13.71	13.51	13.58	14.00	16.89	23.68	39.65	35.06	36.45	37.43	37.20	35.88	33.31	29.88	28.60	29.27	33.27	49.41	46.20	43.34	34.81	27.43	23.25	29.60	36.07
Michigan Hub	28.95	28.82	26.35	25.00	25.30	26.77	33.63	50.58	42.17	42.87	44.31	44.72	44.14	42.82	41.92	40.83	41.73	43.56	56.28	52.01	47.16	43.23	35.52	33.48	39.26	44.62
Minnesota Hub	1.54	0.00	-1.31	-0.46	0.74	1.88	17.66	23.92	23.17	27.88	31.25	32.21	32.98	30.62	28.40	27.41	27.85	31.43	47.90	45.25	42.12	31.89	21.34	18.72	22.68	31.60
Wisconsin PS	10.68	8.07	5.31	5.85	8.38	10.97	23.81	28.51	32.59	31.22	30.55	32.75	33.00	30.60	28.85	28.06	28.28	32.38	51.13	48.94	44.94	31.78	28.09	24.74	26.64	33.85
Cleared Load (GW)	57.8	57.1	56.6	56.3	57.0	60.3	68.9	75.3	75.8	75.6	75.6	74.9	74.2	73.5	72.4	71.5	71.7	73.9	77.9	77.7	76.4	75.0	70.9	6.6		

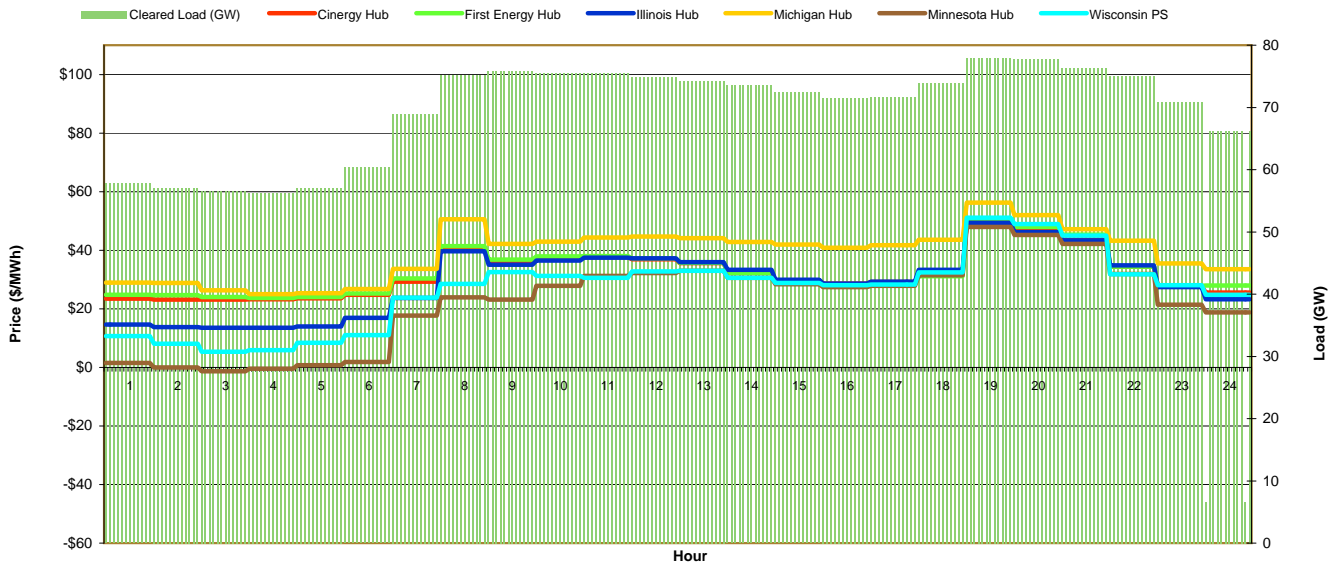

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	-31.02	-22.58	20.21	22.66	21.69	21.99	44.19	41.63	65.02	74.54	60.81	31.33	26.44	26.84	25.84	24.61	25.09	23.81	49.56	34.43	31.06	27.81	26.51	27.56	29.17	37.21
First Energy Hub	-32.01	-23.01	20.97	23.63	22.60	22.56	45.98	43.25	67.37	77.98	63.79	32.88	27.54	27.94	26.84	25.51	25.99	24.67	51.50	35.81	32.35	28.77	27.48	28.40	30.37	38.73
Illinois Hub	-31.09	-28.96	9.88	6.76	9.83	19.21	34.28	39.52	62.47	70.91	57.71	29.80	25.42	25.91	25.04	23.90	24.32	23.07	48.00	33.35	29.95	26.95	25.67	26.62	25.77	35.75
Michigan Hub	-32.62	-23.19	21.95	24.97	23.64	22.93	62.08	75.94	78.87	106.42	92.28	64.26	28.32	28.69	27.60	26.22	26.70	25.08	64.16	63.14	59.16	32.10	40.13	33.78	40.53	52.44
Minnesota Hub	-51.57	-34.24	-4.24	-10.01	4.47	-12.57	23.87	26.09	60.86	68.06	55.64	29.27	25.05	25.33	24.38	23.01	23.27	22.22	47.10	33.13	28.67	21.42	22.99	16.91	19.55	33.53
Wisconsin PS	-24.67	-30.63	7.60	2.90	7.20	22.62	35.87	41.50	66.04	74.60	60.18	31.60	26.89	27.44	26.52	25.30	25.71	24.44	51.72	36.04	31.91	28.21	26.85	22.90	27.03	37.81
Forecasted Load (GW)	60.4	58.9	59.2	59.2	60.1	62.0	66.8	72.7	74.3	74.5	74.5	74.0	73.2	72.6	71.8	70.9	70.7	71.8	75.6	77.2	76.2	74.0	70.6	67.4		
Forecast Error %	-3.8%	-3.9%	-5.8%	-5.9%	-5.9%	-3.8%	-1.6%	-1.2%	-1.3%	-1.2%	-0.8%	-0.7%	-1.0%	-0.8%	-0.9%	-1.2%	-1.1%	-1.9%	-2.4%	-1.0%	-0.6%	-0.2%	0.3%	-0.5%		

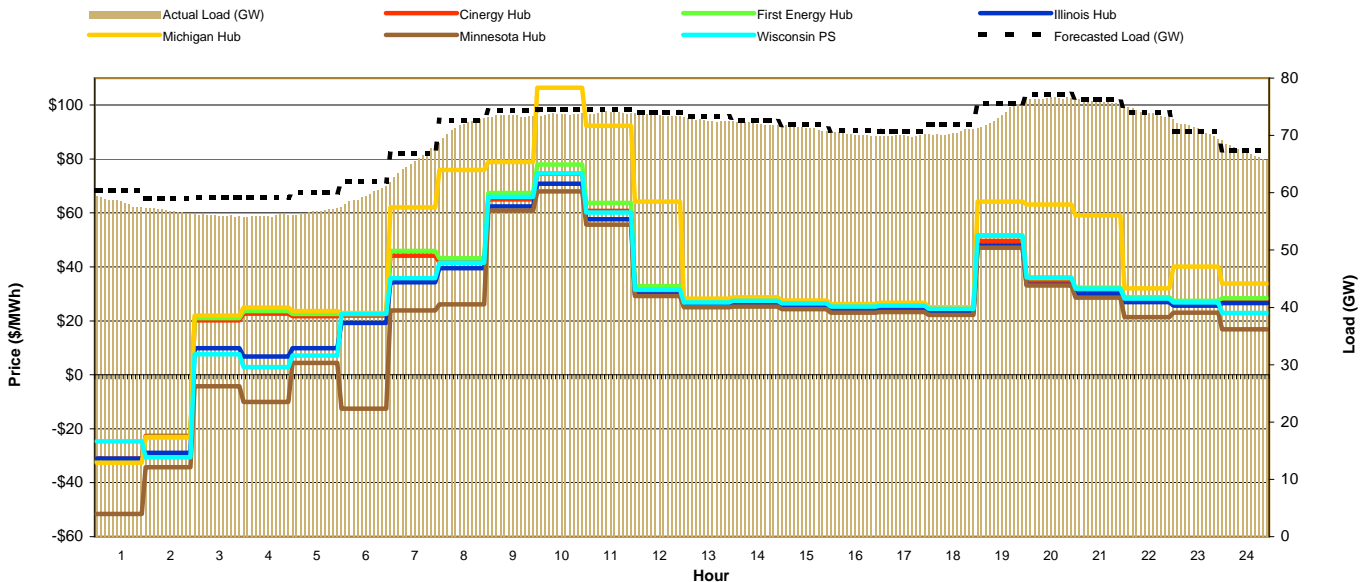




# MISO Daily Report

Tuesday February 15, 2011

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$	
																									All	On Pk
Cinergy Hub	25.81	24.67	24.65	24.70	25.36	29.96	43.82	47.16	44.96	44.31	43.68	37.51	34.07	30.94	29.00	28.25	28.42	31.34	45.19	43.89	40.53	32.50	28.32	27.57	34.03	36.88
First Energy Hub	27.83	26.40	25.60	25.41	26.05	31.03	44.66	48.65	46.65	45.97	45.31	38.77	35.89	32.88	30.95	29.90	30.21	33.06	46.32	45.09	42.16	34.65	29.77	28.93	35.51	38.51
Illinois Hub	16.90	15.35	15.08	15.32	16.11	21.18	28.43	45.05	38.14	37.46	37.08	33.27	31.38	27.45	27.82	25.39	26.52	29.90	43.28	42.20	39.59	31.79	24.34	21.09	28.76	33.79
Michigan Hub	36.15	34.84	30.51	29.28	29.84	36.69	63.20	67.51	61.56	59.38	59.02	50.26	46.21	42.08	39.10	36.69	37.99	42.05	64.19	58.55	52.43	43.71	35.68	36.07	45.54	49.78
Minnesota Hub	5.00	3.08	2.71	2.65	2.54	2.41	16.17	21.49	21.41	21.33	21.03	20.77	20.50	17.41	17.12	16.18	17.08	20.73	30.92	39.64	32.47	29.28	20.58	18.79	17.55	23.00
Wisconsin PS	19.64	15.70	10.94	11.42	12.90	17.99	25.57	35.24	39.55	35.33	34.08	32.63	32.66	31.66	28.63	28.01	28.15	32.13	52.29	47.64	41.92	29.57	25.60	22.61	28.82	34.69
Cleared Load (GW)	59.4	58.1	57.1	56.9	57.8	63.0	71.6	77.7	77.1	76.5	76.6	75.9	74.9	73.8	72.4	71.6	71.3	73.1	77.5	76.7	75.5	73.5	69.1	6.4		

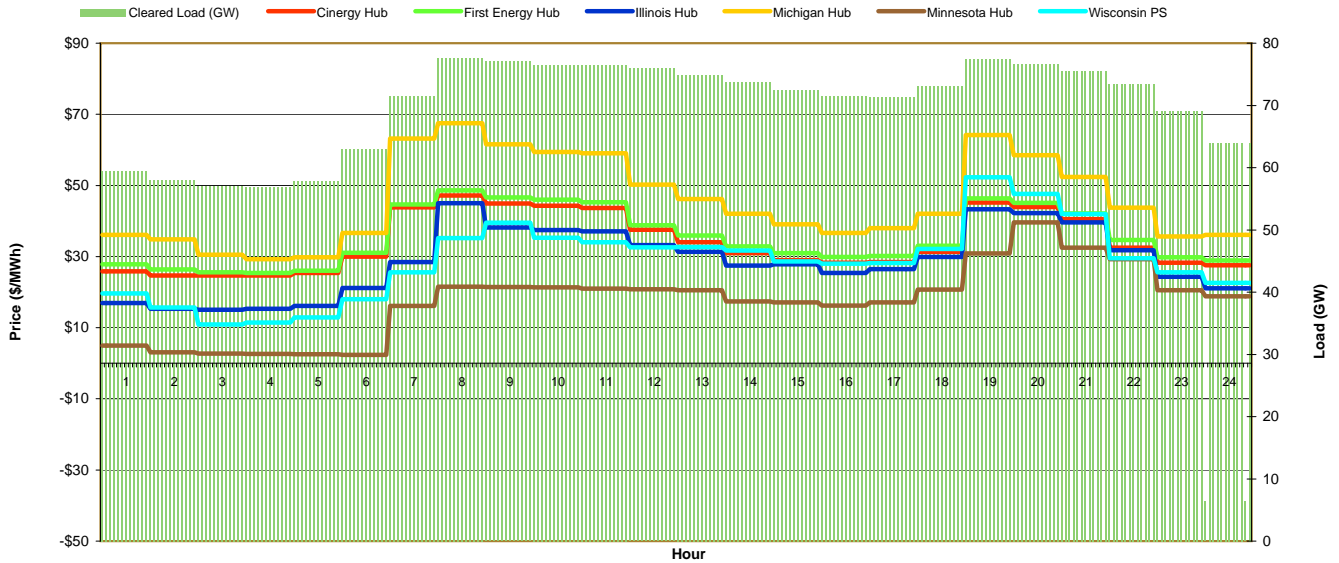

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$	
																									All	On Pk
Cinergy Hub	23.84	26.92	23.68	36.69	25.28	22.66	79.02	29.12	25.72	70.73	36.59	25.14	27.28	25.73	24.32	21.67	25.20	22.69	26.19	29.11	27.31	25.41	23.94	23.85	30.34	29.13
First Energy Hub	26.17	37.79	24.29	36.83	25.44	23.35	81.05	30.24	26.69	72.43	36.94	25.91	28.18	26.23	25.02	22.51	25.93	23.59	27.31	30.40	28.56	26.53	24.89	25.49	31.74	30.09
Illinois Hub	22.13	18.07	22.63	30.36	17.79	19.18	66.80	26.89	22.64	51.77	17.39	5.93	9.55	-0.68	16.66	12.15	-4.64	18.27	20.78	22.07	5.35	22.97	20.63	23.15	20.33	16.73
Michigan Hub	31.48	62.06	25.06	34.82	25.11	24.24	81.89	45.89	26.89	70.04	34.25	25.56	28.03	25.18	26.01	22.85	25.42	23.80	27.29	30.35	28.43	26.66	25.18	26.12	33.44	30.74
Minnesota Hub	10.30	-35.33	16.63	-42.04	-42.86	9.48	-2.88	24.77	16.50	-23.02	-42.27	7.32	12.77	-26.98	-1.27	18.58	1.31	19.65	23.73	26.84	24.65	22.99	21.48	16.42	2.37	7.94
Wisconsin PS	15.99	-8.20	20.16	-5.38	-16.09	14.41	36.90	28.91	27.52	33.05	-0.90	22.55	24.89	12.74	13.37	23.34	21.76	23.39	27.80	31.50	32.34	26.02	24.72	20.87	18.82	23.31
Forecasted Load (GW)	65.4	63.7	62.7	62.4	63.2	65.7	69.6	74.9	76.1	75.7	75.1	74.1	73.0	72.0	70.9	69.8	69.4	70.5	74.2	76.0	75.0	73.0	69.4	65.2		
Forecast Error %	-2.2%	-2.1%	-2.4%	-2.4%	-2.5%	-2.0%	0.8%	1.0%	0.8%	0.3%	0.1%	0.3%	0.2%	0.2%	0.6%	0.9%	1.0%	0.8%	0.6%	1.1%	1.3%	1.2%	1.2%	1.3%		

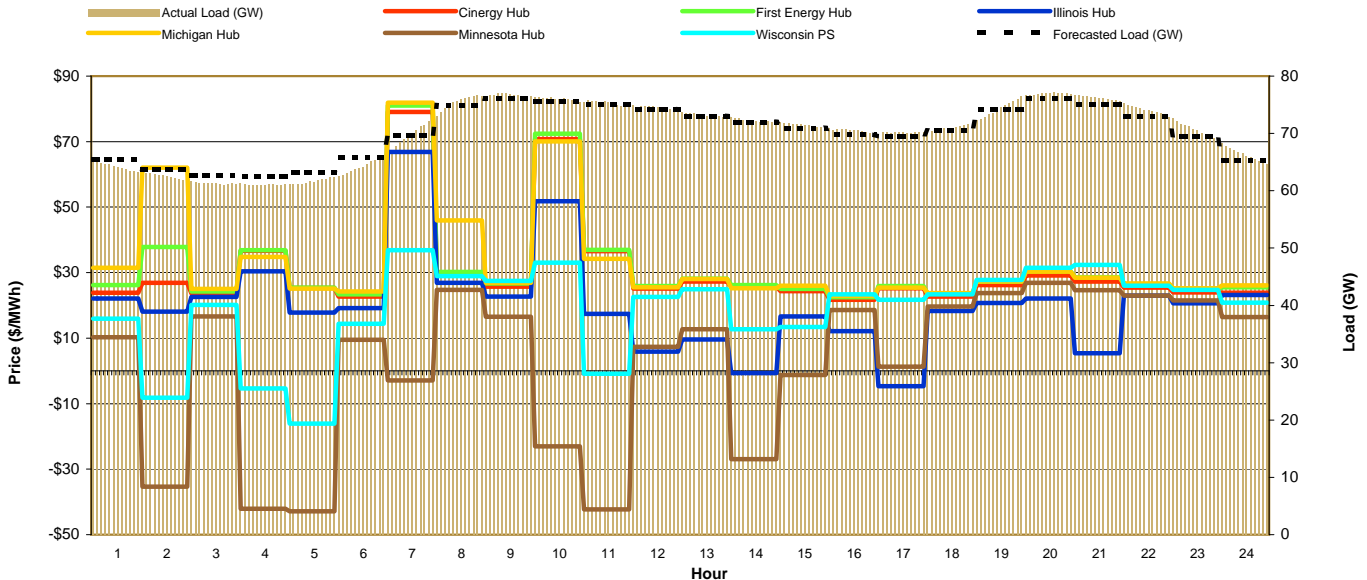




# MISO Daily Report

Wednesday February 16, 2011

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$			
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk		
Cinergy Hub	25.43	24.60	24.08	23.59	24.14	25.52	35.00	41.09	37.43	37.91	36.99	34.66	33.07	31.93	29.96	28.92	29.00	32.27	42.38	40.85	36.39	31.62	28.98	25.00	31.62	34.47	25.00	31.62
First Energy Hub	26.64	24.71	24.05	23.49	24.08	25.52	35.48	42.19	40.04	40.95	39.98	37.77	36.30	35.34	32.92	31.60	29.58	33.14	43.59	41.97	37.47	32.83	27.71	25.58	33.03	36.46	25.58	33.03
Illinois Hub	12.56	11.92	12.32	12.78	12.92	14.36	19.34	29.04	26.30	25.89	25.31	22.81	22.00	21.05	20.53	20.39	19.73	21.25	25.33	24.47	21.72	20.89	16.57	10.97	19.60	22.71	10.97	19.60
Michigan Hub	31.91	29.63	29.25	29.10	29.72	29.69	45.88	48.71	44.21	46.61	46.05	42.92	42.13	41.36	37.92	37.08	37.25	40.33	53.23	51.19	45.97	39.64	34.16	31.15	39.38	43.05	31.15	39.38
Minnesota Hub	10.56	6.71	5.15	3.74	4.08	11.35	20.31	31.68	33.29	30.55	28.39	25.26	23.45	21.47	20.63	19.36	18.10	20.71	30.69	28.20	23.96	19.69	15.81	9.16	19.26	24.45	9.16	19.26
Wisconsin PS	17.37	12.72	11.01	9.07	9.37	17.65	26.64	42.89	44.36	42.11	39.71	36.13	33.01	31.08	29.18	27.54	28.09	34.18	53.92	50.29	42.66	34.02	27.61	21.51	30.09	37.30	21.51	30.09
Cleared Load (GW)	59.4	57.9	56.9	56.7	57.4	60.3	68.9	73.9	74.1	73.7	73.7	73.1	72.3	71.4	70.3	69.3	69.3	71.6	76.2	75.7	74.2	71.3	66.6	61			61	76

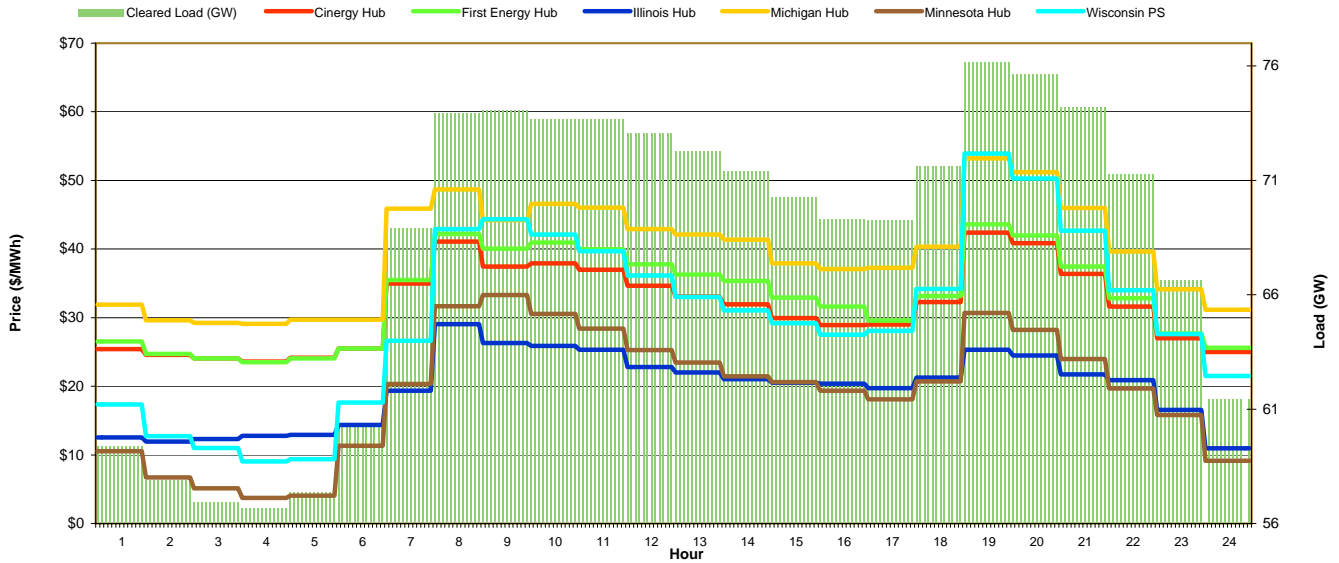

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$			
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk		
Cinergy Hub	17.80	17.77	21.06	22.64	22.82	19.54	25.80	48.78	25.63	24.97	24.78	23.46	23.59	22.82	20.27	20.22	19.06	13.21	23.02	24.10	23.04	21.32	17.71	12.50	22.33	23.50	22.33	23.50
First Energy Hub	27.07	19.69	33.82	23.75	24.81	20.33	26.76	50.82	26.69	25.98	25.74	24.39	24.50	23.72	21.03	20.96	19.77	13.62	23.88	25.02	24.77	22.59	18.41	12.85	24.21	24.49	24.21	24.49
Illinois Hub	13.27	16.48	14.49	21.38	20.61	18.64	24.70	46.75	24.77	24.17	24.03	22.77	22.91	22.14	19.71	19.68	18.50	12.83	22.16	23.18	22.81	20.76	16.98	11.33	21.04	22.76	11.33	21.04
Michigan Hub	48.08	23.21	62.85	24.71	28.79	20.53	26.84	50.80	26.60	26.13	25.90	24.60	24.73	23.93	21.23	21.18	19.87	13.64	23.92	25.13	24.84	22.75	18.65	12.49	26.73	24.62	12.49	26.73
Minnesota Hub	6.68	15.69	12.26	17.95	2.56	17.47	23.82	45.91	24.96	23.47	22.55	21.96	19.34	18.43	12.58	15.39	15.28	11.25	17.90	22.40	19.27	16.59	13.62	14.55	18.00	20.06	14.55	18.00
Wisconsin PS	9.35	17.25	14.19	21.03	9.23	19.34	26.03	49.81	26.67	26.03	25.91	24.81	22.77	24.33	22.59	21.99	21.73	14.95	30.16	26.03	24.31	21.56	18.00	8.35	21.93	25.10	8.35	21.93
Forecasted Load (GW)	63.5	62.7	61.6	61.3	61.8	63.9	68.1	72.3	73.3	73.0	72.8	72.1	71.2	70.5	69.6	68.8	68.4	69.0	72.5	74.2	73.2	70.9	67.3	63.1			63.1	74.2
Forecast Error %	-1.4%	-3.6%	-3.7%	-4.2%	-4.1%	-3.4%	-1.2%	0.5%	0.2%	-0.1%	-0.9%	-1.0%	-1.1%	-1.5%	-1.4%	-1.6%	-1.7%	-2.0%	-1.0%	-1.1%	-1.1%	-1.1%	-1.4%			-1.4%	-1.4%	

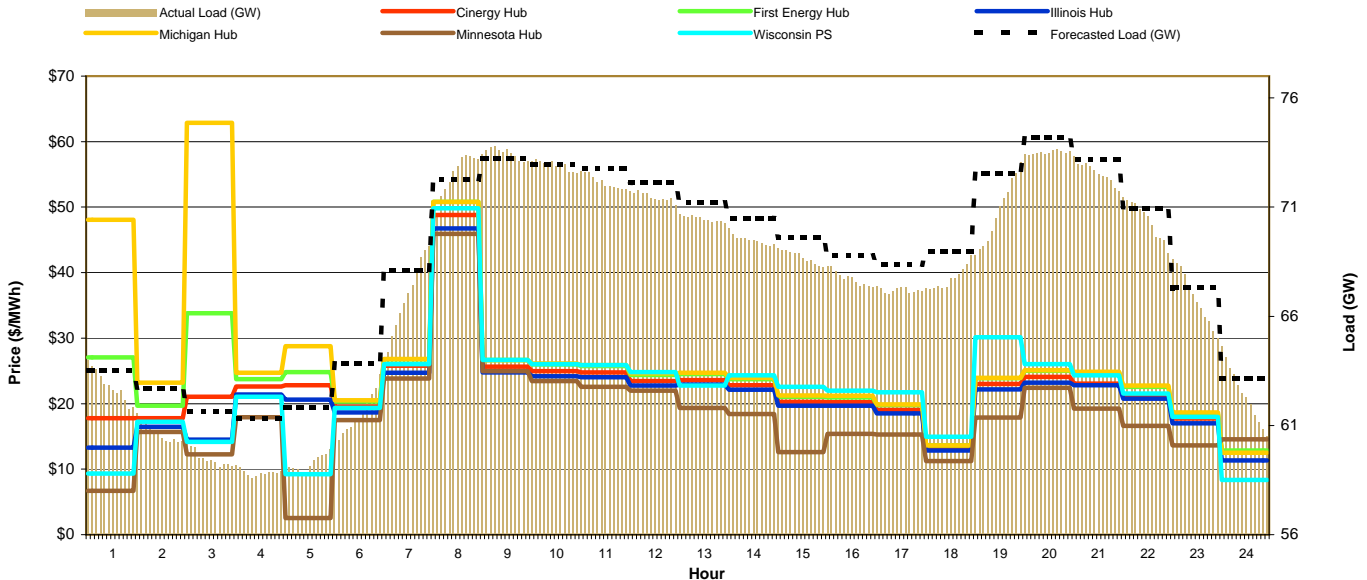






# MISO Daily Report

Thursday February 17, 2011

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	18.51	18.98	18.35	18.33	19.11	21.87	27.01	30.24	27.65	27.81	27.28	27.14	26.67	26.72	25.82	25.75	25.12	26.48	29.98	29.23	28.31	26.69	24.01	20.05	24.88	27.18
First Energy Hub	18.60	19.90	18.50	18.80	19.23	22.18	27.53	31.38	28.38	28.49	27.92	27.74	26.90	26.94	25.98	25.93	25.26	26.83	30.80	30.37	28.92	27.23	24.20	21.13	25.38	27.70
Illinois Hub	15.24	14.25	14.00	14.09	14.55	20.21	23.11	28.96	25.68	25.28	24.65	23.91	21.68	21.71	21.14	21.25	20.89	22.72	28.00	26.60	25.70	24.08	21.88	17.42	21.54	24.01
Michigan Hub	19.38	22.64	19.56	20.62	20.20	23.34	29.28	32.90	29.49	29.63	29.25	29.09	27.31	27.43	26.45	26.46	25.78	27.33	34.19	36.38	30.65	29.06	27.88	24.65	27.04	29.33
Minnesota Hub	3.74	1.46	1.02	0.13	0.62	2.76	16.40	23.26	22.12	21.84	21.28	20.77	20.48	18.09	16.28	15.78	14.00	16.73	22.16	21.14	20.50	16.94	11.57	3.82	13.87	18.93
Wisconsin PS	12.19	9.26	8.30	7.54	7.38	11.80	21.51	26.16	26.76	26.45	25.02	24.89	24.76	24.38	24.86	25.04	25.16	25.49	28.18	26.81	25.75	23.56	22.16	15.64	20.79	25.34
Cleared Load (GW)	55.2	53.9	53.3	52.5	53.4	56.1	65.1	72.3	72.2	71.9	71.4	70.8	70.0	69.4	68.4	67.4	67.1	68.7	74.3	73.3	71.5	67.5	63.3	57		

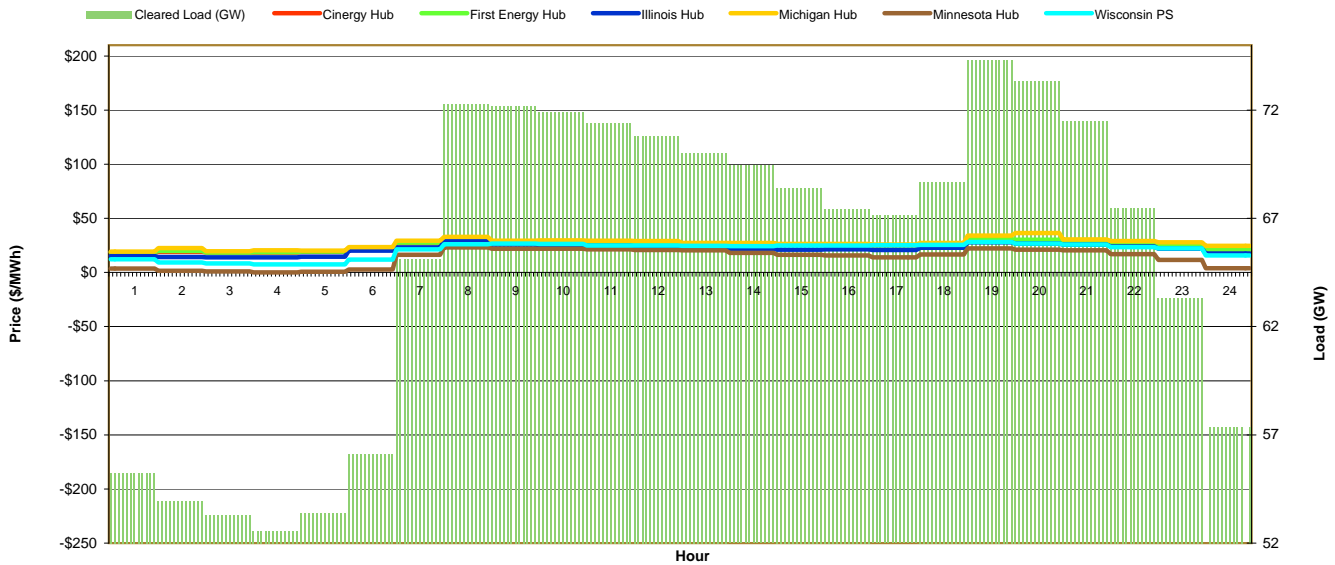

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	13.47	17.65	4.04	23.41	21.41	22.38	24.96	26.00	23.28	32.96	25.54	23.00	22.22	34.44	22.67	41.88	22.20	25.60	34.78	33.35	23.31	23.25	19.08	20.50	24.22	27.10
First Energy Hub	14.13	18.54	4.37	23.14	20.32	22.19	26.38	27.88	25.14	35.72	28.43	30.15	26.28	48.65	27.77	46.67	25.00	27.92	36.64	36.61	26.05	25.19	20.14	21.66	26.87	30.89
Illinois Hub	13.08	16.87	3.86	17.56	-5.66	14.58	20.60	23.48	23.22	31.17	18.76	22.91	22.38	32.26	22.92	44.30	23.46	26.47	36.38	33.75	24.09	24.75	18.96	20.33	22.10	26.83
Michigan Hub	14.21	18.63	4.38	23.81	22.10	22.05	26.64	28.27	25.33	36.26	29.20	25.24	24.96	39.11	26.10	45.31	24.77	30.19	43.86	40.42	26.65	25.90	20.43	22.66	26.94	30.75
Minnesota Hub	13.05	16.71	3.87	-8.39	-53.34	9.70	18.26	21.65	22.22	26.14	15.24	18.75	10.96	-14.07	-6.09	-243.28	-31.08	-73.50	-77.00	44.66	15.12	-37.57	12.62	-0.20	-12.32	-18.45
Wisconsin PS	14.10	18.18	4.28	1.63	-38.59	14.18	21.70	25.54	25.43	31.80	23.66	30.32	33.32	36.64	59.93	192.17	59.14	99.47	103.69	41.58	46.05	61.41	43.41	10.57	39.98	57.09
Forecasted Load (GW)	60.2	58.3	58.1	57.8	58.4	60.4	63.9	69.3	70.9	71.0	71.1	71.0	70.4	69.9	69.3	68.3	67.7	68.1	70.8	72.5	71.3	69.1	65.6	62.0		
Forecast Error %	-3.0%	-3.3%	-5.1%	-5.4%	-5.6%	-4.9%	-1.4%	-0.7%	-0.8%	-0.3%	-0.2%	-0.6%	0.0%	0.0%	0.1%	0.6%	0.5%	0.9%	0.3%	0.7%	0.8%	0.7%	0.5%	0.0%		

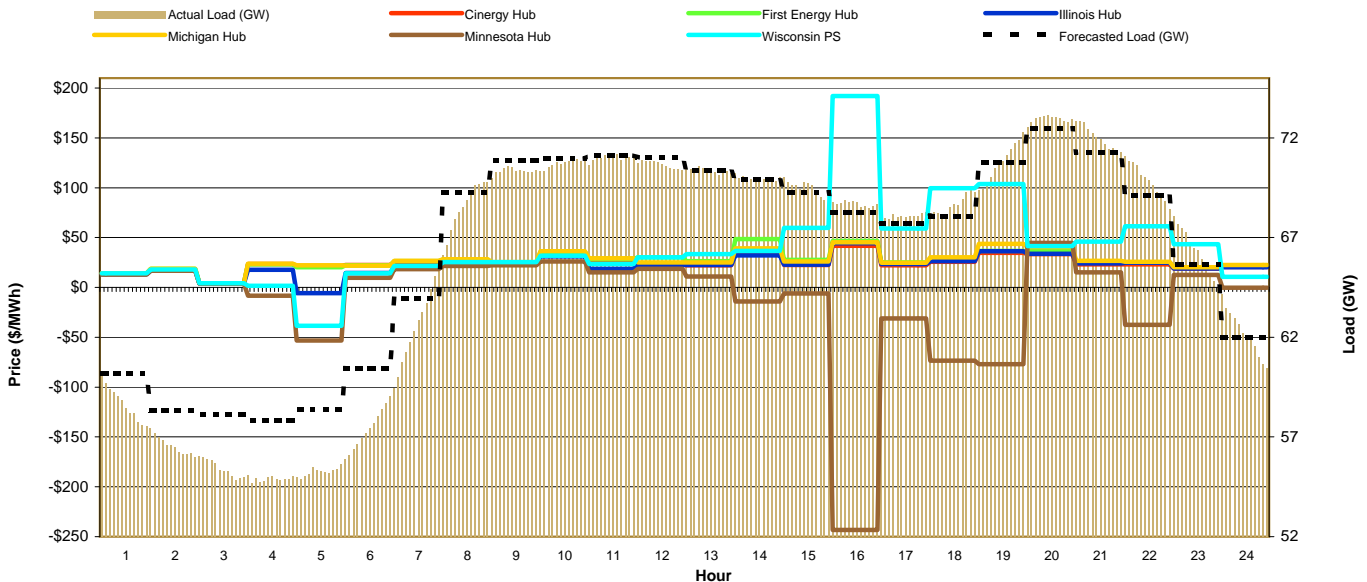




# MISO Daily Report

Friday February 18, 2011

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	19.27	16.21	15.72	15.79	15.36	22.17	26.58	33.15	30.07	30.34	30.49	29.85	29.11	27.88	26.54	26.23	26.24	26.85	34.88	34.69	30.51	28.29	26.13	24.15	26.10	29.45
First Energy Hub	20.04	16.86	16.29	16.36	16.05	22.83	27.60	33.77	31.07	31.49	31.49	30.77	30.05	28.78	27.46	27.12	26.99	27.65	36.02	35.94	31.42	29.22	26.54	24.43	26.93	30.36
Illinois Hub	13.85	12.54	12.27	12.45	12.65	18.71	25.06	29.36	28.30	29.23	28.57	27.90	27.23	26.11	25.40	25.08	24.69	24.80	33.45	33.70	29.48	27.31	24.79	22.70	23.98	27.84
Michigan Hub	21.03	17.65	17.05	17.19	16.87	24.22	28.49	36.98	32.41	32.87	33.19	32.00	31.19	30.11	28.37	27.81	27.64	28.78	38.44	38.06	32.27	30.16	27.80	25.49	28.17	31.76
Minnesota Hub	1.06	0.73	-0.90	0.01	-0.61	2.27	15.56	20.76	20.76	20.81	21.01	20.90	20.73	20.55	19.73	19.54	20.16	22.42	33.09	34.76	30.24	27.59	22.47	20.36	17.25	23.47
Wisconsin PS	7.88	6.14	5.30	4.43	4.45	9.15	21.19	29.58	30.36	29.60	28.93	28.62	27.30	26.00	25.14	24.62	24.92	27.44	35.48	38.87	33.64	30.23	25.23	23.04	22.81	29.12
Cleared Load (GW)	52.7	51.1	50.0	49.6	49.5	53.6	62.5	70.4	71.0	71.1	71.0	70.4	69.6	68.4	67.0	65.8	65.6	67.6	71.3	71.0	69.8	67.7	64.1	5.7		

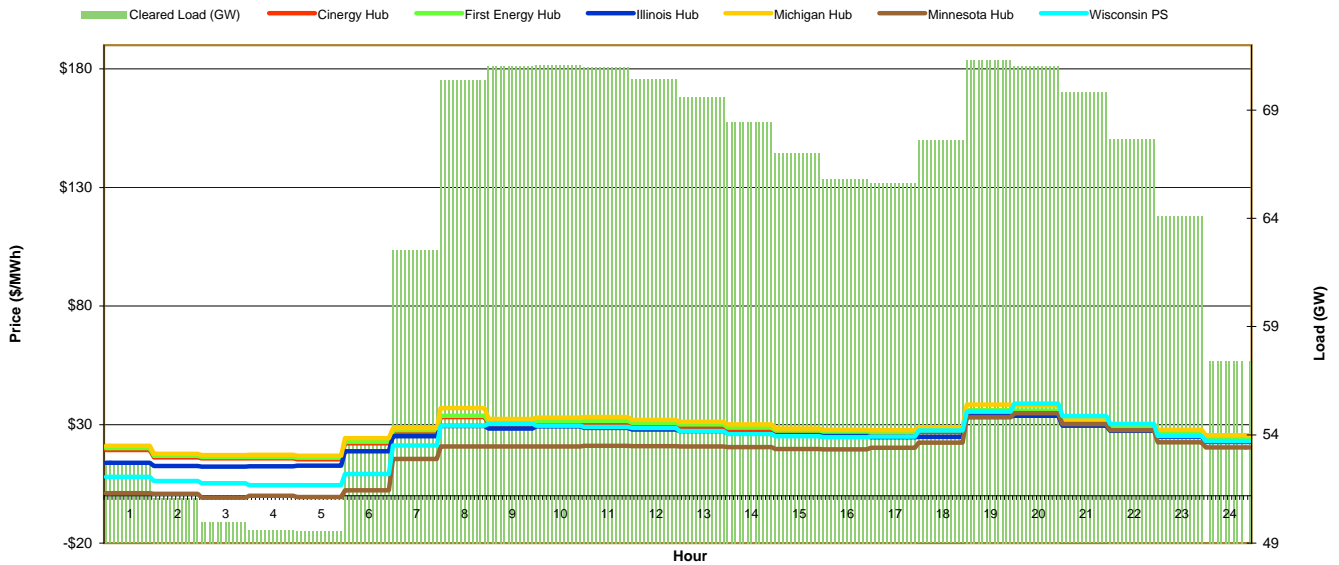

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	23.87	17.43	16.44	16.50	2.35	18.07	63.96	26.02	24.80	25.60	24.28	27.44	26.50	27.26	26.06	25.20	24.92	24.98	147.66	51.58	30.28	28.47	25.34	25.31	31.26	35.40
First Energy Hub	22.79	17.97	16.93	16.96	2.40	18.56	63.71	26.81	25.60	27.48	27.13	30.05	28.62	28.72	27.06	26.14	25.87	25.86	152.83	53.54	31.37	29.44	26.21	26.21	32.43	37.05
Illinois Hub	14.14	16.71	15.77	15.83	2.25	17.08	51.64	24.92	23.89	24.68	21.61	28.04	26.63	26.19	25.11	24.26	24.01	24.06	142.53	49.30	29.45	27.67	24.69	24.60	29.38	34.19
Michigan Hub	23.17	18.09	16.97	16.93	2.40	18.48	63.39	27.13	26.00	28.03	27.75	30.53	29.04	29.11	27.44	26.46	26.14	26.21	155.86	54.52	32.03	30.16	26.68	26.53	32.88	37.69
Minnesota Hub	-12.51	16.54	11.12	15.37	2.15	15.70	33.11	22.90	22.66	24.67	24.36	23.11	25.29	24.55	25.05	23.60	23.48	23.78	186.63	96.19	34.45	29.17	25.85	25.09	30.93	39.73
Wisconsin PS	-1.68	17.92	16.59	16.85	2.41	18.40	60.29	27.99	26.27	28.21	28.41	34.04	28.66	28.09	27.18	26.07	25.80	25.96	159.54	58.93	32.59	30.16	26.95	26.65	32.18	38.43
Forecasted Load (GW)	59.3	58.2	56.1	55.8	56.4	59.5	64.1	68.5	70.0	70.2	70.3	70.1	69.5	68.8	67.9	66.8	66.2	66.4	68.8	70.6	69.7	68.2	66.3	63.0		
Forecast Error %	-1.6%	-3.3%	-1.9%	-2.4%	-2.7%	-4.1%	-2.6%	-0.9%	-0.9%	-0.2%	0.0%	0.0%	0.1%	0.1%	-0.1%	-0.7%	-0.8%	-0.5%	0.1%	0.6%	0.9%	0.2%	0.5%			

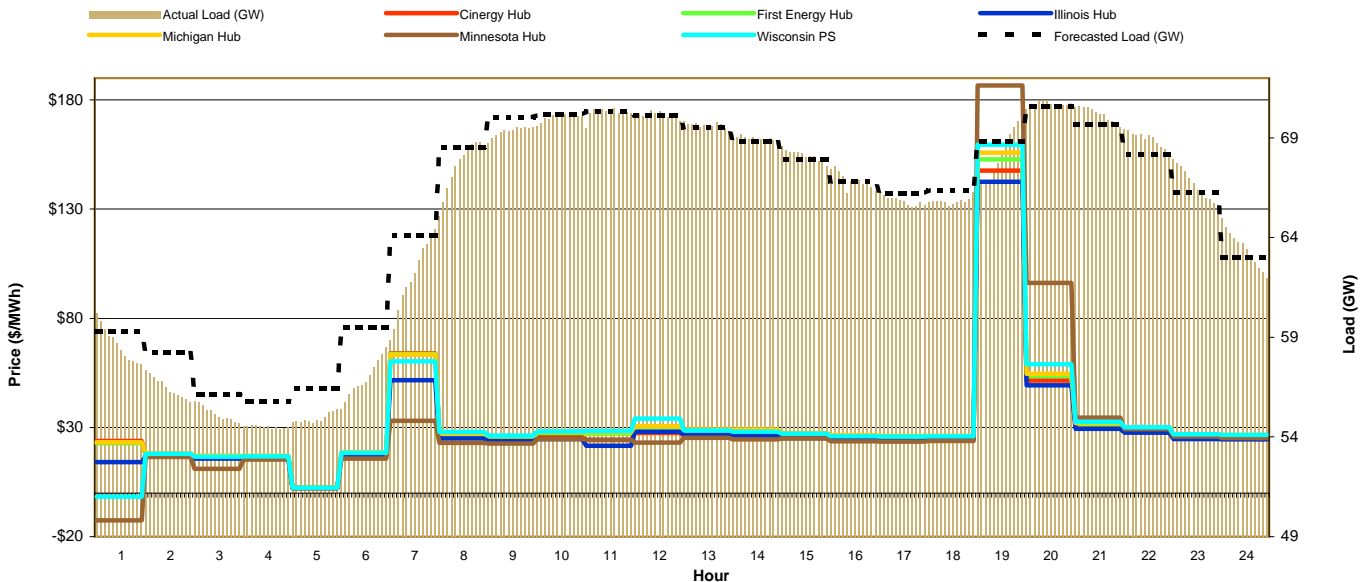




# MISO Daily Report

Saturday February 19, 2011

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	24.50	24.95	24.80	21.81	23.48	24.09	25.78	29.20	30.59	35.19	35.19	30.54	28.28	26.85	25.84	25.41	25.92	27.80	37.96	37.08	32.21	29.73	28.66	24.88	28.36	30.40
First Energy Hub	24.75	25.12	24.97	22.05	23.75	24.31	26.37	30.03	30.96	35.39	35.38	31.04	28.92	27.49	26.46	26.04	26.64	28.67	37.83	37.10	32.47	30.09	28.65	25.08	28.73	30.82
Illinois Hub	20.93	21.12	20.90	18.80	20.52	20.90	23.12	25.07	25.68	28.04	28.03	26.12	24.77	23.20	22.64	22.55	22.93	24.72	29.20	29.32	26.90	25.24	23.47	21.56	23.99	25.49
Michigan Hub	25.28	25.69	25.56	22.60	24.35	24.89	27.17	30.94	31.87	36.40	36.37	31.91	29.76	28.31	27.26	26.83	27.44	29.52	42.25	41.78	33.38	30.98	29.28	25.65	29.81	32.14
Minnesota Hub	18.46	18.09	16.82	15.00	14.52	15.83	18.85	21.06	21.97	25.78	26.52	24.35	22.35	20.62	20.01	19.24	20.06	20.95	26.62	29.96	24.66	22.18	20.35	18.28	20.94	22.92
Wisconsin PS	21.31	20.98	20.06	17.86	18.29	19.49	22.35	25.62	26.69	30.10	30.53	27.86	25.56	23.67	22.77	22.14	23.20	25.61	31.98	33.79	29.02	26.30	24.10	21.41	24.61	26.81
Cleared Load (GW)	54.6	54.6	53.8	50.9	52.0	53.8	58.0	62.3	64.2	65.8	65.8	65.1	63.3	60.9	59.5	59.0	59.8	62.3	68.3	68.5	66.1	64.4	61.7	5.7		

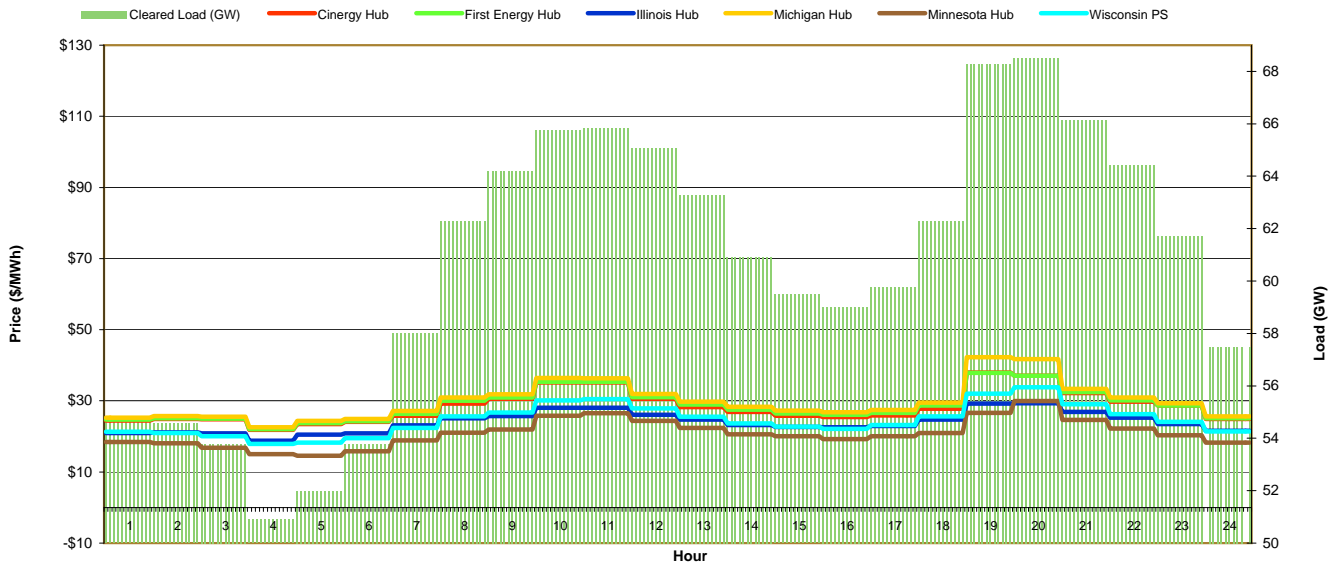

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	23.88	27.18	23.38	25.43	24.04	24.31	71.26	122.76	50.70	36.52	70.07	27.96	30.70	26.37	23.82	24.65	24.61	26.19	51.40	37.49	104.56	73.19	73.58	27.07	43.80	50.29
First Energy Hub	24.67	27.94	24.03	26.10	24.70	24.95	70.69	109.67	46.36	37.68	72.36	29.81	31.83	27.39	24.71	25.59	25.53	27.19	53.39	38.98	92.76	64.94	57.84	27.70	42.37	47.88
Illinois Hub	23.11	26.27	22.58	24.59	23.24	23.47	66.86	45.34	23.20	35.22	67.51	27.72	29.58	25.49	23.10	23.86	23.78	25.04	49.49	35.96	31.96	22.24	-9.57	25.87	29.83	30.00
Michigan Hub	25.04	28.35	24.41	26.43	24.99	25.18	71.55	110.75	47.00	38.35	73.36	30.26	32.27	27.77	25.03	25.95	25.82	27.53	54.07	39.52	94.01	65.76	58.42	28.34	42.92	48.49
Minnesota Hub	22.92	21.85	20.67	19.90	20.30	21.44	48.98	67.31	31.53	58.05	76.00	32.34	38.14	27.77	22.48	22.76	22.60	33.07	53.71	59.85	58.52	44.93	22.52	19.07	36.11	41.97
Wisconsin PS	24.66	24.10	22.73	22.31	22.61	24.03	62.41	81.88	37.00	38.28	73.61	30.49	32.92	27.69	24.67	25.34	25.22	27.69	53.81	40.46	68.10	46.98	28.42	23.62	37.04	41.41
Forecasted Load (GW)	59.9	59.3	58.1	57.7	57.7	58.8	61.3	62.7	64.3	65.8	66.4	65.9	64.8	63.5	62.2	61.2	61.0	62.1	65.7	67.9	67.4	66.0	63.9	61.1		
Forecast Error %	0.6%	-1.7%	-1.7%	-1.8%	-1.5%	-1.4%	-1.7%	0.1%	0.7%	1.4%	1.7%	1.8%	2.1%	1.9%	1.6%	1.8%	1.8%	1.1%	0.3%	0.6%	0.4%	0.8%	0.7%	0.7%		

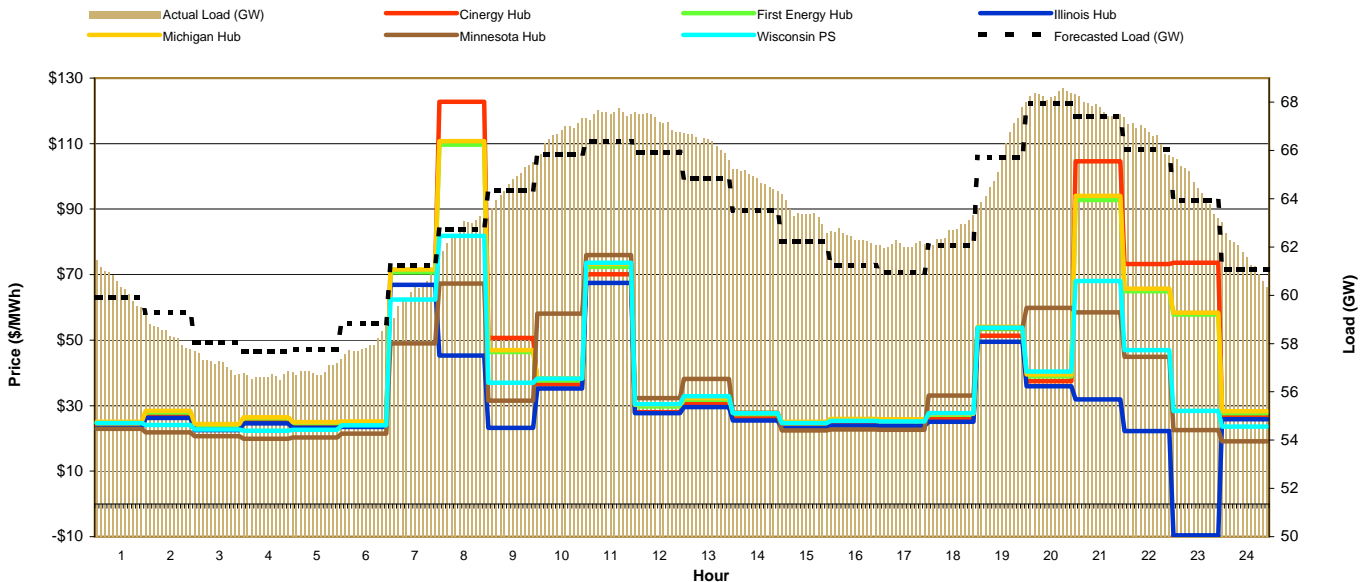




# MISO Daily Report

Sunday February 20, 2011

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	24.99	24.87	24.81	24.99	24.75	24.75	25.36	27.60	28.30	29.24	29.50	29.26	28.53	26.68	25.52	25.33	25.80	28.96	38.98	37.19	30.66	28.63	26.44	25.25	27.77	29.16
First Energy Hub	25.38	25.56	25.49	25.56	25.28	25.25	26.11	28.29	29.03	30.13	30.39	30.07	29.31	27.56	26.36	26.16	26.50	29.65	38.79	37.07	31.47	29.42	26.91	26.33	28.42	29.82
Illinois Hub	21.87	22.93	22.65	22.61	22.11	22.08	23.09	23.94	24.75	25.53	25.73	25.53	25.02	24.24	23.58	23.49	22.94	24.46	29.26	28.21	25.79	24.81	23.15	22.03	24.16	25.03
Michigan Hub	26.03	26.34	26.33	26.49	26.24	26.16	27.11	29.25	30.05	31.16	31.43	31.11	30.31	28.52	27.28	27.07	27.32	30.54	39.84	38.13	32.35	30.34	28.36	28.89	29.44	30.82
Minnesota Hub	15.35	13.97	11.69	8.38	6.22	7.18	9.44	14.95	16.31	19.77	20.02	19.52	18.81	17.02	16.45	15.00	16.40	18.36	25.15	24.85	21.73	19.88	17.18	13.79	16.14	18.84
Wisconsin PS	20.18	18.78	17.32	15.42	13.54	15.40	18.15	21.52	21.96	23.71	23.84	23.45	24.02	22.82	22.05	21.92	22.63	25.51	35.09	33.98	29.24	23.90	21.35	18.91	22.28	24.81
Cleared Load (GW)	54.4	53.6	52.8	53.1	52.9	53.6	55.7	58.5	60.8	62.6	63.1	62.8	62.3	61.3	60.2	59.8	60.5	63.1	68.3	69.0	67.0	64.0	61.0	58		

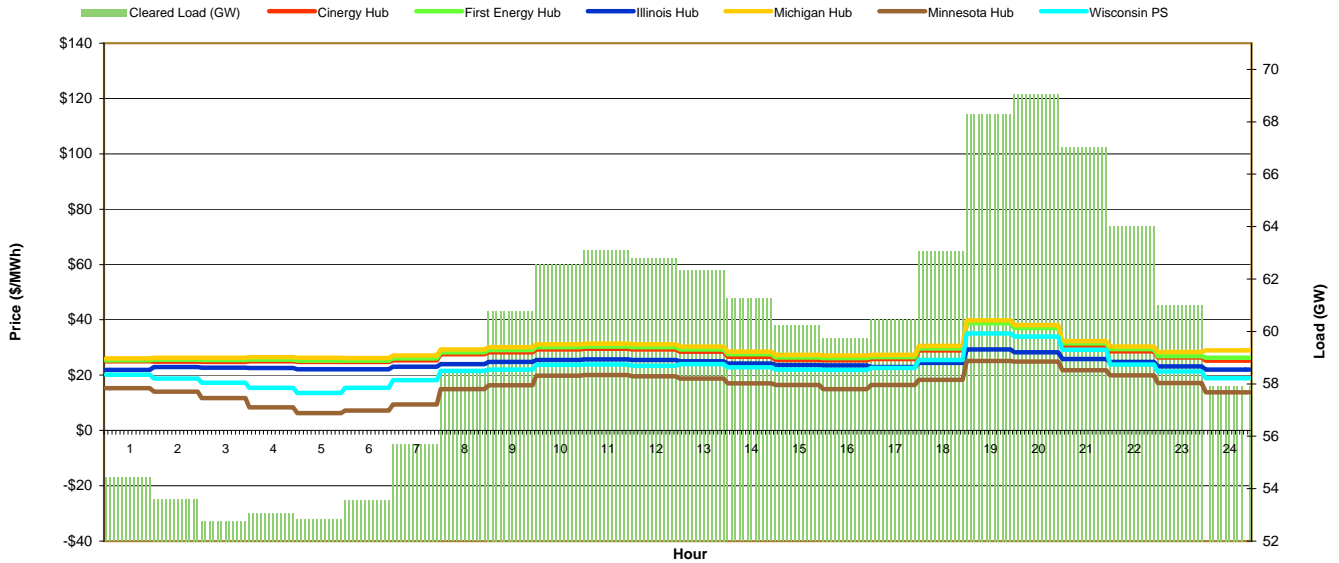

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	74.63	44.42	25.21	28.19	16.84	26.99	21.63	22.18	28.02	28.17	24.66	41.39	36.35	23.96	50.44	24.90	39.41	129.43	49.06	24.39	26.22	25.84	25.20	22.69	35.84	37.48
First Energy Hub	56.67	45.18	25.49	28.85	17.35	27.63	22.31	22.92	28.88	28.75	25.46	37.13	30.10	24.60	43.27	25.44	35.76	116.23	49.68	25.41	27.11	26.66	25.80	23.34	34.17	35.83
Illinois Hub	-10.31	27.99	18.05	23.09	14.86	24.68	18.47	19.97	19.14	22.83	22.33	14.36	2.48	22.97	9.96	23.87	16.23	54.30	40.60	23.26	24.63	24.61	24.21	21.85	21.02	22.86
Michigan Hub	57.54	44.01	24.24	29.46	17.68	28.61	22.57	23.15	29.51	29.23	25.85	37.53	30.46	25.10	43.99	26.13	43.34	132.93	77.84	53.05	40.42	30.94	26.56	24.07	38.51	42.25
Minnesota Hub	3.39	-22.45	-19.28	-35.18	13.14	-33.06	17.05	18.81	17.94	22.02	21.20	23.35	12.39	22.89	22.94	22.03	21.98	65.95	41.84	23.98	25.26	24.27	22.12	20.70	14.72	25.56
Wisconsin PS	19.71	3.39	-0.58	-11.47	14.73	-10.13	18.86	20.70	18.95	24.39	23.69	27.64	19.10	24.38	29.14	24.87	27.53	86.36	47.59	26.20	27.45	26.56	24.89	22.87	22.37	29.96
Forecasted Load (GW)	58.8	56.9	57.6	57.2	57.3	58.0	59.4	60.3	61.9	62.4	63.2	63.2	62.8	62.5	61.8	61.4	61.6	63.4	66.7	69.0	68.5	66.3	63.6	60.6		
Forecast Error %	-0.2%	0.3%	-2.9%	-3.3%	-3.5%	-4.0%	-3.8%	-2.0%	-1.5%	1.4%	2.0%	2.8%	3.7%	4.0%	4.3%	4.3%	4.4%	3.5%	3.6%	1.9%	1.1%	1.2%	1.1%	1.0%		

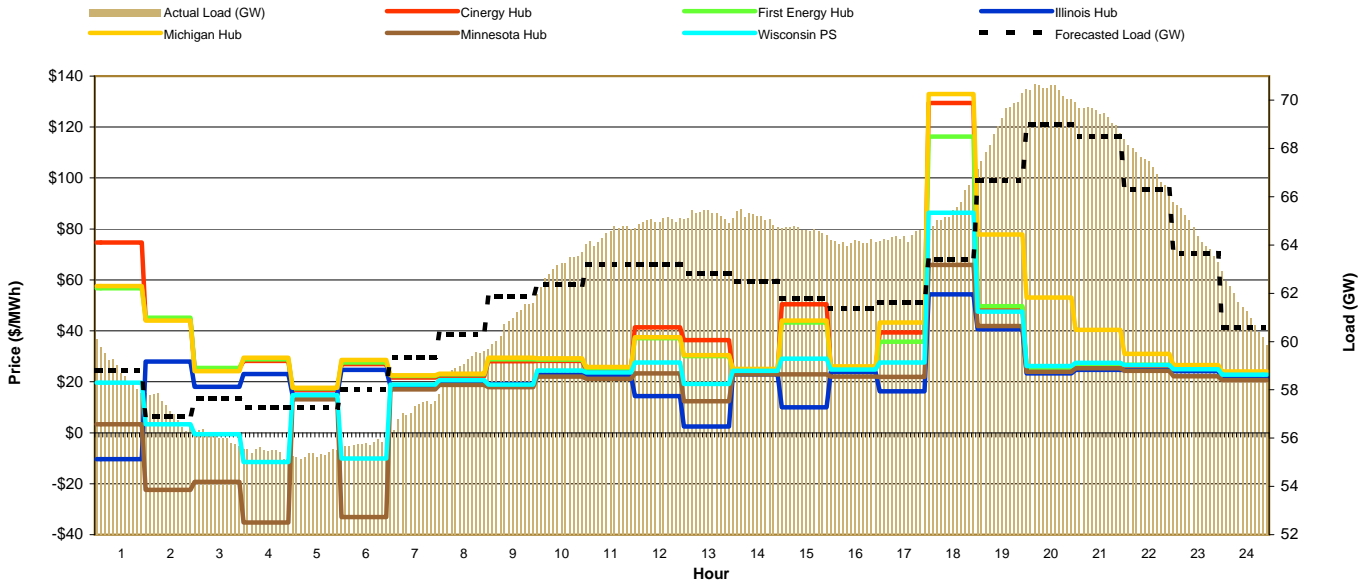




# MISO Daily Report

Monday February 21, 2011

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	23.99	22.97	22.42	22.13	22.63	26.10	32.03	33.18	28.88	29.82	31.61	30.87	29.71	28.30	26.98	27.31	27.88	29.60	43.13	44.49	36.96	32.91	26.31	25.42	29.40	31.75
First Energy Hub	24.17	23.29	22.81	22.58	22.99	26.34	34.47	35.33	32.17	32.42	34.85	34.82	33.57	31.87	29.88	30.04	30.36	33.03	44.58	46.13	41.42	37.44	29.89	28.10	31.77	34.86
Illinois Hub	19.91	19.65	19.42	19.45	19.52	21.38	23.84	27.38	26.38	27.92	29.33	28.44	27.41	26.19	25.26	25.53	25.70	26.80	41.28	43.08	38.19	34.39	25.70	22.17	26.85	29.94
Michigan Hub	24.72	23.96	23.53	23.31	23.69	27.06	41.62	41.67	40.24	39.65	42.55	43.35	42.54	41.32	38.54	38.35	38.37	41.04	46.27	53.07	44.79	42.43	37.78	36.30	37.34	42.00
Minnesota Hub	4.14	3.10	2.43	1.81	2.58	4.89	19.95	22.85	24.27	28.45	28.55	26.56	24.37	22.49	21.33	20.79	21.53	22.85	41.34	42.94	38.73	35.16	24.57	20.81	21.10	27.92
Wisconsin PS	12.60	11.43	10.12	9.75	10.58	13.81	24.78	29.88	29.76	30.19	30.18	30.30	30.10	28.85	28.67	27.90	28.20	30.30	44.05	45.69	42.17	38.26	26.48	23.06	26.54	32.56
Cleared Load (GW)	54.5	52.9	52.1	52.1	53.0	57.4	65.6	71.8	73.5	74.4	75.3	75.0	74.5	73.5	72.6	72.0	72.1	73.7	78.3	78.2	76.9	74.3	70.4	6.6		

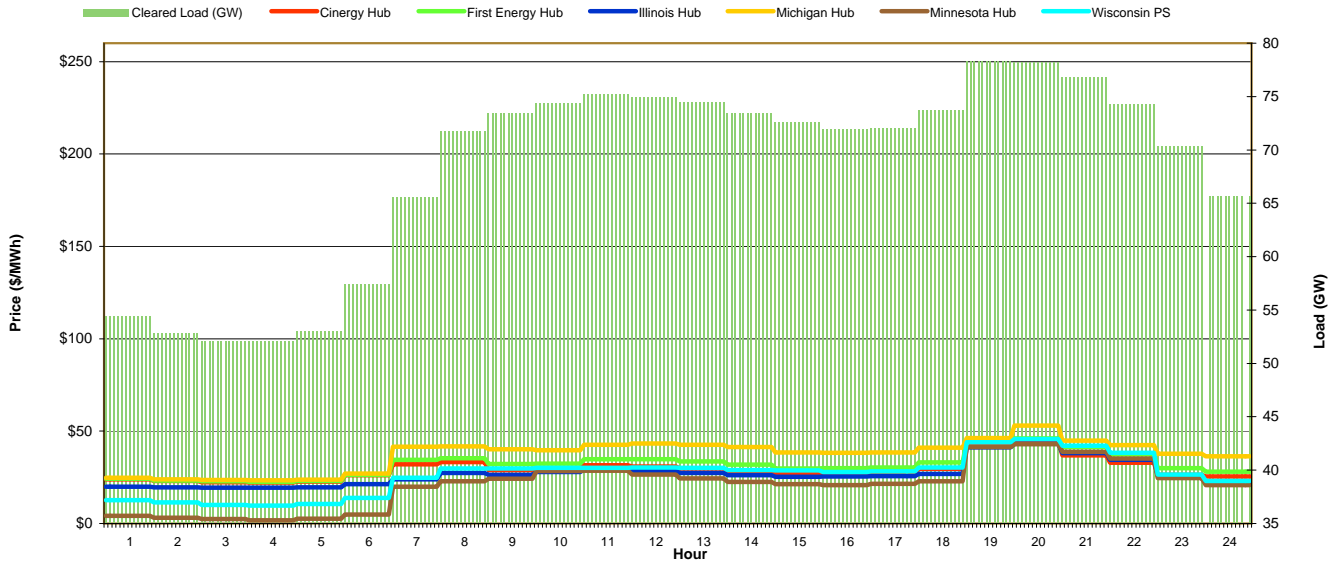

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	20.78	22.27	22.27	22.10	22.07	17.85	24.07	38.48	60.97	87.45	113.04	104.23	163.95	44.83	55.90	65.25	85.69	33.15	88.56	69.91	88.03	75.86	55.61	51.07	59.72	76.93
First Energy Hub	20.09	22.53	22.84	22.58	21.19	18.36	24.80	39.12	61.20	95.95	122.04	113.37	175.03	49.63	58.92	68.66	90.47	34.91	119.95	74.44	92.89	79.76	58.19	88.52	65.64	83.41
Illinois Hub	19.67	21.16	21.34	21.27	20.79	17.21	23.00	35.83	56.09	86.45	111.31	103.84	161.62	45.57	54.42	63.69	83.22	32.15	85.99	68.14	85.62	73.72	53.98	33.71	57.49	75.10
Michigan Hub	20.62	23.16	23.46	23.17	21.68	18.65	25.12	39.26	61.27	109.47	122.68	113.60	175.10	49.43	58.45	67.88	89.36	34.41	102.80	88.77	90.93	78.49	57.71	176.10	69.65	83.73
Minnesota Hub	11.73	24.53	23.21	20.54	15.15	18.63	36.99	61.82	81.08	170.64	184.16	195.70	255.41	77.98	94.31	91.81	154.97	42.30	157.70	157.51	174.20	111.66	73.19	49.33	95.19	130.28
Wisconsin PS	16.31	21.58	22.31	21.74	16.94	18.25	26.01	41.39	63.32	102.47	128.19	121.94	184.54	52.03	63.19	71.93	97.36	35.65	100.84	83.66	102.60	83.37	59.38	38.11	65.54	86.99
Forecasted Load (GW)	60.3	58.3	57.2	57.4	58.2	59.7	64.2	69.9	72.0	73.5	74.3	74.6	74.2	73.8	73.0	72.3	72.2	73.2	76.6	78.8	77.8	75.5	72.0	68.5		
Forecast Error %	-3.4%	-3.0%	-2.6%	-3.5%	-3.8%	-2.6%	-3.6%	-3.2%	-2.2%	-1.0%	-0.3%	0.6%	1.1%	1.8%	2.3%	2.4%	2.0%	1.2%	0.4%	0.0%	0.0%	0.0%	-0.2%			

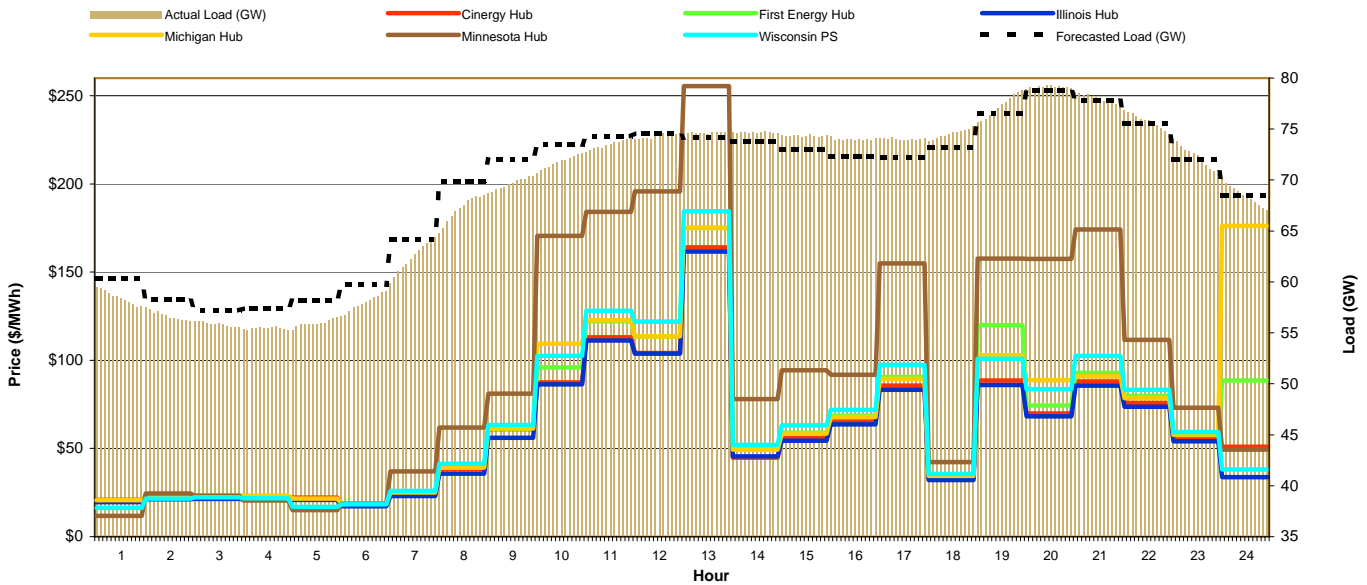




# MISO Daily Report

Tuesday February 22, 2011

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	25.13	24.88	24.73	24.24	24.85	29.50	39.12	49.78	50.03	47.99	47.37	44.87	42.65	39.49	33.45	31.25	30.57	42.99	59.41	60.15	55.60	44.37	35.00	34.04	39.23	44.89
First Energy Hub	29.43	27.98	27.51	27.03	28.19	31.42	38.54	51.41	50.90	48.86	48.22	45.55	43.34	40.03	35.03	32.78	32.00	41.73	58.72	60.01	54.72	43.15	34.69	33.66	40.20	45.07
Illinois Hub	21.70	21.08	21.17	20.91	21.03	12.87	24.87	34.30	42.25	40.52	39.96	36.51	35.27	32.86	29.64	27.01	26.73	21.39	36.99	41.39	32.29	20.98	13.51	4.86	27.50	31.98
Michigan Hub	38.31	33.43	32.19	31.78	34.24	39.81	40.82	54.26	52.64	51.89	51.27	48.15	44.31	41.36	39.04	37.85	37.24	42.10	64.77	67.64	57.77	43.48	38.66	39.02	44.25	48.28
Minnesota Hub	20.98	20.30	20.20	19.94	20.21	23.16	30.54	42.84	39.60	40.90	40.42	38.66	33.61	30.10	27.65	25.43	25.19	28.26	40.46	42.20	37.44	32.16	24.09	20.35	30.20	34.31
Wisconsin PS	23.00	22.02	21.79	21.51	21.85	25.52	32.07	46.72	39.54	37.05	36.47	34.91	31.54	29.38	28.10	26.70	26.78	28.71	39.89	41.43	37.53	36.04	25.98	21.20	30.65	34.17
Cleared Load (GW)	62.6	61.3	60.6	60.4	61.0	65.9	73.7	77.7	77.2	77.2	76.9	75.9	75.2	74.7	74.3	73.9	73.8	75.6	79.1	79.3	78.2	77.3	73.1	6.8		

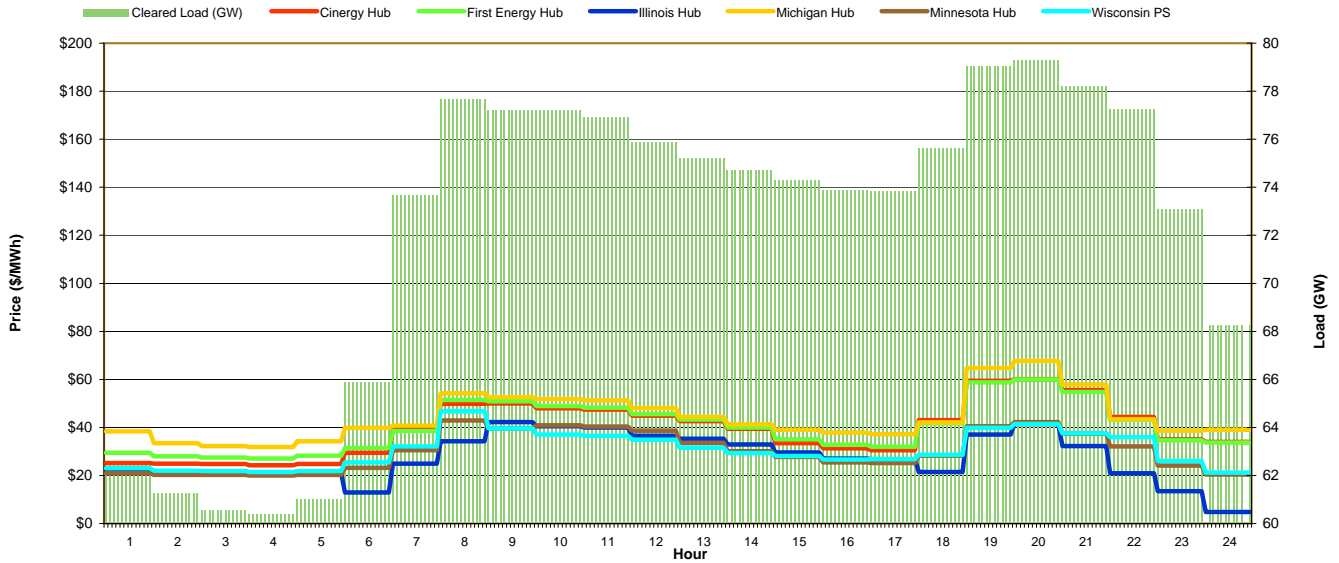

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	33.48	39.68	24.99	32.29	27.99	24.46	28.72	50.27	43.32	51.79	43.76	40.78	36.03	30.83	33.30	29.95	31.70	27.18	109.68	64.25	55.13	42.35	27.55	24.82	39.76	44.87
First Energy Hub	57.26	85.10	25.85	51.74	29.49	25.27	29.81	52.50	45.34	54.46	46.16	42.85	37.69	32.24	34.76	31.23	33.00	28.30	115.26	67.89	57.98	44.28	28.71	25.82	45.12	47.04
Illinois Hub	22.39	18.49	24.26	22.72	26.71	23.58	27.60	48.34	41.83	50.08	42.27	39.57	35.00	29.95	32.26	28.97	30.62	26.20	105.73	61.96	53.23	40.94	26.45	24.03	36.80	43.34
Michigan Hub	113.45	195.33	26.36	98.25	31.38	25.46	29.72	55.37	44.68	67.63	73.71	53.51	37.45	32.14	34.60	31.14	32.92	28.11	117.07	97.94	61.68	43.75	28.36	25.81	57.74	52.50
Minnesota Hub	30.67	26.46	26.66	24.27	26.52	23.75	26.63	49.98	46.13	50.61	42.06	38.42	33.91	28.75	30.84	27.91	29.47	25.62	104.34	62.06	74.42	40.43	24.39	23.40	38.24	44.33
Wisconsin PS	24.80	21.31	25.89	24.46	28.25	24.94	29.14	51.95	45.57	54.15	45.28	41.82	36.89	31.68	34.16	30.89	32.64	28.08	113.55	66.67	57.79	42.86	27.06	25.31	39.38	46.31
Forecasted Load (GW)	65.4	63.5	62.5	62.3	63.0	64.7	70.0	75.2	76.3	76.4	76.2	75.8	75.0	74.4	73.6	72.5	71.8	72.8	76.3	78.7	77.8	75.7	72.3	68.7		
Forecast Error %	-0.3%	0.0%	0.1%	-0.1%	0.0%	1.1%	0.8%	0.7%	1.0%	1.1%	1.1%	1.1%	1.2%	1.0%	1.3%	1.6%	2.0%	1.6%	0.7%	1.2%	1.5%	1.8%	1.7%	1.1%		

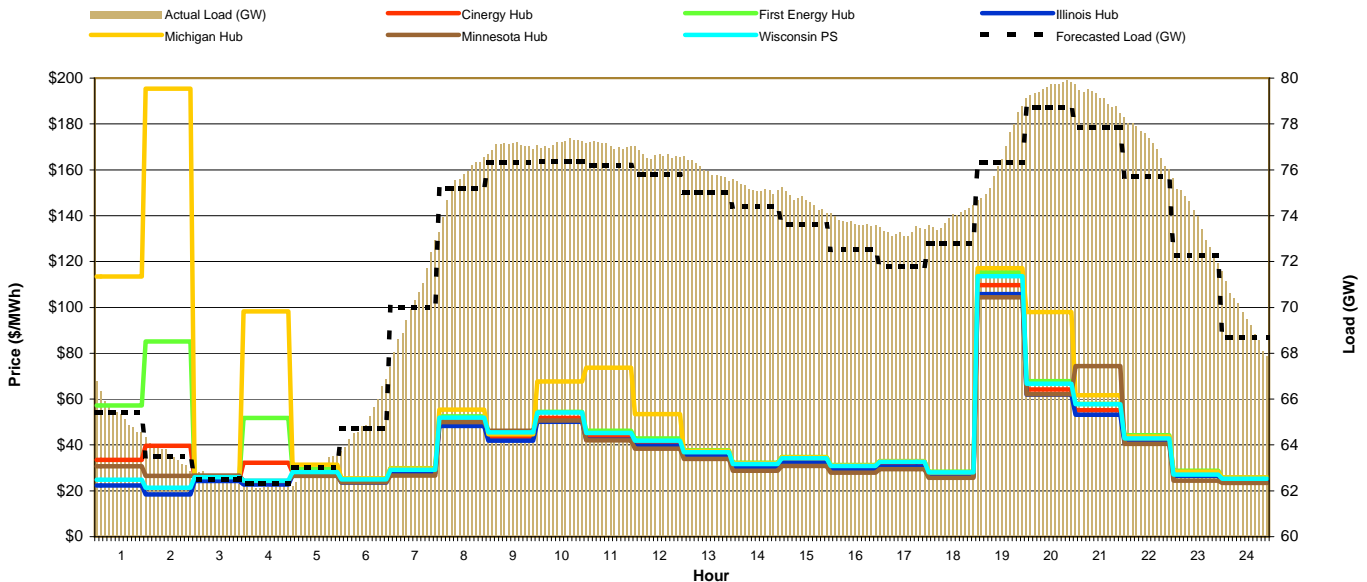




# MISO Daily Report

Wednesday February 23, 2011

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	27.15	25.95	26.00	25.61	26.03	29.09	42.87	51.04	44.99	41.60	41.13	36.96	33.33	30.01	28.49	27.38	27.15	29.14	39.67	42.48	40.26	30.89	27.01	25.57	33.33	35.72
First Energy Hub	31.88	30.24	30.26	29.97	30.35	31.35	44.14	52.78	46.77	43.15	42.67	38.37	35.25	32.41	30.63	29.20	28.93	31.46	41.17	44.12	42.06	33.04	29.53	28.74	35.77	37.60
Illinois Hub	21.76	20.87	20.61	20.89	21.39	25.61	39.61	48.77	41.55	39.74	39.01	34.99	29.32	27.14	25.78	25.03	25.42	26.66	37.88	40.53	38.70	28.58	25.12	22.57	30.31	33.39
Michigan Hub	41.81	39.38	39.38	39.32	39.41	34.70	45.34	58.67	52.89	51.72	48.46	42.87	39.45	38.44	34.35	31.38	31.11	37.56	48.41	53.78	45.01	38.34	36.51	35.47	41.82	43.06
Minnesota Hub	18.88	17.43	16.85	15.95	16.58	18.88	24.52	38.08	41.62	39.75	38.67	37.82	31.44	28.74	26.88	25.62	26.51	27.80	39.50	43.46	40.12	29.98	25.49	21.27	28.83	33.84
Wisconsin PS	22.21	21.07	20.55	19.70	19.85	22.12	27.32	37.66	44.10	40.07	38.97	38.14	31.71	29.50	27.95	27.09	27.62	28.98	39.89	44.26	42.10	31.19	26.81	23.53	30.51	34.75
Cleared Load (GW)	65.4	64.0	63.1	62.9	63.7	66.4	73.7	78.1	78.1	78.0	77.3	76.2	75.2	74.1	73.1	71.8	71.4	73.0	76.9	77.5	76.2	74.9	70.1	67		

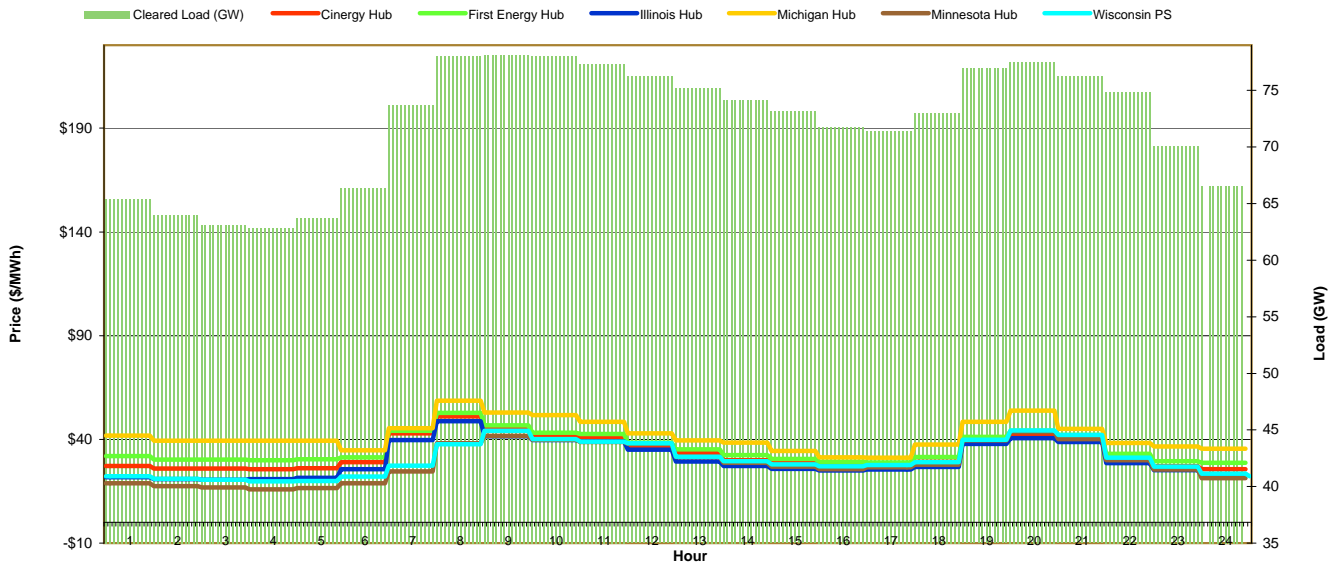

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	31.73	33.49	34.50	28.96	27.34	39.22	111.48	145.74	30.28	48.03	51.22	28.38	37.51	40.55	26.05	26.38	28.21	31.09	59.92	42.32	32.78	26.95	27.12	24.78	42.25	42.66
First Energy Hub	26.39	30.01	32.57	26.65	26.69	34.58	102.42	228.04	40.49	50.20	48.33	29.74	39.28	38.58	27.33	27.65	29.52	32.53	63.10	62.75	44.76	29.26	28.37	25.84	46.88	51.25
Illinois Hub	-7.28	10.99	14.58	7.81	16.17	13.45	39.54	126.95	29.09	43.71	16.83	27.30	36.06	16.42	25.15	25.38	27.13	29.90	57.81	40.81	31.55	25.77	25.70	23.50	29.35	36.60
Michigan Hub	26.35	29.91	31.97	26.53	26.39	34.42	100.49	98.82	26.74	48.41	47.19	29.78	39.58	38.92	27.64	27.91	29.73	32.74	62.89	34.52	28.78	27.62	28.35	25.94	38.82	39.35
Minnesota Hub	23.16	18.56	12.40	19.88	19.87	15.97	47.88	67.70	27.85	24.98	30.00	25.81	33.96	33.55	23.86	24.11	25.84	28.60	85.42	67.07	45.35	23.13	21.47	21.23	31.99	36.79
Wisconsin PS	18.34	21.38	18.71	19.17	21.31	19.66	57.50	102.50	29.85	36.92	32.26	28.26	37.25	32.74	26.19	26.57	28.29	30.99	60.92	43.13	32.96	25.81	25.40	23.28	33.31	37.50
Forecasted Load (GW)	66.5	65.5	64.5	64.3	65.0	66.0	71.1	75.9	77.1	76.4	75.7	74.7	73.7	72.8	71.8	71.0	70.4	71.2	74.3	76.6	75.7	73.7	70.2	66.3		
Forecast Error %	-0.4%	-1.7%	-1.8%	-2.1%	-2.3%	0.2%	0.7%	0.9%	0.6%	1.5%	2.1%	2.6%	2.8%	2.9%	2.9%	3.1%	3.1%	3.1%	2.4%	2.2%	1.9%	1.7%	1.7%	-7.6%		

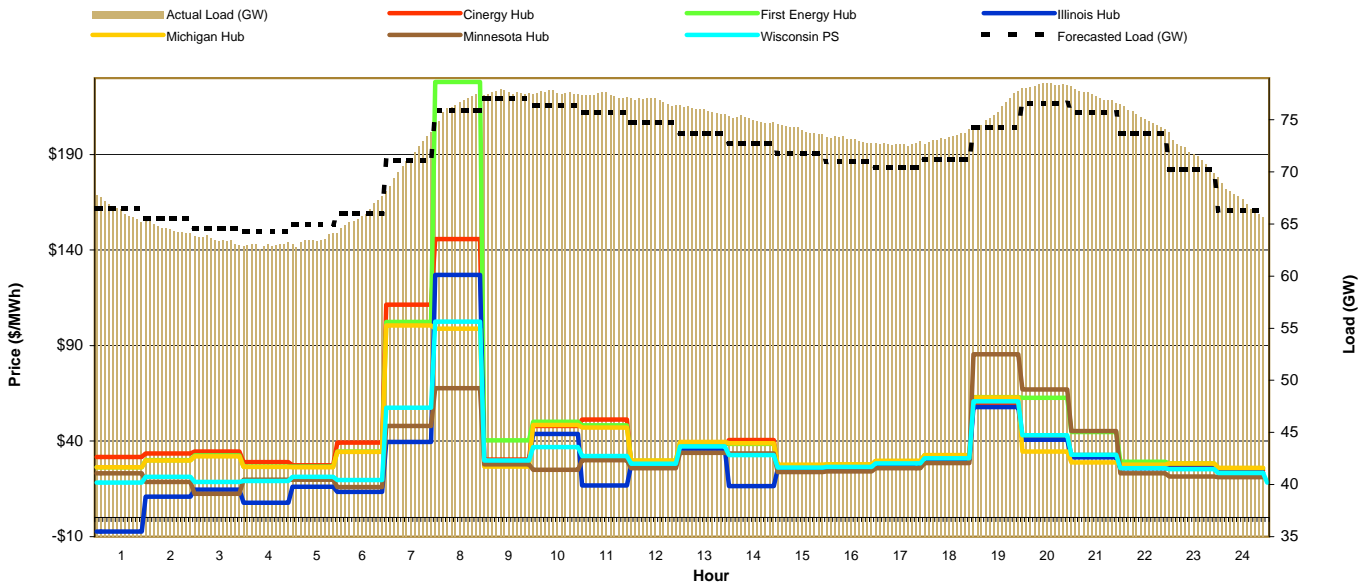




# MISO Daily Report

Thursday February 24, 2011

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$			
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk		
Cinergy Hub	25.23	24.04	24.03	23.72	23.80	25.64	36.74	46.64	43.50	43.64	41.92	38.52	34.11	31.37	29.63	28.85	28.77	30.56	45.56	47.31	41.02	32.02	28.34	26.05	33.38	36.99		
First Energy Hub	28.12	27.04	26.11	25.89	26.16	27.16	37.26	50.00	47.13	47.06	44.91	41.13	37.35	34.19	32.08	31.12	31.02	32.49	49.42	51.04	43.39	33.64	29.21	26.30	35.80	39.70		
Illinois Hub	15.78	15.50	15.50	15.71	15.92	19.03	30.25	43.15	40.26	40.49	38.60	34.11	29.84	27.55	25.80	24.52	24.29	26.79	42.13	43.94	37.23	28.56	24.98	20.34	28.34	33.27		
Michigan Hub	35.38	34.74	31.66	31.54	32.23	30.29	38.14	48.30	44.77	45.04	43.38	41.19	39.20	35.17	32.47	31.01	30.97	31.79	46.97	48.98	42.77	33.43	30.26	26.31	36.92	39.11		
Minnesota Hub	18.61	17.76	17.02	16.73	16.60	18.05	23.50	34.60	41.62	41.28	39.36	36.50	32.50	30.76	28.87	26.47	27.01	29.13	44.29	47.93	40.26	31.68	27.05	21.96	29.56	34.96		
Wisconsin PS	21.61	20.52	20.17	19.91	19.75	21.62	28.76	34.04	41.55	41.92	40.28	37.61	34.76	31.91	30.00	27.85	28.15	29.98	45.86	49.11	42.41	33.08	28.56	24.55	31.41	36.06		
Cleared Load (GW)	61.5	59.9	58.7	58.6	59.2	62.5	70.8	76.0	76.3	76.2	76.0	75.5	74.9	74.4	73.7	72.6	72.7	73.7	76.1	77.2	76.6	74.6	70.1	6.6				

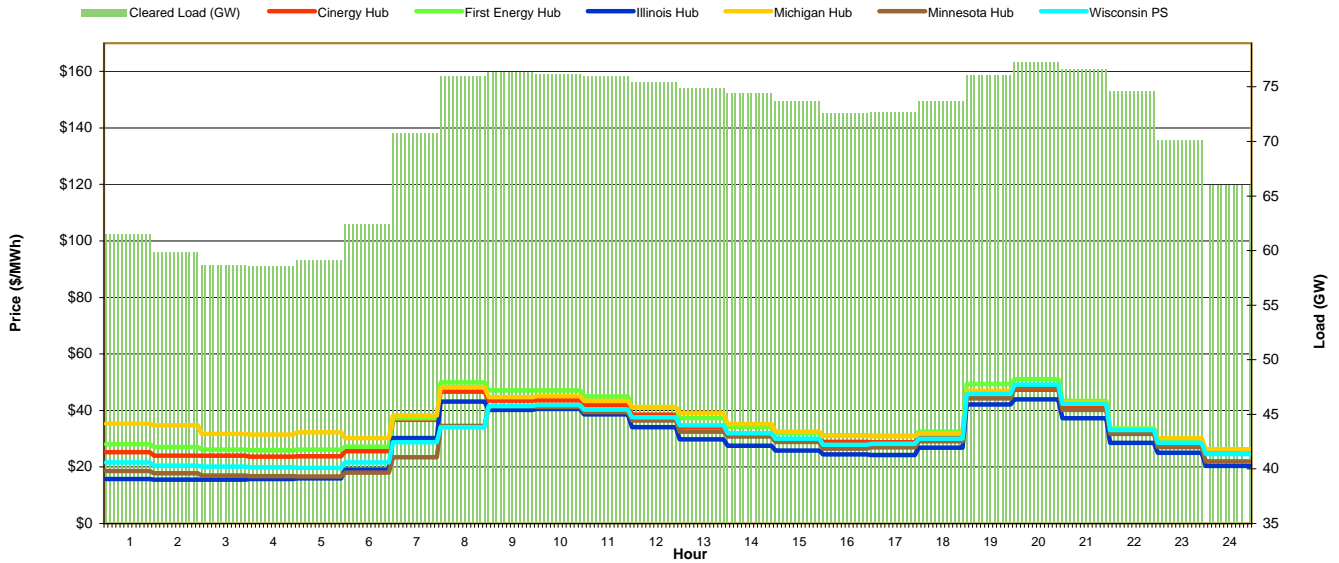

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$			
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk		
Cinergy Hub	27.87	26.88	25.13	21.96	22.95	32.24	34.41	30.56	29.61	29.28	28.76	41.28	34.99	33.34	31.20	33.18	36.40	109.03	123.08	31.24	86.20	50.31	28.41	28.18	40.69	47.30		
First Energy Hub	54.35	56.71	45.39	22.83	23.94	57.67	55.28	32.02	31.06	30.82	30.28	43.46	36.74	35.14	32.74	34.71	37.98	146.24	165.66	33.15	140.11	49.40	29.71	28.22	52.23	56.83		
Illinois Hub	15.24	12.76	15.37	21.11	21.73	19.78	23.85	29.21	28.49	28.21	27.63	39.41	33.03	31.38	29.24	30.82	33.52	96.14	108.86	29.83	74.77	28.83	26.80	25.61	34.65	42.26		
Michigan Hub	118.72	130.05	94.59	23.16	24.28	118.95	114.40	35.40	31.33	31.08	30.45	43.80	36.97	35.53	32.83	34.55	37.52	93.10	117.48	60.81	70.43	61.02	37.28	28.43	60.09	49.35		
Minnesota Hub	24.92	12.75	15.11	18.64	17.84	21.99	24.07	27.72	29.16	31.42	28.06	36.13	27.63	25.70	23.08	21.68	21.97	29.81	36.74	29.47	18.75	18.42	22.57	20.83	24.35	26.77		
Wisconsin PS	17.90	13.17	15.67	21.09	21.04	20.81	24.24	29.46	29.31	29.68	28.80	39.63	31.53	29.62	27.36	27.57	29.06	65.20	75.17	30.83	48.83	32.68	26.29	24.98	30.83	36.31		
Forecasted Load (GW)	64.5	63.7	61.6	61.2	61.8	64.6	69.8	74.0	75.7	76.0	75.7	75.3	74.6	73.7	72.8	71.9	71.6	72.2	75.0	77.4	76.4	74.5	71.5	67.7				
Forecast Error %	-1.0%	-3.1%	-1.9%	-2.0%	-2.2%	-2.1%	-0.5%	-0.5%	-0.6%	0.0%	0.3%	0.8%	1.2%	1.8%	2.5%	2.9%	3.2%	2.7%	1.6%	1.9%	1.9%	1.7%	1.6%					

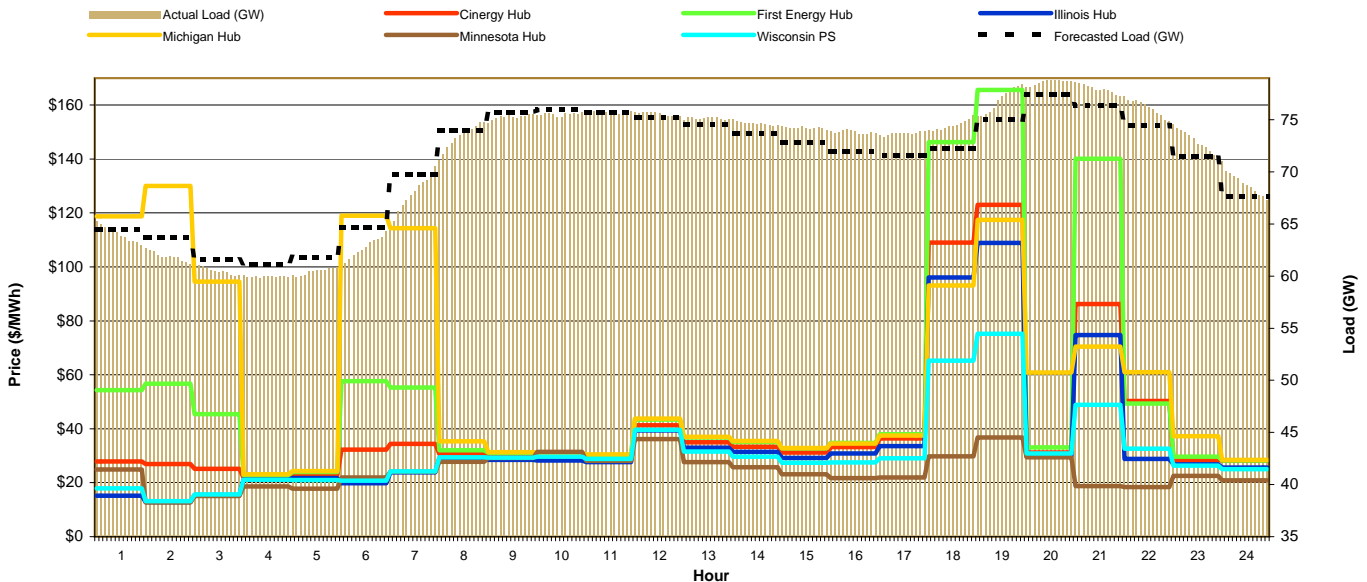






# MISO Daily Report

Friday February 25, 2011

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	26.46	25.93	25.63	25.11	25.05	27.00	37.03	42.44	39.45	44.54	43.69	40.51	38.95	36.48	32.55	30.58	31.71	32.63	49.07	50.79	44.19	39.68	32.24	29.75	35.48	39.34
First Energy Hub	27.50	26.83	26.28	25.84	25.98	28.15	38.34	44.18	41.15	46.49	45.57	42.22	40.39	37.83	33.75	31.71	32.06	32.89	48.08	50.67	45.14	41.15	33.38	30.72	36.51	40.42
Illinois Hub	19.32	19.49	19.49	19.39	19.60	21.31	26.53	40.86	37.92	42.83	41.98	38.89	37.22	34.85	31.11	29.23	29.56	30.32	44.21	46.60	41.54	37.91	30.75	28.07	32.04	37.24
Michigan Hub	29.66	28.48	27.20	26.73	27.38	30.36	39.63	45.17	42.06	47.52	46.58	43.16	41.62	39.69	34.51	32.41	32.78	33.63	51.96	54.07	46.50	42.07	35.69	30.67	37.90	41.84
Minnesota Hub	21.20	20.28	19.97	19.86	19.94	21.68	28.58	38.97	41.10	47.08	46.24	43.08	39.21	37.28	33.10	30.35	30.56	31.09	49.94	53.55	47.55	41.38	32.75	30.16	34.37	40.20
Wisconsin PS	22.04	21.19	20.91	20.82	20.95	22.57	28.30	36.00	41.28	46.79	45.87	42.52	40.51	37.99	33.88	31.27	30.68	30.74	48.50	51.18	45.58	41.40	32.78	30.07	34.32	39.81
Cleared Load (GW)	63.5	61.9	60.9	60.4	60.9	64.8	71.9	77.4	77.8	78.1	77.6	76.8	75.8	74.4	74.0	72.9	72.8	72.7	76.9	76.9	76.0	73.2	70.0	6.6		

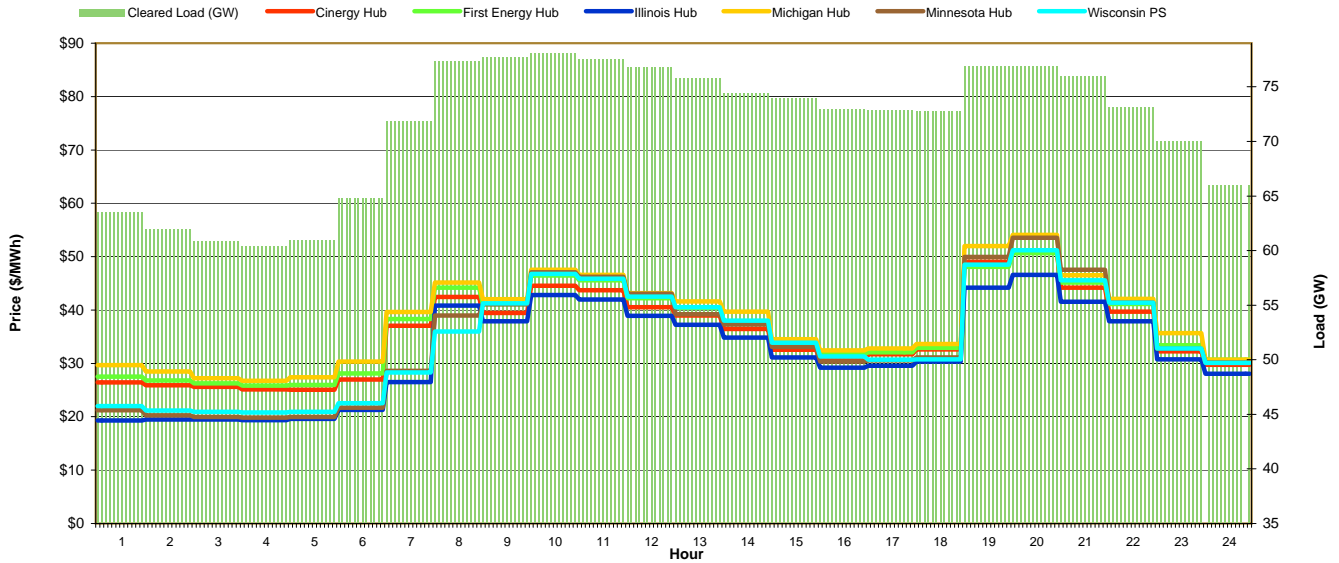

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	25.98	24.29	24.12	25.18	25.98	34.44	29.64	34.06	29.80	36.95	54.42	43.53	39.02	35.47	38.52	33.88	32.17	33.85	77.88	50.00	36.91	47.33	33.25	30.81	36.56	41.07
First Energy Hub	24.43	25.21	24.95	26.06	26.88	28.49	29.96	35.04	30.96	38.44	56.79	45.66	40.84	37.02	40.11	35.31	33.49	35.09	80.85	51.99	38.37	49.10	34.46	31.91	37.56	42.72
Illinois Hub	22.42	23.06	22.95	23.87	24.48	25.88	27.02	31.41	28.55	34.99	52.48	41.95	37.60	34.15	37.10	32.60	30.94	32.64	75.25	48.52	35.79	45.76	32.10	29.71	34.63	39.49
Michigan Hub	24.61	25.30	24.97	26.06	26.89	28.54	29.88	34.67	30.91	40.25	56.68	45.70	48.02	38.54	44.44	46.43	39.20	35.65	81.05	51.97	38.42	49.35	34.63	32.45	38.95	44.76
Minnesota Hub	18.97	20.36	19.48	19.88	20.49	20.68	20.94	22.72	29.15	31.62	54.37	65.98	42.95	33.54	36.78	32.47	30.83	32.76	76.42	50.17	37.04	45.73	31.89	29.55	34.37	40.90
Wisconsin PS	22.12	23.04	22.49	23.15	23.69	24.58	25.10	28.46	30.03	35.04	55.68	46.24	39.91	35.46	38.58	33.75	32.03	34.04	78.97	50.89	37.38	47.15	32.79	30.84	35.47	41.02
Forecasted Load (GW)	65.5	63.7	62.6	63.2	63.9	65.2	69.7	75.2	77.2	77.5	77.6	77.2	76.5	75.6	74.7	73.6	73.0	73.5	75.6	77.4	76.2	74.3	71.6	68.1		
Forecast Error %	0.1%	0.2%	0.1%	-1.2%	-1.2%	0.6%	1.0%	0.3%	-0.2%	0.1%	-0.4%	-0.5%	-0.6%	-0.7%	-0.7%	-0.3%	-0.2%	-0.6%	-0.7%	-0.5%	-0.6%	-0.1%	-0.3%	-0.3%		

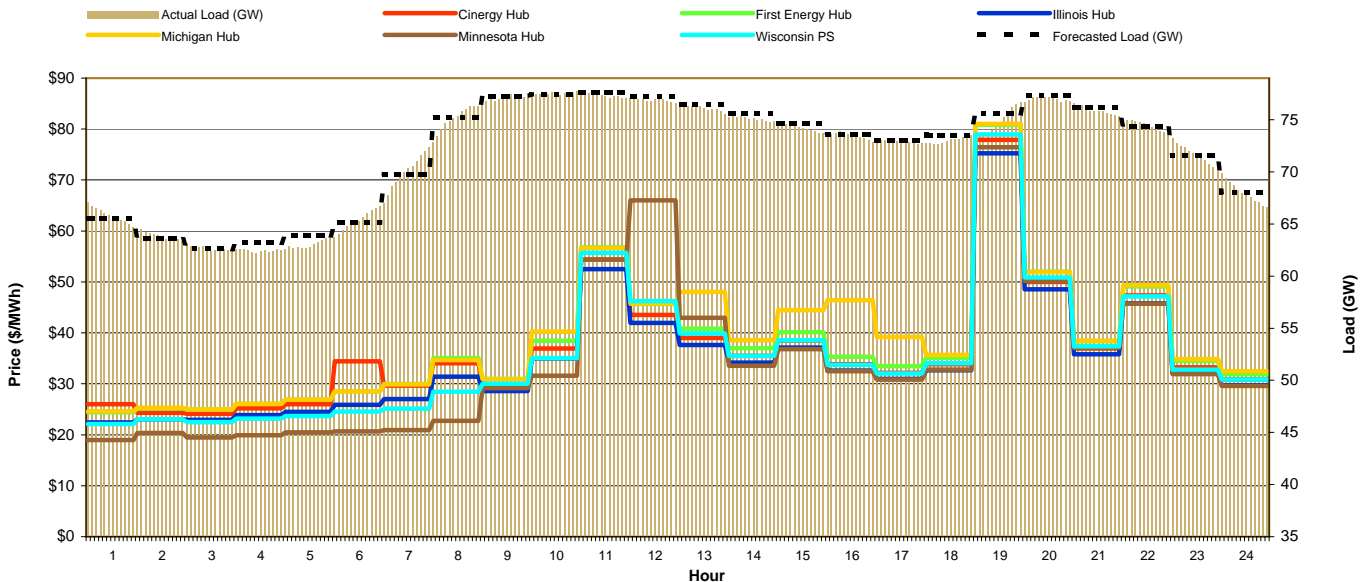




# MISO Daily Report

Saturday February 26, 2011

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	32.36	33.91	36.87	32.85	30.82	32.05	35.65	40.59	40.97	46.80	47.87	41.00	37.56	34.53	31.57	30.15	30.73	34.00	48.70	47.95	42.61	35.65	31.73	29.79	36.95	38.90
First Energy Hub	33.41	35.16	38.47	34.04	31.86	33.25	37.12	42.28	42.70	48.82	49.94	42.78	39.17	36.01	32.94	31.43	32.02	35.43	50.85	50.14	44.48	37.20	32.83	30.83	38.47	40.56
Illinois Hub	29.12	30.82	31.10	29.80	28.74	29.20	34.03	38.83	39.35	45.17	46.21	39.54	36.13	33.23	30.38	28.89	29.37	32.53	46.90	46.27	41.05	34.15	30.76	28.83	35.02	37.42
Michigan Hub	33.74	35.49	38.93	34.34	32.13	33.71	36.82	41.95	42.43	48.57	50.13	42.55	38.92	35.81	32.81	31.20	32.01	36.51	55.01	51.31	44.21	36.92	34.34	31.22	38.79	40.92
Minnesota Hub	25.61	24.43	22.87	22.19	21.91	23.12	27.37	32.50	34.59	42.41	43.78	37.28	31.95	28.83	26.92	24.48	24.46	26.70	42.73	47.20	38.55	31.67	29.48	27.91	30.79	33.97
Wisconsin PS	29.00	27.81	26.13	25.77	25.40	25.67	28.15	32.16	31.66	36.76	37.32	33.55	31.10	29.35	27.81	26.61	26.67	28.25	41.92	48.07	38.56	34.01	29.17	29.56	31.27	33.31
Cleared Load (GW)	63.2	62.1	61.1	60.9	61.1	62.8	65.6	67.9	69.3	71.8	72.0	71.7	69.8	68.0	67.0	66.0	66.4	67.9	72.0	72.1	71.6	69.9	66.8	63		

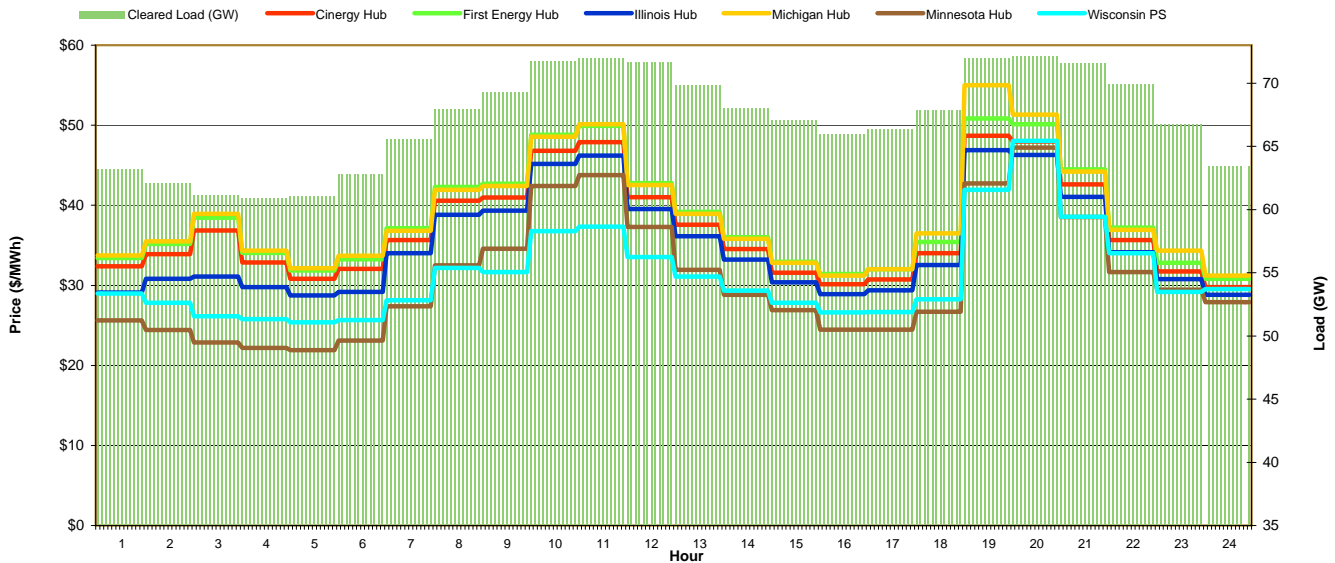

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	29.14	37.29	31.28	30.84	38.39	29.42	27.36	27.93	30.29	31.36	31.84	32.49	39.32	31.53	30.08	29.40	29.41	31.43	28.67	31.05	32.48	30.89	28.49	27.20	31.15	31.04
First Energy Hub	30.14	38.49	32.29	31.80	39.32	30.30	28.19	28.72	31.22	32.41	32.83	33.42	40.37	32.31	30.77	30.08	30.12	32.19	29.41	31.92	33.38	31.72	29.19	27.82	32.02	31.88
Illinois Hub	27.94	35.28	27.77	27.39	33.85	27.01	26.01	26.58	28.75	29.85	30.43	31.13	37.68	30.22	28.80	28.16	28.15	30.14	27.63	29.91	31.17	29.66	27.42	26.20	29.46	29.73
Michigan Hub	30.69	39.35	33.08	32.48	39.29	30.71	28.37	28.72	31.06	32.04	32.54	33.27	40.58	32.74	31.34	30.67	30.73	32.78	29.69	31.99	33.58	32.05	29.69	28.52	32.33	32.09
Minnesota Hub	27.25	33.63	25.84	24.91	17.07	22.86	26.60	26.17	32.23	40.13	34.22	32.66	40.57	29.37	27.99	27.04	26.55	28.30	26.65	33.77	32.59	29.10	27.30	26.49	29.14	30.92
Wisconsin PS	28.99	36.11	27.63	27.08	27.07	26.10	26.96	27.32	30.06	32.25	32.69	33.09	39.95	31.60	30.20	29.54	29.40	31.56	29.55	32.69	33.57	31.00	28.43	27.36	30.42	31.43
Forecasted Load (GW)	65.3	64.1	62.4	62.4	62.4	64.2	65.4	67.6	69.5	70.1	70.6	70.1	69.1	67.4	66.0	65.2	65.0	66.1	69.1	70.9	70.1	68.4	66.3	62.9		
Forecast Error %	-0.8%	-2.1%	-1.5%	-2.4%	-2.7%	-4.2%	-2.4%	-2.5%	-2.5%	-0.4%	0.4%	0.8%	1.0%	2.0%	2.7%	3.0%	3.4%	3.1%	1.8%	1.8%	1.7%	1.6%	0.9%	1.6%		

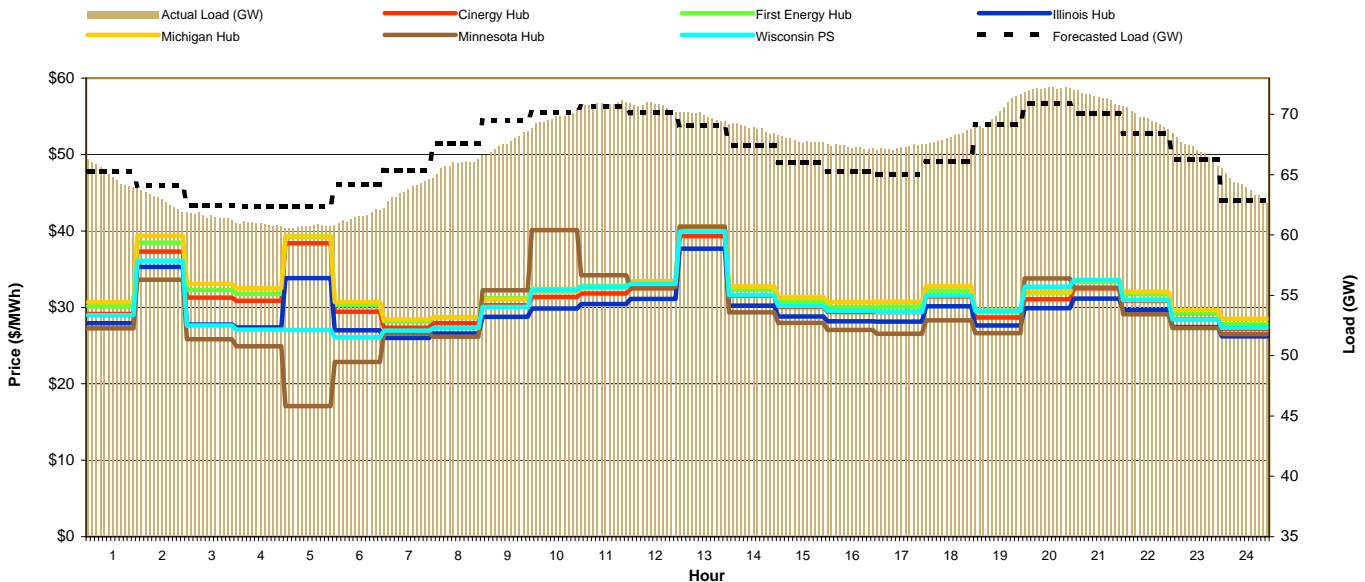




# MISO Daily Report

Sunday February 27, 2011

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	Day																								Avg. Hr \$			
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk		
Cinergy Hub	29.72	29.84	29.11	28.17	27.70	26.93	28.71	28.73	30.58	31.74	30.58	30.00	29.20	28.00	26.79	26.48	26.75	30.09	43.31	42.00	37.24	30.80	28.22	26.87	30.32	31.28		
First Energy Hub	30.30	30.74	29.89	29.02	28.92	27.79	30.23	29.91	31.84	33.10	31.99	31.38	30.52	29.28	28.02	27.68	27.96	31.45	45.37	43.98	38.98	32.23	29.14	27.49	31.55	32.68		
Illinois Hub	25.03	26.42	25.36	25.06	24.58	23.90	26.89	27.25	29.00	30.31	29.59	29.05	28.26	27.16	25.98	25.59	25.87	29.08	41.96	40.70	36.09	29.86	27.05	24.26	28.51	30.18		
Michigan Hub	30.63	31.01	30.16	29.42	30.26	28.19	30.86	29.58	31.48	32.80	31.85	31.25	30.39	29.17	27.92	27.62	27.89	31.29	49.50	44.40	38.81	32.11	29.71	27.72	31.83	32.86		
Minnesota Hub	21.23	20.81	20.47	19.54	19.10	19.11	20.70	20.83	22.35	26.34	30.68	29.95	27.29	26.55	26.55	23.60	24.08	27.09	46.27	46.46	40.29	31.41	22.36	20.56	26.40	29.51		
Wisconsin PS	25.37	25.53	25.06	23.93	23.33	22.70	25.00	25.96	27.64	29.92	31.15	30.64	29.54	28.60	27.49	26.23	26.66	30.24	44.86	43.56	38.57	31.73	26.53	24.64	28.95	31.21		
Cleared Load (GW)	59.0	57.8	56.6	56.1	56.5	57.4	60.6	61.0	62.6	64.4	64.7	64.2	63.3	62.5	61.7	61.0	61.4	63.3	68.6	69.3	67.4	65.5	62.5	6.0				

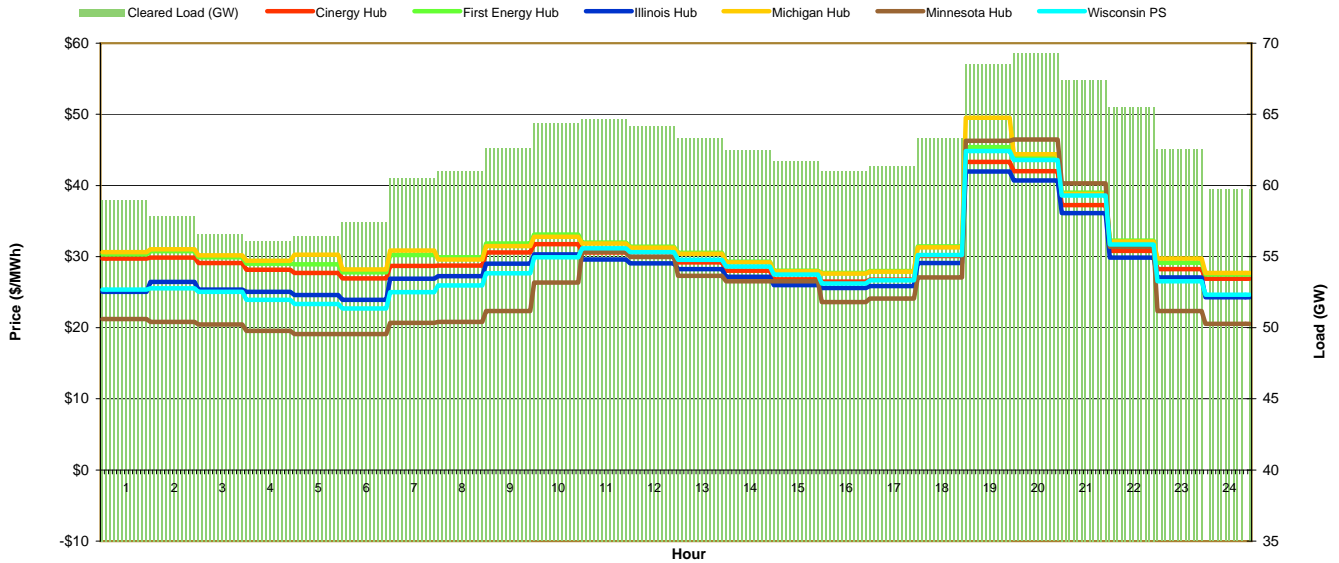

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	Day																								Avg. Hr \$			
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk		
Cinergy Hub	28.59	35.95	29.44	42.09	28.41	27.43	25.55	25.74	34.86	32.17	48.11	27.74	29.56	26.65	24.36	24.69	25.93	22.17	27.45	31.01	28.68	26.11	20.93	23.16	29.03	28.51		
First Energy Hub	29.15	36.43	29.84	42.61	28.88	27.95	26.03	26.24	35.69	33.01	49.39	28.44	30.26	27.29	24.96	25.25	26.53	22.60	28.11	31.89	29.48	26.82	21.43	23.27	29.65	29.21		
Illinois Hub	27.50	32.57	27.67	39.17	26.77	25.97	24.45	24.98	33.54	31.03	46.66	26.96	28.64	25.85	23.70	24.00	25.12	21.54	26.65	30.07	27.67	25.19	20.20	20.55	27.77	27.61		
Michigan Hub	29.92	36.47	30.22	43.06	29.38	28.30	26.35	26.65	36.16	33.56	50.28	28.98	30.84	27.82	25.40	25.71	27.10	23.12	28.32	32.15	29.90	27.51	21.97	22.78	30.08	29.72		
Minnesota Hub	28.31	18.28	22.92	28.69	22.00	21.83	22.11	25.58	33.48	31.69	48.26	29.06	29.59	27.59	24.18	23.94	25.28	21.67	28.78	47.05	31.43	26.03	20.40	-0.09	26.59	29.63		
Wisconsin PS	29.00	27.05	26.70	36.09	25.95	25.46	24.60	26.49	35.10	32.71	49.65	28.79	30.59	27.71	25.36	25.69	26.93	23.10	29.17	33.92	30.67	27.37	21.76	11.02	28.37	29.69		
Forecasted Load (GW)	60.8	59.2	59.9	59.3	59.2	59.7	61.1	62.6	62.5	63.7	64.1	63.9	63.4	62.9	62.4	62.1	62.3	63.6	66.6	68.5	67.6	66.0	63.6	62.0				
Forecast Error %	0.4%	-0.3%	-3.7%	-3.8%	-4.0%	-4.0%	-3.8%	-4.0%	-1.2%	-0.1%	-0.1%	0.0%	0.0%	0.2%	-0.4%	-0.7%	-0.5%	-0.1%	0.1%	1.1%	1.3%	0.8%	0.2%	-2.2%				

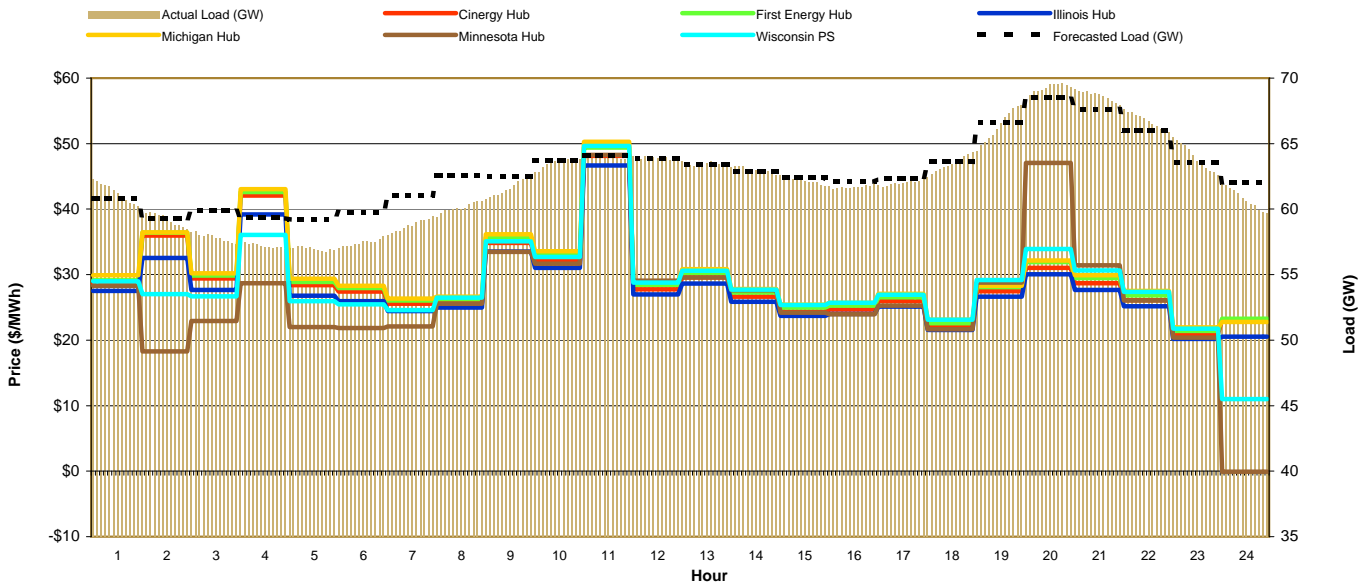




# MISO Daily Report

Monday February 28, 2011

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%

## Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	23.98	23.31	22.86	22.84	24.82	24.82	31.00	40.23	39.61	39.51	39.22	39.37	38.54	35.64	32.08	30.85	31.17	34.90	47.88	48.19	42.14	40.60	32.15	29.01	33.86	38.26
First Energy Hub	25.39	24.90	24.23	24.19	24.44	26.05	32.75	42.40	41.72	41.66	41.60	41.75	40.86	37.61	33.79	32.43	32.72	36.56	49.95	47.67	43.90	42.20	33.12	28.88	35.45	40.00
Illinois Hub	21.68	21.69	21.08	21.50	21.17	23.39	26.72	39.38	38.68	38.60	38.56	38.72	37.92	34.91	31.36	29.78	29.85	33.28	45.47	43.62	40.02	38.25	30.48	27.30	32.23	36.81
Michigan Hub	26.66	26.40	25.44	25.22	26.02	27.10	32.91	42.24	41.54	41.51	41.48	41.54	40.67	37.48	33.69	32.19	32.39	36.17	49.31	47.19	43.39	41.64	34.33	30.87	35.72	39.80
Minnesota Hub	18.94	18.43	18.15	18.14	18.33	20.25	26.25	38.18	41.51	41.44	40.00	38.17	35.15	32.12	29.19	24.76	23.43	25.47	38.94	42.65	36.92	29.61	22.33	20.59	29.12	33.74
Wisconsin PS	22.33	21.87	21.43	21.50	21.57	22.76	26.70	34.03	37.58	40.96	40.37	40.31	37.13	33.71	30.99	28.58	28.18	29.22	43.79	43.60	39.11	35.74	29.18	25.82	31.52	35.78
Cleared Load (GW)	56.6	55.5	54.6	54.7	55.5	59.3	66.9	73.1	73.3	74.2	74.6	74.3	74.1	73.4	73.1	72.5	72.6	73.4	78.4	78.9	78.0	75.0	70.4	6.6		

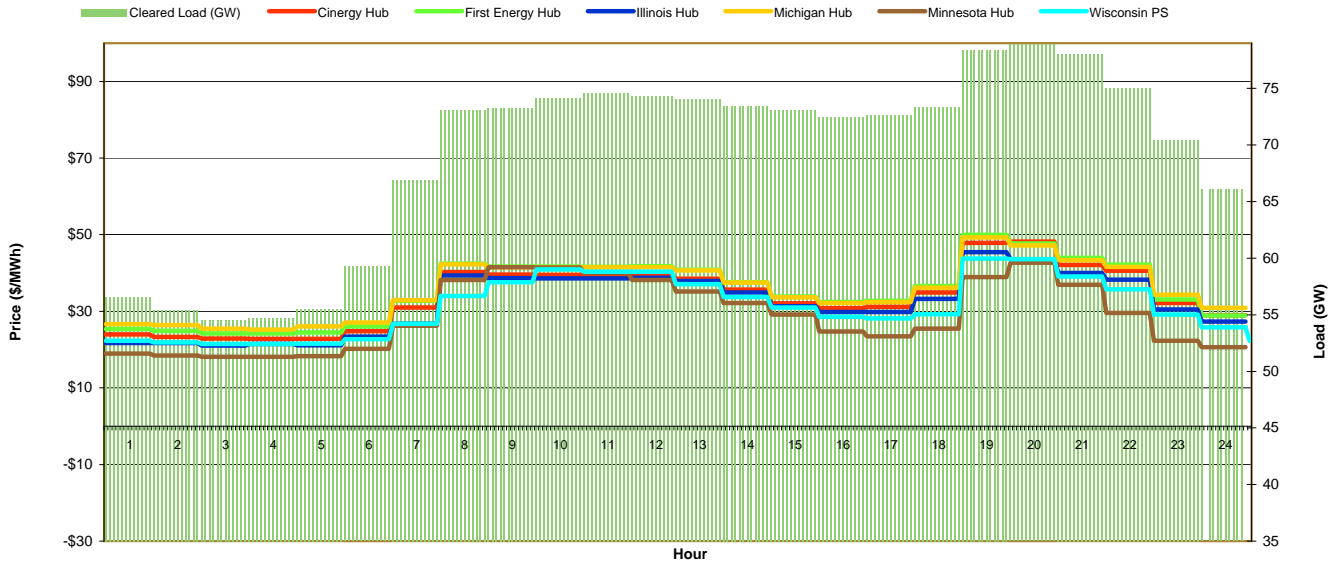

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	18.75	15.13	17.19	22.72	19.84	20.68	41.92	28.66	51.59	45.42	35.26	44.75	32.14	30.78	28.48	27.35	24.99	23.93	27.82	52.10	32.31	60.86	32.08	29.77	31.86	36.16
First Energy Hub	19.10	15.44	17.57	22.58	20.29	21.20	42.62	29.54	53.52	47.43	36.76	46.63	33.43	32.04	29.65	28.45	25.95	24.86	28.91	54.06	33.14	62.22	31.95	29.83	32.80	37.41
Illinois Hub	17.84	14.68	16.78	19.34	19.19	20.13	40.07	27.78	49.94	43.84	34.15	43.34	31.01	29.56	27.36	26.20	23.92	22.83	26.66	50.30	29.81	56.05	25.45	24.76	30.04	34.26
Michigan Hub	19.31	15.73	17.89	21.38	20.50	21.44	43.27	29.62	53.60	47.37	36.77	46.67	33.62	32.09	29.73	28.45	26.03	24.88	28.76	53.82	32.55	60.98	29.69	28.41	32.61	37.16
Minnesota Hub	13.89	14.58	17.08	-11.79	18.47	20.55	41.86	29.75	75.99	93.52	54.53	54.12	33.01	30.66	28.16	26.54	24.17	35.00	46.40	80.56	23.52	31.75	-26.81	-13.08	30.93	40.05
Wisconsin PS	17.09	15.62	18.05	3.89	20.00	21.69	43.44	30.29	56.01	51.32	38.31	47.30	33.17	31.23	28.96	27.63	25.38	25.14	29.38	55.07	25.18	46.33	0.42	7.40	29.09	34.44
Forecasted Load (GW)	59.1	57.7	57.0	57.2	57.6	59.5	64.9	70.5	72.7	73.4	73.8	73.3	72.8	72.1	71.3	71.0	71.6	74.8	78.2	77.5	75.4	72.2	68.2			
Forecast Error %	-2.1%	-2.4%	-2.4%	-2.0%	-2.0%	0.1%	0.6%	1.0%	0.7%	1.0%	1.1%	1.5%	1.4%	1.2%	1.1%	1.0%	0.5%	0.3%	-0.4%	0.0%	0.4%	0.4%	0.2%	-9.1%		

