




# ISO-NE Daily Report

Wednesday February 29, 2012

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%

## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	23.83	23.32	23.27	22.74	23.26	26.49	27.04	27.42	27.77	28.21	29.35	27.90	28.61	29.50	28.48	27.64	29.46	41.18	39.88	30.70	28.41	27.06	26.29	26.90	28.11	29.87	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	23.47	23.02	23.01	22.48	23.20	25.24	26.78	26.87	26.95	27.57	28.56	27.25	27.76	28.58	27.41	26.54	28.59	40.30	38.12	30.03	27.57	26.67	26.15	26.00	27.42	29.06		
<b>New Hampshire</b>	22.90	22.51	22.52	22.02	22.79	25.13	26.91	26.90	26.88	27.53	28.50	27.15	27.61	28.42	27.31	26.53	28.59	39.95	37.76	29.87	27.40	26.71	25.97	25.76	27.23	28.94		
<b>Maine</b>	22.57	22.15	22.07	21.73	22.67	25.36	27.52	27.20	27.17	27.87	28.46	27.00	27.32	27.99	26.86	26.28	28.44	40.07	38.09	30.20	27.37	27.35	26.37	26.04	27.26	29.00		
<b>Mass Hub</b>	23.48	23.12	23.14	22.60	23.25	25.16	26.99	27.09	27.16	27.84	28.92	27.57	28.09	29.00	27.82	26.87	29.00	40.74	38.18	30.28	27.81	26.85	26.24	25.96	27.63	29.34		
<b>Cleared Load (GW)</b>	11.3	11.1	11.0	11.0	11.1	12.2	14.1	15.1	15.5	15.5	15.6	15.6	15.6	15.8	15.6	15.4	15.9	17.0	17.0	16.5	15.7	14.3	13.0	11.9				

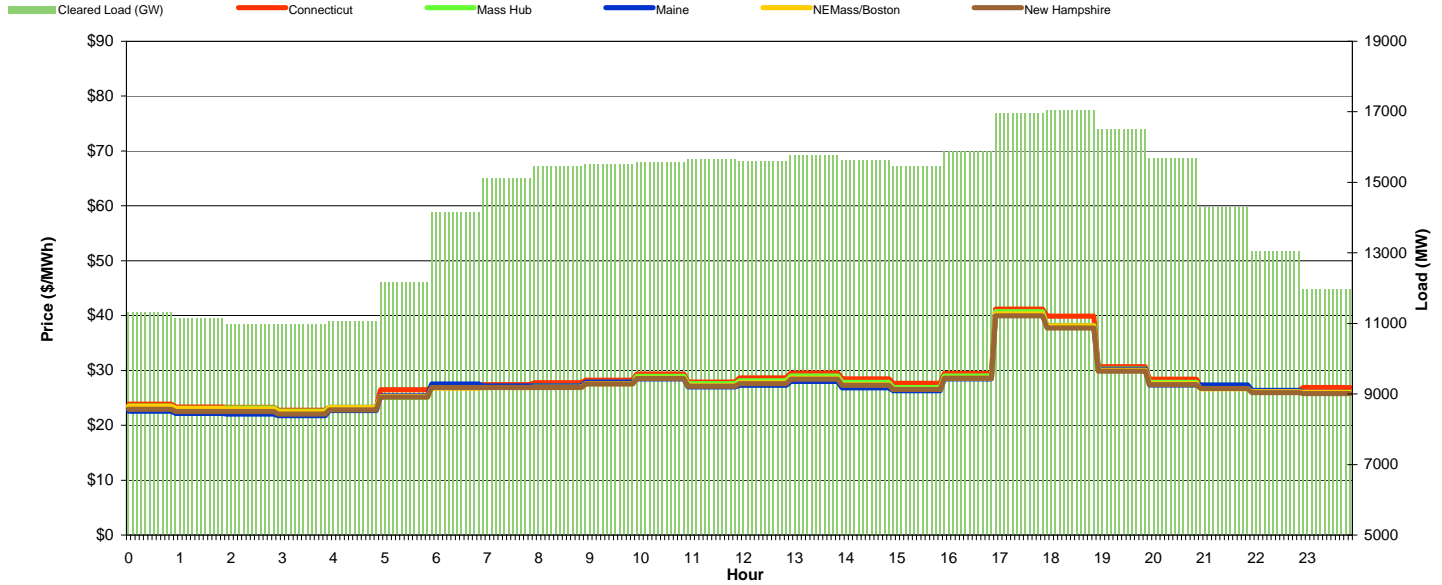

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	24.66	24.98	24.25	24.36	25.65	35.25	34.04	25.11	25.34	26.09	35.98	36.73	28.56	29.45	30.26	37.11	39.26	79.89	53.74	44.56	33.18	26.98	25.41	38.31	33.71	36.10	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	24.56	24.80	24.07	24.20	25.62	34.99	33.65	24.74	25.01	25.70	34.91	35.82	27.90	28.69	29.45	36.01	38.21	78.88	53.38	43.98	32.47	26.57	25.29	38.52	33.23	35.44		
<b>New Hampshire</b>	24.08	24.37	23.67	23.83	25.29	34.73	33.61	24.68	24.96	25.65	34.99	35.78	27.80	28.57	29.32	35.78	37.86	77.87	52.76	43.48	32.08	26.38	25.02	37.79	32.93	35.19		
<b>Maine</b>	23.73	24.04	23.36	23.70	25.40	35.18	34.16	25.12	25.44	26.00	35.03	35.75	27.60	28.23	28.98	35.22	37.51	78.35	53.11	43.47	31.58	26.29	25.17	37.81	32.93	35.18		
<b>Mass Hub</b>	24.57	24.86	24.14	24.26	25.61	35.03	33.73	24.82	25.08	25.78	35.20	36.05	28.06	28.88	29.63	36.26	38.44	78.91	53.33	44.01	32.62	26.66	25.29	38.39	33.32	35.56		
<b>DA Forecast Load (GW)</b>	12.08	11.65	11.44	11.42	11.77	12.91	14.85	15.94	16.16	16.29	16.34	16.34	16.20	16.10	16.00	16.01	16.51	17.49	17.94	17.45	16.70	15.58	14.15	12.86				
<b>Forecast Error %</b>	-1.3%	0.4%	1.3%	1.2%	-1.0%	-1.6%	-2.0%	-1.8%	-1.5%	-1.4%	-0.9%	-0.3%	0.5%	2.1%	2.7%	3.0%	2.4%	2.1%	2.2%	2.3%	2.0%	1.5%	1.5%	1.6%				

