




# ISO-NE Daily Report

## Monday August 01, 2011

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


### Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	40.49	35.44	33.82	33.56	33.91	34.91	40.26	44.45	47.29	52.01	63.02	69.17	75.00	84.80	85.72	87.35	98.54	83.90	77.50	69.76	67.92	59.45	47.68	42.57	58.69	69.60	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	39.63	34.92	33.41	32.99	33.44	34.50	39.44	43.00	45.67	50.24	60.72	66.33	72.11	81.63	82.43	83.83	94.18	80.41	74.22	66.77	64.97	56.96	45.66	41.23	56.61	66.82		
<b>New Hampshire</b>	39.67	35.00	33.41	33.02	33.53	34.61	39.56	43.18	45.87	50.27	60.55	66.44	72.11	81.50	82.12	83.32	93.54	80.24	74.29	66.86	65.08	56.86	45.43	41.23	56.57	66.73		
<b>Maine</b>	39.28	34.64	33.13	32.57	33.15	34.41	39.66	42.70	45.06	48.93	58.46	64.17	69.60	79.43	80.00	80.50	90.10	77.49	71.87	64.56	63.25	55.00	43.96	40.80	55.11	64.69		
<b>Mass Hub</b>	39.93	35.13	33.56	33.21	33.67	34.68	39.75	43.37	46.06	50.62	61.34	67.14	72.87	82.24	83.03	84.44	94.96	81.08	74.98	67.50	65.73	57.58	46.17	41.60	57.11	67.44		
<b>Cleared Load (GW)</b>	13.0	12.4	11.9	11.9	12.0	12.5	13.8	15.8	17.3	18.7	19.7	20.6	21.1	21.7	21.8	21.8	21.6	21.4	20.9	20.3	20.1	19.2	17.3	15.3				

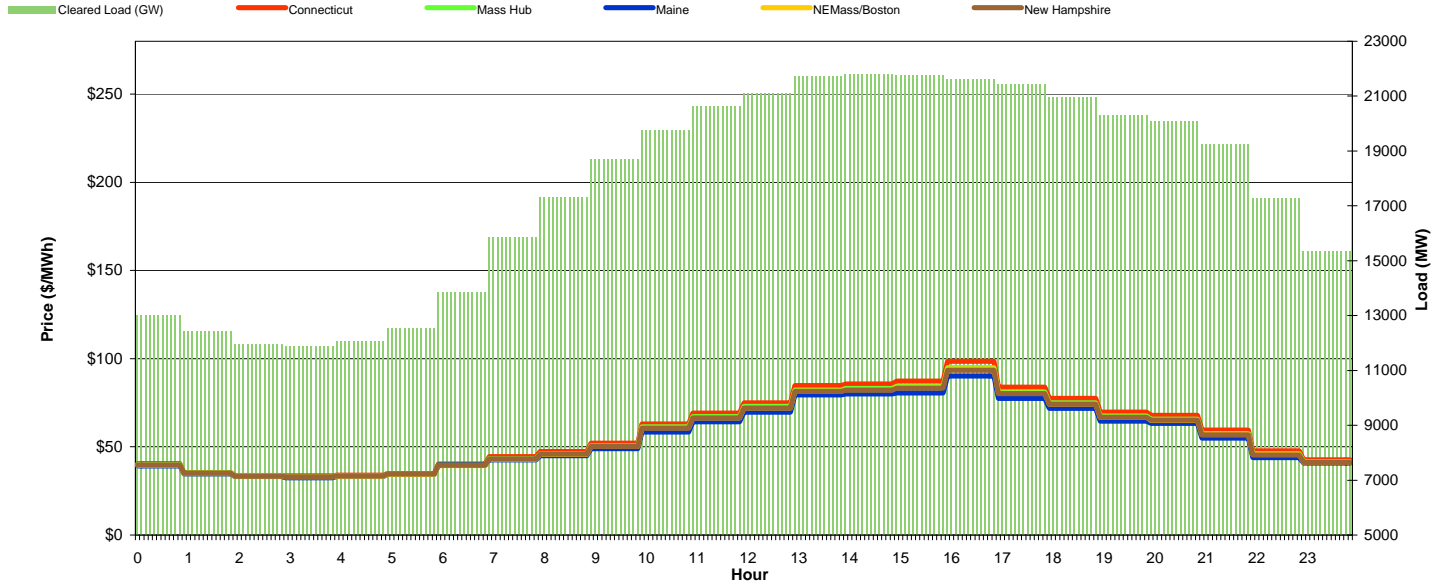

### Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	47.26	43.31	45.91	43.24	41.55	40.29	42.69	44.01	51.56	68.31	85.28	93.15	117.74	271.67	114.73	92.91	98.50	89.47	89.90	64.96	55.74	50.51	44.07	41.48	74.09	89.53	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	45.80	42.17	44.58	41.90	40.43	39.27	41.50	42.61	49.61	66.26	82.61	90.51	115.34	265.26	111.83	89.98	94.65	86.08	86.81	62.99	54.35	49.18	42.41	40.17	71.93	86.91		
<b>New Hampshire</b>	45.61	42.15	44.63	41.97	40.48	39.28	41.37	42.58	49.60	66.08	82.33	90.27	114.80	263.06	110.88	89.07	93.70	85.54	86.94	63.18	54.58	49.34	42.35	40.20	71.67	86.52		
<b>Maine</b>	44.57	41.30	43.71	41.13	39.71	38.58	40.37	42.09	48.36	64.64	79.79	87.76	111.72	255.14	107.41	85.37	89.70	82.05	84.44	61.90	53.98	48.96	41.75	40.17	69.78	84.07		
<b>Mass Hub</b>	46.34	42.65	45.21	42.53	40.98	39.78	41.96	42.98	50.10	66.73	83.23	91.01	115.52	265.27	111.93	90.36	95.22	86.60	87.38	63.44	54.67	49.47	42.78	40.48	72.36	87.29		
<b>DA Forecast Load (GW)</b>	13.87	13.12	12.65	12.44	12.59	13.28	14.72	16.66	18.13	19.51	20.66	21.51	22.12	22.64	22.91	22.98	22.96	22.60	21.69	21.17	21.02	20.16	18.34	16.49				
<b>Forecast Error %</b>	9.0%	11.5%	15.5%	15.7%	14.7%	12.4%	6.3%	2.1%	2.5%	2.7%	3.5%	4.2%	4.2%	3.4%	2.2%	1.1%	0.3%	-0.1%	1.1%	-0.1%	-0.9%	-1.0%	-1.1%	0.4%				

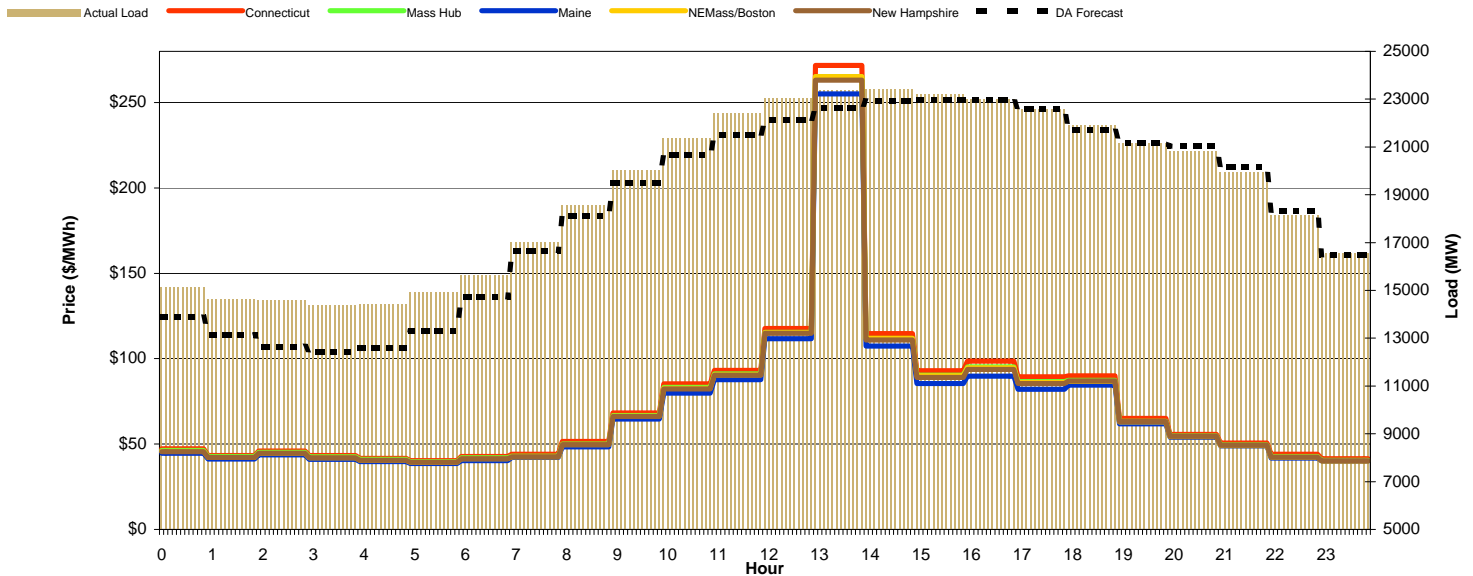




# ISO-NE Daily Report

Tuesday August 02, 2011

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	42.02	41.19	38.80	35.87	36.19	39.51	40.73	42.15	46.00	51.70	55.95	63.76	66.67	68.05	78.23	78.55	88.89	70.33	63.30	54.78	58.16	49.15	44.33	41.72	54.00	61.25	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	40.33	40.13	37.81	35.00	35.29	38.46	40.03	41.05	44.87	50.31	54.59	61.84	64.49	65.53	75.54	75.30	84.89	67.02	60.64	52.83	56.20	47.82	42.64	40.47	52.21	59.10		
<b>New Hampshire</b>	40.58	40.48	38.20	35.39	35.72	38.96	40.53	41.32	45.18	50.50	54.65	61.95	64.62	65.69	75.51	75.11	84.71	66.94	60.71	52.87	56.17	48.04	42.52	40.64	52.37	59.16		
<b>Maine</b>	40.43	40.52	37.99	35.16	35.51	38.82	41.21	41.29	45.00	48.20	51.82	57.83	60.16	61.48	69.63	68.56	76.34	61.72	59.39	51.86	54.77	47.88	41.66	40.77	50.33	56.10		
<b>Mass Hub</b>	40.93	40.58	38.35	35.48	35.79	38.99	40.41	41.37	45.14	50.59	54.84	62.22	64.97	65.95	76.08	75.91	85.63	67.57	61.17	53.20	56.58	48.06	43.04	40.89	52.66	59.52		
<b>Cleared Load (GW)</b>	15.0	14.0	14.0	13.5	13.6	14.2	15.0	16.1	17.5	18.7	19.5	20.1	20.8	21.3	21.4	21.5	21.4	21.1	20.5	20.0	19.9	19.0	16.8	15.0				

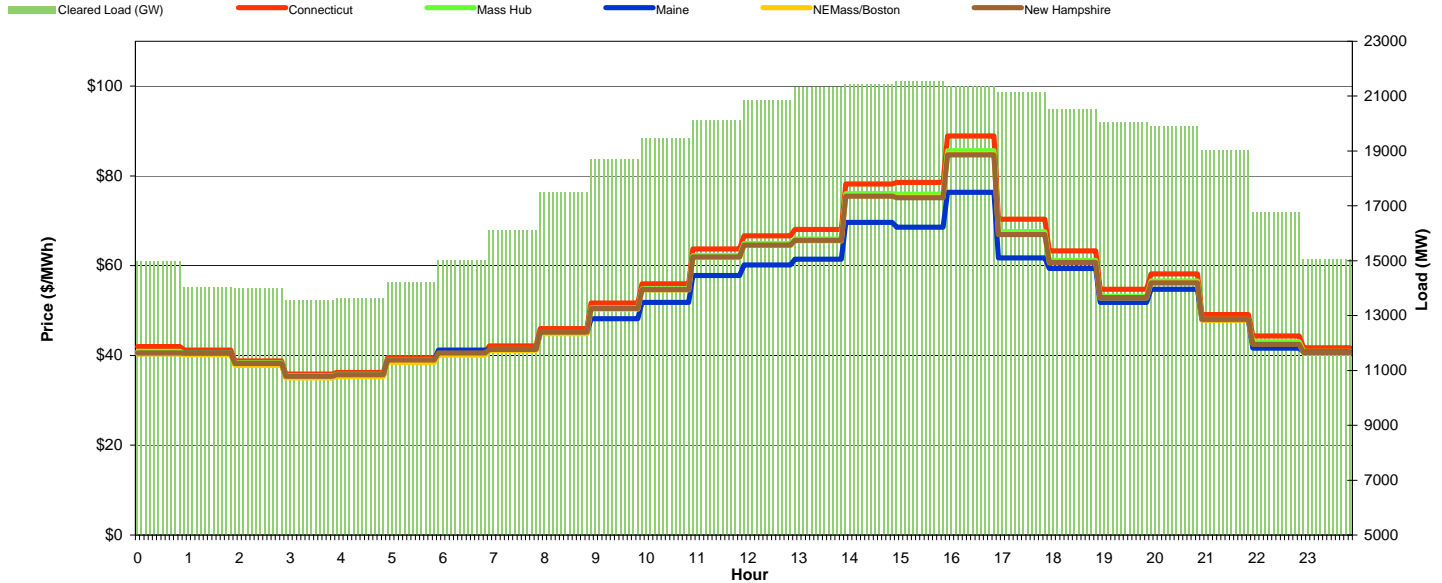

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	41.89	42.94	38.07	40.16	38.65	43.00	41.28	39.43	49.05	60.13	56.86	64.52	57.44	66.78	70.44	75.02	92.98	74.66	52.86	48.11	49.24	38.48	39.20	40.71	52.58	58.45	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	40.39	41.86	37.33	39.37	38.01	42.32	40.45	38.53	47.83	58.53	55.42	62.54	55.66	64.30	66.45	67.34	82.87	64.72	50.04	46.01	47.13	36.89	37.33	39.25	50.02	55.10		
<b>New Hampshire</b>	40.63	42.27	37.76	39.84	38.47	42.81	40.77	38.73	48.17	58.76	55.52	62.60	55.44	63.95	65.93	66.67	82.06	64.28	49.81	45.91	47.06	36.79	37.12	39.25	50.03	54.93		
<b>Maine</b>	40.88	42.67	38.09	40.29	38.96	43.41	40.83	38.88	48.58	57.85	53.00	59.06	52.04	59.23	60.52	60.54	74.03	61.97	48.24	44.70	45.85	35.72	35.88	39.12	48.35	52.26		
<b>Mass Hub</b>	40.84	42.23	37.66	39.79	38.39	42.73	40.77	38.70	48.03	58.78	55.60	62.83	55.88	64.69	66.76	67.28	82.82	64.76	50.49	46.42	47.55	37.20	37.75	39.65	50.32	55.35		
<b>DA Forecast Load (GW)</b>	15.15	14.24	13.64	13.33	13.33	13.93	15.28	17.15	18.56	19.65	20.66	21.35	21.77	22.16	22.34	22.39	22.39	22.12	21.26	20.61	20.49	19.58	17.74	15.88				
<b>Forecast Error %</b>	3.8%	4.7%	7.1%	9.3%	10.1%	9.3%	4.6%	-3.1%	-2.6%	-1.9%	-1.7%	-1.0%	-0.6%	-0.3%	-0.4%	-0.2%	-0.5%	-1.4%	-1.2%	-2.4%	-3.5%	-3.7%	-3.3%	-1.9%				

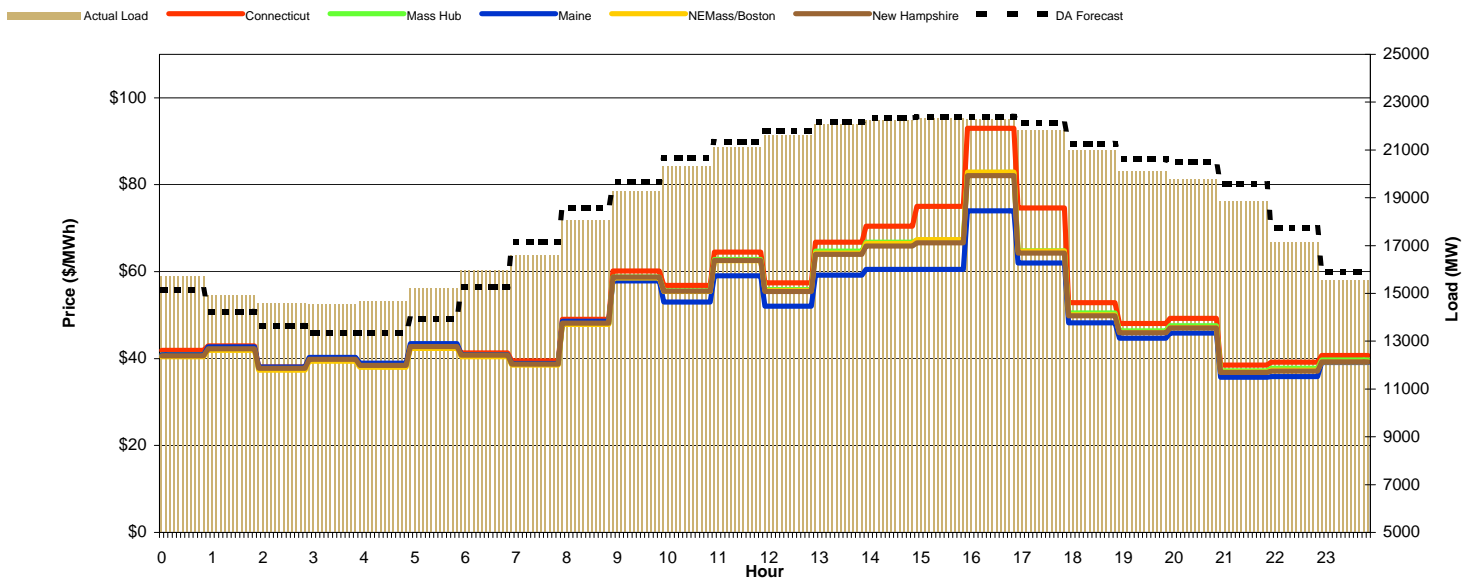




# ISO-NE Daily Report

Wednesday August 03, 2011

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	39.90	37.08	35.40	33.83	34.58	36.76	37.68	41.29	41.95	45.36	49.61	53.68	56.82	60.80	61.12	62.64	64.07	61.64	53.76	48.51	51.72	44.22	41.15	40.18	47.24	52.40	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	38.60	36.26	34.60	33.14	33.80	35.96	37.08	39.89	40.45	43.37	47.37	51.58	54.71	58.68	58.86	60.08	61.46	58.85	51.31	46.31	49.27	42.10	39.34	38.91	45.50	50.23		
<b>New Hampshire</b>	38.84	36.66	34.98	33.45	34.16	36.37	37.52	40.13	40.66	43.68	47.63	51.73	54.68	58.55	58.68	59.84	61.21	58.64	51.41	46.56	49.47	42.26	39.41	39.03	45.65	50.28		
<b>Maine</b>	38.68	36.55	34.84	33.31	33.99	36.20	39.00	39.80	40.17	43.03	46.42	50.66	53.34	57.06	57.37	58.28	59.75	56.94	50.09	45.50	48.24	41.26	38.68	40.96	45.01	49.16		
<b>Mass Hub</b>	39.20	36.75	35.13	33.56	34.28	36.44	37.34	40.30	40.81	43.80	47.86	52.05	55.15	59.06	59.20	60.47	61.85	59.36	51.76	46.72	49.85	42.53	39.81	39.30	45.94	50.66		
<b>Cleared Load (GW)</b>	14.0	13.4	13.0	12.6	12.8	13.4	13.7	15.0	16.2	17.1	17.9	18.6	18.9	19.3	19.3	19.3	19.4	18.8	18.4	18.2	18.1	17.1	15.3	13.5				

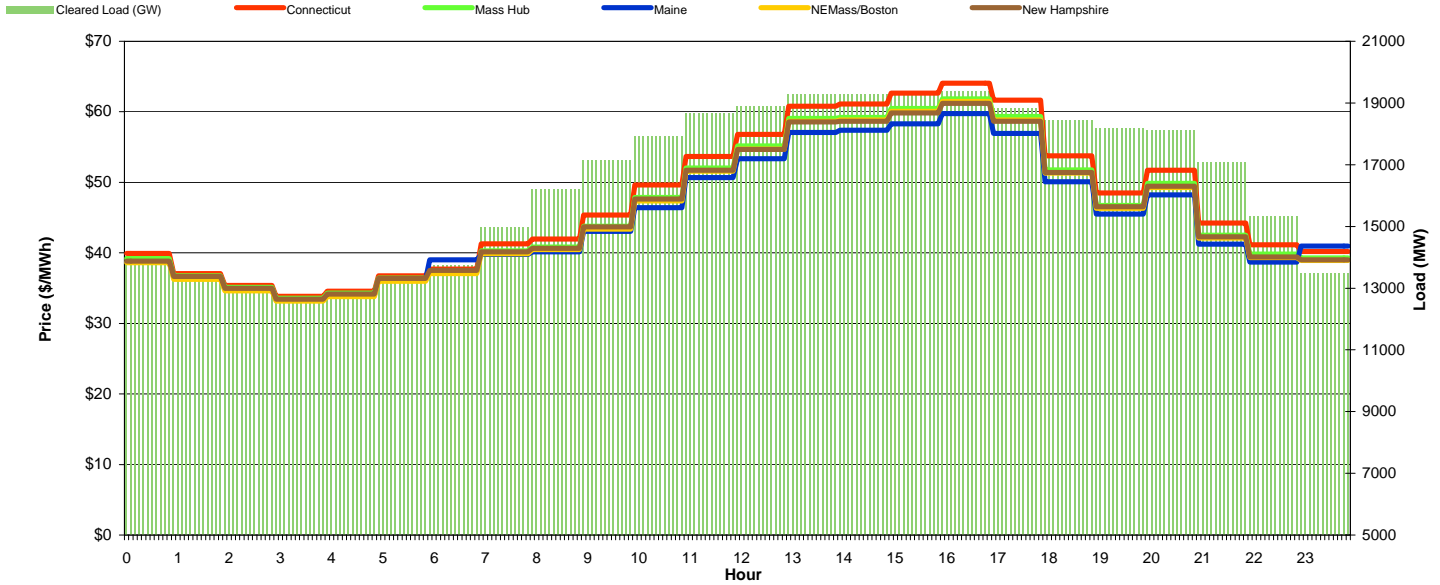

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	39.74	41.54	37.23	36.06	37.50	38.25	37.54	38.02	35.58	40.52	45.19	53.68	60.69	61.81	62.50	54.66	45.20	48.95	41.15	39.90	44.18	39.18	36.67	37.80	43.90	46.74	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	38.47	40.19	36.13	35.09	36.42	37.33	36.68	36.87	34.37	38.81	43.25	51.47	57.95	59.03	59.84	52.35	43.60	47.08	39.43	38.25	42.22	37.33	35.25	36.67	42.25	44.81		
<b>New Hampshire</b>	38.62	40.49	36.47	35.44	36.86	37.67	36.90	36.92	34.47	38.97	43.31	51.43	57.64	58.72	59.25	52.04	43.46	47.01	39.53	38.32	42.30	37.36	35.19	36.65	42.29	44.75		
<b>Maine</b>	38.59	40.27	36.22	35.27	36.70	37.52	36.64	36.33	33.99	38.26	41.86	49.67	55.42	56.65	57.17	50.37	42.35	45.63	38.45	37.07	40.96	36.00	33.93	35.99	41.30	43.38		
<b>Mass Hub</b>	38.98	40.83	36.68	35.64	37.03	37.83	37.08	37.22	34.67	39.21	43.70	51.95	58.51	59.56	60.18	52.79	43.87	47.50	39.85	38.67	42.75	37.83	35.69	37.08	42.71	45.25		
<b>DA Forecast Load (GW)</b>	14.24	13.33	12.70	12.38	12.44	13.06	14.30	16.03	17.32	18.09	18.98	19.54	19.89	20.29	20.46	20.53	20.51	20.31	19.65	19.12	19.20	18.39	16.72	14.99				
<b>Forecast Error %</b>	4.7%	8.1%	8.8%	10.7%	10.7%	7.8%	3.5%	-1.9%	-2.1%	-1.0%	-1.5%	-1.8%	-2.2%	-2.4%	-2.7%	-3.6%	-4.6%	-5.5%	-5.1%	-4.3%	-4.1%	-3.8%	-3.4%	-2.0%				

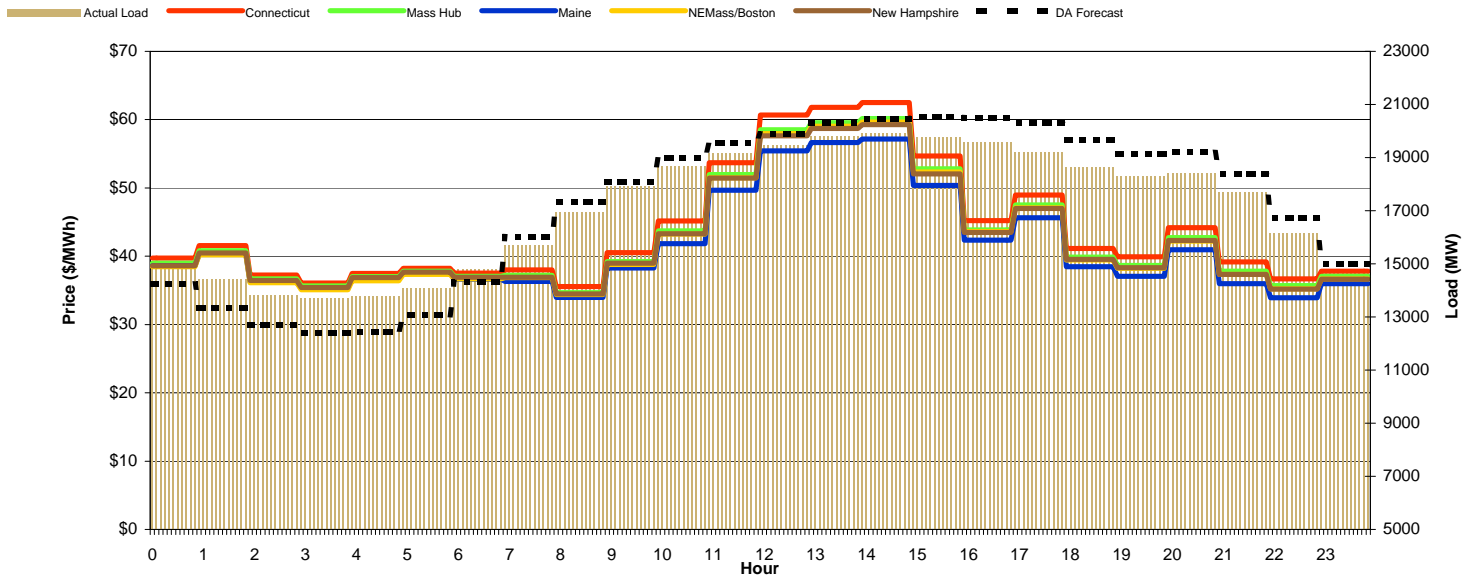




# ISO-NE Daily Report

Thursday August 04, 2011

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
																										All	On Pk	
<b>Connecticut</b>	36.21	34.08	33.37	31.38	31.85	33.42	36.99	40.72	41.87	43.55	49.56	50.06	55.46	52.91	51.11	52.50	60.83	51.65	50.07	48.00	49.17	44.82	40.80	38.61	44.12	48.94		
<b>NEMass/Boston</b>	35.59	33.60	32.81	30.91	31.39	32.90	36.55	39.84	40.57	42.04	47.60	48.34	53.57	51.31	49.71	51.03	58.61	49.98	48.01	45.96	47.17	42.90	39.36	38.03	42.82	47.25		
<b>New Hampshire</b>	35.94	33.96	33.16	31.20	31.71	33.25	37.00	40.23	40.84	42.42	48.01	48.71	53.70	51.55	49.98	51.26	58.68	50.21	48.43	46.40	47.55	43.33	39.58	38.36	43.14	47.56		
<b>Maine</b>	41.15	38.00	34.76	31.62	34.00	41.58	38.00	40.30	40.71	42.33	47.54	48.30	52.84	51.15	49.62	50.82	57.87	49.62	47.97	45.88	47.05	43.21	39.70	41.99	44.00	47.18		
<b>Mass Hub</b>	35.91	33.92	33.14	31.13	31.60	33.12	36.78	40.28	41.10	42.56	48.23	48.89	54.18	51.74	50.12	51.44	59.23	50.47	48.62	46.56	47.89	43.55	39.96	38.31	43.28	47.80		
<b>Cleared Load (GW)</b>	12.9	12.5	12.2	11.8	11.9	12.4	13.5	15.4	16.6	17.5	18.3	18.8	19.1	19.4	19.4	19.4	19.1	19.2	18.5	18.1	18.1	16.9	15.3	13.6				

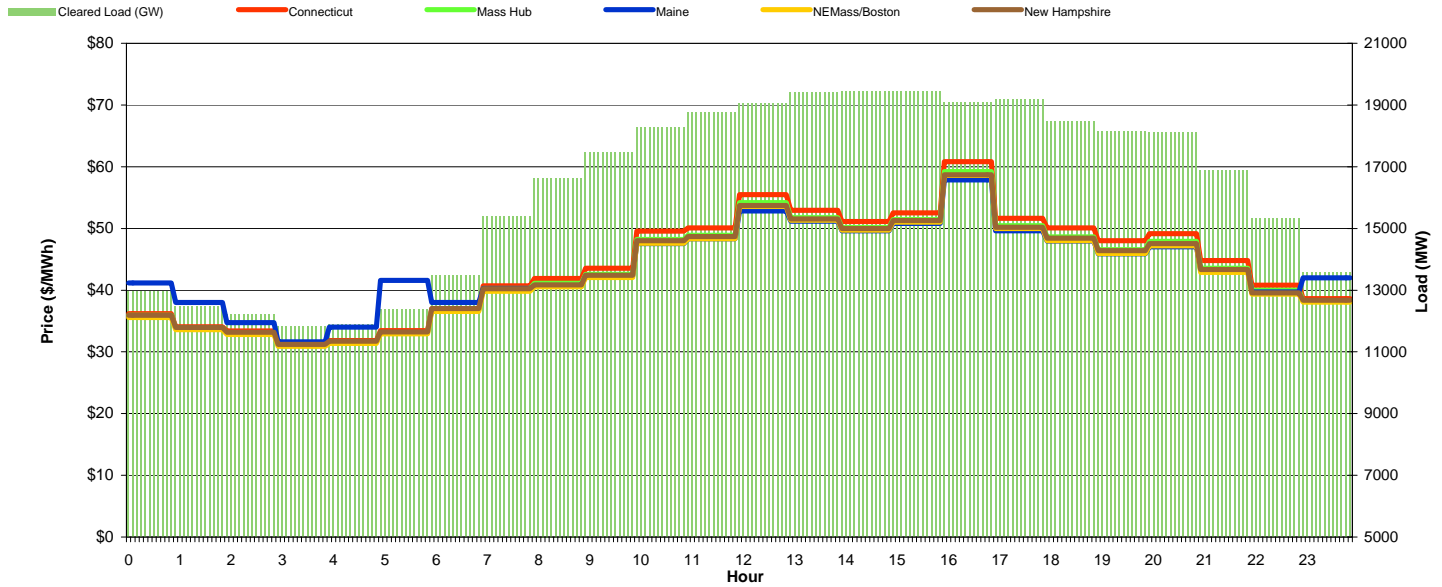

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
																										All	On Pk	
<b>Connecticut</b>	35.71	34.47	34.08	33.51	34.07	33.85	36.84	41.88	36.20	39.10	46.83	47.87	52.55	58.82	61.62	66.87	68.93	64.56	55.07	44.13	51.23	45.20	44.80	39.38	46.15	51.60		
<b>NEMass/Boston</b>	34.91	33.93	33.53	33.00	33.55	33.53	36.45	41.39	35.35	37.92	45.23	46.33	50.76	56.82	59.62	64.52	65.92	61.30	52.42	42.00	48.85	43.00	43.01	38.55	44.66	49.65		
<b>New Hampshire</b>	35.10	34.26	33.87	33.29	33.89	33.83	36.78	41.62	35.54	38.17	45.47	46.54	50.93	56.83	59.41	64.26	65.65	61.21	52.55	42.21	49.08	43.26	43.21	38.77	44.82	49.75		
<b>Maine</b>	35.21	34.53	34.18	33.59	34.23	34.16	37.22	41.83	35.65	38.19	44.89	45.86	50.06	55.87	58.25	63.09	64.20	59.83	51.28	41.22	47.97	42.59	43.09	39.13	44.42	48.99		
<b>Mass Hub</b>	35.29	34.28	33.92	33.35	33.92	33.80	36.67	41.59	35.60	38.21	45.61	46.68	51.15	57.19	59.91	64.84	66.39	61.90	53.05	42.56	49.47	43.59	43.54	38.86	45.06	50.08		
<b>DA Forecast Load (GW)</b>	13.39	12.63	12.13	11.92	12.02	12.67	13.93	15.61	16.81	17.62	18.39	18.94	19.26	19.60	19.70	19.72	19.67	19.40	18.84	18.36	18.38	17.62	16.06	14.44				
<b>Forecast Error %</b>	1.7%	5.0%	7.4%	7.7%	8.2%	7.2%	2.5%	1.5%	1.6%	2.4%	2.5%	2.3%	2.3%	2.4%	2.8%	3.1%	3.5%	3.6%	3.4%	2.5%	2.4%	3.0%	3.2%	3.4%				

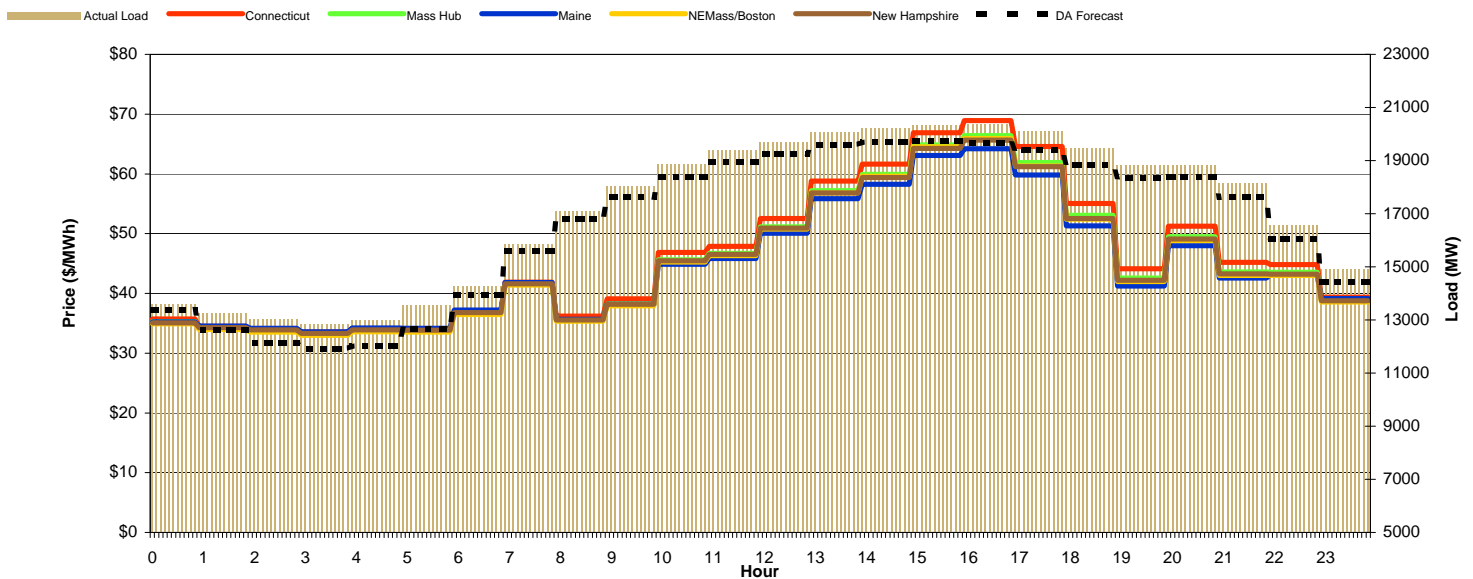




# ISO-NE Daily Report

Friday August 05, 2011

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	35.44	32.73	32.48	31.00	32.19	33.08	33.99	38.48	39.94	42.52	48.10	52.47	50.00	57.68	59.81	60.41	57.94	51.54	45.76	42.29	45.91	42.60	40.00	38.24	43.53	48.47	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	34.72	32.17	31.85	30.50	31.63	32.66	33.75	37.71	38.77	41.02	46.12	50.24	48.20	55.24	57.18	57.69	55.20	49.02	43.56	40.46	43.87	40.63	38.27	37.25	41.99	46.45		
<b>New Hampshire</b>	35.13	32.53	32.19	30.78	31.94	33.00	34.12	38.05	38.98	41.27	46.52	50.55	48.42	55.31	57.24	57.66	55.15	49.15	43.83	40.66	44.12	40.74	38.30	37.52	42.22	46.62		
<b>Maine</b>	36.47	32.76	32.41	30.99	32.12	35.09	34.56	37.95	38.84	41.00	45.93	49.61	47.63	54.47	56.28	56.47	54.02	48.13	43.06	40.06	43.44	39.95	37.56	38.00	41.95	45.90		
<b>Mass Hub</b>	35.06	32.59	32.27	30.84	32.04	33.05	33.96	38.01	39.16	41.45	46.68	50.86	48.64	55.79	57.78	58.28	55.79	49.63	44.14	40.97	44.47	41.20	38.87	37.66	42.47	46.98		
<b>Cleared Load (GW)</b>	12.5	12.2	12.2	12.0	12.2	12.4	13.3	15.1	16.1	17.0	17.9	18.3	18.7	18.8	18.8	18.8	18.6	18.2	17.9	17.6	17.7	16.7	15.6	13.8				

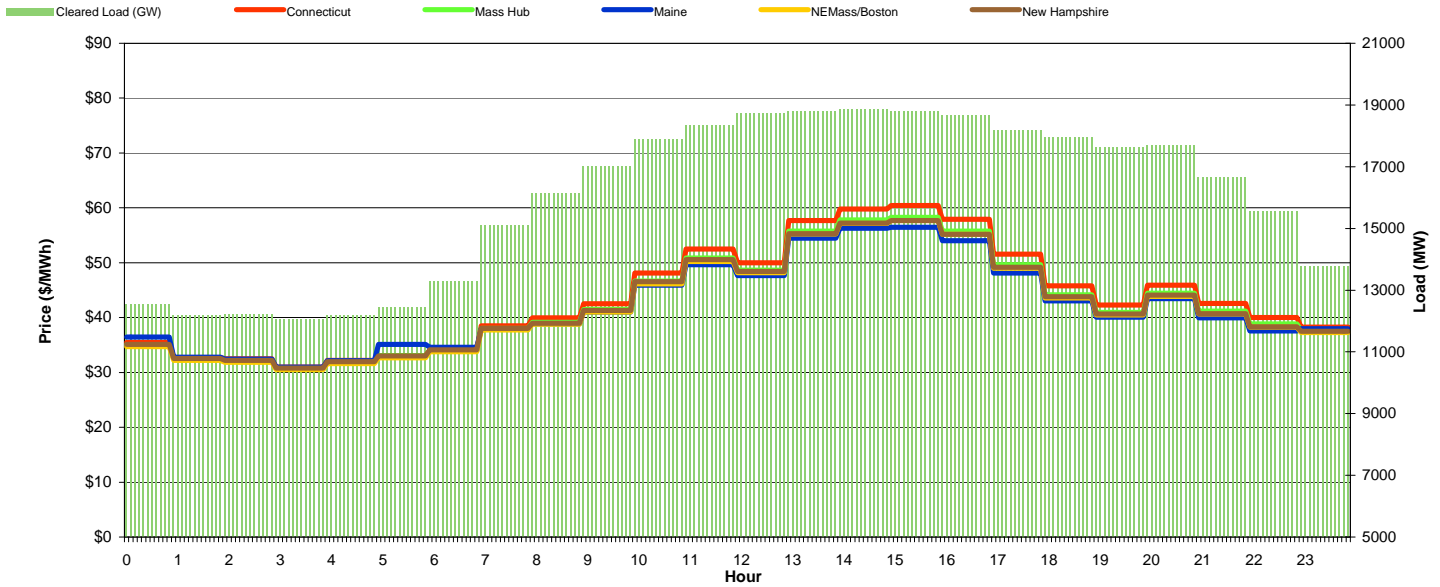

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	39.22	38.71	35.35	36.55	38.70	42.16	42.38	42.38	42.90	49.74	59.38	62.43	61.28	73.08	79.82	81.34	79.66	71.14	56.68	47.19	54.39	53.16	47.42	49.89	53.54	60.12	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	38.41	37.85	34.56	35.66	37.74	41.26	41.48	41.12	41.34	47.59	56.28	59.15	58.09	69.02	75.33	76.97	75.40	67.14	53.42	44.68	51.43	50.14	45.21	48.34	51.15	57.02		
<b>New Hampshire</b>	38.76	38.31	35.02	36.12	38.30	41.86	41.92	41.36	41.56	47.98	56.67	59.50	58.35	69.15	75.42	77.06	75.51	67.33	53.76	45.07	51.80	50.37	45.16	48.15	51.44	57.25		
<b>Maine</b>	39.41	39.00	35.60	36.70	39.14	42.93	42.54	41.17	41.11	47.46	55.69	58.45	57.31	67.79	73.64	75.52	74.08	65.86	52.50	44.19	50.74	49.24	44.10	47.68	50.91	56.18		
<b>Mass Hub</b>	38.74	38.26	35.03	36.15	38.25	41.77	41.91	41.50	41.72	48.12	56.97	59.83	58.72	69.76	76.16	77.77	76.15	67.90	54.19	45.32	52.20	50.94	45.78	48.74	51.75	57.69		
<b>DA Forecast Load (GW)</b>	13.21	12.47	12.01	11.81	11.95	12.56	13.93	15.49	16.87	17.86	18.68	19.20	19.52	19.88	19.99	19.93	19.79	19.44	18.80	18.31	18.28	17.67	16.30	14.77				
<b>Forecast Error %</b>	3.7%	7.1%	10.9%	10.9%	10.6%	10.6%	5.9%	2.0%	1.0%	0.5%	0.2%	0.1%	-0.1%	-0.2%	0.3%	0.8%	1.3%	1.8%	1.8%	0.8%	1.0%	1.2%	1.5%	1.9%				

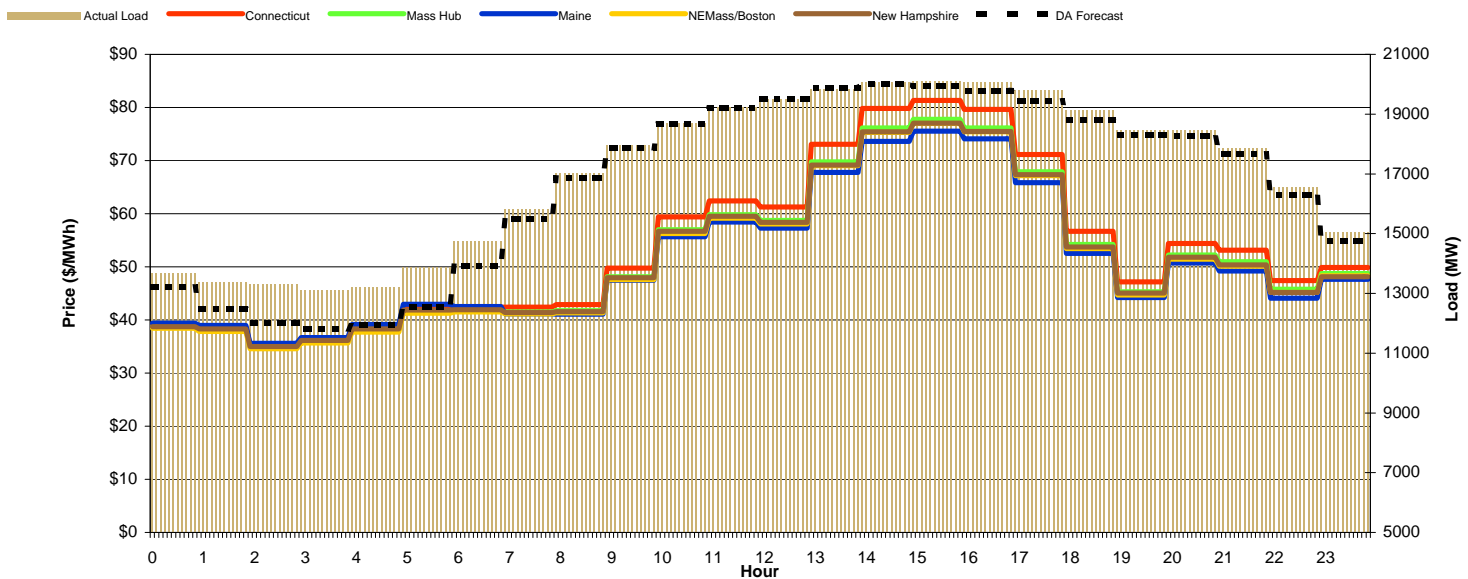




# ISO-NE Daily Report

Saturday August 06, 2011

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	39.19	37.92	34.60	33.61	33.45	33.54	33.24	34.07	37.73	42.06	48.39	51.88	55.00	53.40	53.64	51.76	56.07	53.46	52.83	49.82	56.02	46.95	40.69	40.12	44.56	48.99	All	On Pk
<b>NEMass/Boston</b>	38.36	37.38	34.22	33.17	33.05	33.16	33.00	33.48	36.71	40.60	46.74	50.25	53.18	51.71	51.77	50.15	54.31	51.47	50.70	47.71	53.89	44.97	39.32	39.31	43.28	47.31	72.60	83.78
<b>New Hampshire</b>	38.53	37.67	34.56	33.51	33.38	33.50	33.29	33.77	37.00	40.78	46.98	50.39	53.11	51.53	51.63	49.94	54.07	51.37	50.74	47.75	53.87	45.08	39.27	39.36	43.38	47.33	70.16	80.81
<b>Maine</b>	39.00	38.00	34.76	33.75	33.54	33.69	36.00	33.80	37.39	40.60	46.85	50.00	52.44	50.94	51.07	49.09	53.30	50.15	49.83	47.07	52.96	44.45	38.93	39.87	43.23	46.80	69.16	79.34
<b>Mass Hub</b>	38.75	37.72	34.52	33.53	33.46	33.55	33.29	33.73	37.04	41.01	47.17	50.60	53.60	51.97	52.12	50.43	54.59	51.89	51.16	48.12	54.37	45.40	39.65	39.48	43.63	47.68	70.62	81.33
<b>Cleared Load (GW)</b>	12.9	12.4	12.2	12.1	12.1	12.3	12.4	13.1	14.3	15.5	16.1	16.7	16.9	17.1	17.2	17.3	17.4	16.9	16.5	16.2	16.7	15.9	14.8	13.7				

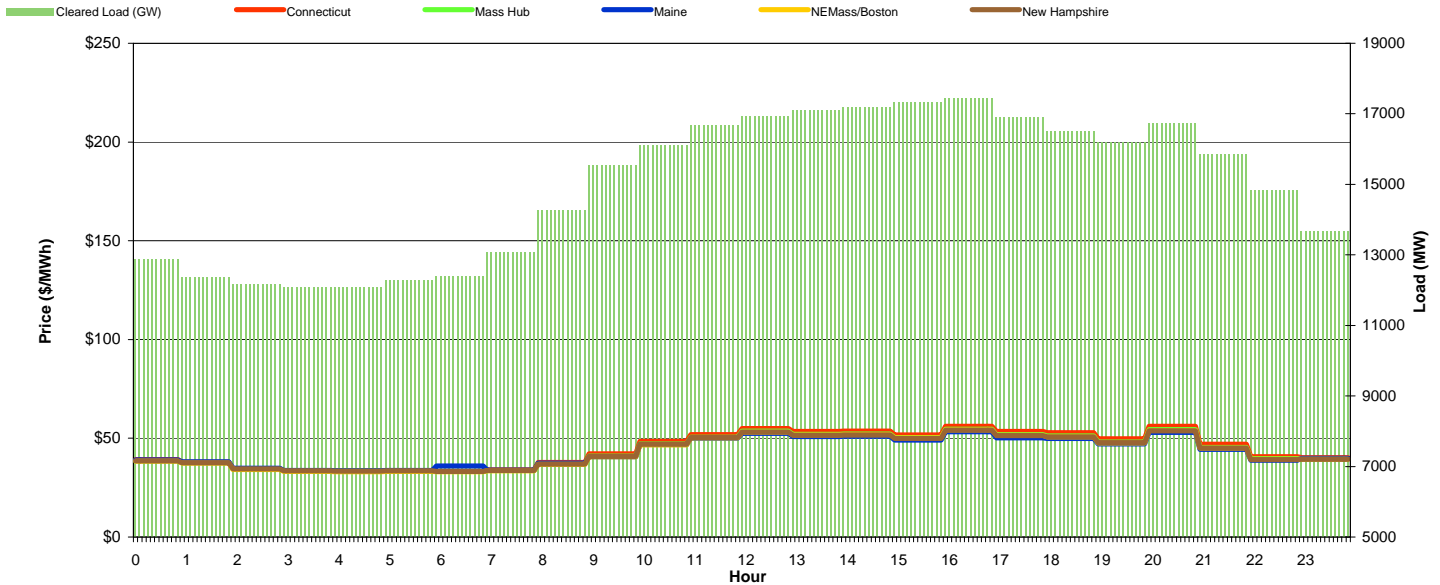

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	68.41	61.73	54.07	42.92	44.06	42.08	37.67	60.43	56.40	65.39	81.48	199.26	240.28	119.73	60.94	48.15	57.37	65.86	69.21	60.00	58.67	50.63	46.70	50.84	72.60	83.78	All	On Pk
<b>NEMass/Boston</b>	66.48	60.04	52.38	41.59	42.72	40.80	36.71	58.59	54.00	62.45	78.15	192.02	232.71	116.56	59.25	46.95	55.64	63.92	66.70	57.80	56.53	48.66	44.96	49.60	70.22	80.93	70.22	80.93
<b>New Hampshire</b>	66.22	60.08	52.51	41.74	42.91	41.03	36.81	58.59	54.02	62.37	78.03	191.37	231.77	116.10	58.99	46.86	55.59	63.97	66.95	58.01	56.71	48.76	44.93	49.46	70.16	80.81	70.16	80.81
<b>Maine</b>	66.71	60.47	52.39	41.49	42.73	41.02	36.51	57.66	53.17	61.26	76.42	187.49	227.78	114.06	57.87	45.84	54.26	62.61	65.82	57.23	55.99	47.88	44.11	49.18	69.16	79.34	69.16	79.34
<b>Mass Hub</b>	66.95	60.46	52.86	42.07	43.22	41.26	37.03	59.06	54.48	62.99	78.68	192.97	233.53	116.81	59.42	46.98	55.77	64.11	67.16	58.20	56.83	48.99	45.29	49.82	70.62	81.33	70.62	81.33
<b>DA Forecast Load (GW)</b>	13.62	12.86	12.37	12.10	11.99	12.15	12.49	13.72	15.30	16.70	17.70	18.33	18.67	18.93	19.00	19.08	19.09	19.02	18.66	18.25	18.27	17.79	16.57	15.20				
<b>Forecast Error %</b>	2.0%	4.5%	7.4%	12.3%	12.9%	13.0%	10.6%	6.3%	3.3%	2.4%	2.6%	2.9%	3.3%	2.1%	1.1%	-0.4%	-1.4%	-1.9%	-1.7%	-0.7%	0.2%	-0.1%	0.3%	0.8%				

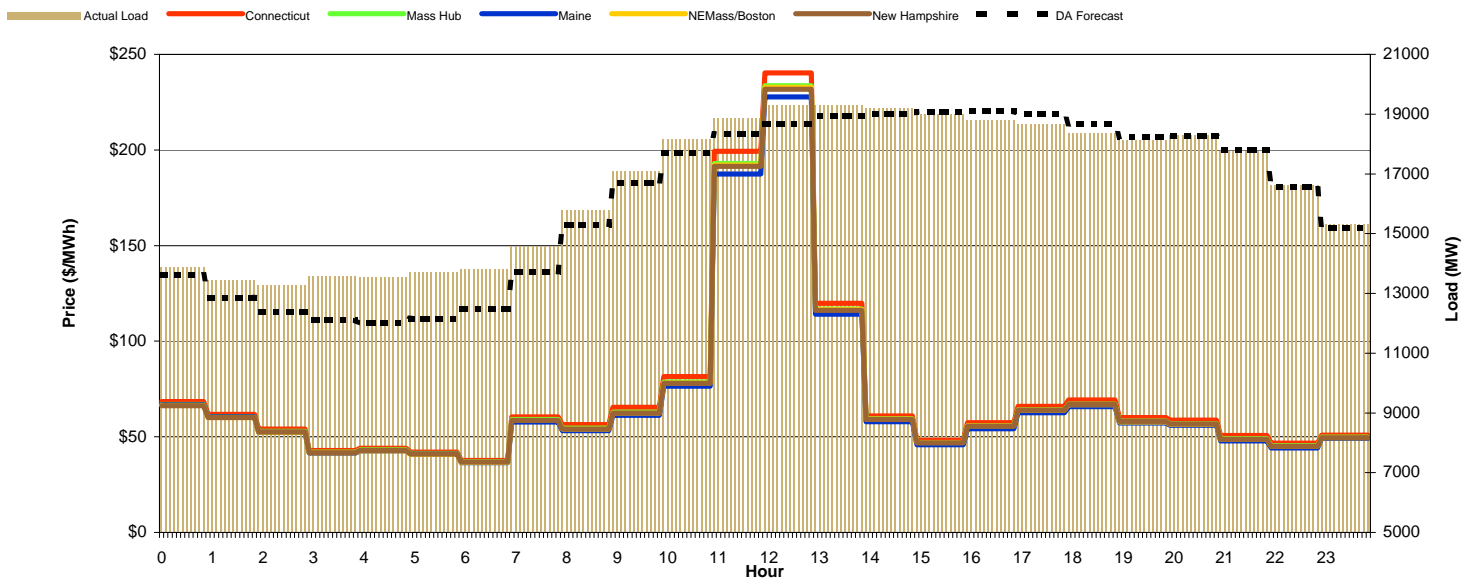




# ISO-NE Daily Report

Sunday August 07, 2011

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	39.22	37.57	37.30	34.76	34.29	34.65	34.61	33.24	37.47	40.15	42.90	48.49	51.22	53.89	55.33	59.37	59.58	59.18	59.62	56.02	60.65	47.40	41.30	39.50	44.57	50.36	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	38.44	36.67	36.38	33.91	33.45	33.83	33.90	32.32	36.50	38.98	41.34	46.51	49.09	51.53	52.88	56.51	56.88	56.49	56.69	53.35	57.82	45.14	39.54	38.67	44.03	48.22		
<b>New Hampshire</b>	38.62	36.89	36.51	34.15	33.67	34.04	34.14	32.42	36.66	39.05	41.46	46.74	49.15	51.45	52.73	56.20	56.61	56.36	56.61	53.35	57.78	45.15	39.33	38.72	44.07	48.19		
<b>Maine</b>	38.89	37.00	36.29	34.16	33.68	34.00	34.40	32.39	36.85	39.00	41.06	46.50	48.39	50.67	52.00	54.71	55.35	55.03	55.16	52.49	56.63	44.24	38.60	41.15	43.69	47.44		
<b>Mass Hub</b>	38.87	37.22	37.00	34.47	34.00	34.42	34.43	32.84	36.93	39.38	41.81	47.00	49.64	52.10	53.42	57.03	57.37	57.00	57.28	54.00	58.45	45.68	40.00	38.91	44.55	48.75		
<b>Cleared Load (GW)</b>	14.0	13.8	13.3	12.9	12.9	12.9	13.1	13.3	14.1	15.0	15.8	16.2	16.6	16.8	16.9	16.9	17.1	17.0	16.6	16.5	16.6	16.1	15.0	13.7				

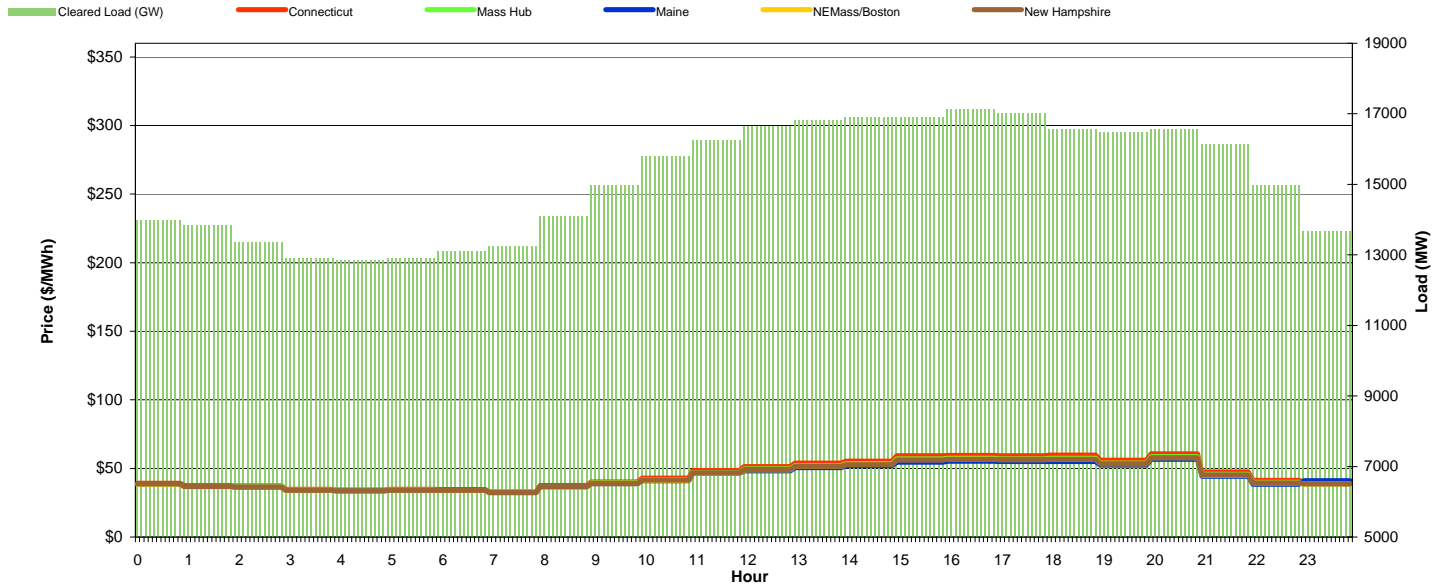

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	43.68	40.23	45.96	44.32	36.91	41.00	38.54	33.41	35.58	38.87	52.11	58.12	62.12	65.87	73.05	96.77	224.83	121.35	241.23	285.34	346.43	68.44	57.40	62.46	92.25	116.31	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	42.83	39.33	44.90	43.11	35.98	39.99	37.67	32.56	34.76	37.94	50.30	55.69	59.32	62.62	63.98	72.56	151.88	112.95	231.28	273.15	333.45	65.74	54.73	60.66	84.89	105.81		
<b>New Hampshire</b>	42.88	39.41	44.95	43.20	36.06	40.11	37.71	32.58	34.85	38.07	50.41	55.80	59.39	62.61	63.91	72.40	151.53	112.92	230.72	272.61	332.47	65.55	54.41	60.47	84.79	105.64		
<b>Maine</b>	43.20	39.64	45.18	43.32	35.97	40.36	37.93	32.19	34.60	38.03	49.82	55.00	58.48	61.71	62.81	70.61	147.13	110.04	224.51	266.71	323.91	63.46	52.72	60.23	83.23	103.23		
<b>Mass Hub</b>	43.03	39.65	45.37	43.64	36.40	40.45	38.07	32.90	34.97	38.11	50.66	56.13	59.73	63.08	63.83	70.84	145.59	113.22	233.16	275.28	335.89	66.34	55.30	61.01	85.11	105.94		
<b>DA Forecast Load (GW)</b>	14.13	13.34	12.87	12.57	12.34	12.34	12.50	13.47	14.85	16.08	17.03	17.70	18.15	18.36	18.39	18.52	18.72	18.80	18.63	18.33	18.46	17.90	16.55	15.07				
<b>Forecast Error %</b>	4.4%	10.4%	11.3%	13.2%	14.4%	15.3%	15.4%	8.9%	1.2%	-1.6%	-2.0%	-2.0%	-1.7%	-1.2%	0.1%	1.4%	2.6%	3.8%	4.3%	5.4%	6.0%	5.8%	6.4%	8.9%				

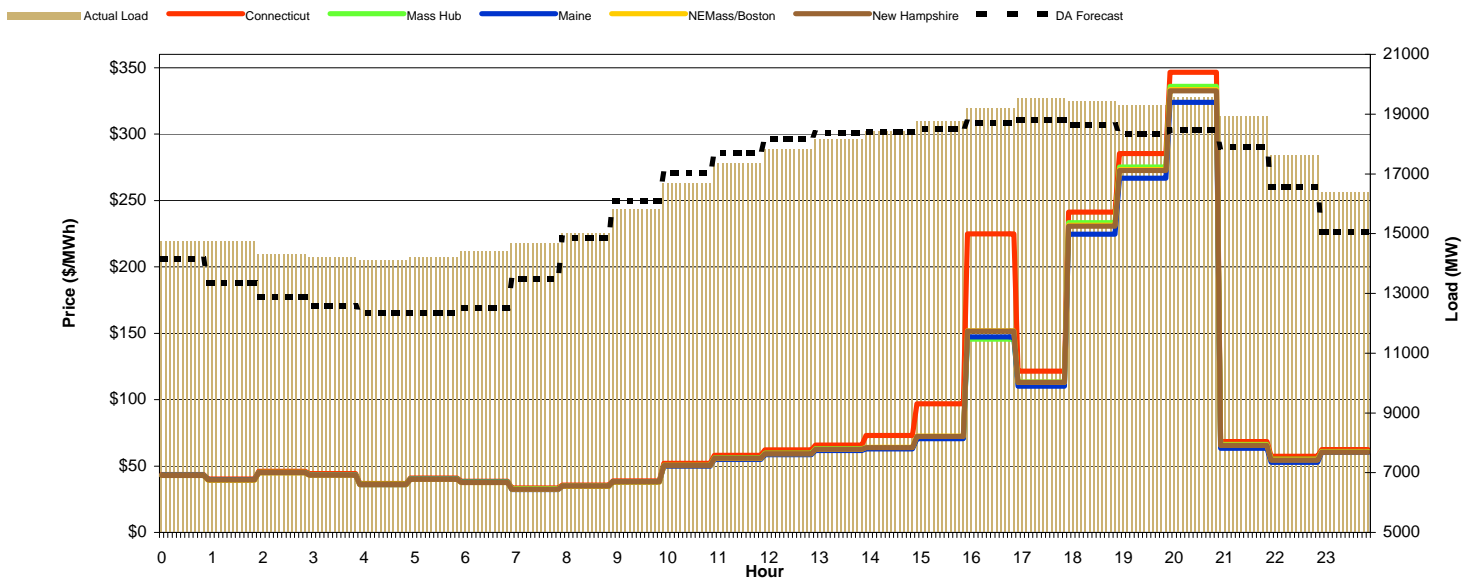




# ISO-NE Daily Report

Monday August 08, 2011

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	39.46	39.59	37.84	37.80	38.59	39.20	37.69	41.43	45.96	50.00	59.71	65.57	70.86	75.47	75.43	74.63	74.19	74.56	65.12	60.49	64.76	50.18	40.92	40.43	54.16	61.83	All	On Pk
<b>NEMass/Boston</b>	38.75	38.92	37.09	37.09	37.79	38.46	37.82	40.48	44.61	48.01	57.31	62.78	67.86	72.11	72.13	71.22	70.88	70.58	61.98	57.93	61.84	47.78	39.33	39.75	52.19	59.18		
<b>New Hampshire</b>	38.87	39.03	37.28	37.26	37.99	38.72	37.88	40.74	44.97	48.46	57.77	63.44	68.42	72.55	72.55	71.59	71.29	71.24	62.61	58.52	62.45	48.21	39.34	39.98	52.55	59.63		
<b>Maine</b>	39.01	39.00	37.18	37.15	37.88	38.87	42.23	40.51	44.49	47.83	56.82	62.25	66.88	70.61	70.88	69.70	69.63	69.85	61.68	57.71	61.30	47.14	38.36	41.00	52.00	58.48		
<b>Mass Hub</b>	39.03	39.22	37.50	37.47	38.24	38.84	37.79	40.75	45.01	48.51	57.80	63.27	68.39	72.51	72.55	71.58	71.31	71.04	62.42	58.34	62.43	48.31	39.72	39.96	52.58	59.62		
<b>Cleared Load (GW)</b>	13.4	13.2	13.0	12.9	13.1	13.5	13.8	15.8	17.1	18.1	18.6	19.1	19.5	19.7	19.9	19.9	19.8	19.5	19.1	18.7	18.7	17.8	16.4	14.4				

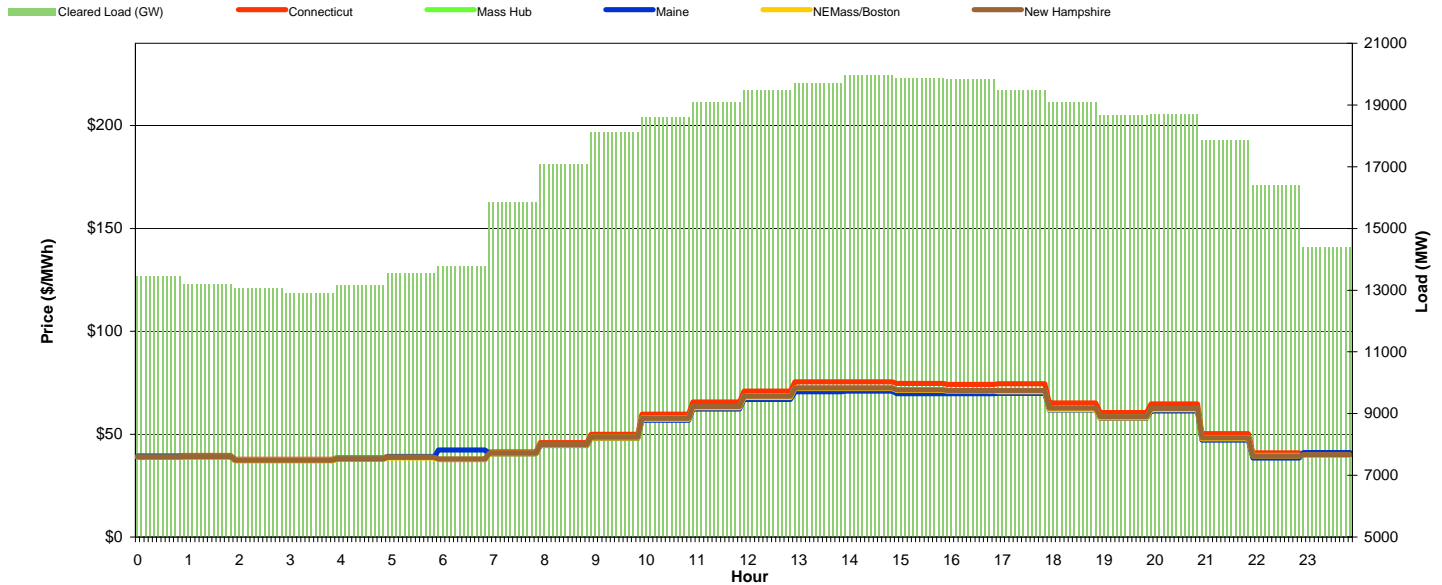

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	52.44	61.27	46.59	41.25	40.98	54.91	47.06	54.73	73.69	80.05	85.09	94.39	150.94	217.96	85.80	88.51	151.20	225.60	80.15	80.09	84.83	50.36	39.25	43.32	84.60	102.67	All	On Pk
<b>NEMass/Boston</b>	50.86	59.37	45.69	41.39	40.51	53.88	46.18	53.29	71.67	77.92	82.54	91.66	146.56	207.17	81.12	83.27	142.11	217.21	77.36	77.16	81.94	48.49	37.80	42.01	81.55	98.58		
<b>New Hampshire</b>	50.87	59.45	45.74	41.46	40.54	54.02	46.33	53.30	71.64	78.28	82.72	91.49	145.68	205.39	80.39	82.66	141.06	216.30	77.28	77.14	81.91	48.40	37.55	41.67	81.30	98.20		
<b>Maine</b>	50.62	59.10	45.29	41.03	40.16	53.62	45.96	52.04	66.29	75.16	80.20	88.33	139.65	196.82	76.76	79.23	135.23	208.10	74.32	74.33	78.80	46.28	35.83	39.79	78.46	94.21		
<b>Mass Hub</b>	51.28	59.95	47.49	45.78	41.68	54.50	46.42	53.53	71.92	78.20	82.96	91.89	146.89	207.14	81.13	83.22	142.00	218.22	77.87	77.80	82.52	48.89	38.04	42.29	82.15	98.89		
<b>DA Forecast Load (GW)</b>	14.81	14.05	13.64	13.44	13.55	14.30	15.66	17.33	18.69	19.86	20.73	21.39	21.80	22.05	22.10	22.04	21.93	21.55	20.90	20.40	20.20	19.16	17.43	15.64				
<b>Forecast Error %</b>	6.7%	8.9%	10.7%	12.8%	12.3%	9.4%	4.4%	2.1%	1.5%	1.0%	1.8%	2.4%	2.8%	3.6%	3.7%	3.6%	3.4%	3.5%	4.3%	3.6%	4.1%	4.9%	4.9%	8.3%				

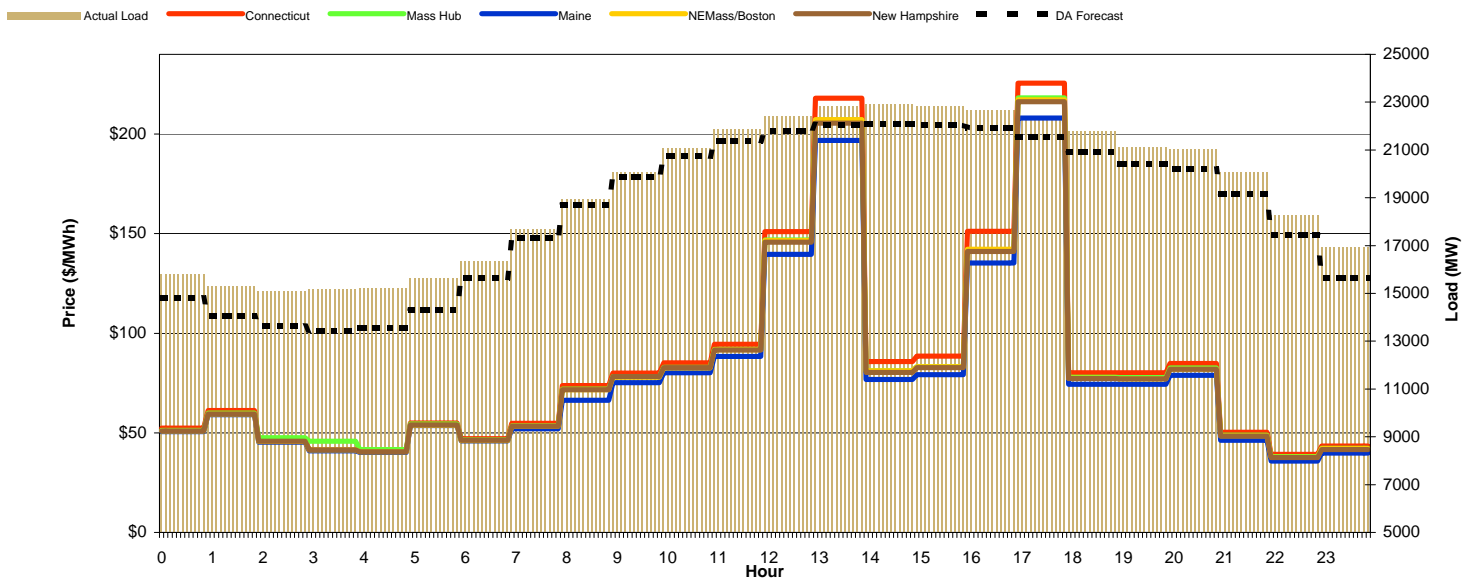






# ISO-NE Daily Report

Tuesday August 09, 2011

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	41.31	41.07	37.52	37.12	37.46	39.58	41.35	41.00	42.37	47.98	52.16	58.68	65.31	67.98	70.81	73.69	75.00	67.74	55.51	50.35	54.59	47.29	41.54	40.00	51.14	57.00	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	40.24	40.16	36.82	36.30	36.63	38.76	40.28	40.18	41.03	46.08	50.36	56.72	62.92	65.37	67.81	70.44	71.47	63.51	53.24	48.30	52.33	45.08	40.05	39.22	49.30	54.68		
<b>New Hampshire</b>	40.41	40.25	36.96	36.49	36.83	38.98	40.72	40.34	41.24	46.43	50.64	56.91	63.17	65.50	67.95	70.56	71.62	63.77	53.50	48.63	52.58	45.37	40.04	39.48	49.52	54.89		
<b>Maine</b>	39.63	39.38	36.10	35.60	35.99	38.30	40.48	39.81	40.60	45.58	49.37	55.45	61.68	64.04	66.64	69.15	70.18	62.30	52.27	47.55	51.36	44.22	38.76	39.26	48.49	53.69		
<b>Mass Hub</b>	40.86	40.74	37.41	36.85	37.21	39.30	40.81	40.46	41.46	46.60	50.90	57.29	63.61	66.09	68.48	71.14	72.22	64.18	53.93	48.89	53.09	45.74	40.51	39.53	49.89	55.29		
<b>Cleared Load (GW)</b>	15.2	14.6	14.2	13.7	13.8	14.2	15.2	16.1	17.4	18.4	19.2	19.9	20.1	20.3	20.2	20.1	20.1	19.9	19.6	19.2	19.2	17.9	16.2	14.5				

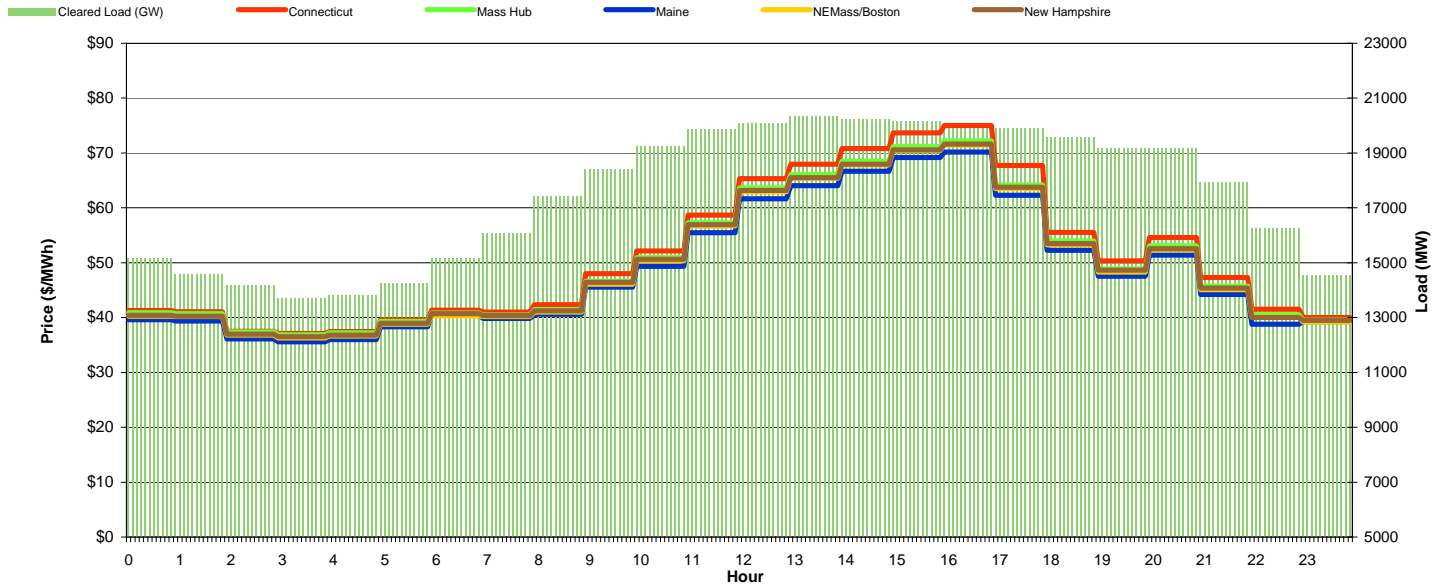

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	37.06	39.04	37.81	38.60	38.99	38.19	40.34	38.17	37.67	49.20	48.41	60.13	63.71	54.51	45.03	43.06	48.74	43.95	42.35	41.50	42.56	38.19	34.84	35.21	43.22	45.75	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	35.98	37.86	36.65	37.36	37.83	37.23	39.34	37.26	36.67	47.72	46.92	58.29	61.67	52.74	43.61	41.68	46.97	42.29	40.90	40.40	41.41	36.94	33.73	34.48	41.91	44.33		
<b>New Hampshire</b>	35.86	37.78	36.59	37.39	37.88	37.29	39.49	37.17	36.59	47.57	46.88	58.19	61.51	52.53	43.44	41.59	46.88	42.33	40.99	40.39	41.42	36.92	33.70	34.59	41.87	44.26		
<b>Maine</b>	34.45	36.42	35.32	36.39	36.97	36.41	38.69	35.99	35.33	45.86	45.20	56.12	59.39	50.78	41.80	40.14	45.24	40.81	39.64	39.14	40.11	35.60	32.40	34.02	40.51	42.72		
<b>Mass Hub</b>	36.33	38.29	37.08	37.82	38.27	37.61	39.63	37.44	36.77	47.92	47.20	58.62	61.96	53.02	43.83	41.93	47.35	42.66	41.28	40.69	41.72	37.26	34.02	34.73	42.23	44.60		
<b>DA Forecast Load (GW)</b>	14.44	13.59	13.12	12.84	12.91	13.55	14.91	16.61	17.87	18.80	19.64	20.25	20.65	21.01	21.10	21.09	21.00	20.65	19.94	19.43	19.35	18.46	16.78	15.10				
<b>Forecast Error %</b>	12.8%	14.9%	14.4%	14.1%	13.7%	11.4%	6.6%	3.3%	0.6%	1.3%	1.9%	2.2%	2.0%	0.8%	-0.4%	-2.5%	-3.8%	-3.7%	-2.7%	-1.6%	-1.4%	-1.7%	-1.1%	2.1%				

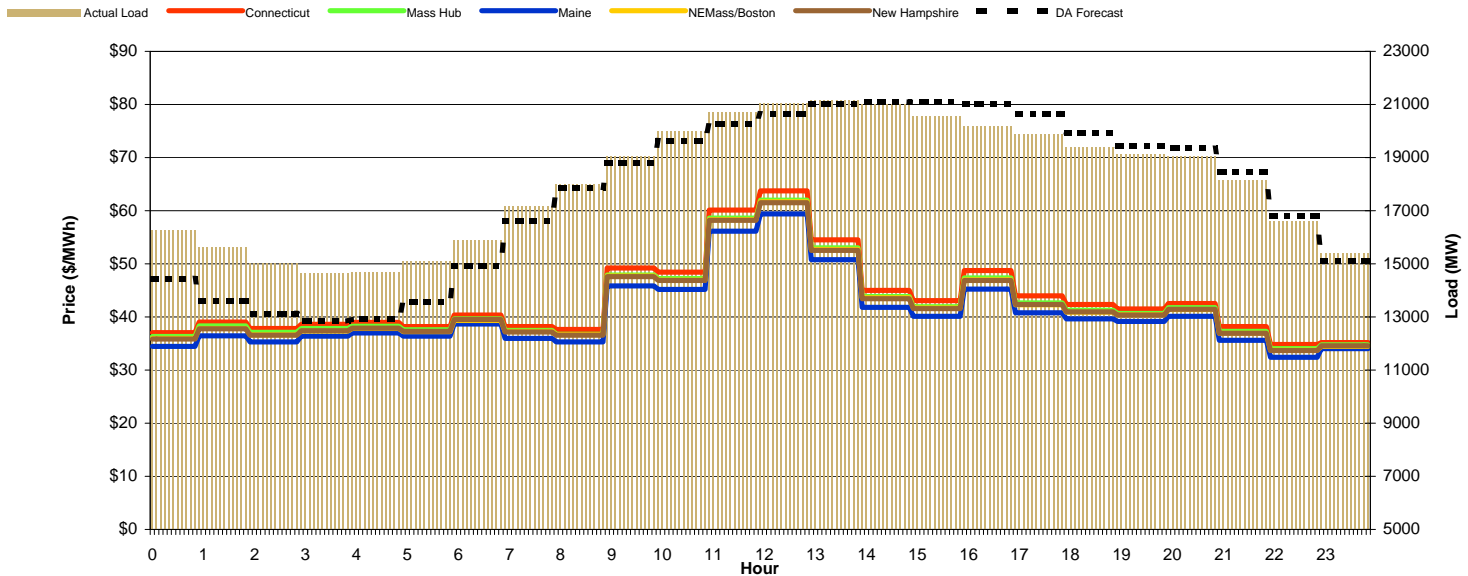




# ISO-NE Daily Report

Wednesday August 10, 2011

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	37.00	34.86	34.12	33.07	33.37	33.55	36.19	41.52	43.91	48.81	58.91	63.06	68.62	73.48	74.74	75.00	75.78	75.20	70.00	58.21	64.19	50.00	41.63	38.09	52.64	61.44	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	36.01	34.06	33.31	32.31	32.62	32.87	35.58	40.03	41.88	46.40	55.68	59.72	65.00	69.56	70.77	70.38	70.54	70.99	64.85	54.91	60.78	47.37	39.42	37.17	50.09	58.02		
<b>New Hampshire</b>	36.24	34.27	33.52	32.49	32.85	33.11	35.83	40.28	42.15	46.57	55.59	59.60	64.94	69.34	70.44	69.98	70.12	70.88	64.94	54.93	60.81	47.34	39.21	37.28	50.11	57.95		
<b>Maine</b>	35.50	33.50	32.81	31.78	32.17	32.47	35.21	39.14	40.68	44.75	52.85	56.33	61.61	66.00	67.35	66.81	66.95	67.36	61.95	52.44	58.07	45.05	37.35	36.46	48.11	55.29		
<b>Mass Hub</b>	36.56	34.60	33.85	32.78	33.12	33.35	35.97	40.66	42.58	47.18	56.71	60.78	66.04	70.60	71.70	71.24	71.31	72.06	65.96	55.89	61.94	48.20	40.14	37.54	50.87	58.94		
<b>Cleared Load (GW)</b>	14.3	13.8	13.6	13.2	13.3	13.6	14.4	16.0	17.0	18.3	18.8	19.4	19.9	20.1	20.5	20.5	20.6	19.8	19.3	19.0	19.4	18.0	16.5	14.7				

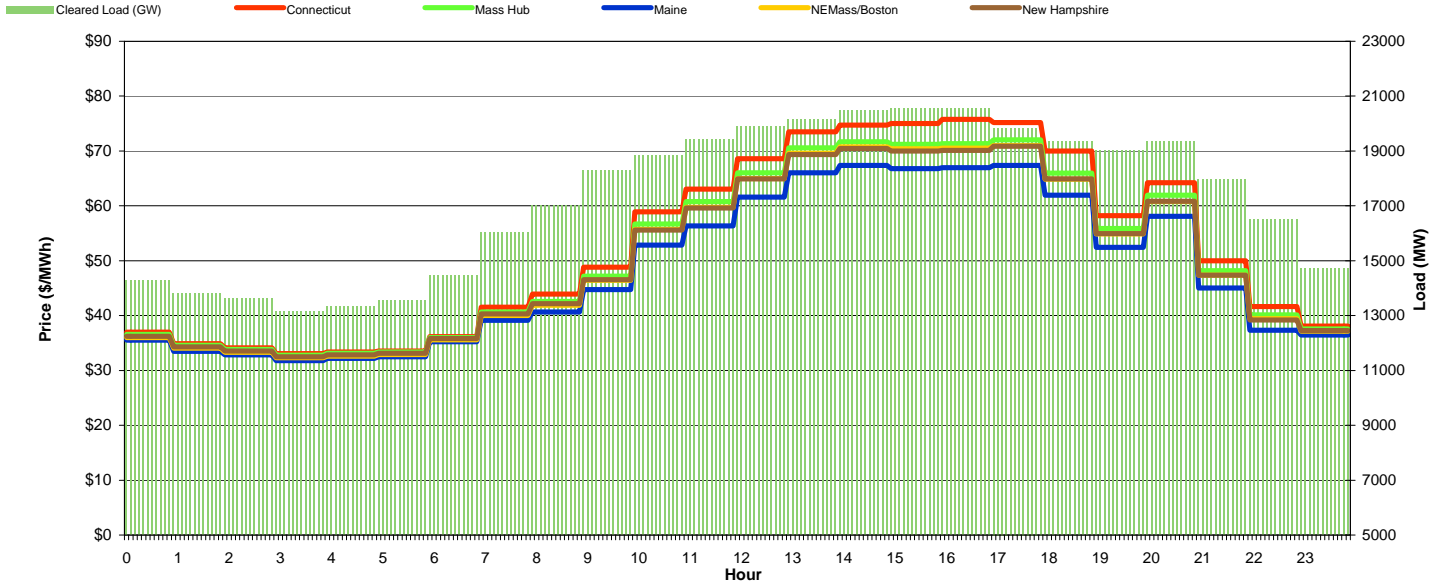

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	35.38	34.13	33.73	33.20	33.13	34.30	36.69	40.56	39.95	48.61	48.06	59.85	45.73	41.88	50.52	54.40	57.28	65.53	64.56	43.86	40.98	40.35	36.90	35.75	43.97	48.69	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	34.51	33.31	32.92	32.37	32.42	33.68	36.04	39.36	38.56	47.30	47.08	57.46	44.06	40.58	48.70	50.47	50.68	60.37	59.05	39.85	39.04	38.22	34.85	34.50	41.89	45.98		
<b>New Hampshire</b>	34.61	33.40	33.01	32.43	32.48	33.73	36.21	39.45	38.58	47.13	46.83	57.13	43.85	40.21	48.07	49.71	49.98	59.70	58.68	39.75	38.89	38.05	34.65	34.42	41.71	45.67		
<b>Maine</b>	33.89	32.68	32.25	31.56	31.68	32.78	35.33	38.16	37.16	45.42	45.04	54.64	42.09	38.65	45.73	46.86	47.40	56.82	56.06	38.24	37.40	36.42	33.05	33.52	40.12	43.70		
<b>Mass Hub</b>	34.85	33.69	33.32	32.76	32.77	34.02	36.33	39.67	38.90	47.59	47.24	58.02	44.40	40.78	48.97	50.64	50.62	60.72	59.66	40.18	39.45	38.75	35.38	34.86	42.23	46.31		
<b>DA Forecast Load (GW)</b>	13.87	13.20	12.71	12.52	12.67	13.42	14.70	16.38	17.59	18.52	19.21	19.75	20.15	20.56	20.61	20.64	20.74	20.43	19.84	19.33	19.28	18.38	16.70	15.00				
<b>Forecast Error %</b>	4.7%	7.6%	10.4%	10.6%	10.3%	8.2%	4.1%	-0.3%	-0.5%	-0.8%	-0.5%	-0.4%	-0.5%	-0.9%	0.5%	1.2%	1.0%	1.7%	1.1%	-0.2%	-0.5%	-0.4%	-0.3%	-0.8%				

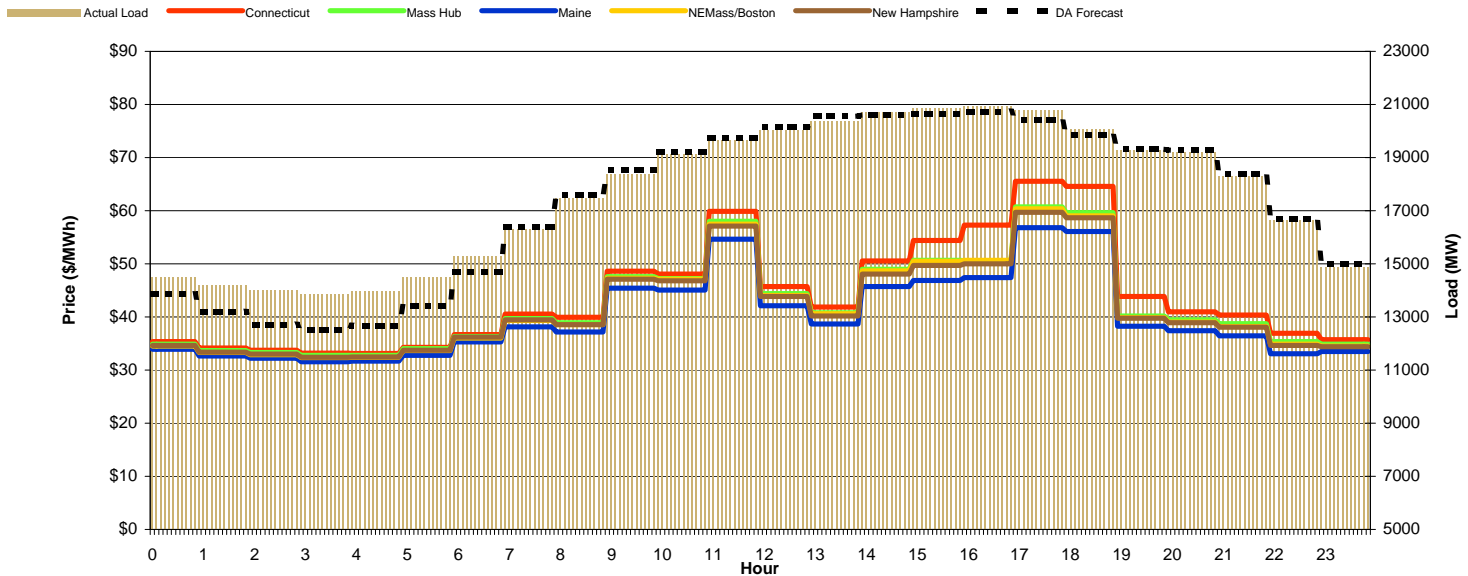




# ISO-NE Daily Report

Thursday August 11, 2011

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	36.76	34.40	33.65	33.27	33.52	34.66	35.19	37.61	39.26	43.26	44.56	48.58	53.57	44.88	49.84	53.87	54.92	49.86	47.94	44.82	48.41	42.27	38.78	38.76	42.61	46.40	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	36.04	33.80	32.89	32.48	32.74	33.94	34.68	36.89	37.98	41.84	43.10	46.98	51.62	43.27	47.65	51.01	51.72	48.25	46.14	43.06	46.66	40.75	37.50	38.00	41.21	44.65		
<b>New Hampshire</b>	36.06	33.87	32.97	32.59	32.88	34.10	34.95	37.16	38.15	41.85	43.11	46.90	51.42	43.06	47.33	50.65	51.35	48.00	45.97	42.96	46.59	40.65	37.46	38.11	41.17	44.54		
<b>Maine</b>	35.17	32.99	32.06	31.67	31.99	33.31	34.62	36.55	37.32	40.41	41.47	44.95	49.02	41.39	45.29	48.29	48.87	46.11	43.93	41.15	44.65	39.17	36.87	37.91	39.80	42.84		
<b>Mass Hub</b>	36.59	34.43	33.55	33.14	33.39	34.59	35.13	37.29	38.45	42.35	43.57	47.47	52.17	43.60	48.07	51.48	52.35	48.74	46.68	43.56	47.29	41.21	37.98	38.43	41.73	45.14		
<b>Cleared Load (GW)</b>	13.8	13.5	13.2	13.0	13.1	13.5	14.0	15.4	16.4	17.4	18.3	18.8	19.0	19.8	19.9	19.7	19.6	19.1	18.5	18.0	18.4	16.9	15.4	13.7				

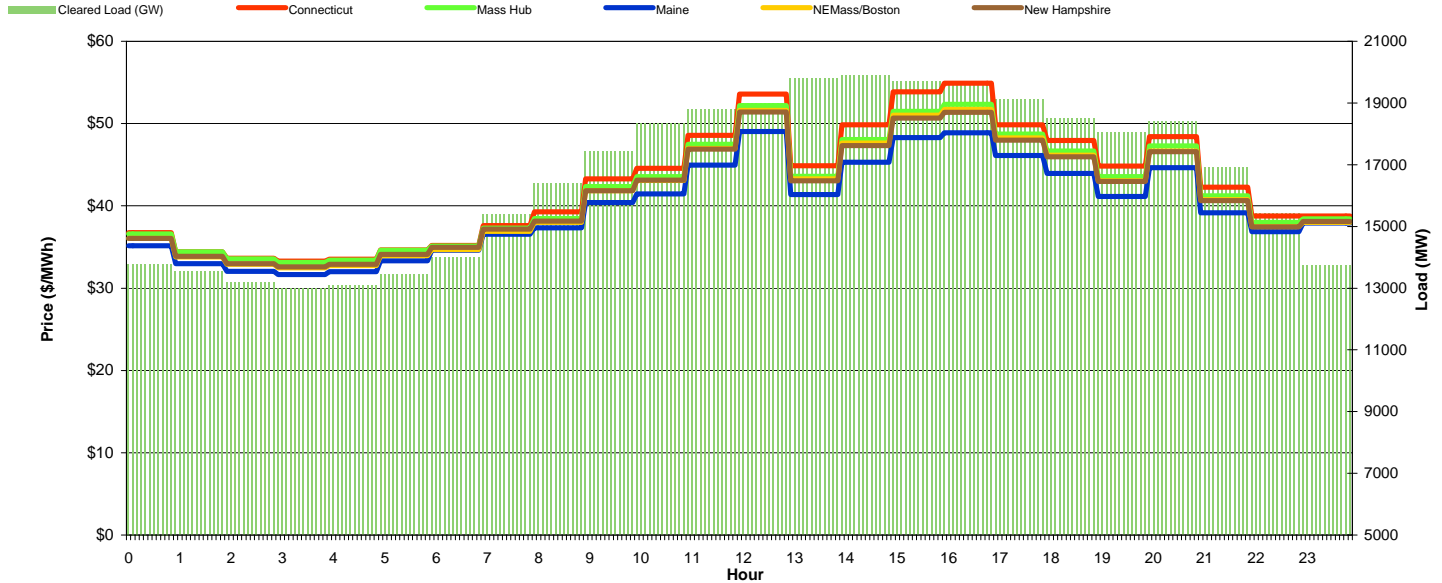

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	37.10	33.75	33.63	33.46	33.89	34.68	33.23	36.37	38.25	37.97	39.82	42.42	39.83	37.37	39.75	38.71	38.73	38.26	37.15	35.76	35.79	36.66	32.80	31.73	36.55	37.85	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	35.93	32.85	32.67	32.50	32.94	33.77	32.49	35.41	36.90	36.68	38.40	40.93	38.62	36.45	38.54	37.62	37.51	37.19	35.97	34.56	34.74	35.46	31.84	31.14	35.46	36.68		
<b>New Hampshire</b>	35.94	32.87	32.70	32.56	33.05	33.93	32.52	35.48	36.97	36.79	38.47	40.90	38.54	36.31	38.29	37.36	37.22	37.02	35.87	34.53	34.77	35.50	31.77	31.07	35.43	36.61		
<b>Maine</b>	35.05	32.08	31.98	31.83	32.36	33.39	31.85	34.82	36.08	35.88	37.33	39.47	37.23	35.32	36.91	36.10	35.88	35.81	34.67	33.48	33.85	34.63	31.20	30.76	34.50	35.54		
<b>Mass Hub</b>	36.41	33.34	33.17	33.01	33.46	34.25	32.76	35.64	37.22	36.94	38.67	41.19	38.81	36.47	38.60	37.65	37.58	37.28	36.16	34.80	34.95	35.73	32.08	31.32	35.73	36.86		
<b>DA Forecast Load (GW)</b>	13.77	12.97	12.48	12.25	12.35	13.01	14.26	15.82	16.94	17.70	18.39	18.82	19.05	19.27	19.35	19.41	19.29	18.76	18.13	17.74	17.80	16.94	15.40	13.86				
<b>Forecast Error %</b>	1.7%	5.2%	7.8%	9.7%	9.5%	6.9%	0.3%	-1.1%	-0.2%	0.4%	0.1%	-0.1%	-0.1%	0.2%	0.7%	0.4%	0.9%	2.5%	2.7%	1.3%	1.3%	1.6%	1.6%	0.9%				

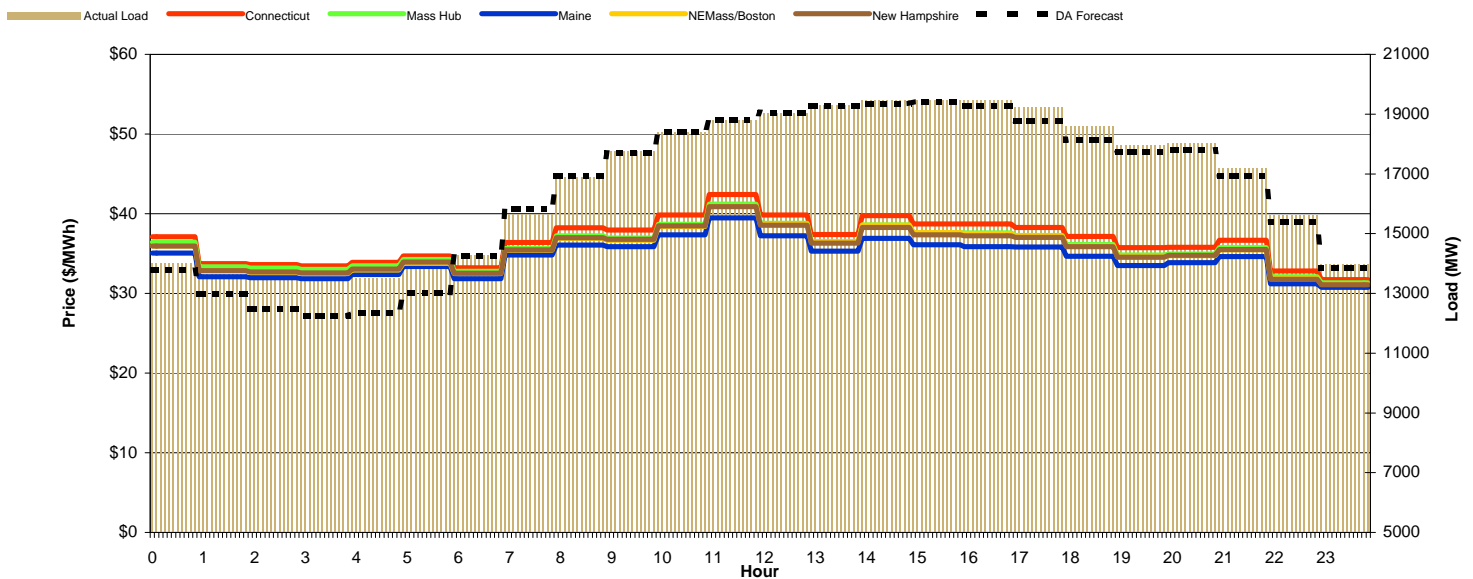




# ISO-NE Daily Report

Friday August 12, 2011

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$	
<b>Connecticut</b>	37.24	33.41	33.10	31.86	31.98	32.21	35.22	36.41	37.42	41.58	43.64	44.79	46.67	50.15	55.58	60.26	59.85	53.33	47.49	45.24	47.49	42.16	37.91	37.47	All	On Pk
<b>NEMass/Boston</b>	36.67	33.12	32.60	31.41	31.60	32.00	35.21	36.06	36.58	40.31	41.87	43.07	44.92	48.05	53.11	57.15	56.15	50.80	45.05	42.91	45.06	40.56	36.69	36.51	41.14	44.90
<b>New Hampshire</b>	36.69	33.10	32.61	31.41	31.62	31.99	35.31	36.29	36.70	40.43	42.10	43.29	45.07	48.01	52.95	56.89	55.89	50.88	45.23	43.08	45.26	40.59	36.67	36.64	41.20	44.96
<b>Maine</b>	36.64	32.87	32.20	31.05	31.30	31.72	35.31	36.14	36.41	39.95	41.28	42.52	44.03	46.82	51.62	55.22	54.24	49.54	44.12	42.12	44.33	39.89	35.99	38.00	40.55	44.01
<b>Mass Hub</b>	37.00	33.51	33.05	31.83	31.99	32.36	35.39	36.15	36.80	40.67	42.35	43.52	45.34	48.47	53.61	57.74	56.74	51.40	45.70	43.52	45.72	41.04	37.09	36.93	41.58	45.37
<b>Cleared Load (GW)</b>	12.6	12.7	12.4	12.2	12.3	12.7	13.3	14.7	15.9	16.9	17.9	18.5	18.8	19.1	19.2	18.8	18.8	18.6	18.1	17.7	17.9	16.7	15.6	13.9		

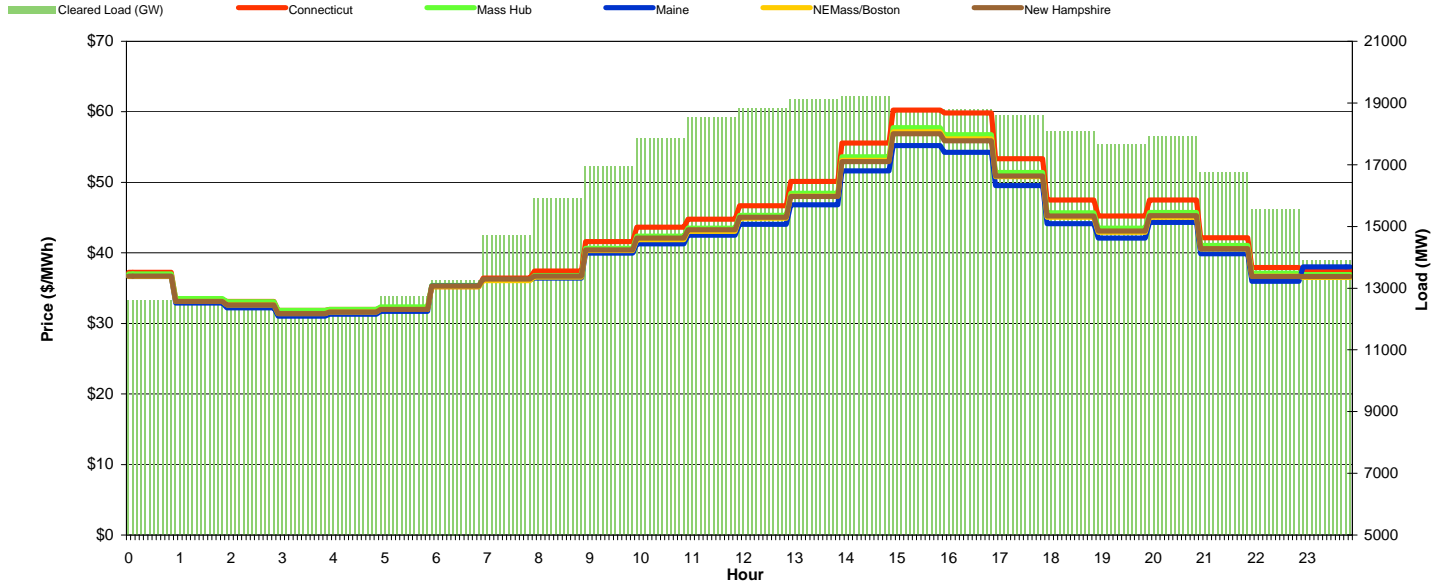

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$	
<b>Connecticut</b>	32.99	32.11	32.22	29.80	30.38	29.68	28.15	33.29	33.81	34.65	34.94	35.36	35.67	38.54	40.54	43.45	42.38	45.70	37.88	35.89	35.87	35.55	32.22	31.63	All	On Pk
<b>NEMass/Boston</b>	32.60	31.83	31.72	29.42	30.06	29.58	28.11	33.02	33.29	33.65	33.75	34.19	34.52	37.10	38.86	41.59	40.60	43.64	36.23	34.26	34.36	34.20	31.38	31.18	34.13	35.92
<b>New Hampshire</b>	32.56	31.80	31.75	29.38	30.04	29.54	28.05	33.04	33.42	33.92	34.07	34.47	34.74	37.18	38.84	41.50	40.51	43.62	36.31	34.42	34.59	34.31	31.41	31.31	34.20	36.02
<b>Maine</b>	32.35	31.72	31.43	29.09	29.80	29.47	28.10	32.96	33.38	33.80	33.83	34.14	34.24	36.52	37.92	40.47	39.60	42.43	35.52	33.73	34.04	33.64	30.78	31.24	33.76	35.44
<b>Mass Hub</b>	32.75	32.07	32.06	29.69	30.32	29.75	28.16	33.04	33.38	33.87	34.00	34.42	34.74	37.34	39.14	41.88	40.86	43.99	36.57	34.62	34.70	34.52	31.58	31.31	34.37	36.17
<b>DA Forecast Load (GW)</b>	12.91	12.16	11.60	11.41	11.56	12.18	13.44	15.06	16.22	17.08	17.79	18.30	18.53	18.80	18.92	18.85	18.75	18.46	17.82	17.36	17.42	16.78	15.47	14.05		
<b>Forecast Error %</b>	-0.8%	5.1%	9.0%	8.7%	8.1%	5.7%	-1.0%	-2.6%	-1.5%	-0.9%	-0.7%	-1.1%	-1.2%	-1.1%	-0.7%	0.0%	0.8%	1.8%	2.6%	1.7%	1.6%	1.0%	0.5%	0.0%		

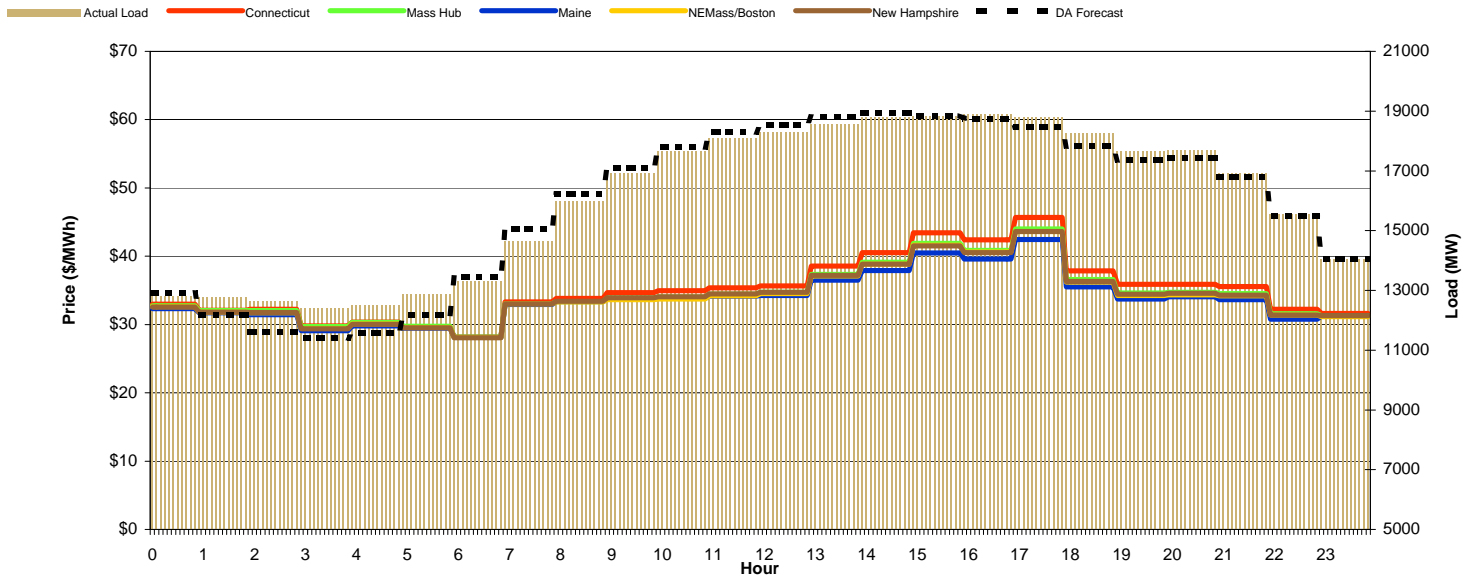




# ISO-NE Daily Report

Saturday August 13, 2011

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$	
<b>Connecticut</b>	37.51	35.01	31.66	30.90	31.26	31.58	32.20	36.40	37.22	39.51	44.28	49.52	47.59	52.38	51.31	57.30	56.09	53.02	52.68	51.03	54.64	45.29	41.00	41.06	43.35	48.08
<b>NEMass/Boston</b>	37.23	35.34	31.97	31.09	31.42	31.84	32.35	36.52	36.78	38.69	42.99	47.91	46.24	50.77	49.82	55.35	54.10	51.25	50.78	48.98	52.81	43.85	39.93	40.30	42.43	46.67
<b>New Hampshire</b>	37.37	35.54	32.12	31.24	31.62	32.07	32.49	36.81	36.92	38.83	43.25	48.14	46.38	50.87	49.90	55.28	54.18	51.41	51.00	49.27	52.95	44.05	40.03	40.45	42.59	46.83
<b>Maine</b>	40.28	35.86	32.38	31.38	31.85	32.34	32.24	36.70	36.74	38.16	42.06	46.62	44.81	49.32	48.36	53.45	52.69	49.86	49.40	47.50	51.34	42.74	39.33	40.16	41.90	45.57
<b>Mass Hub</b>	37.45	35.43	32.04	31.25	31.59	31.99	32.49	36.57	36.97	39.01	43.50	48.52	46.74	51.33	50.31	55.95	54.66	51.84	51.43	49.71	53.52	44.44	40.42	40.72	42.83	47.18
<b>Cleared Load (GW)</b>	12.7	11.9	11.3	11.4	11.3	11.3	11.6	12.8	14.6	15.8	16.9	17.4	17.8	17.9	18.1	18.1	18.3	17.9	17.5	17.1	17.6	16.8	15.5	13.9		

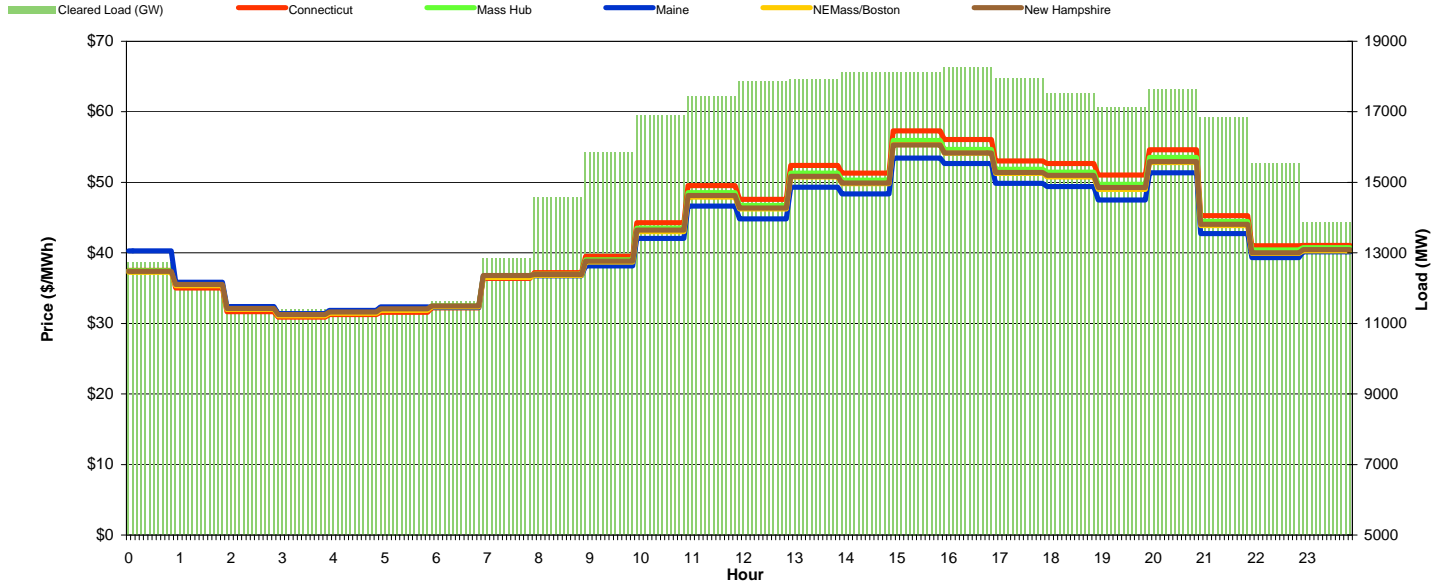

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$	
<b>Connecticut</b>	32.80	32.41	30.39	31.83	31.78	29.20	27.60	31.55	34.30	35.08	38.30	41.38	36.84	39.63	40.73	42.69	38.90	43.70	42.83	39.68	35.62	33.64	32.51	32.75	35.67	37.96
<b>NEMass/Boston</b>	32.39	32.41	30.53	31.87	31.85	29.31	27.64	31.39	33.55	33.90	36.88	39.78	35.56	38.03	39.15	40.81	37.38	42.00	41.06	38.17	34.47	32.61	31.58	32.13	34.77	36.65
<b>New Hampshire</b>	32.46	32.45	30.57	31.98	31.99	29.39	27.58	31.43	33.64	34.10	37.14	40.06	35.70	38.14	39.23	40.88	37.50	42.19	41.32	38.44	34.71	32.81	31.63	32.21	34.90	36.81
<b>Maine</b>	32.53	32.50	30.59	32.03	32.07	29.33	27.32	31.30	33.35	33.47	36.30	39.04	34.76	37.05	38.19	39.83	36.69	40.95	40.15	37.42	33.96	32.15	31.01	32.16	34.34	35.98
<b>Mass Hub</b>	32.52	32.45	30.56	32.02	31.98	29.39	27.68	31.43	33.69	34.16	37.19	40.11	35.78	38.31	39.41	41.11	37.60	42.29	41.41	38.52	34.73	32.84	31.80	32.33	34.97	36.90
<b>DA Forecast Load (GW)</b>	12.94	12.17	11.67	11.38	11.30	11.41	11.78	12.98	14.50	15.68	16.56	17.09	17.40	17.52	17.68	17.73	17.72	17.74	17.38	17.09	17.29	16.72	15.55	14.28		
<b>Forecast Error %</b>	-0.8%	-0.9%	1.0%	5.5%	5.9%	3.7%	1.4%	-1.5%	-2.4%	-1.9%	-1.7%	-1.6%	-1.8%	-1.8%	-2.2%	-2.0%	-1.6%	-1.3%	-0.8%	-0.7%	-0.4%	-0.5%	-0.3%	-0.5%		

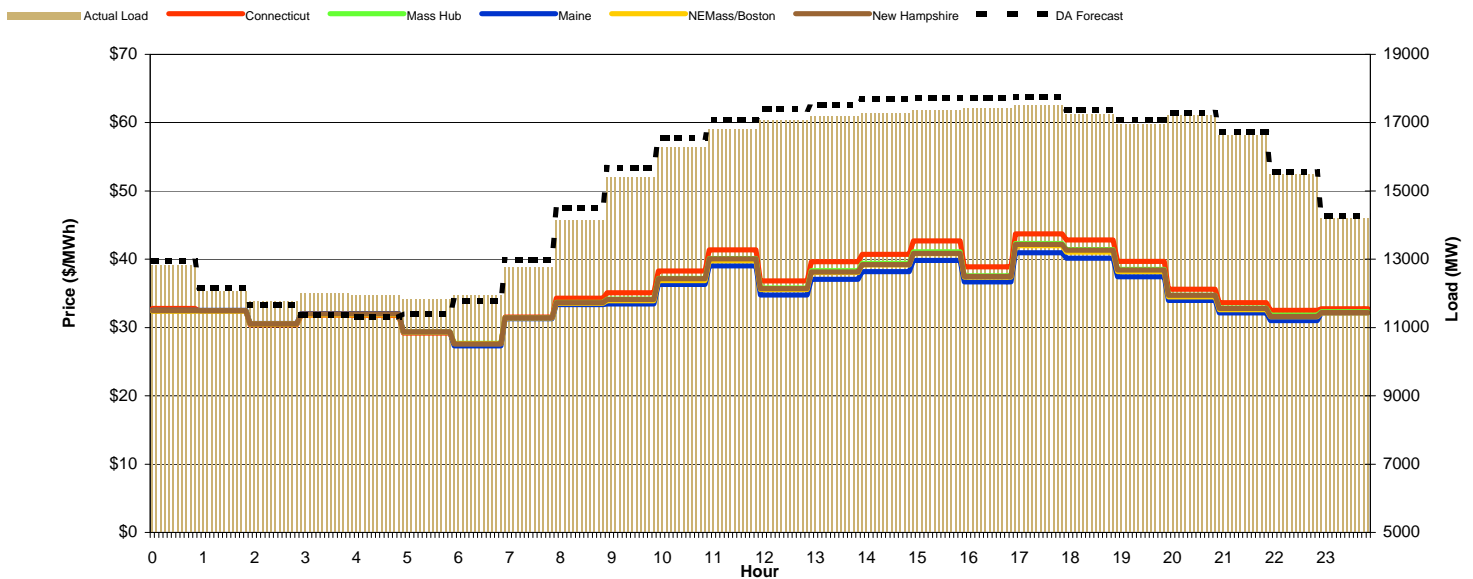




# ISO-NE Daily Report

Sunday August 14, 2011

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	36.29	35.83	32.80	32.49	31.62	32.67	31.74	33.32	35.87	37.21	38.81	40.66	43.01	39.81	42.10	42.14	42.61	42.64	39.51	43.70	46.73	40.00	38.09	38.02	38.24	40.39	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	36.04	36.02	33.09	32.51	31.77	32.68	31.95	33.47	35.74	36.70	37.84	39.70	41.74	38.72	40.84	40.88	41.28	41.32	38.40	42.23	45.15	38.79	37.12	37.27	37.55	39.37		
<b>New Hampshire</b>	36.39	36.19	33.25	32.72	31.99	32.91	32.16	33.65	36.14	37.11	38.07	39.85	41.92	38.82	40.92	40.98	41.44	41.58	38.68	42.57	45.50	38.94	37.28	37.55	37.78	39.59		
<b>Maine</b>	36.57	36.28	33.32	32.69	32.00	32.91	36.00	33.68	36.05	37.02	37.48	38.78	40.78	37.97	39.84	40.15	40.44	40.59	38.06	41.65	44.34	38.17	36.90	37.62	37.47	38.87		
<b>Mass Hub</b>	36.16	36.02	33.12	32.63	31.93	32.82	32.00	33.44	35.83	36.88	38.16	39.99	42.12	39.02	41.18	41.19	41.62	41.62	38.64	42.61	45.57	39.11	37.37	37.52	37.77	39.65		
<b>Cleared Load (GW)</b>	12.5	11.7	11.4	11.3	11.3	11.3	11.1	11.8	13.3	14.6	15.4	16.0	16.4	16.4	16.4	16.5	16.6	16.5	16.4	16.5	16.8	15.7	14.6	13.2				

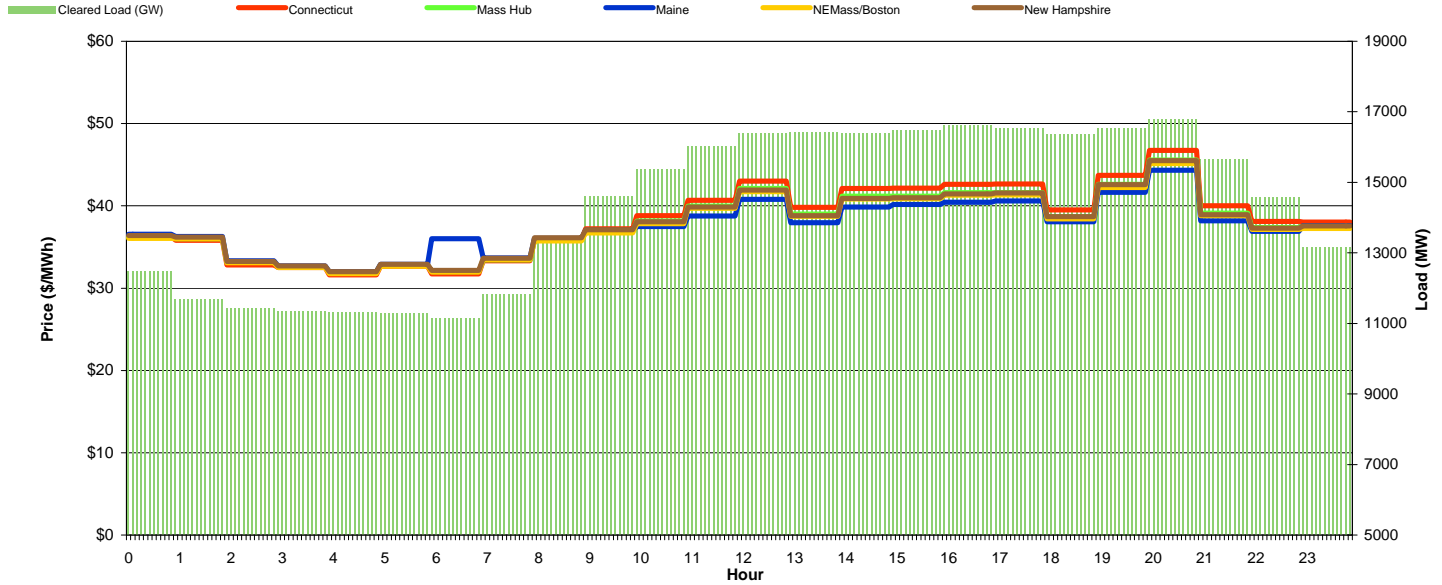

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	36.89	40.40	47.77	43.05	34.13	41.98	31.59	32.04	34.87	34.41	34.89	35.15	35.71	34.37	34.14	33.22	33.49	35.52	33.87	34.38	34.71	33.77	34.01	33.06	35.73	34.28	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	36.51	40.37	48.09	43.34	34.54	42.28	31.85	32.21	34.80	33.96	34.16	34.39	34.88	33.70	33.45	32.64	32.96	34.72	33.41	33.88	34.19	33.32	33.61	32.94	35.43	33.77		
<b>New Hampshire</b>	36.61	40.56	48.21	43.46	34.60	42.36	31.86	32.22	34.90	34.13	34.36	34.60	35.06	33.82	33.55	32.71	33.14	34.98	33.69	34.15	34.43	33.42	33.92	33.27	35.58	33.94		
<b>Maine</b>	36.75	40.72	48.36	43.44	34.64	42.22	31.80	32.03	34.37	33.62	33.72	33.90	34.21	33.17	32.89	32.11	32.68	34.28	33.38	33.79	33.98	32.92	34.02	33.49	35.27	33.44		
<b>Mass Hub</b>	36.64	40.43	48.16	43.43	34.57	42.35	31.86	32.19	34.84	34.11	34.40	34.63	35.14	33.91	33.65	32.81	33.10	34.94	33.52	34.01	34.30	33.45	33.73	33.01	35.55	33.92		
<b>DA Forecast Load (GW)</b>	12.97	12.20	11.74	11.43	11.27	11.35	11.54	12.50	13.75	15.03	15.90	16.49	16.82	16.92	16.86	16.91	17.03	17.12	17.04	16.98	17.20	16.52	15.23	13.89				
<b>Forecast Error %</b>	1.7%	2.5%	6.4%	10.0%	10.8%	11.3%	7.3%	2.7%	0.9%	-1.4%	-2.2%	-3.0%	-3.6%	-4.9%	-5.3%	-5.9%	-6.0%	-5.1%	-4.4%	-3.8%	-3.9%	-4.0%	-3.2%	-2.5%				

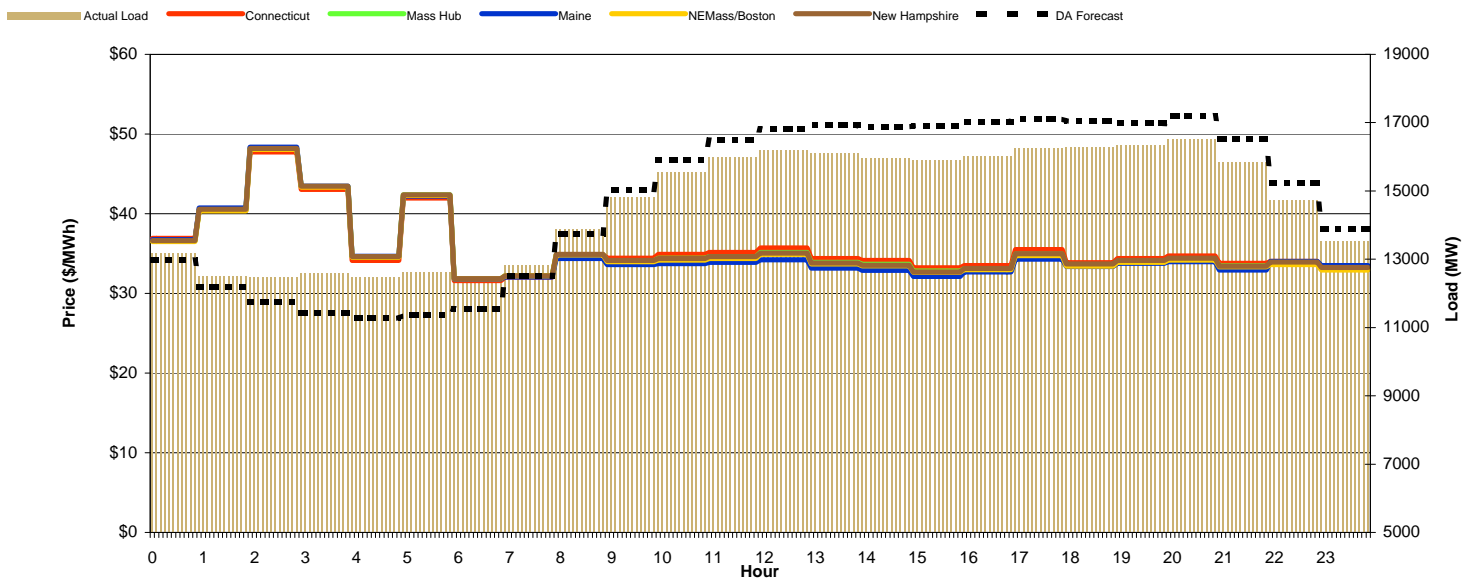




# ISO-NE Daily Report

Monday August 15, 2011

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	38.47	34.45	35.63	33.25	32.73	36.00	38.58	40.00	41.51	45.61	47.66	48.68	46.99	45.89	48.37	48.40	52.11	49.30	48.34	48.26	47.95	42.79	40.21	39.83	42.96	46.38	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	38.66	35.08	36.00	33.70	33.27	36.54	38.99	39.75	40.89	44.66	46.51	47.52	45.96	44.95	47.18	47.10	50.58	48.05	46.93	46.71	46.64	41.69	39.81	39.95	42.38	45.31		
<b>New Hampshire</b>	39.16	35.38	36.39	34.04	33.58	37.00	39.39	40.24	41.18	45.05	46.85	47.83	46.25	45.15	47.32	47.22	50.75	48.37	47.26	47.03	46.92	41.78	40.31	40.53	42.71	45.59		
<b>Maine</b>	39.11	35.41	36.24	33.99	33.57	37.05	39.21	39.52	40.49	44.38	45.65	46.54	45.15	44.16	46.07	46.00	49.44	47.36	46.28	45.88	45.75	40.83	40.05	40.60	42.03	44.60		
<b>Mass Hub</b>	38.66	34.97	36.01	33.69	33.21	36.51	38.96	39.82	41.00	44.88	46.71	47.67	46.03	45.00	47.27	47.21	50.71	48.18	47.15	46.99	46.92	41.89	39.79	39.89	42.46	45.45		
<b>Cleared Load (GW)</b>	12.4	12.0	12.1	11.8	11.8	12.5	13.2	15.1	16.0	17.1	17.6	17.8	17.8	18.0	18.0	18.0	17.9	17.9	17.6	17.4	17.5	16.2	14.8	13.1				

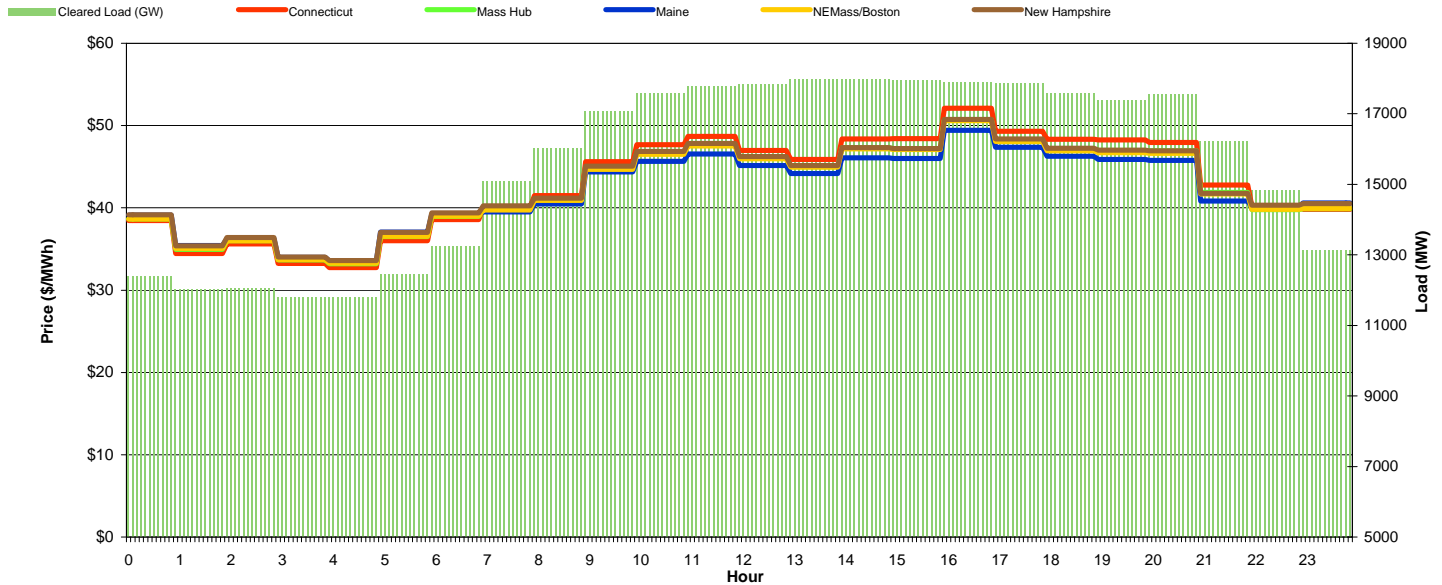

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	32.43	32.11	34.25	32.31	31.10	34.20	37.37	44.26	40.52	43.31	45.99	44.17	42.56	46.88	43.04	39.95	39.07	34.57	34.70	35.51	34.12	33.10	28.60	30.14	37.26	39.40	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	32.47	32.47	34.54	32.61	31.53	34.73	37.76	43.84	39.88	42.48	45.03	43.45	42.02	45.95	42.17	39.17	38.24	33.99	34.08	34.67	33.28	32.24	28.05	29.94	36.86	38.66		
<b>New Hampshire</b>	32.76	32.72	34.91	32.94	31.82	34.97	38.03	44.20	40.22	42.89	45.38	43.76	42.31	46.14	42.38	39.40	38.49	34.26	34.42	34.98	33.56	32.41	28.00	29.89	37.12	38.93		
<b>Maine</b>	32.87	32.85	35.03	32.98	31.92	34.98	37.91	43.73	39.74	42.16	44.18	42.62	41.43	45.03	41.63	38.70	37.85	33.76	33.90	34.39	32.98	31.82	27.42	29.59	36.64	38.21		
<b>Mass Hub</b>	32.45	32.37	34.52	32.59	31.46	34.62	37.65	43.92	40.02	42.67	45.26	43.64	42.15	46.20	42.38	39.33	38.39	34.10	34.23	34.87	33.48	32.45	28.15	29.96	36.95	38.83		
<b>DA Forecast Load (GW)</b>	12.34	11.84	11.51	11.46	11.75	12.61	14.09	15.66	16.70	17.47	18.03	18.37	18.44	18.55	18.48	18.39	18.37	18.35	18.00	17.90	17.88	16.88	15.34	13.90				
<b>Forecast Error %</b>	2.1%	1.8%	6.6%	6.6%	5.7%	3.6%	0.9%	0.2%	0.7%	0.5%	0.5%	0.1%	-0.3%	-1.6%	-2.4%	-3.7%	-4.1%	-4.2%	-3.5%	-3.9%	-5.2%	-5.5%	-5.3%	-5.9%				

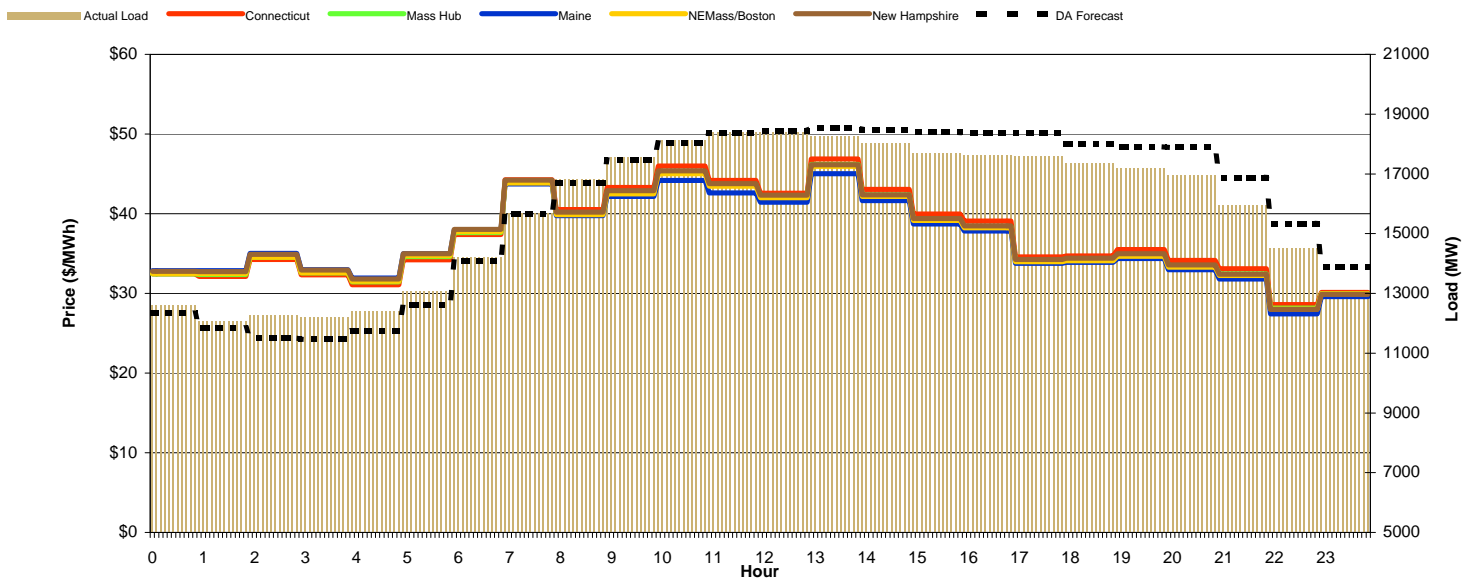




# ISO-NE Daily Report

Tuesday August 16, 2011

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$				
<b>Connecticut</b>	33.99	31.29	26.86	26.03	26.83	31.27	33.97	36.15	37.70	39.30	41.07	48.68	50.00	49.33	49.09	51.52	51.41	51.20	47.20	48.99	47.22	40.28	37.64	36.29	36.29	40.55	45.42	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	33.94	31.80	27.35	26.47	27.34	31.96	34.43	36.11	37.10	38.61	40.13	47.28	48.67	48.13	47.93	50.17	50.06	49.69	45.78	47.13	45.68	39.01	36.57	35.90	39.89	44.25			
<b>New Hampshire</b>	34.16	31.77	27.31	26.43	27.31	32.01	34.87	36.55	37.45	39.00	40.59	47.69	49.10	48.42	48.20	50.42	50.28	50.03	46.23	47.56	46.10	39.38	36.64	35.95	40.14	44.60			
<b>Maine</b>	33.80	31.43	26.98	26.09	27.00	31.77	35.02	36.13	36.80	38.41	39.65	46.14	47.64	47.30	47.03	49.20	48.90	48.57	45.07	46.09	44.92	38.58	35.49	35.13	39.30	43.50			
<b>Mass Hub</b>	34.10	31.77	27.30	26.42	27.28	31.87	34.48	36.25	37.33	38.85	40.39	47.60	48.95	48.30	48.07	50.36	50.27	49.99	46.12	47.60	46.09	39.36	36.93	36.10	40.07	44.53			
<b>Cleared Load (GW)</b>	12.1	11.4	10.9	10.7	10.9	11.6	13.2	14.7	16.0	16.9	17.5	17.8	18.1	18.4	18.5	18.4	18.4	18.2	17.8	17.5	17.6	16.7	15.0	13.3					

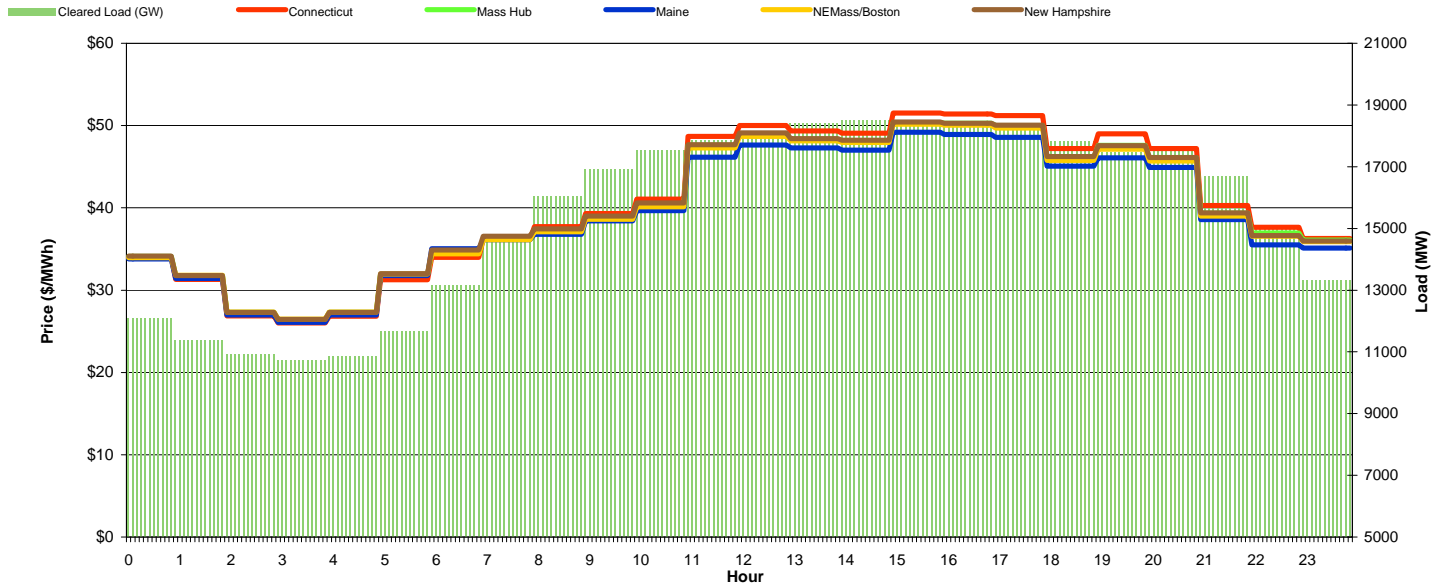

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	31.85	23.44	1.26	0.00	0.00	0.00	26.20	30.11	31.69	32.01	33.18	33.75	33.21	32.84	32.41	33.83	34.55	34.86	35.36	36.23	36.92	33.27	30.14	31.15	27.01	33.40	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	31.82	23.59	1.27	0.00	0.00	0.00	26.44	30.03	31.25	31.63	32.68	33.18	32.65	32.33	31.87	33.08	33.77	34.08	34.48	35.12	35.71	32.33	29.40	30.79	26.56	32.72		
<b>New Hampshire</b>	31.74	23.45	1.26	0.00	0.00	0.00	26.42	29.95	31.22	31.64	32.78	33.30	32.69	32.36	31.87	33.13	33.75	34.14	34.65	35.29	35.87	32.26	29.13	30.43	26.56	32.75		
<b>Maine</b>	31.35	23.07	1.24	0.00	0.00	0.00	26.27	29.46	30.74	31.26	32.35	32.96	32.10	32.08	31.60	32.85	33.19	33.74	34.29	34.82	35.15	31.39	28.15	29.43	26.15	32.26		
<b>Mass Hub</b>	31.84	23.57	1.26	0.00	0.00	0.00	26.35	30.00	31.29	31.63	32.71	33.22	32.67	32.32	31.84	33.11	33.82	34.16	34.61	35.32	35.94	32.48	29.52	30.85	26.60	32.79		
<b>DA Forecast Load (GW)</b>	12.34	11.74	11.39	11.25	11.41	12.20	13.56	15.08	16.14	16.94	17.60	18.04	18.27	18.49	18.49	18.46	18.49	18.39	18.00	17.75	17.81	16.95	15.41	13.88				
<b>Forecast Error %</b>	-2.2%	-1.2%	-0.7%	-2.0%	-2.7%	-3.0%	-3.9%	-3.9%	-3.8%	-4.3%	-4.5%	-5.0%	-5.7%	-6.5%	-6.9%	-7.2%	-7.2%	-6.9%	-6.1%	-6.0%	-4.7%	-4.7%	-4.6%	-4.9%				

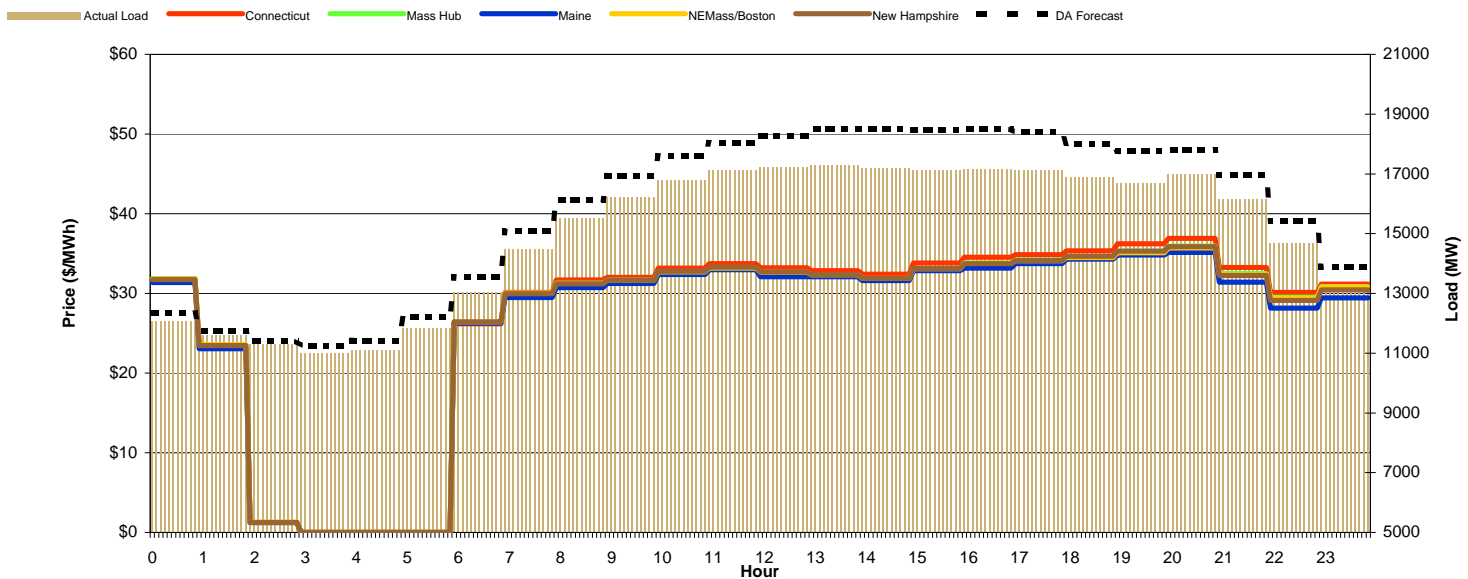






# ISO-NE Daily Report

Wednesday August 17, 2011

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	32.27	28.61	26.24	26.76	26.20	29.97	35.01	36.13	37.10	37.52	39.48	42.58	45.84	52.03	53.36	55.23	57.85	53.30	51.78	50.05	53.00	41.73	38.30	37.57	41.16	46.58	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	31.67	28.13	26.25	26.83	26.37	29.64	34.86	35.94	36.70	36.96	38.63	41.55	44.69	50.53	51.68	53.44	56.00	51.53	49.55	47.88	50.85	40.14	36.95	36.66	40.14	45.19		
<b>New Hampshire</b>	31.77	28.14	26.13	26.74	26.29	29.71	35.15	36.41	37.17	37.19	38.80	41.58	44.63	50.30	51.34	53.03	55.55	51.26	49.47	47.90	50.86	40.23	37.04	36.90	40.15	45.17		
<b>Maine</b>	31.36	27.73	25.70	26.44	26.03	29.35	35.06	36.21	37.12	36.47	37.73	39.87	42.71	48.25	49.27	50.91	53.32	48.97	47.22	45.64	48.53	38.67	36.12	36.63	38.97	43.56		
<b>Mass Hub</b>	31.91	28.40	26.25	26.86	26.38	29.85	35.00	35.98	36.75	37.06	38.79	41.75	44.90	50.79	51.99	53.72	56.29	51.85	49.97	48.36	51.28	40.53	37.34	36.99	40.37	45.46		
<b>Cleared Load (GW)</b>	11.5	11.2	10.6	10.6	10.8	11.6	12.7	14.7	16.0	17.1	18.1	18.8	19.2	19.7	19.6	19.9	20.0	19.6	18.5	18.2	18.3	17.3	15.7	13.9				

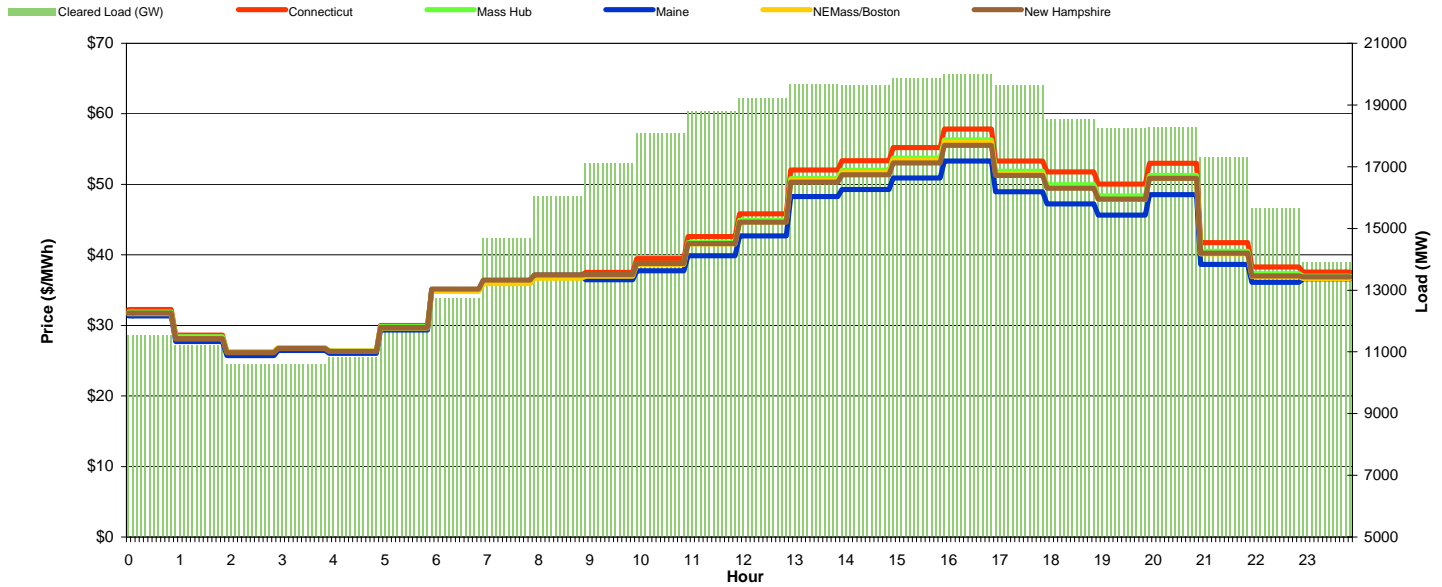

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	32.79	32.08	29.09	28.94	28.16	32.07	30.50	30.98	30.88	32.23	35.15	37.96	37.95	40.36	39.79	39.20	43.89	49.42	50.51	42.72	44.36	39.07	33.47	32.39	36.42	39.25	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	32.19	31.68	28.91	28.84	28.20	31.77	30.31	30.74	30.51	31.73	34.30	36.81	36.72	38.93	38.55	38.02	42.44	47.53	48.24	40.86	42.66	37.45	32.26	31.75	35.48	37.98		
<b>New Hampshire</b>	31.97	31.49	28.73	28.70	28.07	31.69	30.37	30.83	30.54	31.80	34.42	36.88	36.73	38.83	38.39	37.79	42.10	47.15	47.96	40.77	42.60	37.38	32.17	31.69	35.38	37.90		
<b>Maine</b>	30.92	30.74	28.07	28.30	27.72	31.04	30.11	30.39	29.91	31.09	33.50	35.68	35.45	37.39	37.01	36.57	40.41	44.91	45.78	39.22	40.94	35.93	31.13	31.25	34.31	36.58		
<b>Mass Hub</b>	32.39	31.82	29.03	28.93	28.25	31.94	30.39	30.78	30.54	31.80	34.46	37.03	36.93	39.17	38.72	38.13	42.59	47.81	48.71	41.27	43.01	37.81	32.55	31.92	35.67	38.21		
<b>DA Forecast Load (GW)</b>	12.21	11.58	11.21	11.12	11.29	11.98	13.38	14.95	16.12	17.05	17.88	18.54	19.08	19.26	19.45	19.50	19.58	19.41	18.95	18.61	18.69	17.77	16.08	14.48				
<b>Forecast Error %</b>	-0.8%	-1.1%	1.3%	0.6%	1.2%	0.6%	-3.3%	-2.5%	-1.2%	-0.7%	-0.5%	-0.9%	-1.8%	-0.3%	-0.1%	0.7%	1.0%	1.5%	1.4%	0.4%	0.8%	0.5%	0.7%	0.0%				

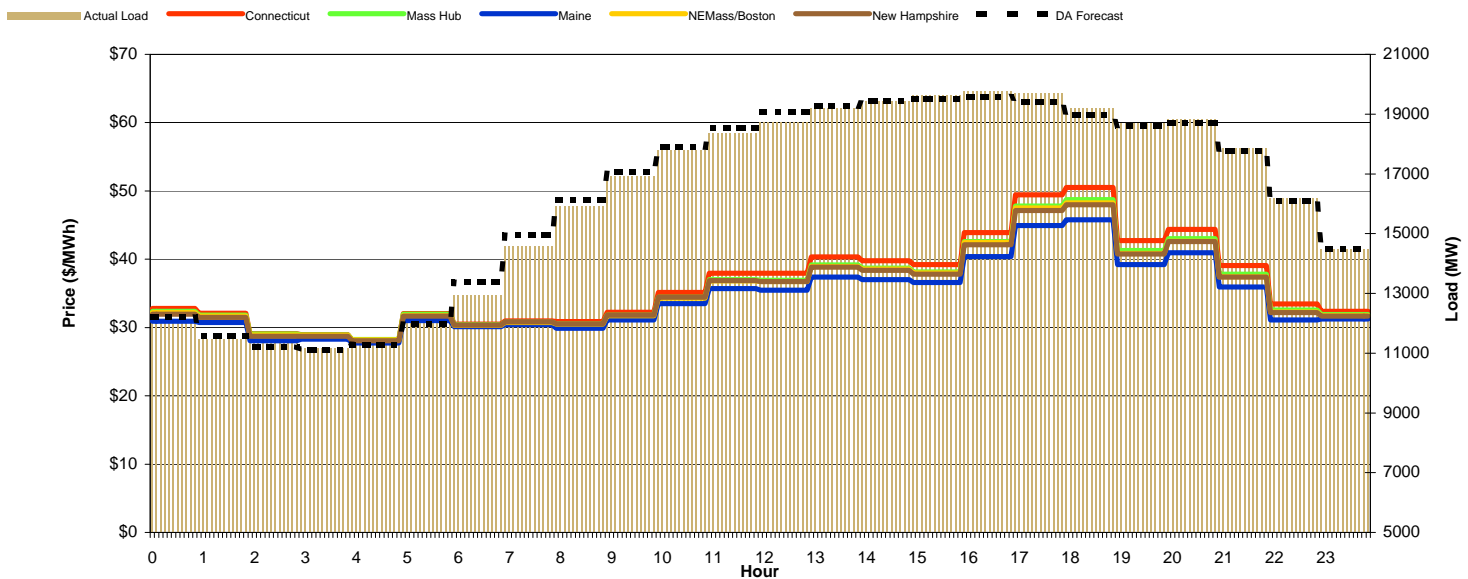




# ISO-NE Daily Report

Thursday August 18, 2011

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	36.61	34.24	31.46	29.55	29.97	31.61	33.73	36.33	36.91	38.65	41.83	49.86	50.57	55.76	50.88	56.76	55.32	51.68	49.78	48.51	53.20	43.33	38.03	36.44	42.54	47.34	All	On Pk
NEMass/Boston	36.00	33.71	31.00	29.33	29.74	31.33	33.75	35.94	36.29	37.84	40.85	48.64	49.50	54.87	50.12	55.56	54.15	50.58	48.39	46.95	51.52	41.69	36.76	35.86	41.68	46.23	41.68	46.23
New Hampshire	36.16	33.92	31.20	29.52	29.97	31.54	33.90	36.21	36.31	37.88	40.95	48.52	49.33	54.57	49.77	55.13	53.73	50.30	48.28	46.90	51.38	41.74	36.84	36.01	41.67	46.12	41.67	46.12
Maine	35.47	33.41	30.72	29.23	29.73	31.25	33.42	35.30	35.11	36.68	39.36	46.11	46.90	52.09	47.60	52.49	51.21	48.19	46.44	45.20	49.12	40.15	35.95	35.65	40.28	44.24	40.28	44.24
Mass Hub	36.31	34.14	31.41	29.65	30.07	31.63	33.95	36.11	36.50	38.08	41.11	48.90	49.63	55.11	50.26	55.74	54.37	50.86	48.80	47.40	52.10	42.21	37.08	36.12	41.98	46.52	41.98	46.52
Cleared Load (GW)	12.8	12.9	12.3	12.1	12.2	12.5	13.5	15.1	16.4	17.5	18.5	18.9	19.4	19.9	20.0	19.8	19.8	19.3	18.8	18.5	18.6	17.5	15.8	14.2				

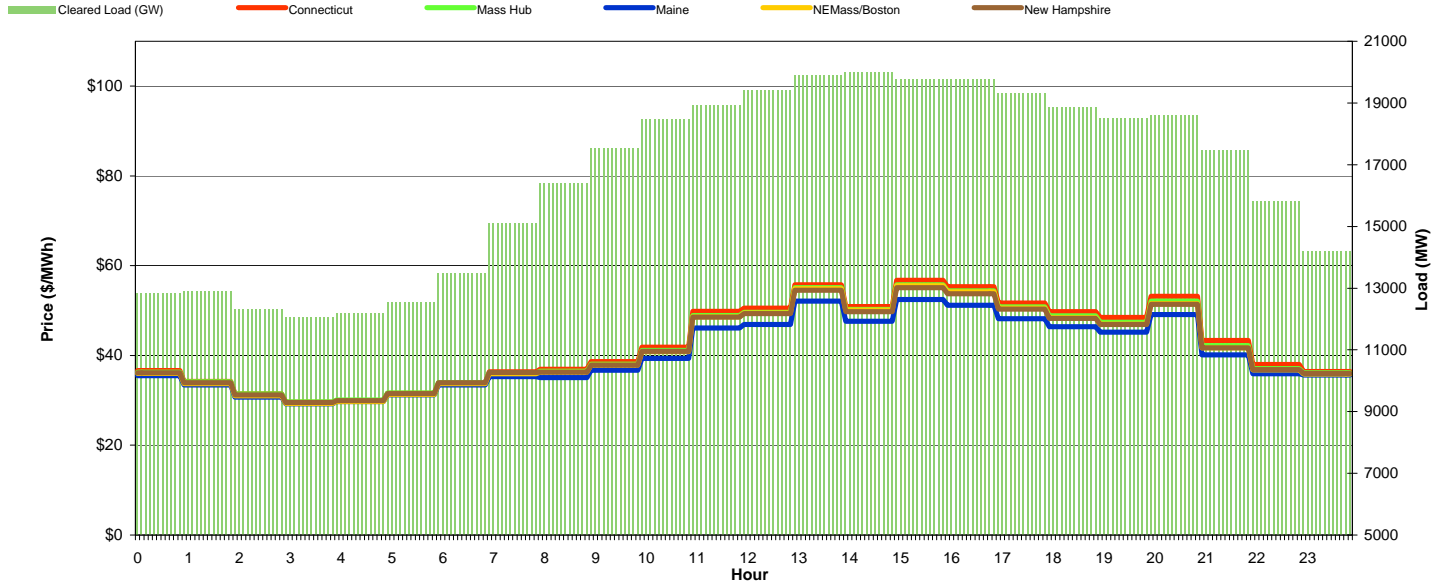

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	32.55	35.63	32.35	31.41	31.13	33.10	33.97	34.32	37.77	42.14	54.65	59.15	58.97	72.04	71.63	68.73	71.41	104.84	69.95	56.36	80.83	58.86	35.61	34.50	51.75	61.08	All	On Pk
NEMass/Boston	32.11	35.06	31.91	31.04	30.91	32.80	33.69	33.75	37.13	40.95	52.94	57.55	57.75	70.86	70.25	67.33	69.86	102.41	68.27	54.83	78.73	56.62	34.47	34.06	50.64	59.61	50.64	59.61
New Hampshire	32.18	35.22	32.06	31.20	31.07	32.90	33.67	33.78	37.12	40.97	52.86	57.28	57.36	70.26	69.59	66.74	69.24	101.58	67.85	54.62	78.55	56.50	34.37	33.99	50.46	59.29	50.46	59.29
Maine	31.85	34.85	31.62	30.89	30.86	32.48	32.91	32.81	36.03	39.35	50.19	54.29	54.39	66.77	65.88	63.26	65.58	96.01	64.09	51.59	74.29	53.20	32.77	32.95	48.29	56.28	48.29	56.28
Mass Hub	32.31	35.44	32.29	31.38	31.20	33.03	33.83	33.92	37.31	41.22	53.26	57.78	57.79	70.77	70.18	67.27	69.86	102.57	68.54	55.15	79.17	57.17	34.74	34.22	50.85	59.79	50.85	59.79
DA Forecast Load (GW)	13.12	12.40	11.96	11.77	11.96	12.71	14.11	15.76	17.05	18.06	18.97	19.58	19.96	20.33	20.42	20.44	20.45	20.17	19.62	19.20	19.23	18.35	16.73	15.08				
Forecast Error %	2.1%	8.0%	9.2%	8.8%	8.0%	2.4%	-2.9%	-2.1%	-1.4%	-0.4%	0.3%	0.9%	0.9%	1.0%	1.7%	2.0%	2.3%	2.4%	2.2%	1.9%	2.8%	2.7%	2.7%	2.8%				

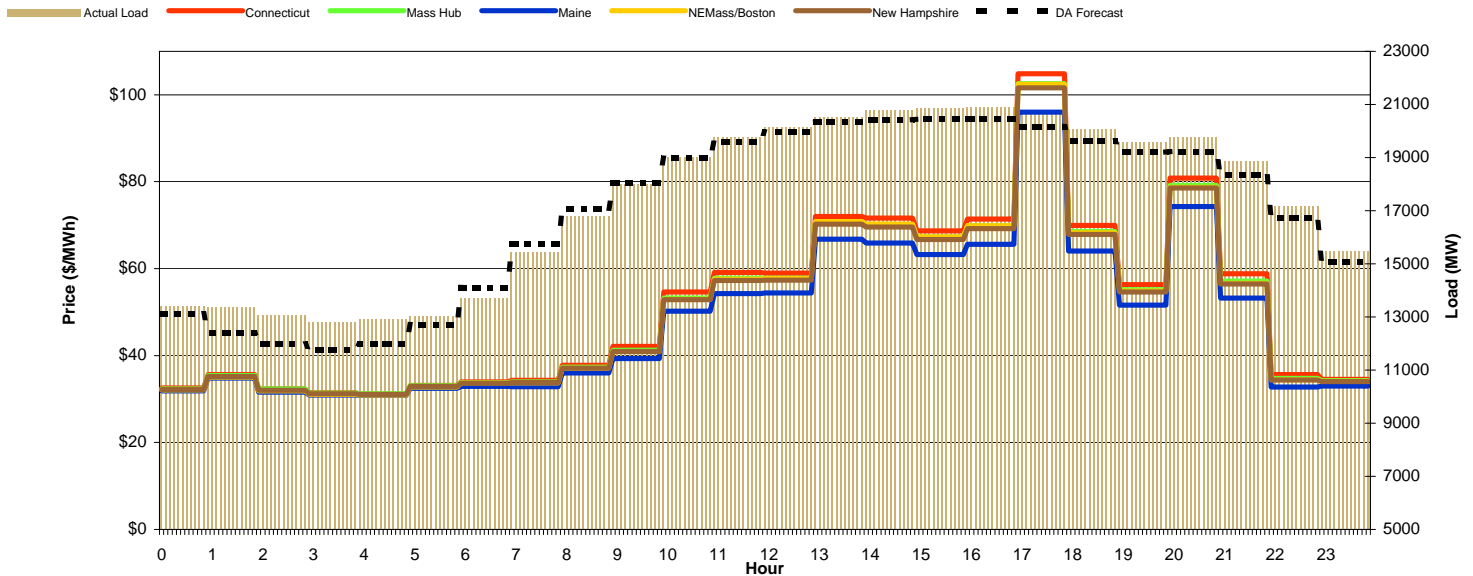




# ISO-NE Daily Report

Friday August 19, 2011

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	35.78	36.49	34.16	33.02	33.09	36.39	36.64	37.58	40.51	46.54	60.57	61.61	61.60	62.72	65.63	65.24	64.02	61.16	53.13	50.46	51.04	42.00	38.23	37.13	47.70	53.88	All	On Pk
NEMass/Boston	34.85	35.97	33.57	32.53	32.56	35.95	36.46	36.68	39.29	44.83	58.14	59.61	59.71	60.99	63.80	63.05	61.70	58.96	51.26	48.45	49.29	40.32	36.75	36.30	46.29	52.05	47.70	53.88
New Hampshire	34.90	36.05	33.75	32.73	32.74	36.11	36.72	36.76	39.24	44.84	57.85	59.22	59.24	60.54	63.21	62.34	61.27	58.73	51.12	48.45	49.20	40.41	36.82	36.48	46.20	51.83	46.29	52.05
Maine	33.80	34.81	32.61	31.79	31.67	34.91	35.98	35.56	37.75	42.79	54.49	55.87	56.00	57.74	59.82	58.68	57.98	55.83	48.54	46.03	46.77	38.96	35.80	36.14	44.18	49.29	46.20	51.83
Mass Hub	35.34	36.49	34.09	32.98	33.04	36.43	36.70	37.30	39.82	45.46	59.02	60.45	60.30	61.57	64.37	63.68	62.10	59.44	51.71	48.92	49.82	40.82	37.24	36.60	46.82	52.63	46.82	52.63
Cleared Load (GW)	13.3	13.2	12.9	12.6	12.7	13.4	14.1	15.7	16.7	17.7	18.3	19.1	19.3	19.7	19.8	19.5	19.4	18.9	18.5	18.1	18.1	17.1	15.7	13.9				

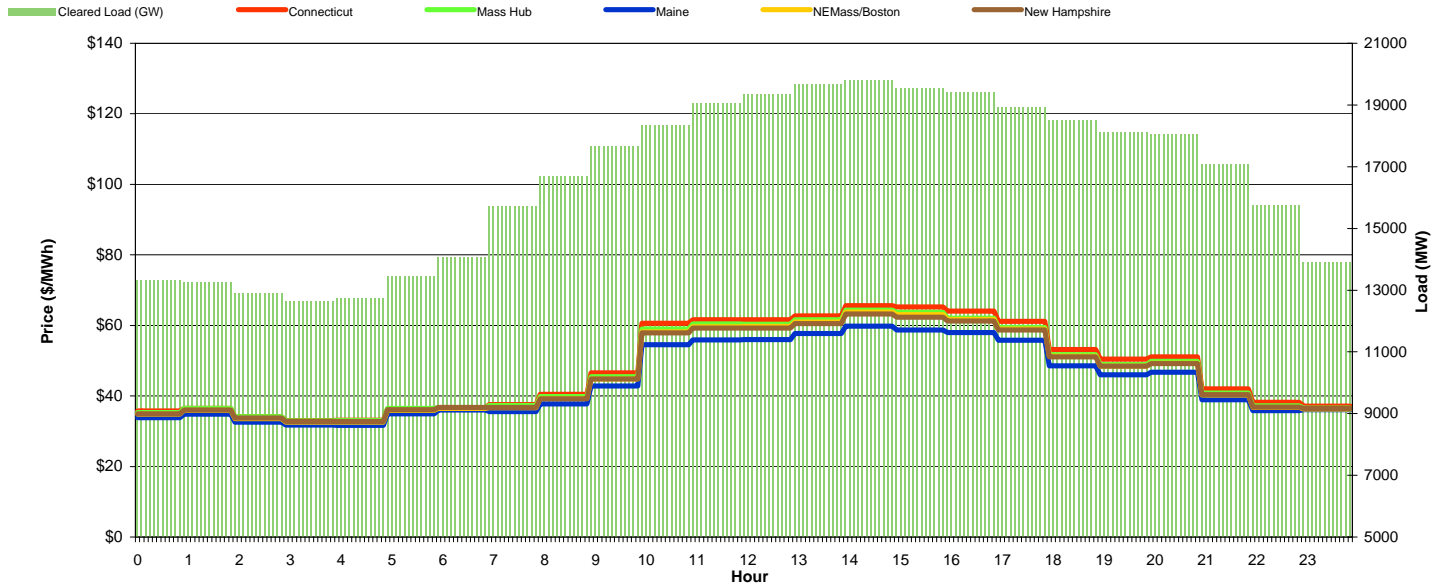

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	43.14	51.05	43.01	37.21	37.74	40.04	36.94	37.80	45.23	65.36	69.08	85.29	131.29	76.51	72.41	66.18	68.32	83.72	46.86	52.80	45.00	39.64	36.25	37.25	56.17	63.86	All	On Pk
NEMass/Boston	42.06	49.70	42.18	36.74	37.28	39.64	36.66	36.96	43.79	63.27	67.78	84.35	130.62	76.43	71.81	64.77	66.32	81.28	45.32	51.07	43.59	38.35	35.12	36.64	55.07	62.55	56.17	63.86
New Hampshire	42.03	49.61	42.22	36.85	37.37	39.72	36.75	36.99	43.74	63.15	67.55	83.97	129.70	75.77	71.22	64.37	66.00	81.18	45.34	51.05	43.63	38.34	35.04	36.62	54.93	62.32	54.93	62.32
Maine	40.51	47.34	40.45	35.86	36.27	38.74	36.18	36.07	42.02	60.41	64.58	80.20	124.50	72.70	67.62	60.78	62.17	76.58	42.95	48.38	41.60	36.57	33.60	35.77	52.58	59.42	52.58	59.42
Mass Hub	42.59	50.49	42.79	37.21	37.75	40.06	36.86	37.18	44.19	63.85	67.94	84.12	129.60	75.81	71.38	64.67	66.56	81.55	45.53	51.35	43.85	38.64	35.39	36.85	55.26	62.60	55.26	62.60
DA Forecast Load (GW)	14.15	13.38	12.86	12.60	12.69	13.38	14.60	16.30	17.61	18.58	19.49	20.11	20.43	20.77	20.94	21.00	20.86	20.49	19.80	19.21	19.15	18.32	16.90	15.32				
Forecast Error %	5.9%	8.8%	10.7%	10.8%	10.8%	8.7%	3.5%	-0.1%	-0.1%	1.3%	2.2%	3.0%	3.8%	4.2%	3.4%	1.4%	-0.1%	-0.7%	-0.9%	0.2%	0.0%	-0.8%	-0.8%	0.1%				

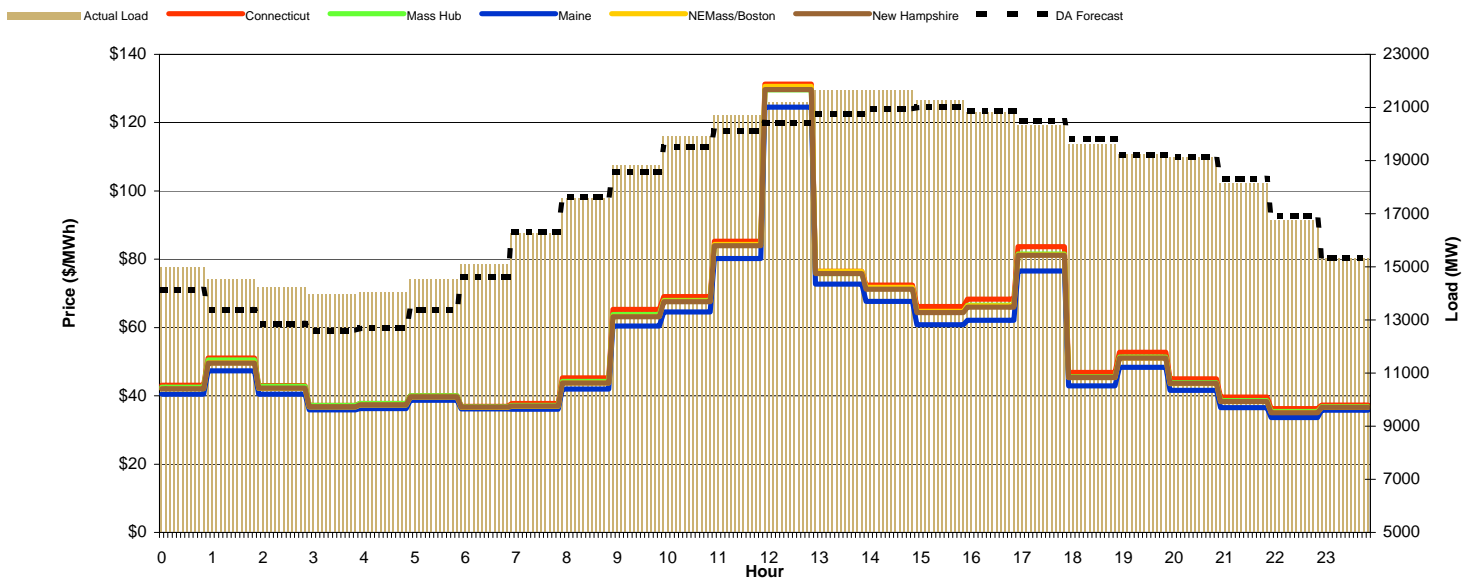




# ISO-NE Daily Report

Saturday August 20, 2011

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	39.91	37.18	37.26	34.62	34.27	35.18	34.64	35.40	37.01	41.34	47.13	58.46	61.00	61.18	58.55	60.17	60.30	58.28	57.12	49.72	53.95	43.97	40.56	37.54	46.45	51.51	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	39.31	37.05	37.00	34.48	34.11	35.00	34.70	35.49	36.75	40.37	45.63	56.56	58.91	59.13	56.64	58.43	58.49	56.30	55.00	48.08	52.15	42.58	39.61	36.92	45.36	50.01		
<b>New Hampshire</b>	39.32	37.13	37.08	34.60	34.20	35.11	34.89	35.59	36.91	40.46	45.82	56.77	58.97	59.13	56.59	58.34	58.46	56.41	55.28	48.34	52.38	42.75	39.45	36.73	45.45	50.10		
<b>Maine</b>	38.77	36.64	36.45	33.96	33.48	34.43	34.66	35.59	36.75	39.58	44.43	54.84	57.17	57.13	54.60	56.36	56.48	54.36	53.25	46.95	50.67	41.51	38.20	35.89	44.26	48.62		
<b>Mass Hub</b>	39.63	37.28	37.38	34.79	34.38	35.35	34.85	35.58	36.91	40.78	46.19	57.25	59.46	59.65	57.17	59.00	59.02	57.02	55.64	48.71	52.85	43.10	40.00	37.13	45.80	50.52		
<b>Cleared Load (GW)</b>	13.7	13.1	12.9	12.5	12.4	12.5	12.5	12.9	14.7	16.1	17.2	17.5	17.8	18.0	18.1	18.5	18.5	17.9	17.3	17.3	17.4	16.4	15.2	14.0				

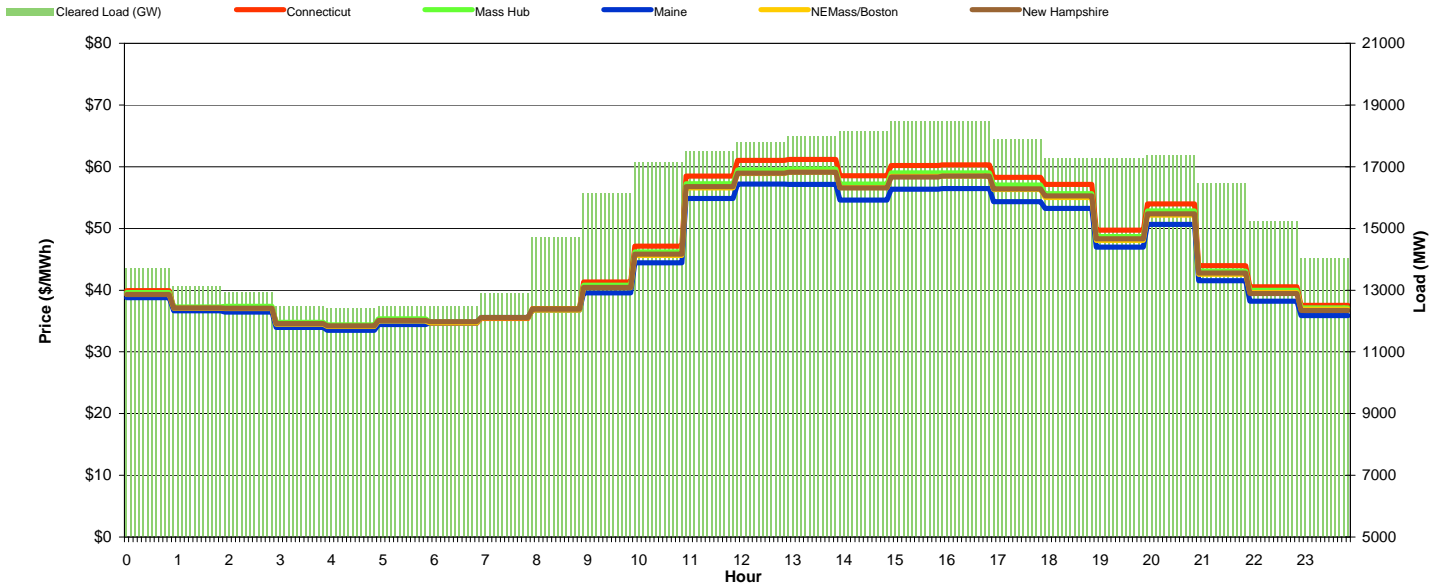

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	47.92	60.31	45.94	42.37	37.35	43.38	34.30	32.93	32.62	36.40	49.12	53.89	67.12	48.56	44.40	50.80	58.21	69.56	62.00	55.62	47.52	38.39	38.37	37.69	47.28	49.09	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	46.99	59.91	45.86	42.28	37.49	43.42	34.45	33.13	32.43	35.77	47.88	52.63	65.33	47.43	43.43	49.59	56.76	67.66	60.20	54.14	46.44	37.48	37.46	36.86	46.46	47.99		
<b>New Hampshire</b>	47.08	59.96	45.91	42.31	37.55	43.47	34.35	33.03	32.48	35.97	48.12	52.88	65.51	47.46	43.43	49.56	56.79	67.86	60.55	54.51	46.76	37.67	37.60	36.78	46.57	48.14		
<b>Maine</b>	46.07	58.62	44.77	41.33	37.01	42.73	33.75	32.54	32.11	35.46	46.94	51.60	63.74	46.01	42.10	48.01	55.13	65.68	58.63	53.12	45.70	36.90	37.05	35.68	45.45	46.92		
<b>Mass Hub</b>	47.36	60.24	46.18	42.58	37.69	43.67	34.54	33.09	32.41	35.86	48.12	52.78	65.51	47.48	43.42	49.57	56.75	67.73	60.41	54.38	46.55	37.60	37.65	37.13	46.61	48.08		
<b>DA Forecast Load (GW)</b>	14.04	13.23	12.70	12.36	12.23	12.42	12.75	13.99	15.54	16.86	17.84	18.47	18.87	19.02	19.15	19.25	19.29	19.25	18.83	18.46	18.51	17.84	16.56	15.15				
<b>Forecast Error %</b>	4.4%	9.0%	12.0%	12.8%	13.3%	13.1%	9.9%	2.6%	-0.5%	-1.5%	-1.7%	-1.2%	-0.6%	0.2%	0.5%	0.7%	1.2%	1.1%	0.9%	0.1%	0.3%	-0.7%	0.2%	2.2%				

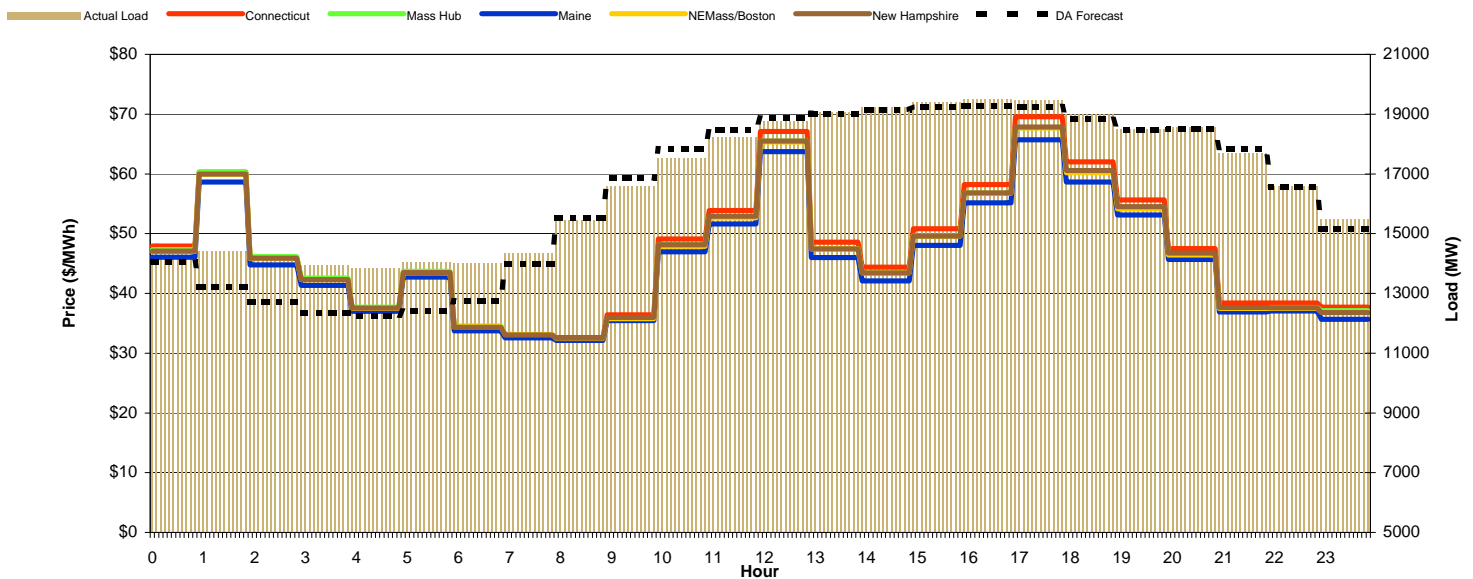




# ISO-NE Daily Report

Sunday August 21, 2011

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	36.51	36.35	36.35	34.11	33.35	33.32	32.62	34.77	37.08	38.49	41.75	43.14	54.75	54.46	57.18	57.72	59.23	54.54	52.32	52.38	53.55	42.00	39.78	38.43	43.92	48.32	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	35.70	35.86	35.91	33.78	33.06	33.06	32.56	34.39	36.63	37.62	40.42	41.74	52.60	52.38	54.94	55.39	56.80	52.39	50.34	50.33	51.55	40.56	38.76	37.66	42.68	46.68		
<b>New Hampshire</b>	35.68	35.84	35.85	33.76	33.06	33.06	32.59	34.33	36.70	37.71	40.47	41.92	52.73	52.42	54.97	55.30	56.73	52.43	50.53	50.55	51.62	40.64	38.62	37.72	42.72	46.73		
<b>Maine</b>	34.71	34.71	34.35	32.70	32.05	32.08	32.03	33.71	36.26	37.35	39.23	40.76	50.92	50.50	53.03	53.07	54.70	50.31	48.86	49.04	50.00	39.54	37.76	37.28	41.46	45.32		
<b>Mass Hub</b>	36.13	36.24	36.40	34.21	33.50	33.48	32.83	34.65	36.81	38.00	41.00	42.37	53.28	52.95	55.56	56.00	57.39	52.97	51.00	51.00	52.22	41.11	39.09	37.95	43.17	47.21		
<b>Cleared Load (GW)</b>	14.1	13.4	13.3	12.8	12.6	12.7	12.4	13.0	14.1	15.8	16.9	17.8	18.1	18.3	18.4	18.4	18.6	18.5	18.2	18.0	18.1	17.3	15.9	14.3				

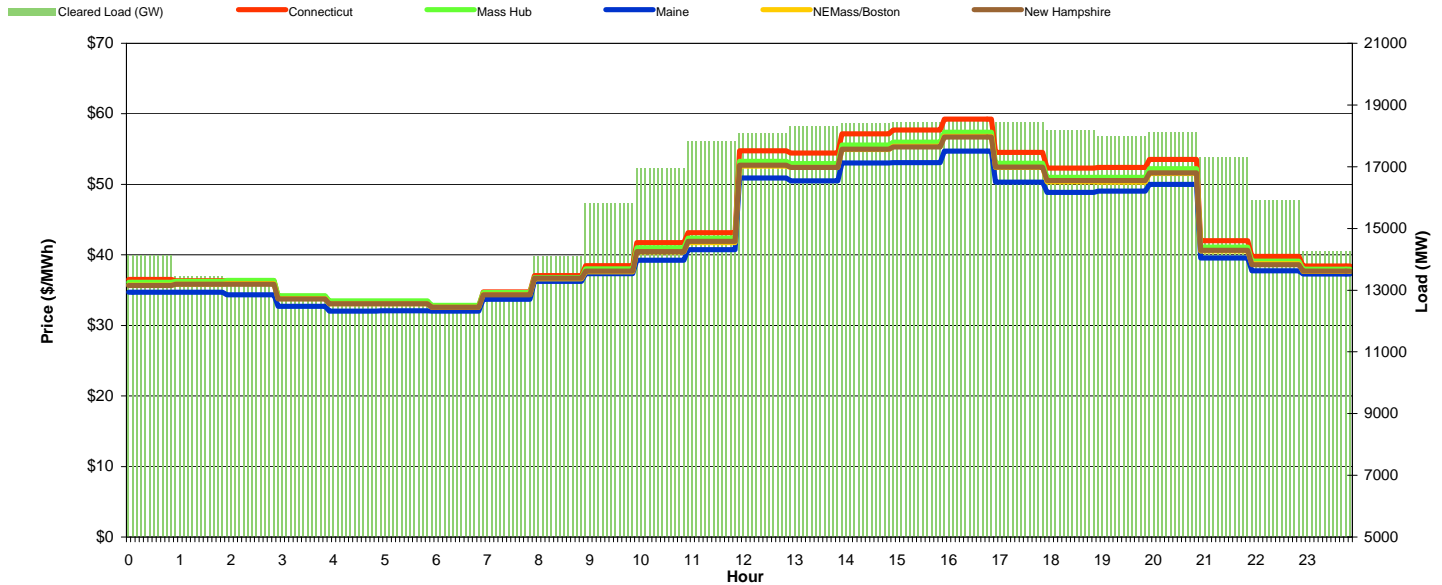

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$				
<b>Connecticut</b>	37.30	34.82	34.06	32.86	31.90	32.60	31.55	31.23	34.00	33.24	36.13	46.75	59.85	61.14	48.42	49.53	52.69	60.53	56.53	49.96	50.66	37.39	37.91	37.09	42.42	46.62	<b>All</b>	<b>On Pk</b>	
<b>NEMass/Boston</b>	36.71	34.58	33.91	32.78	31.81	32.53	31.54	31.29	33.87	32.78	35.44	45.92	58.76	60.08	47.62	48.56	51.71	60.05	55.85	48.98	49.62	36.67	37.26	36.81	41.88	45.90			
<b>New Hampshire</b>	36.65	34.54	33.82	32.69	31.70	32.47	31.44	31.21	34.02	33.08	35.70	46.13	58.91	60.20	47.67	48.70	51.66	59.73	55.67	48.94	49.51	36.55	36.99	36.55	41.86	45.92			
<b>Maine</b>	35.83	33.82	33.06	31.98	31.02	31.85	31.12	31.12	34.03	33.22	35.23	45.46	57.86	59.05	46.50	47.47	50.16	57.90	54.16	47.76	48.23	35.70	36.32	35.98	41.03	45.01			
<b>Mass Hub</b>	36.96	34.79	34.17	33.04	32.04	32.78	31.66	31.28	33.89	32.85	35.52	45.99	58.73	60.02	47.55	48.52	51.60	59.55	55.60	48.99	49.63	36.67	37.27	36.81	41.91	45.85			
<b>DA Forecast Load (GW)</b>	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
<b>Forecast Error %</b>	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!		

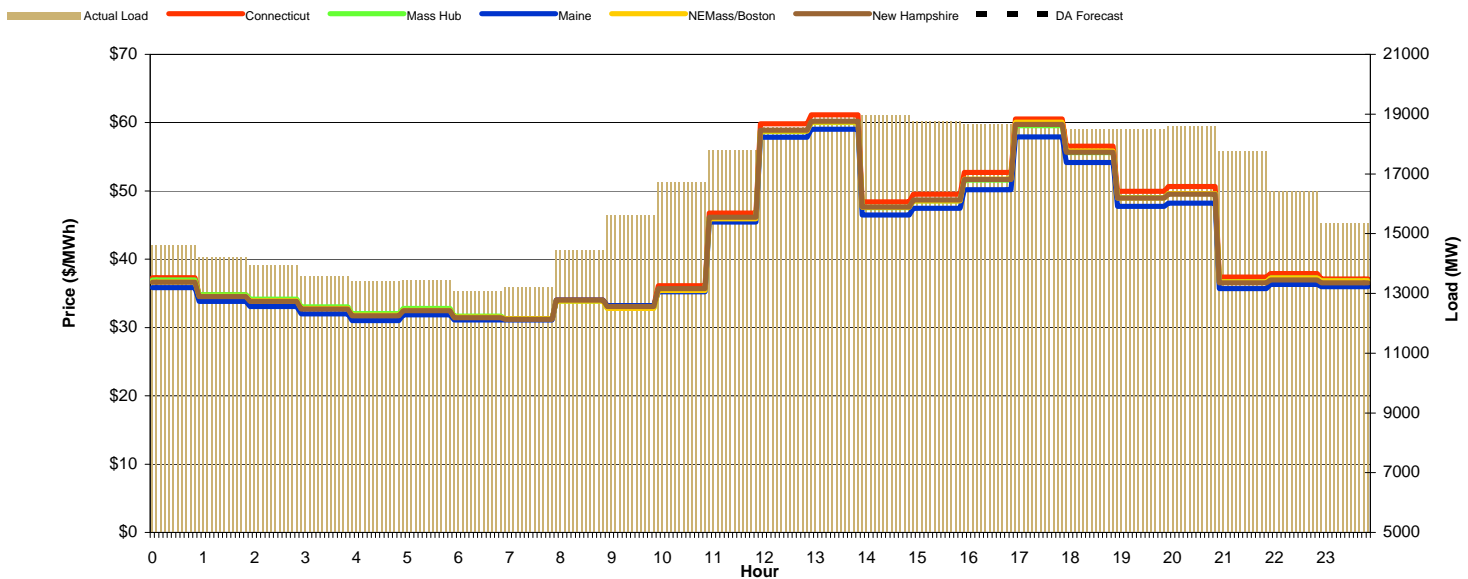




# ISO-NE Daily Report

Monday August 22, 2011

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$	
<b>Connecticut</b>	35.29	34.91	35.97	33.79	34.17	37.10	37.44	39.16	41.00	43.37	45.96	52.69	52.25	53.77	52.65	55.88	54.24	51.46	45.84	42.66	41.35	40.00	37.34	37.49	43.16	46.85
<b>NEMass/Boston</b>	34.98	35.07	36.01	33.89	34.31	37.27	37.88	38.83	40.36	42.53	44.75	51.22	50.62	52.11	51.01	53.98	52.46	49.77	44.53	41.58	40.43	39.23	36.99	37.51	42.39	45.65
<b>New Hampshire</b>	34.93	35.12	35.99	33.96	34.38	37.34	38.01	39.05	40.54	42.74	45.03	51.42	50.80	52.28	51.11	54.10	52.59	49.87	44.67	41.77	40.65	39.24	36.90	37.44	42.50	45.80
<b>Maine</b>	34.37	34.63	35.29	33.49	33.83	36.93	37.82	38.78	39.89	41.85	43.90	49.68	49.16	50.85	49.53	52.51	50.89	48.07	43.33	40.75	39.89	38.42	36.34	37.13	41.56	44.62
<b>Mass Hub</b>	35.18	35.12	36.23	34.07	34.45	37.39	37.83	38.97	40.58	42.81	45.06	51.61	50.80	52.14	51.17	54.12	52.66	50.15	44.84	41.86	40.69	39.33	36.96	37.41	42.56	45.86
<b>Cleared Load (GW)</b>	13.4	13.0	13.1	12.7	12.9	13.3	13.8	15.5	16.7	17.7	18.2	18.6	18.6	18.6	18.9	18.8	18.7	18.5	18.1	17.9	17.7	16.6	15.0	13.2		

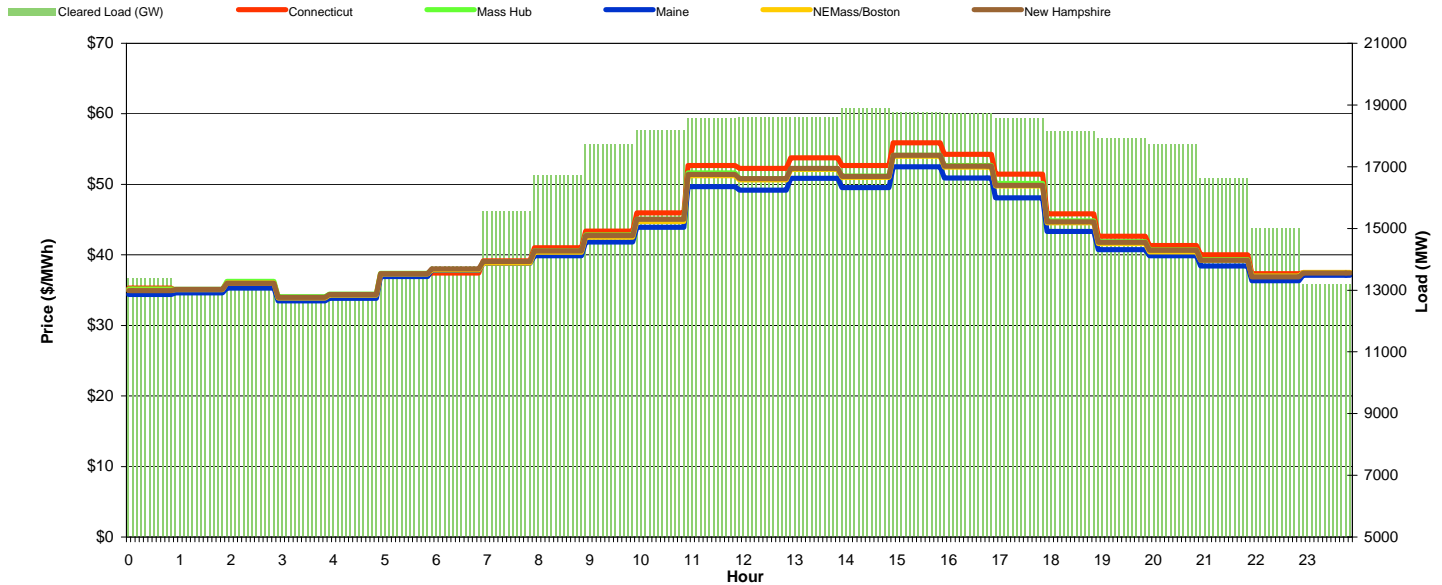

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$	
<b>Connecticut</b>	35.21	34.42	34.49	31.95	32.95	35.92	35.48	33.80	32.62	33.79	35.33	41.58	51.84	44.16	36.70	39.37	37.40	35.05	32.57	32.01	33.04	32.26	32.55	31.62	35.67	36.50
<b>NEMass/Boston</b>	34.97	34.50	34.63	32.07	33.17	36.18	35.72	33.60	32.41	33.60	35.04	41.04	50.96	43.22	35.89	38.36	36.51	34.45	32.13	31.63	32.56	31.78	32.39	31.76	35.36	35.97
<b>New Hampshire</b>	34.81	34.40	34.57	31.99	33.10	36.10	35.55	33.58	32.47	33.67	35.12	41.07	50.85	43.10	35.87	38.33	36.50	34.54	32.16	31.65	32.63	31.69	32.21	31.56	35.31	35.97
<b>Maine</b>	34.24	33.84	34.00	31.48	32.65	35.68	34.95	33.20	32.12	33.18	34.43	40.26	49.30	41.97	34.97	37.44	35.55	33.83	31.48	31.04	31.91	30.81	31.47	31.00	34.62	35.19
<b>Mass Hub</b>	35.03	34.46	34.62	32.08	33.15	36.12	35.54	33.50	32.29	33.44	34.88	40.91	50.85	43.17	35.88	38.39	36.51	34.35	32.03	31.54	32.55	31.76	32.26	31.59	35.29	35.89
<b>DA Forecast Load (GW)</b>	14.01	13.26	12.77	12.57	12.72	13.49	14.73	16.34	17.46	18.31	18.94	19.29	19.38	19.41	19.24	19.01	18.86	18.67	18.20	17.82	17.80	16.73	15.17	13.62		
<b>Forecast Error %</b>	4.2%	6.8%	9.6%	10.1%	9.7%	8.1%	1.0%	-2.1%	-3.2%	-3.4%	-3.5%	-3.5%	-3.3%	-2.9%	-2.0%	-1.2%	-1.0%	-1.1%	-1.7%	-2.1%	-1.5%	-1.4%	-1.6%	-1.7%		

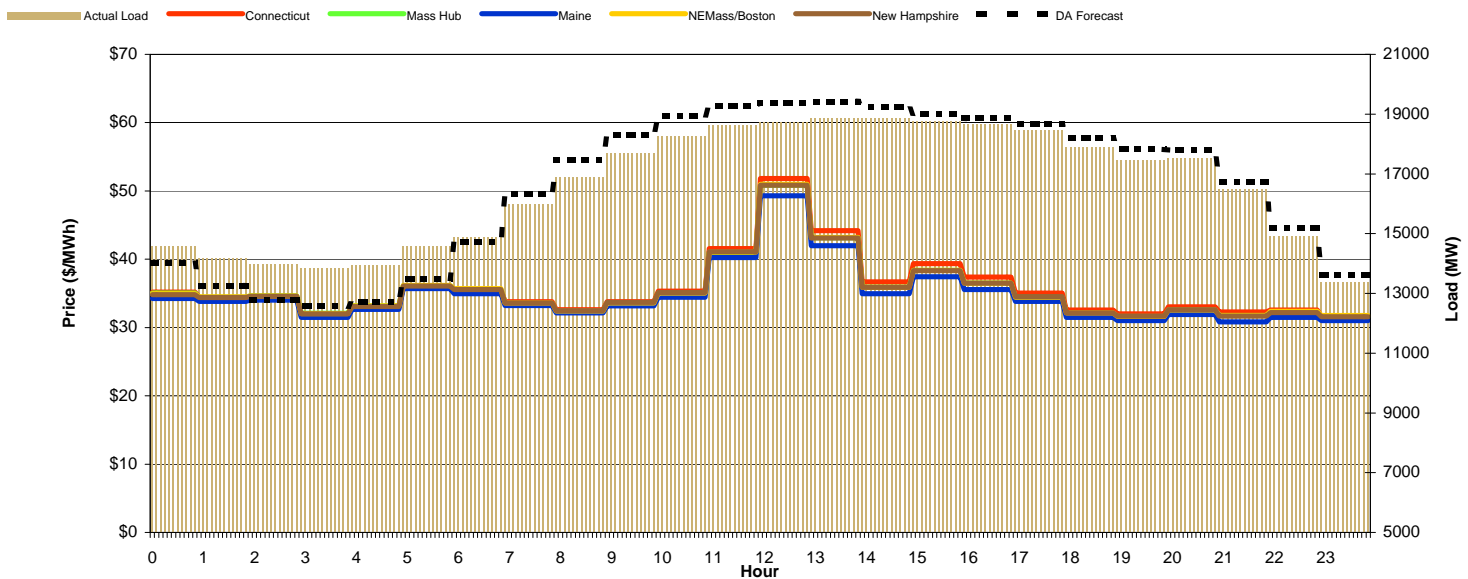




# ISO-NE Daily Report

Tuesday August 23, 2011

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	31.53	27.74	26.17	25.97	26.37	28.61	31.75	35.89	37.17	38.72	40.43	40.53	42.90	45.94	46.72	47.20	48.34	46.89	39.37	39.25	37.68	37.79	37.07	35.59	37.32	41.37	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	31.43	27.68	26.45	26.25	26.66	28.70	31.94	35.92	36.61	37.94	39.33	39.53	41.77	44.69	45.39	45.84	46.23	44.76	38.28	38.28	36.75	36.80	36.50	34.96	36.61	40.29		
<b>New Hampshire</b>	31.39	27.64	26.31	26.15	26.58	28.75	32.15	36.04	36.84	38.15	39.61	39.87	42.08	45.01	45.63	46.02	46.41	45.01	38.58	38.51	37.00	36.89	36.71	35.07	36.77	40.52		
<b>Maine</b>	31.04	27.24	26.04	25.97	26.44	28.49	32.09	35.45	36.25	37.60	38.68	39.12	41.17	44.10	44.52	44.88	45.19	43.80	38.03	37.85	36.47	36.13	36.03	34.47	36.13	39.70		
<b>Mass Hub</b>	31.51	27.82	26.44	26.24	26.67	28.78	31.92	35.98	36.89	38.26	39.60	39.89	42.15	45.04	45.75	46.24	46.58	45.15	38.67	38.69	37.16	37.23	36.81	35.11	36.86	40.63		
<b>Cleared Load (GW)</b>	11.7	11.4	11.2	11.0	11.2	11.8	12.6	14.3	15.5	16.4	16.8	17.5	17.7	17.9	17.9	18.0	17.7	17.4	17.3	17.2	16.1	14.6	12.6					

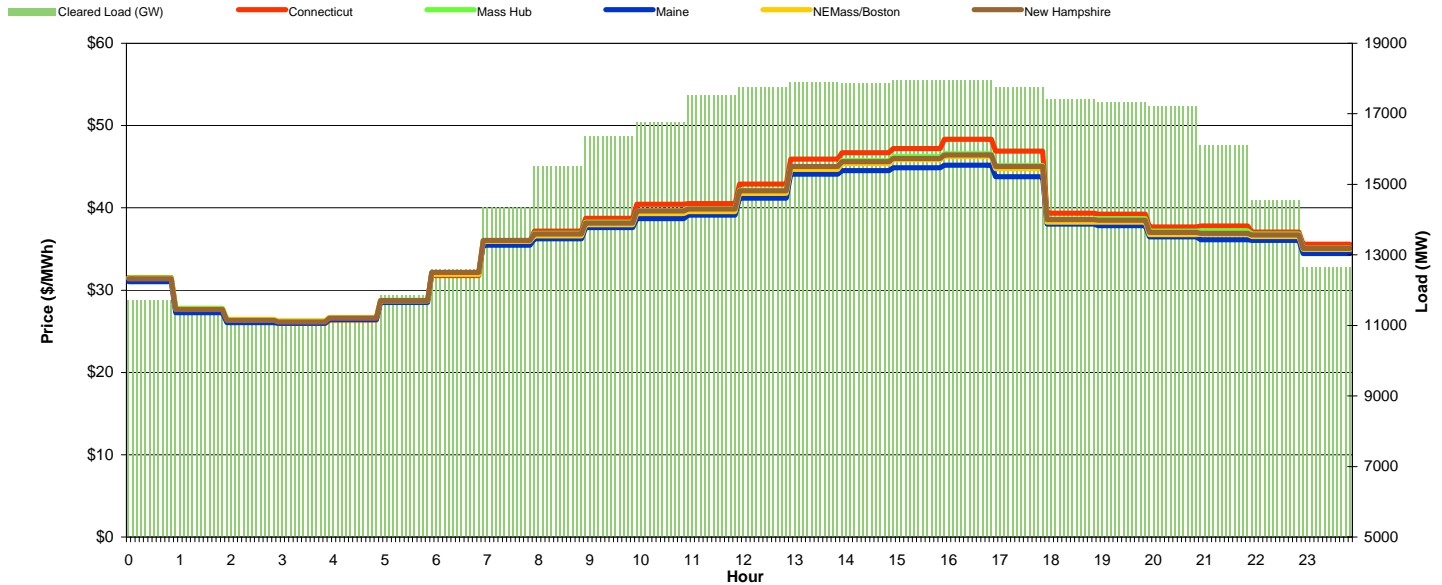

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	29.24	26.95	27.30	31.40	32.38	32.53	30.52	32.43	32.74	31.83	32.89	32.20	32.85	37.36	38.18	37.21	37.06	37.11	35.81	32.68	33.63	32.41	32.84	32.37	33.00	34.33	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	29.38	27.09	27.46	31.51	32.57	32.65	30.62	32.40	32.41	31.32	32.27	31.66	32.21	36.41	37.03	36.11	35.96	35.94	34.61	31.95	32.78	31.59	32.42	32.34	32.53	33.57		
<b>New Hampshire</b>	29.13	26.87	27.23	31.29	32.39	32.44	30.54	32.33	32.50	31.51	32.50	31.88	32.44	36.65	37.17	36.23	36.05	36.08	34.82	32.18	33.02	31.71	32.42	32.28	32.57	33.72		
<b>Maine</b>	28.49	26.22	26.71	30.81	32.04	31.78	30.22	31.76	31.94	30.96	31.74	31.12	31.66	35.73	36.10	35.05	34.96	35.09	33.88	31.60	32.33	30.92	31.71	31.94	31.87	32.91		
<b>Mass Hub</b>	29.28	27.06	27.42	31.48	32.52	32.62	30.52	32.34	32.45	31.40	32.37	31.70	32.29	36.57	37.24	36.30	36.14	36.14	34.84	32.08	32.94	31.75	32.47	32.30	32.59	33.69		
<b>DA Forecast Load (GW)</b>	12.20	11.53	11.13	10.98	11.15	11.84	13.13	14.56	15.58	16.29	16.95	17.39	17.60	17.81	17.82	17.71	17.64	17.51	17.05	16.92	17.03	16.09	14.57	13.11				
<b>Forecast Error %</b>	0.4%	4.3%	4.7%	4.3%	4.1%	3.6%	-1.9%	-1.4%	-0.6%	0.2%	0.2%	0.2%	-0.1%	0.2%	0.4%	0.9%	1.2%	1.2%	1.2%	0.3%	0.8%	0.6%	0.7%	0.6%				

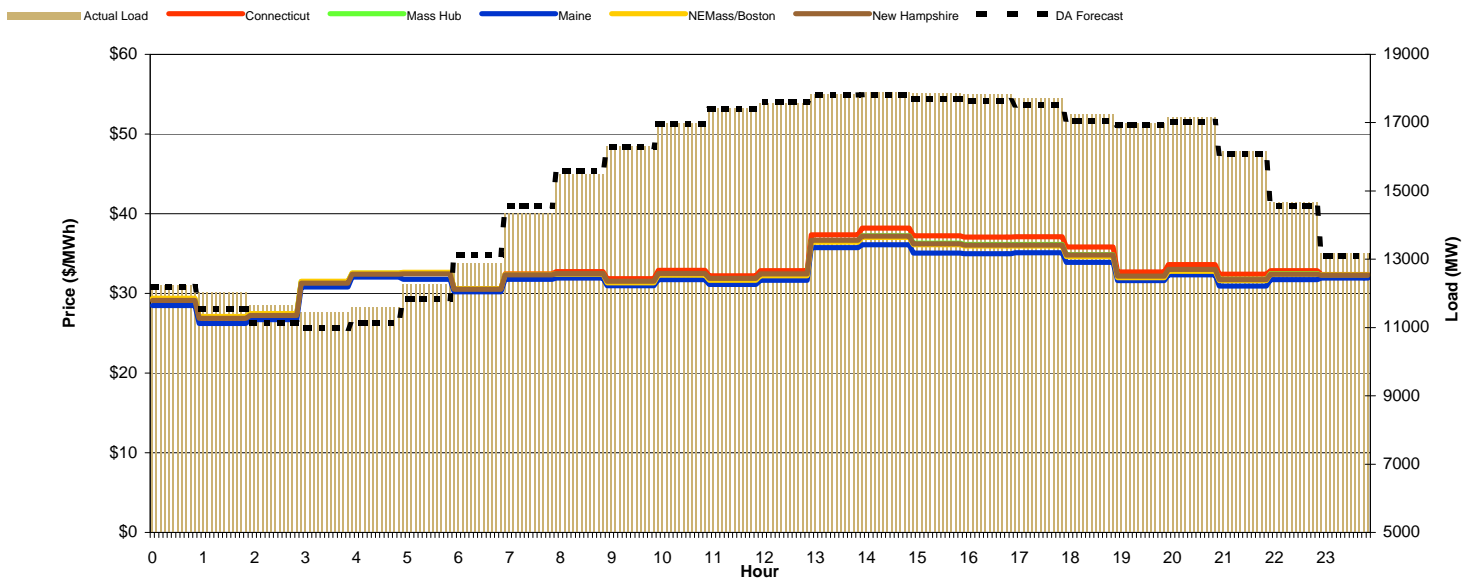




# ISO-NE Daily Report

Wednesday August 24, 2011

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	34.49	29.76	27.41	27.24	27.31	31.47	35.90	36.30	37.33	39.50	42.63	48.18	51.69	49.63	52.91	54.99	55.66	51.97	51.42	48.42	51.35	39.39	38.34	36.79	41.67	46.86	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	33.91	29.50	27.48	27.45	27.49	31.23	35.75	35.96	36.61	38.51	41.42	46.68	50.04	48.31	51.39	53.37	53.95	50.36	49.42	46.80	49.36	38.28	37.33	36.27	40.70	45.49		
<b>New Hampshire</b>	34.07	29.53	27.43	27.45	27.49	31.45	36.10	36.11	36.82	38.74	41.72	46.93	50.04	48.33	51.32	53.27	53.86	50.40	49.55	46.95	49.49	38.32	37.48	36.48	40.81	45.58		
<b>Maine</b>	33.99	29.50	27.37	27.62	27.77	33.38	38.00	35.00	35.87	37.79	40.44	44.97	48.01	46.96	49.41	51.27	51.67	48.45	47.39	44.90	47.17	37.17	36.53	36.17	39.87	43.94		
<b>Mass Hub</b>	34.12	29.62	27.46	27.42	27.44	31.39	35.92	36.22	36.94	38.87	41.84	47.19	50.58	48.60	51.67	53.60	54.16	50.66	49.88	47.25	49.80	38.76	37.87	36.53	40.99	45.87		
<b>Cleared Load (GW)</b>	11.5	11.0	10.5	10.3	10.6	11.2	12.4	14.6	15.6	16.7	17.4	17.9	18.2	18.7	18.6	18.8	18.7	18.5	17.8	17.9	17.7	16.8	15.3	13.3				

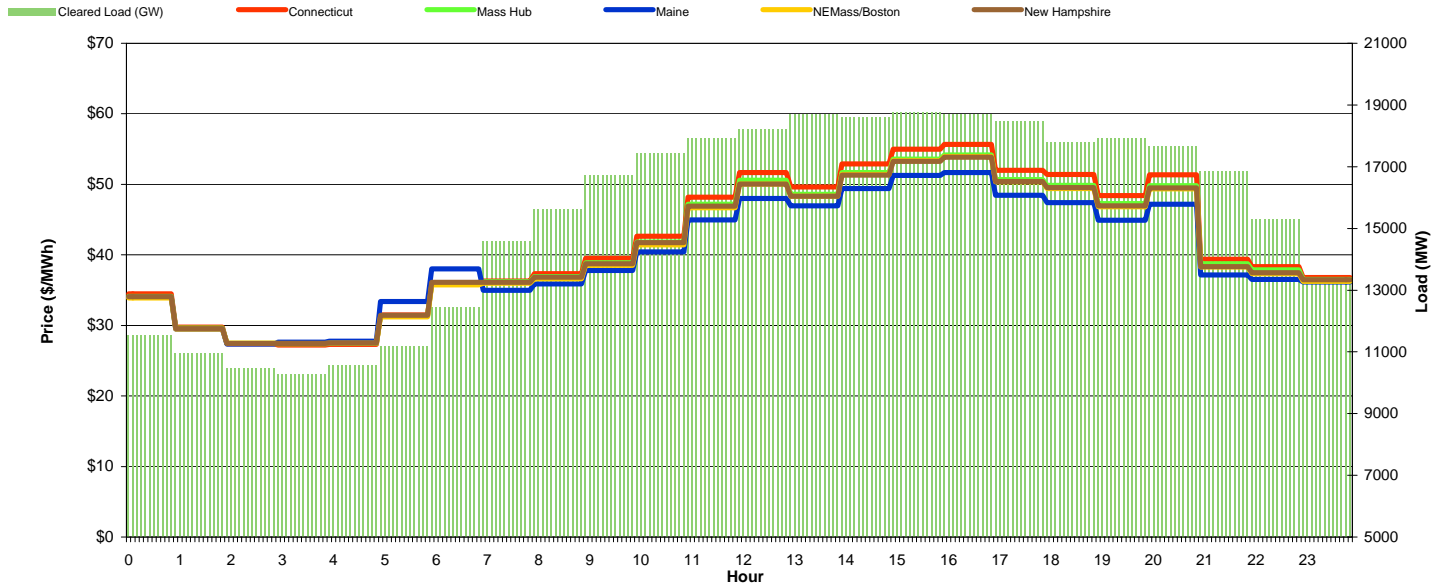

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	34.36	32.31	31.36	30.64	29.21	32.94	33.63	31.91	33.07	33.76	35.23	39.78	38.04	37.08	40.35	39.92	42.98	37.79	33.81	34.05	37.29	32.47	32.07	29.91	34.75	36.23	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	34.44	32.40	31.43	30.75	29.43	33.24	33.75	31.83	32.84	33.33	34.66	38.88	37.16	36.43	39.37	38.85	41.72	36.72	32.98	33.35	36.21	31.85	31.57	29.68	34.29	35.48		
<b>New Hampshire</b>	34.34	32.27	31.32	30.68	29.32	33.16	33.78	31.84	32.99	33.55	34.98	39.17	37.29	36.51	39.46	38.93	41.84	36.89	33.23	33.61	36.49	32.00	31.60	29.64	34.37	35.65		
<b>Maine</b>	34.13	32.22	31.25	30.78	29.49	33.34	33.84	31.20	32.41	32.91	34.19	38.02	36.28	35.74	38.42	37.83	40.59	35.82	32.34	32.74	35.38	31.22	30.78	29.03	33.75	34.74		
<b>Mass Hub</b>	34.43	32.41	31.47	30.77	29.40	33.20	33.75	31.86	32.88	33.37	34.71	38.97	37.24	36.43	39.44	38.96	41.87	36.87	33.10	33.46	36.42	31.95	31.68	29.75	34.35	35.58		
<b>DA Forecast Load (GW)</b>	12.12	11.48	11.07	10.93	11.10	11.82	13.16	14.73	15.82	16.72	17.57	18.18	18.57	18.93	19.10	19.04	19.01	18.83	18.32	17.96	18.03	17.05	15.44	13.90				
<b>Forecast Error %</b>	-0.2%	-0.5%	-0.2%	-0.3%	-0.3%	-0.1%	-1.1%	-0.7%	0.4%	0.3%	-0.5%	-1.0%	-2.0%	-2.4%	-3.1%	-3.0%	-3.0%	-3.6%	-4.0%	-3.3%	-2.2%	-2.0%	-1.2%	-0.8%				

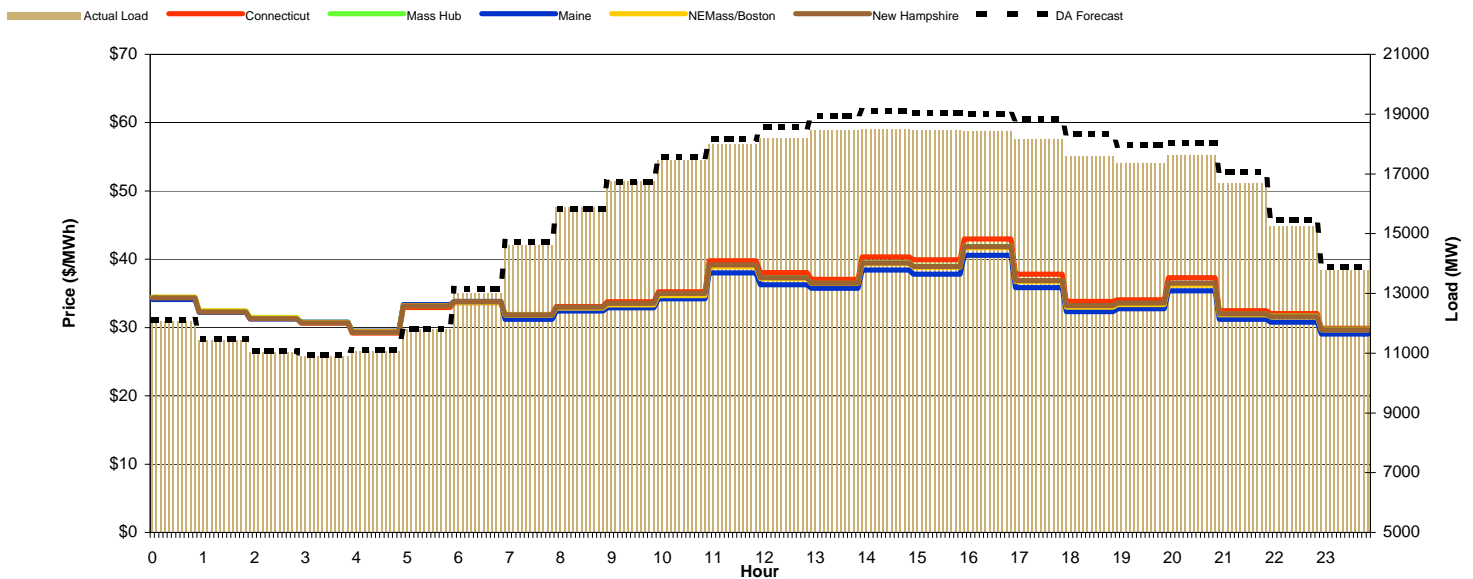






# ISO-NE Daily Report

Thursday August 25, 2011

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	33.68	31.74	31.93	29.64	30.50	32.14	37.20	38.27	40.38	45.80	55.79	58.26	60.70	63.72	68.95	69.38	69.23	61.18	58.61	58.29	58.63	44.15	40.00	37.65	48.16	55.71	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	33.30	31.46	31.31	29.27	30.08	31.74	37.02	37.63	39.57	44.72	54.58	57.03	59.54	62.48	67.00	67.20	67.02	59.36	57.39	56.97	57.31	43.00	39.08	37.09	47.13	54.37		
<b>New Hampshire</b>	33.52	31.62	31.47	29.33	30.15	31.91	37.30	37.78	39.69	44.82	54.63	56.94	59.34	62.12	66.30	66.44	66.31	58.84	57.39	57.07	57.37	43.08	38.97	37.17	47.07	54.19		
<b>Maine</b>	33.08	31.19	30.79	28.61	29.55	31.33	36.99	36.97	38.68	43.07	52.16	54.06	56.23	59.21	62.64	62.47	62.69	55.84	54.95	54.64	55.00	41.41	37.37	36.14	45.21	51.71		
<b>Mass Hub</b>	33.60	31.71	31.64	29.52	30.35	32.02	37.26	38.00	39.92	45.18	55.05	57.41	59.86	62.69	67.38	67.62	67.56	59.93	57.83	57.42	57.80	43.47	39.49	37.31	47.50	54.79		
<b>Cleared Load (GW)</b>	12.7	12.2	11.8	11.7	11.8	12.2	13.5	15.7	16.9	17.9	18.6	19.4	19.8	20.1	20.3	20.2	20.1	19.6	19.1	19.0	19.0	17.7	16.4	14.1				

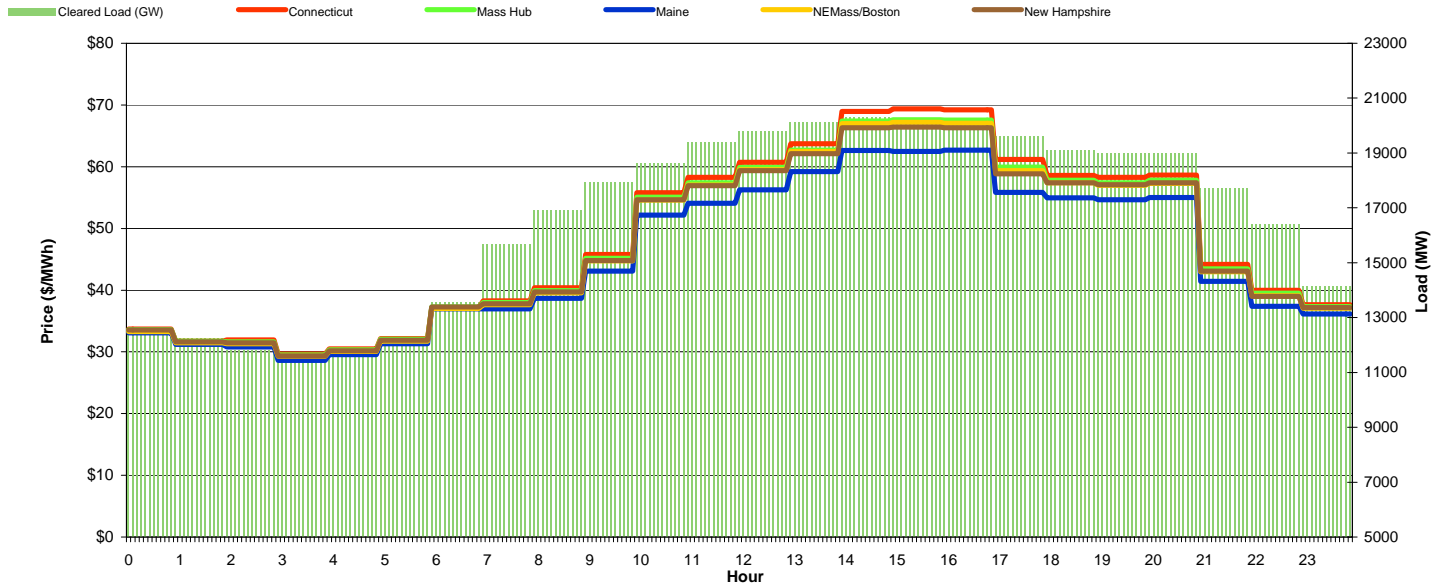

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	32.21	30.68	30.43	30.19	30.76	32.20	38.74	36.77	34.19	37.69	41.25	41.77	51.56	49.00	48.35	45.26	38.69	38.11	37.24	47.21	47.69	38.71	37.24	37.40	38.89	41.92	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	31.75	30.31	29.91	29.61	30.25	31.72	37.98	35.87	33.30	36.56	40.11	40.71	50.15	47.60	46.91	43.96	37.74	37.27	36.68	46.49	46.83	37.95	36.55	37.05	38.05	40.92		
<b>New Hampshire</b>	31.76	30.31	29.87	29.53	30.22	31.72	38.04	35.92	33.40	36.55	39.94	40.41	49.56	46.86	46.14	43.20	37.06	36.70	36.32	46.21	46.65	37.75	36.32	36.84	37.80	40.56		
<b>Maine</b>	31.05	29.71	29.00	28.49	29.45	31.06	37.25	34.83	32.27	34.84	37.70	38.22	46.02	43.98	43.20	40.49	34.66	34.33	34.44	43.86	44.20	35.70	34.67	35.67	36.05	38.34		
<b>Mass Hub</b>	31.96	30.51	30.14	29.84	30.48	31.92	38.20	36.04	33.41	36.70	40.21	40.76	50.22	47.67	46.99	44.04	37.76	37.30	36.64	46.47	46.84	38.00	36.61	37.12	38.16	40.98		
<b>DA Forecast Load (GW)</b>	12.77	12.10	11.73	11.58	11.77	12.61	14.05	15.74	16.94	17.98	18.85	19.50	19.91	20.33	20.40	20.34	20.36	20.17	19.67	19.48	19.50	18.52	16.89	15.28				
<b>Forecast Error %</b>	1.9%	4.7%	5.3%	5.9%	5.8%	2.4%	1.3%	1.2%	2.2%	2.5%	2.1%	2.1%	1.6%	0.2%	-0.8%	-1.0%	-1.6%	-1.5%	-0.3%	0.6%	0.8%	1.0%	1.1%	1.7%				

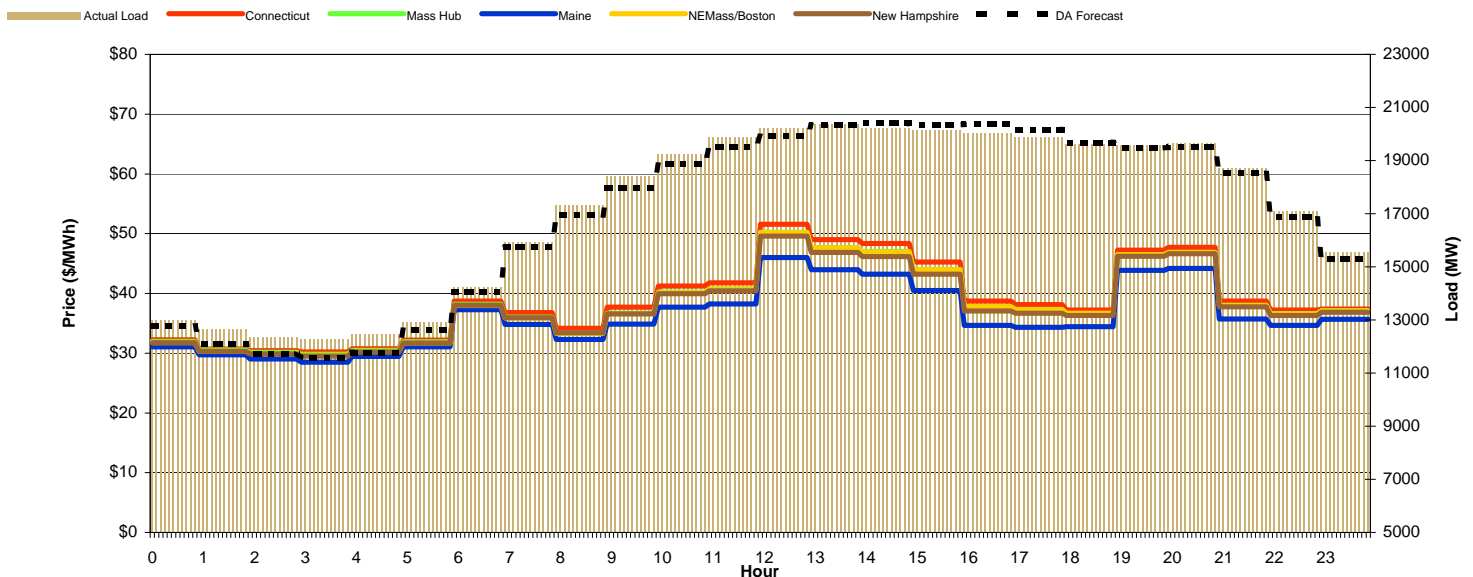




# ISO-NE Daily Report

Friday August 26, 2011

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	41.05	36.89	33.34	31.21	31.23	33.55	38.00	37.29	40.18	44.77	49.00	58.96	58.81	62.07	63.00	62.79	62.35	58.65	49.84	46.95	48.13	42.35	38.00	37.43	46.08	51.45	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	40.21	36.48	33.00	30.97	31.03	33.33	37.92	36.86	39.41	43.77	48.07	57.67	57.65	60.71	61.70	61.30	60.84	57.07	48.48	45.85	46.88	41.38	37.33	37.08	45.21	50.31		
<b>New Hampshire</b>	40.32	36.59	33.13	31.05	31.11	33.48	38.01	36.91	39.51	43.84	48.04	57.53	57.25	60.14	61.17	60.65	60.20	56.63	48.19	45.79	46.80	41.42	37.34	37.26	45.10	50.09		
<b>Maine</b>	39.44	35.80	32.19	30.17	30.26	32.70	37.58	36.05	38.42	42.00	45.77	54.50	54.44	57.26	58.71	58.00	57.63	54.34	46.24	44.03	44.99	39.83	36.46	36.97	43.49	48.04		
<b>Mass Hub</b>	40.64	36.86	33.39	31.29	31.34	33.65	38.15	37.22	39.84	44.21	52.42	58.11	57.94	61.03	61.94	61.58	61.14	57.52	48.94	46.25	47.36	41.75	37.65	37.26	45.73	50.93		
<b>Cleared Load (GW)</b>	13.7	13.7	13.2	12.8	12.9	13.4	14.1	16.0	17.1	18.0	19.1	19.5	20.1	20.3	20.6	20.5	20.5	19.8	19.4	19.1	18.9	17.6	16.2	13.9				

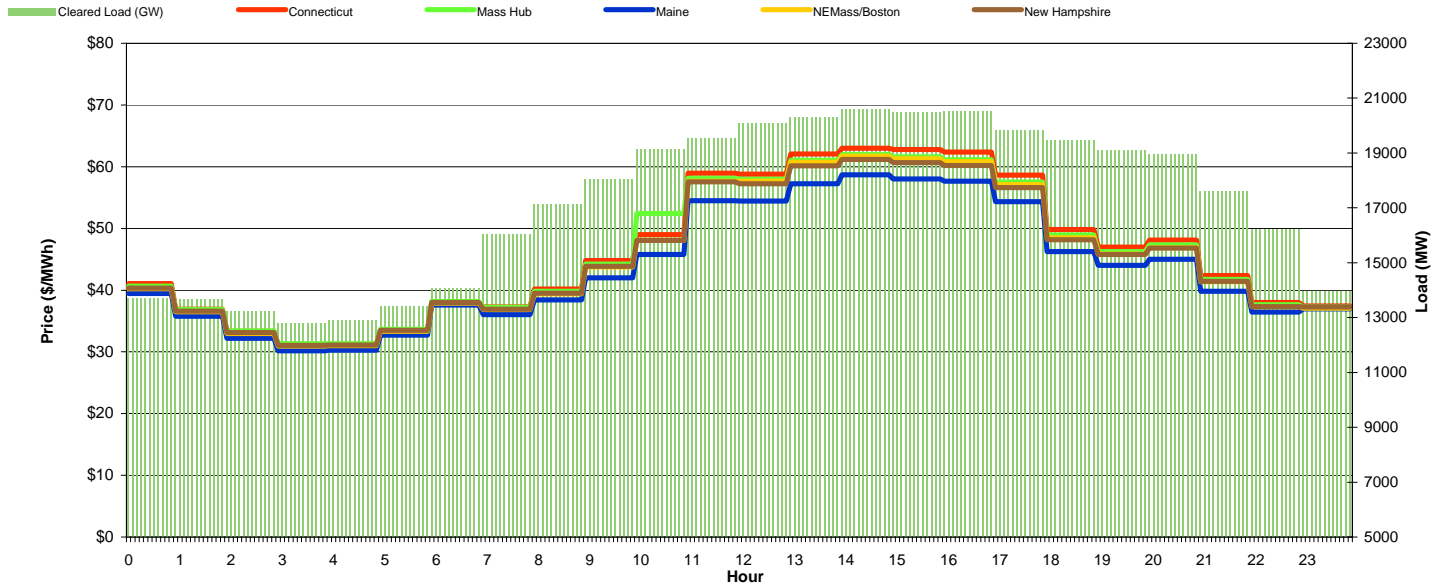

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	39.74	33.12	31.53	29.88	29.44	34.53	34.11	35.88	34.84	40.69	58.39	60.97	54.55	67.45	73.74	59.25	55.52	60.29	53.62	42.65	44.05	40.06	44.97	40.97	45.84	51.68	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	39.11	32.73	31.17	29.63	29.31	34.28	33.89	35.58	34.22	39.81	57.11	59.60	53.43	66.00	72.33	58.21	54.52	58.88	52.04	41.56	42.92	38.73	43.69	40.49	44.97	50.54		
<b>New Hampshire</b>	39.00	32.68	31.07	29.48	29.15	34.26	33.87	35.51	34.20	39.72	56.89	59.48	53.00	65.33	71.57	57.54	53.87	58.30	51.70	41.35	42.69	38.51	43.41	40.34	44.71	50.19		
<b>Maine</b>	37.59	31.53	29.68	28.13	27.89	33.10	32.97	34.36	32.81	37.75	54.23	57.52	51.31	63.39	69.65	55.80	52.07	56.38	50.17	40.10	41.38	36.94	41.91	40.01	43.19	48.49		
<b>Mass Hub</b>	39.36	32.96	31.40	29.81	29.45	34.47	33.98	35.61	34.27	39.88	57.15	59.50	53.30	65.76	72.00	57.97	54.30	58.81	52.15	41.62	42.95	38.88	43.86	40.54	45.00	50.50		
<b>DA Forecast Load (GW)</b>	14.10	13.32	12.91	12.67	12.71	13.52	14.82	16.45	17.65	18.73	19.64	20.35	20.85	21.27	21.41	21.37	21.29	20.84	19.94	19.50	19.41	18.42	16.93	15.33				
<b>Forecast Error %</b>	4.2%	7.2%	6.8%	6.6%	6.6%	3.9%	-1.3%	-2.1%	-0.7%	-0.4%	-0.5%	-0.6%	-0.8%	-0.4%	0.0%	0.3%	0.3%	0.7%	1.9%	1.6%	2.2%	2.1%	1.9%	1.3%				

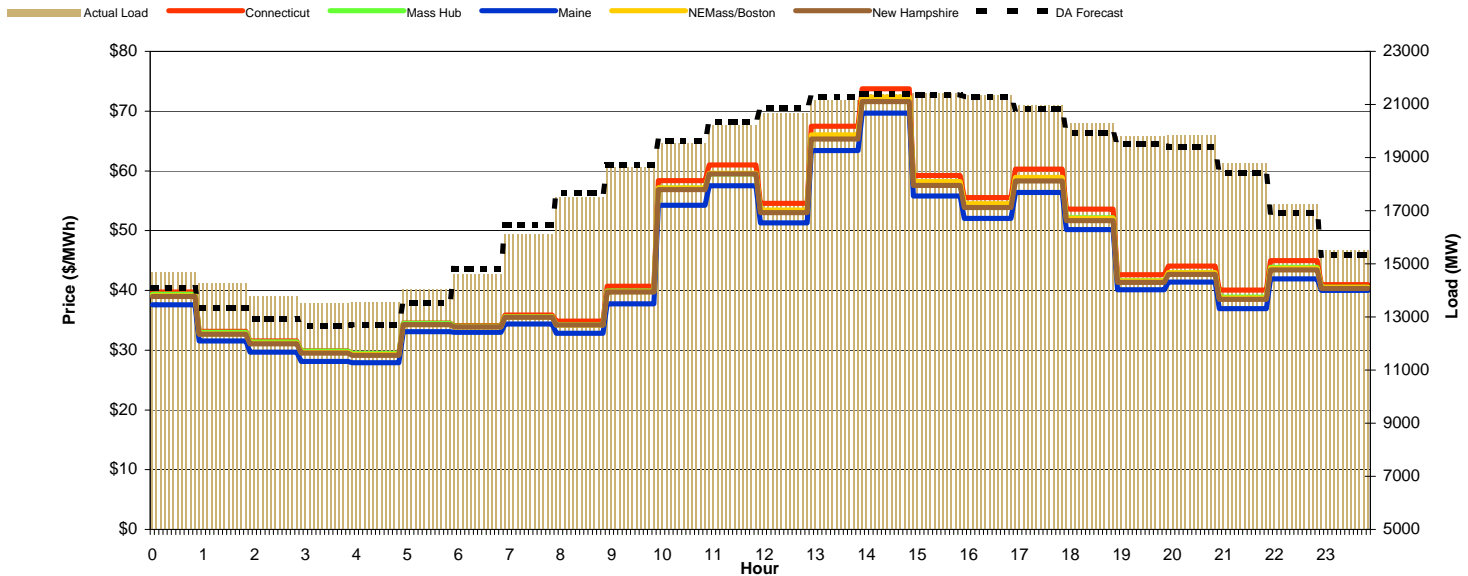




# ISO-NE Daily Report

Saturday August 27, 2011

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	40.67	36.47	33.08	32.33	31.66	32.39	31.84	32.65	36.89	39.29	43.39	46.21	46.83	48.09	46.01	44.45	42.99	43.04	40.36	42.20	41.23	38.44	37.09	36.29	39.33	41.82	All	On Pk
<b>NEMass/Boston</b>	40.40	36.39	32.93	32.23	31.68	32.36	31.79	32.73	36.75	38.85	42.56	45.44	46.00	47.21	45.17	43.56	42.15	42.19	39.73	41.38	40.60	37.79	36.68	36.02	38.86	41.17		
<b>New Hampshire</b>	40.36	36.37	32.96	32.26	31.75	32.41	31.76	32.73	36.72	38.83	42.60	45.45	45.76	46.90	44.84	43.27	41.89	42.00	39.49	41.20	40.42	37.73	36.54	35.70	38.75	41.02		
<b>Maine</b>	40.20	36.17	32.73	32.02	31.71	32.41	31.34	32.34	36.12	37.93	41.12	43.64	43.94	45.06	43.19	41.75	40.56	40.57	38.14	40.00	39.31	36.86	36.04	35.10	37.84	39.79		
<b>Mass Hub</b>	40.70	36.61	33.17	32.51	31.93	32.58	31.98	32.78	36.84	39.02	42.89	45.69	46.23	47.47	45.40	43.81	42.37	42.43	39.89	41.67	40.80	37.96	36.78	36.19	39.07	41.38		
<b>Cleared Load (GW)</b>	13.4	12.8	12.5	12.3	12.2	12.1	12.4	12.9	14.2	15.7	16.4	16.8	17.0	17.1	17.0	17.0	17.0	16.9	16.8	16.8	16.7	15.6	14.5	13.2				

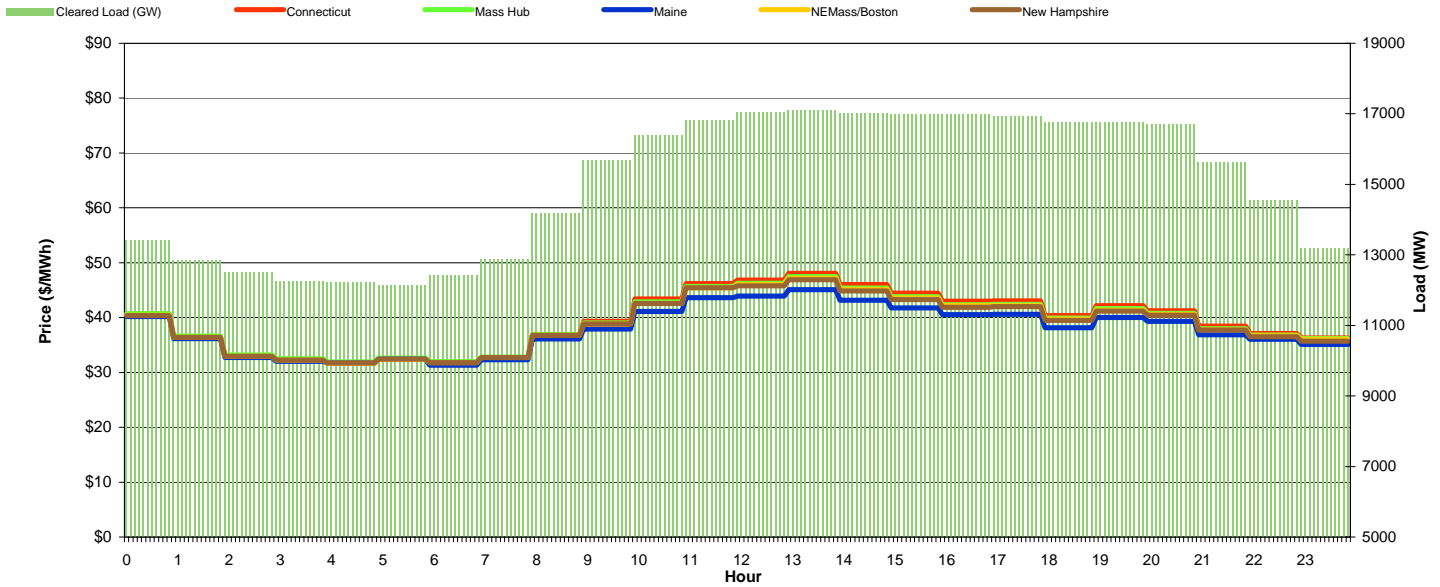

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$				
<b>Connecticut</b>	41.44	37.30	39.48	39.13	39.30	40.54	37.13	45.66	44.55	43.32	69.91	80.75	74.57	47.64	36.08	47.42	55.54	46.26	43.44	60.15	46.44	41.28	52.95	40.01	47.93	52.25	All	On Pk	
<b>NEMass/Boston</b>	40.84	37.08	39.05	38.60	38.86	39.74	36.44	44.84	43.37	42.11	68.03	78.91	73.26	47.11	35.69	46.79	54.52	45.44	42.70	58.85	45.50	40.55	51.99	39.53	47.08	51.23			
<b>New Hampshire</b>	40.65	36.83	38.85	38.39	38.69	39.48	36.14	44.54	43.14	41.86	67.51	78.31	72.63	46.78	35.41	46.45	54.21	45.30	42.38	58.49	45.34	40.21	51.36	39.17	46.76	50.87			
<b>Maine</b>	40.29	36.37	38.10	37.59	38.19	38.37	35.11	43.60	42.24	40.32	64.42	74.71	69.44	44.97	34.03	44.62	52.04	43.53	40.80	56.20	43.38	38.39	49.11	38.17	45.17	48.86			
<b>Mass Hub</b>	40.99	37.15	39.30	38.93	39.19	40.14	36.73	45.04	43.60	42.32	68.40	79.28	73.51	47.23	35.76	46.92	54.72	45.63	42.86	59.14	45.68	40.69	52.26	39.78	47.30	51.44			
<b>DA Forecast Load (GW)</b>	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
<b>Forecast Error %</b>	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!		

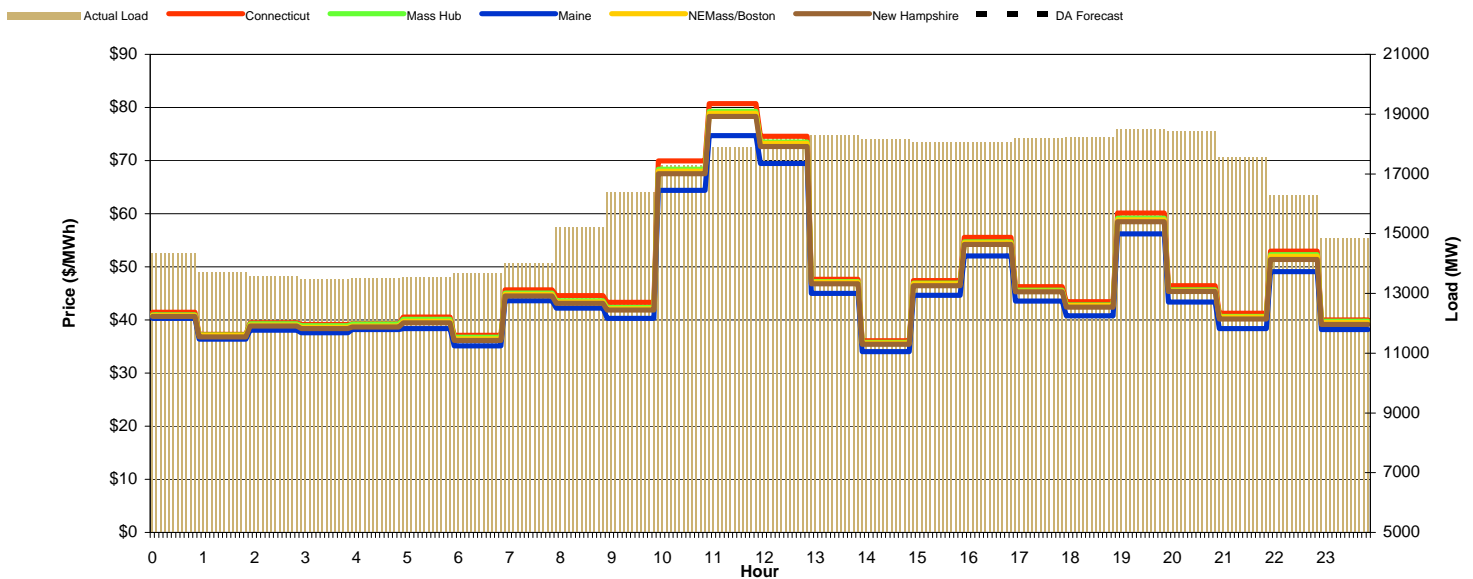




# ISO-NE Daily Report

Sunday August 28, 2011

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	49.24	45.64	45.65	42.07	41.45	36.34	34.77	38.31	44.34	47.76	51.76	57.36	52.85	60.37	57.54	57.54	57.52	57.49	57.93	57.87	58.39	51.51	47.39	43.70	49.78	53.50	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	47.23	44.15	44.27	40.89	40.49	35.81	34.04	37.54	43.24	45.96	49.73	55.07	51.00	57.74	55.08	55.03	55.00	55.06	55.51	55.60	56.11	49.50	46.14	42.63	48.03	51.46		
<b>New Hampshire</b>	46.71	43.64	43.68	40.42	40.12	35.45	33.56	37.15	42.59	45.48	49.26	54.56	50.50	57.13	54.46	54.44	54.43	54.55	54.98	55.13	55.57	49.05	45.58	42.20	47.53	50.93		
<b>Maine</b>	45.20	42.60	42.59	39.52	39.20	34.89	32.60	36.52	40.80	43.58	46.95	51.63	48.12	53.99	51.54	51.70	51.71	51.97	52.36	52.67	53.20	47.23	44.58	41.67	45.70	48.66		
<b>Mass Hub</b>	47.94	44.65	44.77	41.36	40.91	36.03	34.24	37.73	43.47	46.46	50.38	55.84	51.60	58.51	55.81	55.80	55.78	55.83	56.27	56.33	56.82	50.15	46.45	42.82	48.58	52.08		
<b>Cleared Load (GW)</b>	13.5	12.8	12.7	12.7	12.4	12.2	12.0	13.1	14.0	14.9	15.5	15.9	15.7	15.6	15.4	15.3	15.4	15.5	15.5	15.6	15.6	15.0	14.0	12.7				

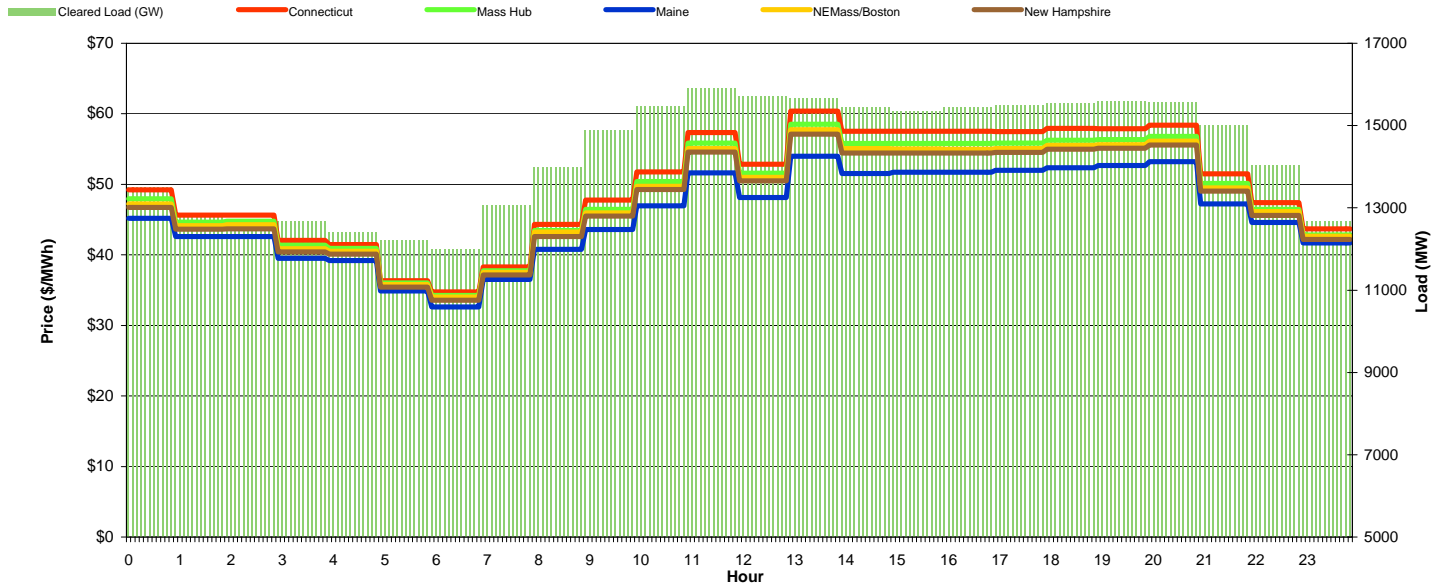

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$				
<b>Connecticut</b>	30.91	25.86	30.81	32.67	22.00	23.40	31.05	23.68	23.79	31.52	30.93	16.45	5.16	0.00	0.00	0.00	0.00	0.00	0.00	0.00	13.94	31.62	16.04	0.00	16.24	12.07	<b>All</b>	<b>On Pk</b>	
<b>NEMass/Boston</b>	30.40	25.54	30.25	31.81	21.59	23.09	30.52	23.28	23.38	31.13	30.57	16.31	5.11	0.00	0.00	0.00	0.00	0.00	0.00	0.00	13.63	31.01	15.81	0.00	15.98	11.89			
<b>New Hampshire</b>	30.03	25.17	29.92	31.57	21.45	22.86	30.19	23.03	23.16	30.90	30.40	16.20	5.08	0.00	0.00	0.00	0.00	0.00	0.00	0.00	13.60	30.78	15.67	0.00	15.83	11.80			
<b>Maine</b>	29.22	24.55	29.44	31.10	21.17	22.42	29.34	22.37	22.18	29.74	29.15	15.53	4.91	0.00	0.00	0.00	0.00	0.00	0.00	0.00	12.98	29.14	15.07	0.00	15.35	11.32			
<b>Mass Hub</b>	30.58	25.66	30.48	32.17	21.77	23.25	30.76	23.43	23.56	31.32	30.70	16.36	5.13	0.00	0.00	0.00	0.00	0.00	0.00	0.00	13.79	31.33	15.93	0.00	16.09	11.97			
<b>DA Forecast Load (GW)</b>	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
<b>Forecast Error %</b>	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!		

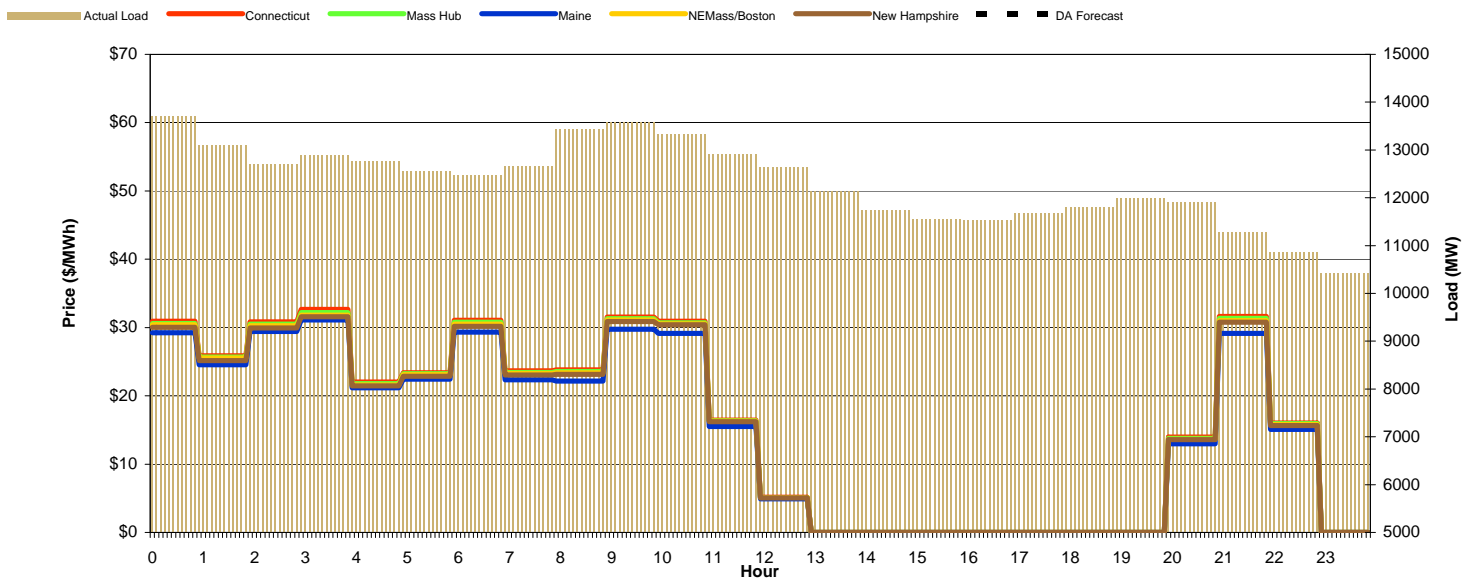




# ISO-NE Daily Report

Monday August 29, 2011

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	32.62	30.38	28.81	27.36	28.12	30.25	34.70	36.77	40.44	44.15	48.73	58.91	56.70	55.97	58.85	61.40	60.63	57.58	51.72	49.49	51.21	43.19	39.00	40.41	44.47	50.92	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	31.92	29.74	28.25	26.88	27.66	29.90	34.51	36.63	39.87	43.21	47.83	57.66	55.78	55.15	57.86	60.24	59.44	56.48	50.48	48.67	50.15	42.23	38.41	39.64	43.69	50.01		
<b>New Hampshire</b>	31.79	29.58	28.08	26.70	27.49	29.78	34.41	36.36	39.43	42.83	47.35	57.21	55.22	54.60	57.23	59.50	58.80	55.97	50.00	48.23	49.69	41.74	38.06	39.30	43.31	49.51		
<b>Maine</b>	32.02	29.71	28.14	26.74	27.59	29.98	34.26	35.84	38.54	41.70	45.98	55.56	53.50	53.19	55.58	57.39	56.76	54.54	48.53	47.02	48.35	40.45	37.83	39.23	42.43	48.17		
<b>Mass Hub</b>	32.14	29.94	28.50	27.10	27.89	30.14	34.68	36.80	40.13	43.59	48.22	58.16	56.18	55.39	58.02	60.48	59.71	56.87	50.84	49.02	50.56	42.72	38.73	40.06	43.99	50.34		
<b>Cleared Load (GW)</b>	10.7	10.1	10.0	9.8	10.1	10.7	11.8	13.1	14.0	14.8	15.3	15.5	16.0	16.2	16.1	16.2	16.2	15.9	15.6	15.6	15.4	14.7	13.3	12.0				

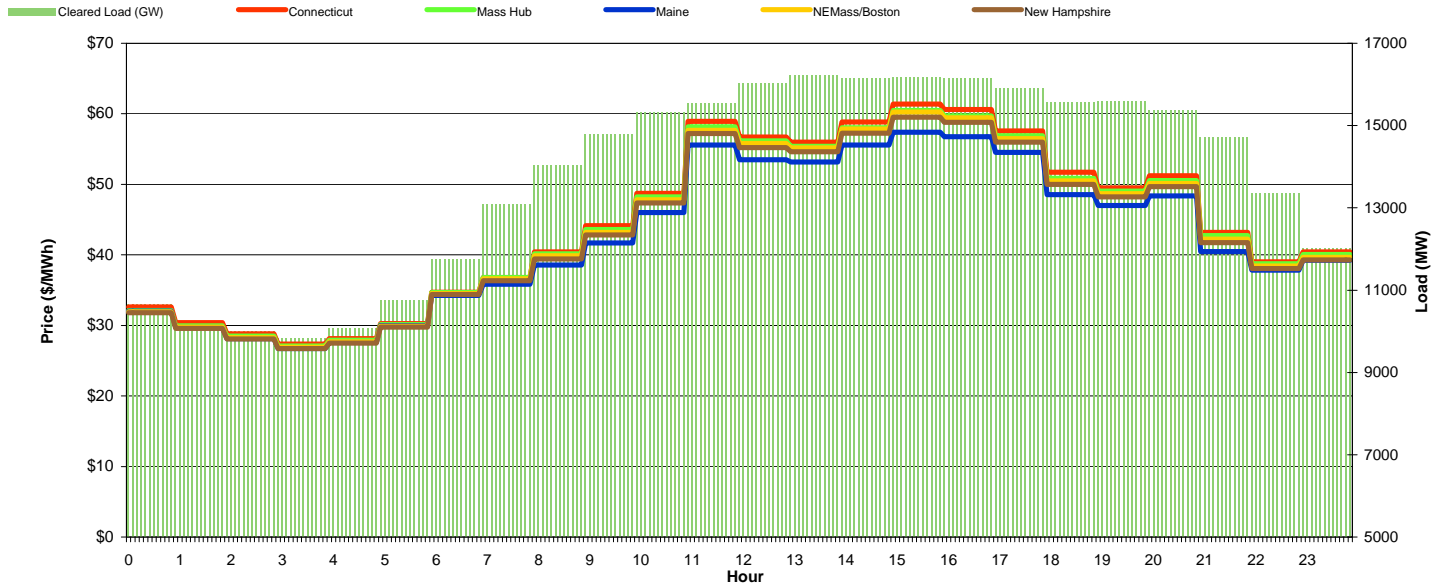

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$				
<b>Connecticut</b>	0.00	0.00	0.00	0.00	0.00	0.00	2.20	0.00	0.00	30.52	39.31	37.26	36.20	36.04	39.14	38.56	34.94	31.49	30.94	31.64	33.01	28.22	23.74	27.76	20.87	29.44	<b>All</b>	<b>On Pk</b>	
<b>NEMass/Boston</b>	0.00	0.00	0.00	0.00	0.00	0.00	2.19	0.00	0.00	29.85	38.40	36.65	35.88	35.86	38.83	38.27	34.67	31.36	30.80	31.63	32.88	28.16	23.79	28.02	20.72	29.19			
<b>New Hampshire</b>	0.00	0.00	0.00	0.00	0.00	0.00	2.17	0.00	0.00	29.64	38.24	36.47	35.65	35.65	38.52	37.90	34.35	31.07	30.54	31.39	32.63	27.80	23.38	27.48	20.54	28.95			
<b>Maine</b>	0.00	0.00	0.00	0.00	0.00	0.00	2.16	0.00	0.00	28.60	36.68	34.90	34.02	34.21	37.05	36.38	32.87	30.00	29.56	30.48	31.58	26.83	22.67	26.68	19.78	27.86			
<b>Mass Hub</b>	0.00	0.00	0.00	0.00	0.00	0.00	2.20	0.00	0.00	30.19	38.89	37.02	36.17	36.11	39.12	38.54	34.98	31.54	30.96	31.79	33.11	28.31	23.82	28.02	20.87	29.41			
<b>DA Forecast Load (GW)</b>	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
<b>Forecast Error %</b>	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!		

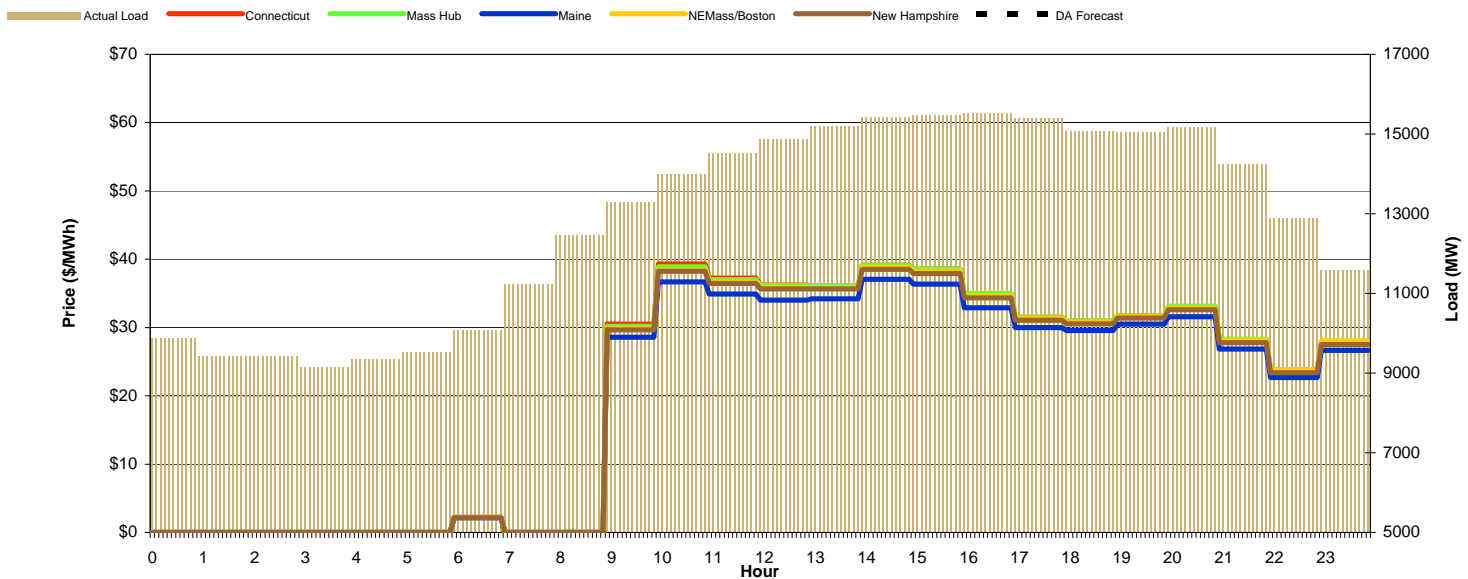




# ISO-NE Daily Report

Tuesday August 30, 2011

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	26.59	23.22	19.96	14.95	13.98	26.21	31.29	32.89	35.95	35.93	37.16	37.53	37.56	37.73	37.82	49.02	49.02	37.82	37.71	37.67	37.47	36.07	33.44	29.74	33.20	38.17	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	26.09	23.06	19.99	14.95	14.04	26.00	30.54	32.19	35.23	35.19	36.36	36.65	36.72	36.77	36.78	38.53	37.69	36.76	36.65	36.65	36.51	35.19	32.62	29.33	31.69	36.03		
<b>New Hampshire</b>	25.67	22.64	19.74	14.78	13.89	25.57	30.45	32.07	35.04	34.99	36.13	36.51	36.54	36.62	36.61	38.37	37.54	36.65	36.55	36.53	36.42	34.98	32.40	29.19	31.50	35.87		
<b>Maine</b>	24.92	21.99	19.20	14.36	13.52	24.92	30.00	31.38	34.04	33.90	34.88	35.33	35.25	35.35	35.30	37.02	36.17	35.59	35.49	35.37	35.36	33.71	31.37	28.98	30.56	34.72		
<b>Mass Hub</b>	26.26	23.13	20.02	14.98	14.06	26.07	30.90	32.54	35.61	35.55	36.71	37.04	37.09	37.15	37.14	38.99	38.15	37.18	37.10	37.15	36.97	35.62	33.01	29.63	32.00	36.44		
<b>Cleared Load (GW)</b>	9.6	9.2	9.0	8.9	9.1	9.5	10.6	12.3	13.3	14.1	14.8	15.3	15.7	15.9	15.9	16.0	16.0	15.9	15.4	15.4	15.2	14.1	12.7	11.2				

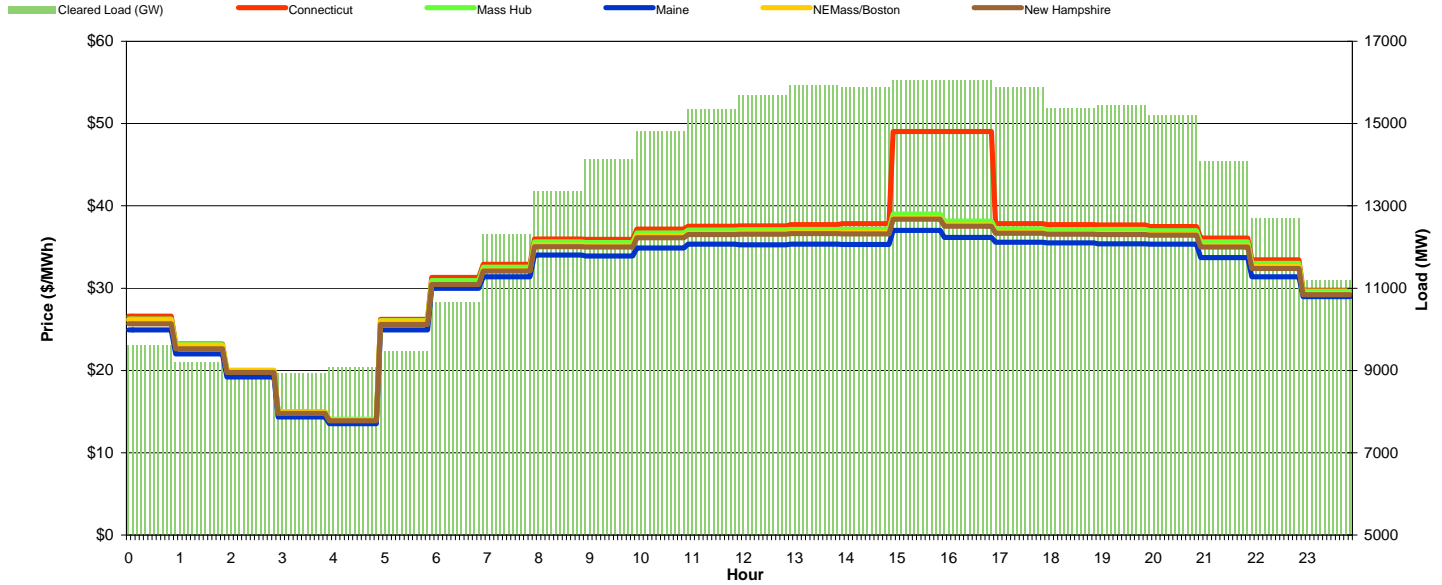

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	35.76	36.20	14.09	0.00	0.00	0.00	44.74	37.94	33.76	33.19	36.63	39.43	35.29	36.62	40.42	43.93	41.70	40.41	38.23	43.73	41.65	36.35	31.57	40.52	32.59	38.18	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	35.81	36.13	14.10	0.00	0.00	0.00	44.95	37.95	33.62	32.87	35.98	38.71	34.70	35.90	39.43	42.91	40.80	39.46	37.37	42.89	40.78	35.65	31.11	40.40	32.15	37.51		
<b>New Hampshire</b>	35.11	35.49	13.87	0.00	0.00	0.00	44.43	37.49	33.32	32.67	35.76	38.48	34.47	35.63	39.12	42.59	40.47	39.08	37.05	42.55	40.37	35.19	30.68	39.83	31.82	37.18		
<b>Maine</b>	33.94	34.34	13.52	0.00	0.00	0.00	43.85	36.62	32.58	32.16	34.90	37.43	33.49	34.62	37.91	41.06	39.20	37.78	35.81	41.15	38.77	33.70	29.51	39.19	30.90	36.04		
<b>Mass Hub</b>	35.92	36.27	14.14	0.00	0.00	0.00	45.02	38.09	33.83	33.15	36.35	39.07	34.99	36.24	39.85	43.35	41.21	39.89	37.78	43.36	41.27	36.08	31.43	40.66	32.41	37.87		
<b>DA Forecast Load (GW)</b>	10.05	9.56	9.32	9.24	9.49	10.21	11.66	13.26	14.36	15.20	15.84	16.35	16.51	16.78	16.92	16.86	16.89	16.61	16.55	16.54	16.31	15.33	13.86	12.50				
<b>Forecast Error %</b>	5.8%	5.9%	5.1%	4.5%	3.4%	2.9%	-0.1%	-2.5%	-3.2%	-2.9%	-2.1%	-2.3%	-1.4%	-1.0%	-0.8%	0.1%	0.3%	1.2%	-0.9%	-1.4%	0.6%	0.3%	0.3%	0.1%				

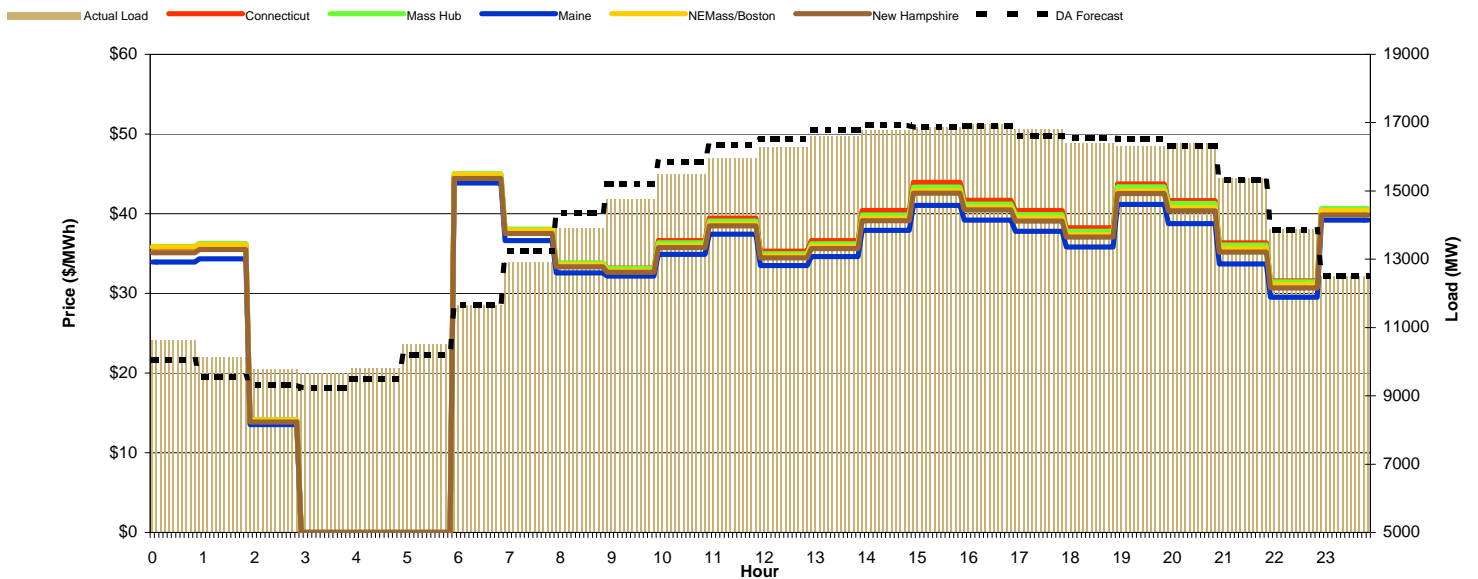




# ISO-NE Daily Report

Wednesday August 31, 2011

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%

## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	29.96	29.48	25.85	25.13	25.16	28.52	30.84	32.55	35.25	35.02	36.86	37.67	38.01	38.26	42.40	43.95	47.09	43.71	37.86	37.55	37.64	33.99	32.59	31.74	34.88	38.15	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	29.64	28.88	25.77	25.18	25.31	28.07	30.36	32.01	34.69	34.42	36.16	36.75	36.95	37.16	40.97	42.38	45.44	42.17	36.72	36.71	36.62	33.36	32.08	31.22	34.13	37.16		
<b>New Hampshire</b>	29.47	28.73	25.43	24.79	24.92	27.86	30.19	31.79	34.40	34.18	35.91	36.50	36.71	36.94	40.71	42.06	45.05	41.84	36.53	36.47	36.40	33.07	31.90	31.08	33.87	36.90		
<b>Maine</b>	29.56	28.68	25.38	24.72	24.82	27.83	29.90	31.26	33.62	33.33	34.90	35.61	35.81	36.23	39.64	40.84	43.40	40.23	35.54	35.50	35.44	32.11	31.71	31.12	33.22	35.95		
<b>Mass Hub</b>	29.94	29.23	25.85	25.20	25.34	28.36	30.63	32.39	35.10	34.82	36.59	37.22	37.44	37.64	41.54	43.04	46.09	42.86	37.26	37.22	37.17	33.78	32.47	31.56	34.53	37.66		
<b>Cleared Load (GW)</b>	10.7	9.9	9.1	9.2	9.3	10.1	11.3	13.3	14.4	15.2	15.9	16.3	16.7	17.0	16.9	17.0	16.9	16.7	16.4	16.5	16.3	15.0	13.4	11.6				

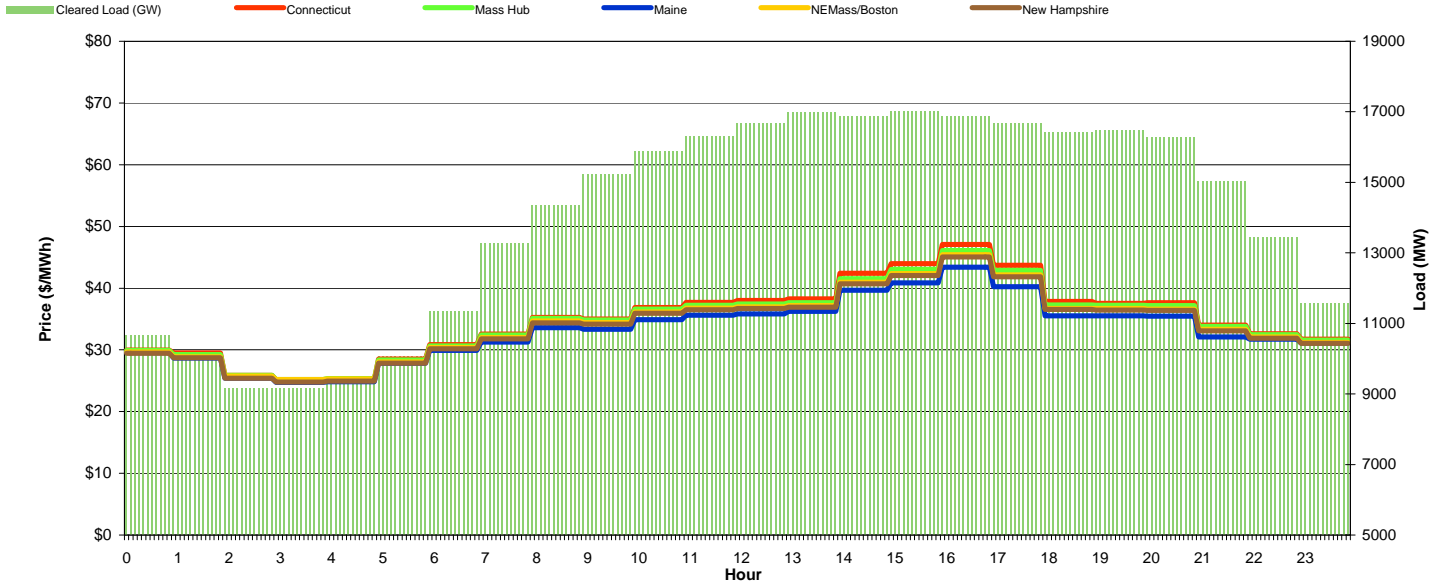

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	50.60	36.01	30.95	32.15	35.09	48.74	37.53	30.80	32.18	34.00	37.35	37.09	38.96	42.70	52.33	46.95	57.01	59.70	53.37	53.09	48.37	41.76	37.65	40.77	42.30	43.96	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	50.50	35.76	30.81	32.04	35.06	48.42	37.19	30.61	31.75	33.49	36.72	36.30	37.93	41.42	50.79	45.43	55.12	44.93	47.45	45.76	44.49	37.64	35.59	40.09	40.22	40.96		
<b>New Hampshire</b>	49.83	35.31	30.46	31.73	34.78	47.94	36.79	30.17	31.43	33.17	36.34	35.95	37.51	40.92	50.28	44.99	54.58	44.52	47.12	45.47	44.15	37.27	35.28	39.90	39.83	40.57		
<b>Maine</b>	49.62	35.15	30.30	31.75	34.89	47.88	36.39	29.44	30.71	32.26	35.10	34.60	36.12	39.46	48.18	43.05	52.27	42.56	45.31	43.75	42.20	35.77	34.37	39.77	38.79	39.07		
<b>Mass Hub</b>	50.83	36.05	31.02	32.27	35.30	48.77	37.45	30.81	32.01	33.77	37.00	36.59	38.23	41.78	51.24	45.87	55.72	44.08	47.61	45.68	44.84	37.78	35.83	40.50	40.46	41.18		
<b>DA Forecast Load (GW)</b>	11.54	10.90	10.54	10.37	10.55	11.29	12.63	14.11	15.11	16.01	16.64	17.14	17.40	17.69	17.84	17.83	17.84	17.70	17.23	17.11	17.18	16.22	14.69	13.19				
<b>Forecast Error %</b>	-0.9%	-0.3%	-1.0%	1.6%	1.0%	-0.8%	-0.6%	-1.9%	-1.0%	-0.8%	0.4%	1.0%	1.9%	2.6%	2.8%	2.8%	2.2%	1.5%	1.7%	2.9%	2.4%	1.7%	1.7%	1.3%				

