




ISO-NE Daily Report

Thursday April 01, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	27.53	29.26	29.48	29.18	28.15	28.93	35.29	43.06	39.64	42.03	41.00	40.00	38.07	37.17	35.42	35.09	35.29	37.04	38.86	46.39	43.30	36.61	32.83	30.57	35.84	38.86	All	On Pk
NEMass/Boston	26.61	26.44	26.41	26.42	26.49	28.12	34.30	41.85	38.51	40.84	39.85	38.88	37.00	36.13	34.43	34.10	34.30	36.00	37.77	45.09	42.09	35.58	31.09	28.78	34.46	37.72		
New Hampshire	21.35	17.40	16.27	17.63	22.34	27.66	33.74	41.78	39.21	41.40	39.35	38.38	36.69	35.61	33.87	33.55	33.74	35.42	38.40	44.37	41.43	35.00	27.02	24.28	32.33	37.20		
Maine	20.64	16.84	15.58	16.04	21.26	26.96	32.88	44.00	44.00	45.72	39.00	38.00	37.00	35.00	33.01	32.70	32.88	33.52	35.54	42.67	38.39	33.73	22.27	23.11	31.70	36.71		
Mass Hub	26.74	27.49	27.56	27.45	27.06	28.33	34.56	42.16	38.80	41.15	40.15	39.17	37.28	36.40	34.69	34.36	34.56	36.27	38.06	45.43	42.41	35.85	31.69	29.42	34.88	38.03		
Cleared Load (GW)	10.5	10.6	10.2	10.4	10.7	10.6	12.6	13.0	13.4	13.4	13.6	13.6	13.3	13.3	13.2	13.1	13.2	13.3	13.5	13.8	13.6	12.5	11.5	10.3				

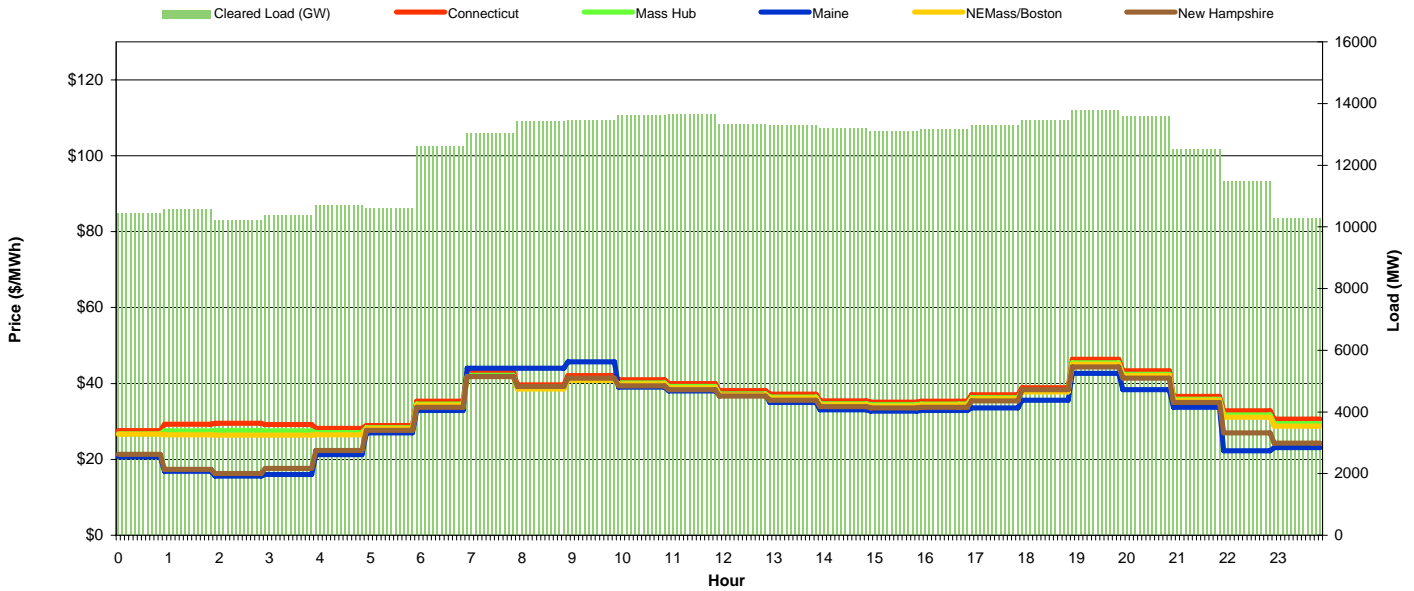

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	45.26	114.78	50.46	30.89	20.48	23.14	62.72	52.91	65.04	67.10	50.42	52.87	48.31	46.25	36.11	33.41	33.70	33.77	32.28	55.04	48.13	51.53	41.27	25.93	46.74	46.76	All	On Pk
NEMass/Boston	45.08	113.91	50.16	30.62	20.45	23.06	62.60	52.50	64.29	66.05	49.62	52.15	47.52	45.32	35.30	32.72	32.99	33.08	31.70	54.57	47.87	51.11	40.57	25.70	46.21	46.09		
New Hampshire	43.29	109.79	48.32	29.61	19.79	22.34	61.03	51.40	63.31	65.08	48.90	51.39	46.85	44.72	34.80	32.17	32.38	32.42	31.05	53.40	46.91	50.00	39.50	24.80	45.14	45.27		
Maine	42.06	105.73	46.35	28.63	19.27	21.88	60.74	50.88	62.70	64.40	48.23	50.71	46.10	43.93	34.15	31.58	31.73	31.76	30.47	52.58	46.19	49.23	38.59	24.14	44.25	44.58		
Mass Hub	44.94	114.30	50.35	30.76	20.49	23.04	62.14	52.34	64.31	66.19	49.74	52.22	47.68	45.48	35.47	32.83	33.10	33.19	31.80	54.49	47.77	51.09	40.76	25.70	46.26	46.15		
DA Forecast Load (GW)	11.10	10.65	10.42	10.36	10.69	11.71	13.73	14.97	15.17	15.27	15.38	15.28	15.08	14.99	14.78	14.54	14.62	14.78	15.18	15.66	15.46	14.50	13.12	11.64				
Forecast Error %	1.8%	7.6%	9.9%	12.3%	12.8%	4.5%	-1.9%	-1.9%	-0.4%	-0.1%	-0.6%	-0.4%	-0.4%	-0.7%	-0.7%	-0.5%	-1.9%	-3.1%	-5.4%	-3.7%	-1.4%	-0.6%	-0.4%	2.0%				

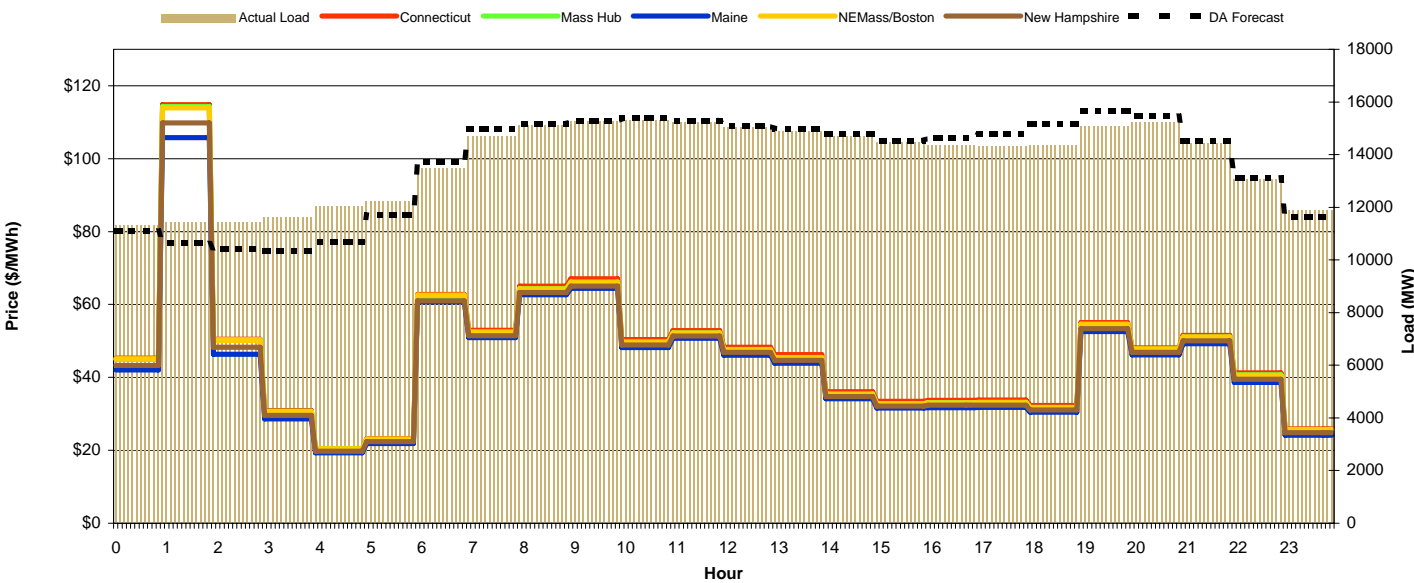




ISO-NE Daily Report

Friday April 02, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	27.73	28.04	28.61	28.19	28.24	29.08	34.46	36.47	41.76	44.01	49.95	49.84	46.76	43.68	41.89	40.18	40.82	41.91	42.66	46.80	43.38	36.55	35.19	34.03	38.34	42.62	All	On Pk
NEMass/Boston	26.68	26.94	26.51	26.44	26.53	27.78	33.53	35.49	40.64	42.83	48.61	48.50	45.50	42.51	40.76	39.10	39.72	40.79	41.51	45.54	42.22	35.57	32.99	31.83	37.02	41.39		
New Hampshire	24.88	24.92	19.94	21.16	21.52	25.05	32.91	34.83	39.89	42.04	47.71	47.60	44.66	41.72	40.00	38.37	38.98	40.03	40.74	44.69	41.43	34.91	26.93	25.68	35.02	40.28		
Maine	24.10	24.11	18.66	20.00	20.39	24.14	32.11	33.99	38.92	41.02	46.55	46.44	43.57	40.71	39.03	37.44	38.04	39.22	40.00	44.00	40.43	34.06	25.53	24.30	34.03	39.31		
Mass Hub	27.00	27.27	27.32	27.11	27.18	28.20	33.77	35.74	40.93	43.13	48.95	48.84	45.82	42.81	41.05	39.37	40.00	41.07	41.80	45.86	42.51	35.82	33.77	32.62	37.41	41.72		
Cleared Load (GW)	10.1	10.3	10.3	10.3	10.6	10.2	11.7	13.0	13.0	13.0	12.8	12.6	12.6	12.5	12.5	12.5	12.5	12.6	12.6	13.1	12.7	12.0	11.2	10.1				

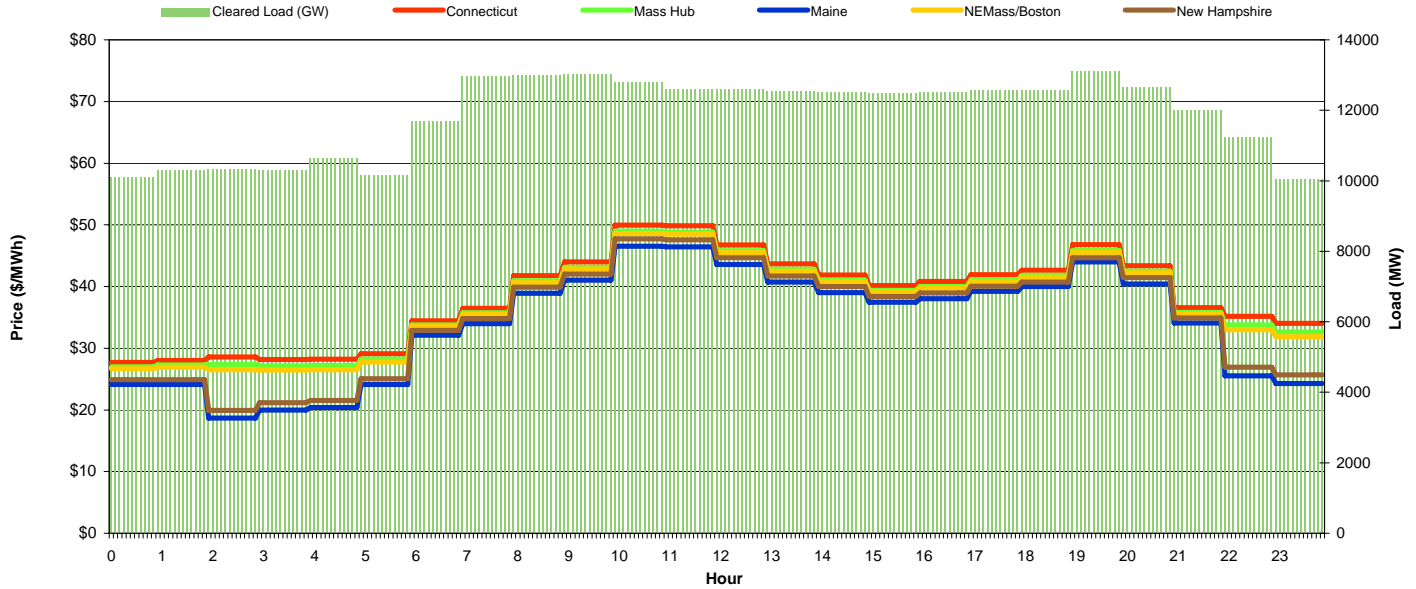

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	28.34	32.86	30.21	44.85	27.94	26.86	28.81	38.98	44.49	55.09	52.92	53.60	55.13	52.41	45.63	33.98	40.43	38.75	34.49	65.34	68.13	42.77	34.22	31.43	41.99	47.27	All	On Pk
NEMass/Boston	28.25	32.76	30.19	45.14	27.97	26.84	28.92	38.87	44.13	54.57	52.43	53.23	54.68	51.93	45.00	33.59	39.86	38.06	33.96	64.53	67.04	41.83	33.52	31.04	41.60	46.70		
New Hampshire	27.30	31.78	29.23	43.67	27.10	26.01	28.12	38.15	43.43	53.67	51.42	52.11	53.39	50.76	43.99	32.75	38.87	37.13	33.12	62.87	65.35	40.72	32.35	29.78	40.54	45.63		
Maine	26.49	30.88	28.49	42.63	26.51	25.58	27.82	37.74	42.98	52.96	50.58	51.09	52.25	49.69	42.90	31.91	37.82	36.06	32.16	61.15	63.39	39.28	31.01	28.64	39.58	44.56		
Mass Hub	28.30	32.94	30.38	45.34	28.13	26.92	28.90	38.92	44.19	54.61	52.44	53.17	54.63	51.98	45.16	33.66	39.93	38.19	34.05	64.53	67.18	42.05	33.70	31.10	41.68	46.77		
DA Forecast Load (GW)	10.51	10.05	9.81	9.68	9.86	10.78	12.23	13.49	14.11	14.55	14.76	14.73	14.57	14.48	14.34	14.19	14.12	14.03	14.26	14.51	14.40	13.69	12.64	11.24				
Forecast Error %	8.3%	11.9%	14.8%	15.9%	15.5%	7.6%	1.9%	-1.3%	-0.7%	-1.3%	-1.4%	-1.1%	-0.9%	-1.1%	-1.4%	-2.0%	-2.2%	-1.5%	-3.6%	-1.3%	0.1%	0.0%	-0.5%	2.3%				

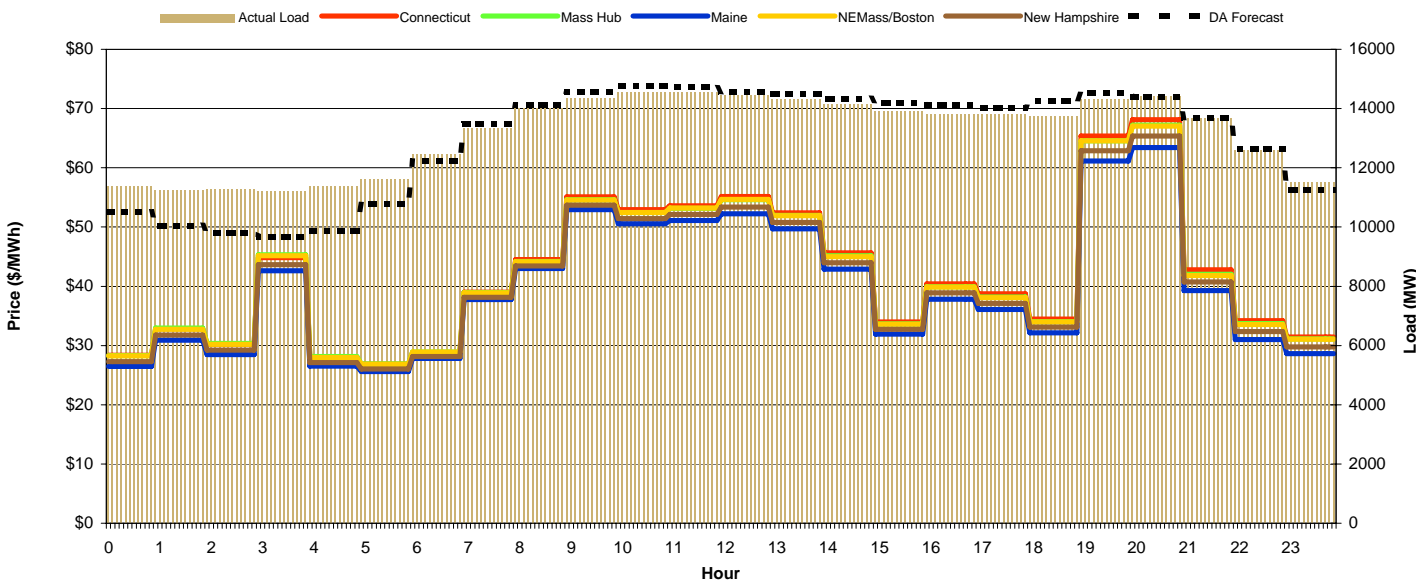




ISO-NE Daily Report

Saturday April 03, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$	
Connecticut	30.18	30.64	30.90	29.63	29.56	24.62	26.67	30.18	31.97	34.58	40.58	39.15	37.56	39.02	36.00	35.45	36.00	34.46	34.46	43.54	39.77	35.41	31.97	29.74	All	On Pk
NEMass/Boston	29.42	29.08	28.88	27.59	27.84	23.99	25.99	29.42	31.16	33.59	39.45	38.04	36.48	37.95	35.09	34.55	35.09	33.59	33.59	42.44	38.76	34.51	31.16	29.48	32.80	35.30
New Hampshire	28.84	25.14	23.01	21.51	23.10	23.52	25.48	28.85	30.55	32.93	38.68	37.30	35.77	37.21	34.40	33.88	34.40	32.93	32.93	41.61	38.01	33.84	30.55	26.78	31.30	34.62
Maine	28.18	24.10	21.75	20.26	22.00	22.98	24.89	28.18	29.84	32.17	37.78	36.43	34.94	36.35	33.61	33.09	33.61	32.17	32.17	40.65	37.12	33.05	29.84	25.89	30.46	33.81
Mass Hub	29.59	29.60	29.60	28.33	28.44	24.13	26.14	29.59	31.34	33.79	39.68	38.26	36.69	38.17	35.29	34.75	35.29	33.83	33.83	42.75	39.05	34.76	31.39	29.75	33.09	35.53
Cleared Load (GW)	10.3	10.3	10.2	10.2	10.2	10.2	10.3	10.7	12.4	13.4	13.2	13.2	12.7	12.2	12.0	12.0	12.0	12.6	12.9	13.3	12.8	12.0	11.3	10.2		

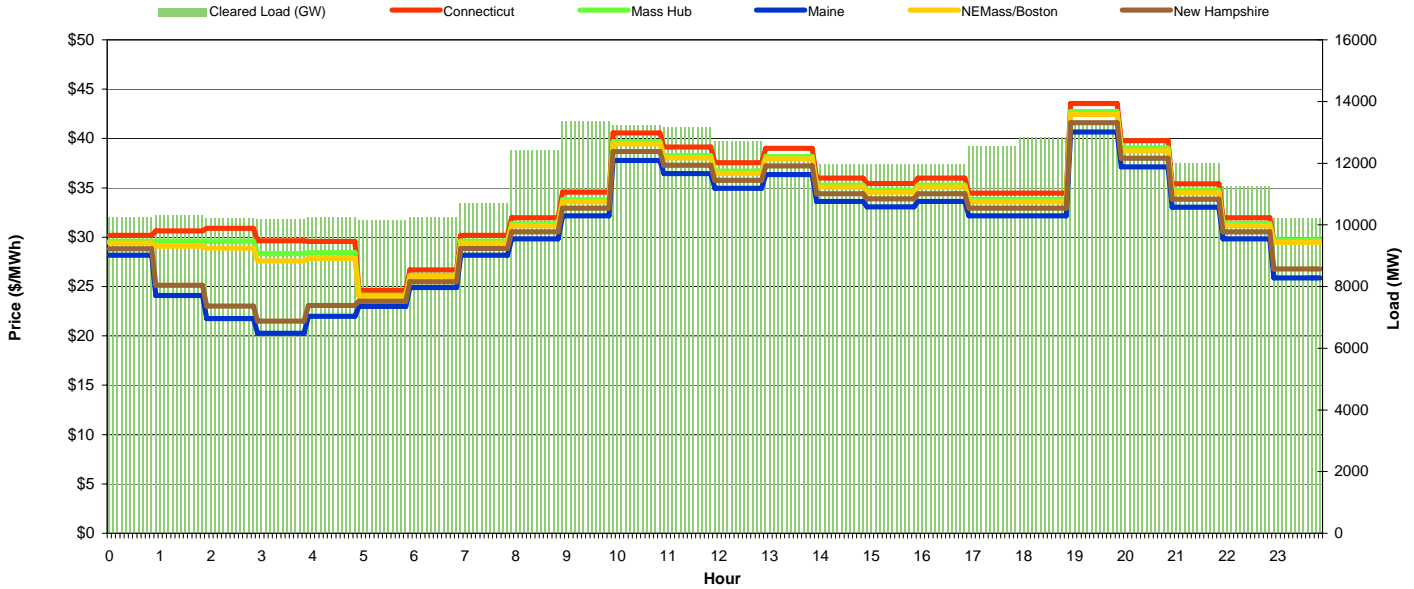

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$	
Connecticut	30.84	28.23	27.59	27.24	26.82	27.21	26.01	25.05	30.07	34.71	40.40	44.55	38.54	37.64	38.65	36.18	37.83	32.05	30.73	39.58	41.90	41.97	36.81	29.40	All	On Pk
NEMass/Boston	30.81	28.18	27.51	27.19	26.77	27.25	26.21	25.28	30.07	34.51	40.11	44.07	38.13	37.12	38.11	35.66	37.20	31.61	30.54	39.43	41.42	41.42	36.54	29.44	33.52	36.33
New Hampshire	29.55	27.04	26.41	26.15	25.76	26.23	25.27	24.42	29.23	33.66	39.11	42.96	37.14	36.17	37.15	34.76	36.30	30.77	29.68	38.35	40.36	40.17	35.22	28.22	32.50	35.34
Maine	28.41	25.90	25.28	25.15	24.87	25.41	24.77	24.04	28.80	33.12	38.35	42.07	36.31	35.38	36.39	33.98	35.51	29.99	29.01	37.42	39.26	38.96	33.96	27.20	31.65	34.53
Mass Hub	30.83	28.30	27.66	27.34	26.92	27.35	26.22	25.19	30.02	34.53	40.10	44.09	38.18	37.19	38.22	35.78	37.35	31.68	30.52	39.29	41.38	41.42	36.50	29.35	33.56	36.34
DA Forecast Load (GW)	10.36	9.83	9.56	9.46	9.51	9.86	10.53	11.35	12.42	13.16	13.42	13.34	13.13	12.82	12.55	12.44	12.50	12.72	12.92	13.65	13.63	12.92	11.87	10.84		
Forecast Error %	4.4%	11.0%	13.8%	13.8%	13.6%	10.9%	5.1%	-0.3%	-0.4%	-0.3%	0.5%	1.3%	1.9%	2.8%	3.4%	3.5%	3.4%	2.5%	1.8%	1.5%	2.9%	3.9%	4.8%	4.2%		

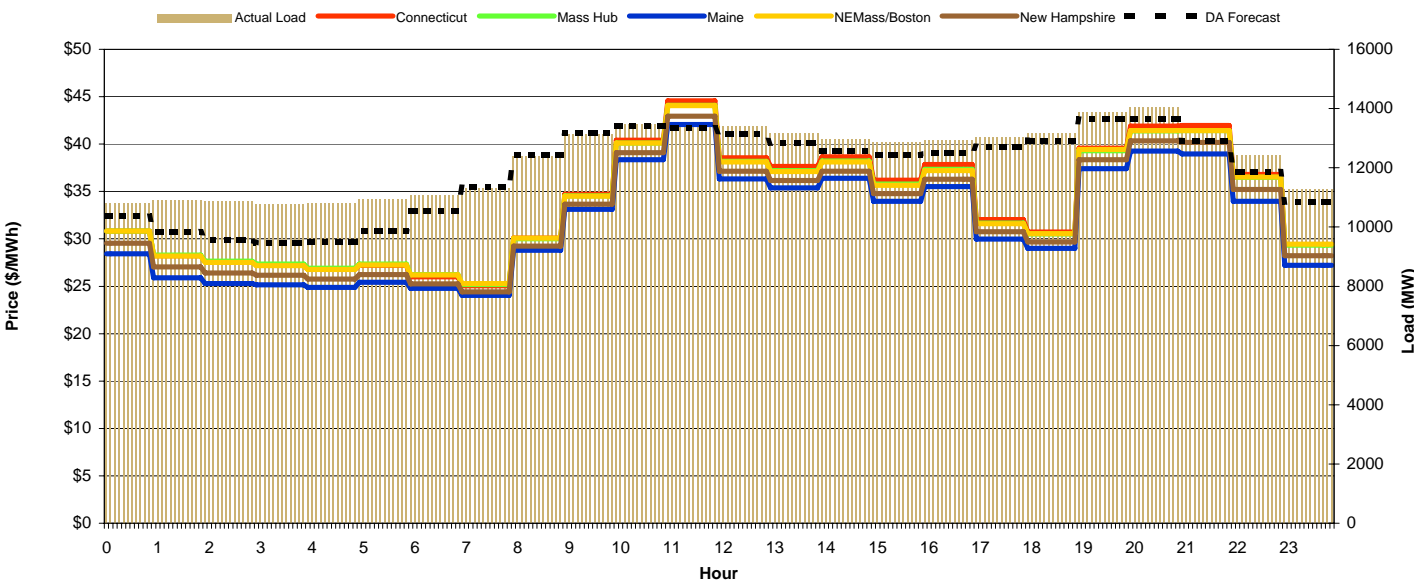




ISO-NE Daily Report

Sunday April 04, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$	
Connecticut	25.61	25.30	25.30	23.37	22.50	22.54	22.54	23.55	30.52	31.87	32.14	34.39	34.44	34.44	32.39	32.39	33.61	33.77	33.90	45.83	42.91	34.00	31.87	28.90	30.75	33.88
NEMass/Boston	25.03	24.73	24.73	22.90	22.17	22.03	22.03	23.02	29.83	31.15	31.41	33.61	33.66	33.66	31.66	31.66	32.85	33.01	33.13	44.79	41.94	33.23	31.15	28.24	30.07	33.11
New Hampshire	24.51	24.21	24.21	22.40	21.39	21.57	21.57	22.54	29.21	30.50	30.76	32.91	32.96	32.96	31.00	31.00	32.16	32.32	32.44	43.86	41.07	32.54	30.50	27.65	29.43	32.42
Maine	23.94	23.65	23.65	21.88	20.86	21.07	21.07	22.02	28.53	29.79	30.28	32.37	32.41	32.39	30.49	30.48	31.62	31.79	31.69	42.84	40.12	31.90	29.88	27.01	28.82	31.79
Mass Hub	25.18	24.87	24.87	22.97	22.24	22.16	22.16	23.16	30.01	31.33	31.60	33.81	33.86	33.86	31.84	31.84	33.04	33.20	33.33	45.06	42.19	33.43	31.34	28.41	30.24	33.31
Cleared Load (GW)	9.8	9.8	9.8	9.7	9.8	9.9	10.1	10.2	11.0	11.8	12.2	12.4	12.4	12.2	11.9	11.9	12.0	12.4	12.9	13.8	13.4	12.0	10.8	9.8		

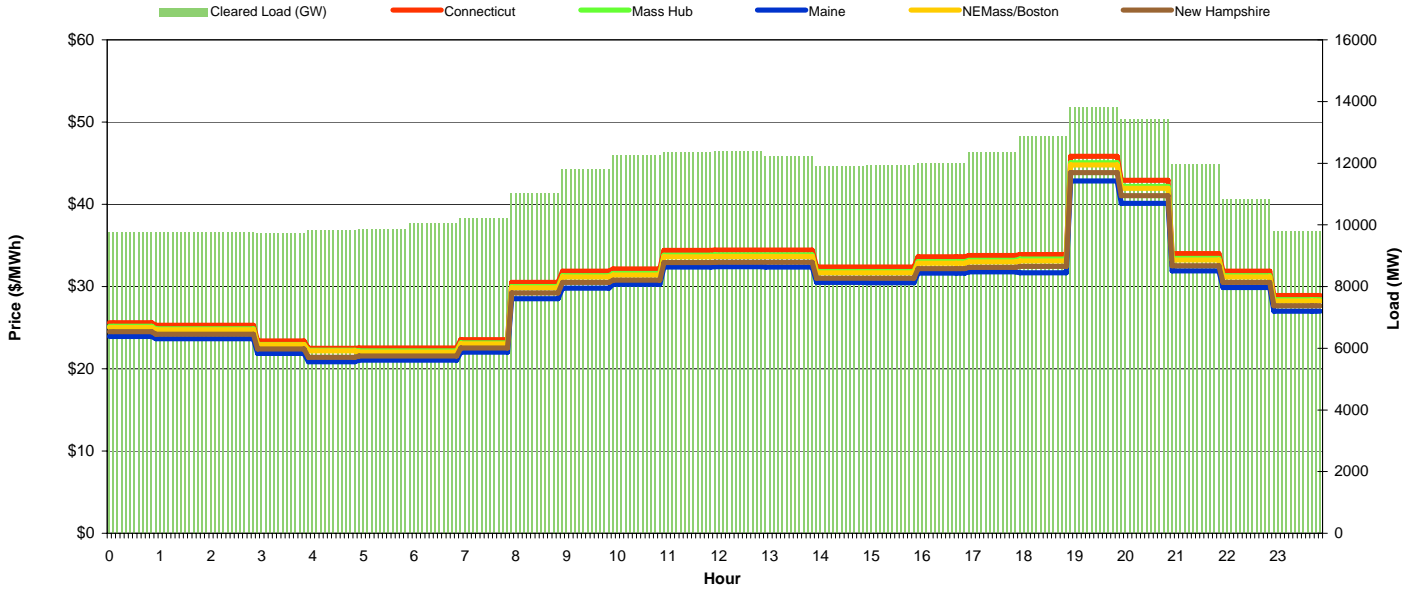

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$	
Connecticut	23.81	25.06	23.04	20.11	24.21	26.25	20.09	22.78	30.42	31.36	32.18	35.39	32.88	30.94	29.31	26.72	26.25	15.30	13.50	32.11	35.81	33.81	34.11	29.99	27.31	28.93
NEMass/Boston	23.74	24.88	22.85	19.92	24.01	26.08	20.08	22.92	30.50	31.26	31.93	35.02	32.52	30.56	29.02	26.59	26.15	15.23	13.52	32.10	35.46	33.35	33.90	29.94	27.15	28.75
New Hampshire	22.73	23.83	21.93	19.14	23.10	25.13	19.35	22.13	29.59	30.39	31.02	34.07	31.59	29.65	28.11	25.67	25.25	14.68	13.06	31.05	34.40	32.27	32.58	28.69	26.23	27.84
Maine	21.85	22.89	21.05	18.33	22.31	24.38	18.77	21.61	28.96	29.60	30.25	33.29	30.84	29.00	27.41	25.02	24.63	14.24	12.70	30.18	33.36	31.33	31.36	27.61	25.46	27.11
Mass Hub	23.72	24.96	22.98	20.05	24.15	26.19	20.12	22.88	30.48	31.26	31.96	35.10	32.58	30.62	29.04	26.54	26.09	15.20	13.48	31.91	35.37	33.35	33.89	29.91	27.16	28.73
DA Forecast Load (GW)	10.14	9.65	9.36	9.25	9.25	9.42	9.68	10.41	11.41	12.17	12.59	12.77	12.74	12.55	12.41	12.35	12.57	12.84	13.06	13.57	14.00	13.17	11.98	10.85		
Forecast Error %	4.8%	8.2%	12.7%	13.4%	11.8%	9.0%	11.1%	6.3%	2.4%	2.3%	1.8%	1.4%	0.8%	-1.0%	-3.2%	-4.4%	-6.4%	-5.7%	-3.0%	-1.4%	-1.8%	-1.0%	-0.6%	-0.7%		

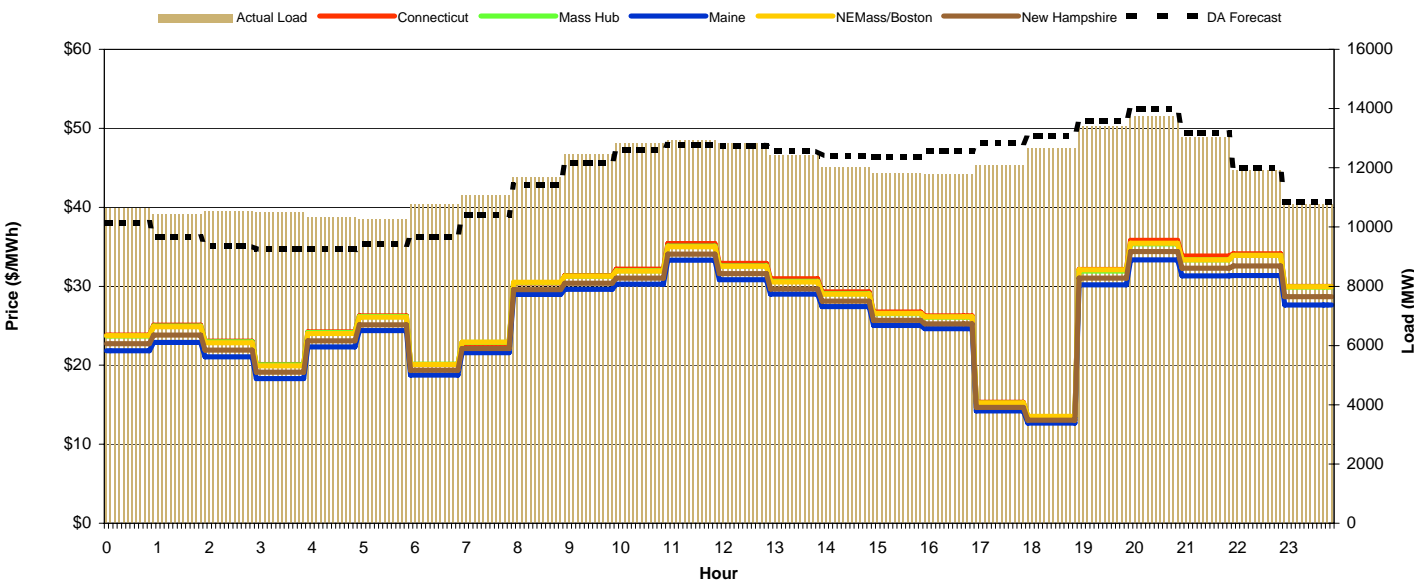




ISO-NE Daily Report

Monday April 05, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	24.59	20.45	22.49	22.69	26.45	28.51	32.22	34.31	37.11	41.41	44.88	43.42	42.56	44.04	46.75	41.62	42.26	46.00	42.56	47.65	44.85	36.00	35.34	29.69	36.58	41.92	All	On Pk
NEMass/Boston	25.44	20.05	23.78	23.82	26.45	27.95	31.59	33.64	36.39	40.60	44.00	42.57	41.73	43.18	45.30	40.80	41.04	44.60	41.73	46.72	43.97	35.30	33.11	29.63	35.97	40.92		
New Hampshire	19.18	19.59	16.85	18.66	24.65	27.30	30.86	32.86	35.55	39.66	42.99	41.59	40.76	42.18	41.88	39.82	38.36	41.35	40.76	45.64	42.96	34.48	25.68	26.72	33.76	39.16		
Maine	18.02	19.13	15.68	17.67	23.93	26.67	30.14	32.10	34.72	38.74	41.98	40.62	39.81	41.20	40.58	38.89	37.24	40.09	39.81	44.58	41.96	33.68	24.18	25.82	32.80	38.14		
Mass Hub	25.68	20.14	23.88	23.83	26.49	28.07	31.72	33.78	36.54	40.77	44.18	42.75	41.90	43.36	45.74	40.97	41.40	45.02	41.90	46.91	44.15	35.44	33.97	29.78	36.18	41.17		
Cleared Load (GW)	9.7	9.7	9.5	9.6	9.7	10.1	11.6	13.3	13.9	14.0	13.9	13.9	13.8	13.8	13.5	13.4	13.5	13.5	14.0	14.5	14.1	12.9	11.6	10.4				

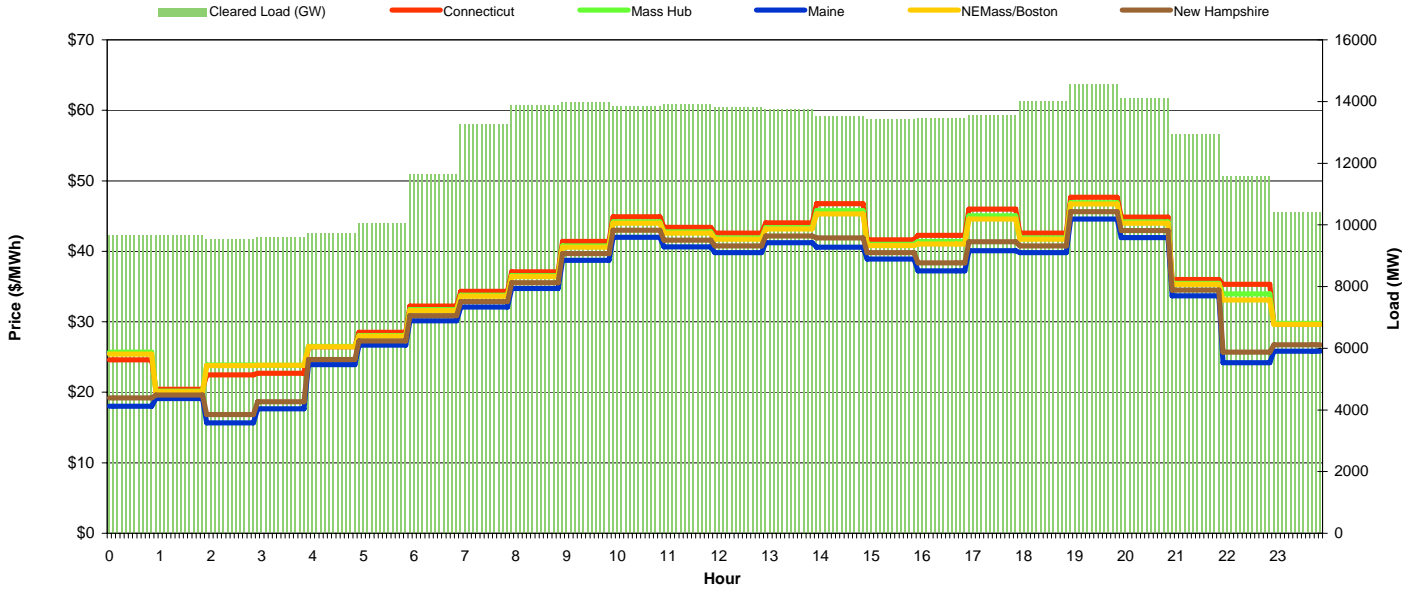

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	25.83	30.18	26.80	20.03	19.60	15.44	28.17	33.24	35.42	45.32	47.26	46.53	44.57	54.35	41.49	44.68	43.96	40.70	39.12	54.44	57.16	37.51	38.59	31.01	37.56	44.02	All	On Pk
NEMass/Boston	25.75	29.97	26.53	19.85	19.45	15.39	28.18	32.59	34.60	44.14	45.91	45.11	43.19	52.91	40.41	43.36	42.52	39.50	37.99	52.86	55.53	36.34	37.78	30.80	36.69	42.80		
New Hampshire	24.71	28.80	25.49	19.07	18.68	14.82	27.27	31.77	33.85	43.17	44.84	44.08	42.20	51.54	39.41	42.26	41.49	38.52	37.06	51.40	53.98	35.34	36.45	29.62	35.66	41.71		
Maine	23.89	27.87	24.68	18.48	18.03	14.39	27.00	31.34	33.35	42.58	44.16	43.45	41.51	50.63	38.63	41.41	40.74	37.77	36.36	50.20	52.64	34.30	35.00	28.51	34.87	40.88		
Mass Hub	25.79	30.08	26.70	19.97	19.58	15.46	28.21	32.81	34.88	44.52	46.32	45.54	43.60	53.30	40.75	43.75	42.96	39.90	38.37	53.34	56.06	36.73	38.05	30.85	36.98	43.18		
DA Forecast Load (GW)	9.95	9.40	9.20	9.12	9.43	10.40	12.17	13.66	14.30	14.61	14.94	14.99	15.00	14.99	14.90	14.75	14.72	14.73	14.91	15.36	15.32	14.31	12.84	11.24				
Forecast Error %	4.3%	6.4%	9.2%	12.7%	11.9%	9.8%	3.0%	0.1%	-0.3%	0.4%	0.6%	1.1%	0.8%	0.8%	0.4%	0.2%	0.0%	0.2%	-1.0%	0.1%	1.3%	0.9%	0.5%	2.0%				

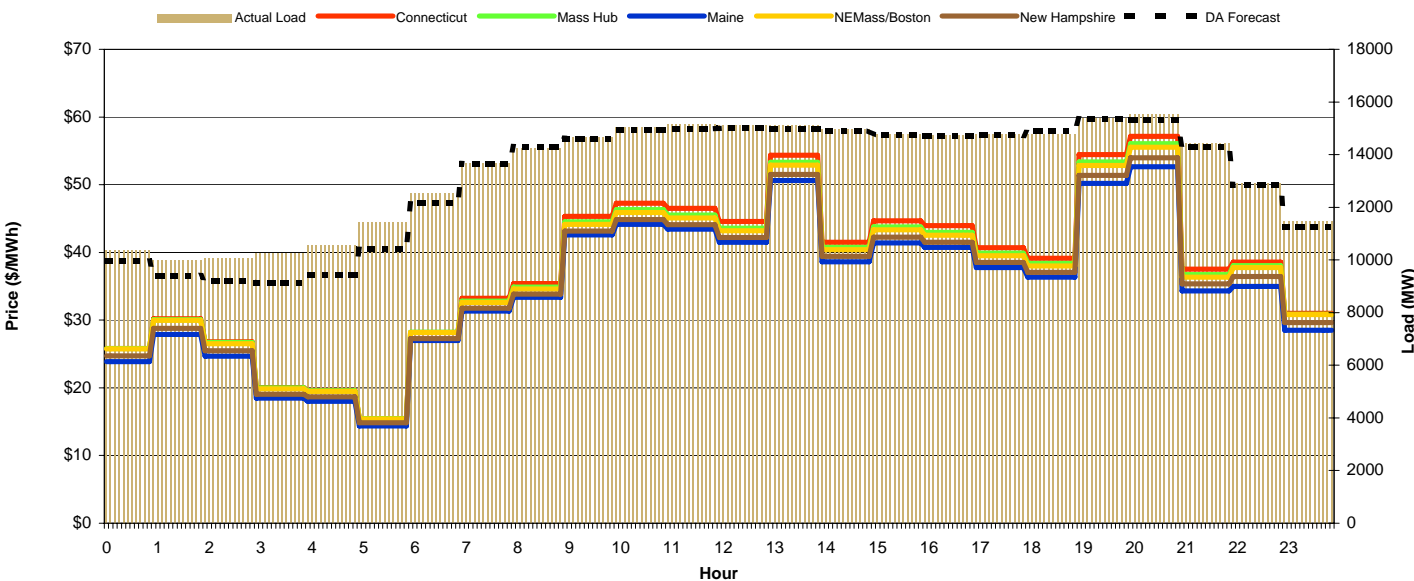




ISO-NE Daily Report

Tuesday April 06, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$				
Connecticut	30.74	31.24	31.04	22.31	23.10	25.19	33.72	34.55	36.33	40.68	41.87	41.05	41.44	43.61	44.62	41.62	43.84	43.64	35.22	45.37	43.19	35.47	32.57	28.62	26.62	36.29	40.32	All	On Pk
NEMass/Boston	29.01	28.65	28.79	21.94	22.72	24.78	33.17	33.85	35.55	40.02	41.19	40.35	40.76	42.76	43.89	40.94	43.12	42.93	34.65	44.43	42.48	34.37	30.94	27.36	35.36	39.51			
New Hampshire	22.95	18.82	20.48	21.37	22.13	24.13	32.31	32.97	34.62	38.98	40.12	39.31	39.71	41.65	42.75	39.88	42.00	41.81	33.75	43.27	41.38	31.25	25.36	23.20	33.09	38.05			
Maine	21.70	17.16	18.98	20.88	21.62	23.57	31.56	32.20	33.81	38.07	39.19	38.39	38.78	40.68	41.76	38.95	41.02	40.84	32.97	42.26	40.42	30.19	24.07	22.15	32.13	37.10			
Mass Hub	29.68	29.71	29.70	22.01	22.79	24.85	33.27	33.94	35.64	40.14	41.31	40.47	40.89	42.88	44.02	41.06	43.25	43.06	34.75	44.54	42.62	34.72	31.55	27.82	35.61	39.68			
Cleared Load (GW)	9.4	9.5	9.6	9.9	9.8	10.3	11.7	13.4	14.1	14.4	14.6	14.6	14.5	14.4	14.5	14.4	14.5	14.5	14.4	14.8	14.5	13.2	11.8	10.5					

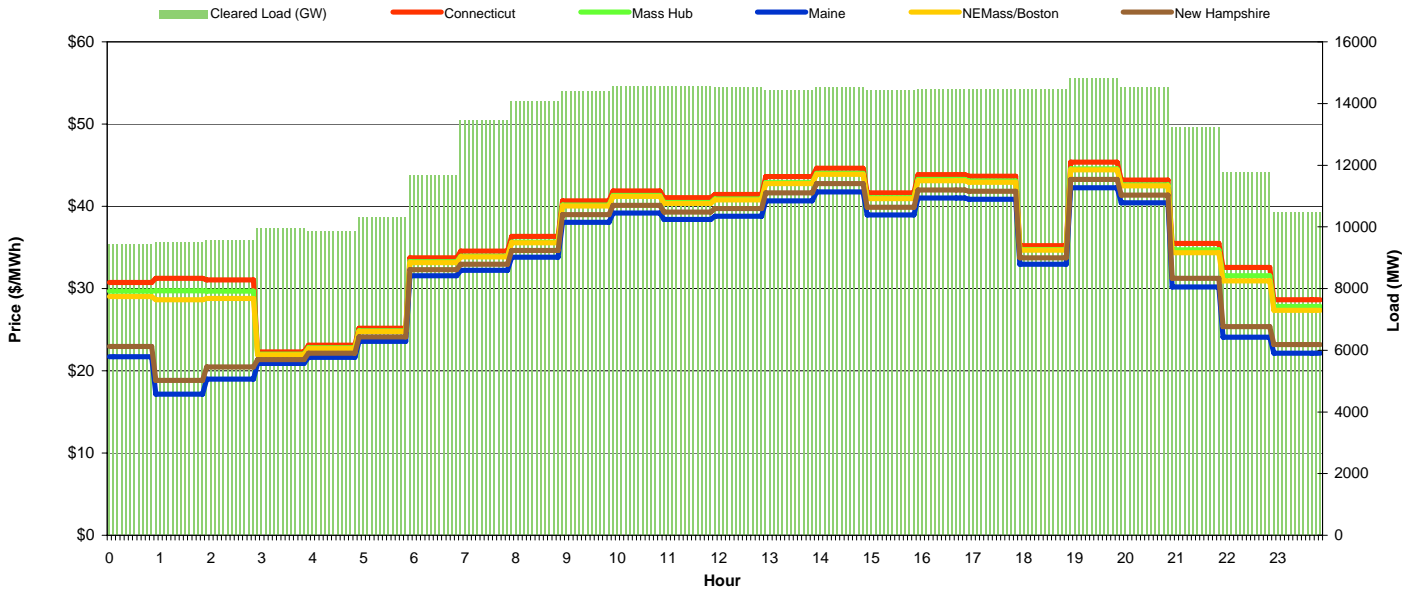

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	29.47	33.30	31.18	24.10	22.54	23.60	37.90	37.69	36.20	43.09	44.41	41.73	43.11	41.89	40.30	37.85	36.37	36.84	35.27	44.36	41.69	38.33	30.27	24.21	35.65	39.34	All	On Pk
NEMass/Boston	29.13	32.75	30.70	23.71	22.14	23.37	37.48	36.59	35.09	41.58	42.71	40.19	41.66	40.32	38.82	36.49	35.06	35.55	34.12	43.17	40.31	36.93	29.50	23.89	34.64	38.01		
New Hampshire	28.04	31.61	29.67	22.93	21.40	22.55	36.30	35.82	34.44	40.69	41.79	39.37	40.72	39.42	37.96	35.67	34.23	34.73	33.40	42.27	39.48	36.08	28.49	23.01	33.75	37.16		
Maine	26.88	30.24	28.42	22.01	20.58	21.86	35.60	34.98	33.64	39.62	40.71	38.45	39.73	38.40	37.03	34.75	33.17	33.58	32.44	41.33	38.70	35.23	27.61	22.46	32.81	36.21		
Mass Hub	29.23	32.98	30.93	23.91	22.34	23.49	37.59	36.93	35.42	41.99	43.16	40.60	42.02	40.70	39.18	36.83	35.40	35.89	34.43	43.45	40.68	37.35	29.69	23.94	34.92	38.36		
DA Forecast Load (GW)	10.29	9.83	9.62	9.52	9.83	10.81	12.66	13.97	14.47	14.84	15.11	15.20	15.21	15.16	15.08	14.99	15.10	15.05	15.09	15.55	15.43	14.41	12.99	11.35				
Forecast Error %	1.9%	6.4%	9.0%	13.4%	11.4%	5.0%	-0.1%	0.1%	0.5%	0.4%	0.4%	0.5%	0.2%	0.4%	-0.1%	-0.5%	-1.6%	-1.0%	-1.0%	-0.9%	-0.3%	-0.7%	-1.1%	2.2%				

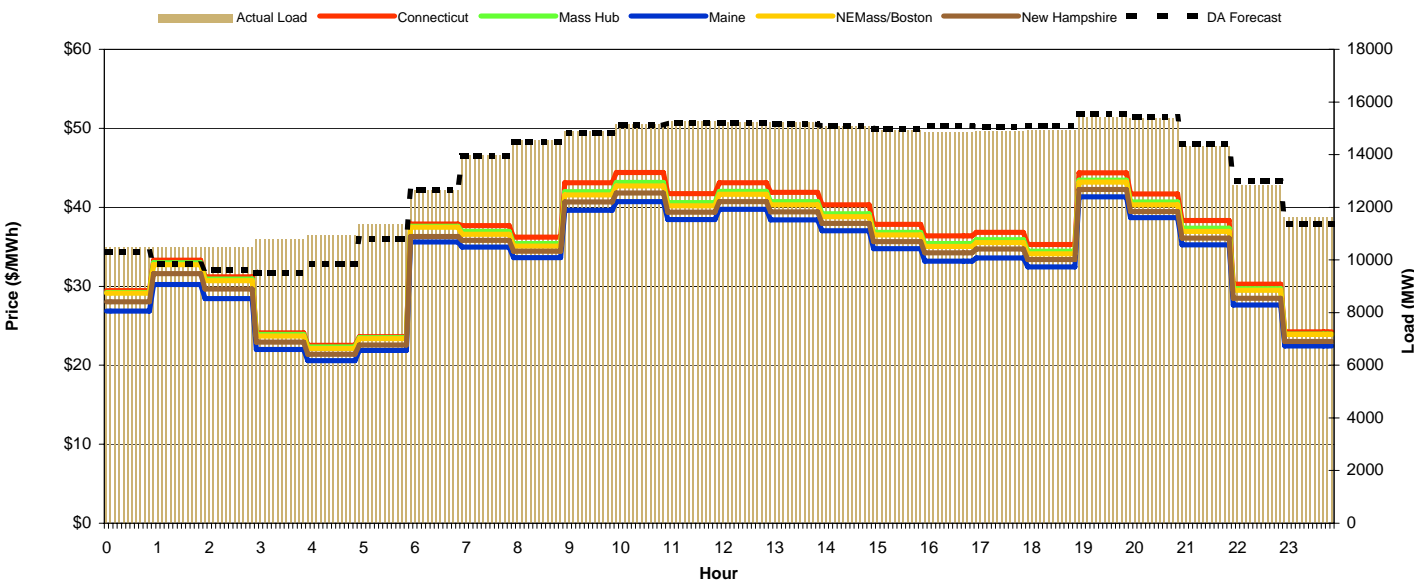




ISO-NE Daily Report

Wednesday April 07, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	29.63	28.44	23.32	26.29	25.87	31.03	34.14	35.79	40.01	40.10	44.94	44.93	46.68	49.42	50.21	47.35	46.93	44.62	41.21	47.55	44.16	39.85	35.00	33.70	38.80	43.67	All	On Pk
NEMass/Boston	29.17	27.83	22.96	25.70	25.48	30.56	33.62	35.24	39.04	39.49	43.16	47.21	47.23	48.67	50.00	47.36	47.34	47.33	47.20	47.22	47.21	38.62	34.98	33.18	38.99	44.21		
New Hampshire	28.15	26.01	22.32	23.86	24.76	29.70	32.67	34.25	37.93	38.38	41.28	42.66	44.24	47.30	48.06	44.87	44.91	42.67	39.37	45.51	42.23	35.65	29.73	32.25	36.62	41.19		
Maine	27.44	24.96	21.81	22.82	24.20	29.02	31.93	33.47	37.06	37.50	40.39	41.66	43.21	46.22	46.95	43.85	43.88	41.67	38.43	44.46	41.24	34.58	28.63	31.51	35.70	40.20		
Mass Hub	29.26	27.99	23.03	25.86	25.55	30.65	33.71	35.34	39.10	39.60	43.68	44.01	45.62	48.80	49.58	46.57	46.35	44.06	40.68	46.96	43.61	38.91	34.19	33.28	38.18	42.94		
Cleared Load (GW)	10.1	10.5	10.8	10.2	10.3	10.5	12.2	14.3	14.8	15.6	16.0	16.4	16.4	16.8	16.8	16.5	16.8	16.4	16.1	16.6	16.4	15.0	12.9	10.7				

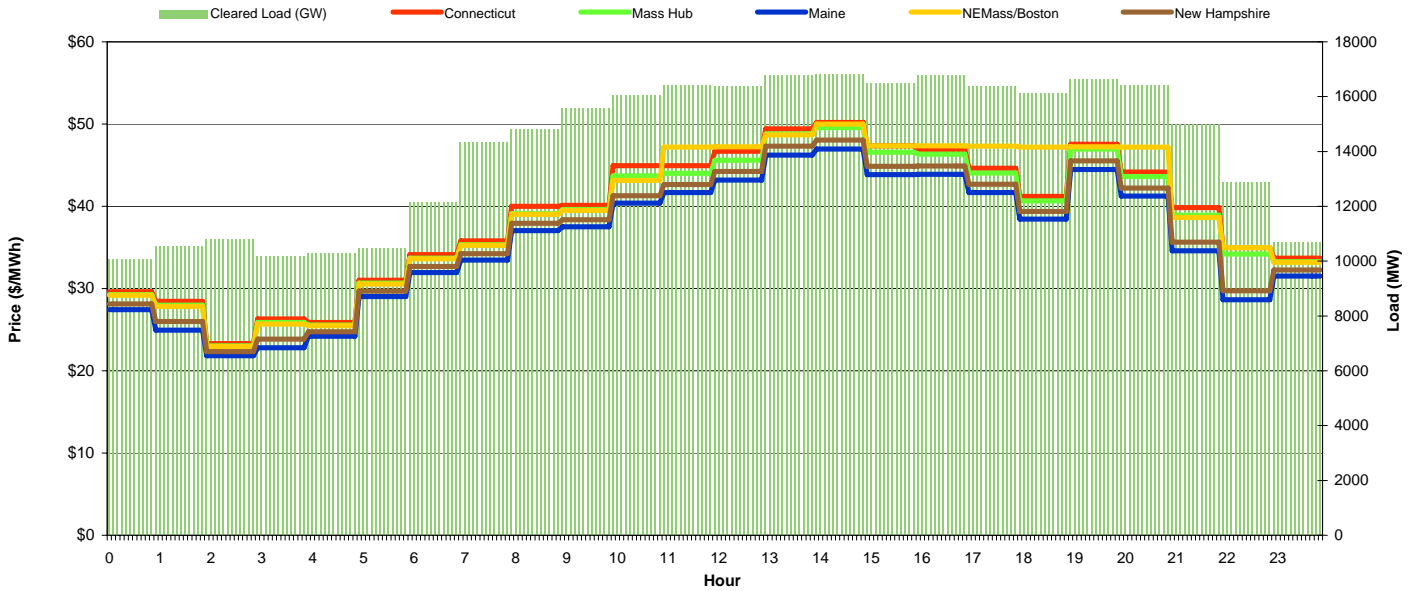

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	21.56	26.17	28.64	30.06	28.12	25.95	30.30	29.41	34.30	34.10	34.81	34.95	34.93	35.13	35.47	35.62	36.69	36.50	35.64	39.03	40.79	36.25	34.21	39.83	33.27	35.49	All	On Pk
NEMass/Boston	21.36	25.91	28.34	29.61	27.85	25.88	30.22	28.99	33.26	32.97	33.60	33.72	33.78	33.97	34.32	34.43	35.40	35.17	34.38	37.79	39.24	34.87	33.37	39.67	32.42	34.33		
New Hampshire	20.79	25.30	27.73	28.95	27.27	25.35	29.78	28.55	32.73	32.42	33.07	33.15	33.23	33.44	33.78	33.93	34.88	34.70	33.88	37.35	38.76	34.24	32.52	38.42	31.84	33.79		
Maine	20.20	24.54	26.98	28.05	26.50	24.65	29.42	28.17	32.10	31.71	32.30	32.31	32.49	32.72	33.00	33.21	34.05	33.80	33.08	36.93	38.29	33.45	31.25	37.08	31.10	33.05		
Mass Hub	21.39	26.01	28.47	29.79	27.99	25.94	30.23	29.10	33.52	33.20	33.83	33.93	34.00	34.19	34.48	34.59	35.60	35.42	34.59	37.98	39.54	35.16	33.44	39.50	32.58	34.54		
DA Forecast Load (GW)	10.39	9.93	9.69	9.64	9.93	10.85	12.69	14.12	14.75	15.30	15.70	15.98	16.10	16.30	16.36	16.19	16.11	15.86	15.57	15.65	16.12	15.12	13.54	12.12				
Forecast Error %	5.8%	10.3%	12.3%	10.0%	10.2%	6.3%	1.1%	-1.6%	-2.8%	-4.1%	-4.1%	-3.4%	-3.1%	-3.2%	-3.1%	-2.1%	-1.7%	-0.5%	0.2%	2.6%	0.8%	0.3%	0.1%	-0.7%				

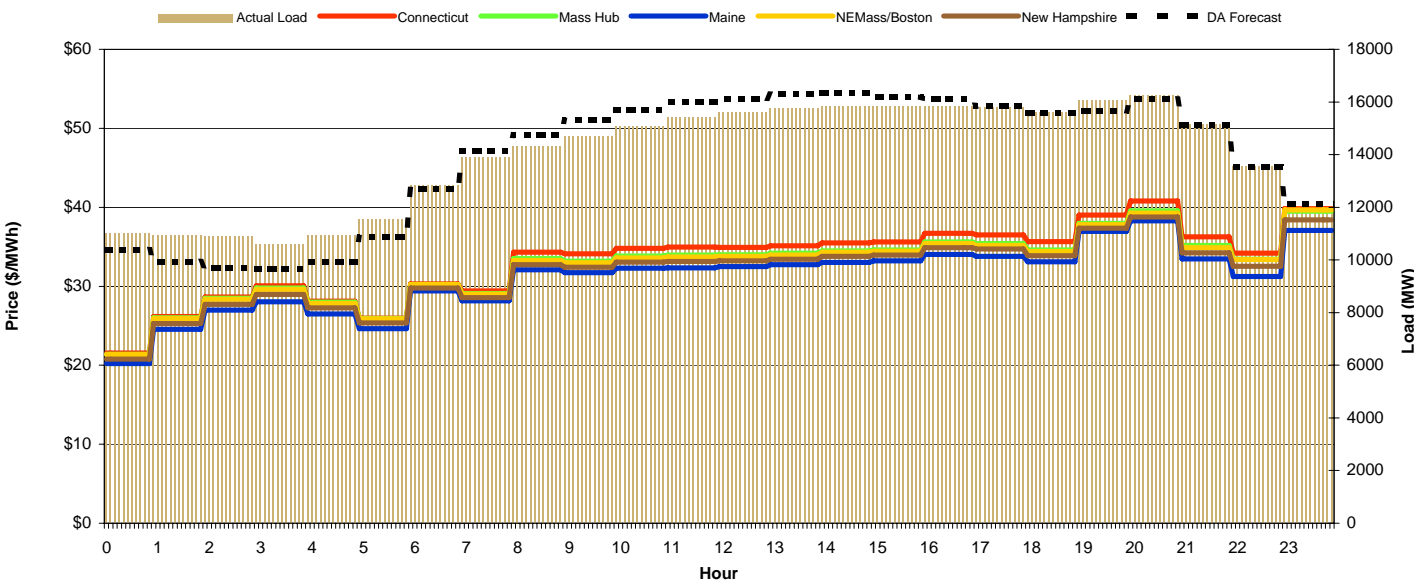




ISO-NE Daily Report

Thursday April 08, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	28.18	27.83	26.20	23.51	24.84	28.86	36.16	37.45	40.65	41.58	44.43	44.34	43.26	43.12	42.91	43.30	42.29	40.44	39.29	42.84	42.35	37.38	39.10	33.71	37.25	41.55	All	On Pk
NEMass/Boston	27.76	27.41	25.81	23.15	24.47	28.42	35.62	36.89	40.04	40.96	43.76	43.67	42.61	42.47	42.26	42.65	41.65	39.83	38.71	42.20	41.72	36.82	37.41	33.21	36.65	40.85		
New Hampshire	26.98	26.64	25.08	22.50	23.78	27.62	34.62	35.85	38.91	39.81	43.17	42.44	41.41	41.27	41.07	41.45	40.48	38.71	37.62	41.01	40.54	35.79	31.89	32.27	35.45	39.46		
Maine	26.34	26.01	24.49	21.97	23.22	26.97	33.80	35.00	37.99	38.86	45.00	41.44	40.43	40.30	40.10	40.46	39.52	37.79	36.72	40.04	39.58	34.94	30.53	31.51	34.71	38.67		
Mass Hub	27.85	27.50	25.89	23.23	24.55	28.51	35.73	37.01	40.15	41.08	43.89	43.80	42.74	42.60	42.39	42.77	41.78	39.96	38.83	42.33	41.85	36.94	38.07	33.31	36.78	41.01		
Cleared Load (GW)	10.1	10.2	9.9	10.3	10.1	10.2	11.6	13.3	13.9	14.4	14.7	14.8	14.7	14.9	14.7	14.5	14.5	14.6	14.5	15.3	14.8	13.4	11.1	10.3				

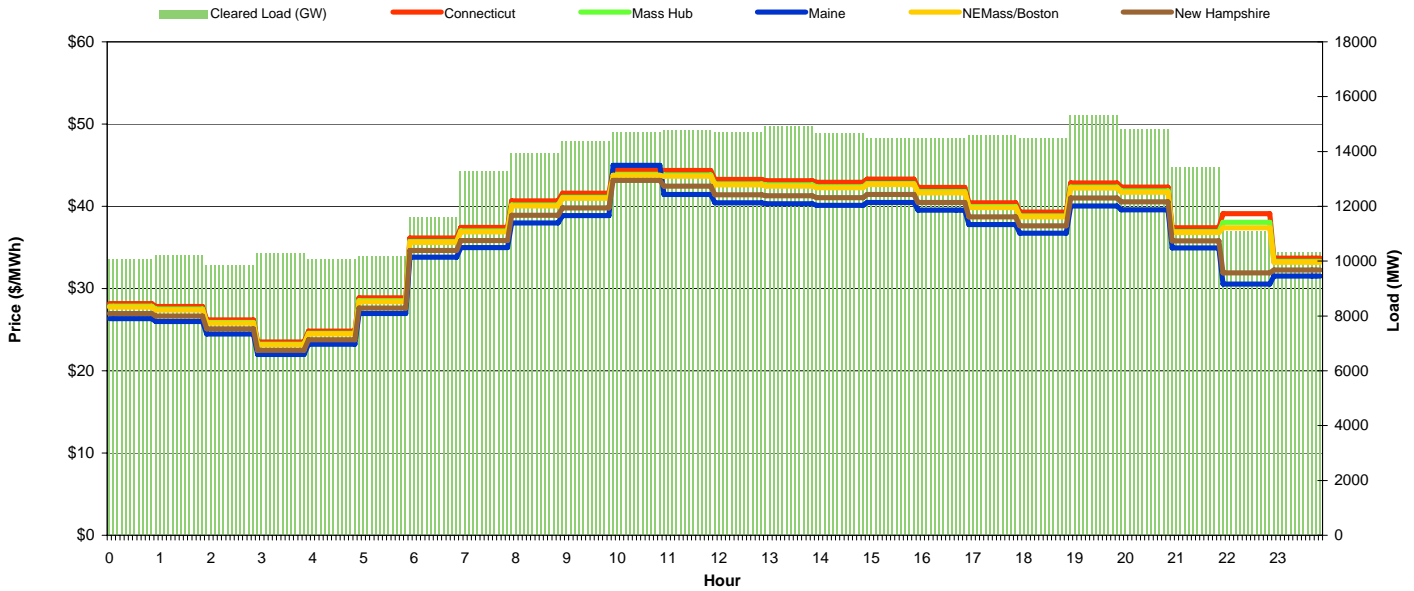

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	34.11	32.49	32.89	30.55	30.80	35.10	35.48	39.24	38.18	38.20	40.52	41.74	42.86	43.46	41.02	40.17	40.98	40.18	35.51	37.85	48.58	40.85	41.57	38.96	38.39	40.68	All	On Pk
NEMass/Boston	33.86	32.18	32.58	30.22	30.49	34.85	34.87	38.08	36.69	36.72	38.99	40.17	41.17	41.65	39.18	38.42	39.20	38.57	34.27	36.80	47.05	39.26	40.52	38.61	37.27	39.17		
New Hampshire	32.82	31.23	31.66	29.38	29.65	33.87	34.16	37.46	36.10	35.90	38.02	39.12	40.00	40.49	38.12	37.44	38.21	37.64	33.43	35.73	45.94	38.41	38.98	37.12	36.29	38.19		
Maine	31.58	30.09	30.51	28.26	28.58	32.82	33.68	36.53	35.14	34.72	36.65	37.70	38.56	39.04	36.74	36.27	36.86	36.33	32.21	34.38	45.07	37.82	37.22	35.72	35.10	36.95		
Mass Hub	33.75	32.14	32.60	30.26	30.52	34.80	34.95	38.36	37.08	37.07	39.34	40.53	41.57	42.10	39.63	38.82	39.62	38.94	34.53	36.92	47.31	39.66	40.62	38.49	37.48	39.51		
DA Forecast Load (GW)	11.18	10.60	10.20	10.05	10.23	11.18	12.98	14.29	14.93	15.33	15.60	15.66	15.59	15.50	15.36	15.36	15.29	15.27	15.62	15.59	14.56	13.13	11.65					
Forecast Error %	-1.7%	-0.4%	3.5%	6.0%	3.3%	-1.7%	-2.2%	-1.8%	-2.0%	-2.2%	-1.8%	-1.2%	-0.9%	-0.9%	-1.3%	-1.7%	-2.4%	-2.2%	-2.5%	-1.6%	-1.2%	-1.2%	-1.6%	-1.1%				

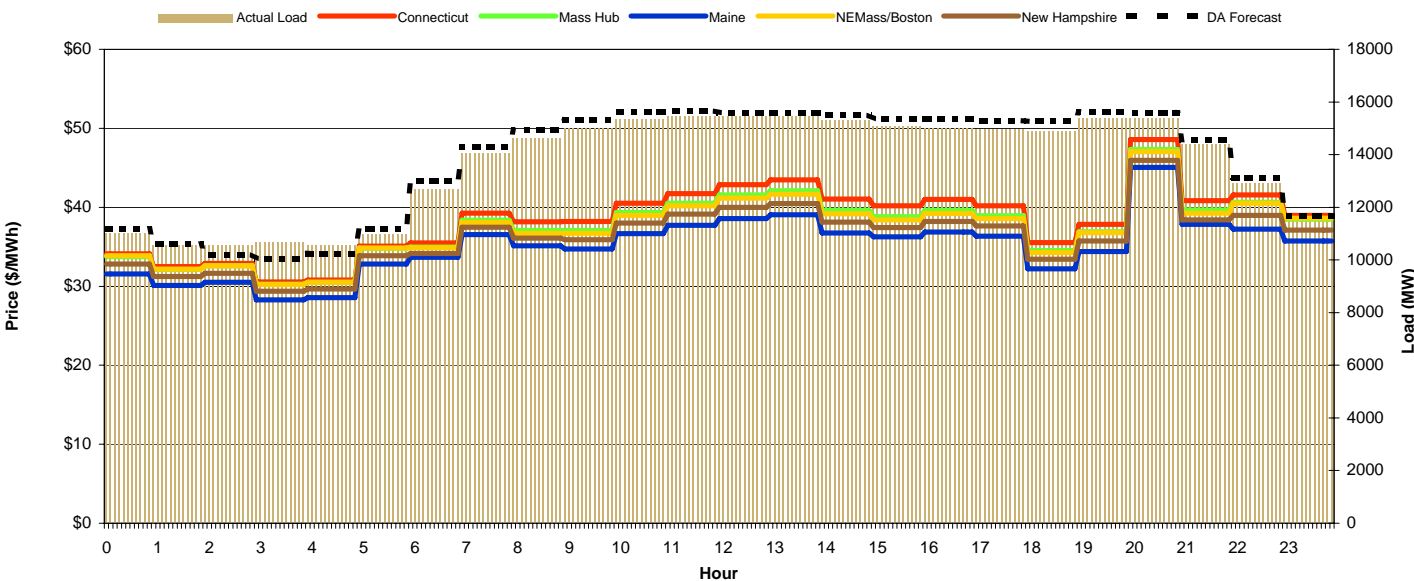




ISO-NE Daily Report

Friday April 09, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	30.04	29.74	30.08	30.13	30.38	30.72	35.00	37.46	36.46	39.87	40.57	40.22	40.05	40.37	38.74	37.52	38.55	34.43	34.18	36.31	40.95	33.74	31.12	30.21	35.29	37.53	All	On Pk
NEMass/Boston	29.58	29.28	29.55	29.51	29.91	30.25	34.48	36.81	35.87	38.67	39.51	39.49	38.86	38.20	37.17	36.16	36.59	33.86	33.65	35.75	39.12	33.22	30.00	29.75	34.39	36.43		
New Hampshire	28.77	28.49	28.34	27.77	29.02	29.43	33.58	35.44	34.68	35.34	36.66	37.85	35.13	32.14	31.65	31.55	31.55	32.77	32.74	34.78	32.92	32.32	26.41	28.94	32.01	33.37		
Maine	28.06	27.78	27.47	26.70	28.29	28.70	32.64	34.36	33.72	34.07	35.42	36.72	33.78	30.59	30.15	30.18	30.17	31.94	31.93	33.92	31.48	31.52	25.42	28.23	30.97	32.21		
Mass Hub	29.68	29.38	29.68	29.68	30.01	30.35	34.59	36.97	36.01	39.03	39.83	39.68	39.27	38.82	37.77	36.66	37.12	33.99	33.77	35.87	39.82	33.33	30.41	29.85	34.65	36.77		
Cleared Load (GW)	9.8	10.0	10.1	10.0	9.9	10.1	11.8	13.3	13.7	14.0	14.1	14.2	14.0	13.8	13.6	13.6	13.7	13.8	13.8	14.3	13.5	12.7	11.7	10.6				

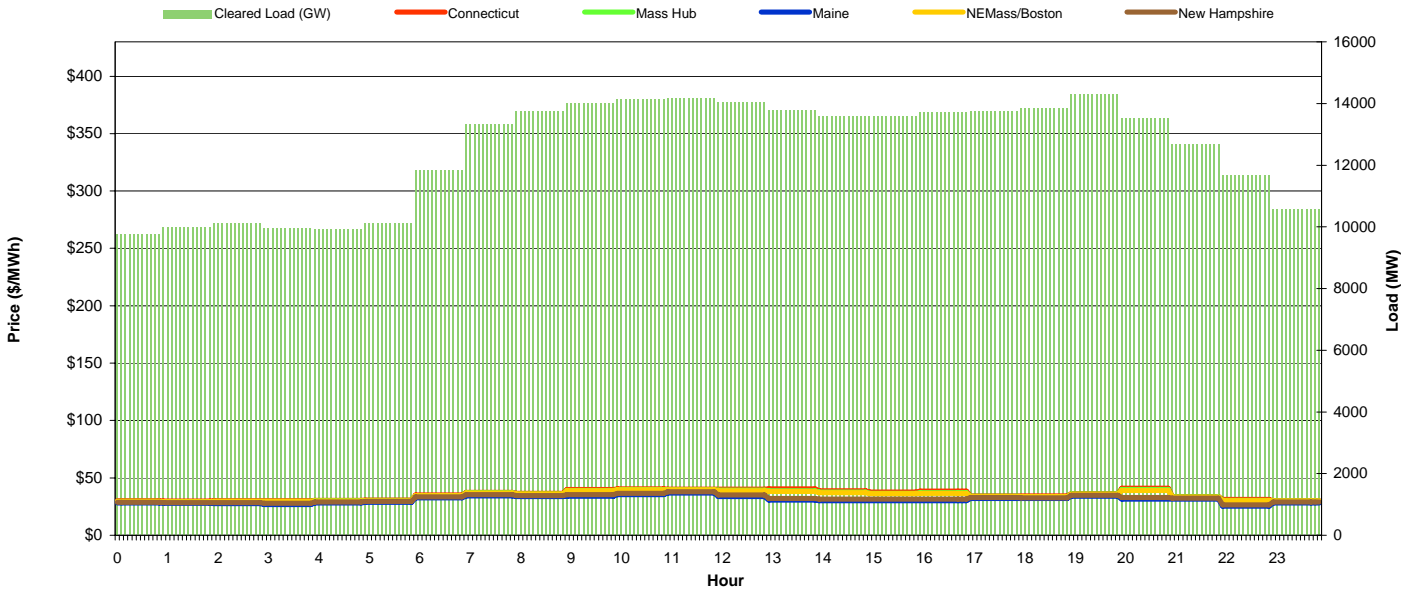

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	30.99	25.28	30.77	26.92	29.04	31.14	37.38	41.74	42.61	42.05	44.84	46.17	42.01	42.37	36.15	35.71	37.12	37.09	35.08	37.09	38.42	33.42	33.38	30.36	36.13	39.08	All	On Pk
NEMass/Boston	30.77	25.14	30.57	26.71	28.92	31.06	36.70	40.26	40.80	40.30	129.25	418.24	310.61	233.31	206.65	239.35	36.06	36.11	34.33	36.18	37.25	32.55	32.48	30.03	89.32	118.98		
New Hampshire	29.72	24.32	29.60	25.85	27.98	30.03	35.74	39.40	39.97	39.16	39.30	38.30	35.92	36.71	31.68	31.37	35.08	35.05	33.38	35.11	36.11	31.60	31.45	29.20	33.42	35.60		
Maine	28.46	23.34	28.32	24.74	26.89	28.60	33.87	36.86	37.36	36.35	31.69	30.15	29.37	30.14	27.39	27.31	33.33	33.24	31.98	33.32	33.99	29.83	29.65	27.97	30.59	32.00		
Mass Hub	30.69	25.12	30.61	26.74	28.90	31.00	36.78	40.58	41.24	40.71	43.19	42.87	39.56	40.26	34.14	33.92	36.28	36.27	34.40	36.29	37.44	32.69	32.67	30.05	35.10	37.66		
DA Forecast Load (GW)	10.55	10.02	9.77	9.74	10.00	10.99	12.82	14.19	14.75	14.98	15.21	15.20	15.05	14.95	14.75	14.59	14.56	14.63	14.46	14.73	14.71	13.87	12.77	11.52				
Forecast Error %	0.1%	6.8%	13.0%	10.1%	6.7%	0.9%	-1.1%	-0.5%	-0.3%	0.3%	0.3%	0.9%	1.0%	0.9%	1.1%	1.2%	1.8%	1.8%	2.9%	2.2%	0.8%	0.9%	0.8%	0.9%				

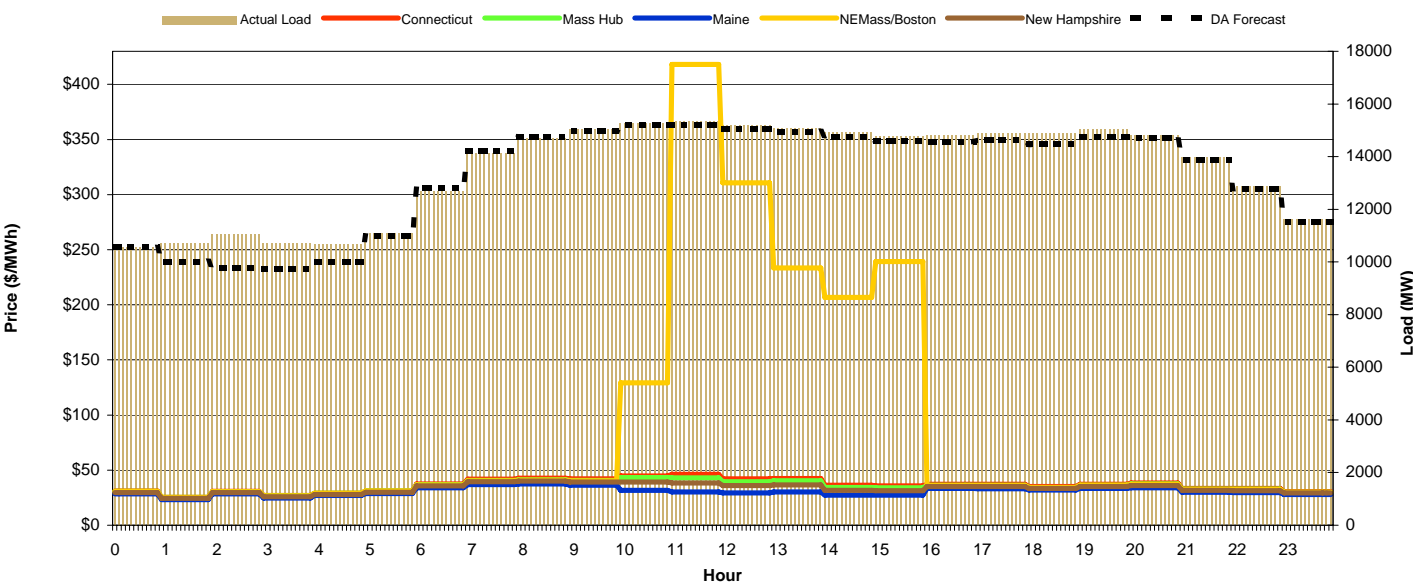




ISO-NE Daily Report

Saturday April 10, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$	
Connecticut	32.40	29.84	30.14	27.53	29.34	33.95	33.83	34.80	40.86	45.31	44.71	45.44	42.00	40.55	39.00	39.62	42.98	41.10	42.00	47.05	56.22	48.00	42.44	44.98	39.75	43.26
NEMass/Boston	32.80	29.87	29.59	27.07	28.85	33.39	33.27	33.24	39.38	43.56	43.00	43.00	39.62	37.59	35.74	36.00	39.07	38.35	39.31	44.98	52.47	44.77	38.14	42.37	37.73	40.51
New Hampshire	27.90	26.80	27.37	26.17	28.07	32.48	32.36	28.01	35.13	35.38	35.16	31.89	29.41	25.19	22.38	20.98	22.15	26.74	27.76	36.91	36.17	31.26	20.13	30.59	29.02	29.04
Maine	27.00	26.00	26.52	25.46	27.33	31.62	31.51	26.69	33.78	33.54	33.36	29.75	27.43	23.01	20.14	18.56	19.47	24.64	25.64	35.04	33.26	28.82	17.34	28.38	27.26	26.90
Mass Hub	32.28	29.62	29.69	27.17	28.96	33.51	33.39	33.82	39.89	44.77	44.16	44.51	40.92	39.07	37.27	37.71	41.08	39.77	40.73	46.50	55.36	46.91	40.34	43.93	38.81	42.05
Cleared Load (GW)	9.8	9.9	9.9	9.9	9.6	9.5	10.1	11.3	12.7	13.4	13.7	13.5	13.1	12.9	12.6	12.4	12.4	12.4	12.7	13.7	13.1	12.3	11.8	10.0		

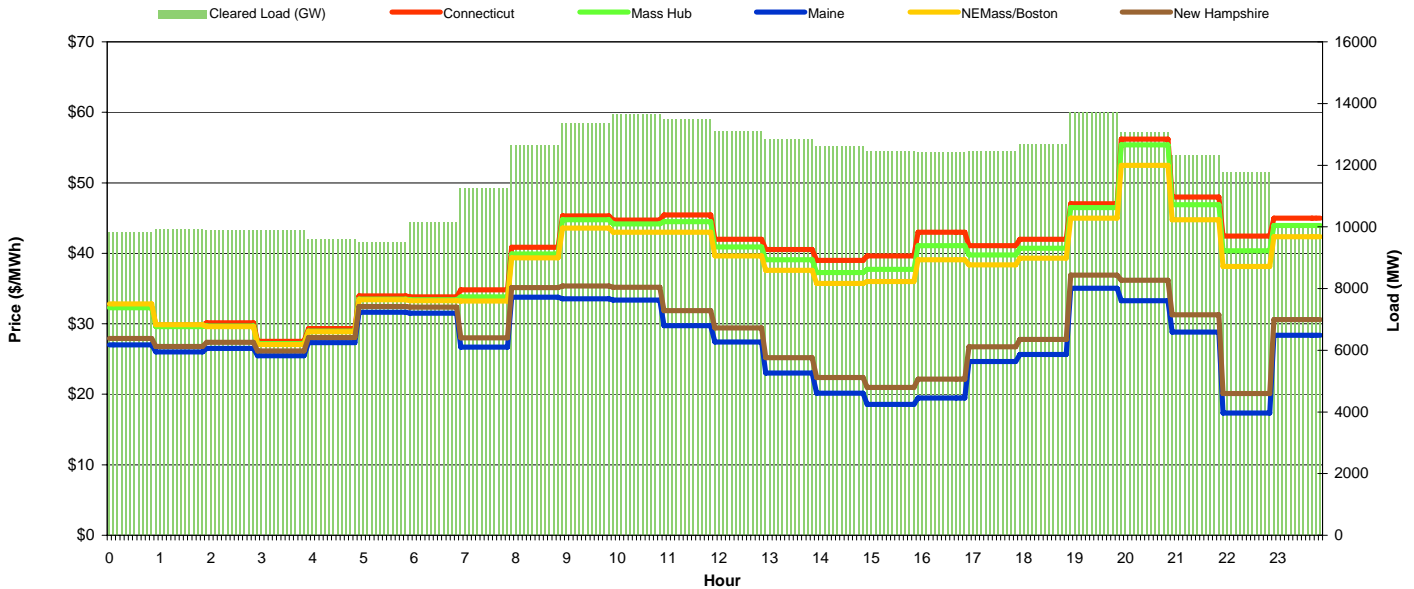

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$	
Connecticut	32.15	30.24	31.54	32.58	30.34	48.43	32.77	30.96	33.25	38.18	40.72	37.56	34.63	33.44	32.82	33.13	33.30	32.10	31.67	34.86	39.01	52.08	47.08	29.53	35.93	36.55
NEMass/Boston	31.72	30.06	31.31	32.37	30.15	48.03	32.23	30.28	32.33	36.91	39.44	36.34	33.63	32.50	31.82	31.98	32.13	31.10	30.70	33.82	37.49	49.91	44.94	38.10	34.97	35.33
New Hampshire	30.83	29.11	30.37	31.45	29.28	46.66	31.36	29.35	31.35	35.89	38.34	35.39	32.59	31.47	30.72	30.86	31.02	29.95	29.50	32.54	36.05	48.29	43.70	36.98	33.88	34.19
Maine	29.54	27.70	28.83	30.04	28.06	44.88	29.98	27.85	29.69	33.99	36.41	33.74	30.82	29.81	28.89	28.96	29.11	28.05	27.66	30.66	33.80	44.99	40.99	34.89	32.06	32.21
Mass Hub	31.73	29.99	31.31	32.38	30.12	47.97	32.25	30.33	32.42	37.05	39.56	36.51	33.70	32.57	31.88	32.08	32.25	31.15	30.73	33.81	37.53	50.01	45.18	38.21	35.03	35.42
DA Forecast Load (GW)	10.61	10.10	9.87	9.78	9.83	10.25	10.92	11.80	12.88	13.46	13.61	13.52	13.22	12.87	12.48	12.35	12.42	12.53	12.68	13.34	13.68	13.05	12.16	11.09		
Forecast Error %	1.0%	5.4%	7.8%	10.1%	5.2%	1.5%	-0.6%	0.4%	0.5%	1.3%	2.0%	2.2%	2.6%	2.9%	3.9%	3.5%	2.8%	2.8%	2.6%	1.7%	2.1%	2.3%	1.8%	2.3%		

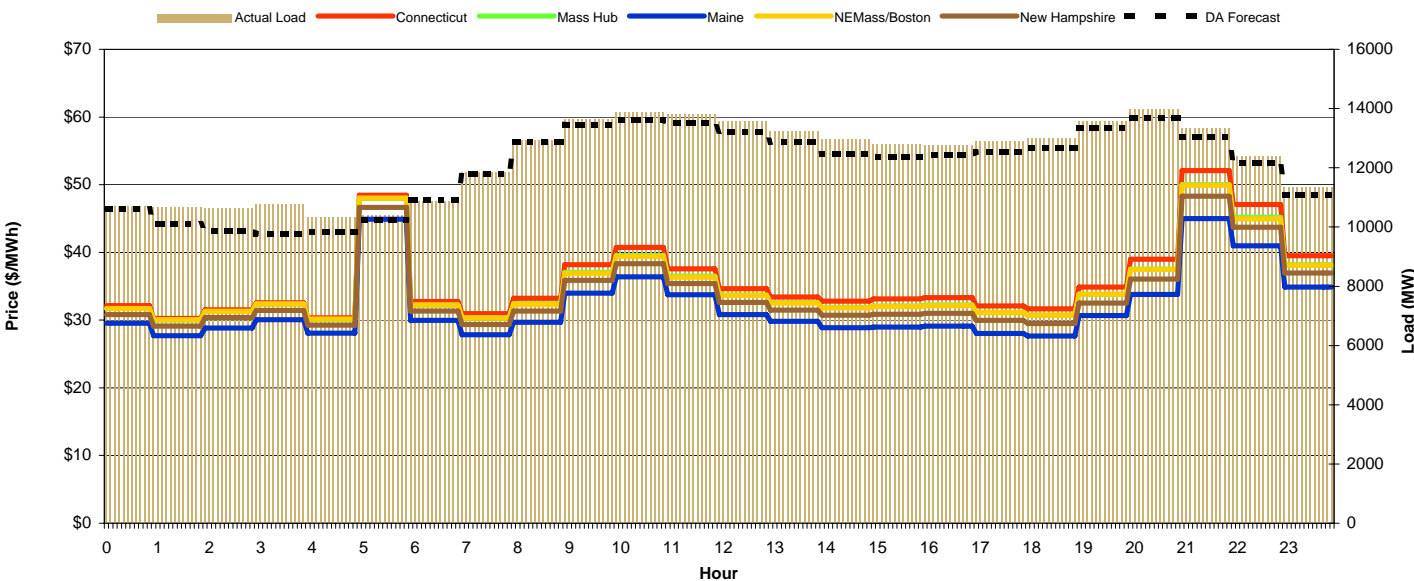




ISO-NE Daily Report

Sunday April 11, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	32.24	34.60	33.27	35.19	31.64	31.35	31.15	31.68	33.87	35.29	38.34	38.17	39.00	35.56	34.45	34.17	34.43	35.29	35.29	48.51	48.91	42.62	34.26	32.32	35.90	37.49	All	On Pk
NEMass/Boston	31.66	33.36	31.51	32.62	30.15	30.78	30.59	31.11	33.26	34.66	37.55	37.32	37.72	34.42	33.46	33.25	33.46	34.66	34.66	47.58	48.01	40.77	33.65	31.74	34.91	36.60		
New Hampshire	30.78	29.68	25.50	23.12	25.22	29.93	29.74	30.24	32.34	33.69	36.52	35.83	34.56	31.39	30.98	30.97	31.08	33.69	33.69	46.26	46.68	35.22	32.71	30.86	32.53	34.74		
Maine	29.84	28.40	24.01	21.23	23.89	29.02	28.83	29.32	31.35	32.67	35.41	34.68	33.21	30.15	29.82	29.84	29.93	32.67	32.67	44.85	45.26	33.56	31.72	29.92	31.34	33.57		
Mass Hub	31.78	33.77	32.17	33.63	30.69	30.90	30.70	31.23	33.39	34.79	37.67	37.50	38.06	34.79	33.76	33.52	33.76	34.79	34.79	47.76	48.20	41.44	33.78	31.86	35.20	36.83		
Cleared Load (GW)	9.3	9.6	9.6	9.5	9.3	9.2	9.2	9.8	11.0	11.8	12.2	12.2	12.1	11.9	11.7	11.6	11.9	12.2	12.6	13.9	13.8	12.4	11.0	9.8				

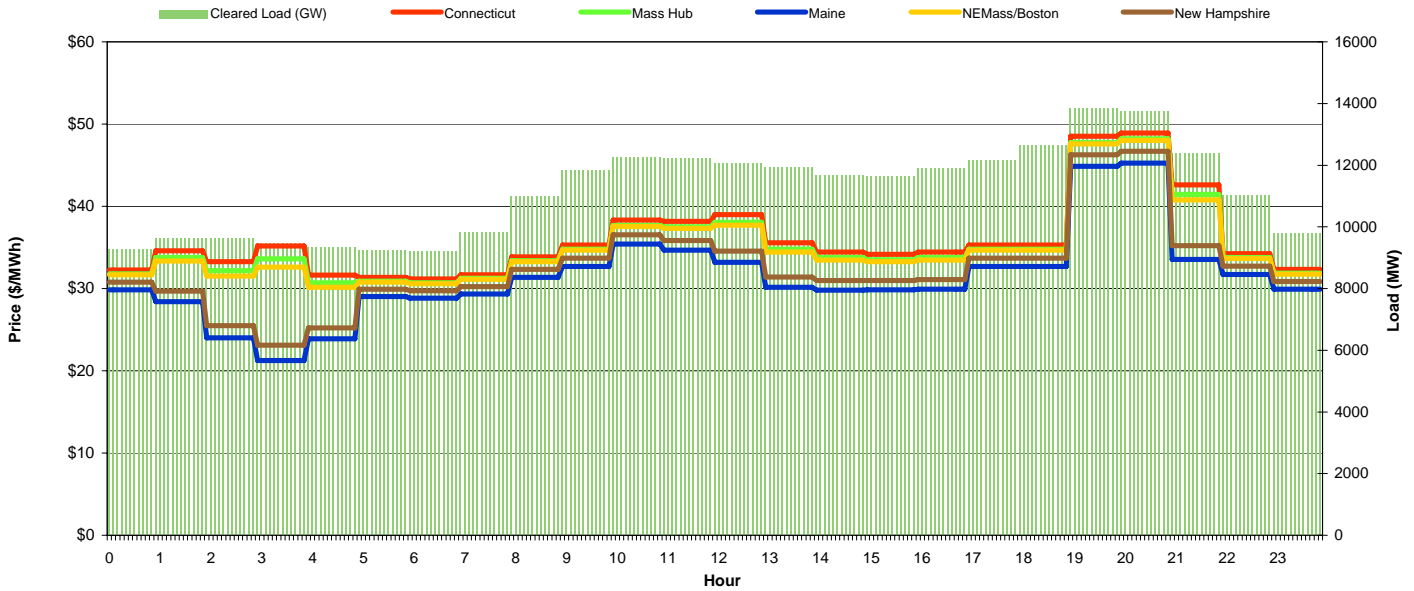

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	34.14	33.92	37.09	43.72	33.53	34.39	32.84	32.94	33.28	34.10	42.79	38.97	46.06	42.84	34.23	33.62	33.11	36.45	34.74	52.53	52.91	44.81	46.47	37.42	38.62	39.99	All	On Pk
NEMass/Boston	33.39	33.33	36.36	42.63	32.72	33.52	32.05	32.08	32.33	32.99	41.30	37.65	44.47	41.25	33.19	32.69	32.21	35.32	33.63	51.01	51.29	43.26	45.15	36.71	37.52	38.74		
New Hampshire	32.31	32.30	35.23	41.36	31.67	32.42	30.94	30.92	31.26	31.88	39.97	36.38	42.93	39.88	32.06	31.46	31.01	34.14	32.58	49.43	49.62	41.76	43.82	35.50	36.28	37.44		
Maine	30.75	30.71	33.46	39.26	30.14	30.94	29.80	29.67	30.09	30.56	38.32	34.79	41.01	38.04	30.61	30.01	29.59	32.63	31.32	47.65	47.69	39.88	42.00	34.00	34.71	35.87		
Mass Hub	33.38	33.37	36.49	42.85	32.86	33.64	32.12	32.17	32.43	33.08	41.44	37.71	44.51	41.34	33.19	32.65	32.16	35.34	33.65	50.91	51.20	43.30	45.16	36.63	37.57	38.77		
DA Forecast Load (GW)	10.34	9.82	9.55	9.43	9.40	9.61	9.99	10.77	11.77	12.45	12.76	12.90	12.89	12.72	12.46	12.44	12.61	12.83	13.02	13.55	13.91	13.02	11.86	10.70				
Forecast Error %	1.1%	7.1%	13.5%	14.0%	11.9%	9.0%	2.9%	-0.8%	-1.2%	-0.3%	0.7%	0.9%	0.8%	0.9%	1.4%	0.8%	0.4%	0.9%	0.7%	1.6%	1.8%	2.2%	1.5%	1.1%				

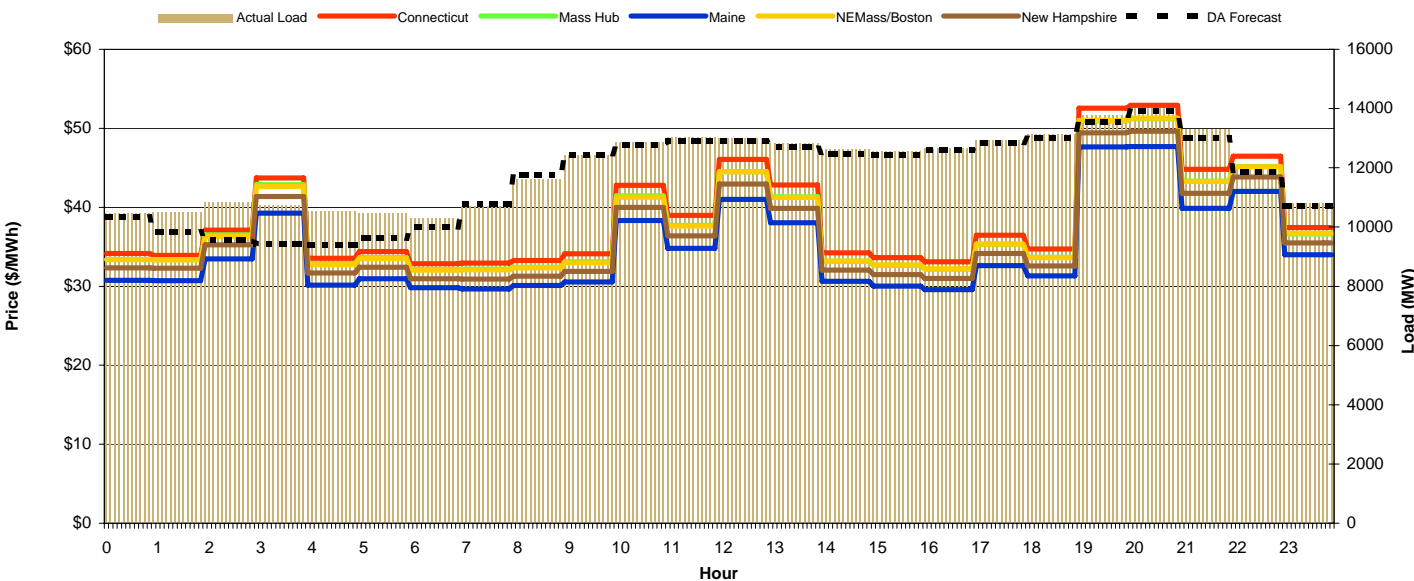




ISO-NE Daily Report

Monday April 12, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	31.83	33.61	33.17	32.20	31.31	34.01	44.03	45.00	50.25	50.09	51.74	51.62	48.30	49.51	45.86	44.00	44.22	45.00	44.33	55.12	52.15	46.20	43.46	35.45	43.44	47.93	All	On Pk
NEMass/Boston	31.72	32.80	31.60	30.81	30.65	33.31	43.13	44.07	49.22	49.07	65.00	66.00	62.00	68.00	66.00	60.00	62.00	67.00	68.00	80.00	69.04	44.12	42.01	34.73	51.26	60.10		
New Hampshire	28.07	27.85	26.39	26.21	29.15	32.37	41.91	42.81	47.74	47.59	48.83	48.71	45.78	46.83	43.38	41.67	41.85	42.54	41.89	44.78	45.96	37.93	38.58	33.74	39.69	44.18		
Maine	27.00	26.00	24.51	24.25	27.98	31.26	40.48	45.21	46.20	46.05	47.27	47.14	44.10	45.11	41.71	40.09	40.26	40.88	40.24	42.89	44.18	35.98	36.96	32.59	38.26	42.77		
Mass Hub	31.46	32.90	32.11	31.25	30.77	33.44	43.31	44.26	49.43	49.27	50.83	50.71	47.45	48.62	45.02	43.21	43.42	44.15	43.48	46.61	47.71	44.79	42.44	34.86	42.15	46.34		
Cleared Load (GW)	9.0	9.2	9.3	9.2	9.2	9.4	11.9	13.8	14.0	14.3	14.3	14.2	14.4	14.2	14.3	14.2	14.3	14.7	15.0	15.6	15.1	14.0	12.2	11.0				

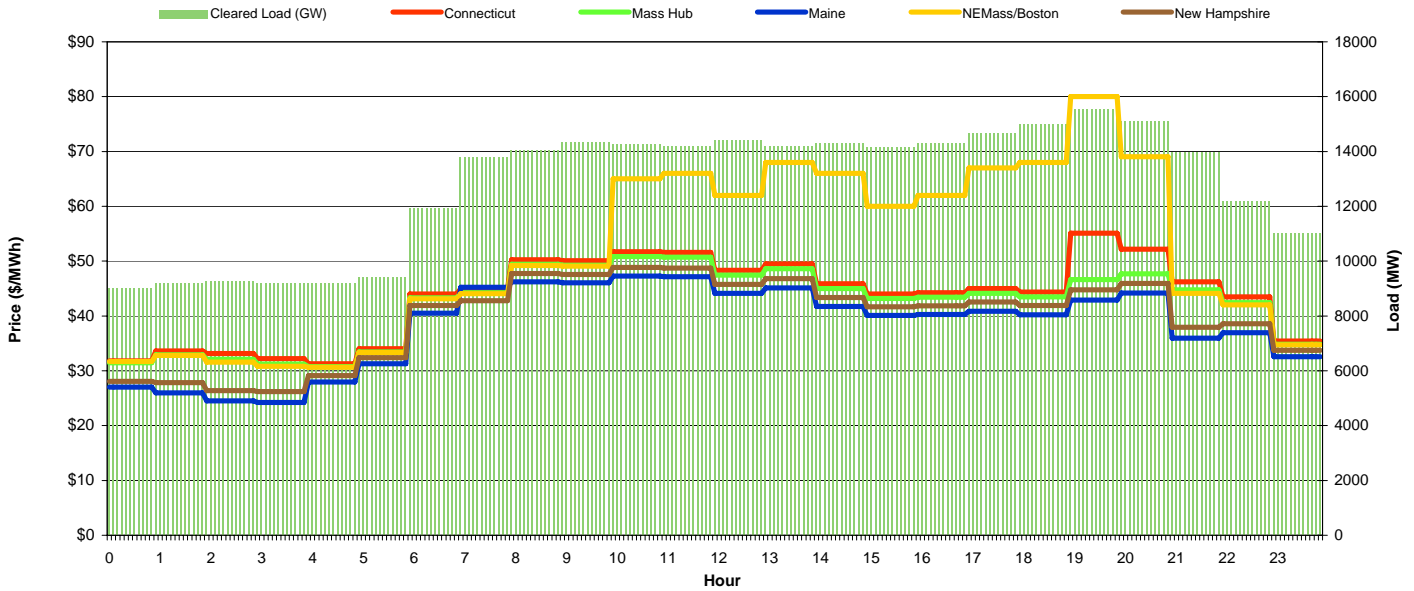

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	32.60	32.26	38.07	35.00	34.11	38.56	33.24	37.20	43.13	48.17	51.14	48.66	48.66	52.58	48.16	46.86	46.56	38.83	35.47	40.95	42.42	36.19	31.35	29.15	40.39	43.52	All	On Pk
NEMass/Boston	31.75	31.45	37.02	34.02	33.25	37.58	32.16	35.65	41.11	45.18	47.50	45.60	45.10	46.63	44.19	41.45	41.68	36.67	33.73	38.92	39.82	34.01	29.78	27.90	38.01	40.44		
New Hampshire	30.74	30.46	35.95	33.05	32.29	36.37	30.99	34.78	40.10	41.38	41.25	41.70	37.29	37.60	34.39	23.31	27.46	36.06	33.15	38.25	39.11	33.31	29.21	27.41	34.40	35.52		
Maine	29.35	29.08	34.28	31.52	31.00	35.15	30.12	34.20	39.41	40.35	39.89	40.50	35.76	35.79	32.59	20.64	25.11	34.77	32.12	37.19	37.81	31.93	27.93	26.49	33.04	34.12		
Mass Hub	31.79	31.54	37.19	34.22	33.40	37.69	32.25	35.85	41.41	45.78	48.36	46.21	46.02	47.84	45.32	43.38	43.39	37.14	34.07	39.30	40.42	34.53	30.14	28.20	38.56	41.20		
DA Forecast Load (GW)	10.01	9.62	9.45	9.46	9.81	10.88	12.72	14.09	14.55	14.71	14.88	14.82	14.70	14.59	14.36	14.15	14.19	14.33	14.50	14.90	15.08	14.01	12.57	11.13				
Forecast Error %	-0.2%	4.4%	8.5%	10.3%	7.5%	1.6%	-1.7%	-1.4%	-1.5%	-0.9%	-0.5%	0.4%	0.6%	1.0%	1.4%	1.6%	1.0%	0.6%	-0.7%	0.2%	0.8%	1.5%	1.3%	3.5%				

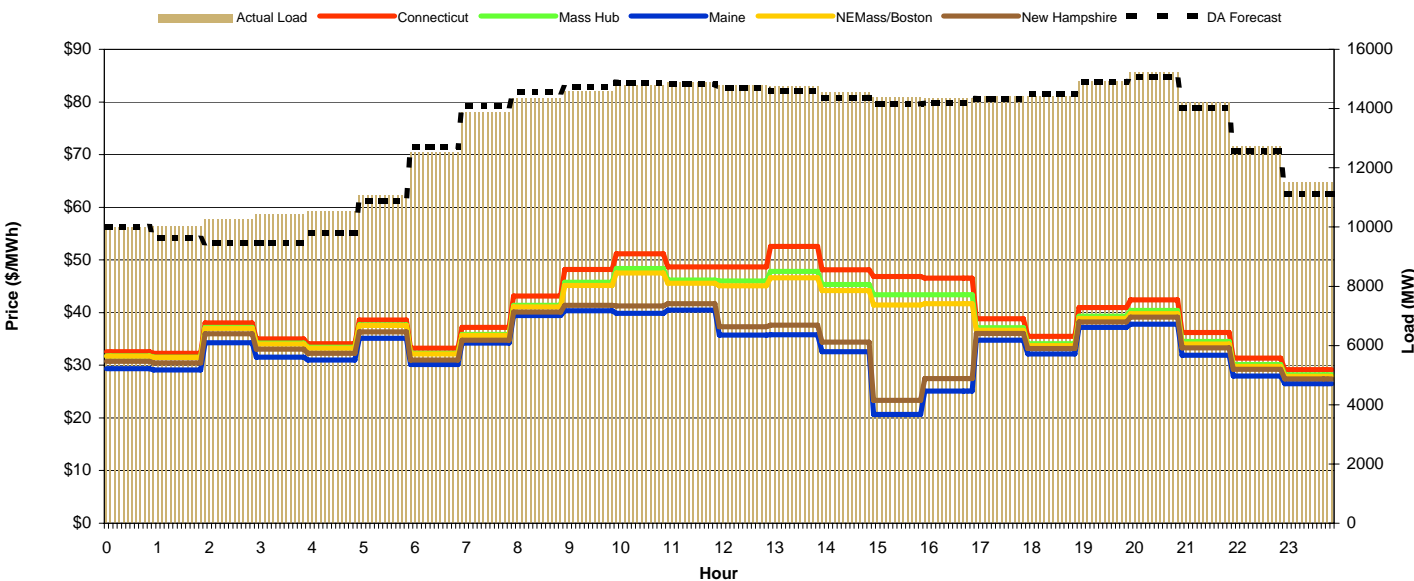




ISO-NE Daily Report

Tuesday April 13, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	32.46	32.26	30.60	31.42	32.46	34.12	40.38	45.92	48.79	51.17	49.25	48.66	47.06	48.00	47.22	45.20	39.97	39.55	38.29	47.86	51.29	40.50	37.00	34.55	41.42	45.36	All	On Pk
NEMass/Boston	31.70	31.51	29.88	30.68	31.70	33.32	39.44	44.85	44.73	44.03	45.93	43.93	42.30	42.56	41.09	40.43	39.04	38.62	37.40	43.24	45.67	39.55	36.13	33.75	38.81	41.84		
New Hampshire	30.80	30.61	29.04	29.81	30.80	32.38	38.32	43.58	42.20	40.22	43.69	41.13	39.52	39.50	37.77	37.67	37.93	37.53	36.34	41.98	42.46	38.43	35.11	32.79	37.07	39.69		
Maine	29.69	29.51	27.99	28.73	29.69	31.21	36.93	42.00	40.85	39.12	42.23	39.86	38.31	38.32	36.71	36.54	36.56	36.17	35.02	40.43	41.20	37.04	33.84	31.60	35.81	38.39		
Mass Hub	31.83	31.63	30.00	30.80	31.83	33.45	39.61	45.04	46.20	46.81	47.07	45.69	44.08	44.63	43.46	42.23	39.21	38.77	37.54	43.41	47.62	39.70	36.27	33.88	39.62	42.98		
Cleared Load (GW)	10.0	10.1	10.0	10.0	10.1	10.5	12.0	13.6	14.0	14.1	14.2	14.2	14.0	13.8	13.5	13.5	13.8	14.1	14.3	15.0	14.6	13.8	12.1	10.5				

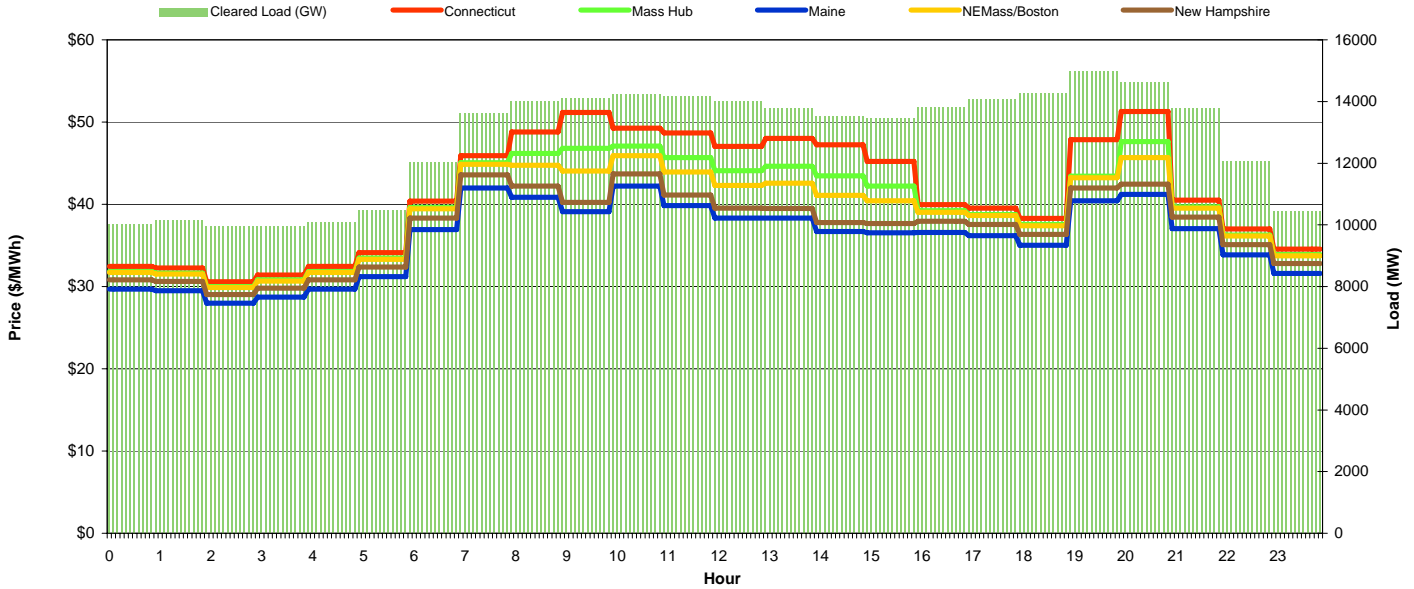

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	32.49	31.37	30.51	30.39	30.40	34.87	47.77	45.46	43.99	43.37	39.62	38.99	38.51	38.98	38.48	38.02	37.49	37.44	36.44	44.29	42.55	36.40	32.40	30.72	37.54	39.53	All	On Pk
NEMass/Boston	31.50	30.30	29.48	29.43	29.46	33.64	45.72	42.99	41.41	40.73	37.36	36.83	36.38	36.82	36.39	35.99	35.52	35.54	34.63	42.02	40.17	34.69	30.96	29.58	35.73	37.40		
New Hampshire	31.27	30.10	29.28	29.23	29.29	33.53	45.73	42.89	41.15	40.20	36.85	36.35	35.93	36.45	36.02	35.63	35.20	35.19	34.14	41.42	39.56	34.29	30.54	29.21	35.39	36.99		
Maine	30.39	29.09	28.29	28.24	28.41	32.73	45.15	41.85	39.74	38.41	35.24	34.59	34.20	34.44	33.96	33.57	33.25	33.21	32.37	39.16	37.16	32.45	28.99	28.34	33.88	35.16		
Mass Hub	31.75	30.62	29.80	29.74	29.74	33.97	46.25	43.59	42.00	41.34	37.85	37.31	36.88	37.32	36.89	36.48	35.97	35.95	35.01	42.49	40.68	35.06	31.29	29.82	36.16	37.88		
DA Forecast Load (GW)	10.37	9.98	9.83	9.79	10.10	11.16	12.91	14.25	14.71	14.82	14.89	14.80	14.67	14.58	14.35	14.19	14.18	14.22	14.45	14.91	15.16	14.14	12.70	11.17				
Forecast Error %	2.9%	7.6%	9.3%	10.6%	7.5%	0.2%	-0.5%	-0.4%	-0.8%	-0.4%	-0.1%	0.4%	0.6%	0.8%	1.2%	0.9%	0.7%	0.8%	-0.7%	-0.1%	0.9%	1.1%	1.2%	3.1%				

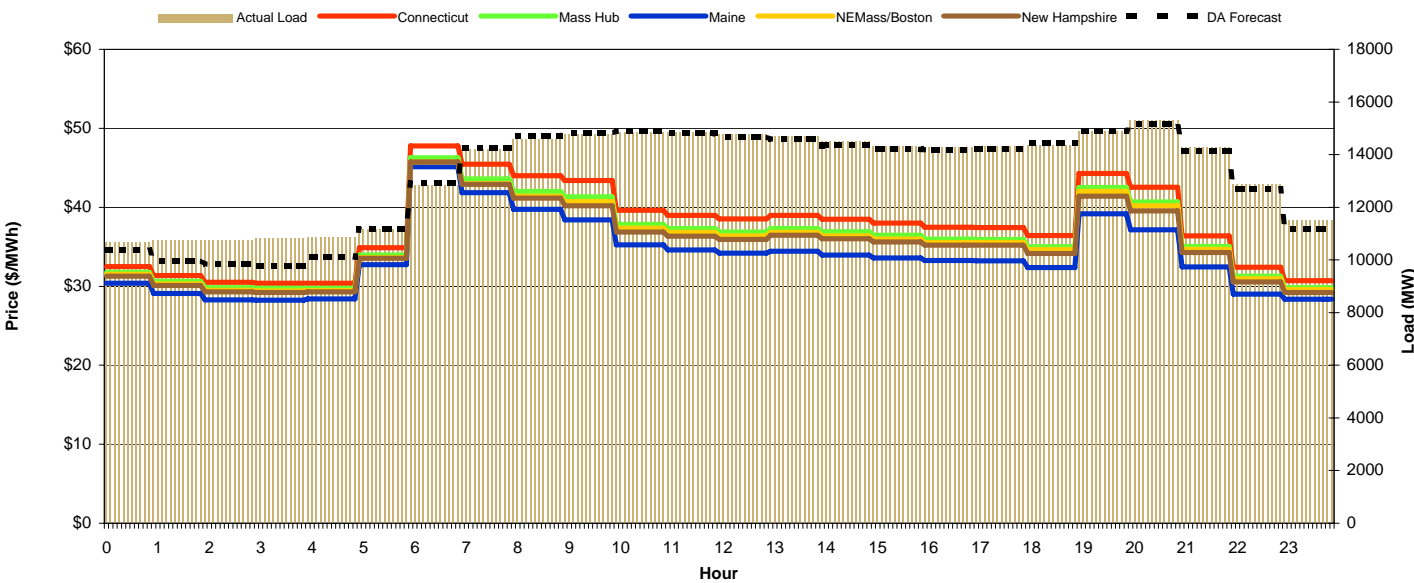




ISO-NE Daily Report

Wednesday April 14, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	30.48	29.49	29.17	27.78	28.91	32.20	39.96	42.16	42.52	42.54	48.00	47.00	42.14	42.48	40.69	41.28	43.00	40.23	38.06	45.20	48.49	40.11	34.66	34.23	38.78	42.41	All	On Pk
NEMass/Boston	29.62	28.66	28.34	26.99	28.09	31.29	38.83	40.97	41.32	41.34	42.04	41.71	40.38	40.95	39.54	39.51	38.71	38.41	36.99	43.60	45.51	38.98	33.68	33.26	37.03	40.23		
New Hampshire	28.82	27.89	27.58	26.27	27.34	30.45	37.79	39.88	40.21	40.24	38.96	38.90	39.06	39.72	38.49	38.20	37.25	37.09	36.00	42.29	43.60	37.94	32.78	32.37	35.80	38.79		
Maine	27.84	27.00	26.71	25.46	26.47	29.42	36.42	38.43	38.75	38.77	37.85	37.75	37.68	38.29	37.09	36.85	35.92	35.79	34.71	40.78	42.13	36.56	31.59	31.20	34.56	37.43		
Mass Hub	29.75	28.79	28.47	27.12	28.22	31.43	39.03	41.19	41.53	41.56	44.24	43.63	40.84	41.31	39.75	39.98	39.94	38.85	37.16	43.93	46.35	39.16	33.83	33.41	37.48	40.83		
Cleared Load (GW)	9.7	9.6	9.8	10.0	10.1	10.3	12.2	13.9	14.0	14.1	14.1	14.0	14.0	13.9	13.7	13.7	13.3	13.4	13.7	14.5	14.3	13.0	11.7	10.3				

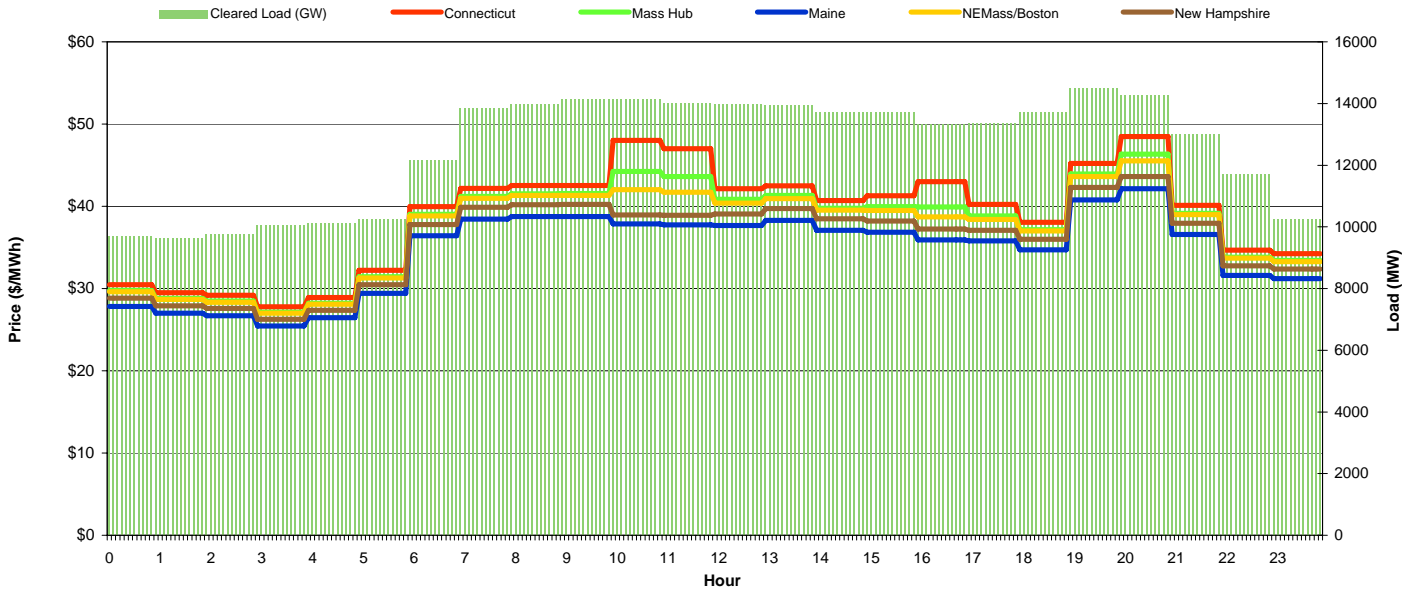

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	29.87	28.08	23.84	14.39	23.17	32.19	41.99	45.66	49.59	50.67	51.74	46.27	45.45	46.67	40.18	37.62	37.01	36.63	35.02	38.92	42.77	40.84	34.43	31.34	37.68	42.47	All	On Pk
NEMass/Boston	28.94	27.14	23.03	13.92	22.48	31.25	40.15	42.86	46.23	45.34	42.34	43.18	42.55	43.81	37.86	35.77	35.28	34.94	33.51	37.29	40.55	38.92	32.86	30.19	35.43	39.58		
New Hampshire	28.64	26.86	22.79	13.79	22.27	30.96	39.86	42.29	45.54	44.92	42.47	42.52	41.93	43.22	37.37	35.28	34.80	34.44	32.98	36.69	39.90	38.54	32.57	29.87	35.02	39.09		
Maine	27.82	26.07	22.04	13.34	21.61	30.20	38.39	39.91	42.67	41.99	39.66	39.76	39.27	40.18	34.90	32.93	32.46	32.09	31.15	34.79	37.64	36.73	31.17	28.98	33.16	36.71		
Mass Hub	29.17	27.41	23.27	14.08	22.70	31.50	40.64	43.51	47.00	46.37	43.92	43.85	43.21	44.46	38.40	36.20	35.70	35.34	33.85	37.62	41.03	39.36	33.25	30.46	35.93	40.19		
DA Forecast Load (GW)	10.32	9.94	9.78	9.75	10.00	11.11	12.91	14.24	14.65	14.72	14.80	14.69	14.55	14.45	14.24	14.03	13.97	13.90	13.97	14.74	15.05	14.02	12.64	11.12				
Forecast Error %	5.0%	7.1%	8.8%	11.3%	10.6%	1.5%	0.8%	0.9%	0.3%	0.5%	0.7%	1.6%	1.8%	2.3%	2.4%	2.9%	2.8%	3.3%	2.2%	-0.2%	0.8%	1.6%	1.0%	1.9%				

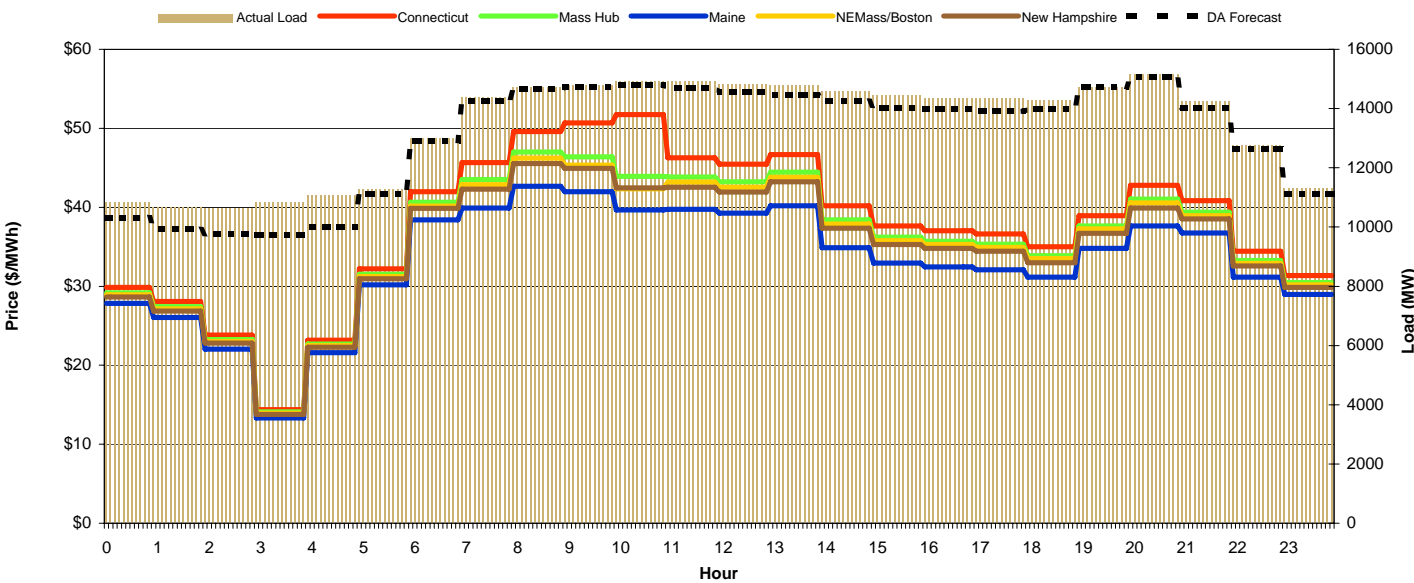




ISO-NE Daily Report

Thursday April 15, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$	
Connecticut	34.32	33.22	31.63	31.63	33.22	34.32	38.79	43.35	47.79	47.79	48.76	48.76	49.70	48.21	47.90	44.00	42.52	42.52	41.88	47.40	50.62	45.21	37.97	37.07	42.02	45.90
NEMass/Boston	33.24	32.18	30.64	30.64	32.18	33.24	37.57	41.99	46.29	46.29	47.23	47.23	46.89	43.56	42.76	41.24	41.19	41.19	40.56	45.91	49.03	42.00	36.78	35.90	40.24	43.76
New Hampshire	32.43	31.39	29.89	29.89	31.39	32.43	36.65	40.97	45.16	45.16	46.07	46.07	45.85	42.77	42.03	40.36	40.18	40.18	39.57	44.79	47.84	40.85	35.88	35.03	39.28	42.73
Maine	31.18	30.19	28.74	28.74	30.19	31.18	35.24	39.39	43.42	43.42	44.30	44.30	44.06	41.05	40.32	38.77	38.64	38.64	38.05	43.07	46.00	39.29	34.50	33.68	37.77	41.08
Mass Hub	33.40	32.34	30.79	30.79	32.34	33.40	37.79	42.23	46.55	46.55	47.50	47.50	47.31	44.19	43.45	41.65	41.43	41.40	40.77	46.14	49.28	42.56	36.96	36.08	40.52	44.09
Cleared Load (GW)	10.0	9.9	9.9	9.9	10.1	10.5	12.5	14.1	13.9	13.9	14.4	14.2	13.9	13.9	13.7	13.9	14.1	14.0	14.0	14.9	14.6	13.4	11.8	10.2		

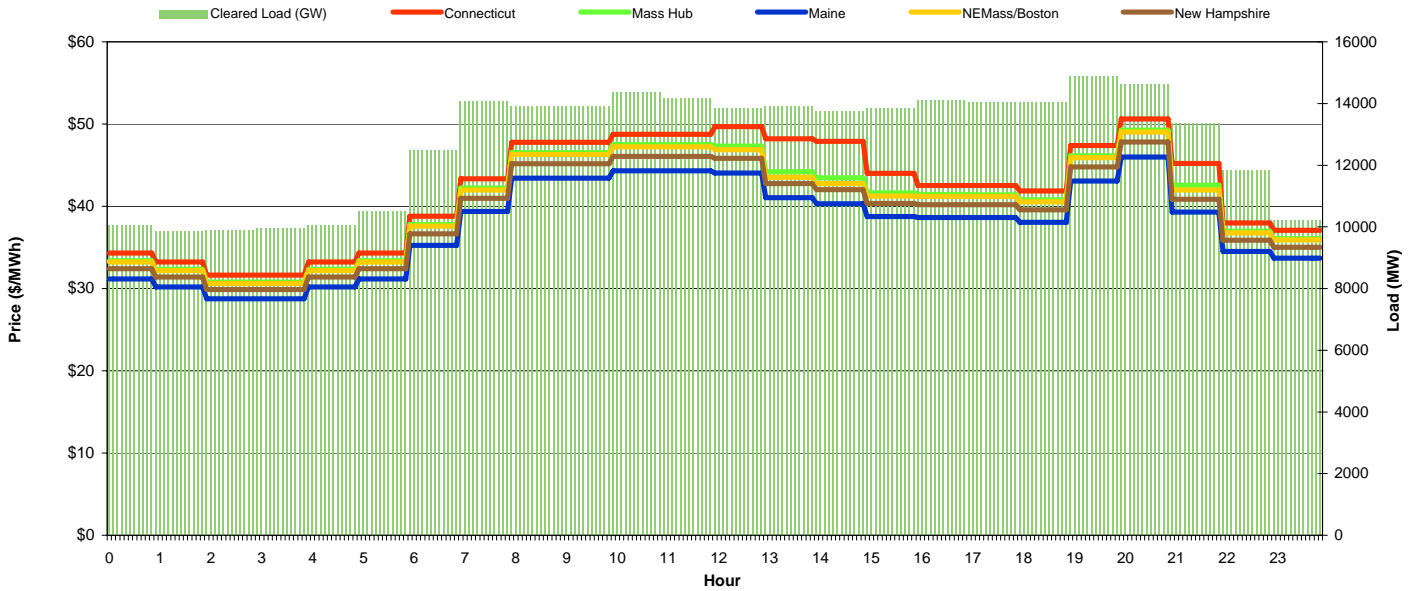

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$	
Connecticut	32.68	33.81	33.00	32.64	27.72	24.52	36.02	40.17	41.61	37.77	37.99	40.93	40.39	37.32	38.43	37.53	36.15	36.21	35.84	39.29	41.46	38.51	34.93	28.50	35.98	38.41
NEMass/Boston	31.81	32.96	32.20	31.85	27.04	23.83	34.75	38.43	39.79	36.32	36.53	39.26	38.45	35.69	36.48	35.71	34.49	34.64	34.32	37.70	39.46	36.59	33.57	27.76	34.57	36.71
New Hampshire	31.68	32.87	32.12	31.75	26.91	23.59	34.41	38.24	39.55	36.03	36.17	38.88	38.12	35.31	36.15	35.36	34.16	34.23	33.93	37.14	38.92	36.10	33.24	27.54	34.27	36.35
Maine	30.88	32.13	31.37	30.88	26.17	22.91	33.49	37.25	38.84	35.37	35.32	37.97	36.58	33.74	34.52	33.82	32.78	32.94	32.69	35.87	37.41	34.54	32.11	26.75	33.18	35.11
Mass Hub	32.05	33.23	32.48	32.14	27.29	24.02	35.06	38.80	40.20	36.59	36.77	39.58	38.86	36.04	36.94	36.11	34.80	34.91	34.57	37.92	39.82	37.02	33.87	27.90	34.87	37.05
DA Forecast Load (GW)	10.40	9.97	9.77	9.76	10.09	11.13	12.94	14.31	14.66	14.76	14.88	14.79	14.69	14.62	14.44	14.24	14.21	14.21	14.44	14.80	15.23	14.18	12.73	11.34		
Forecast Error %	2.4%	4.7%	6.9%	6.6%	5.7%	2.0%	-2.5%	-2.5%	-2.0%	-1.5%	-1.1%	-0.2%	0.1%	0.4%	0.4%	0.4%	0.0%	-0.2%	-2.0%	-0.5%	-1.1%	0.0%	0.0%	0.2%		

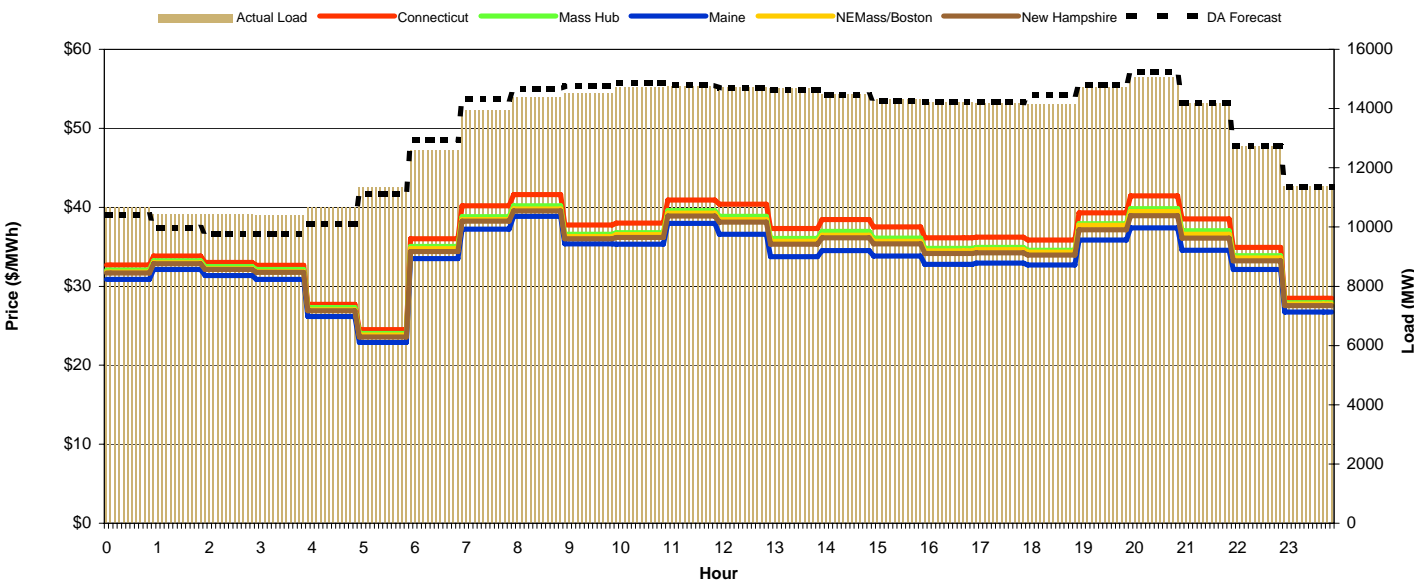




ISO-NE Daily Report

Friday April 16, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	33.13	31.99	31.56	31.05	31.16	34.40	39.86	47.36	48.90	49.02	50.61	50.06	49.83	49.63	48.92	47.72	45.75	45.45	41.22	41.12	45.67	38.88	37.27	36.65	41.97	46.09	All	On Pk
NEMass/Boston	32.01	30.90	30.49	30.00	30.10	33.24	38.51	40.03	39.87	40.17	44.26	42.42	40.61	40.89	40.88	39.76	40.49	41.29	39.82	39.72	44.12	37.57	36.01	35.40	37.86	40.49		
New Hampshire	31.27	30.19	29.79	29.31	29.41	32.48	37.63	39.07	38.91	39.20	43.21	41.41	39.63	39.91	39.91	38.81	39.54	40.32	38.91	38.81	43.11	36.70	35.18	34.59	36.97	39.54		
Maine	29.98	28.94	28.56	28.10	28.20	31.13	36.07	37.39	37.21	37.49	41.37	39.63	37.90	38.17	38.18	37.13	37.86	38.63	37.30	37.21	41.32	35.19	33.73	33.16	35.41	37.86		
Mass Hub	32.18	31.07	30.65	30.16	30.27	33.42	38.75	40.29	40.13	40.43	44.55	42.70	40.88	41.16	41.15	40.02	40.75	41.51	40.04	39.94	44.36	37.77	36.20	35.60	38.08	40.74		
Cleared Load (GW)	10.1	10.1	10.0	10.0	10.1	10.6	12.6	14.4	14.9	15.2	15.2	15.4	15.2	14.9	14.7	14.4	14.3	14.5	14.4	14.9	14.7	13.9	12.4	10.7				

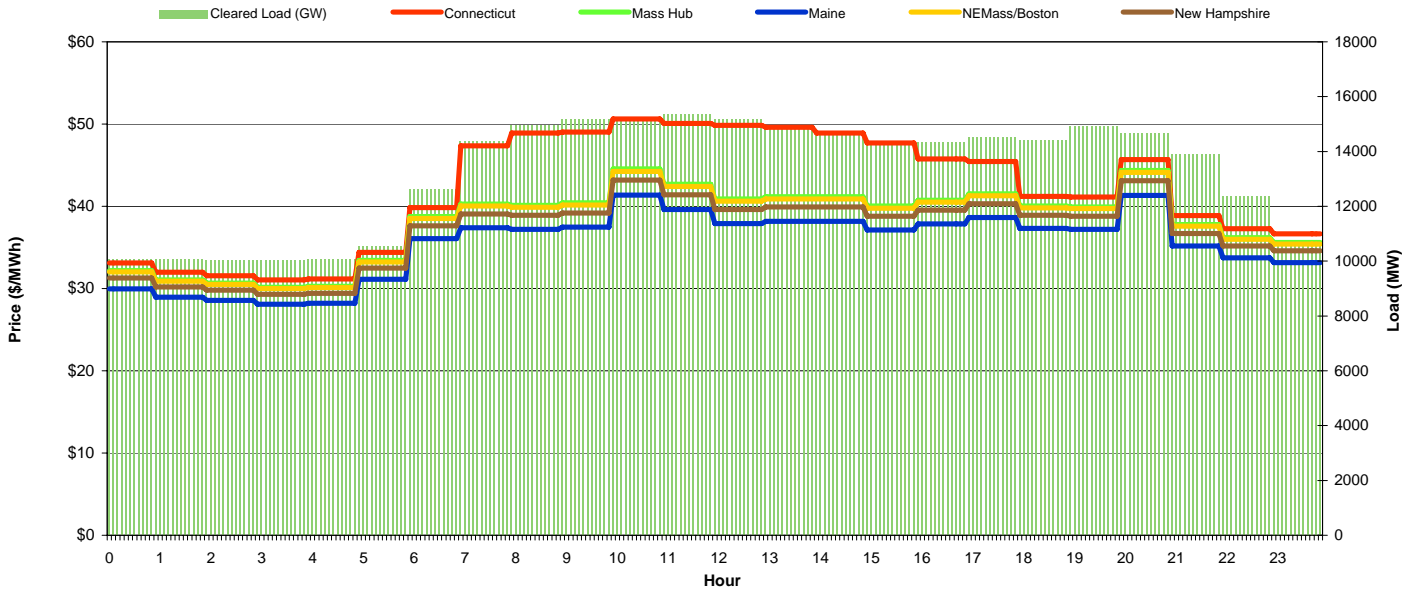

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	24.95	27.10	25.46	15.38	22.65	27.24	35.96	35.77	35.35	36.48	37.16	35.99	37.48	38.55	37.34	36.01	36.66	35.21	34.80	34.39	34.47	34.09	35.63	34.29	32.85	35.96	All	On Pk
NEMass/Boston	24.62	26.63	25.00	15.10	22.24	26.68	34.93	34.51	34.32	35.37	35.92	34.78	36.22	37.12	36.07	34.77	35.44	34.19	33.80	33.51	33.30	32.95	34.37	33.47	31.89	34.79		
New Hampshire	24.44	26.43	24.83	15.00	22.08	26.46	34.66	34.17	33.92	34.88	35.35	34.23	35.72	36.76	35.67	34.33	34.98	33.72	33.28	32.87	32.63	32.29	34.02	33.31	31.50	34.30		
Maine	23.67	25.60	24.06	14.52	21.52	25.86	33.67	32.49	32.26	33.16	33.43	32.26	33.57	34.53	33.44	32.14	32.84	31.84	31.41	31.12	30.77	30.66	32.28	32.38	29.98	32.39		
Mass Hub	24.69	26.75	25.13	15.19	22.37	26.82	35.15	34.75	34.45	35.51	36.10	34.95	36.40	37.37	36.34	35.01	35.67	34.30	33.87	33.55	33.43	33.13	34.63	33.58	32.05	34.97		
DA Forecast Load (GW)	10.24	9.89	9.66	9.69	10.03	11.02	12.84	14.31	14.87	15.17	15.35	15.37	15.24	15.13	14.94	14.79	14.84	14.86	14.75	14.91	14.90	14.14	12.99	11.67				
Forecast Error %	3.1%	6.5%	9.3%	10.5%	7.3%	2.7%	-1.7%	-1.5%	-1.0%	-1.1%	-1.3%	-1.3%	-1.0%	-0.6%	-0.6%	-0.6%	-0.3%	0.7%	1.8%	1.8%	0.6%	0.5%	0.7%	1.4%				

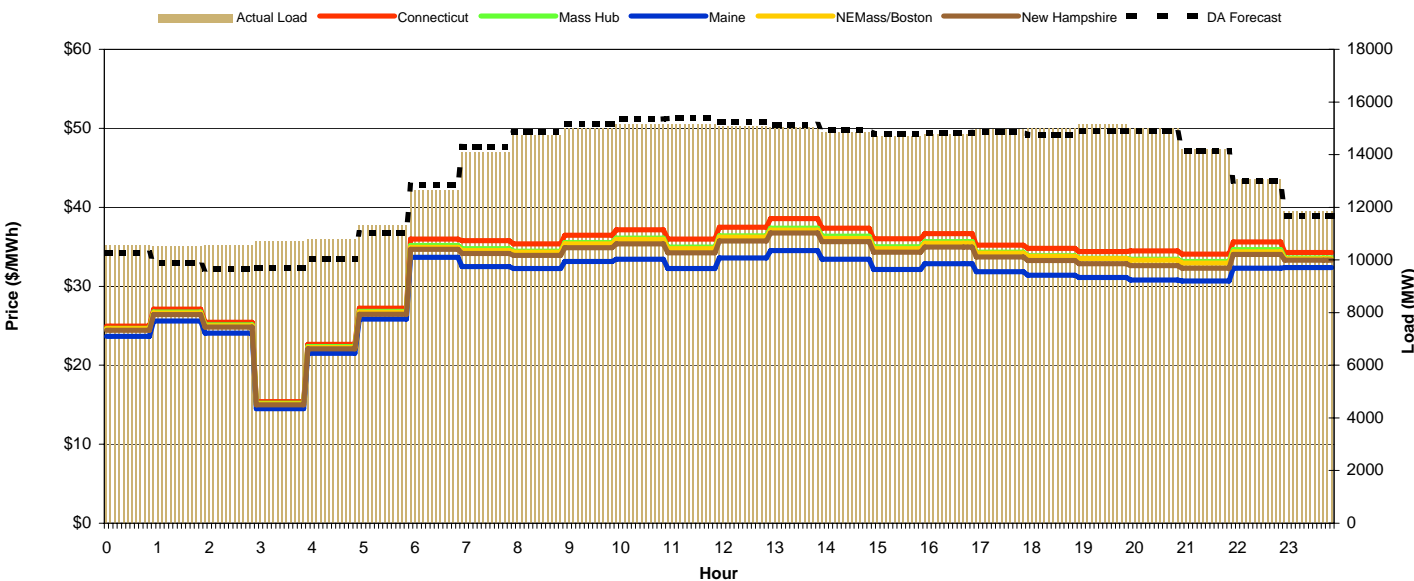




ISO-NE Daily Report

Saturday April 17, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	32.00	27.40	22.32	22.32	22.32	26.49	30.71	31.78	35.55	39.30	39.94	40.33	38.75	37.59	35.58	35.89	35.92	38.43	35.58	40.05	42.62	38.05	34.94	34.01	34.08	37.52	All	On Pk
NEMass/Boston	30.86	26.43	21.53	21.53	21.53	25.55	29.62	30.65	34.29	37.90	38.51	38.88	37.38	36.25	34.32	34.61	34.64	37.06	34.32	38.63	41.11	36.70	33.70	32.81	32.87	36.18	33.80	32.32
New Hampshire	30.20	25.86	21.06	21.06	21.06	25.00	28.99	29.99	33.55	37.09	37.68	38.05	36.57	35.47	33.58	33.87	33.90	36.27	33.58	37.80	40.22	35.91	32.97	32.10	32.16	35.41	33.80	32.32
Maine	28.94	24.78	20.18	20.18	20.18	23.95	27.77	28.74	32.15	35.53	36.10	36.45	35.04	33.99	32.17	32.45	32.48	34.75	32.17	36.22	38.54	34.41	31.59	30.76	30.81	33.92	33.80	32.32
Mass Hub	31.05	26.59	21.65	21.65	21.65	25.70	29.83	30.86	34.52	38.16	38.77	39.15	37.63	36.50	34.55	34.85	34.88	37.28	34.52	38.86	41.35	36.92	33.90	33.00	33.08	36.42	33.80	32.32
Cleared Load (GW)	10.1	9.9	9.9	9.8	9.8	9.6	10.0	11.2	12.6	13.4	14.0	13.9	13.6	13.2	13.0	13.0	13.1	13.3	13.5	13.7	13.6	12.9	11.8	10.7				

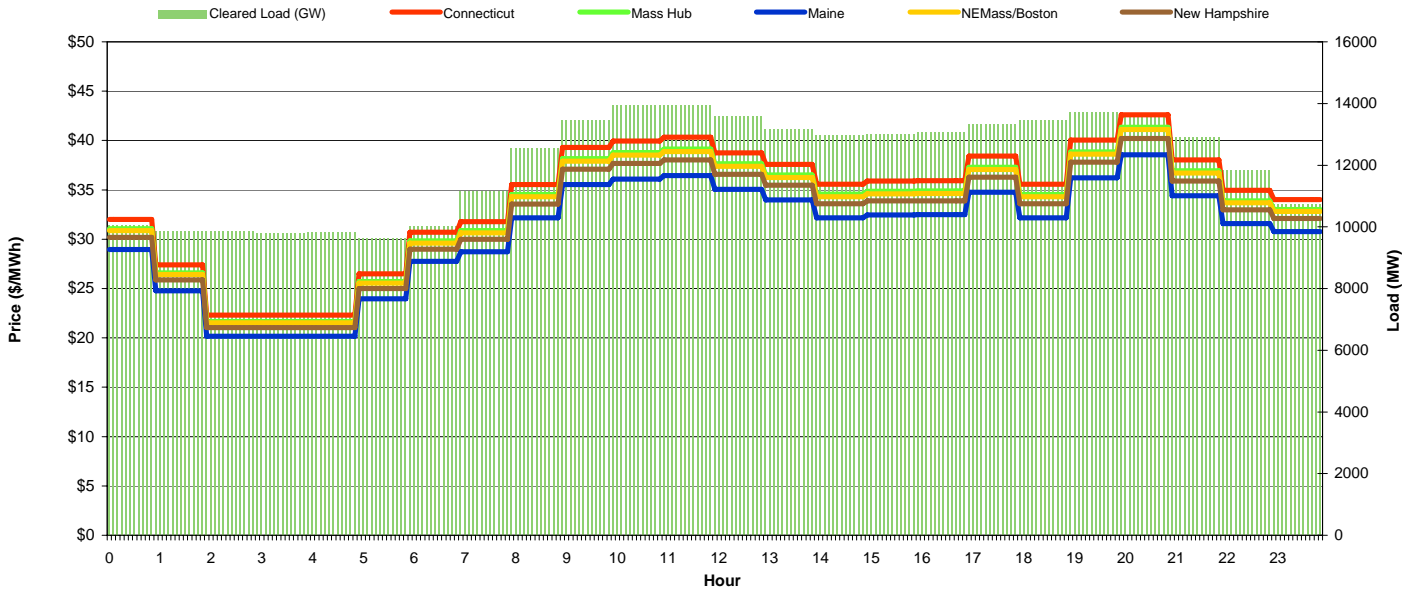

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	33.54	31.32	13.67	26.19	13.48	30.87	29.61	29.50	35.23	38.33	38.03	37.70	36.12	35.49	34.05	33.44	35.04	35.12	33.63	35.08	35.51	36.72	34.15	33.80	32.32	35.20	All	On Pk
NEMass/Boston	32.84	30.62	13.37	25.66	13.26	30.39	29.11	28.88	34.50	37.26	36.77	36.51	34.93	34.25	32.89	32.47	33.94	33.99	32.75	34.14	34.27	35.39	33.02	32.95	31.42	34.12	33.80	32.32
New Hampshire	32.67	30.44	13.29	25.52	13.21	30.32	29.07	28.83	34.39	36.96	36.40	36.11	34.54	33.86	32.48	32.08	33.61	33.65	32.27	33.67	33.77	34.90	32.64	32.69	31.14	33.76	33.80	32.32
Maine	31.88	29.68	12.99	25.03	13.11	30.12	28.64	28.25	33.29	35.37	34.78	34.43	32.88	32.05	30.68	30.46	32.07	32.11	30.93	32.36	32.27	32.99	31.21	31.88	29.98	32.26	33.80	32.32
Mass Hub	32.96	30.78	13.45	25.83	13.32	30.49	29.22	29.02	34.60	37.42	36.94	36.65	35.05	34.40	33.06	32.59	34.11	34.12	32.79	34.18	34.37	35.55	33.14	32.99	31.54	34.25	33.80	32.32
DA Forecast Load (GW)	10.77	10.21	9.91	9.76	9.80	10.14	10.79	11.79	13.03	13.87	14.25	14.33	14.28	14.01	13.79	13.71	13.76	13.95	14.00	14.41	14.51	13.89	12.91	11.69				
Forecast Error %	1.1%	4.2%	8.8%	9.9%	6.2%	1.1%	0.9%	0.6%	-0.4%	-0.2%	0.2%	0.2%	-0.7%	-0.7%	-1.2%	-1.7%	-1.8%	-1.4%	-0.4%	-1.7%	-2.4%	-2.5%	-2.6%	-1.4%				

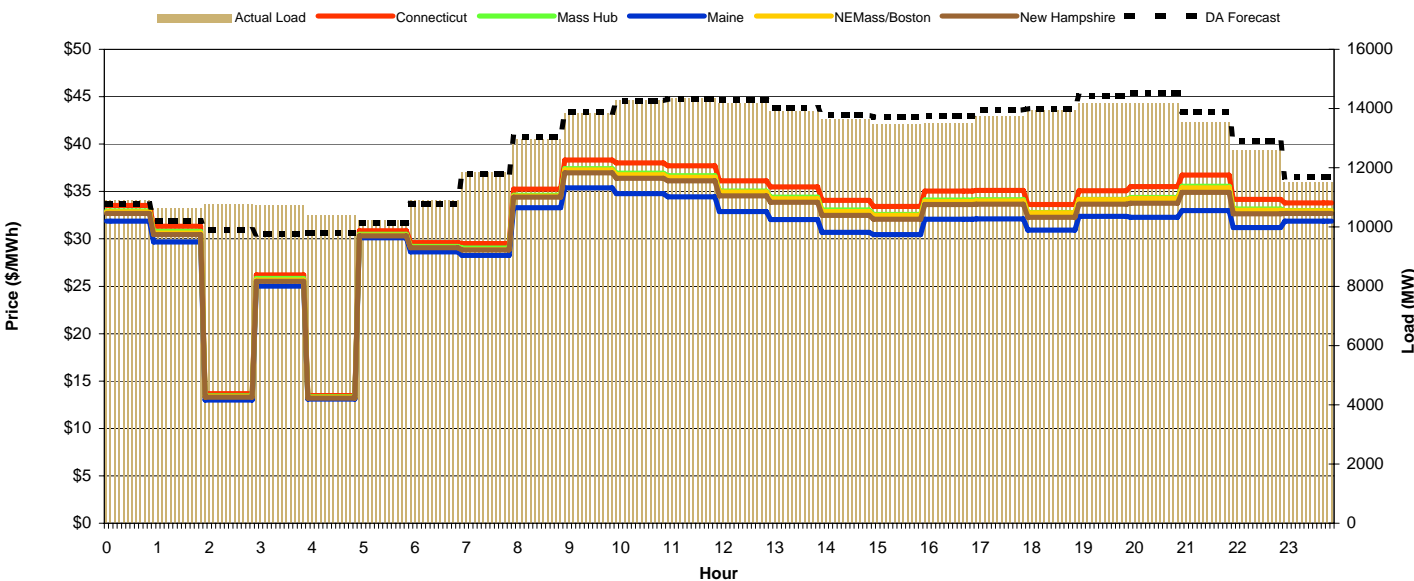




ISO-NE Daily Report

Sunday April 18, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	32.46	29.16	24.42	24.64	25.34	24.71	27.98	26.09	33.89	35.74	35.94	37.64	37.56	35.71	35.01	35.16	35.63	36.78	36.63	40.86	45.04	38.16	34.12	34.97	33.49	36.25	All	On Pk
NEMass/Boston	31.30	28.12	23.55	23.76	24.43	23.83	26.98	25.16	32.68	34.47	34.66	36.29	36.22	34.43	33.76	33.90	34.36	35.47	35.32	39.40	43.27	36.80	32.90	33.72	32.28	34.94		
New Hampshire	30.69	27.57	23.09	23.29	23.95	23.36	26.45	24.66	32.04	33.79	33.98	35.58	35.51	33.76	33.10	33.24	33.68	34.77	34.63	38.63	42.42	36.08	32.26	33.06	31.65	34.26		
Maine	29.38	26.40	22.11	22.30	22.93	22.37	25.32	23.62	30.68	32.36	32.53	34.07	34.00	32.32	31.70	31.83	32.25	33.30	33.16	36.99	40.62	34.54	30.89	31.66	30.31	32.80		
Mass Hub	31.51	28.31	23.71	23.92	24.59	23.99	27.16	25.33	32.90	34.70	34.89	36.54	36.46	34.66	33.99	34.13	34.59	35.71	35.56	39.67	43.54	37.05	33.13	33.95	32.50	35.18		
Cleared Load (GW)	10.0	9.6	9.6	9.5	9.6	9.7	9.8	10.6	11.7	12.5	12.9	13.1	12.9	12.7	12.3	12.3	12.4	13.0	13.1	14.0	14.1	12.7	11.4	10.3				

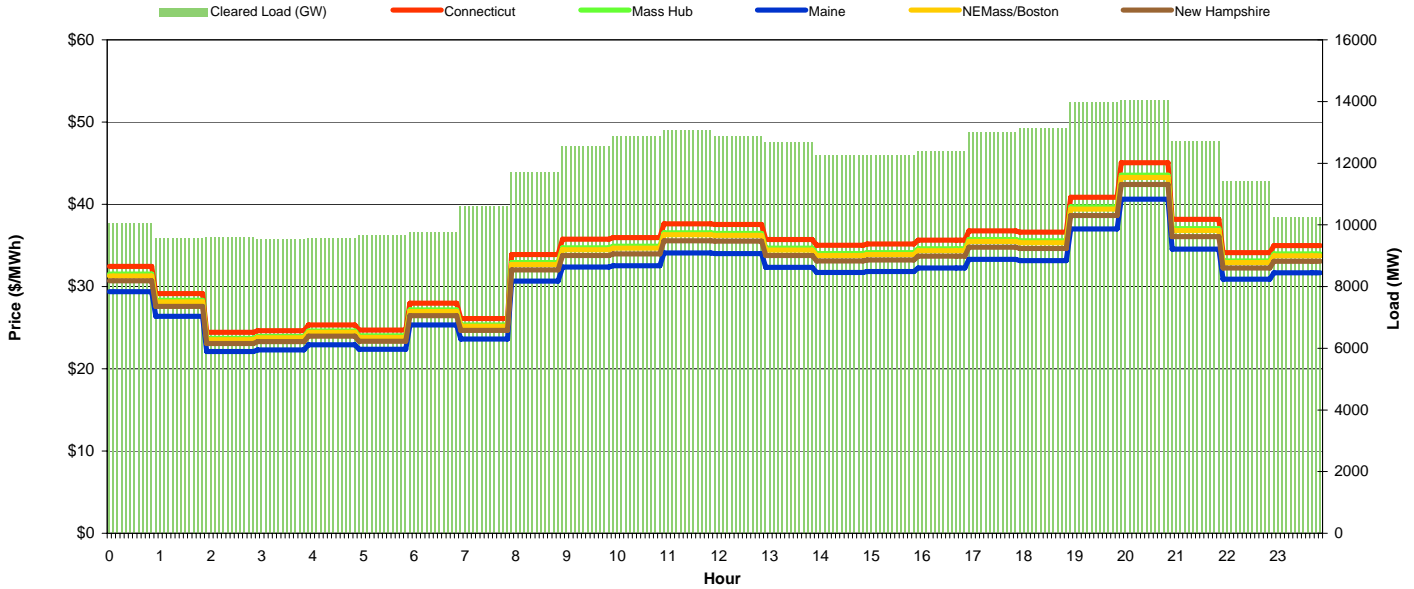

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	33.14	27.47	30.49	31.10	29.60	26.43	15.40	23.39	32.28	33.11	35.59	35.67	36.21	35.57	35.14	35.01	34.81	34.92	35.47	34.93	35.99	38.39	35.45	32.67	32.43	34.50	All	On Pk
NEMass/Boston	32.33	26.73	29.58	30.15	28.71	25.63	15.00	22.71	31.33	32.18	34.39	34.45	34.87	34.25	33.91	33.80	33.63	33.72	34.20	33.87	34.75	36.83	34.11	31.65	31.37	33.31		
New Hampshire	32.11	26.50	29.34	29.92	28.50	25.37	14.83	22.48	31.00	31.82	34.08	34.15	34.55	33.88	33.66	33.52	33.40	33.34	33.89	33.51	34.36	36.47	33.89	31.41	31.08	33.00		
Maine	31.56	26.05	28.81	29.50	28.12	25.16	14.60	21.98	30.12	30.75	32.91	32.98	33.26	32.56	32.29	32.15	32.07	32.18	32.72	32.38	33.11	35.31	32.71	30.62	30.16	31.84		
Mass Hub	32.41	26.85	29.77	30.35	28.90	25.80	15.07	22.83	31.49	32.30	34.56	34.62	35.08	34.45	34.11	34.00	33.83	33.87	34.36	33.93	34.84	37.05	34.32	31.81	31.53	33.48		
DA Forecast Load (GW)	10.86	10.34	10.02	9.83	9.82	10.06	10.40	11.15	12.17	12.93	13.24	13.38	13.38	13.17	12.97	12.89	13.04	13.38	13.63	14.14	14.30	13.51	12.32	11.07				
Forecast Error %	-1.8%	-2.1%	0.3%	1.4%	1.6%	0.1%	0.1%	-0.2%	-1.8%	-2.4%	-1.5%	-1.2%	-1.3%	-1.2%	-1.2%	-1.1%	-0.8%	-1.3%	-1.4%	-1.7%	-1.2%	-0.9%	-0.4%	0.8%				

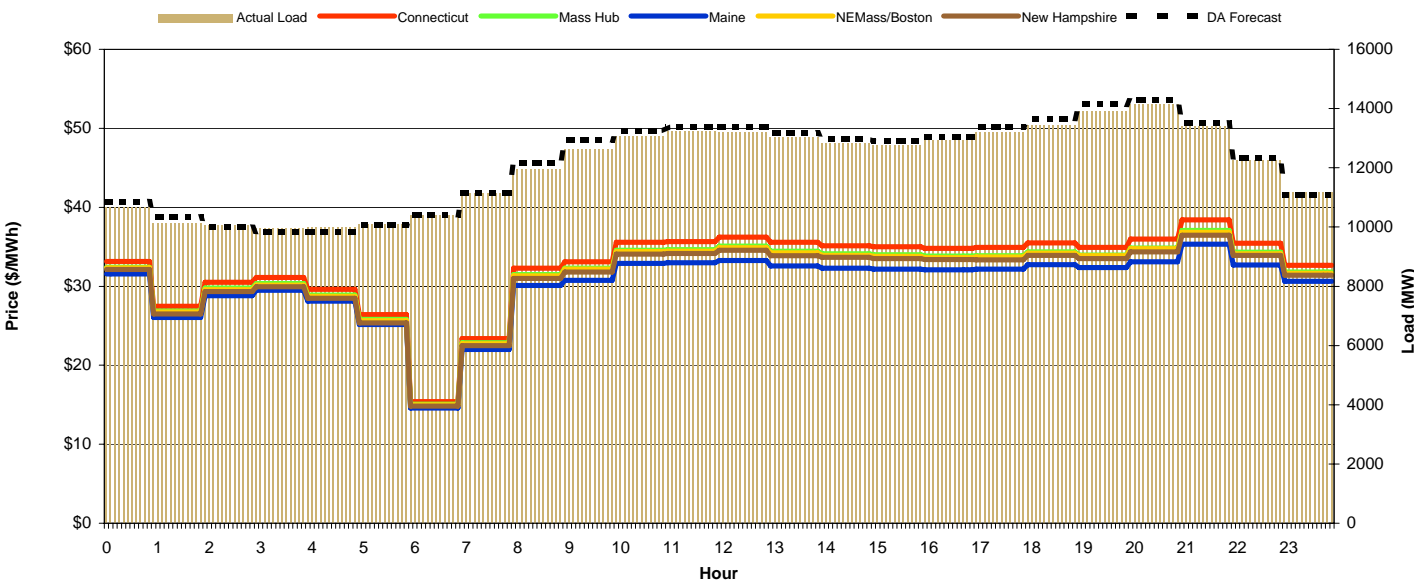




ISO-NE Daily Report

Monday April 19, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	28.93	18.60	22.66	22.49	26.29	30.75	36.10	40.71	41.70	41.87	43.47	43.15	42.81	41.26	39.60	39.92	40.93	37.84	38.08	39.61	45.22	38.00	34.79	31.80	36.11	40.56	All	On Pk
NEMass/Boston	27.88	17.92	21.84	21.68	25.33	29.62	34.79	39.23	40.19	40.35	41.89	41.58	41.25	39.76	38.16	38.47	39.44	36.47	36.70	38.16	43.57	36.62	33.52	30.64	34.79	39.09		
New Hampshire	27.41	17.62	21.47	21.31	24.90	29.12	34.20	38.57	39.51	39.67	41.18	40.88	40.55	39.08	37.52	37.82	38.77	35.85	36.08	37.52	42.83	36.00	32.96	30.12	34.21	38.42		
Maine	26.32	17.34	20.62	20.46	24.13	30.67	32.83	37.03	37.93	38.08	39.54	39.25	38.93	37.52	36.02	36.31	37.22	34.42	34.64	36.02	41.12	34.56	31.64	28.92	32.98	36.89		
Mass Hub	28.07	18.04	21.99	21.82	25.50	29.82	35.03	39.50	40.46	40.63	42.18	41.87	41.53	40.03	38.43	38.74	39.71	36.72	36.95	38.43	43.88	36.87	33.76	30.85	35.03	39.36		
Cleared Load (GW)	9.8	10.0	10.0	10.0	10.0	10.2	12.1	13.6	14.1	14.3	14.5	14.5	14.2	14.1	14.1	13.9	13.9	14.3	14.1	14.8	14.5	13.6	12.0	10.6				

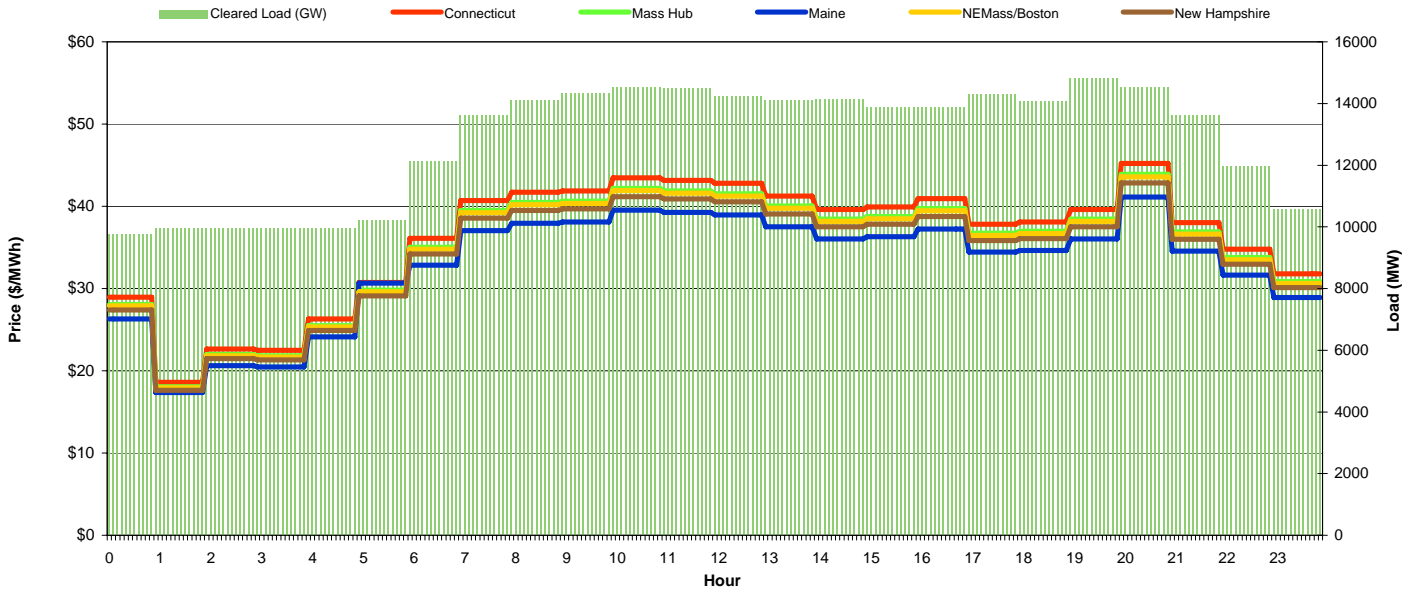

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	26.60	15.78	30.35	27.43	17.88	23.47	32.71	37.93	37.19	37.98	36.18	36.41	36.08	36.60	34.69	35.00	34.93	31.85	32.29	32.48	37.49	35.95	33.30	30.85	32.14	35.40	All	On Pk
NEMass/Boston	25.95	15.40	29.51	26.72	17.45	23.02	31.74	36.02	35.27	36.09	34.49	34.75	34.43	34.82	33.09	33.32	33.32	30.69	31.07	31.52	35.90	34.18	31.70	29.75	30.84	33.79		
New Hampshire	25.76	15.28	29.29	26.50	17.30	22.82	31.38	35.71	34.98	35.76	34.08	34.36	34.08	34.48	32.70	32.90	32.93	30.21	30.64	31.04	35.40	33.70	31.36	29.45	30.50	33.40		
Maine	25.35	15.02	28.76	25.99	16.96	22.33	30.31	33.72	33.04	33.82	32.15	32.38	32.04	32.38	30.61	30.72	30.81	28.50	28.98	29.41	33.26	31.71	29.49	28.20	29.00	31.44		
Mass Hub	26.04	15.47	29.73	26.90	17.54	23.09	31.93	36.48	35.69	36.47	34.78	35.06	34.72	35.15	33.41	33.69	33.68	30.88	31.28	31.64	36.21	34.57	32.08	30.01	31.10	34.11		
DA Forecast Load (GW)	10.37	9.96	9.80	9.74	10.03	11.04	12.65	14.02	14.60	14.91	15.10	15.10	15.02	14.91	14.71	14.55	14.56	14.73	14.91	15.28	15.31	14.31	12.86	11.46				
Forecast Error %	0.0%	3.4%	7.6%	8.4%	6.8%	0.2%	-3.3%	-3.3%	-2.6%	-2.2%	-1.9%	-1.9%	-2.2%	-2.3%	-2.5%	-2.9%	-3.2%	-4.1%	-5.5%	-5.4%	-2.6%	-1.8%	-1.3%	-1.1%				

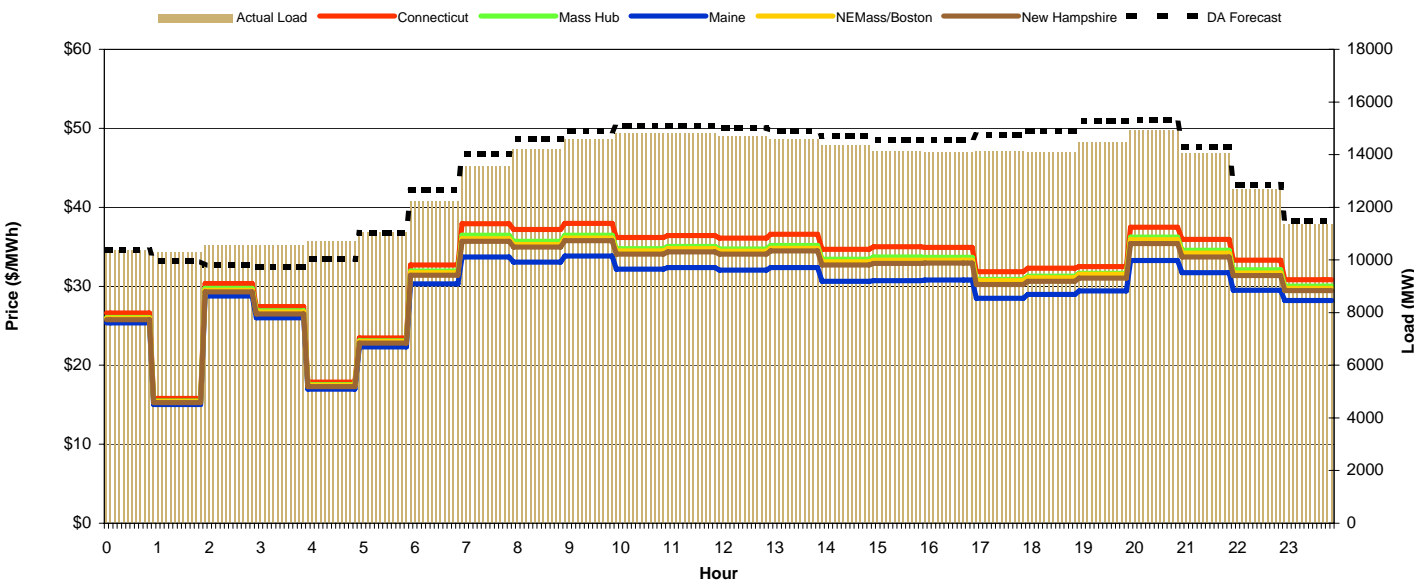




ISO-NE Daily Report

Tuesday April 20, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	30.80	29.44	26.96	24.92	26.96	32.57	38.30	40.55	41.29	42.08	42.46	42.08	41.58	40.88	40.21	40.20	40.77	38.61	38.15	43.05	44.56	39.26	35.07	34.52	37.30	40.68	All	On Pk
NEMass/Boston	29.66	28.35	25.96	24.00	25.96	31.35	36.88	39.05	39.76	40.53	40.89	40.53	40.04	39.36	38.72	38.71	39.26	37.18	36.74	41.46	42.91	37.80	33.77	33.24	35.92	39.17		
New Hampshire	29.25	27.96	25.60	23.66	25.60	30.91	36.48	38.70	39.20	39.96	40.31	39.96	39.47	38.81	38.18	38.16	38.71	36.66	36.22	40.87	42.31	37.27	33.30	32.77	35.43	38.63		
Maine	28.15	26.91	24.64	22.78	24.64	32.11	35.16	37.34	37.74	38.46	38.77	38.43	38.00	37.36	36.75	36.74	37.27	35.29	34.87	39.35	40.73	35.88	32.06	31.55	34.21	37.19		
Mass Hub	29.86	28.54	26.14	24.16	26.14	31.56	37.16	39.34	40.06	40.83	41.20	40.83	40.34	39.66	39.02	39.00	39.56	37.43	36.98	41.73	43.20	38.05	34.00	33.46	36.18	39.45		
Cleared Load (GW)	9.7	8.8	9.3	9.3	9.4	10.2	11.9	13.5	13.9	14.1	14.1	14.2	14.1	13.9	13.5	13.3	13.4	13.7	13.7	14.2	14.1	13.0	11.6	10.2				

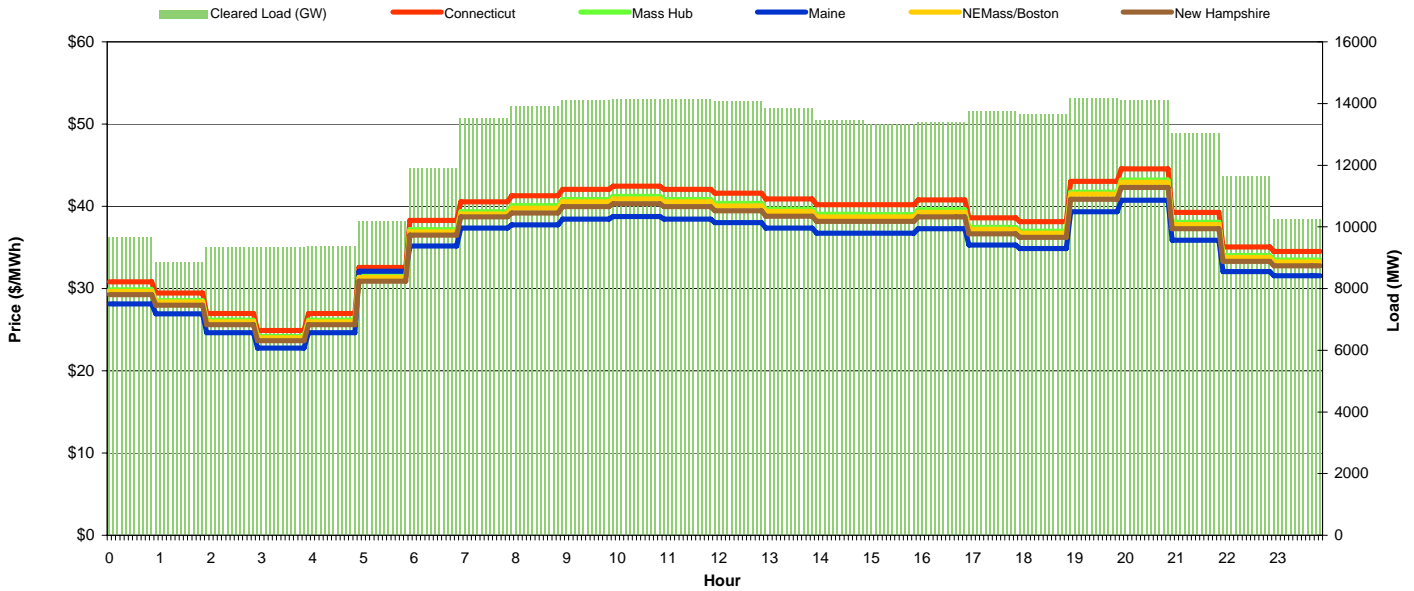

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	31.17	31.76	27.65	29.75	32.02	32.67	35.74	39.66	43.04	39.74	44.36	41.83	47.63	45.91	44.63	44.54	41.99	34.36	35.02	39.02	42.83	43.08	42.85	43.11	38.93	41.91	All	On Pk
NEMass/Boston	30.35	30.93	26.94	29.06	31.34	31.85	34.65	37.84	40.82	41.63	43.99	39.92	47.31	45.45	44.30	44.36	41.47	34.63	34.08	40.03	41.17	40.95	40.22	41.92	38.13	41.14		
New Hampshire	30.15	30.69	26.71	28.80	31.11	31.70	34.44	37.77	40.29	25.68	36.40	39.27	38.04	37.11	35.74	34.89	34.48	26.86	31.82	27.68	39.41	40.36	35.96	41.22	34.02	35.11		
Maine	29.26	29.80	25.95	28.01	30.32	30.88	33.18	35.87	37.78	23.31	33.59	36.86	32.23	31.73	30.36	29.29	29.96	22.56	29.46	21.54	36.68	38.07	34.29	39.75	31.28	31.47		
Mass Hub	30.60	31.21	27.18	29.31	31.59	32.10	34.93	38.32	41.39	41.84	44.37	40.35	46.56	44.81	43.61	43.58	41.00	33.92	34.16	38.67	41.38	41.43	42.01	42.18	38.19	41.09		
DA Forecast Load (GW)	10.33	9.89	9.69	9.65	9.90	10.84	12.50	13.86	14.29	14.43	14.61	14.66	14.56	14.56	14.33	14.20	14.10	14.14	14.30	14.66	14.95	14.04	12.65	11.20				
Forecast Error %	1.1%	0.8%	3.4%	3.4%	3.5%	0.7%	-1.8%	-1.3%	0.0%	1.2%	1.7%	1.7%	2.1%	1.5%	2.0%	1.5%	1.6%	1.2%	-0.8%	-1.2%	-0.4%	-0.5%	-0.2%	0.6%				

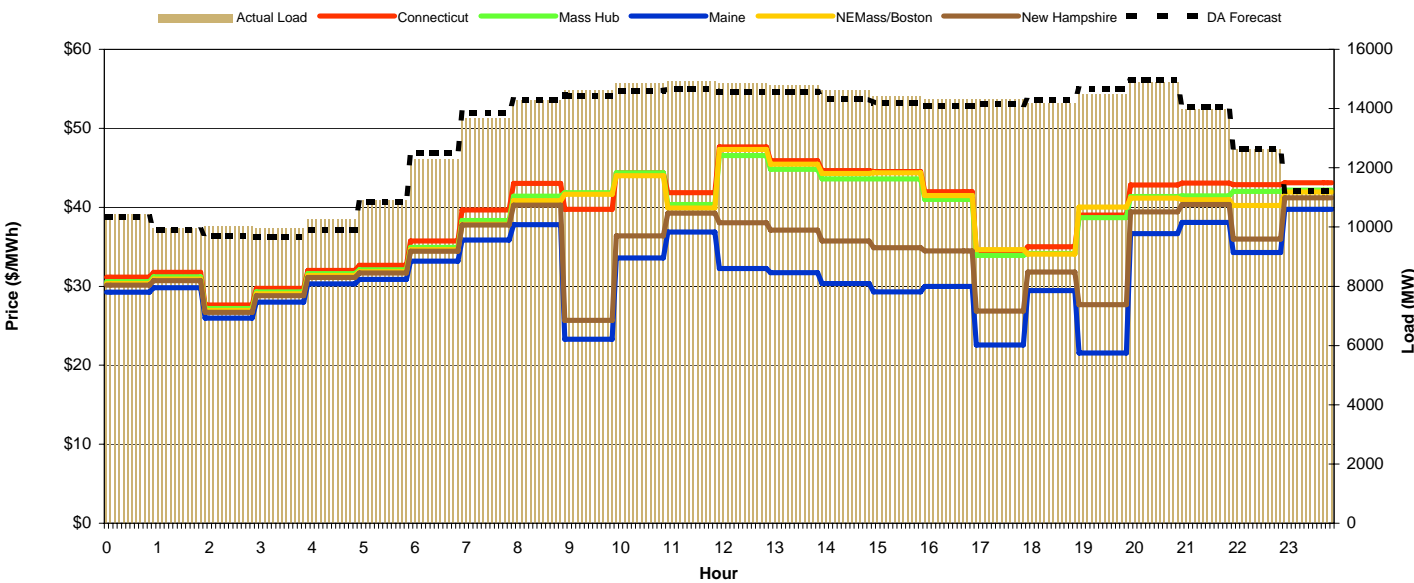




ISO-NE Daily Report

Wednesday April 21, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	32.55	32.01	31.62	31.77	32.57	34.43	39.46	40.33	43.89	42.48	44.83	45.62	45.22	45.78	44.31	43.24	43.76	40.00	39.56	43.53	46.00	43.04	36.21	34.95	39.88	42.99	All	On Pk
NEMass/Boston	31.31	30.79	30.42	30.56	31.34	33.12	37.96	38.71	41.38	40.01	41.49	42.24	41.80	42.21	41.36	40.91	41.61	38.34	38.05	41.87	44.25	39.53	34.54	33.62	37.81	40.52		
New Hampshire	30.96	30.45	30.08	30.22	30.99	32.75	37.54	37.92	38.45	38.71	38.57	39.40	38.41	38.62	38.52	38.44	39.77	37.51	37.63	41.41	43.75	33.75	33.33	33.25	36.27	38.39		
Maine	29.77	29.28	28.92	29.06	29.79	31.49	36.09	36.50	36.57	37.25	37.00	37.63	37.00	37.00	37.00	36.64	37.75	36.00	36.18	39.81	41.95	31.51	31.90	31.97	34.75	36.73		
Mass Hub	31.54	31.01	30.64	30.79	31.56	33.36	38.27	39.18	42.20	40.59	42.49	43.09	43.08	43.36	42.40	41.64	42.22	38.69	38.33	42.18	44.57	40.77	34.94	33.87	38.37	41.23		
Cleared Load (GW)	9.5	9.6	9.5	9.4	9.6	9.9	11.7	13.2	13.4	13.6	13.7	13.7	13.6	13.5	13.3	13.2	13.4	13.4	13.4	14.1	13.9	12.9	11.7	10.1				

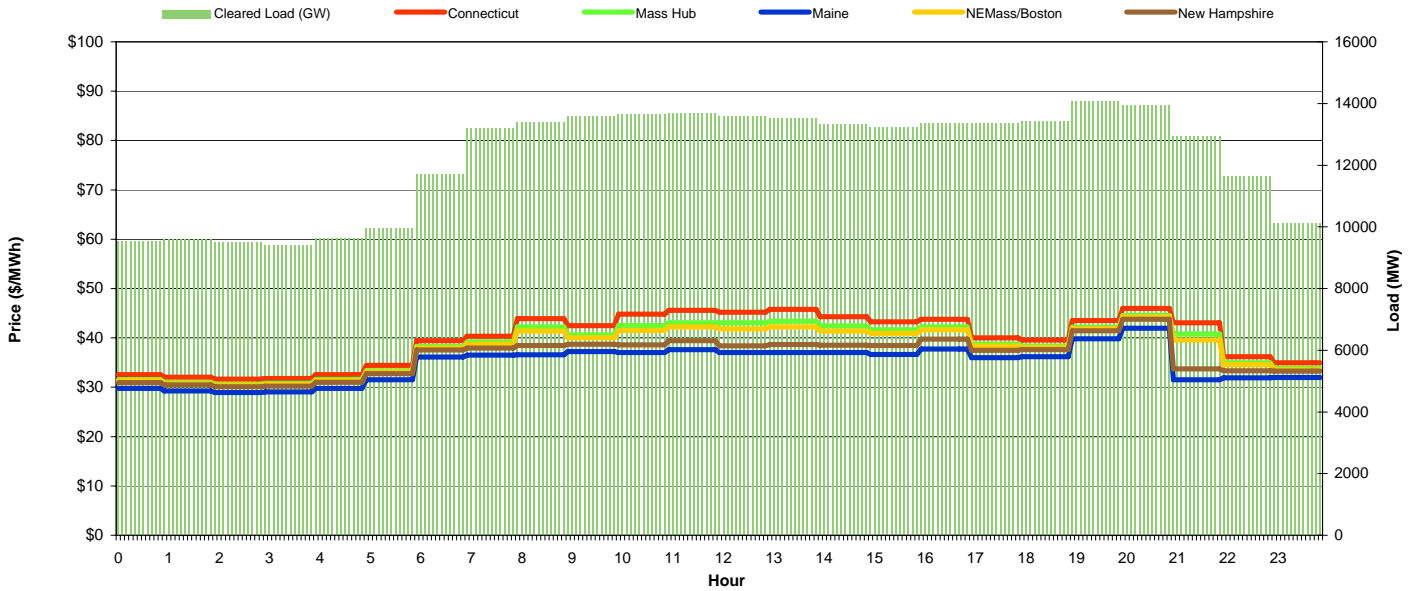

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	34.41	32.70	36.23	45.69	42.41	35.83	35.61	37.37	45.22	54.41	67.12	71.61	74.01	76.67	82.14	44.51	34.11	34.71	35.53	49.72	53.65	39.49	35.09	39.60	47.41	52.21	All	On Pk
NEMass/Boston	33.53	31.79	34.67	44.16	41.23	34.65	34.14	35.33	42.80	52.83	67.53	72.64	77.03	80.10	86.16	44.21	34.18	33.58	34.19	48.92	53.39	37.60	33.48	37.81	46.91	52.12		
New Hampshire	32.96	30.85	30.67	42.53	40.79	34.18	33.64	34.95	42.21	44.48	48.18	50.11	44.99	46.27	48.73	35.26	26.78	31.91	33.01	41.27	41.25	36.99	33.30	37.58	38.45	39.98		
Maine	31.86	29.89	29.01	41.11	39.80	33.06	32.14	33.09	39.63	39.18	38.24	38.59	30.21	30.43	30.99	29.92	22.41	29.81	31.03	36.23	34.27	35.27	32.37	36.64	33.55	33.23		
Mass Hub	33.71	32.15	35.28	44.68	41.59	34.97	34.49	35.87	43.40	52.75	65.65	70.32	73.33	76.11	81.70	43.46	33.51	33.74	34.43	48.42	52.31	37.99	33.84	38.23	46.33	51.05		
DA Forecast Load (GW)	10.27	9.80	9.59	9.53	9.81	10.72	12.17	13.48	14.00	14.21	14.40	14.41	14.31	14.29	14.11	13.91	13.81	13.73	13.69	14.24	14.80	13.86	12.43	11.02				
Forecast Error %	0.9%	6.1%	8.7%	8.6%	8.3%	4.8%	-0.3%	0.3%	1.1%	2.3%	2.8%	3.5%	3.7%	3.6%	3.7%	3.7%	3.7%	3.6%	3.6%	2.6%	0.9%	1.1%	1.9%	3.0%				

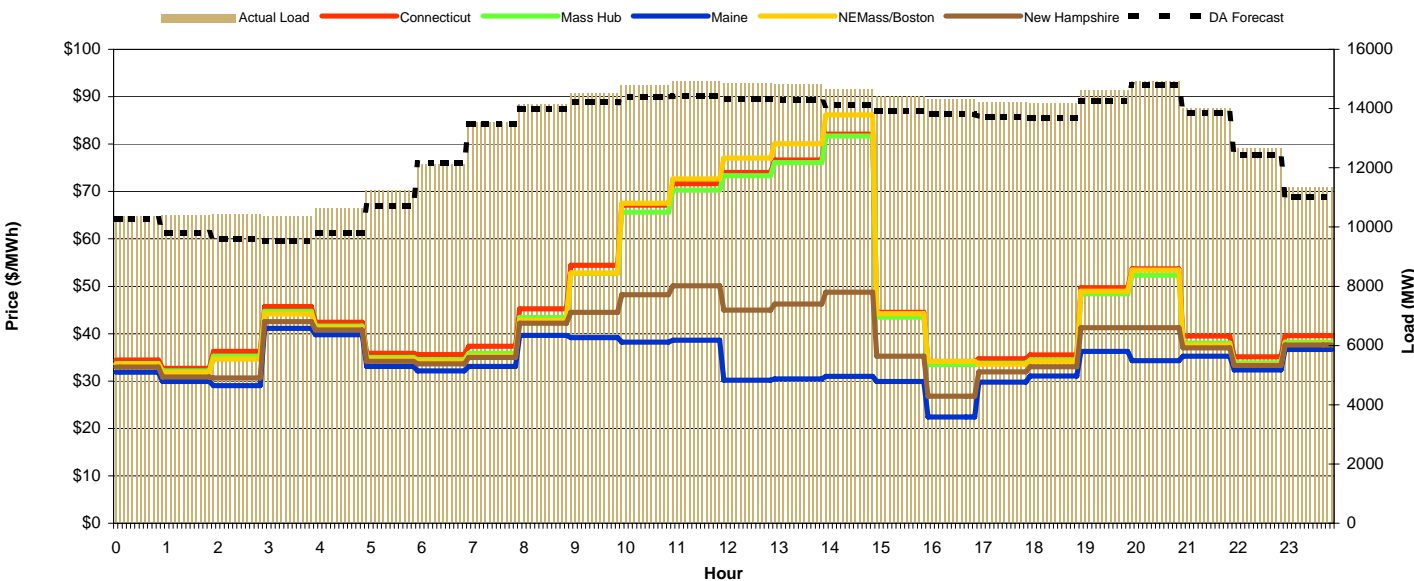




ISO-NE Daily Report

Thursday April 22, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	32.97	33.00	30.71	30.49	31.96	33.74	41.02	44.93	43.52	47.22	48.96	49.23	47.00	46.00	43.58	43.28	41.99	39.15	37.00	43.40	53.00	42.75	35.34	34.22	40.60	44.15	All	On Pk
NEMass/Boston	31.76	31.66	29.26	29.42	30.77	32.48	39.50	42.66	42.45	45.09	46.72	47.19	44.94	44.90	42.74	42.11	40.95	37.95	35.92	42.41	50.42	41.83	34.53	32.99	39.19	42.68		
New Hampshire	31.28	30.50	26.83	28.28	30.46	32.15	39.09	36.32	36.29	38.36	40.04	40.73	38.28	38.30	36.27	35.16	34.26	31.98	29.98	36.32	41.42	36.79	28.65	32.17	34.58	36.20		
Maine	29.98	29.09	25.26	26.91	29.23	30.86	37.52	33.31	32.98	34.93	36.61	37.14	34.79	34.68	32.77	31.74	30.96	29.12	27.24	32.97	37.28	33.66	25.92	30.74	31.90	32.88		
Mass Hub	32.00	31.98	29.72	29.68	31.00	32.72	39.82	43.41	42.65	45.63	47.31	47.57	45.39	45.07	42.87	42.45	41.29	38.42	36.42	42.62	51.09	41.91	34.94	33.25	39.55	43.07		
Cleared Load (GW)	10.2	10.3	10.0	10.0	10.3	10.4	11.6	13.1	14.0	14.1	14.1	14.2	14.0	14.0	13.8	13.7	13.7	13.6	13.7	14.1	13.9	13.2	12.0	10.4				

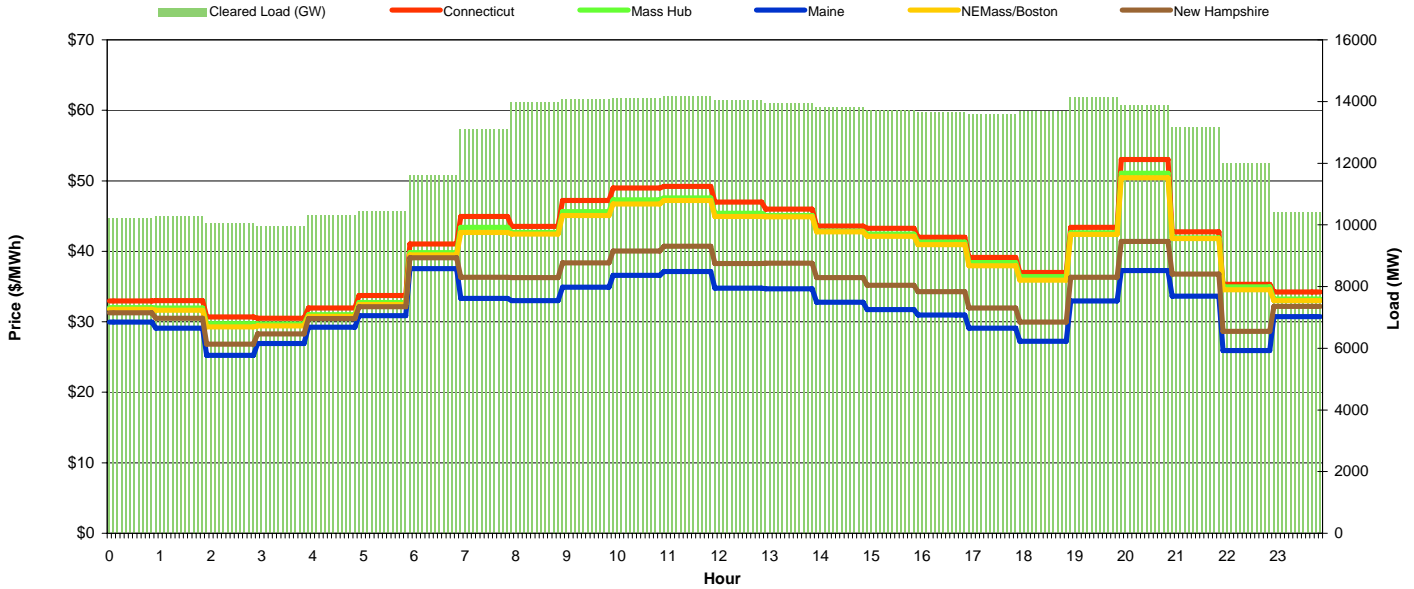

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	34.28	32.75	31.38	30.61	32.75	32.14	38.38	51.75	43.64	50.43	44.88	55.81	58.05	58.55	51.06	45.62	45.97	41.85	35.81	36.32	41.85	35.79	34.69	32.55	41.54	45.75	All	On Pk
NEMass/Boston	32.99	31.49	30.22	29.51	31.54	31.07	36.77	48.55	41.26	47.71	42.43	52.66	54.76	55.27	48.22	43.16	43.42	39.76	34.18	34.92	39.76	33.97	32.95	31.31	39.50	43.31		
New Hampshire	32.76	31.20	29.94	29.25	31.28	30.88	36.61	48.22	40.68	46.94	41.77	51.81	53.82	54.39	47.54	42.56	42.77	39.22	33.65	33.76	37.53	33.51	32.75	30.99	38.91	42.56		
Maine	31.82	30.25	29.08	28.53	30.49	30.18	35.42	45.41	38.20	43.96	39.18	48.42	50.32	50.74	44.29	39.81	39.75	36.79	31.77	31.72	34.62	31.74	31.26	29.83	36.82	39.87		
Mass Hub	33.33	31.88	30.60	29.87	31.92	31.38	37.14	49.34	41.82	48.29	42.91	53.27	55.39	55.90	48.78	43.67	43.96	40.21	34.53	35.11	39.99	34.35	33.36	31.59	39.94	43.81		
DA Forecast Load (GW)	10.28	9.81	9.58	9.54	9.81	10.77	12.38	13.73	14.31	14.58	14.78	14.82	14.70	14.70	14.51	14.34	14.29	14.20	14.12	14.51	15.00	14.00	12.61	11.16				
Forecast Error %	5.8%	11.5%	11.8%	11.2%	10.6%	3.4%	-3.3%	-2.4%	-1.3%	-0.2%	0.5%	1.5%	2.3%	2.4%	2.5%	2.2%	2.1%	2.1%	1.9%	0.5%	-1.0%	-0.2%	0.3%	1.3%				

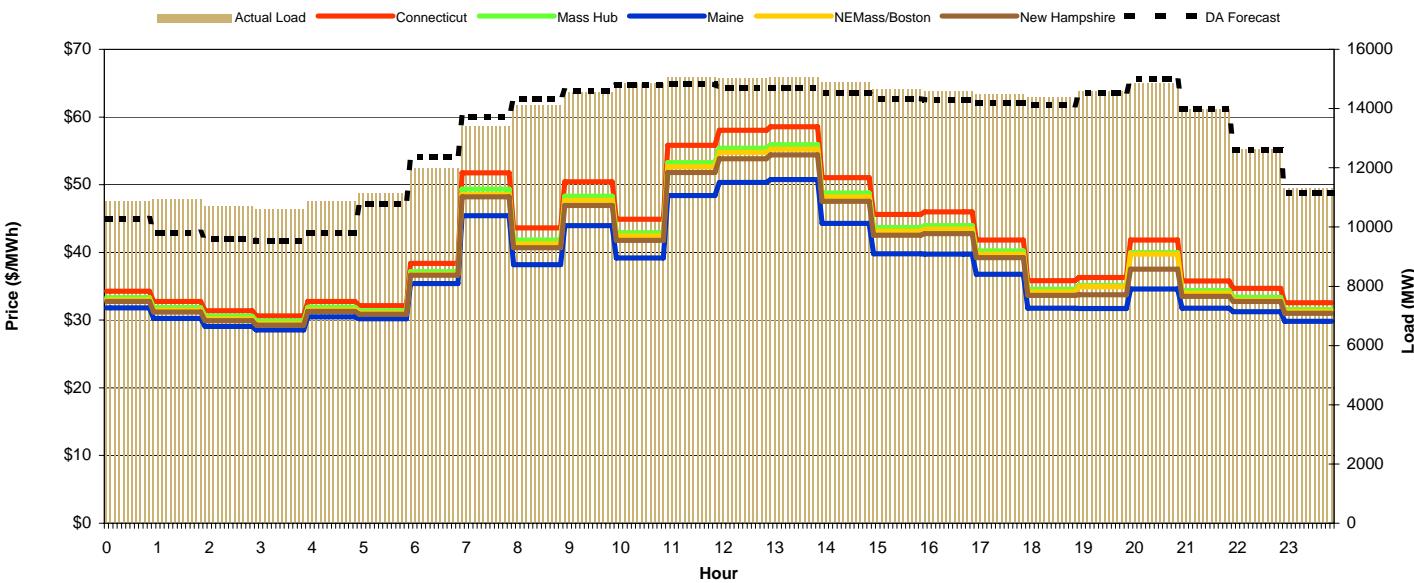




ISO-NE Daily Report

Friday April 23, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	30.88	31.00	30.63	30.63	31.62	32.26	37.35	40.78	43.49	43.93	45.75	46.21	44.12	44.80	43.10	40.55	40.68	35.58	35.31	41.21	45.48	38.57	35.15	34.86	38.50	41.54	All	On Pk
NEMass/Boston	29.74	29.73	29.50	29.50	30.46	31.07	35.98	38.98	41.96	42.34	44.50	44.90	42.71	43.85	42.05	39.58	39.61	34.48	34.27	40.12	44.50	37.34	34.10	33.57	37.29	40.33		
New Hampshire	29.42	29.43	29.19	29.19	30.13	30.74	35.59	37.14	39.46	39.59	40.86	41.19	39.50	40.22	39.14	36.78	37.22	33.12	32.70	37.71	40.84	36.08	32.60	33.21	35.46	37.76		
Maine	28.23	28.24	28.00	28.00	28.91	29.49	34.15	34.99	36.96	36.96	37.78	38.07	36.66	37.17	36.45	34.22	34.82	31.33	30.84	35.28	37.74	34.22	30.77	31.87	33.38	35.27		
Mass Hub	29.96	29.96	29.72	29.72	30.68	31.31	36.28	39.05	41.99	42.32	44.37	44.76	42.62	43.73	42.03	39.55	39.64	34.61	34.36	40.14	44.38	37.50	34.20	33.83	37.36	40.33		
Cleared Load (GW)	10.1	10.4	10.0	9.9	10.2	10.4	11.6	13.5	13.9	14.3	14.4	14.4	14.2	14.0	13.8	13.6	13.6	13.5	13.4	13.8	13.9	13.1	11.9	10.3				

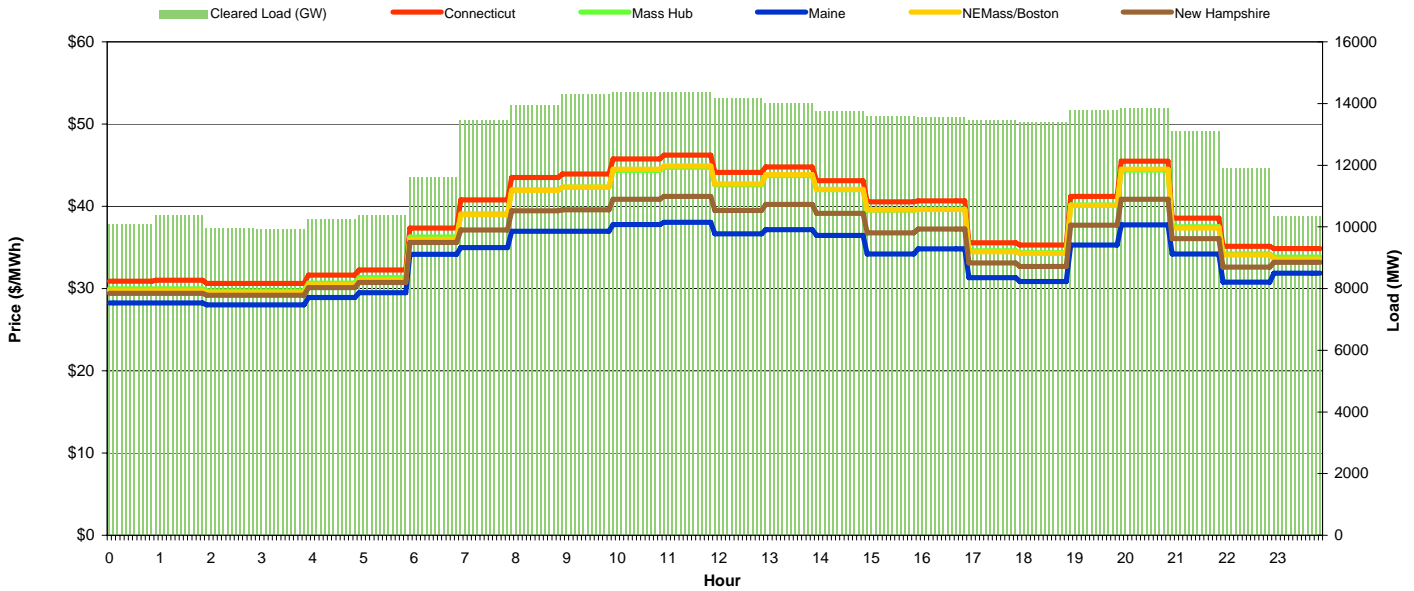

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	33.87	22.64	32.06	32.31	30.95	32.35	34.48	35.71	35.67	37.20	43.23	44.48	35.91	36.69	42.93	43.01	37.17	34.62	34.03	35.54	39.83	35.20	34.73	35.12	35.82	37.87	All	On Pk
NEMass/Boston	32.74	21.91	31.17	31.22	29.80	31.15	32.89	33.70	33.78	35.30	40.83	41.98	34.07	34.68	40.34	40.28	34.96	33.00	32.46	33.96	37.60	33.45	33.05	33.83	34.09	35.84		
New Hampshire	32.61	21.83	30.98	31.10	29.66	30.87	32.48	33.27	33.37	34.84	40.31	41.41	33.59	34.16	39.82	39.12	33.89	32.38	31.86	33.29	36.28	33.08	32.84	33.54	33.61	35.22		
Maine	31.79	21.27	30.15	30.22	28.78	29.86	31.07	31.42	31.53	32.88	37.90	38.74	31.65	32.02	37.25	36.40	31.72	30.58	30.12	31.50	34.03	31.38	31.32	32.48	31.92	33.15		
Mass Hub	33.03	22.14	31.49	31.60	30.18	31.48	33.27	34.21	34.24	35.75	41.36	42.51	34.45	35.09	40.90	40.92	35.48	33.36	32.80	34.28	38.11	33.85	33.45	34.10	34.50	36.30		
DA Forecast Load (GW)	10.39	9.89	9.66	9.58	9.84	10.71	12.12	13.49	14.13	14.44	14.60	14.59	14.47	14.37	14.17	13.95	13.83	13.63	13.43	13.71	14.21	13.42	12.34	11.10				
Forecast Error %	3.3%	7.6%	9.2%	10.0%	8.9%	1.7%	-2.3%	-1.7%	-0.9%	-0.3%	0.4%	0.9%	0.7%	0.9%	1.0%	1.2%	1.1%	1.4%	1.8%	1.0%	0.7%	1.2%	1.3%	1.8%				

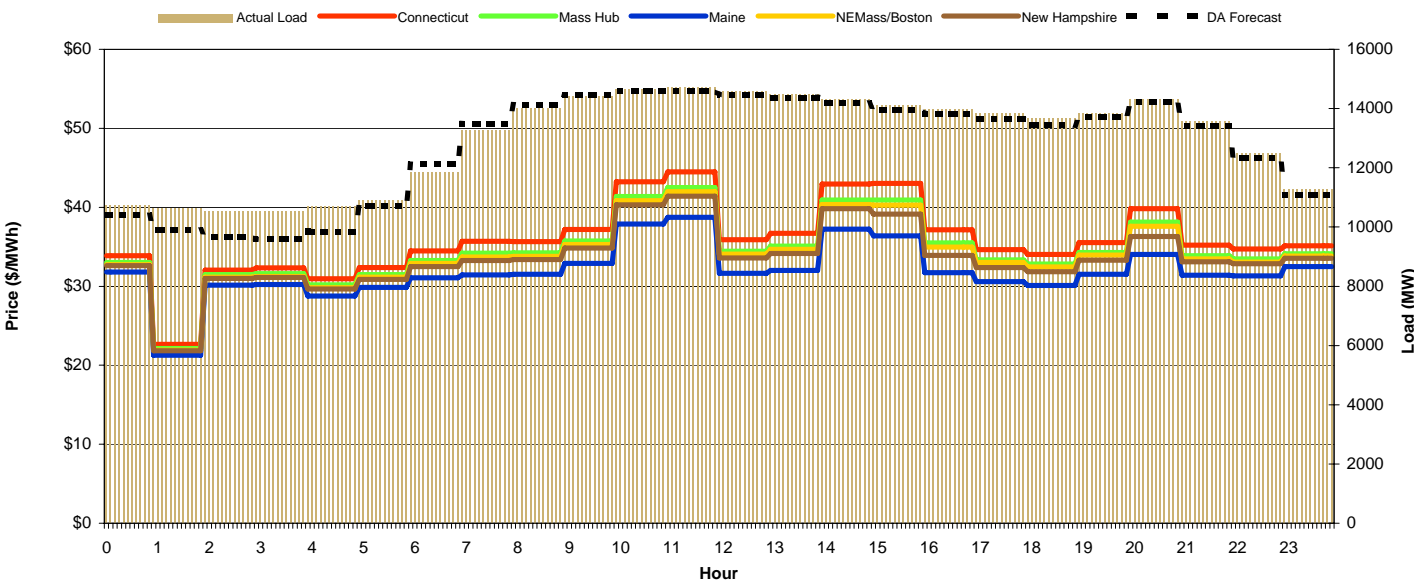




ISO-NE Daily Report

Saturday April 24, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	33.83	30.68	30.68	30.68	31.09	30.69	33.87	31.16	36.92	41.42	45.69	42.52	38.42	36.38	35.80	35.22	35.91	35.42	35.61	39.69	47.32	40.08	34.94	35.80	36.24	38.28	All	On Pk
NEMass/Boston	32.58	29.55	29.55	29.55	29.94	29.56	32.62	30.01	35.55	39.89	44.00	40.95	37.00	35.03	34.47	33.92	34.59	34.11	34.29	38.22	45.57	38.60	33.65	34.47	34.90	36.87		
New Hampshire	32.22	29.22	29.22	29.22	29.61	29.23	32.26	29.68	35.16	39.45	43.52	40.50	36.59	34.65	34.10	33.54	34.21	33.74	33.91	37.80	45.07	38.18	33.28	34.10	34.52	36.46		
Maine	30.88	28.01	28.01	28.01	28.38	28.02	30.92	28.45	33.70	37.81	41.71	38.82	35.07	33.21	32.68	32.15	32.79	32.34	32.51	36.23	43.20	36.59	31.90	32.68	33.09	34.95		
Mass Hub	32.87	29.81	29.81	29.81	30.20	29.82	32.90	30.27	35.87	40.24	44.39	41.31	37.33	35.34	34.78	34.22	34.89	34.41	34.59	38.56	45.97	38.94	33.95	34.78	35.21	37.19		
Cleared Load (GW)	10.0	9.7	9.3	9.2	9.3	9.5	9.7	10.4	12.0	12.7	12.6	12.7	12.4	12.2	11.9	11.8	12.0	11.9	12.1	12.6	12.6	11.9	11.1	10.0				

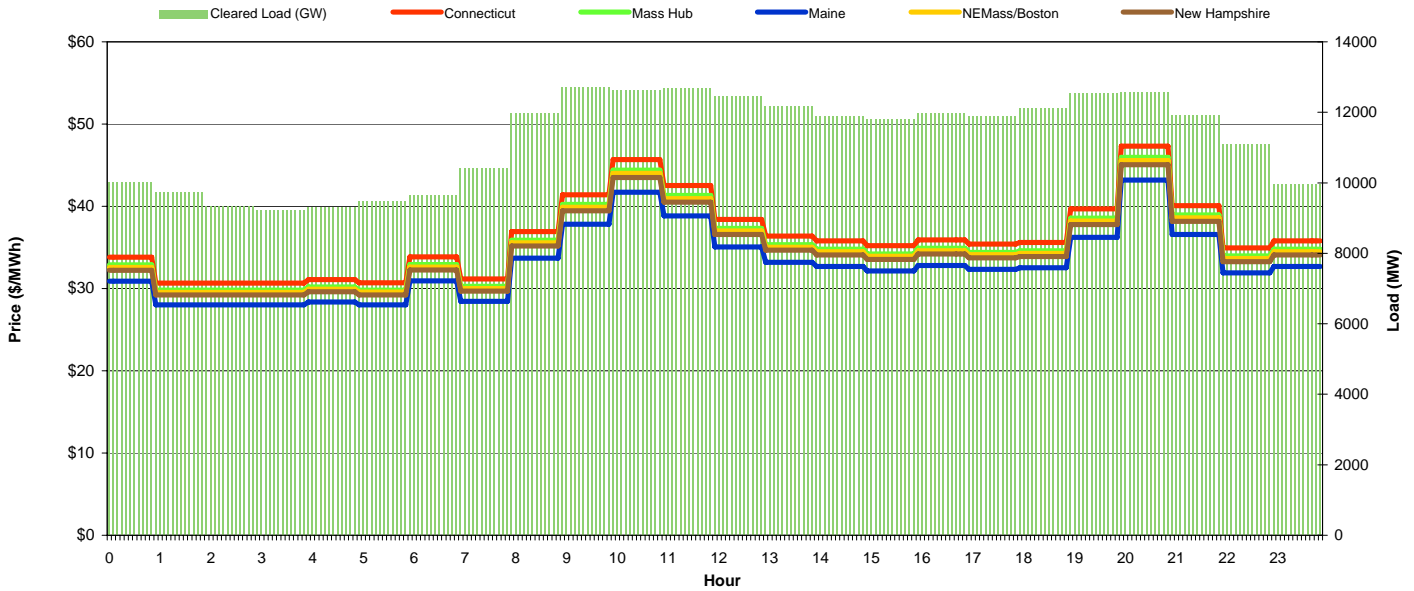

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	38.31	30.74	31.46	31.62	33.10	32.87	33.94	33.98	37.93	38.87	46.11	38.19	35.70	35.01	36.73	34.77	35.84	37.29	33.89	38.95	43.09	39.91	35.32	34.73	36.18	37.60	All	On Pk
NEMass/Boston	36.91	29.87	30.46	30.64	31.91	31.75	32.89	32.50	36.13	37.04	43.74	36.20	33.96	33.27	34.89	33.16	34.18	35.56	32.46	37.41	41.15	38.04	33.68	33.56	34.64	35.84		
New Hampshire	36.62	29.62	30.25	30.44	31.73	31.60	32.76	32.31	35.97	36.69	43.28	35.85	33.57	32.83	34.42	32.67	33.70	35.13	32.07	36.96	40.73	37.71	33.55	33.37	34.33	35.47		
Maine	35.83	28.99	29.54	29.73	31.08	31.09	32.10	31.18	34.57	35.01	41.08	34.27	32.10	31.32	32.88	31.22	32.19	33.52	30.69	35.40	38.91	35.88	31.88	32.06	33.02	33.88		
Mass Hub	37.24	30.13	30.77	30.97	32.27	32.06	33.16	32.91	36.64	37.50	44.30	36.63	34.31	33.63	35.30	33.52	34.58	35.99	32.77	37.72	41.56	38.49	34.10	33.82	35.02	36.25		
DA Forecast Load (GW)	10.37	9.84	9.55	9.47	9.56	9.83	10.27	11.21	12.28	12.84	13.02	13.05	12.89	12.59	12.37	12.22	12.31	12.35	12.46	12.80	13.37	12.75	11.85	10.75				
Forecast Error %	2.1%	4.5%	5.0%	4.7%	4.7%	2.9%	0.7%	1.1%	-0.1%	0.3%	0.9%	0.3%	0.3%	0.8%	0.8%	1.0%	0.6%	1.5%	0.8%	0.7%	0.4%	0.7%	0.3%	0.9%				

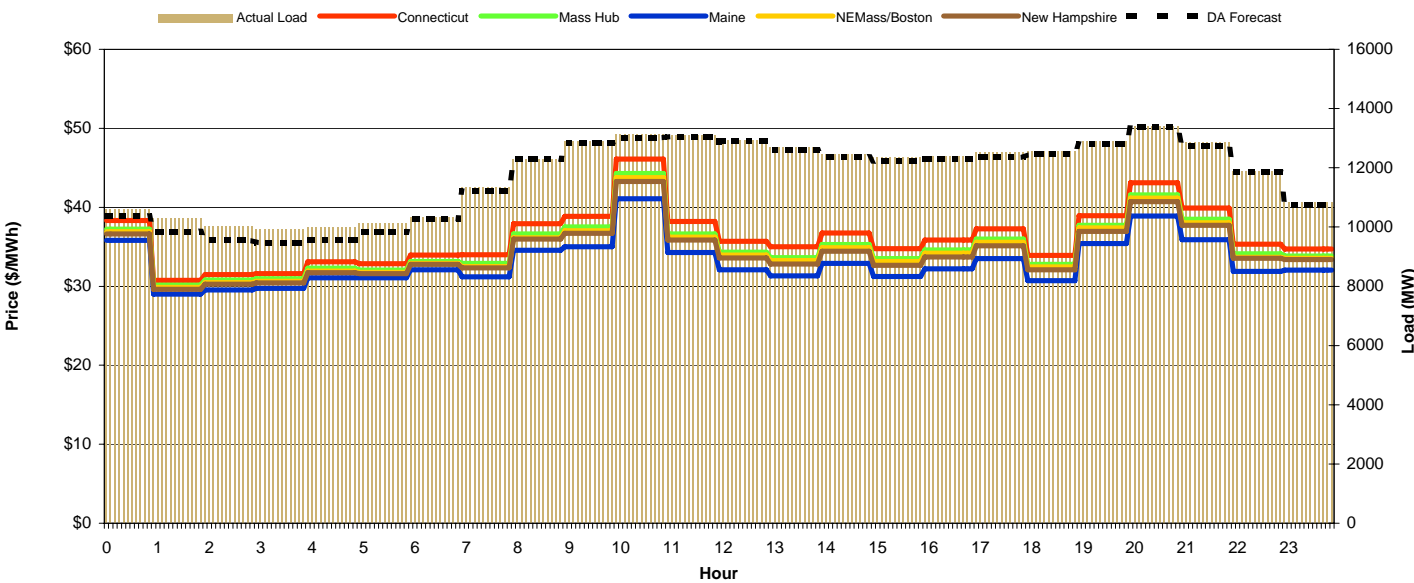




ISO-NE Daily Report

Sunday April 25, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	34.87	31.39	31.09	30.77	30.75	30.75	31.07	30.77	36.07	39.93	43.87	43.68	46.00	46.19	44.00	44.00	43.31	52.37	49.00	50.00	53.00	49.00	36.46	33.95	40.10	44.23	All	On Pk
NEMass/Boston	33.53	30.19	29.90	29.60	29.58	29.58	29.88	29.60	32.67	34.81	36.95	37.19	36.29	34.89	34.60	34.60	34.69	39.69	34.62	42.50	48.01	34.72	32.67	32.65	34.31	36.16		
New Hampshire	33.15	29.84	29.56	29.26	29.24	29.24	29.54	29.26	32.65	35.03	37.43	37.60	37.25	36.14	35.54	35.54	35.50	41.09	36.36	42.97	47.97	36.44	32.70	32.28	34.65	36.84		
Maine	31.72	28.56	28.29	28.00	27.98	27.98	28.27	28.00	30.87	32.86	34.86	35.10	34.18	32.82	32.59	32.59	32.68	37.35	32.50	40.09	45.30	32.60	30.86	30.89	32.37	34.08		
Mass Hub	33.85	30.47	30.18	29.87	29.85	29.85	30.16	29.87	33.94	36.84	39.78	39.83	40.40	39.74	38.59	38.59	38.32	45.13	40.65	45.44	49.80	40.70	34.06	32.95	36.62	39.48		
Cleared Load (GW)	9.3	9.2	9.2	9.0	8.8	8.6	8.8	9.7	11.0	11.8	12.2	12.4	12.4	12.3	12.1	12.1	12.1	12.5	12.6	13.5	13.5	11.8	10.9	9.8				

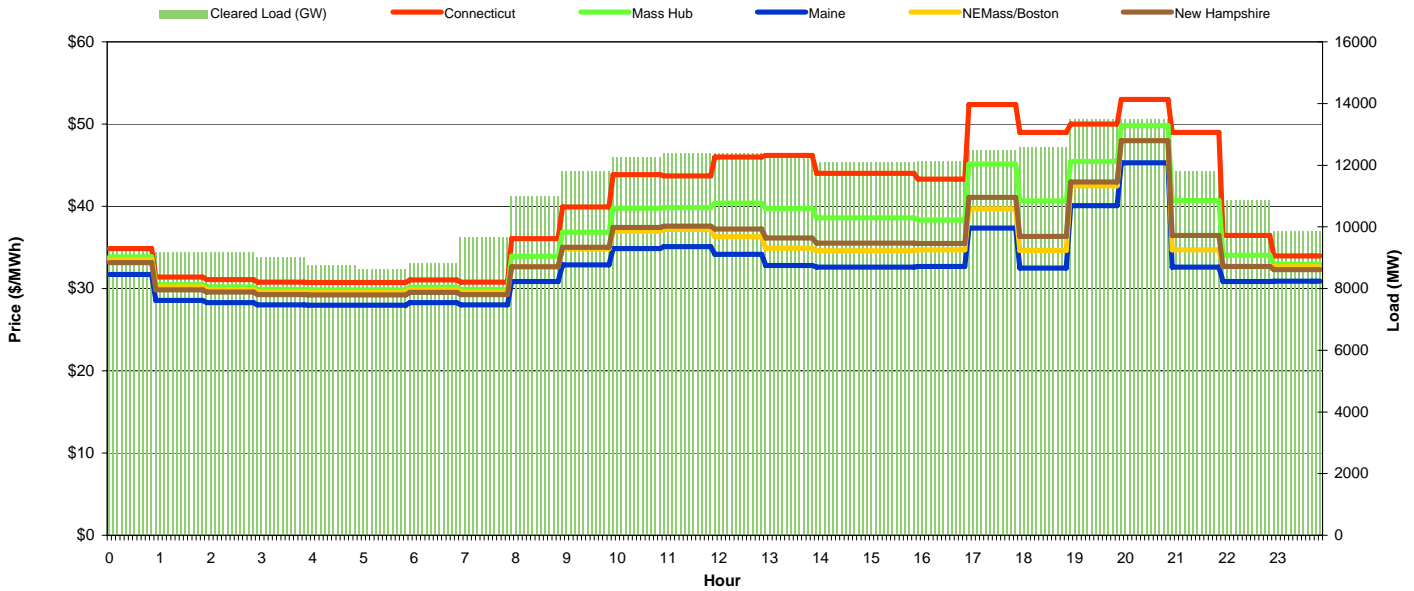

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	33.51	27.00	27.21	25.27	26.77	30.94	31.17	30.32	34.56	37.71	41.62	42.37	44.18	46.43	44.06	39.10	43.40	42.10	38.89	44.58	45.15	53.22	36.91	31.49	37.42	41.54	All	On Pk
NEMass/Boston	32.46	26.16	26.40	24.47	25.92	30.01	29.93	28.96	32.91	35.81	39.24	39.61	40.78	38.19	40.52	36.69	40.69	38.69	36.79	42.32	42.69	44.42	33.17	30.29	34.88	38.22		
New Hampshire	32.41	26.07	26.31	24.39	25.84	29.89	29.78	28.75	32.66	35.53	38.77	38.92	40.12	38.40	39.92	36.04	39.98	38.22	36.19	41.62	41.97	44.88	33.19	30.06	34.58	37.82		
Maine	31.50	25.27	25.51	23.67	25.12	29.05	28.88	27.63	31.52	34.15	36.86	36.58	37.55	35.08	37.31	33.86	37.49	35.75	34.28	39.30	39.51	41.54	31.35	28.96	32.82	35.61		
Mass Hub	32.72	26.39	26.66	24.71	26.17	30.28	30.32	29.38	33.43	36.36	39.89	40.34	41.76	41.28	41.62	37.37	41.44	39.76	37.34	42.90	43.24	47.60	34.44	30.62	35.67	39.26		
DA Forecast Load (GW)	9.98	9.47	9.18	9.05	9.06	9.22	9.43	10.20	11.35	12.21	12.62	12.81	12.88	12.74	12.60	12.62	12.76	13.07	13.23	13.64	14.00	13.11	11.93	10.70				
Forecast Error %	0.8%	3.0%	5.5%	5.5%	3.6%	2.0%	3.5%	1.9%	-0.6%	-0.8%	0.2%	1.2%	1.3%	1.5%	1.3%	0.5%	0.6%	0.6%	1.6%	1.1%	0.2%	0.4%	0.1%	0.3%				

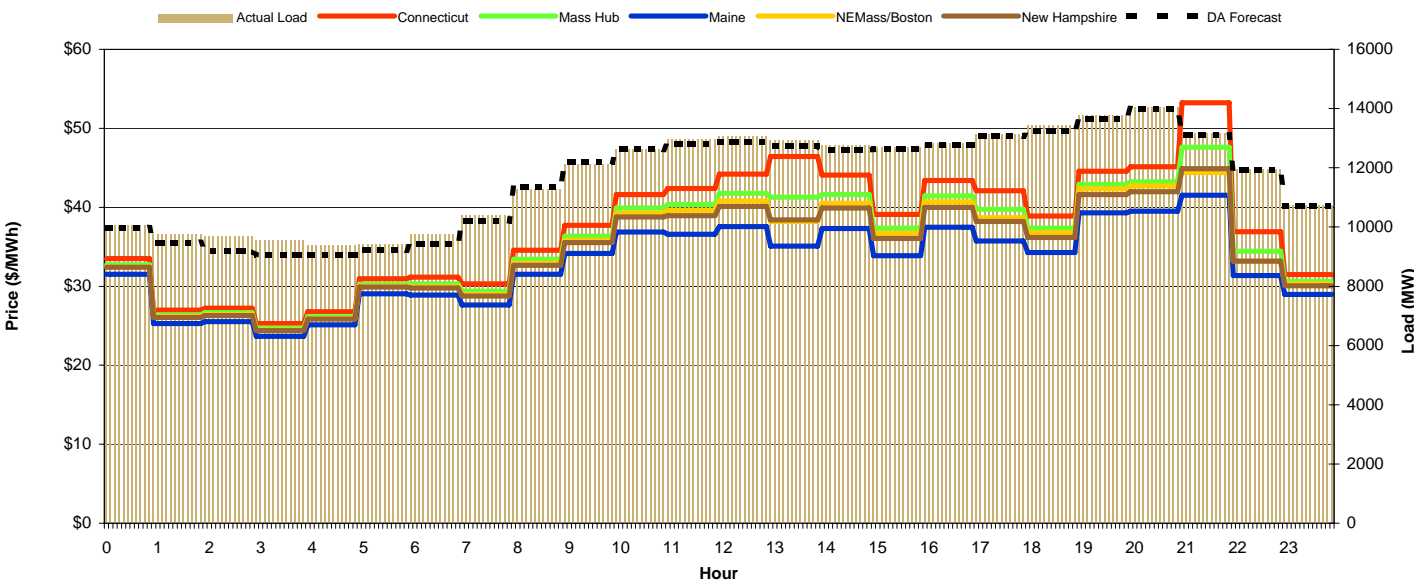




ISO-NE Daily Report

Monday April 26, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	30.82	32.44	31.74	31.70	30.82	33.93	41.07	54.22	55.47	53.00	52.47	53.00	51.09	53.12	53.00	53.26	53.37	48.96	51.12	56.66	57.48	46.31	45.49	34.01	46.02	52.38	All	On Pk
NEMass/Boston	29.59	31.14	30.11	29.59	29.59	32.57	39.43	35.38	38.22	39.92	41.20	42.44	41.56	40.01	39.83	38.43	39.29	41.53	39.98	42.13	44.33	39.46	33.74	32.65	37.17	39.84		
New Hampshire	29.26	30.79	29.84	29.41	29.26	32.21	38.99	37.86	40.38	41.36	42.32	43.42	42.39	41.46	41.29	40.19	40.91	42.01	41.11	43.78	45.71	39.88	35.08	32.29	37.97	41.20		
Maine	28.02	29.48	28.50	28.00	28.02	30.84	37.33	33.17	35.89	37.58	38.82	40.01	39.20	37.67	37.49	36.13	36.97	39.22	37.68	39.66	41.77	37.26	31.76	30.91	35.06	37.52		
Mass Hub	29.88	31.45	30.58	30.27	29.88	32.89	39.82	43.41	45.31	45.21	45.70	46.62	45.31	45.31	45.16	44.48	45.18	44.46	44.57	48.20	49.77	42.15	38.65	32.97	40.72	44.97		
Cleared Load (GW)	9.3	9.3	9.3	9.2	9.3	10.0	11.2	13.2	13.7	14.1	14.4	14.3	14.0	13.9	13.7	13.7	14.0	13.9	14.2	14.3	13.1	11.6	10.2					

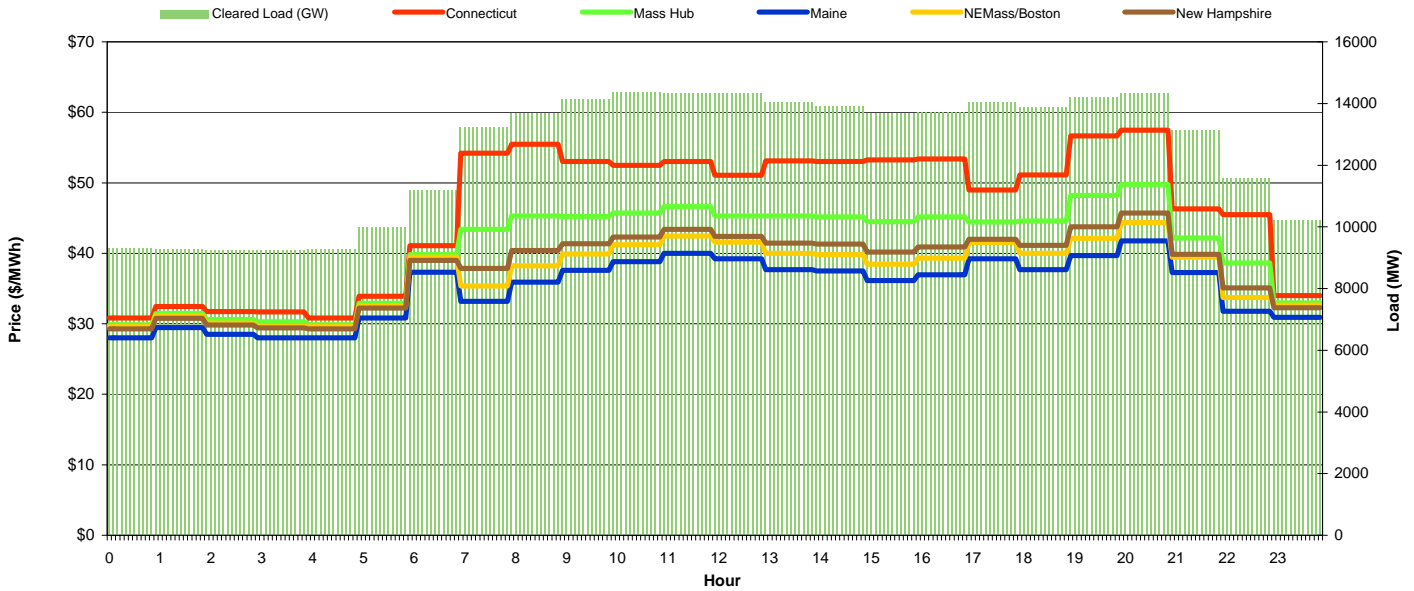

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	30.14	30.49	31.42	30.09	29.44	30.92	42.50	42.31	49.26	47.06	48.04	55.11	53.13	49.48	51.04	51.56	50.39	55.49	52.33	61.79	41.63	54.38	39.87	33.86	44.24	50.18	All	On Pk
NEMass/Boston	29.11	29.25	30.09	28.82	28.40	29.99	40.81	39.67	41.22	43.31	45.53	49.97	44.23	46.71	42.33	40.58	41.02	44.58	44.80	53.36	39.41	39.19	33.38	32.40	39.09	43.08		
New Hampshire	28.96	29.08	29.96	28.69	28.29	29.95	40.88	39.53	41.90	43.27	45.33	50.01	44.98	46.43	43.06	41.74	41.90	45.60	45.13	53.54	38.96	41.07	34.09	32.36	39.36	43.53		
Maine	28.05	28.12	29.10	27.89	27.58	29.27	39.63	37.25	38.44	40.50	42.80	46.61	41.12	43.48	39.22	37.58	38.03	41.09	41.33	49.21	36.57	36.43	31.58	31.24	36.76	40.08		
Mass Hub	29.42	29.70	30.62	29.32	28.80	30.36	41.45	40.63	44.28	44.59	46.27	51.55	47.33	47.44	45.43	44.59	44.46	48.58	47.51	56.30	40.05	45.15	35.88	32.92	40.94	45.63		
DA Forecast Load (GW)	9.90	9.45	9.28	9.29	9.61	10.61	12.39	13.80	14.37	14.71	14.98	15.04	14.97	14.92	14.76	14.63	14.63	14.78	14.81	15.07	15.29	14.27	12.79	11.28				
Forecast Error %	0.2%	5.5%	8.2%	8.2%	6.0%	1.4%	-1.4%	-0.5%	-0.5%	-0.8%	-0.9%	-0.6%	-0.6%	-0.5%	-0.7%	-1.0%	-0.9%	-0.6%	0.3%	0.5%	-1.0%	-1.1%	-1.1%	1.6%				

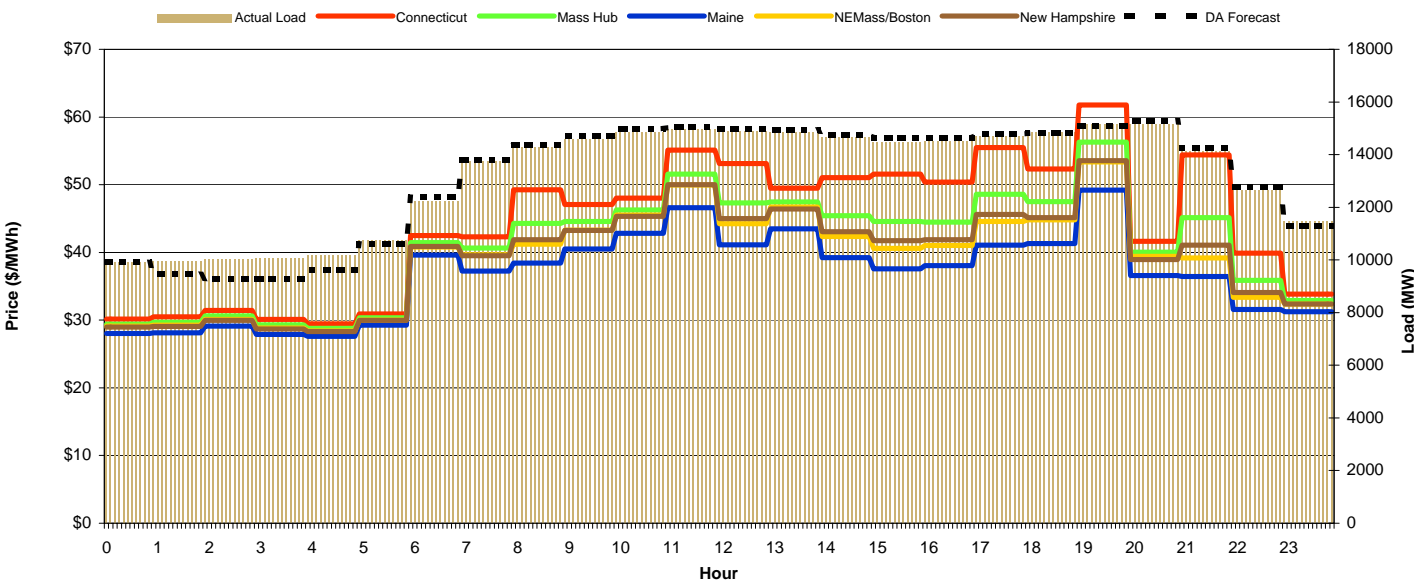




ISO-NE Daily Report

Tuesday April 27, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	31.78	31.98	31.74	32.21	33.06	34.03	41.74	52.58	54.45	52.07	56.53	56.31	56.09	53.73	55.00	52.18	52.66	50.38	49.00	53.00	55.71	45.74	39.35	35.12	46.10	52.17	All	On Pk
NEMass/Boston	30.42	30.69	30.42	30.89	31.74	32.57	39.95	39.91	38.98	42.00	41.89	43.04	40.06	38.40	37.21	37.20	37.20	38.19	37.06	41.40	44.85	38.36	34.10	33.61	37.09	39.37	46.10	52.17
New Hampshire	30.08	30.34	30.08	30.54	31.38	32.21	39.50	41.27	40.83	42.89	43.54	44.44	41.98	40.23	39.47	39.00	39.08	39.51	38.36	42.04	45.82	38.87	34.34	33.24	37.88	40.73	37.09	39.37
Maine	28.75	29.00	28.75	29.19	30.00	30.78	37.76	37.51	36.57	39.53	39.34	40.45	37.58	36.02	34.84	34.90	34.89	35.90	34.84	38.96	42.22	36.14	32.16	31.77	34.91	36.99	34.91	36.99
Mass Hub	30.77	31.04	30.78	31.24	32.10	32.94	40.40	45.18	45.31	45.98	47.84	48.39	46.62	44.67	44.55	43.33	43.72	43.26	42.03	44.85	49.27	41.30	36.14	33.99	40.65	44.53	40.65	44.53
Cleared Load (GW)	9.6	10.0	9.7	9.8	9.8	10.1	11.9	13.2	13.7	14.0	14.0	14.1	13.9	13.9	13.6	13.5	13.5	13.5	13.8	14.3	14.3	13.1	11.8	10.3				

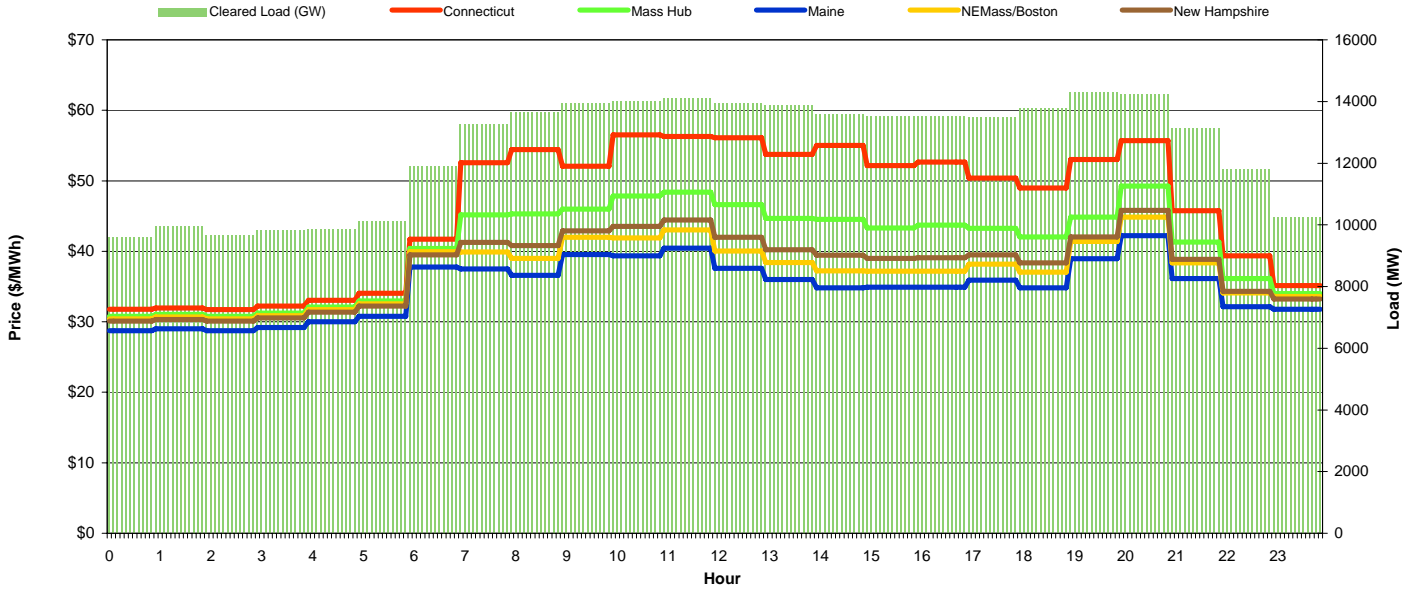

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	37.01	34.22	34.06	33.22	31.40	31.14	43.09	55.24	49.57	53.42	53.14	43.02	40.07	45.45	51.06	49.66	40.82	40.37	41.81	39.30	44.65	46.36	40.53	34.70	42.22	45.90	All	On Pk
NEMass/Boston	35.27	32.52	32.37	31.57	29.96	29.80	41.30	49.30	36.27	36.23	36.14	36.53	37.39	41.68	38.56	38.04	38.95	38.67	40.00	37.68	42.53	43.88	35.16	32.94	37.20	39.19	42.22	45.90
New Hampshire	35.30	32.50	32.34	31.54	29.87	29.67	41.35	50.23	38.32	38.93	38.86	37.51	37.73	42.28	40.69	40.00	39.18	38.88	40.18	37.77	42.62	44.08	35.95	33.08	37.87	40.20	37.87	40.20
Maine	34.14	31.38	31.22	30.48	28.80	28.63	40.18	48.33	34.28	33.41	32.58	33.15	32.27	30.48	32.77	33.05	33.34	34.65	32.10	33.10	33.53	42.86	34.54	32.33	33.82	34.65	33.82	34.65
Mass Hub	35.90	33.16	33.05	32.26	30.56	30.32	41.87	51.39	41.43	42.90	42.72	38.86	38.16	42.85	43.30	42.46	39.47	39.15	40.50	38.08	43.05	44.49	37.08	33.50	39.02	41.62	39.02	41.62
DA Forecast Load (GW)	10.37	9.87	9.65	9.60	9.90	10.96	12.76	14.15	14.58	14.83	15.02	15.02	14.84	14.77	14.54	14.35	14.31	14.46	14.54	14.90	15.17	14.31	12.94	11.47				
Forecast Error %	4.3%	8.1%	9.6%	10.7%	9.1%	4.2%	-2.0%	-1.5%	-0.7%	-0.7%	-0.3%	0.1%	0.7%	1.0%	1.7%	2.5%	3.5%	3.6%	3.5%	2.0%	1.3%	1.1%	0.6%	1.9%				

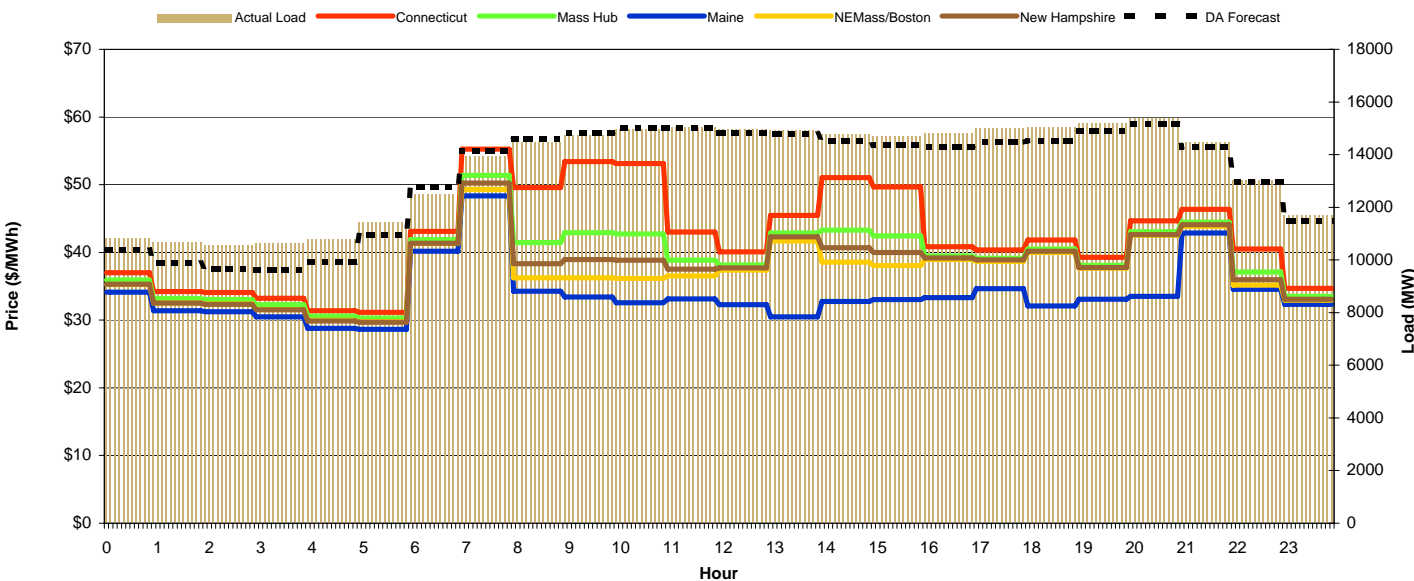




ISO-NE Daily Report

Wednesday April 28, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	31.43	32.83	32.86	30.91	32.83	34.12	38.96	46.34	45.66	47.53	48.08	48.73	49.13	44.96	41.91	46.06	41.26	42.08	40.74	46.85	51.68	45.64	38.12	36.19	41.45	45.30	All	On Pk
NEMass/Boston	30.00	30.27	29.54	29.51	30.27	32.56	37.17	44.19	43.53	45.61	46.27	46.78	46.70	42.91	39.81	39.44	39.15	39.97	38.63	44.94	48.00	38.68	34.55	32.56	38.79	42.45		
New Hampshire	29.68	30.13	29.54	29.19	30.13	32.21	37.91	43.73	43.08	45.14	45.79	46.29	46.24	42.48	39.43	39.83	38.78	39.59	38.27	44.47	47.80	39.14	34.52	32.57	38.58	42.16		
Maine	28.31	28.54	27.83	27.84	28.54	32.49	39.54	41.70	37.46	32.31	32.31	34.95	32.21	32.16	31.10	31.06	31.11	31.20	31.21	32.22	31.18	31.26	24.45	30.69	31.74	32.37		
Mass Hub	30.40	31.16	30.77	29.89	31.16	32.99	37.66	44.79	44.12	45.98	46.54	47.11	47.64	43.45	40.42	41.98	39.78	40.59	39.26	45.33	49.09	41.45	35.86	33.91	39.64	43.34		
Cleared Load (GW)	9.9	10.2	10.1	10.3	10.5	10.5	12.1	13.7	14.1	14.3	14.4	14.4	14.2	14.1	13.9	13.7	14.0	14.1	14.1	14.4	14.4	13.3	12.2	10.5				

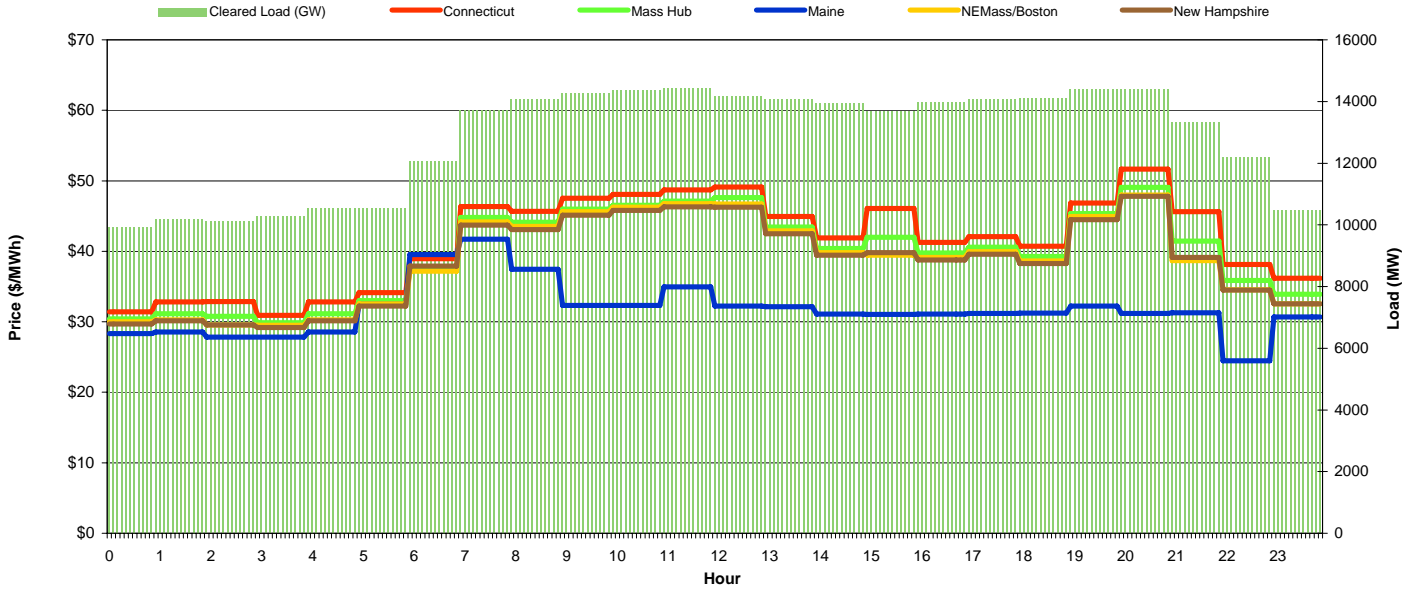

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	33.59	33.44	35.47	33.63	34.68	40.02	53.26	50.99	50.91	51.75	51.65	52.31	56.89	52.35	37.23	39.69	37.43	41.36	36.95	38.49	45.39	51.74	47.23	35.18	43.40	46.40	All	On Pk
NEMass/Boston	32.21	31.89	33.10	32.28	33.12	38.12	50.84	48.57	48.25	49.21	49.15	49.90	53.51	46.13	35.50	37.96	35.97	39.65	35.63	37.25	43.65	47.69	37.37	33.57	40.86	43.46		
New Hampshire	32.47	32.08	33.42	32.48	33.35	38.46	51.32	49.04	48.61	49.58	49.57	50.35	54.19	47.26	35.79	38.23	36.20	39.90	35.77	37.34	43.74	48.21	39.04	33.74	41.26	43.93		
Maine	31.68	31.24	32.52	31.93	32.78	37.95	50.63	47.91	46.10	40.38	33.27	32.34	31.64	32.28	31.82	31.79	32.58	32.92	33.10	36.17	37.57	43.98	37.13	33.18	35.95	36.31		
Mass Hub	32.73	32.57	34.17	32.95	33.85	38.86	51.59	49.27	49.04	49.95	49.86	50.53	54.52	48.32	36.01	38.51	36.40	40.21	35.99	37.57	44.07	49.02	41.24	34.16	41.72	44.41		
DA Forecast Load (GW)	10.70	10.28	10.07	10.05	10.37	11.44	13.16	14.46	14.81	15.00	15.12	15.15	15.00	14.93	14.71	14.53	14.56	14.68	14.74	15.18	15.50	14.52	13.06	11.60				
Forecast Error %	0.9%	7.5%	10.8%	10.5%	9.8%	1.9%	-0.7%	-0.4%	0.1%	0.5%	1.1%	1.0%	1.1%	1.0%	1.3%	1.7%	1.9%	2.6%	2.8%	1.2%	0.9%	1.2%	1.4%	2.1%				

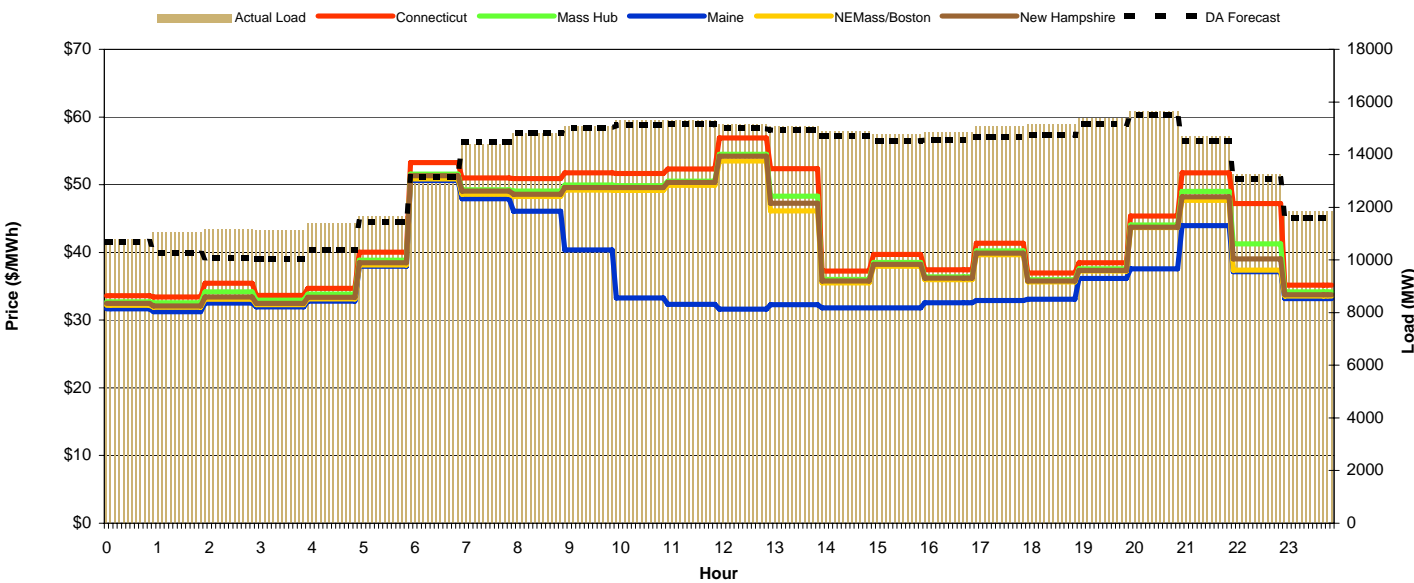




ISO-NE Daily Report

Thursday April 29, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	34.17	33.68	33.31	33.00	34.17	35.26	45.76	55.00	53.64	50.42	54.81	54.00	53.24	55.79	55.94	53.20	53.81	42.91	45.07	49.65	54.00	47.49	47.10	35.83	46.30	51.63	All	On Pk
NEMass/Boston	32.57	32.12	31.76	31.46	32.57	33.61	43.65	49.03	49.24	45.04	44.46	48.84	47.18	45.28	39.61	43.84	43.68	40.94	37.24	43.22	49.69	42.76	35.47	33.09	40.68	44.10		
New Hampshire	32.29	31.84	31.48	31.19	32.29	33.31	44.70	48.91	48.89	45.02	45.53	49.00	47.50	46.37	41.74	44.76	44.73	40.59	37.93	43.57	49.58	42.84	36.83	32.99	41.00	44.61		
Maine	31.50	30.45	30.11	30.00	31.73	34.60	47.00	47.51	40.00	36.81	37.21	37.00	34.43	33.45	31.95	32.02	31.21	31.27	35.20	40.90	47.08	40.50	33.46	31.35	35.70	36.88		
Mass Hub	33.03	32.57	32.20	31.91	33.03	34.08	44.29	52.10	51.49	47.55	49.08	51.40	50.05	49.99	46.60	48.01	48.36	41.51	40.42	45.73	51.22	44.53	40.34	34.05	43.06	47.40		
Cleared Load (GW)	10.0	10.0	10.0	10.0	10.1	10.4	12.1	13.5	13.9	14.3	14.1	14.1	13.9	13.6	13.3	13.2	13.2	13.5	13.3	14.0	14.0	13.1	11.7	10.5				

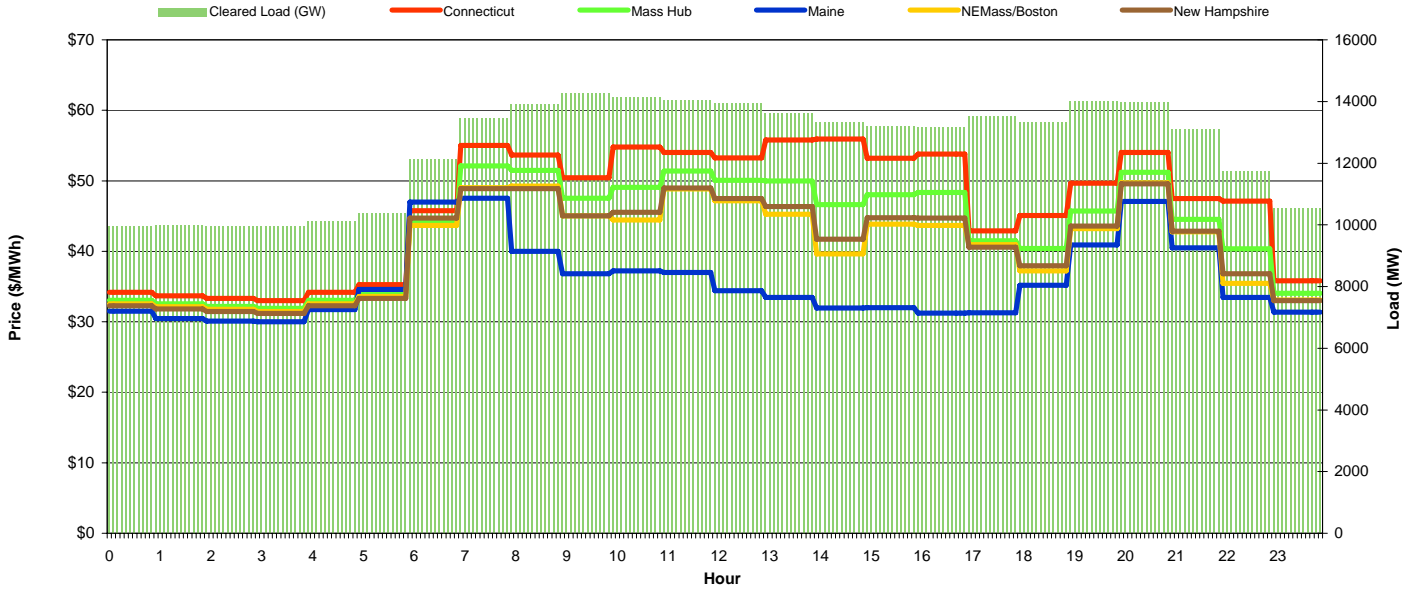

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	35.76	35.60	36.68	35.04	39.03	34.83	63.48	60.29	51.59	52.41	52.39	48.32	37.59	42.18	43.96	39.12	40.71	37.44	37.84	40.60	49.42	45.94	41.64	32.26	43.09	45.09	All	On Pk
NEMass/Boston	34.39	34.35	35.26	33.90	37.60	33.76	61.01	51.98	37.54	37.78	43.84	46.56	36.40	40.69	37.89	37.56	39.01	36.15	36.46	39.42	48.13	44.41	36.61	31.10	39.66	40.65		
New Hampshire	34.53	34.46	35.42	34.05	37.85	33.98	61.47	53.26	39.80	40.12	45.24	46.81	36.48	40.74	38.66	37.52	38.95	35.99	36.33	39.22	47.92	44.12	36.85	30.80	40.02	41.13		
Maine	33.86	33.84	34.89	33.76	37.59	33.82	60.66	50.89	33.47	31.98	31.70	31.63	32.64	31.37	32.46	30.16	32.81	32.91	31.01	32.82	45.20	41.44	32.47	29.99	35.56	34.69		
Mass Hub	34.91	34.89	35.91	34.40	38.25	34.12	61.68	54.91	42.87	43.37	46.96	46.94	36.60	41.00	40.05	37.92	39.37	36.30	36.63	39.50	48.13	44.65	38.46	31.43	40.80	42.10		
DA Forecast Load (GW)	10.83	10.42	10.17	10.14	10.45	11.48	13.23	14.55	14.87	14.96	15.04	14.92	14.72	14.58	14.34	14.15	14.14	14.19	14.27	14.75	15.20	14.35	12.91	11.49				
Forecast Error %	2.6%	8.0%	10.8%	8.0%	9.9%	0.1%	-1.2%	-1.4%	-1.6%	-1.2%	-0.6%	0.0%	0.3%	0.5%	0.2%	-0.2%	-0.7%	-1.6%	-2.9%	-1.4%	-0.9%	-0.3%	0.2%					

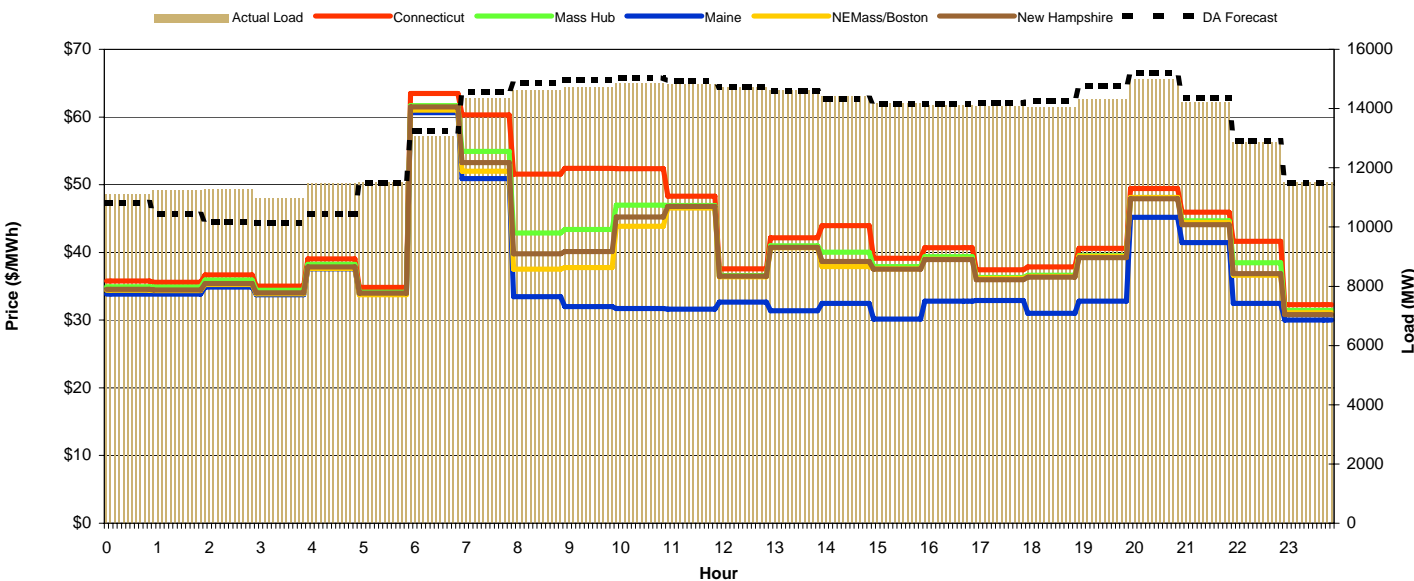




ISO-NE Daily Report

Friday April 30, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%

Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	31.79	32.84	32.84	32.17	30.98	32.18	37.95	50.43	46.96	47.22	50.28	49.50	51.70	52.36	50.89	52.86	53.13	44.44	41.20	40.18	51.00	46.25	36.26	35.51	42.96	47.79	All	On Pk
NEMass/Boston	30.29	29.54	29.54	29.49	29.52	30.66	36.16	37.15	37.78	38.44	39.06	40.44	40.00	41.02	39.68	37.96	38.61	36.19	36.34	38.29	42.90	36.39	34.39	33.84	35.99	38.42		
New Hampshire	30.11	29.67	29.67	29.52	29.35	30.47	36.55	38.86	38.79	39.20	40.39	41.39	41.40	42.34	41.00	39.93	40.51	37.06	36.64	38.06	43.65	37.53	34.21	33.63	36.66	39.44		
Maine	28.90	28.15	28.15	28.12	28.17	29.25	34.50	35.26	35.93	36.81	37.11	38.46	38.00	38.98	37.70	36.00	36.63	34.42	34.62	36.53	40.83	34.59	32.81	32.28	34.26	36.54		
Mass Hub	30.74	30.79	30.79	30.47	29.96	31.11	36.69	42.75	41.47	41.96	43.62	44.06	44.76	45.62	44.23	44.11	44.75	39.57	38.23	38.85	46.17	40.48	34.97	34.33	38.77	42.23		
Cleared Load (GW)	9.8	10.0	10.1	10.2	10.3	10.3	12.1	13.2	13.8	14.2	14.0	14.1	13.9	14.1	13.8	13.4	13.4	13.0	13.1	13.7	13.6	12.8	11.7	10.1				

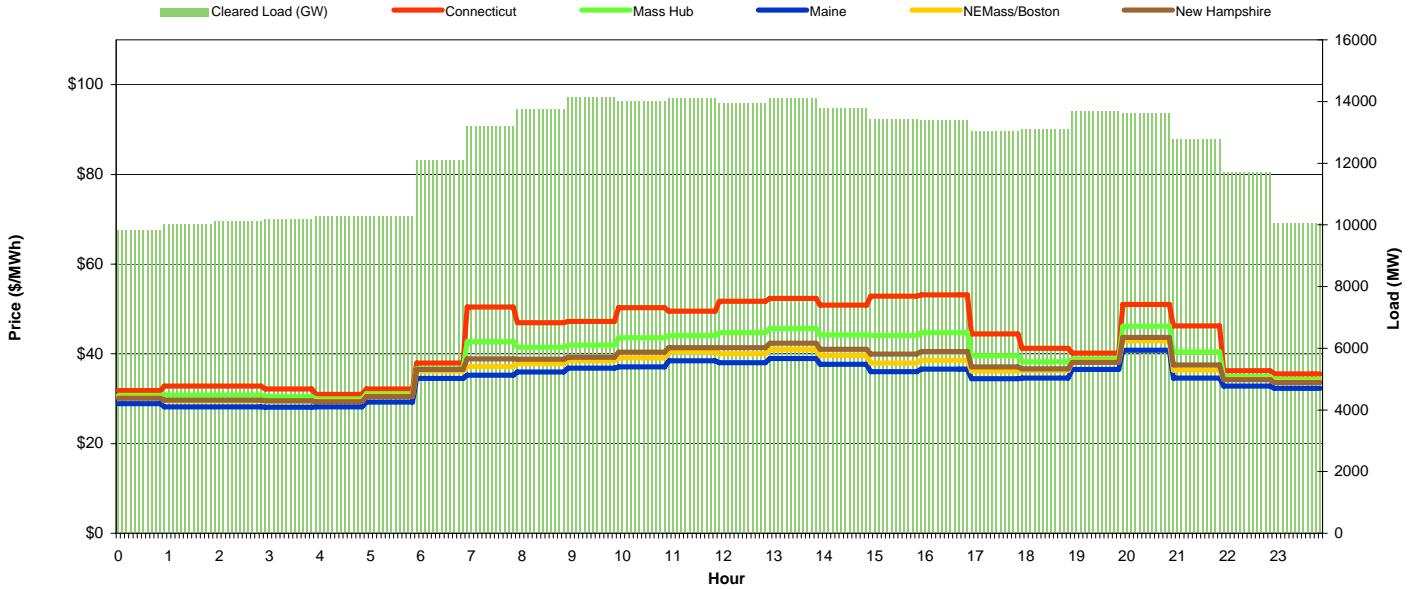

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	34.49	30.94	25.07	10.59	22.68	32.25	34.56	36.91	37.41	37.22	39.20	38.35	39.60	101.61	46.88	50.71	43.64	38.06	37.27	42.50	40.79	37.36	33.14	33.28	38.52	43.79	All	On Pk
NEMass/Boston	33.03	29.72	24.20	10.25	22.03	31.29	33.45	35.57	36.01	35.93	37.74	36.98	37.97	49.69	41.34	48.57	41.09	35.68	35.84	41.17	39.29	35.64	31.86	32.09	34.85	38.77		
New Hampshire	32.91	29.59	24.10	10.20	21.95	31.26	33.37	35.53	36.01	35.89	37.69	36.91	37.86	49.56	41.88	48.45	41.08	35.67	35.63	40.91	39.00	35.16	31.36	31.66	34.73	38.66		
Maine	30.65	28.99	23.62	9.98	21.52	30.66	32.42	31.42	30.35	30.71	31.05	28.30	30.37	30.43	30.55	30.87	30.70	30.45	30.48	30.78	36.92	33.51	29.94	30.84	29.40	31.05		
Mass Hub	33.56	30.19	24.57	10.40	22.30	31.60	33.72	35.83	36.26	36.12	37.96	37.17	38.13	44.71	43.10	48.96	41.75	36.31	36.06	41.30	39.45	35.96	32.11	32.33	34.99	38.82		
DA Forecast Load (GW)	10.38	9.94	9.77	9.75	10.14	10.85	12.43	13.71	14.25	14.47	14.62	14.66	14.63	14.62	14.46	14.36	14.11	13.80	13.67	13.82	14.22	13.67	12.54	11.17				
Forecast Error %	4.8%	7.4%	11.6%	13.2%	9.1%	3.4%	1.9%	0.8%	0.1%	0.1%	0.3%	0.4%	0.0%	0.2%	0.3%	0.0%	1.2%	2.2%	1.3%	0.5%	1.0%	0.6%	0.7%	1.7%				

