




ISO-NE Daily Report

Wednesday December 01, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	36.93	36.45	34.65	34.35	35.65	36.98	41.72	51.26	50.00	50.27	50.02	50.99	50.00	50.00	46.37	46.51	55.95	62.43	57.44	51.68	51.24	42.66	42.65	36.64	45.95	50.59	All	On Pk
NEMass/Boston	36.63	36.35	34.71	34.56	35.67	36.97	41.11	49.08	48.23	48.38	48.00	48.78	47.92	47.94	44.59	44.66	53.38	59.56	54.74	49.23	49.13	41.26	41.47	36.72	44.54	48.52		
New Hampshire	36.30	36.12	34.65	34.52	35.57	36.78	40.98	48.96	47.72	47.86	47.52	48.52	47.62	47.59	44.32	44.37	53.03	59.07	54.29	48.84	48.71	41.06	41.15	36.27	44.24	48.16		
Maine	35.90	35.62	34.69	34.67	35.26	36.66	55.06	48.66	47.00	46.96	46.41	47.56	46.64	46.46	43.41	43.15	52.26	57.90	53.28	47.74	47.53	40.28	40.30	35.67	44.13	47.22		
Mass Hub	36.88	36.48	34.80	34.60	35.78	37.11	41.36	49.55	48.59	48.70	48.29	49.07	48.27	48.30	44.92	45.00	53.84	60.09	55.09	49.64	49.41	41.46	41.57	36.66	44.81	48.86		
Cleared Load (GW)	10.9	10.9	10.6	10.5	10.7	11.3	13.2	14.0	14.1	14.1	14.1	13.9	13.9	13.9	13.9	13.9	15.1	15.7	15.3	15.1	14.4	13.5	11.9	11.3				

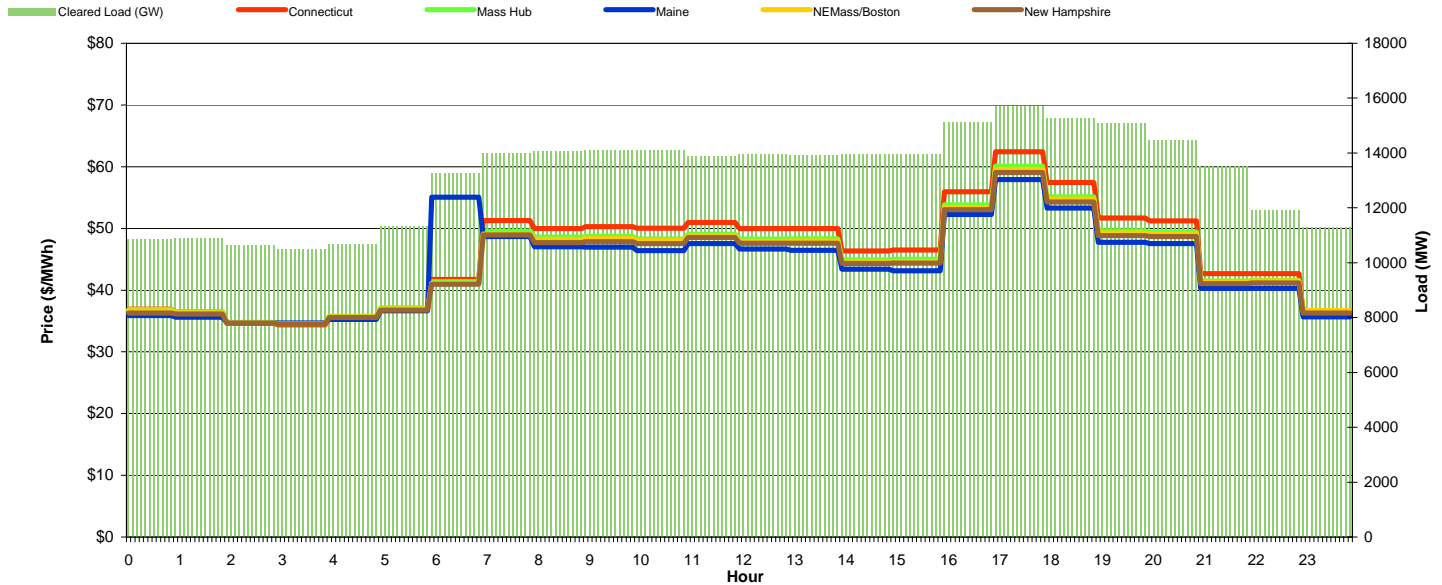

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	37.19	31.57	14.45	32.69	33.02	34.62	34.95	38.32	41.66	53.59	40.58	46.58	54.83	63.31	55.38	62.55	67.15	48.43	45.01	50.65	48.80	39.26	35.58	33.21	43.47	49.48	All	On Pk
NEMass/Boston	37.32	31.73	14.52	33.12	33.36	34.91	35.11	37.84	40.79	51.97	39.14	44.89	52.68	60.93	53.29	60.22	64.56	46.57	43.10	48.67	47.09	38.16	34.91	33.11	42.42	47.80		
New Hampshire	36.87	31.29	14.31	32.76	32.96	34.53	34.83	37.48	40.12	51.11	38.58	44.30	51.92	59.81	52.49	59.17	63.57	46.03	42.69	48.07	46.49	37.60	34.25	32.41	41.82	47.11		
Maine	36.13	30.54	13.97	32.49	32.35	33.83	34.52	36.86	39.08	49.40	37.24	42.87	49.89	57.12	50.59	56.66	61.15	44.50	41.31	46.21	44.55	36.06	32.84	31.05	40.47	45.40		
Mass Hub	37.50	31.93	14.62	33.26	33.53	35.10	35.14	37.99	41.10	52.41	39.46	45.33	53.37	61.70	53.93	60.91	65.11	46.96	43.51	49.15	47.63	38.54	35.17	33.36	42.78	48.27		
DA Forecast Load (GW)	11.45	11.01	10.81	10.74	11.04	12.13	14.16	15.47	15.73	15.92	16.00	15.99	15.86	15.76	15.72	15.87	16.98	17.78	17.58	17.09	16.42	15.24	13.75	12.38				
Forecast Error %	5.9%	7.9%	7.2%	7.1%	6.6%	5.6%	0.6%	-1.9%	-1.5%	-1.4%	-1.1%	-0.7%	-0.4%	0.6%	0.5%	1.1%	0.6%	-0.6%	-1.0%	-1.0%	-1.3%	-1.1%	-1.2%	2.6%				

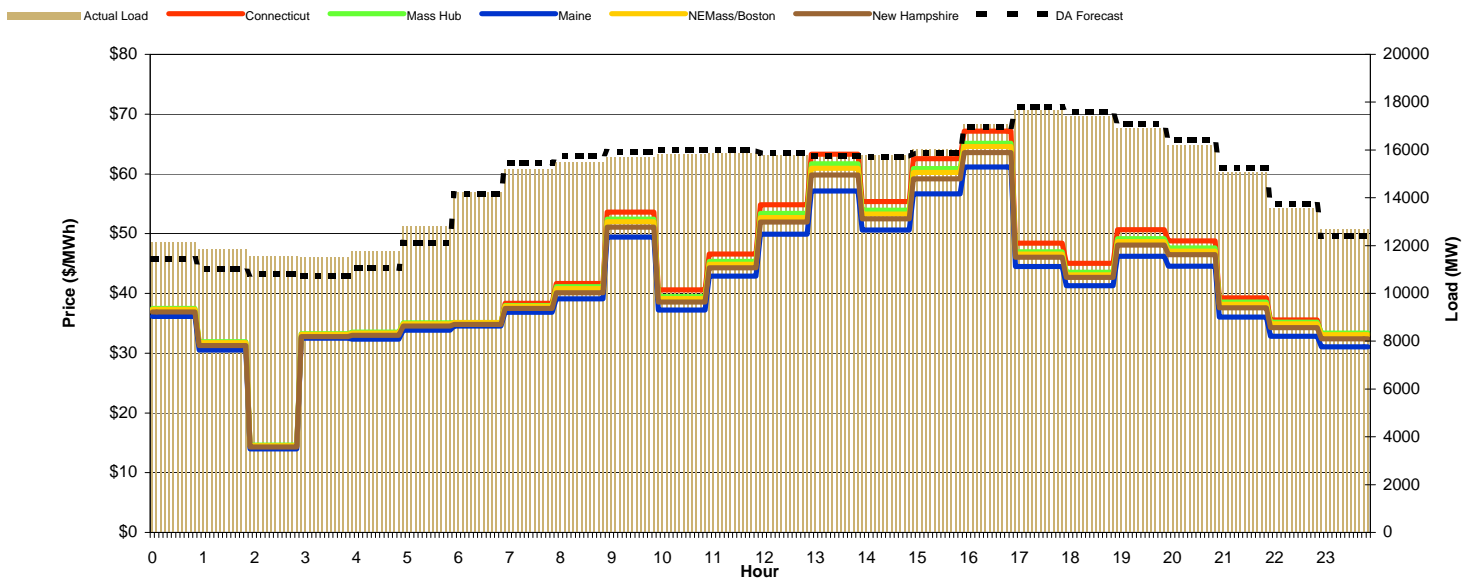




ISO-NE Daily Report

Thursday December 02, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	35.82	34.91	34.92	34.94	35.42	38.27	41.83	47.74	46.36	45.97	43.87	43.94	43.11	43.21	43.04	43.13	51.37	68.00	69.63	63.71	55.00	49.49	43.52	39.03	45.68	50.07	All	On Pk
NEMass/Boston	35.89	35.06	34.93	34.95	35.37	38.04	41.68	46.36	45.04	44.62	42.35	42.32	41.73	41.74	41.64	41.73	49.14	54.08	49.32	49.20	46.95	47.25	42.00	38.55	42.50	45.34		
New Hampshire	35.68	34.86	34.72	34.74	35.10	37.95	41.59	46.26	44.83	44.43	42.14	42.13	41.74	41.77	41.64	41.70	48.93	53.95	49.16	48.97	46.80	46.98	41.79	38.27	42.34	45.20		
Maine	35.45	34.57	34.48	34.42	34.33	37.34	41.05	45.44	44.33	43.89	41.65	41.60	41.34	41.35	41.23	41.13	47.99	52.62	48.10	47.70	45.41	45.71	40.69	37.31	41.63	44.39		
Mass Hub	36.08	35.23	35.19	35.22	35.65	38.24	41.86	46.65	45.22	44.77	42.59	42.63	41.94	41.95	41.82	41.92	49.63	54.65	49.81	49.71	47.40	47.53	42.28	38.67	42.78	45.66		
Cleared Load (GW)	11.7	11.2	11.0	11.0	11.2	12.2	13.8	14.6	14.7	14.8	15.1	15.1	14.8	14.7	14.5	14.6	16.1	16.7	16.3	16.0	15.6	13.9	13.0	12.0				

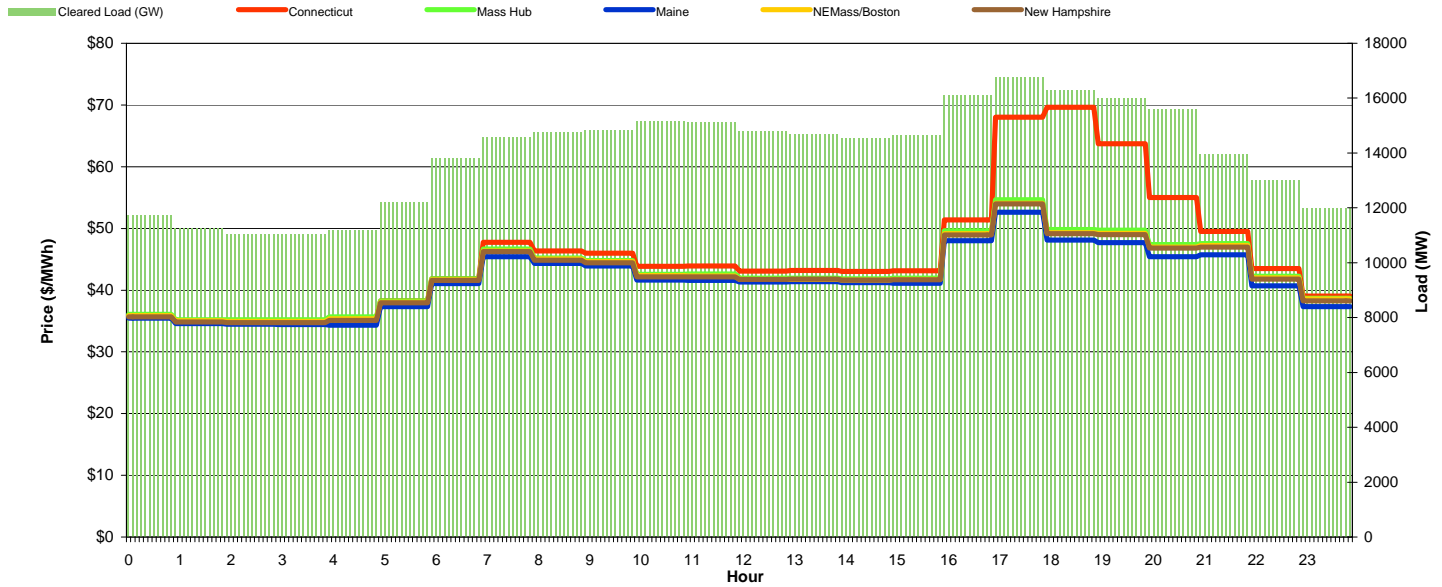

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	33.20	30.74	34.50	32.99	34.38	36.71	42.80	45.05	43.83	43.43	42.73	41.79	42.60	41.42	41.16	41.74	61.17	54.54	68.96	59.53	50.66	53.38	45.07	38.61	44.21	48.57	All	On Pk
NEMass/Boston	33.28	30.85	34.58	33.09	34.54	36.74	42.87	44.23	42.87	42.50	41.66	40.79	41.50	40.36	40.15	40.70	59.17	52.58	65.73	56.69	48.44	51.32	43.70	38.03	43.18	47.02		
New Hampshire	32.64	30.37	34.09	32.62	34.08	36.24	42.39	43.72	42.43	41.93	41.04	40.15	41.02	39.91	39.66	40.25	58.49	52.12	65.13	56.05	47.90	50.55	43.01	37.45	42.64	46.46		
Maine	31.37	29.65	33.47	32.09	33.52	35.27	41.04	41.96	41.54	40.92	39.80	38.79	39.79	38.78	38.51	39.18	56.97	50.75	62.94	53.65	45.46	48.10	41.09	35.95	41.27	44.89		
Mass Hub	33.54	31.06	34.83	33.32	34.76	36.96	42.88	44.51	43.29	42.98	42.16	41.23	41.95	40.72	40.47	41.01	59.68	52.99	66.41	57.46	49.14	52.01	44.21	38.27	43.58	47.51		
DA Forecast Load (GW)	11.50	11.05	10.85	10.85	11.24	12.42	14.54	15.77	15.97	16.03	16.04	15.98	15.83	15.77	15.66	15.84	17.14	18.24	18.00	17.71	17.08	15.97	14.41	12.97				
Forecast Error %	6.5%	6.9%	7.1%	7.2%	5.9%	3.5%	-1.4%	-1.9%	-2.0%	-1.9%	-1.6%	-1.7%	-1.9%	-1.8%	-1.7%	-1.7%	-1.5%	-0.6%	0.7%	0.3%	0.6%	0.8%	1.1%	0.8%				

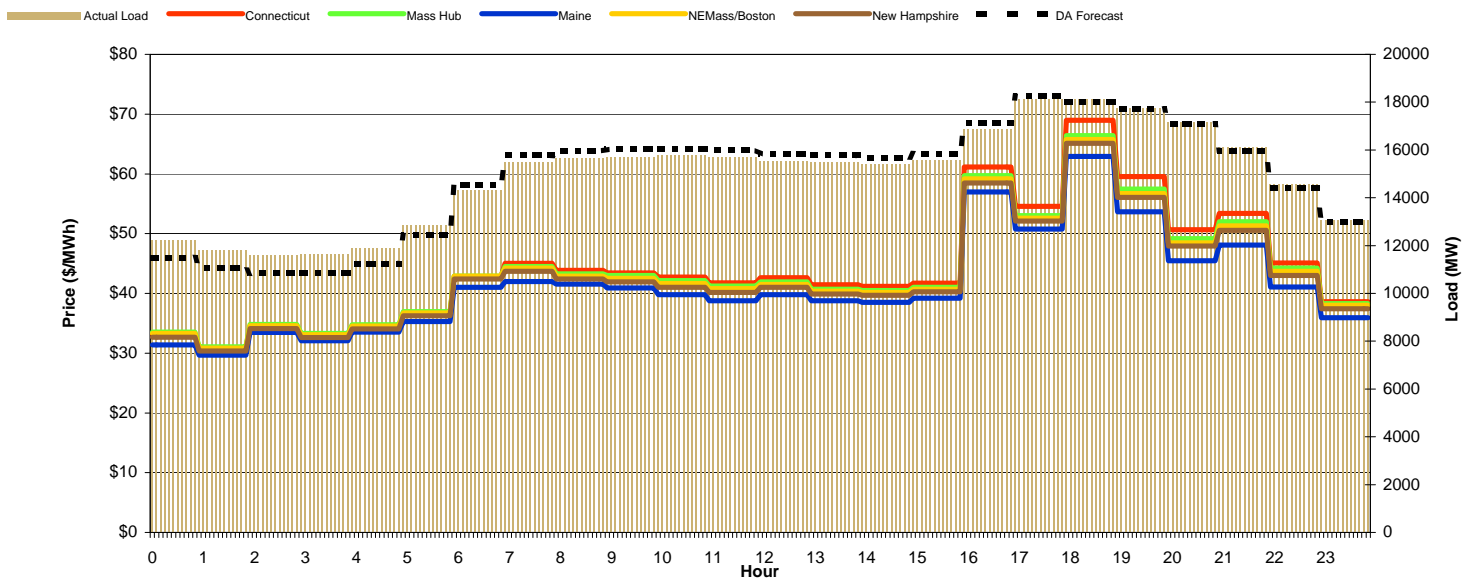




ISO-NE Daily Report

Friday December 03, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$		
																										All	On Pk
Connecticut	36.64	36.82	34.94	35.64	36.61	38.79	51.07	51.26	50.00	51.39	51.31	50.35	46.02	43.68	43.05	45.17	56.64	63.64	55.23	52.72	51.19	48.24	43.36	42.36	46.51	50.20	
NEMass/Boston	36.57	36.55	34.96	35.57	36.56	38.69	49.47	49.08	47.85	49.12	49.10	48.21	44.21	42.24	41.71	43.29	53.78	60.00	52.11	49.87	49.10	46.54	42.08	41.55	44.93	48.02	
New Hampshire	36.21	36.33	34.82	35.39	36.32	38.50	48.82	48.21	46.98	48.29	48.25	47.42	43.58	41.65	41.18	42.60	52.78	58.69	51.18	49.02	48.08	45.72	41.53	41.15	44.28	47.20	
Maine	35.49	35.52	34.46	34.82	35.44	37.91	47.47	46.34	45.54	46.87	46.76	46.08	42.37	40.48	40.04	41.16	50.40	55.48	49.32	47.28	46.36	44.13	41.24	45.00	43.17	45.62	
Mass Hub	36.79	36.87	35.21	35.85	36.84	38.94	50.34	49.76	48.38	49.67	49.64	48.68	44.60	42.56	42.00	43.69	54.50	60.56	52.69	50.44	49.55	46.91	42.32	41.87	45.36	48.50	
Cleared Load (GW)	11.3	11.0	10.9	10.8	11.3	12.2	14.0	15.0	15.0	15.0	15.0	14.8	14.7	14.7	14.5	14.5	15.8	16.2	15.7	15.5	14.9	14.1	13.0	11.7			

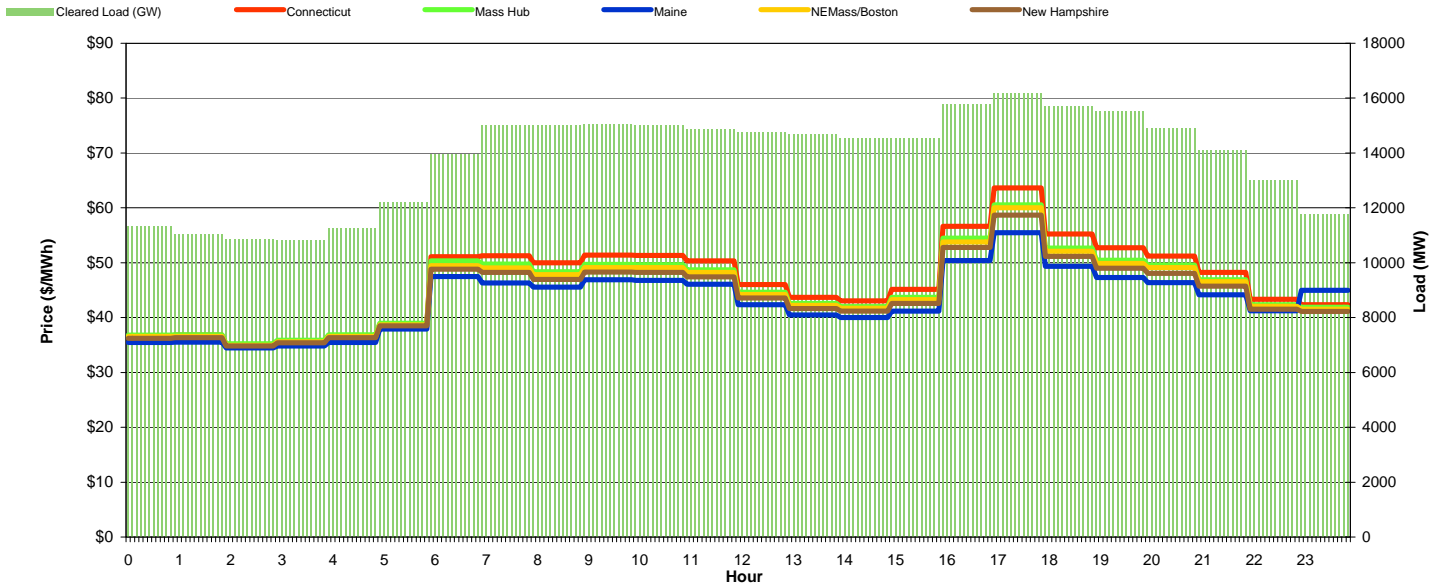

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$		
																										All	On Pk
Connecticut	37.91	36.75	36.89	35.72	35.44	38.37	48.38	48.56	50.18	57.94	57.16	50.63	50.24	53.37	43.86	43.49	59.78	79.25	46.52	43.82	48.89	53.46	51.03	41.78	47.89	52.39	
NEMass/Boston	37.69	36.60	37.03	35.86	35.39	37.96	46.90	46.35	47.95	55.33	54.59	48.44	48.18	51.20	42.34	41.96	56.95	75.55	44.34	41.91	46.67	51.15	49.20	40.75	46.26	50.13	
New Hampshire	37.11	36.09	36.58	35.44	34.94	37.39	46.22	45.60	47.04	54.18	53.44	47.42	47.15	50.03	41.50	41.21	55.87	74.07	43.58	41.09	45.77	50.08	48.24	40.07	45.42	49.14	
Maine	35.87	34.88	35.82	34.75	33.90	36.19	44.45	43.72	45.19	51.64	50.89	45.26	45.03	47.52	39.86	39.79	53.49	70.52	41.51	38.99	43.14	46.90	45.97	38.96	43.51	46.84	
Mass Hub	37.97	36.94	37.31	36.12	35.71	38.37	47.48	47.07	48.67	56.17	55.42	49.16	48.85	51.92	42.85	42.43	57.72	76.37	44.83	42.28	47.24	51.89	49.83	41.15	46.82	50.79	
DA Forecast Load (GW)	12.14	11.64	11.38	11.36	11.74	12.87	14.94	16.09	16.37	16.41	16.40	16.28	16.06	15.93	15.82	15.95	17.24	18.17	17.82	17.35	16.73	15.88	14.67	13.34			
Forecast Error %	1.4%	4.0%	4.5%	5.6%	6.0%	1.8%	-0.8%	-0.1%	0.0%	0.2%	0.1%	0.1%	0.5%	1.1%	1.3%	1.3%	0.4%	-0.3%	0.0%	-0.4%	-0.2%	-0.3%	-0.6%	-0.8%			

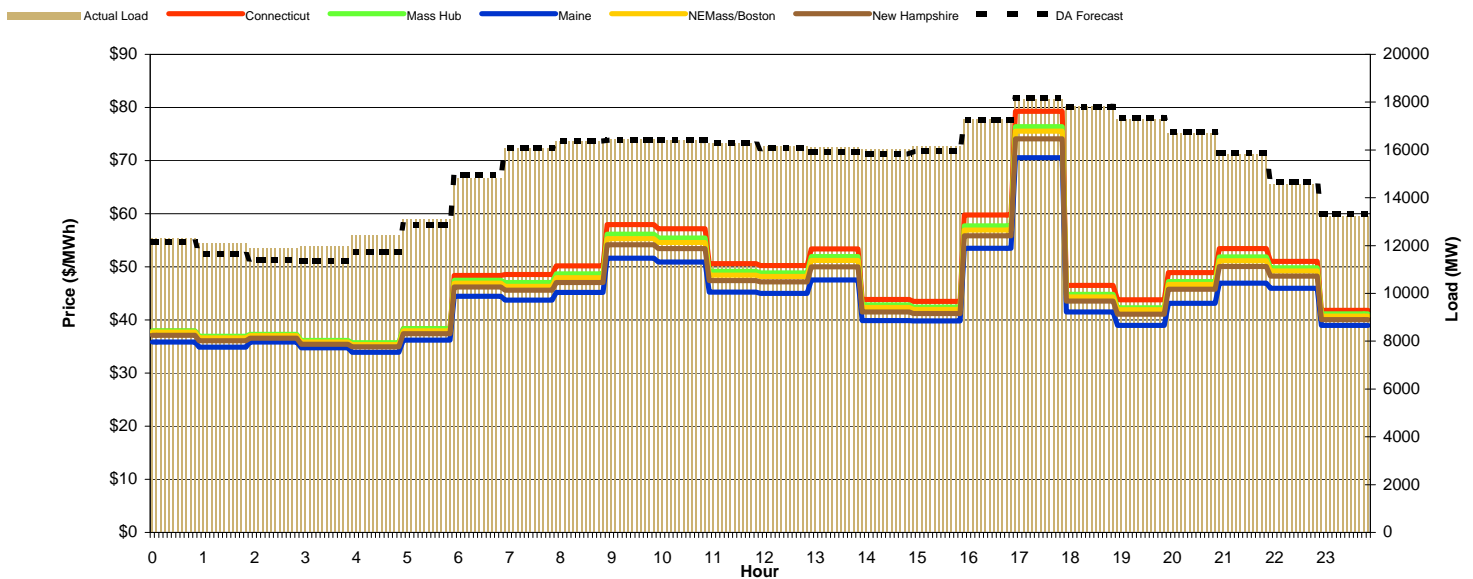




ISO-NE Daily Report

Saturday December 04, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	38.38	38.48	38.13	38.40	38.38	37.86	38.76	42.22	50.90	51.01	50.00	49.63	42.65	41.86	41.40	42.75	50.98	55.87	53.41	50.40	47.29	47.44	44.00	38.70	44.54	47.61	All	On Pk
NEMass/Boston	38.05	38.00	37.79	37.83	37.80	37.56	38.23	40.76	48.99	48.98	48.27	47.99	41.33	40.72	40.22	41.31	49.12	54.01	51.86	49.12	46.46	46.37	42.87	38.56	43.43	46.15		
New Hampshire	37.73	37.73	37.56	37.59	37.54	37.30	37.80	40.55	48.54	48.54	47.84	47.51	41.13	40.41	39.92	41.12	48.79	53.66	51.45	48.71	46.01	45.74	42.36	38.21	43.07	45.77		
Maine	37.64	37.52	37.30	37.23	37.23	37.21	37.52	40.03	47.80	47.36	46.80	46.51	40.36	39.69	39.15	40.30	47.90	52.41	50.29	47.72	45.39	44.94	41.33	38.34	42.42	44.87		
Mass Hub	38.34	38.38	38.17	38.24	38.22	37.83	38.59	41.17	49.43	49.38	48.64	48.30	41.60	40.87	40.41	41.61	49.54	54.35	52.07	49.26	46.51	46.45	43.09	38.67	43.71	46.42		
Cleared Load (GW)	11.8	11.6	11.5	11.3	11.2	11.4	12.0	12.4	13.3	13.8	14.1	14.1	13.8	13.5	13.4	13.6	15.0	15.6	15.5	15.1	14.7	13.8	13.0	12.1				

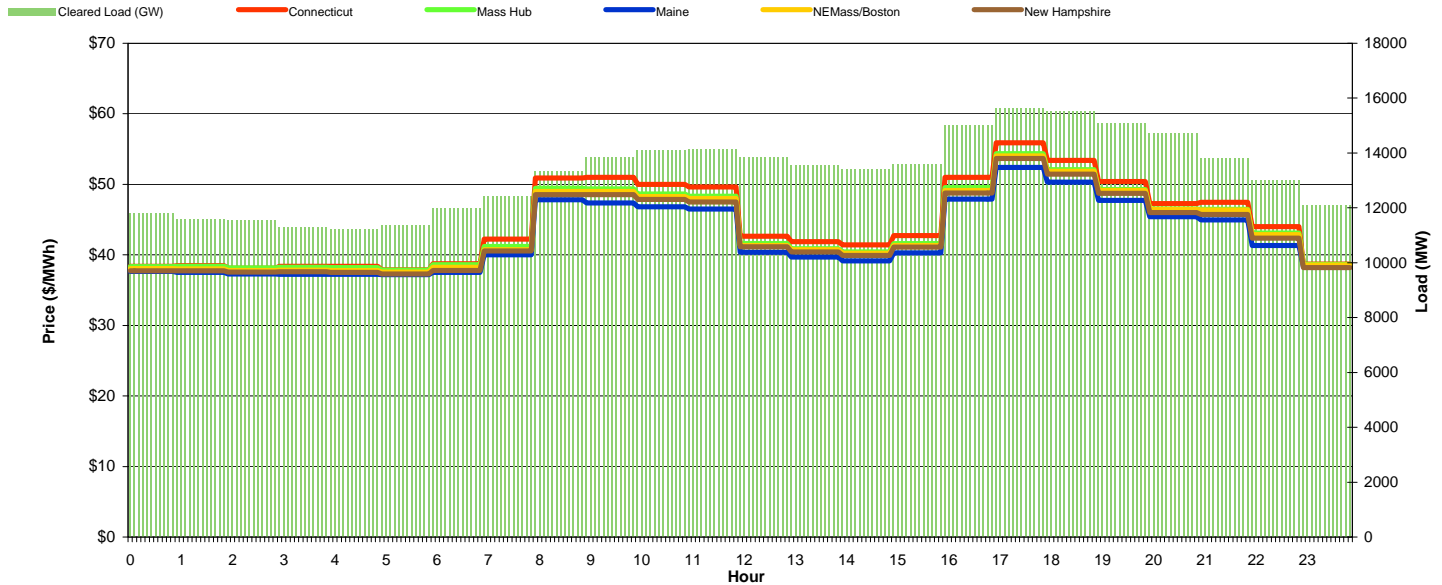

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	39.92	39.44	42.99	53.99	39.30	36.44	40.91	41.69	42.10	42.16	42.27	40.39	39.53	37.68	37.05	39.29	47.76	46.12	45.38	48.65	47.65	44.83	42.65	39.96	42.42	42.83	All	On Pk
NEMass/Boston	39.36	38.87	42.53	52.93	38.52	35.93	40.20	40.22	40.44	40.42	40.63	39.02	38.32	36.68	36.12	38.22	45.95	43.84	43.14	46.19	45.80	43.16	41.20	39.07	41.12	41.21		
New Hampshire	38.69	38.25	41.78	51.90	37.84	35.31	39.42	39.64	39.92	39.88	40.05	38.38	37.68	36.09	35.54	37.68	45.38	43.29	42.66	45.59	45.08	42.35	40.40	38.32	40.46	40.60		
Maine	37.70	37.20	40.50	50.16	36.70	34.21	37.94	37.99	37.99	37.99	38.24	36.67	36.06	34.58	34.12	36.31	43.89	41.68	41.11	43.75	43.38	40.78	38.85	37.06	38.95	38.96		
Mass Hub	39.70	39.33	43.01	53.68	39.05	36.35	40.66	40.70	40.94	40.93	41.12	39.42	38.66	36.95	36.37	38.51	46.43	44.32	43.59	46.82	46.14	43.50	41.51	39.35	41.54	41.62		
DA Forecast Load (GW)	12.28	11.74	11.45	11.36	11.44	11.94	12.69	13.55	14.53	15.13	15.30	15.19	15.02	14.76	14.68	14.91	16.22	17.26	17.07	16.62	16.05	15.36	14.32	13.16				
Forecast Error %	2.4%	5.6%	7.5%	8.1%	6.1%	3.8%	1.9%	-0.2%	-0.4%	-0.8%	-0.9%	-0.8%	-1.1%	-1.1%	-1.5%	-1.9%	-1.5%	-0.6%	-0.4%	-0.2%	0.3%	0.2%	0.4%	0.6%				

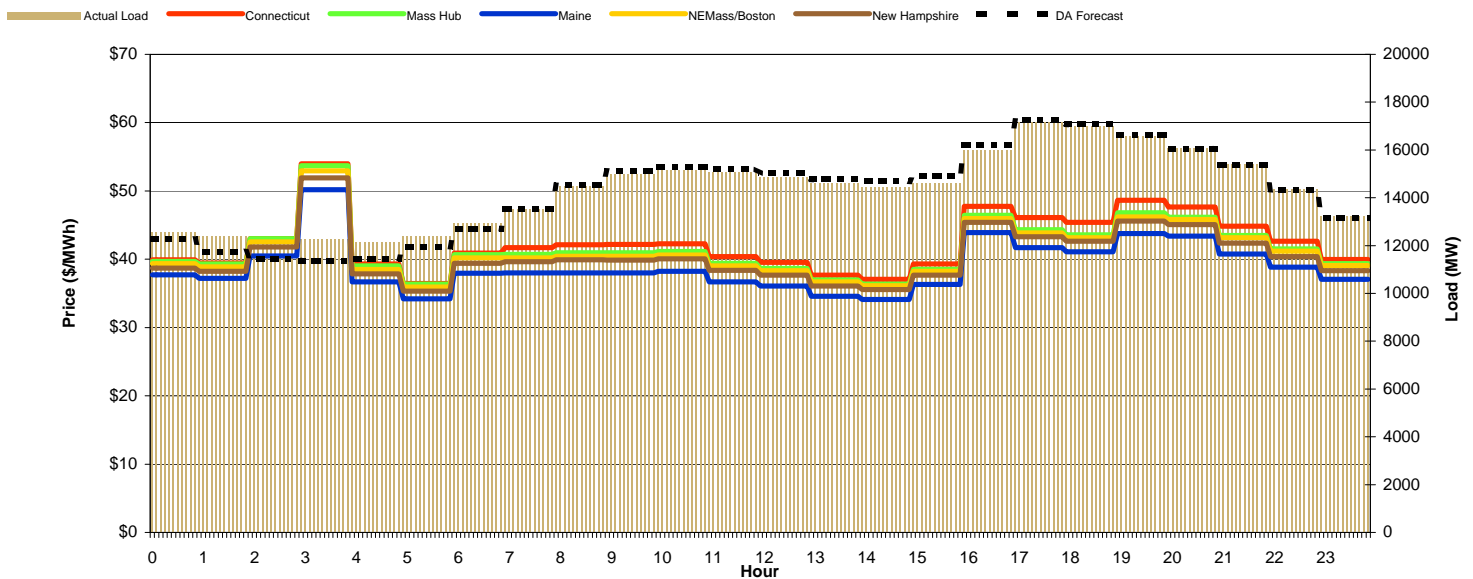




ISO-NE Daily Report

Sunday December 05, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	37.70	36.79	35.29	34.92	35.33	35.00	35.54	38.20	39.39	40.88	40.49	40.74	40.80	39.47	39.45	39.79	52.29	64.87	59.48	55.98	53.81	47.92	41.05	40.37	42.73	45.91	All	On Pk
NEMass/Boston	37.32	36.57	35.37	35.08	35.35	35.09	35.40	37.51	38.81	39.93	39.53	39.74	39.75	38.58	38.50	38.86	50.06	59.98	56.90	53.50	51.54	46.15	39.88	39.65	41.63	44.33		
New Hampshire	37.08	36.52	35.27	34.96	35.16	34.83	35.08	37.27	38.41	39.67	39.19	39.37	39.36	38.09	38.03	38.43	49.75	59.39	56.33	52.90	51.08	45.57	39.36	39.36	41.27	43.89		
Maine	36.78	36.02	35.18	34.87	34.78	34.70	34.89	36.55	37.85	39.04	38.61	38.81	38.77	37.38	37.18	37.68	48.84	57.80	54.81	51.31	49.95	44.52	38.67	39.22	40.59	42.99		
Mass Hub	37.46	36.76	35.50	35.20	35.53	35.16	35.57	37.58	38.82	40.08	39.71	39.92	39.95	38.70	38.67	39.00	50.73	60.25	57.24	54.04	52.14	46.61	40.08	39.99	41.86	44.60		
Cleared Load (GW)	11.2	11.4	10.9	10.8	11.0	10.8	11.1	11.7	12.6	13.1	13.6	13.7	13.7	13.5	13.4	13.6	15.3	15.8	15.8	15.5	15.2	14.2	12.8	12.0				

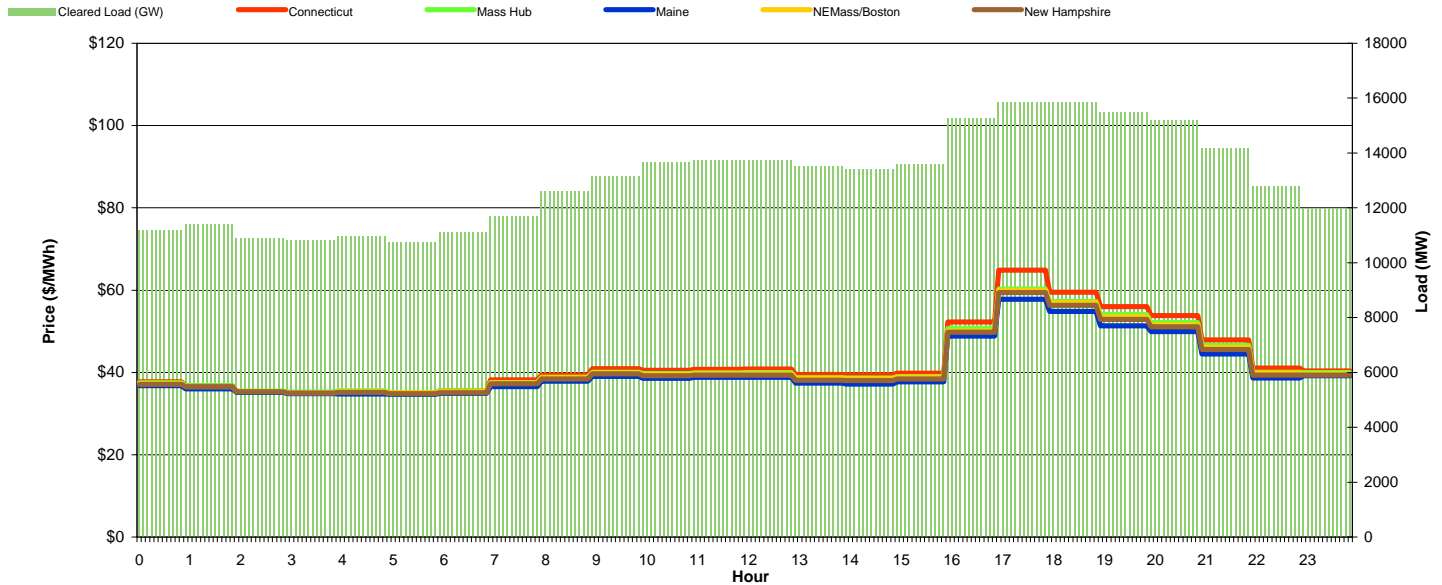

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$				
Connecticut	38.16	37.43	36.92	35.82	35.31	34.93	39.34	38.19	38.24	39.38	39.93	39.61	40.16	39.88	39.08	38.99	79.45	108.28	41.39	40.70	41.84	40.30	39.41	40.80	43.48	46.55	All	On Pk	
NEMass/Boston	37.39	36.74	36.45	35.49	35.09	34.76	38.83	37.31	37.57	38.58	39.12	38.82	39.28	38.99	38.32	38.30	76.97	105.56	40.56	39.32	40.87	39.63	38.77	40.27	42.62	45.50			
New Hampshire	36.73	36.18	35.90	34.94	34.54	34.13	38.09	36.69	36.98	38.02	38.61	38.22	38.73	38.45	37.83	37.92	76.13	104.34	40.07	38.74	40.34	38.97	37.99	39.68	42.01	44.88			
Maine	35.46	34.95	34.66	33.76	33.46	33.19	37.25	35.90	36.27	36.88	37.63	37.27	37.66	37.35	36.80	37.08	74.26	101.58	39.08	37.47	39.59	38.13	37.06	38.95	40.90	43.75			
Mass Hub	37.66	37.05	36.89	35.88	35.44	35.05	39.26	37.65	37.85	38.89	39.43	39.11	39.62	39.31	38.57	38.50	77.45	105.83	40.59	39.50	41.06	39.81	38.96	40.66	42.92	45.76			
DA Forecast Load (GW)	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
Forecast Error %	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!		

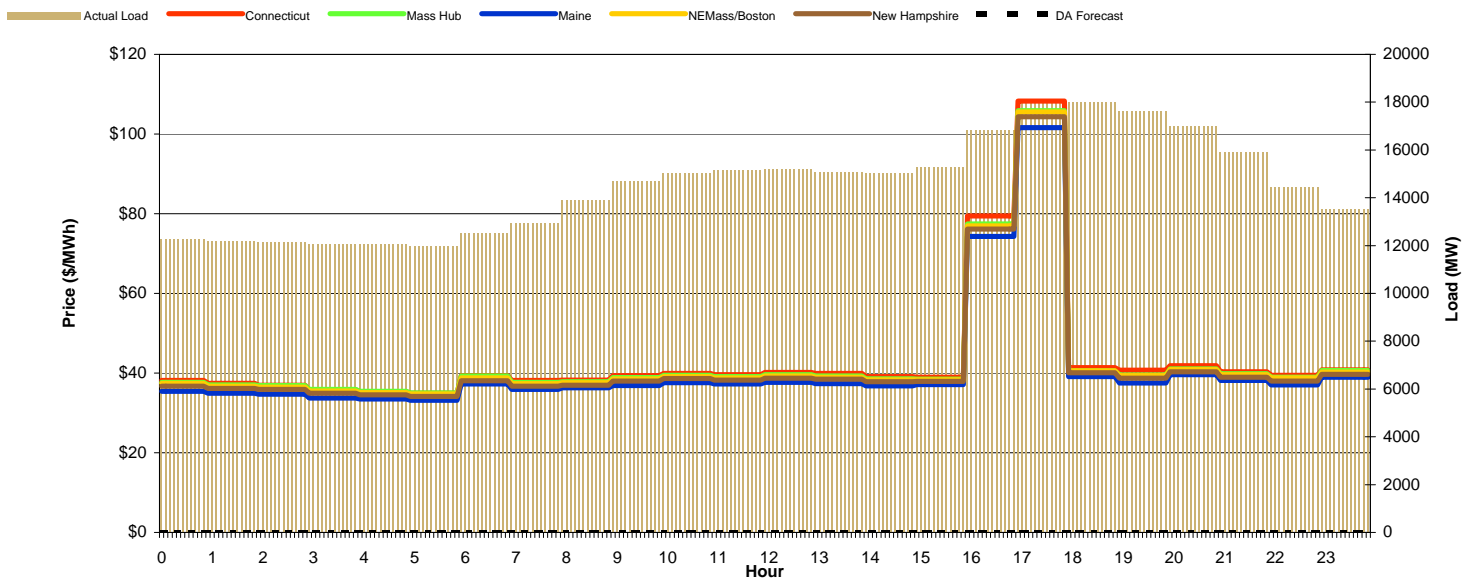




ISO-NE Daily Report

Monday December 06, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
																									All	On Pk		
Connecticut	37.70	36.20	34.82	34.79	35.78	37.68	47.53	49.62	50.90	50.47	50.75	49.14	48.01	45.21	43.57	44.21	53.16	72.00	71.46	59.68	51.22	50.64	45.35	38.60	47.44	52.21	48.57	54.00
NEMass/Boston	37.39	36.15	34.86	34.86	35.81	37.52	47.01	48.09	49.09	48.88	49.10	47.58	46.48	43.94	42.45	43.02	51.09	66.15	65.01	56.82	49.30	49.09	44.25	38.14	45.92	50.02	47.71	52.71
New Hampshire	36.98	35.95	34.61	34.62	35.61	37.17	46.56	47.57	48.53	48.28	48.50	47.04	45.99	43.56	42.18	42.73	50.49	65.05	63.85	55.93	48.69	48.37	43.73	37.76	45.41	49.41	47.18	52.14
Maine	36.53	35.66	34.61	34.61	35.59	36.38	45.90	46.48	47.17	46.86	47.02	45.53	44.69	42.39	40.84	41.43	48.57	61.79	60.23	52.68	46.57	46.80	42.20	37.33	44.08	47.58	45.77	50.44
Mass Hub	37.82	36.52	35.21	35.17	36.23	38.03	47.64	48.67	49.72	49.47	49.69	48.13	47.01	44.46	42.89	43.48	51.94	69.32	68.50	57.59	49.84	49.56	44.49	38.36	46.66	50.92	48.21	53.30
Cleared Load (GW)	11.9	11.3	11.0	11.0	11.4	12.2	14.2	15.5	15.8	15.8	15.9	15.7	15.5	15.5	15.4	15.5	16.8	17.3	17.1	16.9	16.4	15.1	13.6	12.2				

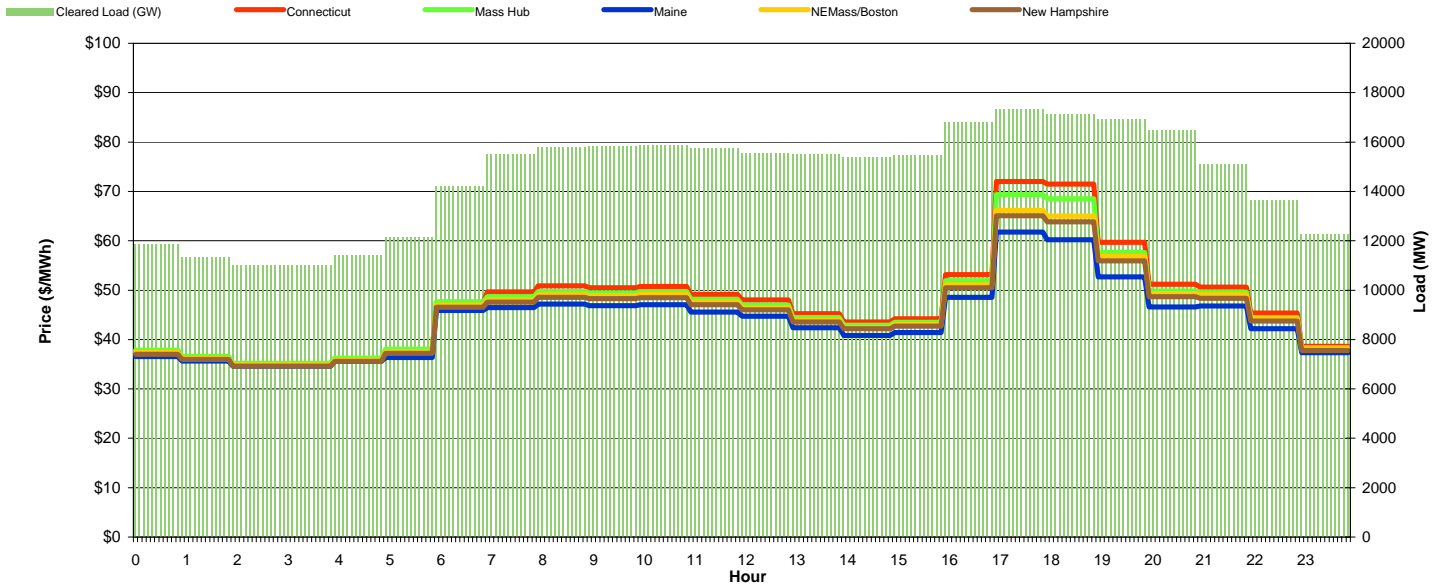

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
																									All	On Pk		
Connecticut	38.33	37.46	36.91	35.64	34.99	36.80	41.45	41.71	42.25	44.47	42.29	52.50	54.03	44.94	42.33	44.69	70.10	90.86	92.39	54.93	51.30	51.95	43.31	40.15	48.57	54.00	48.57	54.00
NEMass/Boston	38.17	37.52	37.09	35.93	35.24	36.83	41.06	40.96	41.31	43.71	41.54	51.35	52.52	43.69	41.46	43.75	68.36	88.39	89.48	53.45	49.85	50.86	42.69	39.83	47.71	52.71	47.71	52.71
New Hampshire	37.81	37.10	36.67	35.52	34.73	36.40	40.53	40.42	40.73	43.11	41.01	50.79	52.07	43.39	41.23	43.54	68.03	87.60	88.44	52.71	49.19	50.06	41.99	39.26	47.18	52.14	47.18	52.14
Maine	37.21	36.44	36.03	34.80	33.66	35.33	39.47	39.22	39.29	41.46	39.70	48.94	50.46	42.22	40.48	42.72	67.02	84.94	84.90	50.36	47.00	47.86	40.44	38.58	45.77	50.44	45.77	50.44
Mass Hub	38.54	37.86	37.40	36.19	35.56	37.13	41.40	41.41	41.80	44.20	41.98	52.02	53.13	44.27	41.95	44.28	69.10	89.26	90.45	53.99	50.49	51.33	43.08	40.10	48.21	53.30	48.21	53.30
DA Forecast Load (GW)	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00				
Forecast Error %	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!				

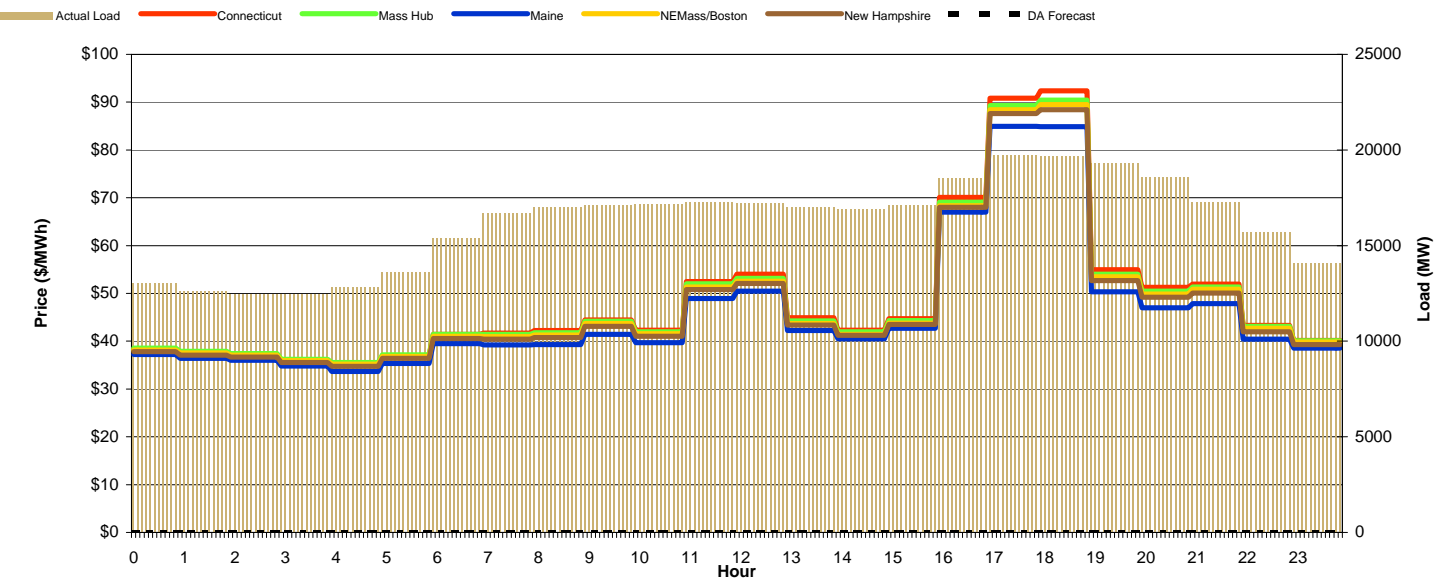




ISO-NE Daily Report

Tuesday December 07, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	39.69	39.70	39.54	39.73	39.74	44.14	51.60	60.09	54.88	55.03	55.12	54.01	52.08	50.80	50.26	50.62	55.96	73.65	62.42	60.72	55.22	52.21	51.01	46.32	51.44	55.88	All	On Pk
NEMass/Boston	39.75	39.76	39.55	39.75	39.76	44.12	51.32	58.71	53.54	53.45	53.54	52.43	50.76	49.53	49.28	49.49	54.36	70.92	60.34	58.65	53.51	50.91	49.83	46.23	50.40	54.33		
New Hampshire	39.24	39.32	39.12	39.37	39.41	43.75	50.74	58.10	52.89	52.82	52.85	51.75	50.23	48.96	48.62	48.90	53.63	69.74	59.37	57.73	52.78	50.30	49.30	45.48	49.77	53.62		
Maine	38.48	38.41	38.18	38.59	38.56	43.51	50.00	57.06	52.05	52.05	51.78	50.71	49.70	48.36	47.87	48.18	52.33	67.12	57.37	55.60	51.25	48.97	48.30	44.53	48.71	52.42		
Mass Hub	39.98	40.27	40.05	40.24	40.29	44.52	52.15	59.14	53.80	53.69	53.85	52.77	51.00	49.74	49.43	49.68	54.77	71.09	60.51	58.87	53.77	51.09	50.11	46.70	50.73	54.58		
Cleared Load (GW)	11.6	11.5	11.3	11.4	11.4	12.3	14.6	15.4	16.0	16.1	16.1	15.9	15.6	15.4	15.2	15.4	17.0	17.7	17.5	17.0	16.7	15.4	13.7	12.5				

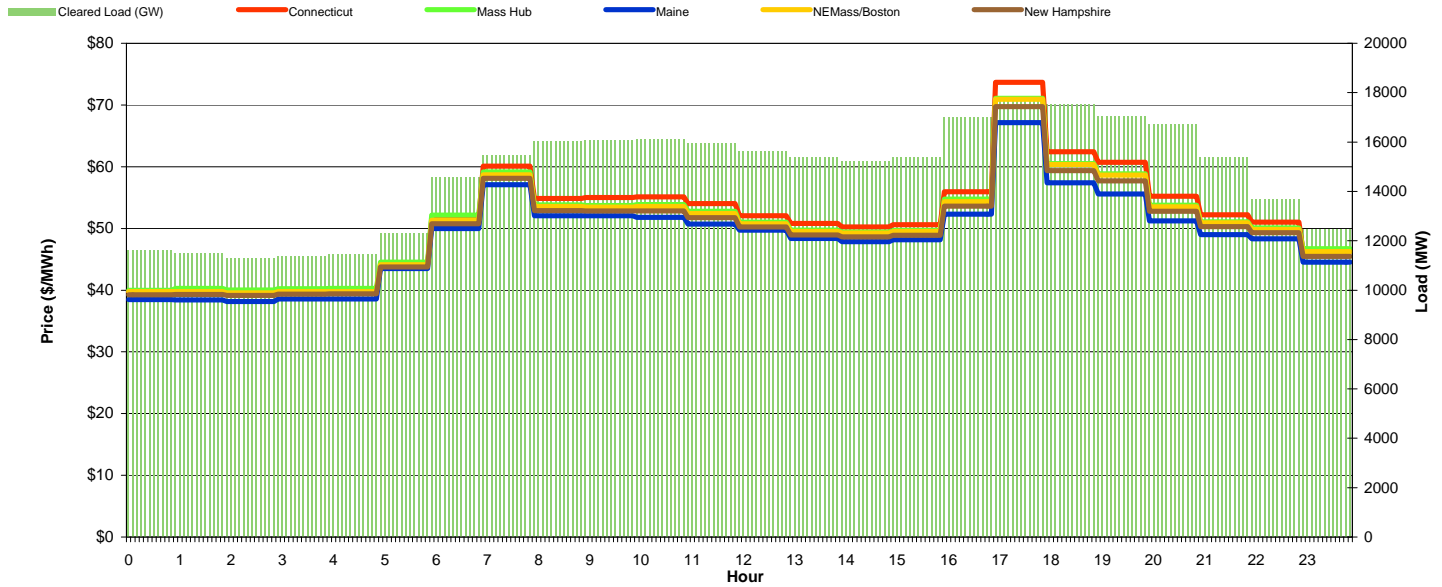

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	41.64	41.14	40.80	42.34	41.33	42.82	58.62	49.06	45.86	47.13	47.55	47.27	46.65	46.94	48.48	51.25	62.21	61.08	54.48	57.54	51.28	47.29	47.27	45.01	48.54	50.71	All	On Pk
NEMass/Boston	41.58	41.07	40.72	42.23	41.24	42.66	57.95	48.31	44.92	45.92	46.20	46.02	45.60	45.88	47.36	49.70	60.55	59.11	52.80	55.15	49.34	46.06	46.24	44.47	47.55	49.32		
New Hampshire	41.01	40.57	40.30	41.85	40.78	42.24	57.37	47.69	44.39	45.41	45.67	45.50	45.18	45.45	46.92	49.35	60.10	58.64	52.32	54.53	48.81	45.63	45.76	43.94	47.06	48.83		
Maine	40.23	39.72	39.42	40.85	39.88	41.24	55.83	46.52	43.11	44.05	44.25	44.09	43.96	44.31	45.75	48.04	58.52	56.65	50.38	51.70	46.56	43.88	44.26	42.69	45.66	47.25		
Mass Hub	41.99	41.64	41.27	42.87	41.85	43.11	58.75	49.00	45.55	46.63	46.95	46.74	46.25	46.53	48.06	50.48	61.32	59.76	53.42	56.11	50.18	46.70	46.92	45.10	48.22	50.04		
DA Forecast Load (GW)	12.80	12.30	12.11	12.07	12.52	13.67	15.87	17.14	17.28	17.35	17.35	17.19	17.02	16.92	16.86	17.05	18.52	19.71	19.42	19.03	18.34	17.18	15.47	13.90				
Forecast Error %	2.9%	4.8%	4.4%	6.2%	3.0%	-1.1%	-1.6%	-2.2%	-2.1%	-2.3%	-2.3%	-1.8%	-1.7%	-1.6%	-1.9%	-1.7%	-1.7%	-1.1%	0.2%	0.1%	0.1%	-0.4%	-0.1%	0.1%				

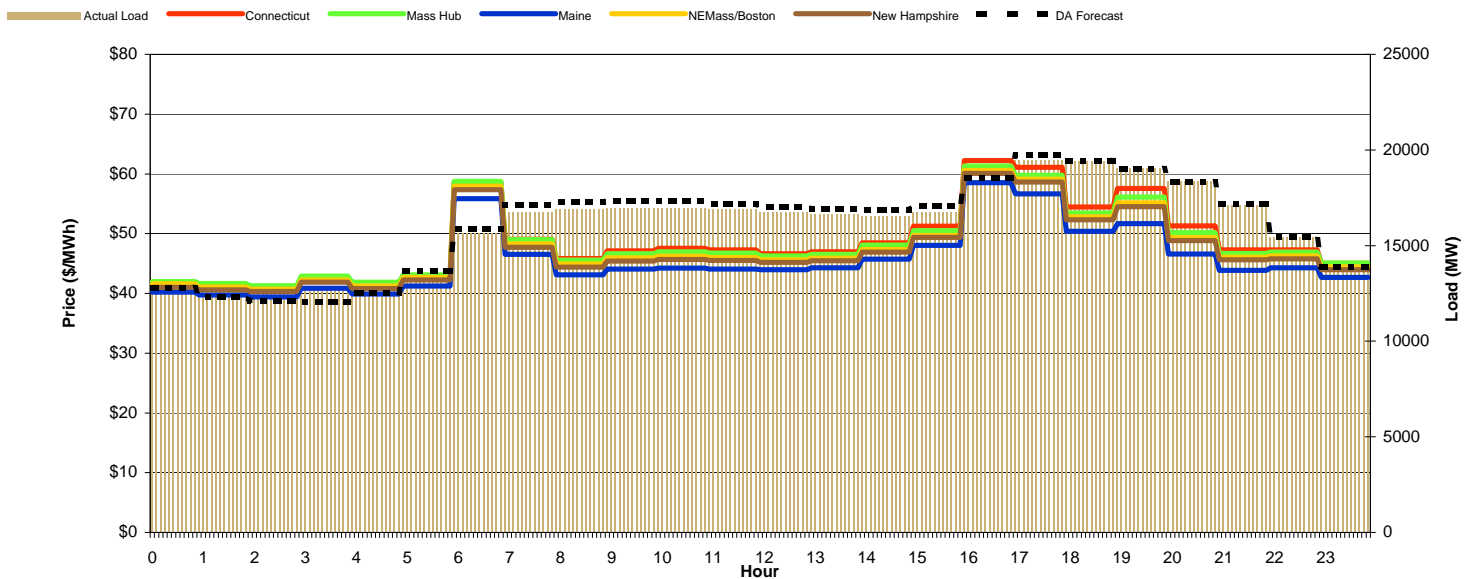




ISO-NE Daily Report

Wednesday December 08, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	45.01	44.40	41.77	41.67	42.92	46.01	56.84	60.35	58.54	58.50	60.00	55.21	52.29	51.21	51.51	52.99	69.85	90.13	84.27	76.03	70.93	55.99	52.20	46.83	56.89	62.50	All	On Pk
NEMass/Boston	44.18	43.48	41.39	41.29	42.50	45.66	56.46	58.98	57.02	56.93	58.26	53.65	50.83	49.78	50.25	51.90	67.45	87.29	81.46	73.07	67.92	54.05	50.82	46.30	55.46	60.60		
New Hampshire	43.47	42.94	41.01	40.95	42.14	45.09	56.23	58.50	56.48	56.42	57.76	53.21	50.60	49.64	50.04	51.66	66.94	86.78	80.95	72.50	67.36	53.70	50.67	45.73	55.03	60.20		
Maine	42.36	41.73	39.88	39.68	41.10	44.36	56.00	57.62	55.48	55.24	56.48	52.32	50.13	49.28	49.68	51.33	65.74	85.00	79.38	70.30	65.00	53.04	50.15	44.84	54.01	59.14		
Mass Hub	44.80	44.18	41.90	41.78	43.06	46.22	57.43	59.43	57.44	57.28	58.66	54.02	51.15	50.10	50.54	52.15	68.00	87.82	81.83	73.51	68.66	54.69	51.29	46.97	55.95	61.04		
Cleared Load (GW)	11.6	11.4	11.5	11.5	11.8	12.5	14.5	15.7	15.8	15.8	15.7	16.0	15.8	15.8	15.5	15.6	16.8	17.3	17.1	16.8	16.3	15.5	14.1	12.7				

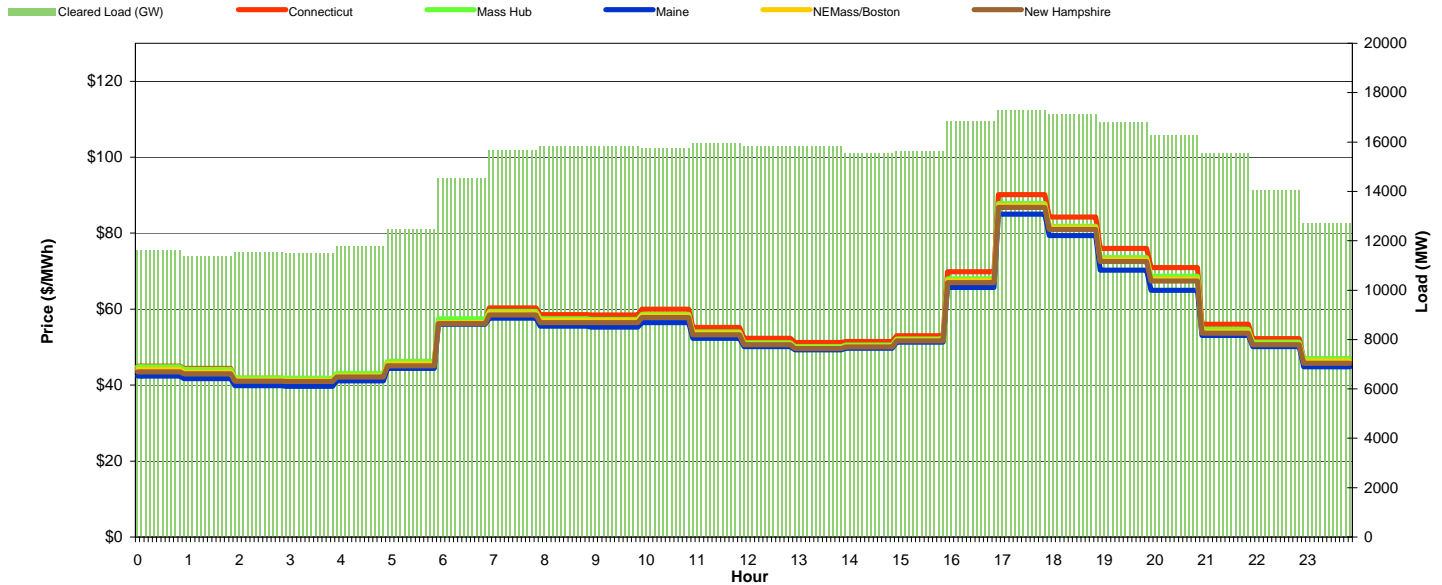

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	46.26	46.33	43.09	43.78	45.13	50.28	73.48	69.00	51.60	53.00	64.57	55.03	51.07	47.66	47.87	50.60	106.02	115.53	71.37	69.24	70.50	57.61	57.20	53.35	59.98	64.87	All	On Pk
NEMass/Boston	45.87	45.85	42.78	43.42	44.88	49.82	72.80	68.31	50.98	52.46	63.36	53.63	49.93	46.57	46.83	49.72	104.13	113.83	69.98	67.65	68.39	56.41	56.09	52.84	59.02	63.64		
New Hampshire	45.18	45.23	42.23	42.88	44.34	49.32	72.47	67.89	50.70	52.00	62.79	53.10	49.54	46.25	46.51	49.43	103.22	112.84	69.32	67.05	67.67	55.75	55.38	52.08	58.47	63.09		
Maine	43.88	43.78	40.77	41.49	42.87	48.16	71.77	66.76	49.57	50.75	60.61	51.18	48.09	45.15	45.66	48.46	100.78	109.45	66.93	64.84	64.96	54.05	53.67	50.36	56.83	61.31		
Mass Hub	46.47	46.50	43.34	44.00	45.46	50.56	73.72	69.06	51.70	53.12	64.33	54.50	50.63	47.16	47.34	50.24	104.79	114.35	70.44	68.16	69.00	56.92	56.80	53.42	59.67	64.28		
DA Forecast Load (GW)	12.90	12.41	12.25	12.23	12.68	13.78	15.89	17.14	17.34	17.36	17.39	17.29	17.11	17.02	16.95	17.11	18.44	19.85	19.49	19.12	18.44	17.29	15.71	14.23				
Forecast Error %	2.2%	4.1%	5.3%	5.2%	4.2%	0.9%	-0.5%	-0.7%	-1.2%	-1.5%	-1.5%	-1.4%	-1.1%	-1.4%	-1.5%	-1.1%	-0.1%	-0.5%	1.1%	1.1%	1.4%	1.4%	1.7%	1.2%				

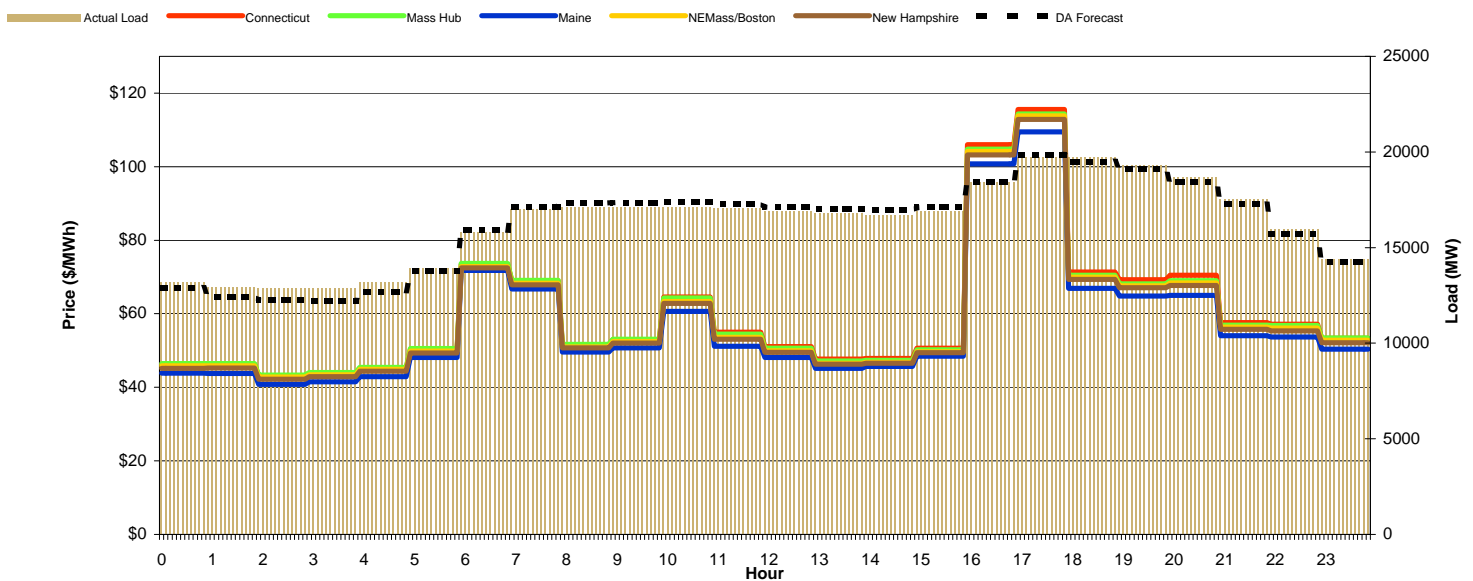




ISO-NE Daily Report

Thursday December 09, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
																									All	On Pk		
Connecticut	62.67	60.60	59.50	57.78	61.57	64.46	65.60	68.08	67.58	67.30	66.03	64.30	64.12	63.16	63.09	63.52	71.91	84.57	83.33	80.04	75.33	66.86	66.26	60.66	67.01	69.72		
NEMass/Boston	61.69	59.73	58.78	57.09	60.71	63.88	65.38	66.25	65.81	65.62	64.01	62.63	62.29	61.51	61.40	61.88	70.00	81.30	80.00	77.13	72.49	65.10	64.77	59.80	65.39	67.64		
New Hampshire	61.67	59.71	58.69	57.02	60.79	64.26	66.01	66.63	66.11	65.71	63.80	62.35	62.14	61.39	61.27	61.74	70.15	82.62	80.42	76.91	72.49	65.43	64.76	59.46	65.48	67.75		
Maine	59.83	57.81	56.80	55.21	58.96	62.88	64.93	64.85	64.83	64.05	62.32	61.02	60.63	60.00	60.01	60.44	68.44	81.18	78.82	74.87	70.10	63.78	62.19	57.59	63.81	66.10		
Mass Hub	62.80	60.89	59.86	58.14	61.83	64.82	66.26	66.80	66.31	66.08	64.60	63.07	62.82	61.99	61.83	62.32	70.58	82.09	80.70	77.81	73.20	65.71	65.34	60.61	66.10	68.20		
Cleared Load (GW)	12.1	11.9	11.8	11.8	12.0	12.7	14.5	16.1	16.4	16.5	16.5	16.3	16.0	15.9	15.7	15.8	17.2	18.5	18.5	17.9	17.3	15.6	14.1	12.6				

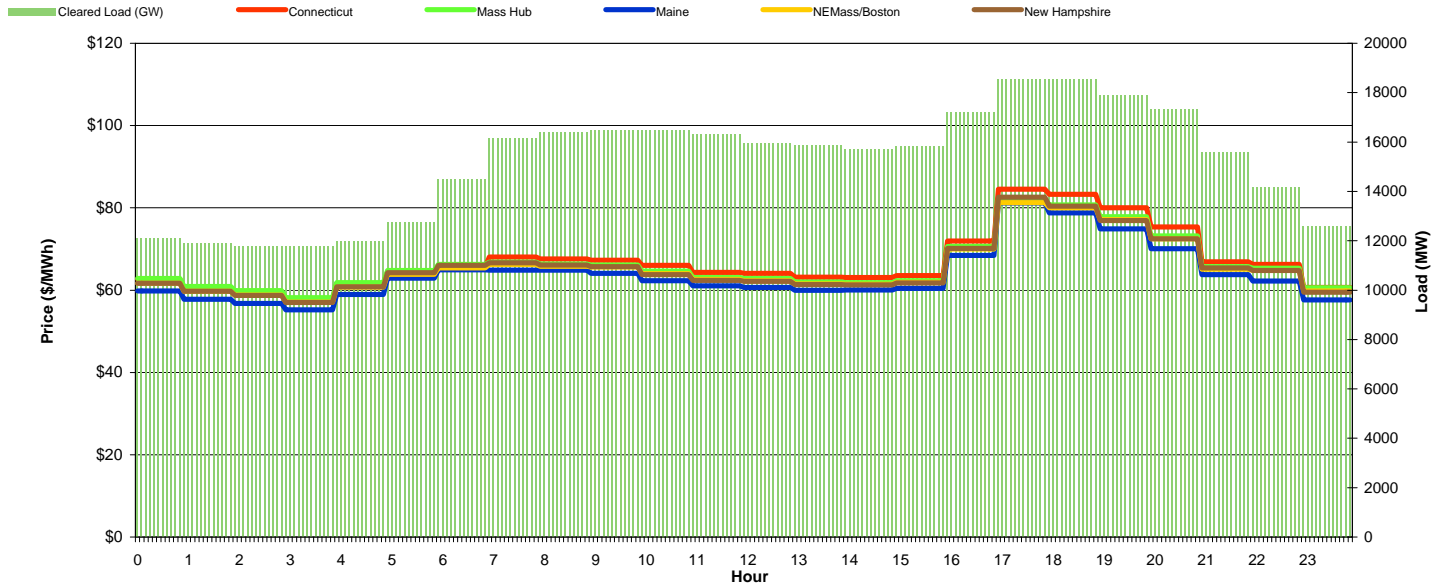

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
																									All	On Pk		
Connecticut	92.58	76.06	67.52	65.78	66.50	91.41	114.15	81.30	70.31	65.62	66.91	64.43	64.27	63.25	60.88	61.57	76.49	91.24	71.32	74.95	77.80	66.59	63.71	60.06	73.11	70.04		
NEMass/Boston	91.74	75.33	67.01	65.23	66.11	91.05	113.77	79.76	68.87	64.25	65.30	63.10	62.94	61.92	59.61	60.45	74.94	88.60	69.74	72.88	75.12	64.78	62.43	58.83	71.82	68.42		
New Hampshire	90.73	74.79	66.57	64.78	65.73	90.78	113.99	79.94	68.92	64.00	64.90	62.54	62.36	61.40	59.17	60.14	74.68	88.55	69.08	72.22	74.52	64.31	62.06	58.26	71.43	68.05		
Maine	86.84	71.02	63.71	61.81	63.12	87.83	111.94	78.09	67.25	62.66	63.43	61.00	60.63	59.79	58.11	59.50	73.22	86.44	67.33	69.54	71.07	61.59	59.99	56.29	69.26	66.23		
Mass Hub	93.01	76.24	67.76	65.96	66.77	91.69	113.92	80.16	69.39	64.79	65.91	63.60	63.49	62.47	60.07	60.87	75.54	89.35	70.26	73.61	76.08	65.49	62.99	59.35	72.45	69.00		
DA Forecast Load (GW)	13.19	12.73	12.53	12.52	12.86	14.02	16.19	17.28	17.38	17.44	17.40	17.27	17.07	16.95	16.84	17.12	18.60	19.94	19.88	19.46	18.72	17.49	15.80	14.26				
Forecast Error %	5.1%	5.2%	5.0%	6.8%	5.8%	3.3%	1.3%	1.9%	1.9%	1.3%	1.5%	1.7%	1.7%	1.8%	1.7%	1.2%	0.8%	0.7%	0.9%	1.3%	2.3%	3.3%	4.1%	4.5%				

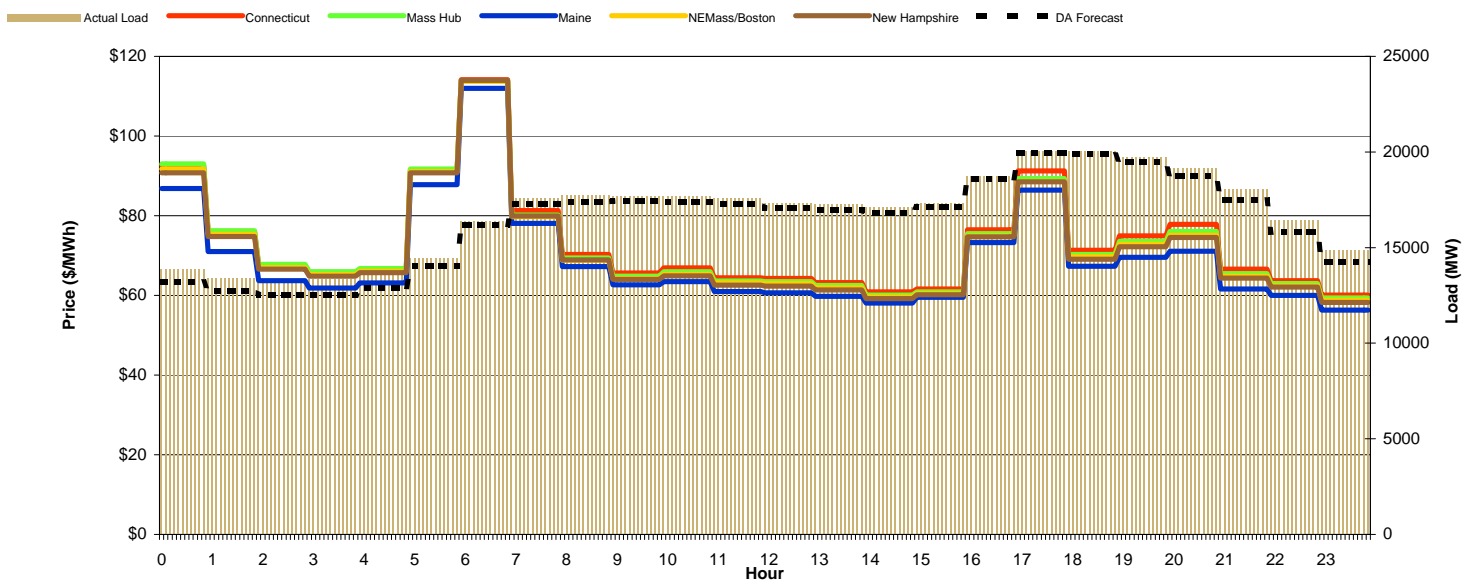




ISO-NE Daily Report

Friday December 10, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	49.98	48.93	48.21	48.09	48.11	49.99	61.19	86.79	82.65	78.06	67.25	60.53	58.20	57.24	56.36	57.37	83.63	91.80	85.97	62.24	65.50	60.95	60.33	55.09	63.52	69.68	All	On Pk
NEMass/Boston	49.91	48.94	48.51	48.34	48.83	50.10	60.58	83.21	79.58	74.98	64.70	58.01	56.27	55.57	54.89	56.07	81.01	88.61	82.22	59.53	62.74	58.19	58.20	54.08	61.79	67.11	63.52	69.68
New Hampshire	49.84	48.94	48.49	48.34	48.86	50.00	60.50	84.76	80.92	75.92	65.15	58.04	56.61	55.90	55.26	56.32	80.86	87.74	81.54	59.42	62.54	57.88	57.82	53.63	61.89	67.29	61.89	67.29
Maine	49.63	48.54	48.11	47.99	48.82	58.78	60.83	83.41	80.04	74.33	64.69	57.81	56.33	55.80	55.45	56.27	80.00	86.47	80.13	58.95	62.13	57.69	57.72	53.54	61.81	66.70	61.81	66.70
Mass Hub	50.60	49.70	49.10	48.93	49.30	50.87	61.44	84.29	80.51	75.86	65.34	58.55	56.64	55.84	55.10	56.27	81.21	88.70	82.53	60.03	63.26	58.81	58.75	54.85	62.35	67.61	62.35	67.61
Cleared Load (GW)	13.0	13.0	12.6	12.6	13.0	13.7	15.1	16.1	16.2	16.0	16.2	16.3	16.1	15.9	15.8	15.8	16.6	17.7	17.7	17.4	16.6	15.5	14.1	12.7				

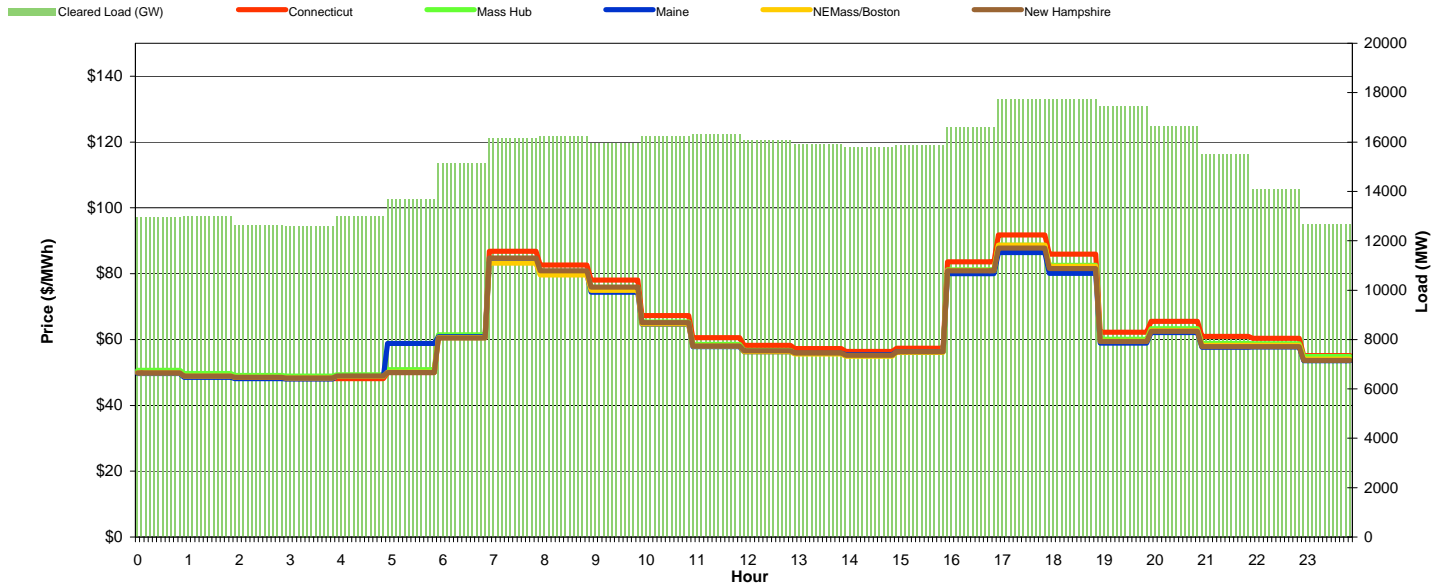

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	48.44	48.31	48.00	48.77	47.76	54.98	82.94	83.72	108.22	142.16	123.09	67.46	60.67	66.71	60.54	63.37	120.55	89.68	79.99	57.87	57.02	57.33	54.69	52.68	71.87	80.82	All	On Pk
NEMass/Boston	47.84	47.83	47.71	48.66	47.98	55.29	82.69	82.78	107.06	140.46	120.92	65.64	59.37	65.08	58.84	61.97	119.17	88.70	78.29	56.22	55.36	55.75	53.46	52.12	70.80	79.32	70.80	79.32
New Hampshire	47.38	47.55	47.46	48.40	47.79	55.07	82.26	82.04	106.36	139.43	119.89	65.16	59.09	64.79	58.82	62.10	118.88	87.82	77.46	55.79	55.08	55.38	52.93	51.55	70.35	78.81	70.35	78.81
Maine	46.37	46.70	46.61	47.54	47.52	54.78	81.09	80.25	104.60	136.59	116.63	63.69	57.38	62.75	57.35	60.84	115.07	84.04	74.07	53.90	52.92	53.66	52.30	51.25	68.66	76.63	68.66	76.63
Mass Hub	48.35	48.41	48.25	49.16	48.38	55.69	83.07	83.23	107.37	140.94	121.53	66.08	59.86	65.64	59.44	62.44	119.49	88.81	78.83	56.75	55.95	56.37	54.08	52.57	71.28	79.80	71.28	79.80
DA Forecast Load (GW)	13.89	13.39	13.18	13.16	13.59	14.72	16.85	17.99	18.11	18.13	18.08	17.99	17.78	17.65	17.53	17.79	19.11	20.00	19.59	18.92	18.11	16.99	15.56	14.19				
Forecast Error %	2.7%	6.1%	6.7%	7.1%	6.0%	2.6%	0.2%	0.7%	1.3%	1.4%	1.3%	0.7%	1.1%	0.6%	2.0%	0.7%	-0.1%	-0.9%	-0.5%	-0.1%	0.6%	1.6%	2.2%	1.9%				

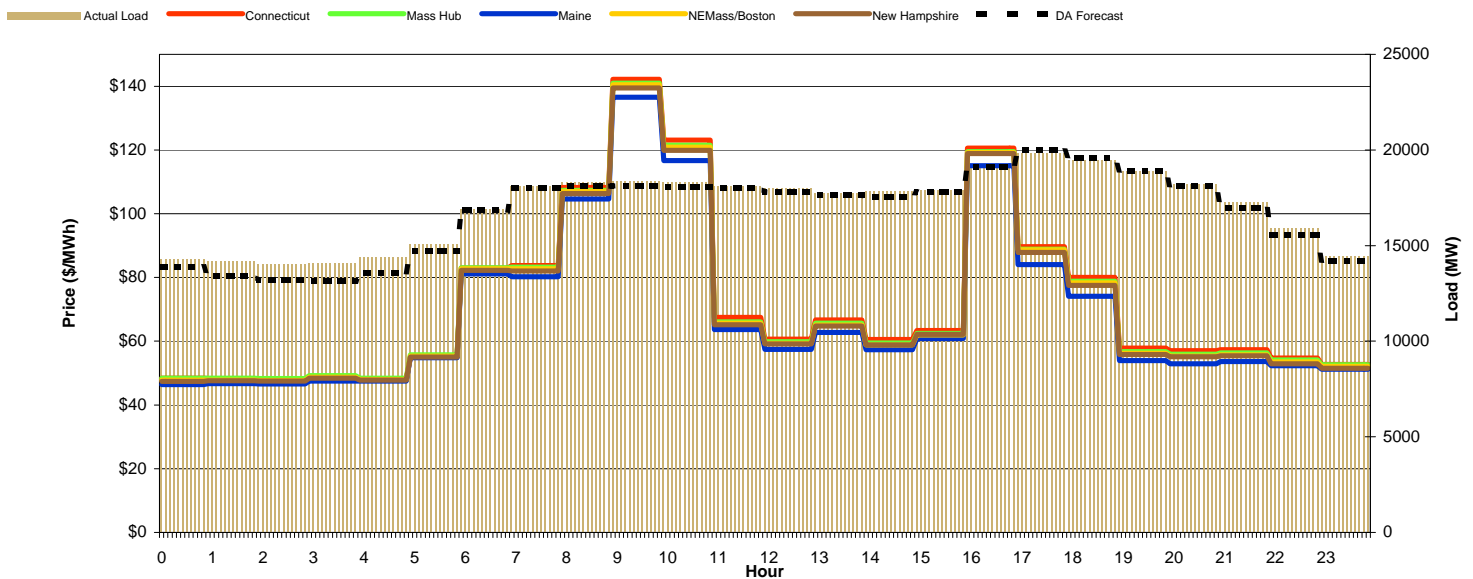




ISO-NE Daily Report

Saturday December 11, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	49.53	49.43	49.17	49.14	47.57	48.00	48.59	51.23	51.50	52.60	52.66	54.29	52.55	52.05	51.65	51.87	55.69	82.08	81.29	64.63	57.46	54.78	52.05	50.07	54.58	57.40	All	On Pk
NEMass/Boston	48.92	48.81	48.53	48.56	47.18	47.62	48.19	49.94	50.32	50.78	50.99	52.40	50.74	50.33	50.03	50.24	53.85	78.25	77.70	61.91	55.05	52.98	50.35	49.13	53.03	55.37		
New Hampshire	48.65	48.59	48.34	48.52	47.10	47.51	47.95	49.93	50.37	50.47	50.68	52.03	50.46	50.08	49.87	50.05	53.62	77.44	76.86	61.29	54.58	52.69	50.04	49.03	52.76	55.03		
Maine	48.08	48.03	47.71	48.44	47.09	47.49	47.67	49.62	50.47	50.05	50.31	51.24	49.86	49.54	49.83	50.05	52.99	76.31	75.62	60.00	53.40	51.85	49.10	49.18	52.25	54.39		
Mass Hub	49.62	49.81	49.57	49.58	48.10	48.60	48.74	50.22	50.57	51.25	51.42	52.88	51.17	50.71	50.37	50.61	54.36	78.86	78.27	62.59	55.69	53.47	50.83	49.82	53.63	55.83		
Cleared Load (GW)	12.2	11.9	11.8	11.6	11.7	11.7	12.1	12.9	13.9	14.4	14.6	14.6	14.3	13.9	13.8	13.9	15.0	15.9	15.9	15.4	15.1	14.1	13.2	12.1				

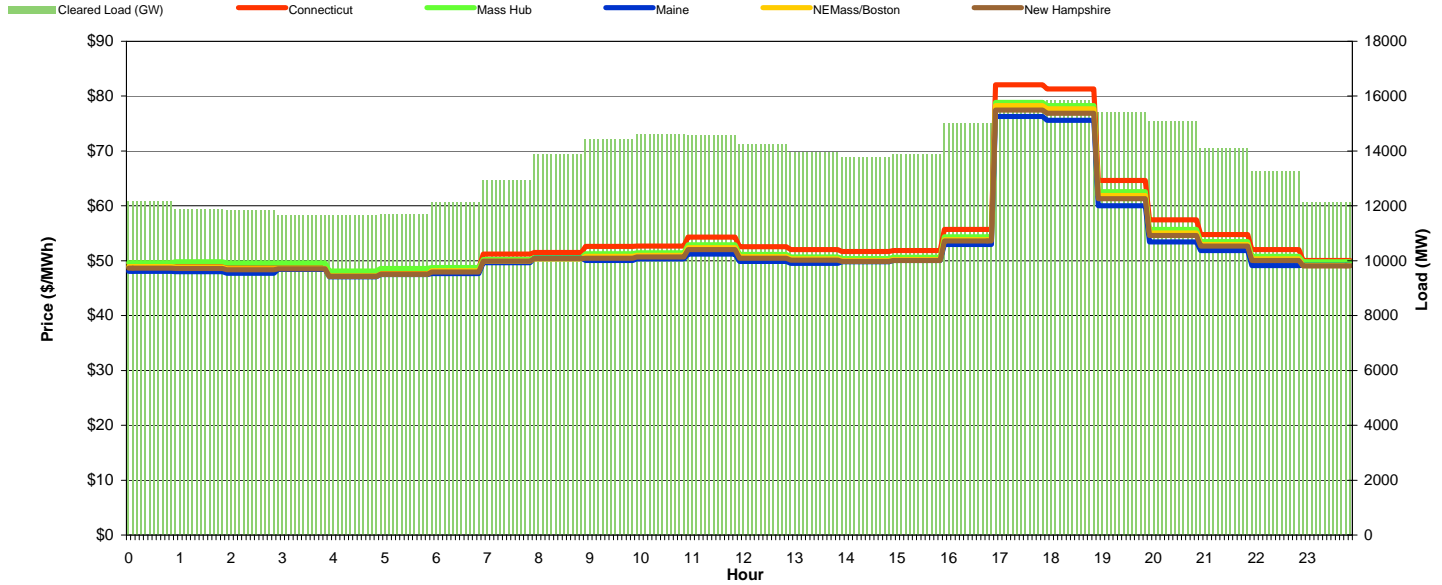

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	53.11	58.95	54.90	57.06	46.99	47.48	48.47	52.20	52.59	56.58	56.78	60.54	52.94	51.14	47.66	45.46	56.43	67.86	64.37	54.64	54.41	52.37	52.28	48.57	53.91	54.89	All	On Pk
NEMass/Boston	52.86	58.59	54.57	57.12	47.17	47.30	47.96	51.26	51.38	54.95	55.03	58.51	51.08	49.87	46.78	44.77	55.17	65.41	61.63	52.82	52.53	50.86	50.83	47.77	52.76	53.31		
New Hampshire	52.38	58.03	54.05	56.58	46.84	46.84	47.58	51.08	51.22	54.54	54.52	58.00	50.65	49.50	46.44	44.46	54.99	64.61	60.77	52.19	52.10	50.36	50.34	47.35	52.31	52.86		
Maine	51.90	57.49	53.38	56.16	47.05	46.41	47.27	50.86	51.06	53.83	53.91	56.79	49.61	48.80	46.01	44.36	54.82	63.48	59.49	51.26	51.08	49.40	49.38	47.10	51.70	52.13		
Mass Hub	53.58	59.57	55.42	58.01	47.66	47.81	48.53	51.94	52.08	55.86	55.97	59.57	52.02	50.63	47.41	45.28	55.88	66.43	62.72	53.63	53.40	51.62	51.60	48.31	53.54	54.13		
DA Forecast Load (GW)	13.41	12.73	12.40	12.23	12.28	12.77	13.58	14.42	15.37	15.88	16.00	15.85	15.51	15.19	14.99	15.19	16.67	17.87	17.61	17.18	16.65	15.91	14.82	13.60				
Forecast Error %	2.9%	5.3%	6.0%	8.0%	4.2%	1.7%	0.9%	0.0%	0.1%	-0.4%	-1.1%	-1.7%	-1.8%	-1.9%	-1.9%	-2.0%	-1.6%	-1.9%	-1.3%	-1.7%	-1.6%	-1.4%	-1.0%	-0.8%				

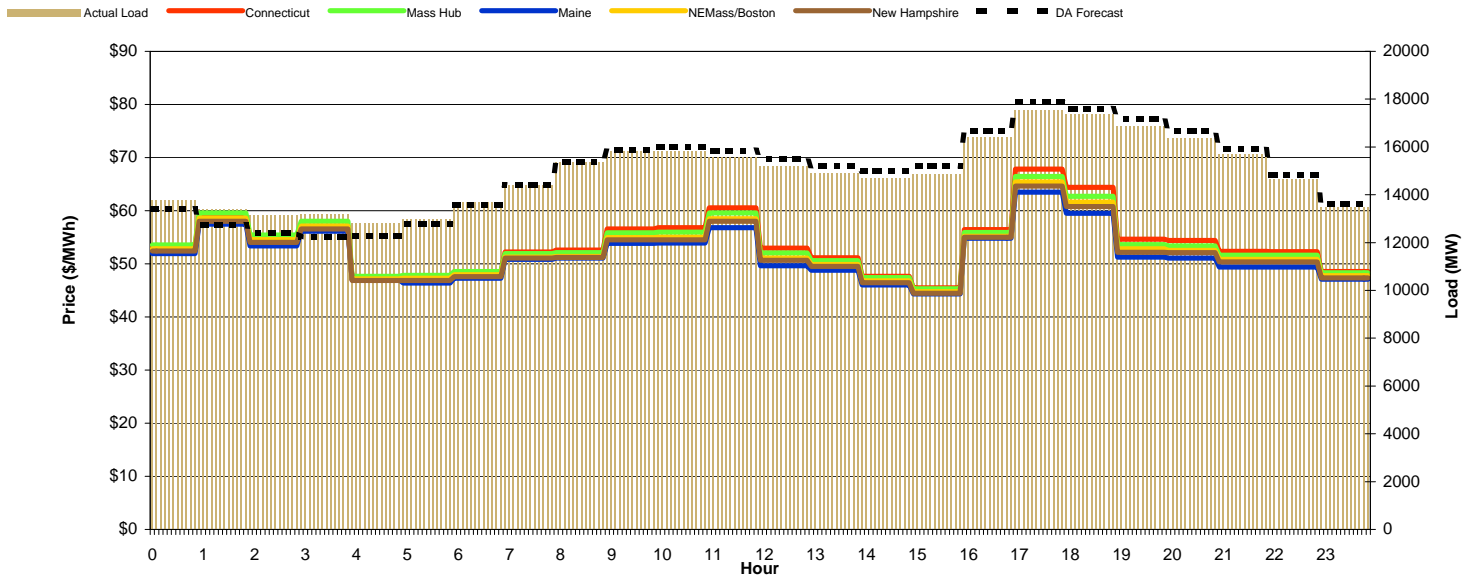




ISO-NE Daily Report

Sunday December 12, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$		
Connecticut	47.21	43.81	43.60	43.34	43.43	43.79	42.77	44.04	50.58	52.59	51.82	52.10	52.24	51.82	51.28	51.58	71.62	81.78	81.22	73.97	61.67	52.94	52.07	49.07	49.07	53.76	58.33
NEMass/Boston	46.51	43.62	43.32	43.02	43.26	43.49	42.61	43.44	48.97	50.84	49.84	50.11	50.29	49.82	49.35	49.57	68.82	78.45	77.90	70.88	59.27	51.05	50.29	48.32	52.21	56.18	56.18
New Hampshire	46.36	43.54	43.29	43.00	43.17	43.41	42.34	43.29	49.02	50.86	49.69	49.85	50.15	49.75	49.27	49.63	68.93	78.06	77.50	70.51	59.25	50.88	50.29	48.18	52.09	56.06	56.06
Maine	46.17	43.27	42.92	42.57	42.81	43.06	41.40	42.75	48.60	50.49	49.21	49.20	49.29	49.15	48.45	49.19	67.63	77.09	76.49	68.91	58.65	50.37	50.26	48.06	51.50	55.36	55.36
Mass Hub	47.50	44.35	44.12	43.85	43.98	44.30	43.27	43.69	49.56	51.25	50.33	50.58	50.75	50.27	49.75	50.00	69.49	78.83	78.33	71.55	59.78	51.49	50.73	48.98	52.78	56.65	56.65
Cleared Load (GW)	11.7	11.6	11.5	11.5	11.4	11.5	12.0	12.1	12.6	13.3	13.6	13.7	13.6	13.4	13.3	13.5	14.8	15.7	15.7	15.2	14.7	13.7	12.5	11.4			

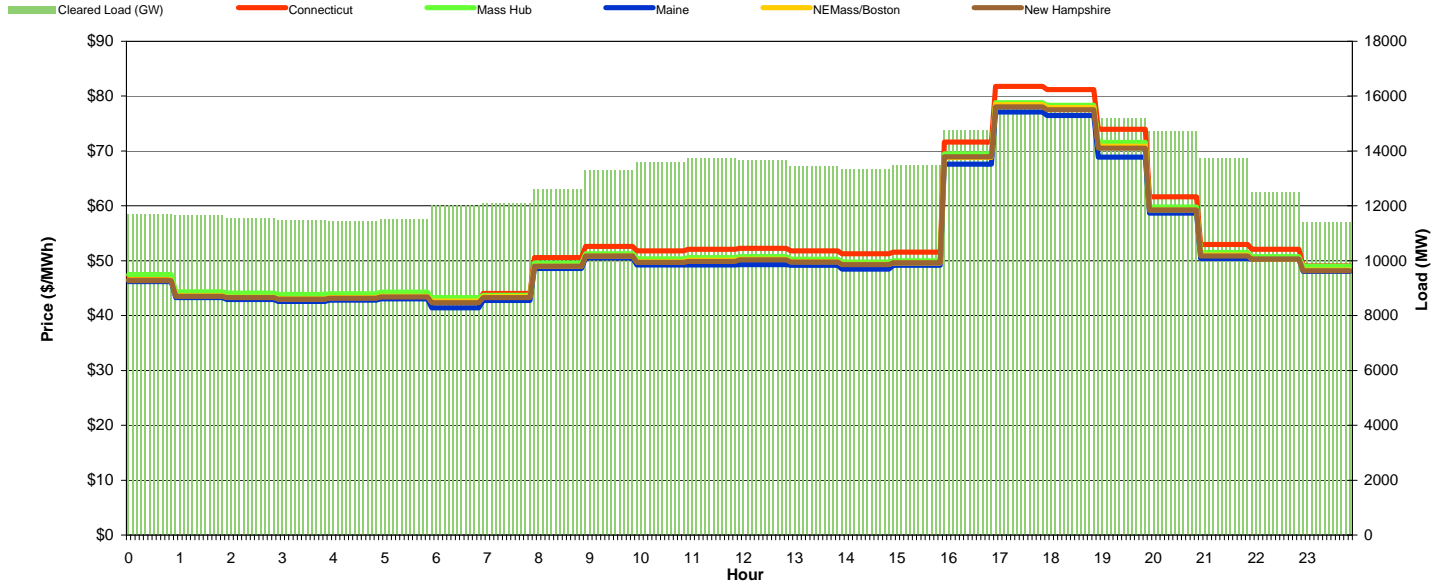

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$	
Connecticut	51.44	57.22	49.61	50.90	51.75	47.87	45.58	47.61	58.51	54.88	55.03	68.81	65.55	59.59	53.69	52.49	73.55	61.80	60.56	62.01	64.64	50.97	47.53	43.72	55.64	58.58
NEMass/Boston	50.47	56.53	49.14	50.48	51.19	47.36	45.01	47.27	57.30	53.00	52.98	65.82	62.53	57.08	51.65	50.66	70.29	58.93	58.07	59.52	61.94	49.25	46.37	43.04	54.00	56.42
New Hampshire	50.16	55.89	48.60	49.96	50.69	46.81	44.53	46.73	56.93	52.66	52.47	64.97	61.70	56.34	50.76	49.89	69.39	57.98	57.00	58.33	60.70	48.30	45.63	42.27	53.28	55.61
Maine	50.34	55.91	48.65	49.91	50.78	46.36	43.54	45.65	55.80	51.58	51.51	63.11	59.28	54.29	48.18	47.57	66.18	56.08	54.90	55.60	57.19	46.01	44.63	40.83	51.83	53.60
Mass Hub	51.24	57.43	49.91	51.26	52.03	48.12	45.73	47.95	58.14	53.92	53.93	67.13	63.80	58.14	52.53	51.50	71.60	59.90	58.87	60.48	63.06	50.01	46.96	43.50	54.88	57.37
DA Forecast Load (GW)	12.59	11.93	11.63	11.45	11.50	11.79	12.40	13.04	13.96	14.70	15.01	15.25	15.29	15.31	15.36	15.66	17.02	17.83	17.61	17.09	16.31	15.22	13.94	12.60		
Forecast Error %	2.1%	6.6%	8.3%	8.8%	8.3%	6.9%	5.7%	1.7%	0.0%	1.6%	3.7%	4.3%	5.3%	4.8%	3.8%	2.6%	0.6%	-0.9%	-0.7%	-0.5%	0.0%	-0.6%	-2.3%	-0.1%		

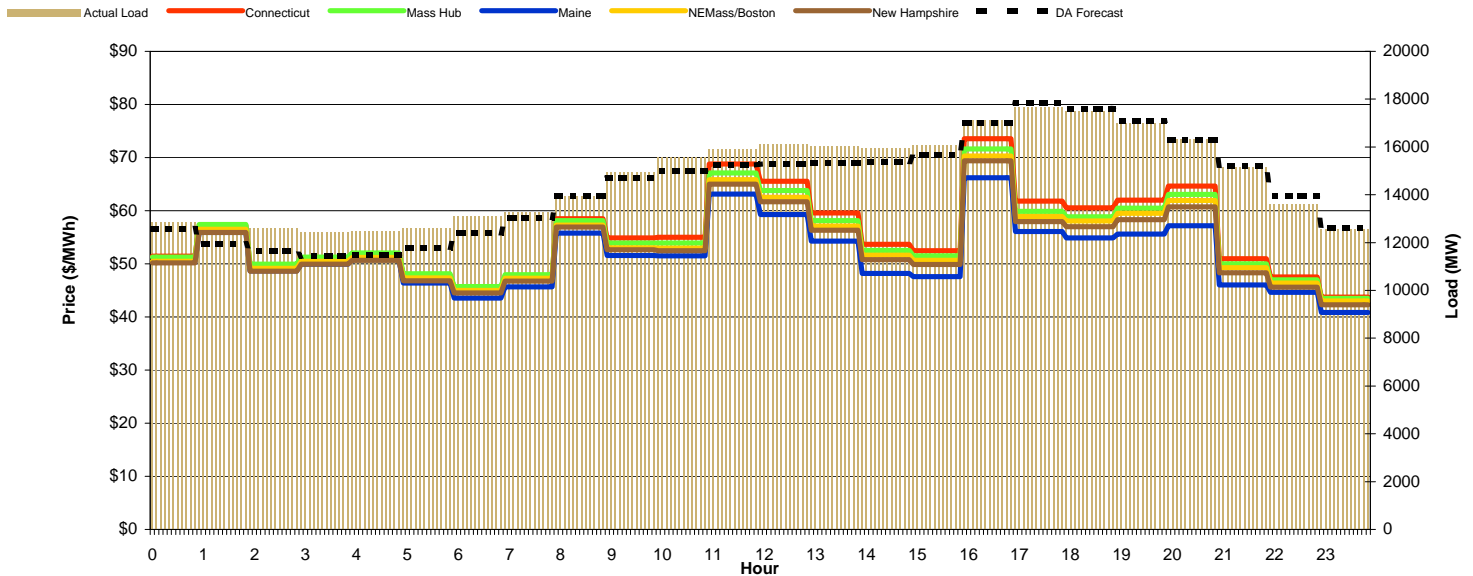




ISO-NE Daily Report

Monday December 13, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	47.47	47.22	46.49	46.47	47.32	50.17	53.97	62.23	67.65	64.17	63.16	62.98	67.74	65.74	63.00	60.33	80.82	98.55	88.00	84.43	82.68	61.44	60.00	51.75	63.49	70.81	All	On Pk
NEMass/Boston	46.49	46.33	45.70	45.68	46.56	49.02	52.41	59.53	64.36	61.30	60.54	60.40	64.65	62.55	60.26	57.63	76.62	89.05	83.97	80.20	77.94	57.99	56.92	50.25	60.68	67.12		
New Hampshire	46.23	46.13	45.45	45.46	46.39	49.04	52.10	58.97	63.68	60.55	59.98	59.66	63.92	62.13	59.59	56.96	75.96	87.77	82.90	79.27	77.31	57.42	56.30	49.94	60.13	66.40		
Maine	45.95	45.80	45.10	45.12	46.12	49.01	51.59	57.89	62.37	59.17	58.87	58.39	62.81	61.00	58.77	55.90	73.90	85.60	80.50	76.53	74.61	55.31	54.67	49.05	58.92	64.77		
Mass Hub	47.49	47.38	46.68	46.67	47.56	50.13	53.36	60.75	65.62	62.39	61.77	61.56	65.81	63.83	61.32	58.74	77.97	94.06	84.91	81.29	79.66	59.36	58.13	51.11	61.98	68.57		
Cleared Load (GW)	11.6	11.6	11.5	11.5	11.7	12.1	13.7	15.2	15.4	15.7	15.9	15.9	15.5	15.4	15.4	15.7	16.6	17.6	17.6	16.9	16.2	15.6	14.1	12.5				

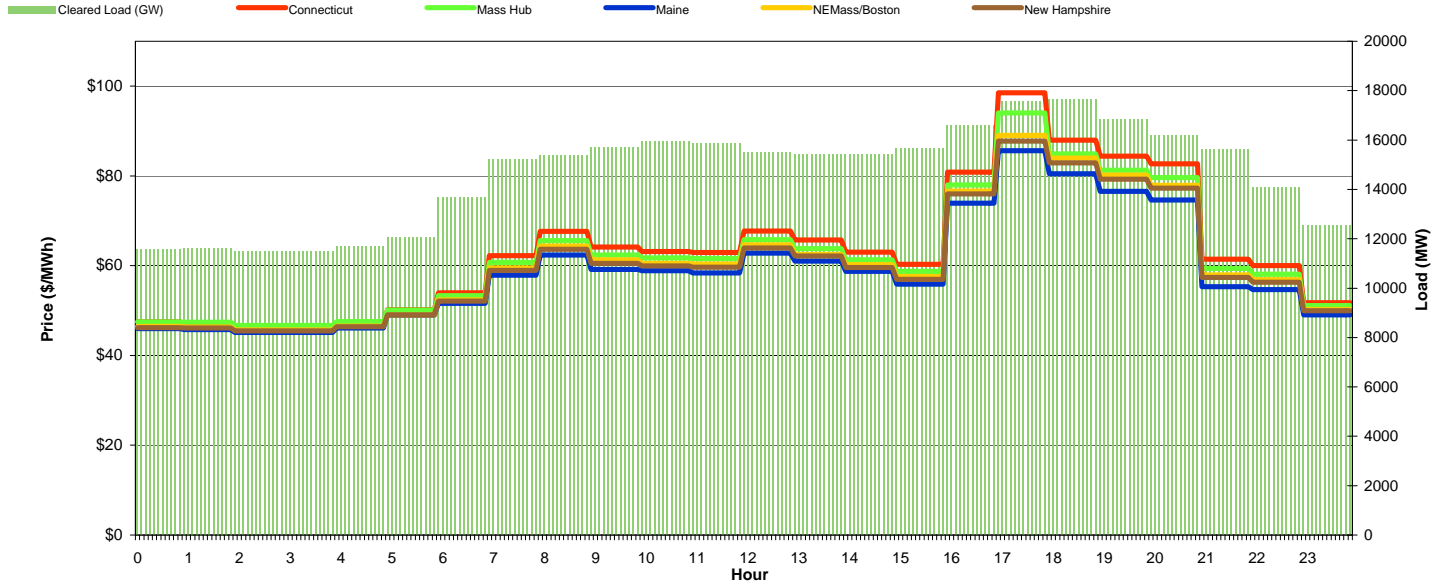

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	29.32	36.70	42.42	38.68	33.76	30.79	46.41	53.16	52.31	54.35	54.53	53.20	55.08	56.28	53.60	53.57	72.33	93.18	87.04	80.81	62.68	58.49	51.01	45.63	53.97	61.98	All	On Pk
NEMass/Boston	29.02	36.35	41.94	38.26	33.38	30.21	45.34	51.32	50.26	52.07	52.36	51.20	52.79	53.81	51.40	51.27	68.97	87.71	80.73	73.50	55.61	51.39	48.46	43.99	51.31	58.30		
New Hampshire	28.57	35.89	41.38	37.77	33.00	29.81	44.72	50.25	49.42	51.15	51.37	50.30	52.07	53.02	50.75	50.66	68.30	86.97	80.04	72.81	54.99	50.56	47.29	43.21	50.60	57.50		
Maine	27.81	35.22	40.36	36.85	32.45	29.03	43.41	48.65	47.10	48.45	48.55	47.56	50.59	51.66	49.66	49.31	66.71	85.89	78.88	70.96	53.53	48.61	45.58	41.95	49.12	55.73		
Mass Hub	29.39	36.84	42.56	38.83	33.83	30.56	45.87	52.17	51.15	53.07	53.33	52.10	53.75	54.83	52.31	52.16	70.14	88.50	81.28	73.94	55.87	51.66	49.46	44.71	52.01	59.11		
DA Forecast Load (GW)	11.49	10.94	10.72	10.64	11.02	12.09	14.28	15.71	16.17	16.47	16.71	16.57	16.25	16.47	16.41	16.56	18.05	18.96	18.54	18.07	17.41	16.09	14.54	13.09				
Forecast Error %	8.3%	9.3%	9.3%	9.7%	8.0%	3.3%	-2.7%	-2.0%	-2.6%	-3.0%	-3.1%	-1.7%	-0.3%	-1.3%	-1.2%	-0.5%	-2.0%	-1.5%	0.5%	0.9%	1.0%	2.6%	2.7%	2.4%				

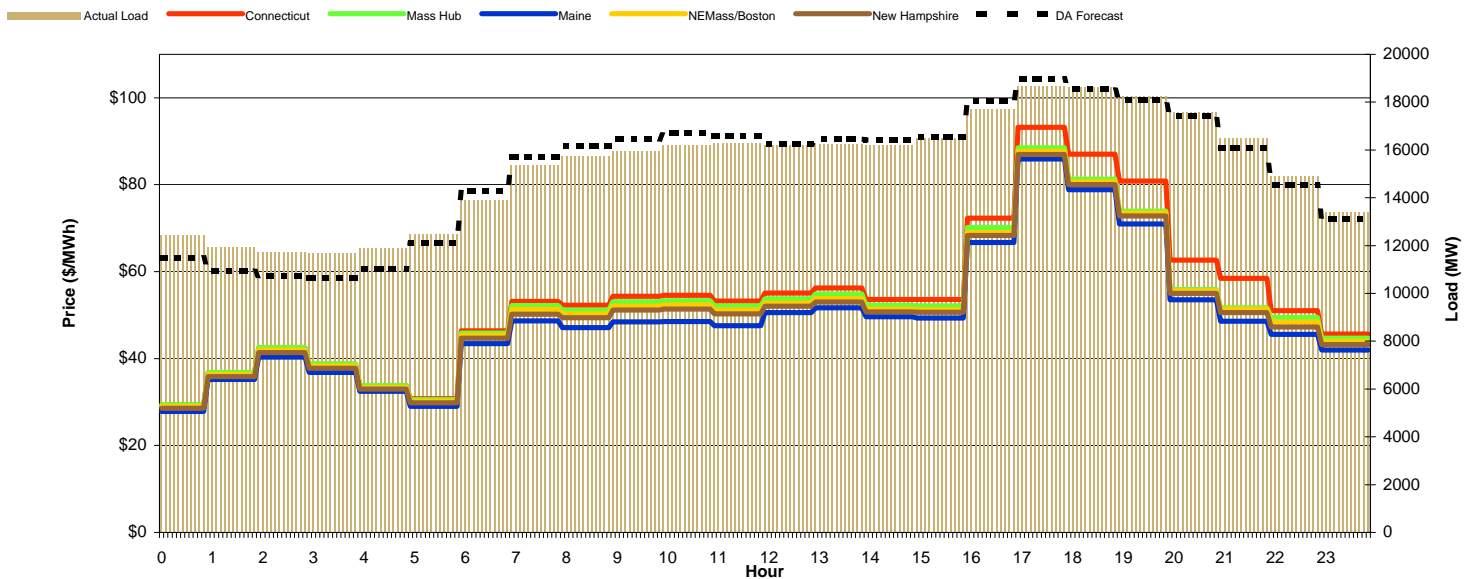




ISO-NE Daily Report

Tuesday December 14, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$	
Connecticut	67.83	70.77	59.51	59.25	72.69	89.62	109.27	129.74	128.13	121.27	136.98	134.03	122.60	112.93	112.64	117.81	142.81	162.17	169.81	155.88	141.12	134.12	119.26	108.70	115.79	133.83
NEMass/Boston	67.33	70.00	59.23	59.26	72.68	89.84	107.81	125.88	123.40	116.46	130.20	127.18	116.46	107.73	107.43	112.59	137.73	156.42	163.73	150.00	134.91	126.91	113.10	104.54	111.70	128.13
New Hampshire	61.03	48.14	49.39	55.03	64.97	88.49	106.60	124.31	121.54	114.45	127.83	124.88	114.34	105.88	105.59	110.67	134.92	153.84	161.11	147.30	132.73	124.75	111.40	96.84	107.75	125.97
Maine	65.00	67.32	57.13	57.20	70.08	86.73	104.76	121.19	117.77	111.45	122.85	120.38	110.20	102.27	101.75	107.27	131.27	151.03	157.83	143.82	128.96	120.50	108.13	99.84	106.86	122.29
Mass Hub	67.59	70.95	60.00	60.00	73.46	90.13	108.57	126.59	123.98	117.10	131.14	128.07	117.21	108.45	108.23	113.36	138.09	156.34	163.79	150.07	135.20	128.20	114.51	106.51	112.40	128.77
Cleared Load (GW)	11.3	11.4	11.5	11.6	11.7	12.1	13.9	15.0	15.5	15.6	15.0	14.8	15.0	14.8	14.9	15.0	16.3	17.0	16.7	16.4	16.0	15.0	14.1	12.9		

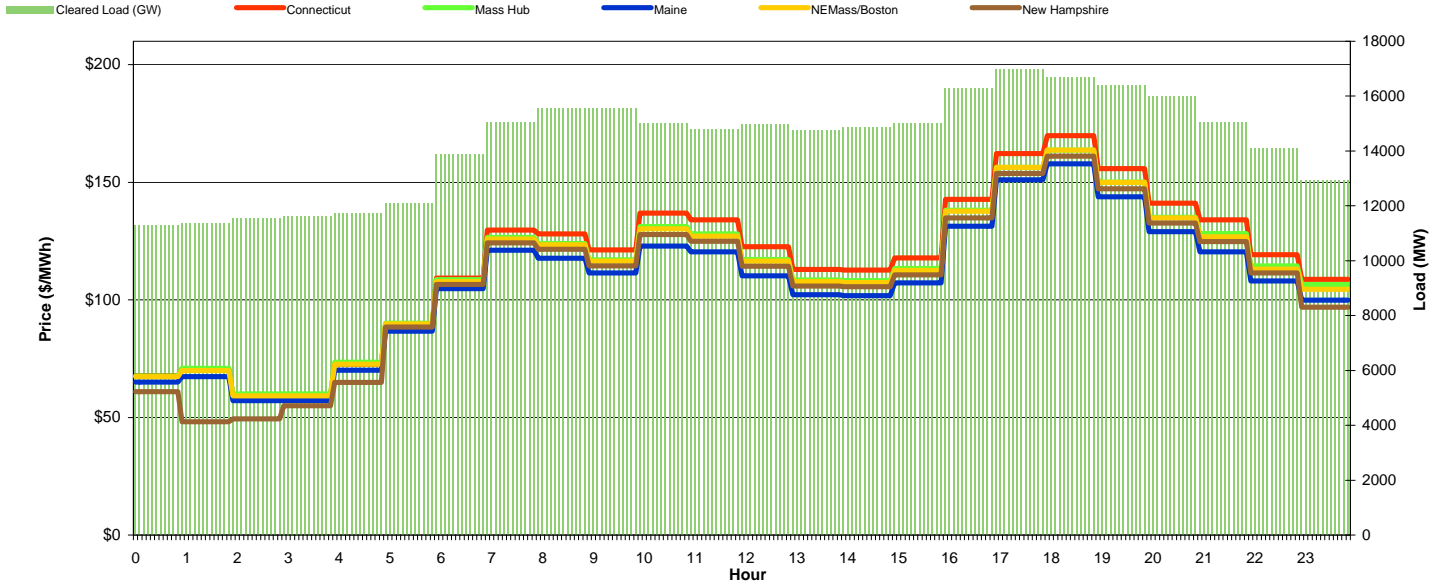

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$	
Connecticut	45.55	62.67	51.12	40.45	53.46	97.64	131.81	144.19	140.93	127.55	137.20	120.93	112.39	108.62	105.05	101.93	145.71	163.98	199.84	141.61	136.49	127.73	124.64	110.53	113.83	133.67
NEMass/Boston	44.79	62.04	50.58	39.93	52.55	95.05	126.87	137.71	134.34	121.17	127.98	113.25	105.61	102.93	100.17	98.16	139.94	158.14	190.75	135.69	130.42	121.48	118.82	106.46	108.95	127.29
New Hampshire	43.73	59.58	49.49	39.21	51.09	91.10	123.43	134.78	131.49	118.67	124.85	111.49	104.16	101.43	98.75	96.92	138.09	155.45	187.37	132.90	127.52	118.76	116.35	104.14	106.70	124.94
Maine	42.25	58.14	47.82	37.61	49.07	88.59	119.74	128.08	125.04	112.57	118.69	106.72	100.28	97.21	95.06	94.39	134.40	150.53	180.37	126.83	120.27	111.98	110.01	97.03	102.20	119.53
Mass Hub	45.28	62.87	51.33	40.52	53.33	96.50	128.77	139.64	136.31	123.04	129.75	115.22	107.41	104.44	101.42	99.12	141.42	159.16	192.35	136.81	131.80	123.17	120.89	108.38	110.37	128.87
DA Forecast Load (GW)	12.00	11.57	11.43	11.50	11.92	13.25	15.57	16.88	17.06	17.18	17.17	17.20	17.08	17.05	17.05	17.32	18.96	20.20	20.00	19.60	18.83	17.69	16.04	14.52		
Forecast Error %	4.8%	8.3%	8.6%	8.3%	7.7%	3.4%	-0.4%	-0.1%	0.6%	0.4%	0.1%	-0.4%	-0.7%	-0.4%	-0.5%	-0.4%	-1.0%	-1.0%	0.0%	0.6%	2.0%	2.5%	2.8%	3.9%		

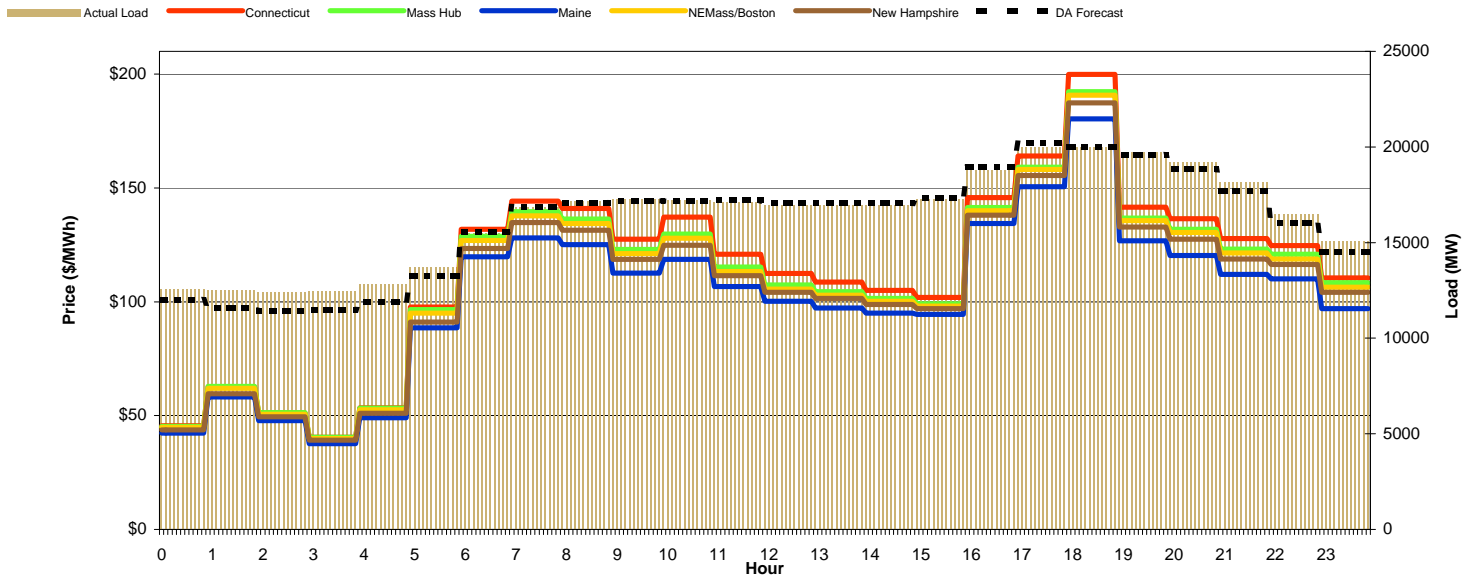




ISO-NE Daily Report

Wednesday December 15, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$	
Connecticut	102.82	87.78	89.11	85.21	94.25	104.87	109.82	121.73	122.38	125.74	120.56	118.88	116.09	113.03	112.08	115.87	148.93	168.07	162.52	149.08	142.22	119.94	111.40	104.63	118.63	129.28
NEMass/Boston	101.36	87.09	88.33	84.58	94.36	103.98	108.37	117.18	117.45	120.39	115.65	114.16	111.67	108.89	108.49	111.47	141.24	160.68	155.35	142.01	135.00	115.35	106.24	101.66	114.62	123.83
New Hampshire	97.13	83.76	84.87	81.45	90.48	100.63	107.91	116.67	116.45	119.18	114.44	113.16	110.76	108.04	107.45	110.73	140.64	159.52	154.24	141.24	134.23	114.36	103.08	97.87	112.85	122.76
Maine	96.46	82.43	83.38	79.99	89.60	99.16	109.62	115.45	114.45	116.44	111.02	109.55	107.25	105.11	104.92	108.06	138.65	157.90	153.15	139.07	131.59	112.52	102.01	97.53	111.05	120.45
Mass Hub	102.45	87.89	89.27	85.54	94.97	105.04	109.89	118.37	118.63	121.68	116.76	115.19	112.58	109.97	109.14	112.41	142.51	161.48	156.04	142.84	136.61	116.33	107.61	103.04	115.68	124.88
Cleared Load (GW)	12.3	12.3	12.3	12.4	12.2	13.0	15.5	16.7	16.9	16.8	16.6	16.4	16.3	16.1	16.0	16.1	17.4	18.4	18.4	18.1	17.4	16.3	14.9	13.2		

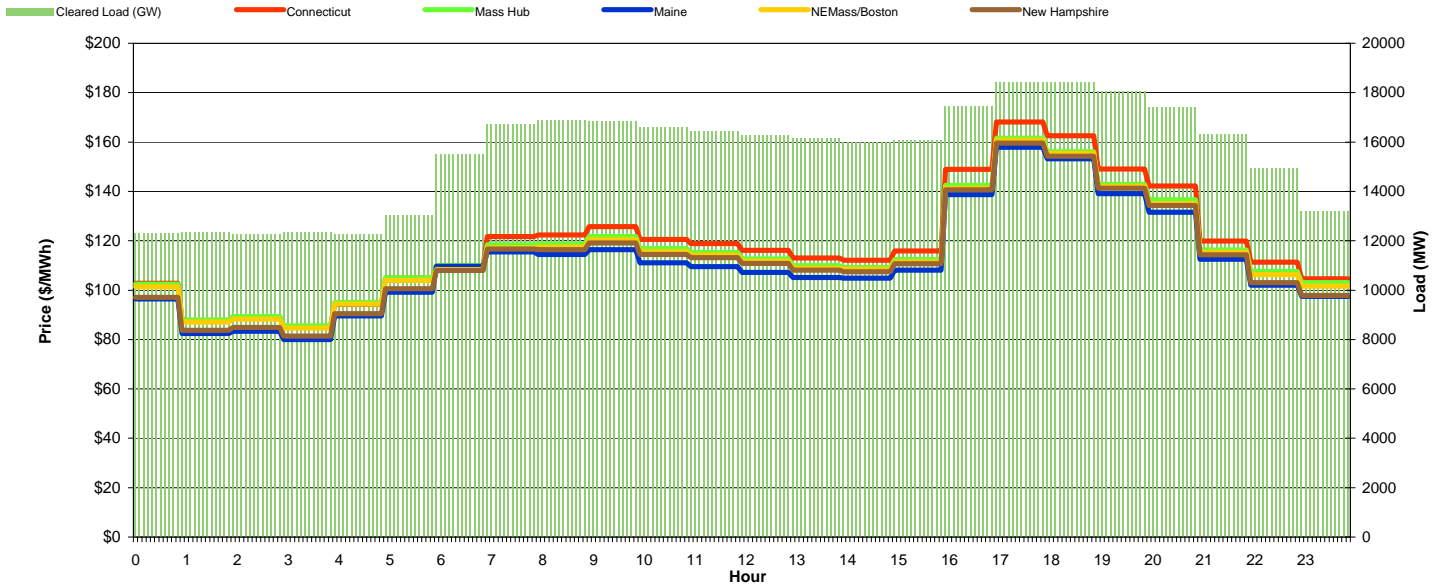

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$	
Connecticut	134.96	116.46	105.12	77.02	61.49	98.49	123.45	124.82	123.92	117.37	115.86	116.18	110.62	112.78	107.36	111.49	150.23	191.51	125.02	121.10	118.48	116.61	102.62	102.61	116.07	122.87
NEMass/Boston	130.27	113.98	102.89	75.56	60.93	97.98	121.42	120.68	119.18	113.28	111.87	112.47	107.59	109.36	104.58	108.41	144.93	185.77	121.36	118.41	114.66	112.82	99.30	100.21	112.83	119.04
New Hampshire	127.77	112.03	100.90	74.19	59.76	95.87	119.59	119.50	117.97	112.08	110.63	111.09	106.48	108.37	103.44	107.45	143.36	183.34	119.89	117.17	113.50	111.42	97.71	98.15	111.32	117.71
Maine	116.57	105.93	94.59	70.02	56.60	91.08	115.80	114.48	112.50	107.80	106.03	106.89	103.17	104.95	100.51	105.22	139.85	179.77	117.74	115.59	110.76	108.12	94.99	95.66	107.28	114.27
Mass Hub	132.79	115.78	104.61	76.82	61.76	98.94	123.00	122.80	121.42	115.21	113.74	114.19	109.08	110.92	105.79	109.58	146.26	186.53	121.86	118.84	115.51	113.94	100.40	101.36	114.21	120.38
DA Forecast Load (GW)	13.84	13.31	13.05	13.14	13.58	14.86	17.02	18.32	18.49	18.53	18.52	18.37	18.14	17.94	17.93	18.15	19.65	20.71	20.51	20.06	19.40	18.30	16.70	15.16		
Forecast Error %	2.3%	3.6%	7.9%	9.2%	5.2%	-0.6%	-1.9%	-1.8%	-1.8%	-2.3%	-2.2%	-1.5%	-0.8%	0.3%	0.2%	0.0%	-0.7%	-0.8%	-0.3%	0.3%	0.6%	0.6%	0.1%	-0.8%		

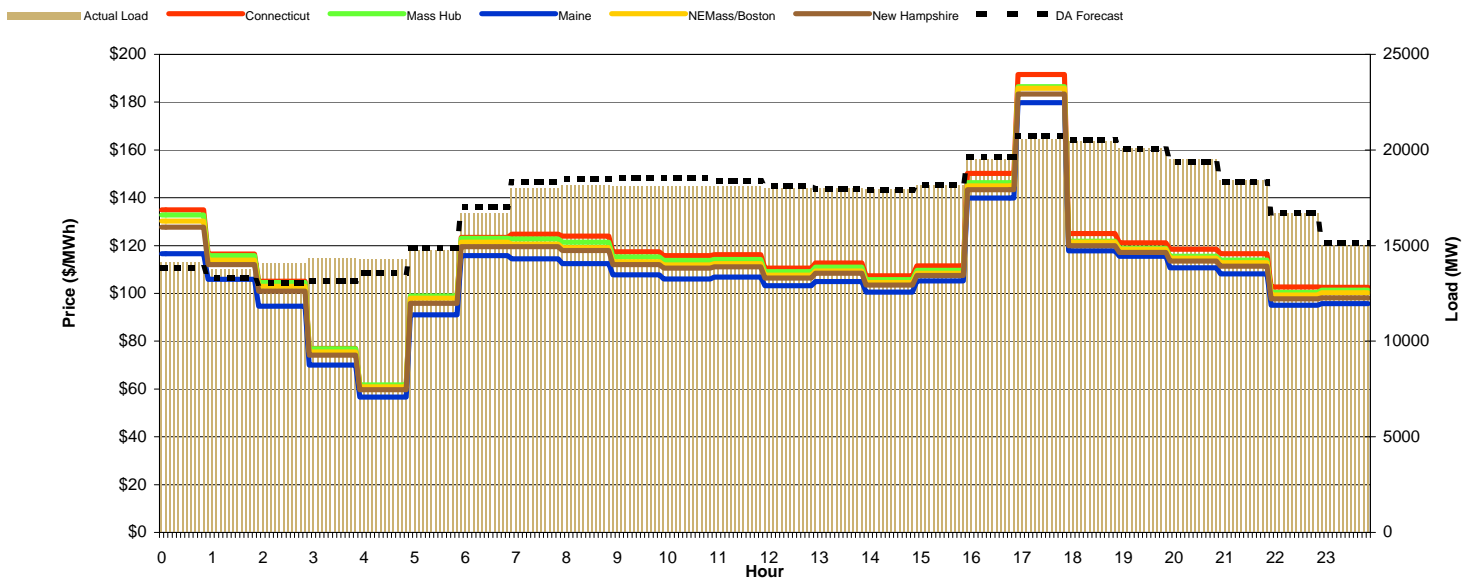




ISO-NE Daily Report

Thursday December 16, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$		
Connecticut	77.80	76.84	75.73	73.57	70.22	80.00	88.63	120.00	129.27	128.99	126.28	117.52	95.60	92.30	89.76	93.48	125.88	147.64	146.25	138.34	118.51	92.80	90.23	76.47	76.47	103.00	115.80
NEMass/Boston	76.64	75.86	75.74	73.63	70.26	79.48	85.98	113.76	122.10	121.81	118.93	110.54	90.21	87.27	85.13	88.47	118.96	140.26	138.54	130.81	111.99	87.56	86.11	75.54	98.57	98.57	109.53
New Hampshire	75.32	74.57	74.72	72.69	68.98	78.42	85.24	112.64	120.76	120.38	117.47	109.15	89.20	86.42	84.40	87.55	118.04	138.80	136.83	129.63	110.87	86.69	85.33	74.36	97.44	97.44	108.39
Maine	73.38	72.44	72.18	70.25	67.53	77.00	83.13	108.67	115.93	115.37	112.52	104.40	85.95	83.59	81.62	85.00	114.08	135.43	132.25	124.84	106.48	83.87	83.55	73.35	94.28	94.28	104.60
Mass Hub	77.97	77.35	76.94	74.76	71.25	80.49	87.73	115.46	124.02	123.59	120.74	112.35	91.58	88.53	86.25	89.79	120.55	141.73	140.10	132.61	113.55	88.86	87.17	76.35	99.99	99.99	111.06
Cleared Load (GW)	12.6	12.6	12.5	12.5	12.6	13.2	15.5	16.4	16.3	16.3	16.2	16.1	16.0	15.8	15.7	15.9	17.1	17.8	17.9	17.5	17.1	16.1	14.6	13.1			

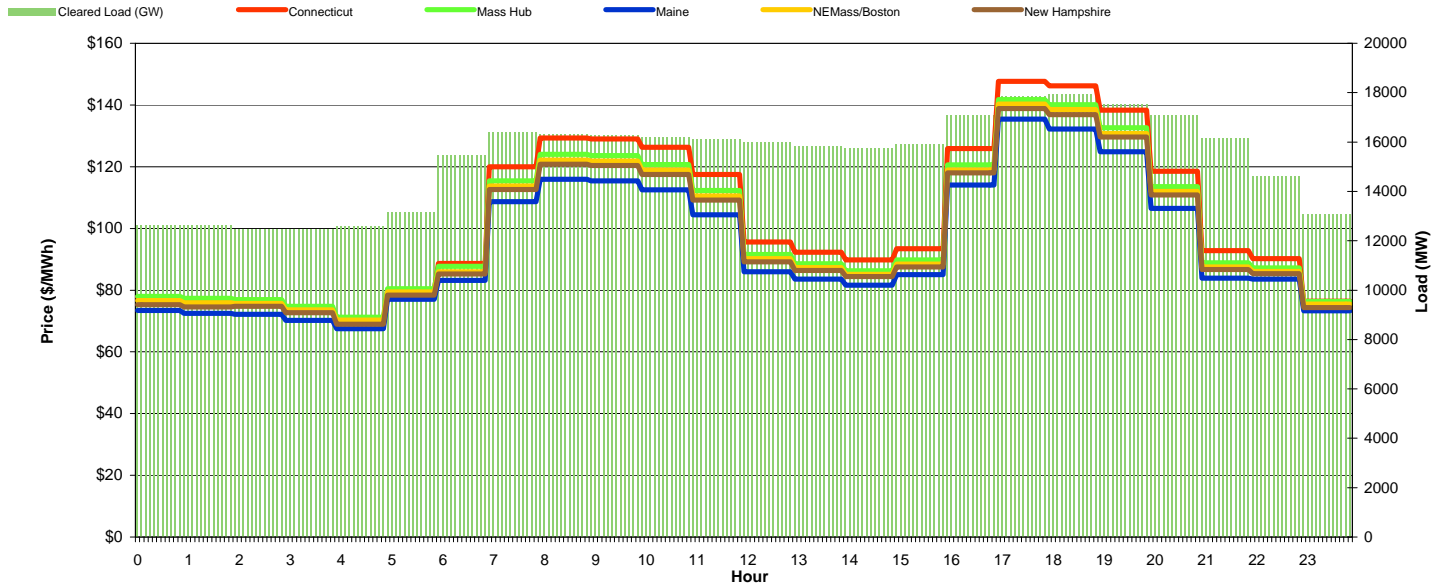

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$		
Connecticut	91.62	116.84	95.24	87.39	84.79	78.59	88.79	118.84	119.89	121.71	91.92	82.98	76.74	77.61	78.56	82.01	123.08	133.21	107.90	137.51	92.84	88.27	76.73	73.57	96.94	96.94	100.61
NEMass/Boston	89.98	115.24	94.83	86.89	84.05	77.34	86.22	114.07	114.81	116.93	87.96	79.45	74.13	74.94	75.57	78.90	118.21	128.99	104.26	132.20	89.23	84.15	73.93	72.56	93.95	93.95	96.73
New Hampshire	88.10	112.65	92.90	85.05	82.32	76.13	85.25	112.42	112.88	115.04	86.74	78.66	73.26	74.12	74.79	78.08	117.08	127.41	102.92	130.54	88.08	82.93	72.50	70.63	92.52	92.52	95.47
Maine	85.10	107.45	89.00	81.71	79.85	73.97	82.71	108.15	108.44	110.64	83.37	76.16	71.09	72.01	72.74	75.84	113.81	123.66	99.92	125.91	84.40	79.61	70.10	68.90	89.36	89.36	92.24
Mass Hub	91.09	117.03	96.08	88.09	85.23	78.34	87.57	116.01	116.68	118.81	89.54	80.81	75.19	76.07	76.77	80.11	120.05	130.54	105.29	133.82	90.66	85.66	75.02	73.12	95.32	95.32	98.19
DA Forecast Load (GW)	14.00	13.42	13.15	13.08	13.42	14.59	16.86	18.03	18.09	18.06	17.98	17.78	17.53	17.39	17.34	17.56	19.11	20.26	20.06	19.61	18.91	17.77	16.11	14.54			
Forecast Error %	0.6%	3.9%	6.1%	8.3%	6.2%	4.7%	0.6%	-0.6%	-0.5%	-1.1%	-1.5%	-1.5%	-1.8%	-0.9%	-0.4%	-1.8%	-2.5%	-1.9%	-1.0%	-0.5%	0.3%	1.2%	1.7%	1.8%			

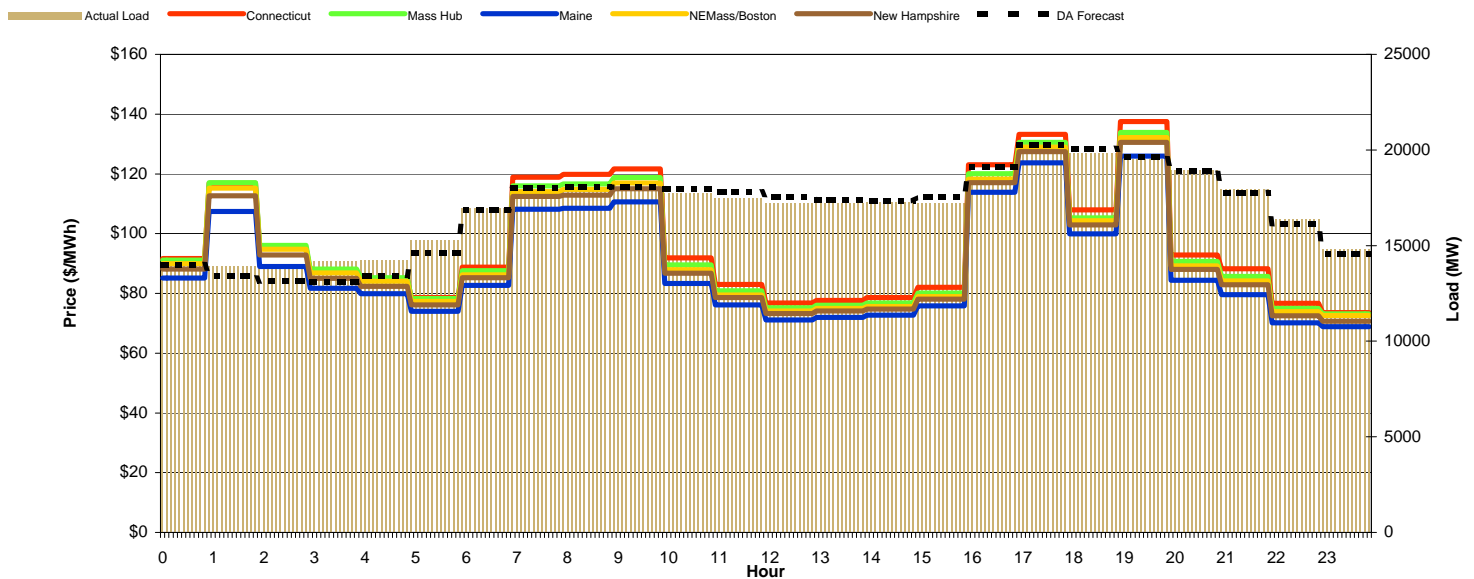




ISO-NE Daily Report

Friday December 17, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	80.02	74.12	70.00	71.17	70.90	77.99	102.31	106.98	110.00	88.09	88.27	83.12	80.66	77.22	75.08	79.92	103.28	128.88	124.87	94.96	90.00	87.08	85.25	81.35	88.81	93.98	All	On Pk
NEMass/Boston	75.95	71.53	67.75	68.67	68.92	75.25	98.21	102.51	105.61	84.29	84.35	79.74	77.84	74.80	72.81	77.34	99.04	124.48	120.26	90.11	85.31	83.48	82.21	78.58	85.38	90.26		
New Hampshire	74.74	70.13	66.47	67.37	67.73	74.51	97.87	102.33	105.35	84.23	84.08	79.39	77.71	74.69	72.57	77.22	99.26	124.42	120.04	90.19	85.10	83.34	81.96	77.76	84.94	90.12		
Maine	71.26	66.83	63.39	64.24	64.78	72.45	96.03	100.23	103.30	82.86	82.67	77.97	76.31	73.19	70.87	76.01	97.78	123.00	118.07	88.24	83.04	81.61	80.86	76.43	82.98	88.50		
Mass Hub	77.19	72.39	68.54	69.47	69.64	76.08	98.85	103.09	106.06	84.78	84.84	80.17	78.01	74.89	72.86	77.44	99.66	124.64	120.48	90.76	86.28	84.18	82.71	79.09	85.92	90.68		
Cleared Load (GW)	13.4	13.1	13.1	13.0	13.3	14.1	15.2	16.1	16.2	16.9	16.6	16.5	16.0	15.8	15.7	15.8	16.9	17.8	17.8	17.7	16.9	15.8	14.3	13.0				

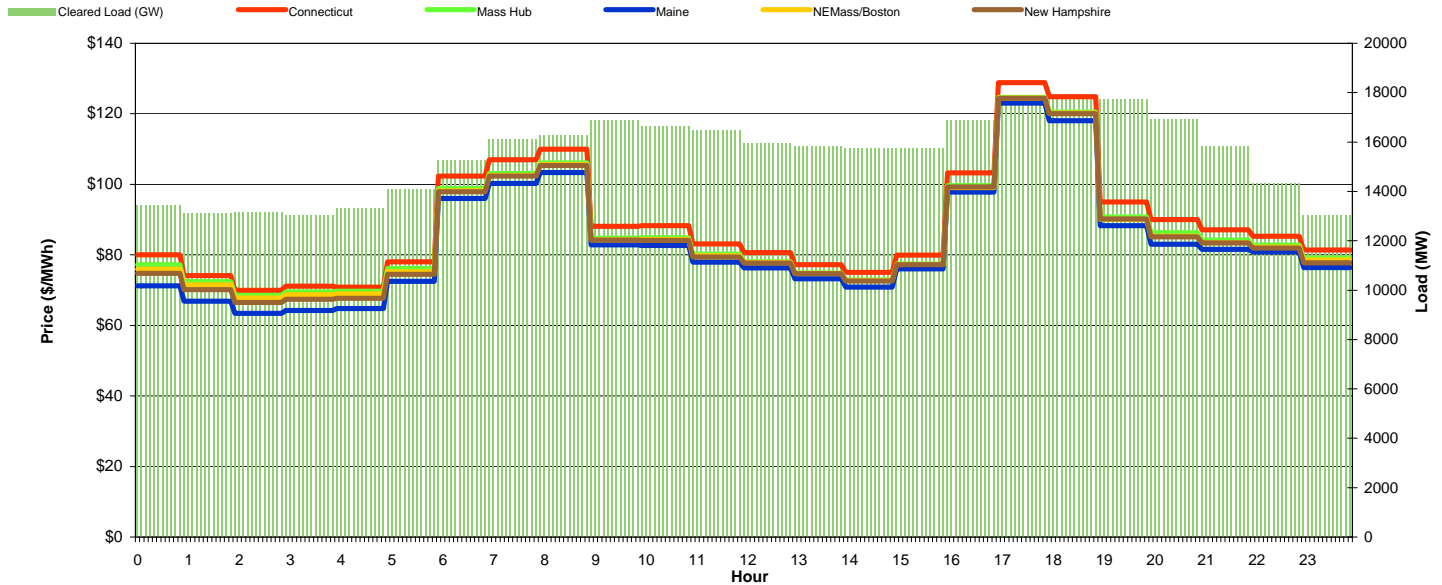

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	83.51	74.09	80.68	76.22	82.43	97.00	96.14	96.25	105.33	85.89	84.83	77.00	69.35	62.63	58.75	58.72	88.12	113.98	93.23	81.79	76.35	71.38	73.04	69.92	81.53	81.04	All	On Pk
NEMass/Boston	81.46	72.49	79.06	74.65	81.06	95.29	93.23	93.66	102.14	83.04	81.86	74.65	67.77	61.14	57.49	57.51	86.50	110.59	91.10	79.20	74.14	69.92	72.10	69.58	79.57	78.93		
New Hampshire	79.44	70.78	77.33	73.01	79.40	93.70	92.23	92.73	101.08	82.35	81.28	74.11	67.30	60.68	57.11	57.30	86.08	109.66	90.54	78.97	73.95	69.51	71.30	68.48	78.68	78.37		
Maine	75.99	67.65	74.23	69.93	76.41	91.51	90.94	91.96	99.70	81.81	80.61	73.50	66.57	59.68	56.23	56.87	85.44	107.86	89.98	78.53	73.58	68.58	69.97	67.24	77.28	77.55		
Mass Hub	82.54	73.56	80.21	75.75	82.20	96.52	94.43	94.70	103.39	84.13	82.90	75.45	68.30	61.65	57.97	57.93	87.14	111.59	91.81	80.05	74.97	70.48	72.59	69.91	80.42	79.69		
DA Forecast Load (GW)	13.62	13.08	12.87	12.85	13.24	14.38	16.54	17.78	17.91	17.82	17.69	17.44	17.16	17.05	16.95	17.15	18.54	19.50	19.18	18.69	18.09	17.20	15.87	14.43				
Forecast Error %	5.0%	9.1%	11.1%	11.6%	10.6%	6.2%	0.6%	-0.1%	0.3%	0.1%	-0.3%	-0.3%	-1.0%	-0.9%	0.5%	-1.0%	-2.2%	-1.1%	-0.4%	-0.6%	-0.2%	0.5%	1.4%	1.6%				

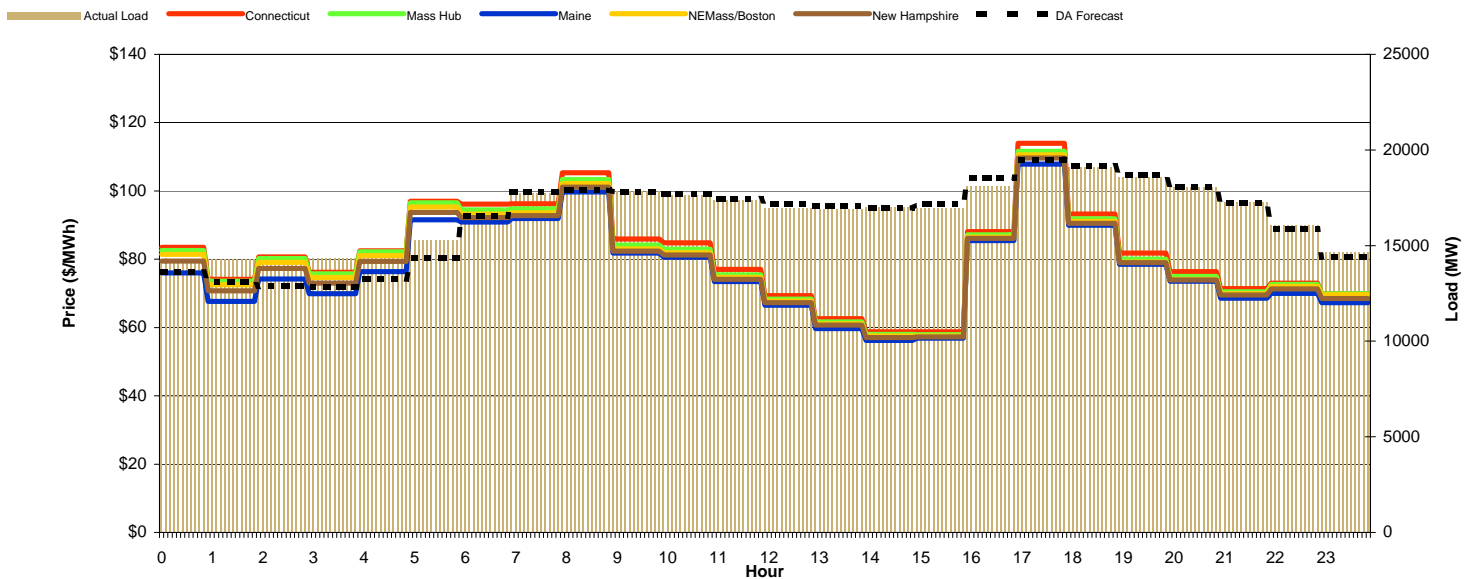




ISO-NE Daily Report

Saturday December 18, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
																										All	On Pk	
Connecticut	85.77	78.81	77.08	76.30	77.37	76.36	84.63	86.09	96.26	95.14	97.52	97.10	91.94	86.77	80.68	85.69	98.35	123.47	121.84	109.69	98.29	96.92	92.58	86.12	91.70	97.40	86.12	91.70
NEMass/Boston	83.46	76.57	74.70	74.57	75.70	75.09	82.66	83.61	93.01	90.98	92.79	92.48	87.96	83.00	77.61	82.71	94.14	117.70	115.78	103.94	93.20	91.87	89.00	82.93	88.14	93.11	82.93	88.14
New Hampshire	82.61	75.75	73.94	73.64	74.69	74.36	82.09	83.74	93.31	90.75	92.54	91.83	87.13	82.41	77.05	82.18	94.34	117.11	115.39	103.46	93.12	90.98	88.32	81.76	87.60	92.73	81.76	87.60
Maine	79.34	72.73	70.69	70.43	71.73	72.46	80.23	82.00	91.19	88.23	89.64	88.25	83.59	79.84	74.82	80.07	92.64	114.86	112.52	100.00	89.96	86.60	84.13	77.85	84.74	89.90	77.85	84.74
Mass Hub	84.37	77.44	75.81	75.46	76.19	75.56	83.15	83.52	93.00	91.36	93.14	92.82	88.09	83.08	77.56	82.60	94.49	117.96	115.82	104.15	93.40	92.17	89.06	83.76	88.50	93.26	83.76	88.50
Cleared Load (GW)	12.6	12.2	12.1	12.0	11.8	12.4	12.7	13.5	14.3	14.9	14.8	14.6	14.4	14.2	14.0	14.1	15.6	16.5	16.4	16.0	15.5	14.6	13.6	12.6				

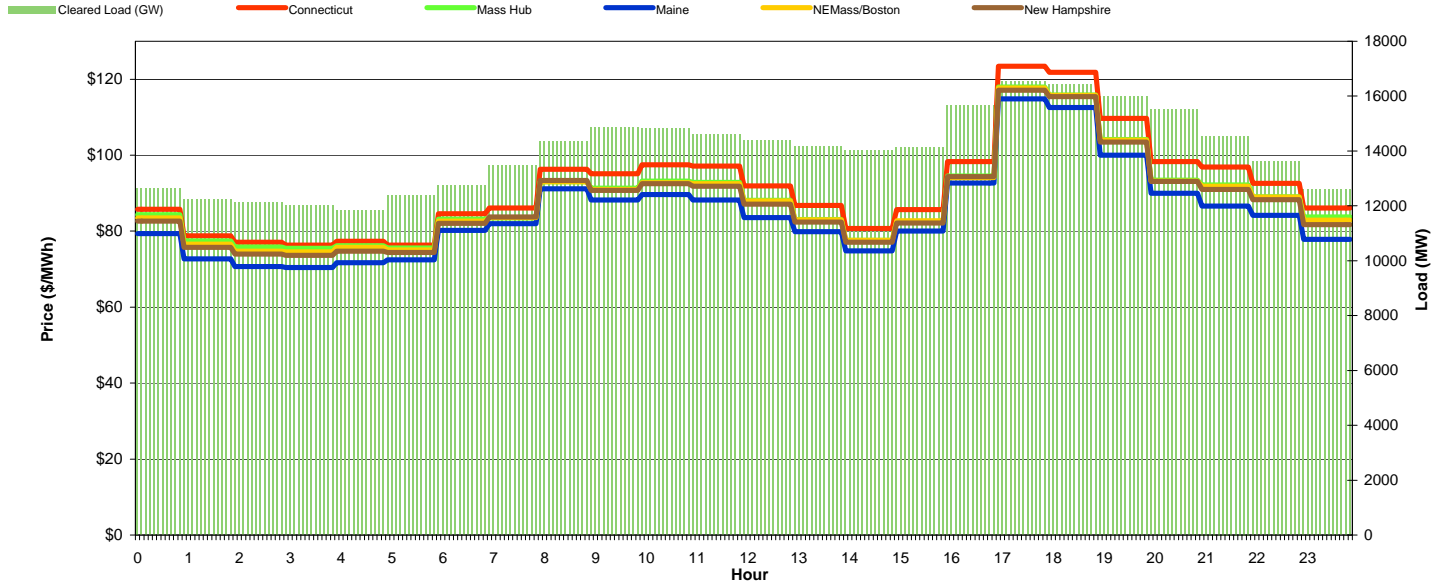

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
																										All	On Pk	
Connecticut	90.06	88.92	91.89	83.31	83.22	69.79	66.98	80.65	91.39	86.97	90.83	86.60	81.04	65.91	60.13	70.34	104.02	124.89	104.94	93.33	89.93	89.84	84.48	72.62	85.50	87.83	72.62	85.50
NEMass/Boston	88.62	87.23	89.63	81.70	81.58	68.70	66.16	79.32	89.44	85.16	87.92	84.02	78.92	64.62	59.11	69.42	101.62	121.10	102.31	90.90	87.10	86.50	82.26	70.56	83.50	85.61	70.56	83.50
New Hampshire	87.60	86.16	88.74	80.94	80.82	68.18	65.86	79.30	89.66	85.05	87.74	83.68	78.45	63.93	58.42	68.77	100.99	119.97	101.31	90.01	86.50	85.47	81.14	69.58	82.84	85.02	69.58	82.84
Maine	84.97	83.46	85.69	78.82	78.97	67.16	65.44	78.59	88.83	84.05	86.07	82.02	76.90	62.30	56.86	67.43	98.47	116.81	98.55	87.56	83.42	81.51	77.40	66.70	80.75	82.92	66.70	80.75
Mass Hub	89.31	87.85	90.36	82.19	81.97	69.27	66.41	79.65	90.06	85.73	88.79	84.74	79.45	64.93	59.41	69.65	102.23	121.63	102.88	91.54	87.88	87.39	82.86	71.06	84.05	86.18	71.06	84.05
DA Forecast Load (GW)	13.47	12.94	12.67	12.57	12.67	13.19	14.03	14.90	15.80	16.29	16.34	16.16	15.90	15.66	15.57	15.79	17.28	18.29	18.13	17.67	17.05	16.32	15.22	13.95				
Forecast Error %	1.0%	2.5%	3.4%	3.3%	3.0%	2.9%	-0.3%	-0.6%	-0.2%	-0.3%	-0.6%	-1.1%	-1.8%	-2.4%	-1.7%	-2.3%	-3.4%	-2.2%	-2.1%	-2.0%	-1.0%	-0.5%	0.3%	1.1%				

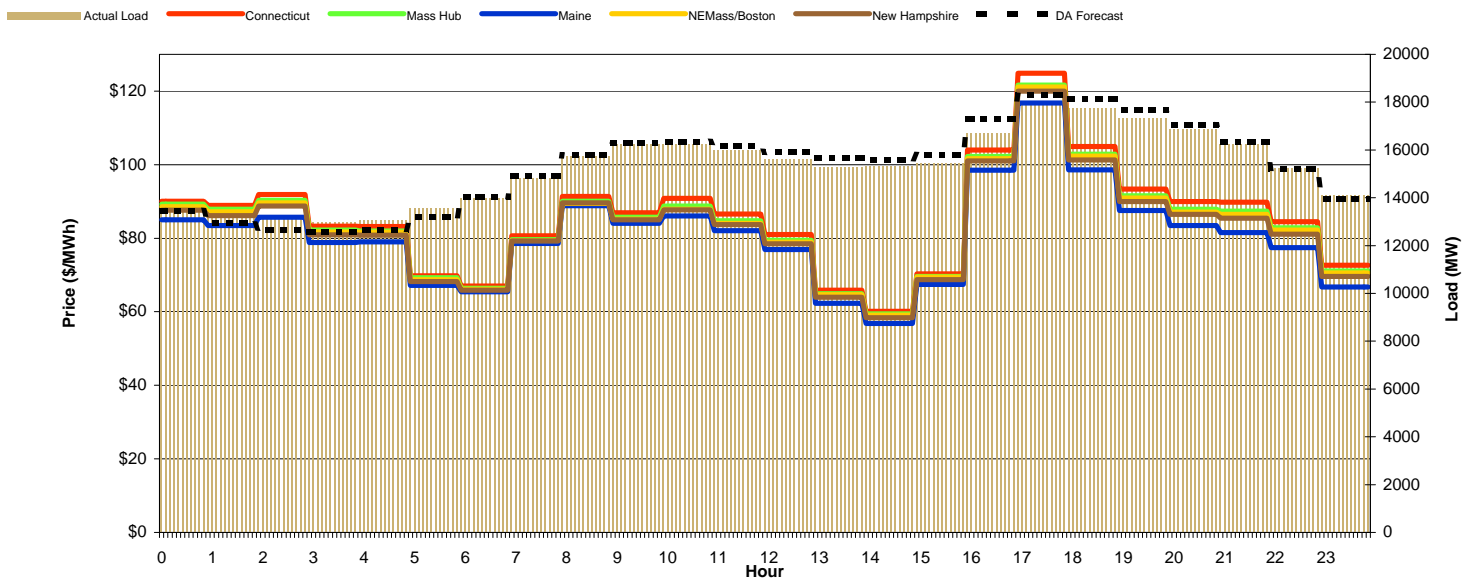




ISO-NE Daily Report

Sunday December 19, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	76.93	75.66	66.00	69.55	70.31	73.86	66.35	77.18	84.15	84.67	86.11	85.97	86.25	85.68	83.56	83.31	110.79	123.69	120.00	117.94	103.66	93.98	83.97	79.30	87.04	94.43	All	On Pk
NEMass/Boston	75.02	73.79	64.96	67.92	68.67	72.51	65.43	75.25	81.85	82.12	83.36	83.59	83.32	82.88	81.11	81.09	106.99	118.66	115.16	112.50	98.75	89.78	80.71	76.72	84.26	91.07		
New Hampshire	74.11	72.83	64.15	67.08	67.84	71.73	64.74	75.09	82.06	82.37	83.65	83.77	83.56	83.05	81.06	81.09	107.37	118.96	115.22	112.25	99.02	89.55	80.15	75.58	84.01	91.14		
Maine	71.45	70.08	61.62	64.22	65.00	69.60	63.47	73.54	80.94	80.99	81.95	81.96	81.64	81.52	79.41	79.49	105.81	116.43	111.97	108.59	95.39	84.79	76.72	72.28	81.62	88.82		
Mass Hub	75.92	74.75	65.74	68.83	69.56	73.27	65.84	75.26	81.64	81.93	83.26	83.39	83.41	82.88	80.96	80.94	106.89	117.98	114.51	112.54	98.88	90.03	80.60	77.30	84.43	90.94		
Cleared Load (GW)	12.6	12.0	12.2	11.9	11.9	12.2	12.2	12.7	13.4	14.0	14.2	14.1	14.1	13.9	13.8	14.0	15.0	16.1	16.1	15.5	15.5	14.5	13.2	12.4				

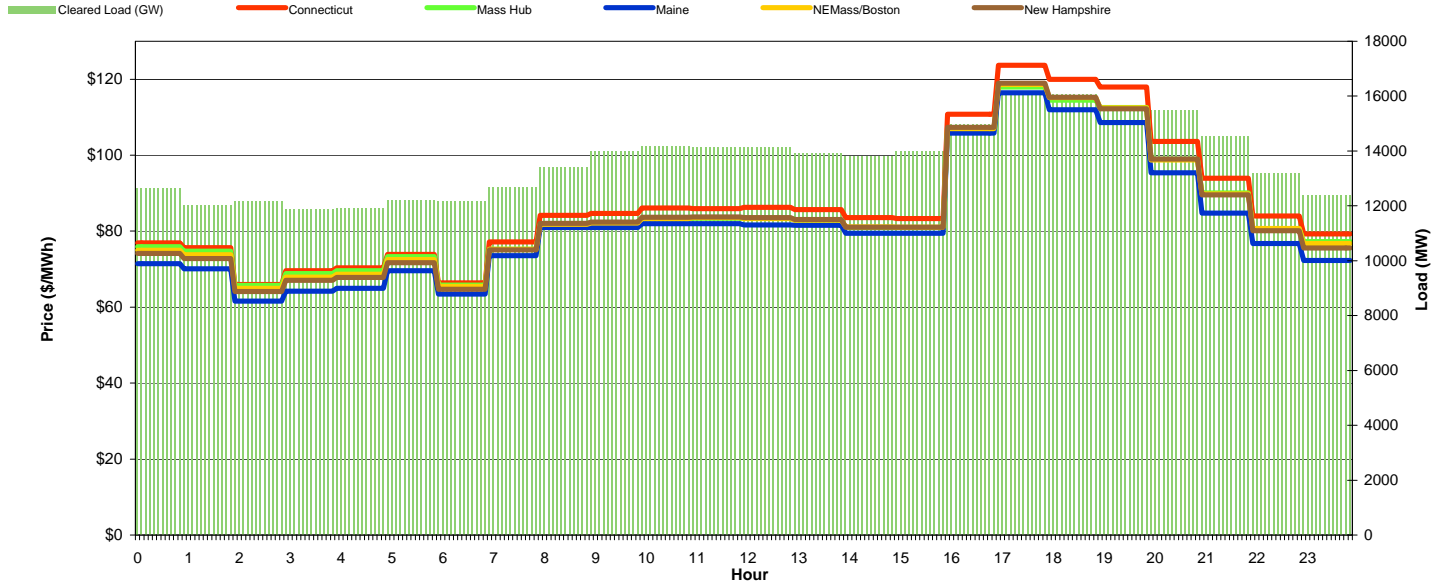

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	55.40	52.07	40.70	42.85	47.30	55.67	53.80	63.39	85.10	85.08	89.46	88.76	86.93	85.70	82.83	76.15	100.95	105.26	107.88	107.87	94.54	90.68	90.35	80.99	77.90	90.06	All	On Pk
NEMass/Boston	54.23	50.92	39.93	41.93	46.39	54.82	53.33	62.62	83.67	83.57	87.06	86.37	84.82	83.52	80.83	74.74	97.78	101.97	104.44	104.17	91.29	87.74	88.37	78.65	75.97	87.69		
New Hampshire	53.37	50.12	39.31	41.30	45.74	54.21	52.86	62.30	83.68	83.53	86.88	86.02	84.41	83.03	80.19	73.94	97.05	101.03	103.36	102.90	90.25	86.86	87.14	77.56	75.29	87.04		
Maine	51.19	47.88	37.56	39.51	43.86	52.71	52.00	61.51	83.00	82.60	85.11	83.83	82.25	80.78	77.96	72.03	94.10	98.19	100.47	99.52	86.75	83.00	83.21	74.19	73.05	84.64		
Mass Hub	54.55	51.30	40.35	42.39	46.86	55.31	53.63	62.86	84.08	84.01	87.75	87.06	85.43	84.10	81.31	74.98	98.36	102.31	104.83	104.68	91.80	88.49	88.96	79.26	76.44	88.19		
DA Forecast Load (GW)	12.95	12.38	12.08	11.97	12.02	12.38	13.01	13.64	14.51	15.22	15.46	15.54	15.53	15.45	15.44	15.78	17.35	18.54	18.41	18.03	17.41	16.37	14.92	13.53				
Forecast Error %	5.0%	8.6%	11.0%	11.2%	11.1%	8.5%	4.3%	1.5%	1.8%	1.7%	2.0%	2.1%	2.2%	2.1%	1.8%	1.0%	0.1%	0.0%	0.5%	0.9%	1.4%	1.8%	2.9%	3.1%				

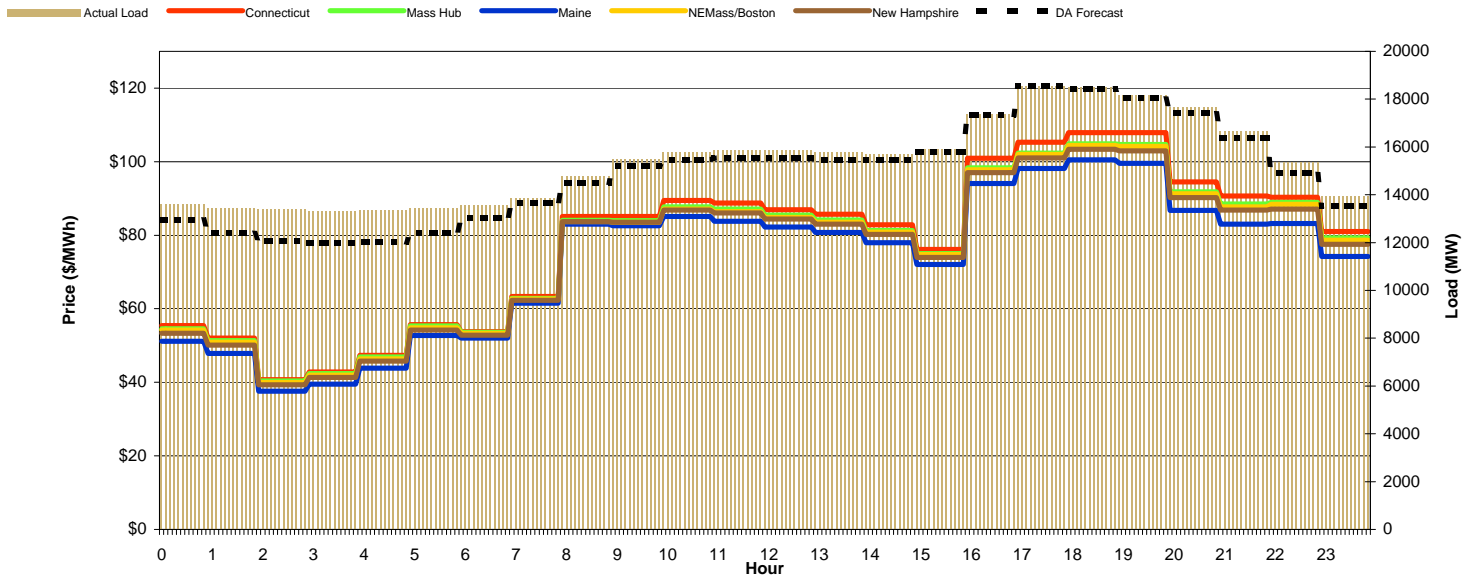




ISO-NE Daily Report

Monday December 20, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	55.19	54.36	53.33	50.28	54.31	55.92	88.54	93.61	95.95	95.89	93.82	89.24	88.00	85.99	85.72	86.12	96.43	125.00	122.67	109.61	96.75	90.00	89.63	85.40	85.07	96.53	All	On Pk
NEMass/Boston	53.59	53.00	51.98	49.08	53.03	54.67	86.88	89.37	91.37	91.43	89.78	85.73	84.49	83.05	82.77	83.21	92.51	119.75	117.15	104.26	92.12	86.78	86.26	82.72	81.87	92.50		
New Hampshire	53.13	52.66	51.62	48.83	52.75	54.43	87.01	89.38	91.13	91.18	89.51	85.36	83.94	82.60	82.33	82.73	92.17	119.10	116.46	103.45	91.56	87.27	86.43	82.06	81.55	92.16		
Maine	51.57	51.22	50.02	47.45	51.20	52.95	84.85	87.41	88.86	89.18	87.40	83.38	81.58	80.78	80.58	80.89	91.22	117.84	114.57	100.68	89.20	84.17	82.98	78.81	79.53	90.05		
Mass Hub	54.20	53.67	52.65	49.68	53.65	54.99	87.52	90.07	92.08	92.03	90.35	86.01	84.70	83.06	82.82	83.22	92.92	119.37	116.91	104.59	92.53	86.87	86.54	83.54	82.25	92.75		
Cleared Load (GW)	12.3	12.0	11.8	11.7	12.0	12.6	14.7	15.9	16.1	16.2	16.1	16.0	15.8	15.6	15.5	15.8	17.3	18.3	18.0	17.4	17.0	15.8	14.1	12.8				

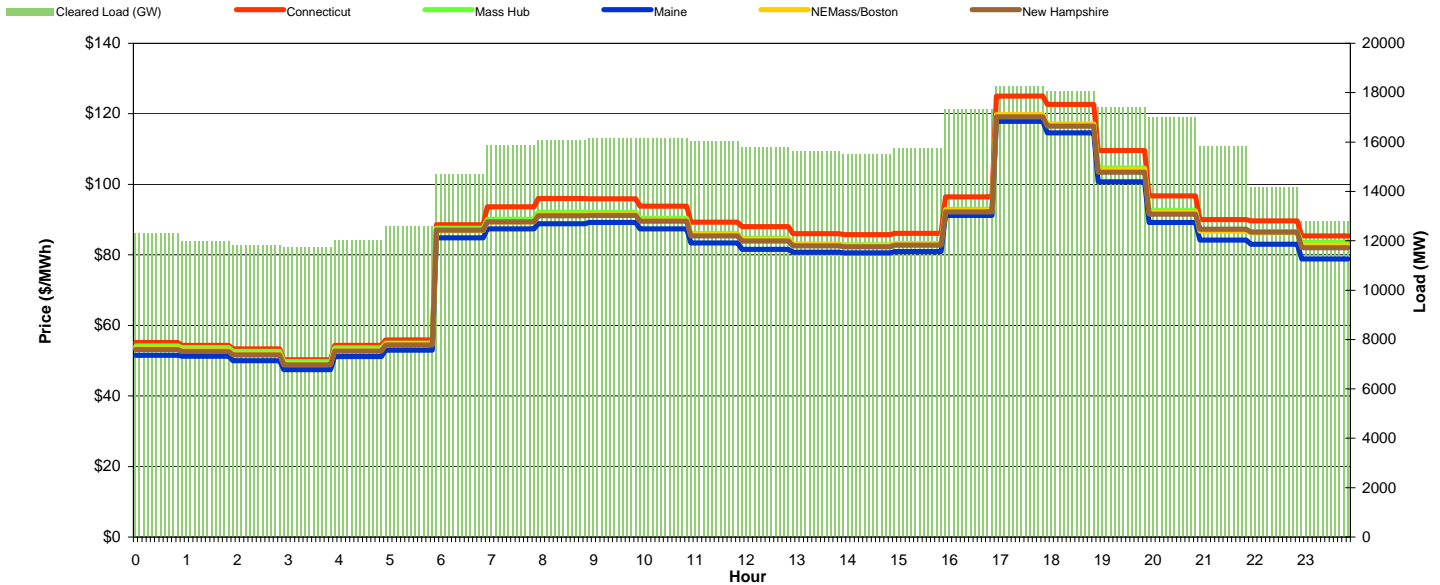

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	70.09	59.34	50.69	65.04	66.08	53.80	90.95	107.11	100.87	97.98	125.05	130.29	91.17	104.01	86.18	86.95	116.94	124.88	124.13	110.55	99.53	91.86	84.86	61.88	91.68	105.15	All	On Pk
NEMass/Boston	68.12	57.83	49.36	63.32	64.25	52.39	88.69	104.29	98.54	95.93	122.06	126.61	88.83	102.05	84.82	84.87	113.70	122.17	120.86	107.19	96.18	89.38	82.89	61.02	89.39	102.52		
New Hampshire	67.33	57.19	48.88	62.79	63.68	51.94	88.56	104.02	98.22	95.54	121.23	125.35	87.91	100.81	83.89	84.08	112.08	119.49	118.46	104.82	94.29	88.33	82.12	59.94	88.37	101.29		
Maine	65.27	55.61	47.64	61.41	62.36	51.02	87.97	102.79	97.41	94.93	119.14	121.95	85.04	96.00	82.32	82.61	107.30	115.05	114.37	100.31	90.27	84.24	78.44	56.88	85.85	98.26		
Mass Hub	68.90	58.50	49.97	64.12	65.09	53.07	89.30	104.93	98.86	96.29	122.71	127.50	89.51	102.59	85.18	85.44	114.21	122.34	121.26	107.63	96.86	90.00	83.45	61.27	89.96	103.05		
DA Forecast Load (GW)	12.63	12.19	12.02	12.06	12.47	13.68	15.71	17.14	17.63	17.72	17.70	17.71	17.53	17.40	17.32	17.57	19.09	20.01	19.84	19.45	18.82	17.70	16.07	14.53				
Forecast Error %	5.3%	6.8%	7.6%	6.7%	5.4%	4.3%	0.2%	0.3%	-0.7%	-0.6%	0.5%	0.9%	0.2%	0.6%	0.7%	0.9%	0.0%	1.3%	2.2%	2.3%	2.2%	2.1%	2.1%	1.8%				

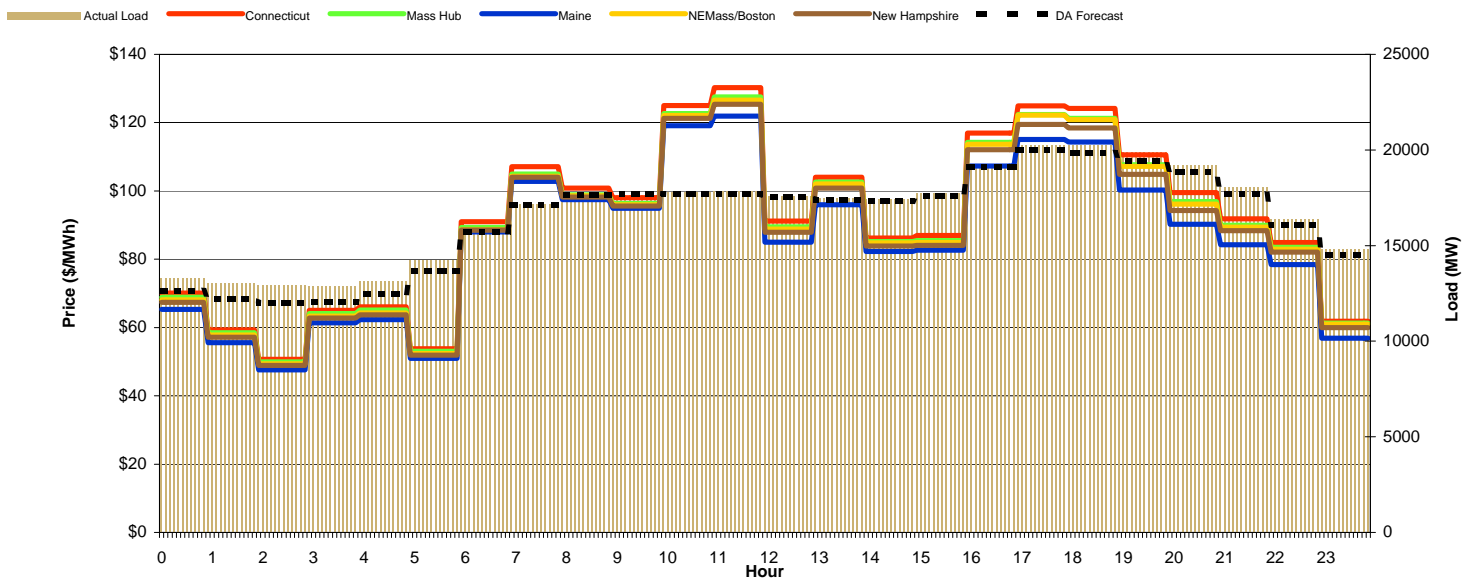




ISO-NE Daily Report

Tuesday December 21, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$				
Connecticut	75.18	71.57	69.96	69.50	72.17	72.19	81.68	113.88	104.11	99.13	95.96	90.05	87.16	83.95	82.67	84.98	113.34	129.63	127.24	118.44	99.77	89.56	87.80	76.86	76.86	91.53	100.48	All	On Pk
NEMass/Boston	74.91	71.49	69.81	69.38	72.36	72.73	80.21	108.32	98.38	93.92	91.11	85.80	83.32	80.99	79.87	81.83	108.34	121.61	114.42	111.69	93.85	85.00	84.53	75.03	87.87	87.87	95.19		
New Hampshire	73.91	70.62	69.07	68.63	71.65	71.74	79.91	107.81	97.77	93.37	90.56	85.42	82.67	80.20	79.04	81.27	107.44	120.66	113.31	110.78	93.31	84.38	83.76	73.39	87.11	87.11	94.48		
Maine	71.45	68.12	66.55	65.97	69.18	70.63	79.63	105.80	92.32	88.68	85.95	81.31	78.74	76.54	75.59	77.75	104.61	117.65	110.00	106.68	89.95	80.42	79.13	70.19	83.87	83.87	90.70		
Mass Hub	75.32	72.30	70.62	70.15	73.11	72.96	81.23	109.57	99.53	94.96	92.10	86.63	83.95	81.53	80.17	82.29	109.24	123.96	121.39	112.92	94.98	85.85	85.20	75.96	89.00	89.00	96.52		
Cleared Load (GW)	12.8	12.7	12.7	12.5	12.7	13.1	15.3	15.9	16.3	16.5	16.5	16.4	16.1	16.2	15.9	16.0	16.9	18.3	18.3	17.8	17.3	16.3	14.8	13.2					

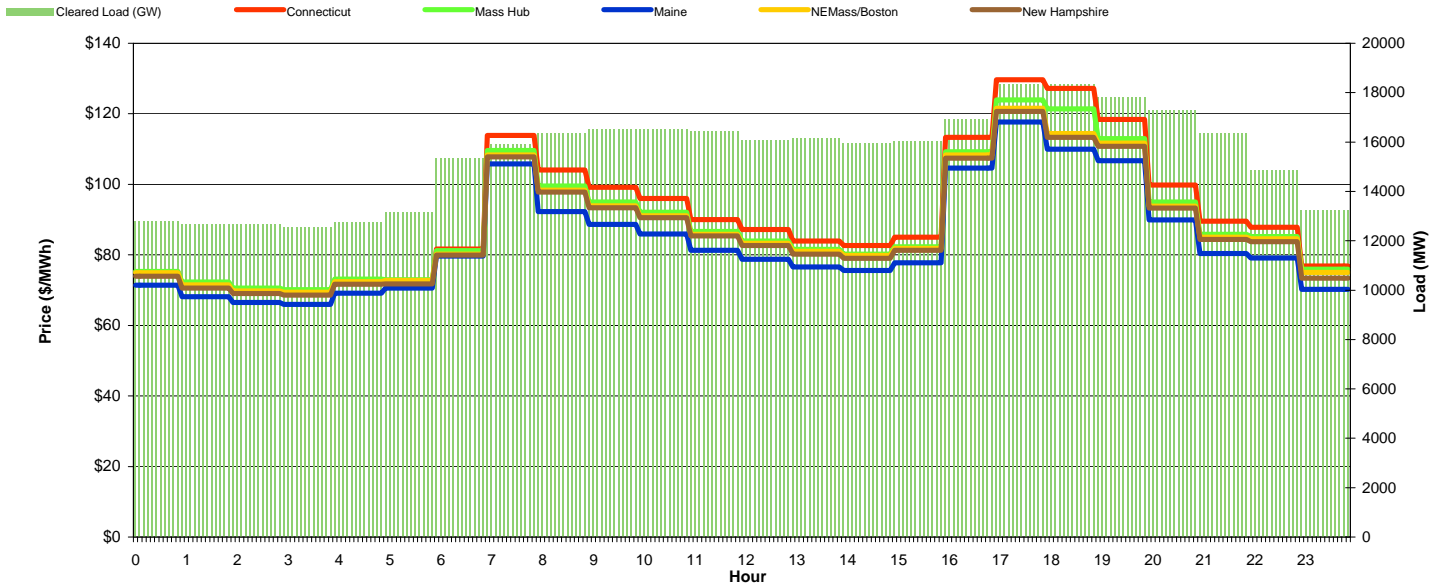

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	67.11	57.81	42.46	49.92	57.98	64.33	85.83	85.75	85.08	90.40	82.82	81.25	72.88	67.52	67.33	76.63	100.14	97.34	101.02	92.93	88.61	74.14	41.16	51.28	74.24	81.56	All	On Pk
NEMass/Boston	67.09	57.68	42.13	49.33	57.23	63.92	84.18	82.96	81.53	87.14	80.06	78.53	70.44	65.41	65.38	74.37	97.07	93.20	95.60	87.74	83.67	71.11	39.69	49.73	71.88	78.37		
New Hampshire	65.83	56.58	41.32	48.33	56.05	62.75	82.99	81.57	80.18	86.32	79.15	77.58	69.43	64.41	64.39	73.54	95.59	91.66	93.94	86.35	82.62	70.16	39.07	48.53	70.76	77.25		
Maine	62.87	53.92	39.14	45.82	53.35	61.30	81.36	79.39	76.97	84.68	77.64	75.61	66.60	61.41	61.61	71.36	91.77	87.99	89.58	82.14	78.56	66.94	37.22	45.70	68.04	74.34		
Mass Hub	67.43	58.09	42.52	49.87	57.92	64.38	84.78	83.64	82.55	88.08	80.82	79.36	71.13	66.00	65.92	74.99	97.94	93.94	96.60	89.08	85.03	71.95	40.10	50.13	72.59	79.20		
DA Forecast Load (GW)	13.61	13.03	12.80	12.75	13.15	14.30	16.50	17.79	17.96	17.91	17.82	17.59	17.40	17.27	17.22	17.47	18.96	20.10	19.86	19.40	18.74	17.59	15.97	14.35				
Forecast Error %	4.6%	5.9%	8.9%	9.0%	7.7%	1.0%	-3.3%	-2.5%	-2.0%	-1.3%	-1.5%	-1.4%	-1.8%	-1.9%	-2.6%	-3.3%	-4.1%	-3.0%	-1.8%	-1.3%	-0.9%	-0.6%	-0.5%	0.1%				

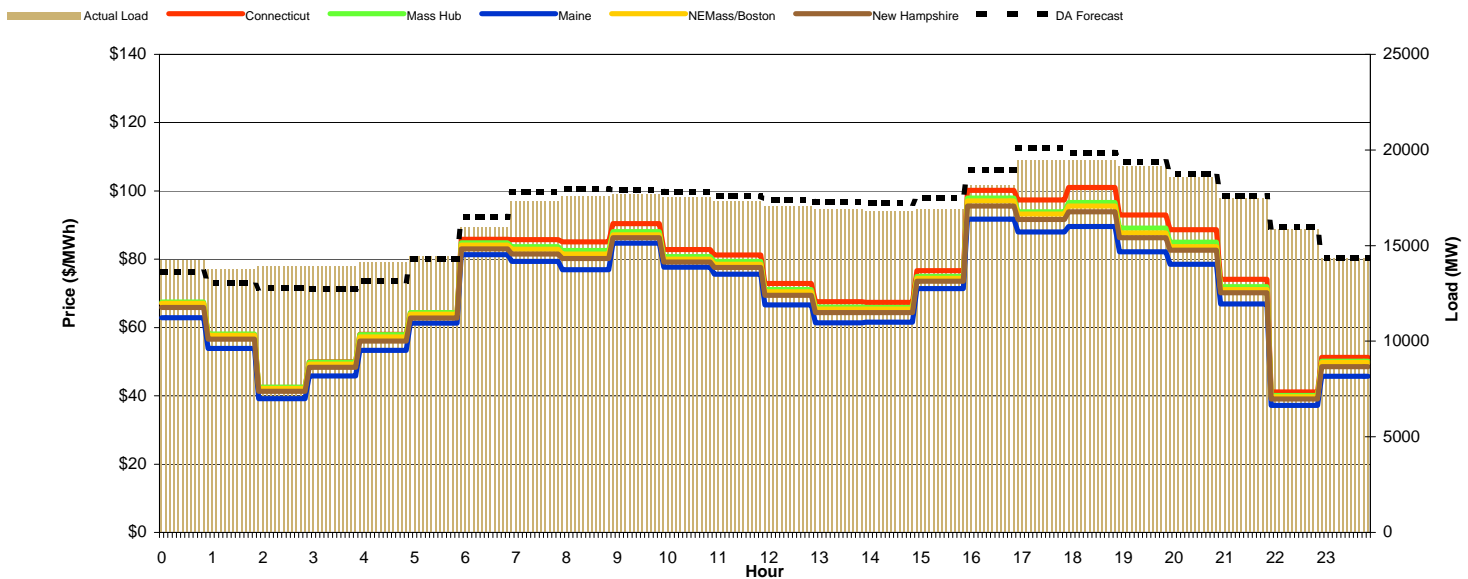




ISO-NE Daily Report

Wednesday December 22, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	58.32	53.48	53.60	53.60	54.18	58.69	62.90	71.13	73.14	70.95	70.44	68.55	66.28	65.30	65.00	65.19	73.98	99.00	97.17	82.36	73.85	70.00	67.80	59.71	68.11	73.76	All	On Pk
NEMass/Boston	56.88	52.37	52.26	52.79	53.38	57.70	61.57	66.70	66.56	64.87	64.46	63.47	62.72	62.17	62.03	62.23	65.60	88.05	86.85	69.24	64.67	64.39	63.95	58.32	63.47	67.37	68.11	73.76
New Hampshire	56.14	51.75	51.62	52.32	52.98	56.98	61.45	66.51	66.32	64.67	64.21	63.08	62.14	61.68	61.51	61.76	65.33	87.77	86.56	69.11	64.66	64.20	63.61	57.70	63.09	67.07	68.11	73.76
Maine	54.73	50.40	50.16	50.60	51.34	55.36	60.22	64.50	64.28	62.73	62.05	60.76	59.65	59.31	59.21	59.66	63.67	84.55	83.27	67.16	62.48	61.65	62.12	56.71	61.11	64.82	68.11	73.76
Mass Hub	57.60	53.27	53.25	53.59	54.16	58.31	62.34	67.70	67.31	65.62	65.14	64.13	63.41	62.71	62.53	62.72	66.09	88.83	87.55	69.38	65.20	65.22	64.70	58.86	64.15	68.02	68.11	73.76
Cleared Load (GW)	12.9	12.5	12.2	12.1	12.7	13.1	15.1	16.4	16.5	16.5	16.5	16.3	16.1	16.0	15.9	16.0	17.3	18.4	18.4	17.9	17.3	16.1	14.4	13.2				

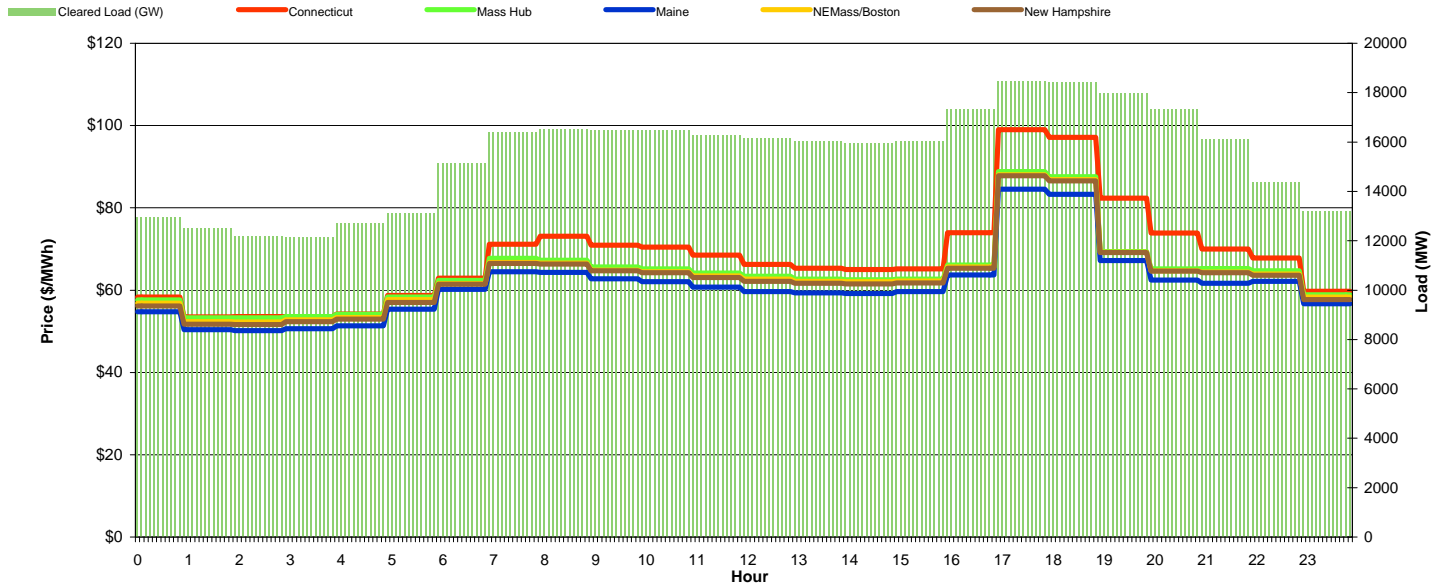

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	56.38	65.96	54.85	47.22	46.48	52.62	65.12	67.26	65.82	65.73	67.42	65.64	63.73	60.04	51.70	55.78	82.04	105.09	104.23	77.18	74.52	70.08	82.71	70.45	67.42	72.44	All	On Pk
NEMass/Boston	54.78	63.95	53.29	45.89	45.43	51.17	62.77	63.98	62.66	62.47	63.70	62.40	61.08	57.61	49.74	53.99	75.97	96.84	92.93	69.01	66.39	62.96	79.16	68.89	63.63	67.56	68.89	72.44
New Hampshire	53.53	62.59	52.31	45.16	44.68	50.34	62.20	63.23	61.91	61.74	62.97	61.56	60.32	56.83	49.09	53.29	74.76	94.95	91.09	67.70	65.25	62.05	78.02	67.54	62.63	66.55	68.89	72.44
Maine	50.86	60.15	50.42	43.67	42.98	48.38	60.18	60.63	59.32	59.30	60.17	58.69	57.65	54.09	46.82	51.17	71.22	89.03	85.23	63.66	61.42	58.33	76.08	66.51	59.83	63.30	68.89	72.44
Mass Hub	55.52	65.04	54.18	46.69	46.19	51.86	63.71	65.13	63.71	63.48	64.85	63.36	61.84	58.30	50.27	54.50	76.64	97.79	93.27	69.41	66.78	63.20	79.99	69.17	64.37	68.28	68.89	72.44
DA Forecast Load (GW)	13.17	12.61	12.34	12.26	12.66	13.77	15.84	17.03	17.20	17.27	17.28	17.12	16.89	16.81	16.77	17.01	18.37	19.50	19.34	18.93	18.35	17.23	15.67	14.07				
Forecast Error %	4.2%	4.8%	4.6%	6.7%	6.0%	1.6%	-1.7%	-1.7%	-0.8%	-1.0%	-1.2%	-0.6%	-0.7%	-0.4%	-0.5%	-0.6%	-0.3%	-0.2%	0.4%	0.6%	1.0%	1.4%	1.6%	1.3%				

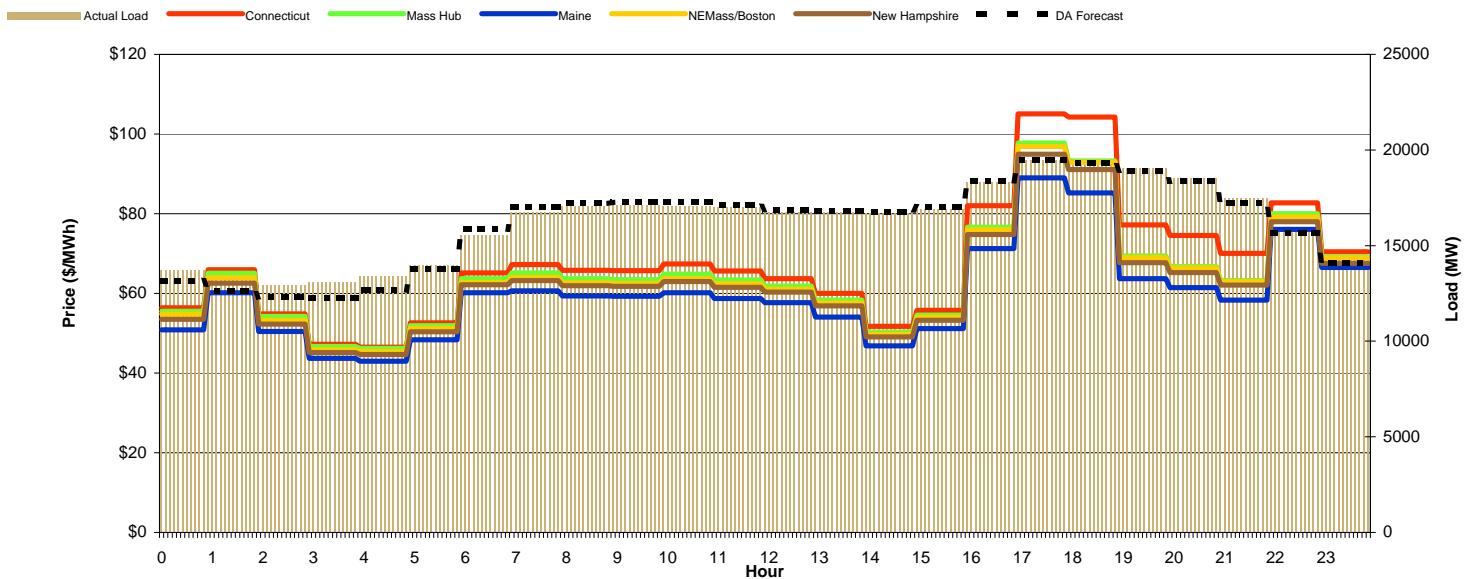




ISO-NE Daily Report

Thursday December 23, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	49.93	49.22	44.53	43.71	44.59	49.11	53.95	59.65	59.30	60.76	59.99	58.66	55.00	54.20	52.89	55.00	59.55	87.58	74.36	66.78	61.73	58.64	55.89	50.54	56.90	61.25	All	On Pk
NEMass/Boston	49.08	48.99	44.55	43.79	44.80	49.09	52.53	55.91	55.01	55.81	54.92	54.38	52.85	52.00	50.83	52.63	54.00	69.53	63.91	58.55	54.95	54.96	53.42	49.09	53.15	55.85		
New Hampshire	48.75	48.56	44.13	43.38	44.42	48.57	52.34	55.67	54.81	55.77	54.91	54.45	52.73	51.87	50.62	52.56	54.03	68.88	63.46	58.27	54.94	55.06	53.24	48.52	52.91	55.70		
Maine	48.67	48.43	43.98	43.23	44.36	48.60	51.71	53.95	52.44	53.23	52.47	52.05	50.46	49.73	48.67	50.70	52.45	66.55	61.43	56.46	53.17	53.29	52.14	47.44	51.48	53.70		
Mass Hub	49.66	49.35	44.80	43.99	44.96	49.37	53.14	56.62	55.61	56.48	55.58	55.09	53.49	52.67	51.49	53.30	54.63	69.16	64.35	59.11	55.58	56.05	54.28	49.69	53.69	56.47		
Cleared Load (GW)	12.0	11.6	11.4	11.4	11.6	12.5	14.6	15.9	16.2	16.0	16.0	15.9	15.8	15.6	15.6	15.6	17.1	18.0	18.1	17.6	16.8	15.6	14.2	12.8				

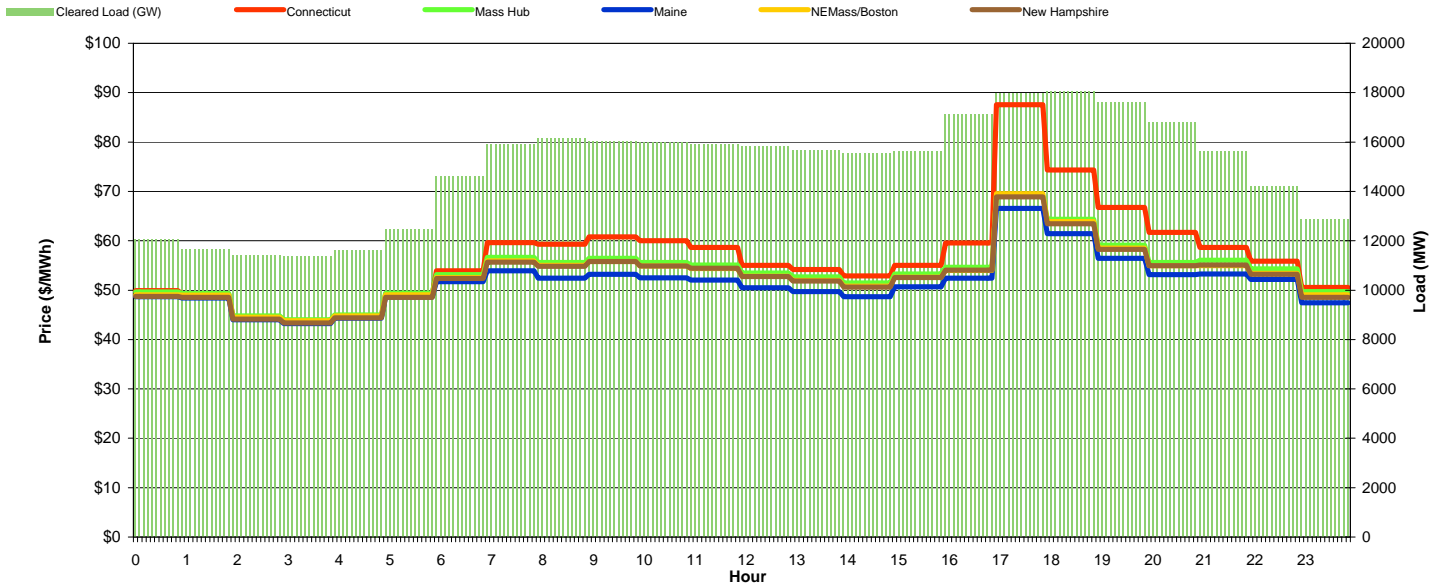

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	48.97	47.90	43.24	42.47	41.87	34.14	43.38	51.84	51.64	52.97	54.75	54.61	51.42	50.23	49.15	48.90	60.40	73.47	76.10	63.21	63.22	67.33	71.78	49.90	53.87	58.81	All	On Pk
NEMass/Boston	48.59	47.64	42.86	42.04	41.49	33.65	41.96	49.31	48.98	50.06	51.50	51.30	49.08	48.10	47.10	46.91	57.12	67.65	68.50	55.79	55.79	61.45	69.05	48.58	51.02	54.86		
New Hampshire	47.83	46.90	42.27	41.48	40.90	33.13	41.44	48.61	48.38	49.56	50.98	50.79	48.46	47.50	46.49	46.40	56.62	66.73	67.55	55.13	55.23	60.83	67.88	47.64	50.36	54.20		
Maine	47.65	46.63	41.96	41.28	40.62	32.55	40.44	46.79	46.53	47.55	48.73	48.50	46.32	45.42	44.57	44.95	54.75	63.78	64.41	52.70	52.86	58.56	66.00	46.47	48.75	52.03		
Mass Hub	48.71	47.76	43.06	42.25	41.71	33.86	42.37	50.01	49.68	50.83	52.36	52.17	49.70	48.65	47.59	47.36	57.76	68.25	68.90	55.80	55.81	61.74	69.64	48.92	51.45	55.39		
DA Forecast Load (GW)	13.08	12.49	12.23	12.21	12.53	13.64	15.64	16.92	17.27	17.33	17.27	17.10	16.86	16.75	16.66	16.82	18.09	19.10	18.89	18.60	18.07	17.11	15.69	14.24				
Forecast Error %	0.5%	1.3%	2.9%	3.1%	3.0%	0.2%	-3.3%	-3.3%	-1.8%	-0.6%	0.0%	0.4%	-0.2%	-0.7%	-1.1%	-1.6%	-1.0%	0.3%	0.6%	-0.3%	-0.6%	-0.4%	0.2%	-0.1%				

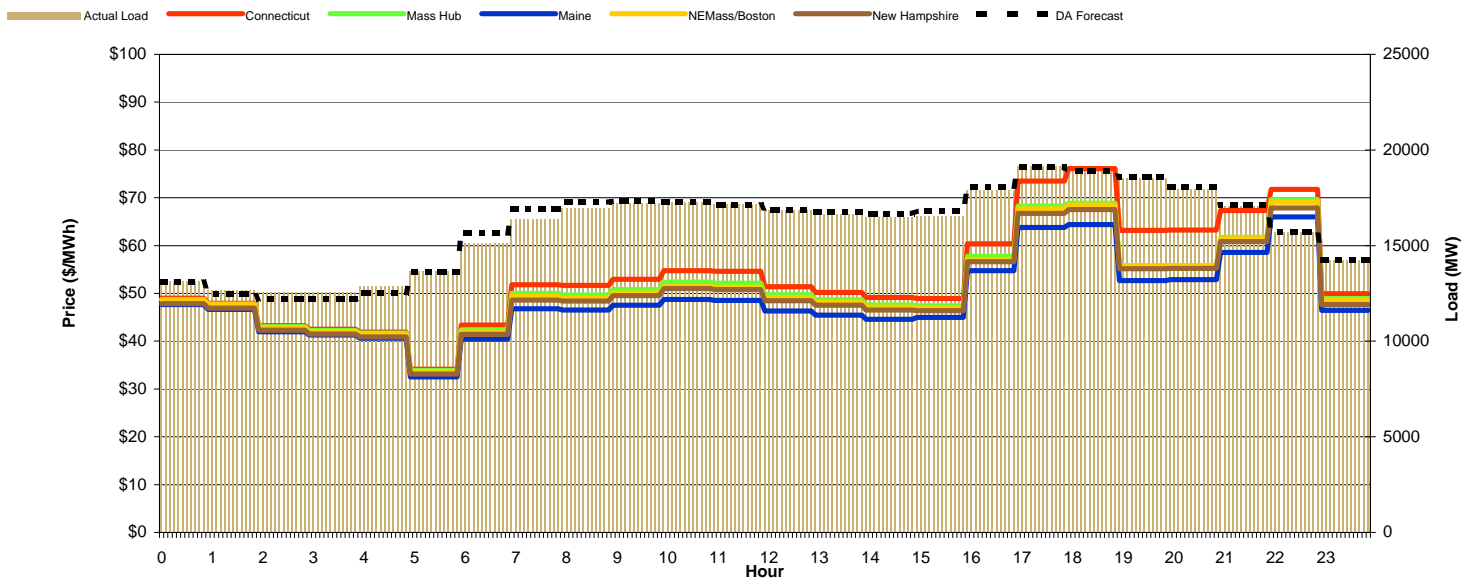




ISO-NE Daily Report

Friday December 24, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	52.00	49.20	49.26	48.50	49.20	50.12	55.31	58.68	59.80	65.19	58.25	57.64	55.43	54.48	54.63	53.13	60.26	79.14	73.52	61.52	58.98	58.90	58.00	52.66	57.24	60.47	All	On Pk
NEMass/Boston	51.26	49.05	48.98	48.17	49.00	49.92	54.17	56.39	57.08	61.86	55.53	55.08	53.50	52.77	52.80	51.84	55.49	73.83	65.46	56.66	54.63	55.76	55.36	51.32	54.83	57.13		
New Hampshire	50.79	48.47	48.46	47.67	48.50	49.45	54.10	56.05	56.49	61.13	55.15	54.81	53.04	52.26	52.21	51.26	55.29	73.04	64.82	56.22	54.24	55.58	55.13	50.54	54.36	56.67		
Maine	49.87	47.54	47.39	46.58	47.44	48.49	53.07	53.98	53.67	57.77	52.77	52.46	50.64	49.85	49.81	49.19	53.07	68.74	61.24	53.56	51.79	53.01	53.22	49.04	52.26	54.05		
Mass Hub	51.58	49.14	49.20	48.41	49.16	49.99	54.61	56.99	57.93	62.84	56.28	55.80	54.02	53.26	53.24	52.12	55.89	74.79	65.99	57.27	55.20	56.55	56.09	51.75	55.34	57.77		
Cleared Load (GW)	12.0	11.5	11.4	11.1	11.4	11.8	13.0	14.1	14.9	15.0	15.2	15.1	14.8	14.6	14.4	14.6	15.8	16.7	16.3	15.8	15.4	14.5	13.6	12.7				

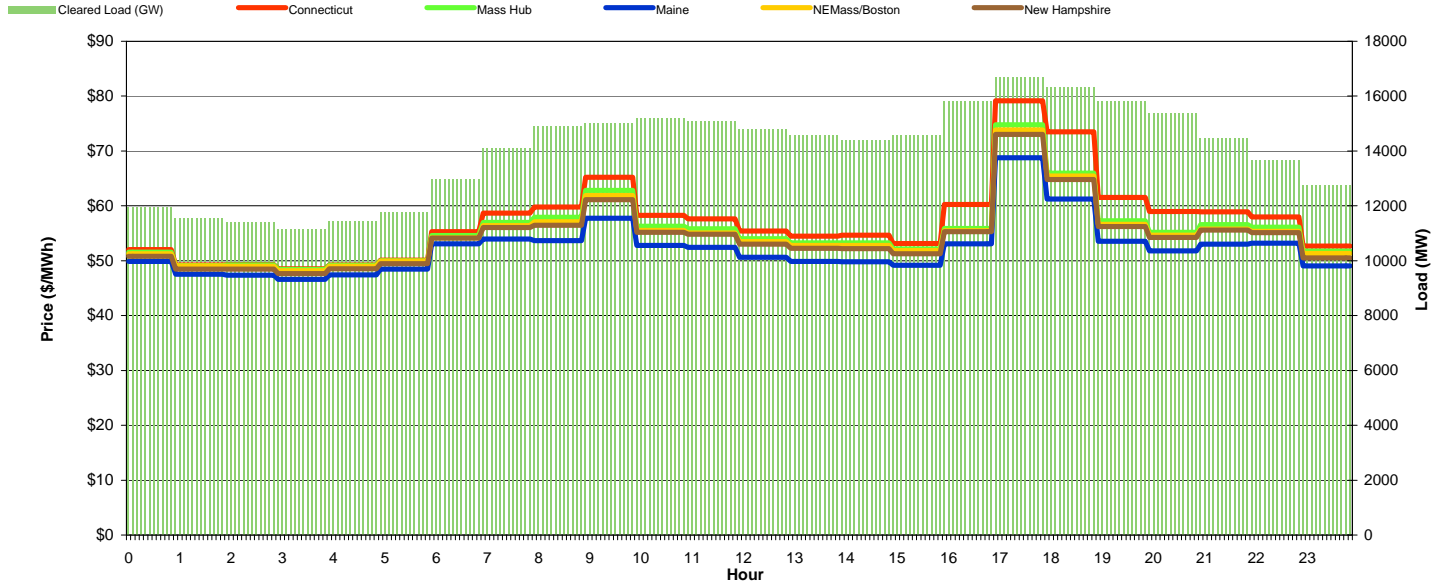

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	52.84	53.72	49.17	52.77	49.79	36.95	44.25	49.60	55.71	58.80	54.97	54.71	54.66	52.83	47.02	43.27	47.72	58.97	48.49	48.64	47.80	56.23	58.92	55.92	51.41	52.40	All	On Pk
NEMass/Boston	52.04	53.01	48.48	52.13	49.11	36.17	43.18	48.05	53.33	55.90	52.46	52.49	52.71	51.33	45.82	42.14	46.11	56.38	46.81	46.66	45.90	53.79	56.27	54.04	49.76	50.38		
New Hampshire	51.28	52.18	47.76	51.37	48.42	35.71	42.63	47.31	52.62	55.31	51.83	51.87	52.03	50.63	45.20	41.64	45.56	55.64	46.06	45.96	45.37	53.12	55.49	53.28	49.09	49.73		
Maine	49.85	50.65	46.24	49.78	46.96	34.62	41.18	45.31	50.06	52.42	49.15	49.16	49.32	48.27	43.11	39.72	43.13	52.27	43.40	43.47	43.26	49.65	51.96	50.97	46.83	47.10		
Mass Hub	52.22	53.23	48.75	52.39	49.36	36.44	43.47	48.46	54.01	56.77	53.14	53.07	53.24	51.72	46.12	42.39	46.46	57.03	47.17	47.09	46.31	54.42	57.10	54.61	50.21	50.91		
DA Forecast Load (GW)	13.29	12.64	12.27	12.09	12.32	13.06	14.37	15.53	16.46	16.95	17.07	16.95	16.58	16.28	16.14	16.18	17.32	18.02	17.15	16.37	15.91	15.48	14.74	13.72				
Forecast Error %	-2.0%	-0.3%	1.9%	2.5%	1.8%	-1.3%	-5.7%	-7.5%	-6.7%	-5.7%	-5.3%	-5.3%	-4.9%	-4.8%	-4.7%	-4.3%	-3.4%	-2.0%	-0.6%	-0.2%	0.3%	0.8%	2.0%	2.6%				

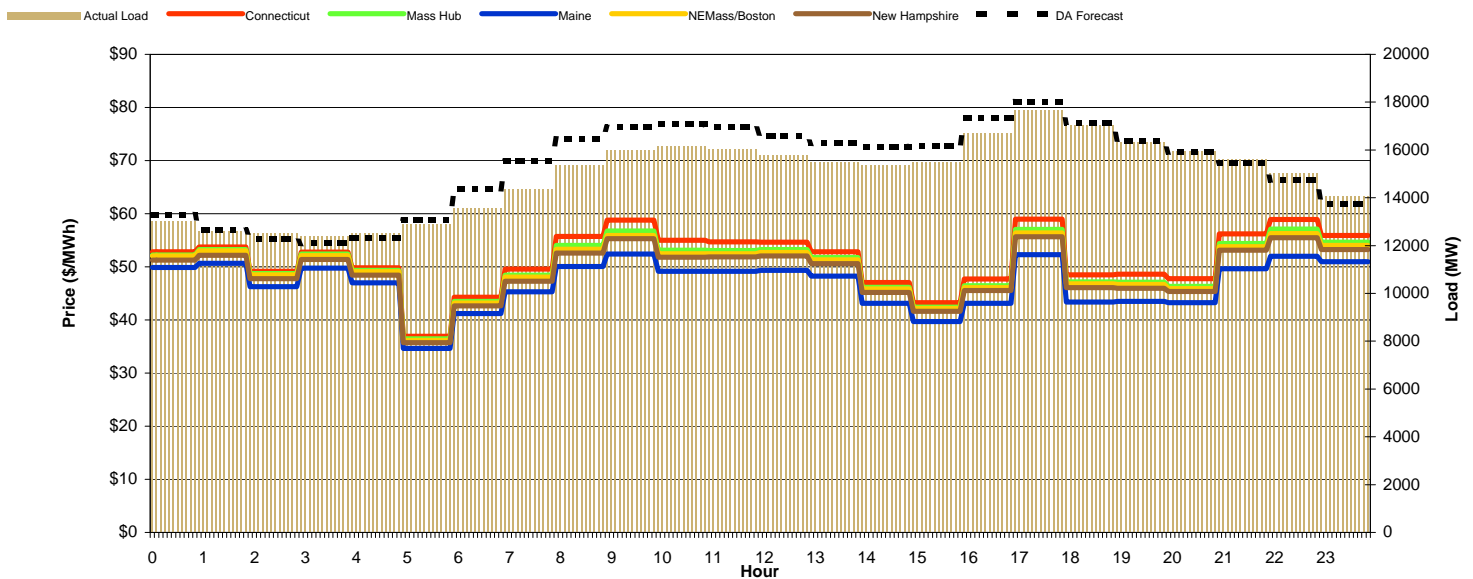




ISO-NE Daily Report

Saturday December 25, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	52.07	49.36	48.76	48.16	45.86	48.36	46.53	49.24	53.92	58.66	58.18	54.53	52.42	52.14	49.78	49.62	52.35	62.23	60.20	56.87	55.07	56.85	57.27	53.70	53.01	54.96	All	On Pk
NEMass/Boston	51.12	48.94	48.48	48.19	45.83	48.37	46.57	49.05	52.75	56.90	56.41	53.03	51.39	51.16	49.10	49.07	51.35	59.96	57.91	54.91	53.40	54.86	55.38	52.22	51.93	53.54		
New Hampshire	51.01	48.80	48.39	47.99	45.63	48.11	46.20	48.89	52.96	56.91	56.48	53.16	51.39	51.14	49.02	48.96	51.63	60.45	58.29	55.16	53.61	54.85	55.13	52.18	51.93	53.63		
Maine	50.59	48.45	47.99	47.58	45.29	47.74	45.58	48.23	52.44	55.43	55.04	52.20	50.56	50.15	48.15	47.98	51.36	59.55	57.05	54.13	52.55	52.82	52.88	51.81	51.06	52.53		
Mass Hub	51.46	49.18	48.83	48.43	45.98	48.52	46.65	49.06	53.17	57.51	57.00	53.49	51.67	51.37	49.20	49.23	51.55	60.53	58.45	55.39	53.79	55.38	55.94	52.82	52.28	53.92		
Cleared Load (GW)	11.9	11.5	11.1	11.2	10.9	11.1	11.6	12.6	13.6	14.2	14.2	14.2	14.0	13.7	13.3	13.5	14.7	15.5	15.5	15.3	14.9	14.2	13.4	12.3				

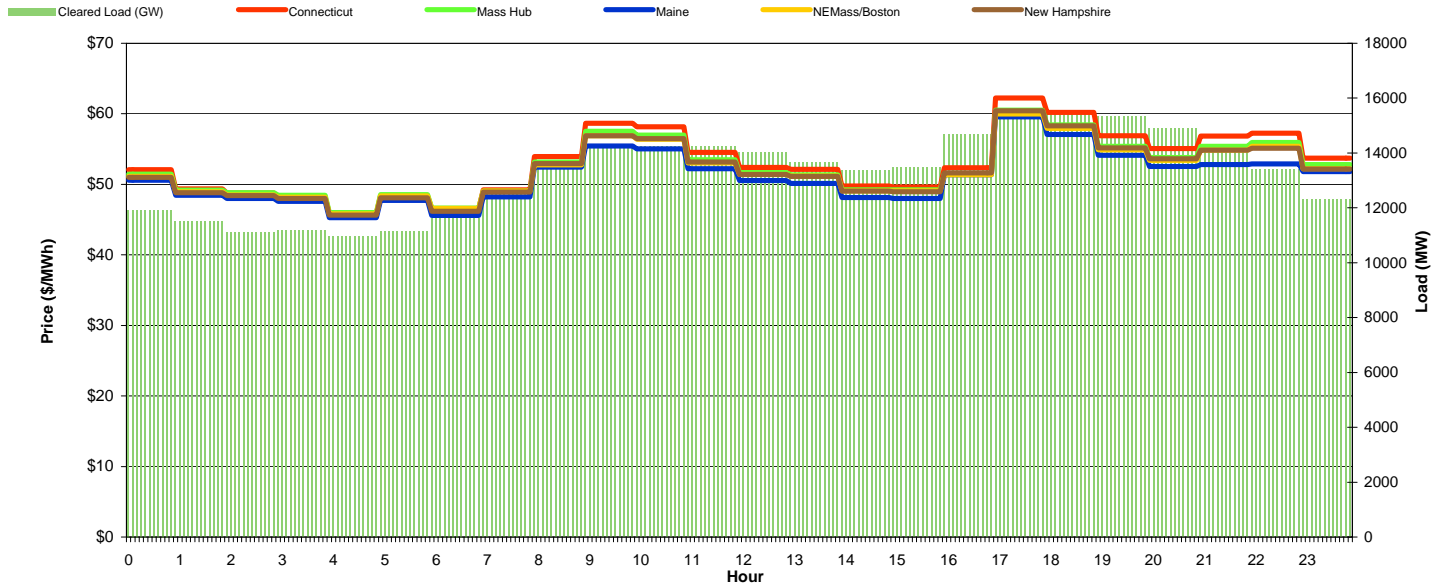

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	62.33	58.57	54.23	54.78	46.54	51.99	56.33	50.60	54.61	54.96	53.30	51.97	52.63	50.55	47.28	36.67	42.81	47.85	49.98	50.20	53.02	59.20	59.28	56.04	52.32	50.93	All	On Pk
NEMass/Boston	60.95	57.27	53.20	53.97	45.86	51.48	56.00	50.03	53.44	53.34	51.70	50.54	51.24	49.26	46.21	35.86	41.71	46.39	48.57	48.85	51.64	57.75	57.85	54.76	51.16	49.65		
New Hampshire	60.08	56.75	52.75	53.51	45.52	50.97	55.48	49.76	53.15	52.94	51.29	50.04	50.80	48.81	45.82	35.65	41.50	46.20	48.32	48.60	51.53	57.70	57.67	54.37	50.80	49.36		
Maine	58.57	55.67	51.68	52.56	44.81	49.86	54.49	48.83	51.64	51.55	49.93	48.75	49.72	47.64	44.89	35.08	40.81	45.62	47.59	47.97	51.19	56.87	57.01	53.55	49.85	48.44		
Mass Hub	61.29	57.68	53.52	54.25	46.08	51.66	56.05	50.17	53.78	53.86	52.18	50.89	51.60	49.57	46.47	36.02	41.90	46.69	48.87	49.15	51.96	58.10	58.27	55.15	51.47	49.97		
DA Forecast Load (GW)	12.79	12.10	11.76	11.65	11.76	12.17	12.87	13.63	14.47	14.98	15.14	15.11	14.93	14.53	14.11	14.09	15.03	15.81	15.83	15.75	15.59	15.13	14.16	13.08				
Forecast Error %	2.1%	4.7%	6.4%	6.3%	3.6%	2.2%	-0.1%	0.0%	0.4%	1.4%	2.1%	2.6%	2.6%	2.5%	2.2%	2.0%	1.5%	0.6%	0.6%	0.6%	0.6%	0.8%	2.0%	2.5%				

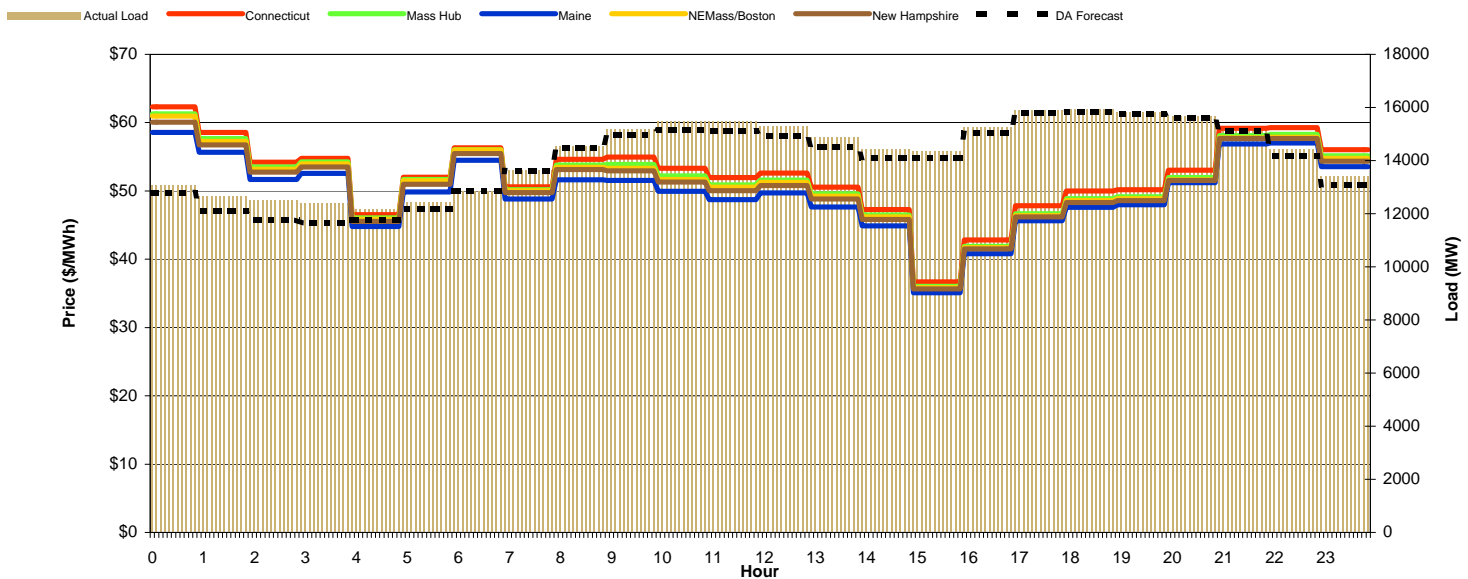




ISO-NE Daily Report

Sunday December 26, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$				
Connecticut	51.13	49.15	48.80	49.29	49.37	49.30	48.65	49.16	51.36	55.15	56.23	54.94	54.23	53.98	52.41	52.57	55.77	74.66	68.59	65.73	61.74	61.48	59.50	54.87	54.87	55.34	57.97	All	On Pk
NEMass/Boston	50.45	49.12	48.98	49.04	49.07	49.09	48.86	49.18	50.63	53.65	54.26	53.15	52.20	52.09	50.82	51.24	53.78	71.38	65.55	62.74	55.06	58.46	56.76	53.25	53.70	55.68			
New Hampshire	50.25	48.86	48.62	48.77	48.79	48.79	48.48	48.92	50.49	53.62	54.19	53.29	52.15	51.86	50.59	51.01	54.01	71.57	65.67	62.80	54.94	58.14	56.38	52.72	53.54	55.60			
Maine	50.17	48.81	48.50	48.69	48.64	48.74	48.02	48.49	49.62	52.62	52.76	52.56	50.82	50.45	49.33	49.91	53.20	70.02	64.18	61.10	53.29	55.58	54.11	51.52	52.55	54.25			
Mass Hub	50.74	49.22	49.11	49.19	49.23	49.19	48.94	49.06	50.79	54.12	54.82	53.59	52.73	52.50	51.14	51.45	54.24	72.03	66.12	63.38	55.08	59.19	57.49	53.84	54.05	56.11			
Cleared Load (GW)	12.0	11.5	11.2	11.0	11.1	11.1	11.8	12.6	13.5	14.2	14.3	14.3	14.3	14.1	13.9	14.2	15.6	16.7	16.7	16.5	16.0	14.8	13.8	12.7					

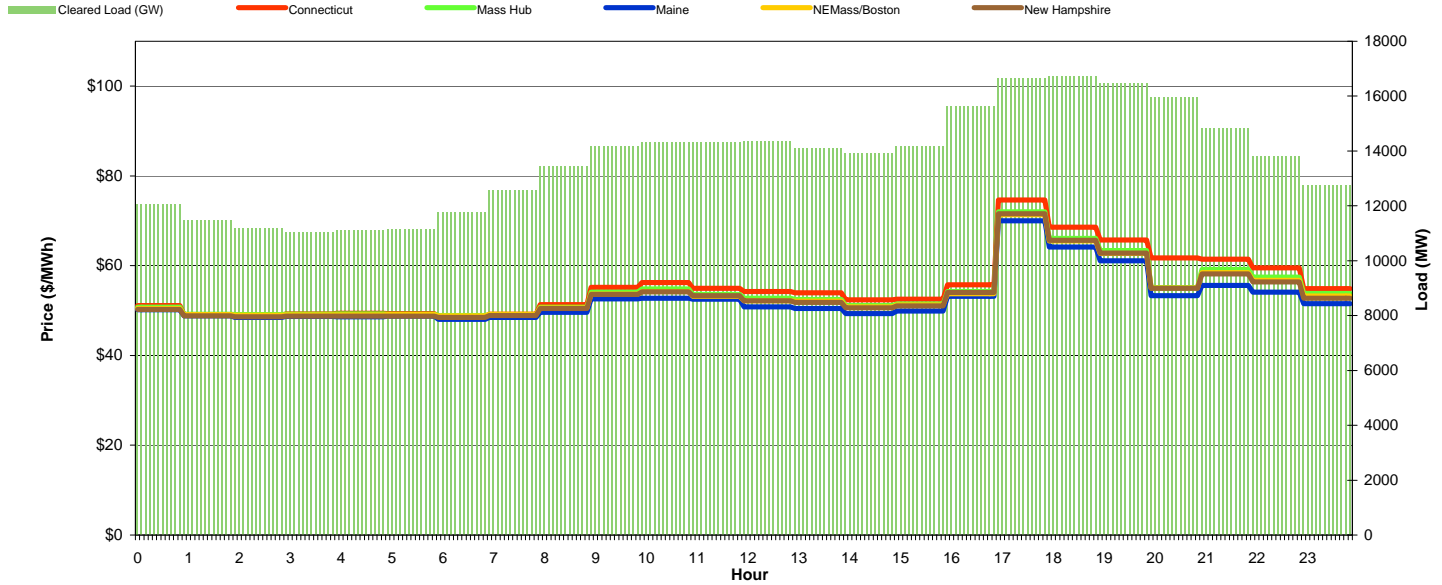

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	45.25	47.27	46.54	47.94	46.20	43.66	47.31	47.70	57.23	58.21	60.97	64.18	69.17	73.09	66.33	64.55	85.14	96.57	80.67	63.39	52.26	58.57	56.84	54.32	59.72	65.93	All	On Pk
NEMass/Boston	44.70	47.04	46.30	47.55	45.81	43.15	47.15	47.70	56.34	56.68	58.55	61.36	65.85	69.60	63.47	61.96	81.97	92.95	77.90	60.58	50.37	55.97	54.32	52.46	57.91	63.47		
New Hampshire	44.37	46.83	46.22	47.45	45.77	43.03	47.14	47.69	56.32	56.88	58.68	61.54	65.89	69.63	63.60	62.12	82.20	93.03	78.00	60.76	50.32	55.82	53.98	52.20	57.89	63.53		
Maine	44.04	46.95	46.34	47.73	46.24	42.81	47.05	47.78	56.07	56.35	57.67	60.54	64.80	68.18	62.59	61.34	81.51	91.58	76.52	59.74	49.25	53.79	52.05	51.67	57.19	62.49		
Mass Hub	44.87	47.20	46.47	47.75	45.98	43.35	47.27	47.71	56.53	57.12	59.25	62.15	66.78	70.56	64.24	62.60	82.49	93.43	78.32	61.11	50.75	56.62	55.01	52.98	58.36	64.04		
DA Forecast Load (GW)	12.61	12.07	11.81	11.73	11.78	12.11	12.69	13.50	14.36	15.15	15.54	15.79	15.84	15.73	15.67	16.01	17.43	18.71	18.57	18.15	17.47	16.45	15.15	13.81				
Forecast Error %	1.1%	3.6%	1.4%	1.4%	1.9%	2.0%	1.1%	-0.6%	0.6%	1.3%	2.1%	2.5%	3.7%	5.3%	6.0%	5.1%	4.0%	1.9%	2.0%	1.1%	0.5%	0.8%	1.7%	2.3%				

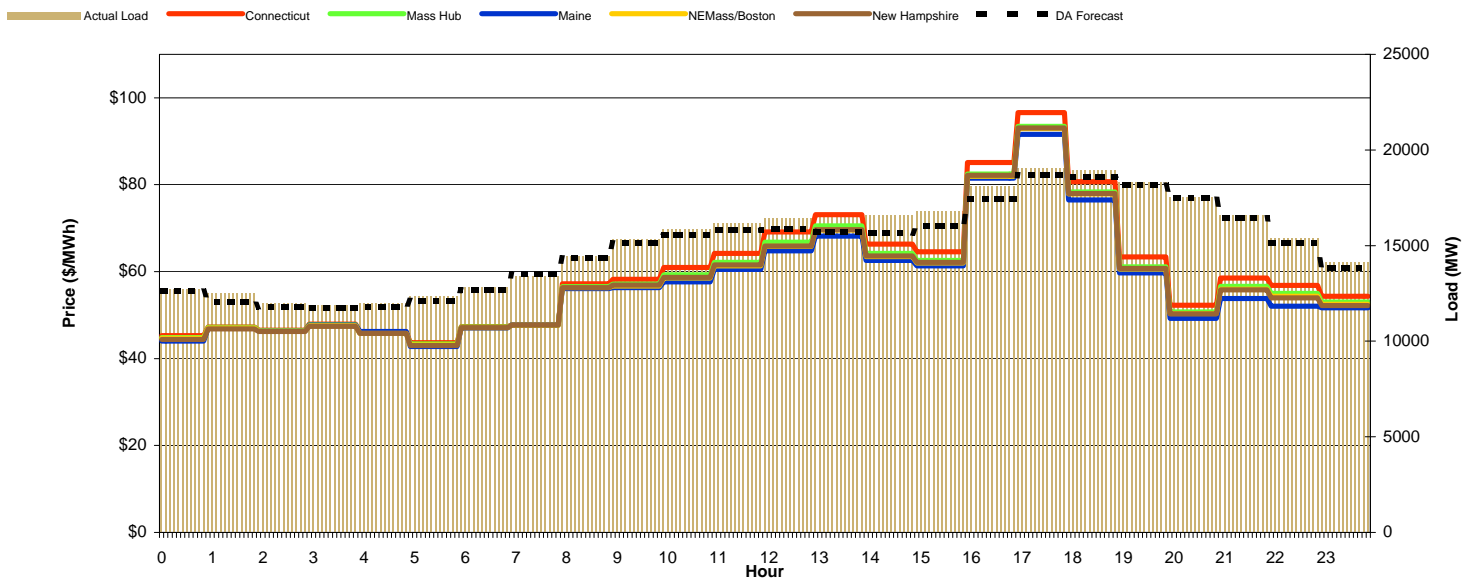




ISO-NE Daily Report

Monday December 27, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$				
Connecticut	54.21	51.63	49.81	49.74	50.16	61.37	56.87	68.99	77.25	76.68	78.13	77.43	75.89	74.32	71.83	74.41	79.84	93.05	90.13	84.22	78.31	77.12	70.60	63.46	63.46	70.23	78.01	All	On Pk
NEMass/Boston	53.22	50.87	49.05	49.02	49.42	60.43	55.97	66.26	73.49	72.84	73.96	73.24	72.04	70.77	68.49	70.84	75.71	88.41	85.67	80.19	74.03	72.53	66.97	61.56	67.29	74.09			
New Hampshire	52.58	50.36	48.60	48.55	49.00	60.01	55.29	65.72	72.98	72.20	73.32	72.51	71.39	70.05	67.81	70.12	74.76	87.10	84.51	79.14	73.25	71.48	65.75	60.80	66.55	73.26			
Maine	52.23	50.42	48.60	48.37	49.15	59.88	54.36	63.60	70.51	69.63	70.49	69.69	68.49	67.08	65.18	67.39	71.90	83.68	81.07	75.66	69.54	67.65	62.09	60.04	64.45	70.23			
Mass Hub	53.75	51.37	49.65	49.58	49.99	61.00	56.45	67.84	75.31	74.59	75.75	75.00	73.76	72.35	70.00	72.42	77.36	90.00	87.23	81.71	75.74	74.43	68.62	62.31	68.59	75.76			
Cleared Load (GW)	11.9	11.6	11.3	11.2	11.5	11.9	13.7	15.4	16.2	16.5	16.5	16.5	16.5	16.4	16.3	16.4	17.9	19.0	19.0	18.7	17.9	16.5	15.3	13.6					

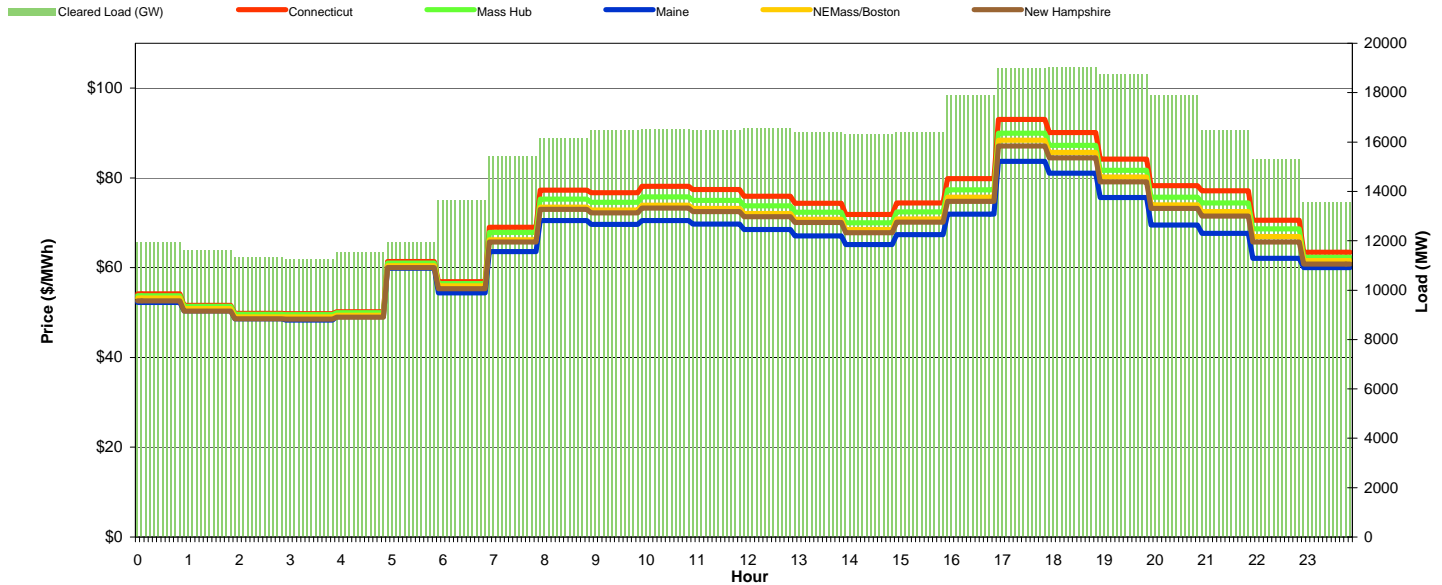

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	53.54	56.44	58.52	56.66	56.91	42.42	42.27	55.40	64.55	79.76	83.59	81.84	87.81	86.65	74.50	66.50	82.12	103.64	75.00	75.93	71.06	61.87	59.99	57.11	68.09	75.64	All	On Pk
NEMass/Boston	52.09	54.61	57.00	55.41	55.47	41.06	40.66	52.88	61.07	74.72	78.13	76.20	81.42	80.38	69.67	62.18	76.98	97.56	70.66	71.21	66.52	57.89	56.80	54.80	64.39	70.89		
New Hampshire	51.65	54.36	56.73	55.11	55.08	40.65	40.39	52.49	60.76	73.76	77.02	75.38	80.40	79.32	69.09	62.01	76.77	96.67	70.06	70.67	66.13	57.39	56.00	53.91	63.83	70.25		
Maine	51.04	54.10	56.88	55.45	55.31	39.94	39.33	50.86	58.53	69.67	72.32	70.82	75.33	74.67	65.88	59.72	74.00	92.42	67.27	67.65	62.88	53.89	52.92	51.80	61.36	66.80		
Mass Hub	52.62	55.39	57.68	56.01	56.12	41.57	41.16	53.61	62.06	76.14	79.60	77.73	83.20	82.16	71.04	63.35	78.18	98.71	71.50	72.21	67.61	58.92	57.66	55.38	65.40	72.11		
DA Forecast Load (GW)	12.93	12.42	12.25	12.31	12.57	13.44	14.81	15.87	16.80	17.57	17.89	17.94	17.86	17.85	17.65	17.81	19.20	20.52	20.43	20.01	19.22	18.08	16.51	14.97				
Forecast Error %	2.5%	5.1%	3.9%	2.6%	2.1%	0.1%	-2.9%	-5.7%	-6.2%	-5.5%	-3.7%	-1.9%	-0.9%	-1.7%	-1.5%	-2.3%	-2.2%	-1.6%	-2.2%	-3.0%	-2.6%	-2.5%	-1.6%	0.8%				

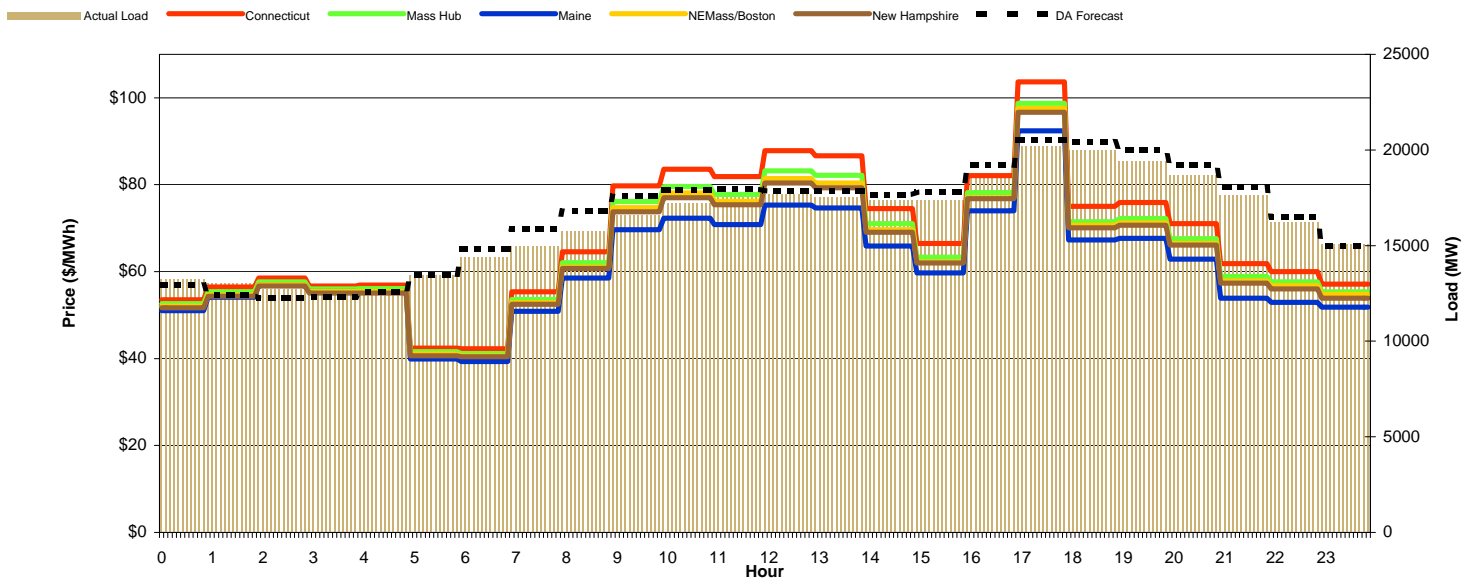




ISO-NE Daily Report

Tuesday December 28, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	79.67	84.54	84.04	82.32	81.96	80.70	84.85	91.45	94.03	95.00	91.70	90.54	88.55	87.90	86.10	85.69	97.50	100.99	106.91	99.45	100.31	96.55	88.02	85.00	90.16	93.79	All	On Pk
NEMass/Boston	78.70	83.11	82.57	81.10	81.13	80.00	83.19	88.12	89.92	90.47	87.50	86.46	84.62	84.59	83.08	82.96	93.16	97.02	102.60	95.26	95.34	91.85	84.63	83.45	87.12	89.85		
New Hampshire	78.02	82.19	81.72	80.48	80.46	79.09	83.21	88.13	89.72	90.22	87.11	86.16	83.97	83.79	82.43	82.47	92.74	96.46	102.06	94.78	95.30	91.78	84.30	81.87	86.60	89.46		
Maine	77.96	81.81	81.17	80.13	80.36	77.73	83.29	87.35	88.11	88.32	84.98	84.18	81.47	81.18	80.61	81.16	91.25	95.06	100.27	93.13	93.59	90.00	81.97	79.64	85.20	87.66		
Mass Hub	79.40	84.13	83.65	82.06	81.87	80.53	84.19	89.85	91.89	92.48	89.40	88.26	86.31	86.05	84.44	84.17	94.92	98.42	104.15	96.77	97.38	93.87	86.25	84.36	88.53	91.54		
Cleared Load (GW)	12.7	12.8	12.7	12.6	12.7	13.0	14.9	16.3	16.4	16.5	16.4	16.4	16.0	15.9	15.7	15.9	17.4	18.6	18.6	18.2	17.4	16.2	14.9	13.4				

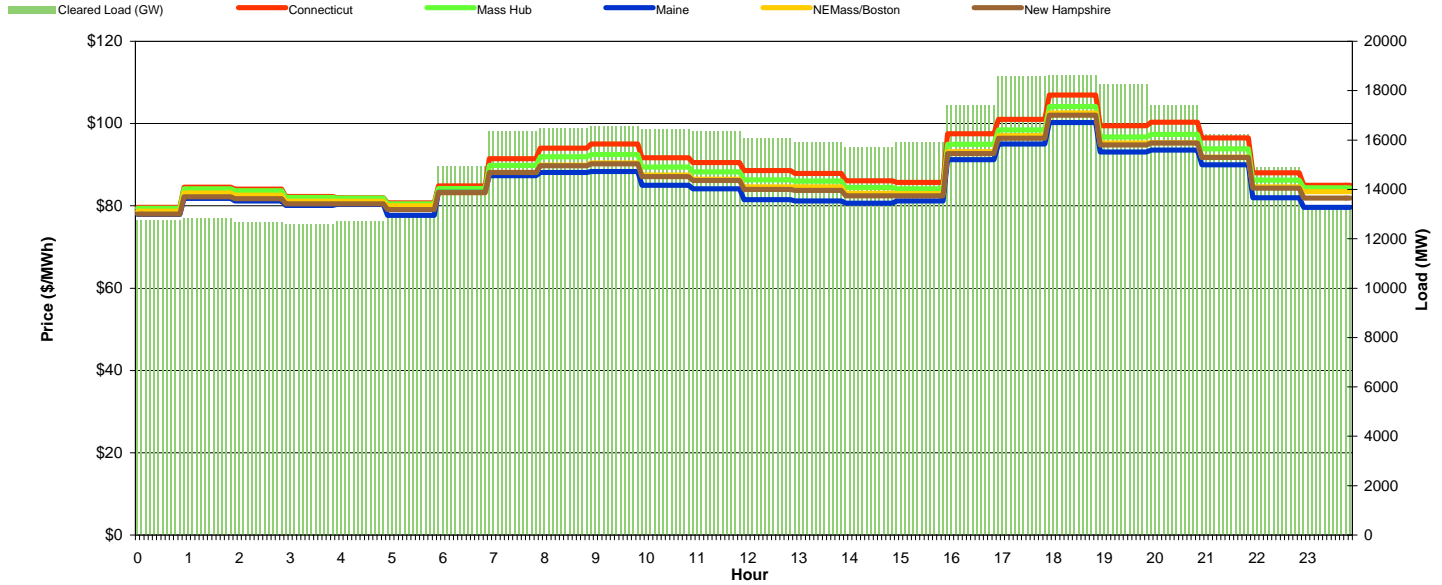

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	66.29	72.93	77.94	72.06	60.13	56.63	70.38	80.32	82.11	91.62	93.66	84.93	84.78	83.77	74.62	52.77	83.58	92.44	87.33	84.02	83.61	84.55	78.47	44.66	76.82	82.66	All	On Pk
NEMass/Boston	64.81	71.44	75.92	70.29	58.70	55.53	68.47	77.40	79.06	88.34	89.83	82.08	81.96	80.78	72.80	51.44	80.11	88.31	83.73	80.84	80.68	81.01	76.38	44.07	74.33	79.67		
New Hampshire	64.13	70.76	75.30	69.72	58.14	55.05	68.22	77.27	79.26	88.17	89.56	82.00	81.76	80.51	72.56	51.31	79.75	87.92	83.62	80.89	80.93	81.04	76.19	43.43	74.06	79.55		
Maine	64.07	70.75	75.11	69.52	57.45	54.29	67.54	76.00	78.31	87.09	88.27	81.09	80.59	79.03	71.68	50.86	77.68	86.51	83.33	80.88	80.53	79.76	74.78	42.05	73.22	78.52		
Mass Hub	65.21	72.03	76.77	71.06	59.31	56.01	69.08	78.40	80.15	89.45	91.07	82.99	82.84	81.69	73.32	51.78	81.01	89.22	84.50	81.54	81.44	82.13	77.12	44.23	75.10	80.54		
DA Forecast Load (GW)	13.90	13.40	13.15	13.19	13.51	14.62	16.55	17.71	17.92	17.92	17.82	17.55	17.19	16.89	16.71	16.85	18.42	19.86	19.55	19.15	18.62	17.62	16.17	14.69				
Forecast Error %	3.0%	5.9%	8.3%	8.0%	7.3%	3.0%	-4.7%	-6.2%	-3.7%	-1.8%	-0.5%	0.4%	0.9%	1.2%	0.8%	0.3%	-1.9%	-2.0%	-1.1%	-1.5%	-2.3%	-2.7%	-2.9%	-2.3%				

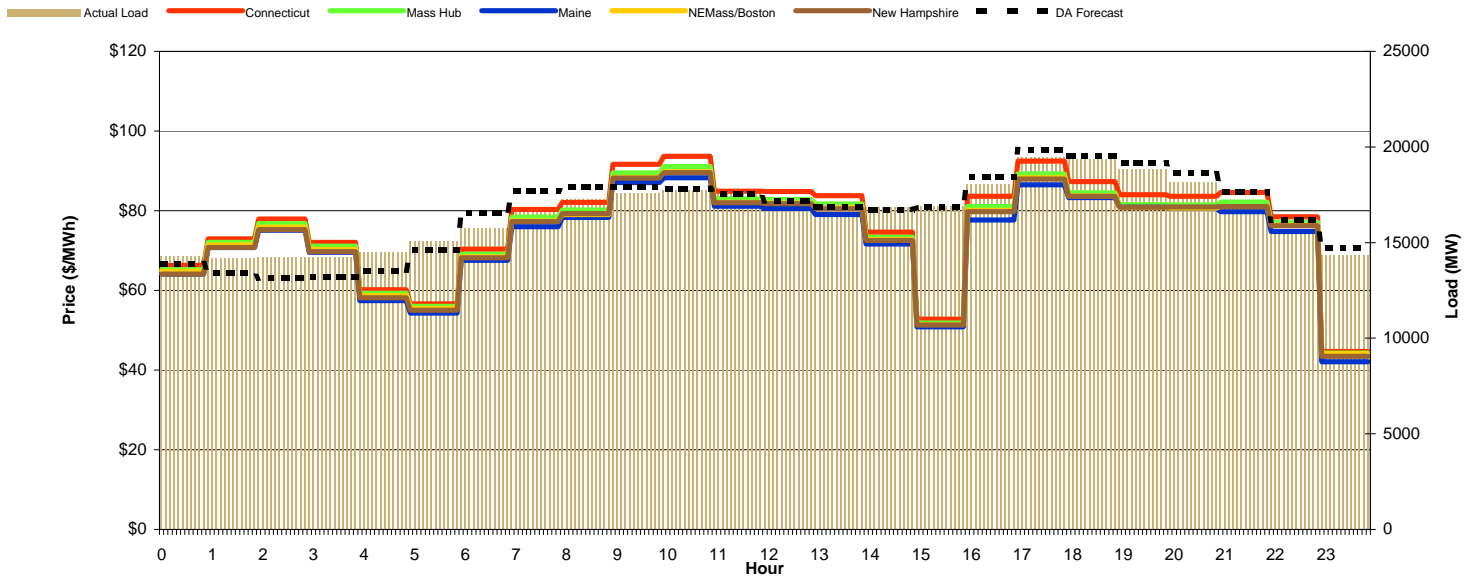




ISO-NE Daily Report

Wednesday December 29, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
																										All	On Pk	
Connecticut	54.47	50.49	49.36	49.38	49.28	54.46	65.20	76.22	80.07	80.52	78.42	69.39	65.28	65.18	65.00	66.05	70.79	91.61	91.07	87.61	69.67	62.40	61.07	56.50	67.06	73.77		
NEMass/Boston	54.59	50.76	49.33	49.31	49.35	54.81	63.92	72.49	75.00	75.17	73.01	65.19	62.10	62.17	62.07	62.99	67.33	86.86	86.27	82.92	66.13	60.21	58.78	56.30	64.46	69.92		
New Hampshire	54.21	50.56	49.22	49.24	49.27	54.64	63.60	72.51	74.75	74.82	72.67	65.13	62.04	62.26	62.13	62.86	67.24	86.43	85.86	82.61	66.19	60.12	58.87	55.73	64.29	69.78		
Maine	54.39	50.85	49.42	49.43	50.90	55.02	63.64	71.88	72.80	72.49	70.00	63.49	60.38	60.51	60.36	61.13	66.20	84.71	83.81	80.50	65.00	58.90	57.88	54.96	63.28	68.13		
Mass Hub	54.71	51.01	49.66	49.66	49.67	54.93	64.59	73.73	76.56	76.73	74.64	66.42	62.97	62.98	62.86	63.78	68.37	88.10	87.53	84.31	67.19	60.77	59.73	56.57	65.31	71.04		
Cleared Load (GW)	13.1	12.7	12.3	12.2	12.6	13.2	14.6	15.8	15.8	15.7	15.6	15.9	15.8	15.7	15.6	15.6	17.1	18.1	18.0	17.4	17.1	16.0	14.6	13.2				

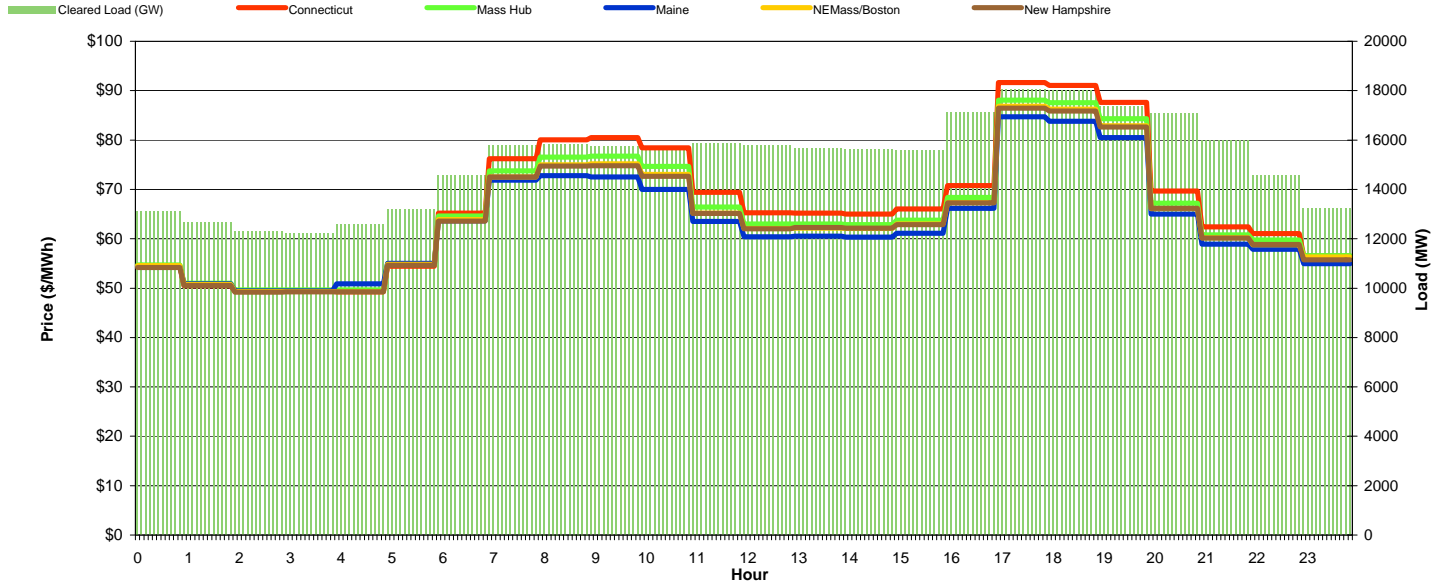

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
																										All	On Pk	
Connecticut	49.67	41.54	41.65	43.56	37.84	34.92	48.27	58.97	63.44	75.64	75.13	69.08	60.22	59.13	57.34	53.70	61.85	69.62	61.63	66.25	57.43	52.43	53.02	34.37	55.28	62.18		
NEMass/Boston	49.25	41.62	41.75	43.61	37.75	34.69	47.23	57.10	60.67	71.70	70.87	65.55	57.63	56.75	55.23	52.20	59.79	67.19	59.82	64.04	55.61	50.92	51.79	33.82	53.61	59.80		
New Hampshire	48.72	41.35	41.46	43.31	37.52	34.42	46.74	56.67	60.46	71.53	70.62	65.38	57.50	56.62	55.16	52.00	59.67	66.87	59.61	63.92	55.64	50.63	51.30	33.45	53.36	59.60		
Maine	47.93	41.31	41.42	43.21	37.55	34.14	45.96	55.44	58.90	69.80	69.00	63.76	56.00	55.02	54.05	51.00	58.60	65.22	58.45	62.85	54.70	49.59	50.59	33.23	52.41	58.31		
Mass Hub	49.43	41.71	41.84	43.73	37.87	34.79	47.52	57.62	61.47	72.84	72.06	66.56	58.39	57.45	55.83	52.54	60.25	67.71	60.20	64.55	56.08	51.26	52.04	33.88	54.07	60.43		
DA Forecast Load (GW)	13.55	12.94	12.65	12.62	12.88	13.70	15.40	16.66	17.11	17.14	17.23	17.09	16.81	16.64	16.49	16.56	17.93	19.13	19.05	18.53	17.90	16.98	15.54	14.13				
Forecast Error %	2.3%	5.4%	4.7%	4.0%	3.1%	1.7%	-5.2%	-5.8%	-4.2%	-2.1%	-1.6%	-0.8%	-0.2%	0.3%	0.0%	-0.6%	-2.1%	-1.5%	-1.9%	-1.7%	-1.7%	-2.3%	-2.0%	-0.4%				

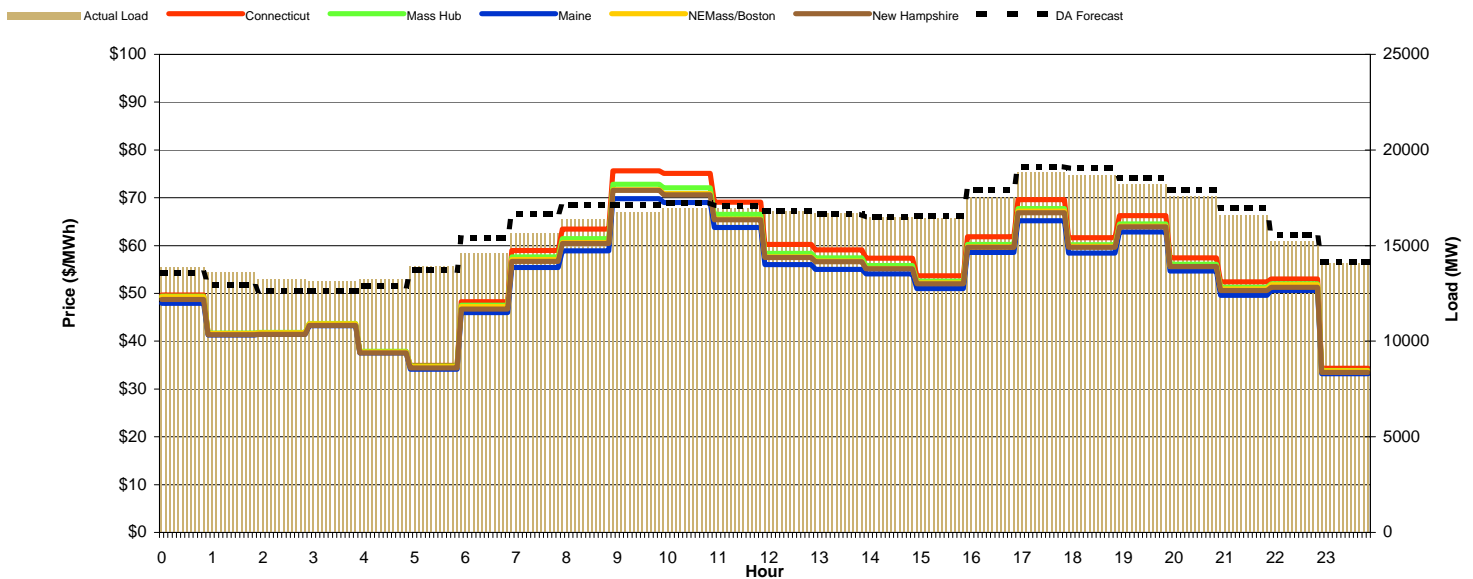




ISO-NE Daily Report

Thursday December 30, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	38.55	34.99	35.11	34.95	35.46	37.63	46.56	50.40	54.07	54.66	53.84	52.74	51.41	50.82	49.86	50.53	54.18	73.22	67.49	60.64	53.48	51.19	48.33	42.94	49.29	54.80	All	On Pk
NEMass/Boston	38.87	35.31	35.58	35.42	36.05	38.18	46.41	49.21	51.79	52.52	51.72	50.53	49.32	49.14	48.42	49.14	51.72	70.18	65.04	58.23	51.14	49.18	46.83	42.67	48.03	52.76		
New Hampshire	38.54	35.03	35.46	35.35	35.97	37.91	46.02	49.02	51.71	52.38	51.59	50.40	49.02	48.72	47.99	48.78	51.69	69.72	64.53	57.90	50.92	48.76	46.49	42.10	47.75	52.48		
Maine	38.92	35.27	35.61	35.59	41.10	38.09	46.76	49.20	51.55	51.92	51.17	50.00	48.28	47.99	47.30	48.50	51.58	68.63	63.25	56.96	50.00	47.67	46.35	42.22	47.66	51.90		
Mass Hub	38.83	35.27	35.48	35.27	35.85	38.00	46.45	49.41	52.37	53.19	52.37	51.18	49.89	49.54	48.78	49.47	52.32	70.80	65.55	58.76	51.77	49.72	47.28	42.79	48.35	53.28		
Cleared Load (GW)	12.2	11.8	11.3	11.3	11.5	12.5	14.2	15.2	15.3	15.6	15.6	15.5	15.2	15.0	14.9	15.0	16.4	17.5	17.6	17.2	16.6	15.5	14.3	13.1				

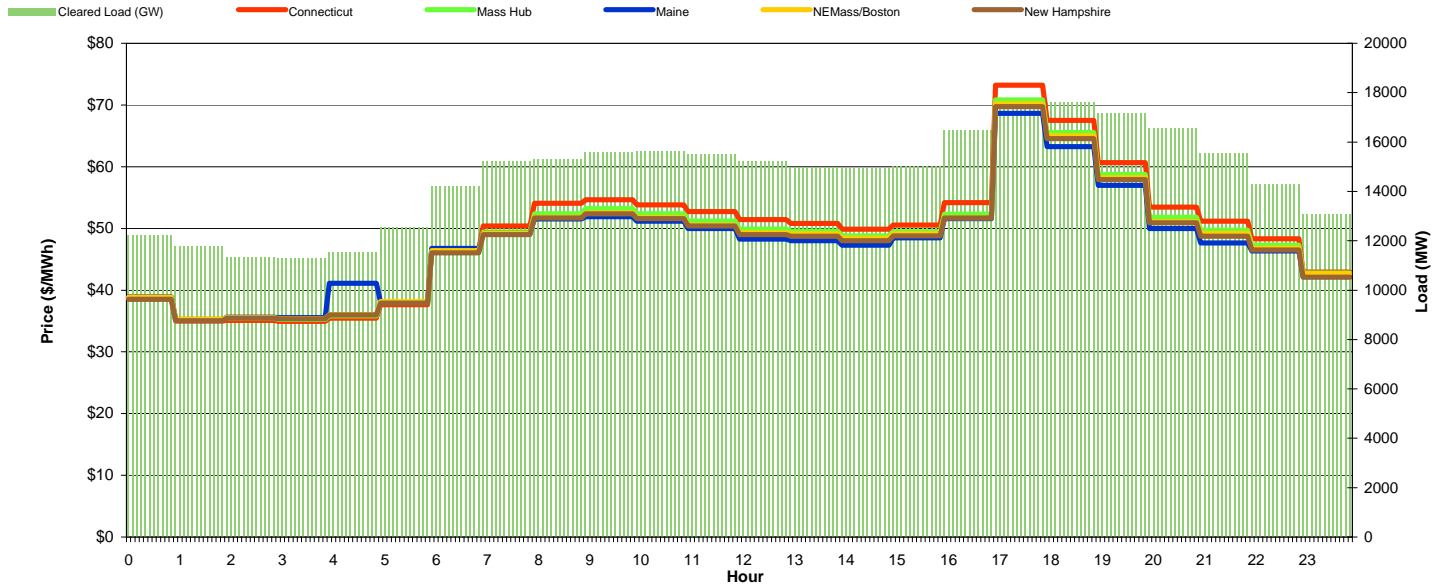

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	34.45	37.24	36.30	36.60	36.30	40.35	44.23	46.09	51.00	52.99	49.91	47.35	44.52	44.08	42.63	41.67	47.79	46.13	45.74	44.83	46.85	44.41	42.95	31.21	43.15	46.18	All	On Pk
NEMass/Boston	34.55	37.42	36.38	36.73	36.41	40.40	44.03	44.96	49.25	51.36	48.01	45.65	43.20	42.99	41.81	40.83	46.30	44.05	43.79	43.16	44.89	42.65	41.74	30.80	42.14	44.67		
New Hampshire	34.13	37.03	36.05	36.43	36.07	40.00	43.67	44.61	48.88	51.05	47.71	45.37	42.95	42.67	41.49	40.67	46.22	43.87	43.56	43.02	44.69	42.36	41.29	30.42	41.84	44.40		
Maine	34.04	37.18	36.27	36.81	36.41	40.31	43.75	44.19	48.46	50.41	46.99	44.55	42.27	41.95	40.91	40.60	46.09	43.30	42.72	42.60	43.78	41.35	40.54	30.18	41.49	43.79		
Mass Hub	34.47	37.37	36.39	36.72	36.40	40.33	44.08	45.33	49.80	51.87	48.61	46.22	43.68	43.42	42.13	41.10	46.70	44.57	44.30	43.60	45.46	43.16	42.14	30.92	42.45	45.13		
DA Forecast Load (GW)	13.12	12.56	12.32	12.31	12.61	13.58	15.27	16.46	16.77	16.86	16.86	16.68	16.29	16.08	15.89	16.06	17.37	18.58	18.38	18.17	17.60	16.61	15.17	13.75				
Forecast Error %	-1.2%	0.0%	1.4%	1.4%	1.3%	-1.3%	-3.5%	-3.5%	-1.5%	-0.6%	-0.6%	-0.8%	-0.8%	-1.4%	-1.8%	-3.2%	-3.9%	-2.2%	-1.5%	-2.8%	-2.9%	-2.2%	-1.1%	-0.6%				

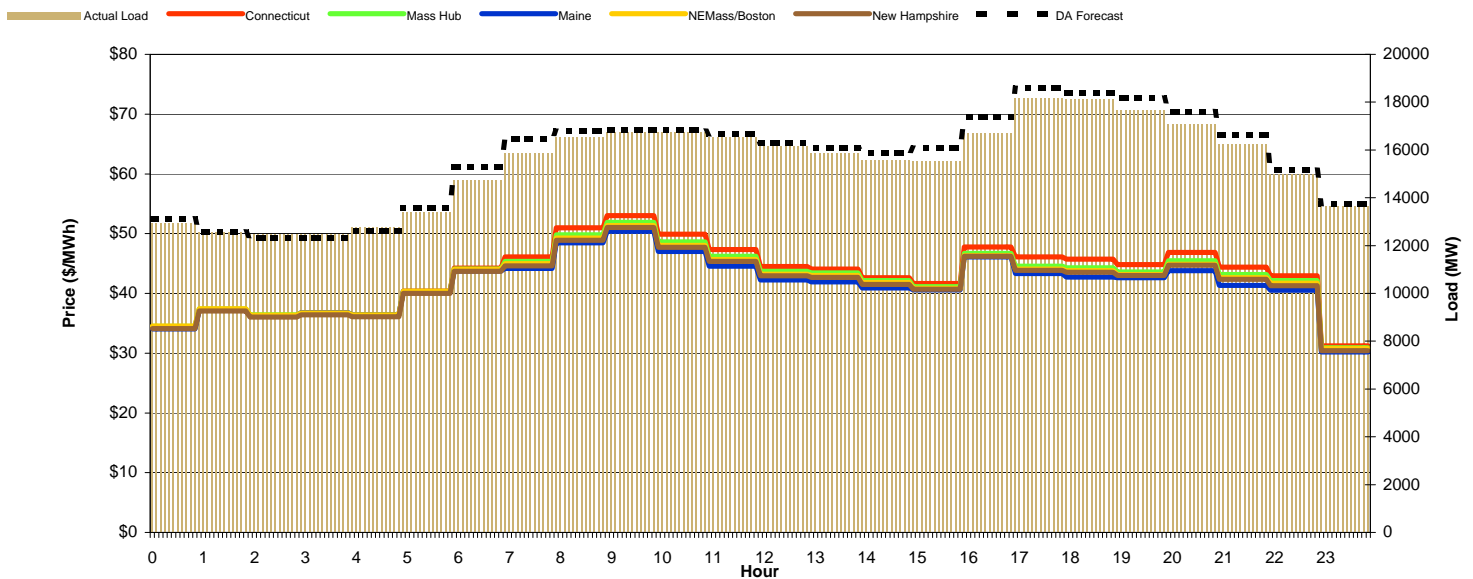




ISO-NE Daily Report

Friday December 31, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%

Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	40.98	37.93	37.42	36.61	34.66	38.16	42.03	49.76	50.62	51.20	51.25	52.00	51.44	51.08	50.58	50.72	51.07	65.88	57.72	51.67	51.09	48.55	48.10	42.43	47.62	52.05	All	On Pk
NEMass/Boston	40.99	38.10	37.93	37.06	34.83	38.77	42.16	48.22	49.06	49.09	49.11	49.54	49.10	48.99	48.52	48.60	49.04	62.91	55.50	49.41	49.05	46.46	46.12	41.90	46.27	49.92		
New Hampshire	40.63	37.78	37.72	36.90	34.55	38.50	41.71	48.01	48.79	48.89	48.90	49.41	48.84	48.71	48.20	48.31	48.85	62.45	55.09	49.14	48.58	46.05	45.78	41.48	45.97	49.63		
Maine	40.94	38.02	37.86	37.09	34.83	41.04	41.79	47.75	48.73	48.77	48.78	49.20	48.18	48.18	47.63	47.75	49.18	61.96	54.86	48.98	48.04	45.20	45.70	41.74	45.93	49.31		
Mass Hub	41.03	38.22	37.90	37.09	34.93	38.69	42.18	48.60	49.46	49.71	49.74	50.23	49.79	49.62	49.09	49.19	49.54	63.71	56.15	50.16	49.57	46.98	46.65	42.12	46.68	50.51		
Cleared Load (GW)	12.0	11.7	11.4	11.3	11.5	12.0	13.3	14.1	14.6	14.9	15.1	15.0	14.8	14.5	14.3	14.4	15.7	16.8	16.9	16.4	15.4	14.4	13.4	12.3				

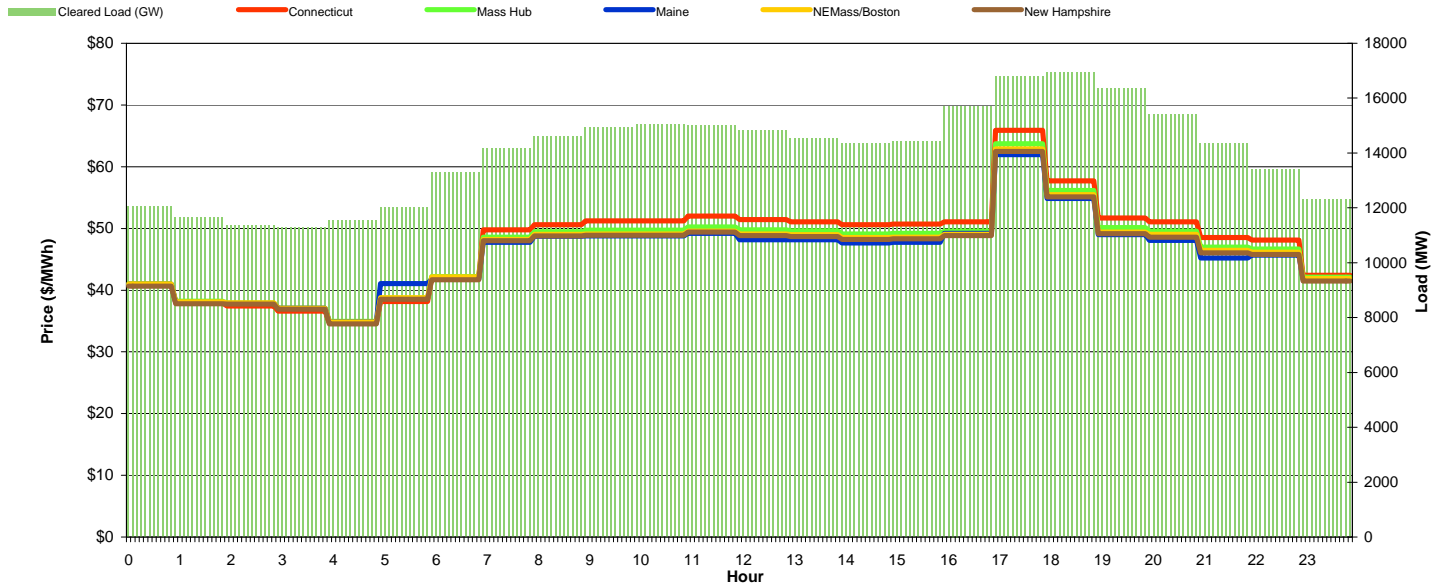

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	37.31	35.40	32.00	27.27	33.18	36.62	40.71	44.23	46.31	53.43	55.49	45.75	46.12	44.57	41.56	41.66	56.77	55.10	45.39	42.77	41.49	42.60	45.01	41.29	43.00	46.77	All	On Pk
NEMass/Boston	37.11	35.36	32.01	27.33	33.22	36.81	40.58	43.48	44.97	51.18	53.02	43.85	44.33	43.22	40.56	40.58	55.10	52.69	43.36	41.13	40.05	40.98	43.46	40.74	41.88	45.12		
New Hampshire	36.47	34.81	31.50	26.91	32.68	36.12	39.94	42.91	44.46	50.62	52.30	43.41	43.80	42.66	40.08	40.22	54.45	51.77	42.66	40.51	39.42	40.48	42.73	40.01	41.29	44.53		
Maine	36.13	34.53	31.24	26.70	32.55	35.74	39.66	42.14	43.77	49.83	51.12	42.53	42.87	41.69	39.29	39.52	53.57	50.03	41.19	39.18	37.92	39.00	41.51	39.67	40.47	43.45		
Mass Hub	37.18	35.41	32.06	27.38	33.26	36.78	40.64	43.71	45.40	51.91	53.77	44.43	44.90	43.68	40.88	40.92	55.51	53.22	43.81	41.54	40.44	41.47	43.92	40.83	42.21	45.59		
DA Forecast Load (GW)	12.69	12.11	11.82	11.72	11.86	12.48	13.49	14.37	15.24	15.95	16.23	16.29	15.94	15.64	15.45	15.55	16.80	18.00	17.52	16.76	15.99	15.21	14.37	13.56				
Forecast Error %	2.2%	2.0%	3.5%	5.8%	2.0%	0.0%	-1.8%	-2.5%	-3.0%	-3.6%	-4.3%	-5.5%	-5.2%	-5.3%	-5.8%	-5.8%	-5.2%	-3.9%	-3.2%	-3.8%	-3.9%	-3.9%	-3.5%	-3.6%				

