




MISO Daily Report

Thursday April 1, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	18.61	18.08	18.15	19.00	22.76	35.04	34.27	31.03	32.44	33.26	32.98	32.65	32.51	32.33	32.00	29.12	28.51	25.62	26.78	29.47	26.81	24.09	20.87	20.25	27.36	29.40
First Energy Hub	20.63	20.32	20.74	21.89	25.95	37.83	37.84	33.26	34.57	35.54	35.12	34.82	34.96	34.93	34.23	29.83	28.79	26.08	26.90	29.73	27.21	24.35	20.44	19.42	28.97	30.67
Illinois Hub	14.93	15.23	14.31	14.30	15.65	25.28	28.88	28.67	29.19	29.75	29.80	29.46	29.29	29.08	28.40	26.57	25.27	23.67	24.70	27.15	25.13	21.76	18.04	15.71	23.76	26.62
Michigan Hub	20.96	20.67	21.15	22.35	26.49	38.40	38.59	33.69	35.06	36.07	35.62	35.32	35.48	35.48	34.77	33.12	32.00	28.78	30.50	33.72	30.54	27.44	26.34	25.88	30.77	32.75
Minnesota Hub	11.07	8.88	7.00	6.24	6.89	16.04	20.14	27.02	26.35	26.32	28.71	29.60	28.57	28.51	28.13	27.75	26.55	23.27	19.20	19.38	19.40	18.63	8.32	7.71	19.57	24.11
Wisconsin PS	12.82	10.33	8.61	8.02	9.18	18.57	20.96	27.55	26.92	26.93	27.94	27.70	26.95	26.51	25.76	25.88	24.87	22.56	24.33	27.24	25.16	21.76	13.74	10.24	20.85	25.11
Cleared Load (GW)	46.2	45.7	45.9	46.8	51.1	60.0	63.9	65.1	66.1	66.4	67.0	66.8	67.1	66.9	66.7	66.3	65.6	64.0	63.9	66.7	65.3	60.6	55.0	5.1		

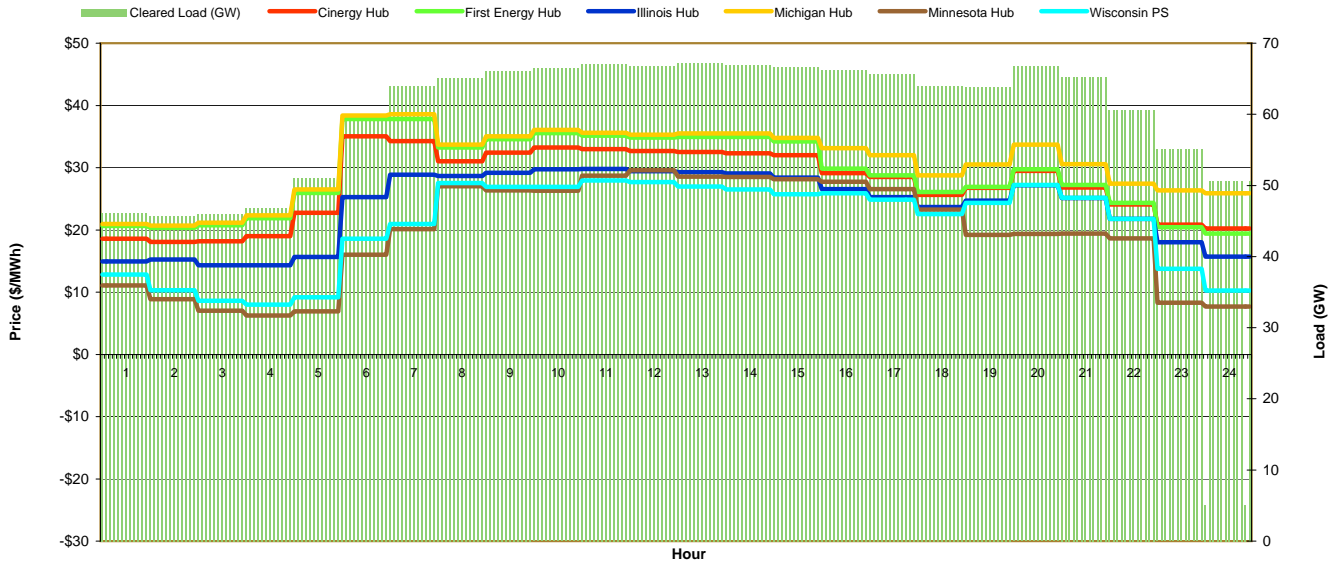

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	15.75	15.28	-9.29	21.64	12.21	20.17	24.95	28.48	24.29	26.06	28.33	31.04	33.88	25.83	23.70	22.87	27.40	24.43	23.69	30.09	23.61	14.53	0.71	7.41	20.71	24.31
First Energy Hub	16.21	15.69	-9.20	22.70	12.50	20.53	24.66	26.90	24.30	26.01	28.18	29.67	32.93	26.02	24.36	23.34	26.27	23.34	21.72	29.14	23.21	14.81	0.71	7.52	20.48	23.81
Illinois Hub	15.01	14.54	-22.62	0.44	11.26	17.06	21.15	23.31	22.10	23.66	25.51	26.03	29.20	23.74	22.52	21.49	22.91	19.84	17.80	25.23	18.19	10.60	-2.09	5.19	16.34	20.63
Michigan Hub	16.18	15.65	-8.23	23.97	12.49	20.75	24.84	26.99	24.47	26.26	28.46	30.06	33.43	26.34	24.65	23.47	26.37	23.34	21.71	29.12	23.26	15.23	1.00	7.78	20.73	24.01
Minnesota Hub	20.26	14.38	-22.25	0.88	11.37	17.28	21.78	25.09	22.33	24.37	26.56	28.83	42.74	24.68	32.61	28.15	29.08	21.64	19.42	22.96	20.85	1.08	-9.85	-0.36	17.66	22.53
Wisconsin PS	16.79	15.61	-26.87	-3.27	12.10	18.21	20.67	19.80	22.98	24.48	26.18	23.96	29.49	25.02	25.72	23.72	21.04	16.28	11.99	24.57	21.08	3.26	-9.13	0.72	15.18	19.40
Forecasted Load (GW)	52.1	50.6	49.9	50.3	52.3	56.8	61.8	64.2	65.2	66.0	66.5	66.7	66.8	66.8	66.5	66.3	65.7	64.7	64.4	66.4	66.3	63.1	59.1	54.8		
Forecast Error %	-3.9%	-4.0%	-4.5%	-4.7%	-4.4%	-3.5%	-2.8%	-3.2%	-2.6%	-2.0%	-1.6%	-1.5%	-1.2%	-1.3%	-1.9%	-2.6%	-2.6%	-2.3%	-2.6%	-2.4%	-2.0%	-2.6%	-4.6%	-4.7%		

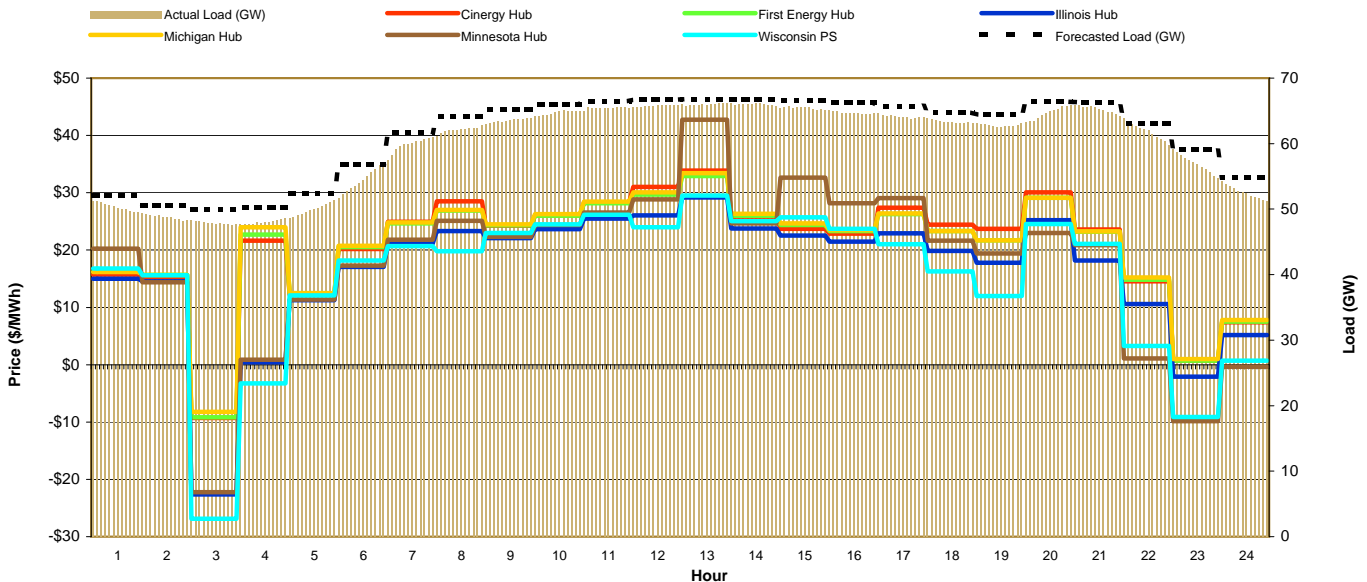




MISO Daily Report

Friday April 2, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	16.43	13.62	13.19	14.12	15.57	27.24	25.11	26.20	27.08	28.05	28.23	27.63	28.01	28.13	28.43	26.98	26.43	25.59	25.45	26.99	26.18	22.35	19.70	18.22	23.54	26.34
First Energy Hub	21.37	17.59	17.34	18.58	19.91	32.10	28.46	28.87	29.71	30.92	30.99	30.21	30.64	30.80	31.07	27.76	27.26	26.42	26.26	27.97	26.94	23.22	20.13	18.23	25.95	28.07
Illinois Hub	12.27	11.67	11.00	11.00	12.00	20.60	22.75	23.79	24.70	25.60	25.87	25.47	25.85	25.95	26.23	25.13	24.76	23.99	23.84	25.17	24.60	21.00	17.90	16.39	21.15	24.37
Michigan Hub	18.39	15.73	15.74	16.67	17.31	28.50	27.88	28.13	28.81	30.43	30.64	29.85	30.25	30.45	30.73	28.45	28.36	27.29	27.31	27.88	28.01	23.25	20.23	19.46	25.41	28.13
Minnesota Hub	7.57	5.88	4.82	4.64	6.67	16.25	18.62	24.09	26.04	26.50	27.18	26.17	26.45	24.07	24.27	24.43	22.25	20.34	20.65	24.97	23.12	20.50	16.32	14.97	19.03	23.58
Wisconsin PS	9.40	7.16	6.56	6.59	9.00	16.18	20.57	21.94	23.49	24.01	24.61	24.67	24.98	24.80	25.18	25.92	24.21	23.78	23.12	26.43	24.65	21.28	17.67	16.68	19.70	23.79
Cleared Load (GW)	45.7	44.8	44.7	44.9	45.9	53.9	57.6	59.6	61.3	62.3	62.6	62.5	62.4	62.5	61.9	61.0	60.4	59.0	58.6	60.8	59.7	55.5	49.5	4.6		

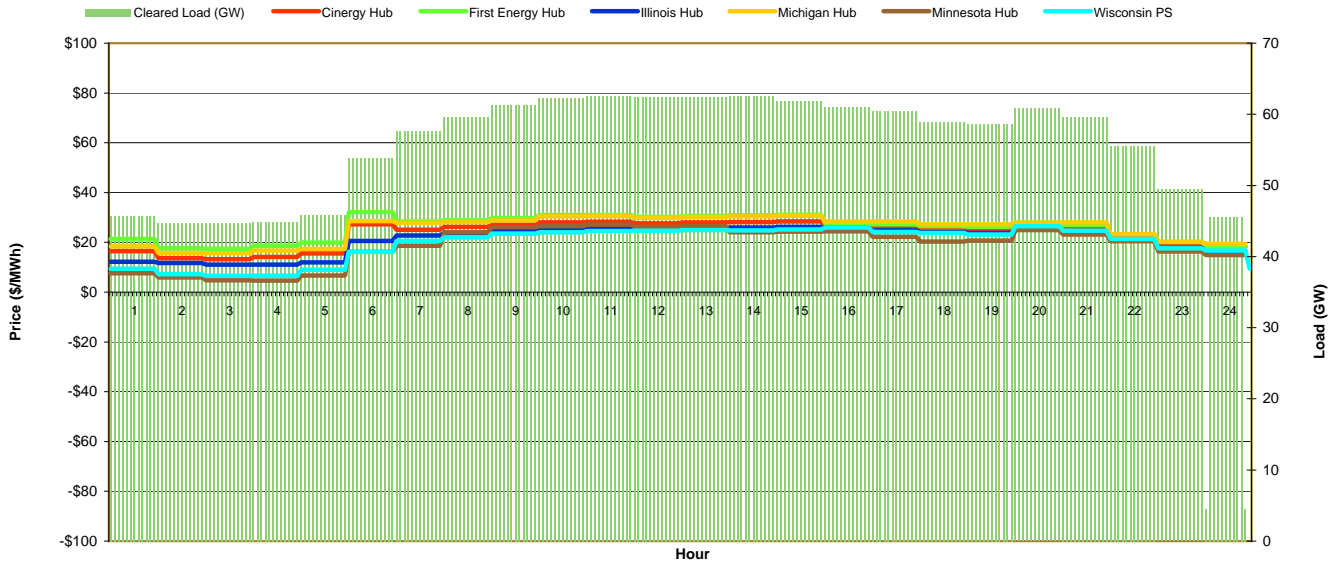

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	22.30	19.09	12.28	10.50	-7.15	-22.28	36.42	21.30	26.04	22.54	23.43	23.23	25.26	23.04	24.74	23.29	23.30	22.18	19.18	31.94	22.44	17.99	17.72	-1.36	18.23	22.98
First Energy Hub	97.23	19.56	12.48	10.66	-7.57	-22.95	25.12	21.91	26.83	23.40	24.30	24.11	26.22	23.97	25.72	24.10	24.12	22.88	19.80	33.05	23.21	18.59	18.49	-1.37	21.41	23.79
Illinois Hub	5.44	15.47	7.01	5.64	-11.29	-25.31	-9.33	19.37	24.29	21.13	22.00	21.93	22.62	21.54	21.94	20.19	21.67	20.45	18.51	28.58	21.32	17.30	10.04	-2.38	13.26	20.81
Michigan Hub	-96.74	19.74	12.91	11.06	-6.89	-22.22	15.16	21.86	26.60	23.19	24.07	23.86	26.10	23.67	25.52	24.04	23.95	22.77	19.60	32.96	23.16	18.49	18.62	-1.28	12.93	23.67
Minnesota Hub	18.41	7.27	-6.37	-6.69	-22.78	-34.28	1.33	15.48	17.84	19.11	21.86	19.77	16.67	19.21	44.35	13.85	21.54	16.42	18.19	38.58	24.41	25.64	9.45	-2.52	12.36	21.40
Wisconsin PS	4.17	9.28	-4.30	-4.83	-22.12	-34.45	4.96	17.72	22.60	21.16	22.19	22.26	19.98	21.42	21.87	16.11	20.76	18.68	19.65	30.84	22.81	19.00	8.78	-2.75	11.49	20.36
Forecasted Load (GW)	51.3	49.5	48.5	48.3	49.3	51.7	55.1	58.3	60.4	61.9	62.3	62.2	62.0	61.9	61.6	61.2	60.7	59.9	59.7	60.8	61.0	58.3	54.0	51.3		
Forecast Error %	-4.0%	-4.1%	-4.3%	-4.7%	-4.4%	-2.6%	-2.4%	-4.0%	-3.3%	-2.9%	-2.0%	-1.9%	-1.8%	-1.8%	-2.0%	-2.4%	-2.4%	-2.4%	-3.0%	-2.3%	-2.8%	-2.9%	-2.2%	-14.1%		

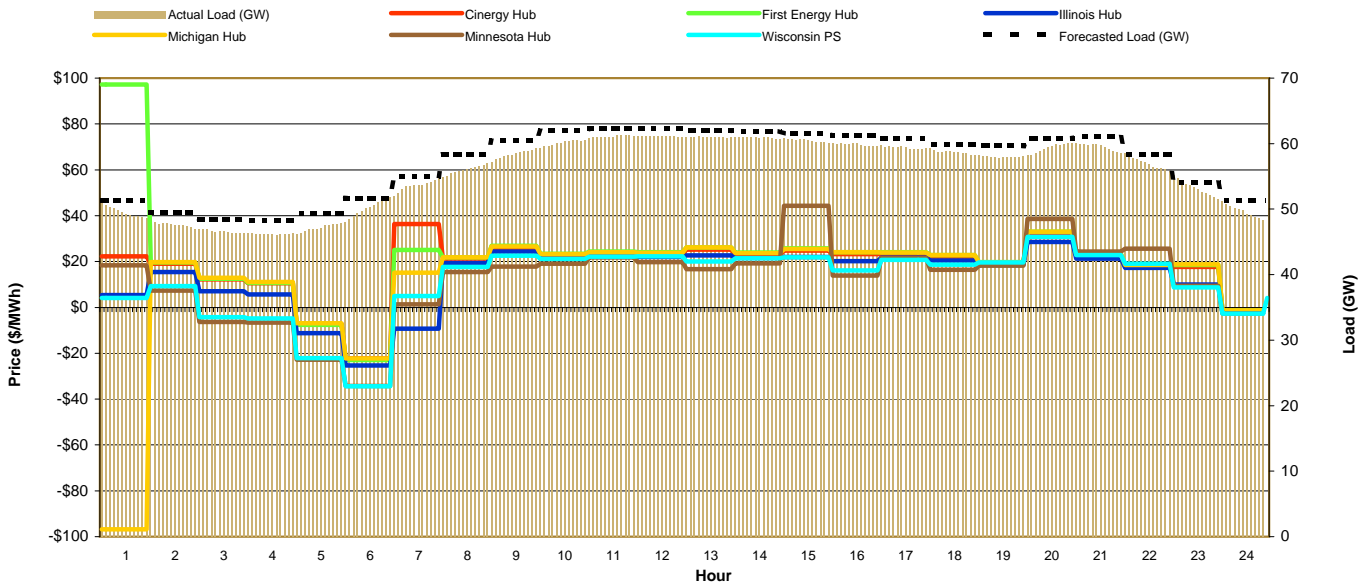




MISO Daily Report

Saturday April 3, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	15.99	14.70	13.41	12.64	13.51	15.30	22.52	24.24	26.47	26.76	26.45	26.69	26.59	26.13	25.24	25.34	25.43	24.75	25.00	29.41	26.48	24.56	19.46	18.62	22.32	25.56
First Energy Hub	17.89	15.62	13.97	13.81	15.40	18.30	28.62	29.46	29.82	30.23	28.17	28.72	28.41	28.07	27.76	27.89	27.32	26.50	26.83	32.96	28.90	26.99	22.63	21.32	24.82	28.17
Illinois Hub	9.00	7.47	5.84	7.43	8.62	11.01	17.47	20.47	22.07	22.50	22.89	23.07	22.90	22.41	21.93	22.03	22.36	22.17	22.71	26.20	24.19	22.44	13.75	11.50	18.02	22.13
Michigan Hub	11.13	11.51	10.51	10.62	11.31	12.08	16.19	19.48	25.05	25.28	27.58	27.39	27.86	27.12	25.66	25.57	26.64	25.99	26.34	28.71	27.12	25.92	15.97	15.31	21.10	25.48
Minnesota Hub	5.81	3.06	1.55	2.61	2.89	7.06	12.71	17.31	18.85	19.25	19.76	20.37	20.26	19.75	19.39	19.07	19.38	19.37	22.90	22.11	18.81	9.89	6.67	14.51	19.12	
Wisconsin PS	7.48	4.87	3.25	4.06	4.50	8.46	14.69	19.09	21.49	21.95	22.57	22.68	22.49	22.05	21.50	21.30	21.60	21.75	21.99	24.98	23.66	20.47	11.26	8.10	16.51	21.30
Cleared Load (GW)	43.3	43.0	42.2	42.2	42.4	42.9	46.4	49.8	53.3	54.9	55.3	55.2	54.4	53.7	53.0	52.7	52.9	52.7	52.9	56.1	55.6	51.7	45.7	4.3		

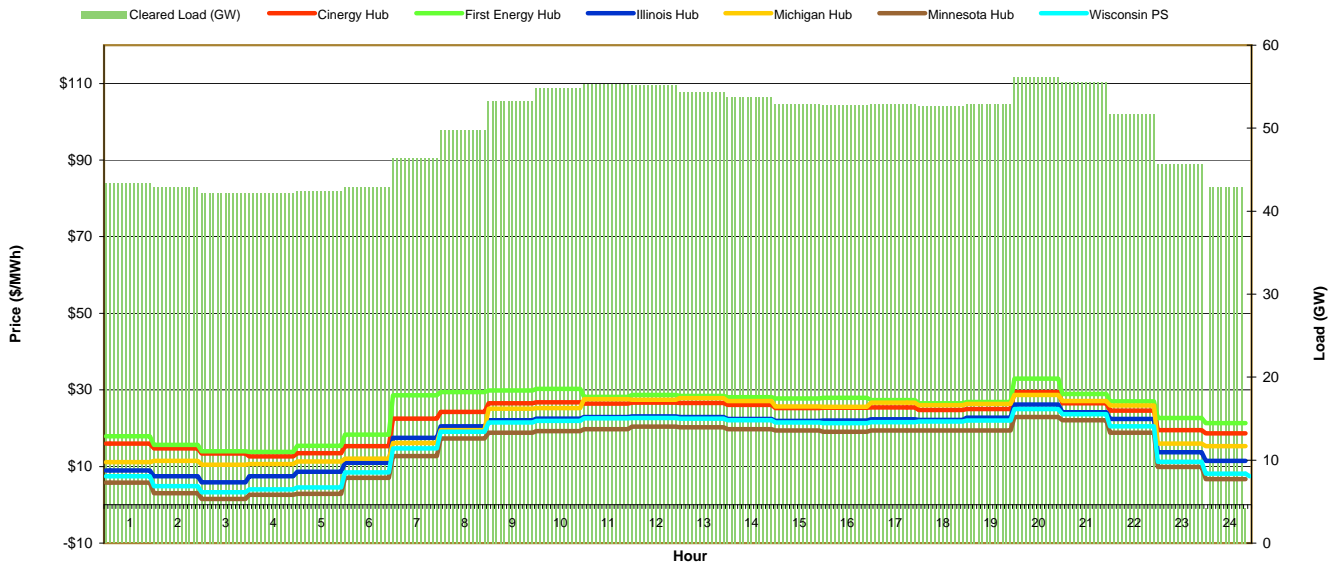

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$		
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk	
Cinergy Hub	16.37	24.96	19.12	16.51	17.39	16.91	19.73	60.65	40.78	25.86	24.99	24.21	23.70	23.66	27.03	24.14	23.65	21.24	22.17	102.30	25.16	25.34	16.88	17.84	27.52	31.99	
First Energy Hub	16.80	26.18	19.70	16.88	17.77	17.31	20.18	56.33	41.81	26.67	25.76	25.06	24.59	24.59	28.22	25.11	24.70	22.07	22.99	105.98	26.11	26.16	17.45	18.38	28.20	32.73	
Illinois Hub	14.16	4.44	14.07	16.03	16.86	16.34	18.86	30.68	39.10	24.96	24.11	23.13	20.99	19.97	19.37	21.63	20.45	19.94	22.90	113.55	25.08	24.79	15.54	17.12	24.34	29.14	
Michigan Hub	16.82	27.37	19.87	16.72	17.59	17.11	19.95	51.01	41.55	26.42	25.52	24.83	24.51	24.52	28.32	24.76	24.43	21.77	22.72	104.67	25.84	25.97	17.32	18.17	27.82	32.14	
Minnesota Hub	14.20	4.03	13.99	15.97	16.71	16.23	18.17	37.51	38.18	24.50	23.33	22.23	22.33	18.74	17.68	18.18	18.99	18.54	20.22	89.25	22.18	13.05	18.47	31.36	23.09	26.46	
Wisconsin PS	14.38	-0.09	13.51	16.60	17.44	16.96	19.39	40.35	40.38	25.77	24.87	23.86	21.49	19.86	18.16	20.73	20.26	20.20	21.45	101.35	24.98	24.31	15.75	18.76	24.19	28.98	
Forecasted Load (GW)	48.7	47.1	46.1	45.8	46.2	47.3	48.1	50.3	53.0	54.6	55.1	54.8	54.1	53.3	52.6	52.3	52.4	52.4	52.7	54.9	55.4	53.4	50.3	47.9			
Forecast Error %	-4.0%	-4.1%	-4.5%	-4.5%	-4.6%	-3.9%	-1.0%	-1.0%	-0.5%	0.3%	0.8%	1.6%	1.9%	2.0%	2.0%	1.8%	1.6%	1.6%	1.1%	0.3%	0.4%	1.7%	1.6%	1.3%	-9.5%		

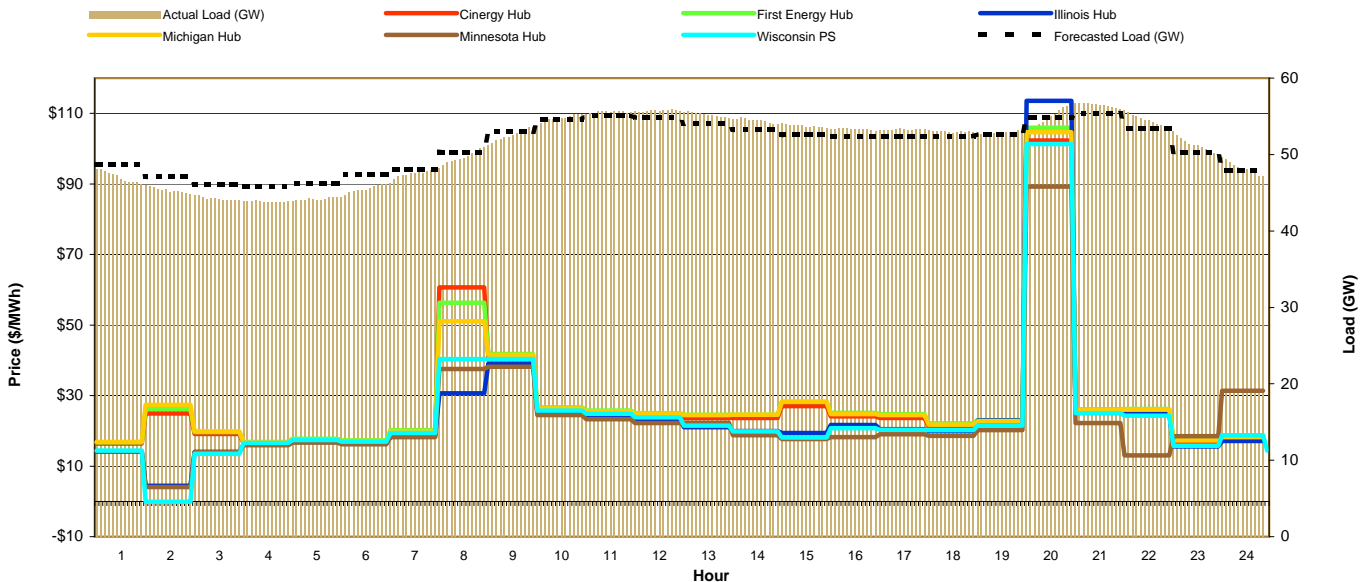




MISO Daily Report

Sunday April 4, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	18.48	17.61	14.78	14.21	15.36	18.76	22.12	22.68	23.08	23.26	23.83	23.41	22.76	22.39	21.78	21.77	22.11	22.18	23.47	30.60	25.63	23.01	20.09	19.27	21.36	23.25
First Energy Hub	19.70	17.87	15.19	14.53	15.83	19.73	23.99	23.91	24.37	24.59	25.21	24.74	23.90	23.50	22.86	22.84	23.40	23.41	24.80	31.48	26.79	24.27	21.18	20.02	22.42	24.45
Illinois Hub	11.75	9.11	9.08	9.00	9.75	15.56	17.99	21.22	21.15	21.36	21.73	21.49	20.97	20.52	20.09	20.18	20.55	20.83	21.87	28.11	24.52	22.66	18.19	15.30	18.46	21.59
Michigan Hub	15.32	16.34	14.13	13.41	14.69	18.42	20.91	22.94	23.82	24.07	24.73	24.29	23.79	23.38	22.71	22.70	23.18	23.19	24.61	30.49	26.62	24.12	20.30	18.89	21.54	24.06
Minnesota Hub	6.15	4.10	1.48	1.66	3.57	5.24	10.28	15.33	17.27	17.68	18.65	18.76	18.63	18.17	18.06	17.95	18.56	19.26	19.89	26.17	24.01	21.99	16.16	12.90	14.66	19.16
Wisconsin PS	8.33	5.76	3.96	4.22	5.59	8.81	13.37	18.52	19.84	20.33	21.10	21.15	20.93	20.44	20.24	20.21	20.78	21.45	22.23	29.92	26.42	24.15	17.82	14.60	17.09	21.59
Cleared Load (GW)	42.3	42.2	41.7	41.9	42.2	43.7	46.2	49.0	50.5	51.3	51.2	51.4	50.8	50.2	49.4	49.2	49.9	50.6	52.6	57.4	55.7	52.8	48.6	4.5		

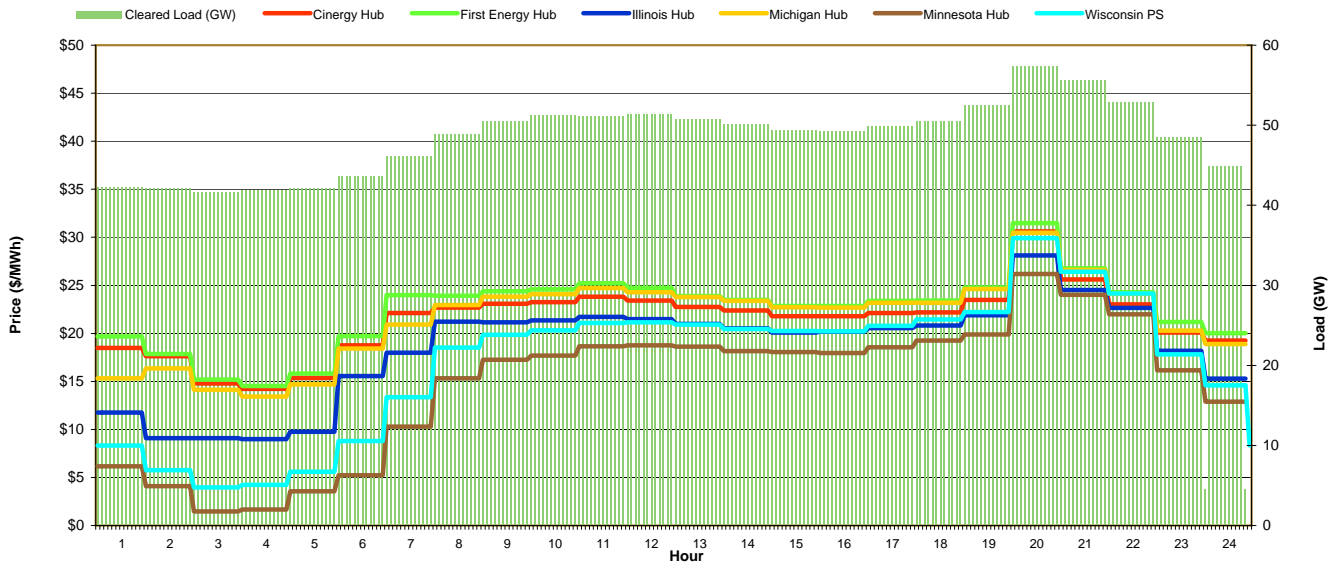

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	10.98	15.04	15.56	17.06	10.12	20.73	21.23	18.00	47.33	21.46	25.44	20.79	20.57	22.30	25.27	19.54	20.36	18.43	19.32	29.95	23.27	21.94	20.37	19.77	21.03	23.40
First Energy Hub	11.33	15.37	15.89	17.49	10.33	21.32	22.00	18.18	38.54	22.08	26.36	21.47	21.23	20.33	23.88	20.02	20.83	18.85	19.71	29.62	23.91	22.63	20.93	20.35	20.94	23.04
Illinois Hub	8.03	12.70	13.55	13.88	9.30	15.63	11.57	6.19	9.63	19.62	19.91	19.44	18.91	12.06	16.25	18.80	19.53	17.75	18.65	25.09	22.42	21.15	18.99	18.52	16.15	17.77
Michigan Hub	11.44	15.46	15.90	17.53	10.31	21.51	22.41	18.22	30.74	21.91	26.38	21.25	21.01	17.99	21.88	19.76	20.55	18.53	19.42	28.44	23.67	22.42	20.92	20.65	20.35	22.07
Minnesota Hub	14.61	11.95	12.75	12.91	8.83	14.73	10.67	6.06	18.14	19.24	19.30	18.85	18.21	14.14	17.76	18.18	18.71	16.94	17.72	23.13	19.96	18.99	23.34	10.64	16.07	18.04
Wisconsin PS	8.40	12.49	13.45	13.51	9.40	14.99	9.80	4.88	21.57	20.10	19.48	19.85	19.16	15.45	19.00	19.17	19.85	18.06	19.07	27.00	23.16	21.51	19.64	13.72	16.78	19.18
Forecasted Load (GW)	45.6	44.8	44.1	43.9	44.5	45.3	46.5	48.2	49.8	50.7	51.0	51.0	50.5	49.8	49.3	49.3	49.9	50.8	51.8	54.6	56.0	54.2	51.3	49.0		
Forecast Error %	0.0%	-1.5%	-1.8%	-1.8%	-2.3%	-0.7%	0.1%	0.6%	1.3%	1.4%	1.4%	1.0%	0.3%	-0.4%	-0.5%	-0.9%	-1.6%	-2.3%	-1.9%	-0.6%	-0.5%	-0.7%	-0.9%	-11.4%		

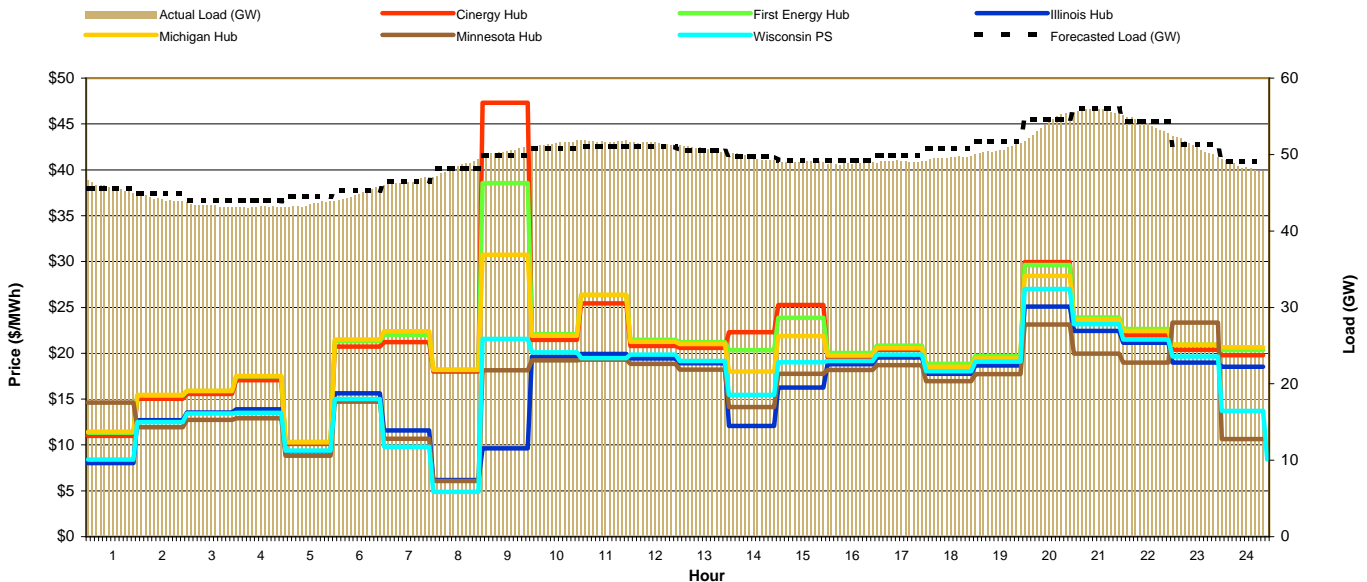




MISO Daily Report

Monday April 5, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$			
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk		
Cinergy Hub	19.08	18.81	18.41	18.99	19.77	34.27	33.34	34.56	40.11	39.48	37.78	38.42	38.90	39.35	35.90	34.07	34.70	28.34	28.88	36.76	31.18	25.30	23.37	20.88	30.44	34.19		
First Energy Hub	20.08	19.77	19.55	19.78	20.66	34.44	34.76	35.60	41.18	40.81	39.79	40.50	40.96	41.65	37.87	35.78	35.76	29.44	30.03	37.72	32.16	26.06	23.01	20.31	31.57	35.52		
Illinois Hub	15.05	15.03	15.16	15.00	16.40	30.26	28.89	32.04	33.53	33.11	34.81	35.66	35.70	38.40	33.93	31.07	27.88	24.23	25.42	29.29	25.29	20.81	14.31	10.78	25.92	29.72		
Michigan Hub	17.88	17.96	17.96	18.14	18.79	34.06	35.10	36.06	42.05	42.00	41.47	42.22	42.72	43.42	39.43	37.19	37.28	30.42	31.02	39.42	33.47	26.86	25.03	22.57	32.19	36.88		
Minnesota Hub	13.24	12.77	12.24	12.63	13.48	17.36	20.25	30.82	37.44	37.91	39.15	39.21	39.69	40.20	37.29	35.78	30.86	26.02	25.21	32.38	29.66	24.00	18.30	14.61	26.69	32.75		
Wisconsin PS	14.87	14.29	13.73	14.03	15.76	22.21	27.01	34.86	41.25	40.70	40.78	41.27	41.88	42.39	38.95	36.88	34.66	29.51	29.58	36.95	32.43	26.26	20.04	15.80	29.42	35.52		
Cleared Load (GW)	44.7	43.5	43.3	43.8	46.2	54.3	60.2	62.1	62.9	64.3	64.5	64.2	63.8	64.3	63.9	63.3	63.0	62.9	63.1	65.0	64.2	60.5	55.9	5.1				

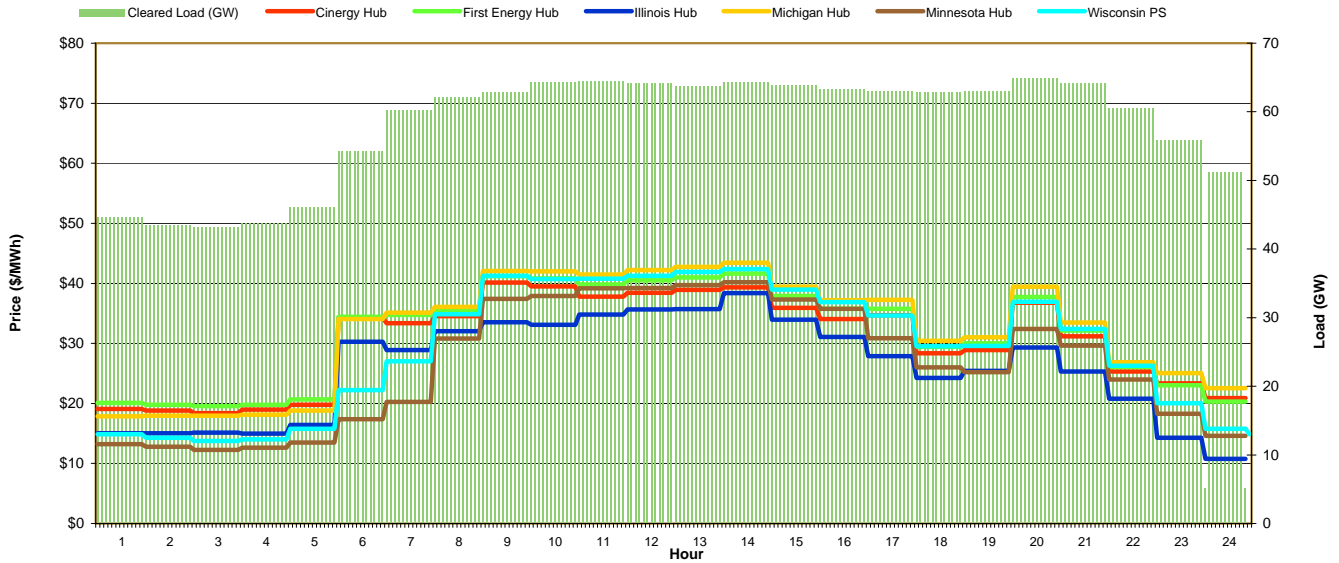

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$			
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk		
Cinergy Hub	14.51	17.02	17.31	18.36	19.31	38.57	53.52	38.26	47.20	31.96	34.05	38.12	76.65	40.97	41.98	58.99	47.09	31.30	39.31	54.47	25.34	22.86	19.48	35.41	40.74			
First Energy Hub	14.82	17.36	17.60	18.84	19.59	32.95	51.70	38.52	48.03	32.61	34.72	38.90	78.20	42.71	43.62	60.66	47.00	31.44	39.53	54.22	25.94	23.49	22.92	19.91	35.64	41.41		
Illinois Hub	14.58	16.09	18.16	13.44	18.30	11.99	41.30	36.29	45.25	30.05	31.76	36.05	71.67	32.80	33.97	26.02	38.74	23.78	27.57	47.32	22.01	20.50	21.03	19.05	29.07	34.05		
Michigan Hub	14.86	17.46	17.71	19.32	19.66	28.20	50.10	38.71	48.17	32.47	34.57	38.57	77.30	42.07	43.14	60.55	47.30	31.65	39.89	54.46	26.28	23.64	23.13	20.12	35.39	41.37		
Minnesota Hub	12.31	14.79	13.71	8.84	17.55	19.00	43.89	36.39	45.55	31.58	34.02	38.20	76.19	40.93	41.01	47.59	30.27	28.98	30.03	45.90	22.16	23.23	18.20	19.96	30.85	36.89		
Wisconsin PS	13.89	16.10	16.42	10.09	18.52	21.31	46.53	37.88	47.37	32.33	34.53	38.55	76.70	41.60	42.21	29.47	25.65	20.31	21.55	32.61	22.35	17.55	15.76	19.19	29.10	33.53		
Forecasted Load (GW)	47.9	46.8	46.5	47.0	49.1	53.9	59.3	62.3	63.9	64.9	65.5	65.6	65.4	65.2	64.6	64.3	63.9	63.3	63.0	64.7	65.3	62.4	58.4	54.4				
Forecast Error %	-3.2%	-3.0%	-2.7%	-2.8%	-2.2%	-2.7%	-2.7%	-1.6%	-0.6%	0.1%	0.9%	1.7%	1.8%	1.6%	0.7%	0.6%	1.0%	1.4%	1.5%	0.1%	-0.9%	-1.7%	-11.4%					

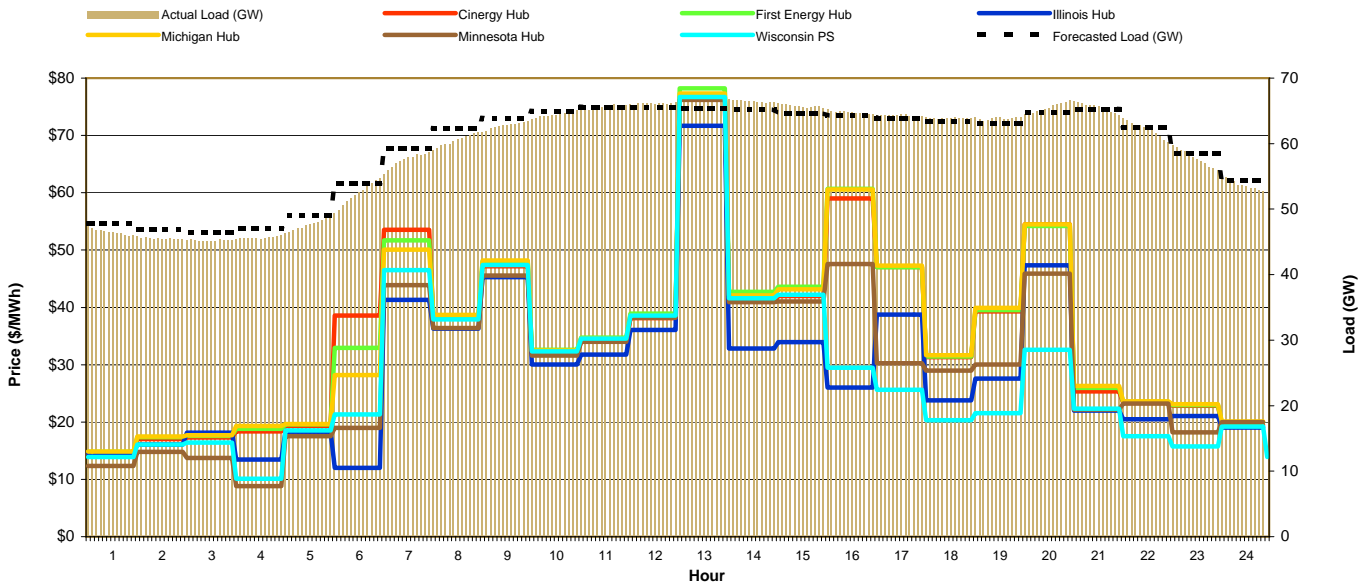




MISO Daily Report

Tuesday April 6, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$			
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk		
Cinergy Hub	17.90	16.59	16.24	16.48	19.28	31.02	32.51	31.82	33.25	36.61	38.75	40.86	45.94	45.83	43.20	45.51	44.41	36.47	33.90	41.88	37.63	26.04	20.08	19.33	32.15	37.64		
First Energy Hub	18.20	16.66	16.23	16.44	19.36	29.01	30.70	31.85	32.81	36.45	37.64	36.87	40.83	40.92	40.53	41.15	39.37	32.43	30.45	37.40	33.75	26.52	20.54	19.34	30.23	34.97		
Illinois Hub	12.24	11.22	10.74	10.43	11.72	18.15	23.96	28.61	30.20	32.80	34.41	33.79	38.42	38.49	36.92	39.24	36.31	31.06	28.20	36.94	31.11	24.57	18.92	14.48	26.37	32.50		
Michigan Hub	18.45	17.68	17.53	18.02	20.81	31.18	33.27	32.20	33.33	36.77	38.03	37.29	41.30	41.32	40.87	41.36	39.55	32.65	30.83	37.61	33.99	26.78	20.36	19.20	30.85	35.27		
Minnesota Hub	13.96	12.32	11.06	10.62	12.66	18.53	22.14	31.13	34.35	38.13	40.08	37.35	38.80	38.18	34.42	31.36	29.14	24.84	24.87	28.05	29.93	21.50	15.84	15.04	25.60	31.12		
Wisconsin PS	15.33	13.42	12.47	11.78	13.51	21.63	26.90	31.16	32.76	36.70	38.71	39.74	46.60	44.35	42.64	39.47	37.19	31.39	29.20	37.43	33.97	25.00	19.30	16.59	29.05	35.35		
Cleared Load (GW)	46.5	45.7	45.3	45.5	48.0	57.7	64.2	66.4	67.8	68.2	68.8	68.6	68.8	69.1	68.5	67.7	67.1	66.3	66.3	68.1	67.3	63.2	55.5	5.0				

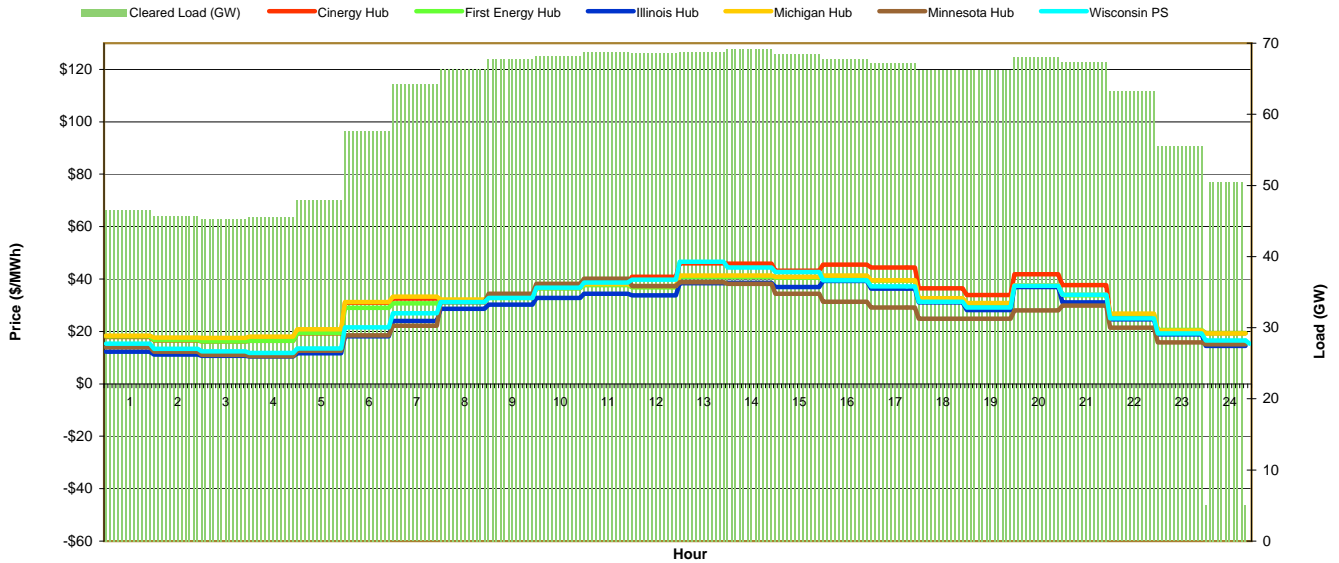

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$			
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk		
Cinergy Hub	19.32	15.48	16.11	16.93	18.06	18.93	23.95	25.25	26.85	62.51	31.23	87.47	67.29	36.51	28.14	31.11	32.95	31.75	23.59	84.83	26.51	20.95	17.83	21.17	32.70	39.67		
First Energy Hub	19.76	15.81	16.44	17.28	18.40	19.21	24.34	25.83	27.65	63.15	32.22	88.84	67.94	41.57	30.12	31.66	33.33	31.62	24.24	80.60	26.49	19.48	18.29	21.70	33.17	40.19		
Illinois Hub	18.45	14.87	15.41	16.14	17.19	18.08	22.86	23.94	22.36	39.21	27.41	78.40	61.93	39.87	28.01	27.57	27.07	27.72	23.27	58.09	22.55	4.12	17.15	20.55	28.01	33.04		
Michigan Hub	19.98	15.98	16.63	17.45	18.58	19.31	24.23	25.79	27.77	63.61	32.34	89.53	68.13	41.30	29.90	31.54	33.31	31.61	24.12	76.28	25.98	19.38	18.21	21.62	33.02	39.93		
Minnesota Hub	27.31	12.46	15.63	25.97	27.73	31.15	31.38	45.06	36.69	62.97	33.32	84.48	62.80	23.36	23.92	21.09	23.81	17.34	11.91	29.76	22.41	15.81	16.41	18.65	30.06	33.20		
Wisconsin PS	20.03	14.27	15.81	17.73	18.94	20.27	23.75	25.58	27.12	39.29	31.54	70.17	50.42	53.10	12.31	29.53	27.44	25.79	32.81	94.96	24.10	-48.63	4.38	11.62	26.76	31.24		
Forecasted Load (GW)	51.8	50.1	49.3	49.5	51.3	55.6	60.5	63.5	64.9	66.2	67.1	67.7	68.2	68.5	68.2	68.0	67.7	66.8	65.8	67.1	67.3	63.9	59.5	55.1				
Forecast Error %	-1.8%	-1.4%	-1.7%	-1.8%	-1.5%	-0.3%	0.4%	0.0%	0.7%	1.1%	1.0%	0.6%	0.5%	-0.3%	-0.5%	-1.0%	-1.3%	-0.5%	-0.1%	0.2%	-0.4%	-0.9%	-1.6%	-10.3%				

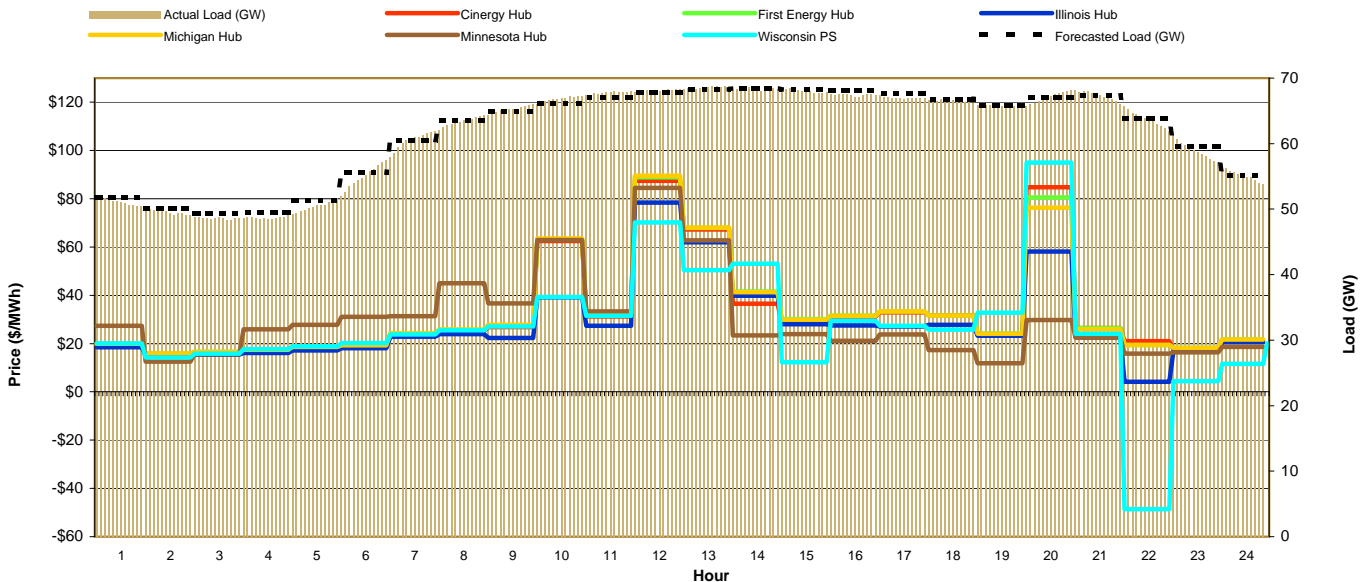




MISO Daily Report

Wednesday April 7, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	17.98	16.10	15.16	15.79	18.23	24.91	27.50	30.15	32.58	34.53	35.60	35.15	38.95	39.87	36.34	36.96	35.57	30.14	30.38	36.20	32.19	26.50	21.47	19.37	28.65	33.29
First Energy Hub	17.84	16.01	15.04	15.39	17.66	24.87	27.86	30.85	33.32	35.38	36.49	35.98	39.95	40.85	37.12	37.31	35.78	30.56	30.77	36.78	32.77	26.94	21.70	19.58	29.03	33.91
Illinois Hub	13.43	11.80	10.97	9.00	9.60	17.15	22.49	21.89	25.11	26.99	27.73	27.89	33.34	32.09	28.75	29.71	26.42	24.97	25.16	29.34	27.75	23.03	18.53	16.75	22.50	26.79
Michigan Hub	17.63	15.96	14.99	15.34	17.46	24.61	28.09	31.20	33.70	35.76	36.85	36.32	40.38	41.12	37.38	37.51	35.94	31.85	32.41	37.05	33.48	28.81	23.24	20.64	29.49	34.56
Minnesota Hub	16.38	14.82	14.16	14.37	16.92	18.31	29.32	37.97	37.56	38.16	37.95	36.20	36.25	35.24	31.85	30.66	28.89	24.89	26.45	33.11	33.29	25.13	18.48	17.13	27.23	32.01
Wisconsin PS	16.51	14.78	14.16	14.53	15.58	18.95	26.44	30.37	32.02	34.12	34.57	33.86	37.98	36.75	33.75	33.01	31.35	27.10	27.33	33.63	32.01	25.45	19.77	18.07	26.75	31.44
Cleared Load (GW)	47.7	46.5	45.9	46.5	48.8	56.5	62.5	64.0	64.9	66.0	66.3	66.6	66.5	66.2	65.6	64.8	64.2	63.4	63.3	65.3	64.1	60.1	53.8	4.9		

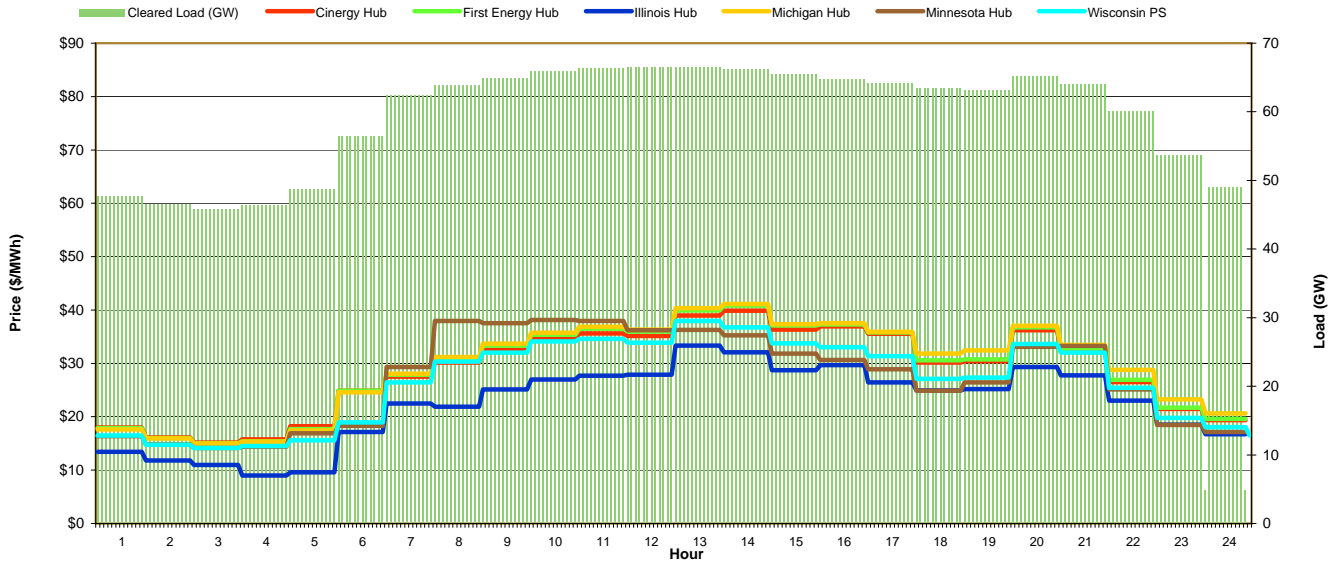

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	18.34	11.57	16.98	16.95	21.95	70.01	23.11	27.51	64.16	64.12	78.05	41.90	27.51	30.69	27.09	32.93	29.93	25.82	24.73	31.70	26.25	23.29	19.06	19.94	32.23	35.92
First Energy Hub	18.79	11.76	16.80	16.94	20.94	58.07	23.52	28.07	65.52	65.70	80.15	43.12	28.36	31.63	27.79	33.70	30.54	26.36	25.25	32.42	26.89	23.82	19.47	20.26	32.33	36.80
Illinois Hub	17.60	10.55	13.04	14.98	14.50	15.31	22.04	27.86	63.44	64.84	77.87	39.01	25.81	31.34	29.18	34.91	30.86	28.05	25.20	31.29	25.12	23.35	18.47	19.67	29.35	36.04
Michigan Hub	18.78	11.79	16.62	16.76	20.03	47.56	23.64	28.06	65.84	65.97	80.35	43.18	28.39	31.63	27.91	33.92	30.70	26.54	25.52	32.62	27.03	24.03	19.74	20.50	31.96	36.96
Minnesota Hub	17.10	10.54	14.22	14.18	16.48	22.39	21.48	22.82	58.33	62.43	67.14	33.68	18.84	19.54	15.61	19.05	16.79	16.69	18.41	26.53	24.29	18.96	17.46	12.05	24.38	28.54
Wisconsin PS	17.84	10.74	12.34	15.70	15.18	27.88	22.00	27.48	63.92	58.98	77.67	41.38	27.14	30.25	26.70	31.13	27.11	25.57	24.43	31.42	26.07	22.87	18.74	17.52	29.17	35.05
Forecasted Load (GW)	52.5	50.9	50.0	50.2	51.9	56.2	61.3	64.1	65.3	66.1	66.4	66.4	66.2	65.7	65.0	64.3	63.5	62.9	62.6	64.5	64.4	61.4	57.8	54.2		
Forecast Error %	-0.3%	-0.7%	-0.4%	-0.5%	-0.2%	0.8%	0.6%	0.4%	0.7%	1.1%	1.7%	1.7%	2.0%	2.3%	1.7%	1.9%	2.3%	2.7%	3.4%	2.1%	1.7%	1.4%	0.1%	-10.0%		

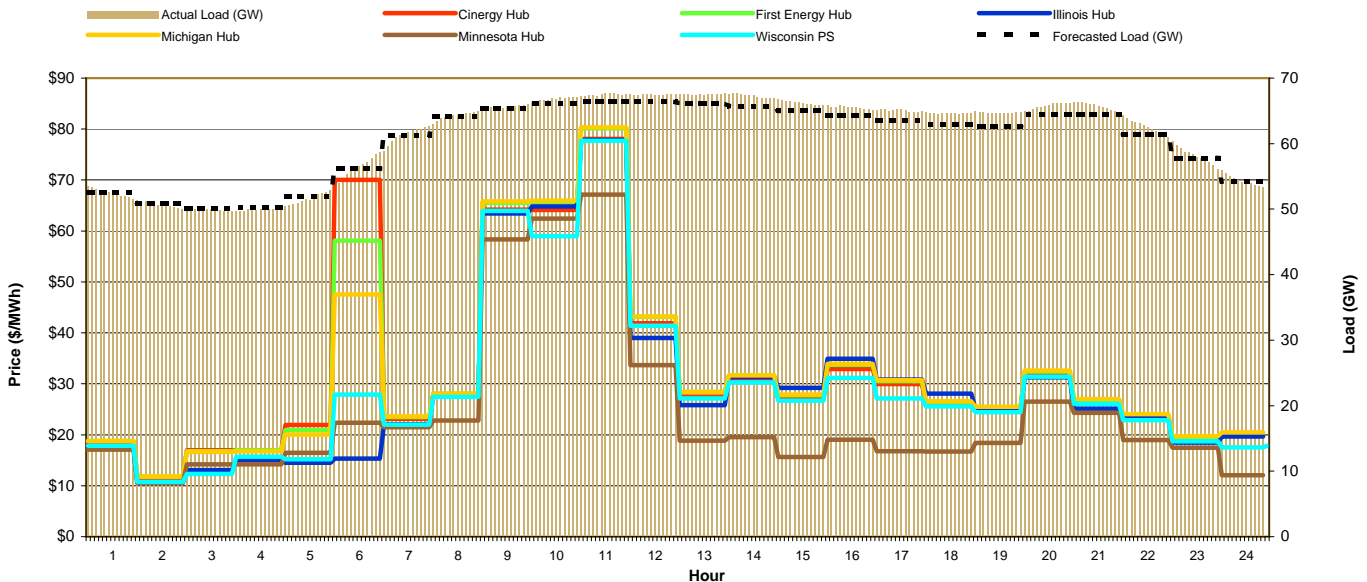




MISO Daily Report

Thursday April 8, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	18.63	17.79	17.54	17.64	19.29	27.64	36.45	41.04	41.26	42.08	41.65	41.79	42.41	41.51	35.58	34.45	32.45	29.71	31.82	41.79	39.66	28.00	22.86	21.05	31.84	36.75
First Energy Hub	18.70	17.80	17.54	17.63	19.35	27.35	37.48	42.02	41.91	42.62	42.20	42.43	42.85	42.37	36.35	34.91	32.97	30.06	32.18	42.84	40.77	28.69	23.39	21.40	32.33	37.41
Illinois Hub	15.93	15.02	14.73	14.86	16.17	22.15	35.21	39.36	39.05	37.71	36.70	36.79	36.16	39.54	34.08	32.43	30.61	25.40	27.11	40.04	38.09	25.78	20.94	17.71	28.82	33.74
Michigan Hub	18.23	17.30	17.04	17.14	18.86	26.33	37.91	42.50	42.38	43.10	42.67	42.91	43.33	42.85	36.75	35.30	33.34	30.39	32.54	43.32	41.22	29.01	23.31	21.32	32.46	37.81
Minnesota Hub	16.26	15.14	14.90	15.00	16.81	22.42	35.03	39.64	39.72	39.44	38.46	37.04	36.23	33.22	30.28	30.22	28.73	26.95	28.33	32.20	37.35	27.13	20.82	19.07	28.35	32.86
Wisconsin PS	16.22	14.66	14.51	14.66	16.33	21.76	38.24	40.62	41.22	42.95	43.35	45.30	46.30	49.24	39.82	36.29	34.38	30.97	34.07	52.40	41.58	29.27	23.25	21.27	32.86	39.44
Cleared Load (GW)	48.7	47.4	47.0	47.5	50.5	59.5	63.5	64.6	65.8	66.3	66.5	66.4	66.2	65.2	64.5	64.1	63.9	63.3	63.5	65.9	64.9	62.2	57.1	5.3		

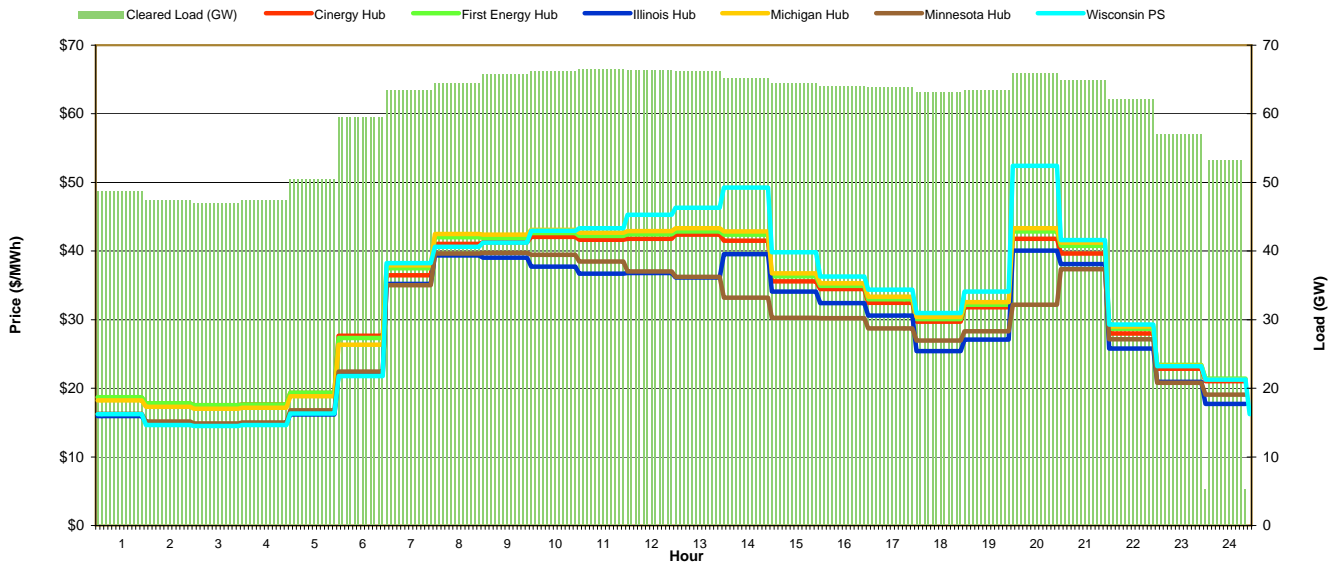

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	19.14	16.26	16.02	20.59	26.33	28.86	35.07	29.61	28.25	31.54	27.33	26.02	27.08	28.93	24.38	22.72	23.65	23.16	21.39	30.05	32.37	23.89	27.20	21.64	25.48	26.72
First Energy Hub	19.78	16.66	16.28	21.32	27.65	29.53	35.81	30.31	28.98	32.46	28.20	26.79	27.87	29.75	25.02	23.25	24.23	23.68	21.83	30.59	32.91	24.30	27.71	22.07	26.12	27.37
Illinois Hub	15.77	14.72	15.53	15.69	16.27	27.71	33.79	28.56	27.27	30.26	26.32	25.06	26.12	28.26	23.89	22.28	22.76	22.81	20.55	23.84	30.86	22.96	22.29	20.75	23.51	25.26
Michigan Hub	20.07	16.95	16.59	21.65	28.08	29.91	36.56	30.86	29.35	32.84	28.52	27.16	28.30	30.28	25.41	23.51	24.48	23.92	22.05	30.86	33.25	24.48	27.98	22.38	26.48	27.70
Minnesota Hub	17.03	14.77	15.43	16.33	19.93	37.50	53.36	40.39	32.44	32.45	33.35	27.19	26.82	31.13	21.86	20.76	21.52	20.94	19.79	28.36	32.07	23.75	26.10	20.86	26.42	27.43
Wisconsin PS	16.10	15.05	15.91	16.04	16.78	28.65	35.53	30.34	29.05	32.31	27.95	26.42	27.36	29.21	25.41	22.96	23.68	23.18	21.41	30.24	33.16	24.44	27.32	21.73	25.01	27.15
Forecasted Load (GW)	52.5	51.1	50.5	50.9	53.1	57.5	62.8	65.9	66.9	67.3	67.1	66.8	66.4	65.8	64.7	63.9	63.5	63.2	63.2	65.4	65.8	62.7	59.0	55.6		
Forecast Error %	-1.6%	-2.1%	-1.9%	-2.1%	-2.4%	-1.0%	-1.0%	-2.0%	-1.6%	-1.1%	-0.5%	-0.5%	-0.4%	-0.4%	-0.3%	-0.7%	-0.7%	-0.6%	-0.6%	-1.1%	-0.3%	0.1%	-0.6%	-10.2%		

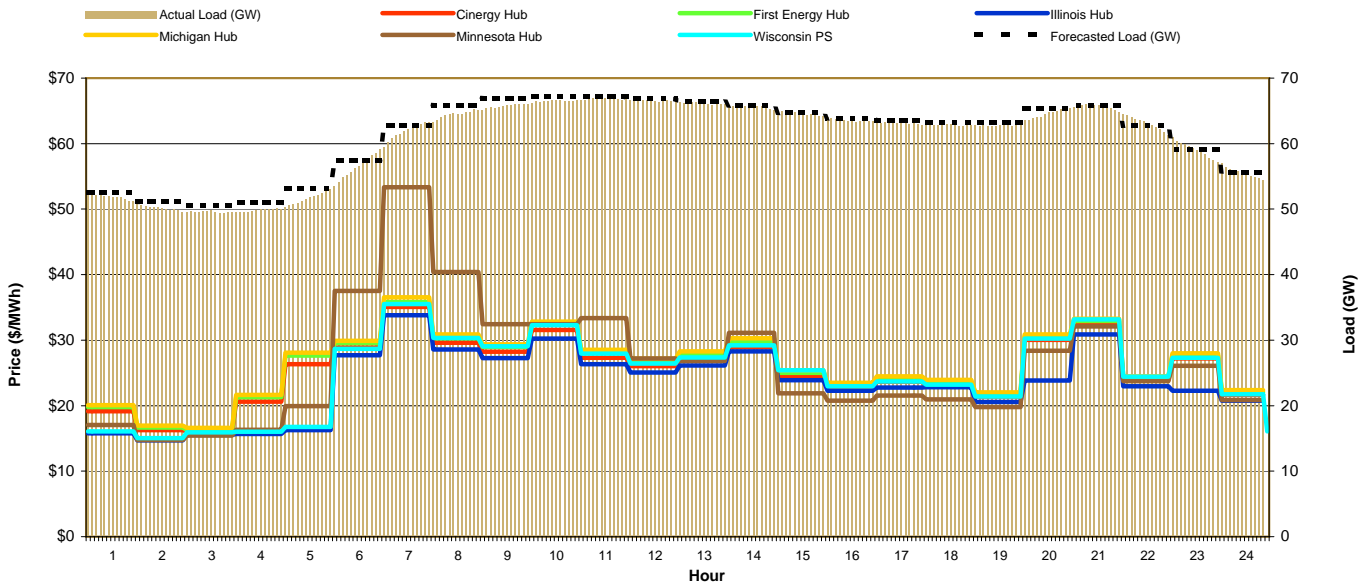




MISO Daily Report

Friday April 9, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	21.35	20.05	19.91	20.42	23.24	34.74	36.38	35.15	35.87	35.19	34.30	31.42	32.15	30.08	26.09	25.27	24.39	23.61	24.23	34.23	30.82	25.13	23.22	22.82	27.92	29.45
First Energy Hub	21.63	20.27	20.10	20.58	23.07	34.29	37.43	36.20	36.97	36.24	35.32	32.34	33.08	30.95	26.83	25.94	25.01	24.28	24.91	35.19	31.68	25.84	23.73	22.88	28.53	30.28
Illinois Hub	19.66	18.00	17.26	16.23	15.73	21.95	34.21	33.17	33.78	32.55	31.74	29.26	30.23	28.32	24.49	23.41	22.06	22.34	22.95	32.55	29.28	23.85	21.54	19.50	25.17	27.60
Michigan Hub	21.46	20.05	19.85	20.37	22.77	33.67	37.86	36.64	37.43	36.67	35.74	32.73	33.47	31.32	27.15	26.25	25.30	24.56	25.20	35.60	32.05	26.15	23.54	22.32	28.67	30.61
Minnesota Hub	18.90	17.50	17.58	18.00	19.43	28.74	41.63	43.59	46.67	45.34	43.11	38.26	36.21	33.90	29.66	28.03	26.64	24.28	24.97	34.65	31.46	24.85	22.39	19.36	29.80	33.38
Wisconsin PS	19.55	18.01	17.94	18.17	19.07	26.34	37.41	35.45	37.43	34.98	34.78	31.61	33.79	31.20	26.39	26.95	25.91	24.95	25.57	36.01	32.43	26.41	23.37	20.79	27.69	30.45
Cleared Load (GW)	50.9	49.8	49.8	50.5	53.7	60.6	64.6	65.8	65.9	66.2	65.6	65.3	64.5	64.1	62.0	60.9	60.0	59.0	59.3	62.6	61.9	58.4	53.6	5.1		

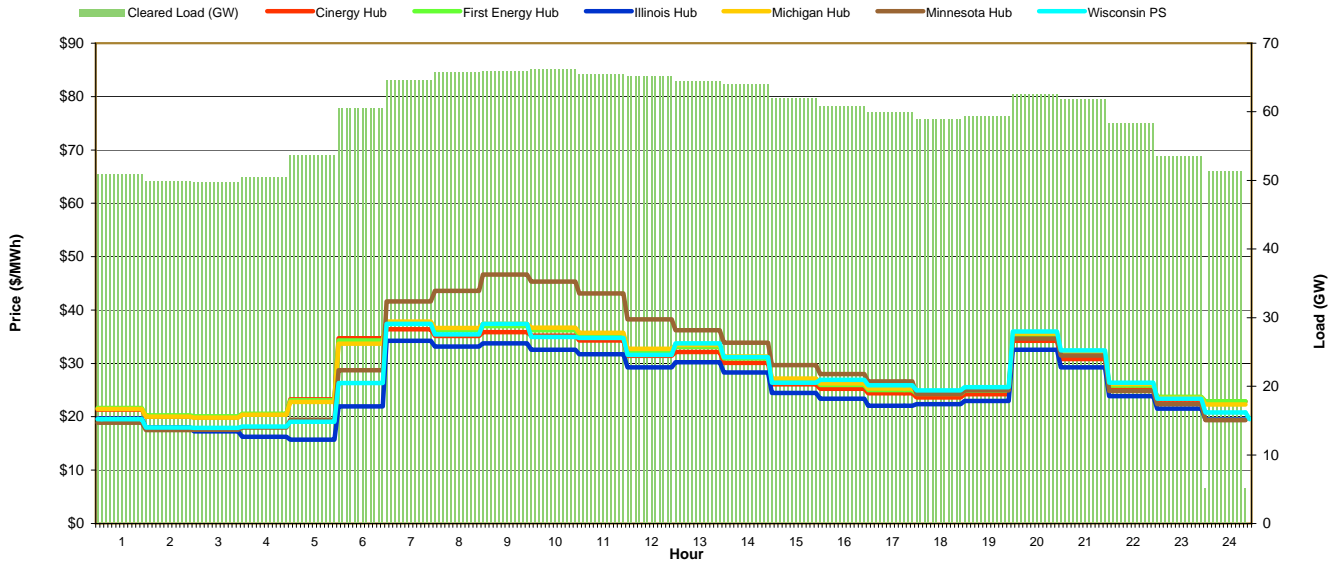

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	19.87	16.73	18.13	19.51	20.56	22.09	31.35	31.61	35.96	64.63	27.11	25.91	28.08	29.57	26.38	24.26	23.93	22.54	21.91	58.32	48.98	25.81	41.21	31.53	29.83	33.51
First Energy Hub	20.27	17.02	18.41	19.79	20.76	22.23	31.56	32.00	36.61	65.87	27.74	26.50	28.77	30.24	26.99	24.86	24.52	23.06	22.38	59.17	49.59	26.14	41.80	25.24	30.06	34.14
Illinois Hub	19.10	16.20	17.55	18.85	19.81	21.28	30.22	30.46	34.74	62.92	26.33	25.16	27.22	28.65	25.55	23.26	22.92	21.65	20.98	55.01	47.35	25.77	40.84	31.33	28.88	32.43
Michigan Hub	20.57	17.36	18.79	20.16	21.17	22.57	31.91	32.35	37.09	66.64	28.19	27.04	29.36	31.00	27.60	25.25	24.85	23.33	22.64	60.24	50.57	26.60	42.42	32.50	30.84	34.70
Minnesota Hub	19.17	16.07	17.31	18.34	19.23	20.84	47.01	54.52	68.85	82.41	77.09	69.12	68.12	48.82	49.37	29.59	29.63	28.44	26.14	56.15	48.05	23.96	31.79	23.10	40.55	49.50
Wisconsin PS	19.95	16.76	18.13	19.37	20.39	21.97	33.37	34.06	39.03	68.72	33.41	31.36	33.08	32.63	29.53	24.99	24.43	21.96	17.46	51.43	48.32	26.36	31.61	25.06	30.14	34.27
Forecasted Load (GW)	54.0	52.9	52.6	53.1	55.1	59.4	64.5	66.5	66.4	66.2	65.6	64.7	63.9	62.6	61.1	59.8	58.8	57.7	57.8	60.1	61.1	59.3	55.4	51.8		
Forecast Error %	-1.9%	-2.4%	-2.6%	-2.4%	-1.6%	-0.7%	-1.0%	-0.9%	0.0%	0.8%	1.5%	2.1%	2.3%	3.2%	3.7%	3.6%	3.7%	3.9%	2.9%	1.7%	2.1%	1.2%	1.9%	-6.7%		

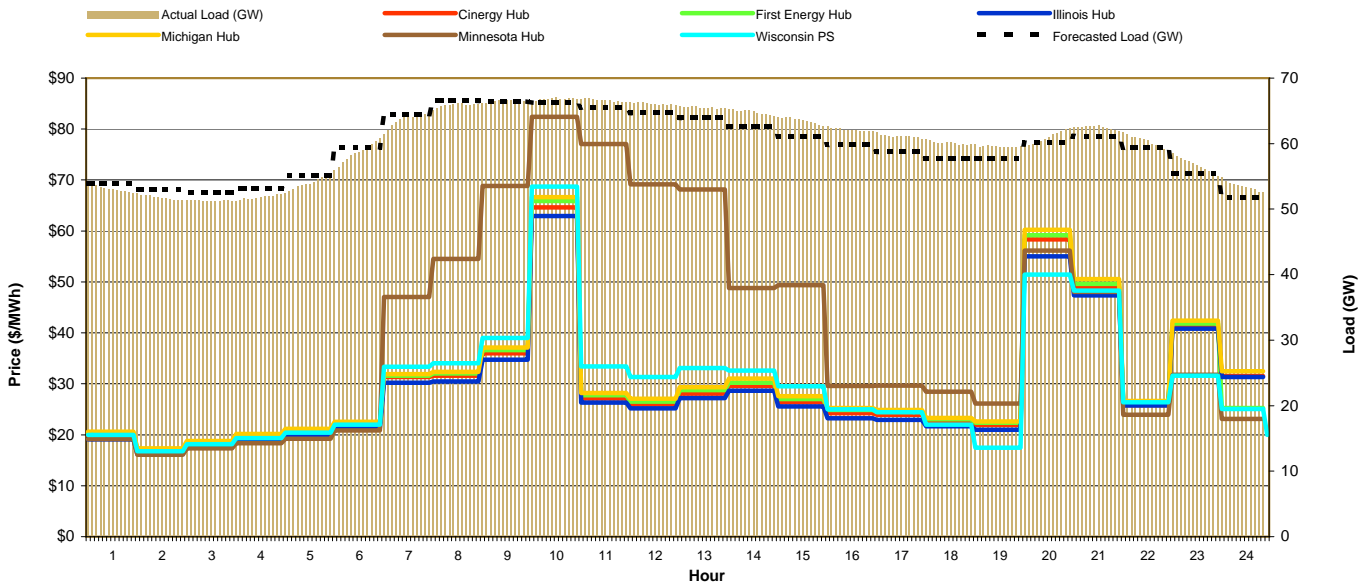




MISO Daily Report

Saturday April 10, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
																									All	On Pk		
Cinergy Hub	21.27	20.89	20.90	20.78	21.34	23.53	24.77	28.79	34.44	35.57	34.38	35.34	29.98	27.35	25.28	24.96	25.31	25.04	25.89	36.41	34.85	27.56	22.94	20.92	27.02	29.63	27.02	29.63
First Energy Hub	22.20	21.53	21.49	21.45	22.13	24.35	25.29	29.40	35.17	36.31	35.10	36.07	30.60	27.92	25.80	25.47	25.83	25.55	26.42	37.15	35.57	28.12	23.43	21.37	27.66	30.24	27.66	30.24
Illinois Hub	21.48	20.30	20.41	20.83	22.10	25.67	23.73	27.35	32.72	33.81	32.67	33.61	28.51	25.99	24.05	23.77	24.08	23.81	24.64	34.68	33.18	26.28	22.14	20.21	26.08	28.21	26.08	28.21
Michigan Hub	20.76	20.51	20.37	20.40	21.13	23.25	25.03	29.09	34.80	35.94	34.74	35.70	30.29	27.63	25.54	25.22	25.57	25.29	26.15	36.78	35.21	27.84	23.48	21.41	27.17	29.95	27.17	29.95
Minnesota Hub	19.00	18.24	18.10	18.15	18.39	21.13	29.60	34.36	44.45	46.70	45.21	45.86	37.25	33.98	29.72	28.32	29.05	28.59	29.59	41.18	43.84	27.37	22.13	19.98	30.42	35.48	30.42	35.48
Wisconsin PS	19.80	19.16	18.98	19.12	19.41	21.97	24.40	28.01	34.41	36.24	35.04	36.04	30.39	27.74	25.52	25.10	25.48	25.17	26.02	36.56	35.46	27.29	22.37	20.44	26.67	29.80	26.67	29.80
Cleared Load (GW)	48.0	47.2	46.5	46.7	48.1	51.4	53.2	55.3	56.0	56.8	56.6	55.7	55.3	54.4	53.5	53.3	53.7	53.3	54.2	57.4	56.6	54.4	50.3	4.7				

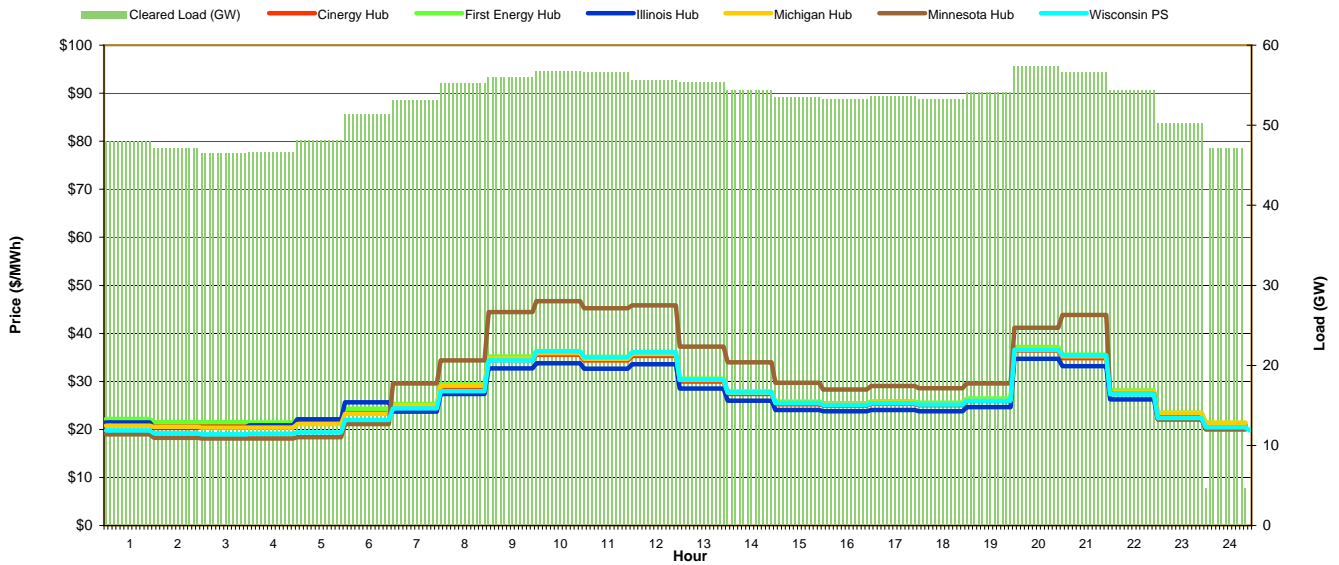

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
																									All	On Pk		
Cinergy Hub	21.94	22.49	21.95	20.95	19.24	34.24	23.58	62.98	93.27	27.76	67.23	42.82	25.26	43.26	23.01	23.56	24.88	24.59	21.28	47.51	26.28	29.86	24.13	19.41	32.98	37.98	32.98	37.98
First Energy Hub	22.28	22.91	22.34	21.34	19.63	24.70	21.72	54.15	82.27	28.13	67.97	43.55	25.69	39.48	21.79	23.91	25.26	24.90	21.57	48.15	26.64	30.35	24.53	19.80	31.79	36.77	31.79	36.77
Illinois Hub	21.47	21.47	20.89	21.46	18.75	33.19	23.37	62.47	89.76	26.85	64.95	41.50	24.48	41.96	22.18	22.86	24.12	23.87	20.69	45.87	25.55	28.78	23.13	18.83	32.02	36.81	32.02	36.81
Michigan Hub	22.66	23.21	22.64	21.61	19.86	35.14	24.06	64.29	95.69	28.46	69.11	43.88	25.97	44.31	23.54	24.03	25.42	25.09	21.78	48.33	26.80	30.62	24.72	19.74	33.79	38.88	33.79	38.88
Minnesota Hub	18.75	19.45	26.90	16.16	16.54	30.69	22.25	60.31	87.94	27.11	65.82	41.97	24.82	42.78	22.35	22.60	23.87	23.61	20.53	46.34	26.21	29.63	23.71	19.16	31.65	36.85	31.65	36.85
Wisconsin PS	21.54	21.81	22.28	20.13	18.62	33.41	23.91	64.52	92.71	28.06	68.26	43.36	25.64	43.99	23.29	23.69	25.02	24.79	21.50	48.35	27.08	30.50	24.36	19.57	33.18	38.44	33.18	38.44
Forecasted Load (GW)	50.8	50.2	49.7	49.6	50.2	51.5	53.4	55.3	56.9	57.6	57.7	57.1	56.3	55.4	54.6	54.2	54.1	54.1	54.6	56.7	57.4	55.7	52.4	49.3				
Forecast Error %	0.3%	-1.3%	-1.8%	-1.4%	-1.0%	0.5%	-0.1%	-0.3%	0.5%	0.8%	0.2%	0.0%	0.6%	0.5%	0.4%	1.3%	1.1%	0.0%	-0.7%	0.3%	-0.5%	-0.5%	-9.9%					

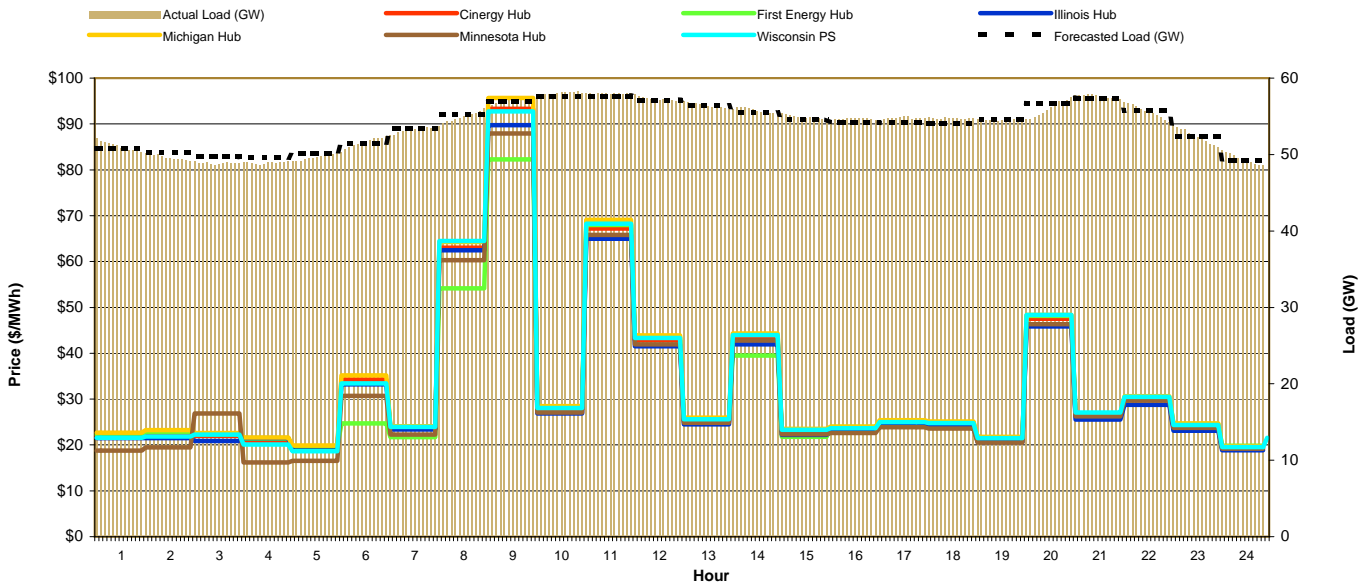




MISO Daily Report

Sunday April 11, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$			
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk		
Cinergy Hub	21.03	20.67	20.43	20.41	20.49	21.05	21.65	23.31	25.68	26.23	26.79	26.36	25.78	25.12	24.46	24.46	24.86	25.17	26.67	36.97	31.17	25.95	22.92	20.62	24.51	26.37		
First Energy Hub	21.83	21.26	21.01	20.93	21.08	21.66	22.43	23.81	26.23	26.78	27.35	26.90	26.31	25.63	24.96	24.96	25.37	25.69	27.21	37.73	31.81	26.47	23.37	20.94	25.07	26.91		
Illinois Hub	22.00	22.00	21.59	21.21	21.67	21.58	22.25	22.17	24.43	24.99	25.52	25.10	24.56	23.94	23.30	23.31	23.69	23.98	25.42	35.25	29.73	24.79	22.05	19.50	23.92	25.14		
Michigan Hub	20.79	20.82	20.59	20.69	20.64	21.23	21.18	23.56	25.95	26.50	27.07	26.63	26.05	25.37	24.71	24.71	25.12	25.43	26.94	37.35	31.49	26.21	23.32	20.86	24.72	26.65		
Minnesota Hub	17.70	16.87	16.89	16.51	16.86	18.29	20.71	25.49	29.09	28.62	32.22	31.29	30.51	29.22	28.05	27.55	28.06	28.70	31.21	46.61	38.02	26.34	18.37	16.43	25.82	29.96		
Wisconsin PS	20.05	19.44	19.29	18.99	19.52	20.11	20.98	22.73	24.96	26.15	27.08	26.60	26.02	25.34	24.63	24.59	24.99	25.32	26.92	37.67	31.60	25.75	21.00	18.53	24.09	26.33		
Cleared Load (GW)	45.6	44.6	44.0	44.0	45.1	47.2	48.1	50.9	53.2	53.7	54.0	54.1	54.0	53.7	53.0	53.0	53.7	54.1	55.0	59.0	59.3	55.6	51.0	4.8				

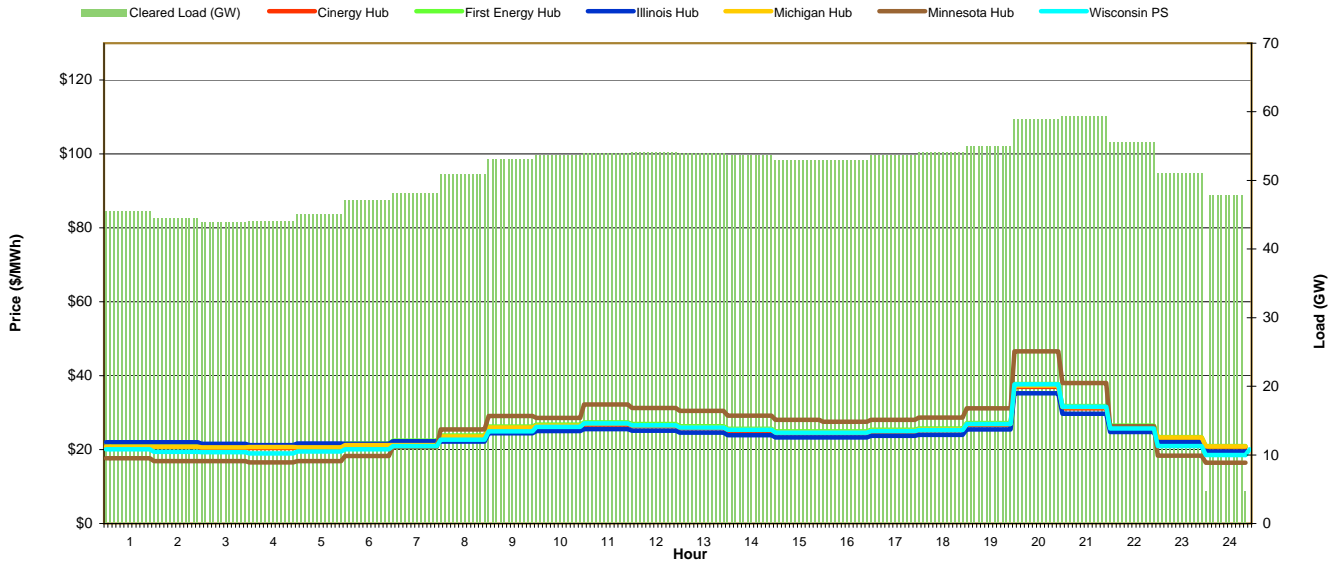

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$			
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk		
Cinergy Hub	21.32	20.53	19.66	20.16	20.88	22.38	16.81	20.47	35.40	26.39	25.60	24.92	26.88	26.70	36.14	25.56	44.68	25.63	24.05	120.19	54.00	24.88	24.38	19.24	30.29	35.37		
First Energy Hub	21.75	20.94	20.05	20.51	21.26	22.70	12.99	20.67	18.54	26.29	25.69	24.79	17.20	17.80	24.89	25.44	45.01	25.56	24.25	121.29	54.59	25.20	24.74	19.57	28.41	32.62		
Illinois Hub	20.65	19.90	18.98	19.36	19.99	21.60	16.25	19.71	34.29	25.68	24.87	24.15	26.09	25.96	35.07	24.73	43.17	24.78	23.20	115.62	53.39	24.27	26.48	19.53	29.49	34.47		
Michigan Hub	21.75	21.00	20.11	20.55	21.32	22.79	17.10	20.71	35.78	26.77	26.02	25.24	27.25	27.03	36.53	25.91	45.39	25.99	24.33	121.84	54.96	25.32	24.77	19.59	30.75	35.87		
Minnesota Hub	20.54	19.39	18.44	18.69	19.22	20.81	15.83	19.58	44.54	26.12	27.59	24.70	26.94	26.78	35.07	25.11	44.16	26.49	24.38	114.66	49.10	26.49	16.76	15.51	29.45	34.90		
Wisconsin PS	21.20	20.26	19.32	19.67	20.41	22.05	16.64	20.52	35.75	26.84	26.00	25.23	27.17	26.92	36.22	25.61	44.78	25.83	24.28	121.29	54.99	25.36	24.41	18.98	30.40	35.70		
Forecasted Load (GW)	48.5	47.2	46.4	46.1	46.6	47.9	48.8	50.1	52.2	53.6	54.3	54.6	54.6	54.3	54.0	54.1	54.5	55.0	56.2	58.7	59.8	57.7	53.9	51.2				
Forecast Error %	-3.0%	-2.9%	-2.6%	-2.3%	-2.4%	-2.2%	-2.2%	-0.9%	-1.0%	-1.2%	-1.2%	-1.0%	-0.6%	-1.0%	-0.6%	-0.4%	0.1%	0.1%	-1.3%	-1.5%	-0.2%	-1.4%	-1.3%	-13.0%				

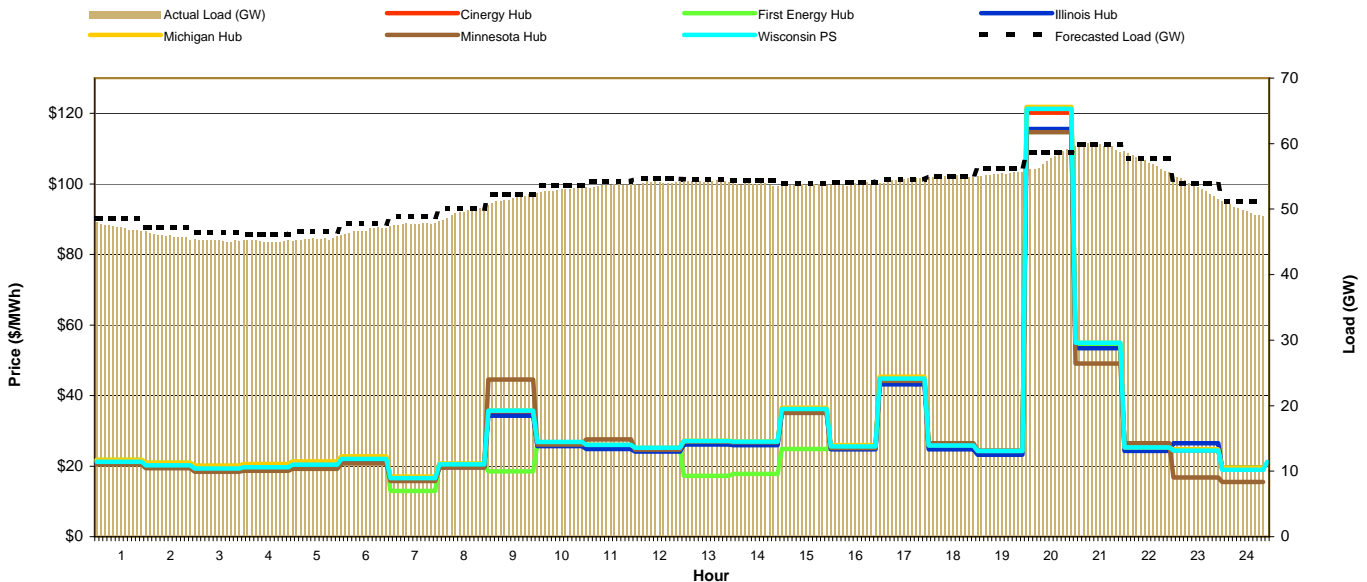




MISO Daily Report

Monday April 12, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	20.56	20.22	20.25	20.69	23.47	34.77	35.63	39.75	42.37	42.75	42.29	43.60	43.39	41.52	36.69	34.30	32.10	27.96	28.15	39.08	36.35	25.60	24.21	21.07	32.37	36.26
First Energy Hub	20.83	20.20	20.20	20.75	23.04	33.45	35.70	37.55	40.36	41.03	40.62	41.59	41.33	39.42	35.16	33.05	30.92	27.65	28.59	39.63	36.84	26.06	24.49	21.39	31.66	35.27
Illinois Hub	18.80	17.76	17.62	18.50	19.00	25.54	31.64	33.84	38.45	38.26	37.93	38.54	38.11	36.24	32.22	30.53	28.58	25.81	26.69	37.05	34.42	24.36	22.21	19.69	28.82	32.70
Michigan Hub	20.34	19.86	19.82	20.47	22.31	31.82	35.02	37.18	40.53	41.25	40.78	41.18	40.89	38.92	34.69	32.63	30.47	27.32	28.20	40.06	36.27	25.67	24.42	21.34	31.31	35.03
Minnesota Hub	17.14	16.13	16.05	16.22	17.96	23.93	34.02	38.91	46.57	47.51	47.34	47.14	43.30	36.84	34.10	30.46	27.85	30.36	28.90	33.78	32.53	21.42	17.29	15.79	30.06	35.27
Wisconsin PS	18.81	17.97	17.71	18.36	19.68	25.48	31.74	33.82	39.21	40.42	40.24	40.84	38.85	35.11	32.37	29.69	27.46	26.30	26.19	34.34	32.26	23.36	21.37	19.10	28.78	32.61
Cleared Load (GW)	46.9	46.2	46.2	47.2	50.3	57.1	61.0	62.7	63.8	64.4	64.5	64.1	64.3	64.2	63.2	63.0	62.7	61.5	62.1	64.6	63.7	60.0	55.3	5.1		

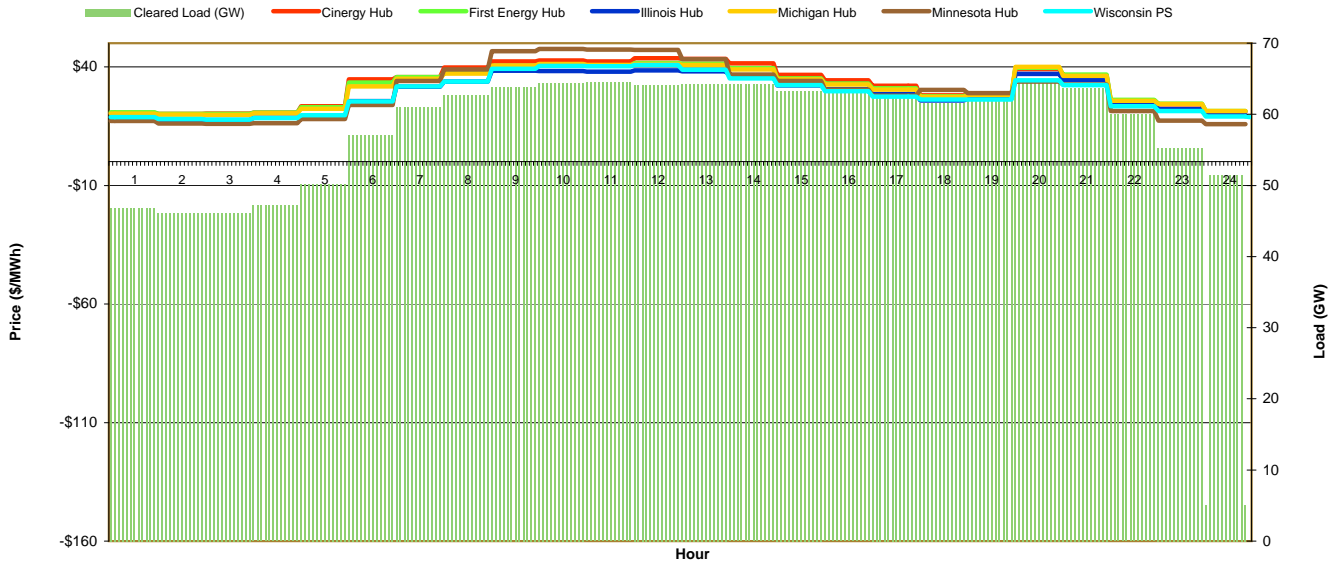

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	20.12	21.89	18.52	19.87	39.15	35.28	39.39	29.36	26.43	29.16	26.61	33.56	29.37	31.05	39.57	24.99	34.41	25.30	25.43	26.77	24.54	22.06	34.19	20.46	28.23	28.93
First Energy Hub	20.57	22.47	18.97	20.21	40.11	35.37	39.72	29.71	26.85	29.68	27.09	34.17	29.87	31.48	40.07	25.33	34.81	25.54	25.71	27.13	24.82	22.37	28.47	15.29	28.16	28.94
Illinois Hub	12.43	7.82	10.79	20.02	18.65	28.58	39.29	28.22	25.31	27.84	25.48	32.93	28.87	31.91	41.36	24.53	33.18	24.79	25.36	27.40	23.63	21.70	-13.26	-18.77	22.00	25.58
Michigan Hub	21.06	23.36	19.53	20.42	41.62	36.44	40.41	30.28	27.18	29.96	27.42	34.69	30.40	31.99	40.72	25.61	35.11	25.82	25.96	27.34	25.03	22.53	19.74	3.86	27.77	28.74
Minnesota Hub	11.28	6.64	9.27	14.44	8.89	18.34	21.33	26.93	24.33	26.58	24.36	28.87	25.18	23.19	27.73	21.42	30.77	21.79	20.60	19.68	22.58	18.87	-3.60	-152.43	12.38	22.46
Wisconsin PS	10.85	4.59	9.02	19.24	14.30	25.85	21.28	29.38	26.54	29.18	26.76	33.69	29.40	31.11	39.57	24.88	34.30	25.32	25.35	26.75	24.71	22.16	2.50	-75.61	19.21	26.97
Forecasted Load (GW)	49.4	48.5	48.3	49.0	51.3	56.2	61.3	64.0	65.3	66.1	66.5	66.6	66.5	66.2	65.6	65.0	64.5	63.8	63.6	65.2	65.8	62.6	58.5	54.5		
Forecast Error %	-3.0%	-3.1%	-3.2%	-3.2%	-2.1%	-0.7%	-0.8%	-1.1%	-1.4%	-1.1%	-0.9%	-0.6%	-0.4%	0.2%	0.3%	-0.2%	-0.2%	0.0%	0.5%	0.4%	-0.1%	-0.7%	-2.5%	-12.8%		

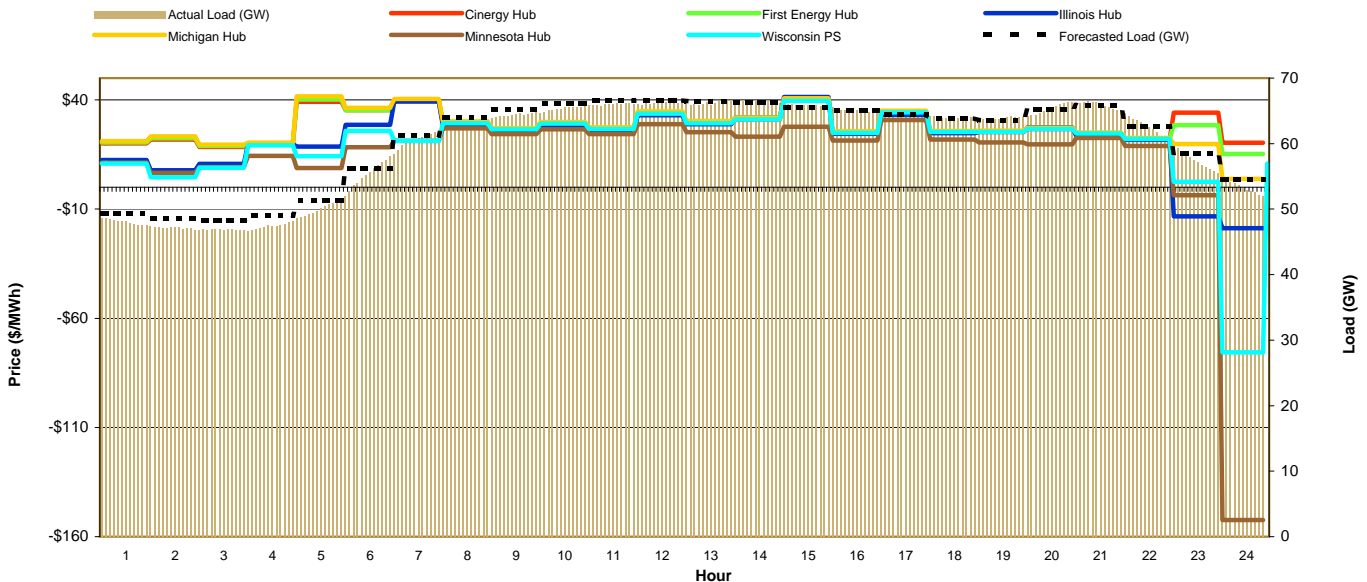




MISO Daily Report

Tuesday April 13, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	20.83	19.99	19.81	20.13	22.90	32.50	33.83	36.12	36.86	38.41	38.35	39.49	40.57	40.93	36.48	34.98	32.81	28.58	28.79	39.34	35.87	26.03	23.50	20.95	31.17	34.82
First Energy Hub	20.98	20.25	19.99	20.46	23.22	33.02	34.13	36.40	37.40	38.93	38.69	39.75	41.13	41.50	37.04	35.45	33.22	29.03	29.25	39.95	36.43	26.46	23.90	21.31	31.58	35.28
Illinois Hub	18.57	17.14	17.16	16.81	17.66	31.62	33.54	34.70	35.93	38.14	37.99	38.77	40.81	40.71	35.88	34.30	31.33	27.69	27.72	38.01	34.62	25.11	22.77	20.33	29.89	34.03
Michigan Hub	21.28	20.64	20.29	20.91	23.74	33.66	34.74	37.06	38.48	40.53	40.40	41.09	41.98	42.23	37.62	35.95	33.62	29.35	29.54	40.90	36.80	26.77	24.22	21.62	32.23	36.03
Minnesota Hub	16.45	16.52	16.64	15.87	17.44	23.31	32.46	42.47	37.83	37.39	35.98	37.87	37.37	38.30	33.65	30.67	29.73	26.67	27.10	31.87	29.87	22.98	19.23	17.41	28.13	32.44
Wisconsin PS	17.71	16.41	16.33	16.36	18.03	24.82	30.97	35.72	36.92	38.54	37.82	38.69	40.54	41.09	36.03	33.71	30.71	26.94	26.89	35.90	33.05	24.62	21.77	19.77	29.14	33.68
Cleared Load (GW)	48.5	47.4	47.2	47.7	51.1	59.4	62.5	63.8	65.1	65.9	66.2	66.1	66.0	65.9	64.9	64.5	64.0	63.3	63.4	65.9	65.4	60.8	55.7	5.2		

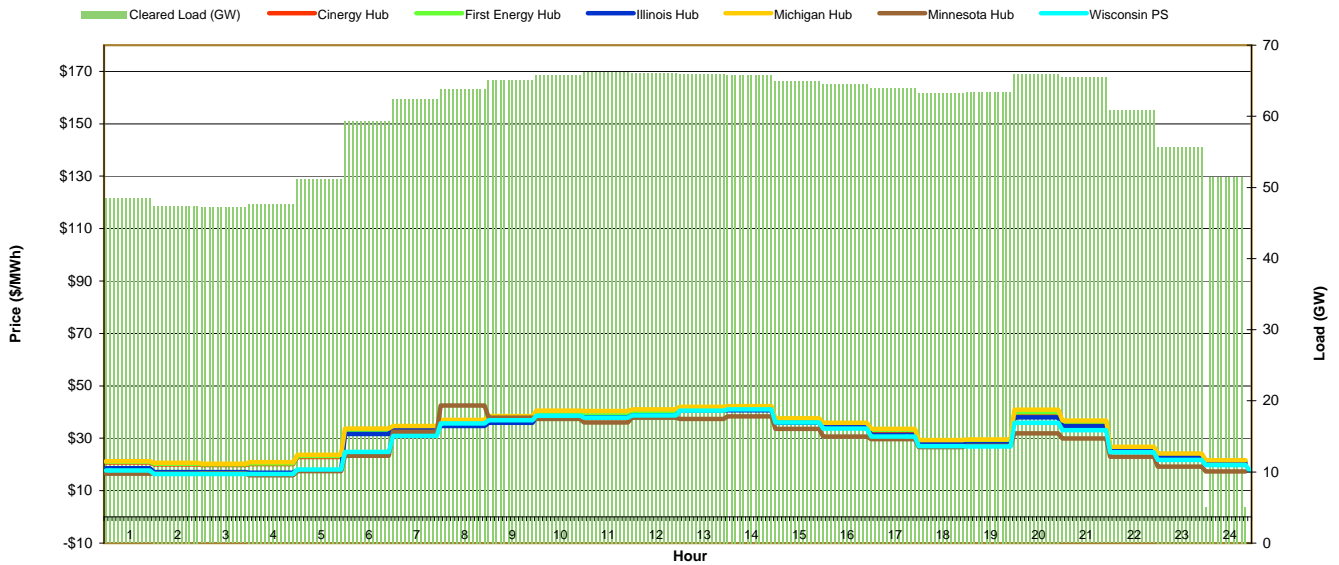

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	26.63	29.75	28.84	18.02	31.55	103.17	95.67	27.55	26.89	43.87	40.79	56.86	83.97	72.05	50.09	47.68	45.85	47.37	27.09	172.71	36.98	26.50	28.16	28.12	49.84	52.15
First Energy Hub	23.33	26.16	25.42	15.23	21.78	77.98	95.85	27.93	27.32	44.55	41.44	52.18	76.59	73.02	50.12	48.05	46.21	47.85	26.41	171.52	37.33	26.76	20.83	21.01	46.87	51.13
Illinois Hub	-2.01	5.94	5.81	3.52	24.74	43.86	92.02	26.95	26.66	48.92	45.37	57.10	58.48	79.44	59.21	61.54	51.60	53.58	24.03	163.42	37.58	26.57	2.46	4.08	41.70	51.43
Michigan Hub	18.72	22.16	21.14	13.91	29.50	94.77	97.92	28.42	27.66	44.97	41.77	52.58	77.54	73.83	50.89	48.66	46.89	48.50	26.74	173.68	37.63	27.23	21.26	21.65	47.83	51.77
Minnesota Hub	4.11	-5.11	-2.30	1.49	-8.62	9.51	75.89	24.95	23.79	24.81	23.93	19.08	24.18	44.40	7.38	10.54	27.58	27.58	20.58	120.64	24.36	22.30	13.35	14.25	22.86	28.72
Wisconsin PS	6.29	4.94	6.84	5.29	10.67	39.95	94.52	28.15	27.60	44.83	41.75	35.13	31.35	73.94	45.86	47.80	46.05	47.21	24.97	157.92	37.10	26.49	13.73	10.12	37.85	45.62
Forecasted Load (GW)	52.1	50.6	49.9	50.2	52.4	56.8	62.1	64.8	65.8	66.6	67.2	67.5	67.7	67.7	67.3	66.9	66.4	65.6	65.3	66.5	67.1	64.0	59.1	55.4		
Forecast Error %	-2.8%	-2.8%	-2.6%	-3.0%	-2.8%	-0.9%	-0.9%	-1.3%	-1.0%	-1.2%	-1.2%	-0.9%	-1.2%	-1.4%	-1.7%	-1.8%	-1.8%	-1.6%	-1.3%	-0.9%	-1.6%	-2.0%	-12.6%			

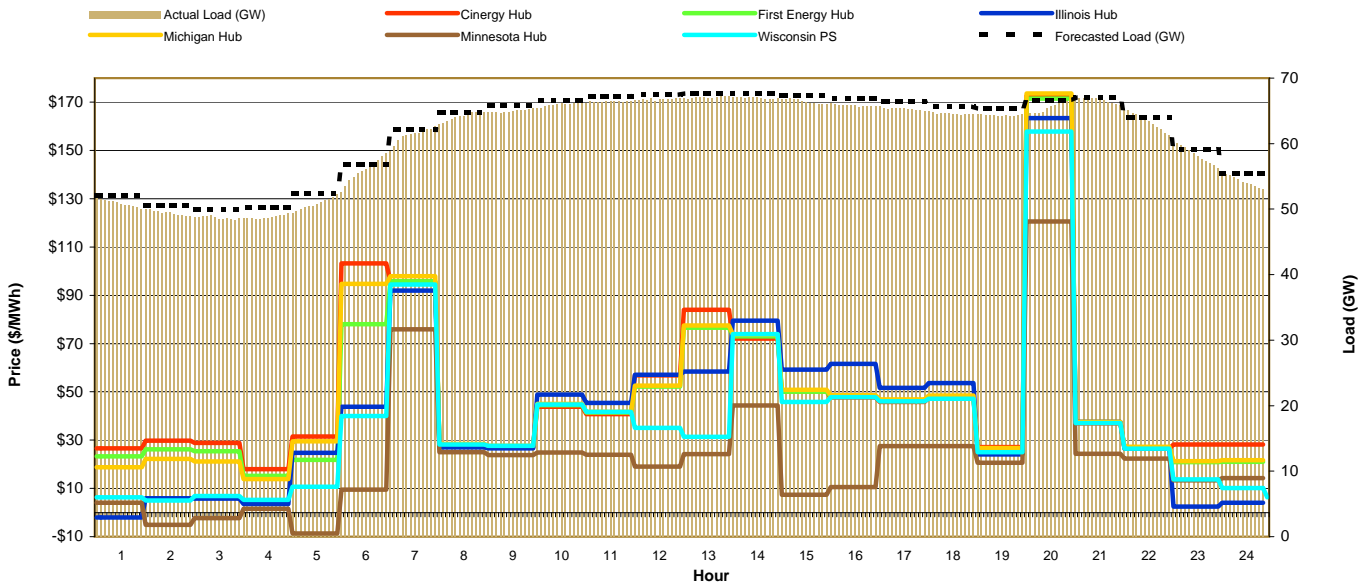




MISO Daily Report

Wednesday April 14, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	26.55	25.00	25.00	25.97	31.14	43.38	39.55	38.73	39.76	42.12	40.90	41.95	40.96	41.34	41.39	41.59	41.36	34.28	34.66	41.97	41.35	29.19	24.89	22.29	35.64	38.53
First Energy Hub	20.11	18.10	17.65	18.27	22.55	33.81	35.72	35.74	40.19	42.46	41.37	42.27	41.23	41.55	41.55	41.66	41.49	34.62	35.00	42.52	41.83	29.51	25.05	22.40	33.61	38.63
Illinois Hub	3.52	0.91	-0.45	-0.74	1.80	10.99	24.00	26.70	39.77	42.64	41.58	41.44	40.32	40.59	39.49	38.46	40.79	32.64	31.41	39.52	38.30	26.63	21.11	18.77	26.67	36.34
Michigan Hub	20.32	18.31	17.85	18.47	22.84	34.31	36.24	36.34	40.87	43.18	42.07	42.93	41.81	42.10	42.10	42.12	42.10	35.21	35.33	42.84	42.13	29.83	25.34	22.62	34.05	39.14
Minnesota Hub	7.86	6.34	5.23	4.60	6.88	18.44	21.85	24.42	29.56	32.14	31.94	32.81	31.35	30.02	29.18	29.63	27.85	25.48	24.65	29.16	28.88	22.35	19.30	15.53	22.31	28.05
Wisconsin PS	12.15	10.29	9.32	9.49	13.04	23.42	29.53	31.43	39.44	40.92	40.30	40.14	37.92	37.33	37.78	36.28	38.87	34.32	31.03	36.62	35.83	26.71	22.72	19.14	28.91	35.47
Cleared Load (GW)	49.4	48.6	48.1	48.5	51.5	58.2	62.6	63.6	64.4	65.2	65.6	66.3	66.9	67.2	65.6	65.1	64.6	63.8	63.7	66.7	65.5	61.2	56.0	5.1		

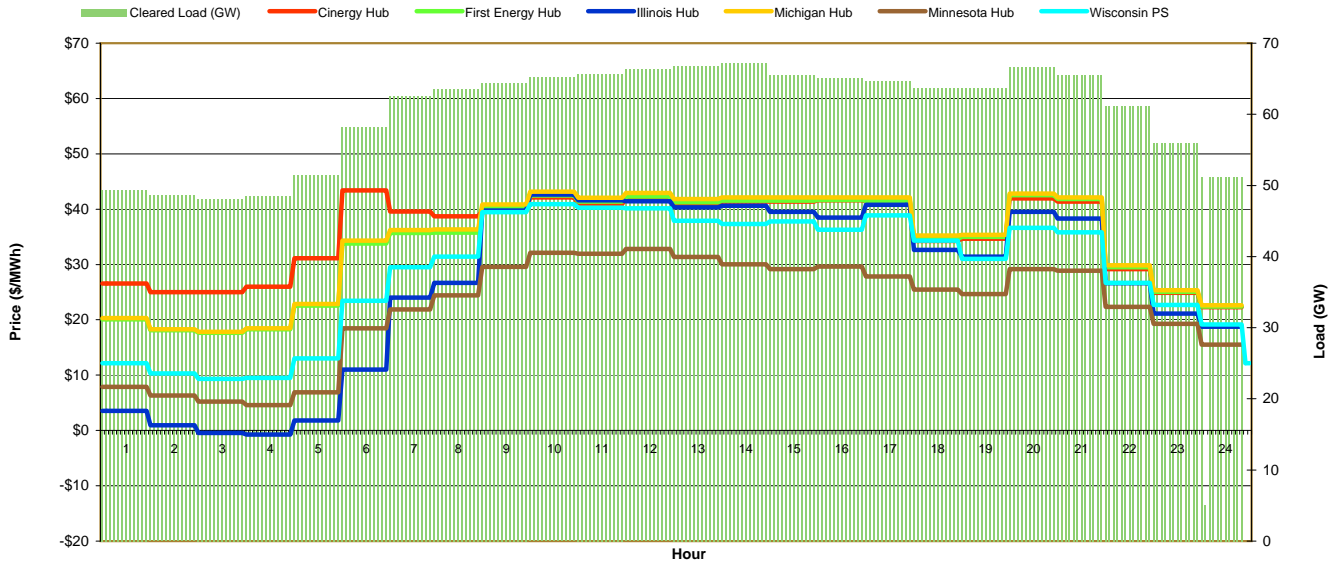

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	16.75	10.42	13.60	15.22	21.19	40.83	27.51	41.51	30.44	34.39	51.36	34.90	27.65	26.64	56.22	61.91	33.66	29.97	26.75	43.11	38.78	25.61	32.50	26.75	31.99	37.21
First Energy Hub	17.12	10.54	13.26	13.28	19.90	37.94	27.29	41.13	29.80	34.69	51.81	35.17	27.83	26.75	56.39	62.04	33.63	29.79	26.64	43.16	38.82	25.75	32.66	25.45	31.70	37.25
Illinois Hub	16.13	10.62	13.57	26.74	18.02	37.77	27.93	39.93	27.37	38.23	58.14	40.05	28.84	28.02	59.44	66.29	35.55	31.31	27.92	41.49	37.44	24.69	31.12	22.98	32.90	38.49
Michigan Hub	17.47	10.72	13.93	14.86	20.75	38.54	27.70	41.78	30.30	34.95	51.92	35.17	27.82	26.77	56.54	62.42	33.81	30.22	26.96	43.24	39.11	26.11	33.23	25.94	32.09	37.52
Minnesota Hub	14.84	-9.77	-18.89	-3.00	4.22	5.54	14.39	36.14	40.80	21.11	31.96	21.94	22.03	20.18	41.36	41.87	24.76	22.04	19.48	40.25	36.53	23.82	21.09	16.36	20.38	29.09
Wisconsin PS	16.50	10.68	11.85	17.27	10.22	23.60	24.82	37.09	26.02	34.31	51.25	34.93	27.90	26.93	56.50	61.22	33.31	27.83	24.81	42.87	38.78	25.45	27.31	17.85	29.55	36.03
Forecasted Load (GW)	52.3	50.8	49.9	49.8	51.5	56.7	61.5	64.0	65.0	65.8	66.6	67.1	67.5	67.9	67.8	67.6	67.3	66.6	66.0	66.9	67.3	64.0	58.7	54.5		
Forecast Error %	-10.2%	-1.9%	-1.4%	-0.5%	0.1%	0.2%	-0.1%	-0.5%	-0.3%	-0.3%	0.0%	0.0%	0.0%	-0.1%	0.1%	-0.2%	-0.9%	-0.9%	-1.0%	-0.5%	0.5%	0.1%	-0.1%	-9.3%		

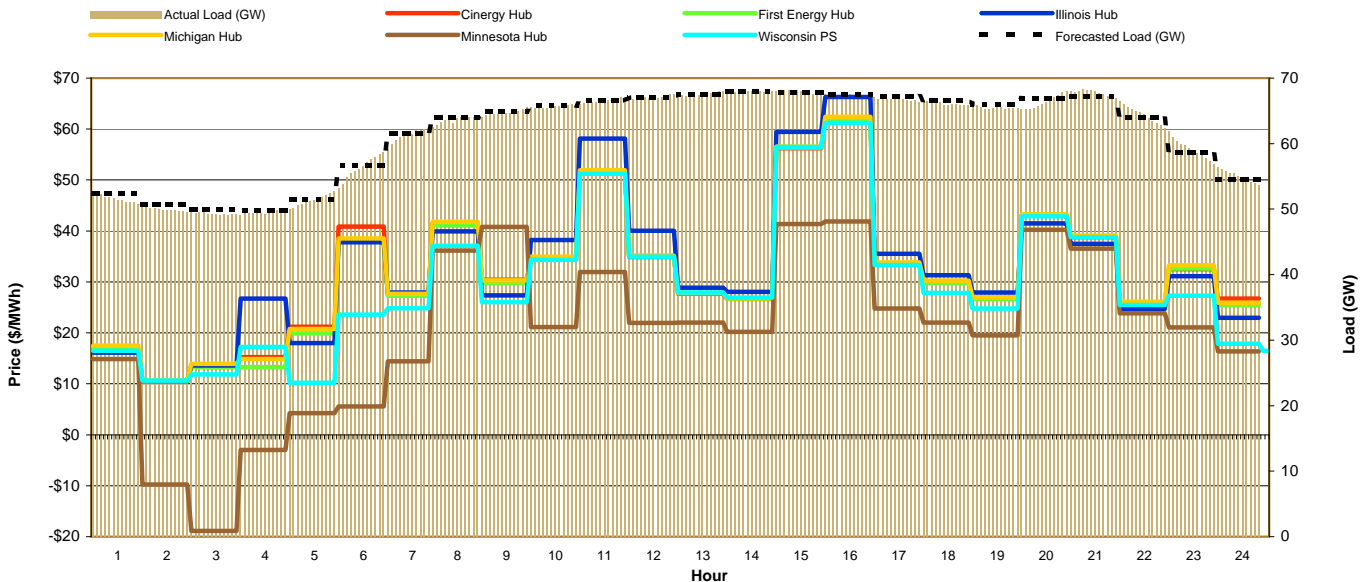




MISO Daily Report

Thursday April 15, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%

Day-Ahead Prices and Cleared Load

Hour Ending:	Day-Ahead Prices and Cleared Load																								Avg. Hr \$			
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk		
Cinergy Hub	20.21	19.50	19.45	19.70	22.00	35.76	34.86	35.51	37.57	39.83	42.49	43.83	43.92	44.83	43.99	43.17	42.47	38.64	37.38	46.23	42.30	31.17	24.82	21.13	34.62	39.88		
First Energy Hub	20.29	19.39	19.38	19.73	21.88	35.52	34.86	35.44	37.61	39.93	42.70	43.92	43.89	44.99	44.33	43.45	42.71	38.79	37.47	46.27	42.71	31.60	25.26	21.52	34.74	40.07		
Illinois Hub	18.00	16.80	17.03	17.48	19.00	38.79	32.91	33.10	35.45	37.83	40.59	41.58	41.50	42.73	42.28	41.54	40.64	36.82	35.64	43.48	40.49	30.12	23.93	20.41	32.84	37.98		
Michigan Hub	20.51	19.44	19.46	19.88	22.21	36.11	35.48	36.08	38.28	40.64	43.46	44.70	44.66	45.79	45.12	44.21	43.46	39.48	38.13	47.09	43.47	32.15	25.61	21.83	35.30	40.77		
Minnesota Hub	11.63	6.50	5.12	5.09	6.88	15.06	28.04	35.32	36.72	37.45	40.37	41.13	39.80	40.33	39.96	38.38	38.58	35.00	31.86	41.66	37.62	26.53	17.93	15.65	28.03	36.17		
Wisconsin PS	16.14	14.22	13.05	13.14	14.78	28.07	32.19	32.45	34.71	36.97	40.15	40.71	40.19	41.95	42.00	40.89	40.01	36.07	34.48	42.22	40.72	30.75	23.47	20.30	31.23	37.35		
Cleared Load (GW)	48.0	46.8	46.6	47.1	49.5	58.1	62.1	63.7	64.9	66.4	67.0	67.9	69.3	69.9	69.0	69.0	68.4	66.5	65.8	69.4	67.6	63.1	57.6	5.2				

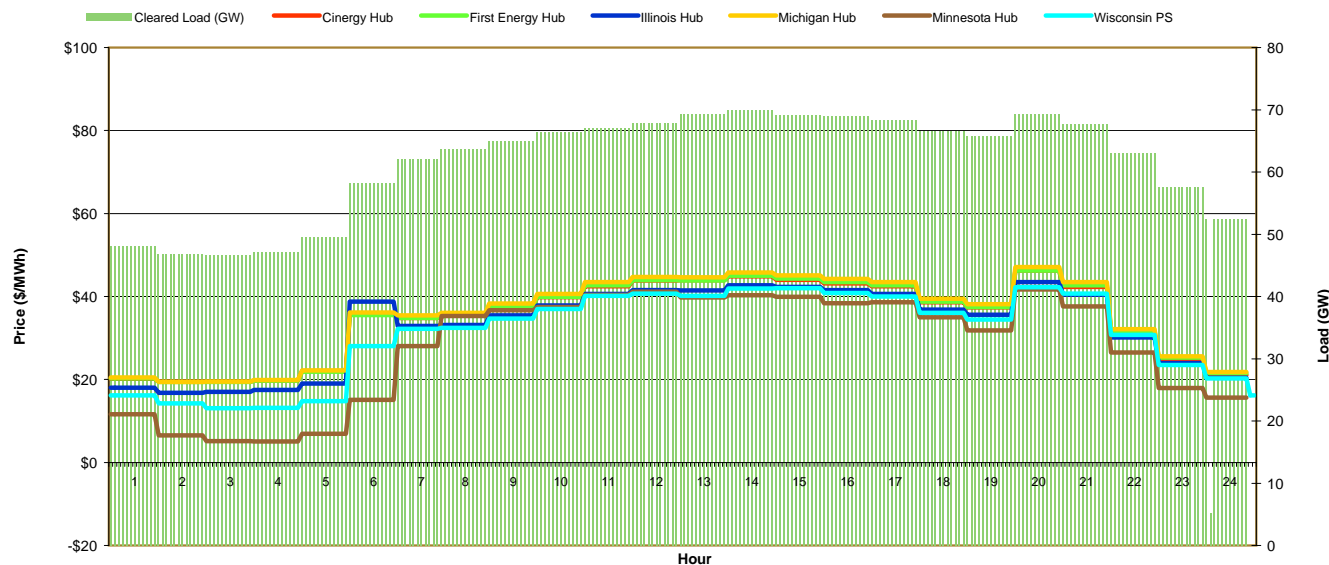

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	Preliminary Real-Time Prices with Forecasted and Actual System Load																								Avg. Hr \$			
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk		
Cinergy Hub	24.83	26.55	23.23	27.64	38.27	28.92	27.50	48.90	38.50	58.25	50.75	29.57	36.67	69.24	70.99	24.69	27.68	31.96	25.92	26.59	40.94	25.04	33.93	27.49	36.00	39.98		
First Energy Hub	23.49	22.44	21.74	22.69	25.38	26.61	27.57	47.14	38.03	57.77	50.30	29.57	36.61	68.33	70.43	24.63	27.56	31.82	25.98	26.16	41.20	25.22	34.24	27.78	34.70	39.69		
Illinois Hub	16.85	6.84	9.69	20.22	42.66	21.11	26.38	43.80	37.08	56.22	49.14	28.51	35.51	68.13	69.45	23.99	26.94	30.98	24.94	22.75	39.37	24.14	32.61	26.34	32.65	38.35		
Michigan Hub	24.06	23.14	22.62	24.51	26.53	27.02	27.84	47.69	38.65	58.69	50.65	29.55	36.34	67.82	70.06	24.53	27.55	32.03	26.12	26.18	41.53	25.59	34.89	28.32	35.08	39.87		
Minnesota Hub	28.63	9.73	14.38	12.50	-18.34	23.27	36.03	92.38	47.69	73.92	72.42	40.69	35.60	60.54	60.82	22.19	24.02	27.59	26.01	25.36	70.52	28.11	31.17	24.94	36.26	46.19		
Wisconsin PS	19.17	16.57	20.71	13.87	10.30	14.57	27.72	43.63	42.48	57.26	50.28	30.03	36.28	65.45	67.73	24.22	26.73	30.67	25.67	25.62	44.24	25.73	33.88	27.12	32.49	39.37		
Forecasted Load (GW)	52.4	50.7	49.9	50.1	52.1	56.6	61.1	64.0	65.5	67.1	68.4	69.4	70.3	71.2	71.5	71.4	71.1	70.0	68.9	69.5	69.4	65.8	60.2	55.4				
Forecast Error %	-9.3%	-1.1%	-1.2%	-1.3%	-1.4%	-0.3%	-0.1%	-0.2%	0.1%	-0.1%	-0.2%	-0.7%	-1.0%	-1.9%	-2.9%	-3.7%	-4.7%	-4.8%	-4.5%	-3.9%	-2.2%	-2.3%	-1.8%	-10.7%				

