




MISO Daily Report

Saturday January 1, 2011

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	19.92	19.13	16.53	15.22	15.17	16.69	20.33	21.71	21.97	23.73	24.77	25.45	25.08	24.65	24.29	24.18	25.06	37.01	34.44	31.34	30.40	28.97	26.69	24.41	24.05	26.86
First Energy Hub	21.76	20.73	18.16	16.87	16.82	18.40	22.51	23.63	23.81	25.59	25.91	26.57	26.31	25.80	25.44	25.32	26.24	36.68	35.71	32.10	31.03	29.77	28.26	26.15	25.40	28.01
Illinois Hub	16.59	16.10	14.06	13.25	12.87	11.87	17.29	19.80	20.19	21.89	23.08	23.55	23.26	23.04	22.70	22.58	23.47	29.84	32.97	28.03	26.57	25.57	23.66	22.58	21.45	24.39
Michigan Hub	17.78	16.75	14.17	12.56	12.39	12.85	17.04	19.72	20.21	22.18	24.54	25.24	24.61	24.46	24.11	24.03	24.99	36.99	35.18	31.49	30.38	29.02	24.77	22.62	22.84	26.37
Minnesota Hub	11.61	8.61	6.93	4.52	4.07	3.45	7.86	12.37	14.85	16.15	17.12	17.91	18.17	18.24	16.84	17.36	18.33	21.49	29.53	26.26	23.15	20.35	19.22	18.32	15.53	19.21
Wisconsin PS	14.82	11.67	9.27	7.29	6.91	6.81	14.84	17.87	19.76	21.97	22.84	23.42	23.13	22.85	22.24	22.79	25.76	31.02	28.02	26.63	25.59	23.47	20.42	19.65	23.72	
Cleared Load (GW)	53.6	52.8	52.2	51.6	51.6	51.8	54.0	57.3	58.7	60.9	62.8	63.7	63.7	63.2	62.1	61.9	63.3	69.7	72.6	70.8	69.8	67.8	64.5	6.2		

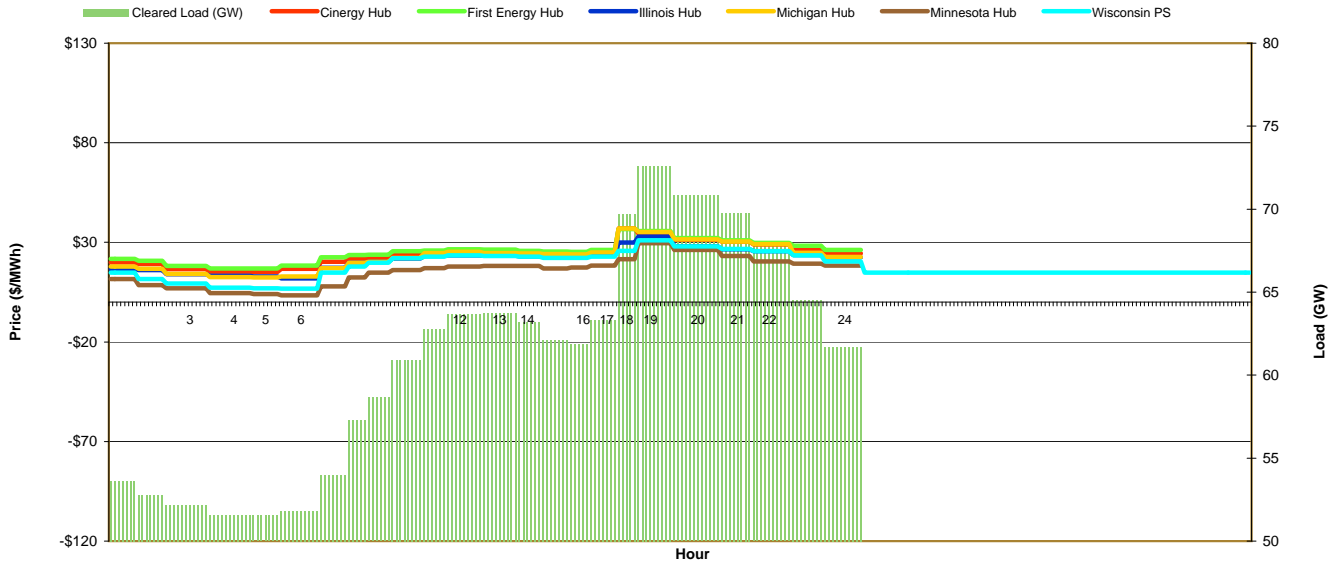

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	6.40	20.41	-1.88	-0.54	13.73	11.62	22.16	16.86	20.52	20.62	24.59	25.00	25.48	24.28	22.68	23.20	24.42	126.65	53.52	40.82	29.32	25.27	24.59	22.46	25.92	32.99
First Energy Hub	4.68	19.28	-3.79	56.41	19.56	67.02	21.58	16.26	8.81	13.60	25.02	24.43	25.46	23.25	21.81	22.40	23.01	124.98	53.79	40.15	28.83	25.43	24.76	22.55	29.55	31.37
Illinois Hub	6.15	9.29	-1.81	-18.31	11.05	-6.78	12.29	16.06	17.14	17.67	20.05	22.18	21.96	22.17	19.54	20.57	21.47	110.32	51.18	39.03	28.05	24.20	23.56	21.60	21.19	29.70
Michigan Hub	6.55	21.88	-1.92	-116.78	0.11	-99.65	23.51	17.12	21.01	20.07	25.37	25.50	26.05	24.81	23.30	23.70	24.87	128.15	55.02	41.98	30.16	25.93	25.23	22.96	16.46	33.64
Minnesota Hub	6.35	9.53	-1.82	-18.47	11.18	-6.90	12.08	15.56	15.70	2.48	19.48	18.50	18.03	18.70	17.25	17.71	17.66	99.04	50.69	38.36	26.99	22.99	22.22	20.44	18.91	26.34
Wisconsin PS	6.44	7.34	-1.87	-18.92	11.35	-7.42	10.47	16.45	16.72	12.97	20.15	21.93	21.45	22.13	19.44	20.42	20.93	115.94	54.21	40.92	29.01	25.05	24.38	22.33	21.32	30.13
Forecasted Load (GW)	59.0	56.6	56.6	56.7	55.4	55.8	56.7	57.7	59.2	62.0	64.1	64.8	64.7	64.2	63.5	63.1	63.8	67.4	71.5	71.6	70.8	69.5	67.5	64.4		
Forecast Error %	#####	-3.9%	-6.2%	-8.2%	-6.3%	-6.1%	-5.0%	-3.5%	-3.4%	-5.1%	-4.2%	-2.3%	-1.0%	-0.2%	0.3%	0.4%	0.4%	1.4%	0.4%	0.0%	0.1%	0.4%	0.1%	-10.0%		

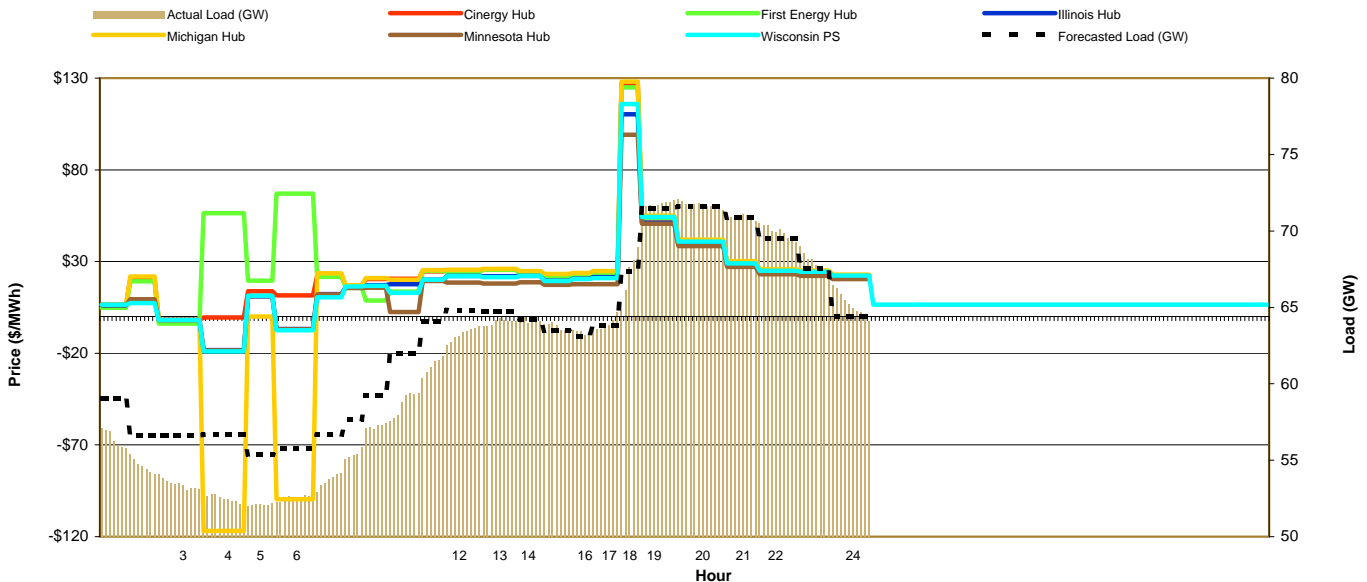




MISO Daily Report

Sunday January 2, 2011

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	23.10	21.64	21.36	21.45	21.59	20.96	23.66	28.10	30.50	31.25	32.12	30.47	29.79	28.49	28.11	27.83	30.27	44.57	58.13	47.96	44.41	45.02	33.23	29.56	31.40	35.64
First Energy Hub	27.15	25.30	25.10	25.19	25.01	25.07	27.54	31.11	31.60	32.86	31.27	30.00	29.68	28.44	28.01	28.28	30.45	42.81	60.39	49.52	46.29	46.76	34.56	31.19	33.07	36.38
Illinois Hub	20.84	19.66	19.28	19.27	17.13	18.82	21.41	23.84	25.80	26.69	27.88	27.18	26.31	25.05	24.68	24.42	25.96	40.65	55.75	45.95	42.54	43.17	27.74	24.80	28.12	32.10
Michigan Hub	16.55	15.82	15.32	15.36	15.22	14.18	18.02	23.27	27.91	28.82	31.75	30.07	29.32	27.93	27.86	27.43	29.71	45.20	59.37	48.65	44.87	45.77	30.77	26.57	28.99	34.92
Minnesota Hub	17.78	16.20	15.39	15.12	15.78	16.11	18.68	19.73	21.12	22.05	23.00	24.62	23.23	23.12	21.44	21.34	22.56	34.33	51.37	42.32	37.32	35.64	26.23	21.84	24.43	28.09
Wisconsin PS	17.27	15.55	15.11	14.30	15.27	16.32	21.46	23.89	25.07	25.75	26.36	26.80	26.23	26.06	25.04	24.96	25.82	38.73	57.83	47.64	40.27	36.19	27.31	24.09	26.80	31.50
Cleared Load (GW)	58.1	56.4	55.4	55.0	54.9	55.1	58.4	62.2	64.8	66.9	67.3	67.1	66.7	66.1	64.7	64.4	66.4	73.2	74.6	74.2	73.8	71.2	68.6	6.6		

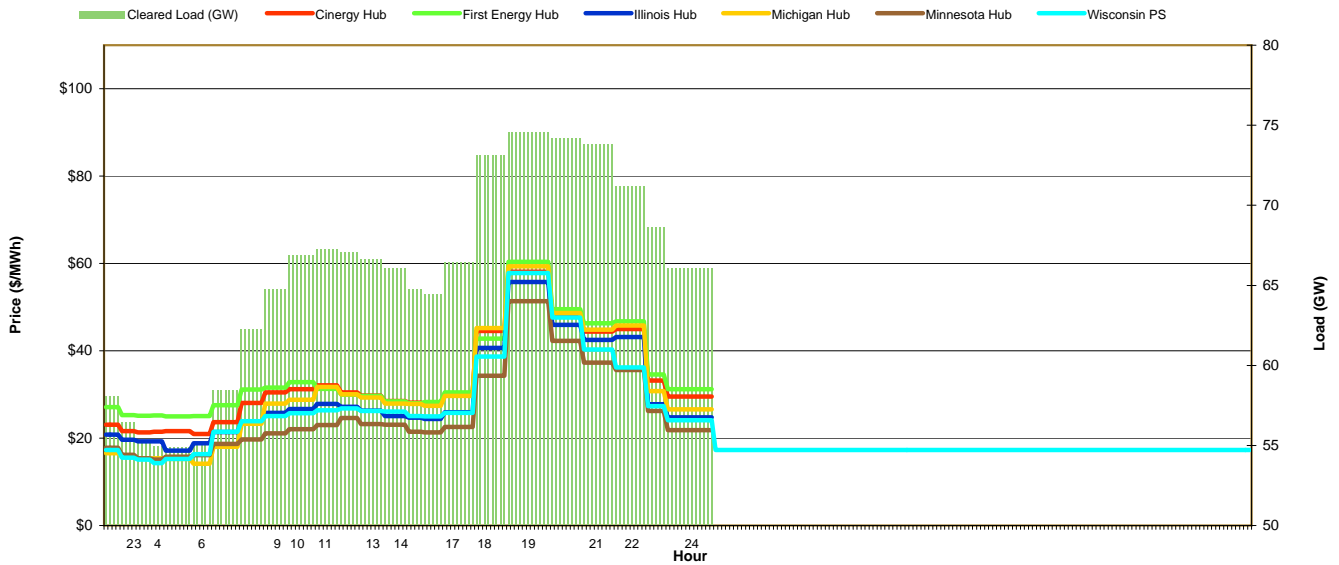

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	21.68	21.89	21.60	21.69	22.25	22.54	24.03	27.67	27.09	38.90	28.60	30.37	103.37	28.37	27.45	27.82	24.13	48.32	73.41	67.81	50.26	51.65	29.74	29.03	36.24	42.81
First Energy Hub	21.72	21.88	21.58	21.66	22.25	22.52	23.97	27.59	26.79	38.99	28.71	30.54	104.52	28.59	27.76	28.23	24.58	49.31	74.92	69.26	51.46	52.68	30.28	29.56	36.64	43.39
Illinois Hub	20.98	21.17	20.84	20.94	21.45	21.75	23.07	26.39	23.99	32.99	25.99	28.07	96.07	24.95	24.59	23.60	19.55	45.00	69.66	62.86	40.56	42.92	24.57	21.98	32.66	38.24
Michigan Hub	22.00	22.13	21.80	21.86	22.40	22.75	24.35	28.07	27.27	40.11	29.52	31.38	107.38	29.40	28.46	28.96	25.46	50.67	76.69	70.96	52.99	54.13	31.19	30.75	37.53	44.54
Minnesota Hub	20.13	20.44	20.03	20.15	20.49	20.54	20.99	23.45	23.18	30.39	24.71	27.10	72.90	23.82	23.20	21.99	18.55	44.78	70.58	63.51	40.67	42.34	24.05	21.11	30.80	35.95
Wisconsin PS	21.53	21.67	21.21	21.27	21.75	22.08	23.21	26.40	25.83	32.78	26.55	28.79	56.34	25.61	25.37	23.96	19.71	47.73	74.12	65.93	41.03	43.52	24.79	21.65	31.78	36.78
Forecasted Load (GW)	62.1	60.2	59.3	59.8	59.8	60.4	61.9	63.5	64.3	65.8	66.7	66.8	66.6	65.9	65.0	64.7	65.6	70.4	75.3	75.7	75.0	73.1	70.5	67.4		
Forecast Error %	#####	0.1%	-0.3%	-1.4%	-1.0%	-0.7%	-0.5%	1.0%	1.8%	1.6%	1.1%	0.8%	1.0%	1.6%	1.8%	1.8%	2.4%	2.3%	0.6%	0.7%	0.5%	0.5%	-0.6%	-9.3%		

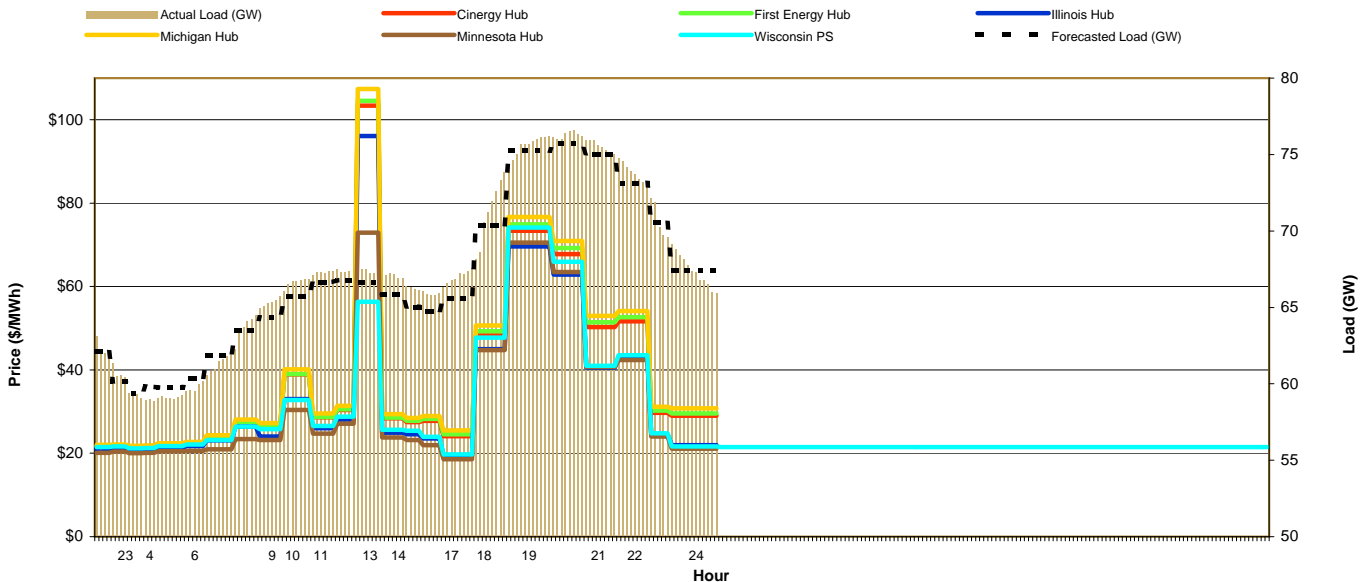




MISO Daily Report

Monday January 3, 2011

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
																									All	On Pk		
Cinergy Hub	28.70	29.33	28.81	28.53	30.48	35.10	44.87	58.43	56.23	53.61	51.22	50.01	40.03	36.19	32.67	30.06	30.88	48.64	62.95	50.96	46.71	37.10	31.53	29.89	40.54	44.83		
First Energy Hub	29.83	30.39	29.57	29.65	31.47	35.62	45.67	60.59	58.44	55.76	53.15	51.86	41.42	37.43	33.72	31.04	31.88	50.28	65.17	52.84	48.29	38.42	32.87	30.87	41.93	46.45		
Illinois Hub	24.38	24.68	21.88	24.23	25.43	27.20	36.15	56.07	53.87	51.36	49.10	47.95	38.43	34.75	31.39	28.88	29.61	46.71	60.43	48.90	44.85	35.62	30.15	24.66	37.36	43.00		
Michigan Hub	26.88	27.54	26.70	26.77	28.70	32.95	43.02	59.75	57.38	54.65	52.46	51.28	41.20	37.27	33.82	31.09	31.98	50.17	64.78	52.28	48.17	38.14	31.37	27.75	40.67	45.99		
Minnesota Hub	20.44	19.72	19.32	19.63	19.40	21.19	27.29	43.91	45.67	43.56	42.21	40.86	33.43	30.25	27.65	25.71	25.64	40.99	54.51	44.37	39.09	31.39	27.18	20.99	31.85	37.28		
Wisconsin PS	22.05	21.46	20.98	21.41	20.36	23.99	28.49	41.20	47.57	45.42	44.60	42.80	35.76	32.38	29.91	28.08	28.12	44.19	60.23	49.31	41.87	33.96	27.97	24.92	34.04	39.58		
Cleared Load (GW)	62.8	62.3	61.2	61.6	62.4	66.1	72.0	77.3	77.9	78.0	78.1	77.3	77.3	76.6	75.7	74.8	75.1	79.9	82.2	81.0	79.7	78.0	74.1	7.0				

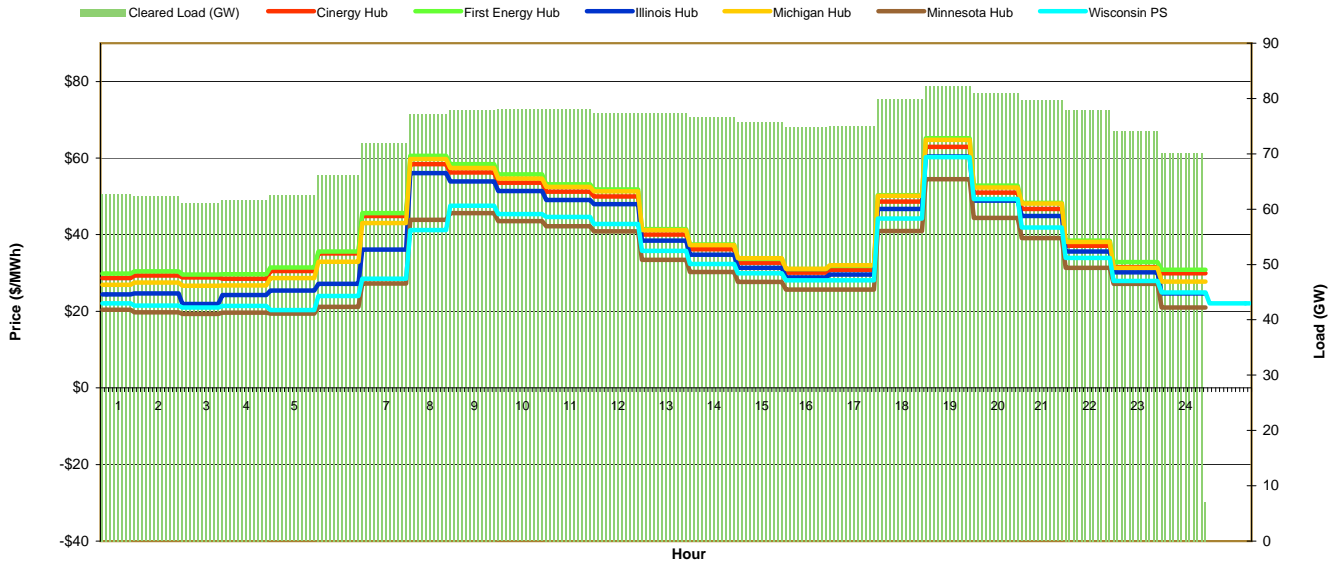

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
																									All	On Pk		
Cinergy Hub	27.13	46.31	32.77	33.60	34.74	27.02	79.92	42.77	43.02	44.85	88.72	36.24	29.97	29.39	27.52	28.61	26.98	46.22	27.41	30.47	49.77	61.15	62.20	37.43	41.43	42.21		
First Energy Hub	27.63	47.53	33.37	34.18	35.35	27.45	81.96	43.59	43.76	43.86	83.61	36.93	30.48	29.90	28.03	26.08	23.68	39.73	27.97	28.86	35.33	45.91	48.97	25.17	38.72	38.54		
Illinois Hub	18.67	19.05	19.54	21.02	22.44	19.84	42.29	34.52	35.52	18.70	45.44	34.60	28.72	28.17	26.39	10.30	4.39	16.04	26.39	16.84	-38.33	-28.35	-4.76	-30.51	16.12	15.91		
Michigan Hub	28.93	50.55	35.34	36.18	37.13	28.49	85.84	44.63	44.32	44.21	84.28	37.46	31.04	30.60	28.86	26.88	24.42	43.07	28.55	29.32	35.81	46.65	49.82	26.00	39.93	39.37		
Minnesota Hub	17.74	17.43	18.84	20.15	21.58	19.38	36.10	34.29	42.02	41.77	78.71	35.24	28.91	28.32	26.04	23.66	21.17	34.68	25.69	26.13	31.26	36.92	25.23	19.23	29.60	33.75		
Wisconsin PS	17.75	13.86	17.71	19.37	20.84	19.36	29.89	35.08	43.32	42.96	79.70	36.64	30.41	29.86	28.00	25.90	23.50	40.10	28.25	28.89	34.75	44.87	44.04	24.76	31.66	37.27		
Forecasted Load (GW)	65.3	64.8	64.1	64.0	64.9	67.3	71.6	76.4	78.2	77.9	77.6	77.0	76.0	75.1	74.2	73.3	73.2	76.5	80.1	80.2	79.2	77.0	73.7	70.1				
Forecast Error %	#####	-3.1%	-3.2%	-2.9%	-3.1%	-2.8%	-1.2%	-0.1%	-0.5%	-0.5%	-0.7%	-0.9%	-0.7%	-0.6%	-0.8%	-0.6%	-0.1%	0.3%	0.4%	0.2%	-0.1%	0.0%	-0.4%	-10.1%				

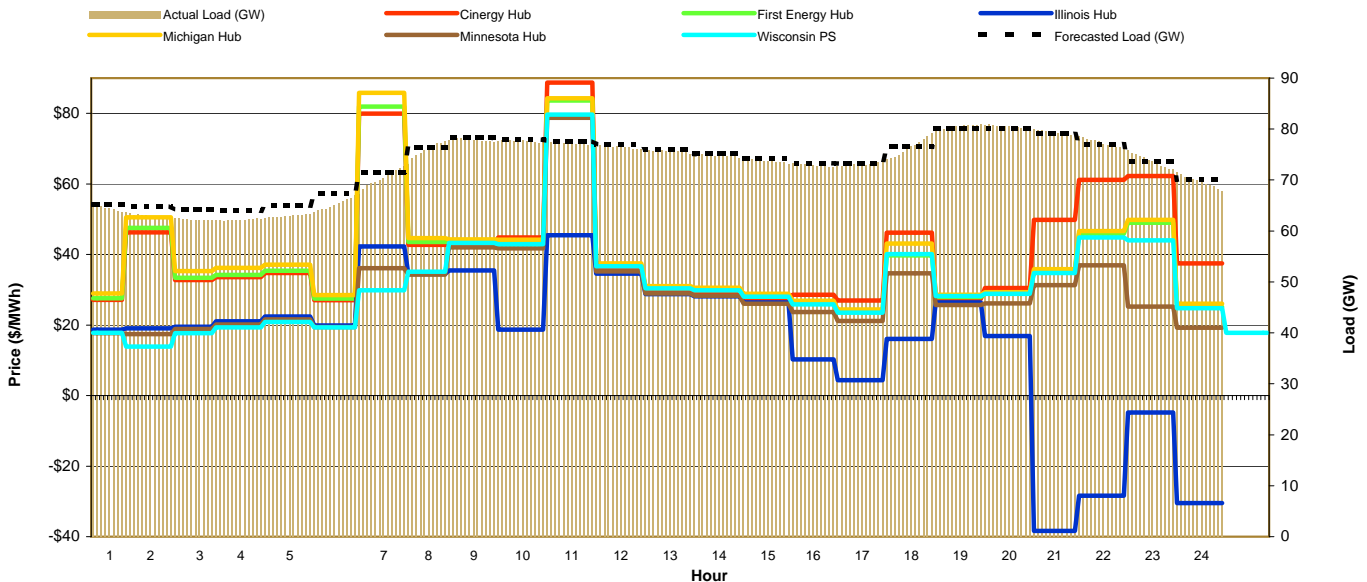




MISO Daily Report

Tuesday January 4, 2011

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	28.81	28.15	27.44	27.43	28.16	30.24	43.74	53.09	50.74	50.08	49.92	46.71	42.86	40.70	34.07	32.18	34.75	49.89	61.10	54.38	49.74	46.29	34.26	36.56	40.89	45.67
First Energy Hub	28.90	28.20	27.61	27.46	28.32	30.39	43.70	53.97	51.53	50.93	50.77	47.52	43.73	41.52	34.76	32.88	35.50	51.14	62.62	55.68	50.84	47.28	34.94	36.74	41.54	46.60
Illinois Hub	22.58	22.00	21.09	21.72	21.91	23.28	32.66	48.00	44.71	43.66	43.53	40.93	37.89	35.93	30.03	28.73	31.04	46.05	55.81	49.30	44.70	41.50	31.38	25.52	35.16	40.82
Michigan Hub	30.23	30.08	29.64	29.38	30.47	32.71	46.21	55.93	53.41	52.28	52.11	48.79	44.53	42.28	35.39	33.47	36.15	52.06	63.74	56.64	51.77	48.15	35.02	40.52	42.96	47.61
Minnesota Hub	17.68	16.75	16.84	17.02	17.77	19.72	25.89	41.75	43.93	42.73	42.88	40.04	36.44	34.51	29.81	28.30	30.02	43.95	56.50	48.68	43.18	38.83	29.26	24.26	32.78	39.43
Wisconsin PS	20.68	19.44	18.19	18.49	18.23	21.19	26.65	37.14	44.35	43.85	43.67	40.65	36.86	34.76	30.80	29.32	30.63	45.85	61.28	52.14	44.43	38.93	30.27	26.47	33.93	40.31
Cleared Load (GW)	64.2	63.5	62.9	62.8	63.7	67.1	73.8	79.0	79.6	79.0	78.6	78.3	77.2	76.3	75.3	74.6	75.2	78.7	81.5	80.9	79.8	77.7	74.2	7.0		

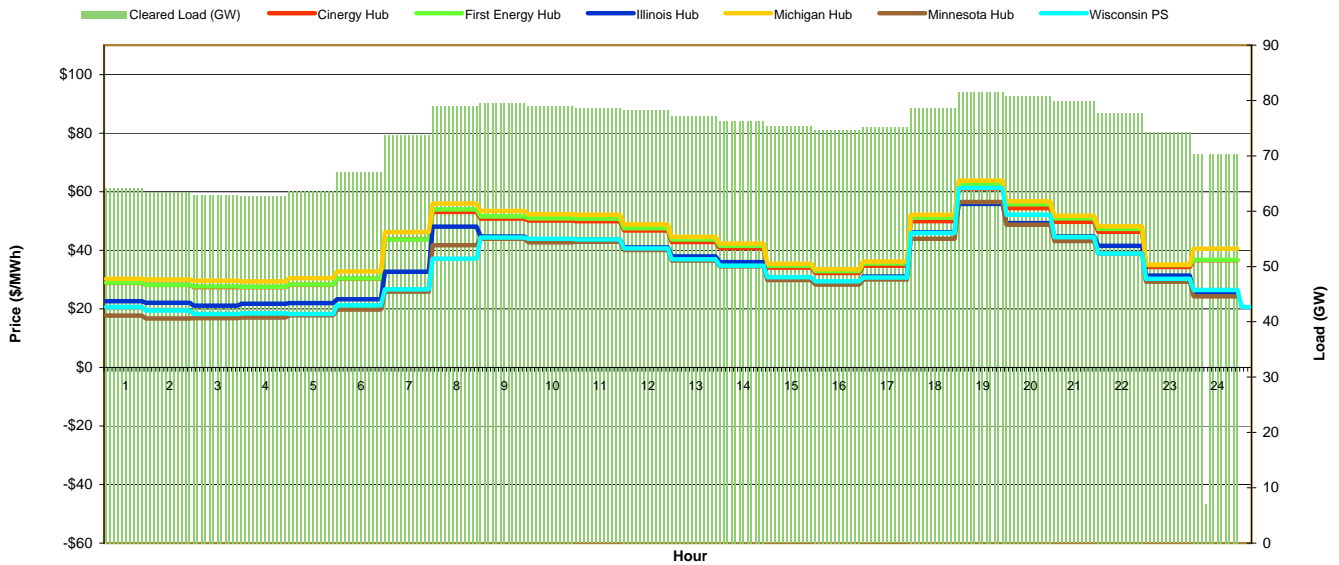

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	54.78	36.10	39.94	38.40	53.38	56.23	55.03	99.77	29.36	31.70	43.92	32.94	41.87	37.77	31.80	30.61	28.90	51.93	65.18	64.73	60.87	74.84	37.37	46.21	47.65	47.72
First Energy Hub	56.73	33.39	38.89	25.93	35.41	37.67	33.86	88.93	29.71	32.13	41.13	33.16	42.45	37.57	32.12	30.64	29.06	45.21	66.20	65.62	61.74	75.51	37.66	46.49	44.47	47.43
Illinois Hub	-34.34	-42.23	-51.67	-36.85	-48.22	-19.55	-31.22	76.08	27.67	29.90	1.33	26.83	39.51	32.65	29.19	26.61	26.94	49.55	62.45	62.08	58.26	71.56	35.71	44.00	18.18	41.02
Michigan Hub	103.99	62.20	72.82	27.43	37.28	43.69	41.38	102.63	30.20	32.60	42.92	33.58	43.36	38.91	33.02	31.43	29.99	53.67	67.14	66.33	62.54	76.66	38.44	48.17	50.87	48.99
Minnesota Hub	18.42	17.56	17.98	19.51	21.58	26.00	26.80	84.97	27.79	30.03	39.54	31.13	39.58	33.35	29.55	27.54	27.13	49.67	99.60	63.98	57.84	70.22	31.51	42.39	38.90	46.46
Wisconsin PS	28.17	18.36	18.40	19.69	17.42	23.25	17.75	88.87	29.40	31.73	29.58	31.54	41.90	35.74	31.36	29.46	28.89	52.87	71.17	66.17	61.38	74.32	31.05	43.85	38.43	45.96
Forecasted Load (GW)	68.0	66.1	65.0	64.7	65.4	67.7	72.0	76.7	78.4	78.2	77.9	77.3	76.7	75.7	75.3	75.2	78.8	82.2	82.3	81.6	79.0	75.7	71.1			
Forecast Error %	-23.7%	-3.3%	-3.2%	-3.4%	-3.2%	-3.0%	-1.2%	0.7%	0.7%	0.1%	-0.6%	-0.9%	-1.1%	-1.1%	-0.5%	-0.8%	-0.5%	-1.2%	-0.6%	-0.6%	-0.8%	0.0%	-8.1%			

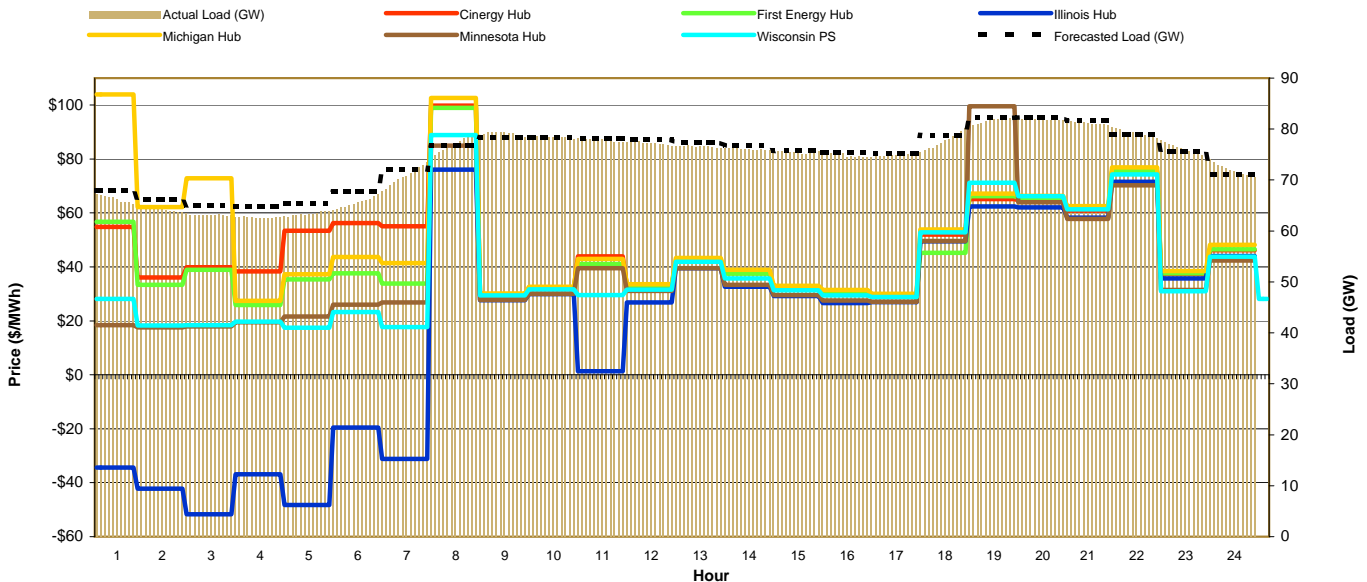



Incomplete Report
Data discrepancy


MISO Daily Report

Wednesday January 5, 2011

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$			
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk		
Cinergy Hub	40.53	36.07	35.40	35.00	37.00	42.31	58.88	69.23	54.86	54.45	55.77	50.85	47.25	44.63	39.28	37.45	37.55	52.75	64.93	54.24	51.96	46.40	38.18	39.95	46.87	49.99		
First Energy Hub	34.39	31.29	30.74	30.35	32.21	36.37	51.74	64.17	50.11	49.13	49.70	45.61	42.08	39.71	35.35	33.66	34.74	49.46	62.32	51.92	49.55	44.17	36.32	36.92	42.58	46.13		
Illinois Hub	2.29	1.69	1.98	1.31	1.39	5.00	11.60	35.88	21.45	16.54	14.50	14.82	12.57	11.99	12.33	11.75	16.80	26.19	38.49	28.01	25.73	22.11	18.79	10.98	15.17	20.50		
Michigan Hub	33.31	32.32	31.71	31.63	33.96	35.99	48.41	61.43	48.97	48.53	44.60	41.06	38.65	34.47	32.72	33.80	48.53	61.97	50.95	48.53	43.34	35.20	35.45	41.84	45.08			
Minnesota Hub	22.13	19.90	19.43	19.49	21.29	28.33	44.01	41.25	41.53	40.89	37.65	34.40	32.20	28.98	27.06	26.62	40.33	53.56	43.26	41.00	34.96	29.22	25.68	32.19	37.31			
Wisconsin PS	23.12	20.98	20.06	20.22	19.94	23.16	28.58	43.50	45.09	45.27	44.73	41.16	37.66	35.29	31.71	29.82	28.58	43.34	58.24	47.22	44.69	36.68	30.36	26.95	34.43	40.21		
Cleared Load (GW)	65.6	64.9	63.9	64.1	64.6	67.8	73.4	78.5	79.1	78.4	77.9	77.3	76.1	75.7	74.3	73.5	74.4	78.7	80.5	80.1	78.5	76.8	72.7	6.9				

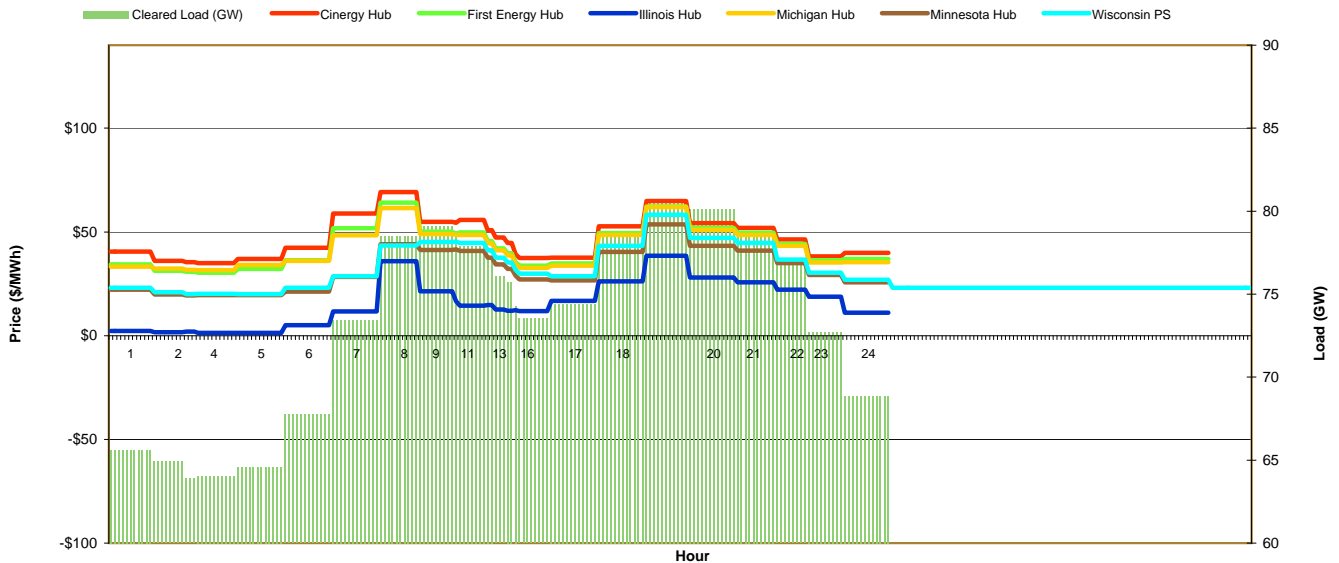

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$			
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk		
Cinergy Hub	29.47	35.42	43.78	44.36	33.20	38.47	88.80	48.38	42.28	47.15	75.24	38.25	42.26	33.73	34.59	39.46	47.74	139.38	61.35	60.72	44.10	136.67	46.81	30.97	53.44	58.63		
First Energy Hub	29.07	33.67	38.54	40.20	28.69	30.26	71.17	44.78	42.38	46.88	74.60	38.51	42.56	32.65	33.92	32.79	42.41	113.86	51.99	52.58	41.33	103.66	38.14	27.45	47.17	52.06		
Illinois Hub	25.53	23.13	16.71	13.16	8.81	-6.37	-15.70	17.35	40.23	40.82	61.12	36.41	40.18	22.71	26.61	6.70	11.69	-87.66	-44.57	-25.48	11.58	-94.61	-40.56	-5.69	3.42	1.41		
Michigan Hub	30.27	35.13	40.01	41.29	29.81	31.41	73.18	45.91	43.15	47.70	76.10	39.45	43.67	33.57	34.79	33.66	43.49	115.80	52.30	52.79	41.66	104.77	38.84	28.07	48.20	52.98		
Minnesota Hub	25.15	23.69	22.07	20.19	22.29	22.00	32.29	35.99	39.32	43.88	68.49	36.31	39.91	28.93	28.31	26.81	27.37	68.17	49.16	48.81	37.15	50.76	30.50	24.24	35.49	41.24		
Wisconsin PS	27.01	26.37	28.64	26.15	25.45	25.35	34.06	39.80	42.48	46.52	73.40	38.30	42.27	31.55	31.46	29.95	31.74	64.61	52.96	52.94	41.12	65.85	31.91	26.66	39.02	44.80		
Forecasted Load (GW)	68.7	67.6	65.6	65.2	65.9	69.0	73.7	78.3	79.7	79.1	78.5	77.8	76.8	76.0	75.1	74.2	74.2	77.2	80.6	80.7	79.5	77.3	73.9	70.4				
Forecast Error %	#####	-0.9%	-0.3%	0.1%	-0.2%	-1.3%	-0.5%	0.7%	1.1%	0.3%	0.6%	-0.1%	0.3%	0.1%	-0.2%	0.9%	0.9%	1.2%	1.1%	1.0%	1.1%	1.4%	0.2%	-9.2%				

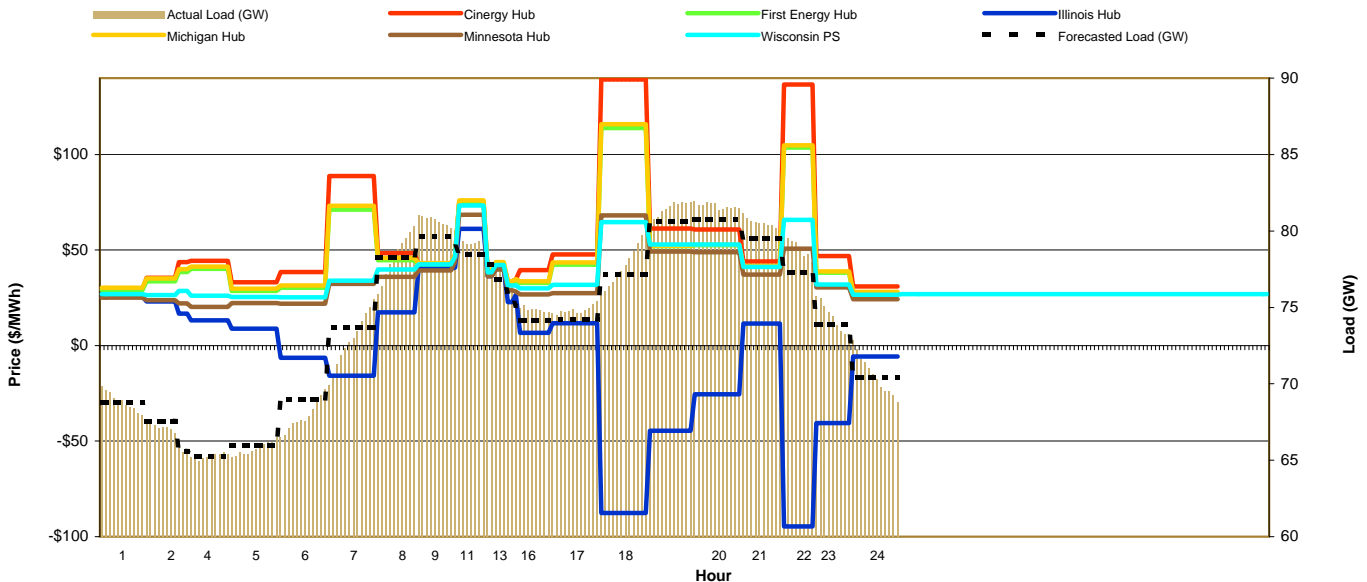




MISO Daily Report

Thursday January 6, 2011

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	36.01	32.68	31.60	31.00	32.10	34.61	48.06	52.61	46.68	46.98	47.10	46.31	41.50	38.67	35.70	34.03	35.72	50.46	61.11	50.77	48.22	43.70	34.44	37.58	41.57	44.63
First Energy Hub	35.46	32.24	31.18	30.64	31.54	33.40	45.87	53.38	47.12	47.12	47.12	46.74	41.76	38.83	35.79	34.12	35.82	51.15	62.22	51.52	48.93	44.14	34.37	36.10	41.52	45.01
Illinois Hub	20.97	20.02	19.52	19.09	18.53	19.16	24.67	44.67	36.67	34.30	33.39	36.76	31.84	28.88	26.06	24.81	26.10	41.99	52.51	42.04	40.21	34.80	24.83	20.64	30.10	34.99
Michigan Hub	35.69	32.49	31.42	30.90	31.81	33.60	46.64	54.50	47.99	47.98	47.98	47.61	42.53	39.55	36.44	34.74	36.48	52.09	63.35	52.46	49.83	44.96	34.49	36.23	42.16	45.81
Minnesota Hub	22.96	20.68	19.82	19.80	20.03	22.14	29.80	39.74	39.87	39.41	39.52	37.84	33.56	31.43	29.48	28.50	29.45	40.99	54.77	45.25	41.66	36.21	29.41	28.05	32.52	37.32
Wisconsin PS	25.10	22.60	21.05	21.06	20.85	23.97	29.23	35.01	40.46	39.54	39.46	36.26	32.32	30.51	29.13	28.55	29.06	39.37	57.48	47.63	42.72	35.64	29.81	28.58	32.72	37.06
Cleared Load (GW)	65.9	64.5	63.3	63.2	64.1	67.1	73.5	78.8	78.7	78.6	77.9	77.4	76.9	75.5	74.9	75.5	79.8	82.6	81.7	80.8	78.5	74.2	7.1			

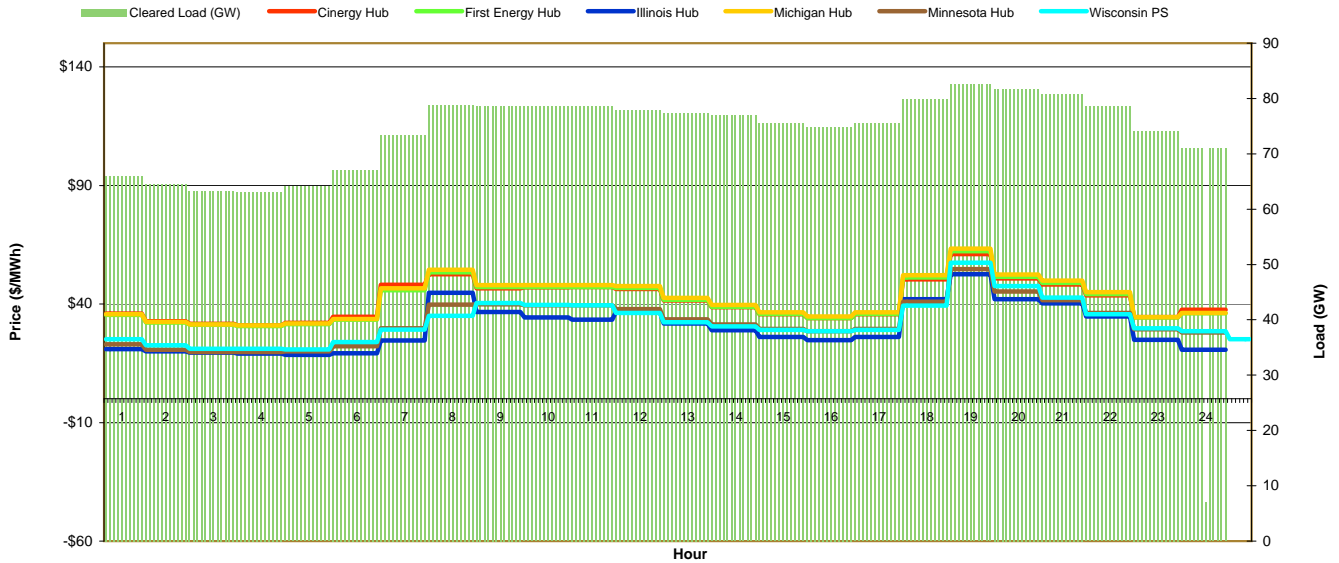

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	40.87	34.39	47.15	29.29	30.29	52.67	35.26	43.58	92.95	79.41	54.04	43.46	48.38	38.44	60.03	43.68	35.59	87.84	43.74	55.24	45.44	38.23	33.93	30.96	47.70	52.75
First Energy Hub	36.47	29.16	38.87	25.84	28.18	44.98	29.85	40.47	85.67	75.21	51.00	36.21	43.46	34.63	54.59	33.69	29.33	84.64	44.21	52.50	41.82	34.63	30.91	27.88	43.09	48.31
Illinois Hub	-0.60	-13.42	-8.26	-6.84	7.13	-3.91	-22.86	7.07	9.70	15.56	16.47	-32.23	-6.06	-4.12	-0.94	-50.06	-30.89	37.61	38.88	18.41	1.64	-2.37	0.07	-3.47	-1.40	1.17
Michigan Hub	37.34	30.36	40.95	27.08	29.23	46.08	30.17	40.52	85.78	75.73	51.35	36.78	44.26	35.20	55.71	34.27	29.82	85.65	44.31	52.63	41.95	35.06	31.58	28.51	43.76	48.79
Minnesota Hub	29.45	23.90	22.02	20.93	21.38	20.68	26.65	35.96	82.83	140.71	49.15	34.38	35.14	30.45	33.97	28.30	37.73	97.28	84.26	56.22	44.39	34.81	32.84	30.17	43.90	53.65
Wisconsin PS	33.19	27.32	28.73	22.94	23.50	17.38	28.50	37.08	85.79	97.62	51.27	35.90	32.79	30.88	21.31	30.90	30.66	88.13	50.80	54.59	42.60	35.11	31.66	28.43	40.29	47.32
Forecasted Load (GW)	68.4	66.4	65.3	64.9	65.5	67.7	72.4	77.2	79.3	78.9	78.5	78.2	77.6	77.0	76.4	75.8	76.1	79.2	82.8	82.6	81.4	79.1	75.5	71.8		
Forecast Error %	-53.6%	-2.1%	-2.1%	-2.3%	-2.5%	-2.4%	-1.3%	0.3%	0.1%	0.1%	0.4%	0.3%	0.5%	0.8%	0.9%	1.1%	1.1%	0.8%	-0.1%	-0.4%	-0.4%	-0.1%	-0.3%	-10.3%		

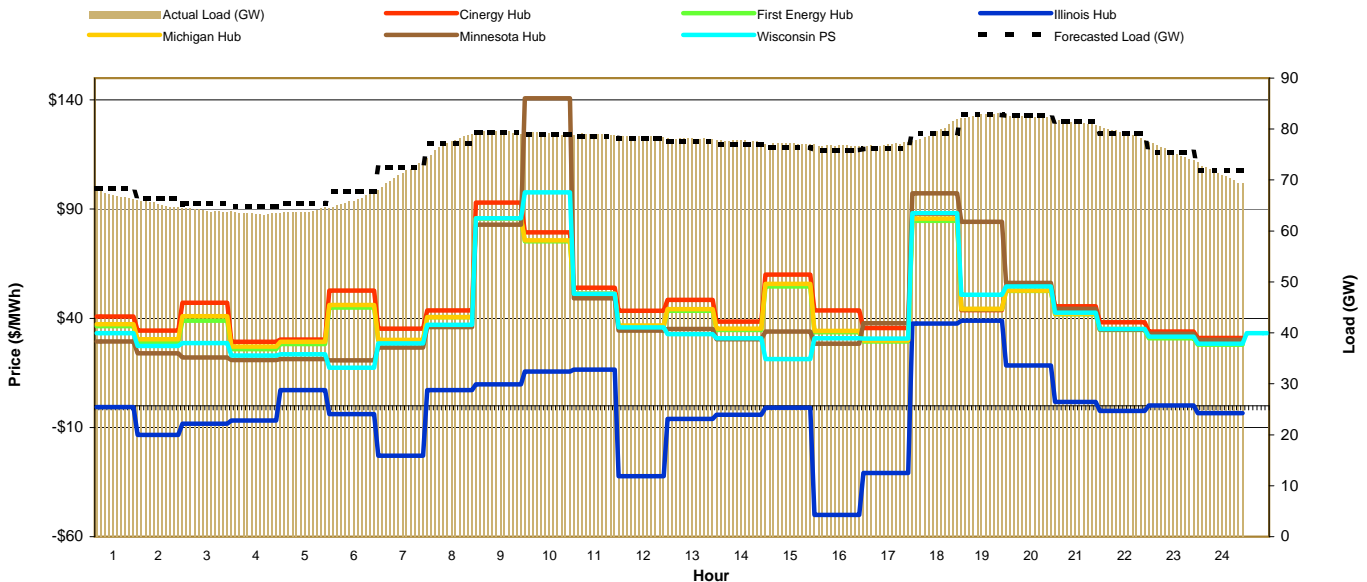




MISO Daily Report

Friday January 7, 2011

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	42.11	37.59	36.40	36.00	36.83	44.29	56.81	62.19	56.28	56.03	53.54	54.11	48.55	47.44	41.45	38.74	40.49	57.14	57.79	52.27	51.20	46.80	40.91	40.70	47.32	50.31
First Energy Hub	38.14	34.41	33.36	32.94	33.72	40.14	50.93	59.48	54.36	53.14	51.38	51.64	46.84	44.88	39.21	36.69	38.07	54.28	54.91	49.73	49.42	45.15	38.61	37.38	44.53	47.99
Illinois Hub	6.59	7.38	6.91	5.88	6.64	5.88	1.19	27.37	25.42	20.88	20.88	20.38	20.75	14.17	10.94	11.42	9.74	19.28	15.87	14.95	20.86	18.80	11.60	10.88	13.94	17.71
Michigan Hub	38.28	34.63	33.62	33.21	33.95	40.15	51.28	59.45	55.11	53.12	51.76	51.88	47.17	45.20	39.50	36.97	38.37	54.84	55.96	50.38	49.90	45.47	38.25	37.67	44.84	48.33
Minnesota Hub	25.77	22.59	20.60	20.33	19.32	19.77	25.69	41.71	44.77	41.40	36.85	32.73	26.30	24.17	21.89	20.91	21.03	32.32	47.92	37.75	32.85	26.77	21.40	20.27	28.55	31.92
Wisconsin PS	25.45	22.25	20.17	20.06	19.88	22.05	28.15	37.57	41.16	37.57	36.29	33.73	31.50	29.62	27.92	26.61	26.73	36.80	52.97	42.85	38.14	32.73	28.85	26.93	31.08	35.06
Cleared Load (GW)	67.0	65.6	64.5	64.7	65.4	67.9	74.5	79.9	81.0	81.2	81.7	81.1	79.9	79.3	78.0	76.9	77.3	81.6	83.6	81.8	80.4	78.7	74.1	7.0		

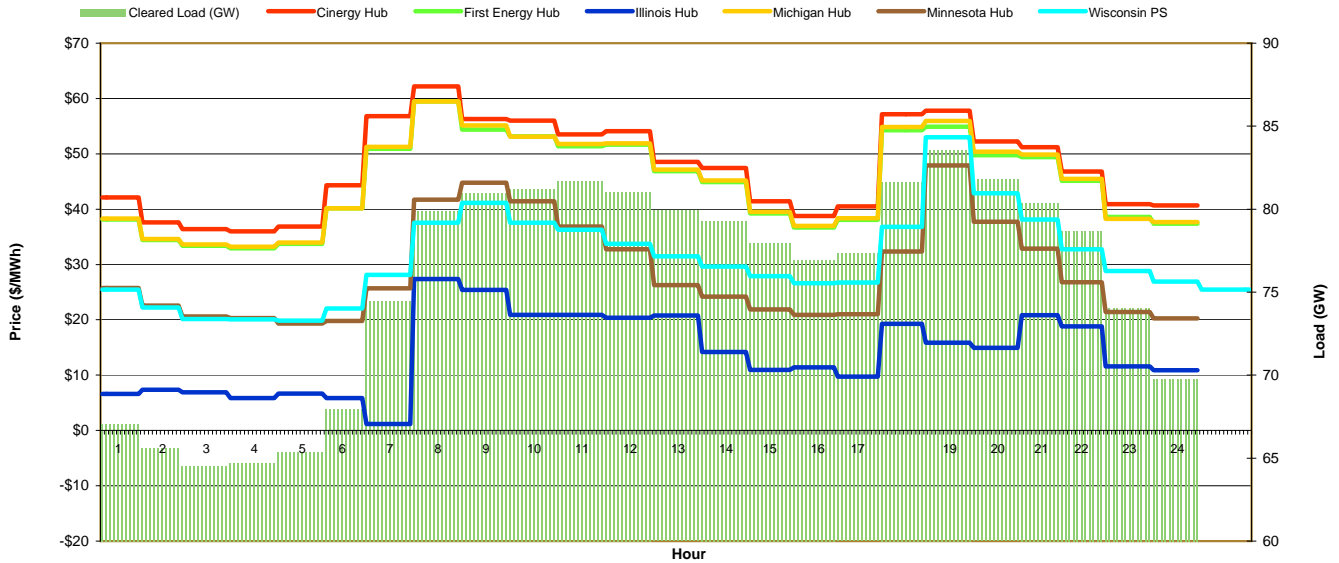

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	30.29	26.50	26.53	26.52	25.49	37.12	27.91	30.30	29.79	28.82	30.99	44.18	27.97	29.89	31.93	26.64	29.34	33.05	27.22	26.28	32.17	26.69	27.02	28.62	29.64	30.14
First Energy Hub	29.12	26.90	26.87	26.87	25.83	34.84	27.17	30.68	30.19	29.41	31.31	43.49	28.31	29.44	28.40	25.00	26.78	29.44	27.70	26.23	27.87	25.80	27.12	27.64	28.85	29.20
Illinois Hub	12.94	25.26	25.35	25.31	28.54	18.81	16.85	28.76	28.50	27.39	28.71	35.46	26.02	22.78	-8.95	4.73	-2.19	-9.35	24.52	19.53	-14.59	12.98	26.01	14.00	17.39	15.64
Michigan Hub	29.73	27.51	27.53	27.59	26.46	35.64	27.79	31.10	30.63	29.95	32.02	44.60	29.19	30.31	28.92	25.61	26.77	29.80	27.63	26.44	28.30	26.43	27.92	28.58	29.44	29.74
Minnesota Hub	26.42	23.95	24.07	24.11	20.17	19.95	46.08	52.56	51.15	59.18	26.79	31.01	9.87	5.10	22.15	34.74	38.72	38.83	63.83	28.42	22.97	17.99	2.53	23.08	29.74	31.62
Wisconsin PS	28.64	26.26	26.28	26.33	25.14	24.41	13.53	32.90	33.02	32.46	17.27	28.79	31.96	-3.06	31.47	27.39	21.85	34.93	31.48	27.70	27.23	28.22	57.96	25.72	27.41	28.85
Forecasted Load (GW)	69.7	67.8	66.8	66.4	67.0	69.0	73.1	78.4	80.5	80.2	79.7	79.2	78.4	77.6	76.8	75.9	75.9	78.6	81.8	81.3	80.0	78.2	75.3	71.6		
Forecast Error %	#####	-3.3%	-3.7%	-3.9%	-3.8%	-2.8%	-1.6%	-1.1%	-0.9%	-0.7%	0.2%	0.6%	1.0%	1.7%	2.0%	2.2%	2.4%	2.0%	1.1%	0.5%	0.4%	0.3%	0.3%	-8.6%		

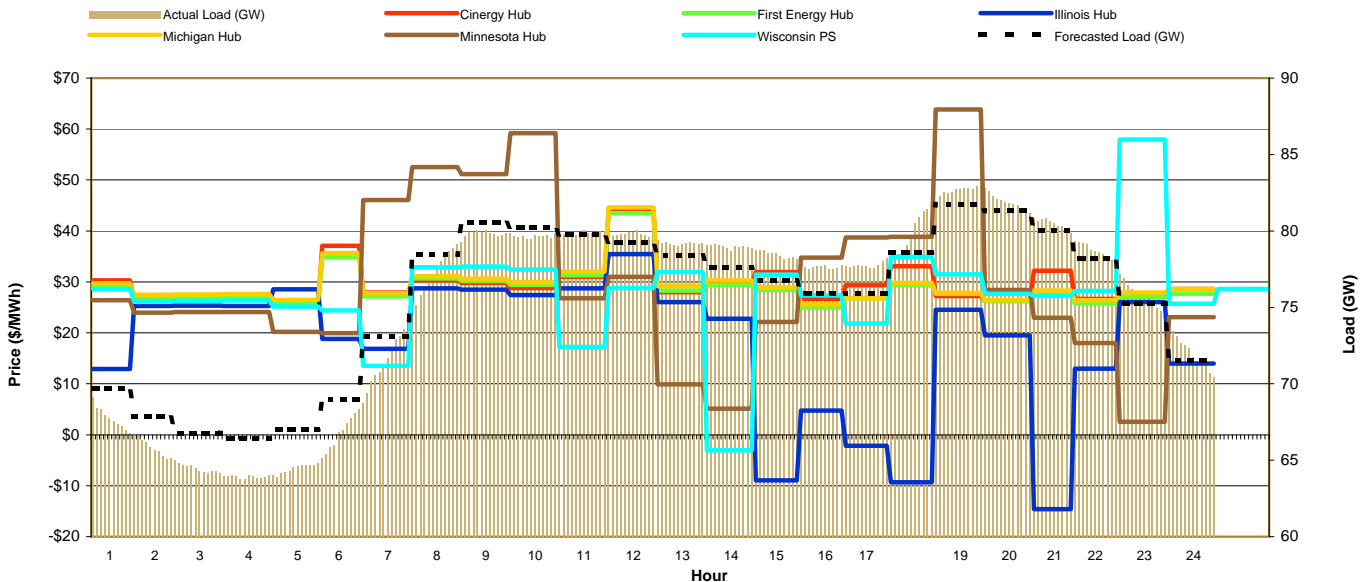




MISO Daily Report

Saturday January 8, 2011

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	38.03	34.96	34.08	32.61	32.11	32.56	34.36	40.25	47.92	58.87	54.87	50.31	43.30	41.46	35.94	33.86	36.96	48.04	60.09	50.25	47.52	47.59	41.90	35.14	42.21	46.20
First Energy Hub	34.03	31.63	31.00	31.44	31.12	31.43	32.65	38.03	44.62	55.97	53.05	48.53	41.69	39.16	34.69	32.87	35.27	46.84	59.53	49.54	47.40	46.70	41.27	33.54	44.70	44.70
Illinois Hub	9.92	11.38	11.39	11.33	11.51	11.04	10.70	14.84	15.04	26.52	26.28	25.34	20.61	12.64	15.07	13.45	13.51	25.24	40.31	27.93	32.02	29.22	24.51	16.55	19.01	22.66
Michigan Hub	35.60	33.16	32.31	30.80	30.38	30.56	31.44	37.80	45.47	57.25	53.25	49.46	42.77	40.18	35.60	33.72	36.18	47.53	60.45	50.19	48.06	47.53	42.23	34.11	41.08	45.48
Minnesota Hub	20.33	19.80	18.61	18.72	17.97	18.98	22.27	29.29	34.13	41.95	43.62	41.08	36.12	33.92	32.24	32.21	31.64	42.96	57.04	49.05	46.00	40.01	33.26	28.20	32.89	39.03
Wisconsin PS	24.07	21.64	20.80	20.96	20.62	21.30	25.17	28.56	32.49	37.94	42.12	40.53	35.10	32.15	29.98	29.24	29.75	40.68	57.53	49.12	44.53	37.69	34.20	29.73	32.74	37.60
Cleared Load (GW)	67.6	65.7	64.1	63.8	63.9	65.6	68.1	70.3	72.5	73.9	74.7	74.2	73.1	71.7	70.7	70.5	71.1	76.8	78.7	78.1	77.2	75.2	72.2	6.9		

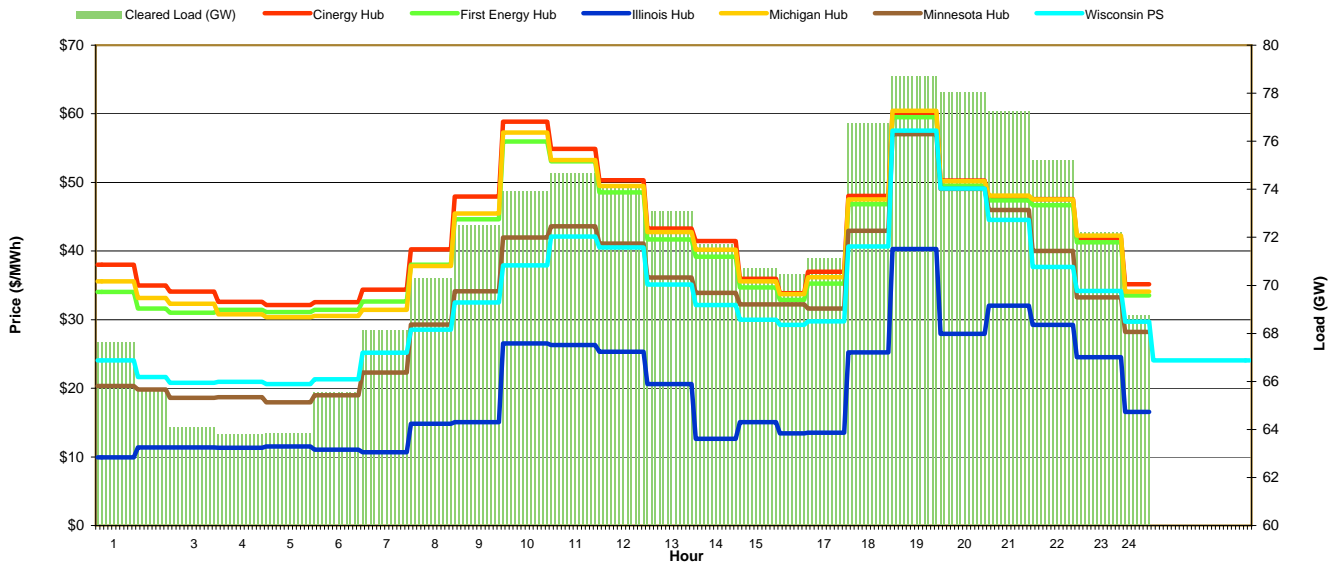

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	30.53	28.73	28.63	27.95	29.75	30.10	29.57	60.95	30.66	46.52	40.65	41.93	46.61	37.86	29.29	28.97	29.84	33.73	56.46	38.26	38.18	42.95	34.60	40.49	36.80	39.84
First Energy Hub	30.20	28.55	29.10	28.37	30.14	30.45	29.94	61.45	30.92	47.16	41.47	42.90	47.69	38.74	29.95	29.67	30.55	34.67	57.97	39.22	39.10	43.93	35.30	41.17	37.44	40.67
Illinois Hub	26.31	20.48	26.70	26.32	29.22	29.07	28.65	58.33	29.35	44.53	38.88	40.13	44.69	36.32	28.09	28.00	28.60	32.35	54.31	36.85	36.80	41.32	33.37	39.08	34.91	38.25
Michigan Hub	31.07	29.25	29.80	29.19	31.00	31.25	30.72	63.06	31.49	47.60	41.36	42.81	47.86	39.12	30.29	29.91	30.80	34.56	57.29	38.76	38.75	43.72	35.37	41.51	37.77	40.80
Minnesota Hub	6.08	19.59	19.90	21.37	22.54	23.63	25.54	32.51	27.21	42.37	38.05	40.15	44.62	35.84	27.11	26.31	25.12	31.90	55.33	37.82	37.32	39.87	30.94	39.84	31.29	35.78
Wisconsin PS	26.54	25.13	25.46	25.81	27.29	28.04	28.82	18.87	29.92	45.77	40.45	41.89	46.56	37.73	28.79	27.76	25.63	34.25	58.11	39.07	38.72	40.52	30.99	41.02	33.88	36.56
Forecasted Load (GW)	67.8	67.4	65.2	64.6	64.7	66.5	68.3	70.3	72.4	73.1	73.9	73.7	72.9	71.8	70.7	70.0	70.6	74.1	77.9	77.9	76.8	75.3	73.1	70.3		
Forecast Error %	#####	-1.7%	0.0%	0.0%	0.4%	-0.5%	0.3%	1.6%	1.4%	2.5%	2.2%	1.8%	1.8%	1.6%	1.5%	1.6%	1.5%	1.4%	1.9%	1.7%	1.8%	1.8%	1.5%	-16.0%		

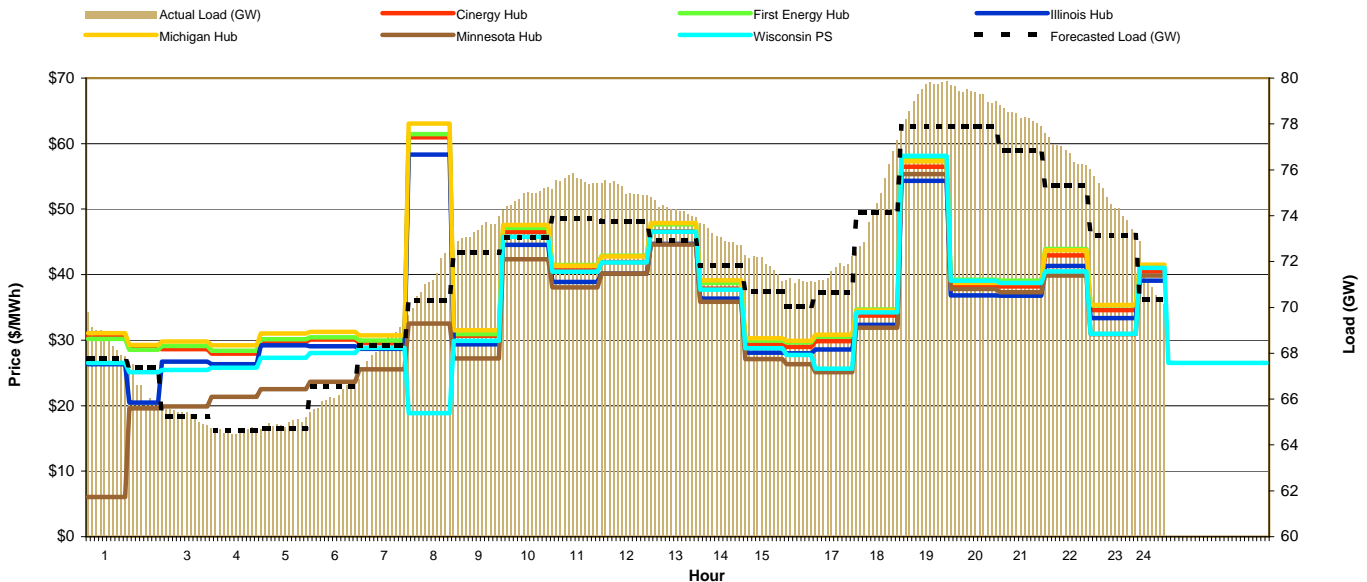




MISO Daily Report

Sunday January 9, 2011

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	31.93	31.21	30.11	29.79	28.56	28.48	30.12	34.36	36.25	40.46	38.44	34.09	31.62	30.32	29.36	29.46	31.95	45.15	61.65	47.83	46.98	42.54	34.11	28.88	35.57	38.41
First Energy Hub	31.78	30.99	29.89	29.59	28.37	28.38	29.93	33.96	35.82	40.15	38.28	33.92	31.48	30.02	29.09	29.14	30.91	43.12	61.32	47.16	46.37	41.96	33.98	28.67	35.18	37.92
Illinois Hub	22.49	21.48	20.69	20.77	20.02	21.10	23.66	25.53	26.84	31.38	30.88	26.55	25.00	22.80	22.34	22.01	24.07	33.47	47.44	33.00	33.38	30.10	24.20	19.59	26.20	28.69
Michigan Hub	32.86	32.05	30.91	30.60	29.34	29.35	30.71	34.84	36.75	41.20	39.27	34.79	32.29	30.79	29.84	29.89	32.44	45.90	62.90	48.38	47.56	43.05	35.14	29.66	36.27	39.06
Minnesota Hub	26.14	24.59	23.20	22.57	21.89	22.11	26.23	29.13	30.62	34.42	33.12	30.19	28.41	27.15	26.27	26.29	27.96	39.27	59.10	46.31	41.38	35.52	28.47	24.44	30.62	33.98
Wisconsin PS	27.24	24.81	22.92	21.91	21.51	21.93	26.49	28.80	30.39	34.23	33.23	31.06	29.58	28.33	27.36	27.35	28.60	38.27	60.86	46.93	42.68	34.94	30.17	26.28	31.07	34.55
Cleared Load (GW)	66.4	65.0	64.1	64.0	63.7	65.1	67.6	70.2	71.2	71.9	71.6	71.3	70.4	69.4	68.5	68.2	69.4	76.0	79.2	79.1	78.2	76.0	72.7	6.9		

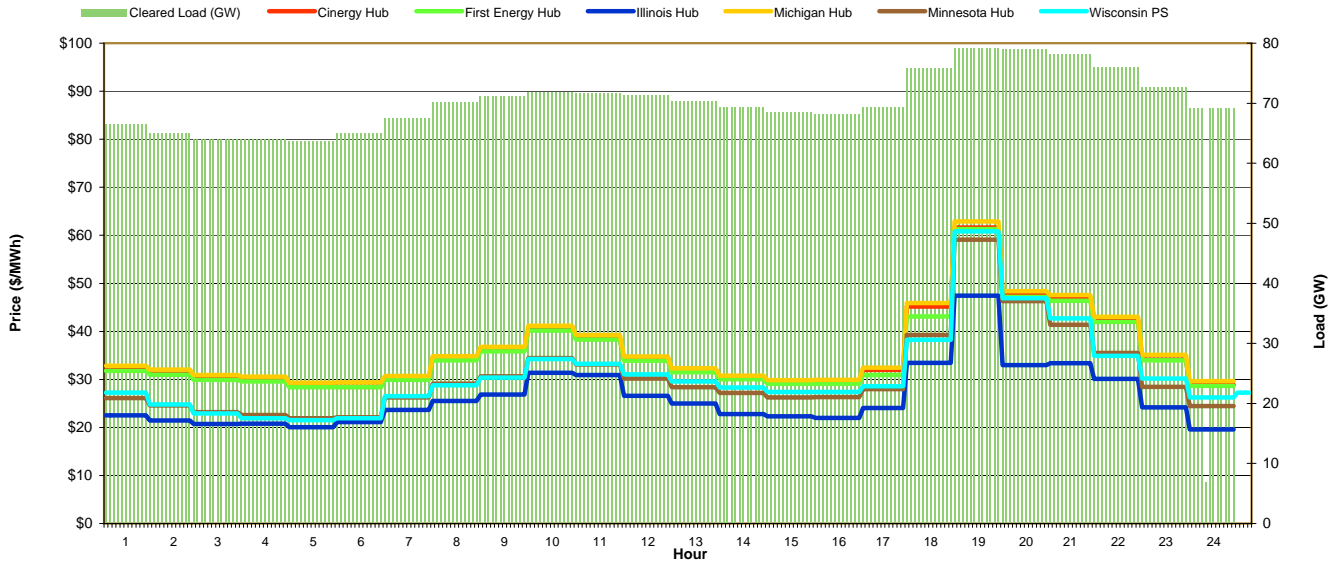

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	30.07	56.52	29.58	37.42	29.60	29.25	32.03	95.18	33.39	30.29	34.86	31.86	30.36	29.04	27.02	27.68	24.82	32.54	33.71	30.66	31.15	31.65	29.43	25.67	34.32	34.60
First Energy Hub	30.48	57.24	29.86	37.80	29.93	29.55	32.25	95.28	33.49	30.45	35.14	32.25	30.81	29.50	27.57	28.30	25.32	33.08	34.25	31.18	31.65	32.07	29.88	26.11	34.73	35.01
Illinois Hub	29.00	54.36	28.40	36.41	28.33	27.98	30.67	91.23	32.12	29.28	33.72	30.83	29.42	28.20	26.30	27.01	24.16	31.60	32.89	29.87	30.29	30.72	28.54	24.78	33.17	33.51
Michigan Hub	30.75	58.01	30.30	38.18	30.22	29.77	32.61	96.98	33.91	30.77	35.61	32.73	31.32	29.97	27.98	28.76	25.76	33.48	34.26	31.16	31.69	32.49	30.49	26.73	35.16	35.46
Minnesota Hub	29.60	54.43	27.49	36.82	26.75	26.21	28.78	85.92	31.46	26.88	33.56	30.93	29.54	28.40	26.31	26.63	23.68	27.12	35.33	32.04	31.82	31.58	28.46	24.30	32.08	33.10
Wisconsin PS	30.37	56.44	29.26	36.82	28.87	28.50	31.33	93.43	33.22	30.23	35.07	32.12	30.71	29.59	27.60	28.27	25.21	24.28	35.55	32.08	32.28	32.27	29.36	25.61	34.10	34.45
Forecasted Load (GW)	69.6	66.7	65.7	65.1	66.1	66.6	68.1	70.1	69.8	70.5	70.7	70.3	69.9	69.2	68.6	68.3	69.3	73.7	78.1	78.5	77.7	76.0	73.4	70.7		
Forecast Error %	-29.4%	0.2%	0.1%	0.4%	-1.2%	-1.3%	-1.2%	-0.8%	1.9%	1.9%	1.6%	1.3%	0.9%	0.9%	0.7%	0.8%	0.8%	-0.1%	0.1%	-0.5%	-0.4%	-0.5%	-1.3%	-11.6%		

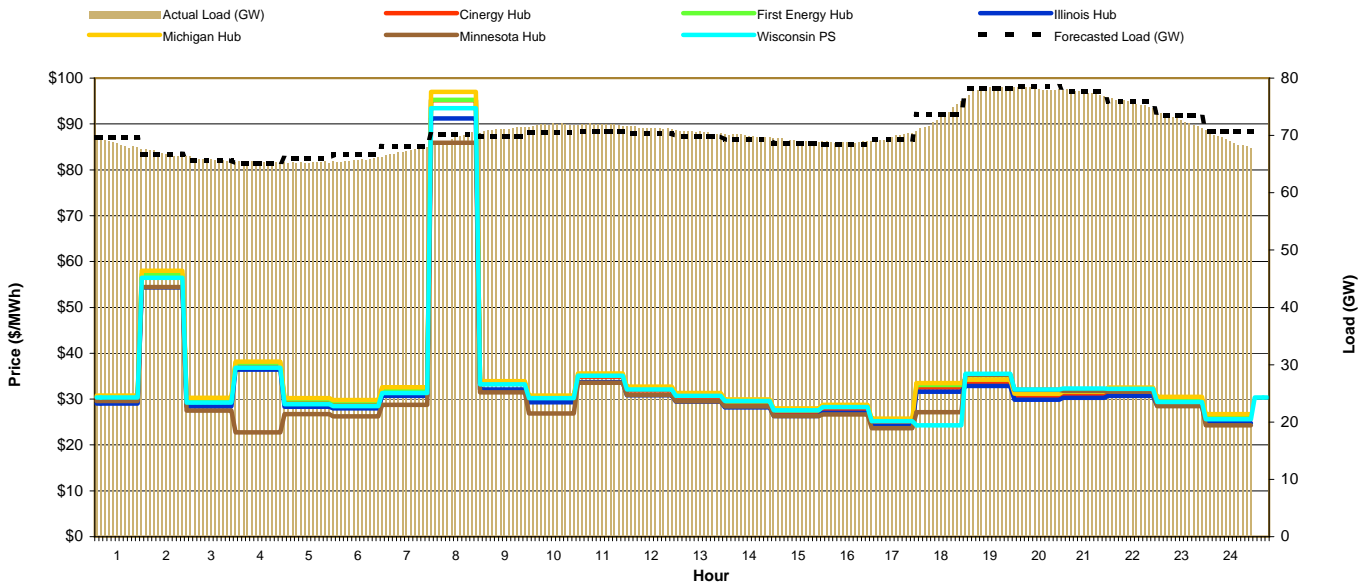




MISO Daily Report

Monday January 10, 2011

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	33.99	35.09	34.20	33.66	34.05	36.56	45.00	55.75	50.00	49.64	47.34	45.32	41.75	38.47	35.24	33.28	34.11	48.09	59.45	49.87	46.25	43.47	35.00	30.60	41.51	44.56
First Energy Hub	30.51	30.80	30.65	30.47	30.73	33.93	43.61	55.85	49.96	49.08	46.86	44.88	41.23	37.87	34.71	32.84	33.60	47.55	59.30	49.36	45.66	42.97	32.27	30.36	40.21	44.00
Illinois Hub	20.00	20.84	20.58	20.74	20.43	23.23	27.15	42.94	35.54	34.51	33.98	32.87	30.32	26.98	24.83	23.91	24.13	34.27	46.15	34.62	32.35	30.86	25.51	21.22	28.67	32.11
Michigan Hub	34.76	35.97	36.86	36.69	36.88	37.96	43.58	55.49	49.18	49.46	47.52	45.54	42.16	38.72	35.47	33.56	34.35	48.24	60.17	50.01	46.65	43.90	36.07	31.40	42.11	44.78
Minnesota Hub	22.81	22.16	20.95	20.87	21.10	24.49	33.87	43.93	44.82	44.84	43.34	40.67	36.42	33.20	30.67	29.05	29.56	43.60	57.23	47.23	41.89	38.28	29.60	26.07	34.44	39.65
Wisconsin PS	23.36	21.76	21.05	20.88	20.74	22.48	30.82	40.03	45.19	44.37	43.25	40.77	36.81	33.78	31.42	29.80	30.17	43.73	58.65	48.76	43.09	39.53	31.77	28.23	34.60	40.07
Cleared Load (GW)	56.3	54.8	53.8	54.1	54.6	58.1	68.3	72.0	71.0	71.2	71.1	71.3	70.7	69.9	69.2	68.3	68.6	74.4	74.9	73.7	72.5	69.7	65.0	6.0		

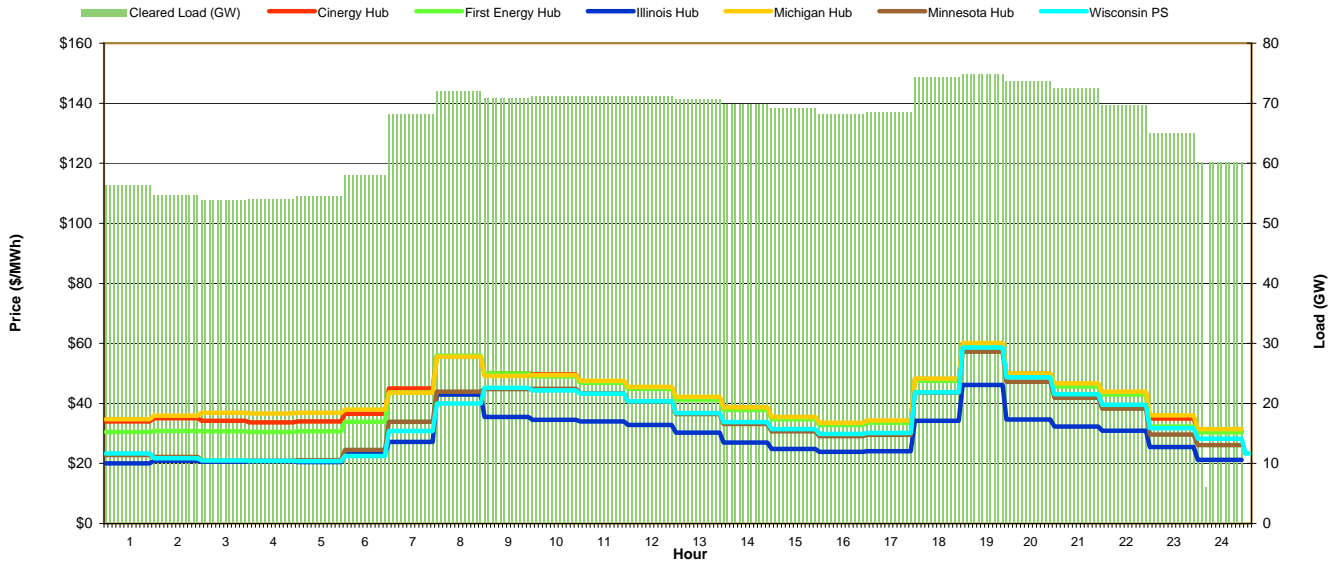

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	27.48	32.91	22.32	25.57	22.73	21.54	33.40	33.48	36.46	36.02	47.22	35.55	101.17	34.39	32.53	29.14	30.29	74.40	72.53	46.48	40.82	32.02	29.27	29.74	38.64	44.49
First Energy Hub	27.78	65.98	22.64	43.86	22.97	20.64	26.72	16.55	37.25	36.90	48.46	36.43	103.83	35.23	33.30	29.89	31.09	69.73	57.12	43.09	37.14	30.79	29.85	29.98	39.05	42.29
Illinois Hub	26.62	17.87	22.13	18.79	22.42	20.66	25.24	29.50	34.92	34.46	45.16	34.09	97.54	38.68	32.66	28.43	29.12	67.92	53.64	42.72	37.48	30.69	28.06	28.45	35.30	41.57
Michigan Hub	28.50	150.99	23.64	91.43	23.62	22.15	32.71	33.50	37.04	36.76	48.27	36.54	104.63	35.26	33.48	30.00	31.19	72.92	56.76	45.18	39.80	32.85	30.18	30.84	46.18	44.02
Minnesota Hub	13.26	20.81	21.78	21.03	20.78	19.38	25.22	30.74	34.20	33.96	43.61	33.17	80.81	39.62	31.66	27.95	28.12	56.10	52.78	42.81	37.10	29.67	27.29	28.62	33.35	39.35
Wisconsin PS	3.31	18.20	22.88	19.15	22.66	21.41	27.42	31.40	36.86	36.14	46.23	35.72	76.56	35.74	31.91	29.81	30.52	54.26	56.78	45.03	39.13	31.43	29.35	29.79	33.82	40.43
Forecasted Load (GW)	60.4	58.6	57.6	57.2	57.7	59.5	64.3	69.9	71.0	71.0	71.0	70.7	70.4	69.8	69.0	68.2	68.3	71.1	74.5	74.0	72.8	70.7	67.2	64.0		
Forecast Error %	-11.5%	-3.4%	-3.7%	-4.2%	-3.9%	-2.8%	-1.7%	-1.0%	-0.2%	0.1%	0.2%	0.7%	0.3%	0.7%	1.5%	2.2%	2.2%	0.6%	1.0%	1.1%	0.9%	0.9%	-9.6%			

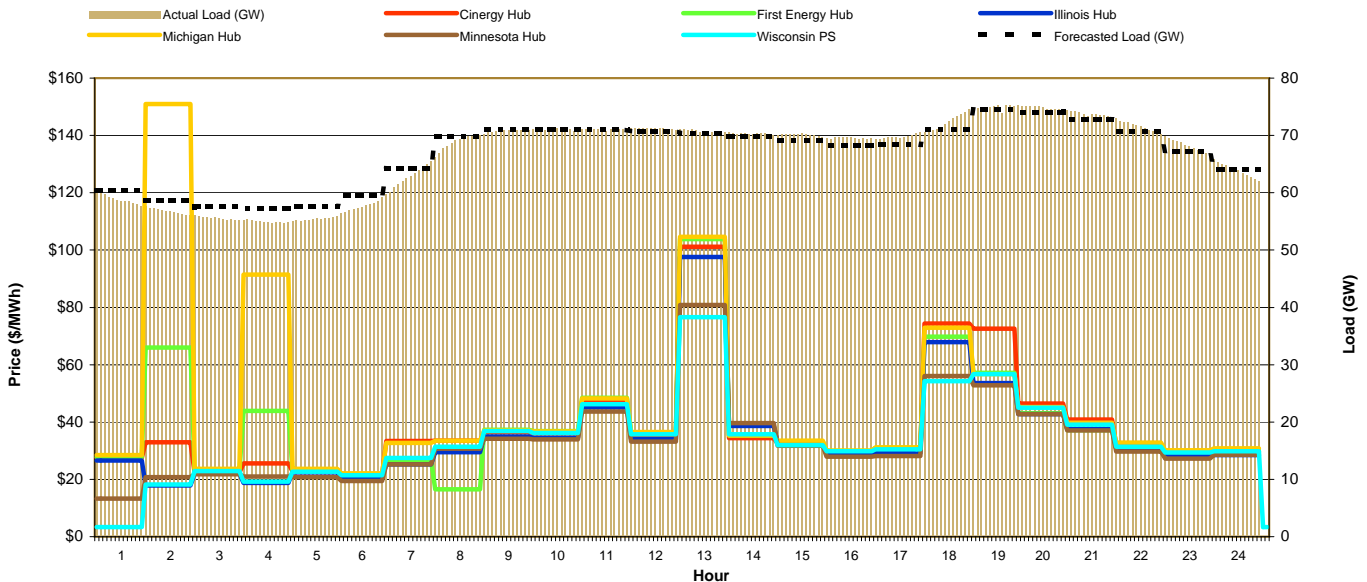




MISO Daily Report

Tuesday January 11, 2011

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	29.17	29.24	28.33	27.59	27.73	31.29	39.32	53.71	49.15	50.10	48.11	46.98	44.29	41.56	38.49	36.49	37.55	49.12	53.40	47.92	44.65	41.20	32.23	32.15	39.99	44.68
First Energy Hub	29.48	29.50	28.34	27.75	27.98	30.80	36.28	53.71	49.68	50.09	48.13	46.89	44.14	39.82	34.69	32.54	33.40	49.03	53.26	47.90	44.65	41.09	31.01	30.09	39.18	43.75
Illinois Hub	21.62	21.06	20.81	20.81	20.66	20.65	27.59	45.86	41.58	41.96	40.41	39.10	36.31	33.59	31.31	28.80	29.68	40.79	43.64	40.17	37.70	33.61	25.69	23.17	31.94	36.89
Michigan Hub	31.79	31.86	29.91	29.81	30.26	31.72	38.97	54.50	48.44	50.65	48.64	47.57	44.78	41.96	38.88	36.75	37.79	49.73	54.01	48.57	45.28	41.52	32.71	32.42	40.77	45.11
Minnesota Hub	22.91	21.37	20.56	20.05	20.05	21.23	28.70	44.07	43.80	44.24	42.67	40.37	36.99	34.18	31.92	29.18	29.48	41.98	50.43	44.87	40.59	33.65	21.65	19.98	32.71	38.13
Wisconsin PS	24.24	21.98	21.20	20.14	20.49	22.03	29.28	41.20	44.45	44.95	43.39	40.73	36.34	35.80	34.66	30.87	32.64	45.25	53.56	47.96	42.79	36.81	26.91	24.98	34.27	39.89
Cleared Load (GW)	56.3	54.8	53.8	54.1	54.6	58.1	68.3	72.0	71.0	71.2	71.1	71.3	70.7	69.9	69.2	68.3	68.6	74.4	74.9	73.7	72.5	69.7	65.0	6.0		

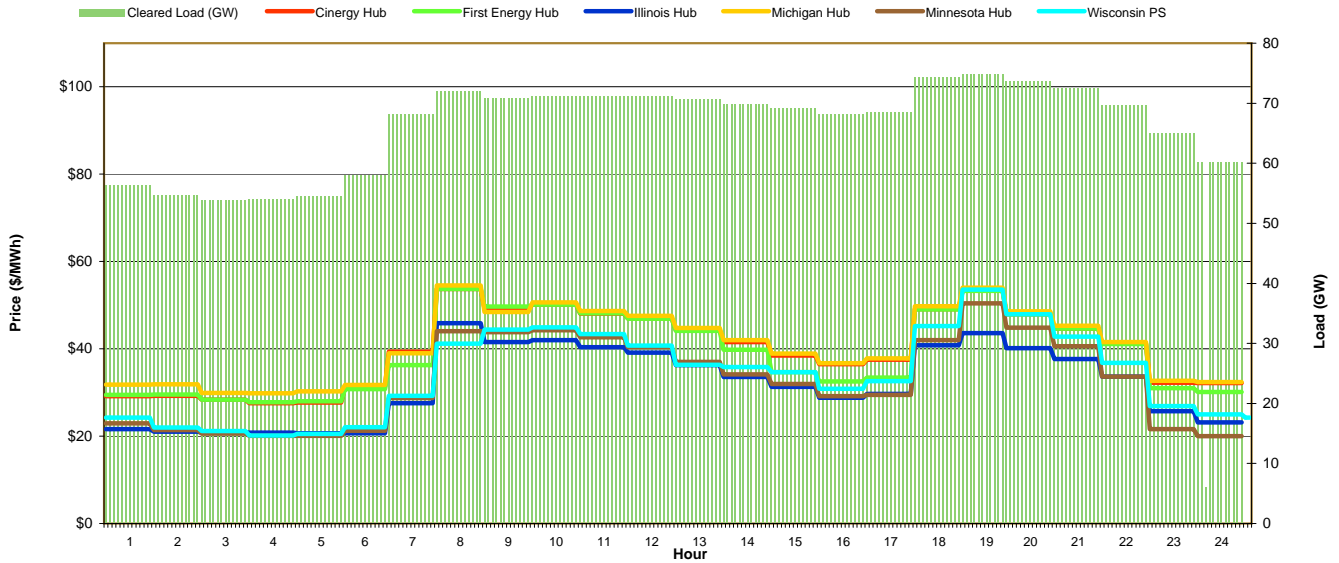

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	26.05	24.69	24.76	24.55	24.99	25.86	33.17	108.57	36.24	36.05	69.05	33.30	35.57	33.63	36.57	30.75	30.72	38.73	42.46	45.56	45.71	32.98	29.32	26.08	37.31	42.83
First Energy Hub	26.76	25.26	25.27	25.04	25.50	26.36	33.90	95.01	36.50	37.16	71.93	34.42	36.51	34.63	38.15	31.19	29.70	25.78	38.94	39.61	37.89	28.17	28.66	26.80	35.80	40.27
Illinois Hub	24.98	23.77	23.80	23.55	23.95	24.80	31.67	89.16	33.82	34.67	67.73	32.45	34.49	32.64	36.03	30.23	30.48	36.70	36.64	37.89	36.94	29.90	28.25	26.29	34.62	39.25
Michigan Hub	27.06	25.55	25.54	25.36	25.91	26.67	34.15	95.43	39.01	37.37	71.97	34.56	36.84	34.85	38.35	31.83	31.88	38.83	38.86	40.04	39.26	32.01	30.27	27.34	37.04	41.96
Minnesota Hub	24.53	22.92	22.26	21.83	22.10	23.21	30.28	90.39	48.72	39.35	72.40	34.43	36.23	33.87	37.13	31.03	31.53	39.21	38.14	40.53	37.92	30.99	28.38	26.56	36.00	41.89
Wisconsin PS	26.11	24.79	24.63	24.26	24.61	25.70	33.08	94.80	41.13	37.90	72.09	34.53	36.59	34.60	38.21	31.85	32.11	38.98	39.42	40.86	39.38	31.67	29.92	27.66	36.87	42.12
Forecasted Load (GW)	60.4	58.6	57.6	57.2	57.7	59.5	64.3	69.9	71.0	71.0	71.0	70.7	70.4	69.8	69.0	68.2	68.3	71.1	74.5	74.0	72.8	70.7	67.2	64.0		
Forecast Error %	-11.5%	-3.4%	-3.7%	-4.2%	-3.9%	-2.8%	-1.7%	-1.0%	-0.2%	0.1%	0.2%	0.7%	0.3%	0.7%	1.5%	1.9%	2.2%	2.2%	0.6%	1.0%	1.1%	0.9%	0.9%	-9.6%		

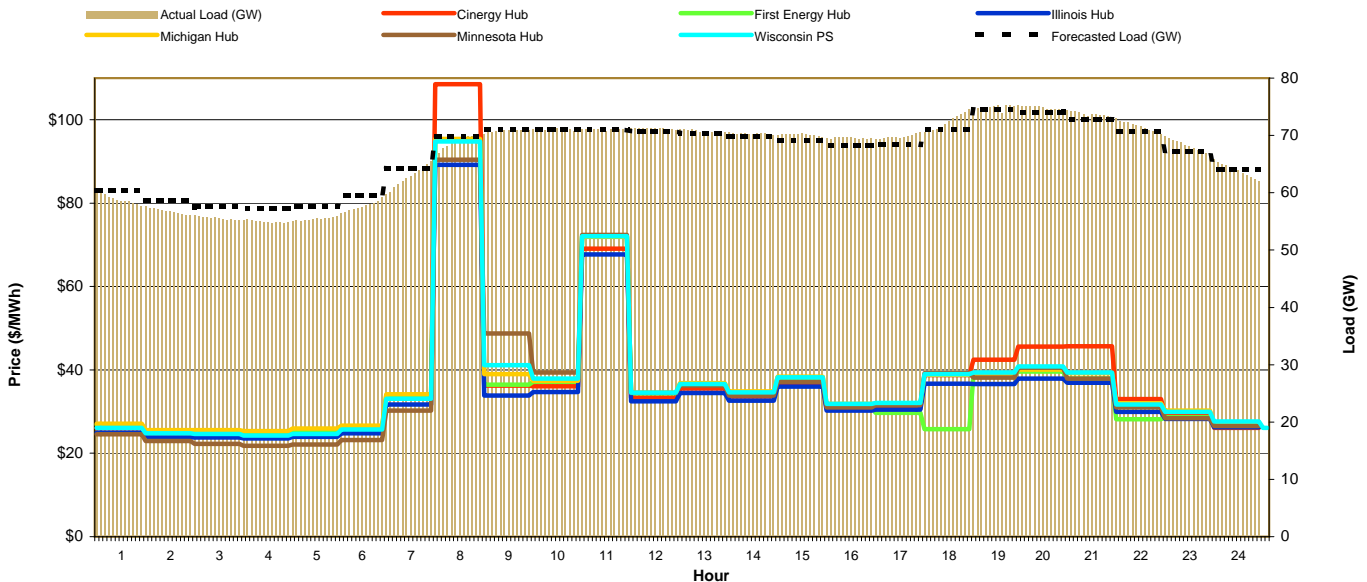




MISO Daily Report

Wednesday January 12, 2011

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	30.98	32.08	30.47	30.08	30.36	33.88	42.00	60.36	57.43	57.01	55.57	53.89	50.12	47.54	43.23	40.96	42.69	58.58	71.64	62.61	56.12	52.40	40.46	35.32	48.49	53.16
First Energy Hub	31.08	32.13	30.45	30.08	30.35	34.02	41.30	55.48	53.14	52.90	51.81	50.04	47.16	44.18	40.62	38.50	39.91	54.96	65.68	58.84	52.60	49.96	39.96	34.77	44.16	49.73
Illinois Hub	23.65	24.43	23.61	23.81	23.83	26.18	33.39	48.53	46.31	44.52	43.19	41.70	39.69	37.17	34.25	31.47	33.10	47.11	56.31	49.91	45.82	43.32	34.96	30.80	36.96	42.34
Michigan Hub	31.60	32.66	30.94	30.56	30.85	34.60	41.43	55.91	53.36	53.38	52.31	50.50	47.57	44.52	41.22	38.70	40.50	55.68	66.20	59.22	53.22	50.57	41.69	36.37	44.73	50.28
Minnesota Hub	19.22	19.05	18.73	18.63	18.70	19.78	24.67	38.21	43.06	43.45	42.24	41.07	39.37	36.57	33.93	32.63	33.44	47.18	58.98	53.65	47.41	43.21	33.97	29.37	34.86	41.77
Wisconsin PS	24.73	24.64	24.34	24.31	24.34	25.21	28.29	36.95	40.18	39.93	38.99	38.18	37.13	34.34	32.45	32.73	31.70	42.60	58.13	52.00	45.68	40.96	31.78	29.61	34.96	39.61
Cleared Load (GW)	56.3	54.8	53.8	54.1	54.6	58.1	68.3	72.0	71.0	71.2	71.1	71.3	70.7	69.9	69.2	68.3	68.6	74.4	74.9	73.7	72.5	69.7	65.0	6.0		

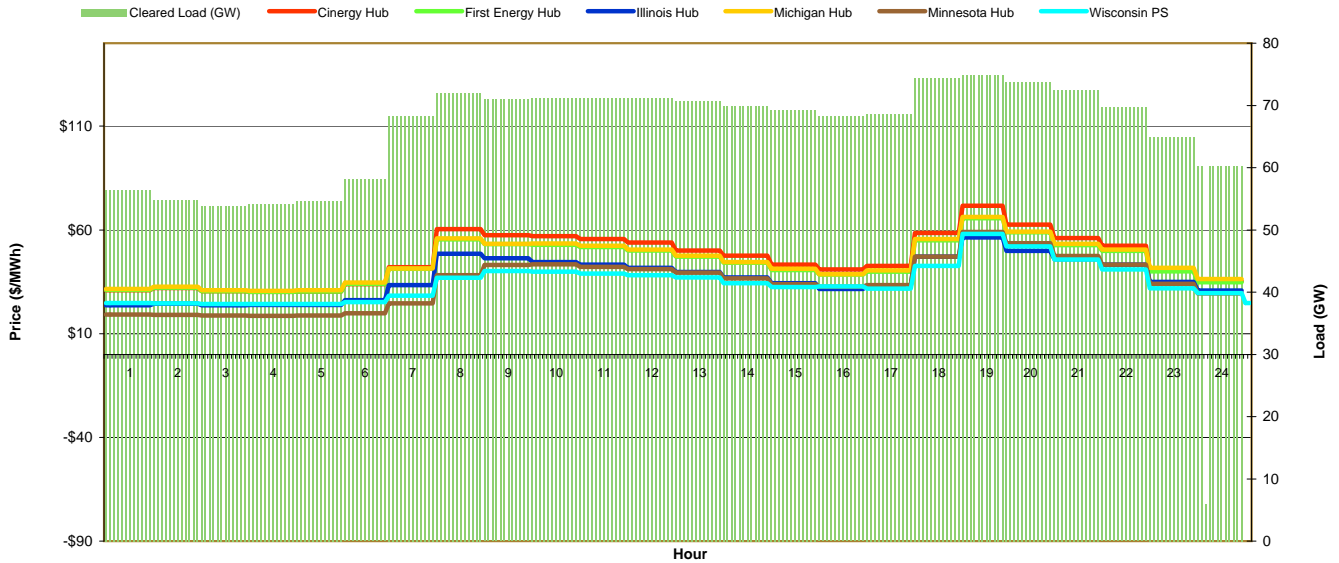

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	25.52	25.90	26.20	34.63	23.04	24.41	41.68	49.85	47.01	42.24	48.17	38.50	46.31	39.26	42.80	48.69	52.11	84.04	142.75	61.99	48.86	40.15	32.80	32.77	45.82	54.10
First Energy Hub	23.98	25.82	26.45	98.69	22.18	23.86	31.86	36.00	35.28	34.42	41.40	36.56	40.70	37.15	34.44	35.27	31.05	40.54	55.53	20.07	40.32	35.37	20.22	30.57	35.74	35.90
Illinois Hub	25.08	26.86	27.05	19.79	23.63	23.49	32.08	36.10	40.01	37.90	42.37	34.60	39.94	35.40	37.05	35.95	33.59	48.38	73.17	43.84	40.37	36.63	31.00	31.44	35.66	40.39
Michigan Hub	26.83	27.29	27.64	89.22	24.10	25.38	34.80	39.06	42.91	40.67	45.33	37.15	43.00	38.57	40.52	39.27	36.47	51.94	77.81	46.37	42.88	38.66	32.73	33.79	33.50	43.33
Minnesota Hub	24.48	26.41	25.63	20.49	23.40	22.48	26.35	33.91	41.87	39.01	39.11	34.18	38.55	32.80	34.21	32.74	31.04	40.55	73.80	47.68	41.42	36.71	33.59	31.88	34.68	39.45
Wisconsin PS	26.22	27.47	26.41	20.13	24.22	24.16	23.89	35.15	42.04	39.20	35.99	33.64	36.88	31.48	32.02	30.85	29.14	33.75	69.62	43.76	41.27	34.54	31.01	30.18	33.46	37.52
Forecasted Load (GW)	60.4	58.6	57.6	57.2	57.7	59.5	64.3	69.9	71.0	71.0	71.0	70.7	70.4	69.8	69.0	68.2	68.3	71.1	74.5	74.0	72.8	70.7	67.2	64.0		
Forecast Error %	-11.5%	-3.4%	-3.7%	-4.2%	-3.9%	-2.8%	-1.7%	-1.0%	-0.2%	0.1%	0.2%	0.7%	0.3%	0.7%	1.5%	1.9%	2.2%	2.2%	0.6%	1.0%	1.1%	0.9%	0.9%	-9.6%		

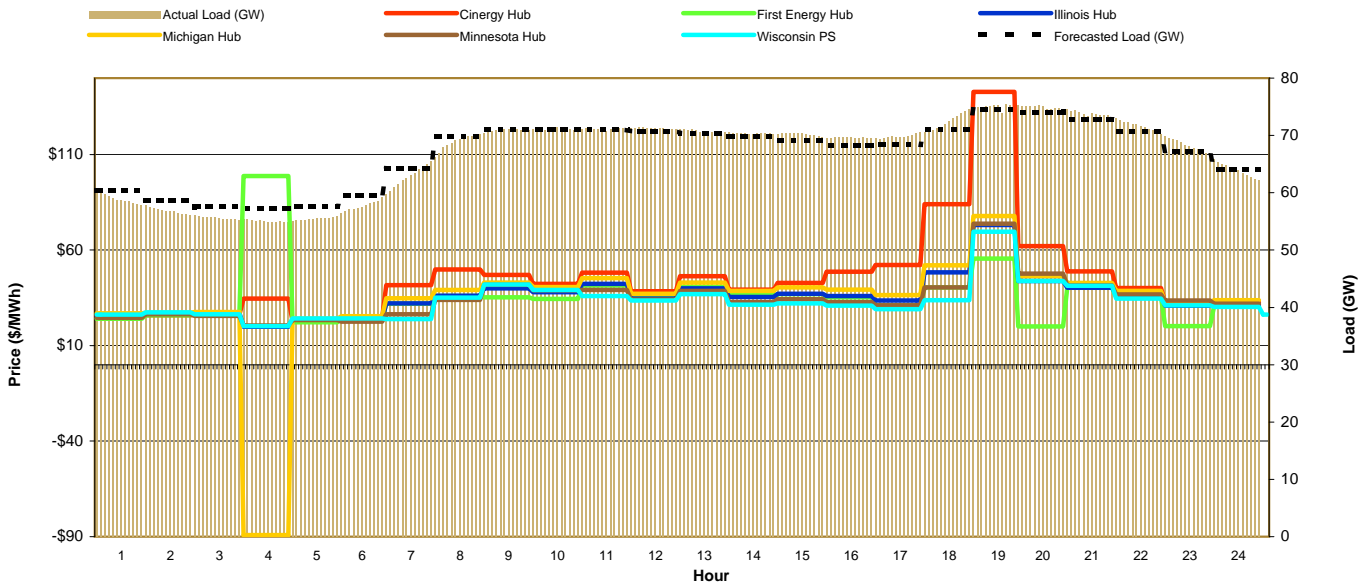




MISO Daily Report

Thursday January 13, 2011

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	33.23	31.27	30.63	30.20	30.12	33.82	52.80	69.37	58.31	60.49	60.28	54.66	51.72	48.41	42.61	40.86	42.00	56.70	69.43	59.94	56.09	51.15	37.18	35.81	47.38	53.70
First Energy Hub	34.49	32.31	31.59	31.10	31.00	34.87	48.82	62.38	55.01	56.43	56.64	52.15	49.93	46.65	41.77	39.92	40.64	54.69	65.61	56.79	53.02	49.28	38.04	35.71	45.79	51.18
Illinois Hub	28.67	27.69	27.08	26.98	26.87	28.35	40.94	58.53	49.26	50.72	49.81	46.54	45.09	42.15	36.92	34.91	35.70	51.23	61.53	50.25	49.58	46.35	35.44	33.22	40.99	46.50
Michigan Hub	33.46	31.38	30.64	30.23	30.03	33.65	47.53	62.59	53.97	56.40	56.67	52.09	49.83	46.46	41.44	39.56	40.27	54.72	65.73	56.59	52.95	49.21	37.89	35.96	45.39	51.02
Minnesota Hub	26.86	22.63	21.27	20.53	20.07	20.66	25.90	40.35	42.64	41.63	35.94	32.85	30.65	26.60	25.44	26.08	30.95	42.47	56.19	48.75	43.27	38.97	30.09	28.32	32.46	37.05
Wisconsin PS	26.10	24.15	23.58	23.27	23.17	24.00	30.24	37.20	38.87	38.89	36.33	34.17	33.10	30.91	30.08	29.83	30.63	36.78	52.79	46.32	39.97	34.66	30.80	28.95	32.70	36.33
Cleared Load (GW)	70.5	69.5	68.6	68.3	68.8	71.4	76.8	83.9	84.3	84.3	84.3	83.4	82.6	81.4	80.3	79.3	79.0	82.6	84.9	84.4	83.4	81.1	77.0	7.3		

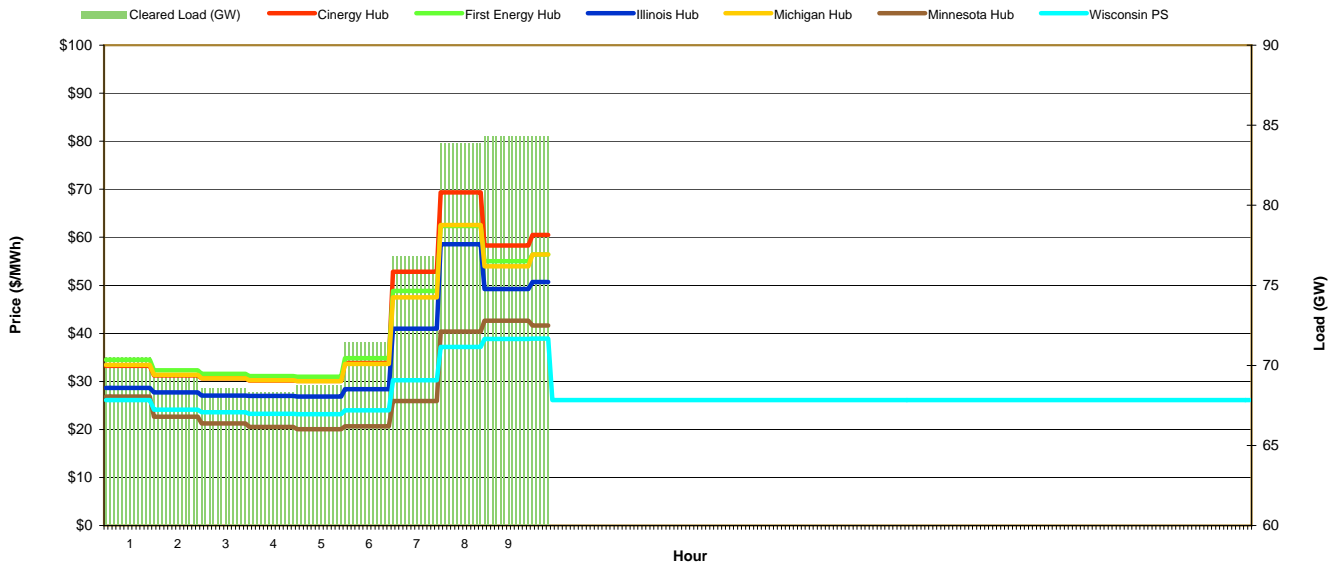

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	29.22	29.63	28.50	25.92	28.49	36.54	35.27	54.47	95.43	42.51	43.13	27.55	26.14	27.47	25.99	27.55	30.06	34.42	48.44	38.18	43.57	30.20	25.15	27.69	35.90	38.77
First Energy Hub	28.90	30.22	29.06	26.41	29.06	18.70	4.66	32.75	71.73	34.23	31.24	25.66	22.88	23.09	25.86	23.55	25.60	7.78	25.46	30.89	27.66	21.58	25.73	27.11	27.08	28.48
Illinois Hub	28.62	28.32	27.23	24.85	27.24	30.82	25.43	41.64	79.56	33.65	29.31	26.63	25.32	26.52	29.75	26.63	28.78	32.50	44.18	35.03	29.92	28.67	25.89	26.88	31.81	34.00
Michigan Hub	30.82	31.07	29.73	27.03	29.65	33.19	27.38	45.53	85.84	35.55	31.21	28.35	27.17	28.74	27.23	28.68	30.97	34.30	46.52	36.95	31.65	26.86	26.23	28.84	33.73	35.74
Minnesota Hub	29.92	28.70	26.63	23.98	25.87	28.96	27.77	42.60	81.89	33.64	28.80	26.29	24.72	26.07	32.93	26.81	28.85	35.31	47.31	36.40	30.91	32.95	27.50	27.57	32.60	35.19
Wisconsin PS	29.71	29.08	27.73	25.33	27.34	26.75	25.93	42.98	82.80	34.64	30.38	27.67	26.34	27.58	30.83	27.83	29.80	33.52	45.82	36.33	31.19	29.84	27.10	28.30	32.70	35.29
Forecasted Load (GW)	71.3	70.4	68.4	68.1	68.7	71.9	76.8	82.0	84.1	83.4	82.8	82.0	81.2	80.5	79.7	79.0	79.2	82.1	85.4	85.3	83.7	81.4	77.8	73.7		
Forecast Error %	#####	-1.9%	-0.6%	-0.7%	-0.7%	-1.7%	-1.1%	-0.7%	-0.6%	-25.2%	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!		

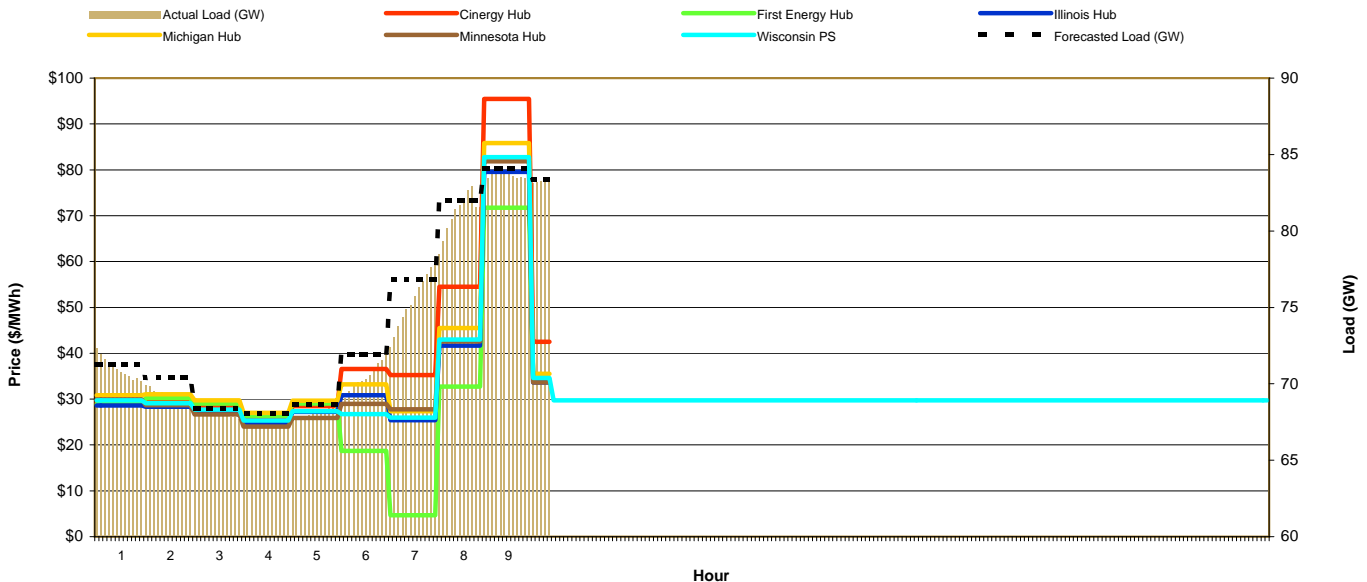




MISO Daily Report

Friday January 14, 2011

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	35.73	35.53	32.67	32.19	33.64	36.50	48.39	62.14	59.39	53.86	50.76	51.36	47.37	43.63	38.07	36.69	38.22	50.32	56.23	47.16	43.88	36.86	34.96	33.54	43.30	46.93
First Energy Hub	30.21	28.59	27.11	27.11	28.64	31.29	35.17	50.06	50.28	45.85	49.60	46.84	45.47	41.76	36.26	34.53	34.35	40.58	45.62	39.35	37.26	34.68	33.80	33.76	37.84	41.64
Illinois Hub	26.65	26.08	25.24	25.47	25.73	27.71	36.20	54.72	53.49	50.05	48.27	47.17	44.14	39.50	35.59	31.67	33.74	45.52	50.80	43.33	40.72	35.16	32.06	24.82	37.66	42.87
Michigan Hub	35.51	34.98	32.05	31.27	32.67	34.74	42.30	56.64	54.89	52.07	49.50	50.47	46.73	42.96	37.53	35.50	36.57	48.72	53.86	46.29	43.57	37.42	35.42	31.81	41.81	45.51
Minnesota Hub	25.14	24.28	23.68	23.32	23.35	24.71	33.18	46.59	47.54	45.37	44.19	41.19	38.23	37.14	33.18	30.66	32.07	41.21	51.07	42.19	38.99	33.59	28.49	24.05	34.73	39.48
Wisconsin PS	25.63	25.07	24.48	23.44	23.81	25.47	31.70	40.74	43.30	41.64	40.29	37.30	35.03	36.69	33.20	31.37	31.85	39.71	54.26	43.72	39.50	34.07	29.15	25.96	34.06	38.24
Cleared Load (GW)	69.3	67.8	66.4	66.0	66.8	69.9	74.4	80.8	80.6	80.9	80.9	79.6	78.7	78.2	77.2	76.2	76.6	79.0	81.4	79.4	78.2	76.3	72.8	6.9		

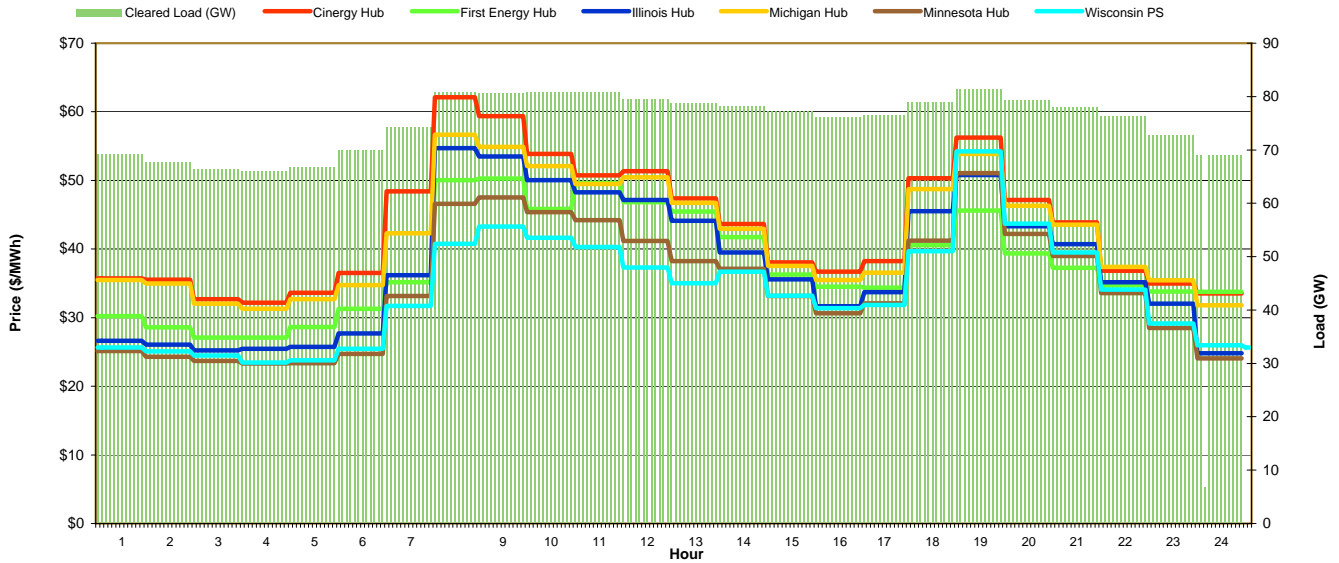

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	26.53	25.96	24.31	24.81	28.84	24.18	32.04	52.62	52.52	44.13	50.93	35.57	33.15	30.63	29.50	27.94	25.73	33.18	41.95	33.30	31.60	27.66	27.56	31.31	33.16	36.12
First Energy Hub	26.22	26.63	24.84	25.33	29.49	24.76	30.81	36.80	45.54	43.77	49.12	36.64	33.73	30.53	28.16	25.71	23.46	32.40	40.51	29.39	30.41	26.91	25.50	29.23	31.50	33.66
Illinois Hub	25.54	25.60	25.63	27.20	27.51	23.06	28.58	34.75	42.54	41.31	48.99	34.38	32.15	29.70	28.62	27.12	24.96	32.16	40.78	32.42	30.62	26.78	26.27	37.53	31.43	33.35
Michigan Hub	27.68	27.15	25.24	25.77	29.92	24.96	30.74	36.24	45.23	44.00	52.16	36.79	34.52	31.98	30.85	29.17	26.83	34.25	42.87	34.15	32.54	28.62	28.65	30.90	32.97	35.55
Minnesota Hub	25.10	25.14	25.92	28.20	25.23	21.55	27.26	35.09	43.59	42.57	51.62	35.51	33.30	30.64	29.42	27.53	24.84	31.40	38.20	28.30	26.55	21.26	24.23	8.66	29.63	32.75
Wisconsin PS	26.72	26.52	26.24	27.68	27.17	23.77	29.73	36.26	44.40	42.89	51.03	35.85	33.73	31.38	30.27	28.66	26.34	33.87	42.85	33.77	31.62	27.94	27.67	25.21	32.15	34.91
Forecasted Load (GW)	70.9	70.0	67.8	67.5	68.0	71.0	75.4	79.9	81.7	81.4	80.9	80.0	78.9	77.9	76.9	75.9	75.8	78.1	81.1	80.3	78.9	76.9	74.1	69.7		
Forecast Error %	-11.1%	-4.2%	-2.7%	-2.5%	-2.5%	-3.4%	-2.1%	-0.5%	-0.6%	-0.7%	-0.8%	-1.0%	-1.0%	-0.7%	-0.4%	-0.2%	-0.4%	-0.7%	-0.8%	-1.2%	-1.3%	-1.2%	-1.4%	-9.6%		

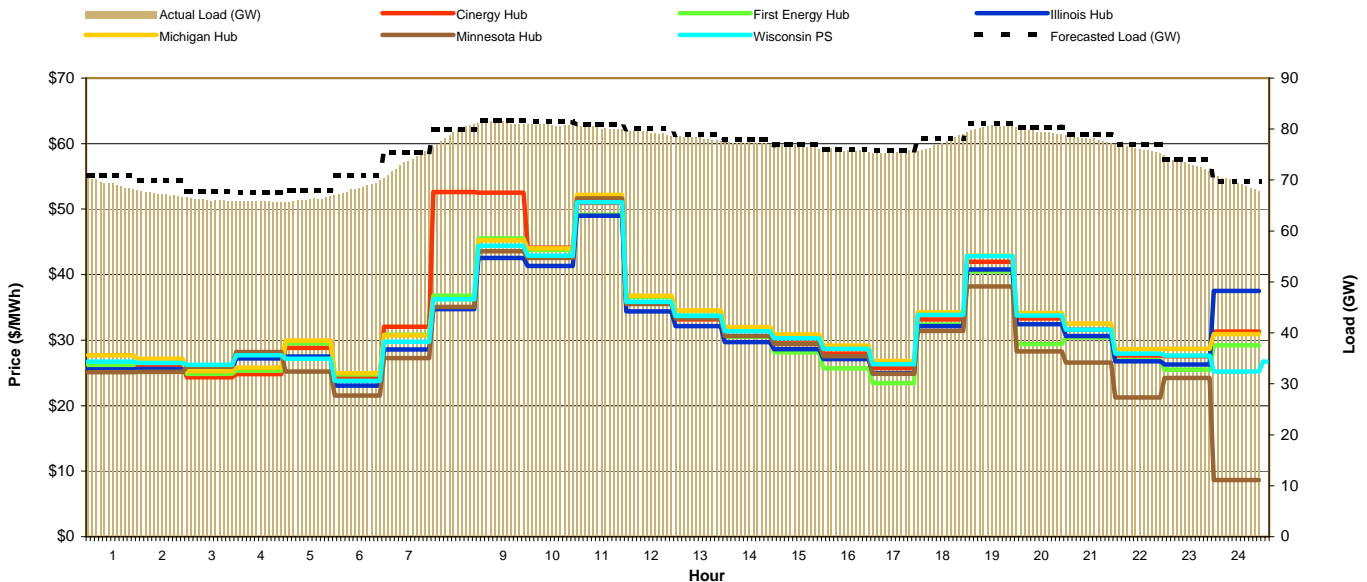




MISO Daily Report

Saturday January 15, 2011

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	29.21	28.84	28.13	27.74	27.06	27.62	30.63	36.74	37.93	47.64	47.36	46.02	39.89	34.66	32.30	31.35	32.77	46.84	56.15	49.57	46.23	42.93	37.39	32.03	37.38	41.61
First Energy Hub	30.35	29.94	29.25	29.07	28.21	28.76	30.55	35.97	37.63	48.12	48.01	46.93	40.59	35.46	33.05	32.08	33.52	46.99	56.64	50.64	47.36	43.91	37.97	33.06	38.09	42.18
Illinois Hub	24.92	24.43	23.73	24.02	22.95	22.97	24.06	32.43	36.38	44.93	44.62	43.93	37.98	33.20	30.94	30.03	31.39	43.86	52.86	47.20	44.15	41.12	35.81	30.47	34.52	39.43
Michigan Hub	28.54	28.09	27.13	26.54	26.04	26.39	27.97	35.95	36.95	48.11	47.60	47.13	40.88	35.70	33.28	32.29	33.75	47.31	57.00	50.60	47.30	44.21	39.04	32.29	37.50	42.32
Minnesota Hub	21.74	20.77	19.25	18.57	17.67	17.92	19.97	22.10	27.61	36.80	37.49	36.98	33.70	29.55	28.01	27.23	28.24	40.68	51.90	45.35	42.25	36.98	32.06	27.63	30.02	34.81
Wisconsin PS	24.73	24.08	21.39	20.55	19.95	21.11	23.73	25.56	29.88	33.19	34.98	34.60	33.93	29.85	28.80	28.04	28.84	41.74	55.31	49.30	45.76	37.73	32.77	28.60	31.43	35.64
Cleared Load (GW)	65.3	63.3	61.7	61.3	61.3	62.7	65.6	69.8	71.3	72.9	73.5	72.8	72.1	70.7	69.6	69.0	69.6	73.4	76.0	75.3	74.7	72.7	70.1	6.7		

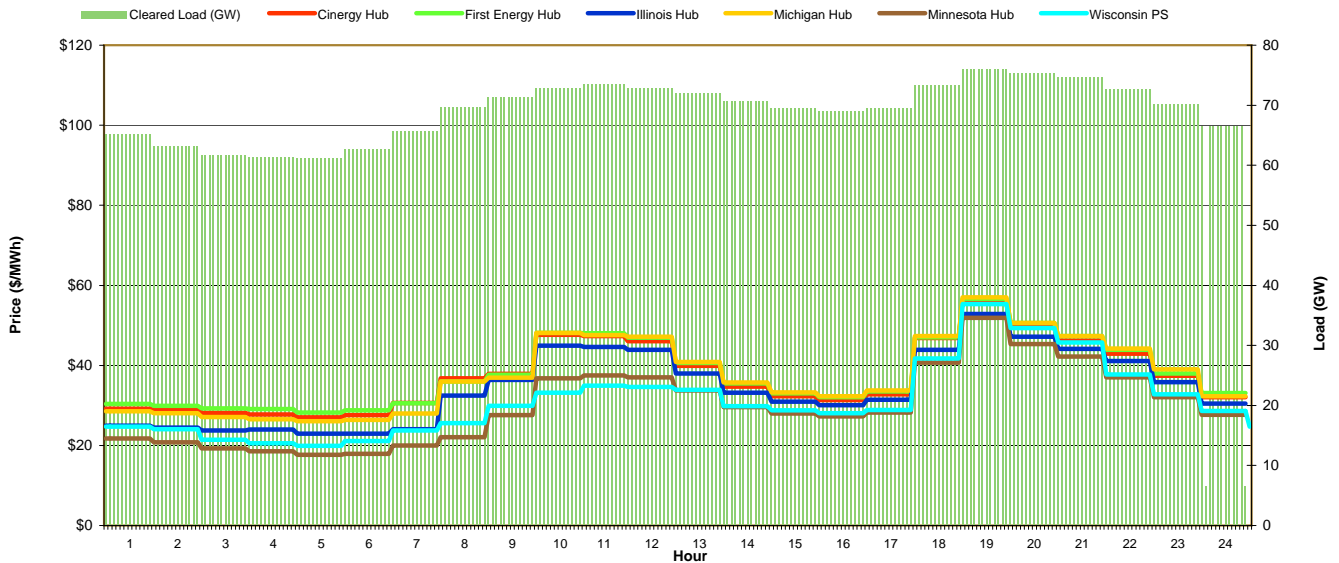

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	28.45	26.28	26.44	27.18	20.88	30.35	24.69	27.98	28.05	34.50	40.87	30.37	28.72	30.16	28.35	27.84	46.15	103.79	37.34	55.25	46.55	36.13	36.30	32.87	35.65	39.90
First Energy Hub	26.59	26.71	27.25	28.07	21.07	28.38	23.27	27.79	26.99	34.98	41.74	31.07	29.47	30.97	29.05	28.48	47.09	106.46	38.16	56.35	47.40	36.72	36.86	33.36	36.01	40.60
Illinois Hub	39.30	59.30	25.18	19.64	16.82	31.95	25.94	35.64	27.55	33.07	39.35	29.28	27.68	29.06	27.36	26.86	44.37	100.22	36.38	53.91	45.37	35.19	35.37	32.03	36.53	39.17
Michigan Hub	28.35	27.32	28.53	29.36	22.15	32.11	25.75	28.98	29.05	35.81	42.43	31.80	30.36	31.97	29.90	29.34	48.81	110.46	39.27	57.71	48.70	37.96	38.23	34.63	37.46	41.92
Minnesota Hub	7.50	8.11	7.03	11.85	15.01	15.62	19.80	19.15	25.43	31.69	38.56	28.94	27.23	28.61	26.88	25.34	35.18	99.12	37.08	56.37	47.41	36.33	35.65	32.03	29.83	37.44
Wisconsin PS	27.29	27.16	13.50	13.82	15.92	22.45	23.62	28.14	27.98	34.01	40.34	30.10	28.59	29.94	28.25	26.38	29.33	103.51	38.00	56.16	46.93	36.01	36.13	32.78	33.18	38.74
Forecasted Load (GW)	66.0	65.3	63.1	62.4	62.4	64.1	66.0	68.2	70.2	71.0	72.0	71.9	71.2	70.3	69.7	69.2	69.7	72.3	75.8	75.6	74.5	72.9	70.8	68.0		
Forecast Error %	-0.2%	-2.7%	-1.5%	-1.6%	-2.1%	-3.2%	-2.9%	-2.0%	-1.7%	-0.2%	-0.1%	0.0%	0.1%	-0.6%	-0.4%	-0.2%	-0.2%	-0.2%	0.2%	-0.2%	-0.2%	-0.1%	-0.3%	-9.4%		

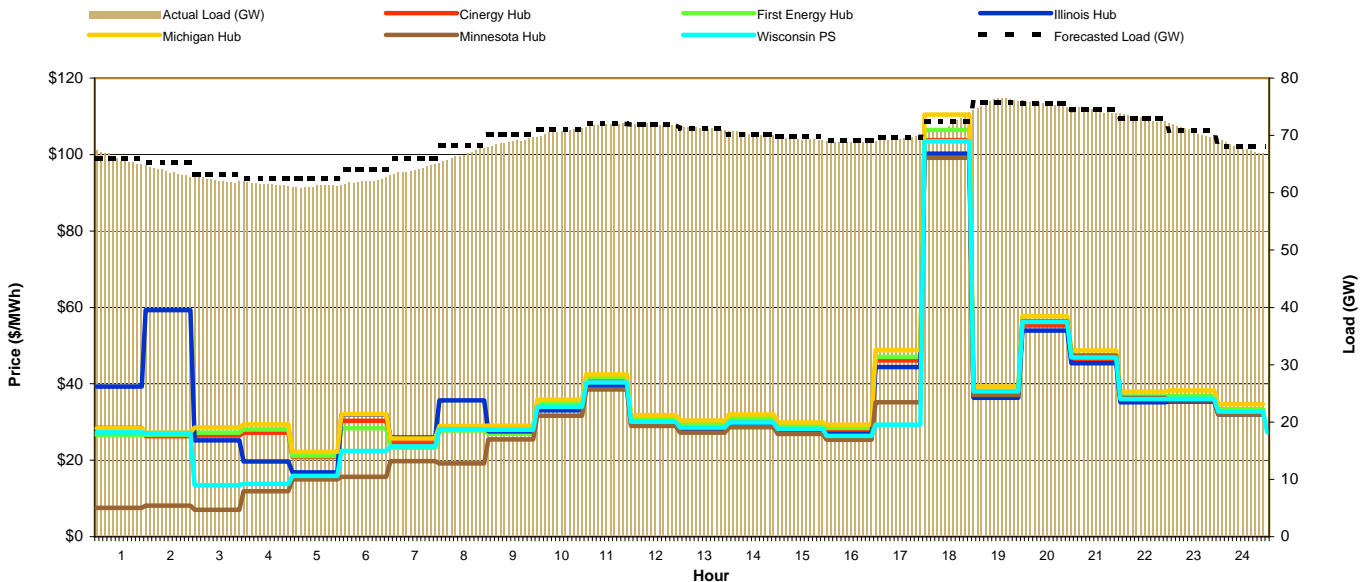




MISO Daily Report

Sunday January 16, 2011

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	31.52	31.07	29.54	28.94	28.52	28.51	31.20	37.03	36.51	42.00	41.79	41.63	37.16	35.04	32.70	30.34	34.04	45.77	69.30	49.93	46.27	41.97	36.96	34.27	37.58	41.15
First Energy Hub	32.15	31.75	30.30	29.77	29.31	29.30	31.90	37.18	37.49	42.81	42.74	42.58	38.01	35.85	32.99	30.64	33.97	45.91	70.85	50.95	46.99	42.17	36.47	33.74	38.16	41.73
Illinois Hub	27.34	26.63	25.83	25.47	24.87	24.81	26.53	31.16	34.93	40.00	40.02	39.87	35.59	33.56	29.11	27.11	28.48	43.01	66.38	47.68	48.70	45.56	37.95	34.52	35.21	39.32
Michigan Hub	30.54	30.15	28.66	28.12	27.65	27.61	30.18	36.85	37.23	42.89	43.04	42.88	38.28	36.09	33.22	30.84	34.20	46.25	71.51	51.28	47.31	42.60	37.37	34.72	37.89	41.99
Minnesota Hub	24.80	24.44	23.21	22.94	22.60	23.01	25.22	28.79	30.60	34.92	35.43	35.25	31.93	30.29	27.23	25.90	27.54	36.40	59.66	44.52	36.28	28.00	22.67	20.51	30.09	33.46
Wisconsin PS	25.96	24.16	23.04	22.62	22.40	23.35	26.32	29.02	30.45	34.58	34.60	34.71	32.04	30.71	28.28	27.48	28.97	34.83	60.93	46.90	39.64	34.15	28.74	26.12	31.25	34.75
Cleared Load (GW)	63.7	62.1	61.2	60.9	60.6	61.5	63.9	67.5	68.7	70.6	70.8	70.4	70.3	69.6	68.7	68.5	69.4	74.1	77.2	77.3	76.8	74.3	71.9	6.8		

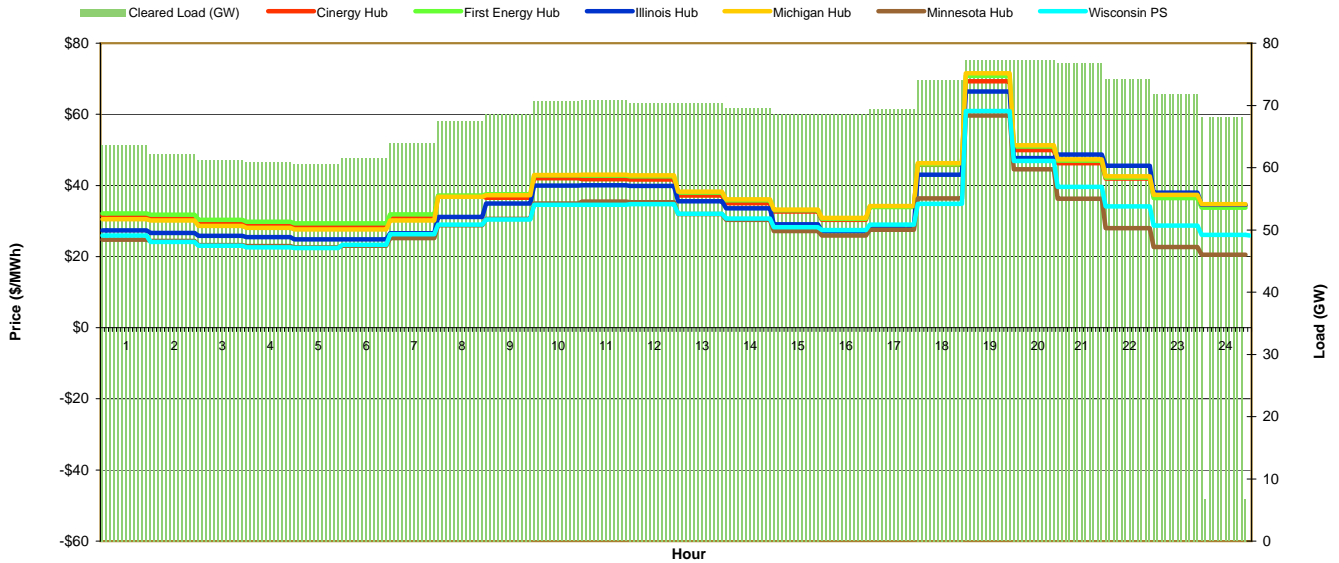

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	34.45	28.78	43.19	29.65	28.95	27.58	28.98	41.93	28.28	26.45	27.53	31.66	26.12	24.37	23.79	25.78	25.57	26.10	28.03	24.86	26.17	26.53	24.43	23.48	28.44	27.35
First Energy Hub	34.90	29.17	43.71	30.02	29.40	28.04	29.42	42.42	28.61	26.85	27.96	32.15	26.53	24.76	24.15	25.83	25.94	26.63	28.61	25.32	26.60	26.98	24.87	23.71	28.86	27.76
Illinois Hub	33.50	27.88	41.82	28.78	28.09	26.74	28.07	40.51	27.41	25.71	26.89	30.97	25.55	23.85	23.25	24.79	24.83	25.46	27.46	24.42	25.59	37.76	33.19	27.58	28.75	27.98
Michigan Hub	36.33	30.30	45.45	31.03	30.26	28.83	30.36	44.03	29.67	27.85	28.98	33.43	27.71	25.91	25.24	26.74	26.88	27.44	29.21	25.73	27.10	27.55	25.56	25.37	29.87	28.69
Minnesota Hub	32.95	27.27	40.30	27.84	27.15	25.68	26.85	34.15	26.63	25.36	26.73	30.93	25.38	23.33	22.05	-13.17	17.88	25.40	27.67	24.11	24.58	15.35	14.87	16.92	24.01	21.95
Wisconsin PS	34.49	28.56	42.55	29.23	28.64	27.33	28.71	31.83	28.16	26.55	27.92	32.16	26.58	24.77	23.58	-49.04	12.50	26.94	29.20	25.82	26.86	26.84	24.49	23.26	24.49	21.57
Forecasted Load (GW)	66.6	63.9	62.9	63.5	63.6	64.2	65.5	66.9	67.6	69.0	69.6	69.6	69.4	68.9	68.1	67.8	68.6	72.2	76.5	76.7	75.9	74.3	71.8	69.3		
Forecast Error %	-2.4%	-1.3%	-1.2%	-2.9%	-2.7%	-2.6%	-2.4%	-0.6%	0.7%	0.8%	0.9%	0.8%	0.4%	0.2%	0.4%	0.1%	0.5%	0.1%	0.3%	0.0%	0.0%	-0.3%	-0.5%	-10.3%		

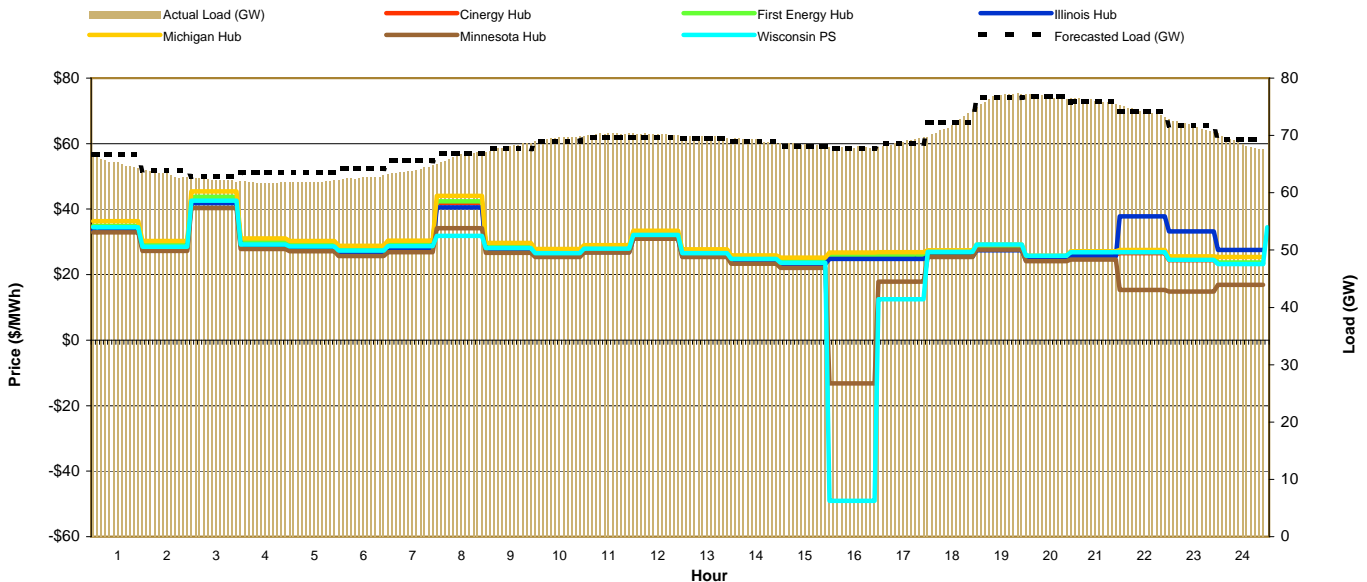




MISO Daily Report

Monday January 17, 2011

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	29.73	30.51	29.60	29.22	29.76	31.52	39.40	47.56	49.07	48.63	48.00	46.83	42.20	40.00	35.22	33.33	33.59	44.67	53.35	42.79	40.33	34.47	28.76	25.87	38.10	41.80
First Energy Hub	29.55	30.35	29.66	29.32	29.78	31.43	37.24	45.36	46.99	46.97	46.98	46.39	41.74	39.62	35.14	33.26	33.47	43.77	54.50	43.60	41.11	35.19	29.11	26.20	37.78	41.45
Illinois Hub	23.54	23.53	23.30	23.18	23.27	24.06	28.51	43.28	40.40	41.17	40.82	40.40	36.44	34.23	30.56	29.30	29.46	39.22	49.97	39.10	37.26	32.09	26.77	23.77	32.65	36.90
Michigan Hub	30.54	30.96	29.97	29.58	30.06	31.28	37.75	45.53	47.31	47.31	47.21	46.71	41.98	39.87	35.38	33.48	33.69	44.02	54.68	43.82	41.39	35.42	29.81	27.00	38.11	41.73
Minnesota Hub	19.00	17.34	15.88	15.88	15.88	16.96	20.41	28.34	37.76	38.50	39.37	38.83	34.63	32.51	29.41	28.22	28.53	37.08	51.64	42.99	36.86	33.58	24.97	22.67	29.47	35.20
Wisconsin PS	20.90	20.14	19.53	19.68	19.85	20.63	25.40	34.28	40.20	38.26	40.03	39.44	34.84	32.31	29.86	29.07	29.52	35.51	53.50	41.12	35.73	32.72	26.33	23.75	30.94	35.79
Cleared Load (GW)	66.5	64.9	64.2	64.3	65.2	67.2	73.0	78.8	80.4	80.9	80.9	79.8	79.4	78.3	76.9	76.0	76.4	80.0	82.5	81.3	79.6	76.8	73.5	6.9		

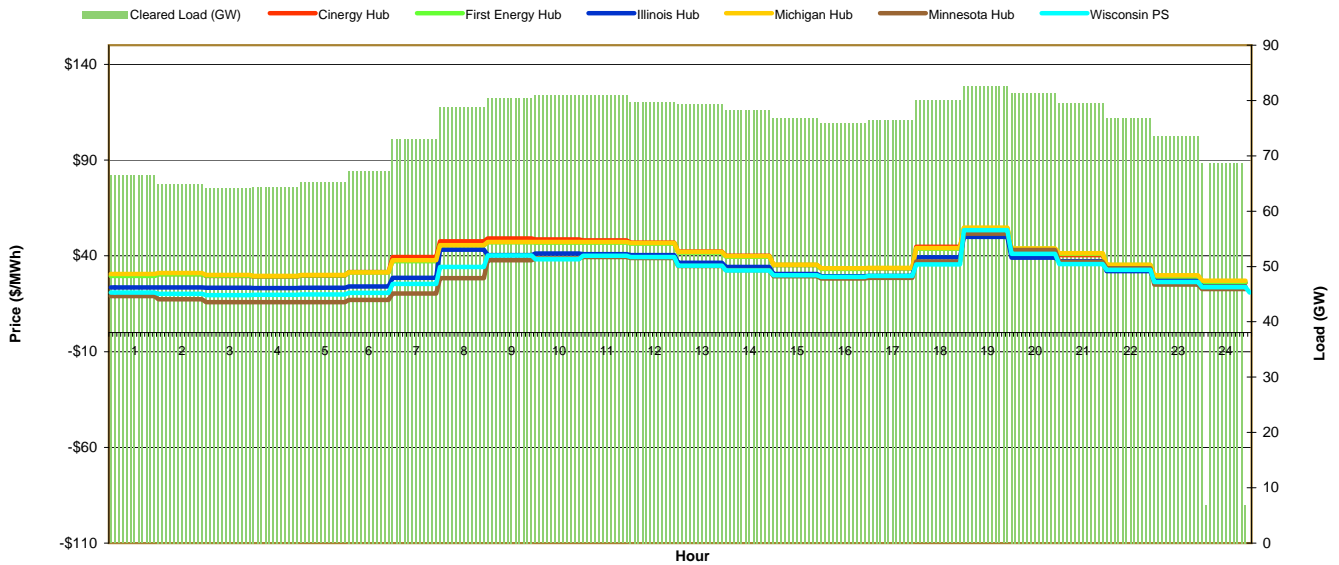

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	28.41	25.65	24.60	25.75	25.14	23.18	83.39	27.06	25.70	27.54	44.76	81.34	33.67	38.03	35.93	35.23	28.17	44.94	40.16	58.01	32.89	26.61	23.14	22.85	35.92	37.70
First Energy Hub	58.52	36.84	24.99	26.06	24.36	23.63	84.03	27.60	26.22	28.12	45.87	83.31	34.45	38.85	36.54	33.30	26.73	45.19	43.10	57.43	34.28	27.67	22.03	19.45	37.86	38.17
Illinois Hub	27.62	25.49	22.90	32.82	30.26	22.93	98.56	25.97	24.73	26.47	42.90	78.02	32.36	36.57	34.62	34.00	27.16	44.38	40.74	57.21	32.43	26.43	22.56	22.55	36.24	36.66
Michigan Hub	141.17	66.83	25.51	27.14	26.37	24.05	86.26	28.09	26.54	28.47	46.46	84.77	35.28	39.87	37.73	37.13	29.85	48.73	44.35	61.95	35.28	28.56	24.34	24.16	44.12	39.84
Minnesota Hub	4.10	15.40	9.84	14.55	16.03	17.33	-20.02	24.71	23.79	25.85	42.56	78.86	33.01	37.41	35.45	34.93	27.57	41.33	42.44	57.70	31.63	25.36	21.32	17.13	27.43	36.50
Wisconsin PS	13.42	20.50	20.38	23.94	23.37	21.56	-91.35	27.22	26.03	27.84	44.91	81.47	34.00	38.27	36.34	35.72	28.64	41.76	43.80	60.68	34.11	27.90	23.72	27.51	27.99	38.27
Forecasted Load (GW)	67.5	66.0	65.3	65.0	65.5	67.0	70.1	74.9	77.1	78.2	78.6	78.2	77.2	76.6	75.8	75.1	75.5	78.3	81.4	81.0	79.3	76.7	72.7	67.8		
Forecast Error %	-2.3%	-2.3%	-2.3%	-1.9%	-1.7%	-0.6%	1.2%	1.5%	1.1%	0.5%	1.3%	1.5%	1.3%	1.4%	1.7%	1.2%	0.4%	0.6%	0.7%	0.5%	0.3%	0.8%	-7.5%			

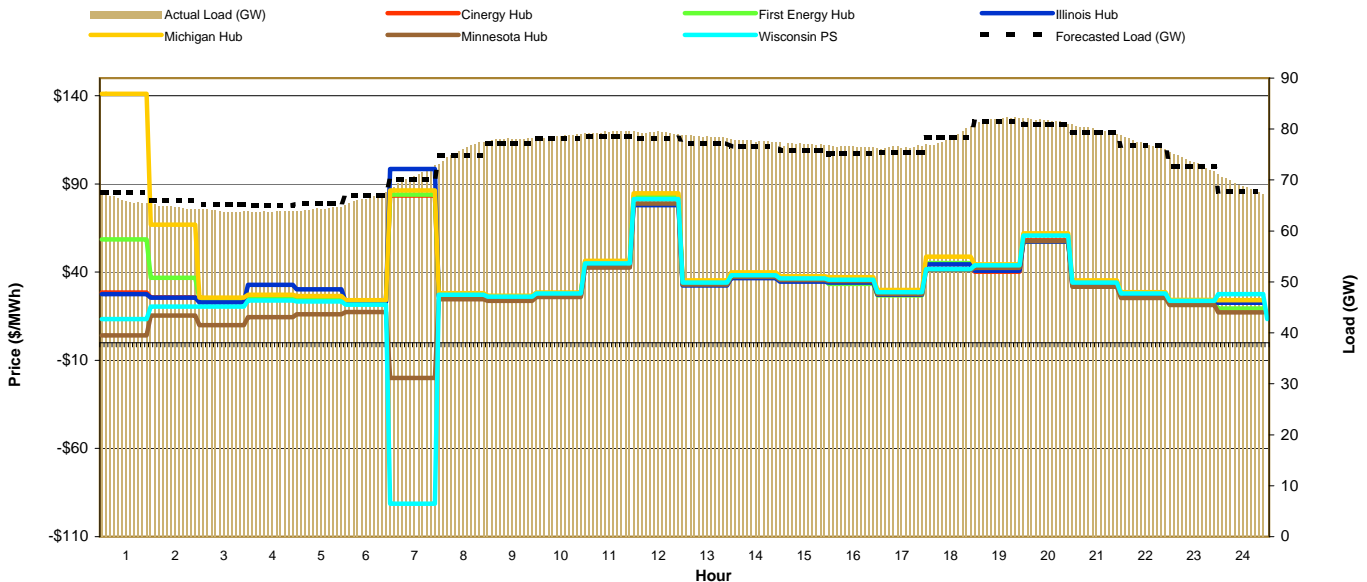




MISO Daily Report

Tuesday January 18, 2011

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	26.60	25.78	25.40	25.13	25.36	25.79	34.42	41.72	36.54	35.45	36.25	34.01	34.98	34.34	32.21	30.95	32.37	40.69	53.91	46.38	42.18	38.16	32.14	29.13	34.16	37.64
First Energy Hub	27.46	26.70	26.12	25.74	25.89	26.59	34.78	42.88	37.60	36.48	37.31	34.99	35.98	35.32	33.13	31.78	33.23	41.96	55.60	47.86	43.55	39.28	32.79	29.66	35.11	38.73
Illinois Hub	21.77	21.41	20.89	20.15	19.65	21.92	30.14	40.30	35.21	34.25	35.03	32.86	33.79	33.18	31.12	29.41	30.65	39.39	52.16	44.67	40.80	36.88	30.74	27.36	31.82	36.28
Michigan Hub	30.29	29.52	28.45	28.05	28.28	29.00	35.00	42.95	37.61	36.49	37.32	35.01	36.01	35.35	33.15	31.81	33.25	41.98	55.61	47.87	43.56	39.29	33.52	30.33	35.82	38.80
Minnesota Hub	18.93	18.29	17.25	16.64	16.88	19.06	24.08	35.88	34.68	33.65	34.31	31.78	31.85	31.01	29.29	28.33	29.33	38.21	55.22	45.25	41.57	36.08	30.11	26.78	30.19	35.41
Wisconsin PS	19.35	18.28	17.35	16.83	16.87	18.69	24.48	34.11	36.49	35.40	36.00	32.95	32.20	31.09	29.56	28.84	29.56	39.71	58.57	49.11	44.34	37.91	31.28	27.43	31.10	36.69
Cleared Load (GW)	64.1	62.7	61.4	61.3	61.9	65.1	72.1	79.0	79.4	79.2	79.4	78.8	78.6	78.0	77.0	76.3	76.7	80.4	82.3	81.0	80.1	78.1	75.2	71.1		

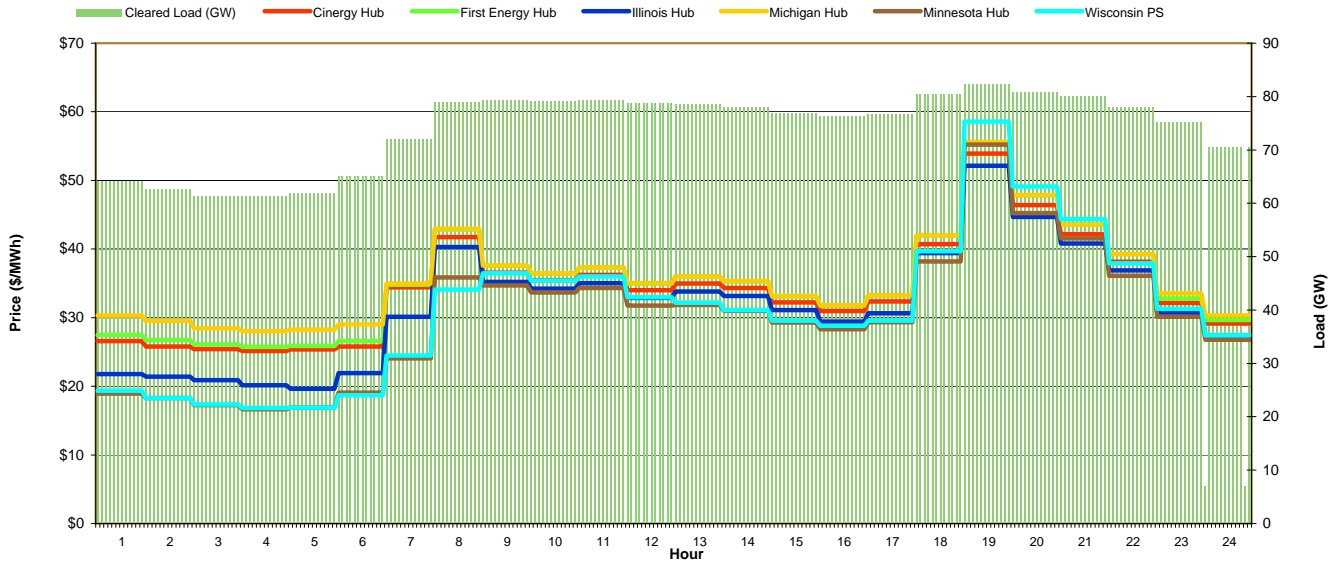

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	22.09	19.97	20.59	21.80	22.18	21.65	29.41	26.81	28.75	27.02	30.02	38.44	47.55	30.14	28.46	25.96	25.91	29.12	36.71	32.61	30.79	33.23	27.78	28.16	28.55	31.21
First Energy Hub	19.05	18.10	21.00	20.13	33.54	21.92	30.04	27.40	29.41	27.75	30.91	39.57	49.00	31.10	29.38	25.17	26.21	29.89	37.93	33.52	30.69	32.87	26.94	27.23	29.11	31.73
Illinois Hub	28.21	18.51	19.84	20.85	21.01	20.92	28.44	25.99	28.05	26.28	29.18	37.42	46.40	29.43	27.81	25.40	25.29	28.53	28.22	31.51	26.69	32.70	27.39	27.71	27.57	29.77
Michigan Hub	23.41	20.74	21.91	23.04	67.55	23.02	31.10	28.39	30.39	28.65	31.90	40.92	50.67	32.13	30.40	27.60	27.52	30.89	38.88	34.31	32.56	35.38	29.57	30.02	32.12	33.14
Minnesota Hub	15.54	19.33	18.78	17.81	12.33	19.79	23.73	25.34	28.37	26.48	29.67	39.03	46.60	30.93	29.14	26.36	26.30	29.91	64.06	37.27	44.18	35.91	29.74	29.68	29.43	34.33
Wisconsin PS	22.72	16.64	20.54	20.74	16.65	21.91	33.38	27.58	29.95	27.97	31.08	39.89	49.42	31.36	29.89	27.31	27.22	30.88	43.38	35.32	34.57	35.32	29.63	29.70	29.71	33.17
Forecasted Load (GW)	66.2	65.3	64.3	63.8	64.4	66.7	70.8	76.4	78.3	79.0	78.8	78.1	77.7	77.4	76.9	76.4	76.7	79.2	82.6	82.4	81.2	79.0	75.7	72.0		
Forecast Error %	-1.4%	-3.3%	-3.8%	-3.8%	-3.8%	-3.5%	-1.2%	-1.1%	-0.8%	-1.9%	-1.3%	-0.6%	-0.4%	-0.3%	-0.3%	-0.2%	-0.3%	-0.6%	-1.4%	-1.4%	-1.4%	-1.4%	-1.7%	-1.7%		

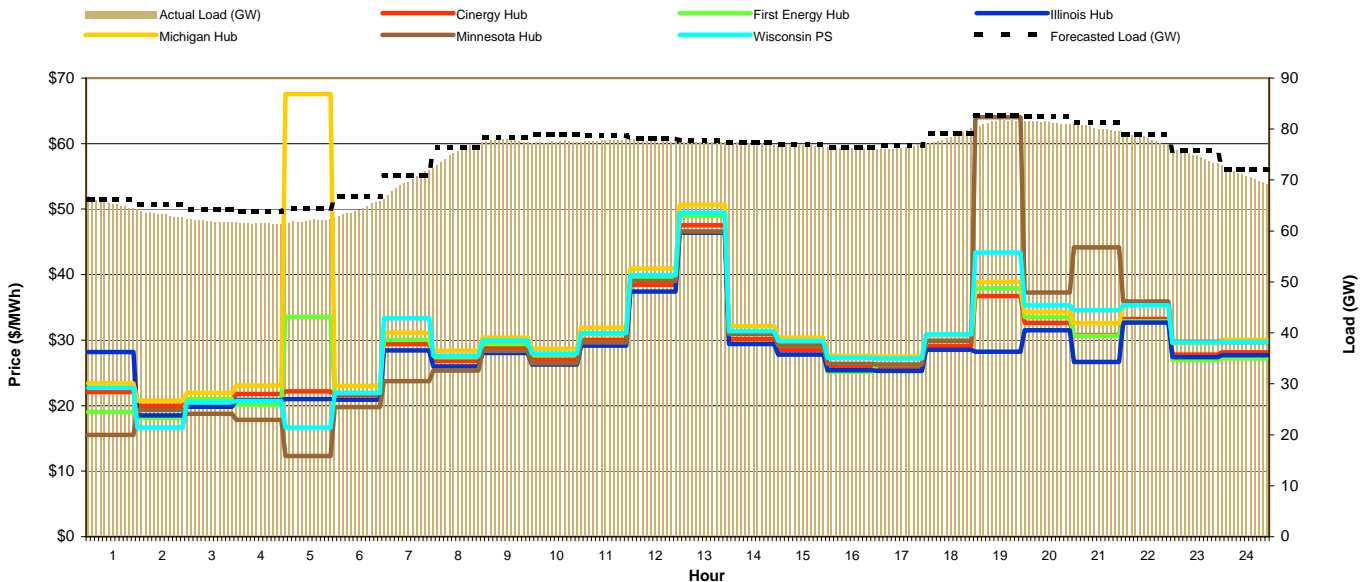




MISO Daily Report

Wednesday January 19, 2011

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	28.83	28.59	26.85	26.72	27.18	30.09	38.64	56.63	52.29	49.12	51.65	49.68	38.98	37.91	36.30	34.11	34.58	47.07	58.39	50.44	47.38	39.66	34.55	30.39	39.83	44.92
First Energy Hub	29.61	27.75	27.94	27.82	27.73	30.68	39.70	58.16	53.73	50.50	53.07	51.08	39.87	38.79	37.18	35.03	35.56	48.41	60.20	51.92	48.75	40.80	35.24	31.00	40.86	46.14
Illinois Hub	26.15	25.96	25.40	25.27	25.54	28.80	37.35	54.75	50.48	47.44	49.87	47.99	37.56	36.54	35.01	32.95	33.41	45.46	56.51	48.73	45.79	38.31	33.04	29.07	38.22	43.37
Michigan Hub	31.90	31.02	30.09	29.98	28.62	31.37	39.77	58.28	53.80	50.56	53.15	51.15	40.03	38.93	37.30	35.11	35.59	48.46	60.23	51.93	48.79	40.82	36.03	31.70	41.44	46.26
Minnesota Hub	25.71	24.86	24.18	24.00	24.12	26.43	32.51	45.90	46.25	43.25	45.25	43.42	35.06	33.90	32.47	30.75	30.77	42.02	55.25	47.68	43.21	36.51	31.50	27.71	35.53	40.20
Wisconsin PS	26.28	24.66	24.18	23.95	23.90	25.52	29.68	39.75	44.81	42.20	42.96	41.49	35.09	33.69	32.27	30.76	30.26	41.32	56.81	50.00	43.72	37.28	31.86	28.02	35.02	39.64
Cleared Load (GW)	68.0	66.2	65.4	65.2	65.8	68.5	75.0	81.2	81.5	81.9	81.2	81.1	80.6	80.1	79.0	78.4	78.6	81.6	85.4	84.2	83.2	81.3	77.2	7.3		

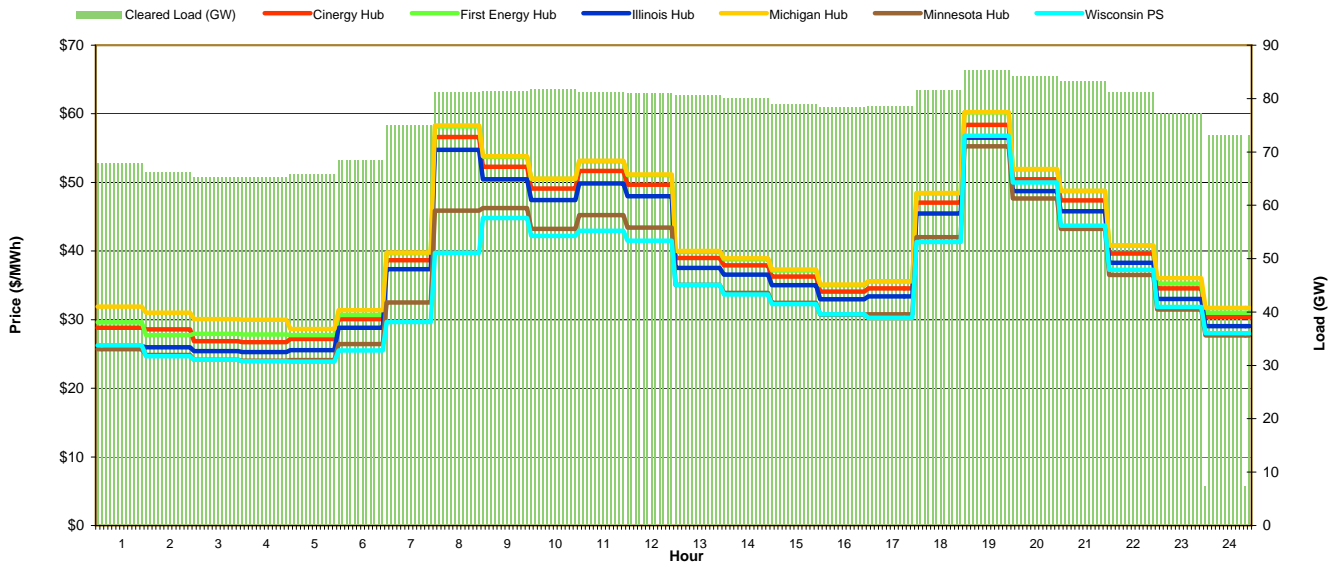

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	25.69	24.42	23.66	22.72	19.28	21.94	27.36	26.77	28.85	25.57	26.21	26.03	26.28	26.30	27.54	26.07	26.85	28.14	31.26	27.89	26.16	25.65	25.34	23.04	25.79	26.93
First Energy Hub	25.91	22.78	22.77	22.15	17.10	19.87	24.71	24.02	29.65	26.32	27.00	26.80	27.04	27.10	28.36	26.77	27.55	28.97	32.26	28.73	26.89	26.28	25.96	23.56	25.77	27.48
Illinois Hub	25.16	23.86	23.12	22.17	18.84	21.54	26.83	26.37	28.60	25.36	25.92	25.72	25.96	25.90	27.16	25.83	26.55	27.93	31.08	27.73	25.98	25.43	25.08	22.80	25.46	26.66
Michigan Hub	27.24	25.86	24.98	23.99	20.36	23.07	28.73	28.14	30.36	26.93	27.73	27.58	27.86	27.96	29.33	27.79	28.55	29.90	33.27	29.58	27.67	27.23	26.66	24.47	27.31	28.55
Minnesota Hub	25.29	23.82	22.65	21.48	18.35	20.76	25.22	26.02	30.46	25.13	25.37	25.16	25.16	20.45	20.50	20.77	21.72	22.22	33.90	28.36	26.14	24.92	24.13	21.75	24.16	25.03
Wisconsin PS	26.52	25.04	24.09	23.03	19.50	22.24	27.69	27.48	24.95	26.80	27.29	27.14	27.39	27.06	28.29	26.95	27.67	29.08	24.62	29.12	27.65	26.80	26.49	24.09	26.12	27.17
Forecasted Load (GW)	69.2	67.3	66.2	65.9	66.6	69.0	73.3	79.1	81.2	80.8	80.5	79.9	79.2	78.5	77.8	77.1	77.3	79.9	83.6	83.6	82.5	80.3	76.9	73.4		
Forecast Error %	-3.0%	-3.2%	-3.2%	-3.2%	-3.5%	-3.4%	-1.3%	-0.9%	-1.0%	-0.8%	-0.3%	-0.1%	-0.1%	-0.2%	0.0%	0.3%	0.4%	0.3%	-0.2%	-0.4%	-0.6%	-0.6%	-0.6%	-0.6%		

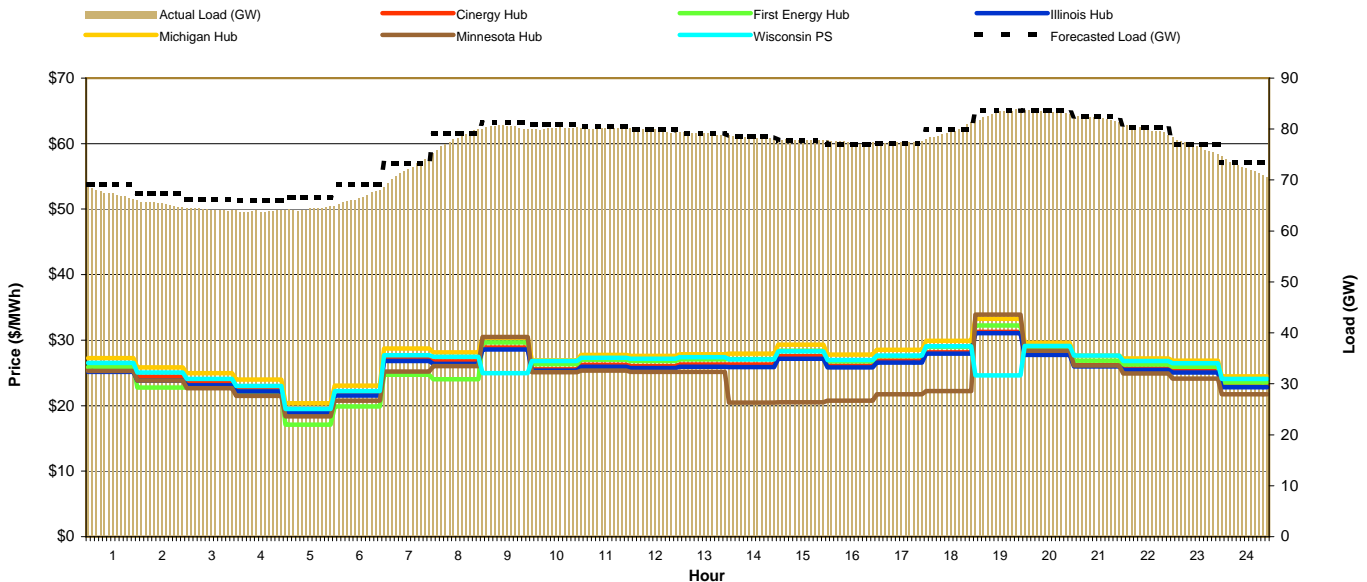




MISO Daily Report

Thursday January 20, 2011

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$			
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk		
Cinergy Hub	28.45	27.47	26.89	26.64	26.62	28.95	35.22	45.79	40.81	41.85	43.29	39.12	36.88	35.21	32.80	31.41	31.68	40.20	51.32	47.14	45.06	39.06	33.43	30.88	36.09	39.69		
First Energy Hub	29.46	27.36	27.01	26.87	27.23	29.51	36.19	47.09	42.01	43.05	44.53	40.24	37.94	36.22	33.74	32.30	32.58	41.36	52.91	48.68	46.52	40.21	34.12	31.50	37.03	40.84		
Illinois Hub	26.98	26.06	25.40	25.13	25.05	26.68	34.03	44.23	39.42	40.43	41.83	37.79	35.63	34.02	31.70	30.41	31.64	38.83	49.39	45.56	43.65	37.73	31.97	29.53	34.71	38.39		
Michigan Hub	29.58	27.60	26.92	26.61	26.92	30.16	36.24	47.14	42.02	43.08	44.56	40.27	37.96	36.25	33.77	32.33	32.63	41.39	52.91	48.69	46.53	40.22	34.88	32.21	37.12	40.91		
Minnesota Hub	25.22	22.60	20.91	20.83	20.85	21.12	29.80	40.72	39.20	38.54	39.30	36.36	34.45	32.56	30.30	28.80	28.08	37.45	51.79	46.55	43.40	37.67	31.29	28.25	32.75	37.28		
Wisconsin PS	24.92	22.96	22.15	21.79	21.85	22.94	27.67	39.40	41.12	38.71	39.28	36.60	34.42	32.25	30.04	28.57	28.17	37.03	49.68	45.71	45.23	39.13	30.93	27.95	32.85	37.26		
Cleared Load (GW)	69.7	67.8	66.9	66.9	67.5	70.0	76.2	82.1	83.2	83.1	83.0	82.8	81.7	81.3	80.3	79.5	79.4	83.3	86.0	85.3	83.9	81.4	77.9	7.4				

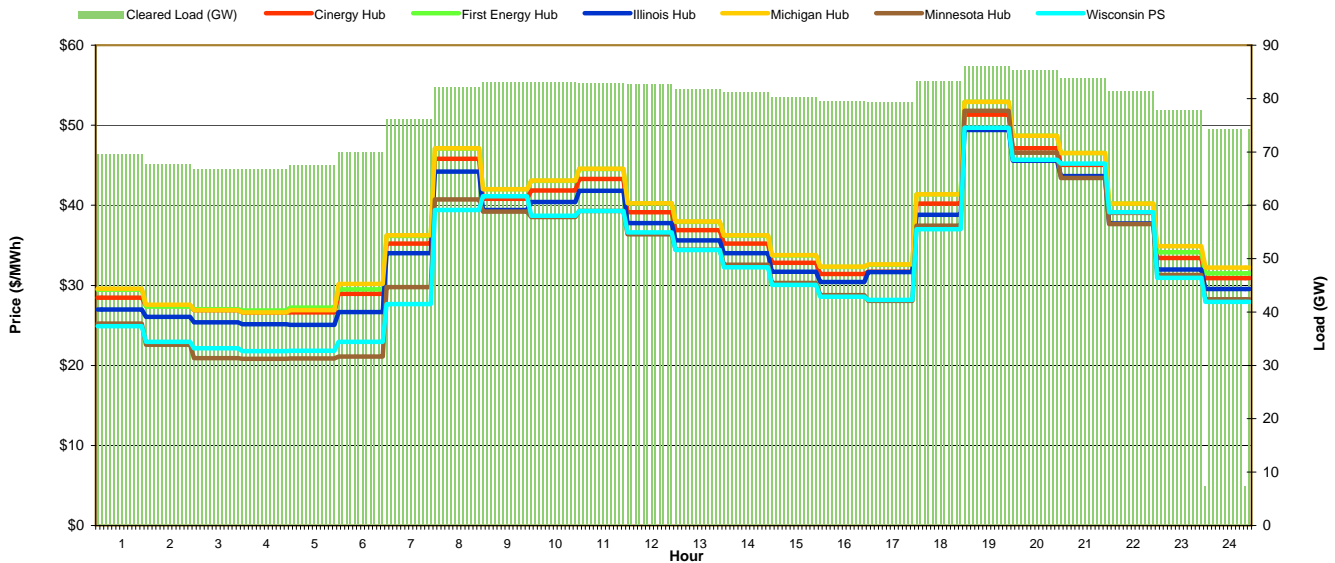

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$			
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk		
Cinergy Hub	23.46	23.84	23.66	23.77	25.81	26.13	26.11	26.01	25.04	26.54	29.90	28.26	26.42	31.19	27.89	26.11	28.62	28.66	45.85	31.50	36.53	49.58	26.95	27.69	28.98	30.94		
First Energy Hub	23.98	24.46	24.26	24.41	26.42	26.77	24.55	25.86	25.77	27.30	30.76	29.07	27.21	32.18	28.78	26.95	29.45	28.86	47.39	32.52	37.67	50.02	27.68	28.36	29.61	31.72		
Illinois Hub	23.04	23.37	23.15	23.07	24.49	24.94	25.46	25.46	24.61	26.06	29.35	27.73	25.90	30.47	27.18	25.33	27.62	27.68	44.60	30.76	35.64	48.35	26.28	26.88	28.23	30.19		
Michigan Hub	24.96	25.38	25.04	25.16	27.03	27.50	27.47	27.39	26.41	28.03	31.63	29.82	27.93	32.86	29.30	27.46	30.22	30.21	47.96	32.98	38.28	52.24	28.43	29.24	30.54	32.57		
Minnesota Hub	21.76	21.90	21.36	20.18	17.32	19.27	23.58	19.31	23.78	24.85	27.41	25.73	23.57	26.04	24.91	23.46	29.79	26.84	45.25	31.84	36.99	50.27	27.09	27.73	26.68	29.20		
Wisconsin PS	24.15	24.42	23.98	23.37	22.80	24.18	27.49	33.65	26.48	27.96	30.86	29.09	27.80	29.60	28.15	26.54	27.77	29.34	48.35	33.25	38.43	51.85	28.06	28.69	29.84	32.32		
Forecasted Load (GW)	70.6	68.7	67.6	67.2	67.7	70.0	73.9	80.0	81.9	81.8	81.7	81.2	80.5	79.9	79.3	78.6	78.8	81.5	85.0	84.5	83.5	81.5	78.9	74.9				
Forecast Error %	-2.4%	-2.1%	-2.1%	-2.1%	-2.2%	-1.7%	0.4%	-0.4%	-0.5%	-0.4%	0.0%	0.4%	0.4%	0.4%	0.5%	0.4%	0.4%	0.4%	-0.6%	0.9%	0.5%	0.6%	0.2%	1.1%				

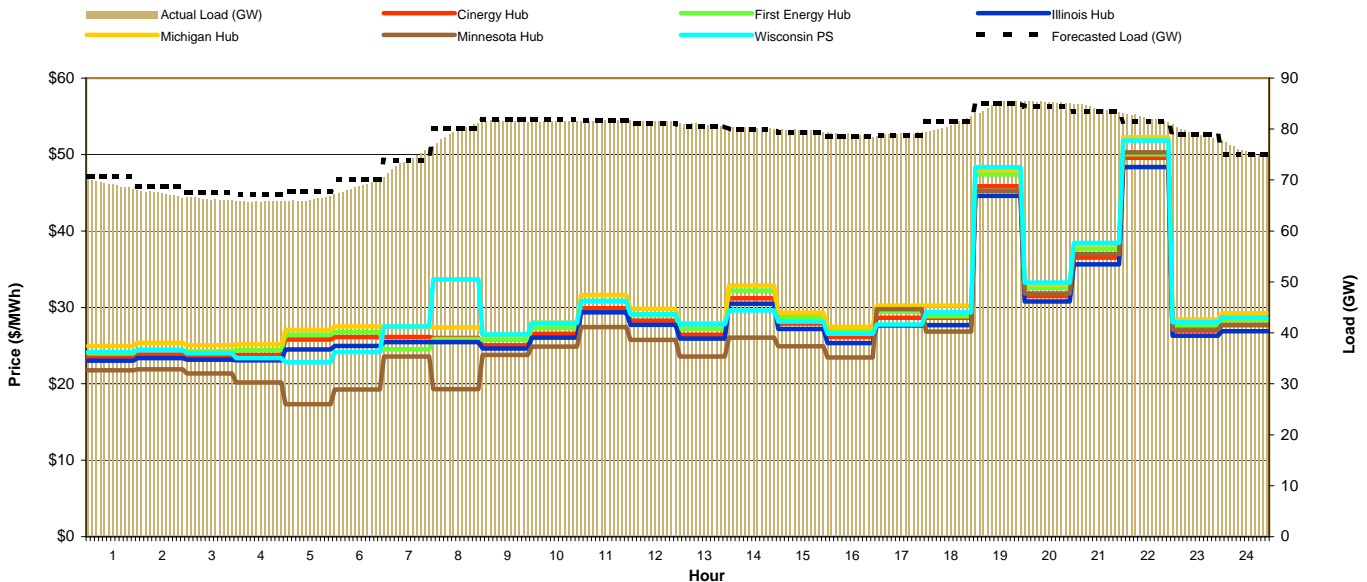




MISO Daily Report

Friday January 21, 2011

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
																									All	On Pk		
Cinergy Hub	30.00	28.66	28.00	27.57	28.01	30.11	38.96	50.99	49.16	49.64	52.88	49.13	43.42	44.02	36.59	34.74	35.02	43.09	54.26	47.92	44.75	44.02	36.00	35.66	40.11	44.73		
First Energy Hub	30.60	29.23	28.56	28.11	28.56	30.70	40.04	52.41	49.39	49.73	53.18	49.37	43.31	43.69	36.90	35.48	35.89	44.27	55.84	49.39	46.15	45.07	36.59	35.65	40.75	45.42		
Illinois Hub	28.70	27.42	26.79	26.37	26.78	28.83	37.66	49.28	46.37	46.70	49.95	46.37	40.68	41.07	34.68	33.34	32.80	40.53	51.18	45.65	42.88	40.84	33.40	30.28	37.86	42.23		
Michigan Hub	31.28	29.89	29.20	28.74	29.19	31.39	40.10	52.49	49.43	49.78	53.24	49.42	43.35	43.74	36.93	35.51	35.93	44.32	55.89	49.43	46.20	45.12	37.41	36.45	41.02	45.51		
Minnesota Hub	27.09	26.11	25.45	24.89	24.89	25.83	32.98	44.01	44.77	44.34	46.08	43.45	38.44	37.55	32.09	30.87	30.70	37.53	48.67	43.07	39.41	38.04	31.97	29.39	35.32	39.44		
Wisconsin PS	27.02	26.31	25.57	24.83	25.01	27.36	30.33	39.62	43.51	41.96	45.38	42.25	37.61	35.32	31.30	30.43	29.66	35.00	44.85	41.24	38.03	36.17	31.46	28.28	34.10	37.73		
Cleared Load (GW)	72.7	71.1	70.2	70.2	71.1	73.5	80.1	86.4	86.9	87.1	86.6	86.0	85.3	83.7	82.3	81.4	81.2	83.7	86.6	85.7	84.5	82.2	78.8	74				

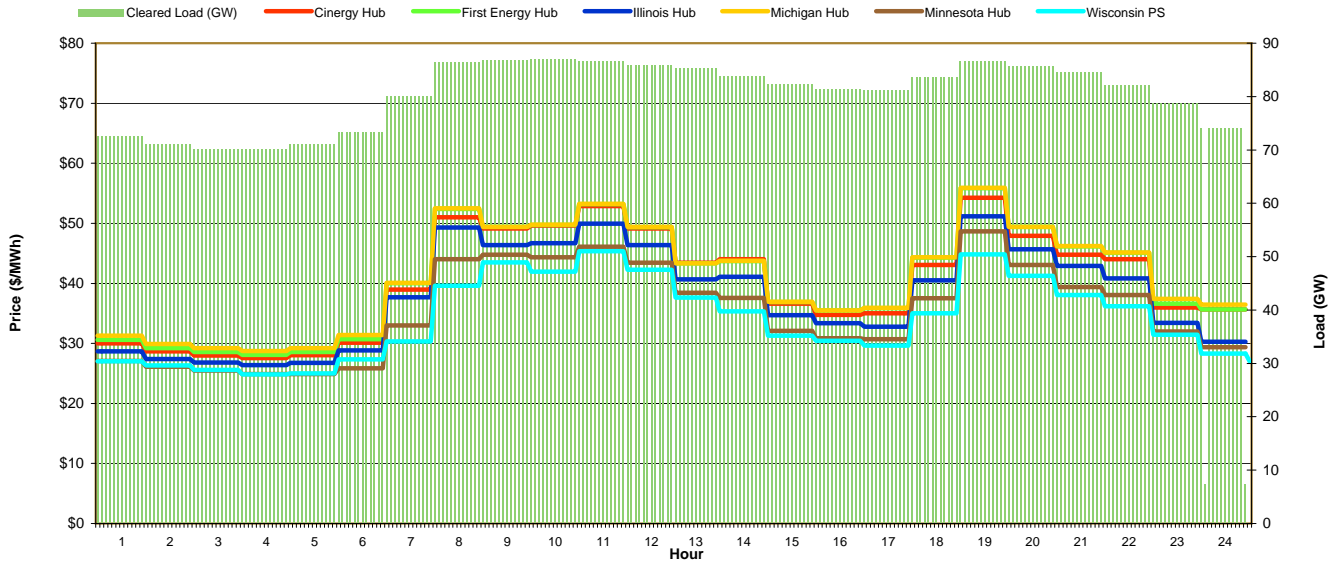

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
																									All	On Pk		
Cinergy Hub	23.33	24.94	25.17	25.36	25.84	30.15	32.35	34.64	52.41	36.84	68.98	35.42	33.65	35.29	29.99	27.33	28.25	50.32	39.34	35.05	35.08	37.59	31.92	31.21	34.60	38.26		
First Energy Hub	23.77	25.47	25.16	25.44	26.30	30.75	33.04	35.39	53.46	37.59	70.32	36.18	34.48	36.21	30.77	28.03	28.96	51.43	40.27	35.86	35.77	38.27	32.48	31.01	35.27	39.09		
Illinois Hub	22.63	24.17	24.35	24.55	24.97	29.09	31.20	33.67	51.21	36.11	67.47	34.71	32.90	34.41	29.22	26.63	27.50	48.91	38.48	34.36	34.27	36.61	31.04	30.18	33.69	37.34		
Michigan Hub	24.65	26.15	26.29	26.39	26.84	31.19	33.37	35.53	53.62	37.89	70.93	36.59	35.03	37.01	31.42	28.66	29.60	52.33	40.71	36.18	36.21	38.93	33.04	32.29	35.87	39.61		
Minnesota Hub	22.69	23.74	23.41	23.41	23.59	26.25	29.76	33.79	52.78	37.53	68.82	35.45	33.62	33.67	28.76	25.98	26.01	29.26	38.15	33.58	31.89	33.45	29.45	29.99	32.29	35.76		
Wisconsin PS	24.00	25.49	25.44	25.58	25.95	28.00	32.31	35.87	55.33	38.99	71.79	36.73	34.74	33.87	29.80	27.49	27.44	12.53	40.09	34.27	31.60	32.83	30.63	31.60	33.01	35.87		
Forecasted Load (GW)	73.4	70.9	70.0	69.9	70.7	73.1	77.9	83.5	85.1	85.1	84.7	84.0	83.1	82.3	81.4	80.6	80.6	82.7	85.8	85.2	84.0	82.1	79.0	74.8				
Forecast Error %	-1.4%	0.0%	0.1%	0.2%	0.2%	0.4%	0.8%	0.3%	0.5%	0.5%	0.6%	0.7%	0.9%	0.8%	0.8%	0.6%	0.6%	0.1%	0.2%	0.6%	0.2%	0.4%	0.4%	-7.6%				

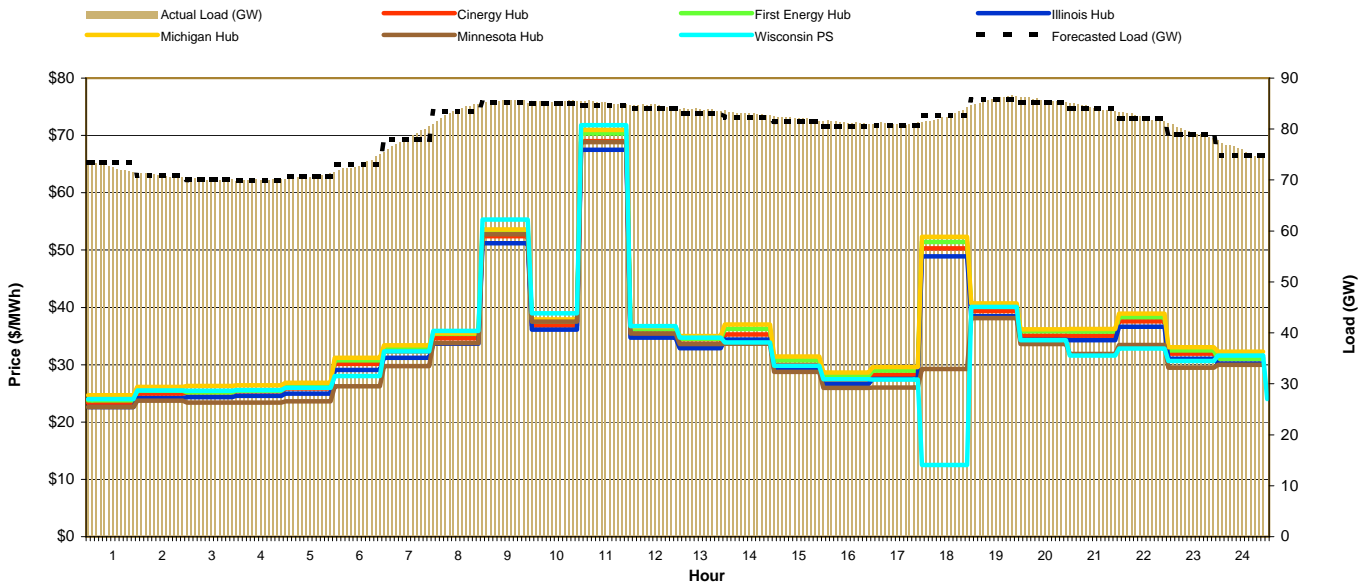




MISO Daily Report

Saturday January 22, 2011

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
																									All	On Pk		
Cinergy Hub	37.61	37.03	37.46	35.45	32.76	33.88	38.13	42.00	48.91	54.79	48.87	47.05	38.78	34.89	30.74	30.24	31.51	43.50	53.90	50.33	46.78	40.90	34.08	32.99	40.11	42.33		
First Energy Hub	37.75	37.26	37.35	35.72	33.33	34.39	38.19	42.35	49.97	56.66	50.70	48.52	39.89	35.78	31.54	30.85	31.97	44.68	55.55	52.20	48.38	42.07	35.20	34.37	41.03	43.52		
Illinois Hub	29.62	29.44	29.30	28.39	27.41	27.59	30.29	36.00	45.00	52.80	47.07	45.47	37.50	33.76	29.75	28.17	28.22	42.08	52.10	48.49	45.11	39.55	32.65	31.44	36.55	40.23		
Michigan Hub	36.91	36.34	36.79	34.82	32.32	33.09	37.06	42.09	49.83	56.08	49.80	48.34	40.10	36.33	31.98	31.11	31.99	45.70	55.52	51.33	47.98	42.31	34.98	33.39	40.67	43.47		
Minnesota Hub	28.76	28.24	27.70	27.05	26.34	26.65	30.31	35.46	40.82	48.52	47.38	45.00	36.68	32.63	29.07	28.02	28.17	39.22	51.96	48.31	44.82	39.12	30.83	28.91	35.42	39.13		
Wisconsin PS	30.45	29.50	28.37	28.09	28.04	28.26	30.35	36.04	38.37	47.61	49.46	47.04	37.68	33.19	29.87	29.06	29.26	38.87	55.07	51.35	47.52	41.37	33.72	30.76	36.63	40.34		
Cleared Load (GW)	70.7	68.8	68.0	67.5	67.7	68.9	71.4	74.7	75.7	77.2	77.4	76.2	75.4	73.8	72.5	72.1	72.6	75.9	79.0	78.8	77.5	76.0	73.1	7.0				

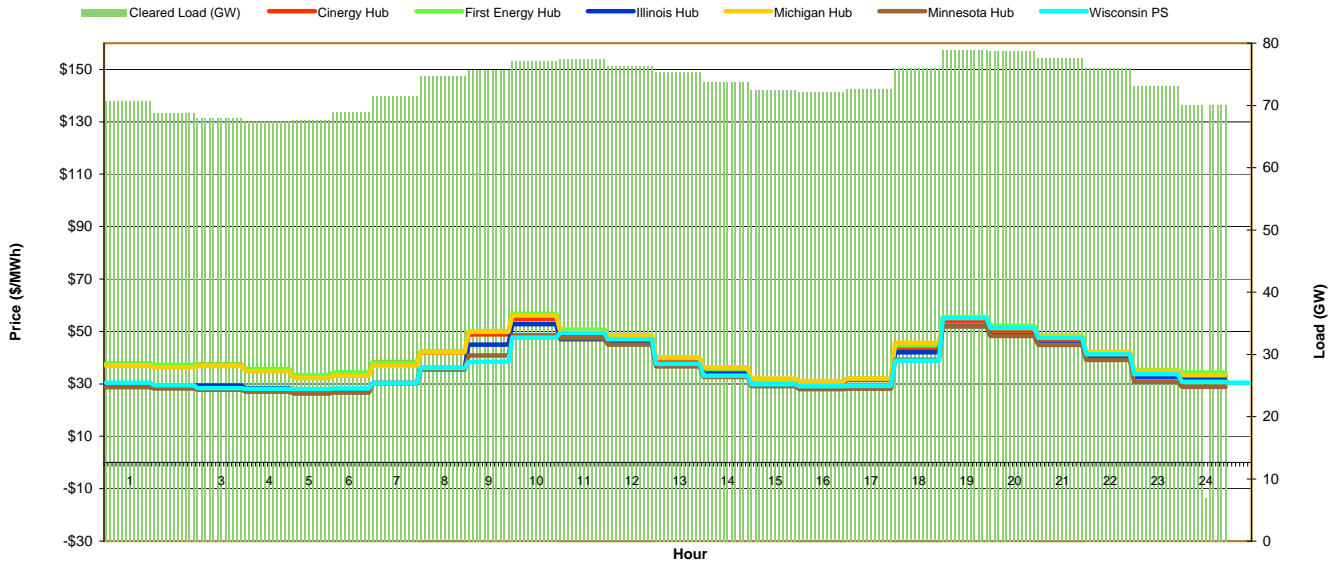

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
																									All	On Pk		
Cinergy Hub	30.46	47.00	35.77	34.83	35.18	31.99	30.84	25.64	33.83	36.67	39.19	53.40	26.02	25.49	24.95	25.16	26.79	105.32	33.36	28.59	29.55	36.07	25.96	26.99	35.38	36.00		
First Energy Hub	-18.54	28.22	20.10	15.77	4.50	-20.32	27.97	-8.26	23.05	26.29	29.90	10.25	19.13	20.09	23.77	25.26	26.63	102.02	28.68	27.92	24.92	64.39	31.11	23.61	23.19	29.70		
Illinois Hub	29.39	45.11	24.41	26.10	22.15	24.17	24.59	23.71	27.94	35.23	37.80	51.80	25.23	24.70	24.05	30.36	26.96	113.63	34.46	27.75	28.61	19.54	17.33	20.12	31.88	34.32		
Michigan Hub	31.32	48.12	37.54	36.37	37.18	33.35	32.02	26.34	35.15	37.56	40.01	54.73	26.96	26.47	25.86	25.85	27.60	108.53	34.12	29.21	30.23	159.23	89.59	75.33	46.19	48.59		
Minnesota Hub	35.16	23.88	24.13	26.38	6.99	29.72	23.88	27.42	28.79	36.70	40.18	59.36	26.88	25.87	24.11	23.77	25.25	79.85	33.47	28.41	29.46	24.72	21.93	24.81	30.46	33.51		
Wisconsin PS	30.14	0.55	21.81	24.59	-17.47	22.69	24.22	23.94	27.67	36.49	39.37	53.43	26.26	25.71	24.97	25.11	26.57	65.32	33.84	29.11	29.70	20.30	18.35	21.24	26.41	31.63		
Forecasted Load (GW)	72.0	70.6	69.9	69.4	69.4	70.0	71.1	73.3	74.2	75.9	76.6	76.0	74.8	73.7	72.9	72.2	72.6	75.0	79.0	78.9	77.7	76.1	73.6	70.4				
Forecast Error %	-40.7%	-0.3%	-1.3%	-1.3%	-1.3%	-0.7%	0.4%	1.0%	2.1%	1.9%	1.7%	1.3%	1.2%	0.8%	0.3%	0.2%	0.1%	0.4%	0.1%	0.1%	0.3%	0.1%	0.1%	-8.9%				

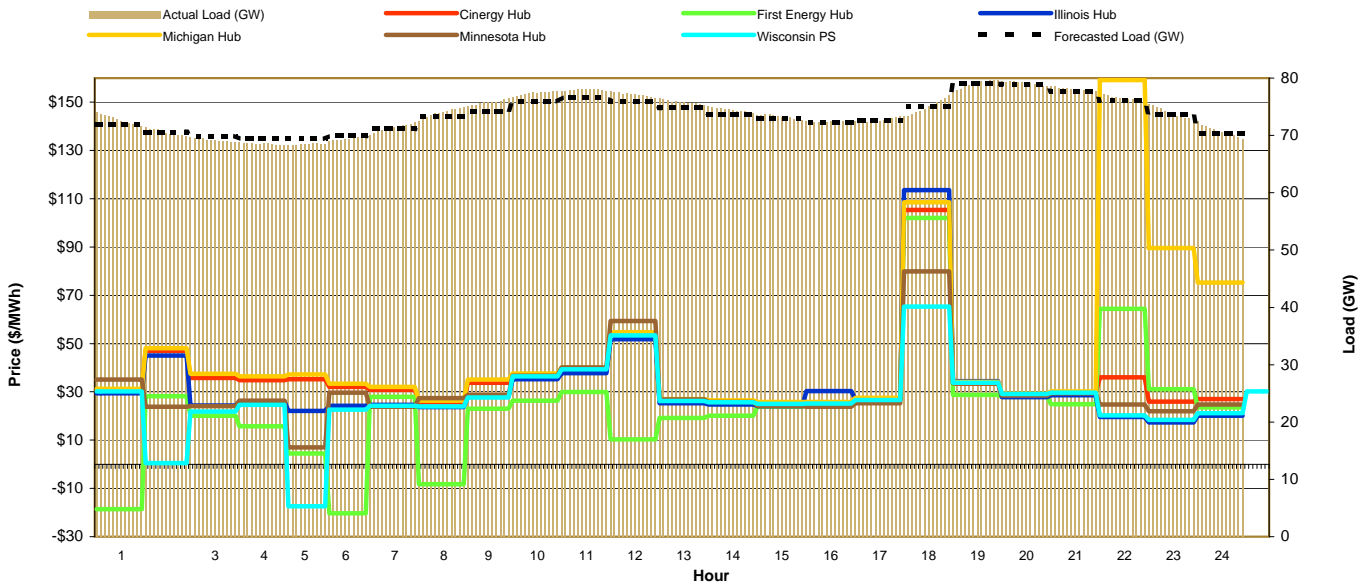




MISO Daily Report

Sunday January 23, 2011

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	33.28	35.93	33.91	32.96	31.94	32.08	34.53	38.52	40.43	46.18	43.00	38.41	36.33	32.93	32.00	30.00	33.04	41.52	58.43	49.44	46.41	45.39	38.71	37.74	38.46	40.67
First Energy Hub	27.00	27.47	26.66	26.26	25.80	25.76	29.15	31.35	33.98	38.27	37.72	34.73	32.25	30.36	29.13	28.17	29.62	37.96	56.76	46.41	42.38	39.04	31.76	29.78	33.24	36.24
Illinois Hub	29.50	28.64	27.92	27.42	26.64	26.55	27.89	30.52	34.53	44.70	41.57	37.10	35.09	31.78	27.90	27.10	27.93	40.12	56.39	47.78	44.95	43.27	28.92	26.43	34.19	37.48
Michigan Hub	32.61	33.58	32.02	30.85	30.01	30.06	32.59	37.82	40.71	47.84	44.16	39.14	37.00	33.26	31.58	29.64	32.61	42.22	59.43	50.29	47.34	46.19	38.23	37.73	38.20	41.09
Minnesota Hub	28.40	27.19	26.58	25.31	24.42	24.86	27.89	30.01	32.33	38.83	38.75	34.72	32.42	29.40	27.36	25.78	26.10	36.90	54.43	47.76	43.30	34.99	27.03	23.60	32.02	35.01
Wisconsin PS	29.63	27.94	27.29	24.82	24.10	25.27	27.86	29.29	30.64	35.20	37.83	34.62	31.84	28.96	26.94	25.45	25.85	33.39	52.94	47.39	42.17	34.39	27.63	25.44	31.53	34.03
Cleared Load (GW)	68.2	67.2	65.7	65.3	65.1	65.8	68.1	71.4	72.7	73.9	73.9	73.6	72.7	72.3	71.5	70.7	71.4	76.2	80.2	80.1	79.2	77.2	74.4	7.1		

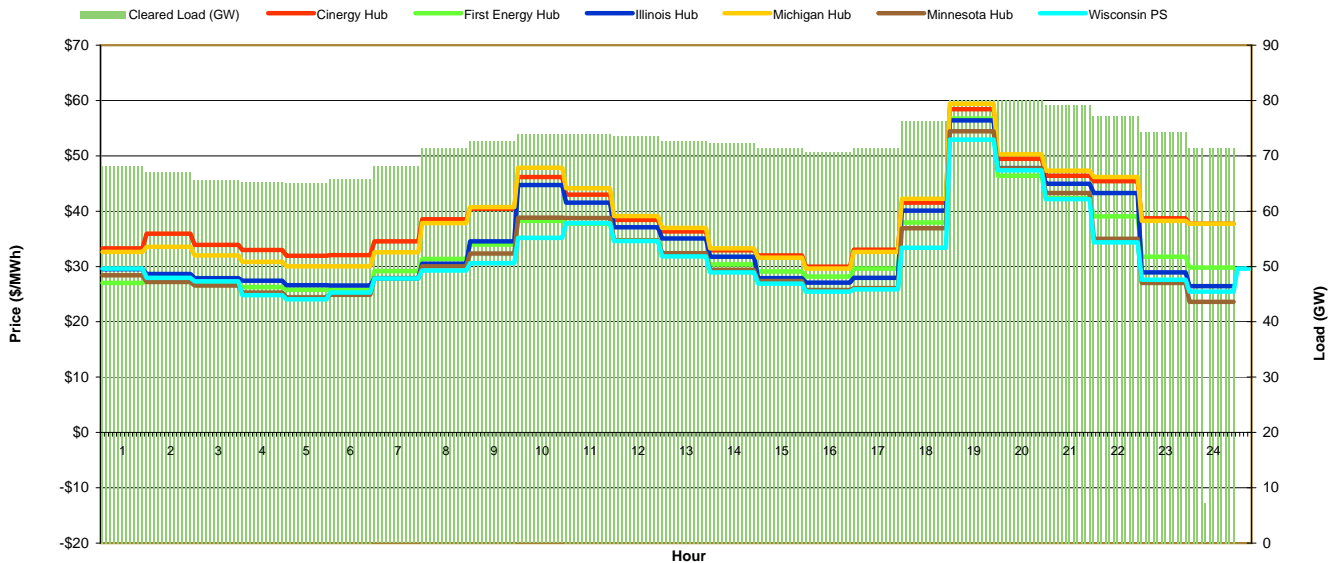

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	27.42	30.26	30.74	27.91	29.76	29.01	33.13	29.83	35.76	30.63	32.71	32.36	29.30	27.99	27.95	43.67	32.31	28.91	44.29	31.45	39.24	64.34	28.37	24.60	33.00	34.94
First Energy Hub	13.51	28.19	31.27	26.73	25.89	28.32	28.32	26.90	30.27	26.19	32.63	28.49	28.99	25.26	27.25	44.70	27.92	20.93	39.71	25.46	30.17	51.91	18.97	24.05	28.83	30.36
Illinois Hub	26.51	29.01	29.56	26.85	28.64	27.90	33.75	28.63	33.84	29.34	31.47	31.22	28.37	27.19	27.17	42.36	31.26	28.04	42.96	30.46	37.85	52.42	13.96	36.37	31.46	32.28
Michigan Hub	27.86	30.82	31.26	28.39	30.26	29.60	33.92	30.60	36.72	31.55	33.82	33.50	30.44	29.10	29.04	45.43	33.59	30.15	46.08	32.55	40.71	67.81	30.82	25.56	34.15	36.37
Minnesota Hub	28.56	27.39	27.61	25.84	27.85	26.48	27.06	26.70	29.51	28.94	30.89	28.48	26.63	26.71	26.26	35.09	25.76	26.59	40.73	30.58	33.80	21.06	13.01	11.49	27.21	28.17
Wisconsin PS	27.86	27.78	29.75	27.42	29.13	27.98	23.99	26.22	26.03	29.50	32.33	26.88	27.69	28.27	28.36	31.93	21.21	25.50	39.57	30.03	30.07	-13.89	9.30	21.14	25.58	24.94
Forecasted Load (GW)	68.1	66.8	66.8	66.4	66.4	67.0	68.5	70.8	70.7	71.7	72.1	72.0	71.7	71.2	70.5	70.3	71.1	74.7	79.6	80.0	79.2	77.3	74.3	71.1		
Forecast Error %	-27.7%	-0.8%	-2.3%	-2.5%	-2.3%	-1.8%	-1.9%	-2.0%	0.5%	1.1%	1.2%	1.3%	1.1%	1.2%	1.2%	0.8%	0.2%	-1.1%	-0.7%	0.1%	0.1%	-0.1%	0.1%	-9.2%		

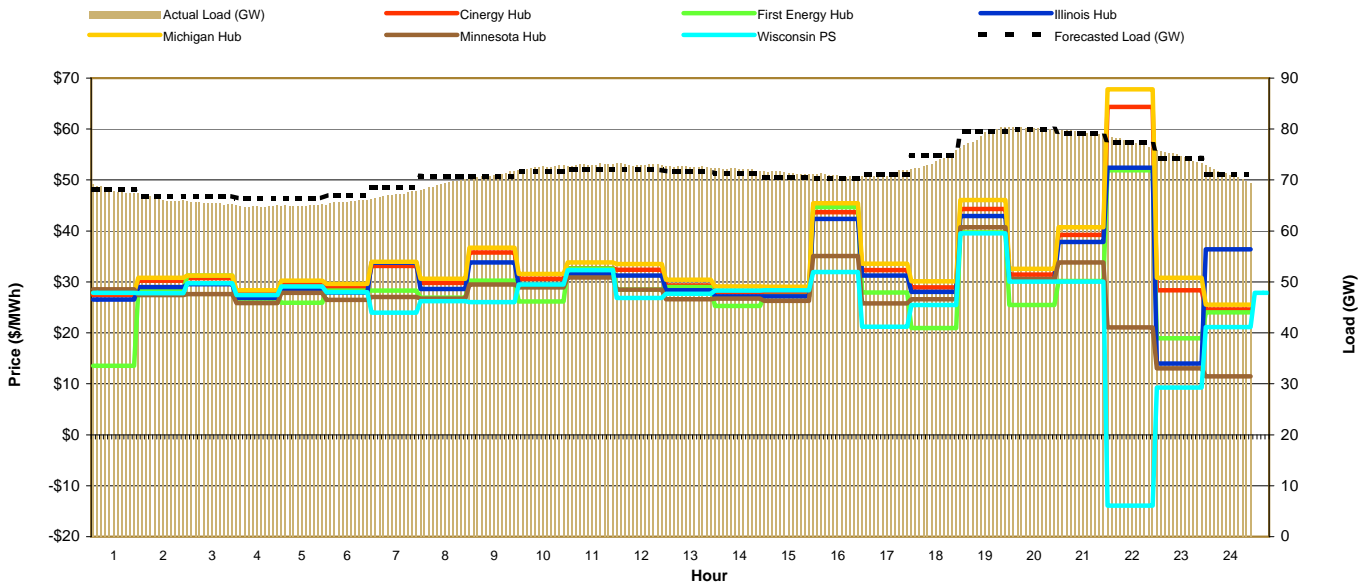




MISO Daily Report

Monday January 24, 2011

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	30.59	30.21	30.22	29.88	29.91	36.57	48.99	60.37	60.00	59.60	58.18	49.85	45.32	48.75	39.18	37.89	38.54	48.29	57.71	50.06	45.21	43.21	35.40	29.82	43.49	48.60
First Energy Hub	32.66	32.35	30.67	32.01	30.78	34.74	48.99	59.21	58.92	58.80	57.48	49.83	45.43	48.16	38.56	37.37	38.00	48.18	59.26	51.27	46.28	44.12	34.48	30.58	43.67	48.46
Illinois Hub	25.57	25.35	25.43	25.04	25.29	25.98	35.43	47.62	50.92	51.99	51.07	45.85	43.01	43.87	32.41	32.47	33.72	40.48	56.05	48.63	43.92	41.88	34.07	26.35	38.02	43.62
Michigan Hub	36.59	36.38	37.12	36.14	35.22	41.10	49.81	60.70	60.36	60.24	58.86	50.96	46.49	49.86	40.18	38.99	39.59	49.48	60.87	53.04	47.59	45.38	37.60	32.90	46.06	50.01
Minnesota Hub	19.47	19.08	18.84	17.86	17.58	19.25	24.29	36.94	40.75	40.91	40.79	37.40	34.01	32.72	28.61	27.05	27.59	36.89	51.43	45.00	39.69	37.69	29.74	24.81	31.18	36.70
Wisconsin PS	22.16	19.95	19.52	19.45	19.21	21.80	25.45	35.51	38.82	38.65	39.44	36.40	33.76	33.10	29.14	29.38	29.00	32.99	48.99	43.40	36.93	34.83	29.13	25.94	30.95	35.59
Cleared Load (GW)	68.9	67.7	66.7	66.7	67.4	70.1	76.0	82.5	83.1	83.4	83.1	82.8	81.9	80.7	79.6	78.7	78.9	81.7	84.4	83.6	82.5	80.0	75.8	7.1		

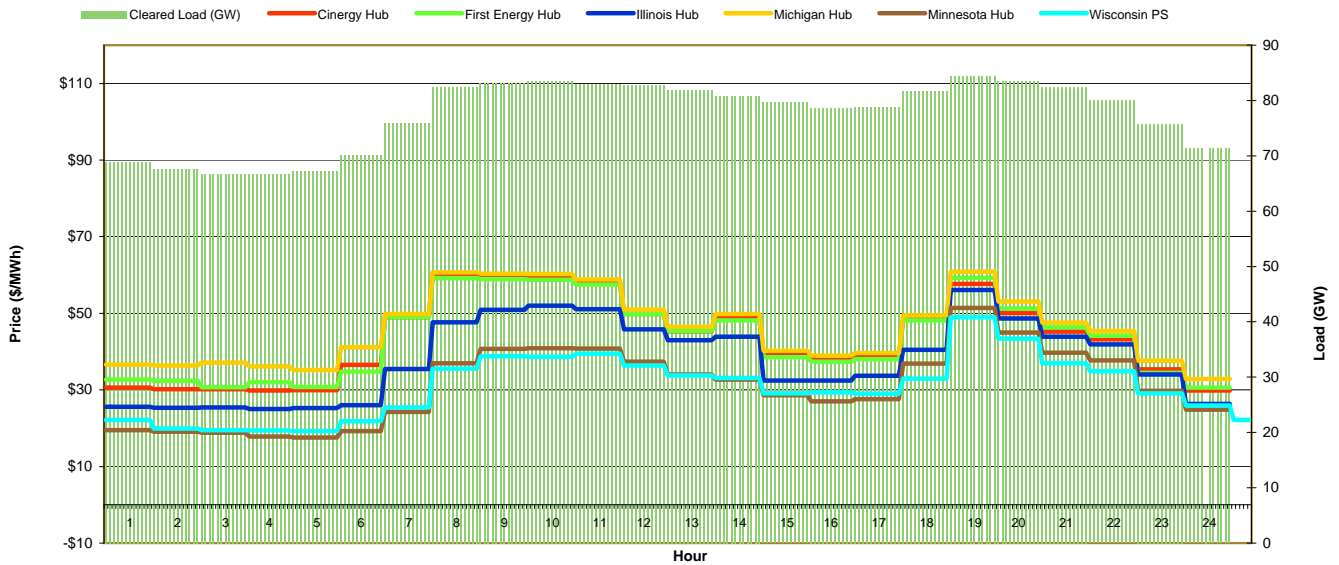

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	21.89	29.42	26.83	27.24	26.09	41.42	77.98	117.78	87.79	36.51	50.74	34.41	49.05	95.04	36.15	29.30	30.70	34.19	42.79	46.98	35.03	36.33	27.28	25.67	44.44	49.38
First Energy Hub	14.22	-4.27	-4.94	21.58	25.02	16.47	54.45	75.07	105.30	39.36	46.77	35.94	51.26	83.73	37.60	30.46	31.87	34.50	44.63	48.82	36.33	37.15	23.62	21.83	37.78	47.65
Illinois Hub	24.47	39.34	37.80	13.95	34.56	25.24	26.45	46.86	97.91	36.56	40.63	33.32	47.31	75.09	34.89	28.21	29.57	32.00	41.77	45.96	34.23	35.42	26.64	25.08	38.05	42.90
Michigan Hub	22.67	31.25	32.49	110.69	27.15	44.97	66.51	73.69	104.84	39.19	45.29	36.01	51.70	84.87	37.93	30.78	32.17	34.82	44.72	48.82	36.42	37.90	28.47	26.75	47.09	47.98
Minnesota Hub	16.95	4.53	14.68	13.93	16.26	17.80	29.31	48.91	98.01	36.56	41.64	33.50	47.13	64.31	34.73	27.81	27.81	32.33	55.69	48.16	35.52	36.37	27.19	24.93	34.75	43.48
Wisconsin PS	20.52	14.63	19.91	9.32	24.52	11.24	27.77	50.61	104.93	39.28	44.36	35.52	50.29	52.18	37.15	29.89	28.68	34.54	46.93	49.88	36.79	37.58	27.89	25.71	35.84	44.15
Forecasted Load (GW)	68.8	67.4	66.6	67.3	67.9	68.7	74.1	79.8	81.7	81.6	81.3	80.5	79.5	78.8	78.0	77.2	77.4	80.3	83.5	83.2	81.9	79.5	75.7	71.7		
Forecast Error %	-34.5%	-0.8%	-0.8%	-2.0%	-2.0%	0.8%	0.7%	0.6%	0.5%	0.8%	1.2%	1.7%	1.9%	1.7%	1.8%	1.5%	0.9%	-0.7%	-0.4%	-0.4%	-0.4%	-0.5%	-0.8%	-10.6%		

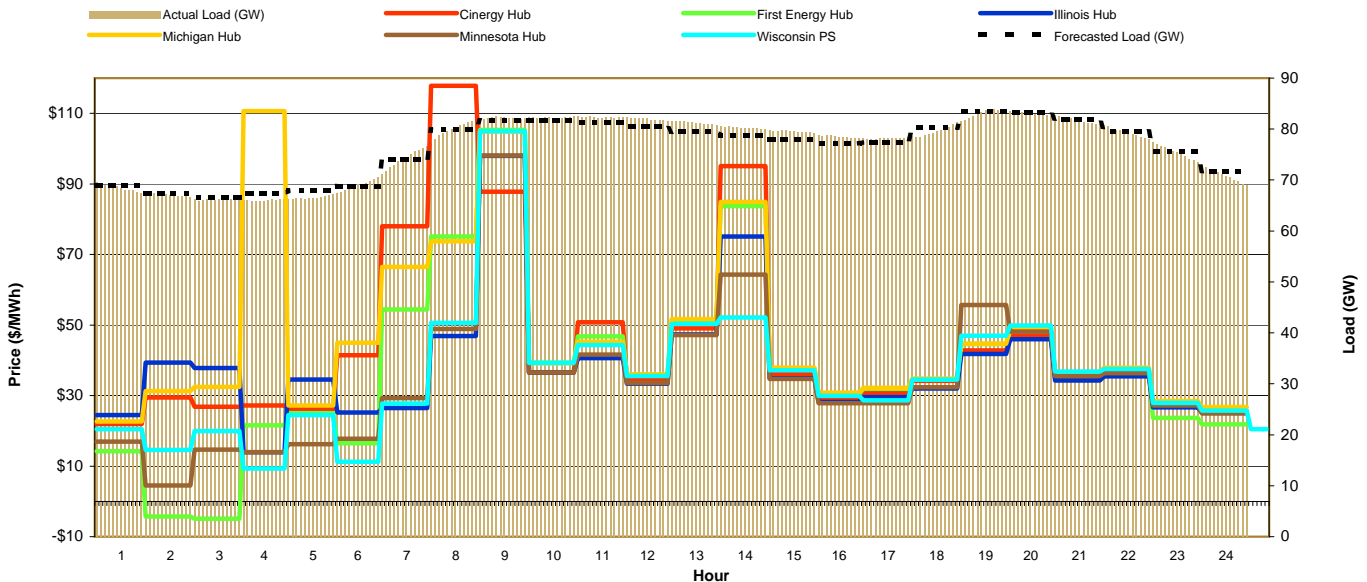




MISO Daily Report

Tuesday January 25, 2011

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	27.59	27.30	26.83	26.49	27.08	29.85	39.55	44.95	46.86	45.36	46.50	44.03	39.38	40.42	33.43	31.45	32.82	40.63	52.46	46.32	42.76	40.43	32.01	29.05	37.23	41.24
First Energy Hub	28.96	28.36	27.62	27.62	27.52	31.15	40.56	49.10	48.69	46.77	47.95	45.38	40.60	41.65	34.46	32.49	33.65	41.79	53.76	47.94	44.24	41.66	32.95	29.63	38.52	42.69
Illinois Hub	26.06	24.72	24.81	24.67	25.29	27.01	42.28	46.68	46.27	44.46	45.58	43.15	38.59	39.60	32.76	33.63	35.38	42.43	58.58	45.57	42.05	39.61	31.32	26.85	36.97	41.60
Michigan Hub	35.84	33.75	31.29	31.86	30.71	34.14	41.71	50.50	50.05	48.07	49.28	46.65	41.73	42.81	35.42	33.39	34.91	44.05	55.23	49.28	45.48	42.82	34.16	30.79	40.58	43.99
Minnesota Hub	21.81	21.39	21.07	21.12	21.14	22.09	31.55	40.05	43.62	41.93	42.91	39.12	36.15	35.27	29.98	28.20	28.67	35.44	48.28	42.98	39.66	35.49	27.96	25.83	32.57	37.23
Wisconsin PS	24.75	23.99	23.38	23.06	22.58	24.14	30.92	40.69	49.28	47.34	48.32	42.29	40.49	37.36	32.75	30.65	30.51	37.63	54.40	48.52	44.77	37.92	32.90	27.60	35.67	40.99
Cleared Load (GW)	66.9	65.4	64.5	64.3	65.1	68.4	74.0	79.5	79.8	79.3	79.1	78.3	77.9	77.3	76.3	75.8	75.8	78.0	81.4	80.2	78.9	77.7	73.5	7.0		

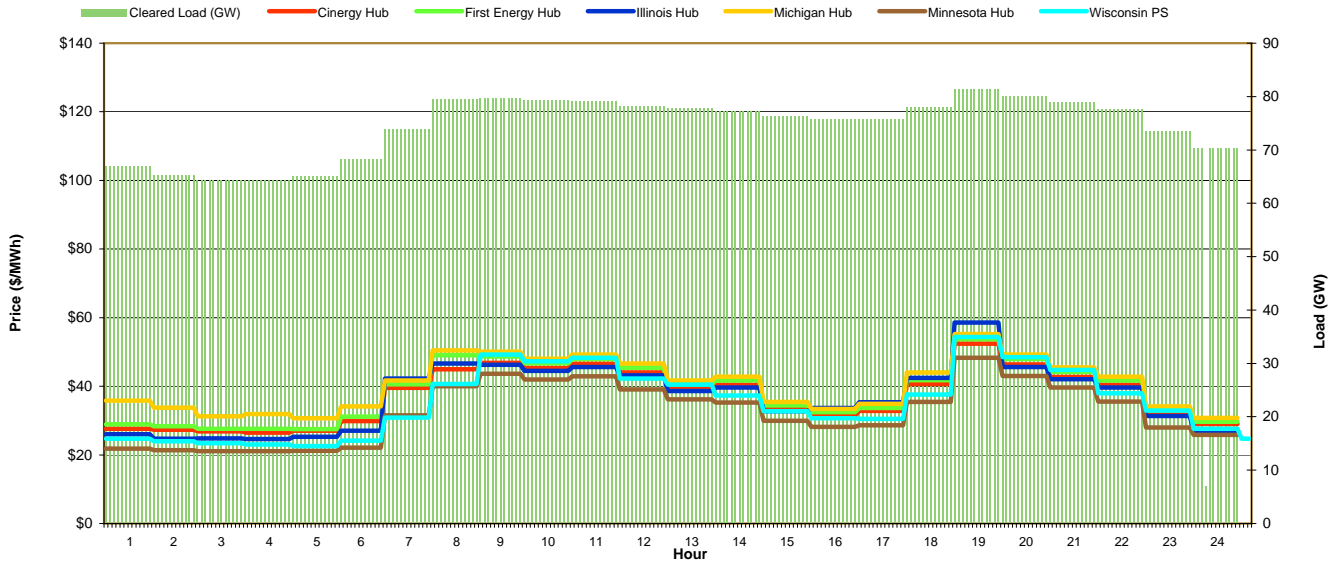

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	26.91	28.95	23.75	29.83	26.06	29.06	37.80	51.01	46.57	69.45	46.53	39.86	33.72	33.43	29.47	28.49	29.54	29.60	37.20	40.68	52.50	31.34	26.35	25.02	35.55	39.11
First Energy Hub	26.74	58.77	24.49	44.69	26.95	30.22	39.09	52.69	48.15	71.94	48.37	41.38	35.03	34.85	30.70	29.76	30.78	30.84	38.79	42.33	54.45	32.53	27.35	25.95	38.62	40.62
Illinois Hub	26.24	15.24	23.22	22.54	25.33	28.09	36.55	49.69	45.71	67.99	45.47	39.02	33.03	32.69	28.82	27.83	28.85	28.92	36.56	40.05	51.53	30.73	25.76	24.40	33.93	38.29
Michigan Hub	28.09	136.64	24.52	79.58	26.78	30.52	38.92	52.35	47.77	71.94	48.74	41.79	35.49	35.26	31.08	30.19	31.10	31.20	38.92	42.43	54.85	32.94	27.53	26.25	43.54	40.85
Minnesota Hub	24.35	15.81	22.03	21.83	23.58	24.58	30.62	47.25	49.60	72.75	48.12	41.53	35.23	34.08	29.42	27.85	26.77	28.54	38.78	43.57	55.19	32.54	26.62	23.98	34.36	39.87
Wisconsin PS	26.09	15.14	24.03	22.72	25.66	24.82	27.31	43.07	48.52	71.22	47.31	40.76	34.63	34.21	30.34	29.14	25.70	29.53	39.22	42.73	54.22	32.10	27.22	25.49	34.21	39.37
Forecasted Load (GW)	68.7	67.7	66.7	66.5	67.2	69.4	74.4	79.3	80.9	80.4	79.7	78.8	78.0	77.2	76.4	75.7	75.9	78.6	82.3	82.3	81.1	78.9	75.7	71.5		
Forecast Error %	-19.4%	-3.8%	-4.3%	-4.4%	-4.4%	-3.4%	-2.7%	-1.5%	-1.4%	-0.9%	0.3%	0.1%	0.0%	0.3%	0.2%	0.0%	0.0%	-1.1%	-0.9%	-0.6%	-0.6%	-1.2%	-10.7%			

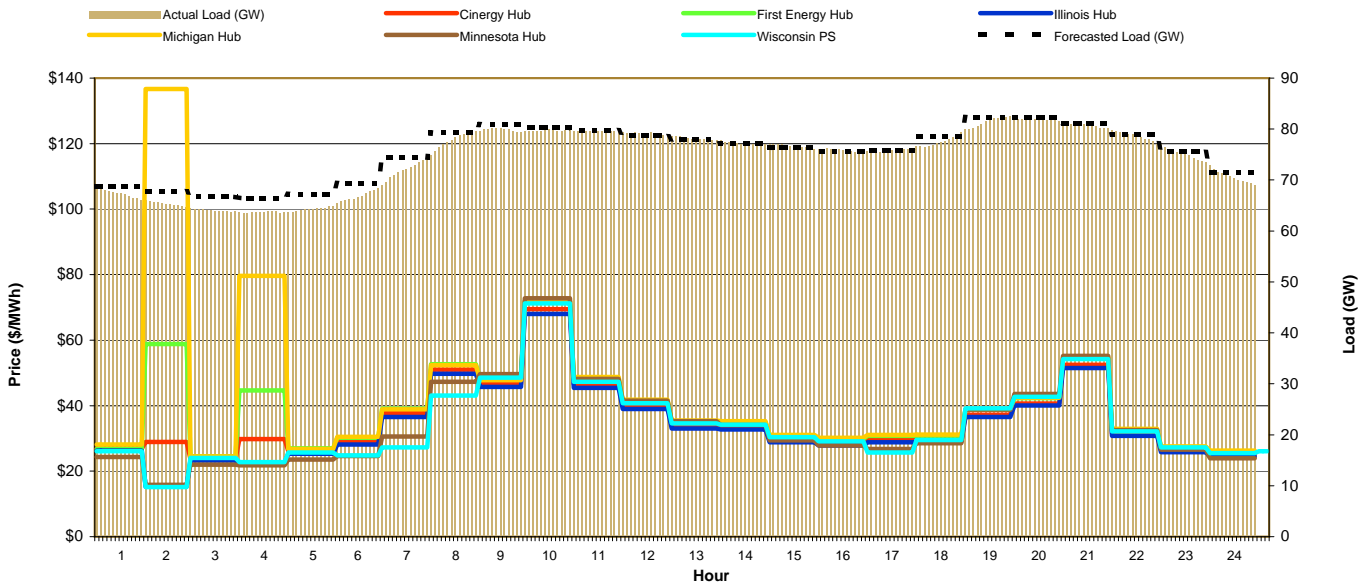




MISO Daily Report

Wednesday January 26, 2011

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	27.70	26.58	25.41	25.23	25.99	28.05	35.81	44.02	43.34	43.47	43.54	40.18	36.27	37.57	32.11	30.84	31.62	40.43	52.16	46.70	42.82	38.97	29.89	27.35	35.67	39.62
First Energy Hub	29.41	28.32	26.97	26.82	27.37	29.18	36.24	46.52	45.72	45.72	42.33	36.86	38.11	33.28	31.84	32.15	42.42	53.82	48.15	44.22	40.15	31.20	30.57	37.21	41.14	
Illinois Hub	22.87	22.15	22.03	21.85	22.01	22.92	31.06	44.27	43.46	43.46	43.47	40.25	36.96	37.84	32.10	30.71	31.15	40.59	51.16	45.77	42.05	38.19	29.12	24.61	34.17	39.41
Michigan Hub	34.10	33.14	30.98	30.85	31.21	32.47	37.24	47.83	46.99	46.99	47.48	43.51	43.83	44.81	35.60	34.08	34.81	44.34	55.31	49.49	45.45	41.27	33.27	38.10	40.13	43.44
Minnesota Hub	23.10	21.24	20.52	19.87	20.43	21.08	29.16	38.11	40.47	40.03	39.31	36.46	33.44	33.48	29.24	28.04	28.27	36.05	47.65	43.18	38.55	34.18	27.80	24.33	31.42	35.89
Wisconsin PS	23.70	22.23	21.87	21.67	21.88	23.66	29.89	38.40	45.03	43.94	42.21	39.23	35.49	34.62	31.56	30.37	30.35	37.82	52.98	48.73	42.08	36.22	29.91	26.39	33.76	38.68
Cleared Load (GW)	67.4	65.8	65.0	64.7	65.1	68.4	75.0	81.4	81.8	80.9	80.9	80.1	79.0	78.7	77.5	76.7	76.9	79.7	82.4	82.2	81.1	79.4	75.2	71.1		

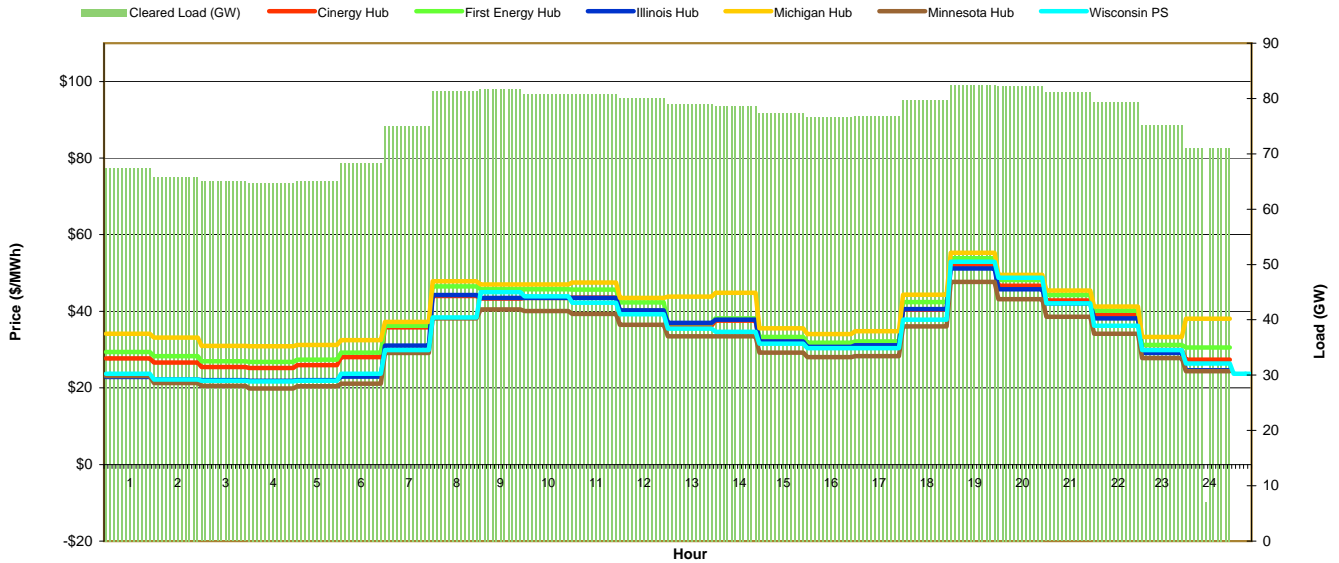

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	24.64	26.23	25.05	27.29	28.03	25.75	28.40	34.25	35.80	33.47	91.84	31.81	30.13	37.25	28.80	30.28	28.56	97.66	45.22	39.10	31.95	28.40	25.03	27.55	35.94	40.60
First Energy Hub	25.52	27.27	25.83	29.32	29.17	26.67	29.35	35.38	36.96	34.66	95.22	32.94	31.21	42.95	30.14	31.05	29.63	101.24	46.98	40.39	32.97	29.28	25.88	28.45	37.44	42.31
Illinois Hub	23.91	24.80	24.02	19.54	25.34	24.12	26.97	33.06	34.81	32.52	88.92	30.84	29.17	40.08	28.11	29.27	27.57	94.61	44.14	38.42	31.34	27.86	24.58	26.39	34.60	39.71
Michigan Hub	26.05	28.06	26.64	30.75	30.18	27.35	29.79	35.78	37.41	35.07	96.66	33.54	31.72	43.80	30.67	31.69	30.01	103.24	47.60	40.95	33.54	29.77	26.17	28.67	38.13	42.98
Minnesota Hub	22.89	23.69	23.29	18.19	24.08	21.79	25.40	33.96	37.68	34.95	92.47	31.46	29.19	31.53	26.34	7.43	26.07	59.64	42.58	39.67	31.64	27.02	23.17	20.72	31.45	35.93
Wisconsin PS	24.94	25.49	24.86	17.73	25.63	24.32	27.84	34.91	37.14	34.68	93.44	32.37	30.76	26.11	27.25	-12.31	27.50	33.45	42.49	40.30	32.46	28.03	25.69	25.87	30.45	33.39
Forecasted Load (GW)	69.5	67.7	66.7	66.4	67.1	69.4	74.3	79.2	80.7	80.2	79.7	79.1	78.2	77.4	76.7	75.9	75.9	78.4	82.1	82.4	81.3	79.1	75.5	71.8		
Forecast Error %	-38.3%	-4.0%	-4.0%	-3.9%	-3.9%	-3.5%	-2.6%	-1.0%	-0.7%	-0.6%	-0.1%	0.2%	0.5%	0.7%	1.1%	1.0%	1.3%	0.4%	0.3%	0.2%	-0.3%	-0.5%	-1.0%	-10.7%		

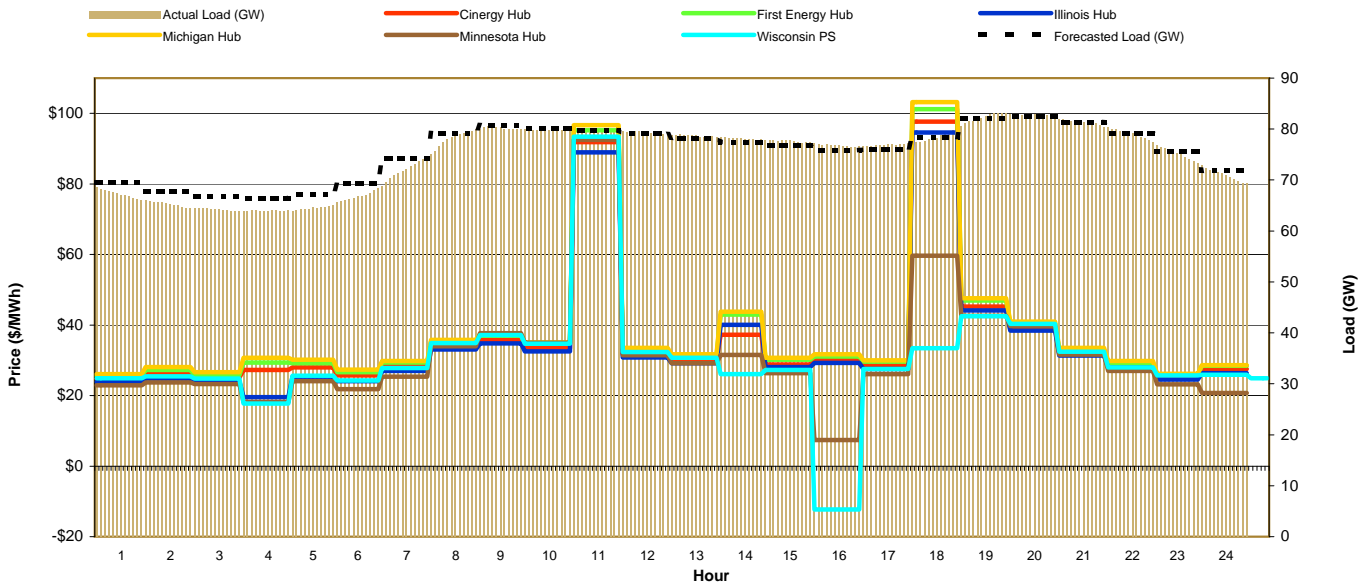




MISO Daily Report

Thursday January 27, 2011

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	28.56	28.11	27.57	27.72	28.38	29.38	38.94	45.51	44.34	43.60	43.64	42.71	40.28	40.33	35.84	33.00	33.23	40.62	52.87	44.47	43.40	39.78	33.37	28.96	37.28	41.06
First Energy Hub	29.89	29.41	28.65	28.95	29.38	30.16	40.51	47.20	46.00	45.22	45.25	44.28	41.73	41.78	37.03	33.89	34.20	42.16	54.51	45.86	44.77	40.98	32.59	29.51	38.50	42.34
Illinois Hub	25.53	24.48	24.04	23.60	23.69	25.54	33.69	44.94	43.78	43.04	43.08	42.15	39.72	39.77	35.11	30.53	31.85	37.13	51.81	43.59	42.56	38.97	32.60	26.97	35.34	40.04
Michigan Hub	32.54	31.85	30.51	30.56	30.73	31.09	41.47	48.52	47.28	46.48	46.52	45.51	42.89	42.94	38.06	34.83	35.16	43.39	56.02	47.14	46.02	42.13	35.43	30.57	39.90	43.65
Minnesota Hub	19.94	19.20	18.40	18.57	18.86	19.94	24.49	36.41	37.72	36.80	36.60	35.49	33.96	33.49	30.16	28.20	28.25	32.70	47.80	41.14	38.95	34.09	28.78	24.87	30.20	35.03
Wisconsin PS	23.24	22.07	21.20	21.09	21.37	22.44	26.95	34.87	38.79	37.52	37.03	35.55	34.62	33.54	30.86	29.49	29.55	34.30	52.88	46.41	42.80	35.91	28.67	25.56	31.94	36.42
Cleared Load (GW)	66.8	64.9	63.7	63.7	64.4	67.2	73.6	80.1	81.2	81.0	80.8	79.4	78.1	77.5	76.6	75.5	75.7	77.9	81.3	80.8	79.6	77.7	73.0	6.9		

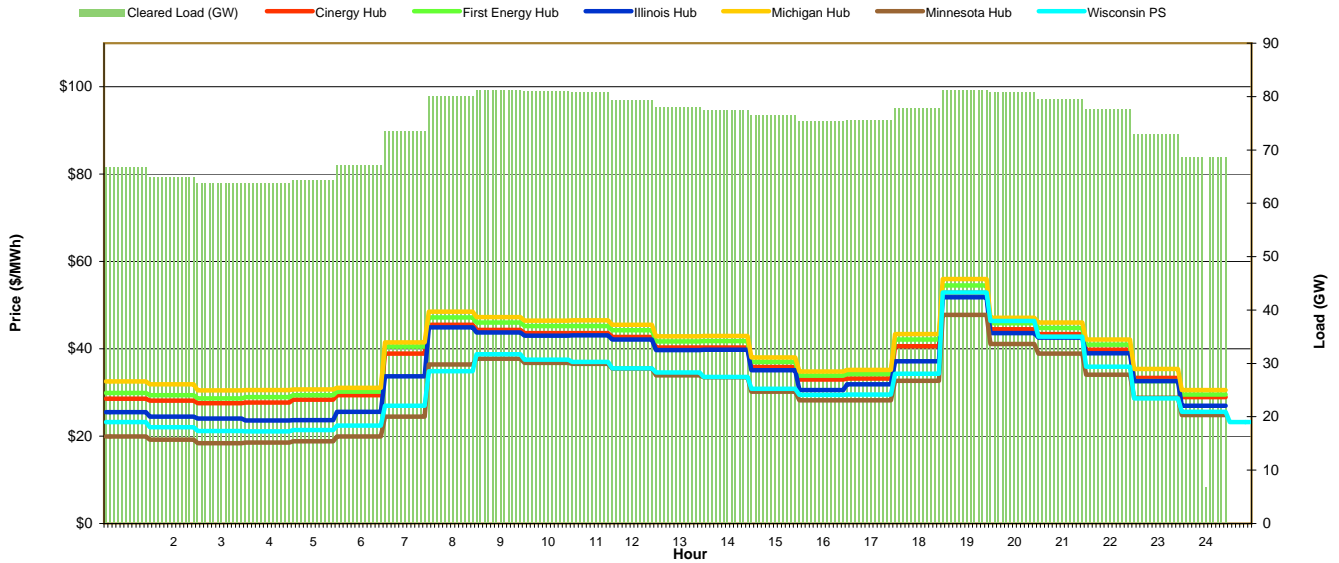

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	32.16	33.13	26.87	26.38	27.77	26.68	78.89	71.09	36.83	29.56	35.36	74.37	93.67	73.60	108.01	46.97	40.34	42.18	57.17	60.12	60.61	45.40	28.83	26.47	49.27	56.51
First Energy Hub	33.13	53.50	27.74	27.24	28.81	28.38	81.03	72.95	37.76	30.34	34.25	38.15	51.57	39.89	75.43	34.46	34.30	33.22	39.17	41.06	58.45	46.71	29.76	27.43	41.86	43.59
Illinois Hub	29.27	23.43	25.76	25.18	26.30	25.77	75.88	68.95	35.91	28.78	32.21	35.53	48.11	37.19	30.29	26.50	26.23	30.47	35.30	38.94	55.36	44.26	28.05	25.64	35.80	37.63
Michigan Hub	33.04	100.88	28.26	27.66	29.12	28.63	82.32	73.51	37.99	30.47	34.31	38.23	52.20	40.51	62.15	32.92	32.65	33.35	38.79	41.10	58.86	47.27	30.15	27.91	43.43	42.78
Minnesota Hub	11.48	20.34	21.62	20.12	19.99	20.68	57.99	69.90	37.81	30.34	32.22	36.14	43.65	35.25	38.78	28.21	26.40	31.20	37.91	41.46	58.15	46.25	28.98	25.88	34.20	38.92
Wisconsin PS	22.91	23.24	25.68	24.54	25.06	25.22	49.87	72.59	38.37	30.88	31.45	35.95	37.15	32.45	31.88	28.58	25.52	32.97	38.90	42.02	59.17	47.14	30.03	26.99	34.94	38.44
Forecasted Load (GW)	69.2	66.5	65.8	65.5	66.7	67.9	72.9	78.9	80.8	80.3	79.9	79.2	78.2	77.4	76.6	75.7	75.6	77.8	81.3	81.1	79.9	77.6	74.0	70.4		
Forecast Error %	-49.3%	-1.5%	-1.9%	-2.0%	-2.6%	-0.8%	0.1%	-0.3%	-0.2%	-0.3%	0.0%	-0.1%	0.2%	0.1%	-0.1%	-0.2%	-0.3%	-1.0%	-0.7%	-0.1%	-0.2%	-0.1%	-0.3%	-10.2%		

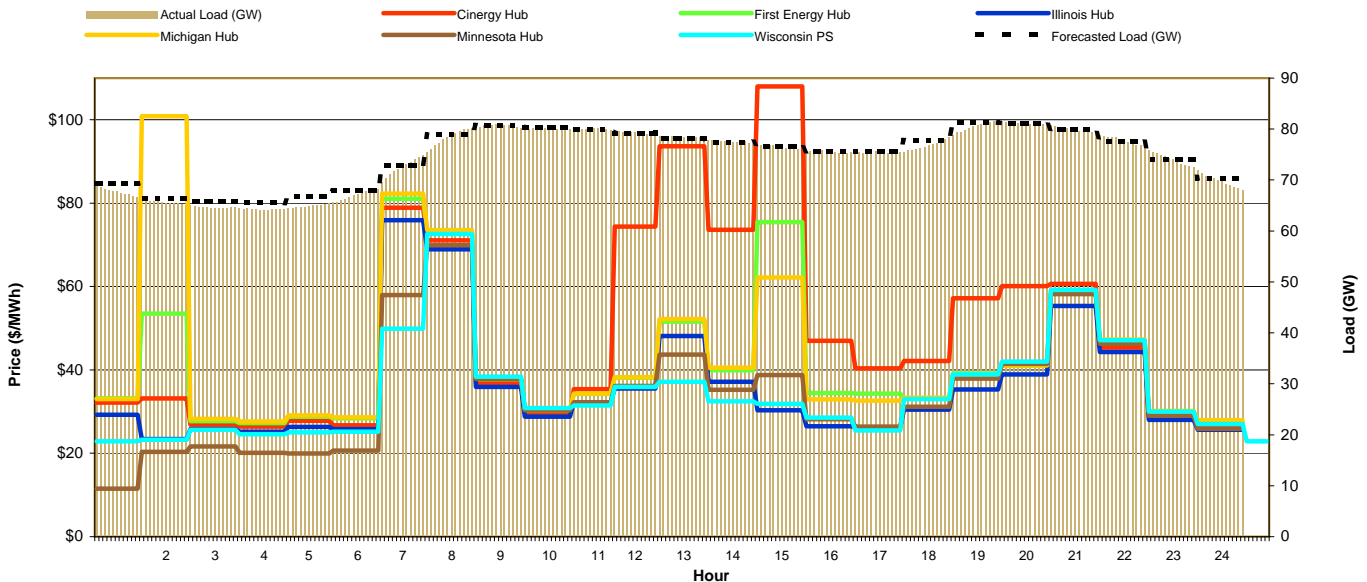




MISO Daily Report

Friday January 28, 2011

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$			
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk		
Cinergy Hub	29.51	29.02	27.99	28.10	28.85	31.97	40.42	47.78	44.47	42.28	45.91	40.01	37.65	36.46	33.85	31.03	31.43	39.72	46.19	41.78	37.95	36.94	30.95	31.99	36.34	39.03		
First Energy Hub	30.34	29.61	28.74	28.71	29.34	30.93	39.60	48.59	45.70	43.58	44.74	39.65	38.31	36.53	33.83	31.26	31.67	39.16	46.83	42.58	38.33	37.75	31.94	32.07	36.66	39.40		
Illinois Hub	26.02	24.85	24.27	24.19	24.37	25.64	30.13	43.82	42.18	41.21	41.76	33.34	33.70	30.50	28.05	26.99	27.26	32.75	41.68	36.62	31.98	30.75	26.26	24.38	31.36	34.30		
Michigan Hub	32.17	31.96	30.66	30.59	31.23	32.64	40.69	49.93	46.97	44.78	45.98	40.74	39.59	37.84	34.65	32.19	33.01	40.11	48.00	43.62	39.32	40.20	34.07	33.30	38.09	40.69		
Minnesota Hub	22.60	21.33	21.05	20.65	20.13	20.56	27.97	40.64	41.12	38.96	39.76	34.28	30.41	27.28	23.35	21.70	22.13	25.03	32.35	29.59	25.31	23.07	20.04	19.12	27.02	29.69		
Wisconsin PS	23.59	22.36	21.74	21.18	19.63	21.59	28.31	44.28	46.27	44.11	45.11	38.46	35.97	33.08	32.41	30.59	29.82	32.79	49.42	39.49	33.82	30.65	24.23	22.04	32.12	36.90		
Cleared Load (GW)	66.8	65.1	63.7	63.5	64.1	66.8	72.5	77.5	78.1	78.4	78.7	78.1	76.4	76.3	75.1	73.8	73.9	76.7	79.5	77.5	76.4	74.3	70.1	6.5				

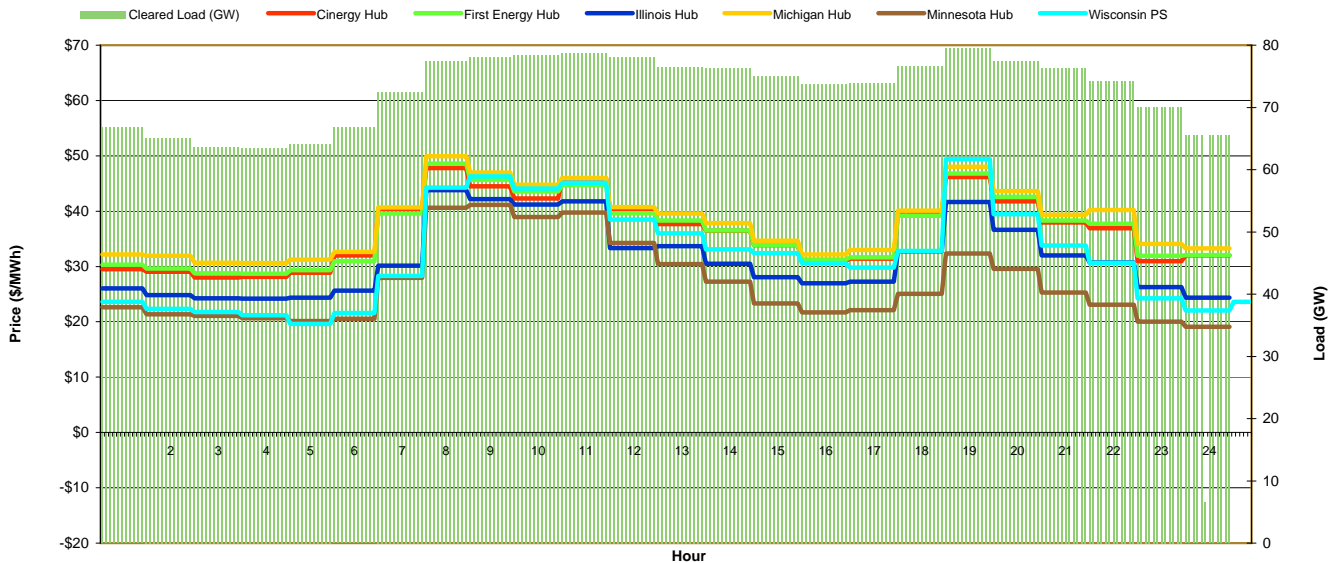

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$			
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk		
Cinergy Hub	34.40	27.57	26.81	27.76	27.13	27.37	27.19	38.35	38.55	30.87	33.32	31.53	28.86	28.82	29.42	26.97	24.61	27.97	53.06	38.13	29.37	27.56	27.61	24.72	30.75	32.19		
First Energy Hub	35.49	28.61	27.79	28.81	28.12	28.17	27.87	39.36	39.51	31.77	34.32	31.87	29.60	29.62	30.21	27.69	25.24	28.62	54.16	39.03	28.54	26.87	24.29	24.98	31.27	32.54		
Illinois Hub	32.98	23.49	22.98	23.36	23.54	24.94	26.03	37.14	37.55	30.06	32.42	30.17	27.93	27.92	28.48	26.10	23.77	27.02	51.27	36.80	14.35	16.12	-10.24	13.69	26.16	27.30		
Michigan Hub	36.17	29.43	28.69	29.82	29.07	28.79	28.17	39.77	39.94	32.11	34.73	32.53	30.36	30.45	31.02	28.48	25.93	29.49	55.79	40.20	29.22	27.48	24.95	26.00	32.02	33.28		
Minnesota Hub	27.26	22.50	21.58	21.76	21.88	23.40	24.99	36.82	38.65	30.22	32.35	29.61	26.96	14.51	16.53	19.90	19.76	14.71	42.41	46.37	17.71	21.04	19.66	5.12	24.82	26.70		
Wisconsin PS	24.53	23.97	27.81	30.07	31.51	29.70	27.37	39.60	40.34	32.37	34.94	32.40	30.10	35.95	35.91	30.36	26.82	34.70	59.33	48.66	32.39	35.51	25.76	27.97	33.25	35.94		
Forecasted Load (GW)	67.4	65.4	65.0	65.0	65.6	67.3	71.4	77.2	79.5	79.1	78.7	77.8	76.7	75.7	74.8	73.9	73.6	75.4	78.4	77.9	76.6	74.5	71.4	67.4				
Forecast Error %	-38.6%	-1.7%	-3.1%	-3.4%	-3.5%	-1.7%	-0.2%	-0.2%	-1.2%	-0.9%	-0.6%	-0.7%	-0.2%	-0.2%	-0.1%	-0.2%	-0.7%	-1.3%	-0.8%	0.0%	-0.1%	0.6%	71.4	67.4				

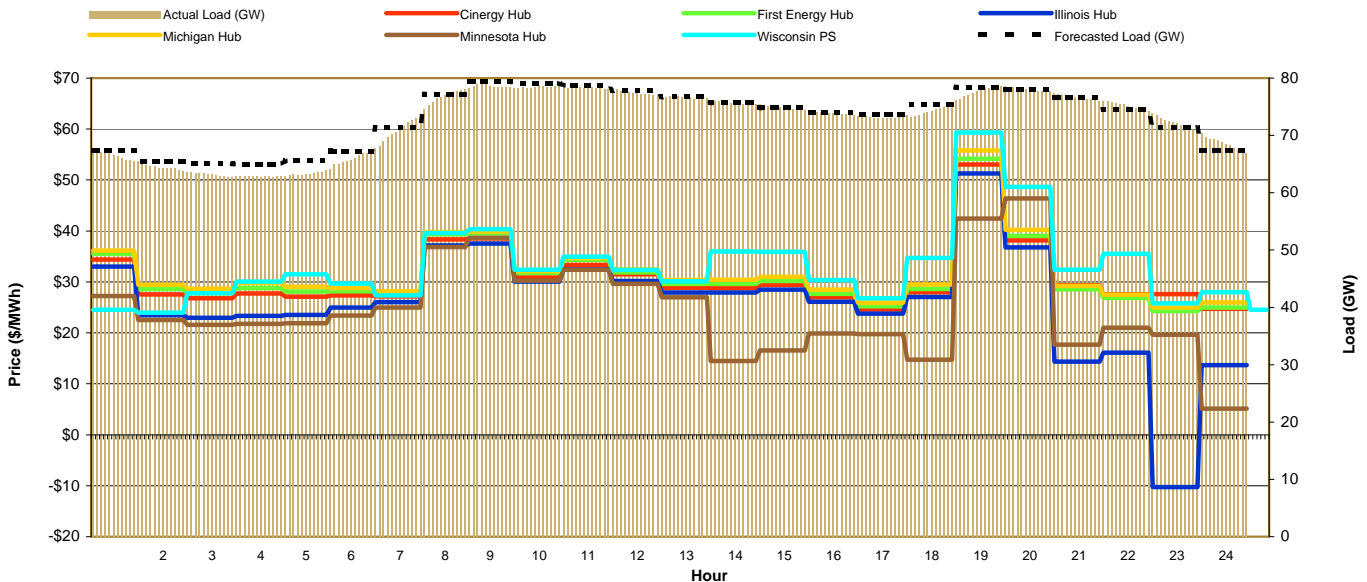




MISO Daily Report

Saturday January 29, 2011

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	29.02	28.82	27.47	26.82	26.07	26.15	29.19	30.08	32.76	38.74	41.54	40.37	33.78	31.31	29.89	29.39	30.06	37.56	46.66	43.97	37.58	35.19	31.11	29.10	33.03	35.62
First Energy Hub	29.90	29.68	29.38	28.68	28.02	28.10	30.49	31.02	33.66	38.80	42.39	41.17	34.45	32.09	30.54	30.29	30.89	38.36	47.94	45.69	38.34	35.96	31.76	29.67	34.05	36.46
Illinois Hub	24.21	23.84	23.17	22.73	22.64	23.66	25.25	24.27	25.81	31.34	37.61	35.99	28.87	27.29	25.84	24.11	24.53	33.34	44.67	42.47	32.75	30.94	26.28	24.99	28.61	31.01
Michigan Hub	30.45	30.38	32.11	31.28	30.54	30.44	32.34	31.58	34.29	39.26	42.61	41.76	34.97	32.55	30.91	30.65	31.27	39.37	48.11	45.86	38.49	36.13	32.12	30.06	34.90	36.87
Minnesota Hub	17.34	17.36	15.64	15.09	14.92	15.76	19.08	20.92	25.09	30.50	35.65	36.27	30.45	27.56	26.05	24.88	25.18	32.27	44.52	42.43	34.17	30.65	25.25	22.44	26.23	30.74
Wisconsin PS	20.81	19.82	17.66	16.62	16.07	17.87	21.47	23.99	27.05	29.88	35.40	38.16	32.91	28.68	27.25	26.40	26.62	32.51	47.57	45.32	36.82	31.42	26.73	24.99	28.00	32.29
Cleared Load (GW)	63.6	62.3	60.9	60.9	60.5	61.7	65.0	67.4	69.4	71.5	71.9	71.5	70.8	69.5	68.4	67.7	68.2	72.4	74.0	73.1	72.7	71.5	68.5	6.6		

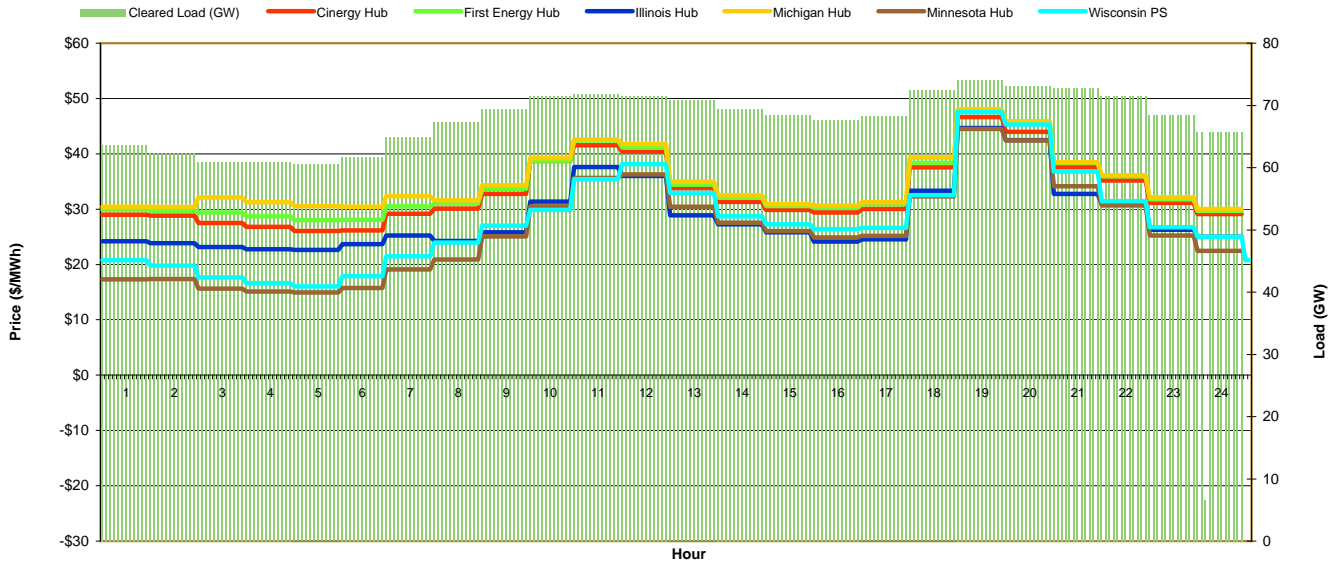

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	22.17	26.35	30.59	25.92	29.21	26.30	26.80	26.12	28.13	40.50	38.30	30.57	26.38	25.63	26.39	24.43	24.72	25.52	48.53	35.11	27.12	25.76	26.24	21.46	28.68	29.97
First Energy Hub	18.19	27.28	31.72	26.76	30.31	27.17	27.68	26.98	29.02	19.30	31.51	29.27	27.17	18.59	21.51	18.73	25.52	26.05	48.97	35.40	27.92	26.50	26.84	21.90	27.10	27.46
Illinois Hub	-25.83	20.71	17.64	18.07	16.06	20.50	22.71	22.51	24.44	33.39	36.47	29.35	25.39	24.70	25.34	23.48	23.69	24.53	46.90	34.05	26.18	24.89	24.98	20.38	23.36	28.14
Michigan Hub	18.68	28.49	33.42	27.85	31.78	27.94	28.27	27.54	29.61	42.93	40.42	32.29	27.92	27.10	27.91	25.82	26.14	27.05	51.43	37.12	28.79	27.43	27.75	22.59	30.26	31.70
Minnesota Hub	13.73	11.28	9.44	15.84	13.80	18.97	20.93	20.64	22.10	30.54	34.25	27.77	24.44	23.85	24.18	22.16	22.24	23.19	45.10	33.12	24.45	22.95	14.43	10.43	22.08	25.96
Wisconsin PS	21.03	16.92	13.52	17.68	14.54	20.65	24.07	24.31	26.82	34.42	38.46	30.70	26.58	26.06	26.68	24.73	24.93	26.01	50.55	36.34	26.99	25.14	6.97	3.03	24.46	28.48
Forecasted Load (GW)	64.1	62.0	61.3	61.6	61.5	62.4	64.3	66.5	67.5	69.0	70.0	69.9	69.2	68.1	67.1	66.4	66.7	69.3	73.0	72.9	71.9	70.3	68.1	65.5		
Forecast Error %	-7.5%	0.7%	-0.3%	-2.0%	-1.9%	-1.8%	-1.8%	-0.8%	0.6%	0.8%	0.9%	0.7%	0.1%	-0.2%	-0.2%	-0.3%	-1.4%	-1.2%	-0.8%	-0.6%	-0.5%	-0.7%	-10.7%			

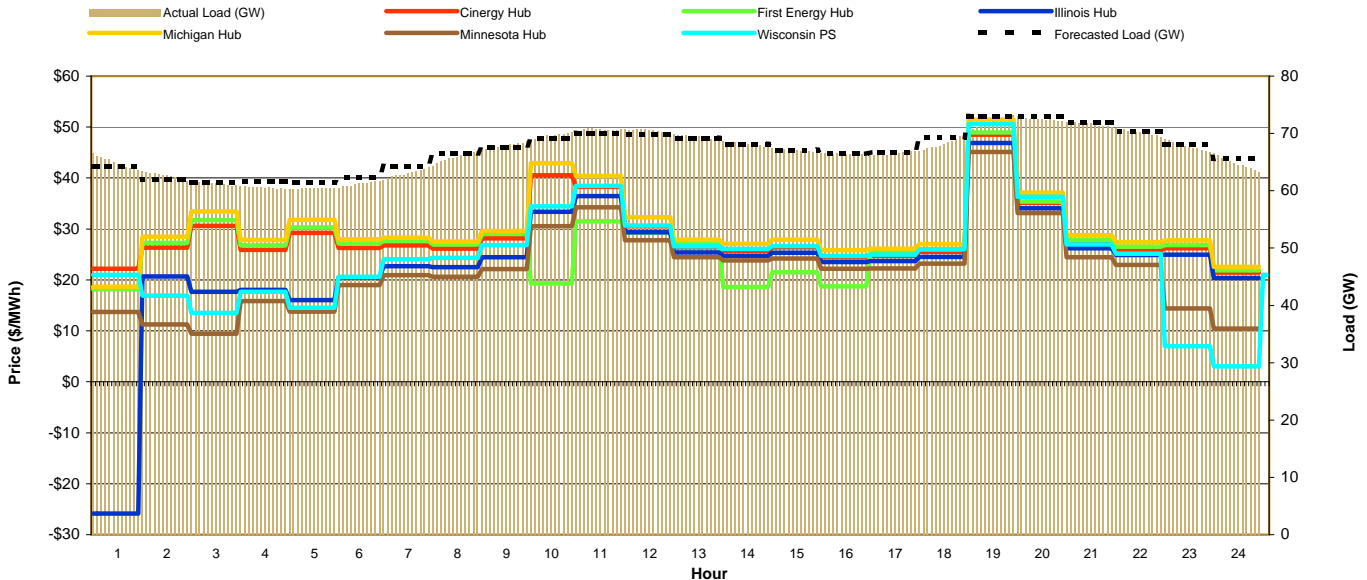




MISO Daily Report

Sunday January 30, 2011

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	28.66	28.54	27.96	27.38	27.15	26.80	27.39	28.66	29.14	31.77	32.69	31.72	30.87	29.36	28.47	28.26	29.22	35.92	49.59	48.54	41.19	37.13	31.92	28.93	31.97	34.03
First Energy Hub	30.11	29.95	27.86	27.17	26.95	26.83	27.29	29.49	30.00	30.78	31.27	31.08	29.46	29.67	29.19	28.91	30.01	35.26	52.14	51.00	40.46	35.74	30.70	28.78	32.09	34.07
Illinois Hub	20.77	21.00	21.00	20.95	20.97	21.94	22.63	24.99	25.88	27.54	28.37	27.84	27.07	25.90	25.05	24.76	25.54	34.99	48.41	47.40	40.34	35.77	30.61	25.88	28.15	31.28
Michigan Hub	31.00	30.89	27.99	27.42	27.20	26.84	27.34	29.50	30.23	32.55	33.48	32.59	31.73	30.27	29.32	29.03	30.15	37.94	52.34	51.25	43.62	38.84	34.01	33.70	33.30	35.43
Minnesota Hub	19.07	18.34	18.02	17.76	17.71	18.78	20.25	21.09	23.38	26.91	27.80	27.99	26.89	26.02	24.95	24.61	25.39	31.58	48.40	47.37	40.37	33.30	26.59	23.82	26.52	30.17
Wisconsin PS	21.28	20.51	19.82	19.11	18.91	20.40	22.12	23.34	24.90	27.26	28.26	29.30	27.77	27.19	25.86	25.43	26.02	30.38	51.86	50.73	43.26	32.94	27.55	24.76	27.87	31.37
Cleared Load (GW)	62.2	60.5	59.6	59.3	59.1	60.1	62.4	65.2	67.0	68.6	69.1	69.2	68.6	67.8	66.9	66.6	67.4	71.2	75.4	74.9	74.8	73.0	70.2	6.8		

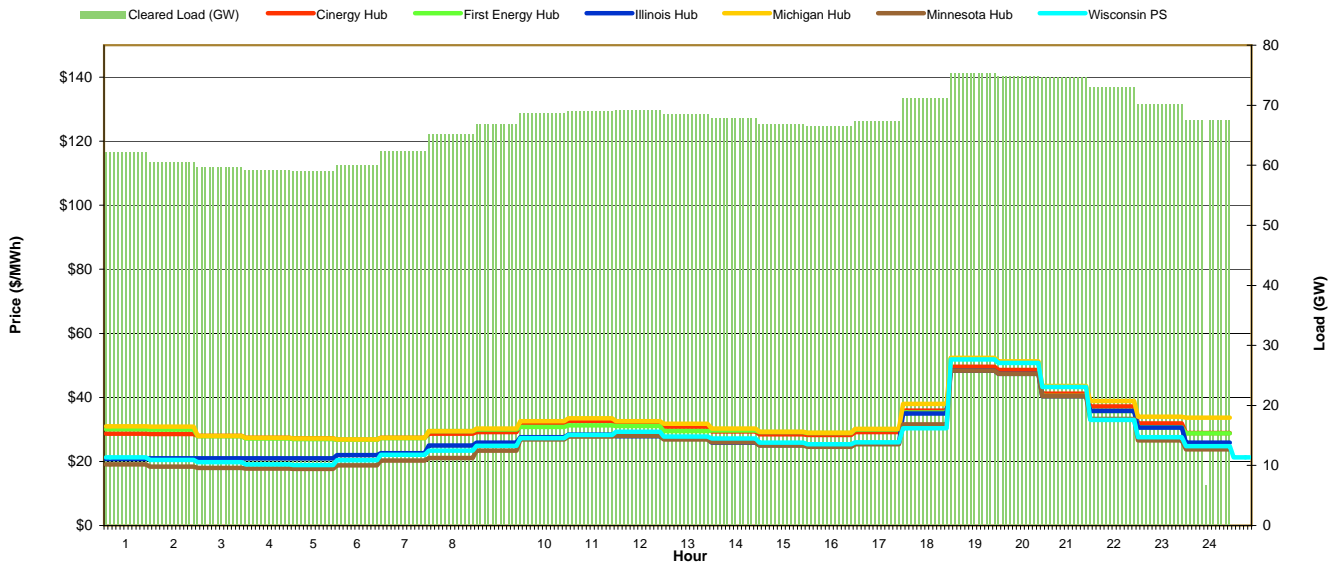

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	28.35	23.32	26.98	25.28	23.56	22.85	24.44	26.87	24.47	25.49	26.61	25.13	25.43	25.10	24.15	24.46	24.82	30.87	139.88	34.38	34.43	27.95	27.56	25.46	31.16	34.23
First Energy Hub	28.79	23.69	27.83	25.93	24.03	23.24	24.99	27.44	24.92	25.96	27.19	25.67	25.99	25.72	24.73	25.03	25.44	31.76	144.18	35.42	35.46	30.27	30.40	27.93	32.17	35.35
Illinois Hub	24.98	20.77	15.61	19.34	20.52	19.57	23.44	25.59	23.49	24.51	25.69	24.34	24.64	24.32	23.43	23.79	24.16	30.03	136.09	33.51	33.53	28.51	28.62	26.00	29.35	33.99
Michigan Hub	28.57	23.71	29.37	27.03	24.37	22.85	25.60	28.18	25.58	26.70	28.01	26.48	26.80	26.56	25.51	25.81	26.21	32.66	147.62	36.27	36.45	31.22	31.48	29.32	33.02	36.35
Minnesota Hub	3.44	6.35	13.73	17.71	10.67	0.61	20.70	22.09	22.08	23.39	25.12	24.18	24.50	24.15	23.06	22.50	23.08	27.00	140.19	35.11	34.42	28.55	26.58	23.39	25.94	32.88
Wisconsin PS	17.16	15.55	13.99	19.11	17.28	12.04	22.36	23.46	25.18	25.77	27.00	25.72	26.01	25.74	24.76	23.12	24.13	26.16	147.71	36.06	35.52	29.53	25.96	23.00	28.84	34.49
Forecasted Load (GW)	62.5	60.7	60.1	59.6	60.7	61.6	63.5	65.8	65.9	67.3	68.0	68.3	68.2	67.7	66.9	66.5	67.2	70.3	74.7	75.8	74.8	73.3	70.7	68.3		
Forecast Error %	-38.2%	-1.6%	-2.2%	-2.3%	-4.2%	-4.5%	-5.1%	-4.8%	-2.1%	-1.8%	-2.0%	-2.7%	-3.2%	-3.3%	-3.3%	-3.2%	-3.2%	-3.5%	-1.6%	-0.9%	-0.1%	-0.3%	-0.5%	-10.7%		

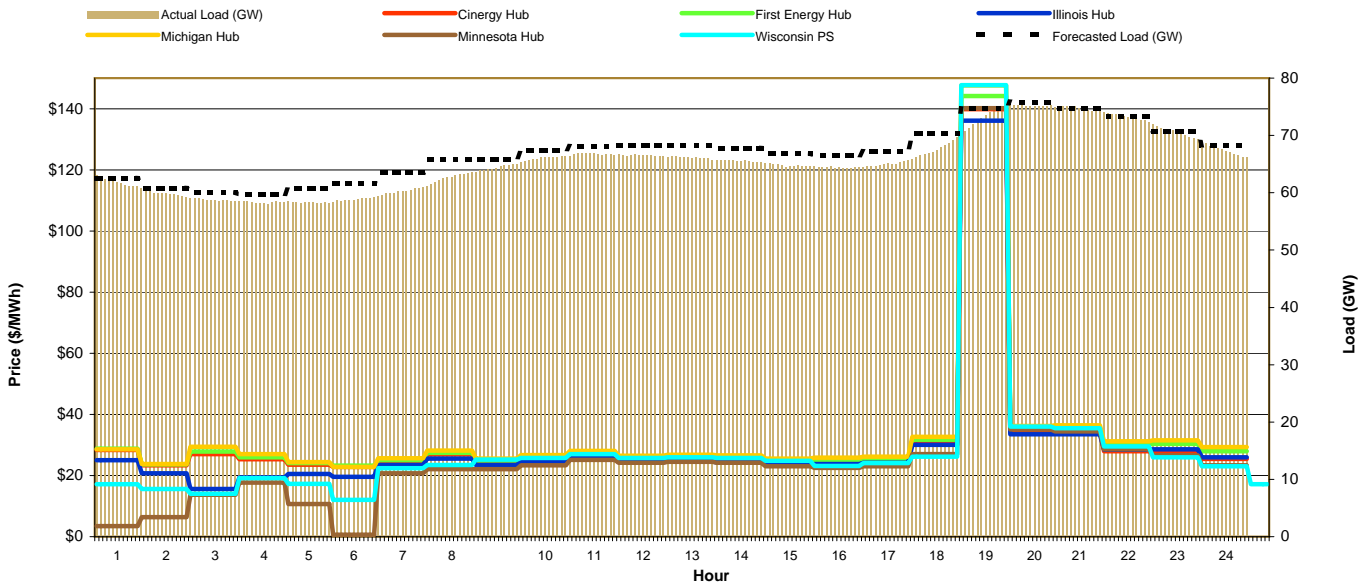




MISO Daily Report

Monday January 31, 2011

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%

Day-Ahead Prices and Cleared Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	28.57	28.61	28.47	28.18	28.00	28.94	38.22	49.34	46.20	46.05	44.60	44.16	44.35	43.34	37.46	35.22	36.70	43.15	53.94	47.15	44.20	37.33	32.34	28.42	38.46	42.85
First Energy Hub	30.15	30.03	29.87	29.04	28.81	29.80	38.49	50.82	48.05	47.88	46.46	46.00	45.94	43.66	37.39	35.41	36.31	44.66	56.21	49.14	46.01	38.84	33.52	29.23	39.66	44.14
Illinois Hub	21.00	21.00	20.72	21.00	21.36	21.56	29.54	43.81	44.73	43.96	43.18	42.75	41.05	39.75	34.72	32.32	33.50	39.85	52.22	45.65	42.07	35.87	30.51	25.07	34.47	40.37
Michigan Hub	32.79	32.09	31.73	29.62	29.33	30.38	38.73	51.10	48.28	48.09	46.65	46.18	46.15	45.05	38.97	36.84	38.16	44.89	56.42	49.32	46.20	39.01	33.85	29.52	40.39	44.70
Minnesota Hub	20.28	19.68	19.51	19.39	19.65	20.29	22.30	34.62	37.04	39.00	38.74	38.29	35.90	34.79	28.38	26.54	28.29	33.67	48.99	41.50	38.61	30.87	23.93	21.42	30.07	34.95
Wisconsin PS	21.85	21.28	20.75	20.68	20.75	22.38	30.13	36.27	39.63	44.56	46.54	45.64	40.13	37.53	32.64	31.13	31.15	36.34	57.36	50.81	45.58	36.39	35.64	30.15	34.80	40.46
Cleared Load (GW)	65.0	63.7	62.8	62.8	63.3	66.6	73.7	79.8	80.9	81.2	81.5	80.8	80.0	79.3	78.4	77.6	78.1	80.2	83.3	82.9	81.5	79.4	74.6	7.0		

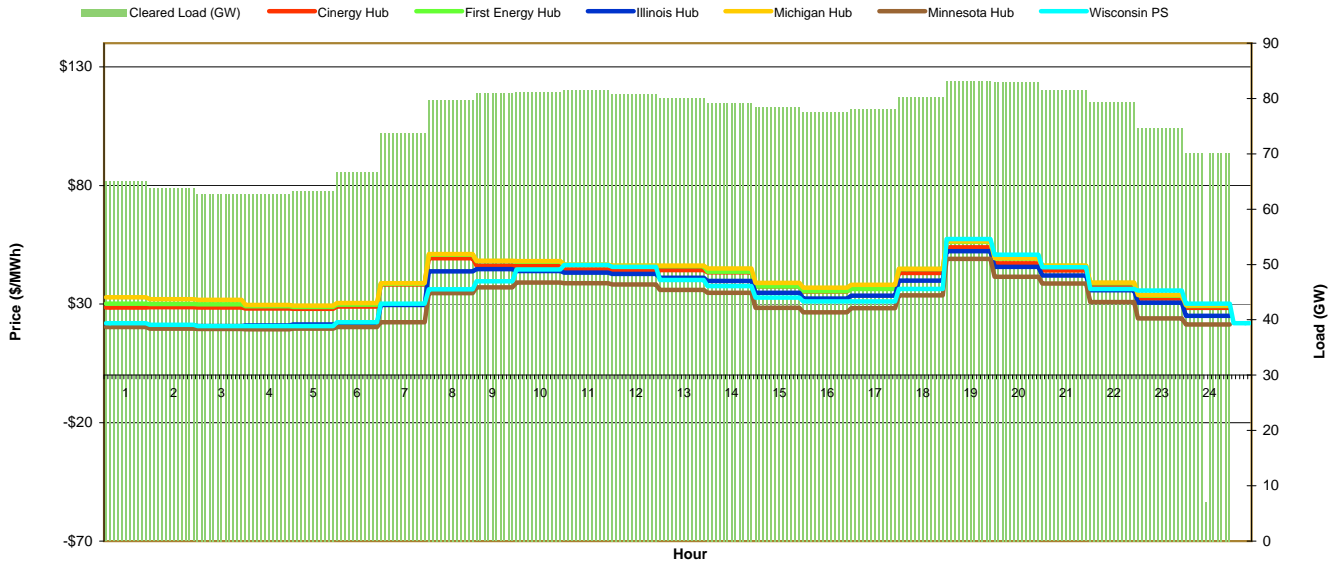

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:																									Avg. Hr \$	
	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	All	On Pk
Cinergy Hub	26.78	27.45	25.86	25.87	27.04	41.13	74.73	43.34	35.16	38.75	33.29	32.13	61.88	43.22	34.74	31.45	30.28	128.31	33.70	42.07	42.75	30.50	30.71	28.02	40.38	43.27
First Energy Hub	39.35	28.76	26.48	26.63	27.82	41.85	77.23	45.16	36.38	40.09	34.99	38.63	64.67	44.67	37.55	35.26	33.96	135.13	41.17	47.06	49.03	36.02	36.67	28.15	43.86	47.28
Illinois Hub	20.03	22.18	24.28	20.01	21.21	38.76	69.49	42.09	33.99	37.55	32.81	36.34	60.90	42.22	35.72	33.56	32.14	127.54	38.86	44.39	46.22	34.05	34.89	27.07	39.85	44.58
Michigan Hub	73.55	31.60	27.49	27.88	28.99	42.74	78.19	45.83	36.76	40.53	35.56	39.44	66.30	46.19	39.09	36.74	35.26	139.81	42.41	48.40	50.37	37.24	38.17	29.10	46.57	48.63
Minnesota Hub	19.17	18.57	19.72	17.77	15.51	7.80	23.80	36.02	33.28	35.23	31.97	34.76	52.47	38.34	33.84	28.66	23.59	38.29	32.71	41.21	40.84	25.68	26.91	-22.35	27.24	34.61
Wisconsin PS	19.04	19.13	18.25	17.03	10.83	-11.59	33.14	30.61	31.45	30.58	29.76	30.67	36.45	31.94	31.01	29.17	26.36	42.35	37.42	35.38	32.80	31.27	32.60	-61.48	23.51	32.49
Forecasted Load (GW)	64.7	64.3	63.8	63.8	64.8	67.0	71.8	77.8	79.7	79.8	80.0	79.6	79.0	78.5	77.8	77.0	77.0	79.5	82.8	82.7	81.4	79.0	75.2	72.0		
Forecast Error %	-36.4%	-1.2%	-1.4%	-1.3%	-1.4%	0.2%	1.7%	1.8%	1.5%	1.3%	1.2%	1.1%	1.0%	1.1%	1.4%	1.9%	2.0%	1.2%	1.4%	1.7%	1.6%	1.2%	1.3%	-9.0%		

