


Permanent Foundations Guide for Manufactured Housing

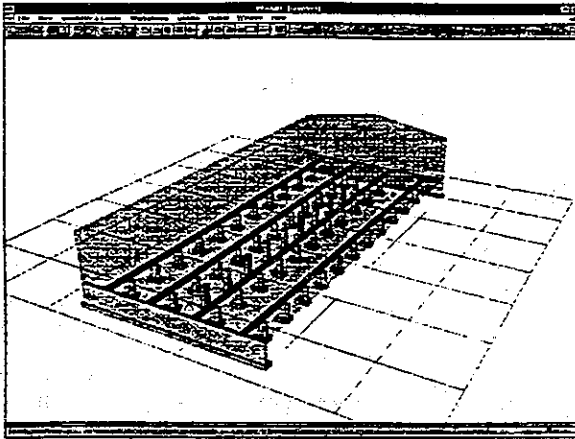

1. The first part of the document discusses the importance of maintaining accurate records of all transactions and activities. It emphasizes that this is crucial for ensuring transparency and accountability in the organization's operations.

2. The second part of the document outlines the various methods and tools used to collect and analyze data. It highlights the need for consistent and reliable data collection processes to support effective decision-making.

3. The third part of the document focuses on the role of technology in modern data management. It discusses how advanced software solutions can streamline data collection, storage, and analysis, leading to more efficient and accurate results.

4. The fourth part of the document addresses the challenges associated with data management, such as data quality, security, and privacy. It provides strategies to mitigate these risks and ensure that the organization's data remains secure and compliant with relevant regulations.

5. The fifth part of the document discusses the importance of data governance and the role of a data governance committee. It outlines the key components of a robust data governance framework, including clear policies, roles, and responsibilities.

6. The sixth part of the document explores the future of data management, including the impact of emerging technologies like artificial intelligence and machine learning. It suggests ways in which these technologies can be leveraged to enhance data management practices and drive innovation.

Permanent Foundations Guide for Manufactured Housing

**Prepared for:
U.S. Department of Housing and
Urban Development
Office of Policy Development and Research**

**Prepared by:
School of Architecture / Building Research Council
University of Illinois at Urbana-Champaign
Champaign, Illinois**

September 1996

Handwritten text, possibly a list or notes, located in the upper middle section of the page.

Handwritten text, possibly a list or notes, located in the middle section of the page.

Handwritten text, possibly a list or notes, located in the lower middle section of the page.

Handwritten text, possibly a list or notes, located in the lower section of the page.

Notice

The U.S. Government does not endorse products or manufacturers. Trade or manufacturer's names appear herein solely because they are considered essential to the object of this report.

The contents of this report are the views of the contractor and do not necessarily reflect the views or policies of the U.S. Department of Housing and Urban Development or the U.S. Government.

1. The first part of the document discusses the importance of maintaining accurate records of all transactions and activities. It emphasizes that this is crucial for ensuring transparency and accountability in the organization's operations.

2. The second part of the document outlines the various methods and tools used to collect and analyze data. It highlights the need for consistent and reliable data collection processes to support effective decision-making.

3. The third part of the document focuses on the role of technology in data management and analysis. It discusses how modern software solutions can streamline data collection, storage, and reporting, thereby improving efficiency and accuracy.

4. The fourth part of the document addresses the challenges associated with data management, such as data quality, security, and privacy. It provides strategies to mitigate these risks and ensure that data is used responsibly and ethically.

5. The fifth part of the document discusses the importance of data governance and the establishment of clear policies and procedures. It stresses that a strong data governance framework is essential for maintaining data integrity and compliance with regulatory requirements.

6. The sixth part of the document explores the benefits of data-driven decision-making and how it can lead to improved performance and innovation. It provides examples of successful organizations that have leveraged data to gain a competitive edge.

7. The seventh part of the document discusses the future of data management and the emerging trends in the field. It highlights the growing importance of artificial intelligence and machine learning in data analysis and the need for ongoing learning and adaptation.

8. The eighth part of the document provides a summary of the key points discussed and offers final thoughts on the importance of data in the modern business landscape. It encourages organizations to embrace data as a strategic asset and to invest in the necessary resources to maximize its value.

9. The ninth part of the document includes a list of references and resources for further reading. It provides links to relevant articles, books, and industry reports that can help readers stay up-to-date on the latest developments in data management and analysis.

10. The tenth part of the document concludes with a call to action, encouraging readers to take the steps necessary to implement the best practices discussed in the document. It emphasizes that data is a powerful tool that, when used correctly, can drive significant positive change in any organization.

Foreword

Permanent Foundations Guide for Manufactured Housing is an update and revision of the 1989 handbook. Its current technical information, recommendations, and tables of analytical data will meet the support and anchorage requirements for foundations that are necessary to minimize manufactured home damage during high winds or earthquakes.

Whereas wind alone governed the information on overturning and sliding in the 1989 handbook, stringent seismic criteria now make it necessary to review both forces in order to determine which should control the foundation design. To account for this significant issue, the tables have been modified to include seismic data and highlight those values controlled by seismic considerations. In addition, the need to address current architectural preferences for open space required that the guide discuss large "marriage wall" openings for multi-section units. To make the Guide easier to comprehend, there has been a significant increase in the number of illustrations and clarification of the accompanying text.

Although many pages have been added, the *Permanent Foundation Guide* is a logically organized easy-to-use reference for the permanent foundation process and for the design of anchorages that will assure adequate structural performance for manufactured homes. There is also companion computer software and its guide available.

The *Permanent Foundation Guide* will be extremely useful to all who are involved in the approval of mortgage insurance for manufactured homes on permanent foundations: engineers, manufacturers, HUD Field Office Staff, and site owners.



Michael A. Stegman
Assistant Secretary for Policy
Development and Research

The first part of the document discusses the importance of maintaining accurate records of all transactions. It emphasizes that proper record-keeping is essential for the integrity of the financial system and for the ability to detect and prevent fraud.

In addition, the document outlines the various methods used to collect and analyze data. It notes that the use of modern technology, such as data mining and artificial intelligence, has significantly improved the efficiency and accuracy of these processes. However, it also highlights the need for robust security measures to protect sensitive information from unauthorized access.

The document further discusses the challenges faced by organizations in implementing these technologies. It points out that a lack of skilled personnel and inadequate infrastructure can be major barriers to success. Therefore, it recommends that organizations invest in training and infrastructure to ensure they are fully equipped to handle the demands of modern data analysis.

Finally, the document concludes by emphasizing the importance of transparency and accountability in all financial activities. It calls for a commitment to ethical standards and the highest quality of work to ensure the trust and confidence of all stakeholders.

By following these guidelines, organizations can ensure the accuracy and integrity of their financial records, thereby supporting the overall stability and growth of the financial system.

Ordering Information for the
**PERMANENT FOUNDATIONS GUIDE
FOR MANUFACTURED HOUSING**

Additional copies of the *Permanent Foundations Guide for Manufactured Housing* and the *Software User's Guide* and software can be downloaded from the Word Wide Web at <http://www.huduser.org/publications/destech/permfound.html>

Order Form

- Please send me _____ copies of *Permanent Foundation Guide for Manufactured Housing* (HUD-007487) at \$5.00 each
- Please send me _____ copies of the *Software User's Guide and software for Windows 95* (HUD-7586-2, CD) at \$15.00 each

Mail this form to HUD USER, P.O. Box 23268 Washington, DC 20026-3268. All orders must be prepaid. To place credit card orders or for more information, call 1-800-245-2691 or 1-800-927-7589 (TDD), or fax 1-202-708-9981

Name: _____ Title: _____

Organization: _____

Address: _____

City: _____ State: _____ Zip: _____

- Enclosed is a check or money order payable to HUD USER

Charge my: _____ MasterCard _____ Visa

Acct no: _____

Signature: _____ Exp Date: _____

- Enclosed is a Government Purchase Order No: _____

Executive Summary

This Handbook updates and revises the Permanent Foundation Guide for Manufactured Housing :Handbook 4930.3, August, 1989. This work was commissioned by the U.S. Department of Housing and Urban Development, Office of Policy Development and Research. The Handbook has received a critical review and has been somewhat reorganized and supplemented with additional graphics to simplify its application. The major revisions include:

- The definition of Permanent Foundation has been expanded and clarified in Chapter 1.
- Design loads have been updated to the current loading requirements for snow, wind and seismic forces of the Minimum Design Loads for Buildings and Other Structures, ASCE 7-93 Edition. The load maps of Appendix H have been replaced by the new maps in ASCE 7-93.
- The Seismic portion of the Handbook, which showed no influence over wind in the previous code, has now become a significant factor in the ASCE 7-93 for consideration of overturning and sliding. Thus, the Tables of Appendix B have required reorganization and expansion. Seismic table values are grayed over to indicate that seismic controls over wind for the parameters of a given Table.
- All of the Foundation Concepts, except Type E2, have been retained in this updated edition. A survey was sent to all HUD field offices which substantiated this decision. Appendix D has been expanded to include sample formula derivations for all of these Foundation Concepts; this includes text and graphics for all single-section and multi-section units for added clarity.
- Appendix A Foundation Concept Details have been redrawn and revised to reflect the new ASCE 7-93 Loads document and their relationship to Appendix B Tables.
- This update now includes consideration of large openings along the length of marriage walls in multi-section units. Appendix B Tables includes openings that range from 10 to 20 feet in 2 foot increments.

Although many pages have been added, the Handbook has become a logically organized and easy to use reference in the permanent foundation selection process and in the anchorage design to assure adequate structural performance for Manufactured Homes.

1. The first part of the document discusses the importance of maintaining accurate records of all transactions. It emphasizes that proper record-keeping is essential for ensuring the integrity and reliability of financial data. This section also outlines the various methods and tools used to collect and store data, highlighting the need for consistency and accuracy throughout the process.

2. The second part of the document focuses on the analysis and interpretation of the collected data. It describes the various statistical techniques and models used to identify trends, patterns, and anomalies in the data. This section also discusses the importance of contextualizing the data and understanding the underlying factors that may influence the results.

3. The third part of the document addresses the challenges and limitations of data analysis. It highlights the potential for bias, error, and misinterpretation, and discusses strategies to mitigate these risks. This section also emphasizes the need for transparency and documentation in the analysis process, as well as the importance of regular updates and revisions to the data and analysis as new information becomes available.

4. The fourth part of the document discusses the practical applications of the data analysis. It describes how the insights gained from the analysis can be used to inform decision-making, identify areas for improvement, and develop new strategies. This section also highlights the importance of communication and collaboration in the data analysis process, as well as the need for ongoing monitoring and evaluation of the results.

5. The fifth part of the document provides a summary of the key findings and conclusions of the study. It reiterates the importance of accurate record-keeping, the effectiveness of the analysis techniques, and the potential for data-driven decision-making. This section also offers recommendations for future research and practice, and emphasizes the need for continued learning and improvement in the field of data analysis.

6. The final part of the document includes a list of references and a list of figures. The references cite the various sources of information used in the study, and the figures provide a visual representation of the key data points and trends. This section also includes a list of appendices, which provide additional details and supporting information for the study.

Acknowledgments

This Handbook was prepared by the Building Research Council of the School of Architecture at the University of Illinois at Urbana/Champaign under contract to the Division of Program Monitoring and Research of the U.S. Department of Housing and Urban Development. Special thanks are extended to William E. Freeborne, the Government Technical Monitor for providing experience and counsel on the manufactured housing industry, for enthusiastic support of our contract proposals, for review and comments on drafts of the handbook, and for guidance and coordination for all meetings with the various housing organizations in Washington D.C.

Special thanks also goes to Smbat Hacopian, senior structural engineer of HUD's Manufactured Housing and Construction Standards Division for providing guidance and review of the draft handbook at various stages of its development, providing examples of foundations submitted by manufacturers for permanent foundation consideration, and providing insights on the Minimum Property Standards requirements that influenced the Handbook.

Special appreciation goes to Richard Mendlen, senior structural engineer at HUD for meticulously reviewing the Handbook drafts for correct phraseology, checking the charts and tables for numerical accuracy, and for spending many hours discussing current manufactured housing floor plans related to marriage wall openings.

Thanks also goes to individuals from other organizations for attending meetings and contributing suggestions for incorporation in the handbook:

Ashok Goswami	Housing and Building Technology, Division of NCSBCS
Paul Hancher	National Conference of States on Building Codes & Standards
Hushang Rais	National Conference of States on Building Codes & Standards
Mike Mafi	Housing and Building Technology, Division of NCSBCS
Richard Marshall	National Institute of Standards & Technology
Frank Walter	Manufactured Housing Institute
Michael Werner	Housing and Building Technology, Division of NCSBCS

1. The first part of the document discusses the importance of maintaining accurate records of all transactions. It emphasizes that proper record-keeping is essential for ensuring the integrity and reliability of financial data. This section also outlines the various methods and tools used to collect and analyze data, highlighting the need for consistency and precision in data entry and reporting.

2. The second part of the document focuses on the role of technology in modern data management. It explores how advanced software solutions and cloud-based platforms have revolutionized the way organizations store, access, and analyze their data. This section also addresses the challenges associated with data security and privacy, providing insights into best practices for protecting sensitive information.

3. The third part of the document discusses the importance of data quality and the impact of poor data on decision-making. It highlights the need for regular data audits and validation processes to ensure that the information used for analysis is accurate and up-to-date. This section also touches upon the role of data governance in maintaining high standards of data quality across the organization.

4. The fourth part of the document explores the concept of data-driven decision-making and its benefits for organizational performance. It provides examples of how data analysis can be used to identify trends, forecast future outcomes, and optimize business processes. This section also discusses the importance of clear communication and collaboration between data analysts and business leaders.

5. The final part of the document concludes by summarizing the key points discussed throughout the report. It reiterates the importance of a data-centric approach and the need for continuous improvement in data management practices. The document also provides a call to action for organizations to embrace data as a strategic asset and invest in the necessary resources and skills to maximize its value.

INTRODUCTORY COMMENTS

Preface

This Handbook is a guide for those approving manufactured homes on permanent foundations -- HUD Field Offices involved in the approval process and manufacturers and site owners who are seeking approval.

There are two acceptable methods for owners or developers to use in seeking HUD Approval: (1) Furnish foundation drawings and design calculations prepared and sealed by a licensed professional for foundation concepts shown in Appendix A and other foundation concepts not covered in the Handbook. The design criteria and requirements of Chapters 1-7 of the Handbook shall be followed in Method (1) and does not require the submittal of Appendix F (Appendix F instructions in paragraph 103 do not apply to Method 1.) Or (2) Furnish the Design Worksheet (Appendix F) prepared by a licensed professional in accordance with the Handbook. Method (2) does not require design calculations. Methods (1) & (2) both require submittals of Appendix E. See Table i - 1 on page ii.

The Foundation Concepts (Appendix A) are considered permanent foundations. Permanent foundations are those that have been engineered for safety and long-term satisfactory performance. These foundations were also designed specifically for use with manufactured homes. The Handbook contains construction recommendations that assure the home, the foundation and the site are all compatible. Because these recommendations are based on estimated conditions, it is important to have complete information for each manufactured home and its site.

Manufacturer-Supplied Information

Information about the home must be provided by the manufacturer. To simplify the approval process, the manufacturer may wish to prepare a Manufacturer's Worksheet for each standard foundation system. The Manufacturer's Worksheet is in Appendix E.

Owner-Supplied Information

Information about the building site must be provided by the owner. The size of the foundation, the depth of the footings, and the anchorage requirements depends on the building's site. This information should be submitted on the Owner's Site Acceptance Worksheet (Appendix E).

Handbook: Site Conditions

Chapters 2 and 3 of the Handbook contain recommendations for site preparation. They also point out unusual site conditions that may call for additional geotechnical engineering reports, such as sloping sites and problem soils. This documentation must also be submitted if problem sites are found.

Handbook: Foundation Design Concepts

Companies building manufactured homes have assisted in the preparation of this handbook by providing foundation design concepts appropriate for manufactured housing. This information was assembled and used as the basis for the Foundation Design Concepts in Appendix A.

The Handbook provides information about three basic foundation types and six alternative types. Appendix A shows which foundation designs can be used on sites with special requirements, such as windy sites.

Handbook: Design Verification

The Handbook's format is arranged for a licensed professional to progress through a se-

ries of logical steps designated to lead to approval. The HUD Field Office at their prerogative may review the Design Worksheet.

Technical assistance to determine acceptability of individual designs of permanent foundation systems should be obtained from a licensed professional engineer.

TITLE	Method (1)	Method (2)
Foundation Drawings (Prepared & Sealed by Licensed Professional)	Yes	No
Design Calculations (Prepared & Sealed by Licensed Professional)	Yes	No
Design Criteria Chapters 1-7	Yes	Yes
Appendix A - Foundation Concepts	Yes	Yes
Other Foundation Concepts	Yes	No
Appendix E (Owner's Site Acceptability & Manufacturer's Worksheets)	Yes	Yes
Appendix F Design Worksheet (Prepared & Sealed by Licensed Professional)	No	Yes

Table i - 1

TABLE OF CONTENTS

CHAPTER 1 - GENERAL INFORMATION

100. Application.....	1-1
101. Local Codes and Standards.....	1-4
102. Referenced Standards.....	1-4
103. General Procedure.....	1-5

CHAPTER 2 - SITE ACCEPTABILITY CRITERIA

200. General.....	2-1
201. Site Suitability.....	2-1
202. Soil Bearing Capacity.....	2-2
203. Problem Soil and Site Conditions.....	2-2

CHAPTER 3 - SITE PREPARATION

300. General.....	3-1
301. Drainage.....	3-1
302. Site - Grading.....	3-1
303. Fill.....	3-1
304. Finish Grade Elevation.....	3-1

CHAPTER 4 - DESIGN LOADS FOR PERMANENT FOUNDATIONS

400. General.....	4-1
401. Building Structure And Size.....	4-1
402. Design Loads.....	4-1

CHAPTER 5 - FOUNDATION REQUIREMENTS

500. General.....	5-1
501. Excavation.....	5-1
502. Foundation Materials.....	5-1
503. Structural Requirements.....	5-1

CHAPTER 6 - FOUNDATION DESIGN

600. Design Procedure.....	6-1
601. Verifying the Foundation Design Concept (Appendix A).....	6-4
602. Using the Foundation Design Tables (Appendix B).....	6-11
603. Using the Foundation Capacities Tables (Appendix C).....	6-25

CHAPTER 7 - FINAL CHECK

700. General.....	7-1
701. Final Approval.....	7-3

APPENDIX A - FOUNDATION DESIGN CONCEPT SELECTION

A-100. General/Concepts.....	A-1 to A-28
------------------------------	-------------

APPENDIX B - FOUNDATION DESIGN TABLES

B-100. USE OF THE FOUNDATION DESIGN TABLES.....	B-1
---	-----

Part 1 - Required Effective Footing Area (A_{ftg})

Single Section C.....	B-3 to B-6
Single Section E, I.....	B-7
Multi-section C.....	B-8 to B-16
Multi-Section C _{nw}	B-17 to B-20
Multi-Section E, I.....	B-21 to B-29
Multi-Section E5,E6.....	B-30 to B-38
Multi-Section E7.....	B-39 to B-47

Part 2 - Required Vertical Anchorage - (A_v)

Single-Section C.....	B-48
Single-Section C1.....	B-49
Single-Section E.....	B-50

Single-Section E3.....B-51
 Single-Section IB-52
 Multi-Section CB-53 to B-54
 Multi-Section E.....B-55 to B-56
 Multi-Section E3B-57
 Multi-Section I.....B-58 to B-59

Part 3 - Required Horizontal Anchorage -(Ah)
 Transverse Direction
 Single-Section C,E,I.....B-60 to B-64
 Multi-Section C,E,I.....B-65 to B-80

Part 4 - Required Horizontal Anchorage -(Ah)
 Longitudinal Direction
 Single-Section C,E,I.....B-81 to B-89
 Multi-Section C,E,I.....B-90 to B-100

APPENDIX C - FOUNDATION CAPACITY TABLES

C-100. USE OF FOUNDATION CAPACITIES TABLES C-1
 C-200. WITHDRAWAL RESISTANCE CAPACITY TABLES..... C-1
 C-300. VERTICAL ANCHOR CAPACITY TABLES..... C-2
 C-400. HORIZONTAL ANCHOR CAPACITY TABLES FOR SHORT AND LONG FOUNDATION WALLS C-3

APPENDIX D - DERIVATION OF FOUNDATION DESIGN

D-100. CONDITIONS AFFECTING DESIGND-1

D-200 LOAD CONDITIONS INCLUDED IN FOUNDATION DESIGN D-3
 D-300 SAMPLE EQUATIONS USED FOR FOUNDATION DESIGN LOAD TABLE VALUES..... D-15

APPENDIX E - OWNER'S SITE ACCEPTABILITY AND MANUFACTURER'S WORKSHEETS.....E-1 to E-5

APPENDIX F - DESIGN WORKSHEET.....F-1 to F-22

APPENDIX G - SAMPLE PROBLEMS

Example #1- Multi-Section
 Type E1 (Marriage wall with Openings)
G-1 to G-6

Example #2-Single Section
 Type C1- Vertical X-Bracing.....G-6 to G-13
 Filled in work sheets for both examples follow

APPENDIX H - MAPS

H-100. GENERAL..... H-1
 H-200. SEISMIC PERFORMANCE CATEGORIES..... H-1
 H-300. SPECIAL SEISMIC DESIGN CONSIDERATIONS FOR FOUNDATIONS H-1

APPENDIX I -REFERENCES.....I-1
 ADDITIONAL RESOURCES.....I-2 to I-3

LIST OF TABLES

Table i-1	Approval Methods.....ii		
Table 4-1	Range of Dead Loads Covered by This Guide.....4-1		
Table A-1	Foundation Selection TableA-2,A-3		
Tables B -Appendix B			
Part 1 - Required Effective Footing Area (Aftg)			
	Single Section CB-3 to B-6		
	Single Section E, IB-7		
	Multi-section CB-8 to B-16		
	Multi-Section CnwB-17 to B-20		
	Multi-Section E, IB-21 to B-29		
	Multi-Section E5, E6B-30 to B-38		
	Multi-Section E7..... B-39 to B-47		
Part 2 - Required Vertical Anchorage - (Av)			
	Single-Section CB-48		
	Single-Section C1B-49		
	Single-Section EB-50		
	Single-Section E3.....B-51		
	Single-Section IB-52		
	Multi-Section CB-53 to B-54		
	Multi-Section E.....B-55 to B-56		
	Multi-Section E3.....B-57		
	Multi-Section I.....B-58 to B-59		
Part 3 - Required Horizontal Anchorage -(Ah)			
	Transverse Direction		
	Single-Section C,E,I.....B-60 to B-64		
	Multi-Section C,E,IB-65 to B-80		
Part 4 - Required Horizontal Anchorage -(Ah)			
	Longitudinal Direction		
	Single-Section C,E,I.....B-81 to B-89		
	Multi-Section C,E,IB-90 to B-100		
Table C-1	Withdrawal Resistance - Long Continuous Founda- tionC-5		
Table C-2	Withdrawal Resistance For Piers.....C-6		
Table C-3	Vertical Anchor Capacity For Piers.....C-6		
Table C-4A	Vertical Anchor Capacity For Long Foundation Wall - Concrete or Ma- sonry Wall.....C-7		
Table C-4B	Vertical Anchor Capacity For Long Foundation Wall - Treated Wood Wall.....C-8		
Table C-5A	Horizontal Anchor Ca- pacity For Short or Long Shear Walls - Concrete or MasonryC-9		
Table C-5B	Horizontal Anchor Ca- pacity For Short or Long Shear Walls - Treated Wood.....C-9		
Table D-1	Dead Load on Foundation..... D-5		
Table D-2	Seismic Forces - Ground Snow < 30 psf D-16		
Table D-3	Seismic Forces - Ground Snow 100 psf D-17		
Table H-1	Seismic Performance Category for Hazard Ex- posure Group I H-17		

LIST OF FIGURES

Figure 1-1	Longitudinal and Transverse.....	1-3	Figure D-5	Interior (GCpi) Coefficients	D-9
Figure 5-1	Minimum Clearances and Footing Depth.....	5-2	Figure D-6	Roof Plane - Wind Components - Transverse Direction	D-10
Figure 6-1	Unit Width Description	6-3	Figure D-7	Seismic Dead Load Distribution.....	D-11
Figure 6-2	Definition of Terms and Possible Support Locations	6-4	Figure D-8A	Gravity Loads - Type C Single-Section Units	D-15
Figure 6-3	Overturning and Uplift Resistance Options	6-5	Figure D-8B	Gravity Loads - Type E and I Single-Section Units.....	D-19
Figure 6-4	Sliding Resistance Options - Transverse Direction.....	6-9	Figure D-9A	Gravity Loads - Type C Multi-Section Units w/Cont. Marriage Walls.....	D-20
Figure 6-5	Sliding Resistance - Combination Option - Transverse Direction	6-10	Figure D-9B	Gravity Loads - Type C Multi-Section Units w/Openings in Marriage Wall.....	D-22
Figure 6-6	Sliding Resistance Options - Longitudinal Direction.....	6-10	Figure D-9C	Marriage Wall w/Large Single Opening	D-23
Figure 6-7	Foundation Design Concepts: Single-Section Units	6-11	Figure D-9D	Marriage Wall w/Two Adjacent Openings.....	D-24
Figure 6-8	Foundation Design Concepts: Multi-Section Units	6-12	Figure D-9E	Gravity Loads-Type E and I Multi-Section Units w/Cont. Marriage Wall	D-26
Figure 6-9	Foundation Terms.....	6-13	Figure D-9F	Gravity Loads - Type Cnw Multi-Section Units w/Cont. Marriage Wall	D-29
Figure 6-10	Horizontal Anchorage with X-bracing - Transverse Direction.....	6-20	Figure D-9G	Gravity Loads - Type E5 Multi-Section Units w/Cont. Marriage Wall	D-30
Figure 6-11	Horizontal Anchorage with X-bracing - Longitudinal Direction.....	6-24	Figure D-9H	Gravity Loads - Type E7 Multi-Section Unit w/Cont. Marriage Wall	D-32
Figure B-1	Anchorage Locations.....	B-1	Figure D-9I	Type E5, E6, E7 - Marriage Walls w/Two Adjacent Openings.....	D-36
Figure D-1	Marriage Wall Connection Options	D-2			
Figure D-2	Dead Load Components and Total.....	D-4			
Figure D-3	Snow Load Distribution	D-6			
Figure D-4	Exterior (Cp) Coefficients	D-8			

Figure D-10	Wind Related Overturning Loads - Transverse Direction - Type C and C1 Single-Section Units.....	D-39	Figure D-19	Wind Related Sliding - Transverse Direction - Type C, E or I Single-Section Units.....	D-56
Figure D-11A	Wind Related Overturning Loads - Transverse Direction - Type E Single-Section Unit.....	D-40	Figure D-20	Foundation Shear Wall Planes - Sliding - Transverse Direction.....	D-59
Figure D-11B	Wind Related Overturning Loads - Transverse Direction - Type E3, E4 Single Section Units.....	D-42	Figure D-21	Wind Related Sliding - Transverse Direction Type C, E or I Multi-Section Units.....	D-60
Figure D-12	Wind Related Overturning Loads - Transverse Direction - Type I Single-Section Unit.....	D-43	Figure D-22	Seismic Related Sliding - Transverse Direction - Type C, E or I Single-Section Units.....	D-61
Figure D-13	Wind Related Overturning Loads: Type C - Multi-Section Unit - Transverse Direction.....	D-45	Figure D-23	Seismic Related Sliding - Transverse Direction Type C, E or I Multi-Section Units.....	D-63
Figure D-14	Wind Related Overturning Loads: Type E - Multi-Section Unit - Transverse Direction.....	D-48	Figure D-24	Wind Related Sliding - Longitudinal Direction.....	D-64
Figure D-15	Wind Related Overturning Loads: Type I - Multi-Section Unit - Transverse Direction.....	D-50	Figure D-25	Type E or I - Foundation Shear Wall Plans - Wind Related Sliding - Longitudinal Direction.....	D-65
Figure D-16	Seismic Related Overturning Loads - Transverse Direction - Type C and C1 Single-Section Units.....	D-52	Figure D-26	Type C - Foundation Vertical X-Bracing - Wind Related Sliding - Longitudinal Direction.....	D-66
Figure D-17	Seismic Related Overturning Loads - Transverse Direction - Type E Single-Section Unit.....	D-53	Figure D-27	End Elevation Areas - Wind - Longitudinal Direction.....	D-68
Figure D-18	Seismic Related Overturning Loads - Transverse Direction - Type I Single-Section Unit.....	D-53	Figure D-28	Seismic Related Sliding - Longitudinal Direction.....	D-69
			Figure H-1	Flood Prone Sites.....	H-3
			Figure H-2	Frost Penetration Depth.....	H-4
			Figure H-3	Expansive Soils.....	H-5
			Figure H-4	Landslide Areas.....	H-6
			Figure H-5	Landslide Areas.....	H-7
			Figure H-6	Areas Prone to Subsidence - Mining.....	H-8

Figure H-7	Areas Prone to Subsidence - Caves.....	H-9
Figure H-8	Termite Infestation	H-10
Figure H-9	Ground Snow Load - West U.S.....	H-11
Figure H-10	Ground Snow Load - Central U.S.	H-12

Figure H-11	Ground Snow Load - Eastern U.S.	H-13
Figure H-12	Basic Wind Speed	H-14
Figure H-13	Seismic Contour Map for Coefficient A_a	H-15
Figure H-14	Seismic Contour Map for Coefficient A_v	H-16

LIST OF ACRONYMS

ANSI	American National Standards Institute	MHCSS ...	Manufactured Home Construction and Safety Standards
APA.....	American Plywood Association	MPS	Minimum Property Standards
ASCE	American Society of Civil Engineers	NBSIR	National Bureau of Standards Institute for Research
ASTM	American Society of Testing Materials	NCSBCS..	National Conference of States on Building Codes and Standards, Inc.
BOCA	Building Officials and Code Administrators International	NEHRP	National Earthquake Hazard Reduction Program
CABO	Council of American Building Officials	NIST	National Institute of Standards and Technology
ELF	Equivalent Lateral Force	SBCCI	Southern Building Code Congress International
FEMA	Federal Emergency Management Agency		
HUD	U.S. Department of Housing and Urban Development		
ICBO	International Conference of Building Officials		

CHAPTER 1 - GENERAL INFORMATION

100. APPLICATION

100-1. GENERAL. Manufactured homes, as addressed by this handbook, are manufactured in accordance with 24 CFR Chapter XX, Part 3280, *Manufactured Home Construction and Safety Standards* (MHCSS), and are sited on a permanent foundation in accordance with *Handbook 4145.1, REV-2, Change 1, Feb. 14, 1992*, Architectural Processing and Inspections for Home Mortgage Insurance, paragraph 3-4.

A. Description of Manufactured Unit. Designs and approval for foundations in this manual are based on the following assumptions about the manufactured home:

1. Transportable in one or more sections.
2. Between 11'-4" and 16'-0" in width in transport mode.
3. Minimum 400 sf. in area for a single section unit.
4. Exterior wall height of 7'-6" or 8'-0" from top of wall to foundation.
5. Built on permanent chassis with minimum distance between main chassis beams of:

Mfg. Home Width	Beam Spacing
12' nom.	6'-3"
14' nom.	6'-10"
16' nom.	8'-0"

Note: Smaller beam spacing will require design by a professional engineer.

6. Chassis beams 10" deep for 12' and 14' nominal unit widths, and 12" deep for 16' nominal unit width.
7. Roof slope varies from a minimum 1/2:12 to a maximum 4.4:12 (20°).
8. Set on permanent foundation of piers, or of continuous, cast-in-place concrete, concrete-block masonry, all-weather wood, or other approved systems.
9. Double width units are assumed connected to behave structurally as a single box.

B. Chassis Removal. The chassis of a manufactured home, under the *Federal Manufactured Housing and Construction Safety Standards*, is not permitted to be removed. Accordingly, foundations in this manual are designed for manufactured homes that **DO NOT HAVE THEIR CHASSIS REMOVED.**

C. Definition of Permanent Foundation. Permanent foundations must be constructed of durable materials; i.e. concrete, mortared masonry, or treated wood - and be site-built. It shall have attachment points to anchor and stabilize the manufactured home to transfer all loads, herein defined, to the underlying soil or rock. The permanent foundations shall be structurally developed in accordance with this document or be structurally designed by a licensed professional engineer for the following:

1. Vertical stability:

- a. Rated anchorage capacity to prevent uplift and overturning due to wind or seismic forces, whichever controls. Screw-in soil anchors are not considered a permanent anchorage.
 - b. Footing size to prevent overloading the soil-bearing capacity and avoids soil settlement. Footing shall be reinforced concrete to be considered permanent.
 - c. Base of footing below maximum frost-penetration depth.
 - d. Encloses a basement of crawl space with a continuous wall (whether bearing or non-bearing) that separates the basement of crawl space from the backfill, and keeps out vermin and water.
2. Lateral stability. Rated anchorage capacity to prevent sliding due to wind or seismic forces, whichever controls, in the transverse and longitudinal directions.

100-2. DEFINITIONS. These are terms used throughout the Handbook and the Design Worksheet. Additional terms are used in Appendix D, where the derivation of equations is shown. These terms are defined in Appendix D, and illustrated in Figure 6-2.

Anchorage: Connection between superstructure and foundation, by means of welds, bolts, and various light gage metal plates. Anchorage does not refer to any type of soil anchor.

Chassis: The structural system running beneath the manufactured home. Example: Pair of steel beams.

Exterior Foundation Wall: Foundation walls placed directly below the exterior perimeter walls of the unit. These walls may, or may not, be structurally used as bearing walls under gravity loads, and/or used as shear walls under horizontal loads. If these walls are not used structurally they are called non-bearing walls or skirt walls.

Exterior Piers: Piers inside the exterior walls, needed to support the chassis beams nearest the longitudinal foundation walls.

Foundation Types:

Type C: Foundation system supported and anchored at chassis only, to equally spaced piers.

Type E: Foundation system supported at chassis and exterior wall but anchored for uplift and overturning at exterior wall only.

Type I: Foundation system supported at chassis and exterior wall but anchored for uplift and overturning at exterior piers only.

Interior Piers: Piers nearest the marriage wall and supporting the chassis in multi-section units.

Longitudinal Foundation Walls: Two walls beneath the long dimension of the unit (in its transport mode) which are structurally used as foundation shear walls that resist applied wind or seismic forces from the superstructure's shear walls in the longitudinal direction.

Longitudinal Direction: Direction of horizontal wind or seismic forces applied parallel to long dimension of unit. See Figure 1-1.

Marriage Wall: The wall where two single-section units are structurally joined to form a multi-section unit. The marriage wall may contain openings that permit interior spaces to expand to two units wide.

Marriage Wall Piers: Piers placed beneath a continuous marriage wall in multi-section homes are assumed to be equally spaced. Piers are also placed at the ends of openings, beneath the posts that transfer concentrated loads from the roof.

Superstructure Shear walls: Vertical elements (usually walls) of the superstructure's lateral load resistance system. These vertical elements structurally transfer horizontal wind or seismic forces, applied to the roof and floor planes of the unit, to the foundation system.

Transverse Foundation Walls: Walls across the short dimension of the unit which are structurally designed to function as foundation shear walls that resist horizontal applied wind or seismic forces from the superstructure's shear walls in the transverse direction.

Transverse Direction: Direction of horizontal wind or seismic forces applied perpendicular to long dimension of unit. See Figure 1-1.

Aa: The seismic coefficient representing the effective peak acceleration as determined by the seismic map 1.

Av: The seismic coefficient representing the effective peak velocity-related acceleration as determined by the seismic map 2.

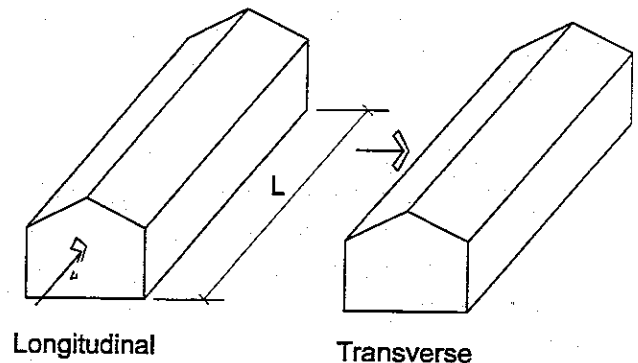


Figure 1 - 1

Av: Vertical anchorage force requirement for the unit; (Pier load in lbs. or wall load in lbs./LF). Example; Anchorage force to prevent uplift and overturning in the transverse direction of applied wind or seismic forces.

Ah: Horizontal anchorage force requirement (lbs./ft.). Example; Anchorage force to keep unit from sliding in the transverse and longitudinal directions of applied wind or seismic forces.

Aftg: Foundation footing size for the isolated unit pier spread footing area (sq. ft.) & continuous wall footing width (ft.).

hn: The height of the manufactured unit exterior wall.

hp: The depth at which a pier footing must be placed to prevent it from pulling out of the soil (ft.).

hw: The depth at which a continuous foundation wall must be placed to prevent it from pulling out of the soil (ft.).

L: Length of manufactured home (ft.).

W: Actual self (dead load) weight of the unit (lbs.).

w: The distributed weight of the unit (lbs./ft). $W/L = w$; therefore weight per foot of length.

Wt: Actual measured width of the unit (ft.) between superstructure walls, excluding roof projections. A single-section unit has one width measurement (*Wt*). A double-section unit is composed of 2 single-section widths ($2Wt$).

100-3. LICENSED PROFESSIONALS.

Those using this handbook are referred to using licensed professionals when design considerations require additional information or when a particular site, foundation system, or superstructure (manufactured home) falls outside the design assumptions and parameters of the handbook. As used herein, the term Geotechnical Engineer is a professional engineer registered under the appropriate laws of the State to practice in the field of Geotechnical Engineering. The term Structural Engineer is a professional or structural engineer registered under the appropriate laws of the State to practice in the field of Structural Engineering. And the term Architect is a professional architect registered under the appropriate laws of the State to practice Architecture.

101. LOCAL CODES AND STANDARDS

101-1. NEW CONSTRUCTION. This handbook has been developed for use at all new permanent manufactured home sites, communities, and set-ups.

101-2. EXISTING CONSTRUCTION. The practices recommended in the Handbook are not intended to be applied retroactively to existing sites unless the authority in the jurisdiction considers such application essential for safety

and health of occupants. Upgrade of existing anchorages and footings shall meet the intent of the definition of permanent foundation stated herein.

101-3. RESPONSIBILITY. This handbook does not relieve the installer of responsibility for compliance with local ordinances, codes, and regulations established by authorities having jurisdiction.

101-4. OTHER FOUNDATION DESIGNS.

Manufacturers of home designs not covered by this handbook or recommending a foundation system not included in this handbook shall submit drawings and structural calculations prepared and sealed by a licensed professional to the owner.

102. REFERENCED STANDARDS

102-1. CODES GOVERNING SUBSURFACE INVESTIGATION

A. HUD *Minimum Property Standards for Housing 1994 Ed. Handbook 4910.1*; Final Rule-24 CFR Part 200.926 contain provisions that apply to permanent foundation installations recommended in this handbook.

B. Engineering Report. If adverse site conditions are discovered, specific recommendations by a Geotechnical Engineer shall be included with the Design Worksheet (Appendix F).

102-2. CODES GOVERNING BUILDINGS AND SITES

A. Seismic, Wind and Snow Loads for each type of structure were computed based on ASCE 7-93: *Minimum Design Loads for Buildings and Other Structures*. Minimum wind and minimum roof live load were based

Buildings and Other Structures. Minimum wind and minimum roof live load were based on *MPS HUD Document 4910.1, Appendix K, art. 200.926e (a) & (c).*

B. Grading, Drainage and Fill. The HUD *Land-Planning Data Sheets (79g)*, Handbooks 4140.3 and 4145.1, should be used for grading, drainage and fill specifications.

C. Manufactured Homes on Elevated Foundations should follow standards in *Manufactured Home Installation in Flood Hazard Areas, FEMA 85/September 1985.*

D. Additions to CABO One and Two Family Dwelling Code, 1992 Ed. (including 1993 Amendments) that apply to construction in this manual are found in CABO, Appendix C -- Section C-101, C-102, C-201, C-301, C-302, C-303, C-304, C-305, C-306, C-307, C-401, C-501, C-502, C-503, C-504, C-505, C-506, C-507, C-600, C-601, C-602, C-603, C-604, C-605.

E. Rural Housing Service (RHS) Formerly Rural Housing and Community Development Service, formerly Farmers Home Administration (FmHA). Provisions for the approval of direct loans for manufactured homes on permanent foundations are contained in Subpart A of Part 1944: Section 502 Rural Housing Loan Policies and Authorizations and for guaranteed loans in Subpart D of Part 1980: Rural Housing Loans. The provisions for acceptable site development, installation and set-up are contained in Subpart A of Part 1924

Exhibit J: Manufactured Home Sites, Rental Projects and Subdivisions. These Agency instructions are available in any RHS field office.

F. Superstructure HUD Code - Federal Manufactured Home Construction and Safety Standards Oct. 25, 1994. The structural design of the superstructure of the manufactured home has been assumed to be in conformance with HUD Code Section 3280.305 and .306 (a)(2) which anticipates the manufactured unit to make provision for the support and anchoring system forces required by this document.

103. GENERAL PROCEDURE

103-1. SUBMISSIONS. Three worksheets must be filled out before evaluation of the foundation system can begin, the "Owner's Site Acceptability Worksheet and Manufacturer's Worksheet" in Appendix E, and the "Design Worksheet" in Appendix F. Refer to Table i - 1 in the Introductory Comments, which indicates requirements and submissions.

103-2. BEGINNING THE APPROVAL PROCESS. If the worksheets in Appendices E and F have been filled out, the approval process can begin. See Chapter 2, "Site Acceptability Criteria" and the Design Worksheet, Appendix F. Persons using the handbook should fill out the Design Worksheets while progressing through the chapters in the Handbook. Questions on the Design Worksheet are tied to sections of the Handbook and the section numbers are noted on the Worksheet.

CHAPTER 2 - SITE ACCEPTABILITY CRITERIA

200. GENERAL. Before approval of the site can begin, preliminary information about the site must be provided. Information to be provided appears in Appendix E.

201. SITE SUITABILITY. Site conditions can determine whether a given foundation design will be suitable for the manufactured home. Problem soils, flood-prone building sites, sloping sites, and ground-water level can affect decisions about foundation design. An investigation of the problem site by a qualified geotechnical engineer is recommended to assure that site conditions will not adversely affect foundation performance.

201-1. EXISTING GRADE ELEVATION(S) must be provided using a level and known benchmarks if any of the following are true:

A. The elevation is to be altered by grading or fill; or

B. The site is near a flood zone (e.g. lakes, rivers, streams, or coastal areas); or

C. The site is or will be incorporated in subdivisions and communities.

201-2. FLOOD-PRONE SITES. Building sites near lakes, rivers, streams and oceans are likely flood-prone areas. Information about whether the site is flood-prone should be obtained from FEMA Flood Maps. Determine whether the building site is in a flood zone. Refer also to the map showing distribution of great floods in the United States, page H-3.

A. Sites in Flood Zones. If the building site is within a flood zone, the finish grade of the building site must be located above the 100-year return frequency flood elevation, and in accordance with *HUD Handbooks 4135.1 REV.2* and *4145.1*.

B. Elevated Homes within flood zones can be built on specially-designed elevated foundations.

1. Refer to *Manufactured Home Installation in Flood-Hazard Areas*, FEMA-85 / Sept. 1985.

2. Homes built on elevated foundations must comply with requirements of the National Flood Insurance Program to qualify for flood insurance. (N.F.I.P.)

201-3. FROST PENETRATION DEPTH. Verify the frost penetration depth with local building code department. Refer to the Maximum Annual Frost Penetration map on page H-4. The base of the foundation footing must be below the maximum frost penetration depth. Foundations in permafrost must be designed by an engineer registered in Alaska.

201-4. GROUND WATER TABLE ELEVATION. Water table elevations vary from season to season and/or by locations. Building structures, streets, paved areas, and utilities shall be located or engineered to minimize the adverse effects of a high water table.

A. Subdivisions. A subsurface investigation by a Geotechnical Engineer is required to determine water table elevation.

1. Developed portions of a site which can be adversely affected by a potentially high ground water table shall be drained where possible (based on recommendations by Geotechnical Engineer) by subsurface drainage facilities adequate for the disposal of excess ground water or by provision of surface drainage and surface ponds.
2. A Geotechnical Engineering Report shall be submitted in subdivision applications.

B. Exceptions. For individually-sited homes, the water table elevation may be based on local records if available; otherwise, determine by subsurface investigation.

202. SOIL BEARING CAPACITY

202-1. GENERAL. Soil conditions typically vary with depth. Subsurface investigations to a minimum recommended depth below the footing depth by a Geotechnical Engineer, using appropriate laboratory tests, are recommended to identify soil type and bearing capacity.

202-2. REQUIRED SUBSURFACE INVESTIGATION. For subdivisions and communities, a subsurface investigation is required.

A. Preliminary Design. Other sources may be consulted for presumptive bearing pressures for preliminary design purposes.

1. Allowable bearing pressures based on national model codes:
 - a. BOCA - Basic National Building Code
 - b. SBCC - Standard Building Code

c. ICBO - Uniform Building Code

d. CABO - One and Two Family Dwelling Code

2. Local authority having jurisdiction
3. Soil Conservation District
4. United States Geological Survey
5. Soil Conservation Service of the U.S. Dept. of Agriculture
6. Highway Department
7. Utility Company Records

B. Exceptions. For individually-sited homes, the bearing capacity may be determined based on local building codes, unless the site is located in an area of known or suspected adverse soil conditions (as defined in Section 203), then a subsurface investigation may be required.

203. PROBLEM SOIL AND SITE CONDITIONS

203-1. ORGANIC SOILS

A. Soil Identification. If any of the following soil types is identified at the proposed site by a Geotechnical Engineer (or soil conservation maps), removal of the problem soil type and replacement with an engineered fill is permitted if submitted and approved by a Geotechnical Engineer.

1. *Loess.* Deposits of windblown organic silts. Susceptible to moisture and frost action and excessive settlement.

2. *Peat*. River or water deposits of organic matter and silts, susceptible to excessive settlement.
3. *Topsoil*. Top organic layer of soil, susceptible to excessive settlement.
4. *Others* (As defined by Geotechnical Engineer). Refer to overview map of expansive soils, Appendix F.

203-2. UNSTABLE CLAYS have potential for large movements:

A. Conditions Causing Instability:

1. Expansive characteristics
2. Highly plastic characteristics
3. High compressibility
4. Other conditions as noted by Geotechnical Engineer.

B. Foundations for Unstable Clays. The presence of unstable clays indicates that special foundation treatment as recommended by a Geotechnical Engineer be included in the approval plan.

203-3. SLOPING SITES

A. General. There is the potential for slope instability and soil movement if the following conditions occur:

1. Loading on the slope by fill, home, or foundation.
2. Removal of lateral supports by construction.

3. Inherent characteristics of soil material and slope geometry.
4. Changes in the water content of the soil.
5. Refer to overview map of landslide problems on pages H-6 and H-7, and National Academy of Sciences Report *Reducing Losses from Landsliding in the United States*.

B. Local Records. Refer to local Geotechnical records and ordinances for guidance.

C. Identification. Subsurface investigation by a Geotechnical Engineer is recommended for sloping sites. This is the primary method of determining slope instability.

203-4. SUBSIDENCE

A. General. Subsidence refers to the potential for lowering or collapse of the land surface. Its causes are:

1. Dissolving of soluble materials below the surface to form cavities.
2. Underground mining.
3. Withdrawal of gas, oil, and water from subterranean cavities
4. Other causes as noted by Geotechnical Engineer.

B. Identification. Areas where subsidence occurs can be identified by local geological records or by subsurface investigation by a Geotechnical Engineer. Refer to the maps showing cave locations and coal field locations on pages H-8 and H-9, NBSIR 81-2215 *Construction of Housing in Mine Subsidence Ar-*

1. The first part of the document discusses the importance of maintaining accurate records of all transactions. This is essential for ensuring the integrity of the financial statements and for providing a clear audit trail.

2. The second part of the document outlines the various methods used to collect and analyze data. These methods include interviews, surveys, and focus groups, each of which has its own strengths and limitations.

3. The third part of the document describes the process of identifying and defining the research objectives. This involves a thorough review of the literature and a clear statement of the research goals.

4. The fourth part of the document discusses the importance of selecting a representative sample. This is crucial for ensuring that the results of the study are generalizable to the population of interest.

5. The fifth part of the document describes the process of data collection and management. This involves the use of standardized forms and the implementation of a robust data management system.

6. The sixth part of the document discusses the importance of data analysis. This involves the use of statistical techniques to identify patterns and trends in the data.

7. The seventh part of the document describes the process of interpreting the results of the study. This involves a careful comparison of the findings with the research objectives and the existing literature.

8. The eighth part of the document discusses the importance of reporting the results of the study. This involves the preparation of a clear and concise report that summarizes the findings and their implications.

9. The ninth part of the document describes the process of disseminating the results of the study. This involves the publication of the findings in a peer-reviewed journal or the presentation of the results at a conference.

10. The tenth part of the document discusses the importance of evaluating the study. This involves a critical assessment of the strengths and weaknesses of the research and the identification of areas for future research.

11. The eleventh part of the document describes the process of maintaining the integrity of the research. This involves the implementation of strict ethical guidelines and the use of secure data storage methods.

12. The twelfth part of the document discusses the importance of transparency in the research process. This involves the publication of the research protocol and the raw data used in the study.

13. The thirteenth part of the document describes the process of ensuring the reliability of the research. This involves the use of standardized procedures and the implementation of a robust quality control system.

14. The fourteenth part of the document discusses the importance of collaboration in the research process. This involves the involvement of a multidisciplinary team of researchers and the sharing of resources and expertise.

15. The fifteenth part of the document describes the process of ensuring the validity of the research. This involves the use of a variety of data sources and the implementation of a robust validation process.

16. The sixteenth part of the document discusses the importance of communication in the research process. This involves the use of clear and concise language and the implementation of a robust communication plan.

17. The seventeenth part of the document describes the process of ensuring the ethical integrity of the research. This involves the implementation of a robust ethical review process and the use of secure data storage methods.

18. The eighteenth part of the document discusses the importance of documentation in the research process. This involves the use of a clear and concise reporting format and the implementation of a robust documentation system.

19. The nineteenth part of the document describes the process of ensuring the accuracy of the research. This involves the use of standardized procedures and the implementation of a robust quality control system.

20. The twentieth part of the document discusses the importance of transparency in the research process. This involves the publication of the research protocol and the raw data used in the study.

21. The twenty-first part of the document describes the process of ensuring the reliability of the research. This involves the use of standardized procedures and the implementation of a robust quality control system.

22. The twenty-second part of the document discusses the importance of collaboration in the research process. This involves the involvement of a multidisciplinary team of researchers and the sharing of resources and expertise.

23. The twenty-third part of the document describes the process of ensuring the validity of the research. This involves the use of a variety of data sources and the implementation of a robust validation process.

24. The twenty-fourth part of the document discusses the importance of communication in the research process. This involves the use of clear and concise language and the implementation of a robust communication plan.

25. The twenty-fifth part of the document describes the process of ensuring the ethical integrity of the research. This involves the implementation of a robust ethical review process and the use of secure data storage methods.

26. The twenty-sixth part of the document discusses the importance of documentation in the research process. This involves the use of a clear and concise reporting format and the implementation of a robust documentation system.

27. The twenty-seventh part of the document describes the process of ensuring the accuracy of the research. This involves the use of standardized procedures and the implementation of a robust quality control system.

28. The twenty-eighth part of the document discusses the importance of transparency in the research process. This involves the publication of the research protocol and the raw data used in the study.

29. The twenty-ninth part of the document describes the process of ensuring the reliability of the research. This involves the use of standardized procedures and the implementation of a robust quality control system.

30. The thirtieth part of the document discusses the importance of collaboration in the research process. This involves the involvement of a multidisciplinary team of researchers and the sharing of resources and expertise.

eas, and National Academy of Sciences Report *Mitigating Losses from Land Subsidence in the United States*.

C. Stipulations. Construction on the site should be determined by a Geotechnical Engineer.

203-5. TERMITE HAZARD. Refer to the map on page H-10 for locations and intensity of termite infestation. Wood selection and treatment, and wood members in close proximity to the ground shall be in accordance with *CABO One & Two Family Dwelling Code* (all provisions listed in section R-309) or with local ordinances.

CHAPTER 3 - SITE PREPARATION

300. GENERAL. Site preparation must conform to referenced standards in Chapter 1.

301. DRAINAGE

301-1. RAIN DIVERSION. Provide the best available routing of run-off water to assure that buildings or other important facilities will not be endangered by the path of a major emergency flood run-off which would occur if the site storm drainage system is exceeded.

301-2. SITE-PLAN. Arrange structures on sites to retain natural drainage patterns (*MPS HUD Document 4910.1, Chapter 3*).

301-3. ROOF DRAINAGE. Control roof drainage by use of gutters and downspouts. Route away from foundation walls.

302. SITE-GRADING

302-1. GENERAL. Site-grading plan must be approved by HUD, according to the *Land Planning Data Sheet 79g* and *HUD Handbook 4145.1* (Appendix 8). Site grading and drainage must be performed to provide diversion of surface water away from the foundation and off the site, to prevent standing water. Design the new slope to tie in with natural grading.

302-2. RECOMMENDED TESTS. Obtain soil analysis, bearing tests, or special foundation design where soil stability is questionable.

303. FILL

303-1. GENERAL. Bearing for footings or foundations on engineered fill is permitted where determined acceptable by HUD Field Office and Geotechnical Engineer.

303-2. FILL SPECIFICATIONS. Fill must be engineered fill, (to 90% compaction, Modified Proctor Test, ASTM D1557) free of organic material such as weeds, or grasses, or other organic matter.

303-3. ENGINEERED FILL. Engineered fill shall have a minimum load bearing capacity as recommended by a Geotechnical Engineer. Use *HUD Land Planning Data Sheet 79g* for preparation requirements.

304. FINISH GRADE ELEVATION. The finish grade must be in accordance with *HUD Handbook 4145.1*, paragraph 3-4.A.6).

CHAPTER 4 - DESIGN LOADS FOR PERMANENT FOUNDATIONS

400. GENERAL. Design and construction must insure that the load bearing portion of the home's foundation will remain stable and maintain its capacity to transmit all imposed loads to the ground.

400-1. FOUNDATION DESIGNER. The foundation designer must be aware of the structural limitations of the home to accommodate differential foundation movement. This is especially important with differential soil settlement or movement of problem soils.

400-2. REFERENCED STANDARDS. All structural design shall be based on generally accepted engineering practice. All loads shall be in accordance with ASCE 7-93, except as shown otherwise in this manual. Local codes must be reviewed for requirements that may be more stringent than ASCE 7-93.

400-3. DESIGN STANDARDS. Foundation design criteria is based on foundation criteria for conventional housing as defined in the *Minimum Property Standards*, and is not based on the *Manufactured Home Construction and Safety Standards* (Part 3280). Foundation De-

sign Load Tables, Appendix B, were developed based on average ASCE *Minimum Design Dead Loads*. See Table 4-1 below. (See Derivation of Foundation Design Load Tables, Appendix D.)

401. BUILDING STRUCTURE AND SIZE. Information must be provided by the manufacturer to assist in determining the suitability of a manufactured home for a particular site and foundation system. The inspector shall do a preliminary check to verify that all information has been prepared by the manufacturer. (The Manufacturer's Worksheet can be found in Appendix E, page E-3.)

402. DESIGN LOADS

402-1. DEAD LOADS

A. Computation of Forces. Two design dead load values are used in this guide. The values are based on typical materials used in construction of homes.

1. The lightest combination of loads is used for computation of horizontal

Range of Dead Loads Covered by This Guide						
(Average pounds per lineal foot (plf) of home length \pm 5%)						
Nominal unit width:	12 feet		14 feet		16 feet	
Dead load:	light	heavy	light	heavy	light	heavy
Single-Section Type C, E, I	260	380	290	425	320	470
Multi-Section	500	715	560	805	615	895
<i>Note:</i> Refer to the "Manufacturer's Worksheet" Appendix E for unit type.						

Table 4 - 1

and vertical anchorage forces for wind related overturning and sliding stability.

2. The heaviest combination of loads is used for computation of: (1) footing bearing area and (2) equivalent lateral inertia forces applied at roof and floor levels for seismic related overturning and sliding stability.

B. Dead Load Values. The design light and heavy dead load values are shown in Table 4-1 for manufactured home type and nominal unit width.

C. Distributed Weight Calculation. The manufacturer shall provide the total weight (W) and the length (L) of the manufactured housing unit, including mechanical equipment. These values are used to convert the weight (W) into the distributed value of pounds per lineal foot (w). Use the following formula to make this conversion:

$$w = \frac{W}{L}$$

Where: L = length of home (Mfr. Wksht. #3)
W = total weight (Mfr. Wksht. #8)

D. Distributed Weight Comparison. The distributed home weight (w) shall be compared with the average calculated values in Table 4-1.

1. If the manufacturer's distributed value (w) is less than the light load or greater than the heavy load, the structural engineer will be required to design the foundation system and anchoring system. Proceed no further until an approved system, cer-

tified by a licensed structural engineer, has been provided. **DO NOT USE THE TABLES.** The tables are based on estimated conditions. Once outside those limits, the results will not be valid.

2. If the manufacturer's value falls within the light and heavy load limits ($\pm 5\%$), **USE THE TABLES IN THIS MANUAL** and proceed with the verification process.

E. Other Dead Loads. Manufactured home partitions and other known loads caused by special installations such as stationary equipment, i.e. water heater, furnace, etc., shall be included to arrive at applicable dead loads.

402-2. SNOW LOAD

A. General. Ground snow loads are based on values from ASCE 7-93. The Ground Snow Load map on pages H-11, H-12, H-13, shall be used to determine a ground snow load value (Pg) for the manufactured home location. For areas where ground snow load values are not shown, consult local weather data or governing code authority. Ground snow loads (Pg) are converted to roof design snow loads (Ps) by multiplication on $0.7 \times Pg$. See Appendix D for derivation. The tables in Appendix B use Pg values from the map. Roof snow loads are assumed to be horizontally projected over the roof area.

B. Heavy Snow Loads. If the ground snow load value (Pg) exceeds 100 psf, consult a licensed structural engineer for footing design.

C. Minimum Roof Live Load. Roofs shall be designed for a minimum horizontally

projected live load in accordance with *MPS HUD Document 4910.1, Appendix K, art.200.926e*. The load magnitude is related to roof slope as follows: greater than 3 in 12: 15 psf; less than or equal to 3 in 12: 20 psf. The larger magnitude, between the design roof snow load and the minimum roof live load, shall be used for design. Note that a 20 psf ground snow load (P_g) corresponds closely to a 15 psf minimum roof live load (i.e. $0.7 \times 20 = 14$ psf rounded to 15 psf) and a 30 psf ground snow load corresponds closely to a 20 psf minimum roof live load (i.e. $0.7 \times 30 = 21$ psf rounded to 20 psf in the Foundation Design Load Tables).

402-3. WIND LOAD

A. General. Wind loads must be based on values from ASCE 7-93. The Basic wind speed map on page H-14 must be used to determine the basic wind speed (v) for the manufactured home location. Refer to Appendix D for factors influencing wind load. Map values below 80 mph shall conform to the minimum wind speed of 80 mph in accordance with *MPS HUD Document 4910.1, Appendix K, art. 200.926e*.

NOTE: Tornadoes have not been considered in the development of the basic wind speed map, and resistance to such conditions is not included in this manual.

B. Coastal or Inland Sites. Coastal regions include any locations within 100 miles of the Atlantic Ocean or Gulf of Mexico hurricane coastlines. All other locations are to be considered Inland regions. Exposure Category C has been assumed regardless of Coastal or Inland location in accordance with *MPS HUD Document 4910.1, Appendix K, art. 200.926e*.

C. Severe Wind and Design Pressures. In hurricane zones, or where severe wind pressures occur, foundations and anchoring for manufactured homes will require special treatment.

1. Foundations may be required to resist greater uplift and overturning than values shown in this manual.
2. Heavier, more deeply buried foundations may be required than values shown in the tables. It may be necessary to provide additional foundation shear walls and/or specially designed cantilever piers.
3. Home-to-foundation connections must be strengthened.
4. Refer to *Mobile Home Anchoring Systems and Related Construction and An Engineering Analysis: Mobile Homes in Windstorms*, Institute for Disaster Research in Lubbock, Texas.

D. Design Verification. The field office must verify the existence of engineered drawings showing connection and anchorage details. The connection details shall be engineered to resist wind speeds at the building site.

E. High Wind Design. For high wind areas, foundation designs must be those that are suited to both high wind and other site conditions, such as seismic or soil conditions.

402-4. SEISMIC LOADS

A. General. Seismic design loads and requirements are based on criteria and values from ASCE 7-93, which are taken from the *NEHRP Recommended Provisions for the De-*

velopment of *Seismic Regulations for New Buildings* (NEHRP 1991). The two seismic maps on pages H-15 and H-16 shall be used to determine the seismic values A_a and A_v for the manufactured home location (county). Seismic values of A_a and A_v that equal or exceed 0.3 shall conform to the special requirements of seismic performance category C and D (cited on page H-17) as they apply to foundation design and detailing. When A_v values from the map on page H-16 are less than 0.15, the seismic provisions of ASCE 7-93 need not be considered, and anchorage design is then based on wind considerations alone. In seismic areas where A_v and/or $A_a \geq 0.3$, foundations must be designed by a professional engineer licensed in the applicable state.

B. Design Verification. The design concept proposed in question 10 of the "Manufacturer's Worksheet", found in Appendix E, should be compared with information in the Foundation Design Concept Tables (Appendix A) to determine whether the foundation is potentially suitable for location in a seismic zone.

C. Characteristic Differences between Wind and Seismic Loading.

1. Wind loads subject the exterior building envelope to pressures and suctions on each wall or roof surface. Thus, exposed surface area is important. Seismic loads are generated by the ground's acceleration being transferred to the foundation, according to the site soil characteristics (S) and then the building's structural system characteristics (R). This modified acceleration excites the building mass, which generates the inertia forces ($F = m \times a$) at each

level (i.e. floor and roof). Thus, the entire building participates in the creation of seismic force, while only the exterior envelope participates in wind load generation.

2. Wind loading is usually long duration with short duration gusting that usually creates slow stress reversals, while seismic events are of short duration, creating accelerations that generate rapid oscillations in all directions with sudden stress reversals.
3. The slow structural response from wind loading permits frictional resistance from gravity loads to be considered for sliding resistance between superstructure and foundation. The simultaneous horizontal and vertical acceleration during a seismic event, generally negates the frictional resistance from gravity loads. Thus, friction is ignored as a potential resistance between superstructure and foundation for seismic loading. Even when wind loads exceed seismic loads, positive connections between superstructure and foundation are required for areas with A_v equal to or greater than 0.15.

D. Seismic / Wind Force Comparisons.

Overtuning and sliding anchorage forces found in the Foundation Design Load Tables of Appendix B are based on the largest lateral forces from a consideration of wind and equivalent lateral seismic inertia forces. The results were as follows:

1. Wind controls for single or multi-section units subjected to (1) overturning from lateral forces in the transverse direction (perpendicular to long dimension of unit) and (2) uplift forces in the vertical direction. Both conditions require vertical anchorage.
2. Wind or seismic may control for single or multi-section units subjected to sliding in the transverse and/or longitudinal direction. Values in the tables of Part 3 and 4 of Appendix B are grayed if seismic controls.

1. The first part of the document discusses the importance of maintaining accurate records of all transactions. It emphasizes that proper record-keeping is essential for ensuring the integrity and reliability of financial data.

2. The second part of the document outlines the various methods used to collect and analyze data. It describes the process of gathering information from different sources and how it is then processed to identify trends and patterns.

3. The third part of the document focuses on the challenges associated with data collection and analysis. It highlights the need for consistent data entry and the importance of verifying the accuracy of the information collected.

4. The fourth part of the document discusses the role of technology in data management. It explores how modern software solutions can streamline the data collection process and improve the efficiency of data analysis.

5. The fifth part of the document provides a summary of the key findings and conclusions. It reiterates the importance of maintaining high standards of data accuracy and the benefits of using advanced data management tools.

6. The sixth part of the document offers recommendations for future research and improvements. It suggests areas where further investigation is needed to enhance the overall quality and reliability of the data collection process.

7. The seventh part of the document discusses the implications of the findings for various stakeholders. It explains how the results of the study can be used to inform decision-making and improve organizational performance.

8. The eighth part of the document provides a detailed look at the data collection process. It includes a step-by-step guide to ensure that all necessary information is captured and recorded accurately.

9. The ninth part of the document discusses the importance of data security and privacy. It outlines the measures that should be taken to protect sensitive information and ensure compliance with relevant regulations.

10. The tenth part of the document provides a final summary and conclusion. It emphasizes the value of the data collected and the importance of continuing to refine and improve the data collection process over time.

CHAPTER 5 - FOUNDATION REQUIREMENTS

500. GENERAL. This section outlines general material and quality standards for all foundations in this manual.

501. EXCAVATION

501-1. FOOTING DEPTH. Excavation for footings or foundation walls shall extend below depth of soil subjected to seasonal or characteristic volume change to undisturbed soil that provides adequate bearing. Select the greatest depth required by any of the provisions below, reference Figure 5-1.

A. Maximum Frost Penetration Depth. The bottom of footings shall extend at least to the depth indicated on the map on page H-4.

B. Alternate Seasonal Wetting and Drying. This is especially important with expansive soils. If expansive soils exist, consult a geotechnical engineer to obtain required footing depth.

C. Footing Depth. The footings shall be deep enough to provide required uplift capacity. (This value may need to be determined for high wind areas after the calculations needed to determine footing bearing have been completed.)

502. FOUNDATION MATERIALS.

Footings and foundations shall be constructed of solid materials such as masonry, concrete, or treated wood, based on the Foundation Design Concept Selection (Appendix A) and Foundation Capacity Tables. (Appendix C) (For masonry and concrete refer to CABO R-302.2, R-304.1 and R-304.3; for wood refer to CABO R-302.1 and R-304.5.)

503. STRUCTURAL REQUIREMENTS

503-1. FOUNDATION REQUIREMENTS.

All exterior walls, marriage walls, marriage wall posts, columns and piers, must be supported on an acceptable foundation system that must be of sufficient design to support safely the loads imposed, as determined from the character of the soil.

A. Height Above Grade. Foundation walls shall extend at least 8" above the finished grade adjacent to the foundation at all points. See Figure 5-1.

B. Minimum Foundation Wall and Wall Footing Thickness. For masonry or concrete construction, the minimum foundation wall will be 6 inches. The minimum reinforced concrete footing thickness will be 6 inches or 1-1/2 times the length of the footing projection from the foundation wall, whichever is greater.

503-2. PIER AND COLUMN FOOTING REQUIREMENTS.

Footings for pier foundations shall be reinforced concrete and should be placed level on firm undisturbed soil of adequate bearing capacity and below the frost penetration depth. They can also be placed on engineered, compacted fill, approved by a licensed geotechnical engineer.

A. Unusual Conditions. Where unusual conditions exist, the spacing of piers and pier size and the load bearing capacity of the soil shall be determined specifically for such conditions.

B. Minimum Pier and Pier Footing Thickness. The minimum thickness for a pier is 8 inches. The minimum thickness for pier footings is 8 inches or 1-1/2 times the length of the footing projection from the pier, whichever is greater.

503-3. FOOTING REINFORCING (HORIZONTAL). Reinforce footings when the projection on each side of the wall, pier, or column exceeds 2/3 of the footing thickness, or when required because of soil conditions.

503-4. MASONRY PIERS AND WALLS. All masonry piers and walls shall have mortared bed and head joints. Reinforcing and grouting shall be in accordance with the foundation concept selected from Appendix A and designed in Appendix C.

503-5. CRAWL SPACE REQUIREMENTS (Basementless spaces)


A. Height Requirement. Ground level must be at least 18 inches below bottom of wood floor joists and 12 inches below bottom of chassis beam. Where it is necessary to provide access for maintenance and repair of me-

chanical equipment located in the under floor space, the ground level in the affected area shall not be less than 2 feet below wood floor joists. (Refer to CABO, Section R-309.) See Figure 5-1.

B. Interior vs. Exterior Ground Level. The interior ground level must be above the outside finish grade unless:

1. Adequate gravity drainage to a positive out fall is provided, or
2. The permeability of the soil and the location of the water table is such that water will not collect in the crawl space, or
3. Drain tile and automatic sump pump system are provided.

C. Openings. Locations of crawl space openings and ventilation openings should be on long foundation walls. Avoid any openings on short foundation walls. Sill plates or other structural members should not be randomly cut to accommodate openings. Continuity of struc-

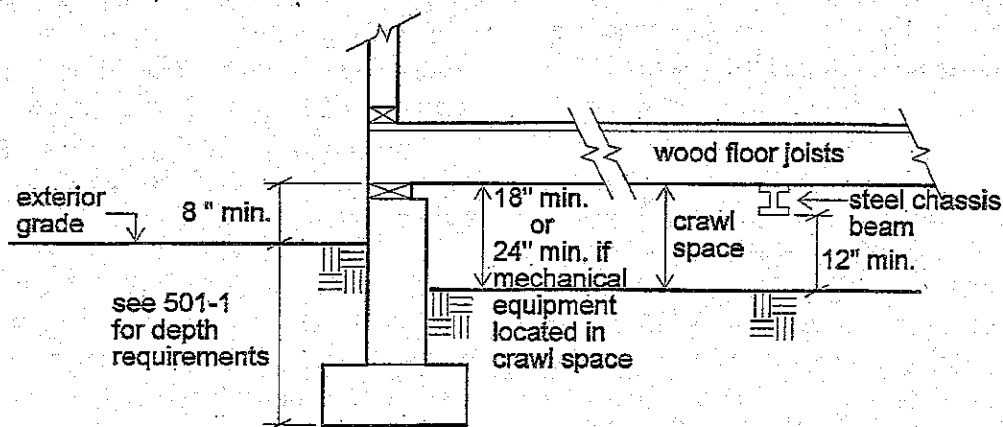

Minimum Clearances and Footing Depth

Figure 5-1

tural members must be maintained.

503-6. FOUNDATION WALLS FOR BASEMENTS. The design and reinforcing of basement walls is **NOT** in the scope of this document. Refer to local codes and ordinances for guidance. Refer also to CABO, Section R-304: "Foundation Walls." Design the unit's foundation based on soil conditions present at the site.

503-7. BACK FILL. Material used for back fill must be clean and free of wood scraps or

other deleterious substances and must be placed carefully against walls.

503-8. STEEL BEAMS AND COLUMNS. The analysis and design of steel transverse girders, steel longitudinal girders potentially used under marriage walls to reduce the number of steel pipe columns within a basement, and the steel pipe columns themselves are **NOT** within the scope of this document for system Types **E5, E6 and E7**

1. The first part of the document discusses the importance of maintaining accurate records of all transactions. This is essential for ensuring the integrity of the financial statements and for providing a clear audit trail. The records should be kept up-to-date and should be easily accessible to all relevant personnel.

2. The second part of the document outlines the procedures for the monthly financial review. This involves a thorough examination of the accounts and a comparison of the actual results with the budgeted figures. Any variances should be identified and explained, and appropriate corrective actions should be taken.

3. The third part of the document describes the process of preparing the quarterly financial statements. This includes the consolidation of the data from all departments and the preparation of the income statement, balance sheet, and cash flow statement. The statements should be reviewed and approved by the appropriate authorities before being issued to the shareholders.

4. The fourth part of the document discusses the importance of maintaining accurate records of all transactions. This is essential for ensuring the integrity of the financial statements and for providing a clear audit trail. The records should be kept up-to-date and should be easily accessible to all relevant personnel.

5. The fifth part of the document outlines the procedures for the monthly financial review. This involves a thorough examination of the accounts and a comparison of the actual results with the budgeted figures. Any variances should be identified and explained, and appropriate corrective actions should be taken.

6. The sixth part of the document describes the process of preparing the quarterly financial statements. This includes the consolidation of the data from all departments and the preparation of the income statement, balance sheet, and cash flow statement. The statements should be reviewed and approved by the appropriate authorities before being issued to the shareholders.

CHAPTER 6 - FOUNDATION DESIGN

600. DESIGN PROCEDURE. In this chapter information about the building site and the building structure are combined and used to determine the size of footings, reinforcing for the foundation, and the size and spacing of anchorage used to tie the unit to the foundation.

600-1. GENERAL

A. Foundation Appendices. The foundation design information in Appendices A, B, & C may be used to design new foundation systems or to verify the design of proposed or existing systems. Appendix A, Foundation Design Concepts, shows design concepts suitable for a variety of manufactured home types and site conditions. Appendix B, Foundation Design Load Tables, provides design requirements for anchorage of the manufactured home to the foundation and recommended footing sizes. Appendix C, Foundation Capacities Tables, provides design capacities for foundation uplift and withdrawal, based on the foundation type chosen (wood, concrete masonry or cast-in-place concrete).

B. Design Verification Sequence. The three Appendices (A, B, & C) are intended to be used in sequence.

1. Appendix A, Foundation Design Concepts, is used to identify acceptable foundation designs based on the manufactured home type and the site conditions.
2. Appendix B, Foundation Design Load Tables, is used to determine the required footing sizes and the required vertical and horizontal an-

chorage forces to be transferred to the foundation.

3. The required anchorage values are used in Appendix C, Foundation Capacities Tables, to determine the materials, dimensions, and construction details of the foundation.

C. Design Criteria and Design Loads. The design criteria and loads are needed for the Foundation Design Load Tables (Appendix B).

1. Width of Unit. The measured width of the manufactured home, converted to a nominal width is needed.
2. Height of Unit. The unit is assumed 8'-0" tall from bottom of floor framing to eave at roof. Ceilings may be horizontal (flat) or cathedral sloped.
3. Design Loads. The design ground snow load, wind speed, seismic ground acceleration and seismic performance category are needed. Refer to Appendix H to determine the design load values.

D. Effective Footing Area (Aftg). The footings for the permanent foundation must be sized to prevent sinking or settlement of the manufactured home. Footing area is given the abbreviation (Aftg). The values for (Aftg) are given in square feet (sf) for pier footings and feet (ft) for wall footing width. Refer to Appendix D for the derivation of equations for the determination of effective footing areas.

E. Vertical Anchorage (Av). The manufactured home must be securely anchored to the foundation. One critical anchorage requirement is for the structure to resist uplift and overturning from wind activity in the transverse direction. This is vertical anchorage and it can be achieved at the chassis beams or along longitudinal wall locations, or both locations. It is given the abbreviation (Av), and the (Av) values are all given in pounds (lbs. per pier or lbs. per foot of foundation wall). Refer to Appendix D for the derivation of the equations for determination of required vertical anchorage force.

F. Horizontal Anchorage (Ah). Another critical anchorage requirement is for the manufactured home to resist horizontal sliding forces in both the transverse and longitudinal directions. Horizontal forces are a result of wind or seismic activity. Horizontal anchorage is given the abbreviation (Ah). The transverse or longitudinal direction relates to the direction of force application and to the orientation of the resistance elements, such as the transverse vertical X-bracing planes or the longitudinal walls of the unit respectively (see Figure 1-1). The values for (Ah) are given in pounds per foot (lbs./ft.). Refer to Appendix D for the derivation of equations for determination of required horizontal anchorage force.

G. Loads Included and Load Combinations. All applicable gravity loads (dead, occupancy and snow or minimum roof live) and all lateral loads (wind or seismic) have been considered in the development of the Foundation Design Load Tables of Appendix B. Chapter 4 gives a brief description of each load and Appendix D derives the equations upon which the magnitude of these loads is determined for any geographic location and unit Type. Appropriate load combinations have

been selected from ASCE 7-93 for allowable stress design as follows:

1. The load combination used for The Foundation Design Footing Tables (Appendix B, Part 1) is:

DL (heavy) + LL (occupancy) +
LL (attic) + SL (or min. roof LL).

2. The load combination used for The Foundation Design: Anchorage Tables (Appendix B, Part 2,3,4) is:

(Wind or Seismic*) ± DL (light)

- * Heavy DL was used to calculate the roof and floor inertia forces only.


600-2 DETERMINATION OF BUILDING WIDTH

A. Building Width for Use of Appendix B Tables. The actual measured building width must be converted into the nominal building width for use in the Foundation Design Footing Tables and Anchorage Tables. The nominal building width should be calculated as follows:

1. To obtain the nominal building width for use in the Foundation Design: use the following information:

<u>Actual Building Width</u>	<u>Nominal Width</u>
11'-4" to 12'-0"	12'
13'-4" to 14'-0"	14'
15'-4" to 16'-0"	16'

2. The tables are based upon the width of each section as it is transported. A multi-section superstructure classified as a nominal 14-foot width

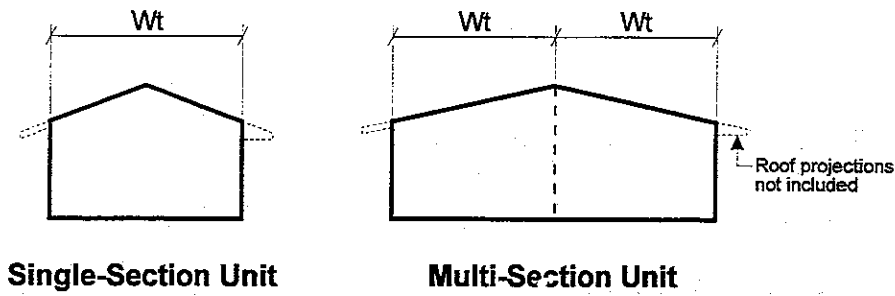

Unit Width Description

Figure 6 - 1

classified as a nominal 14-foot width could be 26'-8" to 28'-0" in actual width.

3. The nominal width to be used in the Foundation Design Load Tables should be recorded.

B. Width Illustration. If there is a question about which dimension is actually the width of the structure, see Figure 6-1. The width of the home is shown as W_t (nominal 12', 14', or 16').

600-3. DETERMINATION OF DESIGN GROUND SNOW LOAD. Verify the geographic location where the unit will be sited. Refer to the ground snow load map on pages H-11, H-12 and H-13, and read the pound per square foot (psf) isobar for the intended site. Note that a mandatory minimum roof live load may be greater than the roof snow load. Refer to section 402-2.A and C for further clarification.

600-4. DETERMINATION OF DESIGN WIND SPEED. Verify the geographic location where the unit will be sited. Refer to the wind speed map on page H-14 and read the MPH wind speed isobar for the intended site. Note that a minimum wind speed of 80 MPH is

required by the *Minimum Property Standards*, even if the map isobar shows a smaller MPH value. Establish if the site is Inland or Coastal (section 402-3.B).

600-5. DETERMINATION OF DESIGN SEISMIC FACTORS.

A. Determine Design Seismic Ground Acceleration Values.

1. Verify the geographic location where the unit will be sited.
2. Refer to the two Ground Acceleration Contour Maps on pages H-15 and H-16 and read (A_a) from map 1 and (A_v) from map 2 for the isobar closest to the site.
3. The manufactured home is exempt from seismic requirements if the map value for (A_v) is less than 0.15; therefore, wind becomes the only lateral load design issue. If (A_v) is equal to or greater than 0.15 seismic provisions must be met (Section 402-4).

B. Determine the Required Seismic Performance Category.

1. A seismic hazard exposure group of (I) is assumed for single family residences.
2. The seismic value (A_v) and the Seismic Hazard Exposure Group (I) are used to assign the manufactured home to a Seismic Performance Category. Refer to the Seismic Performance Category Table on page H-17, enter the Table with these two values and record either (C) or (D) as applicable. Note that if (C) is the correct Category, it is required to comply with the requirements for Category (A) and (B) as well as (C). If Category (D) is the correct Category, then the requirements for Category (A) through (D) must be met. These requirements, as they pertain to permanent foundations for manufactured housing are listed in Section H-300 as a reference. The Foundation Concepts illustrated in Appendix A can meet the intent


of the foundation requirements of Section 9.7 of ASCE 7-93 for Seismic Performance Categories (A) through (D).

3. The manufacturer shall verify that the unit provides continuous load paths with adequate strength and stiffness to transfer all forces from the point of application to the point of resistance at the foundation. The design and detailing of the unit shall comply with Section 9.3.6 of ASCE 7-93 for the Seismic Performance Category assigned in step 2 above.

601. VERIFYING THE FOUNDATION DESIGN CONCEPT (APPENDIX A)

601-1. LOCATION OF FOUNDATION SUPPORTS

A. Definition of Support. Support is herein defined as the location where the gravity loads (dead, occupancy, snow, minimum roof live load) within and applied to the unit are

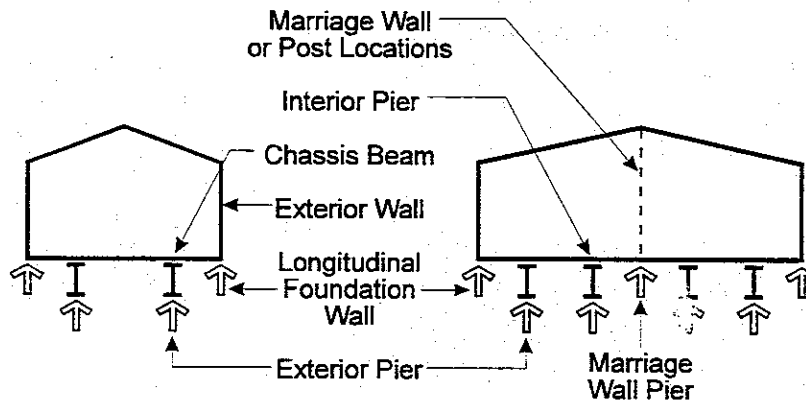

Definition of Terms and Possible Support Locations

Figure 6 - 2

transferred to the foundation system.

B. Illustration of Support Locations.

The acceptable locations where foundation piers and walls support the unit are illustrated in Figure 6-2. Terms that appear throughout Appendices A, B and C are also defined. Some or all of the illustrated locations may be used, but symmetry of the support system must be maintained. Note that marriage walls may be continuous walls, or contain specifically located openings with posts at the ends of each opening.


C. Determine the Location of Foundation Supports.

Single-section or multi-section units are supported by equally spaced piers along their chassis beams, by exterior longitudinal walls or both. Multi-section units may possibly have additional equally spaced pier supports along a continuous marriage wall, and have piers placed according to post locations at the ends of specific marriage wall openings.

Select one of the following unit support options:

Type C: Piers are equally spaced along the chassis beams for single-section units. Additional piers may exist below continuous marriage walls and under posts at the ends of openings within the marriage wall, that exist for multi-section units. If no support exists below the marriage wall the unit is defined as a **Type Cnw**, and no openings can be permitted in the marriage wall. It must be a continuous wall, supported by the floor and chassis beam system.

Type E or I: A combination of longitudinal exterior walls and equally spaced piers under the chassis beams are used for single-

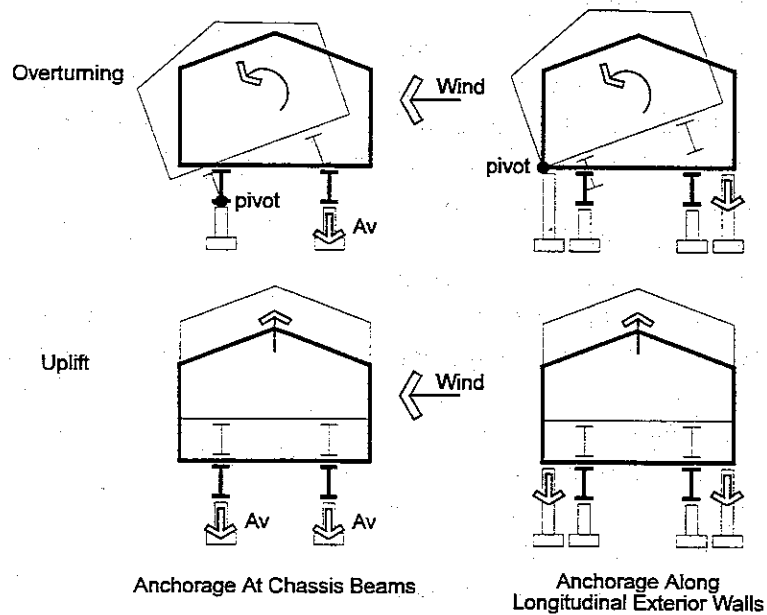

Overturning and Uplift Resistance Options

Figure 6 - 3

section or multi-section units. The same discussion regarding continuous marriage walls and marriage walls with openings within them, as found under Type C, applies to Type E and I.

601-2 LOCATION OF VERTICAL ANCHORAGE (Av) IN THE TRANSVERSE DIRECTION.

A. Definition of Vertical Anchorage.

Vertical anchorage exists in the transverse direction when a mechanical connection is made between the manufactured home unit and the foundation to resist wind related overturning and uplift forces. Overturning is the tendency for the unit to rotate about a pivot point either at the bearing point between chassis beam and support pier, or the bearing between the unit and the longitudinal exterior wall. This rotation lifts the unit off its other bearing points; therefore, requiring vertical anchorage (tie-down) to resist the force. Uplift of the unit occurs as wind passes over the roof surface, tending to lift the unit. Vertical anchorage resists this force. See Figure 6-3 for illustration of both of these effects in the transverse direction. Analysis for both effects in the transverse direction indicates that overturning forces are greater than uplift forces. Thus, Appendix B, Part 2 Vertical Anchorage Tables are based on overturning behavior with the knowledge that uplift forces will also be handled. Locations for this mechanical connection exist either along the chassis beams and/or along the exterior longitudinal walls. Vertical anchorage and gravity support may exist at the same locations, but other combinations of support and anchorage may exist. Connection types include anchor bolts, welds, or a broad range of framing

anchors and fasteners common to the wood industry. A unit that merely sits on its foundation, does not constitute vertical anchorage of the unit. A physical connection of adequate capacity is required for vertical anchorage to exist.

B. Determine Locations of Vertical Anchorage (Av). The character of the foundation support Type selected in section 601-1.C must be reviewed for vertical anchorage capability. The manufactured home unit may be anchored by any of the methods described in section 601-2.A. Select one of the following vertical anchorage options:

- Type C:** Vertical anchorage is along the chassis beams only, and occurs at the equally spaced support piers for single-section units. Multi-section units may utilize the exterior chassis beams (2 ties) or all the chassis beams (4 ties) for vertical anchorage to the support piers.
- Type C1:** Vertical anchorage is typically provided by external straps which wrap over the top and down the sides of the unit. Short vertical ties, which attach directly to the home's exterior wall structure, are a possible alternate. These straps or ties attach to concrete "dead man" footings set at the appropriate depth below grade. The straps or ties are generally spaced to match support pier locations; however, variations are possible. These anchorage types are limited to single-section units. It is required that the first external straps or ties be a minimum of 2 feet in from each end of the unit with the remainder equally spaced.

Type E: Vertical anchorage is only along the exterior longitudinal walls for single-section units. Multi-section units may vertically anchor to exterior longitudinal walls (2 ties) or vertically anchor to exterior longitudinal walls and interior chassis beams at the equally spaced piers (4 ties).

Type I: Vertical anchorage is along the chassis beams only, and occurs at the equally spaced support piers for single-section units. Type I vertical anchorage differs from Type C vertical anchorage only in its pivot point location for overturning. Multi-section units may utilize the exterior chassis beams (2 ties) or all of the chassis beams (4 ties) for vertical anchorage at the equally spaced support piers.

601-3. LOCATION OF HORIZONTAL ANCHORAGE (Ah)

A. Definition of Horizontal Anchorage.

Horizontal anchorage exists when a mechanical connection is made between the manufactured home unit and the foundation to resist sliding due to wind or seismic lateral forces. Sliding can occur in the transverse direction or the longitudinal direction, and both directions must independently be checked. Sliding involves horizontal movement in the transverse or longitudinal direction of the unit, and if the wind or seismic event is of large enough magnitude, these horizontal forces can result in the unit sliding off its foundation. Anchorage between unit and foundation to avoid this situation is accomplished in one of two ways: (1) utilizing bolts, welds or other acceptable means to connect the unit to foundation walls that are made

of concrete masonry, treated wood or concrete, or (2) utilizing vertical X-bracing planes of galvanized rod or wire diagonal ties or straps between the top side of the steel chassis beams diagonally down to the top of the concrete footings.

B. Determine Locations of Horizontal Anchorage (Ah). Horizontal sliding must be resisted both in the transverse and longitudinal directions. Options for each direction are as follows:

1. Transverse Direction: Anchorage location options include 2, 4, or 6 transverse walls (shear walls) or a select number of vertical planes of X-bracing (trussing) with galvanized rods, wires or straps. Figure 6-4 illustrates these individual options for a single-section unit and Figure 6-5 illustrates one combination of these options, also for a single-section unit. Selection of transverse horizontal anchorage location option is not influenced by the selection of Type C, E or I unit for support or vertical anchorage in the transverse direction as done in sections 601-1 and 601-2.
2. Longitudinal Direction: Anchorage location options include either the two exterior longitudinal walls (for single or multi-section units) or the chassis beam lines (2 for single-section units, or 4 for multi-section units), where vertical planes of X-bracing with galvanized rods, wires or straps are possible. Illustration of the two choices is shown in Figure 6-6 for a single-section unit. Selection of longitudinal horizontal

anchorage location option is not influenced by the selection of Type C, E or I unit for support or vertical anchorage in the transverse direction as done in sections 601-1 and 601-2.

601-4. FOUNDATION CONCEPT SELECTION. Whether designing a new permanent foundation or upgrading an existing foundation to a permanent foundation, confirmation of a foundation concept from Appendix A is required. The permanent foundation type is a function of the support option selected in section 601-1.C and the vertical anchorage option selected in section 601-2.B. Note: The horizontal anchorage option is independent of these two issues and does not influence selection of foundation type.

A. Three Basic Foundation Types. A summary of the structural characteristics required for each type of permanent foundation system follows:



Type C: Support and vertical anchorage occurs at equally spaced points along the Chassis beam lines only. This is true for single-section or multi-section units.

Type E: Support occurs at the Exterior longitudinal foundation walls as well as at equally spaced points along the chassis beam lines. Vertical anchorage occurs continuously along the exterior longitudinal foundation walls for single-section or multi-section units (2 ties), or a combination of vertical anchorage can occur continuously along the exterior longitudinal foundation walls and along the equally spaced

pier locations along interior chassis beams (4 ties).

Type I: Support occurs at the exterior longitudinal foundation walls as well as at equally spaced piers along the chassis beam lines, just as for Type E, for single-section or multi-section units. Vertical anchorage occurs at the equally spaced piers along the chassis beam lines only for single-section or multi-section units (2 ties or 4 ties).

B. Illustration of Foundation Types and Concepts. Single-section foundation types and detailing concepts are illustrated in Figure 6-7 and Appendix A. Multi-section foundation types and detailing concepts are illustrated in Figure 6-8 and Appendix A. The meaning of the arrow orientation in both Figures is as follows:





Symbols:  vertical anchorage (uplift and overturning)
 support (gravity)

Type C: concepts C2 to C4

Type E: concepts E1 and E8 (E2 omitted in this revision)


Type I: included here as possible future design concepts. None were currently submitted by manufacturers.

C. Determine Foundation Concept. Based on the foundation type selected, choose one of the several concept options below:

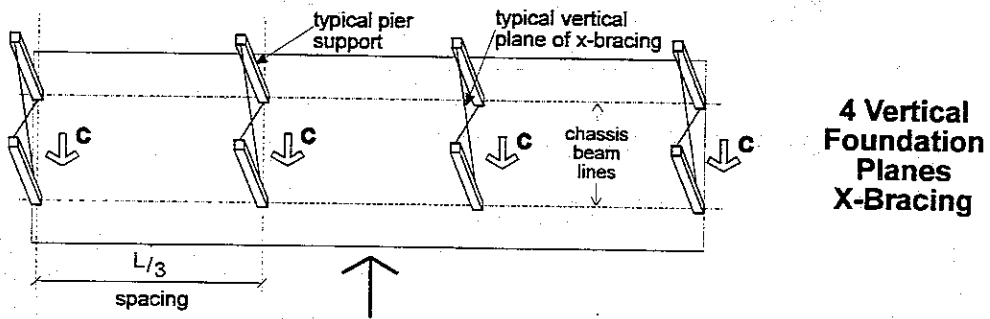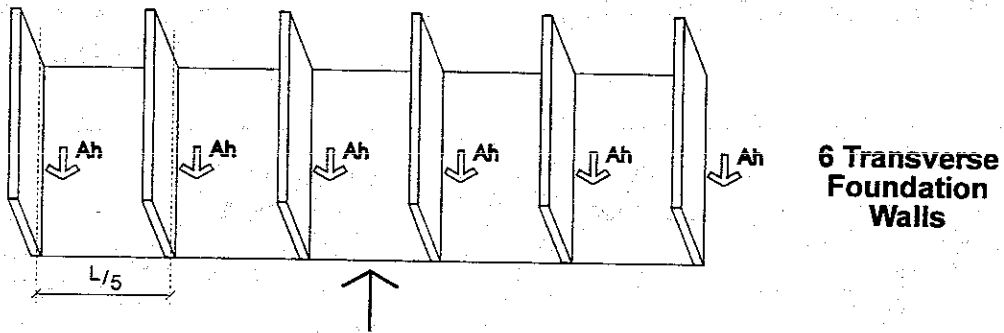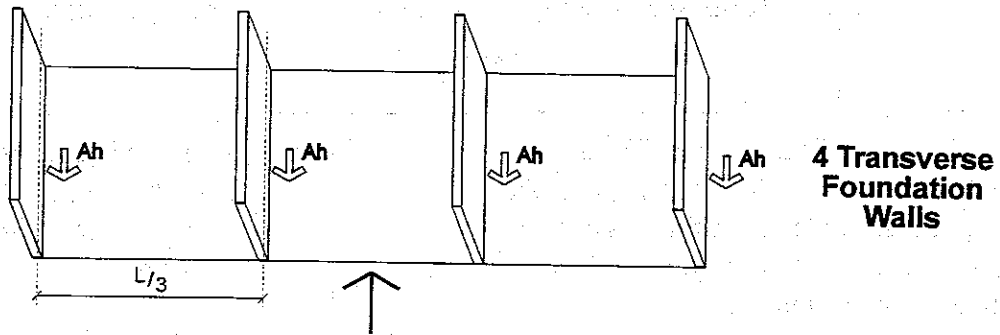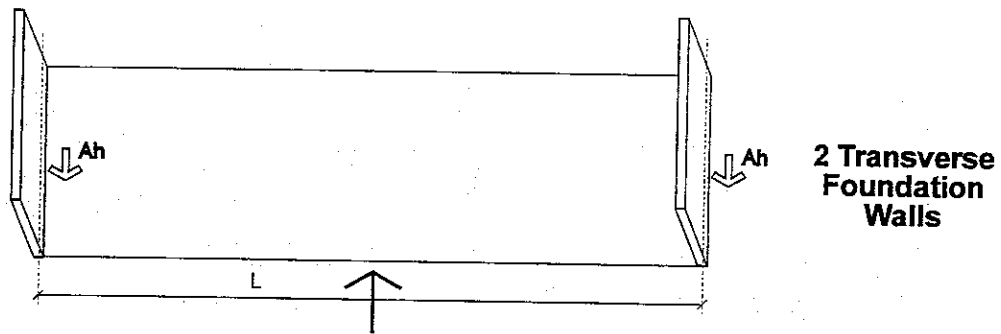

Sliding Resistance Options - Transverse Direction

Figure 6 - 4

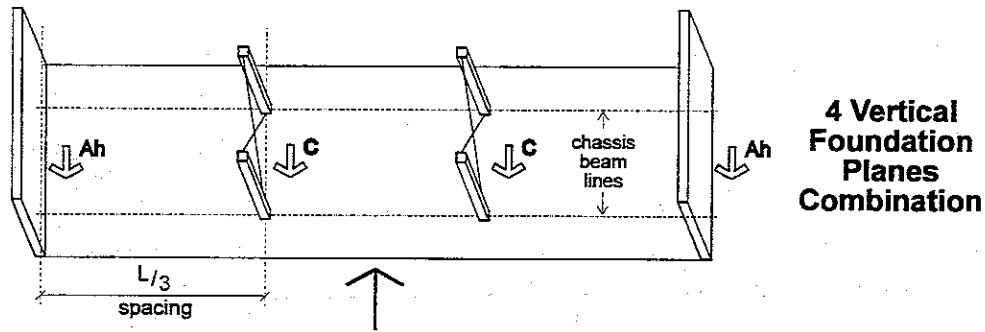

Sliding Resistance - Combination Option - Transverse Direction


Figure 6 - 5

D. Additional Foundation Types and Concepts. Some combinations of support and vertical anchorage, other than the basic Types C, E and I. Should that be the case, select one of the concept options below:

Type C1: concept C1 (Single-section)

Type E: concept E3, E4 (single-section)
concept E3 (multi-section)
concept E5, E6, E7 (multi-section)

Type Cnw: concepts C2, C3, C4 (type Cnw stands for a Type C multi-section with no marriage wall)

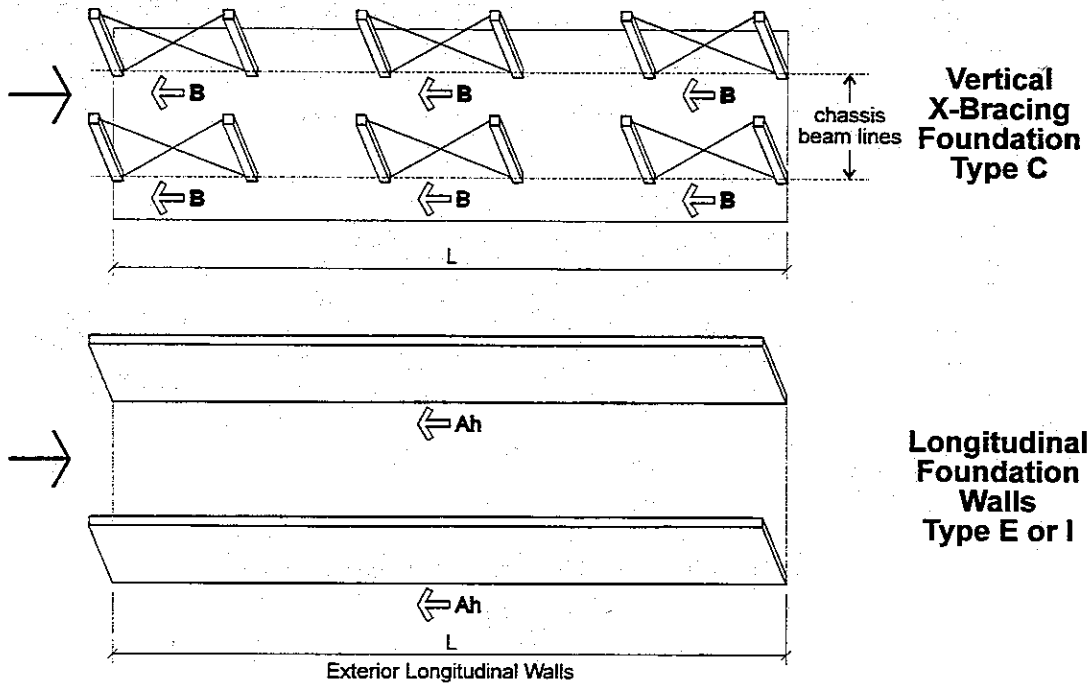


Sliding Resistance Options - Longitudinal Direction

Figure 6 - 6

602. USING THE FOUNDATION DESIGN TABLES (APPENDIX B)


602-1. GENERAL. The Foundation Design Load Tables (Appendix B) are used to determine foundation footing sizes required, plus

vertical and horizontal anchorage forces to be resisted for all the foundation types. This section gives step-by-step instructions for using the Foundation Design Load Tables.

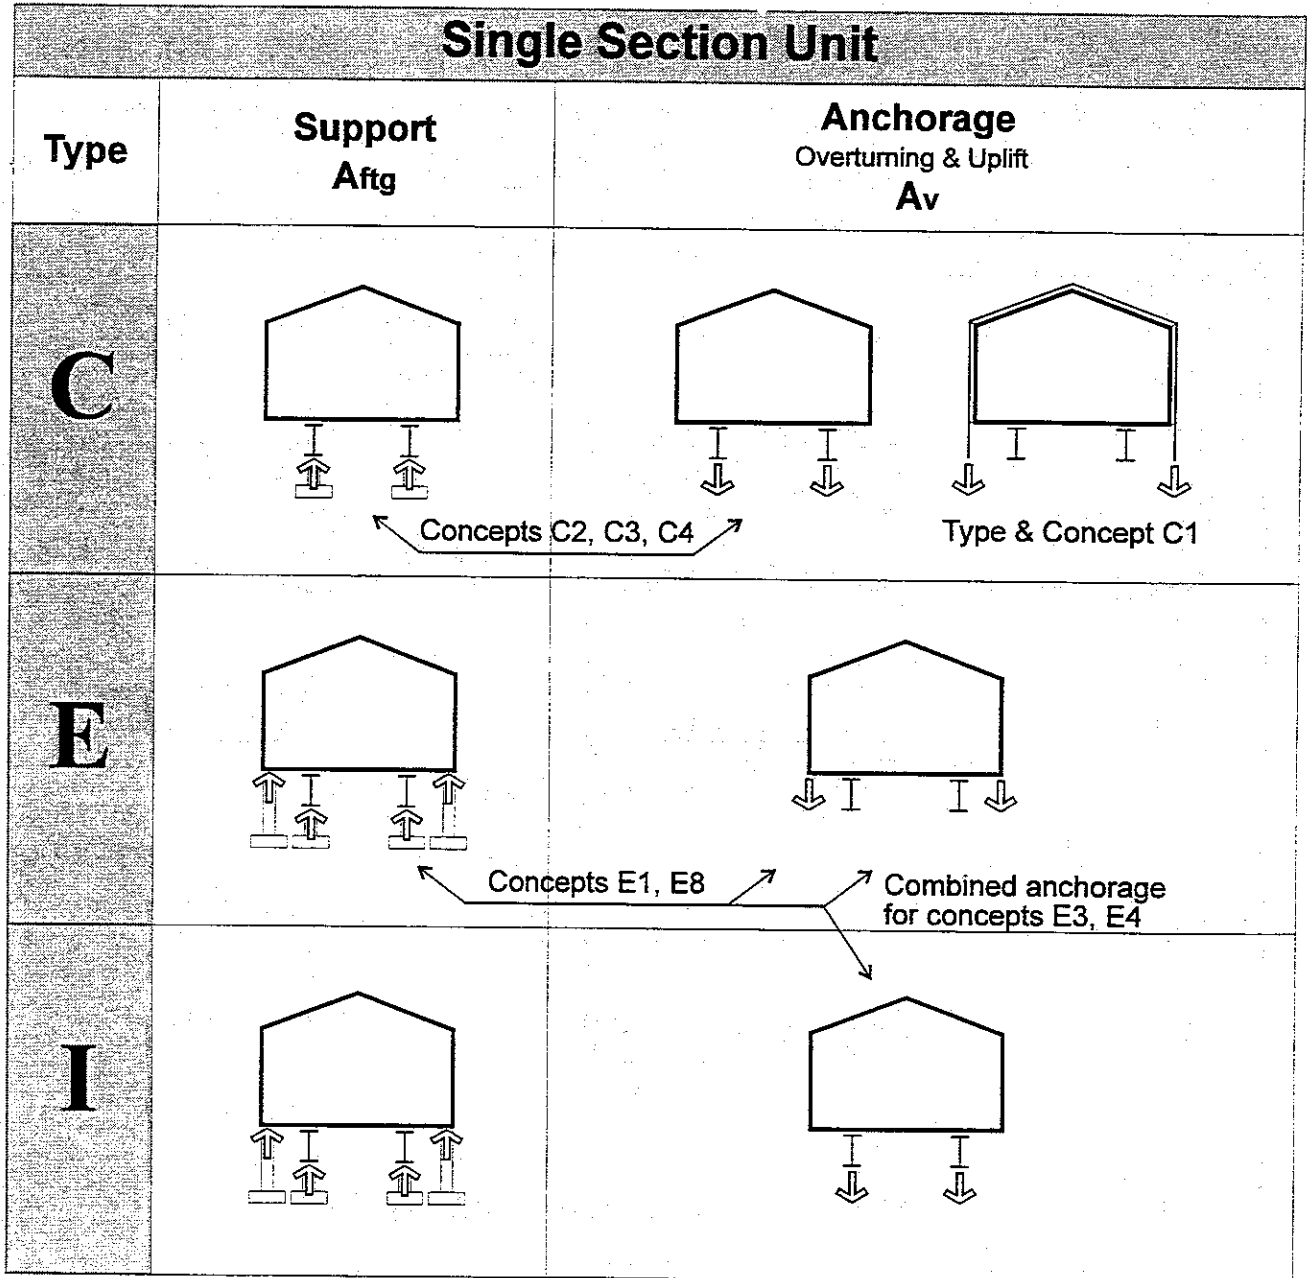

Foundation Design Concepts: Single-Section Units

Figure 6 - 5

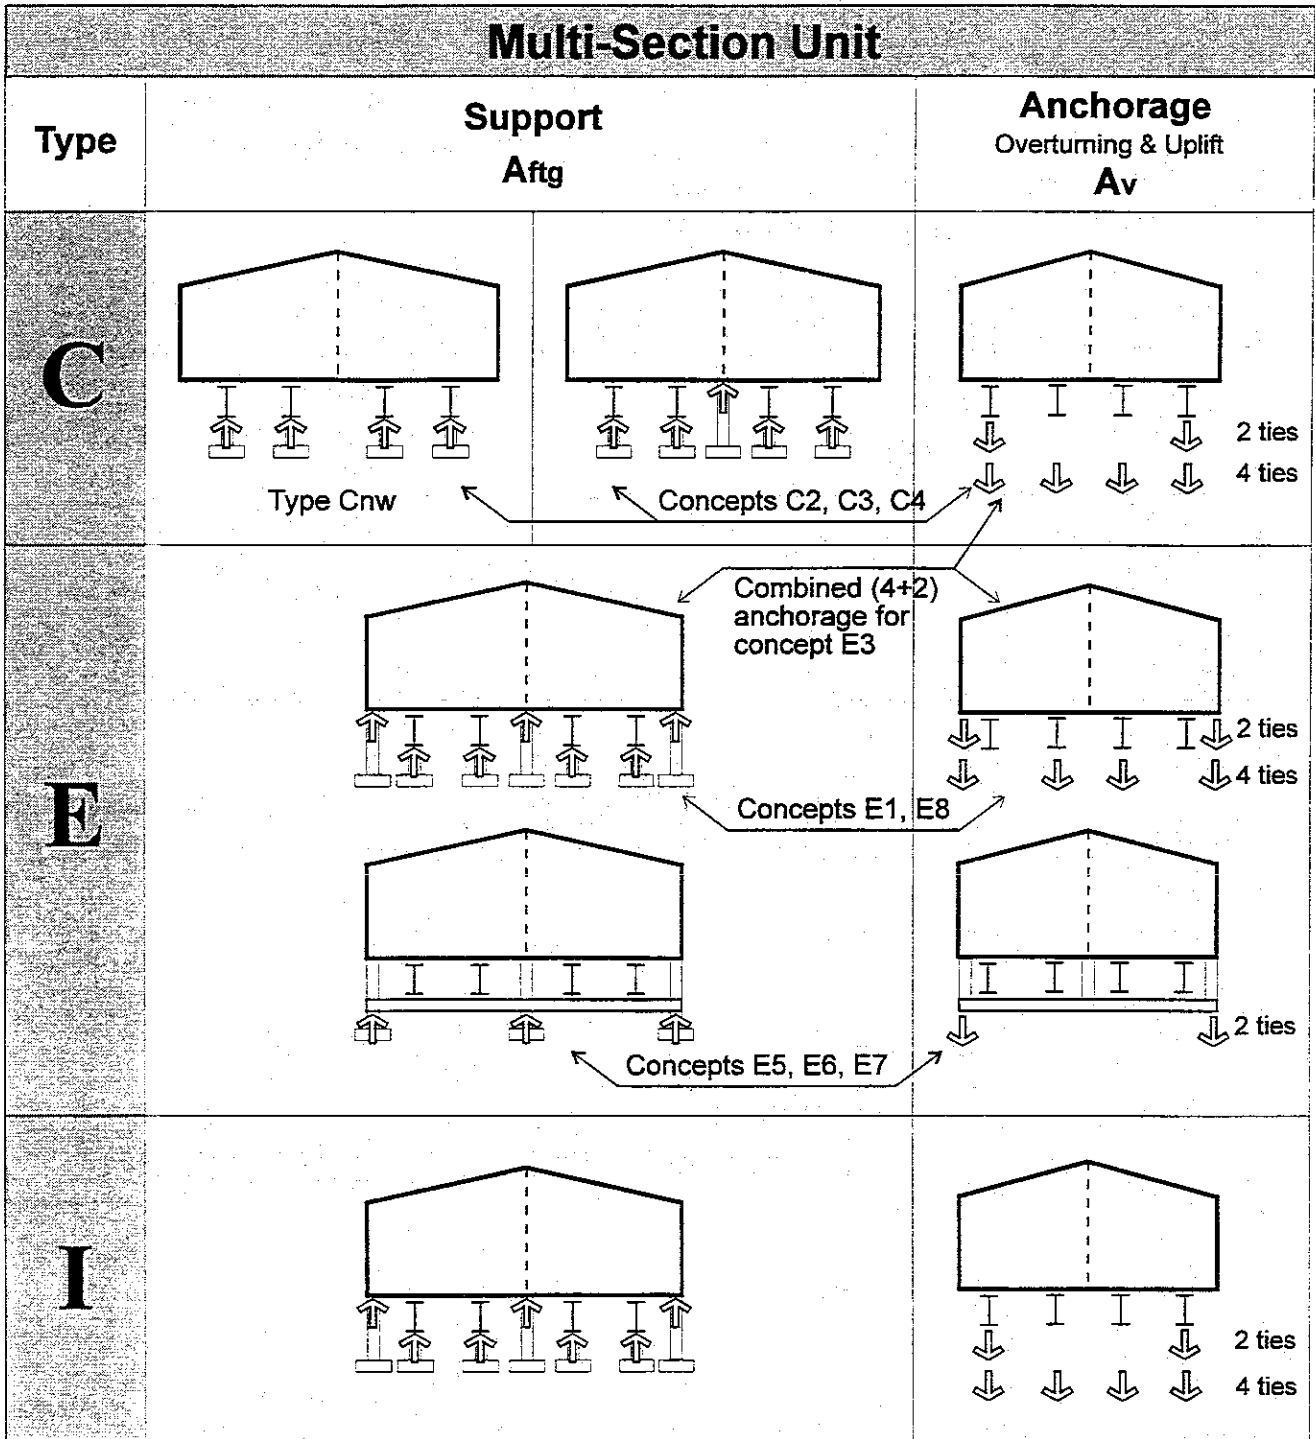

Foundation Design Concepts: Multi-Section Units


Figure 6 - 6

602-2. FOUNDATION VOCABULARY.
Figure 6-9 illustrates the following foundation terms.

A. Pier Foundations. The longitudinal variety of spacing of piers under the chassis beam lines as shown in the Foundation Design Load Tables is 4, 5, 6, 7, 8 and 10 feet. If pier spacings other than those shown are contemplated, use the next largest spacing (i.e. for 4.5 feet use 5 feet). Piers placed under continuous marriage walls are assumed equally spaced, while piers must be placed under posts that define the ends of a large opening in a marriage wall. These openings are assumed to range from 10 to 20 feet in 2 foot increments. All marriage wall piers are assumed to only participate in transferring gravity loads, thus they do not participate in resistance to overturning or sliding. Piers may be made of concrete, con-

crete masonry or steel. Reinforcing is required for all concrete or masonry pier concepts in seismic regions with A_v greater than or equal to 0.3. The values shown in the Foundation Design Load Tables are values based on the pier spacing in pounds per pier (lbs) for (A_v), and square feet for (A_{ftg}), whether exterior, interior or marriage wall piers.

B. Transverse Foundation Walls. Transverse foundation walls can occur at the exterior ends of a single-section or multi-section unit, as well as at selected interior locations along the length of the unit. A continuous concrete footing must exist under the transverse walls regardless of the wall material: concrete, concrete masonry or treated wood. Interior transverse foundation walls of concrete or masonry can: (1) box around the chassis beams and provide direct continuous connec-

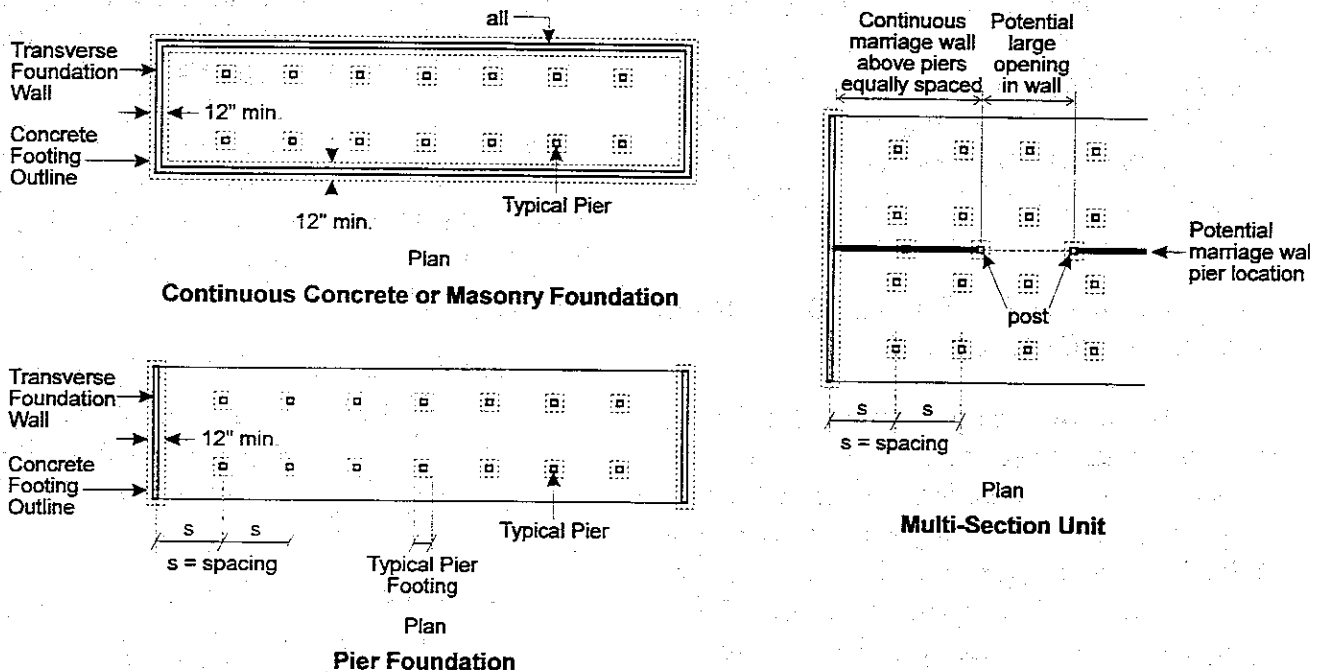

Foundation Terms

Figure 6 - 7

tion to the floor structure of the unit, or (2) the wall can stop at the underside of the chassis beams and utilize diagonal steel straps or diagonal wood ties to complete connection between the transverse wall and the unit's floor structure. Appendix A illustrates these approaches. Reinforcement will be required for most transverse wall concepts. The values shown in the Foundation Design Load Tables (Appendix B) for horizontal anchorage (Ah) are values based on pounds per lineal foot (lbs./ft.) of wall.

C. Longitudinal Foundation Walls. Longitudinal Structural foundation walls are provided for foundation Types E and I. A continuous concrete footing must exist under the longitudinal foundation walls regardless of the wall material: concrete, concrete masonry or treated wood. Reinforcement will be required for all longitudinal wall concepts. The values shown in the Foundation Design Load Tables (Appendix B) for: (1) vertical anchorage (Av) are values based on a continuous wall support in pounds per lineal foot (lbs./ft.) of wall, (2) horizontal anchorage (Ah) are values based on pounds per lineal foot (lbs./ft.) of wall and (3) footing width values are in feet (ft) for (Aftg).

602-3. REQUIRED FOOTING AREAS (Aftg) (APPENDIX B, PART 1)

A. General. The foundation must be capable of transmitting the total gravity load to the soil without exceeding the net allowable soil bearing pressure. The gravity loads consist of the unit dead weight, snow load or minimum roof live load, and occupancy live load. Bearing against the soil is accomplished with square concrete footings under piers and continuous linear concrete footings under walls. Compli-

ance with this requirement should prevent excessive differential settlement.

B. Determine Design Ground Snow Load / Minimum Roof Live Load. This step has been done in section 600-3 and is required for single-section and multi-section units.

C. Occupancy Live Loads. The residential occupancy floor live load is 40 psf in all the model codes and has been used as the floor live load in the Tables of Appendix B, Part 1. Attic live load is assumed to be 10 psf.

D. Determine Net Allowable Soil Bearing Pressure. The maximum net allowable soil bearing pressure shall be based on a geotechnical investigation, a national model code presumptive value, or an assigned value by the local authority having jurisdiction, as described in Chapter 2. The Tables in this document assume a minimum of 1000 psf. The value for design should be recorded in the Owner's Site Acceptability Worksheet (Appendix E, question # 10 or #11).


E. Determine (Aftg) Value from the Tables. Refer to Appendix B, Part 1 of the Foundation Design Load Tables. Several steps must be followed to arrive at the pier and/or wall footing sizes:

1. Select the correct Table based on the foundation type (C, Cnw, E,I or E5; single-section or multi-section) and the unit nominal width (12, 14 or 16 feet).
2. Enter the selected Table with the design ground snow load or minimum roof live load. This step is slightly different depending on unit Type as follows:

Type C (single-section or multi-section), Type Cnw, and Type E, I multi-section: Blocks of values


have headings for the various ground snow load and minimum roof live load magnitudes. Select

Example 1: Type: C - Single-Section Unit; Location: Tampa, FL.; Wt = 14 ft.; L = 60 ft.; Roof Slope: 2 in 12; 4 Transverse Shear Walls; Pier Spacing: 5 ft.; Pg = 0 psf.; Min. Roof LL = 20 psf.; V = 100 mph.; Coastal; Seismic $A_v = 0.05$; $A_a = 0.05$; Allowable Soil Pressure: 2000 psf.

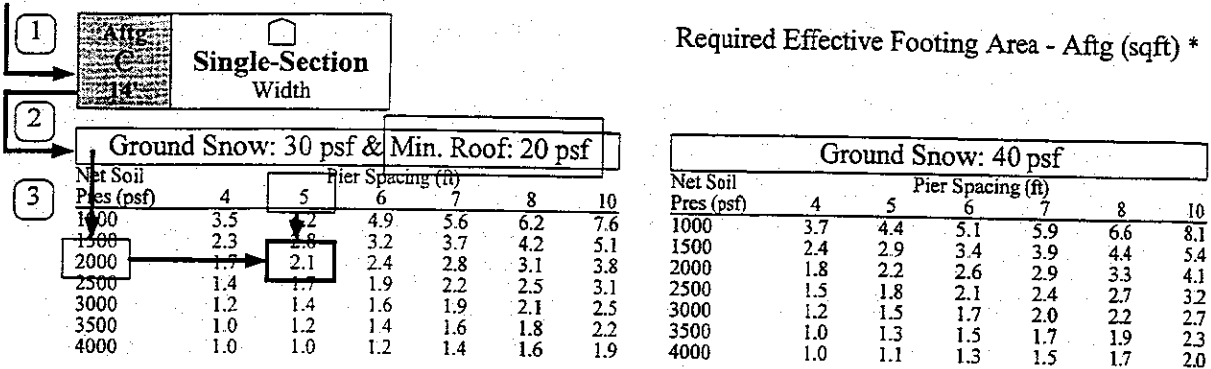

Example 2: Type: E - Multi-Section Unit; Location: West Yellow Stone, MT.; Wt = 14 ft.; L = 60 ft.; Roof Slope: 2 in 12; 4 Transverse Walls; Pier Spacing: 5 ft.; Pg = 70 psf.; V = 80 mph.; Inland; Seismic $A_v = 0.40$; $A_a = 0.40$; Allowable Soil Pressure: 2000 psf. Marriage wall opening width = 14'-0"

Required Effective Footing Area - Aftg (sqft) *

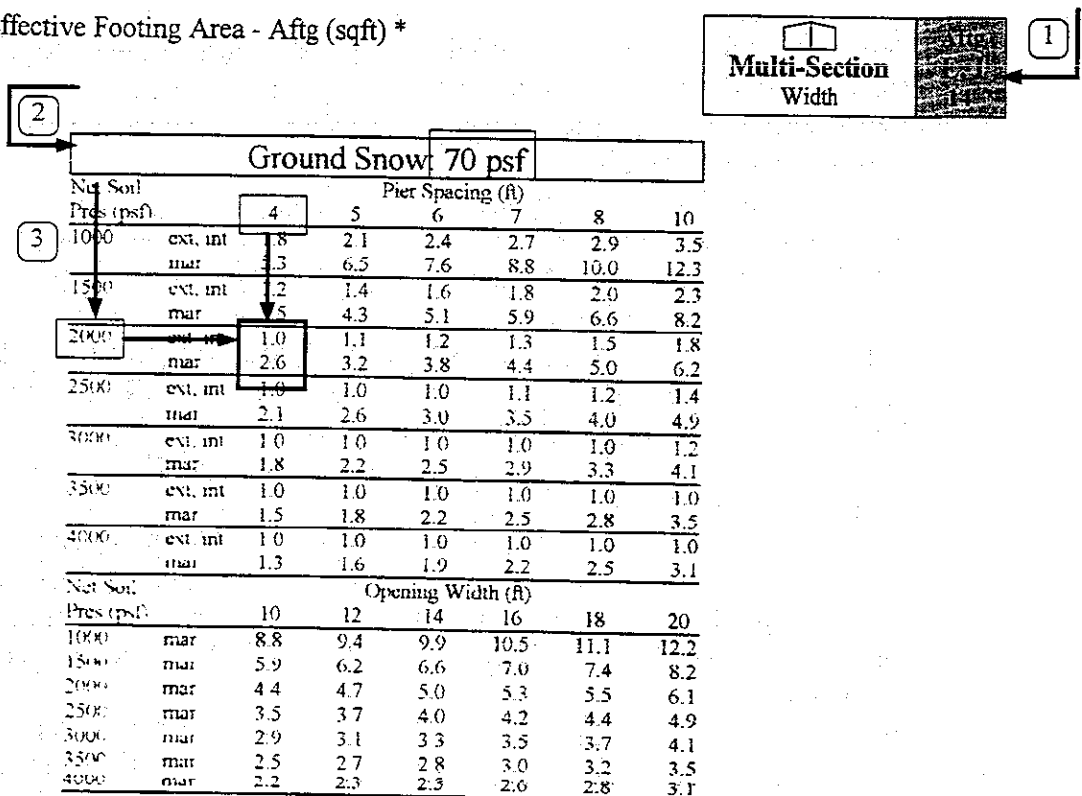

the correct ground snow load block of values.

Type **E** or **I** single-section: Snow load is included in the loading combination but is not required to move to the next step.

3. Select the row for the required net allowable soil bearing pressure and proceed horizontally until the desired, or manufacturer's recommended, pier spacing is located (see the Manufacturer's Worksheet in Appendix E, item #10 or #11). Read and record on the Design Worksheet (Appendix F) the required footing areas for interior and exterior pier footings and continuous marriage wall footings (as required).
4. When the marriage wall of a multi-section unit has a large opening, the lower portion of the block of values is also required. Re-use the net allowable soil bearing pressure and move horizontally until the selected opening width is found. Read the required effective footing area (A_{ftg}) for the piers required at the ends of the opening. Record on the Design Worksheet (Appendix F).

Note: For Types **E** and **I**, the exterior wall footing is a minimum 1'-0" wide for single or multi-section units. Read the footnotes at the bottom of each table for special cases where for certain ground snow loads in combination with an allowable soil pressure of 1000 psf other

minimum footing widths are required.

602-4. REQUIRED VERTICAL ANCHORAGE (A_v) IN THE TRANSVERSE DIRECTION (APPENDIX B, PART 2)

A. General. The foundation must provide enough structural capacity to resist uplift and overturning forces due to wind pressure and suction. These forces are resisted by connections to anchors at the piers or to anchors along the longitudinal foundation walls. Seismic inertia forces generated from the ground acceleration and the mass of roof and floor planes of the manufactured housing unit were **not** found to control over wind for overturning in the transverse direction, regardless of whether a single-section or multi-section unit was analyzed, and regardless of seismic, wind or snow zone.

B. Determine Design Wind Speed. This step has been done in section 600-4, and is required for single-section and multi-section units.

C. Determine (A_v) Value from the Tables. Refer to Appendix B, Part 2 of the Foundation Design Load Tables. Several steps must be followed to arrive at the Required Vertical Anchorage in the Transverse Direction:

1. Select the correct Table based on the foundation type (**C**, **C1**, **E** or **I** for single-section units and **C**, **E** or **I** for Multi-section units); 2 tie-downs or 4 tie-downs; 12, 14 or 16 foot nominal unit width).
2. Enter the selected Table and move down the wind speed column until the design wind speed magnitude

(for Inland or Coastal region) is reached. Read horizontally across the row until the desired, or manufacturer recommended, pier spacing is reached.

3. Read (A_v) and record on the Design Worksheet (Appendix F) the value with its appropriate units as shown in the table. Steps 1 through 3 were described for Type C, C1 or I single-section units. For Type E single-section units or multi-section units with 2 tie-downs, values must be multiplied by the anticipated spacing of connections along the exterior longitudinal walls. For Type C or I multi-section units select the Table for 2 tie-downs or 4

tie-downs (whichever applies) and proceed as above to find the correct value. For Type E multi-section units with 4 tie-downs read two values, first for interior pier locations, and second for exterior longitudinal wall locations.


D. Comparison With Home Manufacturer's Values (Optional). The value for (A_v) determined from the Tables must be compared to the value supplied by the manufacturer. The home manufacturer's uplift resistance value must be equal or greater than the vertical anchorage requirement from the Tables.

602-5. REQUIRED HORIZONTAL ANCHORAGE (A_h) IN THE TRANSVERSE DIRECTION (APPENDIX B, PART 3)

Example 1:

Required Vertical Anchorage - A_v (lbs)

Wind Speed (mph)	Pier Spacing (ft)						
	4	5	6	7	8	10	
Inland	80	960	1300	1450	1690	1930	2410
	90	1370	1710	2060	2400	2740	3430
	100	1830	2280	2740	3200	3660	4570
	110	2330	2910	3500	4080	4660	5830
Coastal	80	1120	1400	1680	1960	2240	2800
	90	1570	1960	2360	2750	3140	3930
	100	2070	2590	3110	3630	4150	5180
	110	2630	3290	3940	4600	5260	6570



Example 2:




Required Vertical Anchorage - A_v (lbs)

Wind Speed (mph)	Exterior (lbs/ft)	Interior Pier Spacing (ft)					
		4	5	6	7	8	10
Inland	80	210	270	320	370	420	530
	90	390	490	580	680	780	970
	100	590	730	880	1030	1170	1470
	110	810	1010	1210	1410	1610	2010
Coastal	80	280	350	420	490	560	700
	90	480	590	710	830	950	1190
	100	690	870	1040	1210	1390	1730
	110	930	1170	1400	1640	1870	2340


A. General. The attachment of the unit to the foundation must provide sufficient structural anchorage for the manufactured home to resist sliding forces due to wind pressures and suctions or seismic inertia forces, whichever controls. Analysis, based on the conservative load assumptions of this hand-

book, has shown that in the transverse direction for single-section units and for multi-section units, it is necessary to check both wind and seismic to determine which force controls. These horizontal forces are resisted by connection of the unit to anchors along the exterior walls, plus any additional interior transverse

Example 1:

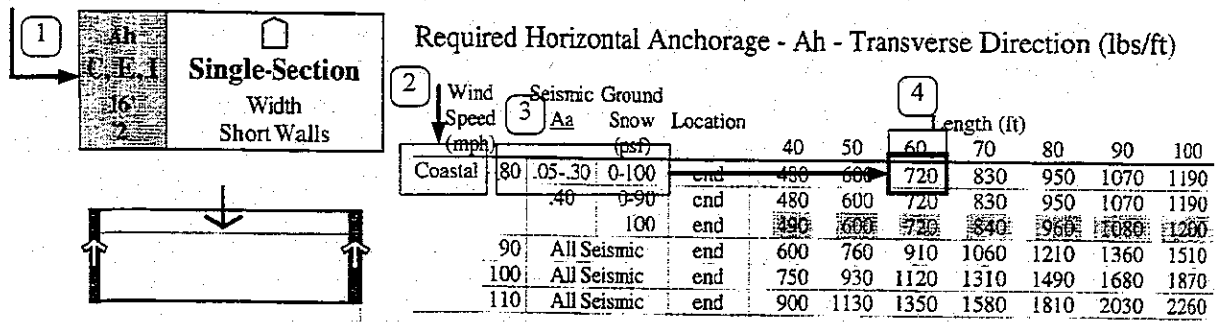

Example 2:

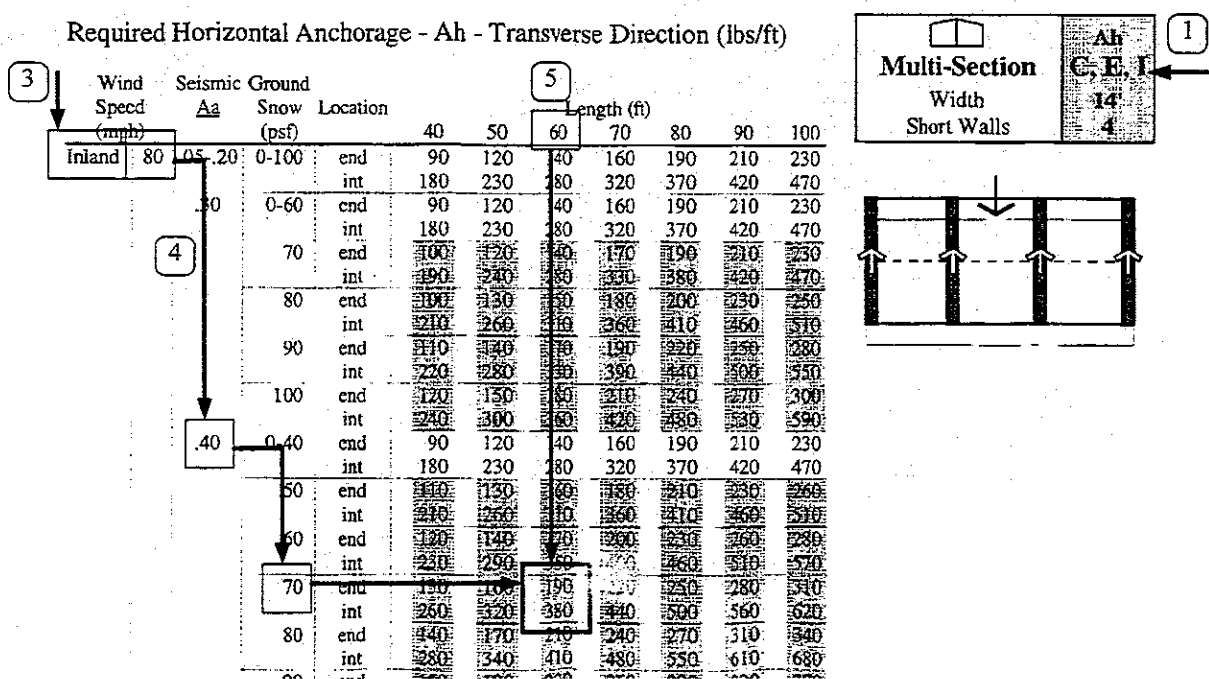

walls; or by connection of the unit to a combination of exterior and interior vertical planes of X-bracing at pier locations. Interior transverse walls may be either full height or short of the chassis beams and completed with some form of diagonal bracing. See illustration of options in Appendix C.

B. Determine Design Ground Snow Load. This step has been done in section 600-3 and is only required for multi-section units, where it may influence seismic values.

C. Determine Design Wind Speed. This step has been done in section 600-4, and is required for single-section and multi-section units.

D. Determine Design Seismic Ground Acceleration Values and Required Seismic Performance Category. This step has been done in section 600-5 and is required for single-section and multi-section units.

E. Determine Horizontal Anchorage (Ah) in the Transverse Direction from the Tables. Refer to Appendix B, Part 3 of the Foundation Design Load Tables. Several steps must be followed to arrive at the Required Horizontal Anchorage in the Transverse Direction:

1. Select the correct Table based on single-section or multi-section unit, nominal unit width of 12, 14 or 16 feet, and whether 2, 4, or 6 transverse walls (the handbook has limited the number of transverse walls to 6). Note that the foundation type does not influence the required horizontal anchorage force, thus the heading for all the Tables read: Type C, E or I.

2. Enter the selected Table at the far left and move down either the Inland or Coastal wind speed column, as appropriate, until the required MPH value is reached. Slide to the next column to the right within the block of numbers covered by that wind speed.

3. Select the next smaller block of numbers based on the required seismic (Aa). Move to the right to the next column and locate the required ground snow load. The seismic (Aa) and ground snow load columns will in many cases include a range of values (i.e. .05-.30, or 0-100 psf respectively, which means that the group of values covers all values in that range). These column movements define a unique pair of rows of values taking into account wind and seismic lateral forces.


4. Move to the right until the column for the known unit length is reached. The intersection of that column and the already located rows represents the correct horizontal anchorage values (Ah) for design in (lbs./ft.). If the values are grayed, seismic controlled the magnitude of the values. In the case of two transverse walls, they will be located at the ends of the unit. The Location column in the Table will state **end**. If 4 or 6 transverse walls are selected, there will be two rows of values; one for **end** walls and one for **interior** walls.

help: **Choosing the number of transverse foundation walls.** As a

guide, increasing the number of transverse foundation walls reduces the force per anchor/connection and permits an increased spacing between anchors. Thus, the user should begin with the fewest number of transverse walls - two (2). Comparison of (Ah) with the horizontal anchorage capacities in Appendix C can be simultaneously verified during the completion of the Design Worksheet (Appendix F). A greater number of transverse foundation walls (4 or 6)

may be required. Multi-section units may be stable enough so that only two transverse foundation walls are required. Long, narrow single-section units, or units in windy or high seismic areas, may require more than two transverse walls.

F. Comparison with Manufacturer's Values (Optional). The value for the horizontal anchorage force required for design in the transverse direction must be compared to the value supplied by the manufacturer. The manu-

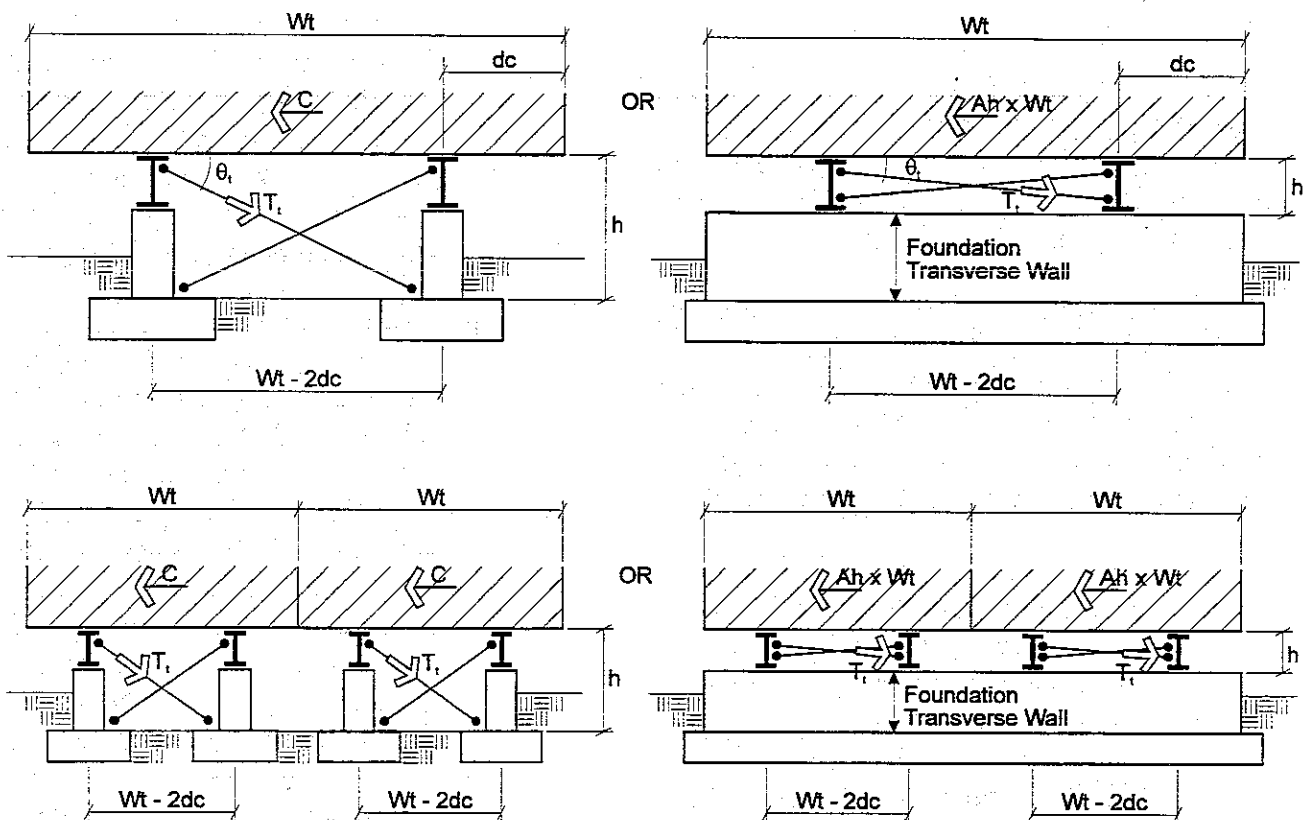

Multi-Section Units

$$\cos \theta_1 = \frac{Wt - 2dc}{\sqrt{h^2 + (Wt - 2dc)^2}}$$

Horizontal Anchorage with X-bracing - Transverse Direction

Figure 6 - 8

facturer's horizontal anchorage value must be equal to or greater than the horizontal anchorage requirements from the Tables. See the Manufacturer's Worksheet, item # 16(c) and example number 1 in Appendix G.

G. Horizontal Anchorage with Diagonal bracing atop transverse shear walls or complete Vertical X-Bracing planes. Diagonal members may be used to complete transverse walls that stop at the underside of the chassis beams, or complete X-bracing can be used in lieu of shear walls for transverse foundation walls. Refer to the Transverse Foundation Wall Concepts for Types C, E and I in Appendix A, and example number 2 in Appendix G.

1. *To use diagonal steel straps or wood diagonals to complete the transverse foundation walls.* The required Horizontal Anchorage Table value of (Ah) for single-section or multi-section units must be converted to a diagonal tension (T_t) to size the strap.
 - a. Multiply the required (Ah) by (Wt) to calculate the total horizontal force at the transverse wall under a pair of chassis beams. Note: two sets of diagonals, using this force, are required for multi-section units.
 - b. Divide this value by the cosine of the angle of the diagonal to arrive at the tension (T_t) in the diagonal. See Figure 6-10 for an illustration of this condition. The equation is as follows:

$$T_t = \frac{Ah \times Wt}{\cos\theta_t}$$

2. *To use Vertical X-Bracing Planes with steel straps or rods instead of transverse foundation walls.* This method is possible for Foundation Concepts C1, C2, E1, E3 and E4 only. The required Horizontal Anchorage Table value of (Ah) must be modified as follows:

- a. Select the required (Ah) value from the Table for two (2) transverse foundation walls for single-section or multi-section units.
- b. Multiply (Ah) times (Wt), regardless if single-section or multi-section unit and then multiply that by 2. Finally divide that total by the unit length (L) to generate a horizontal force (H) in pounds per foot of unit length. The equation follows:

$$H \text{ (lbs./ft. of length)} = \frac{Ah \times Wt \times 2}{L}$$

- c. Multiply (H), horizontal force, by the spacing between vertical X-bracing planes to determine the horizontal force (C) to be resisted at each X-brace location. Thus, for multi-section units (C) is the applied force at both X-bracing locations in the vertical plane. This spacing should be some multiple of the pier spacing. The equation follows:

$$C \text{ (lbs./X-brace)} = H \times \text{spacing}$$

- d. Divide (C), horizontal force, by the cosine of the angle of the diagonals as illustrated in Figure 6-10, to arrive at the required diagonal tension force in pounds. The equation follows:

$$T_t \text{ (lbs./diagonal)} = \frac{C}{\cos \theta_t}$$

- e. Compare the required tension force (T_t) and the required horizontal force per X-brace (C) with the rated capacities supplied by the manufacturer in the Manufacturer's Worksheet, items #16(c and e). See Figures 6-4 and 6-5 for illustrations.

602-6 REQUIRED HORIZONTAL ANCHORAGE (A_h) IN THE LONGITUDINAL DIRECTION (APPENDIX B, PART 4).

A. General. The attachment of the unit to the foundation must provide sufficient structural anchorage for the manufactured home to resist sliding forces due to wind pressures and suctions, or seismic inertia forces, whichever controls. Analysis, based on the conservative assumptions used in this handbook, has shown that wind or seismic may control in the longitudinal direction for single-section or multi-section units, thus it is necessary to check both wind and seismic for all units. These horizontal forces are resisted by connection of the unit to anchors in the exterior longitudinal walls, or by connection of the unit to vertical planes of X-bracing under and along the chassis beams (between piers).

B. Determine Design Ground Snow Load. This step has been done in section 600-3 and is required for single-section or multi-section units.

C. Determine Design Wind Speed. This step has been done in section 600-4 and is required for single-section or multi-section units.

D. Determine Design Seismic Ground Acceleration Values and Required Seismic Performance Category. This step has been done in section 600-5 and is required for single-section or multi-section units.

E. Determine Design Horizontal Anchorage (A_h) in the Longitudinal Direction from the Tables. Refer to Appendix B, Part 4 of the Foundation Design Load Tables. Several steps must be followed to arrive at the Required Horizontal Anchorage in the Longitudinal Direction:

1. Select the correct Table based on single-section or multi-section unit and nominal unit width (W_t) of 12, 14 or 16 feet. Note that the foundation type does not influence the required horizontal anchorage force in the longitudinal direction, thus the heading for the Tables read: Type C, E or I.
2. Enter the selected Table and move down the left-most column until the required Seismic (A_a) value is reached. This defines a large block of values. Move to the right to the next column and locate the required ground snow load. This defines a smaller block of values. Move to the next column to the right and locate the inland or coastal block of

values and lastly find the required wind speed within that same column. This now defines a single row of values that represents comparison of seismic and wind effects.

3. Select the column which represents the length of the unit. The intersection of that column and the already determined row locates the required horizontal anchorage value (Ah) in the longitudinal direction along two


lines; either the two exterior longitudinal walls for Type E or I or along the two exterior chassis beams for Type C.

Help: for Type E or I units, longitudinal exterior walls will exist, and will suffice as shear walls in the longitudinal direction. See example number 1 in Appendix G. For Type C units, vertical X-bracing planes under and along the exterior chassis

Example 1:

Required Horizontal Anchorage - Ah - Longitudinal Direction (lbs/ft)


Seismic Ground Snow (psf)	Wind Speed (mph)		Length (ft)							
			40	50	60	70	80	90	100	
.05-10	0-100	Inland	80	41	33	27	23	20	18	16
			90	52	41	35	30	26	23	21
			100	64	51	43	37	32	28	26
			110	77	62	52	44	39	34	31
		Coastal	80	45	36	30	26	23	20	18
			90	57	46	38	33	29	25	23
			100	71	56	47	40	35	31	28
			110	85	68	57	49	43	38	34



Example 2:

Required Horizontal Anchorage - Ah - Longitudinal Direction (lbs/ft)

Seismic Ground Snow (psf)	Wind Speed (mph)		Length (ft)							
			40	50	60	70	80	90	100	
.40	0-30	Inland	80	100	122	147	174	202	230	258
			90	127	101	125	152	180	208	236
			100	156	125	144	172	200	228	256
			110	189	151	176	208	240	272	304
		Coastal	80	110	122	147	174	202	230	258
			90	139	112	133	160	188	216	244
			100	172	138	155	188	220	252	284
			110	208	167	199	236	272	308	344
		40	Inland	80-100	130	180	210	240	270	300
				110	189	230	270	310	350	390
			Coastal	80-100	130	180	210	240	270	300
				110	208	250	290	330	370	410
	50	Inland	80-110	202	202	202	202	202	202	
		Coastal	80-100	202	202	202	202	202	202	
			110	208	202	202	202	202	202	
	60	All Wind	224	224	224	224	224	224	224	
	70	All Wind	247	247	247	247	247	247	247	
	80	All Wind	269	269	269	269	269	269	269	
	90	All Wind	291	291	291	291	291	291	291	
	100	All Wind	313	313	313	313	313	313	313	



beam lines (between piers) are required. See Section 602-6.F for guidance.

F. Horizontal Anchorage with X-bracing for the Longitudinal Direction. Diagonal members under and along the exterior chassis beams may also be used in lieu of exterior longitudinal shear walls. If galvanized steel diagonal members are used instead of full height exterior foundation walls, the required Horizontal Anchorage Table value of (Ah) must be modified as follows:

1. Select the required (Ah) value from the Tables in Part 4, Appendix B for single-section or multi-section units.
2. Multiply (Ah) times the manufactured home unit length (L) and divide by the selected number of X-brace locations (n) along one exterior chassis beam to generate the total horizontal force (B) to be resisted at each X-brace location along each chassis beam for single-section units, and along each exte-

rior chassis beam for multi-section units. As an example, there are three (n = 3) X-brace locations along each chassis beam for the single-section unit in Figure 6-6. The equation follows:


$$B(\text{lbs./X-brace}) = \frac{Ah \times L}{n}$$

Note: For multi-section units using all four (4) chassis beam lines as vertical X-bracing lines, divide the above equation by 2 (see Fig.D-26 for an example).

3. Divide (B) by the cosine of the angle of the diagonals as illustrated in Figure 6-11, to arrive at the required diagonal tension force in pounds. The equation follows:

$$T_L (\text{lbs./diagonal}) = \frac{B}{\cos \theta_L}$$

4. Compare the required tension force (T_L) and the horizontal force to each

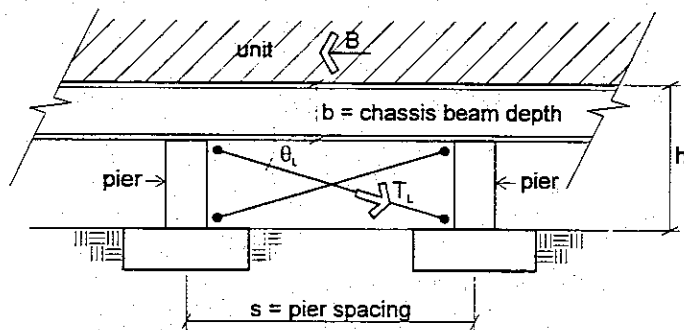

Longitudinal Direction

$$\cos \theta_L = \frac{s}{\sqrt{(h-b)^2 + s^2}}$$

Horizontal Anchorage with X-bracing - Longitudinal Direction

Figure 6 - 11

X-brace (B) with the rated capacities supplied by the manufacturer in the Manufacturer's Worksheet, items #16(c and e), or supplied by another vendor.

603. USING THE FOUNDATION CAPACITIES TABLES (APPENDIX C)

603-1. GENERAL. The Foundation Capacities Tables in Appendix C will be used to find the required size and depth of footings, the required sizes and spacing of anchors, and necessary reinforcement. There are three conditions that will be investigated: 1) Vertical Anchorage (uplift and overturning) requirements for longitudinal foundation walls and piers, 2) Horizontal Anchorage (sliding) in the transverse direction (for transverse foundation walls that function as shear walls), and 3) Horizontal Anchorage (sliding) in the longitudinal direction (for longitudinal foundation walls that function as shear walls).

603-2. REQUIRED VERTICAL ANCHORAGE: LONGITUDINAL FOUNDATION WALLS AND PIERS

A. Determining Footing Depth for Longitudinal Foundation Walls and Piers. This involves selecting sufficient counterweight of material dead loads (wall or pier, footing and soil) to resist the required uplift. The field officer determines how deep the footings must be placed. In frost-prone areas, the footing must at least be placed below the extreme frost depth below grade (map, page H-4). In windy or seismic areas, it may also be necessary to place the footing deeper in the soil than frost protection alone would require. Burying the footing deeper gives it greater

withdrawal resistance--it is harder to pull it out of the soil.

B. Determine Required Withdrawal Resistance. It is necessary to compare the values obtained from the Foundation Design Load Table for (Av) with Tables C-1 or C-2 of Appendix C.

1. *For longitudinal foundation walls,* compare the required value for (Av) with the numbers in the columns in Table C-1 (for foundation Type E).
 - a. Find a number in the table that is greater than (Av). There may be several numbers that meet this criteria.
 - b. Any number that is greater than (Av) means that the foundation type and footing width (found at the top of the column) can be used. The number (hw) in the column on the left indicates how deep the footing should be placed to resist the uplift and overturning force. Example calculations are included in Appendix C if alternate footing widths are desired.
2. *For isolated pier foundations and concrete tie-down blocks (Concept Type CI),* compare the value for the required (Av) with the numbers in the columns in Table C-2 (for foundation Types C or I and type E with 4 tie downs).
 - a. Find a number in the table that is greater than (Av). There may

be several numbers that meet this criteria.

- b. Any number that is greater than (Av) means that the width of the square footing (found at the top of the column) can be used. The number hw in the left-hand column indicates how deep the footing should be placed to provide adequate withdrawal resistance. Example calculations are included in Appendix C if alternate footing widths are desired. The same Table C-2 can conservatively be used for concrete deadman footing sizes for concept Type C1.

C. Foundation System Verification.

The HUD field office should verify that the foundation system selected has sufficient depth to withstand uplift. Regardless of the required depth for uplift or overturning, the footing must always be placed below the extreme frost depth below grade.

D. Determine Required Anchorage and Reinforcement for Longitudinal Foundation Walls and Piers. The field officer will now verify the kinds of anchorage (steel anchor bolts) and reinforcement (steel reinforcing bars) that will be needed to tie together the footing, wall or pier, and the unit itself. The field officer will refer to Table C-3: Vertical Anchor Capacity for Piers and Table C-4A or C-4B: Vertical Anchor Capacity for Longitudinal Foundation Walls (Appendix C).

1. *For piers*, use Table C-3.

- a. Compare the required value of (Av) with the capacity numbers.

- b. Find a capacity number that is greater than the required value for (Av). The number of anchor bolts is listed at the top of the column. The diameter of the anchor bolt is listed in the left column.
 - c. Move to Table C-3A to find the reinforcing size, lap splice, and reinforcing-bar hook requirements, based on the anchor bolt diameter selected in Table C-3.
 - d. Refer to the illustration next to Table C-2 for the required footing reinforcement.
 - e. Refer to the Foundation Type C1 (Appendix A) Design Concept for the tie-down bar size.
 - f. Sample calculations are included in Appendix C if alternate reinforcement sizes, spacings or material grades are desired.
2. *For longitudinal foundation walls*, start with Table C-4A for concrete or concrete masonry walls, or C-4B for a treated wood wall.
- a. Compare the required value for (Av) with the numbers in the left hand column of Table C-4.
 - b. Find a number that is greater than the required (Av).
 - c. Read across the column and find:

- 1) For masonry and concrete foundations (Table C-4A):
 - (a) Anchor bolt size and spacing.
 - (b) From Table C-3A, reinforcing-bar size, lap splice, and hook length.
- 2) For treated wood foundations (Table C-4B):
 - (a) The required nailing.
 - (b) The minimum plywood nailer thickness.
 - (c) The required anchor bolt size and spacing.
- 3) Example calculations are included in Appendix C if alternate reinforcement sizes, spacings or material grades are desired.

603-3. REQUIRED HORIZONTAL ANCHORAGE: TRANSVERSE FOUNDATION WALLS

A. Horizontal Anchorage in the Transverse Direction. This involves connections to avoid sliding between the unit and its foundation. The field officer will compare the required value for (Ah) with Tables C-5 of Appendix C: Horizontal Anchor Capacity for Transverse or Longitudinal Foundation Walls. See example number 1 in Appendix G.

1. Compare the required value for (Ah) with the numbers in the left hand column of Table C-5A or C-5B.

2. Find a number that is greater than the required (Ah).
3. If none of the numbers is greater than (Ah), go back to Section 602-5.E and increase the number of transverse foundation walls until the required value of (Ah) is small enough to be used in the Horizontal Anchor Capacities Tables C-5A or C-5B.
4. The required anchorage for the transverse foundation wall can be read across the columns for:
 - a. *Masonry and Concrete Foundations* (Table C-5A):
 - 1) Anchor bolt diameter.
 - 2) Reinforcing bar size.
 - 3) Anchor bolt spacing.
 - 4) Based on the anchor bolt size, refer back to Table C-3A to obtain the following values:
 - (a) Minimum lap splice.
 - (b) Reinforcing bar hook.
 - b. *Treated Wood Foundations* (Table C-5B):
 - 1) Required nailing.
 - 2) Minimum plywood nailer thickness.
 - 3) Anchor bolt diameter.

- 4) Anchor bolt spacing.
5. Example calculations are included in Appendix C if alternate reinforcement sizes, spacings or material grades are desired.

603-4 REQUIRED HORIZONTAL ANCHORAGE: LONGITUDINAL FOUNDATION WALLS

A. Horizontal Anchorage in the Longitudinal Direction. This involves connections to avoid sliding between the unit and its foundation in the longitudinal direction. The field officer will check compliance with the required value for (Ah) in the longitudinal direction with Tables C-5 of Appendix C: Horizontal Anchor Capacity for Transverse or Longitudinal Foundation Walls. The process is identical with that of section 603-3 for transverse walls and will not be repeated here. See example number 1 in Appendix G.

603-5 DIAGONALS USED TO COMPLETE TRANSVERSE WALLS

A. Horizontal Anchorage. Determine the required horizontal anchorage force by multiplying the required (Ah) by the unit width (Wt). Reference section 602-5.G.1.a and Figure 6-10 for the required horizontal force $(Ah) \times (Wt)$.

1. Compare this value with the bottom number in the left hand column of Table C-5A. The capacity listed for 1/2" bolts at a 12" spacing is equal to the single-bolt capacity for horizontal anchorage of diagonals.
2. Divide $(Ah) \times (Wt)$ by the number in the table to determine the number

of bolts required for diagonal anchorage.

603-6 REQUIRED VERTICAL X-BRACING PLANES IN THE TRANSVERSE AND/OR LONGITUDINAL DIRECTIONS IN PLACE OF TRANSVERSE WALLS


A. Horizontal Anchorage with Diagonal Members. This involves connection of the ends of the diagonal straps to the unit and to the foundation. The HUD Field Office will compare the required horizontal anchorage value at each diagonal with Table C-5A of Appendix C to verify adequacy of connection between diagonal and footing. See example number 2 in Appendix G.

1. *Transverse Direction.* Use the horizontal anchorage force (C) per diagonal found in section 602-5.G.2.c and Figure 6-10.
 - a. Compare the value for (C) with the bottom number in the left hand column of Table C-5A. The capacity listed for 1/2" bolts at a 12" spacing is equal to the single-bolt capacity for anchorage of diagonals.
 - b. Divide (C) by the number in the table to determine the number of bolts required for diagonal anchorage.
 - c. Refer back to Table C-3A, to obtain the following values:
 - 1) Minimum lap splice.
 - 2) Reinforcing bar hook.

2. *Longitudinal Direction.* Use the horizontal anchorage force (B) per diagonal found in section 602-6.F and Figure 6-11..

a. Repeat steps (a.) to (c.) as for the transverse direction, using (B) instead of (C).

603-7. CONCLUSION. Values for the verification of the manufactured home foundation have now been obtained.



CHAPTER 7 - FINAL CHECK

700. GENERAL. Design values determined for the foundation sizes and detailing, that have been derived using procedures in the preceding chapters, will now be summarized. Follow the procedure near the end of the Design Worksheet of Appendix F for assembling relevant foundation information.

700-1. BEARING AREA AND VERTICAL ANCHORAGE.

A. Pier Footings and Piers under Chassis Beams.

1. Determine the area required for pier footings by comparing two values:
 - a. The Required Effective Footing Area (Aftg).
 - b. The Required Footing Area to resist overturning and uplift from withdrawal capacities found in Appendix C, where required.
2. Select the largest of the above two values. This value will determine the Pier Footing Size. The size and spacing of anchor bolts and the selection of reinforcing bar size, lap splice length, and reinforcing bar hook length for the piers has already been determined. The depth of the footings for frost and for withdrawal (where required) has also been determined. Bring these values forward.

B. Pier Footings and Piers under Marriage Walls. Marriage walls only occur in multi-section units. Their piers only carry gravity loads and never participate in uplift or sliding. There are two pier situations that may occur at marriage walls: (1) the marriage wall is continuous without openings, or (2) there are locations where large openings in the marriage wall are intended to enlarge a room's space.

1. Where marriage walls are continuous: determine the area required for pier footings by using one value:
 - a. The Required Effective Footing Area (Aftg) for marriage wall piers from the multi-section unit Foundation Design Tables in Appendix B.
 - b. The piers are assumed equally spaced under the continuous portion of the wall.
2. Where marriage walls have a large opening: determine the area required for piers at the ends of the opening by using one value:
 - a. The Required Effective Footing Area (Aftg) for marriage wall piers from the bottom of each multi-section unit Foundation Design Table in Appendix B by using the length of the opening.
 - b. These piers are located at the ends of the opening directly under the

posts that support the beam at the top of the opening.

C. Longitudinal Foundation Wall Footings and Longitudinal Foundation Walls.

1. Determine the correct footing size for longitudinal foundation walls, Types E & I, by comparing two values:
 - a. The Required Effective footing width (Aftg).
 - b. The Required footing width to resist uplift and overturning from the withdrawal capacities found in Appendix C, where required.
2. Select the largest of the above two values and use it as the appropriate footing size.
3. The foundation system brought forward can either be wood, concrete or masonry.
4. Bring forward values for the wall and footing as follows:
 - a. Depth of footing
 - b. Reinforcing bar size
 - c. Lap splice length
 - d. Reinforcing bar hook length
 - e. Size and spacing of anchor bolts
 - f. Treated wood foundation nailing requirements

700-2. HORIZONTAL ANCHORAGE IN THE TRANSVERSE DIRECTION: TRANSVERSE FOUNDATION WALLS.

A. Transverse Foundation Walls: Exterior (at unit ends) and Interior (to Underside of Chassis).

1. The number of transverse walls, wall footing sizes, anchorage requirements and foundation wall reinforcement have been determined to resist sliding, based on capacities found in Appendix C. Bring all these values forward where continuous transverse foundation walls are used.
2. The foundation system brought forward can either be wood, concrete or concrete masonry.

B. Transverse Foundation Walls Completed with Diagonal Braces.

1. Connection sizes and anchorage requirements have been determined. Bring these values forward where transverse foundation walls are completed with diagonal braces.
2. The foundation wall system brought forward can be only concrete or masonry. The galvanized steel diagonal straps connect to the top of chassis beams under the unit and to the top of masonry or concrete wall option selected.

C. Vertical X-Bracing Planes in Lieu of Walls. This applies only to Concept Design Types C1, C2, E1, E3 and E4 for either single or multi-section units.

1. Number, spacing and detailing information has been determined. Bring these values forward where vertical X-bracing planes are used.
2. The foundation system brought forward can be only galvanized steel diagonal straps connected to the top of chassis beams under the unit and to the top of concrete footings.

700-3 HORIZONTAL ANCHORAGE IN THE LONGITUDINAL DIRECTION: LONGITUDINAL FOUNDATION WALLS.

A. Longitudinal Exterior Foundation Walls - Type E or I Units.

1. Connection sizes and anchorage requirements have been determined based on capacities found in Appendix C. Bring these values forward where longitudinal exterior foundation walls are used.
2. The foundation system brought forward can be wood, concrete or masonry.

B. Vertical X-Bracing Planes under Chassis Beam Lines-Type C Units Only.

1. Number, spacing and detailing information has been determined. Bring these values forward where vertical X-bracing planes are used.
2. The foundation system brought forward can be only galvanized steel diagonal straps connected to the bottom of chassis beams under

the unit and to the top of concrete footings.

701. FINAL APPROVAL. All considerations important in the installation of the manufactured home should have been checked. If answers fall within the boundaries of this document, the foundation may be approved.

1. The first part of the document discusses the importance of maintaining accurate records of all transactions. This is essential for ensuring the integrity of the financial data and for providing a clear audit trail. The records should be kept up-to-date and should be accessible to all relevant parties.

2. The second part of the document outlines the procedures for handling incoming payments. It is important to ensure that all payments are recorded promptly and accurately. The procedures should include verifying the amount and source of the payment, and ensuring that the funds are deposited into the correct account.

3. The third part of the document describes the process for issuing invoices. Invoices should be generated and sent to customers in a timely manner. The invoices should clearly state the amount due and the terms of payment. It is also important to keep a copy of each invoice for your records.

4. The fourth part of the document discusses the process for reconciling the accounts. This involves comparing the company's records with the bank statements to ensure that they match. Any discrepancies should be investigated and resolved promptly. Reconciliation should be performed regularly to maintain the accuracy of the financial records.

5. The fifth part of the document outlines the process for preparing financial statements. These statements provide a summary of the company's financial performance over a specific period. They are essential for management decision-making and for providing information to stakeholders. The statements should be prepared accurately and on a regular basis.

6. The final part of the document discusses the importance of maintaining good communication with all parties involved in the financial process. This includes customers, suppliers, and financial institutions. Clear communication is essential for ensuring that all transactions are handled smoothly and that any issues are resolved quickly.

APPENDIX A

FOUNDATION DESIGN CONCEPT SELECTION

A-100. GENERAL. The foundation systems presented in this section were condensed from over 40 systems submitted by the manufactured housing industry. When a number of systems were similar in their detailing and the way they distributed loads, the system that was most representative of that group was selected for presentation in this section. Many variations from the detailing shown here are possible.

Some of the original systems are not included. The most common reason for rejecting a foundation system was lack of positive vertical anchorage. The superstructures of manufactured homes are too light to rely upon their mass to provide all resistance to overturning and uplift and must rely on the assist of their foundation to achieve adequate resistance.

A-100.1. IDENTIFICATION OF ACCEPTABLE FOUNDATION DESIGN CONCEPTS. The foundation systems are organized by the pattern of superstructure support and vertical anchorage. These two issues have been used to characterize the types of systems used in the Foundation tables: Types C, E, and I. There are no Type I systems presented in this chapter only because none were submitted by the industry for consideration. Type I systems were included in the Foundation Design tables due to their potential use. Their absence is not intended to imply that such systems are not viable, only that none are currently in use.

A-100.2. DELETIONS FROM THE FIRST EDITION. Concept E2 was deleted from this revision. It does not meet the permanent foun-

ation criteria outlined in section 100-1.C. Specifically concrete footings are required for all foundation systems. It has been left in this Appendix but crossed out as a reminder to field officers of its inability to perform to the standard of this document.

A-100.3. LOADS THAT GOVERN. In many cases, the wind forces govern over seismic inertia forces in the design of foundation systems for manufactured homes. However, there are high seismic activity areas where seismic inertia forces control over wind. The detailing of some systems is better suited to regions with such high seismic activity. The selection of systems suitable for use in high seismic regions is based upon complete continuity in the connections between the superstructure and the foundation (and all its parts).

A-100.4. ECONOMIC FACTORS. Economics are not addressed in identifying the regional applicability of the different systems. Some systems would become economically unfeasible in regions with higher wind loads due to the size and depth required for their elements to provide anchorage. It is assumed that those who use this handbook as a design tool will discover the economic limitations of specific foundation systems on a case by case basis.


A-100.5. SELECTION TABLE. The table immediately following can be used to select appropriate foundation types for sites with special requirements.

Table A - 1
FOUNDATION SELECTION TABLE


Foundation Type	High Wind Zone			Engineering Design Required			Seismic Zone			Frost Zone
	All	Some	None	Yes	No	Maybe	All	Some	None	
C1 Reinforced masonry piers w/wire tie-downs & diagonal tie		X				X		X		
C2 Reinforced masonry or concrete piers	X				X		X			X
C3 Isolated deep piers	X			X			X			X
C4 Mat slab w/isolated piers	X			X			X			X
E1 Reinforced perimeter wall, unreinforced piers at chassis			X		X			X		X
E2 Treated wood perimeter wall on gravel, unanchored metal piers			X		X			X		X
		DELETED See E8								
E3 Reinforced masonry or concrete perimeter walls & piers	X				X		X			X

Foundation Type	High Wind Zone			Engineering Design Required			Seismic Zone			Frost Zone
	All	Some	None	Yes	No	Maybe	All	Some	None	
E4 Reinforced perimeter walls & piers w/transverse footings	X					X	X			X
E5 Reinforced perimeter basement wall w/transverse steel girders	X					X	X			X
E6 Perimeter grade beam on deep piers w/transverse steel girders	X			X			X			X
E7 Reinforced concrete perimeter wall w/transverse steel girders	X					X	X			X
E8 Treated wood perimeter wall on concrete footing w/unanchored metal pier			X			X		X		X

FOUNDATION TYPE Reinforced masonry or treated wood	SYSTEM NUMBER C, E, I
SUPERSTRUCTURE TYPE Chassis or chassis and wall supported single & multi-wide	

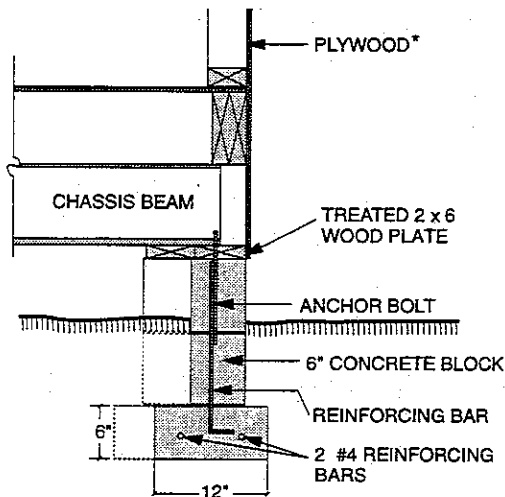


CHASSIS BEAM EXTENDS TO FOUNDATION WALL

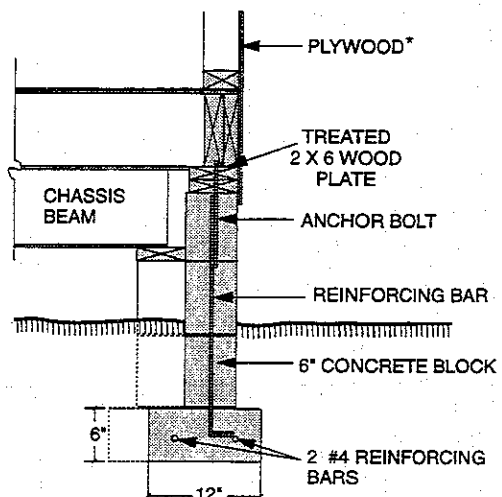


CHASSIS BEAM STOPS SHORT OF FOUNDATION WALL

END TRANSVERSE FOUNDATION SHEAR WALLS

TRANSVERSE INTERIOR FOUNDATION SHEAR WALLS

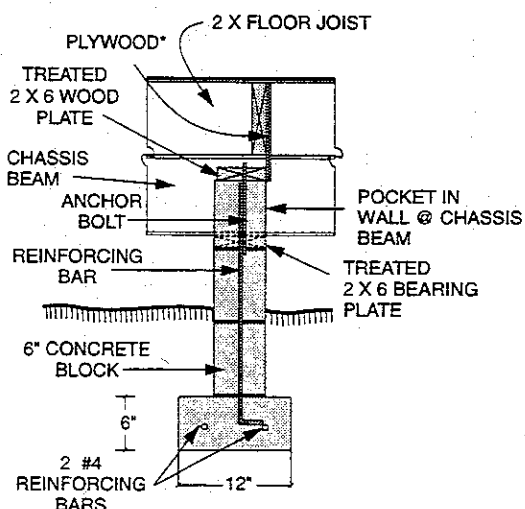



PLYWOOD CONNECTOR TO FOUNDATION WALL

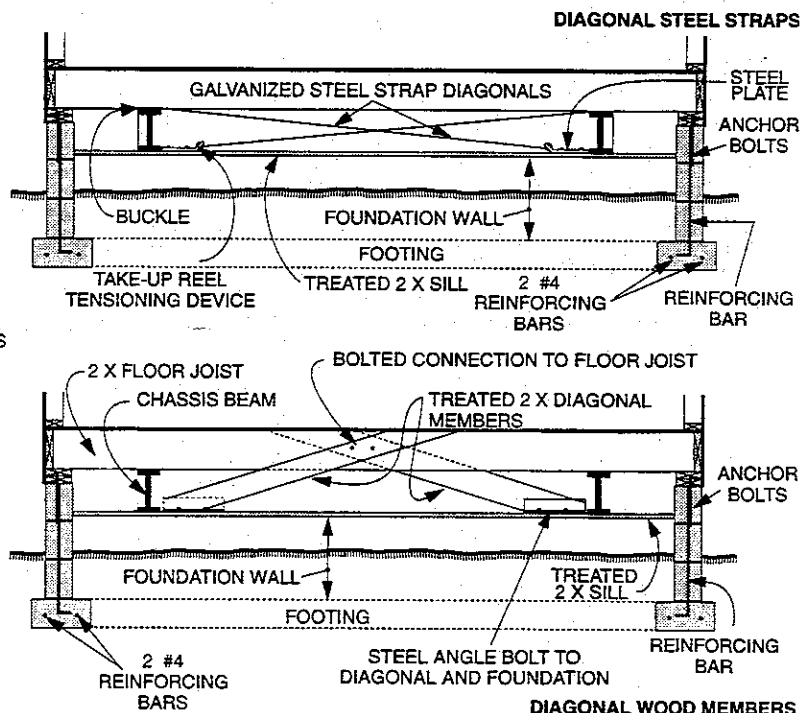

* SEE APPENDIX C FOR PLYWOOD NAILING REQUIREMENTS


FOUNDATION TYPE Reinforced masonry piers w/ wire tie downs and diagonal tie	SYSTEM NUMBER C1
SUPERSTRUCTURE TYPE Chassis supported single-wide	

SINGLE-WIDE

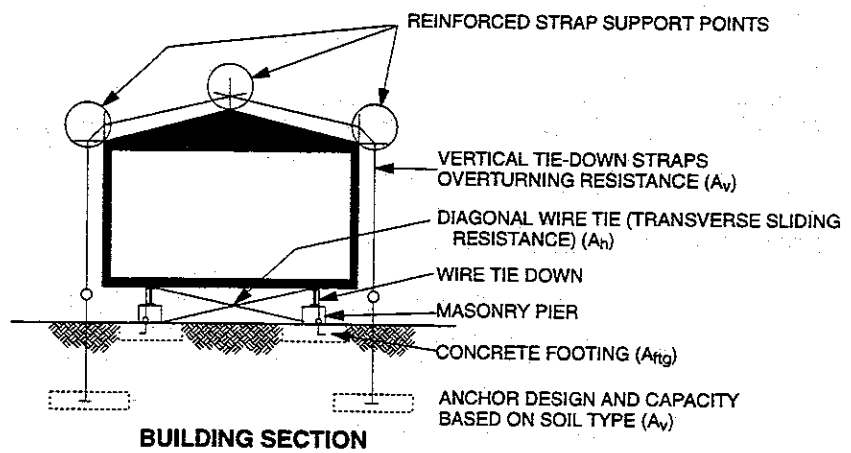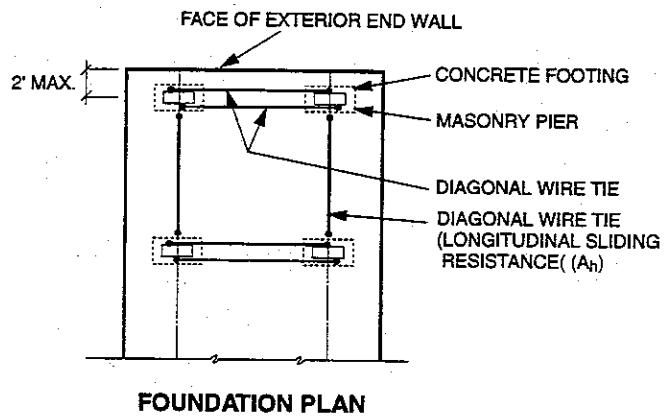

NOTE: TYPICAL STEEL TIE-DOWN STRAP: 1/32" X 1-1/4"
 MINIMUM BREAKING TENSION STRENGTH = 4750 LB (ULTIMATE LOAD)
 (ASTM D3953-83) OR
 FEDERAL QQ-S-781G

FOUNDATION TYPE Reinforced masonry piers w/ wire tie downs and diagonal tie	SYSTEM NUMBER C1
SUPERSTRUCTURE TYPE Chassis supported single-wide	

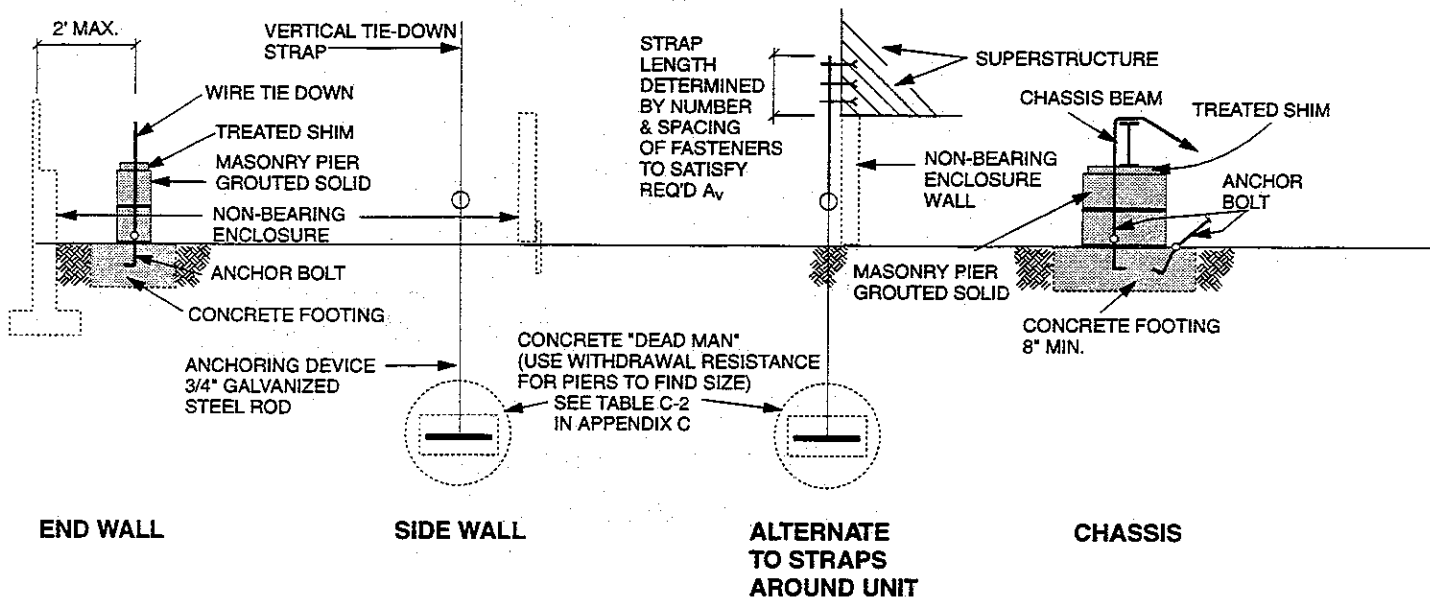

C1

TABLES

Use single-wide Type C for required footing areas (A_{ftg}).

Use single-wide Type C1 for vertical anchorage (A_v).

Use single-wide Type C, E, I for transverse and longitudinal sliding anchorage (A_h).

REGIONAL APPLICATIONS


1. Requires installation by qualified installers.
2. Not suitable for high wind conditions and seismic $A_v \geq 0.3$. Requires design by registered engineer.
3. Not suitable for high frost penetration depth.

NOTES

1. Anchoring device is a 3/4" diameter hot dipped galvanized steel rod embedded into a block of concrete. Refer to Appendix B and C for concrete block size and depth.
2. Capacity of diagonal wires is most effective when located at manufactured home end and interior transverse shear walls which should align with chassis beam pier locations.
3. Guidance for design of transverse and longitudinal x-bracing options to resist sliding is found in Figures 6-4 and 6-10 and Figures 6-6 and 6-11 respectively. Requires design and detailing by a registered engineer.
4. Screw-in-ground anchors are not permitted as permanent foundation anchorage.


FOUNDATION TYPE Reinforced masonry or concrete piers	SYSTEM NUMBER C2
SUPERSTRUCTURE TYPE Chassis supported single- and multi-wide	

SINGLE-WIDE

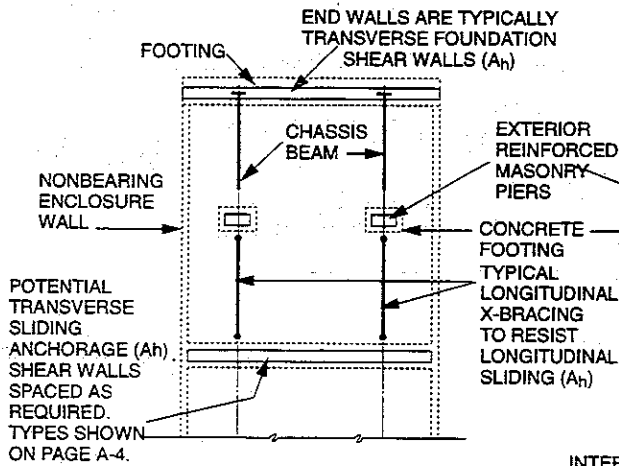


FOUNDATION PLAN

MULTI-WIDE

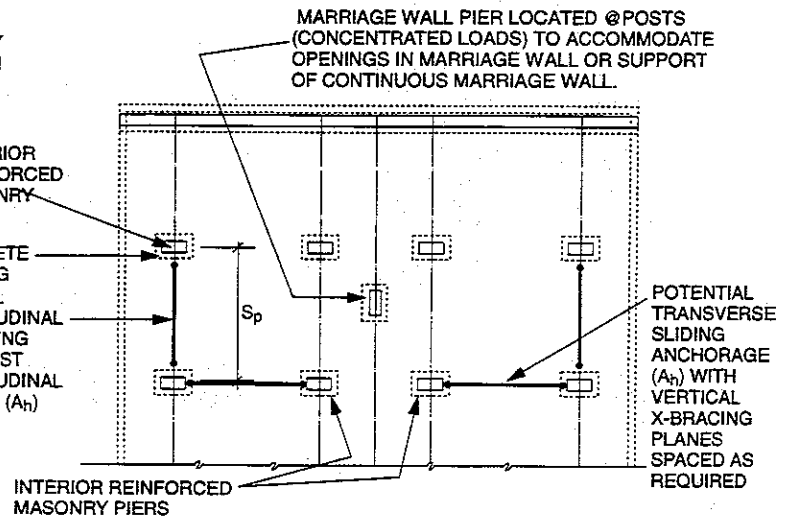


FOUNDATION PLAN

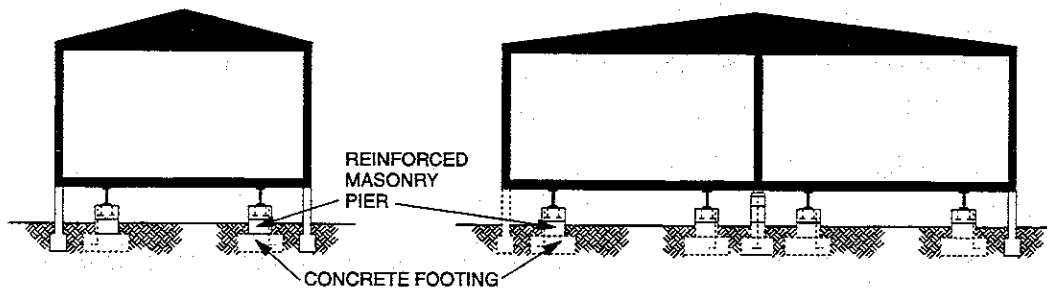

BUILDING SECTION

BUILDING SECTION

FOUNDATION TYPE Reinforced masonry or concrete piers	SYSTEM NUMBER C2
SUPERSTRUCTURE TYPE Chassis supported single- and multi-wide	

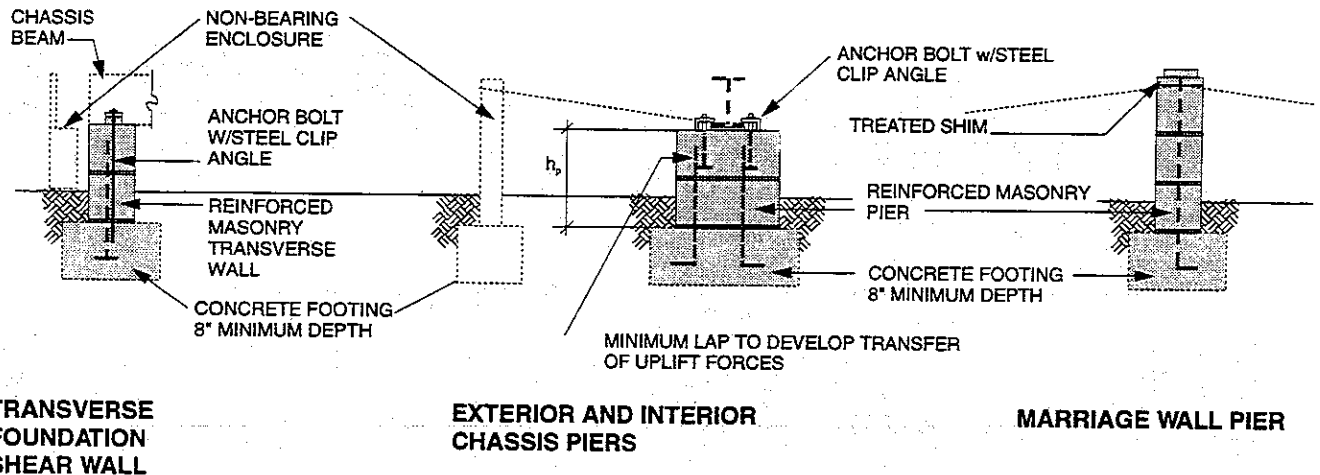

C2

TABLES

Use C tables for required effective footing area (A_{ftg}) for single-wide and multi-wide units.
 Use Cnw tables if there are no marriage wall piers.
 Use C tables for vertical anchorage (A_v).
 Use C, E, I tables for transverse and longitudinal sliding anchorage (A_h) for single-wide and multi-wide units.

REGIONAL APPLICATIONS

1. Suitable for all seismic zones with proper footing size and depth.
2. Suitable for all wind regions with proper footing size and depth.
3. Suitable in areas with high frost penetration with proper footing depth.


NOTES

1. Chassis may be anchored to resist overturning and uplift either with anchor bolt with clamps, as pictured, or weld plates as shown in system C3.
2. Horizontal sliding in the transverse direction can be resisted by foundation shear walls as shown, or alternately by several x-bracing options shown in Figures 6-4 and 6-10.
3. Horizontal sliding in the longitudinal direction is best accommodated with pairs of x-bracing as shown in Figures 6-6 and 6-11.
4. Design details for items 2 and 3 shall be prepared by a registered engineer.

FOUNDATION TYPE Isolated deep piers	SYSTEM NUMBER C3
SUPERSTRUCTURE TYPE Chassis supported single- and multi-wide	


SINGLE-WIDE

MULTI-WIDE

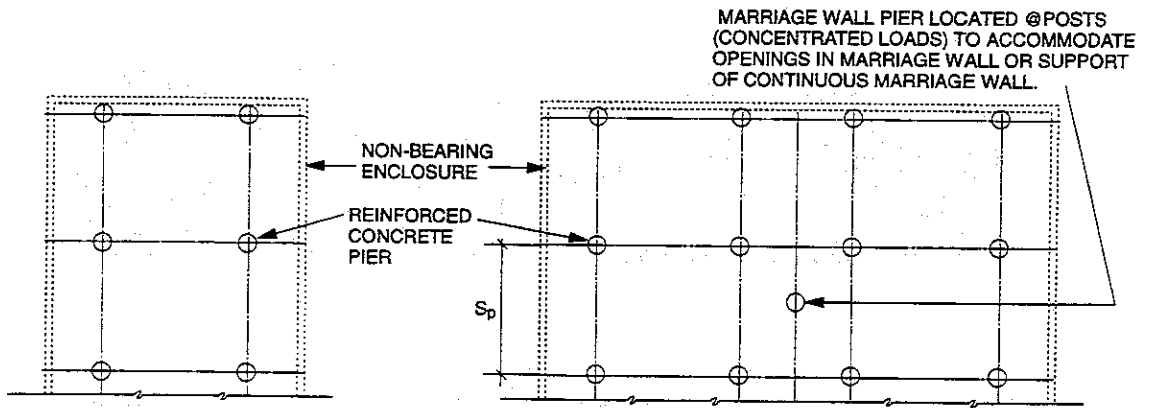

FOUNDATION PLAN


FOUNDATION PLAN

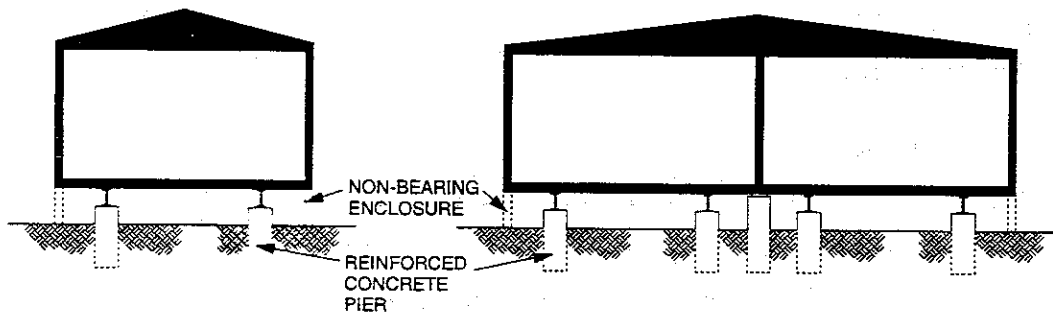

BUILDING SECTION

BUILDING SECTION

FOUNDATION TYPE Isolated deep piers	SYSTEM NUMBER C3
SUPERSTRUCTURE TYPE Chassis supported single- and multi-wide	

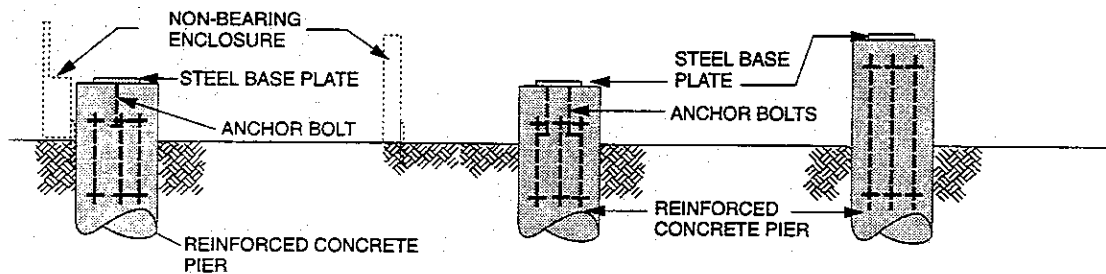

**TRANSVERSE
END CHASSIS
PIER**

**EXTERIOR AND INTERIOR
CHASSIS PIERS**

MARRIAGE WALL PIER

C3

TABLES

Use C tables for required effective footing area (A_{ftg}) for single-wide and multi-wide units.
 Use C_{nw} tables if there are no marriage wall piers.
 Use C tables for vertical anchorage (A_v).
 Use C, E, I tables for transverse and longitudinal sliding anchorage (A_h) for single-wide and multi-wide units.

REGIONAL APPLICATIONS


1. Suitable in permafrost conditions with non-insulated side enclosures.
2. Suitable in any wind or seismic region with proper design.
3. Suitable in areas with high frost penetration with proper footing depth.
4. Design of piers by registered architect or engineer required in all cases. Piers to resist horizontal sliding in transverse and longitudinal directions (A_h) by bending resistance and interaction with the soil.

ACCEPTABLE ALTERNATIVES


1. Chassis may be anchored either with weld plate as pictured, or anchor bolts with clamps as in system C2. as shown in system C3.

FOUNDATION TYPE Mat slab w/ isolated piers	SYSTEM NUMBER C4
SUPERSTRUCTURE TYPE Chassis supported single-wide	

SINGLE-WIDE

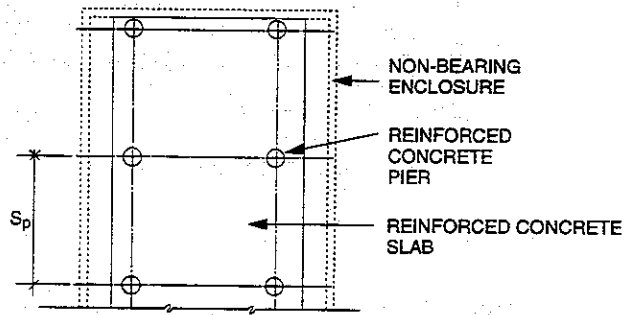


FOUNDATION PLAN

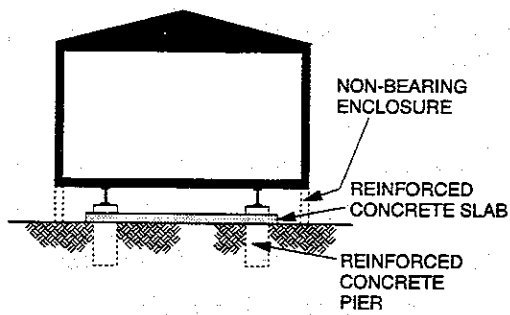

BUILDING SECTION

FOUNDATION TYPE Mat slab w/ isolated piers	SYSTEM NUMBER C4
SUPERSTRUCTURE TYPE Chassis supported single-wide	

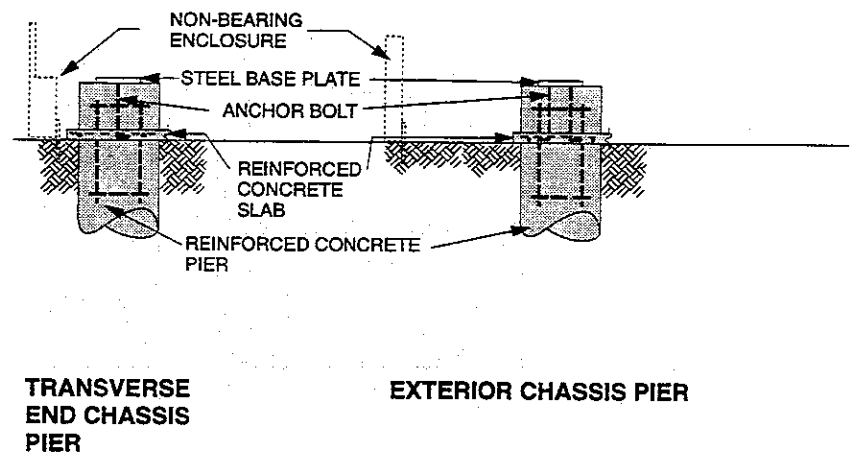

C4

TABLES

Use C tables for required effective footing area (A_{ft0}) for single-wide and multi-wide units.
 Use Cnw tables if there are no marriage wall piers.
 Use C tables for vertical anchorage (A_v).
 Use C, E, I tables for transverse and longitudinal sliding anchorage (A_h) for single-wide and multi-wide units.

REGIONAL APPLICATIONS

1. Useful in poor soil conditions with proper design by registered architect or engineer.
2. Suitable in any wind or seismic region with proper design.
3. Suitable in areas with high frost penetration with proper footing depth.
4. Design by registered architect or engineer required in all cases.



ACCEPTABLE ALTERNATIVES

1. Chassis may be anchored either with weld plate as pictured, or anchor bolts with clamps as in system C2.


FOUNDATION TYPE Reinforced perimeter wall, unreinforced piers at chassis	SYSTEM NUMBER
SUPERSTRUCTURE TYPE Exterior anchored, chassis supported single- and multi-wide	E1

SINGLE-WIDE

MULTI-WIDE

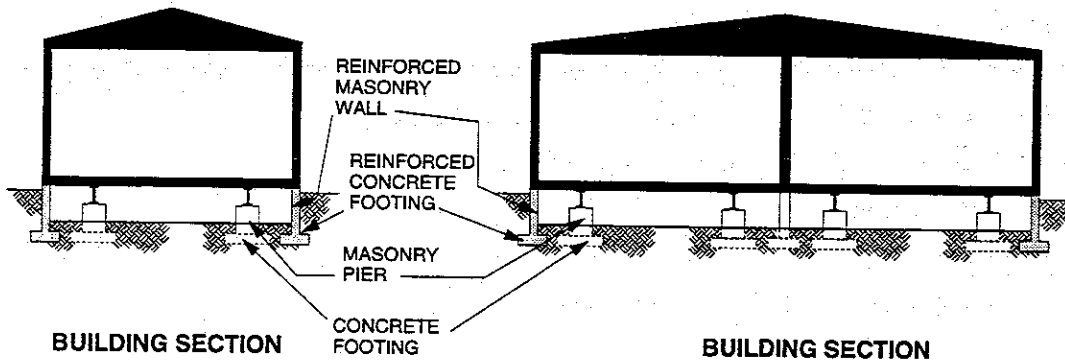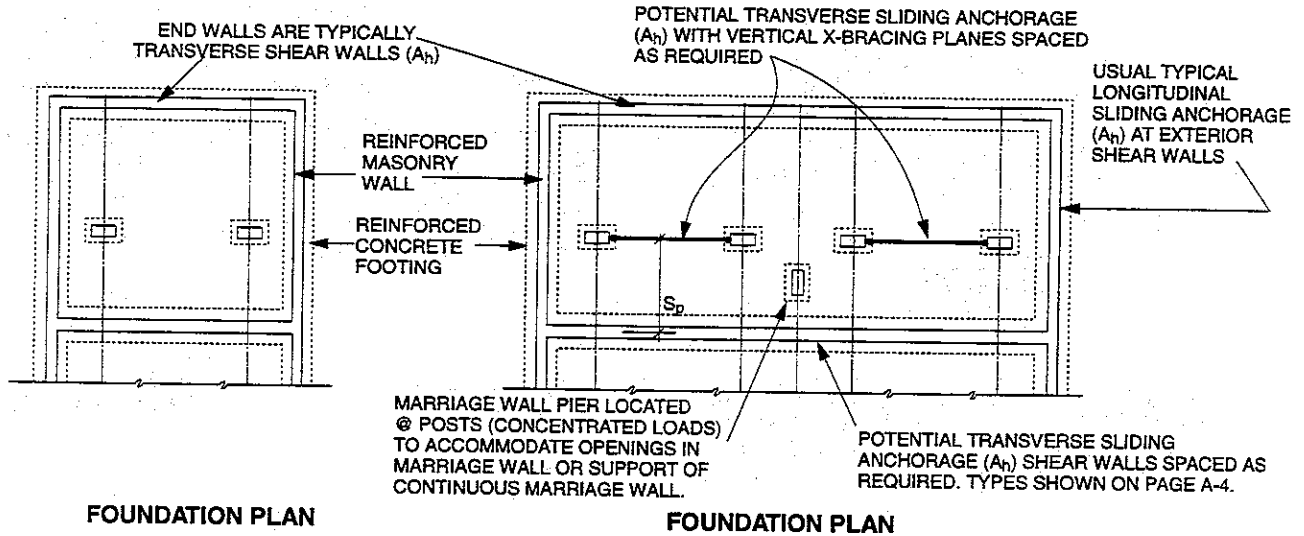


FOUNDATION TYPE Reinforced perimeter wall, unreinforced piers at chassis	SYSTEM NUMBER
SUPERSTRUCTURE TYPE Exterior anchored, chassis supported single- and multi-wide	E1

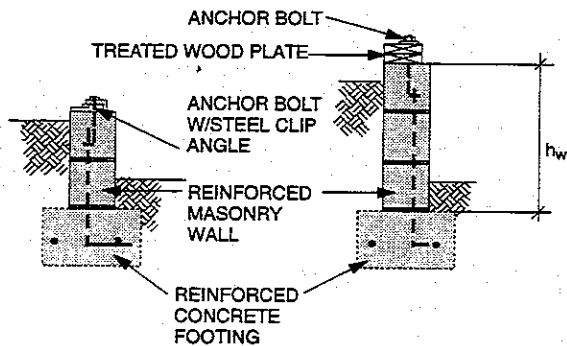

**END TRANSVERSE
FOUNDATION
SHEAR WALL**

**LONGITUDINAL
FOUNDATION
SHEAR WALL**

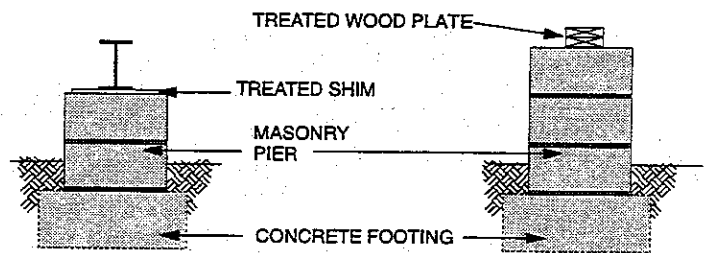

CHASSIS PIER

MARRIAGE WALL PIER

E1

TABLES

Use type E, I tables for required effective footing area (A_{fg}) for single-wide or multi-wide units.
 Use type E tables for vertical anchorage (A_v) for single and multi-wide units.
 Use type C, E, I tables for transverse and longitudinal sliding anchorage (A_h) for single-wide and multi-wide units.

REGIONAL APPLICATIONS

1. Requires solid concrete or fully grouted block and sufficient depth in coastal regions with wind speed (V) greater than 90 mph.
2. Not recommended in seismic areas $A_v = 0.3$ or 0.4 unless use reinforced piers.
3. Suitable in areas with high frost penetration with proper footing depth.
4. Suitable for most "normal" soil conditions.

ACCEPTABLE ALTERNATIVES

1. Treated wood perimeter wall anchored to concrete spread footing.


NOTES

1. Horizontal sliding in the transverse direction can be resisted by foundation shear walls as shown in plan, or alternately by several x-bracing options shown in Figures 6-4 and 6-10.
2. Horizontal sliding in the longitudinal direction is best accommodated by the exterior walls as shear walls.
3. Design details for item 1 shall be prepared by a registered engineer.

FOUNDATION TYPE Treated wood perimeter wall on gravel, unanchored metal piers	SYSTEM NUMBER E2
SUPERSTRUCTURE TYPE Exterior anchored, chassis supported single- and multi-wide	


SINGLE-WIDE

MULTI-WIDE

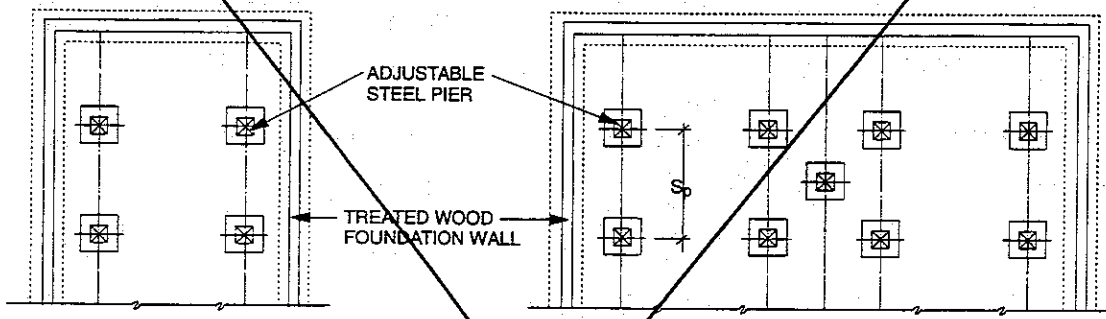

FOUNDATION PLAN

FOUNDATION PLAN

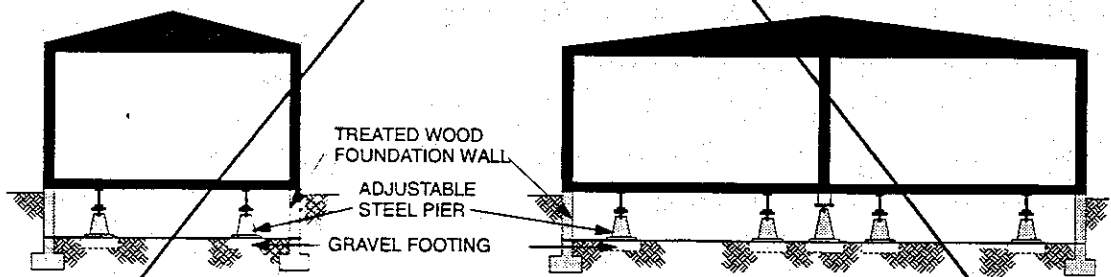


BUILDING SECTION

BUILDING SECTION

SYSTEM CANNOT BE USED-NOT A PERMANENT FOUNDATION

FOUNDATION TYPE Treated wood perimeter wall on gravel, unanchored metal piers	SYSTEM NUMBER E2
SUPERSTRUCTURE TYPE Chassis supported single- and multi-wide	

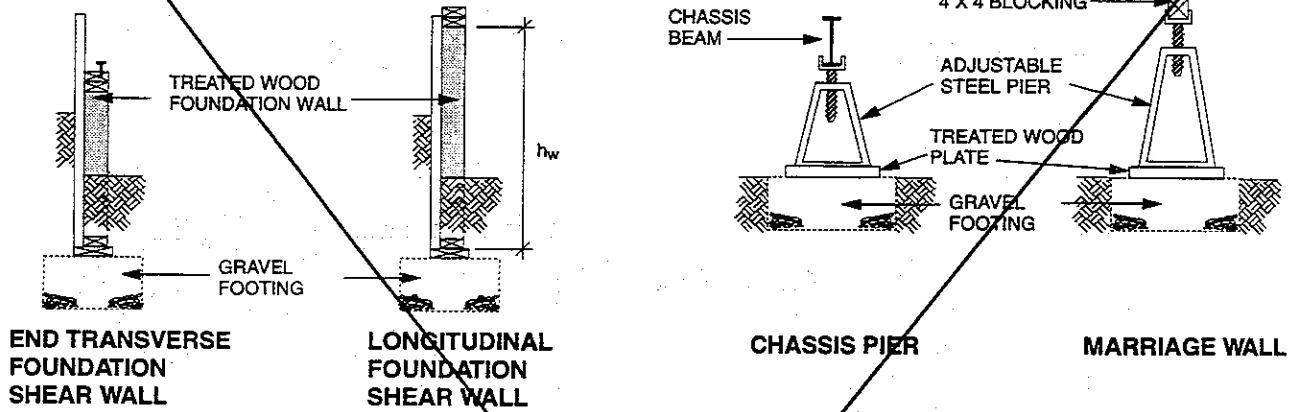

E2

TABLES

Use type E tables for required effective footing area (A_{fg}), vertical anchorage (A_v), and horizontal sliding anchorage (A_h) in the transverse and longitudinal directions for single and multi-wide units.

REGIONAL APPLICATIONS



1. Not suitable in high wind areas. Consult tables for exact limitations.
2. Not suitable in seismic areas where $A_v = 0.3$ or 0.4 .
3. Suitable in areas with high frost penetration with proper footing depth.
4. Not recommended in areas of high termite action unless wood is pressure treated.
5. Below-grade fasteners must be stainless steel.

SYSTEM CANNOT BE USED-NOT A PERMANENT FOUNDATION


FOUNDATION TYPE Reinforced masonry or concrete perimeter walls and piers	SYSTEM NUMBER E3
SUPERSTRUCTURE TYPE Exterior and chassis anchored single- or multi-wide	

SINGLE-WIDE

MULTI-WIDE

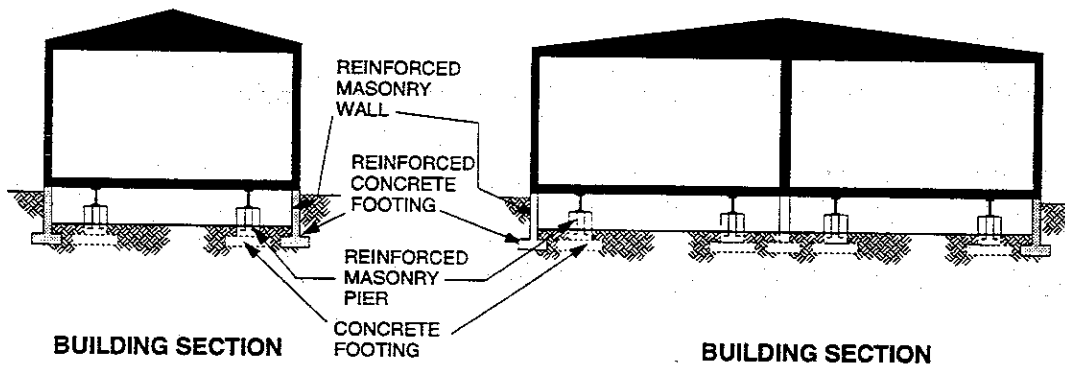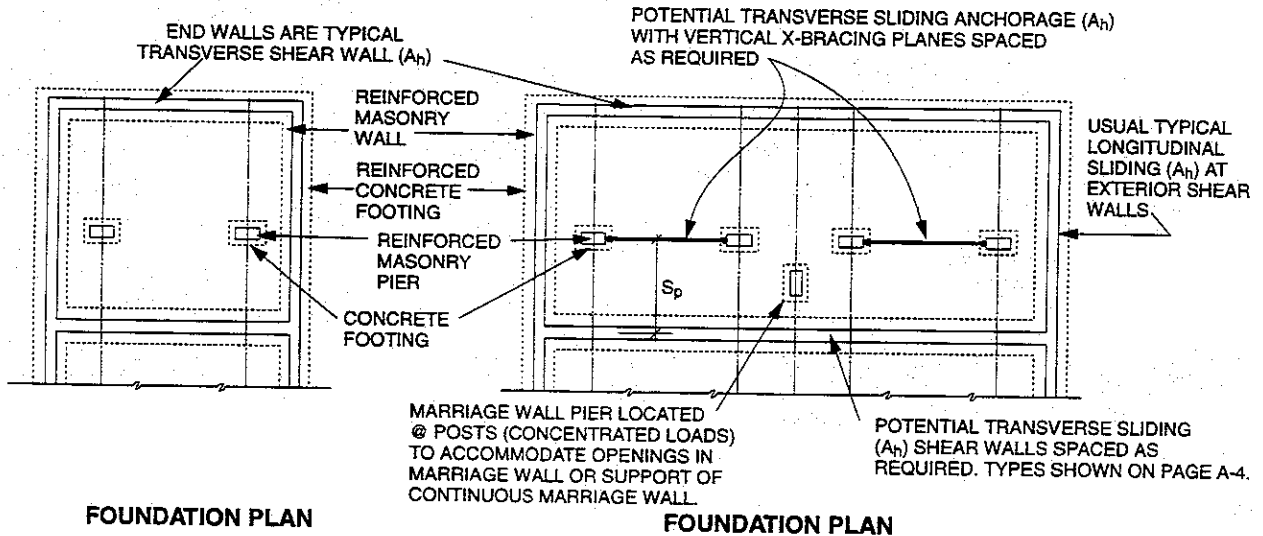

FOUNDATION TYPE Reinforced masonry or concrete perimeter walls and piers	SYSTEM NUMBER
SUPERSTRUCTURE TYPE Exterior and chassis anchored single- and multi-wide	E3

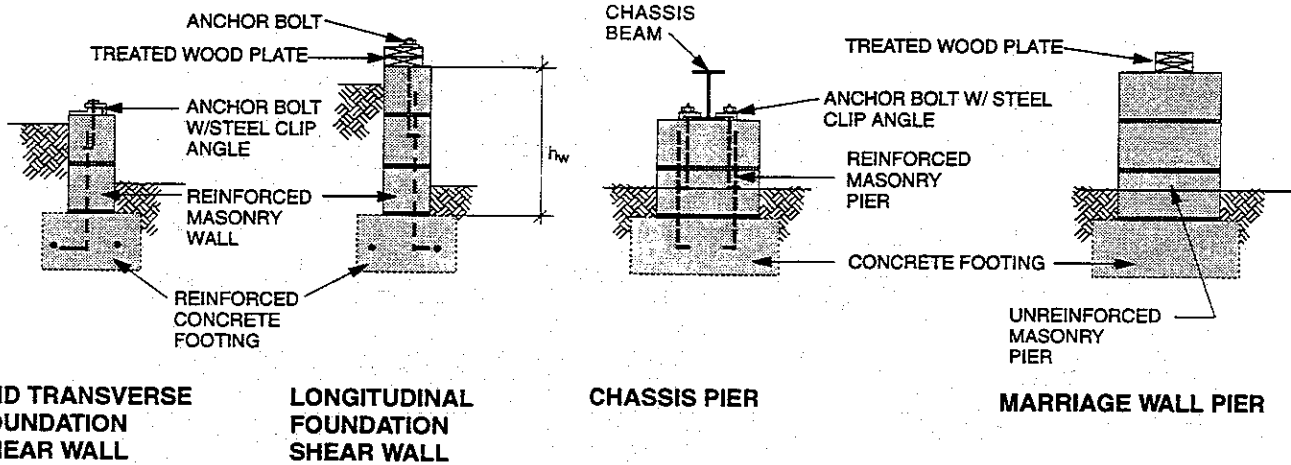

E3

TABLES

Use type E, I tables for required effective footing area (A_{ftg}) for single-wide and multi-wide units.
 For vertical anchorage (A_v) for single-wide units use Type E3 table.
 For vertical anchorage (A_v) for multi-wide units use Type E and apply magnitude at exterior pier, and also to interior pier.
 Use type C, E, I tables for transverse and longitudinal sliding anchorage (A_h) for single-wide and multi-wide units.

REGIONAL APPLICATIONS

1. Suitable in all wind and seismic regions under "normal" soil conditions. Reinforced piers required for seismic areas $A_v = 0.3$ and 0.4 .
2. Suitable in areas with high frost penetration.

ACCEPTABLE ALTERNATIVES


1. Chassis beam may be anchored with weld plates as pictured in system C3.

NOTES


1. Anchor bolts and clip angles are required at interior and exterior piers.
2. Horizontal sliding in the longitudinal direction is best accommodated by the exterior walls as shear walls.
3. Horizontal sliding in the transverse direction can be resisted by foundation shear walls as shown, or alternately by several x-bracing options shown in Figures 6-4 and 6-10.

FOUNDATION TYPE Reinforced masonry perimeter walls and piers w/transverse footings	SYSTEM NUMBER
SUPERSTRUCTURE TYPE Chassis supported single-wide	E4

SINGLE-WIDE

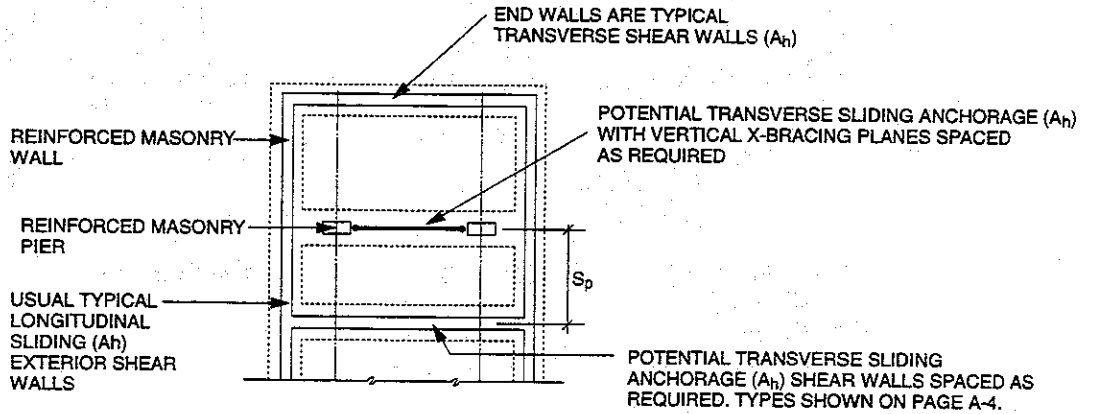


FOUNDATION PLAN

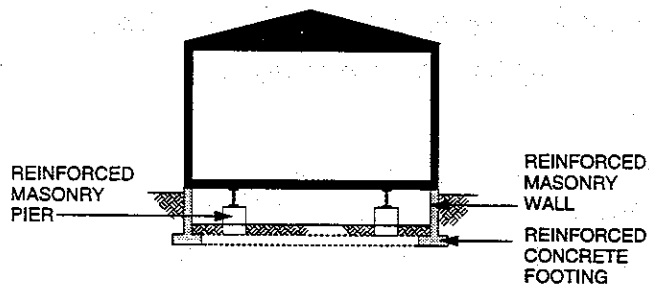

BUILDING SECTION

FOUNDATION TYPE Reinforced masonry perimeter walls and piers w/transverse footings	SYSTEM NUMBER
SUPERSTRUCTURE TYPE Chassis supported single-wide	E4

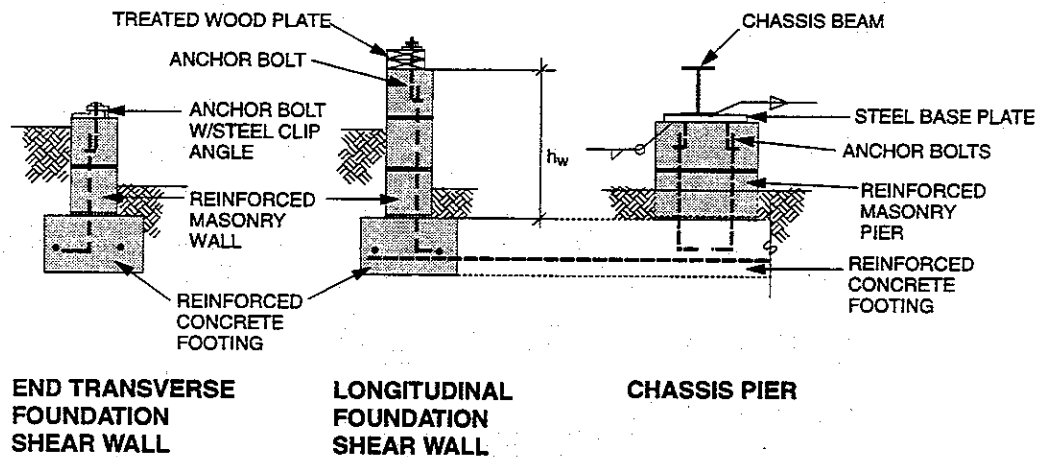

E4

TABLES

Use type E, I tables for required effective footing area (A_{ftg}) for single-wide units.
 For vertical anchorage (A_v) for single-wide units use Type E table.
 Use type C, E, I tables for transverse and longitudinal sliding anchorage (A_h) for single-wide units.

REGIONAL APPLICATIONS

1. Suitable in all wind and seismic zones under "normal" soil conditions. Reinforced piers required for seismic areas with $A_v = 0.3$ and 0.4 .
2. Suitable in problem soils with proper design by registered architect or engineer.
3. Suitable in areas with high frost penetration with proper footing depth.

ACCEPTABLE ALTERNATIVES


1. Continuous longitudinal footings at piers.
2. Anchor bolts with clamps instead of weld plates.

NOTES


1. Steel base plate optional. If used to provide an additional factor of safety, use A_v divided by 2 to determine the footing size and reinforcing for withdrawal capacity.
2. Horizontal sliding in the longitudinal direction is best accommodated by the exterior walls as shear walls.
3. Horizontal sliding in the transverse direction can be resisted by foundation shear walls as shown, or alternately by several x-bracing options shown in Figures 6-4 and 6-10.

FOUNDATION TYPE Reinforced concrete perimeter foundation wall w/ transverse steel girders	SYSTEM NUMBER
SUPERSTRUCTURE TYPE Exterior and chassis anchored multi-wide	E5

MULTI-WIDE

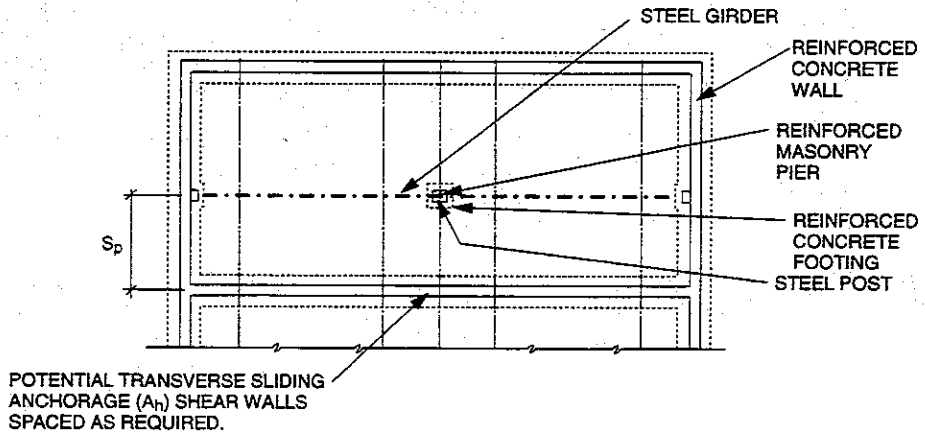


FOUNDATION PLAN

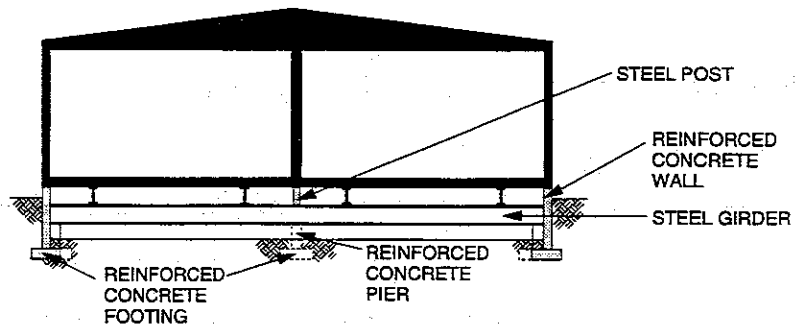

BUILDING SECTION

FOUNDATION TYPE Reinforced concrete perimeter foundation wall w/transverse steel girders	SYSTEM NUMBER E5
SUPERSTRUCTURE TYPE Exterior and chassis anchored multi-wide	

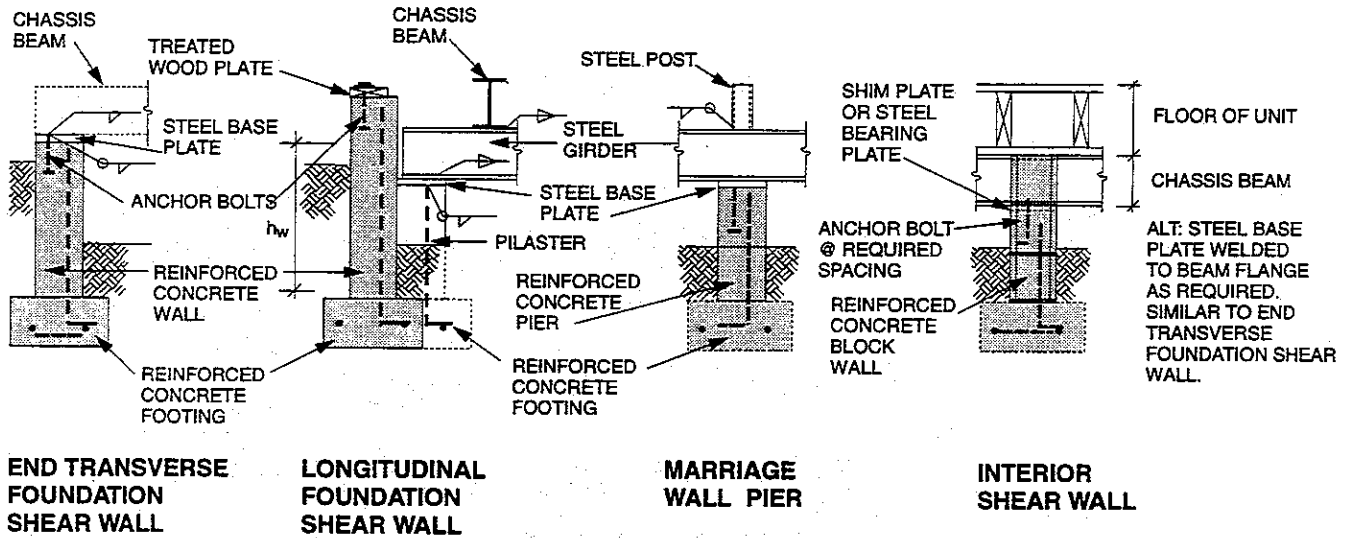

E5

TABLES

Use multi-wide type E5 tables for required effective pier footing area (A_{ftg}) and exterior wall footing width (A_{ftg}).

Use multi-wide type E tables for vertical anchorage (A_v).

Use multi-wide type C, E, I tables for horizontal anchorage (A_h) due to sliding in the transverse end longitudinal direction.

REGIONAL APPLICATIONS

1. Suitable in high wind and seismic regions under "normal" soil conditions.
2. Suitable in areas with high frost penetration with proper footing depth.

ACCEPTABLE ALTERNATIVES


1. Reinforced concrete block acceptable though coursing may be difficult to resolve.

NOTES


1. Horizontal sliding in the longitudinal direction is best accommodated at the exterior foundation walls.
2. Horizontal sliding in the transverse direction is best handled by reinforced poured concrete or concrete block shear walls @ end of unit and at interior locations as required. See details above.
3. Transverse girders to be designed by licensed professional.

FOUNDATION TYPE Perimeter concrete grade beam on deep piers w/ transverse steel girders	SYSTEM NUMBER E6
SUPERSTRUCTURE TYPE Chassis supported multi-wide	

MULTI-WIDE

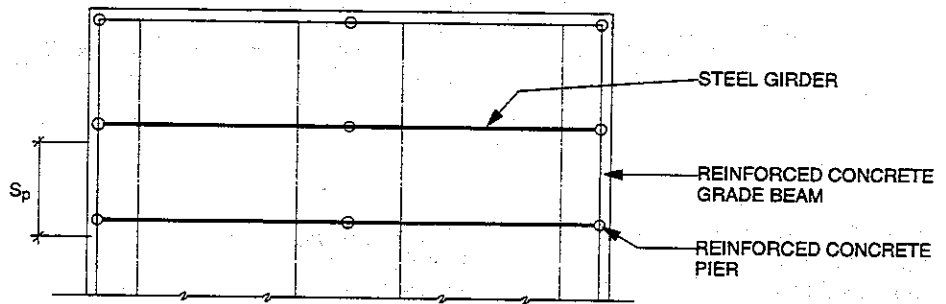


FOUNDATION PLAN

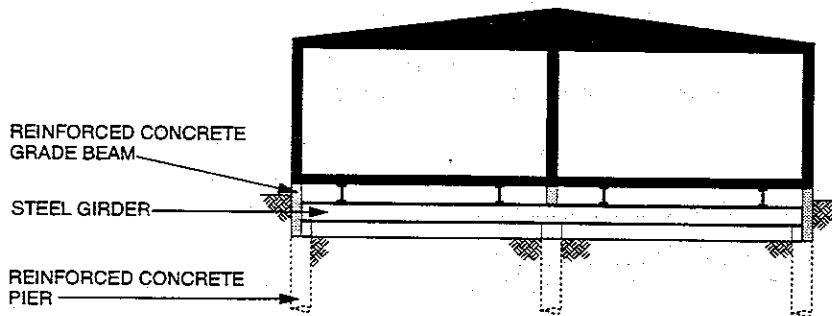

BUILDING SECTION

FOUNDATION TYPE Perimeter concrete grade beam on deep piers w/ transverse steel girders	SYSTEM NUMBER E6
SUPERSTRUCTURE TYPE Chassis supported multi-wide	

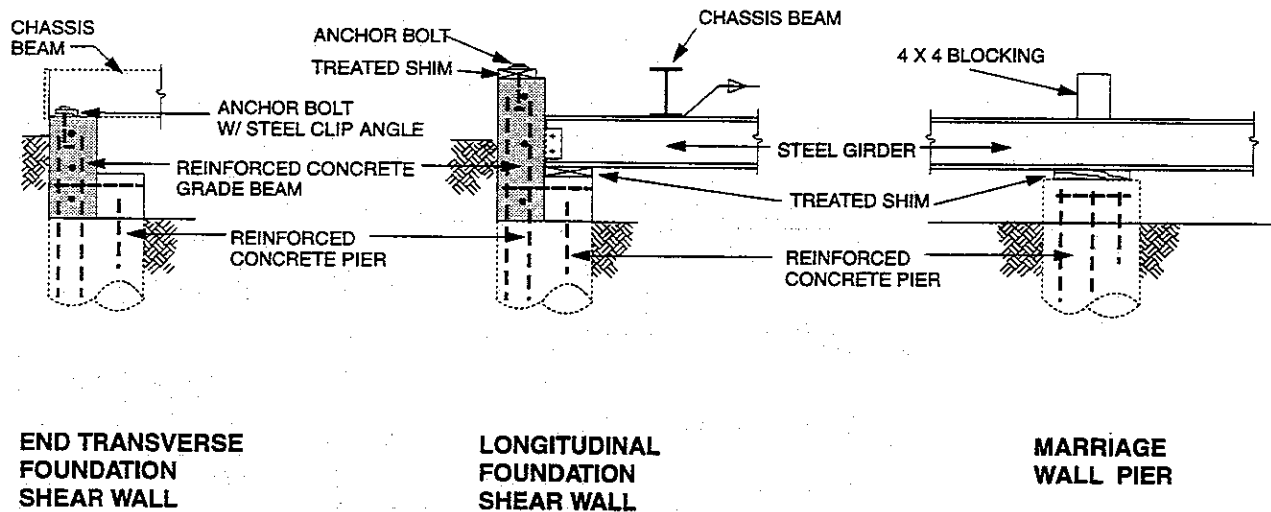

E6

TABLES

Use multi-wide type E5 tables for required effective pier footing area (A_{ftg}) and exterior wall footing width (A_{ftg}).

Use multi-wide type E tables for vertical anchorage (A_v).

Use multi-wide type C, E, I tables for horizontal anchorage (A_h) due to sliding in the transverse and longitudinal direction.

REGIONAL APPLICATIONS


1. Suitable in high wind and seismic zones with proper design.
2. Suitable in high frost areas with proper location or design of bottom of grade beam.

NOTES


1. Requires design by registered architect or engineer in **all** cases.
2. Horizontal sliding anchorage (A_h) in the longitudinal direction is best accommodated at exterior grade beams with moment transfer to the deep piers and lateral soil bearing.
3. Horizontal sliding anchorage (A_h) in the transverse direction is best accommodated by transfer of the sliding force to the steel girders, to steel base plates (instead of treated shim) and then to the deep piers in bending and lateral soil bearing.

FOUNDATION TYPE Reinforced masonry perimeter basement wall w/ transverse steel girders	SYSTEM NUMBER
SUPERSTRUCTURE TYPE Exterior and chassis anchored multi-wide	E7

MULTI-WIDE

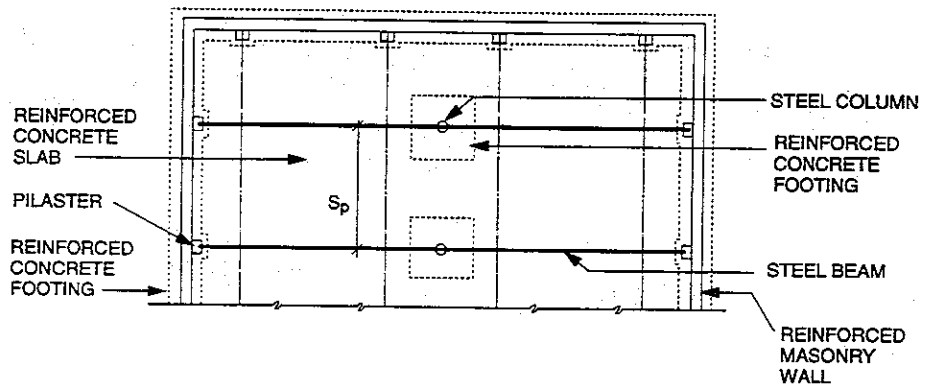


FOUNDATION PLAN

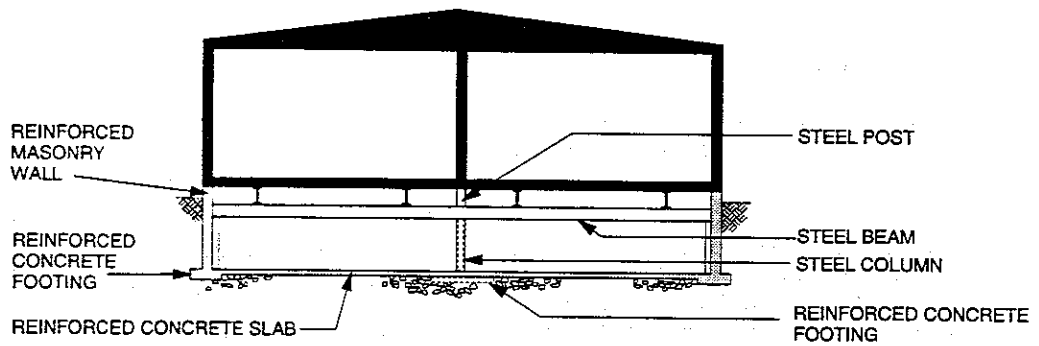

BUILDING SECTION

FOUNDATION TYPE Reinforced masonry perimeter basement wall w/transverse steel girders	SYSTEM NUMBER E7
SUPERSTRUCTURE TYPE Exterior and chassis anchored multi-wide	

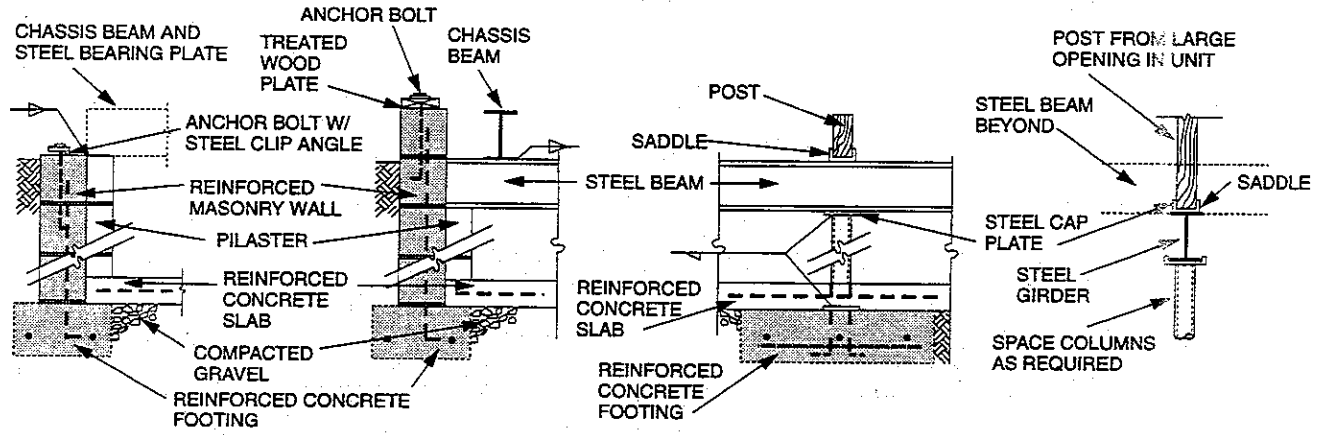

END TRANSVERSE FOUNDATION SHEAR WALL

LONGITUDINAL FOUNDATION SHEAR WALL

MARRIAGE WALL COLUMN

MARRIAGE WALL ALTERNATE IF GIRDER USED

E7

TABLES

Use multi-wide type E7 tables for required effective pier footing area (A_{ftg}) and exterior wall footing width (A_{ftg}).
 Use multi-wide type E tables for vertical anchorage (A_v).
 Use multi-wide type C, E, I tables for horizontal anchorage (A_h) due to sliding in the transverse end longitudinal direction.
 Multiply (A_{ftg}) by allowable soil bearing pressure to obtain column load in pounds.

REGIONAL APPLICATIONS

1. Suitable in high wind and seismic regions.
2. Suitable in areas with high frost penetration.

ACCEPTABLE ALTERNATIVES

1. Solid reinforced concrete walls.
2. Partially reinforced, grouted masonry wall, as required.
3. All-Weather-Wood walls anchored to spread concrete footing.
4. All-Weather-Wood walls on gravel base suitable in low wind and low seismic areas.


NOTES

1. Requires drain tile, granular backfill and moisture-proofing membrane for basement fill.
2. Requirements for reinforced concrete and masonry walls and All-Weather-Wood wall design based on local soil conditions. Requires engineered design.
3. Engineering design required if central steel girder desired under marriage wall and below steel transverse beams, to reduce number of basement columns. Footings will need to be resized as well. Central steel girder may also be required to carry posts from large openings along marriage wall. See detail above. Use multi-section C tables to obtain marriage wall post location required effective footing area (A_{ftg}). Divide (A_{ftg}) by the allowable soil pressure and subtract the marriage wall pier weight used to obtain the post load in pounds for design of the girder.
4. Horizontal sliding anchorage force (A_h) in the longitudinal direction is best accommodated by the exterior longitudinal walls.
5. Horizontal sliding anchorage force (A_h) in the transverse direction is best accommodated by the transfer from the chassis beams anchored and bearing on the perimeter pilasters. The horizontal force thus is resisted by the passive soil pressure. Engineering design is required to base design on existing soil conditions.

FOUNDATION TYPE Treated wood perimeter wall on concrete footing w/ unanchored metal pier	SYSTEM NUMBER E8
SUPERSTRUCTURE TYPE Chassis supported single- and multi-wide	


SINGLE-WIDE

MULTI-WIDE

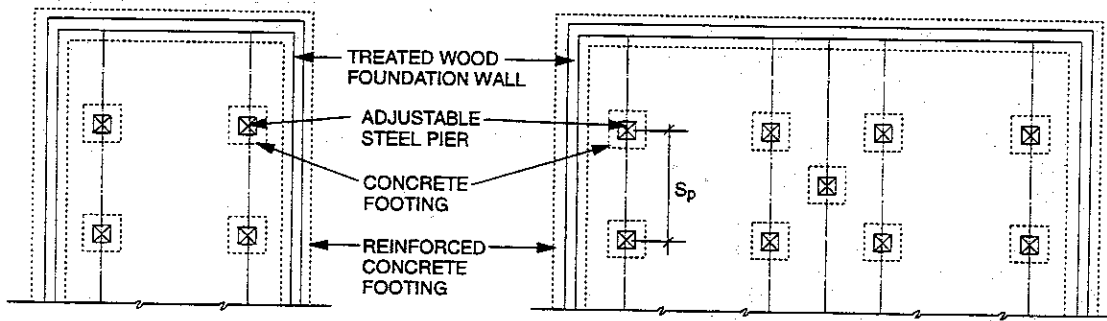

FOUNDATION PLAN




FOUNDATION PLAN

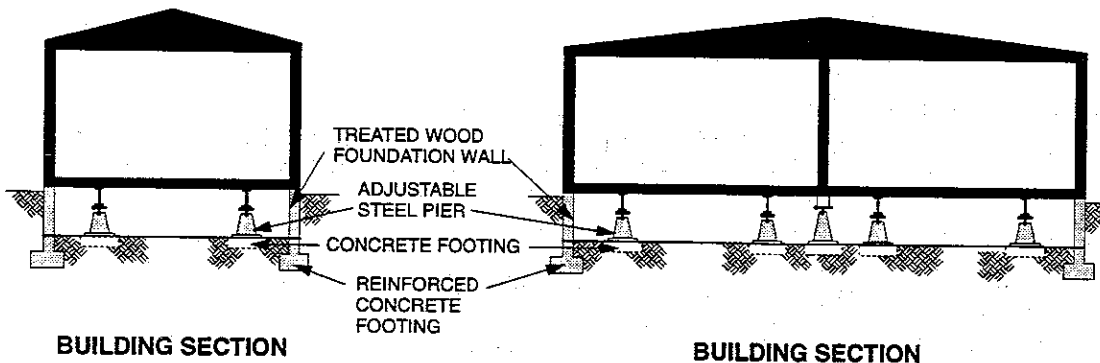

BUILDING SECTION

BUILDING SECTION

FOUNDATION TYPE Treated wood perimeter wall on concrete footing w/ unanchored metal pier	SYSTEM NUMBER E8
SUPERSTRUCTURE TYPE Exterior and chassis anchored single- and multi-wide	

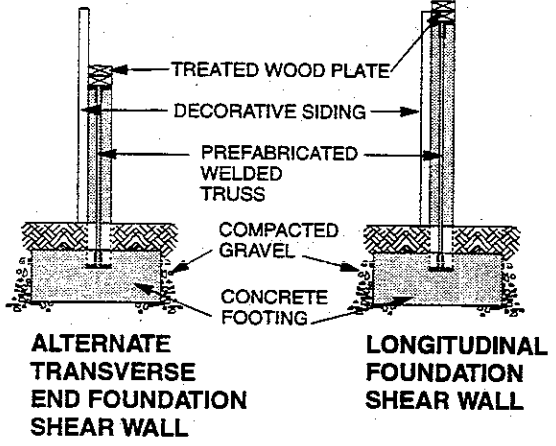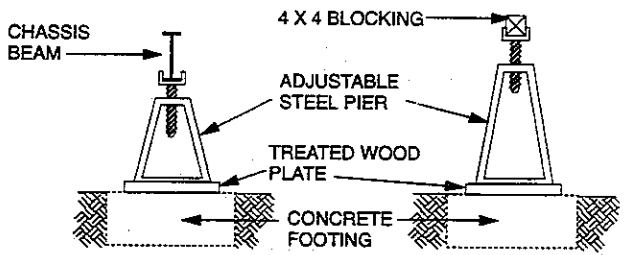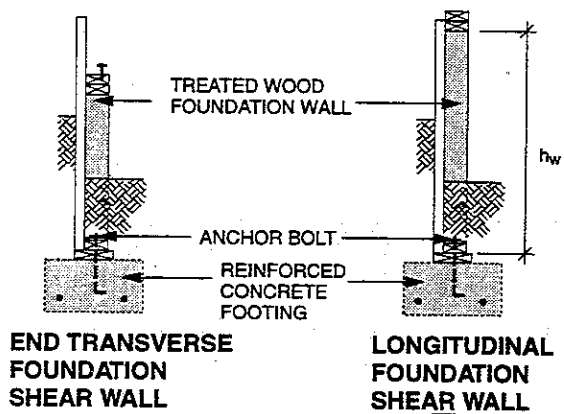

E8

TABLES

Use E, I tables for required effective footing area (A_{ftg}) for single and multi-wide units.
 Use type E tables for vertical anchorage (A_v) for single and multi-wide (2 tie-downs) units.
 Use type C, E, I tables for horizontal sliding anchorage (A_h) in the transverse and longitudinal directions for single and multi-wide units.

REGIONAL APPLICATIONS

1. Not suitable in high wind areas. Consult tables for exact limitations.
2. Not suitable in seismic areas where $A_v = 0.3$ or 0.4 .
3. Suitable in areas with high frost penetration with proper footing depth.
4. Not recommended in areas of high termite action unless wood is pressure treated.
5. Below-grade fasteners must be stainless steel.

NOTES

1. Horizontal anchorage is limited to the perimeter shear walls for lateral and longitudinal sliding.

APPENDIX B

FOUNDATION DESIGN LOAD TABLES

B-100. USE OF THE FOUNDATION DESIGN LOAD TABLES.

B-100.1 GENERAL. The Foundation Design Load Tables provide design values specific to the four conditions of foundation design: items A thru D below. Refer to Figure B-1 for diagrams of anchorage locations designed to resist wind or seismic forces acting on the structure, and footing size to prevent settlement. Refer to Appendix D for a more detailed derivation of the Foundation Design Load Tables. The four conditions are:

A. The required footing area based on the allowable soil bearing capacity under full gravity loading. The footing area is found in the Required Effective Footing Area Tables - Part 1 (pgs. B-3 to B-32).

B. The required anchorage to prevent uplift and overturning (A_v) - Required Vertical Anchorage Tables - Part 2 (pgs. B-33 to B-42).

C. The required anchorage to prevent sliding (A_h) in the transverse direction - Re-

quired Horizontal Anchorage Tables - Part 3 (pgs. B-43 to B-59).


D. The required anchorage to prevent sliding (A_h) in the longitudinal direction - Required Horizontal Anchorage Tables - Part 4 (pgs. B-60 to B-84).

B-100.2. REQUIRED EFFECTIVE FOOTING AREA (A_{ftg}). These tables provide the required effective footing area that will not exceed the allowable soil bearing capacity under full gravity loading of dead load plus live load.

B-100.3 REQUIRED VERTICAL ANCHORAGE (A_v).

A. The Vertical Anchorage Table provides the required anchorage to resist uplift due to wind suction and overturning at the perimeter foundation wall or pier locations. Refer to Figure B-1.

B. **Assumption:** Uplift and overturning is resisted by anchorage to the piers and/or foundation walls.

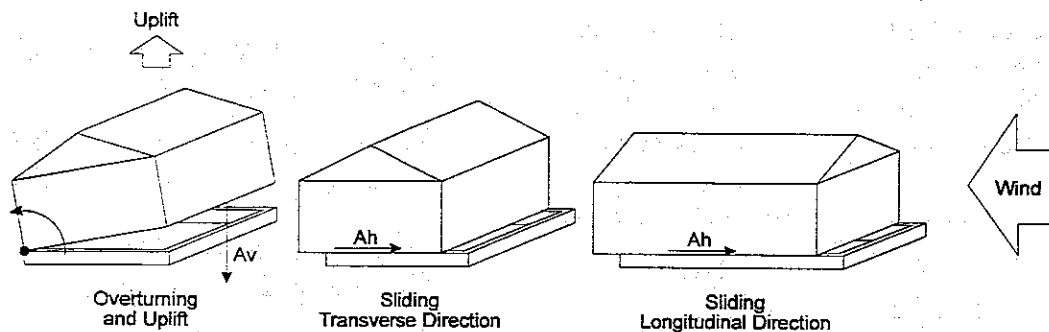

Anchorage Locations

Figure B - 1

B-100.4 REQUIRED HORIZONTAL ANCHORAGE (Ah) IN THE TRANSVERSE DIRECTION.

A. The Horizontal Anchorage Table provides the required anchorage to prevent sliding at the short foundation shear wall locations. Refer to Figure B-1.

B. **Assumption:** Sliding is resisted by anchorage to the short foundation shear walls and a portion of the dead load.)

C. Shear walls in the manufactured home are walls that have been designed and constructed by the manufacturer to resist lateral loads. The home's shear walls transfer lateral loads to the floor frame.

D. **Assumption:** Shear walls inside the unit are reasonably close to the location of short foundation shear walls for proper load transfer.

B-100.5 REQUIRED HORIZONTAL ANCHORAGE (Ah) IN THE LONGITUDINAL DIRECTION.

A. The Horizontal Anchorage Table provides the required anchorage to prevent sliding at the long foundation shear wall locations. Refer to Figure B-1.

B. **Assumption:** Sliding is resisted by anchorage to the long foundation shear walls and a portion of the dead load.

C. Shear walls in the manufactured home are walls that have been designed and constructed by the manufacturer to resist lateral loads. The home's shear walls transfer lateral loads to the floor frame.

D. **Assumption:** Shear walls inside the unit are reasonably close to the location of long foundation shear walls for proper load transfer.

INDEX to TABLES in APPENDIX B

Part 1 - Required Effective Footing Area (Aftg)

Single Section C	B-3 to B-6
Single Section E, I	B-7
Multi-section C	B-8 to B-16
Multi-Section Cnw	B-17 to B-20
Multi-Section E, I	B-21 to B-29
Multi-Section E5, E6	B-30 to B-38
Multi-Section E7	B-39 to B-47

Part 2 - Required Vertical Anchorage - (Av)

Single Section C	B-48
Single Section C1	B-49
Single Section E	B-50
Single-Section E3	B-51

Single-Section I	B-52
Multi-Section C	B-53 to B-54
Multi-Section E	B-55 to B-56
Multi-Section E3	B-57
Multi-Section I	B-58 to B-59

Part 3 - Required Horizontal Anchorage - (Ah) Transverse Direction

Single-Section C, E, I	B-60 to B-64
Multi-Section C, E, I	B-65 to B-80

Part 4 - Required Horizontal Anchorage - (Ah) Longitudinal Direction


Single-Section C, E, I	B-81 to B-89
Multi-Section C, E, I	B-90 to B-100

Part 1

Required Effective Footing Area - Aftg

Single-Section C

Required Effective Footing Area - Aftg (sqft) *



Min. Roof: 15 psf						
Net Soil Pres (psf)	Pier Spacing (ft)					
	4	5	6	7	8	10
1000	3.0	3.5	4.1	4.7	5.2	6.3
1500	2.0	2.3	2.7	3.1	3.5	4.2
2000	1.5	1.8	2.0	2.3	2.6	3.2
2500	1.2	1.4	1.6	1.9	2.1	2.5
3000	1.0	1.2	1.4	1.6	1.7	2.1
3500	1.0	1.0	1.2	1.3	1.5	1.8
4000	1.0	1.0	1.0	1.2	1.3	1.6

Ground Snow: 25 psf						
Net Soil Pres (psf)	Pier Spacing (ft)					
	4	5	6	7	8	10
1000	3.0	3.6	4.2	4.8	5.3	6.5
1500	2.0	2.4	2.8	3.2	3.6	4.3
2000	1.5	1.8	2.1	2.4	2.7	3.2
2500	1.2	1.4	1.7	1.9	2.1	2.6
3000	1.0	1.2	1.4	1.6	1.8	2.2
3500	1.0	1.0	1.2	1.4	1.5	1.9
4000	1.0	1.0	1.0	1.2	1.3	1.6

Ground Snow: 30 psf & Min. Roof: 20 psf						
Net Soil Pres (psf)	Pier Spacing (ft)					
	4	5	6	7	8	10
1000	3.1	3.7	4.3	4.9	5.5	6.7
1500	2.1	2.5	2.9	3.3	3.7	4.5
2000	1.5	1.8	2.1	2.4	2.7	3.3
2500	1.2	1.5	1.7	2.0	2.2	2.7
3000	1.0	1.2	1.4	1.6	1.8	2.2
3500	1.0	1.1	1.2	1.4	1.6	1.9
4000	1.0	1.0	1.1	1.2	1.4	1.7

Ground Snow: 40 psf						
Net Soil Pres (psf)	Pier Spacing (ft)					
	4	5	6	7	8	10
1000	3.3	3.9	4.5	5.2	5.8	7.1
1500	2.2	2.6	3.0	3.5	3.9	4.7
2000	1.6	2.0	2.3	2.6	2.9	3.6
2500	1.3	1.6	1.8	2.1	2.3	2.8
3000	1.1	1.3	1.5	1.7	1.9	2.4
3500	1.0	1.1	1.3	1.5	1.7	2.0
4000	1.0	1.0	1.1	1.3	1.5	1.8

Ground Snow: 50 psf						
Net Soil Pres (psf)	Pier Spacing (ft)					
	4	5	6	7	8	10
1000	3.4	4.1	4.8	5.5	6.2	7.5
1500	2.3	2.7	3.2	3.6	4.1	5.0
2000	1.7	2.1	2.4	2.7	3.1	3.8
2500	1.4	1.6	1.9	2.2	2.5	3.0
3000	1.1	1.4	1.6	1.8	2.1	2.5
3500	1.0	1.2	1.4	1.6	1.8	2.1
4000	1.0	1.0	1.2	1.4	1.5	1.9

Ground Snow: 60 psf						
Net Soil Pres (psf)	Pier Spacing (ft)					
	4	5	6	7	8	10
1000	3.6	4.3	5.0	5.8	6.5	7.9
1500	2.4	2.9	3.4	3.8	4.3	5.3
2000	1.8	2.2	2.5	2.9	3.2	4.0
2500	1.4	1.7	2.0	2.3	2.6	3.2
3000	1.2	1.4	1.7	1.9	2.2	2.6
3500	1.0	1.2	1.4	1.6	1.9	2.3
4000	1.0	1.1	1.3	1.4	1.6	2.0

Ground Snow: 70 psf						
Net Soil Pres (psf)	Pier Spacing (ft)					
	4	5	6	7	8	10
1000	3.8	4.5	5.3	6.0	6.8	8.3
1500	2.5	3.0	3.5	4.0	4.5	5.6
2000	1.9	2.3	2.6	3.0	3.4	4.2
2500	1.5	1.8	2.1	2.4	2.7	3.3
3000	1.3	1.5	1.8	2.0	2.3	2.8
3500	1.1	1.3	1.5	1.7	1.9	2.4
4000	1.0	1.1	1.3	1.5	1.7	2.1

* Minimum exterior and interior pier area is 10 sqft.

Aftg C 12'	
	Single-Section Width

Ground Snow: 80 psf						
Net Soil Pres (psf)	Pier Spacing (ft)					
	4	5	6	7	8	10
1000	3.9	4.7	5.5	6.3	7.1	8.7
1500	2.6	3.1	3.7	4.2	4.8	5.8
2000	2.0	2.4	2.8	3.2	3.6	4.4
2500	1.6	1.9	2.2	2.5	2.9	3.5
3000	1.3	1.6	1.8	2.1	2.4	2.9
3500	1.1	1.3	1.6	1.8	2.0	2.5
4000	1.0	1.2	1.4	1.6	1.8	2.2

Ground Snow: 100 psf						
Net Soil Pres (psf)	Pier Spacing (ft)					
	4	5	6	7	8	10
1000	4.2	5.1	6.0	6.9	7.8	9.6
1500	2.8	3.4	4.0	4.6	5.2	6.4
2000	2.1	2.6	3.0	3.4	3.9	4.8
2500	1.7	2.1	2.4	2.8	3.1	3.8
3000	1.4	1.7	2.0	2.3	2.6	3.2
3500	1.2	1.5	1.7	2.0	2.2	2.7
4000	1.1	1.3	1.5	1.7	1.9	2.4

Aftg C 14'	
	Single-Section Width

Min. Roof: 15 psf						
Net Soil Pres (psf)	Pier Spacing (ft)					
	4	5	6	7	8	10
1000	3.3	4.0	4.6	5.3	5.9	7.2
1500	2.2	2.6	3.1	3.5	3.9	4.8
2000	1.7	2.0	2.3	2.6	3.0	3.6
2500	1.3	1.6	1.8	2.1	2.4	2.9
3000	1.1	1.3	1.5	1.8	2.0	2.4
3500	1.0	1.1	1.3	1.5	1.7	2.1
4000	1.0	1.0	1.2	1.3	1.5	1.8

Ground Snow: 30 psf & Min. Roof: 20 psf						
Net Soil Pres (psf)	Pier Spacing (ft)					
	4	5	6	7	8	10
1000	3.5	4.2	4.9	5.6	6.2	7.6
1500	2.3	2.8	3.2	3.7	4.2	5.1
2000	1.7	2.1	2.4	2.8	3.1	3.8
2500	1.4	1.7	1.9	2.2	2.5	3.1
3000	1.2	1.4	1.6	1.9	2.1	2.5
3500	1.0	1.2	1.4	1.6	1.8	2.2
4000	1.0	1.0	1.2	1.4	1.6	1.9

* Minimum exterior and interior pier area is 1.0 sqft.

Required Effective Footing Area - Aftg (sqft) *


Ground Snow: 90 psf						
Net Soil Pres (psf)	Pier Spacing (ft)					
	4	5	6	7	8	10
1000	4.1	4.9	5.8	6.6	7.5	9.1
1500	2.7	3.3	3.8	4.4	5.0	6.1
2000	2.0	2.5	2.9	3.3	3.7	4.6
2500	1.6	2.0	2.3	2.6	3.0	3.7
3000	1.4	1.6	1.9	2.2	2.5	3.0
3500	1.2	1.4	1.6	1.9	2.1	2.6
4000	1.0	1.2	1.4	1.7	1.9	2.3

Required Effective Footing Area - Aftg (sqft) *

Ground Snow: 25 psf						
Net Soil Pres (psf)	Pier Spacing (ft)					
	4	5	6	7	8	10
1000	3.4	4.0	4.7	5.4	6.1	7.4
1500	2.3	2.7	3.1	3.6	4.0	4.9
2000	1.7	2.0	2.4	2.7	3.0	3.7
2500	1.4	1.6	1.9	2.2	2.4	3.0
3000	1.1	1.3	1.6	1.8	2.0	2.5
3500	1.0	1.2	1.3	1.5	1.7	2.1
4000	1.0	1.0	1.2	1.3	1.5	1.8

Ground Snow: 40 psf						
Net Soil Pres (psf)	Pier Spacing (ft)					
	4	5	6	7	8	10
1000	3.7	4.4	5.1	5.9	6.6	8.1
1500	2.4	2.9	3.4	3.9	4.4	5.4
2000	1.8	2.2	2.6	2.9	3.3	4.1
2500	1.5	1.8	2.1	2.4	2.7	3.2
3000	1.2	1.5	1.7	2.0	2.2	2.7
3500	1.0	1.3	1.5	1.7	1.9	2.3
4000	1.0	1.1	1.3	1.5	1.7	2.0

Required Effective Footing Area - Aftg (sqft) *

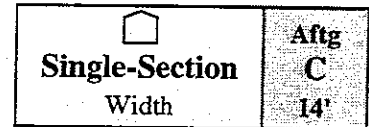

Ground Snow: 50 psf						
Net Soil Pres (psf)	Pier Spacing (ft)					
	4	5	6	7	8	10
1000	3.9	4.6	5.4	6.2	7.0	8.6
1500	2.6	3.1	3.6	4.1	4.7	5.7
2000	1.9	2.3	2.7	3.1	3.5	4.3
2500	1.5	1.9	2.2	2.5	2.8	3.4
3000	1.3	1.5	1.8	2.1	2.3	2.9
3500	1.1	1.3	1.6	1.8	2.0	2.5
4000	1.0	1.2	1.4	1.6	1.8	2.1

Ground Snow: 60 psf						
Net Soil Pres (psf)	Pier Spacing (ft)					
	4	5	6	7	8	10
1000	4.0	4.9	5.7	6.6	7.4	9.1
1500	2.7	3.3	3.8	4.4	4.9	6.0
2000	2.0	2.4	2.9	3.3	3.7	4.5
2500	1.6	2.0	2.3	2.6	3.0	3.6
3000	1.3	1.6	1.9	2.2	2.5	3.0
3500	1.2	1.4	1.6	1.9	2.1	2.6
4000	1.0	1.2	1.4	1.6	1.8	2.3

Ground Snow: 70 psf						
Net Soil Pres (psf)	Pier Spacing (ft)					
	4	5	6	7	8	10
1000	4.2	5.1	6.0	6.9	7.8	9.5
1500	2.8	3.4	4.0	4.6	5.2	6.4
2000	2.1	2.6	3.0	3.4	3.9	4.8
2500	1.7	2.0	2.4	2.8	3.1	3.8
3000	1.4	1.7	2.0	2.3	2.6	3.2
3500	1.2	1.5	1.7	2.0	2.2	2.7
4000	1.1	1.3	1.5	1.7	1.9	2.4

Ground Snow: 80 psf						
Net Soil Pres (psf)	Pier Spacing (ft)					
	4	5	6	7	8	10
1000	4.4	5.4	6.3	7.2	8.2	10.0
1500	3.0	3.6	4.2	4.8	5.4	6.7
2000	2.2	2.7	3.1	3.6	4.1	5.0
2500	1.8	2.1	2.5	2.9	3.3	4.0
3000	1.5	1.8	2.1	2.4	2.7	3.3
3500	1.3	1.5	1.8	2.1	2.3	2.9
4000	1.1	1.3	1.6	1.8	2.0	2.5

Ground Snow: 90 psf						
Net Soil Pres (psf)	Pier Spacing (ft)					
	4	5	6	7	8	10
1000	4.6	5.6	6.6	7.6	8.5	10.5
1500	3.1	3.7	4.4	5.0	5.7	7.0
2000	2.3	2.8	3.3	3.8	4.3	5.3
2500	1.8	2.2	2.6	3.0	3.4	4.2
3000	1.5	1.9	2.2	2.5	2.8	3.5
3500	1.3	1.6	1.9	2.2	2.4	3.0
4000	1.2	1.4	1.6	1.9	2.1	2.6

Ground Snow: 100 psf						
Net Soil Pres (psf)	Pier Spacing (ft)					
	4	5	6	7	8	10
1000	4.8	5.8	6.9	7.9	8.9	11.0
1500	3.2	3.9	4.6	5.3	6.0	7.3
2000	2.4	2.9	3.4	3.9	4.5	5.5
2500	1.9	2.3	2.7	3.2	3.6	4.4
3000	1.6	1.9	2.3	2.6	3.0	3.7
3500	1.4	1.7	2.0	2.3	2.6	3.1
4000	1.2	1.5	1.7	2.0	2.2	2.7

Required Effective Footing Area - Aftg (sqft) *



Min. Roof: 15 psf						
Net Soil Pres (psf)	Pier Spacing (ft)					
	4	5	6	7	8	10
1000	3.6	4.4	5.1	5.8	6.6	8.0
1500	2.4	2.9	3.4	3.9	4.4	5.4
2000	1.8	2.2	2.5	2.9	3.3	4.0
2500	1.5	1.7	2.0	2.3	2.6	3.2
3000	1.2	1.5	1.7	1.9	2.2	2.7
3500	1.0	1.2	1.5	1.7	1.9	2.3
4000	1.0	1.1	1.3	1.5	1.6	2.0

Ground Snow: 25 psf						
Net Soil Pres (psf)	Pier Spacing (ft)					
	4	5	6	7	8	10
1000	3.7	4.5	5.2	6.0	6.7	8.2
1500	2.5	3.0	3.5	4.0	4.5	5.5
2000	1.9	2.2	2.6	3.0	3.4	4.1
2500	1.5	1.8	2.1	2.4	2.7	3.3
3000	1.2	1.5	1.7	2.0	2.2	2.7
3500	1.1	1.3	1.5	1.7	1.9	2.3
4000	1.0	1.1	1.3	1.5	1.7	2.1

* Minimum exterior and interior pier area is 1.0 sqft.

Aftg C 16'	
	Single-Section Width

Required Effective Footing Area - Aftg (sqft) *

Ground Snow: 30 psf & Min. Roof: 20 psf

Net Soil Pres (psf)	Pier Spacing (ft)					
	4	5	6	7	8	10
1000	3.8	4.6	5.4	6.2	6.9	8.5
1500	2.5	3.1	3.6	4.1	4.6	5.7
2000	1.9	2.3	2.7	3.1	3.5	4.2
2500	1.5	1.8	2.2	2.5	2.8	3.4
3000	1.3	1.5	1.8	2.1	2.3	2.8
3500	1.1	1.3	1.5	1.8	2.0	2.4
4000	1.0	1.1	1.3	1.5	1.7	2.1

Ground Snow: 40 psf

Net Soil Pres (psf)	Pier Spacing (ft)					
	4	5	6	7	8	10
1000	4.0	4.9	5.7	6.5	7.4	9.0
1500	2.7	3.2	3.8	4.4	4.9	6.0
2000	2.0	2.4	2.9	3.3	3.7	4.5
2500	1.6	1.9	2.3	2.6	2.9	3.6
3000	1.3	1.6	1.9	2.2	2.5	3.0
3500	1.2	1.4	1.6	1.9	2.1	2.6
4000	1.0	1.2	1.4	1.6	1.8	2.3

Ground Snow: 50 psf

Net Soil Pres (psf)	Pier Spacing (ft)					
	4	5	6	7	8	10
1000	4.3	5.1	6.0	6.9	7.8	9.6
1500	2.8	3.4	4.0	4.6	5.2	6.4
2000	2.1	2.6	3.0	3.5	3.9	4.8
2500	1.7	2.1	2.4	2.8	3.1	3.8
3000	1.4	1.7	2.0	2.3	2.6	3.2
3500	1.2	1.5	1.7	2.0	2.2	2.7
4000	1.1	1.3	1.5	1.7	2.0	2.4

Ground Snow: 60 psf

Net Soil Pres (psf)	Pier Spacing (ft)					
	4	5	6	7	8	10
1000	4.5	5.4	6.4	7.3	8.2	10.1
1500	3.0	3.6	4.2	4.9	5.5	6.7
2000	2.2	2.7	3.2	3.6	4.1	5.1
2500	1.8	2.2	2.5	2.9	3.3	4.0
3000	1.5	1.8	2.1	2.4	2.7	3.4
3500	1.3	1.5	1.8	2.1	2.4	2.9
4000	1.1	1.4	1.6	1.8	2.1	2.5

Ground Snow: 70 psf

Net Soil Pres (psf)	Pier Spacing (ft)					
	4	5	6	7	8	10
1000	4.7	5.7	6.7	7.7	8.7	10.7
1500	3.1	3.8	4.5	5.1	5.8	7.1
2000	2.3	2.8	3.3	3.8	4.3	5.3
2500	1.9	2.3	2.7	3.1	3.5	4.3
3000	1.6	1.9	2.2	2.6	2.9	3.6
3500	1.3	1.6	1.9	2.2	2.5	3.0
4000	1.2	1.4	1.7	1.9	2.2	2.7

Ground Snow: 80 psf

Net Soil Pres (psf)	Pier Spacing (ft)					
	4	5	6	7	8	10
1000	4.9	6.0	7.0	8.1	9.1	11.2
1500	3.3	4.0	4.7	5.4	6.1	7.5
2000	2.5	3.0	3.5	4.0	4.6	5.6
2500	2.0	2.4	2.8	3.2	3.6	4.5
3000	1.6	2.0	2.3	2.7	3.0	3.7
3500	1.4	1.7	2.0	2.3	2.6	3.2
4000	1.2	1.5	1.8	2.0	2.3	2.8

Ground Snow: 90 psf

Net Soil Pres (psf)	Pier Spacing (ft)					
	4	5	6	7	8	10
1000	5.1	6.2	7.3	8.4	9.5	11.7
1500	3.4	4.1	4.9	5.6	6.4	7.8
2000	2.6	3.1	3.7	4.2	4.8	5.9
2500	2.0	2.5	2.9	3.4	3.8	4.7
3000	1.7	2.1	2.4	2.8	3.2	3.9
3500	1.5	1.8	2.1	2.4	2.7	3.4
4000	1.3	1.6	1.8	2.1	2.4	2.9

Ground Snow: 100 psf

Net Soil Pres (psf)	Pier Spacing (ft)					
	4	5	6	7	8	10
1000	5.3	6.5	7.7	8.8	10.0	12.3
1500	3.6	4.3	5.1	5.9	6.6	8.2
2000	2.7	3.2	3.8	4.4	5.0	6.1
2500	2.1	2.6	3.1	3.5	4.0	4.9
3000	1.8	2.2	2.6	2.9	3.3	4.1
3500	1.5	1.9	2.2	2.5	2.8	3.5
4000	1.3	1.6	1.9	2.2	2.5	3.1


* Minimum exterior and interior pier area is 1.0 sqft.

Single-Section E, I

Required Effective Footing Area - Aftg (sqft) *

Interior Piers Net Soil Pres (psf)	Pier Spacing (ft)					
	4	5	6	7	8	10
1000	1.7	1.9	2.2	2.4	2.7	3.2
1500	1.1	1.3	1.5	1.6	1.8	2.1
2000	1.0	1.0	1.1	1.2	1.3	1.6
2500	1.0	1.0	1.0	1.0	1.1	1.3
3000	1.0	1.0	1.0	1.0	1.0	1.1
3500	1.0	1.0	1.0	1.0	1.0	1.0
4000	1.0	1.0	1.0	1.0	1.0	1.0

 Single-Section Width	Aftg E, I 12'
---	--

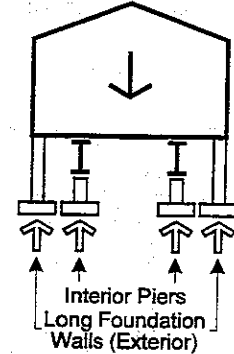


Required Effective Footing Area - Aftg (sqft) *

Interior Piers Net Soil Pres (psf)	Pier Spacing (ft)					
	4	5	6	7	8	10
1000	1.8	2.1	2.4	2.7	2.9	3.5
1500	1.2	1.4	1.6	1.8	2.0	2.3
2000	1.0	1.1	1.2	1.3	1.5	1.8
2500	1.0	1.0	1.0	1.1	1.2	1.4
3000	1.0	1.0	1.0	1.0	1.0	1.2
3500	1.0	1.0	1.0	1.0	1.0	1.0
4000	1.0	1.0	1.0	1.0	1.0	1.0

 Single-Section Width	Aftg E, I 14'
---	--


Required Effective Footing Area - Aftg (sqft) *

Interior Piers Net Soil Pres (psf)	Pier Spacing (ft)					
	4	5	6	7	8	10
1000	2.0	2.3	2.6	2.9	3.3	3.9
1500	1.3	1.5	1.7	2.0	2.2	2.6
2000	1.0	1.1	1.3	1.5	1.6	1.9
2500	1.0	1.0	1.0	1.2	1.3	1.6
3000	1.0	1.0	1.0	1.0	1.1	1.3
3500	1.0	1.0	1.0	1.0	1.0	1.1
4000	1.0	1.0	1.0	1.0	1.0	1.0

 Single-Section Width	Aftg E, I 16'
---	--

* Minimum interior pier area is 1.0 sqft. Minimum exterior foundation wall footing width is 1'-0"; except for a 16' wide unit when the snow load is 100 psf and the allowable soil pressure is 1000 psf, use 1'-2".

Multi-Section C

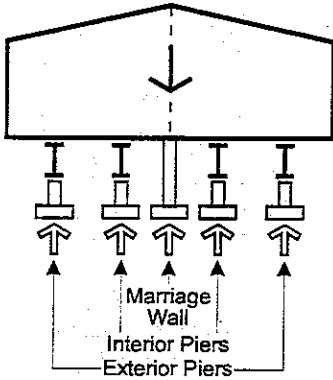

Required Effective Footing Area - Aftg (sqft) *

Min. Roof: 15 psf							
Net Soil Pres (psf)		Pier Spacing (ft)					
		4	5	6	7	8	10
1000	ext, int	3.0	3.5	4.1	4.7	5.2	6.3
	marriage	3.0	3.6	4.2	4.8	5.4	6.6
1500	ext, int	2.0	2.3	2.7	3.1	3.5	4.2
	marriage	2.0	2.4	2.8	3.2	3.6	4.4
2000	ext, int	1.5	1.8	2.0	2.3	2.6	3.2
	marriage	1.5	1.8	2.1	2.4	2.7	3.3
2500	ext, int	1.2	1.4	1.6	1.9	2.1	2.5
	marriage	1.2	1.4	1.7	1.9	2.2	2.6
3000	ext, int	1.0	1.2	1.4	1.6	1.7	2.1
	marriage	1.0	1.2	1.4	1.6	1.8	2.2
3500	ext, int	1.0	1.0	1.2	1.3	1.5	1.8
	marriage	1.0	1.0	1.2	1.4	1.5	1.9
4000	ext, int	1.0	1.0	1.0	1.2	1.3	1.6
	marriage	1.0	1.0	1.0	1.2	1.3	1.6

Net Soil Pres (psf)		Marriage Wall Opening Width (ft)					
		10	12	14	16	18	20
1000	marriage	6.4	7.5	8.7	9.9	11.0	12.2
1500	marriage	4.3	5.0	5.8	6.6	7.3	8.1
2000	marriage	3.2	3.8	4.3	4.9	5.5	6.1
2500	marriage	2.6	3.0	3.5	3.9	4.4	4.9
3000	marriage	2.1	2.5	2.9	3.3	3.7	4.1
3500	marriage	1.8	2.2	2.5	2.8	3.1	3.5
4000	marriage	1.6	1.9	2.2	2.5	2.8	3.0

Ground Snow: 25 psf							
Net Soil Pres (psf)		Pier Spacing (ft)					
		4	5	6	7	8	10
1000	ext, int	3.0	3.6	4.2	4.8	5.3	6.5
	marriage	3.1	3.7	4.4	5.0	5.6	6.9
1500	ext, int	2.0	2.4	2.8	3.2	3.6	4.3
	marriage	2.1	2.5	2.9	3.3	3.7	4.6
2000	ext, int	1.5	1.8	2.1	2.4	2.7	3.2
	marriage	1.6	1.9	2.2	2.5	2.8	3.4
2500	ext, int	1.2	1.4	1.7	1.9	2.1	2.6
	marriage	1.2	1.5	1.7	2.0	2.2	2.8
3000	ext, int	1.0	1.2	1.4	1.6	1.8	2.2
	marriage	1.0	1.2	1.5	1.7	1.9	2.3
3500	ext, int	1.0	1.0	1.2	1.4	1.5	1.9
	marriage	1.0	1.1	1.2	1.4	1.6	2.0
4000	ext, int	1.0	1.0	1.0	1.2	1.3	1.6
	marriage	1.0	1.0	1.1	1.2	1.4	1.7

Net Soil Pres (psf)		Marriage Wall Opening Width (ft)					
		10	12	14	16	18	20
1000	marriage	6.7	7.9	9.1	10.3	11.5	12.7
1500	marriage	4.5	5.3	6.1	6.9	7.7	8.5
2000	marriage	3.3	3.9	4.6	5.2	5.8	6.4
2500	marriage	2.7	3.2	3.6	4.1	4.6	5.1
3000	marriage	2.2	2.6	3.0	3.4	3.8	4.2
3500	marriage	1.9	2.3	2.6	2.9	3.3	3.6
4000	marriage	1.7	2.0	2.3	2.6	2.9	3.2

Ground Snow: 30 psf & Min. Roof: 20 psf							
Net Soil Pres (psf)		Pier Spacing (ft)					
		4	5	6	7	8	10
1000	ext, int	3.1	3.7	4.3	4.9	5.5	6.7
	marriage	3.3	3.9	4.6	5.3	5.9	7.3
1500	ext, int	2.1	2.5	2.9	3.3	3.7	4.5
	marriage	2.2	2.6	3.1	3.5	4.0	4.9
2000	ext, int	1.5	1.8	2.1	2.4	2.7	3.3
	marriage	1.6	2.0	2.3	2.6	3.0	3.6
2500	ext, int	1.2	1.5	1.7	2.0	2.2	2.7
	marriage	1.3	1.6	1.8	2.1	2.4	2.9
3000	ext, int	1.0	1.2	1.4	1.6	1.8	2.2
	marriage	1.1	1.3	1.5	1.8	2.0	2.4
3500	ext, int	1.0	1.1	1.2	1.4	1.6	1.9
	marriage	1.0	1.1	1.3	1.5	1.7	2.1
4000	ext, int	1.0	1.0	1.1	1.2	1.4	1.7
	marriage	1.0	1.0	1.2	1.3	1.5	1.8

Net Soil Pres (psf)		Marriage Wall Opening Width (ft)					
		10	12	14	16	18	20
1000	marriage	7.1	8.4	9.7	11.0	12.3	13.6
1500	marriage	4.7	5.6	6.5	7.3	8.2	9.0
2000	marriage	3.5	4.2	4.8	5.5	6.1	6.8
2500	marriage	2.8	3.4	3.9	4.4	4.9	5.4
3000	marriage	2.4	2.8	3.2	3.7	4.1	4.5
3500	marriage	2.0	2.4	2.8	3.1	3.5	3.9
4000	marriage	1.8	2.1	2.4	2.7	3.1	3.4

* Minimum exterior and interior pier area is 1.0 sqft.

Required Effective Footing Area - Aftg (sqft) *



Ground Snow: 40 psf							
Net Soil Pres (psf)		Pier Spacing (ft)					
		4	5	6	7	8	10
1000	ext, int	3.3	3.9	4.5	5.2	5.8	7.1
	marriage	3.6	4.3	5.1	5.8	6.6	8.1
1500	ext, int	2.2	2.6	3.0	3.5	3.9	4.7
	marriage	2.4	2.9	3.4	3.9	4.4	5.4
2000	ext, int	1.6	2.0	2.3	2.6	2.9	3.6
	marriage	1.8	2.2	2.5	2.9	3.3	4.1
2500	ext, int	1.3	1.6	1.8	2.1	2.3	2.8
	marriage	1.4	1.7	2.0	2.3	2.6	3.2
3000	ext, int	1.1	1.3	1.5	1.7	1.9	2.4
	marriage	1.2	1.4	1.7	1.9	2.2	2.7
3500	ext, int	1.0	1.1	1.3	1.5	1.7	2.0
	marriage	1.0	1.2	1.5	1.7	1.9	2.3
4000	ext, int	1.0	1.0	1.1	1.3	1.5	1.8
	marriage	1.0	1.1	1.3	1.5	1.6	2.0

Marriage Wall Opening Width (ft)							
Net Soil Pres (psf)		10	12	14	16	18	20
1000	marriage	7.9	9.4	10.8	12.3	13.7	15.2
1500	marriage	5.3	6.2	7.2	8.2	9.2	10.1
2000	marriage	4.0	4.7	5.4	6.1	6.9	7.6
2500	marriage	3.2	3.7	4.3	4.9	5.5	6.1
3000	marriage	2.6	3.1	3.6	4.1	4.6	5.1
3500	marriage	2.3	2.7	3.1	3.5	3.9	4.3
4000	marriage	2.0	2.3	2.7	3.1	3.4	3.8

Ground Snow: 50 psf							
Net Soil Pres (psf)		Pier Spacing (ft)					
		4	5	6	7	8	10
1000	ext, int	3.4	4.1	4.8	5.5	6.2	7.5
	marriage	3.9	4.8	5.6	6.4	7.3	8.9
1500	ext, int	2.3	2.7	3.2	3.6	4.1	5.0
	marriage	2.6	3.2	3.7	4.3	4.8	5.9
2000	ext, int	1.7	2.1	2.4	2.7	3.1	3.8
	marriage	2.0	2.4	2.8	3.2	3.6	4.5
2500	ext, int	1.4	1.6	1.9	2.2	2.5	3.0
	marriage	1.6	1.9	2.2	2.6	2.9	3.6
3000	ext, int	1.1	1.4	1.6	1.8	2.1	2.5
	marriage	1.3	1.6	1.9	2.1	2.4	3.0
3500	ext, int	1.0	1.2	1.4	1.6	1.8	2.1
	marriage	1.1	1.4	1.6	1.8	2.1	2.5
4000	ext, int	1.0	1.0	1.2	1.4	1.5	1.9
	marriage	1.0	1.2	1.4	1.6	1.8	2.2

Marriage Wall Opening Width (ft)							
Net Soil Pres (psf)		10	12	14	16	18	20
1000	marriage	8.7	10.3	12.0	13.6	15.2	16.8
1500	marriage	5.8	6.9	8.0	9.1	10.1	11.2
2000	marriage	4.4	5.2	6.0	6.8	7.6	8.4
2500	marriage	3.5	4.1	4.8	5.4	6.1	6.7
3000	marriage	2.9	3.4	4.0	4.5	5.1	5.6
3500	marriage	2.5	3.0	3.4	3.9	4.3	4.8
4000	marriage	2.2	2.6	3.0	3.4	3.8	4.2

Ground Snow: 60 psf							
Net Soil Pres (psf)		Pier Spacing (ft)					
		4	5	6	7	8	10
1000	ext, int	3.6	4.3	5.0	5.8	6.5	7.9
	marriage	4.2	5.2	6.1	7.0	7.9	9.7
1500	ext, int	2.4	2.9	3.4	3.8	4.3	5.3
	marriage	2.8	3.4	4.1	4.7	5.3	6.5
2000	ext, int	1.8	2.2	2.5	2.9	3.2	4.0
	marriage	2.1	2.6	3.0	3.5	4.0	4.9
2500	ext, int	1.4	1.7	2.0	2.3	2.6	3.2
	marriage	1.7	2.1	2.4	2.8	3.2	3.9
3000	ext, int	1.2	1.4	1.7	1.9	2.2	2.6
	marriage	1.4	1.7	2.0	2.3	2.6	3.2
3500	ext, int	1.0	1.2	1.4	1.6	1.9	2.3
	marriage	1.2	1.5	1.7	2.0	2.3	2.8
4000	ext, int	1.0	1.1	1.3	1.4	1.6	2.0
	marriage	1.1	1.3	1.5	1.7	2.0	2.4

Marriage Wall Opening Width (ft)							
Net Soil Pres (psf)		10	12	14	16	18	20
1000	marriage	9.5	11.3	13.1	14.9	16.7	18.5
1500	marriage	6.4	7.5	8.7	9.9	11.1	12.3
2000	marriage	4.8	5.7	6.6	7.4	8.3	9.2
2500	marriage	3.8	4.5	5.2	6.0	6.7	7.4
3000	marriage	3.2	3.8	4.4	5.0	5.6	6.2
3500	marriage	2.7	3.2	3.7	4.3	4.8	5.3
4000	marriage	2.4	2.8	3.3	3.7	4.2	4.6

Ground Snow: 70 psf							
Net Soil Pres (psf)		Pier Spacing (ft)					
		4	5	6	7	8	10
1000	ext, int	3.8	4.5	5.3	6.0	6.8	8.3
	marriage	4.6	5.6	6.6	7.6	8.6	10.6
1500	ext, int	2.5	3.0	3.5	4.0	4.5	5.6
	marriage	3.0	3.7	4.4	5.0	5.7	7.0
2000	ext, int	1.9	2.3	2.6	3.0	3.4	4.2
	marriage	2.3	2.8	3.3	3.8	4.3	5.3
2500	ext, int	1.5	1.8	2.1	2.4	2.7	3.3
	marriage	1.8	2.2	2.6	3.0	3.4	4.2
3000	ext, int	1.3	1.5	1.8	2.0	2.3	2.8
	marriage	1.5	1.9	2.2	2.5	2.9	3.5
3500	ext, int	1.1	1.3	1.5	1.7	1.9	2.4
	marriage	1.3	1.6	1.9	2.2	2.4	3.0
4000	ext, int	1.0	1.1	1.3	1.5	1.7	2.1
	marriage	1.1	1.4	1.6	1.9	2.1	2.6

Marriage Wall Opening Width (ft)							
Net Soil Pres (psf)		10	12	14	16	18	20
1000	marriage	10.4	12.3	14.3	16.2	18.1	20.1
1500	marriage	6.9	8.2	9.5	10.8	12.1	13.4
2000	marriage	5.2	6.2	7.1	8.1	9.1	10.0
2500	marriage	4.1	4.9	5.7	6.5	7.3	8.0
3000	marriage	3.5	4.1	4.8	5.4	6.0	6.7
3500	marriage	3.0	3.5	4.1	4.6	5.2	5.7
4000	marriage	2.6	3.1	3.6	4.0	4.5	5.0

* Minimum exterior and interior pier area is 1.0 sqft.

Aftg C 12'	
	Multi-Section
	Width

Required Effective Footing Area - Aftg (sqft) *

Ground Snow: 80 psf

Net Soil		Pier Spacing (ft)					
Pres (psf)		4	5	6	7	8	10
1000	ext, int	3.9	4.7	5.5	6.3	7.1	8.7
	marriage	4.9	6.0	7.1	8.1	9.2	11.4
1500	ext, int	2.6	3.1	3.7	4.2	4.8	5.8
	marriage	3.3	4.0	4.7	5.4	6.1	7.6
2000	ext, int	2.0	2.4	2.8	3.2	3.6	4.4
	marriage	2.5	3.0	3.5	4.1	4.6	5.7
2500	ext, int	1.6	1.9	2.2	2.5	2.9	3.5
	marriage	2.0	2.4	2.8	3.3	3.7	4.5
3000	ext, int	1.3	1.6	1.8	2.1	2.4	2.9
	marriage	1.6	2.0	2.4	2.7	3.1	3.8
3500	ext, int	1.1	1.3	1.6	1.8	2.0	2.5
	marriage	1.4	1.7	2.0	2.3	2.6	3.2
4000	ext, int	1.0	1.2	1.4	1.6	1.8	2.2
	marriage	1.2	1.5	1.8	2.0	2.3	2.8

Net Soil		Marriage Wall Opening Width (ft)					
Pres (psf)		10	12	14	16	18	20
1000	marriage	11.2	13.3	15.4	17.5	19.6	21.7
1500	marriage	7.4	8.9	10.3	11.7	13.1	14.5
2000	marriage	5.6	6.6	7.7	8.8	9.8	10.9
2500	marriage	4.5	5.3	6.2	7.0	7.8	8.7
3000	marriage	3.7	4.4	5.1	5.8	6.5	7.2
3500	marriage	3.2	3.8	4.4	5.0	5.6	6.2
4000	marriage	2.8	3.3	3.8	4.4	4.9	5.4

Ground Snow: 100 psf

Net Soil		Pier Spacing (ft)					
Pres (psf)		4	5	6	7	8	10
1000	ext, int	4.2	5.1	6.0	6.9	7.8	9.6
	marriage	5.6	6.8	8.0	9.3	10.5	13.0
1500	ext, int	2.8	3.4	4.0	4.6	5.2	6.4
	marriage	3.7	4.5	5.4	6.2	7.0	8.7
2000	ext, int	2.1	2.6	3.0	3.4	3.9	4.8
	marriage	2.8	3.4	4.0	4.6	5.3	6.5
2500	ext, int	1.7	2.1	2.4	2.8	3.1	3.8
	marriage	2.2	2.7	3.2	3.7	4.2	5.2
3000	ext, int	1.4	1.7	2.0	2.3	2.6	3.2
	marriage	1.9	2.3	2.7	3.1	3.5	4.3
3500	ext, int	1.2	1.5	1.7	2.0	2.2	2.7
	marriage	1.6	1.9	2.3	2.7	3.0	3.7
4000	ext, int	1.1	1.3	1.5	1.7	1.9	2.4
	marriage	1.4	1.7	2.0	2.3	2.6	3.3

Net Soil		Marriage Wall Opening Width (ft)					
Pres (psf)		10	12	14	16	18	20
1000	marriage	12.8	15.2	17.7	20.1	22.6	25.0
1500	marriage	8.5	10.2	11.8	13.4	15.0	16.7
2000	marriage	6.4	7.6	8.8	10.1	11.3	12.5
2500	marriage	5.1	6.1	7.1	8.0	9.0	10.0
3000	marriage	4.3	5.1	5.9	6.7	7.5	8.3
3500	marriage	3.7	4.4	5.1	5.7	6.4	7.1
4000	marriage	3.2	3.8	4.4	5.0	5.6	6.2

Ground Snow: 90 psf

Net Soil		Pier Spacing (ft)					
Pres (psf)		4	5	6	7	8	10
1000	ext, int	4.1	4.9	5.8	6.6	7.5	9.1
	marriage	5.2	6.4	7.5	8.7	9.9	12.2
1500	ext, int	2.7	3.3	3.8	4.4	5.0	6.1
	marriage	3.5	4.3	5.0	5.8	6.6	8.1
2000	ext, int	2.0	2.5	2.9	3.3	3.7	4.6
	marriage	2.6	3.2	3.8	4.4	4.9	6.1
2500	ext, int	1.6	2.0	2.3	2.6	3.0	3.7
	marriage	2.1	2.6	3.0	3.5	3.9	4.9
3000	ext, int	1.4	1.6	1.9	2.2	2.5	3.0
	marriage	1.7	2.1	2.5	2.9	3.3	4.1
3500	ext, int	1.2	1.4	1.6	1.9	2.1	2.6
	marriage	1.5	1.8	2.2	2.5	2.8	3.5
4000	ext, int	1.0	1.2	1.4	1.7	1.9	2.3
	marriage	1.3	1.6	1.9	2.2	2.5	3.0

Net Soil		Marriage Wall Opening Width (ft)					
Pres (psf)		10	12	14	16	18	20
1000	marriage	12.0	14.3	16.5	18.8	21.1	23.4
1500	marriage	8.0	9.5	11.0	12.5	14.1	15.6
2000	marriage	6.0	7.1	8.3	9.4	10.5	11.7
2500	marriage	4.8	5.7	6.6	7.5	8.4	9.3
3000	marriage	4.0	4.8	5.5	6.3	7.0	7.8
3500	marriage	3.4	4.1	4.7	5.4	6.0	6.7
4000	marriage	3.0	3.6	4.1	4.7	5.3	5.8

* Minimum exterior and interior pier area is 1.0 sqft

Required Effective Footing Area - Aftg (sqft) *



Min. Roof: 15 psf							
Net Soil Pres (psf)		Pier Spacing (ft)					
		4	5	6	7	8	10
1000	ext, int	3.3	4.0	4.6	5.3	5.9	7.2
	marriage	3.4	4.1	4.8	5.5	6.3	7.7
1500	ext, int	2.2	2.6	3.1	3.5	3.9	4.8
	marriage	2.3	2.8	3.2	3.7	4.2	5.1
2000	ext, int	1.7	2.0	2.3	2.6	3.0	3.6
	marriage	1.7	2.1	2.4	2.8	3.1	3.8
2500	ext, int	1.3	1.6	1.8	2.1	2.4	2.9
	marriage	1.4	1.7	1.9	2.2	2.5	3.1
3000	ext, int	1.1	1.3	1.5	1.8	2.0	2.4
	marriage	1.1	1.4	1.6	1.8	2.1	2.6
3500	ext, int	1.0	1.1	1.3	1.5	1.7	2.1
	marriage	1.0	1.2	1.4	1.6	1.8	2.2
4000	ext, int	1.0	1.0	1.2	1.3	1.5	1.8
	marriage	1.0	1.0	1.2	1.4	1.6	1.9

Net Soil Pres (psf)		Marriage Wall Opening Width (ft)					
		10	12	14	16	18	20
1000	marriage	7.5	8.8	10.2	11.6	13.0	14.3
1500	marriage	5.0	5.9	6.8	7.7	8.6	9.5
2000	marriage	3.7	4.4	5.1	5.8	6.5	7.2
2500	marriage	3.0	3.5	4.1	4.6	5.2	5.7
3000	marriage	2.5	2.9	3.4	3.9	4.3	4.8
3500	marriage	2.1	2.5	2.9	3.3	3.7	4.1
4000	marriage	1.9	2.2	2.6	2.9	3.2	3.6

Ground Snow: 25 psf							
Net Soil Pres (psf)		Pier Spacing (ft)					
		4	5	6	7	8	10
1000	ext, int	3.4	4.0	4.7	5.4	6.1	7.4
	marriage	3.6	4.3	5.0	5.8	6.5	8.0
1500	ext, int	2.3	2.7	3.1	3.6	4.0	4.9
	marriage	2.4	2.9	3.4	3.9	4.3	5.3
2000	ext, int	1.7	2.0	2.4	2.7	3.0	3.7
	marriage	1.8	2.1	2.5	2.9	3.3	4.0
2500	ext, int	1.4	1.6	1.9	2.2	2.4	3.0
	marriage	1.4	1.7	2.0	2.3	2.6	3.2
3000	ext, int	1.1	1.3	1.6	1.8	2.0	2.5
	marriage	1.2	1.4	1.7	1.9	2.2	2.7
3500	ext, int	1.0	1.2	1.3	1.5	1.7	2.1
	marriage	1.0	1.2	1.4	1.7	1.9	2.3
4000	ext, int	1.0	1.0	1.2	1.3	1.5	1.8
	marriage	1.0	1.1	1.3	1.4	1.6	2.0

Net Soil Pres (psf)		Marriage Wall Opening Width (ft)					
		10	12	14	16	18	20
1000	marriage	7.8	9.3	10.7	12.1	13.6	15.0
1500	marriage	5.2	6.2	7.1	8.1	9.0	10.0
2000	marriage	3.9	4.6	5.3	6.1	6.8	7.5
2500	marriage	3.1	3.7	4.3	4.9	5.4	6.0
3000	marriage	2.6	3.1	3.6	4.0	4.5	5.0
3500	marriage	2.2	2.6	3.1	3.5	3.9	4.3
4000	marriage	2.0	2.3	2.7	3.0	3.4	3.8

Ground Snow: 30 psf & Min. Roof: 20 psf							
Net Soil Pres (psf)		Pier Spacing (ft)					
		4	5	6	7	8	10
1000	ext, int	3.5	4.2	4.9	5.6	6.2	7.6
	marriage	3.7	4.5	5.3	6.1	6.9	8.5
1500	ext, int	2.3	2.8	3.2	3.7	4.2	5.1
	marriage	2.5	3.0	3.6	4.1	4.6	5.7
2000	ext, int	1.7	2.1	2.4	2.8	3.1	3.8
	marriage	1.9	2.3	2.7	3.1	3.5	4.2
2500	ext, int	1.4	1.7	1.9	2.2	2.5	3.1
	marriage	1.5	1.8	2.1	2.4	2.8	3.4
3000	ext, int	1.2	1.4	1.6	1.9	2.1	2.5
	marriage	1.2	1.5	1.8	2.0	2.3	2.8
3500	ext, int	1.0	1.2	1.4	1.6	1.8	2.2
	marriage	1.1	1.3	1.5	1.7	2.0	2.4
4000	ext, int	1.0	1.0	1.2	1.4	1.6	1.9
	marriage	1.0	1.1	1.3	1.5	1.7	2.1

Net Soil Pres (psf)		Marriage Wall Opening Width (ft)					
		10	12	14	16	18	20
1000	marriage	8.3	9.8	11.4	12.9	14.4	16.0
1500	marriage	5.5	6.6	7.6	8.6	9.6	10.6
2000	marriage	4.1	4.9	5.7	6.4	7.2	8.0
2500	marriage	3.3	3.9	4.5	5.2	5.8	6.4
3000	marriage	2.8	3.3	3.8	4.3	4.8	5.3
3500	marriage	2.4	2.8	3.2	3.7	4.1	4.6
4000	marriage	2.1	2.5	2.8	3.2	3.6	4.0

Ground Snow: 40 psf							
Net Soil Pres (psf)		Pier Spacing (ft)					
		4	5	6	7	8	10
1000	ext, int	3.7	4.4	5.1	5.9	6.6	8.1
	marriage	4.1	5.0	5.9	6.8	7.7	9.4
1500	ext, int	2.4	2.9	3.4	3.9	4.4	5.4
	marriage	2.8	3.3	3.9	4.5	5.1	6.3
2000	ext, int	1.8	2.2	2.6	2.9	3.3	4.1
	marriage	2.1	2.5	3.0	3.4	3.8	4.7
2500	ext, int	1.5	1.8	2.1	2.4	2.7	3.2
	marriage	1.7	2.0	2.4	2.7	3.1	3.8
3000	ext, int	1.2	1.5	1.7	2.0	2.2	2.7
	marriage	1.4	1.7	2.0	2.3	2.6	3.1
3500	ext, int	1.0	1.3	1.5	1.7	1.9	2.3
	marriage	1.2	1.4	1.7	1.9	2.2	2.7
4000	ext, int	1.0	1.1	1.3	1.5	1.7	2.0
	marriage	1.0	1.3	1.5	1.7	1.9	2.4

Net Soil Pres (psf)		Marriage Wall Opening Width (ft)					
		10	12	14	16	18	20
1000	marriage	9.2	11.0	12.7	14.4	16.2	17.9
1500	marriage	6.2	7.3	8.5	9.6	10.8	11.9
2000	marriage	4.6	5.5	6.3	7.2	8.1	8.9
2500	marriage	3.7	4.4	5.1	5.8	6.5	7.2
3000	marriage	3.1	3.7	4.2	4.8	5.4	6.0
3500	marriage	2.6	3.1	3.6	4.1	4.6	5.1
4000	marriage	2.3	2.7	3.2	3.6	4.0	4.5

* Minimum exterior and interior pier area is 1.0 sqft.

Aftg C 14'	
	Multi-Section
	Width

Required Effective Footing Area - Aftg (sqft) *

Ground Snow: 50 psf							
Net Soil		Pier Spacing (ft)					
Pres (psf)		4	5	6	7	8	10
1000	ext, int	3.9	4.6	5.4	6.2	7.0	8.6
	marriage	4.5	5.5	6.5	7.5	8.4	10.4
1500	ext, int	2.6	3.1	3.6	4.1	4.7	5.7
	marriage	3.0	3.7	4.3	5.0	5.6	6.9
2000	ext, int	1.9	2.3	2.7	3.1	3.5	4.3
	marriage	2.3	2.7	3.2	3.7	4.2	5.2
2500	ext, int	1.5	1.9	2.2	2.5	2.8	3.4
	marriage	1.8	2.2	2.6	3.0	3.4	4.2
3000	ext, int	1.3	1.5	1.8	2.1	2.3	2.9
	marriage	1.5	1.8	2.2	2.5	2.8	3.5
3500	ext, int	1.1	1.3	1.6	1.8	2.0	2.5
	marriage	1.3	1.6	1.8	2.1	2.4	3.0
4000	ext, int	1.0	1.2	1.4	1.6	1.8	2.1
	marriage	1.1	1.4	1.6	1.9	2.1	2.6
Net Soil		Marriage Wall Opening Width (ft)					
Pres (psf)		10	12	14	16	18	20
1000	marriage	10.2	12.1	14.0	16.0	17.9	19.8
	marriage	6.8	8.1	9.4	10.6	11.9	13.2
1500	marriage	5.1	6.1	7.0	8.0	8.9	9.9
	marriage	4.1	4.8	5.6	6.4	7.1	7.9
2000	marriage	3.4	4.0	4.7	5.3	6.0	6.6
	marriage	2.9	3.5	4.0	4.6	5.1	5.7
2500	marriage	2.6	3.0	3.5	4.0	4.5	4.9

Ground Snow: 70 psf							
Net Soil		Pier Spacing (ft)					
Pres (psf)		4	5	6	7	8	10
1000	ext, int	4.2	5.1	6.0	6.9	7.8	9.5
	marriage	5.3	6.5	7.6	8.8	10.0	12.3
1500	ext, int	2.8	3.4	4.0	4.6	5.2	6.4
	marriage	3.5	4.3	5.1	5.9	6.6	8.2
2000	ext, int	2.1	2.6	3.0	3.4	3.9	4.8
	marriage	2.6	3.2	3.8	4.4	5.0	6.2
2500	ext, int	1.7	2.0	2.4	2.8	3.1	3.8
	marriage	2.1	2.6	3.0	3.5	4.0	4.9
3000	ext, int	1.4	1.7	2.0	2.3	2.6	3.2
	marriage	1.8	2.2	2.5	2.9	3.3	4.1
3500	ext, int	1.2	1.5	1.7	2.0	2.2	2.7
	marriage	1.5	1.8	2.2	2.5	2.8	3.5
4000	ext, int	1.1	1.3	1.5	1.7	1.9	2.4
	marriage	1.3	1.6	1.9	2.2	2.5	3.1
Net Soil		Marriage Wall Opening Width (ft)					
Pres (psf)		10	12	14	16	18	20
1000	marriage	12.1	14.4	16.7	19.0	21.3	23.6
	marriage	8.1	9.6	11.1	12.7	14.2	15.7
1500	marriage	6.1	7.2	8.4	9.5	10.7	11.8
	marriage	4.8	5.8	6.8	7.6	8.5	9.4
2000	marriage	4.0	4.8	5.6	6.3	7.1	7.9
	marriage	3.5	4.1	4.7	5.4	6.1	6.7
2500	marriage	3.0	3.6	4.2	4.8	5.3	5.9

Ground Snow: 60 psf							
Net Soil		Pier Spacing (ft)					
Pres (psf)		4	5	6	7	8	10
1000	ext, int	4.0	4.9	5.7	6.6	7.4	9.1
	marriage	4.9	6.0	7.0	8.1	9.2	11.4
1500	ext, int	2.7	3.3	3.8	4.4	4.9	6.0
	marriage	3.3	4.0	4.7	5.4	6.1	7.6
2000	ext, int	2.0	2.4	2.9	3.3	3.7	4.5
	marriage	2.4	3.0	3.5	4.1	4.6	5.7
2500	ext, int	1.6	2.0	2.3	2.6	3.0	3.6
	marriage	2.0	2.4	2.8	3.3	3.7	4.5
3000	ext, int	1.3	1.6	1.9	2.2	2.5	3.0
	marriage	1.6	2.0	2.3	2.7	3.1	3.8
3500	ext, int	1.2	1.4	1.6	1.9	2.1	2.6
	marriage	1.4	1.7	2.0	2.3	2.6	3.2
4000	ext, int	1.0	1.2	1.4	1.6	1.8	2.3
	marriage	1.2	1.5	1.8	2.0	2.3	2.8
Net Soil		Marriage Wall Opening Width (ft)					
Pres (psf)		10	12	14	16	18	20
1000	marriage	11.2	13.3	15.4	17.5	19.6	21.7
	marriage	7.4	8.8	10.3	11.7	13.1	14.5
1500	marriage	5.6	6.6	7.7	8.7	9.8	10.9
	marriage	4.5	5.3	6.2	7.0	7.8	8.7
2000	marriage	3.7	4.4	5.1	5.8	6.5	7.2
	marriage	3.2	3.8	4.4	5.0	5.6	6.2
2500	marriage	2.8	3.3	3.8	4.4	4.9	5.4

Ground Snow: 80 psf							
Net Soil		Pier Spacing (ft)					
Pres (psf)		4	5	6	7	8	10
1000	ext, int	4.4	5.4	6.3	7.2	8.2	10.0
	marriage	5.7	6.9	8.2	9.5	10.7	13.3
1500	ext, int	3.0	3.6	4.2	4.8	5.4	6.7
	marriage	3.8	4.6	5.5	6.3	7.2	8.8
2000	ext, int	2.2	2.7	3.1	3.6	4.1	5.0
	marriage	2.8	3.5	4.1	4.7	5.4	6.6
2500	ext, int	1.8	2.1	2.5	2.9	3.3	4.0
	marriage	2.3	2.8	3.3	3.8	4.3	5.3
3000	ext, int	1.5	1.8	2.1	2.4	2.7	3.3
	marriage	1.9	2.3	2.7	3.2	3.6	4.4
3500	ext, int	1.3	1.5	1.8	2.1	2.3	2.9
	marriage	1.6	2.0	2.3	2.7	3.1	3.8
4000	ext, int	1.1	1.3	1.6	1.8	2.0	2.5
	marriage	1.4	1.7	2.0	2.4	2.7	3.3
Net Soil		Marriage Wall Opening Width (ft)					
Pres (psf)		10	12	14	16	18	20
1000	marriage	13.1	15.6	18.1	20.5	23.0	25.5
	marriage	8.7	10.4	12.0	13.7	15.4	17.0
1500	marriage	6.5	7.8	9.0	10.3	11.5	12.8
	marriage	5.2	6.2	7.2	8.2	9.2	10.2
2000	marriage	4.4	5.2	6.0	6.8	7.7	8.5
	marriage	3.7	4.4	5.2	5.9	6.6	7.3
2500	marriage	3.3	3.9	4.5	5.1	5.8	6.4

* Minimum exterior and interior pier area is 1.0 sqft.

Required Effective Footing Area - Aftg (sqft) *



		Ground Snow: 90 psf					
Net Soil Pres (psf)		Pier Spacing (ft)					
		4	5	6	7	8	10
1000	ext, int	4.6	5.6	6.6	7.6	8.5	10.5
	marriage	6.0	7.4	8.8	10.1	11.5	14.2
1500	ext, int	3.1	3.7	4.4	5.0	5.7	7.0
	marriage	4.0	4.9	5.8	6.8	7.7	9.5
2000	ext, int	2.3	2.8	3.3	3.8	4.3	5.3
	marriage	3.0	3.7	4.4	5.1	5.7	7.1
2500	ext, int	1.8	2.2	2.6	3.0	3.4	4.2
	marriage	2.4	3.0	3.5	4.1	4.6	5.7
3000	ext, int	1.5	1.9	2.2	2.5	2.8	3.5
	marriage	2.0	2.5	2.9	3.4	3.8	4.7
3500	ext, int	1.3	1.6	1.9	2.2	2.4	3.0
	marriage	1.7	2.1	2.5	2.9	3.3	4.1
4000	ext, int	1.2	1.4	1.6	1.9	2.1	2.6
	marriage	1.5	1.9	2.2	2.5	2.9	3.6
Net Soil Pres (psf)		Marriage Wall Opening Width (ft)					
		10	12	14	16	18	20
1000	marriage	14.0	16.7	19.4	22.1	24.8	27.4
1500	marriage	9.4	11.1	12.9	14.7	16.5	18.3
2000	marriage	7.0	8.4	9.7	11.0	12.4	13.7
2500	marriage	5.6	6.7	7.8	8.8	9.9	11.0
3000	marriage	4.7	5.6	6.5	7.4	8.3	9.1
3500	marriage	4.0	4.8	5.5	6.3	7.1	7.8
4000	marriage	3.5	4.2	4.8	5.5	6.2	6.9

		Ground Snow: 100 psf					
Net Soil Pres (psf)		Pier Spacing (ft)					
		4	5	6	7	8	10
1000	ext, int	4.8	5.8	6.9	7.9	8.9	11.0
	marriage	6.4	7.9	9.3	10.8	12.3	15.2
1500	ext, int	3.2	3.9	4.6	5.3	6.0	7.3
	marriage	4.3	5.3	6.2	7.2	8.2	10.1
2000	ext, int	2.4	2.9	3.4	3.9	4.5	5.5
	marriage	3.2	3.9	4.7	5.4	6.1	7.6
2500	ext, int	1.9	2.3	2.7	3.2	3.6	4.4
	marriage	2.6	3.2	3.7	4.3	4.9	6.1
3000	ext, int	1.6	1.9	2.3	2.6	3.0	3.7
	marriage	2.1	2.6	3.1	3.6	4.1	5.1
3500	ext, int	1.4	1.7	2.0	2.3	2.6	3.1
	marriage	1.8	2.3	2.7	3.1	3.5	4.3
4000	ext, int	1.2	1.5	1.7	2.0	2.2	2.7
	marriage	1.6	2.0	2.3	2.7	3.1	3.8
Net Soil Pres (psf)		Marriage Wall Opening Width (ft)					
		10	12	14	16	18	20
1000	marriage	15.0	17.9	20.7	23.6	26.5	29.4
1500	marriage	10.0	11.9	13.8	15.7	17.7	19.6
2000	marriage	7.5	8.9	10.4	11.8	13.2	14.7
2500	marriage	6.0	7.1	8.3	9.4	10.6	11.7
3000	marriage	5.0	6.0	6.9	7.9	8.8	9.8
3500	marriage	4.3	5.1	5.9	6.7	7.6	8.4
4000	marriage	3.7	4.5	5.2	5.9	6.6	7.3

* Minimum exterior and interior pier area is 1.0 sqft.

Aftg C 16'	
	Multi-Section
	Width

Required Effective Footing Area - Aftg (sqft) *

Min. Roof: 15 psf							
Net Soil Pres (psf)		Pier Spacing (ft)					
		4	5	6	7	8	10
1000	ext, int	3.6	4.4	5.1	5.8	6.6	8.0
	marriage	3.7	4.5	5.3	6.1	6.9	8.5
1500	ext, int	2.4	2.9	3.4	3.9	4.4	5.4
	marriage	2.5	3.0	3.6	4.1	4.6	5.7
2000	ext, int	1.8	2.2	2.5	2.9	3.3	4.0
	marriage	1.9	2.3	2.7	3.1	3.5	4.2
2500	ext, int	1.5	1.7	2.0	2.3	2.6	3.2
	marriage	1.5	1.8	2.1	2.4	2.8	3.4
3000	ext, int	1.2	1.5	1.7	1.9	2.2	2.7
	marriage	1.2	1.5	1.8	2.0	2.3	2.8
3500	ext, int	1.0	1.2	1.5	1.7	1.9	2.3
	marriage	1.1	1.3	1.5	1.7	2.0	2.4
4000	ext, int	1.0	1.1	1.3	1.5	1.6	2.0
	marriage	1.0	1.1	1.3	1.5	1.7	2.1

Net Soil Pres (psf)		Marriage Wall Opening Width (ft)					
		10	12	14	16	18	20
1000	marriage	8.3	9.8	11.4	12.9	14.4	16.0
	marriage	5.5	6.6	7.6	8.6	9.6	10.6
1500	marriage	4.1	4.9	5.7	6.5	7.2	8.0
	marriage	3.3	3.9	4.5	5.2	5.8	6.4
2000	marriage	2.8	3.3	3.8	4.3	4.8	5.3
	marriage	2.4	2.8	3.2	3.7	4.1	4.6
2500	marriage	2.1	2.5	2.8	3.2	3.6	4.0

Ground Snow: 25 psf							
Net Soil Pres (psf)		Pier Spacing (ft)					
		4	5	6	7	8	10
1000	ext, int	3.7	4.5	5.2	6.0	6.7	8.2
	marriage	3.9	4.7	5.6	6.4	7.2	8.9
1500	ext, int	2.5	3.0	3.5	4.0	4.5	5.5
	marriage	2.6	3.2	3.7	4.3	4.8	5.9
2000	ext, int	1.9	2.2	2.6	3.0	3.4	4.1
	marriage	2.0	2.4	2.8	3.2	3.6	4.4
2500	ext, int	1.5	1.8	2.1	2.4	2.7	3.3
	marriage	1.6	1.9	2.2	2.6	2.9	3.6
3000	ext, int	1.2	1.5	1.7	2.0	2.2	2.7
	marriage	1.3	1.6	1.9	2.1	2.4	3.0
3500	ext, int	1.1	1.3	1.5	1.7	1.9	2.3
	marriage	1.1	1.4	1.6	1.8	2.1	2.5
4000	ext, int	1.0	1.1	1.3	1.5	1.7	2.1
	marriage	1.0	1.2	1.4	1.6	1.8	2.2

Net Soil Pres (psf)		Marriage Wall Opening Width (ft)					
		10	12	14	16	18	20
1000	marriage	8.7	10.3	11.9	13.5	15.1	16.7
	marriage	5.8	6.9	7.9	9.0	10.1	11.2
1500	marriage	4.3	5.1	6.0	6.8	7.6	8.4
	marriage	3.5	4.1	4.8	5.4	6.1	6.7
2000	marriage	2.9	3.4	4.0	4.5	5.0	5.6
	marriage	2.5	2.9	3.4	3.9	4.3	4.8
2500	marriage	2.2	2.6	3.0	3.4	3.8	4.2

Ground Snow: 30 psf & Min. Roof: 20 psf							
Net Soil Pres (psf)		Pier Spacing (ft)					
		4	5	6	7	8	10
1000	ext, int	3.8	4.6	5.4	6.2	6.9	8.5
	marriage	4.1	5.0	5.9	6.8	7.7	9.4
1500	ext, int	2.5	3.1	3.6	4.1	4.6	5.7
	marriage	2.7	3.3	3.9	4.5	5.1	6.3
2000	ext, int	1.9	2.3	2.7	3.1	3.5	4.2
	marriage	2.1	2.5	2.9	3.4	3.8	4.7
2500	ext, int	1.5	1.8	2.2	2.5	2.8	3.4
	marriage	1.6	2.0	2.4	2.7	3.1	3.8
3000	ext, int	1.3	1.5	1.8	2.1	2.3	2.8
	marriage	1.4	1.7	2.0	2.3	2.6	3.1
3500	ext, int	1.1	1.3	1.5	1.8	2.0	2.4
	marriage	1.2	1.4	1.7	1.9	2.2	2.7
4000	ext, int	1.0	1.1	1.3	1.5	1.7	2.1
	marriage	1.0	1.3	1.5	1.7	1.9	2.4

Net Soil Pres (psf)		Marriage Wall Opening Width (ft)					
		10	12	14	16	18	20
1000	marriage	9.2	10.9	12.7	14.4	16.1	17.8
	marriage	6.2	7.3	8.4	9.6	10.7	11.9
1500	marriage	4.6	5.5	6.3	7.2	8.1	8.9
	marriage	3.7	4.4	5.1	5.8	6.4	7.1
2000	marriage	3.1	3.6	4.2	4.8	5.4	5.9
	marriage	2.6	3.1	3.6	4.1	4.6	5.1
2500	marriage	2.3	2.7	3.2	3.6	4.0	4.5

Ground Snow: 40 psf							
Net Soil Pres (psf)		Pier Spacing (ft)					
		4	5	6	7	8	10
1000	ext, int	4.0	4.9	5.7	6.5	7.4	9.0
	marriage	4.6	5.5	6.5	7.5	8.5	10.5
1500	ext, int	2.7	3.2	3.8	4.4	4.9	6.0
	marriage	3.0	3.7	4.4	5.0	5.7	7.0
2000	ext, int	2.0	2.4	2.9	3.3	3.7	4.5
	marriage	2.3	2.8	3.3	3.8	4.3	5.3
2500	ext, int	1.6	1.9	2.3	2.6	2.9	3.6
	marriage	1.8	2.2	2.6	3.0	3.4	4.2
3000	ext, int	1.3	1.6	1.9	2.2	2.5	3.0
	marriage	1.5	1.8	2.2	2.5	2.8	3.5
3500	ext, int	1.2	1.4	1.6	1.9	2.1	2.6
	marriage	1.3	1.6	1.9	2.2	2.4	3.0
4000	ext, int	1.0	1.2	1.4	1.6	1.8	2.3
	marriage	1.1	1.4	1.6	1.9	2.1	2.6

Net Soil Pres (psf)		Marriage Wall Opening Width (ft)					
		10	12	14	16	18	20
1000	marriage	10.3	12.2	14.2	16.1	18.1	20.0
	marriage	6.9	8.2	9.5	10.7	12.0	13.3
1500	marriage	5.2	6.1	7.1	8.1	9.0	10.0
	marriage	4.1	4.9	5.7	6.4	7.2	8.0
2000	marriage	3.4	4.1	4.7	5.4	6.0	6.7
	marriage	2.9	3.5	4.1	4.6	5.2	5.7
2500	marriage	2.6	3.1	3.5	4.0	4.5	5.0

* Minimum exterior and interior pier area is 1.0 sqft.

Required Effective Footing Area - Aftg (sqft) *



Ground Snow: 50 psf							
Net Soil Pres (psf)		Pier Spacing (ft)					
		4	5	6	7	8	10
1000	ext, int	4.3	5.1	6.0	6.9	7.8	9.6
	marriage	5.0	6.1	7.2	8.3	9.4	11.6
1500	ext, int	2.8	3.4	4.0	4.6	5.2	6.4
	marriage	3.3	4.1	4.8	5.5	6.3	7.7
2000	ext, int	2.1	2.6	3.0	3.5	3.9	4.8
	marriage	2.5	3.0	3.6	4.1	4.7	5.8
2500	ext, int	1.7	2.1	2.4	2.8	3.1	3.8
	marriage	2.0	2.4	2.9	3.3	3.8	4.6
3000	ext, int	1.4	1.7	2.0	2.3	2.6	3.2
	marriage	1.7	2.0	2.4	2.8	3.1	3.9
3500	ext, int	1.2	1.5	1.7	2.0	2.2	2.7
	marriage	1.4	1.7	2.1	2.4	2.7	3.3
4000	ext, int	1.1	1.3	1.5	1.7	2.0	2.4
	marriage	1.2	1.5	1.8	2.1	2.3	2.9

Marriage Wall Opening Width (ft)							
Net Soil Pres (psf)		10	12	14	16	18	20
1000	marriage	11.4	13.6	15.7	17.9	20.0	22.2
1500	marriage	7.6	9.0	10.5	11.9	13.3	14.8
2000	marriage	5.7	6.8	7.9	8.9	10.0	11.1
2500	marriage	4.6	5.4	6.3	7.1	8.0	8.9
3000	marriage	3.8	4.5	5.2	6.0	6.7	7.4
3500	marriage	3.3	3.9	4.5	5.1	5.7	6.3
4000	marriage	2.8	3.4	3.9	4.5	5.0	5.5

Ground Snow: 60 psf							
Net Soil Pres (psf)		Pier Spacing (ft)					
		4	5	6	7	8	10
1000	ext, int	4.5	5.4	6.4	7.3	8.2	10.1
	marriage	5.4	6.6	7.8	9.0	10.3	12.7
1500	ext, int	3.0	3.6	4.2	4.9	5.5	6.7
	marriage	3.6	4.4	5.2	6.0	6.8	8.5
2000	ext, int	2.2	2.7	3.2	3.6	4.1	5.1
	marriage	2.7	3.3	3.9	4.5	5.1	6.3
2500	ext, int	1.8	2.2	2.5	2.9	3.3	4.0
	marriage	2.2	2.7	3.1	3.6	4.1	5.1
3000	ext, int	1.5	1.8	2.1	2.4	2.7	3.4
	marriage	1.8	2.2	2.6	3.0	3.4	4.2
3500	ext, int	1.3	1.5	1.8	2.1	2.4	2.9
	marriage	1.5	1.9	2.2	2.6	2.9	3.6
4000	ext, int	1.1	1.4	1.6	1.8	2.1	2.5
	marriage	1.4	1.7	2.0	2.3	2.6	3.2

Marriage Wall Opening Width (ft)							
Net Soil Pres (psf)		10	12	14	16	18	20
1000	marriage	12.5	14.9	17.2	19.6	22.0	24.3
1500	marriage	8.3	9.9	11.5	13.1	14.6	16.2
2000	marriage	6.2	7.4	8.6	9.8	11.0	12.2
2500	marriage	5.0	5.9	6.9	7.8	8.8	9.7
3000	marriage	4.2	5.0	5.7	6.5	7.3	8.1
3500	marriage	3.6	4.2	4.9	5.6	6.3	7.0
4000	marriage	3.1	3.7	4.3	4.9	5.5	6.1

Ground Snow: 70 psf							
Net Soil Pres (psf)		Pier Spacing (ft)					
		4	5	6	7	8	10
1000	ext, int	4.7	5.7	6.7	7.7	8.7	10.7
	marriage	5.9	7.2	8.5	9.8	11.1	13.8
1500	ext, int	3.1	3.8	4.5	5.1	5.8	7.1
	marriage	3.9	4.8	5.7	6.5	7.4	9.2
2000	ext, int	2.3	2.8	3.3	3.8	4.3	5.3
	marriage	2.9	3.6	4.2	4.9	5.6	6.9
2500	ext, int	1.9	2.3	2.7	3.1	3.5	4.3
	marriage	2.3	2.9	3.4	3.9	4.5	5.5
3000	ext, int	1.6	1.9	2.2	2.6	2.9	3.6
	marriage	2.0	2.4	2.8	3.3	3.7	4.6
3500	ext, int	1.3	1.6	1.9	2.2	2.5	3.0
	marriage	1.7	2.0	2.4	2.8	3.2	3.9
4000	ext, int	1.2	1.4	1.7	1.9	2.2	2.7
	marriage	1.5	1.8	2.1	2.5	2.8	3.4

Marriage Wall Opening Width (ft)							
Net Soil Pres (psf)		10	12	14	16	18	20
1000	marriage	13.6	16.2	18.7	21.3	23.9	26.5
1500	marriage	9.0	10.8	12.5	14.2	15.9	17.7
2000	marriage	6.8	8.1	9.4	10.7	12.0	13.3
2500	marriage	5.4	6.5	7.5	8.5	9.6	10.6
3000	marriage	4.5	5.4	6.2	7.1	8.0	8.8
3500	marriage	3.9	4.6	5.4	6.1	6.8	7.6
4000	marriage	3.4	4.0	4.7	5.3	6.0	6.6

Ground Snow: 80 psf							
Net Soil Pres (psf)		Pier Spacing (ft)					
		4	5	6	7	8	10
1000	ext, int	4.9	6.0	7.0	8.1	9.1	11.2
	marriage	6.3	7.7	9.1	10.6	12.0	14.8
1500	ext, int	3.3	4.0	4.7	5.4	6.1	7.5
	marriage	4.2	5.1	6.1	7.0	8.0	9.9
2000	ext, int	2.5	3.0	3.5	4.0	4.6	5.6
	marriage	3.1	3.9	4.6	5.3	6.0	7.4
2500	ext, int	2.0	2.4	2.8	3.2	3.6	4.5
	marriage	2.5	3.1	3.7	4.2	4.8	5.9
3000	ext, int	1.6	2.0	2.3	2.7	3.0	3.7
	marriage	2.1	2.6	3.0	3.5	4.0	4.9
3500	ext, int	1.4	1.7	2.0	2.3	2.6	3.2
	marriage	1.8	2.2	2.6	3.0	3.4	4.2
4000	ext, int	1.2	1.5	1.8	2.0	2.3	2.8
	marriage	1.6	1.9	2.3	2.6	3.0	3.7

Marriage Wall Opening Width (ft)							
Net Soil Pres (psf)		10	12	14	16	18	20
1000	marriage	14.7	17.5	20.3	23.1	25.9	28.7
1500	marriage	9.8	11.6	13.5	15.4	17.2	19.1
2000	marriage	7.3	8.7	10.1	11.5	12.9	14.3
2500	marriage	5.9	7.0	8.1	9.2	10.3	11.5
3000	marriage	4.9	5.8	6.8	7.7	8.6	9.6
3500	marriage	4.2	5.0	5.8	6.6	7.4	8.2
4000	marriage	3.7	4.4	5.1	5.8	6.5	7.2

* Minimum exterior and interior pier area is 1.0 sqft.

Aftg C 16'	 Multi-Section Width
-------------------------	--

Required Effective Footing Area - Aftg (sqft) *

		Ground Snow: 90 psf					
Net Soil Pres (psf)		Pier Spacing (ft)					
		4	5	6	7	8	10
1000	ext, int	5.1	6.2	7.3	8.4	9.5	11.7
	marriage	6.7	8.3	9.8	11.3	12.9	15.9
1500	ext, int	3.4	4.1	4.9	5.6	6.4	7.8
	marriage	4.5	5.5	6.5	7.6	8.6	10.6
2000	ext, int	2.6	3.1	3.7	4.2	4.8	5.9
	marriage	3.4	4.1	4.9	5.7	6.4	8.0
2500	ext, int	2.0	2.5	2.9	3.4	3.8	4.7
	marriage	2.7	3.3	3.9	4.5	5.1	6.4
3000	ext, int	1.7	2.1	2.4	2.8	3.2	3.9
	marriage	2.2	2.8	3.3	3.8	4.3	5.3
3500	ext, int	1.5	1.8	2.1	2.4	2.7	3.4
	marriage	1.9	2.4	2.8	3.2	3.7	4.6
4000	ext, int	1.3	1.6	1.8	2.1	2.4	2.9
	marriage	1.7	2.1	2.4	2.8	3.2	4.0
Net Soil Pres (psf)		Marriage Wall Opening Width (ft)					
		10	12	14	16	18	20
1000	marriage	15.7	18.8	21.8	24.8	27.8	30.9
1500	marriage	10.5	12.5	14.5	16.5	18.6	20.6
2000	marriage	7.9	9.4	10.9	12.4	13.9	15.4
2500	marriage	6.3	7.5	8.7	9.9	11.1	12.3
3000	marriage	5.2	6.3	7.3	8.3	9.3	10.3
3500	marriage	4.5	5.4	6.2	7.1	8.0	8.8
4000	marriage	3.9	4.7	5.4	6.2	7.0	7.7

		Ground Snow: 100 psf					
Net Soil Pres (psf)		Pier Spacing (ft)					
		4	5	6	7	8	10
1000	ext, int	5.3	6.5	7.7	8.8	10.0	12.3
	marriage	7.2	8.8	10.4	12.1	13.7	17.0
1500	ext, int	3.6	4.3	5.1	5.9	6.6	8.2
	marriage	4.8	5.9	7.0	8.1	9.2	11.3
2000	ext, int	2.7	3.2	3.8	4.4	5.0	6.1
	marriage	3.6	4.4	5.2	6.0	6.9	8.5
2500	ext, int	2.1	2.6	3.1	3.5	4.0	4.9
	marriage	2.9	3.5	4.2	4.8	5.5	6.8
3000	ext, int	1.8	2.2	2.6	2.9	3.3	4.1
	marriage	2.4	2.9	3.5	4.0	4.6	5.7
3500	ext, int	1.5	1.9	2.2	2.5	2.8	3.5
	marriage	2.0	2.5	3.0	3.5	3.9	4.9
4000	ext, int	1.3	1.6	1.9	2.2	2.5	3.1
	marriage	1.8	2.2	2.6	3.0	3.4	4.3
Net Soil Pres (psf)		Marriage Wall Opening Width (ft)					
		10	12	14	16	18	20
1000	marriage	16.8	20.1	23.3	26.5	29.8	33.0
1500	marriage	11.2	13.4	15.5	17.7	19.9	22.0
2000	marriage	8.4	10.0	11.7	13.3	14.9	16.5
2500	marriage	6.7	8.0	9.3	10.6	11.9	13.2
3000	marriage	5.6	6.7	7.8	8.8	9.9	11.0
3500	marriage	4.8	5.7	6.7	7.6	8.5	9.4
4000	marriage	4.2	5.0	5.8	6.6	7.4	8.3


* Minimum exterior and interior pier area is 1.0 sqft.

Multi-Section Cnw

Required Effective Footing Area - Aftg (sqft) *

Min. Roof: 15 psf

Net Soil Pres (psf)		Pier Spacing (ft)					
		4	5	6	7	8	10
1000	pier	3.0	3.5	4.1	4.7	5.2	6.3
1500	pier	2.0	2.3	2.7	3.1	3.5	4.2
2000	pier	1.5	1.8	2.0	2.3	2.6	3.2
2500	pier	1.2	1.4	1.6	1.9	2.1	2.5
3000	pier	1.0	1.2	1.4	1.6	1.7	2.1
3500	pier	1.0	1.0	1.2	1.3	1.5	1.8
4000	pier	1.0	1.0	1.0	1.2	1.3	1.6

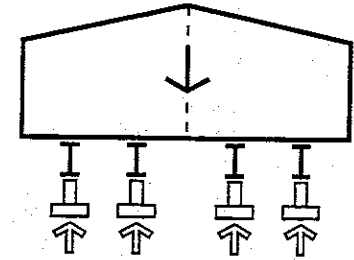

Ground Snow: 25 psf

Net Soil Pres (psf)		Pier Spacing (ft)					
		4	5	6	7	8	10
1000	pier	3.0	3.6	4.2	4.8	5.3	6.5
1500	pier	2.0	2.4	2.8	3.2	3.6	4.3
2000	pier	1.5	1.8	2.1	2.4	2.7	3.2
2500	pier	1.2	1.4	1.7	1.9	2.1	2.6
3000	pier	1.0	1.2	1.4	1.6	1.8	2.2
3500	pier	1.0	1.0	1.2	1.4	1.5	1.9
4000	pier	1.0	1.0	1.0	1.2	1.3	1.6

Ground Snow: 30 psf & Min. Roof: 20 psf

Net Soil Pres (psf)		Pier Spacing (ft)					
		4	5	6	7	8	10
1000	pier	3.1	3.7	4.3	4.9	5.5	6.7
1500	pier	2.1	2.5	2.9	3.3	3.7	4.5
2000	pier	1.5	1.8	2.1	2.4	2.7	3.3
2500	pier	1.2	1.5	1.7	2.0	2.2	2.7
3000	pier	1.0	1.2	1.4	1.6	1.8	2.2
3500	pier	1.0	1.1	1.2	1.4	1.6	1.9
4000	pier	1.0	1.0	1.1	1.2	1.4	1.7

Ground Snow: 40 psf

Net Soil Pres (psf)		Pier Spacing (ft)					
		4	5	6	7	8	10
1000	pier	3.3	3.9	4.5	5.2	5.8	7.1
1500	pier	2.2	2.6	3.0	3.5	3.9	4.7
2000	pier	1.6	2.0	2.3	2.6	2.9	3.6
2500	pier	1.3	1.6	1.8	2.1	2.3	2.8
3000	pier	1.1	1.3	1.5	1.7	1.9	2.4
3500	pier	1.0	1.1	1.3	1.5	1.7	2.0
4000	pier	1.0	1.0	1.1	1.3	1.5	1.8

Ground Snow: 50 psf

Net Soil Pres (psf)		Pier Spacing (ft)					
		4	5	6	7	8	10
1000	pier	3.4	4.1	4.8	5.5	6.2	7.5
1500	pier	2.3	2.7	3.2	3.6	4.1	5.0
2000	pier	1.7	2.1	2.4	2.7	3.1	3.8
2500	pier	1.4	1.6	1.9	2.2	2.5	3.0
3000	pier	1.1	1.4	1.6	1.8	2.1	2.5
3500	pier	1.0	1.2	1.4	1.6	1.8	2.1
4000	pier	1.0	1.0	1.2	1.4	1.5	1.9

Ground Snow: 60 psf

Net Soil Pres (psf)		Pier Spacing (ft)					
		4	5	6	7	8	10
1000	pier	3.6	4.3	5.0	5.8	6.5	7.9
1500	pier	2.4	2.9	3.4	3.8	4.3	5.3
2000	pier	1.8	2.2	2.5	2.9	3.2	4.0
2500	pier	1.4	1.7	2.0	2.3	2.6	3.2
3000	pier	1.2	1.4	1.7	1.9	2.2	2.6
3500	pier	1.0	1.2	1.4	1.6	1.9	2.3
4000	pier	1.0	1.1	1.3	1.4	1.6	2.0

Ground Snow: 70 psf

Net Soil Pres (psf)		Pier Spacing (ft)					
		4	5	6	7	8	10
1000	pier	3.8	4.5	5.3	6.0	6.8	8.3
1500	pier	2.5	3.0	3.5	4.0	4.5	5.6
2000	pier	1.9	2.3	2.6	3.0	3.4	4.2
2500	pier	1.5	1.8	2.1	2.4	2.7	3.3
3000	pier	1.3	1.5	1.8	2.0	2.3	2.8
3500	pier	1.1	1.3	1.5	1.7	1.9	2.4
4000	pier	1.0	1.1	1.3	1.5	1.7	2.1

* Minimum exterior and interior pier area is 1.0 sqft.

Aftg Cnw 12'		
	Multi-Section Width	

Ground Snow: 80 psf							
Net Soil Pres (psf)		Pier Spacing (ft)					
		4	5	6	7	8	10
1000	pier	3.9	4.7	5.5	6.3	7.1	8.7
1500	pier	2.6	3.1	3.7	4.2	4.8	5.8
2000	pier	2.0	2.4	2.8	3.2	3.6	4.4
2500	pier	1.6	1.9	2.2	2.5	2.9	3.5
3000	pier	1.3	1.6	1.8	2.1	2.4	2.9
3500	pier	1.1	1.3	1.6	1.8	2.0	2.5
4000	pier	1.0	1.2	1.4	1.6	1.8	2.2

Ground Snow: 100 psf							
Net Soil Pres (psf)		Pier Spacing (ft)					
		4	5	6	7	8	10
1000	pier	4.2	5.1	6.0	6.9	7.8	9.6
1500	pier	2.8	3.4	4.0	4.6	5.2	6.4
2000	pier	2.1	2.6	3.0	3.4	3.9	4.8
2500	pier	1.7	2.1	2.4	2.8	3.1	3.8
3000	pier	1.4	1.7	2.0	2.3	2.6	3.2
3500	pier	1.2	1.5	1.7	2.0	2.2	2.7
4000	pier	1.1	1.3	1.5	1.7	1.9	2.4

Aftg Cnw 14'		
	Multi-Section Width	

Min. Roof: 15 psf							
Net Soil Pres (psf)		Pier Spacing (ft)					
		4	5	6	7	8	10
1000	pier	3.3	4.0	4.6	5.3	5.9	7.2
1500	pier	2.2	2.6	3.1	3.5	3.9	4.8
2000	pier	1.7	2.0	2.3	2.6	3.0	3.6
2500	pier	1.3	1.6	1.8	2.1	2.4	2.9
3000	pier	1.1	1.3	1.5	1.8	2.0	2.4
3500	pier	1.0	1.1	1.3	1.5	1.7	2.1
4000	pier	1.0	1.0	1.2	1.3	1.5	1.8

Ground Snow: 30 psf & Min. Roof: 20 psf							
Net Soil Pres (psf)		Pier Spacing (ft)					
		4	5	6	7	8	10
1000	pier	3.5	4.2	4.9	5.6	6.2	7.6
1500	pier	2.3	2.8	3.2	3.7	4.2	5.1
2000	pier	1.7	2.1	2.4	2.8	3.1	3.8
2500	pier	1.4	1.7	1.9	2.2	2.5	3.1
3000	pier	1.2	1.4	1.6	1.9	2.1	2.5
3500	pier	1.0	1.2	1.4	1.6	1.8	2.2
4000	pier	1.0	1.0	1.2	1.4	1.6	1.9

Required Effective Footing Area - Aftg (sqft) *

Ground Snow: 90 psf							
Net Soil Pres (psf)		Pier Spacing (ft)					
		4	5	6	7	8	10
1000	pier	4.1	4.9	5.8	6.6	7.5	9.1
1500	pier	2.7	3.3	3.8	4.4	5.0	6.1
2000	pier	2.0	2.5	2.9	3.3	3.7	4.6
2500	pier	1.6	2.0	2.3	2.6	3.0	3.7
3000	pier	1.4	1.6	1.9	2.2	2.5	3.0
3500	pier	1.2	1.4	1.6	1.9	2.1	2.6
4000	pier	1.0	1.2	1.4	1.7	1.9	2.3

Required Effective Footing Area - Aftg (sqft) *

Ground Snow: 25 psf							
Net Soil Pres (psf)		Pier Spacing (ft)					
		4	5	6	7	8	10
1000	pier	3.4	4.0	4.7	5.4	6.1	7.4
1500	pier	2.3	2.7	3.1	3.6	4.0	4.9
2000	pier	1.7	2.0	2.4	2.7	3.0	3.7
2500	pier	1.4	1.6	1.9	2.2	2.4	3.0
3000	pier	1.1	1.3	1.6	1.8	2.0	2.5
3500	pier	1.0	1.2	1.3	1.5	1.7	2.1
4000	pier	1.0	1.0	1.2	1.3	1.5	1.8

Ground Snow: 40 psf							
Net Soil Pres (psf)		Pier Spacing (ft)					
		4	5	6	7	8	10
1000	pier	3.7	4.4	5.1	5.9	6.6	8.1
1500	pier	2.4	2.9	3.4	3.9	4.4	5.4
2000	pier	1.8	2.2	2.6	2.9	3.3	4.1
2500	pier	1.5	1.8	2.1	2.4	2.7	3.2
3000	pier	1.2	1.5	1.7	2.0	2.2	2.7
3500	pier	1.0	1.3	1.5	1.7	1.9	2.3
4000	pier	1.0	1.1	1.3	1.5	1.7	2.0

* Minimum exterior and interior pier area is 1.0 sqft.

Required Effective Footing Area - Aftg (sqft) *



Ground Snow: 50 psf							
Net Soil Pres (psf)		Pier Spacing (ft)					
		4	5	6	7	8	10
1000	pier	3.9	4.6	5.4	6.2	7.0	8.6
1500	pier	2.6	3.1	3.6	4.1	4.7	5.7
2000	pier	1.9	2.3	2.7	3.1	3.5	4.3
2500	pier	1.5	1.9	2.2	2.5	2.8	3.4
3000	pier	1.3	1.5	1.8	2.1	2.3	2.9
3500	pier	1.1	1.3	1.6	1.8	2.0	2.5
4000	pier	1.0	1.2	1.4	1.6	1.8	2.1

Ground Snow: 60 psf							
Net Soil Pres (psf)		Pier Spacing (ft)					
		4	5	6	7	8	10
1000	pier	4.0	4.9	5.7	6.6	7.4	9.1
1500	pier	2.7	3.3	3.8	4.4	4.9	6.0
2000	pier	2.0	2.4	2.9	3.3	3.7	4.5
2500	pier	1.6	2.0	2.3	2.6	3.0	3.6
3000	pier	1.3	1.6	1.9	2.2	2.5	3.0
3500	pier	1.2	1.4	1.6	1.9	2.1	2.6
4000	pier	1.0	1.2	1.4	1.6	1.8	2.3


Ground Snow: 70 psf							
Net Soil Pres (psf)		Pier Spacing (ft)					
		4	5	6	7	8	10
1000	pier	4.2	5.1	6.0	6.9	7.8	9.5
1500	pier	2.8	3.4	4.0	4.6	5.2	6.4
2000	pier	2.1	2.6	3.0	3.4	3.9	4.8
2500	pier	1.7	2.0	2.4	2.8	3.1	3.8
3000	pier	1.4	1.7	2.0	2.3	2.6	3.2
3500	pier	1.2	1.5	1.7	2.0	2.2	2.7
4000	pier	1.1	1.3	1.5	1.7	1.9	2.4

Ground Snow: 80 psf							
Net Soil Pres (psf)		Pier Spacing (ft)					
		4	5	6	7	8	10
1000	pier	4.4	5.4	6.3	7.2	8.2	10.0
1500	pier	3.0	3.6	4.2	4.8	5.4	6.7
2000	pier	2.2	2.7	3.1	3.6	4.1	5.0
2500	pier	1.8	2.1	2.5	2.9	3.3	4.0
3000	pier	1.5	1.8	2.1	2.4	2.7	3.3
3500	pier	1.3	1.5	1.8	2.1	2.3	2.9
4000	pier	1.1	1.3	1.6	1.8	2.0	2.5

Ground Snow: 90 psf							
Net Soil Pres (psf)		Pier Spacing (ft)					
		4	5	6	7	8	10
1000	pier	4.6	5.6	6.6	7.6	8.5	10.5
1500	pier	3.1	3.7	4.4	5.0	5.7	7.0
2000	pier	2.3	2.8	3.3	3.8	4.3	5.3
2500	pier	1.8	2.2	2.6	3.0	3.4	4.2
3000	pier	1.5	1.9	2.2	2.5	2.8	3.5
3500	pier	1.3	1.6	1.9	2.2	2.4	3.0
4000	pier	1.2	1.4	1.6	1.9	2.1	2.6

Ground Snow: 100 psf							
Net Soil Pres (psf)		Pier Spacing (ft)					
		4	5	6	7	8	10
1000	pier	4.8	5.8	6.9	7.9	8.9	11.0
1500	pier	3.2	3.9	4.6	5.3	6.0	7.3
2000	pier	2.4	2.9	3.4	3.9	4.5	5.5
2500	pier	1.9	2.3	2.7	3.2	3.6	4.4
3000	pier	1.6	1.9	2.3	2.6	3.0	3.7
3500	pier	1.4	1.7	2.0	2.3	2.6	3.1
4000	pier	1.2	1.5	1.7	2.0	2.2	2.7

Required Effective Footing Area - Aftg (sqft) *

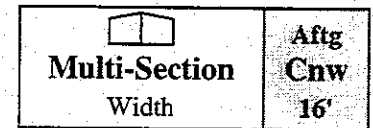

Min. Roof: 15 psf							
Net Soil Pres (psf)		Pier Spacing (ft)					
		4	5	6	7	8	10
1000	pier	3.6	4.4	5.1	5.8	6.6	8.0
1500	pier	2.4	2.9	3.4	3.9	4.4	5.4
2000	pier	1.8	2.2	2.5	2.9	3.3	4.0
2500	pier	1.5	1.7	2.0	2.3	2.6	3.2
3000	pier	1.2	1.5	1.7	1.9	2.2	2.7
3500	pier	1.0	1.2	1.5	1.7	1.9	2.3
4000	pier	1.0	1.1	1.3	1.5	1.6	2.0

Ground Snow: 25 psf							
Net Soil Pres (psf)		Pier Spacing (ft)					
		4	5	6	7	8	10
1000	pier	3.7	4.5	5.2	6.0	6.7	8.2
1500	pier	2.5	3.0	3.5	4.0	4.5	5.5
2000	pier	1.9	2.2	2.6	3.0	3.4	4.1
2500	pier	1.5	1.8	2.1	2.4	2.7	3.3
3000	pier	1.2	1.5	1.7	2.0	2.2	2.7
3500	pier	1.1	1.3	1.5	1.7	1.9	2.3
4000	pier	1.0	1.1	1.3	1.5	1.7	2.1

* Minimum exterior and interior pier area is 1.0 sqft.

Aftg Cnw 16'	
	Multi-Section
	Width

Required Effective Footing Area - Aftg (sqft) *

Ground Snow: 30 psf & Min. Roof: 20 psf

Net Soil Pres (psf)		Pier Spacing (ft)					
		4	5	6	7	8	10
1000	pier	3.8	4.6	5.4	6.2	6.9	8.5
1500	pier	2.5	3.1	3.6	4.1	4.6	5.7
2000	pier	1.9	2.3	2.7	3.1	3.5	4.2
2500	pier	1.5	1.8	2.2	2.5	2.8	3.4
3000	pier	1.3	1.5	1.8	2.1	2.3	2.8
3500	pier	1.1	1.3	1.5	1.8	2.0	2.4
4000	pier	1.0	1.1	1.3	1.5	1.7	2.1

Ground Snow: 40 psf

Net Soil Pres (psf)		Pier Spacing (ft)					
		4	5	6	7	8	10
1000	pier	4.0	4.9	5.7	6.5	7.4	9.0
1500	pier	2.7	3.2	3.8	4.4	4.9	6.0
2000	pier	2.0	2.4	2.9	3.3	3.7	4.5
2500	pier	1.6	1.9	2.3	2.6	2.9	3.6
3000	pier	1.3	1.6	1.9	2.2	2.5	3.0
3500	pier	1.2	1.4	1.6	1.9	2.1	2.6
4000	pier	1.0	1.2	1.4	1.6	1.8	2.3

Ground Snow: 50 psf

Net Soil Pres (psf)		Pier Spacing (ft)					
		4	5	6	7	8	10
1000	pier	4.3	5.1	6.0	6.9	7.8	9.6
1500	pier	2.8	3.4	4.0	4.6	5.2	6.4
2000	pier	2.1	2.6	3.0	3.5	3.9	4.8
2500	pier	1.7	2.1	2.4	2.8	3.1	3.8
3000	pier	1.4	1.7	2.0	2.3	2.6	3.2
3500	pier	1.2	1.5	1.7	2.0	2.2	2.7
4000	pier	1.1	1.3	1.5	1.7	2.0	2.4

Ground Snow: 60 psf

Net Soil Pres (psf)		Pier Spacing (ft)					
		4	5	6	7	8	10
1000	pier	4.5	5.4	6.4	7.3	8.2	10.1
1500	pier	3.0	3.6	4.2	4.9	5.5	6.7
2000	pier	2.2	2.7	3.2	3.6	4.1	5.1
2500	pier	1.8	2.2	2.5	2.9	3.3	4.0
3000	pier	1.5	1.8	2.1	2.4	2.7	3.4
3500	pier	1.3	1.5	1.8	2.1	2.4	2.9
4000	pier	1.1	1.4	1.6	1.8	2.1	2.5

Ground Snow: 70 psf

Net Soil Pres (psf)		Pier Spacing (ft)					
		4	5	6	7	8	10
1000	pier	4.7	5.7	6.7	7.7	8.7	10.7
1500	pier	3.1	3.8	4.5	5.1	5.8	7.1
2000	pier	2.3	2.8	3.3	3.8	4.3	5.3
2500	pier	1.9	2.3	2.7	3.1	3.5	4.3
3000	pier	1.6	1.9	2.2	2.6	2.9	3.6
3500	pier	1.3	1.6	1.9	2.2	2.5	3.0
4000	pier	1.2	1.4	1.7	1.9	2.2	2.7

Ground Snow: 80 psf

Net Soil Pres (psf)		Pier Spacing (ft)					
		4	5	6	7	8	10
1000	pier	4.9	6.0	7.0	8.1	9.1	11.2
1500	pier	3.3	4.0	4.7	5.4	6.1	7.5
2000	pier	2.5	3.0	3.5	4.0	4.6	5.6
2500	pier	2.0	2.4	2.8	3.2	3.6	4.5
3000	pier	1.6	2.0	2.3	2.7	3.0	3.7
3500	pier	1.4	1.7	2.0	2.3	2.6	3.2
4000	pier	1.2	1.5	1.8	2.0	2.3	2.8

Ground Snow: 90 psf

Net Soil Pres (psf)		Pier Spacing (ft)					
		4	5	6	7	8	10
1000	pier	5.1	6.2	7.3	8.4	9.5	11.7
1500	pier	3.4	4.1	4.9	5.6	6.4	7.8
2000	pier	2.6	3.1	3.7	4.2	4.8	5.9
2500	pier	2.0	2.5	2.9	3.4	3.8	4.7
3000	pier	1.7	2.1	2.4	2.8	3.2	3.9
3500	pier	1.5	1.8	2.1	2.4	2.7	3.4
4000	pier	1.3	1.6	1.8	2.1	2.4	2.9

Ground Snow: 100 psf

Net Soil Pres (psf)		Pier Spacing (ft)					
		4	5	6	7	8	10
1000	pier	5.3	6.5	7.7	8.8	10.0	12.3
1500	pier	3.6	4.3	5.1	5.9	6.6	8.2
2000	pier	2.7	3.2	3.8	4.4	5.0	6.1
2500	pier	2.1	2.6	3.1	3.5	4.0	4.9
3000	pier	1.8	2.2	2.6	2.9	3.3	4.1
3500	pier	1.5	1.9	2.2	2.5	2.8	3.5
4000	pier	1.3	1.6	1.9	2.2	2.5	3.1

* Minimum exterior and interior pier area is 1.0 sqft.

Multi-Section E, I


Required Effective Footing Area - Aftg (sqft) *

Min. Roof: 15 psf							
Net Soil Pres (psf)		Pier Spacing (ft)					
		4	5	6	7	8	10
1000	ext, int	1.7	1.9	2.2	2.4	2.7	3.2
	marriage	3.0	3.6	4.2	4.8	5.4	6.6
1500	ext, int	1.1	1.3	1.5	1.6	1.8	2.1
	marriage	2.0	2.4	2.8	3.2	3.6	4.4
2000	ext, int	1.0	1.0	1.1	1.2	1.3	1.6
	marriage	1.5	1.8	2.1	2.4	2.7	3.3
2500	ext, int	1.0	1.0	1.0	1.0	1.1	1.3
	marriage	1.2	1.4	1.7	1.9	2.2	2.6
3000	ext, int	1.0	1.0	1.0	1.0	1.0	1.1
	marriage	1.0	1.2	1.4	1.6	1.8	2.2
3500	ext, int	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	1.0	1.0	1.2	1.4	1.5	1.9
4000	ext, int	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	1.0	1.0	1.0	1.2	1.3	1.6

Marriage Wall Opening Width (ft)							
Net Soil Pres (psf)		10	12	14	16	18	20
		1000	marriage	6.4	7.5	8.7	9.9
marriage	4.3		5.0	5.8	6.6	7.3	8.1
1500	marriage	3.2	3.8	4.3	4.9	5.5	6.1
	marriage	2.6	3.0	3.5	3.9	4.4	4.9
2000	marriage	2.1	2.5	2.9	3.3	3.7	4.1
	marriage	1.8	2.2	2.5	2.8	3.1	3.5
3500	marriage	1.6	1.9	2.2	2.5	2.8	3.0

Ground Snow: 25 psf							
Net Soil Pres (psf)		Pier Spacing (ft)					
		4	5	6	7	8	10
1000	ext, int	1.7	1.9	2.2	2.4	2.7	3.2
	marriage	3.1	3.7	4.4	5.0	5.6	6.9
1500	ext, int	1.1	1.3	1.5	1.6	1.8	2.1
	marriage	2.1	2.5	2.9	3.3	3.7	4.6
2000	ext, int	1.0	1.0	1.1	1.2	1.3	1.6
	marriage	1.6	1.9	2.2	2.5	2.8	3.4
2500	ext, int	1.0	1.0	1.0	1.0	1.1	1.3
	marriage	1.2	1.5	1.7	2.0	2.2	2.8
3000	ext, int	1.0	1.0	1.0	1.0	1.0	1.1
	marriage	1.0	1.2	1.5	1.7	1.9	2.3
3500	ext, int	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	1.0	1.1	1.2	1.4	1.6	2.0
4000	ext, int	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	1.0	1.0	1.1	1.2	1.4	1.7

Marriage Wall Opening Width (ft)							
Net Soil Pres (psf)		10	12	14	16	18	20
		1000	marriage	6.7	7.9	9.1	10.3
marriage	4.5		5.3	6.1	6.9	7.7	8.5
1500	marriage	3.3	3.9	4.6	5.2	5.8	6.4
	marriage	2.7	3.2	3.6	4.1	4.6	5.1
2000	marriage	2.2	2.6	3.0	3.4	3.8	4.2
	marriage	1.9	2.3	2.6	2.9	3.3	3.6
3500	marriage	1.7	2.0	2.3	2.6	2.9	3.2

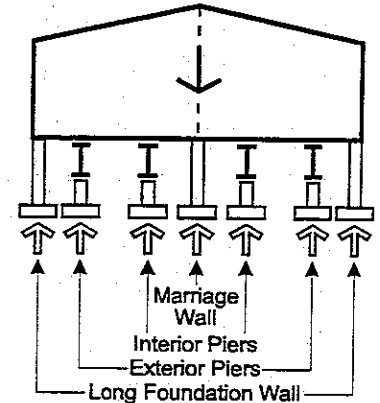

Ground Snow: 30 psf & Min. Roof: 20 psf							
Net Soil Pres (psf)		Pier Spacing (ft)					
		4	5	6	7	8	10
1000	ext, int	1.7	1.9	2.2	2.4	2.7	3.2
	marriage	3.3	3.9	4.6	5.3	5.9	7.3
1500	ext, int	1.1	1.3	1.5	1.6	1.8	2.1
	marriage	2.2	2.6	3.1	3.5	4.0	4.9
2000	ext, int	1.0	1.0	1.1	1.2	1.3	1.6
	marriage	1.6	2.0	2.3	2.6	3.0	3.6
2500	ext, int	1.0	1.0	1.0	1.0	1.1	1.3
	marriage	1.3	1.6	1.8	2.1	2.4	2.9
3000	ext, int	1.0	1.0	1.0	1.0	1.0	1.1
	marriage	1.1	1.3	1.5	1.8	2.0	2.4
3500	ext, int	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	1.0	1.1	1.3	1.5	1.7	2.1
4000	ext, int	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	1.0	1.0	1.2	1.3	1.5	1.8

Marriage Wall Opening Width (ft)							
Net Soil Pres (psf)		10	12	14	16	18	20
		1000	marriage	7.1	8.4	9.7	11.0
marriage	4.7		5.6	6.5	7.3	8.2	9.0
1500	marriage	3.5	4.2	4.8	5.5	6.1	6.8
	marriage	2.8	3.4	3.9	4.4	4.9	5.4
2000	marriage	2.4	2.8	3.2	3.7	4.1	4.5
	marriage	2.0	2.4	2.8	3.1	3.5	3.9
3500	marriage	1.8	2.1	2.4	2.7	3.1	3.4

* Minimum interior pier area is 1.0 sqft. Minimum exterior foundation wall footing width is 1'-0"; except for a 16' wide unit when the snow load is 100 psf and the allowable soil pressure is 1000 psf, use 1'-2".

Aftg E, I 12'	
	Multi-Section
	Width

Required Effective Footing Area - Aftg (sqft) *

Ground Snow: 40 psf							
Net Soil Pres (psf)		Pier Spacing (ft)					
		4	5	6	7	8	10
1000	ext, int	1.7	1.9	2.2	2.4	2.7	3.2
	marriage	3.6	4.3	5.1	5.8	6.6	8.1
1500	ext, int	1.1	1.3	1.5	1.6	1.8	2.1
	marriage	2.4	2.9	3.4	3.9	4.4	5.4
2000	ext, int	1.0	1.0	1.1	1.2	1.3	1.6
	marriage	1.8	2.2	2.5	2.9	3.3	4.1
2500	ext, int	1.0	1.0	1.0	1.0	1.1	1.3
	marriage	1.4	1.7	2.0	2.3	2.6	3.2
3000	ext, int	1.0	1.0	1.0	1.0	1.0	1.1
	marriage	1.2	1.4	1.7	1.9	2.2	2.7
3500	ext, int	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	1.0	1.2	1.5	1.7	1.9	2.3
4000	ext, int	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	1.0	1.1	1.3	1.5	1.6	2.0
Net Soil Pres (psf)		Marriage Wall Opening Width (ft)					
		10	12	14	16	18	20
1000	marriage	7.9	9.4	10.8	12.3	13.7	15.2
	marriage	5.3	6.2	7.2	8.2	9.2	10.1
1500	marriage	4.0	4.7	5.4	6.1	6.9	7.6
	marriage	3.2	3.7	4.3	4.9	5.5	6.1
2000	marriage	2.6	3.1	3.6	4.1	4.6	5.1
	marriage	2.3	2.7	3.1	3.5	3.9	4.3
3500	marriage	2.0	2.3	2.7	3.1	3.4	3.8


Ground Snow: 50 psf							
Net Soil Pres (psf)		Pier Spacing (ft)					
		4	5	6	7	8	10
1000	ext, int	1.7	1.9	2.2	2.4	2.7	3.2
	marriage	3.9	4.8	5.6	6.4	7.3	8.9
1500	ext, int	1.1	1.3	1.5	1.6	1.8	2.1
	marriage	2.6	3.2	3.7	4.3	4.8	5.9
2000	ext, int	1.0	1.0	1.1	1.2	1.3	1.6
	marriage	2.0	2.4	2.8	3.2	3.6	4.5
2500	ext, int	1.0	1.0	1.0	1.0	1.1	1.3
	marriage	1.6	1.9	2.2	2.6	2.9	3.6
3000	ext, int	1.0	1.0	1.0	1.0	1.0	1.1
	marriage	1.3	1.6	1.9	2.1	2.4	3.0
3500	ext, int	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	1.1	1.4	1.6	1.8	2.1	2.5
4000	ext, int	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	1.0	1.2	1.4	1.6	1.8	2.2
Net Soil Pres (psf)		Marriage Wall Opening Width (ft)					
		10	12	14	16	18	20
1000	marriage	8.7	10.3	12.0	13.6	15.2	16.8
	marriage	5.8	6.9	8.0	9.1	10.1	11.2
1500	marriage	4.4	5.2	6.0	6.8	7.6	8.4
	marriage	3.5	4.1	4.8	5.4	6.1	6.7
2000	marriage	2.9	3.4	4.0	4.5	5.1	5.6
	marriage	2.5	3.0	3.4	3.9	4.3	4.8
3500	marriage	2.2	2.6	3.0	3.4	3.8	4.2

Ground Snow: 60 psf							
Net Soil Pres (psf)		Pier Spacing (ft)					
		4	5	6	7	8	10
1000	ext, int	1.7	1.9	2.2	2.4	2.7	3.2
	marriage	4.2	5.2	6.1	7.0	7.9	9.7
1500	ext, int	1.1	1.3	1.5	1.6	1.8	2.1
	marriage	2.8	3.4	4.1	4.7	5.3	6.5
2000	ext, int	1.0	1.0	1.1	1.2	1.3	1.6
	marriage	2.1	2.6	3.0	3.5	4.0	4.9
2500	ext, int	1.0	1.0	1.0	1.0	1.1	1.3
	marriage	1.7	2.1	2.4	2.8	3.2	3.9
3000	ext, int	1.0	1.0	1.0	1.0	1.0	1.1
	marriage	1.4	1.7	2.0	2.3	2.6	3.2
3500	ext, int	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	1.2	1.5	1.7	2.0	2.3	2.8
4000	ext, int	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	1.1	1.3	1.5	1.7	2.0	2.4
Net Soil Pres (psf)		Marriage Wall Opening Width (ft)					
		10	12	14	16	18	20
1000	marriage	9.5	11.3	13.1	14.9	16.7	18.5
	marriage	6.4	7.5	8.7	9.9	11.1	12.3
1500	marriage	4.8	5.7	6.6	7.4	8.3	9.2
	marriage	3.8	4.5	5.2	6.0	6.7	7.4
2000	marriage	3.2	3.8	4.4	5.0	5.6	6.2
	marriage	2.7	3.2	3.7	4.3	4.8	5.3
3500	marriage	2.4	2.8	3.3	3.7	4.2	4.6

Ground Snow: 70 psf							
Net Soil Pres (psf)		Pier Spacing (ft)					
		4	5	6	7	8	10
1000	ext, int	1.7	1.9	2.2	2.4	2.7	3.2
	marriage	4.6	5.6	6.6	7.6	8.6	10.6
1500	ext, int	1.1	1.3	1.5	1.6	1.8	2.1
	marriage	3.0	3.7	4.4	5.0	5.7	7.0
2000	ext, int	1.0	1.0	1.1	1.2	1.3	1.6
	marriage	2.3	2.8	3.3	3.8	4.3	5.3
2500	ext, int	1.0	1.0	1.0	1.0	1.1	1.3
	marriage	1.8	2.2	2.6	3.0	3.4	4.2
3000	ext, int	1.0	1.0	1.0	1.0	1.0	1.1
	marriage	1.5	1.9	2.2	2.5	2.9	3.5
3500	ext, int	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	1.3	1.6	1.9	2.2	2.4	3.0
4000	ext, int	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	1.1	1.4	1.6	1.9	2.1	2.6
Net Soil Pres (psf)		Marriage Wall Opening Width (ft)					
		10	12	14	16	18	20
1000	marriage	10.4	12.3	14.3	16.2	18.1	20.1
	marriage	6.9	8.2	9.5	10.8	12.1	13.4
1500	marriage	5.2	6.2	7.1	8.1	9.1	10.0
	marriage	4.1	4.9	5.7	6.5	7.3	8.0
2000	marriage	3.5	4.1	4.8	5.4	6.0	6.7
	marriage	3.0	3.5	4.1	4.6	5.2	5.7
3500	marriage	2.6	3.1	3.6	4.0	4.5	5.0

* Minimum interior pier area is 1.0 sqft. Minimum exterior foundation wall footing width is 1'-0"; except for a 16' wide unit when the snow load is 100 psf and the allowable soil pressure is 1000 psf, use 1'-2".

Required Effective Footing Area - Aftg (sqft) *

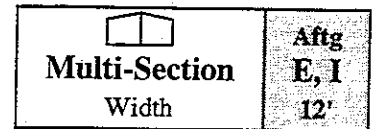

Ground Snow: 80 psf							
Net Soil Pres (psf)		Pier Spacing (ft)					
		4	5	6	7	8	10
1000	ext, int	1.7	1.9	2.2	2.4	2.7	3.2
	marriage	4.9	6.0	7.1	8.1	9.2	11.4
1500	ext, int	1.1	1.3	1.5	1.6	1.8	2.1
	marriage	3.3	4.0	4.7	5.4	6.1	7.6
2000	ext, int	1.0	1.0	1.1	1.2	1.3	1.6
	marriage	2.5	3.0	3.5	4.1	4.6	5.7
2500	ext, int	1.0	1.0	1.0	1.0	1.1	1.3
	marriage	2.0	2.4	2.8	3.3	3.7	4.5
3000	ext, int	1.0	1.0	1.0	1.0	1.0	1.1
	marriage	1.6	2.0	2.4	2.7	3.1	3.8
3500	ext, int	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	1.4	1.7	2.0	2.3	2.6	3.2
4000	ext, int	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	1.2	1.5	1.8	2.0	2.3	2.8
Net Soil Pres (psf)		Marriage Wall Opening Width (ft)					
		10	12	14	16	18	20
1000	marriage	11.2	13.3	15.4	17.5	19.6	21.7
	marriage	7.4	8.9	10.3	11.7	13.1	14.5
1500	marriage	5.6	6.6	7.7	8.8	9.8	10.9
	marriage	4.5	5.3	6.2	7.0	7.8	8.7
2000	marriage	3.7	4.4	5.1	5.8	6.5	7.2
	marriage	3.2	3.8	4.4	5.0	5.6	6.2
3000	marriage	2.8	3.3	3.8	4.4	4.9	5.4

Ground Snow: 90 psf							
Net Soil Pres (psf)		Pier Spacing (ft)					
		4	5	6	7	8	10
1000	ext, int	1.7	1.9	2.2	2.4	2.7	3.2
	marriage	5.2	6.4	7.5	8.7	9.9	12.2
1500	ext, int	1.1	1.3	1.5	1.6	1.8	2.1
	marriage	3.5	4.3	5.0	5.8	6.6	8.1
2000	ext, int	1.0	1.0	1.1	1.2	1.3	1.6
	marriage	2.6	3.2	3.8	4.4	4.9	6.1
2500	ext, int	1.0	1.0	1.0	1.0	1.1	1.3
	marriage	2.1	2.6	3.0	3.5	3.9	4.9
3000	ext, int	1.0	1.0	1.0	1.0	1.0	1.1
	marriage	1.7	2.1	2.5	2.9	3.3	4.1
3500	ext, int	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	1.5	1.8	2.2	2.5	2.8	3.5
4000	ext, int	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	1.3	1.6	1.9	2.2	2.5	3.0
Net Soil Pres (psf)		Marriage Wall Opening Width (ft)					
		10	12	14	16	18	20
1000	marriage	12.0	14.3	16.5	18.8	21.1	23.4
	marriage	8.0	9.5	11.0	12.5	14.1	15.6
1500	marriage	6.0	7.1	8.3	9.4	10.5	11.7
	marriage	4.8	5.7	6.6	7.5	8.4	9.3
2000	marriage	4.0	4.8	5.5	6.3	7.0	7.8
	marriage	3.4	4.1	4.7	5.4	6.0	6.7
3000	marriage	3.0	3.6	4.1	4.7	5.3	5.8

Ground Snow: 100 psf							
Net Soil Pres (psf)		Pier Spacing (ft)					
		4	5	6	7	8	10
1000	ext, int	1.7	1.9	2.2	2.4	2.7	3.2
	marriage	5.6	6.8	8.0	9.3	10.5	13.0
1500	ext, int	1.1	1.3	1.5	1.6	1.8	2.1
	marriage	3.7	4.5	5.4	6.2	7.0	8.7
2000	ext, int	1.0	1.0	1.1	1.2	1.3	1.6
	marriage	2.8	3.4	4.0	4.6	5.3	6.5
2500	ext, int	1.0	1.0	1.0	1.0	1.1	1.3
	marriage	2.2	2.7	3.2	3.7	4.2	5.2
3000	ext, int	1.0	1.0	1.0	1.0	1.0	1.1
	marriage	1.9	2.3	2.7	3.1	3.5	4.3
3500	ext, int	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	1.6	1.9	2.3	2.7	3.0	3.7
4000	ext, int	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	1.4	1.7	2.0	2.3	2.6	3.3
Net Soil Pres (psf)		Marriage Wall Opening Width (ft)					
		10	12	14	16	18	20
1000	marriage	12.8	15.2	17.7	20.1	22.6	25.0
	marriage	8.5	10.2	11.8	13.4	15.0	16.7
1500	marriage	6.4	7.6	8.8	10.1	11.3	12.5
	marriage	5.1	6.1	7.1	8.0	9.0	10.0
2000	marriage	4.3	5.1	5.9	6.7	7.5	8.3
	marriage	3.7	4.4	5.1	5.7	6.4	7.1
3000	marriage	3.2	3.8	4.4	5.0	5.6	6.2

* Minimum interior pier area is 1.0 sqft. Minimum exterior foundation wall footing width is 1'-0"; except for a 16' wide unit when the snow load is 100 psf and the allowable soil pressure is 1000 psf, use 1'-2".

Aftg E, I 14'	
	Multi-Section
	Width

Required Effective Footing Area - Aftg (sqft) *

Min. Roof: 15 psf							
Net Soil		Pier Spacing (ft)					
Pres (psf)		4	5	6	7	8	10
1000	ext, int	1.8	2.1	2.4	2.7	2.9	3.5
	marriage	3.4	4.1	4.8	5.5	6.3	7.7
1500	ext, int	1.2	1.4	1.6	1.8	2.0	2.3
	marriage	2.3	2.8	3.2	3.7	4.2	5.1
2000	ext, int	1.0	1.1	1.2	1.3	1.5	1.8
	marriage	1.7	2.1	2.4	2.8	3.1	3.8
2500	ext, int	1.0	1.0	1.0	1.1	1.2	1.4
	marriage	1.4	1.7	1.9	2.2	2.5	3.1
3000	ext, int	1.0	1.0	1.0	1.0	1.0	1.2
	marriage	1.1	1.4	1.6	1.8	2.1	2.6
3500	ext, int	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	1.0	1.2	1.4	1.6	1.8	2.2
4000	ext, int	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	1.0	1.0	1.2	1.4	1.6	1.9

Net Soil		Marriage Wall Opening Width (ft)					
Pres (psf)		10	12	14	16	18	20
1000	marriage	7.5	8.8	10.2	11.6	13.0	14.3
1500	marriage	5.0	5.9	6.8	7.7	8.6	9.5
2000	marriage	3.7	4.4	5.1	5.8	6.5	7.2
2500	marriage	3.0	3.5	4.1	4.6	5.2	5.7
3000	marriage	2.5	2.9	3.4	3.9	4.3	4.8
3500	marriage	2.1	2.5	2.9	3.3	3.7	4.1
4000	marriage	1.9	2.2	2.6	2.9	3.2	3.6

Ground Snow: 25 psf							
Net Soil		Pier Spacing (ft)					
Pres (psf)		4	5	6	7	8	10
1000	ext, int	1.8	2.1	2.4	2.7	2.9	3.5
	marriage	3.6	4.3	5.0	5.8	6.5	8.0
1500	ext, int	1.2	1.4	1.6	1.8	2.0	2.3
	marriage	2.4	2.9	3.4	3.9	4.3	5.3
2000	ext, int	1.0	1.1	1.2	1.3	1.5	1.8
	marriage	1.8	2.1	2.5	2.9	3.3	4.0
2500	ext, int	1.0	1.0	1.0	1.1	1.2	1.4
	marriage	1.4	1.7	2.0	2.3	2.6	3.2
3000	ext, int	1.0	1.0	1.0	1.0	1.0	1.2
	marriage	1.2	1.4	1.7	1.9	2.2	2.7
3500	ext, int	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	1.0	1.2	1.4	1.7	1.9	2.3
4000	ext, int	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	1.0	1.1	1.3	1.4	1.6	2.0

Net Soil		Marriage Wall Opening Width (ft)					
Pres (psf)		10	12	14	16	18	20
1000	marriage	7.8	9.3	10.7	12.1	13.6	15.0
1500	marriage	5.2	6.2	7.1	8.1	9.0	10.0
2000	marriage	3.9	4.6	5.3	6.1	6.8	7.5
2500	marriage	3.1	3.7	4.3	4.9	5.4	6.0
3000	marriage	2.6	3.1	3.6	4.0	4.5	5.0
3500	marriage	2.2	2.6	3.1	3.5	3.9	4.3
4000	marriage	2.0	2.3	2.7	3.0	3.4	3.8

Ground Snow: 30 psf & Min. Roof: 20 psf							
Net Soil		Pier Spacing (ft)					
Pres (psf)		4	5	6	7	8	10
1000	ext, int	1.8	2.1	2.4	2.7	2.9	3.5
	marriage	3.7	4.5	5.3	6.1	6.9	8.5
1500	ext, int	1.2	1.4	1.6	1.8	2.0	2.3
	marriage	2.5	3.0	3.6	4.1	4.6	5.7
2000	ext, int	1.0	1.1	1.2	1.3	1.5	1.8
	marriage	1.9	2.3	2.7	3.1	3.5	4.2
2500	ext, int	1.0	1.0	1.0	1.1	1.2	1.4
	marriage	1.5	1.8	2.1	2.4	2.8	3.4
3000	ext, int	1.0	1.0	1.0	1.0	1.0	1.2
	marriage	1.2	1.5	1.8	2.0	2.3	2.8
3500	ext, int	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	1.1	1.3	1.5	1.7	2.0	2.4
4000	ext, int	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	1.0	1.1	1.3	1.5	1.7	2.1

Net Soil		Marriage Wall Opening Width (ft)					
Pres (psf)		10	12	14	16	18	20
1000	marriage	8.3	9.8	11.4	12.9	14.4	16.0
1500	marriage	5.5	6.6	7.6	8.6	9.6	10.6
2000	marriage	4.1	4.9	5.7	6.4	7.2	8.0
2500	marriage	3.3	3.9	4.5	5.2	5.8	6.4
3000	marriage	2.8	3.3	3.8	4.3	4.8	5.3
3500	marriage	2.4	2.8	3.2	3.7	4.1	4.6
4000	marriage	2.1	2.5	2.8	3.2	3.6	4.0

Ground Snow: 40 psf							
Net Soil		Pier Spacing (ft)					
Pres (psf)		4	5	6	7	8	10
1000	ext, int	1.8	2.1	2.4	2.7	2.9	3.5
	marriage	4.1	5.0	5.9	6.8	7.7	9.4
1500	ext, int	1.2	1.4	1.6	1.8	2.0	2.3
	marriage	2.8	3.3	3.9	4.5	5.1	6.3
2000	ext, int	1.0	1.1	1.2	1.3	1.5	1.8
	marriage	2.1	2.5	3.0	3.4	3.8	4.7
2500	ext, int	1.0	1.0	1.0	1.1	1.2	1.4
	marriage	1.7	2.0	2.4	2.7	3.1	3.8
3000	ext, int	1.0	1.0	1.0	1.0	1.0	1.2
	marriage	1.4	1.7	2.0	2.3	2.6	3.1
3500	ext, int	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	1.2	1.4	1.7	1.9	2.2	2.7
4000	ext, int	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	1.0	1.3	1.5	1.7	1.9	2.4

Net Soil		Marriage Wall Opening Width (ft)					
Pres (psf)		10	12	14	16	18	20
1000	marriage	9.2	11.0	12.7	14.4	16.2	17.9
1500	marriage	6.2	7.3	8.5	9.6	10.8	11.9
2000	marriage	4.6	5.5	6.3	7.2	8.1	8.9
2500	marriage	3.7	4.4	5.1	5.8	6.5	7.2
3000	marriage	3.1	3.7	4.2	4.8	5.4	6.0
3500	marriage	2.6	3.1	3.6	4.1	4.6	5.1
4000	marriage	2.3	2.7	3.2	3.6	4.0	4.5

* Minimum interior pier area is 1.0 sqft. Minimum exterior foundation wall footing width is 1'-0"; except for a 16' wide unit when the snow load is 100 psf and the allowable soil pressure is 1000 psf, use 1'-2".

Required Effective Footing Area - Aftg (sqft) *



Ground Snow: 50 psf							
Net Soil Pres (psf)		Pier Spacing (ft)					
		4	5	6	7	8	10
1000	ext, int	1.8	2.1	2.4	2.7	2.9	3.5
	marriage	4.5	5.5	6.5	7.5	8.4	10.4
1500	ext, int	1.2	1.4	1.6	1.8	2.0	2.3
	marriage	3.0	3.7	4.3	5.0	5.6	6.9
2000	ext, int	1.0	1.1	1.2	1.3	1.5	1.8
	marriage	2.3	2.7	3.2	3.7	4.2	5.2
2500	ext, int	1.0	1.0	1.0	1.1	1.2	1.4
	marriage	1.8	2.2	2.6	3.0	3.4	4.2
3000	ext, int	1.0	1.0	1.0	1.0	1.0	1.2
	marriage	1.5	1.8	2.2	2.5	2.8	3.5
3500	ext, int	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	1.3	1.6	1.8	2.1	2.4	3.0
4000	ext, int	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	1.1	1.4	1.6	1.9	2.1	2.6

Net Soil Pres (psf)		Marriage Wall Opening Width (ft)					
		10	12	14	16	18	20
1000	marriage	10.2	12.1	14.0	16.0	17.9	19.8
1500	marriage	6.8	8.1	9.4	10.6	11.9	13.2
2000	marriage	5.1	6.1	7.0	8.0	8.9	9.9
2500	marriage	4.1	4.8	5.6	6.4	7.1	7.9
3000	marriage	3.4	4.0	4.7	5.3	6.0	6.6
3500	marriage	2.9	3.5	4.0	4.6	5.1	5.7
4000	marriage	2.6	3.0	3.5	4.0	4.5	4.9

Ground Snow: 60 psf							
Net Soil Pres (psf)		Pier Spacing (ft)					
		4	5	6	7	8	10
1000	ext, int	1.8	2.1	2.4	2.7	2.9	3.5
	marriage	4.9	6.0	7.0	8.1	9.2	11.4
1500	ext, int	1.2	1.4	1.6	1.8	2.0	2.3
	marriage	3.3	4.0	4.7	5.4	6.1	7.6
2000	ext, int	1.0	1.1	1.2	1.3	1.5	1.8
	marriage	2.4	3.0	3.5	4.1	4.6	5.7
2500	ext, int	1.0	1.0	1.0	1.1	1.2	1.4
	marriage	2.0	2.4	2.8	3.3	3.7	4.5
3000	ext, int	1.0	1.0	1.0	1.0	1.0	1.2
	marriage	1.6	2.0	2.3	2.7	3.1	3.8
3500	ext, int	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	1.4	1.7	2.0	2.3	2.6	3.2
4000	ext, int	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	1.2	1.5	1.8	2.0	2.3	2.8

Net Soil Pres (psf)		Marriage Wall Opening Width (ft)					
		10	12	14	16	18	20
1000	marriage	11.2	13.3	15.4	17.5	19.6	21.7
1500	marriage	7.4	8.8	10.3	11.7	13.1	14.5
2000	marriage	5.6	6.6	7.7	8.7	9.8	10.9
2500	marriage	4.5	5.3	6.2	7.0	7.8	8.7
3000	marriage	3.7	4.4	5.1	5.8	6.5	7.2
3500	marriage	3.2	3.8	4.4	5.0	5.6	6.2
4000	marriage	2.8	3.3	3.8	4.4	4.9	5.4

Ground Snow: 70 psf							
Net Soil Pres (psf)		Pier Spacing (ft)					
		4	5	6	7	8	10
1000	ext, int	1.8	2.1	2.4	2.7	2.9	3.5
	marriage	5.3	6.5	7.6	8.8	10.0	12.3
1500	ext, int	1.2	1.4	1.6	1.8	2.0	2.3
	marriage	3.5	4.3	5.1	5.9	6.6	8.2
2000	ext, int	1.0	1.1	1.2	1.3	1.5	1.8
	marriage	2.6	3.2	3.8	4.4	5.0	6.2
2500	ext, int	1.0	1.0	1.0	1.1	1.2	1.4
	marriage	2.1	2.6	3.0	3.5	4.0	4.9
3000	ext, int	1.0	1.0	1.0	1.0	1.0	1.2
	marriage	1.8	2.2	2.5	2.9	3.3	4.1
3500	ext, int	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	1.5	1.8	2.2	2.5	2.8	3.5
4000	ext, int	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	1.3	1.6	1.9	2.2	2.5	3.1

Net Soil Pres (psf)		Marriage Wall Opening Width (ft)					
		10	12	14	16	18	20
1000	marriage	12.1	14.4	16.7	19.0	21.3	23.6
1500	marriage	8.1	9.6	11.1	12.7	14.2	15.7
2000	marriage	6.1	7.2	8.4	9.5	10.7	11.8
2500	marriage	4.8	5.8	6.7	7.6	8.5	9.4
3000	marriage	4.0	4.8	5.6	6.3	7.1	7.9
3500	marriage	3.5	4.1	4.8	5.4	6.1	6.7
4000	marriage	3.0	3.6	4.2	4.8	5.3	5.9

Ground Snow: 80 psf							
Net Soil Pres (psf)		Pier Spacing (ft)					
		4	5	6	7	8	10
1000	ext, int	1.8	2.1	2.4	2.7	2.9	3.5
	marriage	5.7	6.9	8.2	9.5	10.7	13.3
1500	ext, int	1.2	1.4	1.6	1.8	2.0	2.3
	marriage	3.8	4.6	5.5	6.3	7.2	8.8
2000	ext, int	1.0	1.1	1.2	1.3	1.5	1.8
	marriage	2.8	3.5	4.1	4.7	5.4	6.6
2500	ext, int	1.0	1.0	1.0	1.1	1.2	1.4
	marriage	2.3	2.8	3.3	3.8	4.3	5.3
3000	ext, int	1.0	1.0	1.0	1.0	1.0	1.2
	marriage	1.9	2.3	2.7	3.2	3.6	4.4
3500	ext, int	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	1.6	2.0	2.3	2.7	3.1	3.8
4000	ext, int	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	1.4	1.7	2.0	2.4	2.7	3.3

Net Soil Pres (psf)		Marriage Wall Opening Width (ft)					
		10	12	14	16	18	20
1000	marriage	13.1	15.6	18.1	20.5	23.0	25.5
1500	marriage	8.7	10.4	12.0	13.7	15.4	17.0
2000	marriage	6.5	7.8	9.0	10.3	11.5	12.8
2500	marriage	5.2	6.2	7.2	8.2	9.2	10.2
3000	marriage	4.4	5.2	6.0	6.8	7.7	8.5
3500	marriage	3.7	4.4	5.2	5.9	6.6	7.3
4000	marriage	3.3	3.9	4.5	5.1	5.8	6.4

* Minimum interior pier area is 1.0 sqft. Minimum exterior foundation wall footing width is 1'-0"; except for a 16' wide unit when the snow load is 100 psf and the allowable soil pressure is 1000 psf, use 1'-2".



Required Effective Footing Area - Aftg (sqft) *

Ground Snow: 90 psf							
Net Soil Pres (psf)		Pier Spacing (ft)					
		4	5	6	7	8	10
1000	ext, int	1.8	2.1	2.4	2.7	2.9	3.5
	marriage	6.0	7.4	8.8	10.1	11.5	14.2
1500	ext, int	1.2	1.4	1.6	1.8	2.0	2.3
	marriage	4.0	4.9	5.8	6.8	7.7	9.5
2000	ext, int	1.0	1.1	1.2	1.3	1.5	1.8
	marriage	3.0	3.7	4.4	5.1	5.7	7.1
2500	ext, int	1.0	1.0	1.0	1.1	1.2	1.4
	marriage	2.4	3.0	3.5	4.1	4.6	5.7
3000	ext, int	1.0	1.0	1.0	1.0	1.0	1.2
	marriage	2.0	2.5	2.9	3.4	3.8	4.7
3500	ext, int	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	1.7	2.1	2.5	2.9	3.3	4.1
4000	ext, int	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	1.5	1.9	2.2	2.5	2.9	3.6
Net Soil Pres (psf)		Marriage Wall Opening Width (ft)					
		10	12	14	16	18	20
1000	marriage	14.0	16.7	19.4	22.1	24.8	27.4
	marriage	9.4	11.1	12.9	14.7	16.5	18.3
1500	marriage	7.0	8.4	9.7	11.0	12.4	13.7
	marriage	5.6	6.7	7.8	8.8	9.9	11.0
2000	marriage	4.7	5.6	6.5	7.4	8.3	9.1
	marriage	4.0	4.8	5.5	6.3	7.1	7.8
3500	marriage	3.5	4.2	4.8	5.5	6.2	6.9

Ground Snow: 100 psf							
Net Soil Pres (psf)		Pier Spacing (ft)					
		4	5	6	7	8	10
1000	ext, int	1.8	2.1	2.4	2.7	2.9	3.5
	marriage	6.4	7.9	9.3	10.8	12.3	15.2
1500	ext, int	1.2	1.4	1.6	1.8	2.0	2.3
	marriage	4.3	5.3	6.2	7.2	8.2	10.1
2000	ext, int	1.0	1.1	1.2	1.3	1.5	1.8
	marriage	3.2	3.9	4.7	5.4	6.1	7.6
2500	ext, int	1.0	1.0	1.0	1.1	1.2	1.4
	marriage	2.6	3.2	3.7	4.3	4.9	6.1
3000	ext, int	1.0	1.0	1.0	1.0	1.0	1.2
	marriage	2.1	2.6	3.1	3.6	4.1	5.1
3500	ext, int	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	1.8	2.3	2.7	3.1	3.5	4.3
4000	ext, int	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	1.6	2.0	2.3	2.7	3.1	3.8
Net Soil Pres (psf)		Marriage Wall Opening Width (ft)					
		10	12	14	16	18	20
1000	marriage	15.0	17.9	20.7	23.6	26.5	29.4
	marriage	10.0	11.9	13.8	15.7	17.7	19.6
1500	marriage	7.5	8.9	10.4	11.8	13.2	14.7
	marriage	6.0	7.1	8.3	9.4	10.6	11.7
2000	marriage	5.0	6.0	6.9	7.9	8.8	9.8
	marriage	4.3	5.1	5.9	6.7	7.6	8.4
3500	marriage	3.7	4.5	5.2	5.9	6.6	7.3

* Minimum interior pier area is 1.0 sqft. Minimum exterior foundation wall footing width is 1'-0"; except for a 16' wide unit when the snow load is 100 psf and the allowable soil pressure is 1000 psf, use 1'-2".

Required Effective Footing Area - Aftg (sqft) *



Min. Roof: 15 psf							
Net Soil Pres (psf)		Pier Spacing (ft)					
		4	5	6	7	8	10
1000	ext, int	2.0	2.3	2.6	2.9	3.3	3.9
	marriage	3.7	4.5	5.3	6.1	6.9	8.5
1500	ext, int	1.3	1.5	1.7	2.0	2.2	2.6
	marriage	2.5	3.0	3.6	4.1	4.6	5.7
2000	ext, int	1.0	1.1	1.3	1.5	1.6	1.9
	marriage	1.9	2.3	2.7	3.1	3.5	4.2
2500	ext, int	1.0	1.0	1.0	1.2	1.3	1.6
	marriage	1.5	1.8	2.1	2.4	2.8	3.4
3000	ext, int	1.0	1.0	1.0	1.0	1.1	1.3
	marriage	1.2	1.5	1.8	2.0	2.3	2.8
3500	ext, int	1.0	1.0	1.0	1.0	1.0	1.1
	marriage	1.1	1.3	1.5	1.7	2.0	2.4
4000	ext, int	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	1.0	1.1	1.3	1.5	1.7	2.1

Marriage Wall Opening Width (ft)							
Net Soil Pres (psf)		10	12	14	16	18	20
1000	marriage	8.3	9.8	11.4	12.9	14.4	16.0
1500	marriage	5.5	6.6	7.6	8.6	9.6	10.6
2000	marriage	4.1	4.9	5.7	6.5	7.2	8.0
2500	marriage	3.3	3.9	4.5	5.2	5.8	6.4
3000	marriage	2.8	3.3	3.8	4.3	4.8	5.3
3500	marriage	2.4	2.8	3.2	3.7	4.1	4.6
4000	marriage	2.1	2.5	2.8	3.2	3.6	4.0

Ground Snow: 25 psf							
Net Soil Pres (psf)		Pier Spacing (ft)					
		4	5	6	7	8	10
1000	ext, int	2.0	2.3	2.6	2.9	3.3	3.9
	marriage	3.9	4.7	5.6	6.4	7.2	8.9
1500	ext, int	1.3	1.5	1.7	2.0	2.2	2.6
	marriage	2.6	3.2	3.7	4.3	4.8	5.9
2000	ext, int	1.0	1.1	1.3	1.5	1.6	1.9
	marriage	2.0	2.4	2.8	3.2	3.6	4.4
2500	ext, int	1.0	1.0	1.0	1.2	1.3	1.6
	marriage	1.6	1.9	2.2	2.6	2.9	3.6
3000	ext, int	1.0	1.0	1.0	1.0	1.1	1.3
	marriage	1.3	1.6	1.9	2.1	2.4	3.0
3500	ext, int	1.0	1.0	1.0	1.0	1.0	1.1
	marriage	1.1	1.4	1.6	1.8	2.1	2.5
4000	ext, int	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	1.0	1.2	1.4	1.6	1.8	2.2

Marriage Wall Opening Width (ft)							
Net Soil Pres (psf)		10	12	14	16	18	20
1000	marriage	8.7	10.3	11.9	13.5	15.1	16.7
1500	marriage	5.8	6.9	7.9	9.0	10.1	11.2
2000	marriage	4.3	5.1	6.0	6.8	7.6	8.4
2500	marriage	3.5	4.1	4.8	5.4	6.1	6.7
3000	marriage	2.9	3.4	4.0	4.5	5.0	5.6
3500	marriage	2.5	2.9	3.4	3.9	4.3	4.8
4000	marriage	2.2	2.6	3.0	3.4	3.8	4.2

Ground Snow: 30 psf & Min. Roof: 20 psf							
Net Soil Pres (psf)		Pier Spacing (ft)					
		4	5	6	7	8	10
1000	ext, int	2.0	2.3	2.6	2.9	3.3	3.9
	marriage	4.1	5.0	5.9	6.8	7.7	9.4
1500	ext, int	1.3	1.5	1.7	2.0	2.2	2.6
	marriage	2.7	3.3	3.9	4.5	5.1	6.3
2000	ext, int	1.0	1.1	1.3	1.5	1.6	1.9
	marriage	2.1	2.5	2.9	3.4	3.8	4.7
2500	ext, int	1.0	1.0	1.0	1.2	1.3	1.6
	marriage	1.6	2.0	2.4	2.7	3.1	3.8
3000	ext, int	1.0	1.0	1.0	1.0	1.1	1.3
	marriage	1.4	1.7	2.0	2.3	2.6	3.1
3500	ext, int	1.0	1.0	1.0	1.0	1.0	1.1
	marriage	1.2	1.4	1.7	1.9	2.2	2.7
4000	ext, int	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	1.0	1.3	1.5	1.7	1.9	2.4

Marriage Wall Opening Width (ft)							
Net Soil Pres (psf)		10	12	14	16	18	20
1000	marriage	9.2	10.9	12.7	14.4	16.1	17.8
1500	marriage	6.2	7.3	8.4	9.6	10.7	11.9
2000	marriage	4.6	5.5	6.3	7.2	8.1	8.9
2500	marriage	3.7	4.4	5.1	5.8	6.4	7.1
3000	marriage	3.1	3.6	4.2	4.8	5.4	5.9
3500	marriage	2.6	3.1	3.6	4.1	4.6	5.1
4000	marriage	2.3	2.7	3.2	3.6	4.0	4.5

Ground Snow: 40 psf							
Net Soil Pres (psf)		Pier Spacing (ft)					
		4	5	6	7	8	10
1000	ext, int	2.0	2.3	2.6	2.9	3.3	3.9
	marriage	4.6	5.5	6.5	7.5	8.5	10.5
1500	ext, int	1.3	1.5	1.7	2.0	2.2	2.6
	marriage	3.0	3.7	4.4	5.0	5.7	7.0
2000	ext, int	1.0	1.1	1.3	1.5	1.6	1.9
	marriage	2.3	2.8	3.3	3.8	4.3	5.3
2500	ext, int	1.0	1.0	1.0	1.2	1.3	1.6
	marriage	1.8	2.2	2.6	3.0	3.4	4.2
3000	ext, int	1.0	1.0	1.0	1.0	1.1	1.3
	marriage	1.5	1.8	2.2	2.5	2.8	3.5
3500	ext, int	1.0	1.0	1.0	1.0	1.0	1.1
	marriage	1.3	1.6	1.9	2.2	2.4	3.0
4000	ext, int	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	1.1	1.4	1.6	1.9	2.1	2.6

Marriage Wall Opening Width (ft)							
Net Soil Pres (psf)		10	12	14	16	18	20
1000	marriage	10.3	12.2	14.2	16.1	18.1	20.0
1500	marriage	6.9	8.2	9.5	10.7	12.0	13.3
2000	marriage	5.2	6.1	7.1	8.1	9.0	10.0
2500	marriage	4.1	4.9	5.7	6.4	7.2	8.0
3000	marriage	3.4	4.1	4.7	5.4	6.0	6.7
3500	marriage	2.9	3.5	4.1	4.6	5.2	5.7
4000	marriage	2.6	3.1	3.5	4.0	4.5	5.0

* Minimum interior pier area is 1.0 sqft. Minimum exterior foundation wall footing width is 1'-0"; except for a 16' wide unit when the snow load is 100 psf and the allowable soil pressure is 1000 psf, use 1'-2".

Aftg E, I 16'	
	Multi-Section
	Width

Required Effective Footing Area - Aftg (sqft) *

Ground Snow: 50 psf							
Net Soil Pres (psf)		Pier Spacing (ft)					
		4	5	6	7	8	10
1000	ext, int	2.0	2.3	2.6	2.9	3.3	3.9
	marriage	5.0	6.1	7.2	8.3	9.4	11.6
1500	ext, int	1.3	1.5	1.7	2.0	2.2	2.6
	marriage	3.3	4.1	4.8	5.5	6.3	7.7
2000	ext, int	1.0	1.1	1.3	1.5	1.6	1.9
	marriage	2.5	3.0	3.6	4.1	4.7	5.8
2500	ext, int	1.0	1.0	1.0	1.2	1.3	1.6
	marriage	2.0	2.4	2.9	3.3	3.8	4.6
3000	ext, int	1.0	1.0	1.0	1.0	1.1	1.3
	marriage	1.7	2.0	2.4	2.8	3.1	3.9
3500	ext, int	1.0	1.0	1.0	1.0	1.0	1.1
	marriage	1.4	1.7	2.1	2.4	2.7	3.3
4000	ext, int	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	1.2	1.5	1.8	2.1	2.3	2.9
Net Soil Pres (psf)		Marriage Wall Opening Width (ft)					
		10	12	14	16	18	20
1000	marriage	11.4	13.6	15.7	17.9	20.0	22.2
	marriage	7.6	9.0	10.5	11.9	13.3	14.8
1500	marriage	5.7	6.8	7.9	8.9	10.0	11.1
	marriage	4.6	5.4	6.3	7.1	8.0	8.9
2000	marriage	3.8	4.5	5.2	6.0	6.7	7.4
	marriage	3.3	3.9	4.5	5.1	5.7	6.3
3500	marriage	2.8	3.4	3.9	4.5	5.0	5.5

Ground Snow: 70 psf							
Net Soil Pres (psf)		Pier Spacing (ft)					
		4	5	6	7	8	10
1000	ext, int	2.0	2.3	2.6	2.9	3.3	3.9
	marriage	5.9	7.2	8.5	9.8	11.1	13.8
1500	ext, int	1.3	1.5	1.7	2.0	2.2	2.6
	marriage	3.9	4.8	5.7	6.5	7.4	9.2
2000	ext, int	1.0	1.1	1.3	1.5	1.6	1.9
	marriage	2.9	3.6	4.2	4.9	5.6	6.9
2500	ext, int	1.0	1.0	1.0	1.2	1.3	1.6
	marriage	2.3	2.9	3.4	3.9	4.5	5.5
3000	ext, int	1.0	1.0	1.0	1.0	1.1	1.3
	marriage	2.0	2.4	2.8	3.3	3.7	4.6
3500	ext, int	1.0	1.0	1.0	1.0	1.0	1.1
	marriage	1.7	2.0	2.4	2.8	3.2	3.9
4000	ext, int	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	1.5	1.8	2.1	2.5	2.8	3.4
Net Soil Pres (psf)		Marriage Wall Opening Width (ft)					
		10	12	14	16	18	20
1000	marriage	13.6	16.2	18.7	21.3	23.9	26.5
	marriage	9.0	10.8	12.5	14.2	15.9	17.7
1500	marriage	6.8	8.1	9.4	10.7	12.0	13.3
	marriage	5.4	6.5	7.5	8.5	9.6	10.6
2000	marriage	4.5	5.4	6.2	7.1	8.0	8.8
	marriage	3.9	4.6	5.4	6.1	6.8	7.6
3500	marriage	3.4	4.0	4.7	5.3	6.0	6.6

Ground Snow: 60 psf							
Net Soil Pres (psf)		Pier Spacing (ft)					
		4	5	6	7	8	10
1000	ext, int	2.0	2.3	2.6	2.9	3.3	3.9
	marriage	5.4	6.6	7.8	9.0	10.3	12.7
1500	ext, int	1.3	1.5	1.7	2.0	2.2	2.6
	marriage	3.6	4.4	5.2	6.0	6.8	8.5
2000	ext, int	1.0	1.1	1.3	1.5	1.6	1.9
	marriage	2.7	3.3	3.9	4.5	5.1	6.3
2500	ext, int	1.0	1.0	1.0	1.2	1.3	1.6
	marriage	2.2	2.7	3.1	3.6	4.1	5.1
3000	ext, int	1.0	1.0	1.0	1.0	1.1	1.3
	marriage	1.8	2.2	2.6	3.0	3.4	4.2
3500	ext, int	1.0	1.0	1.0	1.0	1.0	1.1
	marriage	1.5	1.9	2.2	2.6	2.9	3.6
4000	ext, int	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	1.4	1.7	2.0	2.3	2.6	3.2
Net Soil Pres (psf)		Marriage Wall Opening Width (ft)					
		10	12	14	16	18	20
1000	marriage	12.5	14.9	17.2	19.6	22.0	24.3
	marriage	8.3	9.9	11.5	13.1	14.6	16.2
1500	marriage	6.2	7.4	8.6	9.8	11.0	12.2
	marriage	5.0	5.9	6.9	7.8	8.8	9.7
2000	marriage	4.2	5.0	5.7	6.5	7.3	8.1
	marriage	3.6	4.2	4.9	5.6	6.3	7.0
3500	marriage	3.1	3.7	4.3	4.9	5.5	6.1

Ground Snow: 80 psf							
Net Soil Pres (psf)		Pier Spacing (ft)					
		4	5	6	7	8	10
1000	ext, int	2.0	2.3	2.6	2.9	3.3	3.9
	marriage	6.3	7.7	9.1	10.6	12.0	14.8
1500	ext, int	1.3	1.5	1.7	2.0	2.2	2.6
	marriage	4.2	5.1	6.1	7.0	8.0	9.9
2000	ext, int	1.0	1.1	1.3	1.5	1.6	1.9
	marriage	3.1	3.9	4.6	5.3	6.0	7.4
2500	ext, int	1.0	1.0	1.0	1.2	1.3	1.6
	marriage	2.5	3.1	3.7	4.2	4.8	5.9
3000	ext, int	1.0	1.0	1.0	1.0	1.1	1.3
	marriage	2.1	2.6	3.0	3.5	4.0	4.9
3500	ext, int	1.0	1.0	1.0	1.0	1.0	1.1
	marriage	1.8	2.2	2.6	3.0	3.4	4.2
4000	ext, int	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	1.6	1.9	2.3	2.6	3.0	3.7
Net Soil Pres (psf)		Marriage Wall Opening Width (ft)					
		10	12	14	16	18	20
1000	marriage	14.7	17.5	20.3	23.1	25.9	28.7
	marriage	9.8	11.6	13.5	15.4	17.2	19.1
1500	marriage	7.3	8.7	10.1	11.5	12.9	14.3
	marriage	5.9	7.0	8.1	9.2	10.3	11.5
2000	marriage	4.9	5.8	6.8	7.7	8.6	9.6
	marriage	4.2	5.0	5.8	6.6	7.4	8.2
3500	marriage	3.7	4.4	5.1	5.8	6.5	7.2

* Minimum interior pier area is 1.0 sqft. Minimum exterior foundation wall footing width is 1'-0"; except for a 16' wide unit when the snow load is 100 psf and the allowable soil pressure is 1000 psf, use 1'-2".

Required Effective Footing Area - Aftg (sqft) *




Ground Snow: 90 psf							
Net Soil Pres (psf)		Pier Spacing (ft)					
		4	5	6	7	8	10
1000	ext, int	2.0	2.3	2.6	2.9	3.3	3.9
	marriage	6.7	8.3	9.8	11.3	12.9	15.9
1500	ext, int	1.3	1.5	1.7	2.0	2.2	2.6
	marriage	4.5	5.5	6.5	7.6	8.6	10.6
2000	ext, int	1.0	1.1	1.3	1.5	1.6	1.9
	marriage	3.4	4.1	4.9	5.7	6.4	8.0
2500	ext, int	1.0	1.0	1.0	1.2	1.3	1.6
	marriage	2.7	3.3	3.9	4.5	5.1	6.4
3000	ext, int	1.0	1.0	1.0	1.0	1.1	1.3
	marriage	2.2	2.8	3.3	3.8	4.3	5.3
3500	ext, int	1.0	1.0	1.0	1.0	1.0	1.1
	marriage	1.9	2.4	2.8	3.2	3.7	4.6
4000	ext, int	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	1.7	2.1	2.4	2.8	3.2	4.0
Net Soil Pres (psf)		Marriage Wall Opening Width (ft)					
		10	12	14	16	18	20
1000	marriage	15.7	18.8	21.8	24.8	27.8	30.9
1500	marriage	10.5	12.5	14.5	16.5	18.6	20.6
2000	marriage	7.9	9.4	10.9	12.4	13.9	15.4
2500	marriage	6.3	7.5	8.7	9.9	11.1	12.3
3000	marriage	5.2	6.3	7.3	8.3	9.3	10.3
3500	marriage	4.5	5.4	6.2	7.1	8.0	8.8
4000	marriage	3.9	4.7	5.4	6.2	7.0	7.7

Ground Snow: 100 psf							
Net Soil Pres (psf)		Pier Spacing (ft)					
		4	5	6	7	8	10
1000	ext, int	2.0	2.3	2.6	2.9	3.3	3.9
	marriage	7.2	8.8	10.4	12.1	13.7	17.0
1500	ext, int	1.3	1.5	1.7	2.0	2.2	2.6
	marriage	4.8	5.9	7.0	8.1	9.2	11.3
2000	ext, int	1.0	1.1	1.3	1.5	1.6	1.9
	marriage	3.6	4.4	5.2	6.0	6.9	8.5
2500	ext, int	1.0	1.0	1.0	1.2	1.3	1.6
	marriage	2.9	3.5	4.2	4.8	5.5	6.8
3000	ext, int	1.0	1.0	1.0	1.0	1.1	1.3
	marriage	2.4	2.9	3.5	4.0	4.6	5.7
3500	ext, int	1.0	1.0	1.0	1.0	1.0	1.1
	marriage	2.0	2.5	3.0	3.5	3.9	4.9
4000	ext, int	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	1.8	2.2	2.6	3.0	3.4	4.3
Net Soil Pres (psf)		Marriage Wall Opening Width (ft)					
		10	12	14	16	18	20
1000	marriage	16.8	20.1	23.3	26.5	29.8	33.0
1500	marriage	11.2	13.4	15.5	17.7	19.9	22.0
2000	marriage	8.4	10.0	11.7	13.3	14.9	16.5
2500	marriage	6.7	8.0	9.3	10.6	11.9	13.2
3000	marriage	5.6	6.7	7.8	8.8	9.9	11.0
3500	marriage	4.8	5.7	6.7	7.6	8.5	9.4
4000	marriage	4.2	5.0	5.8	6.6	7.4	8.3

* Minimum interior pier area is 1.0 sqft. Minimum exterior foundation wall footing width is 1'-0"; except for a 16' wide unit when the snow load is 100 psf and the allowable soil pressure is 1000 psf, use 1'-2".

Multi-Section E5, E6

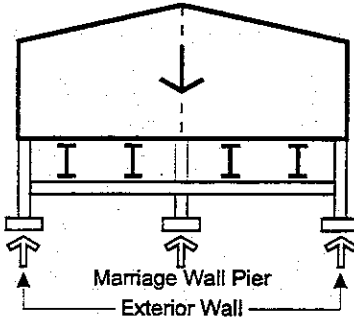

Required Effective Footing - Aftg *

		Min. Roof: 15 psf					
Net Soil Pres (psf)		Transverse Girder and Pier Spacing (ft)					
		4	5	6	7	8	10
1000	ext wall	1.0	1.1	1.1	1.2	1.3	1.4
	marriage	5.2	6.3	7.4	8.5	9.6	11.8
1500	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	3.5	4.2	4.9	5.7	6.4	7.8
2000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.6	3.1	3.7	4.2	4.8	5.9
2500	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.1	2.5	3.0	3.4	3.8	4.7
3000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	1.7	2.1	2.5	2.8	3.2	3.9
3500	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	1.5	1.8	2.1	2.4	2.7	3.4
4000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	1.3	1.6	1.8	2.1	2.4	2.9

		Marriage Wall Opening Width (ft)					
Net Soil Pres (psf)		10	12	14	16	18	20
1000	marriage	9.4	11.1	12.8	14.5	16.3	18.0
1500	marriage	6.3	7.4	8.6	9.7	10.8	12.0
2000	marriage	4.7	5.6	6.4	7.3	8.1	9.0
2500	marriage	3.8	4.4	5.1	5.8	6.5	7.2
3000	marriage	3.1	3.7	4.3	4.8	5.4	6.0
3500	marriage	2.7	3.2	3.7	4.2	4.6	5.1
4000	marriage	2.4	2.8	3.2	3.6	4.1	4.5

		Ground Snow: 25 psf					
Net Soil Pres (psf)		Transverse Girder and Pier Spacing (ft)					
		4	5	6	7	8	10
1000	ext wall	1.0	1.1	1.2	1.2	1.3	1.4
	marriage	5.3	6.4	7.6	8.7	9.8	12.0
1500	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	3.5	4.3	5.0	5.8	6.5	8.0
2000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.7	3.2	3.8	4.3	4.9	6.0
2500	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.1	2.6	3.0	3.5	3.9	4.8
3000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	1.8	2.1	2.5	2.9	3.3	4.0
3500	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	1.5	1.8	2.2	2.5	2.8	3.4
4000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	1.3	1.6	1.9	2.2	2.5	3.0

		Marriage Wall Opening Width (ft)					
Net Soil Pres (psf)		10	12	14	16	18	20
1000	marriage	9.7	11.5	13.2	15.0	16.8	18.5
1500	marriage	6.5	7.6	8.8	10.0	11.2	12.4
2000	marriage	4.9	5.7	6.6	7.5	8.4	9.3
2500	marriage	3.9	4.6	5.3	6.0	6.7	7.4
3000	marriage	3.2	3.8	4.4	5.0	5.6	6.2
3500	marriage	2.8	3.3	3.8	4.3	4.8	5.3
4000	marriage	2.4	2.9	3.3	3.8	4.2	4.6

		Ground Snow: 30 psf & Min. Roof: 20 psf					
Net Soil Pres (psf)		Transverse Girder and Pier Spacing (ft)					
		4	5	6	7	8	10
1000	ext wall	1.1	1.1	1.2	1.2	1.3	1.4
	marriage	5.5	6.6	7.8	9.0	10.1	12.5
1500	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	3.7	4.4	5.2	6.0	6.8	8.3
2000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.7	3.3	3.9	4.5	5.1	6.2
2500	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.2	2.7	3.1	3.6	4.1	5.0
3000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	1.8	2.2	2.6	3.0	3.4	4.2
3500	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	1.6	1.9	2.2	2.6	2.9	3.6
4000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	1.4	1.7	2.0	2.2	2.5	3.1

		Marriage Wall Opening Width (ft)					
Net Soil Pres (psf)		10	12	14	16	18	20
1000	marriage	10.1	12.0	13.8	15.7	17.5	19.4
1500	marriage	6.7	8.0	9.2	10.4	11.7	12.9
2000	marriage	5.1	6.0	6.9	7.8	8.8	9.7
2500	marriage	4.0	4.8	5.5	6.3	7.0	7.7
3000	marriage	3.4	4.0	4.6	5.2	5.8	6.5
3500	marriage	2.9	3.4	3.9	4.5	5.0	5.5
4000	marriage	2.5	3.0	3.5	3.9	4.4	4.8

* Minimum interior pier area is 1.0 sqft.
The Exterior Footing Widths are shown in feet. The Marriage Wall Footing Areas are shown in square feet.

Required Effective Footing - Aftg *



Ground Snow: 40 psf							
Net Soil		Transverse Girder and Pier Spacing (ft)					
Pres (psf)		4	5	6	7	8	10
1000	ext wall	1.1	1.2	1.2	1.3	1.3	1.5
	marriage	5.8	7.0	8.3	9.5	10.8	13.3
1500	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	3.9	4.7	5.5	6.4	7.2	8.8
2000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.9	3.5	4.1	4.8	5.4	6.6
2500	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.3	2.8	3.3	3.8	4.3	5.3
3000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	1.9	2.3	2.8	3.2	3.6	4.4
3500	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	1.7	2.0	2.4	2.7	3.1	3.8
4000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	1.5	1.8	2.1	2.4	2.7	3.3
Net Soil		Marriage Wall Opening Width (ft)					
Pres (psf)		10	12	14	16	18	20
1000	marriage	10.9	12.9	15.0	17.0	19.0	21.0
	marriage	7.3	8.6	10.0	11.3	12.7	14.0
1500	marriage	5.5	6.5	7.5	8.5	9.5	10.5
	marriage	4.4	5.2	6.0	6.8	7.6	8.4
2000	marriage	3.6	4.3	5.0	5.7	6.3	7.0
	marriage	3.1	3.7	4.3	4.8	5.4	6.0
2500	marriage	2.7	3.2	3.7	4.2	4.7	5.2

Ground Snow: 50 psf							
Net Soil		Transverse Girder and Pier Spacing (ft)					
Pres (psf)		4	5	6	7	8	10
1000	ext wall	1.1	1.2	1.3	1.3	1.4	1.5
	marriage	6.1	7.5	8.8	10.1	11.4	14.1
1500	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	4.1	5.0	5.9	6.7	7.6	9.4
2000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	3.1	3.7	4.4	5.1	5.7	7.0
2500	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.5	3.0	3.5	4.0	4.6	5.6
3000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.0	2.5	2.9	3.4	3.8	4.7
3500	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	1.8	2.1	2.5	2.9	3.3	4.0
4000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	1.5	1.9	2.2	2.5	2.9	3.5
Net Soil		Marriage Wall Opening Width (ft)					
Pres (psf)		10	12	14	16	18	20
1000	marriage	11.7	13.9	16.1	18.3	20.5	22.6
	marriage	7.8	9.3	10.7	12.2	13.6	15.1
1500	marriage	5.9	7.0	8.0	9.1	10.2	11.3
	marriage	4.7	5.6	6.4	7.3	8.2	9.1
2000	marriage	3.9	4.6	5.4	6.1	6.8	7.5
	marriage	3.4	4.0	4.6	5.2	5.8	6.5
2500	marriage	2.9	3.5	4.0	4.6	5.1	5.7

Ground Snow: 60 psf							
Net Soil		Transverse Girder and Pier Spacing (ft)					
Pres (psf)		4	5	6	7	8	10
1000	ext wall	1.2	1.2	1.3	1.4	1.4	1.5
	marriage	6.5	7.9	9.3	10.7	12.1	14.9
1500	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	4.3	5.2	6.2	7.1	8.1	9.9
2000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	3.2	3.9	4.6	5.3	6.0	7.5
2500	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.6	3.1	3.7	4.3	4.8	6.0
3000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.2	2.6	3.1	3.6	4.0	5.0
3500	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	1.8	2.2	2.6	3.1	3.5	4.3
4000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	1.6	2.0	2.3	2.7	3.0	3.7
Net Soil		Marriage Wall Opening Width (ft)					
Pres (psf)		10	12	14	16	18	20
1000	marriage	12.6	14.9	17.2	19.6	21.9	24.3
	marriage	8.4	9.9	11.5	13.1	14.6	16.2
1500	marriage	6.3	7.4	8.6	9.8	11.0	12.1
	marriage	5.0	6.0	6.9	7.8	8.8	9.7
2000	marriage	4.2	5.0	5.7	6.5	7.3	8.1
	marriage	3.6	4.3	4.9	5.6	6.3	6.9
2500	marriage	3.1	3.7	4.3	4.9	5.5	6.1

Ground Snow: 70 psf							
Net Soil		Transverse Girder and Pier Spacing (ft)					
Pres (psf)		4	5	6	7	8	10
1000	ext wall	1.2	1.3	1.3	1.4	1.5	1.6
	marriage	6.8	8.3	9.8	11.3	12.7	15.7
1500	ext wall	1.0	1.0	1.0	1.0	1.0	1.1
	marriage	4.5	5.5	6.5	7.5	8.5	10.5
2000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	3.4	4.1	4.9	5.6	6.4	7.9
2500	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.7	3.3	3.9	4.5	5.1	6.3
3000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.3	2.8	3.3	3.8	4.2	5.2
3500	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	1.9	2.4	2.8	3.2	3.6	4.5
4000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	1.7	2.1	2.4	2.8	3.2	3.9
Net Soil		Marriage Wall Opening Width (ft)					
Pres (psf)		10	12	14	16	18	20
1000	marriage	13.4	15.9	18.4	20.9	23.4	25.9
	marriage	8.9	10.6	12.3	13.9	15.6	17.3
1500	marriage	6.7	7.9	9.2	10.4	11.7	12.9
	marriage	5.4	6.4	7.4	8.4	9.4	10.4
2000	marriage	4.5	5.3	6.1	7.0	7.8	8.6
	marriage	3.8	4.5	5.3	6.0	6.7	7.4
2500	marriage	3.3	4.0	4.6	5.2	5.8	6.5

* Minimum interior pier area is 10 sqft
 The Exterior Footing Widths are shown in feet. The Marriage Wall Footing Areas are shown in square feet.

Aftg E5, E6 12'	
	Multi-Section
	Width

Required Effective Footing - Aftg *


Ground Snow: 80 psf							
Net Soil		Transverse Girder and Pier Spacing (ft)					
Pres (psf)		4	5	6	7	8	10
1000	ext wall	1.3	1.3	1.4	1.4	1.5	1.6
	marriage	7.1	8.7	10.3	11.8	13.4	16.5
1500	ext wall	1.0	1.0	1.0	1.0	1.0	1.1
	marriage	4.7	5.8	6.8	7.9	8.9	11.0
2000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	3.6	4.3	5.1	5.9	6.7	8.3
2500	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.8	3.5	4.1	4.7	5.4	6.6
3000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.4	2.9	3.4	3.9	4.5	5.5
3500	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.0	2.5	2.9	3.4	3.8	4.7
4000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	1.8	2.2	2.6	3.0	3.3	4.1
Net Soil		Marriage Wall Opening Width (ft)					
Pres (psf)		10	12	14	16	18	20
1000	marriage	14.2	16.9	19.5	22.2	24.9	27.5
	marriage	9.5	11.2	13.0	14.8	16.6	18.4
1500	marriage	7.1	8.4	9.8	11.1	12.4	13.8
	marriage	5.7	6.7	7.8	8.9	9.9	11.0
2000	marriage	4.7	5.6	6.5	7.4	8.3	9.2
	marriage	4.1	4.8	5.6	6.3	7.1	7.9
3000	marriage	3.5	4.2	4.9	5.5	6.2	6.9

Ground Snow: 90 psf							
Net Soil		Transverse Girder and Pier Spacing (ft)					
Pres (psf)		4	5	6	7	8	10
1000	ext wall	1.3	1.4	1.4	1.5	1.5	1.7
	marriage	7.4	9.1	10.7	12.4	14.1	17.4
1500	ext wall	1.0	1.0	1.0	1.0	1.0	1.1
	marriage	5.0	6.1	7.2	8.3	9.4	11.6
2000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	3.7	4.5	5.4	6.2	7.0	8.7
2500	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	3.0	3.6	4.3	5.0	5.6	6.9
3000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.5	3.0	3.6	4.1	4.7	5.8
3500	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.1	2.6	3.1	3.5	4.0	5.0
4000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	1.9	2.3	2.7	3.1	3.5	4.3
Net Soil		Marriage Wall Opening Width (ft)					
Pres (psf)		10	12	14	16	18	20
1000	marriage	15.0	17.8	20.7	23.5	26.3	29.2
	marriage	10.0	11.9	13.8	15.7	17.6	19.4
1500	marriage	7.5	8.9	10.3	11.8	13.2	14.6
	marriage	6.0	7.1	8.3	9.4	10.5	11.7
2000	marriage	5.0	5.9	6.9	7.8	8.8	9.7
	marriage	4.3	5.1	5.9	6.7	7.5	8.3
3000	marriage	3.8	4.5	5.2	5.9	6.6	7.3

Ground Snow: 100 psf							
Net Soil		Transverse Girder and Pier Spacing (ft)					
Pres (psf)		4	5	6	7	8	10
1000	ext wall	1.3	1.4	1.5	1.5	1.6	1.7
	marriage	7.8	9.5	11.2	13.0	14.7	18.2
1500	ext wall	1.0	1.0	1.0	1.0	1.1	1.1
	marriage	5.2	6.3	7.5	8.6	9.8	12.1
2000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	3.9	4.7	5.6	6.5	7.4	9.1
2500	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	3.1	3.8	4.5	5.2	5.9	7.3
3000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.6	3.2	3.7	4.3	4.9	6.1
3500	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.2	2.7	3.2	3.7	4.2	5.2
4000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	1.9	2.4	2.8	3.2	3.7	4.5
Net Soil		Marriage Wall Opening Width (ft)					
Pres (psf)		10	12	14	16	18	20
1000	marriage	15.8	18.8	21.8	24.8	27.8	30.8
	marriage	10.6	12.5	14.5	16.5	18.5	20.5
1500	marriage	7.9	9.4	10.9	12.4	13.9	15.4
	marriage	6.3	7.5	8.7	9.9	11.1	12.3
2000	marriage	5.3	6.3	7.3	8.3	9.3	10.3
	marriage	4.5	5.4	6.2	7.1	7.9	8.8
3000	marriage	4.0	4.7	5.5	6.2	7.0	7.7

* Minimum interior pier area is 1.0 sqft.
The Exterior Footing Widths are shown in feet. The Marriage Wall Footing Areas are shown in square feet.

Required Effective Footing - Aftg *

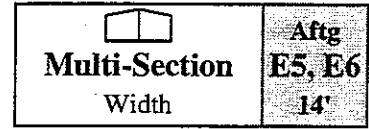

Min. Roof: 15 psf							
Net Soil		Transverse Girder and Pier Spacing (ft)					
Pres (psf)		4	5	6	7	8	10
1000	ext wall	1.1	1.2	1.3	1.3	1.4	1.5
	marriage	5.9	7.2	8.5	9.7	11.0	13.6
1500	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	4.0	4.8	5.7	6.5	7.3	9.0
2000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	3.0	3.6	4.2	4.9	5.5	6.8
2500	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.4	2.9	3.4	3.9	4.4	5.4
3000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.0	2.4	2.8	3.2	3.7	4.5
3500	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	1.7	2.1	2.4	2.8	3.1	3.9
4000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	1.5	1.8	2.1	2.4	2.8	3.4
Net Soil		Marriage Wall Opening Width (ft)					
Pres (psf)		10	12	14	16	18	20
1000	marriage	10.8	12.8	14.8	16.8	18.8	20.8
	marriage	7.2	8.6	9.9	11.2	12.5	13.9
1500	marriage	5.4	6.4	7.4	8.4	9.4	10.4
	marriage	4.3	5.1	5.9	6.7	7.5	8.3
2000	marriage	3.6	4.3	4.9	5.6	6.3	6.9
	marriage	3.1	3.7	4.2	4.8	5.4	5.9
3000	marriage	2.7	3.2	3.7	4.2	4.7	5.2

Ground Snow: 30 psf & Min. Roof: 20 psf							
Net Soil		Transverse Girder and Pier Spacing (ft)					
Pres (psf)		4	5	6	7	8	10
1000	ext wall	1.2	1.2	1.3	1.4	1.4	1.6
	marriage	6.3	7.6	9.0	10.3	11.7	14.4
1500	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	4.2	5.1	6.0	6.9	7.8	9.6
2000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	3.1	3.8	4.5	5.2	5.8	7.2
2500	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.5	3.0	3.6	4.1	4.7	5.7
3000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.1	2.5	3.0	3.4	3.9	4.8
3500	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	1.8	2.2	2.6	2.9	3.3	4.1
4000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	1.6	1.9	2.2	2.6	2.9	3.6
Net Soil		Marriage Wall Opening Width (ft)					
Pres (psf)		10	12	14	16	18	20
1000	marriage	11.7	13.8	16.0	18.1	20.3	22.4
	marriage	7.8	9.2	10.7	12.1	13.5	15.0
1500	marriage	5.8	6.9	8.0	9.1	10.1	11.2
	marriage	4.7	5.5	6.4	7.3	8.1	9.0
2000	marriage	3.9	4.6	5.3	6.0	6.8	7.5
	marriage	3.3	3.9	4.6	5.2	5.8	6.4
3000	marriage	2.9	3.5	4.0	4.5	5.1	5.6

Ground Snow: 25 psf							
Net Soil		Transverse Girder and Pier Spacing (ft)					
Pres (psf)		4	5	6	7	8	10
1000	ext wall	1.1	1.2	1.3	1.3	1.4	1.5
	marriage	6.1	7.4	8.7	10.0	11.3	13.9
1500	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	4.0	4.9	5.8	6.7	7.5	9.3
2000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	3.0	3.7	4.3	5.0	5.6	6.9
2500	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.4	3.0	3.5	4.0	4.5	5.6
3000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.0	2.5	2.9	3.3	3.8	4.6
3500	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	1.7	2.1	2.5	2.9	3.2	4.0
4000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	1.5	1.8	2.2	2.5	2.8	3.5
Net Soil		Marriage Wall Opening Width (ft)					
Pres (psf)		10	12	14	16	18	20
1000	marriage	11.2	13.3	15.3	17.4	19.4	21.5
	marriage	7.5	8.8	10.2	11.6	13.0	14.3
1500	marriage	5.6	6.6	7.7	8.7	9.7	10.7
	marriage	4.5	5.3	6.1	6.9	7.8	8.6
2000	marriage	3.7	4.4	5.1	5.8	6.5	7.2
	marriage	3.2	3.8	4.4	5.0	5.6	6.1
3000	marriage	2.8	3.3	3.8	4.3	4.9	5.4

Ground Snow: 40 psf							
Net Soil		Transverse Girder and Pier Spacing (ft)					
Pres (psf)		4	5	6	7	8	10
1000	ext wall	1.2	1.3	1.3	1.4	1.5	1.6
	marriage	6.6	8.1	9.5	11.0	12.4	15.3
1500	ext wall	1.0	1.0	1.0	1.0	1.0	1.1
	marriage	4.4	5.4	6.4	7.3	8.3	10.2
2000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	3.3	4.0	4.8	5.5	6.2	7.7
2500	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.7	3.2	3.8	4.4	5.0	6.1
3000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.2	2.7	3.2	3.7	4.1	5.1
3500	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	1.9	2.3	2.7	3.1	3.6	4.4
4000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	1.7	2.0	2.4	2.7	3.1	3.8
Net Soil		Marriage Wall Opening Width (ft)					
Pres (psf)		10	12	14	16	18	20
1000	marriage	12.6	15.0	17.3	19.7	22.0	24.4
	marriage	8.4	10.0	11.5	13.1	14.7	16.2
1500	marriage	6.3	7.5	8.7	9.8	11.0	12.2
	marriage	5.1	6.0	6.9	7.9	8.8	9.7
2000	marriage	4.2	5.0	5.8	6.6	7.3	8.1
	marriage	3.6	4.3	4.9	5.6	6.3	7.0
3000	marriage	3.2	3.7	4.3	4.9	5.5	6.1

* Minimum interior pier area is 1.0 sqft.
The Exterior Footing Widths are shown in feet. The Marriage Wall Footing Areas are shown in square feet.

Aftg E5, E6 14'	
	Multi-Section
	Width

Required Effective Footing - Aftg *

Ground Snow: 50 psf							
Net Soil		Transverse Girder and Pier Spacing (ft)					
Pres (psf)		4	5	6	7	8	10
1000	ext wall	1.2	1.3	1.4	1.5	1.5	1.7
	marriage	7.0	8.6	10.1	11.7	13.2	16.3
1500	ext wall	1.0	1.0	1.0	1.0	1.0	1.1
	marriage	4.7	5.7	6.7	7.8	8.8	10.9
2000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	3.5	4.3	5.1	5.8	6.6	8.1
2500	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.8	3.4	4.0	4.7	5.3	6.5
3000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.3	2.9	3.4	3.9	4.4	5.4
3500	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.0	2.4	2.9	3.3	3.8	4.7
4000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	1.8	2.1	2.5	2.9	3.3	4.1
Net Soil		Marriage Wall Opening Width (ft)					
Pres (psf)		10	12	14	16	18	20
1000	marriage	13.6	16.1	18.7	21.2	23.7	26.3
	marriage	9.1	10.7	12.4	14.1	15.8	17.5
1500	marriage	6.8	8.1	9.3	10.6	11.9	13.1
	marriage	5.4	6.4	7.5	8.5	9.5	10.5
2500	marriage	4.5	5.4	6.2	7.1	7.9	8.8
	marriage	3.9	4.6	5.3	6.1	6.8	7.5
4000	marriage	3.4	4.0	4.7	5.3	5.9	6.6

Ground Snow: 60 psf							
Net Soil		Transverse Girder and Pier Spacing (ft)					
Pres (psf)		4	5	6	7	8	10
1000	ext wall	1.3	1.4	1.4	1.5	1.6	1.7
	marriage	7.4	9.1	10.7	12.3	14.0	17.2
1500	ext wall	1.0	1.0	1.0	1.0	1.1	1.1
	marriage	4.9	6.0	7.1	8.2	9.3	11.5
2000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	3.7	4.5	5.3	6.2	7.0	8.6
2500	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	3.0	3.6	4.3	4.9	5.6	6.9
3000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.5	3.0	3.6	4.1	4.7	5.7
3500	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.1	2.6	3.1	3.5	4.0	4.9
4000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	1.9	2.3	2.7	3.1	3.5	4.3
Net Soil		Marriage Wall Opening Width (ft)					
Pres (psf)		10	12	14	16	18	20
1000	marriage	14.5	17.3	20.0	22.7	25.5	28.2
	marriage	9.7	11.5	13.3	15.2	17.0	18.8
1500	marriage	7.3	8.6	10.0	11.4	12.7	14.1
	marriage	5.8	6.9	8.0	9.1	10.2	11.3
2500	marriage	4.8	5.8	6.7	7.6	8.5	9.4
	marriage	4.2	4.9	5.7	6.5	7.3	8.1
4000	marriage	3.6	4.3	5.0	5.7	6.4	7.0

Ground Snow: 70 psf							
Net Soil		Transverse Girder and Pier Spacing (ft)					
Pres (psf)		4	5	6	7	8	10
1000	ext wall	1.3	1.4	1.5	1.6	1.6	1.8
	marriage	7.8	9.5	11.3	13.0	14.7	18.2
1500	ext wall	1.0	1.0	1.0	1.0	1.1	1.2
	marriage	5.2	6.4	7.5	8.7	9.8	12.1
2000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	3.9	4.8	5.6	6.5	7.4	9.1
2500	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	3.1	3.8	4.5	5.2	5.9	7.3
3000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.6	3.2	3.8	4.3	4.9	6.1
3500	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.2	2.7	3.2	3.7	4.2	5.2
4000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	1.9	2.4	2.8	3.2	3.7	4.5
Net Soil		Marriage Wall Opening Width (ft)					
Pres (psf)		10	12	14	16	18	20
1000	marriage	15.5	18.4	21.3	24.3	27.2	30.1
	marriage	10.3	12.3	14.2	16.2	18.1	20.1
1500	marriage	7.7	9.2	10.7	12.1	13.6	15.0
	marriage	6.2	7.4	8.5	9.7	10.9	12.0
2500	marriage	5.2	6.1	7.1	8.1	9.1	10.0
	marriage	4.4	5.3	6.1	6.9	7.8	8.6
4000	marriage	3.9	4.6	5.3	6.1	6.8	7.5

Ground Snow: 80 psf							
Net Soil		Transverse Girder and Pier Spacing (ft)					
Pres (psf)		4	5	6	7	8	10
1000	ext wall	1.4	1.5	1.5	1.6	1.7	1.8
	marriage	8.2	10.0	11.8	13.7	15.5	19.2
1500	ext wall	1.0	1.0	1.0	1.1	1.1	1.2
	marriage	5.5	6.7	7.9	9.1	10.3	12.8
2000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	4.1	5.0	5.9	6.8	7.7	9.6
2500	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	3.3	4.0	4.7	5.5	6.2	7.7
3000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.7	3.3	3.9	4.6	5.2	6.4
3500	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.3	2.9	3.4	3.9	4.4	5.5
4000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.0	2.5	3.0	3.4	3.9	4.8
Net Soil		Marriage Wall Opening Width (ft)					
Pres (psf)		10	12	14	16	18	20
1000	marriage	16.5	19.6	22.7	25.8	28.9	32.0
	marriage	11.0	13.0	15.1	17.2	19.3	21.3
1500	marriage	8.2	9.8	11.3	12.9	14.4	16.0
	marriage	6.6	7.8	9.1	10.3	11.6	12.8
2500	marriage	5.5	6.5	7.6	8.6	9.6	10.7
	marriage	4.7	5.6	6.5	7.4	8.3	9.1
4000	marriage	4.1	4.9	5.7	6.4	7.2	8.0

* Minimum interior pier area is 1.0 sqft.
The Exterior Footing Widths are shown in feet. The Marriage Wall Footing Areas are shown in square feet.

Required Effective Footing - Aftg *



Ground Snow: 90 psf							
Net Soil Pres (psf)		Transverse Girder and Pier Spacing (ft)					
		4	5	6	7	8	10
1000	ext wall	1.4	1.5	1.6	1.7	1.7	1.9
	marriage	8.6	10.5	12.4	14.3	16.3	20.1
1500	ext wall	1.0	1.0	1.1	1.1	1.1	1.2
	marriage	5.7	7.0	8.3	9.6	10.8	13.4
2000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	4.3	5.2	6.2	7.2	8.1	10.1
2500	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	3.4	4.2	5.0	5.7	6.5	8.0
3000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.9	3.5	4.1	4.8	5.4	6.7
3500	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.4	3.0	3.5	4.1	4.6	5.7
4000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.1	2.6	3.1	3.6	4.1	5.0
Net Soil Pres (psf)		Marriage Wall Opening Width (ft)					
		10	12	14	16	18	20
1000	marriage	17.4	20.7	24.0	27.3	30.6	33.9
1500	marriage	11.6	13.8	16.0	18.2	20.4	22.6
2000	marriage	8.7	10.4	12.0	13.7	15.3	17.0
2500	marriage	7.0	8.3	9.6	10.9	12.2	13.6
3000	marriage	5.8	6.9	8.0	9.1	10.2	11.3
3500	marriage	5.0	5.9	6.9	7.8	8.7	9.7
4000	marriage	4.4	5.2	6.0	6.8	7.7	8.5

Ground Snow: 100 psf							
Net Soil Pres (psf)		Transverse Girder and Pier Spacing (ft)					
		4	5	6	7	8	10
1000	ext wall	1.5	1.6	1.6	1.7	1.8	1.9
	marriage	8.9	11.0	13.0	15.0	17.0	21.1
1500	ext wall	1.0	1.0	1.1	1.1	1.2	1.3
	marriage	6.0	7.3	8.7	10.0	11.4	14.0
2000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	4.5	5.5	6.5	7.5	8.5	10.5
2500	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	3.6	4.4	5.2	6.0	6.8	8.4
3000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	3.0	3.7	4.3	5.0	5.7	7.0
3500	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.6	3.1	3.7	4.3	4.9	6.0
4000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.2	2.7	3.2	3.8	4.3	5.3
Net Soil Pres (psf)		Marriage Wall Opening Width (ft)					
		10	12	14	16	18	20
1000	marriage	18.4	21.9	25.4	28.8	32.3	35.8
1500	marriage	12.2	14.6	16.9	19.2	21.6	23.9
2000	marriage	9.2	10.9	12.7	14.4	16.2	17.9
2500	marriage	7.3	8.7	10.1	11.5	12.9	14.3
3000	marriage	6.1	7.3	8.5	9.6	10.8	11.9
3500	marriage	5.2	6.2	7.2	8.2	9.2	10.2
4000	marriage	4.6	5.5	6.3	7.2	8.1	9.0

* Minimum interior pier area is 1.0 sqft.

The Exterior Footing Widths are shown in feet. The Marriage Wall Footing Areas are shown in square feet.

Aftg E5, E6 16'	
	Multi-Section
	Width

Required Effective Footing - Aftg *

Min. Roof: 15 psf							
Net Soil		Transverse Girder and Pier Spacing (ft)					
Pres (psf)		4	5	6	7	8	10
1000	ext wall	1.2	1.3	1.4	1.4	1.5	1.7
	marriage	6.6	8.0	9.5	10.9	12.3	15.2
1500	ext wall	1.0	1.0	1.0	1.0	1.0	1.1
	marriage	4.4	5.4	6.3	7.3	8.2	10.1
2000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	3.3	4.0	4.7	5.5	6.2	7.6
2500	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.6	3.2	3.8	4.4	4.9	6.1
3000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.2	2.7	3.2	3.6	4.1	5.1
3500	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	1.9	2.3	2.7	3.1	3.5	4.3
4000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	1.7	2.0	2.4	2.7	3.1	3.8
Net Soil		Marriage Wall Opening Width (ft)					
Pres (psf)		10	12	14	16	18	20
1000	marriage	12.2	14.4	16.7	18.9	21.2	23.4
	marriage	8.1	9.6	11.1	12.6	14.1	15.6
1500	marriage	6.1	7.2	8.3	9.5	10.6	11.7
	marriage	4.9	5.8	6.7	7.6	8.5	9.4
2000	marriage	4.1	4.8	5.6	6.3	7.1	7.8
	marriage	3.5	4.1	4.8	5.4	6.0	6.7
3000	marriage	3.0	3.6	4.2	4.7	5.3	5.9


Ground Snow: 25 psf							
Net Soil		Transverse Girder and Pier Spacing (ft)					
Pres (psf)		4	5	6	7	8	10
1000	ext wall	1.2	1.3	1.4	1.5	1.5	1.7
	marriage	6.8	8.2	9.7	11.2	12.6	15.6
1500	ext wall	1.0	1.0	1.0	1.0	1.0	1.1
	marriage	4.5	5.5	6.5	7.5	8.4	10.4
2000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	3.4	4.1	4.9	5.6	6.3	7.8
2500	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.7	3.3	3.9	4.5	5.1	6.2
3000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.3	2.7	3.2	3.7	4.2	5.2
3500	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	1.9	2.4	2.8	3.2	3.6	4.5
4000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	1.7	2.1	2.4	2.8	3.2	3.9
Net Soil		Marriage Wall Opening Width (ft)					
Pres (psf)		10	12	14	16	18	20
1000	marriage	12.6	14.9	17.2	19.5	21.9	24.2
	marriage	8.4	9.9	11.5	13.0	14.6	16.1
1500	marriage	6.3	7.4	8.6	9.8	10.9	12.1
	marriage	5.0	6.0	6.9	7.8	8.7	9.7
2000	marriage	4.2	5.0	5.7	6.5	7.3	8.1
	marriage	3.6	4.3	4.9	5.6	6.2	6.9
3000	marriage	3.1	3.7	4.3	4.9	5.5	6.0

Ground Snow: 30 psf & Min. Roof: 20 psf							
Net Soil		Transverse Girder and Pier Spacing (ft)					
Pres (psf)		4	5	6	7	8	10
1000	ext wall	1.2	1.3	1.4	1.5	1.6	1.7
	marriage	7.0	8.5	10.0	11.6	13.1	16.1
1500	ext wall	1.0	1.0	1.0	1.0	1.0	1.1
	marriage	4.7	5.7	6.7	7.7	8.7	10.8
2000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	3.5	4.3	5.0	5.8	6.5	8.1
2500	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.8	3.4	4.0	4.6	5.2	6.5
3000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.3	2.8	3.3	3.9	4.4	5.4
3500	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.0	2.4	2.9	3.3	3.7	4.6
4000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	1.7	2.1	2.5	2.9	3.3	4.0
Net Soil		Marriage Wall Opening Width (ft)					
Pres (psf)		10	12	14	16	18	20
1000	marriage	13.1	15.5	18.0	20.4	22.8	25.3
	marriage	8.7	10.4	12.0	13.6	15.2	16.8
1500	marriage	6.5	7.8	9.0	10.2	11.4	12.6
	marriage	5.2	6.2	7.2	8.2	9.1	10.1
2000	marriage	4.4	5.2	6.0	6.8	7.6	8.4
	marriage	3.7	4.4	5.1	5.8	6.5	7.2
3000	marriage	3.3	3.9	4.5	5.1	5.7	6.3

Ground Snow: 40 psf							
Net Soil		Transverse Girder and Pier Spacing (ft)					
Pres (psf)		4	5	6	7	8	10
1000	ext wall	1.3	1.4	1.5	1.5	1.6	1.8
	marriage	7.4	9.1	10.7	12.3	13.9	17.2
1500	ext wall	1.0	1.0	1.0	1.0	1.1	1.2
	marriage	4.9	6.0	7.1	8.2	9.3	11.5
2000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	3.7	4.5	5.3	6.2	7.0	8.6
2500	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	3.0	3.6	4.3	4.9	5.6	6.9
3000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.5	3.0	3.6	4.1	4.6	5.7
3500	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.1	2.6	3.1	3.5	4.0	4.9
4000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	1.9	2.3	2.7	3.1	3.5	4.3
Net Soil		Marriage Wall Opening Width (ft)					
Pres (psf)		10	12	14	16	18	20
1000	marriage	14.2	16.8	19.5	22.1	24.8	27.4
	marriage	9.5	11.2	13.0	14.8	16.5	18.3
1500	marriage	7.1	8.4	9.7	11.1	12.4	13.7
	marriage	5.7	6.7	7.8	8.9	9.9	11.0
2000	marriage	4.7	5.6	6.5	7.4	8.3	9.1
	marriage	4.1	4.8	5.6	6.3	7.1	7.8
3000	marriage	3.5	4.2	4.9	5.5	6.2	6.9

* Minimum interior pier area is 1.0 sqft.
The Exterior Footing Widths are shown in feet. The Marriage Wall Footing Areas are shown in square feet.

Required Effective Footing - Aftg *

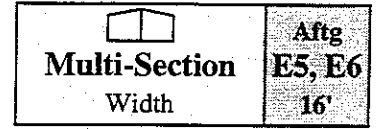

Ground Snow: 50 psf							
Net Soil		Transverse Girder and Pier Spacing (ft)					
Pres (psf)		4	5	6	7	8	10
1000	ext wall	1.4	1.4	1.5	1.6	1.7	1.8
	marriage	7.9	9.6	11.3	13.1	14.8	18.3
1500	ext wall	1.0	1.0	1.0	1.1	1.1	1.2
	marriage	5.2	6.4	7.6	8.7	9.9	12.2
2000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	3.9	4.8	5.7	6.5	7.4	9.1
2500	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	3.1	3.8	4.5	5.2	5.9	7.3
3000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.6	3.2	3.8	4.4	4.9	6.1
3500	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.2	2.7	3.2	3.7	4.2	5.2
4000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.0	2.4	2.8	3.3	3.7	4.6
Net Soil		Marriage Wall Opening Width (ft)					
Pres (psf)		10	12	14	16	18	20
1000	marriage	15.3	18.1	21.0	23.9	26.7	29.6
	marriage	10.2	12.1	14.0	15.9	17.8	19.7
1500	marriage	7.6	9.1	10.5	11.9	13.4	14.8
	marriage	6.1	7.3	8.4	9.5	10.7	11.8
2000	marriage	5.1	6.0	7.0	8.0	8.9	9.9
	marriage	4.4	5.2	6.0	6.8	7.6	8.5
3000	marriage	3.8	4.5	5.3	6.0	6.7	7.4

Ground Snow: 70 psf							
Net Soil		Transverse Girder and Pier Spacing (ft)					
Pres (psf)		4	5	6	7	8	10
1000	ext wall	1.5	1.5	1.6	1.7	1.8	1.9
	marriage	8.7	10.7	12.6	14.6	16.6	20.5
1500	ext wall	1.0	1.0	1.1	1.1	1.2	1.3
	marriage	5.8	7.1	8.4	9.7	11.0	13.6
2000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	4.4	5.3	6.3	7.3	8.3	10.2
2500	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	3.5	4.3	5.1	5.8	6.6	8.2
3000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.9	3.6	4.2	4.9	5.5	6.8
3500	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.5	3.1	3.6	4.2	4.7	5.8
4000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.2	2.7	3.2	3.6	4.1	5.1
Net Soil		Marriage Wall Opening Width (ft)					
Pres (psf)		10	12	14	16	18	20
1000	marriage	17.4	20.7	24.0	27.3	30.6	33.9
	marriage	11.6	13.8	16.0	18.2	20.4	22.6
1500	marriage	8.7	10.4	12.0	13.7	15.3	17.0
	marriage	7.0	8.3	9.6	10.9	12.3	13.6
2000	marriage	5.8	6.9	8.0	9.1	10.2	11.3
	marriage	5.0	5.9	6.9	7.8	8.8	9.7
3000	marriage	4.4	5.2	6.0	6.8	7.7	8.5

Ground Snow: 60 psf							
Net Soil		Transverse Girder and Pier Spacing (ft)					
Pres (psf)		4	5	6	7	8	10
1000	ext wall	1.4	1.5	1.6	1.6	1.7	1.9
	marriage	8.3	10.1	12.0	13.8	15.7	19.4
1500	ext wall	1.0	1.0	1.0	1.1	1.2	1.3
	marriage	5.5	6.8	8.0	9.2	10.5	12.9
2000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	4.1	5.1	6.0	6.9	7.8	9.7
2500	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	3.3	4.1	4.8	5.5	6.3	7.8
3000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.8	3.4	4.0	4.6	5.2	6.5
3500	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.4	2.9	3.4	4.0	4.5	5.5
4000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.1	2.5	3.0	3.5	3.9	4.8
Net Soil		Marriage Wall Opening Width (ft)					
Pres (psf)		10	12	14	16	18	20
1000	marriage	16.4	19.4	22.5	25.6	28.7	31.8
	marriage	10.9	13.0	15.0	17.1	19.1	21.2
1500	marriage	8.2	9.7	11.3	12.8	14.3	15.9
	marriage	6.5	7.8	9.0	10.2	11.5	12.7
2000	marriage	5.5	6.5	7.5	8.5	9.6	10.6
	marriage	4.7	5.6	6.4	7.3	8.2	9.1
3000	marriage	4.1	4.9	5.6	6.4	7.2	7.9

Ground Snow: 80 psf							
Net Soil		Transverse Girder and Pier Spacing (ft)					
Pres (psf)		4	5	6	7	8	10
1000	ext wall	1.5	1.6	1.7	1.8	1.8	2.0
	marriage	9.2	11.2	13.3	15.4	17.4	21.6
1500	ext wall	1.0	1.1	1.1	1.2	1.2	1.3
	marriage	6.1	7.5	8.9	10.2	11.6	14.4
2000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	4.6	5.6	6.6	7.7	8.7	10.8
2500	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	3.7	4.5	5.3	6.1	7.0	8.6
3000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	3.1	3.7	4.4	5.1	5.8	7.2
3500	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.6	3.2	3.8	4.4	5.0	6.2
4000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.3	2.8	3.3	3.8	4.4	5.4
Net Soil		Marriage Wall Opening Width (ft)					
Pres (psf)		10	12	14	16	18	20
1000	marriage	18.5	22.0	25.6	29.1	32.6	36.1
	marriage	12.3	14.7	17.0	19.4	21.7	24.1
1500	marriage	9.3	11.0	12.8	14.5	16.3	18.1
	marriage	7.4	8.8	10.2	11.6	13.0	14.4
2000	marriage	6.2	7.3	8.5	9.7	10.9	12.0
	marriage	5.3	6.3	7.3	8.3	9.3	10.3
3000	marriage	4.6	5.5	6.4	7.3	8.2	9.0

* Minimum interior pier area is 1.0 sqft.
The Exterior Footing Widths are shown in feet. The Marriage Wall Footing Areas are shown in square feet.

Aftg E5, E6 16'	
	Multi-Section
	Width

Required Effective Footing - Aftg *

Ground Snow: 90 psf							
Net Soil		Transverse Girder and Pier Spacing (ft)					
Pres (psf)		4	5	6	7	8	10
1000	ext wall	1.6	1.6	1.7	1.8	1.9	2.0
	marriage	9.6	11.8	13.9	16.1	18.3	22.6
1500	ext wall	1.0	1.1	1.2	1.2	1.3	1.4
	marriage	6.4	7.8	9.3	10.7	12.2	15.1
2000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	4.8	5.9	7.0	8.1	9.1	11.3
2500	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	3.8	4.7	5.6	6.4	7.3	9.1
3000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	3.2	3.9	4.6	5.4	6.1	7.5
3500	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.7	3.4	4.0	4.6	5.2	6.5
4000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.4	2.9	3.5	4.0	4.6	5.7
Net Soil		Marriage Wall Opening Width (ft)					
Pres (psf)		10	12	14	16	18	20
1000	marriage	19.6	23.3	27.1	30.8	34.6	38.3
	marriage	13.1	15.6	18.1	20.5	23.0	25.5
2000	marriage	9.8	11.7	13.5	15.4	17.3	19.1
	marriage	7.8	9.3	10.8	12.3	13.8	15.3
3000	marriage	6.5	7.8	9.0	10.3	11.5	12.8
	marriage	5.6	6.7	7.7	8.8	9.9	10.9
4000	marriage	4.9	5.8	6.8	7.7	8.6	9.6

Ground Snow: 100 psf							
Net Soil		Transverse Girder and Pier Spacing (ft)					
Pres (psf)		4	5	6	7	8	10
1000	ext wall	1.6	1.7	1.8	1.9	1.9	2.1
	marriage	10.0	12.3	14.6	16.9	19.2	23.7
1500	ext wall	1.1	1.1	1.2	1.2	1.3	1.4
	marriage	6.7	8.2	9.7	11.2	12.8	15.8
2000	ext wall	1.0	1.0	1.0	1.0	1.0	1.1
	marriage	5.0	6.2	7.3	8.4	9.6	11.9
2500	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	4.0	4.9	5.8	6.7	7.7	9.5
3000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	3.3	4.1	4.9	5.6	6.4	7.9
3500	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.9	3.5	4.2	4.8	5.5	6.8
4000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.5	3.1	3.6	4.2	4.8	5.9
Net Soil		Marriage Wall Opening Width (ft)					
Pres (psf)		10	12	14	16	18	20
1000	marriage	20.7	24.6	28.6	32.6	36.5	40.5
	marriage	13.8	16.4	19.1	21.7	24.3	27
2000	marriage	10.3	12.3	14.3	16.3	18.3	20.2
	marriage	8.3	9.9	11.4	13.0	14.6	16.2
3000	marriage	6.9	8.2	9.5	10.9	12.2	13.5
	marriage	5.9	7.0	8.2	9.3	10.4	11.6
4000	marriage	5.2	6.2	7.2	8.1	9.1	10.1

* Minimum interior pier area is 1.0 sqft.

The Exterior Footing Widths are shown in feet. The Marriage Wall Footing Areas are shown in square feet.

Multi-Section E7


Required Effective Footing - Aftg *

Min. Roof: 15 psf							
Net Soil		Transverse Girder and Pier Spacing (ft)					
Pres (psf)		4	5	6	7	8	10
1000	ext wall	1.7	1.7	1.7	1.7	1.7	1.7
	marriage	6.0	7.1	8.2	9.3	10.4	12.6
1500	ext wall	1.2	1.2	1.2	1.2	1.2	1.2
	marriage	4.0	4.7	5.5	6.2	6.9	8.4
2000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	3.0	3.6	4.1	4.6	5.2	6.3
2500	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.4	2.8	3.3	3.7	4.2	5.0
3000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.0	2.4	2.7	3.1	3.5	4.2
3500	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	1.7	2.0	2.3	2.7	3.0	3.6
4000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	1.5	1.8	2.0	2.3	2.6	3.1

Net Soil		Marriage Wall Opening Width (ft)					
Pres (psf)		10	12	14	16	18	20
1000	marriage	10.2	11.9	13.6	15.4	17.1	18.8
1500	marriage	6.8	8.0	9.1	10.2	11.4	12.5
2000	marriage	5.1	6.0	6.8	7.7	8.5	9.4
2500	marriage	4.1	4.8	5.5	6.1	6.8	7.5
3000	marriage	3.4	4.0	4.5	5.1	5.7	6.3
3500	marriage	2.9	3.4	3.9	4.4	4.9	5.4
4000	marriage	2.6	3.0	3.4	3.8	4.3	4.7

Ground Snow: 25 psf							
Net Soil		Transverse Girder and Pier Spacing (ft)					
Pres (psf)		4	5	6	7	8	10
1000	ext wall	1.8	1.8	1.7	1.7	1.7	1.7
	marriage	6.1	7.3	8.4	9.5	10.6	12.9
1500	ext wall	1.2	1.2	1.2	1.2	1.2	1.2
	marriage	4.1	4.8	5.6	6.3	7.1	8.6
2000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	3.1	3.6	4.2	4.7	5.3	6.4
2500	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.5	2.9	3.3	3.8	4.2	5.1
3000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.0	2.4	2.8	3.2	3.5	4.3
3500	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	1.8	2.1	2.4	2.7	3.0	3.7
4000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	1.5	1.8	2.1	2.4	2.7	3.2

Net Soil		Marriage Wall Opening Width (ft)					
Pres (psf)		10	12	14	16	18	20
1000	marriage	10.5	12.3	14.1	15.8	17.6	19.4
1500	marriage	7.0	8.2	9.4	10.5	11.7	12.9
2000	marriage	5.3	6.1	7.0	7.9	8.8	9.7
2500	marriage	4.2	4.9	5.6	6.3	7.0	7.7
3000	marriage	3.5	4.1	4.7	5.3	5.9	6.5
3500	marriage	3.0	3.5	4.0	4.5	5.0	5.5
4000	marriage	2.6	3.1	3.5	4.0	4.4	4.8

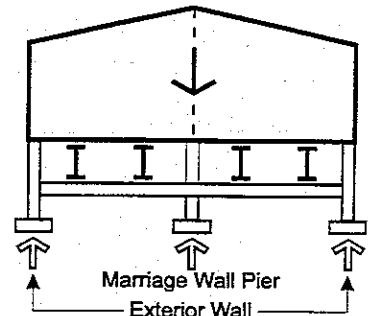

Ground Snow: 30 psf & Min. Roof: 20 psf							
Net Soil		Transverse Girder and Pier Spacing (ft)					
Pres (psf)		4	5	6	7	8	10
1000	ext wall	1.8	1.8	1.8	1.8	1.8	1.8
	marriage	6.3	7.5	8.6	9.8	10.9	13.3
1500	ext wall	1.2	1.2	1.2	1.2	1.2	1.2
	marriage	4.2	5.0	5.7	6.5	7.3	8.8
2000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	3.1	3.7	4.3	4.9	5.5	6.6
2500	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.5	3.0	3.4	3.9	4.4	5.3
3000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.1	2.5	2.9	3.3	3.6	4.4
3500	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	1.8	2.1	2.5	2.8	3.1	3.8
4000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	1.6	1.9	2.2	2.4	2.7	3.3

Net Soil		Marriage Wall Opening Width (ft)					
Pres (psf)		10	12	14	16	18	20
1000	marriage	10.9	12.8	14.6	16.5	18.3	20.2
1500	marriage	7.3	8.5	9.8	11.0	12.2	13.5
2000	marriage	5.5	6.4	7.3	8.2	9.2	10.1
2500	marriage	4.4	5.1	5.9	6.6	7.3	8.1
3000	marriage	3.6	4.3	4.9	5.5	6.1	6.7
3500	marriage	3.1	3.7	4.2	4.7	5.2	5.8
4000	marriage	2.7	3.2	3.7	4.1	4.6	5.0

* Minimum interior pier area is 1.0 sqft.

The Exterior Footing Widths are shown in feet. The Marriage Wall Footing Areas are shown in square feet.

Aftg
E7
12'



Multi-Section
Width

Required Effective Footing - Aftg *

Ground Snow: 40 psf							
Net Soil		Transverse Girder and Pier Spacing (ft)					
Pres (psf)		4	5	6	7	8	10
1000	ext wall	1.8	1.8	1.8	1.8	1.8	1.8
	marriage	6.6	7.9	9.1	10.4	11.6	14.1
1500	ext wall	1.2	1.2	1.2	1.2	1.2	1.2
	marriage	4.4	5.2	6.1	6.9	7.7	9.4
2000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	3.3	3.9	4.6	5.2	5.8	7.0
2500	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.6	3.1	3.6	4.1	4.6	5.6
3000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.2	2.6	3.0	3.5	3.9	4.7
3500	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	1.9	2.2	2.6	3.0	3.3	4.0
4000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	1.7	2.0	2.3	2.6	2.9	3.5

Net Soil		Marriage Wall Opening Width (ft)					
Pres (psf)		10	12	14	16	18	20
1000	marriage	11.7	13.8	15.8	17.8	19.8	21.8
1500	marriage	7.8	9.2	10.5	11.9	13.2	14.5
2000	marriage	5.9	6.9	7.9	8.9	9.9	10.9
2500	marriage	4.7	5.5	6.3	7.1	7.9	8.7
3000	marriage	3.9	4.6	5.3	5.9	6.6	7.3
3500	marriage	3.4	3.9	4.5	5.1	5.7	6.2
4000	marriage	2.9	3.4	3.9	4.4	4.9	5.5

Ground Snow: 60 psf							
Net Soil		Transverse Girder and Pier Spacing (ft)					
Pres (psf)		4	5	6	7	8	10
1000	ext wall	1.9	1.9	1.9	1.9	1.9	1.9
	marriage	7.3	8.7	10.1	11.5	12.9	15.7
1500	ext wall	1.3	1.3	1.3	1.3	1.3	1.3
	marriage	4.8	5.8	6.7	7.7	8.6	10.5
2000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	3.6	4.3	5.0	5.7	6.5	7.9
2500	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.9	3.5	4.0	4.6	5.2	6.3
3000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.4	2.9	3.4	3.8	4.3	5.2
3500	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.1	2.5	2.9	3.3	3.7	4.5
4000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	1.8	2.2	2.5	2.9	3.2	3.9

Net Soil		Marriage Wall Opening Width (ft)					
Pres (psf)		10	12	14	16	18	20
1000	marriage	13.4	15.7	18.1	20.4	22.7	25.1
1500	marriage	8.9	10.5	12.0	13.6	15.2	16.7
2000	marriage	6.7	7.9	9.0	10.2	11.4	12.5
2500	marriage	5.3	6.3	7.2	8.2	9.1	10.0
3000	marriage	4.5	5.2	6.0	6.8	7.6	8.4
3500	marriage	3.8	4.5	5.2	5.8	6.5	7.2
4000	marriage	3.3	3.9	4.5	5.1	5.7	6.3

Ground Snow: 50 psf							
Net Soil		Transverse Girder and Pier Spacing (ft)					
Pres (psf)		4	5	6	7	8	10
1000	ext wall	1.9	1.9	1.9	1.8	1.8	1.8
	marriage	6.9	8.3	9.6	10.9	12.3	14.9
1500	ext wall	1.2	1.2	1.2	1.2	1.2	1.2
	marriage	4.6	5.5	6.4	7.3	8.2	9.9
2000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	3.5	4.1	4.8	5.5	6.1	7.5
2500	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.8	3.3	3.8	4.4	4.9	6.0
3000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.3	2.8	3.2	3.6	4.1	5.0
3500	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.0	2.4	2.7	3.1	3.5	4.3
4000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	1.7	2.1	2.4	2.7	3.1	3.7

Net Soil		Marriage Wall Opening Width (ft)					
Pres (psf)		10	12	14	16	18	20
1000	marriage	12.6	14.7	16.9	19.1	21.3	23.4
1500	marriage	8.4	9.8	11.3	12.7	14.2	15.6
2000	marriage	6.3	7.4	8.5	9.5	10.6	11.7
2500	marriage	5.0	5.9	6.8	7.6	8.5	9.4
3000	marriage	4.2	4.9	5.6	6.4	7.1	7.8
3500	marriage	3.6	4.2	4.8	5.5	6.1	6.7
4000	marriage	3.1	3.7	4.2	4.8	5.3	5.9

Ground Snow: 70 psf							
Net Soil		Transverse Girder and Pier Spacing (ft)					
Pres (psf)		4	5	6	7	8	10
1000	ext wall	1.9	1.9	1.9	1.9	1.9	1.9
	marriage	7.6	9.1	10.6	12.1	13.6	16.5
1500	ext wall	1.3	1.3	1.3	1.3	1.3	1.3
	marriage	5.1	6.1	7.1	8.0	9.0	11.0
2000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	3.8	4.5	5.3	6.0	6.8	8.3
2500	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	3.0	3.6	4.2	4.8	5.4	6.6
3000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.5	3.0	3.5	4.0	4.5	5.5
3500	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.2	2.6	3.0	3.4	3.9	4.7
4000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	1.9	2.3	2.6	3.0	3.4	4.1

Net Soil		Marriage Wall Opening Width (ft)					
Pres (psf)		10	12	14	16	18	20
1000	marriage	14.2	16.7	19.2	21.7	24.2	26.7
1500	marriage	9.5	11.1	12.8	14.5	16.1	17.8
2000	marriage	7.1	8.3	9.6	10.9	12.1	13.4
2500	marriage	5.7	6.7	7.7	8.7	9.7	10.7
3000	marriage	4.7	5.6	6.4	7.2	8.1	8.9
3500	marriage	4.1	4.8	5.5	6.2	6.9	7.6
4000	marriage	3.5	4.2	4.8	5.4	6.1	6.7

* Minimum interior pier area is 1.0 sqft.
The Exterior Footing Widths are shown in feet. The Marriage Wall Footing Areas are shown in square feet.

Required Effective Footing - Aftg *



Ground Snow: 80 psf							
Net Soil		Transverse Girder and Pier Spacing (ft)					
Pres (psf)		4	5	6	7	8	10
1000	ext wall	2.0	2.0	2.0	2.0	2.0	2.0
	marriage	7.9	9.5	11.1	12.6	14.2	17.4
1500	ext wall	1.3	1.3	1.3	1.3	1.3	1.3
	marriage	5.3	6.3	7.4	8.4	9.5	11.6
2000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	4.0	4.7	5.5	6.3	7.1	8.7
2500	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	3.2	3.8	4.4	5.1	5.7	6.9
3000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.6	3.2	3.7	4.2	4.7	5.8
3500	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.3	2.7	3.2	3.6	4.1	5.0
4000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.0	2.4	2.8	3.2	3.6	4.3
Net Soil		Marriage Wall Opening Width (ft)					
Pres (psf)		10	12	14	16	18	20
1000	marriage	15.0	17.7	20.3	23.0	25.7	28.3
	marriage	10.0	11.8	13.6	15.3	17.1	18.9
2000	marriage	7.5	8.8	10.2	11.5	12.8	14.2
	marriage	6.0	7.1	8.1	9.2	10.3	11.3
3000	marriage	5.0	5.9	6.8	7.7	8.6	9.4
	marriage	4.3	5.1	5.8	6.6	7.3	8.1
4000	marriage	3.8	4.4	5.1	5.8	6.4	7.1

Ground Snow: 90 psf							
Net Soil		Transverse Girder and Pier Spacing (ft)					
Pres (psf)		4	5	6	7	8	10
1000	ext wall	2.0	2.0	2.0	2.0	2.0	2.0
	marriage	8.3	9.9	11.6	13.2	14.9	18.2
1500	ext wall	1.3	1.3	1.3	1.3	1.3	1.3
	marriage	5.5	6.6	7.7	8.8	9.9	12.1
2000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	4.1	5.0	5.8	6.6	7.4	9.1
2500	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	3.3	4.0	4.6	5.3	5.9	7.3
3000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.8	3.3	3.9	4.4	5.0	6.1
3500	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.4	2.8	3.3	3.8	4.2	5.2
4000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.1	2.5	2.9	3.3	3.7	4.5
Net Soil		Marriage Wall Opening Width (ft)					
Pres (psf)		10	12	14	16	18	20
1000	marriage	15.8	18.7	21.5	24.3	27.1	30.0
	marriage	10.5	12.4	14.3	16.2	18.1	20.0
2000	marriage	7.9	9.3	10.7	12.2	13.6	15.0
	marriage	6.3	7.5	8.6	9.7	10.9	12.0
3000	marriage	5.3	6.2	7.2	8.1	9.0	10.0
	marriage	4.5	5.3	6.1	6.9	7.8	8.6
4000	marriage	4.0	4.7	5.4	6.1	6.8	7.5

Ground Snow: 100 psf							
Net Soil		Transverse Girder and Pier Spacing (ft)					
Pres (psf)		4	5	6	7	8	10
1000	ext wall	2.1	2.1	2.1	2.1	2.1	2.0
	marriage	8.6	10.3	12.0	13.8	15.5	19.0
1500	ext wall	1.4	1.4	1.4	1.4	1.4	1.4
	marriage	5.7	6.9	8.0	9.2	10.3	12.7
2000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	4.3	5.2	6.0	6.9	7.8	9.5
2500	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	3.4	4.1	4.8	5.5	6.2	7.6
3000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.9	3.4	4.0	4.6	5.2	6.3
3500	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.5	2.9	3.4	3.9	4.4	5.4
4000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.1	2.6	3.0	3.4	3.9	4.7
Net Soil		Marriage Wall Opening Width (ft)					
Pres (psf)		10	12	14	16	18	20
1000	marriage	16.6	19.6	22.6	25.6	28.6	31.6
	marriage	11.1	13.1	15.1	17.1	19.1	21.1
2000	marriage	8.3	9.8	11.3	12.8	14.3	15.8
	marriage	6.7	7.9	9.1	10.2	11.4	12.6
3000	marriage	5.5	6.5	7.5	8.5	9.5	10.5
	marriage	4.8	5.6	6.5	7.3	8.2	9.0
4000	marriage	4.2	4.9	5.7	6.4	7.2	7.9

* Minimum interior pier area is 1.0 sqft.
The Exterior Footing Widths are shown in feet. The Marriage Wall Footing Areas are shown in square feet.

Aftg E7 14'	
	Multi-Section
	Width

Required Effective Footing - Aftg *

Min. Roof: 15 psf							
Net Soil Pres (psf)		Transverse Girder and Pier Spacing (ft)					
		4	5	6	7	8	10
1000	ext wall	1.8	1.8	1.8	1.8	1.8	1.8
	marriage	6.8	8.0	9.3	10.6	11.8	14.4
1500	ext wall	1.2	1.2	1.2	1.2	1.2	1.2
	marriage	4.5	5.3	6.2	7.0	7.9	9.6
2000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	3.4	4.0	4.6	5.3	5.9	7.2
2500	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.7	3.2	3.7	4.2	4.7	5.7
3000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.3	2.7	3.1	3.5	3.9	4.8
3500	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	1.9	2.3	2.7	3.0	3.4	4.1
4000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	1.7	2.0	2.3	2.6	3.0	3.6

Net Soil Pres (psf)							Marriage Wall Opening Width (ft)				
		10	12	14	16	18	20				
1000	marriage	11.7	13.7	15.6	17.6	19.6	21.6				
1500	marriage	7.8	9.1	10.4	11.8	13.1	14.4				
2000	marriage	5.8	6.8	7.8	8.8	9.8	10.8				
2500	marriage	4.7	5.5	6.3	7.1	7.9	8.6				
3000	marriage	3.9	4.6	5.2	5.9	6.5	7.2				
3500	marriage	3.3	3.9	4.5	5.0	5.6	6.2				
4000	marriage	2.9	3.4	3.9	4.4	4.9	5.4				

Ground Snow: 25 psf							
Net Soil Pres (psf)		Transverse Girder and Pier Spacing (ft)					
		4	5	6	7	8	10
1000	ext wall	1.9	1.8	1.8	1.8	1.8	1.8
	marriage	6.9	8.2	9.5	10.8	12.1	14.7
1500	ext wall	1.2	1.2	1.2	1.2	1.2	1.2
	marriage	4.6	5.5	6.3	7.2	8.1	9.8
2000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	3.4	4.1	4.7	5.4	6.1	7.4
2500	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.8	3.3	3.8	4.3	4.8	5.9
3000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.3	2.7	3.2	3.6	4.0	4.9
3500	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.0	2.3	2.7	3.1	3.5	4.2
4000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	1.7	2.0	2.4	2.7	3.0	3.7

Net Soil Pres (psf)							Marriage Wall Opening Width (ft)				
		10	12	14	16	18	20				
1000	marriage	12.0	14.1	16.1	18.2	20.2	22.3				
1500	marriage	8.0	9.4	10.8	12.1	13.5	14.9				
2000	marriage	6.0	7.0	8.1	9.1	10.1	11.2				
2500	marriage	4.8	5.6	6.5	7.3	8.1	8.9				
3000	marriage	4.0	4.7	5.4	6.1	6.7	7.4				
3500	marriage	3.4	4.0	4.6	5.2	5.8	6.4				
4000	marriage	3.0	3.5	4.0	4.5	5.1	5.6				

Ground Snow: 30 psf & Min. Roof: 20 psf							
Net Soil Pres (psf)		Transverse Girder and Pier Spacing (ft)					
		4	5	6	7	8	10
1000	ext wall	1.9	1.9	1.9	1.9	1.9	1.9
	marriage	7.1	8.4	9.8	11.1	12.5	15.2
1500	ext wall	1.3	1.2	1.2	1.2	1.2	1.2
	marriage	4.7	5.6	6.5	7.4	8.3	10.1
2000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	3.5	4.2	4.9	5.6	6.2	7.6
2500	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.8	3.4	3.9	4.5	5.0	6.1
3000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.4	2.8	3.3	3.7	4.2	5.1
3500	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.0	2.4	2.8	3.2	3.6	4.3
4000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	1.8	2.1	2.4	2.8	3.1	3.8

Net Soil Pres (psf)							Marriage Wall Opening Width (ft)				
		10	12	14	16	18	20				
1000	marriage	12.5	14.6	16.8	19.0	21.1	23.3				
1500	marriage	8.3	9.8	11.2	12.6	14.1	15.5				
2000	marriage	6.2	7.3	8.4	9.5	10.6	11.6				
2500	marriage	5.0	5.9	6.7	7.6	8.4	9.3				
3000	marriage	4.2	4.9	5.6	6.3	7.0	7.8				
3500	marriage	3.6	4.2	4.8	5.4	6.0	6.6				
4000	marriage	3.1	3.7	4.2	4.7	5.3	5.8				

Ground Snow: 40 psf							
Net Soil Pres (psf)		Transverse Girder and Pier Spacing (ft)					
		4	5	6	7	8	10
1000	ext wall	1.9	1.9	1.9	1.9	1.9	1.9
	marriage	7.5	8.9	10.4	11.8	13.3	16.1
1500	ext wall	1.3	1.3	1.3	1.3	1.3	1.3
	marriage	5.0	5.9	6.9	7.9	8.8	10.8
2000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	3.7	4.5	5.2	5.9	6.6	8.1
2500	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	3.0	3.6	4.1	4.7	5.3	6.5
3000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.5	3.0	3.5	3.9	4.4	5.4
3500	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.1	2.5	3.0	3.4	3.8	4.6
4000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	1.9	2.2	2.6	3.0	3.3	4.0

Net Soil Pres (psf)							Marriage Wall Opening Width (ft)				
		10	12	14	16	18	20				
1000	marriage	13.4	15.8	18.1	20.5	22.8	25.2				
1500	marriage	9.0	10.5	12.1	13.7	15.2	16.8				
2000	marriage	6.7	7.9	9.1	10.2	11.4	12.6				
2500	marriage	5.4	6.3	7.3	8.2	9.1	10.1				
3000	marriage	4.5	5.3	6.0	6.8	7.6	8.4				
3500	marriage	3.8	4.5	5.2	5.9	6.5	7.2				
4000	marriage	3.4	3.9	4.5	5.1	5.7	6.3				

* Minimum interior pier area is 1.0 sqft.
The Exterior Footing Widths are shown in feet. The Marriage Wall Footing Areas are shown in square feet.

Required Effective Footing - Aftg *

 Multi-Section Width	Aftg E7 14'
--	--

Ground Snow: 50 psf							
Net Soil Pres (psf)		Transverse Girder and Pier Spacing (ft)					
		4	5	6	7	8	10
1000	ext wall	2.0	2.0	2.0	2.0	2.0	2.0
	marriage	7.8	9.4	10.9	12.5	14.0	17.1
1500	ext wall	1.3	1.3	1.3	1.3	1.3	1.3
	marriage	5.2	6.3	7.3	8.3	9.3	11.4
2000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	3.9	4.7	5.5	6.2	7.0	8.6
2500	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	3.1	3.8	4.4	5.0	5.6	6.8
3000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.6	3.1	3.6	4.2	4.7	5.7
3500	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.2	2.7	3.1	3.6	4.0	4.9
4000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.0	2.3	2.7	3.1	3.5	4.3
Net Soil Pres (psf)		Marriage Wall Opening Width (ft)					
		10	12	14	16	18	20
1000	marriage	14.4	16.9	19.5	22.0	24.5	27.1
	marriage	9.6	11.3	13.0	14.7	16.4	18.1
1500	marriage	7.2	8.5	9.7	11.0	12.3	13.5
	marriage	5.8	6.8	7.8	8.8	9.8	10.8
2000	marriage	4.8	5.6	6.5	7.3	8.2	9.0
	marriage	4.1	4.8	5.6	6.3	7.0	7.7
2500	marriage	3.6	4.2	4.9	5.5	6.1	6.8

Ground Snow: 70 psf							
Net Soil Pres (psf)		Transverse Girder and Pier Spacing (ft)					
		4	5	6	7	8	10
1000	ext wall	2.1	2.1	2.1	2.1	2.1	2.0
	marriage	8.6	10.3	12.1	13.8	15.5	19.0
1500	ext wall	1.4	1.4	1.4	1.4	1.4	1.4
	marriage	5.7	6.9	8.1	9.2	10.4	12.7
2000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	4.3	5.2	6.0	6.9	7.8	9.5
2500	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	3.4	4.1	4.8	5.5	6.2	7.6
3000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.9	3.4	4.0	4.6	5.2	6.3
3500	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.5	3.0	3.5	3.9	4.4	5.4
4000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.2	2.6	3.0	3.5	3.9	4.8
Net Soil Pres (psf)		Marriage Wall Opening Width (ft)					
		10	12	14	16	18	20
1000	marriage	16.3	19.2	22.2	25.1	28.0	30.9
	marriage	10.9	12.8	14.8	16.7	18.7	20.6
1500	marriage	8.2	9.6	11.1	12.5	14.0	15.5
	marriage	6.5	7.7	8.9	10.0	11.2	12.4
2000	marriage	5.4	6.4	7.4	8.4	9.3	10.3
	marriage	4.7	5.5	6.3	7.2	8.0	8.8
2500	marriage	4.1	4.8	5.5	6.3	7.0	7.7

Ground Snow: 60 psf							
Net Soil Pres (psf)		Transverse Girder and Pier Spacing (ft)					
		4	5	6	7	8	10
1000	ext wall	2.0	2.0	2.0	2.0	2.0	2.0
	marriage	8.2	9.9	11.5	13.1	14.8	18.1
1500	ext wall	1.3	1.3	1.3	1.3	1.3	1.3
	marriage	5.5	6.6	7.7	8.8	9.9	12.0
2000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	4.1	4.9	5.8	6.6	7.4	9.0
2500	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	3.3	3.9	4.6	5.3	5.9	7.2
3000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.7	3.3	3.8	4.4	4.9	6.0
3500	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.4	2.8	3.3	3.8	4.2	5.2
4000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.1	2.5	2.9	3.3	3.7	4.5
Net Soil Pres (psf)		Marriage Wall Opening Width (ft)					
		10	12	14	16	18	20
1000	marriage	15.4	18.1	20.8	23.5	26.3	29.0
	marriage	10.2	12.1	13.9	15.7	17.5	19.3
1500	marriage	7.7	9.0	10.4	11.8	13.1	14.5
	marriage	6.1	7.2	8.3	9.4	10.5	11.6
2000	marriage	5.1	6.0	6.9	7.8	8.8	9.7
	marriage	4.4	5.2	5.9	6.7	7.5	8.3
2500	marriage	3.8	4.5	5.2	5.9	6.6	7.3

Ground Snow: 80 psf							
Net Soil Pres (psf)		Transverse Girder and Pier Spacing (ft)					
		4	5	6	7	8	10
1000	ext wall	2.1	2.1	2.1	2.1	2.1	2.1
	marriage	9.0	10.8	12.7	14.5	16.3	20.0
1500	ext wall	1.4	1.4	1.4	1.4	1.4	1.4
	marriage	6.0	7.2	8.4	9.7	10.9	13.3
2000	ext wall	1.1	1.1	1.1	1.1	1.0	1.0
	marriage	4.5	5.4	6.3	7.2	8.2	10.0
2500	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	3.6	4.3	5.1	5.8	6.5	8.0
3000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	3.0	3.6	4.2	4.8	5.4	6.7
3500	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.6	3.1	3.6	4.1	4.7	5.7
4000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.2	2.7	3.2	3.6	4.1	5.0
Net Soil Pres (psf)		Marriage Wall Opening Width (ft)					
		10	12	14	16	18	20
1000	marriage	17.3	20.4	23.5	26.6	29.7	32.8
	marriage	11.5	13.6	15.7	17.7	19.8	21.9
1500	marriage	8.6	10.2	11.7	13.3	14.9	16.4
	marriage	6.9	8.2	9.4	10.6	11.9	13.1
2000	marriage	5.8	6.8	7.8	8.9	9.9	10.9
	marriage	4.9	5.8	6.7	7.6	8.5	9.4
2500	marriage	4.3	5.1	5.9	6.7	7.4	8.2

* Minimum interior pier area is 1.0 sqft.

The Exterior Footing Widths are shown in feet. The Marriage Wall Footing Areas are shown in square feet.

Aftg E7 14'	 Multi-Section Width
----------------------------	---

Required Effective Footing - Aftg *

		Ground Snow: 90 psf					
Net Soil Pres (psf)		Transverse Girder and Pier Spacing (ft)					
		4	5	6	7	8	10
1000	ext wall	2.2	2.2	2.2	2.2	2.1	2.1
	marriage	9.4	11.3	13.2	15.2	17.1	20.9
1500	ext wall	1.4	1.4	1.4	1.4	1.4	1.4
	marriage	6.3	7.5	8.8	10.1	11.4	14.0
2000	ext wall	1.1	1.1	1.1	1.1	1.1	1.1
	marriage	4.7	5.7	6.6	7.6	8.5	10.5
2500	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	3.8	4.5	5.3	6.1	6.8	8.4
3000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	3.1	3.8	4.4	5.1	5.7	7.0
3500	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.7	3.2	3.8	4.3	4.9	6.0
4000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.3	2.8	3.3	3.8	4.3	5.2
Net Soil Pres (psf)		Marriage Wall Opening Width (ft)					
		10	12	14	16	18	20
1000	marriage	18.2	21.5	24.8	28.1	31.4	34.7
1500	marriage	12.2	14.4	16.6	18.8	21.0	23.2
2000	marriage	9.1	10.8	12.4	14.1	15.7	17.4
2500	marriage	7.3	8.6	9.9	11.3	12.6	13.9
3000	marriage	6.1	7.2	8.3	9.4	10.5	11.6
3500	marriage	5.2	6.2	7.1	8.0	9.0	9.9
4000	marriage	4.6	5.4	6.2	7.0	7.9	8.7

		Ground Snow: 100 psf					
Net Soil Pres (psf)		Transverse Girder and Pier Spacing (ft)					
		4	5	6	7	8	10
1000	ext wall	2.2	2.2	2.2	2.2	2.2	2.2
	marriage	9.8	11.8	13.8	15.8	17.8	21.9
1500	ext wall	1.5	1.5	1.5	1.5	1.5	1.5
	marriage	6.5	7.9	9.2	10.5	11.9	14.6
2000	ext wall	1.1	1.1	1.1	1.1	1.1	1.1
	marriage	4.9	5.9	6.9	7.9	8.9	10.9
2500	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	3.9	4.7	5.5	6.3	7.1	8.8
3000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	3.3	3.9	4.6	5.3	5.9	7.3
3500	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.8	3.4	3.9	4.5	5.1	6.3
4000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.4	2.9	3.5	4.0	4.5	5.5
Net Soil Pres (psf)		Marriage Wall Opening Width (ft)					
		10	12	14	16	18	20
1000	marriage	19.2	22.7	26.2	29.7	33.2	36.7
1500	marriage	12.8	15.1	17.4	19.8	22.1	24.4
2000	marriage	9.6	11.3	13.1	14.8	16.6	18.3
2500	marriage	7.7	9.1	10.5	11.9	13.3	14.7
3000	marriage	6.4	7.6	8.7	9.9	11.1	12.2
3500	marriage	5.5	6.5	7.5	8.5	9.5	10.5
4000	marriage	4.8	5.7	6.5	7.4	8.3	9.2

* Minimum interior pier area is 1.0 sqft.

The Exterior Footing Widths are shown in feet. The Marriage Wall Footing Areas are shown in square feet.

Required Effective Footing - Aftg *



Min. Roof: 15 psf							
Net Soil		Transverse Girder and Pier Spacing (ft)					
Pres (psf)		4	5	6	7	8	10
1000	ext wall	1.9	1.9	1.9	1.9	1.9	1.9
	marriage	7.4	8.9	10.3	11.7	13.2	16.0
1500	ext wall	1.3	1.3	1.3	1.3	1.3	1.3
	marriage	5.0	5.9	6.9	7.8	8.8	10.7
2000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	3.7	4.4	5.1	5.9	6.6	8.0
2500	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	3.0	3.5	4.1	4.7	5.3	6.4
3000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.5	3.0	3.4	3.9	4.4	5.3
3500	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.1	2.5	2.9	3.3	3.8	4.6
4000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	1.9	2.2	2.6	2.9	3.3	4.0
Net Soil		Marriage Wall Opening Width (ft)					
Pres (psf)		10	12	14	16	18	20
1000	marriage	13.0	15.2	17.5	19.7	22.0	24.2
	marriage	8.7	10.2	11.7	13.2	14.7	16.2
1500	marriage	6.5	7.6	8.7	9.9	11.0	12.1
	marriage	5.2	6.1	7.0	7.9	8.8	9.7
2000	marriage	4.3	5.1	5.8	6.6	7.3	8.1
	marriage	3.7	4.4	5.0	5.6	6.3	6.9
2500	marriage	3.2	3.8	4.4	4.9	5.5	6.1

Ground Snow: 25 psf							
Net Soil		Transverse Girder and Pier Spacing (ft)					
Pres (psf)		4	5	6	7	8	10
1000	ext wall	1.9	1.9	1.9	1.9	1.9	1.9
	marriage	7.6	9.1	10.5	12.0	13.5	16.4
1500	ext wall	1.3	1.3	1.3	1.3	1.3	1.3
	marriage	5.1	6.0	7.0	8.0	9.0	10.9
2000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	3.8	4.5	5.3	6.0	6.7	8.2
2500	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	3.0	3.6	4.2	4.8	5.4	6.6
3000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.5	3.0	3.5	4.0	4.5	5.5
3500	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.2	2.6	3.0	3.4	3.8	4.7
4000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	1.9	2.3	2.6	3.0	3.4	4.1
Net Soil		Marriage Wall Opening Width (ft)					
Pres (psf)		10	12	14	16	18	20
1000	marriage	13.4	15.7	18.0	20.3	22.7	25.0
	marriage	8.9	10.5	12.0	13.6	15.1	16.7
1500	marriage	6.7	7.8	9.0	10.2	11.3	12.5
	marriage	5.3	6.3	7.2	8.1	9.1	10.0
2000	marriage	4.5	5.2	6.0	6.8	7.6	8.3
	marriage	3.8	4.5	5.1	5.8	6.5	7.1
2500	marriage	3.3	3.9	4.5	5.1	5.7	6.3

Ground Snow: 30 psf & Min. Roof: 20 psf							
Net Soil		Transverse Girder and Pier Spacing (ft)					
Pres (psf)		4	5	6	7	8	10
1000	ext wall	2.0	2.0	2.0	2.0	1.9	1.9
	marriage	7.8	9.3	10.9	12.4	13.9	16.9
1500	ext wall	1.3	1.3	1.3	1.3	1.3	1.3
	marriage	5.2	6.2	7.2	8.2	9.3	11.3
2000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	3.9	4.7	5.4	6.2	6.9	8.5
2500	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	3.1	3.7	4.3	4.9	5.6	6.8
3000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.6	3.1	3.6	4.1	4.6	5.6
3500	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.2	2.7	3.1	3.5	4.0	4.8
4000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.0	2.3	2.7	3.1	3.5	4.2
Net Soil		Marriage Wall Opening Width (ft)					
Pres (psf)		10	12	14	16	18	20
1000	marriage	13.9	16.3	18.8	21.2	23.7	26.1
	marriage	9.3	10.9	12.5	14.1	15.8	17.4
1500	marriage	7.0	8.2	9.4	10.6	11.8	13.0
	marriage	5.6	6.5	7.5	8.5	9.5	10.4
2000	marriage	4.6	5.4	6.3	7.1	7.9	8.7
	marriage	4.0	4.7	5.4	6.1	6.8	7.5
2500	marriage	3.5	4.1	4.7	5.3	5.9	6.5

Ground Snow: 40 psf							
Net Soil		Transverse Girder and Pier Spacing (ft)					
Pres (psf)		4	5	6	7	8	10
1000	ext wall	2.0	2.0	2.0	2.0	2.0	2.0
	marriage	8.2	9.9	11.5	13.1	14.8	18.0
1500	ext wall	1.3	1.3	1.3	1.3	1.3	1.3
	marriage	5.5	6.6	7.7	8.8	9.8	12.0
2000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	4.1	4.9	5.8	6.6	7.4	9.0
2500	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	3.3	3.9	4.6	5.3	5.9	7.2
3000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.7	3.3	3.8	4.4	4.9	6.0
3500	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.4	2.8	3.3	3.8	4.2	5.2
4000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.1	2.5	2.9	3.3	3.7	4.5
Net Soil		Marriage Wall Opening Width (ft)					
Pres (psf)		10	12	14	16	18	20
1000	marriage	15.0	17.7	20.3	23.0	25.6	28.3
	marriage	10.0	11.8	13.5	15.3	17.1	18.8
1500	marriage	7.5	8.8	10.2	11.5	12.8	14.1
	marriage	6.0	7.1	8.1	9.2	10.2	11.3
2000	marriage	5.0	5.9	6.8	7.7	8.5	9.4
	marriage	4.3	5.0	5.8	6.6	7.3	8.1
2500	marriage	3.8	4.4	5.1	5.7	6.4	7.1

* Minimum interior pier area is 1.0 sqft.
The Exterior Footing Widths are shown in feet. The Marriage Wall Footing Areas are shown in square feet.

**Aftg
E7
16'**



**Multi-Section
Width**

Required Effective Footing - Aftg *

Ground Snow: 50 psf							
Net Soil Pres (psf)		Transverse Girder and Pier Spacing (ft)					
		4	5	6	7	8	10
1000	ext wall	2.1	2.1	2.1	2.1	2.1	2.1
	marriage	8.7	10.4	12.2	13.9	15.6	19.1
1500	ext wall	1.4	1.4	1.4	1.4	1.4	1.4
	marriage	5.8	6.9	8.1	9.3	10.4	12.7
2000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	4.3	5.2	6.1	6.9	7.8	9.6
2500	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	3.5	4.2	4.9	5.6	6.3	7.6
3000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.9	3.5	4.1	4.6	5.2	6.4
3500	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.5	3.0	3.5	4.0	4.5	5.5
4000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.2	2.6	3.0	3.5	3.9	4.8

Net Soil Pres (psf)		Marriage Wall Opening Width (ft)					
		10	12	14	16	18	20
1000	marriage	16.1	19.0	21.8	24.7	27.6	30.4
1500	marriage	10.7	12.6	14.5	16.5	18.4	20.3
2000	marriage	8.0	9.5	10.9	12.3	13.8	15.2
2500	marriage	6.4	7.6	8.7	9.9	11.0	12.2
3000	marriage	5.4	6.3	7.3	8.2	9.2	10.1
3500	marriage	4.6	5.4	6.2	7.1	7.9	8.7
4000	marriage	4.0	4.7	5.5	6.2	6.9	7.6

Ground Snow: 60 psf							
Net Soil Pres (psf)		Transverse Girder and Pier Spacing (ft)					
		4	5	6	7	8	10
1000	ext wall	2.1	2.1	2.1	2.1	2.1	2.1
	marriage	9.1	11.0	12.8	14.7	16.5	20.2
1500	ext wall	1.4	1.4	1.4	1.4	1.4	1.4
	marriage	6.1	7.3	8.5	9.8	11.0	13.5
2000	ext wall	1.1	1.1	1.1	1.1	1.1	1.1
	marriage	4.6	5.5	6.4	7.3	8.3	10.1
2500	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	3.6	4.4	5.1	5.9	6.6	8.1
3000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	3.0	3.7	4.3	4.9	5.5	6.7
3500	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.6	3.1	3.7	4.2	4.7	5.8
4000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.3	2.7	3.2	3.7	4.1	5.0

Net Soil Pres (psf)		Marriage Wall Opening Width (ft)					
		10	12	14	16	18	20
1000	marriage	17.2	20.3	23.3	26.4	29.5	32.6
1500	marriage	11.4	13.5	15.6	17.6	19.7	21.7
2000	marriage	8.6	10.1	11.7	13.2	14.8	16.3
2500	marriage	6.9	8.1	9.3	10.6	11.8	13.0
3000	marriage	5.7	6.8	7.8	8.8	9.8	10.9
3500	marriage	4.9	5.8	6.7	7.6	8.4	9.3
4000	marriage	4.3	5.1	5.8	6.6	7.4	8.1

Ground Snow: 70 psf							
Net Soil Pres (psf)		Transverse Girder and Pier Spacing (ft)					
		4	5	6	7	8	10
1000	ext wall	2.2	2.2	2.2	2.2	2.2	2.2
	marriage	9.5	11.5	13.5	15.4	17.4	21.3
1500	ext wall	1.5	1.5	1.4	1.4	1.4	1.4
	marriage	6.4	7.7	9.0	10.3	11.6	14.2
2000	ext wall	1.1	1.1	1.1	1.1	1.1	1.1
	marriage	4.8	5.7	6.7	7.7	8.7	10.6
2500	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	3.8	4.6	5.4	6.2	6.9	8.5
3000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	3.2	3.8	4.5	5.1	5.8	7.1
3500	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.7	3.3	3.8	4.4	5.0	6.1
4000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.4	2.9	3.4	3.9	4.3	5.3

Net Soil Pres (psf)		Marriage Wall Opening Width (ft)					
		10	12	14	16	18	20
1000	marriage	18.3	21.6	24.9	28.2	31.5	34.8
1500	marriage	12.2	14.4	16.6	18.8	21.0	23.2
2000	marriage	9.1	10.8	12.4	14.1	15.7	17.4
2500	marriage	7.3	8.6	9.9	11.3	12.6	13.9
3000	marriage	6.1	7.2	8.3	9.4	10.5	11.6
3500	marriage	5.2	6.2	7.1	8.0	9.0	9.9
4000	marriage	4.6	5.4	6.2	7.0	7.9	8.7

Ground Snow: 80 psf							
Net Soil Pres (psf)		Transverse Girder and Pier Spacing (ft)					
		4	5	6	7	8	10
1000	ext wall	2.2	2.2	2.2	2.2	2.2	2.2
	marriage	10.0	12.0	14.1	16.2	18.2	22.4
1500	ext wall	1.5	1.5	1.5	1.5	1.5	1.5
	marriage	6.7	8.0	9.4	10.8	12.2	14.9
2000	ext wall	1.1	1.1	1.1	1.1	1.1	1.1
	marriage	5.0	6.0	7.1	8.1	9.1	11.2
2500	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	4.0	4.8	5.6	6.5	7.3	8.9
3000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	3.3	4.0	4.7	5.4	6.1	7.5
3500	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.9	3.4	4.0	4.6	5.2	6.4
4000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.5	3.0	3.5	4.0	4.6	5.6

Net Soil Pres (psf)		Marriage Wall Opening Width (ft)					
		10	12	14	16	18	20
1000	marriage	19.3	22.9	26.4	29.9	33.4	36.9
1500	marriage	12.9	15.2	17.6	19.9	22.3	24.6
2000	marriage	9.7	11.4	13.2	14.9	16.7	18.5
2500	marriage	7.7	9.1	10.6	12.0	13.4	14.8
3000	marriage	6.4	7.6	8.8	10.0	11.1	12.3
3500	marriage	5.5	6.5	7.5	8.5	9.5	10.6
4000	marriage	4.8	5.7	6.6	7.5	8.4	9.2

* Minimum interior pier area is 1.0 sqft.
The Exterior Footing Widths are shown in feet. The Marriage Wall Footing Areas are shown in square feet.

Required Effective Footing - Aftg *



Aftg
E7
16'

Ground Snow: 90 psf							
Net Soil		Transverse Girder and Pier Spacing (ft)					
Pres (psf)		4	5	6	7	8	10
1000	ext wall	2.3	2.3	2.3	2.3	2.3	2.3
	marriage	10.4	12.6	14.8	16.9	19.1	23.5
1500	ext wall	1.5	1.5	1.5	1.5	1.5	1.5
	marriage	6.9	8.4	9.8	11.3	12.7	15.6
2000	ext wall	1.1	1.1	1.1	1.1	1.1	1.1
	marriage	5.2	6.3	7.4	8.5	9.6	11.7
2500	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	4.2	5.0	5.9	6.8	7.6	9.4
3000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	3.5	4.2	4.9	5.6	6.4	7.8
3500	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	3.0	3.6	4.2	4.8	5.5	6.7
4000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.6	3.1	3.7	4.2	4.8	5.9
Net Soil		Marriage Wall Opening Width (ft)					
Pres (psf)		10	12	14	16	18	20
1000	marriage	20.4	24.2	27.9	31.6	35.4	39.1
	marriage	13.6	16.1	18.6	21.1	23.6	26.1
1500	marriage	10.2	12.1	13.9	15.8	17.7	19.6
	marriage	8.2	9.7	11.2	12.7	14.1	15.6
2000	marriage	6.8	8.1	9.3	10.5	11.8	13.0
	marriage	5.8	6.9	8.0	9.0	10.1	11.2
2500	marriage	5.1	6.0	7.0	7.9	8.8	9.8
	marriage	4.1	4.9	5.8	6.7	7.6	8.5

Ground Snow: 100 psf							
Net Soil		Transverse Girder and Pier Spacing (ft)					
Pres (psf)		4	5	6	7	8	10
1000	ext wall	2.3	2.3	2.3	2.3	2.3	2.3
	marriage	10.8	13.1	15.4	17.7	20.0	24.5
1500	ext wall	1.6	1.6	1.6	1.6	1.6	1.5
	marriage	7.2	8.8	10.3	11.8	13.3	16.4
2000	ext wall	1.2	1.2	1.2	1.2	1.2	1.2
	marriage	5.4	6.6	7.7	8.8	10.0	12.3
2500	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	4.3	5.3	6.2	7.1	8.0	9.8
3000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	3.6	4.4	5.1	5.9	6.7	8.2
3500	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	3.1	3.8	4.4	5.1	5.7	7.0
4000	ext wall	1.0	1.0	1.0	1.0	1.0	1.0
	marriage	2.7	3.3	3.9	4.4	5.0	6.1
Net Soil		Marriage Wall Opening Width (ft)					
Pres (psf)		10	12	14	16	18	20
1000	marriage	21.5	25.5	29.4	33.4	37.3	41.3
	marriage	14.3	17.0	19.6	22.2	24.9	27.5
1500	marriage	10.8	12.7	14.7	16.7	18.7	20.6
	marriage	8.6	10.2	11.8	13.3	14.9	16.5
2000	marriage	7.2	8.5	9.8	11.1	12.4	13.8
	marriage	6.1	7.3	8.4	9.5	10.7	11.8
2500	marriage	5.4	6.4	7.4	8.3	9.3	10.3
	marriage	4.4	5.3	6.2	7.1	8.0	9.0


* Minimum interior pier area is 1.0 sqft.

The Exterior Footing Widths are shown in feet. The Marriage Wall Footing Areas are shown in square feet.

Part 2 Required Vertical Anchorage - Av

Single-Section C

Av C 12'	 Single-Section Width
-------------------------------------	---



Required Vertical Anchorage - Av (lbs)

		Wind Speed (mph)	Pier Spacing (ft)				
			4	5	6	7	8
Inland	80	970	1210	1450	1700	1940	2420
	90	1360	1710	2050	2390	2730	3410
	100	1810	2260	2710	3160	3610	4510
	110	2290	2870	3440	4010	4580	5730
Coastal	80	1120	1400	1680	1960	2240	2810
	90	1560	1950	2340	2720	3110	3890
	100	2040	2550	3060	3580	4090	5110
	110	2580	3220	3870	4510	5160	6450

Av C 14'	 Single-Section Width
-------------------------------------	---

Required Vertical Anchorage - Av (lbs)

		Wind Speed (mph)	Pier Spacing (ft)				
			4	5	6	7	8
Inland	80	960	1200	1450	1690	1930	2410
	90	1370	1710	2060	2400	2740	3430
	100	1830	2280	2740	3200	3660	4570
	110	2330	2910	3500	4080	4660	5830
Coastal	80	1120	1400	1680	1960	2240	2800
	90	1570	1960	2360	2750	3140	3930
	100	2070	2590	3110	3630	4150	5180
	110	2630	3290	3940	4600	5260	6570

Av C 16'	 Single-Section Width
-------------------------------------	---

Required Vertical Anchorage - Av (lbs)


		Wind Speed (mph)	Pier Spacing (ft)				
			4	5	6	7	8
Inland	80	900	1130	1360	1580	1810	2260
	90	1310	1640	1960	2290	2620	3270
	100	1760	2210	2650	3090	3530	4410
	110	2270	2830	3400	3970	4530	5670
Coastal	80	1060	1330	1590	1860	2120	2650
	90	1510	1890	2260	2640	3020	3770
	100	2010	2510	3010	3520	4020	5020
	110	2560	3200	3840	4480	5130	6410

Single-Section C1

Required Vertical Anchorage - Av (lbs)


	Wind Speed (mph)	lbs/ft	Anchor Spacing (ft)					
			4	5	6	7	8	10
Inland	80	170	680	850	1020	1190	1360	1700
	90	240	960	1190	1430	1670	1910	2390
	100	320	1260	1580	1900	2210	2530	3160
	110	400	1610	2010	2410	2810	3210	4020
Coastal	80	200	790	980	1180	1380	1570	1970
	90	270	1090	1360	1640	1910	2180	2730
	100	360	1430	1790	2150	2510	2860	3580
	110	450	1810	2260	2710	3160	3620	4520

 Single-Section Width	Av C1 12'
---	--------------------------------------



Required Vertical Anchorage - Av (lbs)

	Wind Speed (mph)	lbs/ft	Anchor Spacing (ft)					
			4	5	6	7	8	10
Inland	80	160	640	800	960	1120	1280	1610
	90	230	910	1140	1370	1600	1830	2290
	100	300	1220	1520	1830	2130	2440	3050
	110	390	1550	1940	2330	2720	3110	3890
Coastal	80	190	750	930	1120	1310	1490	1870
	90	260	1050	1310	1570	1830	2090	2620
	100	350	1380	1730	2070	2420	2760	3460
	110	440	1750	2190	2630	3070	3510	4380

 Single-Section Width	Av C1 14'
---	--------------------------------------


Required Vertical Anchorage - Av (lbs)

	Wind Speed (mph)	lbs/ft	Anchor Spacing (ft)					
			4	5	6	7	8	10
Inland	80	150	610	770	920	1070	1230	1530
	90	220	890	1110	1330	1560	1780	2220
	100	300	1200	1500	1800	2090	2390	2990
	110	380	1540	1920	2310	2690	3080	3840
Coastal	80	180	720	900	1080	1260	1440	1800
	90	260	1020	1280	1540	1790	2050	2560
	100	340	1360	1700	2040	2390	2730	3410
	110	430	1740	2170	2610	3040	3480	4350

 Single-Section Width	Av C1 16'
---	--------------------------------------

Single-Section E

Av	
E	Single-Section
12'	Width



Required Vertical Anchorage - Av (lbs/ft)

	Wind Speed (mph)	lbs/ft
Inland	80	120
	90	190
	100	260
	110	340
Coastal	80	150
	90	220
	100	300
	110	390

Av	
E	Single-Section
14'	Width

Required Vertical Anchorage - Av (lbs/ft)

	Wind Speed (mph)	lbs/ft
Inland	80	120
	90	190
	100	270
	110	350
Coastal	80	150
	90	220
	100	310
	110	410

Av	
E	Single-Section
16'	Width

Required Vertical Anchorage - Av (lbs/ft)


	Wind Speed (mph)	lbs/ft
Inland	80	120
	90	200
	100	280
	110	370
Coastal	80	150
	90	230
	100	320
	110	420

Single-Section E3

Required Vertical Anchorage - Av (lbs)


	Wind Speed (mph)	Exterior (lbs/ft)	Interior Pier Spacing (ft)					
			4	5	6	7	8	10
Inland	80	80	230	290	350	410	470	590
	90	120	360	450	540	630	730	910
	100	160	510	630	760	890	1010	1270
	110	220	660	830	1000	1160	1330	1660
Coastal	80	90	280	350	430	500	570	710
	90	140	430	530	640	740	850	1060
	100	190	580	730	880	1020	1170	1460
	110	250	760	950	1140	1330	1520	1900

 Single-Section Width	Av E3 12'
---	------------------------




Required Vertical Anchorage - Av (lbs)

	Wind Speed (mph)	Exterior (lbs/ft)	Interior Pier Spacing (ft)					
			4	5	6	7	8	10
Inland	80	80	230	290	350	400	460	580
	90	120	360	460	550	640	730	910
	100	170	510	640	770	900	1030	1290
	110	230	680	850	1020	1190	1360	1700
Coastal	80	90	280	350	420	490	560	710
	90	140	430	540	650	750	860	1080
	100	200	600	740	890	1040	1190	1490
	110	260	780	970	1170	1360	1560	1950

 Single-Section Width	Av E3 14'
---	------------------------


Required Vertical Anchorage - Av (lbs)

	Wind Speed (mph)	Exterior (lbs/ft)	Interior Pier Spacing (ft)					
			4	5	6	7	8	10
Inland	80	80	230	290	350	410	470	590
	90	120	380	470	570	660	750	940
	100	180	540	670	810	940	1070	1340
	110	240	710	890	1070	1250	1430	1780
Coastal	80	100	290	360	430	510	580	720
	90	150	450	560	670	780	890	1120
	100	210	620	780	930	1090	1250	1560
	110	270	820	1020	1220	1430	1630	2040

 Single-Section Width	Av E3 16'
---	------------------------

Single-Section I

Av I 12'	 Single-Section Width
-------------------------	--



Required Vertical Anchorage - Av (lbs)

		Wind Speed (mph)	Pier Spacing (ft)				
			4	5	6	7	8
Inland	80	630	790	950	1100	1260	1580
	90	980	1220	1460	1710	1950	2440
	100	1360	1700	2040	2380	2720	3400
	110	1790	2230	2680	3130	3570	4470
Coastal	80	760	950	1140	1340	1530	1910
	90	1140	1430	1720	2000	2290	2860
	100	1570	1960	2350	2740	3140	3920
	110	2040	2550	3060	3570	4080	5100

Av I 14'	 Single-Section Width
-------------------------	--

Required Vertical Anchorage - Av (lbs)

		Wind Speed (mph)	Pier Spacing (ft)				
			4	5	6	7	8
Inland	80	640	800	960	1120	1280	1600
	90	1010	1270	1520	1770	2030	2530
	100	1430	1790	2150	2500	2860	3580
	110	1890	2360	2840	3310	3780	4730
Coastal	80	780	980	1180	1370	1570	1960
	90	1200	1490	1790	2090	2390	2990
	100	1660	2070	2480	2900	3310	4140
	110	2160	2700	3240	3790	4330	5410

Av I 16'	 Single-Section Width
-------------------------	--


Required Vertical Anchorage - Av (lbs)


		Wind Speed (mph)	Pier Spacing (ft)				
			4	5	6	7	8
Inland	80	650	810	970	1130	1290	1610
	90	1040	1300	1550	1810	2070	2590
	100	1470	1840	2210	2580	2950	3680
	110	1960	2450	2940	3430	3910	4890
Coastal	80	800	1000	1190	1390	1590	1990
	90	1230	1530	1840	2150	2460	3070
	100	1710	2140	2560	2990	3420	4270
	110	2240	2800	3360	3920	4490	5610

Multi-Section C

Required Vertical Anchorage - Av (lbs)


	Wind Speed (mph)	Pier Spacing (ft)					
		4	5	6	7	8	10
Inland	80	570	710	860	1000	1140	1430
	90	990	1230	1480	1730	1980	2470
	100	1450	1820	2180	2540	2910	3630
	110	1970	2460	2950	3440	3930	4920
Coastal	80	730	910	1100	1280	1460	1830
	90	1190	1490	1790	2080	2380	2980
	100	1700	2130	2560	2980	3410	4260
	110	2270	2840	3410	3970	4540	5680

 Multi-Section Width Tie-downs	Av C 12' 2
---	----------------------------

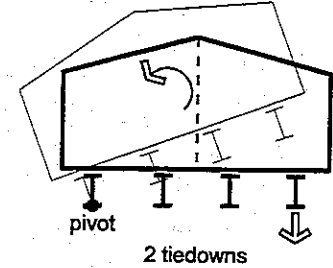


Required Vertical Anchorage - Av (lbs)

	Wind Speed (mph)	Pier Spacing (ft)					
		4	5	6	7	8	10
Inland	80	640	800	960	1120	1280	1600
	90	1110	1380	1660	1930	2210	2760
	100	1630	2030	2440	2840	3250	4060
	110	2200	2750	3300	3850	4400	5500
Coastal	80	820	1020	1230	1430	1640	2050
	90	1330	1670	2000	2330	2670	3330
	100	1910	2380	2860	3340	3810	4770
	110	2540	3180	3810	4450	5080	6350

 Multi-Section Width Tie-downs	Av C 14' 2
---	----------------------------

Required Vertical Anchorage - Av (lbs)

	Wind Speed (mph)	Pier Spacing (ft)					
		4	5	6	7	8	10
Inland	80	700	880	1050	1230	1400	1750
	90	1210	1510	1820	2120	2420	3030
	100	1780	2230	2670	3120	3560	4450
	110	2410	3010	3620	4220	4820	6030
Coastal	80	900	1120	1350	1570	1790	2240
	90	1460	1820	2190	2550	2920	3650
	100	2090	2610	3130	3650	4180	5220
	110	2780	3480	4180	4870	5570	6960


 Multi-Section Width Tie-downs	Av C 16' 2
---	----------------------------

Multi-Section C

Av C 12' 4	 Multi-Section Width Tiedowns
---	--

Required Vertical Anchorage - Av (lbs)


	Wind Speed (mph)	Pier Spacing (ft)					
		4	5	6	7	8	10
Inland	80	370	460	550	650	740	920
	90	640	800	960	1120	1280	1600
	100	940	1180	1410	1650	1880	2350
	110	1270	1590	1910	2230	2550	3180
Coastal	80	470	590	710	830	950	1180
	90	770	960	1160	1350	1540	1930
	100	1100	1380	1650	1930	2210	2760
	110	1470	1840	2210	2570	2940	3680

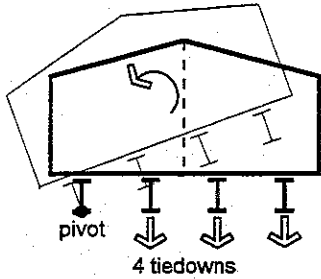

Av C 14' 4	 Multi-Section Width Tiedowns
---	--

Required Vertical Anchorage - Av (lbs)

	Wind Speed (mph)	Pier Spacing (ft)					
		4	5	6	7	8	10
Inland	80	410	510	620	720	820	1030
	90	710	890	1070	1240	1420	1780
	100	1050	1310	1570	1830	2090	2610
	110	1410	1770	2120	2480	2830	3540
Coastal	80	530	660	790	920	1050	1320
	90	860	1070	1290	1500	1710	2140
	100	1230	1530	1840	2140	2450	3060
	110	1630	2040	2450	2860	3270	4080

Av C 16' 4	 Multi-Section Width Tiedowns
---	--


Required Vertical Anchorage - Av (lbs)


	Wind Speed (mph)	Pier Spacing (ft)					
		4	5	6	7	8	10
Inland	80	450	560	680	790	900	1130
	90	780	980	1170	1370	1560	1950
	100	1150	1430	1720	2010	2300	2870
	110	1550	1940	2330	2720	3110	3880
Coastal	80	580	720	870	1010	1160	1450
	90	940	1180	1410	1650	1880	2350
	100	1350	1680	2020	2360	2690	3370
	110	1790	2240	2690	3140	3590	4480

Multi-Section E

Required Vertical Anchorage - Av (lbs/ft)


	Wind Speed (mph)	Exterior (lbs/ft)
Inland	80	110
	90	210
	100	310
	110	430
Coastal	80	150
	90	250
	100	370
	110	500

 Multi-Section Width Tiedowns	Av E 12' 2
--	----------------------------

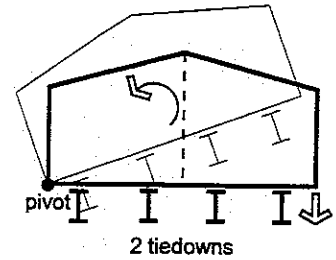


Required Vertical Anchorage - Av (lbs/ft)

	Wind Speed (mph)	Exterior (lbs/ft)
Inland	80	130
	90	240
	100	360
	110	490
Coastal	80	170
	90	290
	100	420
	110	570

 Multi-Section Width Tiedowns	Av E 14' 2
--	----------------------------


Required Vertical Anchorage - Av (lbs/ft)

	Wind Speed (mph)	Exterior (lbs/ft)
Inland	80	150
	90	270
	100	400
	110	550
Coastal	80	190
	90	330
	100	480
	110	640

 Multi-Section Width Tiedowns	Av E 16' 2
--	----------------------------


Multi-Section E

Av E 12' 4	 Multi-Section Width Tiedowns
---	--

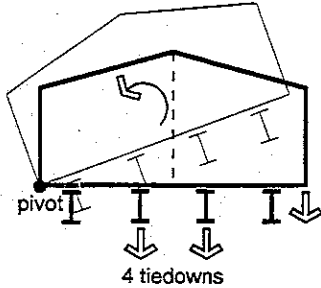

Required Vertical Anchorage - Av (lbs)

	Wind Speed (mph)	Exterior (lbs/ft)	Interior Pier Spacing (ft)					
			4	5	6	7	8	10
Inland	80	70	180	230	270	320	360	450
	90	140	330	420	500	590	670	840
	100	210	510	630	760	890	1020	1270
	110	280	700	870	1050	1220	1400	1750
Coastal	80	100	240	300	360	420	480	600
	90	170	410	510	620	720	820	1030
	100	240	600	750	900	1050	1200	1500
	110	330	810	1010	1220	1420	1620	2030

Av E 14' 4	 Multi-Section Width Tiedowns
---	--

Required Vertical Anchorage - Av (lbs)

	Wind Speed (mph)	Exterior (lbs/ft)	Interior Pier Spacing (ft)					
			4	5	6	7	8	10
Inland	80	80	210	270	320	370	420	530
	90	160	390	490	580	680	780	970
	100	230	590	730	880	1030	1170	1470
	110	320	810	1010	1210	1410	1610	2010
Coastal	80	110	280	350	420	490	560	700
	90	190	480	590	710	830	950	1190
	100	280	690	870	1040	1210	1390	1730
	110	370	930	1170	1400	1640	1870	2340

Av E 16' 4	 Multi-Section Width Tiedowns
---	--


Required Vertical Anchorage - Av (lbs)


	Wind Speed (mph)	Exterior (lbs/ft)	Interior Pier Spacing (ft)					
			4	5	6	7	8	10
Inland	80	100	240	300	360	420	480	600
	90	180	440	540	650	760	870	1090
	100	260	650	820	980	1150	1310	1640
	110	360	900	1120	1340	1570	1790	2240
Coastal	80	130	320	390	470	550	630	790
	90	210	530	660	800	930	1060	1330
	100	310	770	970	1160	1350	1540	1930
	110	420	1040	1300	1560	1820	2080	2600

Multi-Section E3

Required Vertical Anchorage - Av (lbs)


	Wind Speed (mph)	Exterior (lbs/ft)	Interior Pier Spacing (ft)					
			4	5	6	7	8	10
Inland	80	50	170	210	260	300	340	430
	90	90	320	400	480	560	640	800
	100	140	480	600	720	840	970	1210
	110	190	660	830	1000	1160	1330	1660
Coastal	80	60	230	290	340	400	460	570
	90	110	390	490	590	680	780	980
	100	160	570	710	860	1000	1140	1430
	110	220	770	960	1160	1350	1540	1930

 Multi-Section Width Tiedowns	Av E3 12' 6
--	-----------------------------

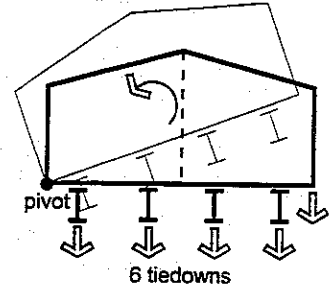


Required Vertical Anchorage - Av (lbs)

	Wind Speed (mph)	Exterior (lbs/ft)	Interior Pier Spacing (ft)					
			4	5	6	7	8	10
Inland	80	60	200	250	300	350	400	490
	90	100	360	450	540	640	730	910
	100	160	550	680	820	960	1100	1370
	110	210	750	940	1130	1320	1500	1880
Coastal	80	70	260	330	390	460	520	650
	90	130	440	550	670	780	890	1110
	100	180	650	810	970	1130	1290	1620
	110	250	870	1090	1310	1530	1740	2180

 Multi-Section Width Tiedowns	Av E3 14' 6
--	-----------------------------


Required Vertical Anchorage - Av (lbs)

	Wind Speed (mph)	Exterior (lbs/ft)	Interior Pier Spacing (ft)					
			4	5	6	7	8	10
Inland	80	60	230	280	340	400	450	560
	90	120	410	510	610	720	820	1020
	100	170	610	770	920	1080	1230	1540
	110	240	840	1050	1260	1470	1680	2100
Coastal	80	80	300	370	450	520	590	740
	90	140	500	620	750	870	1000	1250
	100	210	730	910	1090	1270	1450	1810
	110	280	980	1220	1460	1710	1950	2440

 Multi-Section Width Tiedowns	Av E3 16' 6
--	-----------------------------


Multi-Section I

Av I 12' 2	 Multi-Section Width Tie-downs
---	---

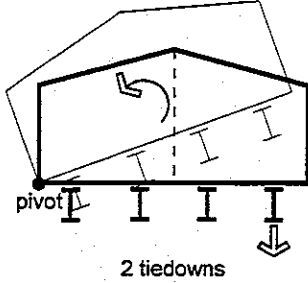

Required Vertical Anchorage - Av (lbs)

	Wind Speed (mph)	Pier Spacing (ft)					
		4	5	6	7	8	10
Inland	80	510	630	760	890	1010	1260
	90	940	1170	1410	1640	1880	2350
	100	1420	1780	2140	2490	2850	3560
	110	1960	2450	2940	3430	3920	4900
Coastal	80	670	840	1010	1180	1350	1680
	90	1150	1440	1730	2010	2300	2880
	100	1690	2110	2530	2950	3370	4210
	110	2280	2840	3410	3980	4550	5690

Av I 14' 2	 Multi-Section Width Tie-downs
---	---

Required Vertical Anchorage - Av (lbs)

	Wind Speed (mph)	Pier Spacing (ft)					
		4	5	6	7	8	10
Inland	80	590	740	890	1040	1190	1480
	90	1090	1360	1630	1910	2180	2720
	100	1640	2050	2460	2880	3290	4110
	110	2260	2820	3380	3950	4510	5640
Coastal	80	780	980	1180	1370	1570	1960
	90	1330	1660	2000	2330	2660	3330
	100	1940	2430	2910	3400	3880	4860
	110	2620	3270	3930	4580	5230	6540

Av I 16' 2	 Multi-Section Width Tie-downs
---	---


Required Vertical Anchorage - Av (lbs)


	Wind Speed (mph)	Pier Spacing (ft)					
		4	5	6	7	8	10
Inland	80	670	840	1010	1180	1350	1680
	90	1220	1530	1830	2140	2440	3050
	100	1830	2290	2750	3210	3670	4580
	110	2510	3140	3770	4390	5020	6280
Coastal	80	880	1110	1330	1550	1770	2210
	90	1490	1860	2230	2610	2980	3720
	100	2160	2710	3250	3790	4330	5410
	110	2910	3640	4370	5090	5820	7280

Multi-Section I

Required Vertical Anchorage - Av (lbs)


	Wind Speed (mph)	Pier Spacing (ft)					
		4	5	6	7	8	10
Inland	80	300	380	450	530	600	760
	90	560	700	840	980	1120	1400
	100	850	1060	1280	1490	1700	2130
	110	1170	1460	1760	2050	2340	2930
Coastal	80	400	500	600	700	800	1010
	90	690	860	1030	1200	1380	1720
	100	1010	1260	1510	1760	2020	2520
	110	1360	1700	2040	2380	2720	3400

	Av
Multi-Section	I
Width	12'
Tiedowns	4

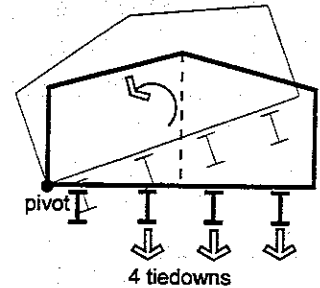


Required Vertical Anchorage - Av (lbs)

	Wind Speed (mph)	Pier Spacing (ft)					
		4	5	6	7	8	10
Inland	80	350	440	530	610	700	880
	90	640	800	960	1130	1290	1610
	100	970	1210	1460	1700	1940	2430
	110	1330	1660	2000	2330	2660	3330
Coastal	80	460	580	700	810	930	1160
	90	790	980	1180	1380	1570	1960
	100	1150	1430	1720	2010	2290	2870
	110	1540	1930	2320	2700	3090	3860

	Av
Multi-Section	I
Width	14'
Tiedowns	4

Required Vertical Anchorage - Av (lbs)

	Wind Speed (mph)	Pier Spacing (ft)					
		4	5	6	7	8	10
Inland	80	400	500	600	700	800	1000
	90	720	910	1090	1270	1450	1810
	100	1090	1360	1630	1900	2170	2720
	110	1490	1860	2230	2610	2980	3720
Coastal	80	520	660	790	920	1050	1310
	90	880	1100	1320	1550	1770	2210
	100	1280	1600	1920	2250	2570	3210
	110	1730	2160	2590	3020	3450	4310


	Av
Multi-Section	I
Width	16'
Tiedowns	4

Part 3

Required Horizontal Anchorage - Ah - Transverse Direction


Single-Section C, E, I

Ah C, E, I 12' 2	 Single-Section Width Short Walls
---	--

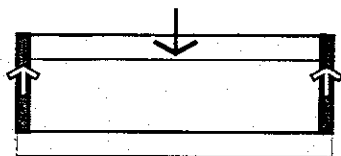

Required Horizontal Anchorage - Ah - Transverse Direction (lbs/ft)

	Wind Speed (mph)	Seismic Ground		Location	Length (ft)						
		Aa	Snow (psf)		40	50	60	70	80	90	100
Inland	80	All Seismic		end	540	680	820	950	1090	1230	1370
	90	All Seismic		end	690	870	1040	1210	1390	1560	1730
	100	All Seismic		end	860	1070	1280	1500	1710	1930	2140
	110	All Seismic		end	1040	1290	1550	1810	2070	2330	2590
Coastal	80	All Seismic		end	600	750	900	1050	1210	1360	1510
	90	All Seismic		end	760	960	1150	1340	1530	1720	1910
	100	All Seismic		end	940	1180	1420	1650	1890	2120	2360
	110	All Seismic		end	1140	1430	1710	2000	2280	2570	2850

Ah C, E, I 14' 2	 Single-Section Width Short Walls
---	--

Required Horizontal Anchorage - Ah - Transverse Direction (lbs/ft)

	Wind Speed (mph)	Seismic Ground		Location	Length (ft)						
		Aa	Snow (psf)		40	50	60	70	80	90	100
Inland	80	.05-.30	0-100	end	480	600	720	840	960	1080	1200
			.40	0-90	end	480	600	720	840	960	1080
			100	end	490	610	720	840	960	1080	1200
	90	All Seismic		end	610	760	910	1060	1210	1370	1520
	100	All Seismic		end	750	940	1120	1310	1500	1690	1870
	110	All Seismic		end	910	1130	1360	1590	1810	2040	2270
Coastal	80	All Seismic		end	530	660	790	920	1060	1190	1320
	90	All Seismic		end	670	840	1000	1170	1340	1510	1670
	100	All Seismic		end	830	1030	1240	1450	1650	1860	2070
	110	All Seismic		end	1000	1250	1500	1750	2000	2250	2500

Ah C, E, I 16' 2	 Single-Section Width Short Walls
---	--

Required Horizontal Anchorage - Ah - Transverse Direction (lbs/ft)

	Wind Speed (mph)	Seismic Ground		Location	Length (ft)						
		Aa	Snow (psf)		40	50	60	70	80	90	100
Inland	80	.05-.30	0-100	end	430	540	650	760	860	970	1080
			.40	0-80	end	430	540	650	760	860	970
			90	end	450	560	670	780	890	1000	1110
	90	All Seismic		end	490	600	720	840	960	1080	1200
	100	All Seismic		end	550	690	820	960	1100	1230	1370
	110	All Seismic		end	680	850	1020	1180	1350	1520	1690
	110	All Seismic		end	820	1020	1230	1430	1640	1840	2050


table continues

Note: All Seismic refers to all values of Aa and all magnitudes of ground snow load.

Required Horizontal Anchorage - Ah - Transverse Direction (lbs/ft)

	Wind Speed (mph)	Seismic Ground		Location	Length (ft)						
		Aa	Snow (psf)		40	50	60	70	80	90	100
Coastal	80	.05-.30	0-100	end	480	600	720	830	950	1070	1190
				int	480	600	720	830	950	1070	1190
		.40	0-90	end	490	600	720	840	960	1080	1200
	90	All Seismic	100	end	600	760	910	1060	1210	1360	1510
				int	750	930	1120	1310	1490	1680	1870
	110	All Seismic		end	900	1130	1350	1580	1810	2030	2260


□	Ah C, E, I
Single-Section	
Width Short Walls	
	16'
	2

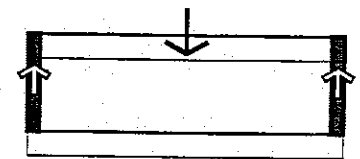

Required Horizontal Anchorage - Ah - Transverse Direction (lbs/ft)

	Wind Speed (mph)	Seismic Ground		Location	Length (ft)						
		Aa	Snow (psf)		40	50	60	70	80	90	100
Inland	80	All Seismic		end	180	220	270	320	360	410	450
				int	360	450	540	630	720	810	900
	90	All Seismic		end	230	290	350	400	460	520	580
				int	460	580	690	810	920	1040	1150
	100	All Seismic		end	290	360	430	500	570	640	710
				int	570	710	860	1000	1140	1280	1430
110	All Seismic		end	350	430	520	600	690	780	860	
			int	690	860	1040	1210	1380	1550	1730	
Coastal	80	All Seismic		end	200	250	300	350	400	450	500
				int	400	500	600	700	800	900	1000
	90	All Seismic		end	250	320	380	450	510	570	640
				int	510	640	760	890	1020	1150	1270
	100	All Seismic		end	310	390	470	550	630	710	790
				int	630	790	940	1100	1260	1420	1570
110	All Seismic		end	380	480	570	670	760	860	950	
			int	760	950	1140	1330	1520	1710	1900	

□	Ah C, E, I
Single-Section	
Width Short Walls	
	12'
	4

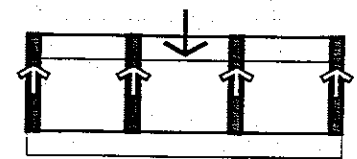

Required Horizontal Anchorage - Ah - Transverse Direction (lbs/ft)


	Wind Speed (mph)	Seismic Ground		Location	Length (ft)							
		Aa	Snow (psf)		40	50	60	70	80	90	100	
Inland	80	.05-.30	0-100	end	160	200	240	280	320	360	400	
				int	310	390	470	550	630	710	790	
				.40	0-90	end	160	200	240	280	320	360
		100	All Seismic	100	end	160	200	240	280	320	360	400
					int	320	400	480	560	640	720	800
					90	All Seismic	end	200	250	300	350	400
100	All Seismic		end	250	310	370	440	500	560	620		
			int	500	620	750	870	1000	1120	1250		
110	All Seismic		end	300	380	450	530	600	680	760		
			int	600	760	910	1060	1210	1360	1510		

□	Ah C, E, I
Single-Section	
Width Short Walls	
	14'
	4

table continues

Note: All Seismic refers to all values of Aa and all magnitudes of ground snow load.

Ah C, E, I 14' 4	□
	Single-Section
	Width Short Walls

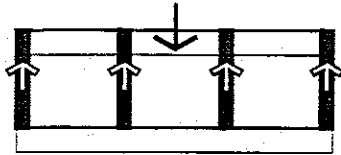

Required Horizontal Anchorage - Ah - Transverse Direction (lbs/ft)

	Wind Speed (mph)	Seismic Aa	Ground Snow Location (psf)	Length (ft)						
				40	50	60	70	80	90	100
Coastal	80	All Seismic	end	170	220	260	310	350	400	440
			int	350	440	530	610	700	790	880
	90	All Seismic	end	220	280	330	390	450	500	560
			int	450	560	670	780	890	1000	1120
	100	All Seismic	end	280	340	410	480	550	620	690
			int	550	690	830	960	1100	1240	1380
	110	All Seismic	end	330	420	500	580	670	750	830
			int	670	830	1000	1170	1330	1500	1670

Ah C, E, I 16' 4	□
	Single-Section
	Width Short Walls


Required Horizontal Anchorage - Ah - Transverse Direction (lbs/ft)


	Wind Speed (mph)	Seismic Aa	Ground Snow Location (psf)	Length (ft)								
				40	50	60	70	80	90	100		
Inland	80	.05-.30	0-100	end	140	180	210	250	290	320	360	
				int	280	360	430	500	570	640	720	
			.40	0-80	end	140	180	210	250	290	320	360
					int	280	360	430	500	570	640	720
		90	All Seismic	end	150	190	220	260	300	330	370	
				int	300	380	450	520	600	670	740	
		100	All Seismic	end	160	200	240	280	320	360	400	
				int	320	400	480	560	640	720	800	
	90	All Seismic	end	180	230	270	320	370	410	460		
			int	370	460	550	640	730	820	910		
	100	All Seismic	end	230	280	340	390	450	510	560		
			int	450	560	680	790	900	1020	1130		
110	All Seismic	end	270	340	410	480	550	610	680			
		int	550	680	820	960	1090	1230	1370			
Coastal	80	.05-.30	0-100	end	160	200	240	280	320	360	400	
				int	320	400	480	560	630	710	790	
			.40	0-90	end	160	200	240	280	320	360	400
					int	320	400	480	560	630	710	790
		90	All Seismic	end	160	200	240	280	320	360	400	
				int	320	400	480	560	640	720	800	
		90	All Seismic	end	200	250	300	350	400	450	500	
				int	400	500	600	710	810	910	1010	
	100	All Seismic	end	250	310	370	440	500	560	620		
			int	500	620	750	870	1000	1120	1240		
	110	All Seismic	end	300	380	450	530	600	680	750		
			int	600	750	900	1050	1200	1350	1510		

Note: All Seismic refers to all values of Aa and all magnitudes of ground snow load.

Required Horizontal Anchorage - Ah - Transverse Direction (lbs/ft)


Wind Speed (mph)	Seismic Aa	Ground Snow (psf)	Location	Length (ft)						
				40	50	60	70	80	90	100
Inland	80	All Seismic	end	110	130	160	190	220	240	270
			int	210	270	320	380	430	490	540
	90	All Seismic	end	140	170	210	240	280	310	350
			int	280	350	420	480	550	620	690
	100	All Seismic	end	170	210	260	300	340	390	430
			int	340	430	510	600	680	770	860
	110	All Seismic	end	210	260	310	360	410	470	520
			int	410	520	620	720	830	930	1040
Coastal	80	All Seismic	end	120	150	180	210	240	270	300
			int	240	300	360	420	480	540	600
	90	All Seismic	end	150	190	230	270	310	340	380
			int	310	380	460	530	610	690	760
	100	All Seismic	end	190	240	280	330	380	420	470
			int	380	470	570	660	750	850	940
	110	All Seismic	end	230	290	340	400	460	510	570
			int	460	570	680	800	910	1030	1140

 Single-Section Width Short Walls	Ah C, E, I 12' 6
--	---

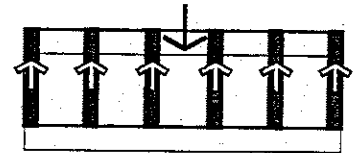


Required Horizontal Anchorage - Ah - Transverse Direction (lbs/ft)

Wind Speed (mph)	Seismic Aa	Ground Snow (psf)	Location	Length (ft)							
				40	50	60	70	80	90	100	
Inland	80	.05-.30	0-100	end	90	120	140	160	190	210	240
				int	190	230	280	330	380	430	470
		.40	0-90	end	90	120	140	160	190	210	240
				int	190	230	280	330	380	430	470
		100		end	100	120	140	170	190	220	240
				int	190	240	290	340	380	430	480
	90	All Seismic	end	120	150	180	210	240	270	300	
			int	240	300	360	430	490	550	610	
	100	All Seismic	end	150	190	220	260	300	340	370	
			int	300	370	450	520	600	670	750	
	110	All Seismic	end	180	230	270	320	360	410	450	
			int	360	450	540	640	730	820	910	
Coastal	80	All Seismic	end	100	130	160	180	210	240	260	
			int	210	260	310	370	420	470	530	
	90	All Seismic	end	130	170	200	230	270	300	330	
			int	270	330	400	470	540	600	670	
	100	All Seismic	end	170	210	250	290	330	370	410	
			int	330	410	500	580	660	740	830	
	110	All Seismic	end	200	250	300	350	400	450	500	
			int	400	500	600	700	800	900	1000	

 Single-Section Width Short Walls	Ah C, E, I 14' 6
--	---

Note: All Seismic refers to all values of Aa and all magnitudes of ground snow load.

Ah C, E, I 16' 6	 Single-Section Width Short Walls
---------------------------	--

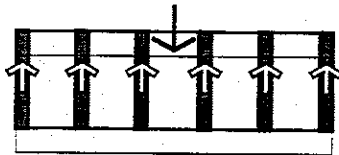

Required Horizontal Anchorage - Ah - Transverse Direction (lbs/ft)



	Wind Speed (mph)	Seismic Aa	Ground Snow Location (psf)		Length (ft)						
					40	50	60	70	80	90	100
Inland	80	.05-.30	0-100	end	80	110	130	150	170	190	210
				int	170	210	260	300	340	380	430
		.40	0-80	end	80	110	130	150	170	190	210
				int	170	210	260	300	340	380	430
		.90	0-60	end	90	110	130	160	180	200	220
				int	180	230	270	310	360	400	450
		1.00	0-40	end	100	120	140	170	190	220	240
				int	190	240	290	340	380	430	480
	90	All Seismic	0-40	end	110	140	160	190	220	250	270
				int	220	270	330	380	440	490	550
	100	All Seismic	0-40	end	140	170	200	240	270	300	340
				int	270	340	410	470	540	610	680
110	All Seismic	0-40	end	160	200	250	290	330	370	410	
			int	330	410	490	570	660	740	820	
Coastal	80	.05-.30	0-100	end	90	120	140	170	190	210	240
				int	190	240	280	330	380	430	480
		.40	0-90	end	90	120	140	170	190	210	240
				int	190	240	280	330	380	430	480
		.90	0-60	end	100	120	140	170	190	220	240
				int	190	240	290	340	380	430	480
		1.00	0-40	end	120	150	180	210	240	270	300
				int	240	300	360	420	480	540	600
	90	All Seismic	0-40	end	150	190	220	260	300	340	370
				int	300	370	450	520	600	670	750
	100	All Seismic	0-40	end	180	230	270	320	360	410	450
				int	360	450	540	630	720	810	900

Note: All Seismic refers to all values of Aa and all magnitudes of ground snow load.

Multi-Section C, E, I


Required Horizontal Anchorage - Ah - Transverse Direction (lbs/ft)

	Wind Speed (mph)	Seismic Aa	Ground Snow (psf)	Location	Length (ft)							
					40	50	60	70	80	90	100	
Inland	80	.05-.20	0-100	end	310	390	470	550	630	710	790	
			.30	0-70	end	310	390	470	550	630	710	790
				80	end	320	390	470	550	630	710	790
				90	end	340	420	510	590	670	760	840
		100	end	370	460	550	630	720	810	900		
		.40	0-40	end	310	390	470	550	630	710	790	
	50		end	320	400	480	550	630	710	790		
	60		end	360	440	530	610	700	780	870		
	70		end	390	480	580	670	770	860	950		
	80		end	420	530	630	730	830	930	1040		
	90	.05-.30	0-100	end	400	500	600	700	800	900	1000	
			.40	0-70	end	400	500	600	700	800	900	1000
				80	end	420	530	630	730	830	930	1040
		90	end	460	570	680	790	900	1010	1120		
		100	end	490	610	730	850	960	1080	1200		
		All Seismic	end	490	620	740	870	990	1110	1240		
	110	All Seismic	end	600	750	900	1050	1200	1350	1500		
	Coastal	80	.05-.20	0-100	end	350	430	520	610	700	780	870
.30				0-90	end	350	430	520	610	700	780	870
				100	end	370	460	550	630	720	810	900
.40			0-50	end	350	430	520	610	700	780	870	
			60	end	360	440	530	610	700	780	870	
			70	end	390	480	580	670	770	860	950	
		80	end	420	530	630	730	830	930	1040		
		90	end	460	570	680	790	900	1010	1120		
90		.05-.30	0-100	end	440	550	660	770	880	990	1100	
			.40	0-80	end	440	550	660	770	880	990	1100
				90	end	460	570	680	790	900	1010	1120
		100	end	490	610	730	850	960	1080	1200		
	100	All Seismic	end	540	680	820	950	1090	1230	1360		
	110	All Seismic	end	660	820	990	1150	1320	1480	1650		

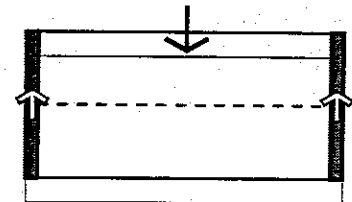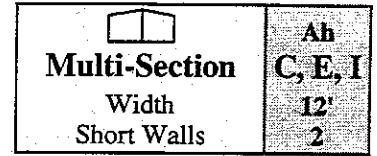

Note: All Seismic refers to all values of Aa and all magnitudes of ground snow load.

Ah C, E, I 14' 2	
	Multi-Section
	Width Short Walls

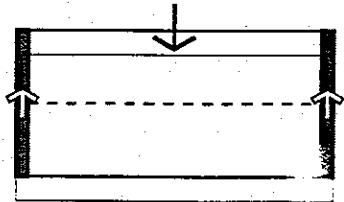

Required Horizontal Anchorage - Ah - Transverse Direction (lbs/ft)

	Wind Speed (mph)	Seismic Aa	Ground Snow (psf)	Location	Length (ft)									
					40	50	60	70	80	90	100			
Inland	80	.05-.20	0-100	end	280	350	420	490	560	630	700			
				end	.30	0-60	280	350	420	490	560	630	700	
					70	290	360	430	500	560	630	700		
					80	310	390	460	540	610	690	760		
					90	340	420	500	580	660	750	830		
					100	360	450	540	630	710	800	890		
	end	.40	0-40	280	350	420	490	560	630	700				
		50	320	390	470	540	620	700	770					
		60	350	430	520	600	690	770	850					
		70	380	480	570	660	750	840	940					
		80	420	520	620	720	820	920	1020					
		90	450	560	670	780	880	990	1100					
	90	.05-.30	0-100	end	360	450	540	630	720	800	890			
				end	.40	0-60	360	450	540	630	720	800	890	
					70	380	480	570	660	750	840	940		
					80	420	520	620	720	820	920	1020		
					90	450	560	670	780	880	990	1100		
					100	480	600	720	830	950	1070	1190		
100	.05-.30	0-100	end	440	550	660	770	880	990	1100				
			end	.40	0-80	440	550	660	770	880	990	1100		
				90	450	560	670	780	880	990	1100			
110	.05-.30	0-100	end	480	600	720	830	950	1070	1190				
			end	.40	0-80	440	550	660	770	880	990	1100		
				90	450	560	670	780	880	990	1100			
Coastal	80	.05-.20	0-100	end	310	390	470	540	620	700	780			
				end	.30	0-80	310	390	470	540	620	700	780	
					90	340	420	500	580	660	750	830		
					100	360	450	540	630	710	800	890		
					end	.40	0-40	310	390	470	540	620	700	780
						50	320	390	470	540	620	700	780	
	60	350	430	520		600	690	770	850					
	70	380	480	570		660	750	840	940					
	80	420	520	620		720	820	920	1020					
	90	.05-.30	0-100	end	390	490	590	690	790	890	990			
				end	.40	0-70	390	490	590	690	790	890	990	
					80	420	520	620	720	820	920	1020		
					90	450	560	670	780	880	990	1100		
					100	480	600	720	830	950	1070	1190		
					end	.40	0-70	390	490	590	690	790	890	990
	80	420	520	620		720	820	920	1020					
	100	.05-.30	0-100	end	490	610	730	850	970	1090	1220			
				end	490	610	730	850	970	1090	1220			
110	.05-.30	0-100	end	590	740	880	1030	1180	1320	1470				
			end	590	740	880	1030	1180	1320	1470				



Note: All Seismic refers to all values of Aa and all magnitudes of ground snow load.

Required Horizontal Anchorage - Ah - Transverse Direction (lbs/ft)


Wind Speed (mph)	Seismic Aa	Ground Snow (psf)	Location	Length (ft)									
				40	50	60	70	80	90	100			
Inland	80	.05-.20	0-100	end	260	320	390	450	520	580	650		
			.30	0-50	end	260	320	390	450	520	580	650	
				60	end	260	330	390	450	520	580	650	
				70	end	290	360	430	490	560	630	700	
				80	end	310	390	460	540	610	690	760	
				90	end	340	420	500	580	660	740	830	
		100		end	360	450	540	630	710	800	890		
		.40	0-40	end	260	320	390	450	520	580	650		
			50	end	320	390	470	540	620	690	770		
			60	end	350	430	520	600	680	770	850		
			70	end	380	480	570	660	750	840	940		
			80	end	420	520	620	720	820	920	1020		
	90		end	450	560	670	780	880	990	1100			
	90	.05-.20	0-100	end	330	410	490	570	660	740	820		
			.30	0-80	end	330	410	490	570	660	740	820	
				90	end	340	420	500	580	660	740	830	
				100	end	360	450	540	630	710	800	890	
				.40	0-50	end	330	410	490	570	660	740	820
					60	end	350	430	520	600	680	770	850
		70			end	380	480	570	660	750	840	940	
		80	end		420	520	620	720	820	920	1020		
		90	end		450	560	670	780	880	990	1100		
		100	end		480	600	720	830	950	1070	1190		
		100	.05-.30	0-100	end	400	510	610	710	810	910	1010	
.40				0-70	end	400	510	610	710	810	910	1010	
	80			end	420	520	620	720	820	920	1020		
	90			end	450	560	670	780	880	990	1100		
	100			end	480	600	720	830	950	1070	1190		
	All Seismic			end	490	610	730	860	980	1100	1220		
Coastal	80	.05-.20	0-100	end	290	360	430	500	570	640	710		
			.30	0-70	end	290	360	430	500	570	640	710	
				80	end	310	390	460	540	610	690	760	
				90	end	340	420	500	580	660	740	830	
				100	end	360	450	540	630	710	800	890	
				.40	0-40	end	290	360	430	500	570	640	710
	50	end			320	390	470	540	620	690	770		
	60	end	350		430	520	600	680	770	850			
	70	end	380		480	570	660	750	840	940			
	80	end	420		520	620	720	820	920	1020			
	90	end	450		560	670	780	880	990	1100			
	100	.05-.30	0-100	end	400	510	610	710	810	910	1010		
.40			0-70	end	400	510	610	710	810	910	1010		
			80	end	420	520	620	720	820	920	1020		
			90	end	450	560	670	780	880	990	1100		
			100	end	480	600	720	830	950	1070	1190		
			All Seismic	end	490	610	730	860	980	1100	1220		

table continues

Note: All Seismic refers to all values of Aa and all magnitudes of ground snow load.

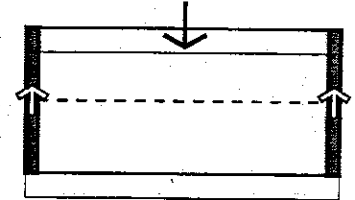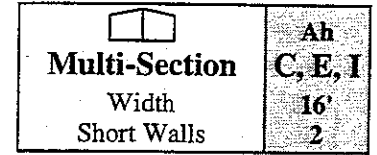


Ah C, E, I 16' 2	
	Multi-Section
	Width Short Walls

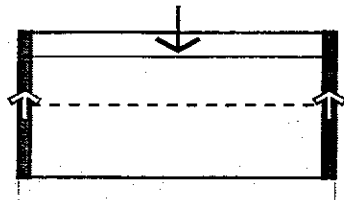

Required Horizontal Anchorage - Ah - Transverse Direction (lbs/ft)

Wind Speed (mph)	Seismic Aa	Ground Snow (psf)	Location	Length (ft)							
				40	50	60	70	80	90	100	
Coastal	90	.05-.30	0-100	end	360	450	540	630	720	810	900
			end	360	450	540	630	720	810	900	
		.40	0-60	end	380	480	570	660	750	840	940
			70	end	420	520	620	720	820	920	1020
			80	end	450	560	670	780	880	990	1100
			90	end	480	600	720	830	950	1070	1190
	100	.05-.30	0-100	end	450	560	670	780	890	1000	1120
			end	450	560	670	780	890	1000	1120	
		.40	0-90	end	480	600	720	830	950	1070	1190
			end	480	600	720	830	950	1070	1190	
			100	end	540	680	810	950	1080	1220	1350
			end	540	680	810	950	1080	1220	1350	

Ah C, E, I 12' 4	
	Multi-Section
	Width Short Walls

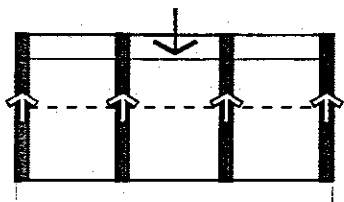

Required Horizontal Anchorage - Ah - Transverse Direction (lbs/ft)



Wind Speed (mph)	Seismic Aa	Ground Snow (psf)	Location	Length (ft)								
				40	50	60	70	80	90	100		
Inland	80	.05-.20	0-100	end	100	130	150	180	210	230	260	
			int	200	260	310	360	420	470	520		
			.30	0-70	end	100	130	150	180	210	230	260
				int	200	260	310	360	420	470	520	
			80	end	110	130	160	180	210	230	260	
				int	210	260	310	360	420	470	520	
		90	end	110	140	170	200	220	250	280		
			int	230	280	340	390	450	500	560		
		100	end	120	150	180	210	240	270	300		
			int	240	300	360	420	480	540	600		
		.40	0-40	end	100	130	150	180	210	230	260	
				int	200	260	310	360	420	470	520	
			50	end	110	130	160	180	210	240	260	
				int	220	270	320	370	420	470	520	
			60	end	120	150	180	200	230	260	290	
				int	240	290	350	410	470	520	580	
			70	end	130	160	190	220	260	290	320	
				int	260	320	380	450	510	570	640	
	80		end	140	180	210	240	280	310	350		
			int	280	350	420	490	550	620	690		
	90		end	150	190	230	260	300	340	370		
			int	300	380	450	530	600	670	750		
	100	end	160	200	240	280	320	360	400			
		int	330	410	480	560	640	720	800			

table continues


Note: All Seismic refers to all values of Aa and all magnitudes of ground snow load.


Required Horizontal Anchorage - Ah - Transverse Direction (lbs/ft)

Wind Speed (mph)	Seismic Aa	Ground Snow (psf)	Location	Length (ft)								
				40	50	60	70	80	90	100		
Inland	90	.05-.30	0-100	end	130	170	200	230	270	300	330	
				int	270	330	400	470	530	600	670	
		.40	0-70	end	130	170	200	230	270	300	330	
				int	270	330	400	470	530	600	670	
		80		end	140	180	210	240	280	310	350	
				int	280	350	420	490	550	620	690	
	90		end	150	190	230	260	300	340	370		
			int	300	380	450	530	600	670	750		
	100		end	160	200	240	280	320	360	400		
			int	330	410	480	560	640	720	800		
	100	All Seismic		end	160	210	250	290	330	370	410	
				int	330	410	490	580	660	740	820	
	110	All Seismic		end	200	250	300	350	400	450	500	
				int	400	500	600	700	800	900	1000	
	Coastal	80	.05-.20	0-100	end	110	140	170	200	230	260	290
					int	230	290	340	400	460	520	580
			.30	0-90	end	110	140	170	200	230	260	290
					int	230	290	340	400	460	520	580
100				end	120	150	180	210	240	270	300	
				int	240	300	360	420	480	540	600	
.40			0-50	end	110	140	170	200	230	260	290	
				int	230	290	340	400	460	520	580	
60				end	120	150	180	200	230	260	290	
				int	240	290	350	410	470	520	580	
70				end	130	160	190	220	260	290	320	
				int	260	320	380	450	510	570	640	
80			end	140	180	210	240	280	310	350		
			int	280	350	420	490	550	620	690		
90			end	150	190	230	260	300	340	370		
			int	300	380	450	530	600	670	750		
100			end	160	200	240	280	320	360	400		
			int	330	410	480	560	640	720	800		
90		.05-.30	0-100	end	150	180	220	260	290	330	370	
				int	290	370	440	520	590	660	740	
		.40	0-80	end	150	180	220	260	290	330	370	
				int	290	370	440	520	590	660	740	
		90		end	150	190	230	260	300	340	370	
				int	300	380	450	530	600	670	750	
100		end	160	200	240	280	320	360	400			
		int	330	410	480	560	640	720	800			
100	All Seismic		end	180	230	270	320	360	410	450		
			int	360	450	540	640	730	820	910		
110	All Seismic		end	220	270	330	380	440	490	550		
			int	440	550	660	770	880	990	1100		

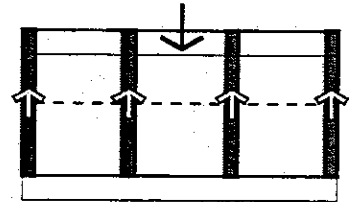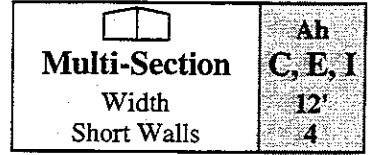

Note: All Seismic refers to all values of Aa and all magnitudes of ground snow load.

Ah C, E, I 14' 4	 Multi-Section Width Short Walls
---------------------------	---

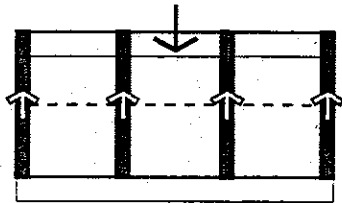

Required Horizontal Anchorage - Ah - Transverse Direction (lbs/ft)



Wind Speed (mph)	Seismic Aa	Ground Snow (psf)	Location	Length (ft)							
				40	50	60	70	80	90	100	
Inland	80	.05-.20	0-100	end	90	120	140	160	190	210	230
				int	180	230	280	320	370	420	470
		.30	0-60	end	90	120	140	160	190	210	230
				int	180	230	280	320	370	420	470
			70	end	100	120	140	170	190	210	230
				int	190	240	280	330	380	420	470
			80	end	100	130	150	180	200	230	250
				int	210	260	310	360	410	460	510
		90	end	110	140	170	190	220	250	280	
			int	220	280	330	390	440	500	550	
		100	end	120	150	180	210	240	270	300	
			int	240	300	360	420	480	530	590	
	.40	0-40	end	90	120	140	160	190	210	230	
			int	180	230	280	320	370	420	470	
		50	end	110	130	160	180	210	230	260	
			int	210	260	310	360	410	460	510	
		60	end	120	140	170	200	230	260	280	
			int	230	290	350	400	460	510	570	
		70	end	130	160	190	220	250	280	310	
			int	260	320	380	440	500	560	620	
		80	end	140	170	210	240	270	310	340	
			int	280	340	410	480	550	610	680	
		90	end	150	190	220	260	290	330	370	
			int	300	370	440	520	590	660	730	
100	end	160	200	240	280	320	360	400			
	int	320	400	480	560	630	710	790			
90	.05-.30	0-100	end	120	150	180	210	240	270	300	
			int	240	300	360	420	480	540	600	
	.40	0-60	end	120	150	180	210	240	270	300	
			int	240	300	360	420	480	540	600	
		70	end	130	160	190	220	250	280	310	
			int	260	320	380	440	500	560	620	
		80	end	140	170	210	240	270	310	340	
			int	280	340	410	480	550	610	680	
	90	end	150	190	220	260	290	330	370		
		int	300	370	440	520	590	660	730		
	100	end	160	200	240	280	320	360	400		
		int	320	400	480	560	630	710	790		

table continues

Note: All Seismic refers to all values of Aa and all magnitudes of ground snow load.

Required Horizontal Anchorage - Ah - Transverse Direction (lbs/ft)

Wind Speed (mph)	Seismic Aa	Ground Snow (psf)	Location	Length (ft)								
				40	50	60	70	80	90	100		
Inland	100	.05-.30	0-100	end	150	180	220	260	290	330	370	
				int	290	370	440	510	590	660	740	
		.40	0-80	end	150	180	220	260	290	330	370	
				int	290	370	440	510	590	660	740	
			90	end	150	190	220	260	290	330	370	
				int	300	370	440	520	590	660	740	
			100	end	160	200	240	280	320	360	400	
				int	320	400	480	560	630	710	790	
		110	All Seismic	end	180	220	270	310	360	400	450	
				int	360	450	530	620	710	800	890	
Coastal	80	.05-.20	0-100	end	100	130	150	180	210	230	260	
				int	210	260	310	360	410	460	520	
			.30	0-80	end	100	130	150	180	210	230	260
					int	210	260	310	360	410	460	520
				90	end	110	140	170	190	220	250	280
					int	220	280	330	390	440	500	550
				100	end	120	150	180	210	240	270	300
					int	240	300	360	420	480	530	590
			.40	0-40	end	100	130	150	180	210	230	260
					int	210	260	310	360	410	460	520
				50	end	110	130	160	180	210	230	260
					int	210	260	310	360	410	460	520
				60	end	120	140	170	200	230	260	280
					int	230	290	350	400	460	510	570
				70	end	130	160	190	220	250	280	310
					int	260	320	380	440	500	560	620
				80	end	140	170	210	240	270	310	340
					int	280	340	410	480	550	610	680
			90	end	150	190	220	260	290	330	370	
				int	300	370	440	520	590	660	730	
			100	end	160	200	240	280	320	360	400	
				int	320	400	480	560	630	710	790	
	90	.05-.30	0-100	end	130	160	200	230	260	300	330	
				int	260	330	390	460	530	590	660	
			.40	0-70	end	130	160	200	230	260	300	330
					int	260	330	390	460	530	590	660
				80	end	140	170	210	240	270	310	340
					int	280	340	410	480	550	610	680
				90	end	150	190	220	260	290	330	370
					int	300	370	440	520	590	660	730
			100	end	160	200	240	280	320	360	400	
				int	320	400	480	560	630	710	790	
100	All Seismic	end	160	200	240	280	320	360	410			
		int	320	410	490	570	650	730	810			
110	All Seismic	end	200	250	290	340	390	440	490			
		int	390	490	590	690	790	880	980			

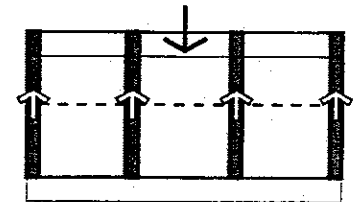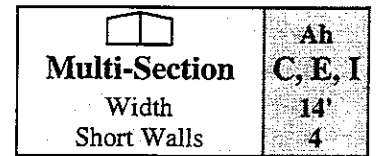

Note: All Seismic refers to all values of Aa and all magnitudes of ground snow load.

Ah C, E, I 16' 4	
	Multi-Section
	Width
	Short Walls

Required Horizontal Anchorage - Ah - Transverse Direction (lbs/ft)

	Wind Speed (mph)	Seismic Aa	Ground Snow (psf)	Location	Length (ft)						
					40	50	60	70	80	90	100
Inland	80	.05-.20	0-100	end	80	110	130	150	170	190	210
				int	170	210	260	300	340	380	430
		.30	0-50	end	80	110	130	150	170	190	210
				int	170	210	260	300	340	380	430
			60	end	90	110	130	150	170	190	210
				int	170	220	260	300	340	380	430
			70	end	100	120	140	160	190	210	230
				int	190	240	280	330	380	420	470
		80	end	100	130	150	180	200	230	250	
			int	210	260	310	360	410	460	510	
		90	end	110	140	170	190	220	250	280	
			int	220	280	330	390	440	500	550	
	100	end	120	150	180	210	240	270	300		
		int	240	300	360	420	480	530	590		
	.40	0-40	end	80	110	130	150	170	190	210	
			int	170	210	260	300	340	380	430	
		50	end	110	130	160	180	210	230	260	
			int	210	260	310	360	410	460	510	
		60	end	120	140	170	200	230	260	280	
			int	230	290	340	400	460	510	570	
		70	end	130	160	190	220	250	280	310	
			int	260	320	380	440	500	560	620	
		80	end	140	170	210	240	270	310	340	
			int	280	340	410	480	550	610	680	
90		end	150	190	220	260	290	330	370		
		int	300	370	440	520	590	660	730		
100	end	160	200	240	280	320	360	400			
	int	320	400	480	560	630	710	790			
90	.05-.20	0-100	end	110	140	160	190	220	250	270	
			int	220	270	330	380	440	490	550	
		.30	0-80	end	110	140	160	190	220	250	270
				int	220	270	330	380	440	490	550
			90	end	110	140	170	190	220	250	280
				int	220	280	330	390	440	500	550
			100	end	120	150	180	210	240	270	300
				int	240	300	360	420	480	530	590
		.40	0-50	end	110	140	160	190	220	250	270
				int	220	270	330	380	440	490	550
			60	end	120	140	170	200	230	260	280
				int	230	290	340	400	460	510	570
	70		end	130	160	190	220	250	280	310	
			int	260	320	380	440	500	560	620	
	80		end	140	170	210	240	270	310	340	
			int	280	340	410	480	550	610	680	
	90		end	150	190	220	260	290	330	370	
			int	300	370	440	520	590	660	730	
	100		end	160	200	240	280	320	360	400	
			int	320	400	480	560	630	710	790	

table continues



Note: All Seismic refers to all values of Aa and all magnitudes of ground snow load.


Required Horizontal Anchorage - Ah - Transverse Direction (lbs/ft)


Wind Speed (mph)	Seismic Aa	Ground Snow (psf)	Location	Length (ft)								
				40	50	60	70	80	90	100		
Inland	100	.05-.30	0-100	end	130	170	200	240	270	300	340	
				int	270	340	400	470	540	610	670	
		.40	0-70	end	130	170	200	240	270	300	340	
				int	270	340	400	470	540	610	670	
		80	end	int	140	170	210	240	270	310	340	
				int	280	340	410	480	550	610	680	
		90	end	int	150	190	220	260	290	330	370	
	int			300	370	440	520	590	660	730		
	100	end	int	160	200	240	280	320	360	400		
			int	320	400	480	560	630	710	790		
	110	All Seismic	end	int	160	200	240	290	330	370	410	
				int	330	410	490	570	650	730	820	
	Coastal	80	.05-.20	0-100	end	90	120	140	170	190	210	240
					int	190	240	280	330	380	430	470
.30			0-60	end	90	120	140	170	190	210	240	
				int	190	240	280	330	380	430	470	
70			end	int	100	120	140	170	190	210	240	
				int	190	240	280	330	380	430	470	
80			end	int	100	130	150	180	200	230	250	
				int	210	260	310	360	410	460	510	
90			end	int	110	140	170	190	220	250	280	
				int	220	280	330	390	440	500	550	
100			end	int	120	150	180	210	240	270	300	
				int	240	300	360	420	480	530	590	
.40			0-40	end	90	120	140	170	190	210	240	
				int	190	240	280	330	380	430	470	
		50	end	int	110	130	160	180	210	230	260	
				int	210	260	310	360	410	460	510	
		60	end	int	120	140	170	200	230	260	280	
				int	230	290	340	400	460	510	570	
		70	end	int	130	160	190	220	250	280	310	
int				260	320	380	440	500	560	620		
80		end	int	140	170	210	240	270	310	340		
	int		280	340	410	480	550	610	680			
90	end	int	150	190	220	260	290	330	370			
		int	300	370	440	520	590	660	730			
100	end	int	160	200	240	280	320	360	400			
		int	320	400	480	560	630	710	790			
90	.05-.30	0-100	end	120	150	180	210	240	270	300		
			int	240	300	360	420	480	540	600		

table continues

Note: All Seismic refers to all values of Aa and all magnitudes of ground snow load.

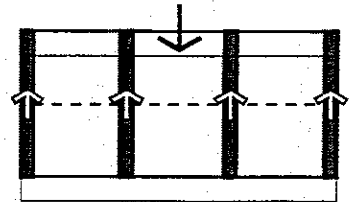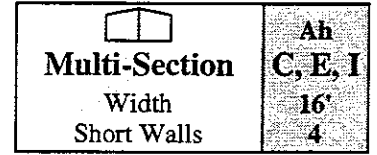


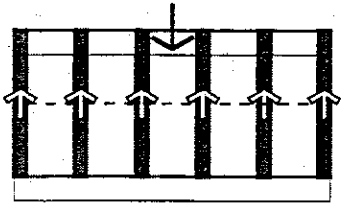
Ah C, E, I 16' 4	
	Multi-Section
	Width Short Walls

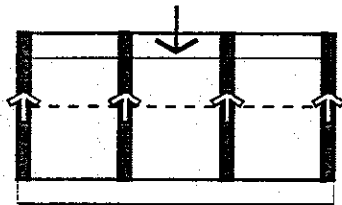

Required Horizontal Anchorage - Ah - Transverse Direction (lbs/ft)

Wind Speed (mph)	Seismic Aa	Ground Snow (psf)	Location	Length (ft)								
				40	50	60	70	80	90	100		
Coastal	90	.40	0-60	end	120	150	180	210	240	270	300	
				int	240	300	360	420	480	540	600	
		70	end	130	160	190	220	250	280	310		
			int	260	320	380	440	500	560	620		
		80	end	140	170	210	240	270	310	340		
			int	280	340	410	480	550	610	680		
	90	end	150	190	220	260	290	330	370			
		int	300	370	440	520	590	660	730			
	100	.05-.30	0-100	end	150	190	220	260	300	330	370	
				int	300	370	450	520	600	670	740	
	110	All Seismic	.40	0-90	end	150	190	220	260	300	330	370
					int	300	370	450	520	600	670	740
100			end	160	200	240	280	320	360	400		
			int	320	400	480	560	630	710	790		

Ah C, E, I 12' 6	
	Multi-Section
	Width Short Walls



Required Horizontal Anchorage - Ah - Transverse Direction (lbs/ft)

Wind Speed (mph)	Seismic Aa	Ground Snow (psf)	Location	Length (ft)							
				40	50	60	70	80	90	100	
Inland	80	.05-.20	0-100	end	60	80	90	110	120	140	150
				int	120	150	180	210	250	280	310
		.30	0-70	end	60	80	90	110	120	140	150
				int	120	150	180	210	250	280	310
		80	end	60	80	90	110	120	140	160	
			int	130	160	190	220	250	280	310	
	90	end	70	80	100	120	130	150	170		
		int	140	170	200	240	270	300	340		
	100	.05-.20	0-100	end	70	90	110	130	140	160	180
				int	150	180	220	250	290	320	360

table continues



Note: All Seismic refers to all values of Aa and all magnitudes of ground snow load.

Required Horizontal Anchorage - Ah - Transverse Direction (lbs/ft)


Wind Speed (mph)	Seismic Aa	Ground Snow (psf)	Location	Length (ft)										
				40	50	60	70	80	90	100				
Inland	80	.40	0	end	60	80	90	110	120	140	150			
				int	120	150	180	210	250	280	310			
			50	end	60	80	100	110	130	140	160			
				int	130	160	190	220	250	280	310			
			60	end	70	90	110	120	140	160	170			
				int	140	180	210	250	280	310	350			
			70	end	80	100	120	130	150	170	190			
				int	160	190	230	270	310	340	380			
			80	end	80	110	130	150	170	190	210			
				int	170	210	250	290	330	370	410			
			90	end	90	110	140	160	180	200	220			
				int	180	230	270	320	360	400	450			
			100	end	100	120	150	170	190	220	240			
				int	200	240	290	340	390	430	480			
			90	.05-.30	0-100	end	80	100	120	140	160	180	200	
						int	160	200	240	280	320	360	400	
					.40	0-70	end	80	100	120	140	160	180	200
							int	160	200	240	280	320	360	400
					80	end	80	110	130	150	170	190	210	
						int	170	210	250	290	330	370	410	
					90	end	90	110	140	160	180	200	220	
						int	180	230	270	320	360	400	450	
					100	end	100	120	150	170	190	220	240	
						int	200	240	290	340	390	430	480	
100	All Seismic	end			100	120	150	170	200	220	250			
		int			200	250	300	350	400	440	490			
110	All Seismic	end	120	150	180	210	240	270	300					
		int	240	300	360	420	480	540	600					
Coastal	80	.05-.20	0-100	end	70	90	100	120	140	150	170			
				int	140	170	210	240	280	310	340			
			.30	0-90	end	70	90	100	120	140	150	170		
					int	140	170	210	240	280	310	340		
			100	end	70	90	110	130	140	160	180			
				int	150	180	220	250	290	320	360			
			.40	0-50	end	70	90	100	120	140	150	170		
					int	140	170	210	240	280	310	340		
			60	end	70	90	110	120	140	160	170			
				int	140	180	210	250	280	310	350			
			70	end	80	100	120	130	150	170	190			
				int	160	190	230	270	310	340	380			
			80	end	80	110	130	150	170	190	210			
				int	170	210	250	290	330	370	410			
			90	end	90	110	140	160	180	200	220			
				int	180	230	270	320	360	400	450			
			100	end	100	120	150	170	190	220	240			
				int	200	240	290	340	390	430	480			

table continues

Note: All Seismic refers to all values of Aa and all magnitudes of ground snow load.

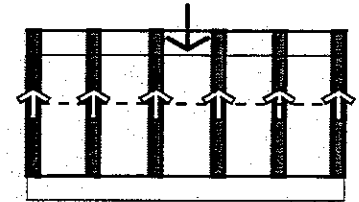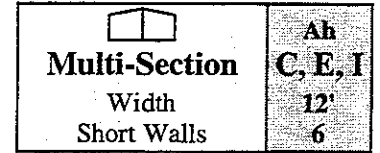

Ah C, E, I 12' 6	
	Multi-Section
	Width
	Short Walls

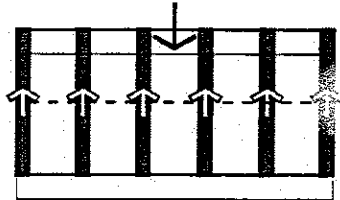

Required Horizontal Anchorage - Ah - Transverse Direction (lbs/ft)

	Wind Speed (mph)	Seismic Ground		Location	Length (ft)						
		Aa	Snow (psf)		40	50	60	70	80	90	100
Coastal	90	.05-.30	0-100	end	90	110	130	150	180	200	220
				int	180	220	260	310	350	400	440
		.40	0-80	end	90	110	130	150	180	200	220
				int	180	220	260	310	350	400	440
		.90	end	int	90	110	140	160	180	200	220
				int	180	230	270	320	360	400	450
	1.00	end	int	100	120	150	170	190	220	240	
			int	200	240	290	340	390	430	480	
	100	All Seismic	end	int	110	140	160	190	220	250	270
				int	220	270	330	380	440	490	540
	110	All Seismic	end	int	130	160	200	230	260	300	330
				int	260	330	400	460	530	590	660

Ah C, E, I 14' 6	
	Multi-Section
	Width
	Short Walls

Required Horizontal Anchorage - Ah - Transverse Direction (lbs/ft)

	Wind Speed (mph)	Seismic Ground		Location	Length (ft)							
		Aa	Snow (psf)		40	50	60	70	80	90	100	
Inland	80	.05-.20	0-100	end	50	70	80	100	110	120	140	
				int	110	140	160	190	220	250	280	
			.30	0-60	end	50	70	80	100	110	120	140
					int	110	140	160	190	220	250	280
			.70	end	int	60	70	90	100	110	130	140
					int	120	140	170	200	230	250	280
		.80	end	int	60	80	90	110	120	140	150	
				int	130	160	190	220	250	280	310	
		.90	end	int	70	80	100	120	130	150	170	
				int	130	170	200	230	270	300	330	
		1.00	end	int	70	90	110	130	140	160	180	
				int	140	180	220	250	290	320	360	
		.40	0-40	end	50	70	80	100	110	120	140	
				int	110	140	160	190	220	250	280	
			.50	end	int	60	80	90	110	120	140	150
					int	130	160	190	220	250	280	310
			.60	end	int	70	90	100	120	140	150	170
					int	140	170	210	240	270	310	340
	.70		end	int	80	100	110	130	150	170	190	
				int	150	190	230	260	300	340	370	
	.80		end	int	80	100	120	140	160	180	200	
				int	170	210	250	290	330	370	410	
	.90		end	int	90	110	130	160	180	200	220	
				int	180	220	270	310	350	400	440	
	1.00	end	int	100	120	140	170	190	210	240		
			int	190	240	290	330	380	430	470		
	90	.05-.20	0-100	end	70	90	110	130	140	160	180	
				int	140	180	210	250	290	320	360	

table continues



Note: All Seismic refers to all values of Aa and all magnitudes of ground snow load.

Required Horizontal Anchorage - Ah - Transverse Direction (lbs/ft)


	Wind Speed (mph)	Seismic Aa	Ground Snow (psf)	Location	Length (ft)							
					40	50	60	70	80	90	100	
Inland	90	.30	0-90	end	70	90	110	130	140	160	180	
				int	140	180	210	250	290	320	360	
			100	end	70	90	110	130	140	160	180	
				int	140	180	220	250	290	320	360	
			.40	0-60	end	70	90	110	130	140	160	180
					int	140	180	210	250	290	320	360
	70	end		80	100	110	130	150	170	190		
		int		150	190	230	260	300	340	370		
	80	end		80	100	120	140	160	180	200		
		int		170	210	250	290	330	370	410		
	90	end	90	110	130	160	180	200	220			
		int	180	220	270	310	350	400	440			
	100	end	100	120	140	170	190	210	240			
		int	190	240	290	330	380	430	470			
	100	.05-.30	0-100	end	90	110	130	150	180	200	220	
				int	180	220	260	310	350	400	440	
		.40	0-80	end	90	110	130	150	180	200	220	
				int	180	220	260	310	350	400	440	
90		end	90	110	130	160	180	200	220			
		int	180	220	270	310	350	400	440			
100	end	100	120	140	170	190	210	240				
	int	190	240	290	330	380	430	470				
110	All Seismic	end	110	130	160	190	210	240	270			
		int	210	270	320	370	430	480	530			
Coastal	80	.05-.20	0-100	end	60	80	90	110	120	140	150	
				int	120	150	180	220	250	280	310	
			.30	0-70	end	60	80	90	110	120	140	150
					int	120	150	180	220	250	280	310
			80	end	60	80	90	110	120	140	150	
				int	130	160	190	220	250	280	310	
	90	end	70	80	100	120	130	150	170			
		int	130	170	200	230	270	300	330			
	100	end	70	90	110	130	140	160	180			
		int	140	180	220	250	290	320	360			
	.40	0-40	end	60	80	90	110	120	140	150		
			int	120	150	180	220	250	280	310		
		50	end	60	80	90	110	120	140	150		
			int	130	160	190	220	250	280	310		
		60	end	70	90	100	120	140	150	170		
			int	140	170	210	240	270	310	340		
	70	end	80	100	110	130	150	170	190			
		int	150	190	230	260	300	340	370			
80	end	80	100	120	140	160	180	200				
	int	170	210	250	290	330	370	410				
90	end	90	110	130	160	180	200	220				
	int	180	220	270	310	350	400	440				
100	end	100	120	140	170	190	210	240				
	int	190	240	290	330	380	430	470				

table continues

Note: All Seismic refers to all values of Aa and all magnitudes of ground snow load.

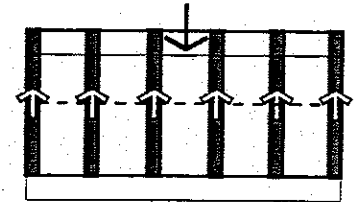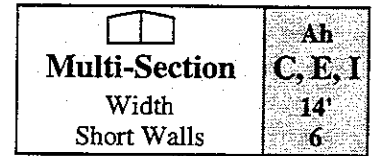

Ah C, E, I 14' 6	
	Multi-Section
	Width Short Walls

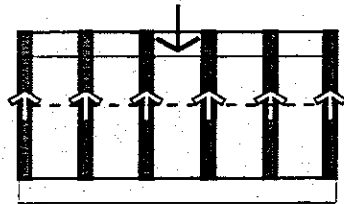

Required Horizontal Anchorage - Ah - Transverse Direction (lbs/ft)

	Wind Speed (mph)	Seismic Aa	Ground Snow (psf)	Location	Length (ft)						
					40	50	60	70	80	90	100
Coastal	90	.05-.30	0-100	end	80	100	120	140	160	180	200
				int	160	200	240	280	320	350	390
		.40	0-70	end	80	100	120	140	160	180	200
				int	160	200	240	280	320	350	390
		80	end	80	100	120	140	160	180	200	
			int	170	210	250	290	330	370	410	
	90	end	90	110	130	160	180	200	220		
		int	180	220	270	310	350	400	440		
	100	All Seismic		end	100	120	150	170	190	220	240
				int	190	240	290	340	390	440	490
	110	All Seismic		end	120	150	180	210	240	260	290
				int	240	290	350	410	470	530	590

Ah C, E, I 16' 6	
	Multi-Section
	Width Short Walls

Required Horizontal Anchorage - Ah - Transverse Direction (lbs/ft)

	Wind Speed (mph)	Seismic Aa	Ground Snow (psf)	Location	Length (ft)						
					40	50	60	70	80	90	100
Inland	80	.05-.20	0-100	end	50	60	80	90	100	110	130
				int	100	130	150	180	200	230	260
		.30	0-50	end	50	60	80	90	100	110	130
				int	100	130	150	180	200	230	260
		60	end	50	70	80	90	100	120	130	
			int	100	130	160	180	210	230	260	
		70	end	60	70	90	100	110	130	140	
			int	110	140	170	200	230	250	280	
		80	end	60	80	90	110	120	140	150	
			int	120	160	190	220	250	280	310	
		90	end	70	80	100	120	130	150	170	
			int	130	170	200	230	270	300	330	
	100	end	70	90	110	130	140	160	180		
		int	150	180	220	250	290	320	360		
	.40	0-40	end	50	60	80	90	100	110	130	
			int	100	130	150	180	200	230	260	
		50	end	60	80	90	110	120	140	150	
			int	130	160	190	220	250	280	310	
		60	end	70	90	100	120	140	150	170	
			int	140	170	210	240	270	310	340	
		70	end	80	100	110	130	150	170	190	
			int	150	190	230	260	300	340	370	
		80	end	80	100	120	140	160	180	200	
			int	170	210	250	290	330	370	410	
90		end	90	110	130	160	180	200	220		
		int	180	220	270	310	350	400	440		
100	end	100	120	140	170	190	210	240			
	int	190	240	290	330	380	430	470			

table continues



Note: All Seismic refers to all values of Aa and all magnitudes of ground snow load.

Required Horizontal Anchorage - Ah - Transverse Direction (lbs/ft)


Wind Speed (mph)	Seismic Aa	Ground Snow (psf)	Location	Length (ft)							
				40	50	60	70	80	90	100	
Inland	90	.05-.20	0-100	end	70	80	100	110	130	150	160
				int	130	160	200	230	260	300	330
		.30	0-80	end	70	80	100	110	130	150	160
				int	130	160	200	230	260	300	330
		90	end	int	70	80	100	120	130	150	170
				int	130	170	200	230	270	300	330
	100	end	int	70	90	110	130	140	160	180	
			int	150	180	220	250	290	320	360	
	.40	0-50	end	70	80	100	110	130	150	160	
			int	130	160	200	230	260	300	330	
		60	end	int	70	90	100	120	140	150	170
				int	140	170	210	240	270	310	340
		70	end	int	80	100	110	130	150	170	190
				int	150	190	230	260	300	340	370
		80	end	int	80	100	120	140	160	180	200
				int	170	210	250	290	330	370	410
		90	end	int	90	110	130	160	180	200	220
				int	180	220	270	310	350	400	440
		100	end	int	100	120	140	170	190	210	240
				int	190	240	290	330	380	430	470
	100	.05-.30	0-100	end	80	100	120	140	160	180	200
				int	160	200	240	280	320	360	400
		.40	0-70	end	80	100	120	140	160	180	200
				int	160	200	240	280	320	360	400
80		end	int	80	100	120	140	160	180	200	
			int	170	210	250	290	330	370	410	
90	end	int	90	110	130	160	180	200	220		
		int	180	220	270	310	350	400	440		
100	end	int	100	120	140	170	190	210	240		
		int	190	240	290	330	380	430	470		
110	All Seismic	end	int	100	120	150	170	200	220	240	
			int	200	240	290	340	390	440	490	
Coastal	80	.05-.20	0-100	end	60	70	90	100	110	130	140
				int	110	140	170	200	230	260	280
	.30	0-70	end	60	70	90	100	110	130	140	
			int	110	140	170	200	230	260	280	
	80	end	int	60	80	90	110	120	140	150	
			int	120	160	190	220	250	280	310	
	90	end	int	70	80	100	120	130	150	170	
			int	130	170	200	230	270	300	330	
	100	end	int	70	90	110	130	140	160	180	
			int	150	180	220	250	290	320	360	

table continues

Note: All Seismic refers to all values of Aa and all magnitudes of ground snow load.

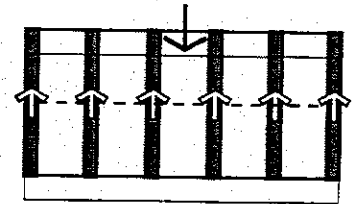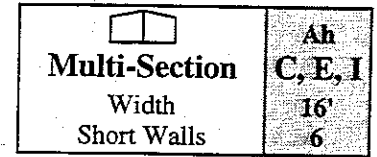

A_h C, E, I 16' 6	 Multi-Section Width Short Walls
--	---

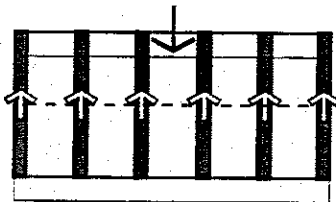

Required Horizontal Anchorage - A_h - Transverse Direction (lbs/ft)

	Wind Speed (mph)	Seismic Δ _a	Ground Snow (psf)	Location	Length (ft)											
					40	50	60	70	80	90	100					
Coastal	80	.40	0	end	60	70	90	100	110	130	140					
					int	110	140	170	200	230	260	280				
				50	end	60	80	90	110	120	140	150				
					int	130	160	190	220	250	280	310				
				60	end	70	90	100	120	140	150	170				
					int	140	170	210	240	270	310	340				
				70	end	80	100	110	130	150	170	190				
					int	150	190	230	260	300	340	370				
				80	end	80	100	120	140	160	180	200				
					int	170	210	250	290	330	370	410				
				90	end	90	110	130	160	180	200	220				
					int	180	220	270	310	350	400	440				
				100	end	100	120	140	170	190	210	240				
					int	190	240	290	330	380	430	470				
				90	.05-.20	0-100	end	70	90	110	130	140	160	180		
								int	140	180	220	250	290	330	360	
							.30	0-90	end	70	90	110	130	140	160	180
										int	140	180	220	250	290	330
							100	end	70	90	110	130	140	160	180	
									int	150	180	220	250	290	330	360
							.40	0-60	end	70	90	110	130	140	160	180
										int	140	180	220	250	290	330
							70	end	80	100	110	130	150	170	190	
									int	150	190	230	260	300	340	370
80	end	80	100				120	140	160	180	200					
		int	170				210	250	290	330	370	410				
90	end	90	110	130	160	180	200	220								
		int	180	220	270	310	350	400	440							
100	end	100	120	140	170	190	210	240								
		int	190	240	290	330	380	430	470							
100	.05-.30	0-100	end	90	110	130	160	180	200	220						
				int	180	220	270	310	360	400	450					
			.40	0-90	end	90	110	130	160	180	200	220				
						int	180	220	270	310	360	400	450			
			100	end	100	120	140	170	190	210	240					
					int	190	240	290	330	380	430	470				
110	All Seismic	end	110	140	160	190	220	240	270							
			int	220	270	320	380	430	490	540						

Note: All Seismic refers to all values of A_a and all magnitudes of ground snow load.

Part 4 Required Horizontal Anchorage - Ah - Longitudinal Direction

Single-Section C, E, I

Required Horizontal Anchorage - Ah - Longitudinal Direction (lbs/ft)

Seismic Ground Aa	Snow (psf)	Wind Speed (mph)	Length (ft)								
			40	50	60	70	80	90	100		
.05-.10	0-100	Inland	80	34	27	23	20	17	15	14	
			90	43	35	29	25	22	19	17	
			100	54	43	36	31	27	24	21	
			110	65	52	43	37	32	29	26	
		Coastal	80	38	30	25	22	19	17	15	
			90	48	38	32	27	24	21	19	
			100	59	47	39	34	30	26	24	
			110	71	57	48	41	36	32	29	
	.15	0-40	Inland	80	34	27	23	20	17	17	17
				90	43	35	29	25	22	19	17
				100	54	43	36	31	27	24	21
				110	65	52	43	37	32	29	26
Coastal			80	38	30	25	22	19	17	17	
			90	48	38	32	27	24	21	19	
			100	59	47	39	34	30	26	24	
			110	71	57	48	41	36	32	29	
50		Inland	80	36	36	35	35	35	35	35	
			90	43	36	35	35	35	35	35	
			100	54	43	36	35	35	35	35	
			110	65	52	43	37	35	35	35	
	Coastal	80	38	36	35	35	35	35	35		
		90	48	38	35	35	35	35	35		
		100	59	47	39	35	35	35	35		
		110	71	57	48	41	36	35	35		
60	Inland	80	40	39	39	39	39	39	39		
		90	43	39	39	39	39	39	39		
		100	54	43	39	39	39	39	39		
		110	65	52	43	39	39	39	39		
	Coastal	80	40	39	39	39	39	39	39		
		90	48	39	39	39	39	39	39		
		100	59	47	39	39	39	39	39		
		110	71	57	48	41	39	39	39		
	70	Inland	80-90	43	43	43	43	43	42	42	
			100	54	43	43	43	43	42	42	
			110	65	52	43	43	43	42	42	
		Coastal	80	43	43	43	43	43	42	42	
90			48	43	43	43	43	42	42		
100			59	47	43	43	43	42	42		
			110	71	57	48	43	43	42	42	



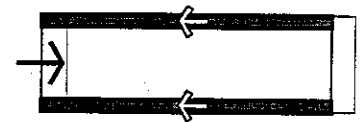


table continues

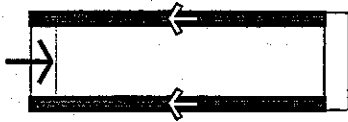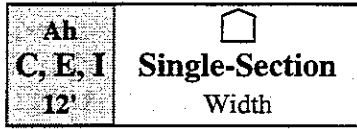

Required Horizontal Anchorage - Ah - Longitudinal Direction (lbs/ft)

Seismic Ground Aa	Snow (psf)	Wind Speed (mph)	Length (ft)								
			40	50	60	70	80	90	100		
.15	80	Inland	80-90	47	47	46	46	46	46	46	46
			100	54	47	46	46	46	46	46	46
			110	65	52	46	46	46	46	46	46
		Coastal	80	47	47	46	46	46	46	46	46
			90	48	47	46	46	46	46	46	46
			100	59	47	46	46	46	46	46	46
	90	Inland	80-90	50	50	50	50	50	50	50	50
			100	54	50	50	50	50	50	50	50
			110	65	52	50	50	50	50	50	50
		Coastal	80-90	50	50	50	50	50	50	50	50
			100	59	50	50	50	50	50	50	50
			110	71	57	50	50	50	50	50	50
100	Inland	80-100	54	54	54	54	53	53	53	53	
		110	65	54	54	54	53	53	53	53	
		Coastal	80-90	54	54	54	54	53	53	53	53
	100		59	54	54	54	53	53	53	53	
	110		71	57	54	54	53	53	53	53	
	.20	0-40	Inland	80	34	27	23	23	23	23	23
90				43	35	29	25	23	23	23	23
100				54	43	36	31	27	24	23	23
Coastal			80	38	30	25	23	23	23	23	23
			90	48	38	32	27	24	23	23	23
			100	59	47	39	34	30	26	24	24
50		Inland	80-90	48	48	47	47	47	47	47	47
			100	54	48	47	47	47	47	47	47
			110	65	52	47	47	47	47	47	47
		Coastal	80-90	48	48	47	47	47	47	47	47
			100	59	48	47	47	47	47	47	47
			110	71	57	48	47	47	47	47	47
60		Inland	80-90	53	52	52	52	52	52	52	52
			100	54	52	52	52	52	52	52	52
			110	65	52	52	52	52	52	52	52
		Coastal	80-90	53	52	52	52	52	52	52	52
			100	59	52	52	52	52	52	52	52
			110	71	57	52	52	52	52	52	52
70	Inland	80-100	58	57	57	57	57	57	57	57	
		110	65	57	57	57	57	57	57	57	
		Coastal	80-90	58	57	57	57	57	57	57	57
	100		59	57	57	57	57	57	57	57	
	110		71	57	57	57	57	57	57	57	

table continues

Required Horizontal Anchorage - Ah - Longitudinal Direction (lbs/ft)

Seismic Aa	Ground Snow (psf)	Wind Speed (mph)	Length (ft)								
			40	50	60	70	80	90	100		
.20	80	Inland 80-100	62	62	62	62	62	61	61		
			65	62	62	62	62	61	61		
		Coastal 80-100	62	62	62	62	62	61	61		
			71	62	62	62	62	61	61		
	90	Inland 80-110	67	67	67	67	66	66	66		
			67	67	67	67	66	66	66		
	Coastal 80-100	67	67	67	67	66	66	66			
		71	67	67	67	66	66	66			
	100	All Wind	72	72	72	71	71	71	71		
	.30	0-40	Inland 80	36	35	35	34	34	34	34	
90				43	35	35	34	34	34	34	
100				54	43	36	34	34	34	34	
110				65	52	43	37	34	34	34	
Coastal 80			38	35	35	34	34	34	34		
			90	48	38	35	34	34	34	34	
			100	59	47	39	34	34	34	34	
			110	71	57	48	41	36	34	34	
50			All Wind	72	71	71	71	71	70	70	
60			All Wind	79	79	78	78	78	78	78	
70			All Wind	86	86	86	85	85	85	85	
80			All Wind	94	93	93	93	92	92	92	
90		All Wind	101	100	100	100	100	99	99		
100		All Wind	108	108	107	107	107	107	107		
.40		0-40	Inland 80-90	47	47	46	46	46	45	45	
				100	54	47	46	46	46	45	45
				110	65	52	46	46	46	45	45
			Coastal 80	47	47	46	46	46	45	45	
	90			48	47	46	46	46	45	45	
	100			59	47	46	46	46	45	45	
	110	71	57	48	46	46	45	45			
	50	All Wind	96	95	95	94	94	94	94		
	60	All Wind	106	105	104	104	104	104	103		
	70	All Wind	115	115	114	114	113	113	113		
80	All Wind	125	124	124	123	123	123	123			
90	All Wind	135	134	133	133	133	133	132			
100	All Wind	144	144	143	143	142	142	142			



Ah C, E, I 14'	 Single-Section Width
----------------------	---

Required Horizontal Anchorage - Ah - Longitudinal Direction (lbs/ft)



Seismic Aa	Ground Snow (psf)	Wind Speed (mph)	Length (ft)							
			40	50	60	70	80	90	100	
.05-.10	0-100	Inland	80	41	33	27	23	20	18	16
			90	52	41	35	30	26	23	21
			100	64	51	43	37	32	28	26
			110	77	62	52	44	39	34	31
		Coastal	80	45	36	30	26	23	20	18
			90	57	46	38	33	29	25	23
			100	71	56	47	40	35	31	28
			110	85	68	57	49	43	38	34
.15	0-40	Inland	80	41	33	27	23	20	19	19
			90	52	41	35	30	26	23	21
			100	64	51	43	37	32	28	26
			110	77	62	52	44	39	34	31
		Coastal	80	45	36	30	26	23	20	19
			90	57	46	38	33	29	25	23
			100	71	56	47	40	35	31	28
			110	85	68	57	49	43	38	34
	50	Inland	80	41	41	41	41	40	40	40
			90	52	41	41	41	40	40	40
			100	64	51	43	41	40	40	40
			110	77	62	52	44	40	40	40
		Coastal	80	45	41	41	41	40	40	40
			90	57	46	41	41	40	40	40
			100	71	56	47	41	40	40	40
			110	85	68	57	49	43	40	40
60	Inland	80	45	45	45	45	45	45	44	
		90	52	45	45	45	45	45	44	
		100	64	51	45	45	45	45	44	
		110	77	62	52	45	45	45	44	
	Coastal	80	45	45	45	45	45	45	44	
		90	57	46	45	45	45	45	44	
		100	71	56	47	45	45	45	44	
		110	85	68	57	49	45	45	44	
70	Inland	80	50	49	49	49	49	49	49	
		90	52	49	49	49	49	49	49	
		100	64	51	49	49	49	49	49	
		110	77	62	52	49	49	49	49	
	Coastal	80	50	49	49	49	49	49	49	
		90	57	49	49	49	49	49	49	
		100	71	56	49	49	49	49	49	
		110	85	68	57	49	49	49	49	

table continues

Required Horizontal Anchorage - Ah - Longitudinal Direction (lbs/ft)

Seismic Aa	Ground Snow (psf)	Wind Speed (mph)		Length (ft)								
				40	50	60	70	80	90	100		
.15	80	Inland	80-90	54	54	53	53	53	53	53	53	
			100	64	54	53	53	53	53	53	53	
			110	77	62	53	53	53	53	53	53	
		Coastal	80	54	54	53	53	53	53	53	53	
			90	57	54	53	53	53	53	53	53	
			100	71	56	53	53	53	53	53	53	
	90	Inland	80-90	58	58	58	57	57	57	57	57	
			100	64	58	58	57	57	57	57	57	
			110	77	62	58	57	57	57	57	57	
		Coastal	80-90	58	58	58	57	57	57	57	57	
			100	71	58	58	57	57	57	57	57	
			110	85	68	58	57	57	57	57	57	
	100	Inland	80-90	62	62	62	62	62	61	61	61	
			100	64	62	62	62	62	61	61	61	
			110	77	62	62	62	62	61	61	61	
		Coastal	80-90	62	62	62	62	62	61	61	61	
			100	71	62	62	62	62	61	61	61	
			110	85	68	62	62	62	61	61	61	
.20	0-40	Inland	80	41	33	27	26	26	25	25		
			90	52	41	35	30	26	25	25		
			100	64	51	43	37	32	28	26		
		Coastal	80	45	36	30	26	26	25	25		
			90	57	46	38	33	29	25	25		
			100	71	56	47	40	35	31	28		
		110	85	68	57	49	43	38	34	31		
			50	Inland	80-90	55	55	54	54	54	54	54
					100	64	55	54	54	54	54	54
		110			77	62	54	54	54	54	54	
		Coastal		80	55	55	54	54	54	54	54	
				90	57	55	54	54	54	54	54	
	100			71	56	54	54	54	54	54		
	110	85	68	57	54	54	54	54	54			
		60	Inland	80-90	61	60	60	60	60	59	59	
				100	64	60	60	60	60	59	59	
	110			77	62	60	60	60	59	59		
	Coastal		80-90	61	60	60	60	60	59	59		
			100	71	60	60	60	60	59	59		
			110	85	68	60	60	60	59	59		
	70	Inland	80-100	66	66	66	65	65	65	65		
			110	77	66	66	65	65	65	65		
			Coastal	80-90	66	66	66	65	65	65	65	
		100	71	66	66	65	65	65	65	65		
110			85	68	66	65	65	65	65	65		

table continues

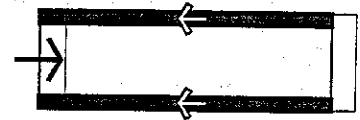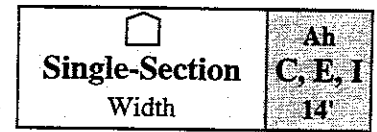



Required Horizontal Anchorage - Ah - Longitudinal Direction (lbs/ft)

Seismic Ground Aa	Snow (psf)	Wind Speed (mph)	Length (ft)								
			40	50	60	70	80	90	100		
.20	80	Inland 80-100	72	71	71	71	71	71	71		
			110	77	71	71	71	71	71		
		Coastal 80-100	72	71	71	71	71	71	71		
			110	85	71	71	71	71	71		
		90	Inland 80-110	78	77	77	77	76	76	76	
				Coastal 80-100	78	77	77	77	76	76	76
	100	Inland 80-110	83	83	82	82	82	82	82		
			Coastal 80-100	83	83	82	82	82	82	82	
	.30	0-40	Inland	80	41	39	39	39	38	38	38
				90	52	41	39	39	38	38	38
				100	64	51	43	39	38	38	38
				110	77	62	52	44	39	38	38
Coastal			80	45	39	39	39	38	38	38	
			90	57	46	39	39	38	38	38	
			100	71	56	47	40	38	38	38	
			110	85	68	57	49	43	38	38	
50			Inland 80-110	82	82	81	81	81	81	80	
				Coastal 80-100	82	82	81	81	81	81	80
60			All Wind	91	90	90	89	89	89	89	
				99	99	98	98	98	98	97	
80		All Wind	108	107	107	106	106	106	106		
			116	116	115	115	115	115	114		
100		All Wind	125	124	124	123	123	123	123		
			110	109	108	108	108	107	107		
.40		0-40	Inland 80-90	53	52	52	51	51	51	51	
				100	64	52	52	51	51	51	
				110	77	62	52	51	51	51	
			Coastal	80	53	52	52	51	51	51	51
				90	57	52	52	51	51	51	51
				100	71	56	52	51	51	51	51
				110	85	68	57	51	51	51	51
			50	All Wind	110	109	108	108	108	107	107
	121				120	120	119	119	119	119	
	70		All Wind	133	132	131	131	130	130	130	
				144	143	142	142	142	141	141	
	90		All Wind	155	154	154	153	153	153	152	
		166		166	165	165	164	164	164		

Required Horizontal Anchorage - Ah - Longitudinal Direction (lbs/ft)



Seismic Aa	Ground Snow (psf)	Wind Speed (mph)	Length (ft)							
			40	50	60	70	80	90	100	
.05-.10	0-100	Inland	80	47	38	32	27	24	21	19
			90	60	48	40	34	30	27	24
			100	74	59	49	42	37	33	30
			110	89	72	60	51	45	40	36
		Coastal	80	52	42	35	30	26	23	21
			90	66	53	44	38	33	29	26
			100	82	65	54	47	41	36	33
			110	99	79	66	56	49	44	39
.15	0-40	Inland	80	47	38	32	27	24	21	21
			90	60	48	40	34	30	27	24
			100	74	59	49	42	37	33	30
			110	89	72	60	51	45	40	36
		Coastal	80	52	42	35	30	26	23	21
			90	66	53	44	38	33	29	26
			100	82	65	54	47	41	36	33
			110	99	79	66	56	49	44	39
	50	Inland	80	47	46	46	46	46	45	45
			90	60	48	46	46	46	45	45
			100	74	59	49	46	46	45	45
			110	89	72	60	51	46	45	45
		Coastal	80	52	46	46	46	46	45	45
			90	66	53	46	46	46	45	45
			100	82	65	54	47	46	45	45
			110	99	79	66	56	49	45	45
60	Inland	80	51	51	51	51	50	50	50	
		90	60	51	51	51	50	50	50	
		100	74	59	51	51	50	50	50	
		110	89	72	60	51	50	50	50	
	Coastal	80	52	51	51	51	50	50	50	
		90	66	53	51	51	50	50	50	
		100	82	65	54	51	50	50	50	
		110	99	79	66	56	50	50	50	
70	Inland	80	56	56	56	55	55	55	55	
		90	60	56	56	55	55	55	55	
		100	74	59	56	55	55	55	55	
		110	89	72	60	55	55	55	55	
	Coastal	80	56	56	56	55	55	55	55	
		90	66	56	56	55	55	55	55	
		100	82	65	56	55	55	55	55	
		110	99	79	66	56	55	55	55	

table continues



Required Horizontal Anchorage - Ah - Longitudinal Direction (lbs/ft)

Seismic Aa	Ground Snow (psf)	Wind Speed (mph)	Length (ft)									
			40	50	60	70	80	90	100			
.15	80	Inland	80-90	61	61	60	60	60	60	60	60	
			100	74	61	60	60	60	60	60	60	
			110	89	72	60	60	60	60	60	60	
		Coastal	80	61	61	60	60	60	60	60	60	
			90	66	61	60	60	60	60	60	60	
			100	82	65	60	60	60	60	60	60	
	90	Inland	80-90	66	65	65	65	65	65	65	65	
			100	74	65	65	65	65	65	65	65	
			110	89	72	65	65	65	65	65	65	
		Coastal	80-90	66	65	65	65	65	65	65	65	
			100	82	65	65	65	65	65	65	65	
			110	99	79	66	65	65	65	65	65	
100	Inland	80-90	71	70	70	70	70	70	70	70		
		100	74	70	70	70	70	70	70	70		
		110	89	72	70	70	70	70	70	70		
	Coastal	80-90	71	70	70	70	70	70	70	70		
		100	82	70	70	70	70	70	70	70		
		110	99	79	70	70	70	70	70	70		
.20	0-40	Inland	80	47	38	32	29	28	28	28		
			90	60	48	40	34	30	28	28		
			100	74	59	49	42	37	33	30		
			110	89	72	60	51	45	40	36		
			Coastal	80	52	42	35	30	28	28	28	
				90	66	53	44	38	33	29	28	
		100		82	65	54	47	41	36	33		
		110		99	79	66	56	49	44	39		
		50		Inland	80-90	62	61	61	61	61	61	60
					100	74	61	61	61	61	61	60
			110		89	72	61	61	61	61	60	
			Coastal	80	62	61	61	61	61	61	60	
	90			66	61	61	61	61	61	60		
	100			82	65	61	61	61	61	60		
	60	Inland	80-90	68	68	68	67	67	67	67		
			100	74	68	68	67	67	67	67		
			110	89	72	68	67	67	67	67		
		Coastal	80-90	68	68	68	67	67	67	67		
			100	82	68	68	67	67	67	67		
			110	99	79	68	67	67	67	67		
	70	Inland	80-100	75	74	74	74	74	73	73		
			110	89	74	74	74	74	73	73		
			Coastal	80-90	75	74	74	74	74	73	73	
		Coastal	100	82	74	74	74	74	73	73		
110			99	79	74	74	74	73	73			


table continues

Required Horizontal Anchorage - Ah - Longitudinal Direction (lbs/ft)

Seismic Aa	Ground Snow (psf)	Wind Speed (mph)	Length (ft)								
			40	50	60	70	80	90	100		
.20	80	Inland 80-100	81	81	81	80	80	80	80		
			89	81	81	80	80	80	80		
		Coastal 80-90	81	81	81	80	80	80	80		
			100	82	81	81	80	80	80		
			110	99	81	81	80	80	80		
			110	99	81	81	80	80	80		
	90	Inland 80-100	88	87	87	87	87	86	86		
			110	89	87	87	87	87	86	86	
		Coastal 80-100	88	87	87	87	87	86	86		
			110	99	87	87	87	87	86	86	
	100	Inland 80-110	94	94	93	93	93	93	93		
			110	99	94	93	93	93	93		
Coastal 80-100		94	94	93	93	93	93	93			
.30	0-40	Inland 80	47	44	43	43	43	42	42		
			90	60	48	43	43	43	42	42	
			100	74	59	49	43	43	42	42	
			110	89	72	60	51	45	42	42	
		Coastal 80	52	44	43	43	43	42	42		
			90	66	53	44	43	43	42	42	
			100	82	65	54	47	43	42	42	
			110	99	79	66	56	49	44	42	
		50	Inland 80-110	93	92	92	91	91	91	91	
				110	99	92	92	91	91	91	
			Coastal 80-100	93	92	92	91	91	91	91	
		60	All Wind	103	102	101	101	101	101	100	
	70	All Wind	112	112	111	111	110	110	110		
	80	All Wind	122	121	121	120	120	120	120		
	90	All Wind	132	131	130	130	130	129			
	100	All Wind	141	141	140	140	140	139	139		
	.40	0-40	Inland 80	59	58	58	57	57	56	56	
				90	60	58	58	57	57	56	56
				100	74	59	58	57	57	56	56
				110	89	72	60	57	57	56	56
			Coastal 80	59	58	58	57	57	56	56	
				90	66	58	58	57	57	56	56
				100	82	65	58	57	57	56	56
				110	99	79	66	57	57	56	56
50			All Wind	124	123	122	122	121	121	121	
60			All Wind	137	136	135	135	134	134	134	
70			All Wind	150	149	148	148	147	147	147	
80			All Wind	163	162	161	161	160	160	160	
90		All Wind	176	175	174	173	173	173	173		
100		All Wind	189	188	187	186	186	186	185		



Multi-Section C, E, I

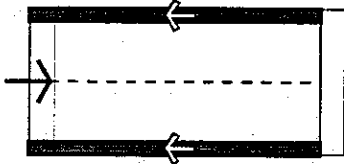

Required Horizontal Anchorage - Ah - Longitudinal Direction (lbs/ft)


Seismic Ground Aa	Snow p	Wind Speed (mph)	Length (ft)								
			40	50	60	70	80	90	100		
.05-.10	0-10	Inland	80	82	66	55	47	41	37	33	
			90	104	83	70	60	52	46	42	
			100	129	103	86	74	64	57	51	
		Coastal	110	156	125	104	89	78	69	62	
			80	91	73	61	52	45	40	36	
			90	115	92	77	66	57	51	46	
	.15	0-40	Inland	100	142	114	95	81	71	63	57
				110	172	137	114	98	86	76	69
				80	91	73	61	52	45	40	36
			Coastal	90	115	92	77	66	57	51	46
				100	142	114	95	81	71	63	57
				110	172	137	114	98	86	76	69
50	Inland	80	82	70	70	69	69	69	69		
		90	104	83	70	69	69	69	69		
		100	129	103	86	74	69	69	69		
		110	156	125	104	89	78	69	69		
		Coastal	80	91	73	70	69	69	69	69	
			90	115	92	77	69	69	69	69	
	100		142	114	95	81	71	69	69		
	60	Inland	110	172	137	114	98	86	76	69	
			80	82	77	77	77	76	76	76	
			90	104	83	77	77	76	76	76	
		Coastal	100	129	103	86	77	76	76	76	
			110	156	125	104	89	78	76	76	
80			91	77	77	77	76	76	76		
70	Inland	90	115	92	77	77	76	76	76		
		100	142	114	95	81	76	76	76		
		110	172	137	114	98	86	76	76		
		80	85	85	84	84	84	84	83		
		90	104	85	84	84	84	84	83		
		100	129	103	86	84	84	84	83		
	Coastal	110	156	125	104	89	84	84	83		
		80	91	85	84	84	84	84	83		
		90	115	92	84	84	84	84	83		
		100	142	114	95	84	84	84	83		
		110	172	137	114	98	86	84	83		
		80	82	77	77	77	76	76	76		


table continues

Required Horizontal Anchorage - Ah - Longitudinal Direction (lbs/ft)

Seismic Aa	Ground Snow (psf)	Wind Speed (mph)	Length (ft)							
			40	50	60	70	80	90	100	
.15	80	Inland	80	93	92	91	91	91	91	91
			90	104	92	91	91	91	91	91
			100	129	103	91	91	91	91	91
			110	156	125	104	91	91	91	91
		Coastal	80	93	92	91	91	91	91	91
			90	115	92	91	91	91	91	91
	90	Inland	80	100	99	99	98	98	98	98
			90	104	99	99	98	98	98	98
			100	129	103	99	98	98	98	98
			110	156	125	104	98	98	98	98
		Coastal	80	100	99	99	98	98	98	98
			90	115	99	99	98	98	98	98
100	Inland	80-90	107	106	106	106	105	105	105	
		100	129	106	106	106	105	105	105	
		110	156	125	106	106	105	105	105	
		Coastal	80	107	106	106	106	105	105	105
	90		115	106	106	106	105	105	105	
	100	142	114	106	106	105	105	105		
.20	0-40	Inland	80	82	66	55	47	44	43	43
			90	104	83	70	60	52	46	43
			100	129	103	86	74	64	57	51
			110	156	125	104	89	78	69	62
		Coastal	80	91	73	61	52	45	43	43
			90	115	92	77	66	57	51	46
	50	Inland	80	94	93	93	92	92	92	92
			90	104	93	93	92	92	92	92
			100	129	103	93	92	92	92	92
			110	156	125	104	92	92	92	92
		Coastal	80	94	93	93	92	92	92	92
			90	115	93	93	92	92	92	92
60	Inland	80-90	104	103	103	102	102	102	101	
		100	129	103	103	102	102	102	101	
		110	156	125	104	102	102	102	101	
		Coastal	80	104	103	103	102	102	102	101
	90		115	103	103	102	102	102	101	
	100	142	114	103	102	102	102	101		
110	172	137	114	102	102	102	101			

table continues

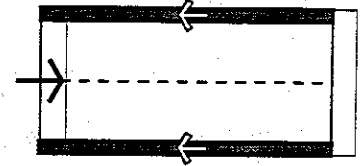

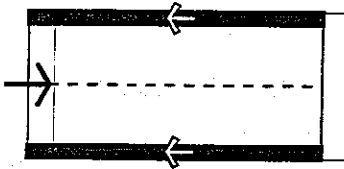


Required Horizontal Anchorage - Ah - Longitudinal Direction (lbs/ft)

Seismic Aa	Ground Snow (psf)	Wind Speed (mph)	Length (ft)								
			40	50	60	70	80	90	100		
.20	70	Inland	80-90	114	113	112	112	112	111	111	
			100	129	113	112	112	112	111	111	
			110	156	125	112	112	112	111	111	
		Coastal	80	114	113	112	112	112	111	111	
			90	115	113	112	112	112	111	111	
			100	142	114	112	112	112	111	111	
	80	Inland	80-90	123	123	122	122	121	121	121	
			100	129	123	122	122	121	121	121	
			110	156	125	122	122	121	121	121	
		Coastal	80-90	123	123	122	122	121	121	121	
			100	142	123	122	122	121	121	121	
			110	172	137	122	122	121	121	121	
	90	Inland	80-100	133	132	132	131	131	131	131	
			110	156	132	132	131	131	131	131	
			Coastal	80-90	133	132	132	131	131	131	131
		100		142	132	132	131	131	131	131	
		110		172	137	132	131	131	131	131	
		100	Inland	80-100	143	142	141	141	141	140	140
110	156			142	141	141	141	140	140		
Coastal	80-100			143	142	141	141	141	140	140	
	110		172	142	141	141	141	140	140		
.30	0-40		Inland	80	82	67	67	66	66	65	65
		90		104	83	70	66	66	65	65	
		100		129	103	86	74	66	65	65	
		110		156	125	104	89	78	69	65	
		Coastal	80	91	73	67	66	66	65	65	
			90	115	92	77	66	66	65	65	
			100	142	114	95	81	71	65	65	
			110	172	137	114	98	86	76	69	
		50	Inland	80-100	141	140	139	139	138	138	138
				110	156	140	139	139	138	138	138
			Coastal	80-90	141	140	139	139	138	138	138
				100	142	140	139	139	138	138	138
	60	Inland	80-110	156	155	154	153	153	152	152	
			110	172	155	154	153	153	152	152	
		Coastal	80-100	156	155	154	153	153	152	152	
			110	172	155	154	153	153	152	152	
	70	Inland	80-110	170	169	168	168	167	167	167	
			110	172	169	168	168	167	167	167	
		Coastal	80-100	170	169	168	168	167	167	167	
			110	172	169	168	168	167	167	167	
	80	All Wind	185	184	183	182	182	182	181		
	90	All Wind	200	198	197	197	196	196	196		
	100	All Wind	214	213	212	211	211	211	210		

table continues

Required Horizontal Anchorage - Ah - Longitudinal Direction (lbs/ft)

Seismic Ground Aa	Snow (psf)	Wind Speed (mph)	Length (ft)							
			40	50	60	70	80	90	100	
.40	0-40	Inland	80	92	90	89	88	87	87	87
			90	104	90	89	88	87	87	87
			100	129	103	89	88	87	87	87
			110	156	125	104	89	87	87	87
		Coastal	80	92	90	89	88	87	87	87
			90	115	92	89	88	87	87	87
			100	142	114	95	88	87	87	87
			110	172	137	114	98	87	87	87
	50	All Wind	189	187	186	185	184	184	184	
	60	All Wind	208	206	205	204	204	203	203	
	70	All Wind	227	226	225	224	223	223	222	
	80	All Wind	247	245	244	243	243	242	242	
	90	All Wind	266	264	263	263	262	261	261	
	100	All Wind	285	284	283	282	281	281	280	

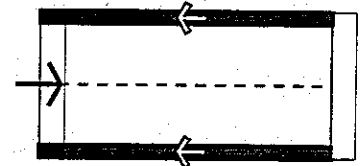


Required Horizontal Anchorage - Ah - Longitudinal Direction (lbs/ft)

Seismic Ground Aa	Snow (psf)	Wind Speed (mph)	Length (ft)								
			40	50	60	70	80	90	100		
.05-.10	0-100	Inland	80	100	80	67	57	50	44	40	
			90	127	101	84	72	63	56	51	
			100	156	125	104	89	78	69	62	
			110	189	151	126	108	94	84	76	
		Coastal	80	110	88	73	63	55	49	44	
			90	139	112	93	80	70	62	56	
			100	172	138	115	98	86	77	69	
			110	208	167	139	119	104	93	83	
	.15	0-40	Inland	80	100	80	67	57	50	44	40
				90	127	101	84	72	63	56	51
				100	156	125	104	89	78	69	62
				110	189	151	126	108	94	84	76
			Coastal	80	110	88	73	63	55	49	44
				90	139	112	93	80	70	62	56
100				172	138	115	98	86	77	69	
110				208	167	139	119	104	93	83	
50		Inland	80	100	81	80	80	79	79	79	
			90	127	101	84	80	79	79	79	
			100	156	125	104	89	79	79	79	
			110	189	151	126	108	94	84	79	
		Coastal	80	110	88	80	80	79	79	79	
			90	139	112	93	80	79	79	79	
	100		172	138	115	98	86	79	79		
	110		208	167	139	119	104	93	83		



table continues

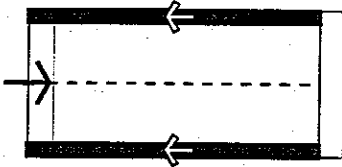

Required Horizontal Anchorage - Ah - Longitudinal Direction (lbs/ft)


Seismic Ground Aa	Snow (psf)	Wind Speed (mph)	Length (ft)							
			40	50	60	70	80	90	100	
.15	60	Inland	80	100	89	89	88	88	88	88
			90	127	101	89	88	88	88	88
			100	156	125	104	89	88	88	88
		Coastal	110	189	151	126	108	94	88	88
			80	110	89	89	88	88	88	88
			90	139	112	93	88	88	88	88
	70	Inland	100	172	138	115	98	88	88	88
			110	208	167	139	119	104	93	88
			80	100	98	97	97	96	96	96
		Coastal	90	127	101	97	97	96	96	96
			100	156	125	104	97	96	96	96
			110	189	151	126	108	96	96	96
80	80	Inland	80	107	106	106	105	105	105	105
			90	127	106	106	105	105	105	105
			100	156	125	106	105	105	105	105
		Coastal	110	189	151	126	108	105	105	105
			80	110	106	106	105	105	105	105
			90	139	112	106	105	105	105	105
	90	Inland	100	172	138	115	105	105	105	105
			110	208	167	139	119	105	105	105
			80	115	115	114	114	113	113	113
		Coastal	90	127	115	114	114	113	113	113
			100	156	125	114	114	113	113	113
			110	189	151	126	114	113	113	113
100	100	Inland	80	124	123	122	122	122	122	121
			90	127	123	122	122	122	122	121
			100	156	125	122	122	122	122	121
		Coastal	110	189	151	126	122	122	122	121
			80	124	123	122	122	122	122	121
			90	139	123	122	122	122	122	121
	100	Inland	100	172	138	122	122	122	122	121
			110	208	167	139	122	122	122	121
			80	124	123	122	122	122	122	121
		Coastal	90	139	123	122	122	122	122	121
			100	172	138	122	122	122	122	121
			110	208	167	139	122	122	122	121


table continues

Required Horizontal Anchorage - Ah - Longitudinal Direction (lbs/ft)

Seismic Aa	Ground Snow (psf)	Wind Speed (mph)	Length (ft)							
			40	50	60	70	80	90	100	
.20	0-40	Inland	80	100	80	67	57	50	49	49
			90	127	101	84	72	63	56	51
			100	156	125	104	89	78	69	62
		Coastal	80	110	88	73	63	55	49	49
			90	139	112	93	80	70	62	56
			100	172	138	115	98	86	77	69
	50	Inland	80	108	107	107	106	106	106	105
			90	127	107	107	106	106	106	105
			100	156	125	107	106	106	106	105
		Coastal	80	110	107	107	106	106	106	105
			90	139	112	107	106	106	106	105
			100	172	138	115	106	106	106	105
60	Inland	80	120	119	118	118	117	117	117	
		90	127	119	118	118	117	117	117	
		100	156	125	118	118	117	117	117	
	Coastal	80	120	119	118	118	117	117	117	
		90	139	119	118	118	117	117	117	
		100	172	138	118	118	117	117	117	
70	Inland	80-90	131	130	129	129	129	128	128	
		100	156	130	129	129	129	128	128	
		110	189	151	129	129	129	128	128	
	Coastal	80	131	130	129	129	129	128	128	
		90	139	130	129	129	129	128	128	
		100	172	138	129	129	129	128	128	
80	Inland	80-90	142	141	141	140	140	140	139	
		100	156	141	141	140	140	140	139	
		110	189	151	141	140	140	140	139	
	Coastal	80-90	142	141	141	140	140	140	139	
		100	172	141	141	140	140	140	139	
		110	208	167	141	140	140	140	139	
90	Inland	80-90	154	153	152	152	151	151	151	
		100	156	153	152	152	151	151	151	
		110	189	153	152	152	151	151	151	
	Coastal	80-90	154	153	152	152	151	151	151	
		100	172	153	152	152	151	151	151	
		110	208	167	152	152	151	151	151	

table continues

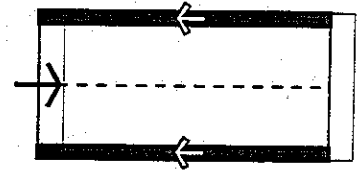

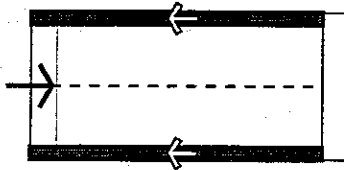

Required Horizontal Anchorage - Ah - Longitudinal Direction (lbs/ft)


Seismic Aa	Ground Snow (psf)	Wind Speed (mph)	Length (ft)								
			40	50	60	70	80	90	100		
.20	100	Inland	80-100	165	164	163	163	162	162	162	
			110	189	164	163	163	162	162	162	
		Coastal	80-90	165	164	163	163	162	162	162	
			100	172	164	163	163	162	162	162	
			110	208	167	163	163	162	162	162	
	.30	0-40	Inland	80	100	80	75	75	74	74	73
				90	127	101	84	75	74	74	73
				100	156	125	104	89	78	74	73
				110	189	151	126	108	94	84	76
			Coastal	80	110	88	75	75	74	74	73
				90	139	112	93	80	74	74	73
100	172			138	115	98	86	77	73		
110	208			167	139	119	104	93	83		
50	Inland		80-100	163	161	160	159	159	158	158	
			110	189	161	160	159	159	158	158	
	Coastal		80-90	163	161	160	159	159	158	158	
			100	172	161	160	159	159	158	158	
		110	208	167	160	159	159	158	158		
60	Inland	80-100	180	178	177	176	176	175	175		
		110	189	178	177	176	176	175	175		
	Coastal	80-100	180	178	177	176	176	175	175		
		110	208	178	177	176	176	175	175		
70	Inland	80-110	197	195	194	193	193	192	192		
	Coastal	80-100	197	195	194	193	193	192	192		
		110	208	195	194	193	193	192	192		
80	All Wind	214	212	211	210	210	209	209			
90	All Wind	231	229	228	227	227	226	226			
100	All Wind	247	246	245	244	244	243	243			
.40	0-40	Inland	80	104	102	100	100	99	98	98	
			90	127	102	100	100	99	98	98	
			100	156	125	104	100	99	98	98	
			110	189	151	126	108	99	98	98	
		Coastal	80	110	102	100	100	99	98	98	
			90	139	112	100	100	99	98	98	
			100	172	138	115	100	99	98	98	
			110	208	167	139	119	104	98	98	
		50	All Wind	217	215	214	213	212	211	211	
		60	All Wind	240	237	236	235	234	234	233	
		70	All Wind	262	260	259	258	257	257	256	
		80	All Wind	285	283	281	280	280	279	279	
	90	All Wind	307	305	304	303	302	302	301		
	100	All Wind	330	328	327	326	325	324	324		

Required Horizontal Anchorage - Ah - Longitudinal Direction (lbs/ft)



Seismic Aa	Ground Snow (psf)	Wind Speed (mph)	Length (ft)								
			40	50	60	70	80	90	100		
.05-.10	0-100	Inland	80	117	94	78	67	58	52	47	
			90	148	118	99	85	74	66	59	
			100	183	146	122	104	91	81	73	
			110	221	177	147	126	111	98	88	
		Coastal	80	129	103	86	74	64	57	52	
			90	163	131	109	93	82	73	65	
	.15	0-40	Inland	80	117	94	78	67	58	52	47
				90	148	118	99	85	74	66	59
				100	183	146	122	104	91	81	73
				110	221	177	147	126	111	98	88
			Coastal	80	129	103	86	74	64	57	52
				90	163	131	109	93	82	73	65
50	0-40	Inland	80	117	94	91	90	90	90	89	
			90	148	118	99	90	90	90	89	
			100	183	146	122	104	91	90	89	
			110	221	177	147	126	111	98	89	
		Coastal	80	129	103	91	90	90	90	89	
			90	163	131	109	93	90	90	89	
	50	50	Inland	80	117	101	100	100	99	99	99
				90	148	118	100	100	99	99	99
				100	183	146	122	104	99	99	99
				110	221	177	147	126	111	99	99
			Coastal	80	129	103	100	100	99	99	99
				90	163	131	109	100	99	99	99
60	0-40	Inland	80	117	111	110	109	109	109	109	
			90	148	118	110	109	109	109	109	
			100	183	146	122	109	109	109	109	
			110	221	177	147	126	111	109	109	
		Coastal	80	129	111	110	109	109	109	109	
			90	163	131	110	109	109	109	109	
	60	60	Inland	80	117	101	100	100	99	99	99
				90	148	118	100	100	99	99	99
				100	183	146	122	104	99	99	99
				110	221	177	147	126	111	99	99
			Coastal	80	129	103	100	100	99	99	99
				90	163	131	109	100	99	99	99
70	0-40	Inland	80	117	111	110	109	109	109	109	
			90	148	118	110	109	109	109	109	
			100	183	146	122	109	109	109	109	
			110	221	177	147	126	111	109	109	
		Coastal	80	129	111	110	109	109	109	109	
			90	163	131	110	109	109	109	109	
	70	70	Inland	80	117	101	100	100	99	99	99
				90	148	118	100	100	99	99	99
				100	183	146	122	104	99	99	99
				110	221	177	147	126	111	99	99
			Coastal	80	129	103	100	100	99	99	99
				90	163	131	109	100	99	99	99

table continues

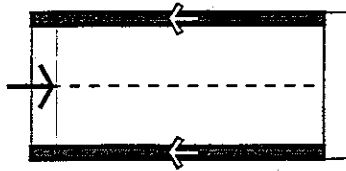

Required Horizontal Anchorage - Ah - Longitudinal Direction (lbs/ft)



Seismic Aa	Ground Snow (psf)	Wind Speed (mph)	Length (ft)								
			40	50	60	70	80	90	100		
.15	80	Inland	80	121	120	120	119	119	119	118	
			90	148	120	120	119	119	119	118	
			100	183	146	122	119	119	119	118	
			110	221	177	147	126	119	119	118	
		Coastal	80	129	120	120	119	119	119	118	
			90	163	131	120	119	119	119	118	
			100	202	161	134	119	119	119	118	
			110	244	195	163	139	122	119	118	
	90	Inland	80	131	130	129	129	129	128	128	
			90	148	130	129	129	129	128	128	
			100	183	146	129	129	129	128	128	
			110	221	177	147	129	129	128	128	
		Coastal	80	131	130	129	129	129	128	128	
			90	163	131	129	129	129	128	128	
			100	202	161	134	129	129	128	128	
			110	244	195	163	139	129	128	128	
	100	Inland	80	140	140	139	139	138	138	138	
			90	148	140	139	139	138	138	138	
			100	183	146	139	139	138	138	138	
			110	221	177	147	139	138	138	138	
		Coastal	80	140	140	139	139	138	138	138	
			90	163	140	139	139	138	138	138	
			100	202	161	139	139	138	138	138	
			110	244	195	163	139	138	138	138	
.20	0-40	Inland	80	117	94	78	67	58	55	54	
			90	148	118	99	85	74	66	59	
			100	183	146	122	104	91	81	73	
			110	221	177	147	126	111	98	88	
		Coastal	80	129	103	86	74	64	57	54	
			90	163	131	109	93	82	73	65	
			100	202	161	134	115	101	90	81	
			110	244	195	163	139	122	108	98	
		50	Inland	80	123	121	121	120	120	119	119
				90	148	121	121	120	120	119	119
				100	183	146	122	120	120	119	119
				110	221	177	147	126	120	119	119
	Coastal		80	129	121	121	120	120	119	119	
			90	163	131	121	120	120	119	119	
			100	202	161	134	120	120	119	119	
			110	244	195	163	139	122	119	119	


table continues

Required Horizontal Anchorage - Ah - Longitudinal Direction (lbs/ft)

Seismic Aa	Ground Snow (psf)	Wind Speed (mph)	Length (ft)								
			40	50	60	70	80	90	100		
.20	60	Inland	80	136	134	134	133	133	132	132	
			90	148	134	134	133	133	132	132	
			100	183	146	134	133	133	132	132	
			110	221	177	147	133	133	132	132	
		Coastal	80	136	134	134	133	133	132	132	
			90	163	134	134	133	133	132	132	
			100	202	161	134	133	133	132	132	
			110	244	195	163	139	133	132	132	
		70	Inland	80-90	149	147	147	146	146	145	145
				100	183	147	147	146	146	145	145
				110	221	177	147	146	146	145	145
				Coastal	80	149	147	147	146	146	145
	90				163	147	147	146	146	145	145
	100				202	161	147	146	146	145	145
	80		Inland	80-90	161	160	159	159	158	158	158
				100	183	160	159	159	158	158	158
				110	221	177	159	159	158	158	158
			Coastal	80	161	160	159	159	158	158	158
				90	163	160	159	159	158	158	158
				100	202	161	159	159	158	158	158
	90	Inland	80-90	174	173	172	172	171	171	171	
			100	183	173	172	172	171	171	171	
			110	221	177	172	172	171	171	171	
			Coastal	80-90	174	173	172	172	171	171	171
100				202	173	172	172	171	171	171	
110				244	195	172	172	171	171	171	
100		Inland	80-100	187	186	185	185	184	184	184	
			110	221	186	185	185	184	184	184	
			Coastal	80-90	187	186	185	185	184	184	184
		100		202	186	185	185	184	184	184	
		110		244	195	185	185	184	184	184	
		.30	0-40	Inland	80	117	94	84	83	83	82
90	148				118	99	85	83	82	82	
100	183				146	122	104	91	82	82	
110	221				177	147	126	111	98	88	
Coastal	80			129	103	86	83	83	82	82	
	90			163	131	109	93	83	82	82	
	100			202	161	134	115	101	90	82	
	110			244	195	163	139	122	108	98	
50	Inland			80-100	184	182	181	180	180	179	179
				110	221	182	181	180	180	179	179
				Coastal	80-90	184	182	181	180	180	179
	100				202	182	181	180	180	179	179
	110		244		195	181	180	180	179	179	

table continues

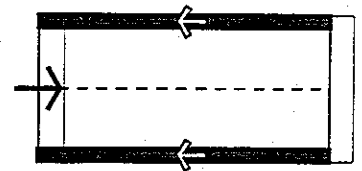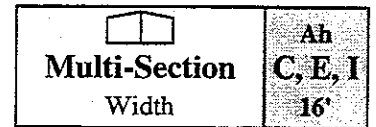

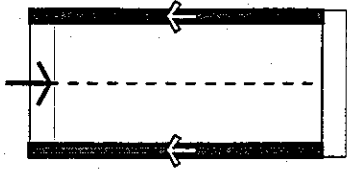

Required Horizontal Anchorage - Ah - Longitudinal Direction (lbs/ft)

Seismic Aa	Ground Snow (psf)	Wind Speed (mph)	Length (ft)							
			40	50	60	70	80	90	100	
.30	60	Inland 80-100	203	202	200	200	199	198	198	
		110	221	202	200	200	199	198	198	
	Coastal	80-100	203	202	200	200	199	198	198	
		110	244	202	200	200	199	198	198	
	70	Inland 80-110	223	221	220	219	218	218	217	
		Coastal 80-100	223	221	220	219	218	218	217	
	110	80-100	244	221	220	219	218	218	217	
		110	244	221	220	219	218	218	217	
	80	Inland 80-110	242	240	239	238	238	237	237	
		Coastal 80-100	242	240	239	238	238	237	237	
110	80-100	244	240	239	238	238	237	237		
	110	244	240	239	238	238	237	237		
90	All Wind	262	260	259	258	257	257	256		
100	All Wind	281	279	278	277	276	276	276		
.40	0-40	Inland	80	117	114	112	111	110	110	109
			90	148	118	112	111	110	110	109
			100	183	146	122	111	110	110	109
			110	221	177	147	126	111	110	109
		Coastal	80	129	114	112	111	110	110	109
			90	163	131	112	111	110	110	109
			100	202	161	134	115	110	110	109
			110	244	195	163	139	122	110	109
	50	All Wind	245	243	241	240	239	239	238	
	60	All Wind	271	269	267	266	265	265	264	
	70	All Wind	297	295	293	292	291	290	290	
	80	All Wind	323	321	319	318	317	316	316	
	90	All Wind	349	346	345	344	343	342	342	
	100	All Wind	375	372	371	369	369	368	367	

APPENDIX C

FOUNDATION CAPACITIES TABLES

C-100. USE OF FOUNDATION CAPACITIES TABLES.

C-100.1. GENERAL. The Foundation Capacities Tables provide foundation design capacities and dimensions for three conditions of foundation design.

A. Withdrawal Resistance. The ability of a foundation wall or pier plus its respective footing to resist uplift and overturning. See Tables C-1 & C-2.

B. Vertical Anchor Capacity. The required size and spacing of anchors to tie the superstructure to the foundation to meet the required uplift or overturning in the transverse direction. See Tables C-3 & C-4 (a & b).

C. Horizontal Anchor Capacity. The required size and spacing of anchors to tie the superstructure to the foundation to resist sliding in the transverse and longitudinal directions - Horizontal Anchor Capacity Table, Table C-5.

C-100.2. CONNECTIONS of the foundation to the manufactured home is dependent on the rated capacity of the manufacturer's connection designs.

C-200. WITHDRAWAL RESISTANCE CAPACITY TABLES. There are two tables providing the withdrawal resistance (uplift and overturning) for different designs of foundation walls and piers on spread footings at different depths.

C-200.1. LONGITUDINAL FOUNDATION WALLS. The "Withdrawal Resistance for Longitudinal Foundation Walls - Table C-1" is used for manufactured homes anchored to longitudinal foundation walls, specifically system type E. The table provides a footing width and depth below grade to prevent uplift.

Example: Determine the withdrawal resistance of a 6" reinforced concrete wall with a height (hw) of 3'- 4" and with a 6"x16" footing. Repeat for a 6"CMU wall grouted solid, then grouted at 48" o.c., and lastly for an all-weather wood foundation.

Solution: Start with the concrete wall:
 wall weight: $(0.5') \times (3.33') \times 150 \text{ pcf} = 250 \text{ plf}$;
 reinforced concrete footing weight:
 $(6" \times 16" \div 144 \text{ in. sq. / sq. ft.}) \times 150 \text{ pcf} = 100 \text{ plf}$;
 rectangular soil wedge wt: $(3.33' - 1') \times ((16" \times 6") \div (2" \times 12")) \times 120 \text{ pcf} = 116 \text{ plf}$. The total withdrawal resistance is the sum of the wall, footing and soil block weight, which is $250 + 100 + 116 = 466 \text{ plf}$. This matches the tabled value. The solid grouted CMU wall: wall wt.: $(3.33') \times (63 \text{ psf}) = 210 \text{ plf}$, 16" footing and 5" soil wedge calculations are the same as above. The total withdrawal is the sum = $210 + 100 + 116 = 426 \text{ plf}$, just as found in the Table. The partially grouted CMU wall: wall wt.: $(3.33') \times (45 \text{ psf}) = 150 \text{ plf}$, 16" footing and 5" soil wedge are the same. The total withdrawal is the sum = $150 + 100 + 116 = 366 \text{ plf}$, just as found in the table. Lastly, for the all-weather wood foundation: wood stud wall wt.: 2"x6" plate = 2.1 plf; (3)-2"x4" plates = $3 \times 1.3 \text{ plf} = 3.9 \text{ plf}$; 2"x4" @ 16" o.c. = $1.0 \text{ psf} \times 3.33' =$

3.33plf; 1/2"plywood = 1.5psf × 3.33' = 5.0 plf. Wood sum = 2.1+3.9+3.33+5.0 = 14.3 plf; footing weight is the same as calculated before. Soil weight is based on a 6" wide wedge: (3.33')×(16-4)÷(2×12)×pcf = 140 plf. Total withdrawal = 14.3+100+140 = 254 plf, just as in the Table.

C-200.2. PIER FOUNDATIONS. The "Withdrawal Resistance for Piers - Table C-2" is used for manufactured homes anchored to piers; specifically system Types C, I, and Type E when interior piers are used for anchorage. This table also applies to the concrete tie-down block for type C1 foundations.

Example: Determine the withdrawal resistance of a 3 foot square footing with an 8"x16" solid grouted CMU pier of a height (hp) of 3'-4". Grade exists 12 inches down from the top of the pier.

Solution: Assume the following material weights: 8"CMU = 84 psf; soil = 120 pcf; and concrete = 150 pcf. Pier weight = (84psf) × (16/12) × (3.33') = 373 lbs. Footing weight = (150pcf)×(8/12)×(3'×3') = 900 lbs. Assume footing perimeter creates a conservative shear plane. Soil above footing also counted to resist withdrawal. Soil Weight = (120pcf)×(3.33'-1')×(3² - (8)×(16)/144) = 2267 lbs. Total withdrawal resistance is the sum of the pier + footing + soil = 3541 lbs. This magnitude matches the value found in the Table C-2.

C-200.3. FOOTING DEPTH. The bottom of the footings must be below the maximum frost depth for the area where the home is located.

Example: The average depth of frost penetration is 35 inches. Assume that the required footing depth to resist withdrawal (A_v) is

hw = 2 feet. The depth of the base of the footing is 24"-12"+6"=18". This is less than 35". The depth of hw must be increased to 41" in order for the base of the footing to be at 35"--the required depth to prevent frost damage & also satisfy withdrawal requirements (41"-12"+6"=35").

C-300. VERTICAL ANCHOR CAPACITY TABLES provide the required anchor and reinforcing size and spacing to tie the superstructure to the foundation wall or piers. As in section C-200.1 above, there are two Vertical Anchorage Capacity Tables, one for longitudinal foundation walls and one for piers.

C-300.1. PIERS. The "Vertical Anchor Capacity for Piers - Table C-3" is used for manufactured homes anchored to piers to prevent uplift specifically system Types C, I, and Type E when interior piers are used for anchorage (multi-section E's).

Example: Anchor bolts are assumed to be made from A36 rod stock and of embedment length sufficient to fully develop the allowable tensile capacity ($0.6 \times F_y$) of the diameter of rod used. A 1/2" diameter anchor bolt has the following capacity: $(0.6 \times 36,000 \text{psi}) \times (\pi \times 0.5^2/4) = 4,240$ psi, as noted in the Table. The capacity of any substituted grade of steel can easily be calculated if the yield point and diameter are known.

C-300.2. LONGITUDINAL CONCRETE/MASONRY FOUNDATION WALLS. The "Vertical Anchorage Capacity for Longitudinal Foundation Walls - Table C-4A" is used for manufactured homes anchored to a continuous Reinforced concrete or reinforced concrete masonry foundation wall, specifically system Type E.

Example: Determine the anchorage capacity per foot of foundation wall if 1/2" diameter anchor bolts are spaced 3'-4" o.c. and attach to a continuous treated wood mud sill 1-1/2" thick. Standard washers are used under the nut and bear into the mud sill perpendicular to grain.

Solution: Determine the bearing area of a standard washer with O.D. = 1.375" and I.D. = 0.5625": $A_{brg} = \pi \times (1.375^2 - 0.5625^2) \div 4 = 1.237 \text{ sq. in.}$. The capacity in bearing multiplied by a bearing area factor $C_b = 1.25$. Thus, the bearing capacity = $1.237 \times 1.25 \times 565 \text{ psi} = 873 \text{ lbs./bolt}$. The capacity for a given spacing of bolts is found by division of that spacing. Thus, for a 3'-4" bolt spacing: $873 \div 3.33' = 262 \text{ plf}$, which is the same as in the Table.

Use of an oversized washer (for a 5/8" dia. bolt) produces a larger capacity per bolt. The O.D. = 1.75" and the I.D. = 0.6875", thus the net bearing area: $A_{brg} = \pi \times (1.75^2 - 0.6875^2) \div 4 = 2.03 \text{ sq. in.}$. The vertical anchor capacity at the same same spacing = $2.03 \times 1.25 \times 565 \text{ psi} \div 3.33' = 431 \text{ plf}$, which is the same as in the Table.

C-300.3. LONGITUDINAL TREATED WOOD FOUNDATION WALLS. The "Vertical Anchorage Capacity for Longitudinal Foundation Walls - Table C-4B" is used for manufactured homes anchored to a continuous treated wood foundation wall, specifically system Type E. Vertical anchorage capacities are based on the use of standard washers over 1/2" dia. bolts. Plywood thickness, nail size and spacing are selected so as to provide equal or greater capacity than the standard washer in bearing. The APA Plywood Diaphragm Guide was used to select plywood, and nailing requirements for the Table.

Example: A 1/2" dia. bolt spaced at 3'-4" o.c. provides a vertical anchor capacity of 262 lbs./ft. This is the same capacity as found in Table C-4A for a standard washer in bearing, and its calculation is illustrated above. The APA Table - *Recommended Shear for Horizontal APA Panel Diaphragms* requires for a shear of 320 plf > 262 plf: 8d COM nails @ 4" o.c. and uses 3/8" APA rated sheathing.

C-400. HORIZONTAL ANCHOR CAPACITY TABLES FOR TRANSVERSE AND LONGITUDINAL FOUNDATION WALLS (Table C-5A & C-5B) are used for all types of manufactured homes: homes on continuous foundations - Type E; homes on piers - Types C and I.

C-400.1. ASSUMPTIONS. Along with the notes at the bottom of the tables the following assumptions are made:

A. The horizontal sliding forces are resisted totally by transverse foundation shear walls in the transverse direction and by longitudinal foundation shear walls in the longitudinal direction. An appropriate number of vertical X-bracing planes can be substituted for shear walls to resist sliding in the transverse or longitudinal direction. See sections 602-5.G and 602-6.F.

B. The roof/ceiling and floor of the superstructure are adequate as diaphragms, transferring wind load to the transverse and longitudinal foundation shear walls.

C. A home supported by piers does not provide adequate horizontal sliding resistance unless the piers and footings have been engineered to withstand lateral loads.

C-400.2. TABLES FOR HORIZONTAL ANCHOR CAPACITY. There are two Tables (C-5A & C-5B) for the Horizontal Anchor Capacity for Transverse or Longitudinal Walls.

A. Concrete or Masonry Walls. Table C-5A is based on the capacity of the anchor bolt in a properly designed concrete or masonry foundation system. Horizontal shear capacity for a specific spacing of anchor bolts is based on bearing of the anchor bolt against concrete or grout: $F_{brg} = 0.35 \times f_c' = 0.35 \times 2500\text{psi} = 875\text{psi}$.

Example: Horizontal capacity per anchor bolt bearing = $875\text{psi} \times 1/2''\text{ dia.} \times 4''\text{ min. embed.} = 1750\text{ lb/bolt}$, rounded to 1800 lb/bolt. (Note: shear of the bolt did not control since it calculated to be 2830 lb/bolt, assuming A36 rod stock). Thus for 3 foot spacing: $1800 \div 3' = 600\text{ plf}$, as shown in the Table.


B. Wood Foundation Walls. Table C-5B is based on the capacity of the anchor connection to a treated wood wall which is attached to a concrete footing. Horizontal shear

capacity is controlled by bearing of wood parallel to grain against the anchor bolt, and then the spacing of those bolts. A 1600 psi end grain bearing allowable stress was assumed, since it would cover most typical species. Thus, the capacity per bolt = $1/2''\text{ dia.} \times 1.5'' \times 1600\text{ psi} = 1200\text{ lb}$. The APA Plywood Diaphragm Guide was used to select plywood, and nailing requirements for the Table.

Example: For a $1/2''\text{ dia.}$ bolt spaced at 3'- 4'', the horizontal capacity is: $1200\text{ lb.} \div 3.33' = 360\text{ plf}$ as shown in the Table. The APA Table - *Recommended Shear for Horizontal APA Panel Diaphragms* requires for a shear of 360 plf: 8d COM nails @ 4" o.c. and uses 15/32" APA rated sheathing, just as shown in the Table.

C. Anchorage For Diagonal Steel Members To Complete Transverse Foundation Walls Used As Shear Walls. The number of anchor bolts required to anchor the diagonal steel members to the foundation wall can be found by dividing the capacity value for a bolt spaced at 12 inches into the required A_h .

Table C-1
Withdrawal Resistance¹
Longitudinal Continuous Foundations^{2,3}
(In pounds per linear foot of wall)

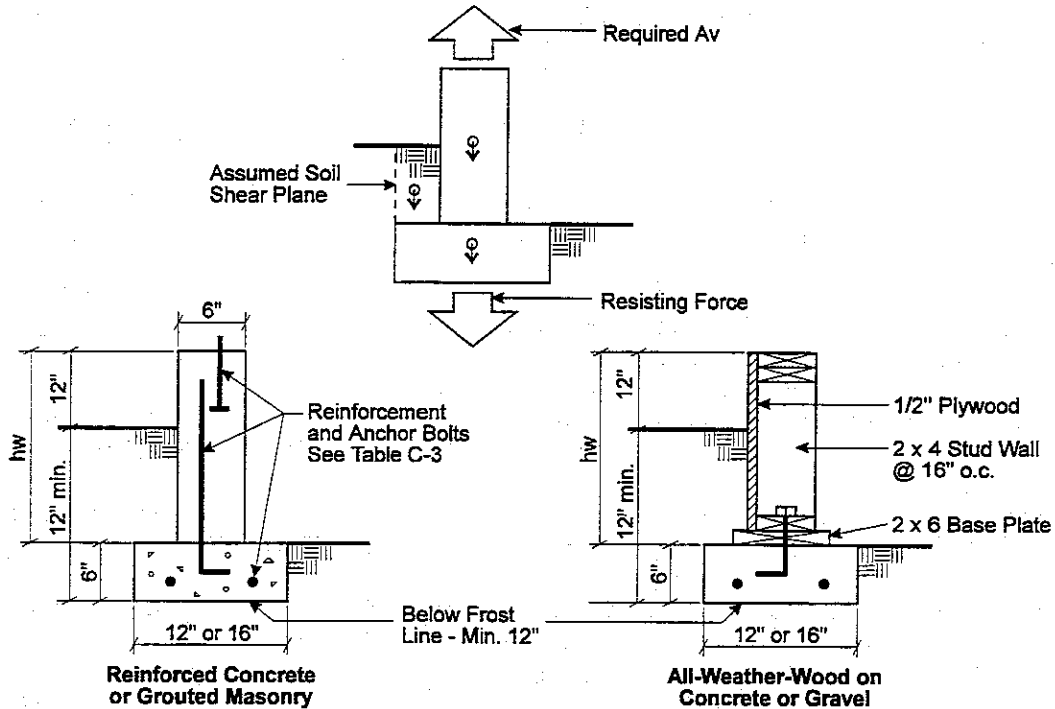

hw	Reinforced Concrete		Masonry-Fully Grouted 6" CMU		Masonry-Grouted @ 48" o.c.		All-Weather Wood w/ Conc. Footing	
	Footing Width		Footing Width		Footing Width		Footing Width	
	12"	16"	12"	16"	12"	16"	12"	16"
2'-0"	255	300	231	276	195	240	126	171
2'-8"	325	383	293	351	245	303	154	212
3'-4"	395	466	355	426	295	366	182	254
4'-0"	465	550	417	502	345	430	211	296
4'-8"	535	633	479	577	395	493	240	337


¹ Potential resistance to withdrawal is the maximum uplift resistance which can be provided by the foundations shown. It is computed by adding the weights of building materials and soil over the top of the footing, plus the footing weight. To fully develop this potential, adequate connections to the footing and superstructure must be provided. Material weights used: concrete (nlwt) = 150 psf; 6" solid grouted CMU = 63 psf; 6" CMU grouted @ 48" o.c. = 45psf; grout wt assumed = 140 pcf; CMU units nlwt; wood = 35 pcf; soil = 120 pcf.

² Foundations must be designed for bearing pressure, gravity loads, and uplift loads in addition to meeting the anchorage requirements tabulated in the Foundation Design Tables.

³ Values shown in this table could be increased by widening the footing, provided the system is designed for the increased load, or by a more detailed analysis of the shearing strength of the soil overburden.

Table C-2
Withdrawal¹ Resistance For Piers^{2,3}
(In pounds per pier)

Hp Depth	Width of Square Footing: Wf			
	1'-0" ⁴	2'-0"	3'-0"	4'-0" ⁴
2'-0"	279	997	2097	3755
2'-8"	361	1322	2824	5049
3'-4"	442	1643	3541	6325
4'-0"	525	1967	4267	7617
4'-8"	607	2292	4994	8911

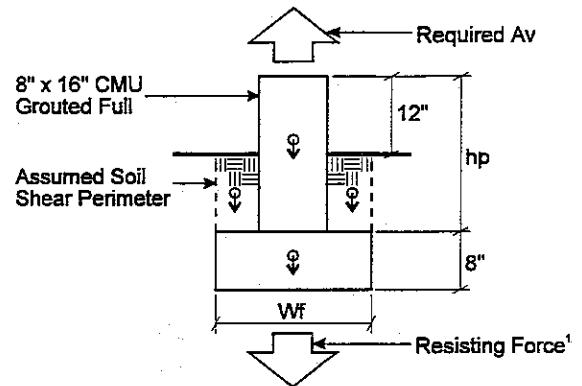

- ¹ Potential resistance to withdrawal is the maximum uplift resistance which can be provided by the foundations shown. It is computed by adding the weights of building materials and soil over the top of the footing, plus the footing weight. To fully develop this potential, adequate connections to the footing and superstructure must be provided. Material weights used: concrete (nlwt) = 150 psf; nlwt 8"CMU = 84 psf grouted solid; grout (nlwt) = 140 pcf; soil = 120 pcf.
- ² Foundations must be designed for lateral soil pressure, bearing pressure, gravity loads, and uplift loads, in addition to meeting the anchorage requirements tabulated in the Foundation Design Tables. The bottom of the footing must also be below the maximum depth of frost penetration.
- ³ Values shown in this table could be increased by widening the footing, providing the wall system is designed for the increased load, or by a more detailed analysis of the shear strength of the soil overburden.
- ⁴ Assumes 8" x 8" pier for the 1'-0" square footing, and 16" x 16" pier for the 4'-0" square footing.

Table C-3
Vertical Anchor Capacity For Piers^{1,2}
(In pounds)

Anchor Bolt Dia.	Capacity Per Number Of Bolts	
	1	2
1/2"	4240	8480
5/8"	6620	13240


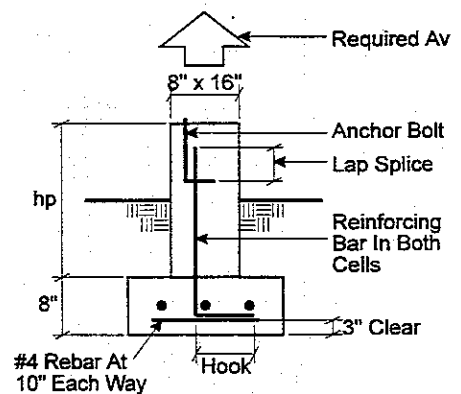


Table C-3A

Anchor Bolt Dia.	Vertical Rebar	Minimum Lap Splice	Rebar Hook
1/2"	# 4	16"	6"
5/8"	# 5	20"	7"

- ¹ The vertical anchor capacity is based upon the working capacity of ASTM A-36 rod stock anchor bolts in 2500 psi concrete or grout. To fully develop this capacity, anchor bolts must be properly lapped with the pier's vertical reinforcement.
- ² The capacity is based on $f_c = 2500$ psi; $F_y = 36,000$ psi.

Table C-4A
Vertical Anchor Capacity For Longitudinal Foundation Wall¹
(In pounds per linear foot of wall)

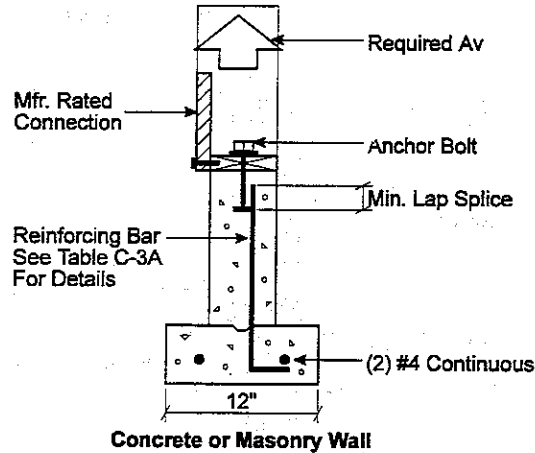

Vertical Capacity ⁵ lbs./ft.		Required Anchorage ^{2,3}		
Standard Washer	Over-Sized Washer	Anchor Bolt	Rebar ⁴	Spacing ⁵
146	239	1/2"	# 4	6'-0" max.
164	270	↓	↓	5'-4"
187	307	↓	↓	4'-8"
218	359	↓	↓	4'-0"
262	431	↓	↓	3'-4"
327	538	↓	↓	2'-8"
437	718	↓	↓	2'-0"

¹ Compare with required A_v for Type E units.

² Values are based on vertical capacity per foot of wall.

³ Assuming 1 1/2" thick sill plate, 3/4" edge distance for wood or composite nailer plates or 20 diameter end distance for plywood sheathing; APA rated, properly seasoned wood; Group III woods, not permanently loaded, and a 25% length of bearing factor increase.

⁴ It is assumed that a reinforcing bar of the same diameter and spacing as the anchor is adequately embedded in the footing and lapped with the anchor.

⁵ Spacing and capacity is based on allowable compression of wood perpendicular to grain for $F_c = 565$ psi and washer as define below:

Standard washer: 1 3/8" O.D. and 0.5625" I.D. washer (for 1/2" ϕ bolt)

Over-sized washer: 1 3/4" O.D. and 0.6875" I.D. washer (for 5/8" ϕ bolt) placed under the standard washer.





Table C-4B
Vertical Anchor Capacity For Longitudinal Foundation Wall^{1,2}
(In pounds per linear foot of wall)

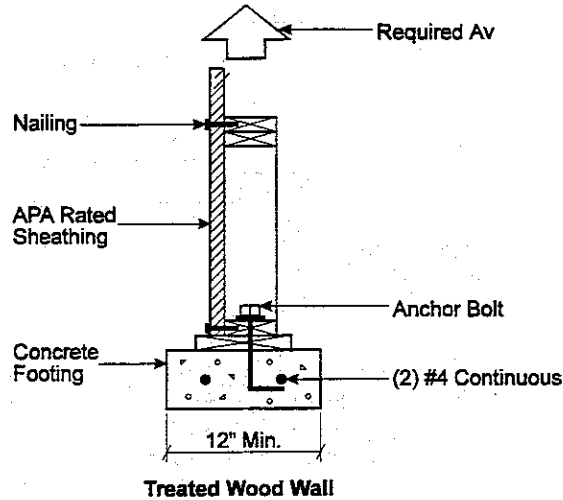

Vertical Capacity lbs./ft.	Required Nailing ^{4,5} (Edge Spacing, in.)	Min. Plywood Thickness	Required Anchorage ^{2,3}	
			Anchor Bolt Diameter	Bolt Spacing ⁶
146	6d @ 6" o.c.	3/8"	1/2"	6'-0" max.
164	↓	↓	↓	5'-4"
187	↓	↓	↓	4'-8"
218	8d @ 6" o.c.	↓	↓	4'-0"
262	8d @ 4" o.c.	↓	↓	3'-4"
327	8d @ 4" o.c.	15/32"	↓	2'-8"
437	10d @ 2 1/2" o.c.	↓	↓	2'-0"


*** For required Av greater than 437 lbs./ft., consider using a different foundation material or utilize an engineered design with a higher capacity.

- ¹ Compare with required Av for Type E units.
- ² In the case of a treated wood foundation wall, the wood wall and its connections must be designed to transfer the anchor load to a concrete footing. This table does not apply to treated wood foundation walls on gravel bases.
- ³ Values are based on vertical capacity per foot of wall.
- ⁴ Assuming 1 1/2" thick sill plate, 3/4" edge distance for wood or composite nailer plates or 20 diameter end distance for plywood sheathing; APA rated, properly seasoned wood; Group III woods, not permanently loaded, and a 25% length of bearing factor increase.
- ⁵ Nailing schedule in this table is intended to secure the superstructure to the foundation only, and not to provide required edge fastening for plywood siding or sheathing.
- ⁶ Spacing and capacity is based on allowable compression of wood perpendicular to grain for $F_c = 565$ psi and standard washer = 1 3/8" O.D. and 9/16" I.D. washer (for 1/2" ϕ bolt).

Table C-5A
Horizontal Anchor Capacity For Transverse or Longitudinal Shear Walls¹
(In pounds per foot of wall)

Concrete or Masonry

Horizontal Capacity ² lbs./ft.	Required Anchorage ⁵		
	Anchor Bolt ⁴	Rebar	Spacing ⁶
300	↓ 1/2"	↓ #4	72" o.c. max.
600			36" o.c.
675			32" o.c.
900			24" o.c.
1350			16" o.c.
1800			12" o.c.
***	See Table C-3A For Rebar Details		

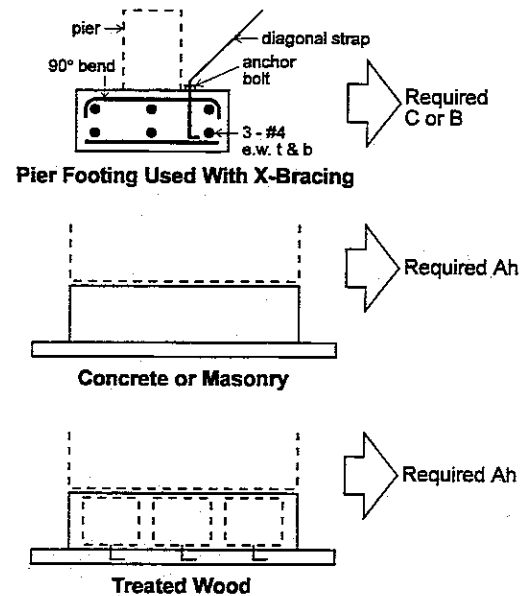

*** For required Ah greater than 1800 lbs./ft., consider using an engineered design with a higher capacity.

Table C-5B

Treated Wood

Horizontal Capacity ² lbs./ft.	Required Nailing ^{3,4} (Edge Spacing, in.)	Min. Plywood ⁴ Nailer Thickness	Required Anchorage	
			Anchor Bolt Diameter	Bolt Spacing ⁷
300	8d @ 4" o.c.	7/16"	↓ 1/2"	4'-0" max.
360	8d @ 4" o.c.	15/32"		3'-4"
449	10d @ 4" o.c.	15/32"		2'-8"
600	10d @ 3" o.c.	19/32"		2'-0"

¹ Compare capacity with required Ah in transverse or longitudinal direction.

² Values are based on horizontal load per foot of wall. Select Ah for pier spacing of 4 feet for use with this table.

³ Assuming 1 1/2" thick sill plate, 3/4" edge distance for wood or composite nailer plates or 20 diameter end distance for plywood sheathing; APA rated, properly seasoned wood; Group III woods, not permanently loaded.

⁴ Nailing schedule in this table is intended to secure the superstructure to the foundation only, and not to provide required edge fastening for plywood siding or sheathing.

⁵ It is assumed that a reinforcing bar of the same diameter as the anchor is adequately embedded in the footing and lapped with the anchor. In the case of a treated wood foundation wall, the wood wall and its connections must be designed to transfer the anchor load to a concrete footing. This table does not apply to treated wood foundation walls on gravel bases.

⁶ Spacing based on bearing capacity of bolt against concrete/grout.

⁷ Spacing based on capacity of anchor bolt in bearing against the wood plate. (see also #5.)

1. The first part of the document discusses the importance of maintaining accurate records of all transactions and activities. It emphasizes that this is crucial for ensuring transparency and accountability in the organization's operations.

2. The second part of the document outlines the various methods and tools used to collect and analyze data. It highlights the need for consistent and reliable data collection processes to ensure the validity of the results.

3. The third part of the document describes the different types of data that are collected and how they are used to inform decision-making. It notes that a combination of quantitative and qualitative data is often used to provide a comprehensive view of the organization's performance.

4. The fourth part of the document discusses the challenges associated with data collection and analysis. It identifies common issues such as data quality, consistency, and availability, and provides strategies to address these challenges.

5. The fifth part of the document describes the various ways in which data is used to inform decision-making. It highlights the importance of using data to identify trends, patterns, and areas for improvement, and to evaluate the effectiveness of different strategies and initiatives.

6. The sixth part of the document discusses the role of data in strategic planning and implementation. It notes that data is used to set goals, develop strategies, and monitor progress, and that it is essential for ensuring that the organization is on track to achieve its long-term objectives.

7. The seventh part of the document describes the various ways in which data is used to improve organizational performance. It highlights the importance of using data to identify areas of inefficiency and to develop targeted interventions to address these issues.

8. The eighth part of the document discusses the role of data in risk management and compliance. It notes that data is used to identify potential risks and to develop strategies to mitigate these risks, and that it is essential for ensuring that the organization is compliant with relevant laws and regulations.

APPENDIX D

DERIVATION OF FOUNDATION DESIGN

D-100. CONDITIONS AFFECTING DESIGN. Values for the Foundation Design Load Tables have been derived based on major foundation design factors, foundation design criteria, and design assumptions.

D-100.1 MAJOR FOUNDATION DESIGN FACTORS determine the appropriateness of foundations for manufactured homes:

A. Soil and site conditions.

1. Soil types
2. Bearing capacities
3. Drainage
4. Slopes

B. Load Conditions and Combinations. Various combinations of (1) through (5) with appropriate factors:

1. Dead loads
2. Occupancy live loads
3. Wind loads
4. Snow loads / Minimum roof live loads
5. Seismic loads

C. Foundation Design and Capacity.

1. Footing depth
2. Footing size
3. Reinforcing
4. Materials

D. Connection Compatibility with Manufactured Home. Adequate capacity plus a safety factor is required to transfer forces

from the manufactured house to the foundation without failure.

D-100.2 CRITERIA FOR FOUNDATION DESIGN for manufactured homes must meet the following:

A. Assumptions made in foundation system design must be compatible with the design of the housing unit and actual site conditions.

B. Stress Limitations. The design must sustain all loads within stress limitations of connection systems.

C. Acceptable Foundation Design must provide for the Permanent Foundation criteria as specified in Section 100-1.C.


D-100.3 DESIGN ASSUMPTIONS

A. Values Included In Appendix B & C. The foundation tables in Appendices B & C are based on a number of design assumptions:

1. Building width is discussed in terms of minimum chassis beam spacing in Chapter 1: 100-1.A.5 and again in Chapter 6: 600-2.A.1. for comparison of nominal and range of actual width, and then is illustrated in Figure 6-1. It is clear that many actual widths are possible. The following actual widths and projections (dc) were used in the Tables of Appendix B:

Wt (nominal)	Wt (actual)	dc
12'	11'-8"(11.67')	32.25"(2.69')
14'	13'-8"(13.67')	41"(3.42')
16'	15'-6"(15.5')	45.25"(3.77')

- The Overturning (A_v) and Sliding (A_h) Tables in Appendix B assume $h_n=8.0$ feet and assume a chassis beam depth of 10" (0.833 ft).
- The manufactured home is located on a flat, open site with no protection from the wind.
- Wind force on the manufactured home, instead of seismic force, is the controlling factor for the foundation overturning anchorage design in the transverse direction. Seismic forces or wind force may control sliding anchorage in the transverse or longitudinal direction.
- Uplift, overturning, and sliding caused by wind or seismic forces

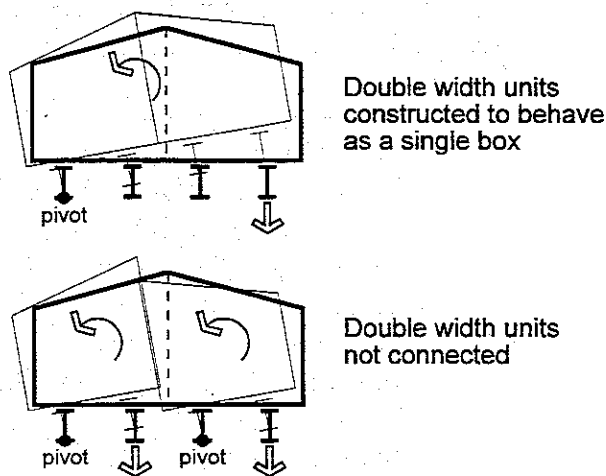

Marriage Wall Connection Options

Figure D - 1

acting on the manufactured home are transferred to the foundation by the structural integrity of the manufactured home.

- The manufactured home unit, single or multi-width, is assumed to be a box with flexible floor and roof diaphragms. End walls and selected interior shear walls were assumed to transfer lateral forces based on tributary area methodology. The unit's shear wall locations must closely coincide with the foundation shear walls or vertical X-bracing planes. A structural engineer shall design the system if deviations from these assumptions exist.
- Multi-section units are assumed to be connected at the marriage wall to act as a single box for overturning consideration, and do not act separately as illustrated in Figure D-1. This is particularly necessary in high seismic locations.

B. List of Variables. These variables are used throughout Appendix D.

- Aa** Seismic coefficient representing effective peak acceleration
- Ah** Required horizontal anchorage (lbs. or lbs./LF)
- Av** Required vertical anchorage (lbs. or lbs./LF)
- Av** Seismic coefficient representing effective peak velocity related acceleration

Ce	Exposure factor (See ASCE 7-93)	p	Design wind pressure
Ct	Thermal factor (See ASCE 7-93)	Pf	Design roof snow load (See ASCE 7-93)
Cp	External wall or roof pressure coefficient (See ASCE 7-93)	Pg	Ground snow load (See ASCE 7-93)
Cs	Roof slope factor (See ASCE 7-93)	Sp	or Spacing: Spacing of foundation elements in the longitudinal direction.
Cs	Seismic design coefficient (See ASCE 7-93)	V	Basic wind speed (See ASCE 7-93)
dc	Distance from perimeter of structure to chassis beam line.	Wt	Width of structure (or 1/2 the total width of a multi-section unit)
DL	Total dead load of structure for each foot of length		
Fr	Force resisting sliding		
Fsl	Sliding force (lbs.)		
GCpi	Internal wall or ceiling pressure coefficient (See ASCE 7-93)		
Gh	Gust response factor (See ASCE 7-93)		
hn	Height of the exterior wall acted on by lateral wind pressure		
I	Importance factor (See ASCE 7-93)		
Kz	Velocity pressure exposure coefficient (See ASCE 7-93)		
LL	Live load		
Mo	Overturning moment of structure		
Mr	Moment resisting overturning		

D-200. LOAD CONDITIONS INCLUDED IN FOUNDATION DESIGN. The following load conditions have been used as assumptions in design of the foundation systems in this handbook. This information is important for engineers who may be designing connection details or modifying foundations designs. All Design Loads are based on ASCE 7-93, except as noted otherwise.

D-200.1 DEAD LOAD DESIGN FACTORS. Dead loads consist of the material weight of the manufactured home without furnishings or occupants. Dead load includes the weight of the roof, floor, walls, and chassis, and may include permanent attachments such as cabinets and attached appliances.

A. Dead Load Categories. Dead loads were grouped into two categories: heavy and light. The heaviest combinations of dead loads were used for the computation of footing areas, and the determination of inertia forces for the computation of sliding and overturning due to seismic activity. Heavier loads generate the

largest inertia forces and produce the largest footings. The lightest combinations of dead loads were used for the computation of horizontal and vertical anchorage due to wind. Lighter loads offer less resistance to overturning and sliding and thus require greater anchorage. The following dead loads in Table D-1 have been included in the calculations for the

Foundation Design Load Tables on the next page.

B. Dead Load Equations for use in computing the required vertical and horizontal anchorage to resist overturning and sliding are listed below by type. The equations are for the total Dead Load per foot of Manufactured Home length. Figure D-2 illustrates the individual component loads and the total dead load situated at the geometric centroid of the unit.

Lightest combination of loads:

SINGLE-SECTION TYPES C, E, & I

$$DL = (34.5)2 + (6 + 8.6)Wt + 9 \times 2$$

(walls)+(floor+roof)+(chassis beams)

$$DL = 87 + (14.6)Wt$$

MULTI-SECTION TYPES C, E, & I

$$DL = (34.5)2 + (26.25)2 + 2(6 + 8.6)Wt + 9 \times 4$$

(ext. walls) + (marriage wall) + (floor + roof) + (chassis beams)

$$DL = 157.5 + (29.2)Wt$$

Heaviest combination of loads:

SINGLE-SECTION TYPES C, E, & I

$$DL = (44.25)2 + (13 + 9.7)Wt + 9 \times 2$$

(walls) + (floor + roof) + (chassis beams)


$$DL = 106.5 + (22.7)Wt$$

MULTI-SECTION TYPES C, E, & I

$$DL = (44.25)2 + (26.25)2 + 2(13 + 9.7)Wt + 9 \times 4$$

(ext. walls) + (marriage wall) + (floor + roof) + (chassis beams)

$$DL = 177 + (45.4)Wt$$

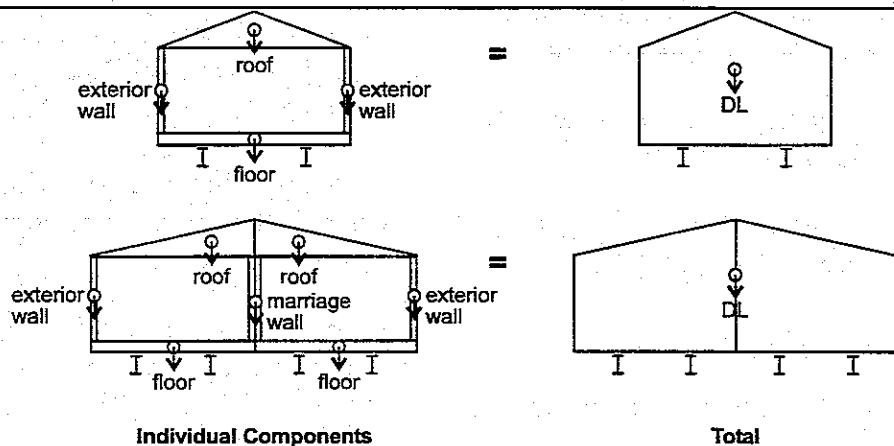

Dead Load Components and Total

Figure D - 2

TABLE D-1
DEAD LOAD ON FOUNDATION


LOCATION	ITEM	HEAVY (psf)	LIGHT (psf)	HEAVY (plf of length)	LIGHT (plf of length)
EXTERIOR WALL	7/16" siding	1.4			
	.019 aluminum		0.1		
	2 x 4 studs @ 16" o.c.	1.5	1.5		
	3 1/2" fiberglass insulation	1.0	1.0		
	1/2" gypsum	2.0	2.0		
	SUM =	5.9	4.6		
TOTAL	7'-6" WALL			44.25	34.5
FLOOR	carpet & pad	1.0			
	1/16" vinyl		0.7		
	5/8" plywood	1.7	1.7		
	2 x 10 joist @ 16" o.c.	2.6			
	2 x 6 joist @ 16" o.c.		1.4		
	11" fiberglass insulation	2.2			
	5 1/2" fiberglass insulation		1.2		
	mechanical	2.0	1.0		
	misc. partitions	3.5	0.0		
	SUM =	13.0 *	6.0 *	13 × Wt + 9	6 × Wt + 9
* plus 9 plf for each manufactured home beam					
ROOF	asphalt shingles with felt	2.5			
	3/8" plywood	1.1			
	20 ga. steel		2.5		
	2 x 3 truss	1.5	1.5		
	9 1/2" fiberglass insulation	2.6	2.6		
	1/2" gypsum ceiling	2.0	2.0		
		SUM =	9.7	8.6	9.7 × Wt
MARRIAGE WALL	2x4 studs @ 16"	1.5	1.5		
	1/2" gypsum (one side)	2.0	2.0		
		SUM =	3.5	3.5	
TOTAL	7'-6" WALL			26.25	26.25

D-200.2 LIVE LOAD DESIGN FACTORS

A. Description. Design live loads consist of the weight of all moving and variable loads (from use and occupancy) that may act on the manufactured home including loads on floors, operational loads on roofs and ceilings, or snow loads, but do not include wind, earthquake or dead loads. All live loads are assumed to be uniformly distributed and roof live loads are horizontally projected on sloped surfaces. The design live loads specified herein for the floor and attic are the minimums recommended by the ASCE standard. The design live loads specified herein for the roof are the minimum recommended by the *Minimum Property Standard*, HUD Handbook 4910.1, 1994 Edition. The roof live load used for the design of the foundation system should be the greater of the appropriate value indicated in the Data Plate shown here or as obtained from the ASCE 7-93 for snow load.

B. Design Assumptions. The following values for live loads were used in the engineering calculations and are included in the tables. They are provided here as background information only. The field inspector will not need to calculate live loads under normal circumstances. See box of live loads.

D-200.3 SNOW LOAD DESIGN FACTORS

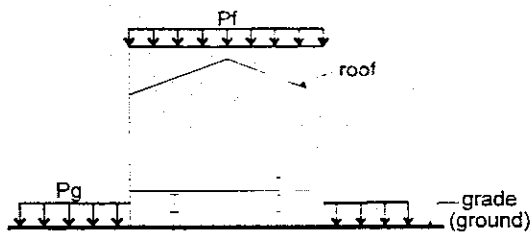

Snow Load Distribution

Figure D - 3

Minimum Uniformly Distributed Live Loads (used for Foundation Design Load Tables)

Location	Live Load (psf)
Roof (slope 3/12 or less, $\leq 14^\circ$)	20*
Roof (slope over 3/12, $> 14^\circ$) (Over the entire width of the unit. Compare with snow load value. Use the larger value.)	15*
Dwelling rooms (Floor design live loads over the entire area of the unit.)	40
Attics (uninhabitable, without storage)	10

* Due to snow load factors, the 30 psf ground snow load used on the Foundation Design Load Tables is equivalent to a 20 psf roof live load. The 20 psf ground snow load is equivalent to a 15 psf roof live load.

A. Ground Snow Load. The ground snow load values (P_g) to be used in the design of the manufactured home are found in Appendix H. The ground snow load is converted to a roof snow load to account for wind and thermal factors (see Figure D-3). The value (P_g) modified by snow load design factors has been included in the derived values for the Foundation Design Load Tables. The following assumptions were made to find P_f , the horizontally projected uniformly distributed design roof snow load:

B. Design Assumptions.

Basic Snow Load Equation:

$$P_f = 0.7 \times C_e \times C_t \times I \times P_g$$

Where:

1. Ground snow load (P_g) from the Ground Snow Load maps on pages H-11, H-12 and H-13.
2. Importance factor $I = 1.0$ (residential buildings)
3. Exposure factor $C_e = 1.0$ (locations where snow removal cannot be relied on to reduce snow loads)
4. Thermal factor $C_t = 1.0$ (heated structures)
5. Slope factor $C_s = 1.0$ (4/12 slope or less)
6. Flat roof factor = 0.7 (contiguous U.S.; Use 0.6 in Alaska.)

Therefore, the Required Effective Footing Area Tables are based on:

$$P_f = 0.7 \times P_g \text{ (Roof snow load)}$$

C. Drifted Snow. At locations where the manufactured home is adjacent to a higher structure, drifted snow loads MUST be calculated in accordance with ASCE 7-93. An average value including the drifted load may be used with the Foundation Design Load Tables.

D-200.4 WIND LOAD DESIGN FACTORS.

A. Model for Analysis. The methodology for resistance of the box to uplift, overturning and sliding utilizes equations for Main Wind-Force Resisting Systems as defined in ASCE 7-93.

B. Basic Wind Speed. The basic wind speed map is found on page H-14. Wind factors have been included in the derived values

for the Foundation Design Load Tables of Appendix B.

C. Design Assumptions.

1. To convert mile per hour (MPH) wind speed to a basic wind velocity pressure (q) in pounds per square feet (psf) use the following equation from ASCE 7-93:

$$q = 0.00256 \times K_z \times (V \times I)^2$$

where:

- a. Mean roof height is assumed to be less than or equal to 15 feet from grade.
- b. Basic Wind Speed (V) is from the isobar map on page H-14 for the unit's geographic location.
- c. Velocity Pressure Coefficient (K_z) is based on Exposure C: open terrain with scattered obstructions having heights generally less than 30 feet. This Category includes flat open country and grasslands. For these conditions, including item (a) above, $K_z = 0.8$.
- d. Importance Category I (residential) for inland sites, sets $I = 1.0$, while for coastal sites (hurricane oceanline) $I = 1.05$. Linear interpolation can be utilized for sites between the oceanline and 100 miles inland; however, this was not done for the tables of Appendix B. Thus, only the above two values have been included.

2. Velocity pressure (q) is applied to surfaces, i.e. walls and roof planes, to generate design wind pressures (p) for Main Wind-Force Resisting Systems. Design wind pressures (p) are based on external and internal effects utilizing the following equation from ASCE 7-93:

$$p = q \times Gh \times C_p - q \times (\pm GC_{pi})$$

(external) - (internal)

where:

- a. The Gust Response Factor (Gh) is assumed to be based on Expo-

sure C (see section D-200.4.C.1.c). The Minimum Property Standard (MPS) permits use of Exposure C regardless of whether the site is inland or coastal. Thus, for units of assumed mean height less than or equal to 15 feet, $Gh = 1.32$.

- b. External Roof and Wall Pressure Coefficients (C_p) vary on the windward roof surface based on the structural issue being analyzed. Figure D-4 illustrates the various (C_p) values for the transverse and longitudinal di-

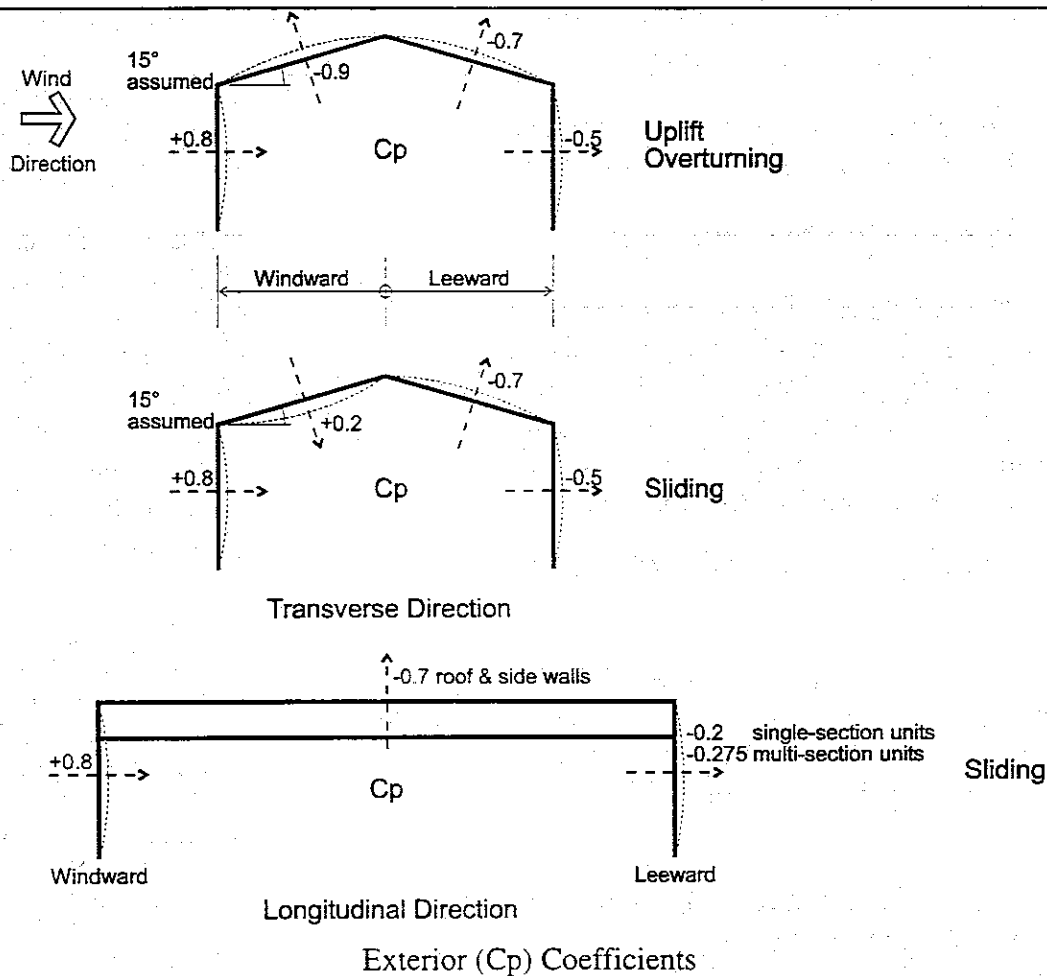


Figure D - 4

rections. A roof slope of 10 to 15 degrees (2 in 12 to 3 in 12) produces 2 possible situations: (+0.2) pressure and (-0.9) suction. The value (-0.9) was selected to produce maximum suction for uplift and overturning while (+0.2) was selected to maximize sliding. Note that (+) means pressure on the external surface, while (-) means suction on the external surface. For the leeward wall in the longitudinal direction the proportions of the unit (L/Wt) are important to establishing the proper exterior (Cp) value. Single-section units,

regardless of the combination of width or length, has a ratio $L/Wt \geq 4.0$; therefore, $C_p = -0.2$. For multi-section units An average proportion of unit (28' x 70', or 32' x 80') was assumed. Thus, the L/Wt ratio was 2.5 and by interpolation $C_p = -0.275$. Single or multi-section units have a Wt/L ratio, which is ≤ 1.0 for all proportions of units. Thus, the leeward value for $C_p = -0.5$ in the transverse direction.

- c. Internal Roof and Wall Pressure Coefficients assume a uniform distribution of openings on all

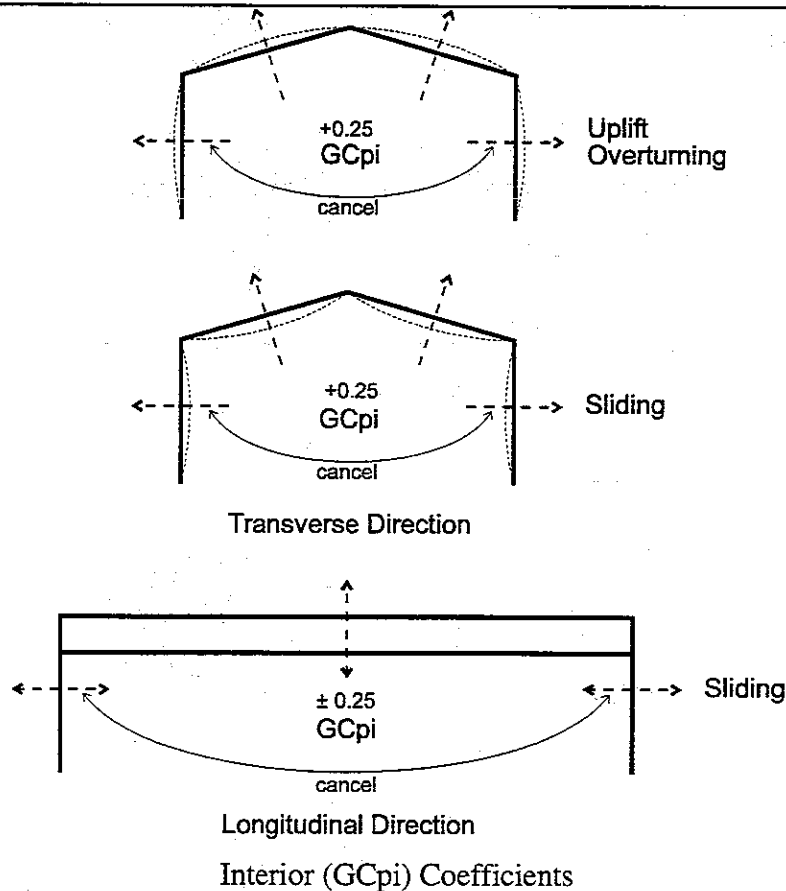


Figure D - 5

surfaces, thus $GC_{pi} = \pm 0.25$. Figure D-5 illustrates the pressures and suctions used for various structural considerations. Note that the walls receive offsetting values that cancel any internal effect; therefore, only the roof (GC_{pi}) values are utilized for the calculation of overturning and sliding in the transverse direction. Internal roof Pressures are not utilized in the longitudinal direction.

- d. Wind pressures and suctions are typically treated as uniformly

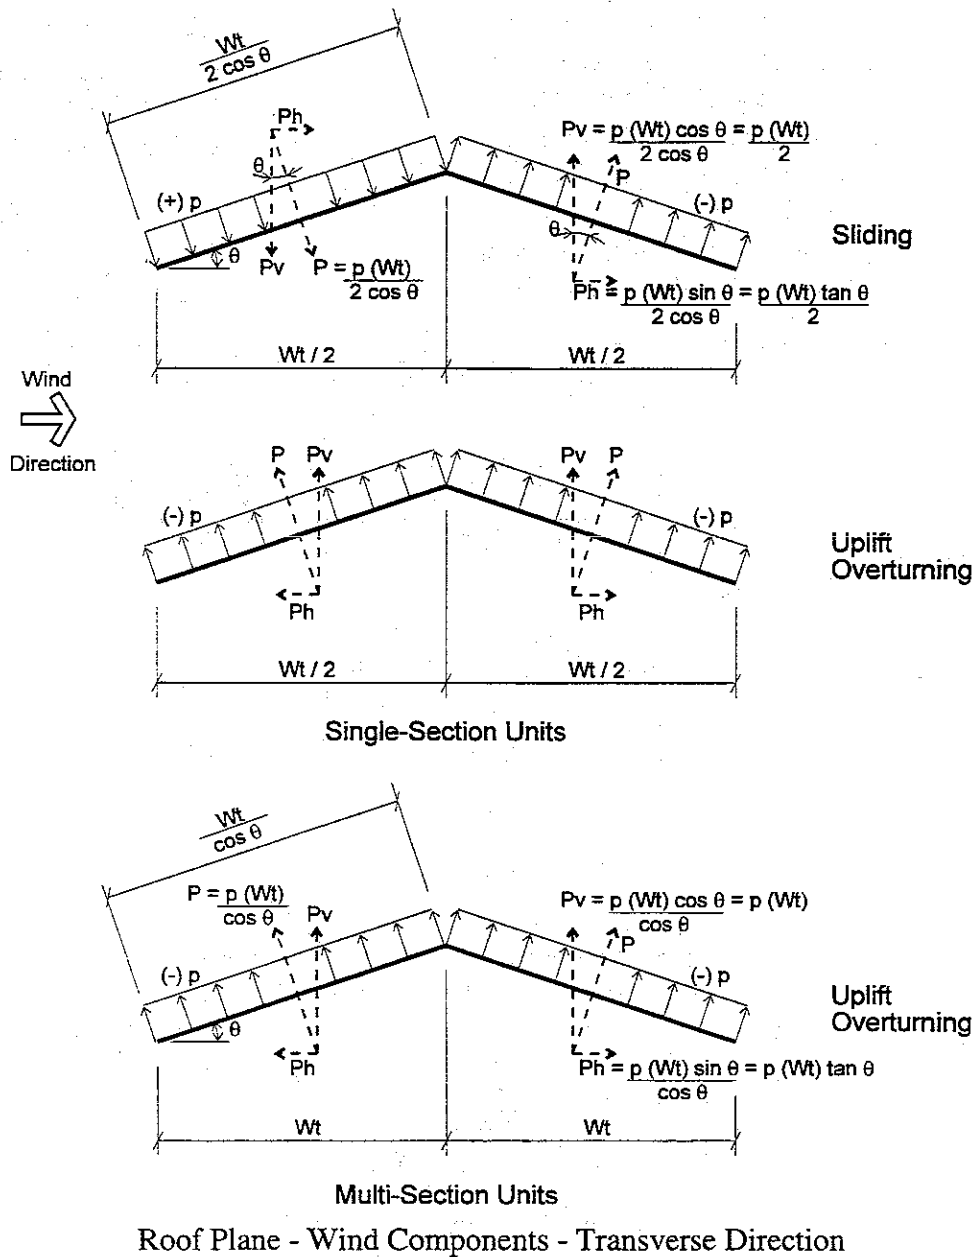



Figure D - 6

distributed and typically applied perpendicular to the orientation of any planar surface. This usually requires the calculation of horizontal and vertical components when wind is applied to sloping surfaces, in this case only roof planes. Figure D-6 illustrates that by the use of trigonometry the resultant force (P) on any sloping surface has components (P_V) and (P_H), which can be arrived at as shown. Note that for the vertical components (P_V) it is possible to merely multiply the pressure (p) by the horizontal length of the slope ($Wt/2$) for single section units or by (Wt) for multi-section units. This approach simplifies the sample calculations provided in section D-300 for uplift, overturning and sliding in the transverse direction.

D-200.5 SEISMIC LOAD FACTORS.

A. Seismic Versus Wind Forces. It has been stated in Chapters 4 and 6 that seismic forces did not control over wind forces in the computations for consideration of overturning in the transverse direction; however, seismic forces did sometimes control over wind for certain situations of sliding in the transverse and longitudinal direction. This is particularly true in the longitudinal direction because only the end wall elevations are exposed to the wind, producing small applied horizontal forces. Seismic inertia forces are a function of mass that is the same in both directions, which may be larger than the wind forces in particular when the geographic region is also a high snow region.

B. Dead Loads. The model assumes use of the "heavy" dead load values for roof, floor and wall components from Table D-1. It is assumed that the weight of the exterior walls and the weight of the marriage wall (for multi-section units only) are distributed half to the roof plane and half to the floor plane. The

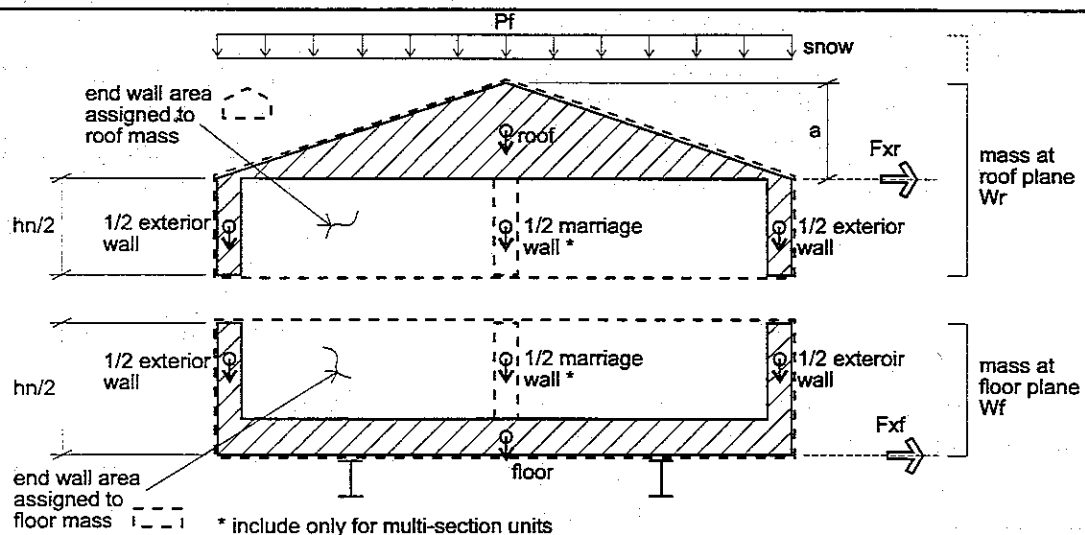

Seismic Dead Load Distribution

Figure D - 7

marriage wall was assumed continuous, without any large openings to maximize the dead load. This distribution of the dead load is illustrated in Figure D-7 to arrive at inertia forces (Fxr) and (Fxf). The weight of the end walls was included in the total mass of the unit and distributed to the roof and floor as shown in Figure D-7 and defined by the equations below:

1. Areas at each end of a Single-Section unit:

$$A_r = \frac{W_t \times a}{2} + \frac{hn}{2} \times W_t$$

$$A_f = W_t \times \frac{hn}{2}$$

2. Areas at each end of a Multi-Section unit:

$$A_r = W_t \times a + 2 \times W_t \times \frac{hn}{2}$$

$$A_f = 2 \times W_t \times \frac{hn}{2}$$

3. These areas are multiplied by the heavy wall weight of 5.9 psf resulting in total roof and floor load additions respectively for Single or Multi-Section units as follows:

$$W_{\text{endroof}} = 2 \times 5.9 \times A_r$$

$$W_{\text{endfloor}} = 2 \times 5.9 \times A_f$$

The above loads are in pounds and are smeared into the unit's dead load for overturning by using an average length of 60 feet, while for sliding they are smeared into the unit's dead load by dividing by "L". See Section D-200.5.E.7.a for further clarification.

C. Snow Loads. When the flat roof snow load (Pf) is less than 30 psf, the snow load to be attributed to the mass at the roof plane shall be zero. Where siting and snow duration and conditions warrant, and roof snow load is equal to or exceeds 30 psf, the snow load shall be added to the mass of the roof plane. The local authority may permit a reduction in snow load by as much as 80%. See Figure D-7. Note that roof snow load (Pf) has been previously defined as 70% of the ground snow load (Pg) in section D-200.3B.

D. Miscellaneous Loads. No consideration of partial occupancy live load was included in the mass of the floor plane; however, mechanical and partition load was included in the floor plane.

E. Seismic Analysis Method. The Equivalent Lateral Force Procedure (ELF) was assumed for manufactured housing units, as defined by ASCE 7-93. No plan or elevation irregularities were assumed. Thus, the manufactured home superstructure was assumed to be a simple rectangular box with proportions of length to width not exceeding 5 to 1.

1. The Fundamental Period (T): the manufactured home is assumed to have the same period in either direction, transverse or longitudinal, determined from the following equation:

$$T = C_t \times h^{3/4}$$

where:

- a. $C_t = 0.02$ for the category of: all other buildings.

- b. the height from bottom of footing to the mean roof height (h) has been assumed as 13.5 feet.
- c. Thus: $T = 0.14$ seconds.
2. Site Coefficient (S): the site has been selected for the most significant soil classification, thus $S = 2.0$.
3. The Response Modification Coefficient (R): the structure has been selected as a bearing wall system with light frame walls with shear panels. Thus, $R = 6.5$.
4. Effective peak velocity-related acceleration coefficient (\underline{A}_v): is selected for the geographic location based on the map H-16 in Appendix H.
5. The Seismic Design Coefficient (\underline{C}_s) is determined by the following equation:

$$\underline{C}_s = \frac{1.2 \times \underline{A}_v \times S}{R \times T^{2/3}}$$

Insertion of all the above values in the equation for (\underline{C}_s) leads to the results tabulated below:

\underline{A}_v	\underline{C}_s
0.15	0.204
0.2	0.273
0.3	0.409
0.4	0.546

6. But (\underline{C}_s) need not exceed the following equation:

$$\underline{C}_s = \frac{2.5 \times \underline{A}_a}{R}$$

where:

- a. Effective peak acceleration coefficient (\underline{A}_a): selected for the geographic location based on map H-15 in Appendix H.
- b. The results are tabulated below:

\underline{A}_a	\underline{C}_s
0.15	0.058
0.2	0.077
0.3	0.115
0.4	0.154

- c. The values for (\underline{C}_s) are definitely smaller in item (6.b) above rather than in item (5.a), thus \underline{C}_s is based on the equation in item (6). Thus, for this Manual assuming $\underline{A}_a = \underline{A}_v$:

$$\underline{C}_s = \frac{2.5 \times \underline{A}_a}{R}$$

7. The basic equation for base shear (V_B), using the (ELF) method, is:

$$V_B = \underline{C}_s \times W$$

where:

- a. The total weight (W) is the summation of the roof plane mass and the floor plane mass, including snow as applicable, as a function of unit length. It is advantageous to keep the roof and floor loads separated for calculation ease and kept in units of lbs/ft of unit length as follows:

For a Single-Section Unit:

$$w_{\text{roof}} = 9.7 \times Wt + 44.25 + \frac{W_{\text{endroof}}}{L} + \%P_f \times Wt$$

$$w_{\text{floor}} = 13.0 \times Wt + 44.25 + 18 + \frac{W_{\text{endfloor}}}{L}$$

For a Multi-Section Unit:

$$w_{\text{roof}} = 19.4 \times Wt + 44.25 + 26.25 + \frac{W_{\text{endroof}}}{L} + 2 \times \%P_f \times Wt$$

$$w_{\text{floor}} = 26.0 \times Wt + 36 + 44.25 + 26.25 + \frac{W_{\text{endfloor}}}{L}$$

Note: For overturning calculations, where (L) does not enter the equations, use L=60 ft as an average length to smear the end wall load. For Sliding (L) is always required and the end wall weight is smearing over the real length (L).

Where for either the Single or Multi-Section unit, the total dead load per foot of length of the unit becomes:

$$W = w_{\text{roof}} + w_{\text{floor}}$$

- b. The seismic coefficient (C_s) is based on equation in item (6.b).
8. The base shear (V_B) is then distributed vertically as inertia forces (F_{xr} and F_{xf}) to the floor and roof levels according to the mass that exists at each level (see Figure D-7), based on the following generic equation:

$$F_x = C_{vx} \times V_B$$

where also generically:

$$C_{vx} = \frac{w_x \times h_x}{\sum_{i=1}^n (w_i \times h_i)}$$

- a. The weight and height at each respective level is subscripted with an (x) while the sum of the product of each level's weight and height are generically subscripted with an (I). The uppermost level of the building (n) is in this case the roof. For a one story manufactured home, there will only be two levels, w_{roof} and w_{floor} reducing to two expressions substituting Single or Multi-Section unit values as follows:

$$C_{\text{roof}} = \frac{w_{\text{roof}} \times h_r}{w_{\text{roof}} \times h_r + w_{\text{floor}} \times h_f}$$

$$C_{\text{floor}} = \frac{w_{\text{floor}} \times h_f}{w_{\text{roof}} \times h_r + w_{\text{floor}} \times h_f}$$

Thus, the inertia forces in lbs/ft of unit length at the two respective levels becomes:

$$F_{xr} = C_{\text{roof}} \times V_B \quad \text{and,}$$

$$F_{xf} = C_{\text{floor}} \times V_B$$


- b. Sample spreadsheet output for two cases (snow $P_g = 0$ psf and snow $P_g = 100$ psf) indicates the range of (F_{xr}) and (F_{xf}) values at the roof and floor levels respec-

tively for a single section unit. These examples include the 12, 14 and 16 nominal width units and are labeled as Tables D-2 and D-3. Note: nominal, rather than actual unit width (W_t) were used in the dead load calculations for conservatism.

- The forces (F_{xr} and F_{xf}) were applied to the manufactured home unit as illustrated in Figure D-7 and used for transverse and longitudinal overturning and sliding calculations for comparison to the wind forces. The forces that produced the largest required resistance values were used in the Foundation Design Load Tables - Appendix B. Values that are grayed in the Tables of Appendix B are controlled by seismic inertia forces.

D-300. SAMPLE EQUATIONS USED FOR FOUNDATION DESIGN LOAD TABLE VALUES.

D-300.1 REQUIRED EFFECTIVE FOOTING AREA. Refer to Figures D-8(A&B) and D-9(A&B) for the free-body diagrams illustrating the applied gravity loads on the superstructure and on the foundation for a Type C and Type E or I single-section unit, and a Type C multi-section unit with consideration of a continuous marriage wall and a marriage wall with a large opening. Note that the "heavy" dead loads are used from Table D-1. For allowable stress design methodology, the load combination from ASCE 7-93 is: $DL(\text{heavy}) + LL(\text{occupancy}) + LL(\text{attic}) + SL(\text{or min. roof LL})$.

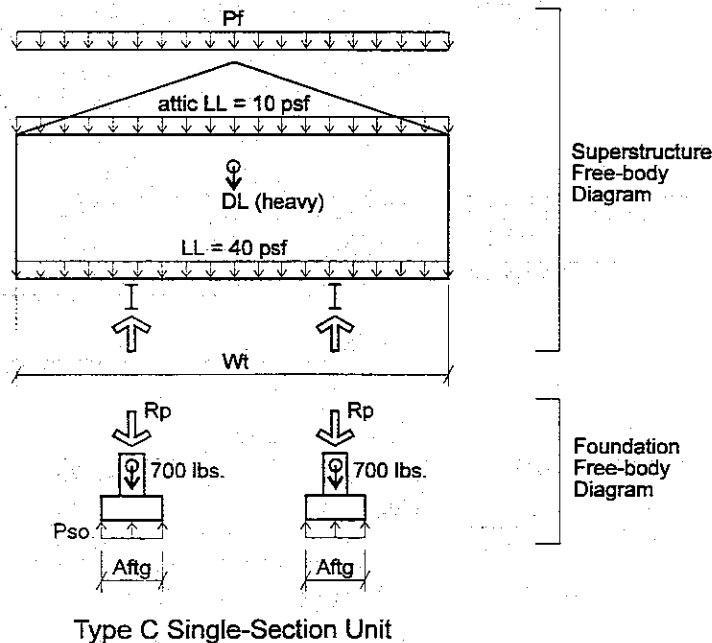

Gravity Loads

Figure D -8A

Seismic

Smax= 2 R= 6.5 hn= 11.0 ft
 Exposure Group I Ct= 0.02
 Seismic Performance A to D Assume no plan or elevation irregularities
 Equivalent Lateral Force Procedure
 Period: $T_a=C_t(hn)^{3/4}= 0.120802$
 $T_{max}=T_a \cdot C_a$ Ca= 1.5 (1.5 max for Av=.15)
 $T_{max}= 0.181203$

Cs max=2.5*Aa/R

Aa	Cs max
0.15	0.057692
0.20	0.076923
0.30	0.115385
0.40	0.153846

Snow Load: Pg= 100 psf Pf= 70 psf

	DL	Wt	
	12.0	14.0	16.0
roof	1000.65	1160.05	1319.45
floor	218.25	244.25	270.25
total	1218.90	1404.30	1589.70

Width 12 ft

Vbase= 70.32 93.76 140.64 187.52

	w	h	w*h	Cvx	Fx=Cvx*Vbase Aa			
					0.15	0.2	0.3	0.4
roof	1000.65	11.0	11007.15	0.943856	66.37	88.50	132.75	176.99
floor	218.25	3.0	654.75	0.056144	3.95	5.26	7.90	10.53
sum	1218.90		11661.90	1.0	70.32	93.76	140.64	187.52

Width 14 ft

Vbase= 81.02 108.02 162.03 216.05

	w	h	w*h	Cvx	Fx=Cvx*Vbase Aa			
					0.15	0.2	0.3	0.4
roof	1160.05	11.0	12760.55	0.945695	76.62	102.16	153.24	204.31
floor	244.25	3.0	732.75	0.054305	4.40	5.87	8.80	11.73
sum	1404.30		13493.30	1.0	81.02	108.02	162.03	216.05

Width 16 ft

Vbase= 91.71 122.28 183.43 244.57

	w	h	w*h	Cvx	Fx=Cvx*Vbase Aa			
					0.15	0.2	0.3	0.4
roof	1319.45	11.0	14513.95	0.947095	86.86	115.82	173.72	231.63
floor	270.25	3.0	810.75	0.052905	4.85	6.47	9.70	12.94
sum	1589.70		15324.70	1.0	91.71	122.28	183.43	244.57

Seismic Forces - Ground Snow 100 psf

Table D - 3

A. Gravity Load Considerations for the Type C Single-Section Unit.

1. *General:* The foundation to support the superstructure gravity loads is provided only by the spaced piers under the chassis beams.
2. *Superstructure load to a pier:* As shown in Figure D-8A the snow load, the attic live load and the roof dead load are transferred equally to each exterior wall. The exterior walls in turn transfer the roof loads to the floor framing. The floor live and dead load combine with the roof and wall load to reach the chassis beam, where the foundation piers receive the total concentrated superstructure load (Rp) in proportion to the pier spacing.

$$R_p = \left[(P_f + (40 + 10)) \times \frac{W_t}{2} + \frac{DL}{2} \right] \times \text{spacing}$$

3. *Typical chassis beam pier foundation weight:* The typical pier assumed for the calculations is based on a pier composed of four 8"x8"x16" concrete masonry units grouted solid with a 2 foot square footing that is 8 inches deep. Thus the assumed pier weight is as follows:

pier: $2.67' \times 1.33' \times 84 \text{ psf} = 298.0 \text{ lbs.}$
 footing: $150 \text{ pcf} \times 2' \times 2' \times .67' = 402.0 \text{ lbs.}$
 total = 700.0 lbs.

4. *Required chassis beam Pier Footing size:* The footing area (Aftg) must be large enough so that the net allowable soil bearing pressure (Pso)

is not exceeded under the full gravity dead, live and snow loads. Note that the pier and footing weight become additional dead load.

$$A_{ftg} = \frac{R_p + 700}{P_{so}}$$

B. Gravity Load Considerations for the Type E and I Single-Section Unit.

1. *General:* Support of the superstructure gravity loads is shared by the exterior longitudinal walls and the spaced interior piers under the chassis beams, which together comprise the foundation.
2. *Superstructure load to the exterior longitudinal foundation walls:* As shown in Figure D-8B, the snow load, the attic live load and the heavy roof dead load are transferred equally to each exterior wall. The exterior wall weight is added, and both loads transfer directly to the exterior foundation walls. A portion (dc/2) of the floor live and heavy dead load also goes to the exterior foundation walls. The total superstructure gravity load (Rw) transferred to the exterior foundation wall is in units of lbs./ft. of home length. The equation is as follows:

$$R_w = [P_f + (9.7 + 10)] \times \frac{W_t}{2} + (40 + 13) \times \frac{dc}{2} + 44.25$$

$$[\text{snow} + (\text{roof DL} + \text{attic LL})] + (\text{floor LL} + \text{DL}) + (\text{wall DL})$$

3. *Superstructure load to an interior pier:* The remainder of the floor dead and live load is equally divided between the chassis beam lines, and concentrated at the foundation piers based on their spacing. The total superstructure concentrated gravity load to a pier (R_p) is as follows:

$$R_p = \left[(40 + 13) \times \frac{W_t - dc}{2} + 9 \right] \times \text{spacing}$$

(floor DL+LL) (chassis beam DL)

4. *Typical exterior longitudinal foundation wall weight:* The typical exterior longitudinal foundation wall is assumed to be composed of a 6" poured concrete wall, 3'-8" high, and a 6" x 24" continuous concrete footing. Thus, the assumed weight


is as follows:

$$\begin{aligned} \text{wall: } & 150 \text{ pcf} \times 3.67' \times 0.5' = 275.0 \text{ plf} \\ \text{footing: } & 150 \text{ pcf} \times 2' \times 0.5' = 150.0 \text{ plf} \\ \text{total} & = 425.0 \text{ plf} \end{aligned}$$

5. *Required Exterior Wall Footing Width:* The footing width (W_f) must be large enough so that the net allowable soil bearing pressure (P_{so}) is not exceeded under the full gravity dead, live and snow loads. Note that the longitudinal foundation wall and footing weight become additional dead load. The required footing width:

$$W_f = \frac{R_w + 425}{P_{so}}$$

6. *Required Interior Pier Footing Area:* The footing area (A_{ftg}) must

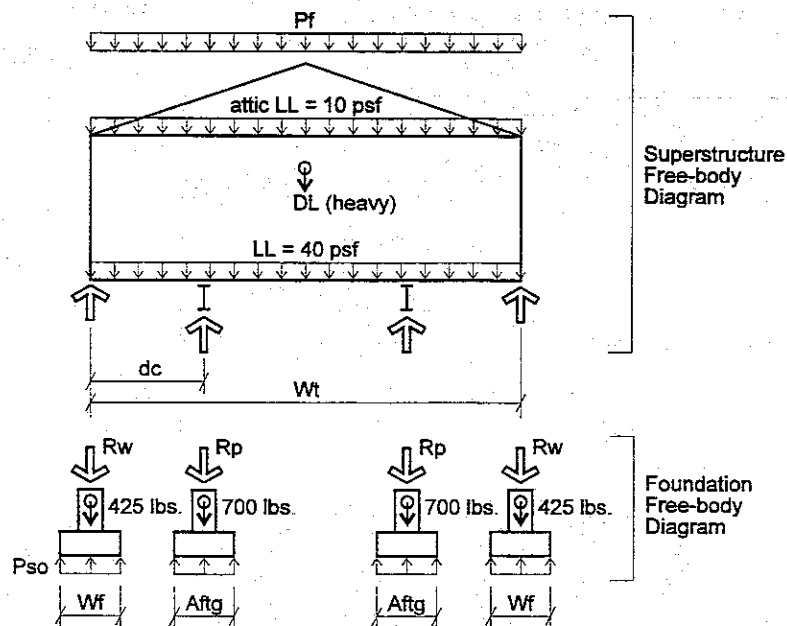

Type E and I Single-Section Units

Gravity Loads

Figure D -8B

be large enough so that the allowable soil bearing pressure (P_{so}) is not exceeded under the full gravity dead and live loads. Note that the pier and footing weight become additional dead load. The required footing area:

$$A_{ftg} = \frac{R_p + 700}{P_{so}}$$

C. Gravity Load Considerations for the Type C Multi-Section Unit with a Continuous Superstructure Marriage wall.


1. *General:* The foundation to support the superstructure gravity loads is provided only by spaced piers under the chassis beams and under the continuous marriage wall.
2. *Superstructure continuous marriage wall load to a pier:* As shown in Figure D-9A the snow load, the attic

live load and the roof dead load are transferred between the marriage wall and the exterior walls as bearing walls. The marriage wall in turn transfer the roof loads to the floor framing. A small portion of the floor live and dead load is assumed to combine with the roof loads and marriage wall weight to reach the top of the foundation pier as the total concentrated superstructure load (R_{pm}) in proportion to the pier spacing.

$$R_{pm} = \left[\frac{52.5 + (P_f + 19.7) \times W_t +}{(40 + 13) \times d_c} \right] \times \text{spacing}$$

$$[\text{marr. wall} + (\text{snow} + \text{roof DL} + \text{attic LL})] \\ (\text{floor DL} + \text{LL})$$

3. *Superstructure load to an exterior chassis beam pier:* As shown in Figure D-9A the snow load, the attic

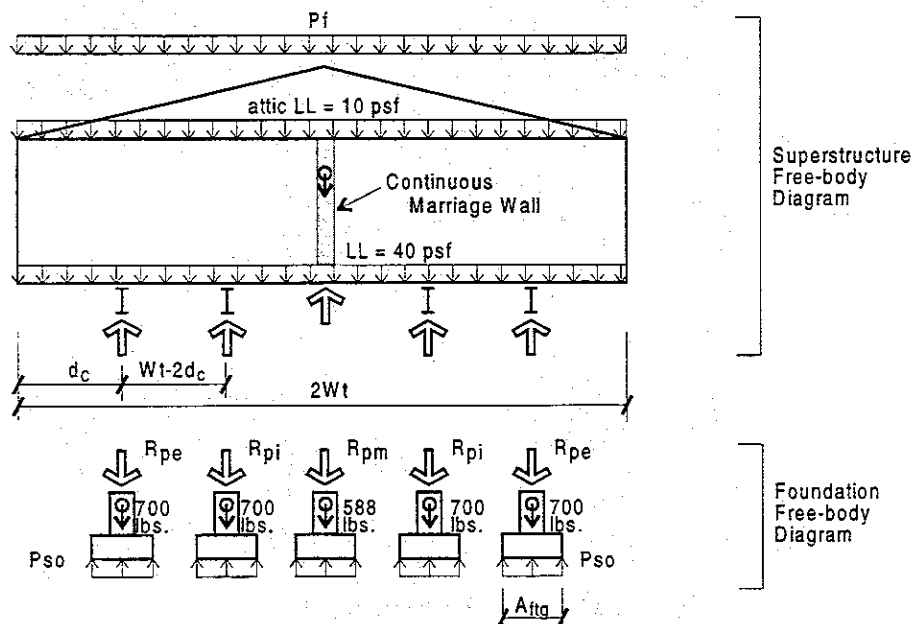

Type C - Multi-Section Unit w/Continuous Marriage Wall

Figure D - 9A

live load and the roof dead load are transferred equally between the exterior wall and the marriage wall. The exterior wall in turn transfers the roof loads to the floor framing. The floor live and dead load combine with the roof and wall weight to reach the chassis beam, where the foundation piers receive the total concentrated superstructure load (Rpe) in proportion to the pier spacing.

$$R_{pe} = \left[\frac{(P_f + 19.7 + 40 + 13) \times W_t / 2 +}{(44.25 + 9)} \right] \times \text{spacing}$$

[snow+roofDL+atticLL+floorDL+LL]
(ext.wall DL+chassis bm.)

4. *Superstructure load to an interior chassis beam pier:* As shown in Figure D-9A The floor live and dead load comprise the only load to reach the interior chassis beam, where the foundation piers receive the total concentrated superstructure load (Rpi) in proportion to the pier spacing.

$$R_{pi} = \left[(40 + 13) \times \left(\frac{W_t - dc}{2} \right) + 9 \right] \times \text{spacing}$$

[(floorLL+DL)+chassis bm.]

5. *Typical Continuous Marriage Wall Pier:* The typical continuous marriage wall within the superstructure of the multi-section unit is assumed to have a foundation pier composed of five courses of 8"x8"x16" concrete block (ungrouted), and a concrete footing 2'x2' by 8" deep. The

dead load of a typical continuous marriage wall foundation pier is as follows:

$$\begin{aligned} \text{pier: } & 42 \text{ psf} \times 3.33' \times 1.33' = 186.0 \text{ lbs.} \\ \text{footing: } & 150 \text{ pcf} \times 2^2 \times .67' = \underline{402.0 \text{ lbs.}} \\ & \text{total} = 588.0 \text{ lbs.} \end{aligned}$$

6. *Required continuous marriage wall pier footing.* The footing area (Aftg) must be large enough so that the net allowable soil bearing pressure (Pso) is not exceeded under the full gravity dead, live and snow loads. Note that the pier and footing weight become additional dead load. The required footing area:

$$A_{ftg_{mar}} = \frac{R_{pm} + 588}{P_{so}}$$

7. *Required exterior chassis beam Pier Footing Area:* The footing area (Aftg) must be large enough so that the allowable soil bearing pressure (Pso) is not exceeded under the full gravity dead and live loads. Note that the pier and footing weight become additional dead load. The required footing area:

$$A_{ftg_{ext}} = \frac{R_{pe} + 700}{P_{so}}$$

8. *Required interior chassis beam Pier Footing Area:* The footing area (Aftg) must be large enough so that the allowable soil bearing pressure (Pso) is not exceeded under the full gravity dead and live loads. Note that the pier and footing weight become additional dead load. The required footing area:

$$Aftg_{int} = \frac{R_{pi} + 700}{P_{so}}$$


D. Gravity Load Considerations for the Type C Multi-Section Unit with a Superstructure Marriage wall containing one opening or two large adjacent openings.

1. *General:* The foundation to support the superstructure gravity loads, as illustrated in Figure D-9B, is provided only by spaced piers under the chassis beams, piers placed under the posts at the ends of marriage wall openings, and equally spaced piers under the continuous portions of the marriage wall.
2. *Marriage wall openings: limitations and assumptions.* Two marriage wall opening situations were reviewed: (1) a **single opening**, as il-

lustrated in Figure D-9C, is bounded by posts at the ends of the opening with continuous marriage walls extending beyond the opening width in both directions, and (2) **two adjacent marriage wall openings**, as illustrated in Figure D-9D, consisting of three posts with the outer two posts having continuous marriage walls extending beyond the two openings.

Note: A maximum 10 foot pier spacing was assumed under all continuous marriage wall portions.

Note: The center post between the two adjacent openings of the later scheme produces the largest concentrated load to a marriage wall pier. This is the condition used for

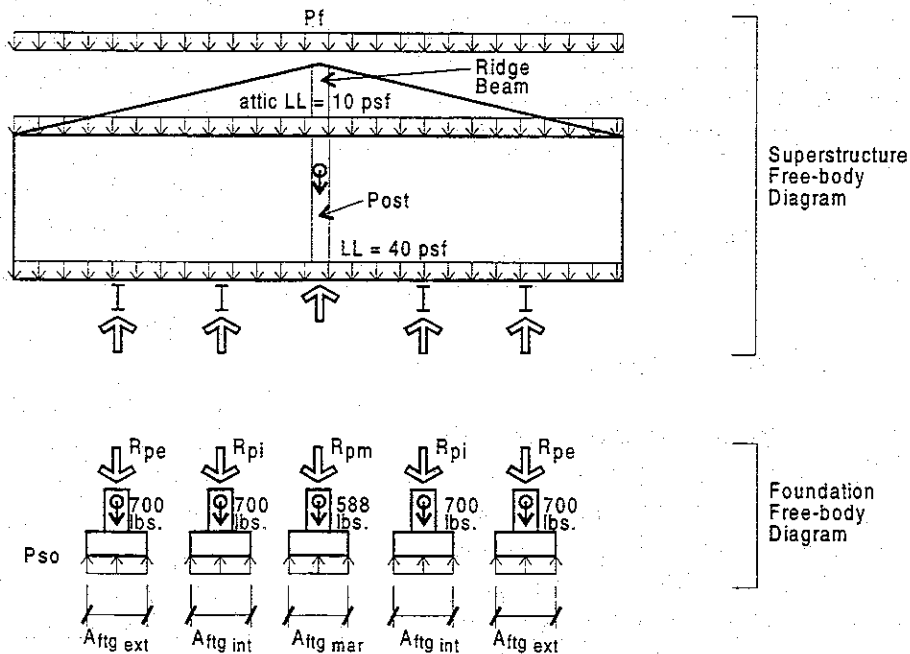

Type C - Multi-Section Unit w/Openings in Marriage Wall

Figure D - 9B


centrated load to a marriage wall pier. This is the condition used for the equations that follow.

Note: It is conservatively assumed that the footing size required under the center post will be used under all three posts in the Appendix B Part 1 Tables for Multi-section units.

Note: The opening width used for two adjacent openings in the Ap-


pendix B Tables, is the average of the two opening widths: $(x+x_1) \div 2$. The marriage wall opening tables use 2 foot increments for single openings, or the average of two adjacent openings, from 10 feet to 20 feet.

3. *Superstructure: Two large adjacent marriage wall openings: load to the pier under center post:* As shown in Figure D-9D the snow load, the attic

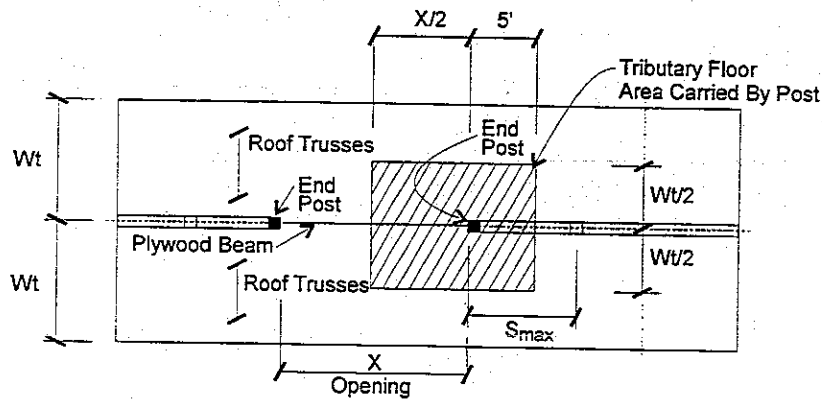

Assume $S_{max} = 10$ ft

Roof Plan

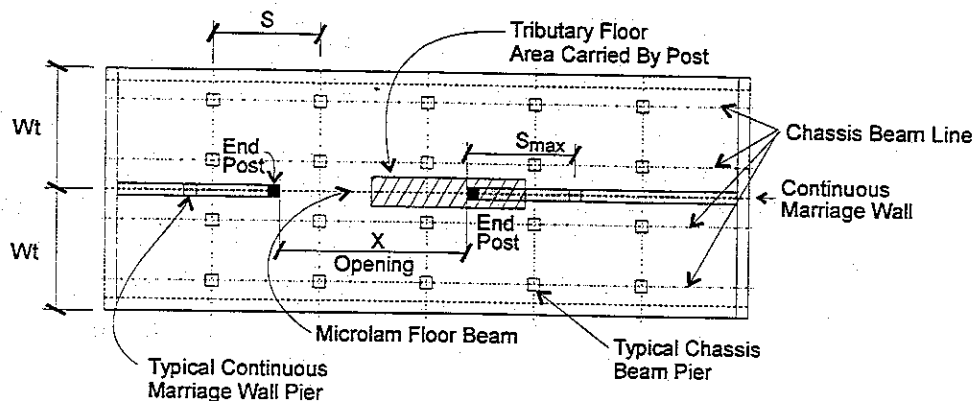

Floor Plan


Marriage Wall w/Large Single Opening

Figure D - 9C


live load and the roof dead load are transferred between the marriage wall ridge beam and the exterior wall ridge beams as bearing points. The marriage wall ridge beam (assumed to act as two simple span beams) transfers the average of the two opening widths of the roof and attic

loads to the center post. The floor live and dead load is assumed to be carried by floor beams, and also is transferred based on the average width of the two openings.

Note: For a single opening $x_1=0$ and all the formulas still work.

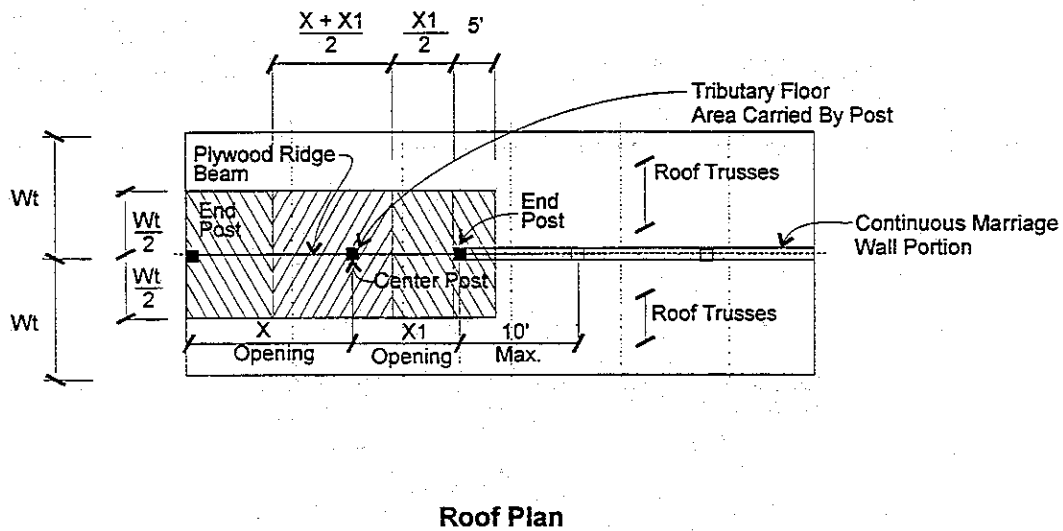

Roof Plan

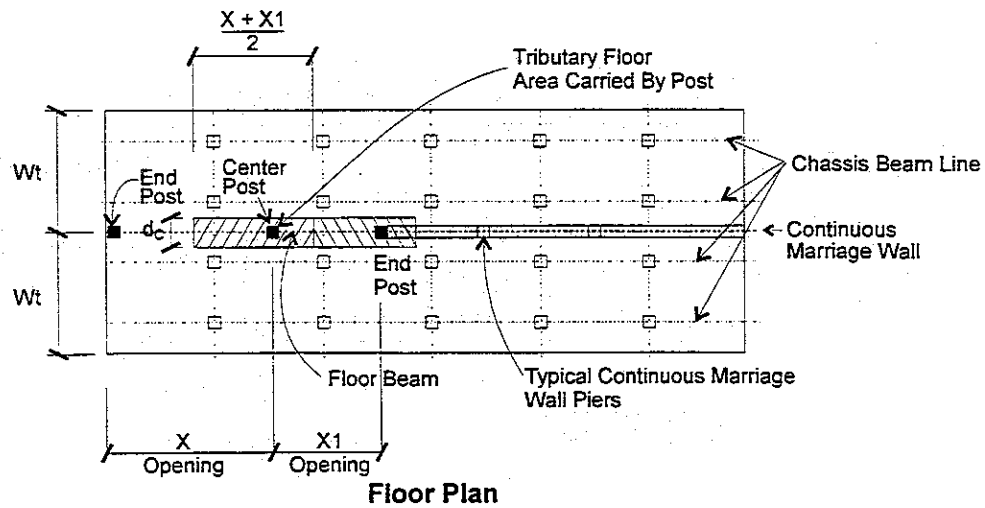

Floor Plan

Marriage Wall w/Two Adjacent Openings

Figure D - 9D

The floor beam is assumed to weigh 10 plf and the ridge beam is assumed to be composed of 6 layers of 3/8" plywood at a depth of 3 feet. Thus, the ridge beam weighs 19.8 plf. The post is assumed to be a 4x4 of weight 32 lbs. The total concentrated superstructure load to the pier (Rmax):

$$R_{pm} = \left[\frac{(Pf + 19.7) \times Wt + (40 + 13) \times dc + 10 + 19.8}{2} \right] \times \left(\frac{x + x_1}{2} \right) + 32$$

[(snow+roofDL+attic LL)]
(floor DL+LL)+floor bm+Ridge bm
+post DL

4. *Superstructure load to an exterior chassis beam pier:* the superstructure load to an exterior pier is unchanged from that for a Type C multi-section unit with a continuous marriage wall. Thus, the total concentrated superstructure load (Rpe) is repeated here:

$$R_{pe} = \left[\frac{(Pf + 19.7 + 40 + 13) \times Wt / 2 + (44.25 + 9)}{2} \right] \times \text{spacing}$$

[snow+roofDL+atticLL+floorDL+LL]
(ext.wall DL+chassis bm.)

5. *Superstructure load to an interior chassis beam pier:* the superstructure load to an interior pier is unchanged from that for a Type C multi-section unit with a continuous marriage wall. Thus, the total concentrated superstructure load (Rpi) is repeated here:

$$R_{pi} = \left[(40 + 13) \times \left(\frac{Wt - dc}{2} \right) + 9 \right] \times \text{spacing}$$

[(floorLL+DL)+chassis bm.]

6. *Required pier footing area for marriage wall containing large openings.* The footing area (Aftg) must be large enough so that the net allowable soil bearing pressure (Pso) is not exceeded under the full gravity dead, live and snow loads. Note that the pier and footing weight become additional dead load. The required footing area:

$$Aftg_{mar} = \frac{R_{pm} + 588}{P_{so}}$$

7. *Required pier footing areas for exterior and interior chassis beam lines.* See items 7 and 8 for a Type C Multi-section unit with a continuous marriage wall. Equations are the same and are repeated here for ease of use:

$$Aftg_{ext} = \frac{R_{pe} + 700}{P_{so}}$$

$$Aftg_{int} = \frac{R_{pi} + 700}{P_{so}}$$

E. Gravity Load Considerations for the Type E and Type I Multi-Section Unit with a Continuous Superstructure Marriage Wall.

1. *General:* As illustrated in Figure D-9E, the foundation to support the superstructure gravity loads is provided by spaced piers under the chassis beams, along the exterior wall and by spaced piers under the continuous marriage wall.

D - 25 **Note:** Foundation Concepts E5 and E7 do not follow the equation development presented here and are treated


separately, later in Section D.300.1.

2. *Superstructure continuous marriage wall load to a pier:* Identical to that shown in Figure D-9A for the Type C multi-section unit; the snow load, the attic live load and the roof dead load are transferred between the marriage wall and the exterior walls as bearing walls. As shown in Figure D-9E the marriage wall in turn transfers the roof loads to the floor framing. A small portion of the floor live and dead load is assumed to combine with the roof loads and marriage wall weight to reach the top of the foundation pier as the total concentrated superstructure load (R_{pm}) in proportion to the pier spacing.

$$R_{pm} = \left[\frac{52.5 + (P_f + 19.7) \times W_t +}{(40 + 13) \times d_c} \right] \times \text{spacing}$$

[marr.wall+(snow+roofDL+attic LL)]
(floor DL+LL)

3. *Superstructure load to an exterior and interior chassis beam pier:* As shown in Figure D-9E there are no gravity roof loads or exterior wall load transferred to the piers under the chassis beams. The floor live and dead load comprise the only load to reach the exterior and interior chassis beam, where the exterior and interior foundation piers receive the total concentrated superstructure load (R_{pe} and R_{pi}) equally in proportion to the pier spacing.

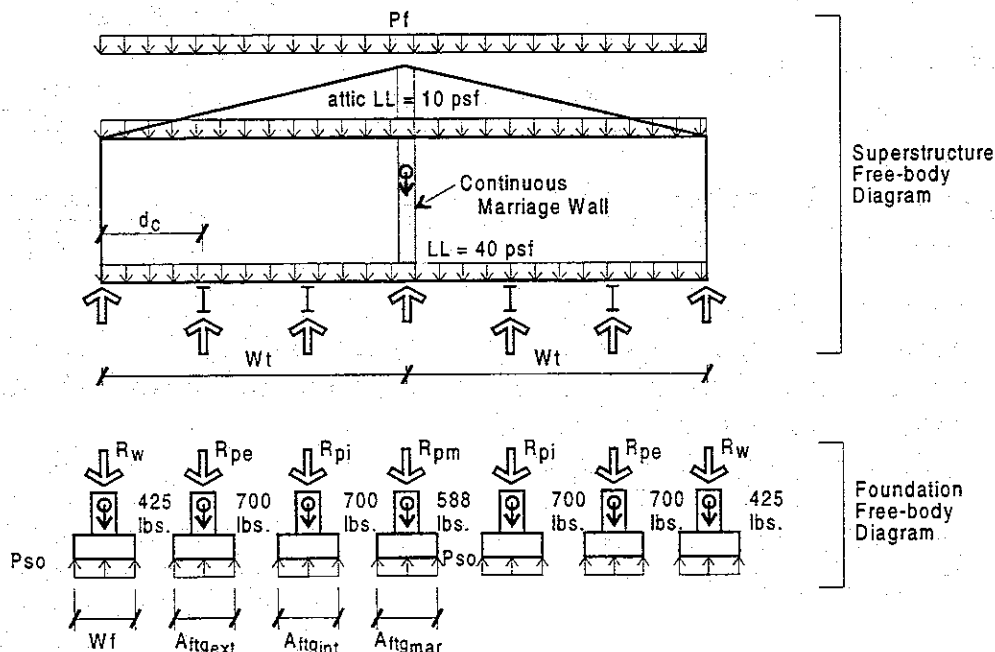

Type E and I - Multi-Section Units w/Continuous Marriage Wall

Figure D - 9E

$$R_{pe} = R_{pi} = \left[\frac{(40 + 13) \times \left(\frac{W_t - 2dc}{2} + \frac{dc}{2} \right) + 9}{2} \right] \times \text{spacing}$$

(floorDL+LL) (chassis bm.)

4. *Superstructure load to the exterior foundation wall.* As shown in figure D-9E the snow load, the attic live load and the roof dead load are transferred equally between the exterior wall and the marriage wall. The exterior wall in turn transfers the roof loads to the floor framing. A small portion of the floor live and dead load combine with the roof and wall weight to reach the foundation wall as a lineal uniform load (R_w).

$$R_w = (pf + 19.7) \times \frac{W_t}{2} + (40 + 13) \times \frac{dc}{2} + 52.5$$

5. *Required continuous marriage wall pier footing.* The footing area (A_{ftg}) must be large enough so that the net allowable soil bearing pressure (P_{so}) is not exceeded under the full gravity dead, live and snow loads. Note that the pier and footing weight become additional dead load. The required footing area:

$$A_{ftg_{mar}} = \frac{R_{pm} + 588}{P_{so}}$$

6. *Required exterior and interior chassis beam Pier Footing Area:* The footing areas (A_{ftg}) must be large enough so that the allowable soil bearing pressure (P_{so}) is not exceeded under the full gravity dead and live loads. Note that the pier

and footing weight become additional dead load. The required footing areas:

$$A_{ftg_{ext}} = A_{ftg_{int}} = \frac{R_{pe} + 700}{P_{so}}$$

7. *Required exterior foundation wall Footing Width:* The footing width (W_f) must be large enough so that the allowable soil bearing pressure (P_{so}) is not exceeded under the full gravity dead and live loads. Note that the wall and footing weight become additional dead load. The required footing width becomes:

$$W_f = \frac{R_w + 425}{P_{so}}$$

F. Gravity Load Considerations for the Type E and I Multi-Section Units with a Superstructure Marriage wall containing one opening or two large adjacent openings.

1. *Continuous marriage wall.* The equation development presented in Section D.300.1.E for loads and footing sizes at exterior foundation wall and exterior and interior chassis beam line piers is identical to that when a continuous marriage wall exists and will not be repeated here.
2. *One opening or two adjacent openings.* The considerations for the foundation piers under the posts that define one opening, or two adjacent large openings within the length of the continuous marriage wall, is the same as that for the Type C Multi-section unit presented in Section D.300.1D and illustrated in Figure

D-9D. The equation for the maximum reaction under the center post will be repeated here:

$$R_{pm} = \left[\frac{(Pf + 19.7) \times Wt + (40 + 13) \times dc + 10 + 19.8}{2} \right] \times \left(\frac{x + x_1}{2} \right) + 32$$

[(snow+roofDL+attic LL)]
(floor DL+LL)+floor bm+Ridge bm)
+post DL

Note: For a single opening $x_1 = 0$ and all the equations still work.

3. *Required marriage wall pier footing at center post.* The pier and footing weight become additional dead load. The required footing area under the center post location repeats also:

$$A_{ftg_{mar}} = \frac{R_{pm} + 588}{P_{so}}$$

Note: Regardless of Multi-Section Unit Type C, E or I the equations developed for piers under the continuous marriage walls and the equations developed for the pier under the center post, when two large marriage wall openings exist, do not change. The only exception is for the Type E5, (E6 uses E5 Tables) and E7 Multi-section units, which are presented further on in this Section D.300.1.

G. Gravity Load Considerations for the Type Cnw Multi-Section Unit with a continuous marriage wall (without any marriage wall piers).

1. *General:* As illustrated in Figure D-9F, the foundation to support the superstructure gravity loads is provided by spaced piers under the exterior and interior chassis beams. **Note:** A marriage wall with large openings is not considered feasible for this foundation concept, since it would require piers under the posts.

2. *Superstructure load to an interior or exterior chassis beam pier:* Similar to that shown in Figure D-9A for the Type C multi-section unit; the snow load, the attic live load and the roof dead load are transferred between the marriage wall and the exterior walls as bearing walls. The marriage wall and the exterior wall in turn transfer their dead weight and the roof loads to the floor framing. The floor live and dead load is equally distributed each chassis beam line. These loads from both levels combine to reach the top of the foundation pier as the total concentrated superstructure load (R_p) in proportion to the pier spacing.

Note: The only difference between the exterior pier load and the interior pier load is in the difference of the weight of the exterior wall and marriage wall. Since the exterior wall has a greater weight than the marriage wall, it will be used and thus the load to the exterior and interior chassis beam piers will be assumed equal.


$$R_{pe} = R_{pi} = \left[\begin{array}{l} (pf + 19.7) \times \frac{Wt}{2} + \\ (40 + 13) \times \frac{Wt}{2} \\ + (44.25 + 9) \end{array} \right] \times \text{spacing}$$

$$Aftg_{ext} = Aftg_{int} = \frac{Rp + 700}{Pso}$$

H. Gravity Load Considerations for the Type E5 Multi-Section Unit with a Continuous Superstructure Marriage Wall.

3. *Required exterior and interior chassis beam Pier Footing Area:* The footing area (Aftg) must be large enough so that the allowable soil bearing pressure (Pso) is not exceeded under the full gravity dead and live loads. Note that the pier and footing weight become additional dead load. The required exterior and interior footing areas become:

1. *General:* As illustrated in Figure D-9G, the foundation to support the superstructure gravity loads is provided by spaced transverse steel girders (under the chassis beams) that span between pilasters built into the exterior foundation walls and by spaced piers under the continuous marriage wall. A crawlspace exists below the first floor. The transverse steel girder is assumed to be composed of two simple spans that run from exterior wall to the central marriage wall piers, rather than

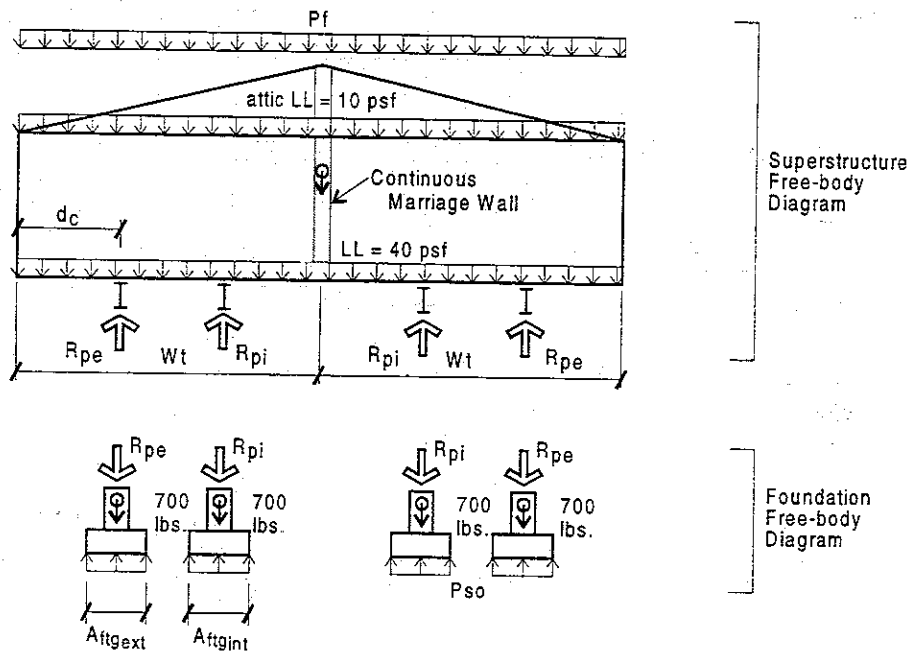

Type Cnw - Multi-Section Units w/Continuous Marriage Wall

Figure D - 9F

create a continuous two span girder.


Note: A licensed professional shall be responsible for the design of the transverse steel girders.

2. *Superstructure floor load transferred to the transverse steel girder and then to the exterior foundation wall pilaster.* As shown in Figure D-9G the floor dead and live load transfer to the chassis beam lines and present concentrated loads to the transverse girder. This concentrated load is then assumed to transfer to the end of the transverse girder and bear on the pilaster. Based on the transverse girder spacing, the concentrated load (F1) becomes:

$$F1 = \left[(40 + 13) \times \left(\frac{Wt - 2dc}{2} + \frac{dc}{2} \right) + 9 \right] \times \text{spacing}$$

(floorLL+DL)

3. *Superstructure load to the exterior foundation wall:* As shown in Figure D-9G the snow load, the attic live load and the roof dead load are transferred between the marriage wall and the exterior walls as bearing walls. The exterior wall transfers this load down to the top of the foundation wall. A small portion of floor load is assumed to also go to the foundation wall. This is a uniform linear load (F2) as follows:

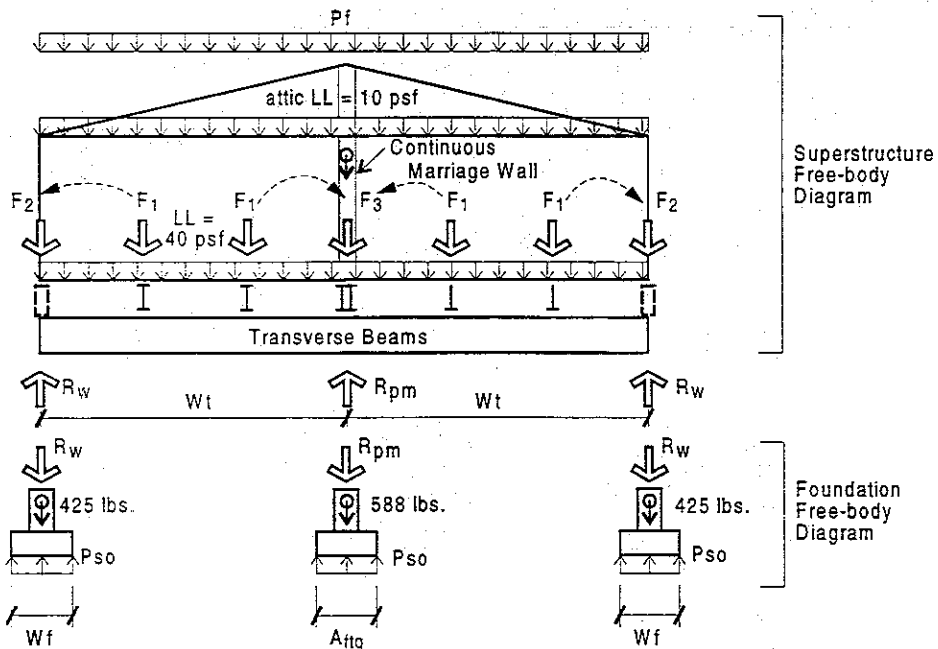

Type E5 Multi-Section Units w/Continuous Marriage Wall

Figure D - 9G

$$F2 = (Pf + 19.7) \times \frac{Wt}{2} + (40 + 13) \times \frac{dc}{2} + 44.25$$

(snow + roof DL + attic LL)
(floor LL + DL) (exterior wall DL)

4. *Superstructure total load to the exterior foundation wall:* As shown in Figure D-9G the pilaster receives load (F1) and this load plus the transverse girder weight of 20 plf spreads at a 45° angle along the wall length based on an assumed wall depth of 2 feet. Therefore, the spread in the wall is 4 feet. This spread load combines with the roof and exterior wall load (F2) to produce a total reaction (Rw) to the footing as follows:

$$Rw = \frac{F1 + \left(20 \times \frac{Wt}{2}\right)}{4} + F2$$

5. *Superstructure load at the marriage wall:* As shown in Figure D-9G the snow load, the attic live load and the roof dead load are transferred between the marriage wall and the exterior walls as bearing walls. The continuous marriage wall transfers this load down to the floor level and to a short steel post as a concentrated load, based on the spacing of the transverse girders. This concentrated load (F3) is as follows:

$$F3 = \left[\frac{(Pf + 19.7) \times Wt + 52.5 +}{(13 + 40) \times dc} \right] \times \text{spacing}$$

(snow + roof DL + LL) (marriage wall weight)
(floor DL + LL)

6. *Superstructure total load to a continuous marriage wall pier:* As shown in Figure D-9G two concentrated floor loads (F1) plus the concentrated load (F3) in addition to the transverse girder weight of 20 plf are assumed to be transferred to the continuous marriage wall pier as a total concentrated load (Rpm) as follows:

$$Rpm = 2 \times F1 + F3 + 20 \times Wt$$

7. *Required exterior foundation wall Footing Width:* The footing width (wf) must be large enough so that the allowable soil bearing pressure (Pso) is not exceeded under the full gravity dead and live loads. Note that the wall and footing weight become additional dead load. The required footing width becomes:

$$Wf = \frac{Rw + 425}{Pso}$$

Note: The width of the footing between pilasters is assumed to be the same as at the pilaster. It is uneconomical to continually jog footing forms. Plus the spread through the wall will almost encompass the entire wall between pilasters anyway.

8. *Required continuous marriage wall pier footing.* The footing area (Aftg) must be large enough so that the net allowable soil bearing pressure (Pso) is not exceeded under the

full gravity dead, live and snow loads. Note that the pier and footing weight become additional dead load. The required footing area:

$$A_{ftg_{mar}} = \frac{R_{pm} + 588}{P_{so}}$$


I. Gravity Load Considerations for the Type E7 Multi-Section Unit with a Continuous Superstructure Marriage Wall.

1. *General:* As illustrated in Figure D-9H, the load flow of the superstructure gravity loads is identical to that for the Type E5 multi-section unit, and the equation development is very similar. The only difference is that instead of a crawlspace, a full basement exists below the first floor. Thus, the exterior foundation

is a full depth basement wall and footing with space pilasters. Again, the transverse steel girder is assumed to be composed of two simple spans that run from exterior basement wall to the central marriage wall, where steel pipe columns and a spread footing are used instead of piers.

Note: A licensed professional shall be responsible for the design of the basement wall for gravity loads and lateral earth pressures; as well as the transverse steel girders and the steel pipe column.

2. *Exterior foundation basement wall and footing assumptions.* A 6'-8" headroom is assumed under the transverse girders that are assumed

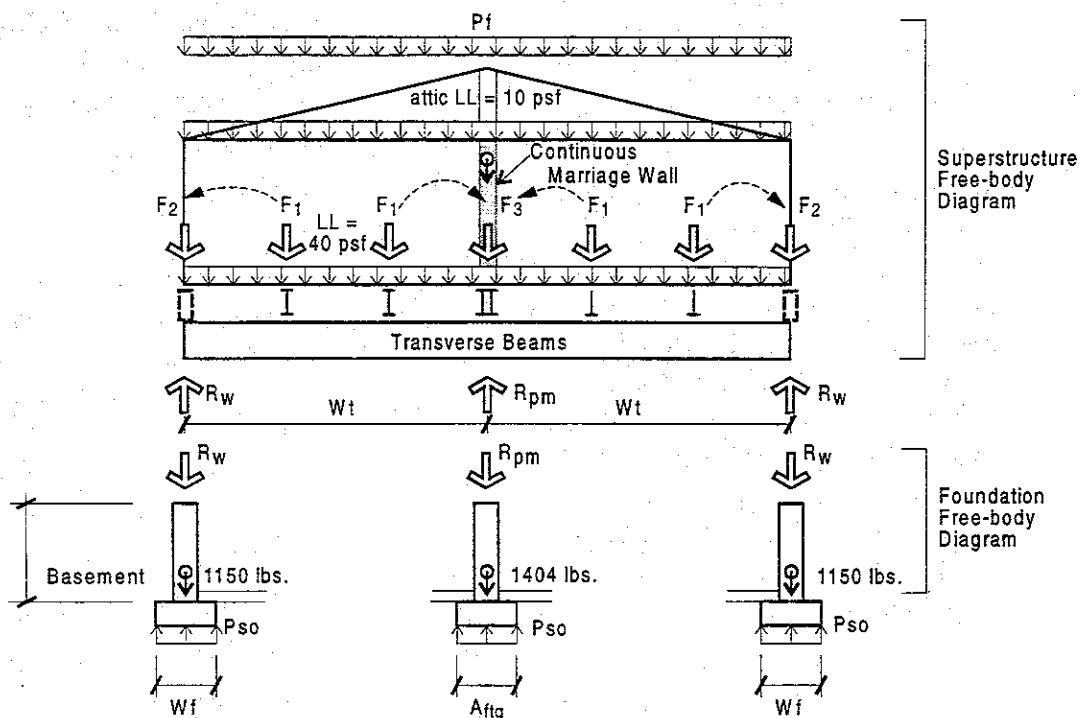

Type E7 Multi-Section Units w/Continuous Marriage Wall

Figure D - 9H

to be 12 inches deep. The chassis beams are assumed to be 10" deep. Thus, the total wall height to the top of basement floor is 8'-6". To maximize the gravity loading the walls are assumed to be 8 " solid concrete, rather than the also acceptable reinforced concrete block. The linear footing proportions are set at 1 foot deep x 2 feet wide. Since the pilaster only exists at the spacing of transverse girders its weight has been ignored. The foundation dead load becomes:

$$\begin{aligned} \text{Conc. wall: } 0.67' \times 8.5' \times 150 \text{ pcf} &= 850 \text{ plf} \\ \text{footing: } 1.0 \times 2.0 \times 150 \text{ pcf} &= \underline{300 \text{ plf}} \\ \text{total} &= 1150 \text{ plf} \end{aligned}$$

3. *Foundation under the marriage wall:* Steel pipe columns 3.5"φ are assumed spaced under the transverse girders with a base plate at the bottom and a cap plate at the top with holes for bolting. The footing is assumed to be 1' deep x 3' x 3'. The column/footing load is therefore:

$$\begin{aligned} \text{Column: } 7.6 \text{ plf} \times 7 \text{ feet tall} &= 54 \text{ lbs.} \\ \text{Footing: } 150 \text{ pcf} \times 1' \times 3' \times 3' &= \underline{1350 \text{ lbs.}} \\ \text{total} &= 1404 \text{ lbs.} \end{aligned}$$

4. Superstructure floor load transferred to the transverse steel girder and then to the exterior foundation wall pilaster. The load (F1) is identical to that for the Type E5 Multi-Section unit found in section D.300.1.H.2.
5. *Superstructure load to the exterior foundation wall:* The load (F2) is

identical to that for the Type E5 Multi-Section Unit found in section D.300.1.H.3.

6. *Superstructure load at the marriage wall:* The load (F3) is identical to that for the Type E5 Multi-Section Unit found in section D.300.1.H.5.

7. *Superstructure total load to the exterior foundation wall:* The pilaster receives load (F1) and the transverse girder weight of 20 plf. This load spreads at a 45° angle along the wall length based on an assumed wall depth of 8'-6" below the superstructure. Therefore, the spread in the wall would be greater than the maximum 10 foot spacing for transverse girders. The maximum Code prescribed spread is thus the spacing (s). This spread load combines with the roof and exterior wall load (F2) to produce a total reaction (Rw) to the footing as follows:

$$R_w = \frac{F_1 + \left(20 \times \frac{W_t}{2}\right)}{s} + F_2$$

8. *Superstructure total load to a continuous marriage wall pier:* The total concentrated load to the steel pipe column is identical to that for the Type E5 Multi-section unit concentrated load to a pier, found in section D.300.1.H.6. The total concentrated load (Rpm) is repeated here as follows:

$$R_{pm} = 2 \times F_1 + F_3 + 20 \times W_t$$

9. *Required exterior foundation wall Footing Width:* The footing width (wf) must be large enough so that the allowable soil bearing pressure (Pso) is not exceeded under the full gravity dead and live loads. Note that the wall and footing weight become additional dead load. The required footing width becomes:

$$Wf = \frac{Rw + 1150}{Pso}$$

10. *Required continuous marriage wall pipe column footing.* The footing area (Aftg) must be large enough so that the net allowable soil bearing pressure (Pso) is not exceeded under the full gravity dead, live and snow loads. Note that the steel column and footing weight become additional dead load. The required footing area:

$$Aftg_{mar} = \frac{Rpm + 1404}{Pso}$$

11. *Basement longitudinal beams used to space steel pipe columns further apart:* It would be possible to add longitudinal steel beams to support the transverse steel girders in order to avoid a large number of pipe columns. This produces concentrated loads to the longitudinal beams, which could be spaced (b) distance apart, assuming (b) > (s) by a significant amount. The value (n) is the number of transverse beams that occurs within the distance (b). The area of footing would then become:

$$Aftg_{mar} = \frac{b \times \left[\frac{2 \times F3 + F4}{s} + n \times 20 \times Wt \right] + 1404}{Pso}$$

Note: There are no tables in Appendix B to cover this situation. The steel pipe column, the transverse and longitudinal steel beams would require design by an engineer.

J. Gravity Load Considerations for the Type E5, E6 and E7 Multi-Section Units with a Superstructure Marriage Wall containing one opening or two large adjacent openings.

1. *General:* The presence of regularly spaced steel transverse girders in these foundation concepts complicates the equation development to account for randomly placed large openings along the marriage wall line. Any concentrated post load, defining the ends of an opening, that falls between transverse girders would require either another pier or column, that would in many cases be close enough to the grid of transverse girder piers and posts, as to overlap or abut- clearly uneconomical and impractical to construct.
2. *Marriage wall openings: assumptions and limitations:* It has been assumed and is now recommended in this Handbook, that opening widths for these three foundation concepts be a multiple of the transverse girder spacing for the practical reasons stated above. Any other assumptions would require the design of a licensed professional.

The equation development will again follow the logic and assumptions of Section D.300.1.D.2 and will not be repeated here. Thus, two adjacent openings will be considered, with the center post receiving the largest concentrated load. All three post locations will have their foundation sized based on that center post, thus introducing a degree of conservatism.

The equations for the exterior foundation footing width are identical to those of the individual concepts for the Type E5 (E6 uses E5) and E7 already developed for a continuous marriage wall, and will not be repeated here.

3. *Roof load to a center post between two large marriage wall openings:* The given situation, illustrated in the roof plan of Figure D-9I, shows two adjacent marriage wall openings that follows the assumption of openings being a multiple of the transverse girder spacing; one opening twice the width of the other, hence $x = 2s$ and $x_1 = s$. The tributary area of gravity loads carried by the center post as the concentrated load (P1) is as follows:

$$P1 = [(Pf + 19.7) \times Wt + 19.8] \times \left(\frac{x + x_1}{2} \right) + 32$$

(snow+roofDL+LL) (ridge bm) (postDL)

4. *Floor load to a center post between two large marriage wall openings:* Referring to the floor plan of Figure D-9I, the tributary area

illustrated produces the concentrated gravity load (P2) to the foundation below the post as follows:

$$P2 = [(40 + 13) \times Wt + 10 + 18] \times \left(\frac{2}{3} \right) \times \left(\frac{x + x_1}{2} \right) + 20 \times Wt$$

(floorLL+DL) (floor bm) (two chassis bms)
(transverse girder wt)

Note: The 2/3rds factor in the above equation is to account for an average floor load situation as illustrated in Figure D-9I.

5. *Total concentrated load (Rpm) to the foundation at a center post location:* The roof and floor loads combine to produce the total reaction (Rpm) to the foundation pier or column as follows:

$$Rpm = P1 + P2$$

6. *Required, adjacent opening center post location, marriage wall pier footing for Foundation Concept Type E5 and E6.* The footing area (Aftg) must be large enough so that the net allowable soil bearing pressure (Pso) is not exceeded under the full gravity dead, live and snow loads. Note that the pier and footing weight become additional dead load. The required footing area:


$$Aftg_{mar} = \frac{Rpm + 588}{Pso}$$

7. *Required, adjacent opening center post location, marriage wall pier footing for Foundation Concept*


footing for Foundation Concept Type E7. The footing area (Aftg) must be large enough so that the net allowable soil bearing pressure (Pso) is not exceeded under the full gravity dead, live and snow loads. Note that the pier and footing weight become additional dead load. The required footing area:

$$Aftg_{mar} = \frac{Rpm + 1404}{Pso}$$

Note: A foundation pier or column exists, centered below the larger marriage wall opening ($x = 2 \times s$) at a transverse girder line. The pier or column footing here should be sized only for the floor concentrated load (P2). Substitute (P2) for (Rpm) in the above two equations. This is left to the engineer and is not reflected in the Tables of Appendix B.

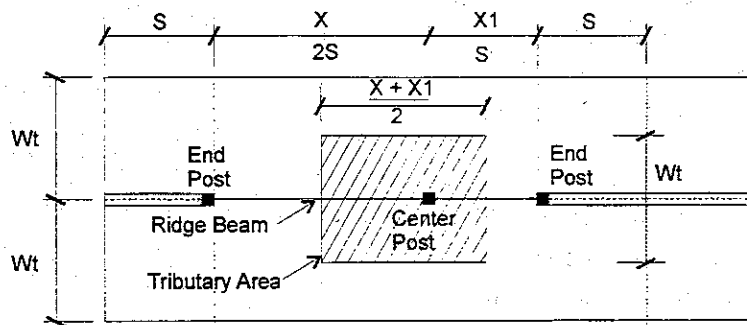

Roof Plan

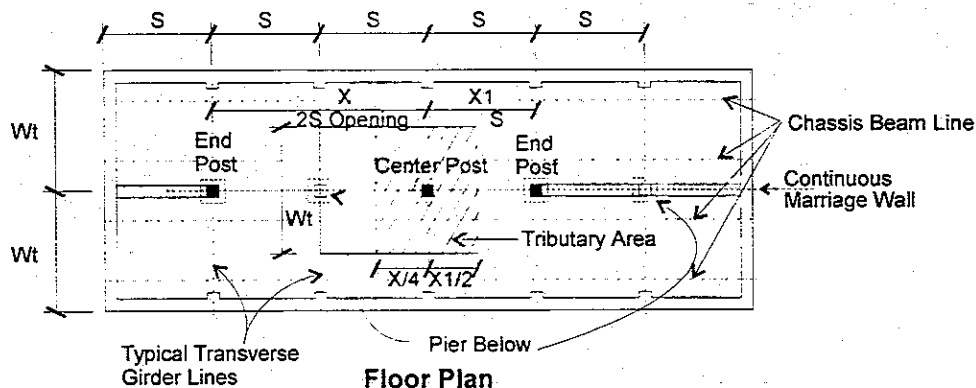

Floor Plan

Type E5, E6 and E7 - Marriage Wall w/Two Adjacent Openings

Figure D - 91

D-300.2 REQUIRED VERTICAL ANCHORAGE BASED ON WIND IN THE TRANSVERSE DIRECTION. Refer to Figures D-10 to D-12 for the free-body diagrams of the superstructure and foundation, illustrating the overturning forces due to wind and the element dead loads providing resistance. The foundation Types C, C1, E and I are included for single-section units. Figure D-4, D-5 and D-6 are also related to the equation development of this section. For allowable stress design methodology, the load combination from ASCE 7-93 is: (Wind) - DL.

A. Wind Load Considerations for the Type C Single-Section Unit.

1. *General:* The superstructure receives external and internal wind pressures or suctions (p) on the two walls and two sloping roof planes in accordance with the equation of section D-200.4.C.2. These wind pressures tend to overturn the superstructure, rotating it about the pivot point at the bottom of the chassis beam as shown on Figure D-10. The vertical anchorage force (A_v) necessary to prevent this uplift action is located at the opposite foundation pier. The anchorage connection of superstructure to foundation must be capable of transferring the (A_v) force to the pier. The dead load of the pier, footing and soil overburden must be equal to or greater than the (A_v) force to keep the superstructure from overturning.

2. *Wind Loads on the Superstructure:* As shown in Figure D-10, the resultant wind force at the top and bot-

tom of the wall are (P_t) and (P_b) respectively. The vertical component of the resultant wind force on the windward and leeward slope are (P_{vw}) and (P_{vl}) respectively. They are calculated as follows:

$$P_t = P_b = (p_{ww} + |p_{wl}|) \times \frac{h_p}{2}$$

$$P_{vw} = p_{rw} \times \frac{W_t}{2}$$

$$P_{vl} = p_{rl} \times \frac{W_t}{2}$$

3. *Overturning Moment of the Superstructure:* The resultant wind loads on each surface rotate about the pivot point shown in Figure D-10. The summation of the force times distance values define the equation:

$$M_o = P_t \times (h_p + 0.833) + |P_{vw}| \times \left(\frac{3 \times W_t}{4} - dc \right) + |P_{vl}| \times \left(\frac{W_t}{4} - dc \right) + P_b \times (0.833)$$

4. *Resisting moment of the superstructure:* The total dead load provides the only gravity load resistance to overturning. Using the light dead load from section D-200.1.B:

$$M_r = DL \times \left(\frac{W_t}{2} - dc \right)$$

5. *Required Vertical Anchorage Force:* If the overturning moment (M_o) exceeds the resisting moment (M_r), an uplift force exists. The ASCE 7-93 restricts the usable dead load to 2/3rds of the actual dead load. This is the same as inverting

the ratio and making the overturning moment 3/2 times the calculated value. Thus, the final equation for (Av) at a specific pier spacing is:

$$A_v = \left[\frac{1.5 \times M_o - M_r}{W_t - 2 \times d_c} \right] \times \text{spacing}$$

B. Wind Load Considerations for the Type C1 Single-Section Unit.

1. *General:* The same wind pressures as for Type C tend to overturn the superstructure, rotating it about the pivot point at the bottom of the chassis beam as shown on Figure D-10. The vertical anchorage force (Av) necessary to prevent this uplift action is a tie-down strap that wraps over the roof of the unit and down the side walls to anchorage below grade at concrete deadmen. The capacity of the steel straps must be capable of transferring the (Av) force to the deadman. The dead load of the concrete deadman and soil overburden must be equal to or greater than the (Av) force to keep the superstructure from overturning.
2. *Wind Loads on the Superstructure:* As shown in Figure D-10, the resultant wind forces are the same as for the Type C single-section unit. See equations in section D-300.2.A.2.
3. *Overturning Moment of the Superstructure:* The resultant wind loads on each surface rotate about the pivot point shown in Figure D-10. The equation is the same as for the Type C single-section unit.

4. *Resisting moment of the superstructure:* The resisting moment is the same as for the Type C single-section unit.

5. *Required Vertical Anchorage Force:* The final equation for (Av) at a specific vertical tie-down strap or tie spacing is:



$$A_v = \left[\frac{1.5 \times M_o - M_r}{W_t - d_c} \right] \times \text{spacing}$$

C. Wind Load Considerations for the Type E Single-Section Unit (excluding Types E3 and E4, which follows).

1. *General:* The applied wind loads to the superstructure are the same as for the Type C single-section unit. These wind pressures tend to overturn the superstructure, rotating it about the pivot point at the exterior foundation wall as shown in Figure D-11A. The vertical anchorage force (Av) necessary to prevent this uplift action is located at the opposite exterior foundation wall. The anchorage connection of superstructure to foundation must be capable of transferring the (Av) force to the wall. The dead load of the wall, footing and soil overburden must be equal to or greater than the (Av) force to keep the superstructure from overturning.
2. *Wind Loads on the Superstructure:* Same as for the Type C single-section unit. The equations are shown in section D-300.2.A.2.

3. *Overturning Moment of the superstructure:* The resultant wind loads on each surface rotate about the pivot point shown in Figure D-11A.

The summation of the force times distance values define the equation:

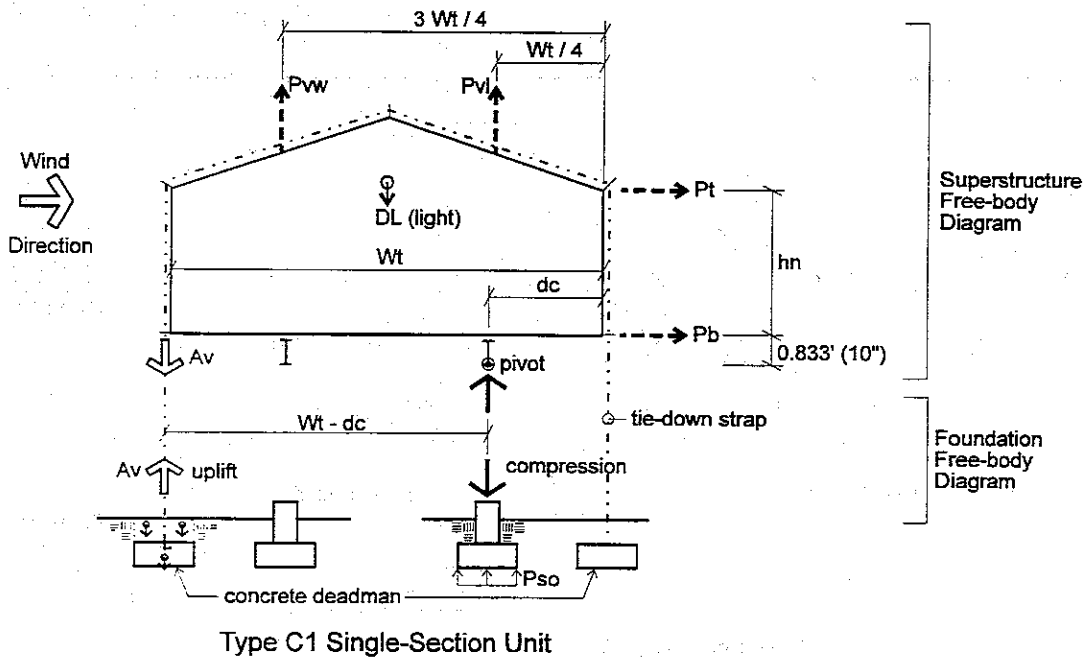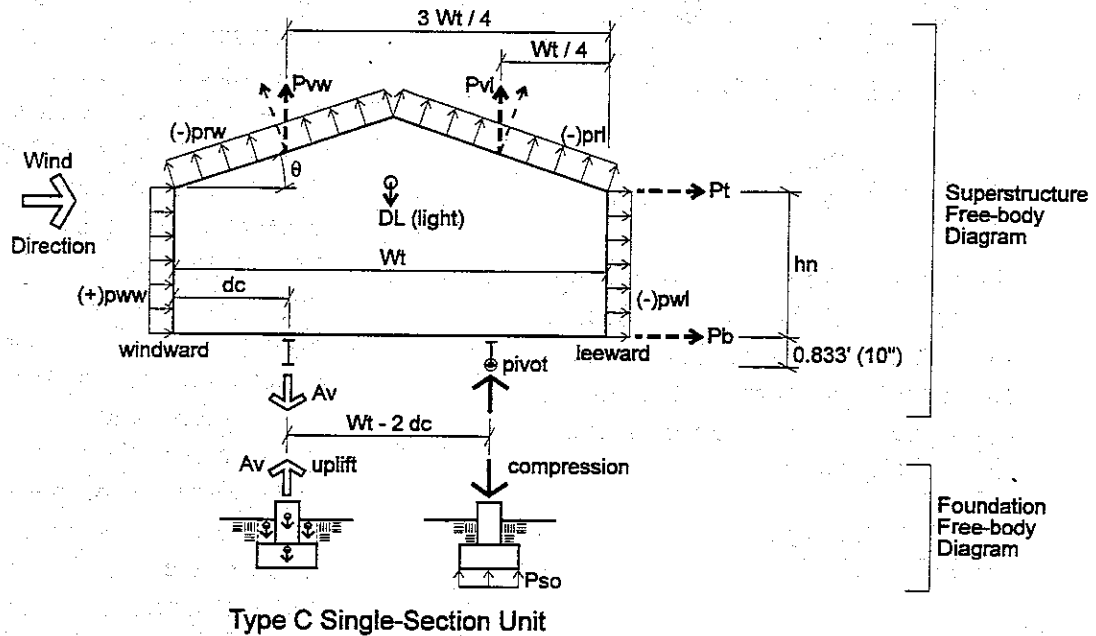

Wind Related Overturning Loads - Transverse Direction

Figure D - 10

$$M_o = P_t \times h_n + |P_{vw}| \times \left(\frac{3 \times W_t}{4} \right) + |P_{vl}| \times \left(\frac{W_t}{4} \right)$$

Type E3 and E4 Single-Section Unit.

4. *Resisting moment of the superstructure:* The total dead load provides the only gravity load resistance to overturning. Using the light dead load from section D-200.1.B:


$$M_r = DL \times \left(\frac{W_t}{2} \right)$$

5. *Required Vertical Anchorage Force:* Similar to Section D-300.A.5. Thus, the final equation for anchorage force (A_v) to be transferred to the exterior foundation wall becomes:

$$A_v = \frac{15 \times M_o - M_r}{W_t}$$

1. *General:* The applied wind loads to the superstructure are the same as for the Type C single-section unit as shown in Figure D-10. These wind pressures tend to overturn the superstructure, rotating it about the pivot point at the exterior foundation wall as shown in Figure D-11B. The vertical anchorage force (A_v) necessary to prevent this uplift action is located at the two chassis beam piers and the opposite exterior foundation wall. The anchorage connection of superstructure to these piers and foundation wall must be capable of transferring the (A_v) force in proportion to their distance from the pivot. The dead load of the exterior wall, footing and soil overburden; plus the dead load of the two piers, footings and soil overburden must all be equal to

C-X. Wind Load Considerations for the

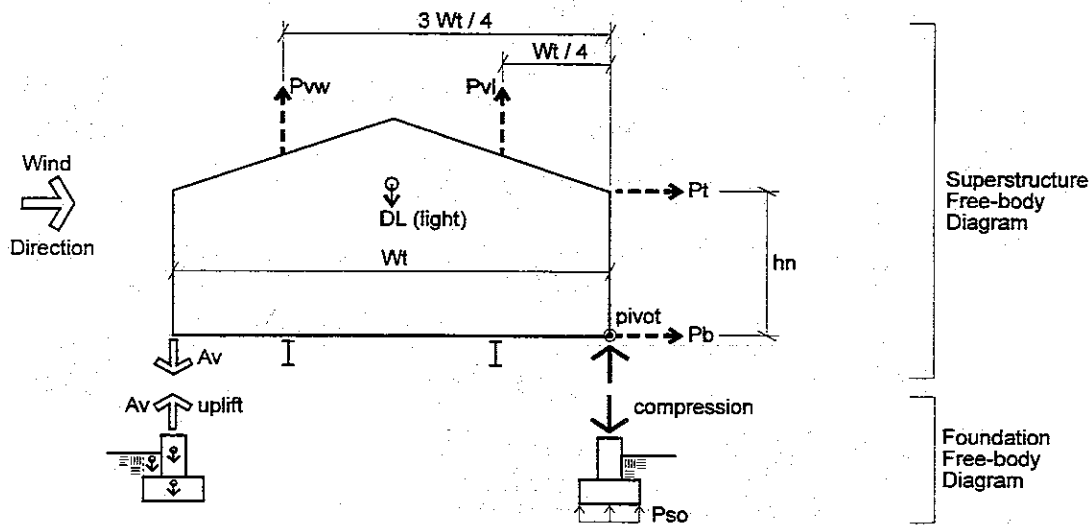

Type E Single-Section Unit

Wind Related Overturning Loads - Transverse Direction

Figure D - 11A

or greater than the portion of the (Av) force each must resist to keep the superstructure from overturning.

2. *Wind Loads on the Superstructure:* Same as for the Type C single-section unit. The equations are shown in section D-300.2.A2.
3. *Overturning Moment of the superstructure:* The resultant wind loads on each surface rotate about the pivot point shown in Figure D-11B. The summation of the force times distance values define the equation:

$$M_o = P_t \times h_n + |P_{vw}| \times \left(\frac{3 \times Wt}{4} \right) + |P_{vl}| \times \left(\frac{Wt}{4} \right)$$

4. *Resisting moment of the superstructure:* The total dead load provides the only gravity load resistance to overturning. Using the light dead load from section D-200.1.B:

$$M_r = DL \times \left(\frac{Wt}{2} \right)$$

5. *Required vertical Anchorage Force:* Assuming the anchorage force at the exterior wall to be (Av), and using triangle proportions, the intermediate vertical anchorage force at the furthest pier from the pivot (Av₁) becomes:

$$Av_1 = \left(\frac{Wt - dc}{Wt} \right) \times Av$$

Note: As illustrated in Figure D-11B the anchorage force at the pier closest to the pivot is very small and is ignored. The anchorage

force (Av₁) shall be used at both piers for conservatism.

The resisting moment created by these two anchorage locations is:

$$M_{AV} = Av \times Wt + Av_1 \times (Wt - dc)$$

Substitution of the anchorage force value (Av₁) into the above equation results in the following:

$$M_{AV} = Av \times \left[Wt + \frac{(Wt - dc)^2}{Wt} \right]$$

Since the anchorage moment (M_{AV}) must balance the net overturning moment (1.5 x Mo - Mr), the maximum vertical anchorage force (Av), which is used in the Foundation Design Load Tables of Appendix B, Part 2 for the exterior wall per foot of length, becomes:

$$Av = \frac{(1.5 \times Mo - Mr)}{\left[Wt + \frac{(Wt - dc)^2}{Wt} \right]}$$

Note that the vertical anchorage force (Av₁) used in the Tables for anchorage at both piers under the chassis beams is based on pier spacing (s) and renamed (Av_{1pier}) in the equation becomes:

$$Av_{1pier} = \left(\frac{Wt - dc}{Wt} \right) \times Av \times \text{spacing}$$

D. Wind Load Considerations for the Type I Single-Section Unit.

1. *General:* The applied wind loads to the superstructure are the same as for the Type C and E single-section unit. These wind pressures tend to overturn the superstructure, rotating it about the pivot point at the exterior foundation wall as shown in Figure D-12. The vertical anchorage force (A_v) necessary to prevent this uplift action is located at the far side chassis beam at the interior pier spacing. The anchorage connection of superstructure to foundation must be capable of transferring the (A_v) force to the pier. The dead load of the wall, footing and soil overburden must be equal to or greater than


the (A_v) force to keep the superstructure from overturning.

2. *Wind Loads on the Superstructure:* Same as for the Type C single-section unit. The equations are shown in section D-300.2.A.2.

3. *Overturning Moment of the superstructure:* Same as for the Type E single-section unit.

$$M_o = P_t \times h_n + |P_{vw}| \times \left(\frac{3 \times W_t}{4} \right) + |P_{vl}| \times \left(\frac{W_t}{4} \right)$$

4. *Resisting moment of the superstructure:* Same as for the Type E single-section unit.

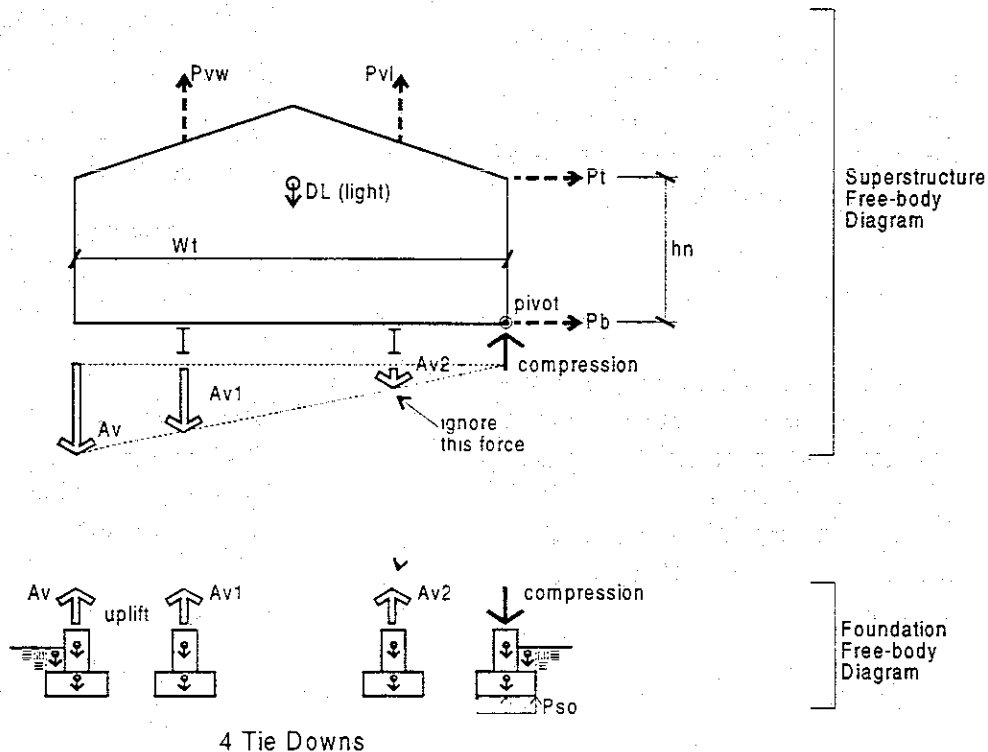

Type E3 and E4 Single-Section Unit

Wind Related Overturning Loads - Transverse Direction

Figure D - 11B

gle-section unit.

$$M_r = DL \times \left(\frac{W_t}{2} \right)$$

5. *Required Vertical Anchorage Force:* Similar to Section D-300.A.5. Thus, the final equation for anchorage force (A_v) to be transferred to the exterior foundation wall becomes:


$$A_v = \left[\frac{(1.5 \times M_o - M_r)}{(W_t - dc)} \right] \times \text{spacing}$$

E. Wind Load Considerations for a Type C Multi-Section Unit.

1. *General:* The superstructure is assumed to behave as a single box for overturning. It receives wind loads and tends to overturn in a similar manner to the single-section unit as

described in Section D-300.2.A.1. The pivot point is under the exterior chassis beam on one side. Anchorage connection of superstructure to foundation is either two tie-downs or four tie-downs as illustrated in Figure D-13 at the other chassis beams.

2. *Wind Loads on the Superstructure:* As shown in Figure D-13, the resultant wind force at the top and bottom of the wall are (P_t) and (P_b) respectively. The vertical component of the resultant wind force on the windward and leeward slope are (P_{vw}) and (P_{vl}) respectively. They are calculated as follows:

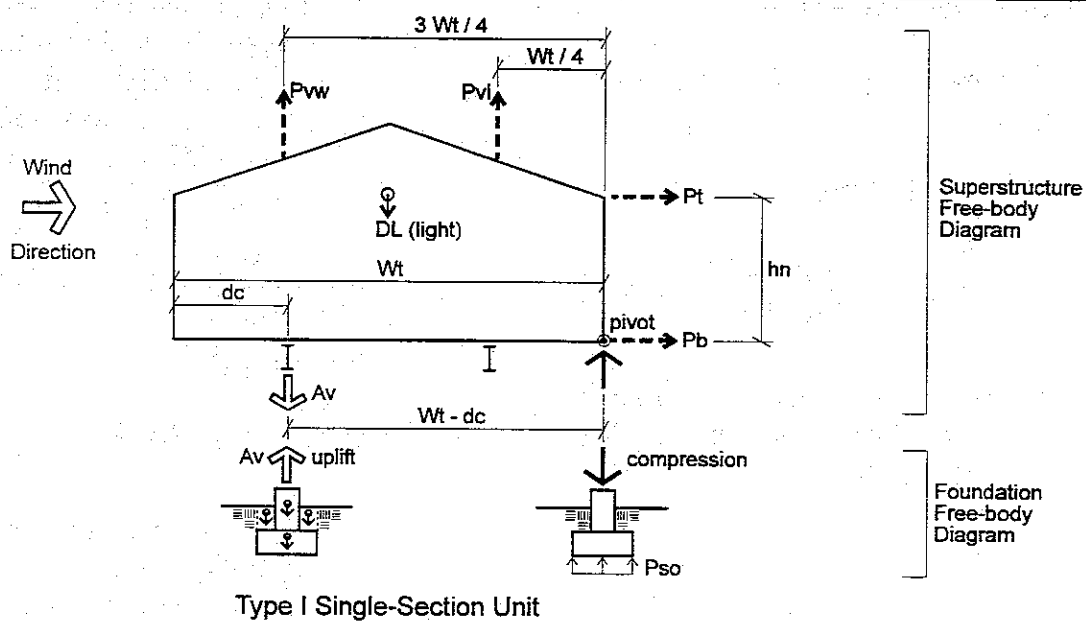

Wind Related Overturning Loads - Transverse Direction

Figure D - 12

$$P_t = P_b = (p_{rw} + |p_{wl}|) \times \frac{h_n}{2}$$

$$P_{vw} = p_{rw} \times W_t$$

$$P_{vl} = p_{rl} \times W_t$$

3. **Overturning Moment of the Superstructure:** The summation of the force times distance values defines the equation:

$$M_o = P_t \times (h_n + 0.833) + |P_{vw}| \times \left(\frac{3 \times W_t}{2} - dc \right) + |P_{vl}| \times \left(\frac{W_t}{2} - dc \right) + P_b \times (0.833)$$

4. **Resisting Moment of the Superstructure:** The total dead load provides the only gravity load resistance to overturning. Using the light dead load for a multi-section unit from section D-200.1.B:

$$M_r = DL \times (W_t - dc)$$

5. **Required Vertical Anchorage Force:**

- a. **Two tie-downs:**

$$A_v = \left[\frac{(1.5 \times M_o - M_r)}{2 \times (W_t - dc)} \right] \times \text{spacing}$$

- b. **Four tie-downs:** by triangle proportions the intermediate vertical anchorage forces (A_v) are:

$$A_{v_1} = \left[\frac{W_t}{2 \times (W_t - dc)} \right] \times A_v$$

$$A_{v_2} = \left[\frac{W_t - 2 \times dc}{2 \times (W_t - dc)} \right] \times A_v$$

The resisting moment created by the three anchorage locations is:

$$M_{AV} = A_{v_1} \times W_t + A_{v_2} \times (W_t - 2 \times dc) + A_v \times 2 \times (W_t - dc)$$

Substitution of the anchorage force values into the above equation results in the following:

$$M_{AV} = A_v \times \left[\frac{(W_t - 2 \times dc)^2}{2 \times (W_t - dc)} + \frac{(W_t)^2}{2 \times (W_t - dc)} + 2 \times (W_t - dc) \right]$$



Since the anchorage moment (M_{AV}) must balance the net overturning moment ($1.5 \times M_o - M_r$), the maximum vertical anchorage force (A_v) concentrated at the exterior pier, which is used in the Foundation Design Load Tables of Appendix B, Part 2, becomes:

$$A_v = \left[\frac{(1.5 \times M_o - M_r)}{\frac{(W_t - 2 \times dc)^2}{2 \times (W_t - dc)} + \frac{(W_t)^2}{2 \times (W_t - dc)} + 2 \times (W_t - dc)} \right] \times \text{spacing}$$

Note that the smaller vertical anchorage forces (A_{v_1}) and (A_{v_2}) are **not** used in the Tables.

F. Wind Load Considerations for a Type E Multi-Section Unit.

1. *General:* The pivot point is located at the exterior foundation wall on

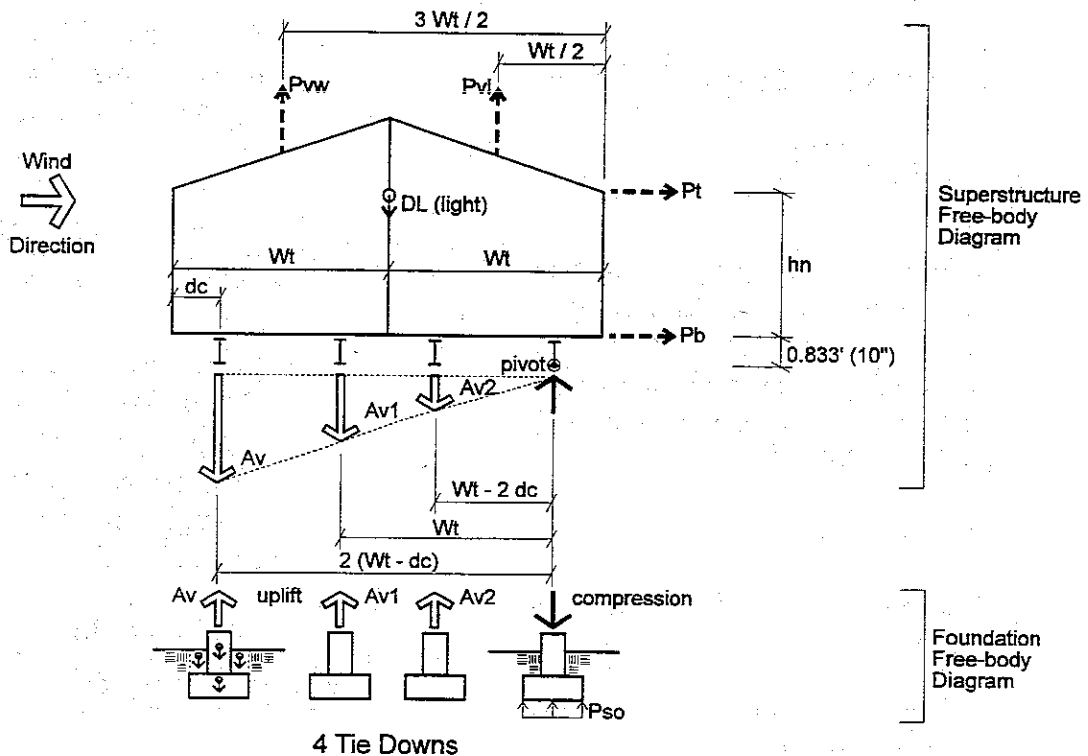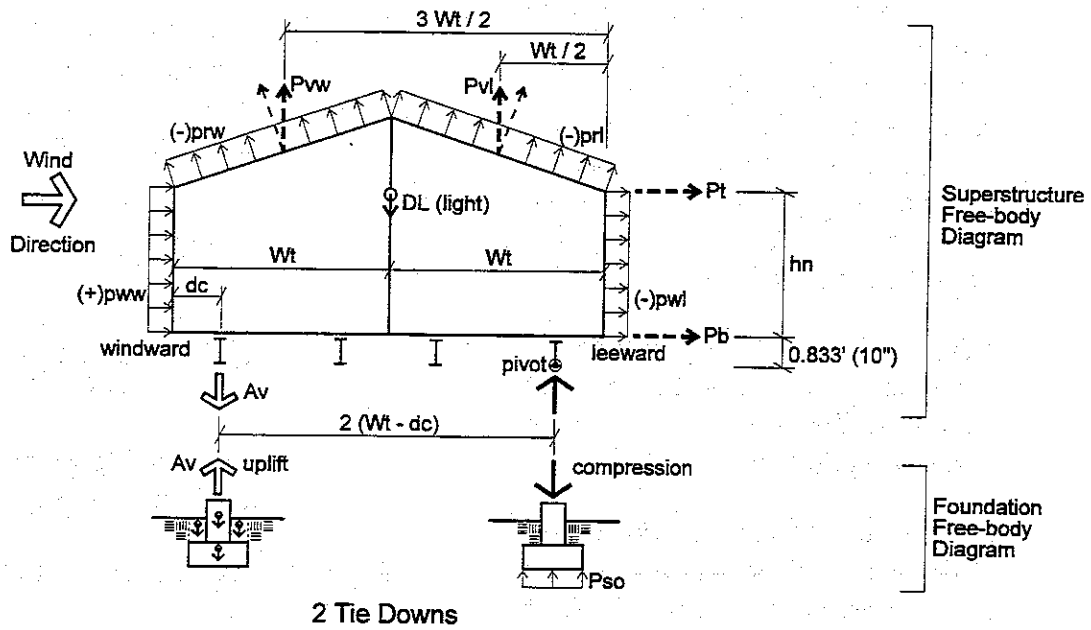

Wind Related Overturning Loads: Type C - Multi-Section Unit - Transverse Direction

Figure D - 13

one side. Anchorage connection of superstructure to foundation is accomplished at the opposite exterior wall and at specific pier locations resulting in either two tie-downs or four tie-downs as illustrated in Figure D-14. Foundation Concept Type E3 has six tie-downs. The illustration would be similar to that for four tie-downs; however, the calculations are included here.

2. *Wind Loads on the Superstructure:* Wind loads on the walls and roof planes are the same as for the Type C multi-section unit.
3. *Overturing Moment of the Superstructure:* The summation of the force times distance values defines the equation:

$$M_o = P_t \times h_n + |P_{vw}| \times \left(\frac{3 \times W_t}{2} \right) +$$

$$|P_v| \times \left(\frac{W_t}{2} \right)$$

4. *Resisting Moment of the Superstructure:* The total dead load provides the only gravity load resistance to overturning. Using the light dead load for a multi-section unit from section D-200.1.B:

$$M_r = DL \times W_t$$

5. *Required Vertical Anchorage Force:*

- a. **Two tie-downs:** at the exterior wall in lbs/ft:

$$A_v = \left[\frac{(1.5 \times M_o - M_r)}{2 \times W_t} \right]$$

- b. **Four tie-downs:** by triangle proportions the intermediate vertical anchorage forces (A_v), also in lbs/ft, are:

$$A_{v_1} = \left[\frac{W_t + dc}{2 \times W_t} \right] \times A_v$$

$$A_{v_2} = \left[\frac{W_t - dc}{2 \times W_t} \right] \times A_v$$

The resisting moment created by the three anchorage locations is:

$$M_{AV} = A_{v_1} \times (W_t + dc) + A_{v_2} \times (W_t - dc) + A_v \times 2 \times W_t$$

Substitution of the anchorage force values into the above equation results in the following:

$$M_{AV} = A_v \times \left[\frac{(W_t + dc)^2}{2 \times W_t} + \frac{(W_t - dc)^2}{2 \times W_t} + 2 \times W_t \right]$$

Since the anchorage moment (M_{AV}) must balance the net overturning moment ($1.5 \times M_o - M_r$), the maximum vertical anchorage force (A_v) at the exterior wall in lbs/ft, becomes:

$$A_v = \frac{(1.5 \times M_o - M_r)}{\left[\frac{(W_t + dc)^2}{2 \times W_t} + \frac{(W_t - dc)^2}{2 \times W_t} + 2 \times W_t \right]}$$

And the next largest anchorage force (in lbs.) (Av_1) at the first interior pier becomes:

$$Av_1 = \left[\frac{Wt + dc}{2 \times Wt} \right] \times Av \times \text{spacing}$$

- b. **Six tie-downs:** by triangle proportions the intermediate vertical anchorage forces (Av), in lbs/ft of unit length, are:

$$Av_1 = \left[\frac{2 \times Wt - dc}{2 \times Wt} \right] \times Av$$

$$Av_2 = \left[\frac{Wt + dc}{2 \times Wt} \right] \times Av$$

$$Av_3 = \left[\frac{Wt - dc}{2 \times Wt} \right] \times Av$$

The resisting moment created by the four anchorage locations is:

$$M_{AV} = Av_1 \times (2 \times Wt + dc) + Av_2 \times (Wt + dc) + Av_3 \times (Wt - dc) + Av \times 2 \times Wt$$

Substitution of the anchorage force values into the above results in the following:

$$M_{AV} = Av \times \left[\frac{(2 \times Wt - dc)^2}{2 \times Wt} + \frac{(Wt + dc)^2}{2 \times Wt} + \frac{(Wt - dc)^2}{2 \times Wt} + 2 \times Wt \right]$$

Since the anchorage moment (M_{AV}) must balance the net overturning moment ($1.5 \times Mo - Mr$), the maximum vertical an-

chorage force (Av) at the exterior wall in lbs/ft, becomes:

$$Av = \frac{(1.5 \times Mo - Mr)}{\left[\frac{(2 \times Wt - dc)^2}{2 \times Wt} + \frac{(Wt + dc)^2}{2 \times Wt} + \frac{(Wt - dc)^2}{2 \times Wt} + 2 \times Wt \right]}$$

And the next largest anchorage force (in lbs.) (Av_1) at the first interior pier becomes:

$$Av_1 = \left[\frac{2 \times Wt - dc}{2 \times Wt} \right] \times Av \times \text{spacing}$$



The smaller values of Av are not printed in the tables for fabrication economy.

G. Wind Load Considerations for a Type I Multi-Section Unit.

1. *General:* The pivot point is located at the exterior foundation wall on one side. Anchorage connection of superstructure to foundation is accomplished at specific pier locations resulting in either two tie-downs or four tie-downs as illustrated in Figure D-15.
2. *Wind Loads on the Superstructure:* Wind loads on the walls and roof planes are the same as for the Type C or E unit.
3. *Overturning Moment of the Superstructure:* The summation of the force times distance values defines the equation:

$$M_o = P_t \times h_n + |P_{vw}| \times \left(\frac{3 \times W_t}{2} \right) + |P_{vl}| \times \left(\frac{W_t}{2} \right)$$

4. *Resisting Moment of the Superstructure:* The total dead load provides the only gravity load resistance to

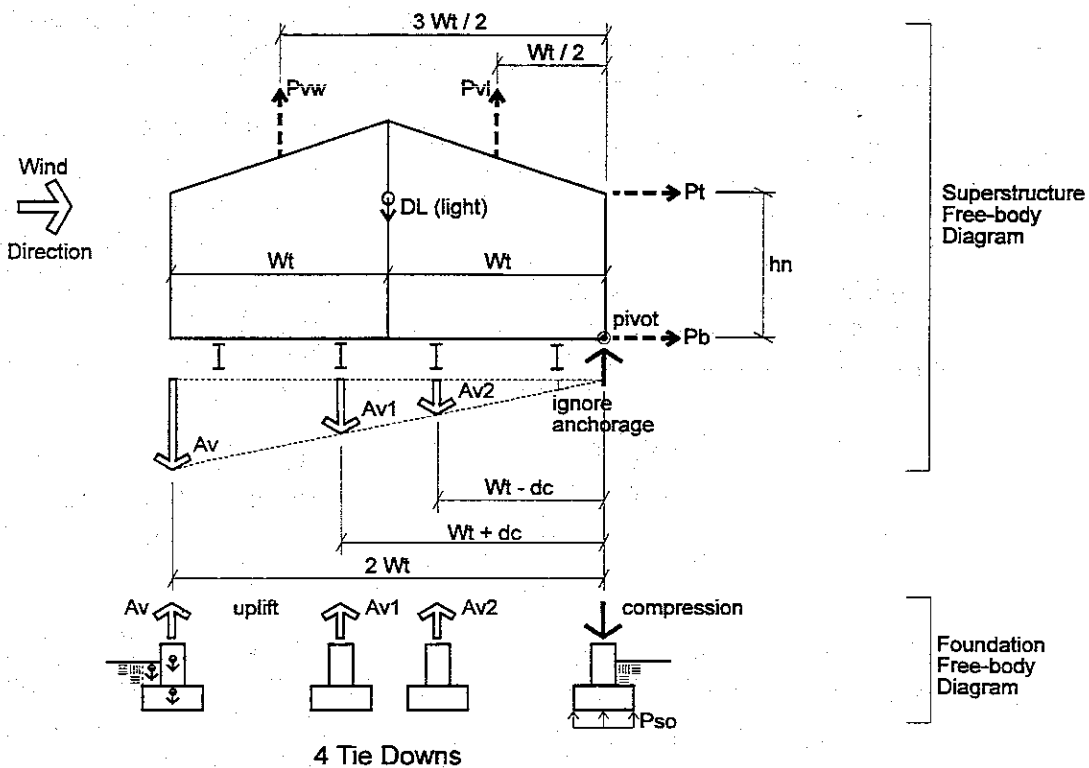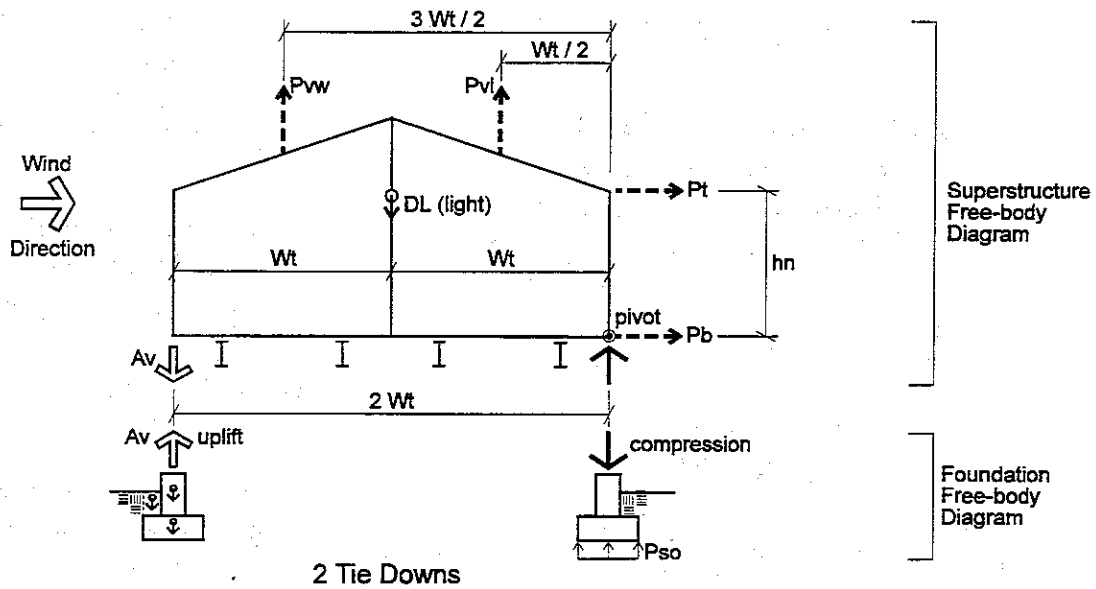

Wind Related Overturning Loads: Type E - Multi-Section Unit - Transverse Direction

Figure D - 14

overturning. Using the light dead load for a multi-section unit from section D-200.1.B:

$$M_r = DL \times (Wt)$$

5. *Required Vertical Anchorage Force:*

a. **Two tie-downs:** Concentrated load in lbs. at the exterior pier becomes:

$$A_v = \left[\frac{(1.5 \times M_o - M_r)}{(2 \times Wt - dc)} \right] \times \text{spacing}$$

b. **Four tie-downs:** by triangle proportions the intermediate vertical anchorage forces (A_v) are similar to the Type E multi-section unit.

The resisting moment created by the three anchorage locations is:

$$M_{AV} = A_{v_1} \times (Wt + dc) + A_{v_2} \times (Wt - dc) + A_v \times (2 \times Wt - dc)$$

Substitution of the anchorage force values into the above equation results in the following:

$$M_{AV} = A_v \times \left[\frac{(Wt + dc)^2}{(2 \times Wt - dc)} + \frac{(Wt - dc)^2}{(2 \times Wt - dc)} + (2 \times Wt - dc) \right]$$

Since the anchorage moment (M_{AV}) must balance the net overturning moment ($1.5 \times M_o -$

M_r), the maximum vertical anchorage force (A_v) at the exterior pier, used in the Foundation Design Load Tables of Appendix B, Part 2, becomes:

$$A_v = \left[\frac{(1.5 \times M_o - M_r)}{\frac{(Wt + dc)^2}{(2 \times Wt - dc)} + \frac{(Wt - dc)^2}{(2 \times Wt - dc)} + (2 \times Wt - dc)} \right] \times \text{spacing}$$

And the next largest anchorage force (A_{v_1}) at the first interior pier becomes:

$$A_{v_1} = \left[\frac{Wt + dc}{(2 \times Wt - dc)} \right] \times A_v$$

This (A_{v_1}) force equation is **not** used in the Foundation Design Load Tables of Appendix B. It is shown here for engineers who wish to reduce the design (A_v) force at interior pier locations.


D-300.3 REQUIRED VERTICAL ANCHORAGE BASED ON SEISMIC IN THE TRANSVERSE DIRECTION. Refer to Figure D-16 to D-18 for the free-body diagrams of the superstructure and foundation for single-section units, illustrating the overturning forces due to seismic activity and the element dead loads providing resistance.

A. General. The seismic provisions of ASCE 7-93 are a limit state methodology that must be modified to an allowable stress methodology for comparison to wind. This is accomplished in the load combination as follows:

The basic load combination from ASCE 7-93:

E - DL

The seismic equation from ASCE

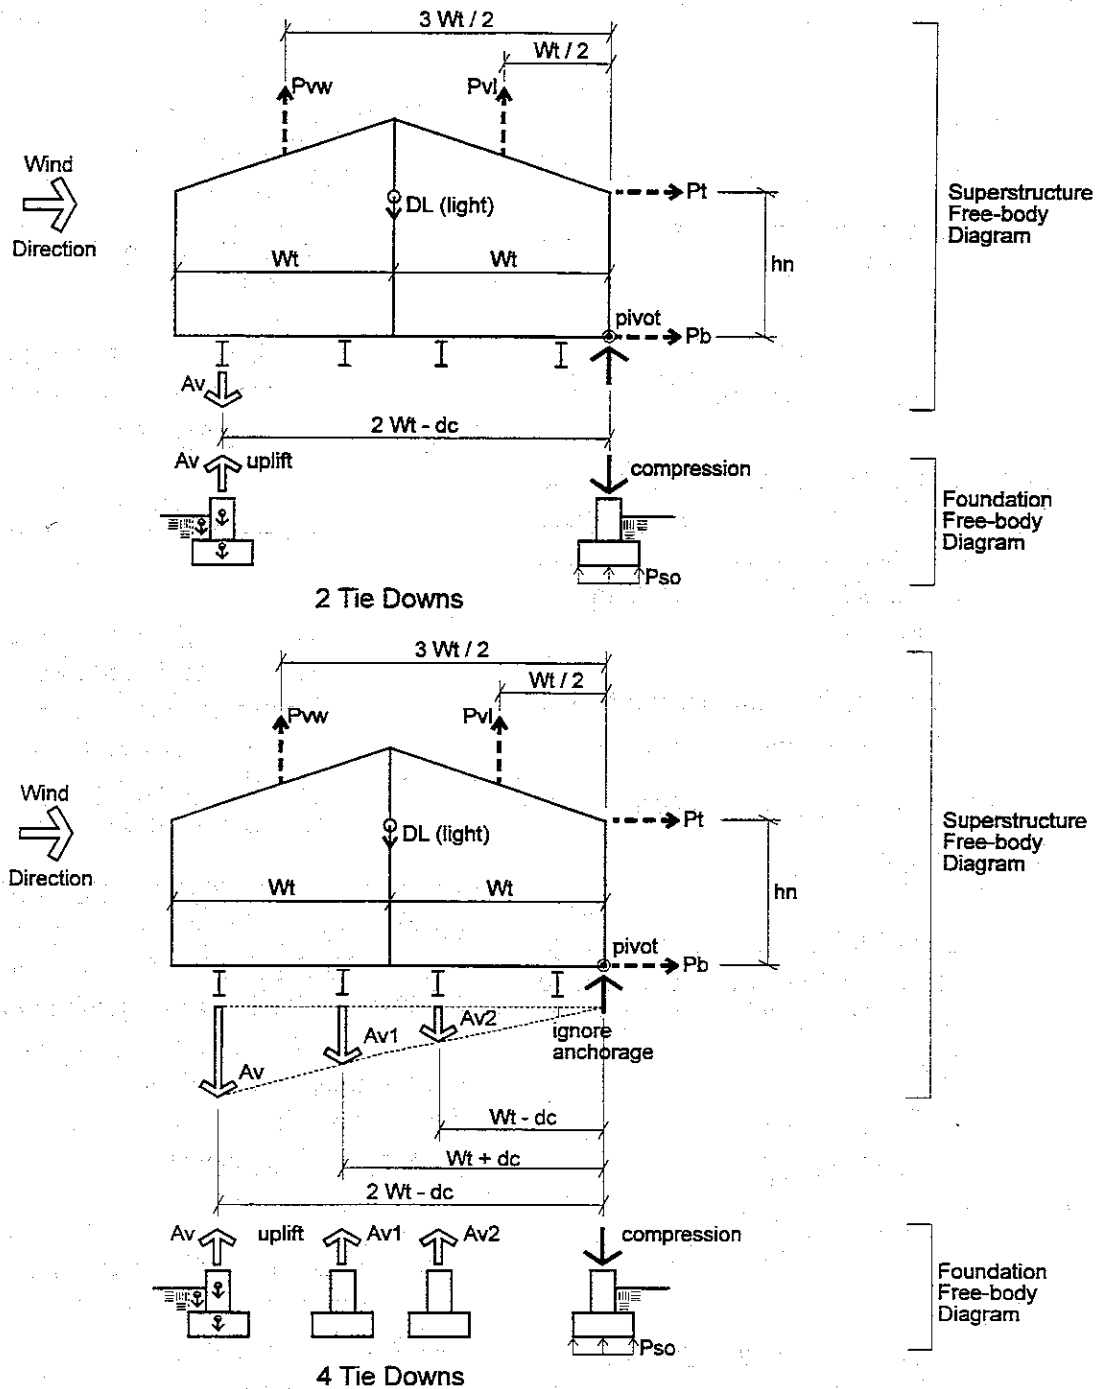

Wind Related Overturning Loads: Type I - Multi-Section Unit - Transverse Direction

Figure D - 15

7-93:

$$E = \pm Q_E \pm 0.5 \times \underline{A_v} \times DL$$

where Q_E is the effect of horizontal seismic. Substitution of E into the basic equation:

$$Q_E - D \times (1 - 0.5 \times \underline{A_v})$$

Thus, for Seismic the net overturning equation generalizes to:

$$1.5 \times Mo - (1 - 0.5 \times \underline{A_v}) \times Mr$$

which includes the same 1.5 factor of safety as used for wind.

B. Seismic Force Consideration for the Type C, C1, E or I Single-Section Units.

1. *Seismic Inertia Forces on the Superstructure:* Determination of the horizontal forces was explained in section D-200.5. The "heavy" component dead loads were used to arrive at the inertia forces F_{xr} and F_{xf} .
2. *Overturning Moment of the Superstructure:* The moment components are force times distance from the pivot.

- a. For Type C and C1 single-section units:

$$Mo = F_{xr} \times (h_n + 0.833) + F_{xf} \times 0.833$$

- b. For Type E or I single-section units:

$$Mo = F_{xr} \times h_n$$

3. *Resisting moment of the Superstructure:* The dead load and snow load, where applicable, constitute the gravity load resisting overturning. The "light" unit dead load was used for overturning resistance to be conservative, even though the "heavy" dead loads for single-section units were used for the calculation of the floor and roof inertia forces. Generally the equations become:

- a. For Type C and C1 single-section units:

$$Mr = (DL + \%P_f \times Wt) \times \left(\frac{Wt}{2} - dc \right)$$

- b. For Type E and I single-section units:

$$Mr = (DL + \%P_f \times Wt) \times \left(\frac{Wt}{2} \right)$$

4. *Required Vertical Anchorage Force:* Using the general equation described in section D-300.3.A and using the appropriate Mo and Mr equations for each unit Type, the equations become:

- a. For Type C single-section units:



$$A_v = \left[\frac{1.5 \times Mo - (1 - 0.5 \times A_v) \times Mr}{Wt - 2 \times dc} \right] \times \text{spacing}$$

- b. For Type C1 single-section unit:

$$A_v = \left[\frac{1.5 \times Mo - (1 - 0.5 \times A_v) \times Mr}{Wt - dc} \right] \times \text{spacing}$$


c. For Type E single-section units:

$$A_v = \left[\frac{1.5 \times M_o - (1 - 0.5 \times A_v) \times M_r}{W_t} \right]$$

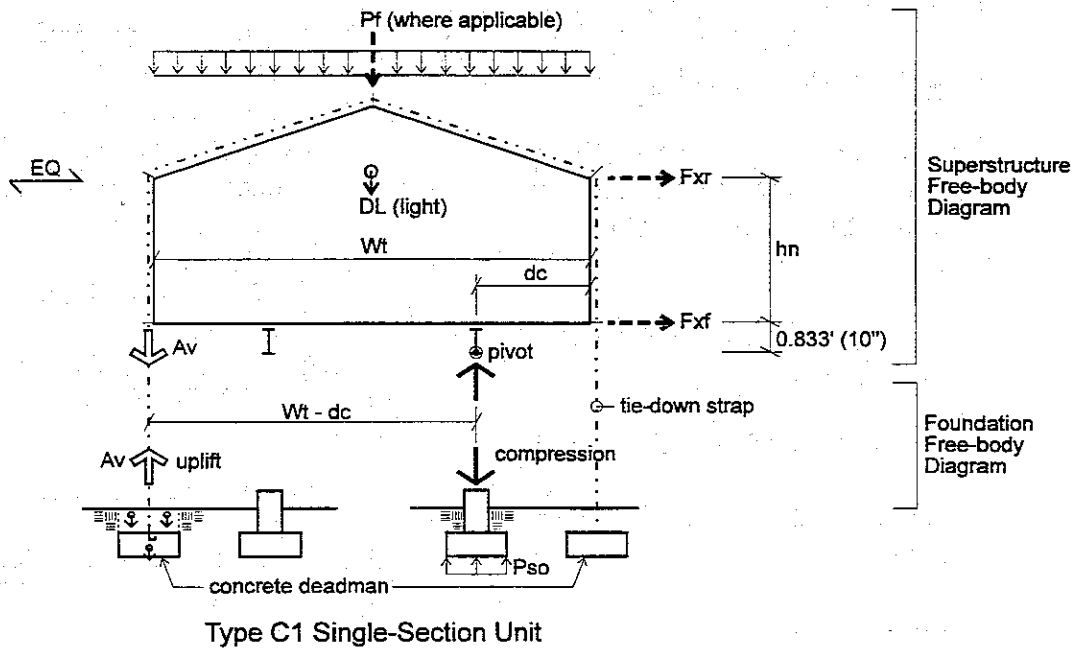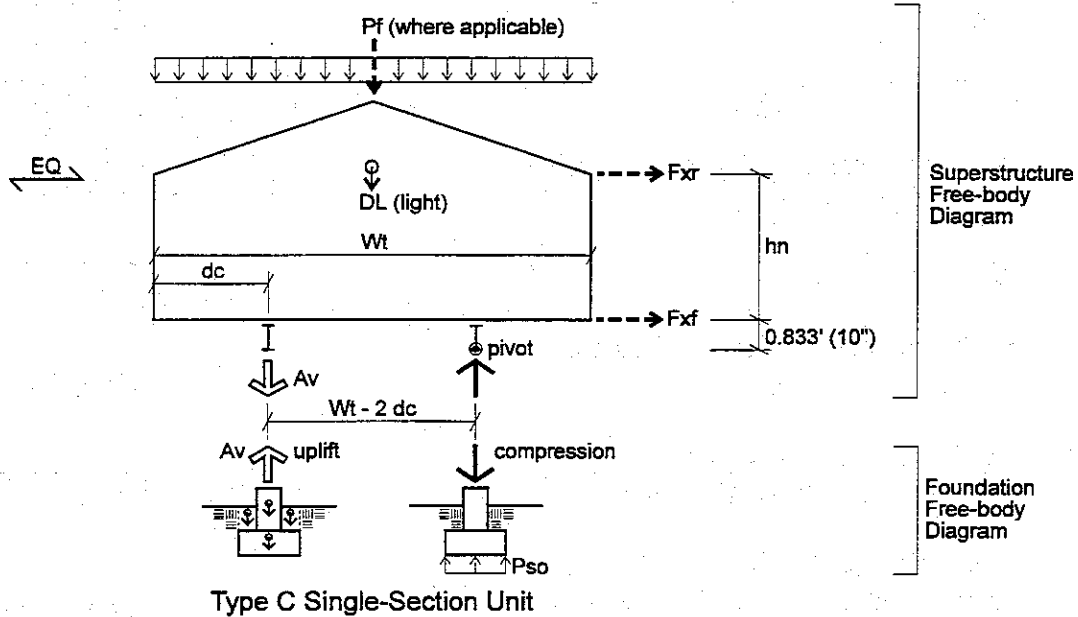

Seismic Related Overturning Loads - Transverse Direction

Figure D - 16

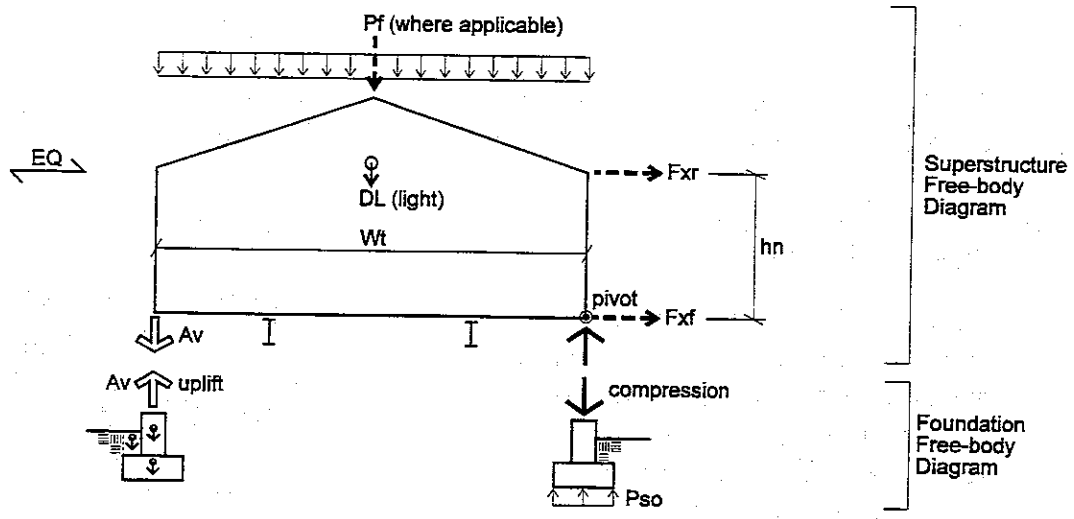

Type E Single-Section Unit


Seismic Related Overturning Loads - Transverse Direction

Figure D - 17

d. For Type I single-section units:

$$A_v = \left[\frac{1.5 \times M_o - (1 - 0.5 \times A_v) \times M_r}{W_t - d_c} \right] \times \text{spacing}$$

5. *Comparison: Wind vs. Seismic:* The values for the vertical anchorage force (A_v), based on overturning in the transverse direction, will be the larger value of wind or seismic.

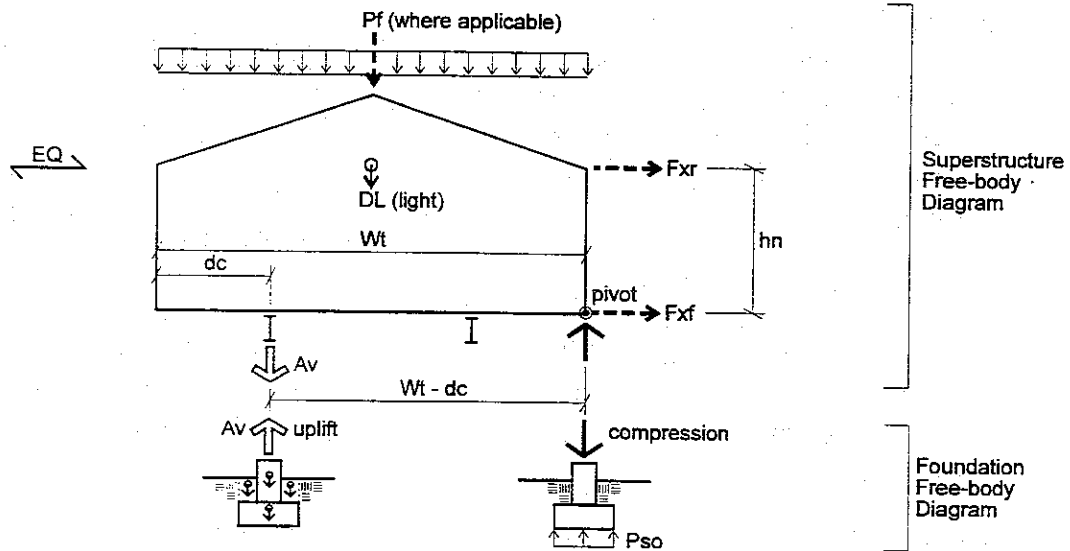

Type I Single-Section Unit

Seismic Related Overturning Loads - Transverse Direction

Figure D - 18

This is reflected in the Foundation Design Load Tables of Appendix B, Part 2. **Note:** should any (Av) value become negative, there is no uplift.

C. Seismic Force Considerations for the Type C, E and I Multi-Section Units.

1. *General:* The moment equilibrium equations for anchorage resistance are similar to those for the multi-section units subjected to wind load as shown in Figures D-13 to D-15. The applied roof and floor inertia forces (F_{xr} and F_{xf} respectively) are based on heavy dead loads for multi-section units and positioned where shown in Figures D-16 to D-18. Calculation of the horizontal roof and floor forces was explained in section D-200.5.

2. *Overturning Moment of the Superstructure:*

a. For Type C multi-section units: Use the same equation found in section D-300.3.B.2.a., except calculate F_{xr} and F_{xf} from the expressions for Multi-Section units.

b. For Type E or I multi-section units: Use the same equation found in section D-300.3.B.2.b., except calculate F_{xr} and F_{xf} from the expressions for Multi-Section units.

3. *Resisting Moment of the Superstructure:*

a. For Type C multi-section units:

$$M_r = (DL + \%P_f \times 2 \times Wt) \times (Wt - dc)$$

b. For Type E or I multi-section units:

$$M_r = (DL + \%P_f \times 2 \times Wt) \times Wt$$

4. *Required Vertical Anchorage Force:* Using the general equation described in section D-300.3.A the equations become:

a. For Type C multi-section units: The concentrated force at the exterior pier for **two tie-downs:**

$$A_v = \left[\frac{1.5 \times M_o - (1 - 0.5 \times A_v) \times M_r}{2 \times (Wt - dc)} \right] \times \text{spacing}$$

with **four tie-downs:** The maximum concentrated (A_v) force that is used in the Foundation Design Load Tables of Appendix B, Part 2 is:

$$A_v = \left[\frac{(1.5 \times M_o - (1 - 0.5 \times A_v) \times M_r)}{\frac{(Wt - 2 \times dc)^2}{2 \times (Wt - dc)} + \frac{(Wt)^2}{2 \times (Wt - dc)} + 2 \times (Wt - dc)} \right] \times \text{spacing}$$

Note: that the smaller vertical anchorage forces (A_{v1}) and (A_{v2}) derived in Section D-300.2.E.5 are not used in the tables. **Note:** negative values of (A_v) produce no uplift.

b. For Type E multi-section units, anchored at the exterior walls, the (A_v) value is in units of lbs/ft. With **two tie-downs:**

$$A_v = \left[\frac{1.5 \times M_o - (1 - 0.5 \times A_v) \times M_r}{2 \times W_t} \right]$$

For **four tie-downs**: The maximum vertical anchorage force (A_v) that is used in the Foundation Design Load Tables of Appendix B, Part 2 at the exterior wall in units of lbs/ft is:

$$A_v = \frac{(1.5 \times M_o - (1 - 0.5 \times A_v) \times M_r)}{\left[\frac{(W_t + dc)^2}{2 \times W_t} + \frac{(W_t - dc)^2}{2 \times W_t} + 2 \times W_t \right]}$$

The next largest anchorage force (A_{v_1} in lbs.) at the first interior pier as used in the Appendix B, Part 2 Tables becomes:

$$A_{v_1} = \left[\frac{W_t + dc}{2 \times W_t} \right] \times A_v \times \text{spacing}$$

For **six tie-downs**: This condition exists only for the Type E3 Foundation Concept. The maximum vertical anchorage force (A_v) that is used in the Foundation Design Load Tables of Appendix B, Part 2 at the exterior wall in units of lbs/ft is:

$$A_v = \frac{(1.5 \times M_o - (1 - 0.5 \times A_v) \times M_r)}{\left[\frac{(2 \times W_t - dc)^2}{2 \times W_t} + \frac{(W_t + dc)^2}{2 \times W_t} + \frac{(W_t - dc)^2}{2 \times W_t} + 2 \times W_t \right]}$$

The next largest anchorage force (A_{v_1} in lbs.) at the first interior pier as used in the Appendix B, Part 2 Tables becomes:

$$A_{v_1} = \left[\frac{2 \times W_t - dc}{2 \times W_t} \right] \times A_v \times \text{spacing}$$

c. For Type I multi-section units: The concentrated force at the exterior pier for **two tie-downs**:

$$A_v = \left[\frac{1.5 \times M_o - (1 - 0.5 \times A_v) \times M_r}{2 \times (W_t - dc)} \right] \times \text{spacing}$$

with **four tie-downs**: The maximum vertical anchorage force (A_v in Lbs.) at the exterior pier, which is used in the Foundation Design Load Tables, Part 2, is:

$$A_v = \frac{(1.5 \times M_o - (1 - 0.5 \times A_v) \times M_r)}{\left[\frac{(W_t + dc)^2}{(2 \times W_t - dc)^2} + \frac{(W_t - dc)^2}{(2 \times W_t - dc)^2} + (2 \times W_t - dc) \right]} \times \text{spacing}$$

And the next largest anchorage force (A_{v_1}) at the first interior pier is:

$$A_{v_1} = \left[\frac{W_t + dc}{(2 \times W_t - dc)} \right] \times A_v$$

This (A_{v_1}) force equation is **not** used in the Foundation Design Load Tables of Appendix B. It is shown here for engineers who wish to reduce the design (A_v) force at interior pier locations.


D-300.4 REQUIRED HORIZONTAL ANCHORAGE BASED ON WIND IN THE TRANSVERSE DIRECTION. Refer to Figures D-19 and D-21 for the free-body diagrams

of the superstructure and foundation for single section and multi-section units, illustrating the horizontal forces due to sliding and element dead loads providing resistance. Horizontal sliding is not influenced by the foundation Type C, E or I; thus the same analysis applies to all of the foundation types. Figure D-4, D-5 and D-6 are also related to the equation development of this section. A roof slope of 10-15° (20° also) (approx. 3 in 12 slope) was used so as to utilize the maximum exterior pressure coefficient on the windward slope ($C_p = +0.2$) to produce the largest horizontal windward force component, and thus the largest sliding force. An external windward slope uses a $C_p = -0.9$ to produce the smallest resistance force. These were conservative assumptions for the Tables. Note that internal pressures on the walls cancel; therefore, only internal pressures of $+GC_{pi}$ on the roof planes are considered (see Figure D-5). For allowable stress design methodology, the load combination from ASCE 7-93 is: (Wind -

DL). Figure D-20 illustrates that a tributary width approach is used to calculate the forces to each foundation horizontal load resisting plane.

A. Wind Load Considerations for the Type C, E and I Single-Section Unit.

1. *General:* As shown in Figure D-19 the external wind pressure on the windward wall and the external suction on the leeward wall are transferred into the roof (plus ceiling) and floor diaphragms. The roof (plus ceiling) diaphragm transfers the force into superstructure shear walls perpendicular to the unit length, and then in turn to the floor diaphragm, assuming all connections are properly designed to resist the horizontal wind forces. From the floor diaphragm the horizontal

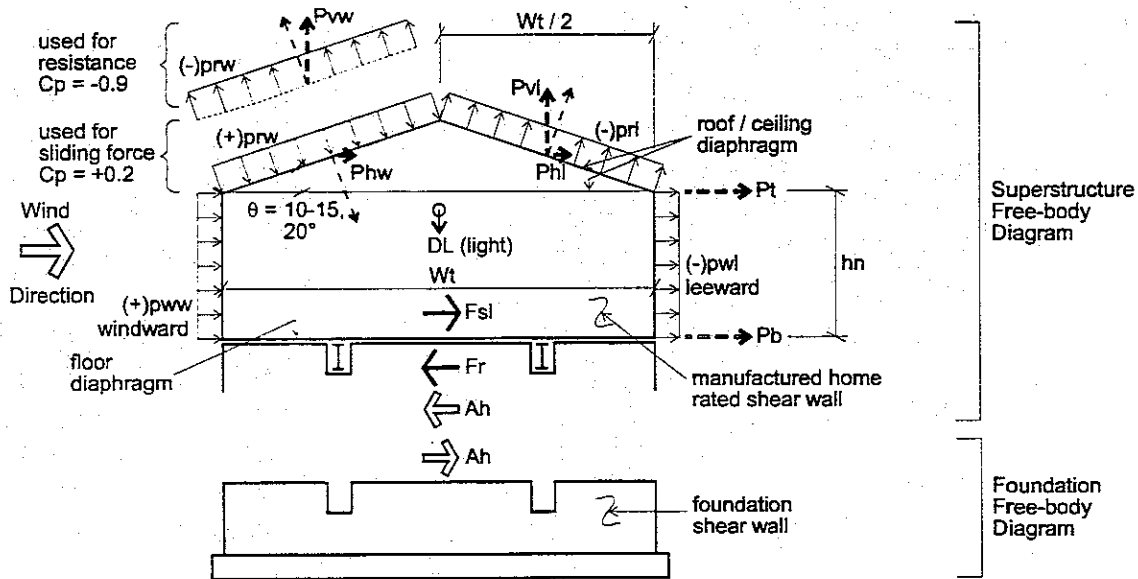

Type C, E or I Single-Section Units

Wind Related Sliding - Transverse Direction

Figure D - 19

force is transferred into the foundation shear wall or vertical X-bracing plane. Reference Figure 6-4. It is assumed that the location of superstructure shear walls coincides with the foundation shear wall locations.

2. *Wind Loads on the Superstructure:* As shown in Figure D-19, the resultant wind force at the top and bottom of the wall are (Pt) and (Pb) respectively. The vertical component of the resultant wind force on the windward and leeward slope are (Pvw) and (Pvl) respectively. The horizontal components of the roof wind loads both contribute to sliding, and are calculated as follows:

$$Pt = Pb = (p_{ww} + |p_{wl}|) \times \frac{h_n}{2}$$

$$Pvw = p_{rw} \times \frac{Wt}{2}$$

For calculation of (Fr) use (Cp) = -0.9 in the above equation.

$$Pvl = p_n \times \frac{Wt}{2}$$

$$P_{HW} = p_{rw} \times \left(\frac{Wt}{2}\right) \times \tan 20^\circ$$

For calculation of (F_{SL}) use (Cp) = +0.2 in the above equation.

$$P_{HL} = |p_n| \times \left(\frac{Wt}{2}\right) \times \tan 20^\circ$$

3. *Sliding Force on the Superstructure:* The sliding force is a function of the number of foundation shear walls (transverse foundation walls)

that are used. Note that all four sliding force horizontal components point in the same direction and thus are additive.

- a. For **two** end shear (transverse) walls: the end wall sliding force distribution is illustrated in Figure D-20 and calculated as follows:

$$F_{SL_{end}} = (Pt + Pb) \times \left(\frac{L}{2}\right) + (P_{HW} + P_{HL}) \times \left(\frac{L}{2}\right)$$

- b. For **four** shear (transverse) walls: the interior and end wall sliding force distribution is illustrated in Figure D-20 and calculated as follows:

$$F_{SL_{int}} = (Pt + Pb) \times \left(\frac{L}{3}\right) + (P_{HW} + P_{HL}) \times \left(\frac{L}{3}\right)$$

$$F_{SL_{end}} = (Pt + Pb) \times \left(\frac{L}{6}\right) + (P_{HW} + P_{HL}) \times \left(\frac{L}{6}\right)$$

- c. For **six** shear (transverse) walls: the interior and end wall sliding force distribution is illustrated in Figure D-20 and calculated as follows:

$$F_{SL_{int}} = (Pt + Pb) \times \left(\frac{L}{5}\right) + (P_{HW} + P_{HL}) \times \left(\frac{L}{5}\right)$$

$$F_{SL_{end}} = (Pt + Pb) \times \left(\frac{L}{10}\right) + (P_{HW} + P_{HL}) \times \left(\frac{L}{10}\right)$$

4. *Resisting Force supplied by the Superstructure:* At the shear walls the sliding force (F_{SL}) is resisted by the friction from the dead load of the

structure, reduced by the differential uplift pressure on the roof planes. Note that the "light" unit dead load was assumed for the calculations. The coefficient of static friction is assumed to be 0.4 for wood against concrete or masonry.

- a. For **two** end shear (transverse) walls: the frictional resistance is a function of dead load as illustrated in Figure D-20 and calculated as follows:

$$Fr_{end} = (DL - |P_{VL}| - |P_{VW}|) \times 0.4 \times \left[\frac{\text{spacing}}{2} \right]$$

Spacing has been conservatively set to 4 feet, regardless of actual pier spacing. If (Fr_{end}) is negative, set $Fr_{end} = 0$.

- b. For **four** shear (transverse) walls: the frictional resistance is distributed to an end and interior shear wall location as illustrated in Figure D-20 and calculated as follows:

$$Fr_{int} = (DL - |P_{VL}| - |P_{VW}|) \times 0.4 \times \text{spacing}$$

$$Fr_{end} = (DL - |P_{VL}| - |P_{VW}|) \times 0.4 \times \left[\frac{\text{spacing}}{2} \right]$$

Spacing has been conservatively set to 4 feet, regardless of actual pier spacing. If (Fr_{int} or Fr_{end}) is negative, set Fr_{int} or $Fr_{end} = 0$ as appropriate.

- c. For **six** shear (transverse) walls: the frictional resistance is distributed to an interior and end

wall the same as for four shear walls as illustrated in Figure D-20.

5. *Required Horizontal Anchorage Force:* If the horizontal sliding force exceeds the horizontal sliding resistance, then sliding occurs. This net sliding force (Ah) must be resisted by connections between the superstructure and the foundation shear walls or vertical X-bracing planes with an appropriate factor of safety, generally assumed to be 1.5 as for overturning. Refer to section D-300.2.A.5 for a full description. The equation requires substitution of the above (F_{SL}) and (Fr_{int} and Fr_{end}) values for the selected 2, 4 or 6 shear walls. For the interior shear wall locations:


$$Ah_{int} = \frac{1.5 \times F_{SL_{int}} - Fr_{int}}{Wt}$$

and for the end shear wall locations:

$$Ah_{end} = \frac{1.5 \times F_{SL_{end}} - Fr_{end}}{Wt}$$

B. Wind Load Considerations for a Type C, E or I Multi-Section Unit.

1. *General:* Comparing Figures D-19 and D-21, it is clear that the behavior of a multi-section unit is identical to the single-section unit in regards to sliding. The behavior described in section D-300.4.A. can be applied here, except that the multi-section unit is twice as wide ($2 \times Wt$).

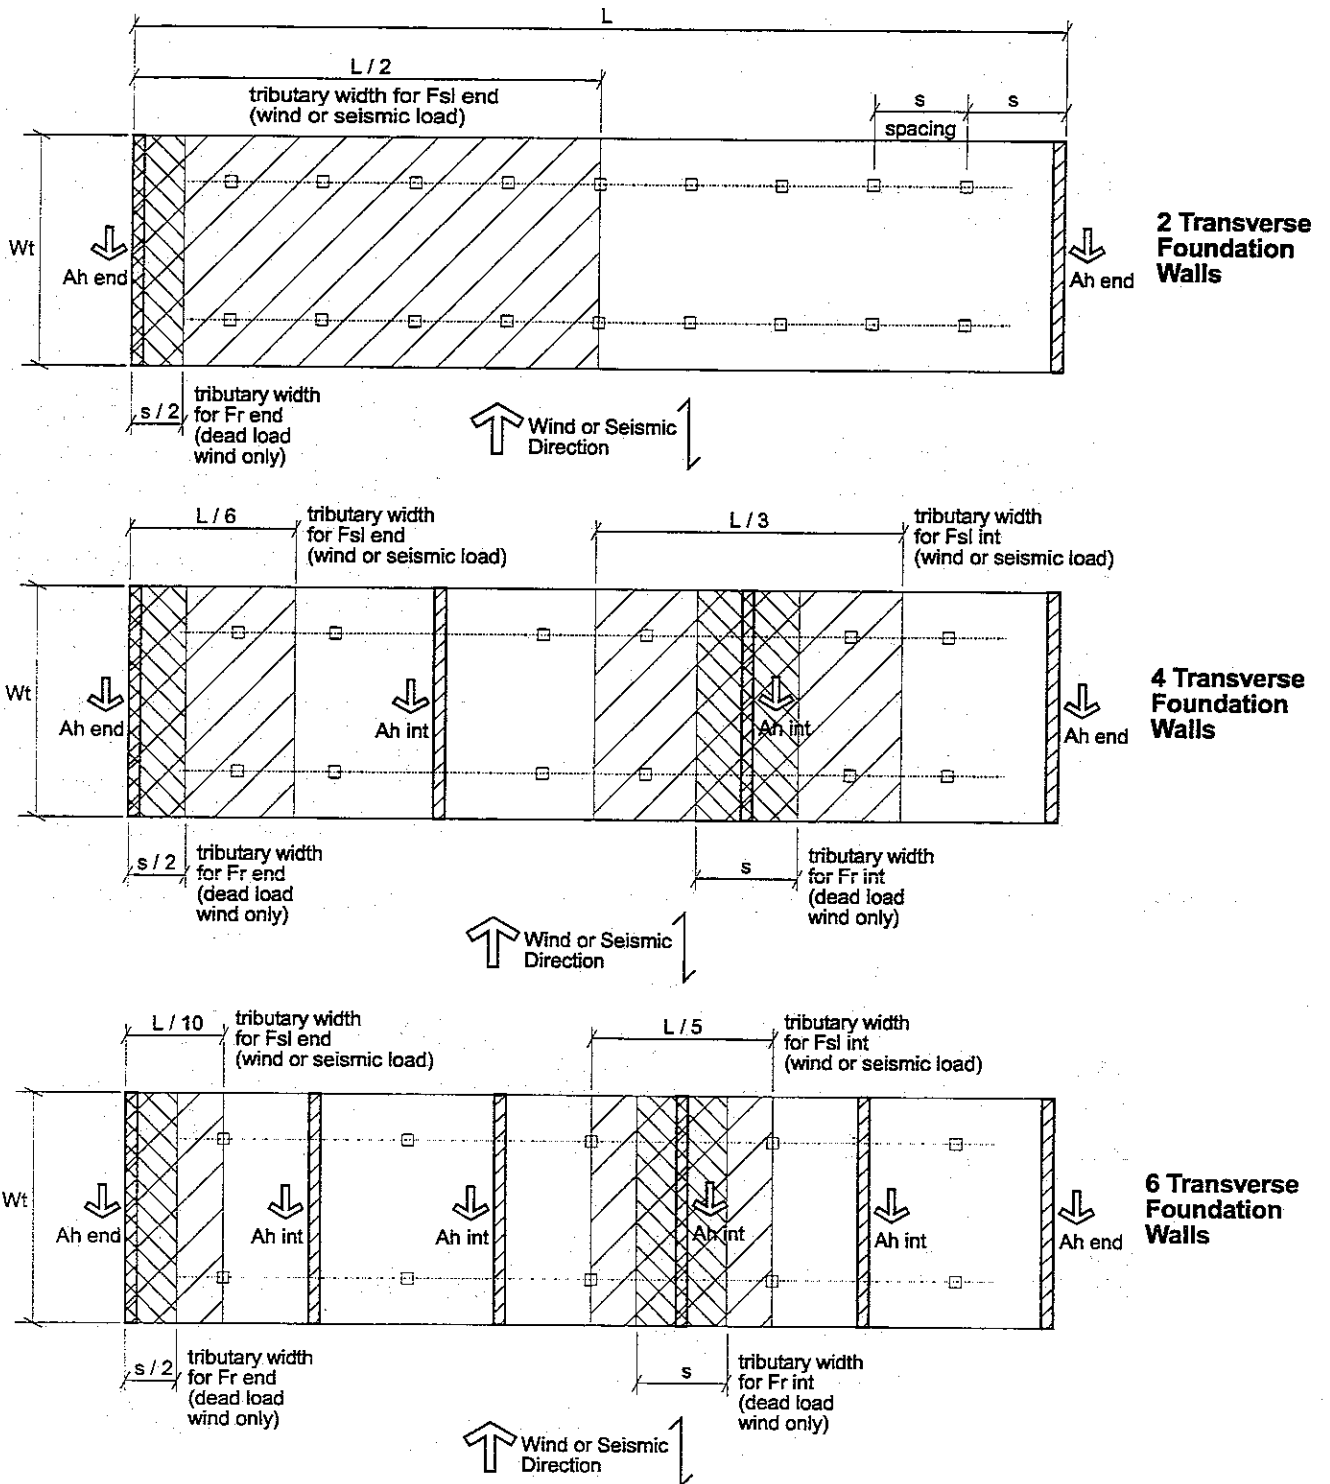

Foundation Shear Wall Planes - Sliding - Transverse Direction

Figure D - 20

2. *Wind Loads on the Superstructure:*
As shown in Figure D-21, the same wind force components are required, except that the roof forces are twice as large for the multi-section unit as follows:

$$P_t = P_b = (p_{ww} + |p_{wl}|) \times \frac{h_n}{2}$$

$$P_{vw} = p_{rw} \times W_t$$

For calculation of (Fr) use (Cp) = -0.9 in the above equation.


$$P_{vl} = p_{rl} \times W_t$$

$$P_{HW} = p_{rw} \times W_t \times \tan 20^\circ$$

For calculation of (F_{SL}) use (Cp) = +0.2 in the above equation.

$$P_{HL} = p_{rl} \times W_t \times \tan 20^\circ$$

3. *Sliding Force on the Superstructure:* The sliding force equations for single-section units from section D-300.4.A.3 are applicable, substituting the force values from section D-300.4B.2 for multi-section units.
4. *Resisting Force supplied by the Superstructure:* The resisting force equations for single-section units from section D-300.4.A.4 with the same notes are applicable, substituting the "light" dead load for a multi-section unit and the wind force values from section D-300.4.B.2.
5. *Required Horizontal Anchorage Force:* Similar equations are utilized as for the single-section units except for unit width (2 x W_t). The

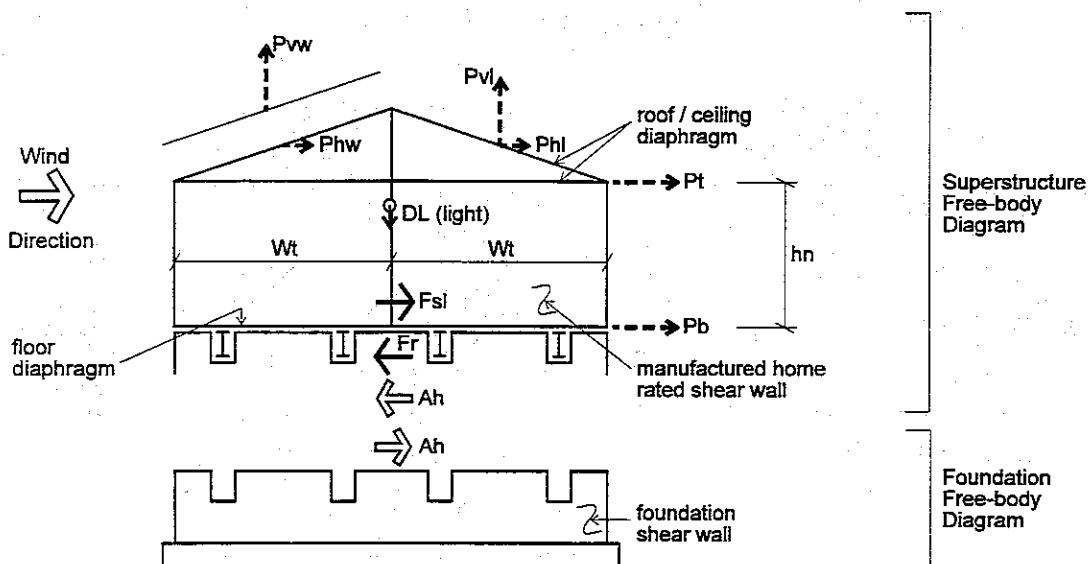

Type C, E or I Multi-Section Units

Wind Related Sliding - Transverse Direction

Figure D - 21

equation requires substitution of the above (F_{SL}) and ($F_{r_{int}}$ and $F_{r_{end}}$) values for the selected 2, 4 or 6 shear walls. For the interior shear wall location:

$$Ah_{int} = \frac{1.5 \times F_{SL_{int}} - Fr_{int}}{2 \times Wt}$$

and for the end shear wall location:

$$Ah_{end} = \frac{1.5 \times F_{SL_{end}} - Fr_{end}}{2 \times Wt}$$

C. Horizontal Anchorage with X-Bracing. The calculation of (Ah) is necessary to proceed to analyze X-bracing alternatives. Refer to Figure 6-10 and section 602-5.G for illustration and explanation of two horizontal anchorage options:


1. To use steel straps to complete the transverse foundation walls, or
2. To use steel straps instead of trans-

verse foundation walls.

D-300.5 REQUIRED HORIZONTAL ANCHORAGE BASED ON SEISMIC IN THE TRANSVERSE DIRECTION. Refer to Figures D-22 and D-23 for the free-body diagrams of the superstructure and foundation for single section and multi-section units, illustrating the horizontal forces due to seismic induced sliding. No gravity load frictional resistance is considered due to the dynamic vertical component of acceleration. Horizontal sliding is not influenced by the foundation Type C, E or I; thus the same analysis applies to all of the foundation types. Figure D-7 is related to the equation development for the calculation of horizontal inertia floor and roof forces.

A. Seismic Force Considerations for the Type C, E and I Single-Section Units.

1. *General:* Figure D-22 shows all the applied and resisting forces involved in the horizontal equilibrium equations.

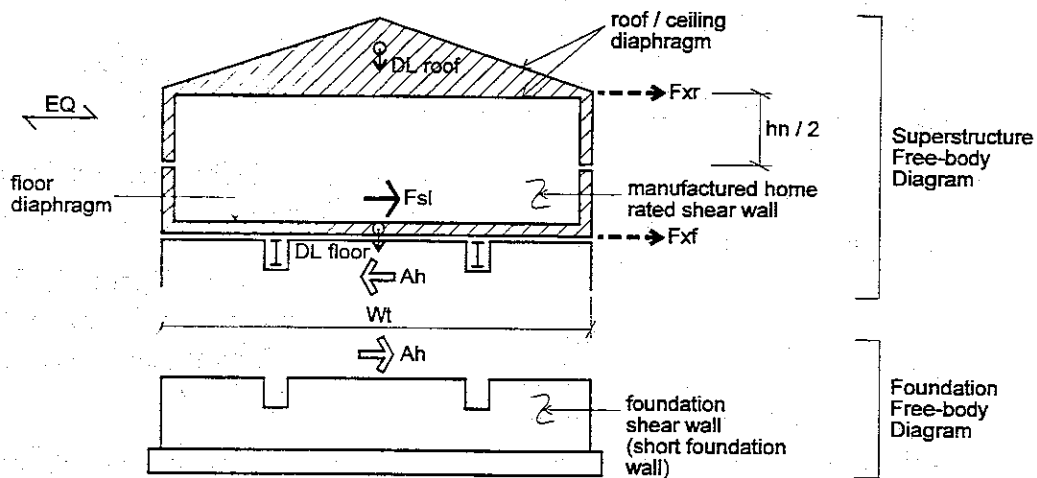

Type C, E or I Single-Section Units

Seismic Related Sliding - Transverse Direction

Figure D - 22

2. *Seismic Inertia Forces on the Superstructure:* Determination of the horizontal forces was explained in section D-200.5. The "heavy" component dead loads were used to arrive at the inertia forces for single-section units.

3. *Sliding Force on the Superstructure:* The sliding force is a function of the number of foundation shear walls (transverse foundation walls) that are used.

a. For **two** end shear (transverse) walls: the end wall sliding seismic force distribution is illustrated in Figure D-20 and calculated as follows:

$$F_{SL_{end}} = (F_{xr} + F_{xf}) \times \left(\frac{L}{2}\right)$$

b. For **four** shear (transverse) walls: the interior and end wall sliding seismic force distribution is illustrated in Figure D-20 and calculated as follows:

$$F_{SL_{int}} = (F_{xr} + F_{xf}) \times \left(\frac{L}{3}\right)$$

$$F_{SL_{end}} = (F_{xr} + F_{xf}) \times \left(\frac{L}{6}\right)$$

c. For **six** shear (transverse) walls: the interior and end wall sliding seismic force distribution is illustrated in Figure D-20 and calculated as follows:

$$F_{SL_{int}} = (F_{xr} + F_{xf}) \times \left(\frac{L}{5}\right)$$

$$F_{SL_{end}} = (F_{xr} + F_{xf}) \times \left(\frac{L}{10}\right)$$

4. *Resisting Force supplied by the Superstructure:* The unreliability of friction to provide horizontal resistance to sliding during a seismic event requires:

$F_r = 0$ for interior and end wall resistance.

5. *Required Horizontal Anchorage Force:* The equations require substitution of the above (F_{SL}) values for the selected 2, 4, or 6 shear walls. The horizontal sliding force for interior shear wall locations is:

$$Ah_{int} = \frac{1.5 \times F_{SL_{int}}}{W_t}$$

The horizontal sliding force for the end shear wall locations is:

$$Ah_{end} = \frac{1.5 \times F_{SL_{end}}}{W_t}$$

B. Seismic Force Considerations for the Type C, E and I Multi-Section Units.

1. *General:* Figure D-23 shows all the applied and resisting forces involved in the horizontal equilibrium equations.

2. *Seismic Inertia Forces on the Superstructure:* Determination of the horizontal forces was explained in section D-200.5. The "heavy" com-

ponent dead loads for multi-section units were used to arrive at the inertia forces.

3. *Sliding Force on the Superstructure:* The sliding force is a function of the number of foundation shear walls (transverse foundation walls) that are used. Reference Figure D-20 as a similar illustration, changing the unit width from (Wt) to (2 × Wt). The equations for horizontal sliding are the same as for single-section units, except that the magnitude of the inertia forces is for multi-section units as described in section D.200.5.B and D.200.5.E.7.a. and D-200.5.E.8. The sliding (F_{SL}) equations then duplicate as shown in section D-300.5.A.3 with the larger F_{xr} and F_{xf} values used in the equations.

4. *Resisting Force supplied by the Superstructure:* The unreliability of

friction to provide horizontal resistance to sliding during a seismic event requires :

Fr = 0 for interior and end wall resistance.


5. *Required Horizontal Anchorage Force:* The equations require substitution of the above (F_{SL}) Multi-Section unit values for the selected 2, 4 or 6 shear walls. The horizontal sliding force for the interior shear wall locations is:

$$Ah_{int} = \frac{1.5 \times F_{SL_{int}}}{2 \times Wt}$$

and the horizontal sliding force for the end shear wall location is:

$$Ah_{end} = \frac{1.5 \times F_{SL_{end}}}{2 \times Wt}$$

C. Horizontal Anchorage with

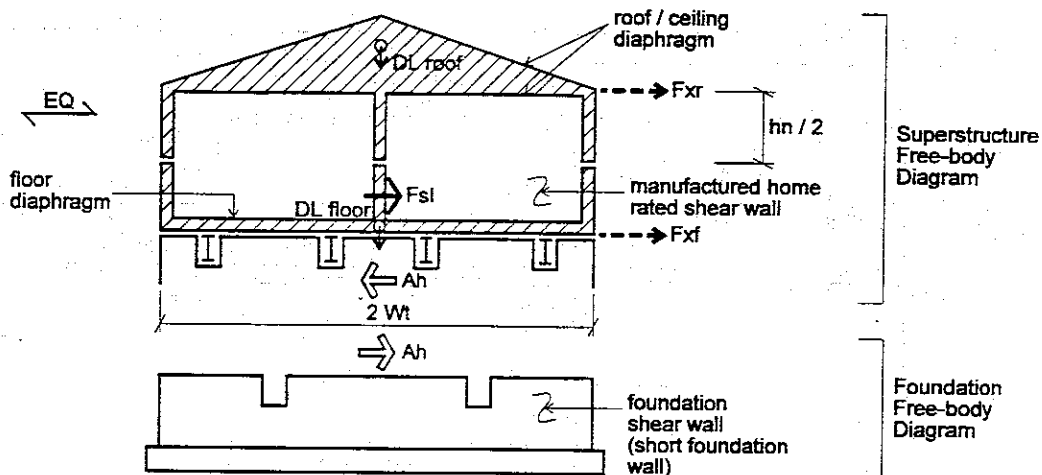

Type C, E or I Multi-Section Units

Seismic Related Sliding - Transverse Direction

Figure D - 23

X-Bracing. The calculation of (A_h) is necessary to proceed to analyze X-bracing alternatives. Refer to Figure 6-10 and section 602-5.G for illustration and explanation of two horizontal anchorage options:


1. To use steel straps or rods to complete the transverse foundation walls, or
2. To use steel straps or rods instead of transverse foundation walls.

D-300.6 REQUIRED HORIZONTAL ANCHORAGE BASED ON WIND IN THE LONGITUDINAL DIRECTION. Refer to Figure D-24 for the free-body diagram of the superstructure and foundation for single section and multi-section, illustrating the horizontal forces due to longitudinal sliding from wind loading. The longitudinal sliding force (A_h) is not influenced by the foundation Type C, E or I. The same free-body diagram is used for the analysis; however, the detailing does differ based on foundation Type C, or E and I. The

Type E or I foundation, where structural exterior longitudinal foundation walls are used, is illustrated in Figure D-25. A Type C unit, where non-structural exterior longitudinal walls are typically used, incorporates vertical X-bracing planes along the chassis beam lines for longitudinal sliding resistance as illustrated in Figure D-26. Figure D-4 is also related to the equation development of this section. A roof slope of 20 degrees (approx. 4 in 12 slope) was used so as to maximize the end wall area to produce the largest horizontal windward and leeward forces. Note that internal pressures G_{Cpi} on the end walls cancel (see Figure D-5). For allowable stress design methodology, the load combination from ASCE 7-93 is: (Wind - DL). Figures D-25 and D-26 also illustrate that a tributary width approach is used to calculate the (A_h) force transferred to each foundation horizontal load resisting plane.

A. Wind Load Considerations for the Type C, E and I Single-Section Units.

1. *General:* As shown in Figure D-24

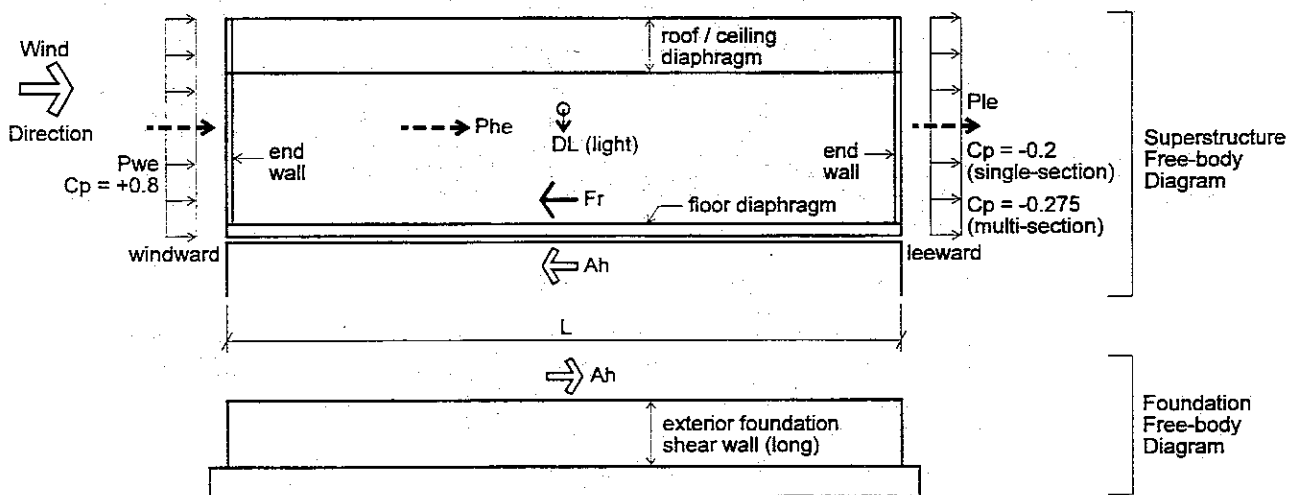

Single or Multi-Section Unit


Wind Related Sliding - Longitudinal Direction

Figure D - 24

the external wind pressure on the windward wall and the external suction on the leeward wall are transferred into the roof (plus ceiling) and floor diaphragms. The roof (plus ceiling) diaphragm transfers the force into the exterior superstructure shear walls parallel to the unit length, and then in turn to the floor diaphragm, assuming all connections are properly designed to resist the horizontal wind forces. From the floor diaphragm the horizontal force is transferred into the exterior (longitudinal) foundation shear walls for Type E or I units, or is transferred from the exterior walls to the vertical X-bracing planes under chassis beam lines for Type C units as shown in Figures D-25 and

D-26 respectively. Also, reference Figure 6-6 for further illustration of both longitudinal resistance systems. **Note:** it is assumed that the exterior superstructure shear walls can transfer their force through the floor diaphragm and send the total sliding force over to the chassis beam lines for the Type C foundation.

2. *Wind Loads on the Superstructure:* The resultant wind forces occur on the end elevations of the single-section unit. The windward pressure (p_{WE}) and the leeward suction (p_{LE}) include exterior effects only (internal effects cancel) as shown in Figures D-4 and D-5. The areas over which these pressures act are

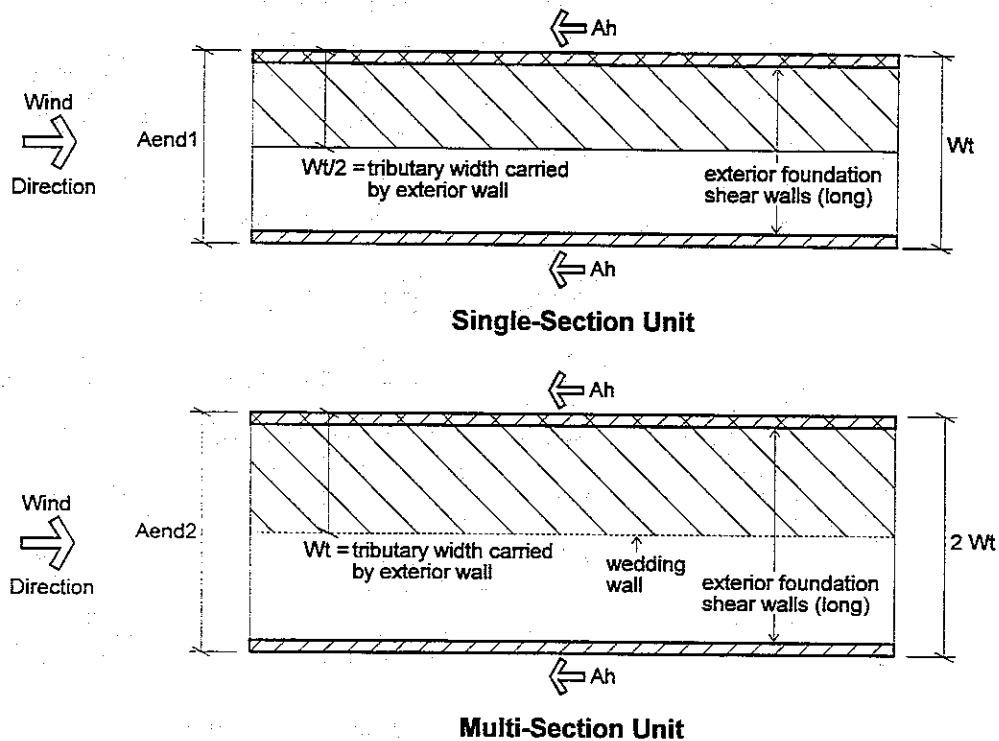

Type E or I - Foundation Shear Wall Plans - Wind Related Sliding - Longitudinal Direction

Figure D - 25

illustrated in Figure D-27 for single-section units, and is calculated as follows:

$$A_{end_1} = Wt \times h_n + \left(\frac{Wt}{2}\right)^2 \times \tan 20^\circ$$


The combined longitudinal resultant force for the windward and leeward end walls of a single-section unit is:

$$P_{HE} = (P_{WE} + |P_{LE}|) \times A_{end_1}$$

For selection of external pressure coefficients (C_p) on the leeward side, use $C_p = -0.2$ for single-section units

3. *Sliding Force on the Superstructure:* The sliding force is distributed to the two longitudinal exterior superstructure walls and then to the floor diaphragm as follows:

$$F_{SL} = \frac{P_{HE}}{2 \times L}$$

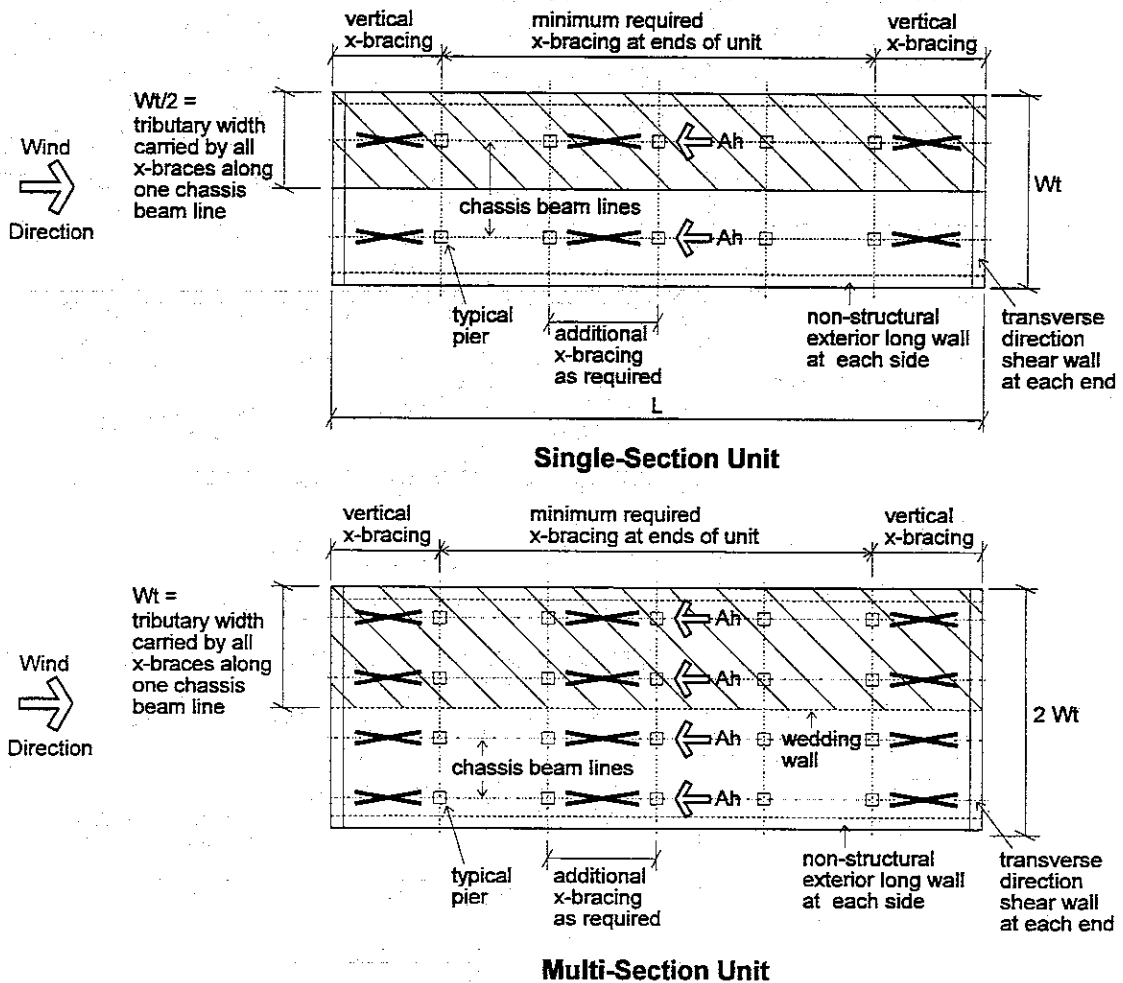

Type C - Foundation Vertical X-Bracing - Wind Related Sliding - Longitudinal Direction

Figure D - 26

4. *Resisting Force supplied by the Superstructure:* Superstructure gravity dead loads are distributed differently to the Type C and Type E or I foundations as described in section D-300.1.A to C. Also, the roof planes are subjected to external and interior combined suctions as shown in Figures D-4 and D-5 that would offset much of the dead load in most cases. **Note:** the "light" unit dead load was assumed. For these reasons, and for simplicity in the analysis, no frictional resistance was assumed to exist. This is a conservative approach. It should be pointed out that for wind speeds of 80 and 90 MPH incorporating the $C_p = -0.7$ on both roof sloping planes would have resulted in no sliding, meaning values of F_{SL} that are negative. This was ignored for additional conservatism.

5. *Required Horizontal Anchorage Force:* The longitudinal sliding force (A_h), without any assumed frictional resistance, is the same magnitude as the sliding force on the superstructure (F_{SL}). This sliding force (A_h) must be resisted by connections between the superstructure and the longitudinal foundation shear walls for Type E or I Foundations, and it must be resisted by vertical X-bracing planes for Type C foundations. The appropriate factor of safety is assumed to be 1.5 (as for overturning). Refer to section D-300.2.A.5 for a full description. The longitudinal sliding force per foot of length of unit is:

$$A_h = 1.5 \times F_{SL}$$

B. Wind Load Considerations for the Type C, E and I Multi-Section Units.

1. *General:* The analysis process is the same as for single-section units, except that the end elevation area is greater than the single section unit. Figures D-24 to D-27 illustrate the multi-section unit information required.

2. *Wind Loads on the Superstructure:* The resultant wind forces occur on the end elevations of the multi-section unit. The windward pressure (p_{WE}) and the leeward suction (p_{LE}) include exterior effects only (internal effects cancel) as shown in Figures D-4 and D-5. The area over which these pressures act is illustrated in Figure D-27 and is calculated as follows:

$$A_{end_2} = (2 \times Wt) \times h_n + (Wt)^2 \times \tan 20^\circ$$

The combined longitudinal resultant force for a multi-section unit is:

$$P_{HE} = (p_{WE} + |p_{LE}|) \times A_{end_2}$$

and $C_p = -0.275$ for multi-section units in the calculation of (p_{LE}) as required above.

3. *Sliding Force on the Superstructure:* The sliding force is distributed to the two longitudinal exterior superstructure walls and then to the floor diaphragm as follows:

$$F_{SL} = \frac{P_{HE}}{2 \times L}$$

4. *Resisting Force supplied by the Superstructure:* Same discussion applies as for single-section units.
5. *Required Horizontal Anchorage Force:* The same discussion applies as for single-section units. The longitudinal sliding force, distributed to each exterior longitudinal wall, per foot of length of unit is:

$$Ah = 1.5 \times F_{SL}$$

Note if 4 lines of vertical X-bracing are to carry the sliding force (F_{SL}) as depicted in Figure D-26 then:


$$Ah = \frac{1.5 \times F_{SL}}{2}$$

C. Horizontal Anchorage with X-Bracing. The calculation of (A_h) is necessary to proceed to analyze X-bracing. Refer to Figure 6-11 and section 603-6.F for illustration and explanation of the horizontal anchorage with X-bracing in the longitudinal direction:

Note: X-bracing is typically used for Type C units. Only Perimeter longitudinal

foundation walls would typically be required for Type E or I units.

D-300.7 REQUIRED HORIZONTAL ANCHORAGE BASED ON SEISMIC IN THE LONGITUDINAL DIRECTION. Refer to Figure D-28 for the free-body diagram of the superstructure and foundation for single section and multi-section units, illustrating the horizontal forces due to longitudinal sliding from seismic forces. The longitudinal sliding force (A_h) is not influenced by the foundation Type C, E or I. The same free-body diagram is used for the analysis; however, the detailing does differ based on foundation Type C, or E and I. The Type E or I foundation, where structural exterior longitudinal foundation walls are used, is similar to that illustrated for wind in Figure D-25. A Type C unit, where non-structural exterior longitudinal walls are typically used, incorporates vertical X-bracing planes along the chassis beam lines for longitudinal sliding resistance is similar to that illustrated for wind in Figure D-26. Figure D-7 illustrates the seismic terms and is related to the equation development found in section D-200.5.B. and E.7. and E.8. for the calculation of horizontal inertia floor and roof forces. These forces are the same magnitude in the transverse and longitudinal directions. For allowable stress design methodology, the load combination from ASCE 7-93 is: (Seismic)-DL.

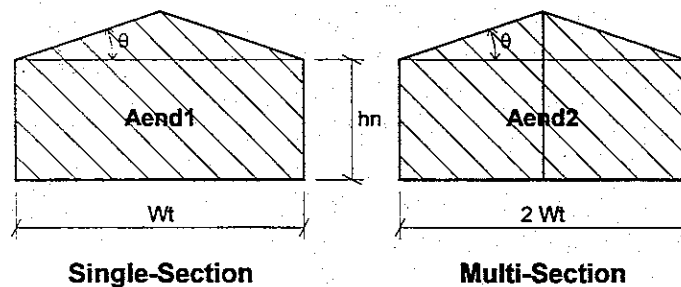

End Elevation Areas - Wind - Longitudinal Direction


Figure D - 27

A. Seismic Force Considerations for the Type C, E and I Single-Section Units.

1. *General:* Figure D-28 shows all the applied and resisting forces involved in the horizontal equilibrium equations. The seismic inertia floor and roof forces are transferred into the roof (plus ceiling) and floor diaphragms. The roof (plus ceiling) diaphragm transfers the force into the exterior superstructure shear walls parallel to the unit length, and then in turn to the floor diaphragm, assuming all connections are properly designed to resist the horizontal inertia forces. From the floor diaphragm the horizontal force is transferred into the exterior (longitudinal) foundation shear walls for Type E or I units, or is transferred from the exterior walls to the vertical X-bracing planes under chassis beam lines for Type C units. Figures D-25 and D-26,

drawn for wind loads, can be similarly applied. Also, reference Figure 6-6 for further illustration of both longitudinal resistance systems. It is assumed that the exterior superstructure shear walls can transfer their force through the floor diaphragm and send the total sliding force over to the chassis beam lines for the Type C foundation.

2. *Seismic Loads on the Superstructure:* Calculation of the seismic inertia forces is the same as that determined for the transverse direction seismic related sliding found in section D-200.5.B and E.7. and E.8.
3. *Sliding Force on the Superstructure:* The sliding force is distributed to the two longitudinal exterior superstructure walls and then to the floor diaphragm in lbs/ft of length as follows:

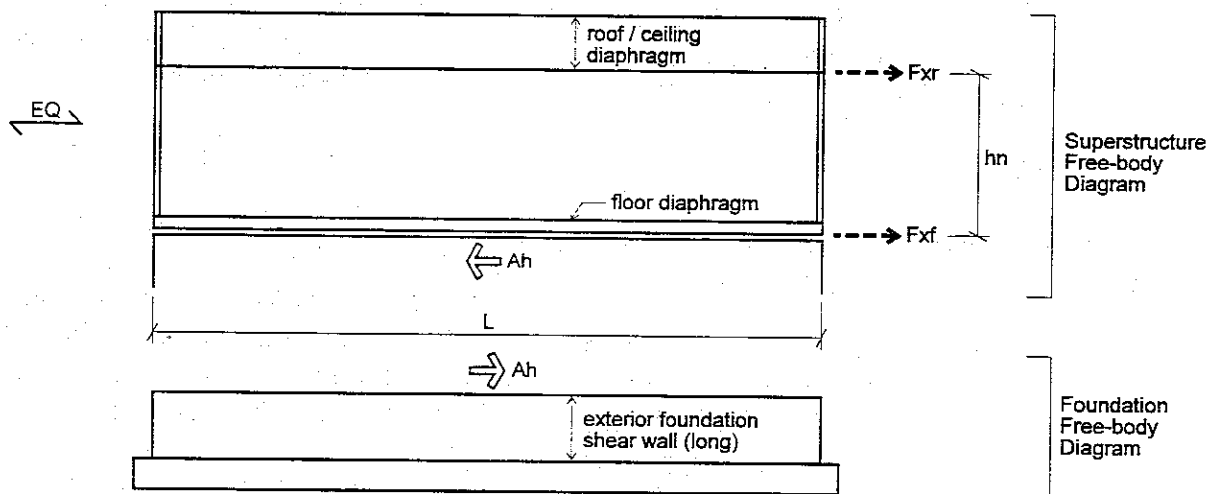

Single or Multi-Section Unit

Seismic Related Sliding - Longitudinal Direction

Figure D - 28

$$F_{SL} = \frac{(F_{xr} + F_{xf})}{2}$$

4. *Resisting Force supplied by the Superstructure:* The unreliability of friction to provide horizontal resistance to sliding during a seismic event requires:

$F_r = 0$: for all foundation types

5. *Required Horizontal Anchorage Force:* The longitudinal sliding force (A_h), without any assumed frictional resistance, is the same magnitude as the sliding force on the superstructure (F_{SL}). This sliding force (A_h) must be resisted by connections between the superstructure and the longitudinal foundation shear walls for Type E or I Foundations, and it must be resisted by vertical X-bracing planes for Type C foundations. The appropriate factor of safety is assumed to be 1.5 (as for overturning). Refer to section D-300.2.A.5 for a full description. The longitudinal sliding force per foot of length of unit is:

$$A_h = 1.5 \times F_{SL}$$

B. Seismic Load Considerations for the Type C, E and I Multi-Section Units.

1. *General:* The analysis process is the same as for single-section units, except that the dead load for the multi-section unit is greater than the single section unit, and the inertia forces will be greater. Figures D-24 to D-26, although illustrating wind loads, are similar for the multi-

section unit information required for seismic forces.

2. *Seismic Loads on the Superstructure:* Calculation of the seismic inertia forces is the same as that determined for the transverse direction seismic related sliding.

3. *Sliding Force on the Superstructure:* The sliding force is distributed to the two longitudinal exterior superstructure walls and then to the floor diaphragm in lbs/ft of unit length as follows:

$$F_{SL} = \frac{(F_{xr} + F_{xf})}{2}$$

4. *Resisting Force supplied by the Superstructure:* Same discussion applies as for single-section units. Thus, $(F_r) = 0$.
5. *Required Horizontal Anchorage Force:* The same equation applies as for single-section units. The longitudinal sliding force per foot of length of unit is:

$$A_h = 1.5 \times F_{SL}$$

C. Horizontal Anchorage with X-Bracing. The calculation of (A_h) is necessary to proceed to analyze X-bracing. Refer to Figure 6-11 and section 603-6.F for illustration and explanation of the horizontal anchorage with X-bracing in the longitudinal direction:

Note: X-bracing is typically used for Type C units. Only Perimeter longitudinal foundation walls would typically be required for Type E or I units.

APPENDIX E

MANUFACTURER'S WORKSHEET

Manufacturer's
Company Name: _____

Address: _____

Telephone: _____

Determination of Building Structure and Size

The manufacturer shall provide the following information:

- | | Single-Section | Multi-Section |
|--|----------------|---------------|
| 1. Type of unit | | |
| 2. Method, location and types of support:
Refer to Figures 6-7 and 6-8 and Section 601-4
Is the home a C, E, or I ? | | _____ |
| 3. Length of unit L | | _____ ft. |
| 4. Actual width of unit Wt | | _____ ft. |
| 5. Height of exterior wall ** | | _____ ft. |
| 6. Height of roof peak ** | | _____ ft. |
| 7. Roof slope ** | | _____ |
| 8. Self weight of total unit (W) including mechanical equipment ** | | _____ lbs. |
| 9. Distance between chassis members | | _____ ft. |
| 10. One foundation design concept (See Appendix A)
(C1-C4; E1-E8; or I) | | _____ |

11. Recommended pier spacing **
- a. Exterior _____ ft.
 - b. Interior _____ ft.
 - c. Continuous Marriage Wall _____ ft.
 - Length of largest isolated marriage wall opening or average of largest two adjacent openings _____ ft.
 - d. Tie-down Strap (C1 concept only) _____ (Number) _____ (Spacing) ft.
12. One installation method recommendations (include documentation showing connection details pertinent to geographic area for seismic or wind). ** yes no
13. Interior shear wall locations (include documentation showing locations). ** yes no
14. Design wind speed used in designing connection details for horizontal anchorage (Ah) and vertical anchorage (Av) in the transverse direction. ** _____ mph.
15. Seismic acceleration values used in designing connection details for horizontal anchorage (Ah) in the transverse and longitudinal directions. ** Av _____ Aa _____
16. Shear wall connection details with rated capacity for wind and seismic are provided. ** † yes no
- a. Connection locations at foundation end and interior walls shown? ** yes no
 - b. Rated connection capacity for uplift and overturning ** _____ lbs./ft. (or lbs./tie-down)
 - c. Rated connection capacity for sliding in transverse direction ** _____ lbs./ft. (or lbs./diag. strap)
 - d. Rated connection capacity for sliding in longitudinal direction ** _____ lbs./ft.
 - e. Vertical X-bracing tension strap capacity ** _____ lbs./diag. strap

43. The nominal building width to be used in the Foundation Design Tables, (Aftg, Av & Ah) is Wt: _____ ft.
(600-2.A and Figure 6-1)
44. Where are the foundation supports located? Check drawings submitted by the owner and Foundation Design Concepts in Appendix A. Circle the support locations shown on the Manufacturer's foundation concept plan. Chassis Beams
Exterior Walls
Marriage Wall
45. Do these locations match the Foundation Concept shown in Appendix A? Do the locations match Question #24 on the Design Worksheet? yes no
(If yes, proceed. If no, return to Owner for clarification.)
46. Is Vertical Anchorage present? yes no
(601-2.B, 601-3.B & 601-4.B (Figures 6-7 & 6-8); Mfg. Wksht. #12 & #16)

APPENDIX A

47. What is the basic system type? _____ *
(From Part 3: #24; Mfg. Wksht. #2)
48. What is the spacing between piers? Exterior: 4' 5' 6' 7' 8'
(Mfg. Wksht. #11) Interior: 4' 5' 6' 7' 8'
(602-2) Continuous Marriage Wall: 4' 5' 6' 7' 8'
- Largest or Average Marriage Wall Opening: _____ ft.
- Tie Down (C1) _____ ft.

APPENDIX B

Required Footing Size

49. The required Exterior Wall Footing, for the foundation type, is found in the Required Effective Footing Area table in App. B, Part 1. (Use maximum value from item #30.) _____ *
- The Required Exterior Square Footing size is: Type C _____ sq.ft.
Type E or I _____ ft.
(width)

50. The Required Interior Footing area is: _____ sq.ft.
 (Also exterior piers for foundation type E)

51a. The Required Continuous Marriage Wall Footing area is: _____ sq.ft.

51b. The Required Footing area under posts at the ends of marriage wall opening(s) is: _____ sq.ft.

Vertical Anchorage Requirements in the Transverse Direction (602-4)

52a. Using the Foundation Design Load Tables (Appendix B, Part 2), determine the Required Vertical Anchorage. Exterior Av _____ *
 (lbs./pier spacing;
 lbs./ft for E type;
 lbs./tie-down spacing)

52b. Number of vertical tie-down locations for multi-section units: 2 or 4 or 6

52c. For units with additional vertical anchorage at the interior piers, determine the Required Vertical Anchorage. Interior Av _____ *
 (lbs./int pier spacing)

53. What is the manufacturer-supplied value? Exterior _____ *
 (#16b, Mfg. WkSht.) Interior _____ *

54. Is this value (#53) greater than the value given in #52a? yes no
 (If yes, continue. If no, return to owner for clarification.)

Horizontal Anchorage Requirements In The Transverse Direction (602-5)

55a. What number of transverse foundation walls was selected? (602-5.E) (If vertical X-bracing planes are used, complete items #55a, #56 and #57 for 2 transverse walls, and then skip to item #59.)

55b. Are diagonal ties used to complete the top of the transverse short wall for horizontal anchorage? (602-5.G.1)

Estimate height (h) for appropriate illustration in Figure 6-10.

trial 1	trial 2	trial 3
2	4	6
yes no	yes no	yes no

ft.

56. Using the tables, find the Required Horizontal Anchorage (Ah). (Appendix B; Part 3)

End Wall Ah

trial 1	trial 2	trial 3

lbs./ft.

Int Wall Ah

--	--	--

lbs./ft.

57a. What is the manufacturer's-supplied rated capacity for sliding? (#16c, Mfg. WkSht.)

--	--	--

lbs./ft.

57b. If answer to item #55b is yes, record manufacturer or product supplier rated strap tension capacity

--	--	--

lbs./strap

58a. Is value #57a greater than item #56?
If yes, continue. If no, return to section 602-4.C and to question #55a and select a larger number of transverse foundation walls. If the maximum number selected (6) does not work, return to owner (who may wish to contact the manufacturer for clarification).

yes	yes	yes
no	no	no

58b. If answer to #55b is yes, required tension in diagonal (T_d). (Complete procedure in Section 602.5.G.1.)

--	--	--

lbs.

58c. Is value #57b greater than #58b?
If yes, continue to item #62. If no, return to owner for product with greater capacity.

yes	yes	yes
no	no	no

59. If using vertical X-bracing planes in lieu of transverse short walls (and the formulas in section 602-5.G.2), determine anchorage values and sizes for diagonal members. (If shear walls are selected in item #55, skip to item #62.)

a. Vertical X-bracing spacing proposed.

trial 1	trial 2	trial 3

ft. *

b. Number of vertical X-bracing locations proposed. (Item #13, Mfg. WkSht. for trial 1.)

--	--	--

*

	trial 1	trial 2	trial 3	
c. Required horizontal anchorage (C) value, based on formula. (602-5.G.2.c)				lbs./ x-brace set
d. Estimated height (h) in Figure 6-10.				ft.
e. Tension (T ₁) required. (602-5.G.2.d)				lbs./diag.
60. What is the manufacturer-supplied rated strap tension capacity? (#16, Mfg. WkSht.) (or capacity defined by literature supplied by product supplier)				lbs. *
61a. Is value #57 greater than value #59c? If yes, continue. If no, return to Section 602-5.G and to question #59 and select a greater number of X-brace locations as a next trial. Repeat until answer is yes, then continue.	yes no	yes no	yes no	
61b. Is value #60 greater than value #59e? If yes, continue. If no, return to section 602-5.G and to question #59 and select a greater number of X-bracing locations. If the maximum number selected does not work, return to owner (who may wish to contact the manufacturer for clarification or product supplier for clarification).	yes no	yes no	yes no	

Horizontal Anchorage Requirements In The Longitudinal Direction (602-6)

62a. Using the tables, find the required horizontal anchorage (Ah) in the longitudinal direction. (Appendix B, Part 4) (602.6.E) Exterior Wall Ah _____ lbs./ft.

62b. If using vertical X-bracing planes (and the formulas in section 602-6.F) determine anchorage value for X-bracing planes. (If using exterior long walls, skip to item #63.)

1. Number of chassis beam lines used for vertical X-bracing planes.

trial 1	trial 2	trial 3
2 or 4	2 or 4	2 or 4


- Number of X-bracing planes proposed under each chassis beam along the length of the unit.
2. Horizontal anchorage (B) required force, based on formula.
 3. Assumed height (h-b) based on Figure 6-11.
 4. Tension (T_L) based on formula. (602-6.F.(3)).
63. What is the manufacturer-supplied value for horizontal anchorage? (#16d, Mfg. WkSht.)
- 64a. For shear walls: is value #63 greater than #62a?
If yes, skip to item #67. If no, contact owner for clarification.
- 64b. For X-bracing: is value #63 greater than value #62b.2?
If yes, return to item #62b.3. If no, increase number of vertical X-bracing planes and repeat items 62b.1 and 62b.2 until answer is yes. For multi-section units consider 4 lines of vertical X-bracing under all chassis beams.
65. What is the manufacturer-supplied rated strap tension? (#16e, Mfg. WkSht. or product supplier)
66. Is value #65 greater than #62b.4?
If yes, continue. If no, contact owner to obtain straps with greater capacity, or return to item #62b.1 and increase the number of vertical X-bracing planes until answer is yes.

	trial 1	trial 2	trial 3	
				lbs.
				ft.
				lbs.
				lbs./ft.
	yes	yes	yes	
	no	no	no	
	yes	yes	yes	
	no	no	no	
				lbs.
	yes	yes	yes	
	no	no	no	

APPENDIX C

Withdrawal Resistance Verification (603-2.B)

67. Using Appendix C, Table C-1 or C-2, verify that the foundation system will resist withdrawal. Answer question #67a for type E. Answer question #67b for types C, I, or type E with interior pier anchorage.

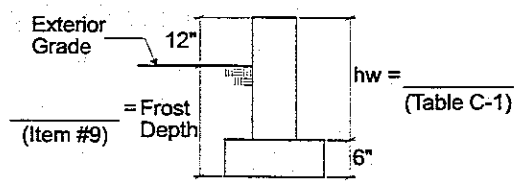

a. **Withdrawal Resistance for long foundation wall.** (Type E)

Circle the type of material that is to be used.

- Reinforced Concrete
- Masonry-Fully Grouted
- Masonry-Grouted @ 48" o.c.
- All-Weather Wood / Footing

1) Using Table C-1, which capacity is greater than required A_v ? (603-2.B.(1)) (#52a) _____ lbs./ft.

2) Using Table C-1, what is the height of the wall + footing for required withdrawal resistance? ($h_w + 6''$) _____ in.

3) What is the height of the wall + footing for frost protection? (frost depth (#9) + 12'') _____ in.

4) What is the greatest height #67a.2 or #67a.3? _____ in.

Circle the height which controls.

Withdrawal
Frost Depth


5) Record the bottom of footing depth from grade. (Item #67a.4 - 12'') _____ in.

6) Using Table C-1, what is the required width of the wall footing for withdrawal? _____ in.

7) Is item #67a.6 greater than or equal to item #49? yes no
If yes, continue. If no, change footing width to item #49.

8) Record design exterior wall footing width. _____ in.

b. **Withdrawal Resistance for Piers.** (Types C, C1 (concrete dead-man), I or type E with interior pier anchorage - multi-section units.)

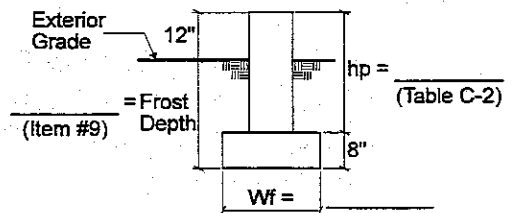

Circle pier type:

- Reinforced Concrete
- Reinforced Masonry - fully grouted
- Reinforced Concrete Dead-man

	<u>Exterior</u>	<u>Interior</u> (when used)	
1) Using Table C-2, which capacity is greater than required A_v ? (#52a and #52c) (603-2.B.(2))	_____	_____	lbs./pier *
2) Using Table C-2, what is the height of the pier + footing for required withdrawal resistance? (hp + 8")	_____	_____	in. *
3) What is the required height of pier + footing for frost protection? (frost depth (#9) + 12")	_____	_____	in.
4) What is the greatest height #67b.2 or #67b.3?	_____	_____	in.
Circle the height which controls.	Withdrawal Frost Depth	Withdrawal Frost Depth	
5) Record the bottom of footing depth from grade. (Item #67b.4 - 12")	_____	_____	in.
6) Using Table C-2, what is the required width of the square footing if withdrawal resistance controls or if frost depth controls?	_____	_____	in. *
c. Frost depth for marriage walls. What is the required depth of footing below grade for frost protection? (frost depth (#9)) (no withdrawal resistance)		_____	in.

Vertical Anchorage and Reinforcement for Longitudinal Foundation Walls and Piers (603-2.D)

68. Using Appendix C, Table C-3, C-4A or C-4B, verify that the foundation anchors will resist uplift. Answer question #68a for type E. Answer question #68b for types C, I, or type E with interior pier anchorage.

a. **Vertical Anchor Capacity for longitudinal foundation wall (type E).** (603-2.D.2)

1) Using Table C-4A (concrete & masonry), which capacity is greater than the required A_v ? (#52a, Design Wksht.)
If treated wood wall, skip to item #68a.3.

_____ lbs./lineal ft. of wall

Circle correct washer choice for the capacity selected

Standard Washer
Oversized Washer

2) Using Table C-4A (masonry and concrete):

a) Required anchor bolt diameter _____ in.

b) Required anchor bolt spacing _____ in.

c) Using Table C-3A:

(1) Rebar size _____ *

(2) Lap splice _____ in.

(3) Rebar hook length _____ in.

3) Using Table C-4B (wood), which capacity is greater than the required A_v ? (#52a, Design Wksht.)

If using concrete or masonry wall, skip to item #68b. _____ lbs./lineal ft. of wall

4) Using Table C-4B (wood):

a) Required nailing _____ *

b) Minimum plywood thickness _____ in.

c) Required anchor bolt diameter _____ in.

d) Required anchor bolt spacing _____ in.

b. *Vertical Anchor Capacity for Piers*

(Types C, I, or type E with interior pier anchorage)

(603-2.D.1)

Exterior

Interior

(when used for anchorage in multi-section units)

1) Using Table C-3, which capacity in the table is greater than the required A_v ?

(From #52a, Design Wksht.)

_____ lbs./pier

	<u>Exterior</u>	<u>Interior</u>
2) Using Table C-3:		
a) Number of anchor bolts	1 or 2	1 or 2
b) Anchor diameter	1/2" or 5/8"	1/2" or 5/8"
3) Using Table C-3A:		
a) Rebar size	#4 or #5	#4 or #5
b) Lap splice	_____	_____ in.
c) Rebar hook length	_____	_____ in.

Horizontal Anchorage and Reinforcement for Transverse Foundation Walls (603-3)

69. Using Appendix C, Table C-5A or C-5B, verify that the foundation anchorage will resist sliding at the transverse end foundation walls. Use for types C, E, or I.

	<u>End Wall</u>	<u>Interior Wall</u>
a. <i>For continuous foundations.</i>		
Using Table C-5A (concrete & masonry) or C-5B (wood), which capacity is greater than the required (Ah) (603-3) (item #56)?	_____	_____ lbs./ft.
1) Using Table C-5A, find:		
a) Required anchor bolt diameter	_____	_____ in.
b) Required anchor bolt spacing	_____	_____ in.
c) Using Table C-3A:		
(1) Rebar size	_____	_____ *
(2) Lap splice	_____	_____ in.
(3) Rebar hook length	_____	_____ in.
2) Using Table C-5B, find:		
a) Required nailing	_____	_____ *

	<u>End Wall</u>	<u>Interior Wall</u>	
b) Minimum plywood thickness	_____	_____	in.
c) Required anchor bolt diameter	_____	_____	in.
d) Required anchor bolt spacing	_____	_____	in.

b. *For transverse short foundation walls completed with diagonal braces.*
(603-5)

Using Appendix C, Table C-5A, verify the diagonal anchorage capacity to the short foundation wall.

	<u>End</u>	<u>Interior</u>	
1) Record the required horizontal force ($A_h \times W_t$) from 602-5.G.1.a and item #56.	_____	_____	lbs.
2) Table C-5A capacity for one 1/2" diameter bolt at 12" o.c.	<u>1800</u>	<u>1800</u>	lbs.
3) Number of bolts ($A_h \times W_t \div 1800$; one minimum) at concrete or masonry top of short wall.	_____	_____	*
4) Size of anchor bolts	_____	_____	in.
5) Using Table C-3A:			
a) Rebar size	_____	_____	*
b) Lap splice	_____	_____	in.
c) Rebar hook length	_____	_____	in.

c. *For vertical X-bracing planes in the transverse direction.*
(603-6)

Using Appendix C, Table C-5A, verify the diagonal anchorage to the pier footings and the tension capacity of the diagonals.

1) Record the required horizontal force (C) from item #59c.	_____	lbs.
2) Table C-5A capacity for one 1/2" diameter bolt at 12" o.c.	<u>1800</u>	lbs.

- 3) Number of bolts ($C \div 1800$; one minimum) at top of a footing. _____ *
- 4) Record the required tension force (T_t) from item #59e. _____ lbs./diag.
- 5) Select tension strap capacity greater than or equal to T_t from owner's product supplier or manufacturer's supplied capacity (item #60). _____ lbs./diag.
- 6) Record diagonal strap data _____

Horizontal Anchorage for Longitudinal Foundation Walls (603-4)

70. Using Appendix C, Table C-5A or C-5B, verify that the foundation horizontal anchorage will resist sliding at the long foundation walls. Use for types C, E and I.

a. For continuous exterior foundation walls.

Using Table C-5A (concrete and masonry) or Table C-5B (wood), which capacity is greater than the required exterior A_h ? (602-6.E) (item #62a) _____ lbs./ft.

1) Using Table C-5A, find:

- a) Required anchor bolt diameter _____ in.
- b) Required anchor bolt spacing _____ in.
- c) Using Table C-3A:
 - (1) Rebar size _____ *
 - (2) Lap splice _____ in.
 - (3) Rebar hook length _____ in.

2) Using Table C-5B, find:

- a) Required nailing _____ *
- b) Minimum plywood thickness _____ in.
- c) Required anchor bolt diameter _____ in.
- d) Required anchor bolt spacing _____ in.

b. **For vertical X-bracing planes.**
(603-6.A.(2))

Using Appendix C, Table C-5A, verify the diagonal anchorage to the pier footings and the tension capacity of the diagonals.

- | | |
|---|------------------|
| 1) Record the required horizontal force (B) from item #62b.2. | _____ lbs. |
| 2) Table C-5A capacity for one 1/2" diameter bolt at 12" o.c. | _____ 1800 lbs. |
| 3) Number of bolts ($B \div 1800$; one minimum) | _____ * |
| 4) Record the required tension force (T_L) from item #62b.4. | _____ lbs./diag. |
| 5) Select tension strap capacity greater than or equal to T_L from owner's product supplier or manufacturer's supplied capacity (item #60). | _____ lbs./diag. |
| 6) Record diagonal strap data | _____ |

SUMMARY SHEET
(Accompanies Chapter 7)

71. Compare values from preceding questions.
Select the largest value.

a. **Bearing area and vertical anchorage**

1. *Pier footings: types C, E & I.*

	Piers				sq.ft.
	Exterior	Interior	Marriage Wall		
	Cont.	At Post			
Required Effective Footing Area from questions #49, #50, & #51.	_____	_____	_____	_____	
Required footing area to resist withdrawal due to uplift from Question #67. (for single-section or 2 tie-down system, only the exterior piers resist uplift, for 4 tie-down only the interior piers and exterior walls resist uplift)	_____	_____			sq.ft.

	Piers			
	Exterior	Interior	Marriage Wall	
	Cont.	At Post		
Pier Footing Sizes (largest of above)	_____	_____	_____	_____ sq.ft.
“Dead-man” footing size.	_____ sq.ft.			

Reinforcing for pier footings:
 Bring forward answers from previous questions. (#68b)
 (Types C , I, or E with interior pier anchorage.)

	Exterior	Interior
Number of anchor bolts	_____	_____
Anchor bolt diameter	_____	_____ in.
Rebar size	_____	_____
Lap splice	_____	_____ in.
Rebar hook length	_____	_____ in.

	Exterior	Interior	Marriage Wall
Footing depth: grade to bottom of footing	_____	_____	_____ in.
Pier footing and “dead-man” footing reinforcing bars:	#4 at 10" o.c.		
“Dead-man” footing depth: grade to bottom of footing	_____ in.		

2. *Long Foundation wall footing: type E or I:*

Required Effective Footing Width	
Required Footing Width for soil bearing (#49)	_____ ft.
Required Footing Width to resist uplift withdrawal (#67a.6)	_____ ft.
<u>Wall Footing Size</u> (largest of above)	_____ ft.
Footing Depth: Grade to bottom of footing (#67a.5)	_____ in.

Footing reinforcing bars.

2 #4 bars

Reinforcing for longitudinal foundation walls: Record answers from item #68a and record sizes and spacings.

From 68a.2: masonry and concrete:

Required anchor bolt diameter

_____ in.

Required washer size

Standard

Oversized

Required anchor bolt spacing

_____ in

Rebar size

Lap splice

_____ in.

Rebar hook length

_____ in.

From 68a.4: wood: Record answers from item #68a.4 and record sizes and spacings.

Required nailing

Minimum plywood thickness.

_____ in.

Required anchor bolt diameter

Required anchor bolt spacing

_____ in

b. Horizontal anchorage in the transverse direction - foundation walls

1. *Continuous foundation walls* (#69a)

Number of transverse foundation walls (#55a)

2 4 6

Required Footing Width (minimum)

12 in.

From #69a.1: concrete / masonry:

End Wall

Interior Wall

Anchor bolt diameter

_____ in.

	<u>End Wall</u>	<u>Interior Wall</u>	
Anchor bolt spacing	_____	_____	in.
Rebar size	_____	_____	
Lap splice	_____	_____	in.
Rebar hook length	_____	_____	in.
<u>From #69a.2: wood:</u>			
Required nailing	_____	_____	
Minimum plywood nailer	_____	_____	
Anchor bolt diameter	_____	_____	
Anchor bolt spacing	_____	_____	in.

2. *For transverse short foundation walls completed with diagonal braces (#69b)*

	<u>End</u>	<u>Interior</u>	
Number of pairs of diagonals (1 for single-section units, 2 for multi-section units) times number of short walls (end or interior) (#55a)	_____	_____	
Diagonal spacing (same as number of short walls)	_____	_____	
<u>From #69b: concrete / masonry:</u>			
Anchor bolt diameter	_____	_____	in.
Number of bolts	_____	_____	
Rebar size	_____	_____	
Lap splice	_____	_____	in.
Rebar hook length	_____	_____	in.

3. *For vertical X-bracing planes in lieu of short walls. (#69c)*

Number of X-brace locations (#59)	_____
-----------------------------------	-------

Spacing of vertical X-brace planes (#59) _____ ft.

Items from #69c.3 and #69c.5

Required anchor bolt diameter _____ in.

Number of bolts at top of footing to connect diagonal _____

Diagonal strap size _____

Connection to top flange of chassis beam (describe) _____

c. **Horizontal anchorage in the longitudinal direction - exterior foundation walls**

1. *Continuous foundation walls*

Reinforcing for longitudinal foundation walls: record only if larger sizes or closer spacing than recorded for vertical anchorage (#71a.2).

From #70a.1: concrete / masonry:

Anchor bolt diameter _____ in.

Anchor bolt spacing _____ in.

Rebar size _____

Lap splice _____ in.

Rebar hook length _____ in.

From #70a.2: wood: record only if larger sizes or closer spacings than recorded for vertical anchorage (#71a.2)

Required nailing _____

Minimum plywood nailer _____

Anchor bolt diameter _____

Anchor bolt spacing _____ in.

APPENDIX G SAMPLE PROBLEMS

All the data necessary for the approval of the adequacy of a permanent foundation for the manufactured home can be located in this handbook and on worksheets submitted by the homeowner. The HUD field office (or user) must refer to Design Worksheet as a guide through the process of collecting and verifying data.

There are two steps in the approval process: (1) the Owner's Site Acceptability / Manufacturer's Worksheets, with accompanying forms as required, from the owner, and (2) the Design Worksheet. The reader is referred to the completed worksheet samples in Appendix E.

Example #1 is a proposed site for a **multi-section** manufactured home in Champaign, Illinois. The **marriage wall has two adjacent large openings of 16 and 12 feet respectively**. The remainder of the wall is continuous. Both the Owner's Site Acceptability / Manufacturer's Worksheet and the Design Worksheet for Example 1 have been filled out. Asterisks (*) on the Design Worksheet mark the items that were filled in based on data submitted by the owner. The remaining data on the Design Worksheet must be collected from the handbook as described herein.

COMMENTS - EXAMPLE # 1

Item # DESIGN WORKSHEET

Part 1 -- Site Conditions

9. Refer to the Average Depth of Frost Penetration map on page H-4. The average frost depth for Champaign Illinois is 30 inches.

14. Refer to the Termite Infestation map on page H-10. The site is in a moderate to heavy infestation region.
15. The owner has indicated compliance with CABO R.308.

Part 3 -- Design Loads

21. Calculate the distributed weight per foot of length by dividing the total weight of the home by its length: $33,040/56=590$ lbs./ft.

Dead Load

25. From Table 4-1 (402-1.A1). The light dead load value is 560 lbs./ft.
26. From Table 4-1, the heavy dead load value is 805 lbs./ft.
27. Yes, the distributed weight of the home is within the limits defined by this document. The design tables may be used.

Snow Load

28. Refer to the Ground Snow Load (Pg) map on page H-12 for the central United States. The average ground snow load is 20 psf.
29. Refer to Section D-200.2.B for minimum roof live load based on roof slope. For a 2 in 12 roof slope, the minimum roof live load is 20 psf.
30. Comparison of roof snow load (14 psf) and minimum roof live load, minimum

roof live load is greater; therefore, it controls.

Wind Load

31. Refer to the Design Windspeed map on page H-14. The site location is near the 70 mph design wind isobar. Use minimum 80 mph for *MPS* in lieu of map value.
32. Based on the map provided by the owner, the site is not near a hurricane coastline. The site is Inland.

Seismic Load

- 38a. Refer to the maps for Seismic acceleration A_a and A_v on pages H-15 and H-16. The site has Seismic acceleration values: A_a = 0.05 and A_v = 0.05.
- 38b. Residential construction is exempt from seismic considerations if A_v is less than 0.15.
41. Checking the Foundation Design Concept Tables for Type E1, this foundation type is not recommended for seismic areas where A_a and A_v are greater than or equal to 0.3. This is because the piers are unreinforced. The Type E1 concept is permitted in seismic areas where A_a and A_v are greater than 0.3, if the piers are reinforced.

Part 4 -- Final Design Procedure

42. From the table (600-2.A.1), the nominal width for a 13'-6" home width is 14'-0".
44. The user will compare the Foundation Design Concept, Figures 6-7 and 6-8 with foundation drawings and details provided by the owner. The concept drawings identify the bearing and vertical anchorage locations. An anchorage system for the

transverse and longitudinal directions must be clearly shown on the documents provided by the owner.

Required Footing Size

49. In order to determine the Required Footing sizes, the user needs the data from the following items on the Owner's Site Acceptability Worksheet: Nos. 10 or 11 and on the Design Worksheet: Nos. 24, 30, 43, 48.

Item Number

- | | |
|------------|---|
| #10 or #11 | Net allowable soil bearing pressure = 1000 psf |
| #24 | Foundation System, Multi-Section type E1 |
| #30 | Ground snow load $P_g = 20$ psf. Use 30 psf for the Foundation Design Table. The 30 psf value with load factors applied is equivalent to a minimum live load of 20 psf. |
| #43 | Nominal Building width: $W_t = 14'-0"$ |
| #48 | Pier Spacing: Interior and exterior piers, 5'-0"; Continuous Marriage wall piers, 8'-0". |

Next the user will locate the Required Effective Footing Area tables in Appendix B, Part 1. The user locates the table for a multi-wide E with a nominal width of 14 feet.

49. The user finds a note which indicates that the minimum longitudinal foundation wall footing width is 1 foot.
50. Interior pier and exterior pier

- 1) For the interior and exterior piers, the user finds the block of values for minimum roof live load of 20 psf.
- 2) Next, the user finds the two rows of values for a Net Allowable Soil pressure of 1000 psf (read ext, int row).
- 3) Under the column for a pier spacing of 5 feet, the required pier footing area is 2.1 square feet (1'-6" x 1'-6").

51a. Continuous Marriage Wall Piers

- 1) Refer to the same block of values as for the exterior/interior footings.
- 2) Next the user finds the second line of values for a Net Soil Pressure of 1000 psf (labeled mar).
- 3) Under the column for a marriage wall pier spacing of 8 feet, the required pier footing area is 6.9 square feet (2'-8" x 2'-8").

51b. Marriage Wall Openings

- 1) Refer to the lower block of values as for the ext/int footing.
- 2) Next, the user finds the average of two adjacent openings from item#48 (14 feet). Read area of footing at piers under posts as 11.4 sq.ft. (3'-6"x3'-6").

Vertical Anchorage Requirements In The Transverse Direction

52. In order to determine the Required Vertical Anchorage the user needs the data from the following items on the Design Worksheet: Nos. 24, 31, 32, 43. With this information, the user can determine Vertical Anchorage in the transverse direction

by using the appropriate table in Appendix B, Part 2.

- 1) The user locates the Tables for a Multi-Section E with a nominal width of 14 feet and 2 tie-downs.
- 2) Then the user finds a block of values for the Inland condition.
- 3) To the right of the 80 mph wind value, the user finds a value of 130 lbs./ft along the longitudinal exterior walls.

53. The user verifies that the manufacturer's design value (200 lbs./ft.) shown on line 16b of the Manufacturer's Worksheet is greater than the required value shown on line 52a. Otherwise repeat the process with four tie-downs.

Horizontal Anchorage Requirements In The Transverse Direction

55. Two (2) transverse foundation shear walls are initially selected in order to compare the required horizontal anchorage with the values provided by the manufacturer. This is trial #1.
56. In order to determine the Required Horizontal Anchorage the user needs data from the same items on the Design Worksheet that were required for Approval item number 52a plus item No. 22 (namely, the building length $L = 56'-0''$), No. 30, roof snow/minimum roof live load and No. 36, Seismic Acceleration values. Proceed knowing that you are exempt from seismic considerations.

Next, the user will locate the Required Horizontal Anchorage table in Appendix B, Part 3.

- 1) The user locates the tables for a Multi-Section E with a width of 14 feet and two (2) transverse walls.
- 2) Then the user finds the block of values for the Inland condition and the line of values for a design wind speed of 80 mph.
- 3) Then the user finds Seismic Aa range 0.05-0.2 and snow load range 0-100 psf. Only one row of values remains.
- 4) For a length L of 56 feet, the user rounds the value to the next highest number shown on the top line of the table -- 60 feet.
- 5) Under the column of values for 60 feet, the user finds the required anchorage $A_h = 420$ pounds per lineal foot along the length of each transverse shear wall. Note that the value was not grayed over, indicating the force calculations were controlled by wind.

Note: if the manufacturer has specified (1) diagonal metal straps to complete the transverse short foundation walls, or (2) vertical x-bracing in place of transverse foundation walls, for comparative purposes, the user shall use the formulas in section 602-5.G.1 or 602-5.G.2 and proceed with item #55b or #59 respectively.

58. Verify the Manufacturer's design value shown on line 57a (400 plf) is greater than the required value shown on line 56. Since it is not ($420 > 400$), attempt trial #2 and consider 4 short walls. Repeat steps 1) to 5). Read (A_h) exterior 140 plf and (A_h) interior 280 plf, both less than the manufacturer's value 400 plf. Thus, 4 short walls will provide adequate sliding resistance.

Horizontal Anchorage in the Longitudinal Direction

- 62a. In order to determine the Required Horizontal anchorage in the longitudinal direction the user needs the same data as used in steps 52 and 56 from the Design Worksheet.

Next, the user will locate the Required Horizontal Anchorage in the Longitudinal Direction tables in Appendix B, Part 4.

- 1) The user locates the table for a Multi-section unit Type E with a nominal width of 14 feet.
- 2) Then the user finds Seismic Aa range 0.05-0.1 and snow load range 0-100 psf.
- 3) Then the user finds the block of values for the Inland condition and the row of values for a design wind speed of 80 mph.
- 4) For a length L of 56 feet, the user rounds the value to the next highest number shown on the top row of the table -- 60 feet.
- 5) Under the column for 60 feet, the user finds the required anchorage force $A_h = 67$ plf along each of the longitudinal exterior shear walls. Note that the value was not grayed over indicating that the force calculations were controlled by wind, not seismic.

Note: if the manufacturer has specified a diagonal metal strap X-bracing in place of the shear wall, for comparative purposes, the user shall use the formulas in section 602-5.F, which are based on the required anchorage (A_h) found in the tables. This could be the case for Type C or I units.

64. Verify the manufacturer's design value on line 63 is greater than the required value shown on line 62a.

therefore; frost protection controls over withdrawal resistance

Withdrawal Resistance Verification

67. For type E foundations answer item 67a.

67a. For this example, a masonry foundation fully grouted was depicted on the documents submitted by the owner.

- 1) Checking the tabular columns of Table C-1, Appendix C, for Masonry-Fully Grouted, the lowest value greater than (Av) is 231 lbs. per foot. Thus, 231 > 130 (from item #52).
- 2) The footing depth (Hw) is found in the far left column, hw = 2'0". This value corresponds to the minimum depth of the footing below grade which is shown in the illustration above the table.
- 3) The width of the footing is found at the top of the column, 12".
- 4) Based on item #9, the frost depth for Champaign, IL. is 30 inches. Based on Table C-1, the depth of the base of the footing below grade is :

from Table C-1:

$$\begin{array}{r}
 \text{hw} = 24'' \\
 \quad + 6'' \text{ (footing thickness)} \\
 \quad \quad 30'' \text{ for withdrawal} \\
 \quad \quad \quad \text{resistance}
 \end{array}$$

for frost protection:

$$\begin{array}{r}
 \text{hw} = 30'' \text{ (depth below grade)} \\
 \quad + 12'' \text{ (min. wall height} \\
 \quad \quad \text{above grade)} \\
 \quad \quad 42''
 \end{array}$$

$$\begin{array}{r}
 42'' \\
 - 12'' \text{ (min. wall height} \\
 \quad \text{above grade)} \\
 30'' \text{ (bottom of footing} \\
 \quad \text{to grade)}
 \end{array}$$

for establishing the number of block courses:

$$\begin{array}{r}
 42'' \\
 - 6'' \text{ (footing depth)} \\
 36'' \text{ min. required} \\
 \quad \text{foundation wall} \\
 \quad \text{height}
 \end{array}$$

Use hw = 40", which is a multiple of the 8" masonry unit -- 40" = 5 block courses.

- 5) Interior piers under (item #67b.3.) chassis beams do not participate in vertical anchorage for this example. Frost depth considerations are accounted for at the perimeter walls. Interior piers may be set below the 18" of topsoil on undisturbed soil. See item #50 for required footing size.
- 6) Item #67c.; Marriage wall piers do not participate in vertical anchorage in any case, and do not need to set at frost depth. Again, set footings below the 18" of topsoil onto undisturbed soil.

Vertical anchorage and reinforcement for longitudinal foundation walls and piers

68. For type E foundations answer item 68a.

68a.

- 1) From item #52, the value for (Av) was 130 lbs./ft. Using Table C-4A for a ma-

sonry foundation wall, the first value in the left hand column is 146 lbs. per foot of wall. The 146 lbs./ft. value utilizes the maximum recommended anchor spacing by code as 6'-0" o.c. The wood material connected to the anchor bolt with a standard washer controls the final capacity. (Note the similarity in capacities with a treated wood foundation wall, Table C-4B, since wood bearing on washer controls).

- 2) For a masonry wall grouted solid, the following sizes are required:

On Table C-4A - on the same line as +146 lbs./ft., read:

- a) Anchor Bolt diameter = 1/2"
- b) Anchor Bolt spacing = 72"

On Table C-3A - on the same line as 1/2" anchor bolt diameter read:

- c.1) Rebar size = #4
- 2) Lap splice = 16"
- 3) Rebar hook length = 6"

Horizontal Anchorage and Reinforcement for Transverse Foundation Walls

- 69a. From item number 56, the value for transverse (Ah) is 140 lbs. per foot along the transverse end (shear) wall and 280 lbs. per foot along the interior transverse walls. Using Table C-5A for a masonry foundation wall, the first value in the left hand column is 300 lbs. per foot of wall which is greater than either end or interior (Ah). The 300 lbs./ft. value is based on the maximum recommended anchor spacing of 6'-0" o.c. by code. The mate-

rial connected to the anchor bolt will control the final capacity.

- 1) For masonry walls grouted solid, the following sizes are required:

On Table C-5A: On the same line as Ah = 300 lbs./ft., read:

- a. Anchor bolt diameter = 1/2"
- b. Anchor bolt spacing 72" (cores must be grouted solid)

On Table C-3A: On the same line as 1/2" anchor bolt diameter, read:

- c.1) Rebar = #4
- 2) Lap splice = 16"
- 3) Rebar hook length = 6"

Horizontal Anchorage and Reinforcement for Longitudinal Foundation Walls

- 70a. From item #62a, the value for longitudinal (Ah) is 67 plf. From Table C-5A, again the 300 plf value is adequate. All other information for reinforcement is the same along the exterior longitudinal walls.

Summary Sheet

The values can be brought forward on to the summary sheet and the design approved.

EXAMPLE 2

Example #2 is a proposed site for a **single-section** manufactured home in Tampa Florida. The data on the Owner's Site Acceptability Worksheet remains the same as Example #1, with the exception of item 1. The grade elevation is 28 feet. The data on the Manufacturer's Worksheet, regarding the superstructure, remains

the same as Example #1 with the exception of the following items:

Item #	Data
1.	Single-section (Nominal 14' wide unit)
2.	Type C
7.	Roof slope = 4 in 12
8.	Unit weight = 16,500 lbs.
10.	Type C1
11a.	Pier Spacing = 7 ft.
11b.	NA
11c.	NA
11d.	7 Tie-down straps at 8'-8" spacing Note: Tie-downs are required to be at 2'-0" in from each end of the unit. (Section 601-2.B.)
14.	Design wind = 120 mph
16b.	Uplift capacity = 3,150 lbs./tie-down
16c.	Sliding capacity = 4,800 lbs./diag. set
16d.	Sliding capacity = 4,800 lbs./diag. set
16e.	Vertical X-bracing tension capacity = 5600 lbs./strap

Asterisks (*) on the HUD Approval Worksheet mark the items that were filled in based on data submitted by the owner. As demonstrated in Example #1, the remaining data must be collected from the handbook as described herein.

Item # DESIGN WORKSHEET

Part 1 -- Site conditions

9. Refer to the Frost Penetration map on page H-4. The average **frost depth** for Tampa Florida is **zero inches**.
14. Refer to the Termite Infestation map on page H-10. The site is in a **very heavy** infestation area.
15. Yes, the owner has indicated compliance with CABO R-308.

Part 3 -- Design Load

23. The distributed weight is the weight of the home divided by its length:

$$16,500 / 56 = 295 \text{ lbs./ft.}$$

25. From Table 4-1 (402-1), the light dead load value is 290 lbs./ft.
26. From Table 4-1, the heavy dead load value is 425 lbs./ft.
27. Yes, the distributed weight of the home is within the limits defined by this document. The design tables may be used.

Snow Load

28. Refer to the Ground Snow Load map on page H-13 for the Eastern United States. The average **ground snow load** is **zero**.
29. Based on a 4 in 12 roof slope, the minimum roof live load is 15 psf (D-200.2.B).
30. The **15 psf minimum roof live load** controls.

Wind Load

31. Refer to the Design Wind Load map for the Eastern United States on page H-14. The average wind load is near the 100 mph design wind isobar, which exceeds the *MPS* minimum of 80 mph. Thus, **100 mph wind speed** is used for the foundation design.
32. Based on the map provided by the owner, the site is located on a hurricane coastline. The site is **Coastal**.
- 33-36. The manufacturer should supply details consistent with a coastal high wind site.

Seismic Load

38. Refer to the Seismic Acceleration maps on pages H-15 and H-16. The seismic coefficients for Hillsborough County, A_a and $A_v = 0.05$. Residential construction is exempt from seismic consideration since $A_v < 0.15$.
41. Checking the Foundation Design concepts for Type C1, it is permitted for use when seismic coefficient $A_v < 0.15$. It is not acceptable for use in areas where A_a and A_v greater than or equal to 0.3.

Part 4 -- Final Design Procedure

43. From the Section 600-2.A table, the nominal width for a 13'-8" home width is 14'-0".
44. The user will compare the Foundation Design concept illustrations with foundation drawings and details provided by the owner. The concept drawings identify the anchorage locations. An anchorage system must be clearly shown on the documents provided by the owner.

Required Footing Size

49. In order to determine the Required Footing size, the user needs the data from the following items on the Owner's Site Acceptability Worksheet item #10 or #11 and on the Design Worksheet: Nos. 24, 28-30, 43, 48.

Item Number

- #10 or #11 Net allowable soil bearing pressure = 1000 psf from Owner's Worksheet.
- #24 Foundation System, Single-section type C1

#28-#30 Ground Snow Load $P_g = 0$ psf. Use a minimum roof live load of 15 psf for the Foundation Design Load Tables.

#43 Building nominal width: $W_t = 14'-0"$

#48 Pier Spacing: Exterior = 7'-0"

Next the user will locate the Required Effective Footing Area Tables in Appendix B, Part 1.

- 1) The user locates the tables for a Single-section Type C with a width of 14 feet.
- 2) Find the block of values for a Minimum Roof Live Load of 15 psf.
- 3) Next the user finds the row of values for a net allowable soil pressure of 1000 psf.
- 4) Last, the user finds the intersection of that row with the column for a 7'-0" foot pier spacing. The required footing area is 5.3 square feet (2'-4" x 2'-4").

Vertical Anchorage Requirements in the Transverse Direction

- 52a. In order to determine the Required Vertical Anchorage the user needs the data from the following items on the Design Worksheet: Nos. 24, 31, 32, 43 and 48. With this information, the field officer can locate and determine the Required Vertical Anchorage tables in Appendix B, Part 2.

Use the tables for a Type C1 system. Then multiply A_v x Tie-down spacing.

Item No. Data

#24 Foundation System: Type C1 - Single-section

#31 Design Windspeed: 100 mph

#32 Site Location: Coastal

#43 Building Nominal Width: 14'-0"

#48 Tie-down Spacing: $s_t = 8'-8"$. Number of tie-downs is 7 from (N):

$$N = \frac{L - 2 \times 2'}{s_t} + 1$$

- 1) The user locates the Required Vertical Anchorage (Appendix B, Part 2) tables for a Single-section Type C1 with a nominal width of 14 feet.
- 2) Then the user finds a block of values for the Coastal condition.
- 3) Locate the row for a wind speed 100 mph. The user finds the required vertical anchorage $A_v = 350$ lbs./ft. of home length and multiplies this by a tie-down spacing of 8.667 feet (3033 lbs.) or conservatively move across the row to the next largest anchor spacing (10') and reads 3460 lbs. as an approximate check.
- 4) The Required Vertical Anchorage force for a tie-down is 3033 lbs.

54. The manufacturer's supplied value, item #53, is 3,150 pounds, which is more than the Required Vertical Anchorage of 3,033 pounds. Note: see optional details in Appendix A for Type C1. If the manufacturer's supplied value had been less than A_v , the owner would have been notified. The owner would need to contact the manufacturer in order to have a licensed

structural engineer verify the existing design or modify the anchor design or spacing to comply with the required anchorage.

Horizontal Anchorage in the Transverse Direction

56. In order to determine the Required Horizontal Anchorage, the user needs data from the same items on the Design Worksheet that were required for Approval item number 52a and item No. 22 (the building length $L = 56'-0"$). Also required is item #9 (6'-10") from the Manufacturer's Worksheet.

Next, the user will locate the Required Horizontal Anchorage table in the transverse direction in Appendix B, Part 3.

- 1) The user locates the tables for a Single-section Type C, E or I with a nominal width of 14 feet and initially selects two transverse walls for trial #1. This is required to initiate the process of selecting vertical X-bracing planes for horizontal anchorage in the transverse direction.
- 2) Then the user finds the block of values for the Coastal condition and the row of values for a design wind speed of 100 mph. All Seismic is on the same horizontal line, even though it need not be checked.
- 3) For a length L of 56 feet, the user rounds the value to the next highest number shown on the top row of the table -- 60 feet.
- 4) Under the column of values for 60 feet, the user finds the required anchorage (A_h) of 1240 pounds per lineal foot

along the length of each transverse foundation wall (2 shear walls).

- 59c. The required horizontal anchorage per X-brace set (C) is calculated using the procedure of Section 602-5.G.2, illustrated in Figure 6-10.

Process always begins by selecting 2 short walls, then:

1. From item #56, Ah = 1240 lbs./ft.
2. Solving equation for H:

$$H = \frac{1240 \times 13.67 \times 2}{56} = 605 \text{ lbs./ft. of unit length}$$

Note: actual unit width, rather than nominal width is used here.

3. For a first trial, set spacing equal to a multiple of pier spacing: try 14'-0". Solving equation for horizontal force at each X-brace set (C):

$$C = 605 \times 14'-0" = 8475 \text{ lbs./X-brace set.}$$

Note: number of vertical X-brace planes =

$$\frac{L}{\text{spacing}} + 1 = \frac{56}{14} + 1 = 5$$

therefore, number of X-braced planes equals 5.

- 61a. Verify that the Manufacturer's design value on line #57a is greater than the required value (C) shown on line #59c. In this example, the manufacturer's design value of 4800 lbs. (#57) is less than the Required Horizontal Anchorage (C) =

8475 lbs. This indicates that the connection of unit to a foundation diagonal is inadequate for sliding resistance.

The owner would be contacted at this point and notified that the horizontal anchorage is not adequate. If an inspector or owner wanted to determine how many vertical X-bracing planes would be required, they could use the following:

Trial #2:

Piers must be present at the extremities of any vertical X-bracing plane; therefore, the next logical choice is the actual pier spacing of 7'-0".

1. From item #56, Ah = 1240 lbs./ft.
2. Solving equation for H:

$$H = \frac{1240 \times 13.67 \times 2}{56} = 605 \text{ lbs./ft. of unit length}$$

Note: actual unit width, rather than nominal width is used here.

3. C = 605 × 7'-0" = 4235 lbs./X-brace set.

Number of vertical planes =

$$\frac{56'}{7'} + 1 = 9$$

The required horizontal anchorage of 4235 is less than the manufacturer's rated capacity of 4800 lbs., thus 9 vertical X-bracing planes are required at the same spacing as the piers (7'-0").

- 59d. The user must estimate a height (h) on Figure 6-10, which can be revised later if necessary. Try h = 4 feet.

- 59e. From item #9, Manufacturer's Worksheet, $Wt - 2 dc = 6.83'$:

$$\cos\theta_t = \frac{6.83}{\sqrt{4^2 + (6.83)^2}} = 0.863$$

therefore: $\theta_t = 30.4^\circ$

$$T_t = \frac{4235}{0.863} = 4907 \text{ lbs. tension in strap}$$

- 61b. The rated capacity of a strap in tension, item #60 is greater than the required T_t (item #59e) for 9 vertical X-bracing planes $5600 > 4907$, therefore OK.

Horizontal Anchorage Requirements in the Longitudinal Direction

- 62a. In order to determine the Required Horizontal Anchorage (Ah) in the Longitudinal Direction, the user needs data from the same items in the Design Worksheet that were required for item #56.

Next, the user will locate the Required Horizontal Anchorage Table in the Longitudinal Direction (Appendix B, Part 4).

- 1) The user locates the table for a Single-section, Type C, E, or I with a nominal width of 14 feet.
- 2) Then, the user finds the block of values for $Aa = 0.05-0.10$, ground snow 0-100 psf and coastal site.
- 3) The user finds the row of values for wind speed of 100 mph.
- 4) For a length (L) of 56 feet, the user rounds to the next highest length shown across the top row of the table - 60 feet.

- 5) Under the column for 60 feet, the user finds the intersection value with the row for 100 mph wind speed. Read $Ah = 47 \text{ lbs./ft.}$ of length along the longitudinal exterior foundation walls, if shear walls exist.

- 62b For this example of a Type C1 foundation, no structural exterior longitudinal walls exist, thus vertical X-bracing planes are required between piers under chassis beam lines. Follow the procedure of Section 602-6.F and use the illustration in Figure 6-11 and Figure D-26.

Begin Trial 1 with the minimum required vertical X-bracing planes: $n = 2$; one pair under each chassis at both ends of the unit length. Follow the equation:

$$B = \frac{47 \text{ plf} \times 56}{2} = 1316 \text{ lbs. of horizontal force carried by each X-brace set.}$$

64. Verify that the manufacturer's rated value (item #63) is greater than the required horizontal anchorage force (B) of item #62b.2. In this example the manufacturer's value of 4800 lbs. is greater than B. Thus, vertical X-bracing planes at both ends of the unit and under each chassis beam line is adequate.

- 62b.3 Approximate the height (h) in Figure 6-11 by assuming the chassis beam is 1 foot deep, thus: $h = 4' - 1' = 3'$.

- 62b.4 Return to the calculation procedure of section 602.6.F and determine the tension force in a diagonal strap:

$$\text{first: } \cos\theta_L = \frac{7}{\sqrt{3^2 + 7^2}} = 0.919$$

therefore: $\theta_L = 23.2^\circ$

$$\text{next: } T_L = \frac{1316}{.919} = 1432 \text{ lbs.}$$

66. Verify that the manufacturer's (or product supplier) rated value (item #65) is greater than the required tension (T_L) from item #62b.4. In this example, the manufacturer's value of 5600 lbs. is greater than (T_L). Thus, the straps proposed are adequate as tension diagonals.

Withdrawal Resistance Verification

- 67b. For Type C1 foundation answer item 67b for concrete "deadman" footings.

For this example, square concrete footings used as "deadmen" are depicted on the documents submitted by the owner to anchor the tie-down straps. See Appendix A - concept details for Type C1 foundation.

1. From item number 52a, the value for A_v is 3033 lbs. per tie-down anchor.
2. Use Table C-2, The Withdrawal Resistance for Piers, in Appendix C. Table C-2 can conservatively be used for concrete footings used as "deadman" anchors. The footing depth (hp) in the far left column can either be hp = 3'-4" for a 3'-0" sq. ft. footing or hp = 2'-0" for a 4'-0" sq. ft. footing. Assume the least costly solution is the 3'-0" square footing.
3. Based on item #9, the frost depth for Tampa, FL. is 0". Thus, the "deadman" footings are at an adequate depth. The pier footings under the chassis beams can be set 8" below grade, if undisturbed soil (not organic material) is available, otherwise, footing must extend to firm bearing strata.

Vertical Anchorage and Reinforcement for Long Foundation Walls and Piers

68. For type C foundations answer item 68b.

- 1) From item number 52a, the value for A_v is 3033 lbs. per foot. The lowest value greater than A_v on Table C-3 is 4240 pounds.
- 2) For the size of bolt set in concrete "deadman" to complete connection to the tie-down rod, from Table C-3:
 - a) Number of anchor bolts = 1
 - b) Anchor bolt diameter = 1/2"
- 3) Use Table C-3A for the reinforcement of the piers under the chassis beams. Even though these piers do not directly receive anchorage overturning force, it is desirable to reinforce them to assist in force distribution in the vertical X-bracing planes.
 - a) Rebar size = #4
 - b) Lap splice = 16"
 - c) Rebar hook length = 6"

Horizontal Anchorage and Reinforcement for Transverse Foundation Walls

- 69c. From item number 59c (Assume the owner decided to use 9 X-bracing planes), the value for (C) is 4235 lbs. per diagonal. Use Table C-5A for concrete. The horizontal capacity of a single bolt is shown at a spacing of 12".

Bolt size	Capacity
1/2"	1800 lbs.

Three 1/2" bolts would be required to connect the diagonal to the footing. Detail the pier footing as shown in Table C-5A.

Verify that the rated capacity of the strap exceeds the required tension (T_L).

Horizontal Anchorage and Reinforcement for Longitudinal Foundation Walls

70b. From item #62b.2, record the horizontal anchorage force (B) as 1316 lbs. per X-brace. Again, from Table C-5A, the shear capacity of a 1/2" diameter bolt in con-

crete is 1800 lbs. One anchor bolt is sufficient into the concrete footing. Detail the pier footing as shown in Table C-5A. Verify that the rated strap capacity exceeds the required tension (T_L).

Summary Sheet

The values can be brought forward on to the summary sheet and the design approved.

APPENDIX E OWNER'S SITE ACCEPTABILITY WORKSHEET

Owner's
Name:

JOHN DOE

Address:

1600 S. FIRST ST.

CHAMPAIGN, IL

Telephone:

Site Location:

CHAMPAIGN, IL

Legal Description:

Have you provided a copy of a map pinpointing the site?

yes no

Have you submitted a foundation plan?
(See #10 of Manufacture's Worksheet)

yes no

Preliminary Site Information

Before approval of the site can begin, the applicant must provide preliminary site information to the field office. Refer to Chapter 2, "Site Acceptability Criteria" for clarification.

1. Provide survey results showing existing grade elevation. (201-1)

N.A. ft.

2. Is the building in a flood-prone area? (201-2)

yes no

If the answer to 2 is Yes, answer 3, 4, & 5.

If the answer to 2 is No, answer 6, below.

3. What is the Base Flood Elevation?

_____ ft.

What is the Flood Protection Elevation?

_____ ft.

4. Has approval for drainage, grading and berming been approved for flood-prone sites?

yes no

5. Have permits been provided?
(Permits must be obtained for any alteration of the building site in a flood protection area.)

yes no

6. Provide geotechnical report in areas of known high water table. (201-4)

yes no

7. Provide geotechnical report if adverse site conditions are found or suspected. (203)

yes no

8. Provide site-drainage plan complying with CABO R301.3 or local requirements. (301)

yes no

9. Provide fill specifications if site is to be prepared with earth fill. (303-2)

yes no

10. If a geotechnical report is required, what is the net allowable soil bearing pressure? (202)

_____ psf.

11. If no adverse soil conditions are known or suspected, and if the home is individually sited, assume a soil bearing pressure of 1,000 psf. and use this value when a determination of soil bearing pressure is called for.

1,000 psf.

APPENDIX E MANUFACTURER'S WORKSHEET

Manufacturer's
 Company Name: HOWARD SMITH CO., INC.
 Address: 1904 W. 75TH ST.
NEW YORK, N.Y. 10031
 Telephone: (314) 329-XXXXE

Determination of Building Structure and Size

The manufacturer shall provide the following information:

- | | Single-Section
Multi-Section |
|--|---------------------------------|
| 1. Type of unit | <u>E</u> |
| 2. Method, location and types of support:
Refer to Figures 6-7 and 6-8 and Section 601-4
Is the home a C, E, or I? | <u>E</u> |
| 3. Length of unit L | <u>56</u> ft. |
| 4. Actual width of unit Wt | <u>13'-8</u> ft. |
| 5. Height of exterior wall ** | <u>7'-6</u> ft. |
| 6. Height of roof peak ** | <u>2'-3</u> ft. |
| 7. Roof slope ** | <u>2 :: 12</u> |
| 8. Self weight of total unit (W) including mechanical equipment ** | <u>33040</u> lbs. |
| 9. Distance between chassis members | <u>6'-10</u> ft. |
| 10. One foundation design concept (See Appendix A)
(C1-C4; E1-E8; or I) | <u>E1</u> |

11. Recommended pier spacing **

- a. Exterior 5.0 ft.
- b. Interior 5.0 ft.
- c. Continuous Marriage Wall 8.0 ft.
- Length of largest isolated marriage wall opening or average of largest two adjacent openings $\frac{16+12}{2} = 14$ 14.0 ft.
- d. Tie-down Strap (C1 concept only) N.A. (Number) N.A. (Spacing) ft.

12. One installation method recommendations (include documentation showing connection details pertinent to geographic area for seismic or wind). **

yes no

13. Interior shear wall locations (include documentation showing locations). **

yes no

14. Design wind speed used in designing connection details for horizontal anchorage (Ah) and vertical anchorage (Av) in the transverse direction. **

100 mph.

15. Seismic acceleration values used in designing connection details for horizontal anchorage (Ah) in the transverse and longitudinal directions. **

Av 0.05

Aa 0.05

16. Shear wall connection details with rated capacity for wind and seismic are provided. ** †

yes no

a. Connection locations at foundation end and interior walls shown? **

yes no

b. Rated connection capacity for uplift and overturning **

200 lbs./ft.
(or lbs./tie-down)

c. Rated connection capacity for sliding in transverse direction **

400 lbs./ft.
(or lbs./diag. strap)

d. Rated connection capacity for sliding in longitudinal direction **

400 lbs./ft.

e. Vertical X-bracing tension strap capacity **


N.A.
lbs./diag. strap

f. Engineering calculation by licensed structural engineer? **

yes no

**** Optional values:** It is optional for the manufacturer to provide these values. If the manufacturer does not provide the values, it is the responsibility of the owner to supply values, based on engineering analysis by a licensed structural engineer.

† Item 16 is provided in California.



APPENDIX F DESIGN WORKSHEET

Owner's Name: JOHN DOE
Address: 1600 S. FIRST ST., CHAMPAIGN, IL
Builder's Name: ACME, LTD
Site Location: CHAMPAIGN, IL

PART 1: SITE CONDITIONS (Accompanies Chapter 2)

1. Has the Manufacturer's Worksheet been provided?

yes no

Existing Grade Elevation (201-1)

2. Does the site require a survey?

(Answer yes if: 1) elev. to be altered by grade or fill; 2) site near flood zone; 3) subdivision. Answer no if individually-sited with no alteration of building site.)

yes no

3. If yes to above, what is the surveyed existing grade elevation?

N.A. ft.

Flood Protection Elevation (201-2)

4. Is the building site in a flood zone?

(If yes to 4, then answer 5, 6, 7 & 8. If no, skip to 9.)

yes no

5. What is the Base Flood Elevation or the Flood Protection Elevation (use highest value)?

- ft.

6. Is the site to be graded, filled, or bermed?
(If no, skip to 9.)

yes no

7. If yes to 6, have all permits been provided?

yes no

8. If no to 6, then are the buildings to be built on elevated foundations?

(If yes, this handbook cannot be used. Refer to FEMA Manual.)

yes no

Frost Penetration Depth (201-3)

9. What is the maximum frost penetration depth?
(see Appendix H, page H-4) 30 in.
- 10a. Does foundation plan show base of footing extending below frost penetration depth?
(If yes proceed; if no, applicant should revise plans.) yes no
- 10b. Does foundation plan show base of footing extending below top-soil layer (min. 12") to undisturbed soil? yes no

Ground Water Table Elevation (201-4)

11. For subdivisions, does a Geotechnical Engineer recommend drainage of subsurface water?
(If no, skip to 13.) yes no
12. Has groundwater drainage plan been provided? yes no

Soil Conditions (202, 203)

13. If any of the following adverse site conditions are discovered, specific recommendations by a Geotechnical Engineer will be required (applies to subdivisions and individually-sited homes.)

- Organic soil (8" topsoil layer) 18" layer of topsoil yes no
- Expansive (shrink-swell) soil as a site condition yes no
- Sloping site yes no
- Subsidence yes no

(Applicant may be referred to Geotechnical Engineer if any of the above are yes. If no, to all of above, move to next step.)

14. Is area in a known termite infestation area? yes no

Region classification?

(See Appendix H, Termite Infestation Map, page H-10) (If no, skip to 16.)

MODERATE TO HEAVY

15. Has applicant complied with CABO R-308 or local ordinance for construction procedures and treatment?
(If yes, continue; if no, refer applicant to CABO requirements.) yes no

PART 2: SITE PREPARATION

(Accompanies Chapter 3)

16. Acceptable surface drainage plan provided? (301)
(If no, one must be provided for subdivision) yes no
17. Grading plan provided? (302) yes no
18. Fill specifications conforming to those cited in HUD Land Planning Data Sheet (79g)? (303)
(If fill is used, below the home's foundation, a report by Geotech. Eng. should be submitted to provide fill specifications.) yes no
19. Finish grade elevation? (304) _____ *
(Check answers to Part 1: #4 & #5. The finish grade elevation must be higher than #5 if in flood zone.)

PART 3: DESIGN LOADS

(Accompanies Chapter 4)

Information from Manufacturer's Worksheet

20. Has all the information been provided on the Manufacturer's Worksheet? (Appendix E) yes no
21. What is the building self weight (W)?
(Mfg. Wksht. #8) 33,040 lbs.
22. What is the building length (L)?
(Mfg. Wksht. #3) 56 ft.
23. What is the distributed weight per foot of unit length? ($w=W/L$)
(402-1.B, C) 590 lbs./ft.
24. What is the building type?
(Mfg. WkSht. #2) Single-Section Multi-Section
C, E, or I
- Foundation design concept?
(C1, C2, C3, C4, E1, E3, E4, E5, E6, E7, E8, I) E1 *

Dead Load (402-1)

25. What is the light dead load value from Table 4-1?
(402-1.A.1)

560 *
(lbs./ft.)

26. What is the heavy dead load value from Table 4-1?
(402-1.A.2)

805 *
(lbs./ft.)

27. Does the answer from Question #23 fall within the values in #25 and #26? (402-1.D)
(If the answer is yes, continue. If no, the foundation is not within the limits of this document and must be redesigned by a structural engineer.)

yes no

Snow Load (402-2) / Minimum Roof Live Load (402-2.C)

28a. What is average annual ground snowfall (Pg)?
(See Ground Snow Load map, pages H-11, H-12 and H-13.)

20 *
(lbs./sq.ft.)

28b. What is 0.7 multiplied by Pg?

14 psf.

29a. What is the roof slope? (Mfg. Wksht. #7)

2::12

29b. What is the minimum roof live load for the roof slope?
(D-200.2.B)

20 psf.

30. Record the larger magnitude of item 28b or item 29b. Use this magnitude for roof load where required.

20 psf.

Wind Load (402-3)

31a. What is the basic wind speed (V)?
(See Wind Speed map, page H-14.)

70 mph.

31b. If V is less than 80 mph, record *MPS* min. 80 mph for wind design. (402-3.A)

80 mph.

32. Is the site inland or coastal? (402-3.B)
(If inland, skip to question #38.)

Inland
Coastal

33. If a coastal area, has the manufacturer provided connection details? (402-3.D) (Mfg. Wksht. #12)

yes no

34. If yes to #33, what design wind speed has the manufacturer used in designing connection details? _____ mph. *
(Mfg. Wksht. #14)
35. Are the connection locations shown? (Mfg. Wksht. #16a) yes no
36. Are connection details provided for foundation shear walls? yes no
(For an answer of yes, all questions under Mfg. Wksht #16 must be answered satisfactorily.)
37. Is the value for Question 34 equal to or greater than the number given in Question 31? yes no
(If yes, proceed. If no, return design to manufacturer for clarification.)

Seismic Load

- 38a. What are the seismic acceleration values? Aa 0.05 *
(See Seismic maps, pages H-15 and H-16) Av 0.05 *
- 38b. Is A_v < 0.15? yes no
(if no, proceed. If yes, seismic need not be considered, skip questions 39 to 41.)
39. Seismic performance category. N.A.
(See H-300 for Special Requirements of Foundation Design.)
40. What is the applicant's proposed design concept? N.A. *
(Design Wksht. #24)
41. Do the Foundation Design Concept Tables approve the foundation system for use in seismic areas of Question #38 above? (See Appendix A) yes no
(If yes, proceed. If no, return to applicant for foundation design choice more suited to high seismic areas.)

PART 4-FINAL DESIGN PROCEDURE
(Accompanies Chapter 6)

42. What is the actual building width? 13'-8" ft.
(Mfg. Wksht. #4)

43. The nominal building width to be used in the Foundation Design Tables, (Aftg, Av & Ah) is Wt: (600-2.A and Figure 6-1)

14'-0 ft.

44. Where are the foundation supports located? Check drawings submitted by the owner and Foundation Design Concepts in Appendix A. Circle the support locations shown on the Manufacturer's foundation concept plan.

Chassis Beams
Exterior Walls
Marriage Wall

45. Do these locations match the Foundation Concept shown in Appendix A? Do the locations match Question #24 on the Design Worksheet? (If yes, proceed. If no, return to Owner for clarification.)

yes no

46. Is Vertical Anchorage present? (601-2.B, 601-3.B & 601-4.B (Figures 6-7 & 6-8); Mfg. Wksht. #12 & #16)

yes no

APPENDIX A

47. What is the basic system type? (From Part 3: #24; Mfg. Wksht. #2)

E1 *

48. What is the spacing between piers? (Mfg. Wksht. #11) (602-2)

Exterior: 4' 5' 6' 7' 8'

Interior: 4' 5' 6' 7' 8'

Continuous Marriage Wall: 4' 5' 6' 7' 8'

$\frac{16+12}{2} = 14'$ Largest or Average Marriage Wall Opening: 14 ft.

Tie Down (C1) N.A. ft.

APPENDIX B

Required Footing Size

49. The required Exterior Wall Footing, for the foundation type, is found in the Required Effective Footing Area table in App. B, Part 1. (Use maximum value from item #30.)

E1 *

The Required Exterior Square Footing size is:

Type C N.A. sq.ft.

Type E or I 1.0 ft. MIN.
(width)

50. The Required Interior Footing area is: 2.1 sq.ft.
(Also exterior piers for foundation type E)
- 51a. The Required Continuous Marriage Wall Footing area is: 6.9 sq.ft.
- 51b. The Required Footing area under posts at the ends of marriage wall opening(s) is: 11.4 sq.ft.

Vertical Anchorage Requirements in the Transverse Direction (602-4)

- 52a. Using the Foundation Design Load Tables (Appendix B, Part 2), determine the Required Vertical Anchorage. Exterior Av 130 *
(lbs./pier spacing;
lbs./ft for E type;
lbs./tie-down spacing)
- 52b. Number of vertical tie-down locations for multi-section units: 2 or 4 or 6
- 52c. For units with additional vertical anchorage at the interior piers, determine the Required Vertical Anchorage. Interior Av N.A. *
(lbs./int pier spacing)
53. What is the manufacturer-supplied value? (#16b, Mfg. WkSht.) Exterior 200 * lbs/ft
Interior N.A. *
54. Is this value (#53) greater than the value given in #52a? (If yes, continue. If no, return to owner for clarification.) yes no

Horizontal Anchorage Requirements In The Transverse Direction (602-5)

- 55a. What number of transverse foundation walls was selected? (602-5.E) (If vertical X-bracing planes are used, complete items #55a, #56 and #57 for 2 transverse walls, and then skip to item #59.)
- 55b. Are diagonal ties used to complete the top of the transverse short wall for horizontal anchorage? (602-5.G.1)
- Estimate height (h) for appropriate illustration in Figure 6-10.

trial 1	trial 2	trial 3
<u>2</u>	<u>4</u>	6
yes <u>no</u>	yes <u>no</u>	yes no
N.A.		

ft.

56. Using the tables, find the Required Horizontal Anchorage (Ah). (Appendix B; Part 3)

End Wall Ah

trial 1	trial 2	trial 3
420	140	

lbs./ft.

Int Wall Ah

-	280	
---	-----	--

lbs./ft.

57a. What is the manufacturer's-supplied rated capacity for sliding? (#16c, Mfg. WkSht.)

400	400	
-----	-----	--

lbs./ft.

57b. If answer to item #55b is yes, record manufacturer or product supplier rated strap tension capacity

N.A.	N.A.	
------	------	--

lbs./strap

58a. Is value #57a greater than item #56?
If yes, continue. If no, return to section 602-4.C and to question #55a and select a larger number of transverse foundation walls. If the maximum number selected (6) does not work, return to owner (who may wish to contact the manufacturer for clarification).

yes <input type="radio"/> no	<input checked="" type="radio"/> yes no	yes no
---------------------------------	--	-----------

58b. If answer to #55b is yes, required tension in diagonal (T_i). (Complete procedure in Section 602.5.G.1.)

	N.A.	
--	------	--

lbs.

58c. Is value #57b greater than #58b?
If yes, continue to item #62. If no, return to owner for product with greater capacity.

yes no	yes no	yes no
-----------	-----------	-----------

59. If using vertical X-bracing planes in lieu of transverse short walls (and the formulas in section 602-5.G.2), determine anchorage values and sizes for diagonal members. (If shear walls are selected in item #55, skip to item #62.)

a. Vertical X-bracing spacing proposed.

trial 1	trial 2	trial 3
N.A.	N.A.	

ft. *

b. Number of vertical X-bracing locations proposed. (Item #13, Mfg. WkSht. for trial 1.)

--	--	--

*

- c. Required horizontal anchorage (C) value, based on formula. (602-5.G.2.c)
 - d. Estimated height (h) in Figure 6-10.
 - e. Tension (T_i) required. (602-5.G.2.d)
60. What is the manufacturer-supplied rated strap tension capacity? (#16, Mfg. WkSht.) (or capacity defined by literature supplied by product supplier)
- 61a. Is value #57 greater than value #59c?
If yes, continue. If no, return to Section 602-5.G and to question #59 and select a greater number of X-brace locations as a next trial. Repeat until answer is yes, then continue.
 - 61b. Is value #60 greater than value #59e?
If yes, continue. If no, return to section 602-5.G and to question #59 and select a greater number of X-bracing locations. If the maximum number selected does not work, return to owner (who may wish to contact the manufacturer for clarification or product supplier for clarification).

trial 1	trial 2	trial 3	
			lbs./ x-brace set
			ft.
			lbs./diag.
			lbs. *
yes no	yes no	yes no	
yes no	yes no	yes no	

Horizontal Anchorage Requirements In The Longitudinal Direction (602-6)

- 62a. Using the tables, find the required horizontal anchorage (Ah) in the longitudinal direction. (Appendix B, Part 4) (602.6.E)
- 62b. If using vertical X-bracing planes (and the formulas in section 602-6.F) determine anchorage value for X-bracing planes. (If using exterior long walls, skip to item #63.)

Exterior Wall Ah 67 lbs./ft.

- 1. Number of chassis beam lines used for vertical X-bracing planes.


trial 1	trial 2	trial 3
2 or 4	2 or 4	2 or 4

	trial 1	trial 2	trial 3	
Number of X-bracing planes proposed under each chassis beam along the length of the unit.				
2. Horizontal anchorage (B) required force, based on formula.				lbs.
3. Assumed height (h-b) based on Figure 6-11.				ft.
4. Tension (T_L) based on formula. (602-6.F.(3)).				lbs.
63. What is the manufacturer-supplied value for horizontal anchorage? (#16d, Mfg. WkSht.)	400			lbs./ft.
64a. For shear walls: is value #63 greater than #62a? If yes, skip to item #67. If no, contact owner for clarification.	yes no	yes no	yes no	
64b. For X-bracing: is value #63 greater than value #62b.2? If yes, return to item #62b.3. If no, increase number of vertical X-bracing planes and repeat items 62b.1 and 62b.2 until answer is yes. For multi-section units consider 4 lines of vertical X-bracing under all chassis beams.	yes no	yes no	yes no	
65. What is the manufacturer-supplied rated strap tension? (#16e, Mfg. WkSht. or product supplier)				lbs.
66. Is value #65 greater than #62b.4? If yes, continue. If no, contact owner to obtain straps with greater capacity, or return to item #62b.1 and increase the number of vertical X-bracing planes until answer is yes.	yes no	yes no	yes no	

APPENDIX C

Withdrawal Resistance Verification (603-2.B)

67. Using Appendix C, Table C-1 or C-2, verify that the foundation system will resist withdrawal. Answer question #67a for type E. Answer question #67b for types C, I, or type E with interior pier anchorage.

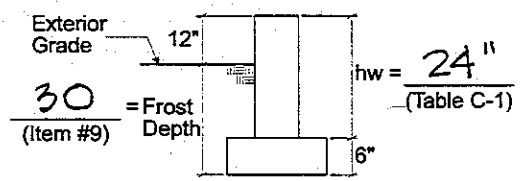

- a. **Withdrawal Resistance for long foundation wall.** (Type E)
 Circle the type of material that is to be used.

Reinforced Concrete
Masonry-Fully Grouted
 Masonry-Grouted @ 48" o.c.
 All-Weather Wood / Footing

- 1) Using Table C-1, which capacity is greater than required A_v ? (603-2.B.(1)) (#52a)

231 lbs./ft.

- 2) Using Table C-1, what is the height of the wall + footing for required withdrawal resistance? ($h_w + 6''$)

30 in.

- 3) What is the height of the wall + footing for frost protection? (frost depth (#9) + 12'')

42 in.

- 4) What is the greatest height #67a.2 or #67a.3?

42 in.

Circle the height which controls.

Withdrawal
Frost Depth

- 5) Record the bottom of footing depth from grade. (Item #67a.4 - 12'')

30 in.

- 6) Using Table C-1, what is the required width of the wall footing for withdrawal?

12'' in.


- 7) Is item #67a.6 greater than or equal to item #49?
 If yes, continue. If no, change footing width to item #49.

yes no

- 8) Record design exterior wall footing width.

12'' in.

- b. **Withdrawal Resistance for Piers.** (Types C, C1 (concrete dead-man), I or type E with interior pier anchorage - multi-section units.)

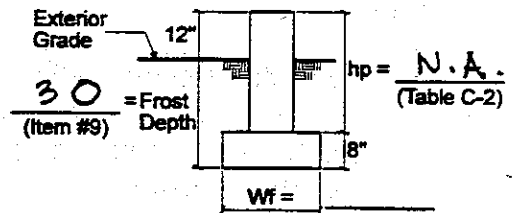

Circle pier type:

Reinforced Concrete
 Reinforced Masonry - fully grouted
 Reinforced Concrete Dead-man

- | | Exterior | Interior
(when used) |
|---|-----------------------------------|--|
| 1) Using Table C-2, which capacity is greater than required A_v ? (#52a and #52c) (603-2.B.(2)) | N.A. | _____ lbs./pier * |
| 2) Using Table C-2, what is the height of the pier + footing for required withdrawal resistance? (hp + 8") | N.A. | _____ in. * |
| 3) What is the required height of pier + footing for frost protection? (frost depth (#9) + 12")
N.A. | min. 18 | min. 18 in.
<i>below top @ undisturbed soil</i> |
| 4) What is the greatest height #67b.2 or #67b.3?

Circle the height which controls. | Withdrawal Frost Depth | Withdrawal Frost Depth |
| 5) Record the bottom of footing depth from grade. (Item #67b.4 - 12") | min. 18 | min. 18 in. |
| 6) Using Table C-2, what is the required width of the square footing if withdrawal resistance controls or if frost depth controls? | N.A. | _____ in. * |
| c. Frost depth for marriage walls. What is the required depth of footing below grade for frost protection? (frost depth (#9)) (no withdrawal resistance) | | min. 18 in.
<i>below top soil @ undist soil level</i> |

Vertical Anchorage and Reinforcement for Longitudinal Foundation Walls and Piers (603-2.D)

68. Using Appendix C, Table C-3, C-4A or C-4B, verify that the foundation anchors will resist uplift. Answer question #68a for type E. Answer question #68b for types C, I, or type E with interior pier anchorage.

a. **Vertical Anchor Capacity for longitudinal foundation wall (type E).** (603-2.D.2)

- 1) Using Table C-4A (concrete & masonry), which capacity is greater than the required A_v ? (#52a, Design Wksht.)
If treated wood wall, skip to item #68a.3.

146
lbs./lineal ft. of wall

Circle correct washer choice for the capacity selected

Standard Washer
Oversized Washer

2) Using Table C-4A (masonry and concrete):

a) Required anchor bolt diameter

1/2" φ in.

b) Required anchor bolt spacing

72 in.
max. allow.

c) Using Table C-3A:

(1) Rebar size

4 *

(2) Lap splice

16 in.

(3) Rebar hook length

6 in.

3) Using Table C-4B (wood), which capacity is greater than the required A_v ? (#52a, Design Wksht.)

N.A.

If using concrete or masonry wall, skip to item #68b.

lbs./lineal ft. of wall

4) Using Table C-4B (wood):

a) Required nailing

_____ *

b) Minimum plywood thickness

_____ in.

c) Required anchor bolt diameter

_____ in.

d) Required anchor bolt spacing

_____ in.

b. *Vertical Anchor Capacity for Piers*

(Types C, I, or type E with interior pier anchorage)

(603-2.D.1)

Exterior

Interior

(when used for anchorage in multi-section units)

1) Using Table C-3, which capacity in the table is greater than the required A_v ?

N.A.

(From #52a, Design Wksht.)

_____ lbs./pier

	<u>Exterior</u>	<u>Interior</u>
2) Using Table C-3:		
a) Number of anchor bolts	1 or 2	1 or 2
b) Anchor diameter	1/2" or 5/8"	1/2" or 5/8"
3) Using Table C-3A:		
a) Rebar size	#4 or #5	#4 or #5
b) Lap splice	_____	_____ in.
c) Rebar hook length	_____	_____ in.

Horizontal Anchorage and Reinforcement for Transverse Foundation Walls (603-3)

69. Using Appendix C, Table C-5A or C-5B, verify that the foundation anchorage will resist sliding at the transverse end foundation walls. Use for types C, E, or I.

	<u>End Wall</u>	<u>Interior Wall</u>
a. <i>For continuous foundations.</i>		
Using Table C-5A (concrete & masonry) or C-5B (wood), which capacity is greater than the required (Ah) (603-3) (item #56)?	140	280
	<u>300</u>	<u>300</u> lbs./ft.
1) Using Table C-5A, find:		
a) Required anchor bolt diameter	<u>1/2 φ</u>	<u>1/2 φ</u> in.
b) Required anchor bolt spacing	<u>72</u>	<u>72</u> in.
	max allow.	
c) Using Table C-3A:		
(1) Rebar size	<u>#4</u>	<u>#4</u> *
(2) Lap splice	<u>16</u>	<u>16</u> in.
(3) Rebar hook length	<u>6</u>	<u>6</u> in.
2) Using Table C-5B, find:		
a) Required nailing	_____	_____ *

	<u>End Wall</u>	<u>Interior Wall</u>	
b) Minimum plywood thickness	_____	_____	in.
c) Required anchor bolt diameter	_____	_____	in.
d) Required anchor bolt spacing	_____	_____	in.

b. *For transverse short foundation walls completed with diagonal braces.*
(603-5)

Using Appendix C, Table C-5A, verify the diagonal anchorage capacity to the short foundation wall.

	<u>End</u>	<u>Interior</u>	
1) Record the required horizontal force ($A_h \times W_t$) from 602-5.G.1.a and item #56.	<u>N.A.</u>	_____	lbs.
2) Table C-5A capacity for one 1/2" diameter bolt at 12" o.c.	<u>1800</u>	<u>1800</u>	lbs.
3) Number of bolts ($A_h \times W_t \div 1800$; one minimum) at concrete or masonry top of short wall.	_____	_____	*
4) Size of anchor bolts	_____	_____	in.
5) Using Table C-3A:			
a) Rebar size	_____	_____	*
b) Lap splice	_____	_____	in.
c) Rebar hook length	_____	_____	in.

c. *For vertical X-bracing planes in the transverse direction.*
(603-6)

Using Appendix C, Table C-5A, verify the diagonal anchorage to the pier footings and the tension capacity of the diagonals.

1) Record the required horizontal force (C) from item #59c.	<u>N.A.</u>	lbs.
2) Table C-5A capacity for one 1/2" diameter bolt at 12" o.c.	<u>1800</u>	lbs.

	<u>End Wall</u>	<u>Interior Wall</u>	
Anchor bolt spacing	<u>72</u>	<u>72</u>	in.
Rebar size	<u># 4</u>	<u># 4</u>	
Lap splice	<u>16</u>	<u>16</u>	in.
Rebar hook length	<u>6</u>	<u>6</u>	in.
<u>From #69a.2: wood:</u>			
Required nailing	<u>-</u>	<u> </u>	
Minimum plywood nailer	<u> </u>	<u> </u>	
Anchor bolt diameter	<u> </u>	<u> </u>	
Anchor bolt spacing	<u> </u>	<u> </u>	in.

2. *For transverse short foundation walls completed with diagonal braces (#69b)*

	<u>End</u>	<u>Interior</u>	
Number of pairs of diagonals (1 for single-section units, 2 for multi-section units) times number of short walls (end or interior) (#55a)	<u>-</u>	<u> </u>	
Diagonal spacing (same as number of short walls)	<u> </u>	<u> </u>	
<u>From #69b: concrete / masonry:</u>			
Anchor bolt diameter	<u>-</u>	<u> </u>	in.
Number of bolts	<u> </u>	<u> </u>	
Rebar size	<u> </u>	<u> </u>	
Lap splice	<u> </u>	<u> </u>	in.
Rebar hook length	<u> </u>	<u> </u>	in.

3. *For vertical X-bracing planes in lieu of short walls. (#69c)*

Number of X-brace locations (#59)	<u> </u>
-----------------------------------	-----------------------------

Spacing of vertical X-brace planes (#59) _____ ft.

Items from #69c.3 and #69c.5

Required anchor bolt diameter _____ in.

Number of bolts at top of footing to connect diagonal _____

Diagonal strap size _____

Connection to top flange of chassis beam (describe) _____

c. Horizontal anchorage in the longitudinal direction - exterior foundation walls

1. *Continuous foundation walls*

Reinforcing for longitudinal foundation walls: record only if larger sizes or closer spacing than recorded for vertical anchorage (#71a.2).

From #70a.1: concrete / masonry:

Anchor bolt diameter _____ in.

Anchor bolt spacing _____ in.

Rebar size _____

Lap splice _____ in.

Rebar hook length _____ in.

From #70a.2: wood: record only if larger sizes or closer spacings than recorded for vertical anchorage (#71a.2)

Required nailing _____

Minimum plywood nailer _____

Anchor bolt diameter _____

Anchor bolt spacing _____ in.



2. *Vertical X-bracing planes under chassis beam lines*
(#70b.)

Number of X-brace locations along one chassis beam line.

N. A.

Spacing of X-brace locations along one chassis beam line.

_____ ft.

Required anchor bolt diameter.

_____ in.

Number of bolts at top of footing at connection to the diagonal.

Diagonal strap size.

Connection to bottom flange of chassis beam (describe).

72. Do foundation dimensions and details comply with Foundation Capacities Table, based on Foundation Design Table Values?

yes no

73. If #72 yes, approve. If no, return to applicant.

APPROVE

DISAPPROVE

APPENDIX E OWNER'S SITE ACCEPTABILITY WORKSHEET

Owner's Name: JOHN SMITH

Address: 35 BRANDYWINE
TAMPA, FL

Telephone: _____

Site Location: _____

Legal Description: _____

Have you provided a copy of a map pinpointing the site?

yes no

Have you submitted a foundation plan?
(See #10 of Manufacture's Worksheet)

yes no

Preliminary Site Information

Before approval of the site can begin, the applicant must provide preliminary site information to the field office. Refer to Chapter 2, "Site Acceptability Criteria" for clarification.

1. Provide survey results showing existing grade elevation. (201-1) 28 ft.
2. Is the building in a flood-prone area? (201-2) yes no
If the answer to 2 is Yes, answer 3, 4, & 5.
If the answer to 2 is No, answer 6, below.

3. What is the Base Flood Elevation? _____ ft.

What is the Flood Protection Elevation? _____ ft.

4. Has approval for drainage, grading and berming been approved for flood-prone sites? yes no

5. Have permits been provided? yes no
(Permits must be obtained for any alteration of the building site in a flood protection area.)

6. Provide geotechnical report in areas of known high water table. (201-4) yes no

7. Provide geotechnical report if adverse site conditions are found or suspected. (203) yes no

8. Provide site-drainage plan complying with CABO R301.3 or local requirements. (301) yes no

9. Provide fill specifications if site is to be prepared with earth fill. (303-2) yes no

10. If a geotechnical report is required, what is the net allowable soil bearing pressure? (202) _____ psf.

11. If no adverse soil conditions are known or suspected, and if the home is individually sited, assume a soil bearing pressure of 1,000 psf. and use this value when a determination of soil bearing pressure is called for. 1,000 psf.

APPENDIX E MANUFACTURER'S WORKSHEET

Manufacturer's
 Company Name: NEW HOMES
 Address: 39 PEACHTREE LANE
ATLANTA, GA
 Telephone: 219 / 333 - 1792

Determination of Building Structure and Size

The manufacturer shall provide the following information:

- | | <div style="border: 1px solid black; border-radius: 50%; padding: 2px; display: inline-block;">Single-Section</div>
Multi-Section |
|--|--|
| 1. Type of unit | <u>C</u> |
| 2. Method, location and types of support:
Refer to Figures 6-7 and 6-8 and Section 601-4
Is the home a C, E, or I? | <u>C</u> |
| 3. Length of unit L | <u>56</u> ft. |
| 4. Actual width of unit Wt | <u>13'-8</u> ft. |
| 5. Height of exterior wall ** | <u>7'-6</u> ft. |
| 6. Height of roof peak ** | <u>2'-4</u> ft. |
| 7. Roof slope ** | <u>4 :: 12</u> |
| 8. Self weight of total unit (W) including mechanical equipment ** | <u>16,500</u> lbs. |
| 9. Distance between chassis members | <u>6'-10</u> ft. |
| 10. One foundation design concept (See Appendix A)
(C1-C4; E1-E8; or I) | <u>C1</u> |

11. Recommended pier spacing **

a. Exterior

7 ft.

b. Interior

- ft.

c. Continuous Marriage Wall

- ft.

Length of largest isolated marriage wall opening or average of largest two adjacent openings

- ft.

d. Tie-down Strap (C1 concept only)

7
(Number)

8'-8" ft.
(Spacing)

12. One installation method recommendations (include documentation showing connection details pertinent to geographic area for seismic or wind). **

yes no

13. Interior shear wall locations (include documentation showing locations). **

yes no

14. Design wind speed used in designing connection details for horizontal anchorage (Ah) and vertical anchorage (Av) in the transverse direction. **

120 mph.

15. Seismic acceleration values used in designing connection details for horizontal anchorage (Ah) in the transverse and longitudinal directions. **

Av 0.05

Aa 0.05

16. Shear wall connection details with rated capacity for wind and seismic are provided. ** †

yes no

a. Connection locations at foundation end and interior walls shown? **

yes no

b. Rated connection capacity for uplift and overturning **

3150 lbs./ft.
(or lbs./tie-down)

c. Rated connection capacity for sliding in transverse direction **

4800 lbs./ft.
(or lbs./diag. strap)

d. Rated connection capacity for sliding in longitudinal direction **

4800 lbs./ft.

e. Vertical X-bracing tension strap capacity **


5600
lbs./diag. strap

f. Engineering calculation by licensed structural engineer? **

yes no

**** Optional values:** It is optional for the manufacturer to provide these values. If the manufacturer does not provide the values, it is the responsibility of the owner to supply values, based on engineering analysis by a licensed structural engineer.

† Item 16 is provided in California.



APPENDIX F DESIGN WORKSHEET

Owner's Name: JOHN SMITH
Address: 35 BRANDYWINE, TAMPA, FL
Builder's Name: GRAPPO INDUSTRIES
Site Location: TAMPA, FL.

PART 1: SITE CONDITIONS (Accompanies Chapter 2)

1. Has the Manufacturer's Worksheet been provided? yes no

Existing Grade Elevation (201-1)

2. Does the site require a survey?
(Answer yes if: 1) elev. to be altered by grade or fill; 2) site near flood zone; 3) subdivision. Answer no if individually-sited with no alteration of building site.) yes no

3. If yes to above, what is the surveyed existing grade elevation? 28 ft.

Flood Protection Elevation (201-2)

4. Is the building site in a flood zone?
(If yes to 4, then answer 5, 6, 7 & 8. If no, skip to 9.) yes no

5. What is the Base Flood Elevation or the Flood Protection Elevation (use highest value)? — ft.

6. Is the site to be graded, filled, or bermed?
(If no, skip to 9.) yes no

7. If yes to 6, have all permits been provided? yes no

8. If no to 6, then are the buildings to be built on elevated foundations?
(If yes, this handbook cannot be used. Refer to FEMA Manual.) yes no

Frost Penetration Depth (201-3)

9. What is the maximum frost penetration depth?
(see Appendix H, page H-4) 0 in.
- 10a. Does foundation plan show base of footing extending below frost penetration depth?
(If yes proceed; if no, applicant should revise plans.) yes no
- 10b. Does foundation plan show base of footing extending below top-soil layer (min. 12") to undisturbed soil? yes no

Ground Water Table Elevation (201-4)

11. For subdivisions, does a Geotechnical Engineer recommend drainage of subsurface water?
(If no, skip to 13.) yes no
12. Has groundwater drainage plan been provided? yes no

Soil Conditions (202, 203)

13. If any of the following adverse site conditions are discovered, specific recommendations by a Geotechnical Engineer will be required (applies to subdivisions and individually-sited homes.)
- Organic soil (8" topsoil layer) yes no
- Expansive (shrink-swell) soil yes no
- Sloping site yes no
- Subsidence yes no
- (Applicant may be referred to Geotechnical Engineer if any of the above are yes. If no, to all of above, move to next step.)

14. Is area in a known termite infestation area? yes no
- Region classification? VERY HEAVY
(See Appendix H, Termite Infestation Map, page H-10) (If no, skip to 16.)

15. Has applicant complied with CABO R-308 or local ordinance for construction procedures and treatment?
(If yes, continue; if no, refer applicant to CABO requirements.) yes no

PART 2: SITE PREPARATION

(Accompanies Chapter 3)

16. Acceptable surface drainage plan provided? (301)
(If no, one must be provided for subdivision) yes no
17. Grading plan provided? (302) yes no
18. Fill specifications conforming to those cited in HUD Land Planning Data Sheet (79g)? (303)
(If fill is used, below the home's foundation, a report by Geotech. Eng. should be submitted to provide fill specifications.)
yes no
19. Finish grade elevation? (304)
(Check answers to Part 1: #4 & #5. The finish grade elevation must be higher than #5 if in flood zone.) 28' *

PART 3: DESIGN LOADS

(Accompanies Chapter 4)

Information from Manufacturer's Worksheet

20. Has all the information been provided on the Manufacturer's Worksheet? (Appendix E) yes no
21. What is the building self weight (W)?
(Mfg. Wksht. #8) 16,500 lbs.
22. What is the building length (L)?
(Mfg. Wksht. #3) 56 ft.
23. What is the distributed weight per foot of unit length? ($w=W/L$)
(402-1.B, C) 295 lbs./ft.
24. What is the building type?
(Mfg. WkSht. #2) Single-Section
 Multi-Section
C, E, or I
- Foundation design concept?
 (C1), C2, C3, C4, E1, E3, E4, E5, E6, E7, E8, I) C1 *

Dead Load (402-1)

25. What is the light dead load value from Table 4-1?
(402-1.A.1)

290 *
(lbs./ft.)

26. What is the heavy dead load value from Table 4-1?
(402-1.A.2)

425 *
(lbs./ft.)

27. Does the answer from Question #23 fall within the values in #25 and #26? (402-1.D)
(If the answer is yes, continue. If no, the foundation is not within the limits of this document and must be redesigned by a structural engineer.)

yes no

Snow Load (402-2) / Minimum Roof Live Load (402-2.C)

28a. What is average annual ground snowfall (Pg)?
(See Ground Snow Load map, pages H-11, H-12 and H-13.)

0 *
(lbs./sq.ft.)

28b. What is 0.7 multiplied by Pg?

0 psf.

29a. What is the roof slope? (Mfg. Wksht. #7)

4:12

29b. What is the minimum roof live load for the roof slope?
(D-200.2.B)

15 psf.

30. Record the larger magnitude of item 28b or item 29b. Use this magnitude for roof load where required.

15 psf.

Wind Load (402-3)

31a. What is the basic wind speed (V)?
(See Wind Speed map, page H-14.)

100 mph.

31b. If V is less than 80 mph, record MPS min. 80 mph for wind design. (402-3.A)

100 mph.

32. Is the site inland or coastal? (402-3.B)
(If inland, skip to question #38.)

Inland
 Coastal

33. If a coastal area, has the manufacturer provided connection details? (402-3.D) (Mfg. Wksht. #12)

yes no

34. If yes to #33, what design wind speed has the manufacturer used in designing connection details?
(Mfg. Wksht. #14) 120 mph. *
35. Are the connection locations shown? (Mfg. Wksht. #16a) yes no
36. Are connection details provided for foundation shear walls?
(For an answer of yes, all questions under Mfg. Wksht #16 must be answered satisfactorily.) yes no
37. Is the value for Question 34 equal to or greater than the number given in Question 31?
(If yes, proceed. If no, return design to manufacturer for clarification.) yes no

Seismic Load

- 38a. What are the seismic acceleration values?
(See Seismic maps, pages H-15 and H-16) Aa 0.05 *
Av 0.05 *
- 38b. Is $A_v < 0.15$?
(if no, proceed. If yes, seismic need not be considered, skip questions 39 to 41.) yes no
39. Seismic performance category.
(See H-300 for Special Requirements of Foundation Design.) N.A.
40. What is the applicant's proposed design concept?
(Design Wksht. #24) C1 *
41. Do the Foundation Design Concept Tables approve the foundation system for use in seismic areas of Question #38 above? (See Appendix A)
(If yes, proceed. If no, return to applicant for foundation design choice more suited to high seismic areas.) yes no

PART 4-FINAL DESIGN PROCEDURE (Accompanies Chapter 6)

42. What is the actual building width?
(Mfg. Wksht. #4) 13'-8 ft.

43. The nominal building width to be used in the Foundation Design Tables, (Aftg, Av & Ah) is Wt: (600-2.A and Figure 6-1)

14'-0 ft.

44. Where are the foundation supports located? Check drawings submitted by the owner and Foundation Design Concepts in Appendix A. Circle the support locations shown on the Manufacturer's foundation concept plan.

Chassis Beams
Exterior Walls
Marriage Wall

45. Do these locations match the Foundation Concept shown in Appendix A? Do the locations match Question #24 on the Design Worksheet? (If yes, proceed. If no, return to Owner for clarification.)

yes no

46. Is Vertical Anchorage present? (601-2.B, 601-3.B & 601-4.B (Figures 6-7 & 6-8); Mfg. Wksht. #12 & #16)

yes no

APPENDIX A

47. What is the basic system type? (From Part 3: #24; Mfg. Wksht. #2)

C1 *

48. What is the spacing between piers? (Mfg. Wksht. #11) (602-2)

Exterior: 4' 5' 6' 7' 8'

Interior: 4' 5' 6' 7' 8' N.A.

Continuous Marriage Wall: 4' 5' 6' 7' 8' N.A.

Largest or Average Marriage Wall Opening: N.A. ft.

Tie Down (C1) 8'-8 ft.

APPENDIX B

Required Footing Size

49. The required Exterior Wall Footing, for the foundation type, is found in the Required Effective Footing Area table in App. B, Part 1. (Use maximum value from item #30.)

C1 *

The Required Exterior Square Footing size is:

Type C 5.3 sq.ft.

Type E or I - ft.
(width)

50. The Required Interior Footing area is: _____ sq.ft.
 (Also exterior piers for foundation type E)
- 51a. The Required Continuous Marriage Wall Footing area is: _____ sq.ft.
- 51b. The Required Footing area under posts at the ends of marriage wall opening(s) is: _____ sq.ft.

Vertical Anchorage Requirements in the Transverse Direction (602-4)

- 52a. Using the Foundation Design Load Tables (Appendix B, Part 2), determine the Required Vertical Anchorage. Exterior Av 3033 *
 (lbs./pier spacing;
 lbs./ft for E type;
 lbs./tie-down spacing)
- $350 \text{ LB/FT} \times 8.667' = 3033 \text{ LB}$
- 52b. Number of vertical tie-down locations for multi-section units: 2 or 4 or 6
- 52c. For units with additional vertical anchorage at the interior piers, determine the Required Vertical Anchorage. Interior Av N.A. *
 (lbs./int pier spacing)
53. What is the manufacturer-supplied value? Exterior 3150 *
 (#16b, Mfg. WkSht.) Interior 3150 *
54. Is this value (#53) greater than the value given in #52a? yes no
 (If yes, continue. If no, return to owner for clarification.)

Horizontal Anchorage Requirements In The Transverse Direction (602-5)

- 55a. What number of transverse foundation walls was selected? (602-5.E) (If vertical X-bracing planes are used, complete items #55a, #56 and #57 for 2 transverse walls, and then skip to item #59.)
- 55b. Are diagonal ties used to complete the top of the transverse short wall for horizontal anchorage? (602-5.G.1)

trial 1	trial 2	trial 3
<input checked="" type="radio"/> 2	4	6
yes <input checked="" type="radio"/> no	yes no	yes no
N.A.		

Estimate height (h) for appropriate illustration in Figure 6-10. _____ ft.

56. Using the tables, find the Required Horizontal Anchorage (Ah). (Appendix B; Part 3)

End Wall Ah

trial 1	trial 2	trial 3
1240		

lbs./ft.

Int Wall Ah

N.A.		
------	--	--

lbs./ft.

57a. What is the manufacturer's-supplied rated capacity for sliding? (#16c, Mfg. WkSht.)

4800		
------	--	--

lbs./ft.

57b. If answer to item #55b is yes, record manufacturer or product supplier rated strap tension capacity

--	--	--

lbs./strap

58a. Is value #57a greater than item #56?
If yes, continue. If no, return to section 602-4.C and to question #55a and select a larger number of transverse foundation walls. If the maximum number selected (6) does not work, return to owner (who may wish to contact the manufacturer for clarification).

yes	yes	yes
no	no	no

58b. If answer to #55b is yes, required tension in diagonal (T₁). (Complete procedure in Section 602.5.G.1.)

--	--	--

lbs.

58c. Is value #57b greater than #58b?
If yes, continue to item #62. If no, return to owner for product with greater capacity.

yes	yes	yes
no	no	no

59. If using vertical X-bracing planes in lieu of transverse short walls (and the formulas in section 602-5.G.2), determine anchorage values and sizes for diagonal members. (If shear walls are selected in item #55, skip to item #62.)

a. Vertical X-bracing spacing proposed.

trial 1	trial 2	trial 3
14	7'	

ft. *

b. Number of vertical X-bracing locations proposed. (Item #13, Mfg. WkSht. for trial 1.)

5	9	
---	---	--

*

c. Required horizontal anchorage (C) value, based on formula. (602-5.G.2.c)

d. Estimated height (h) in Figure 6-10.

e. Tension (T_t) required. (602-5.G.2.d)

60. What is the manufacturer-supplied rated strap tension capacity? (#16, Mfg. WkSht.) (or capacity defined by literature supplied by product supplier)

61a. Is value #57 greater than value #59c?
If yes, continue. If no, return to Section 602-5.G and to question #59 and select a greater number of X-brace locations as a next trial. Repeat until answer is yes, then continue.

61b. Is value #60 greater than value #59e?
If yes, continue. If no, return to section 602-5.G and to question #59 and select a greater number of X-bracing locations. If the maximum number selected does not work, return to owner (who may wish to contact the manufacturer for clarification or product supplier for clarification).

trial 1	trial 2	trial 3	
8475	4235		lbs./x-brace set
	4		ft.
	4907		lbs./diag.
	5600		lbs. *
yes <input checked="" type="radio"/> no	<input checked="" type="radio"/> yes no	yes no	
yes no	<input checked="" type="radio"/> yes no	yes no	

Horizontal Anchorage Requirements In The Longitudinal Direction (602-6)

62a. Using the tables, find the required horizontal anchorage (Ah) in the longitudinal direction. (Appendix B, Part 4) (602.6.E)

Exterior Wall Ah 47 lbs./ft.

62b. If using vertical X-bracing planes (and the formulas in section 602-6.F) determine anchorage value for X-bracing planes. (If using exterior long walls, skip to item #63.)

1. Number of chassis beam lines used for vertical X-bracing planes.

trial 1	trial 2	trial 3
<input checked="" type="radio"/> 2 or 4	2 or 4	2 or 4


- Number of X-bracing planes proposed under each chassis beam along the length of the unit.
2. Horizontal anchorage (B) required force, based on formula.
 3. Assumed height (h-b) based on Figure 6-11.
 4. Tension (T_L) based on formula. (602-6.F.(3)).
63. What is the manufacturer-supplied value for horizontal anchorage? (#16d, Mfg. WkSht.)
- 64a. For shear walls: is value #63 greater than #62a?
If yes, skip to item #67. If no, contact owner for clarification.
- 64b. For X-bracing: is value #63 greater than value #62b.2?
If yes, return to item #62b.3. If no, increase number of vertical X-bracing planes and repeat items 62b.1 and 62b.2 until answer is yes. For multi-section units consider 4 lines of vertical X-bracing under all chassis beams.
65. What is the manufacturer-supplied rated strap tension? (#16e, Mfg. WkSht. or product supplier)
66. Is value #65 greater than #62b.4?
If yes, continue. If no, contact owner to obtain straps with greater capacity, or return to item #62b.1 and increase the number of vertical X-bracing planes until answer is yes.

trial 1	trial 2	trial 3	
2			
1316			lbs.
3'			ft.
1432			lbs.
4800			lbs./ft.
yes no	yes no	yes no	N.A.
<u>yes</u> no	yes no	yes no	
5600			lbs.
<u>yes</u> no	yes no	yes no	

APPENDIX C

Withdrawal Resistance Verification (603-2.B)

67. Using Appendix C, Table C-1 or C-2, verify that the foundation system will resist withdrawal. Answer question #67a for type E. Answer question #67b for types C, I, or type E with interior pier anchorage.

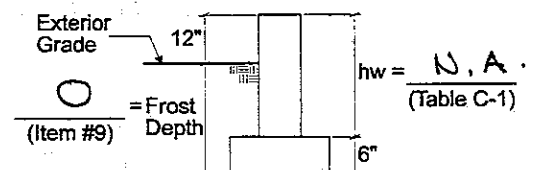

a. **Withdrawal Resistance for long foundation wall.** (Type E)

Circle the type of material that is to be used.

Reinforced Concrete
 Masonry-Fully Grouted
 Masonry-Grouted @ 48" o.c.
 All-Weather Wood / Footing


- 1) Using Table C-1, which capacity is greater than required A_v ? (603-2.B.(1)) (#52a) _____ lbs./ft.
- 2) Using Table C-1, what is the height of the wall + footing for required withdrawal resistance? ($h_w + 6"$) _____ in.
- 3) What is the height of the wall + footing for frost protection? (frost depth (#9) + 12") _____ in.
- 4) What is the greatest height #67a.2 or #67a.3? _____ in.

Circle the height which controls.

Withdrawal
 Frost Depth

- 5) Record the bottom of footing depth from grade. (Item #67a.4 - 12") _____ in.
- 6) Using Table C-1, what is the required width of the wall footing for withdrawal? _____ in.
- 7) Is item #67a.6 greater than or equal to item #49?
 If yes, continue. If no, change footing width to item #49. yes no
- 8) Record design exterior wall footing width. _____ in.

b. **Withdrawal Resistance for Piers.** (Types C, **C1**)
 (concrete dead-man), I or type E with interior pier anchorage - multi-section units.)

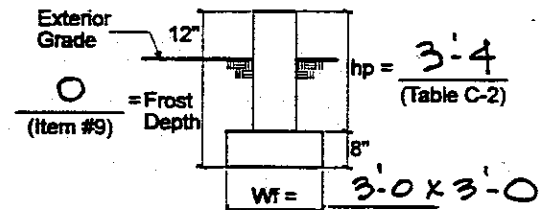

Circle pier type:

Reinforced Concrete
 Reinforced Masonry - fully grouted
Reinforced Concrete Dead-man

	<u>Exterior</u>	<u>Interior</u> (when used)	
1) Using Table C-2, which capacity is greater than required Av? (#52a and #52c) (603-2.B.(2))	<u>3540</u>	_____	lbs./pier *
2) Using Table C-2, what is the height of the pier + footing for required withdrawal resistance? (hp + 8")	<u>48"</u>	_____	in. *
3) What is the required height of pier + footing for frost protection? (frost depth (#9) + 12")	<u>12</u>	_____	in.
4) What is the greatest height #67b.2 or #67b.3?	<u>48</u>	_____	in.
Circle the height which controls.			
	<u>Withdrawal</u> Frost Depth	Withdrawal Frost Depth	
5) Record the bottom of footing depth from grade. (Item #67b.4 - 12")	<u>36</u>	_____	in.
6) Using Table C-2, what is the required width of the square footing if withdrawal resistance controls or if frost depth controls?	<u>36"</u>	_____	in. *
c. <i>Frost depth for marriage walls.</i> What is the required depth of footing below grade for frost protection? (frost depth (#9)) (no withdrawal resistance)		<u>N.A.</u>	in.

Vertical Anchorage and Reinforcement for Longitudinal Foundation Walls and Piers (603-2.D)

68. Using Appendix C, Table C-3, C-4A or C-4B, verify that the foundation anchors will resist uplift. Answer question #68a for type E. Answer question #68b for types C, I, or type E with interior pier anchorage.

a. *Vertical Anchor Capacity for longitudinal foundation wall (type E).* (603-2.D.2)

1) Using Table C-4A (concrete & masonry), which capacity is greater than the required Av? (#52a, Design Wksht.)
If treated wood wall, skip to item #68a.3.

N.A.
lbs./lineal ft. of wall

Circle correct washer choice for the capacity selected

Standard Washer
Oversized Washer

2) Using Table C-4A (masonry and concrete):

a) Required anchor bolt diameter

_____ in.

b) Required anchor bolt spacing

_____ in.

c) Using Table C-3A:

(1) Rebar size

_____ *

(2) Lap splice

_____ in.

(3) Rebar hook length

_____ in.

3) Using Table C-4B (wood), which capacity is greater than the required A_v ? (#52a, Design Wksht.)

If using concrete or masonry wall, skip to item #68b.

_____ lbs./lineal ft. of wall

4) Using Table C-4B (wood):

a) Required nailing

_____ *

b) Minimum plywood thickness

_____ in.

c) Required anchor bolt diameter

_____ in.

d) Required anchor bolt spacing

_____ in.

b. **Vertical Anchor Capacity for Piers**

(Types C, I, or type E with interior pier anchorage)

(603-2.D.1)

Exterior

Interior

(when used for anchorage in multi-section units)

1) Using Table C-3, which capacity in the table is greater than the required A_v ? 3033

(From #52a, Design Wksht.)

4240

_____ lbs./pier

	<u>Exterior</u>	<u>Interior</u>
2) Using Table C-3:		
a) Number of anchor bolts	① or 2	1 or 2
b) Anchor diameter	①/2" or 5/8"	1/2" or 5/8"
3) Using Table C-3A:		
a) Rebar size	④ or #5	#4 or #5
b) Lap splice	<u>16</u>	_____ in.
c) Rebar hook length	<u>6</u>	_____ in.

Horizontal Anchorage and Reinforcement for Transverse Foundation Walls (603-3)

69. Using Appendix C, Table C-5A or C-5B, verify that the foundation anchorage will resist sliding at the transverse end foundation walls. Use for types C, E, or I.

	<u>End Wall</u>	<u>Interior Wall</u>
a. <i>For continuous foundations.</i>		
Using Table C-5A (concrete & masonry) or C-5B (wood), which capacity is greater than the required (Ah) (603-3) (item #56)?	_____	_____ lbs./ft.
1) Using Table C-5A, find:		
a) Required anchor bolt diameter	_____	_____ in.
b) Required anchor bolt spacing	_____	_____ in.
c) Using Table C-3A:		
(1) Rebar size	_____	_____ *
(2) Lap splice	_____	_____ in.
(3) Rebar hook length	_____	_____ in.
2) Using Table C-5B, find:		
a) Required nailing	_____	_____ *

	<u>End Wall</u>	<u>Interior Wall</u>	
b) Minimum plywood thickness	_____	_____	in.
c) Required anchor bolt diameter	_____	_____	in.
d) Required anchor bolt spacing	_____	_____	in.

b. For transverse short foundation walls completed with diagonal braces.
(603-5)

Using Appendix C, Table C-5A, verify the diagonal anchorage capacity to the short foundation wall.

	<u>End</u>	<u>Interior</u>	
1) Record the required horizontal force ($A_h \times W_t$) from 602-5.G.1.a and item #56.	_____	_____	lbs.
2) Table C-5A capacity for one 1/2" diameter bolt at 12" o.c.	<u>1800</u>	<u>1800</u>	lbs.
3) Number of bolts ($A_h \times W_t \div 1800$; one minimum) at concrete or masonry top of short wall.	_____	_____	*
4) Size of anchor bolts	_____	_____	in.
5) Using Table C-3A:			
a) Rebar size	_____	_____	*
b) Lap splice	_____	_____	in.
c) Rebar hook length	_____	_____	in.

c. For vertical X-bracing planes in the transverse direction.
(603-6)

Using Appendix C, Table C-5A, verify the diagonal anchorage to the pier footings and the tension capacity of the diagonals.

1) Record the required horizontal force (C) from item #59c.	<u>4235</u>	lbs.
2) Table C-5A capacity for one 1/2" diameter bolt at 12" o.c.	<u>1800</u>	lbs.

- 3) Number of bolts ($C \div 1800$; one minimum) at top of a footing.
- 4) Record the required tension force (T_t) from item #59e.
- 5) Select tension strap capacity greater than or equal to T_t from owner's product supplier or manufacturer's supplied capacity (item #60).
- 6) Record diagonal strap data

3 *
4907 lbs./diag.

5600 lbs./diag.

A36 plate : $\frac{1}{4}'' \times 1''$

Horizontal Anchorage for Longitudinal Foundation Walls (603-4)

70. Using Appendix C, Table C-5A or C-5B, verify that the foundation horizontal anchorage will resist sliding at the long foundation walls. Use for types C, E and I.

a. For continuous exterior foundation walls.

Using Table C-5A (concrete and masonry) or Table C-5B (wood), which capacity is greater than the required exterior A_h ? (602-6.E) (item #62a)

_____ lbs./ft.

1) Using Table C-5A, find:

a) Required anchor bolt diameter

_____ in.

b) Required anchor bolt spacing

_____ in.

c) Using Table C-3A:

(1) Rebar size

_____ *

(2) Lap splice

_____ in.

(3) Rebar hook length

_____ in.

2) Using Table C-5B, find:

a) Required nailing

_____ *

b) Minimum plywood thickness

_____ in.

c) Required anchor bolt diameter

_____ in.

d) Required anchor bolt spacing

_____ in.

b. *For vertical X-bracing planes.*
(603-6.A.(2))

Using Appendix C, Table C-5A, verify the diagonal anchorage to the pier footings and the tension capacity of the diagonals.

- | | |
|--|-------------------------|
| 1) Record the required horizontal force (B) from item #62b.2. | <u>1316</u> lbs. |
| 2) Table C-5A capacity for one 1/2" diameter bolt at 12" o.c. | <u>1800</u> lbs. |
| 3) Number of bolts (B ÷ 1800; one minimum) | <u>1</u> * |
| 4) Record the required tension force (T _L) from item #62b.4. | <u>1432</u> lbs./diag. |
| 5) Select tension strap capacity greater than or equal to T _L from owner's product supplier or manufacturer's supplied capacity (item #60). | <u>5600</u> lbs./diag. |
| 6) Record diagonal strap data | <u>A36 PL</u> 1/4" x 1" |

SUMMARY SHEET
(Accompanies Chapter 7)

71. Compare values from preceding questions.
Select the largest value.

a. **Bearing area and vertical anchorage**

1. *Pier footings: types C, E & I.*

	Piers				Marriage Wall
	Exterior	Interior	Cont.	At Post	
Required Effective Footing Area from questions #49, #50, & #51.	<u>5.3</u>				sq.ft.
Required footing area to resist withdrawal due to uplift from Question #67. (for single-section or 2 tie-down system, only the exterior piers resist uplift, for 4 tie-down only the interior piers and exterior walls resist uplift)	<u>N.A.</u>				sq.ft.

	Piers				sq.ft.
	Exterior	Interior	Cont.	Marriage Wall At Post	
Pier Footing Sizes (largest of above)	5.3	(2'-4" x 2'-4")			

"Dead-man" footing size. 9.0 sq.ft.

(3'-0" x 3'-0")

Reinforcing for pier footings:

Bring forward answers from previous questions. (#68b)

(Types C, I, or E with interior pier anchorage.)

	Exterior	Interior	
Number of anchor bolts	1		
Anchor bolt diameter	1/2" ϕ		in.
Rebar size	#4		
Lap splice	16		in.
Rebar hook length	6		in.

	Exterior	Interior	Marriage Wall	
Footing depth: grade to bottom of footing	0'-8"			in.

Pier footing and "dead-man" footing reinforcing bars:

#4 at 10" o.c. E.W.

"Dead-man" footing depth: grade to bottom of footing

36 in.

2. *Long Foundation wall footing: type E or I:*

Required Effective Footing Width

Required Footing Width for soil bearing (#49) _____ ft.

Required Footing Width to resist uplift withdrawal (#67a.6) _____ ft.

Wall Footing Size (largest of above) _____ ft.

Footing Depth: Grade to bottom of footing (#67a.5) _____ in.

Footing reinforcing bars.

2 #4 bars

Reinforcing for longitudinal foundation walls: Record answers from item #68a and record sizes and spacings.

From 68a.2: masonry and concrete:

Required anchor bolt diameter

_____ in.

Required washer size

Standard

Oversized

Required anchor bolt spacing

_____ in

Rebar size

Lap splice

_____ in.

Rebar hook length

_____ in.

From 68a.4: wood: Record answers from item #68a.4 and record sizes and spacings.

Required nailing

Minimum plywood thickness.

_____ in.

Required anchor bolt diameter

Required anchor bolt spacing

_____ in

b. Horizontal anchorage in the transverse direction - foundation walls

1. *Continuous foundation walls* (#69a)

Number of transverse foundation walls (#55a)

2 4 6

Required Footing Width (minimum)

12 in.

From #69a.1: concrete / masonry:

End Wall

Interior Wall

Anchor bolt diameter

_____ in.

	<u>End Wall</u>	<u>Interior Wall</u>	
Anchor bolt spacing	_____	_____	in.
Rebar size	_____	_____	
Lap splice	_____	_____	in.
Rebar hook length	_____	_____	in.
<u>From #69a.2: wood:</u>			
Required nailing	_____	_____	
Minimum plywood nailer	_____	_____	
Anchor bolt diameter	_____	_____	
Anchor bolt spacing	_____	_____	in.

2. *For transverse short foundation walls completed with diagonal braces (#69b)*

	<u>End</u>	<u>Interior</u>	
Number of pairs of diagonals (1 for single-section units, 2 for multi-section units) times number of short walls (end or interior) (#55a)	_____	_____	
Diagonal spacing (same as number of short walls)	_____	_____	
<u>From #69b: concrete / masonry:</u>			
Anchor bolt diameter	_____	_____	in.
Number of bolts	_____	_____	
Rebar size	_____	_____	
Lap splice	_____	_____	in.
Rebar hook length	_____	_____	in.

3. *For vertical X-bracing planes in lieu of short walls. (#69c)*

Number of X-brace locations (#59)	_____	_____	9
-----------------------------------	-------	-------	---

Spacing of vertical X-brace planes (#59)

7 ft.

Items from #69c.3 and #69c.5

Required anchor bolt diameter

1/2 φ in.

Number of bolts at top of footing to connect diagonal

3

Diagonal strap size

A36 P - 1/4" x 1"

Connection to top flange of chassis beam (describe)

w/ tr dtl

c. Horizontal anchorage in the longitudinal direction - exterior foundation walls

1. Continuous foundation walls

Reinforcing for longitudinal foundation walls: record only if larger sizes or closer spacing than recorded for vertical anchorage (#71a.2).

From #70a.1: concrete / masonry:

Anchor bolt diameter

_____ in.

Anchor bolt spacing

_____ in.

Rebar size

Lap splice

_____ in.

Rebar hook length

_____ in.

From #70a.2: wood: record only if larger sizes or closer spacings than recorded for vertical anchorage (#71a.2)

Required nailing

Minimum plywood nailer

Anchor bolt diameter

Anchor bolt spacing

_____ in.

2. Vertical X-bracing planes under chassis beam lines (#70b.)

Number of X-brace locations along one chassis beam line.

2

Spacing of X-brace locations along one chassis beam line.

49 ft.

Required anchor bolt diameter.

1/2 φ in.

Number of bolts at top of footing at connection to the diagonal.

1

Diagonal strap size.

A36 #1/4" x 1"

Connection to bottom flange of chassis beam (describe).

w/ft. D+1

72. Do foundation dimensions and details comply with Foundation Capacities Table, based on Foundation Design Table Values?

yes no

73. If #72 yes, approve. If no, return to applicant.

APPROVE

DISAPPROVE

APPENDIX H

MAPS

H-100. GENERAL. The following collection of maps is intended to assist the user in the foundation selection and design process. The maps provide information for geographic locations within the 50 States of the United States covering a wide range of issues: flooding, frost penetration, expansive soils, landslides, subsidence, termites, snow, wind and earthquakes. The maps have been accumulated from various sources, most notably the U.S. Department of Commerce Weather Bureau, the U.S. Army Corps of Engineers Waterways Experiment Station, and the American Society of Civil Engineers.

H-200. SEISMIC PERFORMANCE CATEGORIES. Table H-1 is a condensed version of the ASCE 7-93 Seismic Performance Category Table as it applies to manufactured housing.

H-300. SPECIAL SEISMIC DESIGN CONSIDERATIONS FOR FOUNDATIONS.

H-300.1. General. Based on the Seismic Performance Category for the geographic location involved, special requirements must be satisfied that involve the foundation:

A. Seismic Performance Category A. There are no special requirements for the foundations of manufactured housing assigned to this Category.

B. Seismic Performance Category B. The site coefficient has been assumed as 2.0 for all Tables in Appendix B. The resulting ca-

pacities of the foundations, subjected to the prescribed seismic forces of the Tables in Appendix B shall meet the following requirements:

1. **Structural Components.** The design strength of foundation components subjected to seismic forces alone or in combination with other prescribed loads and their detailing requirements shall conform to the requirements of the applicable material codes (wood, concrete or masonry) referenced by the local authority having jurisdiction.
2. **Soil Capacities.** For the load combination including earthquake, the capacity of the foundation soil in bearing or the capacity of the soil interface between pile, pier or caisson and the soil must be sufficient to resist loads at acceptable strain considering both the short duration of loading and the dynamic properties of the soil.

C. Seismic Performance Category C. Foundations for buildings assigned to Category C shall conform to all of the Foundations for Categories A and B and to the following additional requirements of this section.


1. **Investigation.** The authority having jurisdiction may require the submission of a written report that shall include, in addition to the evaluations required in this section, the results of an investigation to deter-

mine the potential hazards due to slope instability, liquefaction and surface rupture due to faulting or lateral spreading, all as a result of earthquake motions.

2. **Foundation Ties.** Individual drilled piers shall be interconnected by ties. All ties shall have a design strength in tension or compression, greater than a force equal to 25 percent of the effective peak velocity related acceleration (A_v) time the larger column dead plus live load.

3. **Special Pile Requirements.** For uncased concrete drilled piers, there shall be a minimum of four longitudinal bars (with a minimum reinforcement ratio of 0.005) and No. 3 closed ties with maximum spacing of 3 inches.

D. Seismic Performance Category D. Category D does not add any additional requirements for manufactured housing. The requirements of Category C plus A and B shall be followed.

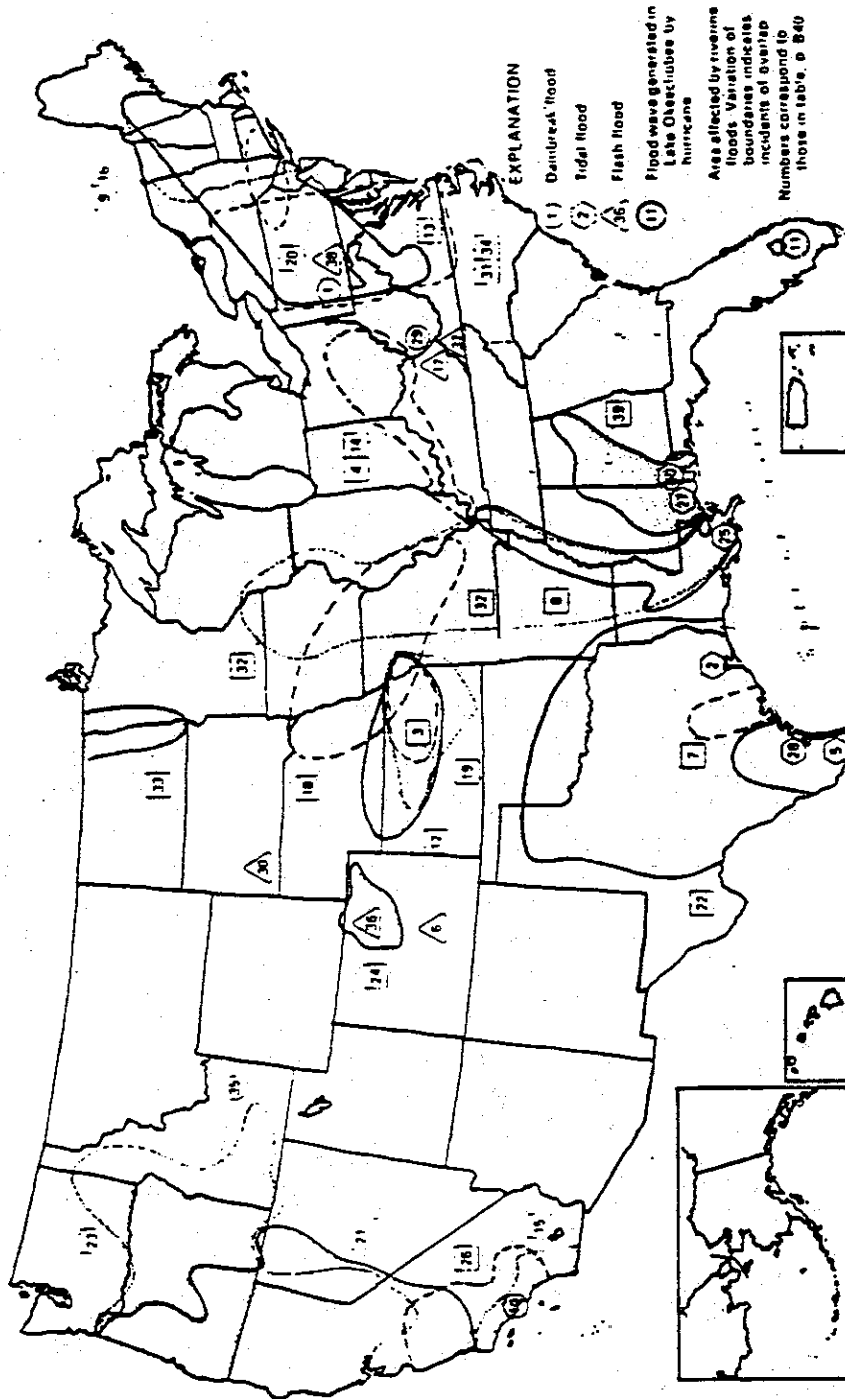

EXPLANATION

- (1) Dam-break flood
- (2) Tidal flood
- (3) Flash flood


Flood wave generated in Late Okechobee by hurricane

Area affected by hurricane floods. Variation of boundaries indicates incidents of overlap. Numbers correspond to those in table, p. 840.

Map showing distribution of great floods in the conterminous United States since 1900

FLOOD-PRONE SITES

APPENDIX H

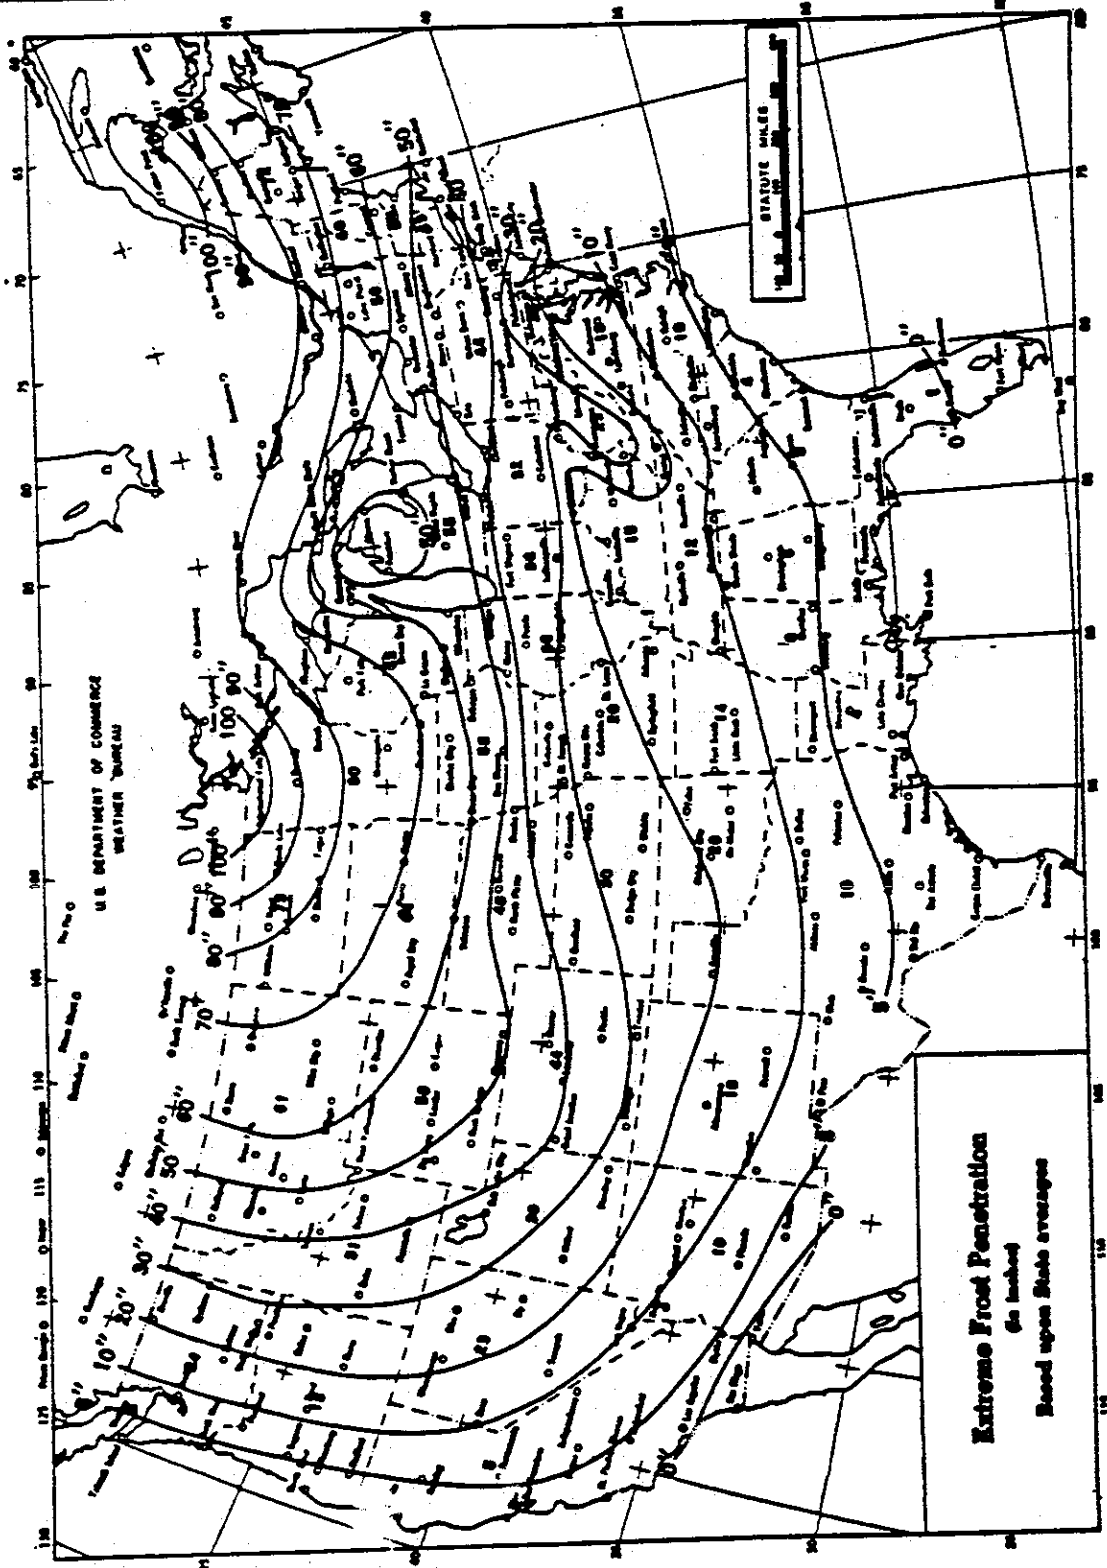

FROST PENETRATION DEPTH

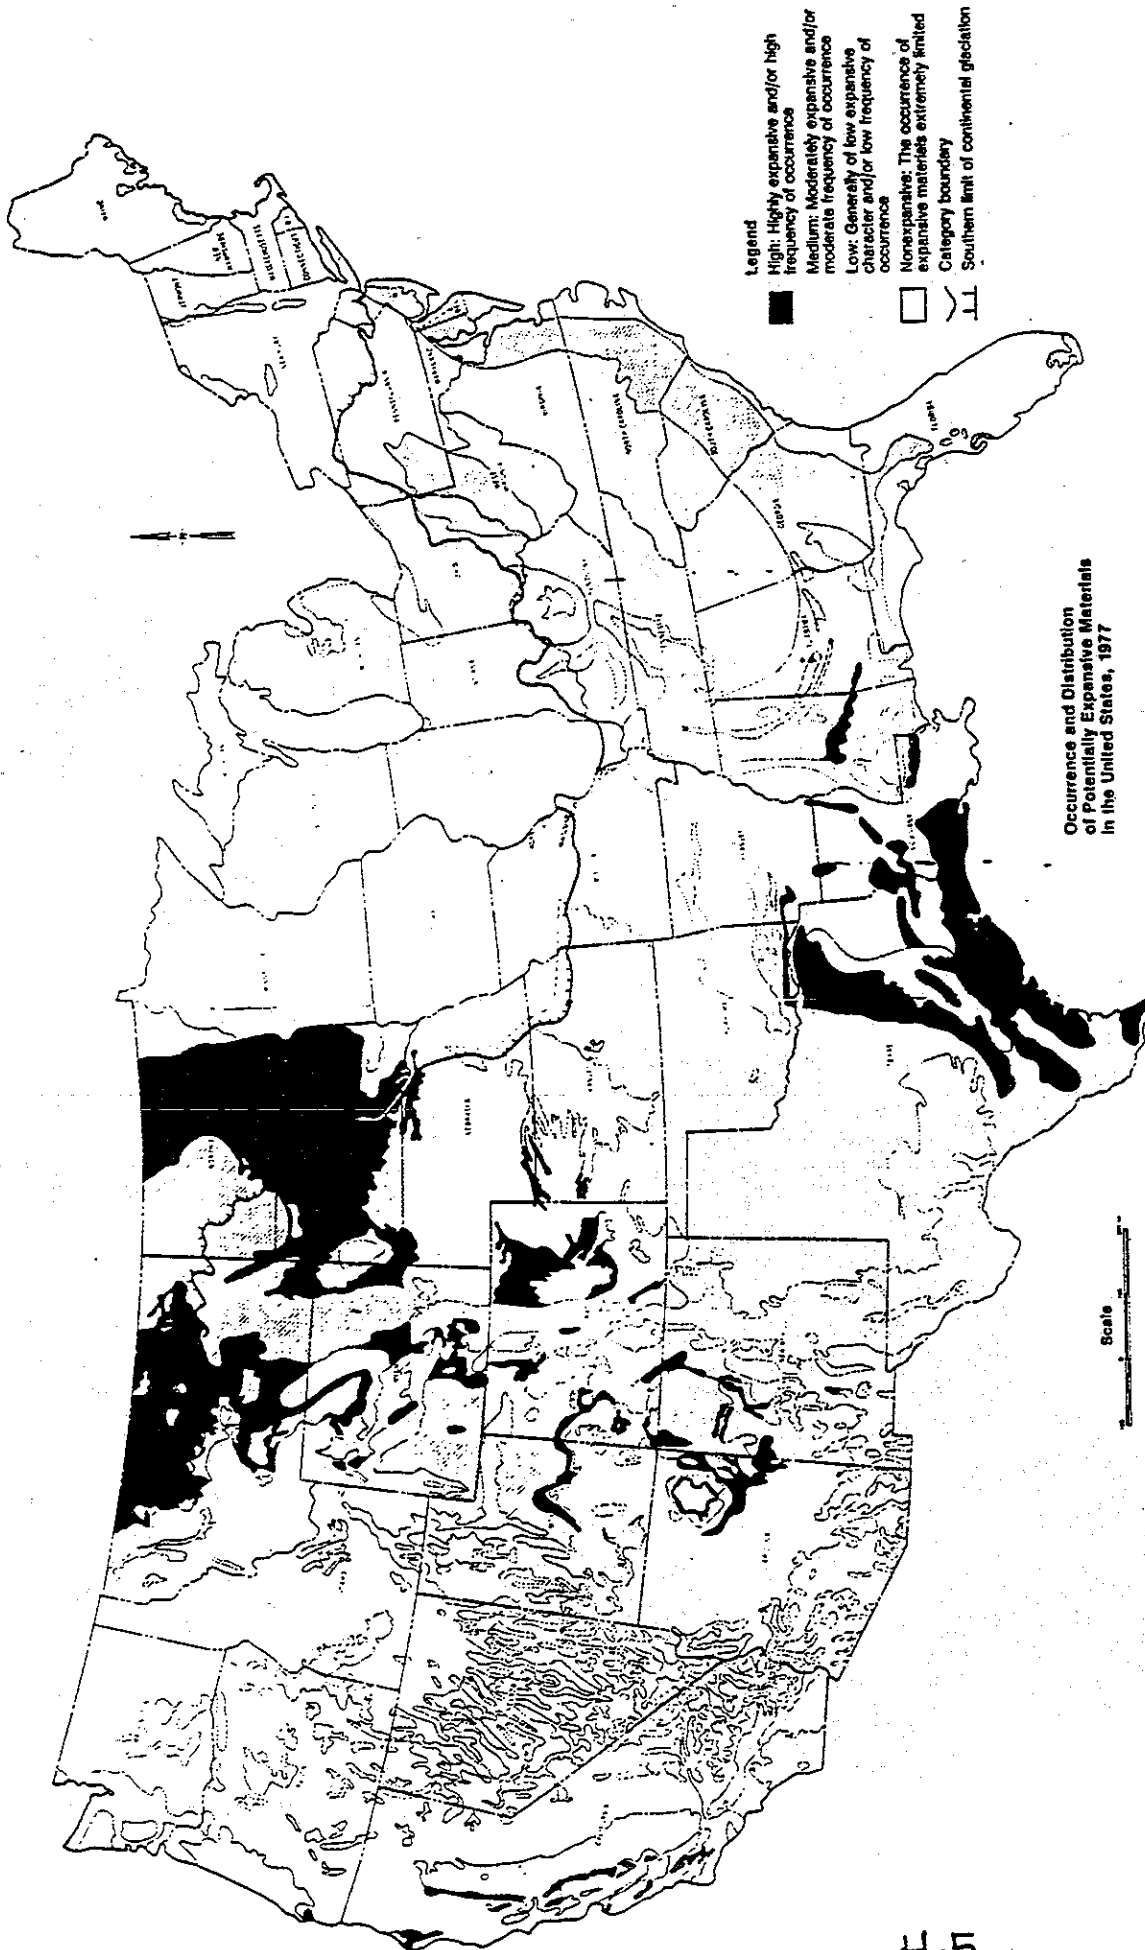


Fig. 10. Occurrence and distribution of potentially expansive materials in the United States, 1977. (U.S. Army Corps Engineer Waterways Experiment Station)


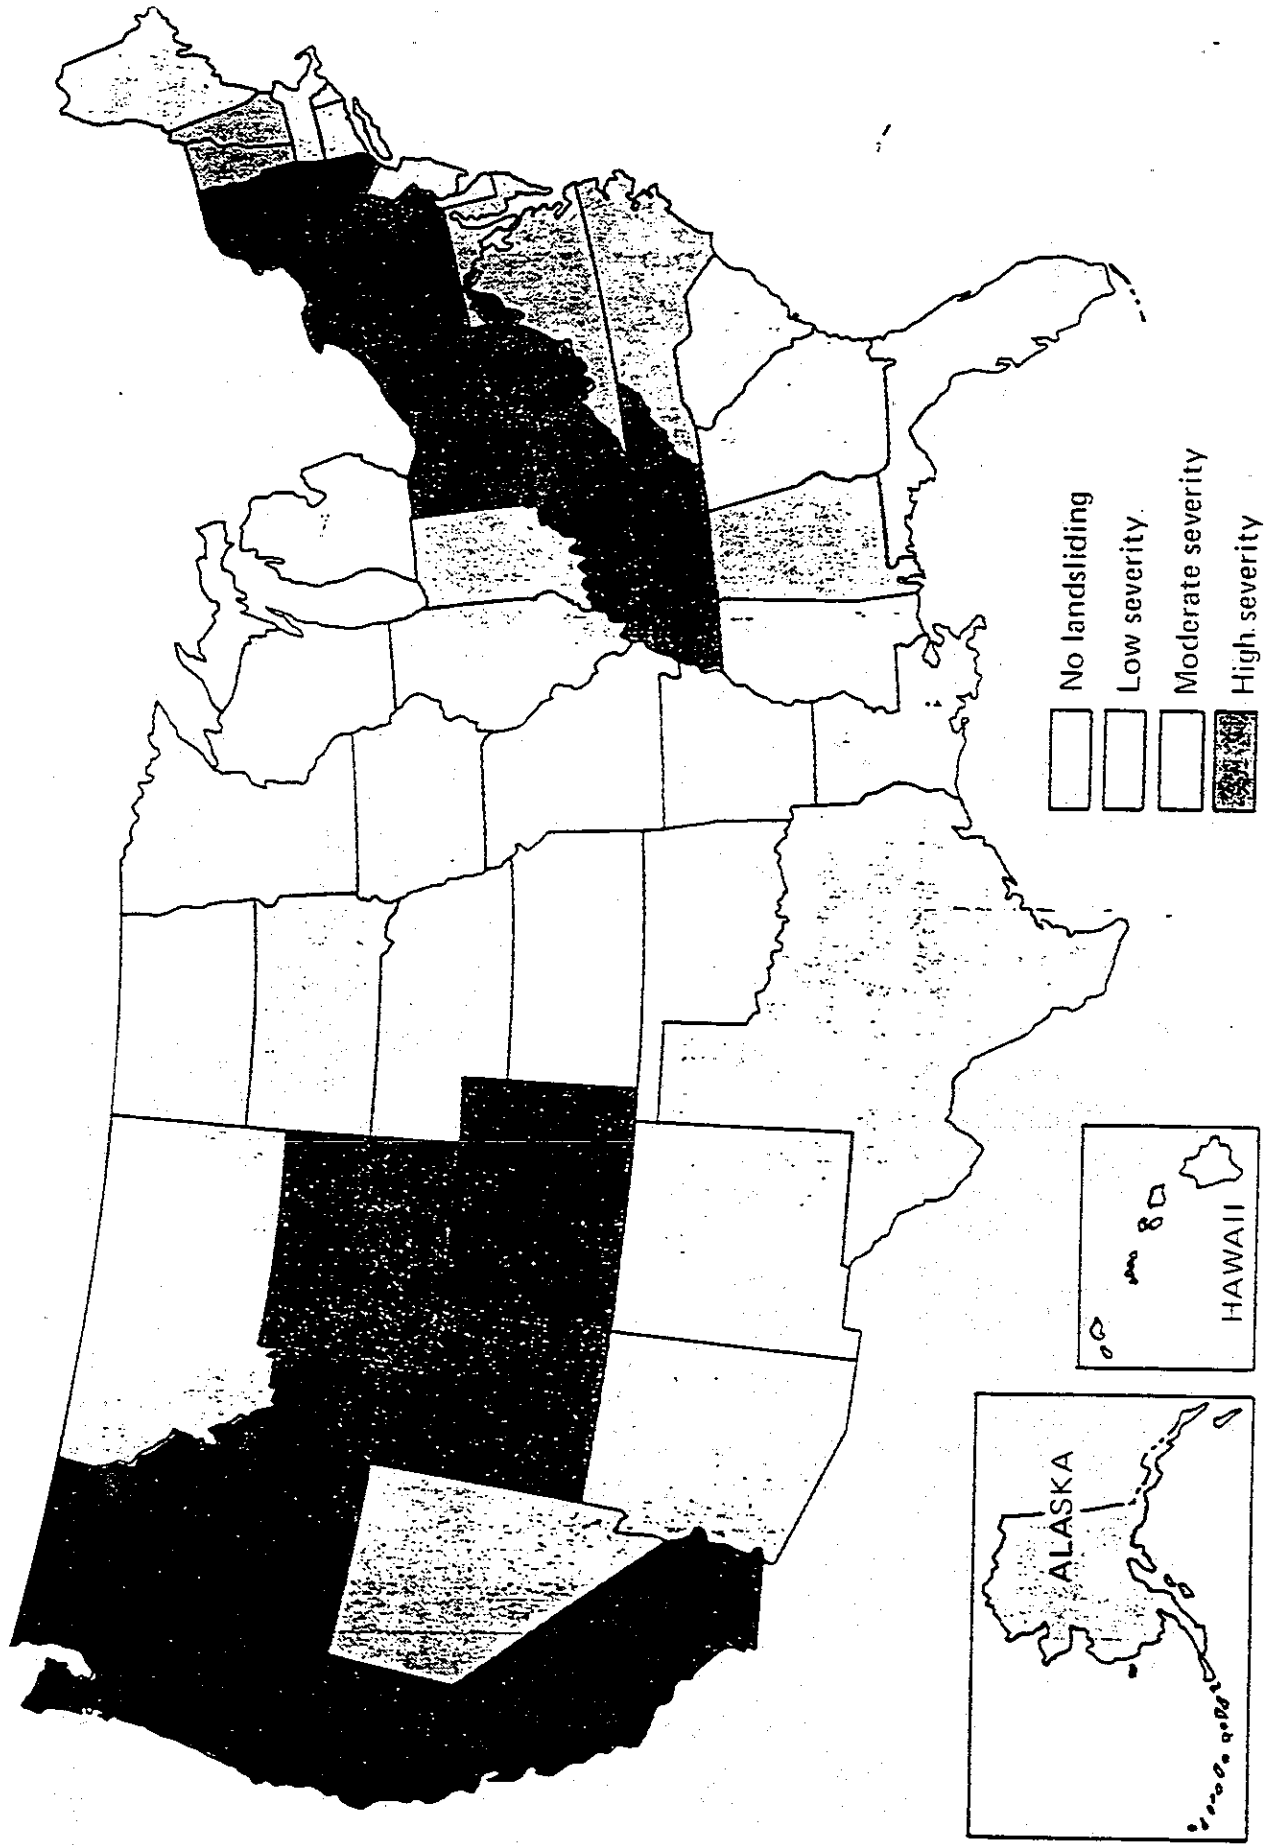



FIGURE 1 Qualitative indication of the severity of landsliding in the United States by state.

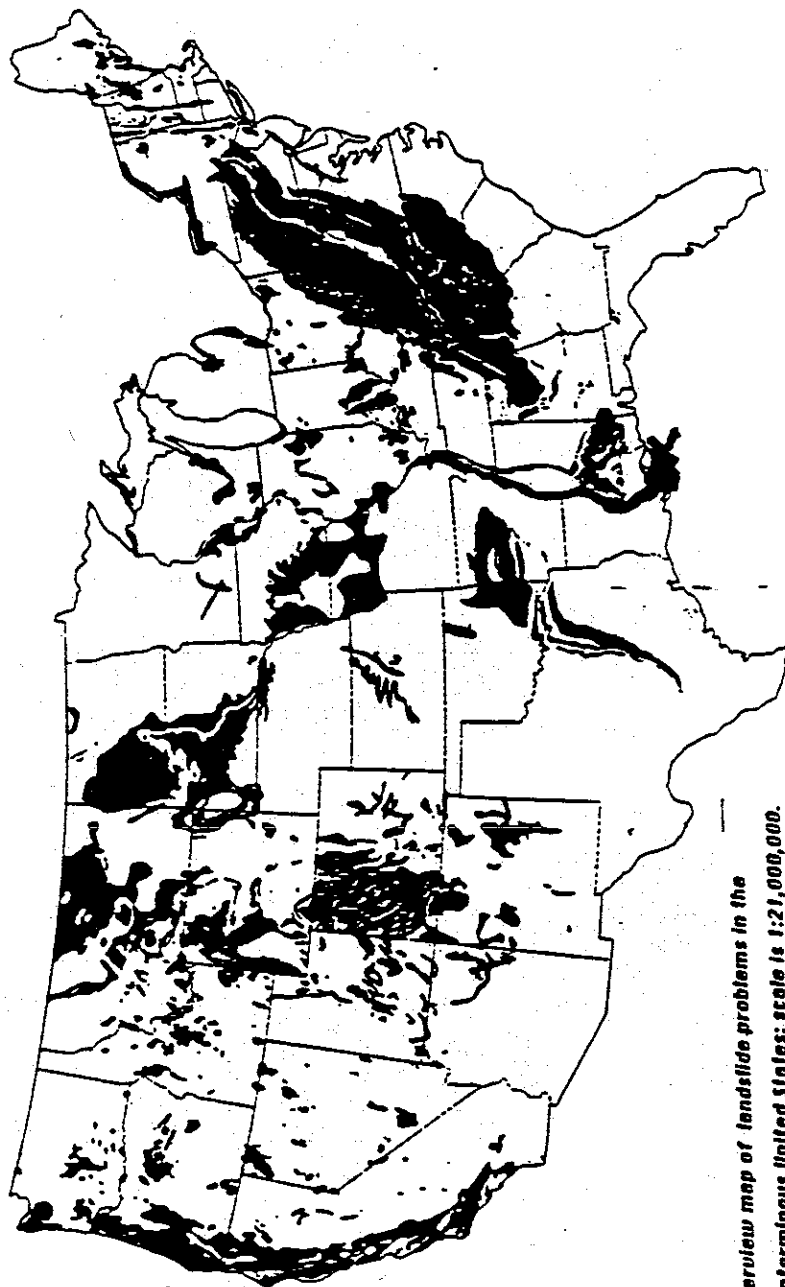


Overview map of landslide problems in the conterminous United States; scale is 1:21,000,000. The severity is highest in the lightly shaded areas, with severity lessening as the color darkens. (modified from Radbruch-Hall and others, 1976)

LANDSLIDE AREAS

APPENDIX H

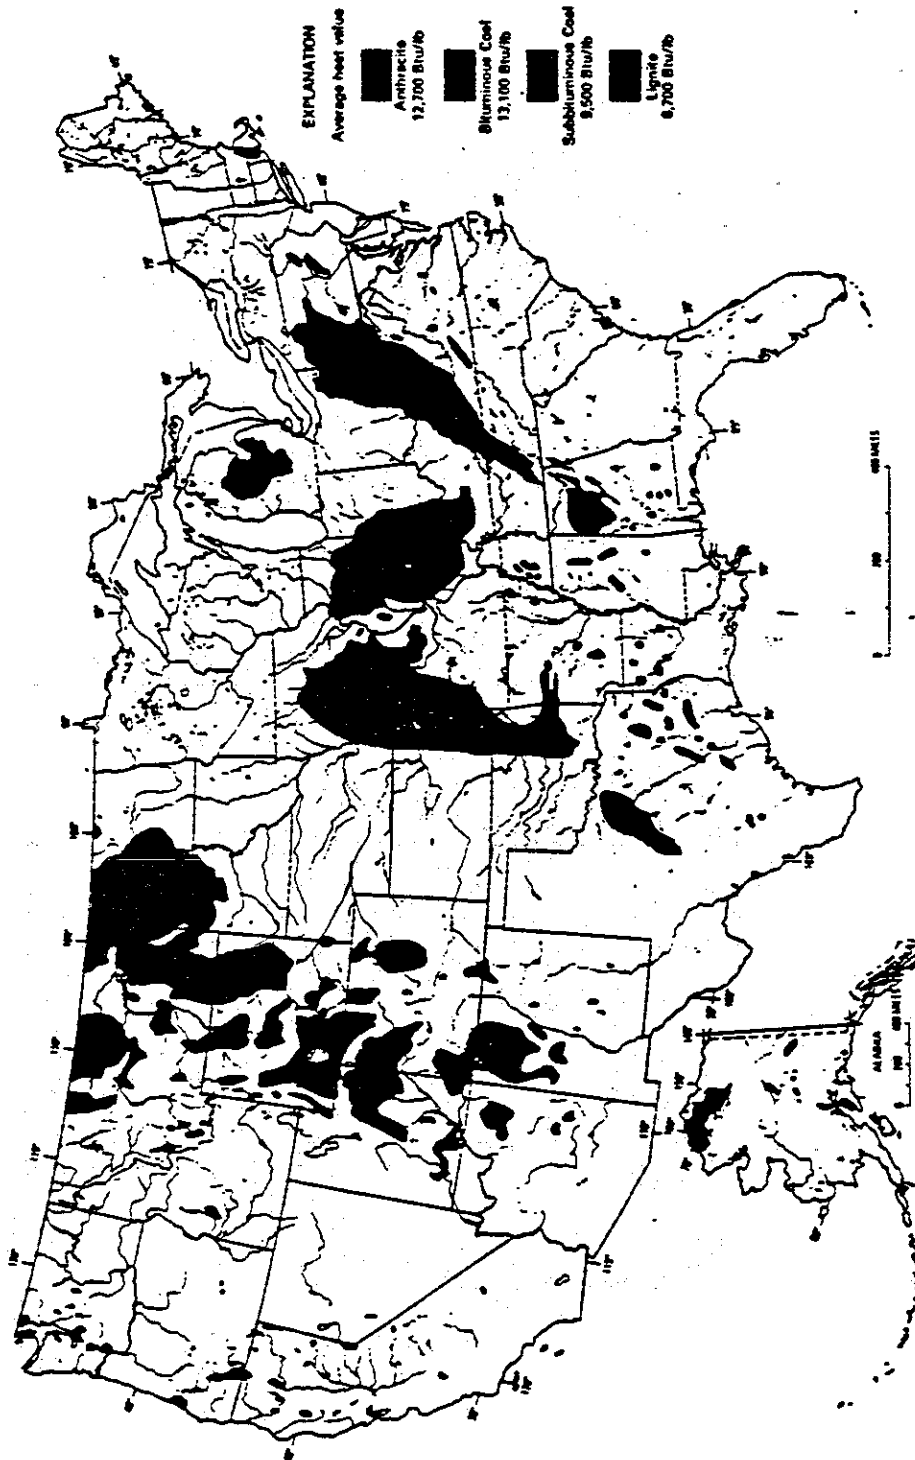


AREAS PRONE TO SUBSIDENCE-MINING

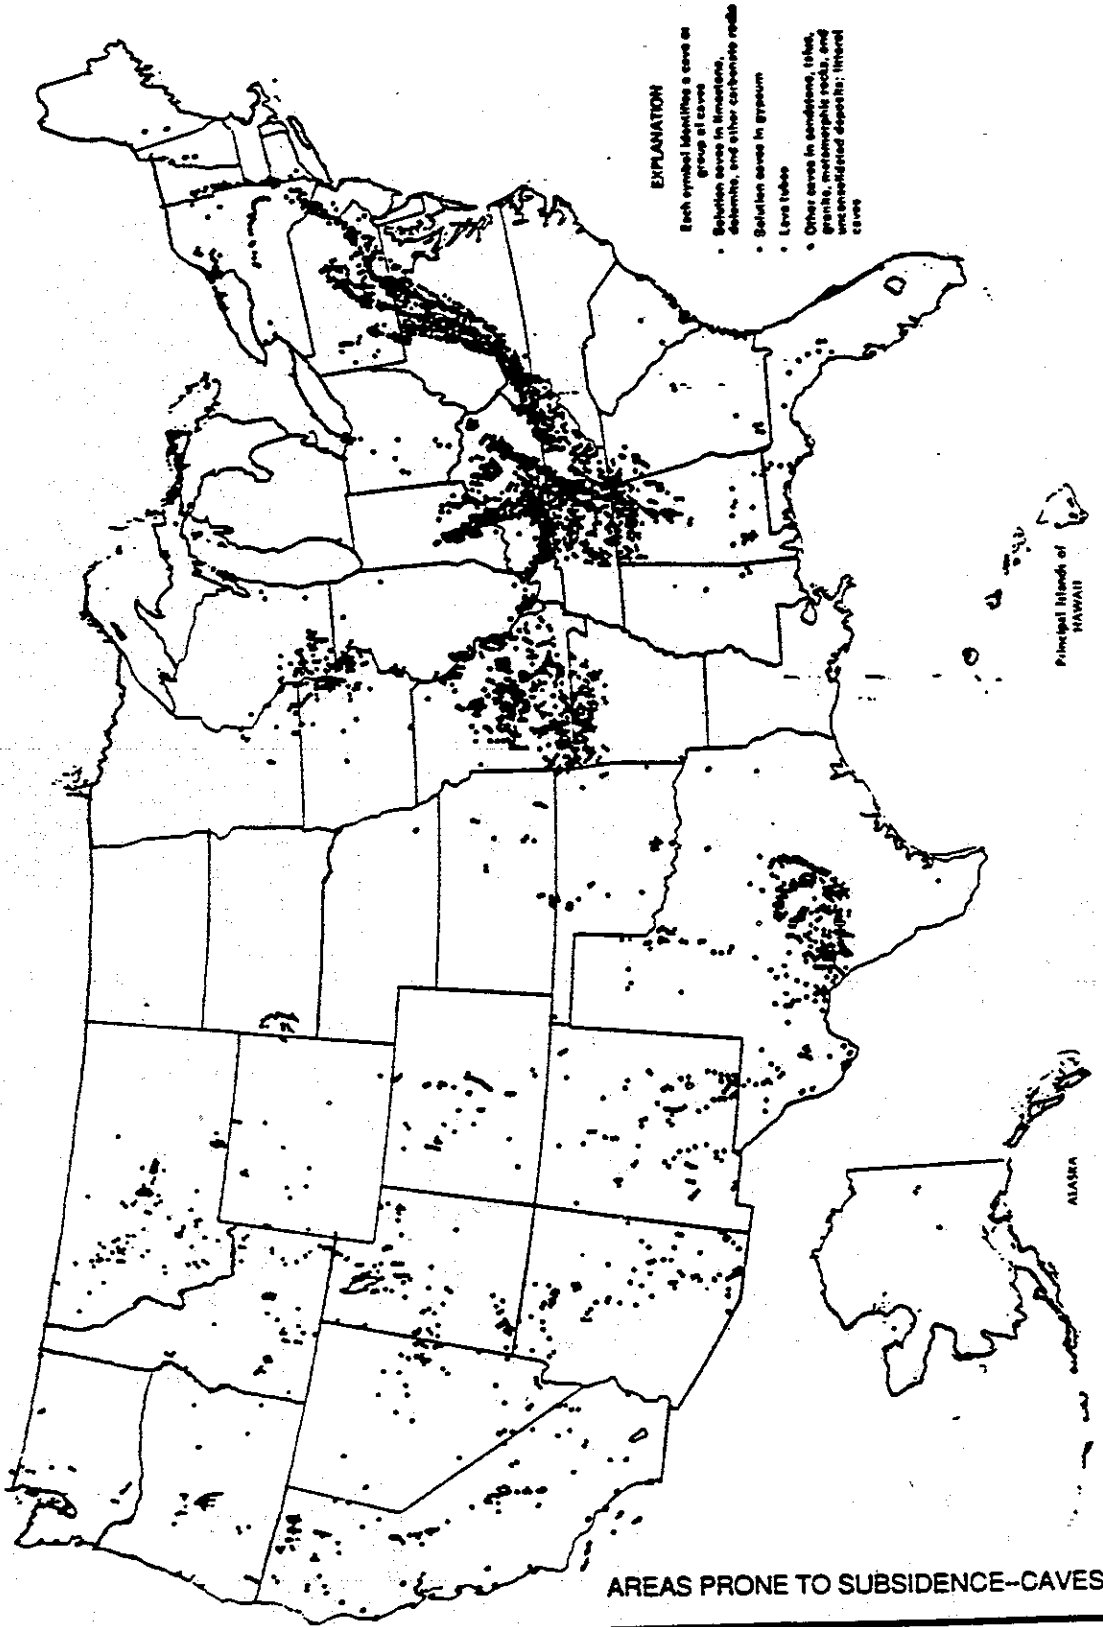

TERMITE INFESTATION PROBABILITY MAP

Note: Lines defining areas are approximate only.
 Local conditions may be more or less severe than indicated by the region classification.

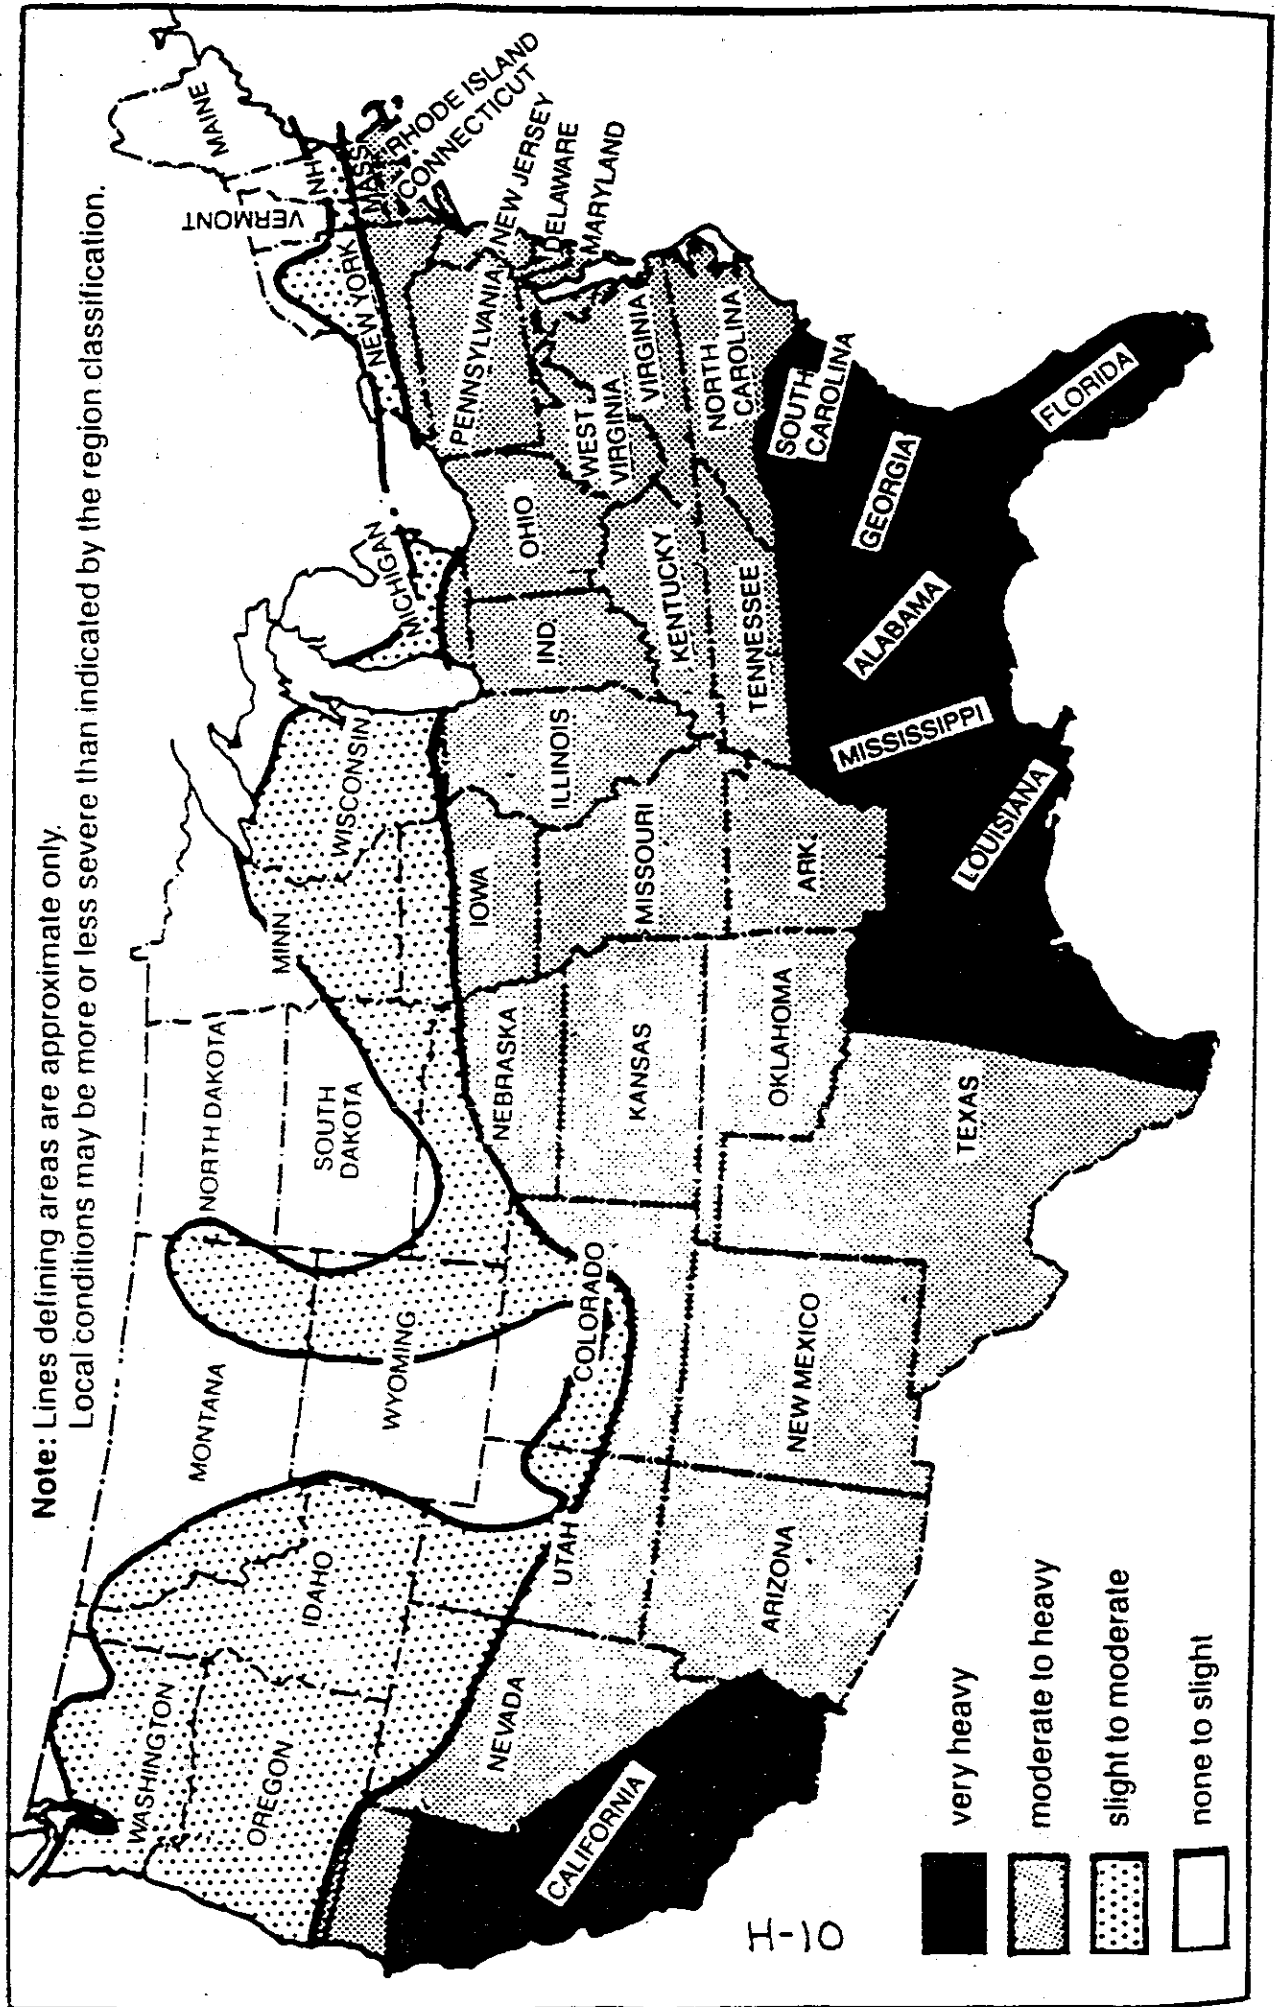





Dots are included to assist in defining the position of boundaries. The letter adjacent to the dot is the first letter of the place name there.


- In these areas extreme local variations in snow loads preclude mapping at this scale.
- The zoned value is not appropriate for certain geographic settings, such as high country in these areas.

Ground Snow Loads, p_g , for the Western United States
(pounds per square foot)

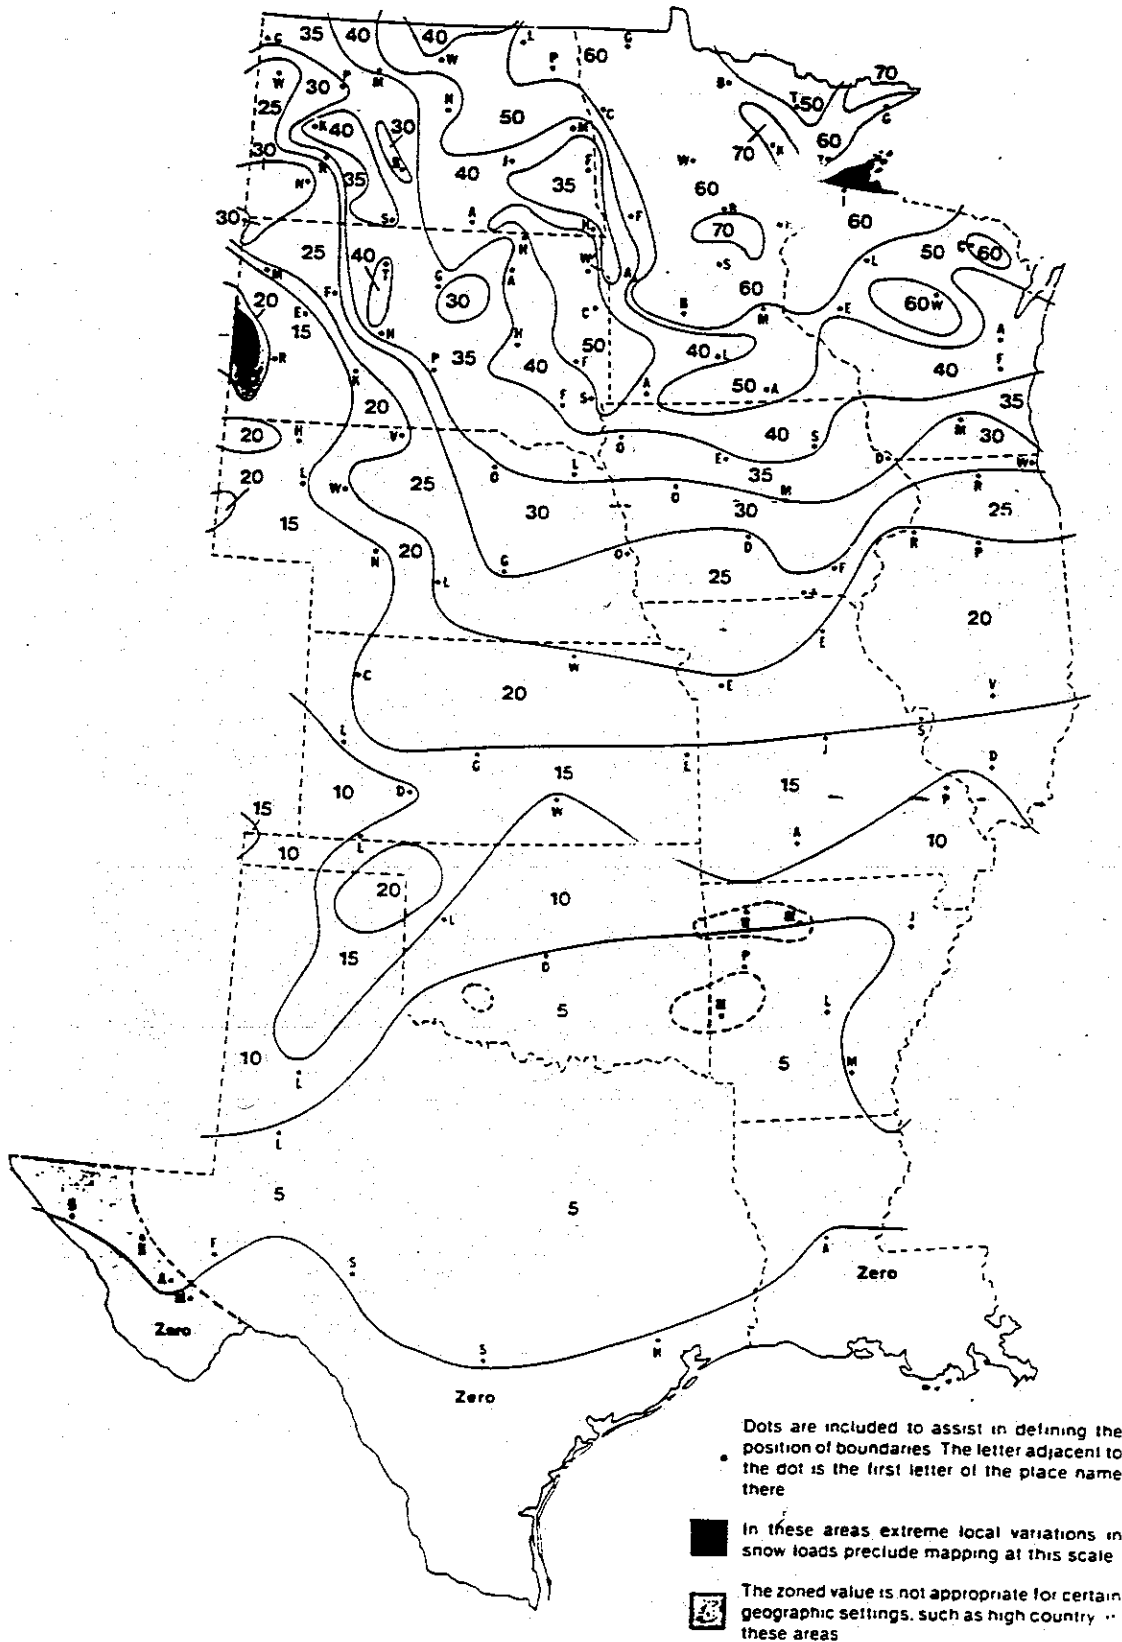


Dots are included to assist in defining the position of boundaries. The letter adjacent to the dot is the first letter of the place name there.


 In these areas extreme local variations in snow loads preclude mapping at this scale.

 The zoned value is not appropriate for certain geographic settings, such as high country in these areas.

Ground Snow Loads, p_g , for the Central United States
(pounds per square foot)

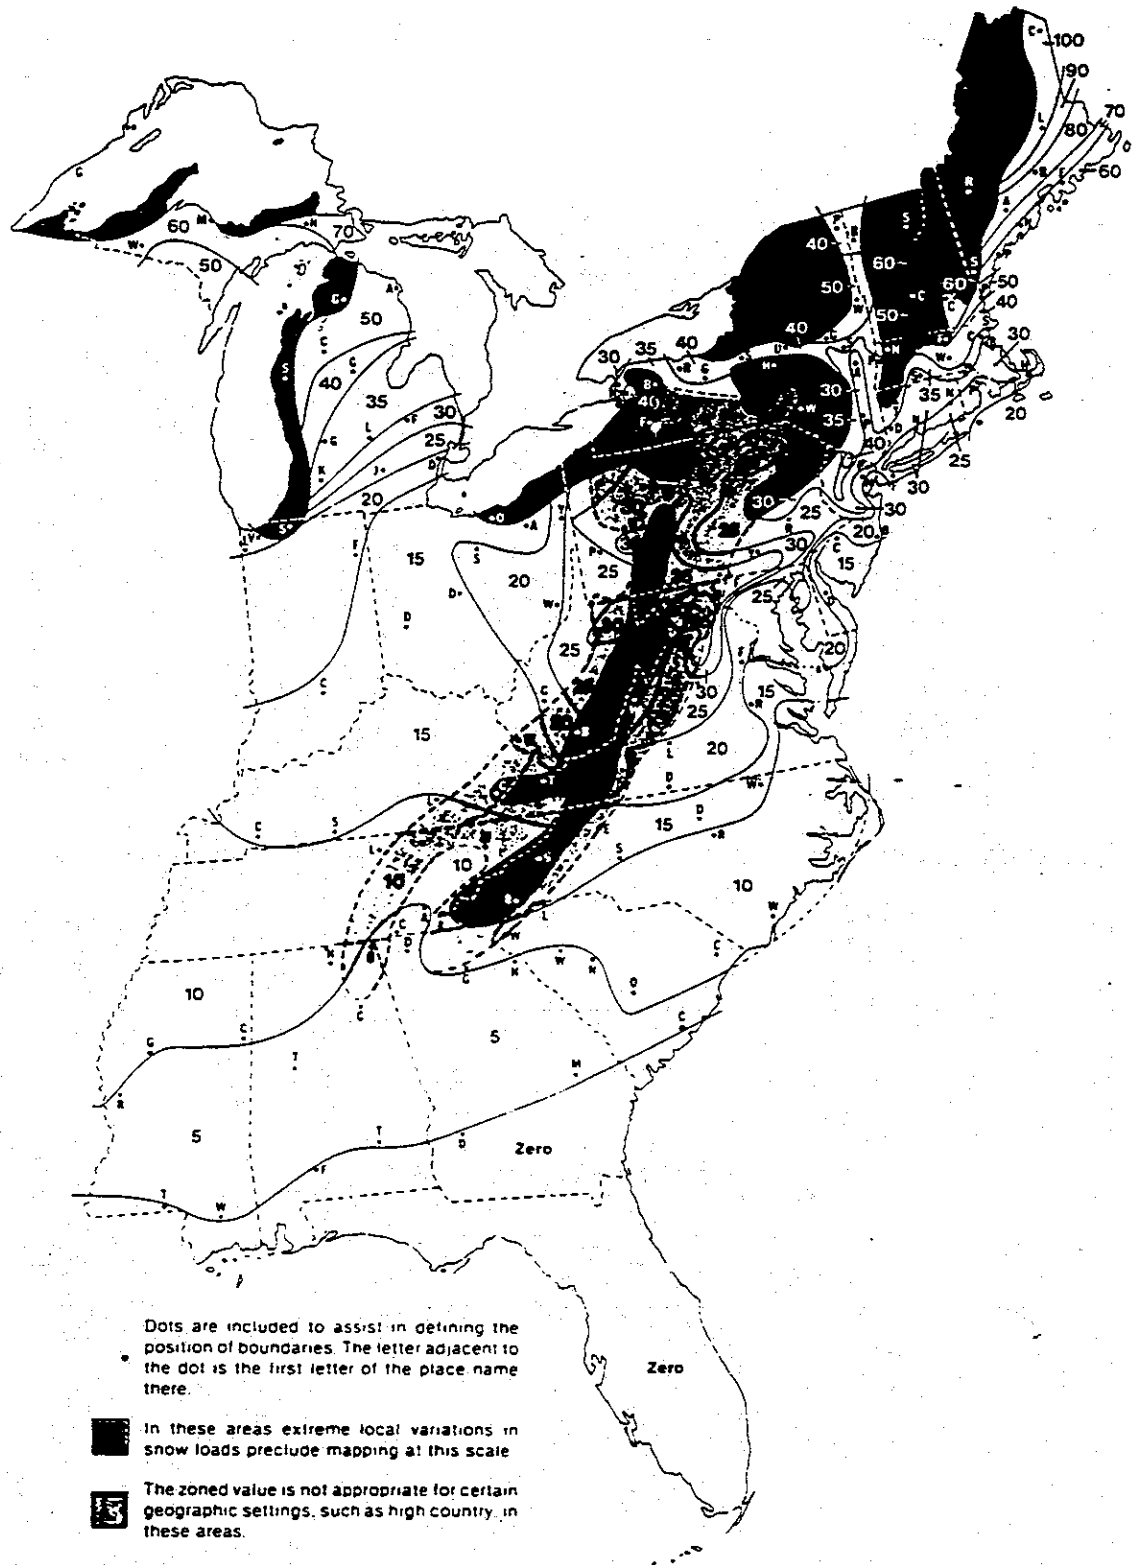


Ground Snow Loads, p_g , for the Eastern United States
(pounds per square foot)

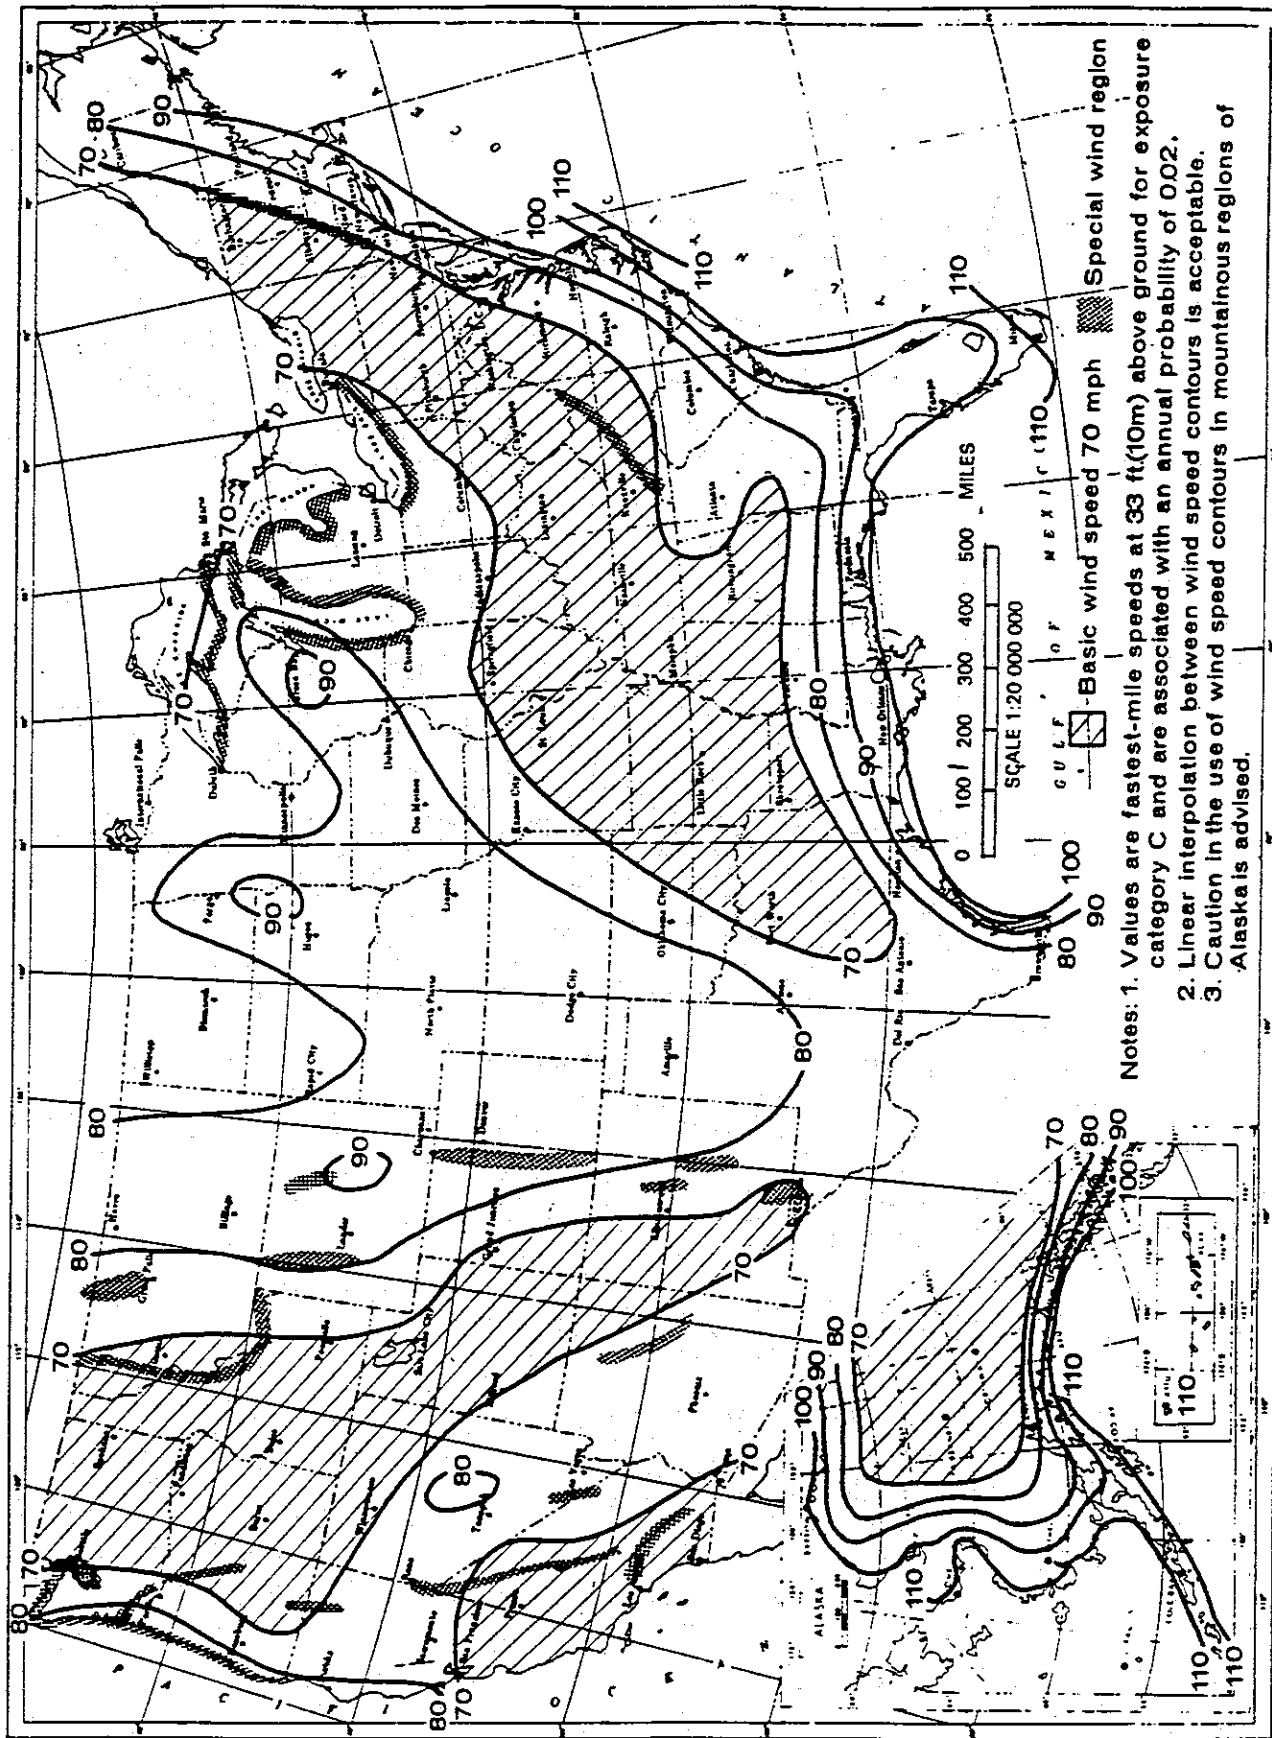

- Notes: 1. Values are fastest-mile speeds at 33 ft (10m) above ground for exposure category C and are associated with an annual probability of 0.02.
 2. Linear interpolation between wind speed contours is acceptable.
 3. Caution in the use of wind speed contours in mountainous regions of Alaska is advised.


Basic Wind Speed (mph)

MINIMUM DESIGN LOADS

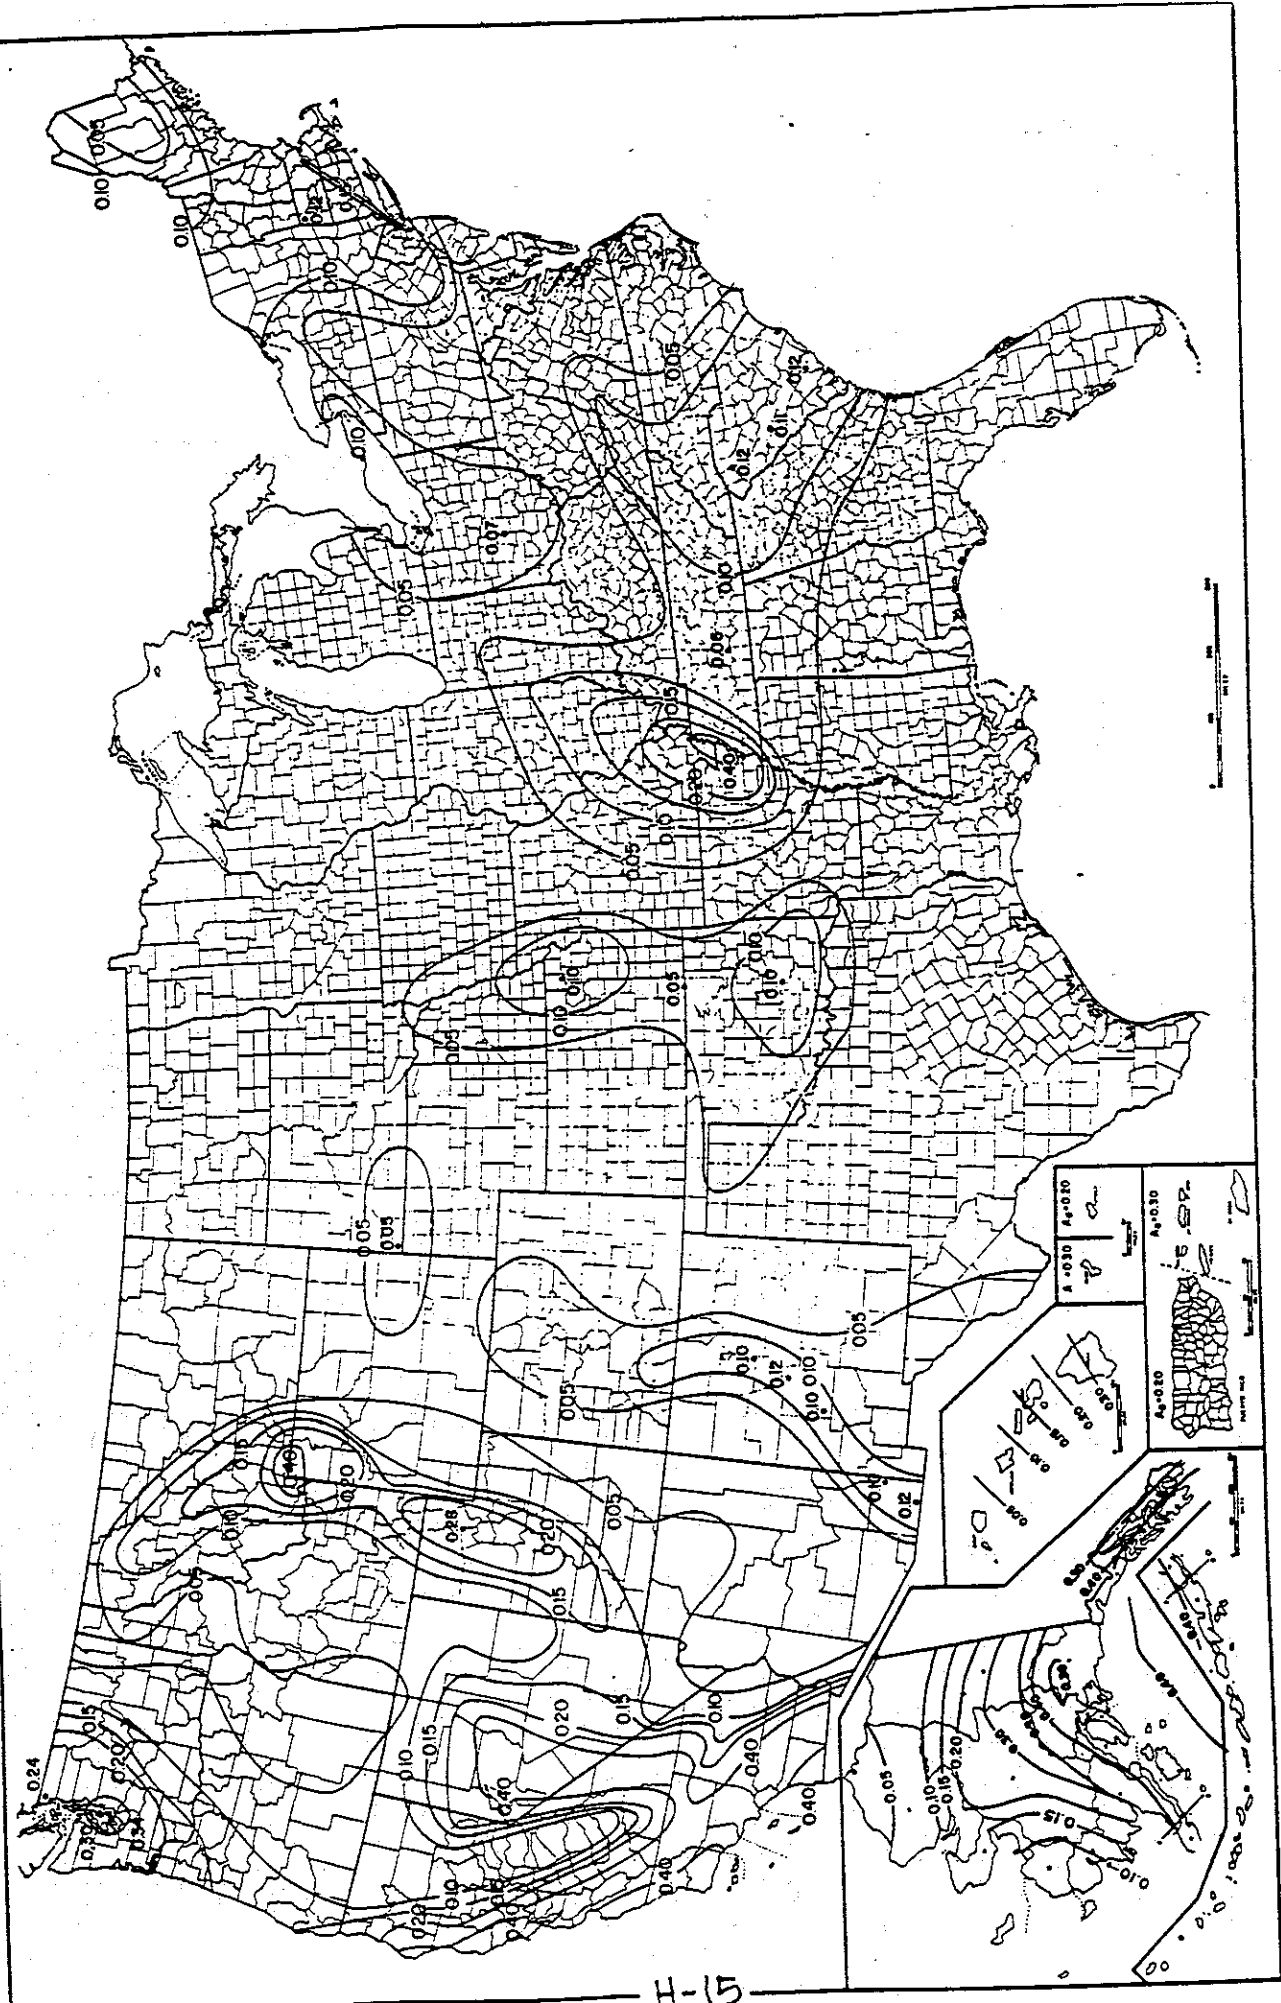

H-15

Contour Map for Coefficient λ_s

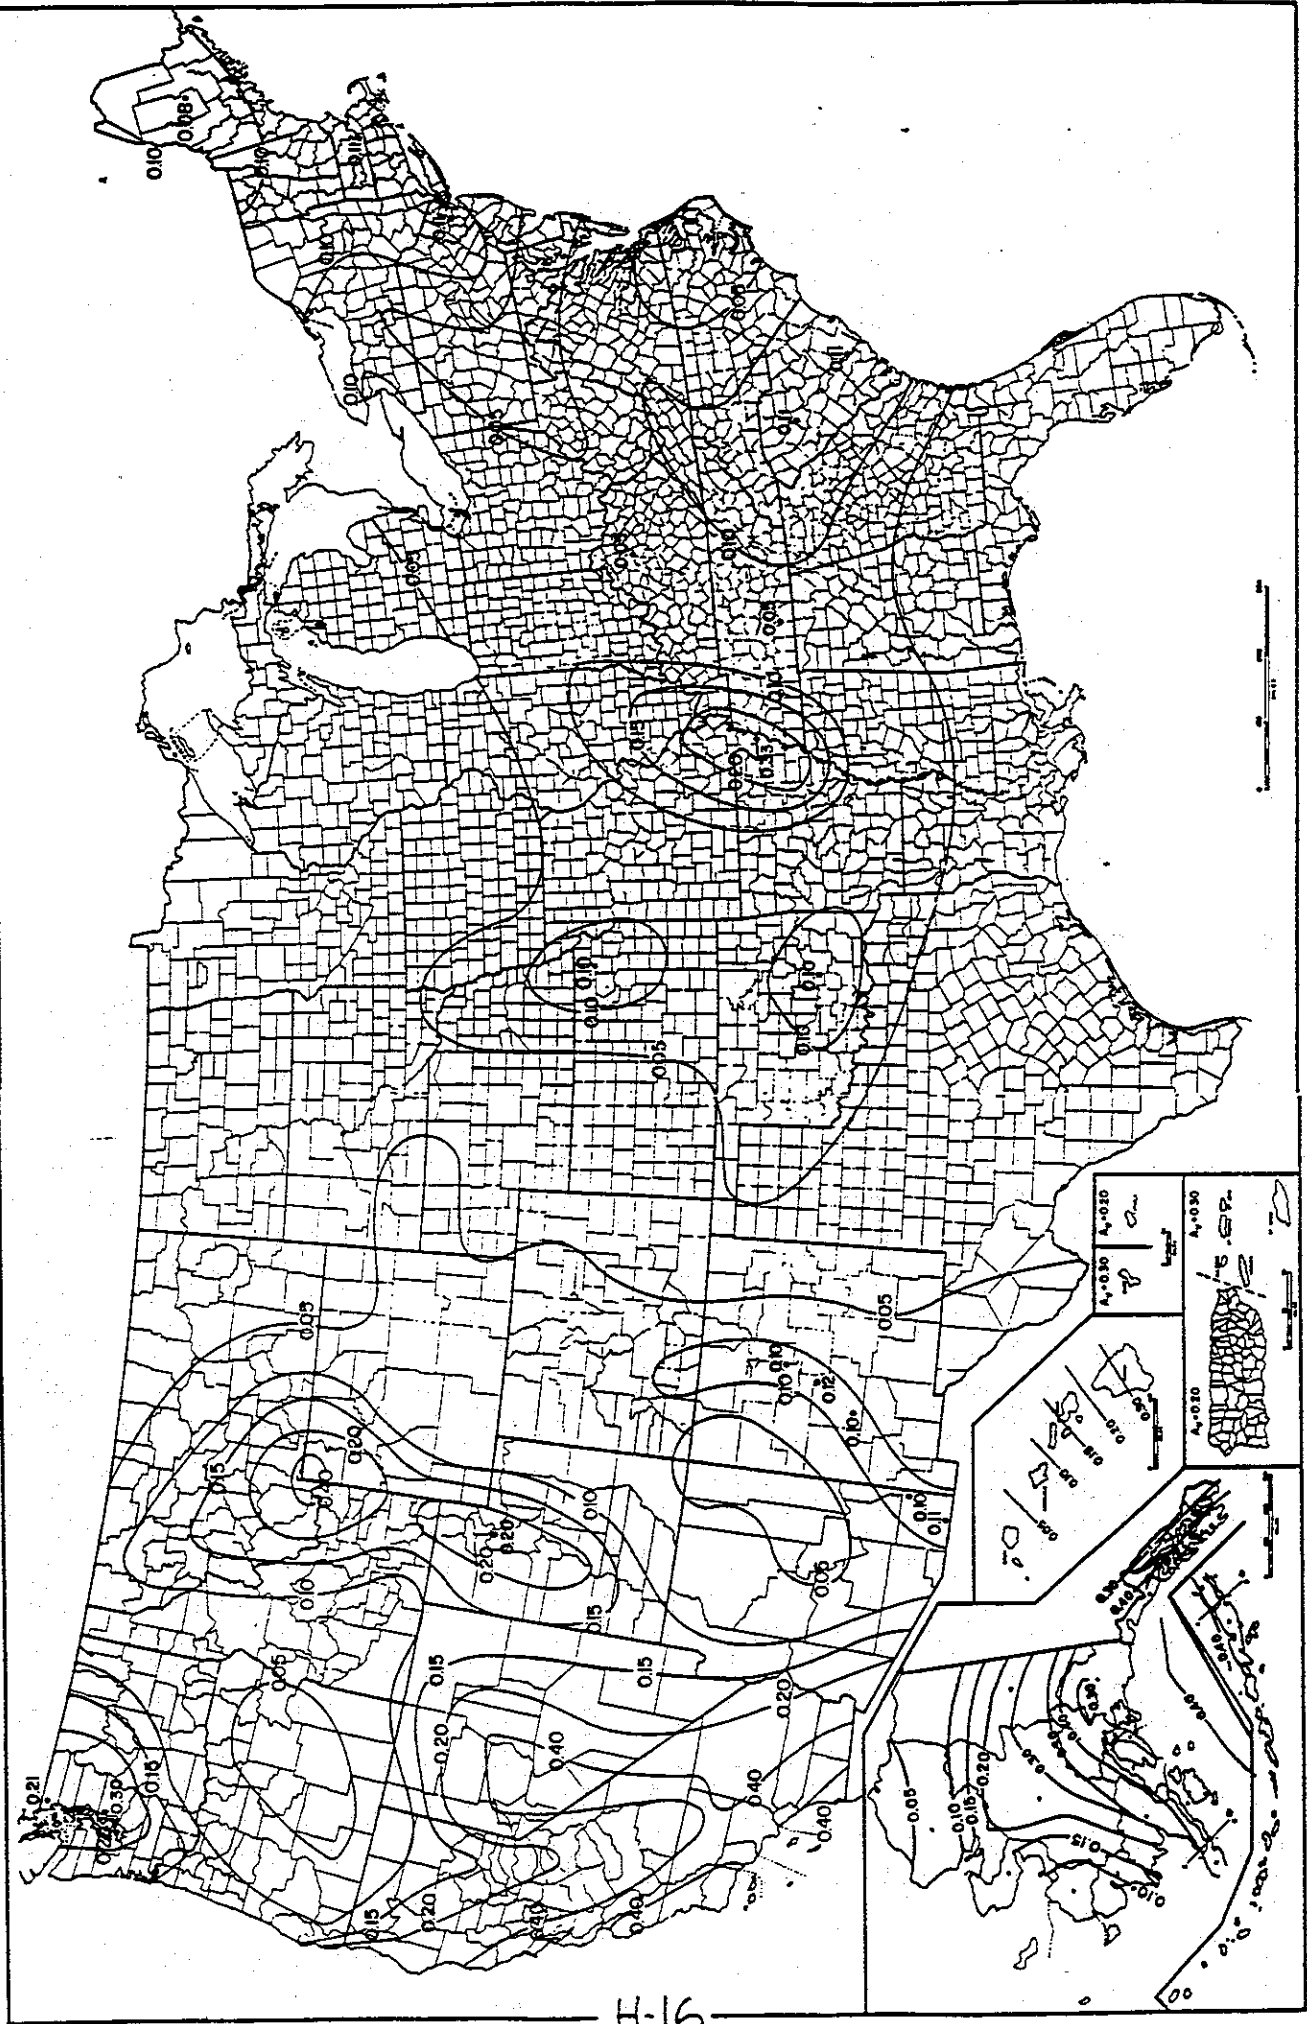

H-16

Contour Map for Coefficient A_s

Table H-1
Seismic Performance Category for
Seismic Hazard Exposure Group I

Effective Peak Velocity-Related Acceleration A_v	Seismic Performance Category
$A_v < 0.05$	A
$0.05 \leq A_v < 0.10$	B
$0.10 \leq A_v < 0.20$	C
$0.20 \leq A_v$	D

Manufactured Housing of Category A and B (one story detached one and two family dwellings which are located in seismic map area having an effective peak velocity-related acceleration (A_v) value less than 0.15) are exempt from the requirements of these provisions.

Manufactured Housing of Category C and D shall comply with all the requirements of these provisions.

APPENDIX I

REFERENCES AND ADDITIONAL RESOURCES

REFERENCES

American Society for Testing Materials. *Test Method for Laboratory Compaction Characteristics of Soil Using Modified Effort.* ASTM: D 1557-91. Philadelphia, PA.: ASTM, 1995.

American Society of Civil Engineers. *Minimum Design Loads for Buildings and Other Structures.* (ASCE 7-93) Revision of ANSI / ASCE 7-88. New York, NY: American Society of Civil Engineers, 1993.

Council of American Building Officials. *CABO One and Two Family Dwelling Code* (including Appendix C). Falls Church, VA: Council of American Building Officials, 1989.

Federal Emergency Management Agency, ed. *Manufactured Home Installation in Flood Hazard Areas.* Washington DC: Government Printing Office, September, 1985.

National Academy of Sciences Report. *Reducing Losses From Land Subsidence in U.S.*

National Bureau of Standards. *Construction of Housing in Mine Subsidence Areas.* NBSIR 81-2215.

U.S. Department of Agriculture. *Rural Housing Loan Policies, Procedures, and Authorizations.* Subpart A of Part 1924 and Subpart A of Part 1944 of Chapter XVIII, Federal Register, Volume 51, Number 12, January 17, 1986. Rural Housing and Community Development Service, formerly the Farmers Home

Administration. Washington DC: Government Printing Office, 1986.

U.S. Department of Housing and Urban Development. *Architectural Processing and Inspections for Home Mortgage Insurance.* HUD Handbook 4145.1 REV-3 Change 1, Issued February 14, 1992.

U.S. Department of Housing and Urban Development. *Land-planning Data Sheet.* HUD Handbook 4140.3. Washington DC: Government Printing Office, 1983.

U.S. Department of Housing and Urban Development. *Manufactured Home Construction and Safety Standards.* Part 3280, 1994. Interpretive Bulletins to the Standard, including changes effective July 13 and October 25, 1994. Code of Federal Regulations Housing and Urban Development.

U.S. Department of Housing and Urban Development. *Minimum Property Standards (MPS) for Housing, 1994 Edition.* HUD Handbook 4910.1, 1994 Edition. Washington DC: Government Printing Office, 1994.

U.S. Department of Housing and Urban Development. *Procedures for Approval of Single Family Proposed Construction Applications in New Subdivisions.* HUD Handbook 4135.1 REV. 2, March 1981.

U.S. Department of Housing and Urban Development. *Value Analysis for Home Mortgage Insurance.* HUD Handbook 4150.1 REV-1, February 1990.

Vann, W.P. and McDonald, J.R. *An Engineering Analysis: Mobile Homes in Windstorms*. Lubbock, TX: Institute for Disaster Research, 1978.

ADDITIONAL RESOURCES

American Plywood Association. *Permanent Wood Foundation Plans for Double-Wide Manufactured Homes. Plan F*, Tacoma, WA: American Plywood Association, January, 1985.

Bernhardt, Arthur D. *Building Tomorrow*. Cambridge, MA: MIT Press, 1980.

Breyer, Donald E. *Design of Wood Structures, 3rd Edition*. New York, NY: McGraw-Hill Book Company, 1993.

Building Research Advisory Board, ed. *Criteria for Selection and Design of Residential Slabs-on-ground*. Publication 1571. Washington DC: National Academy of Sciences, 1968.

Cidras, Joseph M.; Kumar, V.K.; and Stern, E.G. *Mass-produced Foundations for Mass-produced Houses: A progress report*. VPI Bulletin 103. Blacksburg, VA: Virginia Polytechnic Institute and State University, 1971.

Cooke, P.W., and Zelenka, L.P. *Mobile Home Construction Standards Adopted by State Regulatory Programs - An Analysis*. Washington DC: National Bureau of Standards, 1975. NBSIR 75-680.

Cooke, P.W., et.al. *Model Documents for the Evaluation, Approval and Inspection of Manufactured Buildings*. NBSBSS 87. Washington DC: National bureau of Standards, 1976.

Hays, W.W., ed. *Facing Geologic and Hydrologic Hazards: Earth Science Considerations*. Geological Survey Professional Paper 1240-B, Washington DC: Government Printing Office, 1981.

HUDAC. *Precast Foundation System for Low-rise Housing*. HUDAC, Toronto, 1973.

Illinois Department of Public Health. *Illinois Mobile Home, Tie-down Act 1980, Rules and Regulations*. Springfield, IL: Illinois Department of Public Health, Division of Engineering, 1980.

Indiana Administrative Building Council. *Indiana Standard for the Permanent Installation of Manufactured Homes*. Indianapolis, IN: Administrative Building Council, 1982.

Jones, Rudard A. *Sectionalized Houses*. Research Report 62-2. Champaign-Urbana, IL: University of Illinois Small Homes Council-Building Research Council, 1962.

Kumar, Viswanath Krushna. *Industrialized Foundations for Low-rise Light-weight Buildings*. VPI Bulletin 109. Blacksburg, VA: Virginia Polytechnic Institute and State University, 1972.

NAHB Research Foundation. *An Investigation of Precast Concrete Foundation Systems for Residential Construction*. Rockville, MD: NAHB, 1973.

National Conference of States on Building Codes and Standards, Inc. *American National Standard: Manufactured Home Installations/1994*. NCSBCS / ANSI A225.1: 1994. Herndon, VA: National Conference of States on Building Codes and Standards, Inc., 1994.

National Conference of States on Building Codes and Standards, Inc. *Effect of Earthquake Forces on Manufactured Homes.* Housing and Building Technology, a Division of NCSBCS, March 24, 1995.

National Forest Products Assn., *Permanent Wood Foundation System, Design, Fabrication, Installation Manual.* Washington DC: National Forest Products Assn., January, 1987.

National Institute of Building Sciences. *A Study of the Standards Referenced in the Federal Mobile Home Construction and Safety Standards.* Washington DC: National Institute of Building Sciences, 1980.

National Institute of Standards and Technology (NIST). *Recommended Performance Based Criteria for the Design of Manufactured Home Foundation Systems to Resist Wind and Seismic Loads, August 1995.* Gaithersburg, MD: Building and Fire Research Laboratory, National Institute of Standards and Technology. NISTIR 5664.

Nutt-Powell, Thomas E., ed. *Manufactured Homes: Making Sense of a Housing Opportunity.* Boston, MA: Auburn House Publishing Co, 1982.

Nutt-Powell, Thomas E., ed. *Manufactured Housing: A Look at the Issues.* Cambridge, MA: Joint Center for Urban Studies of MIT and Harvard University, 1982.

Penner, E. and Crawford, A. *Frost Action and Foundations.* Ottawa, Canada: National Research Council of Canada, 1983.

Robinson, G.D. and Spieker, A.M., ed. *Nature to be Commanded: Earth Science Maps Applied to Land and Water Management.* Geological Survey Professional Paper 950, Washington DC: Government Printing Office, 1978.

Small Homes Council-Building Research Council. *19th Annual Short Course in Residential Construction.* Champaign-Urbana, IL: University of Illinois, Small Homes Council-Building Research Council, 1964.

Stern, E. George. *Nailed Flinch Beams and Girders Providing New Opportunities in Wood Construction.* Preprint 82-002, Las Vegas, NV: Proceedings of American Society of Civil Engineers, 1982.


Stern, E. George. *Up-grading of Wood Structures by Use of Improved Mechanical Fasteners.* Preprint 80-525, Florida: Proceedings of American Society of Civil Engineers, 1980.


U.S. Department of Agriculture. *Standard Modular Foundations Panels for Houses of All Shapes.* Technical Bulletin 1541. Washington DC: Government Printing Office, 1976.

Ursell, C.R.; Taylor, D.; and Calcote. *Transportation Research, Volume 1, Permanent Perimeter Foundations for Manufactured Housing.* Final Report. San Antonio, TX: Southwest Research Institute, 1983.

Waldrup, Travis. *Mobile Home Anchoring Systems and Related Construction.* Lubbock, TX: Institute for Disaster Research, 1976.

Western Wood Products Association. *Treated Lumber Foundations: Conventional and Factory Built Modular Homes.* Portland, OR: Western Wood Products Association.

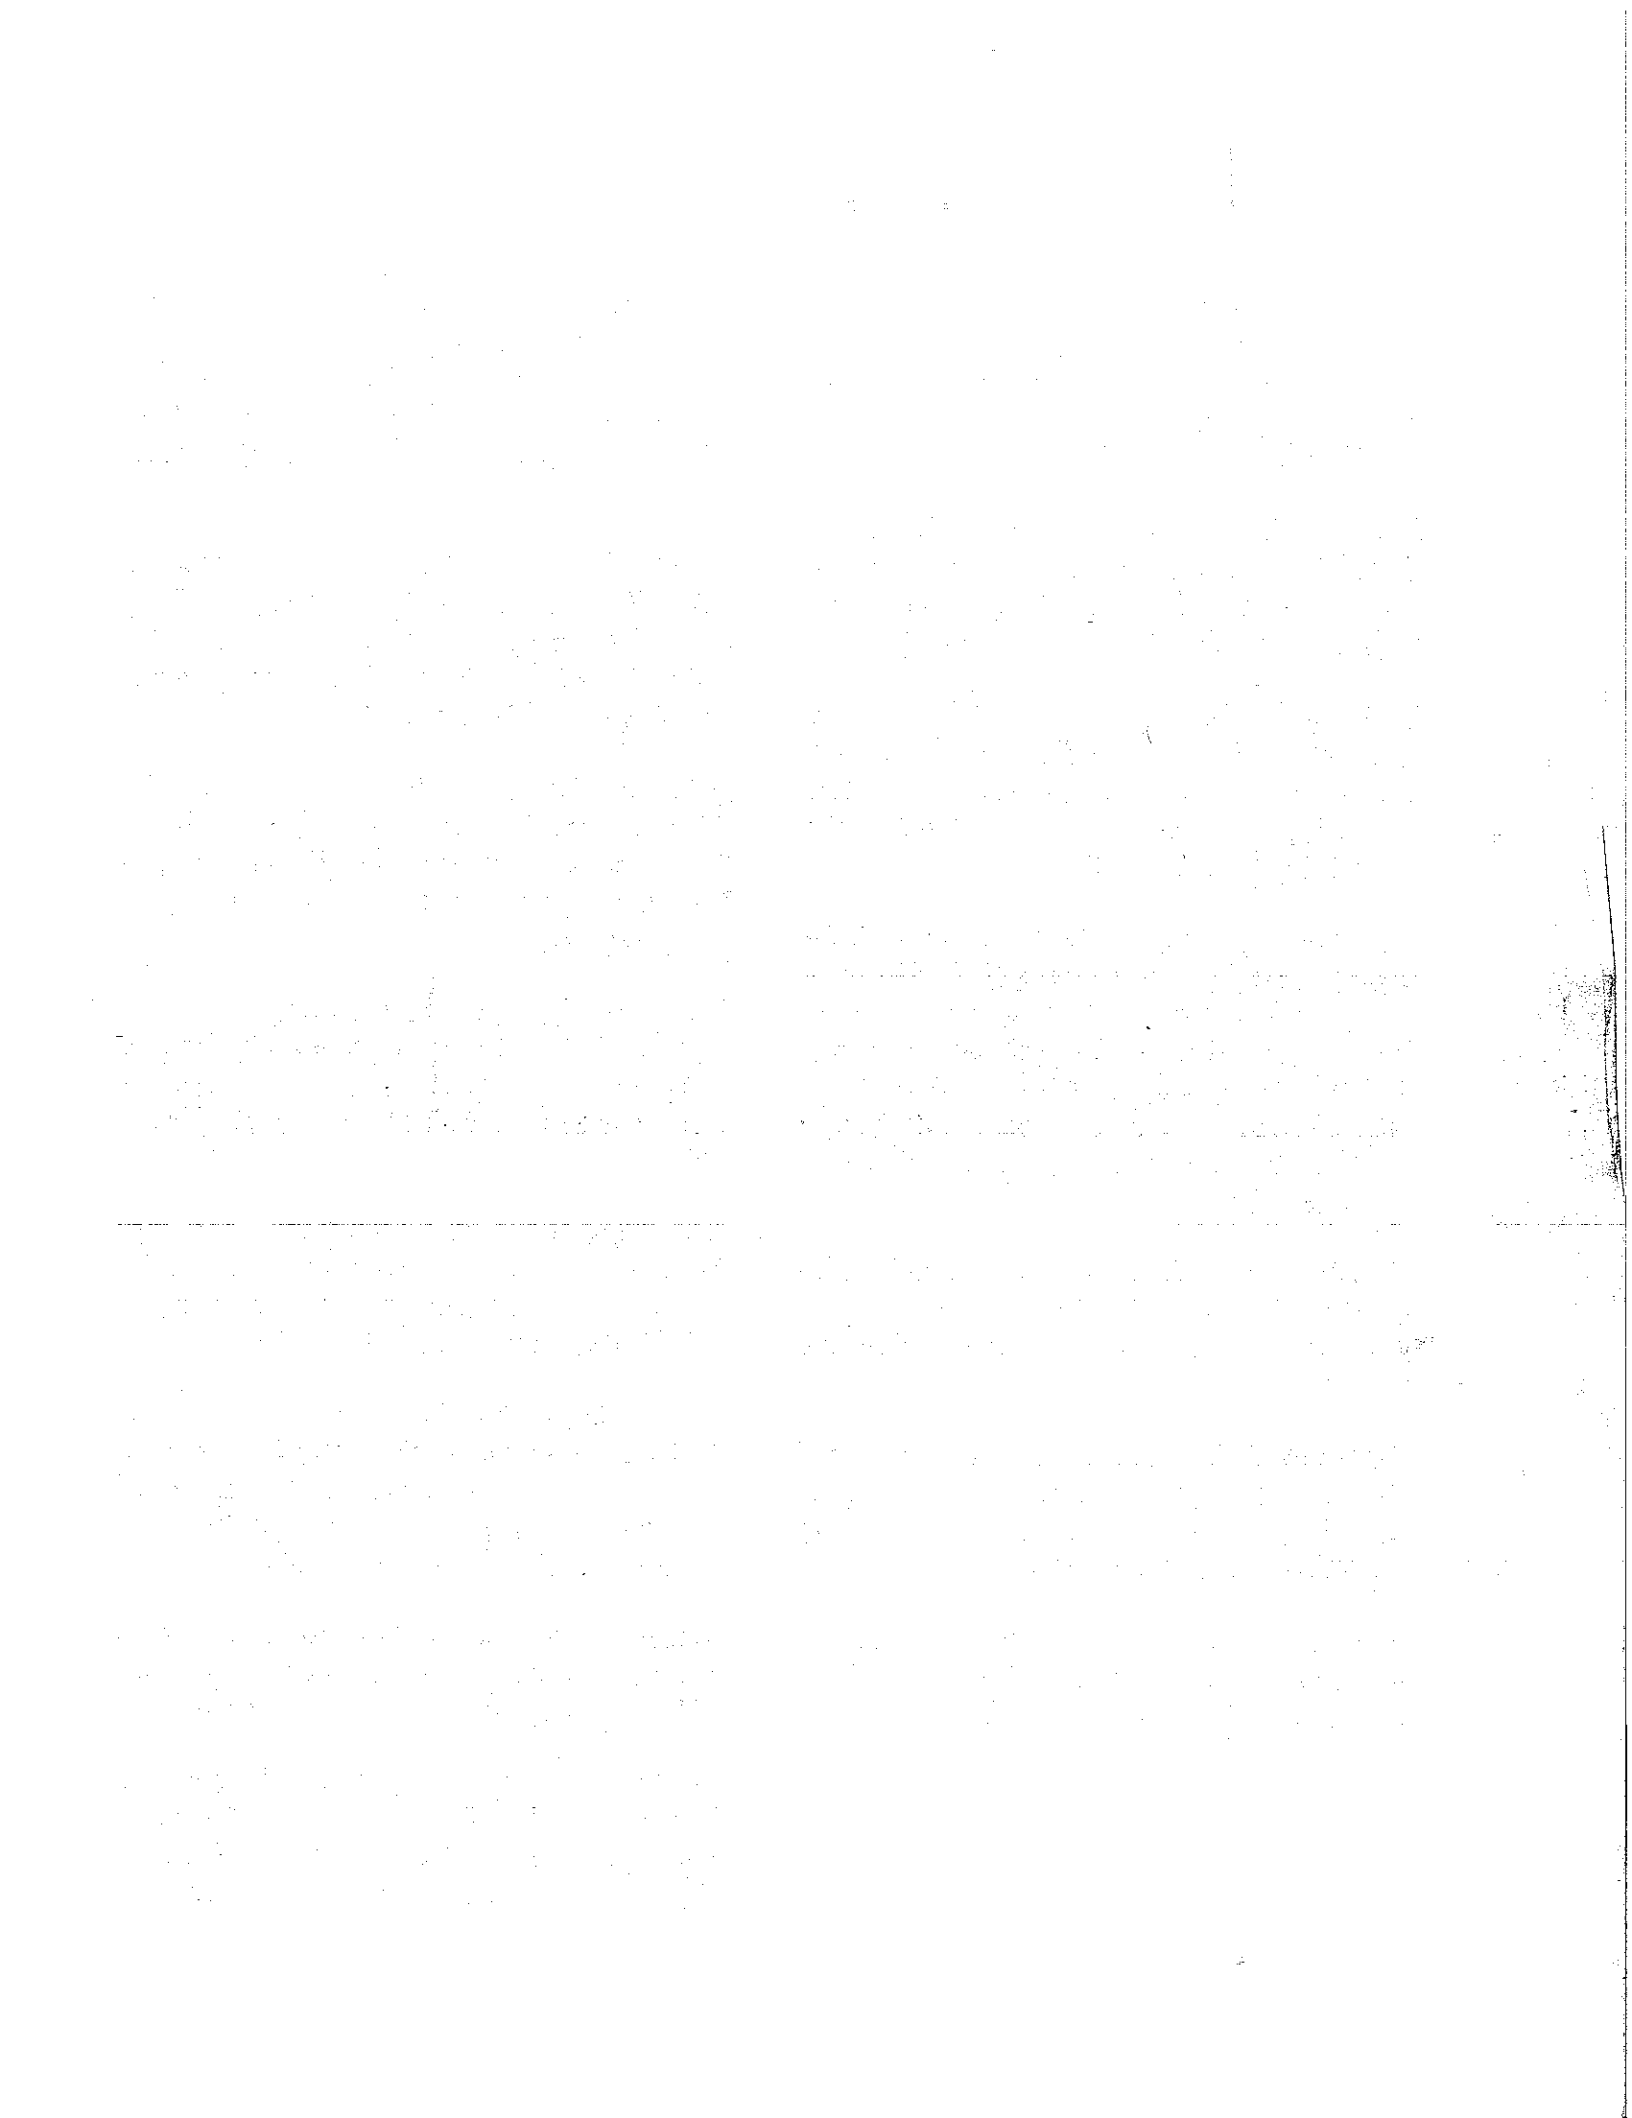

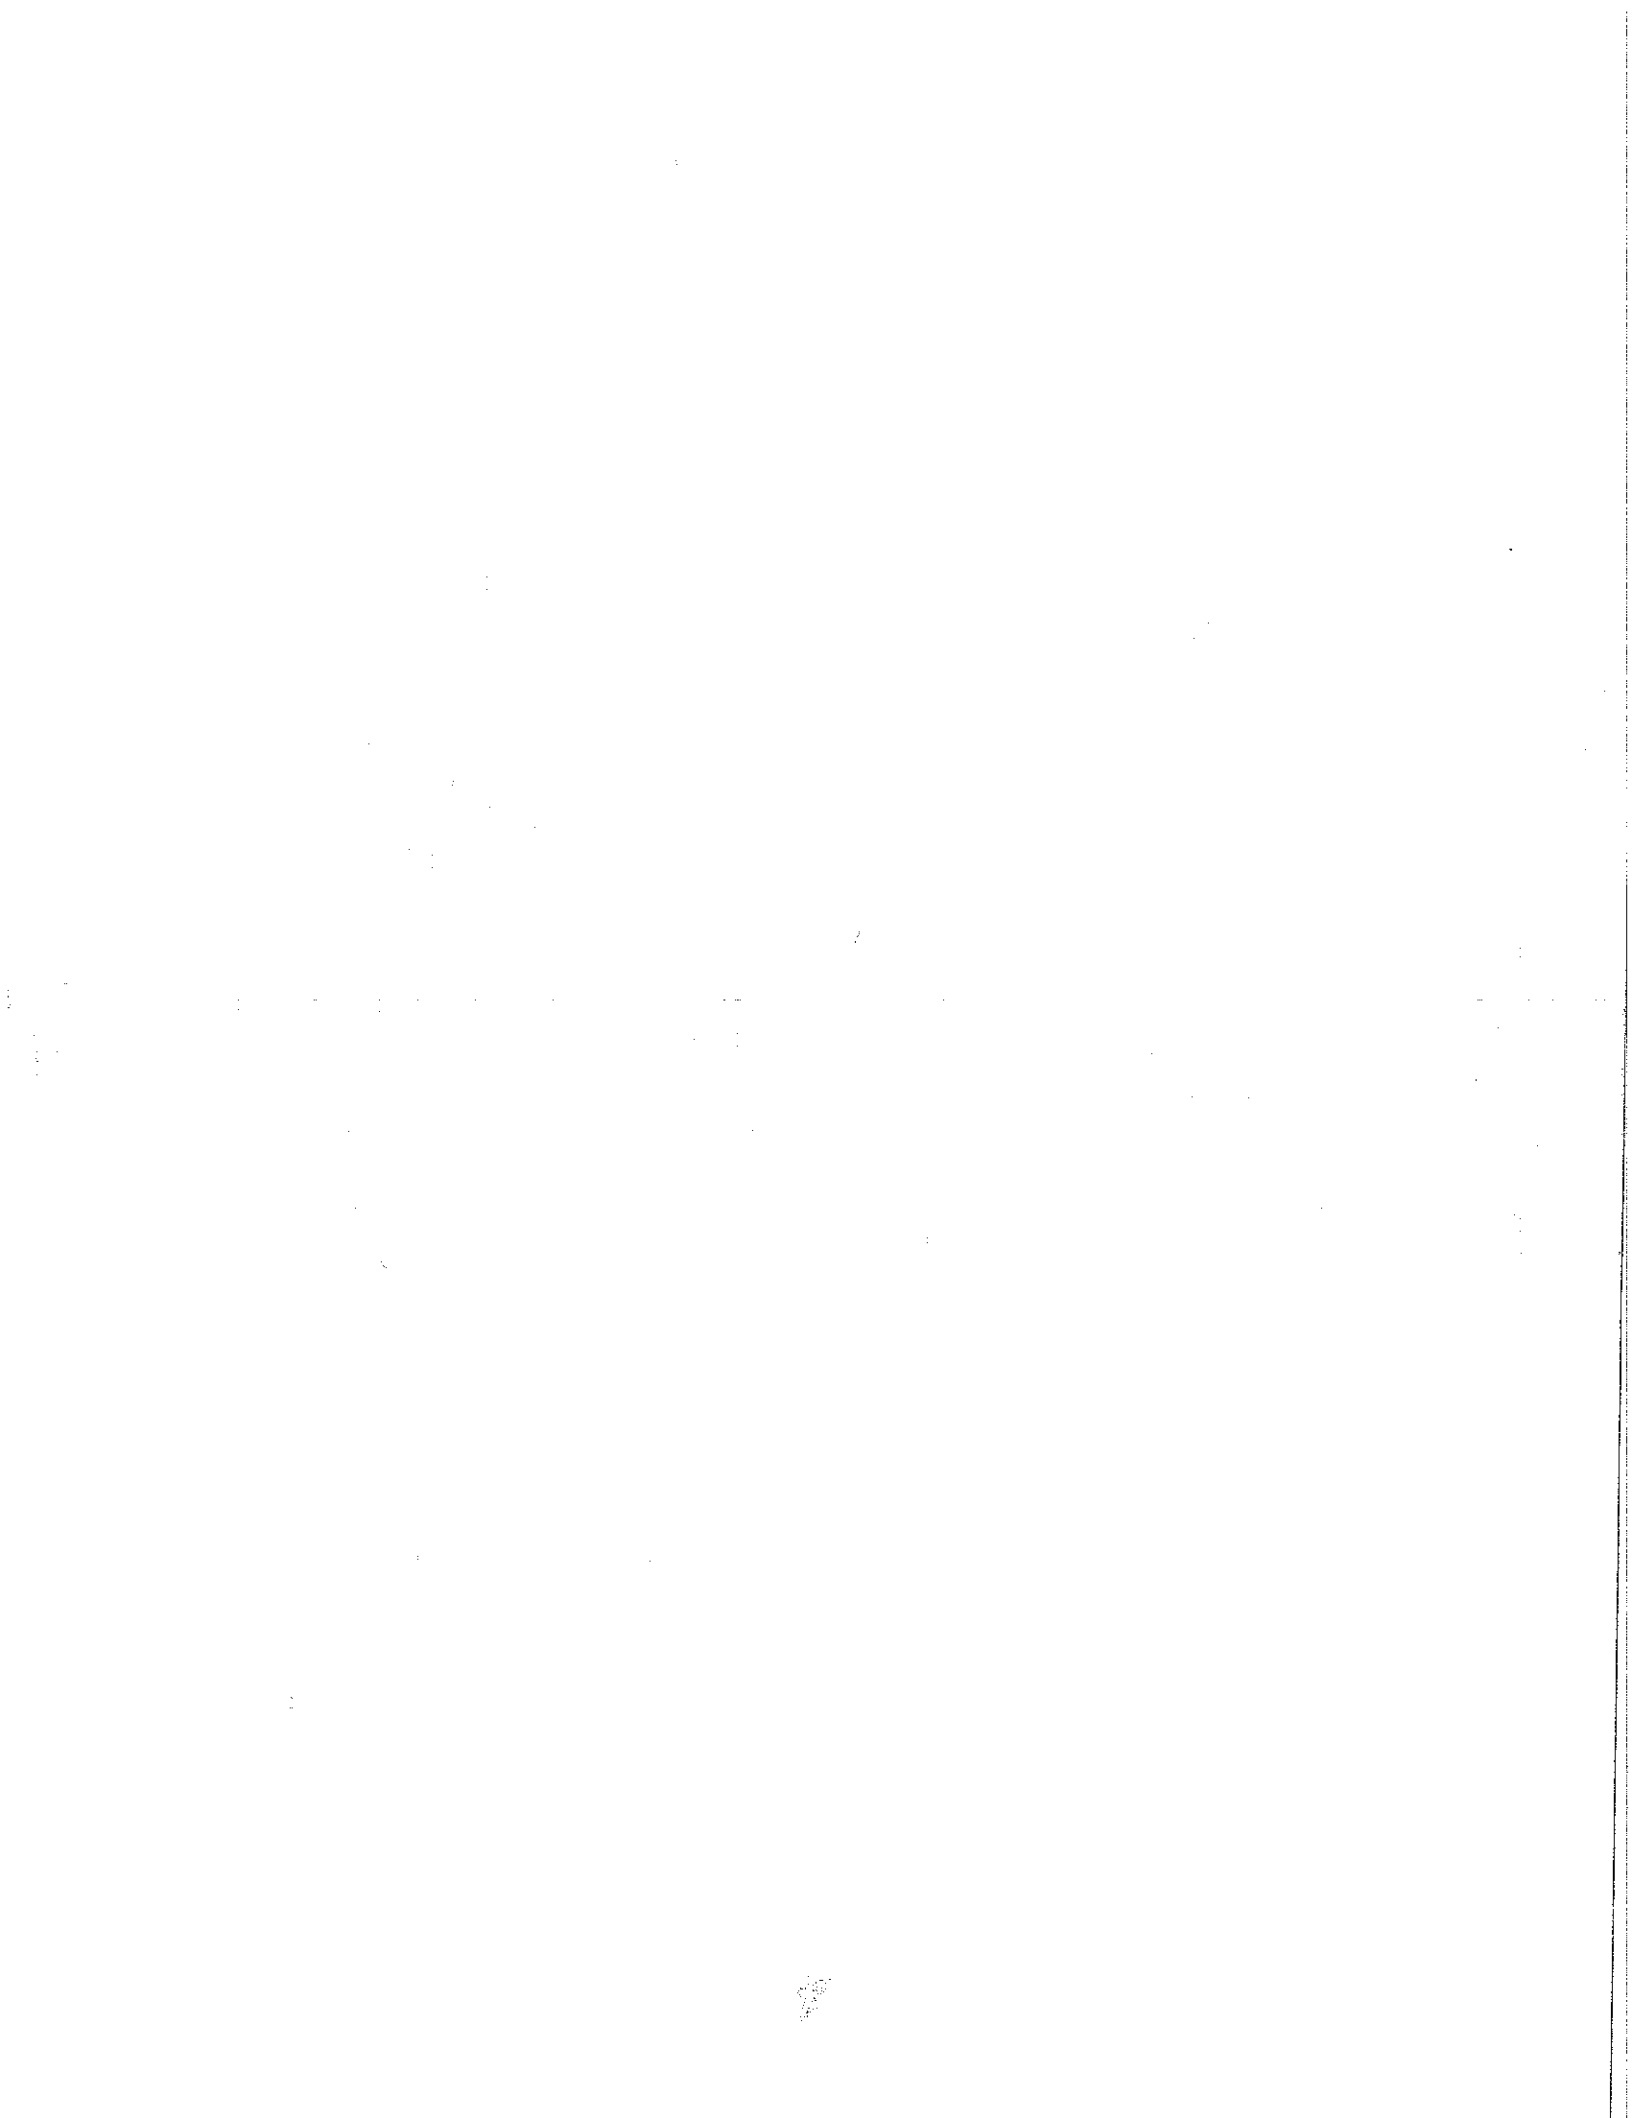

U.S. Department of Housing and Urban Development
HUDUSER
P.O. Box 6091
Rockville, MD 20849

FIRST CLASS MAIL
POSTAGE & FEES PAID
HUD
Permit No. G-795

Official Business
Penalty for Private Use \$300

December 1996

