

Deposition of Alternative (Syngas) Fuels on Turbine Blades with Film Cooling

FACT SHEET

I. PROJECT PARTICIPANTS

Drs. Jeffrey Bons and Thomas Fletcher, Brigham Young University, 435 CTB, PO Box 24201, Provo, Utah 84602

(801) 422-8036

jbons@byu.edu

Tom George, National Energy Technology Laboratory, P O Box 880, 3610 Collins Ferry Rd, Morgantown, WV 26507-0880

(304) 285-4825

tgeorg@netl.doe.gov

Richard Wenglarz, South Carolina Institute for Energy Studies, 386-2 College Ave., Clemson, SC 29634

(864) 656-2267

rwnglrz@clemson.edu

II. PROJECT DESCRIPTION

A. Objectives

This effort will address three critical technical issues associated with syngas use in gas turbines:

- (1) The effects of syngas deposition, erosion, and corrosion at elevated temperatures
- (2) The possibilities for deposit mitigation through surface sub-cooling
- (3) The influence of deposition (and TBC residual) on film cooling flows

B. Background/Relevancy

Background. Turbine inlet temperatures for large power generation gas turbines have been steadily increasing over the last several decades due to significant advances in materials and cooling technologies. At the same time, political and economic pressures are pushing utilities to consider fuel flexibility. Compared to “clean” burning natural gas, these alternative fuels (e.g. coal, petcoke, biomass) have higher concentrations of trace elements and ash that present significant corrosion challenges to turbine operation. If combustion products arrive at the turbine blade surface in the liquid (or vapor) phase, it is likely that they will deposit (or condense) there and accelerate material corrosion. A number of studies conducted in the 1970’s and 1980’s (before the dominant use of natural gas in gas turbines) showed that corrosive deposition is strongly dependent on temperature. Depending on the syngas fuel employed, the threshold temperature for deposition varied from 900C – 1100C. Above this threshold, studies showed up to an order of magnitude increase in deposition rates. Since those tests were conducted, several key technologies (e.g. thermal barrier coatings, advanced cooling schemes, and single crystal blades) have permitted substantial increases in firing temperatures (up to 1400C). The compatibility of these advances with ash-bearing syngas fuels has yet to be assessed.

Relevancy. With this research program, DOE and industry will gain valuable insights into factors affecting the safe, efficient operation of modern industrial turbines with alternative fuels. Findings may also be used to help establish maintenance guidelines and gas cleanup specifications for IGCC plants. Ultimately, this will reduce the time and cost to certify and commercialize modern gas turbines operating with syngas fuels.

C. Period of Performance. 1 Aug 2005 – 31 July 2008

D. Project Summary

Under the University Turbine Research (UTSR) program, Brigham Young University is investigating the negative impacts of alternative fuel use in modern gas turbines. In Phase 1, deposition studies will be conducted in BYU's accelerated turbine deposition facility to document the influence of temperature on deposition, erosion, and corrosion from syngas fuels. This research will be conducted by seeding a natural gas combustor with coal and biomass products of combustion and accelerating them onto target turbine materials. Combustion byproducts will be prepared from industry donations and/or BYU's operating coal and biomass reactors. BYU's accelerated turbine deposition facility matches both the impact velocity and gas temperature of modern industrial turbines. Arrangements are in place with industrial contacts at GE, Solar, Praxair, and Siemens to make available modern turbine materials and coatings as targets for this study. Once syngas deposits are formed on the target, various analyses will be conducted, including: surface mapping, roughness assessment, deposit thermal conductivity measurement, and elemental decomposition with corrosion assessment. Elemental analyses will employ existing diagnostic equipment including: scanning electron microscopy, inductively-coupled plasma with atomic absorption, and x-ray analysis for quantitative analysis of deposits. Phase 1 of the proposed research will also explore the possibility of sub-cooling the turbine surface to mitigate deposition. This will be accomplished by cooling the backside of the target coupon, similar to internal convection cooling in a turbine blade.

Phase 2 will evaluate the influence of deposit formation on film cooling flows. This study will be accomplished in the same turbine deposition facility by injecting coolant from film holes in the target coupon. Sections of turbine blades with cooling holes will be solicited for this effort so that the coolant hole geometry is representative of current practice. Deposits in and around cooling holes will be measured and analyzed.

During the optional 3rd year of the research program, scaled models of the deposit-laden film holes will be installed in a low-speed wind tunnel at BYU for flow and heat transfer assessments. A 3-D PIV system and IR camera will be used to gather 3-dimensional velocity data as well as surface heat transfer and film effectiveness. The data density available from these sophisticated diagnostics will provide an important database for CFD validation. This phase will also consider the effects of TBC residue left in film holes during the plasma-spray application process since it is likely that this residue bears resemblance to deposits formed during turbine operation.

III. PROJECT COSTS

\$399,422

IV. MAJOR ACCOMPLISHMENTS SINCE BEGINNING OF PROJECT

- Facility redesign to allow backside impingement and film cooling of turbine test articles was completed (see Fig. 1). Validation testing has been successful.
- Completed testing sequence to measure deposition rate (particulate capture efficiency) as a function of flow temperature in the absence of test article cooling. Figure 2 shows the observed trend using 3 μ m mean diameter coal ash particulate. There is a clear threshold for particle deposition beginning near 1000C. This result is consistent with previous work by BYU and others.
- Completed testing sequence to measure deposition rate (particulate capture efficiency) as a function of particulate size. Figure 3 shows the observed trend using coal ash particulate at a constant gas temperature of 1150C (no cooling). Deposition appears to reach an asymptote

at low particle diameters consistent with those that typically make it through filtration systems ($\sim 3\mu\text{m}$).

V. MAJOR ACTIVITIES PLANNED DURING THE NEXT 6 MONTHS

- Conduct deposition testing with backside cooling.
- Conduct post-test analyses of deposition specimens (backscatter SEM)
- Repeat testing sequence with alternate synfuel particulate (petcoke or biomass).
- Perform real time measurement of test coupon thermal resistance with and without deposition.

VI. MAJOR ACCOMPLISHMENTS PLANNED IN OUTYEARS (6-18 MONTHS)


- Redesign for film cooling studies
- Conduct film cooling deposition experiments.

VII. ISSUES


Initial attempts to measure post-test deposit thermal resistance have been unsuccessful. We are pursuing an in-situ measurement using 2-color IR thermography.

VIII. ATTACHMENTS

See figures 1-3 below.

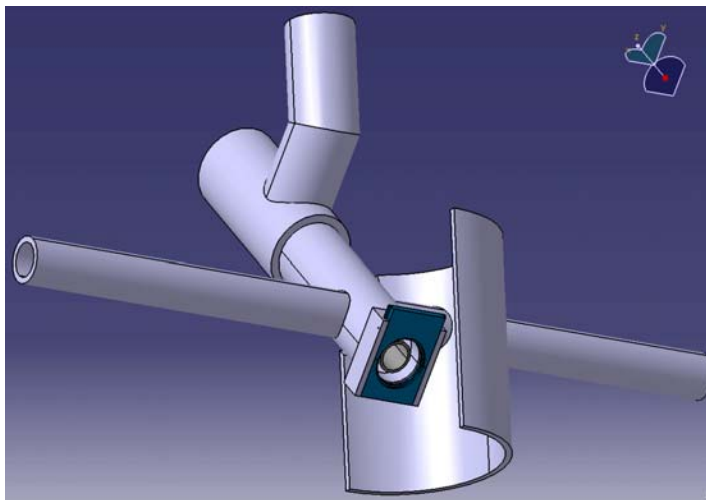

(a) Redesigned coupon holder

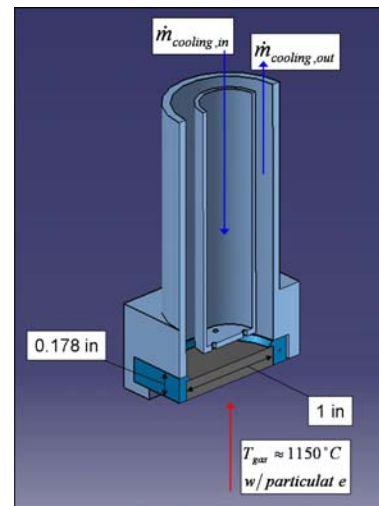

(b) Impingement Cooling

Figure 1: TADF test coupon holder redesign with backside cooling.

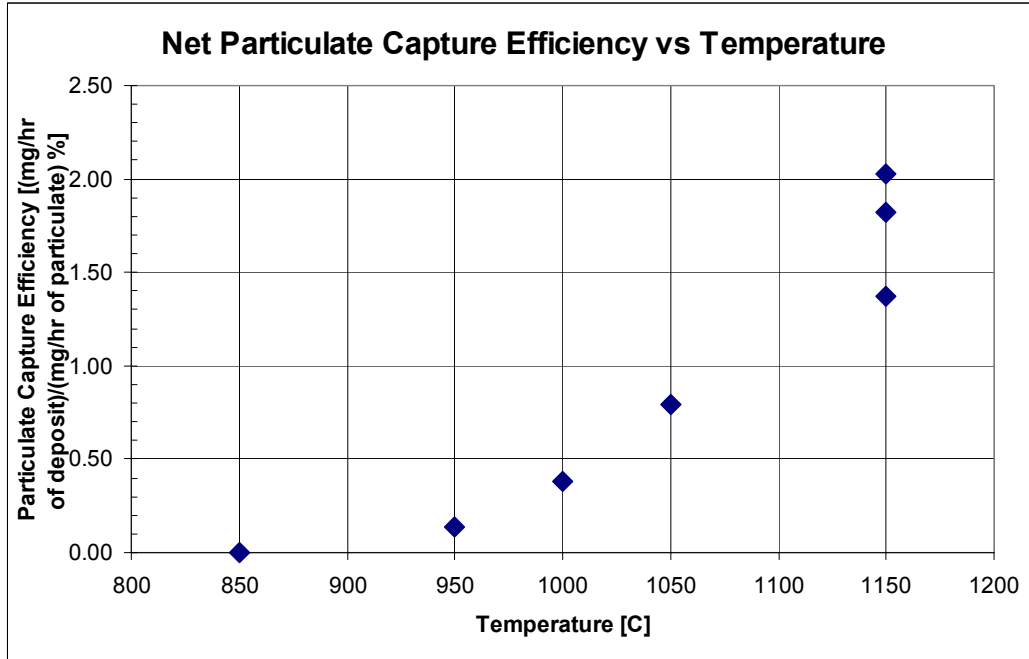


Figure 2: Particulate capture efficiency vs. flow temperature for 3µm diameter coal particulate

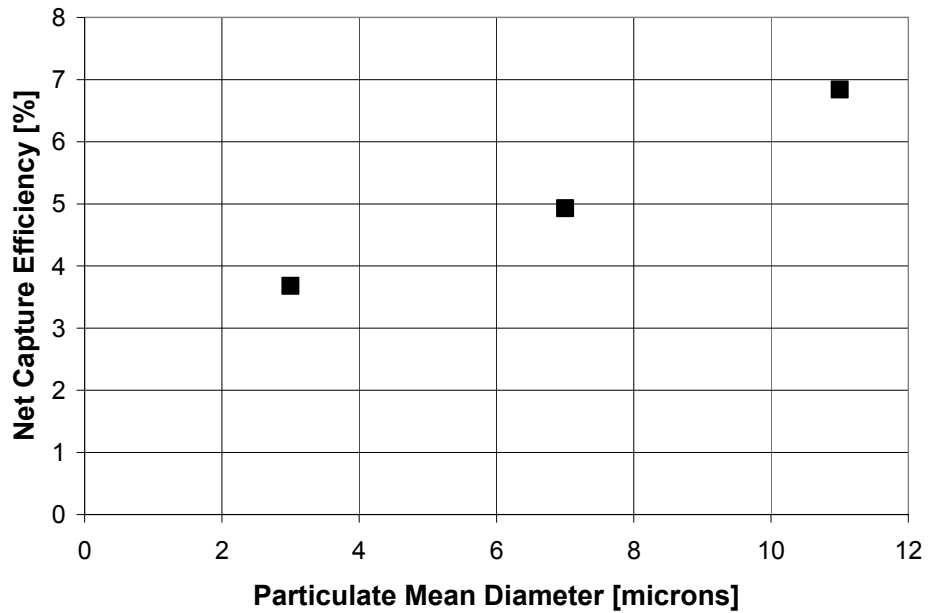


Figure 3: Particulate capture efficiency vs. mean diameter for coal particulate at 1150C