
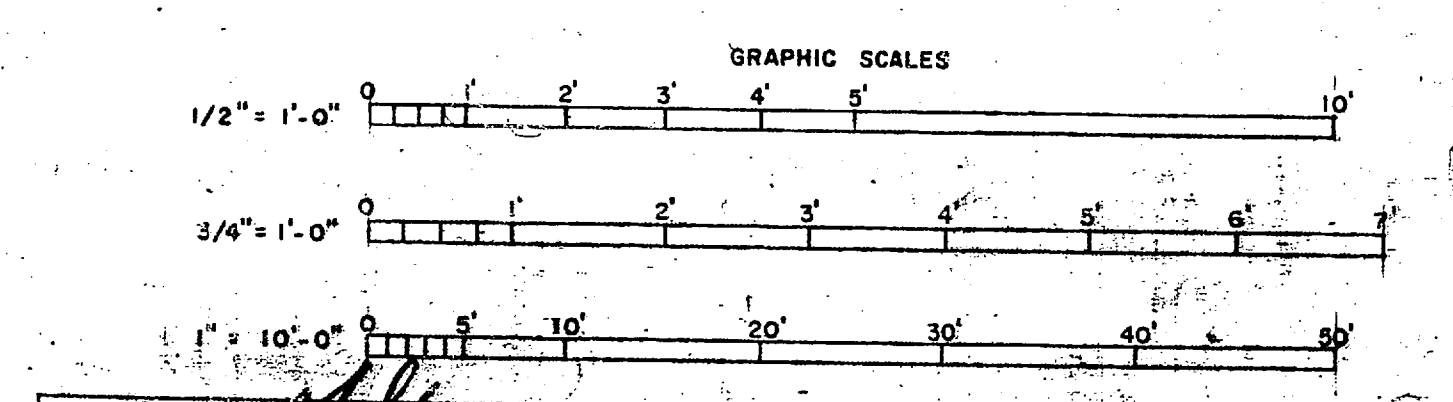


LEGEND

- RAW WATER LINE
- TREATED WATER LINE
- DRAIN LINE
- SAMPLING LINE
- GATE VALVE
- REDUCER
- CHLORINE CONDUIT
- SANITARY SEWER
- UG FUEL TANK
- VENTURI PRESSURE LEADS
- EXIST WATER LINE

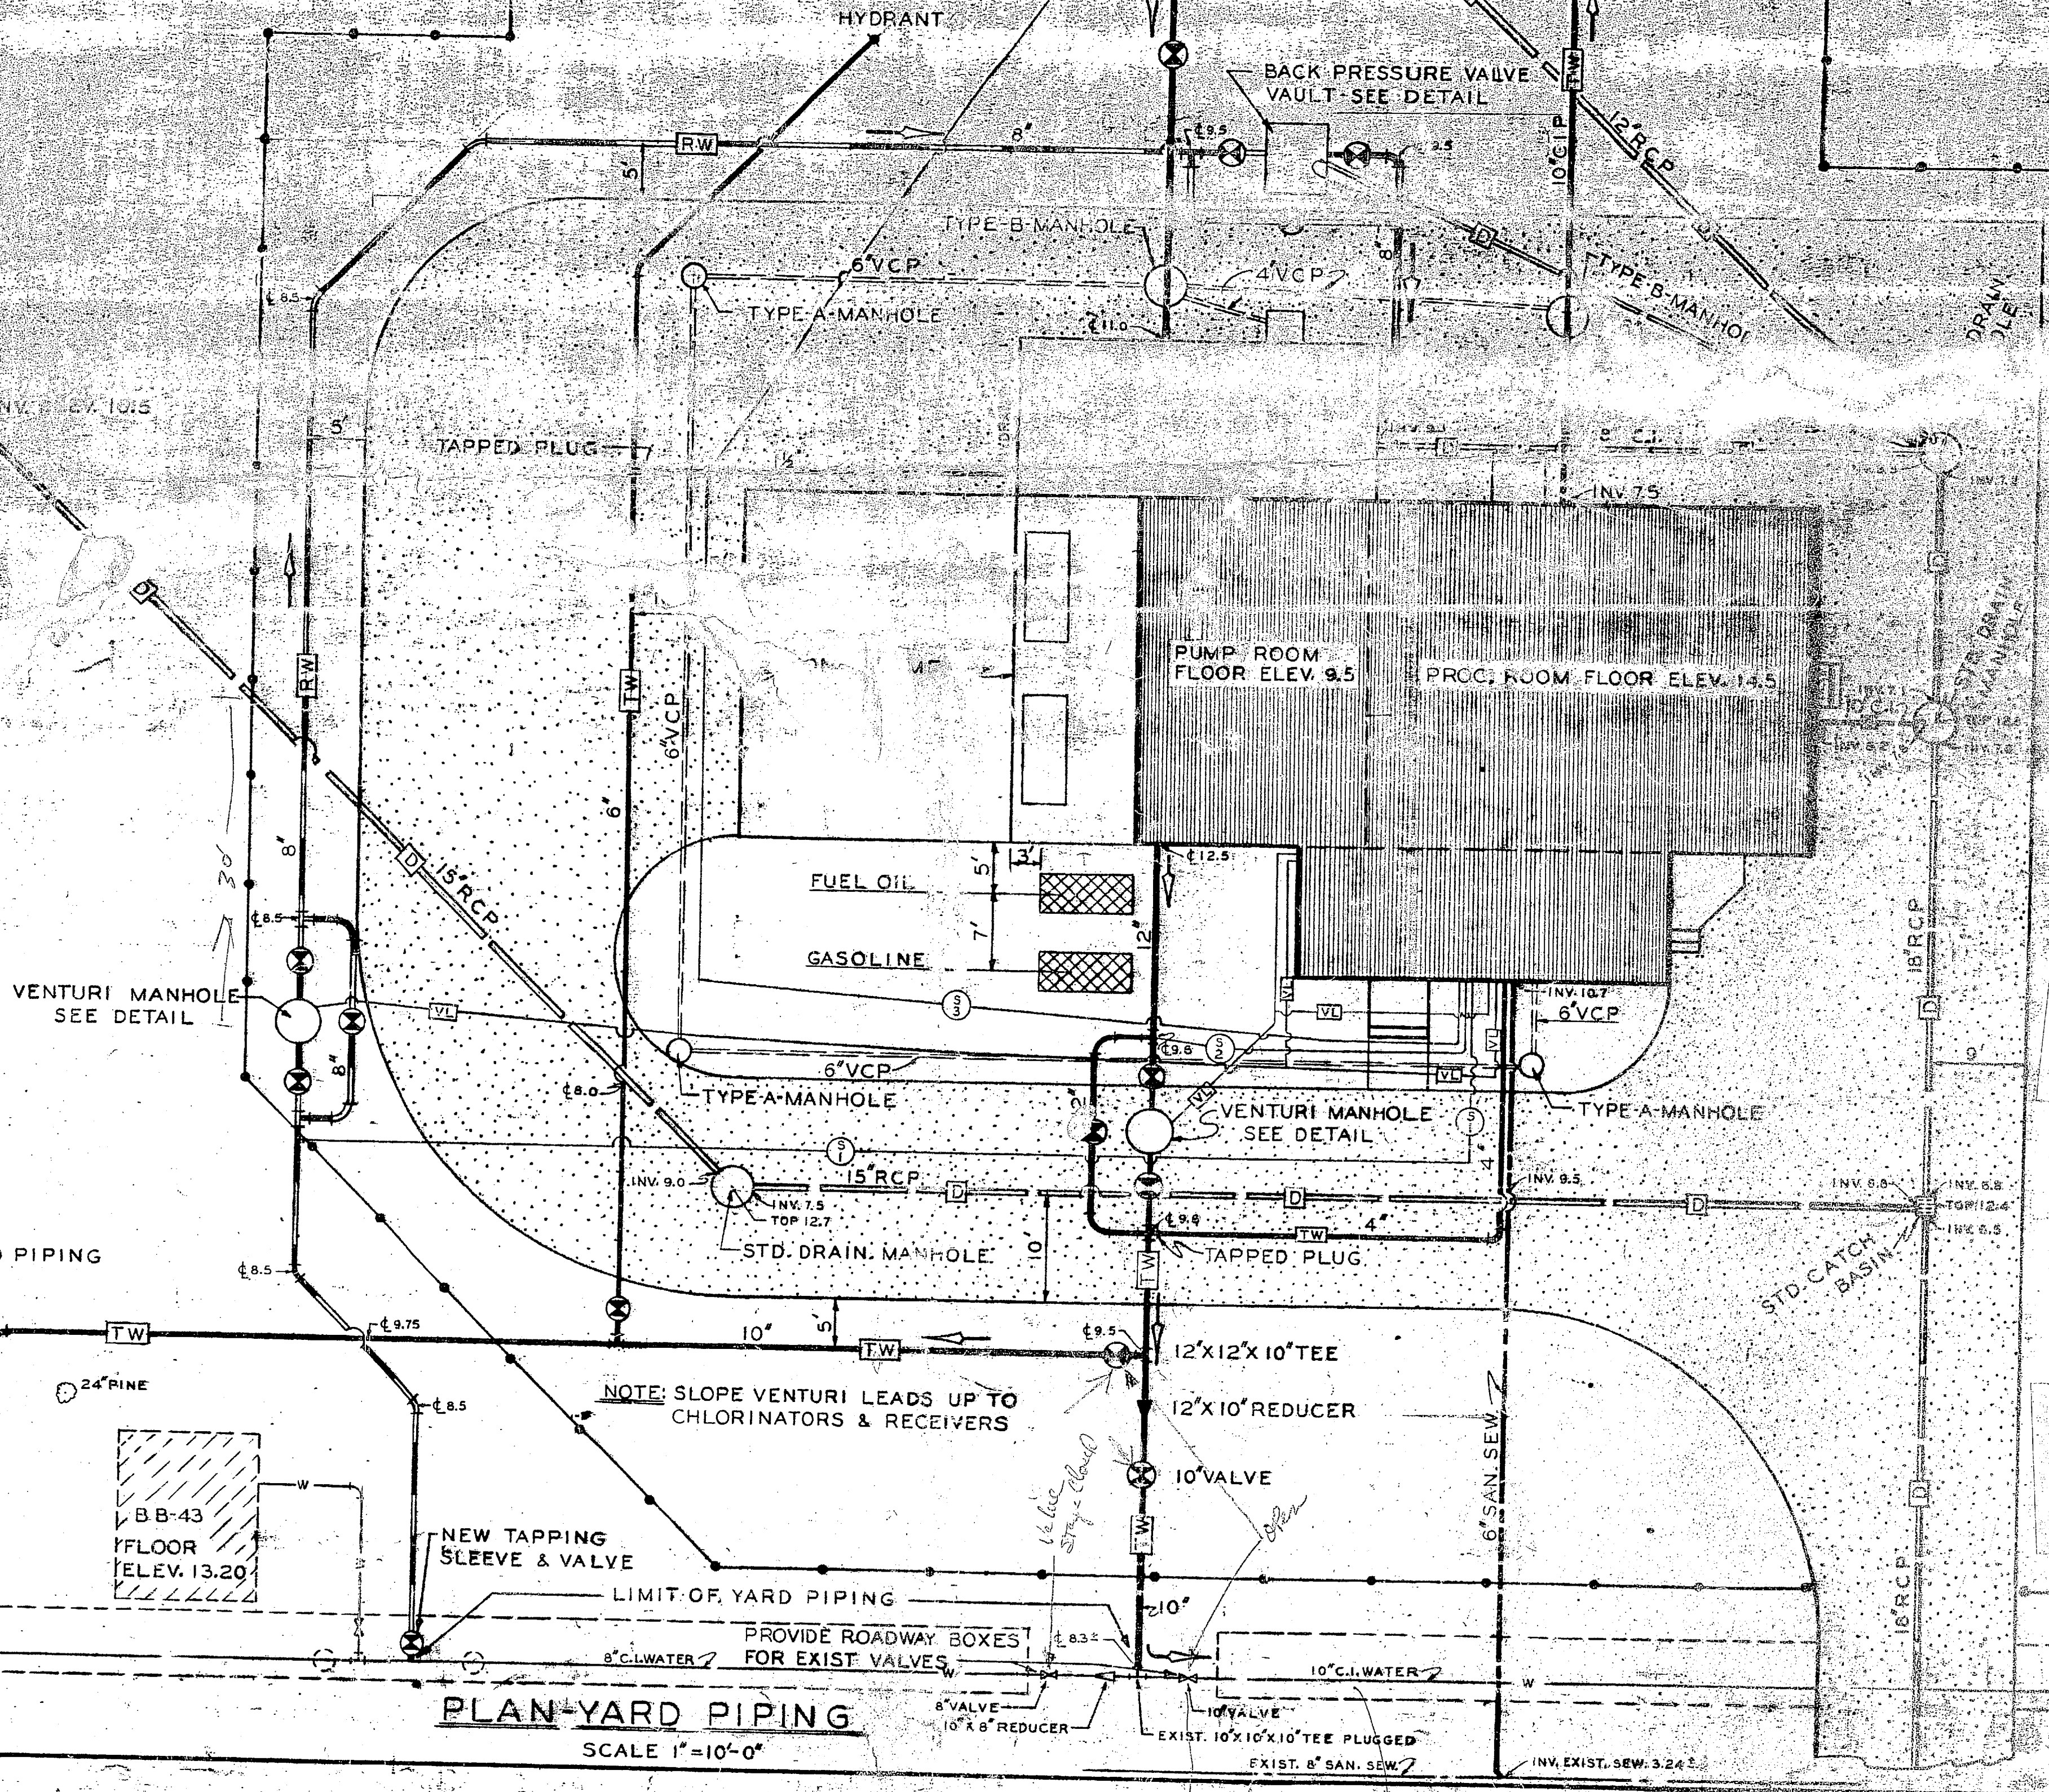

REVISION	DATE	APPD.	DESCRIPTION	BY
PW DRAWING NO.				
MARINE CORPS BASE CAMP LEJEUNE, N. C. ATLANTIC DIV. NAV. FAC. ENG. COMMAND, NORFOLK, VA				
WATER TREATMENT PLANT COURTHOUSE BAY				
YARD PIPING				
DESIGNED BY	DATE	DRWN BY	DATE	TR
CHKD BY	DATE	IN CHARGE	DATE	
RVD BY	DATE	LAINT BOOKS	DATE	
SR. MGR.	DATE	APPROVED	DATE	
DIR. DES.	DATE	PUBLIC WORKS OFFICER	DATE	
SATISFACTORY		SATISFACTORY TO		APPROVED
THE COMMANDING GENERAL MARINE CORPS BASE, CAMP LEJEUNE, N. C.		THE QUARTERMASTER GENERAL OF THE MARINE CORPS		SCALE GRAPHIC
DATE	DATE	DATE	DATE	SPEC 8836A-2
				SHEET 16 OF 21
				NO. 88313
				NAVAFAC DRAWING NO. 110836

N62470-68-B-0020

