

Simplex

TIME RECORDER CO.
GARDNER, MASS., U.S.A.

ALL DIMENSIONS IN INCHES
UNLESS OTHERWISE SPECIFIED

NAME SUPERVISORY ALARM PANEL

PART No.

1840-645

REV.

ORDER No. RPQ No. 1877B ^A

TOLERANCES:
FRACTIONAL $\pm \frac{1}{64}$
DECIMAL $\pm .003$
ANGULAR $\pm \frac{1}{4}^\circ$

REMOVE ALL SHARP EDGES & BURRS $\frac{1}{64}$ MAX.

DESIGNER

CHECKED

MATERIAL

FINISH

HEAT TREATMENT

DO NOT SCALE DRAWING
WORK TO DIMENSIONS ONLY


DRAFTSMAN

APPROVED

LA 5-19-72

RELEASED FOR ASSEM. NO. QUAN. PER UNIT

E.C.O.	SYM	LOC	CHANGE	DATE
	^A	3A	WAS RPQ16783	DD 1-30-74
	^B	8C	ADDED NOTE	DD 1-30-74

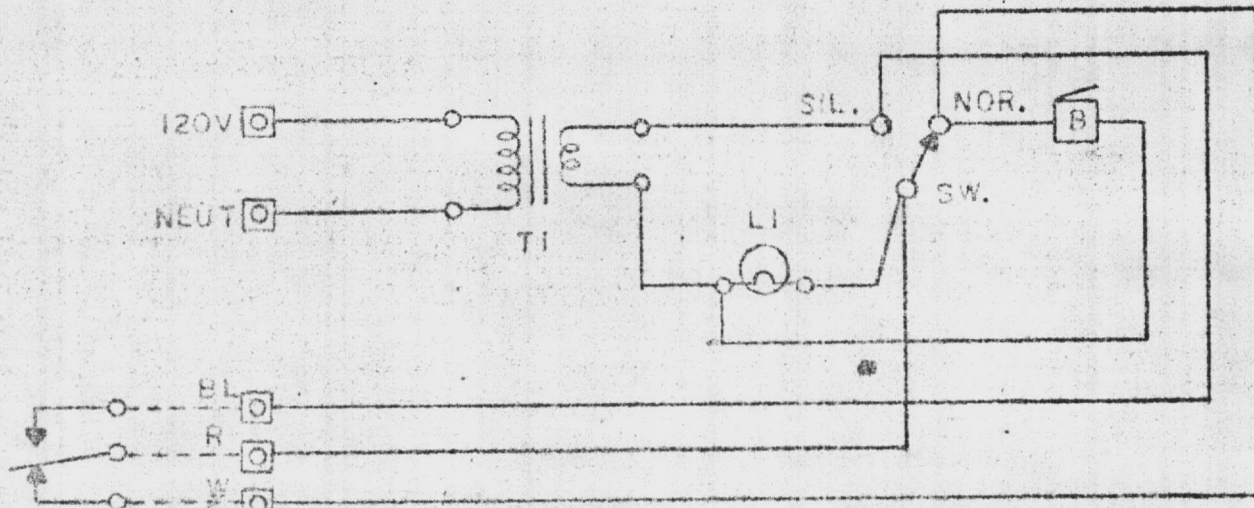

^A **FACTORY NOTE:**
COVER ALL EXPOSED
TERMINALS AND
CONNECTIONS WITH
PROPER INSULATING
MATERIALS.

TERMINALS MOUNTED ON SIDE OF CABINET. ALL OTHER
COMPONENTS MOUNTED ON DOOR PANEL.

* SUPERVISORY CONTACTS LOCATED IN MASTER BOX
AIR PRESSURE SWITCH OR SIMILAR CONTROL SWITCH.

ITEM	PART No.	QTY.	NAME
SW	452-009	1	SWITCH
B	130-004	1	BELL
LI	274-099	1	LAMP
TI	478-185	1	TRANSFORMER

1840-645

PART No. 1840-645

