



DETAILS-BACK PRESSURE VALVE VAULT

55
445
59.45
46.50
12895
11.15

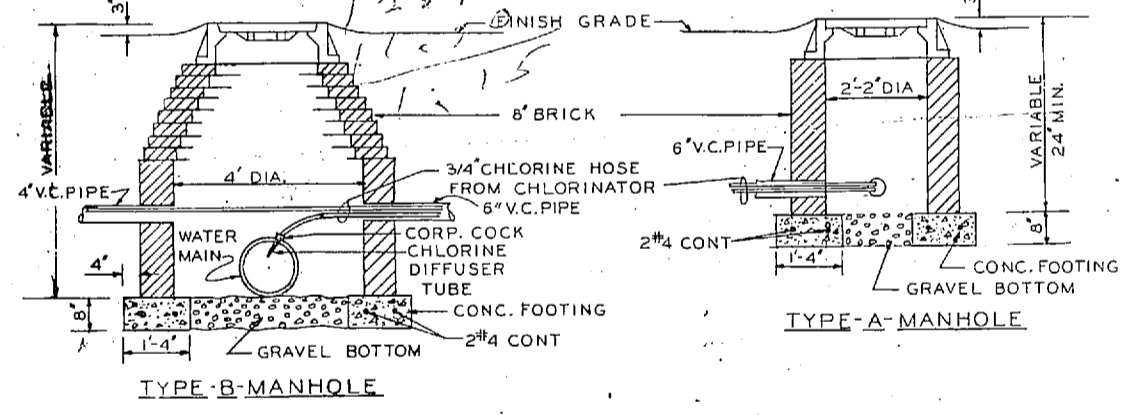


TYPICAL CHLORINATION MANHOLES
NO SCALE

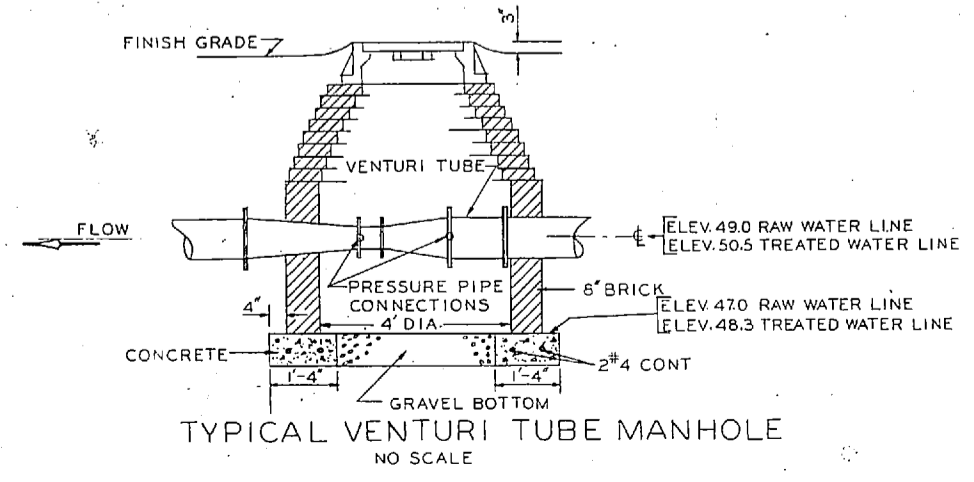


TYPICAL VENTURI TUBE MANHOLE
NO SCALE

- LEGEND**
- RAW WATER LINE
 - TREATED WATER LINE
 - DRAIN LINE
 - SAMPLING LINE
 - GATE VALVE
 - REDUCER
 - CHLORINE CONDUIT
 - SANITARY SEWER
 - U G FUEL TANK
 - VENTURI PRESSURE LEADS

NOTE: SLOPE VENTURI LEADS UP TO CHLORINATORS & RECEIVERS.

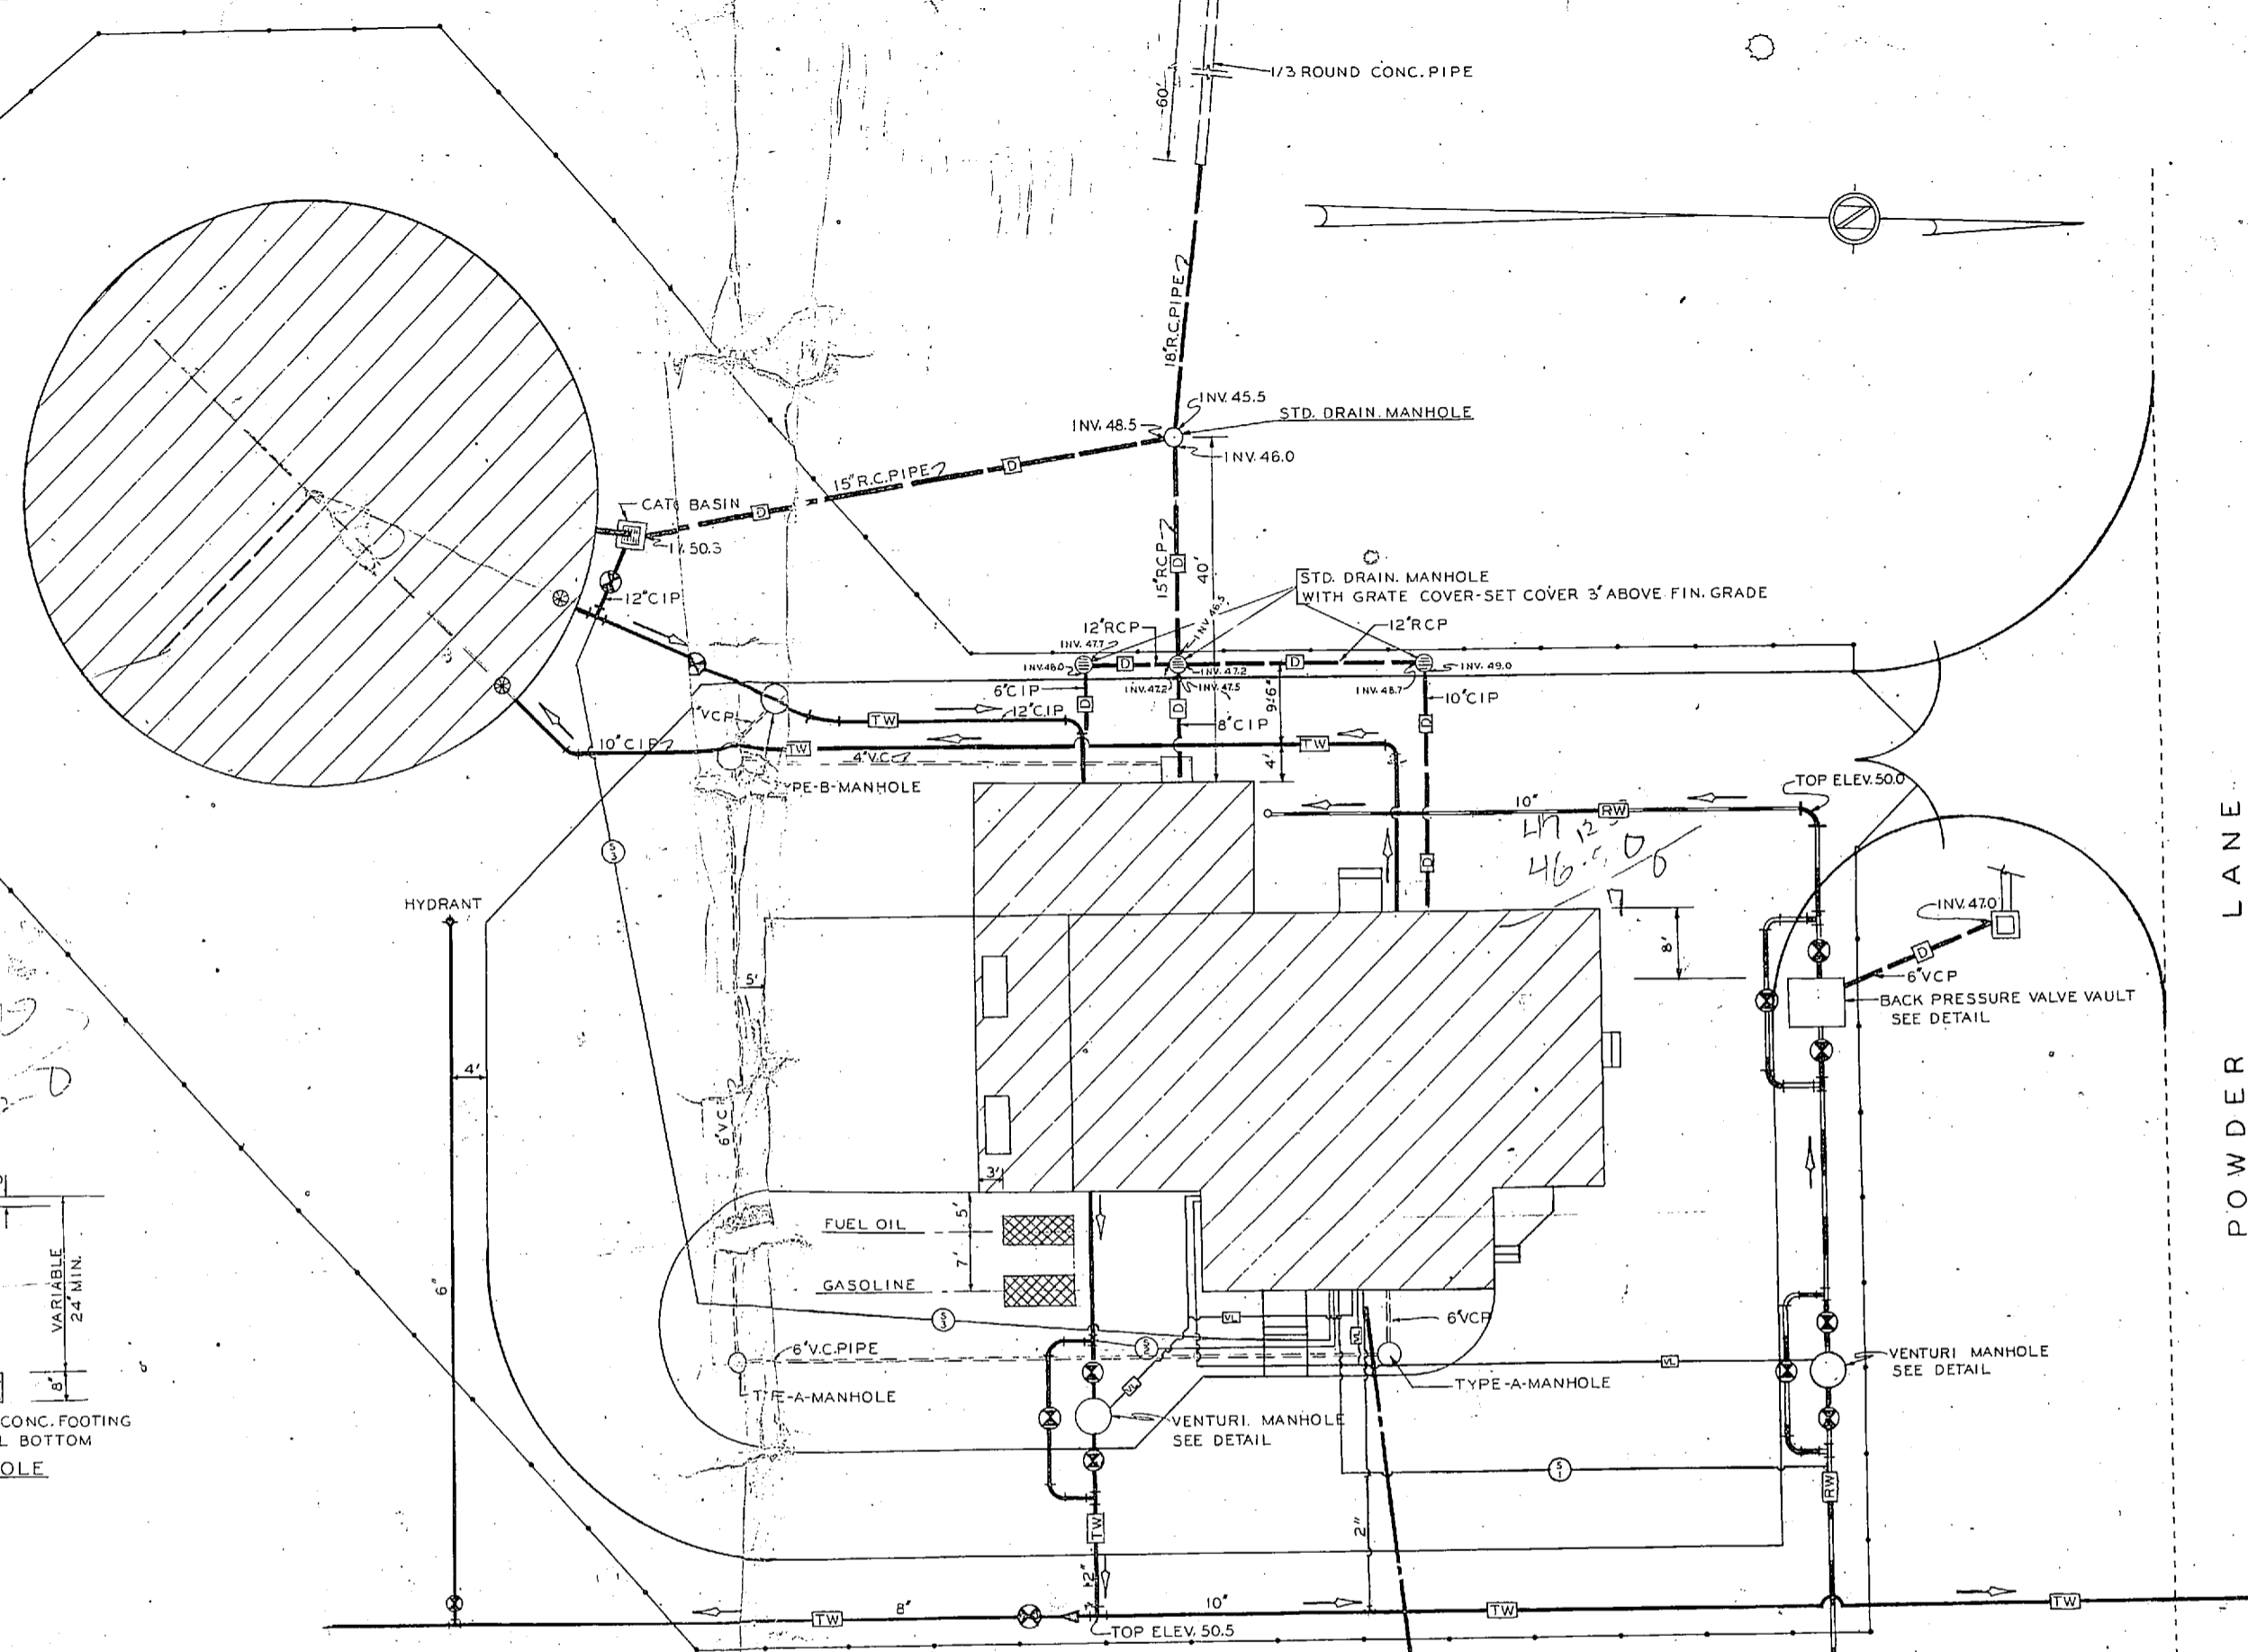

PLAN-YARD PIPING
SCALE 1"=10'-0"

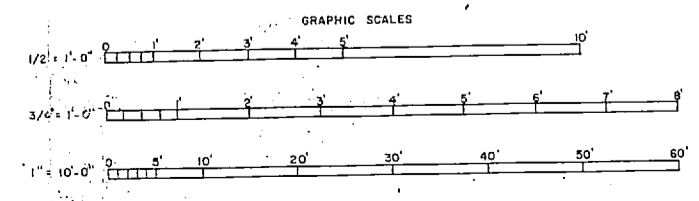

REVISION	DATE	APPD.	DESCRIPTION	BY
1				

MARINE CORPS BASE
CAMP LEJEUNE, N. C.
ATLANTIC DIV. BUREAU OF YARDS & DOCKS, NORFOLK II, VA.

WATER TREATMENT & STORAGE FACILITIES, WEAPONS TRAINING FACILITY

YARD PIPING

CATEGORY CODE NO. 2000

SATISFACTORY TO: *[Signature]*
THE COMMANDING GENERAL
MARINE CORPS BASE, CAMP LEJEUNE, N.C.

DATE: 10 July 1963

APPROVED FOR BUREAU OF YARDS & DOCKS: *[Signature]*
FOR BUREAU OF YARDS & DOCKS FOR CHIEF OF BUREAU: *[Signature]*
DATE: 13 JAN 1964

SCALE: GRAPHIC
SPEC: 54077/63
SHEET: 14 OF 19
NO: 54077
Y & D DRAWING NO.: **957513**

