

INSPECTION REPORT-BOILERS
 NAVFAC 9-11014/41 (3/67)
 Supersedes NAVDOCKS 2544
 S/N 0105-LF-004-0000

DATE OF INSPECTION
 11-4-76

TYPE OF INSPECTION
 A INTERNAL & EXTERNAL B INTERNAL & EXTERNAL WITH PRESSURE TEST C OPERATIONAL

1. FROM
 Base Maint Officer Camp Lejeune NC.

2. TO
 Commandant Hodges Marine Corps (Cide LFF)

14. CERTIFICATE ISSUED YES NO
 EXPIRES 7-2-77
 15. BOILER INSPECTOR
 E.O. Mobley

NAVY OR NATIONAL BOARD NO.
 NAV PAC 101
 16. REASON FOR NOT ISSUING CERTIFICATE

BOILER DATA

3. MANUFACTURER
 Kewanee

4. PROPERTY NO. 9	5. MFG. SERIAL NO. M 9903	6. MFG. MODEL NO. 3R-1F
7. BUILDING NO. 3504	8. YEAR BUILT 1965	9. CAPACITY 324,000 BTU/HR

10. FUEL (Check)
 COAL OIL GAS

11. PRESSURE
 DESIGNED 30 psi OPERATING 12 psi TEST - psi

12. FEED WATER TREATMENT
 SATISFACTORY UNSATISFACTORY

13. TYPE
 WATER TUBE FIRE TUBE C. I.

17. BOILER USE
 Heating

19. COMBUSTION
 9.0 % CO₂ % EXCESS O₂

18. COMBUSTION CONTROL (Mfg. Name)
 Honeywell

20. FLUE GAS TEMPERATURE
 AFTER BOILER 425 °F ; AFTER HEAT TRAP °F

SAFETY DEVICES
SAFETY VALVES

21. MANUFACTURER Watts	22. NUMBER AND SIZE 1-3/4"	23. PSI SETTING 30	24. CONDITION Good
---------------------------	-------------------------------	-----------------------	-----------------------

STEAM PRESSURE GAUGE

25. MANUFACTURER
 U.S. GAGE

26. CORRECTIONS
 WATER LEG CONSTANT _____ psi; OTHER _____ psi

27. REASON IF NOT TESTED


FIRING EQUIPMENT

ITEM	IN SERVICE	ALTERNATE
28. MANUFACTURER	Kewanee	None
29. TYPE	Nozzle Spray Press Atom.	
30. FUEL GRADE	#2	

31. INSPECTOR'S COMMENTS
 O.K.

32. ATTACHMENT(S) (Check)
 COPY OF INSPECTOR'S REPORT SPECIAL COMMENTS

33. SIGNATURE
 Daniel L. White
 BY DIRECTION

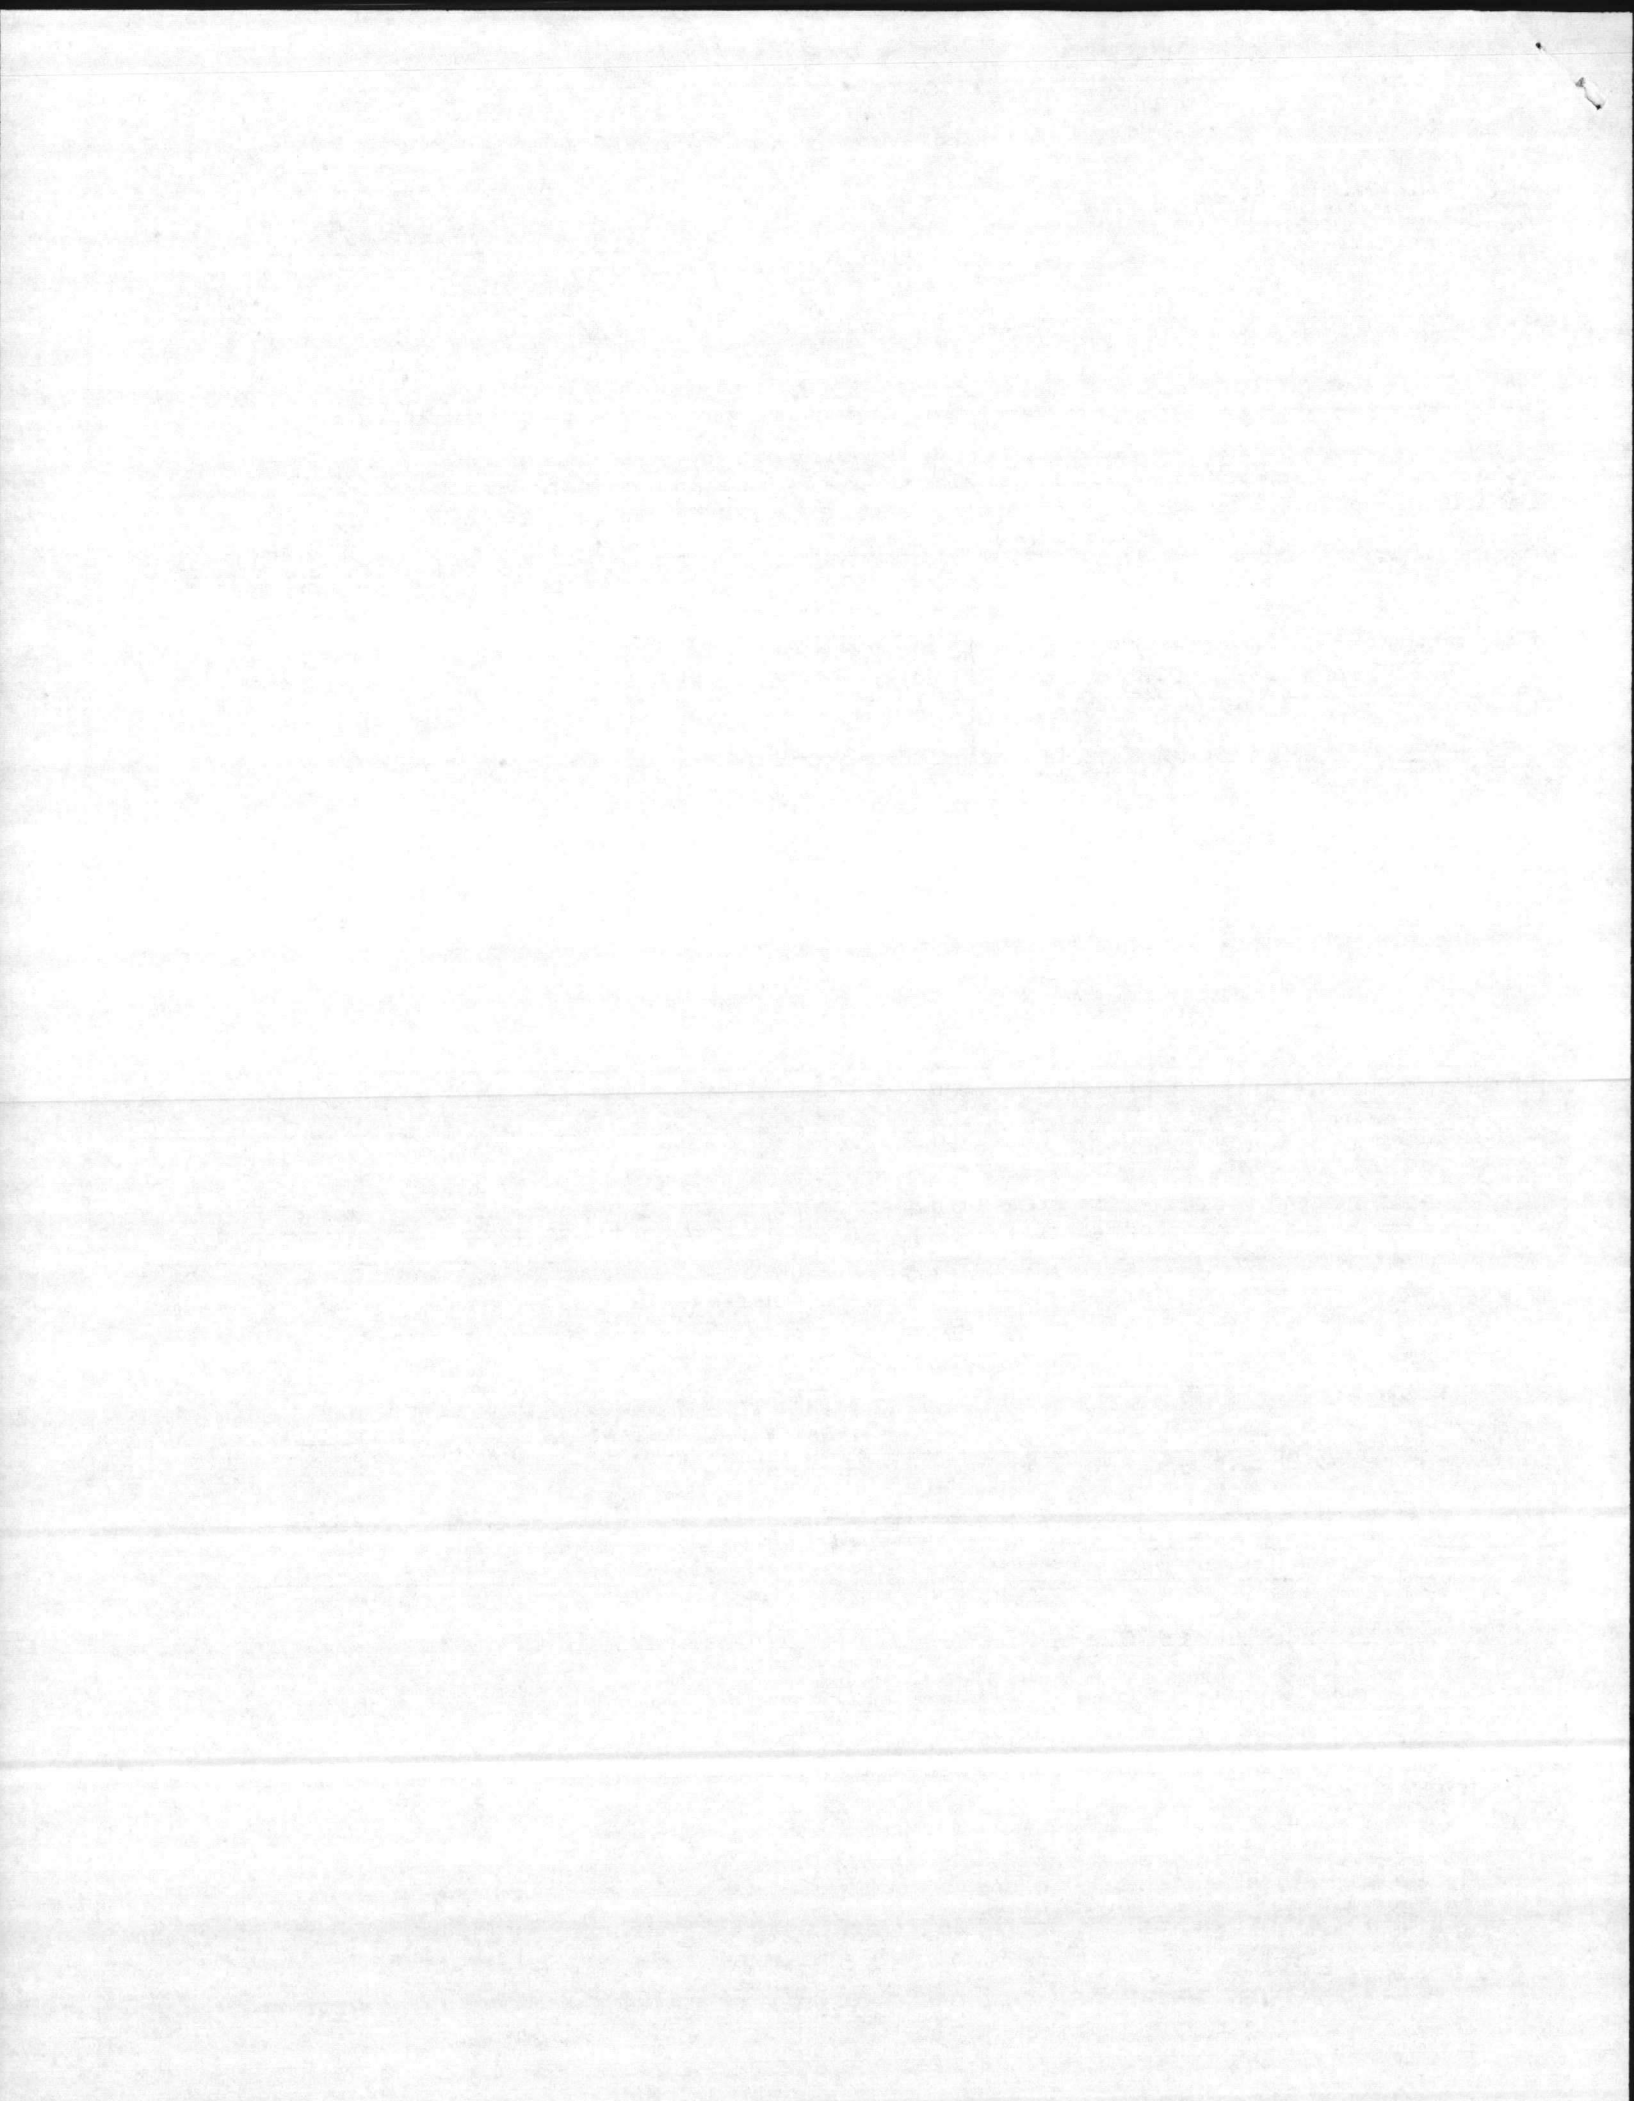

INSPECTION REPORT - BOILERS
 NAVFAC 9-11014/41 (3/67)
 Supersedes NAVDOCKS 2544
 S/N 0105-004-0000

DATE OF INSPECTION
7-8-76

TYPE OF INSPECTION
 A INTERNAL & EXTERNAL B INTERNAL & EXTERNAL WITH PRESSURE TEST C OPERATIONAL

1. FROM
Base MAINT. Officer Camp Lejeune N.C.

2. TO
Commandant Hdqtrs Marine Corps (Code L1-F)

14. CERTIFICATE ISSUED YES NO
 EXPIRES *11-3-76*

15. BOILER INSPECTOR
E.O. Mahley
 NAVY OR NATIONAL BOARD NO.
NAVFAC 101

BOILER DATA

3. MANUFACTURER
Kewanee

4. PROPERTY NO. <i>9</i>	5. MFG. SERIAL NO. <i>M9903</i>	6. MFG. MODEL NO. <i>3R-1F</i>
7. BUILDING NO. <i>3504</i>	8. YEAR BUILT <i>1965</i>	9. CAPACITY <i>334,000 BTU/hr</i>

10. FUEL (Check)
 COAL OIL GAS

11. PRESSURE
 DESIGNED *30* psi OPERATING *12* psi TEST *45* psi

12. FEED WATER TREATMENT
 SATISFACTORY UNSATISFACTORY

13. TYPE
 WATER TUBE FIRE TUBE C. I.

16. REASON FOR NOT ISSUING CERTIFICATE

17. BOILER USE
Heating

18. COMBUSTION CONTROL (Mfg. Name)
Honeywell

19. COMBUSTION
 % CO₂ _____ % EXCESS O₂ _____

20. FLUE GAS TEMPERATURE
 AFTER BOILER _____ °F ; AFTER HEAT TRAP _____ °F

SAFETY DEVICES
SAFETY VALVES

21. MANUFACTURER
WATTS

22. NUMBER AND SIZE
1 - 3/4"

23. PSI SETTING

24. CONDITION

STEAM PRESSURE GAUGE

25. MANUFACTURER
U.S. Gage

26. CORRECTIONS
 WATER LEG CONSTANT _____ psi; OTHER _____ psi

27. REASON IF NOT TESTED

FIRING EQUIPMENT

ITEM	IN SERVICE	ALTERNATE
28. MANUFACTURER	<i>Kewanee</i>	<i>None</i>
29. TYPE	<i>Nozzle spray press. atom.</i>	
30. FUEL GRADE	<i>#2</i>	

31. INSPECTOR'S COMMENTS

Replace 2 pipe nipples - Relocate wiring conduit & Junction Box.

32. ATTACHMENT(S) (Check)
 COPY OF INSPECTOR'S REPORT SPECIAL COMMENTS

33. SIGNATURE
Daniel L. White
 BY DIRECTION

