
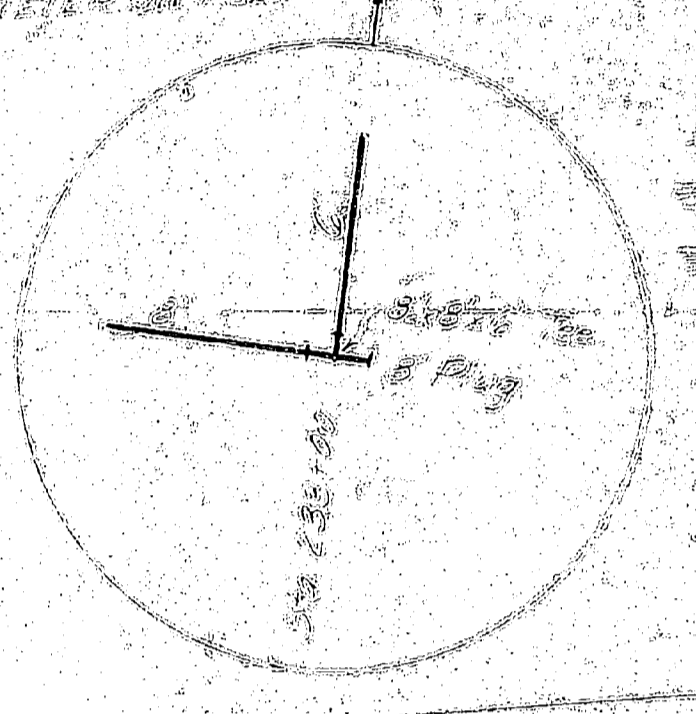



5-5KVA 12470-VOLT 1-Ø TRANSFORMER
 WIRE DELTA PRIMARY 10/0-3/0-24/0
 WYE SECONDARY 10/0-3/0-24/0
 GROUND ROD (MAXIMUM 10 FEET FROM
 GND. WIRE) GROUND WIRE 10/0-3/0-24/0

1. ALL WIRING TO BE DONE
 IN ACCORDANCE WITH THE
 NATIONAL ELECTRICAL
 CODE (NEC) AND ALL
 LOCAL ORDINANCES.
 2. ALL WIRING TO BE DONE
 IN ACCORDANCE WITH THE
 NATIONAL ELECTRICAL
 CODE (NEC) AND ALL
 LOCAL ORDINANCES.

ELECTRICAL
 DISTRIBUTION
 WELLS
 SCALE 1"=100'

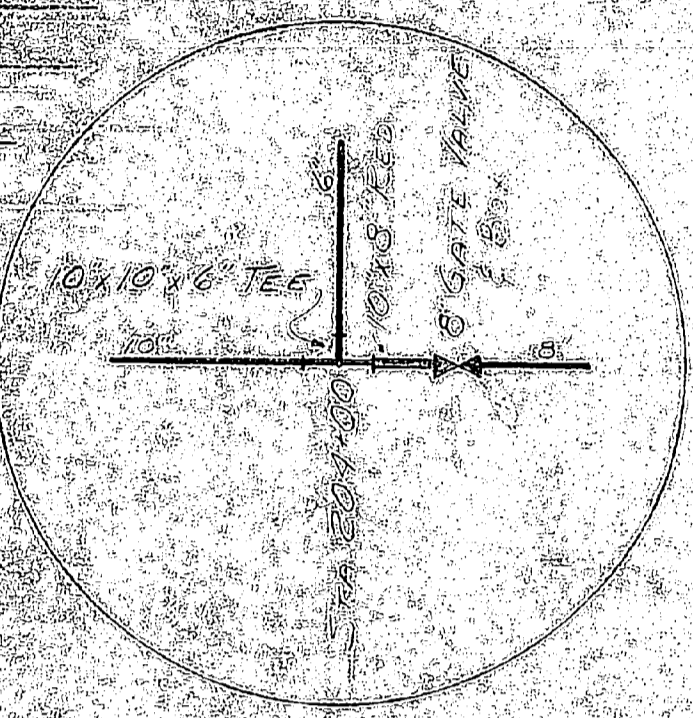

ELECTRICAL
 DISTRIBUTION
 WELLS
 SCALE 1"=100'

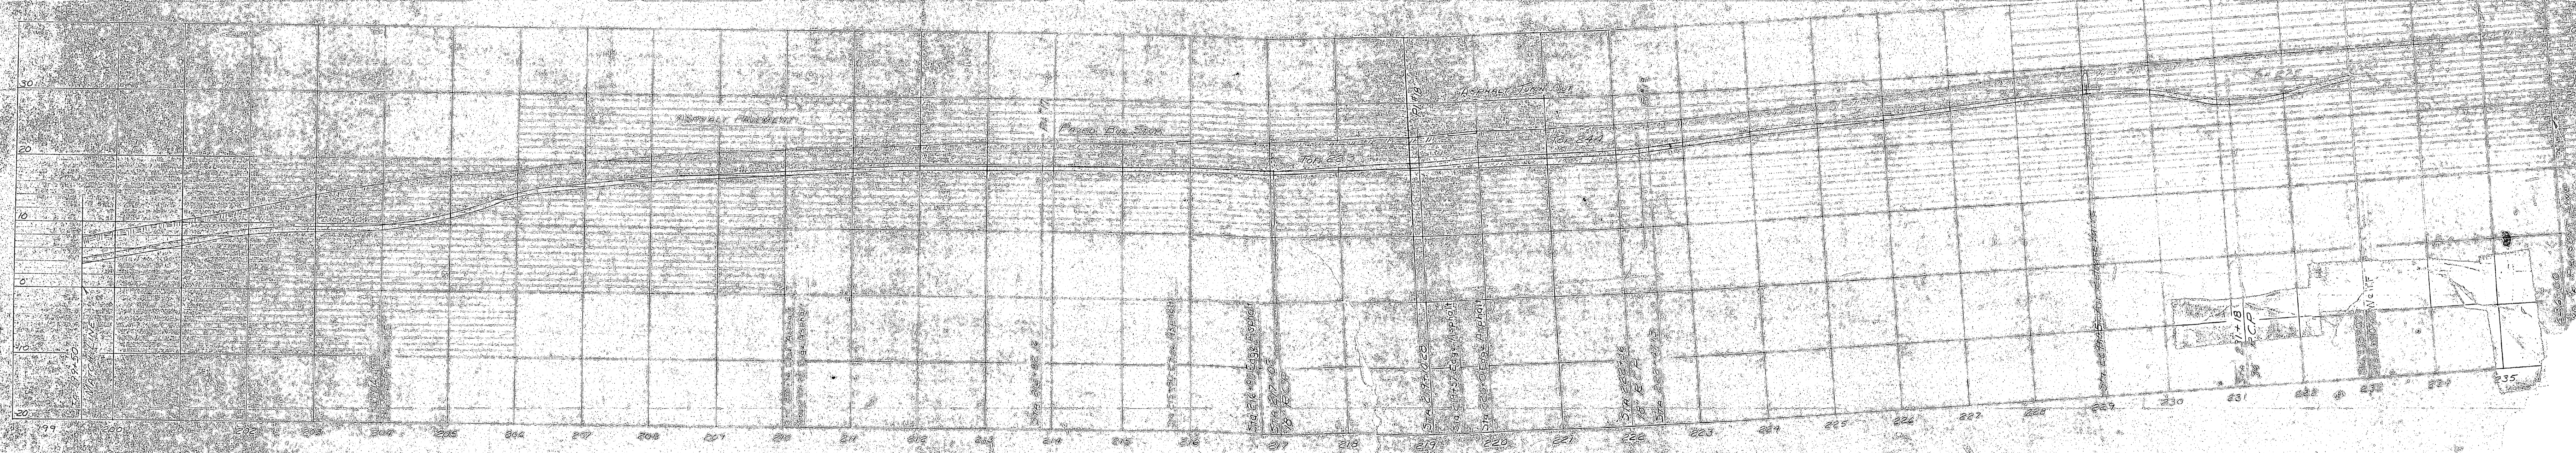

1. LICENSE
 Electrical License
 License No. 10000
 License No. 10000
 License No. 10000

NOTE: FOR CONTINUATION
 SEE PLAN IN WELL HOUSE, SEC
 10-1 ON 10-1000



10-7
 5/8" SCALE WELLS
 SCALE FOR HORIZ. 1"=50'



10-7
 5/8" SCALE WELLS
 SCALE FOR HORIZ. 1"=50'

| REVISION | DATE | APPD. |
|----------|------|-------|
| | | |
| | | |

P.W. DRAWING NO. **7866**

DRWN. *[Signature]*
 CHKD. *[Signature]*
 ELEC. *[Signature]*

IN CHARGE *[Signature]*
 APPROVED *[Signature]*
 DATE *[Date]*

MA
 CORRECT
 RAW
 PI
 ELECT

THE QUARTERMASTER GENERAL
 THE MARINE CORPS

