



2011 Licensed Professional's Guide to the ENERGY STAR® Label for Commercial Buildings

Table of Contents

Introduction.....	3
Module 1: Physical Characteristics	5
Module 2: Operating Characteristics.....	8
Module 3: Energy Consumption	12
Module 4: Thermal Comfort	15
Module 5: Illumination	18
Module 6: Ventilation for Acceptable Indoor Air Quality	22
Appendix A: Contact Information	26
Appendix B: Qualifications for Licensed Professionals.....	27
Appendix C. Example Copy of a Statement of Energy Performance	28
Appendix D. Example Copy of Data Checklist.....	29
Appendix E. List of Building Type Definitions.....	32
Appendix F: Outdoor Air Ventilation Rates for Health Care Facilities	37
Appendix G: How to Apply for the ENERGY STAR Label	40

Introduction

Since January 1999, the U. S. Environmental Protection Agency (US EPA) has provided the public with the means to quickly and easily assess, *or benchmark*, the energy performance of commercial buildings relative to similar buildings in the United States. Accounting for the most significant drivers of energy intensity such as weather and operating characteristics, a building whose performance is among the nation's top 25 percent (equal to an energy performance rating of 75 or greater on a 1 to 100 scale) and that maintains a healthy indoor environment can qualify as an ENERGY STAR building.

EPA's Portfolio Manager is an on-line, interactive, software tool that makes benchmarking energy performance simple and accessible. Portfolio Manager is based on statistical models developed by the US EPA that correlate energy data to operational characteristics for each building type to identify the key drivers of energy use¹. Based on physical and operating characteristics, such as size, number of workers, operating hours per week, number of PCs, etc., the rating system evaluates and communicates the energy performance of a building relative to other buildings with similar characteristics in the United States.

After the building's energy performance is assessed, users can apply for the ENERGY STAR label by completing an Application Letter and Statement of Energy Performance, and a Data Checklist (See **Appendix C** and **D**). The Statement of Energy Performance is a stand-alone document designed to communicate not only a building's energy performance, but also its physical operating characteristics, and whether it meets industry standards for the following indoor environment conditions: thermal comfort, adequate ventilation and illumination. The Statement of Energy Performance must be validated by either a Professional Engineer or Registered Architect (hereafter referred to as a Licensed Professional). Once all information is validated by a licensed professional, the Statement of Energy Performance becomes an official document that can be used to apply for the ENERGY STAR label. The role of the licensed professional is to certify true superior energy performance at the facility and to ensure that indoor environmental quality was not compromised in pursuit of energy conservation.

Licensed professionals provide unbiased services and are legally bound to uphold standards of ethics. Because of this high level of professionalism, experience, and expertise, a licensed professional is required to validate each Statement of Energy Performance that is used to apply for the ENERGY STAR label. The licensed professional's key role is to verify that all data supplied to EPA is correct and the building is fully functional in accordance with industry standards. The licensed professional is not obligated to count up each individual operating characteristic in order to verify a building although they do need to assess if this information is correct. Additionally, the licensed professional is required to use his/her professional judgment to assess whether indoor environmental quality standards have been met at the building (and have not been compromised in pursuit of energy conservation). Additionally, the licensed professional must verify that all information provided in the Statement of Energy Performance and on the Data Checklist is accurate. Services performed by the licensed professional in connection with the ENERGY STAR label shall in no way diminish or otherwise modify the responsibilities or liability of the original designer or operator of the building.

Validating a Statement of Energy Performance and Data Checklist requires the licensed professional to review two categories of user-provided information. These verifications by the licensed professional are one step in the rigorous review process of a label application. For more on the labeling application process, which is the responsibility of the building owner/manager, see **Appendix G**.

- I. The licensed professional must verify that the data entered about the building is accurate. This includes verifying the building's physical characteristics, operating characteristics, and energy consumption. All building characteristics are provided in entirety on the data checklist and must be verified through a site visit by the licensed professional.
- II. During the site visit the licensed professional must also verify that the building complies with current

¹ EPA conducts statistical analysis on the data gathered by the Department of Energy's Energy Information Administration during its quadrennial Commercial Building Energy Consumption Survey (CBECS). For more information on how the rating is calculated and supporting documents on the statistical models, please visit the supporting documents page http://www.energystar.gov/index.cfm?c=evaluate_performance.bus_portfoliomanager_docs

industry standards for indoor environmental quality including thermal comfort, illumination, outside air ventilation, and control of indoor air pollutants (See modules 4, 5 & 6). These standards are meant to provide general guidance for a comfortable and healthy work environment. It is up to the licensed professional's expert judgment as to whether the building as a whole provides a suitable work environment for its occupants.

This document, *The Licensed Professional's Guide to the ENERGY STAR® Label for Commercial Buildings*, is intended to assist the Professional Engineers and Registered Architects in understanding the requirements of the Statement of Energy Performance, the Data Checklist, and the expectations and limitations of the licensed professional's role in the ENERGY STAR labeling process. Each module covers a single topic and contains a purpose, background, expectations, hints and tips, and questions and answers. Where needed, industry standards are referenced and detailed tables are provided to illustrate the relevant standard requirements. However, this document is not intended to take the place of the referenced standards; the licensed professional should refer to the standards for more complete information about their requirements².

EPA is committed to continually improving the content of this document, and welcomes all comments that further enhance the Licensed Professional's Guide. All applicable contact information is provided in **Appendix A**. Please send all suggestions on improving the Licensed Professional's guide to: buildings@energystar.gov.

EPA thanks you for choosing to take part in the ENERGY STAR labeling process and hopes that you find this experience professionally rewarding and are able to forge new or expand existing business relationships. In so doing, you can be assured that you are helping to mitigate society's impact on the environment and climate change.

² For additional guidance on indoor air quality outside the scope of this document please visit EPA's Indoor Environments Division (IED) website (<http://www.epa.gov/iaq/>).

Module 1: Physical Characteristics

1.1 Objective:

All recorded physical characteristics displayed on a building's Statement of Energy Performance must be verified when applying for the ENERGY STAR label.

1.2 Background and Expectations of the Licensed Professional:

To assess the energy performance of a building, all physical characteristics must be accurately portrayed by the user. The licensed professional is expected to verify the accuracy of the building's recorded physical characteristics which include building floor area in square feet, building name, location, etc. A list of the items to be verified is provided at the end of this module. These items must be verified to be true and accurately displayed on the Statement of Energy Performance and Data Checklist.

1.3 Building Designation Requirement:

The information needed to complete a Statement of Energy Performance and/or to apply for the ENERGY STAR label varies by building type and is given below. Currently there are thirteen eligible building space types. Definitions of all building and space types are provided in **Appendix E**. More than 50% of the building's gross floor area (excluding parking lots and garages) must be defined by one of the following space types:

- Bank / Financial Institution
- Courthouse
- Data Center
- Dormitory
- Hospital (General Medical and Surgical)
- Hotel
- House of Worship
- K-12 School
- Medical Office
- Office
- Retail Store
- Senior Care Facility
- Supermarket / Grocery Store
- Warehouse (refrigerated and unrefrigerated)

1.4 Physical Characteristics Requirements:

All buildings must meet the following requirements pertaining to gross square foot, location, parking structures and pools.

- The gross floor area of the building (excluding garage and parking lot) must be at least 5,000 square feet, with four exceptions:
 - a. Bank / Financial Institutions must be at least 1,000 square feet
 - b. Hospitals must be at least 20,000 square feet
 - c. Houses of Worship must be at least 1,000 square feet
 - d. Data Centers do not have a square feet minimum
- The building must be located within the United States of America or its territories. Buildings owned by the United States government that are located in foreign lands are also eligible. A 5-

digit ZIP code must be recorded for buildings located in the USA or its territories. For buildings owned by the United States government that are located in foreign lands, the user must select an international city from a list of cities with available weather data that is provided in Portfolio Manager. The location within a climate that is most similar to that where the building is located should be chosen. Typically, this is the location nearest to that of the building.

- The presence of a swimming pool on the same utility meter should be recorded, along with its size and an indication of whether the pool is located inside or outside of the facility.
- Total square foot of parking structures, and any space marked as "Other" or "Multifamily" must be verified and are subject to the following restrictions.
 - The combined floor area of all the Parking Structures cannot exceed the total gross floor area of the building (where the gross floor area of the building excludes the parking garage/parking lot). Additionally, the presence of an attached parking structure on the same utility meter(s) must be recorded.
 - The combined floor area of any space classified as "Other" cannot exceed 10% of the total gross floor area of the building (where gross floor area of the building excludes the parking garage/parking lot).
 - The combined floor area of all Multifamily Housing space cannot exceed 10% of the total gross floor area of the building (where gross floor area of the building excludes the parking garage/parking lot).
- For Hospitals (i.e. if Hospital accounts for more than 50% of the space), the only other unique space types that may be included are: Data Center, Parking Garages and Lots, Other and Swimming Pools.
- The building being evaluated must be a single structure and not a campus or plaza
 - There may be an exception for hospitals, schools, and hotels
- The Hospital designation is limited to hospitals that provide general medical and surgical services. Specifically excluded are all hospitals primarily used as out-patient facilities, cancer centers, psychiatric care hospitals, rehabilitation centers, or veterinary clinics. See **Appendix E** for definitions.
- Retail properties are eligible to earn the ENERGY STAR at the store level only. Eligible store configurations include: free standing stores; stores located in open air or strip centers (a collection of attached stores with common areas that are not enclosed); and mall anchors. Retail configurations not eligible to earn the ENERGY STAR include: entire enclosed malls (a collection of attached stores with enclosed common areas); individual stores located within enclosed malls; entire open air or strip centers; and individual stores that are part of a larger non-mall building (i.e. office or hotel). Retail space that is part of a mixed-use property should review the mixed-use benchmarking guidance:
http://www.energystar.gov/index.cfm?c=eligibility.bus_portfoliomanager_eligibility_mixed.
- A Data Center space using estimated IT Energy cannot exceed 10% of the total gross floor area.
 - Starting on June 7, 2010, there is a new user input requirement for Data Center to capture the IT Energy. With this requirement, some Data Centers will need to install new meters to capture the IT energy usage. Therefore, a transitional period between June 2010 and June 2012 has been established during which buildings may be able to receive ratings using system-generated estimated values. After June 2012 estimates will no longer be available within Portfolio Manager. Data Centers that apply estimates are limited to 10% of the total building floor area. Provided that the Data Center is 10% or less of the floor area, estimates may be used to earn both a rating and an ENERGY STAR label.

1.5 Hints & Tips:

Original specifications, design documents, and "as-built" drawings can be used to confirm certain physical characteristics. However, because the actual physical characteristics of the building can vary significantly from these plans and records, any review of documentation should always be combined with a physical inspection of the building.

1.6 Physical Characteristics Q& A:

- ***Are buildings that are owned by U. S. based companies or by the Federal Government but that are located outside of the United States eligible to apply for the ENERGY STAR label?***

Buildings located on foreign lands but owned by U.S.-based companies are not eligible to apply for the ENERGY STAR label. However, buildings that are located on foreign lands but that are owned and occupied by the United States government and that meet U.S. construction codes are eligible.

- ***Are common areas to be included when determining the floor area of the building or a given space (for example, office space)?***

Yes, the user-entered value for area must be the gross total area of the building. This value is measured from the principal exterior surfaces of the enclosing fixed walls and includes all supporting functions such as kitchens and break rooms used by staff, storage areas, administrative areas, elevators, stairwells, atria, vent shafts, etc.

Additionally, the following must be noted:

- Existing atriums should only include the base floor area that they occupy.
 - Interstitial (plenum) space between floors should not be included in total.
 - Gross floor area is not the same as leasable space. Leasable space is a subset of a building's gross floor area.
- ***Can the square footage of the parking garage or surface parking be excluded from the square footage of the building?***

Yes, if the parking garage is separately metered from the building and not included in other utility bill data in Portfolio Manager, the user can exclude the parking garage or surface parking from Portfolio Manager. However, if the energy consumption for a parking garage or surface parking is included on the same meter as the building then it should be accounted for in Portfolio Manager.

- ***If a data center is enclosed in a larger ratable building, can the square footage of the data center be excluded from the square footage of the building?***

No, if a data center is enclosed in a ratable building, the data center must be included in the total square footage and total energy consumption for the building. The total gross floor area of the data center is measured between the principal exterior surfaces of the enclosing fixed walls and includes all supporting functions for the data center.

1.7 Verifying Information on Data Checklist

The Data Checklist prints out with the Statement of Energy Performance from Portfolio Manager. The document is meant to summarize all building information for both the owner/operator of the building and the licensed professional. The document is especially meant to assist the licensed professional during the site visit of the label application process by providing all the information about the building in question including physical, operational, and energy information. During the site visit, the licensed professional must verify that all information listed on the Data Checklist (and SEP) is true and accurate. In addition to stamping that all information listed on the SEP is true and accurate, the licensed professional must also sign and date the Data Checklist for purposes of applying for the ENERGY STAR label. A complete data checklist will include a check and/or notation in the box provided by each item. Below are a few examples of physical characteristics that must be verified by the licensed professional:

- Building Name
- Type of Office
- Location
- Single Structure
- Gross Floor Area

Module 2: Operating Characteristics

2.1 Objective:

All recorded operating characteristics displayed on a building's Statement of Energy Performance must be verified when applying for the ENERGY STAR label.

2.2 Background and Expectations of the Licensed Professional:

To assess the energy performance of a building, all building operating characteristics must be accurately portrayed by the user. Operating characteristics include weekly operating hours and number of workers among other pertinent characteristics specific to each building type. The Licensed Professional is expected to verify the accuracy of the building's recorded operating characteristics displayed on the Statement of Energy Performance and Data Checklist and verify that the building meets the eligibility requirements for the ENERGY STAR label.

2.3 Operating Characteristic Requirements:

Eligibility requirements must be met before a building can qualify for the ENERGY STAR label. In Portfolio Manager, users are asked to enter data for key operating characteristics of their building. There are minimum and maximum thresholds for these values applied within Portfolio Manager. These limits are designed to make sure that their building falls into an operation pattern consistent with that of the peer group of buildings used for comparison. In order to be eligible to receive a national energy performance rating and qualify for the ENERGY STAR label, these minimal threshold values must be met:

- All buildings must:
 - have at least 11 consecutive months of energy data and operational characteristics
 - be at least 5,000 ft², with four exceptions:
 - If the building is a bank, it may be as small as 1,000 square foot
 - If the building is a hospital, it must be at least 20,000 square foot
 - If the building is a house of worship, it may be as small as 1,000 square foot
 - If the building is a data center, there is no minimum square footage requirement
 - be in operation at least 30 hours per week, with two exceptions:
 - This does not apply to buildings that are not asked for hours of operation, such as Hotels or Data Centers
 - This does not apply to Houses of Worship
 - contain at least 1 worker during the main shift for applicable space types. For hospitals, include at least 1 "Full-time Equivalent (FTE)" worker.
- All office, bank, and courthouse spaces must contain at least 1 Personal Computer (PC). Retail stores must contain at least 1 register but can have 0 personal computers.
- Building must meet the following occupancy requirements:
 - Offices must have more than 50% average annual occupancy
 - Hotels must have at least 55% average annual occupancy (i.e. less than 45% vacancy)
 - K-12 Schools must operate for at least 8 months of the year
- If the facility is a hospital, it must include at least 1 staffed bed
- If the facility is a retail store, it must:
 - Be a single store only. This includes free standing stores, stores located in a strip or open-air shopping centers, and enclosed mall anchor stores.

- Have an exterior entrance to the public.
- Residence halls/Dormitories must contain at least 5 rooms.
- If the facility is a hotel, it must include at least one room
- Houses of Worship must have at least 25 seats and no more than 4,000 seats
- Senior Care Facilities cannot have an Average Number of Residents that exceeds the Resident Capacity.

2.4 Hints & Tips:

- For office buildings, it can be useful to contact the building's local area network (LAN) manager or the equivalent to find out the average number of workers and number of PCs throughout the year, and the typical weekly operating hours.
- Because HVAC systems are often scheduled to operate for a period of time before and after the typical period of occupancy, using data from an automated environmental management system can substantially overstate the weekly operating hours as defined in Portfolio Manager. "Weekly operating hours" is defined by the number of hours during the week the building is 75% occupied.
- For data centers, it can be helpful for the licensed professional to collaborate with both the IT manager and building manager to ensure that all the required information about the metering configuration and IT energy data are accurate.
- Data Center is a unique space because one of the operational characteristics is a set of energy meters capturing the IT Energy Consumption. This requires special verification considerations. The licensed professional must:
 - Verify that the user entered the correct metering configuration for their IT energy.
 - The licensed professional should look at electrical diagrams to determine what the uninterruptible power supply (UPS) powers.
 - If no more than 10% of the UPS energy goes to non-IT equipment
 - An energy measurement at the output of the UPS is required. Verify that the meter is located at the UPS output and that no more than 10% of the energy is direct to non-IT equipment.
 - If non-IT equipment energy consumption amounts to greater than 10% of the UPS energy consumption
 - Verify that the non-IT consumption has been properly sub-metered, and removed from the UPS load when entered in Portfolio Manager; or
 - Verify that a correct measurement is taken at the input to the Power Distribution Unit (PDU)
 - Verify the annual IT energy values as measured at the UPS output or PDU input meters.
 - If the user has selected to use estimated data for IT Energy
 - Verify that measured data is not available at either the UPS Output or PDU Input meters.
 - Verify that the square footage of the data center is less than 10% of the total square footage of a building.
 - Estimated IT Energy is only permitted until June 2012.

2.5 Operating Characteristics Q& A:

- ***Are the weekly operating hours the same as the hours that the HVAC system is operating, including start-up and shut-down periods?***

No. Weekly operating hours are defined as the number of hours per week in which the majority of the primary tenants (workers for office buildings, customers for grocery stores/ supermarkets, and students for K-12 schools) are within the confines of the building.

How should the Licensed Professional verify that that weekly operating hours are correctly accounted for?

Weekly Operating Hours are the number of hours per week that a building (or space within a building) is occupied by at least 75% of the tenant employees, and is therefore considered to be operational. These hours often correspond to “lease hours” in a multi-tenant office building. The licensed professional should verify that the user did not include HVAC start-up time or hours when the building was occupied only by maintenance, security, or other support personnel. The licensed professional should verify that HVAC operations (and/or the operation of other technical building systems) are *not* a factor when determining office space operating hours for Portfolio Manager.

In a situation where a building has multiple tenants with varied hours, the licensed professional should verify that the user created an additional space for tenants whose weekly operating hours differ from the building norm by 10 hours or more. For example, if standard weekly operating hours are 65 but one tenant’s employees are present for 75 hours each week, then that tenant’s square footage should be entered as an additional space with 75 weekly operating hours. Only the square footage of the tenant that operates 75 hours each week can be input with Weekly Operating Hours of 75, even if the entire building must be air conditioned in order to accommodate that tenant. This is because HVAC operations (and/or the operation of other building systems) are not a factor when determining office space operating hours for Portfolio Manager. Rather, Weekly Operating Hours are the number of hours per week that a building (or space within a building) is occupied by at least 75% of the tenant employees, and is therefore considered to be operational.

- ***Does an employee kitchen or galley count as a cooking facility?***

No. In Portfolio Manager this question is used to determine whether it contains a cooking facility, such as a cafeteria, where food is prepared and served to the primary occupants, customers, or guests. Employee kitchens and galleys are outside the intent of this question. Cafeterias that serve only to keep food warm that was prepared elsewhere should not be considered cooking facilities.

- ***How should office buildings that have a large (for example, one half of one full floor), full-service cafeteria within the main office building structure be handled? Is this space considered part of the primary office space or is it considered another space type, such as restaurant?***

If the space serves the office building, then it is considered part of the office space and should not be separated out. If this cafeteria space is unrelated to the office building and is considered an independent operation such as a separate restaurant or catering service, then it should be entered into Portfolio Manager as “other”.

- ***Is the Licensed Professional expected to count each required input such as occupants, PCs, or rooms to verify the quantity in a given space?***

No. The licensed professional may verify this information by asking credible parties who have a detailed knowledge of the building or cross-checking information within a Portfolio Manager account. However, it is good practice to verify in person any questionable information. Additionally, all physical and operating characteristics of the building must be verified in some form. To aid this process, please see the data checklist provided (See **Appendix D**).

- ***Is the Licensed Professional required to verify annual average occupancy in an Office?***

Yes. The licensed professional is required to verify that the average annual occupancy of an Office is more than 50%. If vacant space averages more than 10% of the building floor area over the 12-month period of assessment, then vacant space must be entered as a separate space within Portfolio Manager (i.e. one Office Space for the occupied portion and a second Office Space for the vacant portion). For the vacant space, the licensed professional should verify that the user entered the following operating characteristic values:

- Weekly Operating Hours = 0
- Workers on Main Shift = 0
- Number of PCs = 0
- Percent Heated and Percent Cooled = Report conditioning as it occurs in the vacant space

- ***Is the Licensed Professional required to verify the IT energy for Data Centers?***

Yes, the Licensed Professional is required to verify the IT energy consumption for data centers. The licensed professional is required to verify that the correct IT energy configuration has been entered correctly for the building and to verify that the IT energy consumption is accurate.

- ***How can the Licensed Professional determine if they can use estimated values for IT energy for data centers?***

If the data center does not have a meter at the UPS or PDU, is enclosed within a larger ratable building, and is less than 10% of the total square footage of the building, then the user can use estimated default values for the data center IT energy consumption until June 2012. After that date, the user will have to install a meter at the output of the UPS to measure the IT energy if they want to be eligible for the ENERGY STAR.

2.6 Checklist: Verification of Operating Characteristics of a Building

- For more on the verification process of the Data Checklist for the purposes of applying for the ENERGY STAR label, please refer to Section 1.7.

Module 3: Energy Consumption

3.1 Objective:

All recorded energy consumption for each type of fuel used within a building must be verified on a Statement of Energy Performance for a building applying for the ENERGY STAR label.

3.2 Background and Expectations of the Licensed Professional:

To assess the performance of a building, all sources of energy within the building must be entered and verified through Portfolio Manager. Currently, acceptable fuel sources include the following: electricity (grid purchases, on-site solar and on-site wind), natural gas, fuel oil, diesel fuel, district steam or hot water, district chilled water, propane, coal, coke, kerosene and wood.

The Licensed Professional is expected to review energy consumption documentation for each energy source used in the building and to validate the energy consumption values reported on the Statement of Energy Performance and Data Checklist. Documentation must include monthly energy consumption for each energy source spanning the most recent 12 months including dates of each entry. The licensed professional must also verify that no fuels were excluded. Each item must be verified to be true and accurate on the Statement of Energy Performance and Data Checklist.

3.3 Energy Reporting Requirements

Buildings are expected to report all forms of energy that are required for building operation. It is critical for the Licensed Professional to verify that all fuel sources are included and listed on the Statement of Energy Performance and Data Checklist. Particular details on the most common sources of fuels are as follows:

- Grid Electricity – When electricity is purchased from the grid, the Licensed Professional is required to verify that the user entered the total amount of as-billed electricity consumption. This will typically be found on monthly electric bills. All purchases of grid electricity must be reported.
- Natural Gas – When natural gas is purchased from a supplier, the Licensed Professional is required to verify that the user entered the total amount of as-billed natural gas consumption. This will typically be found on monthly gas bills. All purchases of natural gas must be reported.
- Fuel Oil and Propane – If fuel oil or propane is combusted on site in a boiler, then the amount of fuel purchased and combusted must be reported. Unlike electricity and natural gas, these fuels may not be delivered or measured on a month-to-month billing period. Fuel values can be entered as they are billed. It is also permissible to divide a delivery amount over the total months that are covered.
- District Energy (hot water, chilled water, steam) – If district heat is purchased from the utility, the monthly quantity of consumption should be reported. The Licensed Professional is required to verify that the user entered the total amount of as-billed district energy consumption. This will typically be found on monthly bills. All purchases of district energy must be reported.
- On-Site Solar and Wind Electricity – Buildings are required to report the amount of electricity that is generated on site from solar or wind energy and used at the building. They are also asked to report energy that they sell to the grid. The Licensed Professional is required to confirm that all energy generated and used on-site from these sources is reported in full. The Licensed Professional is required to ensure that the user is not subtracting the on-site solar and wind energy generated on-site from the total energy consumption of the building.
- On-Site Combined Heat and Power (CHP) – CHP systems consume a single input fuel (e.g. natural gas) to produce both heat and electricity. In these situations, the input fuel is the required data entry for Portfolio Manager. The Licensed Professional should verify that all input fuels are included in the total report energy. This may be found on monthly values for a fuel such as

natural gas, or from other irregular billing periods for diesel oil or coal. The user is not required to report the amount of heat and electricity generated from the CHP system.

- **Wood and Coal** – If wood or coal is purchased and consumed on site, the quantities of these fuels must be reported. Like fuel oil, these fuels will likely not be delivered or measured on a month-to-month billing period. Fuel values can be entered as they are billed. It is also permissible to divide a delivery amount over the total months that are covered.

3.4 Hints & Tips:

- First, review actual monthly energy bills provided by the management or owners. Other sources of energy consumption data, such as spreadsheet tracking and Energy Management Control System (EMCS) output, might be incomplete or not record all fuels or meters within the building.
- Before reviewing the building record on the SEP and Data Checklist or performing the building walk-through you should do the following:
 - Get copies of actual energy bills and any record of monthly EMCS output.
 - Determine the number of energy sources used within the building.
 - Ask about the energy sources for any equipment that uses something other than electricity (for example, domestic water heaters and back-up electrical generators).
 - Determine if there is electricity generated on-site from solar or wind sources
- Data center operators are required to report their IT Energy consumption. This is not the utility meter, but a sub-meter measuring the energy used by the IT equipment.
 - The licensed professional is required to verify that both the IT Energy configuration and the IT energy (measured by the output of the UPS or input to the PDU) are entered accurately in Portfolio Manager.
 - Refer back to Section 2.4 for additional details.

3.5 Energy Consumption Q& A:

- ***To verify the monthly energy consumption, must monthly bills from the utility company be independently obtained?***

No. If the licensed professional is confident based on his/her walk-through that all of the energy sources and meters are accounted for, then independently obtained monthly utility bills are not required. In all but the rarest of cases, the review of existing monthly energy bills that have been provided by the building management or owner is sufficient. If the building owner cannot produce monthly energy bills, then it may be necessary for the PE to contact the utility.

- ***Are monthly utility bills needed to verify the monthly energy consumption of each fuel?***

No. Based upon the judgment of the licensed professional, a building-wide, energy-tracking tool that fully tracks consumption of all fuels (such as an EMCS) may be used instead of utility bills.

- ***Are simulated or calculated values for monthly energy consumption acceptable?***

No. Simulated or calculated values for monthly energy consumption are not acceptable when applying for the ENERGY STAR label.

- ***Should the electrical outputs of co-generation units be included as part of the building's monthly energy consumption?***

No. The energy input required by the co-generation unit must be accounted for in Portfolio Manager, but

not the electricity that is generated.

- ***Should the electrical outputs of renewable energy (on-site solar and wind) be included as part of the building's monthly energy consumption?***

Yes. Buildings must report the full electric requirement of the building; this includes the electricity that comes from on-site solar and wind electricity.

- ***Does Portfolio Manager incorporate other on-site sources of renewable energy?***

No. At the moment, the only types of renewable energy included in Portfolio Manager are on-site solar and wind. EPA is performing an investigation of other on-site sources of renewable energy to determine the most appropriate way to incorporate them in the future.

- ***Does a data center located in a building with other ratable space types have to be sub-metered for its total energy consumption?***

No. A data center located within a larger building with other ratable space types does not have to be sub-metered for energy consumption. The rating for a mixed-use building is calculated for the entire building and is based on the operating characteristics of each individual space type and the total energy consumption for the building. Therefore, if the energy consumption of the data center is not sub-metered, the rating can still be calculated for the entire building.

3.6 Checklist: Verification of Energy Consumption

- For more on the verification process of the Data Checklist please refer to Section 1.7.

Module 4: Thermal Comfort

4.1 Objective:

The licensed professional must verify that the thermal conditions in a building conform to industry standards as part of the review for the ENERGY STAR label and to help assure that a comfortable work environment has not been sacrificed to reduce energy use.

4.2 Technology Standard:

ANSI/ASHRAE Standard 55: Thermal Environmental Conditions for Human Occupancy. American Society of Heating, Refrigerating, and Air-Conditioning Engineers, Inc. Atlanta Georgia. www.ashrae.org

4.3 Background and Expectations of the Licensed Professional:

According to ASHRAE Standard 55, acceptable thermal environment of indoor spaces designed for human occupancy is dependent upon temperature, relative humidity, air speed, building activity, and clothing insulation. Thermal comfort may also vary from person to person; however, extensive laboratory and field data have been collected by ANSI/ASHRAE to provide necessary statistical data to define conditions that a specified percentage of occupants will find thermally comfortable. The majority of data collected is thermal comfort data that pertains to sedentary or near sedentary physical activity levels typical of office work. The licensed professional is expected to verify on the Statement of Energy Performance that thermal comfort conditions of the building are met given the standards outlined in ANSI/ASHRAE Standard 55. It is the responsibility of the licensed professional to consider all measured data and observations at the time of the site visit and to determine, in his/ her professional opinion, whether the building meets the letter and spirit of ASHRAE Standard 55.

4.4 Acceptable Thermal Environmental Conditions:

There are two methods for determining acceptable thermal conditions in occupied spaces as outlined by ASHRAE Standard 55. One method is based on a typical indoor environment with set conditions, and the other method assesses thermal conditions in naturally conditioned spaces. Naturally conditioned spaces are those spaces controlled by occupants through the opening and closing of windows. Given these different methods, the licensed professional is expected to give a professional opinion about the capability of the building to provide acceptable thermal environment conditions per guidelines provided by ASHRAE Standard 55. The licensed professional should measure the temperature, relative humidity, air speed, and draft of a representative sample of the occupied interior spaces of the building during occupied hours. Please refer to ASHRAE Standard 55 for guidance on acceptable limits of these conditions that are expected to be maintained within a functioning building.

4.5 Hints & Tips:

Reviewing previous indoor air quality reports or testing, adjusting, and balancing (TAB) reports is generally not acceptable as a sole source of information when giving a professional opinion about whether the building can provide acceptable thermal environmental conditions.

It is highly recommended that the licensed professional, as part of the evaluation of the occupied spaces, observe and record such signs of possible occupant thermal discomfort as:

- Oscillating table fans, window fans, or other personal fans

- Personal space heaters
- Open windows (unless it is an occupant-controlled, naturally conditioned space)
- Window or through-the-wall style room air-conditioners
- Covered or otherwise occupant-modified supply air diffusers
- Altered or broken thermostats

In addition to observing the conditions, the licensed professional should take temperature and humidity measurements in occupied areas that have the highest concentration of the items listed above. This is a good way to check the most problematic occupied areas in the building. Again, it is up to the licensed professional's judgment as to whether the building as a whole provides a suitable work environment for those subject to the respective working conditions. The outlined standards for acceptable conditions are meant to provide general guidance.

For hotels having individual room units for comfort air and a separate system for outdoor air, make sure that the systems can simultaneously provide comfort AND proper ventilation.

4.6 Thermal Comfort Q& A:

- ***Must the building be assessed as it operates in both heating and cooling modes?***

No. The capability of the building to meet ASHRAE Standard 55, for the purposes of the Statement of Energy Performance, should be determined based on the mode of the HVAC system at the time of the assessment. However, the presence and prevalence of personal comfort items noted above should always factor into the decision of the licensed professional as to whether or not both heating and cooling systems are operating as intended.

- ***Are temperature and humidity measurements required for every occupied space within the building?***

No. The licensed professional should take a representative sample of the occupied spaces. Several factors might influence a licensed professional's decision or require further measurement. For example, if many of the spaces measured are barely meeting the temperature and humidity conditions, then more measurements may be needed. Similarly, if there are a significant number of personal comfort devices (for example, fans, heaters and window a/ c units) or damaged and/ or occupant-altered HVAC equipment (for example, diffusers and thermostats), the licensed professional should consider additional measurements in these areas.

- ***If the measured temperature and/ or humidity of a single occupied space are outside the acceptable thermal conditions listed in ASHRAE Standard 55, is that in and of itself grounds to "fail" the thermal comfort check?***

Generally, no. The assessment of thermal comfort should take into account all measurements and observations, and does not depend upon one occupied space not meeting the temperature and humidity requirements. After considering all measured data and observations, it is the responsibility of the licensed professional to determine whether the building meets the letter and spirit of ASHRAE Standard 55.

- ***Why are TAB reports and Indoor Air Quality (IAQ) assessments generally not acceptable to assess whether acceptable thermal environmental conditions are being met?***

There are two reasons: 1) the assessment is intended to be a professional opinion at the time of the site visit; and 2) the assessment is intended to be based on the measurements and observations of the licensed professional hired to perform the assessment. TAB reports and IAQ assessments can be useful for the licensed professional to review because they may give confirmation of the licensed professional's measurements and observations as well as indicate problem areas that need further assessment or measurement.

- ***Are there unique thermal comfort requirements for data centers?***

Due to the sensitivity of high density computing equipment, data centers usually operate within strict ranges for temperature, humidity, particulate matter and dust. ASHRAE Technical Committee 9.9 is specifically designed to help provide technical guidance for these spaces. They have developed a number of technical pages which may be of use. This material is available at the following link: <http://tc99.ashraetcs.org/content.html>

Module 5: Illumination

5.1 Objective:

Appropriate illumination of interior occupied spaces and the generally unoccupied exterior spaces (for example, parking garages and parking lots) associated with the building must be verified as part of review for the ENERGY STAR label. Appropriate illumination is defined by current industry standards for commercial illumination.

5.2 Technology Standard:

IESNA, Lighting Handbook: Reference & Application, 9th Edition. Illuminating Engineering Society of North America (IESNA) 120 Wall Street, 17th Floor, New York, NY 10005.

5.3 Background and Expectations of the Licensed Professional:

According to the Illuminance Selection Procedure of the IESNA Lighting Handbook, illuminance levels for specific applications are based on best practices for a "typical" application. While illuminance is not the sole, or in many cases the most important lighting design criteria, it is a useful indicator to determine if the lighting system performance has been compromised in pursuit of energy conservation.

The licensed professional is expected to give a professional opinion about the capability of the building to provide minimum recommended illumination levels of both occupied spaces (that is, interior spaces) and generally unoccupied spaces (that is, parking garages and parking lots) based on guidance provided by the Illuminance Selection Procedure in the IESNA Lighting Handbook. In doing so, the licensed professional should measure the illumination levels in a representative sample of the occupied interior spaces of the building as well as any associated parking facilities. It is the responsibility of the licensed professional to decide, based on his/ her professional opinion, whether the building meets the minimum recommended illumination levels considering all measured data and observations at the time of the site visit.

5.4 Acceptable Illumination Levels:

The IESNA Lighting Handbook recommends horizontal and/ or vertical task illuminances for a wide variety of locations and tasks. The recommended values throughout the IESNA Lighting Handbook represent consensus values formally obtained by the appropriate application committee. IESNA recognizes that illuminance is not the sole lighting design criterion and that other criteria may be more important than illuminance. In these instances, the lighting designer may deviate from the recommended illuminance. In general, IESNA believe that a dramatic difference between actual and a recommended illuminance (i.e. a difference of two standard deviations or more) is characterized as 1/3 more or 1/3 less than the recommended value. Any dramatic deviations from the recommended value should be carefully documented just in case the design is ever challenged. Additionally, it should be kept in mind that while a single instance is not alarming, a number of dramatic deviations should be questioned and challenged against the design illuminance. A sample of the minimum recommended illumination levels in foot-candles (FC) are given in the table below. Please refer to the IESNA Lighting Handbook for a complete list of recommended illumination levels of interior spaces.

Recommended Illumination Levels for Interior Spaces

Note this list is not all inclusive. For a complete list of recommended illumination levels of interior spaces, see Interior 1-16 of the IESNA Lighting Design Guide.

Space Type	Horizontal (FC)	Vertical (FC)
Offices		
Meeting Rooms	30	5
Video Conference Rooms	50	30
	10	3
Copy Rooms		
Mail Sorting	50	3
Private Offices	50	5
Open Plan Offices	30 to 50	5
Lobbies/ Reception Areas	10	3
Stairways and Corridors	5	-
Restrooms	5	3
Educational Facilities		
Reading -- white boards	-	5
Reading – chalk boards	-	50
Reading – pen/ typed print/# 2 pencil	30	-
Reading – keyboard	30	-
Science Labs	50	30
Art Rooms	50	30
Lecture Halls	100	50
Health Care Facilities		
Anesthetizing	50	10
Autopsy, general	50	10
Cardiac function laboratory	50	10
Work areas, general	30	5
Operating areas, delivery, recovery, & lab suite and service	50	3
Critical care areas	5	3
Recovery room, general	10	3
Emergency outpatient general	50	10
Occupational therapy	30	5
Patient rooms, observation	5	3
Surgical Suite, general	300-1000	50
Surgical Holding Room	50	10

Space Type*	Horizontal (FC)	Vertical (FC)
Hotels		
Guest rooms – general	10	-
Bathrooms	30	5
Corridors, elevators, stairs	5	-
Front desk	50	-
Lobby – general lighting	10	-
Linen room – general	10	-
Retail		
Fitting areas	100	30
Stocks rooms, wrapping, packaging	30	5
General merchandise display	50	10
Supermarkets		
Shelving	50	10
Meat - processed	50	10
Meat -fresh	50	10
Produce	50	10
Dairy	50	10

Parking Facilities and Enclosed Parking Garages:

The illuminance requirements for all parking facilities depend largely on pedestrian needs and perceived personal security issues. Lighting for parking lots should provide not only the recommended minimum

illuminance levels but also good color, rendition, uniformity, and minimal glare. From a security standpoint, lighting for parking garages need higher illuminances than open parking facilities. Good lighting uniformity is most important in parking garages because access aisles are used by pedestrians for walking between cars, stairways and elevators. The recommended maintained illuminance levels for both open parking lots and enclosed garages are noted below.

Recommended Maintained Illuminance Values for Parking

	Minimum Horizontal (fc)	Minimum Vertical (fc)
Open parking lots		
Basic	0.2	0.1
Enhanced Security	0.5	0.25
Parking garages		
Basic	1.0	0.5
Ramps		
Day	2.0	1.0
Night	1.0	0.5
Entrance Areas		
Day	50.0	25.0
Night	1.0	0.5
Stairways	2.0	1.0

5.5 Hints & Tips:

- When measuring illuminance, remember to position the light meter at the proper height on the work surface at the task location (either vertical or horizontal). Avoid shadowing the meter with your body, and avoid reflections off of clothing.
- Allow thirty minutes between system switch-on and the first measurement to ensure that the lighting system has reached a stable condition.
- Daylight effects should be eliminated by performing the lighting survey after dark, or with the blinds closed and measuring the day lighting contribution with the lights off and subtracting its contribution to the electric lighting.
- Illumination should be checked both directly under the fixture and between fixtures (both laterally and longitudinally).
- Uniformity should also be evaluated, particularly next to walls, in corners, and parking garages where security and safety might be of question.
- Areas with occupant-supplied task lights, de-lamped fixtures, or numerous burned-out lamps should receive additional scrutiny as these are areas that may be under lit.
- The licensed professional should be able to make a professional judgment about whether appropriate illumination exists through a subset of measurements in a representative sample of spaces within the building.

5.6 Illumination Q& A:

- ***If the measured illumination levels of a single occupied space are below the minimum recommended levels as defined in the IESNA Lighting Handbook, is that, in***

and of itself sufficient grounds to "fail" the building for inadequate illumination?

Generally no, the assessment of illumination should take into account measurements and observations of all spaces, and is not necessarily contingent upon one occupied space meeting the minimum recommended levels. Based on observations at the time of the site visit, the licensed professional must determine whether the building lighting system meets the minimum recommended illumination levels for the current occupancy.

Module 6: Ventilation for Acceptable Indoor Air Quality

6.1 Objective:

The licensed professional must verify that minimum ventilation rates and acceptable indoor air quality are provided according to industry standards, as part of the review for the ENERGY STAR label, to help assure that indoor air quality has not been sacrificed to reduce energy use.

6.2 Technology Standard:

ANSI/ASHRAE Standard 62.1, Ventilation for Acceptable Indoor Air Quality. *Note: Healthcare facilities may use either ASHRAE Standard 62 or AIA 2001 Guideline for Design and Construction of Hospital and Healthcare Facilities.* Earlier versions of the Standard may be used, when properly referenced in building documents, if appropriate in the licensed professional's professional judgment

6.3 Background and Expectations of the Licensed Professional:

According to ASHRAE Standard 62.1, acceptable indoor air quality refers to air in which there are no known contaminants at harmful concentrations as determined by cognizant authorities and with which a substantial majority (80% or more) of the people exposed do not express dissatisfaction. The stated purpose of the standard is to specify minimum ventilation rates and indoor air quality that is acceptable to human occupants and that minimizes adverse health effects³. The standard also points out that acceptable indoor air quality may not be achieved in all buildings meeting the requirements of the standard for one or more of the following reasons: Because of the diversity of sources and contaminants in indoor air, because of the many other factors that may affect occupant perception and acceptance of indoor air quality, such as air temperature, humidity, noise, lighting, and psychological stress; because of the range of susceptibility in the population; and because outdoor air brought into the building may be unacceptable or may not be adequately cleaned⁴. Furthermore, the standard does not prescribe specific ventilation rate requirements for spaces that contain smoking or that do not meet the requirements in the standard for separation from spaces that contain smoking.

The standard describes two different compliance paths, one based on ventilation rates (Ventilation Rate Procedure) and the other based on analysis of contaminant sources (IAQ Procedure). Most designers use the ventilation rate procedure. The standard includes additional requirements related to certain sources, including outdoor air, construction processes, moisture, and biological growth, regardless of which compliance path is selected for determining minimum ventilation rates.

Given proper measurements and observations, the licensed professional is expected to give a professional opinion about the capability of the building to supply adequate ventilation rates for the maintenance of acceptable indoor air quality. Ultimately, it is the responsibility of the licensed professional to determine, based on his/ her professional opinion, whether the building meets the letter and spirit of ASHRAE Standard 62.1 considering all measured data and observations at the time of the site visit.

³ Section 1.1.1 of ANSI/ASHRAE Standard 62.1, Ventilation for Acceptable Indoor Air Quality.

⁴ Section 1.2.7 and 1.2.9 of ANSI/ASHRAE Standard 62.1, Ventilation for Acceptable Indoor Air Quality.

6.4 Acceptable Indoor Air Quality and Ventilation Rates:

As mentioned above, ASHRAE Standard 62.1 provides details on two ventilation system design paths, each subject to their own restrictions. The first ventilation system design path is based on a *Ventilation Rate Procedure*. This is a prescriptive procedure in which outdoor air intake rates are determined based on space type/application, occupancy level, and floor area. Minimum ventilation rates for people-related sources and area-related sources are based on contaminant sources and source strengths that are typical for most space types, as listed in Table 6.1 of ASHRAE Standard 62.1, Section 6.2. Table 6.1 is not shown here because the values in the table are not valid in isolation; they must be used in conjunction with other applicable requirements of the standard.

The second type of design compliance is based on the *Indoor Air Quality (IAQ) Procedure* in which outdoor air intake rates and other system design parameters are based on an analysis of contaminant sources, contaminant concentration targets, and air quality acceptability targets. In other words, controls that remove contaminants (e.g., air cleaning devices) or controls that can reliably demonstrate the maintenance of acceptable indoor air quality (resulting in indoor contaminant concentrations equal to or lower than those achieved using the Ventilation Rate Procedure) are given credit. For each contaminant of concern, a target concentration limit and corresponding exposure period should be specified. Section 6.1.2 of ASHRAE Standards 62.1 outlines what design approaches can be used to determine or validate the acceptability of minimum space and system outdoor airflow rates and other relevant design parameters. Other specifics on the IAQ Procedure can be referenced in Section 6.3 of ASHRAE Standard 62.1. Furthermore, guidelines for contaminant concentrations can be found in Appendix B of ASHRAE Standard 62.1.

Sample calculations for determining the required outdoor air supply rates can be found in the 62.1 User's Manual (ASHRAE). For healthcare facilities using the AIA 2006 Guideline in place of ASHRAE Standard 62.1, see **Appendix F** for outdoor air supply rates of various healthcare space functions.

Additionally, the licensed professional should document any spaces failing to meet the following criteria:

- *Microbiological Sources:* The building should be free of visible signs of microbiological sources such as mold and mildew.
- *Water Intrusion:* Water intrusion or accumulation in ventilation system components such as ducts, plenums, and air handlers should be investigated and rectified.

6.5 Hints & Tips:

- Reviewing the most current, written, preventative maintenance plan can provide useful insight about the level of concern placed upon the control of indoor air pollutants. A well written preventive maintenance plan should document the procedures used in the building to monitor, inspect, and clean all HVAC components for proper operation.
- Reviewing previous indoor air quality reports or testing, adjusting, and balancing (TAB) reports is generally not acceptable as the sole means to give a professional opinion about the capability of the building to provide acceptable outside air.
- The licensed professional should make an effort to measure the outdoor airflow directly. If this is not feasible due to air-handling unit design or configuration, the licensed professional should calculate the percentage of outdoor air by mass balance equations.
- In buildings having repetitive occupant and HVAC configurations, direct measurement of a sampling of air-handling units may be acceptable. Each air-handling unit, however, should be

inspected to determine if it is operating properly.

- Central energy management control systems (EMCS) or direct digital control (DDC) systems can provide real-time information about an air-handling unit's operating status. Licensed Professionals may use this information at their discretion as a means to give an opinion about the ability of the building to meet ASHRAE Standard 62.1.

6.6 Ventilation for Acceptable Indoor Air Quality Q&A:

- ***Is the building required to be mechanically ventilated to meet ASHRAE Standard 62.1?***

Generally, yes. However, some buildings (for example, K-12 schools) were designed to be naturally ventilated. Use of natural ventilation systems designed in accordance with Section 5.1 of ASHRAE Standard 62.1, is permitted in lieu of or in conjunction with mechanical ventilation systems. Natural ventilation must be approved by the authority having jurisdiction. Determining whether such buildings meet mechanical ventilation requirements of ASHRAE 62.1 would necessitate a calculation by the licensed professional.

- ***Are outside air measurements or calculations required for every occupied space within the building?***

No. It is expected that the licensed professional will take a representative sample of the occupied spaces to be able to give his/her decision. There are several factors that might influence a licensed professional's decision or warrant further measurement. For example, if a significantly sized space is marginally meeting the minimum requirements, then more measurements may be warranted. Similarly, if there are a significant number of personal fans, indicating stagnate air, or damaged and/or occupied-altered HVAC equipment (for example, diffusers and thermostats), the licensed professional may want to consider additional measurements in these areas.

- ***If the measured outdoor air supply of a single occupied space is below the acceptable supply rates given in ASHRAE Standard 62.1, is that sufficient grounds to give an opinion of "Fail" for the ventilation requirement?***

The answer depends upon the space itself and the compliance design path chosen (IAQ or Ventilation Rate Procedure); it is ultimately the judgment of the licensed professional. For Example, if the ventilation rate in an open office plan within a given building does not meet ASHRAE Standard 62.1, then it would be expected that the licensed professional would give the building a "fail" grade for the ventilation requirement. However, if the outdoor supply rate or contaminant concentration for a single private office within a whole building does not meet ASHRAE Standard 62.1 and the remainder of the building is deemed to meet the standard, than one could reasonably expect that the licensed professional would give the building a "pass" for the ventilation requirement. Generally the outdoor air supply assessment and contaminant concentration guideline should take in to account all measurements and observations, and is not necessarily contingent upon one occupied space meeting the ventilation requirements. It is the responsibility of the licensed professional to determine whether the building meets the letter and spirit of ASHRAE Standard 62.1 after considering all measured data and observations.

- ***Why are TAB reports and Indoor Air Quality assessments generally not acceptable for assessing whether acceptable outside air ventilation is being provided?***

The principal reasons are two-fold: 1) the assessment is intended to be a professional opinion at the time of the site visit; and 2) the assessment is intended to be based upon the measurements and observations of the licensed professional hired to perform the assessment. TAB reports and IAQ assessments can be quite useful for the licensed professional to review though as they may provide confirmation of the licensed professional's measurements and observations as well as indicate problematic areas worthy of the licensed professional's attention.

- ***Is the use of other standards or guidelines acceptable in evaluating “outside air ventilation” requirements?***

All building types are subject to ASHRAE Standard 62.1 with one exception. Healthcare facilities may use either ASHRAE Standard 62.1 OR AIA 2006 Guideline for Design and Construction of Hospital and Healthcare Facilities.

- ***Are there unique indoor air quality requirements for data centers?***

Due to the sensitivity of high density computing equipment, data centers usually operate within strict ranges for temperature, humidity, particulate matter and dust. ASHRAE Technical Committee 9.9 is specifically designed to help provide technical guidance for these spaces. They have developed a number of technical pages which may be of use. This material is available at the following link:

<http://tc99.ashraetcs.org/>

Appendix A: Contact Information

Mailing Address:

ENERGY STAR Label for Buildings
U. S. Environmental Protection Agency (6202J)
1200 Pennsylvania Avenue, NW
Washington, DC 20460

Contact information for questions:

- **E-mail:** buildings@energystar.gov
- **Web-site:** www.energystar.gov (Go to *Buildings and Plants*)
 - More on Portfolio Manager: <http://www.energystar.gov/benchmark>
 - Applying for the ENERGY STAR Label: <http://www.energystar.gov/eslabel>

Technology Standards Referenced in The Guide:

- American Society of Heating, Refrigerating, and Air-Conditioning Engineers, Inc. (ASHRAE) Publication Sales Department 1791 Tullie Circle, NE Atlanta, GA 30329 Tel: (404) 636-8400 Web URL: www.ashrae.org ASHRAE standards are updated on a continual basis. EPA recommends that a licensed professional use the latest version of these standards when undergoing the review process for an ENERGY STAR label application.
 - ANSI/ASHRAE Standard 55-2004: Thermal Environmental Conditions for Human Occupancy. American Society of Heating, Refrigerating, and Air-Conditioning Engineers, Inc. Atlanta Georgia. www.ashrae.org
 - ANSI/ASHRAE Standard 62.1-2007: Ventilation for Acceptable Indoor Air Quality. American Society of Heating, Refrigerating, and Air-Conditioning Engineers, Inc. Atlanta Georgia. www.ashrae.org

Note: Healthcare facilities may use either ASHRAE Standard 62 or AIA 2006 Guideline for Design and Construction of Hospital and Healthcare Facilities.

- IESNA, Lighting Handbook: Reference & Application, 9th Edition Illuminating Engineering Society of North America (IESNA) 120 Wall Street, 17th Floor New York, NY 10005 Tel: (212) 248-5000 Web URL: www.iesna.org E-mail: iesna@iesna.org

Appendix B: Qualifications for Licensed Professionals

To validate the Statement of Energy Performance, a licensed professional must be a Professional Engineer or Registered Architect and possess a current license and be in good standing. The licensed professional should also have:

- A license in a discipline related to commercial building systems (e.g. mechanical engineering or commercial architecture)
- Working knowledge of building systems, ASHRAE Standard 55, ASHRAE Standard 62.1, and the IESNA Lighting Handbook.

Territorial engineering and architecture licensure laws and regulations vary from jurisdiction to jurisdiction. Before offering or performing services, it is recommended that Professional Engineers and Registered Architects understand the professional practice of their respective disciplines and the ethics requirements contained in the state and territorial laws and regulations.

Appendix C. Example Copy of a Statement of Energy Performance

OMB No. 2060-0347



STATEMENT OF ENERGY PERFORMANCE Office Sample Facility

Building ID: 2005550
For 12-month Period Ending: April 30, 2010¹
Date SEP becomes ineligible: August 28, 2010

Date SEP Generated: July 02, 2010

Facility
Office Sample Facility
1234 Main Street
Arlington, VA 22201

Facility Owner
Sample Owner
1500 Test Avenue
Charlotte, NC 28227
555-555-5555

Primary Contact for this Facility
Jane Smith
1500 Test Avenue
Charlotte, NC 28227
555-555-5555
jsmith@jsmith.com

Year Built: 2000
Gross Floor Area (ft²): 53,232

Energy Performance Rating² (1-100) 90

Site Energy Use Summary³

Electricity - Grid Purchase(kBtu)	2,288,770
Natural Gas (kBtu) ⁴	1,228,009
Total Energy (kBtu)	3,516,779

Energy Intensity⁵

Site (kBtu/ft ² /yr)	66
Source (kBtu/ft ² /yr)	168

Emissions (based on site energy use)


Greenhouse Gas Emissions (MtCO ₂ e/year)	413
---	-----

Electric Distribution Utility

Dominion - Virginia Electric & Power Co

National Average Comparison

National Average Site EUI	114
National Average Source EUI	289
% Difference from National Average Source EUI	-42%
Building Type	Office

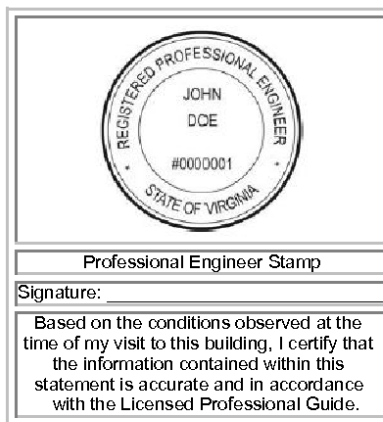

Meets Industry Standards⁶ for Indoor Environmental Conditions:

Ventilation for Acceptable Indoor Air Quality	Yes
Acceptable Thermal Environmental Conditions	Yes
Adequate Illumination	Yes

Professional Engineer
License Number: 0000001
State: VA
John Doe
333 Old Sample Lane
Arlington, VA 22201
555-555-1234

Notes:

- Application for the ENERGY STAR must be submitted to EPA within 4 months of the Period Ending date. Award of the ENERGY STAR is not final until approval is received from EPA.
- The EPA Energy Performance Rating is based on total source energy. A rating of 75 is the minimum to be eligible for the ENERGY STAR.
- Values represent energy consumption, annualized to a 12-month period.
- Natural Gas values in units of volume (e.g. cubic feet) are converted to kBtu with adjustments made for elevation based on Facility zip code.
- Values represent energy intensity, annualized to a 12-month period.
- Based on Meeting ASHRAE Standard 62 for ventilation for acceptable indoor air quality, ASHRAE Standard 55 for thermal comfort, and IESNA Lighting Handbook for lighting quality.

The government estimates the average time needed to fill out this form is 6 hours (includes the time for entering energy data, Licensed Professional facility inspection, and notarizing the SEP) and welcomes suggestions for reducing this level of effort. Send comments (referencing OMB control number) to the Director, Collection Strategies Division, U.S., EPA (2822T), 1200 Pennsylvania Ave., NW, Washington, D.C. 20460.

EPA Form 5900-16

Tracking Number: SEP201007020001044613

Appendix D. Example Copy of Data Checklist

ENERGY STAR® Data Checklist for Commercial Buildings

In order for a building to qualify for the ENERGY STAR, a Professional Engineer (PE) or a Registered Architect (RA) must validate the accuracy of the data underlying the building's energy performance rating. This checklist is designed to provide an at-a-glance summary of a property's physical and operating characteristics, as well as its total energy consumption, to assist the PE or RA in double-checking the information that the building owner or operator has entered into Portfolio Manager.

Please complete and sign this checklist and include it with the stamped, signed Statement of Energy Performance.

NOTE: You must check each box to indicate that each value is correct, OR include a note.

CRITERION	VALUE AS ENTERED IN PORTFOLIO MANAGER	VERIFICATION QUESTIONS	NOTES	<input checked="" type="checkbox"/>
Building Name	Office Sample Facility	Is this the official building name to be displayed in the ENERGY STAR Registry of Labeled Buildings?		<input type="checkbox"/>
Type	Office	Is this an accurate description of the space in question?		<input type="checkbox"/>
Location	1234 Main Street, Arlington, VA 22201	Is this address accurate and complete? Correct weather normalization requires an accurate zip code.		<input type="checkbox"/>
Single Structure	Single Facility	Does this SEP represent a single structure? SEPs cannot be submitted for multiple-building campuses (with the exception of a hospital (general medical and surgical)) nor can they be submitted as representing only a portion of a building		<input type="checkbox"/>
Data Center (Data Center)				
CRITERION	VALUE AS ENTERED IN PORTFOLIO MANAGER	VERIFICATION QUESTIONS	NOTES	<input checked="" type="checkbox"/>
Gross Floor Area	780 Sq. Ft.	Is this the total gross floor area measured between the principal exterior surfaces of the enclosing fixed walls, including all supporting functions for the Data Center? This should include the entire Data Center for stand alone facilities, which may have raised floor computing space, server rack aisles, storage silos, control console areas, battery rooms, mechanical rooms for cooling equipment, administrative office areas, elevator shafts, stairways, break rooms and restrooms. When a Data Center is located within a larger building, the total gross floor area should include the computing space as well as any mechanical rooms or office spaces that support the data center.		<input type="checkbox"/>
IT Energy Configuration	Uninterruptible Power Supply (UPS) supports only IT equipment. (Preferred)	Does the UPS meter support only IT equipment within the Data Center?		<input type="checkbox"/>
UPS System Redundancy	N(Optional)	Is this the level of redundancy of the Uninterruptible Power Supply (UPS)? If there is no UPS system, is this the redundancy for the PDU Meters that support the IT Load?		<input type="checkbox"/>
Cooling Equipment Redundancy	N+1(Optional)	Is this the level of redundancy for the mechanical cooling equipment at the Data Center?		<input type="checkbox"/>
Annual IT Energy	1,403,358.88 kBtu	Does this total IT Energy reflect the total IT load at the Data Center in accordance with the EPA metering requirements? EPA metering requirements are for a meter at the output of the UPS meter. 1. Facilities that do not have a UPS meter are permitted to provide readings from the input of the PDU 2. Facilities for which more than 10% of the UPS load is directed to non-IT equipment are permitted to subtract the non-IT loads if they are sub-metered, or to report a reading from the PDU if the non-IT loads are not sub-metered		<input type="checkbox"/>
Office (Office)				
CRITERION	VALUE AS ENTERED IN PORTFOLIO MANAGER	VERIFICATION QUESTIONS	NOTES	<input checked="" type="checkbox"/>

Gross Floor Area	222,452 Sq. Ft.	Does this square footage include all supporting functions such as kitchens and break rooms used by staff, storage areas, administrative areas, elevators, stairwells, atria, vent shafts, etc. Also note that existing atriums should only include the base floor area that it occupies. Interstitial (plenum) space between floors should not be included in the total. Finally gross floor area is not the same as leasable space. Leasable space is a subset of gross floor area.		<input type="checkbox"/>
Weekly operating hours	90 Hours	Is this the total number of hours per week that the Office space is 75% occupied? This number should exclude hours when the facility is occupied only by maintenance, security, or other support personnel. For facilities with a schedule that varies during the year, "operating hours/week" refers to the total weekly hours for the schedule most often followed.		<input type="checkbox"/>
Workers on Main Shift	1,300	Is this the number of employees present during the main shift? Note this is not the total number of employees or visitors who are in a building during an entire 24 hour period. For example, if there are two daily 8 hour shifts of 100 workers each, the Workers on Main Shift value is 100. The normal worker density ranges between 0.3 and 5.3 workers per 1000 square feet (92.8 square meters)		<input type="checkbox"/>
Number of PCs	63	Is this the number of personal computers in the Office?		<input type="checkbox"/>
Percent Cooled	50% or more	Is this the percentage of the total floor space within the facility that is served by mechanical cooling equipment?		<input type="checkbox"/>
Percent Heated	50% or more	Is this the percentage of the total floor space within the facility that is served by mechanical heating equipment?		<input type="checkbox"/>
Parking (Parking)				
CRITERION	VALUE AS ENTERED IN PORTFOLIO MANAGER	VERIFICATION QUESTIONS	NOTES	<input checked="" type="checkbox"/>
Gross Floor Area	18,694 Sq. Ft.	Is this the total square footage of the entire parking area (enclosed + nonenclosed + open floor area)?		<input type="checkbox"/>
Enclosed Floor Area	1,476 Sq. Ft.	Is this the total square footage of the enclosed garage space? An enclosed garage is defined as having both sides and a roof.		<input type="checkbox"/>
Non-Enclosed Floor Area (w/roof)	0 Sq. Ft.	Is this the total square footage of the nonenclosed garage space? This is typically defined as the portion of the garage above ground (contains no sides but is under a roof).		<input type="checkbox"/>
Open Floor Area (w/o roof)	17,218 Sq. Ft.	Is this the total square footage of the nonenclosed parking area without a roof? This is typically defined as open parking lots or the very top level of an above ground parking garage.		<input type="checkbox"/>
Weekly Hours of Access	168 Hours	Is this the total number of hours per week when it is possible for a vehicle to enter or exit?		<input type="checkbox"/>

**ENERGY STAR® Data Checklist
for Commercial Buildings**

Energy Consumption

Power Generation Plant or Distribution Utility: Virginia Electric & Power Co [Dominion Resources Inc]

Fuel Type: Natural Gas		
Meter: Natural Gas (ccf (hundred cubic feet))		
Space(s): Entire Facility		
Start Date	End Date	Energy Use (ccf (hundred cubic feet))
04/01/2010	04/30/2010	234.00
03/01/2010	03/31/2010	1,505.00
02/01/2010	02/28/2010	2,500.00
01/01/2010	01/31/2010	3,511.00
12/01/2009	12/31/2009	4,222.00
11/01/2009	11/30/2009	1,244.00
10/01/2009	10/31/2009	1,201.00
09/01/2009	09/30/2009	852.00
08/01/2009	08/31/2009	221.00
07/01/2009	07/31/2009	100.00
06/01/2009	06/30/2009	99.00
05/01/2009	05/31/2009	105.00
Natural Gas Consumption (ccf (hundred cubic feet))		15,794.00
Natural Gas Consumption (kBtu (thousand Btu))		1,625,202.60
Total Natural Gas Consumption (kBtu (thousand Btu))		1,625,202.60
Is this the total Natural Gas consumption at this building including all Natural Gas meters?		<input type="checkbox"/>

Additional Fuels	
Do the fuel consumption totals shown above represent the total energy use of this building? Please confirm there are no additional fuels (district energy, generator fuel oil) used in this facility.	<input type="checkbox"/>

On-Site Solar and Wind Energy	
Do the fuel consumption totals shown above include all on-site solar and/or wind power located at your facility? Please confirm that no on-site solar or wind installations have been omitted from this list. All on-site systems must be reported.	<input type="checkbox"/>

IT Energy Type: Uninterruptible Power Supply (UPS) Output Energy		
Meter Name: UPS		
Start Date	End Date	Energy Use (kWh)
05/01/2009	04/30/2010	123,144.00
Uninterruptible Power Supply (UPS) Output Energy (kWh)		123,144.00

Total IT Energy from All Required Meters	
Annual Site IT Energy (kWh)	123,144.00
Annual Source IT Energy (kWh)	411,300.96

Certifying Professional

(When applying for the ENERGY STAR, the Certifying Professional must be the same PE or RA that signed and stamped the SEP.)

Name: _____ Date: _____

Signature: _____

Signature is required when applying for the ENERGY STAR.

Appendix E. List of Building Type Definitions

Bank/Financial Institution

Bank/Financial Institution applies to facility space used for financial services. Relevant businesses include bank branches, bank headquarters, securities and brokerage firms. The total gross floor area should include all supporting functions such as vaults, kitchens used by staff, lobbies, atria, conference rooms and auditoria, fitness areas for staff, storage areas, stairways, elevator shafts, etc.

Courthouse

Courthouse applies to facility space used for federal, state, or local courts and associated office space. The total gross floor area should include all supporting functions such as temporary holding cells, kitchens used by staff, lobbies, atria, conference rooms and auditoria, fitness areas for staff, storage areas, stairways, elevator shafts, etc.

Data Center

Data Center applies to spaces specifically designed and equipped to meet the needs of high density computing equipment such as server racks, used for data storage and processing. Typically these facilities require dedicated uninterruptible power supplies and cooling systems. Data center functions may include traditional enterprise services, on-demand enterprise services, high performance computing, internet facilities, and/or hosting facilities. Often Data Centers are free standing, mission critical computing centers. When a data center is located within a larger building, it will usually have its own power and cooling systems. The Data Center space is intended for sophisticated computing and server functions; it should not be used to represent a server closet or computer training area. The total gross floor area is measured between the principal exterior surfaces of the enclosing fixed walls and includes all supporting functions for the data center. This should include the entire data center, which may have raised floor computing space, server rack aisles, storage silos, control console areas, battery rooms, mechanical rooms for cooling equipment, administrative office areas, elevator shafts, stairways, break rooms and restrooms.

Dormitory / Residence Hall

Dormitory/Residence Hall applies to buildings associated with educational institutions or military facilities which offer multiple accommodations for long-term residents. The total gross floor area should include all supporting functions such as food service facilities, laundry facilities, meeting spaces, exercise rooms, health club/spas, lobbies, elevator shafts, storage areas stairways, etc.

Hospital (General Medical and Surgical)

Hospital applies to a general medical and surgical hospital (including critical access hospitals and children's hospitals) that is either a stand-alone building or a campus of buildings. These facilities provide acute care services intended to treat patients for short periods of time, including emergency medical care, physician's office services, diagnostic care, ambulatory care, surgical care, and limited specialty services such as rehabilitation and cancer care.

The definition of Hospital accounts for all space types that are located within the Hospital building/campus, such as medical offices, administrative offices, and skilled nursing. The total floor area should include the aggregate floor area of all buildings on the campus as well as all supporting functions such as: stairways, connecting corridors between buildings, medical offices, exam rooms, laboratories, lobbies, atria, cafeterias, storage areas, elevator shafts, and any space affiliated with emergency medical care, or diagnostic care.

More than 50% of the gross floor area of all buildings must be used for general medical and surgical services AND more than 50% of the licensed beds must provide acute care services. Properties that use

more than 50% of the gross floor area for long-term care, skilled nursing, specialty care, and/or ambulatory surgical centers or that have less than 50% of their beds licensed for acute care services are not considered eligible hospitals under this definition.

Ineligible healthcare spaces:

- Long-term care hospitals that are certified as acute care hospitals are not eligible because they provide patients with acute care for extended inpatient stays, defined by federal statute as an average of 25 days or more.
- Ambulatory surgical centers, specialty hospitals, and other types of long-term care facilities should benchmark under the "Other" space type category.

Facilities that use 51% or more of the gross floor area for long-term care, skilled nursing, and/or ambulatory surgical centers are not considered General Medical and Surgical Hospitals. Assisted living and skilled nursing facilities can obtain an ENERGY STAR score by selecting the "Senior Care" category in Portfolio Manager. Ambulatory surgical centers, specialty hospitals, and other types of long term care facilities should benchmark under the ["Other" space type](#) category.

No unique space uses should be entered other than Parking, Data Center, or Swimming Pools. All of the other facility and/or campus characteristics should be aggregated under the "Hospital (General Medical and Surgical)" space use classification within Portfolio Manager.

Additional guidance: [Healthcare Classification Document](#)  (446KB)

Hotel

Hotel applies to buildings that rent overnight accommodations on a room/suite basis, typically including a bath/shower and other facilities in guest rooms. The total gross floor area should include all interior space, including guestrooms, halls, lobbies, atria, food preparation and restaurant space, conference and banquet space, health clubs/spas, indoor pool areas, and laundry facilities, as well as all space used for supporting functions such as elevator shafts, stairways, mechanical rooms, storage areas, employee break rooms, back-of-house offices, etc.

House of Worship

House of Worship applies to buildings that are used as places of worship. This includes churches, temples, mosques, synagogues, meeting houses, or any other buildings that primarily function as a house of worship. The rating applies to buildings that function as the primary place of worship and not to other buildings that may be associated with a religious organization, such as living quarters, schools, or buildings used primarily for other community activities. The rating applies to worship facilities that have 4,000 seats or fewer.

K-12 School

K-12 School applies to facility space used as a school building for Kindergarten through 12th grade students. This does not include college or university classroom facilities and laboratories, or vocational, technical, or trade schools. The total gross floor area should include all supporting functions such as administrative space, conference rooms, kitchens used by staff, lobbies, cafeterias, gymnasiums, auditoria, laboratory classrooms, portable classrooms, greenhouses, stairways, atria, elevator shafts, small landscaping sheds, storage areas, etc. The K-12 school model does not apply to preschool or day care buildings; in order to classify as K-12 school, more than 75% of the students must be in kindergarten or older.

Medical Office

Medical Office applies to facility space used to provide diagnosis and treatment for medical, dental, or psychiatric outpatient care. The total gross floor area should include all supporting functions such as

kitchens used by staff, laboratories, lobbies, atria, conference rooms and auditoria, fitness areas for staff, storage areas, stairways, elevator shafts, etc.

Additional guidance: [Healthcare Classification Document](#)  (446KB)

Office

Office applies to facility spaces used for general office, professional, and administrative purposes. The total gross floor area should include all supporting functions such as kitchens used by staff, lobbies, atria, conference rooms and auditoria, fitness areas for staff, storage areas, stairways, elevator shafts, etc.

Parking

The Parking space type is intended for any area connected to the building that is used for parking vehicles. This includes parking lots, fully enclosed parking structures, and unenclosed parking structures that are open on all sides and may or may not include roof parking. All parking areas should be combined into one parking space. The purpose of combining all of these areas into one space is to avoid double counting and simplify the process. By apportioning the square foot of the parking area into these three categories, Portfolio Manager can properly assign lighting and ventilation allowances.

Retail Store

Retail Store applies to facility space used to conduct the retail sale of consumer product goods. Stores must be at least 5,000 square feet and have an exterior entrance to the public. The total gross floor area should include all supporting functions such as kitchens and break rooms used by staff, storage areas, administrative areas, elevators, stairwells, etc. Retail segments typically included under this definition are: Department Stores, Discount Stores, Supercenters, Warehouse Clubs, Drug Stores, Dollar Stores, Home Center/Hardware Stores, and Apparel/Hard Line Specialty Stores (e.g. books, clothing, office products, toys, home goods, electronics). Retail segments excluded under this definition are: Supermarkets (eligible to be benchmarked as Supermarket space), Convenience Stores, Automobile Dealerships, and Restaurants.

Retail properties are eligible to earn the ENERGY STAR at the store level only. Eligible store configurations include: free standing stores; stores located in open air or strip centers (a collection of attached stores with common areas that are not enclosed); and mall anchors. Retail configurations not eligible to earn the ENERGY STAR include: entire enclosed malls (a collection of attached stores with enclosed common areas); individual stores located within enclosed malls; entire open air or strip centers; and individual stores that are part of a larger non-mall building (i.e. office or hotel). Retail space that is part of a mixed-use property should review the mixed-use benchmarking guidance (link to new document or web site).

Senior Care Facility

Senior Care Facility applies to individual buildings and campuses of buildings that house and provide care and assistance for elderly residents. The total gross floor area of a Senior Care Facility should include all activities such as individual rooms or units, wellness centers, exam rooms, community rooms, small shops or service areas for residents and visitors (e.g. hair salons, convenience stores), staff offices, lobbies, atria, cafeterias, kitchens, storage areas, hallways, basements, stairways, connecting corridors between buildings, and elevator shafts.

Nursing homes (skilled nursing facilities) and assisted living facilities are eligible under this definition. Independent senior living communities are not eligible under this definition. However, it is common for some Senior Care Facilities to offer a mix of residential options including independent living along with some form of assisted living. More than 50% of the units in a community must be considered skilled nursing or assisted living in order to be eligible as a Senior Care Facility. Facilities with more than 50%

independent living units cannot earn a rating under this model and should benchmark using the Multifamily space type in Portfolio Manager.

Additional guidance: [Senior Care Classification Document](#)  (244KB)

Supermarket

The Supermarket/Grocery Store space type applies to facility space used for the retail sale of food and beverage products. It should not be used by restaurants, which are not eligible for a rating at this time. The total gross floor area should include all supporting functions such as kitchens and break rooms used by staff, storage areas (refrigerated and non-refrigerated), administrative areas, stairwells, atria, lobbies, etc.

Swimming Pool

Swimming Pool applies to heated swimming pools that operate on the premises and on the same energy-use meter as the primary building. This category applies to any heated swimming pools located inside or outside of the facility. Swimming pools are categorized by size and whether they are an indoor or outdoor pool.

Warehouse (Refrigerated or Unrefrigerated)

Warehouse applies to unrefrigerated or refrigerated buildings that are used to store goods, manufactured products, merchandise or raw materials. The total gross floor area of Refrigerated Warehouses should include all temperature controlled areas designed to store perishable goods or merchandise under refrigeration at temperatures below 50 degrees Fahrenheit. The total gross floor area of Unrefrigerated Warehouses should include space designed to store non-perishable goods and merchandise. Unrefrigerated warehouses also include distribution centers. The total gross floor area of refrigerated and unrefrigerated warehouses should include all supporting functions such as offices, lobbies, stairways, rest rooms, equipment storage areas, elevator shafts, etc. Existing atriums or areas with high ceilings should only include the base floor area that they occupy. The total gross floor area of refrigerated or unrefrigerated warehouse should not include outside loading bays or docks. Self-storage facilities, or facilities that rent individual storage units, are not eligible for a rating using the warehouse model.

Appendix F: Outdoor Air Ventilation Rates for Health Care Facilities (Healthcare facilities using the AIA 2006 Guideline in place of ASHRAE Standard 62.1)

**Table 2.1-2
Ventilation Requirements for Areas Affecting Patient Care in Hospitals and Outpatient Facilities¹**

Area designation	Air movement relationship to adjacent area ²	Minimum air changes of outdoor air per hour ³	Minimum total air changes per hour ^{4, 5}	All air exhausted directly to outdoors ⁶	Recirculated by means of room units ⁷	Relative humidity ⁸ (%)	Design temperature ⁹ (degrees F/C)
NURSING UNITS							
Patient room	—	2	6 ¹⁰	—	—	—	70-75 (21-24)
Toilet room	In	—	10	Yes	—	—	—
Newborn nursery suite	—	2	6	—	No	30-60	72-78 (22-26)
Protective environment room ¹¹	Out	2	12	—	No	—	75 (24)
Airborne infection isolation room ¹¹	In	2	12	Yes ¹²	No	—	75 (24)
Isolation alcove or anteroom	In/Out	—	10	Yes	No	—	—
Patient corridor	—	—	2	—	—	—	—
OBSTETRICAL FACILITIES							
Delivery room ¹³	Out	3	15	—	No	30-60	68-73 (20-23)
Labor/delivery/recovery	—	2	6 ¹⁰	—	—	—	70-75 (21-24)
Labor/delivery/recovery/postpartum	—	2	6 ¹⁰	—	—	—	70-75 (21-24)
EMERGENCY, SURGERY, AND CRITICAL CARE							
Operating/surgical cystoscopic rooms ^{14, 13}	Out	3	15	—	No	30-60	68-73 (20-23) ¹⁴
Recovery room ¹³	—	2	6	—	No	30-60	70-75 (21-24)
Critical and intensive care	—	2	6	—	No	30-60	70-75 (21-24)
Intermediate care	—	2	6 ¹⁰	—	—	—	70-75 (21-24)
Newborn intensive care	—	2	6	—	No	30-60	72-78 (22-26)
Treatment room ¹⁵	—	—	6	—	—	—	75 (24)
Trauma room ¹⁵	Out	3	15	—	No	30-60	70-75 (21-24)
Bronchoscopy ¹¹	In	2	12	Yes	No	30-60	68-73 (20-23)
Triage	In	2	12	Yes ¹⁶	—	—	70-75 (21-24)
ER waiting rooms	In	2	12	Yes ^{12, 16}	—	—	70-75 (21-24)
Procedure room	Out	3	15	—	No	30-60	70-75 (21-24)
Laser eye room	Out	3	15	—	No	30-60	70-75 (21-24)
X-ray (surgical/critical care and catheterization)	Out	3	15	—	No	30-60	70-75 (21-24)
Anesthesia gas storage	In	—	8	Yes	—	—	—
SUPPORT AREAS							
Medication room	Out	—	4	—	—	—	—
Clean workroom or clean holding	Out	—	4	—	—	—	—
Soiled workroom or soiled holding	In	—	10	Yes	No	—	—
DIAGNOSTIC AND TREATMENT AREAS							
Examination room	—	—	6	—	—	—	75 (24)
Treatment room	—	—	6	—	—	—	75 (24)
Physical therapy and hydrotherapy	In	—	6	—	—	—	75 (24)
Gastrointestinal endoscopy room	—	2	6	—	No	30-60	68-73 (20-23)
Endoscopic instrument processing room ¹⁷	In	—	10	Yes	No	—	—
Imaging¹⁸							
X-ray (diagnostic & treatment)	—	—	6	—	—	—	75 (24)
Darkroom	In	—	10	Yes	No	—	—
Imaging waiting rooms	In	2	12	Yes ^{12, 16}	—	—	70-75 (21-24)
Laboratory¹⁹							
General ¹⁸	—	—	6	—	—	—	75 (24)
Biochemistry ¹⁸	In	—	6	Yes	No	—	75 (24)
Cytology	In	—	6	Yes	No	—	75 (24)
Glass washing	In	—	10	Yes	—	—	—

Table 2.1-2 (continued)

Ventilation Requirements for Areas Affecting Patient Care in Hospitals and Outpatient Facilities¹

<i>Area designation</i>	<i>Air movement relationship to adjacent area²</i>	<i>Minimum air changes of outdoor air per hour³</i>	<i>Minimum total air changes per hour^{4,5}</i>	<i>All air exhausted directly to outdoors⁶</i>	<i>Recirculated by means of room units⁷</i>	<i>Relative humidity⁸ (%)</i>	<i>Design temperature⁹ (degrees F/C)</i>
Histology	In	—	6	Yes	No	—	75 (24)
Microbiology ¹⁰	In	—	6	Yes	No	—	75 (24)
Nuclear medicine	In	—	6	Yes	No	—	75 (24)
Pathology	In	—	6	Yes	No	—	75 (24)
Serology	In	—	6	Yes	No	—	75 (24)
Sterilizing	In	—	10	Yes	—	—	—
Autopsy room ¹¹	In	—	12	Yes	No	—	—
Nonrefrigerated body-holding room	In	—	10	Yes	—	—	70 (21)
SERVICE AREAS							
Pharmacy	Out	—	4	—	—	—	—
Food preparation center	—	—	10	—	No	—	—
Warewashing	In	—	10	Yes	No	—	—
Dietary day storage	In	—	2	—	—	—	—
Laundry, general	—	—	10	Yes	—	—	—
Soiled linen (sorting and storage)	In	—	10	Yes	No	—	—
Clean linen storage	Out	—	2	—	—	—	—
Soiled linen and trash chute room	In	—	10	Yes	No	—	—
Bedpan room	In	—	10	Yes	—	—	—
Bathroom	In	—	10	—	—	—	75 (24)
Housekeeping room	In	—	10	Yes	No	—	—
STERILIZING AND SUPPLY							
ETO-sterilizer room	In	—	10	Yes	No	30-60	75 (24)
Sterilizer equipment room	In	—	10	Yes	—	—	—
Central medical and surgical supply							
Soiled or decontamination room	In	—	6	Yes	No	—	68-73 (20-23)
Clean workroom	Out	—	4	—	No	30-60	75 (24)
Sterile storage	Out	—	4	—	—	(Max) 70	—

¹The ventilation rates in this table cover ventilation for comfort, as well as for asepsis and odor control in areas of acute care hospitals that directly affect patient care and are determined based on healthcare facilities being predominantly "No Smoking" facilities. Where smoking may be allowed, ventilation rates will need adjustment. Areas where specific ventilation rates are not given in the table shall be ventilated in accordance with ASHRAE Standard 62, *Ventilation for Acceptable Indoor Air Quality*, and *ASHRAE Handbook—HVAC Applications*. Specialized patient care areas, including organ transplant units, burn units, specialty procedure rooms, etc., shall have additional ventilation provisions for air quality control as may be appropriate. OSHA standards and/or NIOSH criteria require special ventilation requirements for employee health and safety within health care facilities.

²Design of the ventilation system shall provide air movement which is generally from clean to less clean areas. If any form of variable air volume or load shedding system is used for energy conservation, it must not compromise the corridor-to-room pressure balancing relationships or the minimum air changes required by the table.

³To satisfy exhaust needs, replacement air from the outside is necessary. Table 2.1-2 does not attempt to describe specific amounts of outside air to be supplied to individual spaces except for certain areas such as those listed. Distribution of the outside air, added to the system to balance required

exhaust, shall be as required by good engineering practice. Minimum outside air quantities shall remain constant while the system is in operation. In variable volume systems, the minimum outside air setting on the air-handling unit shall be calculated using the ASHRAE 62 method.

⁴Number of air changes may be reduced when the room is unoccupied if provisions are made to ensure that the number of air changes indicated is reestablished any time the space is being utilized. Adjustments shall include provisions so that the direction of air movement shall remain the same when the number of air changes is reduced. Areas not indicated as having continuous directional control may have ventilation systems shut down when space is unoccupied and ventilation is not otherwise needed, if the maximum infiltration or exfiltration permitted in Note 2 is not exceeded and if adjacent pressure balancing relationships are not compromised. Air quantity calculations must account for filter loading such that the indicated air change rates are provided up until the time of filter change-out. The minimum total air change requirements for Table 2.1-2 shall be based on the supply air quantity in positive pressure rooms, and the exhaust air quantity in negative pressure rooms.

⁵Air change requirements indicated are minimum values. Higher values should be used when required to maintain indicated room conditions (temperature and humidity), based on the cooling load of the space (lights, equipment, people, exterior walls and windows, etc.).

Table 2.1-2 (continued)

Ventilation Requirements for Areas Affecting Patient Care in Hospitals and Outpatient Facilities^a

⁶Air from areas with contamination and/or odor problems shall be exhausted to the outside and not recirculated to other areas. Note that individual circumstances may require special consideration for air exhaust to the outside, e.g., in intensive care units in which patients with pulmonary infection are treated, and rooms for burn patients.

⁷Recirculating room HVAC units refers to those local units that are used primarily for heating and cooling of air, and not disinfection of air. Because of cleaning difficulty and potential for buildup of contamination, recirculating room units shall not be used in areas marked "No." However, for airborne infection control, air may be recirculated within individual isolation rooms if HEPA filters are used. Isolation and intensive care unit rooms may be ventilated by reheat induction units in which only the primary air supplied from a central system passes through the reheat unit. Gravity-type heating or cooling units such as radiators or convectors shall not be used in operating rooms and other special care areas. See footnote A7 (at the bottom of the page) for a description of recirculation units to be used in isolation rooms.

⁸The ranges listed are the minimum and maximum limits where control is specifically needed. The maximum and minimum limits are not intended to be independent of a space's associated temperature. The humidity is expected to be at the higher end of the range when the temperature is also at the higher end, and vice versa. See Figure 2.1-1 for a graphic representation of the indicated changes on a psychrometric chart. Shaded area is acceptable range.

⁹Where temperature ranges are indicated, the systems shall be capable of maintaining the rooms at any point within the range during normal operation. A single figure indicates a heating or cooling capacity of at least the indicated temperature. This is usually applicable when patients may be undressed and require a warmer environment. Nothing in these guidelines shall be construed as precluding the use of temperatures lower than those noted when the patients' comfort and medical conditions make lower temperatures desirable. Unoccupied areas such as storage rooms shall have temperatures appropriate for the function intended.

¹⁰Total air changes per room for patient rooms, intermediate care, labor/delivery/recovery rooms, and labor/delivery/recovery/postpartum rooms may be reduced to 4 when supplemental heating and/or cooling systems (radiant heating and cooling, baseboard heating, etc.) are used.

¹¹Differential pressure shall be a minimum of 0.01" water gauge (2.5 Pa). If alarms are installed, allowances shall be made to prevent nuisance alarms of monitoring devices.

¹²If it is not practical to exhaust the air from the airborne infection isolation room to the outside, the air may be returned through HEPA filters to the air-handling system exclusively serving the isolation room.

¹³National Institute for Occupational Safety and Health (NIOSH) Criteria Documents regarding Occupational Exposure to Waste Anesthetic Gases and Vapors, and Control of Occupational Exposure to Nitrous Oxide indicate a need for both local

exhaust (scavenging) systems and general ventilation of the areas in which the respective gases are utilized.

¹⁴Some surgeons may require room temperatures that are outside of the indicated range. All operating room design conditions shall be developed in consultation with surgeons, anesthesiologists, and nursing staff.

¹⁵The term trauma room as used here is the operating room space in the emergency department or other trauma reception area that is used for emergency surgery. The first aid room and/or "emergency room" used for initial treatment of accident victims may be ventilated as noted for the "treatment room." Treatment rooms used for bronchoscopy shall be treated as bronchoscopy rooms. Treatment rooms used for cryosurgery procedures with nitrous oxide shall contain provisions for exhausting waste gases.


¹⁶In a ventilation system that recirculates air, HEPA filters can be used in lieu of exhausting the air from these spaces to the outside. In this application, the return air shall be passed through the HEPA filters before it is introduced into any other spaces.

¹⁷The endoscopic instrument processing room is a room adjacent to the gastrointestinal endoscopy room that is used for cleaning endoscopic equipment and instruments.

¹⁸When required, appropriate hoods and exhaust devices for the removal of noxious gases or chemical vapors shall be provided (see Section 2.1-10.2.4.5. (2) and NFPA 99).

¹⁹The air movement relationships for laboratories apply between laboratory and adjacent non-laboratory spaces. Reference DHHS publication "Biosafety in Microbiological and Biomedical Laboratories" (CDC and NIH) on the CDC Web site.

Psychrometric Chart

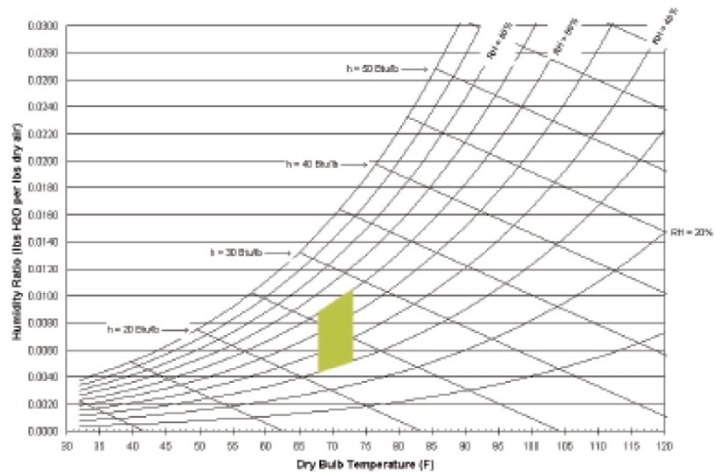

Appendix G: How to Apply for the ENERGY STAR Label

How to Apply for the ENERGY STAR Label

Follow the six steps below to qualify a building as ENERGY STAR:

1. Determine if the building meets the [eligibility requirements](#).
2. [Login](#) to Portfolio Manager and enter the required energy and building information.
3. Determine if the building achieves a rating of 75 or above.
4. Verify that all information provided on the following documents is true and accurate to the best of their ability. Both documents must be signed and dated at the time of the site visit. The Statement of Energy Performance must also be stamped by the licensed professional.

A. Statement of Energy Performance:

Determine if the building meets industry standards for comfort and indoor air quality. A licensed professional must verify that each of the indoor environment criteria requirements have been met and all information provided on the Statement of Energy Performance is true and accurate.

B. Data Checklist (*New Requirement*):

Also during the site visit, the licensed professional must verify all information listed on the Data Checklist. The Data Checklist is meant to summarize all building information for both the owner/operator of the building and the licensed professional. The document is especially meant to assist the licensed professional during the site visit of the label application process by providing all the information about the building in question including physical, operational, and energy information.

5. Read and understand the [ENERGY STAR Identity Guidelines](#).
6. Mail the signed Letter of Agreement and signed and stamped Statement of Energy Performance (SEP) to EPA (postmarked within 120 days of the Period Ending Date). Please note: an official Letter of Agreement will be provided for download in Portfolio Manager. Do not mail to EPA a Letter of Agreement that displays a watermark that reads SAMPLE. Please do not use company letterhead to print the Letter of Agreement.

NOTE: The ENERGY STAR is awarded for a specific year. A building that has earned the ENERGY STAR becomes eligible to reapply one year after the last energy data included in the SEP submitted as part of the previous year's application.

ENERGY STAR Label Application for Buildings should be mailed to:
ENERGY STAR Label for Buildings
C/o The Cadmus Group, Inc.
1600 Wilson Boulevard, Suite 500
Arlington, VA 22209

Sample Building Decal

