


**NOTE:**  
 1. **ROCK FILL:**  
 ROCK FILL SHALL BE PLACED AS SHOWN ON PLAN AND TYPICAL SECTION. THE ROCK FILL SHALL CONSIST OF SOUND DURABLE STONE WITH AT LEAST 50% OF THE STONE, BY WEIGHT, WEIGHING 100 LBS. OR MORE WITH THE MAXIMUM SIZE BEING 2 TIMES THE 50% SIZE. THE REMAINDER OF THE STONE TO BE QUARRY RUN STONE RANGING IN SIZE FROM THE 50% SIZE DOWN TO FINES.

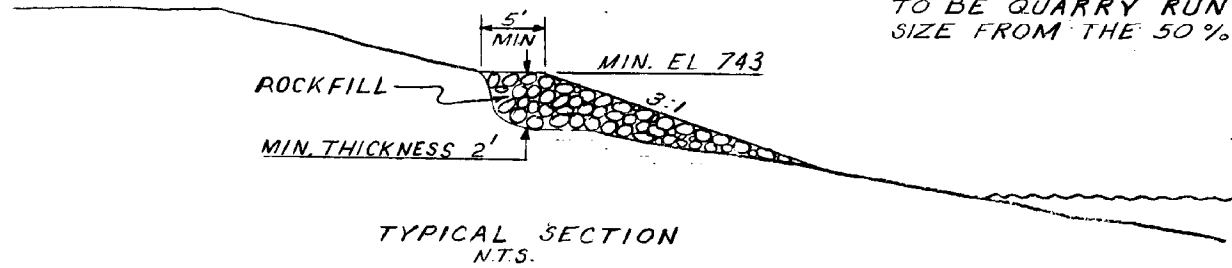

NO.	DATE	BY	CHKD	SLIP	IN SP	STATUS	RECH
DESIGN	J.P.H.	W.P.	J.P.H.				
DRAWN	J.P.H.	W.P.	J.P.H.				
CHKD	J.P.H.	W.P.	J.P.H.				
TICKET							
COMP							

GENERAL		
ASH DISPOSAL AREA REPAIR OF DIKE "C"		
KINGSTON STEAM PLANT TENNESSEE VALLEY AUTHORITY DIVISION OF ENGINEERING DESIGN		
SUBMITTED J.P.H.	DESIGNED W.P.	APPROVED W.W. Engle
KNOXVILLE	12-4-36	C 4 10B415 r/c