

Appendix A

Historic Documents

Reference No. 1

Environmental  
Assessment



45697

M 6 2 8 8 0 6 - 0 9 4 8

Jon M. Loney, Assistant to the Manager (Environmental Matters and Program Support), Office of Natural Resources and Economic Development, 1D 53 OCH-K  
Paul Wade, Director of Fossil and Hydro Power, LP 3S 58K-C

**JUN 17 1988**

**PARADISE FOSSIL PLANT - ENVIRONMENTAL ASSESSMENT (EA) FOR A FLY ASH DREDGE POND**

- References:
1. Your memorandum to me dated March 30, 1988, on the above subject (M01 880331 747)
  2. Memorandum from Wally Carpenter to G. Leon Massey dated June 6, 1988, on the subject, "Johnsonville and Paradise Fossil Plants - Environmental Review for Proposed Fly Ash Dredge Ponds"(copy attached)

After review of the referenced memorandums, we request that you begin work on all items immediately. Internal Service Agreements for each work group will be approved upon receipt as discussed between John Albright, of this division, and Sherry Murphy, of the Division of Air and Water Resources. The revised scope of work for Paradise in reference 2 is appropriate and brings the total amount for the EA to \$40,000 including overheads. The EA needs to be complete by the time the FY 1989 budget is submitted to the Board.

If you have additional questions, please contact Mr. Albright at extension 3505 in Chattanooga.

CND:JTT:JGA:CDR  
Attachment  
cc (Attachment):  
RIMS, LP 3S 127H-C  
R. D. Yeargan, Paradise  
Joe L. Currie, LP 3S 63H-C

Paul Wade

RECEIVED OFFICE OF PLANT MANAGER PARADISE FOSSIL PLANT			
		<b>JUN 20 1988</b>	
	ACT	REP	
<i>h</i> ASST MGR			
OPER SUPV			
MECH SUPV			
<i>h</i> RESULTS SUPV			
SAFETY			
ASST MGR ENGR			
ASST MGR WP			
OPER SUPV WP			
MECH SUPV WP			
RESULTS WP			
ADMN SUPV			
FILES			
PLANT MGR			
ANSW BY	DATE		

*John  
6-7-88  
Please review  
& handle if you  
Approve  
John*

G. Leon Massey, Supervisor, Waste Planning, BR 2S 108B-C

Wally Carpenter, Project Manager, Engineering Laboratory, ENG LAB-N

June 6, 1988

**JOHNSONVILLE AND PARADISE FOSSIL PLANTS - ENVIRONMENTAL REVIEW FOR PROPOSED FLY ASH DREDGE PONDS**

Per your request to Wally Carpenter, the proposals to develop a data base and prepare a detailed evaluation of impacts to groundwater resources at these two plants has been revised. We understand these revisions were necessary to complete the environmental reviews more quickly and that additional data, where needed, will be obtained in the design phase. Attached are revised proposals including cost estimates to complete work activities.

Funding of the activities for each of the listed organizations needs to be set up very quickly if these activities are to be completed by July. Attached is a list of contacts for each organization requiring funding. By copy of this memorandum, the Engineering Laboratory requests each of these organizations to review the revised scope of work activities and funding allocated for adequacy. Please contact Wally Carpenter at 632-1883 if you have any questions regarding these projects.

\_\_\_\_\_  
Wally Carpenter

WGC:TSM

Attachments

cc (Attachments):

- David J. Anderson, LA PSC 1-C
- Herbert Barnard, Jr., T218 NFDC-M
- Charles E. Bohac, 270 HB-C
- Lora M. Dawson, 200 HB-C
- John L. Furgurson, 143 EB-K
- Donald L. Malone, 200 HB-C
- Dennis L. Meinert, EDB-M
- Sherry T. Murphy, 114 EB-K
- Sandra S. Robertson, 293 HB-C
- John L. Rose, Jr., LA PSC 1-C
- Phyllis M. Russell, 2F 69 OCH-K
- Robin M. Scheib, T109ANFDC-M
- Lisa A. Stinson, 108 EB-K
- David M. Varnell, 150 401B-C

Prepared by Wally Carpenter

ATTACHMENT 1

Tennessee Valley Authority  
Office of Natural Resources and Economic Development  
Division of Air and Water Resources  
Engineering Laboratory

JOHNSONVILLE FOSSIL PLANT  
ENVIRONMENTAL ASSESSMENT FOR PROPOSED DREDGE POND

Report No. WR28-3-30-102

Prepared by  
Wallace G. Carpenter

Norris, Tennessee  
May 1988

EXECUTIVE SUMMARY

The Engineering Laboratory proposes to provide a groundwater assessment to describe possible effects of the development of a new dredge pond for fly ash disposal at Johnsonville Fossil Plant. Background conditions will be evaluated, site properties characterized and design options evaluated, to determine if impacts to local groundwater may occur. Based upon the information obtained, an environmental assessment (EA) will be provided describing any suspected impacts to groundwater and mitigative measures that may be necessary.

JOHNSONVILLE FOSSIL PLANT  
ENVIRONMENTAL ASSESSMENT FOR PROPOSED DREDGE POND

INTRODUCTION

The Johnsonville site contains soils of unconsolidated alluvial and terrace deposits consisting of sand, tan clay, and gravel. These deposits range in thickness from 0 to 32 feet across the site. Geologic formations underlying the terrace deposits include the Fort Payne Chert, Chattanooga Shale, and Camden Chert. The Mississippian regional aquifer and the Devonian-Ordovician regional aquifer are known to be in the area with the latter most likely to be affected by TVA ash disposal facilities. This aquifer is in the Camden Chert which in some locations is protected by the Chattanooga Shale (a nonwater-bearing unit).

In order to determine the potential impact of the proposed dredge pond, the existing groundwater quality, and site soils will be evaluated. The regional groundwater flow patterns will be defined to the extent possible. The anticipated ash leachate composition will be estimated and the local attenuation zone will be characterized.

Assessment

The following approach will be used to complete the assessment:

1. Groundwater hydrology and chemistry data from existing wells will be reviewed. Offsite well locations will be identified and if possible groundwater data will be obtained from these wells.
2. Soil characteristic will be examined, some boring have been conducted at the site and some hydraulic data are available.
3. Chemical composition of ash samples will be determined and leachate test of the dredged ash will be performed. The data obtained and other literature data will be used to predict leachate quality.
4. Design features of the proposed dredge pond will be evaluated to determine the potential of leachate to migrate into the groundwater. Details of the proposed design will be needed from Fossil and Hydro Power.

5. Based on the waste characterization, soil properties, site groundwater quality, regional flow conditions, and proposed design features the WQB and ENG LAB will predict the potential for leachate migration into the groundwater. The assessment will provide a basis for determining potential groundwater impacts and design considerations necessary for ash disposal on the site.

Detailed modeling which would predict specific groundwater flow and the direction and amount of leachate flux including attenuation processes would not be a part of the assessment phase although it could be considered for the design phase.

Cost

Following is a cost breakdown for the proposed activities:

<u>Organization/Activity</u>	<u>Cost<sup>a</sup></u>
Field Operations/ Collect ash (2 samples) and groundwater samples (3 samples)	2,500
Central Laboratory Services Branch/ Ash elemental analysis (3 samples)	900
Chemical Research Branch/ Soil mineral analysis (2 samples)	1,100
Mapping Services Branch/ Develop site maps	1,320
Laboratory Branch/ Water quality analyses Ash extractions (3 samples)	780
Water Quality Branch/ Groundwater quality evaluation Leachate attenuation analyses	7,300
Engineering Laboratory - Project Management Geohydraulic evaluation Leachate migration analyses Design evaluation	11,700
<b>Total</b>	<b>25,600</b>

a. Cost estimates are total, direct plus indirect.

ATTACHMENT 2

Proposal for Paradise Fossil Plant  
 Environmental Assessment - Water Resources

Although groundwater quality at the Paradise reservation is generally believed to be uniformly poor, the potential charges in groundwater quality resulting from the proposed fly ash dredging activity for the three sites being considered for development will be evaluated. Available water quality data will be examined to describe the groundwater resources of the areas. Topography of the three areas will be evaluated to attempt to ascertain general groundwater movements. Leachate data will be examined to evaluate the impacts to groundwater for the three sites.

Cost estimates for these activities are as follows:

<u>Organization/Activity</u>	<u>Cost<sup>a</sup></u>
Field Operations/ Collect ash (3 samples) and groundwater samples (4 samples)	3,700
Mapping Services Branch/ Develop site maps	2,700
Laboratory Branch/ Water quality analyses Ash extractions	1,040
Central Laboratory Services Branch/ Ash elemental analyses	900
Water Quality Branch/ Water quality assessment	4,000
Engineering Laboratory/ Hydrogeologic assessment	<u>4,000</u>
Total Direct	16,340

a. Cost estimates are total, direct plus indirect.

*1300 + 3600H = 1060 total for Arch.*

# Memorandum

000331 147

TENNESSEE VALLEY

OFFICE OF DIRECTOR  
DIV. OF FOSSIL & HYDRO POW

MAR 31 '88  
AUTHORITY

TO : Paul Wade, Director of Fossil and Hydro Power, LP 3S 58K-C

FROM : Jon M. Loney, Assistant to the Manager (Environmental Matters and Support), Office of Natural Resources and Economic Development, ID53 OCH-K

DATE : March 30, 1988

SUBJECT: PARADISE FOSSIL PLANT - ENVIRONMENTAL ASSESSMENT (EA) FOR A FLY ASH DREDGE POND

	Date	Initials	Reply
PW	X		3/31
RLC			
CND			
OFF Program			
GFR			
REH			
GLM			
RMC			
ASH DREDGE			
REACT			
XC			3/31
JMS			
RMS	X		3/31

M62 87118 804  
(END:JTT:JGA:CDR)

X1C-Paradise  
4/4

As requested in your November 30, 1987, memorandum, the Office of Natural Resources and Economic Development has prepared the following workplans and cost estimates for the work necessary to collect data and prepare the draft material for the subject EA.

### ARCHAEOLOGY/WILDLIFE/WETLANDS

**Activities:** All three sites under review for a fly ash dredge pond are within areas previously disturbed by mining activities; therefore no archaeological impacts are anticipated. Those areas, however, especially numbers 1 and 3, contain strip mine ponds which have supported the development of wetlands. In this otherwise degraded environment, with vast denuded areas interspersed with patches of ruderal species, these ponds and wetlands are biologically rich, as measured by biomass and species diversity. It has been TVA's practice since 1979 to protect these areas to the extent practicable from adverse impacts. A field inspection will be conducted to determine wetland status, i.e., size, function, and importance. Based on this data, we will then determine whether the proposed project impact would be acceptable or nonacceptable. In previous wetlands assessments of the Paradise area, we have generally concluded that in most cases the loss of wetlands, although serious, is unavoidable. We expect our findings will be similar for the three proposed sites.

**Cost:** Field survey and writeup of results: Four man-days \$1,300

### WATER RESOURCES

**Activities:** Although groundwater quality at the Paradise reservation is generally believed to be uniformly poor, the potential changes in groundwater quality resulting from the proposed fly ash dredging activity for the three sites will be evaluated. The possibility of a water quality gradient at the Paradise site such that one of the sites might have groundwater of higher quality than the other sites will be evaluated. The proposed dredge ponds might affect existing groundwater and surface water flow patterns, possibly further degrading either of the two. For these reasons, groundwater aspects should be investigated prior to the construction of a dredge pond.



Paul Wade  
March 30, 1988

PARADISE FOSSIL PLANT - ENVIRONMENTAL ASSESSMENT (EA) FOR A FLY ASH  
DREDGE POND

Wells exist in the area of site 2. No wells exist in the areas of sites 1 and 3. Therefore, it is proposed that a well be drilled in each of the areas of sites 1 and 3. Water quality samples will be taken and analyses performed for new wells at sites 1 and 3 and for one of the existing wells near site 2. The water quality data and a review of the drilling records for as many of the existing wells as possible will be used to assess the relative quality of the water and the ability to attenuate leachate beneath the three sites.

Water level readings from as many of the existing wells as possible will be obtained. This water level information will be used to assess the general groundwater flow patterns at the site.

Cost:

Mapping services	
Drilling wells	\$ 2,000
Logging wells	10,000
Sampling wells	2,000
Laboratory analysis	2,000
Hydrogeologic assessment	2,000
Water quality assessment	3,000
	<u>3,000</u>
Total	\$24,000

FISHERIES

The evaluation of the direct impact of fly ash dredging on fisheries at the three sites and preparation of the fisheries portion of the EA will involve site visits, examination and evaluation of existing data for the area, fisheries surveys (net and seine studies and electrofishing), and project meetings.

Fisheries and Aquatic Ecology Branch--Preliminary site evaluation, examination and evaluation of existing data (where available), meetings with the Divisions of Fossil and Hydro Power and Services and Field Operations, and preparation of the fisheries section of the EA.

Division of Services and Field Operations--Approximately two man-weeks of effort sampling the fish fauna at site 1. This will include experimental gill nets, seines, and electrofishing surveys, if feasible.

Cost:

Fisheries and Aquatic Ecology Branch	\$12,000
Division of Services and Field Operations	<u>6,000</u>
Total	\$18,000

Paul Wade  
March 30, 1988

PARADISE FOSSIL PLANT - ENVIRONMENTAL ASSESSMENT (EA) FOR A FLY ASH  
DREDGE POND

AIR QUALITY

No survey work is required for the air quality review. Therefore, instead of a workplan the following assessment is provided for inclusion in the EA.

Construction of the proposed dredge pond will result in temporary fugitive dust emissions from clearing and grading during site preparation. Gasoline and diesel fueled equipment and vehicles used in construction will emit minor amounts of combustion pollutants, such as particulates, carbon monoxide, and nitrogen oxides. If debris cleared from the site is disposed of by open burning, additional small amounts of particulates and carbon monoxide will be released. Any open burning will be conducted in accordance with applicable State and local regulations.

Air quality impacts during operation will depend on the method of disposal. Material will be hydraulically dredged and conveyed to the new pond by pipe. Any air emissions from transport will be negligible. If either area 1 or 3 is chosen, all material will be handled and ponded wet. Fugitive dust from such operations will be minimal. If area 2 is chosen, stacking will be necessary. Material in the disposal pile will initially be wet. As necessary, the pile will be wetted to reduce dust emissions. Surfaces will be revegetated as soon as practicable, and the active area of the pile will be kept as small as possible to further reduce dust.

With proper mitigation, this project should not significantly impact air quality.

FLOODPLAIN

No survey work is required for the floodplain review. Therefore, instead of a workplan the following assessment is provided for inclusion in the EA.

Sites 1 and 2 are subject to flooding from Jacobs Creek. The 1-percent-chance (100-year) and 0.2-percent-chance (500-year) elevations on Jacobs Creek at the sites are 404 and 407 respectively. Site 3 is subject to flooding from the Green River with 1- and 0.2-percent-chance flood elevations of 403 and 406 respectively. Therefore, all three of the candidate sites are located outside the limits of the identified

45315 4

Paul Wade  
March 30, 1988

PARADISE FOSSIL PLANT - ENVIRONMENTAL ASSESSMENT (EA) FOR A FLY ASH  
DREDGE POND

1-percent-chance (100-year) and 0.2-percent-chance (500-year) floodplains and would therefore be consistent with the requirements of Executive Order 11988 and TVA's floodplain management policy. Normal site drainage practice would be followed in providing drainage from the local site area.

*Jon M. Loney*

FMM:ADR  
cc: Files, ONRED, SE45 OCH-K  
R. T. Allen, 2F73 OCH-K  
J. L. Furgurson, 143 EB-K

Prepared by Frederick M. Massingill

4228D

RECEIVED OFFICE OF PLANT MANAGER PARADISE FOSSIL PLANT			
APR 08 88			
	IN	ACT	REP
ASST MGR			
OPER SUPV			
MECH SUPV			
RESULTS SUPV			
SAFETY			
ASST MGR ENGR			
ASST MGR WP			
OPER SUPV WP			
MECH SUPV WP			
RESULTS WP			
ADMN SUPV			
FILES			
PLANT MGR			
ANSW BY			DATE

UNITED STATES GOVERNMENT

# Memorandum

A60 890224 003

TENNESSEE VALLEY AUTHORITY

TO : M. Paul Schmierbach, Manager of Environmental Quality, SPB 2S 201P-K  
FROM : W. G. Ruffner, Manager of Environmental Affairs, LP 3S 39F-C  
DATE : MAR 1 1989  
SUBJECT: PARADISE FOSSIL PLANT - JACOBS CREEK ASH POND - DREDGE POND ENVIRONMENTAL ASSESSMENT (EA)

This is in response to your subject memorandum to W. H. Thompson dated January 6, 1989 (A60 890210 006). Attached is a copy of the final EA which has been revised to reflect changes agreed to between our staffs and OGC.

  
W. G. Ruffner

GGP:ECM:AJH

Attachments

cc (Attachments):

RIMS, MR 4N 72A-C

Dennis Allen, Paradise

E. S. Christenbury, ET 11B 33H-K

R. L. Moates, BR 2N 75A-C

W. M. Pearse, BR 4N 40A-C

W. H. Thompson, LP 3S 58K-C

2509k



DRAFT ENVIRONMENTAL ASSESSMENT  
DEVELOPMENT OF DREDGED ASH DISPOSAL AREA  
PARADISE FOSSIL PLANT

Introduction

Paradise Steam-Electric Plant (PAF) is a 3-unit, 2,558-MWe coal-fired facility in Muhlenberg County, Kentucky. The plant is located on the west bank of the Green River at Green River Mile 100.5. Construction for units 1 and 2 began in November 1959, and commercial operation began in May and November 1963. Each of these units has a nameplate rating of 704 MWe each. In February 1970, unit 3 was accepted for commercial operation. Fly ash from this plant is sluiced to a settling pond, with supernatant discharged at an average flow of 53.19 cfs to Jacobs Creek, a small tributary of the Green River.

This project is to construct a dredge pond near the Jacobs Creek ash pond capable of storing at least  $1 \times 10^6$  cubic yards of fly ash dredged from the ash pond. This will provide approximately 10 years of additional fly ash storage in the fly ash pond. Effluent from the dredge pond will be returned to the Jacobs Creek ash pond for discharge to Jacobs Creek.

Approximately 245 acres of land will be purchased under this project for the dredge pond although the pond itself will constitute only about 50 acres. Construction is expected to begin in June 1989, and dredging in February 1990. Based on the latest pond volume survey and forecasted operation, Paradise would be without fly ash storage space in November 1990 without this project.

This assessment is to evaluate the environmental consequences associated with the purchase and development of a new offsite area for dredged ash disposal at PAF.

#### Alternatives Considered

The selection of an environmentally acceptable disposal alternative was based on the following criteria:

1. A storage volume equivalent to a minimum  $1 \times 10^6$  cubic yards.
2. The proximity of the site to the active ash pond.
3. The cost of site development and operation.

4. An area that has favorable physical properties for ensuring no significant impacts to the environmental resources, including groundwater, surface water, biota, and cultural resources.

In the selection of a site for development of additional ash disposal, the following alternatives have been considered.

Alternative 1--Construct two dredge cells in the old scrubber landfill area.

Under this option two small dredge cells would be constructed in the old scrubber landfill area. Each cell would be filled three times by dredging. Each area would be reclaimed twice between dredgings by dewatering the ash and stacking the reclaimed ash on high ground in the old scrubber landfill. The total costs associated with this option are \$3,932,131. This is the highest cost option because of the high costs associated with reclaiming ash and moving it to other areas between dredging operations.

Alternative 2--Construct two dredge areas, one in the old scrubber landfill area, the other on an additional 245-acre tract.

Under this option dikes would be constructed in the old scrubber landfill area sufficient to contain 331,000 cubic yards of dredged material. In addition, a 245-acre tract of land would be purchased. This area would

be developed to contain the balance of 669,000 cubic yards of dredged material on 50 acres of the site. The total costs associated with this option are \$2,692,000. The costs associated with this option are less than for alternative 1 because the ash would not have to be moved from the dredging areas to other areas for permanent disposal. However, this option is higher in cost than alternative 3 because of the need to construct more diked areas.


**Alternative 3--Develop one dredged ash disposal area.**

Under this option, three potential sites were considered (see figure 1). The preferred site is on a 245-acre tract of land which would be purchased. Dikes capable of storing the entire 1 million cubic yards of material to be dredged would be constructed to contain a 50-acre dredge pond. This is the least investment alternative and is the proposed project. The total costs associated with this option are \$2,389,000. This option is less costly because there is no need to reclaim and haul ash to other areas for permanent disposal and it is more economical from a construction standpoint to develop one larger area than two small areas.

**Alternative 4--No action**

The no action alternative is infeasible because free water volume must be restored in the ash pond if the plant is to continue uninterrupted operation. Paradise Steam Plant is one of TVA's largest and most reliable plants and is essential to base load operation.



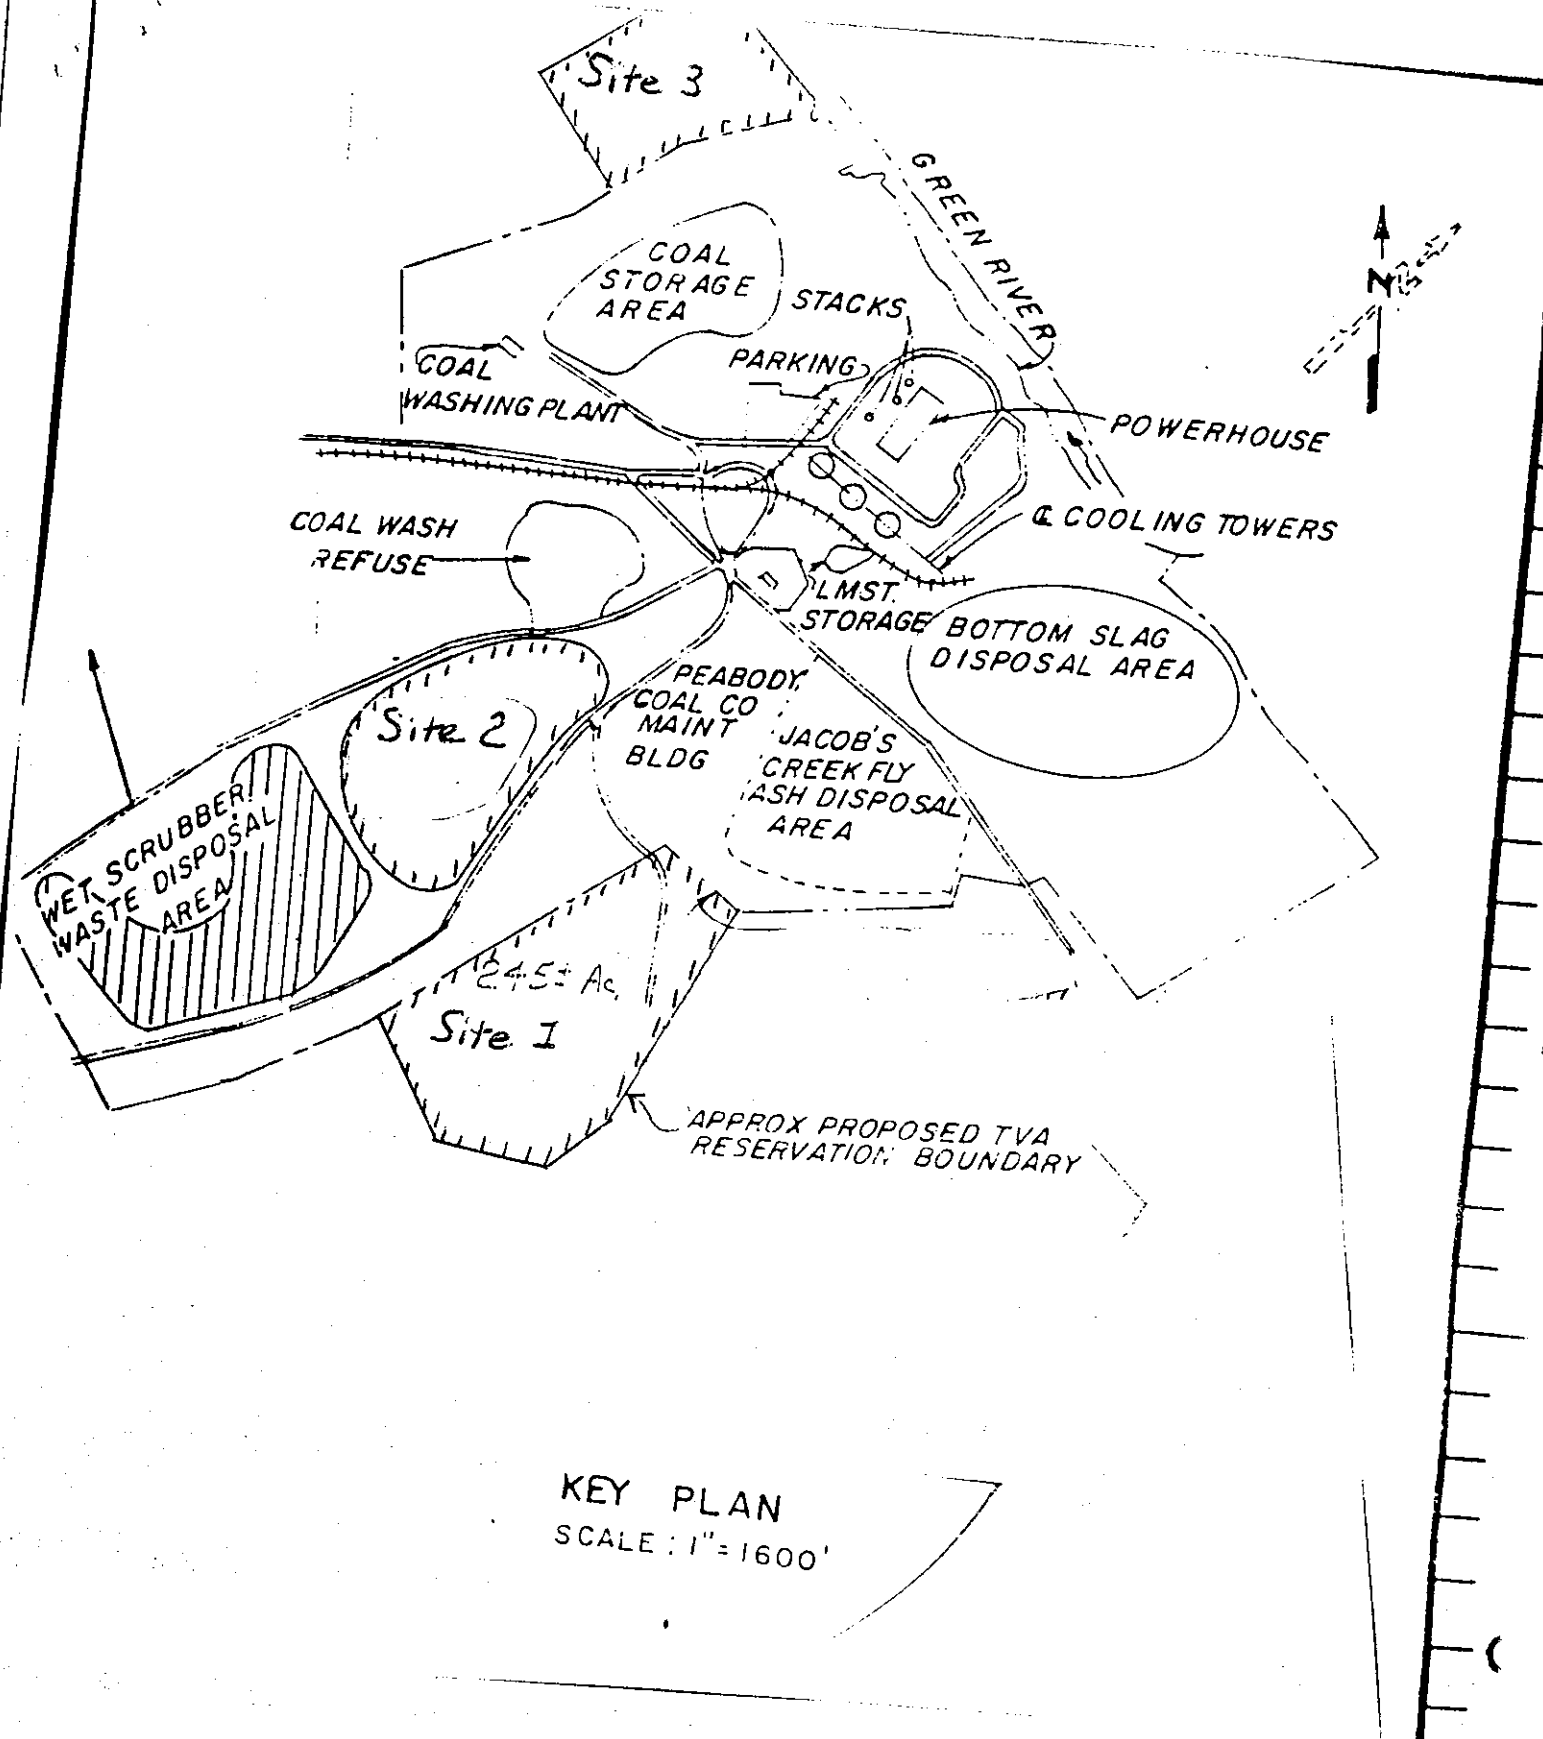

KEY PLAN  
 SCALE: 1" = 1600'

Figure 1  
 PARADISE FOSSIL PLANT  
 CONSTRUCT DREDGE POND AND DREDGE ASH POND

Potential Sites Considered

Site 1--Although the total acreage of this site is a little larger than each of the other two sites considered, site 1 would require development of the smallest area for the dredge pond. This site consists of land that was previously strip mined and has been reclaimed leaving a small pond of approximately 3.4 acres surrounded by open grassland. Part of this area is a depression bounded by hills or ridges about 50 feet in elevation along two sides and would require much less diking for construction of the 50-acre area to contain the desired dredge volume. Although this land is not currently a part of the TVA reservation, one of the two owners has indicated a willingness to sell approximately 169 acres of the 245-acre tract required by TVA.

Site 2--This area is a 140±-acre site west of the Jacobs Creek ash pond which was used for a short time for stacking of scrubber sludge wastes. It consists of previously mined lands which were reclaimed and is now open grassland. Two small hollows were left in the area which contain small ponds. This area was discussed in a previous EA for development of coal-wash refuse and scrubber sludge disposal areas. The area is on a fairly flat elevation about 100 feet above the ash pond elevation and would therefore require much more diking than the other two areas considered in order to contain the ash volume to be dredged in this project.

Site 3--This 100±-acre area is at the northern boundary of the current reservation adjacent to the Green River. It consists primarily of mined land which has been reclaimed. Strip mine pits in the area were left as part of the reclamation process. This area was considered in a previous EA for use as a permanent coal-wash fines refuse and dredge material disposal area. At that time the lake had already been partially filled with dredge materials from construction of a nearby coal barge docking facility. The area is currently used for disposal of miscellaneous dredged materials when required. Although development of this area would not require a great deal of diking to contain the desired volume of dredged ash, use of this area is complicated by other factors. Its remote distance from the active ash pond and its location on the other side of the plant would make it very difficult and costly to construct dredge lines to this site. It would also be difficult or impossible to reroute dredge pond return flow back to the existing ash pond. It is uncertain whether the water from this pond could meet NPDES permit limits enabling it to be discharged directly to the river without further treatment.

#### Preferred Alternative


Based on consideration of the engineering and economic factors discussed above, the preferred alternative is to construct the 50-acre dredge settling pond on site 1. This site will be purchased by TVA and developed for the disposal of  $1 \times 10^6$  cubic yards of dredged ash. Dikes

will be constructed from the best locally available material based on soil tests, probably obtained from a borrow area in the nearby scrubber stacking area. The top of the dikes will be at 460 feet of elevation (see figure 2). This area now drains toward upper Jacobs Creek. Return flow from dredging will be routed back to the ash pond and will flow by gravity through the existing natural drainage for the area adjacent to the preferred site. Diking will prevent flows into the upper Jacobs Creek area.

Upon completion of construction, piping will be assembled from the ash pond dredge to the dredge area. The estimated time to complete the dredging of  $1 \times 10^6$  cubic yards of ash from the active ash pond is approximately ten months. After completion of dredging the ash would be allowed to dewater and the area would be contoured to promote natural rainwater runoff. The ash will then be covered and seeded in accordance with State closure requirements. Appropriate erosion control features will be included in the design to allow for an environmentally acceptable final closure.

Completion of this project will restore approximately 10 years of storage volume to the active ash pond.

Consideration of the environmental factors associated with the use of the three areas considered is discussed in the following sections.

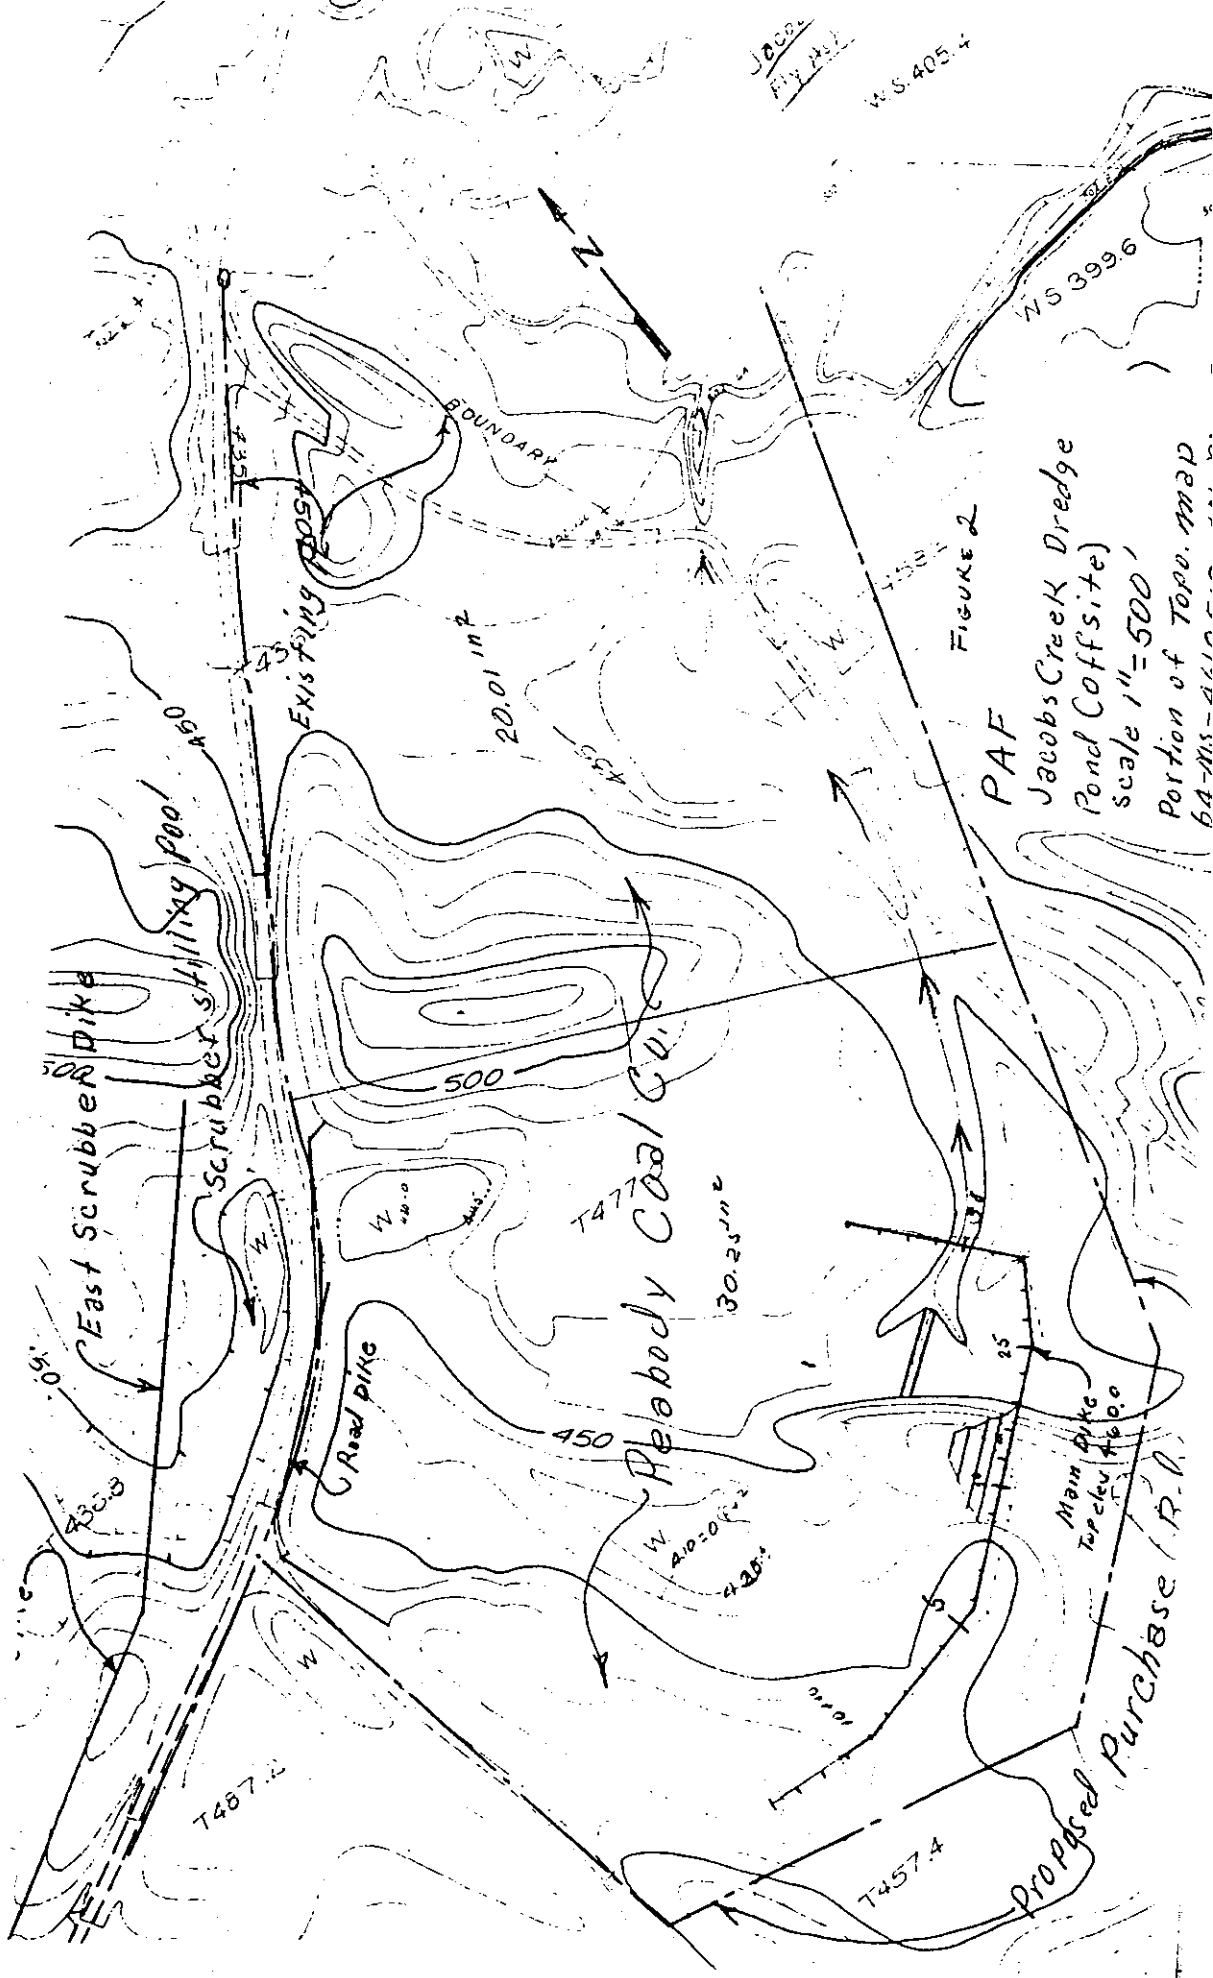

Jacob  
Fly Map

W.S. 405.4

W.S. 399.6

FIGURE 2

Jacobs Creek Dredge  
Pond Coffsite  
scale 1" = 500'  
Portion of Topo. map  
64-MS-410

PAF

GROUNDWATER QUALITY ASSESSMENT

Introduction

Paradise is located on the western bank of the Green River in Muhlenburg County, Kentucky. The area is underlain by Pennsylvanian Age sandstone and shales. The plant area is unique in the TVA system in that approximately half of the land surface is covered by spoil from surface strip mining of coal. Overburden in these areas consists of up to 75 feet of spoil composed of sandy, gravelly clay, mixed with rock fragments. In unmined areas remaining around the plant, an average of 15 feet of unconsolidated materials overlie the bedrock. This original unconsolidated overburden consists of terrace deposits, alluvial clays and silts, and residuum.

Groundwater at Paradise occurs in the fractures of the fine- to coarse-grained sandstone of the Pennsylvanian Age under semiconfined conditions. The only significant water-bearing units within the Pennsylvanian Age regional aquifer are the Lisman Formation and the deeply buried Caseyville Formation. Coal-stripping operations have removed the Lisman Formation in most of the upland areas. Where sandstone units of the Lisman Formation exist they receive direct infiltration and are susceptible to contamination from the surface. The Caseyville Formation has a potential for high well yields; however, since this aquifer occurs at considerable depth there is little likelihood that it will be developed.

Existing Groundwater Data

Table 1 shows mean values for parameters monitored in 1981, 1982, and 1983 from wells at the Paradise site. Figure 3 shows the locations of the monitoring wells. A review of the data shows iron and manganese concentrations are very high for some of the wells compared to the Drinking Water Standards (DWS), but concentrations could be elevated because of the metal casings used for some of the wells. Groundwater quality has been degraded at Paradise as indicated by the high concentration of residue, calcium, sulfate, and conductivity in table 1. In addition, the pH of all the wells was outside the DWS range of 6.5 to 8.5.


Figure 4 compares the composition of the well samples on the basis of equivalents (concentration/[atomic weight x valence]). The equivalent concentration of cations should equal the equivalent concentration of anions (the heights of the bars in figure 4 should be equal). Part of the discrepancy between anions and cations observed in figure 4 is because the iron and manganese concentrations were neglected. Some of the wells were cased with metal pipe and, therefore, the metals data in some wells might be unreliable. The comparisons of figure 4 are, therefore, based on the mineral content of the samples excluding iron and manganese.

Figure 4 shows that calcium generally is the predominate cation in most wells although magnesium constitutes a slightly larger portion of the cations in well B5 than the rest of the wells. Sulfate is the predominate anion followed by the carbonates in all the wells.





# PARADISE FOSSIL FUEL PLANT

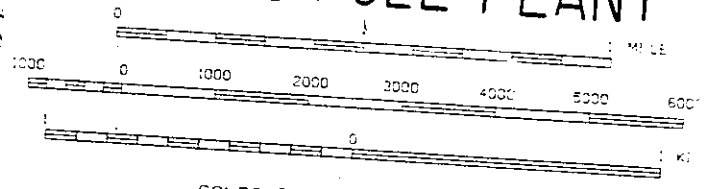

CONTOUR INTERVAL 10 FEET  
DASHED LINES REPRESENT HALF-INTERVAL CONTOUR  
Plant site area revised from aerial photography dated July 1985

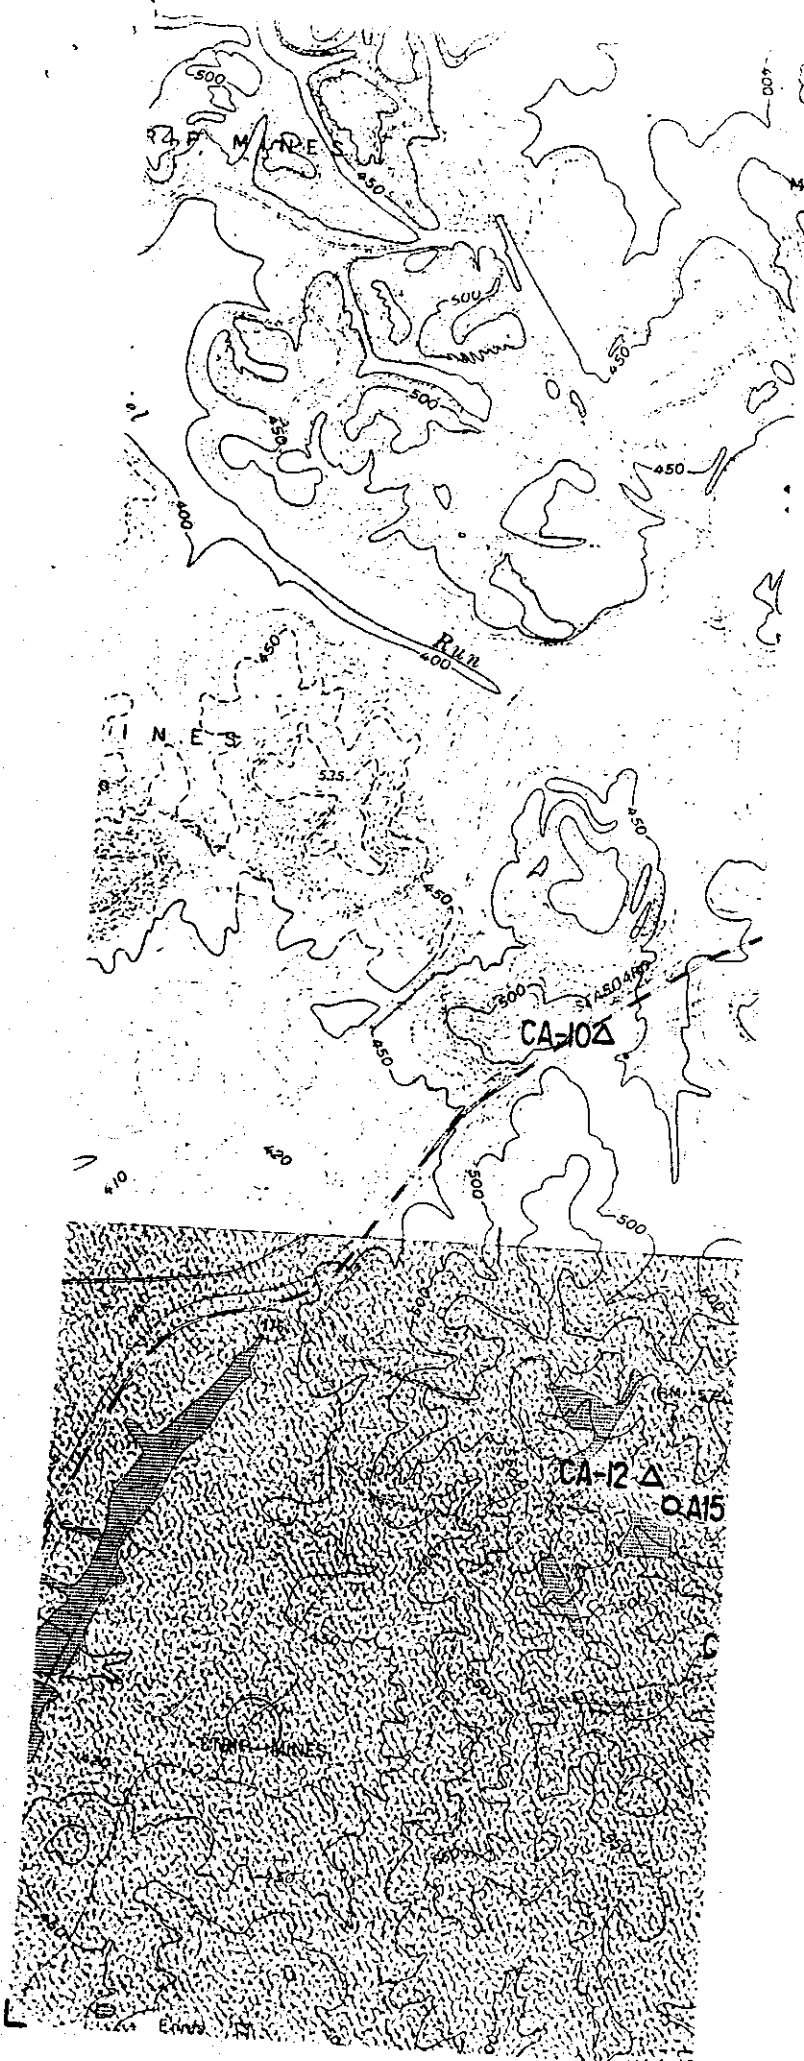



Figure 3

## WELL SITES

- Sampling Wells
- △ Monitoring Wells

All wells not useable at present for sampling.  
Compiled by Messing

FIGURE 4

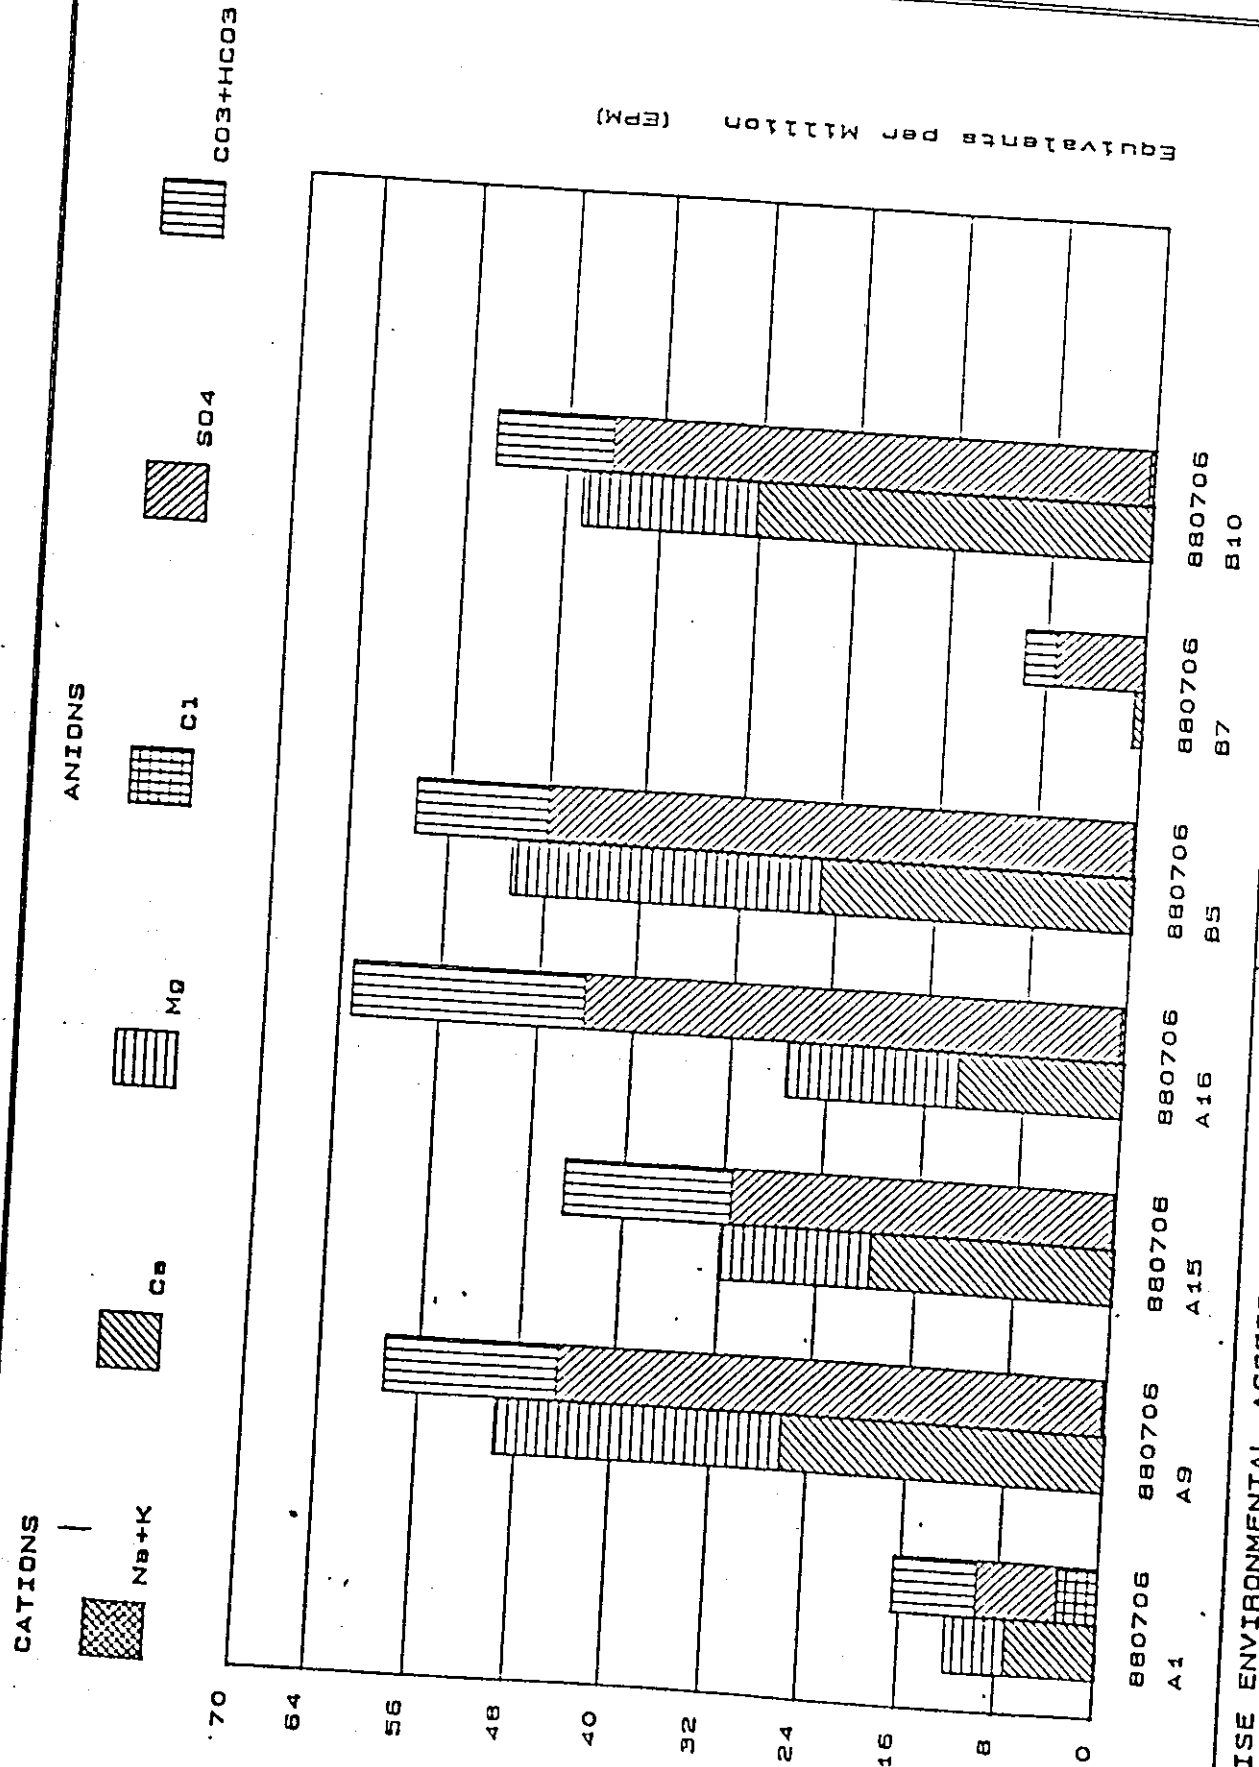

PARADISE ENVIRONMENTAL ASSESSMENT  
AVERAGE CONCENTRATIONS

1981-1983 DATA

Well A1 is somewhat different from the rest of the wells in that chloride, sulfate, and bicarbonate all contribute about equal amounts to the anion total. Wells A1 and B7 are distinct from the rest of the wells in that the residue (TDS) concentration is much lower than the rest. This is indicated by the shortness of the bars in figure 4. Well B7 is distinct from all the other wells in that its pH was 10 while the pH of all the rest of the wells was approximately 6.

Additional groundwater data were collected to confirm the discussion above. These data are also shown in table 1. Wells A1 and A9 were sampled as well as two ponds. Pond A is the pond found at Site 3 while Pond B is the pond at Site 1. The August 1988 data for Wells A1 and A9 compare within the order of magnitudes established during the 1981-83 period with the exception of Mg and Ba in well A1 and Ba and Fe in well A9 indicating the water quality at these two locations has been relatively stable. The pond data are of interest because they lie within the ranges of the well data. This indicates that, with the exception of iron and zinc, the well data are probably reliable. However, the 1988 analysis showed that cadmium was higher than the DWS in wells A1 and A9. The cadmium levels in the ponds were below the DWS. This suggests that the cadmium in the groundwater is already high. The lower cadmium levels in the ponds might be the result of the oxidizing conditions provided by the exchange with the atmosphere or simply a cadmium concentration gradient in the groundwater under the plant site. Further data will be needed to determine whether cadmium is naturally occurring in the strip

mine areas. Although the casings possibly increased the iron and zinc concentrations for some of the wells (A1 and A9 in particular) the pond data indicates that iron concentrations in the groundwater are indeed high. The pond data also confirms that the groundwater beneath the plant site is generally of poor quality.

#### Groundwater Hydrology

Groundwater occurs on the Paradise site in the Lisman Formation where present and in the spoils remaining from strip mine operations. The Lisman Formation in the vicinity of the plant has been disturbed to the point that it is not considered usable as a water source. The deeper Caseyville Formation is expected to receive little use because of its depth and is not of concern in this evaluation because low permeability formations exist between it and overlying groundwaters.

Groundwater found in the upper strata is derived from local precipitation and generally conforms to topography. Depth to groundwater in the wells located on the site range from 6 to 22 feet below surface. There are numerous ponds and lagoons (many are abandoned strip mine pits) in the area that are directly influenced by the groundwater. Several TVA ponds also influence groundwater elevations and local groundwater movement patterns. Groundwater gradients in the plant site areas indicate movement is toward the Green River and Jacobs Creek drainage basins.

Proposed dredge pond sites 1 and 3 are abandoned strip mine pits. The water in these ponds is believed to be in direct connection with area groundwater.

#### Leachate Quality

The expected quality of leachate from the dredged ash was estimated in three ways.

The first estimate was based upon an EP Toxicity Test performed on a composite of three samples obtained from the existing fly ash pond. The EP Toxicity Test is an extraction performed over 24 hours at pH 5. The results from the composite sample are shown in table 2. If the fly ash extract were to exceed the maximum concentration shown in table 2, it would be classified as a hazardous waste. Table 2 shows the fly ash to be nonhazardous.

The second estimate of leachate quality was obtained from an examination of the ash pond effluent quality shown in table 3. Table 3 was based on data collected during the period 1973 to 1974 and 1985 to 1988 and is presented to show the typical concentration ranges.

Because the ash pond effluent is more oxidized than the leachate, the ash pond effluent concentrations will be lower for most species. Even so, a review of data for the period 1976 through 1980 indicated the ash pond concentrations of cadmium, iron, and manganese exceeded the DWS during

each of the five years. The EP Toxicity extract shown in table 2 also shows cadmium above the DWS. Table 3 also shows the ash pond water to have been of very low pH in 1973-74, lower than the pH 5 which is the basis for the EP Toxicity Testing. Solubility of most metals generally increases with lower pH. For example, the pH of the ash pond has risen significantly since the mid-1970s primarily due to diversion of the bottom ash pond discharge into the fly ash pond. As a result, several of the metal concentrations in the 1985 to 1988 period are observed to be less than in the period 1973 to 1974. It is uncertain whether the pH of the leachate will reflect the acidic nature of the ash pond characteristic of the mid-1970s or the more neutral pH of the mid-1980s. Generally, however, the pH at the bottom of ash ponds where the leachate originates is lower than the ash pond discharge. Acidic conditions could result in the leachates from the dredge pond that contains some metal concentrations in excess of the DWS. In order to determine how the dredged ash will behave, data will be collected from an interim internal dredge cell within the ash pond which will be conducted during November and December of 1988.

Table 2  
 EP TOXICITY TEST RESULTS - PARADISE  
 FLY ASH COMPOSITE

<u>Analysis Performed</u>	<u>Result</u>	<u>Maximum Concentration Before Declared Hazardous Waste</u>	<u>DWS</u>
Arsenic, RCRA extract, µg/L	<100	5,000	50
Selenium, RCRA extract, µg/L	<100	1,000	10
Cadmium, RCRA extract, µg/L	17	1,000	10
Lead, RCRA extract, µg/L	70	5,000	50
Barium, RCRA extract, µg/L	300	100,000	1,000
Chromium, RCRA extract, µg/L	<50	5,000	50
Silver, RCRA extract, µg/L	<10	5,000	50
Mercury, RCRA extract, µg/L	<2	2,000	2
pH on RCRA Waste, std. units	7.9	<2 or ≥12.5	6.5-8.5

A third estimate was derived from an analysis of the elemental composition of the ash itself. The elemental composition of the ash composite sample taken from the ash pond (table 4) was used as input to a prerelease version of FOWL (Fossil-Fuel Waste Leachate Computer Code) to generate an estimate of leachate quality. FOWL is the Electric Power Research Institute's computer code which calculates the quantities, aqueous concentrations, and release durations of selected inorganic elements leached from fossil fuel wastes. The code uses a thermodynamic approach to calculate the aqueous concentration of elements which are in equilibrium with the solid phase of the elements in the fly ash matrix. Table 5 shows the predictions made by FOWL for a pH range of 4 to 8 which is the pH range of the ash pond over the past 15 years.

Table 3

## PARADISE FLY ASH POND EFFLUENT CHARACTERISTICS

Parameters	Minimum	Average	Maximum
Flow, gal/min	3,100	6,212.5	8,800
Alkalinity, phenol, mg/L as CaCO <sub>3</sub>	0	0	0
Conductivity, $\mu$ mhos/cm	615	810	1,125
Hardness, total, mg/L as CaCO <sub>3</sub>	185	261.5	520
pH, std. units	3.6/6.2	4.4	6.3/8.4
Solids, dissolved, mg/L	141	508	820
Solids, suspended, mg/L	2	62.5	256
Aluminum, mg/L	3.6/.12	7.2/.29	8.8/.76
Ammonia, mg/L as N	0.02	0.43	1.4
Arsenic, mg/L	<0.005/.002	0.010/.004	0.023/.008
Barium, mg/L	0.2	0.3	0.4
Beryllium, mg/L	<0.01	0.01	0.02
Cadmium, mg/L	0.023/<.001	0.037/.004	0.052/.008
Calcium, mg/L	94	136	180
Chloride, mg/L	5	7	14
Chromium, mg/L	0.012/.004	0.067/.002	0.17/.001
Copper, mg/L	0.16/.009	0.31/.012	0.45/.009
Cyanide, mg/L	<0.01	<0.10	<0.01
Iron, mg/L	0.33/.001	1.44/.950	6.6/5.2
Lead, mg/L	<0.01	0.06/.001	0.2/.003
Magnesium, mg/L	9.4	14	20
Manganese, mg/L	0.29/.047	0.48/.29	0.63/.52
Mercury, mg/L	<0.0002	0.0003	0.0006
Nickel, mg/L	0.06/.004	1.1/.026	0.13/.062
Phosphate, total, mg/L as P	<0.01	0.02	0.06
Selenium, mg/L	<0.001	0.002/.005	0.004/.012
Silica, mg/L	10	12.6	15
Silver, mg/L	<0.01	<0.01	<0.01
Sulfate, mg/L	240	358	440
Zinc, mg/L	1.1/.01	1.51/.042	2.7/0.12

Single values are data from the 1973 to 1974 period.

Values above the slash are from the 1973 to 1974 period.

Values below the slash are from the 1985 to 1988 period.



Table 4  
PARADISE ASH ANALYSIS

<u>Element</u>	<u>Composition (mg/kg)</u>
Al =	129200.000
Ba =	380.000
Ca =	11100.000
Cr =	190.000
Mo =	38.000
Si =	221100.000
Sr =	170.000
S =	800.000
As =	107.000
B =	513.000
Cd =	5.000
Cu =	150.000
Fe =	166900.000
Mg =	5100.000
Na =	3000.000
Ni =	120.000
Se =	5.000
Zn =	440.000

Composite of three samples taken from  
Paradise fly ash pond in July 1988.

WRC 0100K

Table 5

FOWL LEACHATE CONCENTRATIONS PREDICTIONS

Constituent	DWS	Leachate Concentration		
		pH = 4	pH = 6	pH = 8
Al, µg/L		4037	149	822
Ba, µg/L	1000	254	253	253
Ca, mg/L		395	394	394
Cr, µg/L	50	40	2	2
Mo, µg/L		1879	679	672
Si, mg/L		26	26	27
Sr, µg/L		1624	1616	1620
SO <sub>4</sub> , mg/L	250	960	945	945
As, µg/L	50	109	99	99
B, µg/L		2856	3907	5343
Cd, µg/L	10	34	2	2
Cu, µg/L	1000	244	4	4
Fe, µg/L	300	511	21	5
Mg, mg/L		8	2	1
Na, mg/L		8	11	14
Ni, µg/L		197	13	9
Se, µg/L	10	1	41	104
Zn, µg/L	5000	747	10	10
TDS, mg/L	500	772		761

FOWL predicts the highest concentrations of most elements at pH 4 and the lowest at pH 8. The exception is selenium which increases with pH and shows the potential for exceeding the DWS at the higher pH's. FOWL suggests that strontium concentrations will exceed 1 mg/L which is confirmed by the well and pond data shown in table 1 in the EA.

No field data exist to compare to the FOWL predictions for molybdenum and boron both of which are predicted to exceed 1 mg/L. FOWL also indicates increased cadmium concentrations at the low end of the pH range. Should leachate pH be more near 6 than 4, cadmium concentrations should not be elevated. Although FOWL predicts arsenic concentrations in excess of the DWS, FOWL is not very useful for predicting concentrations below 100 µg/L and therefore its arsenic estimate should be discounted.

#### Ranking of Alternative Sites

Although the groundwater is of poor quality across the site, areas near wells A1 and B7 are probably where water quality has been degraded the least. However, the water quality even in these areas is inferior to river water quality and, therefore, would not likely be developed as a water supply source.

Because the ash leachate will likely contain elements which will exceed the DWS, attenuation of the metals such as cadmium through adsorption or precipitation would be desirable. Adsorption would be facilitated if

some soil separated the bottom of the dredge pond from the groundwater. Precipitation would be facilitated if the pH of the leachate could be raised.

Proposed sites 1 and 3 would offer no potential for attenuation if wastes were discharged directly into the existing ponds because the fly ash would be in direct contact with the groundwater. There would be no soil to adsorb some of the metals in the leachate and the pH would be expected to remain low, thus removing the potential for much precipitation.

Site 2 could more easily be constructed with soil between the pond bottom and the groundwater. In addition, the groundwater near site 2 is high in pH and the nearby wet scrubber sludge area is also expected to have an elevating effect on the pH of groundwater beneath sites 1 and 2. Therefore, leachate percolating into the groundwater at sites 1 and 2 might have its pH raised by the groundwater and this could help precipitate metals.

Control of dredge pond hydrology could also be accomplished on site 2. Leachate flux rates to groundwater cannot be calculated without site-specific data, but are estimated to be very large, several hundred thousand gallons per year or greater. Because of precipitation, this flux rate would continue indefinitely until the site is covered to prevent infiltration. However, the dredge pond could be drained following the dredging activity, thus substantially decreasing the leachate flux to groundwater.

Conclusion

Groundwater resources in the Paradise area have been contaminated by strip mine spoil deposits and by onsite coal and waste handling. The degree of additional contamination that will result from development of a new fly ash dredge pond cannot be accurately determined; however, increased concentrations of several metals have been determined to be possible. Any impacts to groundwater will be localized, with increased fluxes to the Green River and/or Jacobs Creek.

Sites 1 and 3 are strip mine pits and are believed to be directly connected with area groundwater. These sites may be less desirable from an environmental standpoint unless specific design considerations are included to lessen groundwater impacts.

Site 2 is located in the Jacobs Creek drainage basin on a gentle slope. The bottom of the dredge pond could be developed above the groundwater table. Drainage of the dredge pond could be accomplished following dredge activities to reduce the flux of groundwater pollutants.

Jacobs Creek is largely comprised of flows from strip mine drainage and the active ash pond. Water quality of the creek is improving as stabilization of strip mine lands occur. Protection of groundwater quality and recharge to surface streams should be provided to the extent practicable.

### SURFACE WATER

There is the potential for some adverse impacts to surface water quality from surface water runoff during the period of dredge pond construction. However, with the implementation of "Best Management Practices" (BMPs) to control surface water runoff, these impacts would be short term and relatively minor.

During operation, the use of BMPs to control surface water runoff from the exterior pond dikes would ensure that no significant surface water impacts result. Routing of the dredge pond discharges through the existing ash pond for subsequent discharges through the currently permitted ash pond outfall should not significantly alter the quality of the current ash pond discharges. The discharges of dredge pond waters in this manner would have no significant impact on the quality of the receiving surface waters.

Thus it can be concluded the construction and operation of the proposed dredge pond would have no significant adverse impacts on the quality of the surface water in the Paradise area.

### AQUATIC ECOLOGY

Examination of available information for the region and an onsite survey showed lakes capable of sustaining fish populations at two of the sites and seepage ponds at the third.

Pond A (site 3) located adjacent to PAF on the north drains directly to the Green River. This lake has been partially filled with dredge spoil removed from the coal barge docking facility. Although approximately 40 percent of the original lake has been filled, the gentle contours of the area around the remaining portion of pond A make it attractive to local anglers. The remainder of pond A is bordered on the northwest by the proposed road which provides access to a proposed concrete launch ramp on the Green River. Surveys taken during June 1988 and in 1985/1986 showed the pond A fish assemblage (primarily bluegill and largemouth bass) to be limited in numbers and in poor condition.

Site 2 is located in an area already impacted by scrubber sludge. The entire area has been diked and recontoured from the post-mining land use plan in order to serve its new role. Fish surveys made in ponds at site 2 in 1981 showed a small pond assemblage typical of the region. However, most of these ponds have been removed; therefore site 2 would have the least fisheries impact of the three proposed areas.

Site 1 contains a teardrop shaped lake of about 1.4 ha (3.4 ac) area. Approximately 60 percent of the shoreline had dense stands of Typha, but with good access around the perimeter of the lake. The water was quite clear provided the deep substrate (>2 feet) was undisturbed. The central portion of the lake was over five meters in depth and free of submersed vegetation; whereas the edges had dense growth of Mirophyllum sp. (water milfoil).

Fish samples were collected using experimental gill nets, electrofishing, and hook and line capture. Seining was not attempted because of the soft deep substrate. The fishery in site 1 lake was comprised primarily of stunted largemouth bass and bluegill. The small size and poor condition of the largemouth bass highlighted the poor fishery. This condition may have been alleviated if local anglers could have removed some fish from the pond; however, this site is behind a locked gate.

In summary, the fishery at site 1 is limited primarily because there has been little or no exploitation of the stocked populations. This has resulted in stunted populations with poor recreational value. At site 2 there would be little fisheries impact. Site 3, although containing a limited fishery, does receive local fishing use. Because of the existing and potential for enhanced recreation and natural resource value of the lakes of sites 1 and 3, development of site 2 for the fly ash pond is preferable from the standpoint of fisheries impacts.

Because intermittent chronic toxicity has occurred in previous studies of ashpond effluent at Paradise Steam Plant, some level of toxicity could occur during the dredging project. The biota of lower Jacobs Creek could be impacted by low pH discharges or metals resuspended from sediments disturbed during dredging. However, significant adverse impacts to the biota of Jacobs Creek are not expected. To verify the no significant adverse impact assumption, TVA will conduct a 7-day static renewal



toxicity test using Ceriodaphnia and larval fathead minnows during the interim internal dredging operation and evaluate changes from baseline toxicity. If significant increases in toxicity are detected, recommendations will be developed for future work.

Additionally, previous studies showed that chronic toxicity was indicated for the 24-hour samples and this toxicity increased (although not linearly) with increasing retention time (there were no notable differences in routine chemical parameters). Due to possible differences between the laboratory-scale test and actual ash pond conditions, the time effect of dredging on toxicity of the ash pond discharge can best be determined in ambient conditions. Accordingly follow-up toxicity studies will be conducted upon completion of the dredging operation to evaluate the differences in toxicity resulting from the increased ash pond volume. If toxicity is identified, appropriate corrective action will be implemented as required by TVA's NPDES permit.

#### WETLANDS

A wetlands inspection was carried out at Paradise Fossil Plant to determine the status of wetlands known to exist on three areas proposed for a new fly ash dredge pond. Wetlands on these areas have changed very little since initial inspections were carried out in 1980. Ponds on all sites have remained in an open water condition. Submergent or floating-leaved aquatic bed wetlands which often evolve on ponds of this

type have not developed. Algae and aquatic moss have developed along certain areas of shoreline where sunlight penetration has encouraged the growth of some biomass. Wetlands that surround the ponds on all three sites are classified (Cowardin, et al., 1979) as:

System - Palustrine

Class - Emergent Wetland

Subclass - Persistent

Water Regime Modifier - Semipermanently Flooded

Other Modifier - Excavated

The major wetland species that have developed around these ponds are common reed (Phragmites communis), common cattail (Typha latifolia), and slender spike rush (Eleocharis acicularis). These are essentially the same species observed on these ponds the last eight years.

Ponds on any of the sites should not be considered rare, unique, unusual, or significant wetlands. They do, however, contribute to the wildlife resources of the area by providing habitat for migrant-wintering and resident waterfowl, shore birds, wading birds, and marsh birds. These ponds are also the most biologically active and productive parts of all three sites where the surrounding terrestrial habitat is principally monotypic open grasslands.

In addition to wetlands which have developed around the ponds, other smaller wetlands have developed sporadically across each site. Opportunistic wetlands have developed where topographic depressions, disrupted drainage ways, and constructed drain ways were created during the reclamation process. These small wetlands do not contribute to wildlife significantly but are important to the eventual recovery of disturbed habitat. These wetlands, like all wetlands on the site, are biologically healthy and contribute to higher quality runoff from each area.

Site 1: This is the smallest of all three sites selected for the fly ash dredge pond. The site contains an open water pond of approximately 3.4 acres, surrounded by open grassland. Emergent wetlands are present along the edge of the pond and along a small ditch that drains into the north end.

Development of site 1 will not impact any significant wetland habitats. There will be some loss of migrant-wintering waterfowl, shore bird, wading bird, and marsh bird habitat. There would also be some loss of resident Canada goose habitat.

Site 2: Site 2 is almost entirely open grassland with a small pond located on the north and west boundaries. Both ponds are less than one acre in size and support emergent wetlands along the shallow shoreline. The pond on the north boundary supports a good stand of slender spike

rush which is excellent waterfowl, marsh, and shore bird food. This is the only pond on the three sites where this particular wetland plant was identified. The two ponds on site 2 provide only very limited habitat for any wetland wildlife species because of their small size and the amount of present disturbance on and near the site.

Site 3: Site 3 contains the largest pond of the three areas. This pond, which is approximately 8 to 10 acres in size, supports emergent wetlands along most of the shoreline and provides habitat for migrant-wintering and resident waterfowl, shore birds, wading birds, and marsh birds. This pond is big enough and biologically productive enough to attract large numbers of these species. It appears to support a healthy food chain as evidenced by large numbers of aquatic invertebrates, reptiles, and amphibians and the evidence of heavy fishing pressure along the shoreline. The majority of the runoff that empties into the pond on site 3 enters from a large wetland situated in a cove at the base of a ridge just north of site 3. This wetland is an important feature of the habitat surrounding site 3 and should be left undisturbed if this site is developed.

The development of a new fly ash dredge pond will not impact significant wetlands or wetland habitat on any of the selected sites and there is no practicable alternative to impacting these de minimus wetlands. The areas surrounding these sites support habitat similar to that which would be disturbed for the fly ash dredge pond. In addition, open water habitat which would be principally disturbed on sites 1 and 3 appears to have

recently undergone considerable expansion just west of site 2. Thus, from the wetlands viewpoint, site 2 is the preferred site for development of a fly ash dredge pond. The development of this site would result in the fewest impacts to wetlands and, thus, be consistent with TVA policy on implementation of Executive Order 11990, Protection of Wetlands.

Site 3 is the least desirable site due to the presence of the highest quality wetlands and wetland habitats of the three selected sites.

#### WILDLIFE

Terrestrial habitat on the three sites is almost entirely open grasslands with some portions supporting shrubby tree growth. The major herbaceous species are fescues (Festuca sp.) and Sericea lespedeza (Lespedeza curreata). The existing ecotone is presently providing habitat for small furbearers, rodents, reptiles, and bird life, such as eastern meadowlark and horned lark, which prefer open grasslands and are abundant on all the areas. The existing terrestrial habitat is also attractive feeding ground for several raptor species, such as American kestrel, red-tailed hawk, and northern harrier. These areas are also expected to attract other predators, such as foxes and coyotes, which will utilize the abundant rodent populations. There is evidence of white-tailed deer use of the site, and the grasslands have attracted a good population of resident Canada geese which are nesting around several of the ponds.

The ponds and surrounding wetland habitat support a variety of organisms from the bottom of the food chain up. The ponds, particularly on site 3, are inhabited by substantial numbers of aquatic insects, fish, amphibians, and reptiles. This, in turn, has attracted a variety of

resident and migratory avian wetland wildlife species. The emergent vegetation along the shoreline has further encouraged wildlife by providing cover, food, and nesting habitat for many passerines, wading birds, shore birds, and marsh birds.

There are no known threatened or endangered or other sensitive species which would be affected by the proposal. The development of a new fly ash dredge pond will not impact significant wildlife habitat on any of the selected sites. The areas surrounding these sites support habitat similar to that which would be disturbed for the fly ash dredge pond. Site 2 is the most disturbed of the three selected areas. The site is bordered on three sides by heavily used roads; large conveyor machines are presently on the area; and parts of the site do not appear to have been completely reclaimed. Therefore, from a wildlife standpoint site 2 is the preferred site for development of a fly ash dredge pond. The development of this site would result in the fewest impacts to wildlife habitats. Site 3 is the least desirable site due to the presence of the highest quality wildlife habitats of the three selected sites.

#### CULTURAL RESOURCES

The proposed fly ash pond would not affect cultural resources at any of the three sites. All three sites proposed for the fly ash pond have been previously altered by mining to the extent that investigations for cultural resources are not warranted. A historical site, Old Airdrie

Furnace, is located downstream of Paradise at Green River mile 99L. Site 3 is bordered on the northwest by a proposed road which would provide access to the furnace. No adverse effects on this historic site would result from development of the dredge pond at this location provided access to the furnace is maintained.

#### AIR QUALITY

Construction of the proposed dredge pond will result in temporary fugitive dust emissions from clearing and grading during site preparation. Gasoline and diesel fueled equipment and vehicles used in construction will emit minor amounts of combustion pollutants, such as particulates, carbon monoxide, and nitrogen oxides. If debris cleared from the site is disposed of by open burning, additional small amounts of particulates and carbon monoxide will be released. Any open burning will be conducted in accordance with applicable State and local regulations.

Air quality impacts during operation will depend on the method of disposal. Material will be hydraulically dredged and conveyed to the new pond by pipe. Any air emissions from transport will be negligible. If either site 1 or 3 is chosen, all material will be handled and ponded wet. Fugitive dust from such operations will be minimal. If site 2 is chosen, stacking will be necessary. Material in the disposal pile will initially be wet. As necessary, the pile will be wetted to reduce dust emissions. Surfaces will be revegetated as soon as practical, and the active area of the pile will be kept as small as possible to further reduce dust.

With proper mitigation, this project should not significantly impact air quality.

#### FLOODPLAIN

All three of the candidate sites are located outside the limits of the identified 1-percent chance (100-year) and 0.2-percent chance (500-year) floodplains and would therefore be consistent with the requirements of Executive Order 11988 and TVA's floodplain management policy. Normal site drainage practice would be followed in providing drainage from the local site area.

#### CONCLUSION

Although use of site 2 would result in the least environmental impacts, none of the sites considered support unique or irreplaceable environmental resources or habitats. Site 3 contains the best wildlife habitat, highest quality wetlands habitats, and the best fishery resource. No significant environmental impacts will result from the development of any of these areas provided proper considerations are incorporated into design of the facility to protect groundwater resources from further degradation and commonly accepted best management techniques



are used during construction, operation, and reclamation to prevent erosion and air quality impacts.

COMMITMENTS

1. Water quality data will be collected from the discharge of the internal ash pond dredge cell to determine whether dredged ash will revert to more acidic conditions when isolated from the main body of the ash pond and its neutralizing effects. Changes in indicator metal concentrations and pH will be monitored over the 4- to 6-week dredge operation with at least two sample collections. If statistically significant changes in metals concentrations or pH drops of 1.5 units or greater occur, the analysis of leachate impacts on groundwater resources will be reevaluated.
2. A 7-day static renewal toxicity test using Ceriodaphnia and larval fathead minnows will be conducted during the interim internal dredging operation to evaluate changes from baseline toxicity. If significant increases in toxicity are detected, recommendations will be developed for future work. If water quality data collected under commitment 1 indicates drops in pH of more than 1.5 units, the 7-day static renewal toxicity tests will be repeated.

3. Follow-up toxicity studies will be conducted upon completion of the dredging operation to evaluate the differences in toxicity resulting from the increased ash pond volume. If significant toxicity is identified, appropriate corrective action will be implemented.
  
4. The ponded area in site 1 will be filled so that the pond bottom is two feet above the existing groundwater level. Fill will consist of material approved by the State of Kentucky geologist. The discharge ditch will meet applicable State requirements.
  
5. The dredge pond will be drained, sloped, covered, and reseeded to decrease surface infiltration that could produce surface seeps and/or the leachate flux to groundwater. This work will be performed within a reasonable time after completion of dredging activities.



DRAFT ENVIRONMENTAL ASSESSMENT  
DEVELOPMENT OF DREDGED ASH DISPOSAL AREA  
PARADISE FOSSIL PLANT

Introduction

Paradise Steam-Electric Plant (PAF) is a 3-unit, 2,558-MWe coal-fired facility in Muhlenberg County, Kentucky. The plant is located on the west bank of the Green River at Green River Mile 100.5. Construction for units 1 and 2 began in November 1959, and commercial operation began in May and November 1963. Each of these units has a nameplate rating of 704 MWe each. In February 1970, unit 3 was accepted for commercial operation. Fly ash from this plant is sluiced to a settling pond, with supernatant discharged at an average flow of 53.19 cfs to Jacobs Creek, a small tributary of the Green River.

This project is to construct a dredge pond near the Jacobs Creek ash pond capable of storing at least  $1 \times 10^6$  cubic yards of fly ash dredged from the ash pond. This will provide approximately 10 years of additional fly ash storage in the fly ash pond. Effluent from the dredge pond will be returned to the Jacobs Creek ash pond for discharge to Jacobs Creek.

(NPDAS No. KY0004201, Discharge No. 001)

Approximately 245 acres of land will be purchased under this project for the dredge pond although the pond itself will constitute only about 50 acres. Construction is expected to begin in June 1989, and dredging in February 1990. Based on the latest pond volume survey and forecasted operation, Paradise would be without fly ash storage space in November 1990 without this project.

This assessment is to evaluate the environmental consequences associated with the purchase and development of a new offsite area for dredged ash disposal <sup>operation</sup> at PAF.

#### Alternatives Considered

The selection of an environmentally acceptable disposal alternative was based on the following criteria:

1. A storage volume equivalent to a minimum  $1 \times 10^6$  cubic yards.
2. The proximity of the site to the active ash pond.
3. The cost of site development and operation.

4. An area that has favorable physical properties for ensuring no significant impacts to the environmental resources, including groundwater, surface water, biota, and cultural resources.

In the selection of a site for development of additional ash disposal, the following alternatives have been considered.

Alternative 1—Construct two dredge cells in the old scrubber landfill area.

Under this option two small dredge cells would be constructed in the old scrubber landfill area. Each cell would be filled three times by dredging. Each area would be reclaimed twice between dredgings by dewatering the ash and stacking the reclaimed ash on high ground in the old scrubber landfill. The total costs associated with this option are \$3,932,131. This is the highest cost option because of the high costs associated with reclaiming ash and moving it to other areas between dredging operations.

Alternative 2—Construct two dredge areas, one in the old scrubber landfill area, the other on an additional 245-acre tract.

Under this option dikes would be constructed in the old scrubber landfill area sufficient to contain 331,000 cubic yards of dredged material. In addition, a 245-acre tract of land would be purchased. This area would

be developed to contain the balance of 669,000 cubic yards of dredged material on 50 acres of the site. The total costs associated with this option are \$2,692,000. The costs associated with this option are less than for alternative 1 because the ash would not have to be moved from the dredging areas to other areas for permanent disposal. However, this option is higher in cost than alternative 3 because of the need to construct more diked areas.

#### Alternative 3—Develop one dredged ash disposal area.

Under this option, three potential sites were considered (see figure 1). The preferred site is on a 245-acre tract of land which would be purchased. Dikes capable of storing the entire 1 million cubic yards of material to be dredged would be constructed to contain a 50-acre dredge pond. This is the least investment alternative and is the proposed project. The total costs associated with this option are \$2,389,000. This option is less costly because there is no need to reclaim and haul ash to other areas for permanent disposal and it is more economical from a construction standpoint to develop one larger area than two small areas.

#### Alternative 4—No action

The no action alternative is infeasible because free water volume must be restored in the ash pond if the plant is to continue uninterrupted operation. Paradise Steam Plant is one of TVA's largest and most reliable plants and is essential to base load operation.

0 2

Figure 1

CONSTRUCT DREDGE POND AND DREDGE ASH POND



## Potential Sites Considered

Site 1—Although the total acreage of this site is a little larger than each of the other two sites considered, site 1 would require development of the smallest area for the dredge pond. This site consists of land that was previously strip mined and has been reclaimed leaving a small pond of approximately 3.4 acres surrounded by open grassland. Part of this area is a depression bounded by hills or ridges about 50 feet in elevation along two sides and would require much less diking for construction of the 50-acre area to contain the desired dredge volume. Although this land is not currently a part of the TVA reservation, one of the two owners has indicated a willingness to sell approximately 169 acres of the 245-acre tract required by TVA.

Site 2—This area is a 140~~0~~ acre site west of the Jacobs Creek ash pond which was used for a short time for stacking of scrubber sludge wastes. It consists of previously mined lands which were reclaimed and is now open grassland. Two small hollows were left in the area which contain small ponds. This area was discussed in a previous EA for development of coal-wash refuse and scrubber sludge disposal areas. The area is on a fairly flat elevation about 100 feet above the ash pond elevation and would therefore require much more diking than the other two areas considered in order to contain the ash volume to be dredged in this project.

Site 3—This ~~100~~ acre area is at the northern boundary of the current reservation adjacent to the Green River. It consists primarily of mined land which has been reclaimed. Strip mine pits in the area were left as part of the reclamation process. This area was considered in a previous EA for use as a permanent coal-wash fines refuse and dredge material disposal area. At that time the lake had already been partially filled with dredge materials from construction of a nearby coal barge docking facility. The area is currently used for disposal of miscellaneous dredged materials when required. Although development of this area would not require a great deal of diking to contain the desired volume of dredged ash, use of this area is complicated by other factors. Its remote distance from the active ash pond and its location on the other side of the plant would make it very difficult and costly to construct dredge lines to this site. It would also be difficult or impossible to reroute dredge pond return flow back to the existing ash pond. It is uncertain whether the water from this pond could meet NPDES permit limits enabling it to be discharged directly to the river without further treatment.

#### Preferred Alternative

Based on consideration of the engineering and economic factors discussed above, the preferred alternative is to construct the 50-acre dredge settling pond <sup>at</sup> site 1. This site will be purchased by TVA and developed for the disposal of  $1 \times 10^6$  cubic yards of dredged ash. Dikes

will be constructed from the best locally available material based on soil tests, probably obtained from a borrow area in the nearby scrubber stacking area. The top of the dikes will be at 460 feet of elevation (see figure 2). This area now drains toward upper Jacobs Creek. Return flow from dredging will be routed back to the ash pond and will flow by gravity through the existing natural drainage for the area adjacent to the preferred site. Diking will prevent flows into the upper Jacobs Creek area.

Upon completion of construction, piping will be <sup>laid</sup> ~~assembled~~ from the ash pond dredge to the dredge area. The estimated time to complete the dredging of  $1 \times 10^6$  cubic yards of ash from the active ash pond is approximately ten months. After completion of dredging the ash would be allowed to dewater and the area would be contoured to promote natural rainwater runoff. The ash will then be covered and seeded in accordance with State closure requirements. Appropriate erosion control features will be included in the design to allow for an environmentally acceptable final closure.

Completion of this project will restore approximately 10 years of storage volume to the active ash pond.

Consideration of the environmental factors associated with the use of the three areas considered is discussed in the following sections.

**Figure 2**

4

7

Reference No. 2

Draft Report  
Peabody Ash Pond  
Expansion 1998

## **I. INTRODUCTION**

The Paradise Fossil Plant is located on the west bank of the Green River at mile 100 in Muhlenberg County, Kentucky. The plant is located in western Kentucky, 5 miles east of Drakesboro. Paradise Fossil Plant has three units. Units 1 and 2 went into commercial operation in 1963. They had a rated capacity of 1300MW and were updated to 1408MW in 1965. Unit 3 became operational in 1970 with an added rated capacity of 1150MW to give an overall plant capacity of 2558MW. With cyclone firing of the boilers, the units produce approximately 80% bottom ash which is tapped from the bottom of the furnace and 20% fly ash. Electrostatic precipitators remove the fly ash from the flue gas. The fly ash is collected in hoppers under the precipitators and conveyed pneumatically by a dry vacuum system to an elevated separator tank. Water jet exhausters located at the tanks mix the fly ash with water. The ash and water slurry from all three units is then pumped to the ash disposal areas.

## **II. HISTORICAL DEVELOPMENT**

Four fly ash disposal areas were initially designated to receive fly ash from Units 1 and 2. By 1967, Area No.1 and Area No. 3 were filled and graded to proper elevations. Area No. 1 is currently part of the coal storage yard and Area No. 3 is the site of Coal Yard Drainage Basin No. 3 and plant parking. During this time, Area No. 2 was being sluiced into. The original dikes for this area were at EL 406 and designed with extra width at the top for future dike raisings. By late 1967, Area No. 2 was divided into two areas, Area 2A and Area 2B, by a 1200-ft dike to facilitate better settling time. At this time, several dikes were relocated outward and raised a few feet in several sections. In

1968, Area No. 4 was being sluiced into. Area 4 was filled in 1970 and is currently part of the coal storage yard.

In 1970, Area No. 2 dikes were raised to EL 416 to provide for additional ash storage. It was anticipated that after Unit 3 began operation in 1970, Area 2A and 2B would provide storage for only an additional 2 ½ months. Consequently, an ash reclaiming hopper for loading ash, located at the south end of ponds 2A and 2B, and an overland ash conveying system were constructed and used to transfer ash from Area 2 to nearby abandoned strip mine pits south of the plant for disposal.

During the design phase of the plant Units 1 and 2, preliminary studies had been made of the Jacobs Creek Area, located approximately ½ mile south of the plant, to utilize this area for future ash disposal. In 1970/71, the Jacobs Creek Fly Ash Disposal Area pond was constructed, with the original dikes, left from strip mining operation, raised to approximately EL 411. The Jacobs Creek Fly Ash Disposal Area received only sluiced fly ash.

After 1971, only bottom ash was received at Areas 2A and 2B and the overland conveyor system continued in use for bottom ash storage at the mine pits until the early 1980s. In the early 1980s, TVA marketed its bottom ash to Reed Minerals for use in shingles and as a sand blasting material. Since this time, Reed Minerals has reclaimed all the bottom ash from Area 2A and 2B for their use.

In 1981, the plant began raising Jacobs Creek Ash Disposal Area dikes to EL 420 to add more storage to the area. Then, in 1988, an internal dredge pond, Dredge Cell A, was constructed inside the pond to provide additional storage. Fly ash from the Jacobs Creek Fly Ash Disposal Area was dredged to this area and was discontinued by 1991.

300166

During this time, another internal dredge cell, Dredge Cell B, had been constructed and also dredged into. In 1993, the east dredge cell, located approximately ½ mile west of Jacobs Creek Fly Ash Disposal Area, was constructed to accept dredged fly ash from Jacobs Creek Fly Ash Disposal Area. The plant stopped dredging into this area by 1994.

### III. SITE DESCRIPTION

The area for the Jacobs Creek Fly Ash Pond Area Extension is adjacent to and south of the existing Jacobs Creek Ash Disposal Area. Changes to the existing conditions of this area were required to make the area adequate for use as a sluiced ash disposal area. The existing dikes left from previous strip mining operations along the southern and eastern portions of the area were too low to allow the pond to be operated above the year flood elevation. In order to meet environmental standards, it is necessary for the pond to be totally contained above the 100-year flood elevation and allow enough retention time for suspended solids to settle out before discharging to open waters. Therefore, dikes were raised from approximate elevation 400 to elevation 408 and tie into the existing Jacobs Creek Ash Disposal Area south dike. The breach through the existing dikes near the southeast corner (Peabody KPDES permitted discharge) was closed and the Paradise Fossil Plant KPDES discharge was relocated to near the existing Jacobs Creek Fly Ash Disposal Area in accordance with state and Corps of Engineer requests during the permitting process. Dike roads have a crushed stone surfacing and dike slopes have established vegetative cover. A channel was constructed at the west end of the existing south dike to allow inflow into the new pond from the existing Jacobs Creek Ash Disposal Area pond. A divider dike was constructed in the northeast portion of the area

300167



to form a stilling pool. A channel through the divider dike and floating boom were installed on the south end of the divider dike. This allows for proper settlement of suspended solids before discharging through three spillway and skimmer structures and through three 36" diameter concrete pipes to Jacobs Creek. Stairs were constructed from the top of dike to the outlets for ease in taking samples for environmental monitoring.

#### **IV. ASH DISPOSAL OPTIONS**

There were several options considered before the Fly Ash Pond Area Expansion was considered to be the least cost solution to the depleting ash storage problem.

##### Option A

Dredging 350,000 cubic yards of material to the existing east/west dredge cells was considered. This option extended the life of ash disposal only 3 ½ years to June 2002.

The cost of the project was estimated to be \$1,840,000.

##### Option B

The construction of a dry collection system and dry stacking operation was considered. The capital costs for this option were extremely high at an estimated cost of \$41,000,000. It was also determined that the cyclone furnace does not produce the quantity of fly ash necessary to support a dry collection system.

##### Option C

Raising the internal dredge cells in Jacobs Creek Fly Ash Disposal Area and dry stacking fly ash in this area was considered. This option would cost an estimated \$8,500,000. A solid waste permit would also be required in this case.

300168

#### Option D

The construction of a new ash pond south of the scrubber pond was considered. Fly ash material would be dredged here, then reclaimed and dry stacked. This option was considered not to be feasible due to the location of environmental wetlands on the site.

#### Option E

Constructing the Jacobs Creek Fly Ash Pond Expansion Area was chosen as the least cost option at an estimated \$1,100,000.

### **V. COSTS OF PROJECT**


### **VI. PROJECTED USE OF SITE**

Based on current generation projection for the next 15 years average high load coal burn forecast, it has been determined that the projected amount of fly ash produced which is sluiced into the active ash disposal area is 108,173 cubic yards per year. Based on this projection, the Fly Ash Pond Area Expansion will have a storage capacity of approximately 18 years, with the existing dikes at elevation 408. A second lift to raise the dikes to elevation 420 can provide additional ash storage capacity of approximately 21 years. At this time, the north dike of the Fly Ash Pond Area Expansion will be breached and a floating boom installed so that the Jacobs Creek Ash Disposal Area stilling pool and discharge structures will be utilized.

Reference No. 3

Peabody Ash Pond  
And Stilling Pond  
Drawings



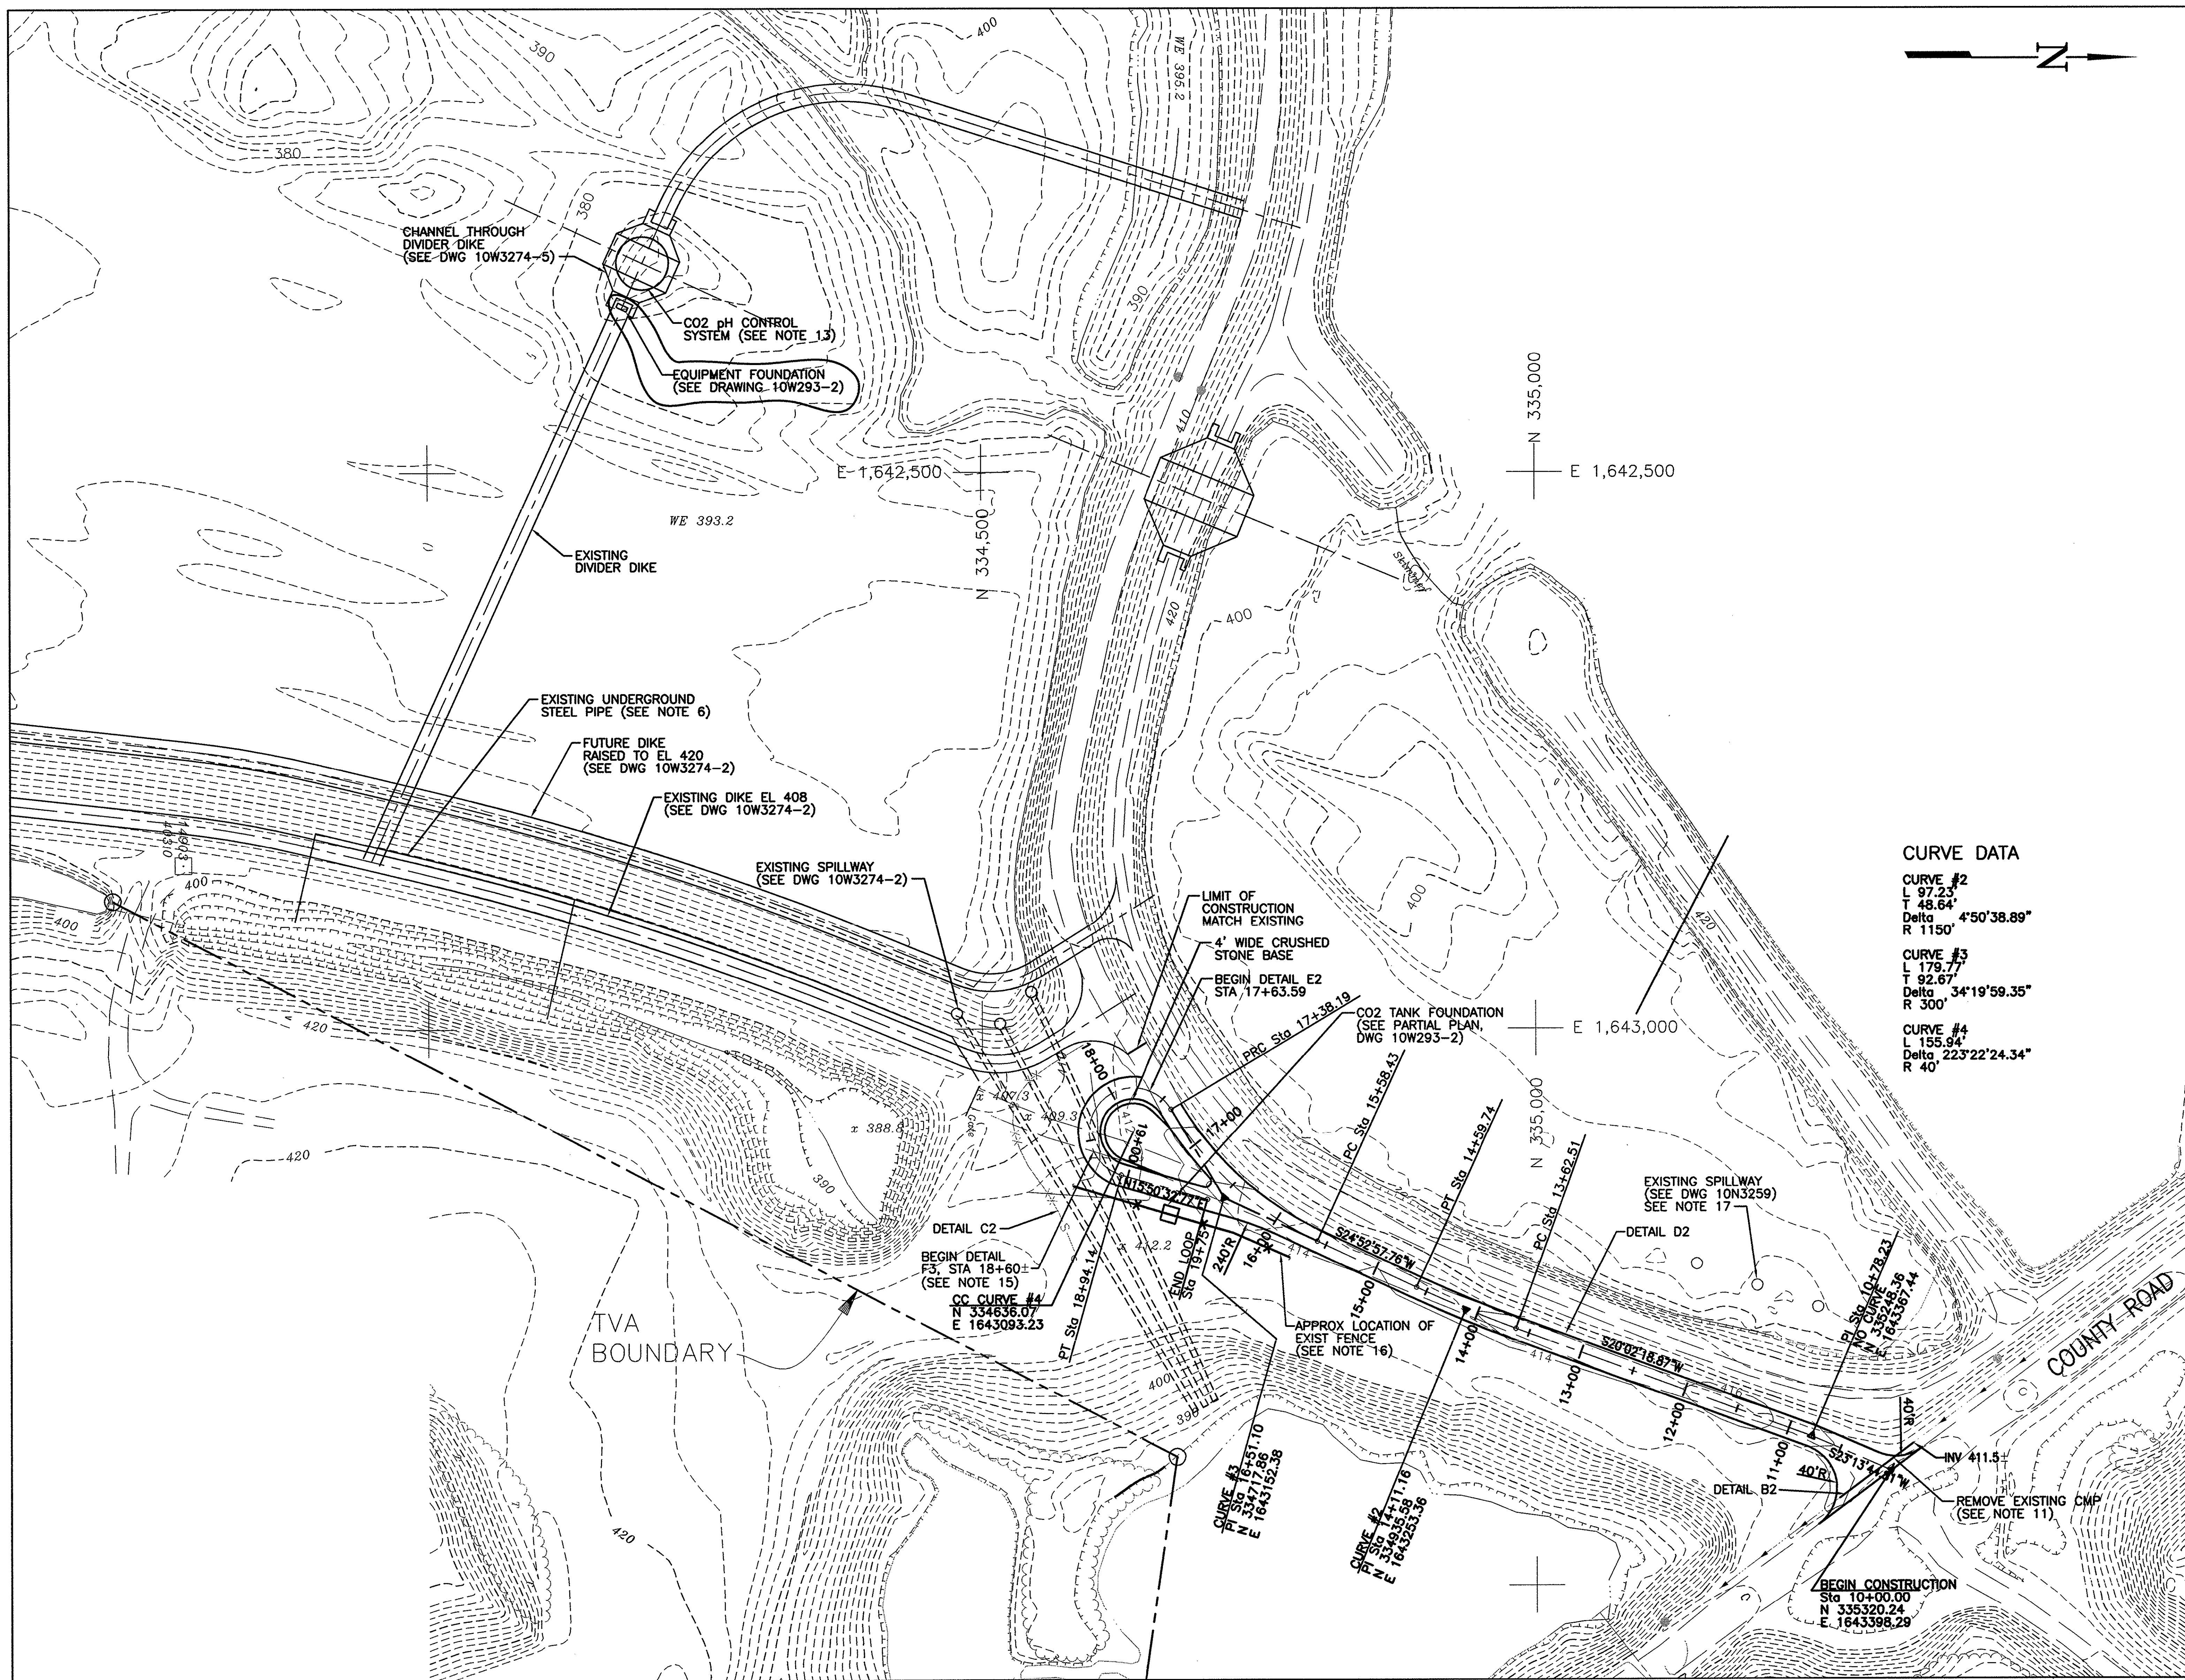


CURVE DATA

**CURVE #2**  
 L 97.23  
 T 48.64  
 Delta 4°50'38.89"  
 R 1150'

**CURVE #3**  
 L 179.77  
 T 92.67  
 Delta 34°19'59.35"  
 R 300'

**CURVE #4**  
 Delta 22°22'24.34"  
 R 40'

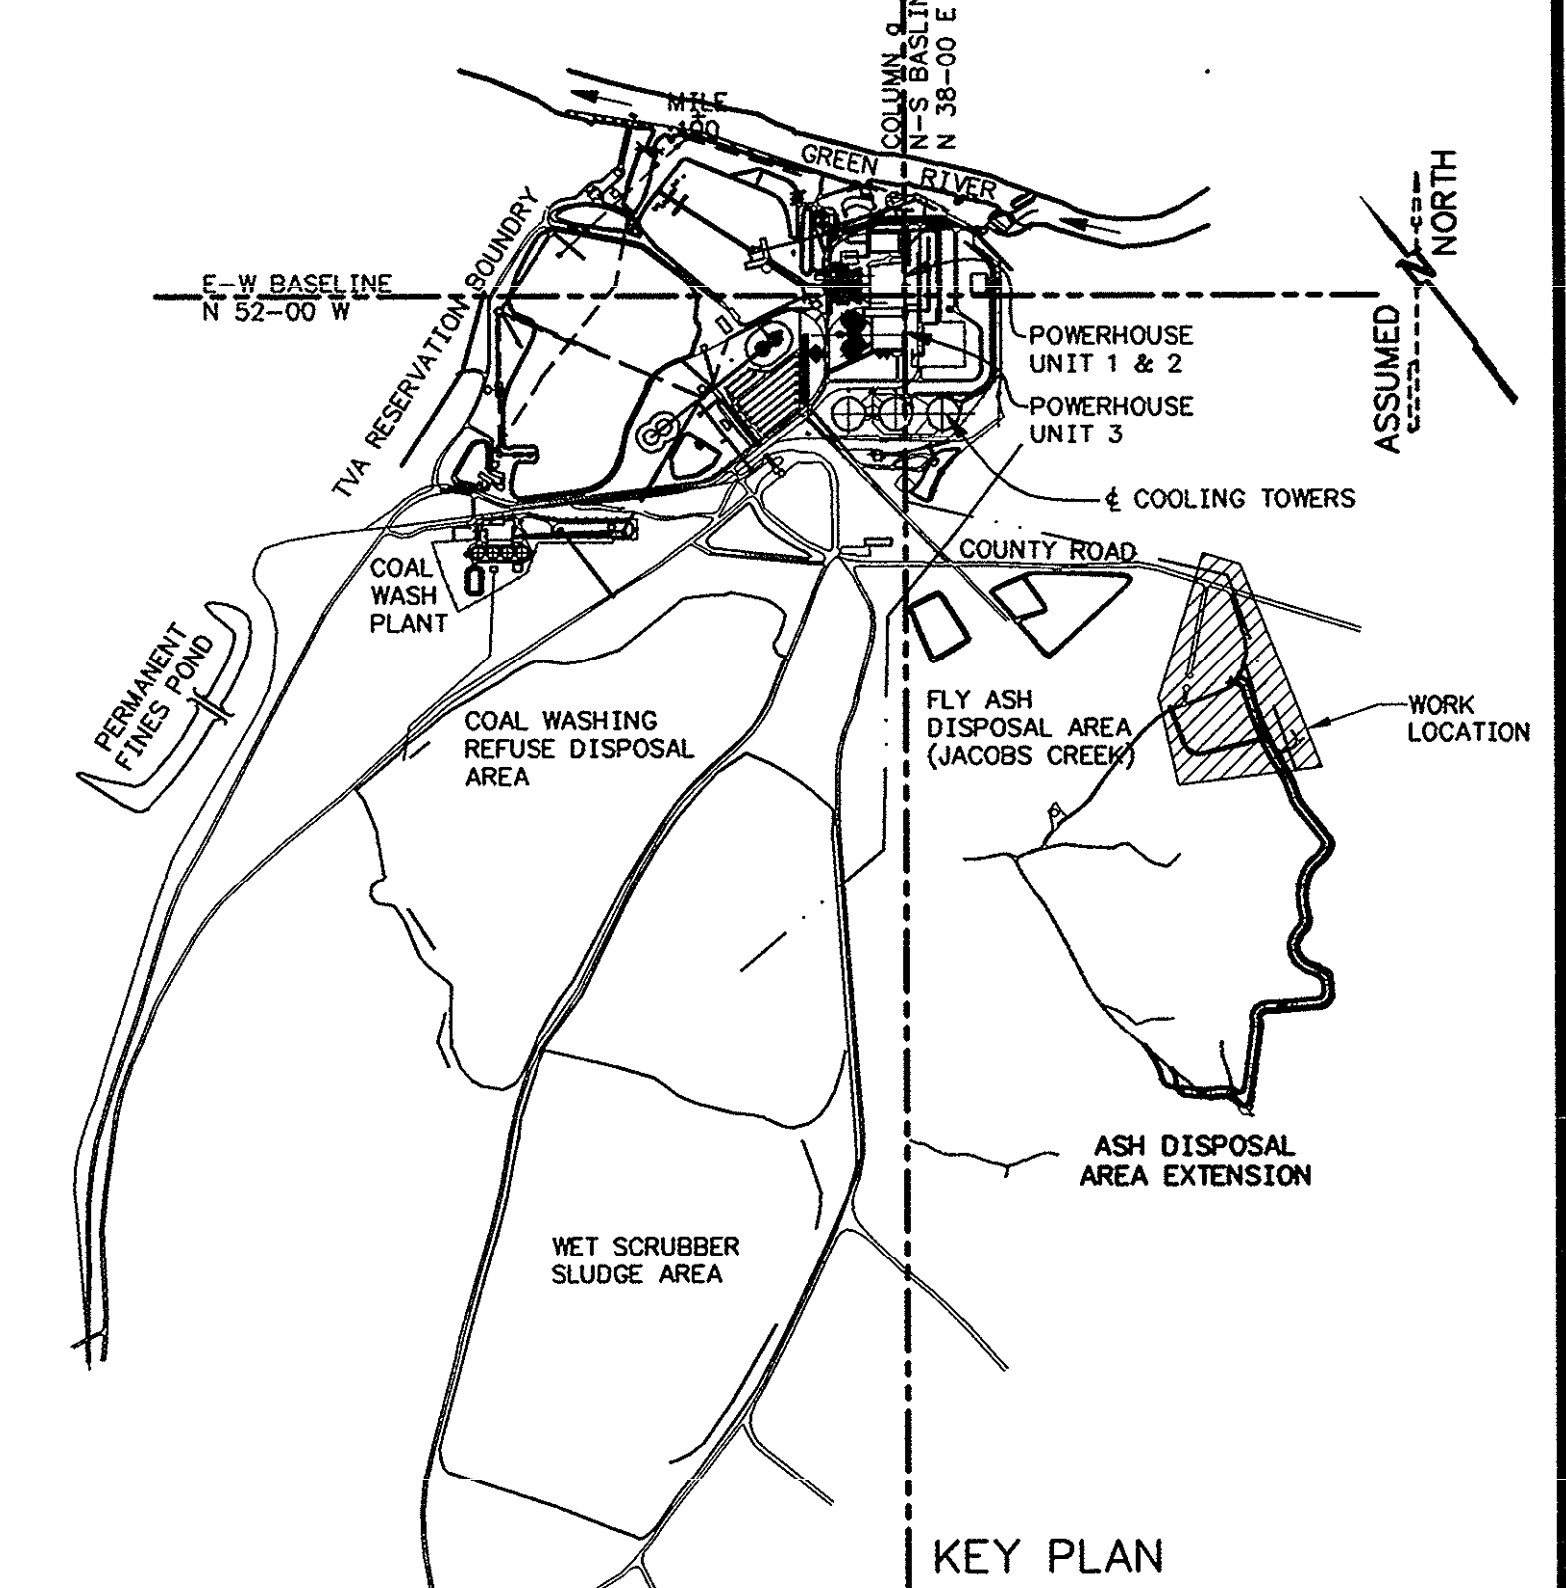

NOTES:

- ALL WORK SHALL BE PERFORMED IN ACCORDANCE WITH TVA SPECIFICATION T-1, UNLESS NOTED OTHERWISE.
- SECTION NUMBERS REFER DIRECTLY TO TVA SPECIFICATION T-1, UNLESS NOTED OTHERWISE.
- VERIFY AMPLE CLEARANCE UNDER OVERHEAD ELECTRICAL LINES FOR CONSTRUCTION EQUIPMENT. NOTIFY CONSTRUCTION MANAGER BEFORE ANY WORK STARTS BENEATH OVERHEAD ELECTRICAL LINES.
- EXISTING TOPOGRAPHY AND FUTURE DEVELOPMENT WERE TAKEN FROM TVA DRAWINGS 64MS461K512(D) F3 RD AND 10W3274-2. COORDINATES ARE BASED ON KENTUCKY RECTANGULAR COORDINATE SYSTEM, SOUTH ZONE, 1927 NORTH AMERICAN DATUM (NAD).
- INSTALL ALL SILT FENCES SHOWN ON THE DRAWINGS PRIOR TO EXCAVATION AND GRADING ACTIVITIES. SILT FENCE SHALL CONFORM TO KENTUCKY DOT STANDARD SPECIFICATION FOR ROAD AND BRIDGE CONSTRUCTION SECTION 213.04.02.
- THE LOCATION OF EXISTING UNDERGROUND UTILITIES IS APPROXIMATE, AND BASED ON A SURVEY PERFORMED BY UNDERGROUND LOCATORS OF NASHVILLE, INC., MARCH 2000. THE CONTRACTOR SHALL EXERCISE CAUTION WHEN PERFORMING EXCAVATIONS FOR THIS PROJECT, AND STOP WORK IN THE EVENT ANY BURIED OBJECTS ARE ENCOUNTERED. FOR ANY WORK IN A PUBLIC ROAD RIGHT OF WAY, CALL 1-800-752-6007 (CONFIRMATION NUMBER 20001301322) TO LOCATE ANY UNDERGROUND UTILITIES.
- MATERIAL FOR CRUSHED STONE BASE SHALL BE AS SPECIFIED IN SECTION 1032.
- SCARIFY EXISTING ROADWAY TO A DEPTH OF 3 INCHES PRIOR TO PLACING NEW CRUSHED STONE BASE. PREPARE EXISTING ROADBED IN ACCORDANCE WITH SECTION 220.
- PLACE CRUSHED STONE BASE (6 IN MINIMUM THICKNESS) IN ACCORDANCE WITH SECTION 305.
- GEOTEXTILE PLACED BENEATH ROADWAY SHALL BE WOVEN FABRIC, CLASS C, IN ACCORDANCE WITH SECTION 571.
- REMOVE EXISTING 18 IN. DIA. CMP AND REPLACE WITH NEW CONCRETE PIPE IN ACCORDANCE WITH SECTION 1250, CLASS III PIPE. PLACE PIPE ON EXISTING SLOPE AND LENGTH TO BE DETERMINED BY FIELD.
- NEW FENCE SHALL BE GALVANIZED CHAIN LINK IN ACCORDANCE WITH KENTUCKY DOT STANDARD SPECIFICATION FOR ROADS AND BRIDGES SECTION 722. FENCE SHALL BE 6 FT HIGH, WITH A 4 FT WIDE SLIDING GATE CENTERED ON THE CONCRETE TANK FOUNDATION. GATE SHALL BE FURNISHED WITH A LATCH AND KEY PADLOCK. CONCRETE FOR FENCE POSTS AND GUARD POSTS TO BE THE SAME AS THE CONCRETE TANK FOUNDATION.
- CO2 TANK AND DELIVERY APPURTENANCES SHALL BE SUPPLIED AND INSTALLED BY BOC GASES, MURRAY HILL, NJ. CO2 DELIVERY PIPE SHALL BE FIELD ROUTED.
- ALL NON-FERROUS UNDERGROUND UTILITIES INSTALLED FOR THIS PROJECT SHALL HAVE UNDERGROUND WARNING TAPE CONSISTING OF A SOLID ALUMINUM CORE, A COATED IMPRINT, AND A REINFORCED PROTECTIVE PLASTIC JACKET BONDED TO THE FOIL CORE. THE TAPE SHALL STATE THE FOLLOWING: CAUTION - UNDERGROUND CARBON DIOXIDE GAS LINE.
- PLACE EXCESS SPOIL MATERIAL, IF NEEDED, INSIDE THE UNPAVED AREA BOUNDED BY THE ROAD TO PROVIDE POSITIVE DRAINAGE. SEED ALL DISTURBED AREAS (INCLUDING THE AREA INSIDE THE NEWLY CONSTRUCTED ROAD) IN ACCORDANCE WITH SECTION 580.
- REMOVE EXISTING FENCE AS NECESSARY TO FACILITATE CONSTRUCTION OF CO2 TANK FOUNDATION.
- FIELD TO VERIFY LOCATION OF EXISTING SPILLWAYS AND UNDERGROUND CONCRETE PIPES. DO NOT INSTALL UTILITY POLES WHERE UNDERGROUND CONCRETE PIPES ARE LOCATED BENEATH THE ROAD (APPROXIMATELY BETWEEN STATIONS 11+00 AND 13+00).

REV	DATE	ISSN	CHG	SUPV	INVD	APPR	ISSD	PROJECT	AS CORRECTED	REV
1	4-18-00	GB	JGA	DRS	DRS			PARF074, INITIAL ISSUE FOR U3 FUEL SWITCH PROJECT.		1
SCALE: 1" = 60'										

YARD

**UNIT 3 FUEL SWITCH PROJECT**

**DISCHARGE POND CONDITIONING**

**ACCESS ROAD AND PLAN**

DESIGNED BY:	DRAWN BY:	CHECKED BY:	APPROVED BY:	ISSUED BY:
G. BHATT	J.G. ASHWORTH	D.R. SMITH	D.R. SMITH	R.E. PURKEY


PARADISE FOSSIL PLANT  
 TENNESSEE VALLEY AUTHORITY  
 FOSSIL AND HYDRO ENGINEERING

PARSONS	1	PLOT FACTOR: 1:60	C.A.D. DRAWING
TASK COMPLETED BY:	REV NO.	FILENAME: 10W293-1.DWG	DO NOT ALTER MANUALLY



7. EARTH BORROW MATERIAL FOR THE DIKES SHALL BE OBTAINED FROM THE NORTHWEST CORNER OF THE FLY ASH POND EXTENSION AREA. FOR THE INITIAL DIKE TO EL 408, THE BORROW MATERIAL SHALL BE TAKEN BELOW EL 410, AS MUCH AS POSSIBLE, TO ALLOW THE REMAINING BORROW MATERIAL TO BE UTILIZED FOR THE FUTURE DIKE RAISING TO EL 420. CUT SLOPES ADJACENT TO EMBANKMENTS (EXISTING OR NEW DIKE) SHALL NOT BE EXCAVATED STEEPER THAN 3:1 AND TOP OF CUT SHALL BE A MINIMUM OF 25 FEET FROM TOE OF EMBANKMENT.
8. CRUSHED STONE SURFACING FOR THE TOP OF DIKE, SHALL BE IN ACCORDANCE WITH SECTION 305.
9. WHEN CONNECTING THE END OF THE NEW DIKE TO THE OLD DIKE, EXTREME CARE SHALL BE USED TO ENSURE AN IMPERVIOUS AND STABLE CONNECTION. THE EXISTING SURFACE SHALL BE STRIPPED OF ALL VEGETATION AND SCARIFIED TO A MINIMUM DEPTH OF 6 INCHES AND COMPACTED SO AS TO FORM A BOND WITH THE NEW FILL.
10. PLACEMENT OF THE UNDERWATER ASH FILL SHALL BE BY END DUMPING ALONG THE LENGTH OF THE DIKE. THE TOP SURFACE OF THE UNDERWATER DIKE JUST ABOVE THE WATER SHALL BE THOROUGHLY COMPACTED AND SCARIFIED BEFORE PLACING THE OVERLYING EARTHFILL. BOTTOM ASH FOR THAT PORTION OF THE DIKE ABOVE WATER SHALL BE PLACED IN NOT MORE THAN 9-INCH LAYERS, AND WELL COMPACTED WITH RUBBER TIERED HAULING EQUIPMENT.
11. INITIAL ROCKFILL FOR RELATED SPILLWAY FOUNDATION IS TO WEIGH FROM 200 TO 400 POUNDS EACH WITH NO SMALLER STONES PERMITTED. THESE ROCKS ARE TO BE FORCED THROUGH THE SOFT MATERIAL TO A FIRM FOUNDATION WITH HEAVY EQUIPMENT AS SHOWN ON 10W3274-4. THE PLACING OF THE 200 TO 400 POUND STONES IS TO CONTINUE TO EL 395. THE TOP OF THE LARGE STONES ARE TO BE CHOKED WITH SMALLER STONES AND INSTRUMENT OBSERVATIONS MADE TO ENSURE FOUNDATION HAS BEEN COMPACTED TO PROVIDE A NON-SETTLING FOUNDATION. TWO ADDITIONAL PASSES OF HEAVY EQUIPMENT ARE TO BE MADE AFTER CURVES INDICATE NO FURTHER SETTLEMENT. THE LARGE STONES SHALL BE SURFACED WITH A MINIMUM OF 6 INCHES OF COMPACTED CRUSHED STONE PER SECTION 1032 TO MAXIMUM EL 395.5.

18. WATER LEVEL MONITOR SHALL BE "POLECAT" RADAR BASED NONCONTACT LEVEL MONITORING DEVICE AS MANUFACTURED BY REMOTE DATA SYSTEMS, INC., P.O. BOX 2522, WILMINGTON, N.C. 28402 (910-313-0105). CALCULATOR AND SOFTWARE ARE NOT REQUIRED (PAF ALREADY HAS THESE). MONITOR TO BE INSTALLED IN ACCORDANCE WITH MANUFACTURER'S INSTRUCTIONS.

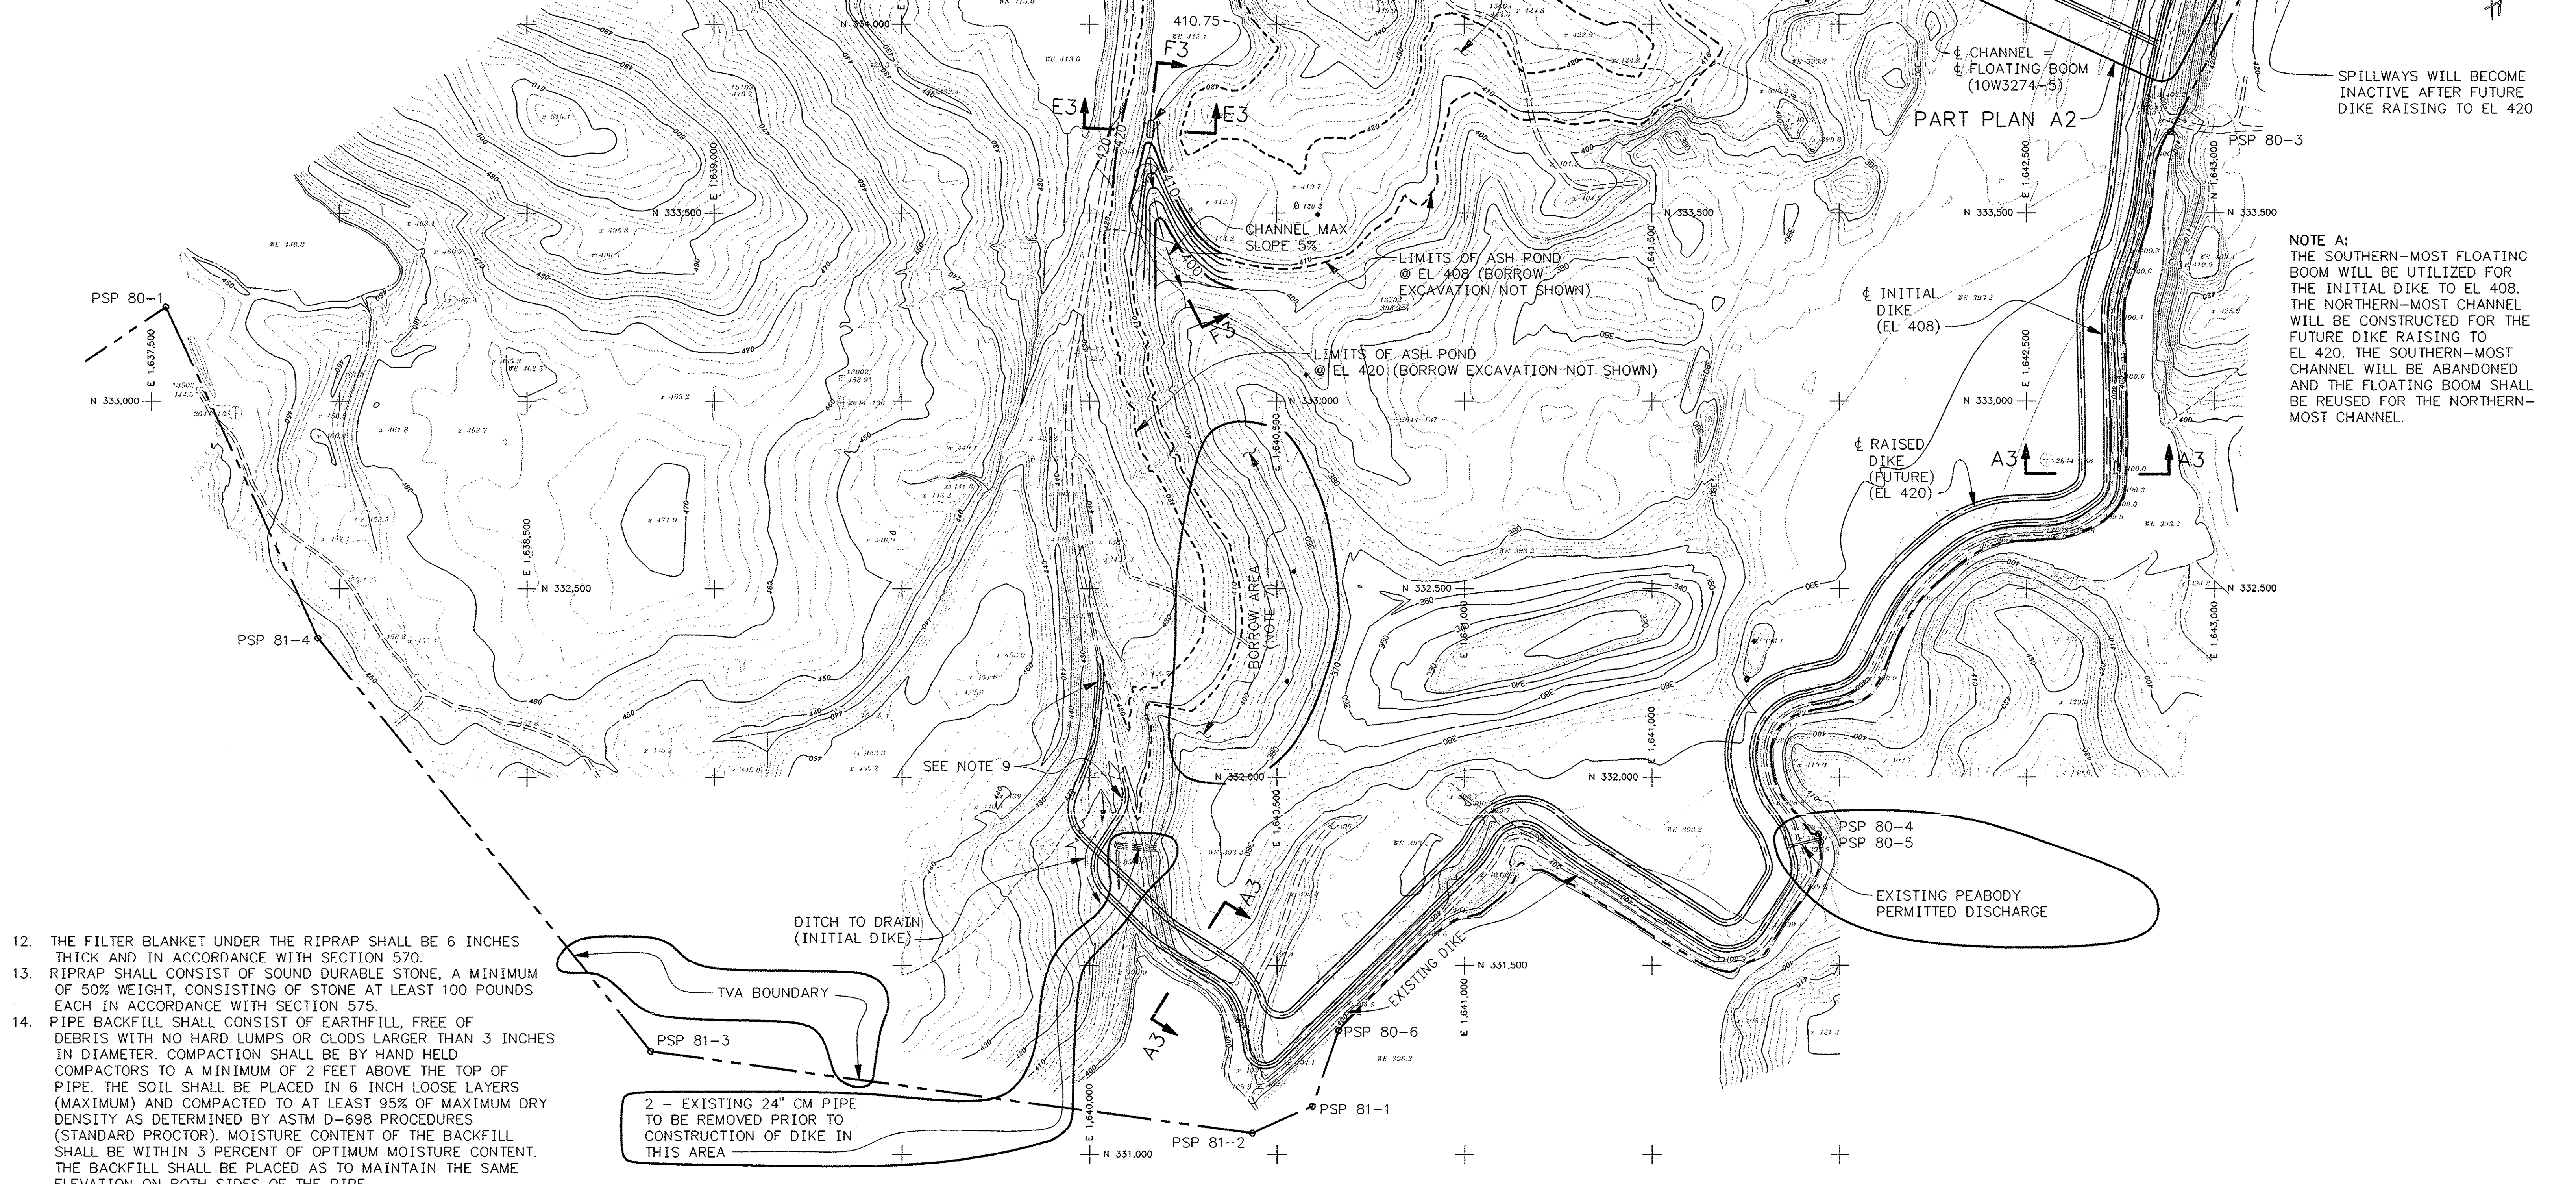

12. THE FILTER BLANKET UNDER THE RIPRAP SHALL BE 6 INCHES THICK AND IN ACCORDANCE WITH SECTION 570.
13. RIPRAP SHALL CONSIST OF SOUND DURABLE STONE, A MINIMUM OF 50% WEIGHT, CONSISTING OF STONE AT LEAST 100 POUNDS EACH IN ACCORDANCE WITH SECTION 575.
14. PIPE BACKFILL SHALL CONSIST OF EARTH FILL, FREE OF DEBRIS WITH NO HARD LUMPS OR CLODS LARGER THAN 3 INCHES IN DIAMETER. COMPACTION SHALL BE BY HAND HELD COMPACTORS TO A MINIMUM OF 2 FEET ABOVE THE TOP OF PIPE. THE SOIL SHALL BE PLACED IN 6 INCH LOOSE LAYERS (MAXIMUM) AND COMPACTED TO AT LEAST 95% OF MAXIMUM DRY DENSITY AS DETERMINED BY ASTM D-698 PROCEDURES (STANDARD PROCTOR). MOISTURE CONTENT OF THE BACKFILL SHALL BE WITHIN 3 PERCENT OF OPTIMUM MOISTURE CONTENT. THE BACKFILL SHALL BE PLACED AS TO MAINTAIN THE SAME ELEVATION ON BOTH SIDES OF THE PIPE.
15. CRUSHED STONE SHALL BE IN ACCORDANCE WITH SECTION 1032.
16. CONCRETE PIPE SHALL BE IN ACCORDANCE WITH SECTION 460.
17. HEAVY CONTOUR LINES REPRESENT FINISHED GRADE. LIGHTER CONTOUR LINES REPRESENT EXISTING GRADE (TOPOGRAPHIC DATA FROM PHOTOGRAPHY DATED FEBRUARY 22, 1995).

- NOTES:
1. ALL WORK SHALL BE IN ACCORDANCE WITH THE T-1 SPECIFICATIONS UNLESS OTHERWISE NOTED.
  2. DIKE SLOPES SHALL BE SEEDED WITH TYPE 8 MIXTURE 1 FOR FALL PLANTING OR TYPE 9 MIXTURE 1 FOR SPRING PLANTING. GRASSED AREAS ARE TO BE FERTILIZED AND MULCHED IN ACCORDANCE WITH SECTIONS 580 AND 582.
  3. EARTH FILL SHALL CONSIST OF SOIL PLACED IN LAYERS WHOSE COMPACTED THICKNESS DOES NOT EXCEED 18 INCHES. EARTH FILL SHALL BE UNIFORMLY COMPACTED WITH A SMOOTH WHEEL (VIBRATORY) ROLLER TO AT LEAST 95% OF MAXIMUM DRY DENSITY AS DETERMINED BY ASTM D-698 PROCEDURES (STANDARD PROCTOR). MOISTURE CONTENT OF THE EARTH FILL SHALL BE WITHIN ±3% OF OPTIMUM MOISTURE CONTENT. NO ROCKS LARGER THAN 10 INCHES IN DIAMETER SHALL BE PLACED WITHIN THE DIKE FILL. IN-PLACE DENSITY TESTS USING THE SAND CONE (ASTM D1556) RUBBER BALLOON (ASTM D2167) OR NUCLEAR (ASTM D2922) TEST METHODS SHALL BE MADE AT A RATE OF AT LEAST ONE TEST PER 5,000 CUBIC YARDS OF EARTH FILL PLACED OR A MINIMUM OF ONE TEST PER DAY THAT EARTH FILL IS PLACED. IF NUCLEAR METHODS ARE USED, SUFFICIENT NUMBERS OF SAND CONE OR RUBBER BALLOON TESTS SHALL BE PERFORMED TO CORRELATE AND VERIFY THE NUCLEAR GAUGE RESULTS.
  4. BOTTOM ASH FILL SHALL BE TAKEN FROM THE WASTE STOCKPILE PRODUCED BY REED MINERALS DIVISION OF HARSCO CORPORATION. THE COARSER OF THE TWO GRADES OF WASTE MATERIAL SHALL BE USED FOR FILL.
  5. BEFORE PLACING NEW FILL ON EXISTING DIKE, SURFACES SHALL BE STRIPPED OF ALL VEGETATION, CRUSHED STONE, AND LOOSE MATERIAL, SCARIFIED, AND NEW FILL ROLLED TO BOND WITH EXISTING FILL.
  6. TOP OF DIKE MUST BE MAINTAINED A MINIMUM OF 4-FOOT ABOVE THE ELEVATION OF THE WATER IN THE ASH DISPOSAL AREA.

REV	DATE	ISSN	ISSN	CHG	SUPV	APPD	ISSN	PROJECT	AS CONST	ISSN

SCALE: 1" = 200' EXCEPT AS NOTED


**YARD**  
**JACOBS CREEK**  
**ASH DISPOSAL AREA EXTENSION**  
**GENERAL PLAN**

DESIGNED BY	DRAWN BY	CHECKED BY	SUPERVISED BY	REVIEWED BY	APPROVED BY	ISSUED BY
C.L.MOUNT	M.C.HRANEK	J.D.PARIS	J.L.GLOVER	R.W.BURNETT	R.G.JOHNSON	W.D.HALL

PARADISE FOSSIL PLANT  
 TENNESSEE VALLEY AUTHORITY  
 FOSSIL AND HYDRO ENGINEERING

AUTOCAD R12 DATE 1-4-96 64 C 10W3274-1 R 1

PLOT FACTOR: 1:200  
 W\_TVA  
 C.A.D. DRAWING DO NOT ALTER MANUALLY  
 FILENAME: PF32741.DWG






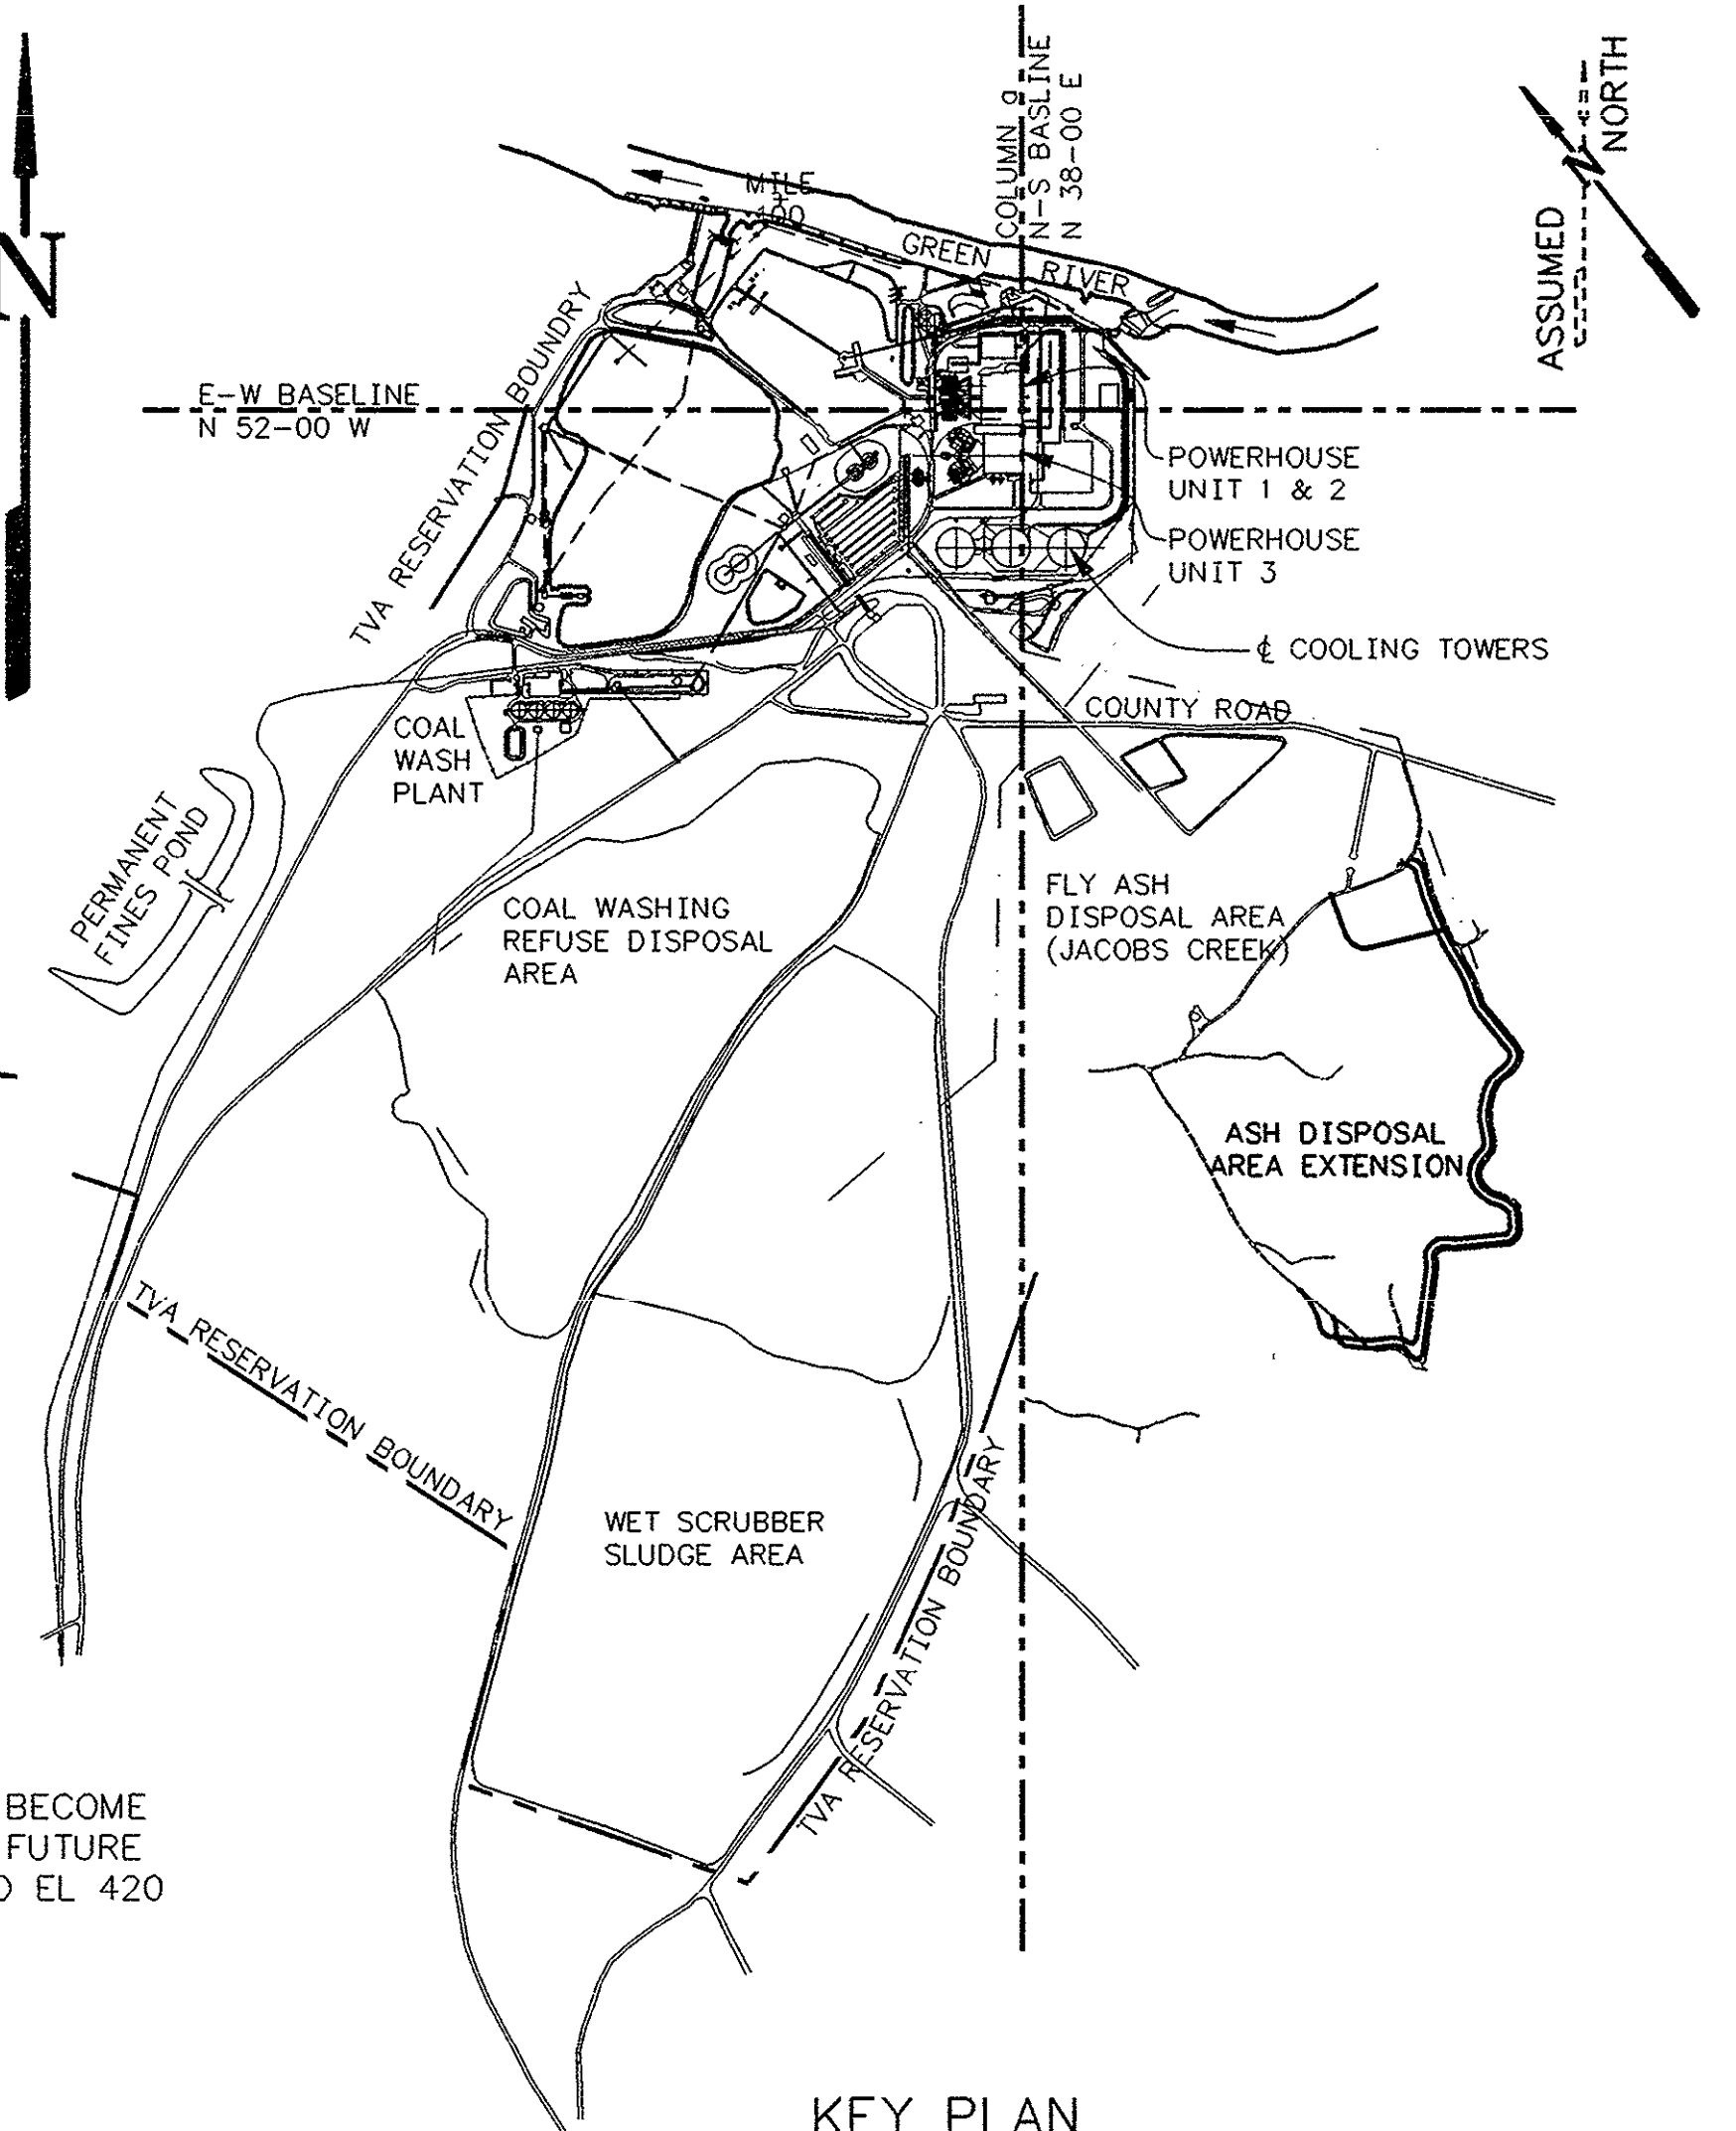


GENERAL PLAN








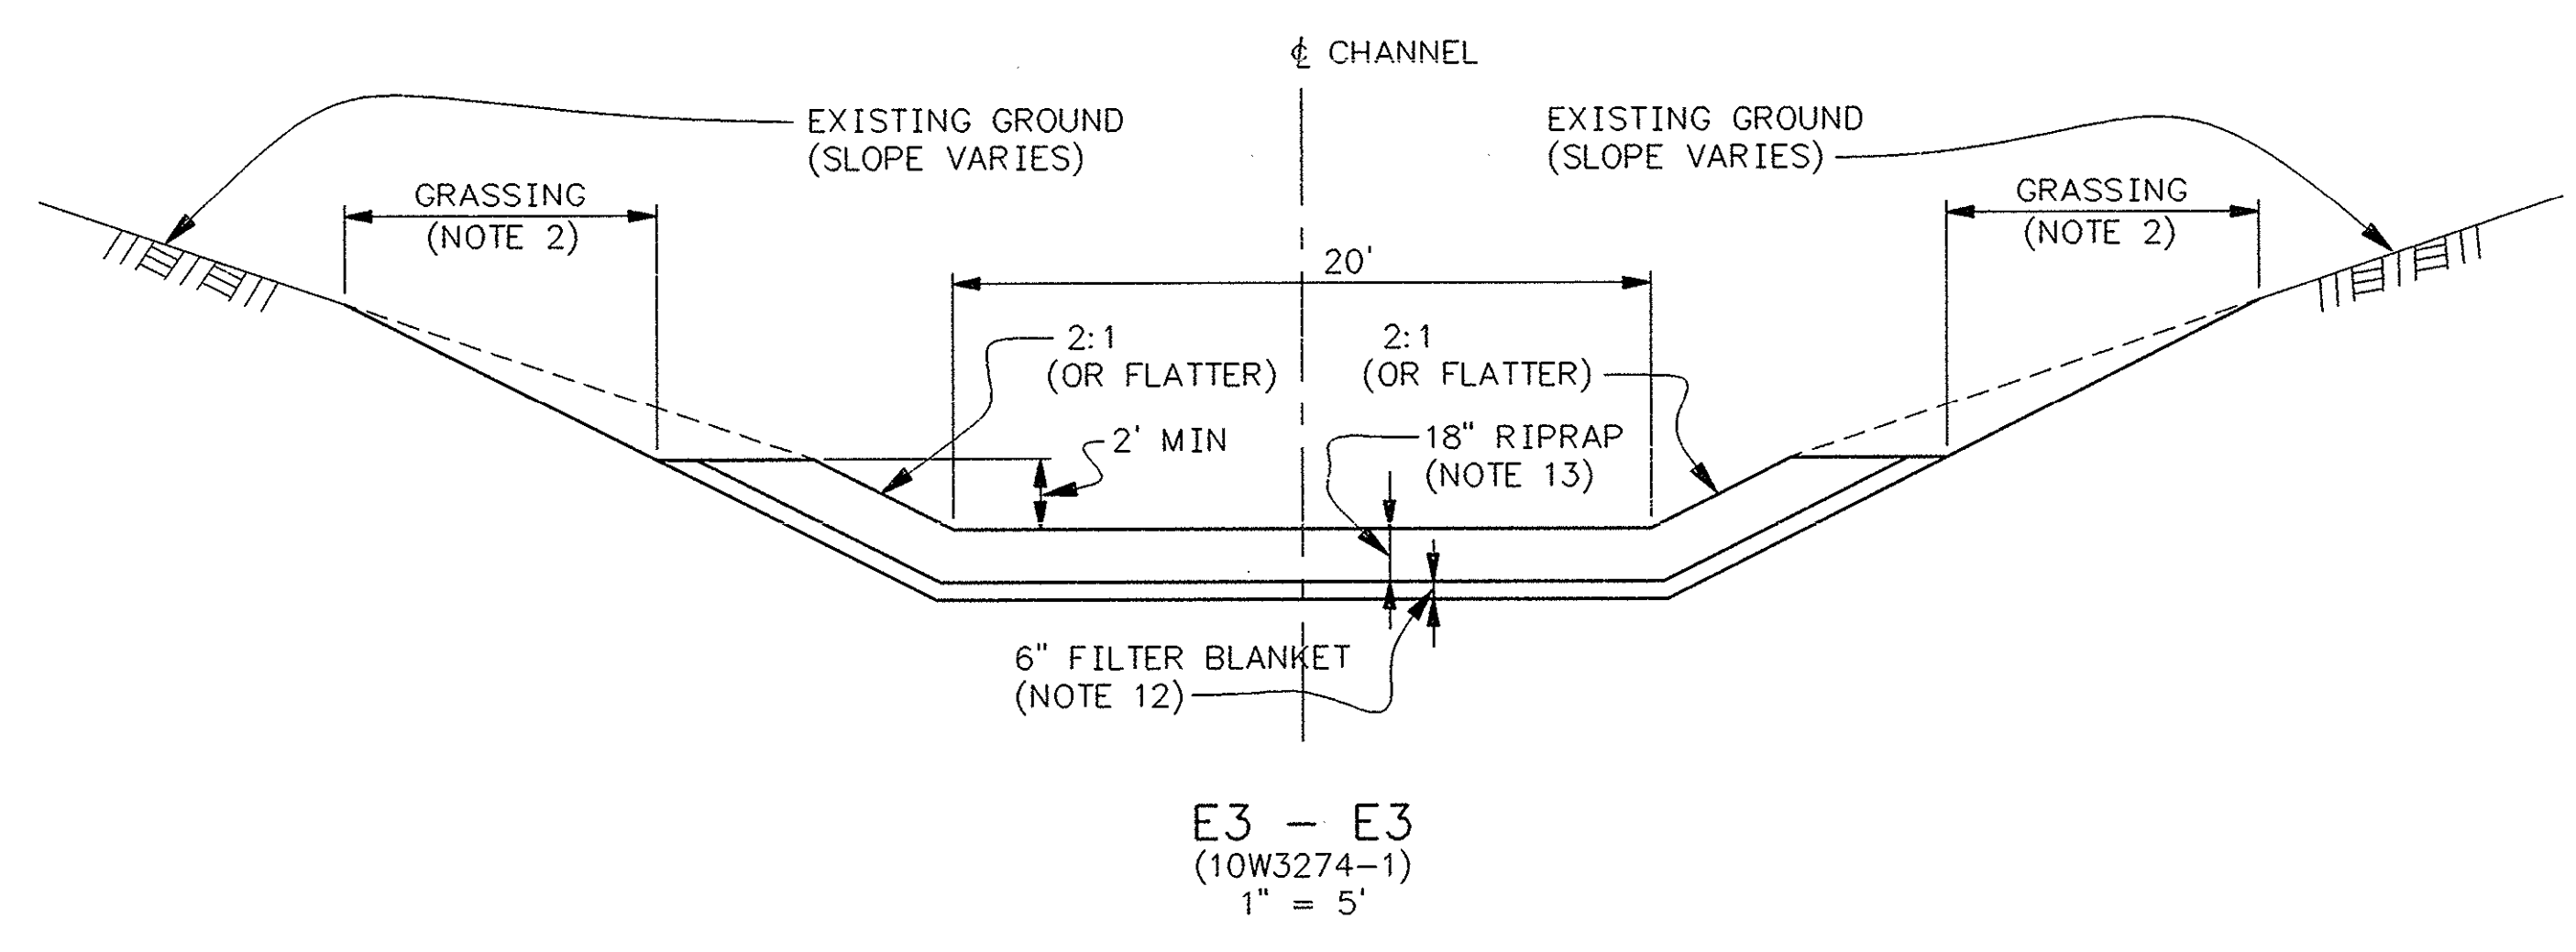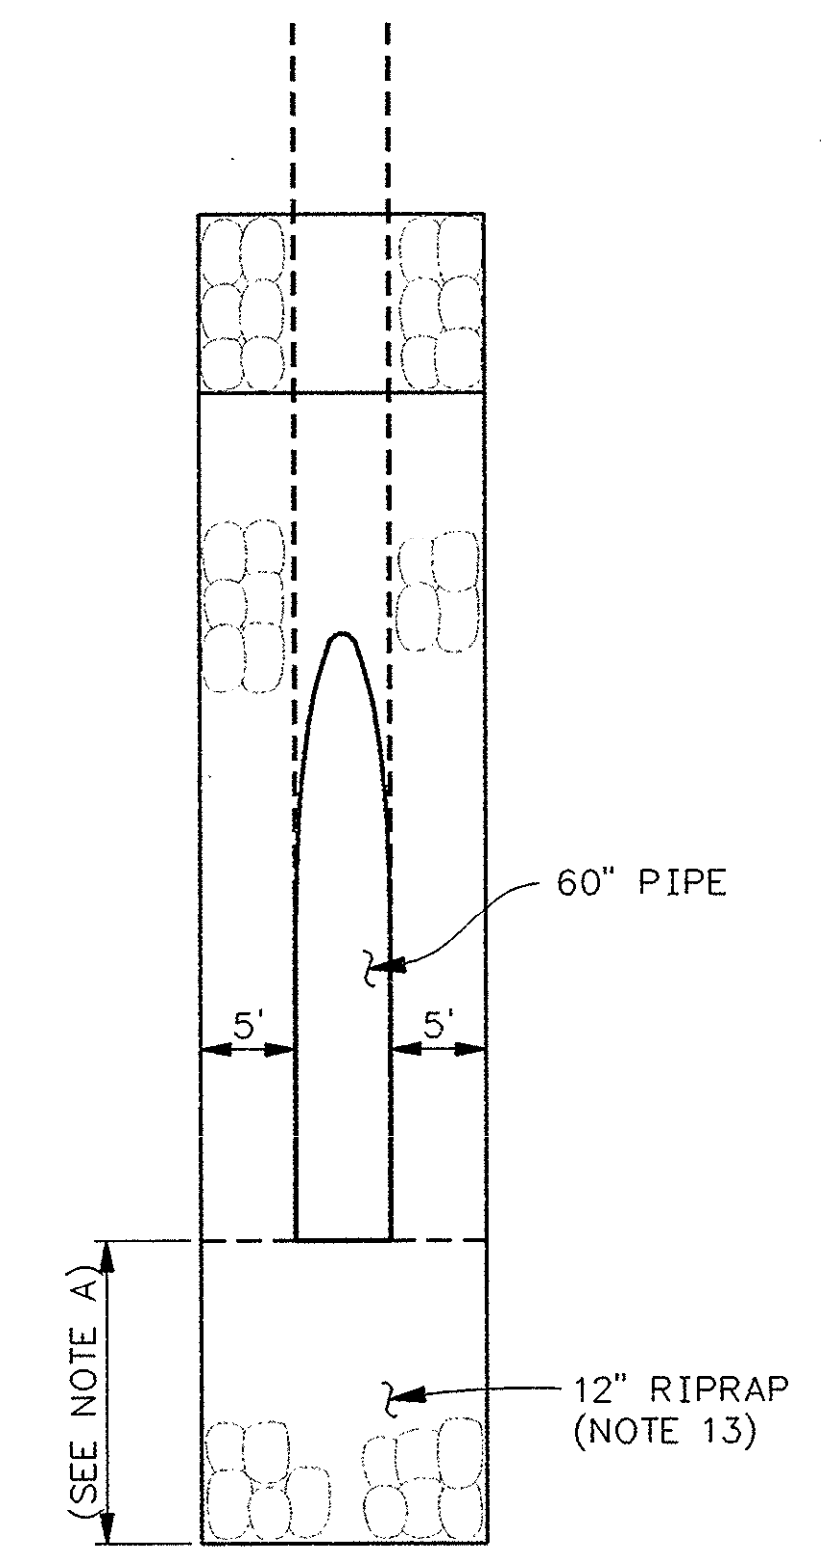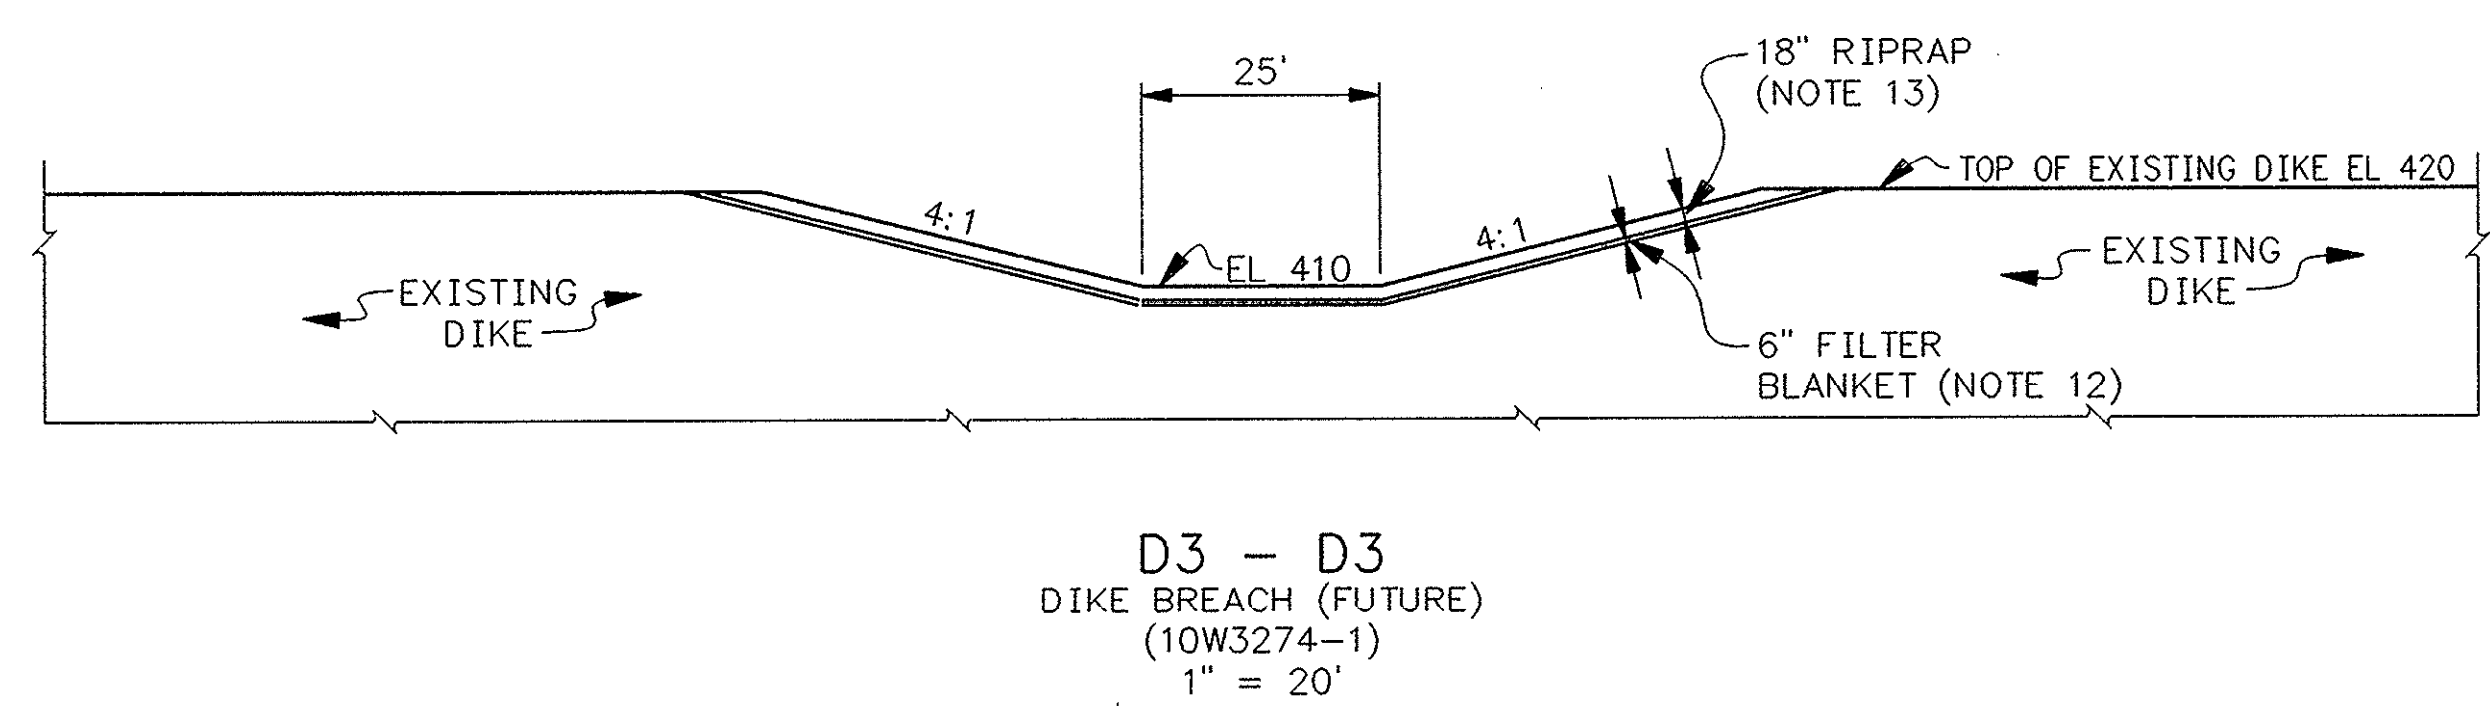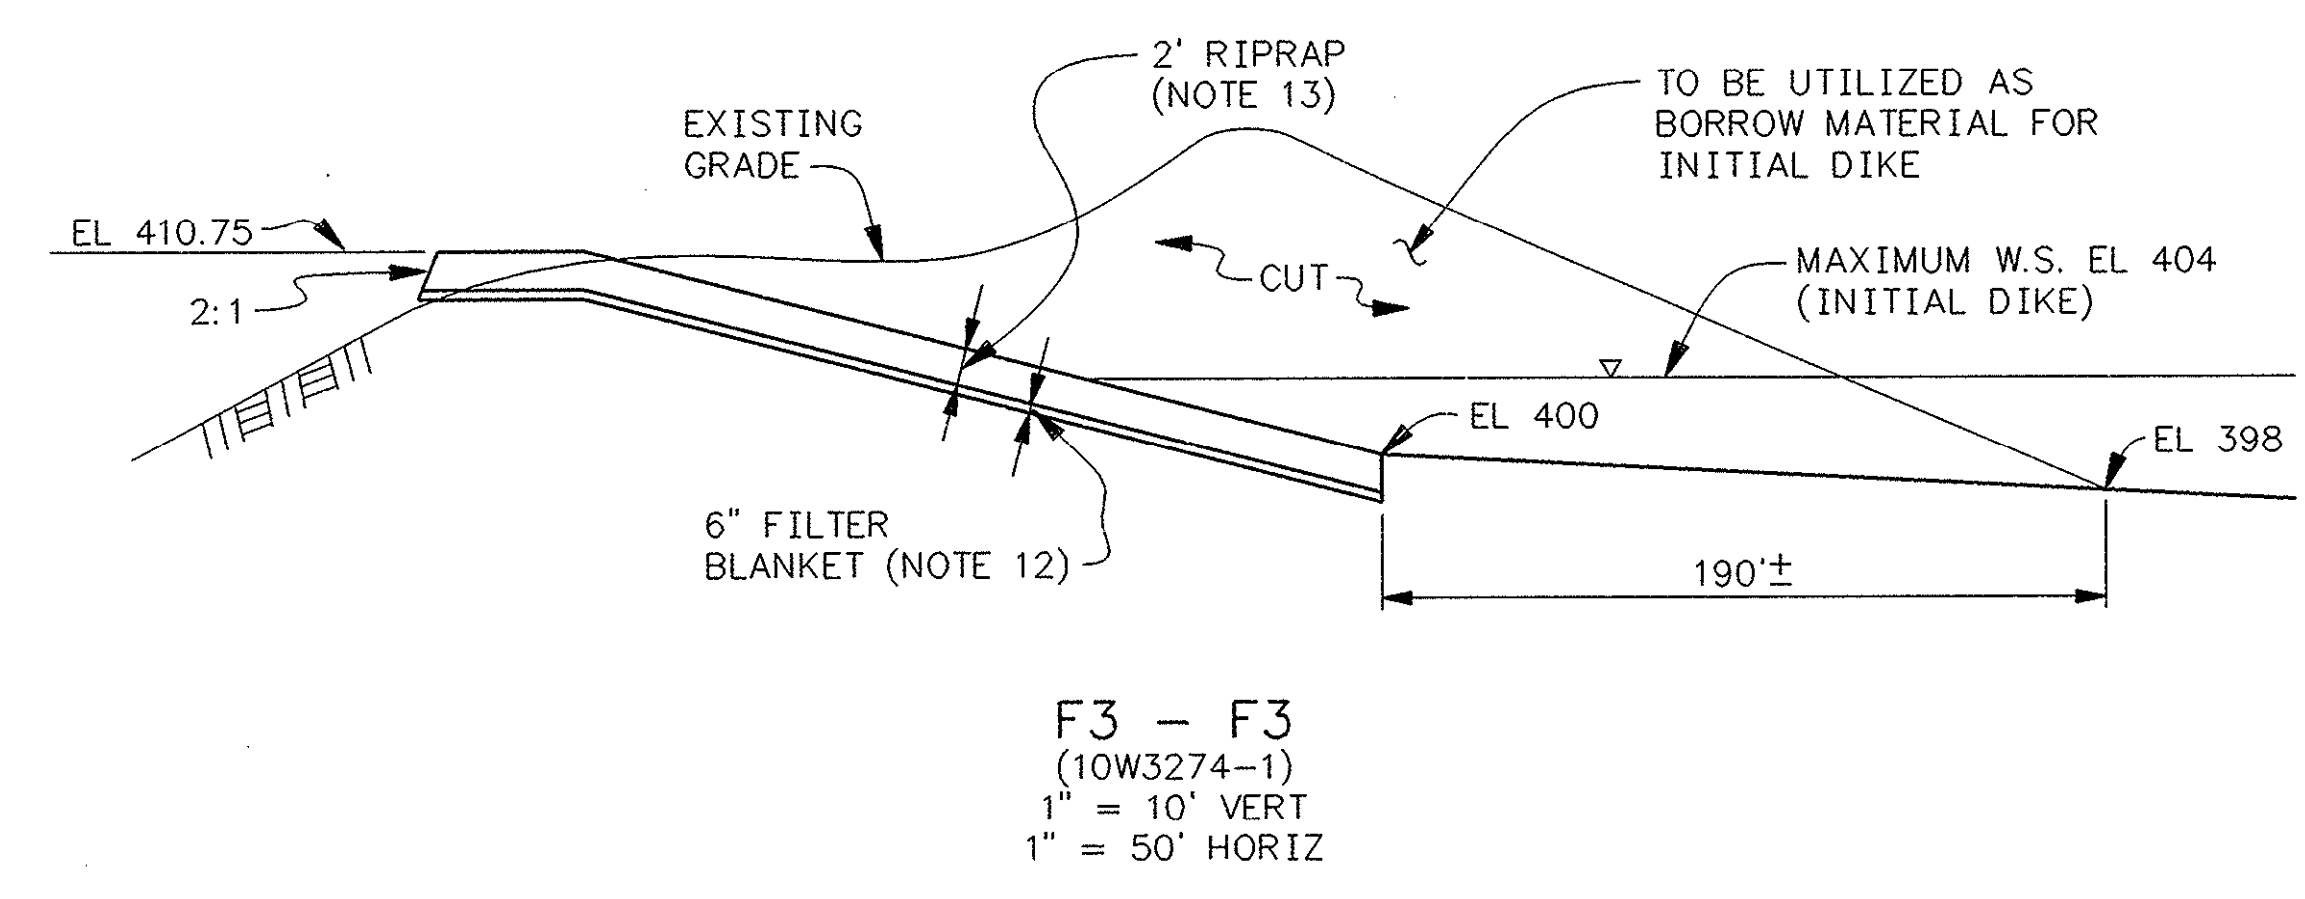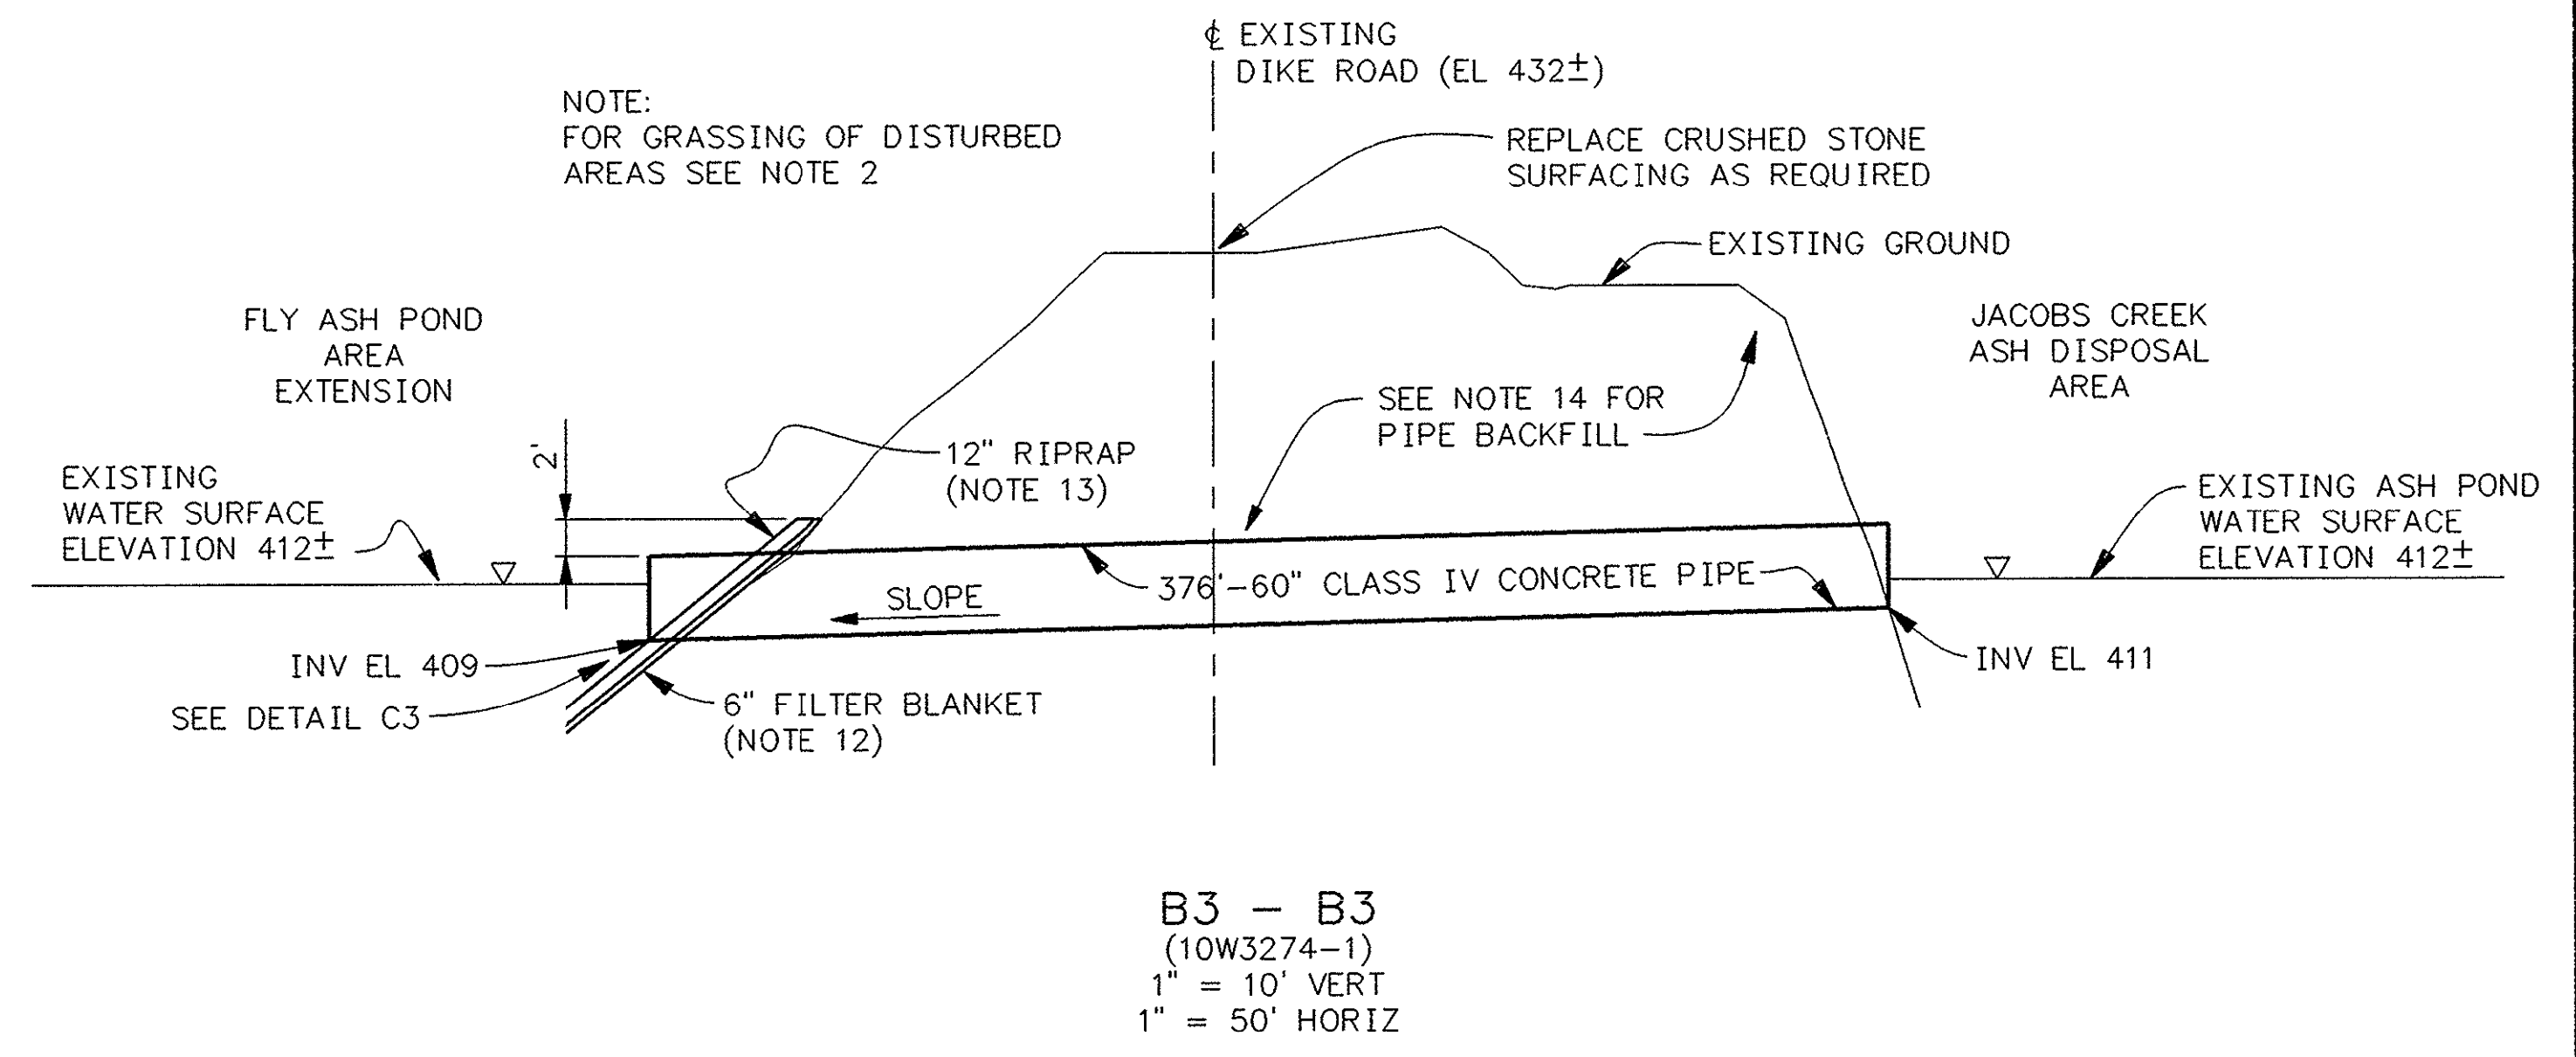
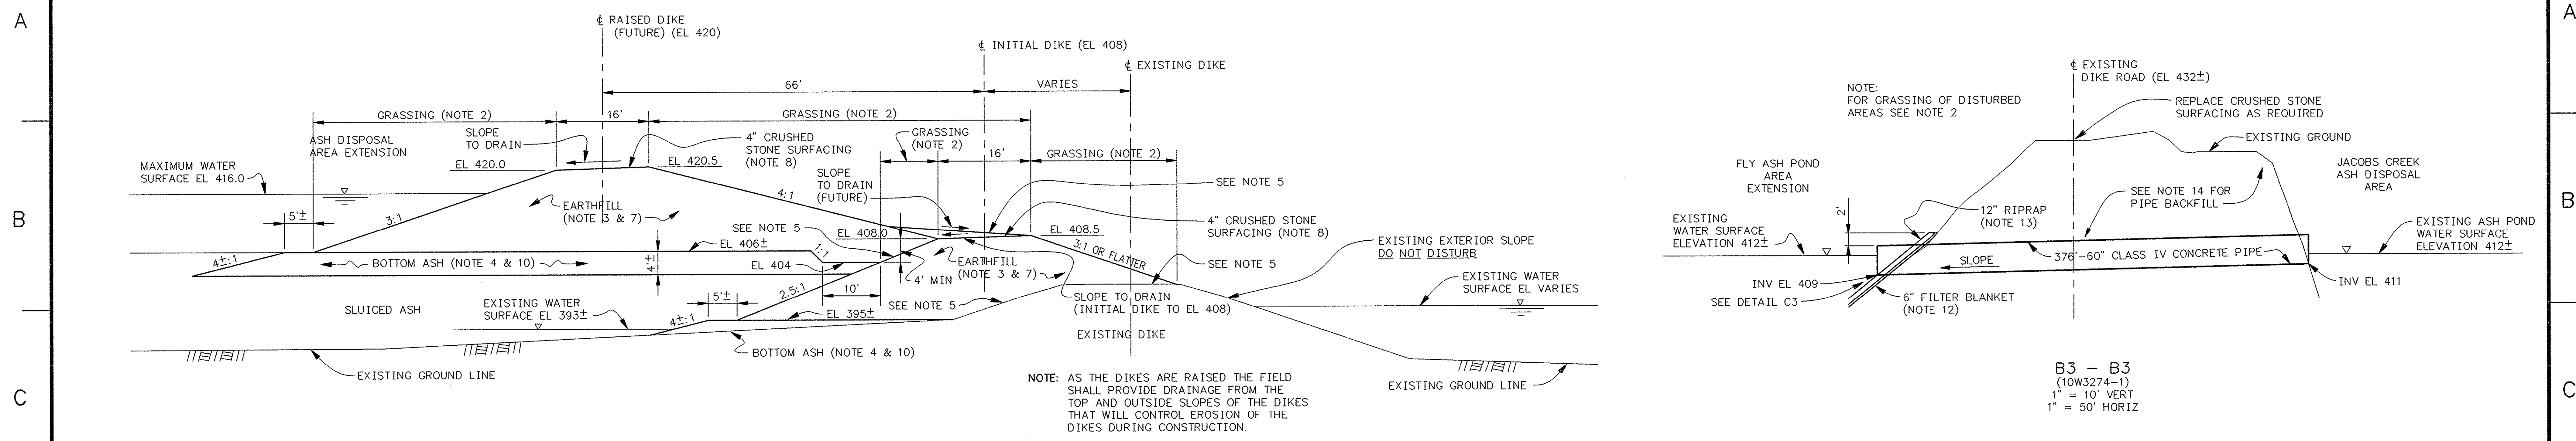


NOTES:  
1. FOR GENERAL NOTES SEE 10W3274-1.


DESIGNED BY:	CL.MOUNT	CHECKED BY:	J.D.PARIS	SUPERVISED BY:	J.L.GLOVER	REVIEWED BY:	K.W.BURNETT	APPROVED BY:	R.G.JOHNSON	ISSUED BY:	W.D.HALL
PARADISE FOSSIL PLANT TENNESSEE VALLEY AUTHORITY FOSSIL AND HYDRO ENGINEERING											
AUTOCAD R12	DATE	1-4-96	64	C	10W3274-3	R	O				
PLOT FACTOR: 1:120						C.A.D. DRAWING DO NOT ALTER MANUALLY					
TASK COMPLETED BY:						REV. NO.					

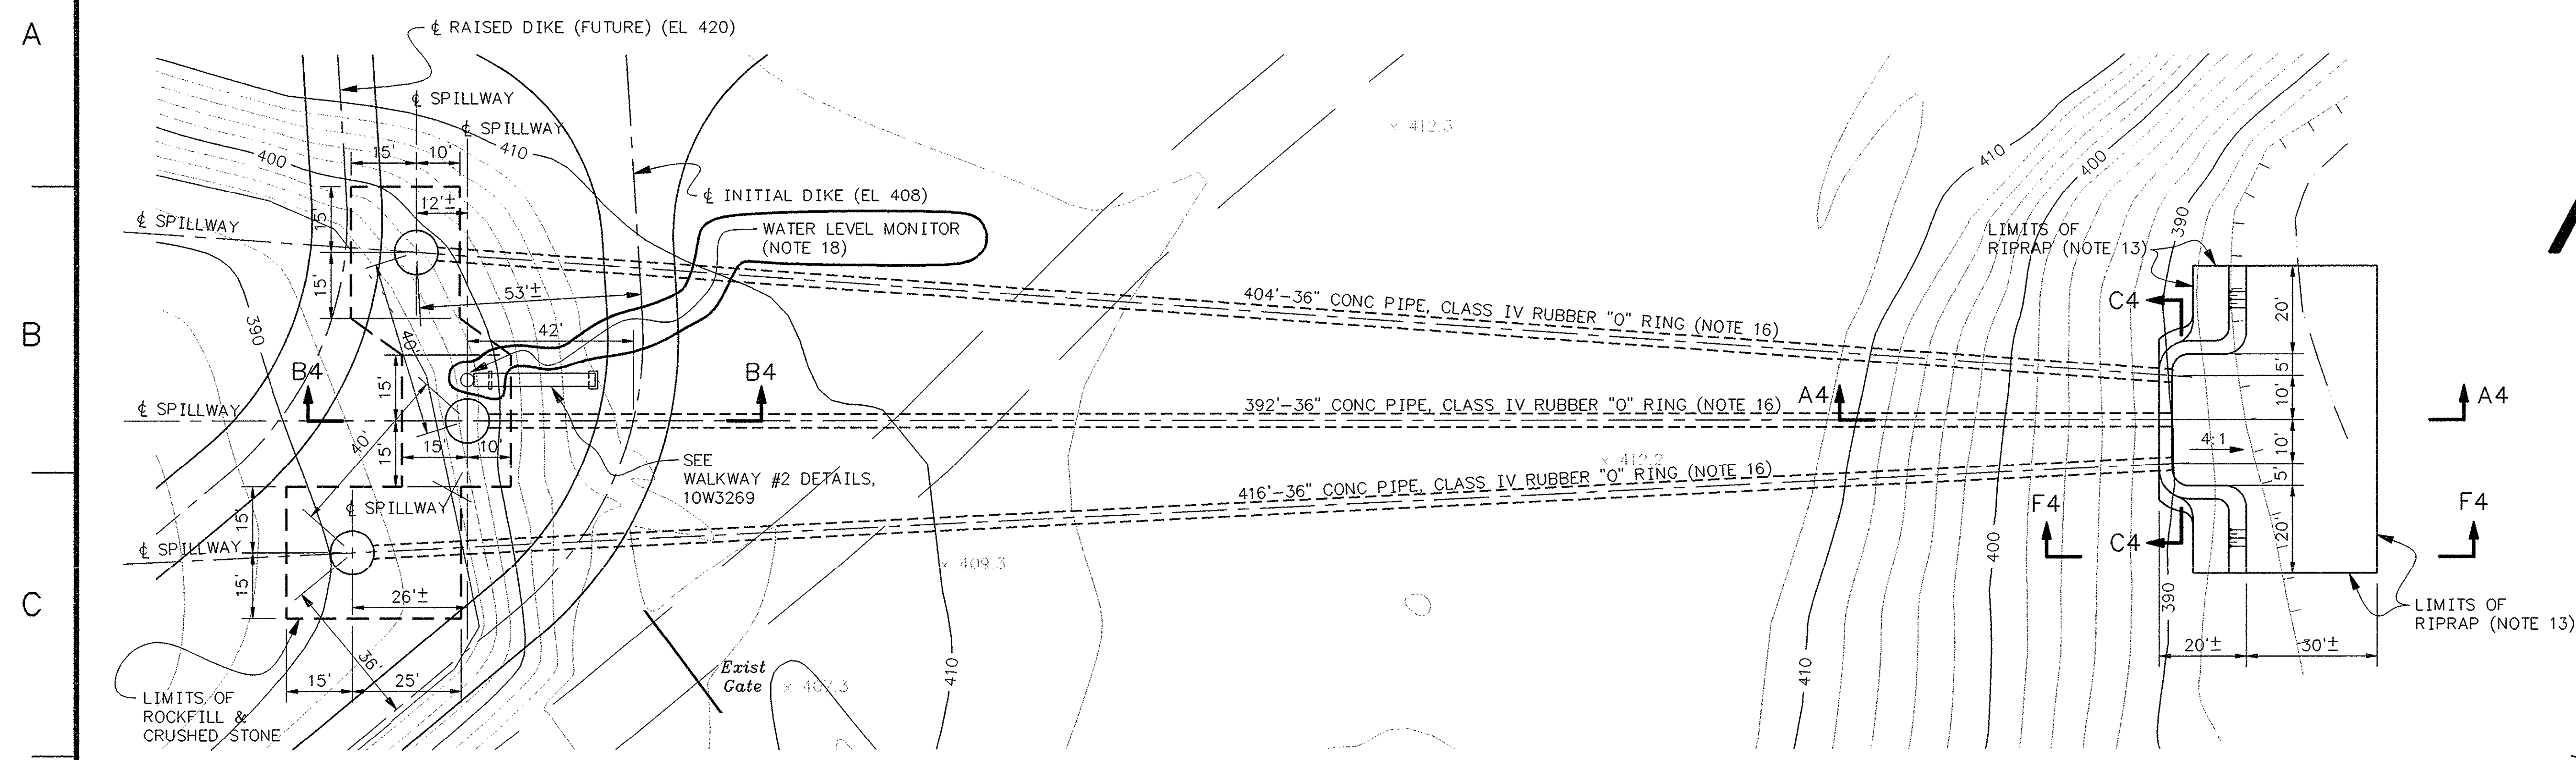


DETAIL E4 - PLAN DISCHARGE SPILLWAYS  
(10W3274-1)

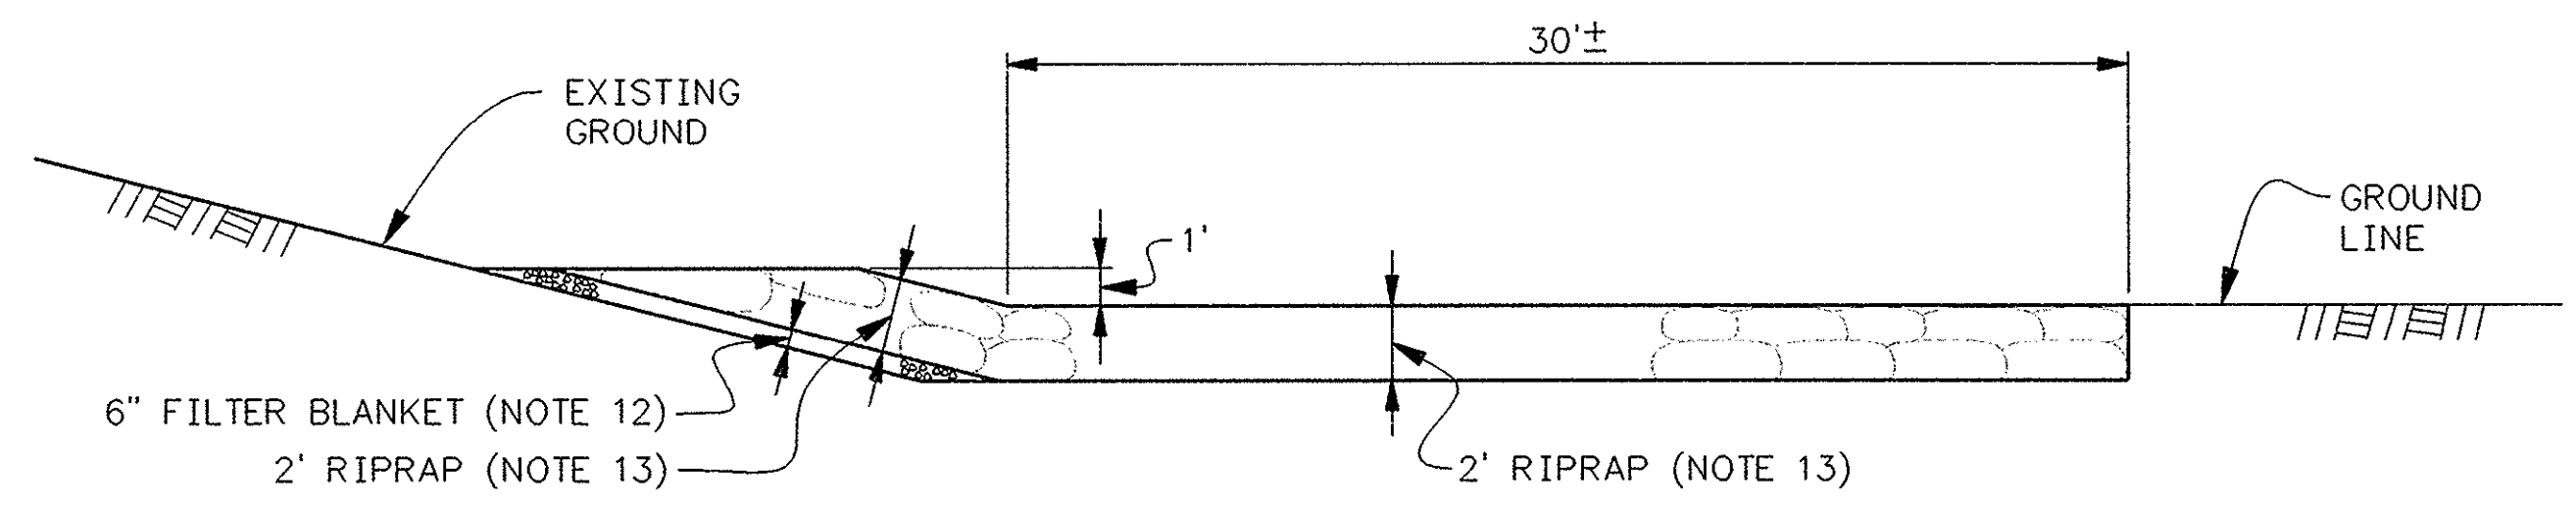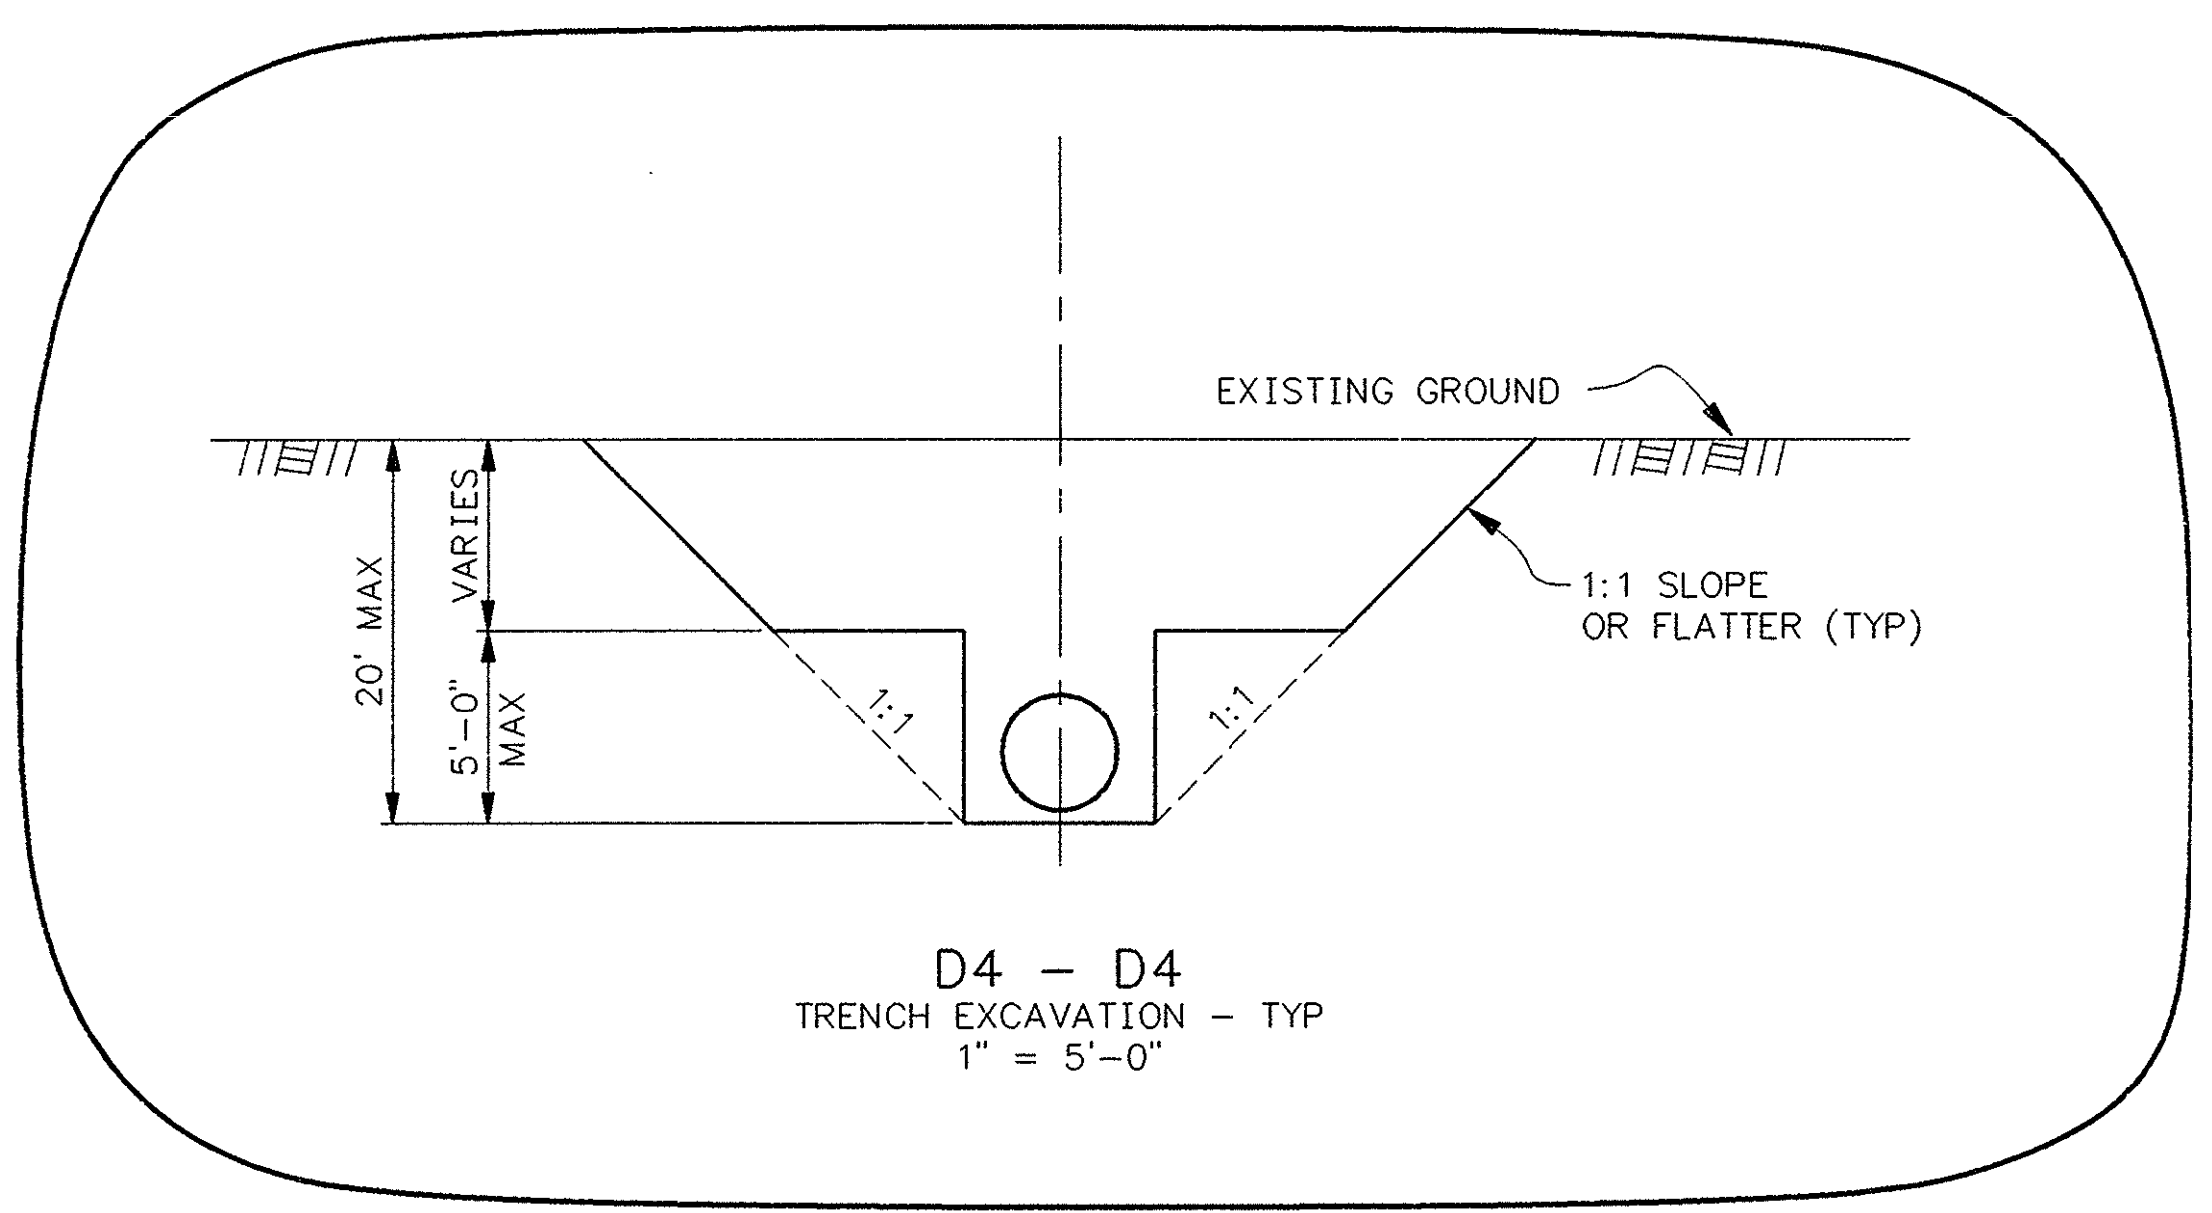

F4 - F4  
1" = 5'

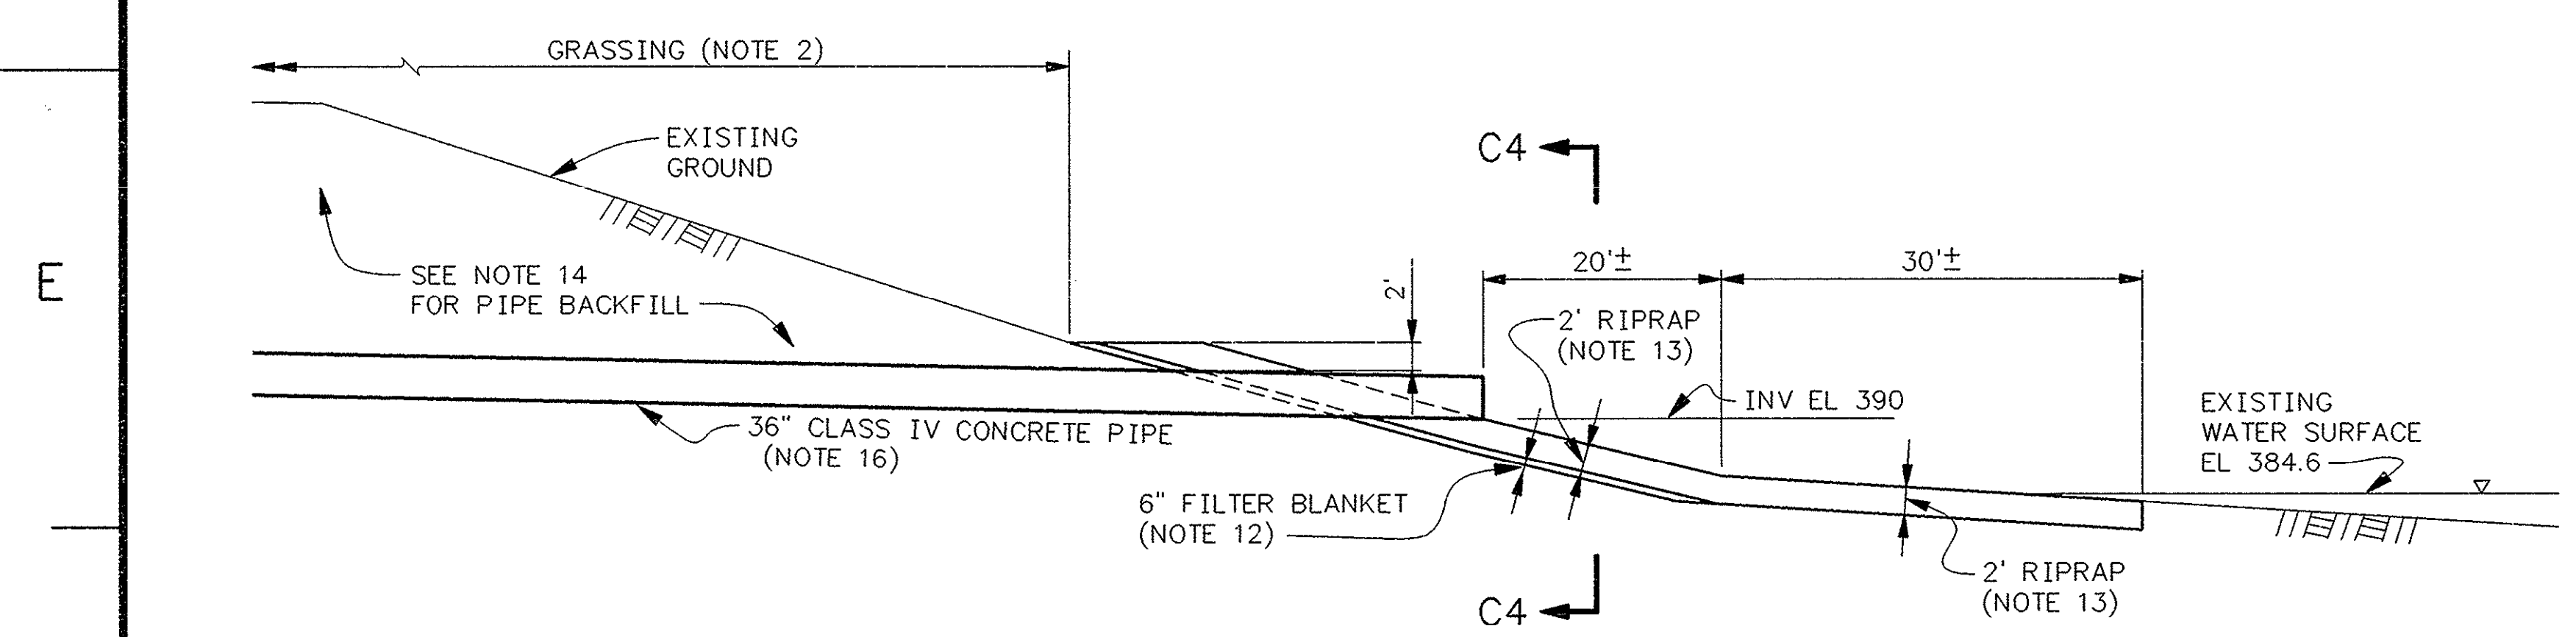


A4 - A4  
TYPICAL PROFILE AT DISCHARGE  
1" = 10'

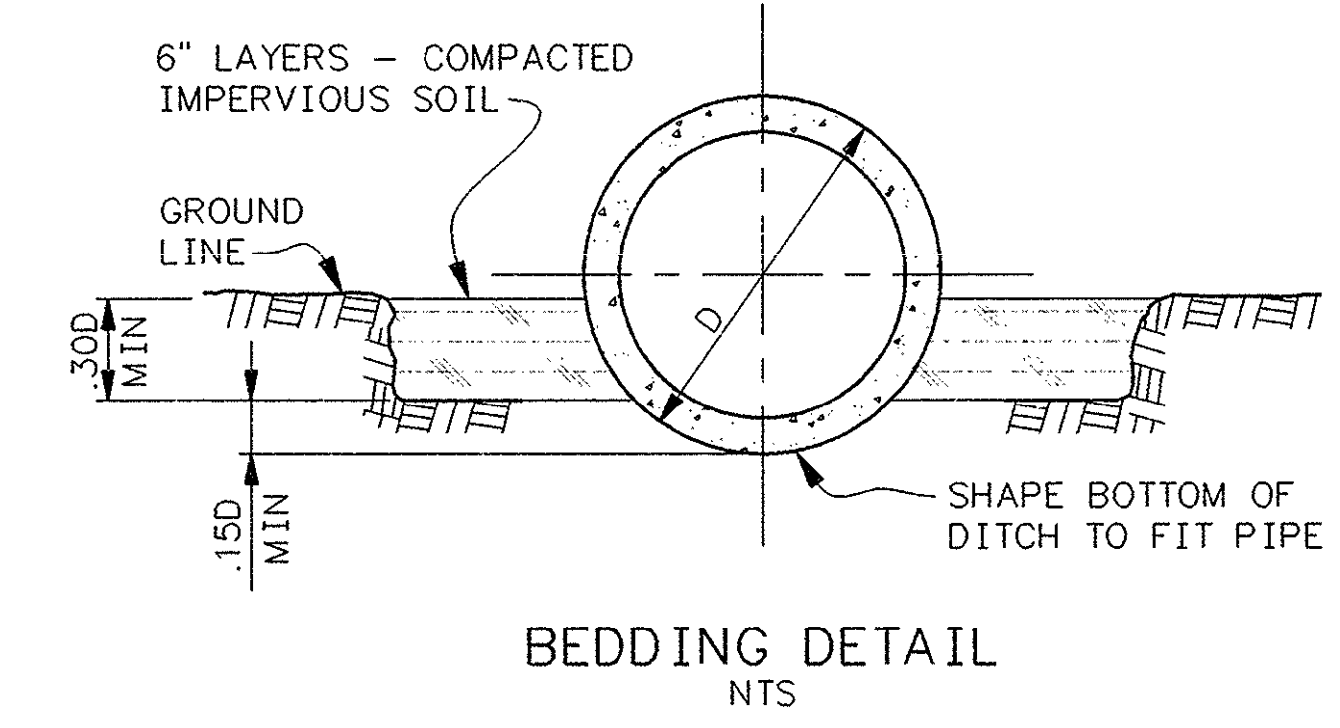


BEDDING DETAIL  
NTS

NOTES:  
1. FOR GENERAL NOTES SEE 10W3274-1.

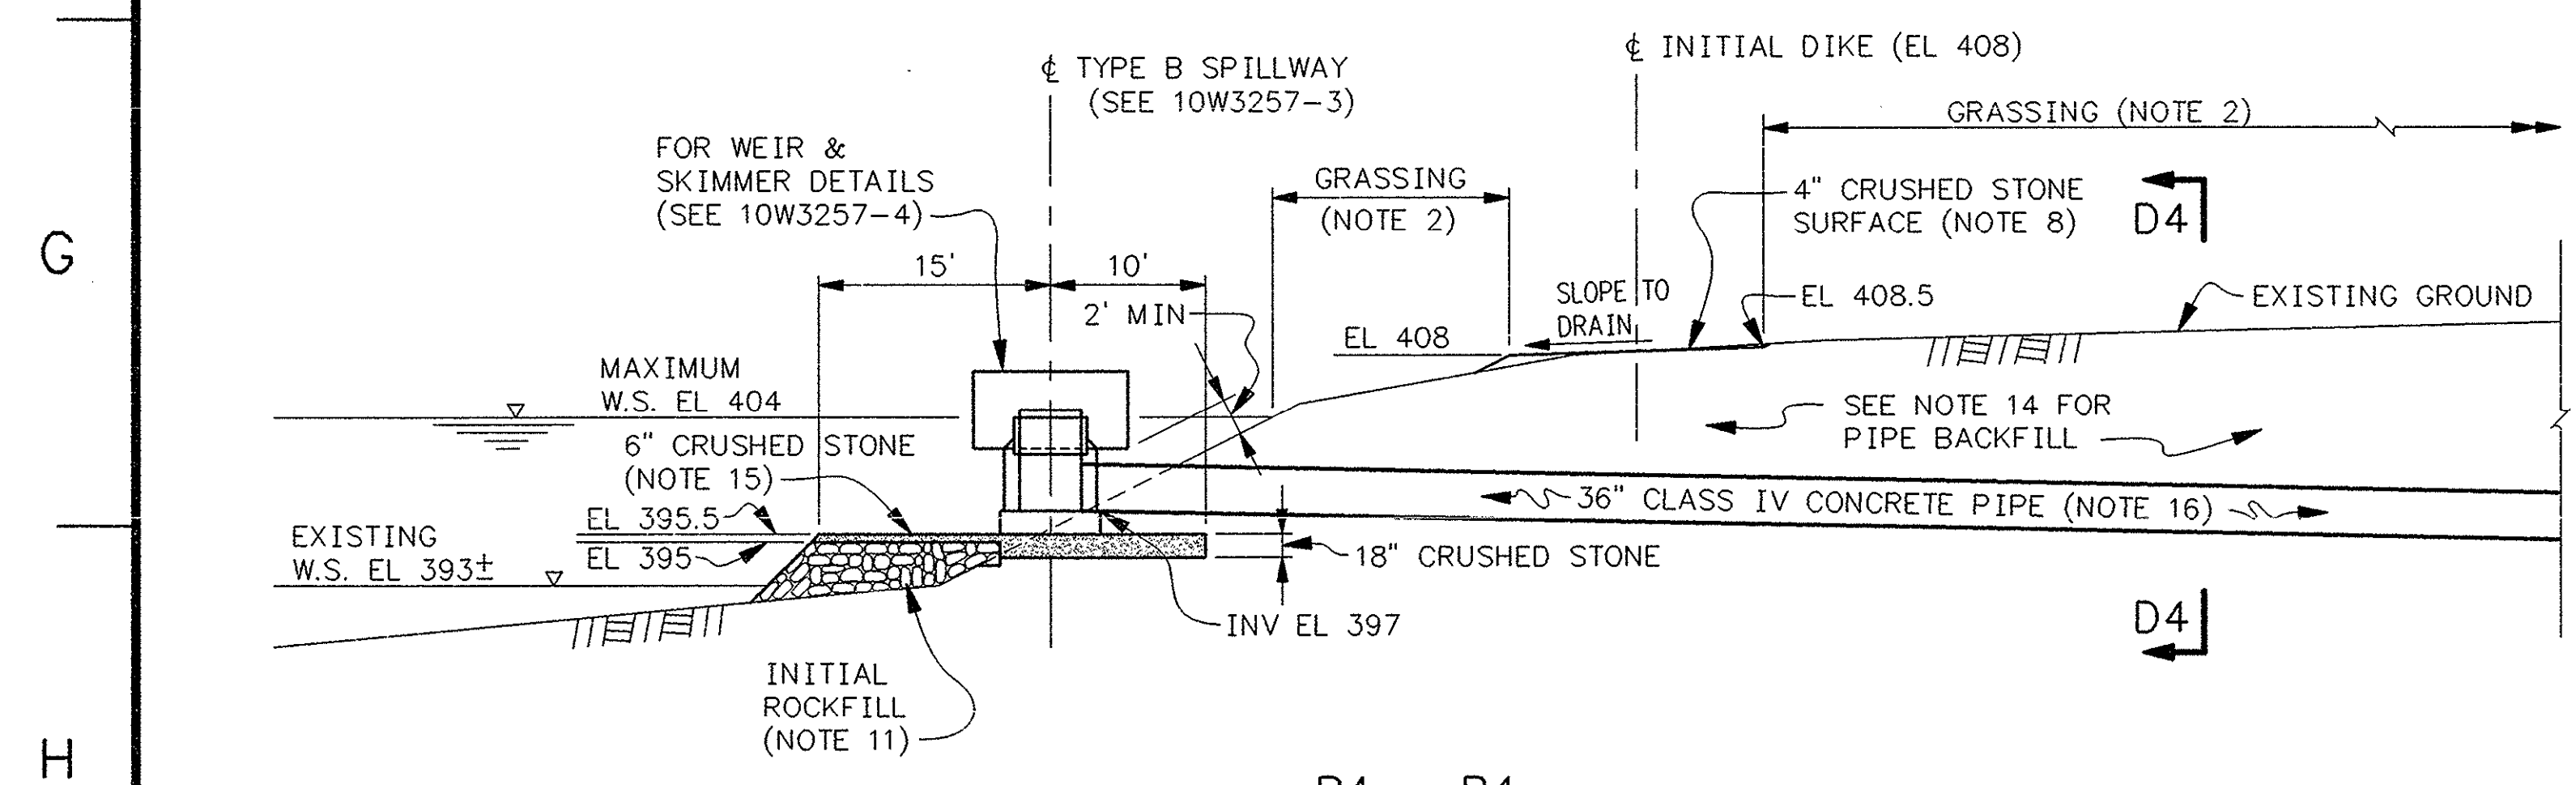






B4 - B4  
TYPICAL PROFILE AT INLET  
3 REQUIRED  
1" = 10'

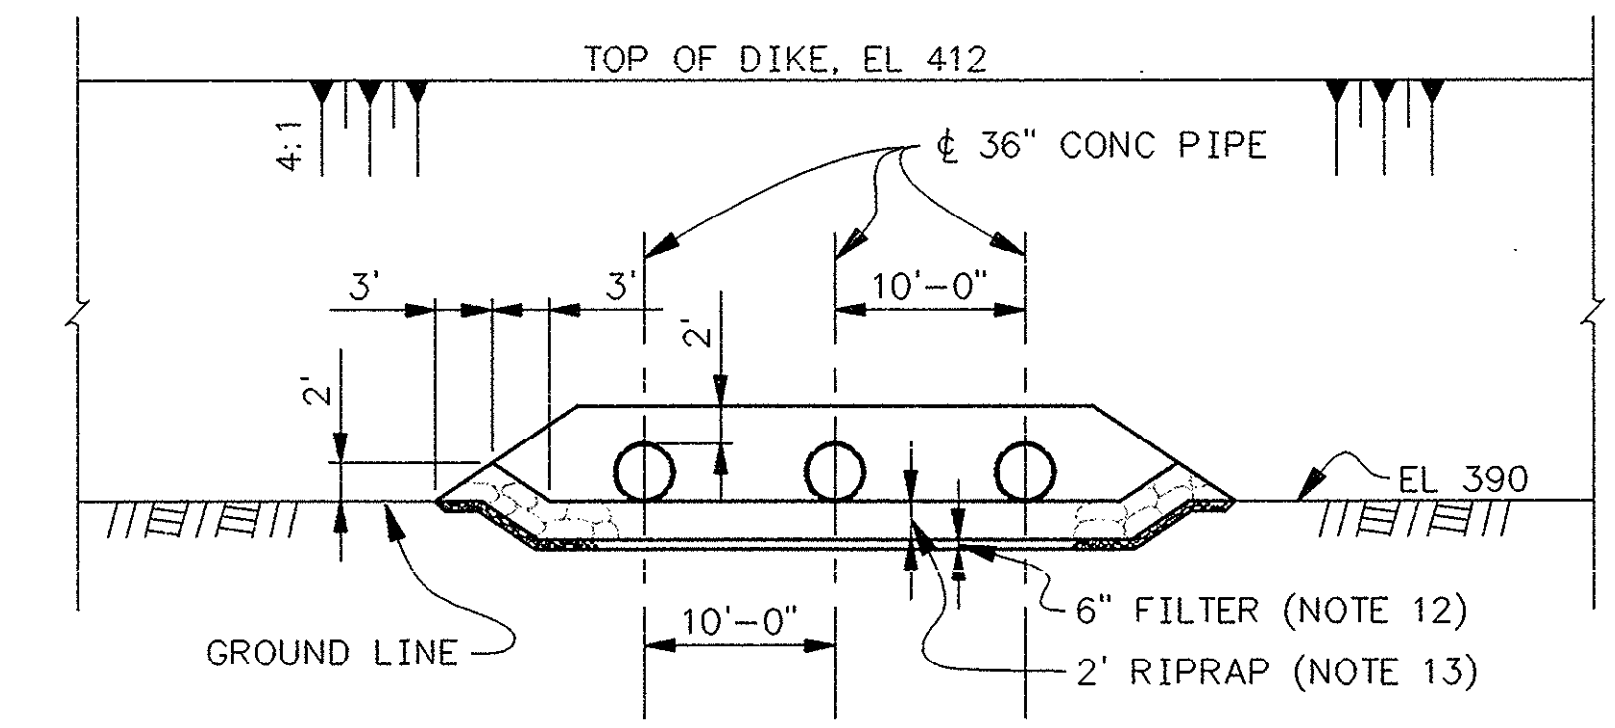





C4 - C4  
1" = 10'

DESIGNED BY	CLMOUNT	DRAWN BY	M.G.HRANEK	CHECKED BY	J.D.PARIS	SUPERVISED BY	J.L.GLOVER	REVIEWED BY	K.W.BURNETT	APPROVED BY	R.G.JOHNSON	ISSUED BY	W.D.HALL
PARADISE FOSSIL PLANT TENNESSEE VALLEY AUTHORITY FOSSIL AND HYDRO ENGINEERING													
AUTOCAD: R12 DATE: 1-4-96 64 C 10W3274-4 R 1													



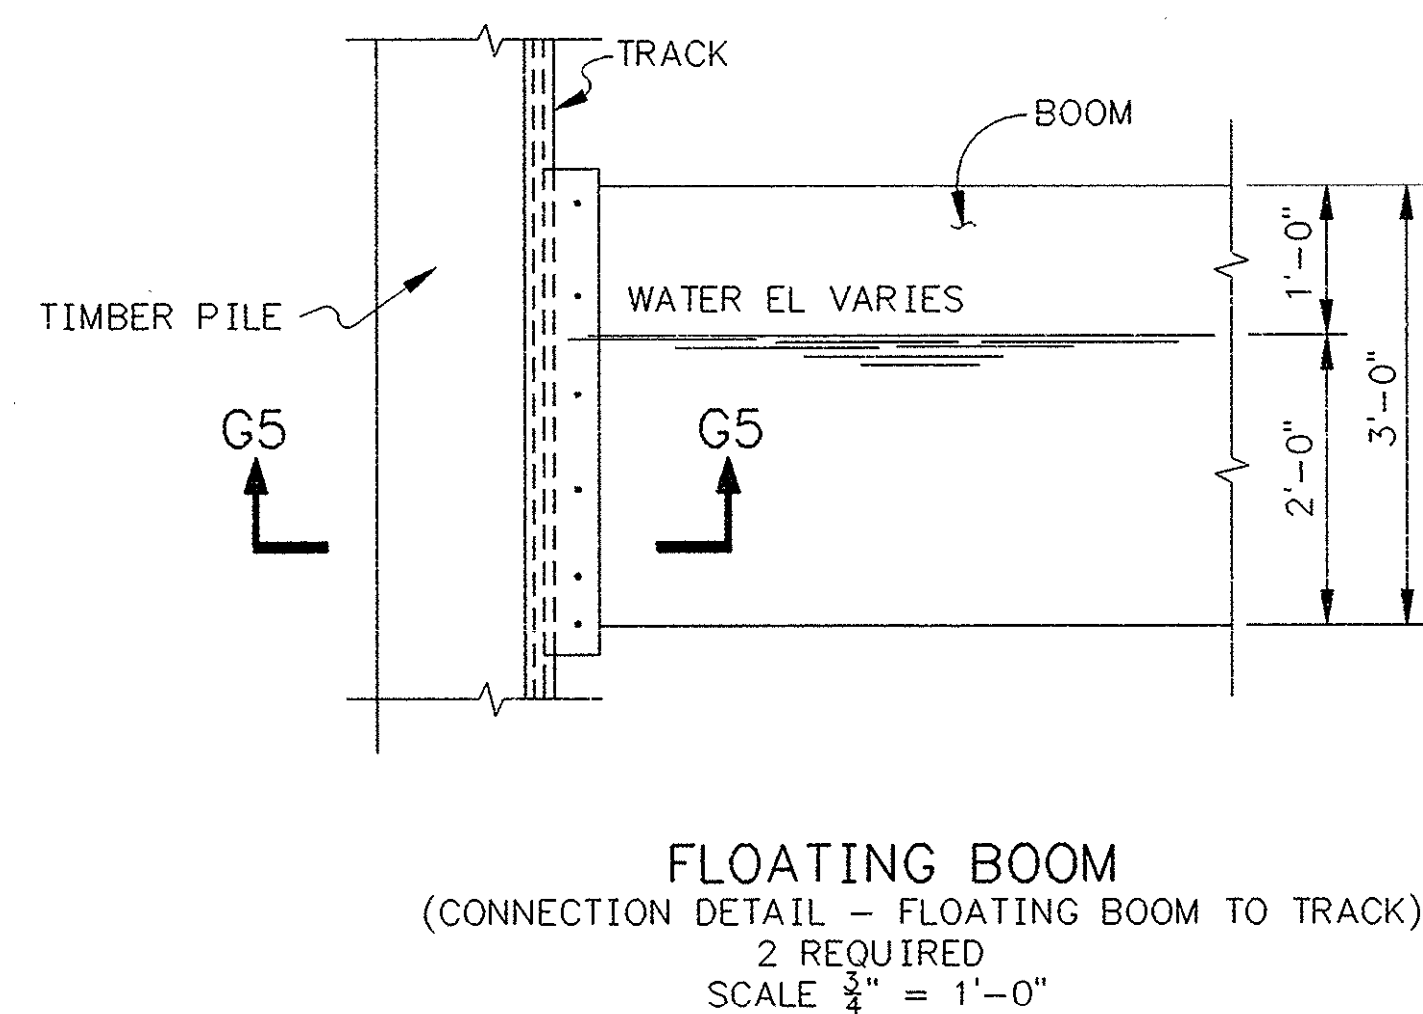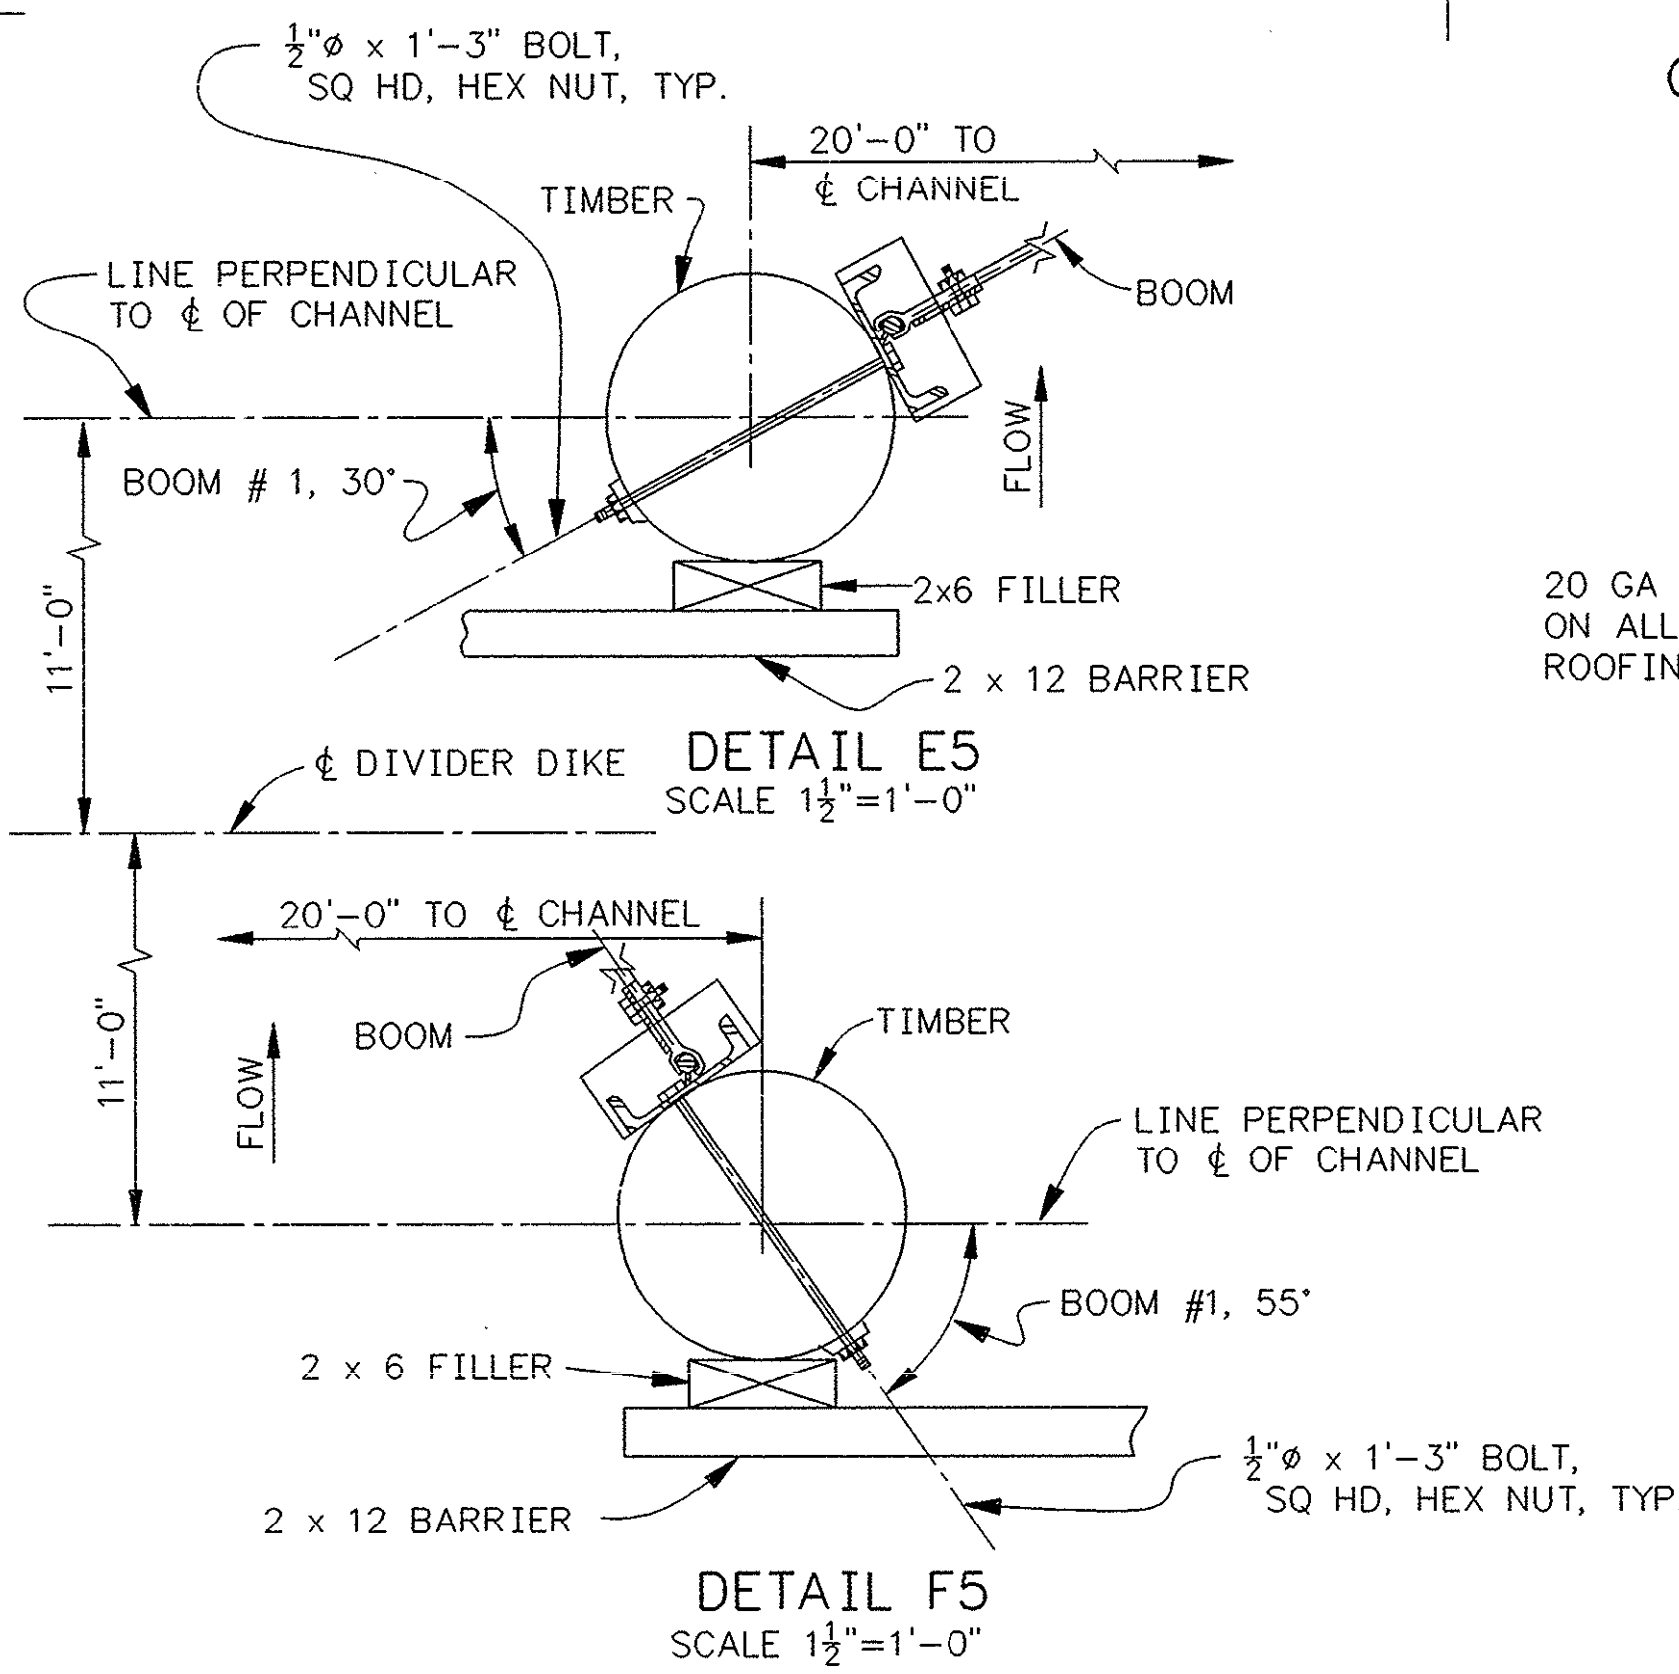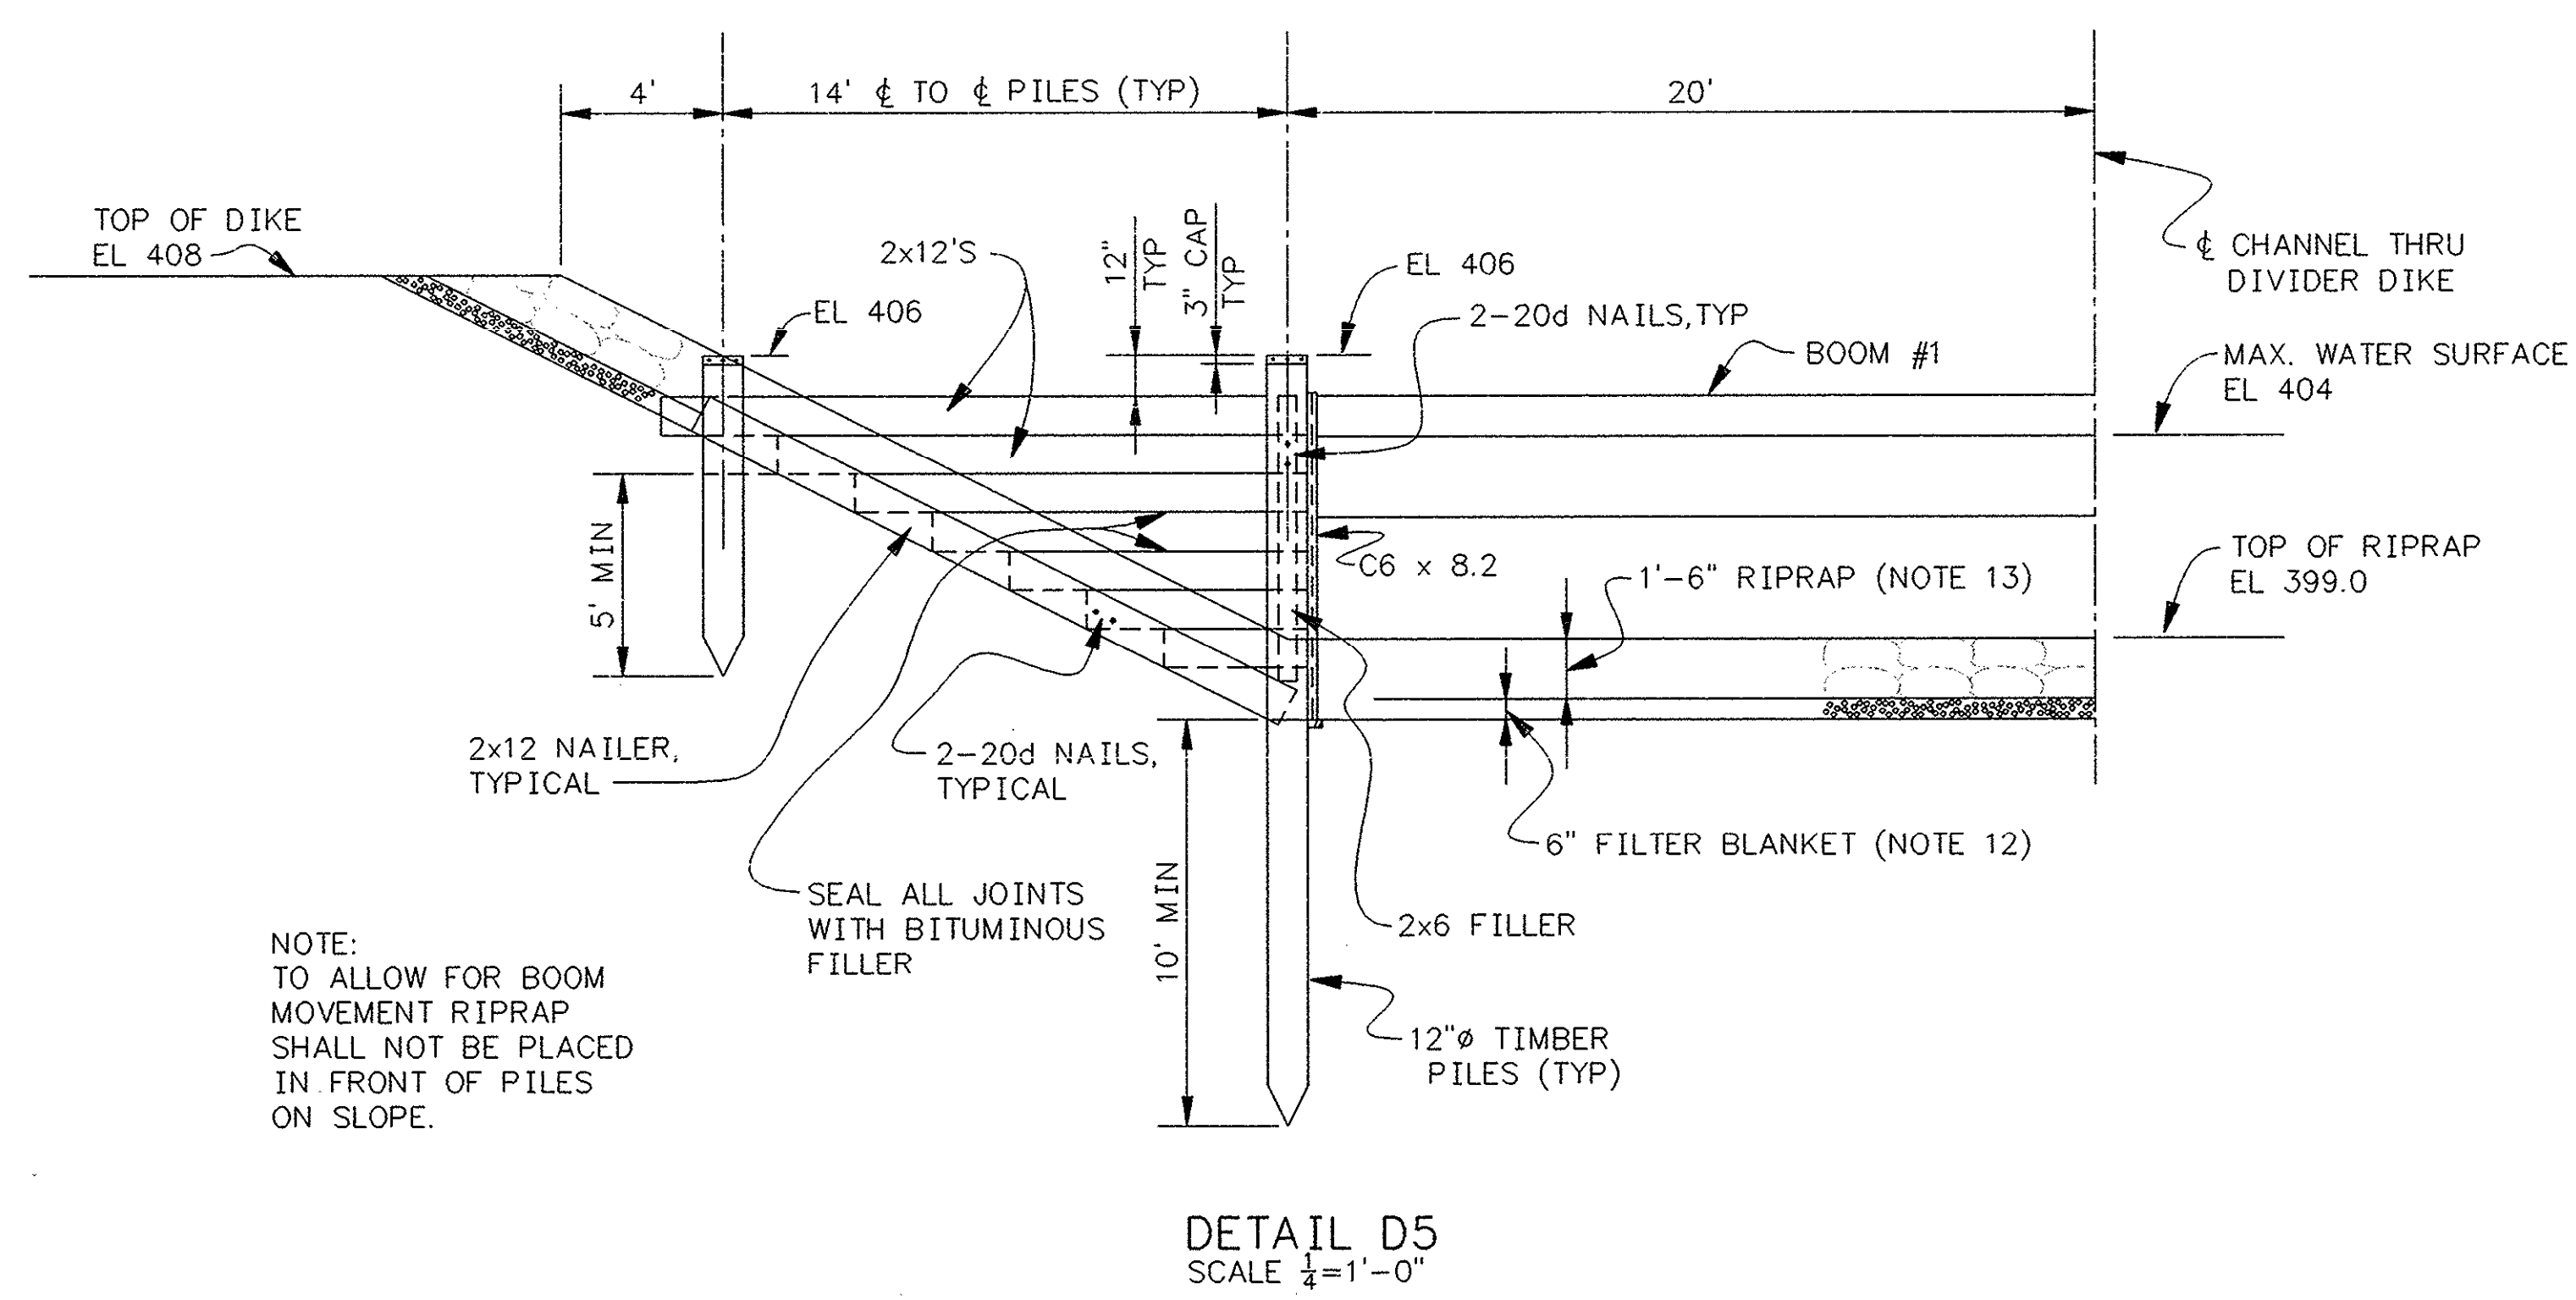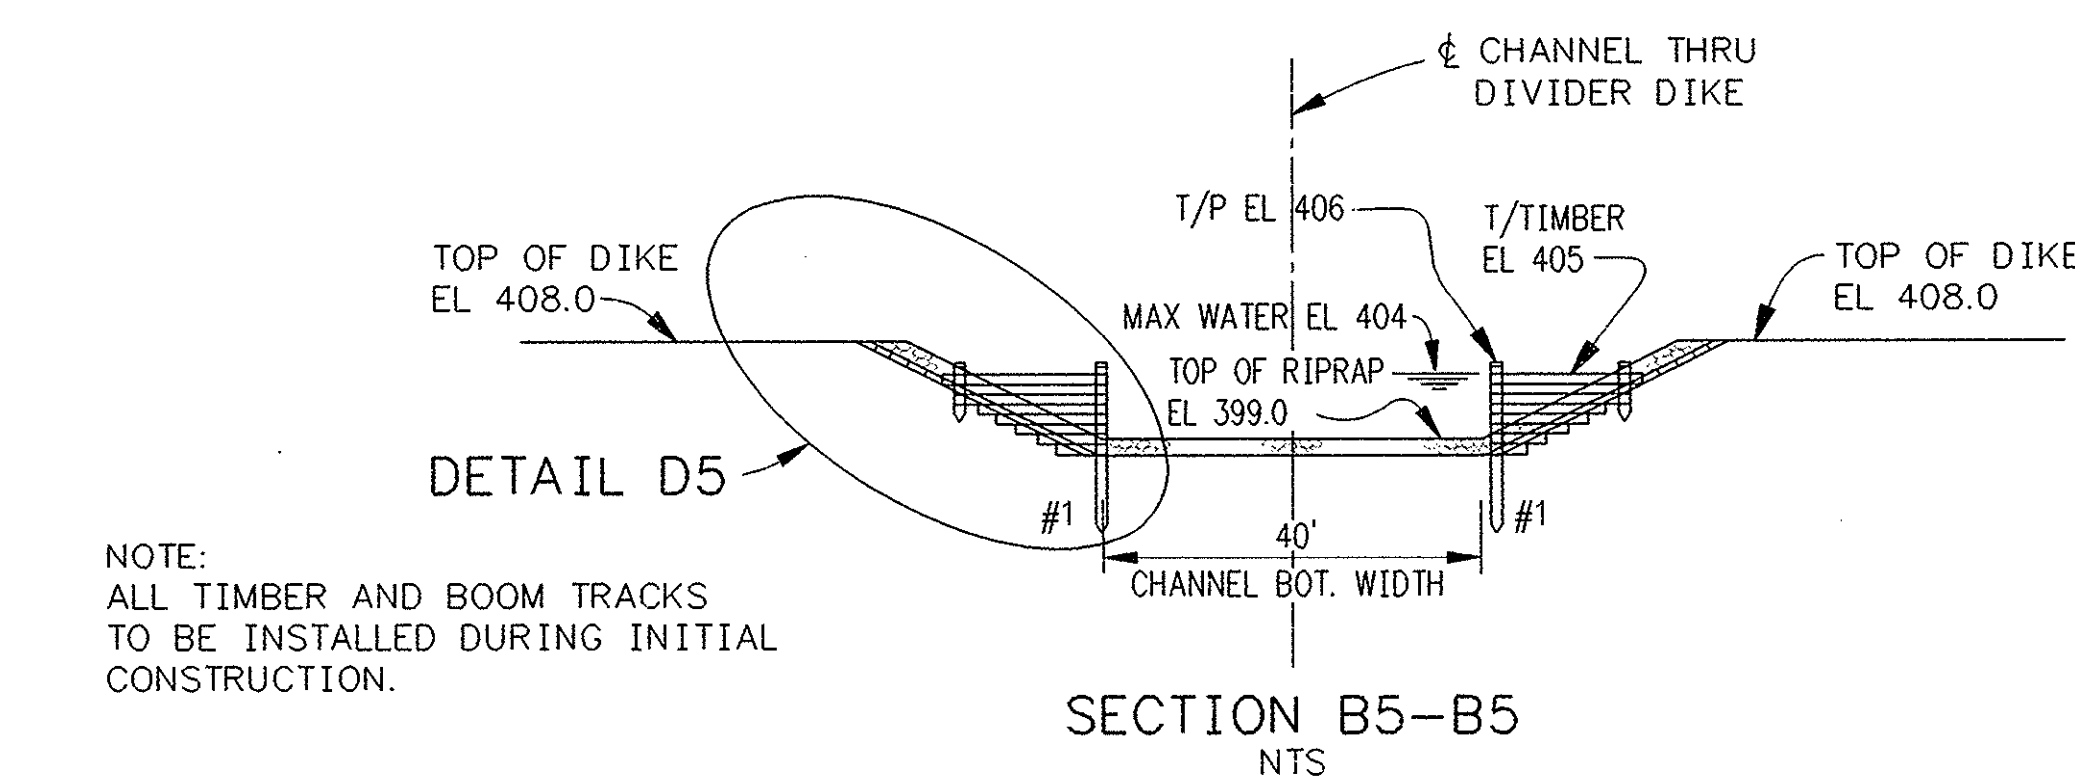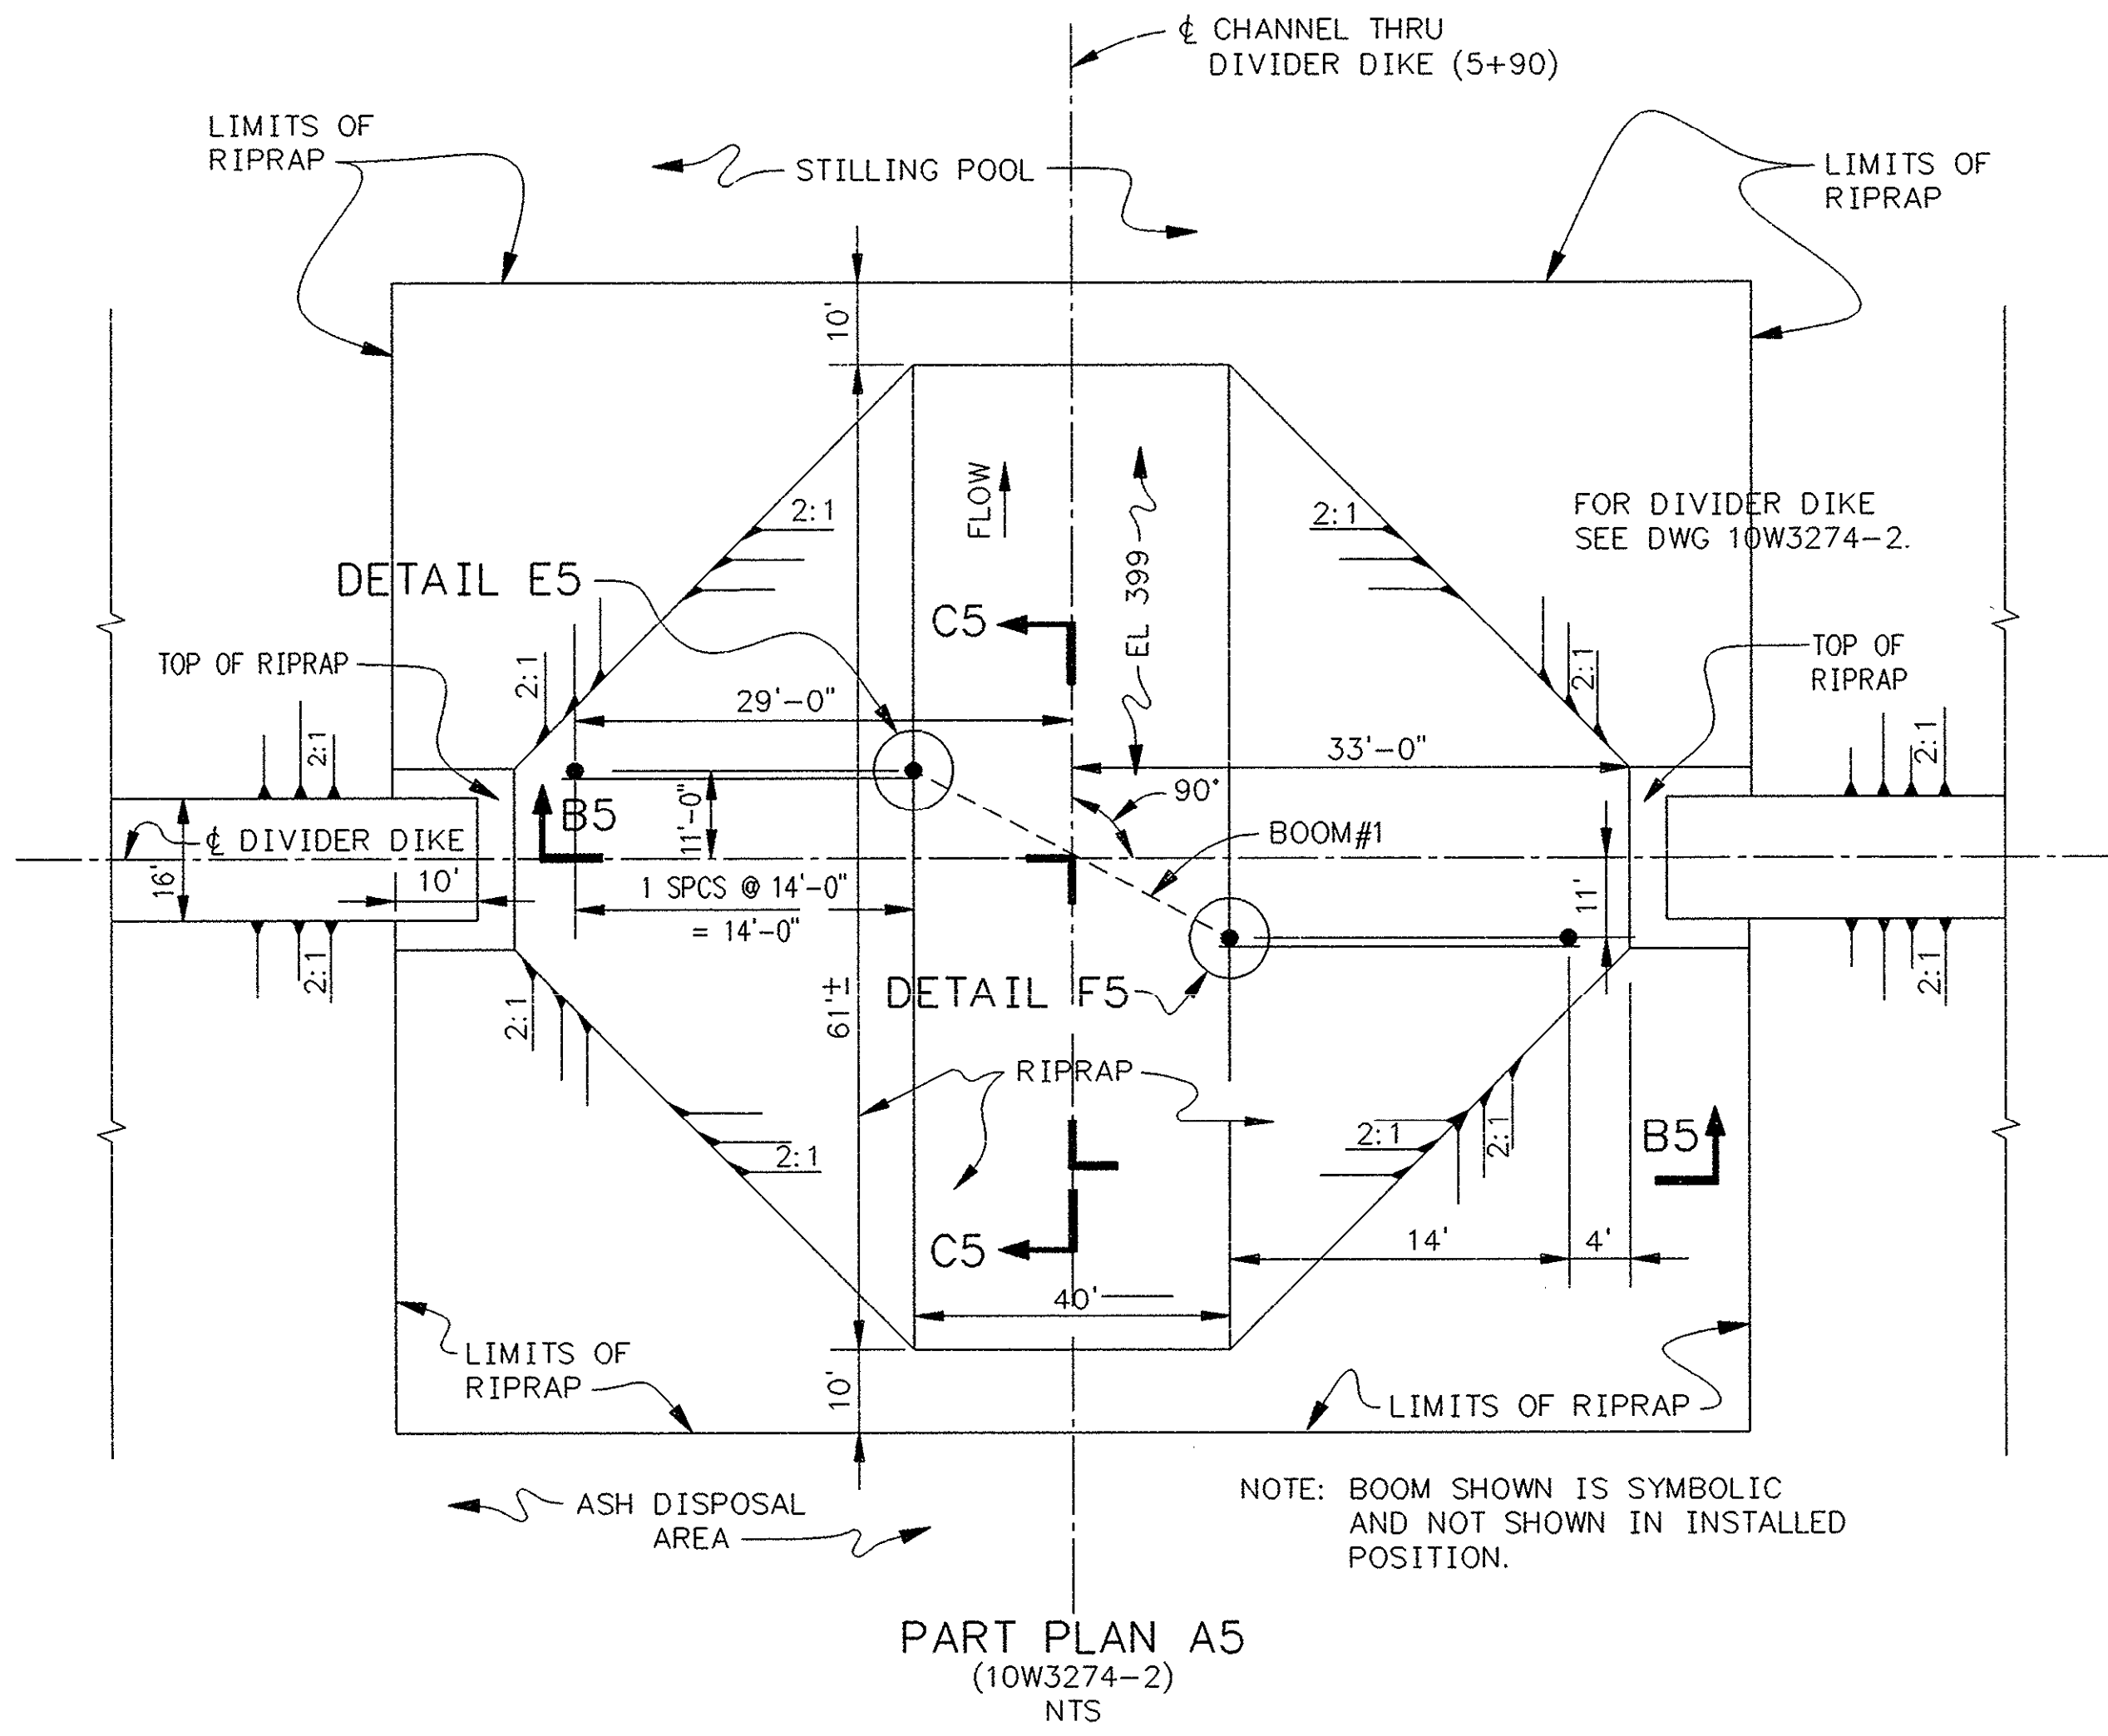

FLOATING BOOM			
ITEM	NO	TOTAL LENGTH	REMARKS
BOOM #1	1	50'-0"	

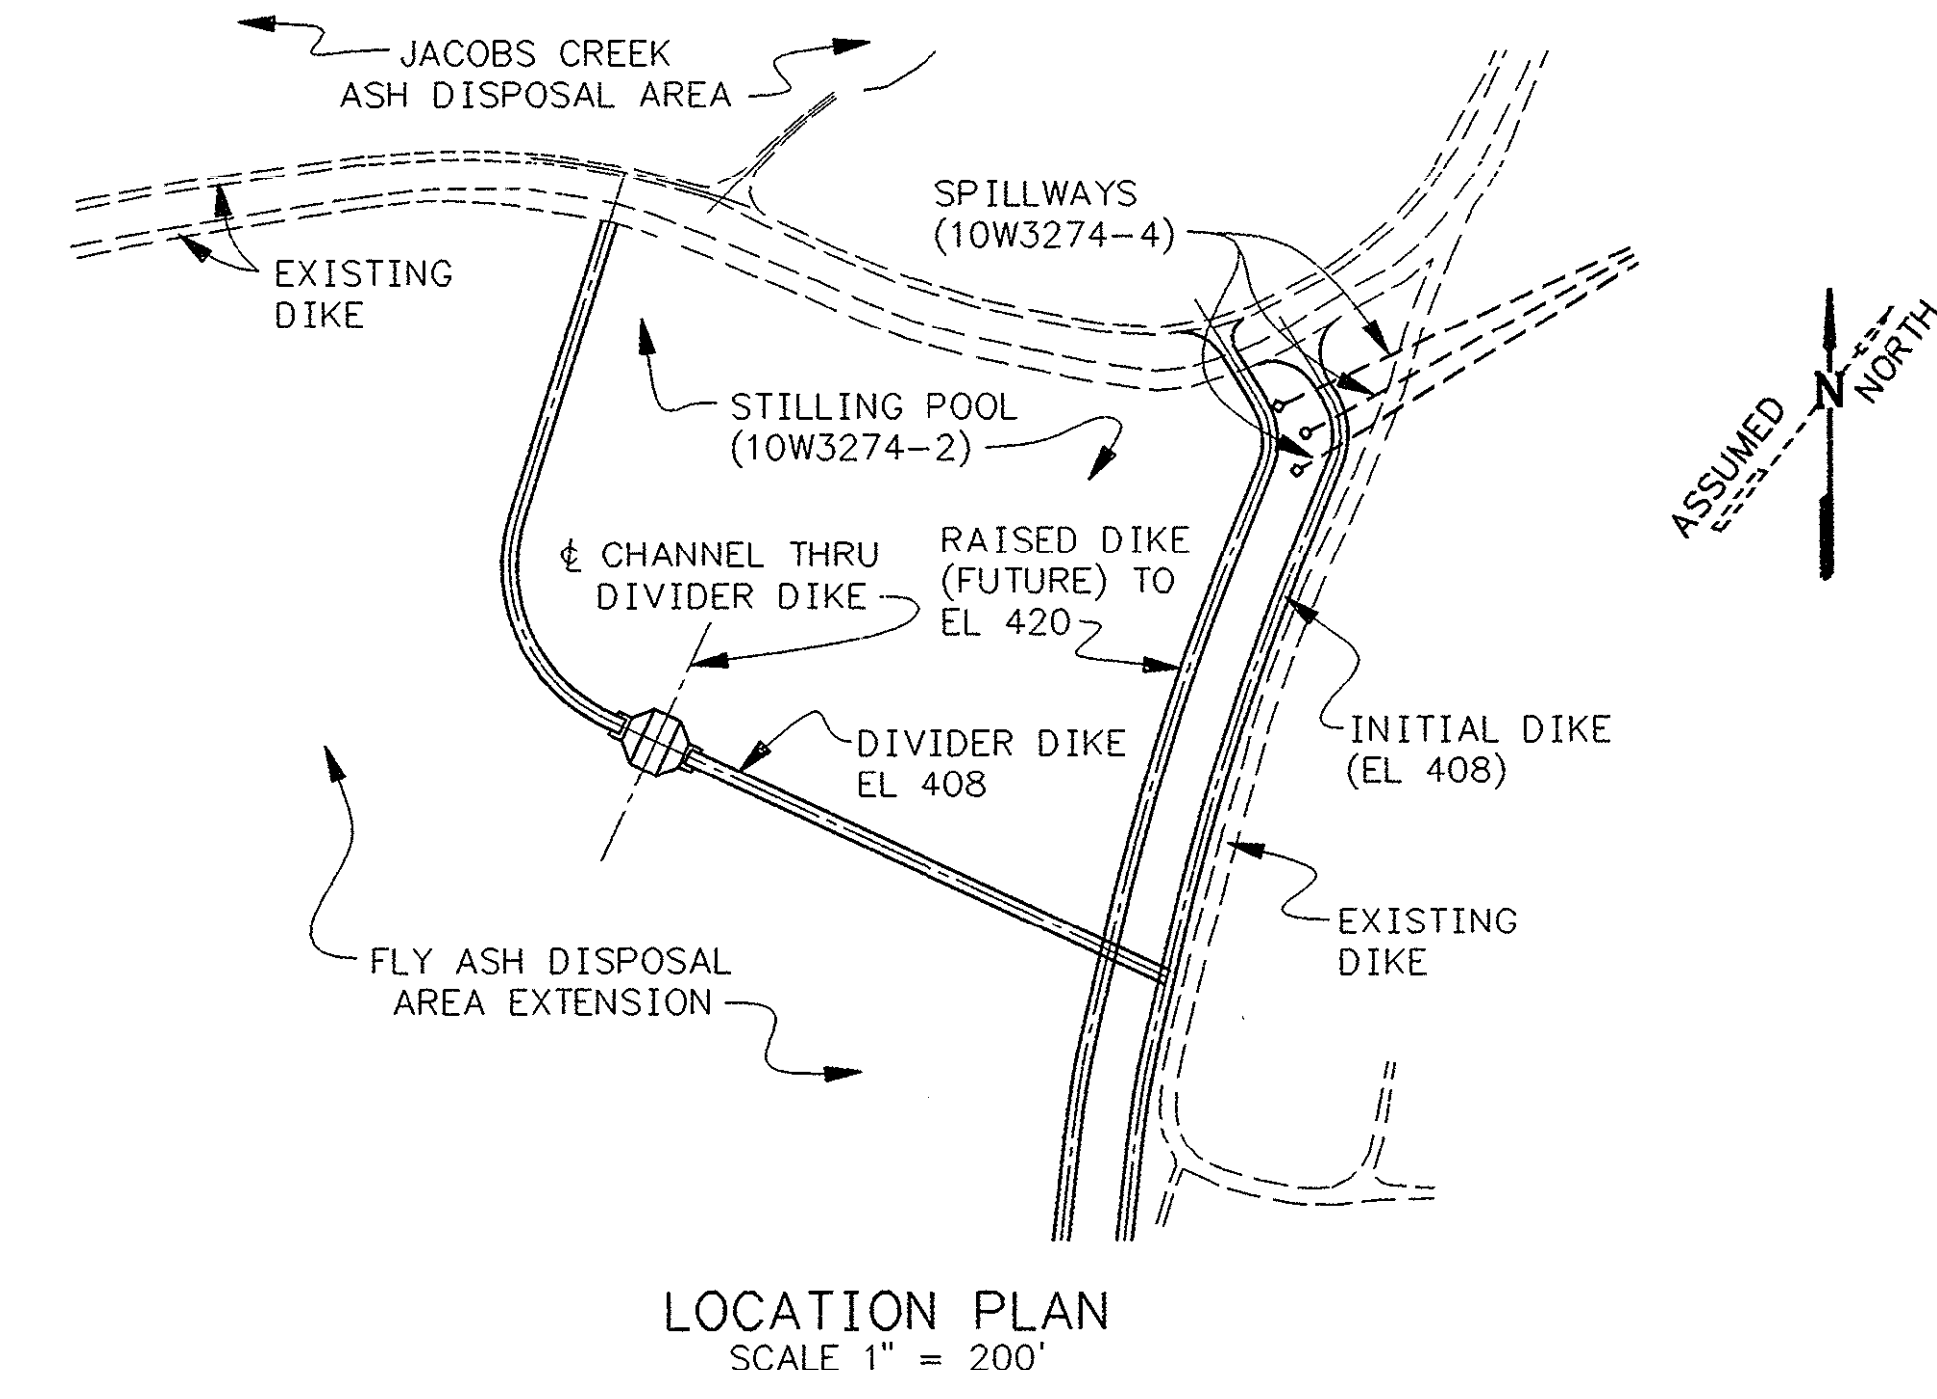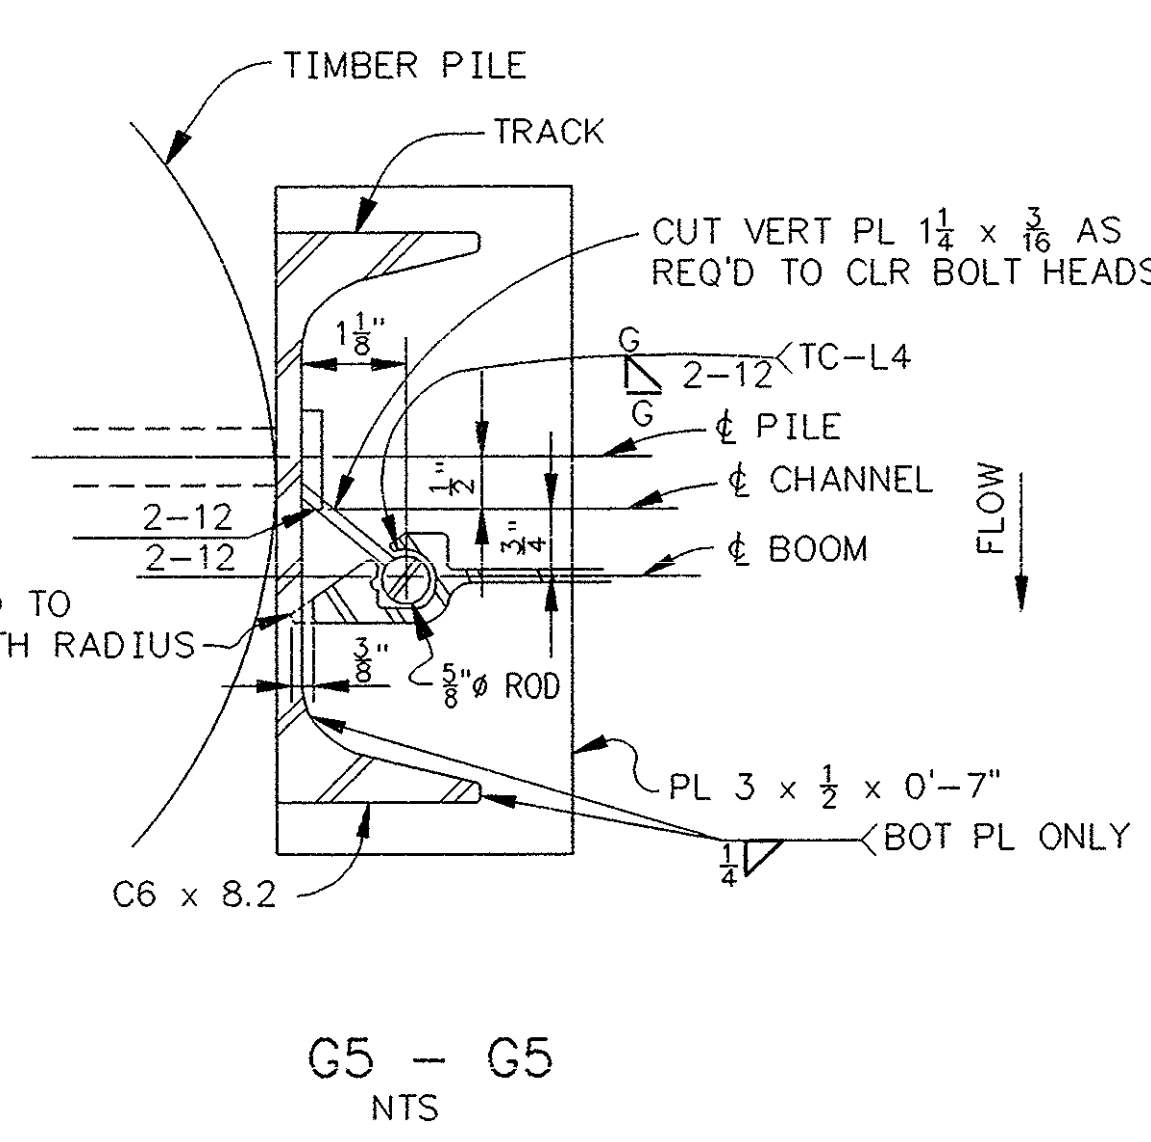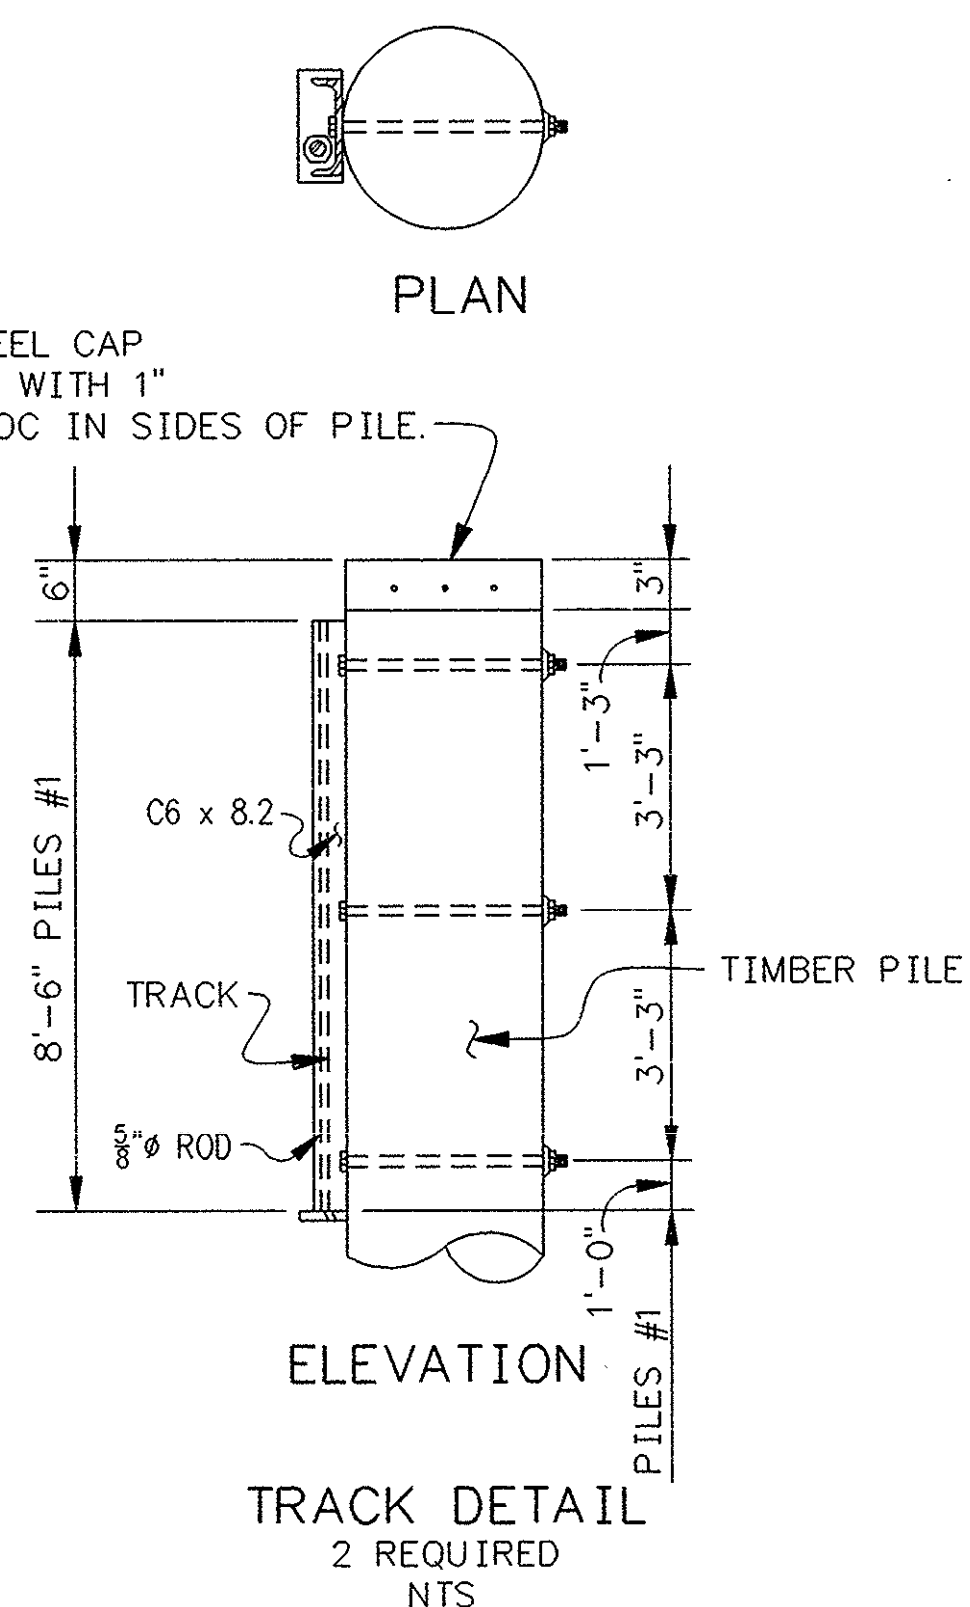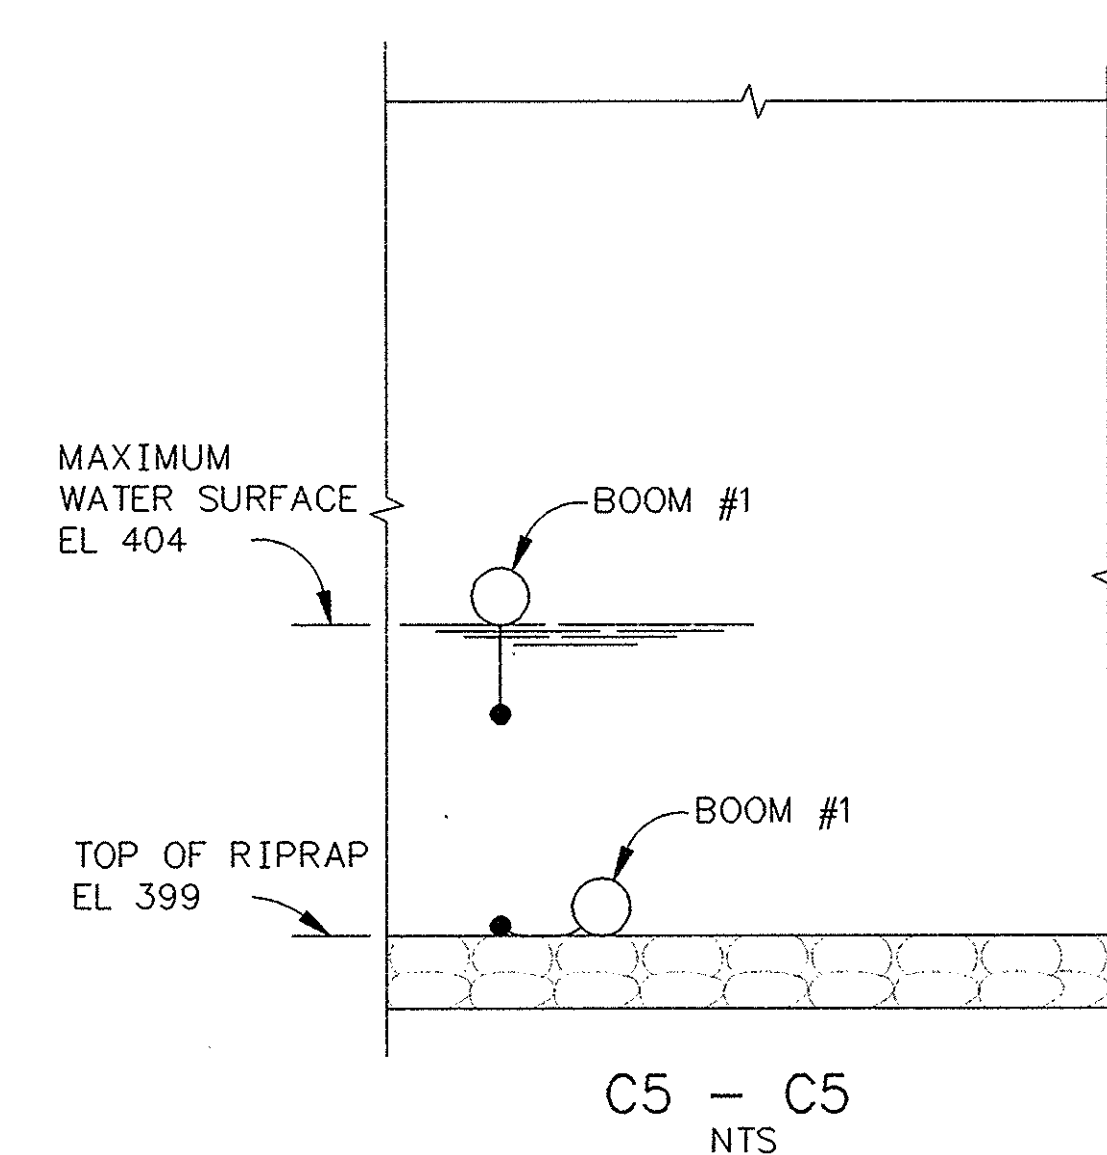

BILL OF FIELD MATERIALS REQUIRED				
ITEM	SIZE	NO	LENGTH	QUANTITY
TIMBER (NAILER)	2 x 12 ROUGH	2	16'-0"	32 LF
BARRIER	2 x 12 ROUGH	10	16'-0"	160 LF
FILLER	2 x 6 ROUGH	2	8'-0"	16 LF
PILING (CLASS B CREOSOTED)				
	12" Ø	2	20'-0"	40 LF
	12" Ø	2	8'-0"	16 LF
HARDWARE				
BOLTS - CHANNEL TO PILE	1/2" SQ HD. HEX NUT	6	1'-3"	EACH
OGE WASHERS	FOR 1/2" Ø BOLTS	6		EACH
ROOFING NAILS			0'-1"	2 LBS
NAILS	20 D COMMON			4 LBS
STEEL				
C6 x 8.2		2	8'-6"	140 LBS
PL	3 x 1/2 x 0'-7"	2		6 LBS
PL	1 1/2 x 3/8 x 8'-6"	2		14 LBS
3/8" Ø ROD		2	8'-6"	12 LBS
GALV SHEET STEEL				
	20 GAGE			25 LBS

- NOTES:
1. MATERIALS: ALL MATERIALS TO BE FURNISHED AND FABRICATED BY TVA'S CONSTRUCTION PARTNER.
  2. BOLTS TO BE ASTM A307.
  3. ALL METAL PARTS TO BE ASTM A36 AND GALVANIZED.
  4. **TIMBER TO BE COMMERCIAL TREATED ROUGH SAWN PINE.**
  5. FOR FIELD WELDING SEE TVA SPEC 029C.
  6. ALL WELDS SHALL BE MADE WITH AWS A5.1 E70 SERIES ELECTRODES OR EQUIVALENT ELECTRODES FOR OTHER PROCESSES.
  7. ALL WELDS SHALL BE VISUALLY INSPECTED IN ACCORDANCE WITH THE LATEST STRUCTURAL WELDING CODE D1.1.
  8. FOR GENERAL NOTES SEE 10W3274-1.

REV	DATE	ISSN	DRWN	CHKD	APPV	ISSD	PROJECT	AS CORRECTED	BY	DATE
R 1	1-4-96		M.G.HRANEK	J.D.PARIS	J.L.GLOVER	K.W.BURNETT	R.G.JOHNSON	W.D.HALL		

SCALE: 1"=200' EXCEPT AS NOTED

**JACOBS CREEK ASH DISPOSAL AREA EXTENSION**

**FLOATING BOOM - DIKE EL TO 408**


DESIGNED BY: M.G.HRANEK  
 DRAWN BY: J.D.PARIS  
 CHECKED BY: J.L.GLOVER  
 SUPERVISED BY: K.W.BURNETT  
 REVIEWED BY: R.G.JOHNSON  
 APPROVED BY: W.D.HALL  
 ISSUED BY:

PARADISE STEAM PLANT  
 TENNESSEE VALLEY AUTHORITY  
 FOSSIL AND HYDRO ENGINEERING


AUTOCAD R12 DATE 1-4-96 64 C 10W3274-5 R 1

PLOT FACTOR: 1:1  
 W\_TVA  
 FILENAME: PF32745.DWG  
 C.A.D. DRAWING  
 DO NOT ALTER MANUALLY




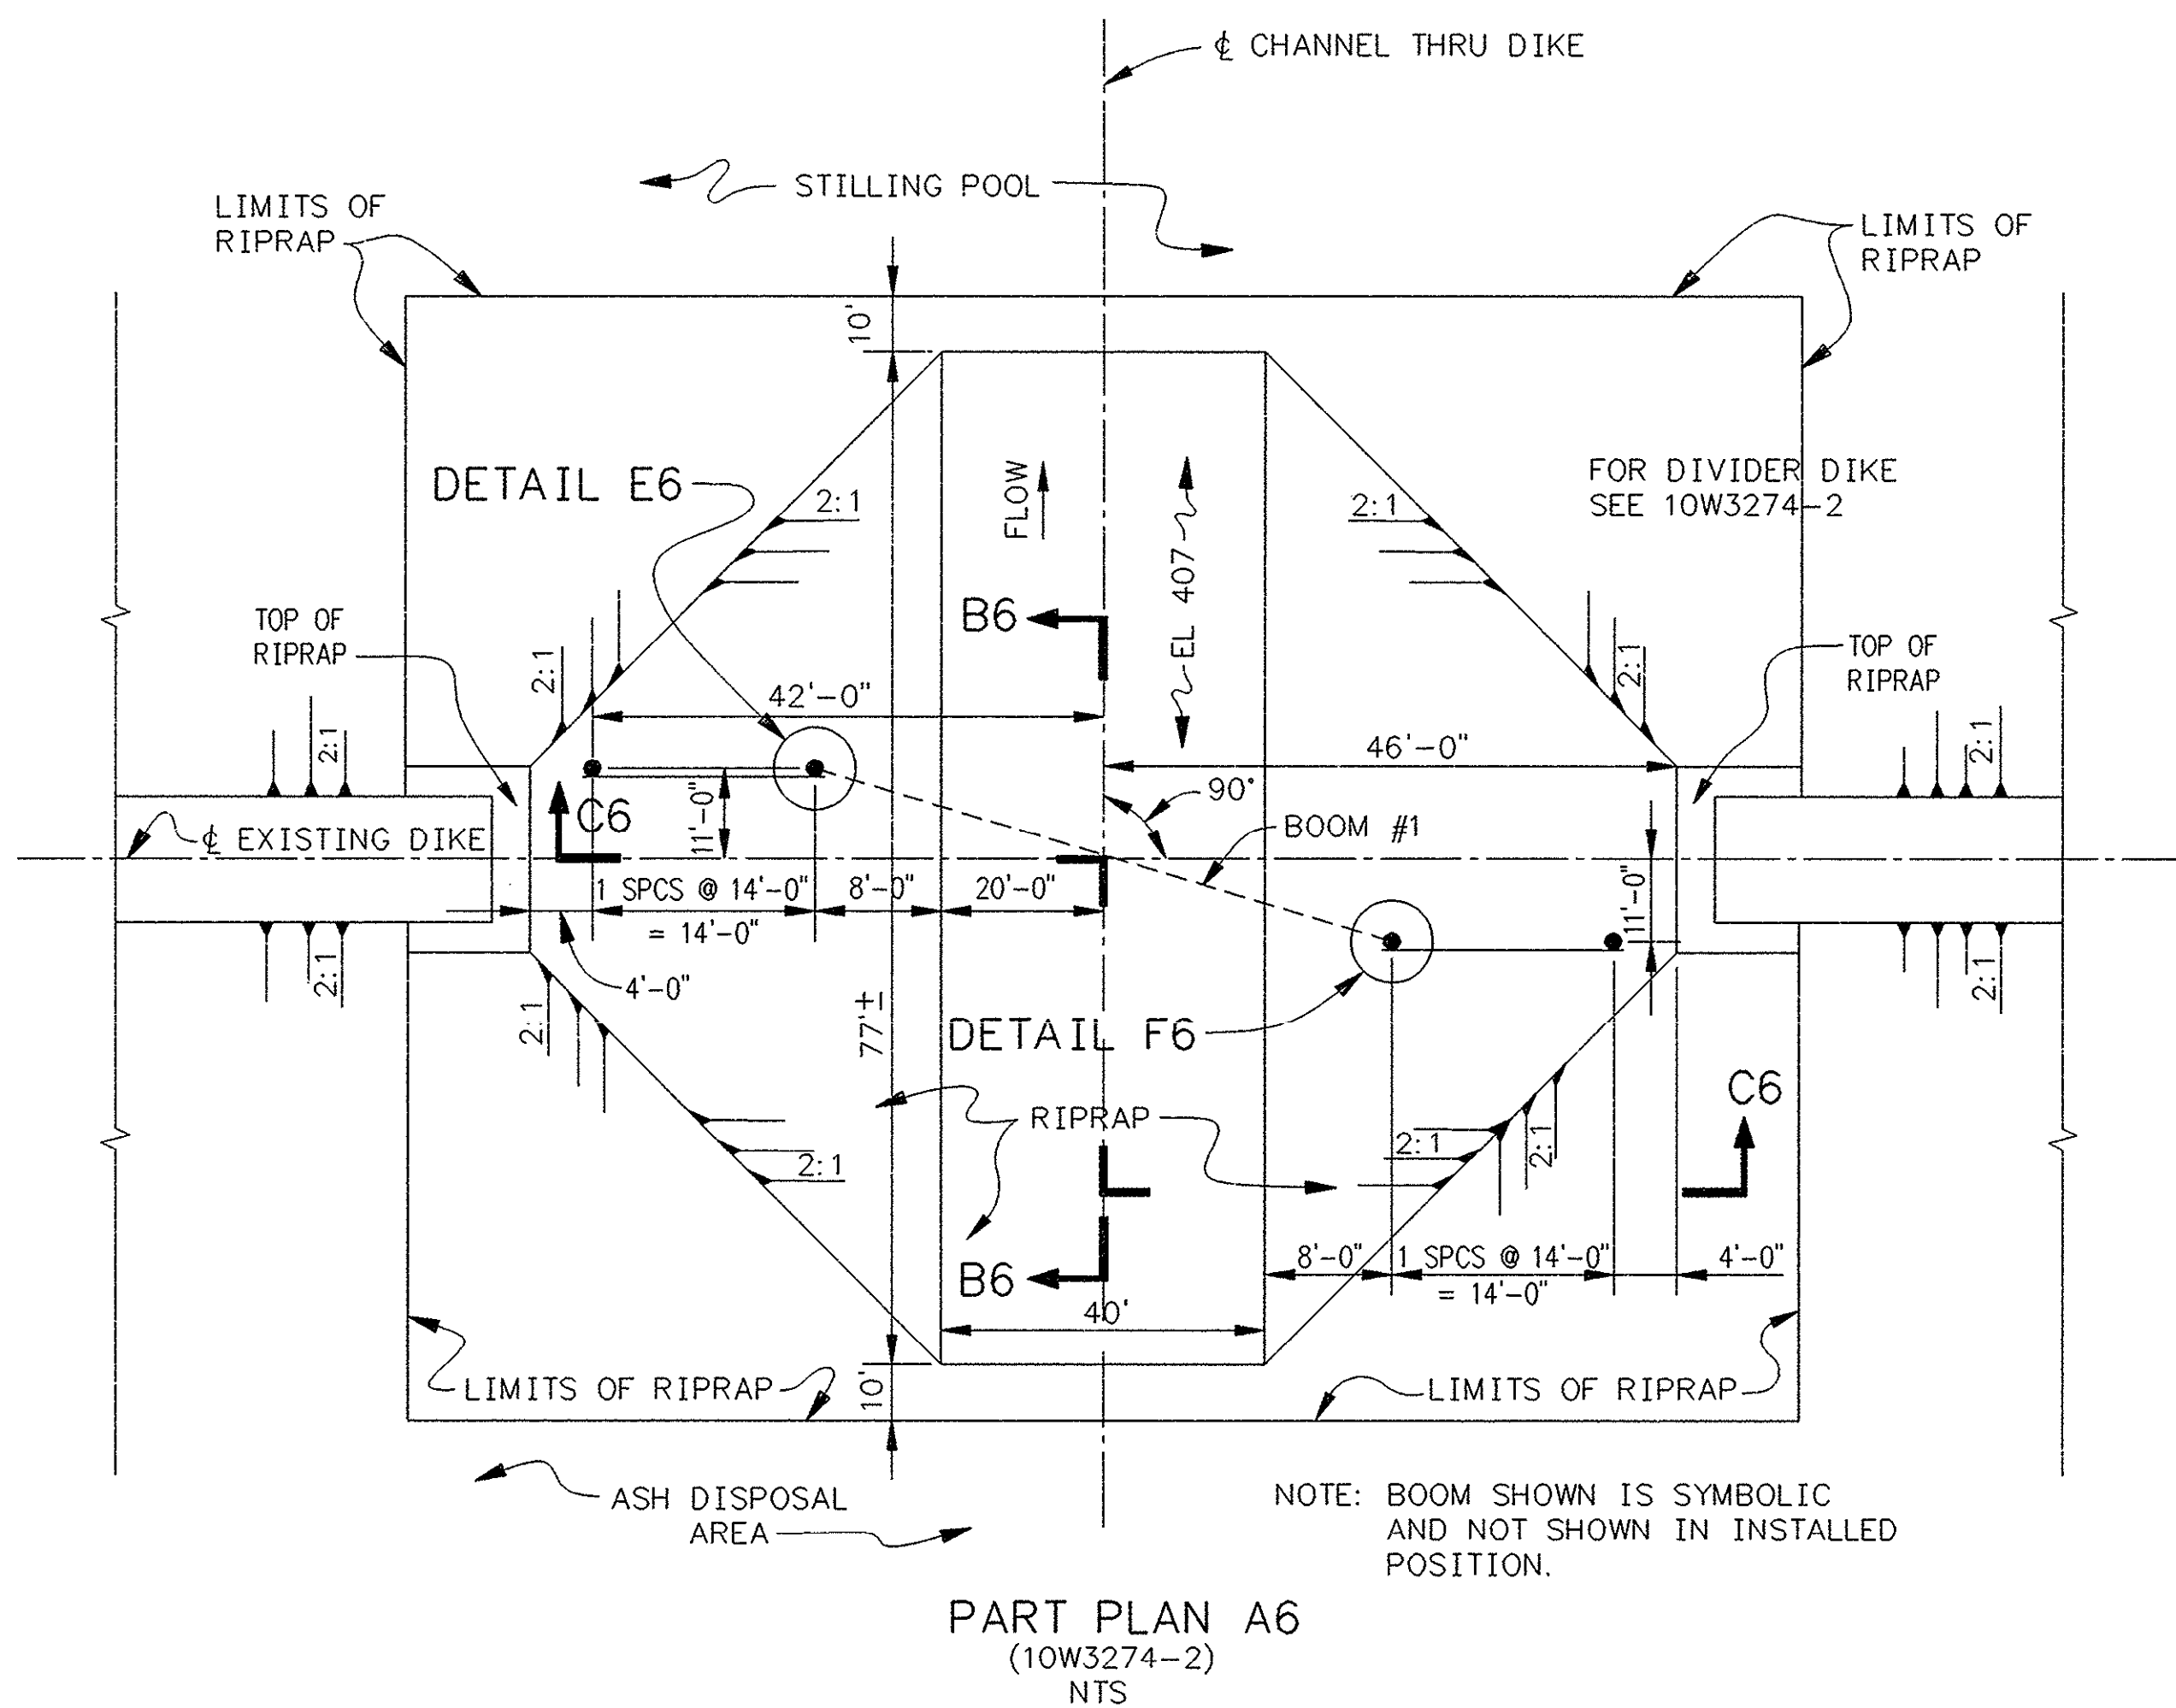


PART PLAN A6  
(10W3274-2)  
NTS

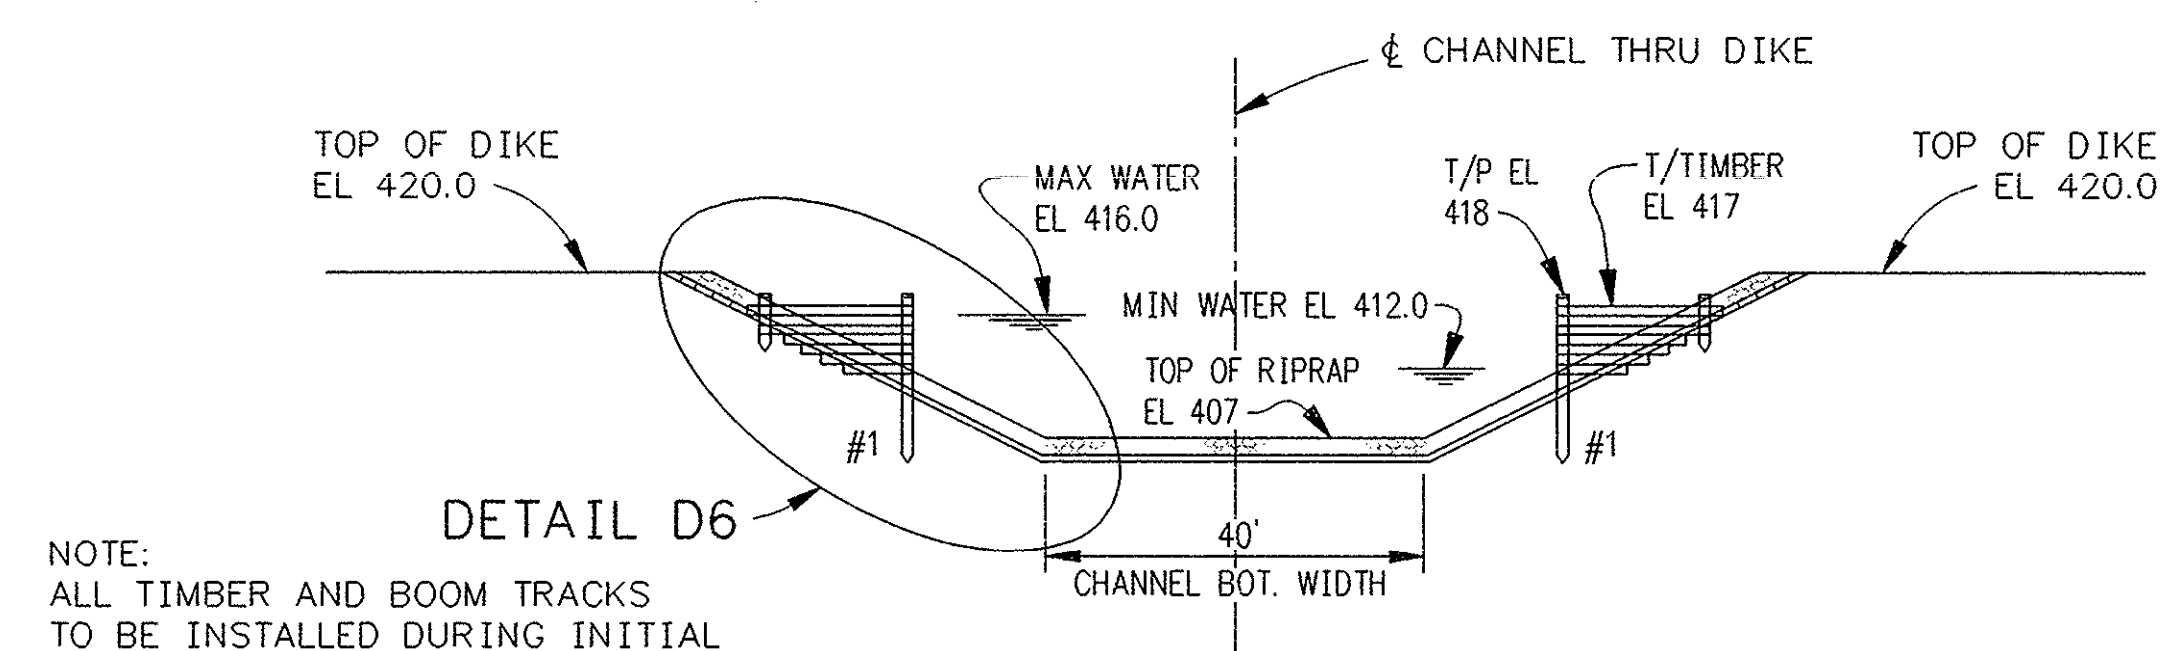


SECTION C6 - C6  
NTS

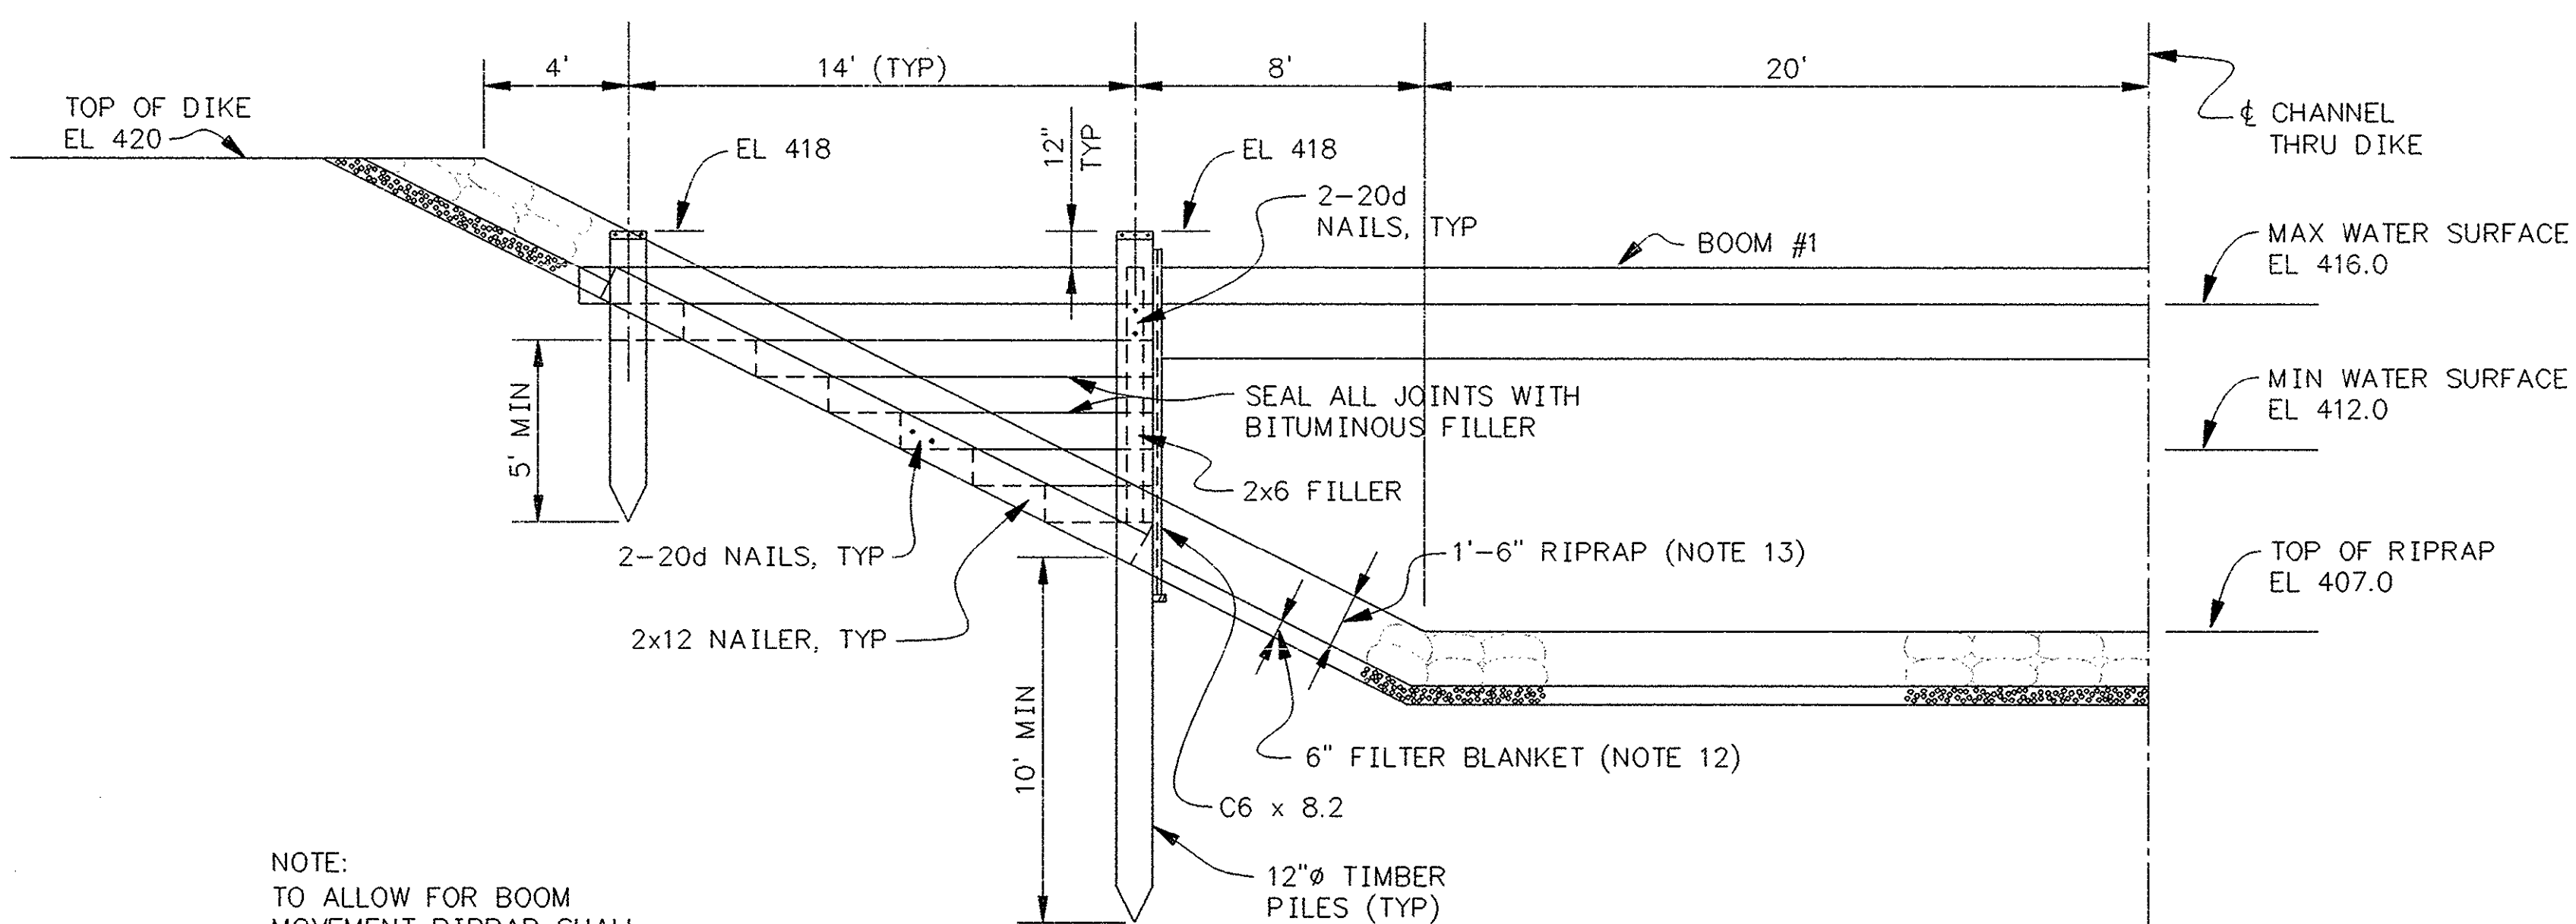


DETAIL D6  
SCALE 1/2" = 1'-0"

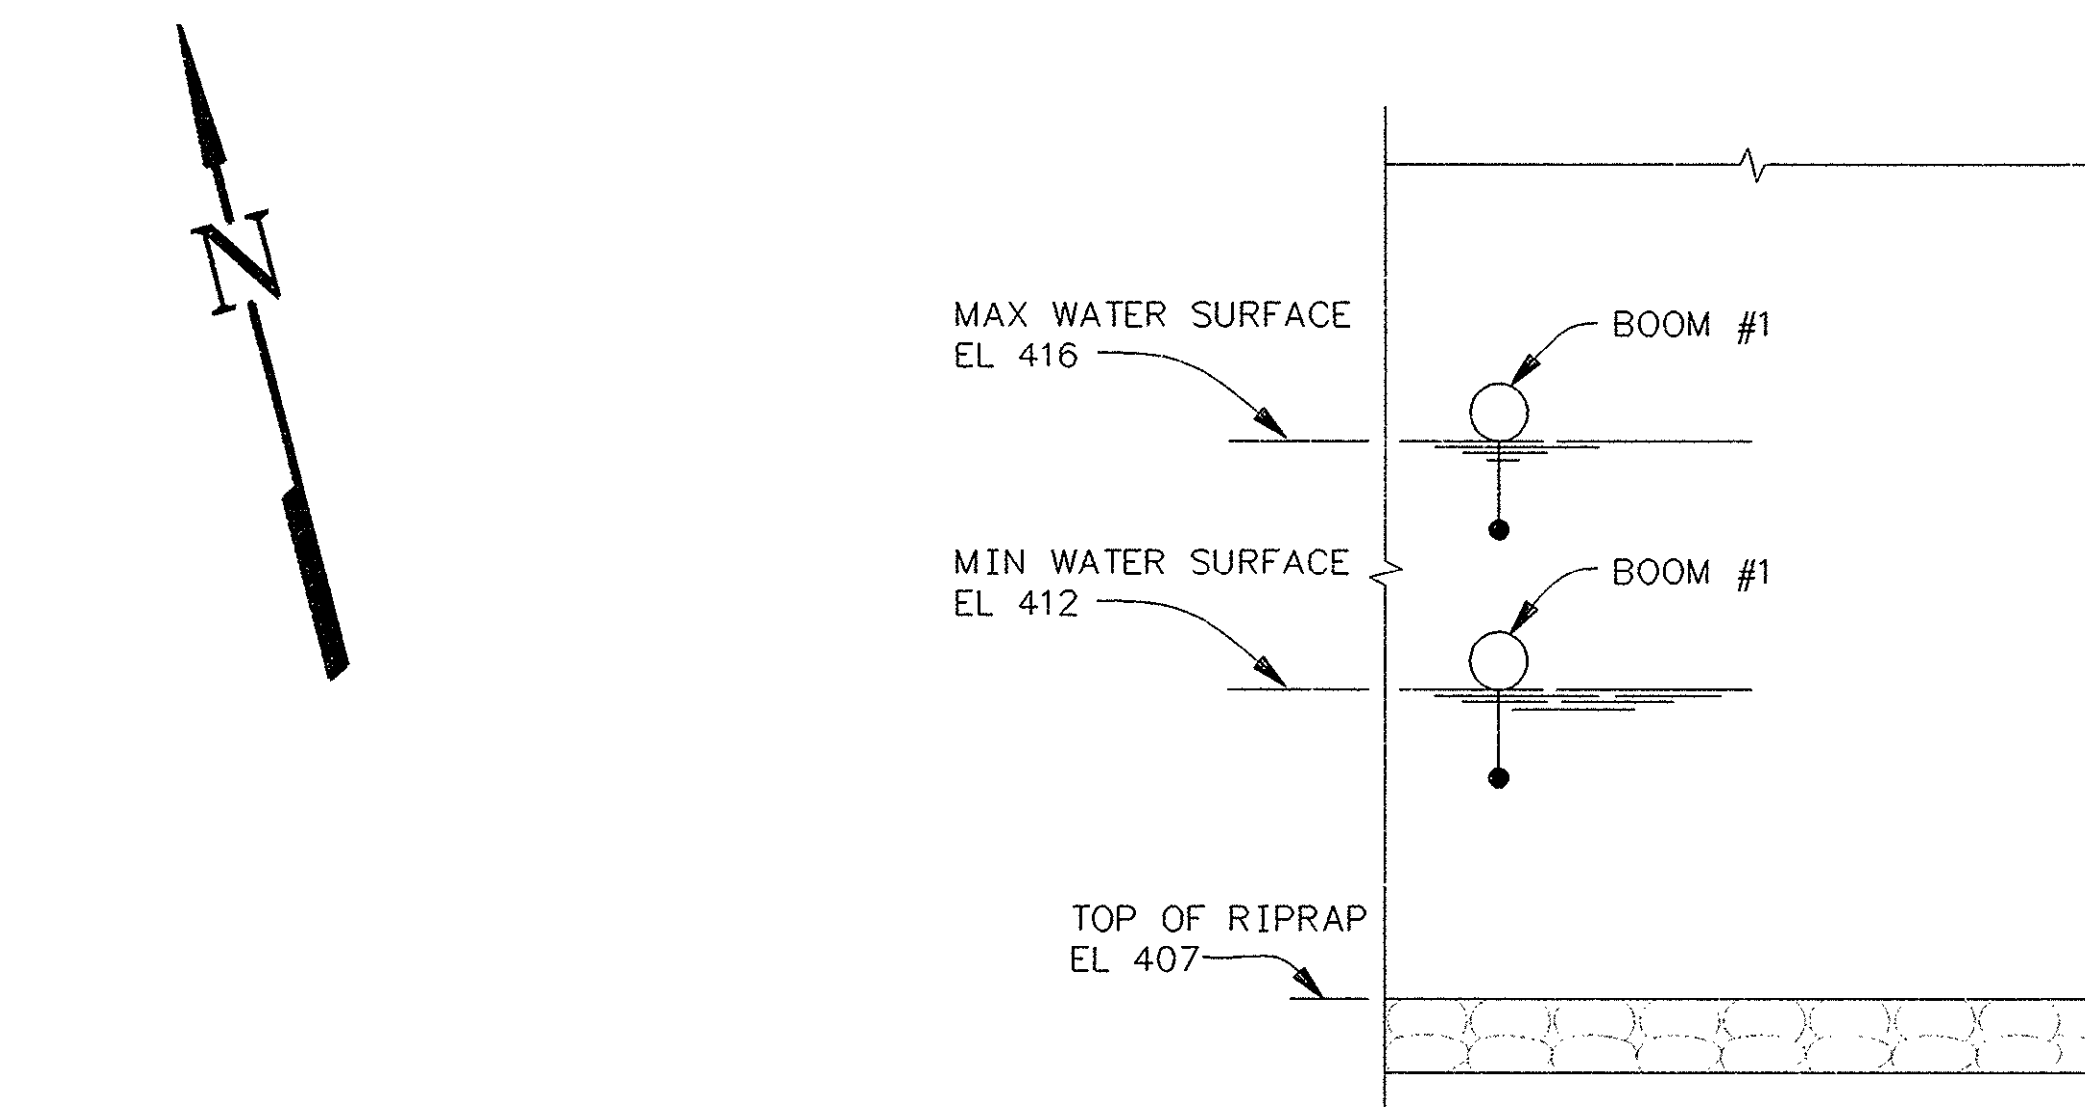


B6 - B6  
NTS

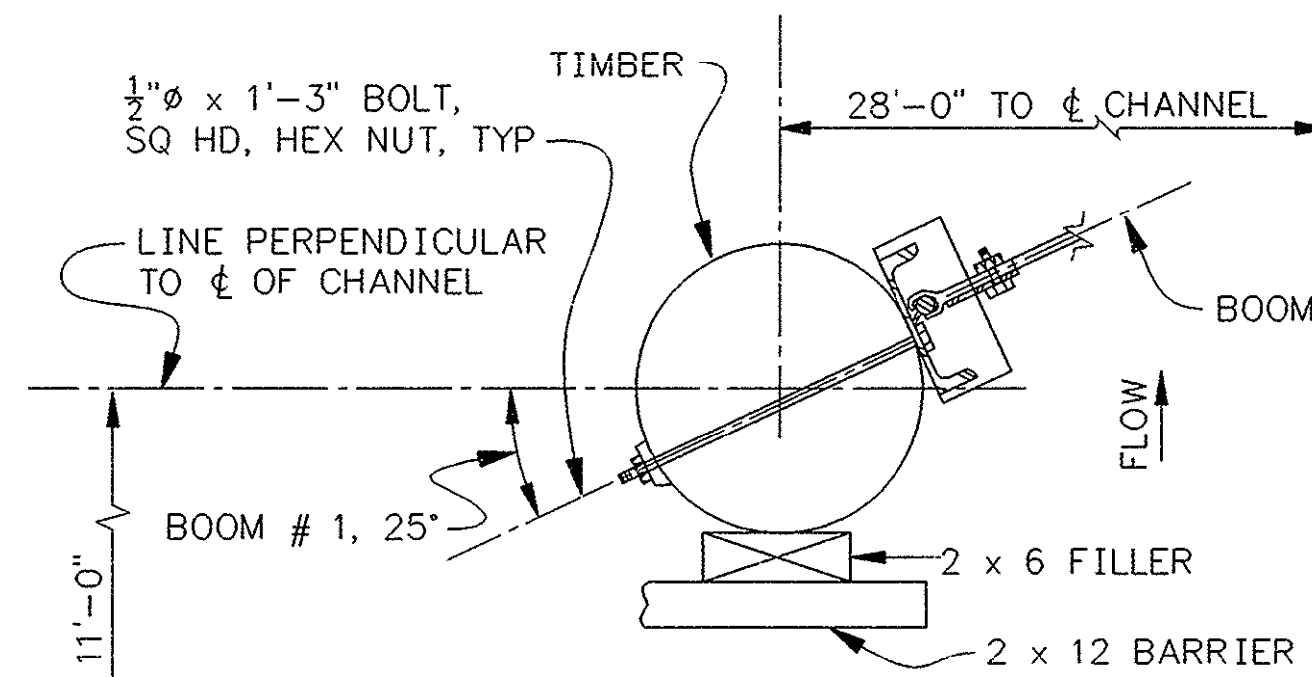


DETAIL E6  
2 REQUIRED  
SCALE 1 1/2" = 1'-0"

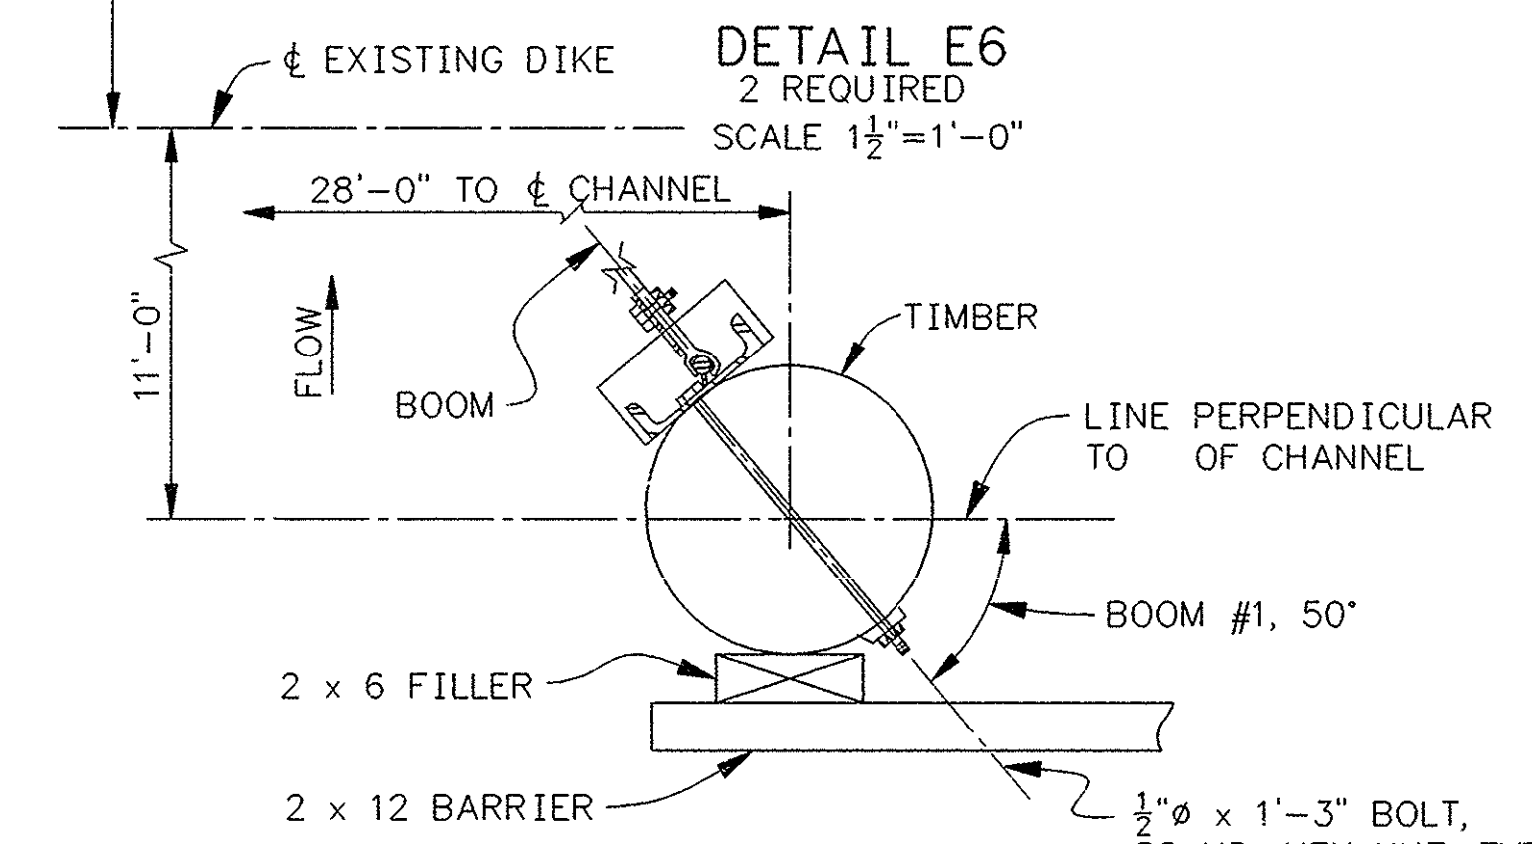

DETAIL F6  
2 REQUIRED  
SCALE 1 1/2" = 1'-0"

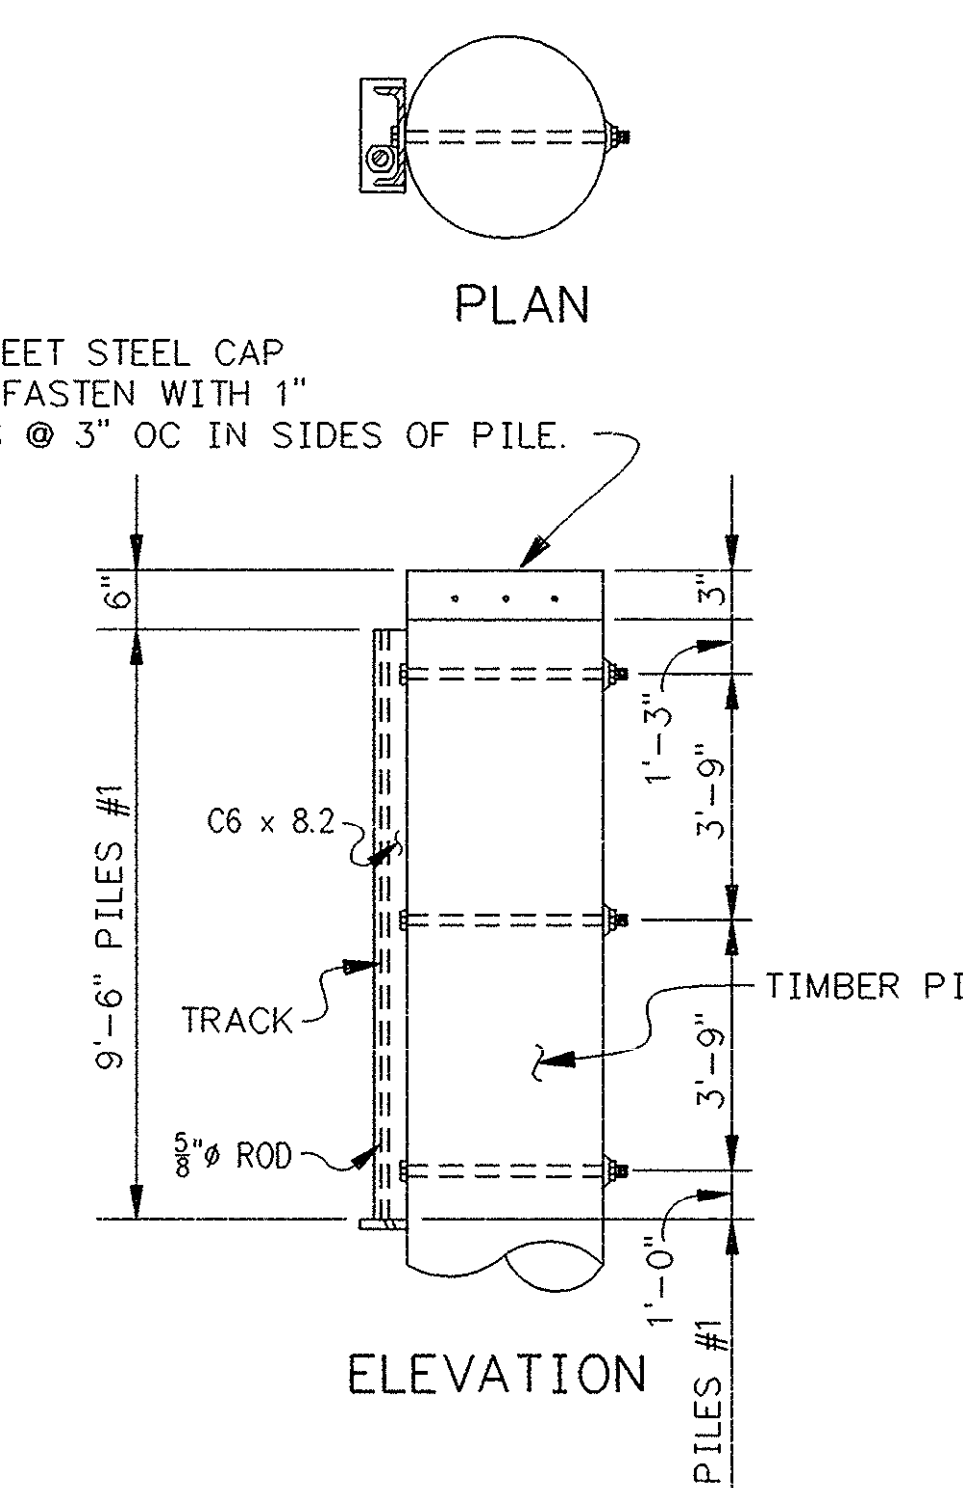


TRACK DETAIL  
2 REQUIRED  
NTS

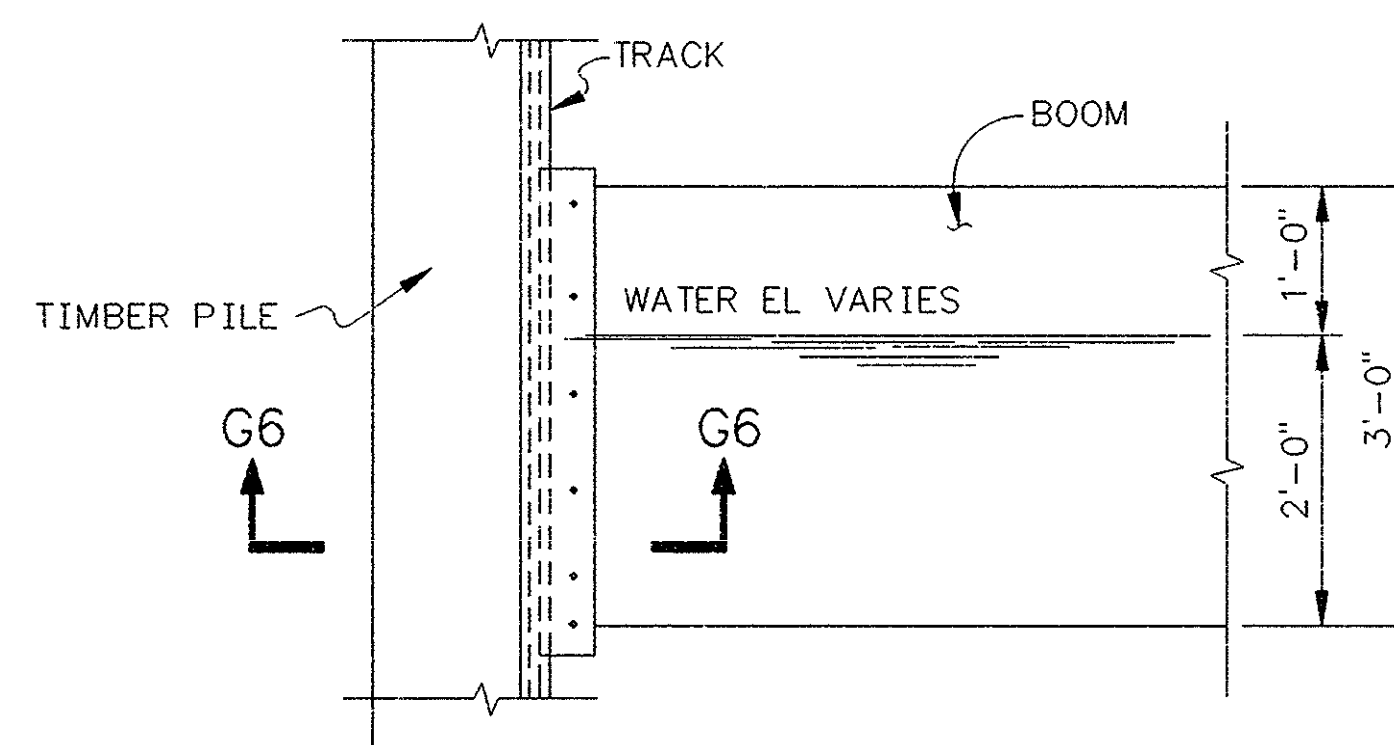

FLOATING BOOM  
(CONNECTION DETAIL - FLOATING BOOM TO TRACK)  
SCALE 3/8" = 1'-0"

FLOATING BOOM			
ITEM	NO	TOTAL LENGTH	REMARKS
BOOM #1	1	70'-0"	

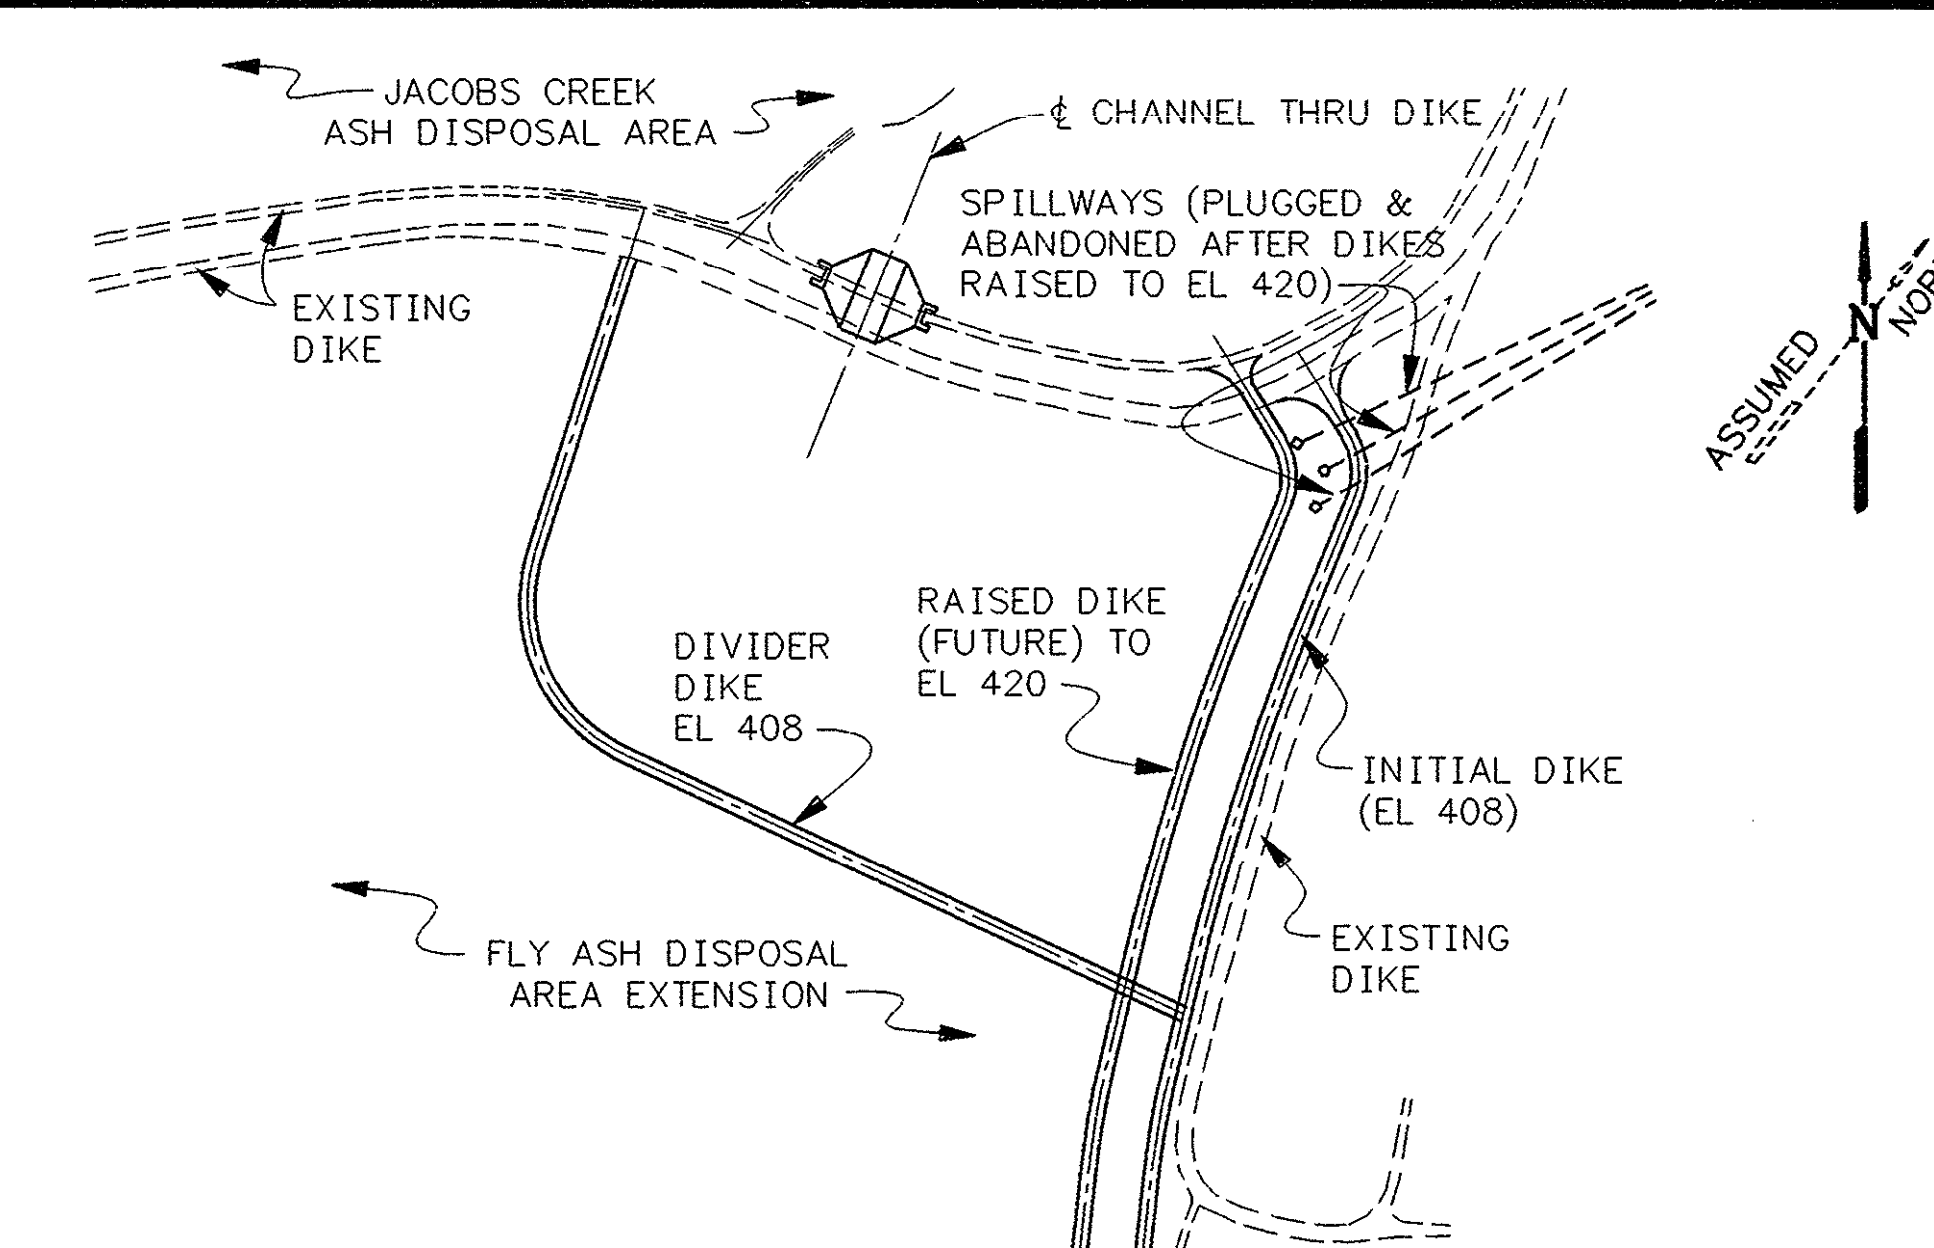

LOCATION PLAN  
SCALE 1" = 200'

BILL OF FIELD MATERIALS REQUIRED				
ITEM	SIZE	NO	LENGTH	QUANTITY
TIMBER (NAILER)	2 x 12 ROUGH	2	16'-0"	32 LF
BARRIER	2 x 12 ROUGH	10	16'-0"	160 LF
FILLER	2 x 6 ROUGH	2	8'-0"	16 LF
PILING (CLASS B CREOSOTED)				
	12" Ø	2	20'-0"	40
	12" Ø	2	8'-0"	16 LF
HARDWARE				
BOLTS - CHANNEL TO PILE	1/2" SQ HD, HEX NUT	6	1'-3"	EACH
OGEE WASHERS	FOR 1/2" Ø BOLTS	6		EACH
ROOFING NAILS			0'-1"	2 LBS
NAILS	20 D COMMON			4 LBS
STEEL				
C6 x 8.2		2	9'-6"	156 LBS
PL	3 x 1/2 x 0'-7"	2		6 LBS
PL	1 1/2 x 3/8 x 9'-6"	2		16 LBS
3/8" Ø ROD		2	9'-6"	14 LBS
GALV SHEET STEEL				
	20 GAGE			25 LBS

- NOTES:
- MATERIALS: ALL MATERIALS TO BE FURNISHED AND FABRICATED BY TVA'S CONSTRUCTION PARTNER.
  - BOLTS TO BE ASTM A307.
  - ALL METAL PARTS TO BE ASTM A36 AND GALVANIZED.
  - TIMBER TO BE QUARTER LOG TOTALY TREATED ROUGH SAWN PINE.
  - FOR FIELD WELDING SEE TVA SPEC G29C.
  - ALL WELDS SHALL BE MADE WITH AWS A5.1 E70 SERIES ELECTRODES OR EQUIVALENT ELECTRODES FOR OTHER PROCESSES.
  - ALL WELDS SHALL BE VISUALLY INSPECTED IN ACCORDANCE WITH THE LATEST STRUCTURAL WELDING CODE D1.1.
  - FOR GENERAL NOTES SEE 10W3274-1.

REV	DATE	ISSN	BY	CHKD	APPD	ISSD	PROJECT	AS COST	REV
R 1	2-12-97	V.L.G.	M.G.P.	J.L.G.	K.W.B.	R.G.J.	423F		E
R 0	1-4-96	CLM	MGH	JDP	J.L.G.	K.W.B.	RGJ	WDH	D

SCALE: 1"=20'

YARD

JACOBS CREEK ASH DISPOSAL AREA EXTENSION

FLOATING BOOM - DIKE EL TO 420

DESIGNED BY: C.L.MOUNT    DRAWN BY: M.G.HRANEK    CHECKED BY: J.D.PARIS    SUPERVISED BY: J.L.GLOVER    REVIEWED BY: K.W.BURNETT    APPROVED BY: R.G.JOHNSON    ISSUED BY: W.E.HALL

PARADISE STEAM PLANT  
TENNESSEE VALLEY AUTHORITY  
FOSSIL AND HYDRO ENGINEERING

AUTOCAD R12    DATE: 1-4-96    64    C    10W3274-6    R 1


PLOT FACTOR: 1:1  
W\_TVA  
C.A.D. DRAWING  
DO NOT ALTER MANUALLY  
FILENAME: PF32746.DWG

TASK COMPLETED BY:    REV NO.

## Appendix B

### Boring Layout and Typed Logs of Boring



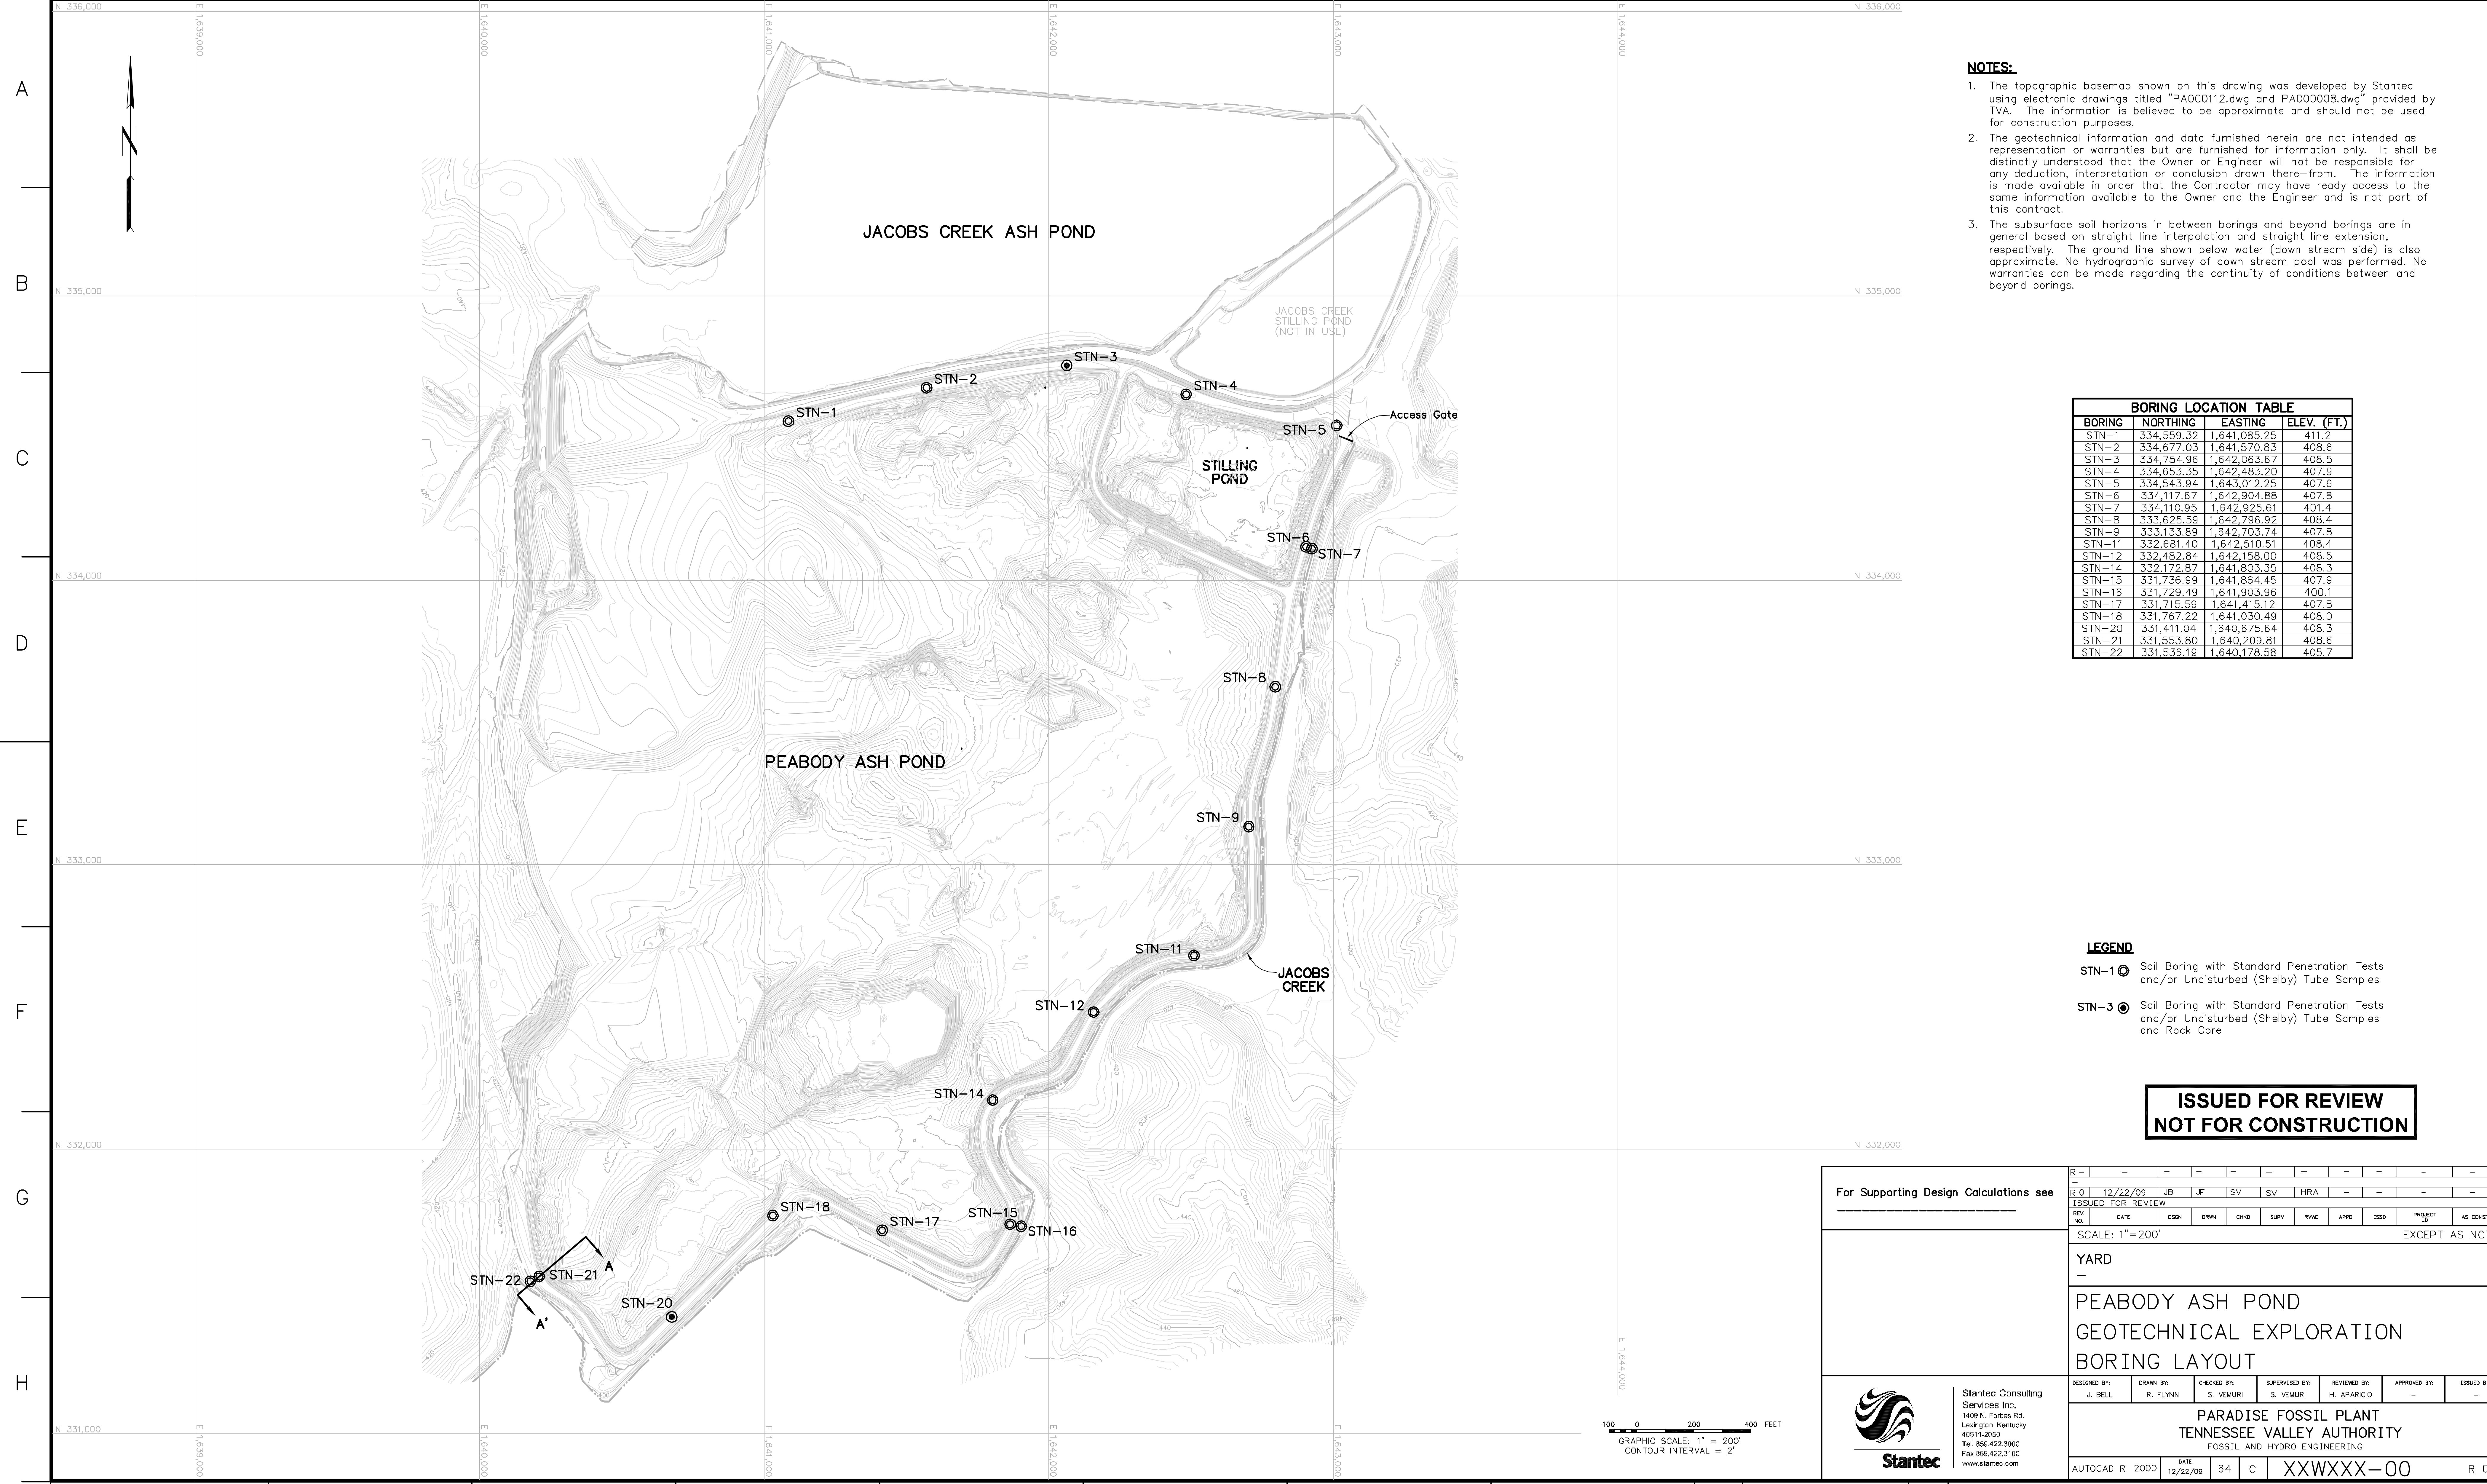

- NOTES:**
1. The topographic basemap shown on this drawing was developed by Stantec using electronic drawings titled "PA000112.dwg and PA000008.dwg" provided by TVA. The information is believed to be approximate and should not be used for construction purposes.
  2. The geotechnical information and data furnished herein are not intended as representation or warranties but are furnished for information only. It shall be distinctly understood that the Owner or Engineer will not be responsible for any deduction, interpretation or conclusion drawn therefrom. The information is made available in order that the Contractor may have ready access to the same information available to the Owner and the Engineer and is not part of this contract.
  3. The subsurface soil horizons in between borings and beyond borings are in general based on straight line interpolation and straight line extension, respectively. The ground line shown below water (down stream side) is also approximate. No hydrographic survey of down stream pool was performed. No warranties can be made regarding the continuity of conditions between and beyond borings.

BORING LOCATION TABLE			
BORING	NORTHING	EASTING	ELEV. (FT.)
STN-1	334,559.32	1,641,085.25	411.2
STN-2	334,677.03	1,641,570.83	408.6
STN-3	334,754.96	1,642,063.67	408.5
STN-4	334,653.35	1,642,483.20	407.9
STN-5	334,543.94	1,643,012.25	407.9
STN-6	334,117.87	1,642,904.88	407.8
STN-7	334,110.95	1,642,925.61	401.4
STN-8	333,625.59	1,642,796.92	408.4
STN-9	333,133.89	1,642,703.74	407.8
STN-11	332,681.40	1,642,510.51	408.4
STN-12	332,482.84	1,642,158.00	408.5
STN-14	332,172.87	1,641,803.35	408.3
STN-15	331,736.99	1,641,864.45	407.9
STN-16	331,729.49	1,641,903.96	400.1
STN-17	331,715.59	1,641,415.12	407.8
STN-18	331,767.22	1,641,030.49	408.0
STN-20	331,411.04	1,640,575.64	408.3
STN-21	331,553.80	1,640,209.81	408.6
STN-22	331,536.19	1,640,178.58	405.7


- LEGEND**
- STN-1 ● Soil Boring with Standard Penetration Tests and/or Undisturbed (Shelby) Tube Samples
  - STN-3 ● Soil Boring with Standard Penetration Tests and/or Undisturbed (Shelby) Tube Samples and Rock Core

**ISSUED FOR REVIEW  
NOT FOR CONSTRUCTION**

For Supporting Design Calculations see		R - - - - -																		
ISSUED FOR REVIEW		R	0	12/22/09	JB	JF	SV	SV	HRA	-	-	-	-	-	-	-	-	-	-	-
SCALE: 1" = 200'		EXCEPT AS NOTED																		
YARD																				
PEABODY ASH POND GEOTECHNICAL EXPLORATION BORING LAYOUT																				
DESIGNED BY:	DRAWN BY:	CHECKED BY:	SUPERVISED BY:	REVIEWED BY:	APPROVED BY:	ISSUED BY:														
J. BELL	R. FLYNN	S. VEMURI	S. VEMURI	H. APARICIO	-	-														
PARADISE FOSSIL PLANT TENNESSEE VALLEY AUTHORITY FOSSIL AND HYDRO ENGINEERING																				
AUTOCAD R 2000	DATE	12/22/09	64	C	XXWXXX-00	R 0														



Stantec Consulting Services Inc.  
1409 N. Forbes Rd.  
Lexington, Kentucky 40511-2950  
Tel: 859.422.3000  
Fax: 859.422.3100  
www.stantec.com

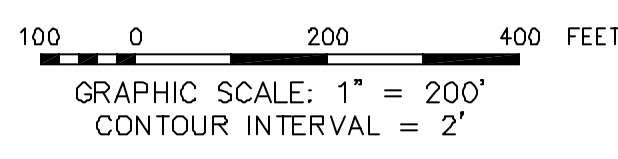

Project Number		175569069			Location		Paradise Fossil Plant			
Project Name		TVA - PAF Peabody Ash Pond			Boring No.		<b>STN-1</b>	Total Depth		46.5 ft
County		Muhlenberg			Surface Elevation		411.2 ft			
Project Type		Geotechnical Exploration			Date Started		8/24/09	Completed		8/24/09
Supervisor		R. Riker      Driller J. Felts			Depth to Water		14.4 ft	Date/Time		8/24/09
Logged By		B. Bline			Depth to Water		N/A	Date/Time		N/A
Lithology		Description	Overburden	Sample #	Depth	Rec. Ft.	Blows	Mois.Cont. %	Remarks	
Elevation	Depth		Rock Core	RQD	Run	Rec. Ft.	Rec. %	Run Depth		
411.2	0.0	Top of Hole								
402.5	8.7	<b>Soil 1: MINESPOIL:</b> Lean clay with intermediate sand lenses, brown to gray with some reddish mottling, moist to wet, soft to very stiff and with heterogeneous mixture of coal, shale, and chert fragments		SPT-1	0.0 - 1.5	0.7	7-7-7	11		
				SPT-2	1.5 - 3.0	1.3	4-5-7	--		
				ST-1	3.0 - 5.0	1.6		--		
				SPT-3	6.0 - 7.5	1.0	5-2-3	22		
				SPT-4	7.5 - 9.0	0.3	2-1-2	--		
				ST-2	9.0 - 11.0	1.5		--		
				SPT-5	12.0 - 13.5	1.1	0-0-0	30		
				SPT-6	13.5 - 15.0	0.2	1-1-2	--	Some coal fragments	
				SPT-7	15.0 - 16.5	0.1	1-2-2	23		
				SPT-8	17.5 - 19.0	1.3	2-2-3	--		
	SPT-9	20.0 - 21.5	0.8	0-0-2	29					
	SPT-10	22.5 - 24.0	1.2	0-0-2	--					

STANTEC\FMSM\_LEGACY\_175569069.GPJ FMSM\_GRAPHIC.LOG.GDT 12/17/09

Lithology		Description	Overburden	Sample #	Depth	Rec. Ft.	Blows	Mois.Cont. %	Remarks
Elevation	Depth		Rock Core	RQD	Run	Rec. Ft.	Rec. %	Run Depth	
		<b>Soil 2: MINESPOIL:</b> Lean clay with sand, olive gray to grayish brown with intermittent orange mottling, moist to wet, stiff to very stiff and with heterogeneous mixture of coal, shale, and chert fragments <i>(Continued)</i>		SPT-11	25.6 - 26.5	0.8	0-0-2	19	Higher percentage of coal fragments with depth
				SPT-12	27.5 - 29.0	1.1	0-1-2	--	
				SPT-13	30.0 - 31.5	0.9	1-1-2	25	
				SPT-14	32.5 - 34.0	1.1	0-6-4	--	
				SPT-15	35.0 - 36.5	1.5	2-3-5	20	
				SPT-16	37.5 - 39.0	1.4	2-3-4	--	
				SPT-17	40.0 - 41.5	1.4	2-2-3	22	
				SPT-18	42.5 - 44.0	1.5	3-3-4	--	
				SPT-19	45.0 - 46.5	1.5	0-0-3	21	
364.7	46.5	No Refusal / Bottom of Hole							

STANTEC\FMSM\_LEGACY\_175569069.GPJ FMSM\_GRAPHIC.LOG.GDT 12/17/09

Project Number		175569069			Location		Paradise Fossil Plant		
Project Name		TVA - PAF Peabody Ash Pond			Boring No.		<b>STN-2</b>	Total Depth 41.5 ft	
County		Muhlenberg			Surface Elevation		408.6 ft		
Project Type		Geotechnical Exploration			Date Started		8/13/09	Completed 8/13/09	
Supervisor		R. Riker	Driller M. Wethington		Depth to Water		27.5 ft	Date/Time 8/13/09	
Logged By		R. Riker			Depth to Water		N/A	Date/Time N/A	

Lithology		Description	Overburden	Sample #	Depth	Rec. Ft.	Blows	Mois.Cont. %	Remarks
Elevation	Depth		Rock Core						
408.6	0.0	Top of Hole							
402.6	6.0	<b>Soil 1: MINESPOIL:</b> Lean clay with intermediate sand lenses, brown to gray with some reddish mottling, moist to wet, soft to very stiff and with heterogeneous mixture of coal, shale, and chert fragments		SPT-1	0.0 - 1.5	0.6	3-4-8	--	
				SPT-2	1.5 - 3.0	0.2	6-7-8	15	
				SPT-3	3.0 - 4.5	0.1	7-6-6	--	
				SPT-4	4.5 - 6.0	0.9	4-3-4	18	
		<b>Soil 2: MINESPOIL:</b> Lean clay with sand, olive gray to grayish brown with intermittent orange mottling, moist to wet, stiff to very stiff and with heterogeneous mixture of coal, shale, and chert fragments	SPT-5	6.0 - 7.5	1.4	8-3-4	--		
			SPT-6	7.5 - 9.0	0.7	1-1-1	34		
			SPT-7	9.0 - 10.5	1.5	5-2-3	--		
			SPT-8	10.5 - 12.0	1.5	6-2-2	37		
			SPT-9	12.0 - 13.5	1.5	1-1-4	--		
			SPT-10	13.5 - 15.0	1.4	1-1-1	34		
			SPT-11	15.0 - 16.5	1.5	3-3-4	--		
			SPT-12	17.5 - 19.0	1.5	2-2-3	24		
			SPT-13	20.0 - 21.5	1.5	1-3-5	--		

STANTEC\FMSM\_LEGACY\_175569069.GPJ FMSM\_GRAPHIC.LOG.GDT 12/17/09

Lithology		Description	Overburden	Sample #	Depth	Rec. Ft.	Blows	Mois.Cont. %	Remarks
Elevation	Depth		Rock Core	RQD	Run	Rec. Ft.	Rec. %	Run Depth	
		<b>Soil 2: MINESPOIL:</b> Lean clay with sand, olive gray to grayish brown with intermittent orange mottling, moist to wet, stiff to very stiff and with heterogeneous mixture of coal, shale, and chert fragments <i>(Continued)</i>		SPT-14	22.5 - 24.0	1.5	6-7-6	27	
				SPT-15	25.0 - 26.5	1.2	4-4-7	--	
				SPT-16	27.5 - 29.0	0.2	6-26-29	11	very gravelly from 28.5' to 30.0'
				SPT-17	30.0 - 31.5	1.0	2-3-5	--	
				SPT-18	32.5 - 34.0	1.1	3-4-6	24	
				SPT-19	35.0 - 36.5	1.0	4-3-7	--	
				SPT-20	37.5 - 39.0	1.5	1-3-6	20	
				SPT-21	40.0 - 41.5	1.1	2-2-3	--	
367.1	41.5	No Refusal / Bottom of Hole							

STANTEC\FMSM\_LEGACY\_175569069.GPJ FMSM-GRAPHIC.LOG.GDT 12/17/09



Project Number	175569069	Location	Paradise Fossil Plant		
Project Name	TVA - PAF Peabody Ash Pond	Boring No.	<b>STN-3</b>	Total Depth	62.0 ft
County	Muhlenberg	Surface Elevation	408.5 ft		
Project Type	Geotechnical Exploration	Date Started	8/12/09	Completed	8/12/09
Supervisor	R. Riker      Driller M. Wethington	Depth to Water	Dry	Date/Time	8/12/09
Logged By	R. Riker	Depth to Water	N/A	Date/Time	N/A

Lithology		Description	Overburden	Sample #	Depth	Rec. Ft.	Blows	Mois.Cont. %	Remarks
Elevation	Depth		Rock Core						
408.5	0.0	Top of Hole							
		<b>Soil 1: MINESPOIL:</b> Lean clay with intermediate sand lenses, brown to gray with some reddish mottling, moist to wet, soft to very stiff and with heterogeneous mixture of coal, shale, and chert fragments		SPT-1	0.0 - 1.5	1.0	3-6-10	13	
			SPT-2	1.5 - 3.0	0.9	6-6-7	--		
			SPT-3	3.0 - 4.5	0.8	7-7-9	14		
			SPT-4	4.5 - 6.0	0.8	3-5-6	--		
			SPT-5	6.0 - 7.5	1.3	4-5-6	15		
			SPT-6	7.5 - 9.0	0.6	2-6-4	--		
			SPT-7	9.0 - 10.5	0.4	12-3-4	--		
			SPT-8	10.5 - 12.0	0.6	4-4-3	12		
			SPT-9	12.0 - 13.5	1.2	2-2-3	14		
			SPT-10	13.5 - 15.0	0.4	9-10-12	--		
			SPT-11	15.0 - 16.5	0.5	4-6-3	16		
391.5	17.0	<b>Soil 2: MINESPOIL:</b> Lean clay with sand, olive gray to grayish brown with intermittent orange mottling, moist to wet, stiff to very stiff and with heterogeneous mixture of coal, shale, and chert fragments		SPT-12	17.5 - 19.0	1.4	1-1-2	--	
			SPT-13	20.0 - 21.5	1.3	2-4-6	20		

STANTEC\FMSM\_LEGACY\_175569069.GPJ FMSM-GRAPHIC.LOG.GDT 12/17/09

Lithology		Description	Overburden	Sample #	Depth	Rec. Ft.	Blows	Mois.Cont. %	Remarks
Elevation	Depth		Rock Core	RQD	Run	Rec. Ft.	Rec. %	Run Depth	
		<b>Soil 2: MINESPOIL:</b> Lean clay with sand, olive gray to grayish brown with intermittent orange mottling, moist to wet, stiff to very stiff and with heterogeneous mixture of coal, shale, and chert fragments <i>(Continued)</i>							
			SPT-14	22.5 - 24.0	1.5	1-1-2	--		Bulk sample from 25' to 27.5'
			SPT-15	25.0 - 26.5	1.3	2-3-3	20		
			SPT-16	27.5 - 29.0	1.5	2-2-4	--		Organic odor with wood chips from 27.3' to 35.0'
			SPT-17	30.0 - 31.5	1.2	2-4-3	24		
			SPT-18	32.5 - 34.0	1.4	2-4-4	--		
			SPT-19	35.0 - 36.5	1.5	2-2-3	24		
			SPT-20	37.5 - 39.0	1.5	1-2-3	--		
			SPT-21	40.0 - 41.5	1.5	2-8-7	26		
			SPT-22	42.5 - 44.0	1.5	1-1-3	--		
		SPT-23	45.0 - 46.5	1.1	5-5-6	23			

STANTEC\FMSM\_LEGACY\_175569069.GPJ FMSM-GRAPHIC.LOG.GDT 12/17/09

Lithology		Description	Overburden	Sample #	Depth	Rec. Ft.	Blows	Mois.Cont. %	Remarks
Elevation	Depth		Rock Core	RQD	Run	Rec. Ft.	Rec. %	Run Depth	
353.5	55.0	<b>Soil 2: MINESPOIL:</b> Lean clay with sand, olive gray to grayish brown with intermittent orange mottling, moist to wet, stiff to very stiff and with heterogeneous mixture of coal, shale, and chert fragments <i>(Continued)</i>							
		Shale, light gray, moderately hard, weathered		SPT-24	55.0 - 56.5	1.1	17-47-47	--	Began Core
346.5	62.0					5.5	5.2	95	62.0
Bottom of Hole  Top of Rock = 55.0 Elevation (353.5)									

STANTEC\FMSM\_LEGACY\_175569069.GPJ FMSM-GRAPHIC.LOG.GDT 12/17/09

Project Number		175569069			Location		Paradise Fossil Plant			
Project Name		TVA - PAF Peabody Ash Pond			Boring No.		<b>STN-4</b>	Total Depth		46.5 ft
County		Muhlenberg			Surface Elevation		407.9 ft			
Project Type		Geotechnical Exploration			Date Started		9/2/09	Completed		9/2/09
Supervisor		R. Riker      Driller J. Wethington			Depth to Water		27.0 ft	Date/Time		9/2/09
Logged By		M. Jones			Depth to Water		N/A	Date/Time		N/A
Lithology		Description	Overburden	Sample #	Depth	Rec. Ft.	Blows	Mois.Cont. %	Remarks	
Elevation	Depth		Rock Core	RQD	Run	Rec. Ft.	Rec. %	Run Depth		
407.9	0.0	Top of Hole								
		<b>Soil 1: MINESPOIL:</b> Lean clay with intermediate sand lenses, brown to gray with some reddish mottling, moist to wet, soft to very stiff and with heterogeneous mixture of coal, shale, and chert fragments		SPT-1	0.0 - 1.5	1.3	6-5-10	12	No recovery possible due to coarse ground wedged	
				SPT-2	1.5 - 3.0	1.4	10-14-14	--		
				SPT-3	3.0 - 4.5	1.5	4-8-9	--		
				SPT-4	4.5 - 6.0	0.8	1-1-3	16		
				SPT-5	6.0 - 7.5	1.0	3-5-8	--		
				SPT-6	7.5 - 9.0	0.8	6-7-6	16		
				SPT-7	9.0 - 10.5	0.0	8-7-5	--		
				SPT-8	10.5 - 12.0	0.4	4-3-5	15		
				SPT-9	12.0 - 13.5	0.0	3-7-10	--		
				SPT-10	13.5 - 15.0	0.0	5-7-8	--		
392.9	15.0	<b>Soil 2: MINESPOIL:</b> Lean clay with sand, olive gray to grayish brown with intermittent orange mottling, moist to wet, stiff to very stiff and with heterogeneous mixture of coal, shale, and chert fragments		SPT-11	15.0 - 16.5	1.5	WOT-WOT-3	--	Wood fragments  Organics from 20' to 24'	
				SPT-12	17.5 - 19.0	0.4	2-3-4	23		
				SPT-13	20.0 - 21.5	1.5	2-2-4	--		
				SPT-14	22.5 - 24.0	1.5	WOT-WOT-3	34		
382.9	25.0									

STANTEC\FMSM\_LEGACY\_175569069.GPJ FMSM-GRAPHIC.LOG.GDT 12/17/09

Lithology		Description	Overburden	Sample #	Depth	Rec. Ft.	Blows	Mois.Cont. %	Remarks
Elevation	Depth		Rock Core	RQD	Run	Rec. Ft.	Rec. %	Run Depth	
372.9	35.0	<b>Soil 5:</b> Lean clay, light to dark brown with orange mottling, moist to wet, soft to stiff and with occasional chert fragments		SPT-15	25.0 - 26.5	1.5	WOT-3	--	
				SPT-16	27.5 - 29.0	1.5	WOT-3	32	
				SPT-17	30.0 - 31.5	1.5	4-6-7	--	
				SPT-18	32.5 - 34.0	1.5	4-5-7	27	
361.4	46.5	<b>Soil 6:</b> Silty clay, gray to brownish gray with some orange mottling, moist to wet, very soft to stiff, with some silt and traces of sand and occasional traces of coal and chert fragments		SPT-19	35.0 - 36.5	1.5	4-5-7	--	
				SPT-20	37.5 - 39.0	1.5	2-2-4	30	
				SPT-21	40.0 - 41.5	1.5	3-4-4	--	
				SPT-22	42.5 - 44.0	1.5	WOT-WOT-3	57	
				SPT-23	45.0 - 46.5	1.5	1-WOT-2	--	
No Refusal / Bottom of Hole									

STANTEC\FMSM\_LEGACY\_175569069.GPJ FMSM\_GRAPHIC.LOG.GDT 12/17/09

Project Number		175569069			Location		Paradise Fossil Plant		
Project Name		TVA - PAF Peabody Ash Pond			Boring No.		<b>STN-5</b>	Total Depth 46.5 ft	
County		Muhlenberg			Surface Elevation		407.9 ft		
Project Type		Geotechnical Exploration			Date Started		9/6/09	Completed 9/6/09	
Supervisor		R. Riker Driller J. Wethington			Depth to Water		12.0 ft	Date/Time 9/6/09	
Logged By		M. Jones			Depth to Water		N/A	Date/Time N/A	
Lithology		Description	Overburden	Sample #	Depth	Rec. Ft.	Blows	Mois.Cont. %	Remarks
Elevation	Depth		Rock Core	RQD	Run	Rec. Ft.	Rec. %	Run Depth	
407.9	0.0	Top of Hole							
		<b>Soil 1: MINESPOIL:</b> Lean clay with intermediate sand lenses, brown to gray with some reddish mottling, moist to wet, soft to very stiff and with heterogeneous mixture of coal, shale, and chert fragments		SPT-1	0.0 - 1.5	1.1	7-4-5	17	
				SPT-2	1.5 - 3.0	0.8	6-6-8	--	
				SPT-3	3.0 - 4.5	0.9	2-4-4	20	
				SPT-4	4.5 - 6.0	1.5	1-1-3	--	
				SPT-5	6.0 - 7.5	1.5	2-3-4	15	
				SPT-6	7.5 - 9.0	0.5	1-2-3	--	
				SPT-7	9.0 - 10.5	0.8	2-4-7	--	
397.4	10.5	<b>Soil 2: MINESPOIL:</b> Lean clay with sand, olive gray to grayish brown with intermittent orange mottling, moist to wet, stiff to very stiff and with heterogeneous mixture of coal, shale, and chert fragments		SPT-8	10.5 - 12.0	0.7	3-3-4	15	
				SPT-9	12.0 - 13.5	0.8	3-5-7	15	
				SPT-10	13.5 - 15.0	1.2	3-3-5	--	
392.4	15.5	<b>Soil 3:</b> Bottom ash with sand, black to dark brown, wet, loose to very loose and with fine to gravel sized coal fragments		SPT-11	15.0 - 16.5	1.3	WOT	37	
390.4	17.5			SPT-12	17.5 - 19.0	1.5	1-4-3	--	
		<b>Soil 2: MINESPOIL:</b> Lean clay with sand, olive gray to grayish brown with intermittent orange mottling, moist to wet, stiff to very stiff and with heterogeneous mixture of coal, shale, and chert fragments		SPT-13	20.0 - 21.5	1.3	2-5-4	20	
				SPT-14	22.5 - 24.0	0.5	5-7-11	--	
382.9	25.0								

STANTEC/FMSM\_LEGACY\_175569069.GPJ FMSM\_GRAPHIC.LOG.GDT 12/17/09

Lithology		Description	Overburden	Sample #	Depth	Rec. Ft.	Blows	Mois.Cont. %	Remarks
Elevation	Depth		Rock Core	RQD	Run	Rec. Ft.	Rec. %	Run Depth	
370.9	37.0	<b>Soil 5:</b> Lean clay, light to dark brown with orange mottling, moist to wet, soft to stiff and with occasional chert fragments		SPT-15	25.0 - 26.5	1.5	5-7-9	26	
				SPT-16	27.5 - 29.0	1.5	WOT-WOT-2	--	
				SPT-17	30.0 - 31.5	1.5	2-3-6	25	
				SPT-18	32.5 - 34.0	1.5	2-5-7	--	
				SPT-19	35.0 - 36.5	1.5	3-4-4	28	
361.4	46.5	<b>Soil 6:</b> Silty clay, gray to brownish gray with some orange mottling, moist to wet, very soft to stiff, with some silt and traces of sand and occasional traces of coal and chert fragments		SPT-20	37.5 - 39.0	1.5	3-4-4	--	
				SPT-21	40.0 - 41.5	0.0	1-2-3	--	
				SPT-22	42.5 - 44.0	1.5	1-2-3	--	
No Refusal / Bottom of Hole									

STANTEC\FMSM\_LEGACY\_175569069.GPJ FMSM-GRAPHIC.LOG.GDT 12/17/09

Project Number	175569069	Location	Paradise Fossil Plant		
Project Name	TVA - PAF Peabody Ash Pond	Boring No.	<b>STN-6</b>	Total Depth	35.4 ft
County	Muhlenberg	Surface Elevation	407.8 ft		
Project Type	Geotechnical Exploration	Date Started	8/27/09	Completed	8/27/09
Supervisor	R. Riker      Driller J. Felts	Depth to Water	11.0 ft	Date/Time	8/27/09
Logged By	B. Bline	Depth to Water	N/A	Date/Time	N/A

Lithology		Description	Overburden	Sample #	Depth	Rec. Ft.	Blows	Mois.Cont. %	Remarks
Elevation	Depth		Rock Core						
407.8	0.0	Top of Hole							
398.3	9.5	<b>Soil 1: MINESPOIL:</b> Lean clay with intermediate sand lenses, brown to gray with some reddish mottling, moist to wet, soft to very stiff and with heterogeneous mixture of coal, shale, and chert fragments		SPT-1	0.0 - 1.5	0.7	11-9-8	--	Tube deformed throw away, advanced 1.1'
				SPT-2	1.5 - 3.0	1.1	6-5-4	12	
				SPT-3	3.0 - 4.5	0.6	3-3-3	--	
				ST-1	4.5 - 6.5			--	
				ST-2	6.5 - 8.5	1.3		--	
				SPT-4	8.0 - 9.5	0.4	23-10-10	13	
				SPT-5	9.5 - 11.0	1.2	3-3-3	--	
				ST-3	11.0 - 13.0	2.0		--	
				SPT-6	13.5 - 15.0	1.5	0-0-0	21	
391.3	16.5	<b>Soil 4:</b> Clayey sand, brown to grayish brown, moist to wet and loose to medium dense		SPT-7	15.0 - 16.5	0.7	0-0-1	--	
				SPT-8	17.5 - 19.0	0.7	0-0-2	21	
				SPT-9	20.0 - 21.5	1.1	0-1-3	--	
385.8	22.0	<b>Soil 5:</b> Lean clay, light to dark brown with orange mottling, moist to wet, soft to stiff and with occasional chert fragments							

STANTEC\FMSM\_LEGACY\_175569069.GPJ FMSM\_GRAPHIC.LOG.GDT 12/17/09



Lithology		Description	Overburden	Sample #	Depth	Rec. Ft.	Blows	Mois.Cont. %	Remarks
Elevation	Depth		Rock Core	RQD	Run	Rec. Ft.	Rec. %	Run Depth	
		<b>Soil 6:</b> Silty clay, gray to brownish gray with some orange mottling, moist to wet, very soft to stiff, with some silt and traces of sand and occasional traces of coal and chert fragments <i>(Continued)</i>		SPT-10	22.5 - 24.0	0.9	0-0-0	28	
				SPT-11	25.0 - 26.5	0.0	0-0-0	--	
				SPT-12	27.5 - 29.0	1.5	0-0-2	26	
377.0	30.8			SPT-13	30.0 - 31.5	1.5	9-10-13	--	
			Bedrock (augered)		SPT-14	32.5 - 34.0	1.4	10-25-50	14
372.4	35.4			SPT-15	35.0 - 35.4		50+	--	
No Refusal / Bottom of Hole  Top of Rock = 30.8 Elevation (377.0)									

STANTEC\FMSM\_LEGACY\_175569069.GPJ FMSM-GRAPHIC.LOG.GDT 12/17/09

Project Number		175569069			Location		Paradise Fossil Plant		
Project Name		TVA - PAF Peabody Ash Pond			Boring No.		<b>STN-7</b>	Total Depth 24.5 ft	
County		Muhlenberg			Surface Elevation		401.4 ft		
Project Type		Geotechnical Exploration			Date Started		8/25/09	Completed 8/25/09	
Supervisor		S. Lange Driller J. Bowerman			Depth to Water		13.0 ft	Date/Time 8/25/09	
Logged By		S. Lange			Depth to Water		N/A	Date/Time N/A	

Lithology		Description	Overburden	Sample #	Depth	Rec. Ft.	Blows	Mois.Cont. %	Remarks		
Elevation	Depth		Rock Core							RQD	Run
401.4	0.0	Top of Hole									
399.9	1.5	<b>Soil 4:</b> Clayey sand, brown to grayish brown, moist to wet and loose to medium dense  <b>Soil 5:</b> Lean clay, light to dark brown with orange mottling, moist to wet, soft to stiff and with occasional chert fragments		SPT-1	0.0 - 1.5	1.0	2-4-5	28			
				SPT-2	1.5 - 3.0	1.0	1-6-11	--			
				SPT-3	3.0 - 4.5	1.0	3-3-4	11			
				ST-1	4.5 - 6.5	1.3	--				
				SPT-4	6.5 - 8.0	1.0	3-3-4	--			
				SPT-5	8.0 - 9.5	1.0	1-2-2	22			
				ST-2	9.5 - 11.5	1.7	--				
				SPT-6	11.5 - 13.0	1.0	WOT	--			
			387.4	14.0		SPT-7	13.0 - 14.5	1.0	1-2-3	16	
					<b>Soil 6:</b> Silty clay, gray to brownish gray with some orange mottling, moist to wet, very soft to stiff, with some silt and traces of sand and occasional traces of coal and chert fragments		SPT-8	15.5 - 17.0	1.5	2-3-5	--
			SPT-9	18.0 - 19.5		1.0	4-5-3	19			
			SPT-10	20.5 - 22.0		1.3	8-12-17	--			

STANTEC\FMSM\_LEGACY\_175569069.GPJ FMSM\_GRAPHIC.LOG.GDT 12/17/09

Project Number <u>175569069</u>	Location <u>Paradise Fossil Plant</u>
Project Name <u>TVA - PAF Peabody Ash Pond</u>	Boring No. <u>STN-7</u> Total Depth <u>24.5 ft</u>

Lithology		Description	Overburden	Sample #	Depth	Rec. Ft.	Blows	Mois.Cont. %	Remarks
Elevation	Depth		Rock Core	RQD	Run	Rec. Ft.	Rec. %	Run Depth	
378.4	23.0								
376.9	24.5	Bedrock (augered)		SPT-11	23.0 - 24.5	1.3	13-28-50+	7	

Auger Refusal /  
Bottom of Hole

STANTEC\FMSM\_LEGACY\_175569069.GPJ FMSM-GRAPHIC.LOG.GDT 12/17/09

Project Number		175569069			Location		Paradise Fossil Plant		
Project Name		TVA - PAF Peabody Ash Pond			Boring No.		<b>STN-8</b>	Total Depth 35.9 ft	
County		Muhlenberg			Surface Elevation		408.4 ft		
Project Type		Geotechnical Exploration			Date Started		8/11/09	Completed 8/11/09	
Supervisor		R. Riker Driller M. Wethington			Depth to Water		12.0 ft	Date/Time 8/11/09	
Logged By		R. Riker			Depth to Water		N/A	Date/Time N/A	
Lithology		Description	Overburden	Sample #	Depth	Rec. Ft.	Blows	Mois.Cont. %	Remarks
Elevation	Depth		Rock Core	RQD	Run	Rec. Ft.	Rec. %	Run Depth	
408.4	0.0	Top of Hole							
		<b>Soil 1: MINESPOIL:</b> Lean clay with intermediate sand lenses, brown to gray with some reddish mottling, moist to wet, soft to very stiff and with heterogeneous mixture of coal, shale, and chert fragments		SPT-1	0.0 - 1.5	0.6	106-6-8	--	
			SPT-2	1.5 - 3.0	0.8	3-5-9	15		
			SPT-3	3.0 - 4.5	1.2	3-3-6	--		
			SPT-4	4.5 - 6.0	0.9	4-4-8	15		Many shale gravels from 4.5' to 6.0'
			SPT-5	6.0 - 7.5	0.9	3-9-12	--		
			SPT-6	7.5 - 9.0	0.2	3-8-4	14		
			SPT-7	9.0 - 10.5	1.5	2-5-9	--		
			SPT-8	10.5 - 12.0	1.0	2-3-5	17		
395.5	12.9		SPT-9	12.0 - 13.5	1.4	4-13-14	--		
		<b>Soil 3:</b> Bottom ash with sand, black to dark brown, wet, loose to very loose and with fine to gravel sized coal fragments		SPT-10	13.5 - 15.0	1.4	6-12-14	16	
391.9	16.5		SPT-11	15.0 - 16.5	0.7	2-2-3	--		
		<b>Soil 4:</b> Clayey sand, brown to grayish brown, moist to wet and loose to medium dense		SPT-12	17.5 - 19.0	0.5	1-1-2	16	
			SPT-13	20.0 - 21.5	1.1	7-2-3	--		

STANTEC\FMSM\_LEGACY\_175569069.GPJ FMSM\_GRAPHIC.LOG.GDT 12/17/09

Lithology		Description	Overburden	Sample #	Depth	Rec. Ft.	Blows	Mois.Cont. %	Remarks
Elevation	Depth		Rock Core	RQD	Run	Rec. Ft.	Rec. %	Run Depth	
385.9	22.5	<b>Soil 5:</b> Lean clay, light to dark brown with orange mottling, moist to wet, soft to stiff and with occasional chert fragments		SPT-14	22.5 - 24.0	1.5	WOT	28	
384.4	24.0				SPT-15	25.0 - 26.5	1.5	WOT	--
		<b>Soil 6:</b> Silty clay, gray to brownish gray with some orange mottling, moist to wet, very soft to stiff, with some silt and traces of sand and occasional traces of coal and chert fragments		SPT-16	27.5 - 29.0	1.3	8-6-16	20	
378.4	30.0				SPT-17	30.0 - 31.5	1.6	29-49-50	--
		Bedrock (augered)		SPT-18	32.5 - 34.0	1.5	16-39-47	10	
372.5	35.9				SPT-19	35.0 - 35.9	0.6	25-50+	--
No Refusal / Bottom of Hole  Top of Rock = 30.0 Elevation (378.4)									

STANTEC\FMSM\_LEGACY\_175569069.GPJ FMSM-GRAPHIC.LOG.GDT 12/17/09

Project Number		175569069			Location		Paradise Fossil Plant		
Project Name		TVA - PAF Peabody Ash Pond			Boring No.		<b>STN-9</b>	Total Depth 34.0 ft	
County		Muhlenberg			Surface Elevation		407.8 ft		
Project Type		Geotechnical Exploration			Date Started		9/1/09	Completed 9/1/09	
Supervisor		R. Riker Driller J. Wethington			Depth to Water		13.0 ft	Date/Time 9/1/09	
Logged By		M. Jones			Depth to Water		N/A	Date/Time N/A	

Lithology		Description	Overburden	Sample #	Depth	Rec. Ft.	Blows	Mois.Cont. %	Remarks
Elevation	Depth		Rock Core						
407.8	0.0	Top of Hole							
		<b>Soil 1: MINESPOIL:</b> Lean clay with intermediate sand lenses, brown to gray with some reddish mottling, moist to wet, soft to very stiff and with heterogeneous mixture of coal, shale, and chert fragments		SPT-1	0.0 - 1.5	0.3	4-5-6	14	
				SPT-2	1.5 - 3.0	0.6	5-5-11	--	
				SPT-3	3.0 - 4.5	1.0	4-7-5	15	
				SPT-4	4.5 - 6.0	0.7	4-5-4	--	
				SPT-5	6.0 - 7.5	1.2	4-7-50/0.4	16	
				SPT-6	7.5 - 9.0			--	Boulders from 7.0' to 9.0'
				SPT-7	9.0 - 10.5	0.2	14-13-10	--	
				SPT-8	10.5 - 12.0	0.9	6-9-9	15	
394.8	13.0			SPT-9	12.0 - 13.5	1.1	6-13-25	16	
		<b>Soil 3:</b> Bottom ash with sand, black to dark brown, wet, loose to very loose and with fine to gravel sized coal fragments		SPT-10	13.5 - 15.0	1.5	21-36-31	--	
				SPT-11	15.0 - 16.5	1.5	5-6-10	16	
				SPT-12	17.5 - 19.0	1.3	1-WOT	--	
387.8	20.0			SPT-13	20.0 - 21.5	1.2	WOT	26	

STANTEC\FMSM\_LEGACY\_175569069.GPJ FMSM\_GRAPHIC.LOG.GDT 12/17/09

Lithology		Description	Overburden	Sample #	Depth	Rec. Ft.	Blows	Mois.Cont. %	Remarks
Elevation	Depth		Rock Core	RQD	Run	Rec. Ft.	Rec. %	Run Depth	
380.8	27.0	<b>Soil 5:</b> Lean clay, light to dark brown with orange mottling, moist to wet, soft to stiff and with occasional chert fragments <i>(Continued)</i>		SPT-14	22.5 - 24.0	1.5	WOT-1	--	
				SPT-15	25.0 - 26.5	1.5	4-6-8	19	
373.8	34.0	Bedrock (augered)		SPT-16	27.5 - 29.0	1.5	7-37-62	--	
				SPT-17	30.0 - 31.5	1.5	14-54-50	13	
				SPT-18	32.5 - 34.0	1.5	17-54-50	--	
		No Refusal / Bottom of Hole  Top of Rock = 27.0 Elevation (380.8)							

STANTEC\FMSM\_LEGACY\_175569069.GPJ FMSM-GRAPHIC.LOG.GDT 12/17/09

Project Number	175569069	Location	Paradise Fossil Plant		
Project Name	TVA - PAF Peabody Ash Pond	Boring No.	<b>STN-11</b>	Total Depth	45.3 ft
County	Muhlenberg	Surface Elevation	408.4 ft		
Project Type	Geotechnical Exploration	Date Started	8/11/09	Completed	8/11/09
Supervisor	R. Riker Driller M. Wethington	Depth to Water	13.5 ft	Date/Time	8/11/09
Logged By	R. Riker	Depth to Water	N/A	Date/Time	N/A

Lithology		Description	Overburden	Sample #	Depth	Rec. Ft.	Blows	Mois.Cont. %	Remarks
Elevation	Depth		Rock Core						
408.4	0.0	Top of Hole							
		<b>Soil 1: MINESPOIL:</b> Lean clay with intermediate sand lenses, brown to gray with some reddish mottling, moist to wet, soft to very stiff and with heterogeneous mixture of coal, shale, and chert fragments		SPT-1	0.0 - 1.5	0.9	6-7-7	--	
				SPT-2	1.5 - 3.0	3.9	7-6-8	13	
				SPT-3	3.0 - 4.5	0.9	10-7-7	--	
				SPT-4	4.5 - 6.0	0.7	4-30-8	12	
				SPT-5	6.0 - 7.5	0.4	3-6-10	--	
				SPT-6	7.5 - 9.0	0.1	6-4-5	11	
				SPT-7	9.0 - 10.5	0.5	3-6-2	--	
				SPT-8	10.5 - 12.0	0.6	4-4-5	17	
				SPT-9	12.0 - 13.5	1.1	7-8-11	--	
394.9	13.5	<b>Soil 3:</b> Bottom ash with sand, black to dark brown, wet, loose to very loose and with fine to gravel sized coal fragments		SPT-10	13.5 - 15.0	1.5	9-13-14	14	
				SPT-11	15.0 - 16.5	1.5	10-7-8	--	
390.9	17.5	<b>Soil 4:</b> Clayey sand, brown to grayish brown, moist to wet and loose to medium dense		SPT-12	17.5 - 19.0	0.5	1-2-1	22	
				SPT-13	20.0 - 21.5	0.4	1-1-1	--	
385.9	22.5	<b>Soil 3:</b> Bottom ash with sand, black to dark brown, wet, loose to very loose and with fine to gravel sized coal fragments		SPT-13	20.0 - 21.5	0.4	1-1-1	--	
				SPT-14	22.5 - 24.0	1.5	1-2-3	24	

STANTEC/FMSM\_LEGACY\_175569069.FPJ FMSM\_GRAPHIC.LOG.GDT 12/17/09



Lithology		Description	Overburden	Sample #	Depth	Rec. Ft.	Blows	Mois.Cont. %	Remarks
Elevation	Depth		Rock Core	RQD	Run	Rec. Ft.	Rec. %	Run Depth	
378.4	30.0	<b>Soil 6:</b> Silty clay, gray to brownish gray with some orange mottling, moist to wet, very soft to stiff, with some silt and traces of sand and occasional traces of coal and chert fragments <i>(Continued)</i>		SPT-15	25.0 - 26.5	1.5	2-4-6	--	
				SPT-16	27.5 - 29.0	1.4	3-4-6	27	
373.4	35.0	<b>Soil 4:</b> Clayey sand, brown to grayish brown, moist to wet and loose to medium dense		SPT-17	30.0 - 31.5	1.3	3-4-8	--	
				SPT-18	32.5 - 34.0	1.5	6-8-10	16	
368.4	40.0	<b>Soil 6:</b> Silty clay, gray to brownish gray with some orange mottling, moist to wet, very soft to stiff, with some silt and traces of sand and occasional traces of coal and chert fragments		SPT-19	35.0 - 36.5	1.1	2-6-13	--	
				SPT-20	37.5 - 39.0	1.3	16-30-45	17	
363.1	45.3	Bedrock (augered)		SPT-21	40.0 - 41.0	0.8	11-50+	--	
				SPT-22	42.5 - 43.5	0.5	50+	8	
				SPT-23	45.0 - 45.3	0.3	50+	--	
		No Refusal / Bottom of Hole  Top of Rock = 40.0 Elevation (368.4)							

STANTEC\FMSM\_LEGACY\_175569069.GPJ FMSM\_GRAPHIC.LOG.GDT 12/17/09

Project Number		175569069			Location		Paradise Fossil Plant			
Project Name		TVA - PAF Peabody Ash Pond			Boring No.		STN-12		Total Depth	46.5 ft
County		Muhlenberg			Surface Elevation		408.5 ft			
Project Type		Geotechnical Exploration			Date Started		8/17/09		Completed	8/18/09
Supervisor		R. Riker      Driller J. Felts			Depth to Water		14.4 ft		Date/Time	8/18/09
Logged By		B. Bline			Depth to Water		N/A		Date/Time	N/A
Lithology		Description	Overburden	Sample #	Depth	Rec. Ft.	Blows	Mois.Cont. %	Remarks	
Elevation	Depth		Rock Core	RQD	Run	Rec. Ft.	Rec. %	Run Depth		
408.5	0.0	Top of Hole								
		<b>Soil 1: MINESPOIL:</b> Lean clay with intermediate sand lenses, brown to gray with some reddish mottling, moist to wet, soft to very stiff and with heterogeneous mixture of coal, shale, and chert fragments		SPT-1	0.0 - 1.5	1.2	7-9-8	--		
			SPT-2	3.0 - 4.5	0.3	37-11-4	2			
			SPT-3	4.5 - 6.0	1.1	4-4-7	--			
			ST-1	6.0 - 8.0	2.0	--				
			SPT-4	8.0 - 9.5	1.5	2-4-2	15			
			SPT-5	9.5 - 11.0	0.8	0-1-7	--			
		SPT-6	11.0 - 12.5	1.1	2-4-7	14				
394.1	14.4	<b>Soil 3:</b> Bottom ash with sand, black to dark brown, wet, loose to very loose and with fine to gravel sized coal fragments		SPT-7	15.0 - 16.5	1.2	7-16-7	--		
			SPT-8	18.5 - 20.0	0.1	3-1-0	20			
387.0	21.5			SPT-9	22.5 - 24.0	1.5	0-0-0	--		

STANTEC\FMSM\_LEGACY\_175569069.GPJ FMSM-GRAFHIC.LOG.GDT 12/17/09

Lithology		Description	Overburden	Sample #	Depth	Rec. Ft.	Blows	Mois.Cont. %	Remarks
Elevation	Depth		Rock Core	RQD	Run	Rec. Ft.	Rec. %	Run Depth	
376.5	32.0	<b>Soil 6:</b> Silty clay, gray to brownish gray with some orange mottling, moist to wet, very soft to stiff, with some silt and traces of sand and occasional traces of coal and chert fragments <i>(Continued)</i>		ST-2	25.0 - 27.0	2.0		--	
				SPT-10	27.5 - 29.0	1.5	0-0-0	22	
				SPT-11	30.0 - 31.5	1.5	0-1-6	--	
368.5	40.0	<b>Soil 5:</b> Lean clay, light to dark brown with orange mottling, moist to wet, soft to stiff and with occasional chert fragments		SPT-12	32.5 - 34.0	1.5	4-16-24	18	
				SPT-13	35.0 - 36.5	0.9	6-10-14	--	
				SPT-14	37.5 - 39.0	1.5	6-9-15	17	
362.6	45.9	<b>Soil 6:</b> Silty clay, gray to brownish gray with some orange mottling, moist to wet, very soft to stiff, with some silt and traces of sand and occasional traces of coal and chert fragments		SPT-15	40.0 - 41.5	0.7	0-6-5	--	
				SPT-16	42.5 - 44.0	0.8	4-9-10	18	
				SPT-17	45.0 - 46.0	0.9	23-50-0.4	--	
362.0	46.5	Bedrock (augered)							
No Refusal / Bottom of Hole  Top of Rock = 45.9 Elevation (362.6)									

STANTEC\FMSM\_LEGACY\_175569069.GPJ FMSM-GRAPHIC.LOG.GDT 12/17/09

Project Number		175569069		Location		Paradise Fossil Plant				
Project Name		TVA - PAF Peabody Ash Pond		Boring No.		<b>STN-14</b>		Total Depth		38.2 ft
County		Muhlenberg		Surface Elevation		408.3 ft				
Project Type		Geotechnical Exploration		Date Started		8/11/09		Completed		8/11/09
Supervisor		R. Riker      Driller J. Felts		Depth to Water		14.5 ft		Date/Time		8/11/09
Logged By		B. Bline		Depth to Water		N/A		Date/Time		N/A
Lithology		Description	Overburden	Sample #	Depth	Rec. Ft.	Blows	Mois.Cont. %	Remarks	
Elevation	Depth		Rock Core	RQD	Run	Rec. Ft.	Rec. %	Run Depth		
408.3	0.0	Top of Hole								
		<b>Soil 1: MINESPOIL:</b> Lean clay with intermediate sand lenses, brown to gray with some reddish mottling, moist to wet, soft to very stiff and with heterogeneous mixture of coal, shale, and chert fragments		SPT-1	0.0 - 1.5	1.1	4-5-4	--		
				SPT-2	1.5 - 3.0	0.8	2-2-3	17		
				SPT-3	3.0 - 4.5	1.4	5-3-6	--		
				SPT-4	4.5 - 6.0	1.5	4-4-5	14		
				SPT-5	6.0 - 7.5	1.3	3-3-3	--		
				SPT-6	7.5 - 9.0	1.2	4-6-10	10		
				SPT-7	9.0 - 10.5	1.3	4-3-5	--		
				SPT-8	10.5 - 12.0	1.7	6-6-8	11		
				SPT-9	12.0 - 13.5	0.3	18-12-14	--		
394.8	13.5	<b>Soil 3:</b> Bottom ash with sand, black to dark brown, wet, loose to very loose and with fine to gravel sized coal fragments		SPT-10	13.5 - 15.0	1.5	8-10-12	15		
	SPT-11		15.0 - 16.5	1.5	8-9-11	--				
	SPT-12		17.5 - 19.0	1.2	4-6-6	14				
	SPT-13		20.0 - 21.5	0.0	0-0-0	--				

STANTEC\FMSM\_LEGACY\_175569069.GPJ FMSM\_GRAPHIC.LOG.GDT 12/17/09

Lithology		Description	Overburden	Sample #	Depth	Rec. Ft.	Blows	Mois.Cont. %	Remarks
Elevation	Depth		Rock Core	RQD	Run	Rec. Ft.	Rec. %	Run Depth	
380.8	27.5	<b>Soil 3:</b> Bottom ash with sand, black to dark brown, wet, loose to very loose and with fine to gravel sized coal fragments <i>(Continued)</i>		SPT-14	22.5 - 24.0	0.5	0-0-0	23	
				SPT-15	25.0 - 26.5	1.0	0-0-0	--	
375.8	32.5	<b>Soil 4:</b> Clayey sand, brown to grayish brown, moist to wet and loose to medium dense		SPT-16	27.5 - 29.0	0.7	0-1-0	21	
				SPT-17	30.0 - 31.5	1.0	0-1-4	--	
370.1	38.2	<b>Soil 6:</b> Silty clay, gray to brownish gray with some orange mottling, moist to wet, very soft to stiff, with some silt and traces of sand and occasional traces of coal and chert fragments Shale, light gray, very thin bedded		SPT-18	32.5 - 34.0	0.8	4-6-12	18	
				SPT-19	35.0 - 36.5	0.5	35-50-0.2	--	
				SPT-20	37.5 - 38.2	0.7	40-50-0.2	11	
		Auger Refusal / Bottom of Hole  Top of Rock = 38.2 Elevation (370.1)							

STANTEC/FMSM\_LEGACY\_175569069.GPJ FMSM-GRAPHIC.LOG.GDT 12/17/09

Project Number		175569069			Location		Paradise Fossil Plant			
Project Name		TVA - PAF Peabody Ash Pond			Boring No.		STN-15		Total Depth	35.9 ft
County		Muhlenberg			Surface Elevation		407.9 ft			
Project Type		Geotechnical Exploration			Date Started		8/25/09		Completed	8/25/09
Supervisor		R. Riker      Driller J. Felts			Depth to Water		14.0 ft		Date/Time	8/25/09
Logged By		B. Bline			Depth to Water		N/A		Date/Time	N/A
Lithology		Description	Overburden	Sample #	Depth	Rec. Ft.	Blows	Mois.Cont. %	Remarks	
Elevation	Depth		Rock Core	RQD	Run	Rec. Ft.	Rec. %	Run Depth		
407.9	0.0	Top of Hole								
		<b>Soil 1: MINESPOIL:</b> Lean clay with intermediate sand lenses, brown to gray with some reddish mottling, moist to wet, soft to very stiff and with heterogeneous mixture of coal, shale, and chert fragments		SPT-1	0.0 - 1.5	1.1	12-12-10	9		
			SPT-2	1.5 - 3.0	1.3	8-7-6	--			
			SPT-3	3.0 - 4.5	0.9	4-5-5	8			
			ST-1	4.5 - 6.5	1.7		--		Bottom of tube is wet	
			SPT-4	6.5 - 8.0	1.5	12-29-8	--		Shale cobble from 7.0' to 7.5'	
			SPT-5	8.0 - 9.5	1.0	2-5-9	13			
			SPT-6	9.5 - 11.0	1.2	1-3-6	--			
			ST-2	11.0 - 13.0	1.5		--			
393.9	14.0		<b>Soil 3:</b> Bottom ash with sand, black to dark brown, wet, loose to very loose and with fine to gravel sized coal fragments		SPT-7	13.5 - 15.0	0.9	0-4-6	21	
				SPT-8	15.0 - 16.5	0.9	1-3-5	--		
390.4	17.5	<b>Soil 6:</b> Silty clay, gray to brownish gray with some orange mottling, moist to wet, very soft to stiff, with some silt and traces of sand and occasional traces of coal and chert fragments		SPT-9	17.5 - 19.0	0.6	1-1-2	20		
			SPT-10	20.0 - 21.5	1.3	0-1-4	--			

STANTEC\FMSM\_LEGACY\_175569069.GPJ FMSM-GRAPHIC.LOG.GDT 12/17/09

Lithology		Description	Overburden	Sample #	Depth	Rec. Ft.	Blows	Mois.Cont. %	Remarks
Elevation	Depth		Rock Core	RQD	Run	Rec. Ft.	Rec. %	Run Depth	
		<b>Soil 6:</b> Silty clay, gray to brownish gray with some orange mottling, moist to wet, very soft to stiff, with some silt and traces of sand and occasional traces of coal and chert fragments <i>(Continued)</i>		SPT-11	22.5 - 24.0	1.5	2-0-0	24	
			SPT-12	25.0 - 26.5	1.1	1-0-0	--		
			SPT-13	27.5 - 29.0	1.5	0-0-2	17		
			SPT-14	30.0 - 31.5	1.5	3-5-8	--		
375.9	32.0								
			Bedrock (augered)		SPT-15	32.5 - 34.0	0.9	21-50-0.4	13
372.0	35.9			SPT-16	35.0 - 35.9	0.9	20-50-0.4	--	
No Refusal / Bottom of Hole  Top of Rock = 32.0 Elevation (375.9)									

STANTEC\FMSM\_LEGACY\_175569069.GPJ FMSM-GRAPHIC.LOG.GDT 12/17/09

Project Number	175569069	Location	Paradise Fossil Plant		
Project Name	TVA - PAF Peabody Ash Pond	Boring No.	<b>STN-16</b>	Total Depth	24.5 ft
County	Muhlenberg	Surface Elevation	400.1 ft		
Project Type	Geotechnical Exploration	Date Started	8/25/09	Completed	8/25/09
Supervisor	S. Lange	Driller	J. Bowerman	Depth to Water	14.0 ft
Logged By	S. Lange	Depth to Water	N/A	Date/Time	N/A

Lithology		Description	Overburden	Sample #	Depth	Rec. Ft.	Blows	Mois.Cont. %	Remarks
Elevation	Depth		Rock Core	RQD	Run	Rec. Ft.	Rec. %	Run Depth	
400.1	0.0	Top of Hole							
		<b>Soil 2:</b> MINESPOIL: Lean clay with sand, olive gray to grayish brown with intermittent orange mottling, moist to wet, stiff to very stiff and with heterogeneous mixture of coal, shale, and chert fragments		SPT-1	0.0 - 1.5	1.0	2-3-6	--	
				SPT-2	1.5 - 3.0	1.0	7-8-5	11	
				SPT-3	3.0 - 4.5	1.0	2-3-3	--	
395.1	5.0	<b>Soil 6:</b> Silty clay, gray to brownish gray with some orange mottling, moist to wet, very soft to stiff, with some silt and traces of sand and occasional traces of coal and chert fragments		ST-1	4.5 - 6.5	2.0		--	
				SPT-4	6.5 - 8.0	1.3	1-3-3	17	
				SPT-5	8.0 - 9.5	0.5	WOT-1-1	--	
				ST-2	9.5 - 11.5	2.0		--	
				SPT-6	11.5 - 13.0	1.3	WOT-1-1	24	
				SPT-7	13.0 - 14.5	1.3	WOT- WOT-1	--	
				SPT-8	15.5 - 17.0	1.3	WOT	28	
				SPT-9	18.0 - 19.5	1.0	1-4-8	--	
			SPT-10	20.5 - 22.0	1.3	13-15-15	14		

STANTEC\FNSM\_LEGACY\_175569069.GPJ\_FNSM\_GRAPHIC.LOG.GDT\_12/22/09



Project Number <u>175569069</u>	Location <u>Paradise Fossil Plant</u>
Project Name <u>TVA - PAF Peabody Ash Pond</u>	Boring No. <u><b>STN-16</b></u> Total Depth <u>24.5 ft</u>

Lithology		Description	Overburden	Sample #	Depth	Rec. Ft.	Blows	Mois.Cont. %	Remarks
Elevation	Depth		Rock Core	RQD	Run	Rec. Ft.	Rec. %	Run Depth	
376.1	24.0	Bedrock (augered)		SPT-11	23.0 - 24.5	1.3	36-30	--	
375.6	24.5								

No Refusal /  
Bottom of Hole

Top of Rock = 24.0  
Elevation (376.1)

Project Number		175569069			Location		Paradise Fossil Plant		
Project Name		TVA - PAF Peabody Ash Pond			Boring No.		<b>STN-17</b>	Total Depth	46.5 ft
County		Muhlenberg			Surface Elevation		407.8 ft		
Project Type		Geotechnical Exploration			Date Started		8/11/09	Completed	8/12/09
Supervisor		R. Riker	Driller	J. Felts	Depth to Water		25.0 ft	Date/Time	8/12/09
Logged By		B. Bline			Depth to Water		N/A	Date/Time	N/A

Lithology		Description	Overburden	Sample #	Depth	Rec. Ft.	Blows	Mois.Cont. %	Remarks
Elevation	Depth		Rock Core						
407.8	0.0	Top of Hole							
		<b>Soil 1: MINESPOIL:</b> Lean clay with intermediate sand lenses, brown to gray with some reddish mottling, moist to wet, soft to very stiff and with heterogeneous mixture of coal, shale, and chert fragments		SPT-1	0.0 - 1.5	1.4	6-12-4	10	
				SPT-2	1.5 - 3.0	1.5	7-8-9	--	
				SPT-3	3.0 - 4.5	1.5	2-4-3	14	
				SPT-4	4.5 - 6.0	1.5	4-13-12	--	Shale cobble from 5.2' to 5.7'
				SPT-5	6.0 - 7.5	1.5	5-6-8	11	
				SPT-6	7.5 - 9.0	1.2	2-4-5	--	
				SPT-7	9.0 - 10.5	1.2	3-5-8	13	
				SPT-8	10.5 - 12.0	1.5	3-6-12	--	
395.8	12.0								
		<b>Soil 4:</b> Clayey sand, brown to grayish brown, moist to wet and loose to medium dense		SPT-9	12.0 - 13.5	1.5	3-7-7	12	
				SPT-10	13.5 - 15.0	1.5	2-3-6	--	
392.8	15.0								
		<b>Soil 5:</b> Lean clay, light to dark brown with orange mottling, moist to wet, soft to stiff and with occasional chert fragments		SPT-11	15.0 - 16.5	1.5	3-6-7	16	
				SPT-12	17.5 - 19.0	1.5	3-3-5	--	
				SPT-13	20.0 - 21.5	1.5	2-3-3	23	
385.3	22.5								
				SPT-14	22.5 - 24.0	0.8	0-1-2	--	

STANTEC/FMSM\_LEGACY\_175569069.GPJ FMSM\_GRAPHIC.LOG.GDT 12/17/09

Lithology		Description	Overburden	Sample #	Depth	Rec. Ft.	Blows	Mois.Cont. %	Remarks
Elevation	Depth		Rock Core	RQD	Run	Rec. Ft.	Rec. %	Run Depth	
		<b>Soil 6:</b> Silty clay, gray to brownish gray with some orange mottling, moist to wet, very soft to stiff, with some silt and traces of sand and occasional traces of coal and chert fragments <i>(Continued)</i>		SPT-15	25.0 - 26.5	1.5	5-8-8	21	
				SPT-16	27.5 - 29.0	1.5	2-4-7	--	
				SPT-17	30.0 - 31.5	1.5	1-4-5	24	
				SPT-18	32.5 - 34.0	1.5	1-3-4	--	
				SPT-19	35.0 - 36.5	1.5	0-0-0	35	
				SPT-20	37.5 - 39.0	1.5	0-0-0	--	
				SPT-21	40.0 - 41.5		0-0-1	30	
				SPT-22	42.5 - 44.0	1.5	1-0-1	--	
				SPT-23	45.0 - 46.5	1.5	0-1-2	30	
361.3	46.5	No Refusal / Bottom of Hole							

STANTEC\FMSM\_LEGACY\_175569069.GPJ FMSM-GRAPHIC.LOG.GDT 12/17/09

Project Number		175569069			Location		Paradise Fossil Plant		
Project Name		TVA - PAF Peabody Ash Pond			Boring No.		<b>STN-18</b>	Total Depth	46.5 ft
County		Muhlenberg			Surface Elevation		408.0 ft		
Project Type		Geotechnical Exploration			Date Started		8/13/09	Completed	8/14/09
Supervisor		R. Riker	Driller	J. Felts	Depth to Water		20.0 ft	Date/Time	8/14/09
Logged By		B. Bline			Depth to Water		N/A	Date/Time	N/A

Lithology		Description	Overburden	Sample #	Depth	Rec. Ft.	Blows	Mois.Cont. %	Remarks
Elevation	Depth		Rock Core						
408.0	0.0	Top of Hole							
		<b>Soil 1: MINESPOIL:</b> Lean clay with intermediate sand lenses, brown to gray with some reddish mottling, moist to wet, soft to very stiff and with heterogeneous mixture of coal, shale, and chert fragments		SPT-1	0.0 - 1.5	1.1	6-11-7	--	
				ST-1	2.0 - 4.0	1.3		--	
402.5	5.5			SPT-2	4.0 - 5.5	1.1	2-3-4	15	
401.0	7.0	<b>Soil 4:</b> Clayey sand, brown to grayish brown, moist to wet and loose to medium dense		SPT-3	5.5 - 7.0	1.2	1-2-4	--	
				ST-2	7.0 - 9.0	1.3		--	
		<b>Soil 5:</b> Lean clay, light to dark brown with orange mottling, moist to wet, soft to stiff and with occasional chert fragments		SPT-4	9.0 - 10.5	0.9	0-0-2	19	
				SPT-5	10.5 - 12.0	0.3	0-0-0	--	
				SPT-6	12.0 - 13.5	1.5	0-1-1	23	
				SPT-7	13.5 - 15.0	1.5	0-1-1	--	
				SPT-8	15.0 - 16.5	1.2	0-1-2	22	
				SPT-9	17.5 - 19.0	1.5	0-2-2	--	
				SPT-10	20.0 - 21.5	1.5	0-0-0	26	
				SPT-11	22.5 - 24.0	1.5	2-7-8	--	

STANTEC\FMSM\_LEGACY\_175569069.GPJ FMSM\_GRAPHIC.LOG.GDT 12/17/09

Lithology		Description	Overburden	Sample #	Depth	Rec. Ft.	Blows	Mois.Cont. %	Remarks
Elevation	Depth		Rock Core	RQD	Run	Rec. Ft.	Rec. %	Run Depth	
381.0	27.0	<b>Soil 6:</b> Silty clay, gray to brownish gray with some orange mottling, moist to wet, very soft to stiff, with some silt and traces of sand and occasional traces of coal and chert fragments		ST-3	24.0 - 26.0	2.0		--	
			SPT-12	27.5 - 29.0	1.5	0-2-2	--		
			SPT-13	30.0 - 31.5	1.5	1-3-4	29		
			SPT-14	32.5 - 34.0	1.5	0-2-2	--		
			SPT-15	35.0 - 36.5	1.5	0-1-2	44		
			SPT-16	37.5 - 39.0	1.5	0-0-1	--		
			SPT-17	40.0 - 41.5	1.5	0-0-0	20		
			SPT-18	42.5 - 44.0	1.3	0-0-0	--		
361.5	46.5		SPT-19	45.0 - 46.5	1.5	0-0-0	25		
No Refusal / Bottom of Hole									

STANTEC\FMSM\_LEGACY\_175569069.GPJ FMSM\_GRAPHIC.LOG.GDT 12/17/09

Project Number		175569069			Location		Paradise Fossil Plant		
Project Name		TVA - PAF Peabody Ash Pond			Boring No.		<b>STN-20</b>	Total Depth 65.7 ft	
County		Muhlenberg			Surface Elevation		408.3 ft		
Project Type		Geotechnical Exploration			Date Started		8/12/09	Completed 8/13/09	
Supervisor		R. Riker Driller J. Felts			Depth to Water		27.0 ft	Date/Time 8/12/09	
Logged By		B. Bline			Depth to Water		N/A	Date/Time N/A	
Lithology		Description	Overburden	Sample #	Depth	Rec. Ft.	Blows	Mois.Cont. %	Remarks
Elevation	Depth		Rock Core	RQD	Run	Rec. Ft.	Rec. %	Run Depth	
408.3	0.0	Top of Hole							
		<b>Soil 1: MINESPOIL:</b> Lean clay with intermediate sand lenses, brown to gray with some reddish mottling, moist to wet, soft to very stiff and with heterogeneous mixture of coal, shale, and chert fragments		SPT-1	0.0 - 1.5	1.1	8-4-9	10	
			SPT-2	1.5 - 3.0	1.4	5-8-6	--		
			SPT-3	3.0 - 4.5	1.5	6-11-9	10		
			SPT-4	4.5 - 6.0	1.5	7-11-12	--		
			SPT-5	6.0 - 7.5	1.5	6-4-4	14		
			SPT-6	7.5 - 9.0	1.5	3-5-6	--		
			SPT-7	9.0 - 10.5	1.5	3-7-8	12		
			SPT-8	10.5 - 12.0	1.5	3-6-8	--		
395.3	13.0		SPT-9	12.0 - 13.5	1.2	1-1-1	17		Shale/Coal fragments from 12.0' to 12.4'
		<b>Soil 5:</b> Lean clay, light to dark brown with orange mottling, moist to wet, soft to stiff and with occasional chert fragments		SPT-10	13.5 - 15.0	1.1	0-0-0	--	
			SPT-11	15.0 - 16.5	1.5	0-0-0	23		
			SPT-12	17.5 - 19.0	0.0	0-1-2	--		
			SPT-13	20.0 - 21.5	0.4	0-0-2	20		Some angular gravel from 20.0' to 22.5'

STANTEC\FMSM\_LEGACY\_175569069.GPJ FMSM-GRAPHIC.LOG.GDT 12/17/09

Lithology		Description	Overburden	Sample #	Depth	Rec. Ft.	Blows	Mois.Cont. %	Remarks
Elevation	Depth		Rock Core	RQD	Run	Rec. Ft.	Rec. %	Run Depth	
380.8	27.5	<b>Soil 5:</b> Lean clay, light to dark brown with orange mottling, moist to wet, soft to stiff and with occasional chert fragments <i>(Continued)</i>		SPT-14	22.5 - 24.0	1.1	2-3-3	--	Sandy clay form 27.7' to 35.5'
				SPT-15	25.0 - 26.5	1.5	1-2-3	18	
373.3	35.0	<b>Soil 4:</b> Clayey sand, brown to grayish brown, moist to wet and loose to medium dense		SPT-16	27.5 - 29.0	1.4	12-18-19	--	
				SPT-17	30.0 - 31.5	1.5	2-5-6	19	
				SPT-18	32.5 - 34.0	1.5	3-3-5	--	
		<b>Soil 6:</b> Silty clay, gray to brownish gray with some orange mottling, moist to wet, very soft to stiff, with some silt and traces of sand and occasional traces of coal and chert fragments		SPT-19	35.0 - 36.5	1.5	1-2-2	21	
				SPT-20	37.5 - 39.0	1.5	0-0-0	--	
				SPT-21	40.0 - 41.5	1.5	0-0-0	33	
				SPT-22	42.5 - 44.0	1.5	0-0-0	--	
				SPT-23	45.0 - 46.5	1.5	1-1-2	26	

STANTEC\FMSM\_LEGACY\_175569069.GPJ FMSM-GRAPHIC.LOG.GDT 12/17/09

Lithology		Description	Overburden	Sample #	Depth	Rec. Ft.	Blows	Mois.Cont. %	Remarks
Elevation	Depth		Rock Core	RQD	Run	Rec. Ft.	Rec. %	Run Depth	
		<b>Soil 6:</b> Silty clay, gray to brownish gray with some orange mottling, moist to wet, very soft to stiff, with some silt and traces of sand and occasional traces of coal and chert fragments <i>(Continued)</i>							
				SPT-24	55.0 - 56.5	1.1	18-23-45	--	
348.1	60.2								Began Core
		Shale, light gray, moderately hard, weathered							
342.6	65.7				5.5	5.5	100	65.7	
Bottom of Hole  Top of Rock = 60.2 Elevation (348.1)									

STANTEC\FMSM\_LEGACY\_175569069.GPJ FMSM-GRAPHIC LOG.GDT 12/17/09



Project Number		175569069		Location		Paradise Fossil Plant				
Project Name		TVA - PAF Peabody Ash Pond		Boring No.		<b>STN-21</b>		Total Depth		46.5 ft
County		Muhlenberg		Surface Elevation		408.6 ft				
Project Type		Geotechnical Exploration		Date Started		8/15/09		Completed		8/17/09
Supervisor		R. Riker      Driller J. Felts		Depth to Water		42.5 ft		Date/Time		8/17/09
Logged By		B. Bline		Depth to Water		N/A		Date/Time		N/A
Lithology		Description	Overburden	Sample #	Depth	Rec. Ft.	Blows	Mois.Cont. %	Remarks	
Elevation	Depth		Rock Core	RQD	Run	Rec. Ft.	Rec. %	Run Depth		
408.6	0.0	Top of Hole								
		<b>Soil 1: MINESPOIL:</b> Lean clay with intermediate sand lenses, brown to gray with some reddish mottling, moist to wet, soft to very stiff and with heterogeneous mixture of coal, shale, and chert fragments		SPT-1	0.0 - 1.5	1.1	9-11-11	--		
				ST-1	2.0 - 4.0	2.0		--		
				SPT-2	4.0 - 5.5	1.5	4-9-15	12		
				SPT-3	5.5 - 7.0	1.4	3-6-8	--		
				ST-2	7.0 - 8.5	1.1		--		
				ST-3	8.5 - 10.5	1.4		--		
				SPT-4	10.5 - 12.0	0.9	1-3-3	13		
				SPT-5	12.0 - 13.5	1.2	1-2-3	--		
				SPT-6	13.5 - 15.0	1.2	3-2-1	13		
				SPT-7	15.0 - 16.5	1.4	2-4-8	--		
391.1	17.5	<b>Soil 4:</b> Clayey sand, brown to grayish brown, moist to wet and loose to medium dense		SPT-8	17.5 - 19.0	1.5	2-4-4	15		
				SPT-9	20.0 - 21.5	1.5	2-3-4	--		
				SPT-10	22.5 - 24.0	1.4	6-11-10	10	Sandstone this spoon only	

STANTEC\FMSM\_LEGACY\_175569069.GPJ FMSM-GRAPHIC.LOG.GDT 12/17/09

Lithology		Description	Overburden	Sample #	Depth	Rec. Ft.	Blows	Mois.Cont. %	Remarks
Elevation	Depth		Rock Core	RQD	Run	Rec. Ft.	Rec. %	Run Depth	
		<b>Soil 4:</b> Clayey sand, brown to grayish brown, moist to wet and loose to medium dense <i>(Continued)</i>		SPT-11	25.0 - 26.5	1.4	2-4-4	--	
				SPT-12	27.5 - 29.0	1.4	1-3-6	13	
				SPT-13	30.0 - 31.5	1.5	8-12-12	--	
				SPT-14	32.5 - 34.0	1.5	4-7-12	14	
				SPT-15	35.0 - 36.5	1.1	4-7-10	--	Decomposed sandstone in spoon tip
				SPT-16	37.5 - 39.0	1.4	5-8-7	11	High percentage of shale fragments
368.6	40.0								
		<b>Soil 6:</b> Silty clay, gray to brownish gray with some orange mottling, moist to wet, very soft to stiff, with some silt and traces of sand and occasional traces of coal and chert fragments		SPT-17	40.0 - 41.5	1.5	3-6-6	--	
				SPT-18	42.5 - 44.0	1.3	3-7-5	19	Decomposing weathered shale from 42.5' to 46.5'
				SPT-19	45.0 - 46.5	1.1	7-4-8	--	
362.1	46.5								
No Refusal / Bottom of Hole									

STANTEC\FMSM\_LEGACY\_175569069.GPJ FMSM\_GRAPHIC.LOG.GDT 12/17/09

Project Number	175569069	Location	Paradise Fossil Plant		
Project Name	TVA - PAF Peabody Ash Pond	Boring No.	<b>STN-22</b>	Total Depth	30.0 ft
County	Muhlenberg	Surface Elevation	405.7 ft		
Project Type	Geotechnical Exploration	Date Started	8/24/09	Completed	8/24/09
Supervisor	S. Lange	Driller	J. Bowerman	Depth to Water	22.0 ft
Logged By	S. Lange	Depth to Water	N/A	Date/Time	N/A

Lithology		Description	Overburden	Sample #	Depth	Rec. Ft.	Blows	Mois.Cont. %	Remarks
Elevation	Depth		Rock Core	RQD	Run	Rec. Ft.	Rec. %	Run Depth	
405.7	0.0	Top of Hole							
		<b>Soil 1:</b> MINESPOIL: Lean clay with intermediate sand lenses, brown to gray with some reddish mottling, moist to wet, soft to very stiff and with heterogeneous mixture of coal, shale, and chert fragments		SPT-1	0.0 - 1.5	1.0	4-4-4	12	
				SPT-2	1.5 - 3.0	1.0	3-3-3	--	
				SPT-3	3.0 - 4.5	0.5	2-2-3	12	
400.0	5.7	<b>Soil 2:</b> MINESPOIL: Lean clay with sand, olive gray to grayish brown with intermittent orange mottling, moist to wet, stiff to very stiff and with heterogeneous mixture of coal, shale, and chert fragments		ST-1	4.5 - 6.5	1.5	--	--	
				SPT-4	6.5 - 8.0	1.0	1-2-2	--	
				SPT-5	8.0 - 9.5	0.0	1-2-2	--	
394.2	11.5			ST-2	9.5 - 11.5	1.4	--	--	
		<b>Soil 4:</b> Clayey sand, brown to grayish brown, moist to wet and loose to medium dense		SPT-6	11.5 - 13.0	1.0	WOT-5-7	--	
				SPT-7	13.0 - 14.5	0.5	2-2-3	14	
				SPT-8	15.5 - 17.0	0.5	1-3-3	--	
				SPT-9	18.0 - 19.5	0.5	5-6-6	11	
			SPT-10	20.5 - 22.0	1.0	4-8-7	--		

STANTEC\FNSM\_LEGACY\_175569069.GPJ\_FNSM\_GRAPHIC.LOG.GDT\_12/22/09

Project Number <u>175569069</u>	Location <u>Paradise Fossil Plant</u>
Project Name <u>TVA - PAF Peabody Ash Pond</u>	Boring No. <u>STN-22</u> Total Depth <u>30.0 ft</u>

Lithology		Description	Overburden	Sample #	Depth	Rec. Ft.	Blows	Mois.Cont. %	Remarks
Elevation	Depth		Rock Core	RQD	Run	Rec. Ft.	Rec. %	Run Depth	
382.7	23.0	<b>Soil 6:</b> Silty clay, gray to brownish gray with some orange mottling, moist to wet, very soft to stiff, with some silt and traces of sand and occasional traces of coal and chert fragments		SPT-11	23.0 - 24.5	0.5	WOT-1-2	20	Shale fragments from 28.5' to 30.0'
			SPT-12	25.5 - 27.0	1.3	2-9-30	--		
375.7	30.0		SPT-13	28.6 - 30.0	1.0	3-16-19	12		


No Refusal /  
Bottom of Hole

## Appendix C



### Instrumentation Layout and Logs


- NOTES:**
- The topographic basemap shown on this drawing was developed by Stantec using electronic drawings titled "PA00012.dwg and PA00008.dwg" provided by TVA. The information is believed to be approximate and should not be used for construction purposes.
  - The geotechnical information and data furnished herein are not intended as representation or warranties but are furnished for information only. It shall be distinctly understood that the Owner or Engineer will not be responsible for any deduction, interpretation or conclusion drawn therefrom. The information is made available in order that the Contractor may have ready access to the same information available to the Owner and the Engineer and is not part of this contract.
  - The subsurface soil horizons in between borings and beyond borings are in general based on straight line interpolation and straight line extension, respectively. The ground line shown below water (down stream side) is also approximate. No hydrographic survey of down stream pool was performed. No warranties can be made regarding the continuity of conditions between and beyond borings.


INSTRUMENTATION LOCATION TABLE			
BORING	NORTHING	EASTING	ELEV. (FT.)
STN-1	334,559.32	1,641,085.25	411.2
STN-6	334,117.67	1,642,904.88	407.8
STN-7	334,110.95	1,642,925.81	401.4
STN-12	332,482.84	1,642,158.00	408.5
STN-15	331,736.99	1,641,864.45	407.9
STN-16	331,729.49	1,641,903.96	400.1
STN-18	331,767.22	1,641,030.49	408.0
STN-21	331,553.80	1,640,209.81	408.6
STN-22	331,536.19	1,640,178.58	405.7

**LEGEND**  
 STN-1  Piezometer Location

**ISSUED FOR REVIEW  
 NOT FOR CONSTRUCTION**

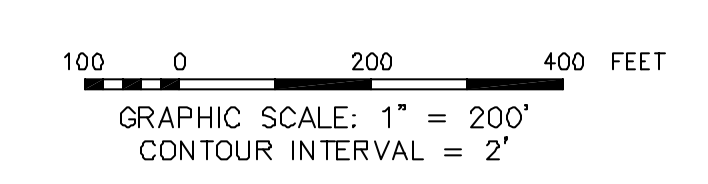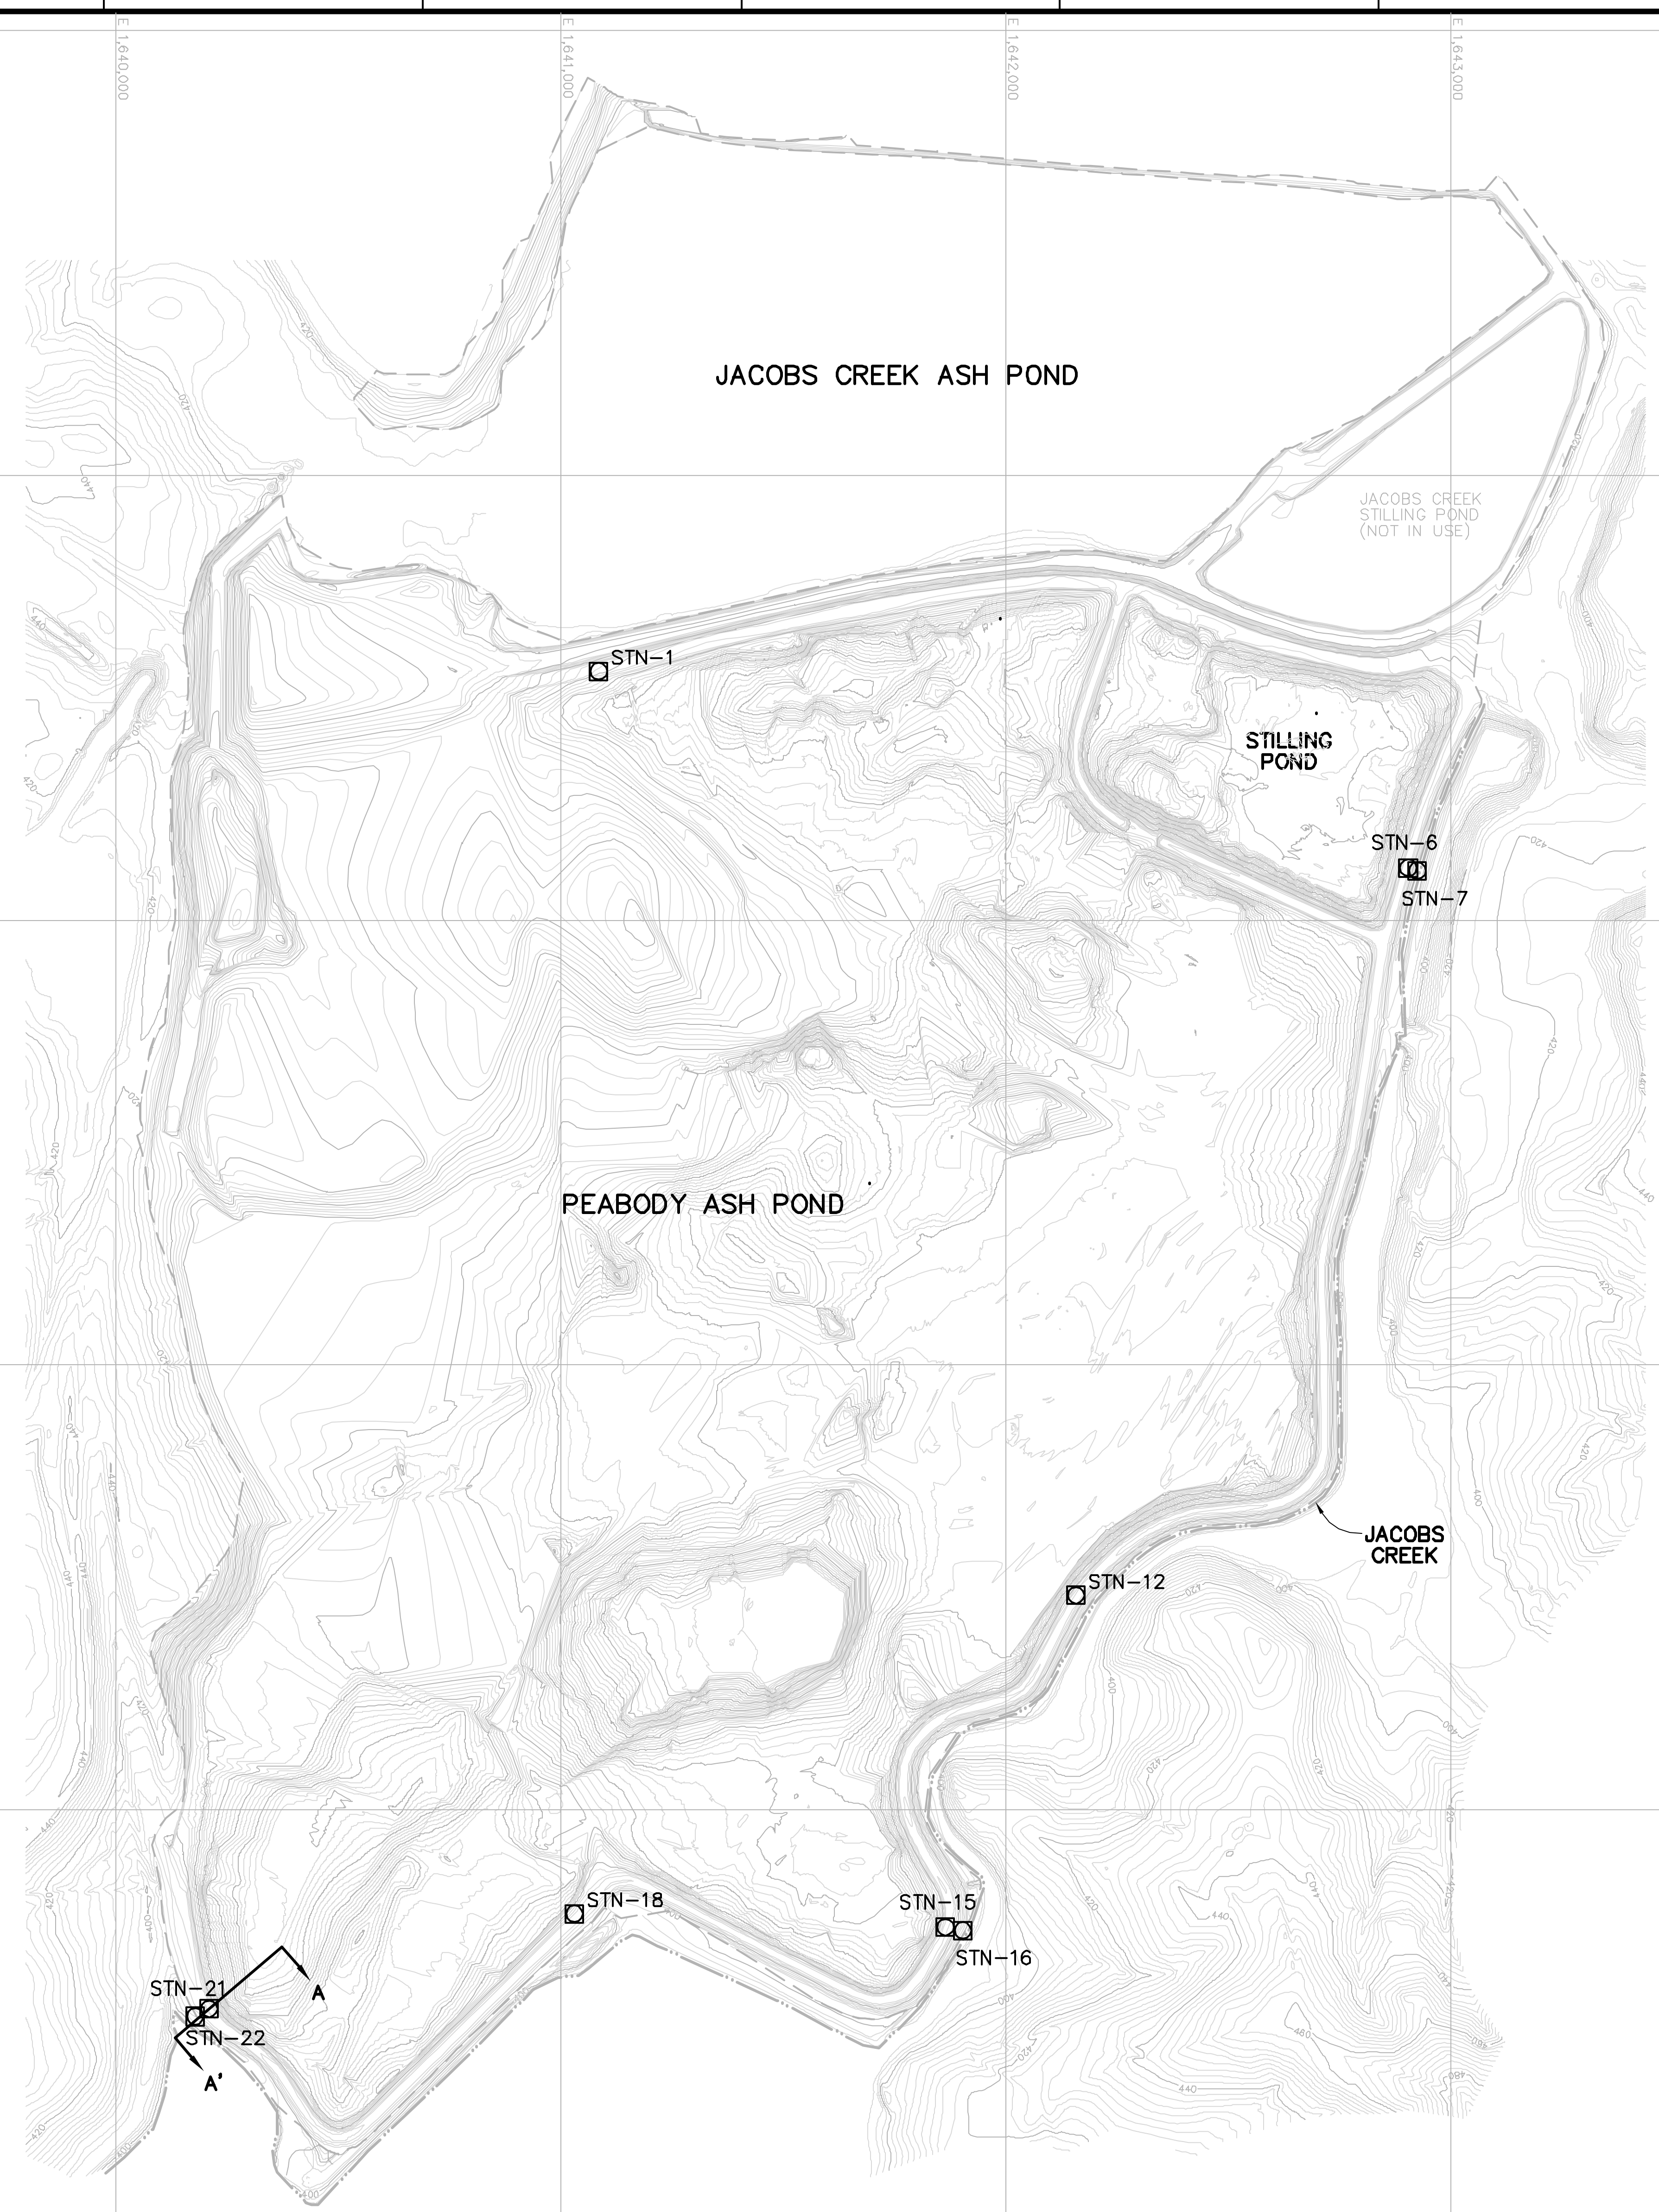

For Supporting Design Calculations see		R - - - - -													
ISSUED FOR REVIEW		R	0	12/22/09	JB	JF	SV	SV	HRA	-	-	-	-	-	-
SCALE: 1" = 200'		EXCEPT AS NOTED													
YARD															
PEABODY ASH POND GEOTECHNICAL EXPLORATION INSTRUMENTATION PLAN															
DESIGNED BY:	DRAWN BY:	CHECKED BY:	SUPERVISED BY:	REVIEWED BY:	APPROVED BY:	ISSUED BY:									
J. BELL	R. FLINN	S. VEMURI	S. VEMURI	H. APARCIO	-	-									
 Stantec Consulting Services Inc. 1409 N. Forbes Rd. Lexington, Kentucky 40511-2050 Tel: 858.422.3000 Fax: 858.422.3100 www.stantec.com		PARADISE FOSSIL PLANT TENNESSEE VALLEY AUTHORITY FOSSIL AND HYDRO ENGINEERING													
AUTOCAD R 2000	DATE 12/22/09	64	C	XXWXXX-00	R 0										

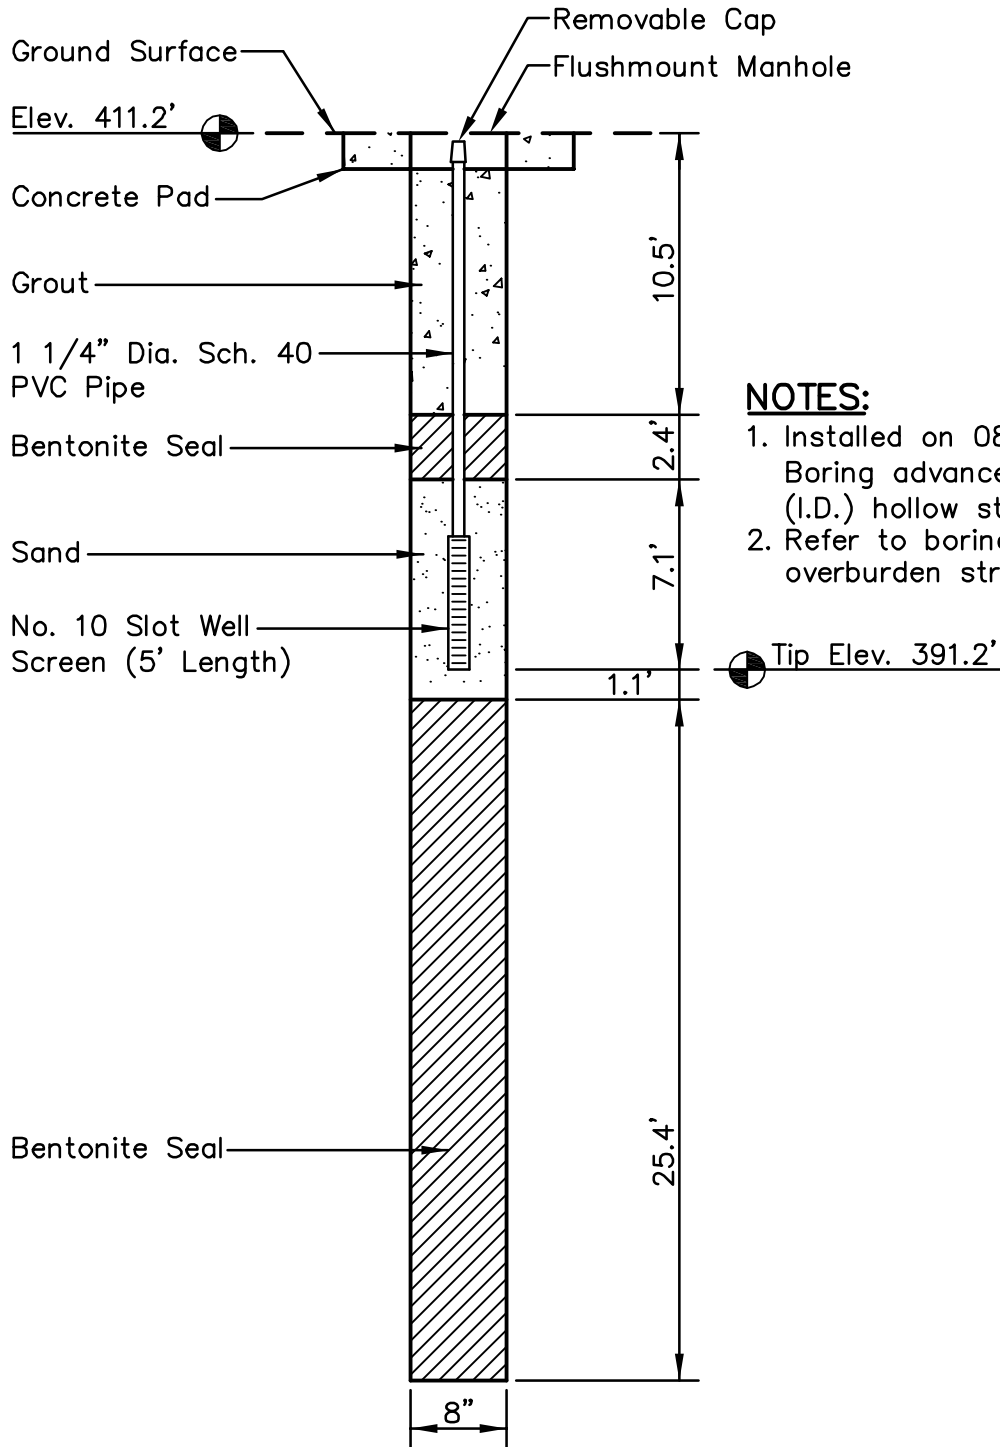

**NOTES:**

1. Installed on 08/25/2009. Boring advanced with 4.25" (I.D.) hollow stem augers.
2. Refer to boring log for overburden stratigraphy.

**LOCATION:**

Northing: 334,559.32  
 Easting: 1,641,085.25  
 Ground Elevation: 411.2 feet

Locations to be provided by  
 TVA, Power Systems  
 Operations, Surveying and  
 Project Services.

Horizontal Datum: NAD 27  
 Vertical Datum: NGVD29

**PIEZOMETER STN-1**  
**GEOTECHNICAL EXPLORATION**  
**PEABODY ASH POND**




Stantec

**Stantec Consulting  
 Services Inc.**  
 1409 N. Forbes Rd.  
 Lexington, Kentucky  
 40511-2050  
 859-422-3000  
 www.stantec.com

DRAWN BY	JRF	DATE	DEC., 2009	REVISED	
CHECKED BY	JTB	PROJ. NO.	175569069	1.	3.
CHECKED BY	SV	SCALE	NTS	2.	4.

SHEET  
**1 OF 1**

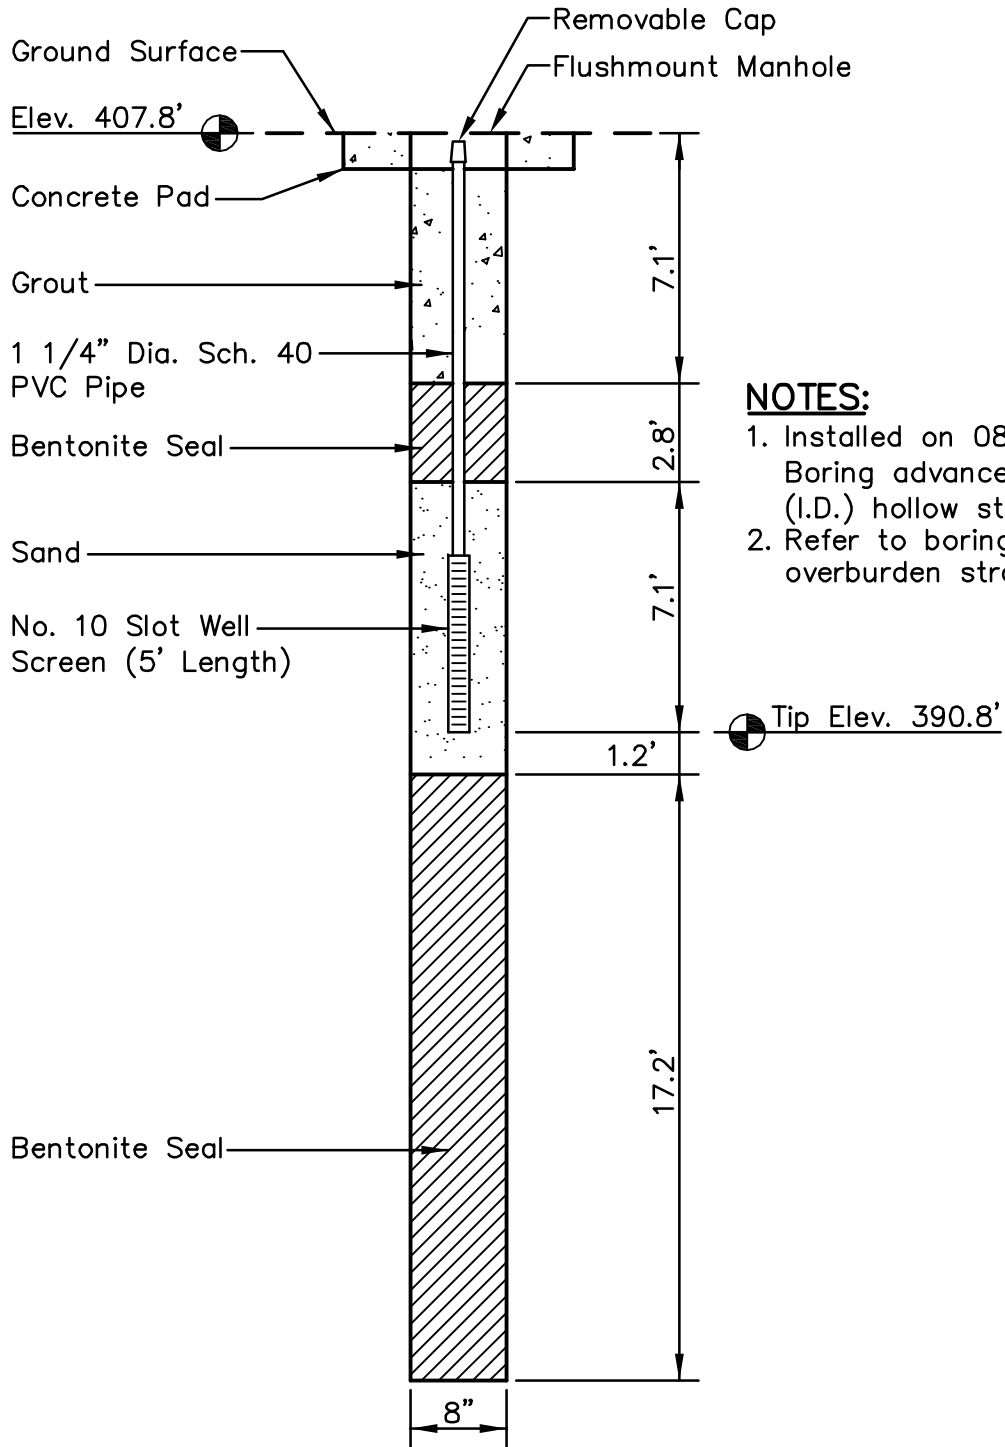

**NOTES:**

1. Installed on 08/27/2009. Boring advanced with 4.25" (I.D.) hollow stem augers.
2. Refer to boring log for overburden stratigraphy.

**LOCATION:**

Northing: 334,117.67  
 Easting: 1,642,904.88  
 Ground Elevation: 407.8 feet

Locations to be provided by  
 TVA, Power Systems  
 Operations, Surveying and  
 Project Services.  
 Horizontal Datum: NAD 27  
 Vertical Datum: NGVD29

**PIEZOMETER STN-6  
 GEOTECHNICAL EXPLORATION  
 PEABODY ASH POND**




**Stantec**

Stantec Consulting  
 Services Inc.  
 1409 N. Forbes Rd.  
 Lexington, Kentucky  
 40511-2050  
 859-422-3000  
 www.stantec.com

DRAWN BY	JRF	DATE	DEC., 2009	REVISED	
CHECKED BY	JTB	PROJ. NO.	175569069	1.	3.
CHECKED BY	SV	SCALE	NTS	2.	4.

SHEET  
**1 OF 1**



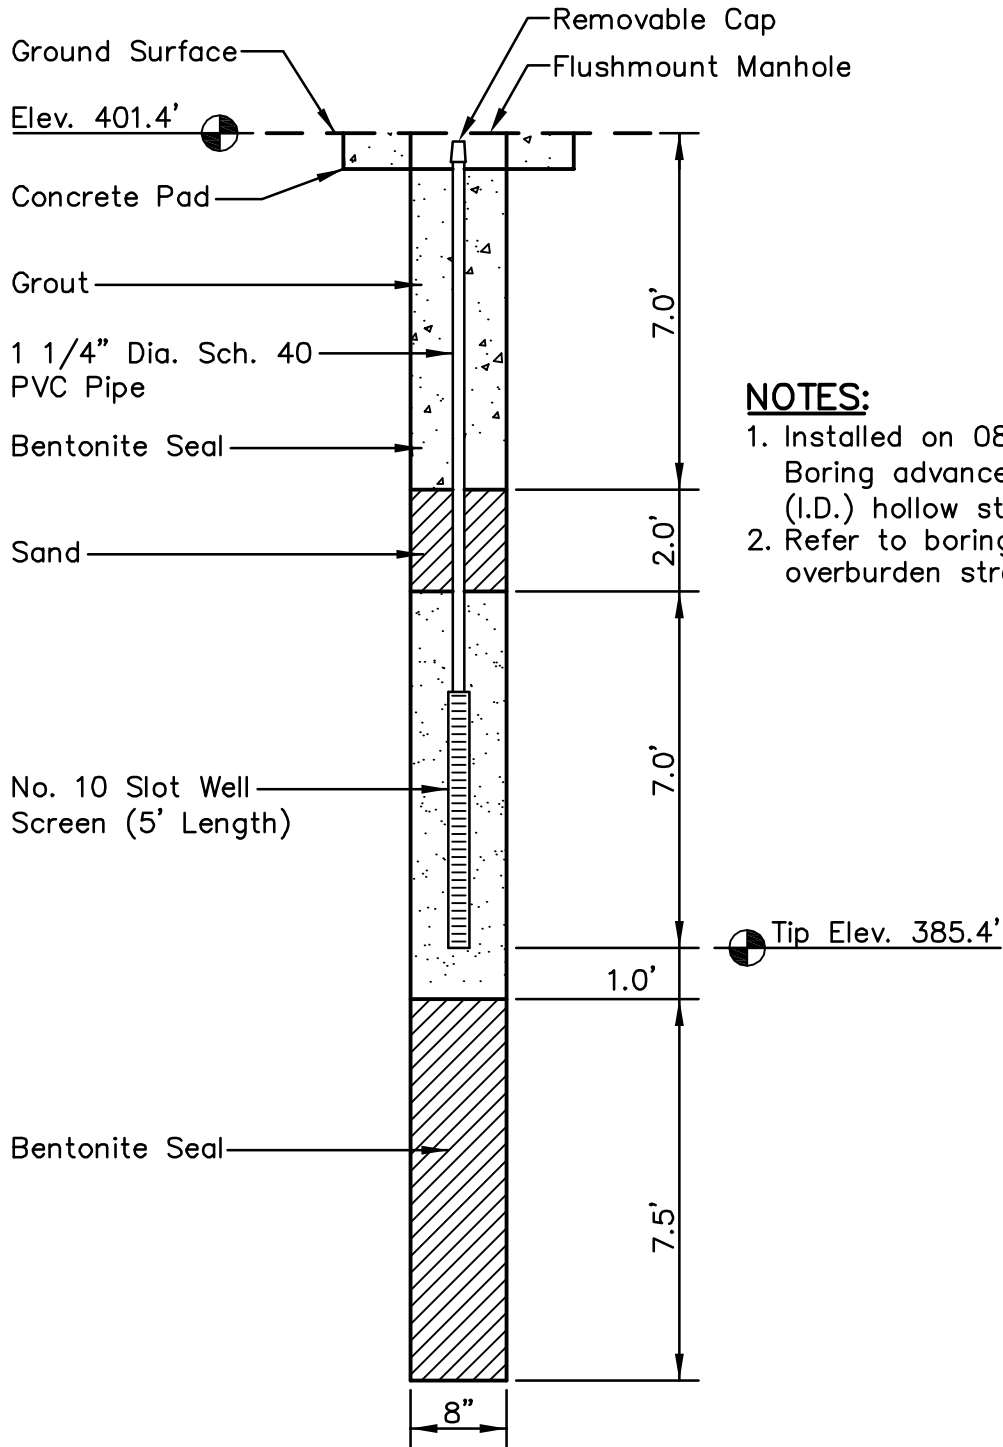

**NOTES:**

1. Installed on 08/25/2009. Boring advanced with 4.25" (I.D.) hollow stem augers.
2. Refer to boring log for overburden stratigraphy.

**LOCATION:**

Northing: 334,110.95  
 Easting: 1,642,925.61  
 Ground Elevation: 401.4 feet

Locations to be provided by TVA, Power Systems Operations, Surveying and Project Services.

Horizontal Datum: NAD 27  
 Vertical Datum: NGVD29

**PIEZOMETER STN-7  
 GEOTECHNICAL EXPLORATION  
 PEABODY ASH POND**




**Stantec**

Stantec Consulting Services Inc.  
 1409 N. Forbes Rd.  
 Lexington, Kentucky  
 40511-2050  
 859-422-3000  
 www.stantec.com

DRAWN BY	JRF	DATE	DEC., 2009	REVISED	
CHECKED BY	JTB	PROJ. NO.	175569069	1.	3.
CHECKED BY	SV	SCALE	NTS	2.	4.

SHEET  
**1 OF 1**

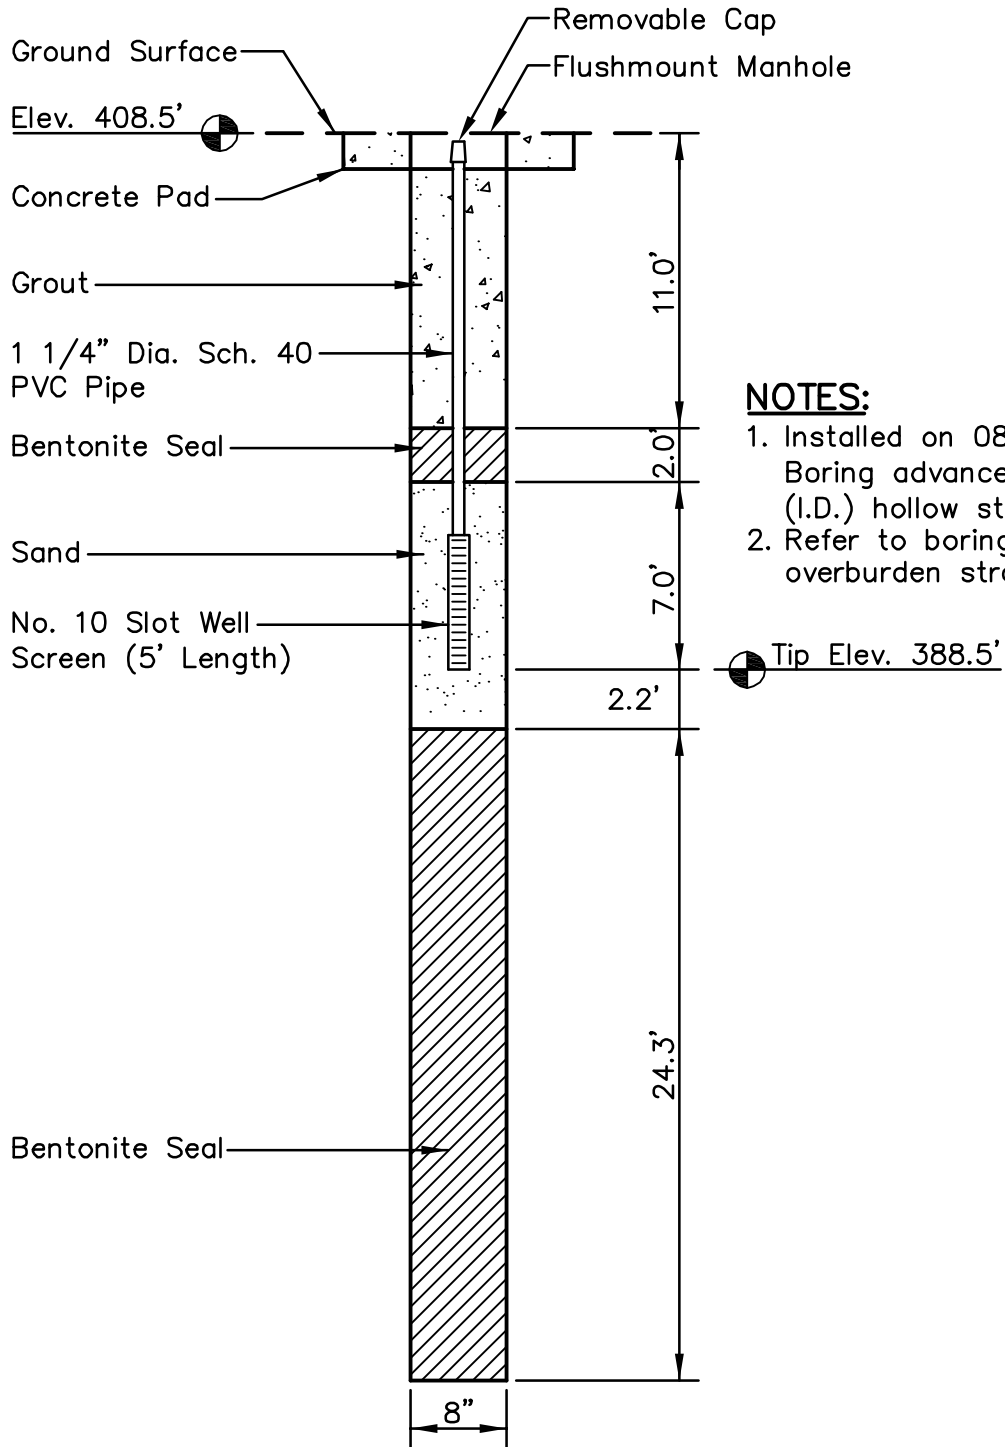

**NOTES:**

1. Installed on 08/18/2009. Boring advanced with 4.25" (I.D.) hollow stem augers.
2. Refer to boring log for overburden stratigraphy.

**LOCATION:**

Northing: 332,482.84  
 Easting: 1,642,158.00  
 Ground Elevation: 408.5 feet

Locations to be provided by  
 TVA, Power Systems  
 Operations, Surveying and  
 Project Services.  
 Horizontal Datum: NAD 27  
 Vertical Datum: NGVD29

**PIEZOMETER STN-12**  
**GEOTECHNICAL EXPLORATION**  
**PEABODY ASH POND**




Stantec

**Stantec Consulting  
 Services Inc.**  
 1409 N. Forbes Rd.  
 Lexington, Kentucky  
 40511-2050  
 859-422-3000  
 www.stantec.com

DRAWN BY	JRF	DATE	DEC., 2009	REVISED	
CHECKED BY	JTB	PROJ. NO.	175569069	1.	3.
CHECKED BY	SV	SCALE	NTS	2.	4.

SHEET  
 1 OF 1

PLOT DATE: 11/17/2009 USER: ELLISON, DOC  
 V: 1755\ACTIVE\175569069\GEO\TECHNICAL\DRAWING\INSTRUMENT\69060C-PAF-301-PZ12.DWG

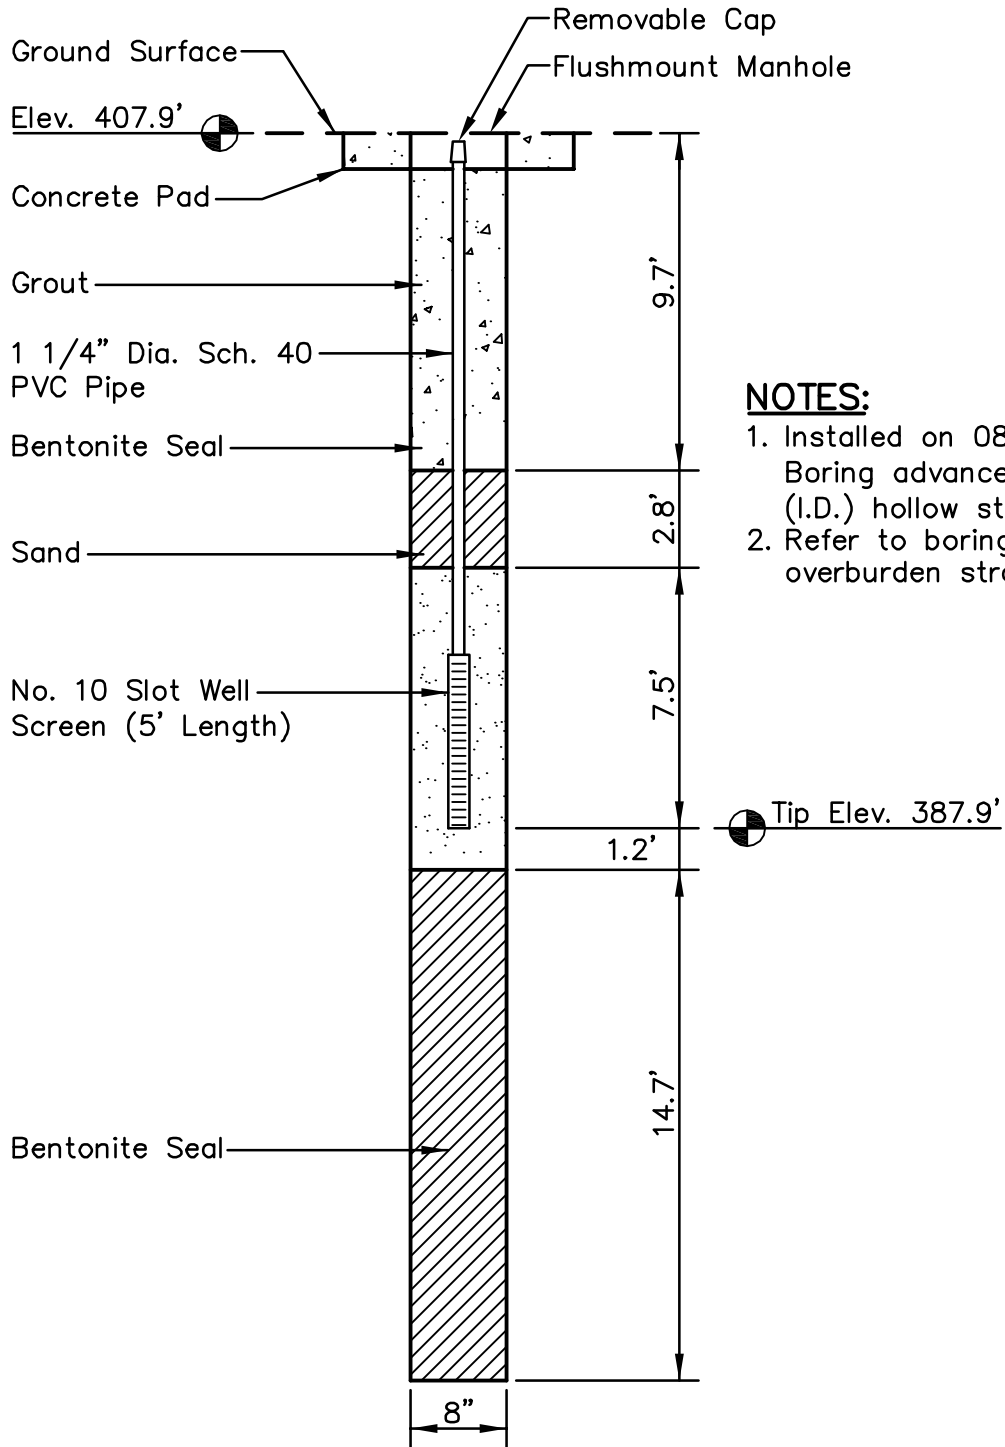

**NOTES:**

1. Installed on 08/26/2009. Boring advanced with 4.25" (I.D.) hollow stem augers.
2. Refer to boring log for overburden stratigraphy.

**LOCATION:**

Northing: 331,736.99  
 Easting: 1,641,846.45  
 Ground Elevation: 407.9 feet

Locations to be provided by  
 TVA, Power Systems  
 Operations, Surveying and  
 Project Services.

Horizontal Datum: NAD 27  
 Vertical Datum: NGVD29

**PIEZOMETER STN-15**  
**GEOTECHNICAL EXPLORATION**  
**PEABODY ASH POND**




Stantec

**Stantec Consulting  
 Services Inc.**  
 1409 N. Forbes Rd.  
 Lexington, Kentucky  
 40511-2050  
 859-422-3000  
 www.stantec.com

DRAWN BY	JRF	DATE	DEC., 2009	REVISED	
CHECKED BY	JTB	PROJ. NO.	175569069	1.	3.
CHECKED BY	SV	SCALE	NTS	2.	4.

SHEET  
**1 OF 1**

PLOT DATE: 11/17/2009 USER: ELLISON, DOC  
 V: 1755\ACTIVE\175569069\GEO\TECHNICAL\DRAWING\INSTRUMENT\69060C-PAF-301-PZ15.DWG

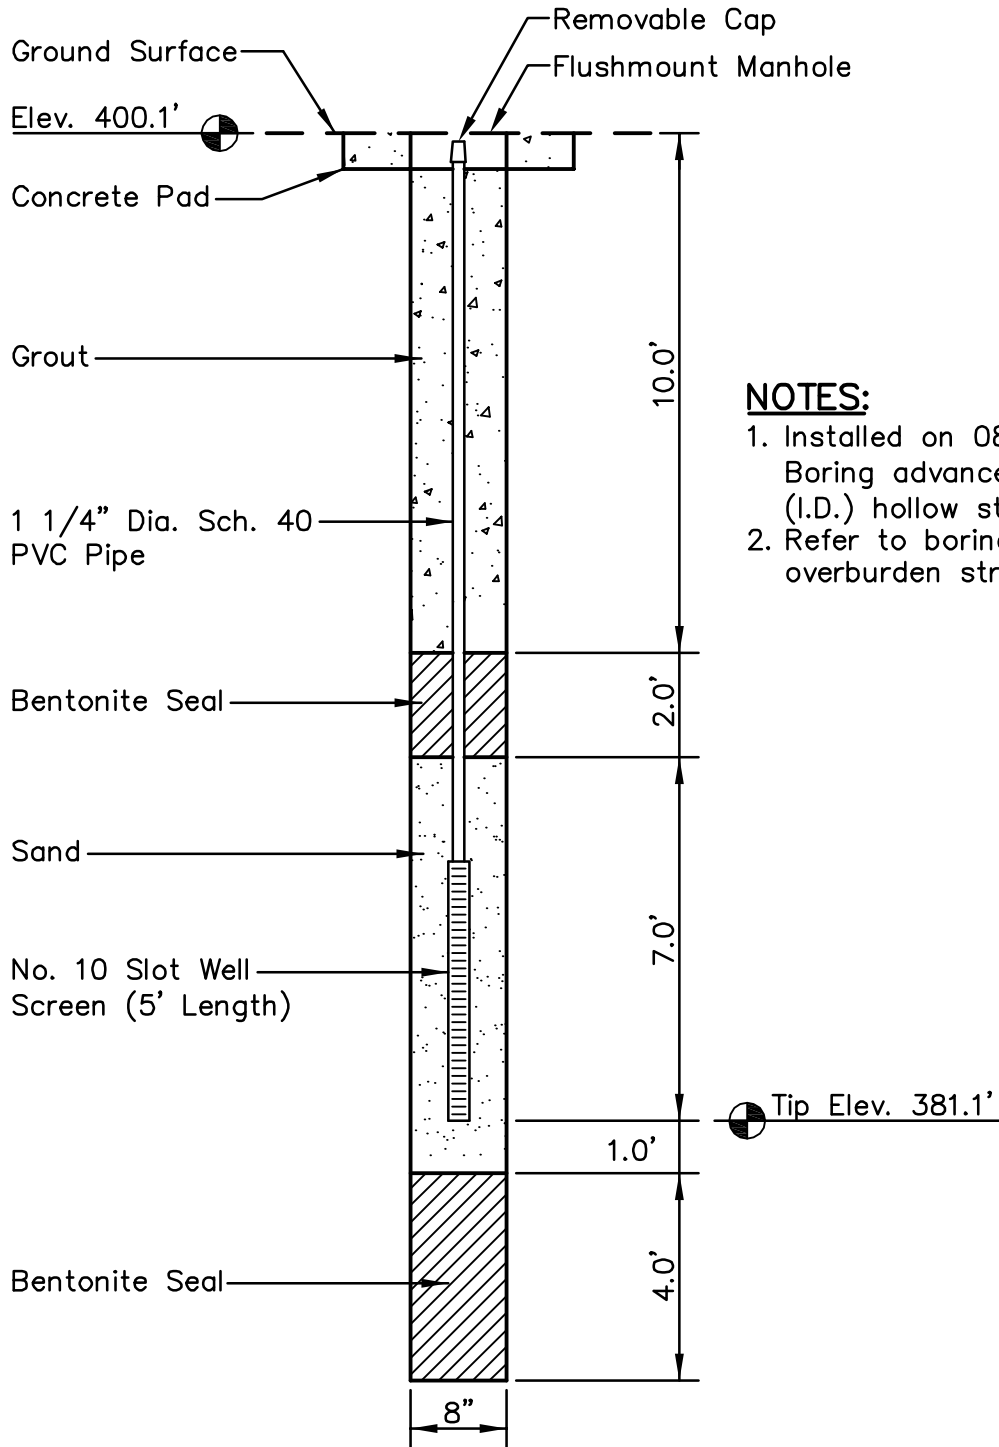

**NOTES:**

1. Installed on 08/25/2009. Boring advanced with 4.25" (I.D.) hollow stem augers.
2. Refer to boring log for overburden stratigraphy.

**LOCATION:**

Northing: 331,729.49  
 Easting: 1,641,903.96  
 Ground Elevation: 400.1 feet

Locations to be provided by  
 TVA, Power Systems  
 Operations, Surveying and  
 Project Services.

Horizontal Datum: NAD 27  
 Vertical Datum: NGVD29

**PIEZOMETER STN-16**  
**GEOTECHNICAL EXPLORATION**  
**PEABODY ASH POND**




Stantec

**Stantec Consulting  
 Services Inc.**  
 1409 N. Forbes Rd.  
 Lexington, Kentucky  
 40511-2050  
 859-422-3000  
 www.stantec.com

DRAWN BY	JRF	DATE	DEC., 2009	REVISED	
CHECKED BY	JTB	PROJ. NO.	175569069	1.	3.
CHECKED BY	SV	SCALE	NTS	2.	4.

SHEET  
**1 OF 1**

PLOT DATE: 11/17/2009 USER: ELLISON, DOC  
 V: \1755\ACTIVE\175569069\GEO\TECHNICAL\DRAWING\INSTRUMENT\69060C-PAF-301-PZ16.DWG

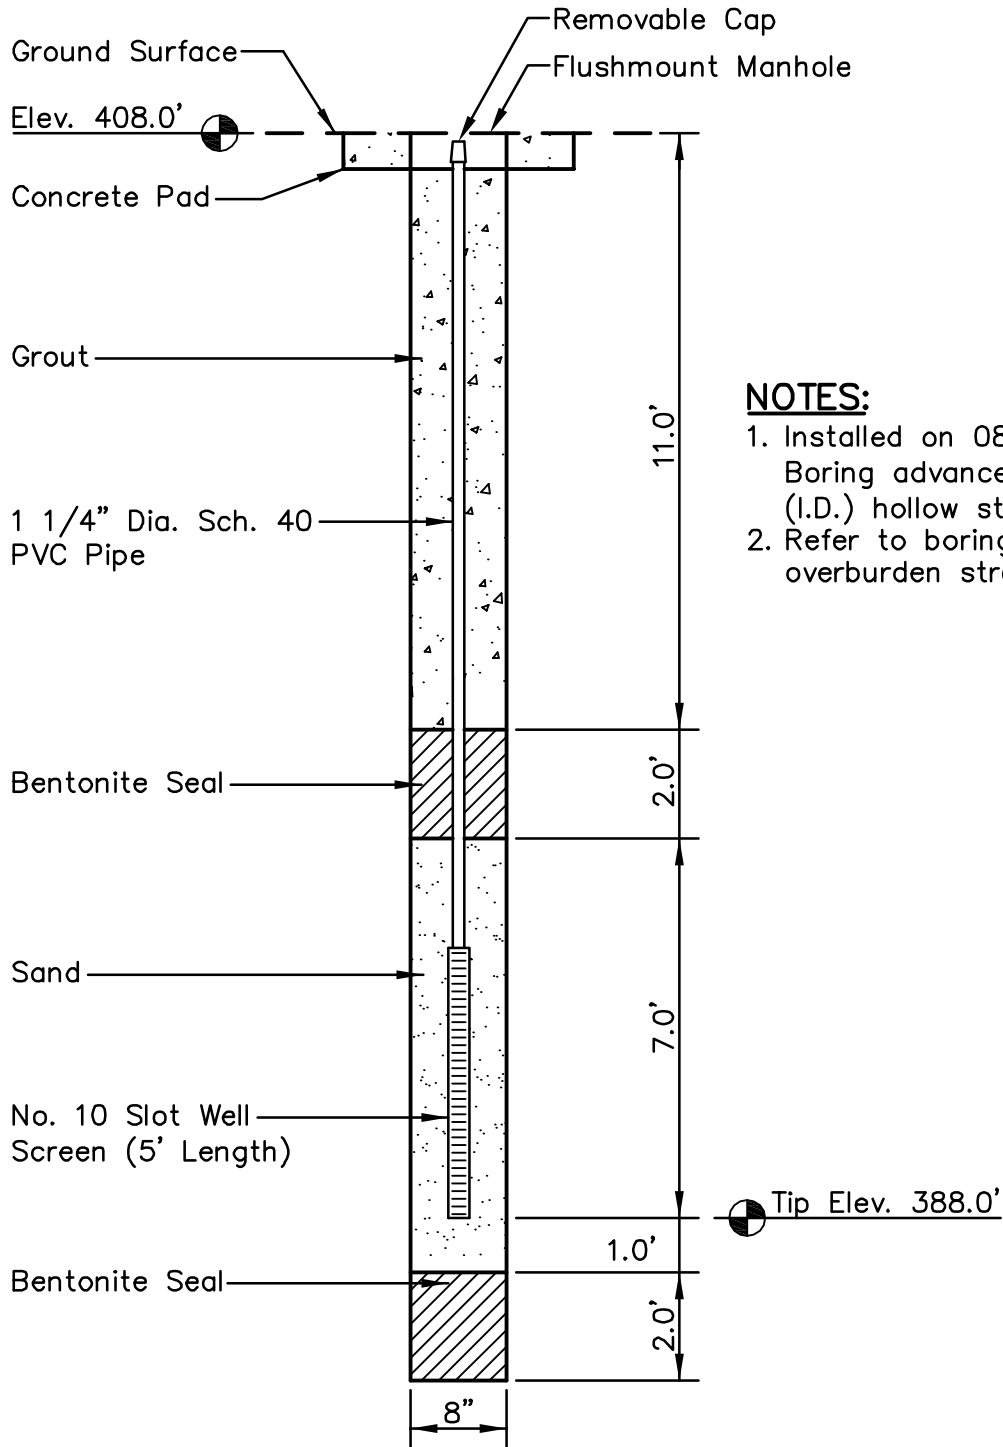

**NOTES:**

1. Installed on 08/15/2009. Boring advanced with 4.25" (I.D.) hollow stem augers.
2. Refer to boring log for overburden stratigraphy.

**LOCATION:**

Northing: 331,767.22  
 Easting: 1,641,030.49  
 Ground Elevation: 408.0 feet

Locations to be provided by TVA, Power Systems Operations, Surveying and Project Services.

Horizontal Datum: NAD 27  
 Vertical Datum: NGVD29

**PIEZOMETER STN-18  
 GEOTECHNICAL EXPLORATION  
 PEABODY ASH POND**




**Stantec**

Stantec Consulting Services Inc.  
 1409 N. Forbes Rd.  
 Lexington, Kentucky  
 40511-2050  
 859-422-3000  
 www.stantec.com

DRAWN BY	JRF	DATE	DEC., 2009	REVISED	
CHECKED BY	JTB	PROJ. NO.	175569069	1.	3.
CHECKED BY	SV	SCALE	NTS	2.	4.

SHEET  
**1 OF 1**

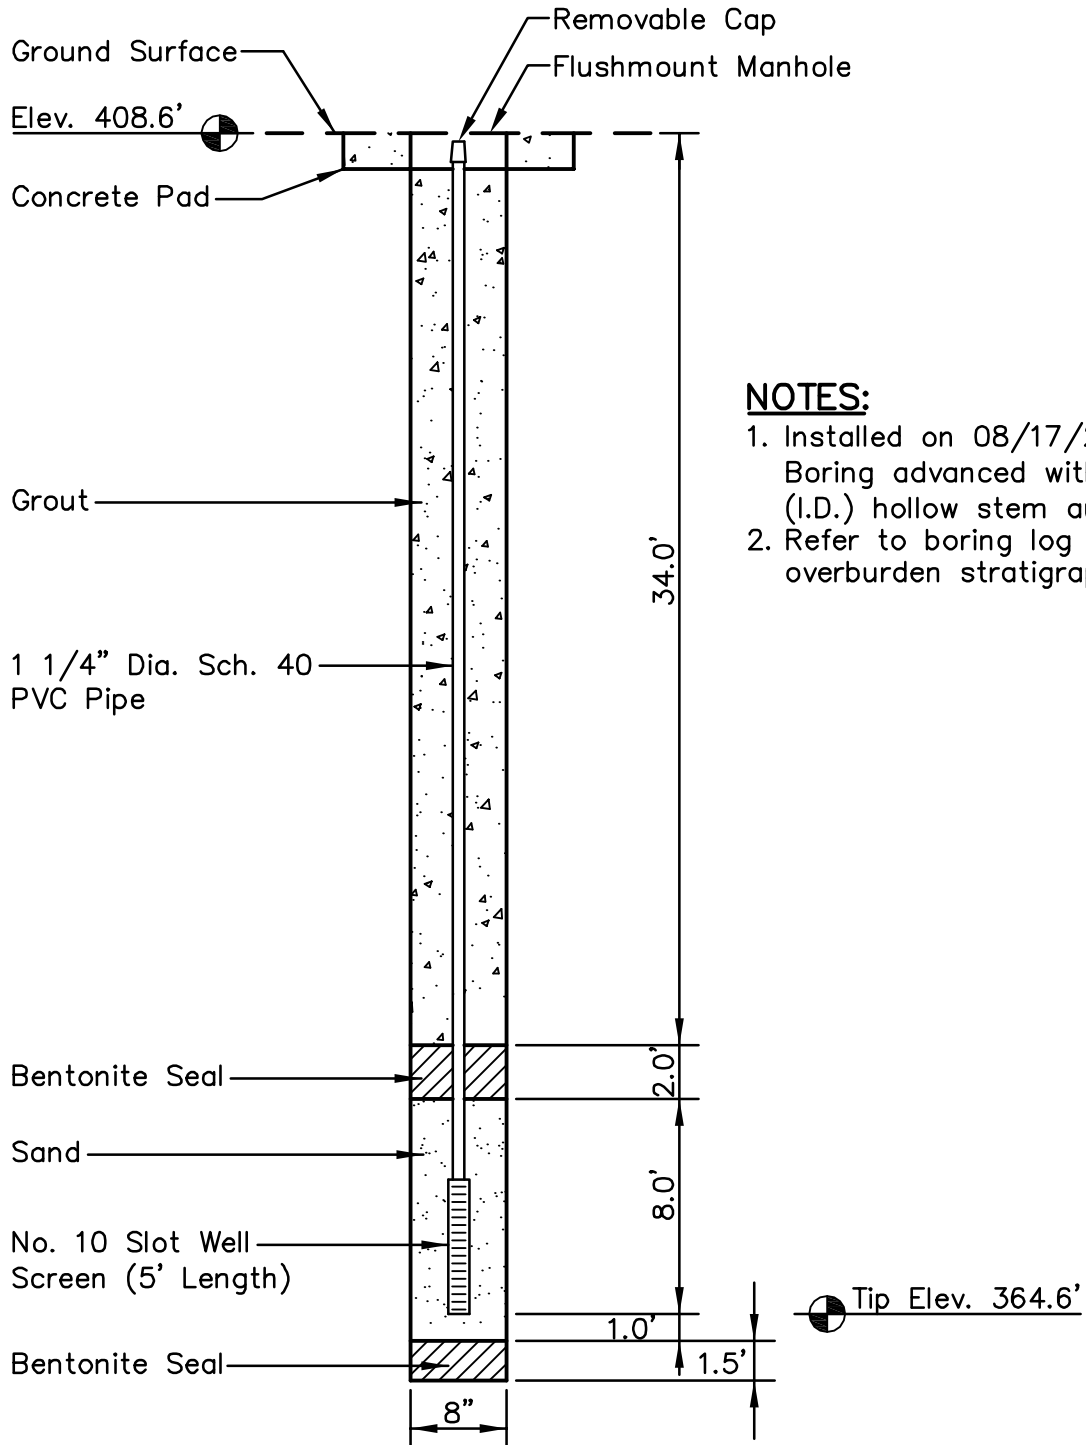

**NOTES:**

1. Installed on 08/17/2009. Boring advanced with 4.25" (I.D.) hollow stem augers.
2. Refer to boring log for overburden stratigraphy.

**LOCATION:**

Northing: 331,553.80  
 Easting: 1,640,209.81  
 Ground Elevation: 408.6 feet

Locations to be provided by  
 TVA, Power Systems  
 Operations, Surveying and  
 Project Services.

Horizontal Datum: NAD 27  
 Vertical Datum: NGVD29

**PIEZOMETER STN-21**  
**GEOTECHNICAL EXPLORATION**  
**PEABODY ASH POND**




Stantec

**Stantec Consulting  
 Services Inc.**  
 1409 N. Forbes Rd.  
 Lexington, Kentucky  
 40511-2050  
 859-422-3000  
 www.stantec.com

DRAWN BY	JRF	DATE	DEC., 2009	REVISED	
CHECKED BY	JTB	PROJ. NO.	175569069	1.	3.
CHECKED BY	SV	SCALE	NTS	2.	4.

SHEET  
**1 OF 1**

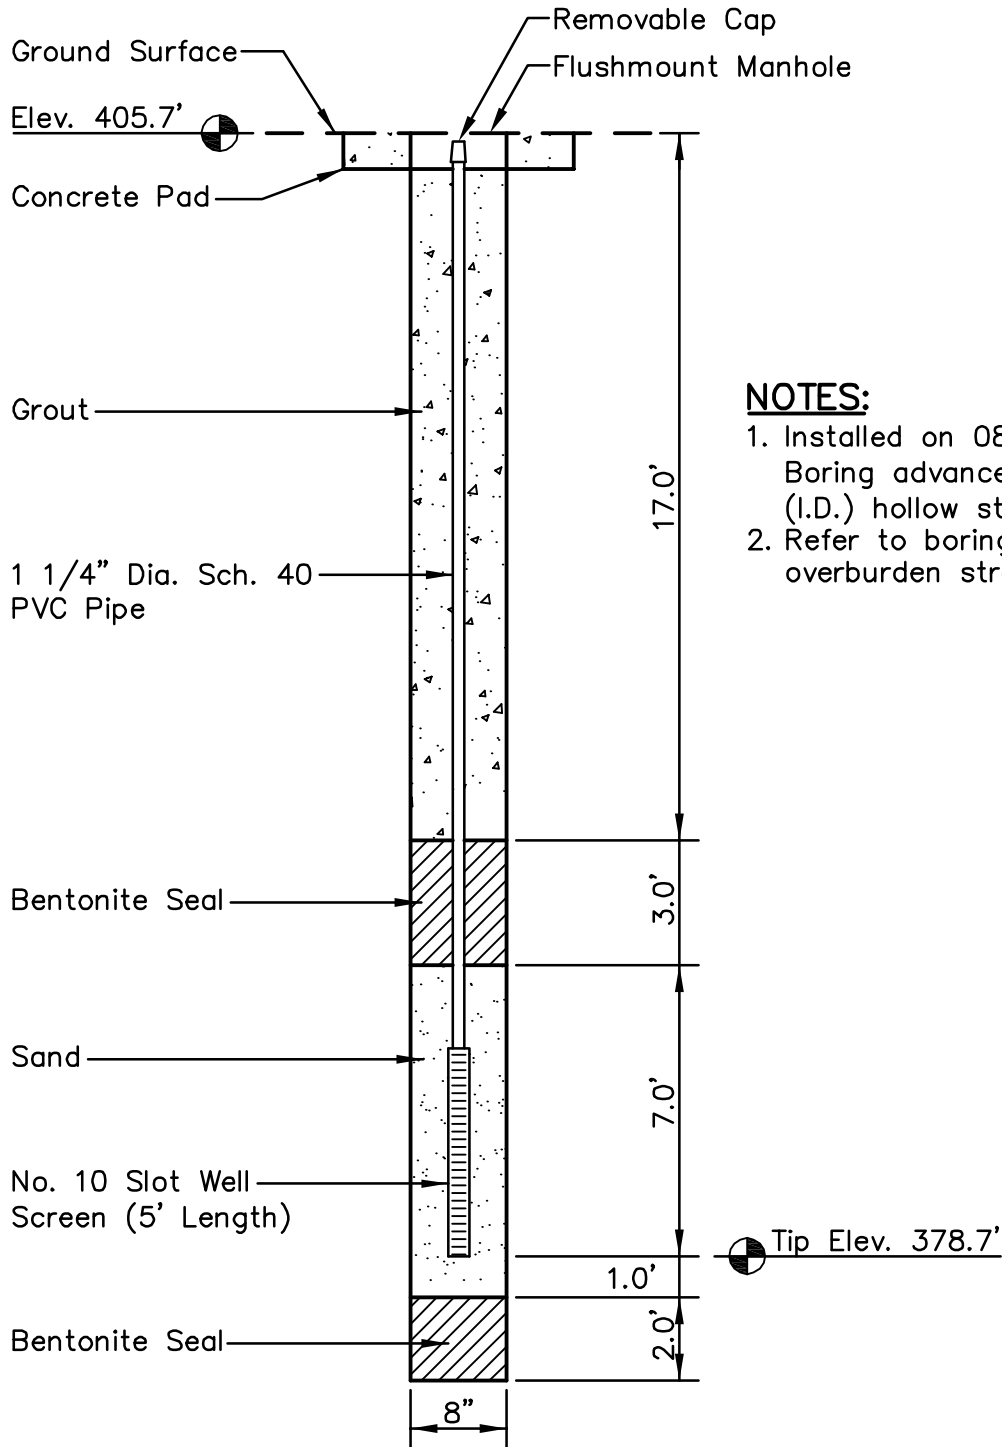

**NOTES:**

1. Installed on 08/24/2009. Boring advanced with 4.25" (I.D.) hollow stem augers.
2. Refer to boring log for overburden stratigraphy.

**LOCATION:**

Northing: 331,536.19  
 Easting: 1,640,178.58  
 Ground Elevation: 405.7 feet

Locations to be provided by  
 TVA, Power Systems  
 Operations, Surveying and  
 Project Services.

Horizontal Datum: NAD 27  
 Vertical Datum: NGVD29

**PIEZOMETER STN-22**  
**GEOTECHNICAL EXPLORATION**  
**PEABODY ASH POND**



Stantec

**Stantec Consulting Services Inc.**  
 1409 N. Forbes Rd.  
 Lexington, Kentucky  
 40511-2050  
 859-422-3000  
 www.stantec.com


DRAWN BY	JRF	DATE	DEC., 2009	REVISED	
CHECKED BY	JTB	PROJ. NO.	175569069	1.	3.
CHECKED BY	SV	SCALE	NTS	2.	4.

SHEET  
**1 OF 1**

## Appendix D

### Graphical Logs of Borings



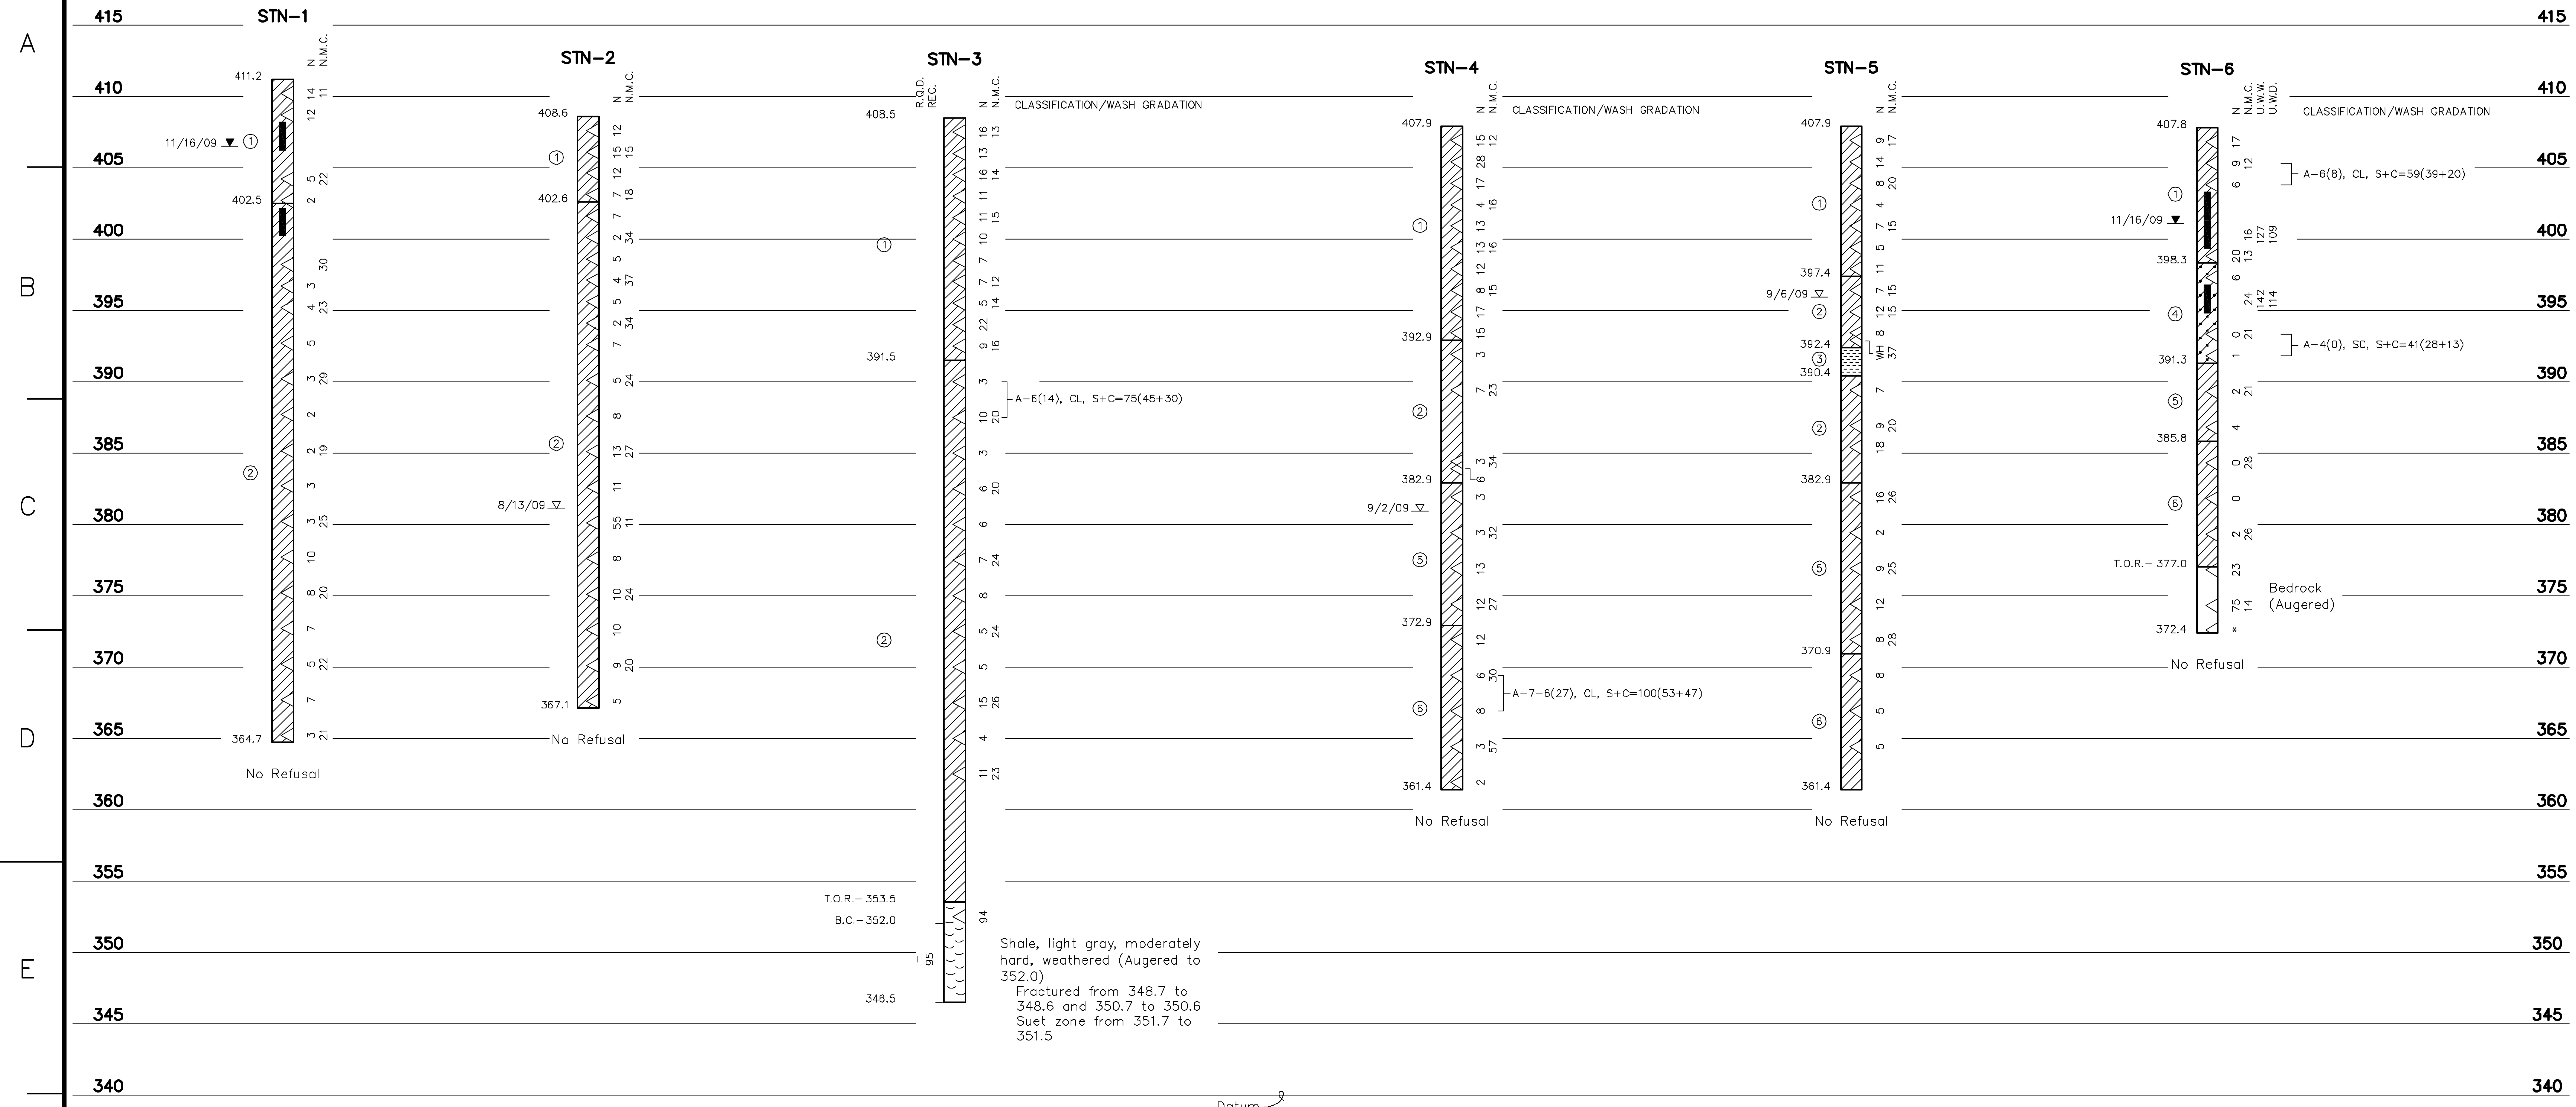

- LEGEND**
- ① MINESPOIL: Lean clay with intermediate sand lenses, brown to gray with some reddish mottling, moist to wet, soft to very stiff and with heterogeneous mixture of coal, shale, and chert fragments
  - ② MINESPOIL: Lean clay with sand, olive gray to grayish brown with intermittent orange mottling, moist to wet, stiff to very stiff and with heterogeneous mixture of coal, shale, and chert fragments
  - ③ BOTTOM ASH: Bottom ash with sand, black to dark brown, wet, loose to very loose and with fine to gravel sized coal fragments
  - ④ Clayey sand, brown to grayish brown, moist to wet and loose to medium dense
  - ⑤ Lean clay, light to dark brown with orange mottling, moist to wet, soft to stiff and with occasional chert fragments
  - ⑥ Silty clay, gray to brownish gray with some orange mottling, moist to wet, very soft to stiff, with some silt and traces of sand and occasional traces of coal and chert fragments
- WH Weight of Hammer  
 ▽ Standard Penetration Test Interval  
 ▴ Undisturbed Thin-Walled (Shelby) Tube Sample  
 N Standard Penetration Test Blow Count (blows/ft.)  
 N.M.C. Natural Moisture Content (%)  
 U.W.W. Unit Weight Wet (lbs./cu.ft.)  
 U.W.D. Unit Weight Dry (lbs./cu.ft.)  
 U.C./U.U. Unconfined Compressive Strength (psf) / Unconsolidated Undrained Triaxial Test (psf)  
 8/11/09 ▽ Water Level 30 minutes after Drilling and Date Recorded  
 11/16/09 ▽ Water Level and Date Recorded  
 T.O.R.— Top of Rock (Indicates the beginning of rock-like resistance to the advancement of the augers. This may indicate the beginning of weathered bedrock, boulders or rock remnants. An exact determination cannot be made without performing rock coring.)  
 B.C.— Begin Rock Core  
 R.Q.D. Rock Quality Designation (%)  
 REC. Recovery (%)  
 Refusal Auger Refusal using a carbide-tipped tooth auger bit  
 No Refusal No Refusal Encountered  
 \* Standard Penetration Test (SPT) terminated per ASTM D 1586-99. Refer to typed boring log.



**NOTE:**  
 The subsurface soil horizons in between borings and beyond borings are in general based on straight line interpolation and straight line extension, respectively. The ground line shown below water (down stream side) is also approximate. No hydrographic survey of down stream pool was performed. No warranties can be made regarding the continuity of conditions between and beyond borings.

Shale, light gray, moderately hard, weathered (Augered to 352.0)  
 Fractured from 348.7 to 348.6 and 350.7 to 350.6  
 Suet zone from 351.7 to 351.5

**LOGS OF BORINGS**  
 SCALE: 1"=5' (VERTICAL ONLY)

**ISSUED FOR REVIEW**  
**NOT FOR CONSTRUCTION**

For Supporting Design Calculations see		R - - - - -												
ISSUED FOR REVIEW		R 0	12/22/09	SV	JRF	AM	SV	SV	SV	TJ	-	-	-	-
SCALE: 1"=5' (VERTICAL ONLY)		EXCEPT AS NOTED												
YARD														
PEABODY ASH POND														
GEOTECHNICAL EXPLORATION														
LOGS OF BORINGS														
DESIGNED BY:	DRAWN BY:	CHECKED BY:	SUPERVISED BY:	REVIEWED BY:	APPROVED BY:	ISSUED BY:								
S. VEMURI	R. FLYNN	A. MORGAN	S. VEMURI	S. VEMURI	S. VEMURI	T. JOHNSON								
Stantec Consulting Services Inc.		PARADISE FOSSIL PLANT												
1409 N. Forbes Rd.		TENNESSEE VALLEY AUTHORITY												
Lexington, Kentucky		FOSSIL AND HYDRO ENGINEERING												
40511-2050														
Tel: 858.422.3000														
Fax: 858.422.3100														
www.stantec.com														
AUTOCAD R 2000	DATE	SCALE	PLT	NO.	PROJECT NO.		AS CONST.		REV.					
	12/22/09	64: C			XXWXXX-00		R 0							

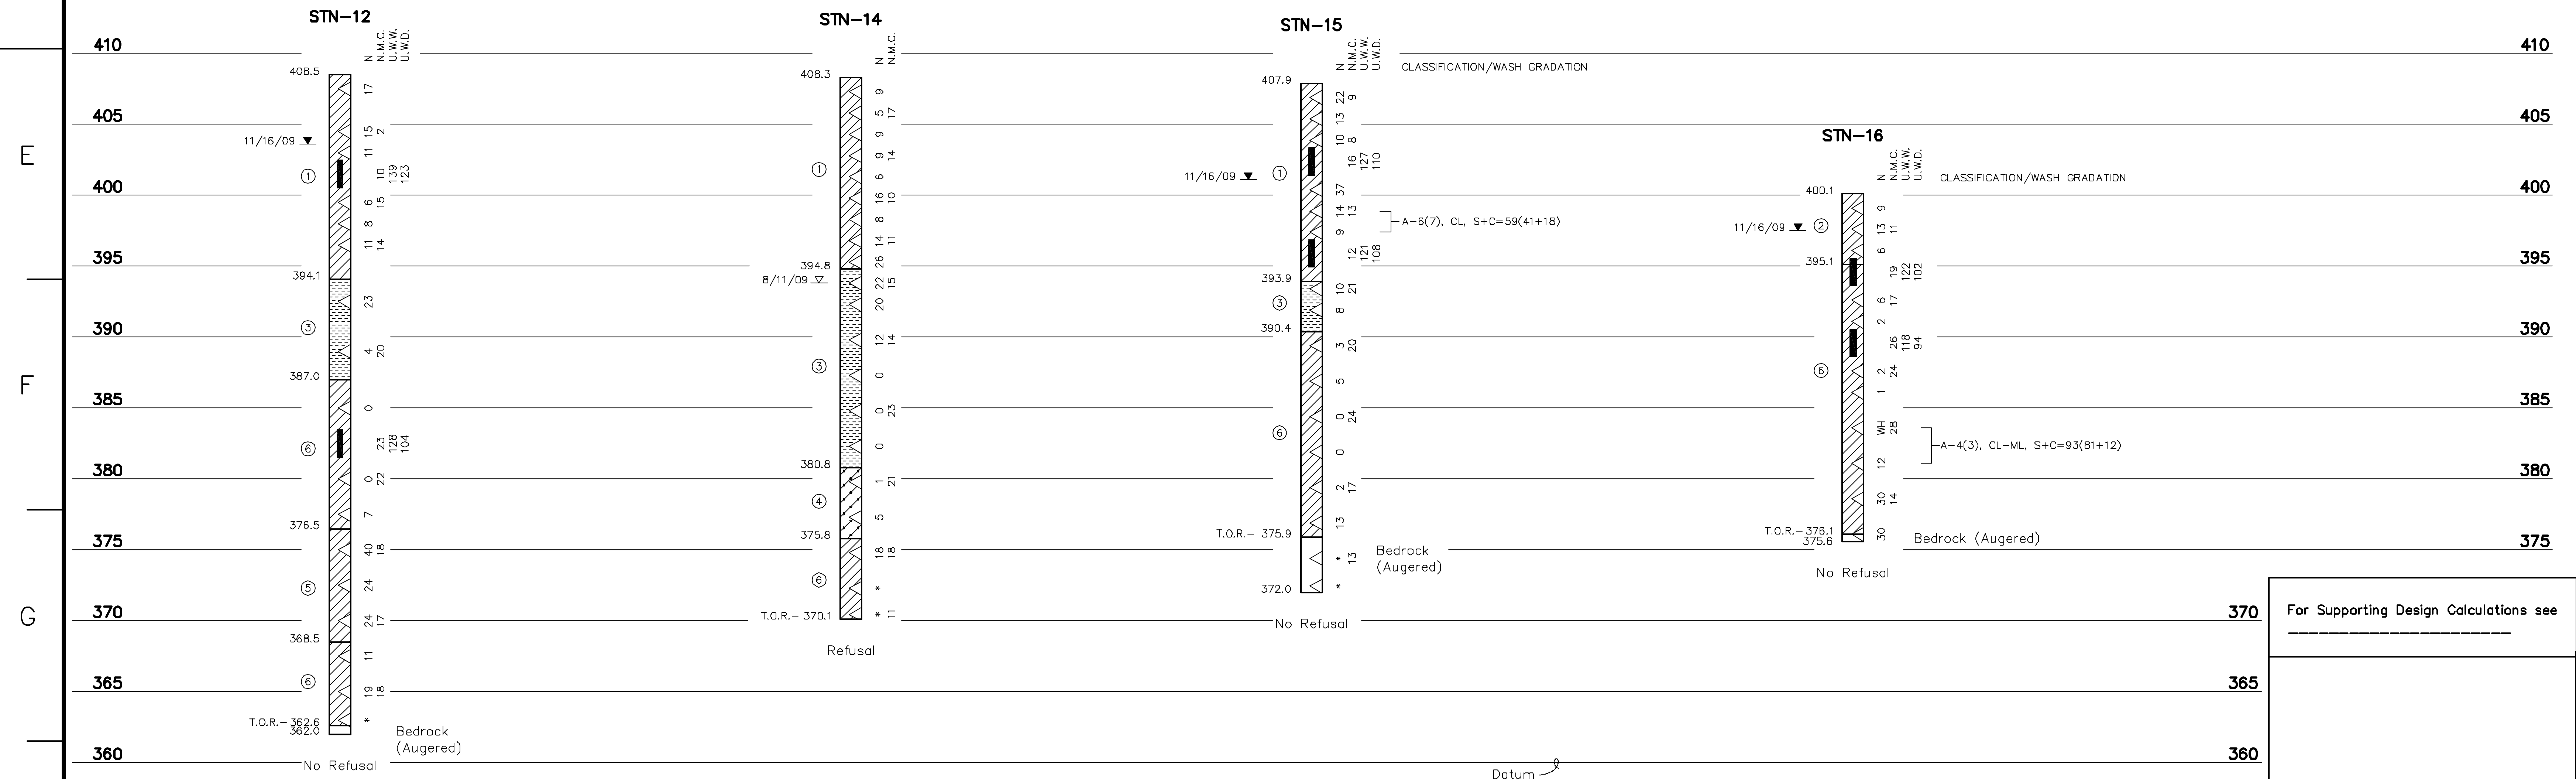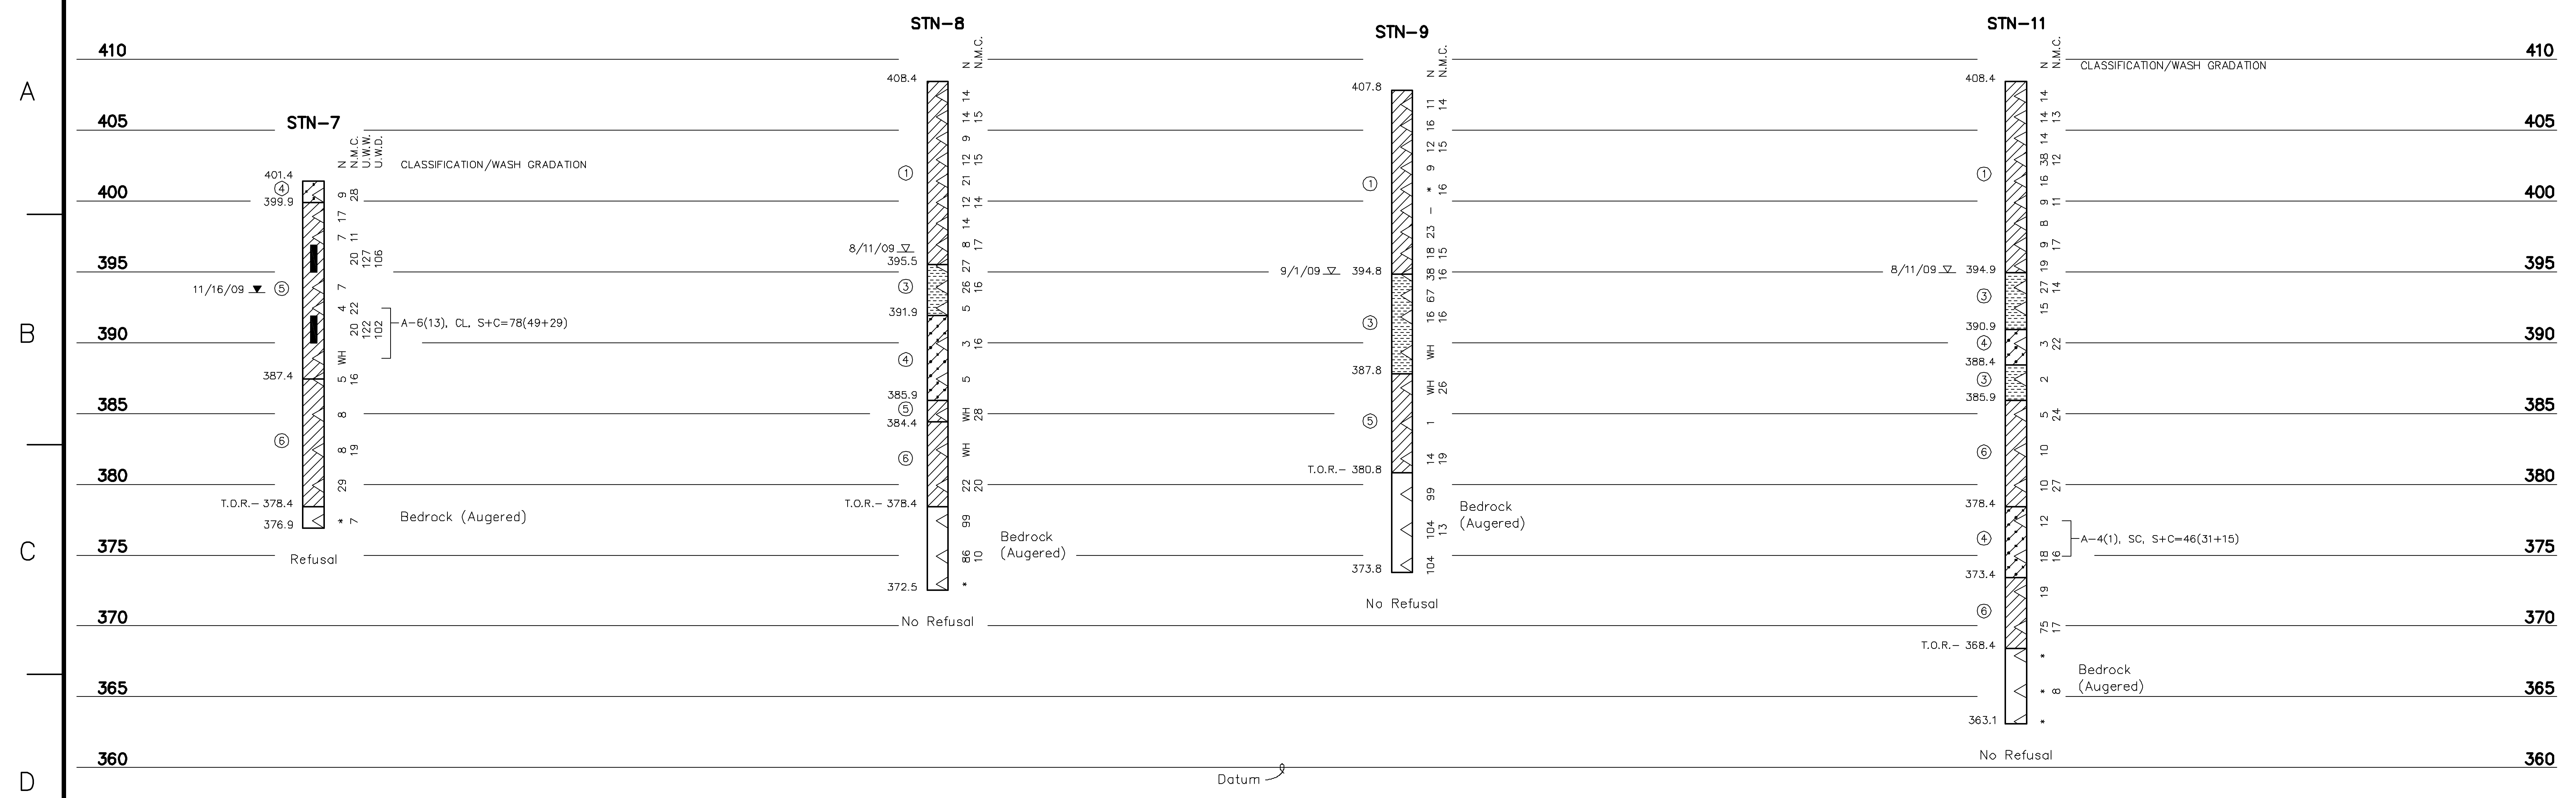

**LEGEND**

- ① MINESPOL: Lean clay with intermediate sand lenses, brown to gray with some reddish mottling, moist to wet, soft to very stiff and with heterogeneous mixture of coal, shale, and chert fragments
- ② MINESPOL: Lean clay with sand, olive gray to grayish brown with intermittent orange mottling, moist to wet, stiff to very stiff and with heterogeneous mixture of coal, shale, and chert fragments
- ③ BOTTOM ASH: Bottom ash with sand, black to dark brown, wet, loose to very loose and with fine to gravel sized coal fragments
- ④ Clayey sand, brown to grayish brown, moist to wet and loose to medium dense
- ⑤ Lean clay, light to dark brown with orange mottling, moist to wet, soft to stiff and with occasional chert fragments
- ⑥ Silty clay, gray to brownish gray with some orange mottling, moist to wet, very soft to stiff, with some silt and traces of sand and occasional traces of coal and chert fragments

WH Weight of Hammer  
 ◻ Standard Penetration Test Interval  
 ◻ Undisturbed Thin-Walled (Shelby) Tube Sample  
 N Standard Penetration Test Blow Count (blows/ft.)  
 N.M.C. Natural Moisture Content (%)  
 U.W.W. Unit Weight Wet (lbs./cu.ft.)  
 U.W.D. Unit Weight Dry (lbs./cu.ft.)  
 U.C./U.U. Unconfined Compressive Strength (psf)/ Unconsolidated Undrained Triaxial Test (psf)

8/11/09 ▽ Water Level 30 minutes after Drilling and Date Recorded  
 11/16/09 ▽ Water Level and Date Recorded  
 T.O.R.— Top of Rock (Indicates the beginning of rock-like resistance to the advancement of the augers. This may indicate the beginning of weathered bedrock, boulders or rock remnants. An exact determination cannot be made without performing rock coring.)  
 B.C.— Begin Rock Core  
 R.Q.D. Rock Quality Designation (%)  
 REC. Recovery (%)  
 Refusal Auger Refusal using a carbide-tipped tooth auger bit  
 No Refusal No Refusal Encountered  
 \* Standard Penetration Test (SPT) terminated per ASTM D 1586-99. Refer to typed boring log.

**NOTE:**  
 The subsurface soil horizons in between borings and beyond borings are in general based on straight line interpolation and straight line extension, respectively. The ground line shown below water (down stream side) is also approximate. No hydrographic survey of down stream pool was performed. No warranties can be made regarding the continuity of conditions between and beyond borings.

**ISSUED FOR REVIEW  
 NOT FOR CONSTRUCTION**

For Supporting Design Calculations see									
YARD									
PEABODY ASH POND GEOTECHNICAL EXPLORATION LOGS OF BORINGS									
DESIGNED BY:	DRAWN BY:	CHECKED BY:	SUPERVISED BY:	REVIEWED BY:	APPROVED BY:	ISSUED BY:			
S. VEMURI	R. FLYNN	A. MORGAN	S. VEMURI	S. VEMURI	S. VEMURI	T. JOHNSON			
PARADISE FOSSIL PLANT TENNESSEE VALLEY AUTHORITY FOSSIL AND HYDRO ENGINEERING									
AUTOCAD R 2000	DATE	SCALE	PROJECT NO.	AS CONST.	REV.				
	12/22/09	64: C	XXWXXX-00						

**LOGS OF BORINGS**  
 SCALE: 1"=5' (VERTICAL ONLY)



Stantec Consulting Services Inc.  
 1409 N. Forbes Rd.  
 Lexington, Kentucky 40511-2950  
 Tel: 859.422.3000  
 Fax: 859.422.3100  
 www.stantec.com



Appendix E

Typical Cross Section



Appendix F

Piezometer Readings



**PIEZOMETER  
Summary Report**

Paradise Fossil Plant:

Peabody Pond

13246 State Route 176

175569069

		9/21/2009				10/20/2009			
Location	Piezometer	Surface Elevation (ft)	Stickup (ft)	Depth Measurement (ft)	Water Elevation (ft)	Surface Elevation (ft)	Stickup (ft)	Depth Measurement (ft)	Water Elevation (ft)
STN-1	STN-1	411.2	-0.2	--	--	411.2	-0.2	4.3	406.7
STN-6	STN-6	407.8	-0.2	6.4	401.3	407.8	-0.2	6.5	401.1
STN-7	STN-7	401.4	-0.2	7.7	393.5	401.4	-0.2	11.4	389.8
STN-12	STN-12	408.5	-0.2	--	--	408.5	-0.2	4.7	403.6
STN-15	STN-15	407.9	-0.2	6.3	401.4	407.9	-0.2	6.5	401.2
STN-16	STN-16	400.1	-0.2	2.5	397.4	400.1	-0.2	2.0	397.9
STN-18	STN-18	408.0	-0.2	--	--	408.0	-0.2	6.4	401.5
STN-21	STN-21	408.6	-0.2	6.1	402.3	408.6	-0.2	6.8	401.6
STN-22	STN-22	405.7	-0.3	4.8	400.7	405.7	-0.3	3.8	401.6



**PIEZOMETER  
Summary Report**

Paradise Fossil Plant:

Peabody Pond

13246 State Route 176

175569069

		11/16/2009				12/13/2009			
Location	Piezometer	Surface Elevation (ft)	Stickup (ft)	Depth Measurement(ft)	Water Elevation (ft)	Surface Elevation (ft)	Stickup (ft)	Depth Measurement (ft)	Water Elevation (ft)
STN-1	STN-1	411.1	-0.2	4.4	406.5	411.1	-0.2	5.0	405.9
STN-6	STN-6	407.8	-0.2	6.6	401.1	407.8	-0.2	6.7	400.9
STN-7	STN-7	401.4	-0.2	7.7	393.5	401.4	-0.2	7.3	393.9
STN-12	STN-12	408.5	-0.2	4.7	403.6	408.5	-0.2	4.7	403.6
STN-15	STN-15	407.9	-0.2	6.6	401.1	407.9	-0.2	6.5	401.2
STN-16	STN-16	400.1	-0.2	2.3	397.5	400.1	-0.2	1.9	398.0
STN-18	STN-18	408.0	-0.2	6.2	401.7	408.0	-0.2	6.5	401.4
STN-21	STN-21	408.6	-0.2	7.1	401.2	408.6	-0.2	6.9	401.5
STN-22	STN-22	405.7	-0.3	4.0	401.5	405.7	-0.3	3.9	401.5





**PIEZOMETER  
Summary Report**

Paradise Fossil Plant:

Peabody Pond

13246 State Route 176

175569069

		1/18/2010			
Location	Piezometer	Surface Elevation (ft)	Stickup (ft)	Depth Measurement (ft)	Water Elevation (ft)
STN-1	STN-1	411.1	-0.2	5.4	405.5
STN-6	STN-6	407.8	-0.2	6.8	400.8
STN-7	STN-7	401.4	-0.2	8.8	392.4
STN-12	STN-12	408.5	-0.2	4.6	403.7
STN-15	STN-15	407.9	-0.2	6.4	401.3
STN-16	STN-16	400.1	-0.2	2.2	397.6
STN-18	STN-18	408.0	-0.2	6.6	401.3
STN-21	STN-21	408.6	-0.2	6.9	401.5
STN-22	STN-22	405.7	-0.2	4.0	401.6

## Appendix G

### Results of Laboratory Testing



# Moisture Content of Soil

ASTM D 2216

Project Name **TVA- PAF Peabody Ash Pond**

Project Number **175569069**

Tested By **JF**

Test Method **ASTM**

Maximum Particle Size in Sample	No. 10	No. 4	3/8"	3/4"	1 1/2"	3"
Recommended Minimum Mass (g)	20	100	500	2,500	10,000	50,000

Material Type: Stratified, Laminated, Lensed, Homogeneous

Source	Lab ID	Date Tested	Material Type	Maximum Particle Size	Material Excluded Amount	Material Excluded Size	Pass Min. Mass? (Y/N)	Can Weight (g)	Wet Soil & Can Weight (g)	Dry Soil & Can Weight (g)	Moisture Content (%)
STN-1, 0.0'-1.5'	1	10/29/09	Hom	3/8"			No	44.98	137.06	128.02	10.9
STN-1, 6.0'-7.5'	3	10/29/09	Hom	3/8"			No	44.71	184.10	159.42	21.5
STN-1, 12.0'-13.5'	5	10/29/09	Hom	No. 4			No	44.31	161.27	134.34	29.9
STN-1, 15.0'-16.5'	7	10/29/09	Hom	1 1/2"			No	49.14	104.31	93.86	23.4
STN-1, 20.0'-21.5'	9	10/29/09	Hom	3/8"			No	42.15	114.15	98.11	28.7
STN-1, 25.0'-26.5'	11	10/29/09	Hom	1 1/2"			No	51.25	143.32	128.58	19.1
STN-1, 30.0'-31.5'	13	10/29/09	Hom	No. 10			Yes	44.46	156.92	134.81	24.5
STN-1, 35.0'-36.5'	15	10/29/09	Hom	No. 10			Yes	51.67	176.76	155.73	20.2
STN-1, 40.0'-41.5'	17	10/29/09	Hom	1 1/2"			No	31.07	116.03	100.59	22.2
STN-1, 45.0'-46.5'	19	10/29/09	Hom	3/8"			No	39.60	143.83	125.48	21.4
STN-2, 1.5'-3.0'	21	10/27/09		3/4"			No	20.88	47.05	43.59	15.2
STN-2, 4.5'-6.0'	23	10/27/09	Hom	1 1/2"			No	23.41	80.59	71.71	18.4
STN-2, 7.5'-9.0'	25	10/27/09	Hom	No. 10			Yes	22.40	77.86	63.79	34.0
STN-2, 13.5'-15.0'	27	10/27/09	Hom	No. 4			No	21.52	71.19	58.59	34.0
STN-2, 17.5'-19.0'	29	10/27/09	Hom	No. 10			Yes	21.72	71.94	62.18	24.1
STN-2, 22.5'-24.0'	31	10/27/09	Hom	No. 4			No	21.58	65.54	56.13	27.2
STN-2, 27.5'-29.0'	33	10/27/09		1 1/2"			No	21.84	30.88	29.97	11.2
STN-2, 32.5'-34.0'	35	10/27/09	Hom	No. 4			No	21.70	96.22	81.88	23.8
STN-2, 37.5'-39.0'	37	10/27/09	Hom	No. 4			No	21.39	86.66	75.77	20.0
STN-3, 0.0'-1.5'	39	10/27/09	Hom	1 1/2"			No	45.49	138.24	127.28	13.4
STN-3, 3.0'-4.5'	41	10/27/09	Hom	3/4"			No	46.23	187.33	169.57	14.4
STN-3, 6.0'-7.5'	43	10/27/09	Len	1 1/2"			No	77.69	270.13	245.17	14.9
STN-3, 12.0'-13.5'	45	10/27/09	Hom	1 1/2"			No	48.89	210.57	190.80	13.9
STN-3, 15.0'-16.5'	47	10/27/09	Hom	1 1/2"			No	73.92	173.00	159.71	15.5
STN-3, 20.0'-21.5'	49	10/27/09	Hom	3/4"			No	77.90	232.32	206.31	20.3
STN-3, 25.0'-26.5'	51	10/27/09	Hom	3/8"			No	20.48	62.14	55.23	19.9
STN-3, 30.0'-31.5'	53	10/27/09	Hom	No. 4			Yes	73.10	258.85	223.49	23.5
STN-3, 35.0'-36.5'	55	10/27/09	Hom	3/8"			No	72.47	267.44	230.20	23.6



# Moisture Content of Soil

ASTM D 2216

Project Name TVA- PAF Peabody Ash Pond

Project Number 175569069  
Tested By JF

Maximum Particle Size in Sample	No. 10	No. 4	3/8"	3/4"	1 1/2"	3"
Recommended Minimum Mass (g)	20	100	500	2,500	10,000	50,000

Test Method ASTM

Material Type: Stratified, Laminated, Lensed, Homogeneous

Source	Lab ID	Date Tested	Material Type	Maximum Particle Size	Material Excluded Amount	Material Excluded Size	Pass Min. Mass? (Y/N)	Can Weight (g)	Wet Soil & Can Weight (g)	Dry Soil & Can Weight (g)	Moisture Content (%)
STN-3, 40.0'-41.5'	57	10/27/09	Hom	1 1/2"			No	76.49	209.73	182.08	26.2
STN-3, 45.0'-46.5'	59	10/27/09	Hom	3/4"			No	21.23	89.29	76.47	23.2
STN-4, 1.5'-3.0'	62	10/26/09	Len	1 1/2"			No	75.86	191.03	178.40	12.3
STN-4, 4.5'-6.0'	64	10/26/09	Hom	3/8"			No	47.73	159.99	144.20	16.4
STN-4, 7.5'-9.0'	66	10/26/09	Hom	1 1/2"			No	43.80	162.51	146.15	16.0
STN-4, 13.5'-15.0'	68	10/26/09									
STN-4, 17.5'-19.0'	70	10/26/09	Hom	3/4"			No	49.21	143.46	125.82	23.0
STN-4, 22.5'-24.0'	72	10/26/09	Hom	No. 4			Yes	71.78	230.68	190.23	34.1
STN-4, 27.5'-29.0'	74	10/26/09		No. 10			Yes	69.30	257.78	212.30	31.8
STN-4, 32.5'-34.0'	76	10/26/09	Hom	3/8"			No	53.19	187.84	159.47	26.7
STN-4, 37.5'-39.0'	78	10/26/09	Hom	No. 10			Yes	73.22	233.62	196.64	30.0
STN-4, 42.5'-44.0'	80	10/26/09	Hom	No. 10			Yes	70.66	222.76	167.80	56.6
STN-5, 0.0'-1.5'	82	10/26/09	Hom	3/8"			No	21.73	65.82	59.53	16.6
STN-5, 3.0'-4.5'	84	10/26/09	Hom	3/8"			No	18.80	68.84	60.53	19.9
STN-5, 6.0'-7.5'	86	10/26/09	Hom	1 1/2"			No	20.97	60.74	55.53	15.1
STN-5, 12.0'-13.5'	88	10/27/09	Hom	1 1/2"			No	47.99	180.56	163.67	14.6
STN-5, 15.0'-16.5'	90	10/27/09	Hom	3/8"			No	46.42	153.88	125.07	36.6
STN-5, 20.0'-21.5'	92	10/27/09		3/4"			No	48.94	154.41	137.22	19.5
STN-5, 25.0'-26.5'	94	10/27/09	Hom	No. 4			No	44.12	137.09	117.69	26.4
STN-5, 30.0'-31.5'	96	10/27/09	Hom	No. 4			No	47.21	137.63	119.81	24.5
STN-5, 35.0'-36.5'	98	10/27/09	Hom	No. 10			Yes	45.60	144.46	122.94	27.8
STN-5, 40.0'-41.5'	100	11/2/09									
STN-6, 1.5'-3.0'	103	10/29/09	Hom	3/4"			No	41.44	160.41	147.33	12.4
STN-6, 8.0'-9.5'	105	10/29/09	Hom	3/8"			No	49.09	116.97	109.29	12.8
STN-6, 13.5'-15.0'	107	10/29/09		3/4"			No	22.99	82.69	72.36	20.9
STN-6, 17.5'-19.0'	109	10/29/09	Hom	No. 4			No	19.65	62.33	55.06	20.5
STN-6, 22.5'-24.0'	111	10/29/09	Hom	No. 10			Yes	19.75	67.83	57.42	27.6
STN-6, 27.5'-29.0'	113	10/29/09	Hom	3/4"			No	21.16	79.65	67.51	26.2
STN-6, 32.5'-34.0'	115	10/29/09	Hom	No. 10			Yes	20.21	69.16	63.04	14.3
STN-7, 0.0'-1.5'	117	10/29/09	Hom	3/4"			No	19.92	67.03	56.84	27.6
STN-7, 3.0'-4.5'	119	10/29/09	Hom	No. 4			No	20.25	74.12	68.61	11.4



# Moisture Content of Soil

ASTM D 2216

Project Name TVA- PAF Peabody Ash Pond

Project Number 175569069

Tested By JF

Maximum Particle Size in Sample	No. 10	3/8"	3/4"	1 1/2"	3"
Recommended Minimum Mass (g)	20	500	2,500	10,000	50,000

Test Method ASTM

Material Type: Stratified, Laminated, Lensed, Homogeneous

Source	Lab ID	Date Tested	Material Type	Maximum Particle Size	Material Excluded Amount	Material Excluded Size	Pass Min. Mass? (Y/N)	Can Weight (g)	Wet Soil & Can Weight (g)	Dry Soil & Can Weight (g)	Moisture Content (%)
STN-7, 8.0'-9.5'	121	10/29/09	Hom	3/4"			No	21.73	74.27	64.84	21.9
STN-7, 13.0'-14.5'	123	10/29/09	Hom	No. 4			No	20.62	72.34	65.17	16.1
STN-7, 18.0'-19.5'	125	10/29/09	Hom	No. 4			No	22.85	78.29	69.62	18.5
STN-7, 23.0'-24.5'	127	10/29/09	Hom	No. 10			Yes	22.27	78.35	74.57	7.2
STN-8, 1.5'-3.0'	129	10/27/09	Hom	No. 4			No	22.90	80.72	73.20	15.0
STN-8, 4.5'-6.0'	131	10/27/09	Hom	1 1/2"			No	21.04	65.22	59.60	14.6
STN-8, 7.5'-9.0'	133	10/27/09	Hom	3/4"			No	18.98	63.03	57.75	13.6
STN-8, 13.5'-15.0'	135	10/27/09		3/4"			No	21.73	72.73	65.69	16.0
STN-8, 17.5'-19.0'	137	10/27/09	Hom	No. 4			No	21.53	87.59	78.29	16.4
STN-8, 22.5'-24.0'	139	10/27/09	Hom	No. 10			Yes	21.49	93.30	77.52	28.2
STN-8, 27.5'-29.0'	141	10/27/09	Len	No. 4			No	21.69	81.10	71.14	20.1
STN-8, 32.5'-34.0'	143	10/27/09	Hom	No. 4			No	21.53	92.65	86.01	10.3
STN-9, 0.0'-1.5'	145	10/27/09		1 1/2"			No	18.76	61.21	55.95	14.1
STN-9, 3.0'-4.5'	147	10/27/09	Hom	3/4"			No	21.78	83.58	75.41	15.2
STN-9, 6.0'-7.5'	149	10/27/09	Hom	3/4"			No	22.57	72.92	66.13	15.6
STN-9, 12.0'-13.5'	151	10/27/09		3/8"			No	21.85	91.45	82.05	15.6
STN-9, 15.0'-16.5'	153	10/27/09		1 1/2"			No	21.27	95.58	85.30	16.1
STN-9, 20.0'-21.5'	155	10/27/09	Hom	3/8"			No	22.91	97.85	82.42	25.9
STN-9, 25.0'-26.5'	157	10/27/09	Hom	3/4"			No	21.82	80.79	71.25	19.3
STN-9, 30.0'-31.5'	159	10/27/09	Hom	3/8"			No	21.79	92.88	85.00	12.5
STN-11, 1.5'-3.0'	162	10/27/09	Hom	3/4"			No	23.22	80.65	73.89	13.3
STN-11, 4.5'-6.0'	164	10/27/09	Hom	3/4"			No	20.81	69.67	64.27	12.4
STN-11, 7.5'-9.0'	166	10/27/09		3/4"			No	22.95	47.78	45.43	10.5
STN-11, 13.5'-13.9'	168A	10/27/09		3/4"			No	21.62	83.65	74.79	16.7
STN-11, 13.9'-15.0'	168B	10/27/09		3/4"			No	21.46	69.17	63.33	13.9
STN-11, 17.5'-19.0'	170	10/27/09		3/8"			No	21.68	79.16	68.69	22.3
STN-11, 22.5'-24.0'	172	10/27/09		3/4"			No	21.93	82.50	70.94	23.6
STN-11, 27.5'-29.0'	174	10/27/09	Hom	No. 10			Yes	21.44	75.13	63.83	26.7
STN-11, 32.5'-34.0'	176	10/27/09		No. 4			No	20.62	74.24	66.98	15.7
STN-11, 37.5'-39.0'	178	10/27/09	Hom	No. 4			No	22.56	80.53	72.04	17.2
STN-11, 42.5'-44.0'	180	10/27/09	Hom	No. 10			Yes	21.99	69.65	66.23	7.7



# Moisture Content of Soil

ASTM D 2216

Project Name TVA- PAF Peabody Ash Pond

Project Number 175569069  
Tested By JF

Maximum Particle Size in Sample	No. 10	No. 4	3/8"	3/4"	1 1/2"	3"
Recommended Minimum Mass (g)	20	100	500	2,500	10,000	50,000

Test Method ASTM

Material Type: Stratified, Laminated, Lensed, Homogeneous

Source	Lab ID	Date Tested	Material Type	Maximum Particle Size	Material Excluded Amount	Size	Pass Min. Mass? (Y/N)	Can Weight (g)	Wet Soil & Can Weight (g)	Dry Soil & Can Weight (g)	Moisture Content (%)
STN-12, 0.0'-1.5'	182	11/1/09									
STN-12, 3.0'-4.5'	184	10/29/09		1 1/2"			No	46.98	112.68	111.53	1.8
STN-12, 8.0'-9.5'	186	10/29/09	Hom	1 1/2"			No	40.69	173.52	156.21	15.0
STN-12, 11.0'-12.5'	188	10/29/09	Hom	3/4"			No	43.84	186.09	168.68	13.9
STN-12, 18.5'-20.0'	190	10/29/09		3/4"			No	44.08	84.85	77.96	20.3
STN-12, 27.5'-29.0'	192	10/29/09	Hom	No. 10			Yes	44.93	163.57	142.38	21.7
STN-12, 32.5'-34.0'	194	10/29/09	Hom	No. 4			Yes	43.74	198.60	175.36	17.7
STN-12, 37.5'-39.0'	196	10/29/09		1 1/2"			No	43.80	169.34	151.59	16.5
STN-12, 42.5'-44.0'	198	10/29/09	Hom	1 1/2"			No	44.21	172.75	153.22	17.9
STN-14, 1.5'-3.0'	201	10/28/09	Hom	3/4"			No	73.75	203.98	184.66	17.4
STN-14, 4.5'-6.0'	203	10/28/09	Hom	3/4"			No	75.71	263.14	240.00	14.1
STN-14, 7.5'-9.0'	205	10/28/09	Hom	1 1/2"			No	74.34	261.12	243.83	10.2
STN-14, 10.5'-12.0'	207	10/28/09	Lam	1 1/2"			No	71.71	182.31	171.66	10.7
STN-14, 13.5'-15.0'	209	10/28/09		3/4"			No	71.16	202.72	185.32	15.2
STN-14, 17.5'-19.0'	211	10/28/09		No. 4			Yes	74.15	209.38	192.52	14.2
STN-14, 22.5'-24.0'	213	10/28/09		3/8"			No	73.27	169.23	151.20	23.1
STN-14, 27.5'-29.0'	215	10/28/09		3/8"			No	70.60	208.04	184.58	20.6
STN-14, 32.5'-34.0'	217	10/28/09	Len	No. 4			Yes	72.74	208.04	187.50	17.9
STN-14, 37.5'-39.0'	219	10/28/09	Lam	No. 4			Yes	76.90	253.30	235.97	10.9
STN-15, 0.0'-1.5'	220	10/29/09	Hom	3/4"			No	23.33	78.34	73.72	9.2
STN-15, 3.0'-4.5'	222	10/29/09	Hom	3/4"			No	22.03	78.33	74.18	8.0
STN-15, 8.0'-9.5'	224	10/29/09	Hom	1 1/2"			No	22.44	72.58	66.72	13.2
STN-15, 13.5'-15.0'	226	10/29/09		3/4"			No	24.79	85.28	74.87	20.8
STN-15, 17.5'-19.0'	228	10/29/09	Hom	No. 4			No	22.71	77.93	68.91	19.5
STN-15, 22.5'-24.0'	230	10/29/09	Hom	No. 10			Yes	21.54	82.00	70.44	23.6
STN-15, 27.5'-29.0'	232	10/29/09	Hom	3/8"			No	21.86	92.92	82.51	17.2
STN-15, 32.5'-34.0'	234	10/29/09	Hom	No. 4			No	23.14	89.29	81.77	12.8
STN-16, 1.5'-3.0'	237	10/29/09	Len	No. 4			Yes	75.51	187.39	176.67	10.6
STN-16, 6.5'-8.0'	239	10/29/09	Hom	No. 10			Yes	70.59	235.76	212.41	16.5
STN-16, 11.5'-13.0'	241	10/29/09	Hom	No. 10			Yes	71.48	157.97	141.09	24.2
STN-16, 15.5'-17.0'	243	10/29/09	Hom	No. 10			Yes	75.12	190.92	165.49	28.1



# Moisture Content of Soil

ASTM D 2216

Project Name TVA- PAF Peabody Ash Pond

Project Number 175569069  
Tested By JF

Maximum Particle Size in Sample	No. 10	No. 4	3/8"	3/4"	1 1/2"	3"
Recommended Minimum Mass (g)	20	100	500	2,500	10,000	50,000

Test Method ASTM

Material Type: Stratified, Laminated, Lensed, Homogeneous

Source	Lab ID	Date Tested	Material Type	Maximum Particle Size	Material Excluded Amount	Material Excluded Size	Pass Min. Mass? (Y/N)	Can Weight (g)	Wet Soil & Can Weight (g)	Dry Soil & Can Weight (g)	Moisture Content (%)
STN-16, 20.5'-22.0'	245	10/29/09	Hom	No. 4			Yes	69.84	208.84	191.72	14.0
STN-17, 0.0'-1.5'	247	10/28/09	Len	3/4"			No	47.11	193.00	179.36	10.3
STN-17, 3.0'-4.5'	249	10/28/09	Hom	3/4"			No	50.46	144.51	132.74	14.3
STN-17, 6.0'-7.5'	251	10/28/09	Hom	3/4"			No	44.63	185.36	171.72	10.7
STN-17, 9.0'-10.5'	253	10/28/09	Hom	3/8"			No	46.82	194.00	177.54	12.6
STN-17, 12.0'-13.5'	255	10/28/09		No. 4			Yes	41.53	171.93	157.99	12.0
STN-17, 15.0'-16.5'	257	10/28/09	Hom	No. 10			Yes	50.04	174.18	156.93	16.1
STN-17, 20.0'-21.5'	259	10/28/09	Hom	No. 10			Yes	44.54	176.86	152.55	22.5
STN-17, 25.0'-26.5'	261	10/28/09	Hom	No. 10			Yes	47.75	191.06	165.81	21.4
STN-17, 30.0'-31.5'	263	10/28/09	Hom	No. 4			No	44.38	157.18	135.32	24.0
STN-17, 35.0'-36.5'	265	10/28/09	Hom	No. 10			Yes	49.52	156.43	128.73	35.0
STN-17, 40.0'-41.5'	267	10/28/09	Hom	No. 10			Yes	47.70	157.38	131.92	30.2
STN-17, 45.0'-46.5'	269	10/28/09	Hom	No. 10			Yes	43.56	140.56	117.96	30.4
STN-18, 4.0'-5.5'	271	10/28/09	Hom	No. 4			Yes	44.58	183.21	165.05	15.1
STN-18, 9.0'-10.5'	273	10/28/09	Hom	3/8"			No	43.59	189.46	165.95	19.2
STN-18, 12.0'-13.5'	275	10/28/09	Len	No. 4			No	44.62	152.45	131.98	23.4
STN-18, 15.0'-16.5'	277	10/28/09		1 1/2"			No	50.86	155.02	136.28	21.9
STN-18, 20.0'-21.5'	279	10/28/09		No. 10			Yes	51.39	164.32	141.02	26.0
STN-18, 25.0'-26.5'	281	10/28/09									
STN-18, 30.0'-31.5'	283	10/28/09	Hom	No. 10			Yes	44.05	168.94	140.97	28.9
STN-18, 35.0'-36.5'	285	10/28/09	Hom	No. 10			Yes	43.76	154.74	120.86	43.9
STN-18, 40.0'-41.5'	287	10/28/09	Hom	No. 10			Yes	47.56	188.34	165.26	19.6
STN-18, 45.0'-46.5'	289	10/28/09	Hom	No. 10			Yes	22.40	100.19	84.72	24.8
STN-20, 0.0'-1.5'	290	10/28/09	Len	3/8"			No	46.95	192.82	179.14	10.3
STN-20, 3.0'-4.5'	292	10/28/09	Len	1 1/2"			No	74.19	269.30	252.08	9.7
STN-20, 6.0'-7.5'	294	10/28/09	Len	1 1/2"			No	76.13	237.60	217.23	14.4
STN-20, 9.0'-10.5'	296	10/28/09	Hom	3/4"			No	43.90	181.24	166.08	12.4
STN-20, 12.0'-13.5'	298	10/28/09	Hom	3/4"			No	71.17	280.95	250.36	17.1
STN-20, 15.0'-16.5'	300	10/28/09	Hom	No. 10			Yes	70.13	217.19	190.03	22.7
STN-20, 20.0'-21.5'	302	10/28/09	Hom	1 1/2"			No	70.74	164.42	148.71	20.1
STN-20, 25.0'-26.5'	304	10/28/09	Len	3/8"			No	69.38	208.07	186.58	18.3



# Moisture Content of Soil

ASTM D 2216

Project Name TVA- PAF Peabody Ash Pond

Project Number 175569069

Tested By JF

Maximum Particle Size in Sample	No. 10	3/8"	3/4"	1 1/2"	3"
Recommended Minimum Mass (g)	20	500	2,500	10,000	50,000

Test Method ASTM



Material Type: Stratified, Laminated, Lensed, Homogeneous

Source	Lab ID	Date Tested	Material Type	Maximum Particle Size	Material Excluded Amount	Material Excluded Size	Pass Min. Mass? (Y/N)	Can Weight (g)	Wet Soil & Can Weight (g)	Dry Soil & Can Weight (g)	Moisture Content (%)
STN-20, 30.0'-31.5'	306	10/28/09		No. 4			Yes	71.79	217.79	194.84	18.7
STN-20, 35.0'-36.5'	308	10/28/09		No. 10			Yes	71.20	269.40	235.29	20.8
STN-20, 40.0'-41.5'	310	10/28/09	Hom	No. 10			Yes	70.30	189.35	159.84	33.0
STN-20, 45.0'-46.5'	312	10/28/09	Hom	No. 10			Yes	49.87	150.29	129.52	26.1
STN-21, 4.0'-5.5'	315	10/28/09	Hom	No. 4			Yes	72.20	249.52	230.87	11.8
STN-21, 10.5'-12.0'	317	10/28/09	Hom	3/4"			No	72.89	252.02	231.06	13.3
STN-21, 13.5'-15.0'	319	10/28/09	Hom	1 1/2"			No	72.23	230.08	211.39	13.4
STN-21, 17.5'-19.0'	321	10/28/09	Hom	3/4"			No	70.39	193.11	176.86	15.3
STN-21, 22.5'-24.0'	323	10/29/09	Hom	3/4"			No	71.34	271.86	253.63	10.0
STN-21, 27.5'-29.0'	325	10/29/09		1 1/2"			No	77.11	225.27	208.25	13.0
STN-21, 32.5'-34.0'	327	10/29/09	Hom	1 1/2"			No	75.08	254.35	232.16	14.1
STN-21, 37.5'-39.0'	329	10/29/09		1 1/2"			No	49.45	181.21	168.25	10.9
STN-21, 42.5'-44.0'	331	10/29/09		3/4"			No	44.88	164.06	144.70	19.4
STN-22, 0.0'-1.5'	333	10/30/09		3/4"			No	76.72	144.10	137.00	11.8
STN-22, 3.0'-4.5'	335	10/30/09		1 1/2"			No	76.10	105.21	102.09	12.0
STN-22, 8.0'-9.5'	337	10/30/09									
STN-22, 13.0'-14.5'	339	10/30/09		3/4"			No	75.83	171.28	159.82	13.6
STN-22, 18.0'-19.5'	341	10/30/09	Hom	3/4"			No	72.00	190.18	178.22	11.3
STN-22, 23.0'-24.5'	343	10/30/09		1 1/2"			No	74.70	151.09	138.65	19.5
STN-22, 28.5'-30.0'	345	10/30/09	Hom	1 1/2"			No	71.63	234.96	216.91	12.4
STN-2, 10.5'-12.0'	347	10/30/09	Hom	No. 10			Yes	45.22	149.94	121.48	37.3
STN-3, 10.5'-12.0'	349	10/30/09	Hom	1 1/2"			No	71.11	177.22	165.75	12.1
STN-4, 10.5'-12.0'	351	10/30/09	Len	3/4"			No	70.82	217.33	198.47	14.8
STN-5, 10.5'-12.0'	353	10/30/09	Hom	No. 4			No	43.89	137.76	125.30	15.3
STN-8, 10.5'-12.0'	355	10/30/09	Hom	3/8"			No	39.73	124.93	112.71	16.7
STN-9, 10.5'-12.0'	357	10/30/09	Len	3/4"			No	40.80	137.15	124.52	15.1
STN-11, 10.5'-12.0'	359	10/30/09	Hom	1 1/2"			No	47.54	116.45	106.55	16.8



Failure Criterion: Maximum Effective Principal Stress Ratio

**Effective Strength Envelope**

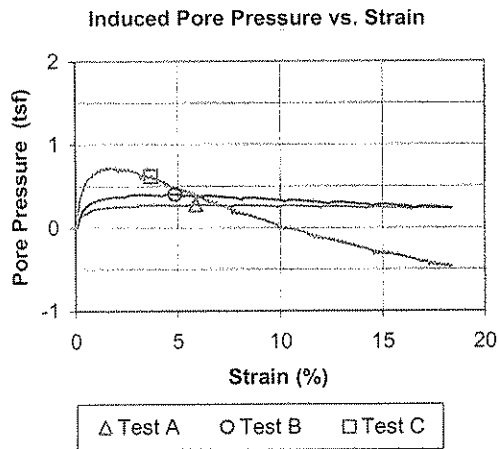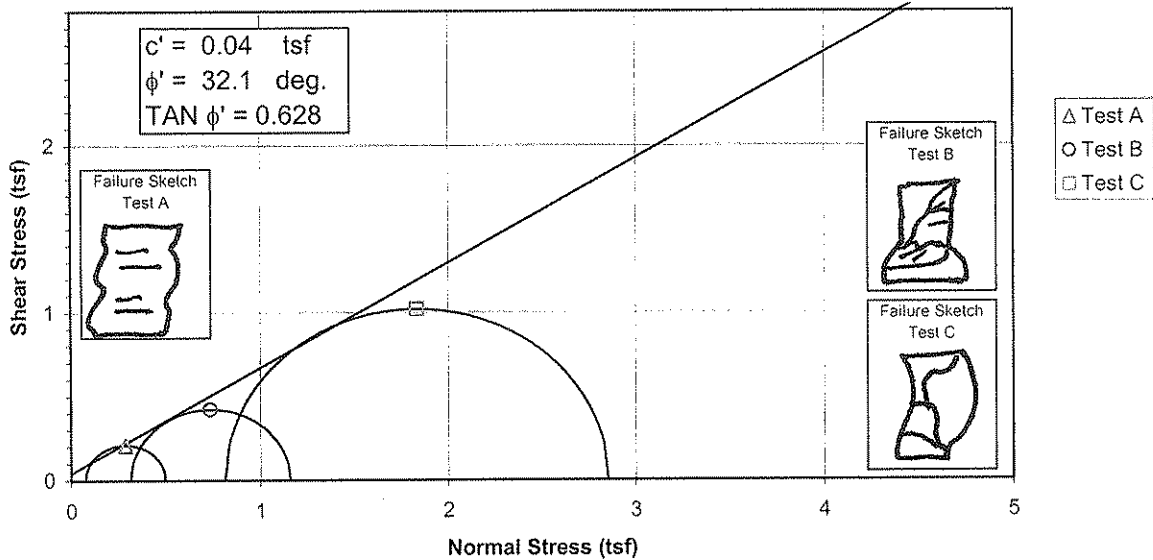

Specimen No.		A	B	C
Initial Data	Water content %	$W_o$ 11.4	12.5	13.0
	Dry Density PCF	$\gamma_{d_o}$ 108.2	111.8	116.8
	Saturation %	$S_o$ 55.4	67.2	80.0
	Void Ratio	$e_o$ 0.552	0.502	0.438
After Shear	Water content %	$W_f$ 18.1	15.2	14.1
	Dry Density PCF	$\gamma_{d_f}$ 113.0	119.2	121.7
	Saturation %	$S_f$ 100.0	100.0	100.0
	Void Ratio	$e_f$ 0.486	0.409	0.379
	Final Back Pressure TSF	$u_c$ 6.12	5.76	5.04
	Minor Principal Stress TSF @ failure	$\sigma_3'f$ 0.08	0.31	0.82
	Maximum Deviator Stress (tsf) @ failure	$(\sigma_1' - \sigma_3')_{max}$ 0.42	0.84	2.03
	Time to $(\sigma_1' - \sigma_3')_{max}$ min.	$t_f$ 30.2	25.9	176.0
	Ultimate Deviator Stress, t/sq ft	$(\sigma_1' - \sigma_3')_{ult}$ n/a	n/a	n/a
	Initial Diameter, in.	$D_o$ 2.859	2.860	2.836
Controlled - Strain Test	Initial Height, in.	$H_o$ 5.977	6.091	5.949


Description of Specimens				Lean Clay (CL), gray, moist, firm, mine spoil								
				Type of Specimen	Undisturbed		Type of test	R				
LL	PL	PI	Gs	2.69				Project	PAF - Peabody Ash Pond			
Remarks:				Boring No.				STN-21 (M1), STN-15 (M1), STN-6 (M1)				
								Sample No.			1	
				Depth Elev.				2.8'-3.4', 5.3'-5.9', 6.5'-7.4'				
				Laboratory				Stantec			Date	12-19-09
<b>TRIAXIAL COMPRESSION TEST REPORT</b>												

**Consolidated Undrained Triaxial Test  
EM 1110-2-1906 Appendix X**


Project PAF - Peabody Ash Pond  
 Sample ID STN-21 (M1), 2.8'-3.3' & STN-15 (M1), 5.3'-5.8' & STN-6 (M1), 6.5'-7.0'  
 Failure Criterion: Maximum Effective Principal Stress Ratio  $\phi' = 32.1$  deg.

Project No. 175569069  
 Test Number 1  
 $c' = 0.04$  tsf

**p' vs. q Plot**

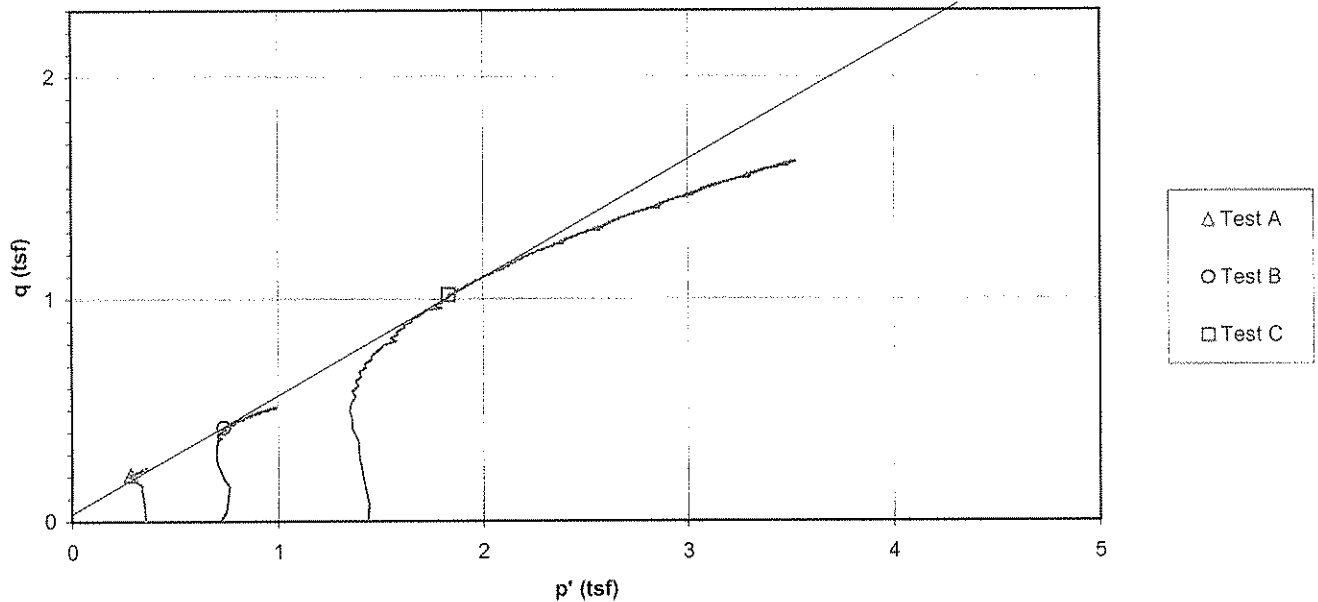

**Deviator Stress and Induced Pore Pressure vs. Axial Strain**

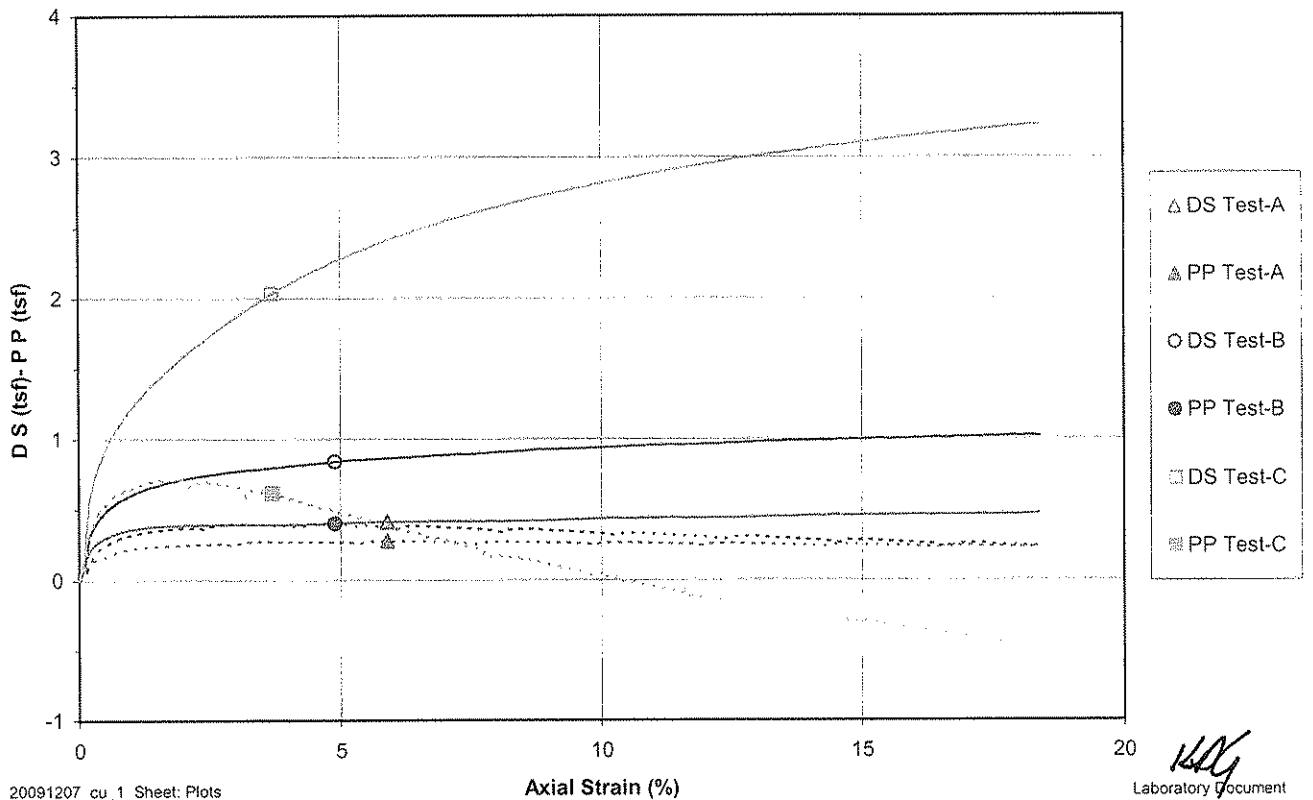

Project Name	PAF - Peabody Ash Pond	Project Number	175569069
Sample Identification	STN-21 (M1), 2.8'-3.3'	Test Number	CU-1A
Visual Description	Lean Clay (CL), gray, moist, firm, mine spoil	Prepared By	MC
Undisturbed	Source STN-21 (M1), 2.8'-3.4'	Date	12-8-2009
Specific Gravity	2.69 ASTM D854 Method A	Liquid Limit	N/A
		Plastic Limit	N/A
		Plasticity Index	N/A

**Initial Specimen Data**

Specimen Diameter (in.)	Specimen Height (in.)	Volumes (in <sup>3</sup> )	Specimen
Top 2.859	1 5.967	Sample 38.3635 (V <sub>o</sub> )	Wet Weight (g) 1214.11
Middle 2.861	2 5.962	Solids 24.7317 (VS <sub>o</sub> )	Dry Weight (g) 1090.27
Bottom 2.856	3 6.018	Water 7.5568 (Vw <sub>o</sub> )	Wet Unit Weight (pcf) 120.6
Avg. 2.8587 (D <sub>o</sub> )	4 5.963	Void Ratio 13.6318 (Vv <sub>o</sub> )	Dry Unit Weight (pcf) 108.3
Area (in <sup>2</sup> ) 6.4183 (A <sub>o</sub> )	Avg. (H <sub>o</sub> ) 5.9773	Degree of Saturation (%) 55.4 (S <sub>o</sub> )	
Moisture Content (%) 11.4	Final Trimmings	Void Ratio 0.551	

**Saturation**




Set Up & Saturated:	Wet <u>xx</u>	Dry _____	Set up By	KDG	
Back Pressure Saturated to:	85 (psi)	Final Pore Pressure Parameter B	0.96	Date	12-9-09
			Panel Board Number	C	
Height Readings (in.)	Back Pressure Burette	Chamber Burette	Specimen Height (in.)	5.9433 (H <sub>e</sub> )	
Initial 0.1413	Initial 24.63 (in.)	Initial 10.08 (in.)	Area (in <sup>2</sup> ) Method A	6.3448 (A <sub>e</sub> )	
Final 0.1753	Final 0 (in.)	Final 11.94 (in.)	Specimen Volume (in <sup>3</sup> )	37.71 (V <sub>s</sub> )	
Change -0.0340 (ΔH <sub>o</sub> )	Change -24.63 (in.)	Change 1.86 (in.)			

**Consolidation**

Height Readings (in.)	Back Pressure Burette Readings	Chamber Burette Readings	Pressures (psi)
Initial 0.1753	Initial 0.87 (in.)	Initial 16.17 (in.)	Chamber 90
Final 0.1965	Final 6.20 (in.)	Final 10.38 (in.)	Back 85
Change -0.0212 (ΔH <sub>c</sub> )	Change -5.33 (in.)	Change -5.79 (in.)	Lateral 5 (σ <sub>3</sub> )
Height (in.) 5.9221 (H <sub>c</sub> )		Volume (in <sup>3</sup> ) 36.7539 (V <sub>c</sub> )	t <sub>50</sub> (min.) 1.591
Area (in <sup>2</sup> ) Method B 6.2063 (A <sub>c</sub> )		Volume - Water (in <sup>3</sup> ) 12.0223 (VW <sub>c</sub> )	
Diameter (in.) 2.8111 (D <sub>c</sub> )		Water Content (%) 18.1	
Dry Density (pcf) 113.0		Degree of Saturation (%) 100.0 (S <sub>c</sub> )	Void Ratio 0.486

**After Test**

Final Measurements	Final Moisture Content	Stresses (membrane corrected) at Failure (psi)
Maximum Diameter 3.351 (in.)	Wet Weight (g) 1287.29	Corrected Deviator 0.42 σ <sub>d</sub> (tsf)
Wet weight (g) 1287.29 (WWf)	Dry Weight (g) 1090.27	Major Principal 0.50 σ <sub>1f</sub> (tsf)
Corrected Diameter 3.327 (in.)	Tare Weight (g) 0.00	Minor Principal 0.08 σ <sub>3f</sub> (tsf)
Youngs Modulus for Membrane (psi) 200		Rate of Strain (% / min.) 0.196
Membrane Thickness (in.) 0.012		Axial Strain at Failure (%) 5.90
		Failure Criterion: Maximum Effective Principal Stress Ratio

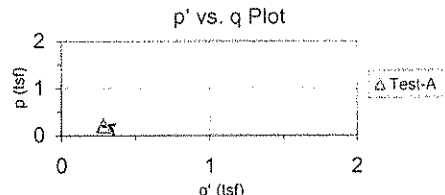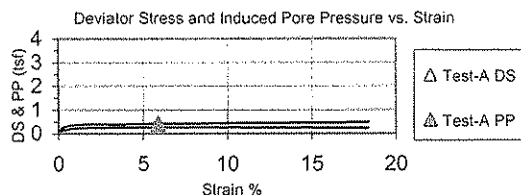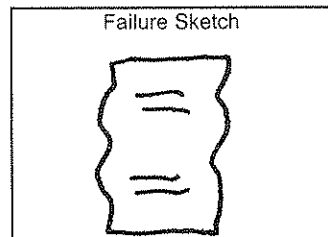

Comments:

*KDG*

Project Name	<u>PAF - Peabody Ash Pond</u>	Project Number	<u>175569069</u>
Sample Identification	<u>STN-15 (M1), 5.3'-5.8'</u>	Test Number	<u>CU-1B</u>
Visual Description	<u>Lean Clay (CL), gray, moist, firm, mine spoil</u>	Prepared By	<u>MC</u>
Undisturbed	Source <u>STN-15 (M1), 5.3'-5.9'</u>	Date	<u>12-8-2009</u>
Specific Gravity	<u>2.69</u> ASTM D854 Method A	Liquid Limit	<u>N/A</u>
		Plastic Limit	<u>N/A</u>
		Plasticity Index	<u>N/A</u>

### Initial Specimen Data

Specimen Diameter (in.)	Specimen Height (in.)	Volumes (in3)	Specimen
Top <u>2.880</u>	1 <u>6.093</u>	Sample <u>39.1781</u> ( $V_o$ )	Wet Weight (g) <u>1292.68</u>
Middle <u>2.855</u>	2 <u>6.091</u>	Solids <u>26.0555</u> ( $VS_o$ )	Dry Weight (g) <u>1148.63</u>
Bottom <u>2.850</u>	3 <u>6.090</u>	Water <u>8.7900</u> ( $Vw_o$ )	Wet Unit Weight (pcf) <u>125.7</u>
Avg. <u>2.8617</u> ( $D_o$ )	4 <u>6.092</u>	Void Ratio <u>13.1226</u> ( $Vv_o$ )	Dry Unit Weight (pcf) <u>111.7</u>
Area (in <sup>2</sup> ) <u>6.4317</u> ( $A_o$ )	Avg. ( $H_o$ ) <u>6.0914</u>	Degree of Saturation (%) <u>67.0</u> ( $S_o$ )	
Moisture Content (%) <u>12.5</u>	Final Trimmings	Void Ratio <u>0.504</u>	

### Saturation




Set Up & Saturated:	Wet <u>xx</u>	Dry _____	Set up By <u>KDG</u>
Back Pressure Saturated to:	<u>80</u> (psi)	Final Pore Pressure Parameter B <u>0.98</u>	Date <u>12-9-09</u>
			Panel Board Number <u>B</u>
Height Readings (in.)	Back Pressure Burette	Chamber Burette	Specimen Height (in.) <u>6.0710</u> ( $H_s$ )
Initial <u>0.1563</u>	Initial <u>16.74</u> (in.)	Initial <u>10.88</u> (in.)	Area (in <sup>2</sup> ) Method A <u>6.3885</u> ( $A_s$ )
Final <u>0.1767</u>	Final <u>0</u> (in.)	Final <u>14.57</u> (in.)	Specimen Volume (in <sup>3</sup> ) <u>38.78</u> ( $V_s$ )
Change <u>-0.0204</u> ( $\Delta H_s$ )	Change <u>-16.74</u> (in.)	Change <u>3.69</u> (in.)	

### Consolidation

Height Readings (in.)	Back Pressure Burette Readings	Chamber Burette Readings	Pressures (psi)
Initial <u>0.1767</u>	Initial <u>2.11</u> (in.)	Initial <u>17.74</u> (in.)	Chamber <u>90</u>
Final <u>0.2018</u>	Final <u>8.99</u> (in.)	Final <u>10.03</u> (in.)	Back <u>80</u>
Change <u>-0.0251</u> ( $\Delta H_c$ )	Change <u>-6.88</u> (in.)	Change <u>-7.71</u> (in.)	Lateral <u>10</u> ( $\sigma_3$ )
Height (in.) <u>6.0459</u> ( $H_c$ )		Volume (in <sup>3</sup> ) <u>36.7146</u> ( $V_c$ )	$D_{50}$ (min.) <u>1.257</u>
Area (in <sup>2</sup> ) Method B <u>6.0727</u> ( $A_c$ )		Volume - Water (in <sup>3</sup> ) <u>10.6591</u> ( $VW_c$ )	
Diameter (in.) <u>2.7806</u> ( $D_c$ )		Water Content (%) <u>15.2</u>	
Dry Density (pcf) <u>119.2</u>		Degree of Saturation (%) <u>100.0</u> ( $S_c$ )	Void Ratio <u>0.409</u>

### After Test

Final Measurements	Final Moisture Content	Stresses (membrane corrected) at Failure (psi)
Maximum Diameter <u>3.75</u> (in.)	Wet Weight (g) <u>1323.31</u>	Corrected Deviator <u>0.84</u> $\sigma_d$ (tsf)
Wet weight (g) <u>1323.31</u> (WWf)	Dry Weight (g) <u>1148.63</u>	Major Principal <u>1.16</u> $\sigma_1'$ (tsf)
Corrected Diameter <u>3.726</u> (in.)	Tare Weight (g) <u>0.00</u>	Minor Principal <u>0.31</u> $\sigma_3'$ (tsf)
		Rate of Strain (% / min.) <u>0.191</u>
Youngs Modulus for Membrane (psi) <u>200</u>		Axial Strain at Failure (%) <u>4.91</u>
Membrane Thickness (in.) <u>0.012</u>		Failure Criterion: Maximum Effective Principal Stress Ratio

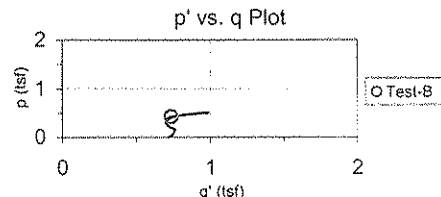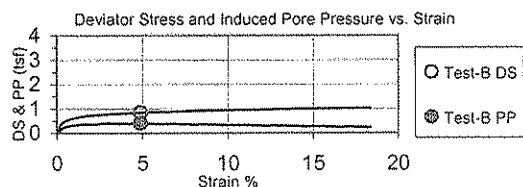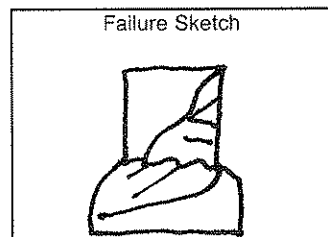

Comments: \_\_\_\_\_

Project Name	PAF - Peabody Ash Pond			Project Number	175569069			
Sample Identification	STN-6 (M1), 6.5'-7.0'			Test Number	CU-1C			
Visual Description	Lean Clay with Sand (CL), gray, moist, firm, mine spoil			Prepared By	MC			
Undisturbed	Source STN-6 (M1), 6.5'-7.4'			Date	12-8-2009			
Specific Gravity	2.69	ASTM D854 Method A	Liquid Limit	N/A	Plastic Limit	N/A	Plasticity Index	N/A

**Initial Specimen Data**

Specimen Diameter (in.)	Specimen Height (in.)	Volumes (in <sup>3</sup> )	Specimen
Top <u>2.856</u>	1 <u>5.941</u>	Sample <u>37.5512 (V<sub>o</sub>)</u>	Wet Weight (g) <u>1301.68</u>
Middle <u>2.837</u>	2 <u>5.955</u>	Solids <u>26.1283 (VS<sub>o</sub>)</u>	Dry Weight (g) <u>1151.84</u>
Bottom <u>2.812</u>	3 <u>5.956</u>	Water <u>9.1434 (VW<sub>o</sub>)</u>	Wet Unit Weight (pcf) <u>132.1</u>
Avg. <u>2.8350 (D<sub>o</sub>)</u>	4 <u>5.944</u>	Voids <u>11.4229 (VV<sub>o</sub>)</u>	Dry Unit Weight (pcf) <u>116.9</u>
Area (in <sup>2</sup> ) <u>6.3124 (A<sub>o</sub>)</u>	Avg. (H <sub>o</sub> ) <u>5.9488</u>	Degree of Saturation (%) <u>80.0 (S<sub>o</sub>)</u>	
Moisture Content (%) <u>13.0</u>	Final Trimmings	Void Ratio <u>0.437</u>	

**Saturation**

Set Up & Saturated: Wet xx Dry \_\_\_\_\_ Set up By KDG  
 Back Pressure Saturated to: 70 (psi) Final Pore Pressure Parameter B 0.97 Date 12-9-09  
 Panel Board Number A




Height Readings (in.)	Back Pressure Burette	Chamber Burette	Specimen Height (in.) <u>5.9504 (H<sub>g</sub>)</u>
Initial <u>0.1315</u>	Initial <u>16.33</u> (in.)	Initial <u>12.23</u> (in.)	Area (in <sup>2</sup> ) Method A <u>6.3158 (A<sub>g</sub>)</u>
Final <u>0.1299</u>	Final <u>9.46</u> (in.)	Final <u>12.46</u> (in.)	Specimen Volume (in <sup>3</sup> ) <u>37.58 (V<sub>g</sub>)</u>
Change <u>0.0016 (ΔH<sub>o</sub>)</u>	Change <u>-6.87</u> (in.)	Change <u>0.23</u> (in.)	

**Consolidation**


Height Readings (in.)	Back Pressure Burette Readings	Chamber Burette Readings	Pressures (psi)
Initial <u>0.1299</u>	Initial <u>1.61</u> (in.)	Initial <u>17.28</u> (in.)	Chamber <u>90</u>
Final <u>0.1667</u>	Final <u>6.37</u> (in.)	Final <u>12.16</u> (in.)	Back <u>70</u>
Change <u>-0.0368 (ΔH<sub>c</sub>)</u>	Change <u>-4.76</u> (in.)	Change <u>-5.12</u> (in.)	Lateral <u>20 (σ<sub>3</sub>)</u>
Height (in.) <u>5.9136 (H<sub>c</sub>)</u>		Volume (in <sup>3</sup> ) <u>36.0424 (V<sub>c</sub>)</u>	
Area (in <sup>3</sup> ) Method B <u>6.0949 (A<sub>c</sub>)</u>		Volume - Water (in <sup>3</sup> ) <u>9.9141 (VW<sub>c</sub>)</u>	D <sub>50</sub> (min.) <u>16</u>
Diameter (in.) <u>2.7857 (D<sub>c</sub>)</u>		Water Content (%) <u>14.1</u>	
Dry Density (pcf) <u>121.7</u>		Degree of Saturation (%) <u>100.0 (S<sub>c</sub>)</u>	Void Ratio <u>0.379</u>

**After Test**

Final Measurements	Final Moisture Content	Stresses (membrane corrected) at Failure (psi)
Maximum Diameter <u>3.376</u> (in.)	Wet Weight (g) <u>1314.31</u>	Corrected Deviator <u>2.03</u> σ <sub>d</sub> (tsf)
Wet weight (g) <u>1314.31</u> (WWf)	Dry Weight (g) <u>1151.84</u>	Major Principal <u>2.85</u> σ <sub>1f</sub> (tsf)
Corrected Diameter <u>3.352</u> (in.)	Tare Weight (g) <u>0.00</u>	Minor Principal <u>0.82</u> σ <sub>3f</sub> (tsf)
		Rate of Strain (% / min.) <u>0.021</u>
Youngs Modulus for Membrane (psi) <u>200</u>		Axial Strain at Failure (%) <u>3.70</u>
Membrane Thickness (in.) <u>0.012</u>		Failure Criterion: Maximum Effective Principal Stress Ratio

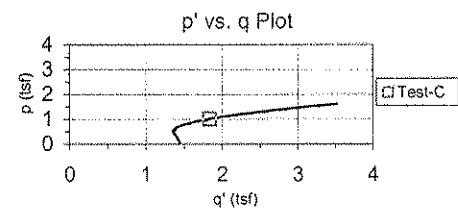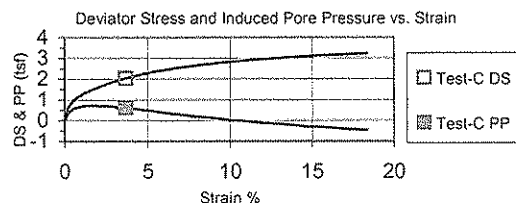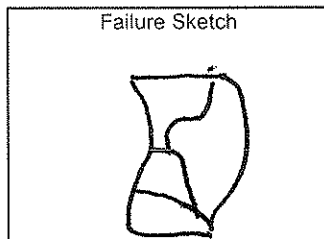

Comments:



**Consolidated Undrained Triaxial Test  
EM 1110-2-1906 Appendix X**

Consolidation Values			Final Values			Tested By <u>KDG</u>		Project Number <u>175569069</u>	
Height	<u>5.922 (in.)</u>	<u>15.042 (cm)</u>	Height	<u>4.833 (in.)</u>		Date	<u>12-10-09</u>	Test Number	<u>CU-1A</u>
Diameter	<u>2.811 (in.)</u>	<u>7.140 (cm)</u>	Dia. avg.	<u>3.258 (in.)</u>		Press No.	<u>1</u>	Data File ID	<u>1A</u>
Area	<u>6.207 (in<sup>2</sup>)</u>	<u>40.043 (cm<sup>2</sup>)</u>	Area avg.	<u>8.335 (in<sup>2</sup>)</u>		Panel No.	<u>C</u>	Lateral Pressure (psi)	<u>5.0</u>
								Chamber Pressure - $\sigma_3$ (psi)	<u>90</u>

Clock Time (min.)	Load (lbf)	Deflection Dial Reading (in.)	Pore Pressure Reading (psi)	Corrected Height (in.)	Strain (%)	Corrected Area (cm <sup>2</sup> )	Corrected Load (lbf)	Deviator Stress (tsf)	Corrected Deviator Stress* (tsf)	$\sigma_1$ (tsf)	$\sigma_1'$ (tsf)	$\sigma_3'$ (tsf)	$p' = (\sigma_1' + \sigma_3')/2$ (tsf)	$q = (\sigma_1 - \sigma_3)/2$ (tsf)	Effective Principal Stress Ratio $\sigma_1' / \sigma_3'$
0:00:00	13.7	-0.021	85.1	5.922	0.00	40.0429	0.0	0.000	0.000	0.360	0.360	0.358	0.358	0.002	1.011
0:00:40	24.0	-0.015	85.9	5.916	0.11	40.0857	10.3	0.119	0.119	0.479	0.415	0.293	0.354	0.061	1.419
0:01:12	31.6	-0.009	86.6	5.910	0.20	40.1241	17.9	0.208	0.207	0.567	0.454	0.243	0.348	0.105	1.867
0:01:43	35.4	-0.003	87.0	5.904	0.30	40.1642	21.7	0.251	0.250	0.610	0.469	0.216	0.343	0.127	2.177
0:02:13	38.0	0.003	87.3	5.898	0.40	40.2048	24.3	0.281	0.280	0.640	0.481	0.198	0.340	0.142	2.434
0:02:42	40.0	0.009	87.4	5.892	0.50	40.2451	26.2	0.303	0.302	0.662	0.494	0.189	0.341	0.153	2.621
0:03:11	41.5	0.015	87.5	5.887	0.60	40.2847	27.7	0.320	0.319	0.679	0.505	0.182	0.343	0.161	2.769
0:03:43	42.8	0.021	87.8	5.880	0.70	40.3262	29.1	0.336	0.334	0.694	0.493	0.156	0.325	0.169	3.167
0:04:12	43.7	0.027	88.0	5.875	0.80	40.3658	30.0	0.346	0.344	0.704	0.494	0.147	0.320	0.174	3.367
0:04:42	44.6	0.032	88.1	5.869	0.90	40.4067	30.9	0.356	0.353	0.713	0.495	0.138	0.316	0.179	3.592
0:05:14	45.4	0.038	88.2	5.863	1.00	40.4478	31.7	0.364	0.362	0.722	0.497	0.132	0.314	0.183	3.778
0:05:45	45.9	0.045	88.2	5.857	1.10	40.4902	32.1	0.369	0.366	0.726	0.498	0.127	0.312	0.185	3.904
0:06:15	46.3	0.050	88.3	5.851	1.20	40.5295	32.6	0.374	0.371	0.731	0.497	0.122	0.309	0.187	4.077
0:06:44	46.8	0.056	88.3	5.845	1.30	40.5710	33.1	0.379	0.376	0.736	0.500	0.120	0.310	0.190	4.159
0:07:15	47.2	0.062	88.4	5.839	1.40	40.6116	33.5	0.384	0.380	0.740	0.501	0.117	0.309	0.192	4.277
0:07:43	47.5	0.068	88.4	5.833	1.50	40.6529	33.7	0.386	0.382	0.742	0.501	0.115	0.308	0.193	4.351
0:08:14	47.7	0.074	88.4	5.827	1.61	40.6964	34.0	0.388	0.384	0.744	0.500	0.112	0.306	0.194	4.460
0:08:45	48.0	0.080	88.5	5.821	1.71	40.7376	34.3	0.391	0.387	0.747	0.501	0.110	0.305	0.195	4.544
0:09:14	48.0	0.086	88.5	5.815	1.80	40.7769	34.2	0.390	0.386	0.746	0.498	0.108	0.303	0.195	4.604
0:09:46	48.3	0.092	88.5	5.809	1.91	40.8215	34.6	0.394	0.390	0.750	0.500	0.107	0.303	0.197	4.686
0:10:17	48.5	0.098	88.5	5.803	2.00	40.8620	34.8	0.396	0.391	0.751	0.500	0.106	0.303	0.197	4.735
0:10:47	48.8	0.104	88.6	5.798	2.10	40.9022	35.1	0.399	0.394	0.754	0.502	0.104	0.303	0.199	4.813
0:11:16	48.5	0.109	88.6	5.792	2.20	40.9440	34.8	0.395	0.390	0.750	0.497	0.103	0.300	0.197	4.826
0:11:47	49.0	0.116	88.6	5.786	2.31	40.9878	35.3	0.400	0.394	0.754	0.500	0.102	0.301	0.199	4.921
0:12:18	48.7	0.121	88.6	5.780	2.40	41.0273	35.0	0.397	0.391	0.751	0.496	0.101	0.298	0.197	4.911
0:12:51	49.1	0.128	88.6	5.774	2.50	41.0718	35.3	0.400	0.394	0.754	0.497	0.099	0.298	0.199	5.000
0:13:22	49.2	0.133	88.6	5.768	2.60	41.1127	35.4	0.401	0.394	0.754	0.497	0.099	0.298	0.199	5.010
0:13:53	49.2	0.139	88.6	5.762	2.70	41.1547	35.5	0.401	0.395	0.755	0.498	0.099	0.299	0.199	5.008
0:14:26	49.1	0.145	88.6	5.756	2.81	41.1988	35.4	0.400	0.393	0.753	0.498	0.101	0.300	0.198	4.916
0:14:55	49.3	0.151	88.6	5.750	2.90	41.2395	35.6	0.402	0.394	0.754	0.502	0.104	0.303	0.199	4.831
0:15:26	49.4	0.157	88.5	5.744	3.00	41.2818	35.7	0.402	0.395	0.755	0.506	0.108	0.307	0.199	4.694
0:15:59	49.5	0.163	88.7	5.738	3.10	41.3252	35.8	0.403	0.395	0.755	0.490	0.091	0.291	0.200	5.377
0:16:30	49.4	0.169	88.8	5.733	3.20	41.3665	35.7	0.401	0.393	0.753	0.485	0.087	0.286	0.199	5.552
0:17:01	49.4	0.175	88.8	5.727	3.30	41.4091	35.6	0.400	0.392	0.752	0.481	0.085	0.283	0.198	5.654
0:17:34	49.7	0.180	88.8	5.721	3.40	41.4521	35.9	0.403	0.395	0.755	0.482	0.083	0.283	0.199	5.778
0:18:06	49.7	0.186	88.9	5.715	3.50	41.4951	36.0	0.404	0.395	0.755	0.481	0.082	0.282	0.199	5.840
0:18:38	49.7	0.192	88.9	5.709	3.60	41.5390	35.9	0.402	0.393	0.753	0.479	0.082	0.281	0.199	5.837
0:19:10	49.6	0.198	88.8	5.703	3.70	41.5822	35.9	0.401	0.392	0.752	0.480	0.085	0.282	0.198	5.675
0:19:41	49.8	0.204	88.8	5.697	3.80	41.6251	36.1	0.403	0.394	0.754	0.481	0.084	0.282	0.199	5.747
0:20:11	50.0	0.210	88.8	5.691	3.90	41.6685	36.2	0.404	0.395	0.755	0.483	0.084	0.284	0.199	5.717
0:20:41	49.9	0.216	88.8	5.685	4.00	41.7110	36.2	0.403	0.394	0.754	0.481	0.084	0.283	0.199	5.731
0:21:12	50.2	0.222	88.8	5.679	4.10	41.7550	36.5	0.406	0.396	0.756	0.485	0.085	0.285	0.200	5.696
0:21:42	50.3	0.228	88.8	5.673	4.20	41.7994	36.5	0.407	0.396	0.756	0.485	0.085	0.285	0.200	5.696
0:22:13	50.2	0.234	88.8	5.667	4.30	41.8428	36.4	0.405	0.394	0.754	0.483	0.085	0.284	0.199	5.692
0:22:42	50.5	0.240	88.8	5.662	4.40	41.8854	36.8	0.409	0.398	0.758	0.486	0.085	0.286	0.201	5.741
0:23:11	50.6	0.246	88.8	5.656	4.50	41.9294	36.8	0.408	0.397	0.757	0.487	0.086	0.286	0.201	5.687
0:23:42	50.5	0.252	88.8	5.650	4.60	41.9741	36.8	0.408	0.397	0.757	0.486	0.086	0.286	0.200	5.659
0:24:10	50.9	0.257	88.8	5.644	4.70	42.0177	37.1	0.411	0.400	0.760	0.489	0.086	0.288	0.202	5.687
0:24:40	51.3	0.263	88.8	5.638	4.80	42.0622	37.6	0.416	0.404	0.764	0.494	0.086	0.290	0.204	5.727
0:25:10	51.3	0.269	88.8	5.632	4.90	42.1060	37.5	0.415	0.403	0.763	0.493	0.086	0.289	0.203	5.707
0:25:40	51.3	0.275	88.8	5.626	5.00	42.1499	37.5	0.414	0.402	0.762	0.493	0.087	0.290	0.203	5.672
0:26:12	51.8	0.281	88.8	5.620	5.10	42.1956	38.1	0.419	0.407	0.767	0.498	0.088	0.293	0.205	5.678
0:26:42	52.0	0.287	88.7	5.614	5.20	42.2394	38.2	0.421	0.408	0.768	0.502	0.090	0.296	0.206	5.565
0:27:12	52.0	0.293	88.7	5.608	5.30	42.2840	38.3	0.421	0.408	0.768	0.505	0.093	0.299	0.206	5.421
0:27:42	52.2	0.299	88.6	5.602	5.40	42.3283	38.5	0.423	0.409	0.769	0.511	0.098	0.305	0.207	5.211
0:28:13	52.4	0.305	88.8	5.596	5.50	42.3737	38.7	0.424	0.411	0.771	0.499	0.084	0.291	0.207	5.917
0:28:42	52.5	0.311	88.8	5.590	5.60	42.4182	38.8	0.425	0.412	0.772	0.499	0.083	0.291	0.208	5.975
0:29:10	52.8	0.317	88.9	5.585	5.70	42.4633	39.0	0.427	0.413	0.773	0.497	0.080	0.288	0.209	6.227
0:29:41	53.0	0.323	88.9	5.579	5.80	42.5087	39.3	0.430	0.415	0.775	0.497	0.078	0.288	0.210	6.344
0:30:12	53.0	0.329	88.9	5.573	5.90	42.5537	39.3	0.430	0.415	0.775	0.497	0.078	0.287	0.209	6.389

# Consolidated Undrained Triaxial Test EM 1110-2-1906 Appendix X

Consolidation Values			Final Values			Tested By <u>KDG</u>		Project Number <u>175569069</u>	
Height	<u>5.922 (in.)</u>	<u>15.042 (cm)</u>	Height	<u>4.833 (in.)</u>		Date	<u>12-10-09</u>	Test Number	<u>CU-1A</u>
Diameter	<u>2.811 (in)</u>	<u>7.140 (cm)</u>	Dia. avg.	<u>3.258 (in)</u>		Press No.	<u>1</u>	Data File ID	<u>1A</u>
Area	<u>6.207 (in<sup>2</sup>)</u>	<u>40.043 (cm<sup>2</sup>)</u>	Area avg.	<u>8.335 (in<sup>2</sup>)</u>		Panel No.	<u>C</u>	Lateral Pressure (psi)	<u>5.0</u>
								Chamber Pressure - $\sigma_3$ (psi)	<u>90</u>

Clock Time (min.)	Load (lbf)	Deflection Dial Reading (in.)	Pore Pressure Reading (psi)	Corrected Height (in.)	Strain (%)	Corrected Area (cm <sup>2</sup> )	Corrected Load (lbf)	Deviator Stress (tsf)	Corrected Deviator Stress* (tsf)	$\sigma_1$ (tsf)	$\sigma_1'$ (tsf)	$\sigma_3'$ (tsf)	$p'$ ( $(\sigma_1 + \sigma_3)'/2$ ) (tsf)	$q$ ( $(\sigma_1 - \sigma_3)'/2$ ) (tsf)	Effective Principal Stress Ratio
															$\sigma_1' / \sigma_3'$
0:30:42	53.1	0.335	88.9	5.567	6.00	42.6003	39.4	0.430	0.415	0.775	0.497	0.078	0.287	0.209	6.370
0:31:12	53.0	0.340	88.9	5.561	6.10	42.6448	39.3	0.429	0.414	0.774	0.497	0.080	0.289	0.209	6.220
0:31:44	53.1	0.346	88.9	5.555	6.20	42.6894	39.4	0.429	0.414	0.774	0.499	0.081	0.290	0.209	6.146
0:32:14	53.2	0.352	88.9	5.549	6.30	42.7352	39.4	0.429	0.414	0.774	0.498	0.081	0.290	0.209	6.157
0:32:44	53.3	0.358	88.8	5.543	6.40	42.7811	39.5	0.430	0.414	0.774	0.501	0.083	0.292	0.209	6.037
0:33:17	53.5	0.364	88.8	5.537	6.50	42.8274	39.7	0.431	0.415	0.775	0.502	0.083	0.293	0.210	6.040
0:33:47	53.7	0.370	88.8	5.531	6.60	42.8727	40.0	0.434	0.418	0.778	0.505	0.083	0.294	0.211	6.055
0:34:18	53.8	0.376	88.8	5.525	6.70	42.9183	40.0	0.434	0.417	0.777	0.505	0.084	0.295	0.211	6.008
0:34:50	54.0	0.382	88.8	5.519	6.80	42.9648	40.2	0.435	0.419	0.779	0.508	0.085	0.297	0.211	5.954
0:35:22	54.0	0.388	88.8	5.513	6.90	43.0110	40.3	0.436	0.419	0.779	0.508	0.086	0.297	0.211	5.929
0:35:53	53.9	0.394	88.8	5.508	7.00	43.0566	40.2	0.434	0.417	0.777	0.509	0.088	0.298	0.210	5.780
0:36:24	54.2	0.400	88.8	5.502	7.10	43.1034	40.5	0.437	0.420	0.780	0.511	0.088	0.300	0.212	5.808
0:36:54	54.3	0.406	88.8	5.496	7.20	43.1498	40.6	0.437	0.419	0.779	0.512	0.089	0.301	0.212	5.738
0:37:26	54.3	0.411	88.8	5.490	7.30	43.1959	40.6	0.437	0.419	0.779	0.512	0.089	0.301	0.212	5.731
0:37:58	54.1	0.417	88.7	5.484	7.40	43.2428	40.4	0.434	0.416	0.776	0.511	0.092	0.302	0.210	5.577
0:38:29	54.2	0.423	88.6	5.478	7.50	43.2894	40.4	0.434	0.416	0.776	0.522	0.102	0.312	0.210	5.102
0:39:01	54.1	0.429	88.6	5.472	7.60	43.3356	40.4	0.434	0.415	0.775	0.518	0.100	0.309	0.209	5.194
0:39:34	54.4	0.435	88.7	5.466	7.70	43.3836	40.7	0.436	0.417	0.777	0.516	0.095	0.305	0.210	5.424
0:40:05	54.4	0.441	88.8	5.460	7.80	43.4304	40.6	0.435	0.416	0.776	0.507	0.087	0.297	0.210	5.798
0:40:36	54.6	0.447	88.8	5.454	7.90	43.4767	40.9	0.438	0.418	0.778	0.507	0.085	0.296	0.211	5.969
0:41:09	54.7	0.453	88.8	5.448	8.00	43.5255	40.9	0.437	0.418	0.778	0.506	0.084	0.295	0.211	6.007
0:41:38	54.6	0.459	88.8	5.442	8.10	43.5718	40.9	0.436	0.416	0.776	0.504	0.084	0.294	0.210	6.028
0:42:09	54.7	0.465	88.8	5.436	8.20	43.6195	41.0	0.437	0.417	0.777	0.505	0.084	0.295	0.210	5.993
0:42:40	55.1	0.471	88.8	5.431	8.30	43.6672	41.4	0.441	0.420	0.780	0.508	0.084	0.296	0.212	6.039
0:43:11	55.1	0.477	88.8	5.425	8.40	43.7145	41.4	0.440	0.420	0.780	0.511	0.087	0.299	0.212	5.862
0:43:40	55.0	0.482	88.8	5.419	8.50	43.7617	41.3	0.439	0.418	0.778	0.510	0.088	0.299	0.211	5.796
0:44:10	55.3	0.488	88.8	5.413	8.60	43.8094	41.5	0.441	0.420	0.780	0.511	0.088	0.300	0.212	5.820
0:44:39	55.5	0.494	88.8	5.407	8.70	43.8575	41.7	0.442	0.421	0.781	0.515	0.090	0.302	0.212	5.734
0:45:10	55.5	0.500	88.8	5.401	8.80	43.9077	41.8	0.443	0.421	0.781	0.514	0.089	0.302	0.212	5.763
0:45:40	55.7	0.506	88.7	5.395	8.90	43.9550	41.9	0.444	0.422	0.782	0.517	0.091	0.304	0.213	5.669
0:46:09	55.9	0.512	88.7	5.389	9.00	44.0026	42.2	0.446	0.424	0.784	0.519	0.091	0.305	0.214	5.688
0:46:40	56.0	0.518	88.7	5.383	9.10	44.0520	42.2	0.446	0.423	0.783	0.519	0.092	0.306	0.214	5.635
0:47:09	56.1	0.524	88.7	5.377	9.20	44.0991	42.4	0.447	0.424	0.784	0.520	0.092	0.306	0.214	5.640
0:47:40	56.5	0.530	88.7	5.371	9.30	44.1486	42.8	0.451	0.428	0.788	0.525	0.094	0.310	0.216	5.605
0:48:11	56.4	0.536	88.7	5.366	9.40	44.1964	42.7	0.449	0.426	0.786	0.524	0.094	0.309	0.215	5.575
0:48:40	56.6	0.542	88.7	5.360	9.50	44.2449	42.9	0.451	0.428	0.788	0.527	0.096	0.311	0.216	5.511
0:49:11	57.0	0.548	88.6	5.353	9.60	44.2957	43.3	0.455	0.431	0.791	0.532	0.097	0.315	0.217	5.472
0:49:41	57.1	0.554	88.6	5.348	9.70	44.3443	43.4	0.455	0.431	0.791	0.535	0.100	0.317	0.218	5.356
0:50:10	57.3	0.560	88.5	5.342	9.80	44.3933	43.6	0.456	0.432	0.792	0.541	0.105	0.323	0.218	5.162
0:50:39	57.5	0.565	88.5	5.336	9.90	44.4414	43.8	0.458	0.434	0.794	0.549	0.111	0.330	0.219	4.945
0:51:08	57.8	0.571	88.7	5.330	10.00	44.4906	44.1	0.461	0.436	0.796	0.535	0.095	0.315	0.220	5.646
0:51:38	57.9	0.577	88.7	5.324	10.10	44.5402	44.2	0.461	0.436	0.796	0.534	0.094	0.314	0.220	5.688
0:52:09	58.2	0.583	88.7	5.318	10.20	44.5921	44.5	0.464	0.439	0.799	0.533	0.091	0.312	0.221	5.866
0:52:38	58.3	0.589	88.7	5.312	10.30	44.6411	44.6	0.464	0.439	0.799	0.534	0.091	0.312	0.221	5.886
0:53:10	58.0	0.595	88.7	5.306	10.40	44.6898	44.3	0.461	0.435	0.795	0.530	0.091	0.310	0.220	5.843
0:53:41	58.1	0.601	88.7	5.300	10.50	44.7389	44.4	0.462	0.436	0.796	0.531	0.091	0.311	0.220	5.833
0:54:12	58.4	0.607	88.7	5.294	10.60	44.7897	44.6	0.463	0.437	0.797	0.534	0.093	0.313	0.221	5.768
0:54:44	58.4	0.613	88.7	5.288	10.70	44.8410	44.7	0.463	0.437	0.797	0.535	0.094	0.314	0.220	5.702
0:55:16	58.7	0.619	88.7	5.282	10.80	44.8921	44.9	0.466	0.439	0.799	0.538	0.095	0.316	0.221	5.669
0:55:45	58.7	0.625	88.7	5.277	10.90	44.9413	44.9	0.465	0.438	0.798	0.538	0.096	0.317	0.221	5.616
0:56:17	58.9	0.631	88.7	5.271	11.00	44.9920	45.2	0.467	0.440	0.800	0.541	0.097	0.319	0.222	5.582
0:56:49	59.0	0.636	88.6	5.265	11.10	45.0423	45.3	0.468	0.441	0.801	0.542	0.098	0.320	0.222	5.540
0:57:20	59.0	0.642	88.6	5.259	11.20	45.0924	45.3	0.467	0.439	0.799	0.542	0.099	0.321	0.222	5.473
0:57:51	59.4	0.648	88.6	5.253	11.30	45.1441	45.7	0.471	0.443	0.803	0.546	0.099	0.323	0.223	5.502
0:58:21	59.4	0.654	88.6	5.247	11.40	45.1940	45.6	0.470	0.442	0.802	0.544	0.099	0.322	0.223	5.495
0:58:53	59.2	0.660	88.6	5.241	11.50	45.2454	45.5	0.468	0.440	0.800	0.544	0.101	0.323	0.222	5.387
0:59:25	59.2	0.666	88.6	5.235	11.60	45.2967	45.5	0.467	0.439	0.799	0.544	0.102	0.323	0.221	5.339
0:59:56	59.4	0.672	88.6	5.229	11.70	45.3476	45.7	0.468	0.440	0.800	0.547	0.104	0.325	0.222	5.272
1:00:28	59.5	0.678	88.5	5.223	11.80	45.3989	45.8	0.469	0.440	0.800	0.549	0.106	0.327	0.222	5.194
1:01:00	59.5	0.684	88.5	5.217	11.90	45.4508	45.7	0.468	0.439	0.799	0.551	0.109	0.330	0.221	5.058

## Consolidated Undrained Triaxial Test EM 1110-2-1906 Appendix X

Consolidation Values			Final Values			Tested By		Project Number	
Height	5.922 (in.)	15.042 (cm)	Height	4.833 (in.)		KDG	175569069		
Diameter	2.811 (in.)	7.140 (cm)	Dia. avg.	3.258 (in.)		12-10-09	Test Number	CU-1A	
Area	6.207 (in <sup>2</sup> )	40.043 (cm <sup>2</sup> )	Area avg.	8.335 (in <sup>2</sup> )		1	Data File ID	1A	
						C	Lateral Pressure (psi)	5.0	
							Chamber Pressure - $\sigma_3$ (psi)	90	

Clock Time (min.)	Load (lbf)	Deflection Dial Reading (in.)	Pore Pressure Reading (psi)	Corrected Height (in.)	Strain (%)	Corrected Area (cm <sup>2</sup> )	Corrected Load (lbf)	Deviator Stress (tsf)	Corrected Deviator Stress* (tsf)	$\sigma_1$ (tsf)	$\sigma_1'$ (tsf)	$\sigma_3$ (tsf)	$p'$ ( $(\sigma_1' + \sigma_3) / 2$ ) (tsf)	$q$ ( $(\sigma_1 - \sigma_3) / 2$ ) (tsf)	Effective Principal Stress Ratio $\sigma_1' / \sigma_3'$
1:01:31	59.5	0.690	88.4	5.212	12.00	45.5016	45.8	0.468	0.438	0.798	0.558	0.116	0.337	0.221	4.816
1:02:02	59.7	0.695	88.6	5.206	12.10	45.5530	45.9	0.469	0.439	0.799	0.545	0.102	0.324	0.222	5.324
1:02:35	59.9	0.702	88.6	5.200	12.20	45.6061	46.2	0.471	0.441	0.801	0.544	0.100	0.322	0.222	5.465
1:03:04	59.9	0.707	88.6	5.194	12.30	45.6571	46.2	0.470	0.440	0.800	0.542	0.098	0.320	0.222	5.508
1:03:35	60.2	0.713	88.6	5.188	12.40	45.7095	46.4	0.472	0.442	0.802	0.543	0.098	0.321	0.223	5.557
1:04:06	60.3	0.719	88.6	5.182	12.50	45.7631	46.6	0.474	0.443	0.803	0.545	0.098	0.321	0.223	5.553
1:04:37	60.3	0.725	88.6	5.176	12.60	45.8150	46.6	0.473	0.442	0.802	0.544	0.099	0.322	0.223	5.511
1:05:05	60.4	0.731	88.6	5.170	12.70	45.8660	46.7	0.473	0.442	0.802	0.545	0.100	0.323	0.223	5.465
1:05:36	60.7	0.737	88.6	5.164	12.80	45.9210	47.0	0.476	0.444	0.804	0.550	0.102	0.326	0.224	5.384
1:06:05	60.8	0.743	88.6	5.158	12.90	45.9732	47.0	0.476	0.444	0.804	0.550	0.103	0.326	0.224	5.364
1:06:34	60.8	0.749	88.6	5.152	13.00	46.0241	47.1	0.476	0.444	0.804	0.551	0.104	0.327	0.224	5.327
1:07:03	61.1	0.755	88.6	5.147	13.10	46.0770	47.4	0.478	0.446	0.806	0.553	0.104	0.329	0.225	5.332
1:07:34	61.3	0.761	88.5	5.141	13.20	46.1304	47.5	0.479	0.447	0.807	0.555	0.105	0.330	0.225	5.299
1:08:04	61.4	0.767	88.5	5.135	13.30	46.1838	47.7	0.480	0.448	0.808	0.557	0.106	0.332	0.226	5.262
1:08:33	61.6	0.772	88.5	5.129	13.40	46.2369	47.9	0.481	0.448	0.808	0.560	0.108	0.334	0.226	5.192
1:09:05	61.5	0.779	88.5	5.123	13.50	46.2923	47.8	0.480	0.447	0.807	0.559	0.108	0.333	0.225	5.178
1:09:36	61.7	0.785	88.5	5.117	13.60	46.3455	47.9	0.481	0.448	0.808	0.560	0.108	0.334	0.226	5.169
1:10:05	61.9	0.790	88.5	5.111	13.70	46.3986	48.2	0.483	0.449	0.809	0.563	0.110	0.336	0.227	5.130
1:10:35	62.2	0.796	88.5	5.105	13.80	46.4515	48.5	0.485	0.451	0.811	0.565	0.110	0.337	0.228	5.151
1:11:06	62.4	0.802	88.5	5.099	13.90	46.5066	48.7	0.487	0.453	0.813	0.568	0.111	0.340	0.228	5.097
1:11:34	62.5	0.808	88.4	5.093	14.00	46.5590	48.8	0.488	0.453	0.813	0.571	0.114	0.342	0.228	5.024
1:12:03	62.8	0.814	88.4	5.087	14.10	46.6138	49.1	0.490	0.455	0.815	0.576	0.117	0.346	0.229	4.934
1:12:33	62.8	0.820	88.3	5.081	14.20	46.6690	49.1	0.489	0.454	0.814	0.579	0.121	0.350	0.229	4.777
1:13:03	62.9	0.826	88.3	5.075	14.30	46.7225	49.2	0.489	0.454	0.814	0.578	0.120	0.349	0.229	4.820
1:13:32	63.3	0.832	88.5	5.069	14.40	46.7775	49.6	0.493	0.458	0.818	0.571	0.110	0.341	0.231	5.206
1:14:02	63.5	0.838	88.5	5.064	14.50	46.8323	49.8	0.495	0.459	0.819	0.570	0.107	0.339	0.231	5.308
1:14:34	63.6	0.844	88.5	5.058	14.60	46.8874	49.9	0.494	0.459	0.819	0.570	0.108	0.339	0.231	5.300
1:15:06	63.6	0.850	88.5	5.052	14.70	46.9427	49.9	0.494	0.458	0.818	0.567	0.106	0.337	0.231	5.356
1:15:35	63.7	0.855	88.5	5.046	14.80	46.9971	50.0	0.494	0.458	0.818	0.568	0.106	0.337	0.231	5.344
1:16:06	63.7	0.861	88.5	5.040	14.90	47.0513	50.0	0.494	0.457	0.817	0.568	0.107	0.337	0.231	5.321
1:16:38	63.9	0.867	88.5	5.034	15.00	47.1089	50.1	0.495	0.458	0.818	0.571	0.110	0.341	0.231	5.212
1:17:07	64.1	0.873	88.5	5.028	15.10	47.1627	50.4	0.497	0.460	0.820	0.574	0.111	0.342	0.232	5.193
1:17:38	64.0	0.879	88.5	5.022	15.20	47.2177	50.3	0.496	0.458	0.818	0.573	0.111	0.342	0.231	5.156
1:18:11	63.9	0.885	88.4	5.016	15.29	47.2732	50.2	0.494	0.456	0.816	0.573	0.113	0.343	0.230	5.073
1:18:42	64.3	0.891	88.4	5.010	15.40	47.3299	50.6	0.497	0.459	0.819	0.577	0.114	0.345	0.232	5.080
1:19:13	64.6	0.897	88.4	5.004	15.50	47.3861	50.8	0.499	0.461	0.821	0.579	0.114	0.347	0.232	5.066
1:19:44	64.5	0.903	88.4	4.998	15.60	47.4415	50.8	0.498	0.459	0.819	0.578	0.115	0.346	0.232	5.032
1:20:16	64.5	0.909	88.4	4.993	15.70	47.4977	50.8	0.497	0.458	0.818	0.578	0.116	0.347	0.231	4.986
1:20:48	64.7	0.915	88.4	4.986	15.80	47.5558	51.0	0.498	0.459	0.819	0.580	0.116	0.348	0.232	4.979
1:21:18	65.0	0.920	88.4	4.981	15.89	47.6105	51.3	0.501	0.462	0.822	0.583	0.117	0.350	0.233	4.988
1:21:52	65.0	0.927	88.4	4.975	16.00	47.6687	51.3	0.501	0.461	0.821	0.583	0.118	0.350	0.232	4.943
1:22:22	65.0	0.932	88.3	4.969	16.10	47.7245	51.3	0.500	0.460	0.820	0.584	0.120	0.352	0.232	4.866
1:22:54	65.2	0.938	88.3	4.963	16.20	47.7820	51.5	0.501	0.461	0.821	0.587	0.122	0.355	0.233	4.800
1:23:26	65.2	0.944	88.2	4.957	16.30	47.8393	51.5	0.500	0.460	0.820	0.590	0.126	0.358	0.232	4.679
1:23:58	65.3	0.950	88.2	4.951	16.40	47.8966	51.6	0.501	0.461	0.821	0.597	0.133	0.365	0.232	4.499
1:24:29	65.5	0.956	88.3	4.945	16.50	47.9541	51.8	0.502	0.461	0.821	0.586	0.121	0.353	0.233	4.854
1:25:00	65.5	0.962	88.4	4.939	16.60	48.0110	51.8	0.502	0.461	0.821	0.582	0.117	0.349	0.232	4.979
1:25:31	65.8	0.968	88.4	4.933	16.69	48.0678	52.1	0.504	0.463	0.823	0.581	0.115	0.348	0.233	5.063
1:26:00	65.7	0.974	88.4	4.927	16.79	48.1252	51.9	0.502	0.460	0.820	0.579	0.115	0.347	0.232	5.033
1:26:31	65.8	0.980	88.4	4.921	16.90	48.1852	52.1	0.503	0.461	0.821	0.580	0.115	0.348	0.233	5.046
1:27:00	66.1	0.986	88.4	4.916	17.00	48.2423	52.3	0.504	0.463	0.823	0.581	0.115	0.348	0.233	5.065
1:27:30	66.0	0.992	88.4	4.910	17.09	48.2997	52.2	0.503	0.461	0.821	0.581	0.116	0.348	0.232	5.007
1:27:59	66.3	0.998	88.4	4.904	17.20	48.3590	52.6	0.506	0.464	0.824	0.586	0.118	0.352	0.234	4.952
1:28:29	66.4	1.004	88.3	4.898	17.30	48.4177	52.7	0.506	0.464	0.824	0.587	0.119	0.353	0.234	4.922
1:28:58	66.5	1.009	88.3	4.892	17.40	48.4757	52.8	0.506	0.463	0.823	0.587	0.120	0.354	0.234	4.888
1:29:28	66.5	1.015	88.3	4.886	17.50	48.5340	52.8	0.506	0.463	0.823	0.587	0.121	0.354	0.233	4.870
1:29:59	66.8	1.021	88.3	4.880	17.60	48.5936	53.1	0.508	0.465	0.825	0.589	0.120	0.354	0.234	4.908
1:30:30	66.7	1.027	88.3	4.874	17.70	48.6523	53.0	0.507	0.463	0.823	0.589	0.123	0.356	0.233	4.805
1:30:59	66.9	1.033	88.3	4.868	17.79	48.7109	53.1	0.507	0.464	0.824	0.590	0.122	0.356	0.234	4.822
1:31:30	67.1	1.039	88.3	4.862	17.90	48.7705	53.3	0.508	0.464	0.824	0.592	0.124	0.358	0.234	4.774



## Consolidated Undrained Triaxial Test EM 1110-2-1906 Appendix X

Consolidation Values		
Height	5.922 (in.)	15.042 (cm)
Diameter	2.811 (in.)	7.140 (cm)
Area	6.207 (in <sup>2</sup> )	40.043 (cm <sup>2</sup> )

Final Values		
Height	4.833 (in.)	
Dia. avg.	3.258 (in.)	
Area avg.	8.335 (in <sup>2</sup> )	

Tested By	KDG
Date	12-10-09
Press No.	1
Panel No.	C

Project Number	175569069
Test Number	CU-1A
Data File ID	1A
Lateral Pressure (psi)	5.0
Chamber Pressure - $\sigma_3$ (psi)	90

Clock Time (min.)	Load (lbf)	Deflection Dial Reading (in.)	Pore Pressure Reading (psi)	Corrected Height (in.)	Strain (%)	Corrected Area (cm <sup>2</sup> )	Corrected Load (lbf)	Deviator Stress (tsf)	Corrected Deviator Stress* (tsf)	$\sigma_1$ (tsf)	$\sigma_1'$ (tsf)	$\sigma_3'$ (tsf)	$p'$ ( $(\sigma_1' + \sigma_3')/2$ ) (tsf)	$q$ ( $(\sigma_1 - \sigma_3)/2$ ) (tsf)	Effective Principal Stress Ratio $\sigma_1' / \sigma_3'$
1:32:01	67.2	1.045	88.3	4.856	18.00	48.8303	53.5	0.509	0.465	0.825	0.590	0.121	0.355	0.235	4.887
1:32:30	67.4	1.051	88.3	4.850	18.09	48.8892	53.6	0.510	0.466	0.826	0.593	0.123	0.358	0.235	4.807
1:33:00	67.5	1.057	88.3	4.844	18.20	48.9496	53.8	0.511	0.466	0.826	0.594	0.124	0.359	0.235	4.781
1:33:29	67.9	1.063	88.3	4.839	18.30	49.0096	54.2	0.514	0.469	0.829	0.598	0.125	0.362	0.236	4.773
1:33:59	68.3	1.069	88.2	4.833	18.40	49.0698	54.6	0.517	0.472	0.832	0.603	0.127	0.365	0.238	4.741

# Consolidated Undrained Triaxial Test EM 1110-2-1906 Appendix X

Consolidation Values		
Height	6.046 (in.)	15.357 (cm)
Diameter	2.781 (in)	7.063 (cm)
Area	6.073 (in <sup>2</sup> )	39.181 (cm <sup>2</sup> )

Final Values		
Height	4.933 (in.)	
Dia. avg.	3.415 (in)	
Area avg.	9.159 (in <sup>2</sup> )	

Tested By	KDG
Date	12-10-09
Press No.	1
Panel No.	B

Project Number	175589069
Test Number	CU-1B
Data File ID	1B
Lateral Pressure (psi)	10.0
Chamber Pressure - $\sigma_3$ (psi)	90

Clock Time (min.)	Load (lbf)	Deflection Dial Reading (in.)	Pore Pressure Reading (psi)	Corrected Height (in.)	Strain (%)	Corrected Area (cm <sup>2</sup> )	Corrected Load (lbf)	Deviator Stress (tsf)	Corrected Deviator Stress* (tsf)	$\sigma_1$ (tsf)	$\sigma_1'$ (tsf)	$\sigma_3'$ (tsf)	$p'$ ( $(\sigma_1' + \sigma_3')/2$ ) (tsf)	$q$ ( $(\sigma_1 - \sigma_3)/2$ ) (tsf)	Effective Principal Stress Ratio $\sigma_1' / \sigma_3'$
0:00:00	12.8	-0.022	80.0	6.046	0.00	39.1808	0.0	0.000	0.000	0.720	0.720	0.717	0.718	0.002	1.005
0:00:49	19.7	-0.015	80.2	6.039	0.11	39.2234	6.9	0.081	0.081	0.801	0.789	0.704	0.747	0.042	1.120
0:01:25	38.8	-0.009	81.5	6.034	0.20	39.2598	26.0	0.308	0.307	1.027	0.919	0.609	0.764	0.155	1.510
0:01:57	46.5	-0.003	82.5	6.028	0.30	39.2997	32.7	0.387	0.386	1.106	0.927	0.538	0.733	0.195	1.724
0:02:30	50.4	0.003	83.1	6.022	0.40	39.3392	37.6	0.444	0.443	1.163	0.943	0.497	0.720	0.223	1.899
0:03:01	53.9	0.009	83.5	6.015	0.50	39.3794	41.1	0.485	0.484	1.204	0.955	0.468	0.712	0.244	2.041
0:03:32	56.7	0.015	83.8	6.009	0.61	39.4194	43.9	0.518	0.516	1.236	0.966	0.446	0.706	0.260	2.165
0:04:02	59.0	0.021	84.1	6.003	0.71	39.4595	46.2	0.545	0.543	1.263	0.975	0.428	0.702	0.273	2.276
0:04:33	61.4	0.027	84.2	5.997	0.80	39.4974	48.6	0.572	0.570	1.290	0.987	0.414	0.701	0.287	2.384
0:05:03	62.8	0.033	84.4	5.991	0.90	39.5375	50.0	0.588	0.585	1.305	0.994	0.405	0.699	0.294	2.455
0:05:35	64.6	0.039	84.5	5.985	1.00	39.5785	51.8	0.608	0.606	1.326	1.004	0.395	0.700	0.304	2.540
0:06:05	66.1	0.045	84.6	5.979	1.10	39.6171	53.3	0.626	0.623	1.343	1.013	0.387	0.700	0.313	2.617
0:06:37	67.5	0.051	84.7	5.973	1.21	39.6598	54.7	0.641	0.638	1.358	1.020	0.379	0.700	0.321	2.692
0:07:08	68.9	0.057	84.8	5.967	1.30	39.6978	56.1	0.657	0.653	1.373	1.029	0.373	0.701	0.328	2.763
0:07:40	69.9	0.063	84.9	5.961	1.40	39.7389	57.1	0.669	0.665	1.385	1.035	0.366	0.700	0.334	2.826
0:08:09	70.6	0.069	85.0	5.955	1.50	39.7782	57.8	0.676	0.672	1.392	1.037	0.362	0.700	0.338	2.867
0:08:40	71.7	0.075	85.0	5.949	1.60	39.8192	58.9	0.688	0.684	1.404	1.047	0.359	0.703	0.344	2.913
0:09:12	72.8	0.081	85.1	5.943	1.71	39.8605	60.0	0.699	0.695	1.415	1.053	0.355	0.704	0.349	2.969
0:09:43	73.5	0.088	85.1	5.937	1.81	39.9012	60.7	0.707	0.703	1.423	1.057	0.351	0.704	0.353	3.010
0:10:14	74.0	0.093	85.2	5.931	1.90	39.9409	61.2	0.712	0.707	1.427	1.059	0.349	0.704	0.355	3.039
0:10:47	75.0	0.100	85.2	5.925	2.01	39.9834	62.2	0.723	0.718	1.438	1.067	0.346	0.706	0.361	3.088
0:11:17	75.8	0.105	85.2	5.919	2.10	40.0220	63.0	0.732	0.726	1.446	1.074	0.344	0.709	0.365	3.120
0:11:49	76.4	0.112	85.2	5.913	2.20	40.0629	63.6	0.739	0.733	1.453	1.082	0.346	0.714	0.368	3.131
0:12:19	77.0	0.118	85.2	5.907	2.30	40.1038	64.2	0.745	0.739	1.459	1.090	0.348	0.719	0.371	3.135
0:12:50	77.5	0.124	85.1	5.900	2.41	40.1466	64.7	0.750	0.744	1.464	1.100	0.353	0.727	0.374	3.116
0:13:22	78.2	0.130	85.3	5.895	2.50	40.1863	65.4	0.757	0.751	1.471	1.090	0.335	0.713	0.377	3.249
0:13:54	78.5	0.136	85.4	5.888	2.60	40.2281	65.7	0.759	0.753	1.473	1.084	0.328	0.706	0.378	3.304
0:14:24	79.2	0.142	85.5	5.882	2.70	40.2694	66.4	0.767	0.760	1.480	1.087	0.323	0.705	0.382	3.363
0:14:57	79.8	0.148	85.6	5.876	2.81	40.3126	67.0	0.773	0.766	1.486	1.089	0.319	0.704	0.385	3.408
0:15:28	80.4	0.154	85.6	5.870	2.91	40.3531	67.6	0.779	0.772	1.492	1.092	0.317	0.705	0.387	3.443
0:15:58	80.5	0.160	85.6	5.864	3.00	40.3938	67.7	0.780	0.772	1.492	1.092	0.317	0.704	0.388	3.451
0:16:32	81.2	0.166	85.6	5.858	3.11	40.4370	68.4	0.787	0.779	1.499	1.100	0.318	0.709	0.391	3.463
0:17:04	81.6	0.172	85.6	5.852	3.21	40.4790	68.8	0.790	0.782	1.502	1.104	0.319	0.711	0.393	3.466
0:17:36	81.8	0.178	85.6	5.846	3.30	40.5199	69.0	0.792	0.784	1.504	1.107	0.320	0.713	0.394	3.462
0:18:08	82.1	0.184	85.6	5.840	3.40	40.5614	69.3	0.794	0.786	1.506	1.109	0.320	0.714	0.394	3.469
0:18:40	82.5	0.190	85.6	5.834	3.51	40.6048	69.7	0.799	0.790	1.510	1.114	0.320	0.717	0.397	3.477
0:19:12	82.9	0.196	85.5	5.828	3.60	40.6460	70.1	0.802	0.793	1.513	1.117	0.321	0.719	0.398	3.485
0:19:44	83.4	0.202	85.5	5.822	3.70	40.6873	70.6	0.807	0.798	1.518	1.125	0.324	0.725	0.401	3.473
0:20:16	83.7	0.209	85.5	5.816	3.81	40.7313	70.9	0.809	0.800	1.520	1.128	0.325	0.726	0.402	3.474
0:20:47	84.3	0.214	85.5	5.810	3.90	40.7721	71.5	0.816	0.806	1.526	1.136	0.326	0.731	0.405	3.480
0:21:19	84.7	0.221	85.5	5.804	4.01	40.8180	71.9	0.819	0.809	1.529	1.136	0.324	0.730	0.406	3.508
0:21:49	85.0	0.227	85.4	5.798	4.11	40.8591	72.2	0.822	0.812	1.532	1.148	0.333	0.741	0.408	3.448
0:22:19	85.5	0.233	85.3	5.792	4.21	40.9008	72.7	0.826	0.816	1.536	1.158	0.338	0.748	0.410	3.421
0:22:50	85.8	0.239	85.4	5.786	4.30	40.9429	73.0	0.829	0.818	1.538	1.156	0.334	0.745	0.411	3.459
0:23:22	86.4	0.245	85.5	5.779	4.41	40.9875	73.6	0.835	0.824	1.544	1.149	0.322	0.735	0.413	3.569
0:23:50	86.6	0.251	85.6	5.774	4.50	41.0291	73.8	0.836	0.825	1.545	1.147	0.319	0.733	0.414	3.601
0:24:22	87.1	0.257	85.6	5.767	4.61	41.0723	74.3	0.841	0.829	1.549	1.147	0.315	0.731	0.416	3.646
0:24:53	87.4	0.263	85.6	5.761	4.71	41.1155	74.6	0.844	0.833	1.553	1.150	0.314	0.732	0.418	3.666
0:25:23	87.8	0.269	85.6	5.755	4.81	41.1588	75.0	0.847	0.836	1.556	1.153	0.314	0.733	0.419	3.675
0:25:53	88.4	0.275	85.6	5.749	4.91	41.2019	75.6	0.853	0.840	1.560	1.159	0.315	0.737	0.422	3.682
0:26:24	88.8	0.281	85.6	5.743	5.00	41.2444	76.0	0.857	0.845	1.565	1.167	0.319	0.743	0.424	3.661
0:26:56	89.3	0.287	85.6	5.737	5.11	41.2897	76.5	0.862	0.849	1.569	1.171	0.318	0.744	0.426	3.678
0:27:25	89.7	0.293	85.5	5.731	5.20	41.3317	76.9	0.865	0.852	1.572	1.177	0.322	0.749	0.428	3.657
0:27:57	90.0	0.299	85.3	5.725	5.31	41.3764	77.2	0.867	0.854	1.574	1.193	0.336	0.765	0.429	3.553
0:28:29	90.1	0.305	85.4	5.719	5.41	41.4205	77.3	0.867	0.854	1.574	1.187	0.330	0.758	0.429	3.600
0:29:00	90.6	0.311	85.5	5.713	5.51	41.4637	77.8	0.872	0.858	1.578	1.189	0.327	0.758	0.431	3.633
0:29:31	90.8	0.317	85.4	5.707	5.61	41.5082	78.0	0.874	0.860	1.580	1.195	0.331	0.763	0.432	3.605
0:30:02	91.0	0.323	85.3	5.701	5.71	41.5515	78.2	0.875	0.861	1.581	1.199	0.335	0.767	0.432	3.581
0:30:32	91.5	0.329	85.3	5.695	5.80	41.5953	78.7	0.880	0.865	1.585	1.205	0.337	0.771	0.434	3.579
0:31:03	91.5	0.335	85.3	5.689	5.90	41.6394	78.7	0.879	0.864	1.584	1.208	0.341	0.775	0.434	3.542

**Consolidated Undrained Triaxial Test  
EM 1110-2-1906 Appendix X**

Consolidation Values		
Height	6.046 (in.)	15.357 (cm)
Diameter	2.781 (in.)	7.063 (cm)
Area	6.073 (in <sup>2</sup> )	39.181 (cm <sup>2</sup> )

Final Values		
Height	4.933 (in.)	
Dia. avg.	3.415 (in.)	
Area avg.	9.159 (in <sup>2</sup> )	

Tested By	KDG
Date	12-10-09
Press No.	1
Panel No.	B

Project Number	175569069
Test Number	CU-1B
Data File ID	1B
Lateral Pressure (psi)	10.0
Chamber Pressure - $\sigma_3$ (psi)	90

Clock Time (min.)	Load (lbf)	Deflection Dial Reading (in.)	Pore Pressure Reading (psi)	Corrected Height (in.)	Strain (%)	Corrected Area (cm <sup>2</sup> )	Corrected Load (lbf)	Deviator Stress (tsf)	Corrected Deviator Stress* (tsf)	$\sigma_1'$ (tsf)	$\sigma_1'$ (tsf)	$\sigma_3'$ (tsf)	$p'$ ( $(\sigma_1' + \sigma_3')/2$ ) (tsf)	$q$ ( $(\sigma_1' - \sigma_3')/2$ ) (tsf)	Effective Principal Stress Ratio $\sigma_1' / \sigma_3'$
0:31:35	91.8	0.342	85.2	5.683	6.01	41.6850	79.0	0.881	0.866	1.586	1.219	0.349	0.784	0.435	3.494
0:32:07	92.2	0.347	85.0	5.677	6.10	41.7282	79.4	0.885	0.870	1.590	1.230	0.357	0.794	0.437	3.446
0:32:39	92.4	0.354	85.3	5.671	6.21	41.7732	79.6	0.886	0.870	1.590	1.210	0.336	0.773	0.437	3.601
0:33:11	92.4	0.360	85.4	5.665	6.31	41.8185	79.6	0.885	0.870	1.590	1.208	0.334	0.771	0.437	3.611
0:33:43	93.0	0.366	85.4	5.659	6.41	41.8627	80.2	0.891	0.875	1.595	1.211	0.332	0.772	0.439	3.644
0:34:14	93.3	0.372	85.3	5.653	6.51	41.9072	80.5	0.893	0.877	1.597	1.215	0.335	0.775	0.440	3.629
0:34:46	93.5	0.378	85.4	5.647	6.61	41.9520	80.7	0.895	0.878	1.598	1.215	0.333	0.774	0.441	3.646
0:35:18	93.8	0.384	85.4	5.640	6.71	41.9973	81.0	0.897	0.880	1.600	1.218	0.334	0.776	0.442	3.644
0:35:49	94.5	0.390	85.3	5.634	6.80	42.0417	81.7	0.903	0.886	1.606	1.228	0.338	0.783	0.445	3.632
0:36:21	94.5	0.396	85.3	5.628	6.91	42.0875	81.7	0.902	0.885	1.605	1.229	0.340	0.785	0.444	3.610
0:36:53	94.9	0.402	85.2	5.622	7.01	42.1330	82.1	0.906	0.888	1.608	1.234	0.342	0.788	0.446	3.605
0:37:24	95.1	0.408	85.2	5.616	7.11	42.1783	82.3	0.908	0.890	1.610	1.238	0.344	0.791	0.447	3.596
0:37:56	95.5	0.414	85.2	5.610	7.21	42.2245	82.7	0.910	0.892	1.612	1.242	0.346	0.794	0.448	3.592
0:38:28	95.6	0.420	85.2	5.604	7.31	42.2688	82.8	0.911	0.893	1.613	1.245	0.348	0.796	0.448	3.573
0:39:00	95.8	0.426	85.1	5.598	7.41	42.3142	83.0	0.912	0.894	1.614	1.248	0.351	0.799	0.449	3.559
0:39:32	96.0	0.432	85.1	5.592	7.51	42.3605	83.2	0.913	0.894	1.614	1.251	0.353	0.802	0.449	3.545
0:40:05	96.3	0.438	85.1	5.586	7.61	42.4075	83.5	0.916	0.897	1.617	1.254	0.354	0.804	0.450	3.541
0:40:37	96.7	0.444	85.1	5.580	7.71	42.4538	83.9	0.919	0.900	1.620	1.259	0.356	0.808	0.452	3.538
0:41:09	96.9	0.450	85.0	5.574	7.81	42.4992	84.1	0.920	0.901	1.621	1.263	0.359	0.811	0.452	3.518
0:41:40	97.4	0.456	84.9	5.568	7.91	42.5443	84.6	0.925	0.905	1.625	1.272	0.364	0.818	0.454	3.494
0:42:12	97.8	0.462	84.9	5.562	8.01	42.5905	85.0	0.928	0.908	1.628	1.281	0.370	0.825	0.455	3.465
0:42:44	98.0	0.469	84.7	5.556	8.11	42.6366	85.2	0.929	0.909	1.629	1.292	0.379	0.836	0.456	3.404
0:43:14	98.2	0.475	85.0	5.550	8.21	42.6848	85.4	0.930	0.910	1.630	1.275	0.362	0.819	0.457	3.524
0:43:44	98.6	0.481	85.0	5.544	8.31	42.7299	85.8	0.933	0.913	1.633	1.274	0.358	0.816	0.458	3.558
0:44:16	98.8	0.487	85.1	5.537	8.41	42.7786	86.0	0.934	0.914	1.634	1.273	0.356	0.815	0.458	3.573
0:44:47	99.2	0.493	85.1	5.531	8.51	42.8247	86.4	0.938	0.917	1.637	1.274	0.354	0.814	0.460	3.601
0:45:16	99.5	0.499	85.1	5.525	8.61	42.8709	86.7	0.941	0.919	1.639	1.276	0.354	0.815	0.461	3.606
0:45:47	100.0	0.505	85.1	5.519	8.71	42.9184	87.2	0.945	0.923	1.643	1.281	0.354	0.818	0.463	3.615
0:46:18	100.5	0.511	85.0	5.513	8.81	42.9657	87.7	0.949	0.927	1.647	1.288	0.357	0.822	0.465	3.604
0:46:47	100.3	0.517	85.0	5.507	8.91	43.0126	87.5	0.946	0.924	1.644	1.290	0.363	0.826	0.464	3.558
0:47:17	100.8	0.523	84.9	5.501	9.01	43.0592	88.0	0.951	0.928	1.648	1.297	0.365	0.831	0.466	3.554
0:47:49	101.0	0.529	84.9	5.495	9.11	43.1070	88.2	0.951	0.929	1.649	1.297	0.365	0.831	0.466	3.551
0:48:20	101.1	0.535	84.9	5.489	9.21	43.1538	88.3	0.951	0.928	1.648	1.300	0.369	0.835	0.466	3.526
0:48:52	101.5	0.541	84.8	5.483	9.31	43.2026	88.7	0.954	0.931	1.651	1.305	0.371	0.838	0.467	3.520
0:49:22	101.5	0.547	84.8	5.477	9.41	43.2498	88.7	0.953	0.930	1.650	1.306	0.373	0.840	0.467	3.501
0:49:54	101.7	0.553	84.8	5.471	9.51	43.2982	88.9	0.955	0.932	1.652	1.310	0.375	0.843	0.467	3.491
0:50:25	101.8	0.559	84.8	5.465	9.61	43.3458	89.0	0.954	0.930	1.650	1.311	0.377	0.844	0.467	3.475
0:50:56	102.0	0.565	84.7	5.459	9.71	43.3945	89.2	0.956	0.932	1.652	1.314	0.378	0.846	0.468	3.474
0:51:27	102.6	0.571	84.7	5.453	9.81	43.4416	89.8	0.961	0.936	1.656	1.321	0.381	0.851	0.470	3.467
0:51:59	102.7	0.577	84.7	5.447	9.91	43.4903	89.9	0.961	0.937	1.657	1.324	0.384	0.854	0.470	3.449
0:52:28	102.9	0.583	84.6	5.441	10.01	43.5376	90.1	0.962	0.937	1.657	1.327	0.386	0.856	0.470	3.436
0:52:59	103.2	0.590	84.6	5.435	10.11	43.5866	90.4	0.965	0.940	1.660	1.332	0.389	0.861	0.471	3.421
0:53:32	103.4	0.596	84.5	5.429	10.21	43.6361	90.6	0.966	0.940	1.660	1.340	0.396	0.868	0.472	3.382
0:54:04	103.6	0.602	84.4	5.423	10.31	43.6842	90.8	0.966	0.941	1.661	1.347	0.403	0.875	0.472	3.340
0:54:35	104.0	0.608	84.6	5.417	10.41	43.7327	91.2	0.970	0.944	1.664	1.335	0.387	0.861	0.474	3.447
0:55:07	104.2	0.614	84.7	5.411	10.51	43.7819	91.4	0.971	0.945	1.665	1.332	0.384	0.858	0.474	3.470
0:55:39	104.9	0.620	84.7	5.404	10.61	43.8315	92.1	0.977	0.950	1.670	1.337	0.383	0.860	0.477	3.487
0:56:10	104.6	0.626	84.7	5.398	10.71	43.8809	91.8	0.973	0.946	1.666	1.334	0.384	0.859	0.475	3.474
0:56:42	104.9	0.632	84.7	5.392	10.81	43.9295	92.1	0.975	0.948	1.668	1.337	0.385	0.861	0.476	3.472
0:57:14	105.5	0.638	84.6	5.386	10.91	43.9791	92.7	0.980	0.953	1.673	1.342	0.386	0.864	0.478	3.479
0:57:44	105.9	0.644	84.6	5.380	11.01	44.0271	93.1	0.983	0.955	1.675	1.348	0.389	0.869	0.479	3.462
0:58:16	106.0	0.650	84.5	5.374	11.11	44.0776	93.2	0.983	0.956	1.676	1.352	0.393	0.872	0.479	3.440
0:58:48	106.1	0.656	84.5	5.368	11.21	44.1284	93.3	0.983	0.955	1.675	1.353	0.395	0.874	0.479	3.426
0:59:20	106.5	0.662	84.5	5.362	11.31	44.1782	93.7	0.987	0.959	1.679	1.358	0.396	0.877	0.481	3.429
0:59:52	106.5	0.668	84.5	5.356	11.41	44.2274	93.7	0.985	0.956	1.676	1.359	0.399	0.879	0.480	3.403
1:00:24	106.7	0.674	84.4	5.350	11.51	44.2769	93.9	0.986	0.957	1.677	1.362	0.401	0.882	0.480	3.393
1:00:56	106.9	0.680	84.4	5.344	11.61	44.3265	94.1	0.987	0.958	1.678	1.365	0.403	0.884	0.481	3.387
1:01:30	107.2	0.686	84.4	5.338	11.71	44.3780	94.4	0.990	0.961	1.681	1.369	0.405	0.887	0.482	3.379
1:02:02	107.2	0.692	84.3	5.332	11.81	44.4282	94.4	0.988	0.958	1.678	1.369	0.407	0.888	0.481	3.363
1:02:34	107.4	0.699	84.3	5.326	11.91	44.4787	94.6	0.989	0.959	1.679	1.373	0.410	0.892	0.481	3.344

# Consolidated Undrained Triaxial Test EM 1110-2-1906 Appendix X

Consolidation Values		
Height	6.046 (in.)	15.357 (cm)
Diameter	2.781 (in)	7.063 (cm)
Area	6.073 (in <sup>2</sup> )	39.181 (cm <sup>2</sup> )

Final Values		
Height	4.933 (in.)	
Dia. avg.	3.415 (in)	
Area avg.	9.159 (in <sup>2</sup> )	

Tested By	KDG
Date	12-10-09
Press No.	1
Panel No.	B

Project Number	175589069
Test Number	CU-1B
Data File ID	1B
Lateral Pressure (psi)	10.0
Chamber Pressure - $\sigma_3$ (psi)	90

Clock Time (min.)	Load (lbf)	Deflection Dial Reading (in.)	Pore Pressure Reading (psi)	Corrected Height (in.)	Strain (%)	Corrected Area (cm <sup>2</sup> )	Corrected Load (lbf)	Deviator Stress (tsf)	Corrected Deviator Stress* (tsf)	$\sigma_1$ (tsf)	$\sigma_1'$ (tsf)	$\sigma_3'$ (tsf)	$p'$ ( $(\sigma_1' + \sigma_3')/2$ ) (tsf)	$q$ ( $(\sigma_1 - \sigma_3)/2$ ) (tsf)	Effective Principal
															Stress Ratio $\sigma_1' / \sigma_3'$
1:03:04	107.9	0.704	84.3	5.320	12.01	44.5287	95.1	0.993	0.963	1.683	1.378	0.412	0.895	0.483	3.348
1:03:36	108.2	0.711	84.2	5.314	12.11	44.6796	95.4	0.995	0.965	1.685	1.389	0.421	0.905	0.484	3.302
1:04:07	108.3	0.717	84.2	5.308	12.21	44.6297	95.5	0.995	0.964	1.684	1.388	0.421	0.905	0.484	3.299
1:04:37	108.5	0.723	84.1	5.302	12.31	44.6803	95.7	0.996	0.965	1.685	1.396	0.428	0.912	0.484	3.264
1:05:09	108.9	0.729	84.1	5.296	12.41	44.7327	96.1	0.999	0.968	1.688	1.397	0.426	0.912	0.486	3.278
1:05:40	109.2	0.735	84.3	5.290	12.51	44.7834	96.4	1.001	0.970	1.690	1.386	0.413	0.900	0.487	3.358
1:06:10	109.2	0.741	84.3	5.283	12.61	44.8355	96.4	1.000	0.969	1.689	1.383	0.411	0.897	0.486	3.367
1:06:40	109.7	0.747	84.3	5.277	12.71	44.8861	96.9	1.003	0.972	1.692	1.384	0.409	0.897	0.488	3.385
1:07:11	110.2	0.753	84.3	5.271	12.81	44.9379	97.4	1.008	0.976	1.696	1.388	0.408	0.898	0.490	3.398
1:07:41	110.2	0.759	84.3	5.265	12.91	44.9903	97.4	1.007	0.975	1.695	1.388	0.410	0.899	0.489	3.387
1:08:11	110.8	0.765	84.3	5.259	13.01	45.0415	98.0	1.011	0.979	1.699	1.392	0.410	0.901	0.491	3.397
1:08:42	110.8	0.771	84.2	5.253	13.11	45.0933	98.0	1.010	0.978	1.698	1.396	0.415	0.905	0.491	3.366
1:09:12	111.4	0.777	84.2	5.247	13.21	45.1460	98.6	1.015	0.983	1.703	1.403	0.417	0.910	0.493	3.363
1:09:42	111.4	0.783	84.2	5.241	13.31	45.1968	98.6	1.014	0.981	1.701	1.404	0.419	0.911	0.492	3.350
1:10:14	111.5	0.789	84.1	5.235	13.41	45.2493	98.7	1.014	0.981	1.701	1.406	0.421	0.914	0.492	3.335
1:10:46	112.0	0.795	84.1	5.229	13.51	45.3025	99.2	1.018	0.984	1.704	1.411	0.423	0.917	0.494	3.336
1:11:17	112.4	0.801	84.1	5.223	13.61	45.3549	99.6	1.021	0.987	1.707	1.415	0.425	0.920	0.495	3.330
1:11:46	112.4	0.807	84.1	5.217	13.71	45.4063	99.6	1.020	0.986	1.706	1.416	0.427	0.922	0.495	3.316
1:12:17	112.7	0.813	84.0	5.211	13.81	45.4589	99.9	1.022	0.988	1.708	1.420	0.429	0.924	0.495	3.311
1:12:48	112.8	0.819	84.0	5.205	13.91	45.5117	100.0	1.022	0.987	1.707	1.421	0.430	0.926	0.495	3.302
1:13:19	112.8	0.825	84.0	5.199	14.01	45.5647	100.0	1.021	0.986	1.706	1.423	0.433	0.928	0.495	3.284
1:13:51	113.1	0.832	84.0	5.193	14.11	45.6183	100.3	1.022	0.987	1.707	1.425	0.434	0.930	0.495	3.281
1:14:23	113.4	0.838	83.9	5.187	14.21	45.6723	100.6	1.024	0.989	1.709	1.430	0.438	0.934	0.496	3.266
1:14:53	113.6	0.844	83.9	5.181	14.31	45.7252	100.8	1.025	0.989	1.709	1.434	0.442	0.938	0.496	3.248
1:15:25	113.5	0.850	83.8	5.174	14.41	45.7793	100.7	1.023	0.987	1.707	1.438	0.448	0.943	0.495	3.211
1:15:56	114.1	0.856	83.7	5.168	14.51	45.8325	101.3	1.028	0.992	1.712	1.449	0.454	0.951	0.498	3.194
1:16:27	114.6	0.862	83.7	5.163	14.61	45.8847	101.8	1.031	0.995	1.715	1.452	0.453	0.953	0.499	3.202
1:16:59	114.3	0.868	83.9	5.156	14.71	45.9402	101.5	1.027	0.991	1.711	1.435	0.441	0.938	0.497	3.255
1:17:30	115.1	0.874	83.9	5.150	14.81	45.9925	102.3	1.034	0.998	1.718	1.437	0.436	0.937	0.500	3.294
1:18:02	115.1	0.880	83.9	5.144	14.91	46.0475	102.3	1.033	0.996	1.716	1.435	0.436	0.936	0.500	3.294
1:18:34	115.3	0.886	84.0	5.138	15.01	46.1018	102.5	1.034	0.997	1.717	1.435	0.435	0.935	0.500	3.299
1:19:04	115.6	0.892	83.9	5.132	15.11	46.1555	102.7	1.035	0.998	1.718	1.437	0.436	0.937	0.500	3.295
1:19:36	115.7	0.898	83.9	5.126	15.21	46.2100	102.9	1.035	0.998	1.718	1.437	0.436	0.937	0.500	3.296
1:20:08	116.3	0.904	83.9	5.120	15.31	46.2662	103.5	1.040	1.002	1.722	1.446	0.440	0.943	0.503	3.283
1:20:40	116.4	0.910	83.8	5.114	15.41	46.3211	103.6	1.040	1.002	1.722	1.449	0.444	0.946	0.502	3.265
1:21:11	116.2	0.916	83.8	5.108	15.51	46.3744	103.4	1.037	0.999	1.719	1.449	0.447	0.948	0.501	3.241
1:21:44	116.5	0.922	83.8	5.102	15.61	46.4298	103.7	1.038	0.999	1.719	1.451	0.448	0.949	0.501	3.238
1:22:16	116.9	0.928	83.8	5.096	15.71	46.4846	104.1	1.042	1.003	1.723	1.456	0.450	0.953	0.503	3.236
1:22:50	116.9	0.934	83.7	5.090	15.81	46.5400	104.1	1.040	1.001	1.721	1.456	0.451	0.954	0.502	3.225
1:23:21	117.1	0.940	83.7	5.084	15.91	46.5954	104.3	1.041	1.001	1.721	1.458	0.453	0.955	0.502	3.219
1:23:54	117.4	0.947	83.7	5.078	16.01	46.6517	104.6	1.042	1.003	1.723	1.461	0.456	0.958	0.503	3.208
1:24:26	117.8	0.953	83.6	5.072	16.11	46.7070	105.0	1.046	1.006	1.726	1.467	0.458	0.962	0.504	3.205
1:24:56	118.0	0.959	83.6	5.066	16.21	46.7617	105.2	1.046	1.006	1.726	1.468	0.459	0.964	0.505	3.198
1:25:27	118.4	0.965	83.6	5.060	16.31	46.8175	105.6	1.049	1.008	1.728	1.474	0.462	0.968	0.506	3.191
1:25:59	118.8	0.971	83.5	5.053	16.41	46.8753	106.0	1.052	1.011	1.731	1.479	0.465	0.972	0.507	3.181
1:26:30	118.8	0.977	83.3	5.047	16.51	46.9313	106.0	1.050	1.009	1.729	1.492	0.479	0.985	0.506	3.113
1:27:01	118.9	0.983	83.4	5.041	16.61	46.9877	106.1	1.050	1.009	1.729	1.490	0.478	0.984	0.506	3.120
1:27:30	119.2	0.989	83.3	5.035	16.71	47.0431	106.4	1.052	1.010	1.730	1.498	0.484	0.991	0.507	3.096
1:28:01	119.7	0.995	83.6	5.029	16.81	47.1002	106.9	1.055	1.013	1.733	1.480	0.464	0.972	0.508	3.193
1:28:32	119.9	1.001	83.6	5.023	16.92	47.1578	107.1	1.056	1.014	1.734	1.478	0.460	0.969	0.509	3.210
1:29:00	119.9	1.007	83.6	5.017	17.01	47.2132	107.1	1.054	1.012	1.732	1.475	0.460	0.968	0.508	3.208
1:29:31	120.1	1.013	83.6	5.011	17.11	47.2708	107.3	1.056	1.013	1.733	1.475	0.458	0.967	0.508	3.218
1:30:01	120.3	1.019	83.6	5.005	17.21	47.3268	107.5	1.057	1.014	1.734	1.475	0.458	0.966	0.509	3.223
1:30:33	120.5	1.025	83.6	4.999	17.32	47.3862	107.7	1.057	1.014	1.734	1.476	0.458	0.967	0.509	3.221
1:31:03	120.9	1.031	83.6	4.993	17.41	47.4427	108.1	1.059	1.016	1.736	1.482	0.462	0.972	0.510	3.205
1:31:34	121.0	1.037	83.5	4.987	17.51	47.5000	108.2	1.060	1.016	1.736	1.484	0.465	0.974	0.510	3.195
1:32:06	121.1	1.043	83.5	4.981	17.61	47.5572	108.3	1.059	1.015	1.735	1.486	0.468	0.977	0.509	3.179
1:32:36	121.6	1.049	83.5	4.975	17.72	47.6163	108.8	1.062	1.018	1.738	1.492	0.470	0.981	0.511	3.174
1:33:07	121.9	1.056	83.5	4.969	17.82	47.6746	109.1	1.064	1.020	1.740	1.493	0.470	0.981	0.512	3.179
1:33:38	122.3	1.061	83.4	4.963	17.91	47.7316	109.5	1.067	1.022	1.742	1.498	0.472	0.985	0.513	3.172

## Consolidated Undrained Triaxial Test EM 1110-2-1906 Appendix X

Consolidation Values		
Height	6.046 (in.)	15.357 (cm)
Diameter	2.781 (in.)	7.063 (cm)
Area	6.073 (in <sup>2</sup> )	39.181 (cm <sup>2</sup> )

Final Values	
Height	4.933 (in.)
Dia. avg.	3.415 (in.)
Area avg.	9.159 (in <sup>2</sup> )

Tested By	KDG
Date	12-10-09
Press No.	1
Panel No.	B

Project Number	175569069
Test Number	CU-1B
Data File ID	1B
Lateral Pressure (psi)	10.0
Chamber Pressure - $\sigma_3$ (psi)	90

Clock Time (min.)	Load (lbf)	Deflection Dial Reading (in.)	Pore Pressure Reading (psi)	Corrected Height (in.)	Strain (%)	Corrected Area (cm <sup>2</sup> )	Corrected Load (lbf)	Deviator Stress (tsf)	Corrected Deviator Stress* (tsf)	$\sigma_1$ (tsf)	$\sigma_1'$ (tsf)	$\sigma_3'$ (tsf)	$p'$ ( $(\sigma_1' + \sigma_3')/2$ ) (tsf)	$q$ ( $(\sigma_1 - \sigma_3)/2$ ) (tsf)	Effective Principal Stress Ratio $\sigma_1' / \sigma_3'$
1:34:09	122.0	1.068	83.4	4.957	18.02	47.7908	109.2	1.063	1.018	1.738	1.497	0.475	0.986	0.511	3.150
1:34:38	122.4	1.074	83.4	4.951	18.11	47.8483	109.6	1.065	1.020	1.740	1.500	0.476	0.988	0.512	3.150
1:35:10	122.8	1.080	83.4	4.945	18.21	47.9067	110.0	1.067	1.022	1.742	1.504	0.479	0.991	0.513	3.143
1:35:42	122.8	1.086	83.3	4.939	18.31	47.9651	110.0	1.066	1.021	1.741	1.503	0.479	0.991	0.512	3.138
1:36:13	122.9	1.092	83.3	4.933	18.41	48.0245	110.1	1.067	1.021	1.741	1.505	0.481	0.993	0.512	3.128

**Consolidated Undrained Triaxial Test  
EM 1110-2-1906 Appendix X**

Consolidation Values			Final Values			Tested By	KDG	Project Number	175569069
Height	5.914 (in.)	15.020 (cm)	Height	4.826 (in.)		Date	12-9-09	Test Number	CU-1C
Diameter	2.786 (in.)	7.076 (cm)	Dia. avg.	3.271 (in.)		Press No.	1	Data File ID	1C
Area	6.095 (in <sup>2</sup> )	39.324 (cm <sup>2</sup> )	Area avg.	8.401 (in <sup>2</sup> )		Panel No.	A	Lateral Pressure (psi)	20.0
								Chamber Pressure - $\sigma_3$ (psi)	90

Clock Time (min.)	Load (lbf)	Deflection Dial Reading (in.)	Pore Pressure Reading (psi)	Corrected Height (in.)	Strain (%)	Corrected Area (cm <sup>2</sup> )	Corrected Load (lbf)	Corrected Deviator Stress (tsf)	Corrected Deviator Stress* (tsf)	$\sigma_1$ (tsf)	$\sigma_1'$ (tsf)	$\sigma_3'$ (tsf)	$p'$ ( $(\sigma_1 + \sigma_3)/2$ ) (tsf)	$q$ ( $(\sigma_1 - \sigma_3)/2$ ) (tsf)	Effective
															Principal Stress Ratio $\sigma_1' / \sigma_3'$
0:00:00	13.2	-0.021	70.1	5.914	0.00	39.3240	0.0	0.000	0.000	1.440	1.440	1.435	1.437	0.003	1.004
0:05:56	24.9	-0.015	70.9	5.908	0.10	39.3636	11.7	0.138	0.138	1.578	1.515	1.372	1.444	0.072	1.104
0:11:34	60.7	-0.009	74.5	5.902	0.20	39.4032	47.5	0.561	0.560	2.000	1.682	1.116	1.399	0.283	1.507
0:16:20	74.3	-0.003	75.7	5.896	0.30	39.4427	61.1	0.720	0.720	2.160	1.754	1.029	1.392	0.362	1.704
0:21:07	83.5	0.003	76.8	5.890	0.40	39.4827	70.3	0.827	0.826	2.266	1.779	0.947	1.363	0.416	1.878
0:25:46	91.2	0.009	77.5	5.884	0.50	39.5216	77.9	0.917	0.916	2.356	1.824	0.903	1.363	0.460	2.020
0:30:33	97.6	0.015	78.2	5.878	0.60	39.5613	84.4	0.992	0.991	2.431	1.849	0.853	1.351	0.498	2.168
0:35:16	103.1	0.021	78.5	5.872	0.70	39.6013	89.9	1.056	1.054	2.494	1.888	0.829	1.358	0.530	2.278
0:39:50	108.0	0.027	78.6	5.866	0.80	39.6429	94.8	1.112	1.110	2.550	1.938	0.823	1.381	0.558	2.356
0:44:19	112.7	0.033	79.2	5.860	0.90	39.6810	99.5	1.166	1.164	2.604	1.949	0.780	1.364	0.585	2.500
0:49:03	116.9	0.039	79.1	5.854	1.00	39.7213	103.7	1.214	1.212	2.652	2.003	0.786	1.394	0.608	2.548
0:53:47	120.9	0.045	79.6	5.849	1.10	39.7614	107.7	1.260	1.257	2.697	2.011	0.749	1.380	0.631	2.686
0:58:31	124.5	0.050	79.5	5.843	1.20	39.8015	111.2	1.300	1.297	2.737	2.060	0.758	1.409	0.651	2.718
1:03:14	128.3	0.056	79.9	5.837	1.30	39.8419	115.1	1.343	1.340	2.780	2.069	0.724	1.397	0.673	2.858
1:07:57	131.7	0.062	79.7	5.831	1.40	39.8821	118.5	1.382	1.379	2.819	2.122	0.738	1.430	0.692	2.874
1:12:43	134.8	0.068	80.0	5.825	1.50	39.9229	121.6	1.416	1.413	2.853	2.135	0.717	1.426	0.709	2.978
1:17:27	138.2	0.074	79.9	5.819	1.60	39.9638	125.0	1.454	1.450	2.890	2.185	0.730	1.457	0.728	2.995
1:22:10	141.2	0.080	80.1	5.813	1.70	40.0036	127.9	1.487	1.483	2.923	2.203	0.715	1.459	0.744	3.081
1:26:51	144.1	0.086	80.0	5.807	1.80	40.0449	130.9	1.520	1.516	2.956	2.244	0.723	1.483	0.760	3.104
1:31:36	147.1	0.092	80.0	5.801	1.90	40.0853	133.8	1.553	1.548	2.988	2.276	0.723	1.500	0.777	3.148
1:36:25	150.1	0.098	79.9	5.795	2.00	40.1262	136.9	1.586	1.581	3.021	2.311	0.725	1.518	0.793	3.189
1:41:05	153.1	0.104	79.3	5.789	2.10	40.1672	139.9	1.619	1.614	3.054	2.369	0.770	1.580	0.810	3.103
1:45:54	156.0	0.110	79.9	5.784	2.20	40.2082	142.8	1.652	1.646	3.086	2.378	0.726	1.552	0.826	3.274
1:50:24	158.3	0.115	79.6	5.778	2.30	40.2493	145.1	1.677	1.671	3.111	2.427	0.750	1.589	0.838	3.234
1:54:59	161.1	0.121	79.9	5.772	2.40	40.2910	147.9	1.706	1.701	3.141	2.433	0.727	1.580	0.853	3.346
1:59:40	164.0	0.127	79.6	5.766	2.50	40.3319	150.8	1.739	1.733	3.173	2.486	0.748	1.617	0.869	3.324
2:04:19	166.5	0.133	79.8	5.760	2.60	40.3733	153.3	1.765	1.759	3.199	2.499	0.735	1.617	0.882	3.399
2:08:55	169.1	0.139	79.5	5.754	2.70	40.4147	155.9	1.793	1.787	3.227	2.548	0.756	1.652	0.896	3.370
2:13:27	171.6	0.145	79.6	5.748	2.80	40.4561	158.3	1.819	1.812	3.252	2.568	0.750	1.659	0.909	3.423
2:18:10	173.9	0.151	79.3	5.742	2.90	40.4982	160.7	1.845	1.838	3.278	2.611	0.768	1.690	0.921	3.398
2:22:41	176.3	0.157	79.2	5.736	3.00	40.5398	163.1	1.871	1.864	3.304	2.643	0.774	1.709	0.934	3.413
2:27:15	179.2	0.163	79.2	5.730	3.10	40.5815	165.9	1.902	1.894	3.334	2.675	0.776	1.725	0.950	3.447
2:31:54	181.0	0.169	78.3	5.724	3.20	40.6232	167.7	1.920	1.912	3.352	2.759	0.842	1.801	0.959	3.277
2:36:35	183.2	0.175	79.0	5.718	3.30	40.6656	170.0	1.944	1.936	3.376	2.732	0.791	1.761	0.970	3.455
2:41:28	185.3	0.180	78.6	5.713	3.40	40.7073	172.1	1.966	1.958	3.398	2.783	0.820	1.801	0.981	3.393
2:46:24	188.1	0.186	78.8	5.707	3.50	40.7495	174.9	1.995	1.987	3.427	2.798	0.806	1.802	0.996	3.471
2:51:22	190.1	0.192	78.4	5.701	3.60	40.7916	176.9	2.016	2.007	3.447	2.846	0.833	1.839	1.006	3.415
2:56:01	192.5	0.198	78.7	5.695	3.70	40.8341	179.3	2.041	2.032	3.472	2.853	0.815	1.834	1.019	3.500
3:00:45	194.5	0.204	78.3	5.689	3.80	40.8764	181.3	2.063	2.053	3.493	2.903	0.845	1.874	1.029	3.436
3:05:33	196.7	0.210	78.4	5.683	3.90	40.9192	183.5	2.086	2.076	3.516	2.914	0.833	1.873	1.041	3.499
3:10:25	198.3	0.216	78.0	5.677	4.00	40.9617	185.1	2.101	2.091	3.531	2.959	0.863	1.911	1.048	3.429
3:15:16	200.7	0.222	78.1	5.671	4.10	41.0042	187.4	2.126	2.115	3.555	2.974	0.854	1.914	1.060	3.484
3:20:07	202.6	0.228	77.8	5.665	4.20	41.0477	189.4	2.146	2.135	3.575	3.020	0.880	1.950	1.070	3.434
3:24:57	204.3	0.234	77.8	5.659	4.30	41.0898	191.0	2.162	2.151	3.591	3.034	0.877	1.956	1.078	3.458
3:29:42	206.4	0.240	77.5	5.654	4.40	41.1328	193.2	2.184	2.173	3.613	3.077	0.899	1.988	1.089	3.422
3:34:30	208.4	0.246	77.5	5.648	4.50	41.1762	195.2	2.204	2.193	3.633	3.099	0.901	2.000	1.099	3.441
3:39:22	209.9	0.251	77.2	5.642	4.60	41.2192	196.7	2.219	2.208	3.648	3.132	0.919	2.025	1.107	3.409
3:44:08	211.5	0.257	77.0	5.636	4.70	41.2623	198.3	2.234	2.223	3.663	3.163	0.935	2.049	1.114	3.382
3:48:46	213.6	0.263	77.0	5.630	4.80	41.3061	200.4	2.256	2.244	3.684	3.183	0.934	2.058	1.125	3.409
3:53:30	215.5	0.269	76.5	5.624	4.90	41.3489	202.3	2.274	2.262	3.702	3.239	0.971	2.105	1.134	3.334
3:58:17	216.8	0.275	76.7	5.618	5.00	41.3925	203.6	2.287	2.274	3.714	3.234	0.954	2.094	1.140	3.390
4:03:05	218.4	0.281	76.4	5.612	5.10	41.4360	205.2	2.303	2.290	3.730	3.278	0.983	2.131	1.148	3.336
4:07:50	220.3	0.287	76.5	5.606	5.20	41.4798	207.1	2.321	2.308	3.748	3.283	0.970	2.127	1.157	3.386
4:12:48	222.0	0.293	76.2	5.600	5.30	41.5238	208.8	2.338	2.325	3.765	3.325	0.995	2.160	1.165	3.341
4:17:32	223.4	0.299	76.3	5.594	5.40	41.5675	210.1	2.351	2.337	3.777	3.328	0.985	2.156	1.171	3.378
4:22:22	225.0	0.305	75.9	5.588	5.50	41.6116	211.7	2.366	2.353	3.793	3.373	1.015	2.194	1.179	3.322
4:27:14	226.6	0.310	76.0	5.583	5.60	41.6552	213.4	2.382	2.368	3.808	3.379	1.006	2.192	1.187	3.361
4:32:06	228.4	0.316	75.7	5.577	5.70	41.6994	215.2	2.399	2.385	3.825	3.422	1.032	2.227	1.195	3.317
4:36:53	229.5	0.322	75.7	5.571	5.80	41.7438	216.3	2.410	2.395	3.835	3.427	1.026	2.227	1.200	3.339
4:41:45	231.1	0.328	75.4	5.565	5.90	41.7883	217.9	2.425	2.410	3.850	3.467	1.052	2.260	1.208	3.296

# Consolidated Undrained Triaxial Test EM 1110-2-1906 Appendix X

Consolidation Values			Final Values			Tested By <u>KDG</u>		Project Number <u>175569069</u>	
Height	<u>5.914 (in.)</u>	<u>15.020 (cm)</u>	Height	<u>4.826 (in.)</u>		Date	<u>12-9-09</u>	Test Number	<u>CU-1C</u>
Diameter	<u>2.786 (in)</u>	<u>7.076 (cm)</u>	Dia. avg.	<u>3.271 (in)</u>		Press No.	<u>1</u>	Data File ID	<u>1C</u>
Area	<u>6.095 (in<sup>2</sup>)</u>	<u>39.324 (cm<sup>2</sup>)</u>	Area avg.	<u>8.401 (in<sup>2</sup>)</u>		Panel No.	<u>A</u>	Lateral Pressure (psi)	<u>20.0</u>
								Chamber Pressure - $\sigma_3$ (psi)	<u>90</u>

Clock Time (min.)	Load (lbf)	Deflection Dial Reading (in.)	Pore Pressure Reading (psi)	Corrected Height (in.)	Strain (%)	Corrected Area (cm <sup>2</sup> )	Corrected Load (lbf)	Deviator Stress (tsf)	Corrected Deviator Stress* (tsf)	$\sigma_1$ (tsf)	$\sigma_1'$ (tsf)	$\sigma_2'$ (tsf)	$p' = (\sigma_1' + \sigma_3')/2$ (tsf)	$q = (\sigma_1 - \sigma_3)/2$ (tsf)	Effective Principal Stress Ratio $\sigma_1' / \sigma_3'$
4:46:38	232.6	0.334	75.4	5.559	6.00	41.8327	219.4	2.439	2.424	3.864	3.477	1.048	2.262	1.215	3.319
4:51:20	233.8	0.340	75.2	5.553	6.10	41.8769	220.6	2.450	2.435	3.875	3.509	1.069	2.289	1.220	3.282
4:56:06	234.9	0.346	75.1	5.547	6.20	41.9217	221.7	2.459	2.444	3.884	3.525	1.075	2.300	1.225	3.278
5:00:53	236.6	0.352	74.9	5.541	6.30	41.9664	223.4	2.475	2.459	3.899	3.554	1.089	2.321	1.232	3.263
5:05:34	238.1	0.358	74.6	5.535	6.40	42.0113	224.8	2.489	2.473	3.913	3.589	1.111	2.350	1.239	3.230
5:10:12	239.4	0.364	74.6	5.529	6.50	42.0561	226.2	2.501	2.485	3.925	3.595	1.105	2.350	1.245	3.252
5:14:51	240.5	0.370	74.1	5.523	6.60	42.1011	227.2	2.510	2.494	3.934	3.646	1.147	2.396	1.249	3.178
5:19:31	242.3	0.375	74.5	5.518	6.70	42.1461	229.0	2.527	2.510	3.950	3.634	1.119	2.377	1.258	3.248
5:24:11	243.4	0.381	74.1	5.512	6.80	42.1917	230.2	2.537	2.520	3.960	3.670	1.144	2.407	1.263	3.207
5:28:53	244.6	0.387	74.3	5.506	6.90	42.2367	231.4	2.547	2.530	3.970	3.668	1.133	2.400	1.268	3.238
5:33:32	246.1	0.393	73.9	5.500	7.00	42.2822	232.9	2.561	2.544	3.984	3.709	1.160	2.434	1.274	3.198
5:38:12	247.5	0.399	73.9	5.494	7.10	42.3275	234.2	2.573	2.556	3.996	3.717	1.156	2.436	1.280	3.215
5:42:49	248.1	0.405	73.6	5.488	7.20	42.3734	234.9	2.578	2.560	4.000	3.744	1.178	2.461	1.283	3.177
5:47:26	249.6	0.411	73.7	5.482	7.30	42.4194	236.3	2.591	2.573	4.013	3.753	1.175	2.464	1.289	3.194
5:52:09	251.0	0.417	73.4	5.476	7.40	42.4647	237.8	2.604	2.586	4.026	3.783	1.192	2.488	1.296	3.173
5:56:49	251.8	0.423	73.2	5.470	7.50	42.5104	238.6	2.610	2.591	4.031	3.804	1.208	2.506	1.298	3.150
6:01:34	253.6	0.429	73.2	5.464	7.60	42.5563	240.4	2.627	2.608	4.048	3.823	1.209	2.516	1.307	3.161
6:06:27	254.3	0.435	72.4	5.458	7.70	42.6028	241.1	2.632	2.613	4.053	3.883	1.265	2.574	1.309	3.069
6:11:23	255.9	0.441	73.0	5.453	7.80	42.6493	242.7	2.646	2.626	4.066	3.858	1.226	2.542	1.316	3.147
6:16:16	256.9	0.446	72.4	5.447	7.90	42.6950	243.7	2.654	2.634	4.074	3.909	1.270	2.590	1.320	3.078
6:21:03	257.9	0.452	72.7	5.441	8.00	42.7417	244.7	2.662	2.642	4.082	3.891	1.243	2.567	1.324	3.130
6:25:52	259.5	0.458	72.3	5.435	8.10	42.7878	246.3	2.676	2.656	4.096	3.936	1.275	2.605	1.331	3.088
6:30:46	260.2	0.464	72.5	5.429	8.20	42.8345	247.0	2.681	2.661	4.101	3.927	1.261	2.594	1.333	3.114
6:35:29	261.7	0.470	72.2	5.423	8.30	42.8810	248.5	2.694	2.674	4.114	3.964	1.285	2.624	1.339	3.085
6:40:27	262.8	0.476	72.4	5.417	8.40	42.9278	249.5	2.703	2.682	4.122	3.958	1.270	2.614	1.344	3.115
6:45:28	263.9	0.482	72.0	5.411	8.50	42.9752	250.7	2.713	2.692	4.132	3.995	1.298	2.647	1.349	3.078
6:50:19	265.1	0.488	72.2	5.405	8.60	43.0217	251.9	2.722	2.701	4.141	3.990	1.284	2.637	1.353	3.108
6:55:07	266.1	0.494	71.8	5.399	8.70	43.0688	252.9	2.730	2.709	4.149	4.027	1.313	2.670	1.357	3.066
6:59:58	267.4	0.500	71.9	5.393	8.80	43.1162	254.2	2.741	2.719	4.159	4.026	1.301	2.663	1.362	3.094
7:04:54	268.3	0.506	71.6	5.388	8.90	43.1634	255.1	2.748	2.726	4.166	4.059	1.327	2.693	1.366	3.058
7:09:44	269.3	0.511	71.7	5.382	8.99	43.2106	256.1	2.756	2.734	4.174	4.059	1.320	2.690	1.370	3.075
7:14:24	270.6	0.517	71.4	5.376	9.09	43.2581	257.4	2.767	2.745	4.185	4.089	1.339	2.714	1.375	3.053
7:19:23	271.6	0.523	71.4	5.370	9.19	43.3058	258.4	2.775	2.752	4.192	4.094	1.337	2.716	1.379	3.062
7:24:18	272.5	0.529	71.2	5.364	9.29	43.3534	259.3	2.781	2.758	4.198	4.120	1.357	2.738	1.382	3.037
7:29:03	273.7	0.535	71.2	5.358	9.39	43.4013	260.5	2.791	2.768	4.208	4.126	1.353	2.740	1.386	3.049
7:34:02	274.9	0.541	71.0	5.352	9.50	43.4495	261.7	2.800	2.777	4.217	4.153	1.371	2.762	1.391	3.029
7:38:55	275.7	0.547	70.9	5.346	9.59	43.4975	262.5	2.806	2.782	4.222	4.161	1.374	2.767	1.394	3.029
7:43:43	276.6	0.553	70.7	5.340	9.69	43.5454	263.4	2.812	2.788	4.228	4.180	1.387	2.783	1.397	3.014
7:48:39	277.5	0.559	70.6	5.334	9.79	43.5936	264.3	2.819	2.795	4.235	4.199	1.399	2.799	1.400	3.001
7:53:31	278.9	0.565	70.6	5.328	9.89	43.6419	265.7	2.831	2.807	4.247	4.212	1.400	2.806	1.406	3.008
7:58:20	279.8	0.570	69.8	5.323	9.99	43.6904	266.6	2.837	2.812	4.252	4.273	1.455	2.864	1.409	2.936
8:03:06	280.8	0.576	70.3	5.317	10.09	43.7389	267.5	2.844	2.819	4.259	4.240	1.415	2.827	1.412	2.996
8:08:00	281.8	0.582	69.8	5.311	10.19	43.7877	268.6	2.853	2.827	4.267	4.287	1.455	2.871	1.416	2.947
8:12:52	283.0	0.588	70.2	5.305	10.29	43.8368	269.8	2.862	2.837	4.277	4.267	1.425	2.846	1.421	2.994
8:17:43	283.4	0.594	69.8	5.299	10.39	43.8853	270.2	2.863	2.837	4.277	4.297	1.454	2.876	1.421	2.954
8:22:27	284.8	0.600	70.0	5.293	10.49	43.9343	271.6	2.875	2.849	4.289	4.292	1.438	2.865	1.427	2.985
8:27:16	285.7	0.606	69.7	5.287	10.59	43.9836	272.5	2.881	2.854	4.294	4.321	1.461	2.891	1.430	2.957
8:32:03	286.7	0.612	69.9	5.281	10.69	44.0330	273.5	2.888	2.862	4.302	4.312	1.445	2.878	1.433	2.984
8:36:45	287.5	0.618	69.5	5.275	10.79	44.0820	274.3	2.894	2.867	4.307	4.346	1.474	2.910	1.436	2.949
8:41:30	289.0	0.624	69.7	5.269	10.89	44.1315	275.8	2.906	2.879	4.319	4.345	1.461	2.903	1.442	2.974
8:46:16	289.7	0.630	69.4	5.263	10.99	44.1811	276.5	2.910	2.883	4.323	4.372	1.484	2.928	1.444	2.946
8:50:55	290.7	0.636	69.4	5.258	11.09	44.2306	277.5	2.918	2.890	4.330	4.379	1.484	2.931	1.448	2.951
8:55:37	291.8	0.641	69.2	5.252	11.19	44.2807	278.6	2.926	2.898	4.338	4.399	1.496	2.947	1.452	2.941
9:00:23	292.8	0.647	69.2	5.246	11.29	44.3308	279.6	2.933	2.905	4.345	4.406	1.496	2.951	1.455	2.945
9:05:04	293.4	0.653	69.0	5.240	11.39	44.3803	280.2	2.936	2.908	4.348	4.423	1.510	2.966	1.457	2.929
9:09:50	294.4	0.659	68.6	5.234	11.49	44.4304	281.2	2.943	2.915	4.355	4.464	1.544	3.004	1.460	2.891
9:14:44	295.7	0.665	68.9	5.228	11.59	44.4810	282.5	2.954	2.925	4.365	4.449	1.519	2.984	1.465	2.929
9:19:33	296.2	0.671	68.3	5.222	11.69	44.5311	283.0	2.955	2.926	4.366	4.493	1.561	3.027	1.466	2.877
9:24:19	297.4	0.677	68.7	5.216	11.79	44.5815	284.1	2.964	2.935	4.375	4.472	1.532	3.002	1.470	2.919
9:29:14	298.2	0.683	68.3	5.210	11.89	44.6322	285.0	2.969	2.940	4.380	4.507	1.562	3.034	1.472	2.885

# Consolidated Undrained Triaxial Test EM 1110-2-1906 Appendix X

Consolidation Values			Final Values			Tested By <u>KDG</u>		Project Number <u>175569069</u>	
Height	<u>5.914 (in.)</u>	<u>15.020 (cm)</u>	Height	<u>4.826 (in.)</u>		Date	<u>12-9-09</u>	Test Number	<u>CU-1C</u>
Diameter	<u>2.766 (in)</u>	<u>7.076 (cm)</u>	Dia. avg.	<u>3.271 (in)</u>		Press No.	<u>1</u>	Data File ID	<u>1C</u>
Area	<u>6.095 (in<sup>2</sup>)</u>	<u>39.324 (cm<sup>2</sup>)</u>	Area avg.	<u>8.401 (in<sup>2</sup>)</u>		Panel No.	<u>A</u>	Lateral Pressure (psi)	<u>20.0</u>
								Chamber Pressure - $\sigma_3$ (psi)	<u>90</u>

Clock Time (min.)	Load (lbf)	Deflection Dial Reading (in.)	Pore Pressure Reading (psi)	Corrected Height (in.)	Strain (%)	Corrected Area (cm <sup>2</sup> )	Corrected Load (lbf)	Deviator Stress (tsf)	Corrected Deviator Stress* (tsf)	$\sigma_1$ (tsf)	$\sigma_1'$ (tsf)	$\sigma_3'$ (tsf)	$p' = (\sigma_1' + \sigma_3')/2$ (tsf)	$q = (\sigma_1 - \sigma_3)/2$ (tsf)	Effective Principal
															Stress Ratio $\sigma_1' / \sigma_3'$
9:34:11	299.3	0.689	68.6	5.204	11.99	44.6832	286.1	2.977	2.947	4.387	4.496	1.544	3.020	1.476	2.912
9:38:57	300.2	0.695	68.2	5.198	12.09	44.7335	287.0	2.984	2.954	4.394	4.529	1.570	3.050	1.479	2.885
9:43:58	300.9	0.701	68.4	5.193	12.19	44.7845	287.7	2.987	2.957	4.397	4.520	1.558	3.039	1.481	2.901
9:48:54	301.9	0.706	68.1	5.187	12.29	44.8354	288.7	2.995	2.964	4.404	4.548	1.579	3.064	1.485	2.880
9:53:55	303.0	0.712	68.2	5.181	12.39	44.8872	289.8	3.002	2.971	4.411	4.543	1.566	3.054	1.488	2.901
9:58:47	304.0	0.718	67.9	5.175	12.48	44.9381	290.7	3.009	2.978	4.418	4.571	1.589	3.080	1.491	2.877
10:03:45	305.3	0.724	68.2	5.169	12.59	44.9894	292.1	3.019	2.988	4.428	4.564	1.571	3.068	1.496	2.905
10:08:49	306.2	0.730	67.8	5.163	12.69	45.0414	293.0	3.024	2.993	4.433	4.597	1.599	3.098	1.499	2.875
10:13:48	306.7	0.736	68.0	5.157	12.79	45.0925	293.5	3.027	2.995	4.435	4.586	1.585	3.086	1.500	2.892
10:18:50	307.5	0.742	67.6	5.151	12.89	45.1444	294.3	3.031	2.999	4.439	4.618	1.613	3.115	1.502	2.862
10:23:51	308.8	0.748	67.8	5.145	12.99	45.1962	295.6	3.041	3.009	4.449	4.612	1.597	3.104	1.507	2.887
10:28:51	309.3	0.754	67.4	5.139	13.09	45.2479	296.1	3.043	3.010	4.450	4.639	1.624	3.132	1.508	2.857
10:33:43	310.5	0.760	67.6	5.133	13.19	45.3002	297.3	3.051	3.019	4.459	4.635	1.611	3.123	1.512	2.877
10:38:38	311.2	0.766	67.3	5.128	13.29	45.3523	298.0	3.055	3.022	4.462	4.662	1.635	3.149	1.514	2.851
10:43:36	312.0	0.771	67.4	5.122	13.39	45.4045	298.8	3.060	3.027	4.467	4.657	1.624	3.140	1.516	2.867
10:48:35	312.5	0.777	67.1	5.116	13.49	45.4570	299.3	3.062	3.029	4.469	4.681	1.648	3.164	1.517	2.841
10:53:29	313.6	0.783	67.2	5.110	13.59	45.5096	300.4	3.070	3.036	4.476	4.682	1.641	3.162	1.521	2.853
10:58:30	314.6	0.789	66.9	5.104	13.69	45.5623	301.4	3.076	3.042	4.482	4.707	1.660	3.184	1.524	2.836
11:03:25	315.3	0.795	67.0	5.098	13.79	45.6151	302.0	3.079	3.046	4.485	4.705	1.655	3.180	1.525	2.843
11:08:19	315.9	0.801	66.7	5.092	13.89	45.6685	302.6	3.082	3.047	4.487	4.727	1.674	3.200	1.526	2.823
11:13:17	316.8	0.807	66.8	5.086	13.99	45.7214	303.6	3.088	3.053	4.493	4.729	1.671	3.200	1.529	2.831
11:18:16	317.6	0.813	66.6	5.080	14.09	45.7742	304.6	3.094	3.059	4.499	4.749	1.684	3.217	1.532	2.819
11:23:12	318.5	0.819	66.6	5.074	14.19	45.8277	305.2	3.097	3.062	4.502	4.753	1.686	3.219	1.534	2.819
11:28:06	319.6	0.825	66.4	5.068	14.29	45.8811	306.4	3.105	3.070	4.510	4.772	1.697	3.235	1.537	2.811
11:33:05	320.7	0.831	66.4	5.062	14.39	45.9351	307.5	3.113	3.077	4.517	4.783	1.701	3.242	1.541	2.812
11:37:57	321.5	0.836	66.3	5.057	14.49	45.9884	308.3	3.117	3.081	4.521	4.792	1.706	3.249	1.543	2.809
11:42:49	322.0	0.842	65.6	5.051	14.59	46.0420	308.8	3.119	3.083	4.523	4.844	1.757	3.301	1.544	2.758
11:47:45	322.9	0.848	66.1	5.045	14.69	46.0960	309.6	3.124	3.087	4.527	4.811	1.719	3.265	1.546	2.799
11:52:44	323.9	0.854	65.6	5.039	14.79	46.1503	310.7	3.130	3.093	4.533	4.854	1.755	3.304	1.549	2.766
11:57:36	324.7	0.860	66.0	5.033	14.89	46.2047	311.5	3.135	3.098	4.538	4.829	1.727	3.278	1.551	2.797
12:02:23	325.6	0.866	65.6	5.027	14.99	46.2596	312.4	3.141	3.103	4.543	4.862	1.753	3.308	1.554	2.773
12:07:14	326.4	0.872	66.0	5.021	15.09	46.3134	313.2	3.144	3.107	4.547	4.842	1.730	3.286	1.556	2.799
12:12:02	326.8	0.878	65.6	5.015	15.19	46.3676	313.6	3.145	3.107	4.547	4.867	1.754	3.311	1.556	2.774
12:16:48	328.0	0.884	65.9	5.009	15.29	46.4228	314.8	3.153	3.115	4.555	4.852	1.732	3.292	1.560	2.802
12:21:37	329.0	0.890	65.6	5.003	15.39	46.4774	315.8	3.160	3.121	4.561	4.886	1.760	3.323	1.563	2.777
12:26:30	329.8	0.896	65.7	4.997	15.49	46.5325	316.6	3.164	3.125	4.565	4.877	1.746	3.311	1.565	2.793
12:31:15	330.3	0.901	65.4	4.992	15.59	46.5872	317.1	3.165	3.127	4.567	4.904	1.772	3.338	1.566	2.767
12:36:15	331.5	0.907	65.6	4.986	15.69	46.6426	318.2	3.173	3.134	4.574	4.896	1.757	3.327	1.570	2.786
12:41:11	332.5	0.913	65.3	4.980	15.79	46.6983	319.3	3.180	3.140	4.580	4.922	1.777	3.349	1.573	2.771
12:46:04	333.0	0.919	65.4	4.974	15.89	46.7534	319.8	3.180	3.141	4.581	4.914	1.768	3.341	1.573	2.780
12:50:54	333.8	0.925	65.2	4.968	15.99	46.8089	320.5	3.184	3.145	4.585	4.937	1.788	3.363	1.575	2.762
12:55:50	335.0	0.931	65.3	4.962	16.09	46.8647	321.8	3.193	3.153	4.593	4.937	1.779	3.358	1.579	2.775
13:00:52	335.6	0.937	65.1	4.956	16.19	46.9207	322.3	3.195	3.154	4.594	4.956	1.796	3.376	1.580	2.759
13:05:44	336.5	0.943	65.1	4.950	16.29	46.9767	323.3	3.200	3.160	4.600	4.959	1.794	3.376	1.583	2.765
13:10:38	337.2	0.949	64.9	4.944	16.39	47.0330	324.0	3.203	3.163	4.603	4.975	1.807	3.391	1.584	2.753
13:15:46	338.2	0.955	65.0	4.938	16.49	47.0899	325.0	3.209	3.168	4.608	4.976	1.803	3.389	1.587	2.760
13:20:39	338.3	0.961	64.8	4.932	16.59	47.1457	325.1	3.207	3.166	4.606	4.987	1.817	3.402	1.585	2.746
13:25:36	339.2	0.967	64.6	4.927	16.69	47.2025	326.0	3.212	3.170	4.610	5.004	1.828	3.416	1.588	2.737
13:30:43	339.9	0.972	64.7	4.921	16.79	47.2587	326.7	3.215	3.173	4.613	5.001	1.823	3.412	1.589	2.743
13:35:47	340.4	0.978	64.2	4.915	16.89	47.3155	327.2	3.216	3.174	4.614	5.034	1.855	3.445	1.590	2.714
13:40:48	341.5	0.984	64.5	4.909	16.99	47.3726	328.3	3.223	3.181	4.621	5.020	1.834	3.427	1.593	2.737
13:46:03	342.3	0.990	64.4	4.903	17.09	47.4301	329.1	3.227	3.184	4.624	5.033	1.844	3.439	1.595	2.730
13:51:08	343.6	0.996	64.5	4.897	17.19	47.4871	330.4	3.235	3.192	4.632	5.037	1.839	3.438	1.599	2.739
13:56:05	344.1	1.002	63.7	4.891	17.29	47.5441	330.9	3.236	3.194	4.634	5.089	1.891	3.490	1.599	2.692
14:01:09	345.1	1.008	64.3	4.885	17.39	47.6017	331.9	3.242	3.199	4.639	5.055	1.851	3.453	1.602	2.731
14:06:11	345.8	1.014	63.8	4.879	17.49	47.6596	332.6	3.245	3.202	4.642	5.096	1.889	3.493	1.603	2.698
14:11:14	346.7	1.020	64.2	4.873	17.59	47.7173	333.5	3.250	3.206	4.646	5.071	1.860	3.465	1.606	2.727
14:16:11	347.4	1.026	63.7	4.867	17.69	47.7755	334.2	3.252	3.209	4.649	5.106	1.893	3.500	1.607	2.698
14:21:10	348.3	1.031	64.1	4.862	17.79	47.8333	335.1	3.258	3.213	4.653	5.086	1.867	3.477	1.609	2.724
14:26:13	349.2	1.037	63.7	4.856	17.89	47.8920	335.9	3.262	3.217	4.657	5.118	1.896	3.507	1.611	2.700



## Consolidated Undrained Triaxial Test EM 1110-2-1906 Appendix X

Consolidation Values		
Height	<u>5.914 (in.)</u>	<u>15.020 (cm)</u>
Diameter	<u>2.766 (in)</u>	<u>7.076 (cm)</u>
Area	<u>6.095 (in<sup>2</sup>)</u>	<u>39.324 (cm<sup>2</sup>)</u>

Final Values	
Height	<u>4.826 (in.)</u>
Dia. avg.	<u>3.271 (in)</u>
Area avg.	<u>8.401 (in<sup>2</sup>)</u>



Tested By	<u>KDG</u>
Date	<u>12-9-09</u>
Press No.	<u>1</u>
Panel No.	<u>A</u>

Project Number	<u>175569069</u>
Test Number	<u>CU-1C</u>
Data File ID	<u>1C</u>
Lateral Pressure (psi)	<u>20.0</u>
Chamber Pressure - $\sigma_3$ (psi)	<u>90</u>

Clock Time (min.)	Load (lbf)	Deflection Dial Reading (in.)	Pore Pressure Reading (psi)	Corrected Height (in.)	Strain (%)	Corrected Area (cm <sup>2</sup> )	Corrected Load (lbf)	Deviator Stress (tsf)	Corrected Deviator Stress* (tsf)	$\sigma_1$ (tsf)	$\sigma_1'$ (tsf)	$\sigma_3'$ (tsf)	$p'$ ( $(\sigma_1' + \sigma_3')/2$ ) (tsf)	$q$ ( $(\sigma_1 - \sigma_3)/2$ ) (tsf)	Effective Principal Stress Ratio
															$\sigma_1' / \sigma_3'$
14:31:10	349.5	1.043	63.9	4.850	17.99	47.9502	336.3	3.261	3.216	4.666	5.101	1.879	3.490	1.611	2.715
14:36:11	350.4	1.049	63.5	4.844	18.09	48.0086	337.2	3.266	3.221	4.661	5.131	1.905	3.518	1.613	2.694
14:41:17	351.5	1.055	63.8	4.838	18.19	48.0675	338.3	3.272	3.227	4.667	5.116	1.884	3.500	1.616	2.716
14:46:21	351.9	1.061	63.4	4.832	18.29	48.1257	338.6	3.272	3.227	4.667	5.144	1.912	3.528	1.616	2.691
14:51:29	352.4	1.067	63.7	4.826	18.39	48.1846	339.2	3.274	3.228	4.668	5.128	1.895	3.511	1.617	2.707

Failure Criterion: Maximum Effective Principal Stress Ratio

**Effective Strength Envelope**

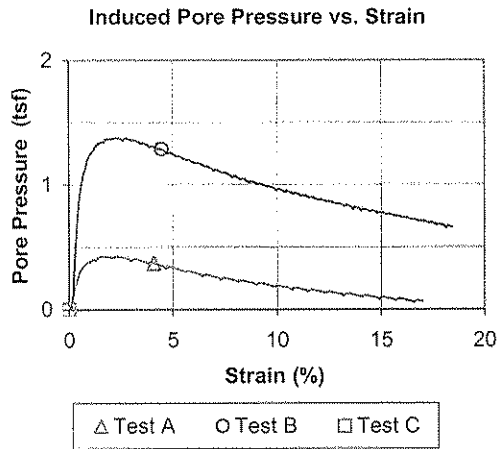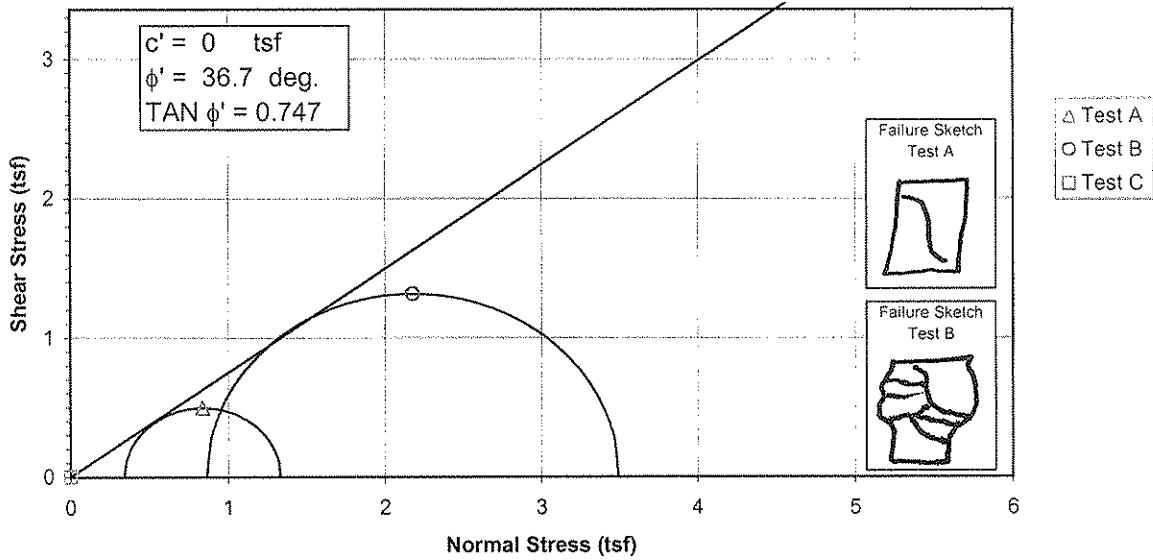

Specimen No.		A	B	C
Initial Data	Water content %	$W_o$ 19.3	18.2	#####
	Dry Density PCF	$\gamma_{d_o}$ 106.8	111.2	#####
	Saturation %	$S_o$ 90.1	95.2	#####
	Void Ratio	$e_o$ 0.578	0.515	#####
After Shear	Water content %	$W_i$ 21.1	14.6	#####
	Dry Density PCF	$\gamma_{d_i}$ 107.3	120.8	#####
	Saturation %	$S_i$ 100.0	100.0	#####
	Void Ratio	$e_i$ 0.571	0.395	#####
	Final Back Pressure TSF	$u_c$ 5.76	4.32	0.00
	Minor Principal Stress TSF @ failure	$\sigma_3'f$ 0.34	0.87	0.00
	Maximum Deviator Stress (tsf) @ failure	$(\sigma_1' - \sigma_3')_{max}$ 0.99	2.62	0.00
	Time to $(\sigma_1' - \sigma_3')_{max}$ min.	$t_f$ 48.5	102.9	0.0
	Ultimate Deviator Stress, t/sq ft	$(\sigma_1' - \sigma_3')_{ult}$ n/a	n/a	0.00
	Initial Diameter, in.	$D_o$ 2.872	2.836	#####
	Initial Height, in.	$H_o$ 6.008	5.975	#####


Controlled - Strain Test				Initial Height, in.				$H_o$	6.008	5.975	#####
Description of Specimens    Sandy Lean Clay (CL), red brown, moist, firm											
				Type of Specimen	Undisturbed				Type of test	R	
LL	PL	PI	Gs	2.7	Project    PAF - Peabody Ash Pond						
Remarks:				Boring No.		STN-18 (N1), STN-6 (N1)		Sample No.		2	
				Depth Elev.		8.4'-8.9', 11.2'-11.7'		Laboratory		Stantec    Date    12-22-09	
<b>TRIAXIAL COMPRESSION TEST REPORT</b>											

**Consolidated Undrained Triaxial Test  
EM 1110-2-1906 Appendix X**


Project PAF - Peabody Ash Pond  
 Sample ID STN-18 (N-1), 8.4'-8.9' & STN-6 (N1), 11.2'-11.7'  
 Failure Criterion: Maximum Effective Principal Stress Ratio       $\phi' = 36.7 \text{ deg.}$

Project No. 175569069  
 Test Number 2  
 $c' = 0.00 \text{ tsf}$

**p' vs. q Plot**

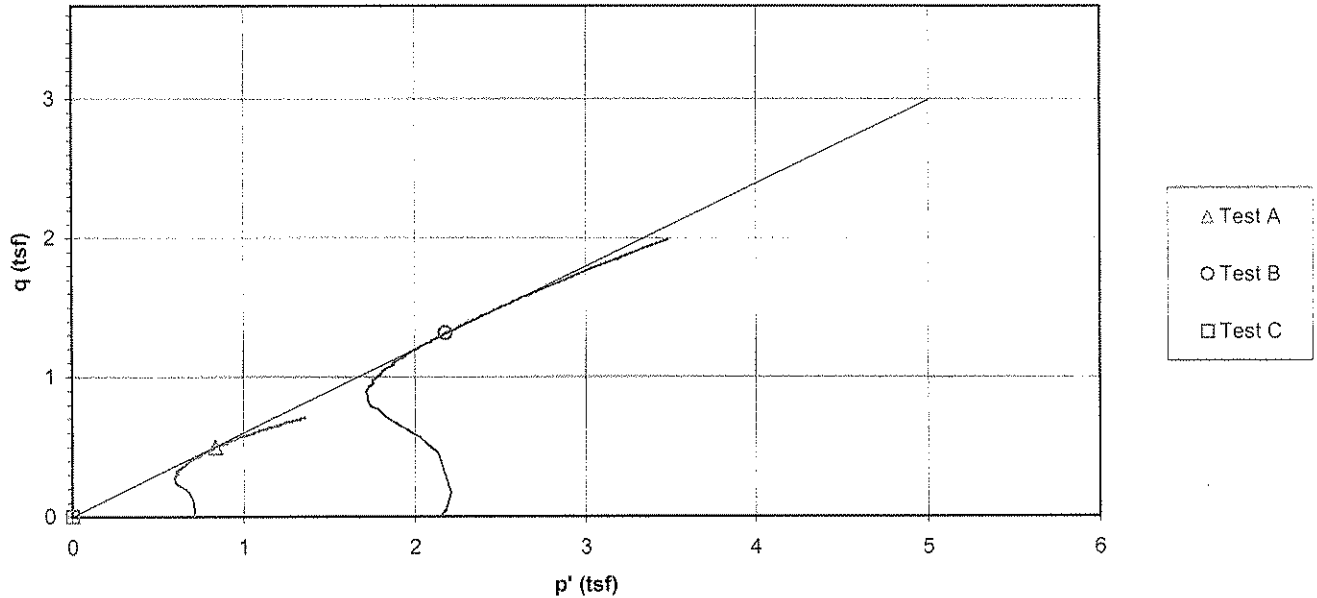

**Deviator Stress and Induced Pore Pressure vs. Axial Strain**

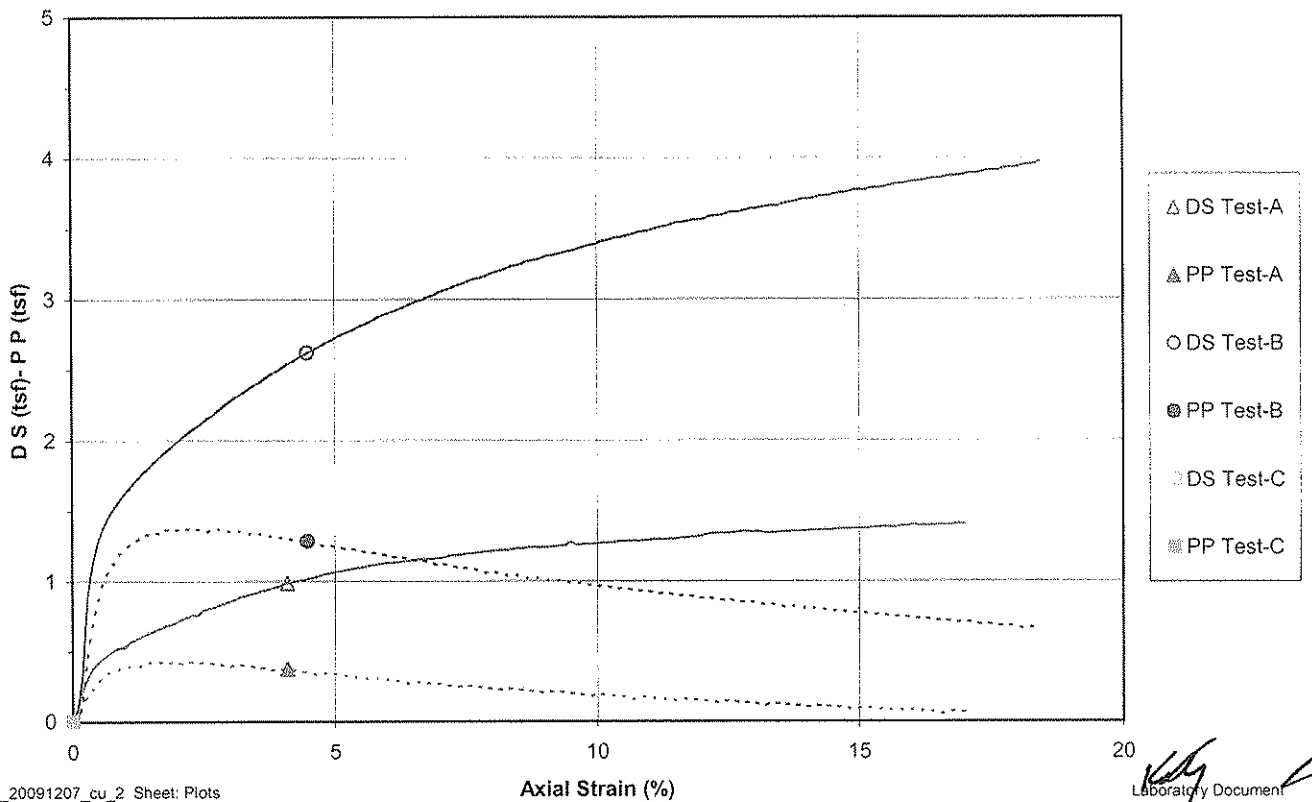

Project Name	PAF - Peabody Ash Pond			Project Number	175569069			
Sample Identification	STN-18 (N-1), 8.4'-8.9'			Test Number	CU-2A			
Visual Description	Sandy Lean Clay (CL), red brown, moist, firm			Prepared By	CM			
Undisturbed	Source STN-18, (N-1), 8.4'-9.0'			Date	12-9-2009			
Specific Gravity	2.70	ASTM D854 Method A	Liquid Limit	N/A	Plastic Limit	N/A	Plasticity Index	N/A

#### Initial Specimen Data

Specimen Diameter (in.)	Specimen Height (in.)	Volumes (in <sup>3</sup> )	Specimen
Top <u>2.876</u>	1 <u>6.012</u>	Sample <u>39.0283</u> (V <sub>o</sub> )	Wet Weight (g) <u>1301.76</u>
Middle <u>2.859</u>	2 <u>6.009</u>	Solids <u>24.6650</u> (VS <sub>o</sub> )	Dry Weight (g) <u>1091.37</u>
Bottom <u>2.893</u>	3 <u>6.013</u>	Water <u>12.8380</u> (Vw <sub>o</sub> )	Wet Unit Weight (pcf) <u>127.1</u>
Avg. <u>2.8760</u> (D <sub>o</sub> )	4 <u>5.998</u>	Voids <u>14.3633</u> (Vv <sub>o</sub> )	Dry Unit Weight (pcf) <u>106.5</u>
Area (in <sup>2</sup> ) <u>6.4963</u> (A <sub>o</sub> )	Avg. (H <sub>o</sub> ) <u>6.0078</u>	Degree of Saturation (%) <u>89.4</u> (S <sub>o</sub> )	
Moisture Content (%) <u>19.3</u>	Final Trimmings	Void Ratio <u>0.582</u>	

#### Saturation

Set Up & Saturated:	Wet <u>xx</u>	Dry _____	Set up By	KDG	
Back Pressure Saturated to:	<u>80</u> (psi)	Final Pore Pressure Parameter B	<u>0.96</u>	Date	11-9-09
			Panel Board Number	D	

Height Readings (in.)	Back Pressure Burette	Chamber Burette	Specimen Height (in.)
Initial <u>0.1268</u>	Initial <u>16.65</u> (in.)	Initial <u>11.76</u> (in.)	<u>6.0033</u> (H <sub>s</sub> )
Final <u>0.1313</u>	Final <u>9.94</u> (in.)	Final <u>8.74</u> (in.)	Area (in <sup>2</sup> ) Method A <u>6.4866</u> (A <sub>s</sub> )
Change <u>-0.0045</u> (ΔH <sub>o</sub> )	Change <u>-6.71</u> (in.)	Change <u>-3.02</u> (in.)	Specimen Volume (in <sup>3</sup> ) <u>38.94</u> (Vs)




#### Consolidation

Height Readings (in.)	Back Pressure Burette Readings	Chamber Burette Readings	Pressures (psi)
Initial <u>0.1313</u>	Initial <u>1.37</u> (in.)	Initial <u>17.17</u> (in.)	Chamber <u>90</u>
Final <u>0.1556</u>	Final <u>4.18</u> (in.)	Final <u>14.04</u> (in.)	Back <u>80</u>
Change <u>-0.0243</u> (ΔH <sub>c</sub> )	Change <u>-2.81</u> (in.)	Change <u>-3.13</u> (in.)	Lateral <u>10</u> (σ <sub>3</sub> )
Height (in.) <u>5.9790</u> (H <sub>c</sub> )		Volume (in <sup>3</sup> ) <u>38.7484</u> (V <sub>c</sub> )	t <sub>50</sub> (min.) <u>1.603</u>
Area (in <sup>2</sup> ) Method B <u>6.4808</u> (A <sub>c</sub> )		Volume - Water (in <sup>3</sup> ) <u>14.0834</u> (VW <sub>c</sub> )	
Diameter (in.) <u>2.8726</u> (D <sub>c</sub> )		Water Content (%) <u>21.1</u>	
Dry Density (pcf) <u>107.3</u>		Degree of Saturation (%) <u>100.0</u> (S <sub>c</sub> )	Void Ratio <u>0.571</u>

#### After Test

Final Measurements	Final Moisture Content	Stresses (membrane corrected) at Failure (psi)
Maximum Diameter <u>3.25</u> (in.)	Wet Weight (g) <u>1322.17</u>	Corrected Deviator <u>0.99</u> σ <sub>d</sub> (tsf)
Wet weight (g) <u>1322.17</u> (WW <sub>f</sub> )	Dry Weight (g) <u>1091.37</u>	Major Principal <u>1.33</u> σ <sub>1'</sub> (tsf)
Corrected Diameter <u>3.226</u> (in.)	Tare Weight (g) <u>0.00</u>	Minor Principal <u>0.34</u> σ <sub>3'</sub> (tsf)
Youngs Modulus for Membrane (psi) <u>200</u>		Rate of Strain (% / min.) <u>0.083</u>
Membrane Thickness (in.) <u>0.012</u>		Axial Strain at Failure (%) <u>4.10</u>

Failure Criterion: Maximum Effective Principal Stress Ratio

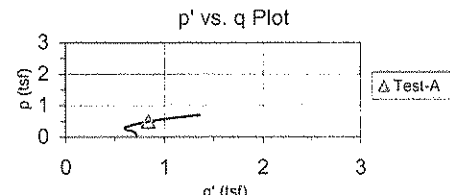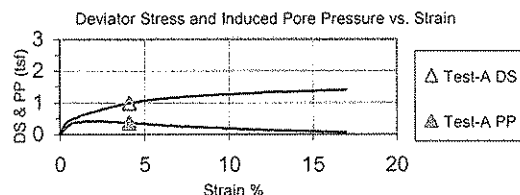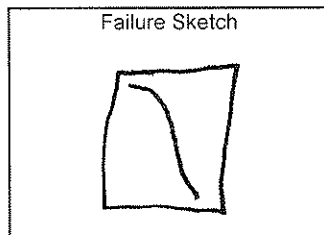

Comments:



Project Name	<u>PAF - Peabody Ash Pond</u>	Project Number	<u>175569069</u>
Sample Identification	<u>STN-6 (N1), 11.2'-11.7'</u>	Test Number	<u>CU-2B</u>
Visual Description	<u>Sandy Lean Clay (CL), brown, wet, very soft</u>	Prepared By	<u>KDG</u>
Undisturbed Source	<u>STN-6 (N1), 11.2'-11.8'</u>	Date	<u>12-16-2009</u>
Specific Gravity	<u>2.70</u> ASTM D854 Method A	Liquid Limit	<u>N/A</u>
		Plastic Limit	<u>N/A</u>
		Plasticity Index	<u>N/A</u>

**Initial Specimen Data**

Specimen Diameter (in.)	Specimen Height (in.)	Volumes (in3)	Specimen
Top <u>2.849</u>	1 <u>5.967</u>	Sample <u>37.7942</u> ( $V_o$ )	Wet Weight (g) <u>1301.97</u>
Middle <u>2.829</u>	2 <u>5.964</u>	Solids <u>24.9015</u> ( $V_{S_o}$ )	Dry Weight (g) <u>1101.84</u>
Bottom <u>2.836</u>	3 <u>5.966</u>	Water <u>12.2121</u> ( $V_{w_o}$ )	Wet Unit Weight (pcf) <u>131.2</u>
Avg. <u>2.8380</u> ( $D_o$ )	4 <u>6.002</u>	Voids <u>12.8927</u> ( $V_{v_o}$ )	Dry Unit Weight (pcf) <u>111.1</u>
Area (in <sup>2</sup> ) <u>6.3258</u> ( $A_o$ )	Avg. ( $H_o$ ) <u>5.9746</u>	Degree of Saturation (%) <u>94.7</u> ( $S_o$ )	
Moisture Content (%) <u>18.2</u>	Final Trimmings	Void Ratio <u>0.518</u>	

**Saturation**

Set Up & Saturated:	Wet <u>xx</u>	Dry _____	Set up By <u>KDG</u>
Back Pressure Saturated to:	<u>60</u> (psi)	Final Pore Pressure Parameter B <u>0.96</u>	Date <u>12-17-09</u>
			Panel Board Number <u>B</u>




Height Readings (in.)	Back Pressure Burette	Chamber Burette	
Initial <u>0.1297</u>	Initial <u>16.72</u> (in.)	Initial <u>12.24</u> (in.)	Specimen Height (in.) <u>5.9631</u> ( $H_g$ )
Final <u>0.1412</u>	Final <u>15.42</u> (in.)	Final <u>9.61</u> (in.)	Area (in <sup>2</sup> ) Method A <u>6.3014</u> ( $A_g$ )
Change <u>-0.0115</u> ( $\Delta H_o$ )	Change <u>-1.30</u> (in.)	Change <u>-2.63</u> (in.)	Specimen Volume (in <sup>3</sup> ) <u>37.58</u> ( $V_g$ )

**Consolidation**

Height Readings (in.)	Back Pressure Burette Readings	Chamber Burette Readings	Pressures (psi)
Initial <u>0.1412</u>	Initial <u>1.71</u> (in.)	Initial <u>17.61</u> (in.)	Chamber <u>90</u>
Final <u>0.1862</u>	Final <u>9.11</u> (in.)	Final <u>10.22</u> (in.)	Back <u>60</u>
Change <u>-0.0450</u> ( $\Delta H_c$ )	Change <u>-7.40</u> (in.)	Change <u>-7.39</u> (in.)	Lateral <u>30</u> ( $\sigma_3$ )
Height (in.) <u>5.9181</u> ( $H_c$ )		Volume (in <sup>3</sup> ) <u>34.7387</u> ( $V_c$ )	
Area (in <sup>3</sup> ) Method B <u>5.8699</u> ( $A_c$ )		Volume - Water (in <sup>3</sup> ) <u>9.8372</u> ( $V_{Wc}$ )	$D_{50}$ (min.) <u>4.481</u>
Diameter (in.) <u>2.7338</u> ( $D_c$ )		Water Content (%) <u>14.6</u>	
Dry Density (pcf) <u>120.8</u>		Degree of Saturation (%) <u>100.0</u> ( $S_c$ )	Void Ratio <u>0.395</u>

**After Test**

Final Measurements	Final Moisture Content	Stresses (membrane corrected) at Failure (psi)
Maximum Diameter <u>3.352</u> (in.)	Wet Weight (g) <u>1263.05</u>	Corrected Deviator <u>2.62</u> $\sigma_d$ (tsf)
Wet weight (g) <u>1263.05</u> (WWf)	Dry Weight (g) <u>1101.84</u>	Major Principal <u>3.50</u> $\sigma_{1f}$ (tsf)
Corrected Diameter <u>3.328</u> (in.)	Tare Weight (g) <u>0.00</u>	Minor Principal <u>0.87</u> $\sigma_{3f}$ (tsf)
		Rate of Strain (% / min.) <u>0.042</u>
Youngs Modulus for Membrane (psi) <u>200</u>		Axial Strain at Failure (%) <u>4.49</u>
Membrane Thickness (in.) <u>0.012</u>		Failure Criterion: Maximum Effective Principal Stress Ratio

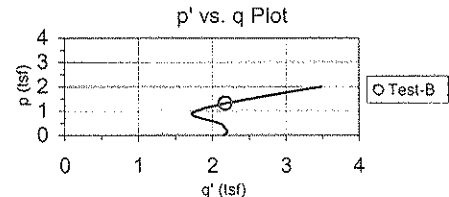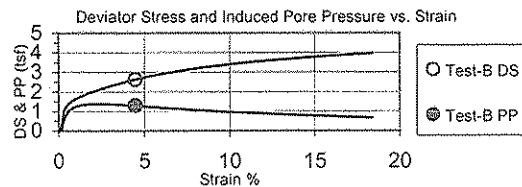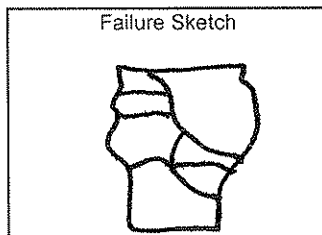

Comments: \_\_\_\_\_

*KDG*

## Consolidated Undrained Triaxial Test EM 1110-2-1906 Appendix X

Consolidation Values			Final Values			Tested By		Project Number	
Height	5.979 (in.)	15.187 (cm)	Height	4.962 (in.)		KDG	175569069		
Diameter	2.873 (in.)	7.297 (cm)	Dia. avg.	3.218 (in.)		Date	12-10-09	Test Number	CU-2A
Area	6.481 (in <sup>2</sup> )	41.814 (cm <sup>2</sup> )	Area avg.	8.134 (in <sup>2</sup> )		Press No.	2	Data File ID	2A
						Panel No.	D	Lateral Pressure (psi)	10.0
								Chamber Pressure - $\sigma_3$ (psi)	90

Clock Time (min.)	Load (lbf)	Deflection Dial Reading (in.)	Pore Pressure Reading (psi)	Corrected Height (in.)	Strain (%)	Corrected Area (cm <sup>2</sup> )	Corrected Load (lbf)	Deviator Stress (tsf)	Corrected Deviator Stress* (tsf)	$\sigma_1$ (tsf)	$\sigma_1'$ (tsf)	$\sigma_3'$ (tsf)	$p'$ ( $(\sigma_1' + \sigma_3')/2$ ) (tsf)	$q$ ( $(\sigma_1 - \sigma_3)/2$ ) (tsf)	Effective Principal Stress Ratio $\sigma_1' / \sigma_3'$
0:00:00	13.8	0.003	80.1	5.979	0.00	41.8141	0.0	0.000	0.000	0.720	0.720	0.714	0.717	0.003	1.008
0:00:41	22.0	0.009	80.7	5.973	0.10	41.8576	8.2	0.091	0.091	0.811	0.767	0.671	0.719	0.048	1.144
0:01:38	33.7	0.015	81.7	5.967	0.20	41.8992	19.9	0.221	0.221	0.941	0.825	0.598	0.712	0.113	1.378
0:02:53	41.9	0.021	82.6	5.961	0.30	41.9415	28.2	0.312	0.311	1.031	0.850	0.533	0.691	0.159	1.585
0:04:07	48.0	0.027	83.3	5.955	0.40	41.9825	34.2	0.379	0.378	1.098	0.866	0.483	0.674	0.192	1.794
0:05:20	51.8	0.033	84.0	5.949	0.50	42.0252	38.0	0.420	0.419	1.139	0.853	0.429	0.641	0.212	1.991
0:06:33	54.6	0.039	84.5	5.943	0.60	42.0668	40.8	0.451	0.450	1.170	0.848	0.393	0.620	0.228	2.159
0:07:46	57.1	0.045	84.9	5.937	0.70	42.1096	43.3	0.479	0.477	1.197	0.849	0.367	0.608	0.241	2.317
0:08:59	59.7	0.051	85.1	5.931	0.80	42.1523	45.9	0.506	0.504	1.224	0.861	0.352	0.606	0.255	2.450
0:10:10	61.8	0.057	85.3	5.925	0.90	42.1947	48.0	0.529	0.527	1.247	0.871	0.339	0.605	0.266	2.573
0:11:23	61.5	0.063	85.3	5.919	1.00	42.2369	47.7	0.525	0.523	1.243	0.864	0.335	0.599	0.264	2.575
0:12:36	65.3	0.069	85.5	5.913	1.10	42.2800	51.5	0.567	0.564	1.284	0.891	0.321	0.606	0.285	2.775
0:13:47	66.9	0.075	85.6	5.907	1.20	42.3222	53.2	0.584	0.581	1.301	0.904	0.317	0.611	0.293	2.850
0:15:03	68.8	0.081	85.6	5.901	1.31	42.3677	55.0	0.604	0.601	1.321	0.926	0.320	0.623	0.303	2.894
0:16:14	70.7	0.087	85.9	5.895	1.41	42.4100	56.9	0.624	0.621	1.341	0.923	0.297	0.610	0.313	3.106
0:17:24	72.0	0.093	85.9	5.889	1.51	42.4533	58.2	0.638	0.634	1.354	0.932	0.292	0.612	0.320	3.187
0:18:33	73.8	0.099	86.0	5.883	1.60	42.4947	60.0	0.656	0.653	1.373	0.949	0.291	0.620	0.329	3.260
0:19:48	75.0	0.105	85.9	5.877	1.70	42.5386	61.2	0.670	0.665	1.385	0.963	0.292	0.628	0.336	3.297
0:20:59	76.7	0.111	85.9	5.871	1.81	42.5828	62.9	0.687	0.683	1.403	0.981	0.293	0.637	0.344	3.347
0:22:10	77.6	0.117	85.9	5.865	1.90	42.6245	63.8	0.696	0.691	1.411	0.991	0.294	0.642	0.348	3.371
0:23:23	79.3	0.123	85.9	5.859	2.00	42.6687	65.5	0.714	0.709	1.429	1.012	0.297	0.654	0.357	3.410
0:24:34	81.0	0.129	85.8	5.853	2.10	42.7128	67.2	0.732	0.726	1.446	1.036	0.304	0.670	0.366	3.405
0:25:44	82.5	0.135	85.9	5.847	2.20	42.7549	68.7	0.747	0.742	1.462	1.041	0.293	0.667	0.374	3.546
0:26:58	84.2	0.141	86.0	5.841	2.30	42.7994	70.4	0.765	0.759	1.479	1.055	0.290	0.672	0.382	3.639
0:28:11	83.8	0.147	85.9	5.835	2.40	42.8441	70.1	0.760	0.755	1.475	1.056	0.296	0.676	0.380	3.570
0:29:24	87.5	0.153	85.9	5.829	2.50	42.8876	73.7	0.799	0.793	1.513	1.094	0.295	0.695	0.399	3.704
0:30:35	88.5	0.159	85.8	5.823	2.60	42.9310	74.8	0.810	0.804	1.524	1.109	0.299	0.704	0.405	3.702
0:31:45	89.5	0.165	85.8	5.817	2.70	42.9746	75.7	0.819	0.813	1.533	1.121	0.303	0.712	0.409	3.703
0:32:59	91.2	0.171	85.7	5.811	2.80	43.0198	77.4	0.836	0.830	1.550	1.142	0.307	0.725	0.418	3.721
0:34:09	92.1	0.177	85.6	5.805	2.90	43.0642	78.3	0.846	0.839	1.559	1.158	0.314	0.736	0.422	3.689
0:35:23	93.9	0.183	85.4	5.799	3.00	43.1088	80.1	0.864	0.857	1.577	1.191	0.329	0.760	0.431	3.623
0:36:33	94.8	0.189	85.7	5.794	3.10	43.1522	81.1	0.874	0.866	1.586	1.182	0.310	0.746	0.436	3.811
0:37:47	96.7	0.195	85.7	5.787	3.20	43.1985	82.9	0.892	0.885	1.605	1.201	0.311	0.756	0.445	3.863
0:38:55	97.8	0.201	85.6	5.782	3.30	43.2415	84.0	0.903	0.895	1.615	1.216	0.315	0.766	0.451	3.859
0:40:08	98.8	0.207	85.5	5.776	3.40	43.2861	85.0	0.913	0.905	1.625	1.232	0.321	0.777	0.455	3.834
0:41:19	99.8	0.213	85.5	5.770	3.50	43.3317	86.0	0.923	0.914	1.634	1.247	0.327	0.787	0.460	3.810
0:42:32	101.2	0.219	85.4	5.763	3.60	43.3772	87.4	0.937	0.929	1.649	1.266	0.332	0.799	0.467	3.815
0:43:45	102.0	0.225	85.3	5.757	3.70	43.4228	88.3	0.945	0.936	1.656	1.280	0.338	0.809	0.471	3.789
0:44:56	103.5	0.231	85.2	5.752	3.80	43.4674	89.7	0.959	0.950	1.670	1.304	0.348	0.826	0.478	3.748
0:46:07	104.2	0.237	85.2	5.746	3.90	43.5126	90.4	0.967	0.957	1.677	1.306	0.344	0.825	0.481	3.803
0:47:17	105.9	0.242	85.3	5.740	4.00	43.5569	92.1	0.983	0.974	1.694	1.320	0.341	0.831	0.490	3.872
0:48:28	107.1	0.248	85.2	5.734	4.10	43.6022	93.3	0.995	0.985	1.705	1.334	0.343	0.838	0.495	3.889
0:49:41	108.2	0.255	85.2	5.728	4.20	43.6493	94.4	1.006	0.996	1.716	1.350	0.349	0.849	0.501	3.870
0:50:54	108.8	0.261	85.1	5.722	4.31	43.6955	95.0	1.011	1.000	1.720	1.362	0.356	0.859	0.503	3.824
0:52:05	109.6	0.266	85.0	5.716	4.40	43.7401	95.8	1.019	1.008	1.728	1.375	0.361	0.868	0.507	3.806
0:53:16	110.5	0.272	84.9	5.710	4.50	43.7861	96.7	1.027	1.017	1.737	1.388	0.366	0.877	0.511	3.794
0:54:26	111.6	0.278	84.8	5.704	4.60	43.8310	97.8	1.037	1.026	1.746	1.405	0.373	0.889	0.516	3.767
0:55:37	112.5	0.284	84.6	5.698	4.70	43.8777	98.8	1.047	1.035	1.755	1.430	0.389	0.909	0.520	3.679
0:56:50	114.0	0.291	84.8	5.692	4.81	43.9249	100.2	1.061	1.049	1.769	1.428	0.374	0.901	0.527	3.823
0:57:58	114.8	0.296	84.8	5.686	4.90	43.9699	101.0	1.068	1.057	1.777	1.437	0.374	0.906	0.531	3.837
0:59:09	115.6	0.302	84.8	5.680	5.00	44.0155	101.9	1.076	1.064	1.784	1.447	0.377	0.912	0.535	3.836
1:00:20	116.3	0.308	84.6	5.674	5.10	44.0626	102.5	1.082	1.069	1.789	1.460	0.385	0.923	0.537	3.789
1:01:30	117.0	0.314	84.6	5.668	5.20	44.1088	103.2	1.088	1.076	1.796	1.473	0.391	0.932	0.541	3.764
1:02:41	118.1	0.320	84.5	5.662	5.30	44.1553	104.4	1.099	1.086	1.806	1.488	0.396	0.942	0.546	3.759
1:03:52	118.8	0.326	84.4	5.656	5.40	44.2020	105.0	1.105	1.092	1.812	1.499	0.402	0.950	0.549	3.732
1:05:02	119.3	0.332	84.3	5.650	5.50	44.2494	105.5	1.109	1.096	1.816	1.511	0.409	0.960	0.551	3.692
1:06:13	120.2	0.338	84.3	5.644	5.60	44.2959	106.4	1.117	1.104	1.824	1.520	0.411	0.966	0.555	3.698
1:07:24	121.1	0.344	84.4	5.638	5.70	44.3425	107.3	1.126	1.112	1.832	1.523	0.406	0.964	0.559	3.756
1:08:34	121.7	0.350	84.3	5.632	5.80	44.3895	107.9	1.130	1.116	1.836	1.529	0.407	0.968	0.561	3.753
1:09:45	122.5	0.356	84.3	5.626	5.90	44.4366	108.7	1.137	1.123	1.843	1.542	0.414	0.978	0.564	3.727

## Consolidated Undrained Triaxial Test EM 1110-2-1906 Appendix X

Consolidation Values			Final Values			Tested By		Project Number	
Height	5.979 (in.)	15.187 (cm)	Height	4.962 (in.)		KDG		175569069	
Diameter	2.873 (in.)	7.297 (cm)	Dia. avg.	3.218 (in.)		Date	12-10-09	Test Number	CU-2A
Area	6.481 (in <sup>2</sup> )	41.814 (cm <sup>2</sup> )	Area avg.	8.134 (in <sup>2</sup> )		Press No.	2	Data File ID	2A
						Panel No.	D	Lateral Pressure (psi)	10.0
						Chamber Pressure - $\sigma_3$ (psi)			
						90			

Clock Time (min.)	Load (lbf)	Deflection Dial Reading (in.)	Pore Pressure Reading (psi)	Corrected Height (in.)	Strain (%)	Corrected Area (cm <sup>2</sup> )	Corrected Load (lbf)	Deviator Stress (tsf)	Corrected Deviator Stress* (tsf)	$\sigma_1$ (tsf)	$\sigma_1'$ (tsf)	$\sigma_3'$ (tsf)	$p'$ ( $(\sigma_1' + \sigma_3')/2$ ) (tsf)	$q$ ( $(\sigma_1 - \sigma_3)/2$ ) (tsf)	Effective Principal Stress Ratio $\sigma_1' / \sigma_3'$
1:10:56	123.3	0.362	84.2	5.620	6.00	44.4836	109.5	1.145	1.131	1.851	1.555	0.419	0.987	0.568	3.711
1:12:09	123.5	0.368	84.1	5.614	6.10	44.5326	109.7	1.146	1.131	1.851	1.561	0.425	0.993	0.568	3.676
1:13:17	124.1	0.374	84.0	5.608	6.20	44.5791	110.3	1.151	1.136	1.856	1.570	0.429	1.000	0.571	3.661
1:14:31	124.8	0.380	84.0	5.602	6.30	44.6275	111.0	1.156	1.141	1.861	1.581	0.434	1.008	0.573	3.640
1:15:41	125.3	0.386	83.8	5.596	6.40	44.6749	111.5	1.161	1.145	1.865	1.599	0.449	1.024	0.575	3.566
1:16:52	126.0	0.392	83.9	5.590	6.50	44.7221	112.3	1.167	1.152	1.872	1.595	0.438	1.017	0.579	3.642
1:18:03	126.7	0.398	83.9	5.584	6.60	44.7698	112.9	1.173	1.157	1.877	1.599	0.436	1.018	0.581	3.665
1:19:16	126.9	0.404	83.9	5.578	6.70	44.8189	113.2	1.174	1.158	1.878	1.602	0.439	1.021	0.582	3.652
1:20:26	126.8	0.410	83.8	5.572	6.80	44.8663	113.0	1.172	1.155	1.875	1.605	0.444	1.025	0.580	3.611
1:21:37	127.5	0.416	83.8	5.566	6.90	44.9139	113.7	1.177	1.161	1.881	1.616	0.450	1.033	0.583	3.592
1:22:50	127.9	0.422	83.7	5.560	7.00	44.9629	114.1	1.180	1.163	1.883	1.623	0.454	1.038	0.584	3.575
1:24:01	128.6	0.428	83.6	5.554	7.10	45.0105	114.8	1.186	1.169	1.889	1.632	0.458	1.045	0.587	3.564
1:25:14	130.0	0.434	83.6	5.548	7.20	45.0591	116.2	1.199	1.182	1.902	1.651	0.464	1.058	0.594	3.561
1:26:25	130.5	0.440	83.3	5.542	7.30	45.1076	116.7	1.203	1.185	1.905	1.670	0.479	1.075	0.596	3.486
1:27:38	130.9	0.446	83.6	5.536	7.40	45.1570	117.1	1.206	1.188	1.908	1.656	0.462	1.059	0.597	3.582
1:28:51	131.8	0.452	83.6	5.530	7.50	45.2057	118.0	1.214	1.196	1.916	1.665	0.463	1.064	0.601	3.595
1:30:04	132.0	0.458	83.6	5.524	7.60	45.2555	118.2	1.214	1.196	1.916	1.666	0.464	1.065	0.601	3.589
1:31:15	132.6	0.464	83.5	5.518	7.70	45.3035	118.9	1.220	1.202	1.922	1.677	0.470	1.074	0.604	3.569
1:32:28	133.2	0.470	83.4	5.512	7.80	45.3534	119.4	1.224	1.205	1.925	1.686	0.475	1.080	0.605	3.551
1:33:41	133.7	0.476	83.3	5.506	7.90	45.4030	119.9	1.228	1.209	1.929	1.694	0.479	1.087	0.607	3.535
1:34:51	134.1	0.482	83.3	5.501	8.00	45.4512	120.3	1.231	1.212	1.932	1.700	0.483	1.092	0.609	3.520
1:36:04	134.8	0.488	83.2	5.494	8.10	45.5013	121.0	1.237	1.218	1.938	1.716	0.493	1.104	0.612	3.484
1:37:15	135.3	0.494	83.2	5.489	8.20	45.5504	121.5	1.240	1.221	1.941	1.713	0.487	1.100	0.613	3.519
1:38:28	135.5	0.500	83.3	5.482	8.30	45.6010	121.7	1.241	1.221	1.941	1.710	0.483	1.096	0.613	3.539
1:39:39	136.2	0.506	83.3	5.477	8.40	45.6503	122.4	1.247	1.226	1.946	1.716	0.484	1.100	0.616	3.545
1:40:50	136.9	0.512	83.2	5.471	8.50	45.6993	123.1	1.253	1.233	1.953	1.728	0.490	1.109	0.619	3.528
1:42:03	137.2	0.518	83.2	5.465	8.60	45.7500	123.4	1.255	1.234	1.954	1.732	0.493	1.113	0.620	3.515
1:43:16	137.9	0.524	83.1	5.458	8.71	45.8013	124.1	1.260	1.239	1.959	1.742	0.498	1.120	0.622	3.501
1:44:26	138.4	0.530	83.0	5.453	8.80	45.8511	124.6	1.264	1.243	1.963	1.749	0.501	1.125	0.624	3.491
1:45:37	138.0	0.535	83.0	5.447	8.90	45.9000	124.2	1.258	1.237	1.957	1.748	0.506	1.127	0.621	3.457
1:46:50	138.6	0.541	82.8	5.441	9.00	45.9509	124.8	1.263	1.241	1.961	1.767	0.520	1.144	0.624	3.398
1:48:03	138.7	0.548	83.0	5.435	9.10	46.0020	125.0	1.263	1.241	1.961	1.751	0.505	1.128	0.623	3.471
1:49:16	139.5	0.554	83.0	5.429	9.20	46.0531	125.7	1.270	1.247	1.967	1.757	0.504	1.130	0.627	3.487
1:50:27	140.0	0.559	83.0	5.423	9.30	46.1026	126.2	1.273	1.250	1.970	1.760	0.505	1.133	0.628	3.489
1:51:40	140.7	0.565	82.9	5.417	9.40	46.1542	126.9	1.279	1.256	1.976	1.774	0.512	1.143	0.631	3.462
1:52:51	142.8	0.571	82.8	5.411	9.50	46.2046	129.1	1.299	1.276	1.996	1.798	0.516	1.157	0.641	3.483
1:54:01	141.2	0.577	82.8	5.405	9.60	46.2555	127.4	1.281	1.258	1.978	1.783	0.519	1.151	0.632	3.432
1:55:17	141.5	0.583	82.7	5.399	9.70	46.3082	127.7	1.282	1.259	1.979	1.788	0.523	1.155	0.632	3.417
1:56:28	142.3	0.589	82.6	5.393	9.80	46.3585	128.5	1.289	1.265	1.985	1.802	0.531	1.166	0.635	3.394
1:57:41	142.5	0.595	82.6	5.387	9.90	46.4101	128.7	1.289	1.266	1.986	1.806	0.535	1.170	0.636	3.378
1:58:54	142.5	0.601	82.7	5.381	10.00	46.4615	128.8	1.289	1.265	1.985	1.795	0.525	1.160	0.635	3.420
2:00:07	143.3	0.607	82.7	5.375	10.10	46.5133	129.5	1.295	1.270	1.990	1.800	0.524	1.162	0.638	3.434
2:01:20	143.5	0.613	82.6	5.369	10.20	46.5651	129.7	1.296	1.271	1.991	1.807	0.530	1.169	0.638	3.408
2:02:33	143.7	0.619	82.6	5.363	10.30	46.6171	129.9	1.296	1.271	1.991	1.811	0.534	1.172	0.639	3.392
2:03:46	144.6	0.625	82.5	5.357	10.40	46.6686	130.8	1.303	1.278	1.998	1.821	0.537	1.179	0.642	3.389
2:05:00	145.2	0.631	82.5	5.351	10.50	46.7208	131.4	1.308	1.283	2.003	1.829	0.540	1.185	0.644	3.385
2:06:15	145.1	0.637	82.4	5.345	10.60	46.7745	131.4	1.306	1.280	2.000	1.833	0.547	1.190	0.643	3.353
2:07:26	145.7	0.643	82.2	5.339	10.70	46.8257	131.9	1.310	1.284	2.004	1.851	0.561	1.206	0.645	3.298
2:08:41	145.5	0.649	82.4	5.333	10.81	46.8795	131.7	1.306	1.280	2.000	1.831	0.545	1.188	0.643	3.358
2:09:55	146.4	0.655	82.5	5.327	10.90	46.9309	132.6	1.314	1.288	2.008	1.835	0.542	1.189	0.647	3.385
2:11:08	146.9	0.661	82.4	5.321	11.00	46.9832	133.1	1.317	1.291	2.011	1.840	0.544	1.192	0.648	3.383
2:12:23	147.6	0.667	82.4	5.315	11.11	47.0378	133.8	1.323	1.296	2.016	1.852	0.551	1.201	0.651	3.364
2:13:36	147.6	0.673	82.3	5.309	11.20	47.0899	133.8	1.322	1.295	2.015	1.855	0.554	1.205	0.650	3.345
2:14:52	147.9	0.679	82.3	5.303	11.30	47.1436	134.1	1.323	1.296	2.016	1.858	0.557	1.207	0.651	3.338
2:16:05	148.2	0.685	82.2	5.297	11.40	47.1962	134.5	1.325	1.297	2.017	1.865	0.562	1.214	0.651	3.317
2:17:18	148.6	0.691	82.1	5.291	11.50	47.2499	134.8	1.327	1.299	2.019	1.877	0.572	1.224	0.652	3.281
2:18:31	149.4	0.697	82.2	5.285	11.60	47.3021	135.6	1.333	1.305	2.025	1.871	0.560	1.216	0.655	3.339
2:19:47	149.8	0.703	82.2	5.279	11.70	47.3566	136.0	1.336	1.307	2.027	1.871	0.558	1.215	0.657	3.352
2:21:00	150.2	0.709	82.2	5.273	11.80	47.4098	136.4	1.338	1.310	2.030	1.874	0.559	1.217	0.658	3.353
2:22:16	150.7	0.715	82.1	5.267	11.90	47.4644	136.9	1.341	1.312	2.032	1.883	0.565	1.224	0.659	3.331

**Consolidated Undrained Triaxial Test  
EM 1110-2-1906 Appendix X**

Consolidation Values			Final Values			Tested By <u>KDG</u>		Project Number <u>175569069</u>	
Height	<u>5.979 (in.)</u>	<u>15.187 (cm)</u>	Height	<u>4.962 (in.)</u>		Date	<u>12-10-09</u>	Test Number	<u>CU-2A</u>
Diameter	<u>2.873 (in)</u>	<u>7.297 (cm)</u>	Dia. avg.	<u>3.218 (in)</u>		Press No.	<u>2</u>	Data File ID	<u>2A</u>
Area	<u>6.481 (in<sup>2</sup>)</u>	<u>41.814 (cm<sup>2</sup>)</u>	Area avg.	<u>8.134 (in<sup>2</sup>)</u>		Panel No.	<u>D</u>	Lateral Pressure (psi)	<u>10.0</u>
								Chamber Pressure - $\sigma_3$ (psi)	<u>90</u>

Clock Time (min.)	Load (lbf)	Deflection Dial Reading (in.)	Pore Pressure Reading (psi)	Corrected Height (in.)	Strain (%)	Corrected Area		Corrected Load (lbf)	Deviator Stress (tsf)	Corrected Deviator Stress* (tsf)	$\sigma_1$ (tsf)	$\sigma_1'$ (tsf)	$\sigma_3'$ (tsf)	$p' = (\sigma_1' + \sigma_3')/2$ (tsf)	$q = (\sigma_1 - \sigma_3)/2$ (tsf)	Effective Principal Stress Ratio $\sigma_1' / \sigma_3'$
						Corrected Area (cm <sup>2</sup> )	Corrected Area (in <sup>2</sup> )									
2:23:31	151.5	0.721	82.1	5.261	12.01	47.5192	137.7	1.347	1.319	2.039	1.893	0.569	1.231	0.662	3.328	
2:24:45	153.0	0.727	82.1	5.255	12.10	47.5726	139.2	1.361	1.332	2.052	1.909	0.572	1.241	0.669	3.339	
2:25:58	153.8	0.733	82.0	5.249	12.21	47.6272	140.0	1.367	1.338	2.058	1.919	0.576	1.248	0.672	3.331	
2:27:08	154.0	0.739	81.9	5.243	12.30	47.6799	140.2	1.367	1.337	2.057	1.926	0.583	1.255	0.672	3.302	
2:28:22	154.4	0.745	82.0	5.237	12.40	47.7351	140.7	1.370	1.340	2.060	1.925	0.579	1.252	0.673	3.324	
2:29:32	154.3	0.751	82.0	5.231	12.50	47.7889	140.5	1.367	1.337	2.057	1.917	0.574	1.245	0.671	3.339	
2:30:45	155.0	0.757	82.0	5.225	12.60	47.8436	141.2	1.372	1.342	2.062	1.922	0.574	1.248	0.674	3.346	
2:31:58	155.6	0.763	81.9	5.219	12.70	47.8994	141.8	1.377	1.346	2.066	1.931	0.580	1.256	0.676	3.332	
2:33:12	156.5	0.769	81.9	5.213	12.81	47.9550	142.7	1.384	1.353	2.073	1.941	0.583	1.262	0.679	3.331	
2:34:22	156.2	0.775	81.9	5.207	12.91	48.0100	142.4	1.379	1.348	2.068	1.939	0.585	1.262	0.677	3.312	
2:35:33	156.5	0.781	81.8	5.201	13.00	48.0640	142.7	1.380	1.349	2.069	1.944	0.590	1.267	0.677	3.297	
2:36:44	156.8	0.787	81.8	5.196	13.10	48.1194	143.0	1.382	1.350	2.070	1.950	0.594	1.272	0.678	3.284	
2:37:54	156.2	0.793	81.5	5.190	13.20	48.1747	142.4	1.375	1.343	2.063	1.958	0.609	1.284	0.674	3.213	
2:39:05	156.1	0.799	81.8	5.184	13.30	48.2300	142.3	1.372	1.340	2.060	1.935	0.590	1.262	0.673	3.281	
2:40:18	156.4	0.805	81.8	5.177	13.40	48.2869	142.6	1.373	1.341	2.061	1.936	0.589	1.262	0.673	3.286	
2:41:27	157.2	0.811	81.8	5.172	13.50	48.3415	143.4	1.380	1.347	2.067	1.943	0.590	1.267	0.676	3.292	
2:42:40	157.5	0.817	81.7	5.166	13.60	48.3987	143.8	1.381	1.348	2.068	1.950	0.596	1.273	0.677	3.272	
2:43:50	158.1	0.823	81.7	5.160	13.70	48.4542	144.3	1.385	1.352	2.072	1.957	0.599	1.278	0.679	3.265	
2:45:04	158.3	0.829	81.6	5.154	13.81	48.5112	144.5	1.385	1.352	2.072	1.961	0.603	1.282	0.679	3.253	
2:46:14	158.7	0.834	81.6	5.148	13.90	48.5664	144.9	1.388	1.354	2.074	1.966	0.606	1.286	0.680	3.243	
2:47:27	159.1	0.841	81.5	5.142	14.00	48.6237	145.3	1.390	1.356	2.076	1.974	0.612	1.293	0.681	3.224	
2:48:38	159.8	0.846	81.5	5.136	14.10	48.6796	146.0	1.394	1.361	2.081	1.979	0.613	1.296	0.683	3.230	
2:49:51	159.7	0.853	81.6	5.130	14.21	48.7376	145.9	1.392	1.358	2.078	1.987	0.603	1.285	0.682	3.260	
2:51:04	160.3	0.859	81.6	5.124	14.31	48.7945	146.5	1.396	1.362	2.082	1.972	0.604	1.288	0.684	3.264	
2:52:18	160.3	0.865	81.5	5.118	14.41	48.8516	146.5	1.394	1.360	2.080	1.974	0.609	1.291	0.683	3.243	
2:53:28	160.8	0.870	81.5	5.112	14.50	48.9069	147.1	1.398	1.363	2.083	1.981	0.612	1.296	0.684	3.238	
2:54:41	161.5	0.876	81.5	5.106	14.60	48.9643	147.7	1.403	1.368	2.088	1.988	0.615	1.302	0.687	3.232	
2:55:55	162.0	0.882	81.4	5.100	14.70	49.0216	148.2	1.406	1.371	2.091	1.994	0.617	1.306	0.688	3.229	
2:57:08	162.3	0.888	81.4	5.094	14.80	49.0799	148.5	1.407	1.371	2.091	1.999	0.622	1.310	0.689	3.215	
2:58:21	162.5	0.894	81.1	5.088	14.90	49.1374	148.8	1.408	1.372	2.092	2.016	0.638	1.327	0.689	3.159	
2:59:34	162.8	0.900	81.4	5.082	15.00	49.1952	149.1	1.409	1.373	2.093	1.997	0.619	1.308	0.689	3.228	
3:00:47	163.2	0.906	81.4	5.076	15.10	49.2526	149.4	1.410	1.374	2.094	1.997	0.617	1.307	0.690	3.235	
3:02:03	163.5	0.912	81.4	5.070	15.21	49.3126	149.7	1.412	1.375	2.095	2.000	0.619	1.309	0.690	3.232	
3:03:16	164.4	0.918	81.3	5.064	15.31	49.3708	150.6	1.419	1.382	2.102	2.012	0.624	1.318	0.694	3.223	
3:04:29	164.6	0.924	81.3	5.058	15.40	49.4284	150.8	1.419	1.382	2.102	2.015	0.627	1.321	0.694	3.211	
3:05:42	165.2	0.930	81.3	5.052	15.50	49.4864	151.4	1.423	1.386	2.106	2.021	0.630	1.326	0.696	3.209	
3:06:55	165.1	0.936	81.2	5.046	15.60	49.5456	151.3	1.420	1.383	2.103	2.021	0.633	1.327	0.694	3.194	
3:08:08	165.2	0.942	81.0	5.040	15.70	49.6044	151.4	1.420	1.382	2.102	2.032	0.645	1.339	0.694	3.152	
3:09:21	166.5	0.948	81.2	5.034	15.80	49.6633	152.7	1.430	1.392	2.112	2.030	0.632	1.331	0.699	3.211	
3:10:35	166.7	0.954	81.2	5.028	15.91	49.7227	152.9	1.430	1.392	2.112	2.028	0.630	1.329	0.699	3.217	
3:11:48	167.8	0.960	81.2	5.022	16.00	49.7815	154.0	1.438	1.400	2.120	2.036	0.630	1.333	0.703	3.230	
3:13:01	167.6	0.966	81.2	5.016	16.11	49.8420	153.8	1.435	1.397	2.117	2.037	0.635	1.336	0.701	3.208	
3:14:14	167.8	0.972	81.1	5.010	16.21	49.9013	154.0	1.435	1.396	2.116	2.041	0.639	1.340	0.701	3.192	
3:15:25	167.6	0.978	81.1	5.004	16.30	49.9597	153.9	1.432	1.393	2.113	2.040	0.642	1.341	0.699	3.179	
3:16:38	168.4	0.984	81.0	4.998	16.41	50.0202	154.7	1.438	1.398	2.118	2.051	0.647	1.349	0.702	3.169	
3:17:49	168.7	0.990	81.0	4.992	16.50	50.0787	154.9	1.438	1.398	2.118	2.055	0.651	1.353	0.702	3.158	
3:19:02	169.2	0.996	80.8	4.986	16.60	50.1396	155.4	1.441	1.401	2.121	2.069	0.662	1.365	0.704	3.127	
3:20:15	169.1	1.002	81.1	4.980	16.71	50.2010	155.3	1.439	1.399	2.119	2.048	0.644	1.346	0.702	3.180	
3:21:26	169.8	1.008	81.1	4.974	16.80	50.2599	156.0	1.443	1.403	2.123	2.051	0.643	1.347	0.704	3.192	
3:22:39	170.5	1.014	81.0	4.968	16.91	50.3211	156.8	1.449	1.408	2.128	2.060	0.646	1.353	0.707	3.187	
3:23:52	170.7	1.020	81.0	4.962	17.01	50.3822	157.0	1.449	1.408	2.128	2.063	0.650	1.357	0.707	3.175	



**Consolidated Undrained Triaxial Test  
EM 1110-2-1906 Appendix X**

Consolidation Values			Final Values			Tested By <u>KDG</u>		Project Number <u>175569069</u>	
Height	<u>5.918 (in.)</u>	<u>15.032 (cm)</u>	Height	<u>4.827 (in.)</u>		Date	<u>12-19-09</u>	Test Number	<u>CU-2B</u>
Diameter	<u>2.734 (in)</u>	<u>6.944 (cm)</u>	Dia. avg.	<u>3.173 (in)</u>		Press No.	<u>1</u>	Data File ID	<u>2B</u>
Area	<u>5.870 (in<sup>2</sup>)</u>	<u>37.872 (cm<sup>2</sup>)</u>	Area avg.	<u>7.909 (in<sup>2</sup>)</u>		Panel No.	<u>B</u>	Lateral Pressure (psi)	<u>30.0</u>
								Chamber Pressure - $\sigma_3$ (psi)	<u>90</u>

Clock Time (min.)	Load (lbf)	Deflection Dial Reading (in.)	Pore Pressure Reading (psi)	Corrected Height (in.)	Strain (%)	Corrected Area (cm <sup>2</sup> )	Corrected Load (lbf)	Corrected Deviator Stress (tsf)	Corrected Deviator Stress* (tsf)	$\sigma_1$ (tsf)	$\sigma_1'$ (tsf)	$\sigma_3'$ (tsf)	$p'$ ( $(\sigma_1' + \sigma_3')/2$ ) (tsf)	q ( $(\sigma_1 - \sigma_3)/2$ ) (tsf)	Effective Principal Stress Ratio $\sigma_1' / \sigma_3'$
0:00:00	12.7	-0.024	60.1	5.918	0.00	37.8725	0.0	0.000	0.000	2.160	2.160	2.150	2.155	0.005	1.005
0:00:49	19.6	-0.018	60.3	5.912	0.10	37.9119	8.8	0.084	0.084	2.244	2.231	2.137	2.184	0.047	1.044
0:02:44	39.6	-0.012	61.7	5.906	0.20	37.9491	26.9	0.330	0.329	2.489	2.380	2.041	2.211	0.170	1.166
0:05:32	85.7	-0.006	66.6	5.900	0.30	37.9869	73.0	0.893	0.892	3.052	2.590	1.687	2.138	0.451	1.535
0:07:54	104.8	0.000	69.7	5.894	0.40	38.0251	92.1	1.126	1.125	3.285	2.596	1.461	2.028	0.567	1.777
0:10:24	117.3	0.005	72.2	5.889	0.50	38.0622	104.6	1.278	1.276	3.436	2.568	1.282	1.925	0.643	2.004
0:12:57	125.7	0.011	73.9	5.883	0.60	38.1004	113.0	1.379	1.377	3.537	2.548	1.161	1.854	0.694	2.195
0:15:18	132.3	0.017	75.0	5.877	0.70	38.1388	119.6	1.458	1.457	3.617	2.544	1.078	1.811	0.733	2.361
0:17:35	137.3	0.023	75.7	5.871	0.80	38.1780	124.6	1.518	1.516	3.676	2.553	1.027	1.790	0.763	2.486
0:19:54	141.9	0.029	76.7	5.865	0.90	38.2159	129.1	1.571	1.569	3.729	2.534	0.955	1.744	0.790	2.654
0:22:15	146.2	0.035	77.3	5.859	1.00	38.2539	133.5	1.622	1.620	3.780	2.547	0.917	1.732	0.815	2.777
0:24:32	149.9	0.041	77.7	5.853	1.10	38.2942	137.2	1.665	1.663	3.823	2.561	0.888	1.724	0.836	2.884
0:26:41	153.7	0.047	77.9	5.847	1.20	38.3311	140.9	1.710	1.707	3.867	2.586	0.869	1.728	0.858	2.975
0:28:57	157.1	0.053	78.3	5.841	1.30	38.3701	144.4	1.750	1.747	3.907	2.597	0.841	1.719	0.878	3.090
0:31:14	160.4	0.059	78.6	5.835	1.40	38.4088	147.7	1.788	1.785	3.945	2.615	0.821	1.718	0.897	3.187
0:33:25	163.3	0.064	78.7	5.830	1.50	38.4475	150.6	1.821	1.817	3.977	2.640	0.813	1.727	0.914	3.249
0:35:46	166.5	0.070	78.8	5.824	1.60	38.4872	153.8	1.858	1.854	4.014	2.669	0.805	1.737	0.932	3.316
0:38:00	169.7	0.076	78.7	5.818	1.70	38.5267	156.9	1.894	1.890	4.050	2.711	0.811	1.761	0.950	3.341
0:40:13	172.5	0.082	79.1	5.812	1.79	38.5646	159.8	1.927	1.922	4.082	2.716	0.784	1.750	0.966	3.463
0:42:28	175.3	0.088	79.1	5.806	1.89	38.6038	162.6	1.958	1.953	4.113	2.746	0.782	1.764	0.982	3.510
0:44:50	178.1	0.094	79.1	5.800	2.00	38.6444	165.3	1.989	1.984	4.144	2.776	0.782	1.779	0.997	3.550
0:47:02	180.6	0.100	79.1	5.794	2.09	38.6824	167.9	2.018	2.013	4.173	2.809	0.786	1.797	1.012	3.576
0:49:14	183.4	0.106	79.2	5.788	2.19	38.7221	170.6	2.049	2.044	4.204	2.832	0.778	1.805	1.027	3.640
0:51:27	186.3	0.112	79.3	5.782	2.29	38.7613	173.6	2.082	2.077	4.237	2.861	0.774	1.817	1.043	3.696
0:53:46	188.3	0.118	79.2	5.776	2.39	38.8017	175.6	2.104	2.098	4.258	2.886	0.778	1.832	1.054	3.708
0:56:03	190.7	0.123	79.1	5.771	2.49	38.8406	178.0	2.131	2.125	4.285	2.918	0.783	1.851	1.067	3.725
0:58:16	193.6	0.129	78.9	5.765	2.59	38.8804	180.8	2.163	2.156	4.316	2.965	0.799	1.882	1.083	3.713
1:00:32	195.7	0.135	79.2	5.759	2.69	38.9202	183.0	2.186	2.179	4.339	2.984	0.774	1.869	1.095	3.828
1:02:58	198.9	0.141	79.2	5.753	2.79	38.9609	186.2	2.222	2.215	4.375	3.006	0.781	1.894	1.113	3.849
1:05:16	201.5	0.147	79.1	5.747	2.89	39.0003	188.8	2.250	2.243	4.403	3.039	0.785	1.912	1.127	3.870
1:07:35	203.9	0.153	78.9	5.741	2.99	39.0401	191.2	2.277	2.269	4.429	3.075	0.796	1.935	1.140	3.864
1:09:53	206.6	0.159	79.0	5.735	3.09	39.0803	193.9	2.307	2.299	4.459	3.101	0.792	1.947	1.155	3.915
1:12:12	208.5	0.165	79.0	5.729	3.19	39.1206	195.7	2.326	2.318	4.478	3.121	0.793	1.957	1.164	3.936
1:14:36	210.7	0.171	78.8	5.723	3.29	39.1610	198.0	2.351	2.343	4.503	3.156	0.803	1.980	1.176	3.930
1:16:57	213.5	0.177	78.7	5.717	3.39	39.2016	200.7	2.381	2.372	4.532	3.193	0.810	2.001	1.191	3.941
1:19:17	215.5	0.182	78.6	5.712	3.49	39.2418	202.7	2.402	2.393	4.553	3.227	0.823	2.025	1.202	3.920
1:21:39	217.3	0.188	78.7	5.706	3.59	39.2823	204.5	2.421	2.412	4.572	3.236	0.813	2.024	1.211	3.978
1:24:02	220.0	0.194	78.6	5.700	3.69	39.3231	207.2	2.451	2.441	4.601	3.274	0.823	2.048	1.226	3.980
1:26:24	222.3	0.200	78.4	5.694	3.79	39.3639	209.5	2.475	2.466	4.626	3.307	0.832	2.069	1.238	3.977
1:28:44	224.3	0.206	78.2	5.688	3.89	39.4049	211.5	2.496	2.486	4.646	3.347	0.850	2.098	1.248	3.936
1:31:03	226.5	0.212	78.4	5.682	3.99	39.4455	213.8	2.520	2.510	4.670	3.358	0.838	2.098	1.260	4.008
1:33:23	229.1	0.218	78.3	5.676	4.09	39.4871	216.4	2.548	2.538	4.698	3.392	0.844	2.118	1.274	4.020
1:35:46	230.9	0.224	78.2	5.670	4.19	39.5284	218.1	2.566	2.555	4.715	3.418	0.853	2.135	1.283	4.009
1:38:09	232.7	0.230	78.0	5.664	4.29	39.5689	220.0	2.585	2.574	4.734	3.448	0.864	2.156	1.292	3.992
1:40:30	235.2	0.236	78.0	5.658	4.39	39.6102	222.4	2.611	2.600	4.760	3.472	0.862	2.167	1.305	4.026
1:42:53	237.2	0.242	78.0	5.653	4.49	39.6518	224.4	2.632	2.621	4.781	3.496	0.865	2.181	1.315	4.040
1:45:17	238.8	0.247	77.8	5.647	4.59	39.6931	226.1	2.649	2.637	4.797	3.524	0.877	2.200	1.324	4.020
1:47:39	240.7	0.253	77.7	5.641	4.69	39.7345	228.0	2.668	2.656	4.816	3.552	0.886	2.219	1.333	4.011
1:50:01	243.0	0.259	77.5	5.635	4.79	39.7759	230.3	2.692	2.680	4.840	3.590	0.900	2.245	1.345	3.991
1:52:22	244.8	0.265	77.6	5.629	4.89	39.8175	232.1	2.711	2.698	4.858	3.601	0.892	2.246	1.354	4.036
1:54:43	246.5	0.271	77.5	5.623	4.99	39.8595	233.8	2.728	2.715	4.875	3.627	0.902	2.265	1.363	4.020
1:57:00	248.7	0.277	77.3	5.617	5.08	39.9014	236.0	2.750	2.737	4.897	3.659	0.911	2.285	1.374	4.015
1:59:17	250.6	0.283	77.2	5.611	5.18	39.9434	237.9	2.769	2.756	4.916	3.691	0.925	2.308	1.383	3.991
2:01:36	252.1	0.289	77.2	5.605	5.28	39.9855	239.4	2.783	2.770	4.930	3.699	0.919	2.309	1.390	4.025
2:03:52	253.8	0.295	77.1	5.600	5.38	40.0274	241.1	2.800	2.787	4.947	3.723	0.926	2.325	1.398	4.019
2:06:06	255.9	0.300	77.0	5.594	5.48	40.0697	243.2	2.822	2.808	4.968	3.754	0.936	2.345	1.409	4.011
2:08:24	257.4	0.306	76.9	5.588	5.58	40.1123	244.7	2.837	2.823	4.983	3.778	0.945	2.362	1.416	3.997
2:10:42	259.2	0.312	76.8	5.582	5.68	40.1545	246.5	2.855	2.840	5.000	3.801	0.951	2.376	1.425	3.997
2:13:02	261.3	0.318	76.8	5.576	5.78	40.1974	248.6	2.876	2.861	5.021	3.820	0.949	2.384	1.435	4.026
2:15:22	263.3	0.324	76.7	5.570	5.88	40.2394	250.6	2.896	2.881	5.041	3.850	0.959	2.405	1.446	4.015

## Consolidated Undrained Triaxial Test EM 1110-2-1906 Appendix X

Consolidation Values				Final Values				Tested By <u>KDG</u>		Project Number <u>175569069</u>	
Height	<u>5.918 (in.)</u>	<u>15.032 (cm)</u>		Height	<u>4.827 (in.)</u>		Date	<u>12-19-09</u>	Test Number	<u>CU-2B</u>	
Diameter	<u>2.734 (in)</u>	<u>6.944 (cm)</u>		Dia. avg.	<u>3.173 (in)</u>		Press No.	<u>1</u>	Data File ID	<u>2B</u>	
Area	<u>5.870 (in<sup>2</sup>)</u>	<u>37.872 (cm<sup>2</sup>)</u>		Area avg.	<u>7.909 (in<sup>2</sup>)</u>		Panel No.	<u>B</u>	Lateral Pressure (psi)	<u>30.0</u>	
Chamber Pressure - $\sigma_3$ (psi) <u>90</u>											

Clock Time (min.)	Load (lbf)	Deflection Dial Reading (in.)	Pore Pressure Reading (psi)	Corrected Height (in.)	Strain (%)	Corrected Area (cm <sup>2</sup> )	Corrected Load (lbf)	Deviator Stress (tsf)	Corrected Stress* (tsf)	$\sigma_1$ (tsf)	$\sigma_1'$ (tsf)	$\sigma_3'$ (tsf)	$p'$ ( $\sigma_1' + \sigma_3'$ )/2 (tsf)	$q$ ( $\sigma_1 - \sigma_3$ )/2 (tsf)	Effective Principal Stress Ratio $\sigma_1' / \sigma_3'$
2:17:42	264.8	0.330	76.6	5.564	5.98	40.2822	252.1	2.910	2.895	5.055	3.872	0.967	2.420	1.453	4.004
2:19:56	266.1	0.336	76.4	5.558	6.08	40.3251	253.4	2.922	2.906	5.066	3.898	0.981	2.439	1.458	3.972
2:22:12	267.6	0.342	76.4	5.552	6.18	40.3676	254.8	2.935	2.920	5.080	3.906	0.976	2.441	1.465	4.002
2:24:35	269.3	0.348	76.4	5.546	6.28	40.4106	256.6	2.952	2.936	5.096	3.928	0.981	2.455	1.473	4.002
2:26:55	271.0	0.354	76.2	5.540	6.38	40.4541	258.2	2.968	2.952	5.112	3.952	0.990	2.471	1.481	3.992
2:29:09	272.6	0.359	76.1	5.535	6.48	40.4969	259.8	2.984	2.967	5.127	3.978	1.000	2.489	1.489	3.976
2:31:29	274.4	0.365	76.0	5.529	6.58	40.5399	261.7	3.002	2.985	5.145	4.002	1.006	2.504	1.498	3.977
2:33:51	275.6	0.371	76.1	5.523	6.68	40.5832	262.9	3.012	2.995	5.155	4.009	1.004	2.507	1.502	3.992
2:36:15	277.5	0.377	75.9	5.517	6.78	40.6269	264.8	3.031	3.014	5.174	4.039	1.015	2.527	1.512	3.979
2:38:38	278.8	0.383	75.8	5.511	6.88	40.6705	266.1	3.042	3.025	5.185	4.058	1.023	2.541	1.517	3.966
2:41:01	280.9	0.389	75.5	5.505	6.98	40.7137	268.2	3.063	3.045	5.205	4.096	1.041	2.568	1.528	3.936
2:43:23	282.4	0.395	75.7	5.499	7.08	40.7577	269.7	3.077	3.059	5.219	4.099	1.030	2.564	1.535	3.980
2:45:44	283.7	0.401	75.6	5.493	7.18	40.8014	270.9	3.088	3.070	5.230	4.117	1.038	2.578	1.540	3.968
2:48:07	285.5	0.407	75.5	5.487	7.28	40.8454	272.8	3.106	3.087	5.247	4.143	1.046	2.595	1.549	3.961
2:50:30	287.2	0.413	75.3	5.481	7.38	40.8896	274.5	3.121	3.103	5.263	4.169	1.056	2.613	1.556	3.946
2:52:49	288.4	0.418	75.3	5.476	7.48	40.9334	275.7	3.132	3.113	5.273	4.178	1.055	2.617	1.561	3.959
2:55:09	290.1	0.424	75.3	5.470	7.58	40.9773	277.4	3.148	3.129	5.289	4.196	1.067	2.626	1.569	3.970
2:57:33	291.7	0.430	75.2	5.464	7.68	41.0216	279.0	3.162	3.143	5.303	4.221	1.068	2.644	1.576	3.952
2:59:52	292.7	0.436	75.1	5.458	7.78	41.0661	280.0	3.170	3.150	5.310	4.236	1.076	2.656	1.580	3.937
3:02:16	293.9	0.442	74.8	5.452	7.88	41.1103	281.2	3.180	3.160	5.320	4.264	1.093	2.678	1.585	3.900
3:04:34	295.9	0.448	75.0	5.446	7.98	41.1548	283.2	3.200	3.180	5.340	4.270	1.080	2.675	1.595	3.952
3:07:00	297.3	0.454	74.9	5.440	8.08	41.1995	284.5	3.211	3.191	5.351	4.291	1.090	2.690	1.601	3.938
3:09:21	298.6	0.460	74.8	5.434	8.18	41.2443	285.8	3.223	3.202	5.362	4.309	1.097	2.703	1.606	3.928
3:11:42	300.0	0.466	74.6	5.428	8.28	41.2892	287.2	3.235	3.214	5.374	4.336	1.112	2.724	1.612	3.898
3:14:04	302.0	0.472	74.7	5.422	8.38	41.3342	289.2	3.254	3.232	5.392	4.345	1.103	2.724	1.621	3.940
3:16:25	302.8	0.477	74.6	5.417	8.47	41.3790	290.1	3.260	3.238	5.398	4.358	1.110	2.734	1.624	3.926
3:18:45	304.1	0.483	74.4	5.411	8.57	41.4241	291.3	3.270	3.248	5.408	4.380	1.121	2.751	1.629	3.906
3:21:09	306.0	0.489	74.3	5.405	8.67	41.4695	293.3	3.288	3.266	5.426	4.410	1.133	2.772	1.638	3.891
3:23:31	307.1	0.495	74.4	5.399	8.77	41.5146	294.3	3.297	3.274	5.434	4.411	1.126	2.768	1.642	3.917
3:25:53	307.9	0.501	74.3	5.393	8.87	41.5602	295.1	3.302	3.280	5.440	4.420	1.130	2.775	1.645	3.912
3:28:17	309.3	0.507	74.2	5.387	8.97	41.6066	296.5	3.314	3.291	5.451	4.441	1.139	2.790	1.651	3.898
3:30:38	311.0	0.513	74.0	5.381	9.07	41.6517	298.2	3.329	3.306	5.466	4.465	1.149	2.807	1.658	3.887
3:33:02	311.8	0.519	74.1	5.375	9.17	41.6978	299.0	3.335	3.311	5.471	4.467	1.145	2.806	1.661	3.900
3:35:20	312.8	0.525	74.0	5.369	9.27	41.7427	300.0	3.342	3.319	5.479	4.478	1.149	2.813	1.664	3.897
3:37:40	314.2	0.531	73.9	5.364	9.37	41.7887	301.5	3.355	3.331	5.491	4.500	1.159	2.829	1.671	3.884
3:40:01	315.2	0.536	73.8	5.358	9.47	41.8348	302.5	3.362	3.338	5.498	4.515	1.167	2.841	1.674	3.870
3:42:22	316.3	0.542	73.8	5.352	9.57	41.8808	303.6	3.371	3.347	5.507	4.523	1.166	2.845	1.678	3.878
3:44:39	317.8	0.548	73.8	5.346	9.67	41.9271	305.1	3.383	3.359	5.519	4.536	1.167	2.852	1.685	3.886
3:46:57	319.4	0.554	73.7	5.340	9.77	41.9737	306.7	3.397	3.373	5.533	4.558	1.175	2.867	1.691	3.879
3:49:17	320.5	0.560	73.6	5.334	9.87	42.0197	307.8	3.406	3.381	5.541	4.573	1.182	2.878	1.696	3.869
3:51:35	321.6	0.566	73.4	5.328	9.97	42.0664	308.9	3.414	3.389	5.549	4.596	1.198	2.897	1.699	3.838
3:53:54	323.5	0.572	73.5	5.322	10.07	42.1138	310.8	3.432	3.406	5.566	4.602	1.185	2.894	1.708	3.882
3:56:13	324.7	0.578	73.4	5.316	10.17	42.1597	311.9	3.440	3.415	5.575	4.617	1.192	2.905	1.712	3.873
3:58:29	325.7	0.584	73.4	5.310	10.27	42.2069	313.0	3.448	3.422	5.582	4.631	1.198	2.915	1.716	3.864
4:00:46	327.1	0.590	73.1	5.305	10.37	42.2534	314.4	3.460	3.433	5.593	4.658	1.214	2.936	1.722	3.836
4:03:08	327.9	0.595	73.3	5.299	10.47	42.3005	315.1	3.464	3.438	5.598	4.650	1.202	2.926	1.724	3.869
4:05:29	329.1	0.601	73.2	5.293	10.57	42.3482	316.3	3.474	3.447	5.607	4.665	1.208	2.936	1.728	3.862
4:07:49	330.4	0.607	73.1	5.287	10.67	42.3950	317.6	3.484	3.457	5.617	4.682	1.215	2.948	1.733	3.854
4:10:07	331.9	0.613	73.0	5.281	10.77	42.4424	319.2	3.497	3.470	5.630	4.707	1.227	2.967	1.740	3.837
4:12:28	333.0	0.619	73.1	5.275	10.87	42.4897	320.2	3.504	3.477	5.637	4.706	1.219	2.963	1.744	3.860
4:14:54	333.8	0.625	73.0	5.269	10.97	42.5377	321.0	3.509	3.482	5.642	4.715	1.223	2.969	1.746	3.854
4:17:17	335.1	0.631	72.9	5.263	11.07	42.5855	322.4	3.520	3.492	5.652	4.735	1.233	2.984	1.751	3.841
4:19:43	336.5	0.637	72.7	5.257	11.17	42.6328	323.8	3.532	3.503	5.663	4.757	1.243	3.000	1.757	3.827
4:22:06	337.8	0.643	72.8	5.251	11.27	42.6810	325.0	3.541	3.513	5.673	4.760	1.237	2.998	1.761	3.848
4:24:28	338.7	0.649	72.8	5.245	11.37	42.7289	326.0	3.547	3.519	5.679	4.769	1.240	3.005	1.764	3.845
4:26:53	340.5	0.654	72.7	5.240	11.47	42.7770	327.7	3.562	3.533	5.693	4.792	1.248	3.020	1.772	3.838
4:29:15	341.6	0.660	72.5	5.234	11.57	42.8252	328.9	3.571	3.542	5.702	4.810	1.258	3.034	1.776	3.823
4:31:39	342.2	0.666	72.6	5.228	11.66	42.8737	329.5	3.573	3.544	5.704	4.808	1.254	3.031	1.777	3.835
4:34:03	343.3	0.672	72.6	5.222	11.76	42.9217	330.6	3.582	3.552	5.712	4.818	1.256	3.037	1.781	3.836
4:36:27	344.6	0.678	72.4	5.216	11.86	42.9706	331.9	3.592	3.562	5.722	4.836	1.264	3.050	1.786	3.825

**Consolidated Undrained Triaxial Test  
EM 1110-2-1906 Appendix X**

Consolidation Values			Final Values			Tested By	KDG	Project Number	175569069
Height	5.918 (in.)	15.032 (cm)	Height	4.827 (in.)		Date	12-19-09	Test Number	CU-2B
Diameter	2.734 (in.)	6.944 (cm)	Dia. avg.	3.173 (in.)		Press No.	1	Data File ID	2B
Area	5.870 (in <sup>2</sup> )	37.872 (cm <sup>2</sup> )	Area avg.	7.909 (in <sup>2</sup> )		Panel No.	B	Lateral Pressure (psi)	30.0
								Chamber Pressure - $\sigma_3$ (psi)	90

Clock Time (min.)	Load (lbf)	Deflection Dial Reading (in.)	Pore Pressure Reading (psi)	Corrected Height (in.)	Strain (%)	Corrected Area (cm <sup>2</sup> )	Corrected Load (lbf)	Deviator Stress (tsf)	Corrected Deviator Stress* (tsf)	$\sigma_1$ (tsf)	$\sigma_1'$ (tsf)	$\sigma_3'$ (tsf)	$p'$ ( $\sigma_1' + \sigma_3'$ )/2 (tsf)	$q$ ( $\sigma_1 - \sigma_3$ )/2 (tsf)	Effective Principal Stress Ratio $\sigma_1' / \sigma_3'$
4:38:51	345.2	0.684	72.3	5.210	11.96	43.0192	332.5	3.594	3.564	5.724	4.847	1.273	3.060	1.787	3.808
4:41:15	345.9	0.690	72.4	5.204	12.06	43.0683	333.2	3.598	3.567	5.727	4.848	1.270	3.059	1.789	3.816
4:43:38	347.9	0.696	72.3	5.198	12.16	43.1171	335.2	3.615	3.584	5.744	4.867	1.273	3.070	1.797	3.824
4:46:01	348.8	0.702	72.2	5.192	12.26	43.1659	336.1	3.620	3.589	5.749	4.879	1.279	3.079	1.800	3.814
4:48:24	349.6	0.708	72.1	5.186	12.36	43.2151	336.8	3.625	3.593	5.753	4.891	1.287	3.089	1.802	3.799
4:50:44	350.8	0.713	72.1	5.181	12.46	43.2644	338.0	3.633	3.602	5.762	4.900	1.288	3.094	1.806	3.804
4:53:09	352.4	0.719	72.1	5.175	12.56	43.3137	339.6	3.646	3.614	5.774	4.910	1.286	3.098	1.812	3.819
4:55:32	353.0	0.725	72.0	5.169	12.66	43.3633	340.2	3.648	3.616	5.776	4.920	1.293	3.107	1.813	3.804
4:57:55	353.6	0.731	71.9	5.163	12.76	43.4122	340.9	3.651	3.619	5.779	4.930	1.301	3.115	1.815	3.790
5:00:19	355.2	0.737	71.9	5.157	12.86	43.4619	342.4	3.664	3.631	5.791	4.947	1.306	3.126	1.821	3.789
5:02:45	356.3	0.743	71.9	5.151	12.96	43.5118	343.6	3.672	3.639	5.799	4.950	1.301	3.126	1.824	3.804
5:05:10	357.1	0.749	71.8	5.145	13.06	43.5618	344.3	3.676	3.643	5.803	4.960	1.308	3.134	1.826	3.793
5:07:34	358.2	0.755	71.7	5.139	13.16	43.6121	345.5	3.684	3.650	5.810	4.976	1.315	3.146	1.830	3.783
5:09:55	359.5	0.761	71.6	5.133	13.26	43.6617	346.7	3.693	3.659	5.819	4.993	1.324	3.159	1.835	3.771
5:12:21	360.2	0.767	71.7	5.128	13.36	43.7120	347.4	3.696	3.662	5.822	4.988	1.316	3.152	1.836	3.791
5:14:42	360.5	0.773	71.6	5.122	13.46	43.7629	347.8	3.695	3.661	5.821	4.995	1.323	3.159	1.836	3.774
5:17:06	362.2	0.778	71.5	5.116	13.56	43.8129	349.5	3.709	3.675	5.835	5.016	1.331	3.173	1.843	3.769
5:19:28	363.4	0.784	71.2	5.110	13.66	43.8635	350.7	3.717	3.683	5.843	5.047	1.354	3.200	1.847	3.728
5:21:50	364.4	0.790	71.5	5.104	13.76	43.9141	351.7	3.724	3.689	5.849	5.030	1.331	3.180	1.850	3.780
5:24:10	365.7	0.796	71.4	5.098	13.86	43.9651	353.0	3.733	3.698	5.858	5.047	1.338	3.192	1.854	3.771
5:26:30	367.2	0.802	71.3	5.092	13.96	44.0162	354.5	3.745	3.709	5.869	5.063	1.343	3.203	1.860	3.769
5:28:49	367.8	0.808	71.1	5.086	14.06	44.0669	355.1	3.747	3.711	5.871	5.081	1.360	3.221	1.861	3.736
5:31:13	368.6	0.814	71.3	5.080	14.16	44.1183	355.9	3.751	3.715	5.875	5.071	1.346	3.209	1.863	3.767
5:33:29	370.3	0.820	71.2	5.074	14.26	44.1694	357.6	3.764	3.728	5.888	5.090	1.352	3.221	1.869	3.766
5:35:52	371.1	0.826	71.2	5.068	14.36	44.2210	358.4	3.769	3.732	5.892	5.098	1.356	3.227	1.871	3.761
5:38:09	371.9	0.831	71.0	5.063	14.46	44.2728	359.1	3.772	3.735	5.895	5.116	1.370	3.243	1.873	3.734
5:40:26	373.3	0.837	71.1	5.057	14.56	44.3241	360.6	3.783	3.746	5.906	5.117	1.361	3.239	1.878	3.759
5:42:47	374.5	0.843	71.1	5.051	14.66	44.3762	361.8	3.791	3.754	5.914	5.127	1.363	3.245	1.882	3.762
5:45:07	375.1	0.849	71.0	5.045	14.76	44.4279	362.4	3.793	3.756	5.916	5.137	1.371	3.254	1.883	3.746
5:47:28	376.4	0.855	70.8	5.039	14.86	44.4802	363.6	3.801	3.764	5.924	5.155	1.381	3.268	1.887	3.733
5:49:46	378.0	0.861	70.9	5.033	14.95	44.5319	365.2	3.814	3.776	5.936	5.162	1.376	3.269	1.893	3.752
5:52:09	378.2	0.867	70.9	5.027	15.05	44.5841	365.5	3.812	3.774	5.934	5.161	1.377	3.269	1.892	3.748
5:54:33	378.9	0.873	70.8	5.021	15.15	44.6368	366.2	3.815	3.777	5.937	5.171	1.384	3.277	1.893	3.736
5:56:55	380.4	0.879	70.7	5.015	15.25	44.6894	367.6	3.825	3.787	5.947	5.188	1.392	3.290	1.898	3.729
5:59:19	381.3	0.885	70.7	5.010	15.35	44.7417	368.6	3.831	3.792	5.952	5.192	1.390	3.291	1.901	3.736
6:01:49	381.8	0.891	70.7	5.004	15.45	44.7952	369.1	3.831	3.792	5.952	5.192	1.390	3.291	1.901	3.736
6:04:12	383.2	0.896	70.6	4.998	15.55	44.8473	370.5	3.841	3.802	5.962	5.210	1.398	3.304	1.906	3.727
6:06:41	384.6	0.902	70.5	4.992	15.65	44.9016	371.9	3.851	3.812	5.972	5.227	1.405	3.316	1.911	3.720
6:09:06	385.8	0.908	70.5	4.986	15.75	44.9535	373.1	3.859	3.820	5.980	5.232	1.403	3.317	1.915	3.730
6:11:32	386.4	0.914	70.5	4.980	15.85	45.0072	373.7	3.861	3.821	5.981	5.235	1.404	3.319	1.916	3.729
6:13:57	387.7	0.920	70.4	4.974	15.95	45.0602	375.0	3.870	3.829	5.989	5.249	1.410	3.330	1.920	3.724
6:16:25	388.7	0.926	70.3	4.968	16.05	45.1137	376.0	3.875	3.835	5.995	5.262	1.417	3.339	1.922	3.714
6:18:51	389.8	0.932	70.3	4.962	16.15	45.1678	377.0	3.881	3.841	6.001	5.266	1.415	3.341	1.925	3.720
6:21:17	390.5	0.938	70.3	4.956	16.25	45.2217	377.8	3.885	3.844	6.004	5.270	1.416	3.343	1.927	3.721
6:23:41	391.9	0.944	70.2	4.950	16.35	45.2751	379.2	3.894	3.853	6.013	5.286	1.423	3.354	1.932	3.715
6:26:07	393.1	0.949	70.1	4.945	16.45	45.3293	380.4	3.902	3.860	6.020	5.301	1.431	3.366	1.935	3.706
6:28:30	393.5	0.955	70.1	4.939	16.55	45.3830	380.8	3.902	3.860	6.020	5.301	1.431	3.366	1.935	3.705
6:30:52	394.7	0.961	70.1	4.933	16.65	45.4373	382.0	3.909	3.867	6.027	5.306	1.429	3.368	1.938	3.713
6:33:21	396.0	0.967	70.1	4.927	16.75	45.4928	383.3	3.917	3.875	6.035	5.321	1.436	3.379	1.943	3.705
6:35:45	396.5	0.973	70.0	4.921	16.85	45.5463	383.8	3.918	3.875	6.035	5.328	1.443	3.385	1.943	3.693
6:38:10	397.3	0.979	69.9	4.915	16.95	45.6013	384.6	3.922	3.879	6.039	5.334	1.445	3.390	1.945	3.691
6:40:35	398.8	0.985	70.0	4.909	17.05	45.6558	386.1	3.932	3.889	6.049	5.341	1.442	3.392	1.949	3.703
6:43:05	400.1	0.991	69.9	4.903	17.15	45.7111	387.3	3.940	3.897	6.057	5.356	1.449	3.403	1.954	3.696
6:45:29	400.3	0.997	69.8	4.897	17.25	45.7660	387.6	3.938	3.895	6.055	5.360	1.456	3.408	1.952	3.683
6:47:53	401.6	1.003	69.7	4.892	17.35	45.8211	388.9	3.947	3.903	6.063	5.372	1.459	3.416	1.956	3.681
6:50:22	403.3	1.008	69.8	4.886	17.45	45.8768	390.5	3.958	3.914	6.074	5.379	1.455	3.417	1.962	3.697
6:52:44	403.8	1.014	69.7	4.880	17.55	45.9319	391.0	3.959	3.914	6.074	5.386	1.462	3.424	1.962	3.685
6:55:07	404.4	1.020	69.6	4.874	17.65	45.9873	391.7	3.960	3.916	6.076	5.395	1.469	3.432	1.963	3.671
6:57:33	406.1	1.026	69.5	4.868	17.75	46.0433	393.4	3.973	3.928	6.088	5.411	1.473	3.442	1.969	3.673
6:59:57	407.0	1.032	69.6	4.862	17.85	46.0989	394.3	3.977	3.932	6.092	5.410	1.468	3.439	1.971	3.685

## Consolidated Undrained Triaxial Test EM 1110-2-1906 Appendix X

Consolidation Values		
Height	5.918 (in.)	15.032 (cm)
Diameter	2.734 (in)	6.944 (cm)
Area	5.870 (in <sup>2</sup> )	37.872 (cm <sup>2</sup> )

Final Values	
Height	4.827 (in.)
Dia. avg.	3.173 (in)
Area avg.	7.909 (in <sup>2</sup> )



Tested By	KDG
Date	12-19-09
Press No.	1
Panel No.	B

Project Number	175569069
Test Number	CU-2B
Data File ID	2B
Lateral Pressure (psi)	30.0
Chamber Pressure - $\sigma_3$ (psi)	90

Clock Time (min.)	Load (lbf)	Deflection Dial Reading (in.)	Pore Pressure Reading (psi)	Corrected Height (in.)	Strain (%)	Corrected Area (cm <sup>2</sup> )	Corrected Load (lbf)	Deviator Stress (tsf)	Corrected Deviator Stress* (tsf)	$\sigma_1$ (tsf)	$\sigma_1'$ (tsf)	$\sigma_3'$ (tsf)	$p'$ ( $(\sigma_1' + \sigma_3')/2$ ) (tsf)	$q$ ( $(\sigma_1 - \sigma_3)/2$ ) (tsf)	Effective
															Principal Stress Ratio $\sigma_1' / \sigma_3'$
7:02:21	407.5	1.038	69.5	4.856	17.95	46.1557	394.8	3.977	3.932	6.092	5.416	1.475	3.445	1.971	3.673
7:04:43	409.0	1.044	69.4	4.850	18.05	46.2114	396.3	3.988	3.942	6.102	5.434	1.482	3.458	1.976	3.667
7:07:05	410.6	1.050	69.2	4.844	18.14	46.2675	397.9	3.999	3.953	6.113	5.460	1.497	3.478	1.982	3.648
7:09:28	411.3	1.056	69.4	4.838	18.24	46.3243	398.5	4.000	3.954	6.114	5.445	1.481	3.463	1.982	3.677
7:11:49	412.5	1.062	69.3	4.833	18.34	46.3804	399.7	4.007	3.961	6.121	5.459	1.488	3.474	1.986	3.669
7:14:14	414.4	1.067	69.2	4.827	18.44	46.4371	401.6	4.022	3.975	6.135	5.480	1.495	3.488	1.993	3.666

Failure Criterion: Maximum Effective Principal Stress Ratio

**Effective Strength Envelope**

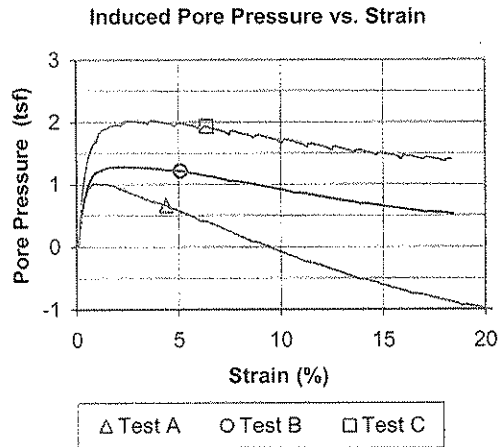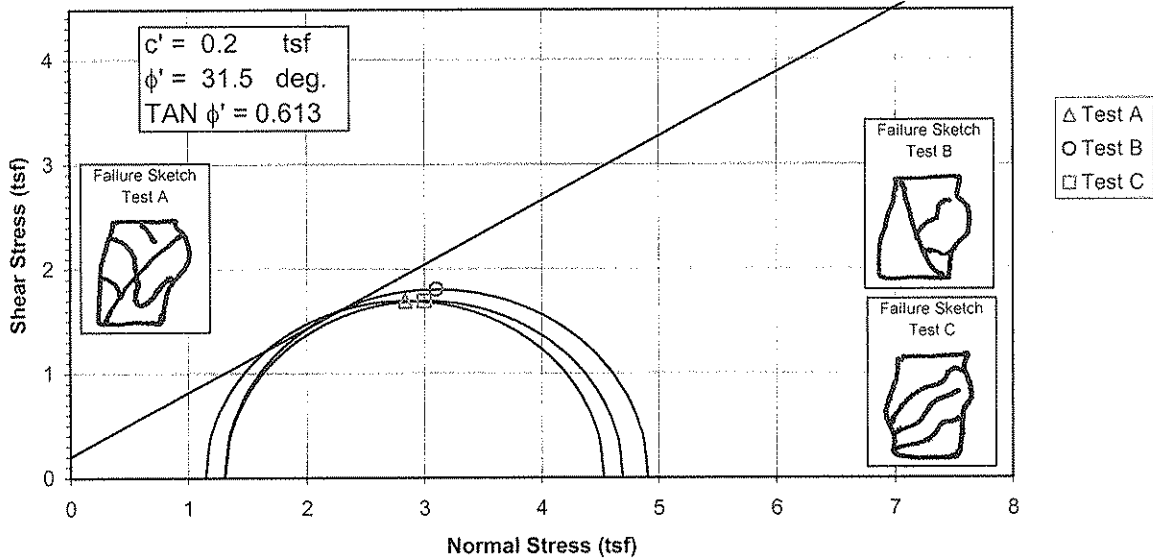

Specimen No.		A	B	C
Initial Data	Water content %	W <sub>o</sub> 20.7	23.1	23.4
	Dry Density PCF	γ <sub>d</sub> <sub>o</sub> 104.3	100.8	100.1
	Saturation %	S <sub>o</sub> 91.4	93.3	92.9
	Void Ratio	e <sub>o</sub> 0.609	0.667	0.677
After Shear	Water content %	W <sub>f</sub> 20.5	23.2	23.1
	Dry Density PCF	γ <sub>d</sub> <sub>f</sub> 108.3	103.4	103.5
	Saturation %	S <sub>f</sub> 100.0	100.0	100.0
	Void Ratio	e <sub>f</sub> 0.551	0.625	0.622
	Final Back Pressure TSF	u <sub>c</sub> 4.68	3.96	3.24
	Minor Principal Stress TSF @ failure	σ <sub>3</sub> <sup>f</sup> 1.15	1.30	1.31
	Maximum Deviator Stress (tsf) @ failure	(σ <sub>1</sub> ' - σ <sub>3</sub> ') <sub>max</sub> 3.40	3.60	3.38
	Time to (σ <sub>1</sub> ' - σ <sub>3</sub> ') <sub>max</sub> min.	t <sub>f</sub> 18.6	21.3	73.5
	Ultimate Deviator Stress, t/sq ft	(σ <sub>1</sub> ' - σ <sub>3</sub> ') <sub>ult</sub> n/a	n/a	n/a
	Initial Diameter, in.	D <sub>o</sub> 2.885	2.878	2.880
Controlled - Strain Test	Initial Height, in.	H <sub>o</sub> 5.940	5.941	6.007


Description of Specimens				Lean Clay (CL), gray brown, moist, firm				
				Type of Specimen	Undisturbed		Type of test	R
LL	PL	PI	Gs	2.69	Project			PAF - Peabody Ash Pond
Remarks:				Boring No.	STN-18 (N2)	Sample No.	3	
				Depth Elev.	24.2'-24.7', 24.8'-25.3', 25.4'-25.9'			
				Laboratory	Stantec		Date	12-19-09
<b>TRIAXIAL COMPRESSION TEST REPORT</b>								

**Consolidated Undrained Triaxial Test  
EM 1110-2-1906 Appendix X**


Project PAF - Peabody Ash Pond  
 Sample ID STN-18 (N2), 24.2'-24.7' & STN-18 (N2), 24.8'-25.3' & STN-18 (N2), 25.4'-25.9'  
 Failure Criterion: Maximum Effective Principal Stress Ratio  $\phi' = 31.5$  deg.

Project No. 175569069  
 Test Number 3  
 $c' = 0.20$  tsf

**p' vs. q Plot**

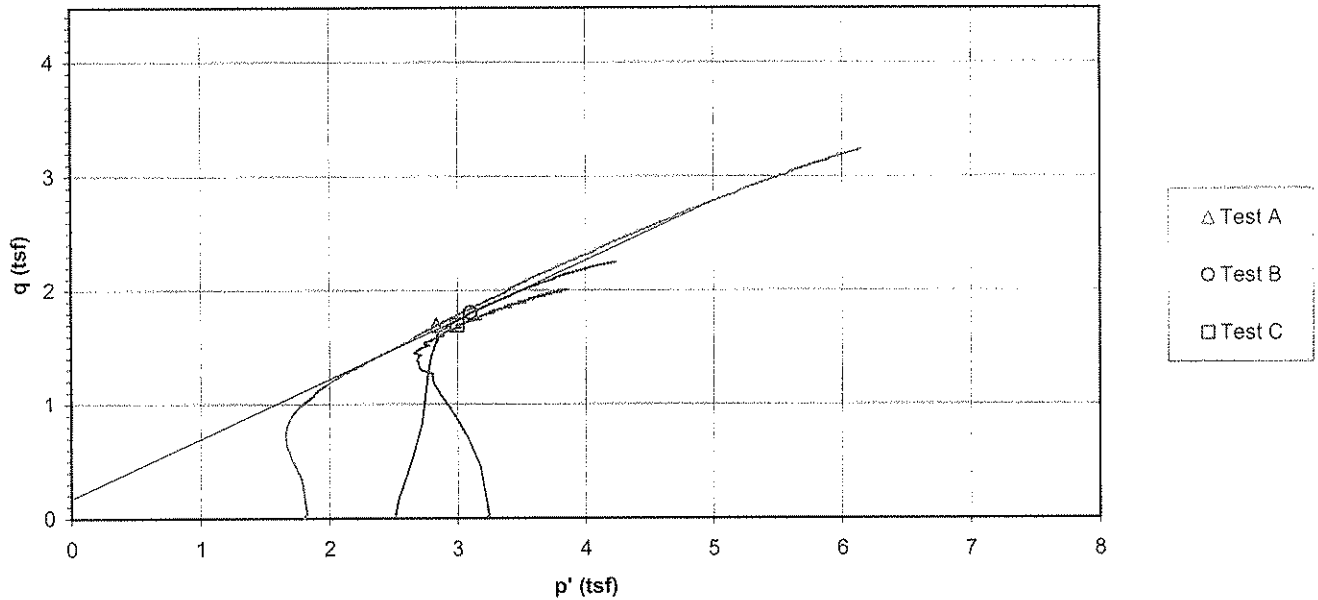

**Deviator Stress and Induced Pore Pressure vs. Axial Strain**

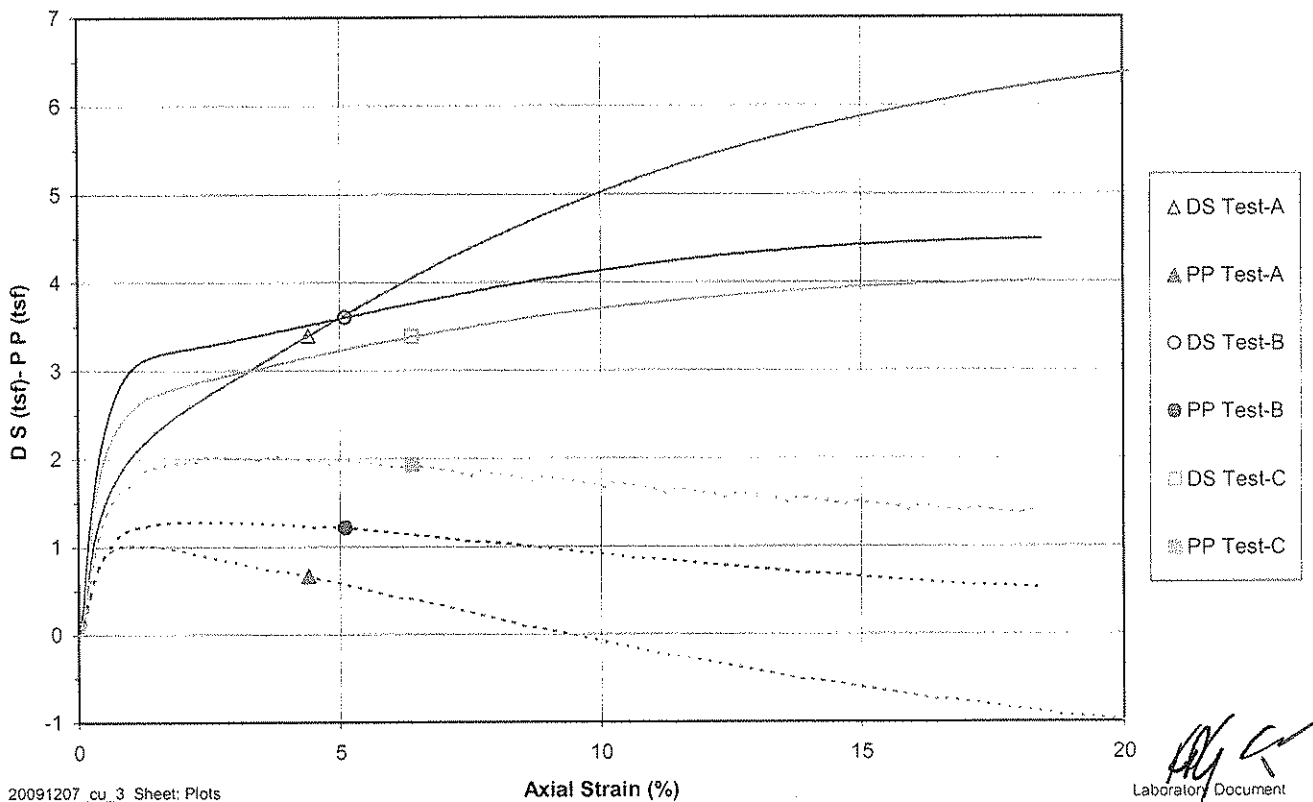

Project Name	PAF - Peabody Ash Pond			Project Number	175569069			
Sample Identification	STN-18 (N2), 24.2'-24.7'			Test Number	CU-3A			
Visual Description	Lean Clay (CL), gray brown, moist, firm			Prepared By	MC			
Undisturbed	Source STN-18 (N2), 24.2'-24.8'			Date	12-9-2009			
Specific Gravity	2.69	ASTM D854 Method A	Liquid Limit	N/A	Plastic Limit	N/A	Plasticity Index	N/A

**Initial Specimen Data**

Specimen Diameter (in.)	Specimen Height (in.)	Volumes (in <sup>3</sup> )	Specimen
Top 2.879	1 5.894	Sample 38.7469 (V <sub>o</sub> )	Wet Weight (g) 1283.25
Middle 2.892	2 5.921	Solids 24.1149 (VS <sub>o</sub> )	Dry Weight (g) 1063.08
Bottom 2.875	3 5.969	Water 13.4349 (Vw <sub>o</sub> )	Wet Unit Weight (pcf) 126.2
Avg. 2.8820 (D <sub>o</sub> )	4 5.975	Void Ratio 14.6320 (Vv <sub>o</sub> )	Dry Unit Weight (pcf) 104.5
Area (in <sup>2</sup> ) 6.5235 (A <sub>o</sub> )	Avg. (H <sub>o</sub> ) 5.9396	Degree of Saturation (%) 91.8 (S <sub>o</sub> )	
Moisture Content (%) 20.7	Final Trimmings	Void Ratio 0.607	

**Saturation**

Set Up & Saturated: Wet xx Dry \_\_\_\_\_ Set up By KDG  
 Back Pressure Saturated to: 65 (psi) Final Pore Pressure Parameter B 0.99 Date 12-10-09  
 Panel Board Number B

Height Readings (in.)	Back Pressure Burette	Chamber Burette	Specimen Height (in.)
Initial 0.1408	Initial 16.77 (in.)	Initial 11.39 (in.)	5.9386 (H <sub>g</sub> )
Final 0.1418	Final 13.05 (in.)	Final 9.3 (in.)	Area (in <sup>2</sup> ) Method A 6.5213 (A <sub>g</sub> )
Change -0.0010 (ΔH <sub>g</sub> )	Change -3.72 (in.)	Change -2.09 (in.)	Specimen Volume (in <sup>3</sup> ) 38.73 (Vs)




**Consolidation**

Height Readings (in.)	Back Pressure Burette Readings	Chamber Burette Readings	Pressures (psi)
Initial 0.1418	Initial 1.17 (in.)	Initial 17.03 (in.)	Chamber 90
Final 0.1727	Final 4.05 (in.)	Final 14.02 (in.)	Back 65
Change -0.0309 (ΔH <sub>c</sub> )	Change -2.88 (in.)	Change -3.01 (in.)	Lateral 25 (σ <sub>3</sub> )
Height (in.) 5.9077 (H <sub>c</sub> )	Volume (in <sup>3</sup> ) 37.3936 (V <sub>c</sub> )	Volume - Water (in <sup>3</sup> ) 13.2787 (VW <sub>c</sub> )	t <sub>50</sub> (min.) 0.738
Area (in <sup>2</sup> ) Method B 6.3296 (A <sub>c</sub> )	Water Content (%) 20.5	Degree of Saturation (%) 100.0 (S <sub>c</sub> )	Void Ratio 0.551
Diameter (in.) 2.8389 (D <sub>c</sub> )			
Dry Density (pcf) 108.3			

**After Test**

Final Measurements	Final Moisture Content	Stresses (membrane corrected) at Failure (psi)
Maximum Diameter 3.459 (in.)	Wet Weight (g) 1280.69	Corrected Deviator 3.40 σ <sub>d</sub> (tsf)
Wet weight (g) 1280.69 (WWf)	Dry Weight (g) 1063.08	Major Principal 4.53 σ <sub>1f</sub> (tsf)
Corrected Diameter 3.435 (in.)	Tare Weight (g) 0.00	Minor Principal 1.15 σ <sub>3f</sub> (tsf)
Youngs Modulus for Membrane (psi) 200		Rate of Strain (% / min.) 0.244
Membrane Thickness (in.) 0.012		Axial Strain at Failure (%) 4.40

Failure Criterion: Maximum Effective Principal Stress Ratio

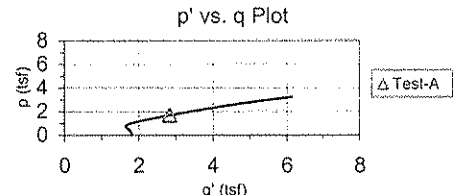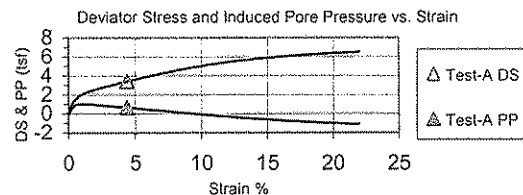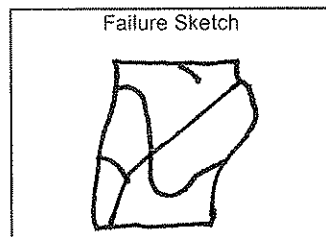

Comments: \_\_\_\_\_

*KDG*

Project Name	PAF - Peabody Ash Pond	Project Number	175569069
Sample Identification	STN-18 (N2), 24.8'-25.3'	Test Number	CU-3B
Visual Description	Lean Clay (CL), gray brown, moist, firm	Prepared By	MC
Undisturbed	Source STN-18 (N2), 24.8'-25.4'	Date	12-9-2009
Specific Gravity	2.69 ASTM D854 Method A	Liquid Limit	N/A
		Plastic Limit	N/A
		Plasticity Index	N/A

**Initial Specimen Data**

Specimen Diameter (in.)	Specimen Height (in.)	Volumes (in3)	Specimen
Top 2.885	1 5.948	Sample 38.6646 (V <sub>o</sub> )	Wet Weight (g) 1258.47
Middle 2.875	2 5.945	Solids 23.1849 (VS <sub>o</sub> )	Dry Weight (g) 1022.08
Bottom 2.876	3 5.927	Water 14.4244 (Vw <sub>o</sub> )	Wet Unit Weight (pcf) 124.0
Avg. 2.8787 (D <sub>o</sub> )	4 5.944	Void Ratio 15.4797 (Vv <sub>o</sub> )	Dry Unit Weight (pcf) 100.7
Area (in <sup>2</sup> ) 6.5084 (A <sub>o</sub> )	Avg. (H <sub>o</sub> ) 5.9408	Degree of Saturation (%) 93.2 (S <sub>o</sub> )	
Moisture Content (%) 23.1	Final Trimmings	Void Ratio 0.668	

**Saturation**

Set Up & Saturated:	Wet <u>xx</u>	Dry _____	Set up By <u>KDG</u>
Back Pressure Saturated to:	<u>55</u> (psi)	Final Pore Pressure Parameter B <u>0.99</u>	Date <u>12-10-09</u>
		Panel Board Number <u>C</u>	




Height Readings (in.)	Back Pressure Burette	Chamber Burette	Specimen Height (in.) <u>5.9427 (H<sub>s</sub>)</u>
Initial <u>0.1508</u>	Initial <u>16.03</u> (in.)	Initial <u>11.89</u> (in.)	Area (in <sup>2</sup> ) Method A <u>6.5125 (A<sub>s</sub>)</u>
Final <u>0.1489</u>	Final <u>11.11</u> (in.)	Final <u>10.7</u> (in.)	Specimen Volume (in <sup>3</sup> ) <u>38.70 (V<sub>s</sub>)</u>
Change <u>0.0019</u> (ΔH <sub>b</sub> )	Change <u>-4.92</u> (in.)	Change <u>-1.19</u> (in.)	

**Consolidation**

Height Readings (in.)	Back Pressure Burette Readings	Chamber Burette Readings	Pressures (psi)
Initial <u>0.1489</u>	Initial <u>1.21</u> (in.)	Initial <u>17.47</u> (in.)	Chamber <u>90</u>
Final <u>0.206</u>	Final <u>5.08</u> (in.)	Final <u>12.29</u> (in.)	Back <u>55</u>
Change <u>-0.0571</u> (ΔH <sub>c</sub> )	Change <u>-3.87</u> (in.)	Change <u>-5.18</u> (in.)	Lateral <u>35</u> (σ <sub>3</sub> )
Height (in.) <u>5.8856 (H<sub>c</sub>)</u>		Volume (in <sup>3</sup> ) <u>37.6667 (V<sub>c</sub>)</u>	
Area (in <sup>3</sup> ) Method B <u>6.3999 (A<sub>c</sub>)</u>		Volume - Water (in <sup>3</sup> ) <u>14.4817 (VW<sub>c</sub>)</u>	D <sub>50</sub> (min.) <u>0.626</u>
Diameter (in.) <u>2.8546 (D<sub>c</sub>)</u>		Water Content (%) <u>23.2</u>	
Dry Density (pcf) <u>103.4</u>		Degree of Saturation (%) <u>100.0 (S<sub>c</sub>)</u>	Void Ratio <u>0.625</u>

**After Test**

Final Measurements	Final Moisture Content	Stresses (membrane corrected) at Failure (psi)
Maximum Diameter <u>3.382</u> (in.)	Wet Weight (g) <u>1259.41</u>	Corrected Deviator <u>3.60</u> σ <sub>d</sub> (tsf)
Wet weight (g) <u>1259.41</u> (WW <sub>f</sub> )	Dry Weight (g) <u>1022.08</u>	Major Principal <u>4.91</u> σ <sub>1'</sub> (tsf)
Corrected Diameter <u>3.358</u> (in.)	Tare Weight (g) <u>0.00</u>	Minor Principal <u>1.30</u> σ <sub>3'</sub> (tsf)
Youngs Modulus for Membrane (psi) <u>200</u>		Rate of Strain (% / min.) <u>0.247</u>
Membrane Thickness (in.) <u>0.012</u>		Axial Strain at Failure (%) <u>5.11</u>
		Failure Criterion: Maximum Effective Principal Stress Ratio

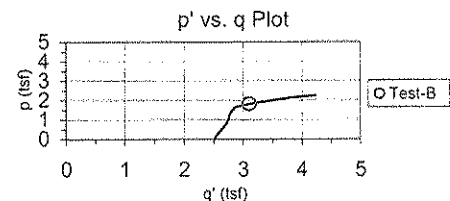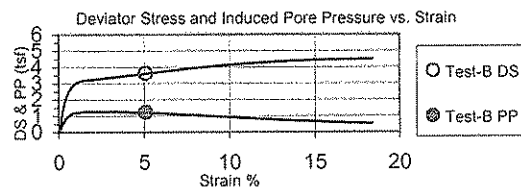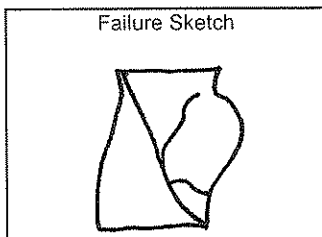

Comments: \_\_\_\_\_

*KDG*



Project Name	<u>PAF - Peabody Ash Pond</u>			Project Number	<u>175569069</u>
Sample Identification	<u>STN-18 (N2), 25.4'-25.9'</u>			Test Number	<u>CU-3C</u>
Visual Description	<u>Lean Clay (CL), brown, moist, firm</u>			Prepared By	<u>MC</u>
Undisturbed	<u>Source STN-18 (M2), 25.4'-26.0'</u>			Date	<u>12-9-2009</u>
Specific Gravity	<u>2.69</u> ASTM D854 Method A	Liquid Limit	<u>N/A</u>	Plastic Limit	<u>N/A</u>
		Plasticity Index	<u>N/A</u>		

**Initial Specimen Data**

Specimen Diameter (in.)	Specimen Height (in.)	Volumes (in <sup>3</sup> )	Specimen
Top <u>2.875</u>	1 <u>6.015</u>	Sample <u>39.1288 (V<sub>o</sub>)</u>	Wet Weight (g) <u>1268.89</u>
Middle <u>2.879</u>	2 <u>6.011</u>	Solids <u>23.3264 (VS<sub>o</sub>)</u>	Dry Weight (g) <u>1028.32</u>
Bottom <u>2.886</u>	3 <u>5.999</u>	Water <u>14.6797 (Vw<sub>o</sub>)</u>	Wet Unit Weight (pcf) <u>123.5</u>
Avg. <u>2.8800 (D<sub>o</sub>)</u>	4 <u>6.001</u>	Voids <u>15.8024 (Vv<sub>o</sub>)</u>	Dry Unit Weight (pcf) <u>100.1</u>
Area (in <sup>2</sup> ) <u>6.5144 (A<sub>o</sub>)</u>	Avg. (H <sub>o</sub> ) <u>6.0065</u>	Degree of Saturation (%) <u>92.9 (S<sub>o</sub>)</u>	
Moisture Content (%) <u>23.4</u>	Final Trimmings	Void Ratio <u>0.677</u>	

**Saturation**

Set Up & Saturated:	Wet <u>xx</u>	Dry _____	Set up By	<u>CSM</u>
Back Pressure Saturated to:	<u>45</u> (psi)	Final Pore Pressure Parameter B	<u>0.95</u>	Date <u>12-11-09</u>
			Panel Board Number	<u>A</u>




Height Readings (in.)	Back Pressure Burette	Chamber Burette	Specimen Height (in.)	<u>5.9952 (H<sub>s</sub>)</u>
Initial <u>0.1987</u>	Initial <u>16.84</u> (in.)	Initial <u>11.01</u> (in.)	Area (in <sup>2</sup> ) Method A	<u>6.4898 (A<sub>s</sub>)</u>
Final <u>0.21</u>	Final <u>11.98</u> (in.)	Final <u>10.04</u> (in.)	Specimen Volume (in <sup>3</sup> )	<u>38.91 (V<sub>s</sub>)</u>
Change <u>-0.0113 (ΔH<sub>b</sub>)</u>	Change <u>-4.86</u> (in.)	Change <u>-0.97</u> (in.)		

**Consolidation**

Height Readings (in.)	Back Pressure Burette Readings	Chamber Burette Readings	Pressures (psi)
Initial <u>0.21</u>	Initial <u>1.13</u> (in.)	Initial <u>17.06</u> (in.)	Chamber <u>90</u>
Final <u>0.2803</u>	Final <u>6.65</u> (in.)	Final <u>11.16</u> (in.)	Back <u>45</u>
Change <u>-0.0703 (ΔH<sub>c</sub>)</u>	Change <u>-5.52</u> (in.)	Change <u>-5.90</u> (in.)	Lateral <u>45 (σ<sub>3</sub>)</u>
Height (in.)	<u>5.9249 (H<sub>c</sub>)</u>	Volume (in <sup>3</sup> )	<u>37.8334 (V<sub>c</sub>)</u>
Area (in <sup>2</sup> ) Method B	<u>6.3855 (A<sub>c</sub>)</u>	Volume - Water (in <sup>3</sup> )	<u>14.5070 (VW<sub>c</sub>)</u>
Diameter (in.)	<u>2.8514 (D<sub>c</sub>)</u>	Water Content (%)	<u>23.1</u>
Dry Density (pcf)	<u>103.5</u>	Degree of Saturation (%)	<u>100.0 (S<sub>c</sub>)</u>
			D <sub>50</sub> (min.) <u>2.764</u>
			Void Ratio <u>0.622</u>

**After Test**

Final Measurements	Final Moisture Content	Stresses (membrane corrected) at Failure (psi)
Maximum Diameter <u>3.403</u> (in.)	Wet Weight (g) <u>1266.06</u>	Corrected Deviator <u>3.38</u> σ <sub>d</sub> (tsf)
Wet weight (g) <u>1266.06 (WWf)</u>	Dry Weight (g) <u>1028.32</u>	Major Principal <u>4.70</u> σ <sub>1'</sub> (tsf)
Corrected Diameter <u>3.379</u> (in.)	Tare Weight (g) <u>0.00</u>	Minor Principal <u>1.31</u> σ <sub>3'</sub> (tsf)
Youngs Modulus for Membrane (psi) <u>200</u>		Rate of Strain (% / min.) <u>0.089</u>
Membrane Thickness (in.) <u>0.012</u>		Axial Strain at Failure (%) <u>6.40</u>
		Failure Criterion: Maximum Effective Principal Stress Ratio

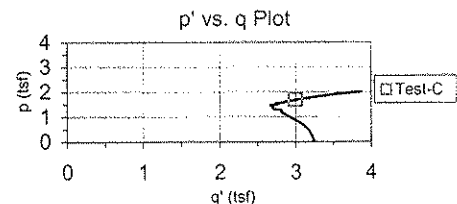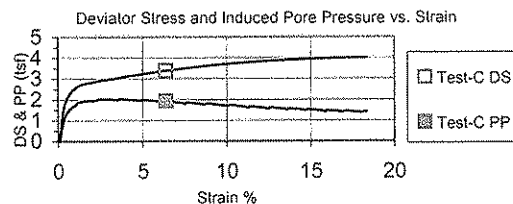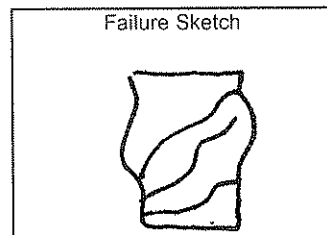

Comments:



## Consolidated Undrained Triaxial Test EM 1110-2-1906 Appendix X

Consolidation Values			Final Values			Tested By		Project Number	
Height	5.908 (in.)	15.006 (cm)	Height	4.608 (in.)		KDG	175569069		
Diameter	2.839 (in.)	7.211 (cm)	Dia. avg.	3.335 (in.)		Date	12-11-09	Test Number	CU-3A
Area	6.330 (in <sup>2</sup> )	40.839 (cm <sup>2</sup> )	Area avg.	8.737 (in <sup>2</sup> )		Press No.	1	Data File ID	3A
						Panel No.	B	Lateral Pressure (psi)	25.0
								Chamber Pressure - $\sigma_3$ (psi)	90

Clock Time (min.)	Load (lbf)	Deflection Dial Reading (in.)	Pore Pressure Reading (psi)	Corrected Height (in.)	Strain (%)	Corrected Area (cm <sup>2</sup> )	Corrected Load (lbf)	Deviator Stress (tsf)	Corrected Deviator Stress* (tsf)	$\sigma_1$ (tsf)	$\sigma_1'$ (tsf)	$\sigma_3$ (tsf)	$p'$ ( $(\sigma_1 + \sigma_3)/2$ ) (tsf)	$q$ ( $(\sigma_1 - \sigma_3)/2$ ) (tsf)	Effective Principal
															Stress Ratio $\sigma_1' / \sigma_3'$
0:00:00	11.8	-0.232	64.9	5.908	0.00	40.8386	0.0	0.000	0.000	1.800	1.800	1.808	1.804	-0.004	0.996
0:00:33	19.2	-0.226	65.1	5.902	0.10	40.8809	7.4	0.084	0.084	1.884	1.866	1.790	1.828	0.038	1.042
0:01:07	71.5	-0.220	69.8	5.896	0.20	40.9206	59.7	0.678	0.678	2.478	2.123	1.453	1.788	0.335	1.461
0:01:38	104.7	-0.214	73.6	5.890	0.30	40.9633	92.8	1.054	1.053	2.853	2.229	1.184	1.706	0.523	1.883
0:02:04	124.8	-0.208	75.7	5.884	0.40	41.0034	112.9	1.281	1.280	3.080	2.305	1.033	1.669	0.636	2.232
0:02:31	140.4	-0.202	77.0	5.878	0.50	41.0444	128.6	1.457	1.455	3.255	2.382	0.934	1.658	0.724	2.550
0:02:57	153.9	-0.196	77.9	5.872	0.60	41.0866	142.1	1.608	1.607	3.407	2.469	0.870	1.670	0.799	2.837
0:03:23	165.3	-0.190	78.4	5.866	0.70	41.1280	153.4	1.735	1.733	3.533	2.567	0.832	1.695	0.863	3.074
0:03:47	174.2	-0.184	78.8	5.860	0.80	41.1681	162.4	1.834	1.832	3.632	2.634	0.809	1.722	0.912	3.253
0:04:13	182.5	-0.178	78.9	5.854	0.90	41.2105	170.7	1.926	1.924	3.724	2.713	0.797	1.755	0.958	3.403
0:04:39	190.3	-0.172	78.9	5.848	1.00	41.2530	178.5	2.012	2.010	3.810	2.798	0.797	1.797	1.001	3.513
0:05:04	196.4	-0.167	78.9	5.843	1.10	41.2942	184.6	2.078	2.076	3.876	2.869	0.801	1.835	1.034	3.581
0:05:30	202.6	-0.161	78.7	5.837	1.21	41.3368	190.7	2.146	2.143	3.943	2.945	0.811	1.878	1.067	3.634
0:05:54	207.5	-0.155	78.9	5.831	1.31	41.3786	195.7	2.199	2.196	3.996	2.988	0.800	1.894	1.094	3.735
0:06:20	213.1	-0.148	78.9	5.824	1.41	41.4222	201.3	2.259	2.256	4.056	3.050	0.802	1.926	1.124	3.803
0:06:45	217.9	-0.143	78.8	5.819	1.50	41.4619	206.0	2.311	2.307	4.107	3.108	0.809	1.959	1.150	3.842
0:07:10	222.3	-0.137	78.7	5.813	1.60	41.5031	210.4	2.358	2.354	4.154	3.162	0.816	1.989	1.173	3.876
0:07:34	226.6	-0.131	78.5	5.807	1.70	41.5454	214.8	2.404	2.400	4.200	3.217	0.825	2.021	1.196	3.899
0:07:59	231.0	-0.125	78.4	5.801	1.80	41.5884	219.2	2.450	2.446	4.246	3.273	0.835	2.054	1.219	3.921
0:08:24	235.3	-0.119	78.3	5.795	1.90	41.6302	223.5	2.496	2.492	4.292	3.329	0.845	2.087	1.242	3.938
0:08:49	239.2	-0.113	78.1	5.789	2.01	41.6750	227.4	2.537	2.532	4.332	3.383	0.859	2.121	1.262	3.938
0:09:11	243.1	-0.107	77.9	5.783	2.10	41.7160	231.3	2.578	2.573	4.373	3.438	0.873	2.155	1.282	3.939
0:09:34	246.6	-0.102	77.7	5.778	2.20	41.7579	234.8	2.615	2.609	4.409	3.490	0.888	2.189	1.301	3.928
0:10:00	250.7	-0.095	77.5	5.771	2.31	41.8038	238.9	2.657	2.651	4.451	3.546	0.903	2.225	1.322	3.928
0:10:24	254.0	-0.090	77.3	5.766	2.40	41.8440	242.2	2.691	2.685	4.485	3.594	0.916	2.255	1.339	3.922
0:10:48	258.2	-0.084	77.1	5.760	2.50	41.8876	246.3	2.734	2.728	4.528	3.649	0.928	2.289	1.360	3.931
0:11:13	261.9	-0.078	76.9	5.754	2.61	41.9309	250.1	2.773	2.767	4.567	3.699	0.940	2.320	1.379	3.934
0:11:38	264.9	-0.072	76.7	5.748	2.71	41.9753	253.0	2.803	2.797	4.597	3.743	0.954	2.349	1.394	3.922
0:12:01	268.4	-0.066	76.6	5.742	2.80	42.0162	256.5	2.839	2.832	4.632	3.789	0.965	2.377	1.412	3.928
0:12:26	272.1	-0.060	76.4	5.736	2.91	42.0605	260.3	2.877	2.870	4.670	3.840	0.978	2.409	1.431	3.928
0:12:49	275.5	-0.054	76.3	5.730	3.00	42.1022	263.7	2.912	2.905	4.705	3.885	0.988	2.436	1.449	3.932
0:13:14	278.6	-0.049	76.1	5.725	3.10	42.1456	266.8	2.943	2.936	4.736	3.931	1.003	2.467	1.464	3.918
0:13:39	282.2	-0.043	75.9	5.719	3.20	42.1896	270.4	2.980	2.972	4.772	3.982	1.018	2.500	1.482	3.913
0:14:05	286.0	-0.036	75.7	5.712	3.31	42.2347	274.2	3.019	3.011	4.811	4.034	1.031	2.532	1.501	3.912
0:14:29	289.2	-0.031	75.5	5.707	3.41	42.2784	277.4	3.051	3.042	4.842	4.080	1.045	2.562	1.517	3.904
0:14:53	293.2	-0.025	75.3	5.701	3.50	42.3210	281.3	3.091	3.083	4.883	4.131	1.057	2.594	1.537	3.910
0:15:17	296.6	-0.019	75.1	5.695	3.60	42.3644	284.8	3.126	3.117	4.917	4.181	1.072	2.626	1.555	3.902
0:15:43	300.3	-0.013	74.9	5.689	3.71	42.4103	288.5	3.163	3.154	4.954	4.236	1.090	2.663	1.573	3.886
0:16:08	303.8	-0.007	74.9	5.683	3.81	42.4545	292.0	3.198	3.189	4.989	4.267	1.086	2.677	1.591	3.929
0:16:31	307.4	-0.001	74.8	5.677	3.90	42.4973	295.5	3.234	3.224	5.024	4.308	1.091	2.700	1.608	3.947
0:16:57	310.9	0.005	74.7	5.671	4.01	42.5428	299.1	3.269	3.259	5.059	4.353	1.102	2.727	1.626	3.951
0:17:22	314.4	0.011	74.5	5.665	4.10	42.5860	302.5	3.303	3.293	5.093	4.399	1.113	2.756	1.643	3.952
0:17:47	317.7	0.017	74.4	5.659	4.20	42.6311	305.8	3.336	3.326	5.126	4.444	1.127	2.785	1.659	3.945
0:18:11	321.4	0.023	74.2	5.653	4.31	42.6763	309.6	3.373	3.363	5.163	4.490	1.135	2.813	1.678	3.956
0:18:35	324.8	0.028	74.1	5.648	4.40	42.7193	313.0	3.407	3.396	5.196	4.534	1.145	2.839	1.694	3.958
0:19:00	327.9	0.034	73.9	5.642	4.50	42.7642	316.0	3.436	3.425	5.225	4.578	1.161	2.870	1.709	3.944
0:19:24	331.6	0.040	73.7	5.636	4.60	42.8099	319.8	3.474	3.462	5.262	4.630	1.176	2.903	1.727	3.938
0:19:49	335.2	0.046	73.5	5.630	4.71	42.8553	323.4	3.509	3.498	5.298	4.680	1.190	2.935	1.745	3.931
0:20:14	338.6	0.052	73.3	5.624	4.80	42.8998	326.7	3.541	3.530	5.330	4.725	1.203	2.964	1.761	3.928
0:20:38	341.9	0.058	73.1	5.618	4.91	42.9450	330.0	3.573	3.561	5.361	4.768	1.214	2.991	1.777	3.927
0:21:03	345.5	0.064	72.9	5.612	5.01	42.9906	333.7	3.609	3.597	5.397	4.817	1.228	3.022	1.795	3.924
0:21:28	349.1	0.070	72.8	5.606	5.10	43.0352	337.3	3.644	3.632	5.432	4.865	1.241	3.053	1.812	3.920
0:21:52	352.2	0.076	72.5	5.600	5.21	43.0811	340.4	3.674	3.661	5.461	4.911	1.258	3.085	1.827	3.904
0:22:17	355.7	0.082	72.3	5.594	5.31	43.1273	343.9	3.708	3.695	5.495	4.958	1.271	3.115	1.844	3.900
0:22:40	359.3	0.087	72.2	5.589	5.40	43.1709	347.4	3.742	3.729	5.529	5.004	1.282	3.143	1.861	3.902
0:23:06	362.9	0.093	72.0	5.583	5.50	43.2177	351.1	3.778	3.764	5.564	5.054	1.298	3.176	1.878	3.895
0:23:31	366.0	0.099	71.8	5.577	5.60	43.2631	354.1	3.806	3.793	5.593	5.098	1.313	3.205	1.892	3.883
0:23:56	369.7	0.105	71.6	5.571	5.70	43.3090	357.8	3.842	3.828	5.628	5.147	1.327	3.237	1.910	3.879
0:24:22	373.5	0.111	71.3	5.565	5.81	43.3562	361.6	3.879	3.864	5.664	5.200	1.343	3.271	1.928	3.872
0:24:45	376.3	0.117	71.1	5.559	5.90	43.4010	364.4	3.905	3.890	5.690	5.241	1.358	3.299	1.941	3.859

# Consolidated Undrained Triaxial Test EM 1110-2-1906 Appendix X

Consolidation Values			Final Values			Tested By	KDG	Project Number		175569069
Height	5.908 (in.)	15.006 (cm)	Height	4.608 (in.)		Date	12-11-09	Test Number	CU-3A	
Diameter	2.839 (in.)	7.211 (cm)	Dia. avg.	3.335 (in.)		Press No.	1	Data File ID	3A	
Area	6.330 (in <sup>2</sup> )	40.839 (cm <sup>2</sup> )	Area avg.	8.737 (in <sup>2</sup> )		Panel No.	B	Lateral Pressure (psi)	25.0	
								Chamber Pressure - $\sigma_3$ (psi)	90	

Clock Time (min.)	Load (lbf)	Deflection Dial Reading (in.)	Pore Pressure Reading (psi)	Corrected		Corrected Load (lbf)	Deviator Stress (tsf)	Corrected Deviator Stress* (tsf)	$\sigma_1$ (tsf)	$\sigma_1'$ (tsf)	$\sigma_3'$ (tsf)	$p'$ ( $(\sigma_1' + \sigma_3')/2$ ) (tsf)	$q$ ( $(\sigma_1 - \sigma_3)/2$ ) (tsf)	Effective Principal Stress Ratio $\sigma_1' / \sigma_3'$
				Height (in.)	Strain (%)									
0:25:10	379.6	0.123	70.9	5.553	6.01	367.8	3.936	3.921	5.721	5.290	1.376	3.333	1.957	3.844
0:25:33	383.3	0.129	70.7	5.547	6.10	43.4928	371.5	3.972	3.957	5.757	1.393	3.367	1.974	3.835
0:25:58	386.9	0.135	70.7	5.541	6.20	43.5394	375.0	4.005	3.990	5.790	1.393	3.384	1.991	3.858
0:26:23	390.1	0.141	70.6	5.535	6.31	43.5875	378.3	4.036	4.020	5.820	1.396	3.402	2.006	3.875
0:26:46	393.6	0.147	70.5	5.529	6.40	43.6328	381.8	4.069	4.053	5.853	1.404	3.427	2.023	3.881
0:27:11	397.4	0.153	70.3	5.523	6.51	43.6806	385.5	4.104	4.088	5.888	1.417	3.457	2.040	3.880
0:27:35	400.4	0.159	70.1	5.517	6.61	43.7275	388.5	4.132	4.116	5.916	1.432	3.486	2.054	3.869
0:27:59	403.7	0.164	69.9	5.512	6.70	43.7731	391.8	4.162	4.146	5.946	1.444	3.513	2.069	3.865
0:28:22	407.0	0.170	69.8	5.506	6.80	43.8201	395.2	4.194	4.177	5.977	1.457	3.542	2.085	3.861
0:28:47	410.8	0.176	69.6	5.500	6.90	43.8676	398.9	4.229	4.212	6.012	1.469	3.571	2.102	3.862
0:29:12	413.7	0.182	69.4	5.494	7.01	43.9149	401.8	4.255	4.238	6.038	1.485	3.600	2.115	3.848
0:29:35	417.5	0.188	69.2	5.488	7.10	43.9614	405.7	4.291	4.274	6.074	1.499	3.632	2.133	3.845
0:30:00	420.5	0.194	69.0	5.482	7.20	44.0085	408.7	4.318	4.301	6.101	1.515	3.661	2.147	3.834
0:30:25	423.1	0.200	68.7	5.476	7.30	44.0563	411.3	4.341	4.323	6.123	1.531	3.689	2.158	3.818
0:30:49	426.5	0.206	68.5	5.470	7.40	44.1041	414.6	4.371	4.353	6.153	1.545	3.718	2.173	3.812
0:31:13	429.8	0.212	68.4	5.464	7.50	44.1512	418.0	4.402	4.384	6.184	1.555	3.743	2.188	3.814
0:31:39	433.3	0.218	68.2	5.458	7.61	44.2005	421.4	4.433	4.415	6.215	1.571	3.775	2.204	3.805
0:32:03	436.0	0.224	68.0	5.452	7.71	44.2493	424.2	4.458	4.439	6.239	1.586	3.802	2.216	3.794
0:32:27	438.8	0.229	67.8	5.447	7.80	44.2952	427.0	4.483	4.464	6.264	1.599	3.827	2.228	3.786
0:32:51	442.1	0.235	67.6	5.441	7.90	44.3434	430.3	4.512	4.493	6.293	1.614	3.856	2.242	3.779
0:33:17	445.5	0.241	67.4	5.435	8.01	44.3936	433.6	4.542	4.522	6.322	1.629	3.886	2.257	3.772
0:33:42	448.0	0.247	67.2	5.429	8.11	44.4419	436.1	4.563	4.544	6.344	1.645	3.913	2.268	3.757
0:34:05	451.4	0.253	67.0	5.423	8.20	44.4881	439.5	4.594	4.574	6.374	1.659	3.942	2.283	3.753
0:34:30	454.7	0.259	66.8	5.417	8.30	44.5367	442.8	4.624	4.603	6.403	1.672	3.970	2.298	3.748
0:34:55	457.5	0.265	66.5	5.411	8.40	44.5852	445.7	4.648	4.628	6.428	1.689	3.999	2.310	3.736
0:35:19	460.1	0.271	66.3	5.405	8.51	44.6352	448.2	4.670	4.649	6.449	1.708	4.028	2.321	3.718
0:35:44	463.6	0.277	66.0	5.399	8.61	44.6850	451.7	4.701	4.680	6.480	1.727	4.063	2.336	3.706
0:36:09	466.9	0.283	66.0	5.393	8.71	44.7340	455.0	4.730	4.709	6.509	1.728	4.078	2.350	3.721
0:36:32	469.2	0.288	65.9	5.388	8.80	44.7812	457.3	4.749	4.728	6.528	1.735	4.095	2.360	3.720
0:36:57	472.6	0.294	65.8	5.382	8.91	44.8317	460.8	4.779	4.758	6.558	1.744	4.119	2.375	3.723
0:37:22	475.7	0.300	65.6	5.376	9.01	44.8815	463.9	4.806	4.784	6.584	1.756	4.144	2.388	3.720
0:37:46	478.4	0.306	65.5	5.370	9.11	44.9306	466.6	4.829	4.807	6.607	1.767	4.167	2.400	3.715
0:38:10	480.6	0.312	65.3	5.364	9.21	44.9789	468.7	4.846	4.824	6.624	1.781	4.189	2.408	3.704
0:38:35	484.4	0.318	65.1	5.358	9.31	45.0287	472.5	4.880	4.857	6.657	1.792	4.216	2.425	3.706
0:38:59	487.1	0.324	64.9	5.352	9.41	45.0784	475.3	4.903	4.880	6.680	1.804	4.240	2.436	3.700
0:39:24	489.5	0.330	64.7	5.346	9.51	45.1288	477.6	4.921	4.898	6.698	1.818	4.264	2.445	3.690
0:39:47	492.3	0.336	64.5	5.340	9.60	45.1774	480.5	4.946	4.922	6.722	1.834	4.291	2.457	3.680
0:40:13	495.3	0.342	64.3	5.334	9.71	45.2300	483.5	4.970	4.947	6.747	1.848	4.318	2.469	3.672
0:40:38	498.3	0.348	64.2	5.328	9.81	45.2799	486.4	4.995	4.972	6.772	1.859	4.341	2.482	3.670
0:41:01	500.6	0.353	64.0	5.323	9.90	45.3283	488.8	5.014	4.990	6.790	1.875	4.366	2.491	3.658
0:41:26	503.8	0.359	63.8	5.317	10.00	45.3783	492.0	5.042	5.017	6.817	1.886	4.391	2.505	3.656
0:41:51	506.8	0.365	63.6	5.311	10.11	45.4302	494.9	5.066	5.041	6.841	1.899	4.415	2.517	3.651
0:42:15	509.4	0.371	63.5	5.305	10.21	45.4805	497.5	5.087	5.062	6.862	1.909	4.436	2.527	3.648
0:42:40	511.9	0.377	63.3	5.299	10.31	45.5319	500.0	5.106	5.081	6.881	1.925	4.461	2.537	3.636
0:43:04	514.9	0.383	63.1	5.293	10.41	45.5814	503.1	5.132	5.107	6.907	1.937	4.486	2.550	3.633
0:43:28	517.9	0.389	62.9	5.287	10.51	45.6330	506.1	5.157	5.131	6.931	1.948	4.510	2.562	3.630
0:43:53	520.2	0.395	62.8	5.281	10.61	45.6851	508.4	5.174	5.149	6.949	1.961	4.531	2.570	3.622
0:44:16	523.4	0.401	62.6	5.275	10.71	45.7349	511.6	5.201	5.175	6.975	1.973	4.557	2.584	3.619
0:44:41	526.2	0.407	62.4	5.269	10.81	45.7878	514.3	5.223	5.197	6.997	1.985	4.580	2.595	3.614
0:45:05	528.2	0.412	62.2	5.264	10.90	45.8370	516.3	5.238	5.212	7.012	1.998	4.600	2.602	3.604
0:45:29	530.6	0.419	62.0	5.257	11.01	45.8904	518.7	5.256	5.230	7.030	2.015	4.626	2.611	3.591
0:45:53	533.7	0.424	61.8	5.252	11.11	45.9404	521.9	5.283	5.256	7.056	2.029	4.653	2.624	3.587
0:46:17	536.3	0.430	61.6	5.246	11.21	45.9925	524.5	5.302	5.275	7.075	2.045	4.679	2.634	3.576
0:46:42	538.4	0.436	61.5	5.240	11.31	46.0458	526.5	5.317	5.290	7.090	2.054	4.695	2.641	3.572
0:47:05	541.3	0.442	61.5	5.234	11.41	46.0971	529.5	5.341	5.313	7.113	2.052	4.704	2.653	3.586
0:47:30	544.1	0.448	61.4	5.228	11.51	46.1490	532.3	5.363	5.335	7.135	2.068	4.722	2.664	3.588
0:47:55	546.5	0.454	61.3	5.222	11.61	46.2017	534.7	5.381	5.353	7.153	2.084	4.741	2.673	3.584
0:48:18	548.4	0.460	61.1	5.216	11.71	46.2535	536.5	5.394	5.365	7.165	2.080	4.759	2.679	3.576
0:48:43	551.3	0.466	61.0	5.210	11.81	46.3064	539.5	5.417	5.389	7.189	2.091	4.781	2.690	3.573
0:49:08	553.8	0.472	60.9	5.204	11.91	46.3591	542.0	5.436	5.407	7.207	2.098	4.798	2.700	3.574

## Consolidated Undrained Triaxial Test EM 1110-2-1906 Appendix X

Consolidation Values			Final Values			Tested By <u>KDG</u>		Project Number <u>175569069</u>	
Height	<u>5.908 (in.)</u>	<u>15.006 (cm)</u>	Height	<u>4.608 (in.)</u>		Date	<u>12-11-09</u>	Test Number	<u>CU-3A</u>
Diameter	<u>2.839 (in)</u>	<u>7.211 (cm)</u>	Dia. avg.	<u>3.335 (in)</u>		Press No.	<u>1</u>	Data File ID	<u>3A</u>
Area	<u>6.330 (in<sup>2</sup>)</u>	<u>40.839 (cm<sup>2</sup>)</u>	Area avg.	<u>8.737 (in<sup>2</sup>)</u>		Panel No.	<u>B</u>	Lateral Pressure (psi)	<u>25.0</u>
								Chamber Pressure - $\sigma_3$ (psi)	<u>90</u>

Clock Time (min.)	Load (lbf)	Deflection Dial Reading (in.)	Pore Pressure Reading (psi)	Corrected Height (in.)	Strain (%)	Corrected Area		Corrected Load (lbf)	Deviator Stress (tsf)	Corrected Deviator Stress* (tsf)	$\sigma_1$ (tsf)	$\sigma_1'$ (tsf)	$\sigma_3'$ (tsf)	$p' (\sigma_1' + \sigma_3')/2$ (tsf)	$q (\sigma_1 - \sigma_3)/2$ (tsf)	Effective Principal Stress Ratio $\sigma_1' / \sigma_3'$
						Area (cm <sup>2</sup> )	Area (in <sup>2</sup> )									
0:49:32	555.6	0.478	60.7	5.198	12.01	46.4123	543.8	5.448	5.419	7.219	7.522	2.111	4.816	2.705	3.564	
0:49:56	558.5	0.483	60.5	5.193	12.11	46.4635	546.7	5.471	5.441	7.241	7.565	2.121	4.838	2.717	3.562	
0:50:20	561.0	0.489	60.3	5.187	12.21	46.5163	549.2	5.490	5.460	7.260	7.588	2.135	4.861	2.726	3.554	
0:50:45	563.1	0.495	60.2	5.181	12.31	46.5701	551.3	5.504	5.474	7.274	7.613	2.147	4.880	2.733	3.547	
0:51:08	565.1	0.501	60.0	5.175	12.40	46.6219	553.3	5.518	5.488	7.288	7.641	2.160	4.901	2.740	3.537	
0:51:34	568.0	0.507	59.9	5.169	12.51	46.6777	556.2	5.541	5.510	7.310	7.673	2.171	4.922	2.751	3.535	
0:51:58	570.2	0.513	59.7	5.163	12.61	46.7296	558.4	5.556	5.526	7.326	7.700	2.182	4.941	2.759	3.529	
0:52:23	572.4	0.519	59.6	5.157	12.71	46.7830	560.6	5.572	5.541	7.341	7.725	2.192	4.959	2.766	3.524	
0:52:47	574.8	0.525	59.4	5.151	12.81	46.8387	562.9	5.589	5.557	7.357	7.753	2.204	4.978	2.775	3.518	
0:53:12	577.6	0.531	59.3	5.145	12.91	46.8919	565.8	5.610	5.579	7.379	7.784	2.213	4.999	2.786	3.517	
0:53:35	579.5	0.537	59.1	5.139	13.01	46.9439	567.7	5.623	5.591	7.391	7.807	2.224	5.016	2.792	3.511	
0:54:00	581.2	0.543	58.9	5.133	13.11	46.9997	569.4	5.633	5.601	7.401	7.831	2.238	5.035	2.797	3.499	
0:54:23	584.1	0.548	58.8	5.128	13.21	47.0527	572.2	5.655	5.623	7.423	7.861	2.246	5.054	2.808	3.500	
0:54:48	586.3	0.554	58.7	5.122	13.31	47.1063	574.5	5.671	5.638	7.438	7.886	2.256	5.071	2.815	3.496	
0:55:13	588.3	0.560	58.5	5.116	13.41	47.1621	576.4	5.683	5.651	7.451	7.913	2.270	5.091	2.822	3.486	
0:55:37	590.6	0.566	58.3	5.110	13.51	47.2172	578.8	5.700	5.667	7.467	7.940	2.281	5.110	2.830	3.482	
0:56:02	593.2	0.572	58.2	5.104	13.61	47.2725	581.3	5.718	5.685	7.485	7.970	2.293	5.132	2.839	3.476	
0:56:26	595.2	0.578	58.0	5.098	13.71	47.3253	583.4	5.732	5.699	7.499	7.997	2.306	5.152	2.845	3.468	
0:56:50	596.8	0.584	57.7	5.092	13.81	47.3798	584.9	5.741	5.707	7.507	8.024	2.325	5.175	2.850	3.451	
0:57:15	599.7	0.590	57.7	5.086	13.91	47.4354	587.9	5.763	5.729	7.529	8.046	2.325	5.185	2.861	3.461	
0:57:40	601.8	0.596	57.7	5.080	14.01	47.4912	590.0	5.777	5.743	7.543	8.059	2.324	5.191	2.867	3.468	
0:58:04	603.4	0.602	57.6	5.074	14.11	47.5474	591.6	5.786	5.751	7.551	8.074	2.330	5.202	2.872	3.465	
0:58:28	605.9	0.608	57.5	5.068	14.21	47.6010	594.1	5.804	5.769	7.569	8.100	2.338	5.219	2.881	3.464	
0:58:52	608.1	0.614	57.4	5.062	14.31	47.6576	596.3	5.818	5.783	7.583	8.121	2.346	5.233	2.888	3.462	
0:59:17	610.2	0.619	57.3	5.057	14.41	47.7129	598.3	5.831	5.796	7.596	8.143	2.355	5.249	2.894	3.458	
0:59:42	612.0	0.625	57.2	5.051	14.51	47.7697	600.2	5.842	5.807	7.607	8.164	2.365	5.264	2.900	3.453	
1:00:05	614.6	0.631	57.1	5.045	14.61	47.8244	602.8	5.861	5.825	7.625	8.189	2.372	5.281	2.909	3.452	
1:00:30	616.7	0.637	56.9	5.039	14.71	47.8817	604.8	5.874	5.838	7.638	8.213	2.383	5.298	2.915	3.447	
1:00:55	618.6	0.643	56.7	5.033	14.81	47.9386	606.8	5.886	5.850	7.650	8.237	2.395	5.316	2.921	3.439	
1:01:18	620.7	0.649	56.6	5.027	14.91	47.9940	608.8	5.899	5.863	7.663	8.260	2.405	5.333	2.927	3.434	
1:01:43	622.9	0.655	56.5	5.021	15.01	48.0524	611.0	5.913	5.876	7.676	8.284	2.415	5.349	2.934	3.430	
1:02:06	624.8	0.661	56.3	5.015	15.11	48.1062	612.9	5.925	5.888	7.688	8.305	2.425	5.365	2.940	3.425	
1:02:31	626.5	0.667	56.2	5.009	15.21	48.1641	614.6	5.934	5.897	7.697	8.324	2.435	5.379	2.945	3.419	
1:02:54	629.1	0.673	56.0	5.003	15.31	48.2191	617.3	5.953	5.915	7.715	8.353	2.446	5.399	2.954	3.415	
1:03:19	631.1	0.679	55.9	4.997	15.41	48.2772	619.2	5.964	5.927	7.727	8.373	2.454	5.414	2.959	3.411	
1:03:44	632.8	0.684	55.8	4.992	15.51	48.3342	620.9	5.974	5.936	7.736	8.392	2.464	5.428	2.964	3.406	
1:04:08	634.8	0.690	55.7	4.986	15.61	48.3922	623.0	5.986	5.948	7.748	8.409	2.468	5.439	2.970	3.406	
1:04:33	637.1	0.696	55.6	4.980	15.71	48.4503	625.2	6.001	5.962	7.762	8.433	2.478	5.455	2.977	3.403	
1:04:58	638.8	0.702	55.5	4.974	15.81	48.5064	627.0	6.010	5.972	7.772	8.451	2.487	5.469	2.982	3.398	
1:05:22	640.3	0.708	55.3	4.968	15.91	48.5647	628.4	6.017	5.979	7.779	8.469	2.498	5.483	2.985	3.390	
1:05:47	642.6	0.714	55.2	4.962	16.01	48.6229	630.8	6.032	5.993	7.793	8.493	2.508	5.500	2.993	3.387	
1:06:12	645.0	0.720	55.0	4.956	16.11	48.6808	633.1	6.048	6.008	7.808	8.520	2.519	5.519	3.000	3.382	
1:06:36	646.7	0.726	54.9	4.950	16.21	48.7390	634.9	6.057	6.018	7.818	8.538	2.528	5.533	3.005	3.377	
1:07:01	648.1	0.732	54.8	4.944	16.31	48.7982	636.3	6.063	6.023	7.823	8.561	2.545	5.553	3.008	3.363	
1:07:26	650.8	0.738	54.5	4.938	16.41	48.8555	638.9	6.081	6.041	7.841	8.590	2.556	5.573	3.017	3.360	
1:07:49	652.8	0.743	54.5	4.933	16.51	48.9126	640.9	6.093	6.053	7.853	8.598	2.553	5.576	3.023	3.368	
1:08:15	654.2	0.750	54.5	4.926	16.61	48.9736	642.4	6.099	6.059	7.859	8.604	2.553	5.578	3.025	3.370	
1:08:38	656.3	0.755	54.5	4.921	16.71	49.0303	644.5	6.112	6.072	7.872	8.623	2.559	5.591	3.032	3.370	
1:09:03	658.8	0.761	54.4	4.915	16.81	49.0889	647.0	6.129	6.088	7.888	8.643	2.563	5.603	3.040	3.372	
1:09:28	660.6	0.767	54.3	4.909	16.91	49.1492	648.7	6.138	6.096	7.896	8.659	2.570	5.615	3.044	3.369	
1:09:52	662.0	0.773	54.2	4.903	17.01	49.2086	650.2	6.144	6.103	7.903	8.674	2.579	5.627	3.047	3.363	
1:10:17	664.8	0.779	54.1	4.897	17.11	49.2686	652.9	6.162	6.121	7.921	8.697	2.584	5.640	3.056	3.366	
1:10:42	666.7	0.785	54.0	4.891	17.21	49.3274	654.9	6.174	6.132	7.932	8.715	2.591	5.653	3.062	3.364	
1:11:06	668.2	0.791	53.9	4.885	17.31	49.3867	656.4	6.180	6.138	7.938	8.733	2.602	5.667	3.065	3.356	
1:11:30	670.0	0.797	53.7	4.879	17.41	49.4454	658.2	6.190	6.147	7.947	8.752	2.612	5.682	3.070	3.351	
1:11:54	672.3	0.803	53.6	4.873	17.51	49.5056	660.5	6.204	6.161	7.961	8.774	2.620	5.697	3.077	3.348	
1:12:19	673.9	0.809	53.5	4.867	17.61	49.5663	662.1	6.211	6.169	7.969	8.789	2.628	5.709	3.080	3.344	
1:12:44	675.3	0.814	53.3	4.862	17.71	49.6265	663.4	6.216	6.173	7.973	8.805	2.639	5.722	3.083	3.336	
1:13:08	677.6	0.820	53.2	4.856	17.81	49.6877	665.7	6.230	6.187	7.987	8.826	2.647	5.737	3.090	3.334	
1:13:33	679.2	0.826	53.1	4.850	17.91	49.7482	667.4	6.238	6.194	7.994	8.840	2.654	5.747	3.093	3.331	

## Consolidated Undrained Triaxial Test EM 1110-2-1906 Appendix X

Consolidation Values		
Height	5.908 (in.)	15.006 (cm)
Diameter	2.839 (in.)	7.211 (cm)
Area	6.330 (in <sup>2</sup> )	40.839 (cm <sup>2</sup> )

Final Values	
Height	4.608 (in.)
Dia. avg.	3.335 (in.)
Area avg.	8.737 (in <sup>2</sup> )

Tested By	
Date	12-11-09
Press No.	1
Panel No.	B

Project Number	
Test Number	CU-3A
Data File ID	3A
Lateral Pressure (psi)	25.0
Chamber Pressure - $\sigma_3$ (psi)	90

Clock Time (min.)	Load (lbf)	Deflection Dial Reading (in.)	Pore Pressure Reading (psi)	Corrected Height (in.)	Strain (%)	Corrected Area (cm <sup>2</sup> )	Corrected Load (lbf)	Deviator Stress (tsf)	Corrected Deviator Stress* (tsf)	$\sigma_1$ (tsf)	$\sigma_1'$ (tsf)	$\sigma_3'$ (tsf)	$p'$ ( $\sigma_1' + \sigma_3'$ )/2 (tsf)	$q$ ( $\sigma_1 - \sigma_3$ )/2 (tsf)	Effective Principal Stress Ratio $\sigma_1' / \sigma_3'$
1:13:58	681.0	0.832	53.0	4.844	18.01	49.8085	669.1	6.247	6.203	8.003	8.857	2.662	5.759	3.098	3.327
1:14:22	682.4	0.838	52.9	4.838	18.11	49.8701	670.6	6.252	6.208	8.008	8.872	2.671	5.772	3.100	3.321
1:14:47	684.7	0.844	52.8	4.832	18.21	49.9313	672.9	6.266	6.222	8.022	8.892	2.678	5.785	3.107	3.320
1:15:12	686.4	0.850	52.7	4.826	18.31	49.9929	674.6	6.274	6.230	8.030	8.907	2.685	5.796	3.111	3.317
1:15:36	688.0	0.856	52.6	4.820	18.41	50.0542	676.1	6.281	6.236	8.036	8.923	2.695	5.809	3.114	3.312
1:16:00	689.9	0.862	52.4	4.814	18.51	50.1136	678.1	6.292	6.247	8.047	8.943	2.704	5.823	3.120	3.308
1:16:25	692.2	0.868	52.4	4.808	18.61	50.1749	680.4	6.305	6.260	8.060	8.963	2.710	5.837	3.126	3.307
1:16:49	693.6	0.873	52.2	4.803	18.71	50.2370	681.8	6.311	6.265	8.065	8.979	2.721	5.850	3.129	3.299
1:17:13	695.0	0.879	52.0	4.797	18.81	50.2986	683.2	6.316	6.270	8.070	8.997	2.735	5.866	3.131	3.289
1:17:37	697.2	0.885	51.8	4.791	18.91	50.3606	685.4	6.328	6.282	8.082	9.022	2.748	5.885	3.137	3.283
1:18:01	698.6	0.891	52.0	4.785	19.01	50.4228	686.8	6.333	6.287	8.087	9.017	2.737	5.877	3.140	3.294
1:18:25	699.9	0.897	51.9	4.779	19.11	50.4863	688.1	6.337	6.291	8.091	9.026	2.743	5.884	3.142	3.291
1:18:49	702.2	0.903	51.9	4.773	19.21	50.5478	690.3	6.350	6.304	8.104	9.042	2.746	5.894	3.148	3.292
1:19:13	703.9	0.909	51.8	4.767	19.31	50.6112	692.0	6.358	6.311	8.111	9.055	2.751	5.903	3.152	3.291
1:19:38	705.7	0.915	51.8	4.761	19.41	50.6738	693.9	6.367	6.320	8.120	9.066	2.753	5.909	3.156	3.293
1:20:02	707.3	0.921	51.6	4.755	19.51	50.7363	695.5	6.374	6.327	8.127	9.080	2.761	5.921	3.159	3.288
1:20:26	709.2	0.927	51.6	4.749	19.61	50.8003	697.4	6.383	6.336	8.136	9.094	2.767	5.931	3.164	3.287
1:20:51	711.1	0.933	51.5	4.743	19.71	50.8636	699.3	6.393	6.345	8.145	9.110	2.773	5.942	3.168	3.285
1:21:16	712.3	0.939	51.4	4.737	19.81	50.9277	700.5	6.396	6.348	8.148	9.123	2.783	5.953	3.170	3.278
1:21:39	714.4	0.944	51.3	4.732	19.91	50.9897	702.5	6.407	6.358	8.158	9.140	2.790	5.965	3.175	3.276
1:22:04	716.3	0.950	51.1	4.726	20.01	51.0540	704.5	6.416	6.368	8.168	9.157	2.798	5.978	3.180	3.273
1:22:28	717.8	0.956	51.1	4.720	20.11	51.1192	706.0	6.422	6.373	8.173	9.167	2.802	5.984	3.182	3.272
1:22:53	718.9	0.962	50.9	4.714	20.21	51.1833	707.0	6.424	6.374	8.174	9.180	2.814	5.997	3.183	3.263
1:23:18	721.3	0.968	50.9	4.708	20.31	51.2488	709.4	6.437	6.388	8.188	9.198	2.818	6.008	3.190	3.264
1:23:41	722.8	0.974	50.8	4.702	20.41	51.3098	710.9	6.443	6.393	8.193	9.208	2.823	6.015	3.193	3.262
1:24:06	723.7	0.980	50.7	4.696	20.51	51.3754	711.8	6.443	6.393	8.193	9.216	2.832	6.024	3.192	3.255
1:24:30	725.8	0.986	50.6	4.690	20.61	51.4402	713.9	6.454	6.404	8.204	9.234	2.838	6.036	3.198	3.253
1:24:55	728.1	0.992	50.5	4.684	20.71	51.5057	716.2	6.466	6.416	8.216	9.250	2.842	6.046	3.204	3.255
1:25:20	729.4	0.998	50.4	4.678	20.81	51.5706	717.5	6.470	6.419	8.219	9.262	2.850	6.056	3.206	3.249
1:25:44	730.4	1.004	50.3	4.672	20.91	51.6370	718.6	6.471	6.420	8.220	9.273	2.861	6.067	3.206	3.241
1:26:08	732.7	1.009	50.2	4.667	21.01	51.7006	720.8	6.483	6.432	8.232	9.290	2.865	6.078	3.212	3.242
1:26:32	734.1	1.015	50.1	4.661	21.11	51.7667	722.3	6.488	6.436	8.236	9.301	2.873	6.087	3.214	3.238
1:26:56	735.0	1.021	50.0	4.655	21.21	51.8312	723.1	6.488	6.436	8.236	9.309	2.881	6.095	3.214	3.231
1:27:21	736.8	1.027	49.8	4.649	21.31	51.8972	725.0	6.496	6.444	8.244	9.327	2.891	6.109	3.218	3.226
1:27:45	738.9	1.033	49.7	4.643	21.41	51.9637	727.1	6.506	6.454	8.254	9.345	2.899	6.122	3.223	3.224
1:28:10	740.1	1.039	49.6	4.637	21.51	52.0318	728.3	6.508	6.456	8.256	9.354	2.906	6.130	3.224	3.219
1:28:34	741.0	1.045	49.7	4.631	21.61	52.0968	729.1	6.508	6.455	8.255	9.348	2.901	6.124	3.224	3.223
1:28:58	743.2	1.051	49.7	4.625	21.71	52.1626	731.4	6.520	6.467	8.267	9.359	2.900	6.129	3.230	3.228
1:29:23	745.0	1.057	49.7	4.619	21.81	52.2310	733.1	6.527	6.474	8.274	9.369	2.903	6.136	3.233	3.227
1:29:46	745.7	1.063	49.6	4.613	21.91	52.2959	733.9	6.526	6.472	8.272	9.372	2.908	6.140	3.232	3.223
1:30:10	747.6	1.068	49.6	4.608	22.01	52.3629	735.8	6.534	6.480	8.280	9.385	2.912	6.148	3.236	3.223

**Consolidated Undrained Triaxial Test  
EM 1110-2-1906 Appendix X**

Consolidation Values				Final Values				Tested By <u>KDG</u>		Project Number <u>175569069</u>	
Height	<u>5.886 (in.)</u>	<u>14.949 (cm)</u>		Height	<u>4.800 (in.)</u>		Date	<u>12-11-09</u>	Test Number	<u>CU-3B</u>	
Diameter	<u>2.855 (in)</u>	<u>7.251 (cm)</u>		Dia. avg.	<u>3.260 (in)</u>		Press No.	<u>1</u>	Data File ID	<u>3B</u>	
Area	<u>6.400 (in<sup>2</sup>)</u>	<u>41.292 (cm<sup>2</sup>)</u>		Area avg.	<u>8.347 (in<sup>2</sup>)</u>		Panel No.	<u>C</u>	Lateral Pressure (psi)	<u>35.0</u>	
									Chamber Pressure - $\sigma_3$ (psi)	<u>90</u>	

Clock Time (min.)	Load (lbf)	Deflection Dial Reading (in.)	Pore Pressure Reading (psi)	Corrected Height (in.)	Strain (%)	Corrected Area (cm <sup>2</sup> )	Corrected Load (lbf)	Corrected Deviator Stress (tsf)	Corrected Deviator Stress* (tsf)	$\sigma_1$ (tsf)	$\sigma_1'$ (tsf)	$\sigma_3'$ (tsf)	$p'$ ( $(\sigma_1' + \sigma_3')/2$ ) (tsf)	q ( $(\sigma_1 - \sigma_3)/2$ ) (tsf)	Effective
															Principal Stress Ratio $\sigma_1' / \sigma_3'$
0:00:00	13.2	-0.020	55.1	5.886	0.00	41.2918	0.0	0.000	0.000	2.520	2.520	2.516	2.518	0.002	1.001
0:00:32	39.2	-0.014	56.8	5.879	0.10	41.3351	26.0	0.292	0.292	2.812	2.687	2.391	2.539	0.148	1.124
0:01:07	110.7	-0.008	60.7	5.873	0.21	41.3775	97.5	1.096	1.095	3.615	3.207	2.109	2.658	0.549	1.521
0:01:38	180.1	-0.001	63.6	5.867	0.31	41.4209	146.8	1.648	1.648	4.168	3.552	1.901	2.727	0.826	1.869
0:02:05	192.4	0.004	65.8	5.862	0.40	41.4589	179.2	2.010	2.009	4.529	3.753	1.740	2.746	1.006	2.157
0:02:31	216.1	0.010	67.5	5.856	0.50	41.5012	202.8	2.273	2.272	4.792	3.898	1.623	2.761	1.138	2.402
0:02:59	237.6	0.016	68.9	5.850	0.61	41.5433	224.4	2.511	2.510	5.030	4.031	1.518	2.774	1.257	2.656
0:03:25	253.0	0.022	69.9	5.844	0.71	41.5854	239.8	2.661	2.660	5.200	4.129	1.446	2.788	1.342	2.856
0:03:52	265.9	0.028	70.7	5.838	0.80	41.6269	252.7	2.823	2.821	5.341	4.212	1.388	2.800	1.412	3.035
0:04:18	275.5	0.034	71.3	5.832	0.91	41.6693	262.2	2.926	2.924	5.444	4.277	1.349	2.813	1.464	3.170
0:04:44	282.5	0.039	71.6	5.826	1.00	41.7108	269.2	3.001	2.999	5.519	4.325	1.322	2.823	1.501	3.271
0:05:10	287.9	0.045	71.9	5.821	1.10	41.7528	274.6	3.059	3.056	5.576	4.364	1.304	2.834	1.530	3.346
0:05:35	292.2	0.051	72.0	5.815	1.21	41.7962	278.9	3.103	3.100	5.620	4.398	1.294	2.846	1.552	3.399
0:05:59	295.3	0.057	72.2	5.809	1.31	41.8380	282.0	3.135	3.131	5.651	4.419	1.284	2.852	1.568	3.442
0:06:24	297.3	0.063	72.4	5.803	1.41	41.8813	284.1	3.154	3.151	5.671	4.419	1.264	2.842	1.577	3.495
0:06:49	299.5	0.069	72.6	5.797	1.51	41.9231	286.2	3.175	3.171	5.691	4.430	1.256	2.843	1.587	3.529
0:07:13	301.3	0.075	72.7	5.791	1.61	41.9669	288.0	3.192	3.188	5.708	4.441	1.249	2.845	1.596	3.555
0:07:38	302.9	0.081	72.7	5.785	1.71	42.0084	289.6	3.206	3.202	5.722	4.449	1.244	2.847	1.603	3.577
0:08:04	304.0	0.087	72.8	5.779	1.81	42.0516	290.7	3.215	3.210	5.730	4.456	1.242	2.849	1.607	3.589
0:08:29	305.5	0.093	72.8	5.773	1.91	42.0976	292.3	3.228	3.224	5.744	4.466	1.239	2.853	1.614	3.605
0:08:52	306.9	0.098	72.8	5.767	2.01	42.1378	293.7	3.241	3.236	5.756	4.475	1.236	2.856	1.620	3.621
0:09:15	307.9	0.104	72.8	5.762	2.11	42.1800	294.7	3.249	3.244	5.764	4.483	1.236	2.860	1.624	3.627
0:09:39	309.1	0.110	72.8	5.756	2.21	42.2234	295.8	3.258	3.253	5.773	4.495	1.238	2.866	1.628	3.630
0:10:03	310.8	0.116	72.8	5.750	2.31	42.2674	297.6	3.274	3.268	5.788	4.507	1.236	2.871	1.636	3.648
0:10:28	311.9	0.122	72.8	5.744	2.41	42.3109	298.7	3.283	3.277	5.797	4.517	1.236	2.876	1.640	3.654
0:10:53	313.0	0.128	72.8	5.738	2.51	42.3548	299.7	3.290	3.284	5.804	4.526	1.238	2.882	1.644	3.656
0:11:17	314.5	0.134	72.8	5.732	2.61	42.4005	301.2	3.304	3.297	5.817	4.538	1.237	2.888	1.650	3.668
0:11:41	316.2	0.140	72.8	5.726	2.71	42.4415	303.0	3.319	3.313	5.833	4.553	1.236	2.895	1.658	3.683
0:12:06	317.2	0.146	72.8	5.720	2.81	42.4853	304.0	3.327	3.320	5.840	4.563	1.239	2.901	1.662	3.682
0:12:30	318.3	0.151	72.8	5.714	2.91	42.5291	305.1	3.336	3.329	5.849	4.574	1.242	2.908	1.666	3.684
0:12:55	320.3	0.156	72.8	5.708	3.01	42.5745	307.1	3.354	3.347	5.867	4.592	1.242	2.917	1.675	3.698
0:13:20	321.7	0.163	72.7	5.703	3.11	42.6167	308.5	3.366	3.358	5.878	4.604	1.242	2.923	1.681	3.706
0:13:44	322.8	0.169	72.7	5.697	3.21	42.6612	309.5	3.374	3.366	5.886	4.614	1.244	2.929	1.685	3.708
0:14:08	324.4	0.175	72.7	5.691	3.31	42.7050	311.2	3.388	3.380	5.900	4.631	1.247	2.939	1.692	3.713
0:14:34	325.9	0.181	72.6	5.685	3.41	42.7509	312.7	3.401	3.393	5.913	4.646	1.250	2.948	1.698	3.718
0:14:58	327.4	0.187	72.6	5.679	3.51	42.7949	314.1	3.413	3.405	5.925	4.660	1.252	2.956	1.704	3.723
0:15:22	328.4	0.193	72.6	5.673	3.61	42.8386	315.2	3.421	3.413	5.933	4.672	1.256	2.964	1.708	3.720
0:15:46	330.3	0.199	72.5	5.667	3.71	42.8835	317.1	3.438	3.429	5.949	4.692	1.259	2.975	1.717	3.727
0:16:11	332.2	0.205	72.5	5.661	3.81	42.9286	319.0	3.455	3.446	5.966	4.710	1.260	2.985	1.725	3.738
0:16:34	333.4	0.210	72.4	5.655	3.91	42.9730	320.2	3.465	3.455	5.975	4.723	1.264	2.993	1.729	3.737
0:16:58	334.8	0.216	72.4	5.649	4.01	43.0176	321.5	3.476	3.466	5.986	4.738	1.268	3.003	1.735	3.736
0:17:21	336.6	0.222	72.3	5.643	4.11	43.0629	323.3	3.491	3.481	6.001	4.757	1.272	3.015	1.743	3.740
0:17:46	338.1	0.228	72.3	5.637	4.22	43.1091	324.8	3.504	3.494	6.014	4.775	1.278	3.026	1.749	3.737
0:18:10	339.2	0.234	72.1	5.632	4.32	43.1541	325.9	3.512	3.501	6.021	4.792	1.287	3.040	1.753	3.724
0:18:32	341.0	0.240	72.1	5.626	4.41	43.1975	327.8	3.528	3.517	6.037	4.813	1.292	3.053	1.761	3.725
0:18:56	342.4	0.246	72.0	5.620	4.51	43.2441	329.2	3.540	3.529	6.049	4.828	1.295	3.062	1.766	3.727
0:19:20	343.4	0.252	72.1	5.614	4.61	43.2884	330.2	3.547	3.536	6.056	4.829	1.289	3.059	1.770	3.745
0:19:43	345.5	0.258	72.1	5.608	4.71	43.3344	332.2	3.565	3.553	6.073	4.847	1.289	3.068	1.779	3.759
0:20:08	347.2	0.264	72.1	5.602	4.82	43.3818	334.0	3.580	3.568	6.088	4.863	1.292	3.078	1.786	3.765
0:20:31	348.1	0.269	72.0	5.596	4.91	43.4256	334.8	3.585	3.574	6.094	4.873	1.296	3.085	1.789	3.760
0:20:56	349.8	0.275	71.9	5.590	5.02	43.4728	336.5	3.600	3.587	6.107	4.892	1.301	3.097	1.796	3.760
0:21:20	351.6	0.281	71.9	5.585	5.11	43.5175	338.4	3.616	3.604	6.124	4.911	1.303	3.107	1.804	3.768
0:21:45	353.0	0.287	71.8	5.578	5.22	43.5648	339.8	3.627	3.614	6.134	4.926	1.309	3.118	1.809	3.764
0:22:10	354.6	0.293	71.7	5.573	5.32	43.6109	341.4	3.640	3.627	6.147	4.946	1.315	3.130	1.815	3.762
0:22:34	356.0	0.299	71.6	5.567	5.42	43.6566	342.7	3.651	3.637	6.157	4.963	1.322	3.143	1.821	3.754
0:22:58	358.0	0.305	71.6	5.561	5.52	43.7027	344.7	3.668	3.654	6.174	4.984	1.326	3.155	1.829	3.758
0:23:23	358.9	0.311	71.5	5.555	5.62	43.7492	345.6	3.674	3.660	6.180	4.999	1.335	3.167	1.832	3.745
0:23:46	360.5	0.317	71.4	5.549	5.72	43.7952	347.3	3.687	3.673	6.193	5.018	1.341	3.179	1.839	3.743
0:24:11	362.5	0.323	71.3	5.543	5.82	43.8422	349.2	3.704	3.690	6.210	5.040	1.346	3.193	1.847	3.744
0:24:37	364.2	0.329	71.2	5.537	5.92	43.8894	351.0	3.718	3.704	6.224	5.058	1.351	3.204	1.854	3.745

**Consolidated Undrained Triaxial Test  
EM 1110-2-1906 Appendix X**

Consolidation Values			Final Values			Tested By <u>KDG</u>		Project Number <u>175569069</u>	
Height	<u>5.886 (in.)</u>	<u>14.949 (cm)</u>	Height	<u>4.800 (in.)</u>	Date	<u>12-11-09</u>	Test Number	<u>CU-3B</u>	
Diameter	<u>2.855 (in.)</u>	<u>7.251 (cm)</u>	Dia. avg.	<u>3.260 (in.)</u>	Press No.	<u>1</u>	Data File ID	<u>3B</u>	
Area	<u>6.400 (in<sup>2</sup>)</u>	<u>41.292 (cm<sup>2</sup>)</u>	Area avg.	<u>8.347 (in<sup>2</sup>)</u>	Panel No.	<u>C</u>	Lateral Pressure (psi)	<u>35.0</u>	
							Chamber Pressure - $\sigma_3$ (psi)	<u>90</u>	

Clock Time (min.)	Load (lbf)	Deflection Dial Reading (in.)	Pore Pressure Reading (psi)	Corrected Height (in.)	Strain (%)	Corrected Area (cm <sup>2</sup> )	Corrected Load (lbf)	Deviator Stress (tsf)	Corrected Deviator Stress* (tsf)	$\sigma_1$ (tsf)	$\sigma_1'$ (tsf)	$\sigma_3'$ (tsf)	$p'$ ( $(\sigma_1' + \sigma_3')/2$ ) (tsf)	$q$ ( $(\sigma_1 - \sigma_3)/2$ ) (tsf)	Effective Principal
															Stress Ratio $\sigma_1' / \sigma_3'$
0:25:01	365.6	0.334	71.2	5.531	6.02	43.9361	352.3	3.729	3.714	6.234	5.075	1.357	3.216	1.859	3.740
0:25:25	367.1	0.340	71.1	5.526	6.12	43.9814	353.9	3.742	3.727	6.247	5.094	1.364	3.229	1.865	3.735
0:25:50	368.6	0.346	71.0	5.520	6.22	44.0289	355.4	3.753	3.738	6.258	5.112	1.370	3.241	1.871	3.732
0:26:14	370.3	0.352	70.9	5.514	6.32	44.0762	357.1	3.767	3.752	6.272	5.130	1.375	3.253	1.878	3.731
0:26:39	371.5	0.358	70.8	5.508	6.42	44.1253	358.2	3.775	3.759	6.279	5.148	1.385	3.266	1.882	3.718
0:27:02	373.3	0.364	70.7	5.502	6.52	44.1716	360.0	3.790	3.774	6.294	5.167	1.389	3.278	1.889	3.720
0:27:27	374.9	0.370	70.6	5.496	6.62	44.2189	361.7	3.804	3.788	6.308	5.185	1.394	3.290	1.896	3.720
0:27:50	376.2	0.376	70.6	5.490	6.72	44.2650	363.0	3.813	3.797	6.317	5.200	1.400	3.300	1.900	3.715
0:28:15	377.6	0.381	70.4	5.484	6.82	44.3129	364.4	3.824	3.807	6.327	5.219	1.408	3.314	1.906	3.706
0:28:40	379.5	0.387	70.4	5.478	6.92	44.3606	366.3	3.840	3.823	6.343	5.240	1.414	3.327	1.913	3.707
0:29:04	380.8	0.393	70.3	5.472	7.02	44.4092	367.6	3.849	3.832	6.352	5.256	1.420	3.338	1.918	3.702
0:29:29	381.9	0.399	70.2	5.467	7.12	44.4564	368.7	3.856	3.839	6.359	5.272	1.429	3.350	1.921	3.689
0:29:54	383.9	0.405	70.0	5.461	7.22	44.5056	370.6	3.872	3.855	6.375	5.298	1.440	3.369	1.929	3.680
0:30:18	385.6	0.411	70.0	5.455	7.32	44.5522	372.3	3.886	3.868	6.388	5.314	1.442	3.378	1.936	3.685
0:30:43	387.0	0.417	69.8	5.449	7.42	44.6006	373.7	3.897	3.879	6.399	5.333	1.451	3.392	1.941	3.675
0:31:08	388.0	0.423	69.7	5.443	7.52	44.6489	374.7	3.903	3.885	6.405	5.351	1.463	3.407	1.944	3.658
0:31:32	390.1	0.429	69.7	5.437	7.62	44.6972	376.8	3.920	3.902	6.422	5.369	1.464	3.417	1.953	3.668
0:31:57	391.7	0.435	69.7	5.431	7.72	44.7457	378.5	3.933	3.914	6.434	5.378	1.460	3.419	1.959	3.683
0:32:22	392.8	0.441	69.7	5.425	7.82	44.7963	379.5	3.940	3.921	6.441	5.388	1.464	3.426	1.962	3.681
0:32:45	394.4	0.446	69.6	5.419	7.92	44.8442	381.1	3.952	3.933	6.453	5.406	1.470	3.438	1.968	3.679
0:33:10	396.1	0.452	69.5	5.413	8.02	44.8934	382.9	3.966	3.947	6.467	5.426	1.475	3.451	1.975	3.677
0:33:33	397.5	0.458	69.5	5.408	8.12	44.9422	384.2	3.975	3.956	6.476	5.439	1.480	3.459	1.980	3.676
0:33:57	398.4	0.464	69.3	5.402	8.22	44.9914	385.2	3.981	3.961	6.481	5.452	1.487	3.469	1.982	3.667
0:34:20	400.2	0.470	69.3	5.396	8.32	45.0399	387.0	3.996	3.975	6.495	5.469	1.490	3.480	1.990	3.670
0:34:45	401.7	0.476	69.2	5.390	8.42	45.0898	388.4	4.006	3.985	6.505	5.487	1.498	3.493	1.995	3.663
0:35:08	402.7	0.482	69.1	5.384	8.52	45.1383	389.5	4.013	3.992	6.512	5.502	1.507	3.505	1.998	3.652
0:35:32	404.6	0.488	69.0	5.378	8.62	45.1886	391.3	4.027	4.006	6.526	5.523	1.513	3.518	2.005	3.650
0:35:56	406.4	0.494	68.9	5.372	8.73	45.2393	393.1	4.041	4.020	6.540	5.541	1.518	3.530	2.012	3.651
0:36:20	407.3	0.500	68.8	5.366	8.82	45.2883	394.0	4.046	4.024	6.544	5.554	1.526	3.540	2.014	3.640
0:36:43	408.7	0.505	68.7	5.360	8.92	45.3377	395.4	4.056	4.034	6.554	5.570	1.532	3.551	2.019	3.636
0:37:08	410.4	0.512	68.6	5.354	9.03	45.3892	397.2	4.069	4.047	6.567	5.589	1.538	3.563	2.025	3.634
0:37:31	411.6	0.517	68.5	5.349	9.12	45.4378	398.3	4.076	4.054	6.574	5.603	1.545	3.574	2.029	3.627
0:37:55	412.4	0.523	68.4	5.343	9.22	45.4869	399.2	4.080	4.058	6.578	5.615	1.554	3.585	2.031	3.614
0:38:19	414.3	0.529	68.4	5.337	9.33	45.5395	401.1	4.095	4.073	6.593	5.634	1.558	3.596	2.038	3.616
0:38:43	415.7	0.535	68.3	5.331	9.42	45.5880	402.5	4.105	4.082	6.602	5.650	1.564	3.607	2.043	3.612
0:39:07	418.9	0.541	68.2	5.325	9.52	45.6385	403.7	4.113	4.090	6.610	5.664	1.570	3.617	2.047	3.607
0:39:32	418.0	0.547	68.1	5.319	9.63	45.6915	404.8	4.119	4.096	6.616	5.678	1.579	3.628	2.050	3.597
0:39:56	419.7	0.553	68.0	5.313	9.73	45.7403	406.4	4.132	4.108	6.628	5.694	1.582	3.638	2.056	3.599
0:40:20	420.7	0.559	67.9	5.307	9.83	45.7910	407.5	4.138	4.114	6.634	5.707	1.589	3.648	2.059	3.591
0:40:45	422.1	0.565	67.8	5.301	9.93	45.8434	408.8	4.147	4.123	6.643	5.724	1.597	3.660	2.063	3.584
0:41:08	423.6	0.570	67.7	5.295	10.03	45.8938	410.4	4.158	4.134	6.654	5.740	1.603	3.671	2.069	3.581
0:41:33	424.7	0.576	67.7	5.290	10.13	45.9438	411.5	4.165	4.140	6.660	5.753	1.609	3.681	2.072	3.576
0:41:58	426.0	0.582	67.6	5.284	10.23	45.9951	412.8	4.173	4.149	6.669	5.768	1.615	3.691	2.076	3.570
0:42:22	427.2	0.588	67.5	5.278	10.33	46.0468	414.0	4.181	4.156	6.676	5.783	1.623	3.703	2.080	3.562
0:42:47	428.9	0.594	67.4	5.272	10.43	46.0998	415.7	4.193	4.167	6.687	5.801	1.630	3.715	2.086	3.559
0:43:12	430.1	0.600	67.2	5.266	10.53	46.1513	416.9	4.200	4.175	6.695	5.817	1.639	3.728	2.089	3.549
0:43:36	431.2	0.606	67.1	5.260	10.63	46.2036	417.9	4.206	4.181	6.701	5.834	1.649	3.741	2.092	3.537
0:44:00	432.9	0.612	67.0	5.254	10.73	46.2555	419.7	4.219	4.193	6.713	5.855	1.658	3.756	2.098	3.532
0:44:25	434.2	0.618	67.0	5.248	10.83	46.3075	421.0	4.227	4.201	6.721	5.857	1.653	3.755	2.102	3.544
0:44:48	435.3	0.623	67.0	5.242	10.93	46.3581	422.1	4.234	4.207	6.727	5.865	1.654	3.760	2.105	3.545
0:45:13	436.4	0.629	67.0	5.236	11.03	46.4111	423.1	4.239	4.213	6.733	5.876	1.659	3.768	2.108	3.541
0:45:37	437.6	0.635	66.9	5.230	11.13	46.4642	424.3	4.247	4.220	6.740	5.886	1.663	3.774	2.112	3.540
0:46:01	438.9	0.641	66.9	5.225	11.23	46.5144	425.7	4.255	4.228	6.748	5.898	1.667	3.783	2.116	3.539
0:46:26	439.9	0.647	66.8	5.219	11.33	46.5675	426.6	4.260	4.233	6.753	5.910	1.674	3.792	2.118	3.531
0:46:51	441.3	0.653	66.7	5.213	11.43	46.6205	428.1	4.270	4.242	6.762	5.925	1.679	3.802	2.123	3.529
0:47:15	442.7	0.659	66.6	5.207	11.53	46.6730	429.5	4.279	4.251	6.771	5.939	1.684	3.811	2.127	3.527
0:47:41	443.9	0.665	66.5	5.201	11.63	46.7264	430.7	4.286	4.258	6.778	5.953	1.692	3.822	2.131	3.519
0:48:05	444.6	0.671	66.4	5.195	11.73	46.7798	431.3	4.287	4.259	6.779	5.964	1.701	3.832	2.131	3.506
0:48:29	446.3	0.676	66.3	5.189	11.83	46.8318	433.1	4.300	4.271	6.791	5.980	1.705	3.842	2.137	3.508
0:48:53	447.7	0.682	66.3	5.183	11.93	46.8853	434.4	4.309	4.280	6.800	5.992	1.709	3.851	2.142	3.506

# Consolidated Undrained Triaxial Test EM 1110-2-1906 Appendix X

Consolidation Values			Final Values			Tested By <u>KDG</u>		Project Number <u>175569069</u>	
Height	<u>5.886 (in.)</u>	<u>14.949 (cm)</u>	Height	<u>4.800 (in.)</u>		Date	<u>12-11-09</u>	Test Number	<u>CU-3B</u>
Diameter	<u>2.855 (in)</u>	<u>7.251 (cm)</u>	Dia. avg.	<u>3.260 (in)</u>		Press No.	<u>1</u>	Data File ID	<u>3B</u>
Area	<u>6.400 (in<sup>2</sup>)</u>	<u>41.292 (cm<sup>2</sup>)</u>	Area avg.	<u>8.347 (in<sup>2</sup>)</u>		Panel No.	<u>C</u>	Lateral Pressure (psi)	<u>35.0</u>
								Chamber Pressure - $\sigma_3$ (psi)	<u>90</u>

Clock Time (min.)	Load (lbf)	Deflection Dial Reading (in.)	Pore Pressure Reading (psi)	Corrected Height (in.)	Strain (%)	Corrected Area (cm <sup>2</sup> )	Corrected Load (lbf)	Corrected Deviator Stress (tsf)	Corrected Deviator Stress* (tsf)	$\sigma_1$ (tsf)	$\sigma_1'$ (tsf)	$\sigma_3'$ (tsf)	$p'$ ( $\sigma_1' + \sigma_3'$ )/2 (tsf)	$q$ ( $\sigma_1 - \sigma_3$ )/2 (tsf)	Effective
															Principal Stress Ratio $\sigma_1' / \sigma_3'$
0:49:18	448.1	0.688	66.2	5.177	12.03	46.9404	434.8	4.308	4.278	6.798	5.999	1.717	3.858	2.141	3.494
0:49:41	449.5	0.694	66.1	5.172	12.13	46.9927	436.3	4.317	4.288	6.808	6.014	1.723	3.869	2.146	3.491
0:50:06	451.0	0.700	66.0	5.165	12.24	47.0492	437.7	4.326	4.297	6.817	6.027	1.727	3.877	2.150	3.490
0:50:30	452.2	0.706	65.9	5.160	12.34	47.1019	438.9	4.333	4.303	6.823	6.040	1.733	3.886	2.153	3.485
0:50:53	452.6	0.712	65.8	5.154	12.44	47.1557	439.4	4.333	4.303	6.823	6.047	1.741	3.894	2.153	3.474
0:51:17	454.3	0.718	65.8	5.148	12.53	47.2095	441.0	4.344	4.314	6.834	6.062	1.745	3.904	2.159	3.474
0:51:40	455.2	0.724	65.7	5.142	12.63	47.2632	441.9	4.348	4.317	6.837	6.072	1.751	3.911	2.160	3.468
0:52:03	455.8	0.730	65.6	5.136	12.74	47.3182	442.5	4.349	4.318	6.838	6.079	1.757	3.918	2.161	3.460
0:52:27	457.4	0.736	65.5	5.130	12.84	47.3728	444.2	4.360	4.329	6.849	6.094	1.762	3.928	2.166	3.459
0:52:49	458.5	0.741	65.5	5.124	12.93	47.4251	445.2	4.366	4.334	6.854	6.104	1.766	3.935	2.169	3.456
0:53:12	459.3	0.747	65.4	5.118	13.03	47.4805	446.1	4.368	4.337	6.857	6.113	1.772	3.943	2.170	3.449
0:53:36	460.5	0.753	65.3	5.112	13.14	47.5358	447.2	4.375	4.343	6.863	6.124	1.777	3.950	2.173	3.446
0:53:59	461.7	0.759	65.3	5.107	13.23	47.5890	448.5	4.382	4.350	6.870	6.135	1.781	3.958	2.177	3.444
0:54:24	462.6	0.765	65.2	5.101	13.34	47.6454	449.3	4.385	4.353	6.873	6.144	1.788	3.966	2.178	3.437
0:54:47	463.1	0.771	65.1	5.095	13.43	47.7003	449.9	4.386	4.353	6.873	6.153	1.796	3.974	2.178	3.426
0:55:12	465.0	0.777	65.0	5.089	13.54	47.7574	451.8	4.399	4.366	6.886	6.168	1.799	3.983	2.185	3.429
0:55:35	465.4	0.783	64.9	5.083	13.63	47.8106	452.2	4.398	4.365	6.885	6.175	1.806	3.990	2.184	3.419
0:56:00	466.4	0.789	64.8	5.077	13.74	47.8678	453.2	4.402	4.369	6.889	6.187	1.814	4.000	2.186	3.410
0:56:24	467.7	0.795	64.7	5.071	13.84	47.9225	454.5	4.410	4.377	6.897	6.203	1.823	4.013	2.190	3.403
0:56:48	469.0	0.801	64.6	5.065	13.94	47.9800	455.7	4.417	4.383	6.903	6.215	1.828	4.021	2.193	3.400
0:57:12	469.5	0.806	64.7	5.059	14.04	48.0337	456.2	4.417	4.383	6.903	6.208	1.821	4.014	2.193	3.408
0:57:36	470.4	0.812	64.6	5.054	14.14	48.0904	457.2	4.421	4.386	6.906	6.216	1.825	4.021	2.195	3.405
0:58:01	472.1	0.818	64.6	5.047	14.24	48.1477	458.9	4.432	4.397	6.917	6.227	1.826	4.026	2.200	3.411
0:58:26	472.8	0.824	64.6	5.042	14.34	48.2045	459.6	4.433	4.399	6.919	6.231	1.829	4.030	2.201	3.407
0:58:49	473.3	0.830	64.5	5.036	14.44	48.2588	460.1	4.433	4.398	6.918	6.236	1.835	4.036	2.201	3.399
0:59:14	474.6	0.836	64.5	5.030	14.54	48.3166	461.3	4.440	4.405	6.925	6.247	1.839	4.043	2.204	3.397
0:59:38	475.8	0.842	64.4	5.024	14.64	48.3740	462.6	4.447	4.411	6.931	6.256	1.841	4.049	2.207	3.398
1:00:03	476.3	0.848	64.3	5.018	14.74	48.4319	463.1	4.446	4.411	6.931	6.263	1.849	4.056	2.207	3.388
1:00:25	477.4	0.853	64.2	5.012	14.84	48.4853	464.1	4.451	4.415	6.935	6.274	1.855	4.065	2.210	3.382
1:00:50	478.9	0.860	64.2	5.006	14.94	48.5442	465.6	4.460	4.424	6.944	6.286	1.859	4.073	2.214	3.382
1:01:14	479.5	0.866	64.1	5.000	15.04	48.6026	466.2	4.461	4.424	6.944	6.292	1.864	4.078	2.214	3.376
1:01:38	479.8	0.871	64.0	4.995	15.14	48.6576	466.5	4.459	4.422	6.942	6.296	1.870	4.083	2.213	3.366
1:02:02	481.2	0.877	64.0	4.989	15.24	48.7170	468.0	4.467	4.430	6.950	6.308	1.874	4.091	2.217	3.366
1:02:27	482.1	0.883	63.9	4.983	15.34	48.7748	468.8	4.470	4.433	6.953	6.314	1.878	4.096	2.218	3.362
1:02:52	482.8	0.889	63.9	4.977	15.44	48.8324	469.6	4.472	4.434	6.954	6.320	1.882	4.101	2.219	3.358
1:03:16	483.7	0.895	63.8	4.971	15.54	48.8902	470.4	4.474	4.437	6.957	6.330	1.890	4.110	2.220	3.349
1:03:41	485.0	0.901	63.7	4.965	15.64	48.9476	471.8	4.482	4.444	6.964	6.340	1.892	4.116	2.224	3.351
1:04:06	485.7	0.907	63.7	4.959	15.74	49.0049	472.4	4.483	4.445	6.965	6.345	1.896	4.121	2.224	3.346
1:04:32	486.6	0.913	63.6	4.953	15.84	49.0657	473.4	4.486	4.448	6.968	6.353	1.901	4.127	2.226	3.342
1:04:55	487.3	0.918	63.5	4.947	15.94	49.1229	474.0	4.487	4.449	6.969	6.360	1.908	4.134	2.226	3.333
1:05:20	488.4	0.925	63.5	4.941	16.04	49.1828	475.2	4.493	4.454	6.974	6.367	1.910	4.139	2.229	3.334
1:05:43	488.9	0.930	63.4	4.935	16.14	49.2403	475.6	4.492	4.453	6.973	6.371	1.914	4.143	2.228	3.328
1:06:08	489.2	0.936	63.3	4.930	16.24	49.2999	476.0	4.490	4.450	6.970	6.375	1.921	4.148	2.227	3.319
1:06:31	490.8	0.942	63.3	4.924	16.34	49.3578	477.6	4.500	4.460	6.980	6.387	1.924	4.156	2.232	3.320
1:06:56	491.7	0.948	63.2	4.918	16.44	49.4187	478.5	4.502	4.462	6.982	6.392	1.926	4.159	2.233	3.319
1:07:19	492.2	0.954	63.2	4.912	16.54	49.4767	478.9	4.501	4.461	6.981	6.396	1.932	4.164	2.232	3.311
1:07:43	493.2	0.960	63.1	4.906	16.64	49.5368	479.9	4.505	4.465	6.985	6.405	1.937	4.171	2.234	3.307
1:08:07	494.1	0.966	63.0	4.900	16.74	49.5959	480.9	4.509	4.468	6.988	6.413	1.941	4.177	2.236	3.304
1:08:30	494.6	0.972	63.0	4.894	16.84	49.6550	481.4	4.508	4.467	6.987	6.417	1.946	4.181	2.235	3.297
1:08:53	495.3	0.978	62.9	4.888	16.95	49.7166	482.0	4.509	4.468	6.988	6.425	1.954	4.189	2.236	3.289
1:09:16	496.5	0.983	62.8	4.883	17.04	49.7747	483.3	4.515	4.474	6.994	6.437	1.959	4.198	2.239	3.285
1:09:40	497.2	0.989	62.8	4.876	17.15	49.8379	484.0	4.516	4.474	6.994	6.439	1.961	4.200	2.239	3.284
1:10:02	497.6	0.995	62.8	4.871	17.24	49.8950	484.4	4.514	4.473	6.993	6.433	1.957	4.195	2.238	3.287
1:10:26	498.9	1.001	62.8	4.865	17.35	49.9573	485.6	4.520	4.478	6.998	6.438	1.956	4.197	2.241	3.291
1:10:49	499.4	1.007	62.8	4.859	17.44	50.0162	486.2	4.520	4.478	6.998	6.439	1.957	4.198	2.241	3.290
1:11:14	499.9	1.013	62.8	4.853	17.55	50.0790	486.7	4.519	4.476	6.996	6.442	1.962	4.202	2.240	3.284
1:11:37	500.9	1.019	62.7	4.847	17.65	50.1401	487.7	4.523	4.480	7.000	6.448	1.964	4.206	2.242	3.283
1:12:01	501.8	1.025	62.7	4.841	17.74	50.1998	488.5	4.525	4.482	7.002	6.452	1.966	4.209	2.243	3.282
1:12:25	502.3	1.031	62.6	4.835	17.85	50.2629	489.1	4.524	4.481	7.001	6.454	1.969	4.212	2.242	3.277
1:12:49	503.1	1.037	62.6	4.829	17.95	50.3244	489.8	4.526	4.483	7.003	6.462	1.976	4.219	2.243	3.271



## Consolidated Undrained Triaxial Test EM 1110-2-1906 Appendix X

Consolidation Values		
Height	5.886 (in.)	14.949 (cm)
Diameter	2.855 (in.)	7.251 (cm)
Area	6.400 (in <sup>2</sup> )	41.292 (cm <sup>2</sup> )

Final Values	
Height	4.800 (in.)
Dia. avg.	3.260 (in)
Area avg.	8.347 (in <sup>2</sup> )

Tested By	KDG
Date	12-11-09
Press No.	1
Panel No.	C

Project Number	175569069
Test Number	CU-3B
Data File ID	3B
Lateral Pressure (psi)	35.0
Chamber Pressure - $\sigma_3$ (psi)	90

Clock Time (min.)	Load (lbf)	Deflection Dial Reading (in.)	Pore Pressure Reading (psi)	Corrected Height (in.)	Strain (%)	Corrected Area (cm <sup>2</sup> )	Corrected Load (lbf)	Deviator Stress (tsf)	Corrected Deviator Stress* (tsf)	$\sigma_1$ (tsf)	$\sigma_1'$ (tsf)	$\sigma_3'$ (tsf)	$p'$ ( $(\sigma_1' + \sigma_3')/2$ ) (tsf)	$q$ ( $(\sigma_1 - \sigma_3)/2$ ) (tsf)	Effective
															Principal Stress Ratio $\sigma_1' / \sigma_3'$
1:13:13	504.0	1.043	62.5	4.823	18.05	50.3864	490.8	4.529	4.486	7.006	6.468	1.979	4.223	2.245	3.269
1:13:37	504.7	1.048	62.5	4.818	18.15	50.4460	491.5	4.530	4.486	7.006	6.471	1.981	4.226	2.245	3.267
1:14:00	505.0	1.054	62.4	4.812	18.25	50.5073	491.7	4.527	4.483	7.003	6.475	1.988	4.231	2.243	3.257
1:14:25	505.9	1.060	62.3	4.806	18.35	50.5707	492.6	4.530	4.485	7.005	6.480	1.991	4.236	2.244	3.254
1:14:49	506.3	1.066	62.3	4.800	18.45	50.6329	493.1	4.529	4.484	7.004	6.484	1.996	4.240	2.244	3.248

# Consolidated Undrained Triaxial Test EM 1110-2-1906 Appendix X

Consolidation Values			Final Values			Tested By <u>KDG</u>	Project Number <u>175569069</u>
Height	<u>5.925 (in.)</u>	<u>15.049 (cm)</u>	Height	<u>4.835 (in.)</u>		Date <u>12-14-09</u>	Test Number <u>CU-3C</u>
Diameter	<u>2.851 (in)</u>	<u>7.243 (cm)</u>	Dia. avg.	<u>3.272 (in)</u>		Press No. <u>1</u>	Data File ID <u>3C</u>
Area	<u>6.386 (in<sup>2</sup>)</u>	<u>41.199 (cm<sup>2</sup>)</u>	Area avg.	<u>8.408 (in<sup>2</sup>)</u>		Panel No. <u>A</u>	Lateral Pressure (psi) <u>45.0</u>
							Chamber Pressure - $\sigma_3$ (psi) <u>90</u>

Clock Time (min.)	Load (lbf)	Deflection Dial Reading (in.)	Pore Pressure Reading (psi)	Corrected Height (in.)	Strain (%)	Corrected Area (cm <sup>2</sup> )	Corrected Load (lbf)	Deviator Stress (tsf)	Corrected Deviator Stress* (tsf)	$\sigma_1$ (tsf)	$\sigma_1'$ (tsf)	$\sigma_3'$ (tsf)	$p'$ ( $(\sigma_1 + \sigma_3)/2$ ) (tsf)	$q$ ( $(\sigma_1 - \sigma_3)/2$ ) (tsf)	Effective Principal Stress Ratio $\sigma_1' / \sigma_3'$
0:00:00	13.2	-0.021	45.1	5.925	0.00	41.1992	0.0	0.000	0.000	3.240	3.240	3.236	3.238	0.002	1.001
0:00:57	17.3	-0.015	45.2	5.919	0.11	41.2431	4.1	0.046	0.046	3.286	3.276	3.226	3.251	0.025	1.016
0:02:47	92.5	-0.009	52.0	5.913	0.20	41.2823	79.4	0.894	0.893	4.133	3.632	2.734	3.183	0.449	1.328
0:04:16	139.8	-0.004	57.1	5.907	0.30	41.3233	126.6	1.424	1.424	4.664	3.797	2.369	3.083	0.714	1.603
0:05:40	169.9	0.003	60.7	5.901	0.40	41.3659	156.7	1.762	1.761	5.001	3.876	2.111	2.993	0.882	1.836
0:06:53	190.1	0.008	63.1	5.895	0.50	41.4062	176.9	1.986	1.985	5.225	3.924	1.935	2.930	0.995	2.028
0:08:05	205.2	0.014	65.1	5.889	0.60	41.4488	192.0	2.154	2.152	5.392	3.953	1.796	2.875	1.078	2.201
0:09:18	217.1	0.020	66.4	5.883	0.70	41.4902	203.9	2.286	2.284	5.524	3.987	1.698	2.842	1.144	2.347
0:10:26	226.3	0.026	67.5	5.878	0.80	41.5313	213.1	2.386	2.384	5.624	4.012	1.623	2.817	1.194	2.471
0:11:35	233.5	0.032	68.1	5.871	0.90	41.5740	220.3	2.464	2.462	5.702	4.041	1.575	2.808	1.233	2.566
0:12:47	240.1	0.038	68.6	5.865	1.00	41.6165	226.9	2.536	2.533	5.773	4.080	1.543	2.812	1.269	2.645
0:13:55	245.4	0.044	70.1	5.860	1.10	41.6587	232.2	2.592	2.589	5.829	4.026	1.433	2.729	1.297	2.810
0:15:05	249.5	0.050	70.7	5.854	1.20	41.7000	236.4	2.636	2.633	5.873	4.025	1.389	2.707	1.318	2.899
0:16:14	253.8	0.056	71.1	5.848	1.30	41.7414	240.6	2.680	2.677	5.917	4.045	1.364	2.704	1.341	2.967
0:17:22	256.5	0.062	71.3	5.842	1.40	41.7854	243.4	2.708	2.705	5.945	4.057	1.348	2.703	1.354	3.009
0:18:34	259.1	0.068	71.5	5.836	1.50	41.8285	245.9	2.733	2.730	5.970	4.069	1.335	2.702	1.367	3.049
0:19:38	260.9	0.073	71.7	5.830	1.60	41.8688	247.7	2.751	2.747	5.987	4.069	1.317	2.693	1.376	3.089
0:20:46	263.2	0.079	71.9	5.824	1.70	41.9111	250.0	2.774	2.770	6.010	4.077	1.303	2.690	1.387	3.129
0:21:55	265.3	0.085	72.0	5.818	1.80	41.9543	252.2	2.795	2.790	6.030	4.093	1.298	2.695	1.397	3.153
0:23:00	266.8	0.091	72.1	5.812	1.90	41.9979	253.6	2.808	2.803	6.043	4.100	1.292	2.696	1.404	3.172
0:24:04	268.7	0.097	72.2	5.806	2.00	42.0395	255.5	2.826	2.821	6.061	4.108	1.283	2.696	1.413	3.203
0:25:15	270.6	0.103	72.2	5.800	2.10	42.0834	257.5	2.845	2.840	6.080	4.128	1.284	2.706	1.422	3.214
0:26:20	272.0	0.109	72.0	5.795	2.20	42.1258	258.8	2.856	2.851	6.091	4.149	1.293	2.721	1.428	3.208
0:27:24	273.6	0.115	72.5	5.789	2.30	42.1685	260.4	2.872	2.866	6.106	4.130	1.259	2.694	1.435	3.280
0:28:32	275.5	0.121	72.9	5.783	2.40	42.2124	262.3	2.889	2.883	6.123	4.116	1.229	2.672	1.444	3.350
0:29:37	276.9	0.127	73.1	5.777	2.50	42.2561	263.7	2.902	2.896	6.136	4.117	1.217	2.667	1.450	3.384
0:30:45	278.4	0.133	73.0	5.771	2.60	42.2990	265.2	2.915	2.909	6.149	4.137	1.224	2.681	1.457	3.380
0:31:52	280.0	0.139	72.9	5.765	2.70	42.3425	266.9	2.931	2.924	6.164	4.157	1.229	2.693	1.464	3.382
0:32:57	281.7	0.144	73.0	5.759	2.80	42.3851	268.5	2.945	2.939	6.179	4.164	1.221	2.692	1.471	3.410
0:34:04	283.0	0.150	73.0	5.753	2.90	42.4289	269.9	2.957	2.950	6.190	4.180	1.225	2.702	1.477	3.412
0:35:11	284.4	0.156	72.9	5.747	3.00	42.4730	271.2	2.969	2.962	6.202	4.199	1.232	2.716	1.483	3.407
0:36:18	286.2	0.162	72.9	5.741	3.10	42.5168	273.0	2.986	2.979	6.219	4.217	1.234	2.725	1.491	3.417
0:37:25	287.7	0.168	72.8	5.735	3.20	42.5614	274.5	2.999	2.991	6.231	4.231	1.235	2.733	1.498	3.425
0:38:32	288.6	0.174	72.7	5.730	3.30	42.6042	275.4	3.006	2.998	6.238	4.245	1.243	2.744	1.501	3.415
0:39:43	290.5	0.180	72.7	5.723	3.40	42.6495	277.3	3.024	3.016	6.256	4.268	1.248	2.758	1.510	3.420
0:40:52	291.9	0.186	72.3	5.718	3.50	42.6928	278.7	3.036	3.027	6.267	4.303	1.272	2.787	1.516	3.384
0:42:01	293.4	0.192	72.9	5.712	3.60	42.7374	280.3	3.049	3.041	6.281	4.277	1.232	2.755	1.522	3.471
0:43:10	295.2	0.198	73.1	5.706	3.70	42.7818	282.0	3.065	3.057	6.297	4.275	1.214	2.745	1.530	3.520
0:44:18	297.1	0.204	73.2	5.700	3.80	42.8263	283.9	3.082	3.073	6.313	4.286	1.209	2.748	1.539	3.546
0:45:27	298.8	0.210	73.0	5.694	3.90	42.8703	285.6	3.098	3.089	6.329	4.314	1.221	2.767	1.546	3.533
0:46:34	300.0	0.215	72.9	5.688	4.00	42.9145	286.8	3.108	3.098	6.338	4.330	1.228	2.779	1.551	3.527
0:47:42	301.4	0.221	72.8	5.682	4.10	42.9595	288.2	3.120	3.110	6.350	4.351	1.237	2.794	1.557	3.518
0:48:51	303.2	0.227	72.8	5.676	4.20	43.0041	290.0	3.136	3.126	6.366	4.370	1.240	2.805	1.565	3.524
0:49:58	304.6	0.233	72.7	5.670	4.30	43.0487	291.4	3.148	3.137	6.377	4.390	1.248	2.819	1.571	3.516
0:51:05	305.8	0.239	72.6	5.664	4.40	43.0938	292.7	3.158	3.147	6.387	4.405	1.253	2.829	1.576	3.514
0:52:15	307.3	0.245	72.5	5.658	4.50	43.1399	294.2	3.171	3.160	6.400	4.425	1.261	2.843	1.582	3.509
0:53:20	308.9	0.251	72.5	5.653	4.60	43.1841	295.7	3.184	3.173	6.413	4.438	1.261	2.850	1.589	3.520
0:54:28	310.4	0.257	72.2	5.646	4.70	43.2307	297.2	3.197	3.185	6.425	4.469	1.279	2.874	1.595	3.494
0:55:34	311.5	0.263	71.9	5.641	4.80	43.2753	298.3	3.205	3.194	6.434	4.501	1.303	2.902	1.599	3.454
0:56:41	313.4	0.269	72.2	5.635	4.90	43.3203	300.2	3.222	3.210	6.450	4.499	1.284	2.891	1.607	3.503
0:57:49	314.9	0.275	72.6	5.629	5.00	43.3666	301.7	3.235	3.223	6.463	4.479	1.252	2.865	1.614	3.579
0:58:56	316.2	0.281	72.6	5.623	5.10	43.4119	303.0	3.245	3.233	6.473	4.487	1.250	2.869	1.619	3.589
1:00:02	317.8	0.287	72.5	5.617	5.20	43.4572	304.6	3.260	3.247	6.487	4.513	1.262	2.888	1.626	3.576
1:01:10	319.5	0.293	72.4	5.611	5.30	43.5036	306.3	3.274	3.262	6.502	4.534	1.269	2.902	1.633	3.574
1:02:18	320.5	0.298	72.2	5.605	5.40	43.5492	307.4	3.282	3.269	6.509	4.552	1.279	2.916	1.637	3.559
1:03:25	322.0	0.304	72.2	5.599	5.50	43.5952	308.8	3.294	3.281	6.521	4.569	1.284	2.927	1.642	3.557
1:04:31	324.0	0.310	72.0	5.593	5.60	43.6413	310.8	3.312	3.298	6.538	4.597	1.294	2.945	1.651	3.552
1:05:39	324.9	0.316	71.9	5.587	5.70	43.6874	311.8	3.318	3.305	6.545	4.611	1.303	2.957	1.654	3.540
1:06:47	326.0	0.322	71.8	5.581	5.80	43.7342	312.8	3.326	3.312	6.552	4.628	1.311	2.970	1.658	3.529
1:07:55	327.5	0.328	71.7	5.576	5.90	43.7809	314.3	3.339	3.324	6.564	4.648	1.320	2.984	1.664	3.522

## Consolidated Undrained Triaxial Test EM 1110-2-1906 Appendix X

Consolidation Values		
Height	5.925 (in.)	15.049 (cm)
Diameter	2.851 (in)	7.243 (cm)
Area	6.386 (in <sup>2</sup> )	41.199 (cm <sup>2</sup> )

Final Values		
Height	4.835 (in.)	
Dia. avg.	3.272 (in)	
Area avg.	6.408 (in <sup>2</sup> )	

Tested By	KDG
Date	12-14-09
Press No.	1
Panel No.	A

Project Number	175569069
Test Number	CU-3C
Data File ID	3C
Lateral Pressure (psi)	45.0
Chamber Pressure - $\sigma_3$ (psi)	90

Clock Time (min.)	Load (lbf)	Deflection Dial Reading (in.)	Pore Pressure Reading (psi)	Corrected Height (in.)	Strain (%)	Corrected Area (cm <sup>2</sup> )	Corrected Load (lbf)	Deviator Stress (tsf)	Corrected Deviator Stress* (tsf)	$\sigma_1$ (tsf)	$\sigma_1'$ (tsf)	$\sigma_3'$ (tsf)	$p'$ ( $(\sigma_1' + \sigma_3')/2$ ) (tsf)	$q$ ( $(\sigma_1 - \sigma_3)/2$ ) (tsf)	Effective Principal
															Stress Ratio $\sigma_1' / \sigma_3'$
1:09:01	329.1	0.334	71.5	5.570	6.00	43.8271	315.9	3.352	3.338	6.578	4.671	1.329	3.000	1.671	3.514
1:10:11	330.0	0.340	71.1	5.564	6.10	43.8740	316.8	3.358	3.343	6.583	4.705	1.358	3.031	1.674	3.465
1:11:18	331.3	0.346	71.6	5.558	6.20	43.9207	318.1	3.368	3.353	6.593	4.682	1.325	3.004	1.679	3.534
1:12:25	333.4	0.352	71.8	5.552	6.30	43.9676	320.2	3.387	3.372	6.612	4.684	1.309	2.996	1.688	3.580
1:13:32	335.0	0.358	71.8	5.546	6.40	44.0140	321.8	3.400	3.384	6.624	4.696	1.307	3.001	1.694	3.592
1:14:38	336.0	0.364	71.6	5.540	6.50	44.0616	322.8	3.407	3.391	6.631	4.718	1.322	3.020	1.698	3.568
1:15:44	337.2	0.369	71.5	5.534	6.59	44.1079	324.0	3.416	3.400	6.640	4.736	1.332	3.034	1.702	3.555
1:16:50	338.7	0.375	71.4	5.528	6.69	44.1552	325.5	3.428	3.412	6.652	4.755	1.339	3.047	1.708	3.550
1:17:58	339.9	0.381	71.3	5.522	6.80	44.2028	326.7	3.437	3.420	6.660	4.773	1.349	3.061	1.712	3.539
1:19:05	341.2	0.387	71.1	5.516	6.90	44.2505	328.1	3.447	3.431	6.671	4.794	1.359	3.077	1.717	3.527
1:20:09	343.0	0.393	71.1	5.510	6.99	44.2977	329.9	3.463	3.446	6.686	4.814	1.364	3.089	1.725	3.529
1:21:16	344.1	0.399	70.9	5.505	7.09	44.3453	330.9	3.470	3.453	6.693	4.831	1.374	3.102	1.729	3.517
1:22:22	345.2	0.405	70.8	5.499	7.19	44.3931	332.0	3.478	3.460	6.700	4.847	1.382	3.114	1.732	3.507
1:23:28	346.7	0.411	70.6	5.493	7.30	44.4416	333.5	3.489	3.472	6.712	4.870	1.394	3.132	1.738	3.494
1:24:32	348.0	0.417	70.4	5.487	7.40	44.4895	334.8	3.499	3.481	6.721	4.900	1.415	3.157	1.743	3.464
1:25:40	348.6	0.423	69.8	5.481	7.50	44.5380	335.4	3.502	3.484	6.724	4.940	1.452	3.196	1.744	3.403
1:26:46	350.3	0.429	70.8	5.475	7.59	44.5853	337.1	3.516	3.497	6.737	4.884	1.383	3.134	1.751	3.532
1:27:53	352.0	0.435	70.9	5.469	7.69	44.6332	338.8	3.530	3.511	6.751	4.892	1.377	3.135	1.758	3.563
1:29:03	353.1	0.441	70.7	5.463	7.80	44.6822	339.9	3.538	3.519	6.759	4.912	1.389	3.151	1.761	3.536
1:30:11	354.3	0.446	70.6	5.457	7.89	44.7304	341.1	3.546	3.527	6.767	4.931	1.400	3.165	1.766	3.523
1:31:19	355.6	0.452	70.4	5.451	7.99	44.7788	342.4	3.555	3.536	6.776	4.952	1.412	3.182	1.770	3.508
1:32:27	357.1	0.458	70.3	5.445	8.10	44.8281	343.9	3.567	3.548	6.788	4.971	1.420	3.196	1.776	3.502
1:33:33	358.4	0.464	70.2	5.439	8.19	44.8761	345.2	3.577	3.557	6.797	4.988	1.427	3.208	1.781	3.495
1:34:40	359.4	0.470	70.0	5.434	8.29	44.9251	346.2	3.583	3.563	6.803	5.004	1.436	3.220	1.784	3.483
1:35:48	360.8	0.476	70.0	5.428	8.39	44.9741	347.6	3.594	3.573	6.813	5.020	1.442	3.231	1.789	3.481
1:36:56	362.4	0.482	69.8	5.422	8.49	45.0233	349.3	3.607	3.587	6.827	5.042	1.451	3.247	1.795	3.474
1:38:05	363.3	0.488	69.6	5.416	8.59	45.0732	350.2	3.612	3.592	6.832	5.061	1.466	3.264	1.798	3.453
1:39:10	364.4	0.494	69.3	5.410	8.69	45.1220	351.2	3.620	3.599	6.839	5.093	1.490	3.292	1.801	3.418
1:40:18	365.9	0.500	69.7	5.404	8.79	45.1714	352.7	3.631	3.609	6.849	5.074	1.461	3.267	1.807	3.474
1:41:26	367.1	0.506	69.9	5.398	8.90	45.2217	353.9	3.639	3.617	6.857	5.068	1.446	3.257	1.811	3.505
1:42:31	368.1	0.512	69.9	5.392	8.99	45.2706	354.9	3.646	3.624	6.864	5.073	1.445	3.259	1.814	3.511
1:43:38	369.4	0.517	69.7	5.386	9.09	45.3204	356.2	3.655	3.633	6.873	5.097	1.460	3.278	1.819	3.492
1:44:46	371.1	0.523	69.6	5.380	9.19	45.3699	357.9	3.669	3.646	6.886	5.119	1.468	3.293	1.825	3.486
1:45:54	372.0	0.529	69.5	5.374	9.29	45.4201	358.8	3.674	3.651	6.891	5.132	1.477	3.304	1.828	3.476
1:47:00	372.7	0.535	69.3	5.368	9.39	45.4706	359.6	3.677	3.654	6.894	5.148	1.490	3.319	1.829	3.456
1:48:07	374.4	0.541	69.2	5.362	9.49	45.5202	361.2	3.690	3.667	6.907	5.166	1.496	3.331	1.835	3.454
1:49:15	375.4	0.547	69.2	5.357	9.59	45.5703	362.2	3.696	3.673	6.913	5.178	1.501	3.339	1.839	3.450
1:50:22	376.0	0.553	69.0	5.351	9.69	45.6212	362.8	3.698	3.674	6.914	5.194	1.515	3.354	1.839	3.428
1:51:28	377.5	0.559	68.9	5.345	9.79	45.6713	364.3	3.710	3.686	6.926	5.212	1.522	3.367	1.845	3.424
1:52:36	378.8	0.565	68.7	5.339	9.89	45.7222	365.6	3.718	3.694	6.934	5.230	1.532	3.381	1.849	3.414
1:53:44	379.5	0.571	68.4	5.333	9.99	45.7734	366.3	3.722	3.697	6.937	5.257	1.555	3.406	1.851	3.380
1:54:50	380.3	0.577	68.2	5.327	10.09	45.8239	367.1	3.725	3.701	6.941	5.276	1.572	3.424	1.852	3.357
1:55:58	382.0	0.583	68.9	5.321	10.19	45.8755	368.9	3.739	3.714	6.954	5.235	1.517	3.376	1.859	3.451
1:57:06	382.8	0.589	69.0	5.315	10.29	45.9264	369.6	3.743	3.718	6.958	5.236	1.514	3.375	1.861	3.458
1:58:14	383.8	0.594	68.8	5.309	10.39	45.9774	370.6	3.748	3.723	6.963	5.251	1.524	3.388	1.864	3.446
1:59:19	385.2	0.600	68.7	5.303	10.49	46.0284	372.0	3.758	3.732	6.972	5.272	1.535	3.403	1.868	3.434
2:00:27	386.4	0.606	68.6	5.297	10.59	46.0805	373.2	3.766	3.740	6.980	5.288	1.543	3.415	1.872	3.427
2:01:34	387.2	0.612	68.5	5.291	10.69	46.1321	374.0	3.770	3.744	6.984	5.299	1.551	3.425	1.874	3.416
2:02:39	388.0	0.618	68.2	5.285	10.79	46.1833	374.8	3.774	3.748	6.988	5.325	1.573	3.449	1.876	3.385
2:03:45	389.6	0.624	68.3	5.280	10.89	46.2348	376.4	3.785	3.759	6.999	5.326	1.563	3.444	1.882	3.408
2:04:52	390.4	0.630	68.0	5.274	10.99	46.2870	377.2	3.789	3.763	7.003	5.350	1.583	3.467	1.884	3.379
2:05:58	391.0	0.636	67.8	5.268	11.09	46.3393	377.8	3.791	3.764	7.004	5.364	1.596	3.480	1.884	3.361
2:07:03	392.3	0.642	67.6	5.262	11.19	46.3914	379.2	3.800	3.773	7.013	5.391	1.613	3.502	1.889	3.341
2:08:10	393.4	0.648	67.1	5.256	11.29	46.4435	380.3	3.807	3.780	7.020	5.430	1.646	3.538	1.892	3.299
2:09:17	394.2	0.654	68.0	5.250	11.39	46.4959	381.1	3.811	3.783	7.023	5.374	1.587	3.481	1.894	3.387
2:10:22	395.7	0.660	68.0	5.244	11.49	46.5487	382.6	3.822	3.794	7.034	5.378	1.581	3.479	1.899	3.403
2:11:26	396.8	0.665	68.0	5.238	11.59	46.6005	383.6	3.828	3.800	7.040	5.387	1.583	3.485	1.902	3.404
2:12:34	397.4	0.671	67.8	5.232	11.69	46.6532	384.2	3.830	3.801	7.041	5.406	1.601	3.504	1.903	3.377
2:13:41	398.5	0.677	67.7	5.226	11.79	46.7062	385.3	3.836	3.808	7.048	5.421	1.609	3.515	1.906	3.370
2:14:46	399.8	0.683	67.6	5.220	11.89	46.7593	386.6	3.845	3.816	7.056	5.436	1.616	3.526	1.910	3.364

# Consolidated Undrained Triaxial Test EM 1110-2-1906 Appendix X

Consolidation Values				Final Values				Tested By <u>KDG</u>		Project Number <u>175569069</u>	
Height	<u>5.925 (in.)</u>	<u>15.049 (cm)</u>		Height	<u>4.835 (in.)</u>		Date	<u>12-14-09</u>	Test Number	<u>CU-3C</u>	
Diameter	<u>2.851 (in)</u>	<u>7.243 (cm)</u>		Dia. avg.	<u>3.272 (in)</u>		Press No.	<u>1</u>	Data File ID	<u>3C</u>	
Area	<u>6.386 (in<sup>2</sup>)</u>	<u>41.199 (cm<sup>2</sup>)</u>		Area avg.	<u>8.408 (in<sup>2</sup>)</u>		Panel No.	<u>A</u>	Lateral Pressure (psi)	<u>45.0</u>	
Chamber Pressure - $\sigma_3$ (psi) <u>90</u>											

Clock Time (min.)	Load (lbf)	Deflection Dial Reading (in.)	Pore Pressure Reading (psi)	Corrected Height (in.)	Strain (%)	Corrected Area (cm <sup>2</sup> )	Corrected Load (lbf)	Deviator Stress (tsf)	Corrected Deviator Stress* (tsf)	$\sigma_1$ (tsf)	$\sigma_1'$ (tsf)	$\sigma_3'$ (tsf)	$p' = (\sigma_1' + \sigma_3')/2$ (tsf)	$q = (\sigma_1 - \sigma_3)/2$ (tsf)	Effective Principal Stress Ratio
															$\sigma_1' / \sigma_3'$
2:15:54	400.5	0.689	67.4	5.214	11.99	46.8126	387.3	3.847	3.818	7.058	5.447	1.625	3.536	1.911	3.352
2:17:03	401.6	0.695	67.3	5.208	12.09	46.8662	388.4	3.854	3.825	7.065	5.460	1.631	3.546	1.914	3.347
2:18:10	402.4	0.701	67.2	5.203	12.19	46.9194	389.2	3.857	3.827	7.067	5.472	1.640	3.556	1.916	3.336
2:19:19	403.7	0.707	67.1	5.197	12.29	46.9737	390.5	3.866	3.836	7.076	5.492	1.652	3.572	1.920	3.325
2:20:27	404.4	0.713	66.8	5.191	12.39	47.0260	391.2	3.869	3.839	7.079	5.517	1.674	3.595	1.921	3.296
2:21:34	405.2	0.719	66.7	5.185	12.49	47.0801	392.0	3.872	3.842	7.082	5.527	1.681	3.604	1.923	3.288
2:22:39	406.6	0.725	67.3	5.179	12.59	47.1334	393.4	3.881	3.850	7.090	5.490	1.636	3.563	1.927	3.356
2:23:49	407.7	0.731	67.3	5.173	12.69	47.1879	394.5	3.887	3.857	7.097	5.492	1.631	3.561	1.930	3.367
2:24:57	408.7	0.737	67.2	5.167	12.79	47.2419	395.5	3.893	3.862	7.102	5.508	1.642	3.575	1.933	3.355
2:26:05	409.2	0.742	67.0	5.161	12.89	47.2963	396.0	3.893	3.862	7.102	5.522	1.656	3.589	1.933	3.334
2:27:12	410.5	0.748	66.9	5.155	12.99	47.3496	397.3	3.901	3.870	7.110	5.536	1.662	3.599	1.937	3.331
2:28:20	411.2	0.754	66.9	5.149	13.09	47.4047	398.0	3.904	3.872	7.112	5.543	1.667	3.605	1.938	3.326
2:29:26	412.0	0.760	66.6	5.143	13.19	47.4590	398.8	3.907	3.875	7.115	5.561	1.681	3.621	1.940	3.307
2:30:32	413.1	0.766	66.6	5.137	13.29	47.5137	399.9	3.913	3.881	7.121	5.573	1.687	3.630	1.943	3.303
2:31:40	414.1	0.772	66.5	5.132	13.39	47.5682	400.9	3.919	3.886	7.126	5.582	1.692	3.637	1.945	3.299
2:32:48	414.7	0.778	66.2	5.126	13.49	47.6231	401.5	3.921	3.888	7.128	5.602	1.710	3.656	1.946	3.276
2:33:54	415.4	0.784	65.8	5.120	13.59	47.6787	402.2	3.923	3.890	7.130	5.636	1.742	3.689	1.947	3.235
2:35:01	416.6	0.790	66.5	5.114	13.69	47.7332	403.4	3.930	3.897	7.137	5.592	1.691	3.641	1.951	3.307
2:36:10	417.6	0.796	66.7	5.108	13.79	47.7890	404.4	3.935	3.902	7.142	5.587	1.681	3.634	1.953	3.324
2:37:17	418.0	0.802	66.6	5.102	13.89	47.8442	404.8	3.935	3.901	7.141	5.587	1.682	3.634	1.953	3.322
2:38:23	419.0	0.807	66.4	5.096	13.99	47.8996	405.8	3.939	3.906	7.146	5.607	1.698	3.653	1.955	3.303
2:39:32	420.0	0.813	66.3	5.090	14.09	47.9561	406.8	3.944	3.910	7.150	5.619	1.705	3.662	1.957	3.296
2:40:42	420.7	0.819	66.3	5.084	14.19	48.0122	407.5	3.947	3.912	7.152	5.626	1.710	3.668	1.958	3.291
2:41:48	421.4	0.825	66.1	5.078	14.29	48.0683	408.2	3.949	3.915	7.155	5.643	1.724	3.684	1.959	3.273
2:42:55	423.0	0.831	66.0	5.072	14.39	48.1247	409.8	3.959	3.925	7.165	5.657	1.729	3.693	1.964	3.273
2:44:01	423.3	0.837	65.9	5.066	14.49	48.1799	410.2	3.959	3.923	7.163	5.664	1.736	3.700	1.964	3.262
2:45:08	423.9	0.843	65.7	5.060	14.59	48.2366	410.7	3.959	3.924	7.164	5.679	1.751	3.715	1.964	3.243
2:46:15	425.0	0.849	65.4	5.054	14.69	48.2941	411.8	3.965	3.929	7.169	5.708	1.774	3.741	1.967	3.217
2:47:21	426.3	0.855	65.9	5.049	14.79	48.3499	413.1	3.973	3.938	7.178	5.680	1.739	3.710	1.971	3.267
2:48:27	427.2	0.861	66.0	5.043	14.89	48.4070	414.0	3.977	3.941	7.181	5.670	1.725	3.697	1.972	3.287
2:49:31	427.6	0.867	66.0	5.037	14.99	48.4630	414.4	3.976	3.940	7.180	5.670	1.726	3.698	1.972	3.285
2:50:36	428.9	0.873	65.9	5.031	15.09	48.5204	415.7	3.984	3.947	7.187	5.687	1.735	3.711	1.976	3.277
2:51:42	429.4	0.879	65.7	5.025	15.19	48.5769	416.2	3.984	3.947	7.187	5.698	1.746	3.722	1.976	3.263
2:52:47	429.8	0.884	65.6	5.019	15.29	48.6344	416.6	3.983	3.946	7.186	5.705	1.755	3.730	1.975	3.251
2:53:54	431.3	0.890	65.6	5.013	15.39	48.6926	418.2	3.993	3.956	7.196	5.719	1.759	3.739	1.980	3.251
2:55:01	431.9	0.896	65.5	5.007	15.49	48.7500	418.7	3.994	3.956	7.196	5.726	1.766	3.746	1.980	3.243
2:56:06	432.3	0.902	65.3	5.001	15.59	48.8076	419.1	3.993	3.955	7.195	5.734	1.775	3.755	1.980	3.231
2:57:11	433.1	0.908	65.2	4.995	15.69	48.8654	419.9	3.996	3.958	7.198	5.745	1.784	3.764	1.981	3.221
2:58:19	434.1	0.914	65.0	4.989	15.79	48.9229	420.9	4.000	3.962	7.202	5.767	1.800	3.783	1.983	3.203
2:59:26	434.8	0.920	64.5	4.984	15.89	48.9810	421.6	4.003	3.964	7.204	5.804	1.835	3.820	1.984	3.162
3:00:35	435.6	0.926	65.4	4.978	15.99	49.0403	422.4	4.005	3.967	7.207	5.740	1.770	3.755	1.985	3.244
3:01:41	436.9	0.932	65.3	4.972	16.09	49.0979	423.7	4.013	3.974	7.214	5.758	1.779	3.769	1.989	3.236
3:02:48	437.6	0.938	65.2	4.966	16.19	49.1562	424.4	4.015	3.975	7.215	5.762	1.782	3.772	1.990	3.233
3:03:56	437.8	0.944	65.3	4.960	16.29	49.2153	424.7	4.012	3.973	7.213	5.757	1.780	3.768	1.989	3.234
3:05:02	438.9	0.950	65.2	4.954	16.39	49.2737	425.7	4.018	3.978	7.218	5.771	1.789	3.780	1.991	3.226
3:06:11	439.7	0.956	65.1	4.948	16.49	49.3331	426.5	4.020	3.980	7.220	5.780	1.796	3.788	1.992	3.219
3:07:19	440.1	0.961	64.9	4.942	16.59	49.3916	426.9	4.019	3.979	7.219	5.787	1.804	3.795	1.992	3.208
3:08:25	440.8	0.967	64.8	4.936	16.69	49.4507	427.6	4.021	3.980	7.220	5.797	1.812	3.804	1.992	3.199
3:09:33	441.9	0.973	64.8	4.930	16.79	49.5108	428.7	4.027	3.986	7.226	5.808	1.817	3.813	1.995	3.195
3:10:43	442.4	0.979	64.5	4.924	16.89	49.5708	429.2	4.026	3.985	7.225	5.824	1.834	3.829	1.995	3.175
3:11:52	442.9	0.985	64.7	4.918	16.99	49.6298	429.7	4.026	3.985	7.225	5.812	1.823	3.817	1.995	3.189
3:12:59	444.0	0.991	65.0	4.912	17.09	49.6900	430.8	4.032	3.990	7.230	5.796	1.802	3.799	1.997	3.217
3:14:07	445.1	0.997	65.0	4.907	17.19	49.7502	431.9	4.037	3.995	7.235	5.797	1.797	3.797	2.000	3.226
3:15:15	445.2	1.003	64.9	4.901	17.29	49.8093	432.1	4.033	3.992	7.232	5.805	1.809	3.807	1.998	3.209
3:16:24	445.7	1.009	64.7	4.895	17.39	49.8723	432.5	4.033	3.991	7.231	5.814	1.819	3.816	1.997	3.196
3:17:28	447.2	1.015	64.7	4.889	17.49	49.9300	434.0	4.042	3.999	7.239	5.824	1.821	3.823	2.002	3.199
3:18:37	447.9	1.021	64.6	4.883	17.59	49.9905	434.7	4.044	4.001	7.241	5.836	1.830	3.833	2.003	3.188
3:19:46	448.1	1.027	64.5	4.877	17.69	50.0520	434.9	4.041	3.998	7.238	5.839	1.837	3.838	2.001	3.179
3:20:52	448.9	1.032	64.4	4.871	17.79	50.1118	435.8	4.044	4.000	7.240	5.848	1.843	3.845	2.002	3.173
3:22:01	449.8	1.038	64.3	4.865	17.89	50.1729	436.6	4.046	4.003	7.243	5.860	1.853	3.857	2.004	3.162

## Consolidated Undrained Triaxial Test EM 1110-2-1906 Appendix X

Consolidation Values		
Height	5.925 (in.)	15.049 (cm)
Diameter	2.851 (in)	7.243 (cm)
Area	6.386 (in <sup>2</sup> )	41.199 (cm <sup>2</sup> )

Final Values	
Height	4.835 (in.)
Dia. avg.	3.272 (in)
Area avg.	8.408 (in <sup>2</sup> )



Tested By	KDG
Date	12-14-09
Press No.	1
Panel No.	A

Project Number	175569069
Test Number	CU-3C
Data File ID	3C
Lateral Pressure (psi)	45.0
Chamber Pressure - $\sigma_3$ (psi)	90

Clock Time (min.)	Load (lbf)	Deflection Dial Reading (in.)	Pore Pressure Reading (psi)	Corrected Height (in.)	Strain (%)	Corrected Area (cm <sup>2</sup> )	Corrected Load (lbf)	Deviator Stress (tsf)	Corrected Deviator Stress* (tsf)	$\sigma_1$ (tsf)	$\sigma_1'$ (tsf)	$\sigma_2'$ (tsf)	$p'$ ( $(\sigma_1' + \sigma_3')/2$ ) (tsf)	$q$ ( $(\sigma_1 - \sigma_3)/2$ ) (tsf)	Effective Principal Stress Ratio
															$\sigma_1' / \sigma_3'$
3:23:08	450.4	1.044	64.0	4.859	17.99	50.2338	437.2	4.047	4.003	7.243	5.877	1.870	3.873	2.004	3.144
3:24:14	450.7	1.050	64.2	4.853	18.09	50.2954	437.5	4.045	4.001	7.241	5.859	1.854	3.856	2.002	3.160
3:25:22	452.1	1.056	64.6	4.847	18.19	50.3571	438.9	4.053	4.008	7.248	5.845	1.832	3.838	2.006	3.190
3:26:32	452.8	1.062	64.6	4.841	18.29	50.4192	439.6	4.054	4.010	7.250	5.842	1.828	3.835	2.007	3.196
3:27:39	453.3	1.068	64.5	4.835	18.39	50.4810	440.1	4.054	4.009	7.249	5.853	1.839	3.846	2.007	3.182

Failure Criterion: Maximum Effective Principal Stress Ratio

**Effective Strength Envelope**

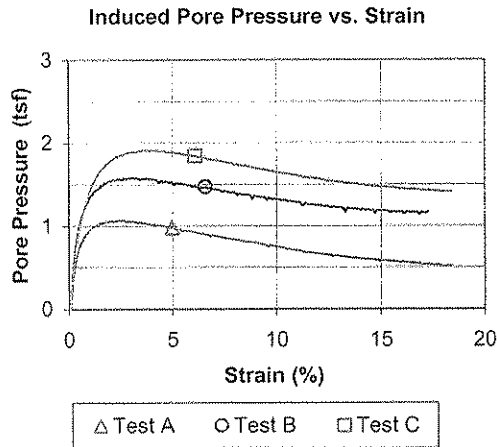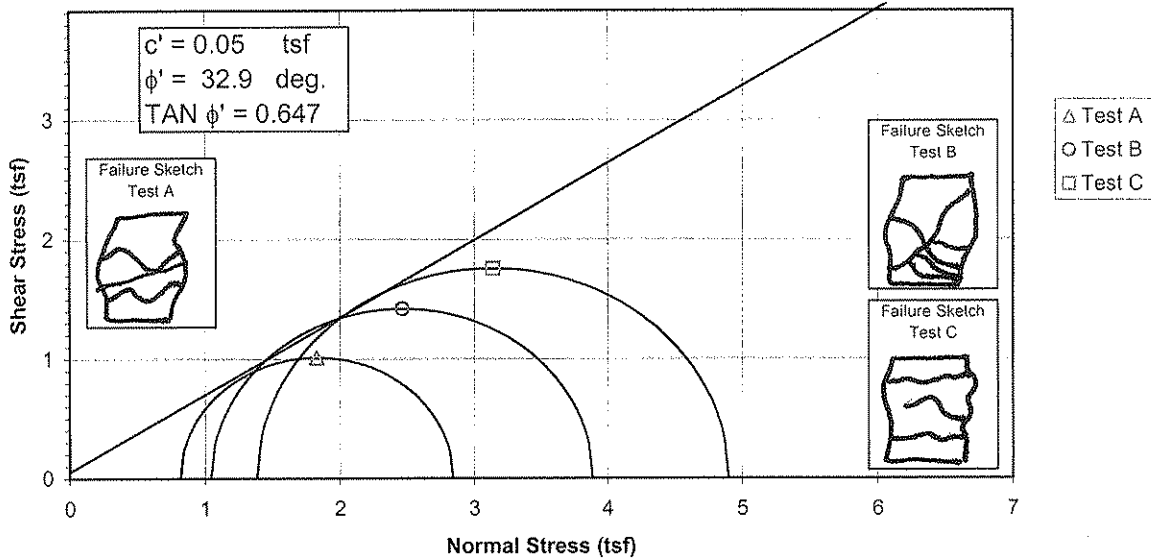

Specimen No.		A	B	C
Initial Data	Water content %	$W_o$ 23.4	22.5	24.8
	Dry Density PCF	$\gamma_{d_o}$ 100.2	107.6	99.5
	Saturation %	$S_o$ 94.8	110.3	98.6
	Void Ratio	$e_o$ 0.658	0.543	0.669
After Shear	Water content %	$W_f$ 19.5	17.3	18.6
	Dry Density PCF	$\gamma_{d_f}$ 109.4	113.7	111.0
	Saturation %	$S_f$ 100.0	100.0	100.0
	Void Ratio	$e_f$ 0.518	0.460	0.496
	Final Back Pressure TSF	$u_c$ 4.68	3.96	3.24
	Minor Principal Stress TSF @ failure	$\sigma_3^f$ 0.82	1.05	1.38
	Maximum Deviator Stress (tsf) @ failure	$(\sigma_1' - \sigma_3')_{max}$ 2.02	2.84	3.51
	Time to $(\sigma_1' - \sigma_3')_{max}$ min.	$t_f$ 263.7	285.0	340.8
	Ultimate Deviator Stress, t/sq ft	$(\sigma_1' - \sigma_3')_{ult}$ n/a	n/a	n/a
	Initial Diameter, in.	$D_o$ 2.887	2.810	2.860
	Initial Height, in.	$H_o$ 5.808	5.531	5.993


Controlled - Strain Test				Initial Height, in.				$H_o$	5.808	5.531	5.993
Description of Specimens Lean Clay with Sand (CL), gray brown, wet, soft											
				Type of Specimen Undisturbed				Type of test R			
LL	PL	PI	Gs	2.66		Project PAF - Peabody Ash Pond					
Remarks:											
				Boring No. STN-12 (N3)				Sample No. 4			
Depth Elev. 26.3'-26.8', 25.0'-25.5', 25.7'-26.2'											
				Laboratory Stantec				Date 12-22-09			
<b>TRIAXIAL COMPRESSION TEST REPORT</b>											

**Consolidated Undrained Triaxial Test  
EM 1110-2-1906 Appendix X**


Project PAF - Peabody Ash Pond  
 Sample ID STN-12 (N3), 26.3'-26.8' & STN-12 (N3), 25.0'-25.5' & STN-12 (N3), 25.7'-26.2'  
 Failure Criterion: Maximum Effective Principal Stress Ratio  $\phi' = 32.9$  deg.

Project No. 175569069  
 Test Number 4  
 $c' = 0.05$  tsf

**p' vs. q Plot**

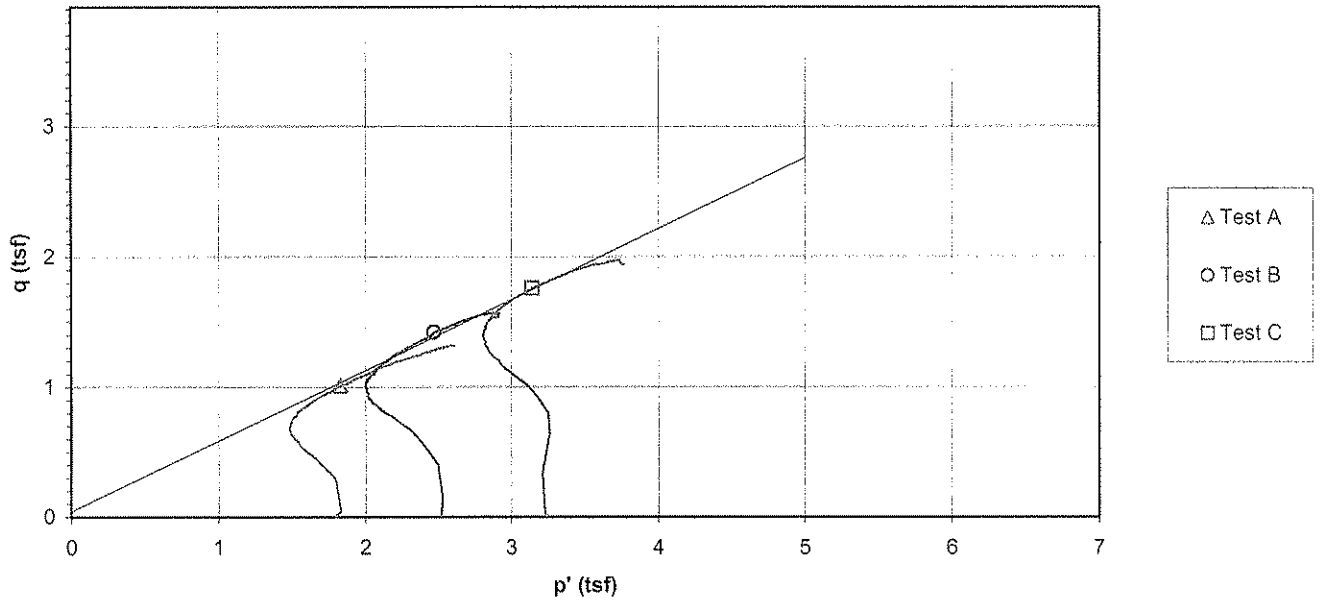

**Deviator Stress and Induced Pore Pressure vs. Axial Strain**

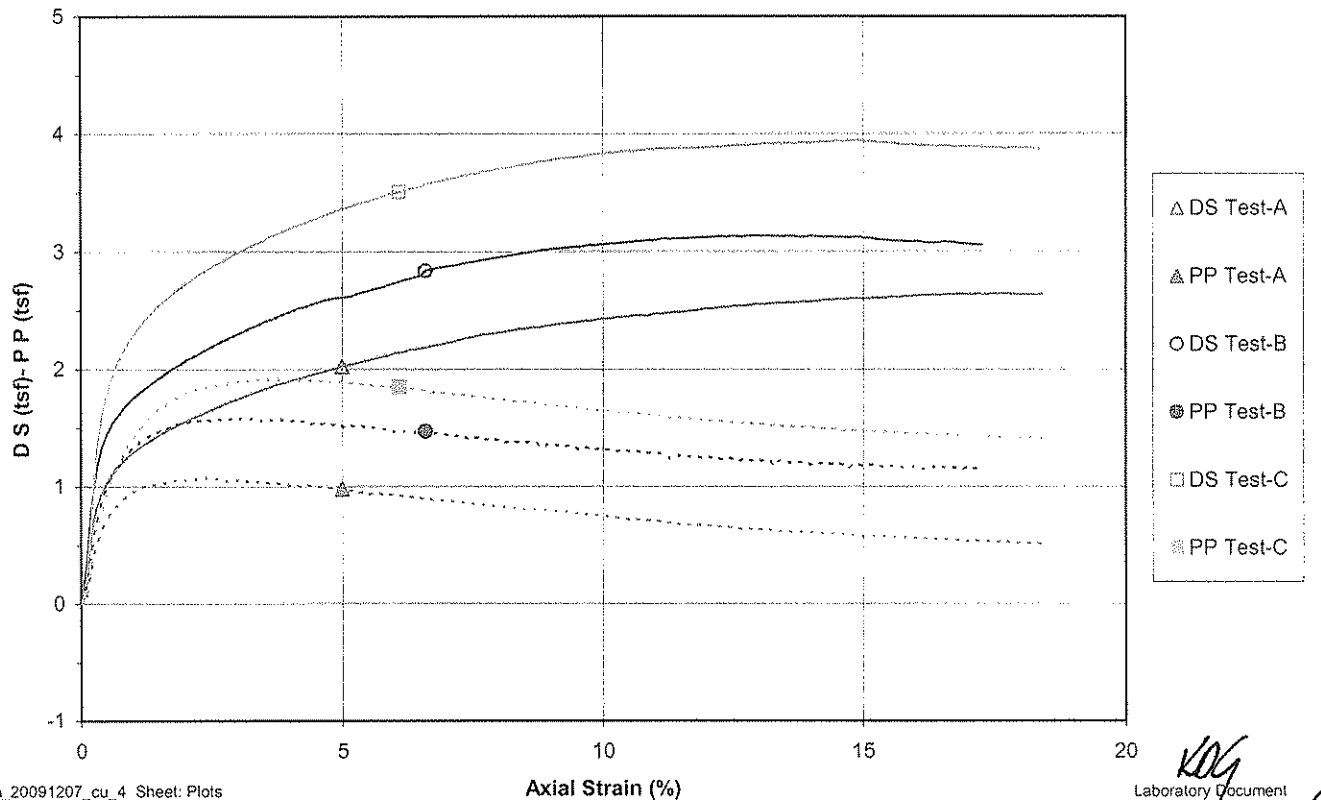

Project Name	PAF - Peabody Ash Pond			Project Number	175569069			
Sample Identification	STN-12 (N3), 26.3'-26.8'			Test Number	CU-4A			
Visual Description	Lean Clay with Sand (CL), gray brown, wet, soft			Prepared By	MC			
Undisturbed	Source	STN-12 (N3), 26.3'-27.0'		Date	12-9-2009			
Specific Gravity	2.66	ASTM D854 Method A	Liquid Limit	N/A	Plastic Limit	N/A	Plasticity Index	N/A

**Initial Specimen Data**

Specimen Diameter (in.)	Specimen Height (in.)	Volumes (in <sup>3</sup> )	Specimen
Top <u>2.871</u>	1 <u>5.880</u>	Sample <u>37.9836</u> (V <sub>o</sub> )	Wet Weight (g) <u>1233.66</u>
Middle <u>2.889</u>	2 <u>5.739</u>	Solids <u>22.9254</u> (V <sub>S<sub>o</sub></sub> )	Dry Weight (g) <u>999.37</u>
Bottom <u>2.897</u>	3 <u>5.844</u>	Water <u>14.2965</u> (V <sub>w<sub>o</sub></sub> )	Wet Unit Weight (pcf) <u>123.7</u>
Avg. <u>2.8857</u> (D <sub>o</sub> )	4 <u>5.770</u>	Voids <u>15.0582</u> (V <sub>v<sub>o</sub></sub> )	Dry Unit Weight (pcf) <u>100.2</u>
Area (in <sup>2</sup> ) <u>6.5401</u> (A <sub>o</sub> )	Avg. (H <sub>o</sub> ) <u>5.8078</u>	Degree of Saturation (%) <u>94.9</u> (S <sub>o</sub> )	
Moisture Content (%) <u>23.4</u>	Final Trimmings	Void Ratio <u>0.657</u>	

**Saturation**

Set Up & Saturated:	Wet <u>xx</u>	Dry _____	Set up By	KDG
Back Pressure Saturated to:	<u>65</u> (psi)	Final Pore Pressure Parameter B	<u>0.97</u>	Date <u>12-14-09</u>
			Panel Board Number	<u>B</u>




Height Readings (in.)	Back Pressure Burette	Chamber Burette	Specimen Height (in.)	<u>5.7739</u> (H <sub>s</sub> )
Initial <u>0.1258</u>	Initial <u>17.21</u> (in.)	Initial <u>11.6</u> (in.)	Area (in <sup>2</sup> ) Method A	<u>6.4633</u> (A <sub>s</sub> )
Final <u>0.1597</u>	Final <u>16.27</u> (in.)	Final <u>7.86</u> (in.)	Specimen Volume (in <sup>3</sup> )	<u>37.32</u> (V <sub>s</sub> )
Change <u>-0.0339</u> (ΔH <sub>b</sub> )	Change <u>-0.94</u> (in.)	Change <u>-3.74</u> (in.)		

**Consolidation**

Height Readings (in.)	Back Pressure Burette Readings	Chamber Burette Readings	Pressures (psi)
Initial <u>0.1597</u>	Initial <u>1.57</u> (in.)	Initial <u>17.21</u> (in.)	Chamber <u>90</u>
Final <u>0.207</u>	Final <u>9.52</u> (in.)	Final <u>8.04</u> (in.)	Back <u>65</u>
Change <u>-0.0473</u> (ΔH <sub>c</sub> )	Change <u>-7.95</u> (in.)	Change <u>-9.17</u> (in.)	Lateral <u>25</u> (σ <sub>3</sub> )
Height (in.)	<u>5.7266</u> (H <sub>c</sub> )	Volume (in <sup>3</sup> )	<u>34.7908</u> (V <sub>c</sub> )
Area (in <sup>3</sup> ) Method B	<u>6.0753</u> (A <sub>c</sub> )	Volume - Water (in <sup>3</sup> )	<u>11.8654</u> (V <sub>wc</sub> )
Diameter (in.)	<u>2.7812</u> (D <sub>c</sub> )	Water Content (%)	<u>19.5</u>
Dry Density (pcf)	<u>109.4</u>	Degree of Saturation (%)	<u>100.0</u> (S <sub>c</sub> )
			t <sub>50</sub> (min.) <u>27</u>
			Void Ratio <u>0.518</u>

**After Test**

Final Measurements	Final Moisture Content	Stresses (membrane corrected) at Failure (psi)
Maximum Diameter <u>3.29</u> (in.)	Wet Weight (g) <u>1193.82</u>	Corrected Deviator <u>2.02</u> σ <sub>d</sub> (tsf)
Wet weight (g) <u>1193.82</u> (WWf)	Dry Weight (g) <u>999.37</u>	Major Principal <u>2.84</u> σ <sub>1'</sub> (tsf)
Corrected Diameter <u>3.266</u> (in.)	Tare Weight (g) <u>0.00</u>	Minor Principal <u>0.82</u> σ <sub>3'</sub> (tsf)
Youngs Modulus for Membrane (psi) <u>200</u>		Rate of Strain (% / min.) <u>0.019</u>
Membrane Thickness (in.) <u>0.012</u>		Axial Strain at Failure (%) <u>5.00</u>
		Failure Criterion: Maximum Effective Principal Stress Ratio

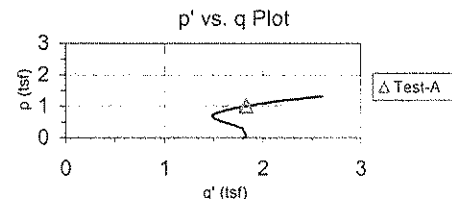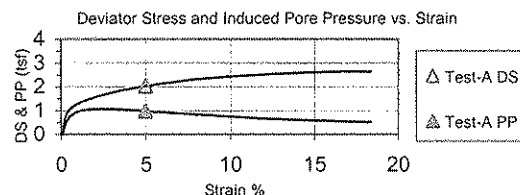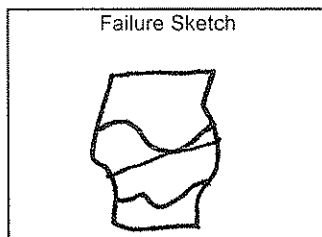

Comments:

*KDG*



Project Name	PAF - Peabody Ash Pond			Project Number	175569069			
Sample Identification	STN-12 (N3), 25.0'-25.5'			Test Number	CU-4B			
Visual Description	Lean Clay with Sand (CL), brown, wet, soft			Prepared By	MC			
Undisturbed	Source	STN-12 (N3), 25.0'-25.7'		Date	12-9-2009			
Specific Gravity	2.66	ASTM D854 Method A	Liquid Limit	N/A	Plastic Limit	N/A	Plasticity Index	N/A

**Initial Specimen Data**

Specimen Diameter (in.)	Specimen Height (in.)	Volumes (in3)	Specimen
Top	1 5.514	Sample	Wet Weight (g)
Middle	2 5.515	Solids	Dry Weight (g)
Bottom	3 5.519	Water	Wet Unit Weight (pcf)
Avg.	4 5.578	Voids	Dry Unit Weight (pcf)
Area (in <sup>2</sup> )	Avg. (H <sub>o</sub> )	Degree of Saturation (%)	
Moisture Content (%)	Final Trimmings	Void Ratio	

**Saturation**

Set Up & Saturated:	Wet <u>xx</u>	Dry _____	Set up By	KDG
Back Pressure Saturated to:	55 (psi)	Final Pore Pressure Parameter B	Date	12-11-09
			Panel Board Number	D

Height Readings (in.)	Back Pressure Burette	Chamber Burette	Specimen Height (in.)
Initial	Initial	Initial	Area (in <sup>2</sup> ) Method A
Final	Final	Final	Specimen Volume (in <sup>3</sup> )
Change	Change	Change	




**Consolidation**

Height Readings (in.)	Back Pressure Burette Readings	Chamber Burette Readings	Pressures (psi)
Initial	Initial	Initial	Chamber
Final	Final	Final	Back
Change	Change	Change	Lateral
Height (in.)	Volume (in <sup>3</sup> )	Volume (in <sup>3</sup> )	D <sub>50</sub> (min.)
Area (in <sup>2</sup> ) Method B	Volume - Water (in <sup>3</sup> )	Water Content (%)	Degree of Saturation (%)
Diameter (in.)	Dry Density (pcf)	Void Ratio	

**After Test**

Final Measurements	Final Moisture Content	Stresses (membrane corrected) at Failure (psi)
Maximum Diameter	Wet Weight (g)	Corrected Deviator
Wet weight (g)	Dry Weight (g)	Major Principal
Corrected Diameter	Tare Weight (g)	Minor Principal
Youngs Modulus for Membrane (psi)	Membrane Thickness (in.)	Rate of Strain (% / min.)
		Axial Strain at Failure (%)

Failure Criterion: Maximum Effective Principal Stress Ratio

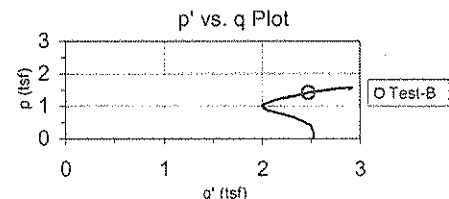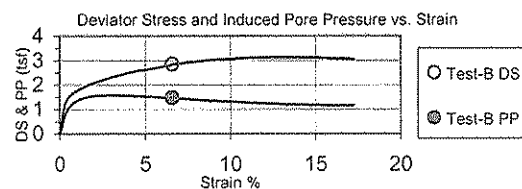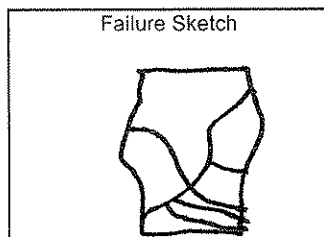

Comments:



Project Name	PAF - Peabody Ash Pond	Project Number	175569069
Sample Identification	STN-12 (N3), 25.7'-26.2'	Test Number	CU-4C
Visual Description	Lean Clay (CL), gray brown, wet, soft	Prepared By	MC
Undisturbed	Source STN-12 (N3), 25.7'-26.2'	Date	12-9-2009
Specific Gravity	2.66 ASTM D854 Method A	Liquid Limit	N/A
		Plastic Limit	N/A
		Plasticity Index	N/A

#### Initial Specimen Data

Specimen Diameter (in.)	Specimen Height (in.)	Volumes (in <sup>3</sup> )	Specimen
Top	1 6.022	Sample	Wet Weight (g) 1254.79
Middle	2 5.995	Solids	Dry Weight (g) 1005.41
Bottom	3 6.028	Water	Wet Unit Weight (pcf) 123.9
Avg.	4 5.926	Voids	Dry Unit Weight (pcf) 99.3
Area (in <sup>2</sup> )	6.4362 (A <sub>0</sub> )	Avg. (H <sub>0</sub> )	5.9925
Moisture Content (%)	24.8	Degree of Saturation (%)	98.1 (S <sub>0</sub> )
	Final Trimmings	Void Ratio	0.672

#### Saturation

Set Up & Saturated:	Wet <u>xx</u> Dry _____	Set up By	KDG
Back Pressure Saturated to:	45 (psi)	Final Pore Pressure Parameter B	0.99
		Date	12-14-09
		Panel Board Number	C




Height Readings (in.)	Back Pressure Burette	Chamber Burette	
Initial	0.1415	Initial	16.76 (in.)
Final	0.2343	Initial	11.91 (in.)
Change	-0.0928 (ΔH <sub>b</sub> )	Final	8.05 (in.)
		Change	-3.86 (in.)
		Specimen Height (in.)	5.8997 (H <sub>s</sub> )
		Area (in <sup>2</sup> ) Method A	6.2337 (A <sub>s</sub> )
		Specimen Volume (in <sup>3</sup> )	36.78 (V <sub>s</sub> )

#### Consolidation

Height Readings (in.)	Back Pressure Burette Readings	Chamber Burette Readings	Pressures (psi)
Initial	0.2343	Initial	17.94 (in.)
Final	0.2948	Final	4.04 (in.)
Change	-0.0605 (ΔH <sub>b</sub> )	Change	-13.90 (in.)
Height (in.)	5.8392 (H <sub>c</sub> )	Volume (in <sup>3</sup> )	34.4968 (V <sub>c</sub> )
Area (in <sup>2</sup> ) Method B	5.9078 (A <sub>c</sub> )	Volume - Water (in <sup>3</sup> )	11.4329 (V <sub>Wc</sub> )
Diameter (in.)	2.7426 (D <sub>c</sub> )	Water Content (%)	18.6
Dry Density (pcf)	111.0	Degree of Saturation (%)	100.0 (S <sub>c</sub> )
		Chamber	90
		Back	45
		Lateral	45 (σ <sub>3</sub> )
		D <sub>50</sub> (min.)	110
		Void Ratio	0.496

#### After Test

Final Measurements	Final Moisture Content	Stresses (membrane corrected) at Failure (psi)			
Maximum Diameter	3.302 (in.)	Wet Weight (g)	1192.77	Corrected Deviator	3.51 σ <sub>d</sub> (tsf)
Wet weight (g)	1192.77 (WW <sub>f</sub> )	Dry Weight (g)	1005.41	Major Principal	4.90 σ <sub>1f</sub> (tsf)
Corrected Diameter	3.278 (in.)	Tare Weight (g)	0.00	Minor Principal	1.38 σ <sub>3f</sub> (tsf)
				Rate of Strain (% / min.)	0.018
				Axial Strain at Failure (%)	6.10
Youngs Modulus for Membrane (psi)	200			Failure Criterion: Maximum Effective Principal Stress Ratio	
Membrane Thickness (in.)	0.012				

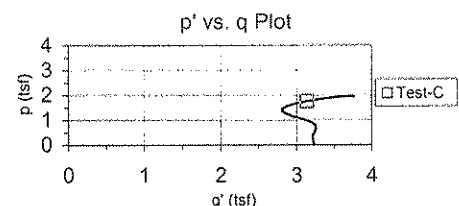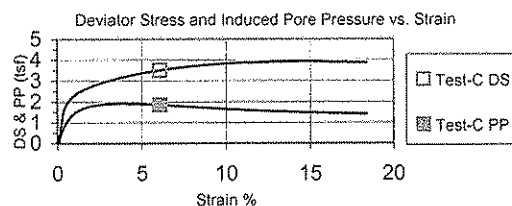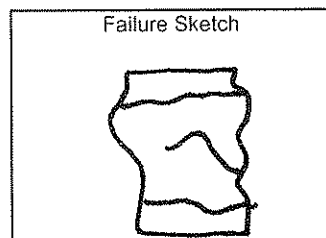

Comments: \_\_\_\_\_

*KDG*

**Consolidated Undrained Triaxial Test  
EM 1110-2-1906 Appendix X**

Consolidation Values		
Height	5.727 (in.)	14.546 (cm)
Diameter	2.781 (in.)	7.065 (cm)
Area	6.076 (in <sup>2</sup> )	39.198 (cm <sup>2</sup> )

Final Values	
Height	4.672 (in.)
Dia. avg.	3.194 (in.)
Area avg.	8.010 (in <sup>2</sup> )

Tested By	KDG
Date	12-16-09
Press No.	1
Panel No.	B

Project Number	175569069
Test Number	CU-4A
Data File ID	CU-4B
Lateral Pressure (psi)	25.0
Chamber Pressure - $\sigma_3$ (psi)	90

Clock Time (min.)	Load (lbf)	Deflection Dial Reading (in.)	Pore Pressure Reading (psi)	Corrected Height (in.)	Strain (%)	Corrected Area (cm <sup>2</sup> )	Corrected Load (lbf)	Deviator Stress (tsf)	Corrected Deviator Stress* (tsf)	$\sigma_1$ (tsf)	$\sigma_1'$ (tsf)	$\sigma_3'$ (tsf)	$p' (\sigma_1' + \sigma_3')/2$ (tsf)	$q (\sigma_1 - \sigma_3)/2$ (tsf)	Effective Principal Stress Ratio $\sigma_1' / \sigma_3'$
0:00:00	12.0	-0.020	65.0	5.727	0.00	39.1976	0.0	0.000	0.000	1.800	1.800	1.802	1.801	-0.001	0.999
0:07:33	19.3	-0.014	65.1	5.721	0.10	39.2386	7.3	0.087	0.087	1.887	1.879	1.794	1.837	0.042	1.047
0:13:40	61.4	-0.009	69.1	5.715	0.20	39.2764	49.4	0.585	0.585	2.385	2.090	1.507	1.799	0.291	1.387
0:18:58	80.3	-0.003	71.9	5.709	0.30	39.3162	68.3	0.807	0.807	2.607	2.105	1.300	1.703	0.402	1.619
0:24:07	91.5	0.003	73.7	5.704	0.40	39.3552	79.5	0.939	0.938	2.738	2.113	1.176	1.645	0.468	1.796
0:29:17	99.3	0.009	75.1	5.698	0.50	39.3950	87.3	1.031	1.030	2.830	2.104	1.076	1.590	0.514	1.955
0:34:51	105.5	0.014	76.0	5.692	0.60	39.4350	93.4	1.102	1.100	2.900	2.109	1.010	1.560	0.549	2.087
0:39:58	110.6	0.020	76.6	5.686	0.70	39.4744	98.6	1.161	1.159	2.959	2.124	0.967	1.545	0.579	2.197
0:45:21	114.7	0.026	77.3	5.681	0.80	39.5144	102.7	1.208	1.206	3.006	2.119	0.914	1.517	0.602	2.317
0:50:46	118.8	0.032	77.7	5.675	0.90	39.5540	106.8	1.255	1.253	3.053	2.137	0.886	1.512	0.626	2.412
0:55:40	121.6	0.037	78.2	5.669	1.00	39.5943	109.6	1.287	1.285	3.085	2.134	0.851	1.492	0.642	2.508
1:01:02	125.0	0.043	78.4	5.664	1.10	39.6344	113.0	1.326	1.323	3.123	2.153	0.832	1.493	0.661	2.588
1:06:12	127.7	0.049	78.8	5.658	1.20	39.6745	115.7	1.356	1.353	3.153	2.160	0.808	1.484	0.676	2.672
1:11:28	130.4	0.055	78.9	5.652	1.30	39.7153	118.3	1.386	1.382	3.182	2.178	0.798	1.488	0.690	2.731
1:16:27	133.1	0.060	79.0	5.646	1.40	39.7550	121.0	1.416	1.412	3.212	2.202	0.792	1.497	0.705	2.781
1:21:36	135.4	0.066	79.3	5.641	1.50	39.7950	123.4	1.442	1.438	3.238	2.210	0.773	1.491	0.718	2.859
1:27:02	137.6	0.072	79.3	5.635	1.60	39.8356	125.6	1.467	1.463	3.263	2.231	0.770	1.501	0.730	2.896
1:32:01	140.0	0.077	79.5	5.629	1.70	39.8764	127.9	1.492	1.488	3.288	2.241	0.755	1.498	0.743	2.968
1:37:14	141.9	0.083	79.5	5.623	1.80	39.9170	129.9	1.513	1.508	3.308	2.260	0.754	1.507	0.753	2.999
1:42:32	144.2	0.089	79.6	5.618	1.90	39.9576	132.2	1.538	1.534	3.334	2.280	0.748	1.514	0.766	3.049
1:47:30	146.0	0.095	79.6	5.612	2.00	39.9982	134.0	1.558	1.553	3.353	2.297	0.746	1.522	0.776	3.079
1:53:04	148.1	0.100	79.6	5.606	2.10	40.0396	136.1	1.581	1.575	3.375	2.324	0.751	1.537	0.787	3.096
1:58:20	150.1	0.106	79.7	5.601	2.20	40.0800	138.0	1.601	1.596	3.396	2.334	0.740	1.537	0.797	3.155
2:03:50	151.7	0.112	79.7	5.595	2.30	40.1221	139.7	1.619	1.613	3.413	2.355	0.744	1.549	0.806	3.167
2:08:56	153.8	0.118	79.8	5.589	2.40	40.1630	141.8	1.642	1.636	3.436	2.365	0.731	1.548	0.817	3.235
2:14:24	155.4	0.123	79.7	5.583	2.50	40.2034	143.4	1.659	1.652	3.452	2.390	0.739	1.565	0.825	3.232
2:19:39	157.4	0.129	79.8	5.578	2.60	40.2450	145.4	1.680	1.673	3.473	2.406	0.735	1.570	0.836	3.275
2:24:48	159.3	0.135	79.7	5.572	2.70	40.2866	147.3	1.700	1.694	3.494	2.434	0.742	1.588	0.846	3.282
2:29:59	160.9	0.140	79.5	5.566	2.80	40.3278	148.9	1.717	1.710	3.510	2.467	0.759	1.613	0.854	3.251
2:35:10	162.7	0.146	79.7	5.560	2.90	40.3695	150.7	1.736	1.729	3.529	2.469	0.742	1.606	0.864	3.328
2:40:01	164.2	0.152	79.6	5.555	3.00	40.4110	152.2	1.751	1.744	3.544	2.493	0.751	1.622	0.871	3.319
2:45:06	165.7	0.158	79.7	5.549	3.10	40.4534	153.7	1.767	1.759	3.559	2.503	0.745	1.624	0.879	3.360
2:50:20	167.5	0.163	79.5	5.543	3.20	40.4944	155.5	1.786	1.778	3.578	2.535	0.758	1.646	0.888	3.343
2:55:16	169.3	0.169	79.5	5.538	3.30	40.5363	157.3	1.805	1.796	3.596	2.550	0.756	1.653	0.897	3.375
3:00:22	170.9	0.175	79.4	5.532	3.40	40.5783	158.8	1.820	1.812	3.612	2.574	0.764	1.669	0.905	3.369
3:05:35	172.5	0.181	79.4	5.526	3.50	40.6202	160.5	1.837	1.829	3.629	2.588	0.761	1.675	0.913	3.399
3:10:33	173.9	0.186	79.3	5.520	3.60	40.6626	161.9	1.851	1.842	3.642	2.611	0.771	1.691	0.920	3.388
3:15:40	175.6	0.192	79.3	5.515	3.70	40.7049	163.6	1.869	1.860	3.660	2.628	0.769	1.698	0.929	3.416
3:20:47	177.0	0.198	79.2	5.509	3.80	40.7472	165.0	1.883	1.873	3.673	2.651	0.779	1.715	0.936	3.403
3:25:52	178.1	0.203	79.2	5.503	3.90	40.7894	166.1	1.894	1.884	3.684	2.658	0.776	1.717	0.941	3.426
3:31:02	179.7	0.209	79.0	5.497	4.00	40.8321	167.6	1.909	1.899	3.699	2.692	0.795	1.743	0.949	3.388
3:36:15	181.1	0.215	79.1	5.492	4.10	40.8748	169.1	1.924	1.913	3.713	2.696	0.784	1.740	0.956	3.439
3:41:22	182.1	0.221	78.8	5.486	4.20	40.9174	170.1	1.933	1.922	3.722	2.726	0.806	1.766	0.960	3.383
3:46:34	183.6	0.226	79.0	5.480	4.30	40.9602	171.6	1.948	1.937	3.737	2.728	0.793	1.761	0.968	3.441
3:51:54	184.9	0.232	78.9	5.474	4.40	41.0033	172.9	1.961	1.950	3.750	2.746	0.797	1.771	0.974	3.445
3:57:13	186.1	0.238	78.9	5.469	4.50	41.0462	174.1	1.973	1.961	3.761	2.761	0.801	1.781	0.980	3.445
4:02:21	187.4	0.244	78.8	5.463	4.60	41.0891	175.3	1.984	1.973	3.773	2.775	0.804	1.789	0.986	3.453
4:07:36	188.7	0.249	78.8	5.457	4.70	41.1321	176.7	1.997	1.986	3.786	2.794	0.810	1.802	0.992	3.451
4:13:07	190.1	0.255	78.7	5.452	4.80	41.1755	178.0	2.011	1.999	3.799	2.808	0.811	1.810	0.999	3.462
4:18:22	191.2	0.261	78.6	5.446	4.90	41.2186	179.2	2.021	2.009	3.809	2.829	0.821	1.825	1.004	3.444
4:23:43	192.7	0.266	78.6	5.440	5.00	41.2620	180.7	2.037	2.024	3.824	2.843	0.821	1.832	1.011	3.465
4:29:11	194.0	0.272	78.4	5.434	5.10	41.3056	182.0	2.049	2.036	3.836	2.869	0.834	1.851	1.017	3.438
4:34:36	194.8	0.278	78.4	5.429	5.20	41.3492	182.8	2.055	2.043	3.843	2.876	0.835	1.856	1.020	3.443
4:39:44	196.1	0.284	78.1	5.423	5.30	41.3929	184.1	2.068	2.054	3.854	2.912	0.860	1.886	1.026	3.388
4:44:54	197.4	0.289	78.2	5.417	5.40	41.4367	185.4	2.080	2.067	3.867	2.911	0.846	1.879	1.033	3.440
4:50:07	198.4	0.295	77.9	5.411	5.50	41.4806	186.4	2.089	2.076	3.876	2.943	0.869	1.906	1.037	3.386
4:55:25	199.9	0.301	78.1	5.406	5.60	41.5245	187.9	2.104	2.090	3.890	2.945	0.856	1.901	1.044	3.438
5:00:39	201.2	0.307	78.0	5.400	5.70	41.5685	189.2	2.116	2.102	3.902	2.963	0.862	1.912	1.050	3.435
5:05:53	202.2	0.312	78.0	5.394	5.80	41.6127	190.2	2.125	2.111	3.911	2.975	0.866	1.920	1.055	3.436
5:11:07	203.0	0.318	77.9	5.389	5.90	41.6569	190.9	2.131	2.117	3.917	2.984	0.869	1.927	1.058	3.433

## Consolidated Undrained Triaxial Test EM 1110-2-1906 Appendix X

Consolidation Values			Final Values			Tested By <u>KDG</u>		Project Number <u>175569069</u>	
Height	<u>5.727 (in.)</u>	<u>14.546 (cm)</u>	Height	<u>4.672 (in.)</u>		Date	<u>12-16-09</u>	Test Number	<u>CU-4A</u>
Diameter	<u>2.781 (in)</u>	<u>7.065 (cm)</u>	Dia. avg.	<u>3.194 (in)</u>		Press No.	<u>1</u>	Data File ID	<u>CU-4B</u>
Area	<u>6.076 (in<sup>2</sup>)</u>	<u>39.198 (cm<sup>2</sup>)</u>	Area avg.	<u>8.010 (in<sup>2</sup>)</u>		Panel No.	<u>B</u>	Lateral Pressure (psi)	<u>25.0</u>
								Chamber Pressure - $\sigma_3$ (psi)	<u>90</u>

Clock Time (min.)	Load (lbf)	Deflection Dial Reading (in.)	Pore Pressure Reading (psi)	Corrected Height (in.)	Strain (%)	Corrected Area (cm <sup>2</sup> )	Corrected Load (lbf)	Deviator Stress (tsf)	Corrected Deviator Stress* (tsf)	$\sigma_1$ (tsf)	$\sigma_1'$ (tsf)	$\sigma_3'$ (tsf)	$p'$ ( $(\sigma_1' + \sigma_3')/2$ ) (tsf)	$q$ ( $(\sigma_1 - \sigma_3)/2$ ) (tsf)	Effective Principal Stress Ratio $\sigma_1' / \sigma_3'$
5:16:28	204.8	0.324	77.8	5.383	6.00	41.7012	192.8	2.150	2.135	3.935	3.009	0.876	1.943	1.067	3.436
5:21:46	205.6	0.330	77.8	5.377	6.10	41.7459	193.6	2.157	2.141	3.941	3.016	0.876	1.946	1.070	3.442
5:27:12	206.6	0.335	77.7	5.371	6.20	41.7902	194.6	2.166	2.150	3.950	3.036	0.888	1.962	1.074	3.419
5:32:27	208.3	0.341	77.7	5.366	6.30	41.8349	196.3	2.182	2.166	3.966	3.051	0.887	1.969	1.082	3.441
5:37:40	208.9	0.347	77.5	5.360	6.40	41.8798	196.9	2.186	2.170	3.970	3.067	0.899	1.983	1.084	3.412
5:43:06	209.7	0.352	77.5	5.354	6.50	41.9246	197.7	2.193	2.177	3.977	3.073	0.898	1.986	1.087	3.421
5:48:28	210.6	0.358	77.3	5.348	6.60	41.9693	198.6	2.200	2.184	3.984	3.094	0.912	2.003	1.091	3.392
5:53:52	211.9	0.364	77.4	5.343	6.71	42.0149	199.9	2.213	2.196	3.996	3.103	0.909	2.006	1.097	3.415
5:59:10	212.9	0.370	77.1	5.337	6.80	42.0598	200.9	2.221	2.204	4.004	3.131	0.929	2.030	1.101	3.371
6:04:28	213.8	0.375	77.2	5.331	6.90	42.1046	201.7	2.228	2.211	4.011	3.129	0.920	2.024	1.105	3.402
6:09:44	215.2	0.381	77.2	5.325	7.00	42.1501	203.2	2.242	2.224	4.024	3.147	0.924	2.035	1.111	3.406
6:15:04	216.2	0.387	77.1	5.320	7.10	42.1953	204.2	2.251	2.233	4.033	3.158	0.927	2.042	1.116	3.408
6:20:21	217.3	0.393	77.1	5.314	7.20	42.2409	205.3	2.260	2.242	4.042	3.170	0.930	2.050	1.120	3.410
6:25:31	218.7	0.398	77.0	5.308	7.31	42.2869	206.7	2.273	2.255	4.055	3.193	0.939	2.066	1.127	3.399
6:30:36	219.9	0.404	77.0	5.303	7.40	42.3322	207.8	2.283	2.265	4.065	3.202	0.939	2.071	1.131	3.409
6:35:40	220.8	0.410	76.8	5.297	7.50	42.3780	208.8	2.291	2.272	4.072	3.219	0.949	2.084	1.135	3.393
6:40:44	222.0	0.415	76.8	5.291	7.60	42.4239	210.0	2.302	2.283	4.083	3.231	0.949	2.090	1.141	3.403
6:45:49	223.3	0.421	76.7	5.285	7.71	42.4700	211.2	2.313	2.294	4.094	3.249	0.957	2.103	1.146	3.394
6:50:56	223.9	0.427	76.7	5.280	7.81	42.5163	211.9	2.318	2.298	4.098	3.253	0.957	2.105	1.148	3.401
6:55:56	224.6	0.433	76.6	5.274	7.91	42.5624	212.5	2.322	2.302	4.102	3.268	0.967	2.118	1.150	3.378
7:01:06	225.7	0.438	76.6	5.268	8.01	42.6089	213.7	2.332	2.312	4.112	3.275	0.964	2.120	1.155	3.396
7:06:12	226.4	0.444	76.4	5.262	8.11	42.6555	214.4	2.337	2.317	4.117	3.292	0.977	2.134	1.157	3.371
7:11:19	227.4	0.450	76.5	5.257	8.21	42.7014	215.4	2.346	2.325	4.125	3.297	0.974	2.136	1.162	3.386
7:16:38	228.4	0.456	76.3	5.251	8.31	42.7481	216.3	2.353	2.333	4.133	3.318	0.987	2.152	1.165	3.363
7:21:53	229.3	0.461	76.3	5.245	8.41	42.7949	217.3	2.361	2.340	4.140	3.323	0.984	2.153	1.169	3.375
7:27:03	229.8	0.467	76.1	5.240	8.51	42.8414	217.8	2.364	2.343	4.143	3.342	1.001	2.172	1.171	3.339
7:32:18	230.9	0.473	76.2	5.234	8.61	42.8882	218.9	2.373	2.351	4.151	3.340	0.990	2.165	1.175	3.372
7:37:40	231.7	0.478	76.1	5.228	8.71	42.9353	219.7	2.379	2.358	4.158	3.355	0.998	2.176	1.178	3.360
7:42:59	232.0	0.484	76.1	5.222	8.81	42.9827	220.0	2.380	2.358	4.158	3.357	1.000	2.179	1.178	3.356
7:48:13	233.1	0.490	76.1	5.217	8.91	43.0296	221.1	2.390	2.367	4.167	3.368	1.002	2.185	1.183	3.360
7:53:37	233.8	0.496	76.0	5.211	9.01	43.0772	221.8	2.394	2.372	4.172	3.378	1.008	2.193	1.185	3.351
7:58:59	234.6	0.501	76.0	5.205	9.11	43.1246	222.6	2.400	2.377	4.177	3.384	1.009	2.196	1.188	3.355
8:04:20	235.6	0.507	75.8	5.199	9.21	43.1722	223.6	2.409	2.386	4.186	3.404	1.020	2.212	1.192	3.338
8:09:47	236.3	0.513	75.9	5.194	9.31	43.2196	224.3	2.414	2.390	4.190	3.406	1.018	2.212	1.194	3.347
8:15:17	237.1	0.519	75.7	5.188	9.41	43.2672	225.1	2.419	2.395	4.195	3.425	1.031	2.228	1.197	3.321
8:20:41	237.7	0.524	75.7	5.182	9.51	43.3153	225.7	2.423	2.399	4.199	3.428	1.030	2.229	1.199	3.327
8:26:13	238.5	0.530	75.4	5.177	9.61	43.3630	226.5	2.429	2.405	4.205	3.455	1.052	2.254	1.202	3.284
8:31:47	239.4	0.536	75.6	5.171	9.71	43.4112	227.4	2.436	2.412	4.212	3.450	1.040	2.245	1.205	3.317
8:37:06	239.7	0.542	75.5	5.165	9.81	43.4595	227.6	2.436	2.411	4.211	3.453	1.044	2.248	1.205	3.309
8:42:21	241.1	0.547	75.4	5.159	9.91	43.5075	229.1	2.448	2.424	4.224	3.471	1.049	2.260	1.211	3.308
8:47:47	242.1	0.553	75.4	5.154	10.01	43.5560	230.1	2.456	2.432	4.232	3.479	1.049	2.264	1.215	3.317
8:53:01	242.2	0.559	75.3	5.148	10.11	43.6046	230.2	2.455	2.430	4.230	3.488	1.060	2.274	1.214	3.290
8:58:13	243.1	0.564	75.3	5.142	10.21	43.6529	231.1	2.462	2.436	4.236	3.496	1.061	2.278	1.217	3.294
9:03:42	244.0	0.570	75.1	5.136	10.31	43.7017	232.0	2.468	2.443	4.243	3.512	1.071	2.291	1.221	3.280
9:09:03	244.5	0.576	75.1	5.131	10.41	43.7509	232.5	2.471	2.445	4.245	3.514	1.071	2.293	1.222	3.283
9:14:20	245.0	0.582	74.9	5.125	10.51	43.7995	233.0	2.473	2.447	4.247	3.532	1.087	2.310	1.223	3.251
9:19:51	246.3	0.587	75.0	5.119	10.61	43.8491	234.3	2.485	2.458	4.258	3.537	1.080	2.308	1.228	3.274
9:25:05	246.3	0.593	74.9	5.114	10.71	43.8974	234.3	2.482	2.455	4.255	3.542	1.089	2.316	1.227	3.254
9:30:32	246.9	0.599	74.9	5.108	10.81	43.9468	234.9	2.485	2.458	4.258	3.546	1.089	2.318	1.228	3.255
9:36:02	247.2	0.605	74.9	5.102	10.91	43.9963	235.2	2.486	2.459	4.259	3.548	1.090	2.319	1.229	3.254
9:41:30	248.7	0.610	74.7	5.096	11.01	44.0459	236.7	2.499	2.472	4.272	3.569	1.098	2.333	1.235	3.249
9:46:54	248.7	0.616	74.8	5.091	11.11	44.0953	236.7	2.496	2.469	4.269	3.565	1.098	2.331	1.233	3.247
9:52:14	249.9	0.622	74.6	5.085	11.21	44.1451	237.8	2.505	2.478	4.278	3.586	1.110	2.348	1.238	3.230
9:57:39	250.3	0.627	74.6	5.079	11.31	44.1949	238.3	2.507	2.479	4.279	3.588	1.110	2.349	1.239	3.231
10:03:04	251.1	0.633	74.3	5.073	11.41	44.2445	239.1	2.513	2.485	4.285	3.613	1.130	2.371	1.242	3.198
10:08:19	251.4	0.639	74.4	5.068	11.51	44.2946	239.4	2.514	2.485	4.285	3.604	1.121	2.363	1.242	3.215
10:13:43	252.2	0.645	74.3	5.062	11.61	44.3457	240.2	2.519	2.490	4.290	3.617	1.128	2.372	1.244	3.205
10:19:00	253.4	0.650	74.3	5.056	11.71	44.3949	241.4	2.528	2.499	4.299	3.625	1.128	2.376	1.249	3.215
10:24:11	253.6	0.656	74.3	5.050	11.81	44.4454	241.6	2.528	2.498	4.298	3.627	1.130	2.379	1.248	3.209
10:29:23	254.9	0.662	74.2	5.045	11.91	44.4959	242.9	2.538	2.509	4.309	3.643	1.135	2.389	1.254	3.208

**Consolidated Undrained Triaxial Test  
EM 1110-2-1906 Appendix X**

Consolidation Values			Final Values			Tested By <u>KDG</u>		Project Number <u>175569069</u>	
Height	<u>5.727 (in.)</u>	<u>14.546 (cm)</u>	Height	<u>4.672 (in.)</u>		Date	<u>12-16-09</u>	Test Number	<u>CU-4A</u>
Diameter	<u>2.781 (in.)</u>	<u>7.065 (cm)</u>	Dia. avg.	<u>3.194 (in.)</u>		Press No.	<u>1</u>	Data File ID	<u>CU-4B</u>
Area	<u>6.076 (in<sup>2</sup>)</u>	<u>39.198 (cm<sup>2</sup>)</u>	Area avg.	<u>8.010 (in<sup>2</sup>)</u>		Panel No.	<u>B</u>	Lateral Pressure (psi)	<u>25.0</u>
								Chamber Pressure - $\sigma_3$ (psi)	<u>90</u>

Clock Time (min.)	Load (lbf)	Deflection Dial Reading (in.)	Pore Pressure Reading (psi)	Corrected Height (in.)	Strain (%)	Corrected Area (cm <sup>2</sup> )	Corrected Load (lbf)	Deviator Stress (tsf)	Corrected Deviator Stress* (tsf)	$\sigma_1$ (tsf)	$\sigma_1'$ (tsf)	$\sigma_3'$ (tsf)	$p' = (\sigma_1' + \sigma_3')/2$ (tsf)	$q = (\sigma_1 - \sigma_3)/2$ (tsf)	Effective Principal Stress Ratio $\sigma_1' / \sigma_3'$
10:34:42	255.7	0.668	74.2	5.039	12.01	44.5469	243.7	2.544	2.514	4.314	3.648	1.135	2.392	1.256	3.213
10:39:52	256.0	0.673	74.1	5.033	12.11	44.5974	244.0	2.544	2.514	4.314	3.656	1.144	2.400	1.256	3.197
10:45:07	257.1	0.679	74.2	5.028	12.21	44.6480	245.1	2.553	2.523	4.323	3.662	1.141	2.401	1.260	3.209
10:50:25	257.7	0.685	74.0	5.022	12.31	44.6989	245.7	2.556	2.525	4.325	3.674	1.151	2.412	1.262	3.193
10:55:39	258.4	0.690	74.1	5.016	12.41	44.7500	246.4	2.560	2.529	4.329	3.675	1.147	2.411	1.264	3.203
11:00:51	259.5	0.696	73.9	5.010	12.51	44.8014	247.4	2.568	2.537	4.337	3.694	1.159	2.427	1.268	3.188
11:06:15	259.9	0.702	74.0	5.005	12.61	44.8526	247.9	2.570	2.538	4.338	3.692	1.155	2.424	1.268	3.195
11:11:36	260.1	0.708	73.6	4.999	12.71	44.9042	248.1	2.569	2.538	4.338	3.713	1.177	2.445	1.268	3.154
11:16:52	261.1	0.713	73.8	4.993	12.81	44.9561	249.0	2.576	2.544	4.344	3.705	1.163	2.434	1.271	3.186
11:22:19	262.0	0.719	73.8	4.987	12.91	45.0073	250.0	2.583	2.551	4.351	3.712	1.163	2.438	1.275	3.192
11:27:45	262.5	0.725	73.8	4.982	13.01	45.0591	250.5	2.585	2.553	4.353	3.720	1.169	2.444	1.276	3.183
11:33:06	262.9	0.731	73.8	4.976	13.11	45.1111	250.8	2.586	2.553	4.353	3.720	1.168	2.444	1.276	3.184
11:38:31	263.3	0.736	73.7	4.970	13.21	45.1629	251.3	2.588	2.555	4.355	3.729	1.176	2.453	1.277	3.170
11:44:00	264.2	0.742	73.7	4.965	13.31	45.2150	252.2	2.594	2.561	4.361	3.731	1.172	2.452	1.280	3.183
11:49:33	264.8	0.748	73.5	4.959	13.41	45.2671	252.8	2.597	2.563	4.363	3.746	1.185	2.466	1.281	3.162
11:55:08	265.3	0.754	73.6	4.953	13.51	45.3199	253.3	2.599	2.565	4.365	3.745	1.181	2.463	1.282	3.170
12:00:43	265.9	0.759	73.5	4.947	13.61	45.3723	253.9	2.602	2.568	4.368	3.758	1.192	2.475	1.283	3.154
12:06:22	266.1	0.765	73.5	4.942	13.71	45.4246	254.1	2.601	2.567	4.367	3.753	1.187	2.470	1.283	3.161
12:11:58	267.0	0.771	73.5	4.936	13.81	45.4774	255.0	2.607	2.573	4.373	3.759	1.187	2.473	1.286	3.166
12:17:38	267.6	0.776	73.4	4.930	13.91	45.5304	255.6	2.610	2.576	4.376	3.769	1.195	2.482	1.287	3.154
12:23:13	267.9	0.782	73.5	4.924	14.01	45.5833	255.9	2.610	2.575	4.375	3.765	1.191	2.478	1.287	3.161
12:28:49	268.5	0.788	73.3	4.919	14.11	45.6363	256.5	2.614	2.579	4.379	3.781	1.204	2.492	1.289	3.141
12:34:27	269.6	0.794	73.3	4.913	14.21	45.6896	257.6	2.622	2.587	4.387	3.784	1.199	2.492	1.292	3.156
12:39:53	270.5	0.799	73.2	4.907	14.31	45.7428	258.5	2.627	2.592	4.392	3.799	1.209	2.504	1.295	3.142
12:45:24	270.6	0.805	73.3	4.901	14.41	45.7969	258.6	2.625	2.590	4.390	3.792	1.205	2.498	1.294	3.148
12:50:55	271.7	0.811	73.3	4.896	14.51	45.8500	259.7	2.634	2.598	4.398	3.800	1.204	2.502	1.298	3.156
12:56:25	272.0	0.817	73.2	4.890	14.61	45.9040	260.0	2.634	2.598	4.398	3.807	1.211	2.509	1.298	3.144
13:01:52	272.4	0.822	73.2	4.884	14.71	45.9576	260.4	2.634	2.598	4.398	3.805	1.208	2.507	1.298	3.148
13:07:29	273.3	0.828	73.1	4.879	14.81	46.0115	261.3	2.641	2.604	4.404	3.820	1.218	2.519	1.301	3.137
13:13:00	273.6	0.834	73.1	4.873	14.91	46.0658	261.6	2.640	2.603	4.403	3.816	1.214	2.515	1.301	3.142
13:18:34	273.2	0.840	72.9	4.867	15.01	46.1202	261.1	2.633	2.596	4.396	3.829	1.235	2.532	1.297	3.101
13:24:07	274.1	0.845	73.0	4.861	15.11	46.1740	262.1	2.640	2.602	4.402	3.822	1.221	2.521	1.300	3.129
13:29:45	274.9	0.851	73.0	4.856	15.21	46.2286	262.9	2.645	2.607	4.407	3.826	1.221	2.524	1.303	3.133
13:35:22	275.2	0.857	73.0	4.850	15.31	46.2836	263.2	2.645	2.607	4.407	3.832	1.227	2.529	1.302	3.123
13:40:45	275.5	0.862	73.0	4.844	15.41	46.3379	263.5	2.644	2.606	4.406	3.830	1.226	2.528	1.302	3.125
13:46:17	276.8	0.868	72.9	4.838	15.51	46.3929	264.8	2.654	2.615	4.415	3.846	1.233	2.539	1.307	3.121
13:51:38	276.9	0.874	72.9	4.833	15.61	46.4481	264.9	2.652	2.613	4.413	3.841	1.229	2.535	1.306	3.125
13:57:05	277.2	0.880	72.8	4.827	15.71	46.5029	265.2	2.652	2.613	4.413	3.853	1.242	2.547	1.306	3.103
14:02:31	278.5	0.885	72.8	4.821	15.81	46.5582	266.5	2.662	2.622	4.422	3.857	1.236	2.547	1.310	3.120
14:07:57	278.8	0.891	72.6	4.816	15.91	46.6139	266.8	2.662	2.622	4.422	3.870	1.249	2.560	1.310	3.097
14:13:17	279.5	0.897	72.8	4.810	16.01	46.6694	267.4	2.665	2.625	4.425	3.864	1.241	2.552	1.312	3.115
14:18:37	280.1	0.903	72.8	4.804	16.11	46.7249	268.1	2.668	2.628	4.428	3.868	1.242	2.555	1.313	3.116
14:23:52	280.5	0.908	72.7	4.798	16.21	46.7808	268.4	2.668	2.628	4.428	3.874	1.248	2.561	1.313	3.105
14:29:10	281.0	0.914	72.7	4.793	16.31	46.8367	269.0	2.670	2.630	4.430	3.873	1.245	2.559	1.314	3.111
14:34:22	281.5	0.920	72.6	4.787	16.41	46.8927	269.5	2.672	2.631	4.431	3.881	1.251	2.566	1.315	3.102
14:39:37	282.0	0.925	72.7	4.781	16.51	46.9493	270.0	2.674	2.633	4.433	3.881	1.249	2.565	1.316	3.107
14:44:58	282.6	0.931	72.6	4.775	16.61	47.0055	270.6	2.677	2.636	4.436	3.889	1.255	2.572	1.317	3.099
14:50:10	283.3	0.937	72.6	4.770	16.71	47.0617	271.3	2.680	2.639	4.439	3.891	1.254	2.572	1.319	3.104
14:55:39	283.7	0.943	72.5	4.764	16.81	47.1182	271.7	2.681	2.639	4.439	3.901	1.264	2.582	1.319	3.087
15:01:04	284.0	0.948	72.5	4.758	16.91	47.1749	272.0	2.681	2.639	4.439	3.897	1.259	2.578	1.319	3.094
15:06:18	284.0	0.954	72.3	4.752	17.01	47.2323	272.0	2.678	2.635	4.435	3.910	1.276	2.593	1.317	3.064
15:11:37	284.5	0.960	72.4	4.747	17.11	47.2893	272.5	2.679	2.637	4.437	3.901	1.266	2.583	1.317	3.082
15:17:06	285.5	0.966	72.4	4.741	17.21	47.3464	273.5	2.686	2.643	4.443	3.909	1.267	2.588	1.321	3.084
15:22:16	285.0	0.971	72.4	4.735	17.31	47.4033	273.0	2.678	2.635	4.435	3.902	1.269	2.585	1.317	3.076
15:27:40	285.8	0.977	72.4	4.730	17.41	47.4609	273.8	2.682	2.639	4.439	3.904	1.267	2.585	1.319	3.082
15:33:10	286.4	0.983	72.3	4.724	17.51	47.5184	274.4	2.685	2.642	4.442	3.913	1.273	2.593	1.320	3.074
15:38:31	286.5	0.989	72.3	4.718	17.61	47.5767	274.5	2.683	2.639	4.439	3.910	1.272	2.591	1.319	3.073
15:43:56	287.3	0.994	72.2	4.712	17.71	47.6341	275.2	2.687	2.643	4.443	3.920	1.279	2.599	1.321	3.066
15:49:26	287.5	1.000	72.3	4.707	17.81	47.6921	275.5	2.686	2.641	4.441	3.914	1.274	2.594	1.320	3.072
15:54:55	287.5	1.006	72.1	4.701	17.91	47.7500	275.5	2.683	2.638	4.438	3.923	1.286	2.605	1.318	3.050

## Consolidated Undrained Triaxial Test EM 1110-2-1906 Appendix X

Consolidation Values		
Height	5.727 (in.)	14.546 (cm)
Diameter	2.781 (in)	7.065 (cm)
Area	6.076 (in <sup>2</sup> )	39.198 (cm <sup>2</sup> )

Final Values		
Height	4.672 (in.)	
Dia. avg.	3.194 (in)	
Area avg.	8.010 (in <sup>2</sup> )	

Tested By	KDG
Date	12-16-09
Press No.	1
Panel No.	B

Project Number	175589069
Test Number	CU-4A
Data File ID	CU-4B
Lateral Pressure (psi)	25.0
Chamber Pressure - $\sigma_3$ (psi)	90

Clock Time (min.)	Load (lbf)	Deflection Dial Reading (in.)	Pore Pressure Reading (psi)	Corrected Height (in.)	Strain (%)	Corrected Area (cm <sup>2</sup> )		Corrected Load (lbf)	Deviator Stress (tsf)	Corrected Deviator Stress* (tsf)	$\sigma_1$ (tsf)	$\sigma_1'$ (tsf)	$\sigma_3'$ (tsf)	$p'$ ( $(\sigma_1' + \sigma_3')/2$ ) (tsf)	$q$ ( $(\sigma_1 - \sigma_3)/2$ ) (tsf)	Effective Principal Stress Ratio $\sigma_1' / \sigma_3'$
						Corrected Area	Corrected Area									
16:00:33	287.7	1.011	72.2	4.695	18.01	47.8085	275.7	2.682	2.637	4.437	3.915	1.280	2.598	1.318	3.058	
16:06:13	288.1	1.017	72.1	4.689	18.11	47.8672	276.1	2.682	2.637	4.437	3.921	1.286	2.603	1.318	3.050	
16:11:51	288.3	1.023	72.2	4.684	18.21	47.9255	276.3	2.681	2.635	4.435	3.919	1.285	2.602	1.317	3.049	
16:17:23	288.5	1.029	72.2	4.678	18.31	47.9842	276.5	2.679	2.634	4.434	3.916	1.284	2.600	1.316	3.049	
16:23:00	289.3	1.034	72.1	4.672	18.41	48.0430	277.3	2.684	2.638	4.438	3.928	1.291	2.609	1.318	3.042	

**Consolidated Undrained Triaxial Test  
EM 1110-2-1906 Appendix X**

Consolidation Values		
Height	5.414 (in.)	13.752 (cm)
Diameter	2.762 (in.)	7.016 (cm)
Area	5.993 (in <sup>2</sup> )	38.665 (cm <sup>2</sup> )

Final Values		
Height	4.479 (in.)	
Dia. avg.	3.179 (in.)	
Area avg.	7.935 (in <sup>2</sup> )	

Tested By	KDG
Date	12-19-09
Press No.	2
Panel No.	D

Project Number	175569069
Test Number	CU-4B
Data File ID	466
Lateral Pressure (psi)	35.0
Chamber Pressure - $\sigma_3$ (psi)	90

Clock Time (min.)	Load (lbf)	Deflection Dial Reading (in.)	Pore Pressure Reading (psi)	Corrected Height (in.)	Strain (%)	Corrected Area (cm <sup>2</sup> )	Corrected Load (lbf)	Deviator Stress (tsf)	Corrected Deviator Stress* (tsf)	$\sigma_1$ (tsf)	$\sigma_1'$ (tsf)	$\sigma_3'$ (tsf)	$p'$ ( $(\sigma_1' + \sigma_3')/2$ ) (tsf)	$q$ ( $(\sigma_1 - \sigma_3)/2$ ) (tsf)	Effective
															Principal Stress Ratio $\sigma_1' / \sigma_3'$
0:00:00	14.2	0.001	55.0	5.414	0.00	38.6647	0.0	0.000	0.000	2.520	2.520	2.517	2.519	0.001	1.001
0:06:30	39.0	0.007	57.0	5.409	0.10	38.7046	24.8	0.298	0.297	2.817	2.678	2.378	2.528	0.150	1.126
0:13:35	81.0	0.012	60.9	5.403	0.20	38.7441	66.8	0.802	0.801	3.321	2.899	2.095	2.497	0.402	1.384
0:17:56	109.5	0.018	64.8	5.398	0.31	38.7836	95.3	1.142	1.142	3.662	2.960	1.816	2.388	0.572	1.630
0:22:05	125.1	0.023	67.1	5.392	0.41	38.8229	110.9	1.328	1.327	3.847	2.981	1.652	2.317	0.665	1.805
0:26:17	135.4	0.029	69.0	5.387	0.51	38.8622	121.2	1.450	1.449	3.969	2.963	1.512	2.238	0.726	1.960
0:30:33	143.3	0.034	70.4	5.381	0.61	38.9022	129.1	1.543	1.541	4.061	2.957	1.413	2.185	0.772	2.093
0:34:44	148.6	0.040	71.4	5.376	0.71	38.9431	134.4	1.605	1.603	4.123	2.942	1.336	2.139	0.803	2.202
0:38:55	153.8	0.045	72.4	5.370	0.81	38.9817	139.6	1.665	1.663	4.183	2.933	1.267	2.100	0.833	2.314
0:43:09	158.2	0.051	73.0	5.365	0.92	39.0221	144.0	1.716	1.714	4.234	2.941	1.224	2.082	0.858	2.403
0:47:22	161.9	0.056	73.8	5.359	1.02	39.0622	147.7	1.758	1.756	4.276	2.926	1.167	2.046	0.879	2.506
0:51:36	165.6	0.062	74.1	5.354	1.12	39.1028	151.4	1.800	1.797	4.317	2.943	1.143	2.043	0.900	2.575
0:55:33	168.7	0.067	74.7	5.348	1.22	39.1420	154.5	1.835	1.832	4.352	2.939	1.104	2.021	0.917	2.662
0:59:58	171.7	0.073	75.0	5.343	1.32	39.1828	157.5	1.869	1.866	4.386	2.950	1.082	2.016	0.934	2.727
1:04:10	174.8	0.078	75.1	5.337	1.42	39.2230	160.6	1.904	1.900	4.420	2.973	1.070	2.021	0.952	2.779
1:08:23	177.6	0.084	75.6	5.332	1.52	39.2631	163.4	1.935	1.932	4.452	2.973	1.039	2.006	0.967	2.862
1:12:39	180.6	0.089	75.7	5.326	1.63	39.3038	166.4	1.969	1.965	4.485	2.997	1.030	2.013	0.984	2.911
1:17:02	183.3	0.095	76.1	5.321	1.73	39.3442	169.1	1.998	1.994	4.514	2.999	1.002	2.000	0.998	2.992
1:21:18	185.8	0.100	76.2	5.315	1.83	39.3855	171.5	2.025	2.021	4.541	3.017	0.994	2.006	1.012	3.036
1:25:56	188.5	0.106	76.5	5.310	1.93	39.4266	174.2	2.055	2.050	4.570	3.029	0.976	2.002	1.027	3.105
1:30:17	191.1	0.111	76.5	5.304	2.03	39.4666	176.8	2.084	2.079	4.599	3.054	0.972	2.013	1.041	3.140
1:34:50	193.1	0.117	76.7	5.299	2.14	39.5086	178.9	2.106	2.100	4.620	3.064	0.961	2.013	1.052	3.189
1:39:16	195.5	0.122	76.7	5.293	2.24	39.5490	181.3	2.132	2.126	4.646	3.088	0.959	2.024	1.065	3.220
1:43:35	198.1	0.128	76.7	5.288	2.34	39.5901	183.8	2.159	2.153	4.673	3.112	0.956	2.034	1.078	3.257
1:48:03	200.0	0.133	76.8	5.282	2.44	39.6327	185.8	2.180	2.174	4.694	3.127	0.951	2.039	1.088	3.289
1:52:24	202.3	0.139	76.6	5.277	2.54	39.6742	188.1	2.204	2.198	4.718	3.165	0.964	2.065	1.100	3.282
1:56:49	204.8	0.144	76.9	5.271	2.64	39.7143	190.6	2.231	2.225	4.745	3.171	0.943	2.057	1.114	3.361
2:01:08	206.7	0.150	76.8	5.266	2.75	39.7570	192.5	2.252	2.245	4.765	3.197	0.950	2.074	1.124	3.366
2:05:31	208.9	0.155	77.0	5.260	2.85	39.7978	194.7	2.275	2.267	4.787	3.209	0.938	2.074	1.135	3.419
2:09:50	210.7	0.161	76.9	5.255	2.95	39.8386	196.5	2.294	2.286	4.806	3.233	0.944	2.088	1.144	3.426
2:14:06	212.9	0.166	77.0	5.249	3.05	39.8802	198.7	2.316	2.309	4.829	3.249	0.937	2.093	1.156	3.466
2:18:27	214.6	0.172	76.9	5.244	3.15	39.9223	200.4	2.334	2.326	4.846	3.271	0.942	2.106	1.165	3.473
2:22:50	216.9	0.177	76.9	5.238	3.25	39.9638	202.7	2.358	2.350	4.870	3.293	0.940	2.117	1.177	3.503
2:27:14	218.7	0.183	76.9	5.233	3.35	40.0061	204.5	2.377	2.368	4.888	3.312	0.941	2.126	1.186	3.521
2:31:37	220.9	0.188	76.7	5.227	3.45	40.0483	206.6	2.399	2.391	4.911	3.354	0.960	2.157	1.197	3.493
2:36:10	223.0	0.194	76.9	5.222	3.56	40.0909	208.8	2.422	2.413	4.933	3.358	0.942	2.150	1.208	3.563
2:40:34	224.2	0.199	76.8	5.216	3.66	40.1333	210.0	2.433	2.424	4.944	3.379	0.953	2.166	1.213	3.546
2:44:52	226.2	0.205	76.9	5.211	3.76	40.1749	212.0	2.454	2.444	4.964	3.390	0.943	2.167	1.223	3.593
2:49:16	228.1	0.210	76.8	5.205	3.86	40.2172	213.8	2.472	2.463	4.983	3.419	0.953	2.186	1.233	3.586
2:53:42	230.0	0.216	76.8	5.200	3.96	40.2603	215.7	2.492	2.482	5.002	3.434	0.949	2.192	1.242	3.617
2:58:05	231.6	0.221	76.7	5.194	4.07	40.3036	217.4	2.508	2.498	5.018	3.456	0.955	2.205	1.250	3.619
3:02:24	233.7	0.227	76.7	5.189	4.17	40.3468	219.5	2.530	2.519	5.039	3.481	0.959	2.220	1.261	3.630
3:06:40	234.5	0.232	76.6	5.183	4.27	40.3882	220.3	2.537	2.526	5.046	3.494	0.965	2.230	1.264	3.620
3:10:58	236.2	0.238	76.1	5.178	4.37	40.4311	222.0	2.553	2.542	5.062	3.543	0.998	2.270	1.272	3.550
3:15:14	237.9	0.243	76.5	5.172	4.47	40.4742	223.7	2.570	2.559	5.079	3.534	0.973	2.253	1.281	3.633
3:19:30	239.4	0.249	76.3	5.167	4.57	40.5178	225.2	2.585	2.573	5.093	3.562	0.986	2.274	1.288	3.614
3:23:32	240.9	0.254	76.4	5.161	4.67	40.5603	226.6	2.598	2.587	5.107	3.567	0.977	2.272	1.295	3.650
3:27:48	242.0	0.260	76.3	5.156	4.77	40.6035	227.7	2.608	2.596	5.116	3.587	0.989	2.288	1.299	3.629
3:31:57	242.9	0.265	76.3	5.150	4.88	40.6478	228.7	2.616	2.604	5.124	3.595	0.989	2.292	1.303	3.637
3:36:03	243.4	0.271	76.2	5.145	4.98	40.6904	229.2	2.619	2.607	5.127	3.601	0.991	2.296	1.305	3.633
3:40:14	244.1	0.276	75.8	5.139	5.08	40.7338	229.9	2.625	2.612	5.132	3.636	1.021	2.329	1.307	3.560
3:44:30	245.3	0.282	76.1	5.134	5.18	40.7783	231.1	2.635	2.622	5.142	3.625	1.000	2.313	1.312	3.623
3:48:49	247.1	0.287	76.0	5.128	5.28	40.8217	232.9	2.652	2.639	5.159	3.651	1.009	2.330	1.321	3.618
3:53:10	248.6	0.293	76.1	5.123	5.38	40.8652	234.4	2.667	2.654	5.174	3.659	1.003	2.331	1.328	3.649
3:57:26	249.7	0.298	75.9	5.117	5.49	40.9091	235.5	2.677	2.663	5.183	3.681	1.015	2.348	1.333	3.627
4:01:39	251.5	0.304	75.9	5.112	5.59	40.9528	237.2	2.694	2.680	5.200	3.695	1.012	2.354	1.341	3.650
4:05:55	252.4	0.309	75.8	5.106	5.69	40.9973	238.2	2.702	2.687	5.207	3.712	1.022	2.367	1.345	3.633
4:10:17	253.8	0.315	75.7	5.101	5.79	41.0412	239.6	2.715	2.700	5.220	3.731	1.028	2.379	1.352	3.630
4:14:38	255.6	0.320	75.7	5.095	5.89	41.0864	241.4	2.732	2.717	5.237	3.749	1.029	2.389	1.360	3.643
4:18:59	257.0	0.326	75.4	5.090	5.99	41.1301	242.8	2.745	2.730	5.250	3.785	1.052	2.418	1.366	3.598

**Consolidated Undrained Triaxial Test  
EM 1110-2-1906 Appendix X**

Consolidation Values			Final Values			Tested By <u>KDG</u>		Project Number <u>175569069</u>	
Height	<u>5.414 (in.)</u>	<u>13.752 (cm)</u>	Height	<u>4.479 (in.)</u>		Date	<u>12-19-09</u>	Test Number	<u>CU-4B</u>
Diameter	<u>2.762 (in)</u>	<u>7.016 (cm)</u>	Dia. avg.	<u>3.179 (in)</u>		Press No.	<u>2</u>	Data File ID	<u>4BB</u>
Area	<u>5.993 (in<sup>2</sup>)</u>	<u>38.665 (cm<sup>2</sup>)</u>	Area avg.	<u>7.935 (in<sup>2</sup>)</u>		Panel No.	<u>D</u>	Lateral Pressure (psi)	<u>35.0</u>
								Chamber Pressure - $\sigma_3$ (psi)	<u>90</u>

Clock Time (min.)	Load (lbf)	Deflection Dial Reading (in.)	Pore Pressure Reading (psi)	Corrected Height (in.)	Strain (%)	Corrected Area (cm <sup>2</sup> )	Corrected Load (lbf)	Deviator Stress (tsf)	Corrected Deviator Stress* (tsf)	$\sigma_1$ (tsf)	$\sigma_1'$ (tsf)	$\sigma_3'$ (tsf)	$p'$ ( $(\sigma_1' + \sigma_3')/2$ ) (tsf)	$q$ ( $(\sigma_1 - \sigma_3)/2$ ) (tsf)	Effective
															Principal Stress Ratio $\sigma_1' / \sigma_3'$
4:23:19	258.6	0.331	75.6	5.084	6.10	41.1744	244.4	2.760	2.745	5.265	3.784	1.036	2.410	1.374	3.651
4:27:43	260.0	0.337	75.4	5.079	6.20	41.2195	245.8	2.773	2.757	5.277	3.810	1.050	2.430	1.380	3.628
4:32:01	261.4	0.342	75.5	5.073	6.30	41.2641	247.2	2.785	2.770	5.290	3.819	1.046	2.433	1.386	3.650
4:36:25	262.8	0.348	75.3	5.068	6.40	41.3087	248.6	2.798	2.782	5.302	3.841	1.056	2.449	1.393	3.636
4:40:50	264.1	0.353	75.3	5.062	6.50	41.3534	249.9	2.810	2.793	5.313	3.853	1.057	2.455	1.398	3.646
4:44:57	268.2	0.359	75.4	5.057	6.60	41.3982	254.0	2.852	2.836	5.356	3.888	1.049	2.468	1.419	3.706
4:47:50	269.6	0.364	75.1	5.051	6.71	41.4436	255.4	2.866	2.849	5.369	3.922	1.070	2.496	1.426	3.664
4:50:43	271.0	0.370	75.2	5.046	6.81	41.4894	256.8	2.878	2.861	5.381	3.926	1.062	2.494	1.432	3.696
4:53:31	271.8	0.375	75.1	5.040	6.91	41.5341	257.5	2.883	2.866	5.386	3.941	1.072	2.506	1.434	3.677
4:56:22	272.8	0.381	75.0	5.035	7.01	41.5793	258.6	2.892	2.875	5.395	3.957	1.080	2.518	1.439	3.665
4:59:13	273.7	0.386	74.9	5.029	7.11	41.6249	259.5	2.899	2.881	5.401	3.968	1.084	2.526	1.442	3.661
5:02:03	274.6	0.392	74.9	5.024	7.21	41.6705	260.4	2.905	2.887	5.407	3.974	1.084	2.529	1.445	3.666
5:04:54	276.0	0.397	74.9	5.018	7.31	41.7162	261.8	2.918	2.900	5.420	3.994	1.091	2.542	1.451	3.661
5:07:47	276.8	0.403	74.6	5.013	7.42	41.7623	262.6	2.924	2.905	5.425	4.019	1.111	2.565	1.454	3.619
5:10:38	277.7	0.408	74.8	5.007	7.52	41.8079	263.5	2.931	2.912	5.432	4.011	1.096	2.554	1.457	3.659
5:13:26	278.8	0.414	74.7	5.002	7.62	41.8543	264.6	2.939	2.920	5.440	4.027	1.104	2.566	1.461	3.647
5:16:15	279.9	0.419	74.5	4.996	7.72	41.8995	265.7	2.949	2.929	5.449	4.046	1.114	2.580	1.466	3.633
5:19:01	280.8	0.425	74.5	4.991	7.82	41.9457	266.6	2.955	2.935	5.455	4.052	1.114	2.583	1.469	3.637
5:21:51	281.9	0.430	74.5	4.985	7.92	41.9926	267.7	2.964	2.944	5.464	4.062	1.115	2.588	1.474	3.644
5:24:42	282.9	0.436	74.4	4.980	8.03	42.0387	268.7	2.972	2.952	5.472	4.076	1.122	2.599	1.477	3.633
5:27:30	283.6	0.441	74.1	4.974	8.13	42.0849	269.3	2.976	2.956	5.476	4.104	1.145	2.624	1.479	3.583
5:30:21	285.0	0.447	74.3	4.969	8.23	42.1321	270.8	2.988	2.968	5.488	4.098	1.127	2.612	1.485	3.635
5:33:11	285.8	0.452	74.2	4.963	8.33	42.1781	271.6	2.994	2.973	5.493	4.111	1.135	2.623	1.488	3.622
5:36:02	286.8	0.458	74.1	4.958	8.43	42.2251	272.6	3.002	2.981	5.501	4.128	1.144	2.636	1.492	3.607
5:38:55	287.8	0.463	74.2	4.952	8.53	42.2723	273.6	3.010	2.988	5.508	4.131	1.140	2.635	1.496	3.625
5:41:44	288.7	0.469	74.1	4.947	8.64	42.3191	274.5	3.016	2.995	5.515	4.142	1.145	2.643	1.499	3.619
5:44:35	289.7	0.474	74.0	4.941	8.74	42.3661	275.5	3.024	3.002	5.522	4.158	1.153	2.655	1.503	3.607
5:47:25	290.8	0.480	73.4	4.936	8.84	42.4134	276.6	3.033	3.010	5.530	4.211	1.198	2.704	1.507	3.516
5:50:14	291.4	0.485	74.0	4.930	8.94	42.4607	277.2	3.036	3.013	5.533	4.171	1.155	2.663	1.508	3.612
5:52:57	292.5	0.491	73.9	4.925	9.04	42.5078	278.3	3.044	3.021	5.541	4.186	1.162	2.674	1.512	3.602
5:55:48	293.2	0.496	73.7	4.919	9.14	42.5557	279.0	3.048	3.025	5.545	4.200	1.173	2.686	1.514	3.582
5:58:34	294.0	0.502	73.8	4.914	9.24	42.6032	279.8	3.054	3.031	5.551	4.201	1.168	2.685	1.517	3.597
6:01:22	294.6	0.507	73.7	4.908	9.35	42.6510	280.4	3.057	3.034	5.554	4.211	1.175	2.693	1.518	3.585
6:04:13	295.5	0.513	73.6	4.903	9.45	42.6991	281.3	3.063	3.040	5.560	4.222	1.180	2.701	1.521	3.579
6:07:01	295.6	0.518	73.2	4.897	9.55	42.7470	281.4	3.061	3.037	5.557	4.246	1.206	2.726	1.520	3.520
6:09:47	296.8	0.524	73.6	4.892	9.65	42.7956	282.6	3.070	3.046	5.566	4.232	1.183	2.707	1.524	3.578
6:12:36	298.1	0.529	73.5	4.886	9.75	42.8431	283.8	3.081	3.056	5.576	4.249	1.190	2.719	1.530	3.571
6:15:24	298.1	0.535	73.3	4.881	9.85	42.8914	283.9	3.078	3.053	5.573	4.256	1.201	2.729	1.528	3.545
6:18:12	299.1	0.540	73.4	4.875	9.96	42.9399	284.9	3.085	3.060	5.580	4.257	1.195	2.726	1.531	3.564
6:21:03	299.8	0.546	73.3	4.870	10.06	42.9882	285.5	3.089	3.063	5.583	4.266	1.200	2.733	1.533	3.555
6:23:51	300.5	0.551	73.2	4.864	10.16	43.0368	286.3	3.094	3.068	5.588	4.277	1.206	2.742	1.536	3.546
6:26:42	301.2	0.557	73.1	4.859	10.26	43.0855	286.9	3.097	3.071	5.591	4.294	1.220	2.757	1.537	3.520
6:29:35	301.7	0.562	73.2	4.853	10.36	43.1345	287.4	3.099	3.073	5.593	4.283	1.207	2.745	1.538	3.548
6:32:26	302.6	0.568	73.2	4.848	10.46	43.1835	288.4	3.106	3.080	5.600	4.295	1.213	2.754	1.541	3.541
6:35:19	303.3	0.573	73.0	4.842	10.57	43.2326	289.1	3.109	3.083	5.603	4.313	1.227	2.770	1.543	3.514
6:38:12	304.3	0.579	73.1	4.837	10.67	43.2821	290.1	3.117	3.090	5.610	4.310	1.218	2.764	1.546	3.540
6:41:08	304.8	0.584	73.0	4.831	10.77	43.3312	290.6	3.118	3.091	5.611	4.319	1.225	2.772	1.547	3.526
6:44:01	305.5	0.590	72.9	4.826	10.87	43.3800	291.3	3.123	3.095	5.615	4.331	1.233	2.782	1.549	3.513
6:46:59	306.1	0.595	72.9	4.820	10.97	43.4302	291.9	3.125	3.098	5.618	4.333	1.232	2.782	1.550	3.516
6:49:52	307.0	0.601	72.9	4.815	11.07	43.4792	292.8	3.131	3.104	5.624	4.340	1.234	2.787	1.553	3.517
6:52:52	308.0	0.606	72.7	4.809	11.18	43.5292	293.8	3.139	3.111	5.631	4.356	1.243	2.800	1.557	3.505
6:55:48	308.0	0.612	72.2	4.804	11.28	43.5789	293.8	3.135	3.107	5.627	4.390	1.280	2.835	1.555	3.430
6:58:44	308.7	0.617	72.7	4.798	11.38	43.6291	294.5	3.139	3.110	5.630	4.361	1.248	2.805	1.557	3.495
7:01:37	309.2	0.623	72.6	4.793	11.48	43.6787	295.0	3.141	3.112	5.632	4.369	1.254	2.812	1.557	3.483
7:04:35	309.8	0.628	72.4	4.787	11.58	43.7288	295.6	3.143	3.114	5.634	4.384	1.267	2.826	1.559	3.460
7:07:33	310.2	0.634	72.5	4.782	11.68	43.7797	296.0	3.143	3.114	5.634	4.377	1.260	2.819	1.558	3.473
7:10:31	311.1	0.639	72.5	4.776	11.78	43.8296	296.9	3.150	3.121	5.641	4.387	1.263	2.825	1.562	3.473
7:13:31	311.7	0.645	72.4	4.771	11.89	43.8802	297.4	3.152	3.122	5.642	4.396	1.271	2.833	1.563	3.459
7:16:29	311.9	0.650	72.4	4.765	11.99	43.9311	297.7	3.151	3.121	5.641	4.392	1.268	2.830	1.562	3.463
7:19:30	312.6	0.656	72.4	4.760	12.09	43.9821	298.3	3.154	3.124	5.644	4.397	1.270	2.833	1.563	3.462



**Consolidated Undrained Triaxial Test  
EM 1110-2-1906 Appendix X**

Consolidation Values			Final Values			Tested By <u>KDG</u>		Project Number <u>175569069</u>	
Height	<u>5.414 (in.)</u>	<u>13.752 (cm)</u>	Height	<u>4.479 (in.)</u>		Date	<u>12-19-09</u>	Test Number	<u>CU-4B</u>
Diameter	<u>2.762 (in)</u>	<u>7.016 (cm)</u>	Dia. avg.	<u>3.179 (in)</u>		Press No.	<u>2</u>	Data File ID	<u>4BB</u>
Area	<u>5.993 (in<sup>2</sup>)</u>	<u>38.665 (cm<sup>2</sup>)</u>	Area avg.	<u>7.935 (in<sup>2</sup>)</u>		Panel No.	<u>D</u>	Lateral Pressure (psi)	<u>35.0</u>
								Chamber Pressure - $\sigma_3$ (psi)	<u>90</u>

Clock Time (min.)	Load (lbf)	Deflection Dial Reading (in.)	Pore Pressure Reading (psi)	Corrected Height (in.)	Strain (%)	Corrected Area (cm <sup>2</sup> )	Corrected Load (lbf)	Deviator Stress (tsf)	Corrected Deviator Stress* (tsf)	$\sigma_1$ (tsf)	$\sigma_1'$ (tsf)	$\sigma_3'$ (tsf)	$p'$ ( $(\sigma_1' + \sigma_3')/2$ ) (tsf)	$q$ ( $(\sigma_1 - \sigma_3)/2$ ) (tsf)	Effective Principal Stress Ratio $\sigma_1' / \sigma_3'$
7:22:23	313.5	0.661	72.3	4.754	12.19	44.0328	299.3	3.160	3.130	5.650	4.406	1.274	2.840	1.566	3.459
7:25:21	313.8	0.667	72.1	4.749	12.29	44.0840	299.6	3.160	3.129	5.649	4.419	1.288	2.853	1.566	3.432
7:28:17	314.1	0.672	72.3	4.743	12.39	44.1345	299.9	3.160	3.129	5.649	4.406	1.275	2.841	1.566	3.457
7:31:15	314.9	0.678	72.2	4.738	12.50	44.1859	300.7	3.164	3.133	5.653	4.419	1.284	2.851	1.568	3.443
7:34:08	314.9	0.683	72.0	4.732	12.60	44.2370	300.7	3.161	3.129	5.649	4.430	1.298	2.864	1.566	3.413
7:37:04	315.2	0.689	72.1	4.727	12.70	44.2890	301.0	3.160	3.129	5.649	4.418	1.286	2.852	1.566	3.434
7:40:04	316.0	0.694	72.1	4.721	12.80	44.3407	301.8	3.165	3.133	5.653	4.426	1.291	2.859	1.568	3.429
7:43:00	316.6	0.700	72.0	4.716	12.90	44.3919	302.4	3.167	3.135	5.655	4.437	1.299	2.868	1.569	3.416
7:45:51	316.9	0.705	72.0	4.710	13.00	44.4436	302.7	3.167	3.135	5.655	4.432	1.295	2.864	1.569	3.422
7:48:46	317.5	0.711	72.0	4.705	13.10	44.4955	303.2	3.169	3.136	5.656	4.437	1.298	2.868	1.569	3.418
7:51:39	317.5	0.716	71.9	4.699	13.21	44.5479	303.3	3.166	3.132	5.652	4.439	1.303	2.871	1.568	3.405
7:54:30	318.0	0.722	71.2	4.694	13.31	44.5999	303.7	3.167	3.133	5.653	4.487	1.351	2.919	1.568	3.321
7:57:21	318.0	0.727	71.9	4.688	13.41	44.6521	303.8	3.163	3.130	5.650	4.435	1.302	2.869	1.566	3.405
8:00:12	318.4	0.733	71.8	4.683	13.51	44.7047	304.2	3.164	3.130	5.650	4.442	1.309	2.875	1.566	3.393
8:03:02	319.1	0.738	71.7	4.677	13.61	44.7576	304.9	3.168	3.133	5.653	4.452	1.316	2.884	1.568	3.384
8:05:48	318.9	0.744	71.8	4.672	13.71	44.8099	304.7	3.161	3.127	5.647	4.439	1.309	2.874	1.565	3.391
8:08:37	319.4	0.749	71.8	4.666	13.82	44.8629	305.2	3.163	3.129	5.649	4.445	1.313	2.879	1.566	3.384
8:11:25	319.7	0.755	71.7	4.661	13.92	44.9156	305.5	3.163	3.128	5.648	4.450	1.320	2.885	1.565	3.372
8:14:13	320.8	0.760	71.5	4.655	14.02	44.9689	306.6	3.170	3.135	5.655	4.473	1.335	2.904	1.569	3.351
8:17:02	320.5	0.766	71.7	4.650	14.12	45.0219	306.3	3.164	3.129	5.649	4.449	1.318	2.883	1.566	3.376
8:19:47	320.9	0.771	71.6	4.644	14.22	45.0754	306.7	3.164	3.128	5.648	4.455	1.323	2.889	1.566	3.366
8:22:33	321.3	0.777	71.5	4.639	14.32	45.1290	307.1	3.164	3.128	5.648	4.461	1.330	2.896	1.566	3.354
8:25:22	321.4	0.782	71.6	4.633	14.43	45.1825	307.2	3.161	3.125	5.645	4.451	1.323	2.887	1.564	3.363
8:28:07	321.7	0.788	71.6	4.628	14.53	45.2362	307.5	3.161	3.124	5.644	4.455	1.328	2.891	1.564	3.355
8:30:53	322.0	0.793	71.5	4.622	14.63	45.2899	307.7	3.160	3.123	5.643	4.458	1.332	2.895	1.563	3.346
8:33:39	321.9	0.799	71.1	4.617	14.73	45.3440	307.7	3.156	3.119	5.639	4.485	1.363	2.924	1.561	3.290
8:36:27	322.9	0.804	71.6	4.611	14.83	45.3978	308.6	3.161	3.124	5.644	4.455	1.328	2.891	1.563	3.355
8:39:13	323.5	0.810	71.5	4.606	14.93	45.4519	309.3	3.164	3.126	5.646	4.464	1.334	2.899	1.565	3.345
8:41:57	322.8	0.815	71.3	4.600	15.04	45.5069	308.6	3.153	3.116	5.636	4.461	1.343	2.902	1.559	3.322
8:44:40	323.5	0.821	71.5	4.595	15.14	45.5609	309.2	3.156	3.118	5.638	4.454	1.333	2.893	1.561	3.342
8:47:28	322.7	0.826	71.4	4.589	15.24	45.6159	308.5	3.144	3.106	5.626	4.446	1.337	2.892	1.555	3.325
8:50:16	322.5	0.832	71.3	4.584	15.34	45.6708	308.3	3.139	3.101	5.621	4.447	1.344	2.896	1.552	3.309
8:53:02	322.7	0.837	71.0	4.578	15.44	45.7252	308.5	3.137	3.098	5.618	4.467	1.366	2.916	1.551	3.271
8:55:48	322.5	0.843	71.3	4.573	15.54	45.7801	308.3	3.131	3.092	5.612	4.439	1.344	2.891	1.547	3.303
8:58:34	322.9	0.848	71.3	4.567	15.64	45.8354	308.7	3.132	3.092	5.612	4.444	1.349	2.897	1.548	3.294
9:01:22	323.2	0.854	71.2	4.562	15.75	45.8908	308.9	3.130	3.091	5.611	4.449	1.356	2.902	1.547	3.282
9:04:08	323.3	0.859	71.2	4.556	15.85	45.9458	309.1	3.128	3.088	5.608	4.442	1.351	2.896	1.546	3.289
9:06:54	323.7	0.865	71.3	4.551	15.95	46.0012	309.5	3.128	3.088	5.608	4.441	1.350	2.896	1.546	3.290
9:09:44	324.3	0.870	71.2	4.545	16.05	46.0569	310.1	3.131	3.091	5.611	4.448	1.354	2.901	1.547	3.285
9:12:30	323.7	0.876	71.0	4.540	16.15	46.1127	309.4	3.120	3.080	5.600	4.453	1.371	2.912	1.541	3.249
9:15:16	323.7	0.881	71.3	4.534	16.25	46.1687	309.5	3.118	3.077	5.597	4.428	1.348	2.888	1.540	3.285
9:18:07	324.2	0.887	71.2	4.529	16.35	46.2247	310.0	3.118	3.078	5.598	4.433	1.353	2.893	1.540	3.277
9:20:57	324.9	0.892	71.1	4.523	16.46	46.2811	310.7	3.121	3.080	5.600	4.442	1.359	2.900	1.541	3.269
9:23:51	325.9	0.898	71.2	4.518	16.56	46.3374	311.7	3.128	3.086	5.606	4.442	1.353	2.898	1.545	3.283
9:26:41	325.8	0.903	71.2	4.512	16.66	46.3939	311.6	3.123	3.082	5.602	4.439	1.354	2.897	1.542	3.277
9:29:32	325.6	0.909	71.1	4.507	16.76	46.4504	311.4	3.118	3.076	5.596	4.437	1.358	2.898	1.539	3.266
9:32:23	325.6	0.914	70.9	4.501	16.86	46.5074	311.4	3.113	3.071	5.591	4.452	1.379	2.915	1.537	3.230
9:35:09	325.6	0.920	71.2	4.496	16.96	46.5640	311.4	3.110	3.067	5.587	4.424	1.353	2.889	1.535	3.268
9:38:02	325.6	0.925	71.1	4.490	17.07	46.6219	311.4	3.106	3.063	5.583	4.425	1.359	2.892	1.533	3.256
9:40:52	325.9	0.931	71.1	4.485	17.17	46.6787	311.7	3.105	3.062	5.582	4.429	1.364	2.896	1.532	3.246
9:43:41	325.9	0.936	71.2	4.479	17.27	46.7358	311.7	3.101	3.058	5.578	4.415	1.354	2.885	1.530	3.260

# Consolidated Undrained Triaxial Test EM 1110-2-1906 Appendix X

Consolidation Values			Final Values			Tested By <u>KDG</u>	Project Number <u>175569069</u>
Height	<u>5.839 (in.)</u>	<u>14.832 (cm)</u>	Height	<u>4.765 (in.)</u>		Date	<u>12-15-09</u>
Diameter	<u>2.743 (in)</u>	<u>6.967 (cm)</u>	Dia. avg.	<u>3.195 (in)</u>		Press No.	<u>1</u>
Area	<u>5.908 (in<sup>2</sup>)</u>	<u>38.117 (cm<sup>2</sup>)</u>	Area avg.	<u>8.017 (in<sup>2</sup>)</u>		Panel No.	<u>C</u>
							Test Number <u>CU-4C</u>
							Data File ID <u>4C</u>
							Lateral Pressure (psi) <u>45.0</u>
							Chamber Pressure - $\sigma_3$ (psi) <u>90</u>

Clock Time (min.)	Load (lbf)	Deflection Dial Reading (in.)	Pore Pressure Reading (psi)	Corrected Height (in.)	Strain (%)	Corrected Area (cm <sup>2</sup> )	Corrected Load (lbf)	Corrected Deviator Stress (tsf)	Corrected Deviator Stress* (tsf)	$\sigma_1$ (tsf)	$\sigma_1'$ (tsf)	$\sigma_3'$ (tsf)	$p'$ ( $(\sigma_1' + \sigma_3')/2$ ) (tsf)	$q$ ( $(\sigma_1 - \sigma_3)/2$ ) (tsf)	Effective Principal Stress Ratio $\sigma_1' / \sigma_3'$
0:00:00	12.5	-0.019	45.1	5.839	0.00	38.1171	0.0	0.000	0.000	3.240	3.240	3.233	3.236	0.004	1.002
0:05:59	21.1	-0.013	45.9	5.833	0.10	38.1562	8.6	0.105	0.104	3.344	3.265	3.173	3.229	0.056	1.035
0:12:18	68.3	-0.007	50.1	5.827	0.20	38.1938	55.8	0.679	0.679	3.919	3.555	2.870	3.213	0.343	1.239
0:19:09	117.6	-0.001	53.6	5.822	0.30	38.2318	105.1	1.278	1.277	4.517	3.903	2.618	3.261	0.642	1.491
0:25:03	143.4	0.005	55.9	5.816	0.40	38.2712	130.9	1.590	1.589	4.829	4.049	2.453	3.251	0.798	1.651
0:30:40	159.3	0.010	58.0	5.810	0.50	38.3089	146.8	1.782	1.780	5.020	4.092	2.305	3.198	0.894	1.776
0:36:17	171.7	0.016	59.8	5.804	0.60	38.3474	159.2	1.930	1.929	5.169	4.112	2.176	3.144	0.968	1.890
0:41:38	181.4	0.022	61.2	5.798	0.70	38.3860	168.8	2.045	2.043	5.283	4.125	2.074	3.099	1.025	1.989
0:47:14	189.5	0.028	62.7	5.792	0.80	38.4250	177.0	2.142	2.140	5.380	4.112	1.965	3.038	1.073	2.092
0:52:39	196.0	0.034	63.8	5.787	0.90	38.4634	183.5	2.218	2.216	5.456	4.111	1.888	2.999	1.111	2.178
0:57:57	201.5	0.040	64.8	5.781	1.00	38.5023	188.9	2.282	2.279	5.519	4.100	1.813	2.957	1.143	2.261
1:03:27	207.5	0.045	65.7	5.775	1.10	38.5418	194.9	2.352	2.349	5.589	4.107	1.751	2.929	1.178	2.345
1:08:52	212.1	0.051	66.2	5.769	1.20	38.5806	199.5	2.405	2.402	5.642	4.121	1.712	2.917	1.204	2.407
1:14:21	216.1	0.057	67.0	5.763	1.30	38.6193	203.6	2.451	2.448	5.688	4.108	1.653	2.880	1.227	2.485
1:19:36	220.2	0.063	67.5	5.757	1.40	38.6585	207.7	2.498	2.495	5.735	4.119	1.617	2.868	1.251	2.547
1:25:17	224.4	0.069	68.2	5.752	1.50	38.6979	211.9	2.546	2.542	5.782	4.118	1.569	2.844	1.275	2.625
1:30:51	227.9	0.075	68.5	5.746	1.60	38.7371	215.3	2.585	2.581	5.821	4.137	1.549	2.843	1.294	2.670
1:36:37	231.1	0.081	69.0	5.740	1.70	38.7769	218.5	2.621	2.616	5.856	4.139	1.516	2.827	1.312	2.731
1:42:21	234.6	0.086	69.3	5.734	1.80	38.8160	222.0	2.660	2.655	5.895	4.152	1.490	2.821	1.331	2.787
1:47:55	237.7	0.092	69.5	5.728	1.90	38.8557	225.2	2.695	2.690	5.930	4.173	1.476	2.824	1.349	2.828
1:53:43	240.6	0.098	69.9	5.722	2.00	38.8952	228.0	2.726	2.721	5.961	4.174	1.446	2.810	1.364	2.887
1:59:32	243.1	0.104	70.1	5.717	2.10	38.9351	230.6	2.754	2.749	5.989	4.192	1.436	2.814	1.378	2.919
2:05:05	246.7	0.110	70.4	5.711	2.20	38.9749	234.1	2.793	2.788	6.028	4.203	1.408	2.806	1.397	2.984
2:10:35	248.9	0.115	70.5	5.705	2.30	39.0146	236.3	2.817	2.811	6.051	4.221	1.403	2.812	1.409	3.009
2:16:08	251.3	0.121	70.7	5.699	2.40	39.0546	238.7	2.842	2.836	6.076	4.232	1.388	2.810	1.422	3.048
2:21:34	254.1	0.127	70.9	5.693	2.50	39.0946	241.5	2.873	2.866	6.106	4.252	1.378	2.815	1.437	3.085
2:27:09	256.5	0.133	70.9	5.687	2.60	39.1352	243.9	2.898	2.892	6.132	4.275	1.377	2.826	1.449	3.106
2:32:47	258.6	0.139	71.1	5.682	2.70	39.1750	246.0	2.920	2.914	6.154	4.280	1.360	2.820	1.460	3.148
2:38:20	261.0	0.145	71.2	5.676	2.80	39.2153	248.4	2.946	2.939	6.179	4.303	1.357	2.830	1.473	3.171
2:44:04	263.5	0.151	71.4	5.670	2.90	39.2560	251.0	2.973	2.966	6.206	4.315	1.342	2.828	1.486	3.215
2:49:45	265.8	0.156	71.3	5.664	3.00	39.2964	253.2	2.997	2.989	6.229	4.339	1.343	2.841	1.498	3.231
2:55:20	267.6	0.162	71.4	5.658	3.10	39.3368	255.0	3.015	3.007	6.247	4.350	1.337	2.843	1.507	3.255
3:00:54	270.0	0.168	71.5	5.652	3.20	39.3774	257.4	3.040	3.032	6.272	4.373	1.335	2.854	1.519	3.277
3:06:39	272.1	0.174	71.4	5.646	3.30	39.4183	259.6	3.062	3.054	6.294	4.398	1.337	2.867	1.530	3.290
3:12:13	274.0	0.180	71.6	5.641	3.40	39.4590	261.5	3.082	3.073	6.313	4.406	1.326	2.866	1.540	3.322
3:17:54	275.8	0.186	71.5	5.635	3.50	39.5003	263.3	3.100	3.091	6.331	4.429	1.331	2.880	1.549	3.327
3:23:30	278.5	0.191	71.7	5.629	3.60	39.5408	266.0	3.128	3.119	6.359	4.443	1.318	2.880	1.563	3.372
3:28:58	280.3	0.197	71.6	5.623	3.70	39.5820	267.8	3.146	3.137	6.377	4.470	1.326	2.898	1.572	3.370
3:34:30	282.1	0.203	71.6	5.617	3.80	39.6230	269.5	3.163	3.153	6.393	4.484	1.323	2.903	1.580	3.389
3:40:01	284.2	0.209	71.6	5.611	3.90	39.6643	271.7	3.185	3.175	6.415	4.505	1.323	2.914	1.591	3.405
3:45:31	286.1	0.215	71.5	5.606	4.00	39.7056	273.6	3.204	3.194	6.434	4.531	1.330	2.930	1.600	3.407
3:50:55	287.9	0.221	71.6	5.600	4.10	39.7476	275.4	3.222	3.211	6.451	4.540	1.322	2.931	1.609	3.435
3:56:13	289.7	0.226	71.6	5.594	4.20	39.7886	277.1	3.239	3.228	6.468	4.563	1.328	2.946	1.618	3.435
4:01:43	291.4	0.232	71.6	5.588	4.30	39.8304	278.8	3.255	3.244	6.484	4.576	1.324	2.950	1.626	3.455
4:07:04	293.3	0.238	71.5	5.582	4.40	39.8721	280.7	3.274	3.263	6.503	4.601	1.330	2.966	1.635	3.458
4:12:23	294.7	0.244	71.5	5.576	4.50	39.9136	282.2	3.287	3.276	6.516	4.617	1.335	2.976	1.641	3.460
4:17:47	296.9	0.250	71.5	5.571	4.60	39.9555	284.4	3.310	3.298	6.538	4.639	1.333	2.986	1.653	3.479
4:23:15	298.7	0.256	71.3	5.565	4.70	39.9974	286.1	3.326	3.315	6.555	4.665	1.343	3.004	1.661	3.473
4:28:41	300.2	0.261	71.4	5.559	4.80	40.0393	287.6	3.340	3.328	6.568	4.673	1.338	3.006	1.668	3.493
4:34:08	302.2	0.267	71.3	5.553	4.90	40.0814	289.7	3.360	3.348	6.588	4.699	1.344	3.022	1.678	3.496
4:39:38	303.9	0.273	71.4	5.547	5.00	40.1237	291.4	3.377	3.364	6.604	4.712	1.340	3.026	1.686	3.515
4:45:08	305.1	0.279	71.2	5.541	5.10	40.1661	292.6	3.387	3.374	6.614	4.733	1.351	3.042	1.691	3.502
4:50:28	306.8	0.285	71.2	5.535	5.20	40.2085	294.2	3.402	3.389	6.629	4.747	1.351	3.049	1.698	3.515
4:55:56	308.6	0.291	71.2	5.530	5.30	40.2508	296.0	3.420	3.406	6.646	4.768	1.355	3.061	1.707	3.520
5:01:29	309.7	0.297	71.1	5.524	5.40	40.2932	297.2	3.429	3.416	6.656	4.784	1.361	3.073	1.711	3.514
5:06:55	311.1	0.302	71.0	5.518	5.50	40.3362	298.5	3.442	3.428	6.668	4.800	1.365	3.083	1.717	3.516
5:12:29	312.9	0.308	70.9	5.512	5.60	40.3787	300.4	3.459	3.445	6.685	4.829	1.377	3.103	1.726	3.507
5:18:08	314.5	0.314	71.0	5.506	5.70	40.4217	302.0	3.474	3.459	6.699	4.837	1.371	3.104	1.733	3.529
5:23:34	315.8	0.320	70.8	5.500	5.80	40.4645	303.2	3.485	3.470	6.710	4.860	1.382	3.121	1.739	3.515
5:29:09	317.5	0.326	70.9	5.495	5.90	40.5074	304.9	3.501	3.486	6.726	4.871	1.379	3.125	1.746	3.534

## Consolidated Undrained Triaxial Test EM 1110-2-1906 Appendix X

Consolidation Values			Final Values			Tested By		Project Number	
Height	5.839 (in.)	14.832 (cm)	Height	4.765 (in.)		KDG	175569069		
Diameter	2.743 (in.)	6.967 (cm)	Dia. avg.	3.195 (in.)		Date	12-15-09	Test Number	CU-4C
Area	5.908 (in <sup>2</sup> )	38.117 (cm <sup>2</sup> )	Area avg.	8.017 (in <sup>2</sup> )		Press No.	1	Data File ID	4C
						Panel No.	C	Lateral Pressure (psi)	45.0
								Chamber Pressure - $\sigma_3$ (psi)	90

Clock Time (min.)	Load (lbf)	Deflection Dial Reading (in.)	Pore Pressure Reading (psi)	Corrected Height (in.)	Strain (%)	Corrected Area (cm <sup>2</sup> )	Corrected Load (lbf)	Deviator Stress (tsf)	Corrected Deviator Stress* (tsf)	$\sigma_3$ (tsf)	$\sigma_1'$ (tsf)	$\sigma_3'$ (tsf)	$p'$ ( $(\sigma_1' + \sigma_3')/2$ ) (tsf)	$q$ ( $(\sigma_1 - \sigma_3)/2$ ) (tsf)	Effective Principal
															Stress Ratio $\sigma_1' / \sigma_3'$
5:34:59	318.6	0.332	70.7	5.489	6.00	40.5506	306.1	3.510	3.494	6.734	4.890	1.388	3.139	1.751	3.523
5:40:47	320.1	0.337	70.8	5.483	6.10	40.5939	307.5	3.523	3.508	6.748	4.899	1.385	3.142	1.757	3.538
5:46:28	321.4	0.343	70.6	5.477	6.20	40.6372	308.9	3.534	3.519	6.759	4.922	1.396	3.159	1.763	3.526
5:52:11	323.1	0.349	70.6	5.471	6.30	40.6804	310.5	3.549	3.534	6.774	4.936	1.396	3.166	1.770	3.537
5:58:02	324.2	0.355	70.5	5.465	6.40	40.7239	311.6	3.558	3.542	6.782	4.954	1.405	3.179	1.775	3.527
6:03:47	325.5	0.361	70.4	5.460	6.50	40.7674	313.0	3.570	3.553	6.793	4.969	1.409	3.189	1.780	3.527
6:09:24	327.3	0.367	70.4	5.454	6.60	40.8113	314.7	3.586	3.569	6.809	4.990	1.414	3.202	1.788	3.529
6:15:15	328.5	0.372	70.1	5.448	6.70	40.8549	315.9	3.596	3.579	6.819	5.020	1.434	3.227	1.793	3.500
6:21:05	329.8	0.378	70.2	5.442	6.80	40.8988	317.3	3.607	3.590	6.830	5.020	1.423	3.222	1.799	3.528
6:26:40	330.9	0.384	70.0	5.436	6.90	40.9430	318.3	3.616	3.598	6.838	5.045	1.440	3.243	1.803	3.504
6:32:24	332.4	0.390	70.1	5.430	7.00	40.9868	319.9	3.629	3.611	6.851	5.053	1.435	3.244	1.809	3.522
6:38:09	333.6	0.396	69.9	5.425	7.10	41.0309	321.0	3.638	3.620	6.860	5.072	1.445	3.259	1.814	3.511
6:43:53	334.7	0.402	69.9	5.419	7.20	41.0750	322.2	3.647	3.629	6.869	5.081	1.445	3.263	1.818	3.517
6:49:35	336.0	0.407	69.8	5.413	7.30	41.1193	323.4	3.658	3.639	6.879	5.101	1.454	3.278	1.823	3.507
6:55:27	337.5	0.413	69.9	5.407	7.40	41.1639	325.0	3.671	3.652	6.892	5.110	1.451	3.280	1.830	3.523
7:01:16	338.3	0.419	69.7	5.401	7.50	41.2083	325.8	3.676	3.657	6.897	5.128	1.463	3.295	1.832	3.504
7:07:04	339.1	0.425	69.6	5.395	7.60	41.2528	326.6	3.681	3.662	6.902	5.135	1.466	3.300	1.835	3.503
7:12:49	340.8	0.431	69.5	5.390	7.70	41.2974	328.3	3.697	3.677	6.917	5.157	1.472	3.315	1.842	3.502
7:18:37	341.8	0.437	69.5	5.384	7.80	41.3425	329.2	3.703	3.684	6.924	5.164	1.474	3.319	1.845	3.504
7:24:14	342.6	0.443	69.4	5.378	7.90	41.3872	330.1	3.709	3.689	6.929	5.179	1.483	3.331	1.848	3.492
7:29:56	343.8	0.448	69.2	5.372	8.00	41.4321	331.2	3.717	3.697	6.937	5.205	1.501	3.353	1.852	3.468
7:35:41	345.0	0.454	69.3	5.366	8.10	41.4774	332.5	3.727	3.707	6.947	5.205	1.491	3.348	1.857	3.491
7:41:24	345.9	0.460	69.1	5.360	8.20	41.5225	333.3	3.733	3.712	6.952	5.221	1.502	3.362	1.859	3.476
7:47:00	346.6	0.466	69.1	5.354	8.30	41.5677	334.1	3.737	3.716	6.956	5.226	1.503	3.365	1.862	3.477
7:52:35	348.0	0.472	69.0	5.349	8.40	41.6133	335.5	3.749	3.727	6.967	5.245	1.510	3.377	1.867	3.473
7:58:16	349.4	0.478	69.1	5.343	8.50	41.6585	336.9	3.760	3.739	6.979	5.254	1.508	3.381	1.873	3.485
8:03:49	350.1	0.483	68.9	5.337	8.60	41.7043	337.5	3.764	3.742	6.982	5.269	1.520	3.394	1.874	3.467
8:09:18	351.6	0.489	69.0	5.331	8.70	41.7500	339.0	3.776	3.754	6.994	5.277	1.516	3.396	1.881	3.482
8:14:52	352.6	0.495	68.8	5.325	8.80	41.7959	340.0	3.783	3.761	7.001	5.294	1.526	3.410	1.884	3.468
8:20:23	353.2	0.501	68.7	5.319	8.90	41.8416	340.7	3.786	3.764	7.004	5.304	1.534	3.419	1.885	3.459
8:25:52	354.5	0.507	68.7	5.314	9.00	41.8876	341.9	3.796	3.773	7.013	5.317	1.536	3.426	1.890	3.460
8:31:34	355.7	0.513	68.5	5.308	9.10	41.9337	343.2	3.805	3.782	7.022	5.337	1.547	3.442	1.895	3.449
8:37:14	356.6	0.519	68.6	5.302	9.20	41.9803	344.0	3.811	3.788	7.028	5.338	1.544	3.441	1.897	3.458
8:42:43	357.3	0.524	68.4	5.296	9.30	42.0262	344.8	3.815	3.792	7.032	5.354	1.555	3.455	1.899	3.443
8:48:33	358.2	0.530	68.4	5.290	9.40	42.0729	345.6	3.820	3.796	7.036	5.355	1.552	3.454	1.902	3.451
8:54:16	358.9	0.536	68.3	5.284	9.50	42.1195	346.4	3.824	3.800	7.040	5.370	1.563	3.466	1.903	3.436
8:59:49	359.7	0.542	68.3	5.279	9.60	42.1656	347.1	3.828	3.804	7.044	5.375	1.564	3.470	1.905	3.436
9:05:35	360.8	0.548	68.2	5.273	9.70	42.2126	348.3	3.837	3.812	7.052	5.392	1.573	3.482	1.910	3.428
9:11:16	362.0	0.553	68.2	5.267	9.80	42.2591	349.5	3.845	3.821	7.061	5.400	1.573	3.487	1.914	3.434
9:17:03	362.8	0.559	68.0	5.261	9.90	42.3062	350.2	3.849	3.824	7.064	5.412	1.581	3.496	1.916	3.424
9:22:46	363.6	0.565	67.9	5.255	10.00	42.3534	351.1	3.855	3.829	7.069	5.431	1.595	3.513	1.918	3.406
9:28:27	364.9	0.571	68.0	5.249	10.10	42.4001	352.4	3.864	3.839	7.079	5.433	1.587	3.510	1.923	3.424
9:34:18	365.3	0.577	67.8	5.244	10.20	42.4474	352.7	3.864	3.838	7.078	5.443	1.598	3.520	1.923	3.407
9:40:05	365.9	0.583	67.8	5.238	10.30	42.4946	353.4	3.867	3.841	7.081	5.447	1.599	3.523	1.924	3.406
9:45:56	367.3	0.589	67.7	5.232	10.40	42.5421	354.7	3.877	3.851	7.091	5.463	1.605	3.534	1.929	3.404
9:51:53	367.8	0.594	67.7	5.226	10.50	42.5900	355.3	3.879	3.852	7.092	5.462	1.602	3.532	1.930	3.409
9:57:37	368.2	0.600	67.6	5.220	10.60	42.6375	355.7	3.879	3.852	7.092	5.473	1.614	3.543	1.930	3.391
10:03:29	369.2	0.606	67.6	5.214	10.70	42.6852	356.6	3.885	3.858	7.098	5.475	1.609	3.542	1.933	3.401
10:09:22	369.9	0.612	67.5	5.208	10.80	42.7332	357.4	3.889	3.862	7.102	5.490	1.621	3.555	1.934	3.387
10:15:15	371.0	0.618	67.5	5.203	10.90	42.7810	358.5	3.897	3.869	7.109	5.497	1.621	3.559	1.938	3.392
10:21:02	371.8	0.624	67.4	5.197	11.00	42.8295	359.2	3.900	3.872	7.112	5.509	1.630	3.570	1.940	3.380
10:26:57	372.4	0.629	67.3	5.191	11.10	42.8771	359.9	3.903	3.875	7.115	5.515	1.634	3.574	1.941	3.376
10:32:40	373.1	0.635	67.3	5.185	11.20	42.9254	360.5	3.905	3.877	7.117	5.522	1.637	3.579	1.942	3.372
10:38:30	373.2	0.641	67.0	5.179	11.30	42.9738	360.6	3.902	3.874	7.114	5.533	1.653	3.593	1.940	3.348
10:44:22	374.2	0.647	67.2	5.173	11.40	43.0223	361.7	3.909	3.880	7.120	5.530	1.643	3.586	1.944	3.366
10:50:11	374.7	0.653	67.0	5.168	11.50	43.0712	362.1	3.910	3.881	7.121	5.541	1.653	3.597	1.944	3.352
10:56:00	374.9	0.659	67.1	5.162	11.60	43.1198	362.4	3.908	3.879	7.119	5.537	1.652	3.594	1.943	3.353
11:01:41	375.5	0.664	66.9	5.156	11.70	43.1689	362.9	3.910	3.880	7.120	5.548	1.661	3.604	1.944	3.341
11:07:31	376.0	0.670	67.0	5.150	11.80	43.2179	363.5	3.911	3.881	7.121	5.544	1.656	3.600	1.944	3.348
11:13:15	376.7	0.676	66.9	5.144	11.90	43.2669	364.2	3.914	3.884	7.124	5.556	1.665	3.611	1.946	3.337

## Consolidated Undrained Triaxial Test EM 1110-2-1906 Appendix X

Consolidation Values			Final Values			Tested By <u>KDG</u>		Project Number <u>175569069</u>	
Height	<u>5.839 (in.)</u>	<u>14.832 (cm)</u>	Height	<u>4.765 (in.)</u>		Date	<u>12-15-09</u>	Test Number	<u>CU-4C</u>
Diameter	<u>2.743 (in)</u>	<u>6.967 (cm)</u>	Dia. avg.	<u>3.195 (in)</u>		Press No.	<u>1</u>	Data File ID	<u>4C</u>
Area	<u>5.908 (in<sup>2</sup>)</u>	<u>38.117 (cm<sup>2</sup>)</u>	Area avg.	<u>8.017 (in<sup>2</sup>)</u>		Panel No.	<u>C</u>	Lateral Pressure (psi)	<u>45.0</u>
								Chamber Pressure - $\sigma_3$ (psi)	<u>90</u>

Clock Time (min.)	Load (lbf)	Deflection Dial Reading (in.)	Pore Pressure Reading (psi)	Corrected Height (in.)	Strain (%)	Corrected Area (cm <sup>2</sup> )	Corrected Load (lbf)	Deviator Stress (tsf)	Corrected Deviator Stress* (tsf)	$\sigma_1$ (tsf)	$\sigma_1'$ (tsf)	$\sigma_3'$ (tsf)	$p'$ ( $(\sigma_1' + \sigma_3')/2$ ) (tsf)	$q$ ( $(\sigma_1 - \sigma_3)/2$ ) (tsf)	Effective Principal Stress Ratio
															$\sigma_1' / \sigma_3'$
11:18:58	376.9	0.682	66.9	5.138	12.00	43.3162	364.3	3.911	3.881	7.121	5.554	1.666	3.610	1.944	3.333
11:24:34	378.0	0.688	66.8	5.133	12.10	43.3651	365.5	3.919	3.888	7.128	5.567	1.672	3.620	1.948	3.330
11:30:21	378.5	0.694	66.7	5.127	12.20	43.4146	365.9	3.919	3.889	7.129	5.571	1.675	3.623	1.948	3.325
11:35:57	379.1	0.700	66.7	5.121	12.30	43.4643	366.5	3.921	3.890	7.130	5.577	1.680	3.629	1.949	3.319
11:41:47	380.2	0.705	66.5	5.115	12.40	43.5139	367.6	3.929	3.897	7.137	5.595	1.691	3.643	1.952	3.309
11:47:35	380.7	0.711	66.6	5.109	12.50	43.5632	368.1	3.930	3.898	7.138	5.592	1.687	3.640	1.953	3.315
11:53:18	381.6	0.717	66.5	5.103	12.60	43.6135	369.0	3.934	3.902	7.142	5.603	1.694	3.649	1.955	3.308
11:58:59	382.1	0.723	66.5	5.098	12.70	43.6630	369.5	3.935	3.903	7.143	5.603	1.693	3.648	1.955	3.310
12:04:48	382.6	0.729	66.4	5.092	12.80	43.7137	370.1	3.937	3.905	7.145	5.612	1.701	3.657	1.956	3.300
12:10:25	383.4	0.735	66.4	5.086	12.90	43.7633	370.8	3.940	3.908	7.148	5.612	1.697	3.655	1.957	3.307
12:16:05	384.1	0.740	66.3	5.080	13.00	43.8137	371.5	3.943	3.910	7.150	5.625	1.707	3.666	1.959	3.294
12:21:46	385.3	0.746	66.3	5.074	13.10	43.8643	372.7	3.951	3.918	7.158	5.628	1.703	3.665	1.963	3.305
12:27:28	385.7	0.752	66.3	5.068	13.20	43.9146	373.1	3.951	3.918	7.158	5.634	1.709	3.671	1.962	3.297
12:33:15	385.8	0.758	66.2	5.062	13.30	43.9661	373.3	3.948	3.914	7.154	5.638	1.716	3.677	1.961	3.285
12:38:54	387.0	0.764	66.2	5.057	13.40	44.0161	374.4	3.956	3.922	7.162	5.644	1.715	3.680	1.964	3.290
12:44:31	387.2	0.770	66.0	5.051	13.50	44.0670	374.7	3.954	3.920	7.160	5.654	1.728	3.691	1.963	3.273
12:50:14	387.5	0.775	66.1	5.045	13.60	44.1183	375.0	3.952	3.918	7.158	5.647	1.722	3.684	1.962	3.280
12:55:51	388.1	0.781	66.0	5.039	13.70	44.1693	375.5	3.953	3.919	7.159	5.655	1.730	3.692	1.963	3.270
13:01:35	389.1	0.787	66.0	5.033	13.80	44.2205	376.5	3.959	3.925	7.165	5.656	1.724	3.690	1.966	3.280
13:07:24	389.3	0.793	65.9	5.027	13.90	44.2717	376.8	3.957	3.922	7.162	5.663	1.734	3.699	1.965	3.266
13:13:02	389.9	0.799	65.9	5.022	14.00	44.3233	377.4	3.959	3.924	7.164	5.663	1.732	3.697	1.965	3.269
13:18:55	390.7	0.805	65.9	5.016	14.10	44.3748	378.2	3.963	3.927	7.167	5.673	1.739	3.706	1.967	3.263
13:24:45	391.5	0.810	65.9	5.010	14.20	44.4267	379.0	3.967	3.931	7.171	5.674	1.736	3.705	1.969	3.268
13:30:28	391.9	0.816	65.7	5.004	14.30	44.4784	379.4	3.966	3.930	7.170	5.684	1.747	3.716	1.969	3.254
13:36:24	392.9	0.822	65.7	4.998	14.40	44.5303	380.4	3.972	3.936	7.176	5.689	1.746	3.718	1.971	3.258
13:42:12	393.8	0.828	65.7	4.992	14.50	44.5830	381.2	3.976	3.940	7.180	5.695	1.748	3.721	1.973	3.258
13:48:06	393.8	0.834	65.5	4.987	14.60	44.6347	381.3	3.972	3.936	7.176	5.704	1.761	3.733	1.971	3.239
13:54:02	394.4	0.840	65.6	4.981	14.70	44.6870	381.9	3.974	3.937	7.177	5.699	1.755	3.727	1.972	3.247
14:00:04	395.7	0.845	65.5	4.975	14.80	44.7394	383.2	3.982	3.945	7.185	5.714	1.762	3.738	1.976	3.243
14:06:01	396.1	0.851	65.6	4.969	14.90	44.7921	383.5	3.981	3.944	7.184	5.707	1.756	3.731	1.975	3.250
14:11:49	395.6	0.857	65.5	4.963	15.00	44.8449	383.1	3.972	3.934	7.174	5.708	1.767	3.738	1.971	3.231
14:17:44	396.5	0.863	65.6	4.957	15.10	44.8981	384.0	3.977	3.939	7.179	5.705	1.759	3.732	1.973	3.243
14:23:40	396.3	0.869	65.5	4.952	15.20	44.9505	383.8	3.970	3.931	7.171	5.706	1.767	3.737	1.969	3.229
14:29:30	396.2	0.875	65.5	4.946	15.30	45.0039	383.6	3.964	3.925	7.165	5.696	1.764	3.730	1.966	3.230
14:35:18	396.5	0.881	65.4	4.940	15.40	45.0570	384.0	3.963	3.924	7.164	5.703	1.772	3.737	1.965	3.219
14:41:11	396.8	0.886	65.4	4.934	15.50	45.1101	384.2	3.960	3.921	7.161	5.697	1.768	3.732	1.964	3.222
14:46:58	397.0	0.892	65.3	4.928	15.60	45.1636	384.5	3.959	3.919	7.159	5.702	1.776	3.739	1.963	3.211
14:52:51	396.5	0.898	65.3	4.922	15.70	45.2176	384.0	3.949	3.909	7.149	5.696	1.780	3.738	1.958	3.200
14:58:40	397.2	0.904	65.3	4.916	15.80	45.2711	384.6	3.951	3.911	7.151	5.698	1.780	3.739	1.959	3.202
15:04:34	397.5	0.910	65.1	4.911	15.90	45.3249	385.0	3.950	3.910	7.150	5.708	1.791	3.749	1.958	3.187
15:10:27	397.4	0.916	65.2	4.905	16.00	45.3788	384.8	3.944	3.903	7.143	5.694	1.783	3.739	1.955	3.193
15:16:13	397.8	0.921	65.1	4.899	16.10	45.4336	385.3	3.943	3.903	7.143	5.701	1.791	3.746	1.955	3.183
15:21:57	398.3	0.927	65.2	4.893	16.20	45.4872	385.7	3.943	3.902	7.142	5.695	1.786	3.741	1.955	3.189
15:27:49	398.1	0.933	65.1	4.887	16.30	45.5417	385.6	3.937	3.896	7.136	5.696	1.793	3.745	1.951	3.176
15:33:29	398.5	0.939	65.1	4.881	16.40	45.5966	386.0	3.936	3.895	7.135	5.693	1.791	3.742	1.951	3.179
15:39:14	399.4	0.945	65.1	4.876	16.50	45.6504	386.9	3.940	3.899	7.139	5.701	1.795	3.746	1.953	3.176
15:45:00	399.8	0.951	65.2	4.870	16.60	45.7052	387.3	3.940	3.898	7.138	5.694	1.789	3.741	1.953	3.183
15:50:41	399.6	0.956	65.0	4.864	16.70	45.7601	387.0	3.933	3.891	7.131	5.697	1.800	3.748	1.949	3.166
15:56:20	400.4	0.962	65.1	4.858	16.80	45.8158	387.8	3.936	3.894	7.134	5.697	1.795	3.746	1.951	3.173
16:01:55	400.9	0.968	65.0	4.852	16.90	45.8704	388.3	3.936	3.894	7.134	5.702	1.801	3.751	1.950	3.166
16:07:38	400.9	0.974	64.9	4.846	17.00	45.9256	388.4	3.932	3.889	7.129	5.707	1.811	3.759	1.948	3.152
16:13:11	401.5	0.980	65.0	4.841	17.10	45.9809	389.1	3.934	3.891	7.131	5.701	1.803	3.752	1.949	3.162
16:18:47	401.8	0.986	64.9	4.835	17.20	46.0365	389.2	3.931	3.888	7.128	5.705	1.810	3.757	1.948	3.152
16:24:29	402.1	0.991	64.9	4.829	17.30	46.0923	389.6	3.930	3.887	7.127	5.697	1.804	3.751	1.947	3.159
16:30:00	402.3	0.997	64.8	4.823	17.40	46.1485	389.8	3.927	3.883	7.123	5.703	1.812	3.757	1.945	3.147
16:35:34	403.0	1.003	64.9	4.817	17.50	46.2042	390.4	3.929	3.885	7.125	5.698	1.806	3.752	1.946	3.156
16:41:03	403.4	1.009	64.8	4.811	17.60	46.2600	390.9	3.929	3.885	7.125	5.704	1.812	3.758	1.946	3.147
16:46:37	403.0	1.015	64.8	4.805	17.70	46.3166	390.4	3.920	3.875	7.115	5.696	1.814	3.755	1.941	3.141
16:52:08	404.2	1.021	64.8	4.800	17.80	46.3728	391.7	3.927	3.882	7.122	5.704	1.815	3.760	1.945	3.143
16:57:36	405.0	1.027	64.7	4.794	17.90	46.4291	392.4	3.930	3.885	7.125	5.717	1.825	3.771	1.946	3.133

**Consolidated Undrained Triaxial Test  
EM 1110-2-1906 Appendix X**

Consolidation Values		
Height	<u>5.839 (in.)</u>	<u>14.832 (cm)</u>
Diameter	<u>2.743 (in.)</u>	<u>6.967 (cm)</u>
Area	<u>5.908 (in<sup>2</sup>)</u>	<u>38.117 (cm<sup>2</sup>)</u>



Final Values	
Height	<u>4.765 (in.)</u>
Dia. avg.	<u>3.195 (in.)</u>
Area avg.	<u>8.017 (in<sup>2</sup>)</u>

Tested By	<u>KDG</u>
Date	<u>12-15-09</u>
Press No.	<u>1</u>
Panel No.	<u>C</u>

Project Number	<u>175569069</u>
Test Number	<u>CU-4C</u>
Data File ID	<u>4C</u>
Lateral Pressure (psi)	<u>45.0</u>
Chamber Pressure - $\sigma_3$ (psi)	<u>90</u>

Clock Time (min.)	Load (lbf)	Deflection Dial Reading (in.)	Pore Pressure Reading (psi)	Corrected Height (in.)	Strain (%)	Corrected Area (cm <sup>2</sup> )	Corrected Load (lbf)	Deviator Stress (tsf)	Corrected Deviator Stress* (tsf)	$\sigma_1$ (tsf)	$\sigma_1'$ (tsf)	$\sigma_3'$ (tsf)	$p'$ ( $(\sigma_1' + \sigma_3')/2$ ) (tsf)	$q$ ( $(\sigma_1 - \sigma_3)/2$ ) (tsf)	Effective
															Principal Stress Ratio $\sigma_1' / \sigma_3'$
17:03:06	404.7	1.032	64.8	4.788	18.00	46.4858	392.2	3.923	3.878	7.118	5.702	1.818	3.760	1.942	3.137
17:08:42	405.7	1.038	64.7	4.782	18.10	46.5424	393.1	3.928	3.882	7.122	5.710	1.821	3.766	1.945	3.136
17:14:29	405.6	1.044	64.8	4.776	18.20	46.5998	393.1	3.922	3.877	7.117	5.701	1.817	3.759	1.942	3.137
17:20:20	405.8	1.050	64.7	4.770	18.30	46.6564	393.3	3.919	3.873	7.113	5.703	1.823	3.763	1.940	3.128
17:26:02	405.8	1.056	64.8	4.765	18.40	46.7139	393.3	3.915	3.869	7.109	5.694	1.818	3.756	1.938	3.132




# CONSOLIDATED UNDRAINED TRIAXIAL TEST by ASTM D4767

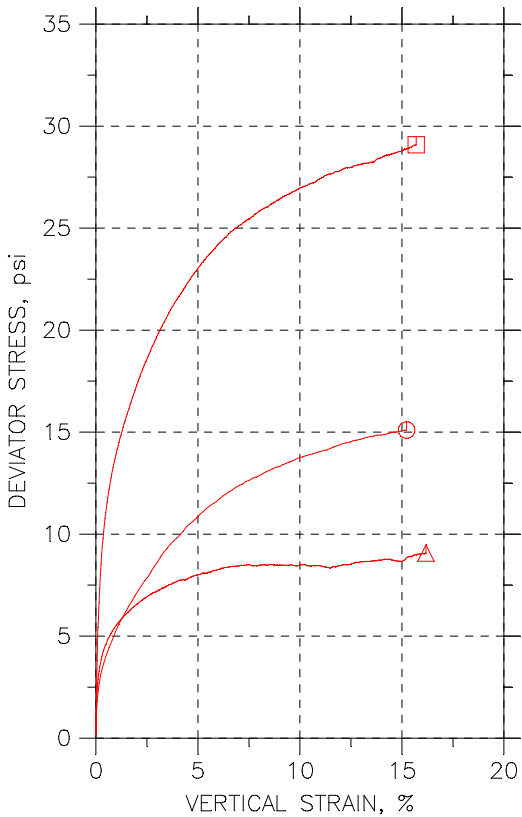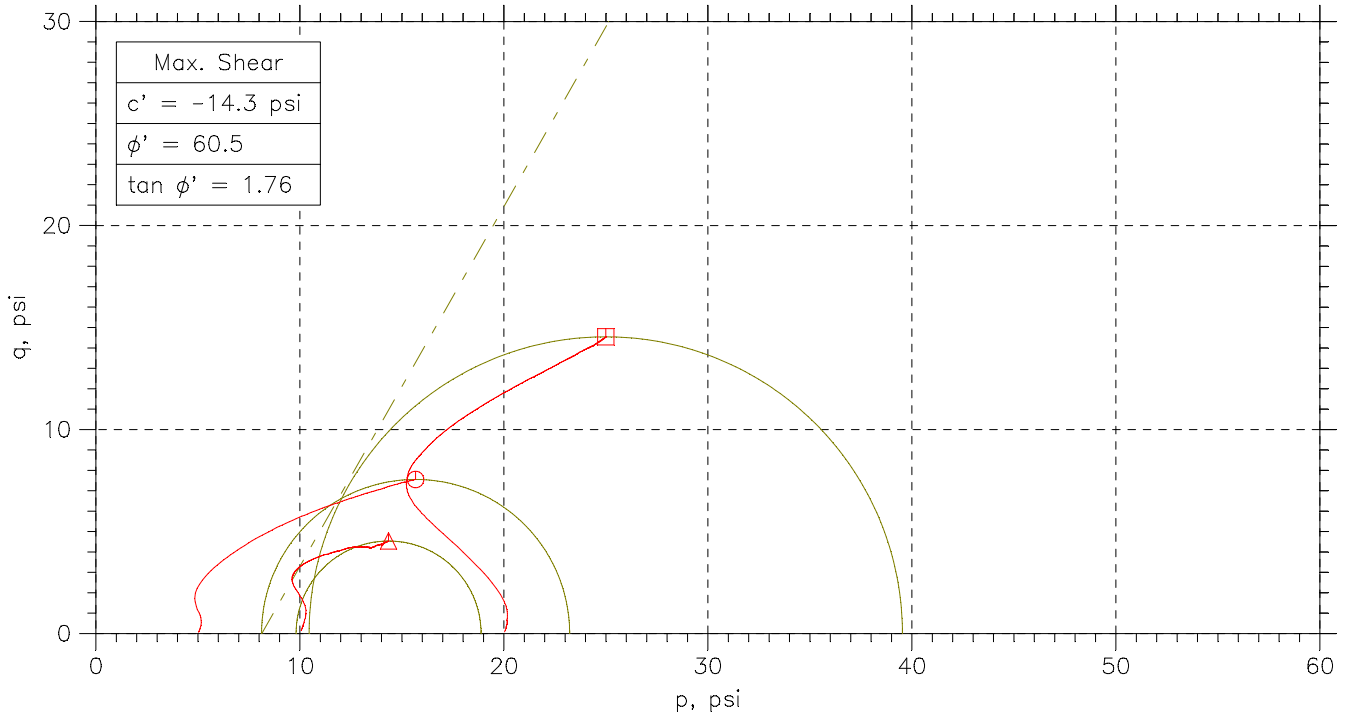


Symbol	⊙	△	□	
Sample No.	<b>STN-7</b>	<b>STN-7</b>	<b>STN-7</b>	
Test No.	1.1	1.2	1.3	
Depth	5.4-6.0	6.0-6.5	12.4-13.0	
Initial	Diameter, in	2.854	2.833	2.821
	Height, in	6.257	5.698	6.337
	Water Content, %	18.2	25.0	21.4
	Dry Density, pcf	110.5	99.78	106.7
	Saturation, %	93.3	98.0	99.8
Before Shear	Void Ratio	0.525	0.689	0.579
	Water Content, %	19.9	26.7	20.7
	Dry Density, pcf	109.7	98.01	108.1
	Saturation*, %	100.0	100.0	100.0
	Void Ratio	0.537	0.72	0.559
	Back Press., psi	142	140.6	80.37
	Ver. Eff. Cons. Stress, psi	4.973	9.917	19.95
	Shear Strength, psi	7.551	4.534	14.54
	Strain at Failure, %	15.2	16.2	15.7
	Strain Rate, %/min	0.016	0.016	0.016
	B-Value	0.95	0.96	0.95
	Estimated Specific Gravity	2.7	2.7	2.7
	Liquid Limit	---	---	---
	Plastic Limit	---	---	---

<p style="font-size: small;">a subsidiary of Geocomp Corporation</p>	Project: Peabody Ash Pond				
	Location: ---				
	Project No.: GTX-1503				
	Boring No.: STN-7				
	Sample Type: UD				
	Description: Brown lean clay with sand				
Remarks: System 1062					



# CONSOLIDATED UNDRAINED TRIAXIAL TEST by ASTM D4767

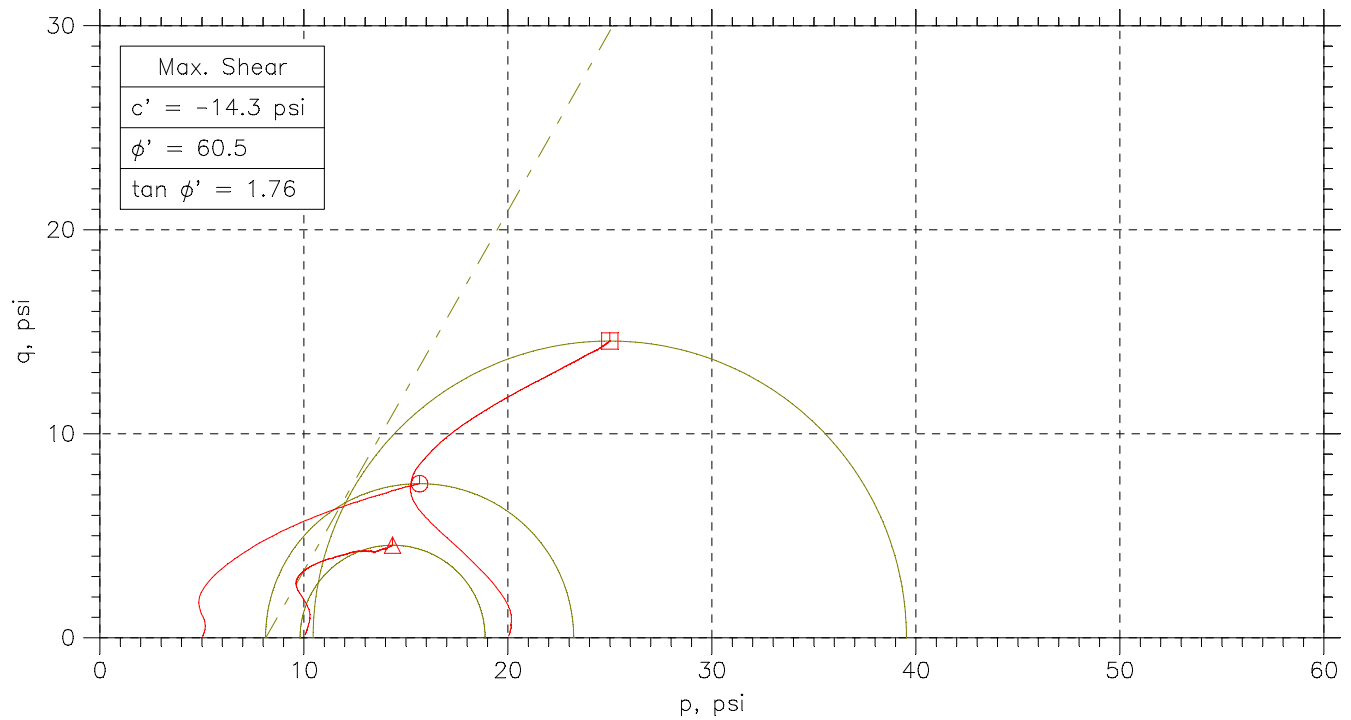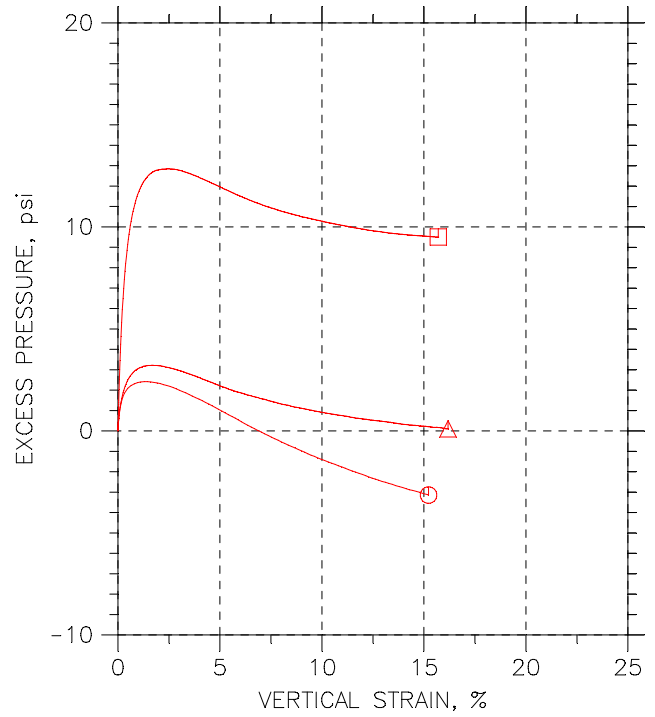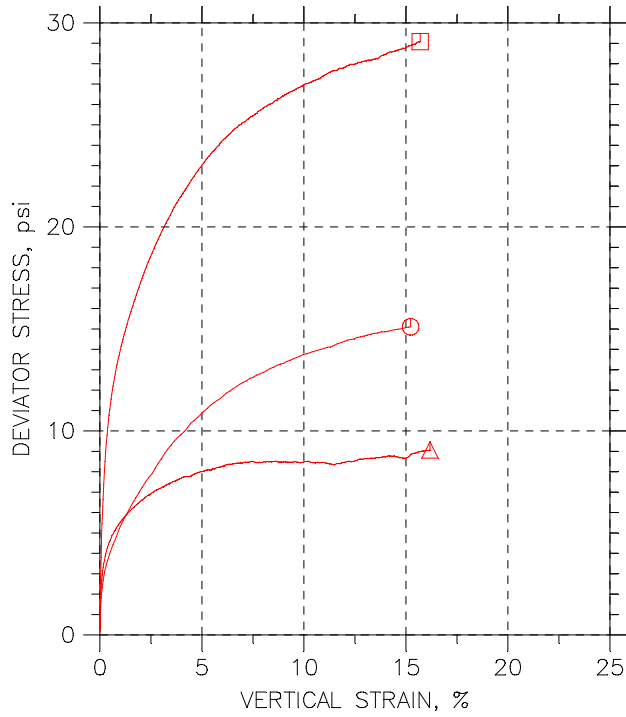


Symbol	Sample No.	Test No.	Depth	Tested By	Test Date	Checked By	Check Date	Test File
○	ST-4	1.1	5.4-6.0	jm	11/5/09	mm		1503-1.1.dat
△	ST-4	1.2	6.0-6.5	JM	11/4/09	MM		1503-1.2.dat
□	STN-15	1.3	12.4-13.0	JM	11/4/09	MM		1503-1.3.dat

 <p style="font-size: small;">a subsidiary of Geocomp Corporation</p>	Project: Peabody Ash Pond		Location: ---		Project No.: GTX-1503	
	Boring No.: STN-7		Sample Type: UD			
	Description: Brown lean clay with sand					
	Remarks: System 1062					

# CONSOLIDATED UNDRAINED TRIAXIAL TEST by ASTM D4767

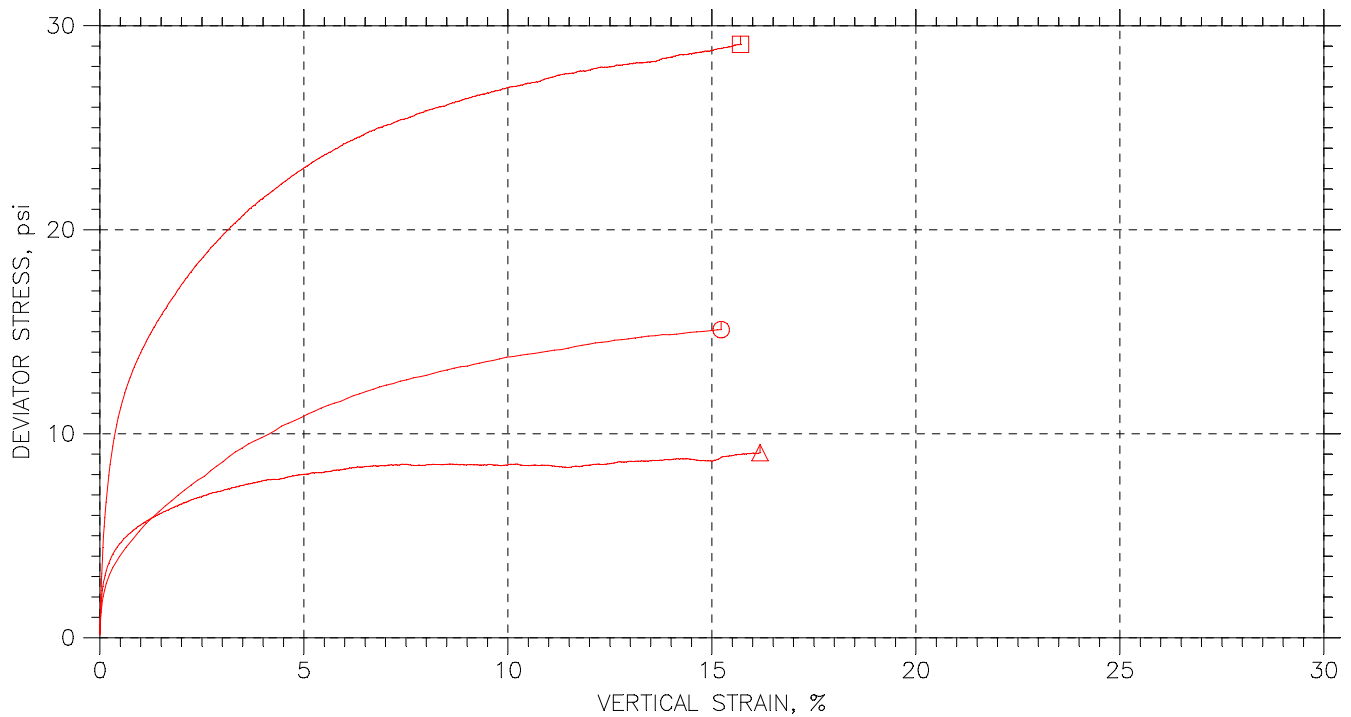
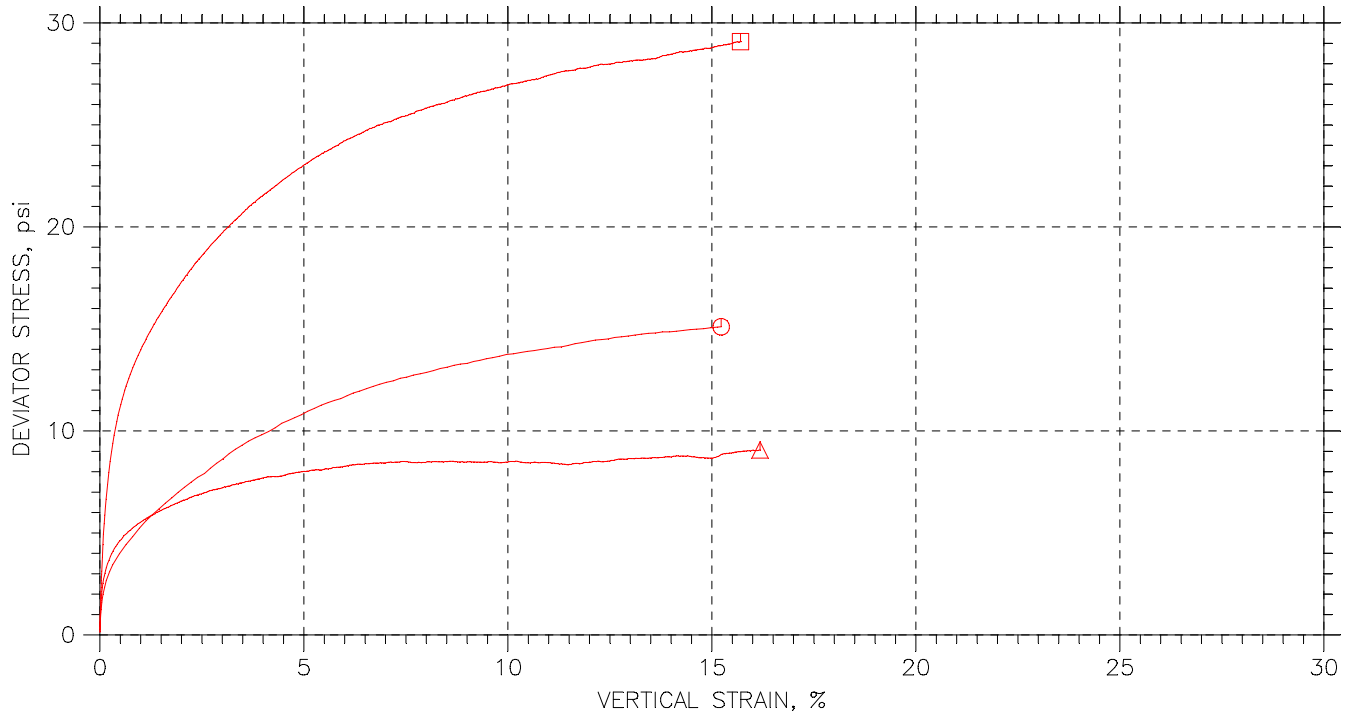


	Sample No.	Test No.	Depth	Tested By	Test Date	Checked By	Check Date	Test File
○	ST-4	1.1	5.4-6.0	jm	11/5/09	mm		1503-1.1.dat
△	ST-4	1.2	6.0-6.5	JM	11/4/09	MM		1503-1.2.dat
□	STN-15	1.3	12.4-13.0	JM	11/4/09	MM		1503-1.3.dat

 <p style="font-size: small;">a subsidiary of Geocomp Corporation</p>	Project: Peabody Ash Pond		Location: ---		Project No.: GTX-1503	
	Boring No.: STN-7		Sample Type: UD			
	Description: Brown lean clay with sand					
	Remarks: System 1062					






# CONSOLIDATED UNDRAINED TRIAXIAL TEST by ASTM D4767

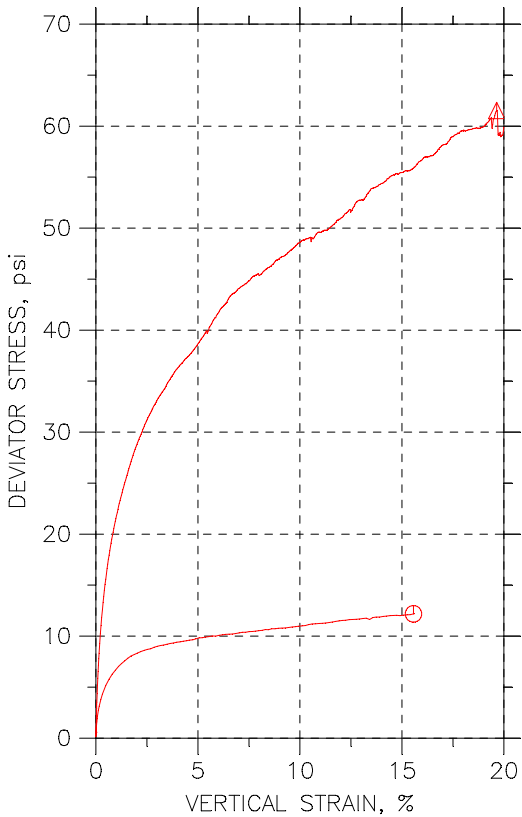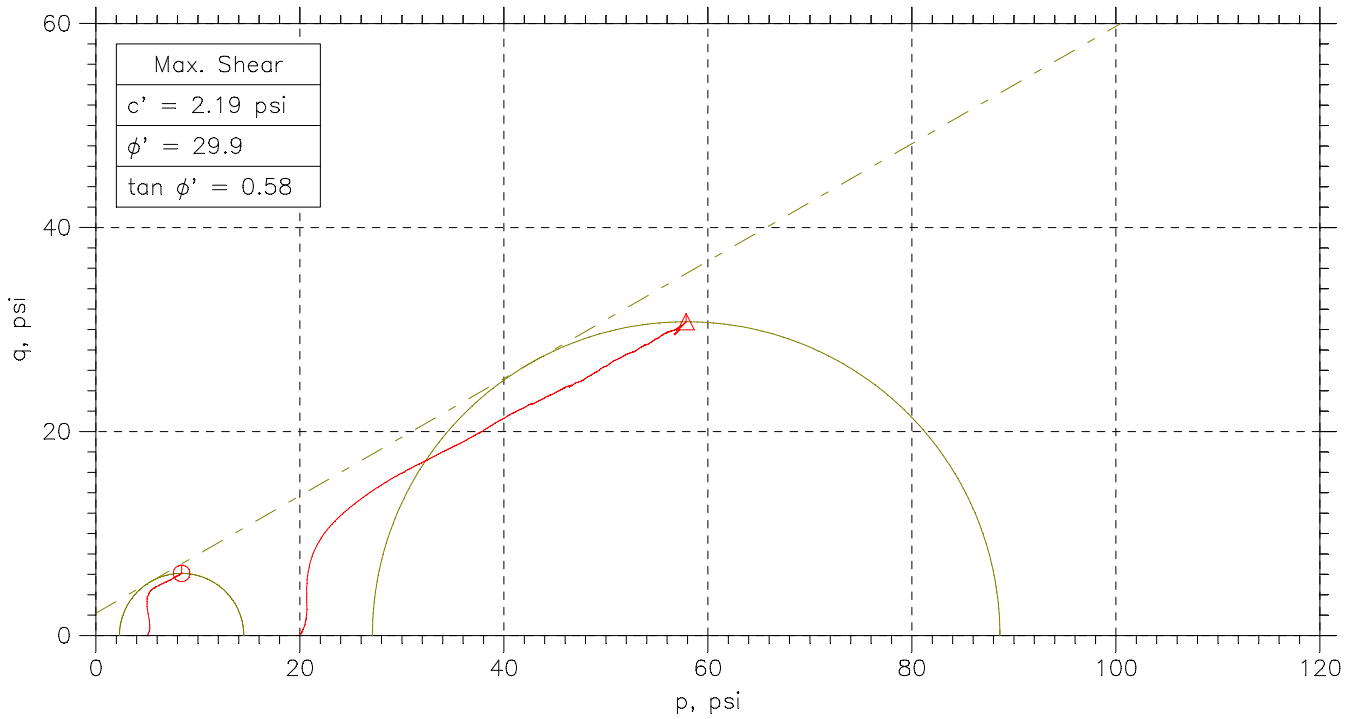


Symbol		⊖	Δ		
Sample No.		<b>STN-15</b>	STN-15		
Test No.		2.1	2.3		
Depth		5.9-6.5	12.4-13.0		
Initial	Diameter, in	2.844	2.854		
	Height, in	5.513	5.668		
	Water Content, %	13.0	12.7		
	Dry Density, pcf	115.8	121.5		
	Saturation, %	76.9	88.5		
Before Shear	Void Ratio	0.455	0.387		
	Water Content, %	14.4	13.2		
	Dry Density, pcf	121.5	124.2		
	Saturation*, %	100.0	100.0		
Void Ratio		0.388	0.357		
Back Press., psi		146.3	131		
Ver. Eff. Cons. Stress, psi		4.982	19.98		
Shear Strength, psi		6.092	30.76		
Strain at Failure, %		15.6	19.6		
Strain Rate, %/min		0.016	0.016		
B-Value		0.96	0.95		
Estimated Specific Gravity		2.7	2.7		
Liquid Limit		---	---		
Plastic Limit		---	---		

<p style="font-size: small; margin-top: 5px;">a subsidiary of Geocomp Corporation</p>	Project: Peabody Ash Pond				
	Location: ---				
	Project No.: GTX-1503				
	Boring No.: STN-15				
	Sample Type: UD				
	Description: Brown lean clay with sand				
Remarks: System 1062					



# CONSOLIDATED UNDRAINED TRIAXIAL TEST by ASTM D4767

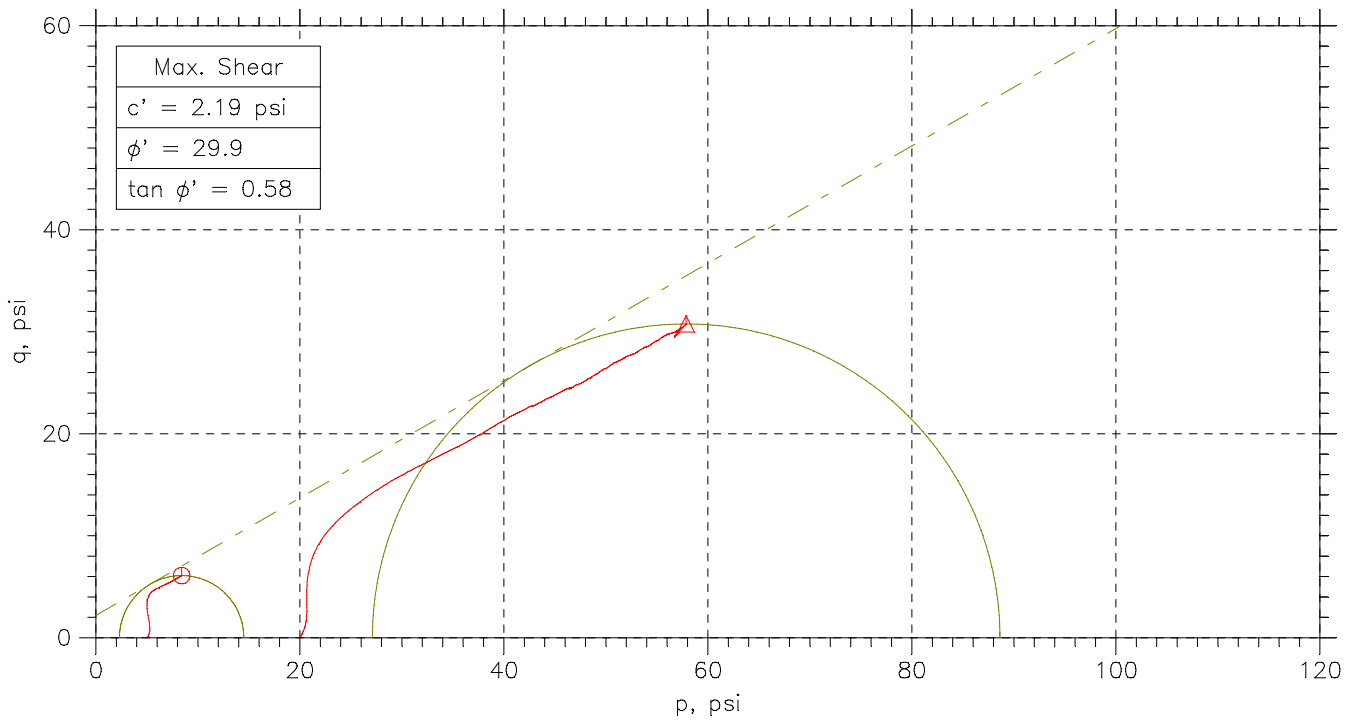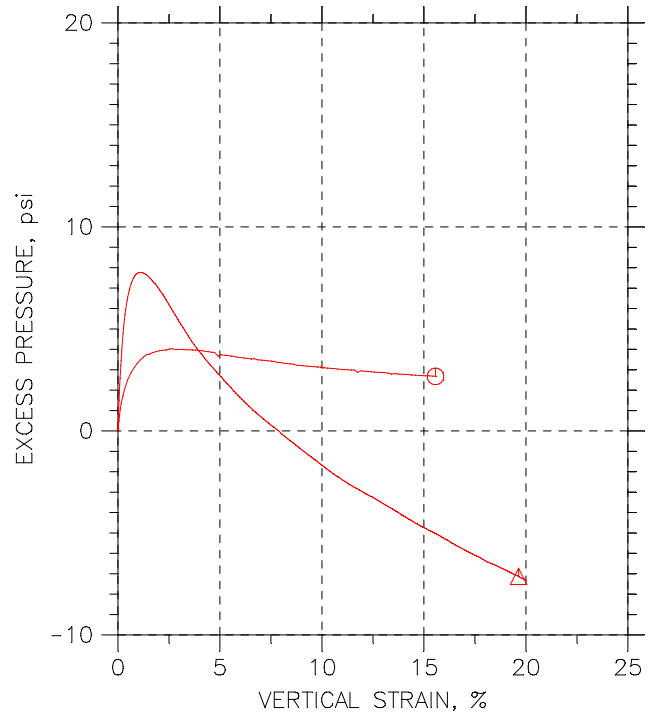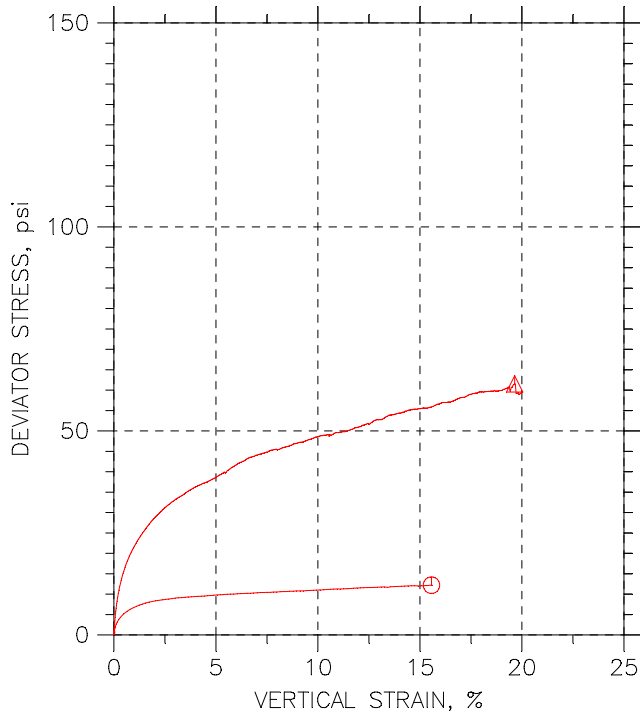


	Sample No.	Test No.	Depth	Tested By	Test Date	Checked By	Check Date	Test File
○	ST-1	2.1	5.9-6.5	jm	11/6/09	mm		1503-2.1.dat
△	STN-15	2.3	12.4-13.0	jm	11/6/09	mm		1503-2.3.dat

 <small>a subsidiary of Geocomp Corporation</small>	Project: Peabody Ash Pond		Location: ---		Project No.: GTX-1503	
	Boring No.: STN-15		Sample Type: UD			
	Description: Brown lean clay with sand					
	Remarks: System 1062					



# CONSOLIDATED UNDRAINED TRIAXIAL TEST by ASTM D4767

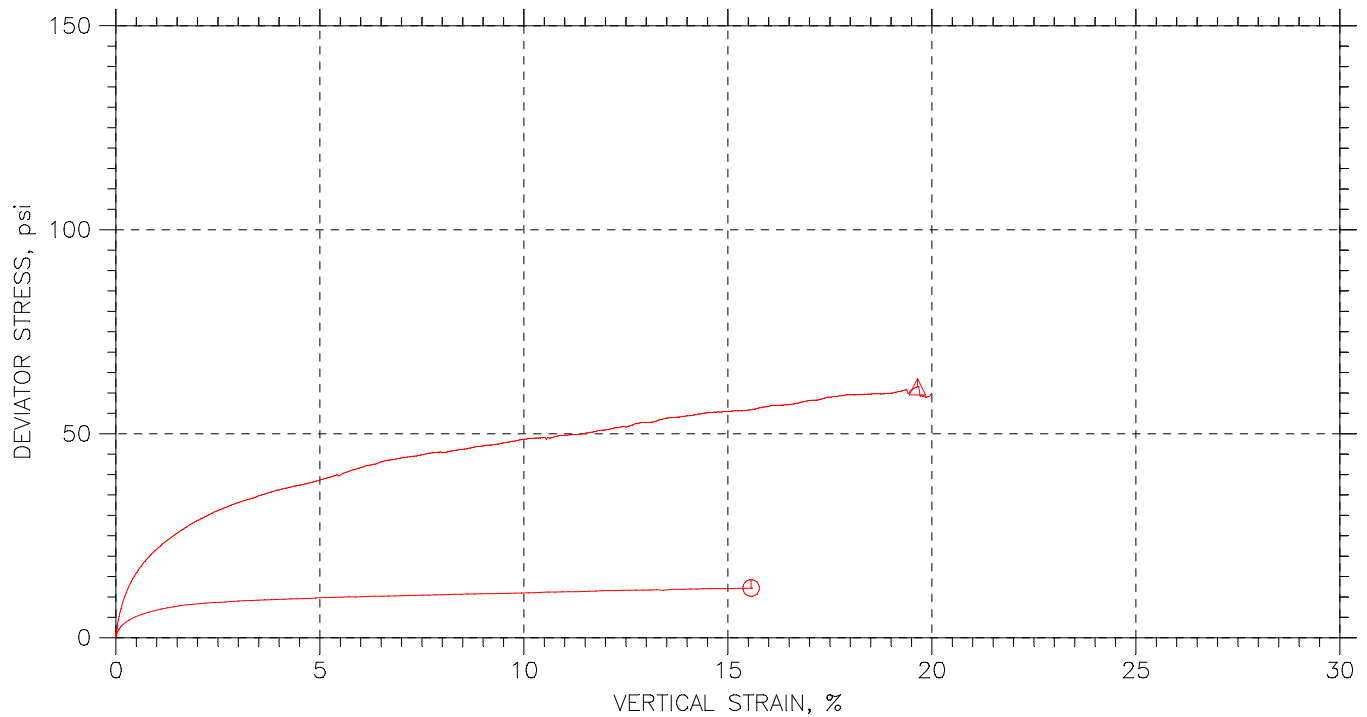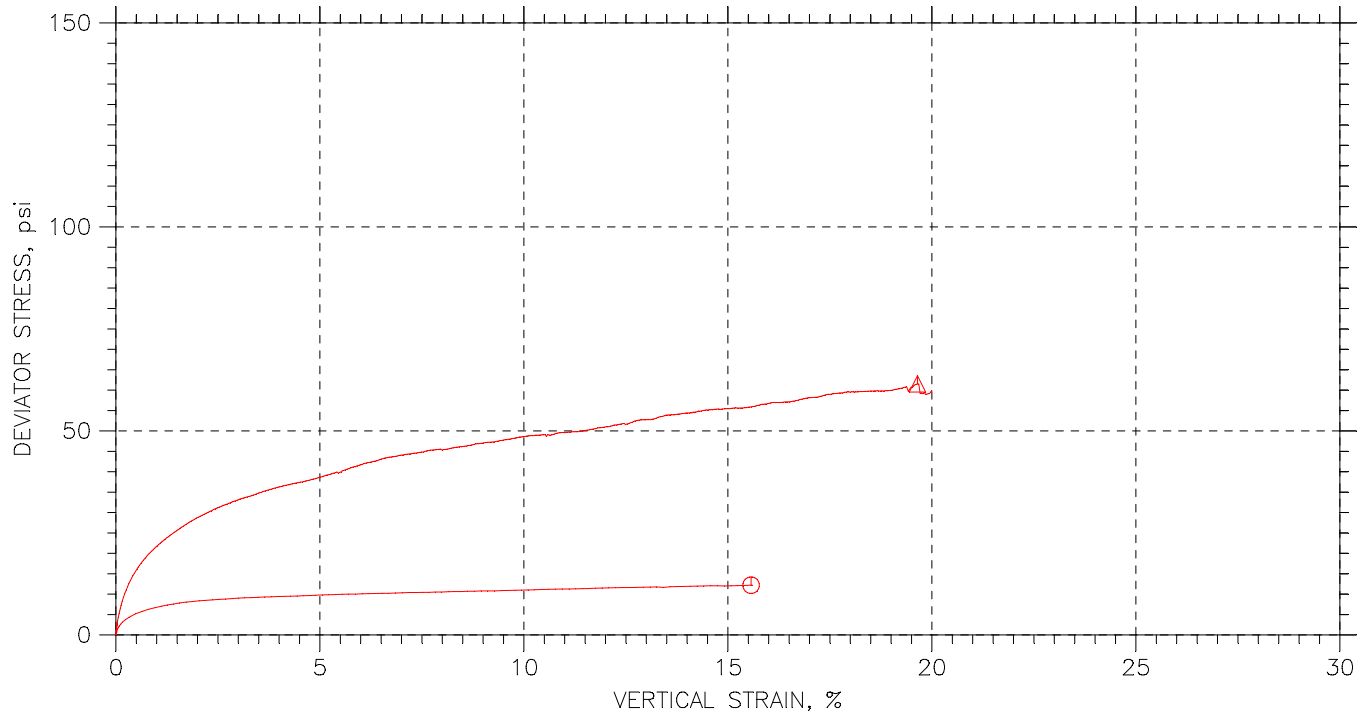

	Sample No.	Test No.	Depth	Tested By	Test Date	Checked By	Check Date	Test File
⊙	ST-1	2.1	5.9-6.5	jm	11/6/09	mm		1503-2.1.dat
△	STN-15	2.3	12.4-13.0	jm	11/6/09	mm		1503-2.3.dat

 <small>a subsidiary of Geocomp Corporation</small>	Project: Peabody Ash Pond		Location: ---		Project No.: GTX-1503	
	Boring No.: STN-15		Sample Type: UD			
	Description: Brown lean clay with sand					
	Remarks: System 1062					




# CONSOLIDATED UNDRAINED TRIAXIAL TEST by ASTM D4767

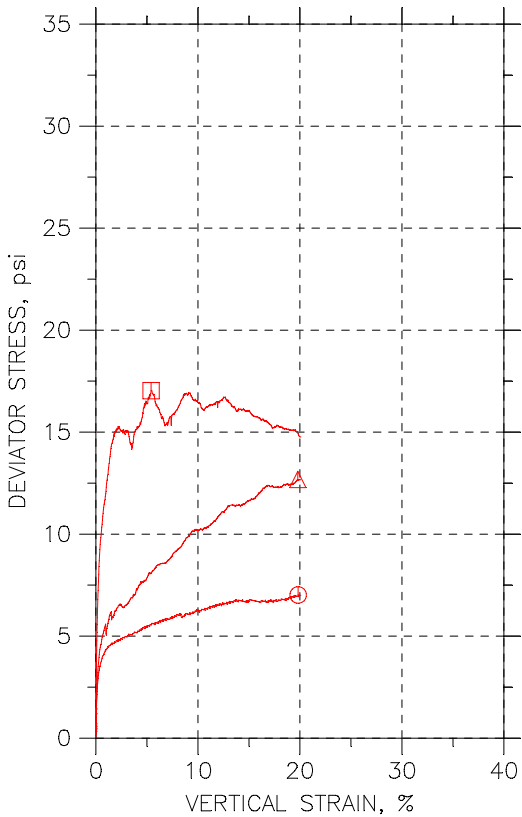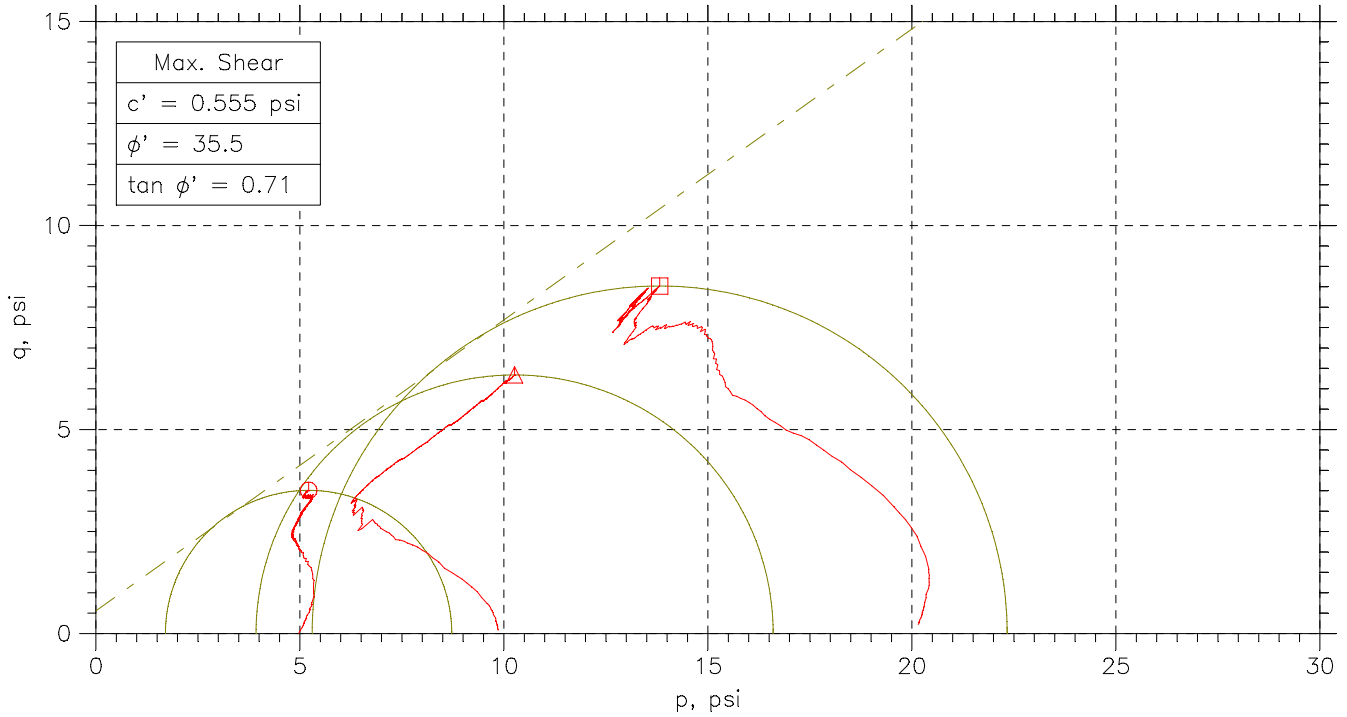

Symbol	⊙	△	□	
Sample No.	<b>STN-16</b>	<b>STN-16</b>	<b>STN-16</b>	
Test No.	3.1	3.2	3.3	
Depth	9.7-10.4	10.4-11.0	11.0-11.5	
Initial	Diameter, in	1.413	2.838	2.818
	Height, in	3.184	5.705	6.012
	Water Content, %	33.0	33.3	40.9
	Dry Density, pcf	85.6	86.42	79.52
	Saturation, %	92.0	94.7	98.6
Before Shear	Void Ratio	0.969	0.95	1.12
	Water Content, %	30.9	30.8	35.8
	Dry Density, pcf	91.9	91.98	85.72
	Saturation*, %	100.0	100.0	100.0
	Void Ratio	0.834	0.832	0.966
	Back Press., psi	122.1	116.1	131.1
	Ver. Eff. Cons. Stress, psi	4.966	9.778	19.93
	Shear Strength, psi	3.509	6.337	8.518
	Strain at Failure, %	19.8	19.8	5.41
	Strain Rate, %/min	0.016	0.016	0.016
	B-Value	0.95	0.95	0.95
	Estimated Specific Gravity	2.7	2.7	2.7
	Liquid Limit	---	---	---
	Plastic Limit	---	---	---

<p style="font-size: small;">a subsidiary of Geocomp Corporation</p>	Project: Peabody Ash Pond				
	Location: ---				
	Project No.: GTX-1503				
	Boring No.: STN-16				
	Sample Type: UD				
	Description: Gray-Brown Sandy lean clay				
Remarks: 2054					



# CONSOLIDATED UNDRAINED TRIAXIAL TEST by ASTM D4767

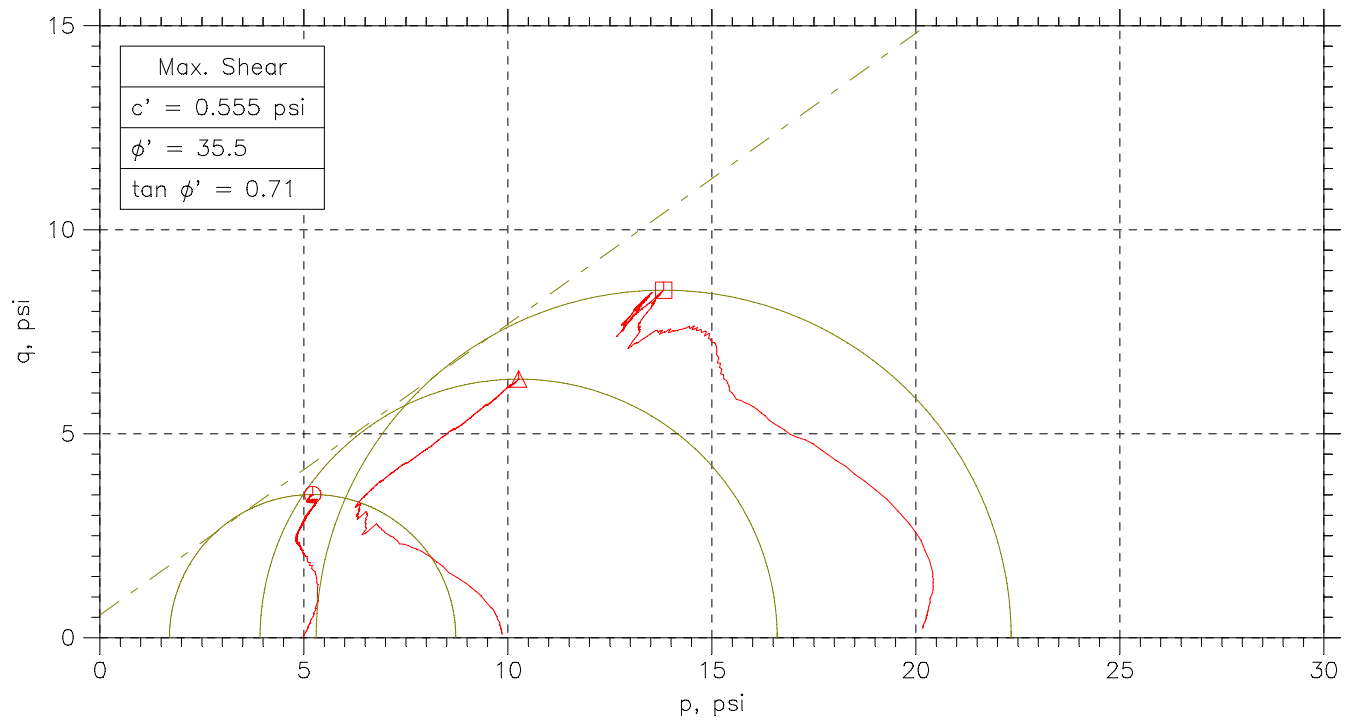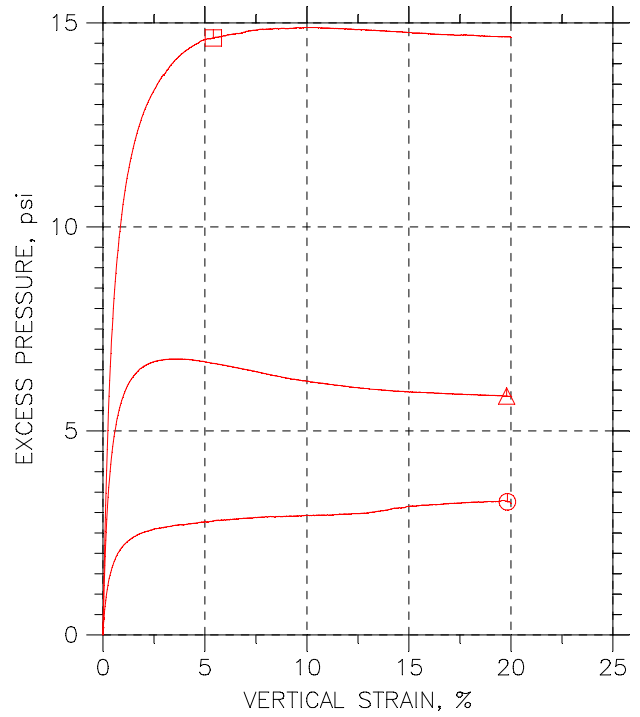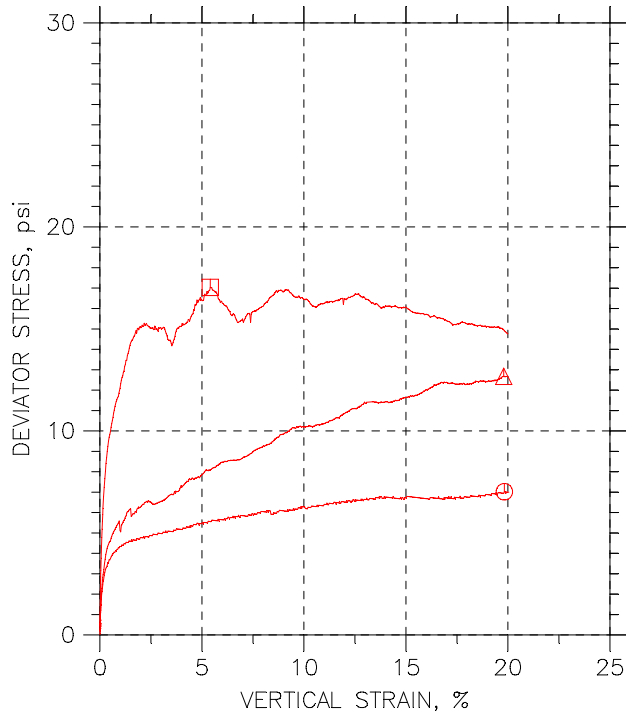


Symbol	Sample No.	Test No.	Depth	Tested By	Test Date	Checked By	Check Date	Test File
⊙	st-7	3.1	9.7-10.4	JM	11/13/09	MM		1503-3.1.dat
△	st-7	3.2	10.4-11.0	jm	11/13/09	mm		1503-3.2.dat
□	st-7	3.3	11.0-11.5	jm	11/10/09	mm		1503-3.3.dat

<p style="font-size: small; margin-top: 5px;">a subsidiary of Geocomp Corporation</p>	Project: Peabody Ash Pond		Location: ---		Project No.: GTX-1503	
	Boring No.: STN-16		Sample Type: UD			
	Description: Gray-Brown Sandy lean clay					
	Remarks: 2054					



# CONSOLIDATED UNDRAINED TRIAXIAL TEST by ASTM D4767

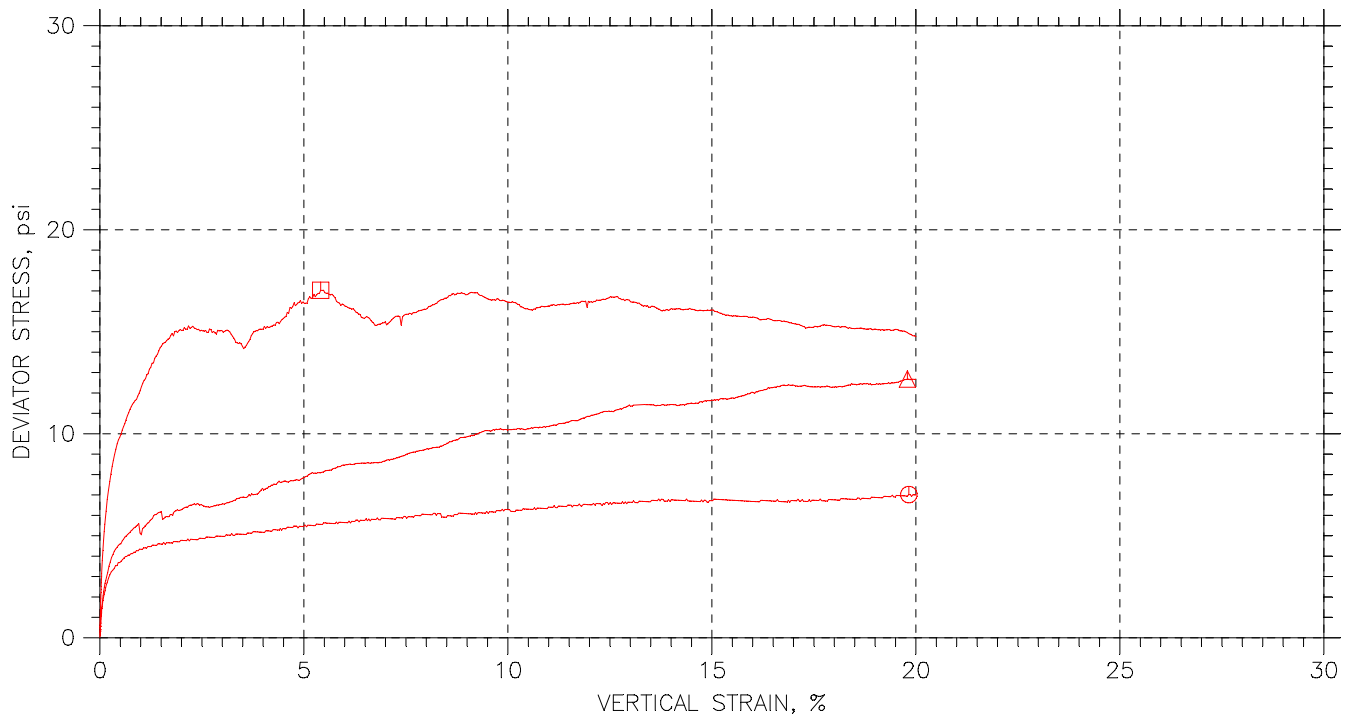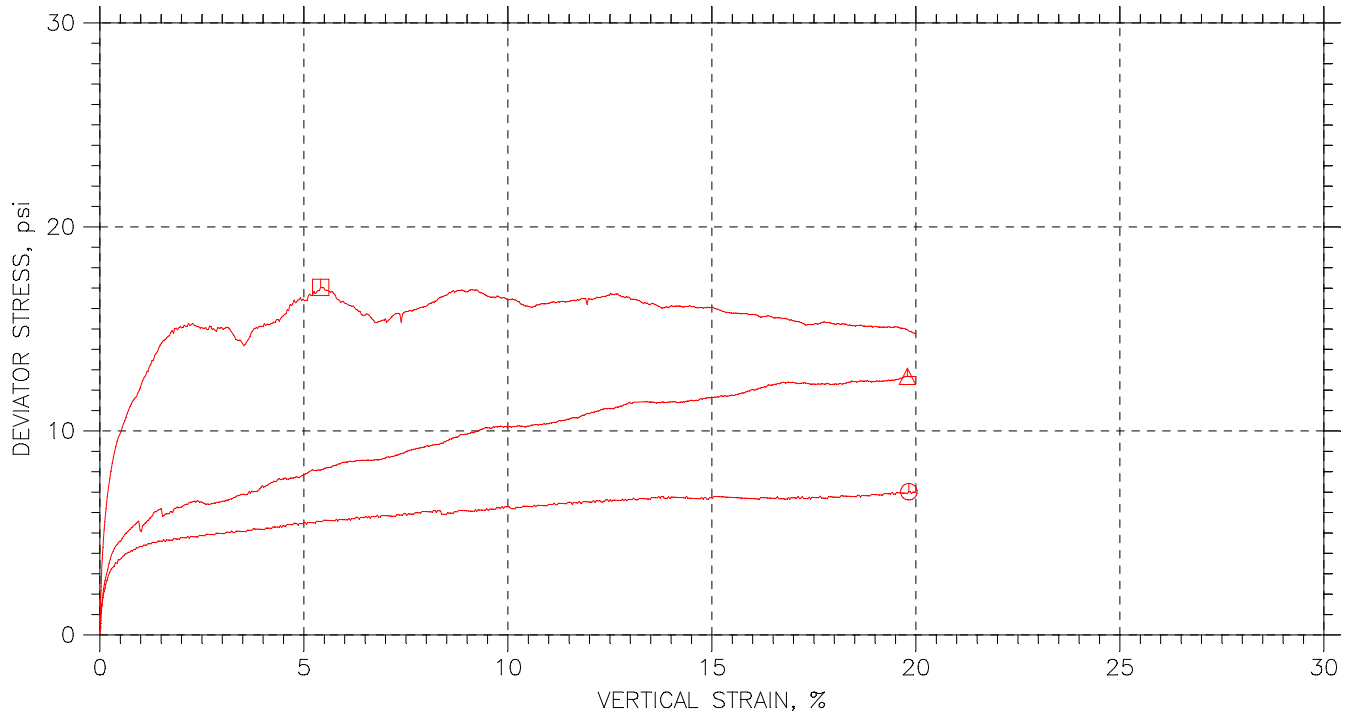

	Sample No.	Test No.	Depth	Tested By	Test Date	Checked By	Check Date	Test File
⊙	st-7	3.1	9.7-10.4	JM	11/13/09	MM		1503-3.1.dat
△	st-7	3.2	10.4-11.0	jm	11/13/09	mm		1503-3.2.dat
□	st-7	3.3	11.0-11.5	jm	11/10/09	mm		1503-3.3.dat

 <small>a subsidiary of Geocomp Corporation</small>	Project: Peabody Ash Pond		Location: ---		Project No.: GTX-1503	
	Boring No.: STN-16		Sample Type: UD			
	Description: Gray-Brown Sandy lean clay					
	Remarks: 2054					




# CONSOLIDATED UNDRAINED TRIAXIAL TEST by ASTM D4767

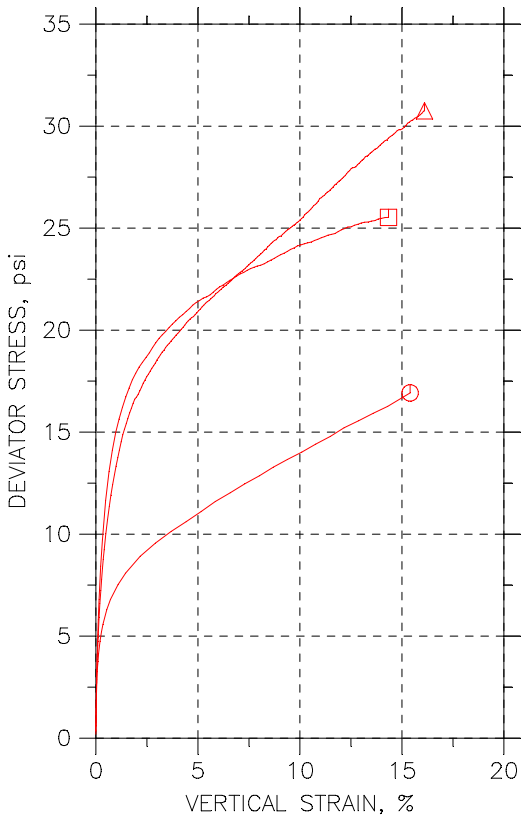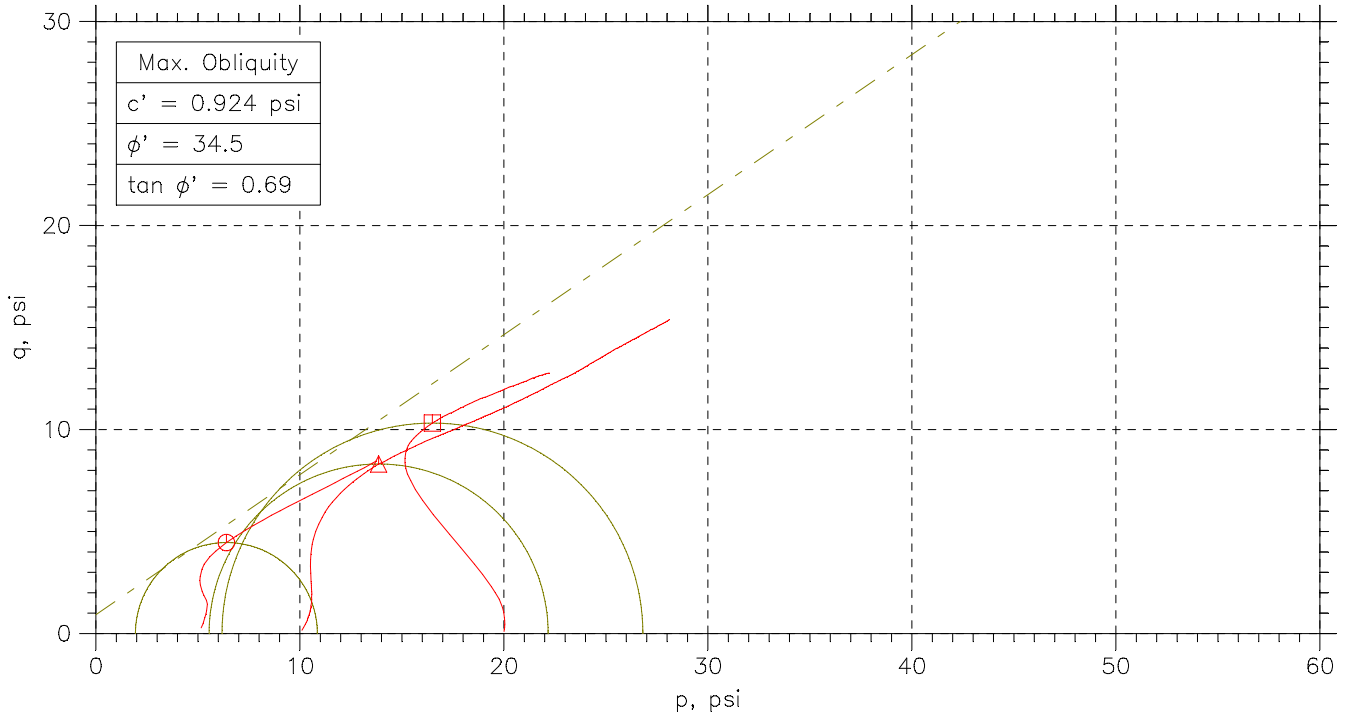

Symbol	⊙	△	□	
Sample No.	<b>STN-21</b>	<b>STN-21</b>	<b>STN-22</b>	
Test No.	4.1	4.2	4.3	
Depth	3.4-4.0	9.4-10.0	11.0-11.5	
Initial	Diameter, in	2.834	2.87	2.85
	Height, in	5.941	5.957	6.548
	Water Content, %	12.4	14.0	14.1
	Dry Density, pcf	115.5	116.3	121.6
	Saturation, %	72.6	84.2	98.9
Before Shear	Void Ratio	0.459	0.449	0.386
	Water Content, %	16.5	15.5	13.7
	Dry Density, pcf	116.5	118.9	123.1
	Saturation*, %	100.0	100.0	100.0
	Void Ratio	0.446	0.418	0.369
	Back Press., psi	147.1	95.47	122.1
	Ver. Eff. Cons. Stress, psi	4.879	9.94	19.91
	Shear Strength, psi	8.46	15.38	12.76
	Strain at Failure, %	15.4	16.1	14.3
	Strain Rate, %/min	0.016	0.016	0.016
	B-Value	0.95	0.96	0.96
	Estimated Specific Gravity	2.7	2.7	2.7
	Liquid Limit	---	---	---
	Plastic Limit	---	---	---

 <small>a subsidiary of Geocomp Corporation</small>	Project: Peabody Ash Pond				
	Location: ---				
	Project No.: GTX-1503				
	Boring No.: STN-21				
	Sample Type: UD				
	Description: Brown lean clay with sand				
Remarks: System 1062					

# CONSOLIDATED UNDRAINED TRIAXIAL TEST by ASTM D4767

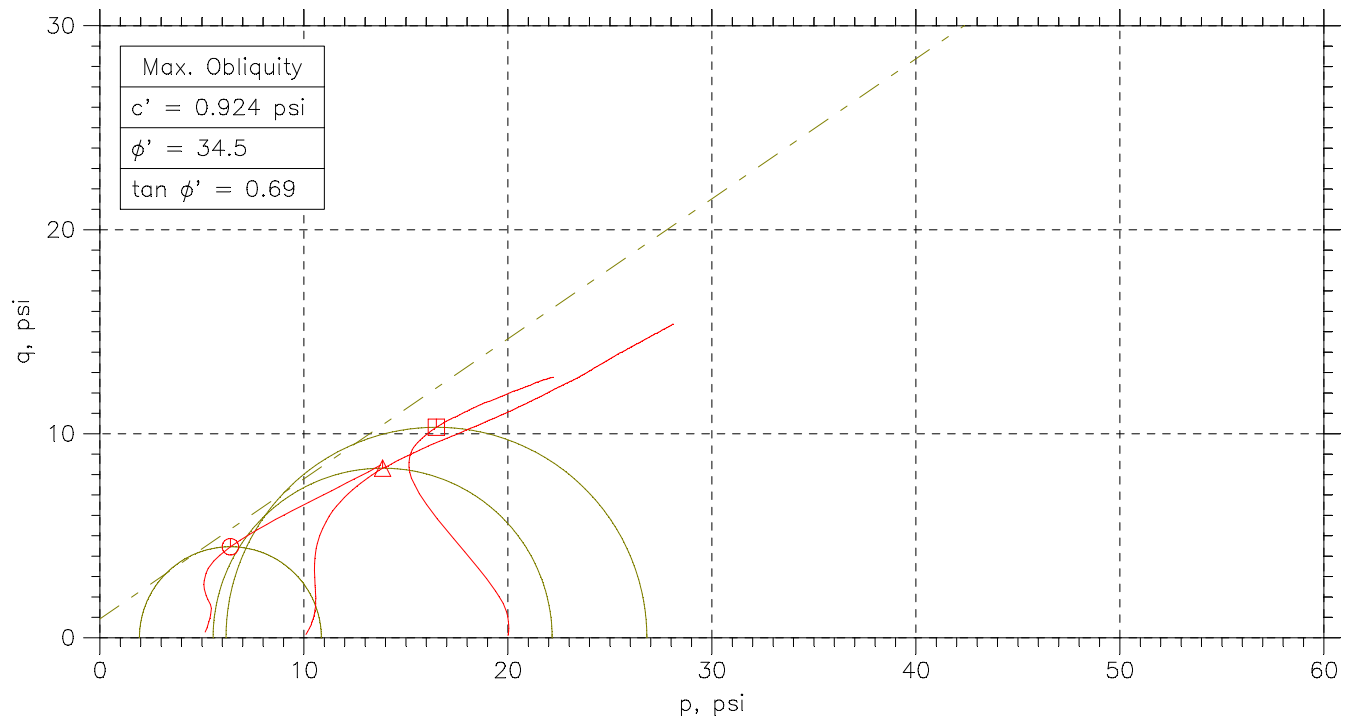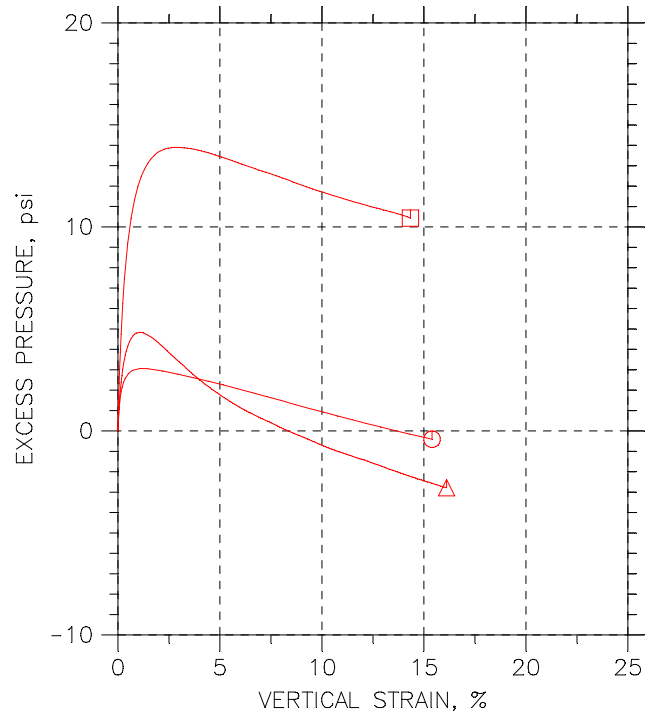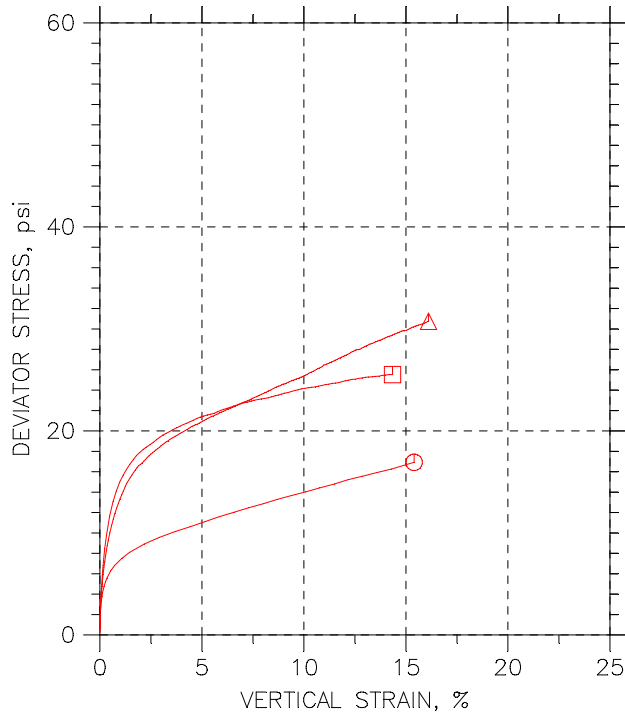



Symbol	Sample No.	Test No.	Depth	Tested By	Test Date	Checked By	Check Date	Test File
○	---	4.1	3.4-4.0	jm	11/10/09	mm		1503-4.1.dat
△	---	4.2	9.4-10.0	JM	11/10/09	MM		1503-4.2.dat
□	st-7	4.3	11.0-11.5	jm	11/9/09	mm		1503-4.3.dat




Project: Peabody Ash Pond	Location: ---	Project No.: GTX-1503
Boring No.: STN-21	Sample Type: UD	
Description: Brown lean clay with sand		
Remarks: System 1062		



# CONSOLIDATED UNDRAINED TRIAXIAL TEST by ASTM D4767

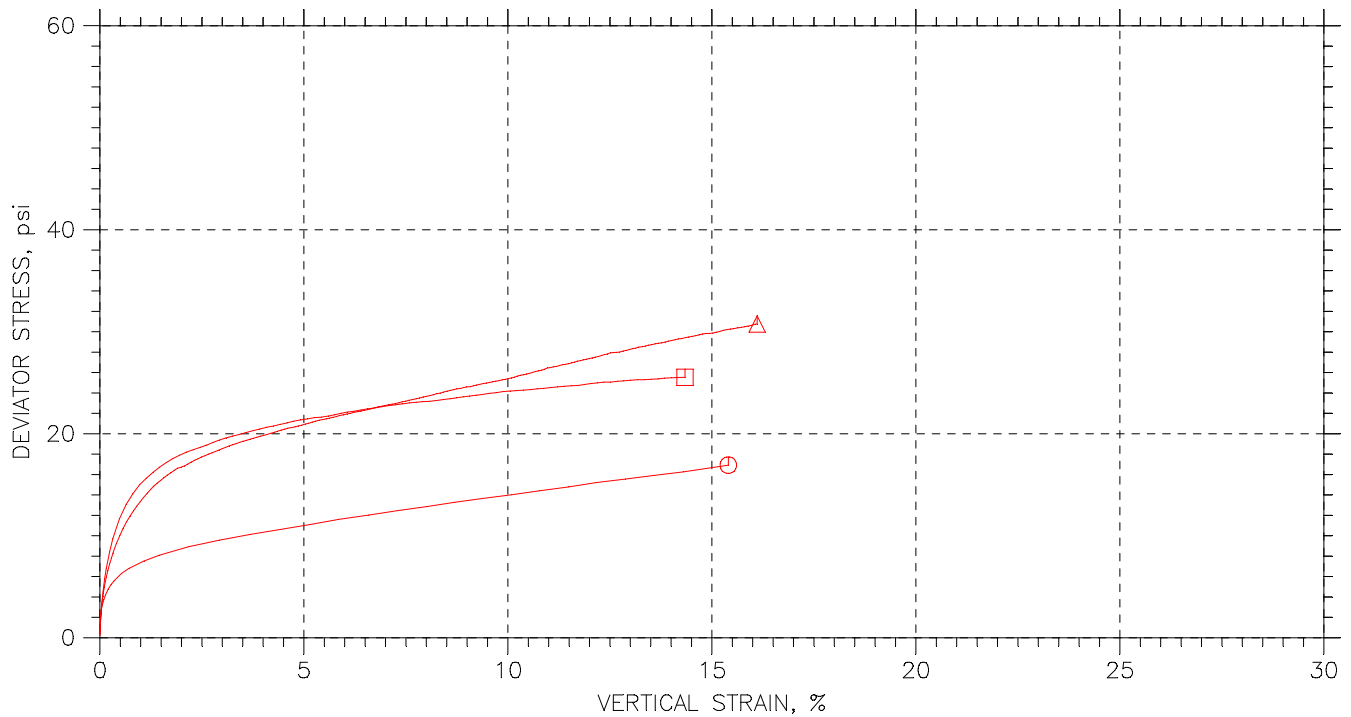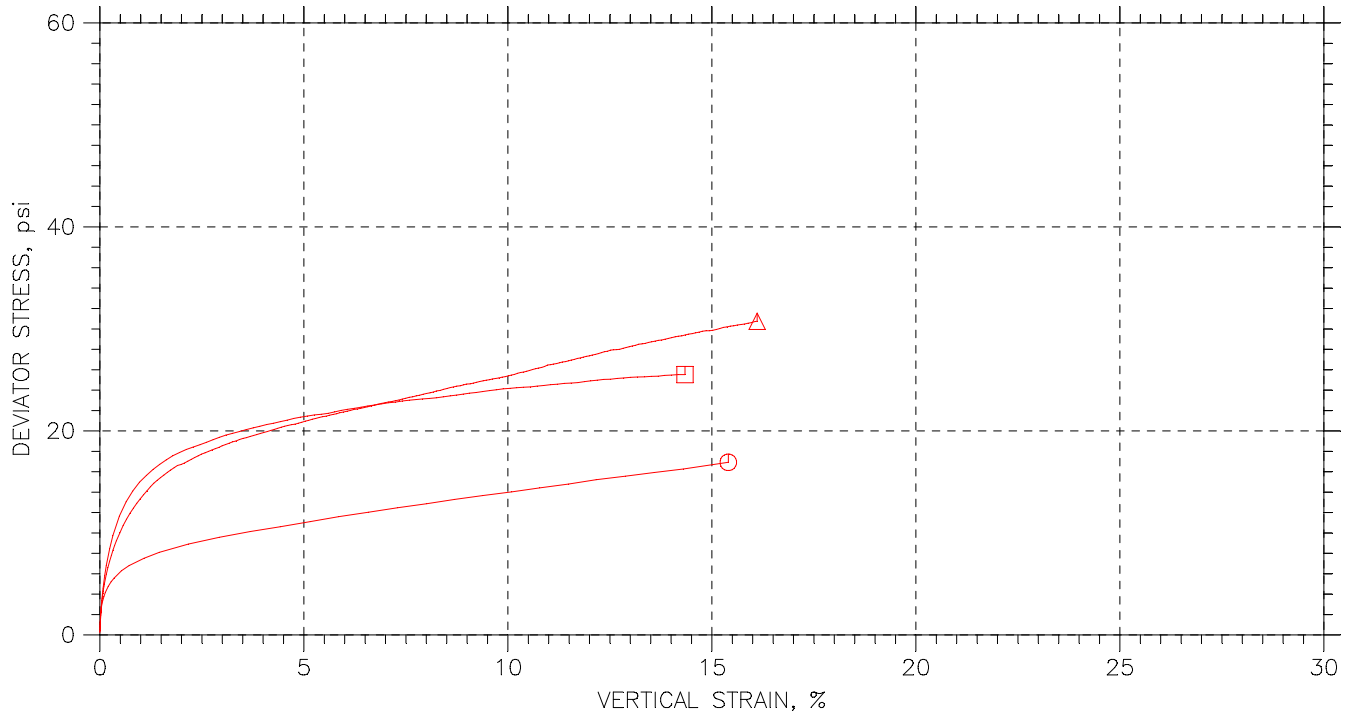

	Sample No.	Test No.	Depth	Tested By	Test Date	Checked By	Check Date	Test File
○	---	4.1	3.4-4.0	jm	11/10/09	mm		1503-4.1.dat
△	---	4.2	9.4-10.0	JM	11/10/09	MM		1503-4.2.dat
□	st-7	4.3	11.0-11.5	jm	11/9/09	mm		1503-4.3.dat

 <small>a subsidiary of Geocomp Corporation</small>	Project: Peabody Ash Pond		Location: ---		Project No.: GTX-1503	
	Boring No.: STN-21		Sample Type: UD			
	Description: Brown lean clay with sand					
	Remarks: System 1062					



## HYDRAULIC CONDUCTIVITY

Project No. **GTX-1503** Tested By **JM**  
Project Name **Peabody Ash Pond** Test Date **11//4/09**  
Boring No. **STN-6** Reviewed By **mm**  
Sample No. **ST-3** Review Date **11/8/2009**  
Sample Depth **12.4-13'** Lab No. **1**  
Sample Description **Brown silty sandy clay**

### *ASTM D5084 - Falling Head (Method C RisingTail)*

Sample Type:	<i>UD</i>
Sample Orientation:	<i>Vertical</i>
Initial Water Content, %:	<i>19.3</i>
Wet Unit Weight, pcf:	<i>126.6</i>
Dry Unit Weight, pcf:	<i>106.1</i>
Compaction, %:	<i>N/A</i>
<b>Hydraulic Conductivity, cm/sec. @20 °C</b>	<b><i>1.1E-07</i></b>

Remarks: \_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_

# PERMEABILITY TEST (ASTM D5084 - 90) (Method C, Increasing Tailwater Level)

Project Number GTX-1503 Tested By JM  
 Project Name Peabody Ash Pond Test Date 11//4/09  
 Boring No. STN-6 Reviewed By mm  
 Sample No. ST-3 Review Date 11/08/09  
 Sample Depth 12.4-13' Lab No. 1  
 Sample Description Brown silty sandy clay



### Sample Data

Length, in		Diameter, in		Pan No.	A-17
Location 1	2.866	Location 1	2.870	Dry Soil+Pan, grams	512.22
Location 2	2.787	Location 2	2.870	Pan Weight, grams	6.64
Location 3	2.765	Location 3	2.870		
Average	2.806	Average	2.870	Moisture Content, %	19.3
		Wet Soil + Tare, grams	603.33	Wet Unit Weight, pcf	126.6
		Tare Weight, grams	0.00	Dry Unit Weight, pcf	106.1

Remarks: \_\_\_\_\_  
 \_\_\_\_\_  
 \_\_\_\_\_

Chamber Pressure, psi 65  
 Back Pressure, psi 60  
 Confining Pressure, psi 5

Date Start	Date Finish	Time Start	Time Finish	Time (sec)	H <sub>a</sub> (cm)	H <sub>1</sub> (cm)	H <sub>b</sub> (cm)	H <sub>2</sub> (cm)	k cm/sec	Temp (°C)	k cm/sec at 20 °C
				300	3.7	104.7	3.40	104.1	1.4E-07	22	1.3E-07
				700	3.7	104.7	3.00	103.4	1.2E-07	22	1.1E-07
				1050	3.7	104.7	2.70	102.8	1.2E-07	22	1.1E-07
				1400	3.7	104.7	2.40	102.2	1.2E-07	22	1.1E-07
				1600	3.7	104.7	2.30	102	1.1E-07	22	1.1E-07

No. of Trials	Sample Type	Max. Density (pcf)	Compaction %	Sample Orientation
5	UD	106.1	N/A	Vertical

Avg. k at 20 °C 1.1E-07 cm/sec

a = area of burette in cm<sup>2</sup>      H<sub>a</sub> = initial inlet head in cm      H<sub>b</sub> = final inlet head in cm      a = 0.16 cm<sup>2</sup>  
 L = length of sample in cm      H<sub>1</sub> = initial outlet head in cm      H<sub>2</sub> = final outlet head in cm      A = 41.74 cm<sup>2</sup>  
 A = area of sample in cm<sup>2</sup>      t = time in seconds      L = 7.13 cm

# PERMEABILITY TEST (ASTM D5084 - 90) (Method C, Increasing Tailwater Level)

Project Number GTX-1503 Tested By JM  
 Project Name Peabody Ash Pond Test Date 11/14/09  
 Boring No. STN-7 Reviewed By MM  
 Sample No. ST-2 Review Date 11/07/09  
 Sample Depth 11.8-12.4 Lab No. 2  
 Sample Description Brown lean clay



### Sample Data

Length, in		Diameter, in		Pan No.	B-44
Location 1	2.831	Location 1	2.873	Dry Soil+Pan, grams	499.22
Location 2	2.830	Location 2	2.873	Pan Weight, grams	7.88
Location 3	2.829	Location 3	2.873		
Average	2.830	Average	2.873	Moisture Content, %	17.4
		Wet Soil + Tare, grams	577.00	Wet Unit Weight, pcf	119.8
		Tare Weight, grams	0.00	Dry Unit Weight, pcf	102.0

Remarks: \_\_\_\_\_  
 \_\_\_\_\_  
 \_\_\_\_\_

Chamber Pressure, psi 65  
 Back Pressure, psi 60  
 Confining Pressure, psi 5

Date Start	Date Finish	Time Start	Time Finish	Time (sec)	H <sub>a</sub> (cm)	H <sub>1</sub> (cm)	H <sub>b</sub> (cm)	H <sub>2</sub> (cm)	k cm/sec	Temp (°C)	k cm/sec at 20 °C
				960	7.5	106.3	7.70	106.2	4.4E-08	22	4.2E-08
				4800	7.5	106.3	9.00	106	5.3E-08	24	4.8E-08
				8400	7.5	106.3	9.70	105.7	4.7E-08	24	4.3E-08
				16090	7.5	106.3	11.90	105.1	5.0E-08	24	4.5E-08
				28000	7.5	106.3	15.30	104.3	5.1E-08	24	4.7E-08

No. of Trials	Sample Type	Max. Density (pcf)	Compaction %	Sample Orientation
5	UD	102.0	N/A	Vertical

Avg. k at 20 °C 4.5E-08 cm/sec

a = area of burette in cm<sup>2</sup>      H<sub>a</sub> = initial inlet head in cm      H<sub>b</sub> = final inlet head in cm      a = 0.16 cm<sup>2</sup>  
 L = length of sample in cm      H<sub>1</sub> = initial outlet head in cm      H<sub>2</sub> = final outlet head in cm      A = 41.82 cm<sup>2</sup>  
 A = area of sample in cm<sup>2</sup>      t = time in seconds      L = 7.19 cm



## HYDRAULIC CONDUCTIVITY

Project No. **GTX-1503** Tested By **JM**  
Project Name **Peabody Ash Pond** Test Date **11/14/2009**  
Boring No. **STN-7** Reviewed By **MM**  
Sample No. **ST-2** Review Date **11/7/2009**  
Sample Depth **11.8-12.4** Lab No. **2**  
Sample Description **Brown lean clay**

### *ASTM D5084 - Falling Head (Method C RisingTail)*

Sample Type:	<i>UD</i>
Sample Orientation:	<i>Vertical</i>
Initial Water Content, %:	<i>17.4</i>
Wet Unit Weight, pcf:	<i>119.8</i>
Dry Unit Weight, pcf:	<i>102.0</i>
Compaction, %:	<i>N/A</i>
<b>Hydraulic Conductivity, cm/sec. @20 °C</b>	<b><i>4.5E-08</i></b>

Remarks: \_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_

# PERMEABILITY TEST (ASTM D5084 - 90) (Method C, Increasing Tailwater Level)

Project Number GTX-1503 Tested By JM  
 Project Name Peabody Ash Pond Test Date 11/04/09  
 Boring No. STN-16 Reviewed By MM  
 Sample No. ST-1 Review Date 11/08/09  
 Sample Depth 4.5-5.1 ft Lab No. 3  
 Sample Description \_\_\_\_\_



### Sample Data

Length, in		Diameter, in		Pan No.	A-12
Location 1	2.708	Location 1	2.844	Dry Soil+Pan, grams	474.33
Location 2	2.710	Location 2	2.843	Pan Weight, grams	9.66
Location 3	2.709	Location 3	2.845		
Average	2.709	Average	2.844	Moisture Content, %	18.8
		Wet Soil + Tare, grams	552.12	Wet Unit Weight, pcf	122.2
		Tare Weight, grams	0.00	Dry Unit Weight, pcf	102.9

Remarks: \_\_\_\_\_  
 \_\_\_\_\_  
 \_\_\_\_\_

Chamber Pressure, psi 65  
 Back Pressure, psi 60  
 Confining Pressure, psi 5

Date Start	Date Finish	Time Start	Time Finish	Time (sec)	H <sub>a</sub> (cm)	H <sub>1</sub> (cm)	H <sub>b</sub> (cm)	H <sub>2</sub> (cm)	k cm/sec	Temp (°C)	k cm/sec at 20 °C
				940	5.1	100.8	5.30	100.6	6.0E-08	22	5.7E-08
				1600	5.1	100.8	5.40	100.4	6.2E-08	22	5.9E-08
				2300	5.1	100.8	5.60	100.3	6.1E-08	22	5.9E-08
				5500	5.1	100.8	6.40	99.8	5.9E-08	22	5.7E-08
				8600	5.1	100.8	7.50	99.5	6.2E-08	22	5.9E-08

No. of Trials	Sample Type	Max. Density (pcf)	Compaction %	Sample Orientation
5	UD	102.9	N/A	Vertical

Avg. k at 20 °C 5.8E-08 cm/sec

a = area of burette in cm<sup>2</sup>      H<sub>a</sub> = initial inlet head in cm      H<sub>b</sub> = final inlet head in cm      a = 0.16 cm<sup>2</sup>  
 L = length of sample in cm      H<sub>1</sub> = initial outlet head in cm      H<sub>2</sub> = final outlet head in cm      A = 40.98 cm<sup>2</sup>  
 A = area of sample in cm<sup>2</sup>      t = time in seconds      L = 6.88 cm



## HYDRAULIC CONDUCTIVITY

Project No. *GTX-1503* Tested By *JM*  
Project Name *Peabody Ash Pond* Test Date *11/4/2009*  
Boring No. *STN-16* Reviewed By *MM*  
Sample No. *ST-1* Review Date *11/8/2009*  
Sample Depth *4.5-5.1 ft* Lab No. *3*  
Sample Description

### *ASTM D5084 - Falling Head (Method C RisingTail)*

Sample Type:	<i>UD</i>
Sample Orientation:	<i>Vertical</i>
Initial Water Content, %:	<i>18.8</i>
Wet Unit Weight, pcf:	<i>122.2</i>
Dry Unit Weight, pcf:	<i>102.9</i>
Compaction, %:	<i>N/A</i>
<b>Hydraulic Conductivity, cm/sec. @20 °C</b>	<b><i>5.8E-08</i></b>

Remarks: \_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_

# PERMEABILITY TEST (ASTM D5084 - 90) (Method C, Increasing Tailwater Level)

Project Number GTX-1503 Tested By JM  
 Project Name Peabody Ash Pond Test Date 11/04/09  
 Boring No. STN-16 Reviewed By MM  
 Sample No. ST-1 Review Date 11/09/09  
 Sample Depth 5.7-6.3 ft Lab No. 4  
 Sample Description \_\_\_\_\_



### Sample Data

Length, in		Diameter, in		Pan No.	G-8
Location 1	3.006	Location 1	2.870	Dry Soil+Pan, grams	572.33
Location 2	2.981	Location 2	2.870	Pan Weight, grams	9.59
Location 3	2.994	Location 3	2.870		
Average	2.994	Average	2.870	Moisture Content, %	17.5
		Wet Soil + Tare, grams	661.45	Wet Unit Weight, pcf	130.1
		Tare Weight, grams	0.00	Dry Unit Weight, pcf	110.7

Remarks: \_\_\_\_\_  
 \_\_\_\_\_  
 \_\_\_\_\_

Chamber Pressure, psi 65  
 Back Pressure, psi 60  
 Confining Pressure, psi 5

Date Start	Date Finish	Time Start	Time Finish	Time (sec)	H <sub>a</sub> (cm)	H <sub>1</sub> (cm)	H <sub>b</sub> (cm)	H <sub>2</sub> (cm)	k cm/sec	Temp (°C)	k cm/sec at 20 °C
				60000	8.6	105.4	19.50	92.8	6.8E-08	22	6.5E-08
				84000	8.6	105.4	22.10	89.6	6.3E-08	22	6.0E-08
				96000	8.6	105.4	24.80	87.4	6.6E-08	22	6.3E-08
				150000	8.6	105.4	31.50	80.8	6.6E-08	22	6.3E-08
				220000	8.6	105.4	39.20	74.4	6.7E-08	22	6.4E-08

No. of Trials	Sample Type	Max. Density (pcf)	Compaction %	Sample Orientation
5	tube	110.7	NA	Vertical

Avg. k at 20 °C 6.3E-08 cm/sec

a = area of burette in cm<sup>2</sup>      H<sub>a</sub> = initial inlet head in cm      H<sub>b</sub> = final inlet head in cm      a = 0.16 cm<sup>2</sup>  
 L = length of sample in cm      H<sub>1</sub> = initial outlet head in cm      H<sub>2</sub> = final outlet head in cm      A = 41.74 cm<sup>2</sup>  
 A = area of sample in cm<sup>2</sup>      t = time in seconds      L = 7.60 cm





## HYDRAULIC CONDUCTIVITY

Project No. *GTX-1503* Tested By *JM*  
Project Name *Peabody Ash Pond* Test Date *11/4/2009*  
Boring No. *STN-16* Reviewed By *MM*  
Sample No. *ST-1* Review Date *11/9/2009*  
Sample Depth *5.7-6.3 ft* Lab No. *4*  
Sample Description

### *ASTM D5084 - Falling Head (Method C RisingTail)*

Sample Type:	<i>Tube</i>
Sample Orientation:	<i>Vertical</i>
Initial Water Content, %:	<i>17.5</i>
Wet Unit Weight, pcf:	<i>130.1</i>
Dry Unit Weight, pcf:	<i>110.7</i>
Compaction, %:	<i>NA</i>
<b>Hydraulic Conductivity, cm/sec. @20 °C</b>	<b><i>6.3E-08</i></b>

Remarks: \_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_

# PERMEABILITY TEST (ASTM D5084 - 90) (Method C, Increasing Tailwater Level)

Project Number GTX-1503 Tested By JM  
 Project Name Peabody Ash Pond Test Date 11/08/09  
 Boring No. STN-21 Reviewed By MM  
 Sample No. ST-1 Review Date 11/12/09  
 Sample Depth 2.2-2.8 ft Lab No. 4  
 Sample Description Brown sandy silty clay



### Sample Data

Length, in		Diameter, in		Pan No.	LP-2
Location 1	2.801	Location 1	2.840	Dry Soil+Pan, grams	546.22
Location 2	2.890	Location 2	2.840	Pan Weight, grams	9.82
Location 3	2.850	Location 3	2.840		
Average	2.847	Average	2.840	Moisture Content, %	10.3
		Wet Soil + Tare, grams	591.88	Wet Unit Weight, pcf	125.0
		Tare Weight, grams	0.00	Dry Unit Weight, pcf	113.3

Remarks: \_\_\_\_\_  
 \_\_\_\_\_  
 \_\_\_\_\_

Chamber Pressure, psi 65  
 Back Pressure, psi 60  
 Confining Pressure, psi 5

Date Start	Date Finish	Time Start	Time Finish	Time (sec)	H <sub>a</sub> (cm)	H <sub>1</sub> (cm)	H <sub>b</sub> (cm)	H <sub>2</sub> (cm)	k cm/sec	Temp (°C)	k cm/sec at 20 °C
				1800	7.7	94.5	8.90	94	1.6E-07	22	1.5E-07
				2200	7.7	94.5	9.40	94	1.7E-07	22	1.6E-07
				10600	7.7	94.5	14.40	89	2.0E-07	22	1.9E-07
				14000	7.7	94.5	15.80	88	1.9E-07	22	1.8E-07
				19000	7.7	94.5	16.30	86	1.6E-07	22	1.6E-07

No. of Trials	Sample Type	Max. Density (pcf)	Compaction %	Sample Orientation
5	UD	111.8	N/A	Vertical

Avg. k at 20 °C 1.7E-07 cm/sec

a = area of burette in cm<sup>2</sup>      H<sub>a</sub> = initial inlet head in cm      H<sub>b</sub> = final inlet head in cm      a = 0.16 cm<sup>2</sup>  
 L = length of sample in cm      H<sub>1</sub> = initial outlet head in cm      H<sub>2</sub> = final outlet head in cm      A = 40.87 cm<sup>2</sup>  
 A = area of sample in cm<sup>2</sup>      t = time in seconds      L = 7.23 cm



## HYDRAULIC CONDUCTIVITY

Project No. **GTX-1503** Tested By **JM**  
Project Name **Peabody Ash Pond** Test Date **11/08/09**  
Boring No. **STN-21** Reviewed By **MM**  
Sample No. **ST-1** Review Date **11/12/09**  
Sample Depth **2.2-2.8 ft** Lab No. **5**  
Sample Description **Brown sandy silty clay**

### *ASTM D5084 - Falling Head (Method C RisingTail)*

Sample Type:	<i>UD</i>
Sample Orientation:	<i>Vertical</i>
Initial Water Content, %:	<i>10.3</i>
Wet Unit Weight, pcf:	<i>125.0</i>
Dry Unit Weight, pcf:	<i>113.3</i>
Compaction, %:	<i>N/A</i>
<b>Hydraulic Conductivity, cm/sec. @20 °C</b>	<b><i>1.7E-07</i></b>

Remarks: \_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_

# PERMEABILITY TEST (ASTM D5084 - 90) (Method C, Increasing Tailwater Level)

Project Number GTX-1503 Tested By JM  
 Project Name Peabody Ash Pond Test Date 11/08/09  
 Boring No. STN-22 Reviewed By MM  
 Sample No. ST-1 Review Date 11/12/09  
 Sample Depth 5.5-6 ft Lab No. 6  
 Sample Description Brown sandy silty clay



### Sample Data

Length, in		Diameter, in		Pan No.	M-2
Location 1	2.750	Location 1	2.870	Dry Soil+Pan, grams	532.01
Location 2	2.770	Location 2	2.870	Pan Weight, grams	7.95
Location 3	2.798	Location 3	2.870		
Average	2.773	Average	2.870	Moisture Content, %	14.9
		Wet Soil + Tare, grams	602.19	Wet Unit Weight, pcf	127.9
		Tare Weight, grams	0.00	Dry Unit Weight, pcf	111.3

Remarks: \_\_\_\_\_  
 \_\_\_\_\_  
 \_\_\_\_\_

Chamber Pressure, psi 65  
 Back Pressure, psi 60  
 Confining Pressure, psi 5

Date Start	Date Finish	Time Start	Time Finish	Time (sec)	H <sub>a</sub> (cm)	H <sub>1</sub> (cm)	H <sub>b</sub> (cm)	H <sub>2</sub> (cm)	k cm/sec	Temp (°C)	k cm/sec at 20 °C
				660	9.7	102.3	9.90	102.1	8.9E-08	22	8.5E-08
				1500	9.7	102.3	10.20	101.9	8.8E-08	22	8.4E-08
				1800	9.7	102.3	10.30	101.8	9.0E-08	22	8.6E-08
				3900	9.7	102.3	10.90	101.2	8.7E-08	22	8.3E-08
				6200	9.7	102.3	11.50	100.5	8.6E-08	22	8.2E-08

No. of Trials	Sample Type	Max. Density (pcf)	Compaction %	Sample Orientation
5	UD	111.3	N/A	Vertical

Avg. k at 20 °C 8.4E-08 cm/sec

a = area of burette in cm<sup>2</sup>      H<sub>a</sub> = initial inlet head in cm      H<sub>b</sub> = final inlet head in cm      a = 0.16 cm<sup>2</sup>  
 L = length of sample in cm      H<sub>1</sub> = initial outlet head in cm      H<sub>2</sub> = final outlet head in cm      A = 41.74 cm<sup>2</sup>  
 A = area of sample in cm<sup>2</sup>      t = time in seconds      L = 7.04 cm



## HYDRAULIC CONDUCTIVITY

Project No. **GTX-1503** Tested By **JM**  
Project Name **Peabody Ash Pond** Test Date **11/8/2009**  
Boring No. **STN-22** Reviewed By **MM**  
Sample No. **ST-1** Review Date **11/12/2009**  
Sample Depth **5.5-6 ft** Lab No. **6**  
Sample Description **Brown sandy silty clay**

### *ASTM D5084 - Falling Head (Method C RisingTail)*

Sample Type:	<i>UD</i>
Sample Orientation:	<i>Vertical</i>
Initial Water Content, %:	<i>14.9</i>
Wet Unit Weight, pcf:	<i>127.9</i>
Dry Unit Weight, pcf:	<i>111.3</i>
Compaction, %:	<i>N/A</i>
<b>Hydraulic Conductivity, cm/sec. @20 °C</b>	<b><i>8.4E-08</i></b>

Remarks: \_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_



Summary of Soil Tests MI

Project Name TVA - PAF Peabody Ash Pond Project Number 175569069  
 Source STN-15, 8.0'-9.5', 9.5'-11.0' Lab ID 378  
 County Muhlenberg, Ky Date Received 11-11-09  
 Sample Type SPT Comp Date Reported 11-20-09

**Test Results**

**Natural Moisture Content**

Test Not Performed  
 Moisture Content (%): N/A

**Atterberg Limits**

Test Method: ASTM D 4318 Method A  
 Prepared: Dry  
 Liquid Limit: 35  
 Plastic Limit: 19  
 Plasticity Index: 16  
 Activity Index: 0.89

**Particle Size Analysis**

Preparation Method: ASTM D 421  
 Gradation Method: ASTM D 422  
 Hydrometer Method: ASTM D 422

Particle Size		% Passing
Sieve Size	(mm)	
3"	75	
2"	50	
1 1/2"	37.5	
1"	25	100.0
3/4"	19	87.9
3/8"	9.5	81.0
No. 4	4.75	77.3
No. 10	2	70.4
No. 40	0.425	64.2
No. 200	0.075	58.9
	0.02	47.3
	0.005	30.8
	0.002	18.4
estimated	0.001	10.0

**Moisture-Density Relationship**

Test Not Performed  
 Maximum Dry Density (lb/ft<sup>3</sup>): N/A  
 Maximum Dry Density (kg/m<sup>3</sup>): N/A  
 Optimum Moisture Content (%): N/A  
 Over Size Correction %: N/A

**California Bearing Ratio**

Test Not Performed  
 Bearing Ratio (%): N/A  
 Compacted Dry Density (lb/ft<sup>3</sup>): N/A  
 Compacted Moisture Content (%): N/A

**Specific Gravity**

Test Method: ASTM D 854  
 Prepared: Dry  
 Particle Size: No. 10  
 Specific Gravity at 20° Celsius: 2.73

Plus 3 in. material, not included: 0 (%)

Range	ASTM (%)	AASHTO (%)
Gravel	22.7	29.6
Coarse Sand	6.9	6.2
Medium Sand	6.2	---
Fine Sand	5.3	5.3
Silt	28.1	40.5
Clay	30.8	18.4

**Classification**

Unified Group Symbol: CL  
 Group Name: Gravelly lean clay with sand  
 AASHTO Classification: A-6 (7)


Comments: \_\_\_\_\_

Reviewed by: Rj

Project TVA - PAF Peabody Ash Pond  
 Source STN-15, 8.0'-9.5', 9.5'-11.0'  
 Tested By mc Test Method ASTM D 4318 Method A  
 Test Date 11-19-2009 Prepared Dry

Project No. 175569069  
 Lab ID 378  
 % + No. 40  
 Date Received 11-11-2009

Wet Soil and Tare Mass (g)	Dry Soil and Tare Mass (g)	Tare Mass (g)	Number of Blows	Water Content (%)	Liquid Limit
19.04	17.17	11.74	31	34.4	35
19.05	16.88	10.72	27	35.2	
19.56	17.25	10.90	19	36.4	

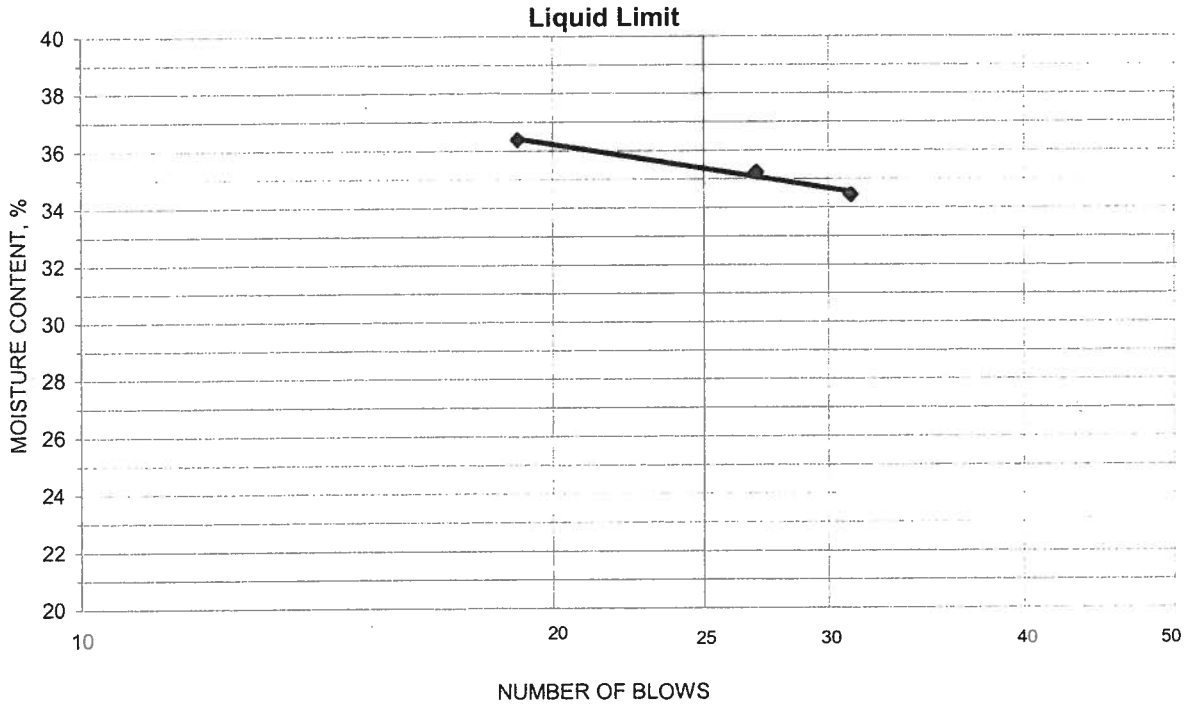

**PLASTIC LIMIT AND PLASTICITY INDEX**

Wet Soil and Tare Mass (g)	Dry Soil and Tare Mass (g)	Tare Mass (g)	Water Content (%)	Plastic Limit	Plasticity Index
18.37	17.23	11.13	18.7	19	16
18.15	16.99	10.91	19.1		

Remarks: \_\_\_\_\_

Reviewed By RJ

Project Name TVA - PAF Peabody Ash Pond  
 Source STN-15, 8.0'-9.5', 9.5'-11.0'

 Project Number 175569069  
 Lab ID 378
**Sieve analysis for the Portion Coarser than the No. 10 Sieve**

 Test Method: ASTM D 422  
 Prepared using: ASTM D 421

 Particle Shape: Angular  
 Particle Hardness: Hard and Durable

 Tested By: CM  
 Test Date: 11-13-2009  
 Date Received 11-11-2009

Sieve Size	% Passing
3"	
2"	
1 1/2"	
1"	100.0
3/4"	87.9
3/8"	81.0
No. 4	77.3
No. 10	70.4

Maximum Particle size: 1" Sieve

**Analysis for the portion Finer than the No. 10 Sieve**

Analysis Based on: Total Sample


 Specific Gravity 2.73

Dispersed using: Apparatus A - Mechanical, for 1 minute

No. 40	64.2
No. 200	58.9
0.02 mm	47.3
0.005 mm	30.8
0.002 mm	18.4
0.001 mm	10.0

**Particle Size Distribution**

ASTM	Coarse Gravel	Fine Gravel	C. Sand	Medium Sand	Fine Sand	Silt	Clay
	12.1	10.6	6.9	6.2	5.3	28.1	30.8
AASHTO	Gravel		Coarse Sand		Fine Sand	Silt	Clay
	29.6		6.2		5.3	40.5	18.4

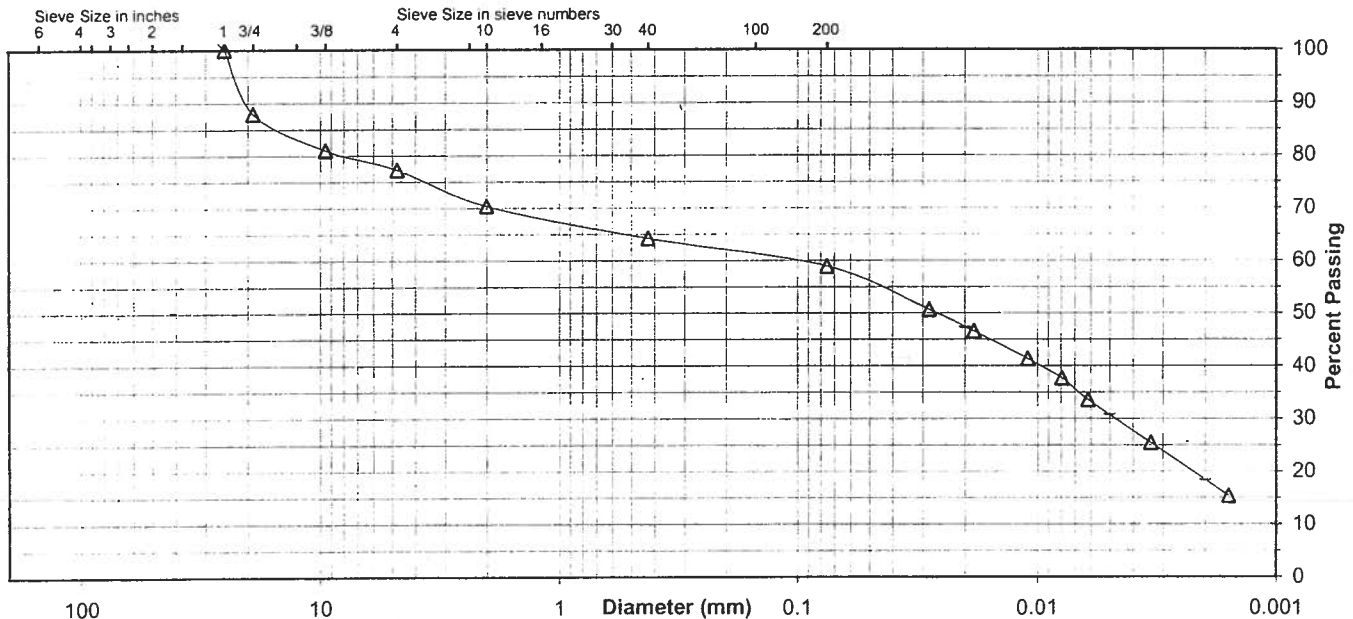

Comments \_\_\_\_\_

 Reviewed By RJ





# Summary of Soil Tests

M1

Project Name TVA - PAF Peabody Ash Pond Project Number 175569069  
 Source STN-6, 1.5'-3.0', 3.0'-4.5' Lab ID 366  
 County Muhlenberg, Ky Date Received 11-11-09  
 Sample Type SPT Comp Date Reported 11-20-09

## Test Results

### Natural Moisture Content

Test Not Performed  
 Moisture Content (%): N/A

### Atterberg Limits

Test Method: ASTM D 4318 Method A  
 Prepared: Dry  
 Liquid Limit: 37  
 Plastic Limit: 18  
 Plasticity Index: 19  
 Activity Index: 0.95

### Particle Size Analysis

Preparation Method: ASTM D 421  
 Gradation Method: ASTM D 422  
 Hydrometer Method: ASTM D 422

Particle Size		% Passing
Sieve Size	(mm)	
3"	75	
2"	50	
1 1/2"	37.5	
1"	25	
3/4"	19	100.0
3/8"	9.5	90.3
No. 4	4.75	82.6
No. 10	2	72.5
No. 40	0.425	65.5
No. 200	0.075	58.6
	0.02	47.0
	0.005	31.0
	0.002	19.7
estimated	0.001	11.0

Plus 3 in. material, not included: 0 (%)

Range	ASTM (%)	AASHTO (%)
Gravel	17.4	27.5
Coarse Sand	10.1	7.0
Medium Sand	7.0	---
Fine Sand	6.9	6.9
Silt	27.6	38.9
Clay	31.0	19.7

### Moisture-Density Relationship

Test Not Performed  
 Maximum Dry Density (lb/ft<sup>3</sup>): N/A  
 Maximum Dry Density (kg/m<sup>3</sup>): N/A  
 Optimum Moisture Content (%): N/A  
 Over Size Correction %: N/A

### California Bearing Ratio

Test Not Performed  
 Bearing Ratio (%): N/A  
 Compacted Dry Density (lb/ft<sup>3</sup>): N/A  
 Compacted Moisture Content (%): N/A

### Specific Gravity

Test Method: ASTM D 854  
 Prepared: Dry  
 Particle Size: No. 10  
 Specific Gravity at 20° Celsius: 2.73

### Classification

Unified Group Symbol: CL  
 Group Name: Sandy lean clay with gravel  
 AASHTO Classification: A-6 (8)


Comments: \_\_\_\_\_

Reviewed by: RJ

Project TVA - PAF Peabody Ash Pond  
 Source STN-6, 1.5'-3.0', 3.0'-4.5'  
 Tested By mc Test Method ASTM D 4318 Method A  
 Test Date 11-19-2009 Prepared Dry

Project No. 175569069  
 Lab ID 366  
 % + No. 40 34  
 Date Received 11-11-2009

Wet Soil and Tare Mass (g)	Dry Soil and Tare Mass (g)	Tare Mass (g)	Number of Blows	Water Content (%)	Liquid Limit
18.83	16.83	11.11	33	35.0	37
18.79	16.63	10.88	24	37.6	
19.86	17.46	11.25	19	38.6	

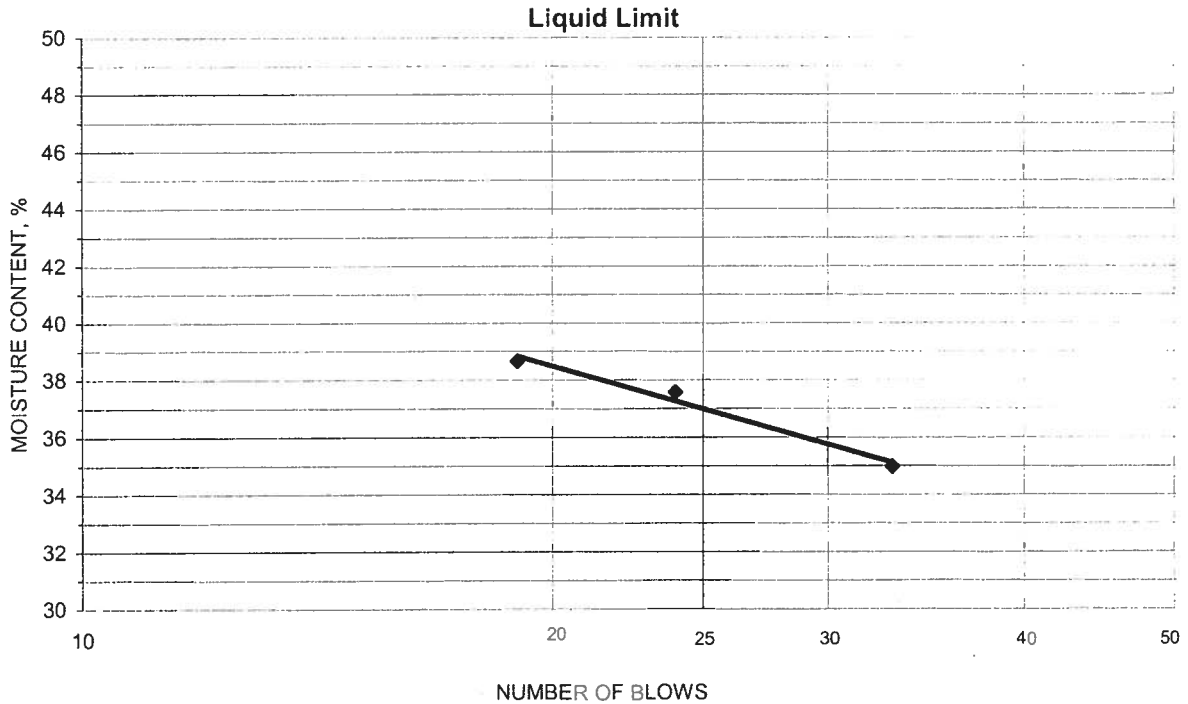

**PLASTIC LIMIT AND PLASTICITY INDEX**

Wet Soil and Tare Mass (g)	Dry Soil and Tare Mass (g)	Tare Mass (g)	Water Content (%)	Plastic Limit	Plasticity Index
18.39	17.26	11.13	18.4	18	19
18.49	17.35	11.08	18.2		

Remarks: \_\_\_\_\_  
 Reviewed By: RJ

Project Name TVA - PAF Peabody Ash Pond  
 Source STN-6, 1.5'-3.0', 3.0'-4.5'

 Project Number 175569069  
 Lab ID 366
**Sieve analysis for the Portion Coarser than the No. 10 Sieve**

 Test Method: ASTM D 422  
 Prepared using: ASTM D 421

 Particle Shape: Angular  
 Particle Hardness: Hard and Durable

 Tested By: CM  
 Test Date: 11-13-2009  
 Date Received: 11-11-2009

Maximum Particle size: 3/4" Sieve

Sieve Size	% Passing
3"	
2"	
1 1/2"	
1"	
3/4"	100.0
3/8"	90.3
No. 4	82.6
No. 10	72.5

**Analysis for the portion Finer than the No. 10 Sieve**

Analysis Based on: Total Sample


 Specific Gravity 2.73

Dispersed using: Apparatus A - Mechanical, for 1 minute

No. 40	65.5
No. 200	58.6
0.02 mm	47.0
0.005 mm	31.0
0.002 mm	19.7
0.001 mm	11.0

**Particle Size Distribution**

ASTM	Coarse Gravel	Fine Gravel	C. Sand	Medium Sand	Fine Sand	Silt	Clay
	0.0	17.4	10.1	7.0	6.9	27.6	31.0
AASHTO	Gravel		Coarse Sand		Fine Sand	Silt	Clay
	27.5		7.0		6.9	38.9	19.7

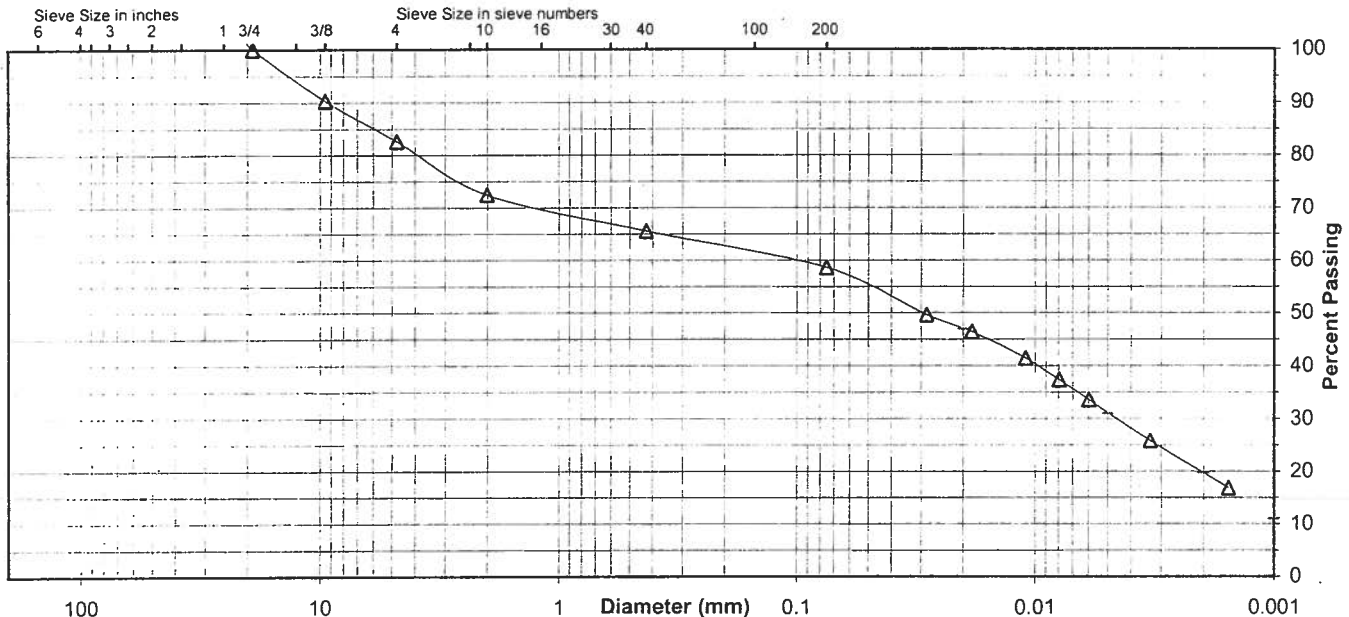

Comments

 Reviewed By Ry



Summary of Soil Tests

MZ

Project Name TVA - PAF Peabody Ash Pond Project Number 175569069  
 Source STN-21, 17.5'-19.0', 20.0'-21.5' Lab ID 387  
 County Muhlenberg, Ky Date Received 11-11-09  
 Sample Type SPT Comp Date Reported 11-20-09

Test Results

**Natural Moisture Content**

Test Not Performed  
 Moisture Content (%): N/A

**Atterberg Limits**

Test Method: ASTM D 4318 Method A  
 Prepared: Dry  
 Liquid Limit: 31  
 Plastic Limit: 16  
 Plasticity Index: 15  
 Activity Index: 0.94

**Particle Size Analysis**

Preparation Method: ASTM D 421  
 Gradation Method: ASTM D 422  
 Hydrometer Method: ASTM D 422

Particle Size		% Passing
Sieve Size	(mm)	
3"	75	
2"	50	
1 1/2"	37.5	
1"	25	
3/4"	19	100.0
3/8"	9.5	88.8
No. 4	4.75	82.4
No. 10	2	69.3
No. 40	0.425	61.8
No. 200	0.075	49.0
	0.02	37.9
	0.005	26.1
	0.002	15.8
estimated	0.001	9.0

**Moisture-Density Relationship**

Test Not Performed  
 Maximum Dry Density (lb/ft<sup>3</sup>): N/A  
 Maximum Dry Density (kg/m<sup>3</sup>): N/A  
 Optimum Moisture Content (%): N/A  
 Over Size Correction %: N/A

**California Bearing Ratio**

Test Not Performed  
 Bearing Ratio (%): N/A  
 Compacted Dry Density (lb/ft<sup>3</sup>): N/A  
 Compacted Moisture Content (%): N/A

**Specific Gravity**

Test Method: ASTM D 854  
 Prepared: Dry  
 Particle Size: No. 10  
 Specific Gravity at 20° Celsius: 2.71

Plus 3 in. material, not included: 0 (%)

Range	ASTM (%)	AASHTO (%)
Gravel	17.6	30.7
Coarse Sand	13.1	7.5
Medium Sand	7.5	---
Fine Sand	12.8	12.8
Silt	22.9	33.2
Clay	26.1	15.8

**Classification**

Unified Group Symbol: SC  
 Group Name: Clayey sand with gravel  
 AASHTO Classification: A-6 (4)

Comments: \_\_\_\_\_

Reviewed by: RJ

Project TVA - PAF Peabody Ash Pond  
 Source STN-21, 17.5'-19.0', 20.0'-21.5'

Project No. 175569069

Lab ID 387


% + No. 40 38

Tested By mc Test Method ASTM D 4318 Method A

Date Received 11-11-2009

Test Date 11-19-2009 Prepared Dry

Wet Soil and Tare Mass (g)	Dry Soil and Tare Mass (g)	Tare Mass (g)	Number of Blows	Water Content (%)	Liquid Limit
20.03	17.99	11.07	35	29.5	31
19.40	17.43	11.12	23	31.2	
18.86	16.90	10.93	16	32.8	

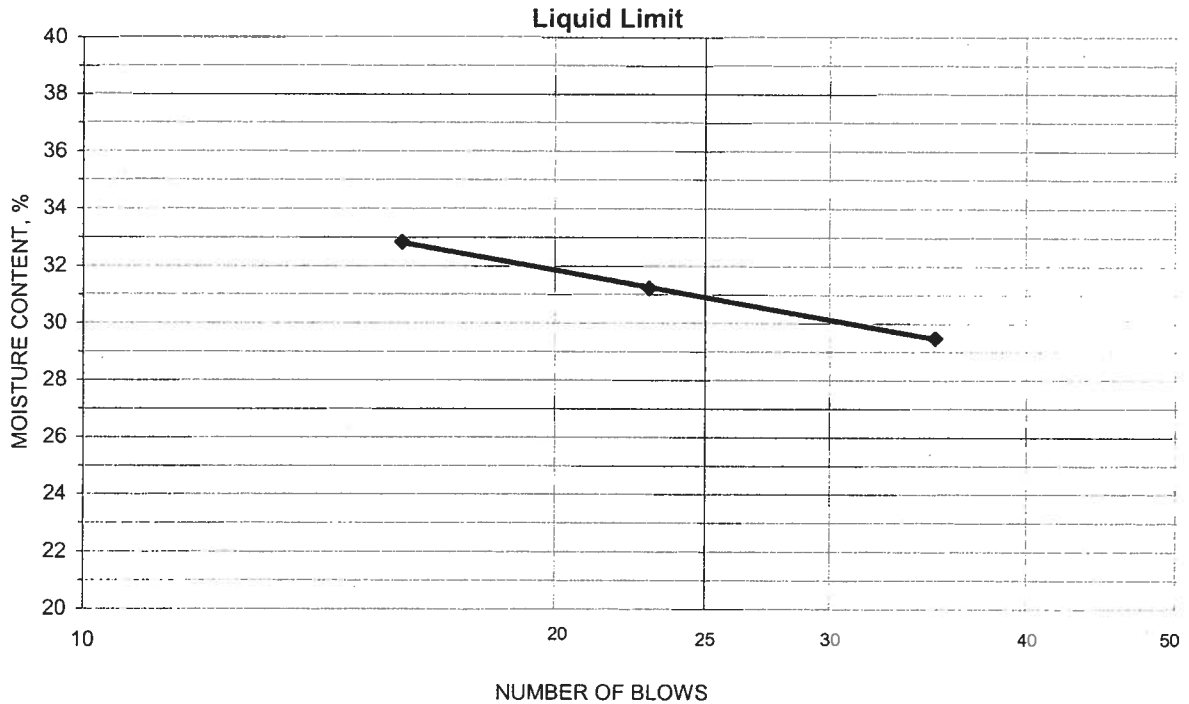

**PLASTIC LIMIT AND PLASTICITY INDEX**

Wet Soil and Tare Mass (g)	Dry Soil and Tare Mass (g)	Tare Mass (g)	Water Content (%)	Plastic Limit	Plasticity Index
18.39	17.39	11.21	16.2	16	15
18.37	17.35	11.16	16.5		

Remarks: \_\_\_\_\_

Reviewed By RJ

Project Name TVA - PAF Peabody Ash Pond  
 Source STN-21, 17.5'-19.0', 20.0'-21.5'

 Project Number 175569069  
 Lab ID 387
**Sieve analysis for the Portion Coarser than the No. 10 Sieve**

 Test Method: ASTM D 422  
 Prepared using: ASTM D 421  
 Particle Shape: Angular  
 Particle Hardness: Hard and Durable  
 Tested By: CM  
 Test Date: 11-12-2009  
 Date Received: 11-11-2009

Sieve Size	% Passing
3"	
2"	
1 1/2"	
1"	
3/4"	100.0
3/8"	88.8
No. 4	82.4
No. 10	69.3

Maximum Particle size: 3/4" Sieve

**Analysis for the portion Finer than the No. 10 Sieve**

Analysis Based on: Total Sample


 Specific Gravity 2.71

Dispersed using: Apparatus A - Mechanical, for 1 minute

No. 40	61.8
No. 200	49.0
0.02 mm	37.9
0.005 mm	26.1
0.002 mm	15.8
0.001 mm	9.0

**Particle Size Distribution**

ASTM	Coarse Gravel	Fine Gravel	C. Sand	Medium Sand	Fine Sand	Silt	Clay
	0.0	17.6	13.1	7.5	12.8	22.9	26.1
AASHTO	Gravel		Coarse Sand		Fine Sand	Silt	Clay
	30.7		7.5		12.8	33.2	15.8

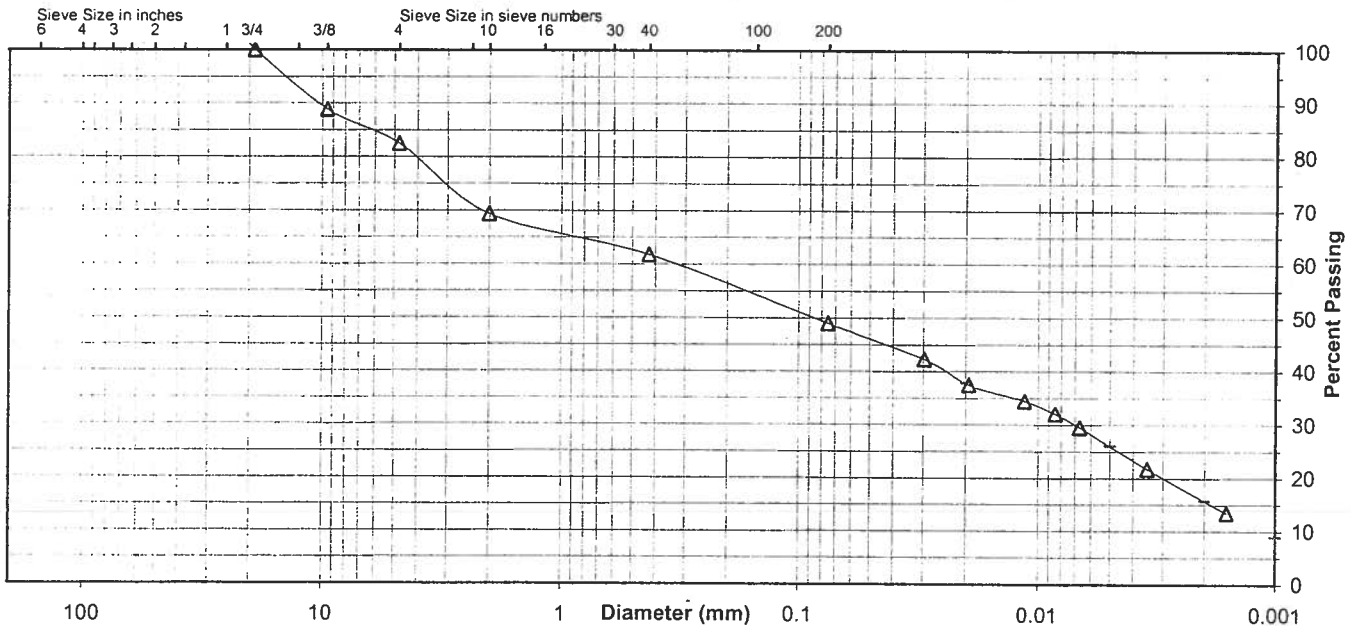

Comments \_\_\_\_\_

 Reviewed By RJ



Summary of Soil Tests

M2

Project Name TVA - PAF Peabody Ash Pond  
 Source STN-3, 17.5'-19.0', 20.0'-21.5'

Project Number 175569069  
 Lab ID 360

County Muhlenberg, Ky  
 Sample Type SPT Comp

Date Received 11-11-09  
 Date Reported 11-20-09

Test Results

**Natural Moisture Content**

Test Not Performed  
 Moisture Content (%): N/A

**Atterberg Limits**

Test Method: ASTM D 4318 Method A  
 Prepared: Dry  
 Liquid Limit: 37  
 Plastic Limit: 16  
 Plasticity Index: 21  
 Activity Index: 0.70

**Particle Size Analysis**

Preparation Method: ASTM D 421  
 Gradation Method: ASTM D 422  
 Hydrometer Method: ASTM D 422

Particle Size		% Passing
Sieve Size	(mm)	
3"	75	
2"	50	
1 1/2"	37.5	
1"	25	
3/4"	19	100.0
3/8"	9.5	98.4
No. 4	4.75	97.9
No. 10	2	90.3
No. 40	0.425	85.7
No. 200	0.075	75.3
	0.02	59.7
	0.005	39.0
	0.002	30.1
estimated	0.001	25.0

**Moisture-Density Relationship**

Test Not Performed  
 Maximum Dry Density (lb/ft<sup>3</sup>): N/A  
 Maximum Dry Density (kg/m<sup>3</sup>): N/A  
 Optimum Moisture Content (%): N/A  
 Over Size Correction %: N/A

**California Bearing Ratio**

Test Not Performed  
 Bearing Ratio (%): N/A  
 Compacted Dry Density (lb/ft<sup>3</sup>): N/A  
 Compacted Moisture Content (%): N/A

**Specific Gravity**

Test Method: ASTM D 854  
 Prepared: Dry  
 Particle Size: No. 10  
 Specific Gravity at 20° Celsius: 2.68

Plus 3 in. material, not included: 0 (%)

Range	ASTM (%)	AASHTO (%)
Gravel	2.1	9.7
Coarse Sand	7.6	4.6
Medium Sand	4.6	---
Fine Sand	10.4	10.4
Silt	36.3	45.2
Clay	39.0	30.1

**Classification**

Unified Group Symbol: CL  
 Group Name: Lean clay with sand  
 AASHTO Classification: A-6 (14)


Comments: \_\_\_\_\_

Reviewed by: RJ

Project TVA - PAF Peabody Ash Pond  
 Source STN-3, 17.5'-19.0', 20.0'-21.5'  
 Tested By MC Test Method ASTM D 4318 Method A  
 Test Date 11-19-2009 Prepared Dry

Project No. 175569069  
 Lab ID 360  
 % + No. 40 14  
 Date Received 11-11-2009

Wet Soil and Tare Mass (g)	Dry Soil and Tare Mass (g)	Tare Mass (g)	Number of Blows	Water Content (%)	Liquid Limit
19.25	17.20	11.42	34	35.5	37
19.77	17.57	11.69	25	37.4	
19.48	17.27	11.56	17	38.7	

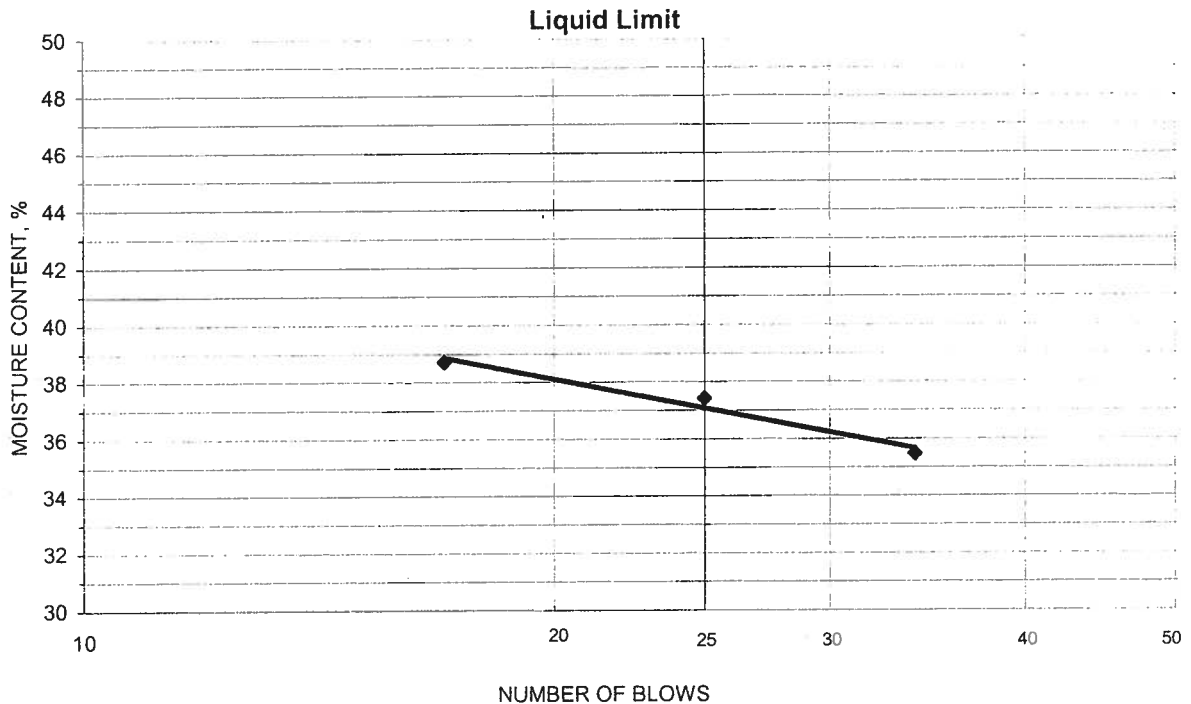

**PLASTIC LIMIT AND PLASTICITY INDEX**

Wet Soil and Tare Mass (g)	Dry Soil and Tare Mass (g)	Tare Mass (g)	Water Content (%)	Plastic Limit	Plasticity Index
19.41	18.35	11.70	15.9	16	21
19.10	18.02	11.39	16.3		

Remarks: \_\_\_\_\_

Reviewed By RJ





**Particle-Size Analysis of Soils**

ASTM D 422

Project Name TVA - PAF Peabody Ash Pond  
 Source STN-3, 17.5'-19.0', 20.0'-21.5'

Project Number 175569069  
 Lab ID 360

**Sieve analysis for the Portion Coarser than the No. 10 Sieve**

Test Method: ASTM D 422  
 Prepared using: ASTM D 421  
 Particle Shape: Angular  
 Particle Hardness: Hard and Durable  
 Tested By: CM  
 Test Date: 11-12-2009  
 Date Received 11-11-2009

Sieve Size	% Passing
3"	
2"	
1 1/2"	
1"	
3/4"	100.0
3/8"	98.4
No. 4	97.9
No. 10	90.3

Maximum Particle size: 3/4" Sieve

**Analysis for the portion Finer than the No. 10 Sieve**

Analysis Based on: Total Sample


Specific Gravity 2.68

Dispersed using: Apparatus A - Mechanical, for 1 minute

No. 40	85.7
No. 200	75.3
0.02 mm	59.7
0.005 mm	39.0
0.002 mm	30.1
0.001 mm	25.0

**Particle Size Distribution**

ASTM	Coarse Gravel	Fine Gravel	C. Sand	Medium Sand	Fine Sand	Silt	Clay
	0.0	2.1	7.6	4.6	10.4	36.3	39.0
AASHTO	Gravel		Coarse Sand		Fine Sand	Silt	Clay
	9.7		4.6		10.4	45.2	30.1

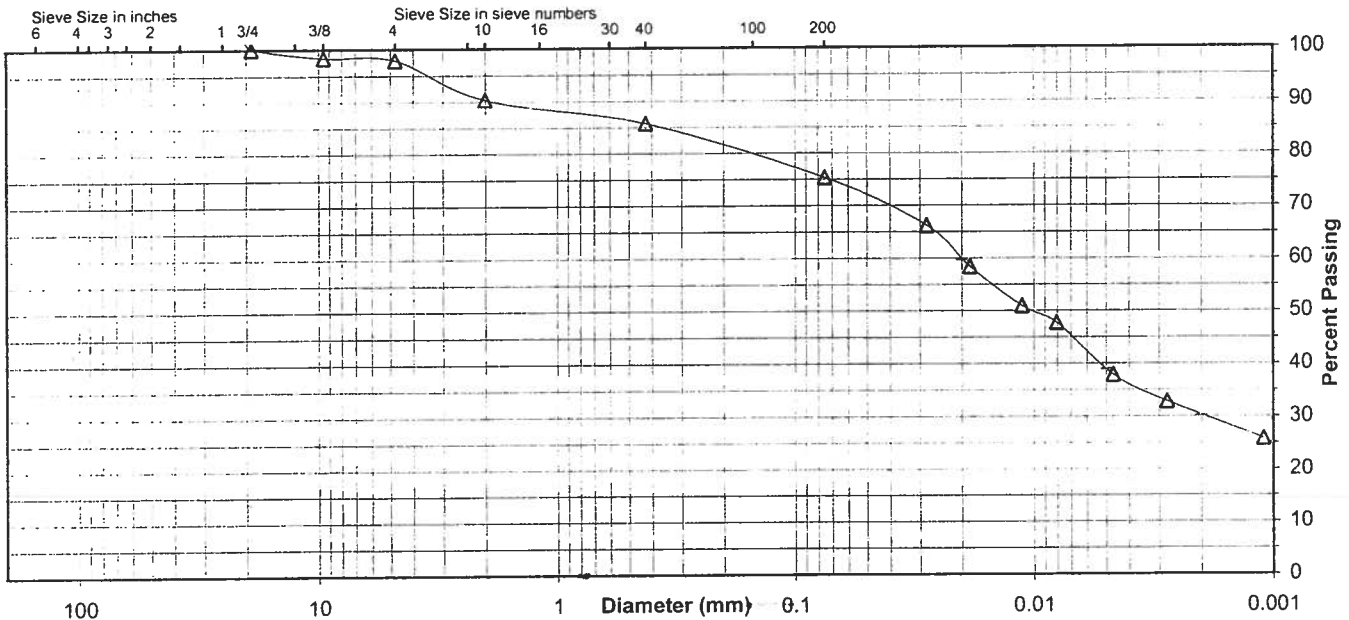



Summary of Soil Tests

N1

Project Name TVA - PAF Peabody Ash Pond Project Number 175569069  
 Source STN-6, 13.5'-15.0', 15.0'-16.5' Lab ID 369  
 County Muhlenberg, Ky Date Received 11-11-09  
 Sample Type SPT Comp Date Reported 11-20-09

Test Results

**Natural Moisture Content**

Test Not Performed  
 Moisture Content (%): N/A

**Atterberg Limits**

Test Method: ASTM D 4318 Method A  
 Prepared: Dry  
 Liquid Limit: 22  
 Plastic Limit: 14  
 Plasticity Index: 8  
 Activity Index: 0.62

**Particle Size Analysis**

Preparation Method: ASTM D 421  
 Gradation Method: ASTM D 422  
 Hydrometer Method: ASTM D 422

Particle Size		%
Sieve Size	(mm)	
		Passing
3"	75	
2"	50	
1 1/2"	37.5	
1"	25	
3/4"	19	
3/8"	9.5	100.0
No. 4	4.75	99.2
No. 10	2	98.8
No. 40	0.425	88.0
No. 200	0.075	40.8
	0.02	30.6
	0.005	17.7
	0.002	13.1
estimated	0.001	10.0

**Moisture-Density Relationship**

Test Not Performed  
 Maximum Dry Density (lb/ft<sup>3</sup>): N/A  
 Maximum Dry Density (kg/m<sup>3</sup>): N/A  
 Optimum Moisture Content (%): N/A  
 Over Size Correction %: N/A

**California Bearing Ratio**

Test Not Performed  
 Bearing Ratio (%): N/A  
 Compacted Dry Density (lb/ft<sup>3</sup>): N/A  
 Compacted Moisture Content (%): N/A

**Specific Gravity**

Test Method: ASTM D 854  
 Prepared: Dry  
 Particle Size: No. 10  
 Specific Gravity at 20° Celsius: 2.67

Plus 3 in. material, not included: 0 (%)

Range	ASTM (%)	AASHTO (%)
Gravel	0.8	1.2
Coarse Sand	0.4	10.8
Medium Sand	10.8	---
Fine Sand	47.2	47.2
Silt	23.1	27.7
Clay	17.7	13.1

**Classification**

Unified Group Symbol: SC  
 Group Name: Clayey sand  
 AASHTO Classification: A-4 (0)


Comments: \_\_\_\_\_

Reviewed by: RJ

Project TVA - PAF Peabody Ash Pond  
 Source STN-6, 13.5'-15.0', 15.0'-16.5'  
 Tested By mc Test Method ASTM D 4318 Method A  
 Test Date 11-19-2009 Prepared Dry

Project No. 175569069  
 Lab ID 369  
 % + No. 40 12  
 Date Received 11-11-2009

Wet Soil and Tare Mass (g)	Dry Soil and Tare Mass (g)	Tare Mass (g)	Number of Blows	Water Content (%)	Liquid Limit
20.68	19.08	11.20	35	20.3	22
21.36	19.56	11.09	28	21.3	
20.43	18.65	11.02	19	23.3	

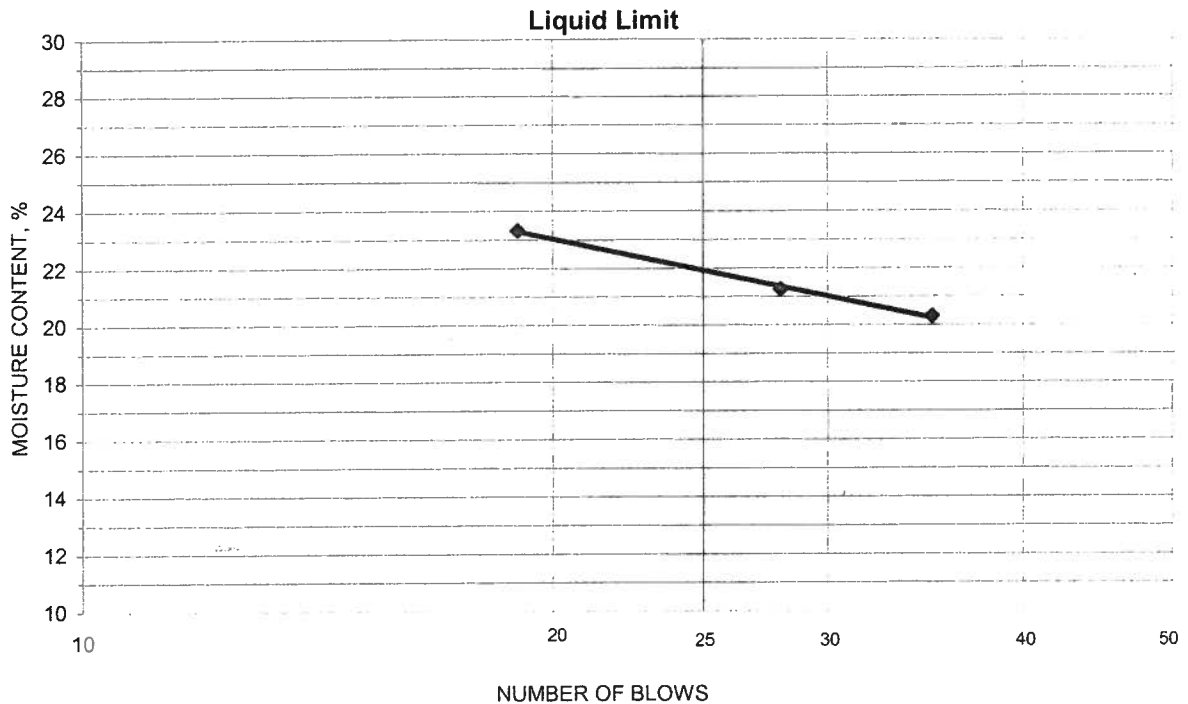

**PLASTIC LIMIT AND PLASTICITY INDEX**

Wet Soil and Tare Mass (g)	Dry Soil and Tare Mass (g)	Tare Mass (g)	Water Content (%)	Plastic Limit	Plasticity Index
19.29	18.34	11.62	14.1	14	8
19.31	18.33	11.68	14.7		

Remarks: \_\_\_\_\_

Reviewed By RJ





Summary of Soil Tests

N

Project Name TVA - PAF Peabody Ash Pond Project Number 175569069  
 Source STN-11, 30.0'-31.5', 32.5'-34.0' Lab ID 375  
 County Muhlenberg, Ky Date Received 11-11-09  
 Sample Type SPT Comp Date Reported 11-20-09

**Test Results**

**Natural Moisture Content**  
 Test Not Performed  
 Moisture Content (%): N/A

**Atterberg Limits**  
 Test Method: ASTM D 4318 Method A  
 Prepared: Dry  
 Liquid Limit: 21  
 Plastic Limit: 12  
 Plasticity Index: 9  
 Activity Index: 0.64

**Particle Size Analysis**  
 Preparation Method: ASTM D 421  
 Gradation Method: ASTM D 422  
 Hydrometer Method: ASTM D 422

Particle Size		% Passing
Sieve Size	(mm)	
3"	75	
2"	50	
1 1/2"	37.5	
1"	25	
3/4"	19	
3/8"	9.5	
No. 4	4.75	100.0
No. 10	2	100.0
No. 40	0.425	89.3
No. 200	0.075	45.4
	0.02	34.9
	0.005	20.7
	0.002	14.5
estimated	0.001	10.0

**Moisture-Density Relationship**  
 Test Not Performed  
 Maximum Dry Density (lb/ft<sup>3</sup>): N/A  
 Maximum Dry Density (kg/m<sup>3</sup>): N/A  
 Optimum Moisture Content (%): N/A  
 Over Size Correction %: N/A

**California Bearing Ratio**  
 Test Not Performed  
 Bearing Ratio (%): N/A  
 Compacted Dry Density (lb/ft<sup>3</sup>): N/A  
 Compacted Moisture Content (%): N/A

**Specific Gravity**  
 Test Method: ASTM D 854  
 Prepared: Dry  
 Particle Size: No. 10  
 Specific Gravity at 20° Celsius: 2.63

Plus 3 in. material, not included: 0 (%)

Range	ASTM (%)	AASHTO (%)
Gravel	0.0	0.0
Coarse Sand	0.0	10.7
Medium Sand	10.7	---
Fine Sand	43.9	43.9
Silt	24.7	30.9
Clay	20.7	14.5

**Classification**  
 Unified Group Symbol: SC  
 Group Name: Clayey sand  
 AASHTO Classification: A-4 (1)


Comments: \_\_\_\_\_

Reviewed by: RJ

Project TVA - PAF Peabody Ash Pond  
 Source STN-11, 30.0'-31.5', 32.5'-34.0'  
 Tested By mc Test Method ASTM D 4318 Method A  
 Test Date 11-19-2009 Prepared Dry

Project No. 175569069  
 Lab ID 375  
 % + No. 40 11  
 Date Received 11-11-2009

Wet Soil and Tare Mass (g)	Dry Soil and Tare Mass (g)	Tare Mass (g)	Number of Blows	Water Content (%)	Liquid Limit
18.83	17.57	11.04	33	19.3	21
19.33	17.95	11.11	28	20.2	
21.06	19.30	11.02	22	21.3	

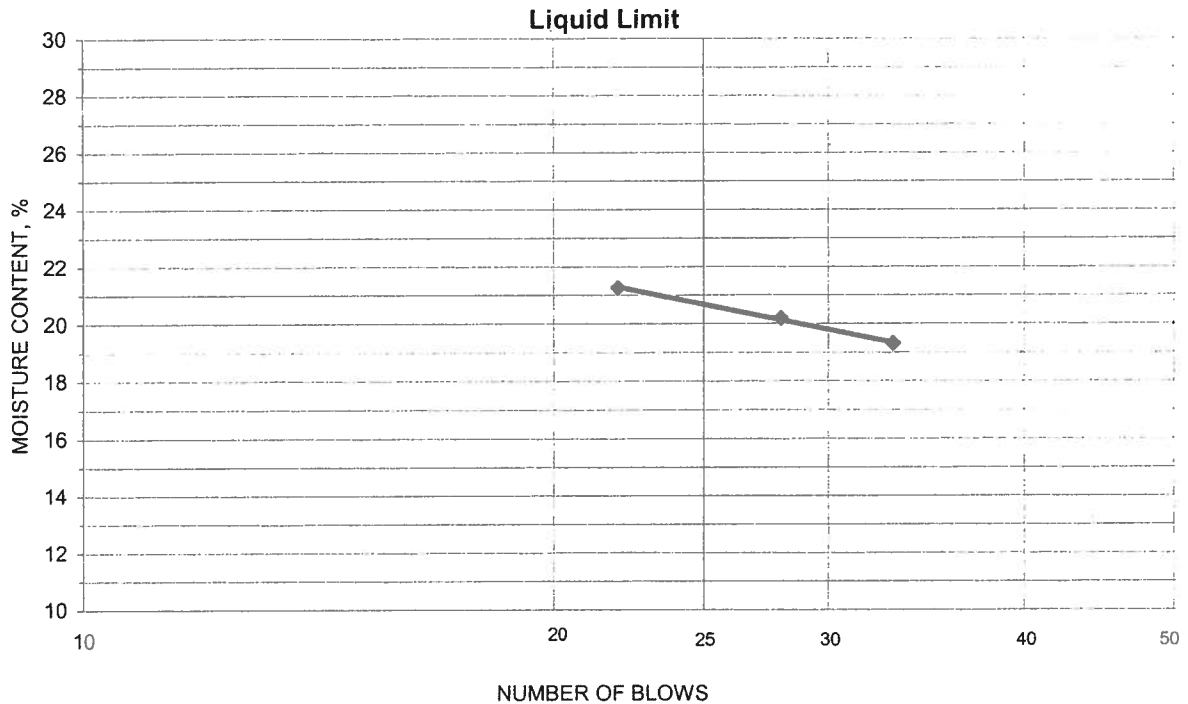

**PLASTIC LIMIT AND PLASTICITY INDEX**

Wet Soil and Tare Mass (g)	Dry Soil and Tare Mass (g)	Tare Mass (g)	Water Content (%)	Plastic Limit	Plasticity Index
18.62	17.82	10.99	11.7	12	9
18.72	17.91	11.16	12.0		

Remarks: \_\_\_\_\_

Reviewed By Rj

Project Name TVA - PAF Peabody Ash Pond  
 Source STN-11, 30.0'-31.5', 32.5'-34.0'

 Project Number 175569069  
 Lab ID 375
**Sieve analysis for the Portion Coarser than the No. 10 Sieve**

 Test Method: ASTM D 422  
 Prepared using: ASTM D 421

 Particle Shape: Angular  
 Particle Hardness: Hard and Durable

 Tested By: CM  
 Test Date: 11-12-2009  
 Date Received 11-11-2009

Maximum Particle size: No. 4 Sieve

Sieve Size	% Passing
3"	
2"	
1 1/2"	
1"	
3/4"	
3/8"	
No. 4	100.0
No. 10	100.0

**Analysis for the portion Finer than the No. 10 Sieve**

Analysis Based on: Total Sample


 Specific Gravity 2.63

Dispersed using: Apparatus A - Mechanical, for 1 minute

No. 40	89.3
No. 200	45.4
0.02 mm	34.9
0.005 mm	20.7
0.002 mm	14.5
0.001 mm	10.0

**Particle Size Distribution**

ASTM	Coarse Gravel	Fine Gravel	C. Sand	Medium Sand	Fine Sand	Silt	Clay
	0.0	0.0	0.0	10.7	43.9	24.7	20.7
AASHTO	Gravel		Coarse Sand		Fine Sand	Silt	Clay
	0.0		10.7		43.9	30.9	14.5

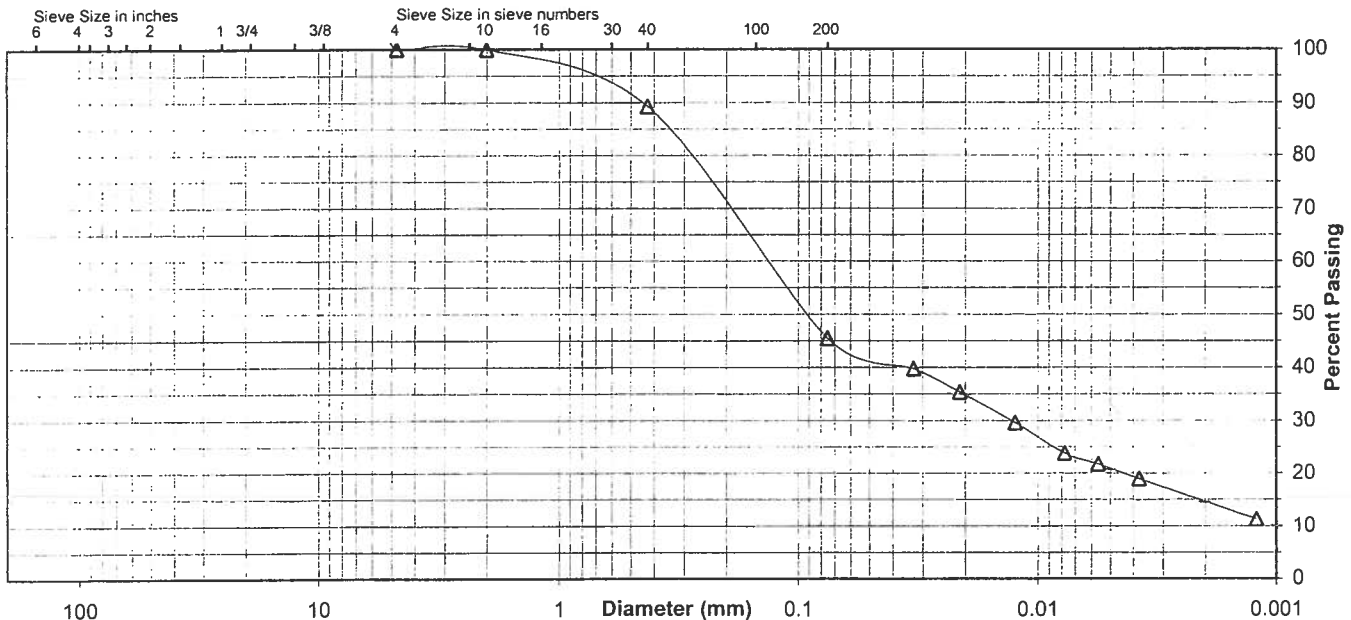

Comments \_\_\_\_\_

 Reviewed By RJ



Summary of Soil Tests

N2

Project Name TVA - PAF Peabody Ash Pond  
 Source STN-17, 17.5'-19.0', 20.0'-21.5'

Project Number 175569069  
 Lab ID 384

County Muhlenberg, Ky  
 Sample Type SPT Comp

Date Received 11-11-09  
 Date Reported 11-20-09

**Test Results**

**Natural Moisture Content**

Test Not Performed  
 Moisture Content (%): N/A

**Atterberg Limits**

Test Method: ASTM D 4318 Method A  
 Prepared: Dry  
 Liquid Limit: 29  
 Plastic Limit: 20  
 Plasticity Index: 9  
 Activity Index: 0.47

**Particle Size Analysis**

Preparation Method: ASTM D 421  
 Gradation Method: ASTM D 422  
 Hydrometer Method: ASTM D 422

Particle Size		% Passing
Sieve Size	(mm)	
3"	75	
2"	50	
1 1/2"	37.5	
1"	25	
3/4"	19	
3/8"	9.5	
No. 4	4.75	
No. 10	2	100.0
No. 40	0.425	98.7
No. 200	0.075	89.6
	0.02	64.8
	0.005	28.1
	0.002	19.2
estimated	0.001	14.0

Plus 3 in. material, not included: 0 (%)

Range	ASTM (%)	AASHTO (%)
Gravel	0.0	0.0
Coarse Sand	0.0	1.3
Medium Sand	1.3	---
Fine Sand	9.1	9.1
Silt	61.5	70.4
Clay	28.1	19.2

**Moisture-Density Relationship**

Test Not Performed  
 Maximum Dry Density (lb/ft<sup>3</sup>): N/A  
 Maximum Dry Density (kg/m<sup>3</sup>): N/A  
 Optimum Moisture Content (%): N/A  
 Over Size Correction %: N/A

**California Bearing Ratio**

Test Not Performed  
 Bearing Ratio (%): N/A  
 Compacted Dry Density (lb/ft<sup>3</sup>): N/A  
 Compacted Moisture Content (%): N/A

**Specific Gravity**

Test Method: ASTM D 854  
 Prepared: Dry  
 Particle Size: No. 10  
 Specific Gravity at 20° Celsius: 2.68

**Classification**

Unified Group Symbol: CL  
 Group Name: Lean clay  
 AASHTO Classification: A-4 (7)

Comments: \_\_\_\_\_


Reviewed by: Rj



Project TVA - PAF Peabody Ash Pond  
 Source STN-17, 17.5'-19.0', 20.0'-21.5'  
 Tested By MC Test Method ASTM D 4318 Method A  
 Test Date 11-19-2009 Prepared Dry

Project No. 175569069  
 Lab ID 384  
 % + No. 40 1  
 Date Received 11-11-2009

Wet Soil and Tare Mass (g)	Dry Soil and Tare Mass (g)	Tare Mass (g)	Number of Blows	Water Content (%)	Liquid Limit
19.83	17.93	11.17	33	28.1	29
19.18	17.31	10.99	22	29.6	
18.75	16.90	10.94	16	31.0	

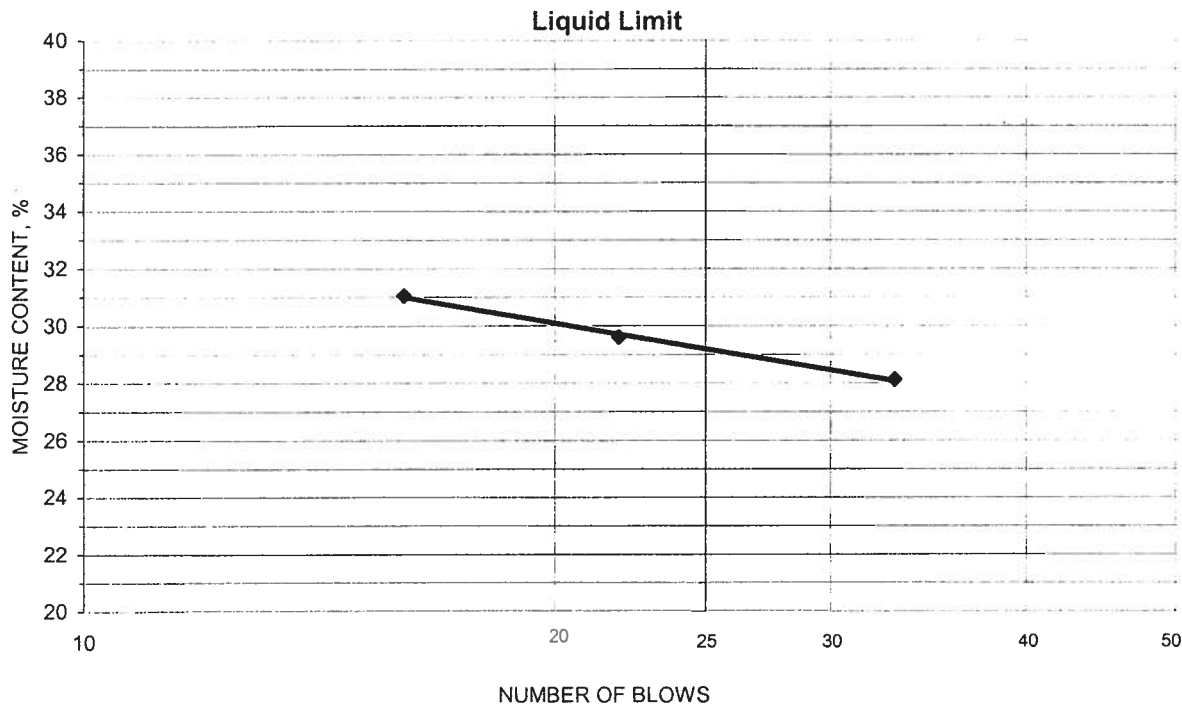

**PLASTIC LIMIT AND PLASTICITY INDEX**

Wet Soil and Tare Mass (g)	Dry Soil and Tare Mass (g)	Tare Mass (g)	Water Content (%)	Plastic Limit	Plasticity Index
18.67	17.44	11.19	19.7	20	9
18.22	17.03	10.88	19.3		

Remarks: \_\_\_\_\_

Reviewed By RJ

Project Name TVA - PAF Peabody Ash Pond  
 Source STN-17, 17.5'-19.0', 20.0'-21.5'

 Project Number 175569069  
 Lab ID 384
**Sieve analysis for the Portion Coarser than the No. 10 Sieve**

 Test Method: ASTM D 422  
 Prepared using: ASTM D 421

 Particle Shape: N/A  
 Particle Hardness: N/A

 Tested By: CM  
 Test Date: 11-12-2009  
 Date Received 11-11-2009

Maximum Particle size: No. 10 Sieve

Sieve Size	% Passing
3"	
2"	
1 1/2"	
1"	
3/4"	
3/8"	
No. 4	
No. 10	100.0

**Analysis for the portion Finer than the No. 10 Sieve**

Analysis Based on: Total Sample


 Specific Gravity 2.68

Dispersed using: Apparatus A - Mechanical, for 1 minute

No. 40	98.7
No. 200	89.6
0.02 mm	64.8
0.005 mm	28.1
0.002 mm	19.2
0.001 mm	14.0

**Particle Size Distribution**

ASTM	Coarse Gravel	Fine Gravel	C. Sand	Medium Sand	Fine Sand	Silt	Clay
	0.0	0.0	0.0	1.3	9.1	61.5	28.1
AASHTO	Gravel		Coarse Sand		Fine Sand	Silt	Clay
	0.0		1.3		9.1	70.4	19.2

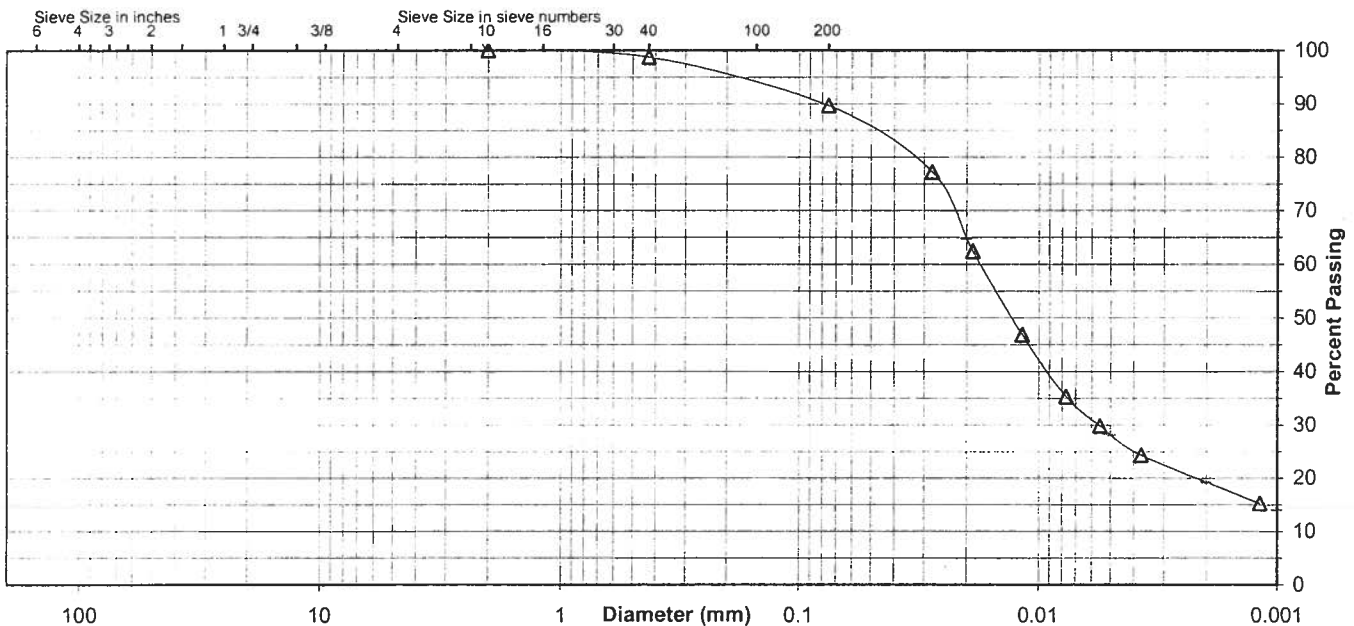

Comments \_\_\_\_\_

 Reviewed By RJ



## Summary of Soil Tests

N2

Project Name TVA - PAF Peabody Ash Pond Project Number 175569069  
 Source STN-7, 8.0'-9.5', 11.5'-13.0' Lab ID 372  
 County Muhlenberg, Ky Date Received 11-11-09  
 Sample Type SPT Comp Date Reported 11-20-09

### Test Results

#### Natural Moisture Content

Test Not Performed  
 Moisture Content (%): N/A

#### Atterberg Limits

Test Method: ASTM D 4318 Method A  
 Prepared: Dry  
 Liquid Limit: 37  
 Plastic Limit: 19  
 Plasticity Index: 18  
 Activity Index: 0.62

#### Particle Size Analysis

Preparation Method: ASTM D 421  
 Gradation Method: ASTM D 422  
 Hydrometer Method: ASTM D 422

Particle Size		% Passing
Sieve Size	(mm)	
3"	75	
2"	50	
1 1/2"	37.5	
1"	25	100.0
3/4"	19	96.0
3/8"	9.5	96.0
No. 4	4.75	96.0
No. 10	2	95.3
No. 40	0.425	90.2
No. 200	0.075	78.2
	0.02	62.1
	0.005	39.2
	0.002	29.3
estimated	0.001	22.0

Plus 3 in. material, not included: 0 (%)

Range	ASTM (%)	AASHTO (%)
Gravel	4.0	4.7
Coarse Sand	0.7	5.1
Medium Sand	5.1	---
Fine Sand	12.0	12.0
Silt	39.0	48.9
Clay	39.2	29.3

#### Moisture-Density Relationship

Test Not Performed  
 Maximum Dry Density (lb/ft<sup>3</sup>): N/A  
 Maximum Dry Density (kg/m<sup>3</sup>): N/A  
 Optimum Moisture Content (%): N/A  
 Over Size Correction %: N/A

#### California Bearing Ratio

Test Not Performed  
 Bearing Ratio (%): N/A  
 Compacted Dry Density (lb/ft<sup>3</sup>): N/A  
 Compacted Moisture Content (%): N/A

#### Specific Gravity

Test Method: ASTM D 854  
 Prepared: Dry  
 Particle Size: No. 10  
 Specific Gravity at 20° Celsius: 2.73

#### Classification

Unified Group Symbol: CL  
 Group Name: Lean clay with sand  
 AASHTO Classification: A-6 (13)


Comments: \_\_\_\_\_

Reviewed by: RJ

Project TVA - PAF Peabody Ash Pond  
 Source STN-7, 8.0'-9.5', 11.5'-13.0'  
 Tested By mc Test Method ASTM D 4318 Method A  
 Test Date 11-19-2009 Prepared Dry

Project No. 175569069  
 Lab ID 372  
 % + No. 40 10  
 Date Received 11-11-2009

Wet Soil and Tare Mass (g)	Dry Soil and Tare Mass (g)	Tare Mass (g)	Number of Blows	Water Content (%)	Liquid Limit
18.85	16.83	11.09	34	35.2	37
19.36	17.12	10.99	27	36.5	
19.10	16.89	11.03	22	37.7	

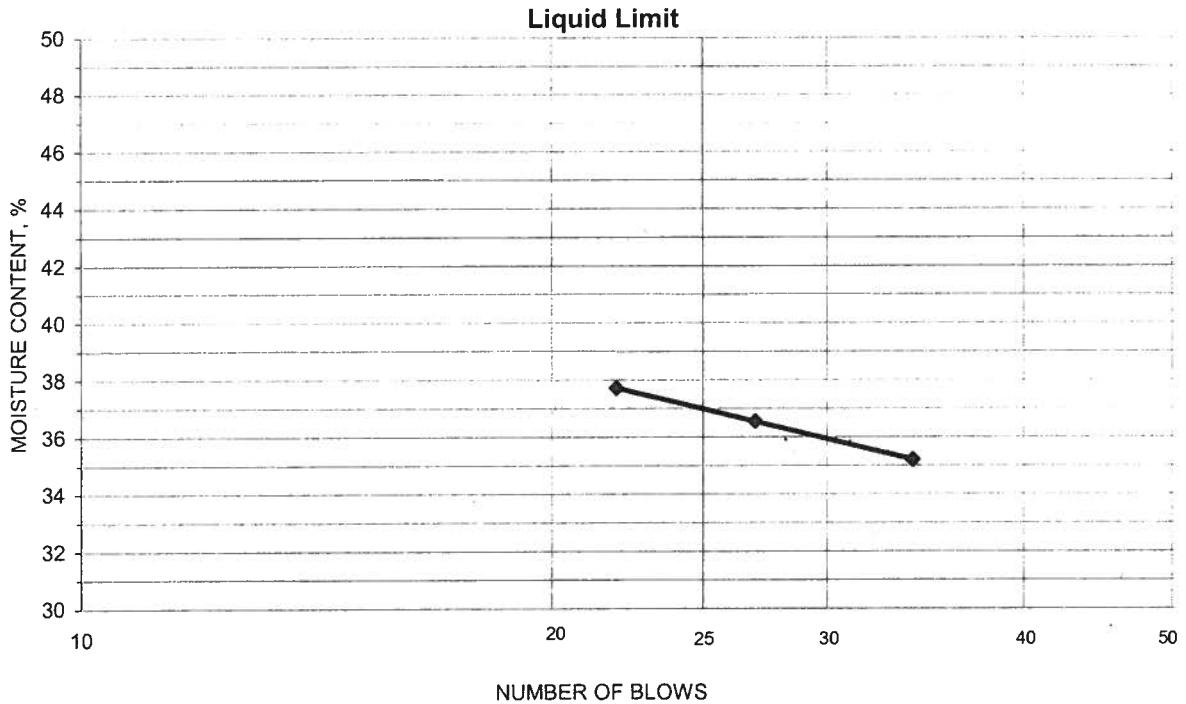

**PLASTIC LIMIT AND PLASTICITY INDEX**

Wet Soil and Tare Mass (g)	Dry Soil and Tare Mass (g)	Tare Mass (g)	Water Content (%)	Plastic Limit	Plasticity Index
18.58	17.39	11.19	19.2	19	18
18.47	17.30	11.12	18.9		

Remarks: \_\_\_\_\_

Reviewed By Rj

Project Name TVA - PAF Peabody Ash Pond  
 Source STN-7, 8.0'-9.5', 11.5'-13.0'

Project Number 175569069  
 Lab ID 372

**Sieve analysis for the Portion Coarser than the No. 10 Sieve**

Test Method: ASTM D 422  
 Prepared using: ASTM D 421  
 Particle Shape: Angular  
 Particle Hardness: Hard and Durable  
 Tested By: CM  
 Test Date: 11-12-2009  
 Date Received 11-11-2009

Sieve Size	% Passing
3"	
2"	
1 1/2"	
1"	100.0
3/4"	96.0
3/8"	96.0
No. 4	96.0
No. 10	95.3

Maximum Particle size: 1" Sieve

**Analysis for the portion Finer than the No. 10 Sieve**

Analysis Based on: Total Sample


Specific Gravity 2.73

Dispersed using: Apparatus A - Mechanical, for 1 minute

No. 40	90.2
No. 200	78.2
0.02 mm	62.1
0.005 mm	39.2
0.002 mm	29.3
0.001 mm	22.0

**Particle Size Distribution**

ASTM	Coarse Gravel	Fine Gravel	C. Sand	Medium Sand	Fine Sand	Silt	Clay
	4.0	0.0	0.7	5.1	12.0	39.0	39.2
AASHTO	Gravel		Coarse Sand		Fine Sand	Silt	Clay
	4.7		5.1		12.0	48.9	29.3

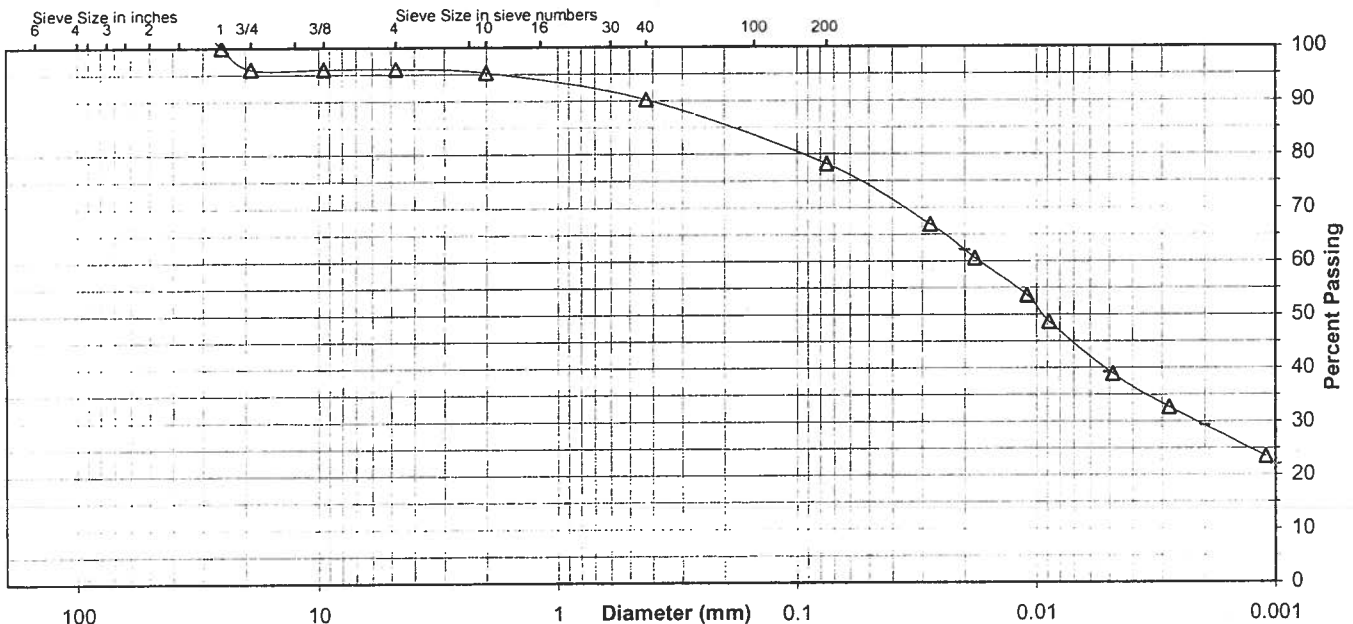



Summary of Soil Tests

N3

Project Name TVA - PAF Peabody Ash Pond Project Number 175569069  
 Source STN-4, 37.5'-39.0', 40.0'-41.5' Lab ID 363  
 County Muhlenberg, Ky Date Received 11-11-09  
 Sample Type SPT Comp Date Reported 11-20-09

**Test Results**

**Natural Moisture Content**

Test Not Performed  
 Moisture Content (%): N/A

**Atterberg Limits**

Test Method: ASTM D 4318 Method A  
 Prepared: Dry  
 Liquid Limit: 46  
 Plastic Limit: 22  
 Plasticity Index: 24  
 Activity Index: 0.51

**Particle Size Analysis**

Preparation Method: ASTM D 421  
 Gradation Method: ASTM D 422  
 Hydrometer Method: ASTM D 422

Particle Size		% Passing
Sieve Size	(mm)	
3"	75	
2"	50	
1 1/2"	37.5	
1"	25	
3/4"	19	
3/8"	9.5	
No. 4	4.75	
No. 10	2	100.0
No. 40	0.425	99.9
No. 200	0.075	99.6
	0.02	94.2
	0.005	66.7
	0.002	47.1
estimated	0.001	35.0

**Moisture-Density Relationship**

Test Not Performed  
 Maximum Dry Density (lb/ft<sup>3</sup>): N/A  
 Maximum Dry Density (kg/m<sup>3</sup>): N/A  
 Optimum Moisture Content (%): N/A  
 Over Size Correction %: N/A

**California Bearing Ratio**

Test Not Performed  
 Bearing Ratio (%): N/A  
 Compacted Dry Density (lb/ft<sup>3</sup>): N/A  
 Compacted Moisture Content (%): N/A

**Specific Gravity**

Test Method: ASTM D 854  
 Prepared: Dry  
 Particle Size: No. 10  
 Specific Gravity at 20° Celsius: 2.76

Plus 3 in. material, not included: 0 (%)

Range	ASTM (%)	AASHTO (%)
Gravel	0.0	0.0
Coarse Sand	0.0	0.1
Medium Sand	0.1	---
Fine Sand	0.3	0.3
Silt	32.9	52.5
Clay	66.7	47.1

**Classification**

Unified Group Symbol: CL  
 Group Name: Lean clay  
 AASHTO Classification: A-7-6 (27)

Comments: \_\_\_\_\_

Reviewed by: RJ

Project TVA - PAF Peabody Ash Pond  
 Source STN-4, 37.5'-39.0', 40.0'-41.5'

Project No. 175569069

Lab ID 363


% + No. 40 0

Tested By MC Test Method ASTM D 4318 Method A

Date Received 11-11-2009

Test Date 11-19-2009 Prepared Dry

Wet Soil and Tare Mass (g)	Dry Soil and Tare Mass (g)	Tare Mass (g)	Number of Blows	Water Content (%)	Liquid Limit
18.33	16.20	11.50	26	45.3	46
19.69	17.14	11.43	30	44.7	
18.86	16.48	11.47	18	47.5	

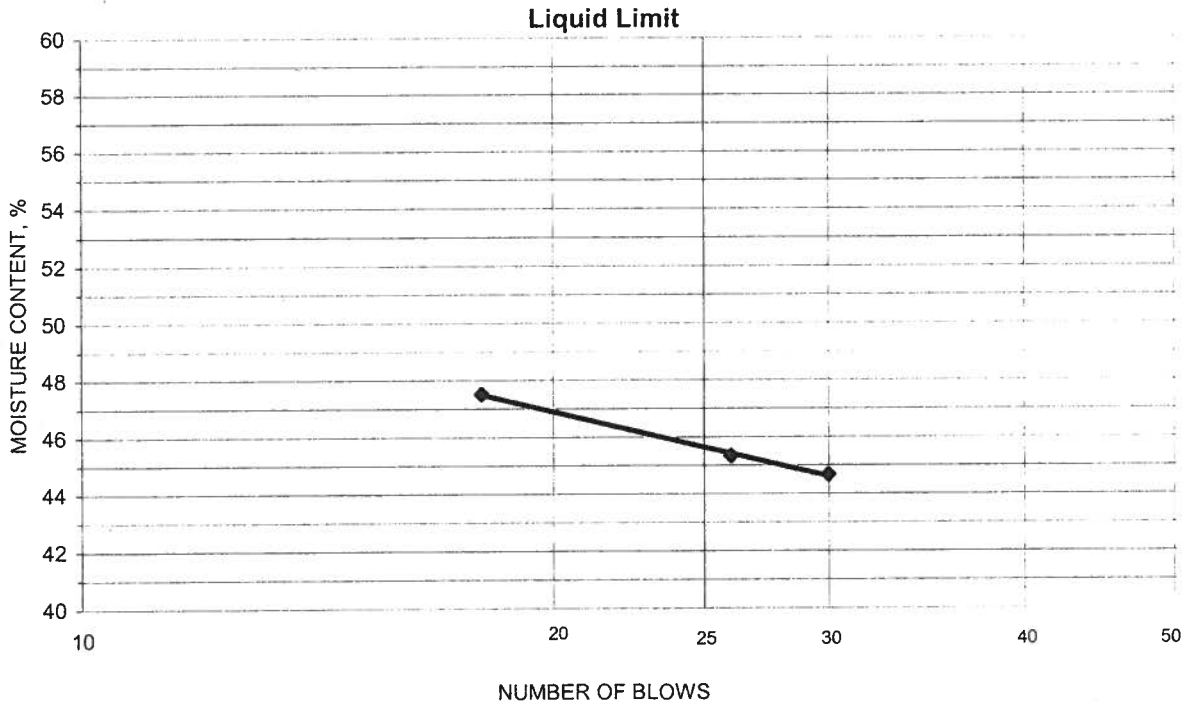

**PLASTIC LIMIT AND PLASTICITY INDEX**

Wet Soil and Tare Mass (g)	Dry Soil and Tare Mass (g)	Tare Mass (g)	Water Content (%)	Plastic Limit	Plasticity Index
18.77	17.48	11.62	22.0	22	24
18.49	17.21	11.38	22.0		

Remarks: \_\_\_\_\_

Reviewed By RJ



**Particle-Size Analysis of Soils**

ASTM D 422

Project Name TVA - PAF Peabody Ash Pond  
 Source STN-4, 37.5'-39.0', 40.0'-41.5'

Project Number 175569069  
 Lab ID 363

**Sieve analysis for the Portion Coarser than the No. 10 Sieve**

Test Method: ASTM D 422  
 Prepared using: ASTM D 421  
 Particle Shape: N/A  
 Particle Hardness: N/A  
 Tested By: CM  
 Test Date: 11-12-2009  
 Date Received 11-11-2009

Sieve Size	% Passing
3"	
2"	
1 1/2"	
1"	
3/4"	
3/8"	
No. 4	
No. 10	100.0

Maximum Particle size: No. 10 Sieve

**Analysis for the portion Finer than the No. 10 Sieve**

Analysis Based on: Total Sample


Specific Gravity 2.76

Dispersed using: Apparatus A - Mechanical, for 1 minute

No. 40	99.9
No. 200	99.6
0.02 mm	94.2
0.005 mm	66.7
0.002 mm	47.1
0.001 mm	35.0

**Particle Size Distribution**

ASTM	Coarse Gravel	Fine Gravel	C. Sand	Medium Sand	Fine Sand	Silt	Clay
	0.0	0.0	0.0	0.1	0.3	32.9	66.7
AASHTO	Gravel		Coarse Sand		Fine Sand	Silt	Clay
	0.0		0.1		0.3	52.5	47.1

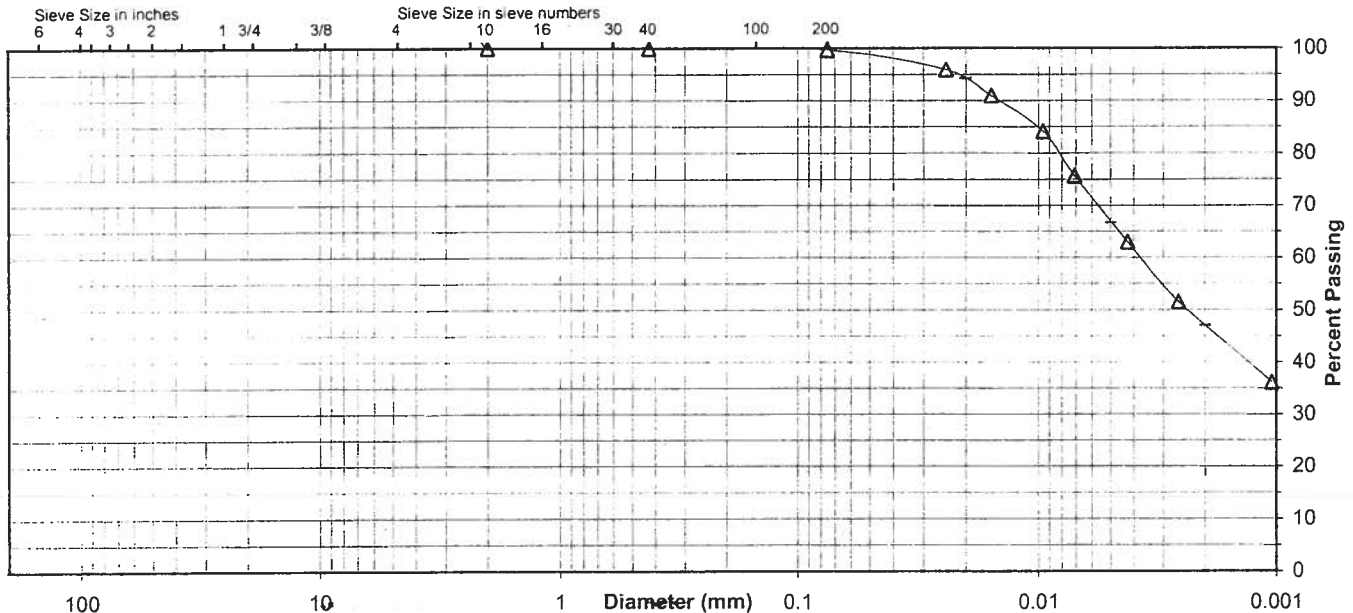

Comments \_\_\_\_\_

Reviewed By Rj





Summary of Soil Tests

N3

Project Name TVA - PAF Peabody Ash Pond Project Number 175569069  
 Source STN-16, 15.5'-17.0', 18.0'-19.5' Lab ID 381  
 County Muhlenberg, Ky Date Received 11-11-09  
 Sample Type SPT Comp Date Reported 11-20-09

**Test Results**

**Natural Moisture Content**

Test Not Performed  
 Moisture Content (%): N/A

**Atterberg Limits**

Test Method: ASTM D 4318 Method A  
 Prepared: Dry  
 Liquid Limit: 23  
 Plastic Limit: 17  
 Plasticity Index: 6  
 Activity Index: 0.50

**Particle Size Analysis**

Preparation Method: ASTM D 421  
 Gradation Method: ASTM D 422  
 Hydrometer Method: ASTM D 422

Particle Size		%
Sieve Size	(mm)	Passing
3"	75	
2"	50	
1 1/2"	37.5	
1"	25	
3/4"	19	
3/8"	9.5	
No. 4	4.75	
No. 10	2	100.0
No. 40	0.425	99.9
No. 200	0.075	92.1
	0.02	47.7
	0.005	17.7
	0.002	11.5
estimated	0.001	8.0

**Moisture-Density Relationship**

Test Not Performed  
 Maximum Dry Density (lb/ft<sup>3</sup>): N/A  
 Maximum Dry Density (kg/m<sup>3</sup>): N/A  
 Optimum Moisture Content (%): N/A  
 Over Size Correction %: N/A

**California Bearing Ratio**

Test Not Performed  
 Bearing Ratio (%): N/A  
 Compacted Dry Density (lb/ft<sup>3</sup>): N/A  
 Compacted Moisture Content (%): N/A

**Specific Gravity**

Test Method: ASTM D 854  
 Prepared: Dry  
 Particle Size: No. 10  
 Specific Gravity at 20° Celsius: 2.67

Plus 3 in. material, not included: 0 (%)

Range	ASTM (%)	AASHTO (%)
Gravel	0.0	0.0
Coarse Sand	0.0	0.1
Medium Sand	0.1	---
Fine Sand	7.8	7.8
Silt	74.4	80.6
Clay	17.7	11.5

**Classification**

Unified Group Symbol: CL-ML  
 Group Name: Silty clay  
 AASHTO Classification: A-4 (3)


Comments: \_\_\_\_\_

Reviewed by: RJ

Project TVA - PAF Peabody Ash Pond  
 Source STN-16, 15.5'-17.0', 18.0'-19.5'  
 Tested By mc Test Method ASTM D 4318 Method A  
 Test Date 11-19-2009 Prepared Dry

Project No. 175569069  
 Lab ID 381  
 % + No. 40 0  
 Date Received 11-11-2009

Wet Soil and Tare Mass (g)	Dry Soil and Tare Mass (g)	Tare Mass (g)	Number of Blows	Water Content (%)	Liquid Limit
16.98	15.85	11.49	15	25.9	23
18.94	17.50	11.43	20	23.7	
20.23	18.57	11.41	27	23.2	

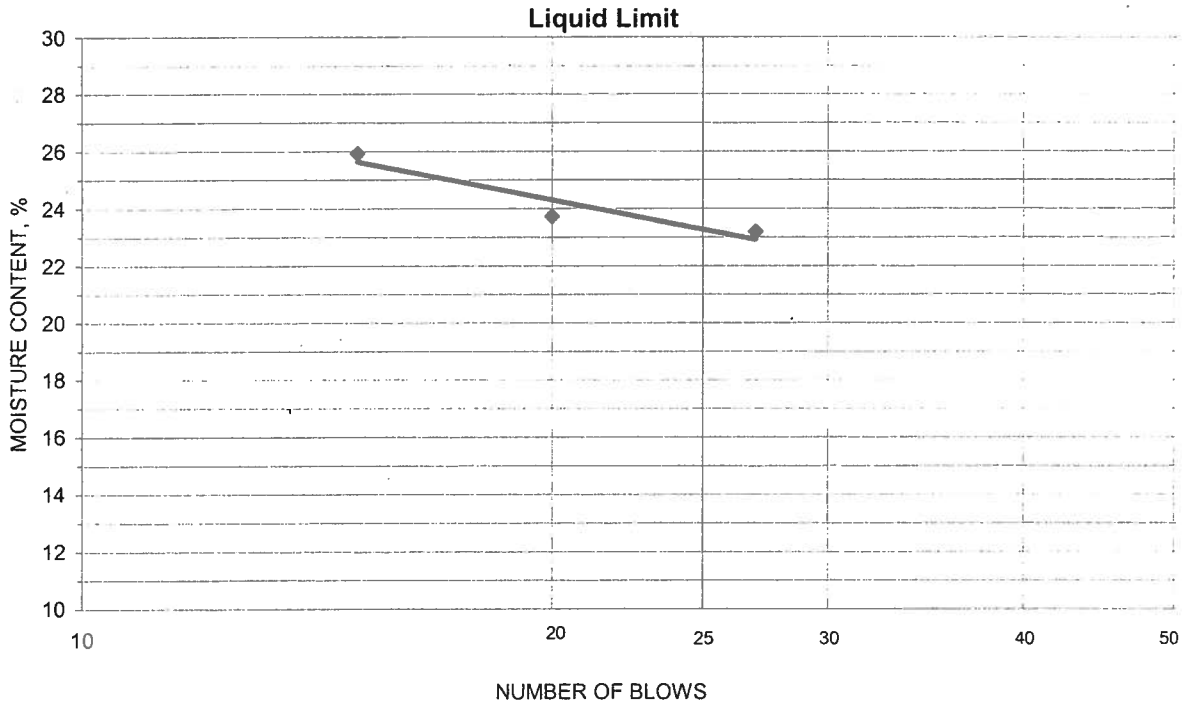

**PLASTIC LIMIT AND PLASTICITY INDEX**

Wet Soil and Tare Mass (g)	Dry Soil and Tare Mass (g)	Tare Mass (g)	Water Content (%)	Plastic Limit	Plasticity Index
19.26	18.15	11.77	17.4	17	6
18.75	17.67	11.45	17.4		

Remarks: \_\_\_\_\_

Reviewed By RJ

Project Name TVA - PAF Peabody Ash Pond  
 Source STN-16, 15.5'-17.0', 18.0'-19.5'

 Project Number 175569069  
 Lab ID 381
**Sieve analysis for the Portion Coarser than the No. 10 Sieve**

 Test Method: ASTM D 422  
 Prepared using: ASTM D 421

 Particle Shape: N/A  
 Particle Hardness: N/A

 Tested By: CM  
 Test Date: 11-12-2009  
 Date Received: 11-11-2009

Maximum Particle size: No. 10 Sieve

Sieve Size	% Passing
3"	
2"	
1 1/2"	
1"	
3/4"	
3/8"	
No. 4	
No. 10	100.0

**Analysis for the portion Finer than the No. 10 Sieve**

Analysis Based on: Total Sample


 Specific Gravity 2.67

Dispersed using: Apparatus A - Mechanical, for 1 minute

No. 40	99.9
No. 200	92.1
0.02 mm	47.7
0.005 mm	17.7
0.002 mm	11.5
0.001 mm	8.0

**Particle Size Distribution**



ASTM	Coarse Gravel	Fine Gravel	C. Sand	Medium Sand	Fine Sand	Silt	Clay
	0.0	0.0	0.0	0.1	7.8	74.4	17.7
AASHTO	Gravel		Coarse Sand		Fine Sand	Silt	Clay
	0.0		0.1		7.8	80.6	11.5

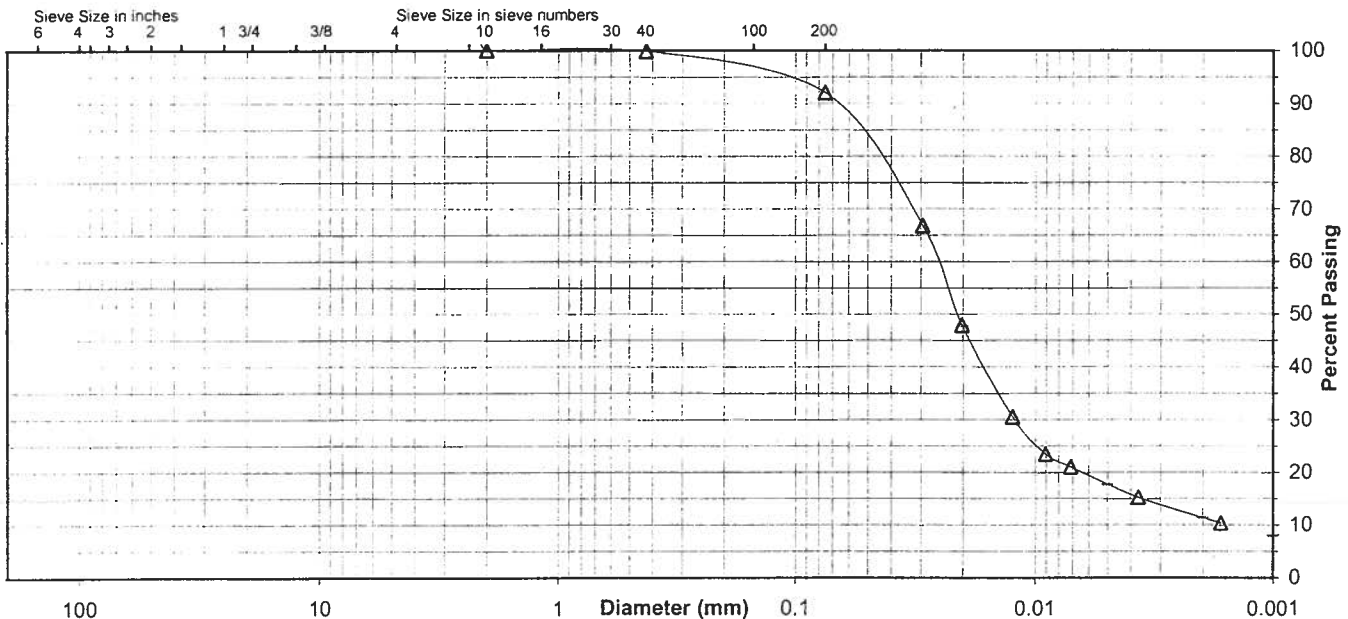

Comments \_\_\_\_\_

 Reviewed By RJ

# UNCONSOLIDATED UNDRAINED TRIAXIAL TEST by ASTM D2850

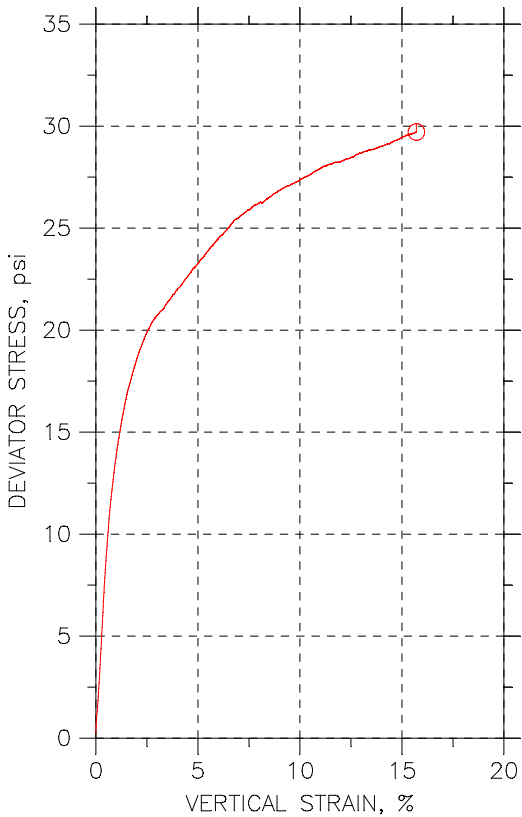
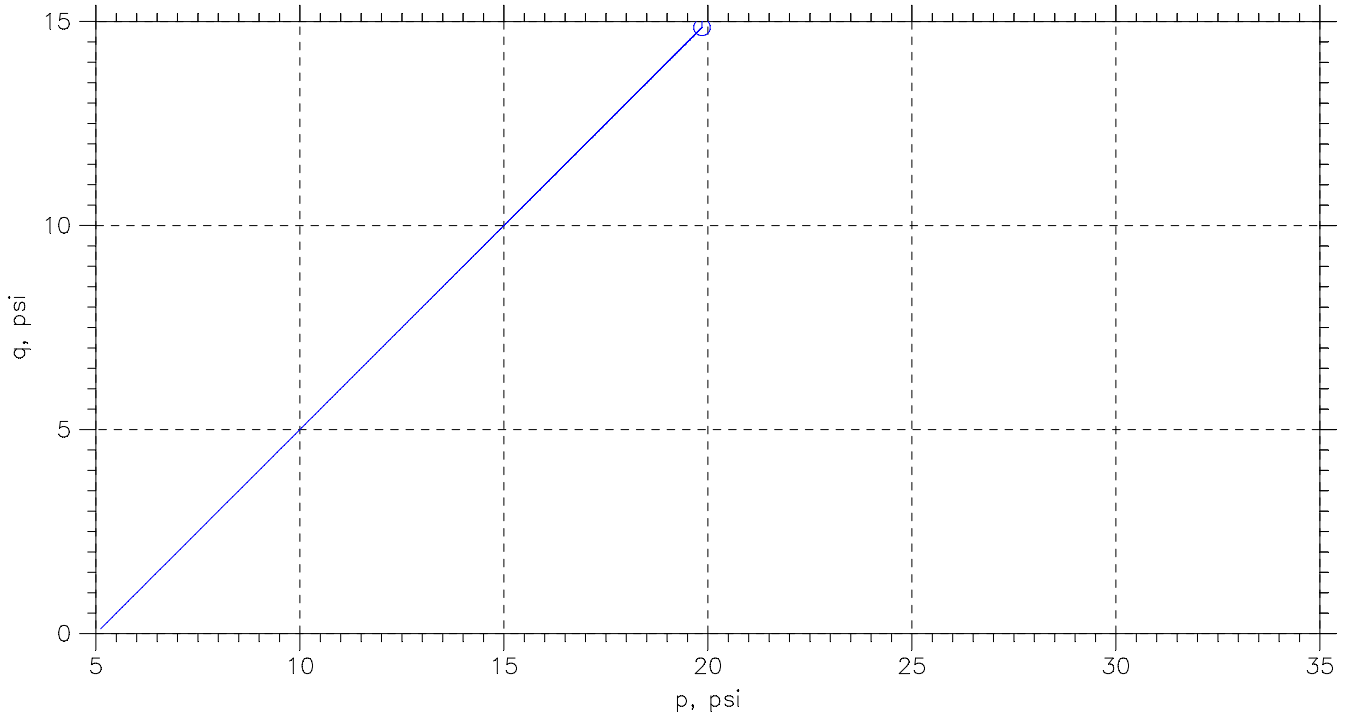


Symbol	⊙			
Sample No.	<b>STN-22, ST-1</b>			
Test No.	7.1			
Depth	6.0-6.5			
Tested by	jm			
Test Date	11/19/09			
Checked by	mm			
Check Date				
Diameter, in	2.854			
Height, in	5.797			
Water Content, %	13.6			
Dry Density, pcf	119.3			
Saturation, %	89.0			
Void Ratio	0.413			
Confining Stress, psi	5			
Undrained Strength, psi	14.86			
Max. Dev. Stress, psi	29.71			
Strain at Failure, %	15.7			
Strain Rate, %/min	1			
Estimated Specific Gravity	2.7			
Liquid Limit	---			
Plastic Limit	---			
Plasticity Index	---			

	Project: Peabody Ash Pond				
	Location: ---				
	Project No.: GTX-1503				
	Boring No.: STN-6				
	Sample Type: UD				
	Description: Gray-Brown Lean clay with sand				
Remarks: 2054					

Phase calculations based on start and end of test.

# UNCONSOLIDATED UNDRAINED TRIAXIAL TEST by ASTM D2850

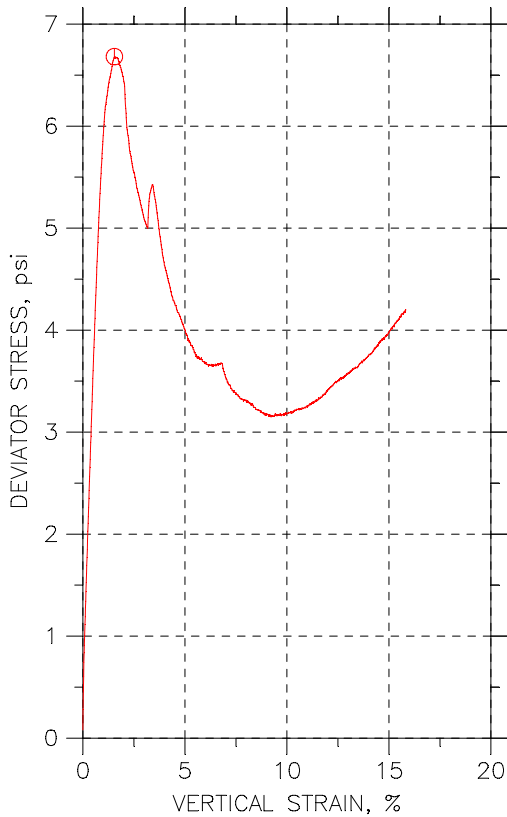
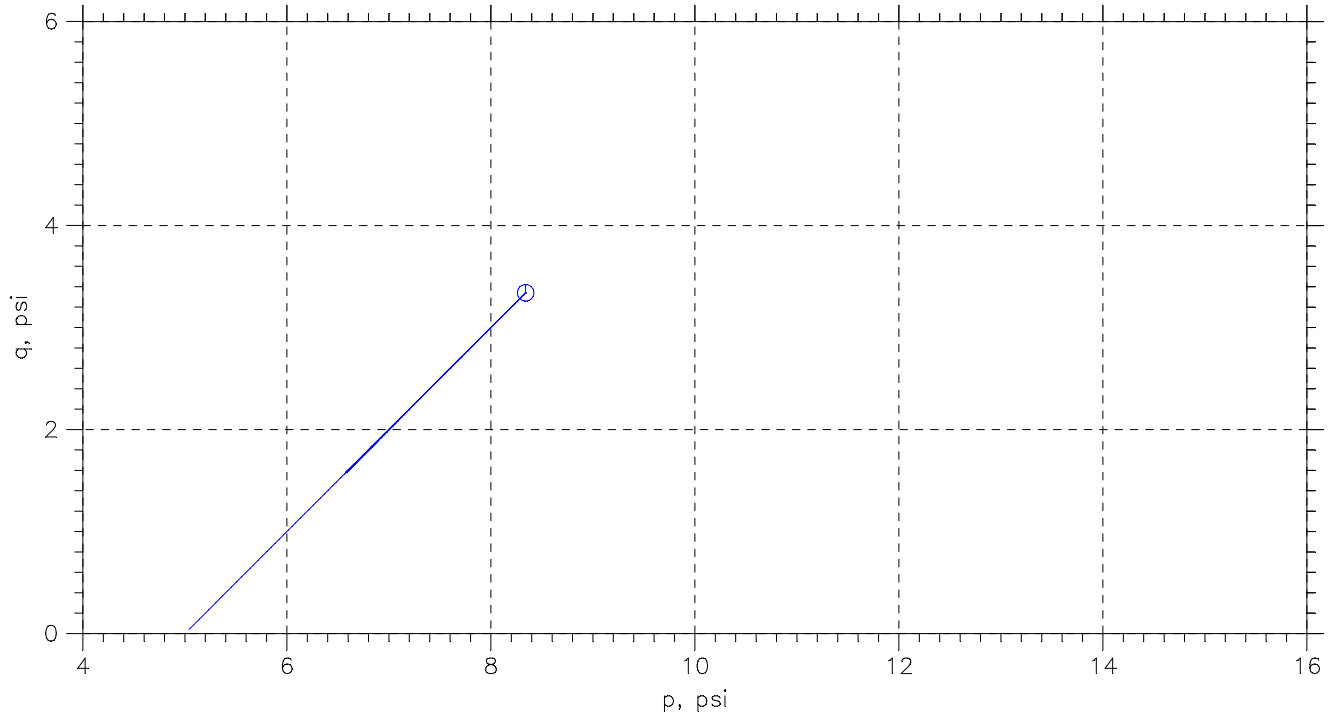


Symbol	⊖			
Sample No.	<b>STN-16; ST-1</b>			
Test No.	6.1			
Depth	5.1-5.7			
Tested by	jm			
Test Date	11/19/09			
Checked by	mm			
Check Date				
Diameter, in	2.841			
Height, in	6.334			
Water Content, %	25.0			
Dry Density, pcf	101.			
Saturation, %	100.8			
Void Ratio	0.669			
Confining Stress, psi	5			
Undrained Strength, psi	3.341			
Max. Dev. Stress, psi	6.681			
Strain at Failure, %	1.54			
Strain Rate, %/min	1			
Estimated Specific Gravity	2.7			
Liquid Limit	---			
Plastic Limit	---			
Plasticity Index	---			


	Project: Peabody Ash Pond				
	Location: ---				
	Project No.: GTX-1503				
	Boring No.: STN-16				
	Sample Type: UD				
	Description: Gray-Brown Lean clay with sand				
Remarks: 2054					

Phase calculations based on start and end of test.

# UNCONSOLIDATED UNDRAINED TRIAXIAL TEST by ASTM D2850

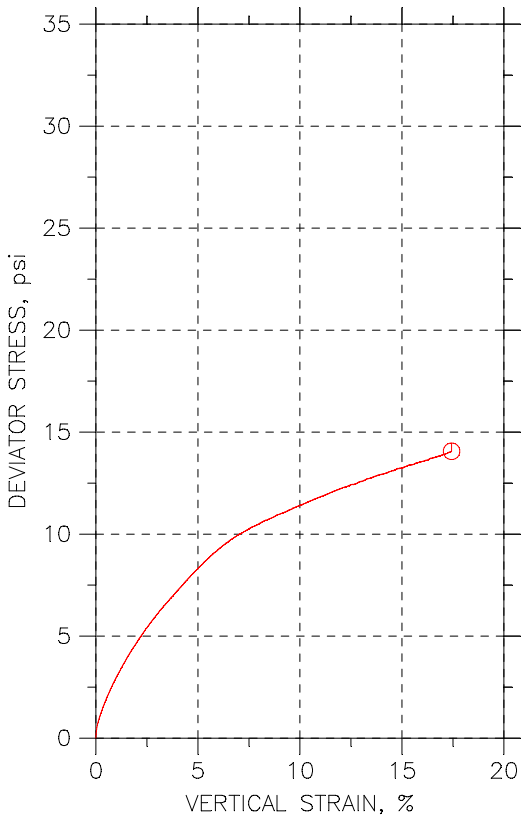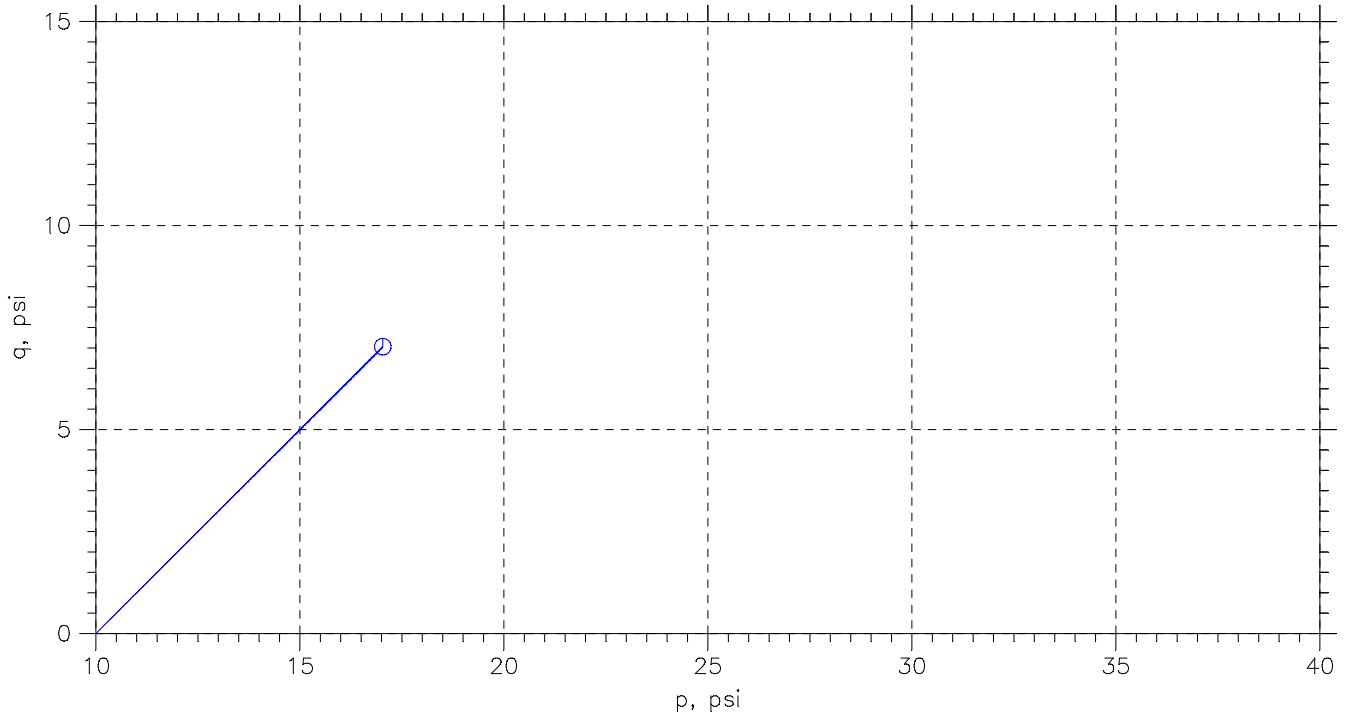

Symbol	⊕			
Sample No.	<b>STN-6, ST-2</b>			
Test No.	5.1			
Depth	11.8-12.4			
Tested by	jm			
Test Date	11/19/09			
Checked by	mm			
Check Date				
Diameter, in	2.775			
Height, in	5.914			
Water Content, %	19.3			
Dry Density, pcf	115.			
Saturation, %	111.9			
Void Ratio	0.465			
Confining Stress, psi	10			
Undrained Strength, psi	7.031			
Max. Dev. Stress, psi	14.06			
Strain at Failure, %	17.4			
Strain Rate, %/min	1			
Estimated Specific Gravity	2.7			
Liquid Limit	---			
Plastic Limit	---			
Plasticity Index	---			

 <p><b>GeoTesting</b> express the groundwork for success</p>	Project: Peabody Ash Pond	<div style="display: flex; justify-content: space-around;"> <div style="border: 1px dashed black; width: 40px; height: 60px;"></div> <div style="border: 1px dashed black; width: 40px; height: 60px;"></div> <div style="border: 1px dashed black; width: 40px; height: 60px;"></div> <div style="border: 1px dashed black; width: 40px; height: 60px;"></div> </div>
	Location: ---	
	Project No.: GTX-1503	
	Boring No.: STN-6	
	Sample Type: UD	
	Description: Gray-Brown Lean clay with sand	
Remarks: 2054		

Phase calculations based on start and end of test.

## Appendix H

### Results of Engineering Analysis

**SEEP/W Analysis  
Section A-A'  
Peabody Ash Pond**


**Paradise Fossil Plant  
Tennessee Valley Authority**

Piping Potential  
 Maximum occurs at (1271.1,399)  
 Total Head = 399.0 ft  
 At (1270.48,395.99)  
 Total Head = 399.39 ft  
 dH = 0.39 ft dl = 3.01 ft  
 i = 0.13 i(critical) = 1.23  
 FSpiping = 9.5

December 2009  
 Method: Steady-State Seepage

Note:  
 The results of analysis shown here are based on available subsurface information, laboratory test results and approximate soil properties. No warranties can be made regarding the continuity of subsurface conditions between the borings.

Material Type	Ksat (ft/s)	Kratio	Wsat (ft3/ft3)
Soil 1: Lean Clay with Sand	3.3e-008	0.1	0.29
Soil 2: Lean Clay with Sand	3.3e-008	0.1	0.29
Soil 4: Clayey Sand	7.2e-008	0.05	0.32
Soil 6: Silty Clay	9.5e-008	0.02	0.38
Hydraulically Placed Ash	5e-005	0.02	0.46

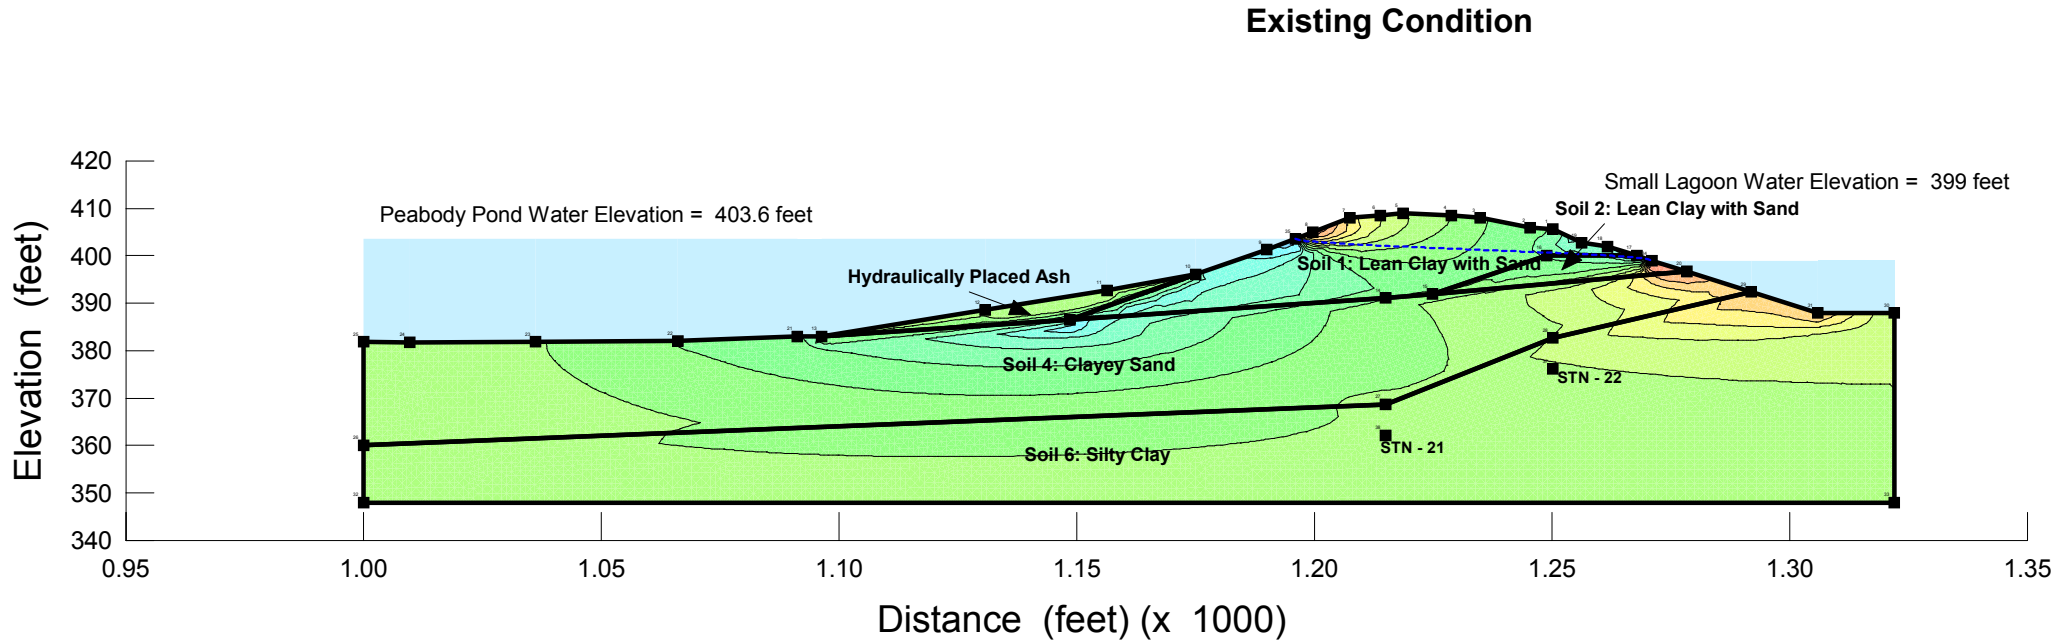



# Slope Stability Section A-A' Peabody Ash Pond

**Factor of Safety: 1.7**

Center: (1288, 457.5) ft  
Radius: 70.5 ft

## Paradise Fossil Plant Tennessee Valley Authority

December 2009


Method: Modified Spencer

**Note:**

The results of analysis shown here are based on available subsurface information, laboratory test results and approximate soil properties. No warranties can be made regarding the continuity of subsurface conditions between the borings.

Material Type	Moist Unit Weight	Saturated Unit Weight	Cohesion	Friction Angle
Soil 1: Lean Clay with Sand	138	139	0	32
Soil 2: Lean Clay with Sand	138	139	0	32
Soil 4: Clayey Sand	129	133	0	30
Soil 6: Silty Clay	126	129	0	30
Hydraulically Placed Ash	100	107	0	25

### Existing Condition

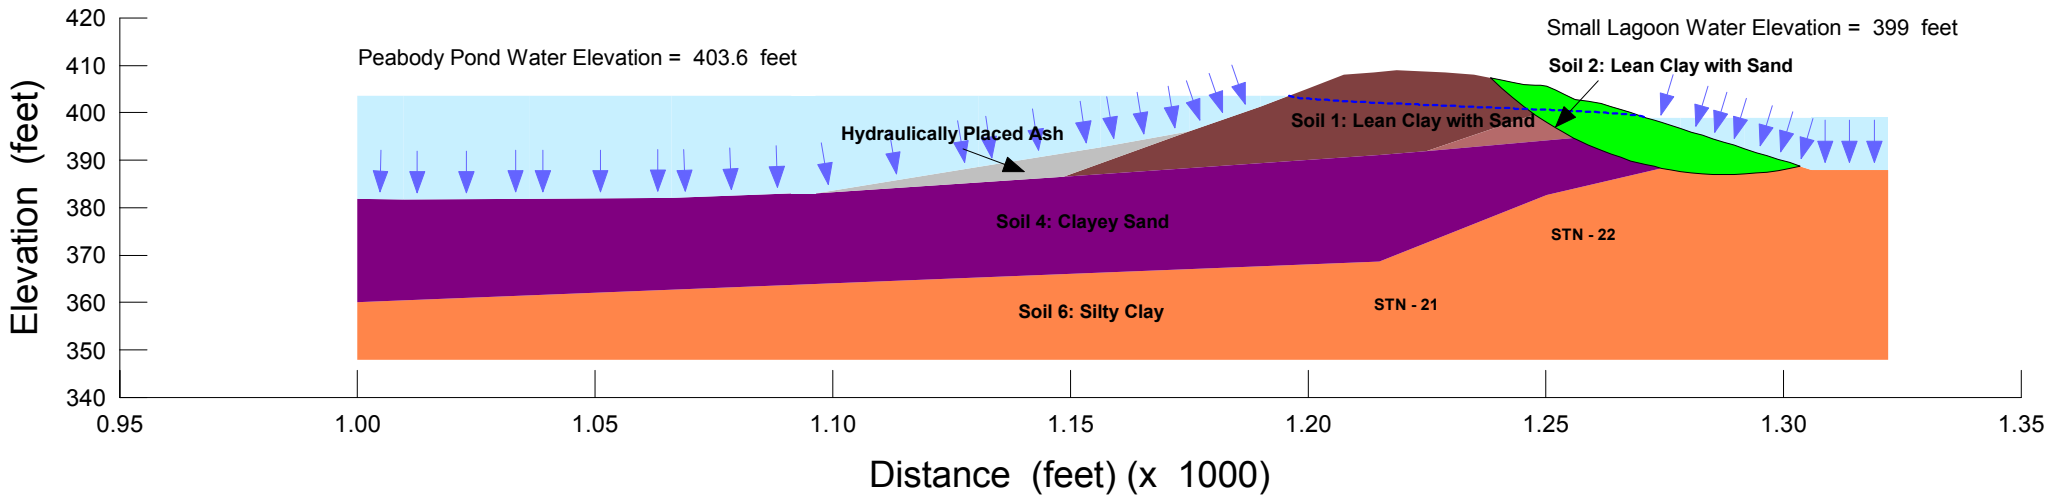

**Slope Stability  
Section A-A'  
Peabody Ash Pond**

**Factor of Safety: 2.2**

Center: (1165, 462.5) ft  
Radius: 75.5 ft

**Paradise Fossil Plant  
Tennessee Valley Authority**

December 2009


Method: Modified Spencer

**Note:**

The results of analysis shown here are based on available subsurface information, laboratory test results and approximate soil properties. No warranties can be made regarding the continuity of subsurface conditions between the borings.

Material Type	Moist Unit Weight	Saturated Unit Weight	Cohesion	Friction Angle
Soil 1: Lean Clay with Sand	138	139	0	32
Soil 2: Lean Clay with Sand	138	139	0	32
Soil 4: Clayey Sand	129	133	0	30
Soil 6: Silty Clay	126	129	0	30
Hydraulically Placed Ash	100	107	0	25


**Existing Condition**

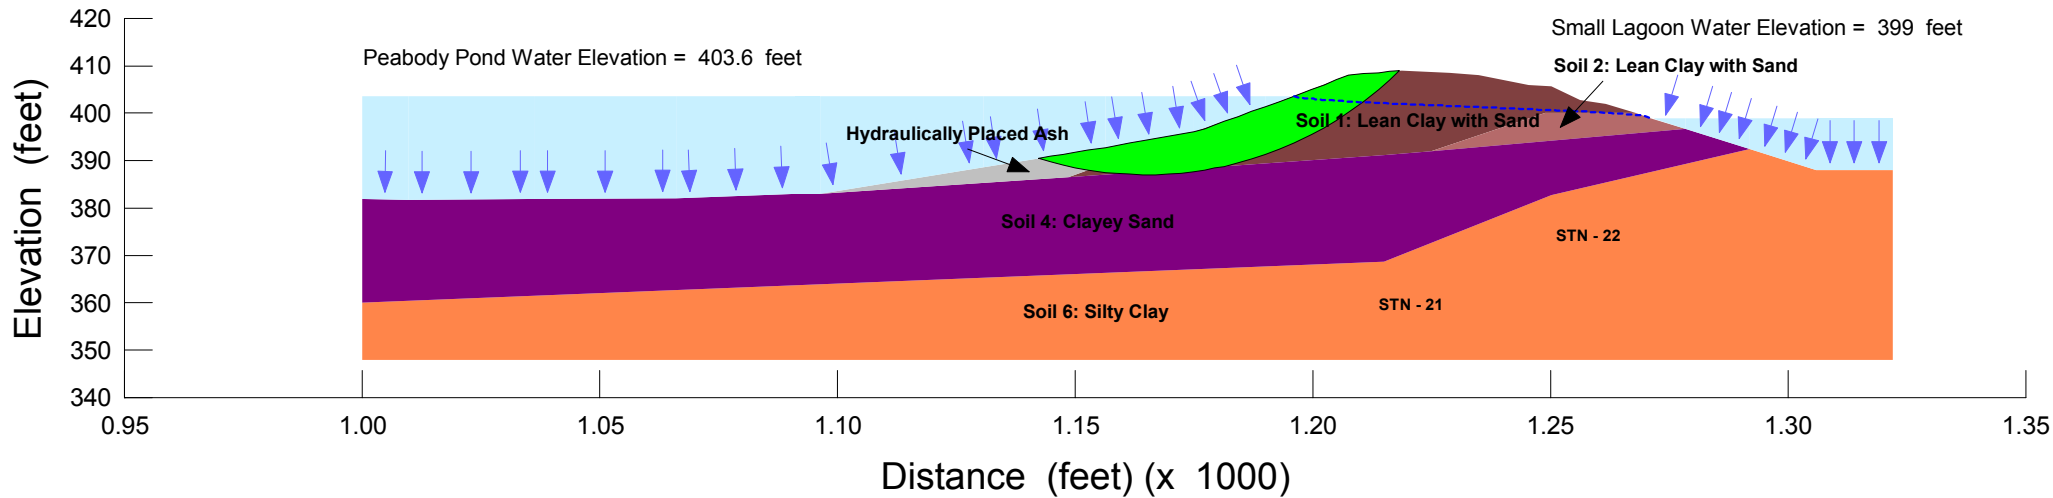

Appendix I

Mine Maps



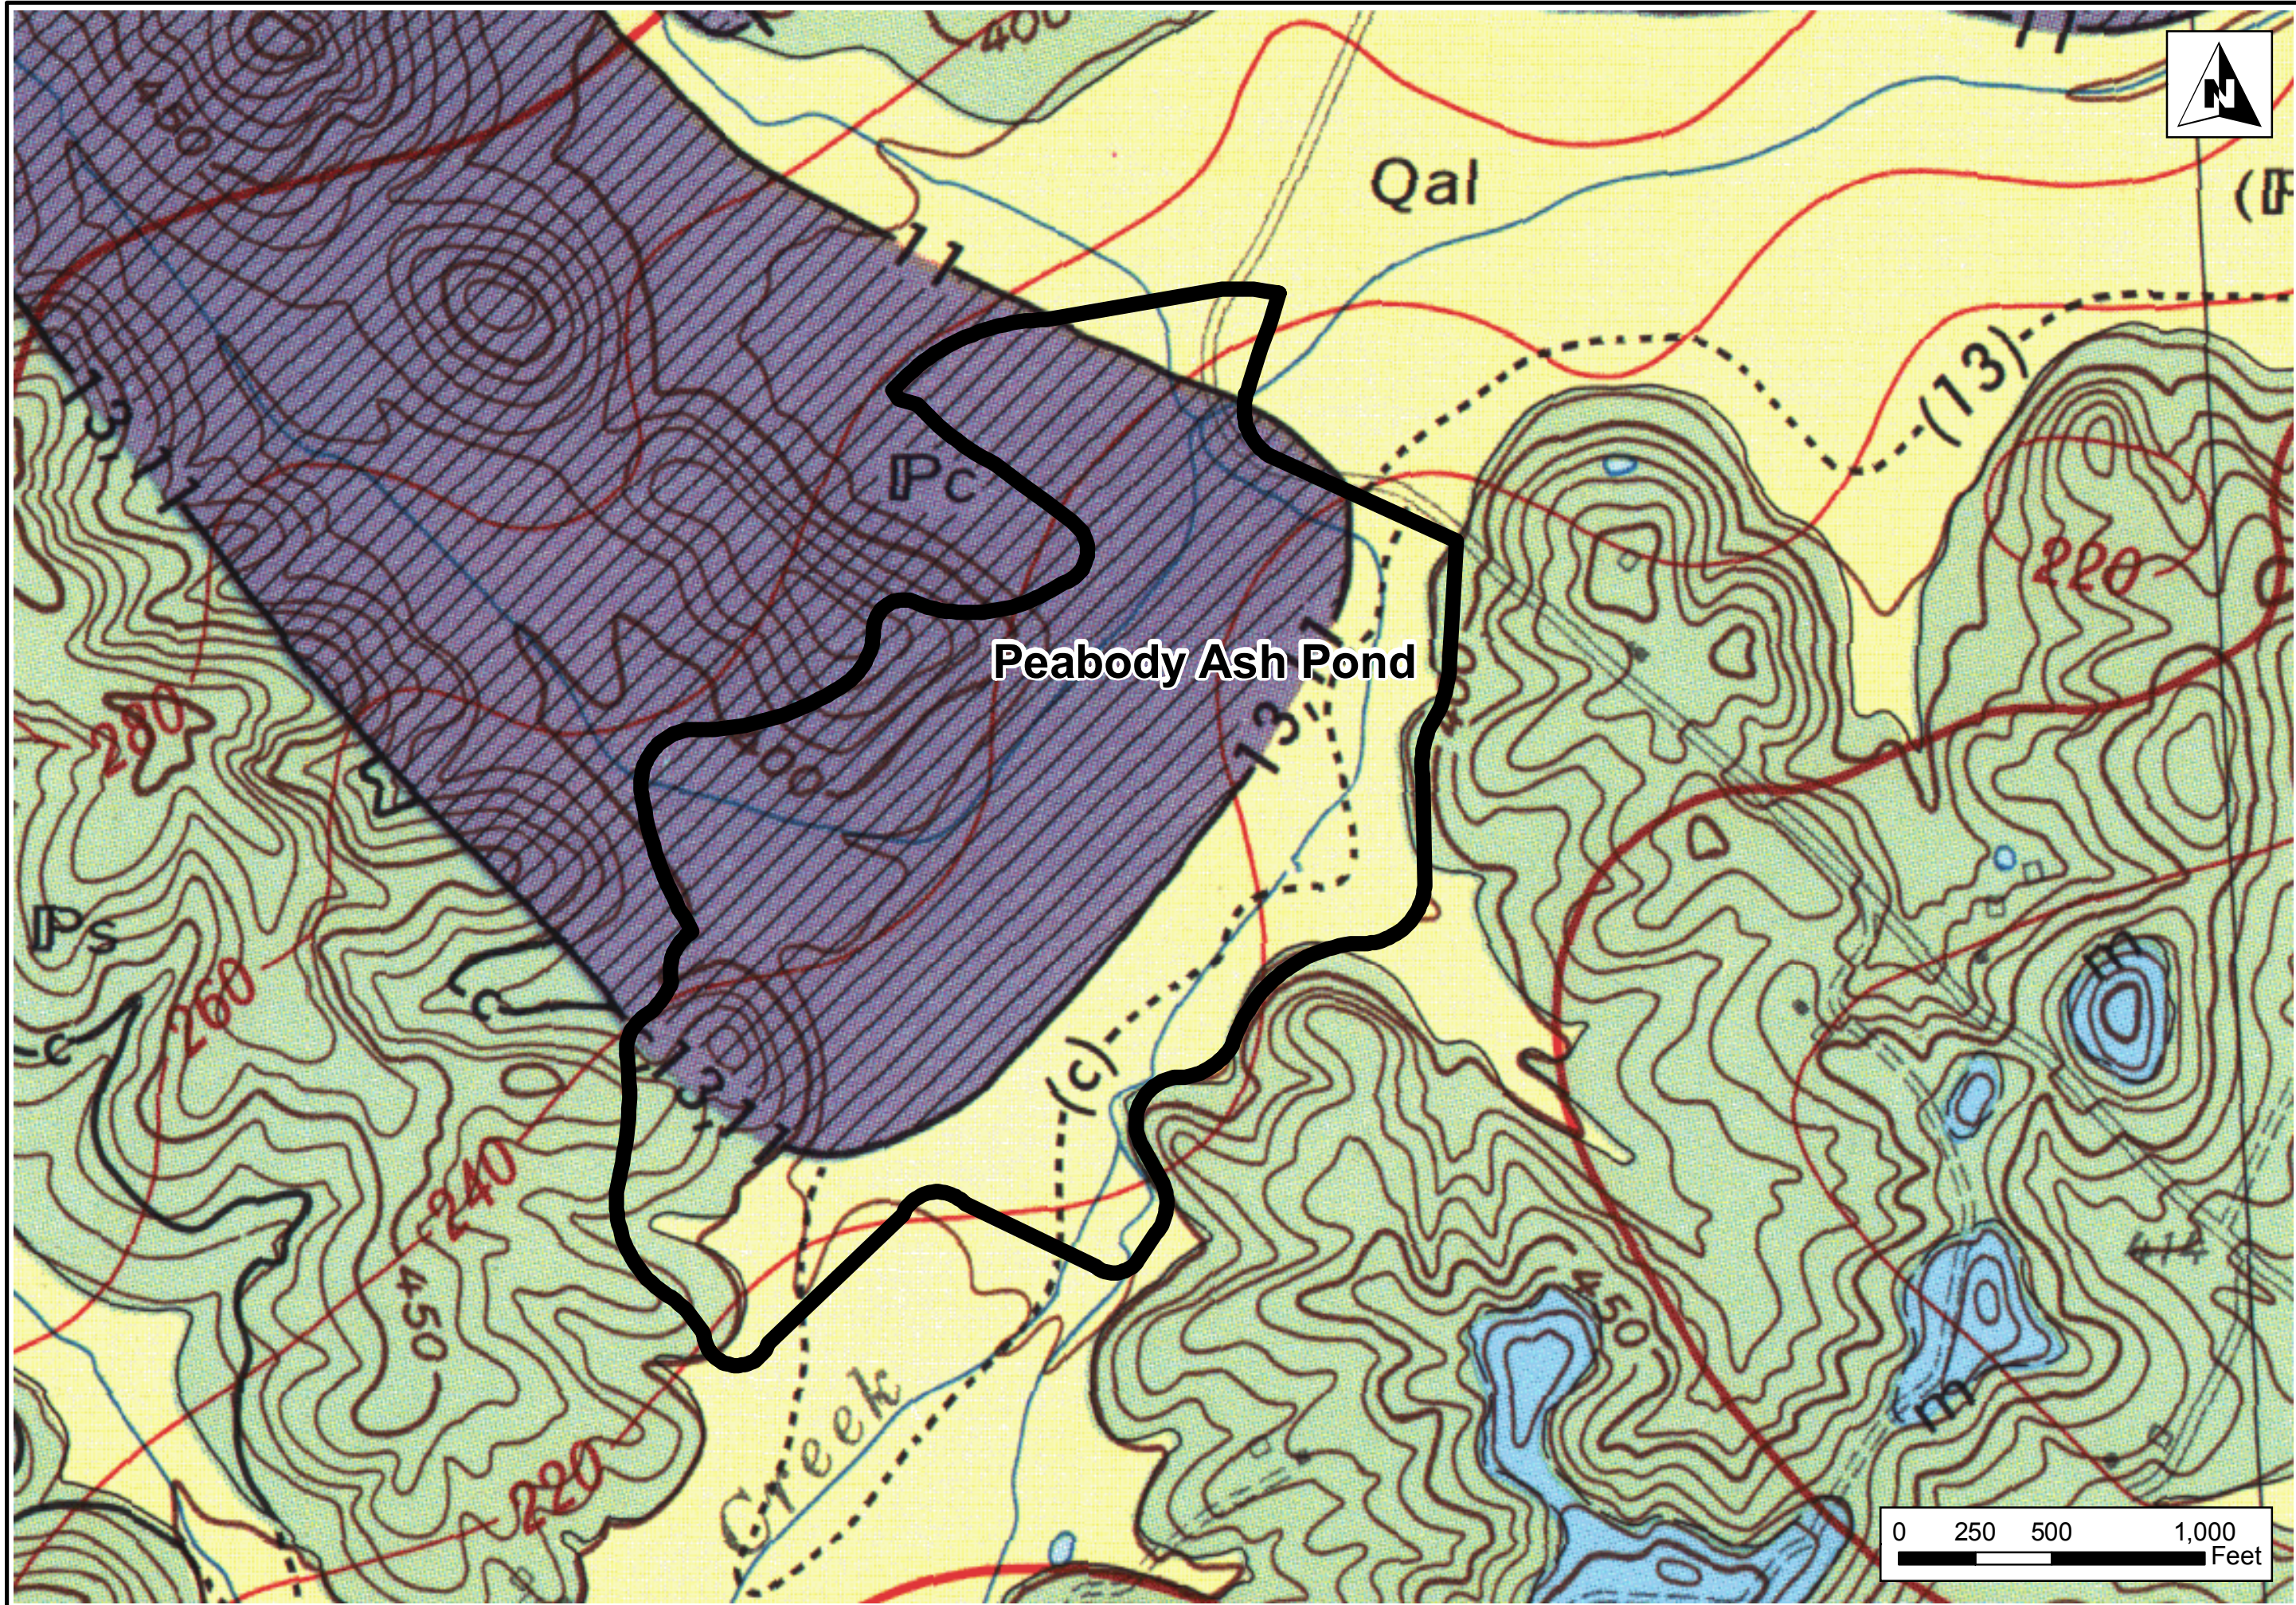

STANTEC  
CONSULTING  
SERVICES INC.  
1409 N. Forbes Rd  
Lexington, Kentucky  
40511-2050  
859-422-3000

**Stantec**



Geologic Map


Phase 2 Assessment  
Peabody Ash Pond  
Paradise Fossil Plant  
Muhlenberg County, Kentucky

PROJECT NO.	175569069
DATE	NOVEMBER 2009
DRAWN BY	BSJ
CHECKED BY	SV
SCALE	1" = 500'
REVISED	
1	
2	
3	
4	
5	
6	
7	
8	

SHEET

1 OF 1



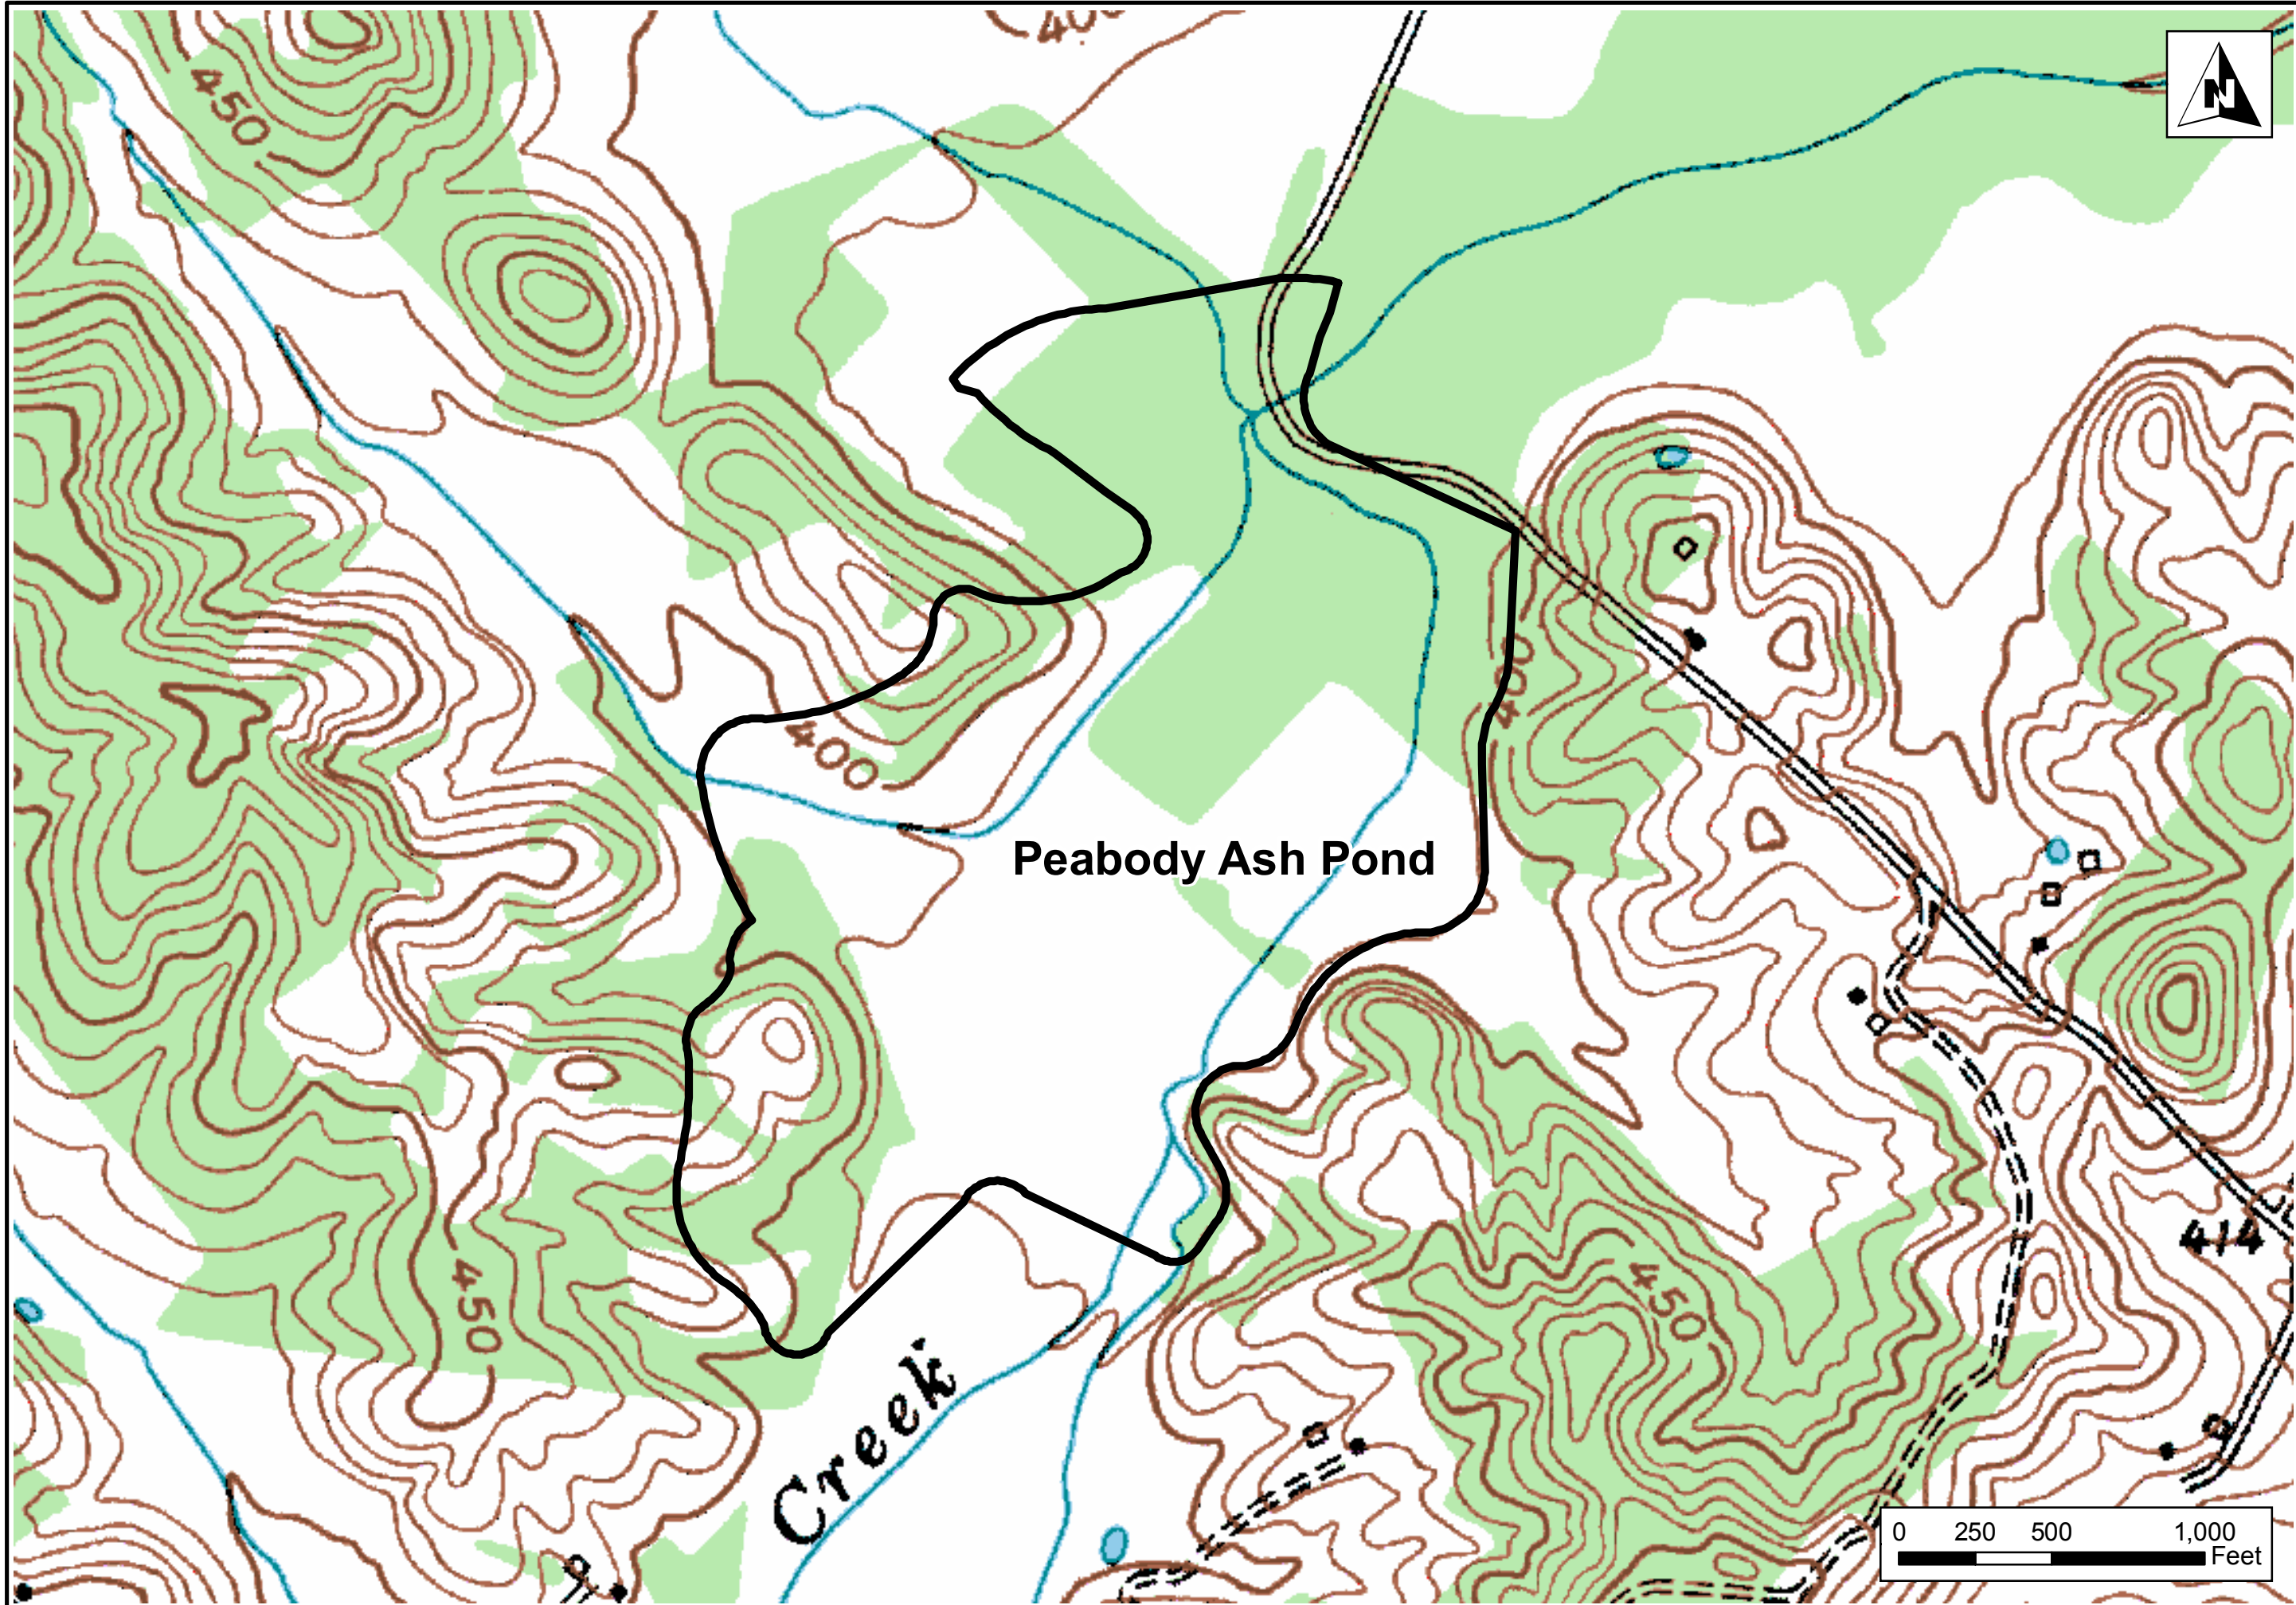

STANTEC  
CONSULTING  
SERVICES INC.  
1409 N. Forbes Rd  
Lexington, Kentucky  
40511-2050  
859-422-3000

**Stantec**



Topographic Map

Phase 2 Assessment  
Peabody Ash Pond  
Paradise Fossil Plant  
Muhlenberg County, Kentucky


PROJECT NO. 175569069  
DATE NOVEMBER 2009  
DRAWN BY B.S.J.  
CHECKED BY S.V.  
SCALE 1" = 500'  
REVISED

1
2
3
4
5
6
7
8

SHEET

1 OF 1



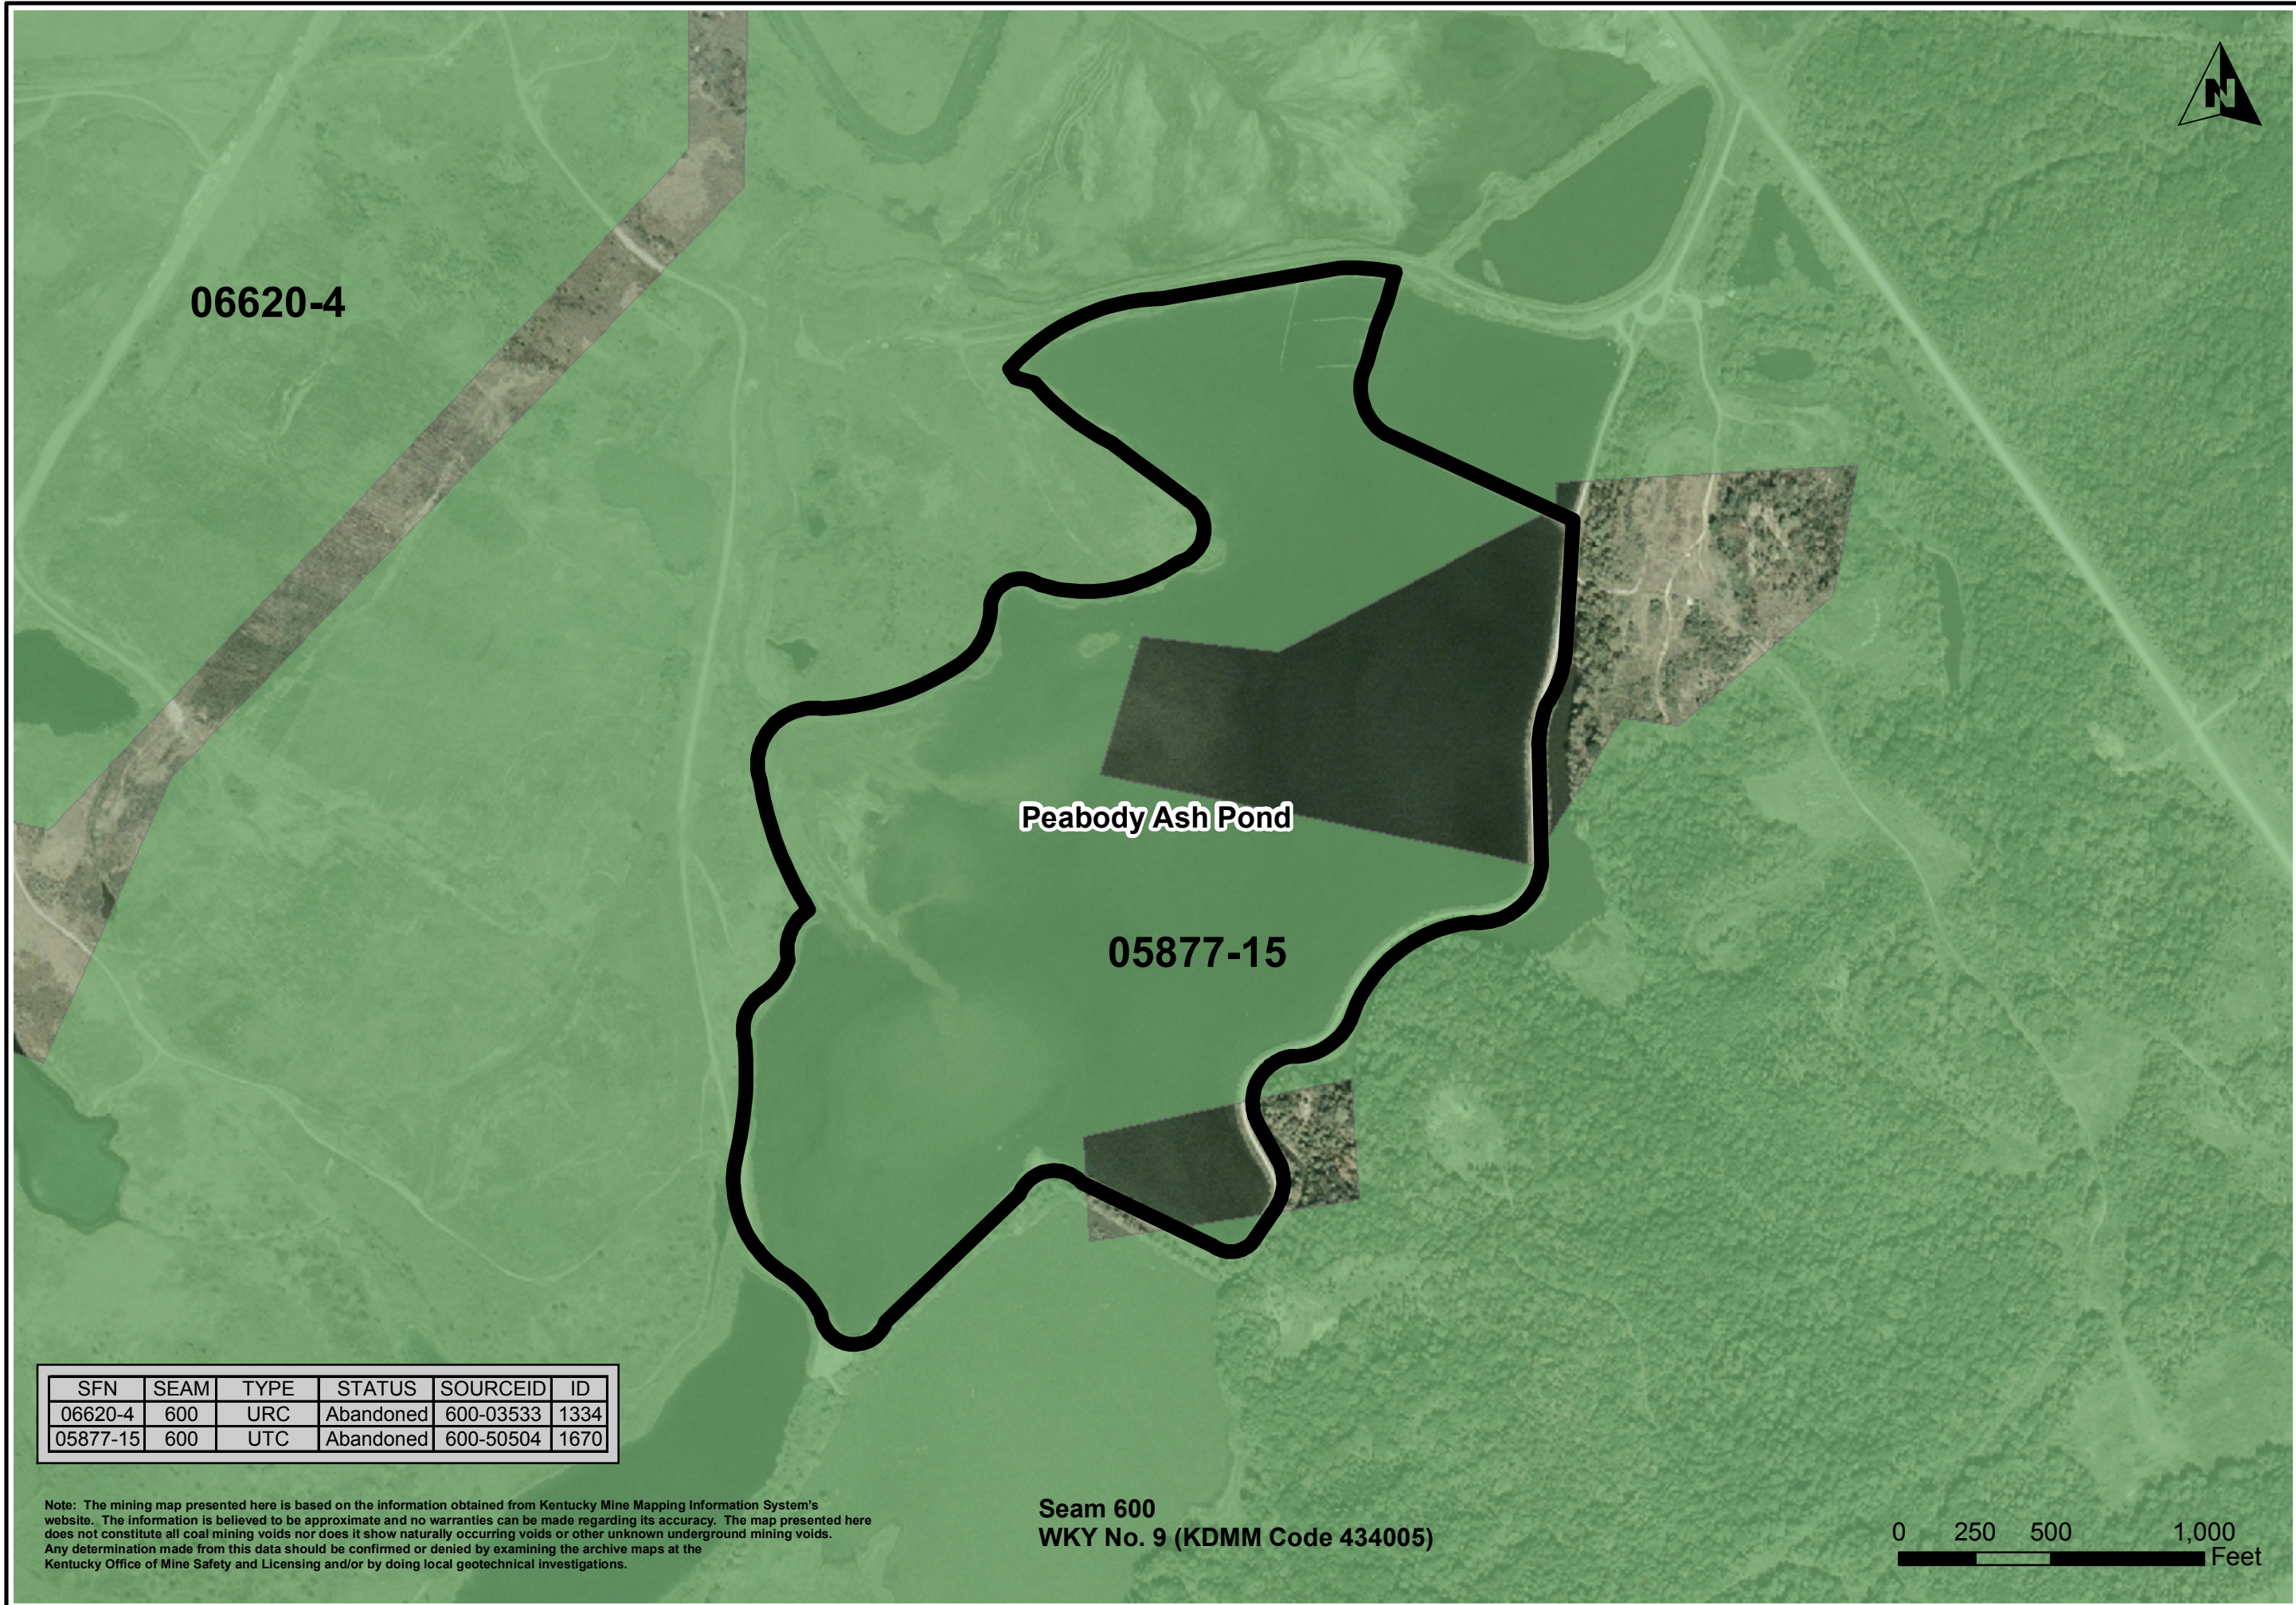

06620-4

Peabody Ash Pond


05877-15



SFN	SEAM	TYPE	STATUS	SOURCEID	ID
06620-4	600	URC	Abandoned	600-03533	1334
05877-15	600	UTC	Abandoned	600-50504	1670

Note: The mining map presented here is based on the information obtained from Kentucky Mine Mapping Information System's website. The information is believed to be approximate and no warranties can be made regarding its accuracy. The map presented here does not constitute all coal mining voids nor does it show naturally occurring voids or other unknown underground mining voids. Any determination made from this data should be confirmed or denied by examining the archive maps at the Kentucky Office of Mine Safety and Licensing and/or by doing local geotechnical investigations.

Seam 600  
WKY No. 9 (KDMM Code 434005)



STANTEC  
CONSULTING  
SERVICES INC.  
1409 N. Forbes Rd.  
Lexington, Kentucky  
40511-2050  
859-422-3000



Mine Map

Phase 2 Assessment  
Peabody Ash Pond  
Paradise Fossil Plant  
Muhlenberg County, Kentucky

PROJECT NO.	175569069
DATE	DECEMBER 2009
DRAWN BY	AMG
CHECKED BY	SV
CHECKED BY	
SCALE	1" = 500'
REVISED	
1.	
2.	
3.	
4.	
5.	
6.	
7.	
8.	

SHEET

1 OF 4



00825-2



00825-2


Peabody Ash Pond

05877-15

SFN	SEAM	TYPE	STATUS	SOURCEID
00825-2	590	STC	Abandoned	590-01164
05877-15	590	UTC	Abandoned	590-01175
	590	Unknown	Abandoned	590-01174

Note: The mining map presented here is based on the information obtained from Kentucky Mine Mapping Information System's website. The information is believed to be approximate and no warranties can be made regarding its accuracy. The map presented here does not constitute all coal mining voids nor does it show naturally occurring voids or other unknown underground mining voids. Any determination made from this data should be confirmed or denied by examining the archive maps at the Kentucky Office of Mine Safety and Licensing and/or by doing local geotechnical investigations.

Seam 590  
WKY No. 11 (KDMM Code 436005)



STANTEC  
CONSULTING  
SERVICES INC.  
1409 N. Forbes Rd.  
Lexington, Kentucky  
40511-2050  
859-422-3000



Mine Map

Phase 2 Assessment  
Peabody Ash Pond  
Paradise Fossil Plant  
Muhlenberg County, Kentucky

PROJECT NO. 175569040  
DATE DECEMBER 2009  
DRAWN BY AMG  
CHECKED BY SV  
SCALE 1" = 500'  
REVISED

1.
2.
3.
4.
5.
6.
7.
8.

SHEET

2 OF 4



00825-2



STANTEC  
CONSULTING  
SERVICES INC.  
1409 N. Forbes Rd.  
Lexington, Kentucky  
40511-2050  
859-422-3000



00825-2

Peabody Ash Pond

Mine Map

Phase 2 Assessment  
Peabody Ash Pond  
Paradise Fossil Plant  
Muhlenberg County, Kentucky

SFN	SEAM	TYPE	STATUS	SOURCEID
2106	585	SRC	Abandoned	585-00325
00825-2	585	STC	Abandoned	585-00725
	585	Unknown	Abandoned	585-00734

Note: The mining map presented here is based on the information obtained from Kentucky Mine Mapping Information System's website. The information is believed to be approximate and no warranties can be made regarding its accuracy. The map presented here does not constitute all coal mining voids nor does it show naturally occurring voids or other unknown underground mining voids. Any determination made from this data should be confirmed or denied by examining the archive maps at the Kentucky Office of Mine Safety and Licensing and/or by doing local geotechnical investigations.

Seam 585  
WKY No. 12 (KDMM Code 441015)




PROJECT NO.	175569069
DATE	DECEMBER 2009
DRAWN BY	AMG
CHECKED BY	SV
SCALE	1" = 500'
REVISED	
1.	
2.	
3.	
4.	
5.	
6.	
7.	
8.	

SHEET

3 OF 4



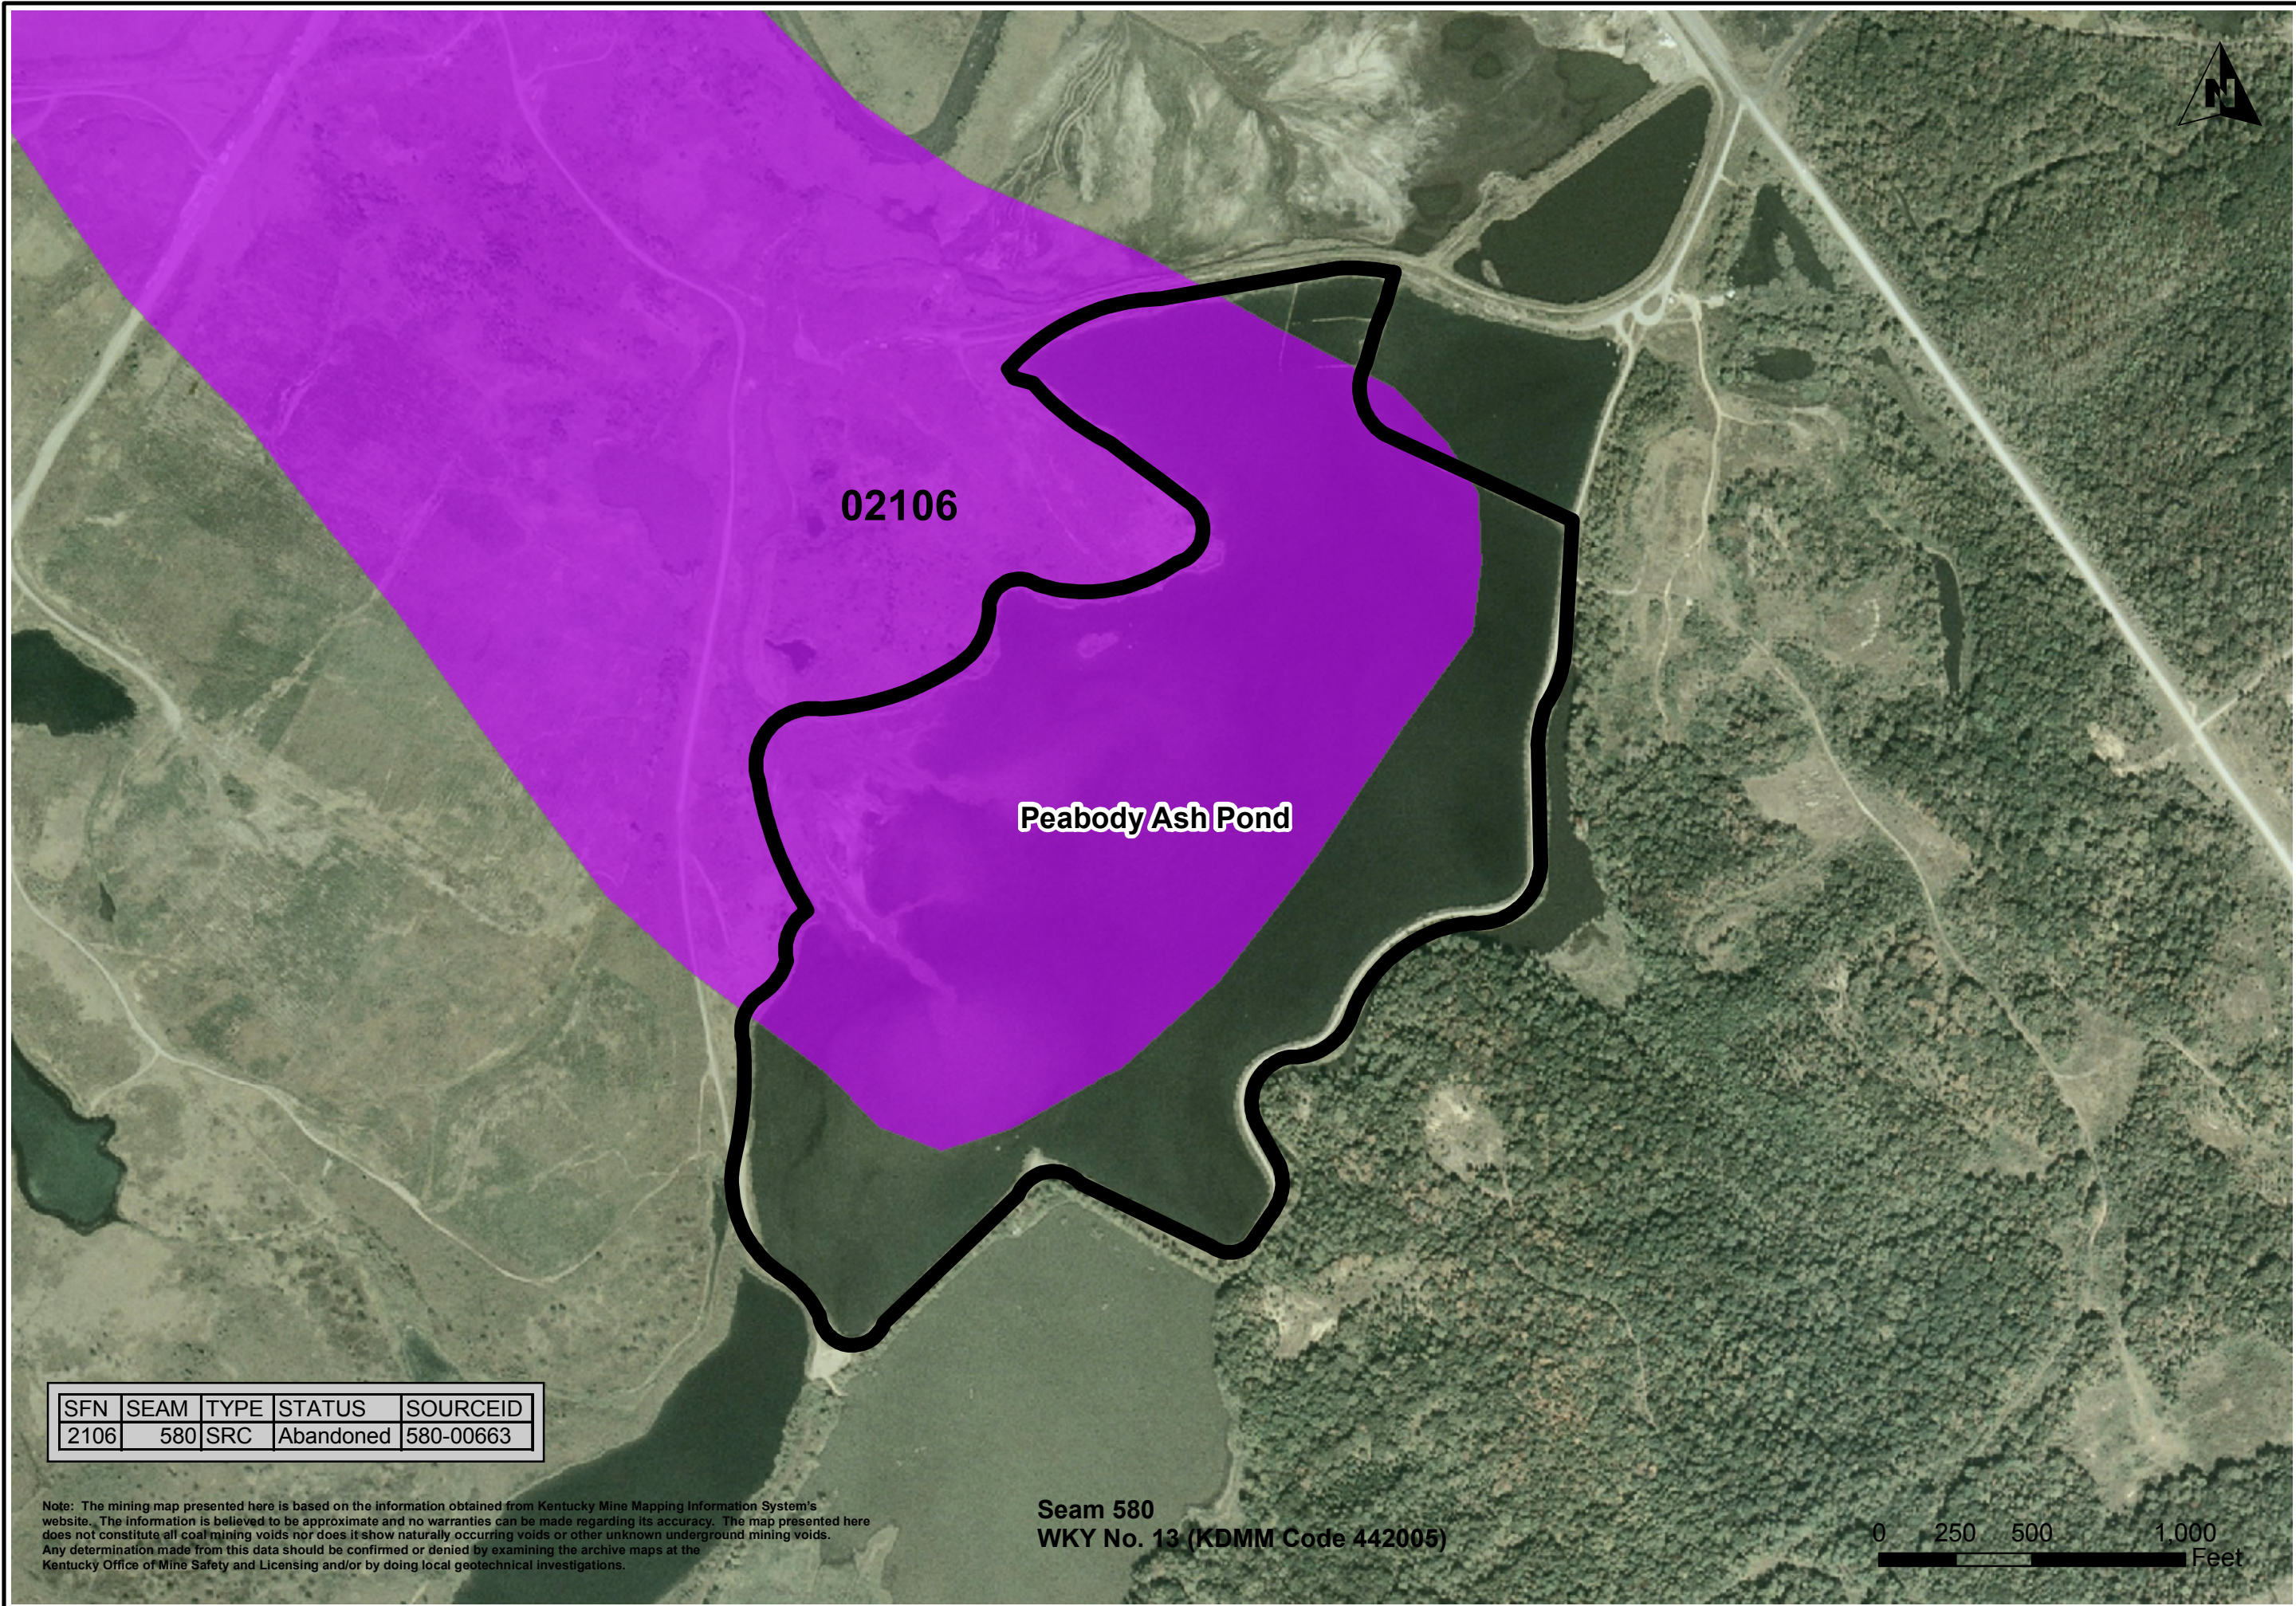

STANTEC  
CONSULTING  
SERVICES INC.  
1409 N. Forbes Rd.  
Lexington, Kentucky  
40511-2050  
859-422-3000



Mine Map  
Phase 2 Assessment  
Peabody Ash Pond  
Paradise Fossil Plant  
Muhlenberg County, Kentucky

PROJECT NO. 175569069  
DATE DECEMBER 2009  
DRAWN BY AMG  
CHECKED BY SV  
SCALE 1" = 500'  
REVISED  
1.  
2.  
3.  
4.  
5.  
6.  
7.  
8.

SFN	SEAM	TYPE	STATUS	SOURCEID
2106	580	SRC	Abandoned	580-00663

Note: The mining map presented here is based on the information obtained from Kentucky Mine Mapping Information System's website. The information is believed to be approximate and no warranties can be made regarding its accuracy. The map presented here does not constitute all coal mining voids nor does it show naturally occurring voids or other unknown underground mining voids. Any determination made from this data should be confirmed or denied by examining the archive maps at the Kentucky Office of Mine Safety and Licensing and/or by doing local geotechnical investigations.

Seam 580  
WKY No. 13 (KDMM Code 442005)



SHEET  
4 OF 4