




# ISO-NE Daily Report

Monday February 01, 2010

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	45.20	43.53	38.74	36.07	44.19	51.05	67.85	77.50	75.55	68.96	64.33	63.35	60.54	56.65	53.82	52.94	60.51	80.38	81.22	75.94	63.88	56.41	49.51	49.04	59.05	65.09	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	44.39	42.42	38.04	35.43	43.40	50.14	66.64	75.86	74.20	67.37	62.38	61.44	59.46	55.64	52.85	52.00	58.47	75.85	76.03	72.46	61.48	55.40	48.62	48.17	57.42	63.09		
<b>New Hampshire</b>	43.83	41.75	37.57	34.98	42.86	49.51	65.81	74.90	73.27	66.51	61.57	60.65	58.71	54.94	52.19	51.34	57.64	74.75	74.87	71.49	60.69	54.71	48.01	47.56	56.67	62.27		
<b>Maine</b>	42.28	40.30	36.24	33.74	41.34	47.76	63.48	70.20	69.06	63.91	59.39	58.50	56.63	53.00	50.35	49.53	58.00	74.01	75.20	68.95	58.53	52.78	46.31	45.88	54.81	60.27		
<b>Mass Hub</b>	44.64	42.83	38.26	35.63	43.65	50.42	67.02	76.26	74.62	67.71	62.64	61.70	59.79	55.96	53.16	52.29	58.69	75.92	76.02	72.63	61.67	55.72	48.90	48.44	57.69	63.36		
<b>Cleared Load (GW)</b>	13.5	13.4	13.5	13.6	13.4	13.4	16.0	16.7	16.8	17.1	17.2	17.0	16.3	16.1	15.8	15.9	16.6	18.4	18.3	18.0	17.1	15.6	14.0	12.9				

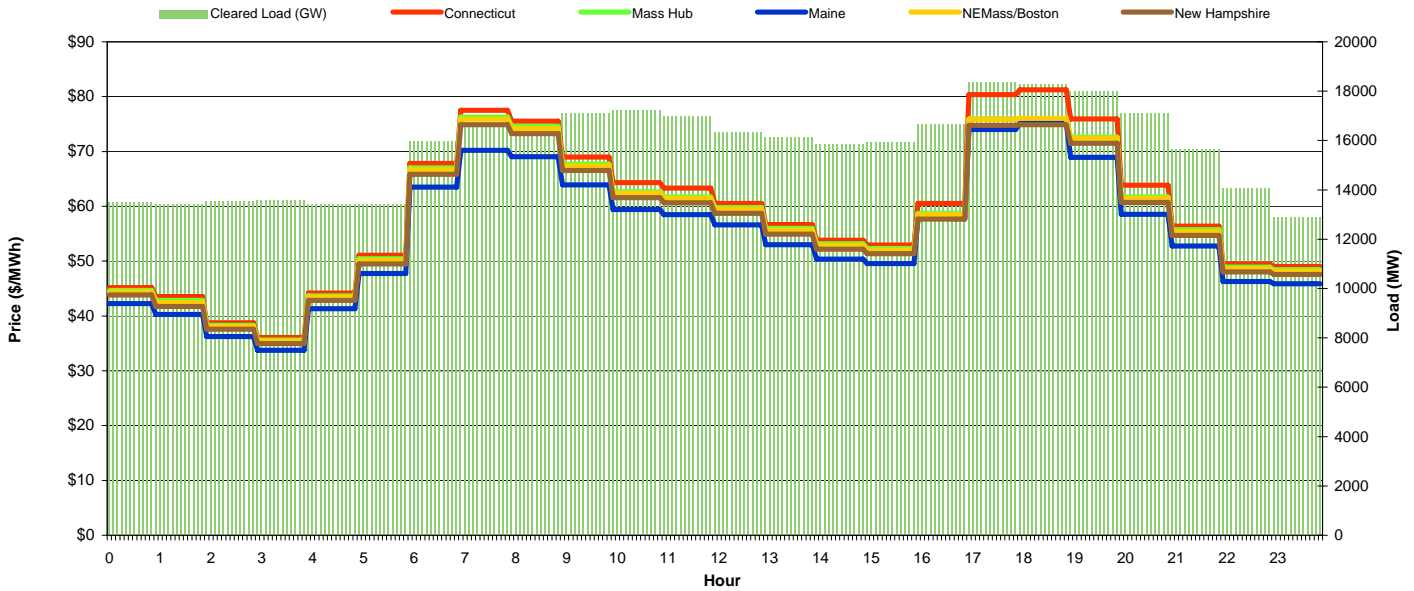

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	31.10	38.79	27.19	27.58	39.47	45.54	65.36	63.15	63.38	63.85	60.26	56.49	51.83	46.53	43.97	31.93	48.82	58.64	64.47	66.70	59.53	53.64	50.79	38.87	49.91	55.25	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	30.18	37.74	26.48	26.91	38.52	44.43	62.78	60.31	60.73	60.74	57.88	54.53	50.25	45.41	42.67	31.15	47.57	56.87	61.66	63.56	57.06	51.99	49.12	37.65	48.17	53.22		
<b>New Hampshire</b>	29.85	37.50	26.30	26.73	38.40	44.32	63.01	60.35	60.78	60.57	57.73	54.27	49.95	45.17	42.48	30.97	47.39	56.47	61.08	63.00	56.83	51.66	48.78	37.28	47.95	52.97		
<b>Maine</b>	28.61	36.35	25.51	25.93	37.61	44.00	61.82	58.95	58.93	58.72	56.28	52.45	48.06	43.50	40.92	29.88	45.81	54.69	58.55	59.87	53.89	49.07	46.28	35.46	48.13	50.99		
<b>Mass Hub</b>	30.44	38.08	26.71	27.13	38.76	44.63	63.37	60.89	61.35	61.48	58.44	54.97	50.59	45.62	42.93	31.26	47.75	57.13	62.15	64.21	57.62	52.35	49.53	37.95	48.56	53.64		
<b>DA Forecast Load (GW)</b>	13.23	12.86	12.75	12.78	13.20	14.42	16.48	17.62	17.86	17.93	17.90	17.71	17.41	17.23	17.02	17.01	17.57	18.99	19.49	19.12	18.37	17.15	15.62	14.20				
<b>Forecast Error %</b>	6.2%	6.0%	4.2%	3.9%	4.8%	7.5%	2.3%	4.7%	4.8%	2.7%	2.0%	2.4%	4.7%	4.7%	4.9%	4.2%	3.3%	2.4%	4.7%	4.1%	5.2%	7.3%	9.7%	10.3%				

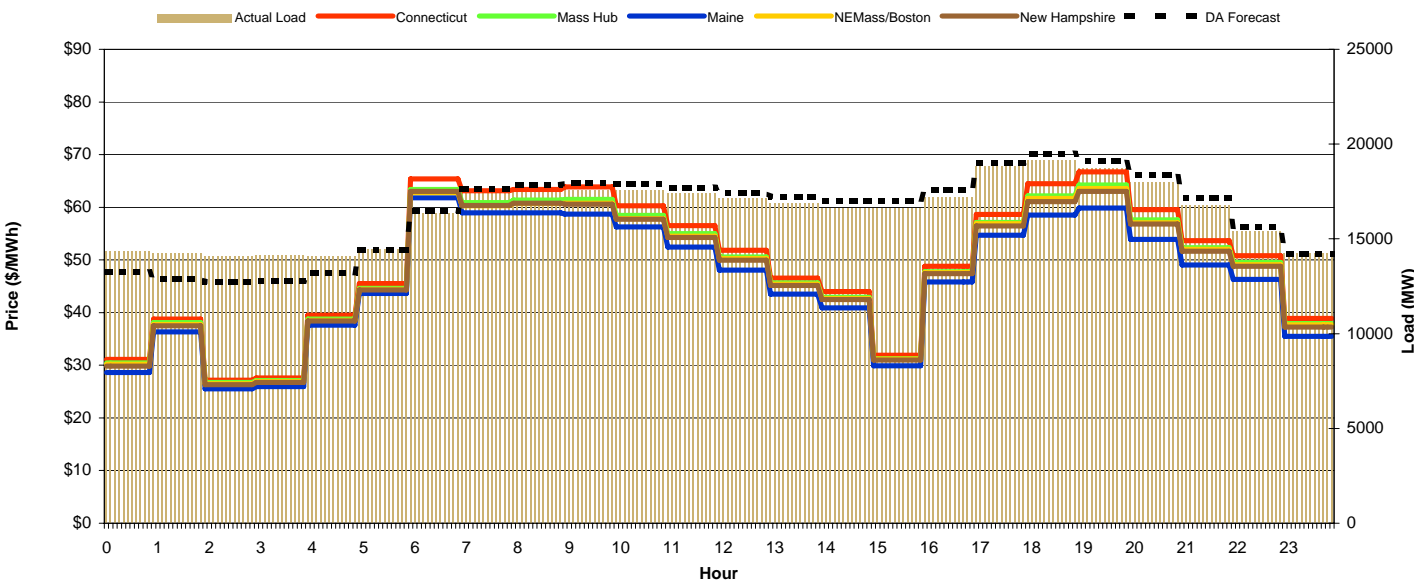




# ISO-NE Daily Report

Tuesday February 02, 2010

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	41.29	35.06	34.81	34.81	43.35	51.70	65.59	65.73	55.49	52.30	54.78	50.26	48.57	47.68	46.48	46.56	54.78	74.09	73.94	65.38	64.26	53.71	48.57	45.42	52.28	56.41	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	40.42	34.32	34.08	34.08	42.44	50.61	64.21	64.36	54.32	51.20	53.63	49.20	47.55	46.68	45.50	45.58	53.63	72.54	72.39	64.00	62.92	52.58	47.55	44.46	51.18	55.23		
<b>New Hampshire</b>	39.92	33.90	33.66	33.66	41.91	49.98	63.41	63.55	53.65	50.57	52.96	48.59	46.96	46.10	44.94	45.02	52.97	71.64	71.49	63.21	62.13	51.93	46.96	43.91	50.54	54.54		
<b>Maine</b>	38.47	32.67	32.43	32.43	40.39	48.17	61.12	60.27	51.70	48.74	51.04	46.83	45.26	44.43	43.31	43.39	51.05	69.04	68.90	60.92	58.72	50.05	45.26	42.32	48.62	52.43		
<b>Mass Hub</b>	40.68	34.54	34.30	34.30	42.71	50.94	64.62	64.77	54.67	51.54	53.97	49.52	47.86	46.98	45.79	45.88	53.98	73.00	72.86	64.42	63.32	52.92	47.86	44.75	51.51	55.58		
<b>Cleared Load (GW)</b>	12.0	12.0	11.9	11.8	12.0	12.6	15.2	16.1	16.3	16.3	16.1	16.1	15.9	15.6	15.3	15.4	16.3	17.6	17.5	17.3	15.9	14.9	13.2	12.3				

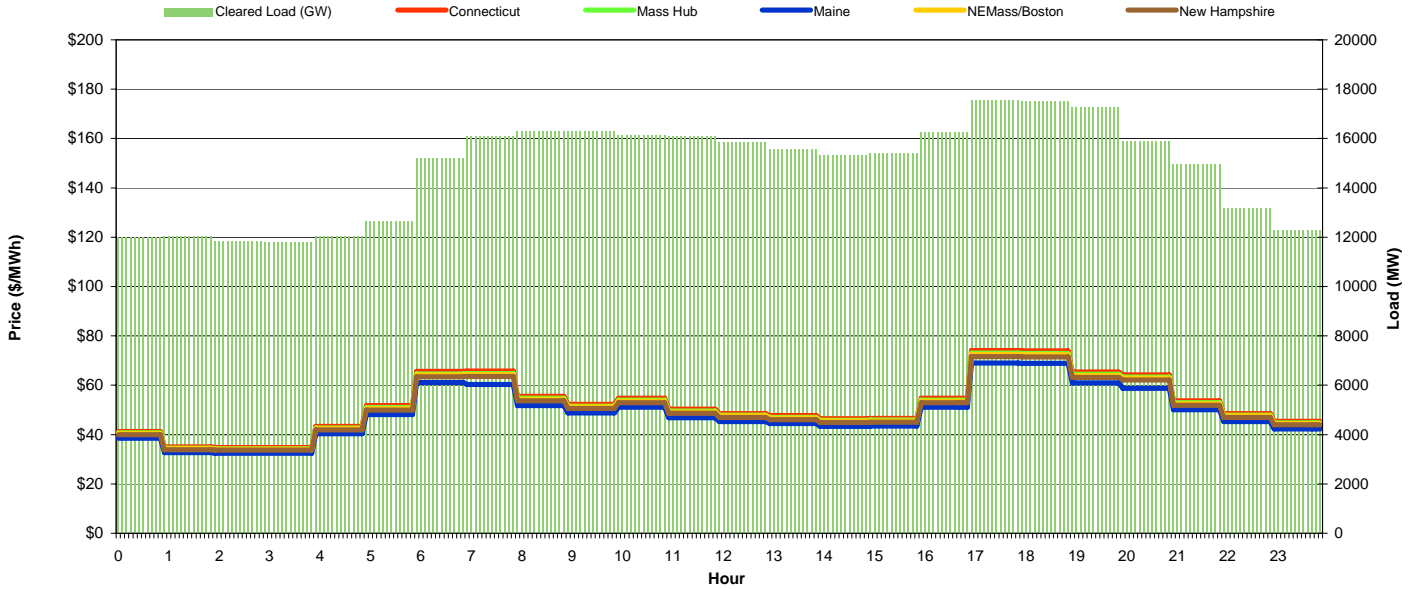

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	39.98	42.92	44.43	43.33	33.63	44.24	61.40	59.37	58.38	56.77	59.82	54.36	53.36	53.82	50.03	56.70	77.18	185.59	61.61	66.25	71.06	62.89	53.67	53.25	60.17	67.55	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	38.94	41.98	43.46	42.39	32.97	43.53	60.35	58.46	57.44	55.72	58.34	53.33	52.36	52.82	49.38	55.88	75.74	183.62	61.34	65.74	69.71	61.58	53.07	52.76	59.20	66.53		
<b>New Hampshire</b>	38.78	41.97	43.51	42.45	32.97	43.51	60.29	58.43	57.41	55.59	58.12	53.13	52.21	52.78	49.40	55.75	75.11	181.60	60.81	65.18	69.15	61.33	52.99	52.78	58.97	66.19		
<b>Maine</b>	37.78	41.57	43.38	42.36	32.74	43.72	60.62	58.66	57.72	56.09	58.81	53.68	52.69	53.16	49.61	56.21	76.18	183.93	61.42	65.91	70.04	62.01	53.33	52.88	59.63	64.59		
<b>Mass Hub</b>	39.19	42.21	43.71	42.64	33.17	43.72	60.62	58.66	57.72	56.09	58.81	53.68	52.69	53.16	49.61	56.21	76.18	183.93	61.42	65.91	70.04	62.01	53.33	52.88	59.48	66.84		
<b>DA Forecast Load (GW)</b>	13.19	12.74	12.66	12.61	13.03	14.23	16.40	17.55	17.71	17.69	17.62	17.44	17.15	17.00	16.78	16.81	17.36	18.80	19.18	18.67	17.92	16.74	15.19	13.81				
<b>Forecast Error %</b>	10.0%	7.1%	7.7%	8.6%	11.5%	11.8%	7.6%	8.6%	7.8%	7.5%	8.4%	7.7%	8.1%	9.3%	9.7%	9.1%	7.1%	7.7%	9.0%	8.2%	13.2%	12.4%	15.6%	13.0%				

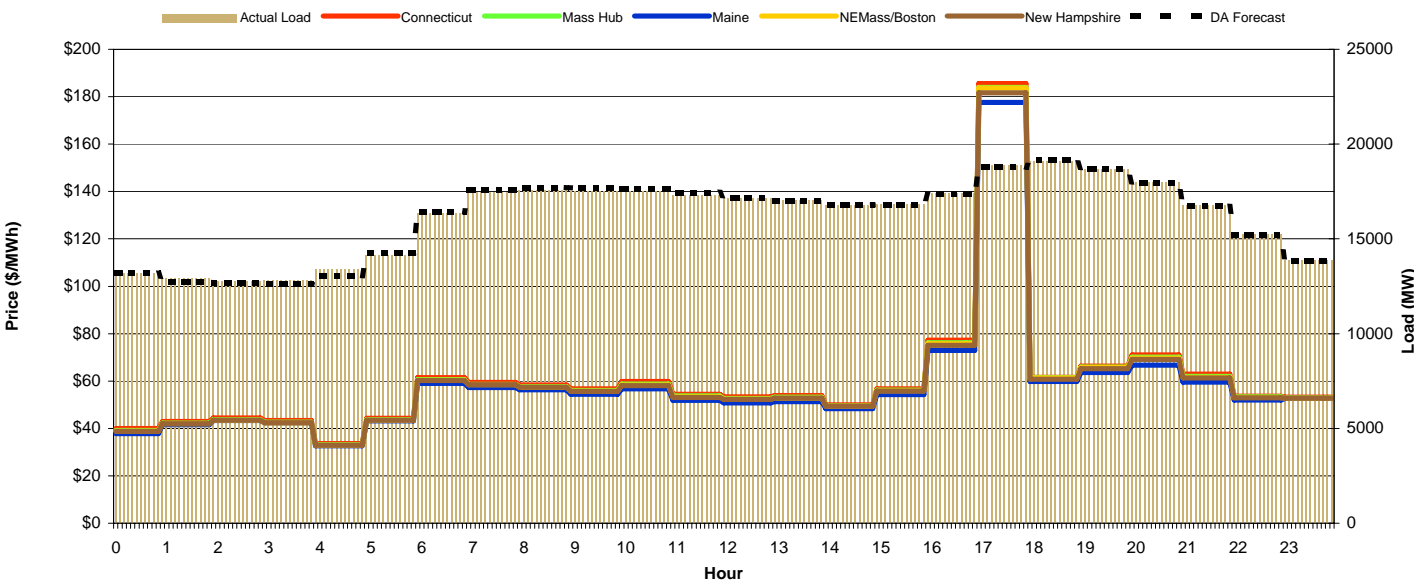




# ISO-NE Daily Report

Wednesday February 03, 2010

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	35.18	38.29	38.29	36.62	35.18	39.21	52.87	59.32	54.93	56.67	57.00	53.47	50.90	49.10	48.03	48.00	51.08	64.24	65.12	59.84	55.04	51.52	46.13	40.00	49.42	54.40	All	On Pk
<b>NEMass/Boston</b>	34.31	37.34	37.34	35.71	34.31	38.24	51.56	57.84	53.56	55.26	55.58	52.14	49.63	47.88	46.83	46.81	49.81	62.64	63.50	58.35	53.67	50.24	44.99	39.01	48.19	53.05	48.91	53.05
<b>New Hampshire</b>	33.92	36.91	36.91	35.30	33.92	37.80	50.97	57.18	52.95	54.62	54.95	51.54	49.06	47.33	46.30	46.27	49.24	61.92	62.77	57.68	53.06	49.66	44.47	38.56	47.64	52.44	48.54	53.43
<b>Maine</b>	32.66	35.55	35.55	34.00	32.66	36.40	49.09	55.07	50.99	52.61	52.92	49.64	47.25	45.59	44.59	44.56	47.42	59.64	60.46	55.55	51.10	47.83	42.83	37.14	45.88	50.50	48.54	53.43
<b>Mass Hub</b>	34.56	37.60	37.60	35.97	34.56	38.51	51.93	58.26	53.95	55.66	55.98	52.51	49.99	48.23	47.17	47.14	50.17	63.09	63.96	58.77	54.06	50.60	45.31	39.29	48.54	53.43	48.54	53.43
<b>Cleared Load (GW)</b>	12.5	12.4	12.4	12.3	12.5	12.8	15.1	15.9	16.2	16.1	16.1	16.1	15.9	15.8	15.5	15.5	16.3	17.8	17.8	17.2	16.4	14.9	13.4	12.6				

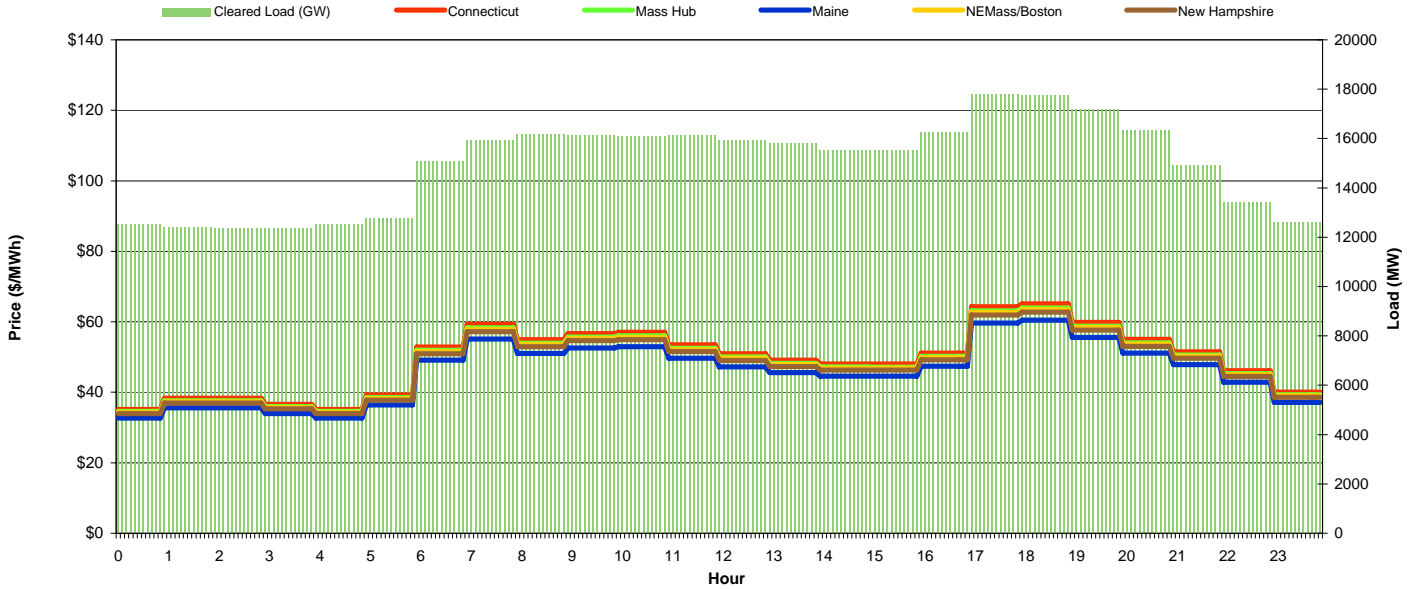

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	45.31	49.14	60.90	80.32	69.70	52.07	84.88	93.32	80.97	106.85	71.41	77.55	56.42	48.56	48.43	49.46	60.11	95.09	67.95	134.48	85.78	49.77	44.77	40.49	68.91	73.18	All	On Pk
<b>NEMass/Boston</b>	44.54	48.31	59.96	78.94	68.66	51.64	84.62	92.49	79.21	104.84	69.75	75.71	54.96	47.48	47.31	48.46	58.65	92.72	66.18	130.07	82.69	48.35	43.90	39.99	67.48	71.42	67.48	71.42
<b>New Hampshire</b>	44.45	48.34	60.13	79.09	68.75	51.57	84.29	91.83	78.70	104.00	69.06	74.83	54.31	47.05	46.90	47.94	57.93	91.10	65.11	128.11	81.69	47.91	43.47	39.53	66.92	70.62	66.92	70.62
<b>Maine</b>	44.08	48.15	60.18	79.28	68.99	88.00	83.05	89.78	77.03	101.92	67.20	72.42	52.05	45.06	44.93	45.80	55.20	87.50	62.57	122.14	78.11	45.64	41.74	38.53	66.64	68.07	66.64	68.07
<b>Mass Hub</b>	44.77	48.67	60.45	79.62	69.27	51.93	84.76	92.70	79.71	105.46	70.28	76.34	55.45	47.85	47.68	48.77	59.10	93.33	66.72	131.44	83.66	48.84	44.22	40.18	67.97	71.97	67.97	71.97
<b>DA Forecast Load (GW)</b>	12.90	12.38	12.22	12.20	12.56	13.74	15.87	17.04	17.21	17.24	17.27	17.12	16.83	16.73	16.49	16.49	16.99	18.36	18.75	18.33	17.53	16.39	14.92	13.64				
<b>Forecast Error %</b>	5.8%	7.1%	7.9%	7.1%	8.1%	9.6%	5.0%	7.0%	7.1%	7.3%	7.1%	6.0%	6.2%	6.2%	7.4%	7.9%	6.8%	4.9%	6.0%	7.2%	8.4%	11.2%	12.4%	9.5%				

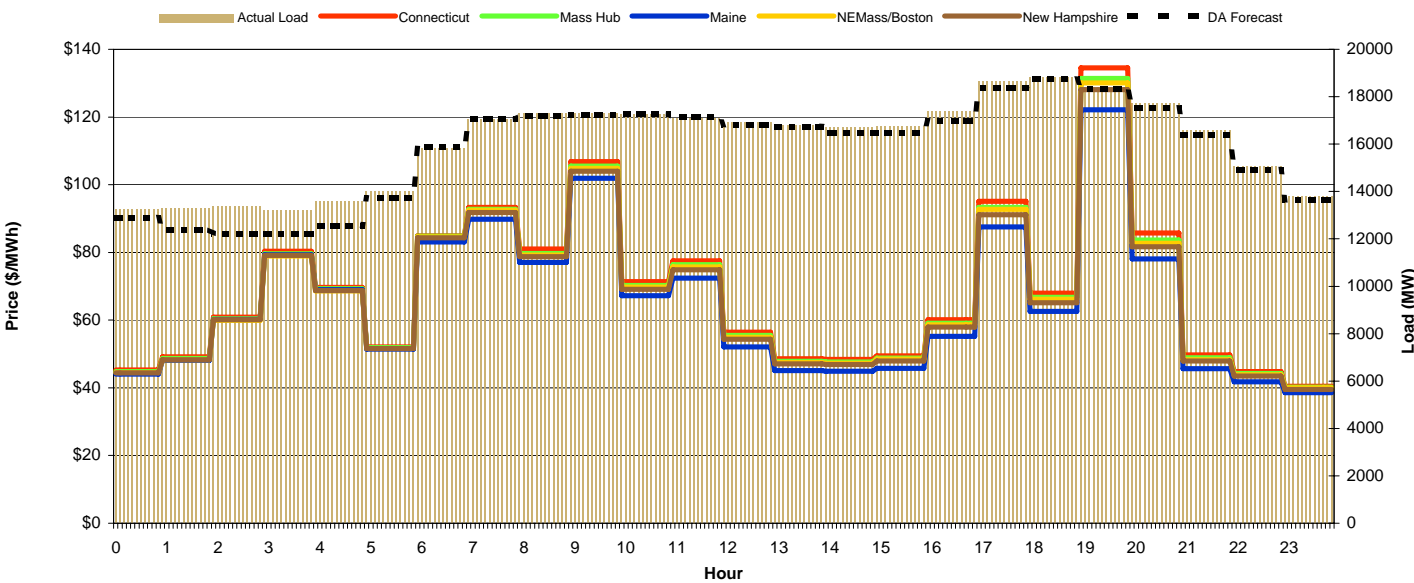




# ISO-NE Daily Report

Thursday February 04, 2010

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	46.95	47.57	46.85	46.55	47.56	48.43	63.97	69.70	68.00	71.92	70.85	66.63	61.80	56.72	52.20	53.10	59.53	81.50	78.67	75.66	68.73	56.04	52.44	51.79	60.13	65.22	All	On Pk
<b>NEMass/Boston</b>	45.72	46.32	45.62	45.33	46.32	47.13	62.29	67.87	66.22	70.03	68.99	64.88	60.17	55.23	50.83	51.71	57.97	79.36	76.60	73.67	66.92	54.57	51.06	50.43	58.55	63.51		
<b>New Hampshire</b>	45.26	45.86	45.17	44.88	45.85	46.65	61.67	67.20	65.56	69.34	68.30	64.24	59.57	54.68	50.32	51.19	57.39	78.57	75.84	72.94	66.26	54.03	50.55	49.92	57.97	62.87		
<b>Maine</b>	43.74	44.32	43.65	43.37	44.31	56.06	59.60	64.93	63.35	67.00	66.00	62.07	57.57	52.84	48.63	49.47	55.46	75.92	73.29	70.48	64.02	52.20	48.85	48.24	56.47	60.76		
<b>Mass Hub</b>	46.08	46.69	45.99	45.70	46.69	47.52	62.79	68.42	66.75	70.60	69.54	65.40	60.66	55.67	51.24	52.13	58.44	80.00	77.22	74.26	67.46	55.01	51.47	50.83	59.02	64.02		
<b>Cleared Load (GW)</b>	12.3	12.6	12.5	12.4	12.8	12.9	15.2	15.8	16.3	16.2	16.2	16.1	15.7	15.8	15.5	15.5	16.2	17.6	17.6	17.0	16.5	15.4	13.8	12.9				

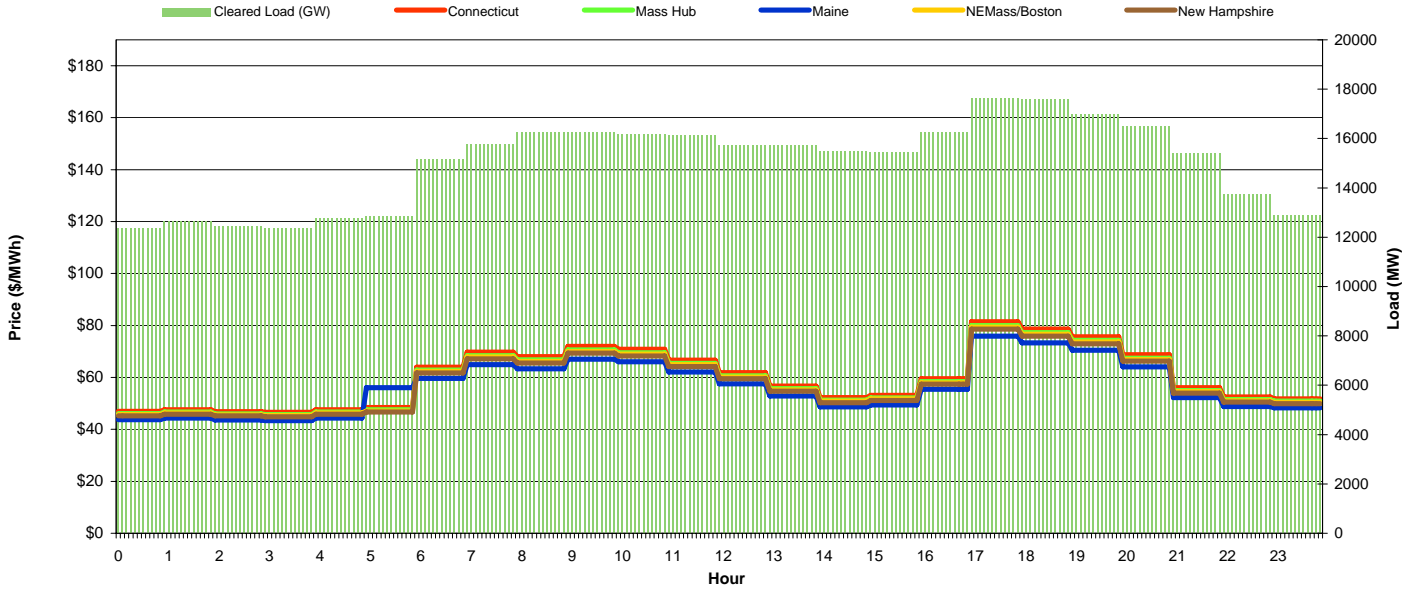

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	46.07	46.21	45.32	45.34	46.68	48.26	69.13	68.47	95.87	94.82	91.83	82.74	57.51	52.23	51.98	56.97	74.23	153.43	91.86	184.32	97.90	52.39	45.88	42.84	72.60	84.53	All	On Pk
<b>NEMass/Boston</b>	45.43	45.34	44.46	44.69	46.36	47.66	68.18	67.26	93.03	91.57	88.86	80.10	55.68	50.76	50.65	55.52	72.40	150.47	90.28	179.98	95.39	50.93	44.88	42.23	70.92	82.36		
<b>New Hampshire</b>	44.98	44.91	44.02	44.29	46.02	47.29	67.55	66.37	91.83	90.24	87.53	78.94	55.00	50.15	50.15	54.90	71.47	147.55	88.60	177.25	94.26	50.50	44.39	41.53	69.99	81.20		
<b>Maine</b>	44.32	44.43	43.73	44.11	46.13	88.00	66.79	65.35	90.16	85.64	79.17	72.14	53.29	48.39	48.54	53.15	65.99	142.28	85.24	170.46	90.56	48.94	42.81	40.31	69.16	77.63		
<b>Mass Hub</b>	45.79	45.86	44.96	45.16	46.76	48.09	68.51	67.55	93.93	92.61	89.80	80.94	56.28	51.24	51.08	55.97	72.93	150.94	90.56	181.29	96.23	51.40	45.22	42.44	71.48	83.00		
<b>DA Forecast Load (GW)</b>	12.81	12.37	12.22	12.25	12.65	13.82	15.92	17.05	17.22	17.23	17.22	17.10	16.84	16.67	16.46	16.46	17.06	18.53	18.90	18.52	17.88	16.81	15.36	14.04				
<b>Forecast Error %</b>	10.4%	9.3%	9.6%	10.8%	10.0%	13.8%	6.0%	9.0%	6.4%	6.6%	6.8%	6.2%	7.3%	5.9%	6.3%	6.1%	4.2%	4.8%	7.4%	9.0%	8.8%	9.2%	11.5%	10.7%				

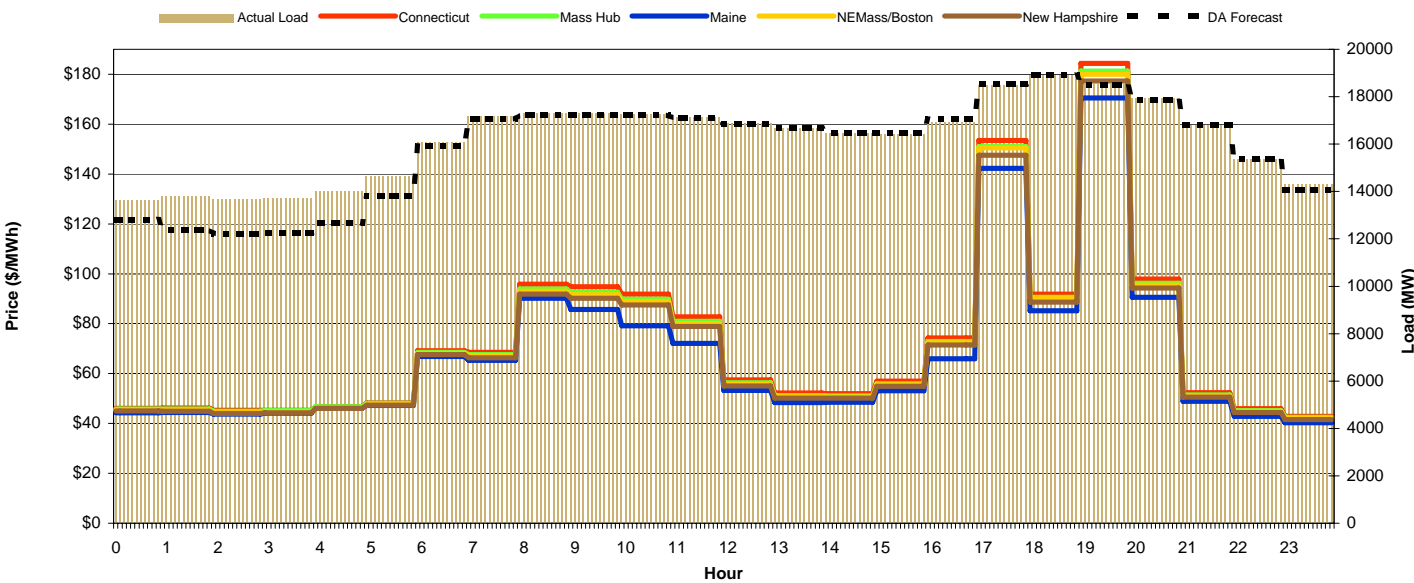




# ISO-NE Daily Report

Friday February 05, 2010

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$				
<b>Connecticut</b>	46.23	46.58	46.20	46.01	46.23	52.33	68.96	81.31	75.75	66.77	64.65	62.85	57.02	55.50	54.17	54.29	61.25	78.84	80.34	69.52	59.88	60.00	56.57	48.22	45.36	54.54	58.41	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	44.96	45.30	44.93	44.75	44.96	50.89	67.07	79.09	73.67	64.93	62.87	61.12	55.45	53.98	52.68	52.80	59.56	76.67	78.13	67.61	58.23	58.35	55.01	46.89	58.33	63.13			
<b>New Hampshire</b>	44.53	44.86	44.50	44.32	44.53	50.40	66.43	78.32	72.96	64.31	62.27	60.54	54.92	53.46	52.17	52.29	58.99	75.93	77.38	66.97	57.68	57.79	54.48	46.44	57.77	62.53			
<b>Maine</b>	43.08	43.41	43.06	42.88	43.08	50.00	64.27	73.26	69.00	62.23	60.25	58.57	53.14	51.73	50.48	50.60	57.08	73.09	73.91	64.79	55.81	55.92	52.72	44.93	55.72	60.16			
<b>Mass Hub</b>	45.34	45.67	45.31	45.12	45.33	51.31	67.63	79.75	74.29	65.48	63.40	61.63	55.91	54.43	53.12	53.24	60.06	77.31	78.79	68.18	58.72	58.84	55.47	47.28	58.82	63.66			
<b>Cleared Load (GW)</b>	12.9	12.9	13.0	13.0	13.1	13.2	15.2	15.7	16.0	16.4	16.3	16.2	15.6	15.1	14.7	14.8	15.9	17.1	16.8	16.3	15.9	14.5	13.3	12.6					

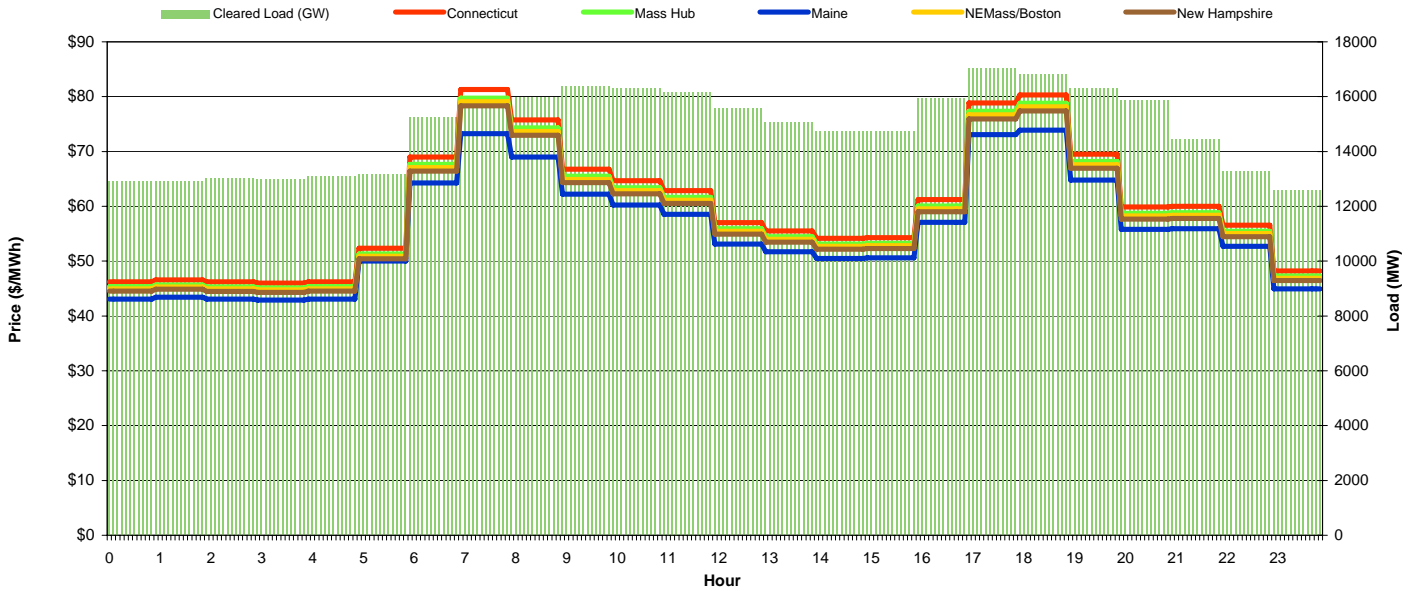

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	46.75	33.65	34.26	49.15	47.55	47.95	69.63	79.02	68.32	65.34	59.37	55.37	53.61	54.35	52.65	53.03	55.42	60.51	58.43	55.39	54.26	56.04	53.49	45.36	54.54	58.41	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	46.17	33.25	34.02	48.70	47.09	47.61	68.79	77.12	66.08	63.03	57.39	53.76	52.21	52.67	51.15	51.45	53.73	58.65	56.54	53.66	52.86	54.60	52.66	44.87	53.25	56.72		
<b>New Hampshire</b>	45.57	32.95	33.68	48.34	46.82	47.35	68.18	76.00	65.20	62.25	56.68	53.20	51.59	52.09	50.53	50.90	53.11	57.94	55.85	53.15	52.50	54.40	52.09	44.35	52.70	56.09		
<b>Maine</b>	44.39	32.23	33.01	47.58	46.50	88.00	67.21	74.43	63.88	60.92	55.32	51.67	50.04	50.60	49.16	49.49	51.68	56.55	54.04	51.45	50.80	53.20	50.82	43.75	53.20	54.63		
<b>Mass Hub</b>	46.52	33.53	34.26	49.07	47.48	47.84	68.94	77.43	66.55	63.58	57.90	54.18	52.54	53.09	51.50	51.83	54.15	59.05	56.94	54.02	53.16	55.02	52.92	45.03	53.61	57.12		
<b>DA Forecast Load (GW)</b>	13.18	12.72	12.54	12.54	12.90	14.00	16.08	17.20	17.34	17.33	17.24	17.03	16.78	16.51	16.28	16.22	16.79	17.94	18.13	17.71	17.12	16.25	15.13	13.91				
<b>Forecast Error %</b>	10.5%	10.9%	8.5%	9.1%	10.7%	14.3%	6.2%	10.0%	9.1%	5.7%	5.5%	5.0%	7.1%	9.3%	10.4%	10.3%	5.2%	5.1%	6.9%	7.0%	6.3%	10.7%	11.6%	10.1%				

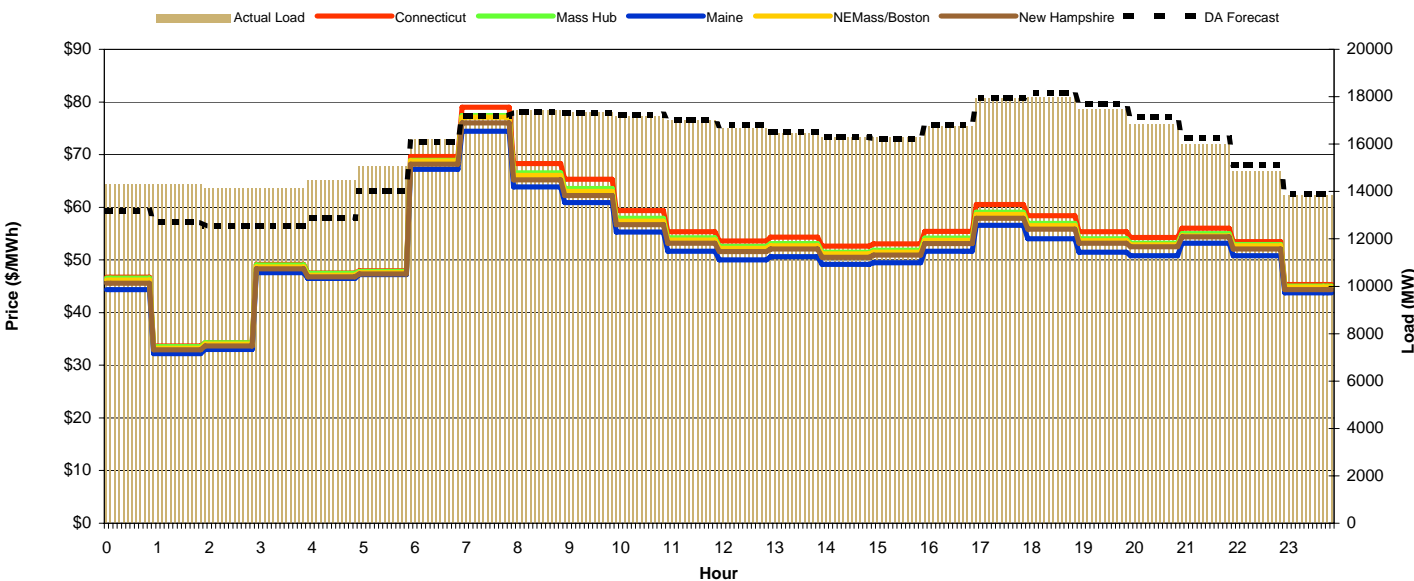




# ISO-NE Daily Report

Saturday February 06, 2010

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	55.00	58.13	52.31	50.63	52.24	48.23	52.31	62.35	70.15	76.31	81.18	79.47	72.66	69.36	66.38	67.32	80.73	96.77	98.24	86.98	75.00	72.09	67.40	68.38	69.15	76.40	All	On Pk
<b>NEMass/Boston</b>	53.47	56.51	50.85	49.23	50.80	46.90	50.86	60.62	68.20	74.19	78.93	77.27	70.64	67.44	64.54	65.45	78.49	92.47	93.94	83.24	71.97	70.09	65.53	66.49	67.01	73.94		
<b>New Hampshire</b>	53.01	56.02	50.41	48.80	50.35	46.49	50.42	60.10	67.61	73.55	78.25	76.59	70.03	66.85	63.98	64.88	77.81	91.76	93.22	82.60	71.40	69.48	64.96	65.91	66.44	73.32		
<b>Maine</b>	51.37	54.29	48.85	47.29	48.80	45.05	48.86	58.24	65.52	71.28	75.83	74.23	67.86	64.79	62.00	62.88	75.40	88.87	90.28	80.00	69.17	67.33	62.95	63.87	64.38	71.04		
<b>Mass Hub</b>	53.92	56.98	51.28	49.64	51.22	47.29	51.28	61.13	68.77	74.81	79.59	77.91	71.23	68.00	65.08	66.00	79.15	93.45	94.93	84.11	72.70	70.68	66.07	67.04	67.59	74.60		
<b>Cleared Load (GW)</b>	12.7	13.0	12.9	12.8	12.9	13.1	13.4	14.0	15.3	15.8	15.4	15.2	14.9	14.7	14.6	14.5	15.0	16.9	16.8	16.3	15.8	14.7	13.7	12.6				

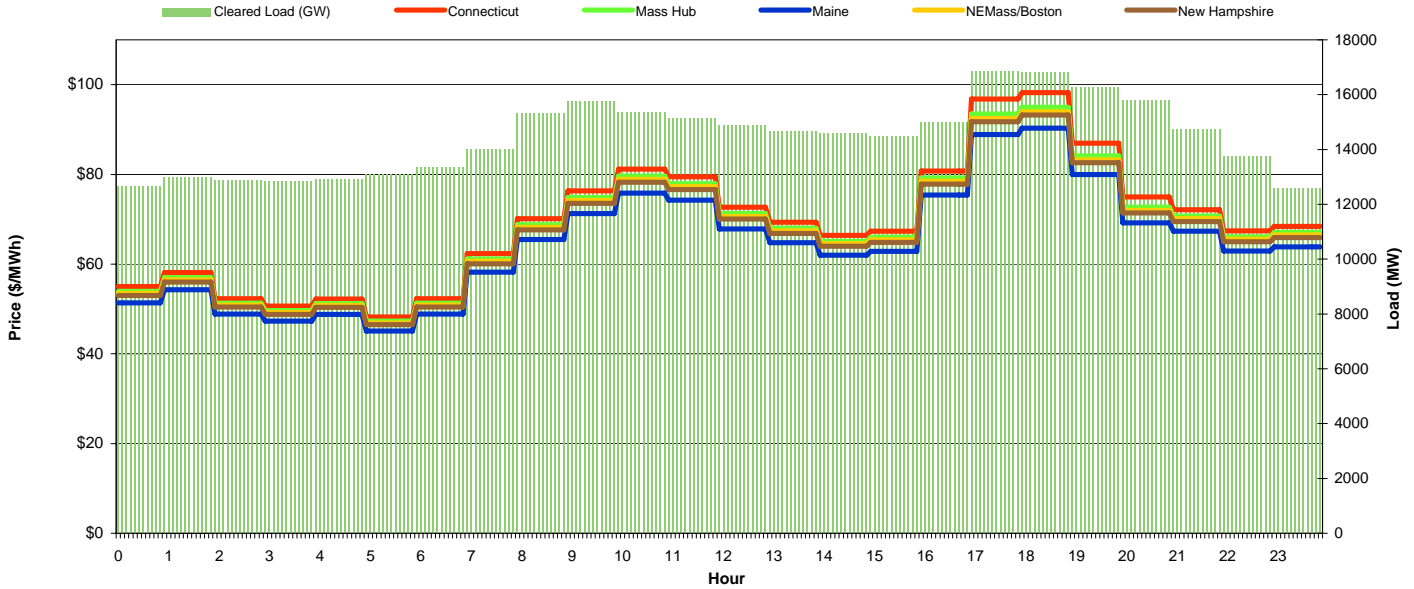

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	54.54	57.18	48.88	52.11	50.03	51.77	53.44	63.26	76.54	95.08	93.29	87.72	85.56	70.72	67.31	74.25	93.77	90.52	76.53	95.47	75.97	70.67	80.55	93.20	73.27	81.08	All	On Pk
<b>NEMass/Boston</b>	54.14	56.78	48.48	51.83	49.89	51.60	53.16	62.69	75.00	92.66	90.90	85.49	83.16	68.75	65.84	72.01	90.76	88.62	75.08	92.93	73.70	68.59	78.36	90.73	71.71	79.02		
<b>New Hampshire</b>	53.67	56.46	48.21	51.58	49.69	51.34	52.80	62.33	74.54	91.85	89.70	84.42	82.04	67.85	64.66	70.97	89.30	87.13	73.83	91.47	72.62	67.46	76.77	88.81	70.81	77.93		
<b>Maine</b>	52.72	55.65	47.48	50.85	49.21	88.00	51.54	61.16	72.44	88.60	86.41	81.07	78.26	64.79	61.87	67.67	85.17	84.27	71.28	87.84	69.46	63.90	72.61	85.32	69.90	74.80		
<b>Mass Hub</b>	54.35	57.09	48.79	52.16	50.16	51.76	53.25	62.77	75.29	93.18	91.36	85.86	83.56	69.07	65.86	72.39	91.24	88.56	75.01	93.12	73.89	68.87	78.77	91.13	71.98	79.30		
<b>DA Forecast Load (GW)</b>	13.08	12.61	12.35	12.27	12.43	12.94	13.85	14.75	15.71	16.32	16.52	16.43	16.16	15.85	15.54	15.57	16.12	17.39	17.76	17.34	16.83	16.04	15.10	14.05				
<b>Forecast Error %</b>	6.4%	4.9%	4.1%	5.9%	6.3%	2.8%	3.1%	3.1%	1.8%	4.4%	9.4%	10.8%	11.1%	10.8%	9.9%	10.6%	10.1%	5.4%	6.6%	7.4%	7.2%	10.0%	11.2%	13.2%				

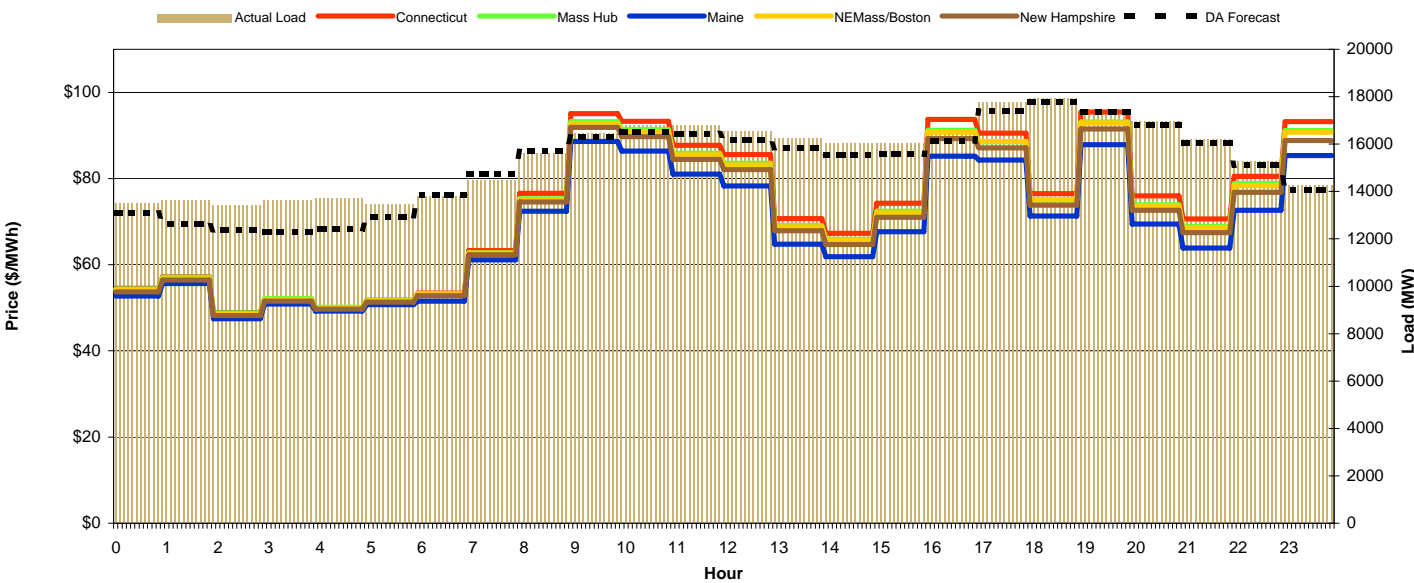




# ISO-NE Daily Report

Sunday February 07, 2010

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	66.79	59.15	58.68	58.68	58.68	59.67	62.14	66.55	69.22	70.20	71.69	71.43	71.01	66.11	62.95	64.01	77.76	95.57	99.09	92.56	82.23	71.78	69.22	61.95	70.30	75.09	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	65.00	57.56	57.10	57.10	57.10	58.07	60.48	64.76	67.37	68.31	69.76	69.51	69.11	64.33	61.26	62.29	75.67	93.00	95.49	89.64	80.02	69.85	67.36	60.29	68.35	72.98		
<b>New Hampshire</b>	64.49	57.11	56.65	56.65	56.65	57.61	60.00	64.26	66.84	67.78	69.21	68.97	68.56	63.83	60.78	61.80	75.07	92.27	94.79	88.96	79.39	69.30	66.83	59.82	67.82	72.42		
<b>Maine</b>	62.64	55.47	55.03	55.03	55.03	55.96	58.28	62.41	64.92	65.84	67.23	66.99	66.60	62.00	59.03	60.03	72.92	89.63	92.04	86.40	77.11	67.31	64.92	58.10	65.87	70.34		
<b>Mass Hub</b>	65.50	58.00	57.54	57.54	57.54	58.51	60.94	65.26	67.88	68.84	70.30	70.05	69.64	64.83	61.73	62.76	76.25	93.71	96.34	90.38	80.63	70.38	67.88	60.75	68.88	73.55		
<b>Cleared Load (GW)</b>	12.3	12.4	12.5	12.5	12.5	12.4	12.6	13.2	14.2	14.9	15.0	15.0	14.8	14.6	14.3	14.5	15.5	17.1	17.0	16.5	15.9	15.0	13.5	12.7				

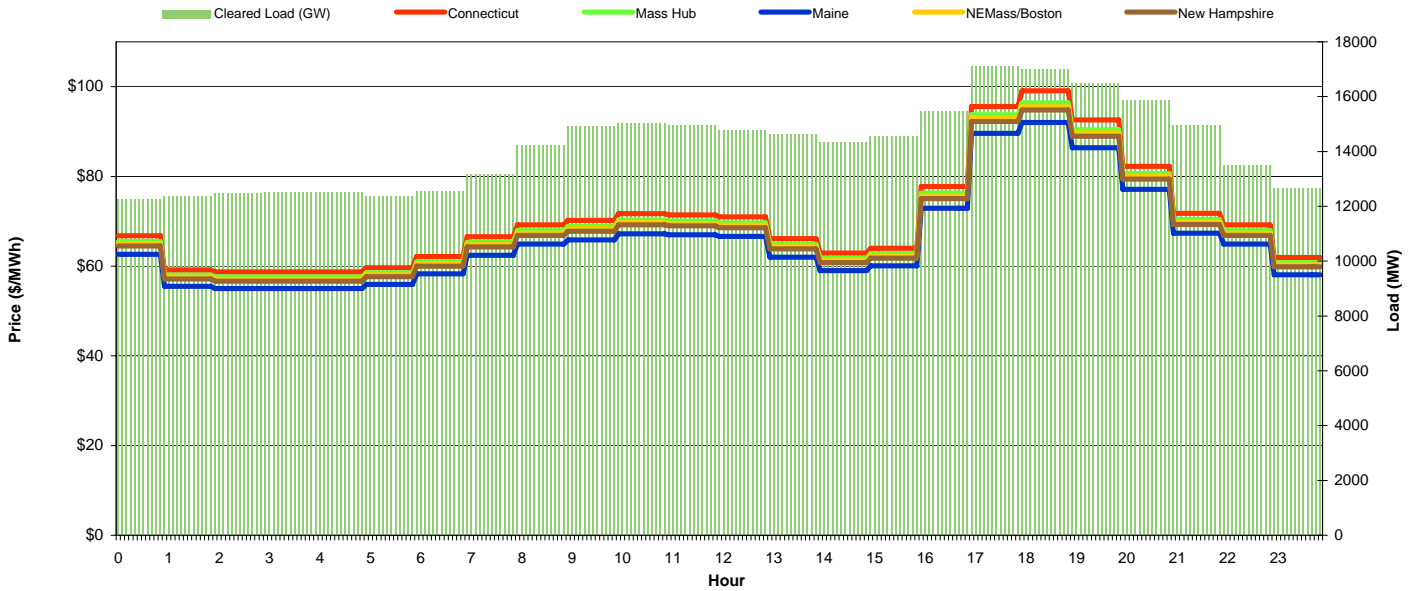

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	65.67	59.91	58.35	66.01	62.67	59.71	61.39	59.86	67.88	69.00	73.73	81.99	71.82	64.33	62.45	63.31	72.13	102.91	86.77	80.67	81.16	67.12	62.77	68.95	69.61	72.99	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	64.44	58.80	57.14	64.49	61.18	58.40	59.84	58.18	65.72	66.77	71.33	79.25	69.57	62.55	60.61	61.52	70.02	100.05	84.58	78.53	78.54	64.89	61.20	67.49	67.71	70.83		
<b>New Hampshire</b>	63.39	58.03	56.47	63.73	60.47	57.69	59.08	57.48	65.10	65.98	70.46	78.29	68.80	61.71	59.83	60.83	69.37	98.54	83.18	77.34	77.50	63.94	60.14	66.40	66.82	69.91		
<b>Maine</b>	61.34	56.26	54.77	61.86	58.57	88.00	56.68	55.32	62.71	63.45	67.42	74.25	65.34	58.53	56.81	58.09	66.39	94.27	79.52	73.83	73.39	60.36	57.16	63.78	65.34	66.68		
<b>Mass Hub</b>	64.65	59.05	57.50	64.92	61.61	58.80	60.26	58.57	66.20	67.22	71.83	79.83	70.02	62.86	60.85	61.74	70.31	100.16	84.58	78.64	78.84	65.26	61.46	67.78	68.04	71.15		
<b>DA Forecast Load (GW)</b>	13.47	13.01	12.77	12.70	12.79	13.09	13.72	14.36	15.22	15.76	15.99	16.04	15.90	15.61	15.41	15.50	16.22	18.05	18.24	17.87	17.28	16.30	15.06	13.89				
<b>Forecast Error %</b>	13.0%	9.7%	8.9%	7.8%	8.2%	11.7%	13.0%	10.7%	8.4%	6.2%	6.9%	8.1%	8.7%	7.8%	8.7%	7.1%	4.5%	3.4%	6.0%	4.8%	5.6%	6.4%	11.1%	12.5%				

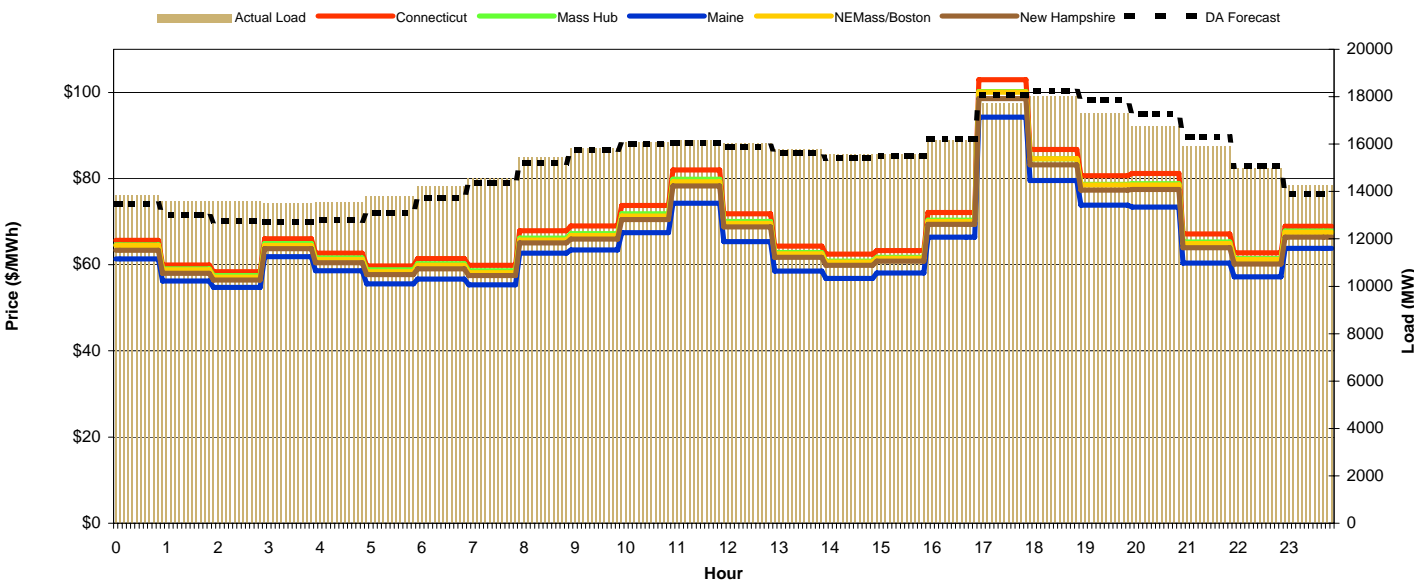




# ISO-NE Daily Report

Monday February 08, 2010

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	61.04	53.20	55.85	53.94	59.10	68.26	90.40	82.00	82.00	77.76	75.47	74.85	67.73	63.54	60.49	62.81	68.86	100.13	100.07	90.00	76.39	67.66	65.01	63.00	63.00	All	On Pk	
<b>NEMass/Boston</b>	59.53	51.88	54.46	52.60	57.63	66.56	88.15	79.96	79.96	75.83	73.60	72.98	66.04	61.96	58.98	61.25	67.14	90.51	89.01	87.25	74.49	65.38	63.31	61.43	69.16	72.98	71.65	75.92
<b>New Hampshire</b>	59.04	51.46	54.02	52.17	57.16	66.01	87.43	79.31	79.31	75.21	73.00	72.39	65.50	61.46	58.50	60.75	66.59	89.76	88.27	86.53	73.88	64.84	62.79	60.93	68.60	72.38	68.60	72.38
<b>Maine</b>	57.40	50.02	52.51	50.72	55.57	64.18	85.00	77.10	77.10	73.11	70.96	70.37	63.68	59.74	56.87	59.06	64.74	87.21	85.76	84.12	71.82	63.03	61.04	59.23	66.68	70.36	66.68	70.36
<b>Mass Hub</b>	59.93	52.23	54.83	52.96	58.02	67.01	88.75	80.50	80.50	76.34	74.10	73.48	66.49	62.38	59.38	61.66	67.60	91.14	89.63	87.84	74.99	65.76	63.72	61.85	69.63	73.47	69.63	73.47
<b>Cleared Load (GW)</b>	12.3	12.7	12.6	12.7	12.6	13.1	14.9	16.4	16.5	16.8	16.9	16.5	16.1	15.9	15.5	15.4	16.5	18.2	18.1	17.6	16.9	15.5	13.6	12.5				

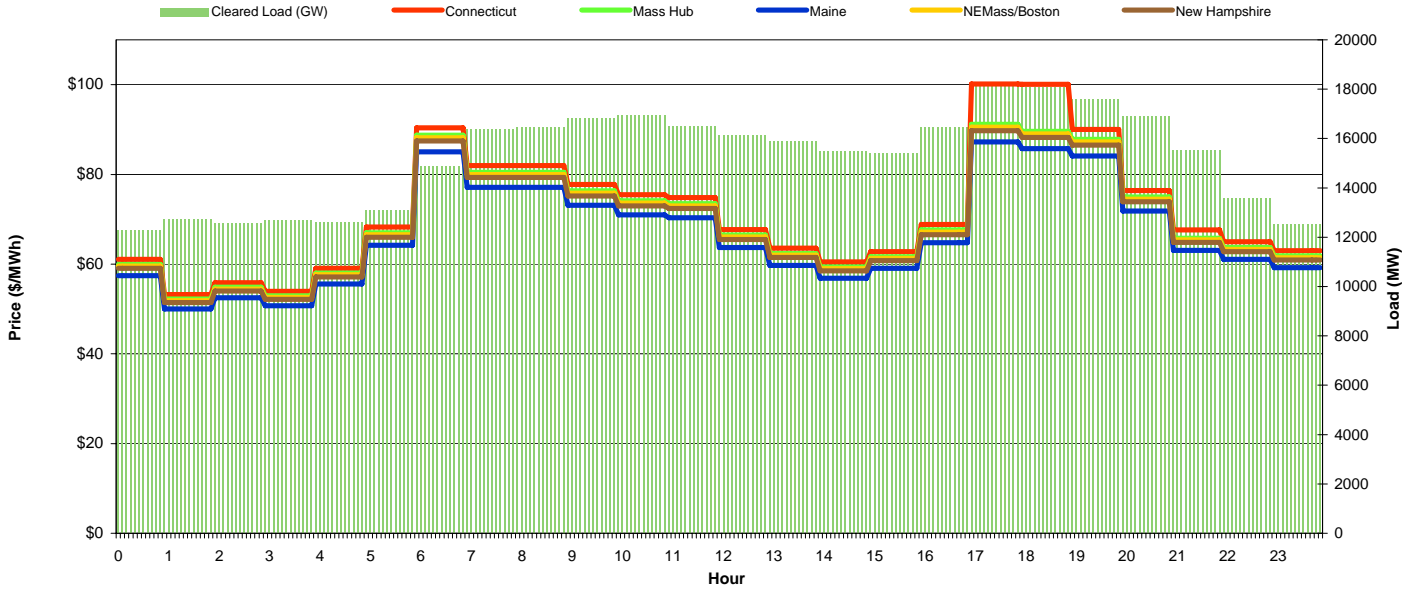

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	68.65	48.07	49.08	44.71	45.79	53.30	68.33	74.11	71.21	69.87	68.20	66.08	63.51	61.09	54.73	57.42	63.94	90.22	80.92	84.83	80.86	66.23	48.40	50.75	63.76	68.85	All	On Pk
<b>NEMass/Boston</b>	66.56	46.56	47.38	43.07	44.14	51.03	65.85	70.66	67.34	65.68	64.77	62.82	60.53	58.40	52.59	55.27	61.50	85.98	77.26	80.51	76.30	62.80	46.05	48.63	60.90	65.53	60.90	65.53
<b>New Hampshire</b>	65.60	46.00	46.85	42.59	43.62	50.55	65.63	70.49	67.04	65.29	64.35	62.28	59.97	57.85	52.07	54.66	61.03	84.95	76.25	79.51	75.49	62.10	45.46	48.26	60.33	64.92	60.33	64.92
<b>Maine</b>	62.94	44.15	45.01	40.93	42.03	88.00	64.17	68.77	64.45	63.04	62.27	59.46	57.33	55.50	50.19	52.89	59.33	82.40	73.71	76.13	71.77	59.07	43.03	45.91	59.69	62.46	59.69	62.46
<b>Mass Hub</b>	67.09	47.01	47.91	43.56	44.67	51.63	66.21	71.21	68.12	66.58	65.46	63.49	61.14	58.91	52.97	55.63	61.96	86.73	77.85	81.36	77.32	63.55	46.52	49.07	61.50	66.18	61.50	66.18
<b>DA Forecast Load (GW)</b>	13.19	12.79	12.63	12.70	13.13	14.33	16.47	17.67	17.89	17.85	17.83	17.64	17.38	17.16	16.88	16.92	17.55	19.14	19.47	19.05	18.29	17.08	15.59	14.23				
<b>Forecast Error %</b>	12.4%	7.7%	9.2%	8.5%	14.0%	13.9%	7.9%	5.7%	6.4%	4.4%	3.8%	5.7%	6.4%	6.9%	8.4%	8.9%	4.9%	2.9%	6.2%	6.7%	7.0%	8.9%	13.4%	12.0%				

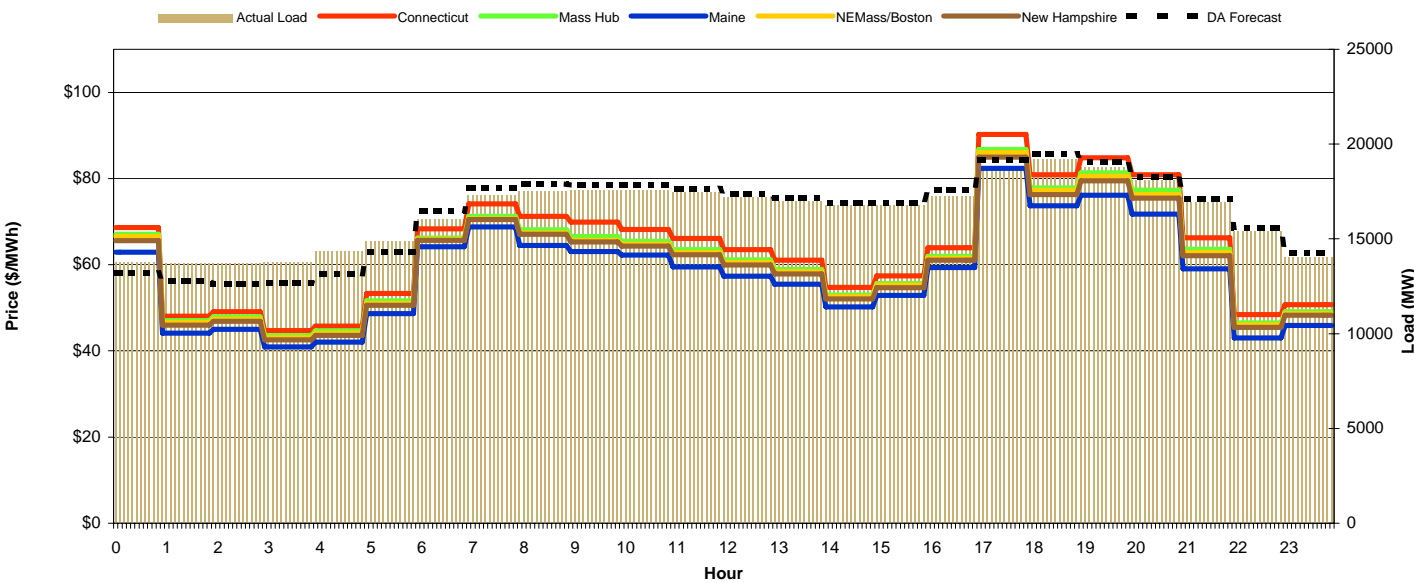






# ISO-NE Daily Report

Tuesday February 09, 2010

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	45.52	44.49	43.03	43.03	44.82	46.95	68.37	77.00	66.00	64.25	62.19	60.37	57.11	55.32	54.06	54.06	58.18	77.15	78.09	74.20	62.18	60.57	58.04	50.86	58.58	63.67	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	44.42	43.41	41.99	41.99	43.74	45.81	66.72	75.14	64.40	62.69	60.68	58.91	55.73	53.98	52.75	52.75	56.77	75.29	76.20	72.40	60.68	59.11	56.63	49.63	57.16	62.13		
<b>New Hampshire</b>	44.03	43.03	41.62	41.62	43.35	45.41	66.13	74.48	63.84	62.14	60.15	58.39	55.24	53.51	52.29	52.29	56.27	74.63	75.53	71.77	60.15	58.59	56.14	49.19	56.66	61.59		
<b>Maine</b>	42.77	41.80	40.43	40.43	42.11	44.11	64.24	72.34	62.01	60.36	58.42	56.72	53.66	51.98	50.79	50.79	54.66	72.49	73.37	69.71	58.42	56.91	54.53	47.78	55.03	59.82		
<b>Mass Hub</b>	44.71	43.69	42.26	42.26	44.02	46.11	67.15	75.62	64.82	63.10	61.07	59.29	56.09	54.33	53.09	53.09	57.13	75.77	76.69	72.87	61.07	59.49	57.00	49.95	57.53	62.53		
<b>Cleared Load (GW)</b>	12.6	12.5	12.8	12.8	13.0	13.7	15.4	16.1	16.3	16.4	16.4	16.0	15.5	15.2	15.0	15.0	16.1	17.5	17.6	17.2	16.6	15.0	13.4	12.7				

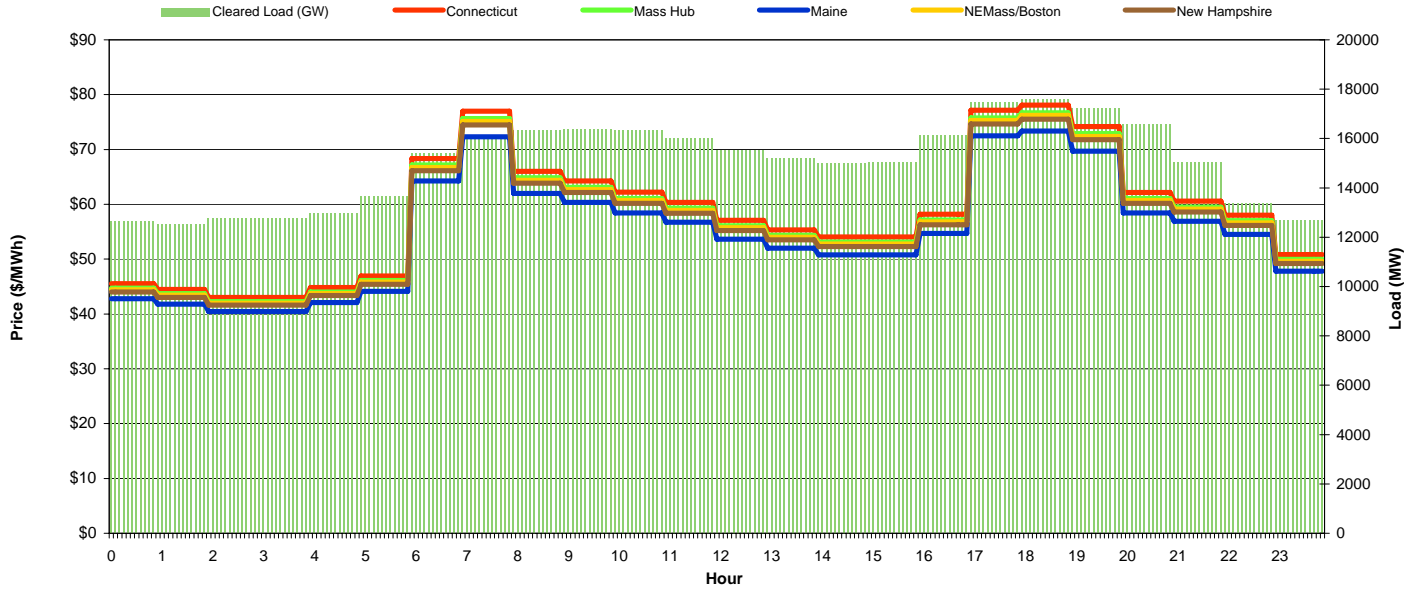

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	43.54	45.92	47.45	44.26	42.30	47.08	70.60	80.79	77.96	70.01	67.58	59.87	58.93	54.63	50.64	51.06	53.64	73.91	76.38	70.61	58.58	59.30	55.22	43.30	58.48	63.69	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	42.09	44.33	45.75	42.61	40.83	45.63	68.11	77.11	73.87	66.09	63.83	56.78	56.02	52.34	48.78	49.13	51.52	70.47	72.76	67.12	55.66	56.56	53.42	41.93	55.95	60.72		
<b>New Hampshire</b>	41.92	44.16	45.61	42.44	40.64	45.24	67.14	75.63	72.65	65.19	62.94	56.09	55.39	51.72	48.08	48.46	50.91	69.45	71.59	66.20	55.12	56.10	52.80	41.22	55.28	59.90		
<b>Maine</b>	40.64	42.94	44.38	41.34	39.88	88.00	65.30	72.53	69.74	62.04	59.93	53.13	52.57	49.46	46.00	46.47	48.78	66.63	68.78	63.12	52.47	53.54	50.59	39.26	54.90	57.24		
<b>Mass Hub</b>	42.45	44.74	46.28	43.13	41.27	46.03	68.65	77.88	74.74	67.06	64.81	57.60	56.78	52.96	49.27	49.63	52.06	71.26	73.50	67.95	56.41	57.31	53.94	42.27	56.58	61.45		
<b>DA Forecast Load (GW)</b>	13.31	12.90	12.76	12.82	13.20	14.40	16.52	17.64	17.70	17.54	17.42	17.20	16.93	16.71	16.45	16.44	17.12	18.57	18.90	18.48	17.77	16.61	15.15	13.76				
<b>Forecast Error %</b>	7.0%	6.0%	6.0%	6.4%	6.2%	6.0%	5.2%	7.3%	6.1%	4.9%	4.4%	5.1%	6.5%	6.8%	6.4%	6.3%	1.8%	2.2%	4.4%	4.3%	4.2%	7.4%	9.7%	8.6%				

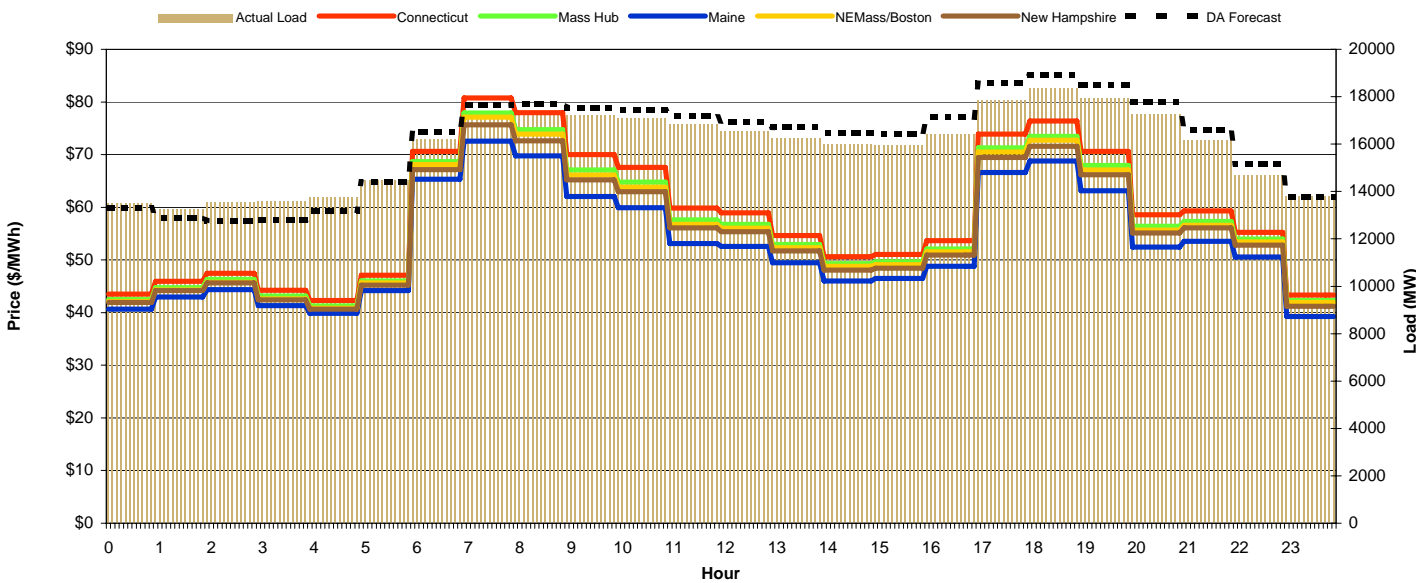




# ISO-NE Daily Report

Wednesday February 10, 2010

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	46.15	43.54	43.09	42.02	43.09	46.53	58.73	63.23	65.23	68.98	72.00	66.17	61.46	57.55	55.82	55.05	61.39	79.52	80.83	73.89	58.78	58.73	53.33	50.00	58.55	64.50	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	44.34	42.42	41.98	40.94	41.98	45.33	57.22	61.60	63.55	67.20	70.14	64.47	59.87	56.06	54.39	53.64	59.81	77.47	78.75	71.99	57.27	57.22	51.96	48.71	57.01	62.84		
<b>New Hampshire</b>	43.94	42.03	41.59	40.56	41.59	44.91	56.69	61.03	62.97	66.58	69.50	63.88	59.32	55.55	53.89	53.14	59.26	76.76	78.03	71.33	56.74	56.69	51.48	48.26	56.49	62.26		
<b>Maine</b>	42.64	40.79	40.37	39.37	40.37	43.59	55.03	59.24	60.38	63.41	67.46	62.00	57.58	53.92	52.31	51.58	57.52	74.50	75.74	69.23	55.07	55.03	49.97	46.85	54.75	60.31		
<b>Mass Hub</b>	44.64	42.70	42.26	41.21	42.26	45.63	57.60	62.01	63.98	67.65	70.62	64.90	60.27	56.44	54.75	54.00	60.21	77.99	79.28	72.47	57.65	57.60	52.31	49.04	57.39	63.26		
<b>Cleared Load (GW)</b>	12.7	12.5	12.5	12.8	12.7	13.0	15.6	16.8	16.8	16.9	16.7	16.5	16.3	16.2	16.3	16.3	17.0	18.0	17.9	17.8	17.1	15.1	13.5	12.7				

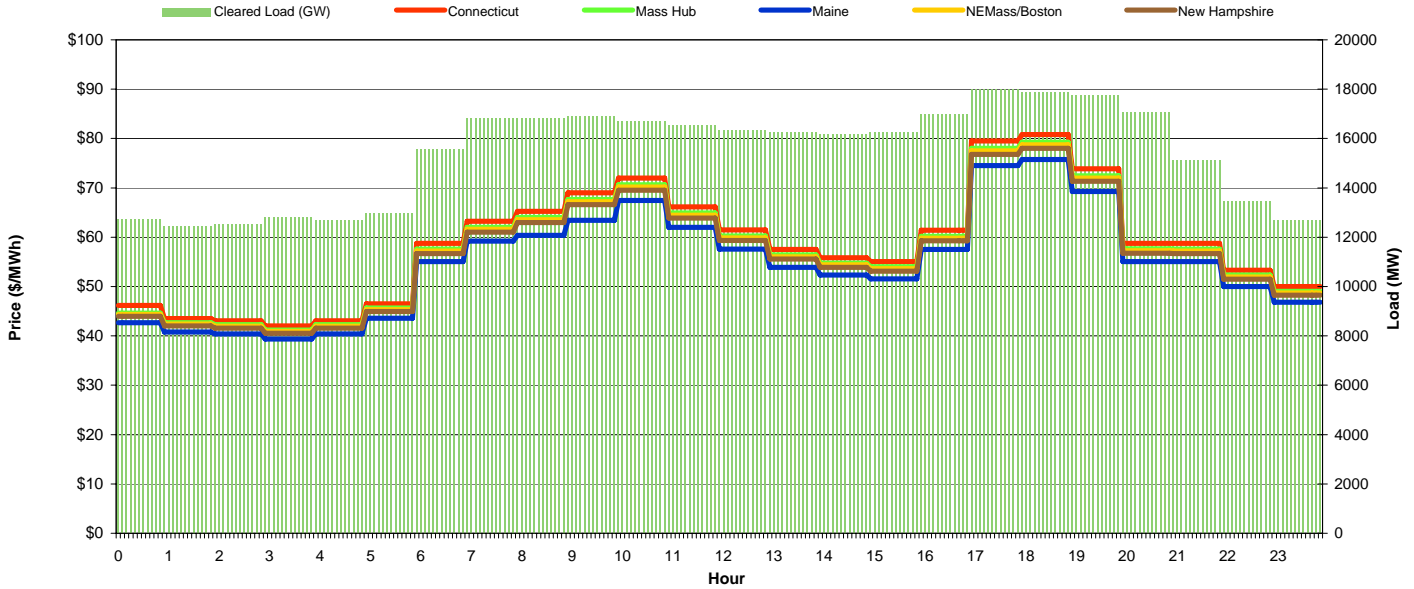

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	42.61	40.74	32.26	35.42	35.27	29.68	43.03	53.50	54.14	54.37	61.02	65.53	66.62	60.40	60.22	57.36	57.06	86.13	66.22	58.88	52.82	48.26	45.70	37.14	51.85	59.26	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	40.84	38.92	31.05	34.22	34.07	28.89	41.83	51.72	51.94	51.95	58.49	62.81	63.35	57.64	57.84	55.12	54.82	82.48	63.60	56.43	50.65	46.78	44.66	36.22	49.85	56.89		
<b>New Hampshire</b>	40.15	38.28	30.61	33.77	33.65	28.52	41.30	51.03	51.31	51.39	57.70	61.86	62.44	56.82	56.87	54.25	54.04	80.80	62.42	55.63	50.12	46.27	44.02	35.67	49.12	56.06		
<b>Maine</b>	38.17	36.39	29.36	32.57	32.46	28.00	40.12	49.14	49.41	49.43	55.24	58.97	59.28	54.28	54.36	51.91	51.78	77.69	60.13	53.50	48.03	44.43	42.43	34.68	49.66	53.75		
<b>Mass Hub</b>	41.35	39.47	31.47	34.65	34.50	29.17	42.09	52.14	52.53	52.53	59.09	63.45	64.12	58.28	58.42	55.64	55.36	83.16	64.08	56.95	51.15	47.11	44.85	36.38	50.33	57.43		
<b>DA Forecast Load (GW)</b>	12.78	12.30	12.12	12.10	12.45	13.42	15.34	16.58	17.29	17.72	17.93	17.99	18.00	17.89	17.75	17.71	18.19	19.24	19.06	18.46	17.67	16.49	15.09	13.73				
<b>Forecast Error %</b>	5.1%	5.8%	6.0%	3.8%	7.0%	8.8%	-4.3%	-4.5%	-1.2%	0.4%	3.6%	5.8%	7.4%	7.7%	7.1%	6.2%	4.4%	5.1%	6.0%	2.7%	1.7%	6.5%	9.0%	5.7%				

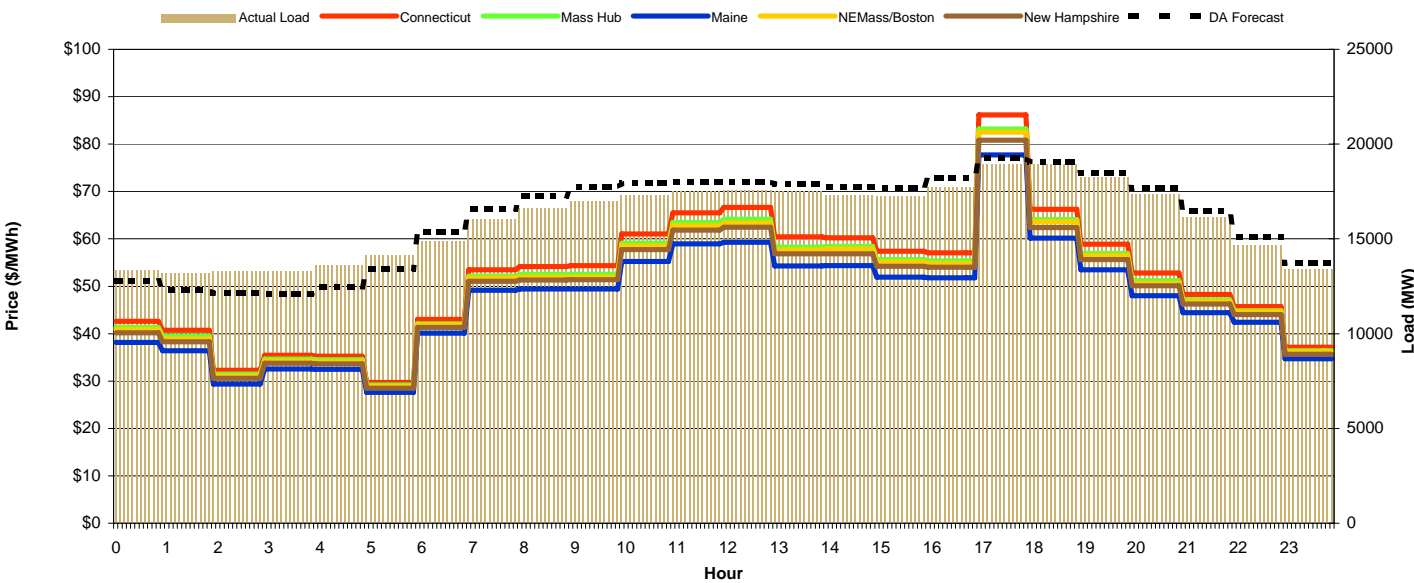




# ISO-NE Daily Report

Thursday February 11, 2010

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	43.28	43.68	35.24	35.24	37.99	46.40	62.71	70.31	67.27	66.86	66.58	60.77	56.63	54.38	53.26	53.23	54.28	70.97	72.98	71.88	62.15	60.26	53.23	51.78	56.31	62.19	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	42.10	42.48	34.28	34.28	36.96	45.13	61.00	68.39	65.44	65.04	64.76	59.11	55.09	52.90	51.81	51.78	52.79	65.93	68.69	67.38	60.20	58.62	51.78	50.36	54.43	59.98		
<b>New Hampshire</b>	41.65	42.03	33.91	33.91	36.56	44.65	60.35	67.66	64.74	64.34	64.07	58.48	54.50	52.33	51.26	51.22	52.23	65.16	67.90	66.61	59.56	57.99	51.22	49.82	53.84	59.33		
<b>Maine</b>	40.34	40.72	32.85	32.85	35.42	43.25	58.46	65.54	62.71	62.33	62.06	56.65	52.80	50.70	49.65	49.62	50.60	63.11	65.76	64.51	57.69	56.18	49.62	48.27	52.15	57.47		
<b>Mass Hub</b>	42.41	42.80	34.53	34.53	37.23	45.47	61.45	68.90	65.92	65.52	65.24	59.55	55.50	53.29	52.20	52.16	53.19	66.00	68.88	67.55	60.62	59.05	52.16	50.74	54.79	60.36		
<b>Cleared Load (GW)</b>	12.1	11.7	12.0	12.0	12.2	12.5	14.7	15.5	16.0	16.1	15.9	15.9	15.6	15.3	15.1	15.1	16.0	17.7	17.6	17.5	16.6	14.9	13.3	12.4				

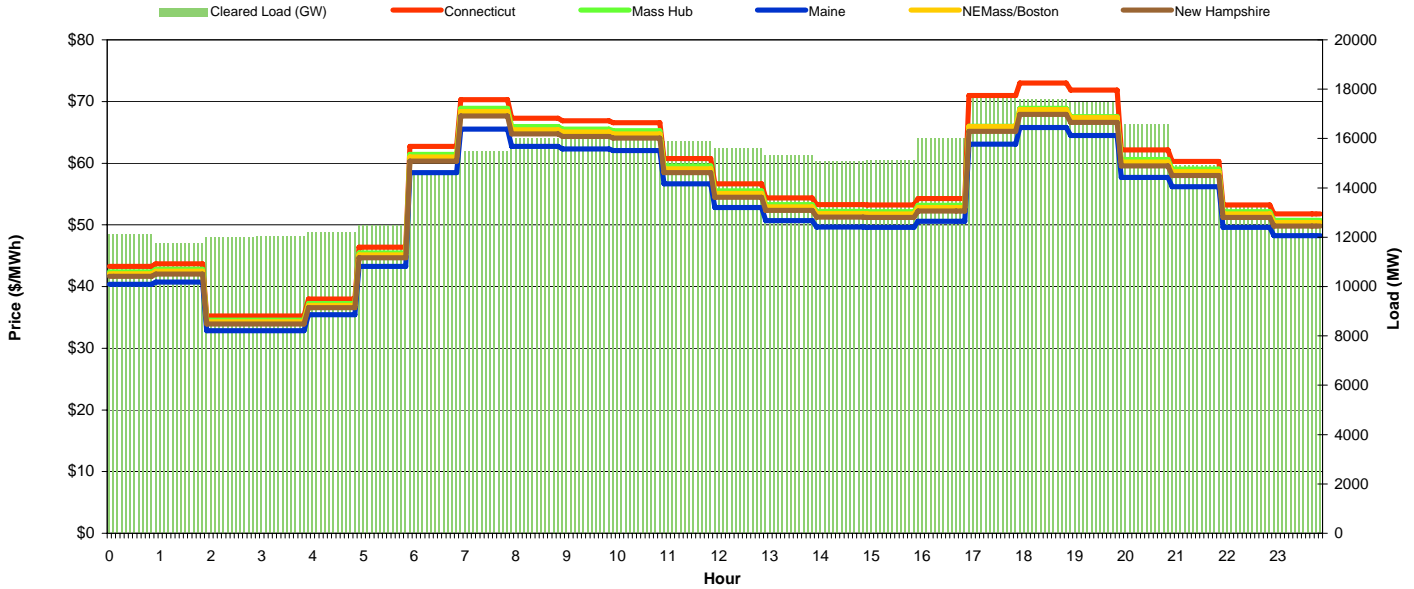

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	40.94	36.56	33.72	34.95	31.32	36.61	60.74	58.91	57.82	57.76	57.99	55.89	54.47	51.72	37.04	29.32	40.95	50.04	53.94	53.89	53.16	49.99	40.39	49.71	46.99	50.21	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	39.76	35.36	32.68	34.05	30.67	35.88	59.55	57.53	56.25	55.91	56.22	54.34	52.79	50.10	36.24	28.77	40.16	48.87	52.64	52.44	51.71	48.53	39.56	47.95	45.75	48.88		
<b>New Hampshire</b>	39.21	34.91	32.32	33.63	30.27	35.39	58.70	56.72	55.56	55.26	55.60	53.79	52.22	49.58	35.78	28.39	39.84	48.30	52.07	51.88	51.37	48.29	39.04	47.36	45.23	48.36		
<b>Maine</b>	38.36	34.27	31.65	32.95	29.60	35.59	55.05	53.90	53.21	53.54	51.67	49.85	47.28	34.31	27.24	38.49	46.91	50.42	49.98	49.11	46.41	37.42	45.62	45.91	46.55			
<b>Mass Hub</b>	40.09	35.69	33.01	34.37	30.94	36.10	59.80	57.77	56.59	56.41	56.71	54.74	53.23	50.50	36.40	28.86	40.26	48.93	52.74	52.61	51.95	48.84	39.73	48.30	46.02	49.14		
<b>DA Forecast Load (GW)</b>	12.73	12.29	12.11	12.12	12.45	13.57	15.61	16.77	17.03	17.02	17.03	16.89	16.66	16.49	16.31	16.30	16.82	18.20	18.70	18.16	17.56	16.53	15.13	13.81				
<b>Forecast Error %</b>	7.6%	8.9%	9.5%	8.1%	9.0%	10.1%	5.1%	6.7%	4.6%	4.2%	5.1%	4.5%	4.8%	5.8%	5.7%	6.2%	1.5%	-0.9%	3.2%	2.1%	4.0%	8.7%	11.1%	9.6%				

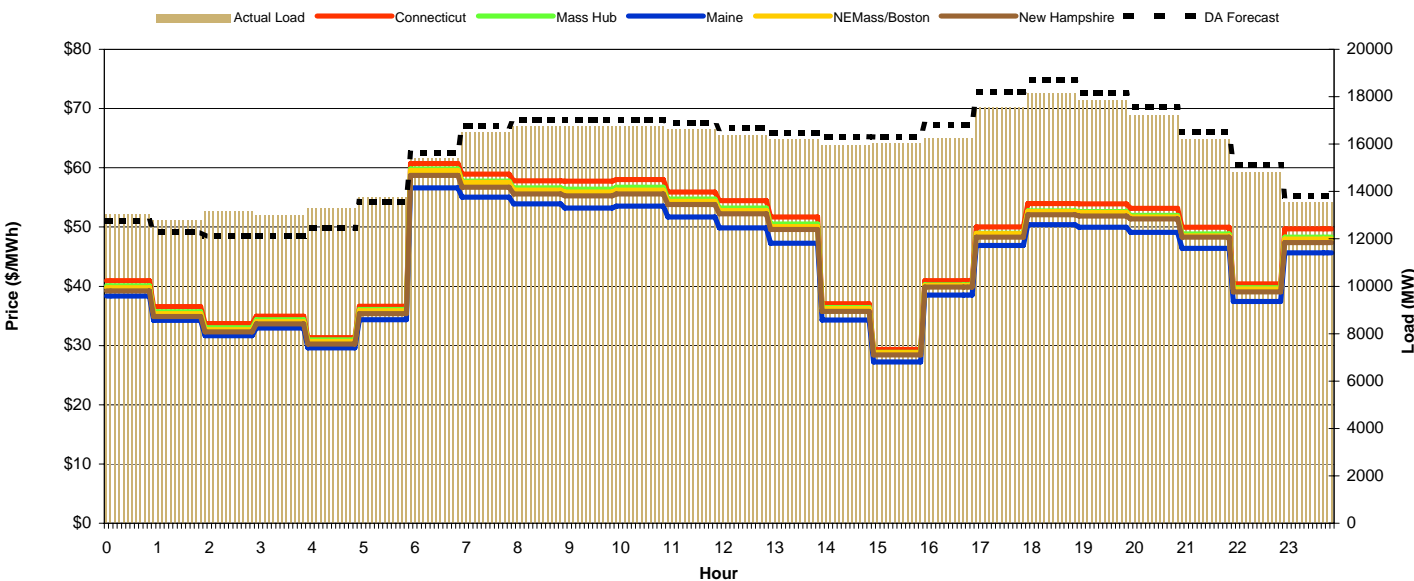




# ISO-NE Daily Report

Friday February 12, 2010

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	40.91	35.96	35.82	35.07	35.00	43.75	64.78	66.04	63.37	62.71	66.21	60.89	57.89	54.71	51.43	51.54	56.39	70.50	72.60	65.90	60.00	54.60	54.07	51.29	54.64	60.55	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	39.69	34.89	34.75	34.03	33.96	42.45	62.85	63.72	60.78	59.86	63.54	58.26	55.69	53.08	49.91	50.01	54.47	66.47	68.32	62.85	57.73	52.98	52.47	49.76	52.61	58.13		
<b>New Hampshire</b>	39.22	34.48	34.34	33.63	33.56	41.95	62.11	62.96	60.04	59.13	62.77	57.55	55.02	52.45	49.31	49.41	53.81	65.63	67.46	62.08	57.04	52.35	51.84	49.18	51.97	57.43		
<b>Maine</b>	37.92	33.34	33.20	32.51	32.45	40.56	60.05	60.87	58.05	57.16	60.69	55.64	53.19	50.71	47.68	47.78	52.03	63.45	65.21	60.02	55.15	50.61	50.13	47.55	50.25	55.52		
<b>Mass Hub</b>	40.01	35.17	35.03	34.30	34.23	42.79	63.35	64.17	61.16	60.20	63.95	58.60	56.06	53.50	50.30	50.40	54.86	66.73	68.57	63.20	58.12	53.39	52.88	50.16	52.96	58.51		
<b>Cleared Load (GW)</b>	12.3	12.2	12.3	12.4	12.6	12.7	15.0	15.9	15.9	15.9	15.6	15.7	15.3	15.1	15.0	14.9	15.3	16.8	16.9	16.7	15.8	14.7	13.3	12.3				

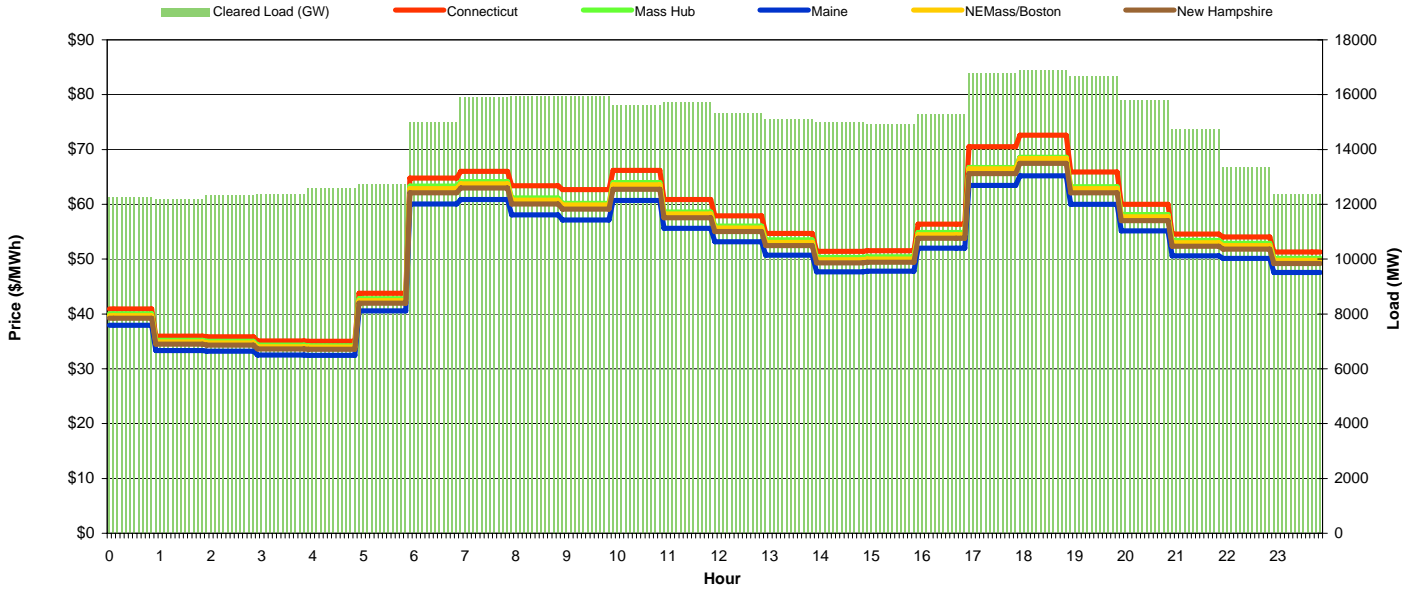

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	47.48	37.85	37.07	38.29	47.24	39.18	61.98	62.34	63.27	63.68	63.35	59.88	60.21	57.62	54.22	52.95	55.86	75.30	68.79	67.99	61.81	57.68	63.01	61.58	56.61	61.75	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	45.67	36.56	35.84	37.17	45.78	38.00	59.98	60.16	60.60	60.92	60.57	57.56	57.66	55.21	52.03	50.94	53.72	71.83	63.65	62.47	56.93	55.29	60.70	59.79	54.13	58.77		
<b>New Hampshire</b>	45.30	36.28	35.57	36.91	45.51	37.57	59.26	59.21	59.77	60.06	59.81	56.92	57.01	54.59	51.39	50.29	53.12	70.75	62.68	61.50	56.33	54.79	60.15	58.96	53.49	58.02		
<b>Maine</b>	44.19	35.38	34.64	35.97	44.30	38.00	56.79	56.98	57.52	57.45	56.97	54.29	54.15	52.02	48.79	47.80	50.69	67.70	59.88	58.35	53.46	52.36	58.18	57.54	53.48	55.41		
<b>Mass Hub</b>	46.12	36.96	36.23	37.53	46.26	38.31	60.35	60.53	61.15	61.55	61.17	58.09	58.30	55.80	52.52	51.36	54.19	72.44	63.81	62.80	57.27	55.89	61.30	60.23	54.59	59.26		
<b>DA Forecast Load (GW)</b>	12.81	12.43	12.24	12.28	12.66	13.80	15.80	16.88	17.10	17.12	17.04	16.85	16.60	16.37	16.07	16.02	16.50	17.81	18.10	17.60	17.01	16.19	15.13	13.90				
<b>Forecast Error %</b>	7.2%	6.7%	6.0%	5.8%	6.6%	7.6%	4.2%	4.7%	5.8%	5.7%	7.6%	5.8%	6.3%	6.2%	4.8%	4.7%	4.4%	2.0%	4.4%	3.5%	5.7%	7.7%	10.8%	10.7%				

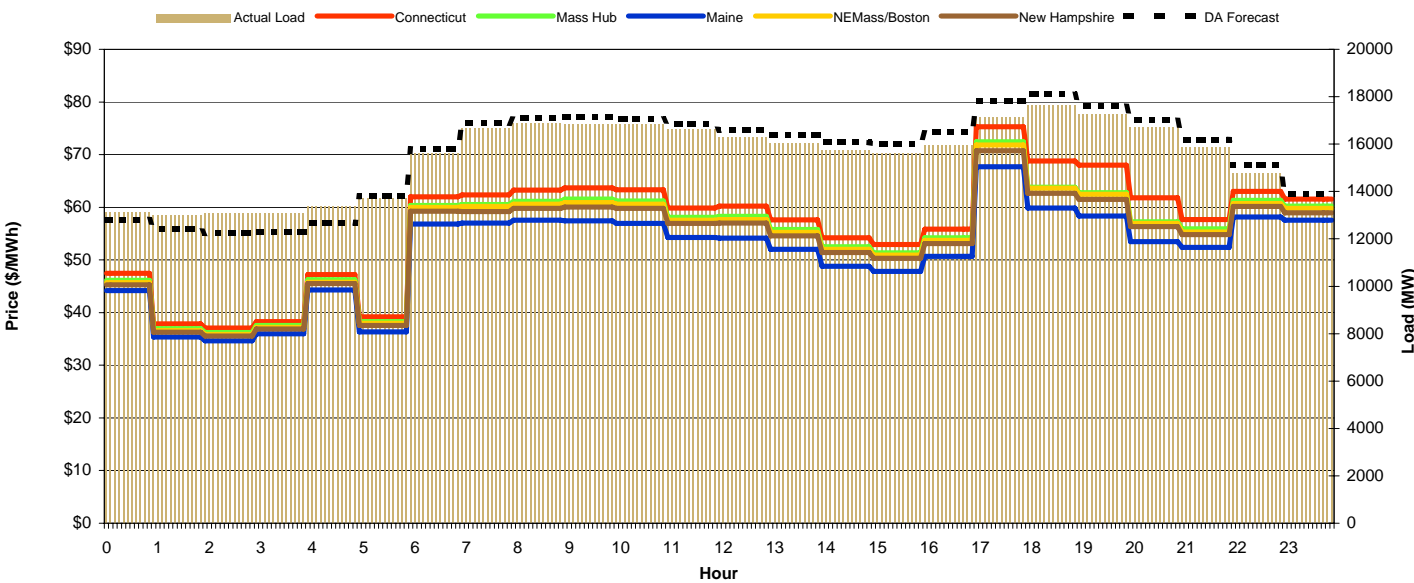




# ISO-NE Daily Report

Saturday February 13, 2010

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	50.02	48.34	44.05	44.98	44.98	40.09	50.21	50.21	58.18	66.76	64.78	61.29	57.00	50.17	46.57	46.61	52.31	66.76	69.45	66.76	65.13	53.30	52.15	51.25	54.22	57.96	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	48.50	46.86	42.70	43.61	43.61	38.87	48.68	48.68	56.41	64.73	62.81	59.42	55.26	48.64	45.15	45.19	50.71	64.73	67.33	64.73	63.14	51.67	50.56	49.69	52.57	56.20		
<b>New Hampshire</b>	47.93	46.31	42.20	43.10	43.10	38.41	48.10	48.10	55.74	63.97	62.07	58.72	54.61	48.07	44.62	44.66	50.12	63.97	66.54	63.97	62.40	51.07	49.97	49.10	51.95	55.54		
<b>Maine</b>	46.29	44.73	40.76	41.63	41.63	37.10	46.46	46.46	53.84	61.79	59.95	56.72	52.75	46.43	43.10	43.14	48.41	61.79	64.27	61.79	60.27	49.33	48.26	47.43	50.18	53.64		
<b>Mass Hub</b>	48.87	47.22	43.03	43.94	43.94	39.17	49.05	49.05	56.84	65.22	63.29	59.88	55.68	49.02	45.50	45.54	51.10	65.22	67.85	65.22	63.63	52.07	50.95	50.07	52.97	56.63		
<b>Cleared Load (GW)</b>	11.8	11.8	11.7	11.6	11.8	11.9	12.6	14.0	15.1	15.2	15.0	15.0	14.6	14.5	14.0	14.1	14.8	16.2	16.4	16.0	15.0	14.4	13.1	12.0				

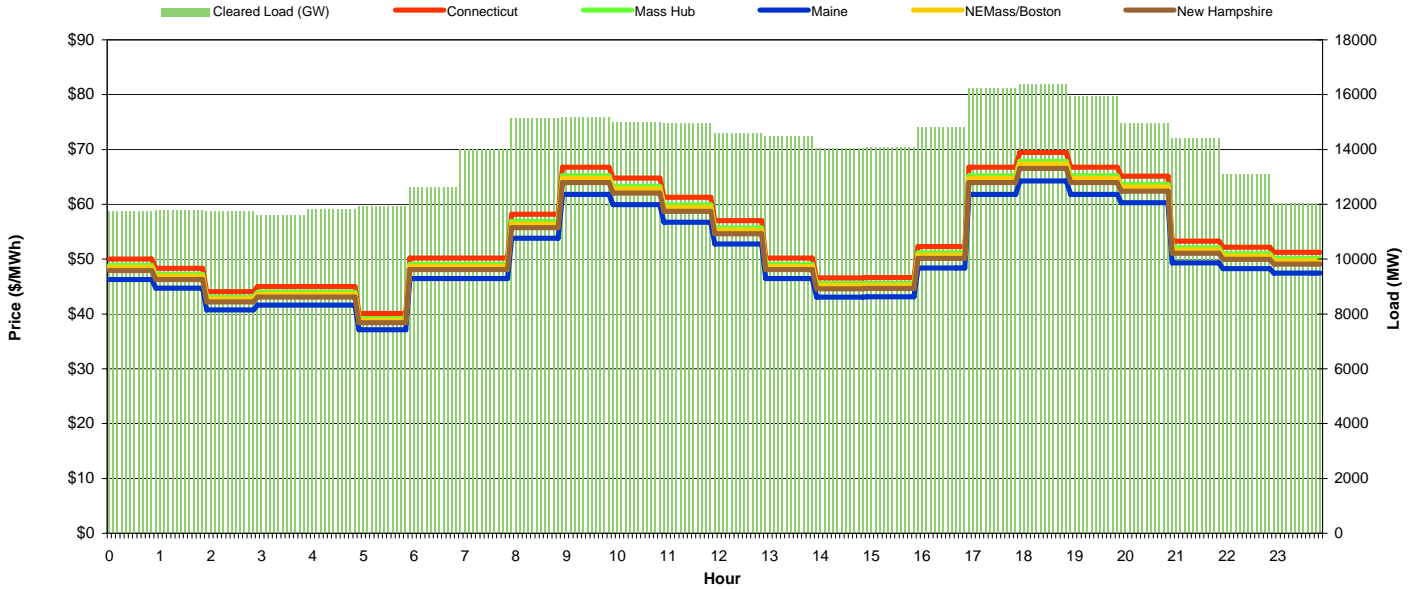

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	48.33	45.64	44.51	49.37	47.36	41.95	50.69	50.32	56.93	74.39	82.64	84.35	63.14	50.99	48.71	49.25	53.30	70.22	69.26	82.50	79.75	57.16	54.07	79.69	59.77	64.19	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	47.16	44.62	43.35	47.91	45.98	41.07	49.64	49.23	55.47	72.23	80.48	81.98	61.41	49.55	47.38	47.88	52.03	68.83	67.62	80.49	77.64	55.40	52.36	77.63	58.22	62.50		
<b>New Hampshire</b>	46.63	44.28	42.96	47.58	45.66	40.70	49.16	49.00	55.16	71.74	79.86	81.23	60.87	49.07	46.81	47.39	51.55	68.11	66.74	79.52	77.10	55.02	51.88	76.63	57.69	61.94		
<b>Maine</b>	46.01	43.39	41.81	46.43	44.51	88.00	48.02	47.60	53.40	69.40	77.38	78.21	58.29	47.10	44.93	45.60	49.63	65.89	64.27	76.38	73.89	52.86	50.11	74.34	57.81	59.68		
<b>Mass Hub</b>	47.46	44.88	43.70	48.35	46.40	41.30	49.84	49.50	55.81	72.55	80.78	82.39	61.79	49.87	47.62	48.14	52.28	68.98	67.72	80.74	77.98	55.81	52.72	78.06	58.53	62.79		
<b>DA Forecast Load (GW)</b>	12.97	12.52	12.27	12.24	12.39	12.87	13.68	14.46	15.40	15.94	16.09	15.95	15.65	15.30	15.06	15.05	15.44	16.72	17.20	16.73	16.17	15.44	14.49	13.46				
<b>Forecast Error %</b>	8.9%	6.3%	6.8%	7.7%	7.0%	6.1%	5.5%	0.7%	0.0%	3.5%	5.2%	4.7%	4.9%	3.2%	5.3%	4.9%	2.6%	1.3%	2.8%	3.0%	6.5%	5.3%	9.0%	10.5%				

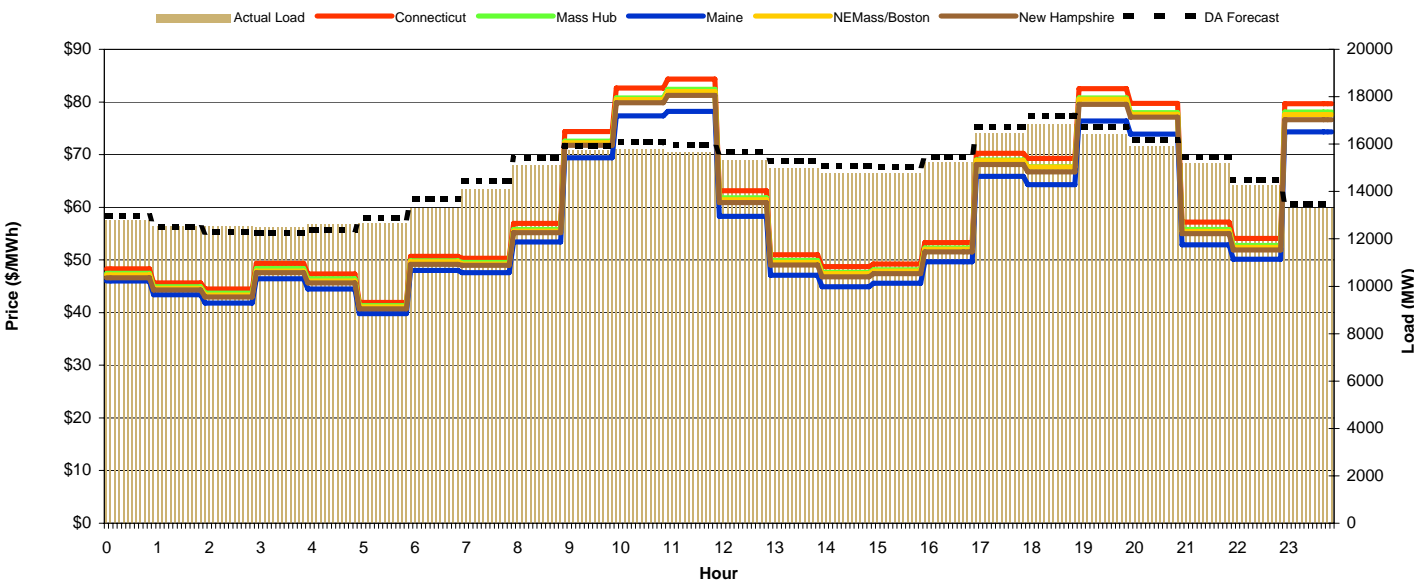




# ISO-NE Daily Report

Sunday February 14, 2010

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	49.89	48.50	48.89	46.50	47.37	54.99	48.43	46.11	50.19	58.00	59.70	62.82	61.27	54.00	50.21	50.18	54.00	82.06	84.43	77.48	69.46	55.28	51.38	47.35	56.60	60.41	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	48.27	46.92	47.30	44.99	45.83	53.20	46.85	44.61	48.56	56.12	57.76	60.78	59.28	52.25	48.58	48.55	52.25	79.40	81.69	74.96	67.20	53.48	49.71	45.81	54.76	58.45		
<b>New Hampshire</b>	47.70	46.37	46.75	44.46	45.29	52.58	46.30	44.09	47.99	55.46	57.08	60.06	58.59	51.63	48.01	47.98	51.63	78.46	80.73	74.08	66.41	52.85	49.13	45.27	54.12	57.76		
<b>Maine</b>	45.99	44.70	45.06	42.86	43.66	50.68	44.64	42.50	46.26	53.46	55.02	57.90	56.48	49.77	46.28	46.25	49.77	75.64	77.82	71.41	64.02	50.95	47.36	43.64	52.17	55.68		
<b>Mass Hub</b>	48.65	47.29	47.67	45.34	46.19	53.62	47.22	44.96	48.94	56.56	58.21	61.25	59.75	52.66	48.96	48.94	52.66	80.02	82.33	75.55	67.73	53.90	50.10	46.17	55.19	58.91		
<b>Cleared Load (GW)</b>	11.9	11.8	12.2	12.2	12.2	12.2	12.3	12.7	13.6	14.2	14.4	14.3	14.2	14.1	14.0	14.0	15.0	16.0	15.9	15.7	15.0	14.3	12.8	11.8				

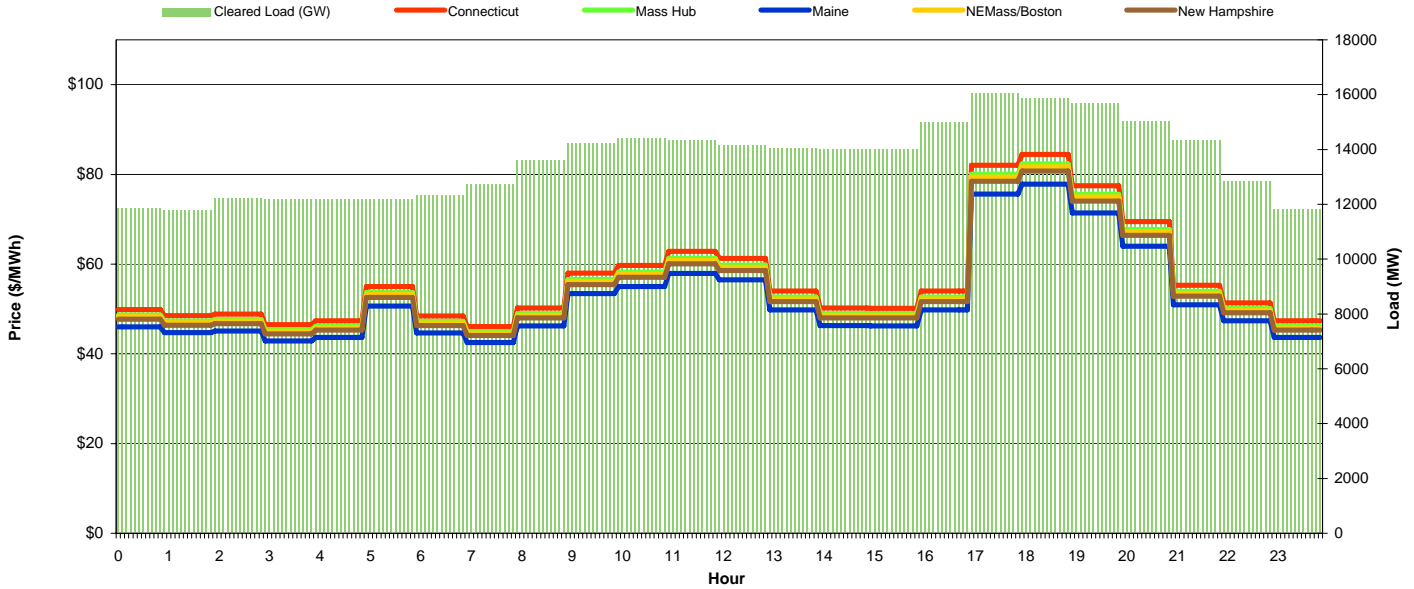

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	59.18	48.50	65.03	47.08	54.49	97.53	45.71	49.94	63.04	60.39	59.04	50.25	47.77	45.59	44.81	44.19	46.65	70.18	88.23	63.64	58.17	47.83	45.77	39.47	55.94	55.34	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	58.26	47.72	63.87	46.18	53.46	96.31	45.13	48.90	61.22	58.56	57.36	48.83	46.48	44.44	43.66	43.20	45.47	68.51	86.05	61.90	56.50	46.54	44.84	38.48	54.66	53.90		
<b>New Hampshire</b>	57.44	47.11	63.11	45.62	52.85	95.28	44.63	48.57	60.98	58.35	57.04	48.46	46.11	44.00	43.23	42.85	45.21	68.00	85.37	61.37	56.08	46.33	44.44	38.05	54.19	53.52		
<b>Maine</b>	56.01	45.98	61.35	44.33	51.58	88.00	43.59	47.64	59.79	56.96	55.46	46.99	44.60	42.52	41.86	41.79	43.92	66.34	82.97	59.46	54.09	45.20	43.56	37.12	52.55	52.07		
<b>Mass Hub</b>	58.39	47.92	64.30	46.53	53.86	96.88	45.29	49.20	61.65	58.99	57.76	49.13	46.74	44.65	43.84	43.33	45.64	68.61	86.20	62.09	56.75	46.74	44.99	38.65	54.92	54.14		
<b>DA Forecast Load (GW)</b>	12.60	12.09	11.80	11.70	11.75	12.05	12.41	12.99	13.92	14.68	15.08	15.20	15.02	14.81	14.60	14.67	15.36	16.60	17.16	16.83	16.22	15.23	14.07	12.96				
<b>Forecast Error %</b>	6.5%	7.9%	5.6%	6.0%	6.1%	6.4%	6.0%	3.9%	1.7%	1.1%	1.2%	2.4%	2.7%	2.0%	1.2%	1.9%	-1.3%	0.0%	4.1%	2.7%	3.5%	2.8%	6.9%	10.7%				

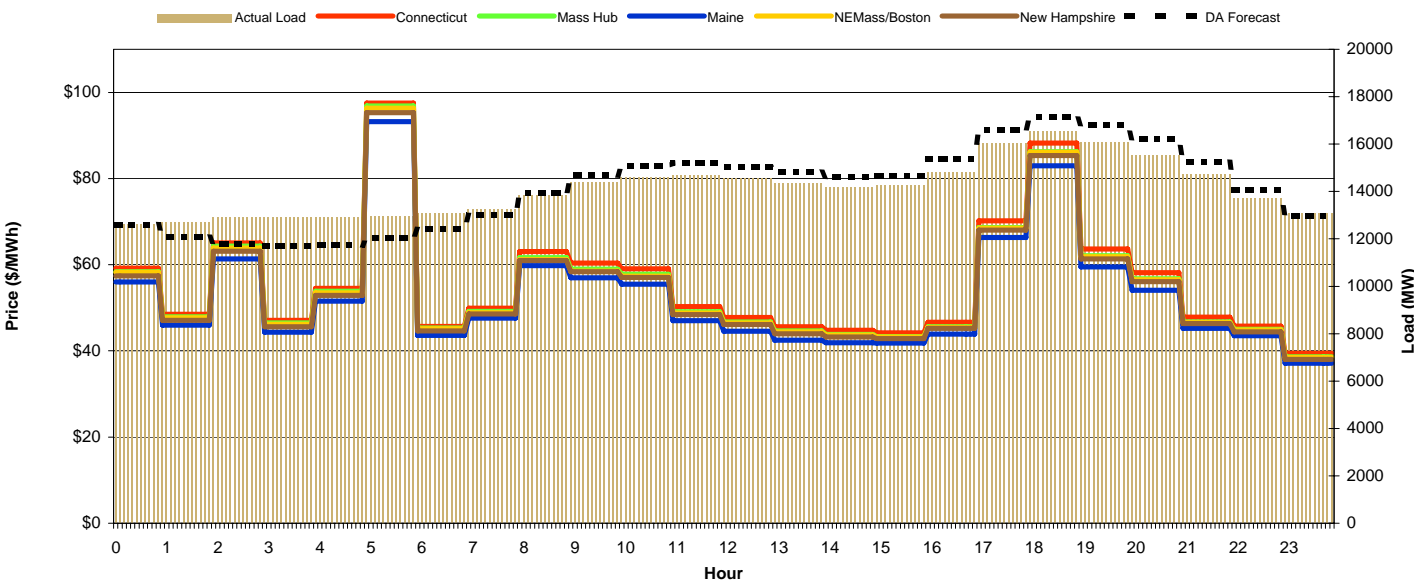




# ISO-NE Daily Report

Monday February 15, 2010

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$				
<b>Connecticut</b>	43.31	43.31	43.31	42.26	44.89	46.41	67.76	75.00	80.00	79.61	76.53	69.49	64.09	63.45	53.72	57.54	61.77	85.17	87.33	77.94	67.02	56.54	58.44	48.66	48.66	62.23	69.60	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	41.89	41.89	41.89	40.88	43.42	44.89	65.54	72.54	77.38	77.00	74.03	67.22	61.99	61.38	51.96	55.65	59.75	82.38	84.47	75.38	64.82	54.69	56.53	47.06	60.19	67.32			
<b>New Hampshire</b>	41.40	41.40	41.39	40.40	42.91	44.36	64.77	71.69	76.47	76.09	73.15	66.43	61.26	60.65	51.35	55.00	59.05	81.41	83.48	74.50	64.06	54.05	55.86	46.51	59.49	66.53			
<b>Maine</b>	39.87	39.87	39.87	38.91	41.32	42.73	62.38	69.05	73.65	73.29	70.46	63.98	59.00	58.42	49.46	52.97	56.87	78.41	80.40	71.75	61.70	52.05	53.80	44.80	57.29	64.08			
<b>Mass Hub</b>	42.21	42.21	42.21	41.19	43.75	45.24	66.05	73.10	77.98	77.60	74.60	67.74	62.47	61.85	52.36	56.08	60.21	83.02	85.13	75.97	65.32	55.11	56.96	47.43	60.66	67.84			
<b>Cleared Load (GW)</b>	12.4	12.5	12.5	12.5	12.8	13.0	13.9	14.3	14.7	14.8	14.8	15.0	14.7	14.3	14.3	14.1	14.9	16.6	16.4	16.2	15.4	14.3	12.7	12.1					

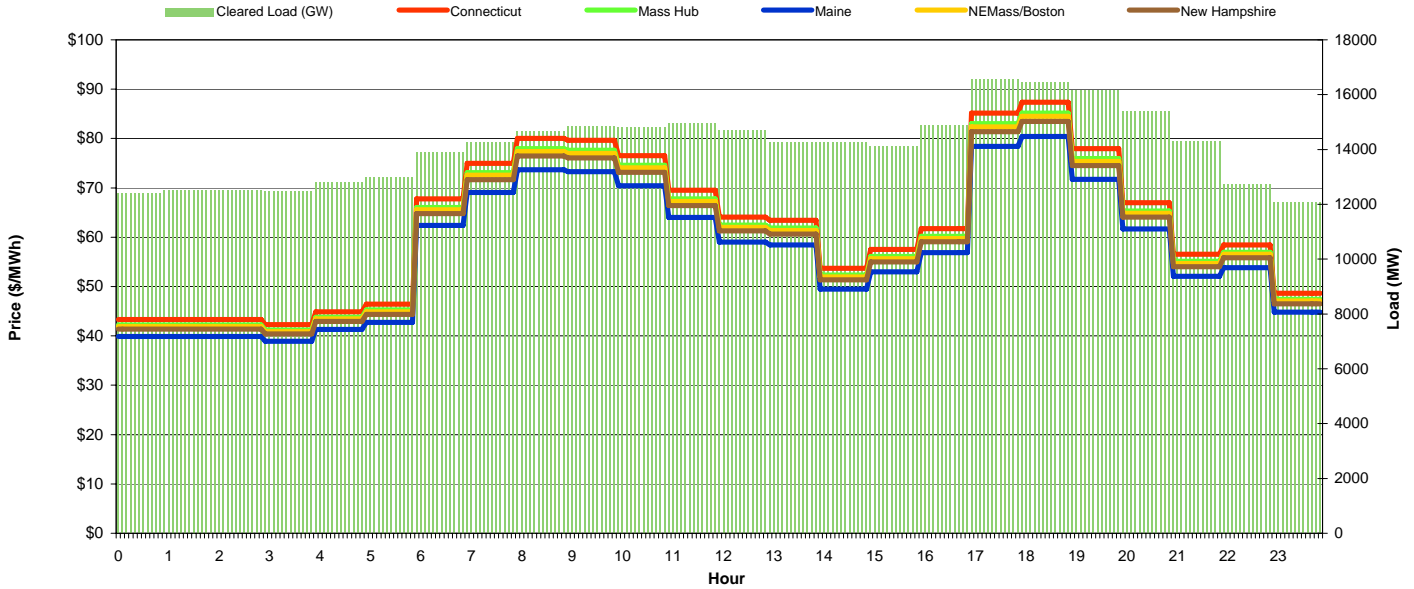

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$				
<b>Connecticut</b>	39.63	28.87	34.18	36.31	34.91	40.96	43.12	67.06	72.02	75.43	75.76	67.12	69.47	62.29	55.70	55.64	50.21	84.26	77.77	86.49	70.04	59.61	57.95	42.22	42.22	57.79	67.93	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	38.64	28.04	33.26	35.22	34.01	39.96	41.99	65.16	69.08	72.23	72.71	64.48	66.87	59.95	53.89	53.86	48.51	81.25	75.38	83.37	67.27	57.28	56.15	41.06	55.82	65.47			
<b>New Hampshire</b>	38.27	27.80	32.97	34.93	33.78	39.76	41.74	65.03	69.21	72.41	72.59	64.22	66.76	59.77	53.63	53.72	48.32	80.68	74.86	82.88	67.01	57.25	55.82	40.71	55.59	65.26			
<b>Maine</b>	37.43	27.13	32.14	34.06	33.16	88.00	40.98	64.29	68.38	71.47	71.04	62.77	64.88	58.60	52.44	52.71	47.36	79.27	73.58	81.30	64.99	55.61	54.23	39.64	56.48	63.93			
<b>Mass Hub</b>	38.88	28.31	33.58	35.58	34.33	40.23	42.16	65.36	69.68	72.98	73.43	65.07	67.48	60.55	54.31	54.30	48.86	81.70	75.67	83.83	67.84	57.81	56.60	41.36	56.25	65.97			
<b>DA Forecast Load (GW)</b>	11.97	11.59	11.47	11.54	11.88	12.93	14.71	15.85	16.28	16.51	16.58	16.48	16.26	15.98	15.72	15.67	16.19	17.48	17.81	17.49	16.93	15.77	14.39	13.09					
<b>Forecast Error %</b>	4.4%	4.5%	3.4%	3.2%	2.6%	2.5%	-0.2%	1.8%	4.4%	7.0%	8.9%	7.8%	7.9%	9.5%	7.5%	7.8%	4.8%	2.6%	6.8%	6.0%	6.9%	7.8%	11.1%	9.9%					

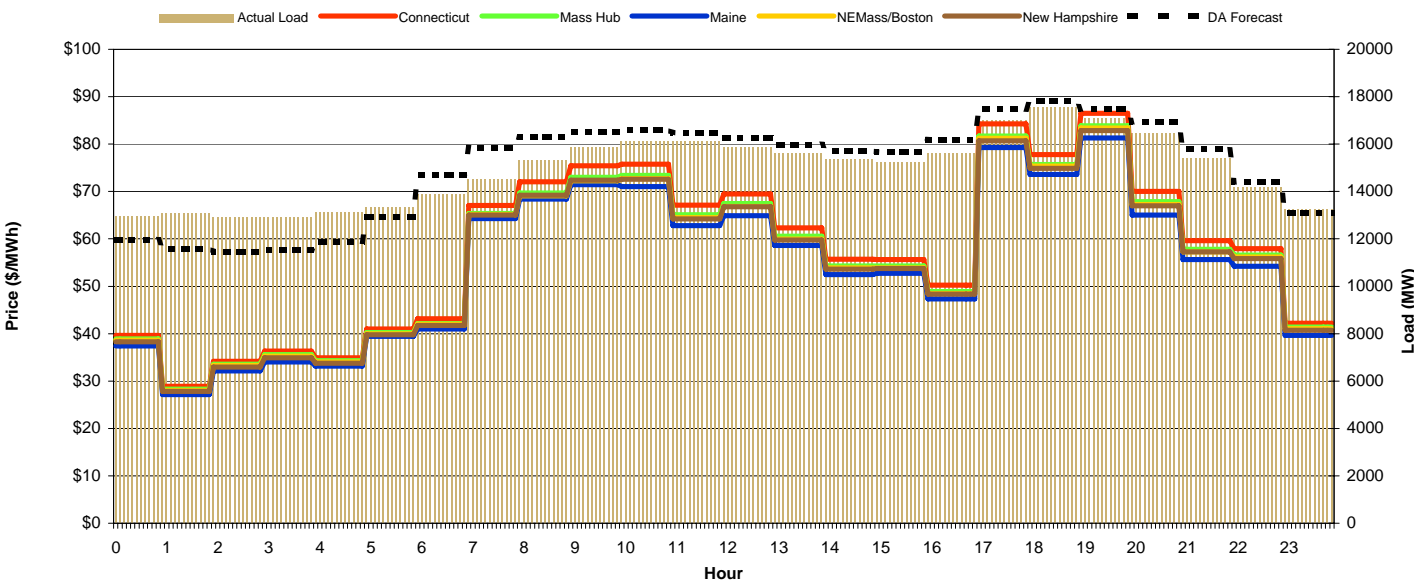




# ISO-NE Daily Report

Tuesday February 16, 2010

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	44.81	43.24	42.07	42.07	44.81	45.31	68.73	74.15	71.52	71.96	70.18	70.30	68.62	64.65	58.07	59.13	65.62	86.58	84.22	74.95	68.62	60.58	56.31	50.05	61.94	69.09	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	43.33	41.81	40.67	40.67	43.33	43.81	66.45	71.69	69.15	69.58	67.86	67.98	66.35	62.51	56.15	57.17	63.45	83.72	81.43	72.46	66.35	58.57	54.44	48.39	59.89	66.80		
<b>New Hampshire</b>	42.85	41.34	40.22	40.22	42.85	43.33	65.72	70.90	68.40	68.86	67.41	67.45	65.76	62.00	55.78	56.77	63.08	82.82	80.54	71.67	65.88	57.95	53.84	47.86	59.31	66.19		
<b>Maine</b>	41.34	39.88	38.80	38.80	41.34	41.80	63.40	68.39	65.61	64.41	62.71	62.82	61.43	58.16	52.75	53.62	58.96	78.96	77.08	68.69	61.43	54.81	51.94	46.17	56.39	62.61		
<b>Mass Hub</b>	43.67	42.13	40.99	40.99	43.67	44.16	66.97	72.25	69.69	70.13	68.38	68.51	66.87	63.00	56.59	57.62	63.94	84.37	82.06	73.03	66.87	59.03	54.87	48.77	60.36	67.33		
<b>Cleared Load (GW)</b>	12.2	12.1	12.2	12.2	12.4	12.9	14.4	15.2	15.6	15.6	15.8	15.5	15.2	15.1	15.0	15.0	15.6	17.0	17.0	16.7	15.8	14.5	13.1	12.3				

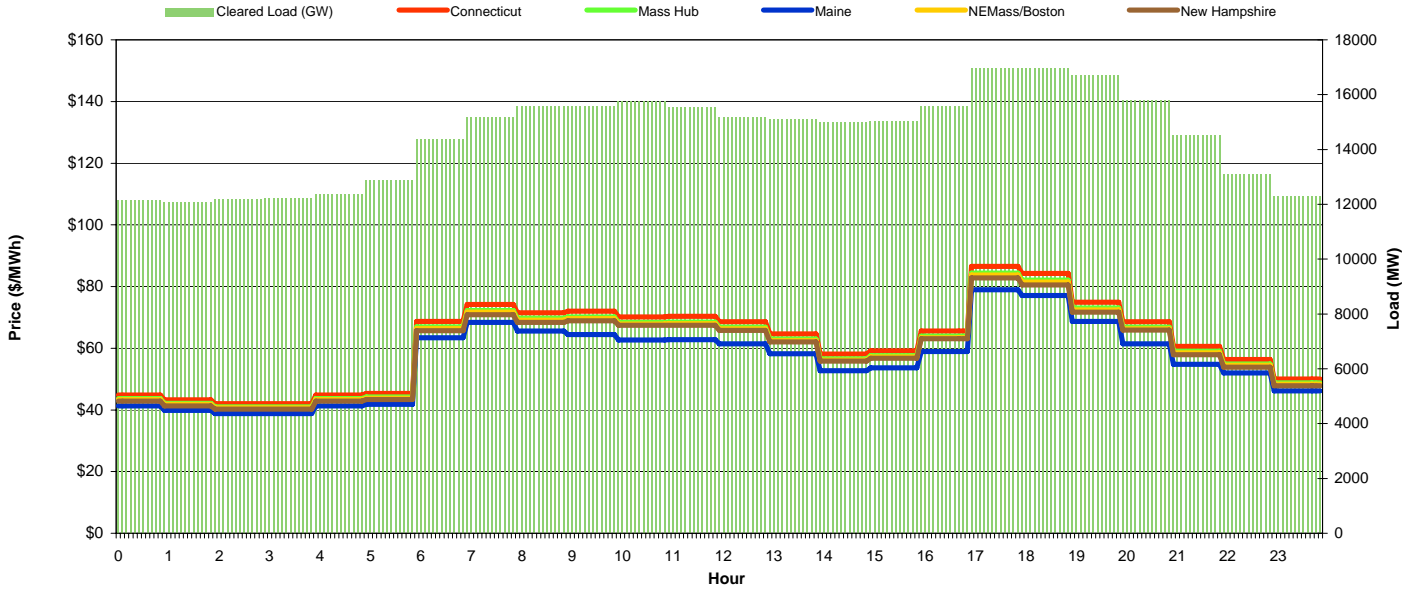

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	46.61	45.33	46.17	43.48	46.70	47.14	68.75	74.85	64.51	78.00	80.43	106.87	122.94	106.52	146.63	113.98	149.49	145.73	62.34	84.31	61.30	56.16	50.79	39.95	78.71	94.05	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	45.31	43.93	44.68	42.11	45.15	45.60	66.43	71.99	61.75	74.95	77.29	102.66	118.18	102.75	141.25	110.28	144.79	140.83	60.58	81.92	58.98	53.84	49.09	38.83	75.97	90.70		
<b>New Hampshire</b>	45.07	43.74	44.51	41.96	44.96	45.43	66.14	71.43	61.23	74.09	76.12	100.94	116.21	101.07	138.90	108.75	142.58	138.43	59.65	80.76	58.26	53.44	48.66	38.45	75.03	89.41		
<b>Maine</b>	44.23	43.00	43.75	41.38	44.49	88.00	66.30	71.07	60.61	72.96	75.04	99.64	114.24	99.68	137.09	107.55	140.07	135.36	58.24	79.04	56.88	52.26	47.85	37.99	75.70	87.97		
<b>Mass Hub</b>	45.76	44.48	45.28	42.66	45.73	46.08	66.87	72.57	62.35	75.57	77.81	103.38	119.13	103.55	142.36	111.14	145.97	141.88	60.94	82.51	59.54	54.38	49.47	39.11	76.61	91.41		
<b>DA Forecast Load (GW)</b>	12.31	11.86	11.72	11.71	12.08	12.96	14.88	16.04	16.50	16.72	16.98	16.94	16.78	16.69	16.58	16.56	17.03	18.23	18.29	17.82	17.14	15.96	14.52	13.20				
<b>Forecast Error %</b>	7.0%	7.9%	7.0%	6.6%	6.1%	4.8%	0.5%	3.0%	5.1%	7.8%	8.6%	11.2%	13.7%	14.1%	13.2%	12.0%	10.2%	7.7%	9.4%	7.6%	8.7%	10.6%	11.9%	10.5%				

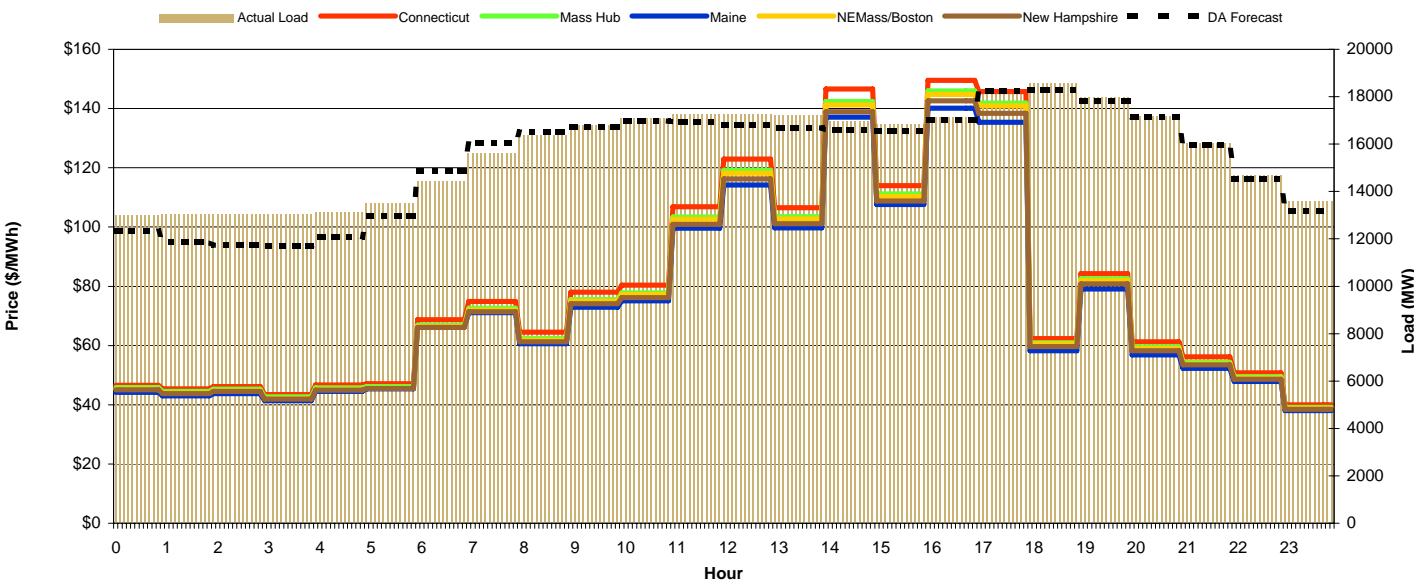






# ISO-NE Daily Report

Wednesday February 17, 2010

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$		
<b>Connecticut</b>	44.35	46.90	45.51	41.15	44.35	45.51	56.79	56.47	57.25	59.42	58.16	57.48	52.43	47.86	47.44	46.85	49.14	59.72	59.78	58.12	52.13	46.44	44.76	43.21	43.21	50.88	53.34
<b>NEMass/Boston</b>	42.88	45.34	44.00	39.78	42.88	44.00	54.91	54.60	54.57	56.58	55.27	54.82	49.74	46.27	45.87	45.29	46.78	55.66	55.67	54.64	49.39	44.48	43.27	41.78	48.69	50.81	50.81
<b>New Hampshire</b>	42.46	44.89	43.57	39.39	42.46	43.57	54.36	54.06	54.02	56.00	54.70	54.26	49.22	45.81	45.41	44.85	46.30	55.07	55.07	54.06	48.88	44.03	42.85	41.37	48.19	50.29	50.29
<b>Maine</b>	41.14	43.50	42.21	38.16	41.14	42.21	52.67	52.38	52.33	54.25	53.00	52.57	47.69	44.39	44.00	43.45	44.85	53.39	53.35	52.37	47.35	42.66	41.51	40.08	46.69	48.72	48.72
<b>Mass Hub</b>	43.22	45.70	44.35	40.09	43.22	44.35	55.34	55.03	54.90	56.91	55.58	55.15	50.00	46.63	46.23	45.65	47.05	55.82	55.83	54.86	49.64	44.77	43.61	42.11	49.00	51.10	51.10
<b>Cleared Load (GW)</b>	12.0	12.5	12.5	12.7	12.8	12.8	15.3	16.1	16.5	16.5	16.5	16.4	16.0	15.4	15.2	15.2	15.9	17.9	17.8	17.4	16.6	15.1	13.5	12.9			

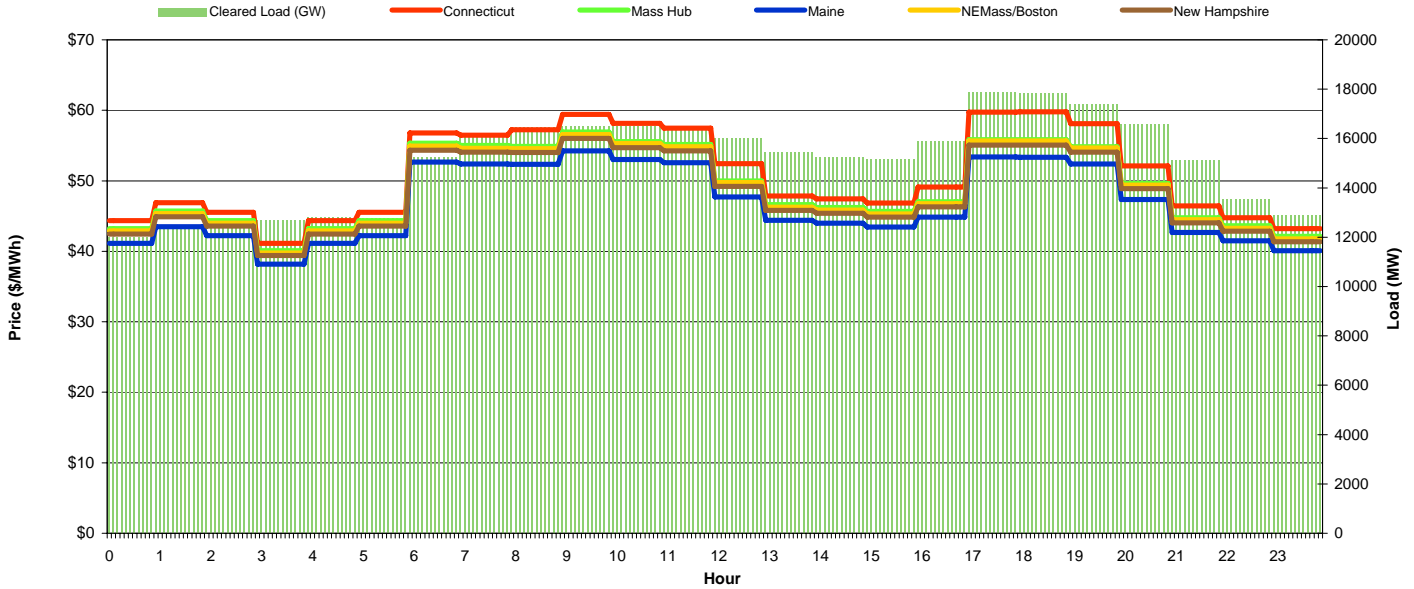

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$		
<b>Connecticut</b>	47.86	42.35	35.82	37.43	43.61	42.73	51.39	53.94	47.15	47.60	49.51	49.75	49.80	48.44	47.24	51.92	52.34	55.68	49.87	52.27	52.18	46.98	42.97	38.29	47.38	49.85	49.85
<b>NEMass/Boston</b>	46.47	41.09	34.74	36.45	42.44	41.65	49.91	52.20	45.41	45.40	47.34	47.82	47.92	46.70	45.69	49.97	50.42	53.62	48.05	50.08	49.91	45.00	41.51	37.10	45.70	47.94	47.94
<b>New Hampshire</b>	46.08	40.69	34.39	36.12	42.06	41.28	49.51	51.66	44.85	44.94	46.93	47.47	47.64	46.46	45.44	49.76	50.20	52.97	47.52	49.60	49.61	44.79	41.07	36.78	45.33	47.56	47.56
<b>Maine</b>	45.51	39.97	33.70	35.68	41.40	88.00	48.26	50.06	43.38	43.38	45.12	45.45	45.63	44.65	43.79	48.00	48.54	51.07	45.82	47.50	47.25	43.11	39.61	36.23	45.88	45.77	45.77
<b>Mass Hub</b>	47.01	41.65	35.21	36.89	42.93	42.00	50.25	52.60	45.83	45.96	47.91	48.36	48.46	47.20	46.14	50.55	50.97	54.10	48.39	50.63	50.50	45.50	41.87	37.41	46.18	48.44	48.44
<b>DA Forecast Load (GW)</b>	12.34	11.92	11.77	11.77	12.15	13.12	15.00	16.28	16.73	16.84	16.84	16.73	16.43	16.24	16.04	16.01	16.37	17.61	17.99	17.62	17.00	15.90	14.54	13.21			
<b>Forecast Error %</b>	14.5%	7.6%	7.3%	5.6%	5.1%	6.8%	-3.0%	-1.9%	-1.3%	-0.5%	0.2%	1.1%	2.6%	6.3%	6.9%	7.0%	4.4%	-1.1%	1.5%	1.2%	2.5%	5.5%	7.9%	5.3%			

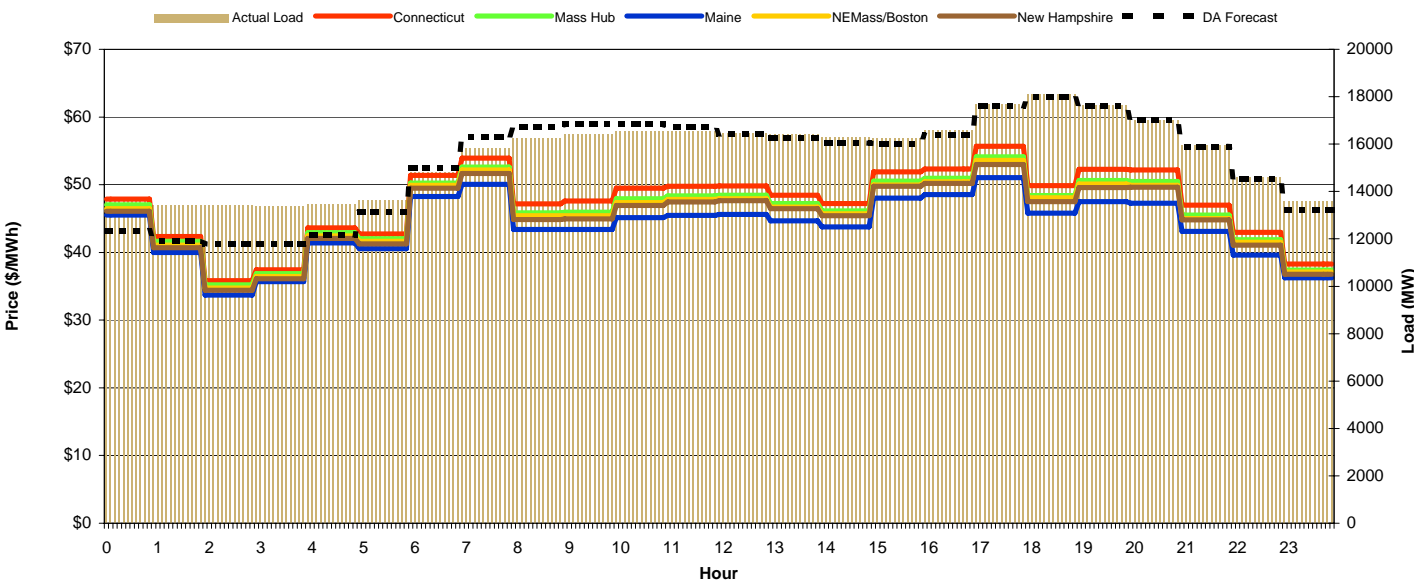




# ISO-NE Daily Report

Thursday February 18, 2010

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	35.99	33.89	31.06	31.07	32.55	37.00	50.54	60.00	50.73	51.47	51.32	49.97	48.32	48.37	46.35	45.30	48.36	65.76	66.05	58.21	49.98	48.17	43.26	38.05	46.74	51.98	All	On Pk
NEMass/Boston	34.83	32.80	30.06	30.06	31.50	35.81	48.91	58.06	48.96	49.67	49.54	48.36	46.76	46.82	44.86	43.84	46.80	63.06	62.96	55.13	47.34	46.62	41.86	36.82	45.06	50.04		
New Hampshire	34.48	32.47	29.76	29.76	31.18	35.45	48.42	57.50	48.47	49.17	49.04	47.87	46.30	46.36	44.42	43.40	46.33	62.42	62.32	54.55	46.85	46.15	41.45	36.45	44.61	49.54		
Maine	33.47	31.52	28.89	28.89	30.27	34.41	47.00	55.18	47.05	47.73	47.60	46.47	44.79	39.42	37.93	42.13	44.91	60.48	59.93	52.95	45.47	44.80	40.23	35.38	42.79	47.32		
Mass Hub	35.10	33.05	30.29	30.30	31.75	36.09	49.29	58.52	49.33	50.04	49.91	48.74	47.13	47.18	45.21	44.18	47.16	63.47	63.32	55.40	47.58	46.98	42.19	37.11	45.39	50.40		
Cleared Load (GW)	12.5	12.4	12.0	12.0	12.6	13.1	14.4	15.0	15.7	15.7	15.6	15.5	15.1	14.9	14.6	14.5	15.1	16.7	16.5	16.6	16.0	14.4	13.0	12.6				

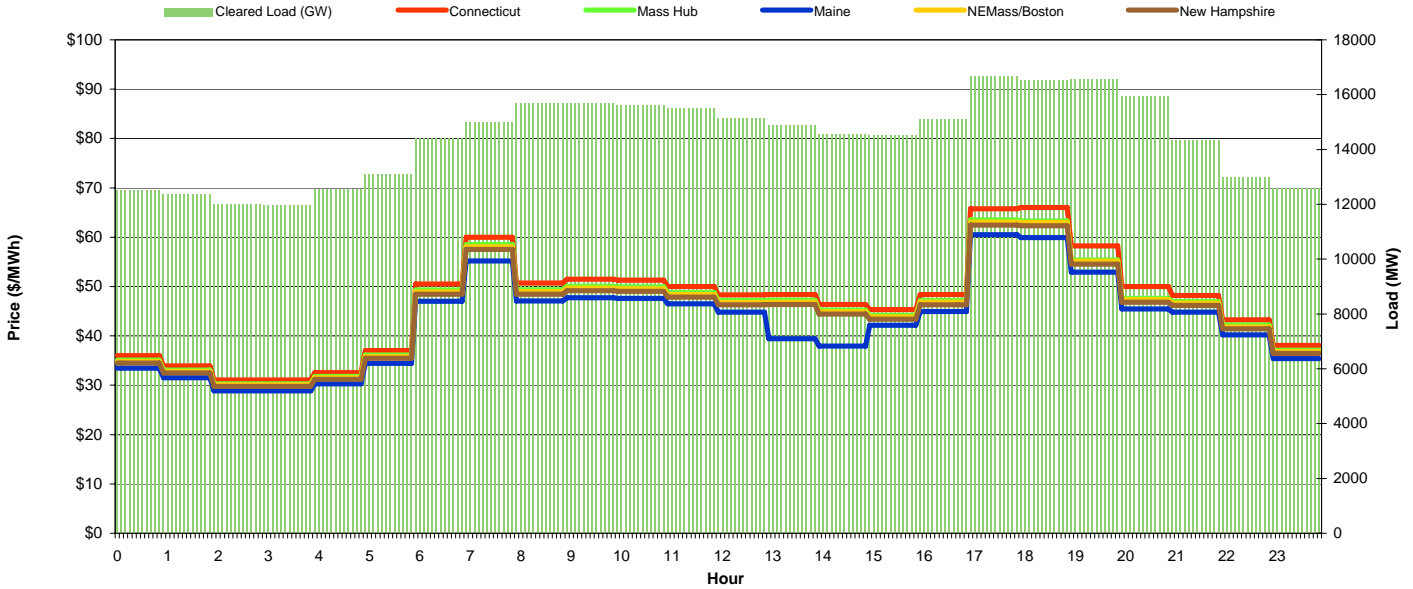

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	42.66	40.02	32.87	37.86	34.48	31.59	50.14	72.66	82.16	85.60	48.38	48.09	46.72	47.49	46.36	45.35	46.71	51.85	52.52	49.48	48.98	47.68	43.14	34.36	48.63	53.95	All	On Pk
NEMass/Boston	41.28	39.03	32.27	37.18	33.83	30.84	45.25	48.13	45.44	46.40	46.73	46.26	44.90	45.56	44.42	43.37	44.68	49.63	50.46	47.57	46.82	45.55	41.47	33.36	42.93	46.09		
New Hampshire	41.19	38.99	32.26	37.17	33.75	30.73	45.09	47.91	45.17	46.20	46.61	46.14	44.82	45.56	44.46	43.35	44.64	49.41	50.25	47.38	46.73	45.56	41.29	33.16	42.83	45.97		
Maine	40.42	38.18	31.56	36.38	33.07	88.00	43.70	45.76	42.93	43.96	44.64	43.94	42.68	39.31	40.80	41.57	42.67	47.23	47.86	45.24	44.40	43.55	39.52	32.38	43.32	43.50		
Mass Hub	41.76	39.46	32.61	37.57	34.17	31.11	45.55	48.50	45.92	46.97	47.28	46.86	45.47	46.15	44.98	43.94	45.24	50.21	50.98	48.09	47.41	46.12	41.93	33.64	43.41	46.63		
DA Forecast Load (GW)	12.39	11.96	11.78	11.78	12.16	13.27	15.20	16.21	16.43	16.51	16.49	16.33	16.15	16.05	15.85	15.78	16.20	17.47	17.91	17.56	16.98	15.95	14.60	13.26				
Forecast Error %	6.1%	6.3%	7.3%	7.2%	4.3%	3.1%	0.7%	4.7%	2.8%	3.6%	4.3%	4.6%	5.5%	6.1%	7.2%	6.7%	4.7%	1.7%	6.8%	4.7%	4.9%	10.0%	11.6%	5.6%				

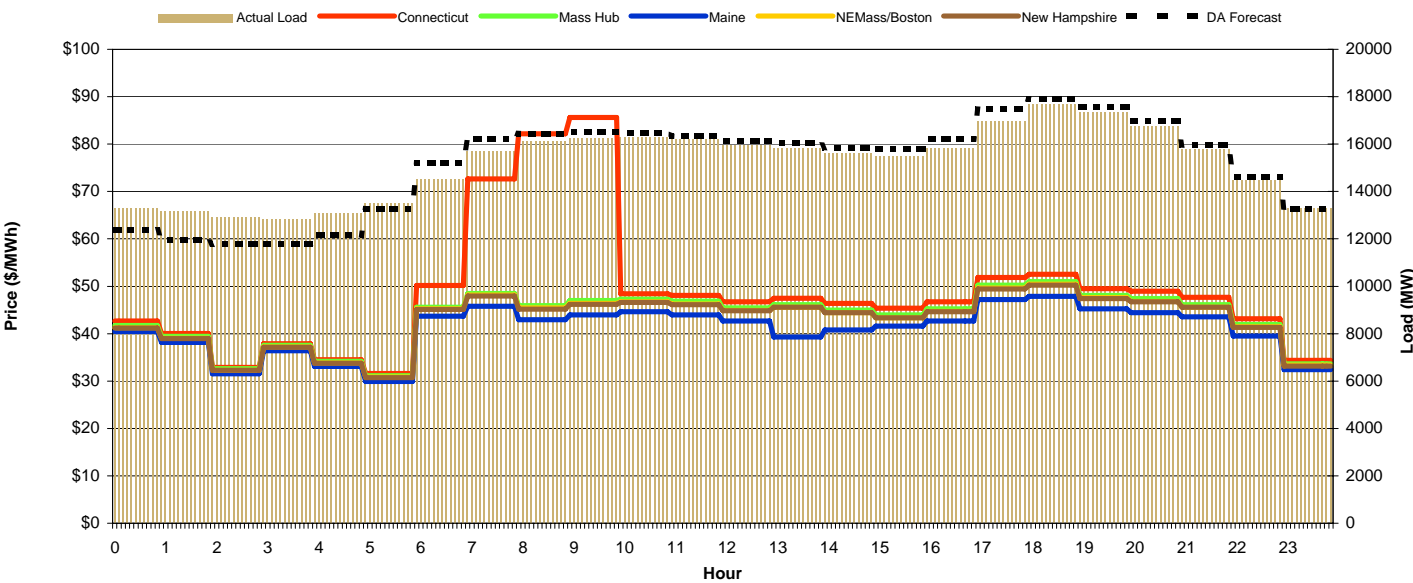




# ISO-NE Daily Report

Friday February 19, 2010

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$				
Connecticut	39.84	34.60	33.89	33.89	33.89	39.00	48.98	50.19	50.66	52.66	51.88	52.39	50.31	48.99	48.00	46.73	48.26	55.55	55.72	51.06	50.39	49.16	47.77	46.62	46.62	46.68	50.61	All	On Pk
NEMass/Boston	38.59	33.52	32.83	32.83	32.83	37.78	47.44	48.62	49.08	51.01	50.26	50.75	48.74	47.46	46.49	45.27	46.75	52.85	53.05	48.37	48.38	47.63	46.28	45.17	45.08	48.81			
New Hampshire	38.23	33.20	32.52	32.52	32.52	37.43	47.00	48.17	48.63	50.55	49.80	50.29	48.30	47.03	46.06	44.85	46.31	52.33	52.53	47.89	47.92	47.18	45.85	44.74	44.66	48.36			
Maine	37.15	32.26	31.60	31.60	31.60	36.37	45.67	46.72	47.01	48.66	48.00	48.29	46.29	45.19	44.76	43.53	45.00	50.85	51.04	46.53	46.56	45.84	44.55	43.48	43.27	46.80			
Mass Hub	38.89	33.78	33.09	33.09	33.09	38.07	47.81	49.00	49.46	51.41	50.65	51.15	49.12	47.83	46.86	45.62	47.11	53.13	53.34	48.60	48.70	47.99	46.64	45.52	45.41	49.16			
Cleared Load (GW)	11.8	11.7	11.7	11.7	11.9	12.3	14.3	15.2	15.4	15.3	15.4	15.1	15.0	14.9	14.6	14.5	14.9	16.2	16.3	16.2	15.4	14.2	12.9	12.0					

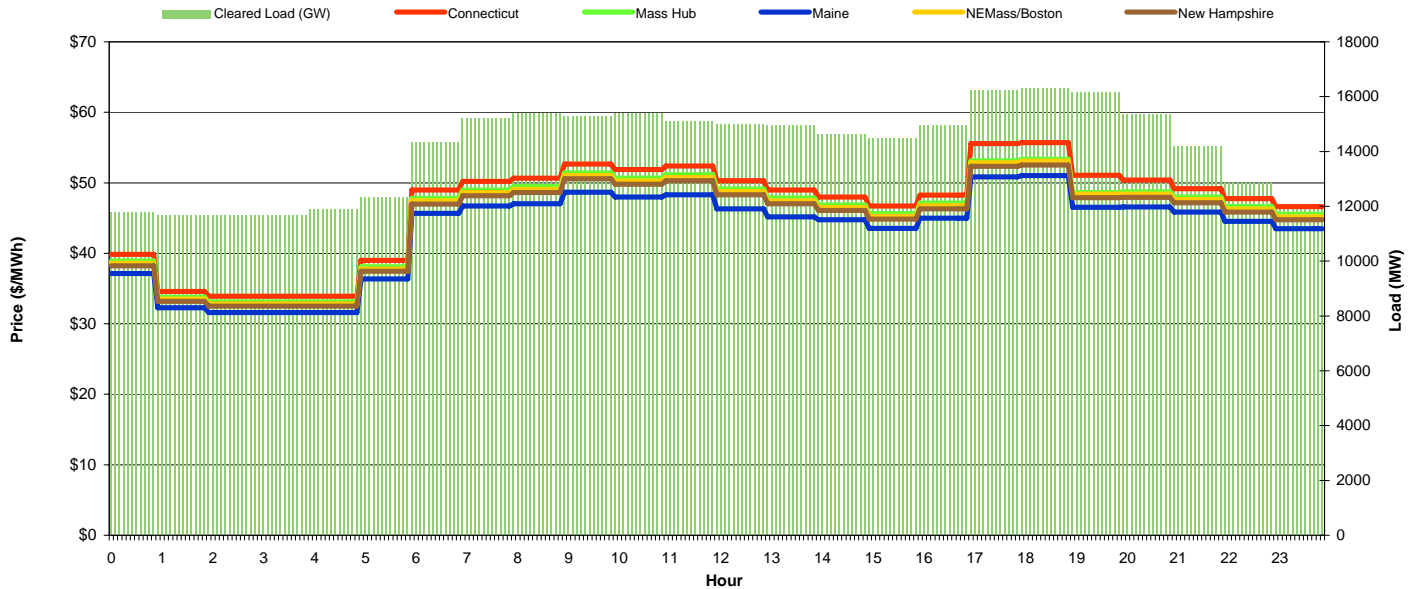

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	36.89	34.26	37.22	30.09	31.96	32.90	42.69	49.18	47.13	48.36	47.94	48.94	46.40	45.34	43.68	44.19	42.98	44.43	46.09	46.40	45.36	44.50	45.37	37.37	42.49	46.02	All	On Pk
NEMass/Boston	35.91	33.39	36.30	29.52	31.43	32.32	41.84	47.86	45.52	46.74	46.31	47.09	44.67	43.94	42.23	42.66	41.66	43.00	44.72	44.77	43.62	42.79	43.92	36.56	41.20	44.47		
New Hampshire	35.74	33.19	36.24	29.46	31.33	32.12	41.55	47.50	45.29	46.48	46.02	46.90	44.46	43.65	41.97	42.41	41.49	42.75	44.47	44.51	43.52	42.72	43.75	36.37	41.00	44.24		
Maine	35.23	32.68	35.60	28.99	30.98	32.60	40.25	45.91	43.80	44.71	43.97	44.43	42.33	41.57	40.15	40.59	39.82	41.21	42.75	42.57	41.37	40.83	41.79	35.33	41.87	42.36		
Mass Hub	36.22	33.74	36.72	29.84	31.75	32.60	42.11	48.26	46.05	47.29	46.85	47.70	45.22	44.37	42.62	43.06	41.98	43.25	44.95	45.16	44.08	43.26	44.32	36.77	41.59	44.90		
DA Forecast Load (GW)	12.34	11.88	11.68	11.68	12.01	13.02	14.72	15.88	16.37	16.52	16.56	16.44	16.20	16.02	15.80	15.77	16.16	17.13	17.57	17.06	16.43	15.62	14.56	13.41				
Forecast Error %	6.9%	6.1%	5.9%	7.1%	5.8%	6.6%	0.5%	2.1%	5.1%	6.9%	6.6%	8.0%	7.3%	6.3%	7.1%	7.0%	5.1%	2.6%	5.6%	3.8%	5.5%	8.3%	10.6%	9.3%				

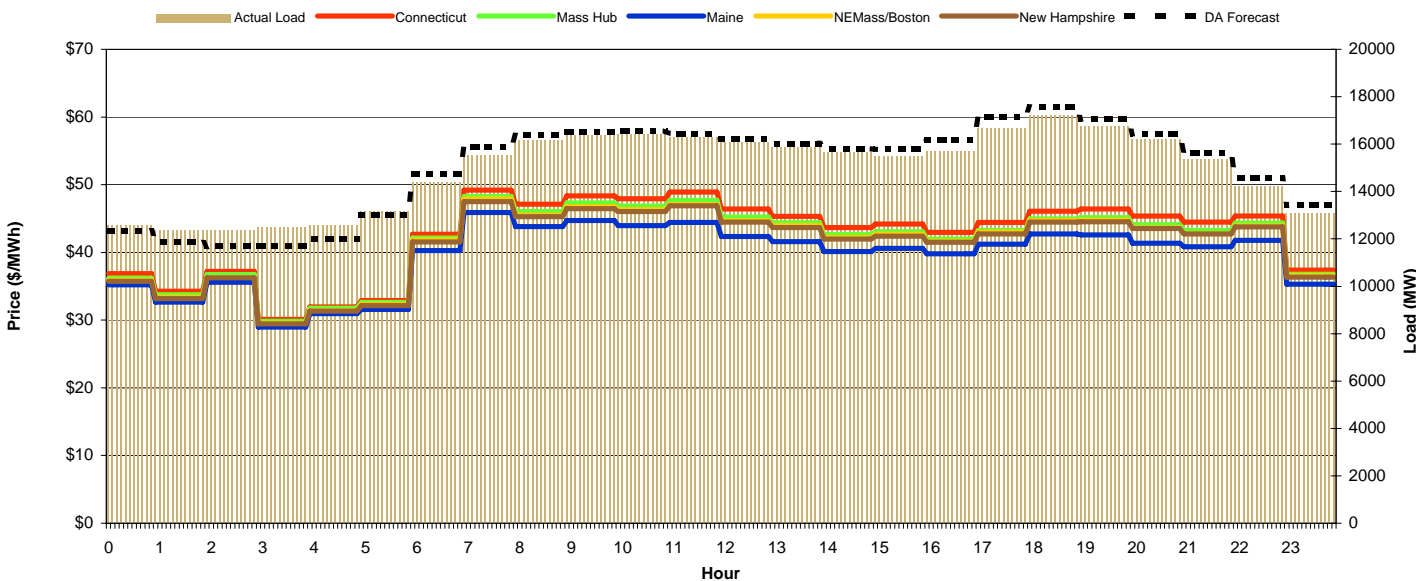




# ISO-NE Daily Report

Saturday February 20, 2010

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	37.20	40.12	34.71	32.60	34.71	37.05	39.61	40.67	46.21	52.39	50.08	47.90	47.46	43.66	41.57	41.40	46.48	53.21	57.12	53.55	50.61	46.12	44.43	42.00	44.20	47.68	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	36.04	38.87	33.63	31.58	33.63	35.89	38.38	39.41	44.77	50.77	48.53	46.42	45.99	42.31	40.28	40.11	45.04	51.56	55.08	51.89	48.91	44.69	43.05	40.70	42.81	46.18		
<b>New Hampshire</b>	35.75	38.55	33.36	31.33	33.36	35.60	38.07	39.09	44.41	50.35	48.13	46.04	45.62	41.96	39.95	39.78	44.67	51.14	54.62	51.47	48.52	44.32	42.70	40.36	42.46	45.80		
<b>Maine</b>	34.73	37.46	32.41	30.44	32.41	34.59	36.99	37.98	43.15	48.92	46.77	44.73	44.32	40.77	38.82	38.66	43.40	49.69	53.07	50.01	47.14	43.06	41.49	39.22	41.26	44.50		
<b>Mass Hub</b>	36.33	39.18	33.90	31.84	33.90	36.18	38.70	39.73	45.14	51.18	48.92	46.79	46.36	42.65	40.60	40.44	45.40	51.98	55.48	52.31	49.33	45.05	43.40	41.02	43.16	46.55		
<b>Cleared Load (GW)</b>	11.4	11.6	11.2	10.8	11.1	11.3	11.6	12.8	14.3	14.8	14.6	14.5	14.3	13.8	13.5	13.5	14.1	15.4	15.6	15.3	14.8	14.0	12.8	12.1				

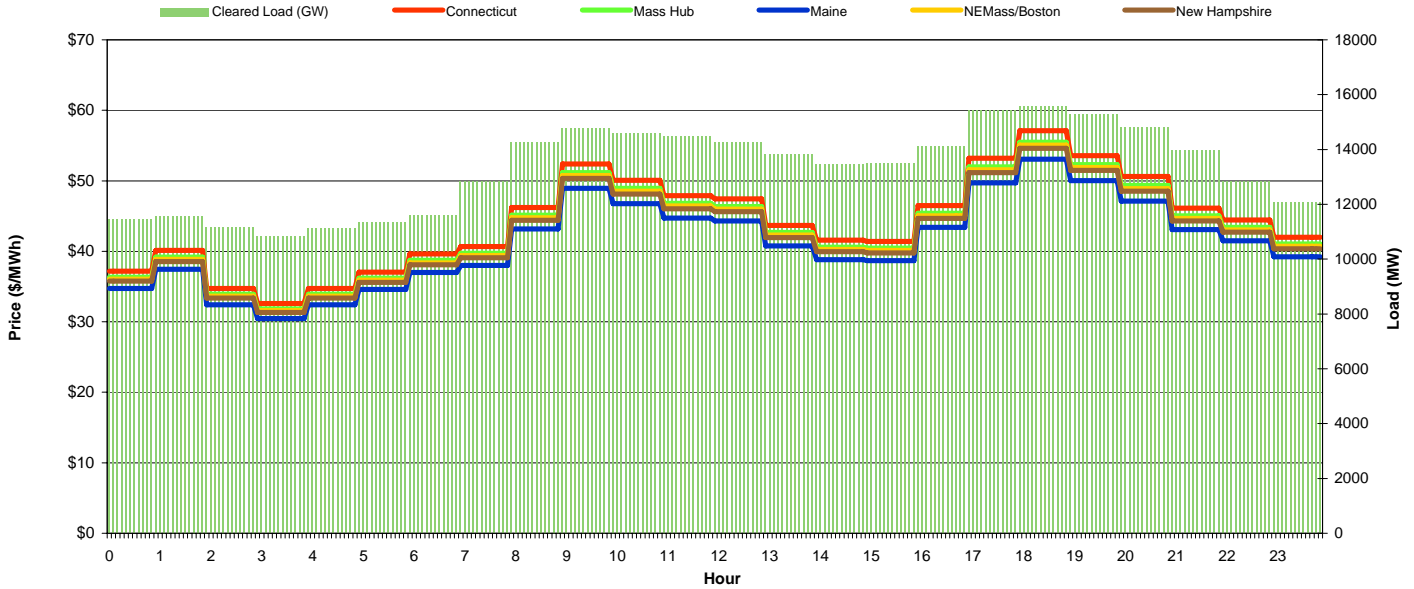

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	38.47	34.31	32.42	35.67	36.91	39.69	41.02	50.93	43.34	45.61	44.91	49.43	42.75	40.00	38.56	38.26	40.42	48.24	50.60	46.52	43.80	43.34	41.47	33.94	41.69	44.26	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	37.74	33.56	31.70	34.91	36.05	38.83	40.17	49.71	42.04	44.14	43.52	47.96	41.47	39.02	37.66	37.33	39.33	47.23	49.36	45.23	42.43	41.99	40.37	33.25	40.63	43.05		
<b>New Hampshire</b>	37.54	33.38	31.58	34.78	35.96	38.70	40.00	49.48	41.81	43.77	43.13	47.62	41.21	38.70	37.31	37.01	39.04	46.74	48.92	44.86	42.20	41.86	40.09	32.99	40.36	42.73		
<b>Maine</b>	36.72	32.70	30.85	33.94	35.12	38.00	38.94	47.46	39.81	41.43	40.89	44.78	39.08	36.81	35.57	35.27	37.27	44.60	46.63	42.72	40.09	40.14	38.56	32.04	40.81	40.69		
<b>Mass Hub</b>	37.89	33.76	31.91	35.14	36.31	39.06	40.37	49.96	42.32	44.48	43.83	48.31	41.74	39.21	37.85	37.52	39.54	47.29	49.48	45.40	42.63	42.28	40.60	33.40	40.85	43.28		
<b>DA Forecast Load (GW)</b>	12.29	11.76	11.47	11.38	11.48	11.87	12.45	13.23	14.31	14.94	15.15	15.05	14.75	14.40	14.17	14.12	14.51	15.63	16.12	15.71	15.29	14.63	13.79	12.80				
<b>Forecast Error %</b>	6.5%	3.3%	4.6%	7.0%	5.0%	6.4%	8.0%	2.7%	-1.1%	-0.8%	1.8%	1.9%	1.3%	1.9%	2.4%	1.4%	-0.8%	-1.6%	2.2%	1.8%	1.9%	3.1%	4.8%	4.5%				

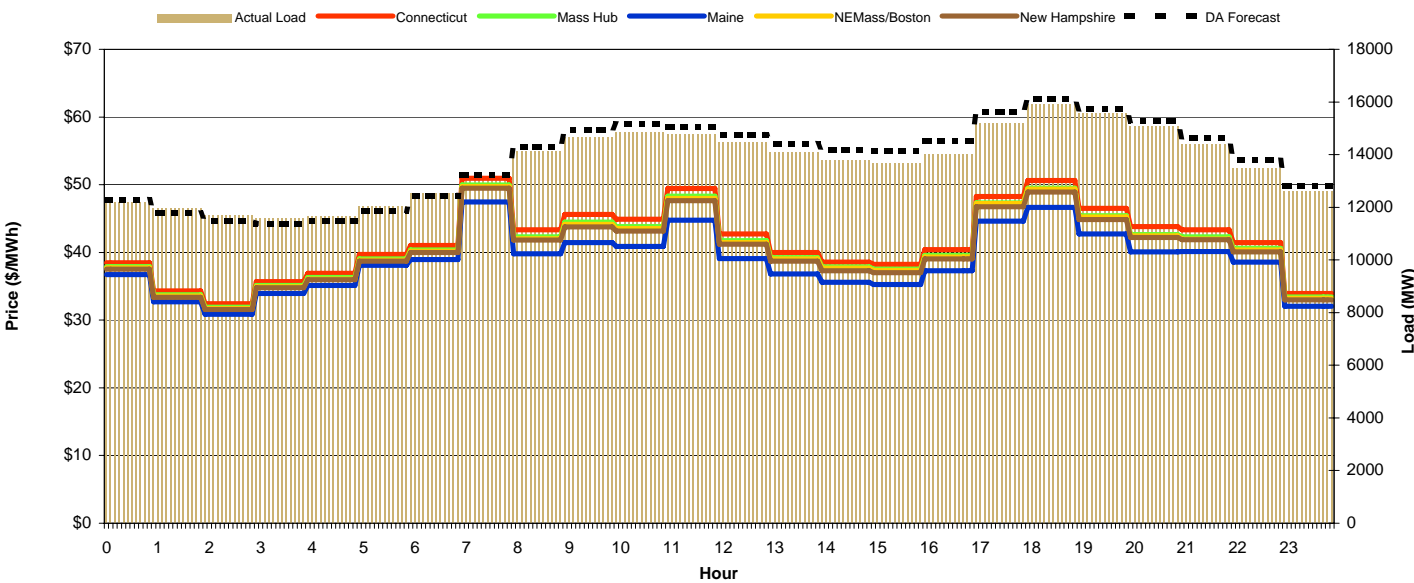




# ISO-NE Daily Report

Sunday February 21, 2010

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
	All	On Pk																										
<b>Connecticut</b>	39.50	35.20	32.56	34.65	32.56	34.67	34.67	37.16	37.07	41.06	44.29	44.67	46.13	44.67	41.62	40.59	45.53	59.93	63.81	60.06	57.79	46.44	42.81	39.23	43.19	47.10	43.90	48.47
<b>NEMass/Boston</b>	38.26	34.10	31.54	33.57	31.54	33.58	33.58	31.80	35.91	39.78	42.90	43.28	44.69	43.28	40.31	39.33	44.11	58.06	61.81	58.18	55.98	44.99	41.47	38.00	41.67	45.37	42.89	47.33
<b>New Hampshire</b>	37.99	33.85	31.31	33.33	31.31	33.34	33.34	31.57	35.65	39.49	42.59	42.96	44.36	42.96	40.02	39.04	43.79	57.64	61.36	57.76	55.57	44.67	41.17	37.72	41.37	45.04	42.70	47.10
<b>Maine</b>	36.91	32.89	30.42	32.38	30.42	32.40	32.40	30.64	34.64	38.37	41.39	41.75	43.11	41.75	38.89	37.93	42.55	56.01	59.63	56.13	54.00	43.40	40.00	36.66	40.19	43.76	43.61	45.42
<b>Mass Hub</b>	38.58	34.38	31.80	33.85	31.80	33.86	33.86	32.08	36.21	40.11	43.26	43.64	45.06	43.64	40.65	39.65	44.47	58.54	62.32	58.66	56.44	45.36	41.81	38.31	42.01	45.74	43.15	47.58
<b>Cleared Load (GW)</b>	11.6	11.3	11.3	11.2	11.2	11.6	11.6	12.5	13.1	13.7	13.9	14.1	14.0	13.7	13.6	13.5	14.2	15.6	15.7	15.4	14.7	13.8	12.7	11.8				

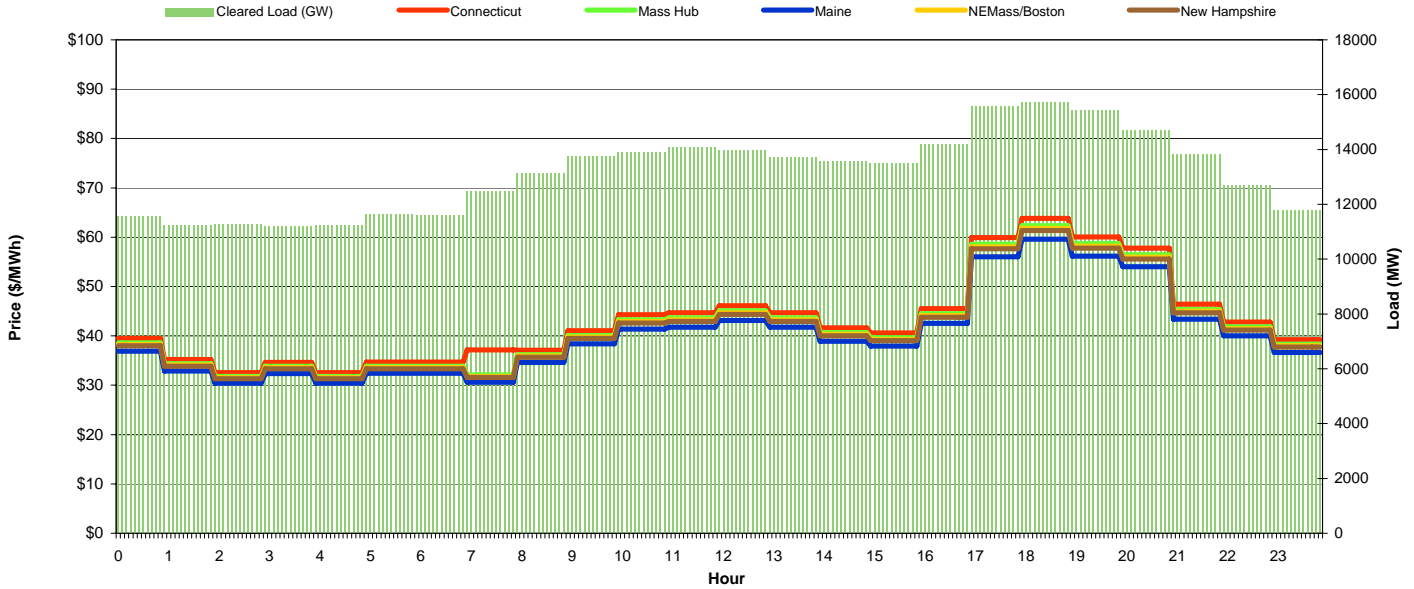

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
	All	On Pk																										
<b>Connecticut</b>	33.82	33.57	34.33	34.22	33.53	34.59	36.92	35.08	42.69	47.67	45.69	42.77	44.60	44.85	40.51	41.86	46.40	53.75	93.07	50.50	52.00	52.68	41.34	37.26	43.90	48.47	43.90	48.47
<b>NEMass/Boston</b>	33.06	32.81	33.46	33.35	32.80	33.94	36.12	34.50	41.70	46.20	44.30	41.74	43.61	43.79	39.64	41.11	45.31	52.31	91.23	49.56	50.88	51.18	40.23	36.49	42.89	47.33	42.89	47.33
<b>New Hampshire</b>	32.86	32.68	33.36	33.27	32.75	33.89	35.97	34.39	41.60	46.16	44.14	41.51	43.47	43.70	39.47	40.91	45.20	51.93	90.52	49.10	50.59	51.00	39.97	36.32	42.70	47.10	42.70	47.10
<b>Maine</b>	32.13	31.84	32.61	32.56	32.13	88.00	35.07	33.34	40.20	44.40	42.35	39.91	41.96	42.33	38.36	39.78	43.93	49.92	86.86	47.25	48.37	49.19	38.55	35.55	43.61	45.42	43.61	45.42
<b>Mass Hub</b>	33.27	33.07	33.78	33.68	33.11	34.21	36.41	34.67	41.94	46.62	44.70	42.01	43.90	44.10	39.85	41.27	45.60	52.54	91.40	49.61	51.05	51.52	40.48	36.70	43.15	47.58	43.15	47.58
<b>DA Forecast Load (GW)</b>	11.92	11.44	11.17	11.07	11.13	11.42	11.83	12.39	13.30	14.11	14.42	14.53	14.44	14.19	14.01	14.01	14.49	15.73	16.40	16.16	15.67	14.74	13.64	12.55				
<b>Forecast Error %</b>	3.9%	6.0%	4.3%	4.4%	6.1%	3.3%	6.2%	1.5%	1.3%	2.0%	3.1%	2.8%	2.9%	3.3%	3.0%	3.2%	1.6%	1.5%	6.4%	6.7%	7.8%	7.8%	7.9%	8.7%				

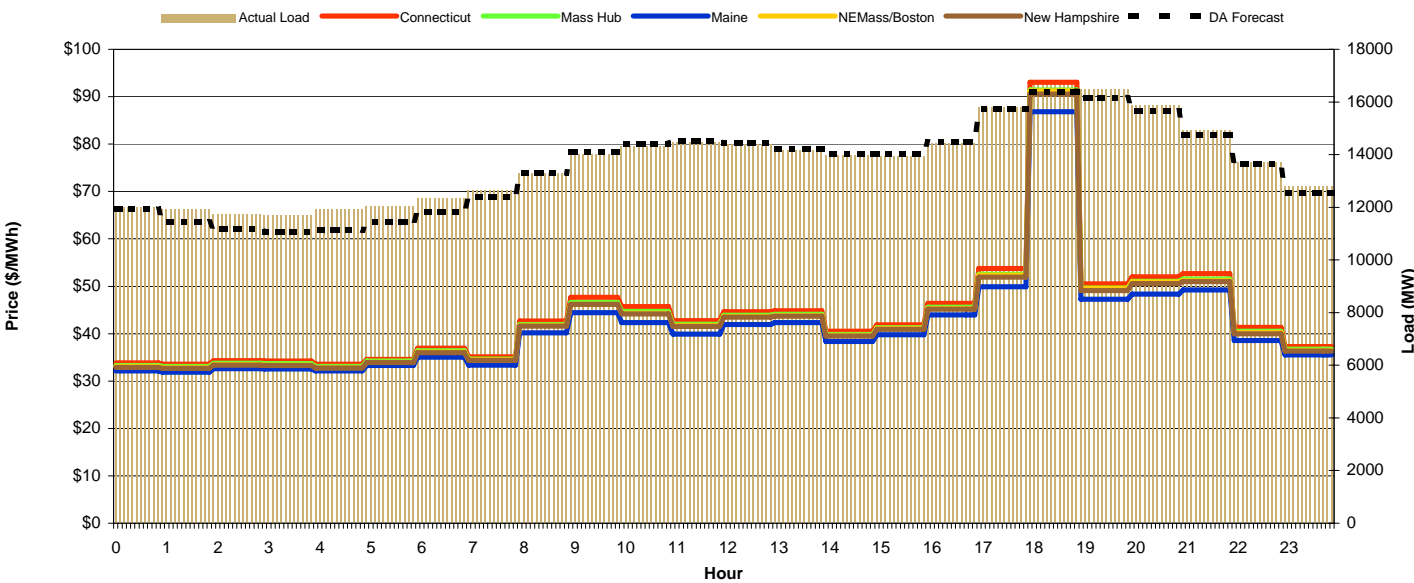




# ISO-NE Daily Report

Monday February 22, 2010

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	33.87	32.81	32.60	32.60	32.81	37.39	51.15	56.26	53.22	53.11	57.08	52.00	49.20	48.28	45.30	44.59	46.50	62.41	69.18	60.00	58.36	48.00	43.91	34.73	47.31	52.96	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	32.85	31.83	31.62	31.62	31.83	36.27	49.61	54.58	51.63	51.52	55.36	50.44	47.73	46.57	43.59	43.26	44.62	59.24	64.80	57.39	56.61	46.40	42.59	33.69	45.65	51.02		
<b>New Hampshire</b>	32.63	31.61	31.41	31.41	31.61	36.02	49.28	54.20	51.27	51.17	54.99	50.10	47.40	46.25	43.28	42.96	44.31	58.82	64.36	56.98	56.22	46.08	42.30	33.46	45.34	50.67		
<b>Maine</b>	31.69	30.70	30.50	30.50	30.70	34.98	47.86	52.64	49.80	49.69	53.40	48.65	46.04	44.92	42.03	41.72	43.03	57.12	62.49	55.34	54.60	44.75	41.08	32.49	44.03	49.21		
<b>Mass Hub</b>	33.11	32.08	31.87	31.87	32.08	36.55	50.00	55.00	52.03	51.92	55.80	50.83	48.10	46.90	43.88	43.59	44.91	59.61	65.31	57.75	57.05	46.74	42.92	33.95	45.99	51.40		
<b>Cleared Load (GW)</b>	11.8	11.8	11.7	11.7	11.9	12.3	13.6	15.2	15.4	15.4	15.3	15.2	15.1	15.1	14.8	14.8	15.3	16.6	16.7	16.6	15.5	14.4	13.1	12.2				

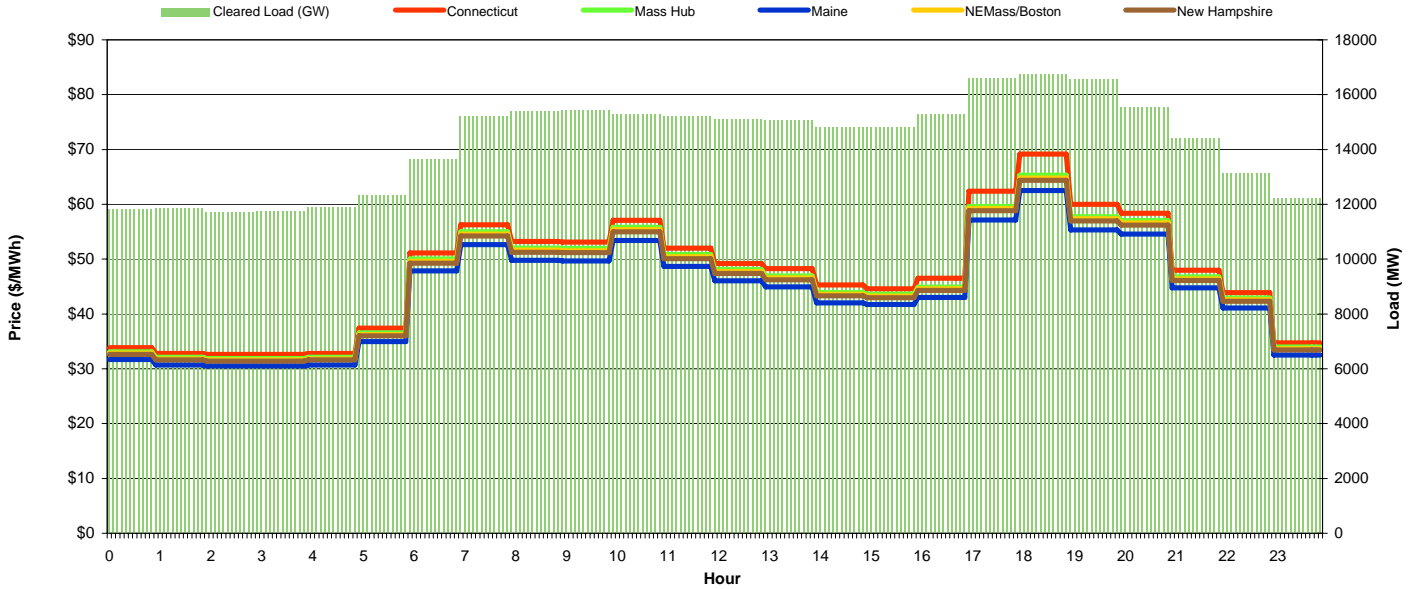

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	32.16	33.91	36.84	33.81	31.36	34.21	53.94	49.97	51.25	52.39	52.29	46.02	43.95	44.14	43.19	43.56	47.65	71.96	78.87	50.06	52.32	42.81	36.58	32.57	45.66	50.44	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	31.52	33.23	36.03	33.16	31.02	33.93	52.75	48.18	49.22	50.25	50.37	44.45	42.43	42.56	41.80	42.13	46.22	70.20	76.85	48.54	50.40	41.11	35.51	31.86	44.31	48.75		
<b>New Hampshire</b>	31.36	33.10	35.98	33.10	30.92	33.83	52.84	47.85	48.85	49.92	50.22	44.43	42.39	42.50	41.53	42.07	46.07	69.74	76.26	48.10	50.13	40.97	35.23	31.66	44.13	48.52		
<b>Maine</b>	30.60	32.29	35.11	32.37	30.38	38.00	52.11	46.21	46.91	47.90	47.98	42.73	40.85	40.89	39.97	40.87	45.01	68.47	74.08	46.43	47.86	39.28	33.94	31.05	45.05	46.84		
<b>Mass Hub</b>	31.73	33.52	36.38	33.43	31.22	34.07	53.12	48.66	49.77	50.83	50.90	44.91	42.86	43.00	42.06	42.53	46.64	70.45	77.16	48.83	50.89	41.57	35.77	32.06	44.68	49.18		
<b>DA Forecast Load (GW)</b>	11.73	11.34	11.22	11.27	11.64	12.72	14.59	15.71	16.16	16.26	16.36	16.27	16.05	15.83	15.59	15.47	15.88	17.09	17.70	17.32	16.65	15.47	14.03	12.75				
<b>Forecast Error %</b>	6.5%	5.9%	5.9%	6.2%	7.0%	8.4%	9.0%	4.9%	5.4%	4.8%	5.7%	5.1%	4.1%	3.3%	3.6%	3.1%	2.9%	2.0%	5.1%	3.8%	6.4%	6.9%	6.9%	5.7%				

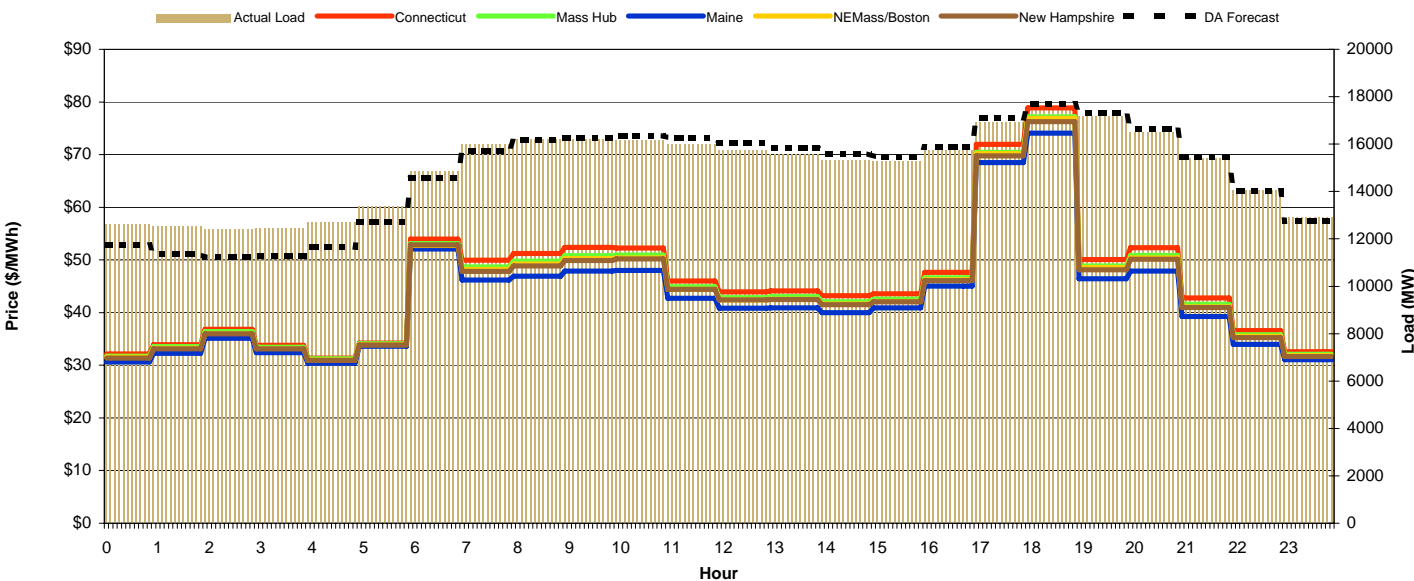




# ISO-NE Daily Report

Tuesday February 23, 2010

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	35.00	33.92	34.76	34.51	34.76	33.86	45.67	52.03	52.61	56.59	53.83	56.68	56.42	52.96	49.00	49.00	50.86	64.22	65.00	55.90	53.18	45.96	43.98	39.16	47.91	53.64	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	33.96	32.92	33.73	33.48	33.73	32.85	44.31	50.49	51.04	54.91	52.23	55.00	54.75	51.39	47.54	47.54	49.35	62.31	63.07	54.24	51.60	44.43	42.67	38.00	46.48	52.04		
<b>New Hampshire</b>	33.75	32.71	33.52	33.28	33.52	32.65	44.04	50.18	50.73	54.57	51.91	54.66	54.41	51.07	47.25	47.25	49.05	61.93	62.68	53.91	51.29	44.16	42.41	37.77	46.20	51.72		
<b>Maine</b>	32.78	31.77	32.55	32.32	32.55	31.71	42.77	48.73	49.27	53.00	50.41	53.08	52.84	49.60	45.89	45.89	47.63	60.14	60.88	52.35	49.81	42.88	41.19	36.68	44.86	50.22		
<b>Mass Hub</b>	34.23	33.18	33.99	33.75	33.99	33.11	44.66	50.89	51.45	55.35	52.64	55.44	55.18	51.79	47.92	47.92	49.74	62.81	63.57	54.67	52.01	44.77	43.01	38.30	46.85	52.45		
<b>Cleared Load (GW)</b>	11.5	11.7	11.5	11.4	11.9	11.9	14.2	15.5	15.4	15.5	15.7	15.5	15.2	15.2	15.0	15.0	15.7	17.0	17.0	17.0	16.1	14.6	13.0	12.1				

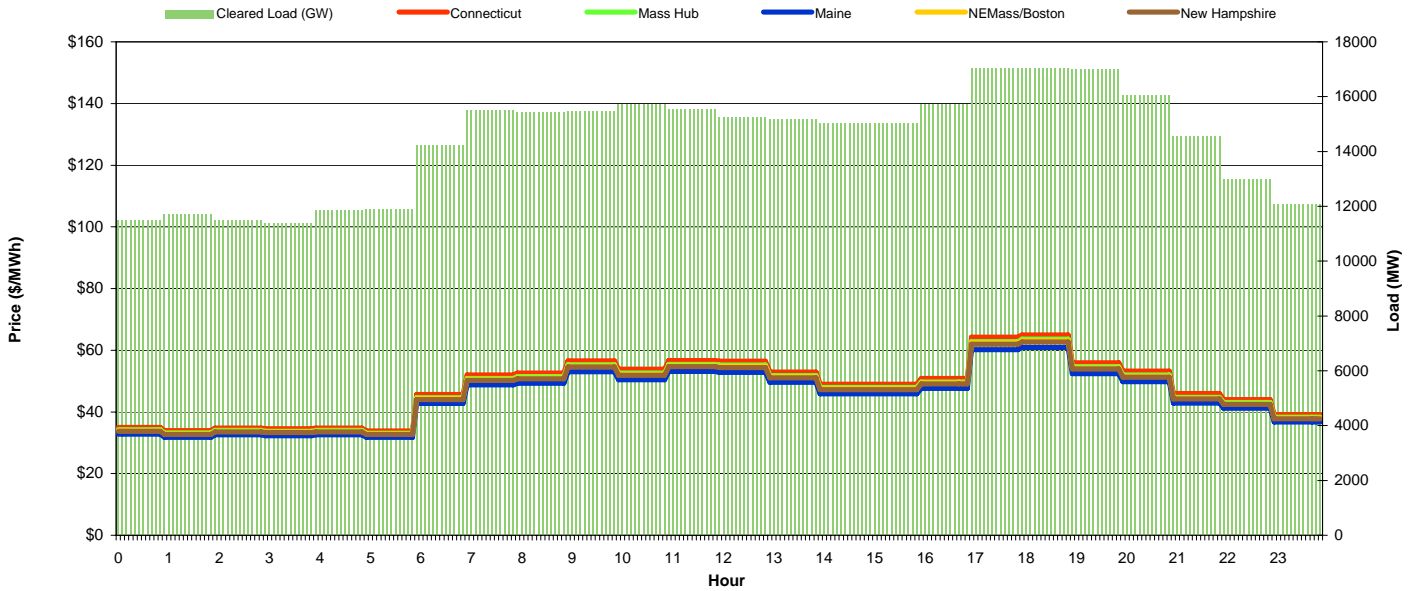

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	33.31	32.64	34.29	31.25	31.26	32.67	52.05	44.05	51.22	50.41	54.55	60.32	49.44	47.91	56.21	59.09	61.14	153.87	68.31	115.08	94.58	46.36	44.34	34.95	55.80	66.06	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	32.61	31.99	33.56	30.64	30.68	32.19	51.17	42.78	49.20	47.88	51.77	57.29	47.26	45.98	53.77	56.71	59.05	149.76	66.65	57.87	56.24	44.70	42.82	33.99	50.27	58.11		
<b>New Hampshire</b>	32.40	31.78	33.43	30.54	30.51	31.97	50.97	42.45	48.84	47.62	51.49	57.10	47.07	45.84	53.57	56.52	58.69	148.19	65.97	57.07	55.71	44.57	42.56	33.68	49.94	57.70		
<b>Maine</b>	31.81	31.21	32.82	29.96	30.01	32.46	51.46	42.44	48.59	47.20	50.72	56.02	45.97	44.77	52.42	55.66	58.06	147.93	65.53	56.33	54.69	44.15	42.02	33.20	51.71	57.03		
<b>Mass Hub</b>	32.89	32.34	33.96	30.99	31.03	32.46	51.43	43.07	49.69	48.53	52.51	57.99	47.77	46.49	54.35	57.27	59.51	150.28	66.87	58.29	56.77	45.14	43.23	34.29	50.71	58.61		
<b>DA Forecast Load (GW)</b>	11.86	11.43	11.24	11.21	11.57	12.65	14.67	15.92	16.29	16.45	16.57	16.58	16.43	16.37	16.26	16.25	16.69	17.78	18.16	17.65	16.88	15.68	14.24	12.86				
<b>Forecast Error %</b>	7.7%	6.1%	6.9%	9.3%	7.4%	10.9%	2.5%	2.0%	5.1%	6.0%	5.4%	7.5%	9.0%	8.9%	9.0%	9.7%	8.2%	5.8%	7.1%	4.2%	5.5%	8.3%	10.4%	9.2%				

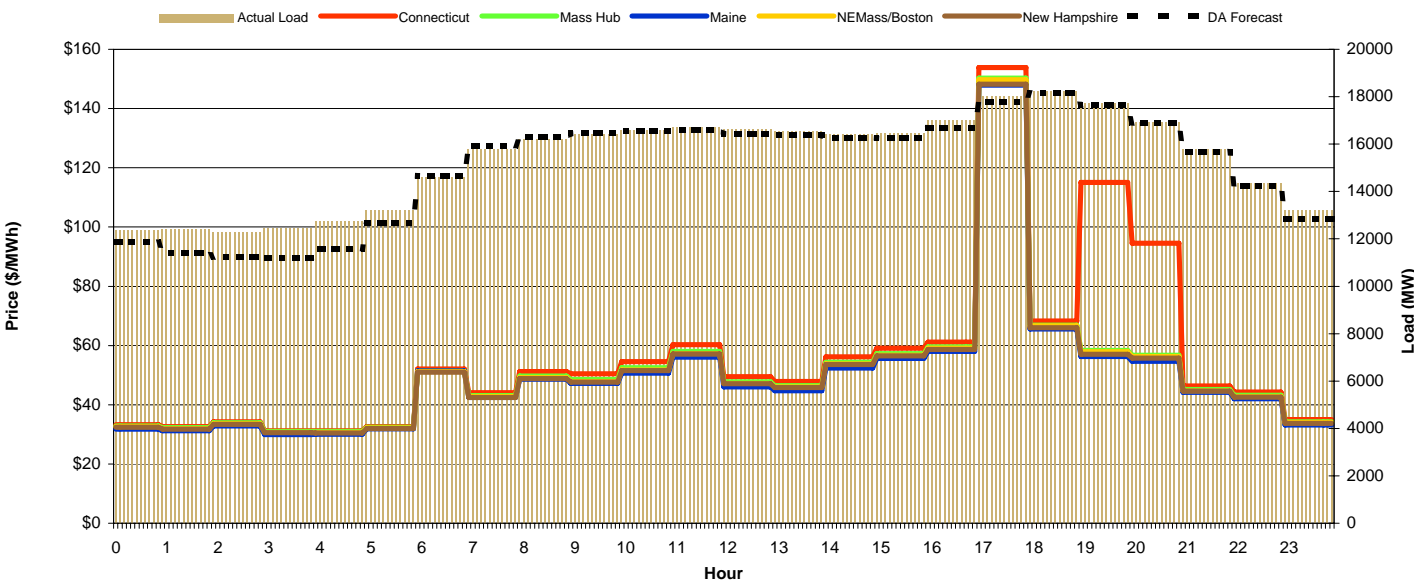




# ISO-NE Daily Report

Wednesday February 24, 2010

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	36.86	36.17	35.78	32.05	31.54	34.72	42.56	46.05	45.02	46.44	48.17	51.02	47.79	46.85	45.23	43.91	47.04	62.82	63.20	53.39	47.06	44.80	43.58	35.88	44.50	48.90	All	On Pk
NEMass/Boston	35.75	35.08	34.71	31.09	30.59	33.67	41.28	44.67	43.66	45.04	46.72	49.49	46.35	45.45	43.87	42.53	45.62	56.46	57.29	49.86	45.64	43.28	42.27	34.80	42.72	46.76	44.50	48.90
New Hampshire	35.55	34.89	34.51	30.91	30.41	33.48	41.05	44.41	43.42	44.79	46.46	49.21	46.09	45.19	43.62	42.29	45.36	56.14	56.96	49.58	45.39	43.03	42.03	34.60	42.47	46.50	44.50	48.90
Maine	34.50	33.86	33.49	30.00	29.52	32.50	39.84	43.11	42.14	43.47	45.09	47.76	44.73	43.86	42.34	41.05	44.03	54.45	55.25	48.10	44.05	41.76	40.79	33.58	41.22	45.12	44.50	48.90
Mass Hub	36.05	35.37	34.99	31.34	30.84	33.95	41.62	45.04	44.02	45.42	47.11	49.90	46.73	45.82	44.24	42.89	46.00	56.94	57.77	50.28	46.02	43.61	42.62	35.09	43.07	47.15	44.50	48.90
Cleared Load (GW)	11.7	11.8	11.8	12.0	12.3	12.3	13.7	15.1	15.8	16.1	16.1	16.0	15.9	15.7	15.6	15.8	16.1	17.3	17.2	16.9	16.1	14.7	13.1	12.1				

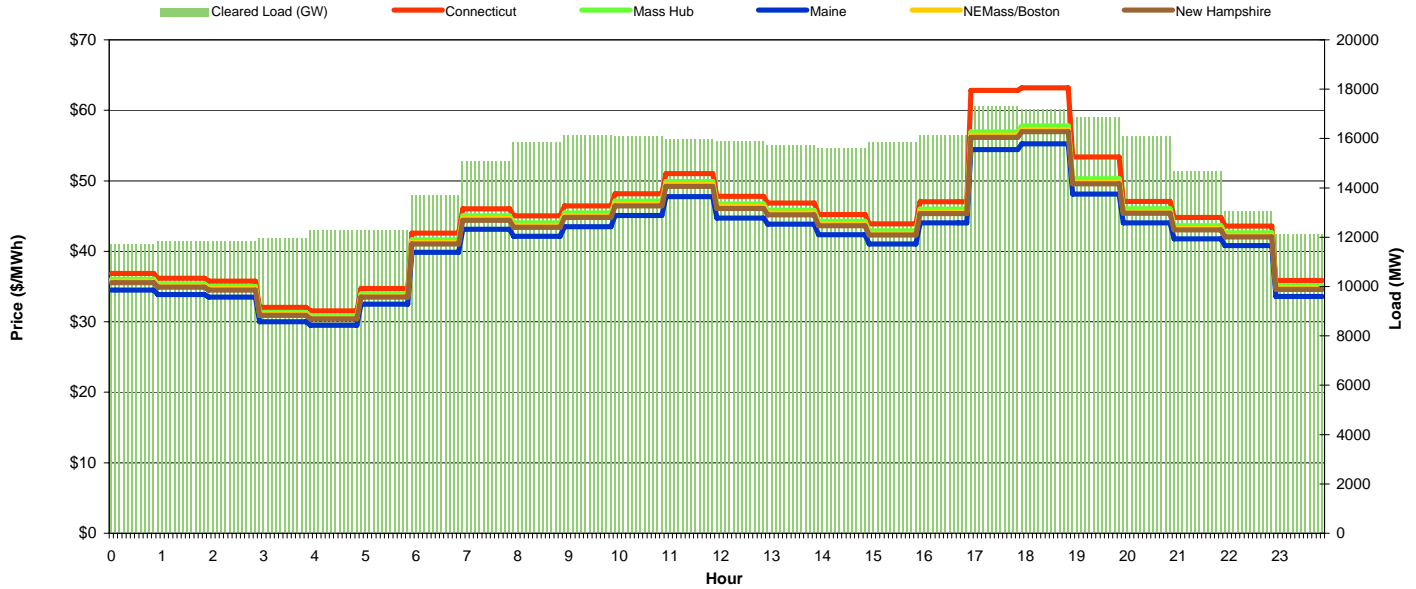

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	39.35	36.00	39.32	42.74	40.49	34.36	55.08	51.53	45.65	41.62	44.57	54.33	47.79	46.04	41.48	41.40	48.55	57.36	56.56	48.93	41.53	40.65	37.19	35.26	44.49	46.57	All	On Pk
NEMass/Boston	38.03	34.79	38.02	41.29	39.23	33.48	53.94	50.12	44.05	40.33	42.99	51.99	46.19	44.45	40.19	40.25	46.95	55.16	54.30	46.64	39.78	39.28	36.06	34.11	42.98	44.92	44.49	46.57
New Hampshire	37.73	34.57	37.86	41.13	39.07	33.27	53.56	49.49	43.43	39.80	42.51	51.48	45.83	43.99	39.73	39.75	46.27	54.16	53.36	45.91	39.23	38.83	35.67	33.75	42.52	44.34	44.50	48.90
Maine	37.15	33.98	37.10	40.23	38.26	88.00	52.90	48.66	42.20	38.46	40.87	48.88	43.59	41.89	37.92	37.96	44.17	51.97	51.19	43.97	37.51	37.43	34.53	32.96	43.41	42.58	44.50	48.90
Mass Hub	38.46	35.24	38.55	41.95	39.84	33.81	54.18	50.42	44.49	40.65	43.42	52.63	46.62	44.88	40.54	40.53	47.36	55.66	54.79	47.25	40.23	39.62	36.38	34.48	43.42	45.34	44.50	48.90
DA Forecast Load (GW)	12.07	11.62	11.41	11.37	11.72	12.77	14.66	15.92	16.38	16.54	16.71	16.73	16.60	16.54	16.39	16.39	16.85	17.86	18.12	17.58	16.83	15.64	14.23	12.84				
Forecast Error %	5.5%	10.0%	11.9%	14.1%	13.2%	5.3%	-0.5%	-0.7%	-0.3%	0.3%	0.6%	1.2%	1.4%	1.3%	1.1%	0.6%	-0.1%	-0.7%	-0.5%	-0.6%	-0.7%	-0.9%	-1.2%	3.7%				

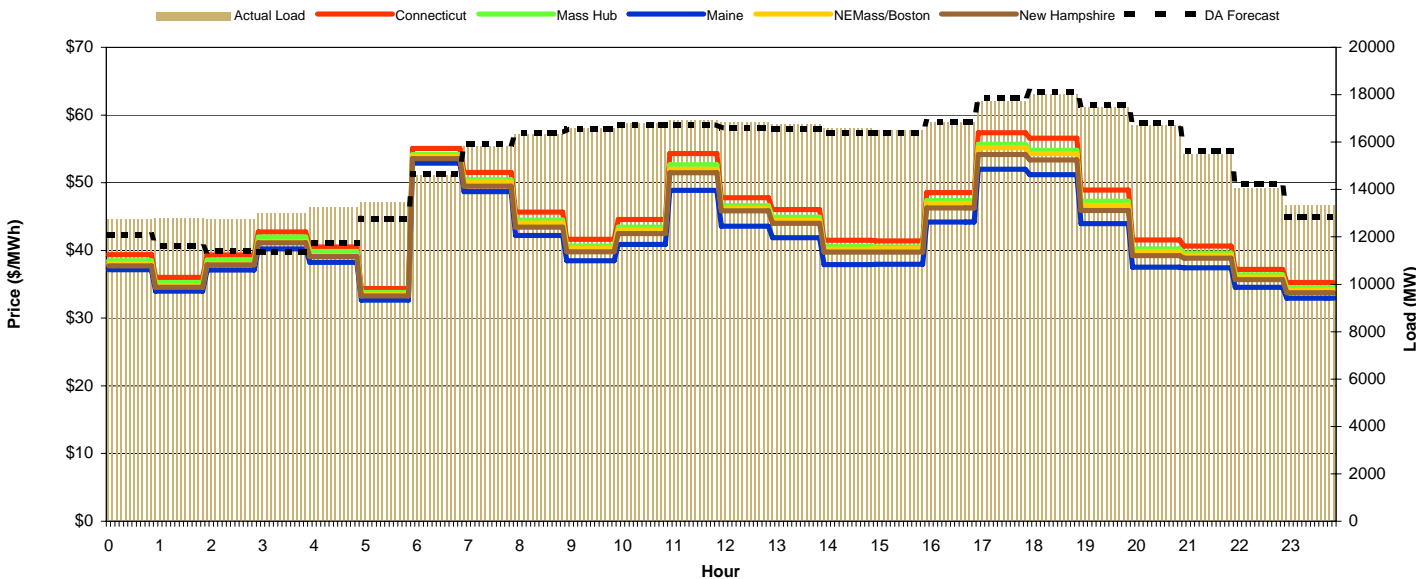






# ISO-NE Daily Report

Thursday February 25, 2010

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$	
<b>Connecticut</b>	32.31	31.16	26.79	27.43	31.01	34.36	44.85	45.03	45.97	47.98	47.58	47.98	45.75	45.56	44.99	44.20	49.69	60.07	63.37	56.36	49.41	45.60	42.05	36.00	43.56	48.85
<b>NEMass/Boston</b>	31.30	30.15	25.91	26.50	30.00	33.27	43.50	43.67	44.58	46.53	46.14	46.53	44.37	44.18	43.64	42.87	48.20	57.73	61.46	54.66	47.92	43.73	40.78	34.91	42.19	47.31
<b>New Hampshire</b>	31.10	29.94	25.72	26.29	29.79	33.07	43.25	43.42	44.32	46.26	45.88	46.27	44.11	43.93	43.39	42.62	47.92	57.40	61.10	54.34	47.65	43.47	40.55	34.71	41.94	47.04
<b>Maine</b>	30.21	29.09	25.00	25.56	28.95	32.12	42.00	42.17	43.05	44.93	44.56	44.93	42.84	42.67	42.14	41.39	46.54	55.74	59.34	52.78	46.27	42.22	39.38	33.71	40.73	45.68
<b>Mass Hub</b>	31.93	31.06	26.80	27.72	30.93	33.69	43.88	44.05	44.97	46.94	46.55	46.94	44.76	44.57	44.02	43.24	48.61	58.23	61.98	55.12	48.33	44.04	41.13	35.21	42.70	47.72
<b>Cleared Load (GW)</b>	12.3	12.0	11.9	11.9	12.0	12.4	14.0	15.4	15.7	15.8	16.1	16.1	15.9	15.7	15.6	15.6	16.1	17.5	17.1	16.5	16.0	14.4	13.0	12.0		

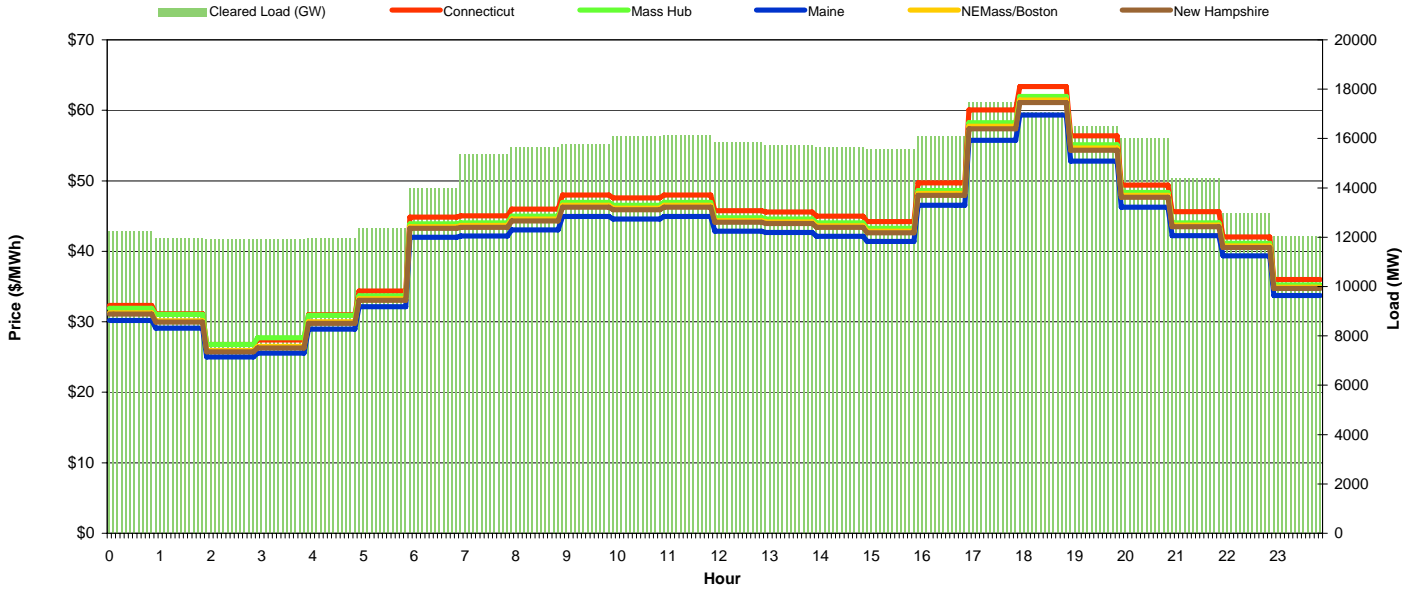

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$	
<b>Connecticut</b>	36.88	32.20	27.81	28.26	33.61	36.04	43.86	45.93	42.94	47.66	44.08	42.73	42.97	42.63	42.23	42.35	45.98	46.63	49.08	55.95	47.12	41.47	36.21	30.14	41.03	44.75
<b>NEMass/Boston</b>	35.38	30.95	26.81	27.27	32.50	34.87	42.31	43.90	41.02	45.07	42.02	40.99	41.26	40.96	40.73	40.88	44.16	44.95	47.03	53.04	44.52	39.71	35.10	29.07	39.35	42.83
<b>New Hampshire</b>	35.14	30.78	26.64	27.07	32.26	34.58	41.97	43.36	40.44	44.50	41.51	40.46	40.80	40.54	40.35	40.53	43.67	44.13	46.17	52.05	43.84	39.19	34.55	28.59	38.88	42.26
<b>Maine</b>	34.38	30.07	25.99	26.37	31.51	38.00	41.12	41.93	39.02	42.65	39.95	38.89	39.34	38.94	38.79	39.01	42.09	42.67	44.33	49.81	41.69	37.71	33.32	27.88	39.81	40.63
<b>Mass Hub</b>	35.92	31.45	27.24	27.70	33.01	35.37	42.78	44.41	41.49	45.77	42.59	41.47	41.73	41.42	41.12	41.27	44.67	45.29	47.47	53.77	45.20	40.19	35.40	29.35	39.84	43.33
<b>DA Forecast Load (GW)</b>	11.91	11.42	11.18	11.12	11.43	12.48	14.39	15.64	16.05	16.22	16.39	16.40	16.39	16.30	16.21	16.10	16.40	17.35	17.79	17.37	16.55	15.45	14.13	12.73		
<b>Forecast Error %</b>	7.7%	10.3%	10.6%	10.7%	10.2%	5.4%	-0.1%	0.3%	0.5%	1.0%	1.0%	1.0%	0.5%	0.8%	0.7%	1.6%	2.5%	2.1%	0.7%	0.6%	1.1%	0.9%	-0.9%	-1.5%		

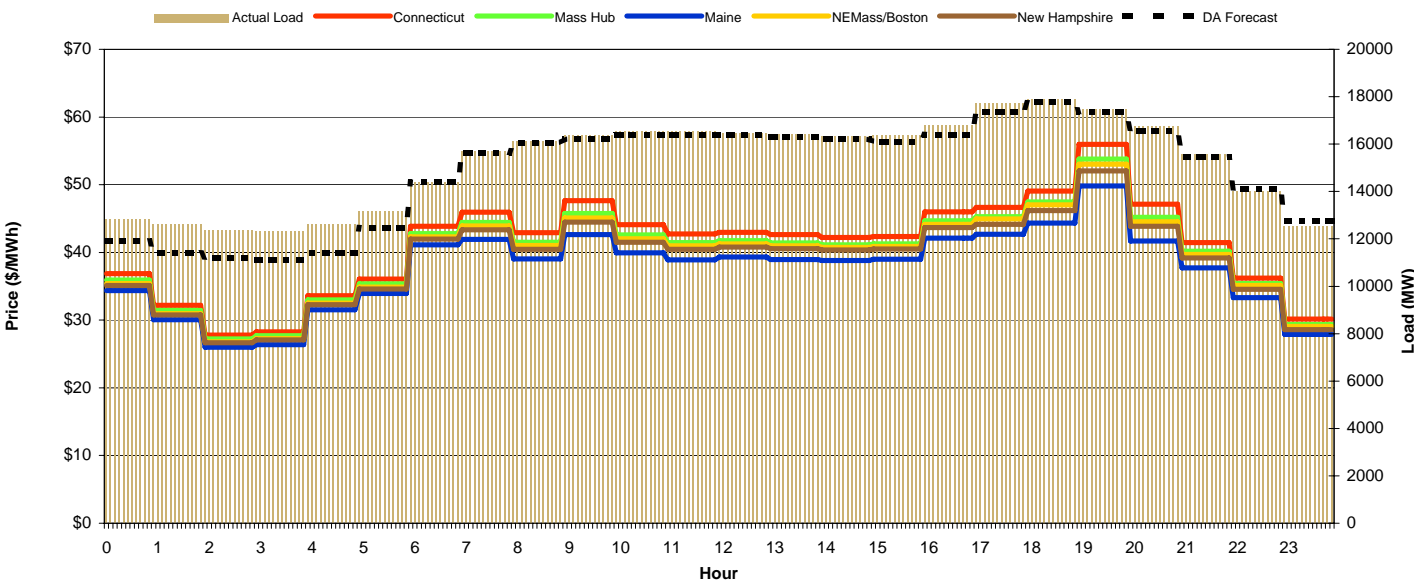




# ISO-NE Daily Report

Friday February 26, 2010

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	34.22	31.56	31.56	30.67	31.56	34.76	43.86	45.00	47.40	47.49	47.85	47.49	47.41	44.58	43.84	42.67	48.88	57.53	58.73	50.05	46.50	43.80	41.80	35.67	43.12	47.56	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	33.19	30.60	30.60	29.74	30.60	33.71	42.54	43.64	44.77	44.80	45.24	44.80	44.71	42.97	42.27	40.90	46.49	54.60	55.59	47.60	43.60	42.27	40.54	34.59	41.27	45.30		
<b>New Hampshire</b>	33.00	30.43	30.43	29.57	30.43	33.51	42.29	43.39	44.49	44.52	44.95	44.52	44.43	42.71	42.02	40.65	46.20	54.26	55.24	47.31	43.31	42.02	40.31	34.39	41.02	45.02		
<b>Maine</b>	31.99	29.50	29.50	28.67	29.50	32.49	41.00	42.06	43.12	43.15	43.57	43.15	43.06	41.41	40.74	39.41	44.79	52.60	53.55	45.86	41.99	40.74	39.08	33.34	39.76	43.64		
<b>Mass Hub</b>	33.48	30.87	30.87	30.00	30.87	34.00	42.91	44.02	45.00	45.03	45.48	45.03	44.93	43.30	42.60	41.19	46.77	54.92	55.89	47.90	43.78	42.61	40.89	34.89	41.55	45.58		
<b>Cleared Load (GW)</b>	11.7	11.9	11.5	11.6	11.8	12.3	13.7	15.1	15.4	15.6	15.6	15.5	15.3	15.4	15.1	15.1	15.4	16.9	16.7	16.2	15.1	14.1	13.0	12.1				

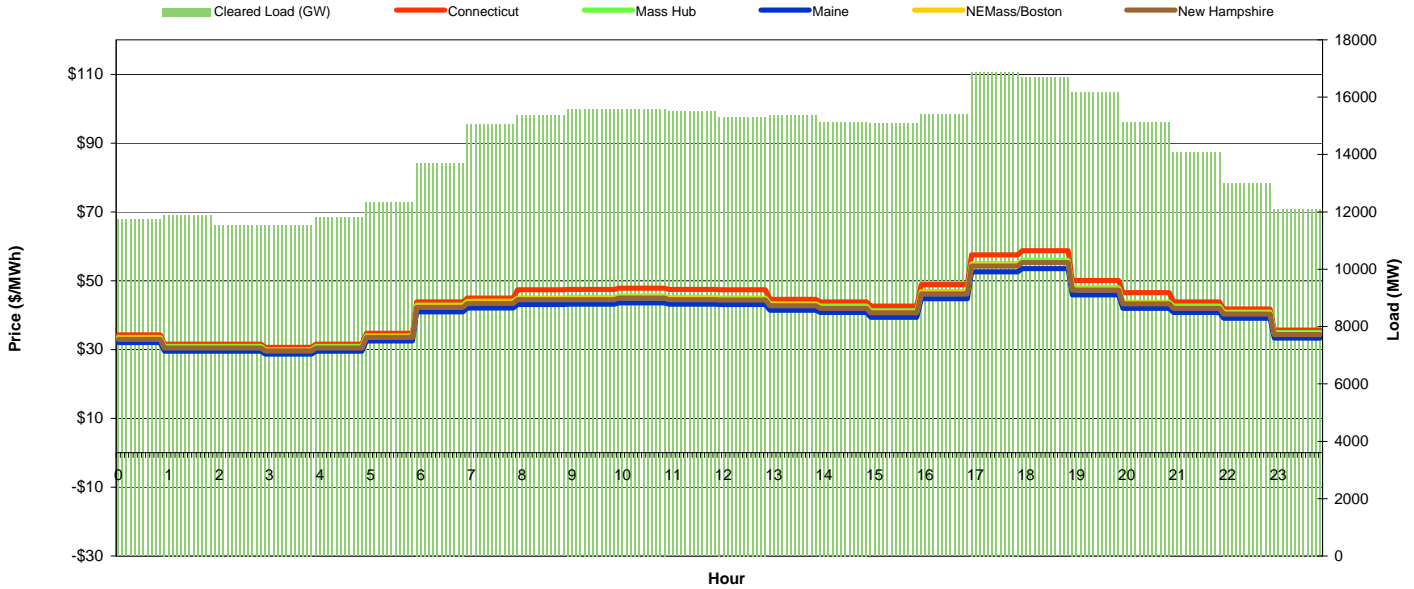

### Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	27.89	30.42	31.78	29.59	38.76	34.65	45.83	43.08	45.59	45.01	47.47	78.01	51.62	42.46	42.93	41.43	64.45	66.84	77.18	92.49	55.47	41.81	44.14	41.26	48.34	55.00	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	26.77	29.19	30.43	28.53	37.38	33.54	44.43	41.60	43.79	42.96	46.29	82.04	47.48	39.89	41.17	39.63	78.26	70.82	80.16	108.08	52.34	39.47	42.40	39.66	48.60	56.02		
<b>New Hampshire</b>	26.15	28.61	29.82	28.06	36.80	32.95	43.67	40.81	41.98	41.20	40.64	28.44	40.97	37.83	38.41	37.73	2.11	37.60	49.26	15.66	50.14	38.80	41.69	39.00	35.35	36.45		
<b>Maine</b>	25.42	27.84	29.03	27.75	36.52	88.00	43.66	40.37	40.32	39.39	36.53	1.48	36.76	35.93	36.08	35.81	-32.86	22.74	35.74	-22.38	47.49	37.30	40.07	37.92	31.12	26.92		
<b>Mass Hub</b>	27.18	29.68	30.96	28.95	37.93	33.95	44.82	41.96	44.17	43.45	46.20	74.94	46.87	40.12	41.42	39.96	67.93	66.82	76.65	95.97	52.85	40.01	42.80	40.00	47.32	53.88		
<b>DA Forecast Load (GW)</b>	11.70	11.21	10.99	10.97	11.28	12.34	14.21	15.50	16.11	16.42	16.59	16.51	16.31	16.17	15.93	15.86	16.11	16.94	17.10	16.60	16.04	15.16	14.08	12.86				
<b>Forecast Error %</b>	1.2%	5.1%	4.0%	3.9%	4.1%	0.4%	-3.9%	-4.5%	-4.9%	-4.8%	-4.2%	-3.1%	-2.5%	-2.4%	-1.9%	-1.8%	-1.2%	-2.0%	-0.5%	-0.2%	-0.4%	-0.3%	-0.7%	0.0%				

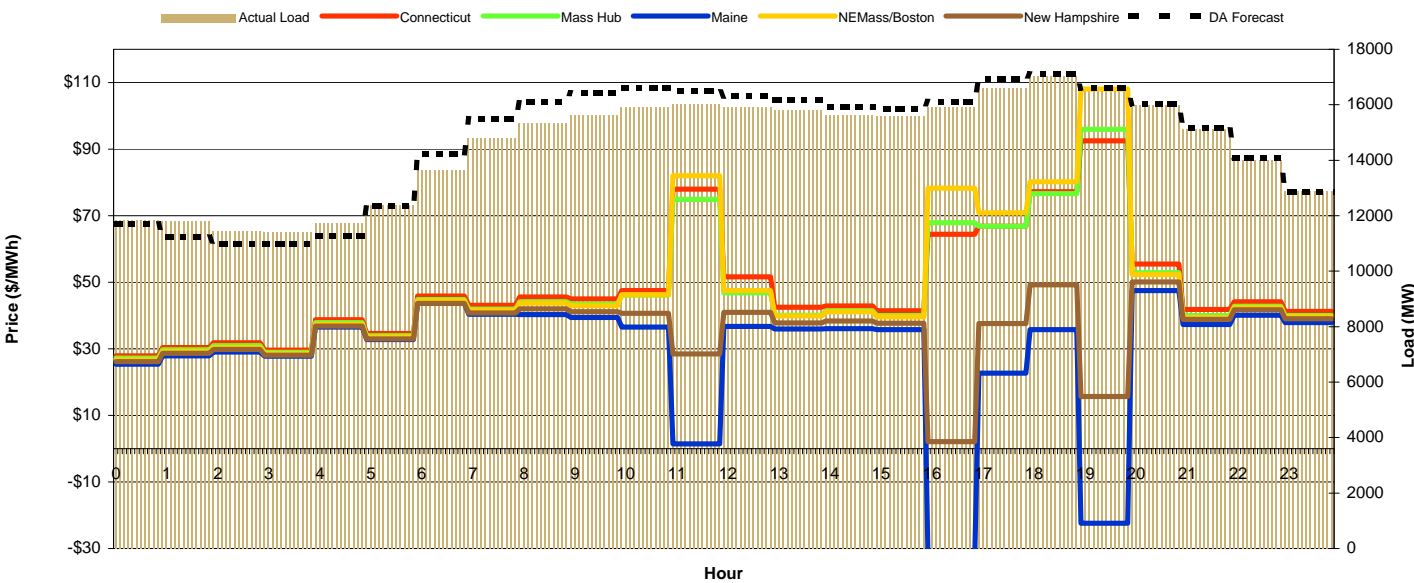




# ISO-NE Daily Report

Saturday February 27, 2010

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$				
<b>Connecticut</b>	38.16	37.37	39.17	38.16	37.37	36.41	36.41	41.00	45.50	54.08	58.16	57.15	55.00	46.92	44.13	43.60	51.70	64.31	67.48	58.14	55.16	46.54	45.00	44.24	44.24	47.55	52.12	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	36.98	36.21	37.95	36.98	36.21	35.29	35.29	39.73	44.09	52.41	56.36	55.38	53.30	45.47	42.76	42.25	50.10	62.32	65.39	56.34	53.45	45.09	43.61	42.87	46.08	50.50			
<b>New Hampshire</b>	36.73	35.97	37.70	36.73	35.97	35.05	35.05	39.46	43.80	52.06	55.99	55.01	52.94	45.17	42.48	41.97	49.77	61.90	64.95	55.96	53.09	44.79	43.31	42.59	45.77	50.17			
<b>Maine</b>	35.61	34.87	36.55	35.61	34.87	33.98	33.98	38.26	42.46	50.47	54.27	53.33	51.32	43.79	41.18	40.68	48.25	60.01	62.97	54.25	51.47	43.42	41.99	41.28	44.37	48.63			
<b>Mass Hub</b>	37.31	36.54	38.29	37.31	36.54	35.60	35.60	40.09	44.49	52.88	56.87	55.88	53.78	45.88	43.15	42.63	50.55	62.88	65.98	56.84	53.93	45.50	44.00	43.26	46.49	50.96			
<b>Cleared Load (GW)</b>	11.3	11.2	11.4	11.3	11.2	11.3	11.8	12.3	14.1	14.5	14.3	14.3	14.1	13.8	13.6	13.6	14.0	15.1	15.3	14.9	14.3	13.7	12.4	11.6					

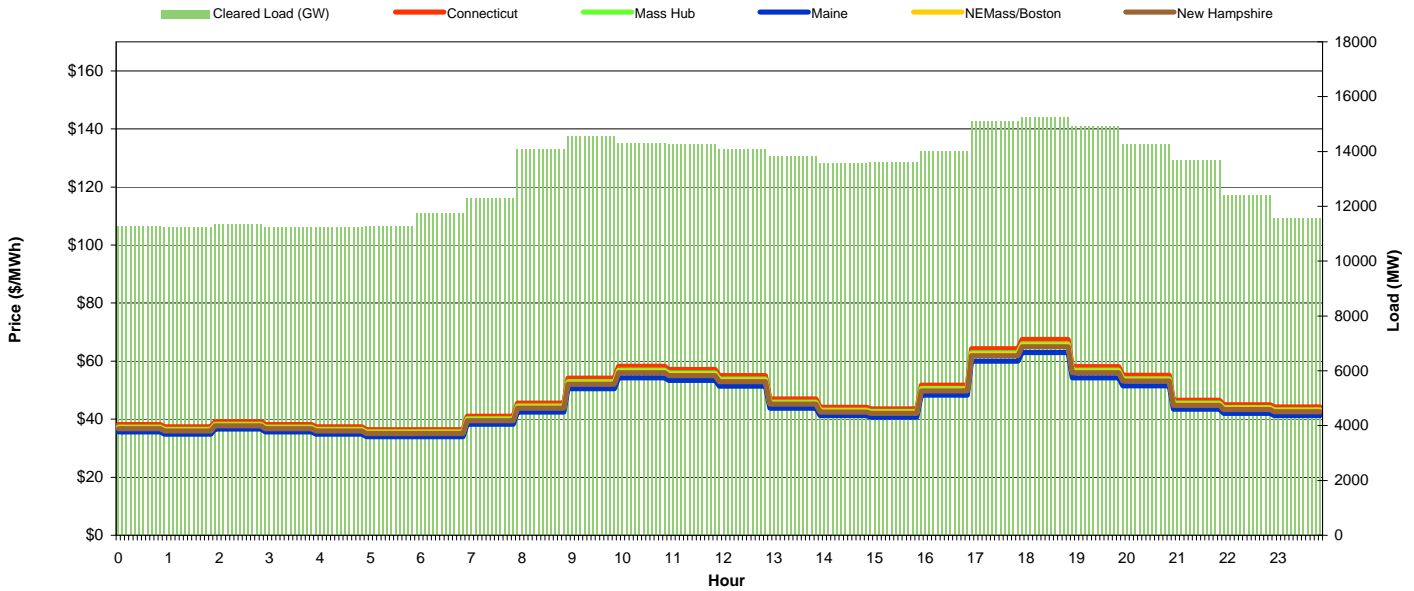

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$				
<b>Connecticut</b>	34.97	37.66	38.03	36.93	34.33	39.53	41.33	41.04	43.15	42.44	54.80	54.21	46.66	41.14	41.38	43.16	44.78	57.99	161.93	43.54	46.01	42.63	41.54	40.57	47.91	52.90	<b>All</b>	<b>On Pk</b>	
<b>NEMass/Boston</b>	33.84	36.49	36.76	35.59	33.08	38.29	40.16	39.90	41.63	40.86	52.46	51.87	44.71	39.62	39.86	41.70	43.22	56.03	157.03	42.32	44.39	41.16	40.25	39.35	46.27	51.06			
<b>New Hampshire</b>	33.27	35.92	36.21	35.05	32.57	37.57	39.40	39.22	41.10	40.29	51.71	51.22	44.23	39.16	39.37	41.22	42.76	55.26	154.73	41.73	43.72	40.60	39.59	38.70	45.61	50.37			
<b>Maine</b>	32.39	34.87	35.18	33.99	31.60	37.77	37.73	39.52	38.81	49.48	49.01	42.30	37.68	37.84	39.77	41.30	53.37	148.68	40.00	41.87	38.73	37.89	37.10	46.04	48.37				
<b>Mass Hub</b>	34.10	36.80	37.14	35.99	33.45	38.63	40.44	40.06	41.88	41.13	52.88	52.29	45.06	39.87	40.09	41.92	43.45	56.19	157.49	42.48	44.63	41.40	40.41	39.50	46.55	51.33			
<b>DA Forecast Load (GW)</b>	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
<b>Forecast Error %</b>	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!		

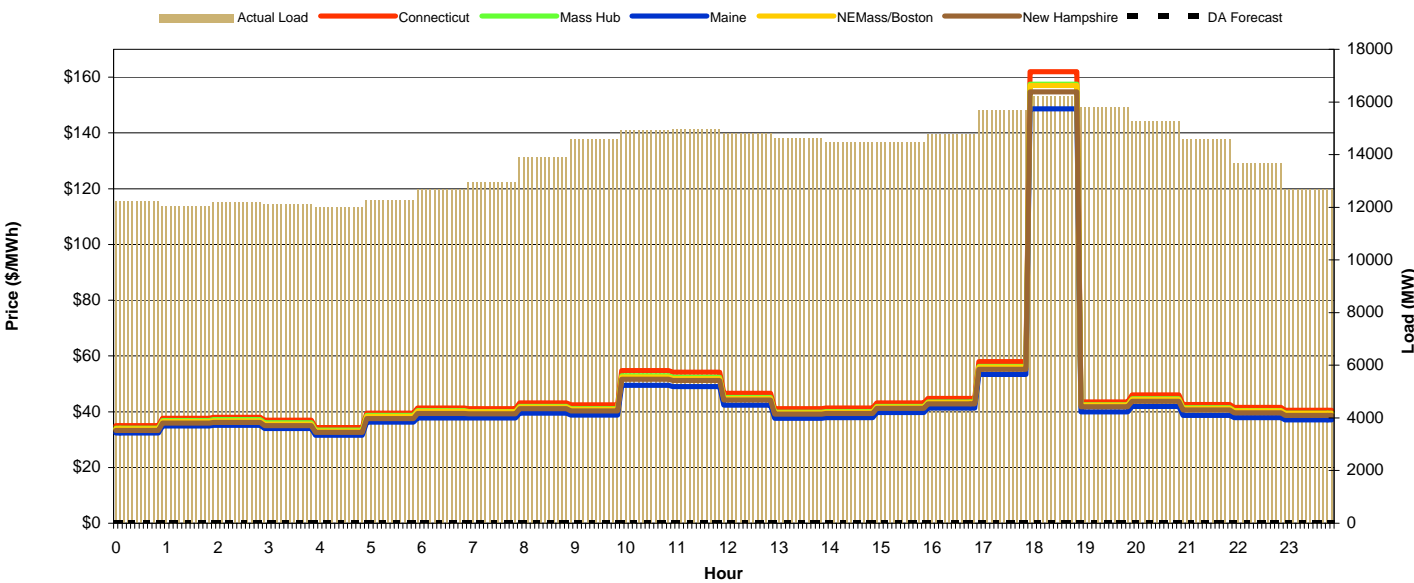




# ISO-NE Daily Report

Sunday February 28, 2010

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%

## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$				
<b>Connecticut</b>	36.41	36.41	35.31	34.85	33.40	34.85	34.85	31.63	37.16	40.57	42.22	42.68	41.94	39.09	38.15	38.49	44.74	60.64	67.65	60.00	56.28	46.00	39.65	36.85	36.85	42.08	45.43	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	35.23	35.23	34.16	33.72	32.31	33.72	33.72	30.60	35.96	39.26	40.71	41.07	40.58	37.82	36.92	37.24	43.29	58.41	65.00	57.91	54.45	44.51	38.37	35.66	40.66	43.88			
<b>New Hampshire</b>	34.92	34.92	33.86	33.42	32.03	33.42	33.42	30.34	35.64	38.91	40.34	40.70	40.23	37.49	36.59	36.92	42.90	57.89	64.42	57.39	53.97	44.12	38.03	35.35	40.30	43.49			
<b>Maine</b>	33.87	33.87	32.84	32.42	31.07	32.42	32.42	29.43	34.57	37.74	39.13	39.48	39.02	36.36	35.49	35.81	41.62	56.15	62.48	55.67	52.35	42.79	36.89	34.28	39.09	42.19			
<b>Mass Hub</b>	35.55	35.55	34.48	34.03	32.61	34.03	34.03	30.89	36.29	39.62	41.06	41.42	40.96	38.17	37.26	37.59	43.68	58.91	65.53	58.42	54.95	44.92	38.72	35.99	41.03	44.27			
<b>Cleared Load (GW)</b>	10.9	11.0	11.1	11.0	10.9	11.1	11.2	11.9	12.5	13.3	13.6	13.8	13.8	13.5	13.2	13.2	13.9	15.4	15.6	15.0	14.4	13.3	12.2	11.4					

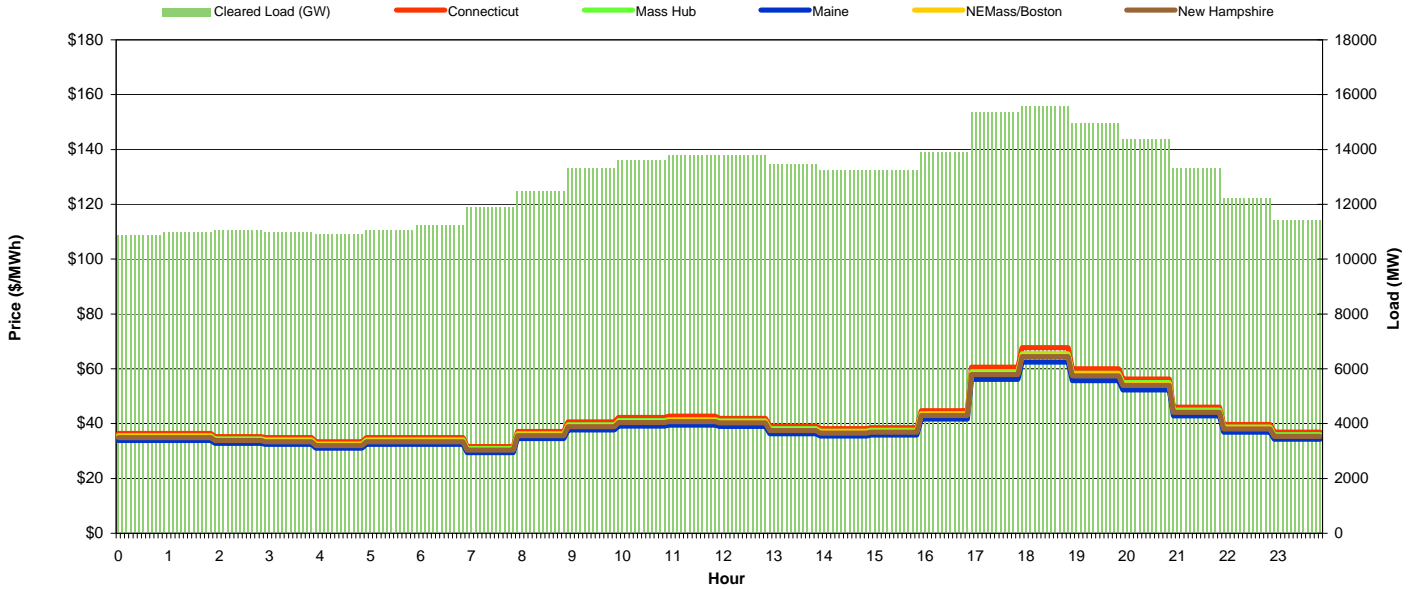

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$				
<b>Connecticut</b>	36.72	37.88	35.35	33.66	34.75	33.37	34.08	37.74	41.78	40.68	43.77	40.71	40.78	45.13	47.34	48.28	56.89	57.68	171.74	127.66	48.04	54.29	42.35	39.59	39.59	51.26	59.05	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	35.66	36.82	34.40	32.77	33.93	32.56	33.31	36.98	40.80	39.44	42.47	39.47	39.69	44.18	46.24	47.09	55.57	56.78	169.33	125.31	46.81	52.72	40.94	38.56	50.08	57.74			
<b>New Hampshire</b>	35.16	36.41	33.98	32.36	33.49	32.07	32.75	36.43	40.39	39.11	42.02	38.94	39.19	43.50	45.53	46.40	54.66	55.85	166.51	123.15	45.99	51.84	40.28	38.05	49.34	56.86			
<b>Maine</b>	34.07	35.47	33.07	31.43	32.56	88.00	31.55	35.37	39.43	38.02	41.11	37.97	37.91	41.96	43.80	44.44	52.28	53.90	159.86	117.29	44.03	49.45	38.33	36.84	49.92	54.70			
<b>Mass Hub</b>	35.85	37.09	34.69	33.06	34.21	32.83	33.53	37.15	41.02	39.67	42.68	39.65	39.85	44.21	46.33	47.24	55.65	56.63	168.82	125.09	46.81	52.88	41.21	38.78	50.21	57.81			
<b>DA Forecast Load (GW)</b>	11.78	11.28	10.99	10.85	10.93	11.17	11.62	12.24	13.24	14.00	14.33	14.55	14.51	14.39	14.25	14.31	14.81	15.97	16.51	16.12	15.54	14.57	13.47	12.36					
<b>Forecast Error %</b>	0.2%	4.2%	7.2%	8.0%	7.1%	7.0%	3.7%	0.9%	0.2%	-0.2%	0.1%	-0.2%	0.6%	1.2%	1.7%	1.6%	1.2%	-0.2%	1.1%	2.0%	1.8%	1.8%	0.9%	0.7%					

