




# ISO-NE Daily Report

Wednesday September 01, 2010

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	42.54	38.65	35.78	33.98	34.60	36.25	41.93	47.51	51.90	61.85	76.31	93.53	107.60	127.63	148.42	156.20	157.80	125.31	96.18	93.94	84.10	65.00	53.23	50.84	77.55	96.66	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	41.18	38.26	35.63	34.16	34.72	36.11	41.33	46.89	50.99	60.93	76.01	89.98	103.76	123.93	145.97	153.28	153.70	119.94	88.96	89.32	78.75	61.23	50.75	48.26	75.17	93.40		
<b>New Hampshire</b>	40.96	38.06	35.44	34.01	34.59	36.03	41.44	47.10	51.48	61.59	76.60	90.69	104.43	124.94	146.80	153.85	154.37	120.95	89.98	90.50	79.69	61.82	51.01	48.37	75.61	94.11		
<b>Maine</b>	40.09	37.31	34.74	33.38	33.99	35.65	41.51	52.86	58.14	82.00	95.00	115.00	128.88	175.00	175.00	152.89	153.43	129.04	110.00	115.00	88.60	61.19	50.18	47.14	85.25	108.89		
<b>Mass Hub</b>	41.76	39.53	36.76	35.30	35.84	36.82	41.87	47.24	51.33	61.10	76.21	90.42	104.14	124.09	145.74	153.19	154.26	120.79	89.78	90.00	79.48	61.93	51.32	49.08	75.75	93.81		
<b>Cleared Load (GW)</b>	15.0	14.5	14.0	13.6	13.7	14.5	15.7	16.8	18.5	19.6	20.8	21.5	22.0	22.6	22.5	22.3	22.5	22.5	22.0	21.5	21.3	19.7	17.6	15.9				

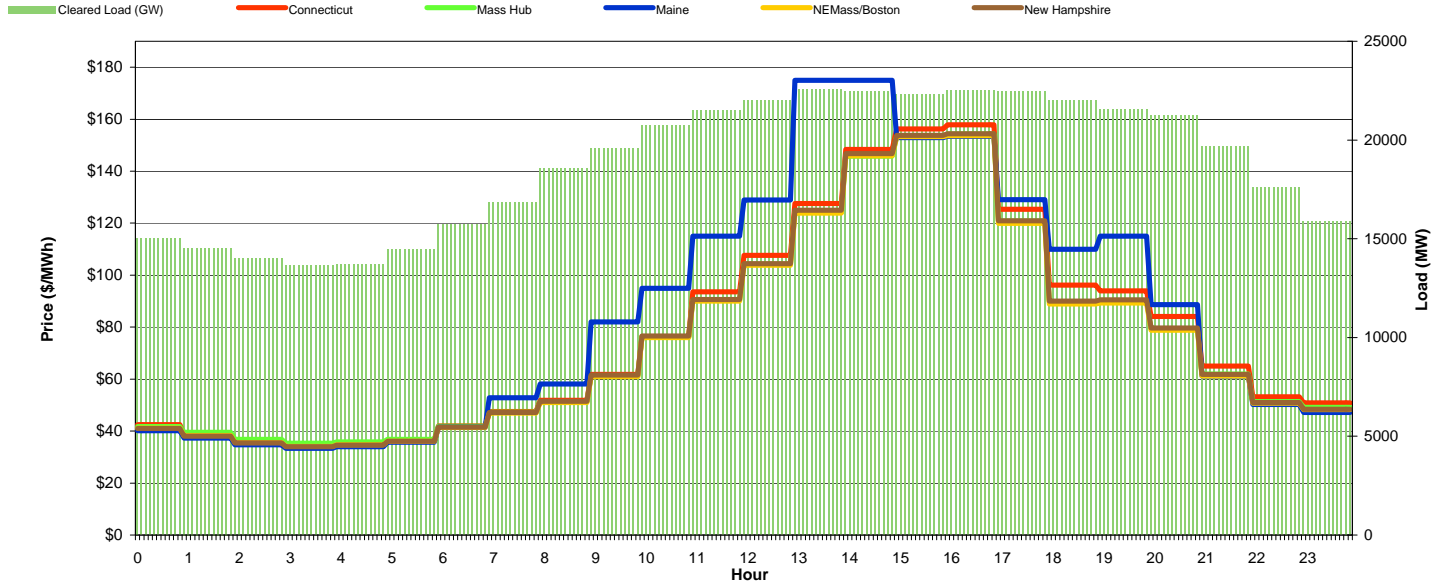

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	43.26	37.41	35.54	35.97	37.95	39.82	47.28	50.51	49.43	64.33	86.14	102.41	111.55	137.49	140.09	133.57	133.90	120.34	100.55	116.90	98.70	72.74	40.80	37.93	78.11	97.47	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	42.52	36.85	35.08	35.36	37.45	39.55	47.16	50.36	49.31	64.07	85.96	102.58	111.30	137.55	140.15	133.59	133.61	120.00	100.08	115.81	97.48	70.84	39.49	37.22	77.64	97.01		
<b>New Hampshire</b>	42.04	36.58	34.91	35.23	37.29	39.44	47.08	50.45	49.51	64.40	86.32	102.97	111.67	137.62	139.91	133.02	133.11	119.82	100.31	116.38	97.99	71.27	39.58	37.18	77.67	97.15		
<b>Maine</b>	40.75	35.61	34.09	34.34	36.36	38.80	46.72	50.25	49.45	64.24	86.10	101.81	110.21	136.06	137.55	129.99	130.03	117.64	99.44	116.11	97.53	70.20	38.75	36.09	76.59	95.96		
<b>Mass Hub</b>	42.81	37.10	35.32	35.67	37.75	39.77	47.31	50.48	49.35	64.13	85.92	102.42	111.38	137.63	140.28	133.69	133.76	120.18	100.31	116.23	97.92	71.39	39.86	37.46	77.84	97.18		
<b>DA Forecast Load (GW)</b>	16.40	15.45	14.83	14.47	14.52	15.33	16.85	18.53	19.84	21.23	22.74	23.95	24.88	25.67	26.13	26.40	26.50	26.04	25.08	24.57	24.27	22.53	20.25	18.04				
<b>Forecast Error %</b>	3.8%	3.6%	3.3%	3.1%	2.7%	1.7%	0.2%	-1.4%	-0.8%	-0.3%	-0.5%	-0.5%	-1.1%	-1.4%	-1.6%	-2.0%	-2.4%	-2.2%	-1.5%	-0.8%	-0.7%	-0.2%	-0.3%	0.9%				

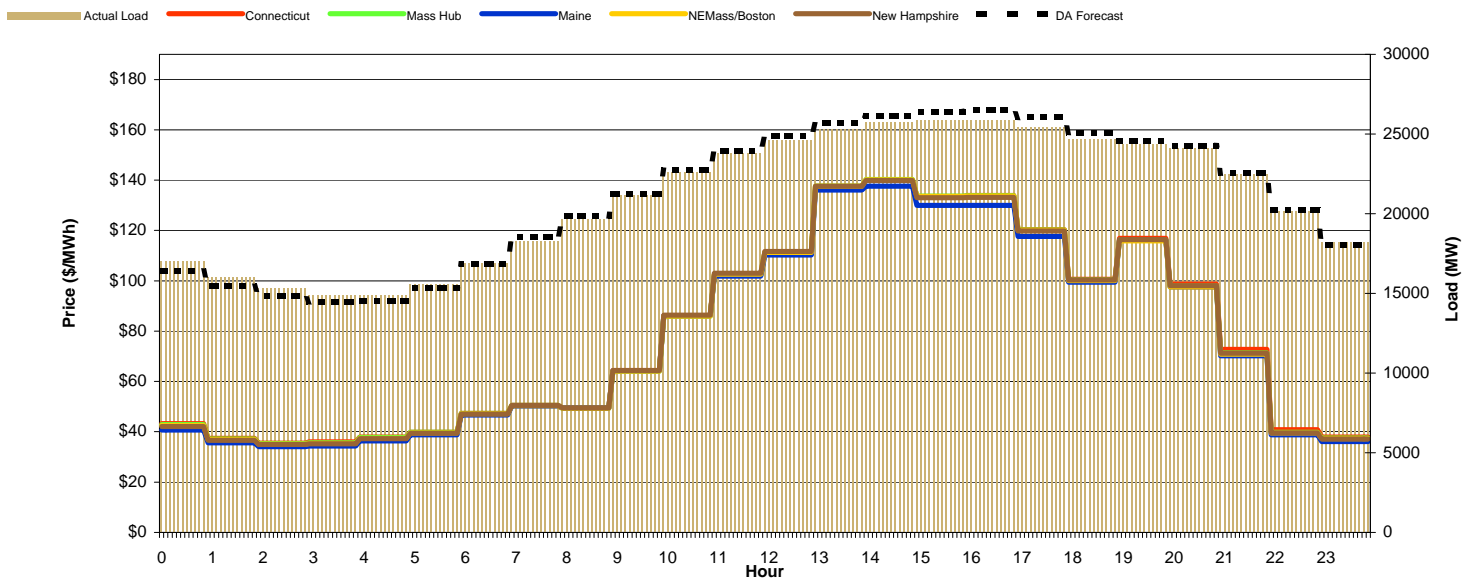




# ISO-NE Daily Report

Thursday September 02, 2010

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$					
<b>Connecticut</b>	38.66	36.19	33.18	32.20	31.95	35.47	39.49	40.78	51.03	55.29	70.27	81.05	92.53	107.22	118.52	115.28	115.15	93.04	77.96	69.64	64.46	54.78	46.51	41.30	41.30	64.25	78.34	<b>All</b>	<b>On Pk</b>	
<b>NEMass/Boston</b>	37.86	35.96	33.22	32.33	32.18	35.44	38.87	40.43	50.73	55.24	70.05	81.05	92.60	107.44	118.51	115.05	115.02	93.52	78.40	70.41	64.36	54.11	45.82	40.30	40.30	64.12	78.30			
<b>New Hampshire</b>	38.04	36.12	33.37	32.41	32.29	35.58	39.18	40.59	51.18	55.71	70.68	81.81	93.38	108.25	119.19	115.68	115.61	94.31	79.27	71.16	65.11	54.42	46.02	40.50	40.50	64.58	78.90			
<b>Maine</b>	37.22	35.53	32.81	31.84	31.78	35.21	42.74	42.92	57.17	75.00	90.00	120.00	125.00	160.00	171.78	161.60	171.42	119.30	89.92	89.66	70.00	53.65	45.77	40.06	40.06	80.43	102.70			
<b>Mass Hub</b>	38.30	36.54	33.89	32.99	32.75	35.96	39.40	41.14	51.30	55.89	71.18	82.42	94.22	109.01	120.31	116.84	116.70	94.51	79.11	71.09	65.14	54.49	46.19	40.59	40.59	65.00	79.35			
<b>Cleared Load (GW)</b>	15.0	14.3	13.9	13.5	13.7	14.3	15.7	17.2	18.3	19.8	21.4	22.2	22.5	22.9	23.1	23.0	23.0	22.6	22.0	22.0	21.5	19.0	17.3	15.8						

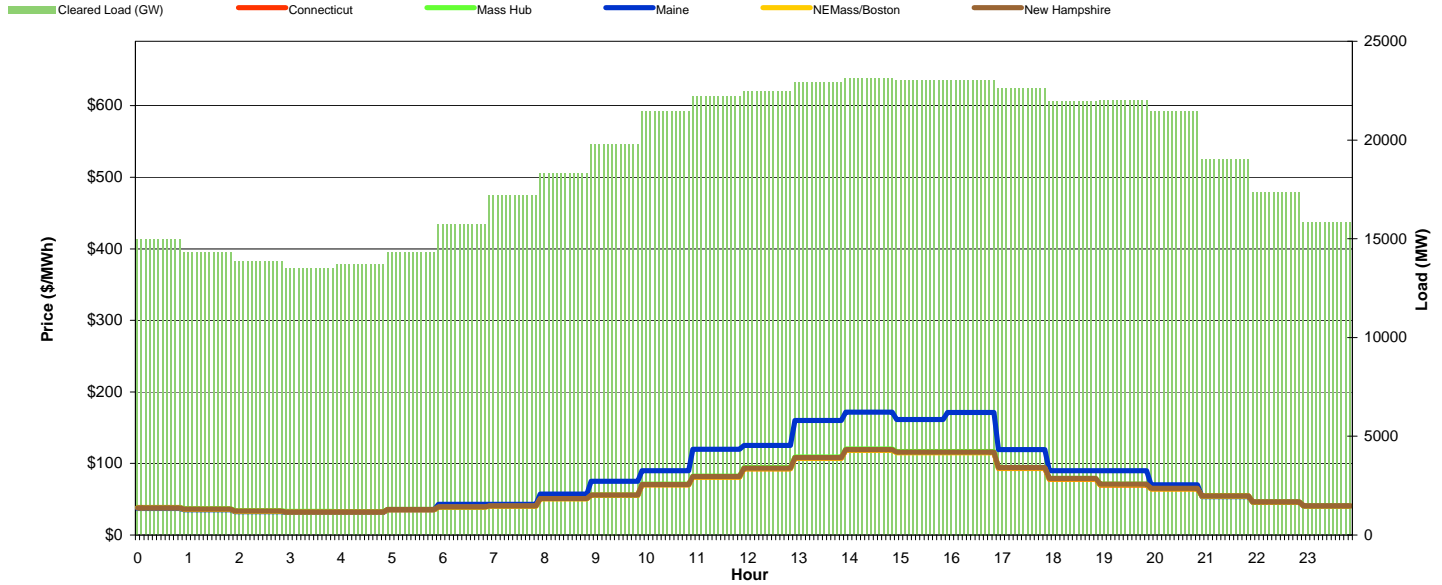

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$					
<b>Connecticut</b>	39.54	37.81	34.03	33.28	31.71	37.30	38.21	38.97	40.52	51.93	62.20	71.90	88.81	495.38	134.94	106.49	134.59	80.91	66.44	60.76	68.20	50.42	39.55	37.30	37.30	78.38	99.50	<b>All</b>	<b>On Pk</b>	
<b>NEMass/Boston</b>	39.06	37.63	33.86	32.91	31.47	37.03	38.01	38.68	40.37	52.20	61.86	71.56	88.56	677.30	139.88	110.71	139.47	83.67	68.48	62.45	69.08	49.90	38.92	36.80	36.80	86.66	112.07			
<b>New Hampshire</b>	38.88	37.54	33.84	32.94	31.49	37.07	38.26	38.97	40.69	52.57	62.46	72.25	89.18	505.81	138.23	109.17	137.53	82.90	68.26	62.60	69.46	50.09	39.05	36.90	36.90	79.42	101.20			
<b>Maine</b>	37.61	36.39	32.88	32.02	30.66	36.38	38.12	38.71	40.36	52.35	61.81	71.57	88.29	496.34	135.09	106.55	134.15	81.47	67.91	62.59	69.10	49.44	38.38	36.32	36.32	78.10	99.63			
<b>Mass Hub</b>	39.28	37.83	34.06	33.14	31.66	37.21	38.16	38.84	40.44	52.17	62.08	71.85	89.07	508.98	138.63	109.67	138.29	82.99	67.97	62.10	68.95	49.99	39.06	36.92	36.92	79.56	101.32			
<b>DA Forecast Load (GW)</b>	16.32	15.35	14.62	14.28	14.33	15.12	16.59	18.18	19.56	20.92	22.35	23.50	24.36	25.13	25.58	25.89	26.00	25.54	24.56	24.09	23.71	22.03	19.80	17.65						
<b>Forecast Error %</b>	2.8%	4.2%	5.2%	5.0%	4.6%	4.7%	2.5%	0.9%	0.9%	1.3%	1.3%	1.4%	1.3%	1.6%	1.1%	0.5%	-0.2%	-0.2%	0.4%	1.0%	1.3%	1.6%	1.6%	3.1%						

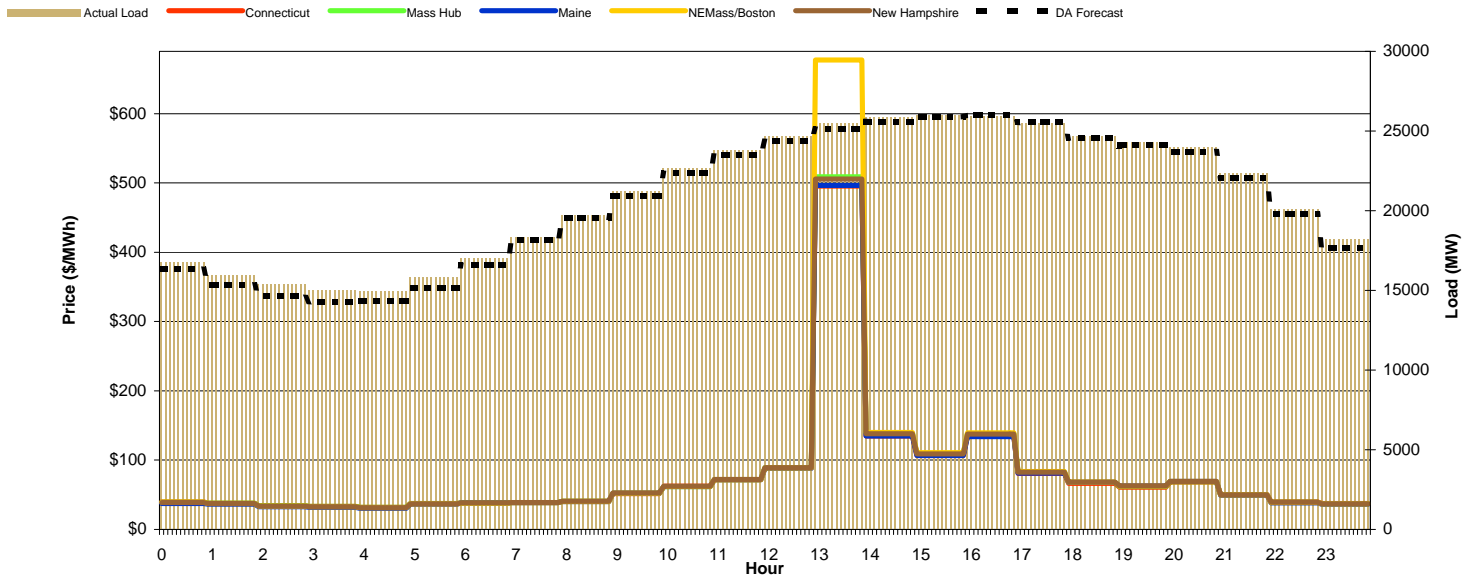




# ISO-NE Daily Report

Friday September 03, 2010

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	38.05	35.36	33.58	33.10	33.03	34.31	39.48	39.59	52.94	61.37	56.03	59.99	61.39	61.79	61.20	60.03	60.39	58.94	60.30	58.90	55.00	50.00	40.69	38.41	49.33	56.16	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	36.94	34.59	32.83	32.51	32.48	33.95	38.35	38.38	44.03	48.85	51.59	54.27	55.49	53.16	57.20	53.12	52.92	51.30	48.85	48.83	48.00	43.32	38.72	37.13	44.45	49.25		
<b>New Hampshire</b>	36.97	34.55	32.93	32.65	32.61	34.10	38.86	38.82	44.76	49.84	52.65	55.32	56.56	54.17	58.32	54.00	53.70	52.20	49.65	49.66	48.72	43.98	38.99	37.56	45.07	50.08		
<b>Maine</b>	36.61	34.15	32.39	32.22	32.17	33.77	39.17	38.76	44.81	49.82	52.15	54.79	56.05	53.94	57.66	53.93	53.43	51.80	48.85	48.88	48.02	43.36	37.99	37.83	44.69	49.64		
<b>Mass Hub</b>	37.42	35.04	33.24	32.91	32.83	34.31	38.93	39.03	44.72	49.68	52.34	55.05	56.23	53.89	57.98	53.87	53.63	51.95	49.47	49.48	48.60	43.82	39.24	37.46	45.05	49.94		
<b>Cleared Load (GW)</b>	14.5	13.7	13.0	12.9	13.0	14.0	15.4	16.5	17.4	18.3	19.3	19.7	19.7	19.9	19.9	19.8	19.6	18.9	18.2	17.9	17.5	16.4	15.3	13.9				

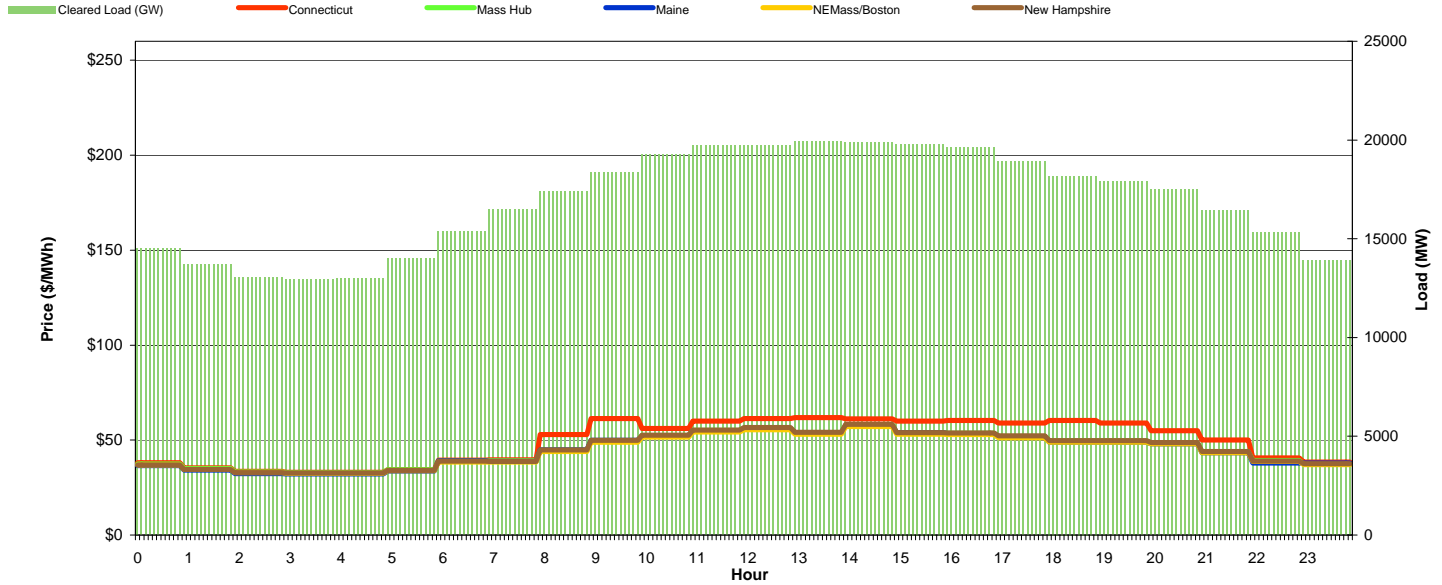

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	47.12	39.87	48.71	36.80	38.26	58.51	62.63	65.87	67.88	92.28	112.00	122.29	98.51	78.63	115.61	84.86	96.30	105.38	130.71	249.95	78.68	66.33	42.55	45.53	82.72	100.49	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	45.66	38.55	46.90	35.54	36.91	56.46	60.74	64.51	66.10	90.67	104.68	114.70	94.35	44.23	56.18	43.86	55.14	62.28	123.28	244.80	77.19	64.70	40.91	44.10	71.35	84.22		
<b>New Hampshire</b>	45.66	38.51	46.91	35.55	36.96	56.64	61.23	65.24	66.99	91.82	106.07	116.17	95.75	45.09	57.41	44.67	55.87	63.38	124.70	247.82	78.07	65.09	40.99	44.05	72.11	85.32		
<b>Maine</b>	44.91	38.09	46.18	35.15	36.57	56.22	61.79	66.36	68.22	93.67	107.37	117.90	96.78	46.03	58.36	45.56	56.35	63.99	126.05	250.57	78.84	65.20	40.46	43.45	72.67	86.36		
<b>Mass Hub</b>	45.97	38.87	47.38	35.89	37.29	56.99	61.27	64.97	66.52	91.05	105.16	115.14	94.53	44.13	56.01	43.94	55.34	62.56	123.72	246.02	77.62	65.11	41.27	44.48	71.72	84.57		
<b>DA Forecast Load (GW)</b>	16.37	15.45	14.83	14.46	14.45	15.19	16.37	17.72	19.01	20.14	21.12	21.81	21.93	21.85	21.83	21.80	21.62	21.18	20.26	19.89	19.70	18.25	16.42	14.98				
<b>Forecast Error %</b>	2.5%	0.5%	1.7%	2.1%	3.9%	4.2%	2.4%	1.9%	0.9%	0.8%	0.5%	0.7%	1.2%	1.9%	1.9%	0.7%	0.3%	1.1%	3.6%	5.6%	4.9%	7.4%	10.3%	10.1%				

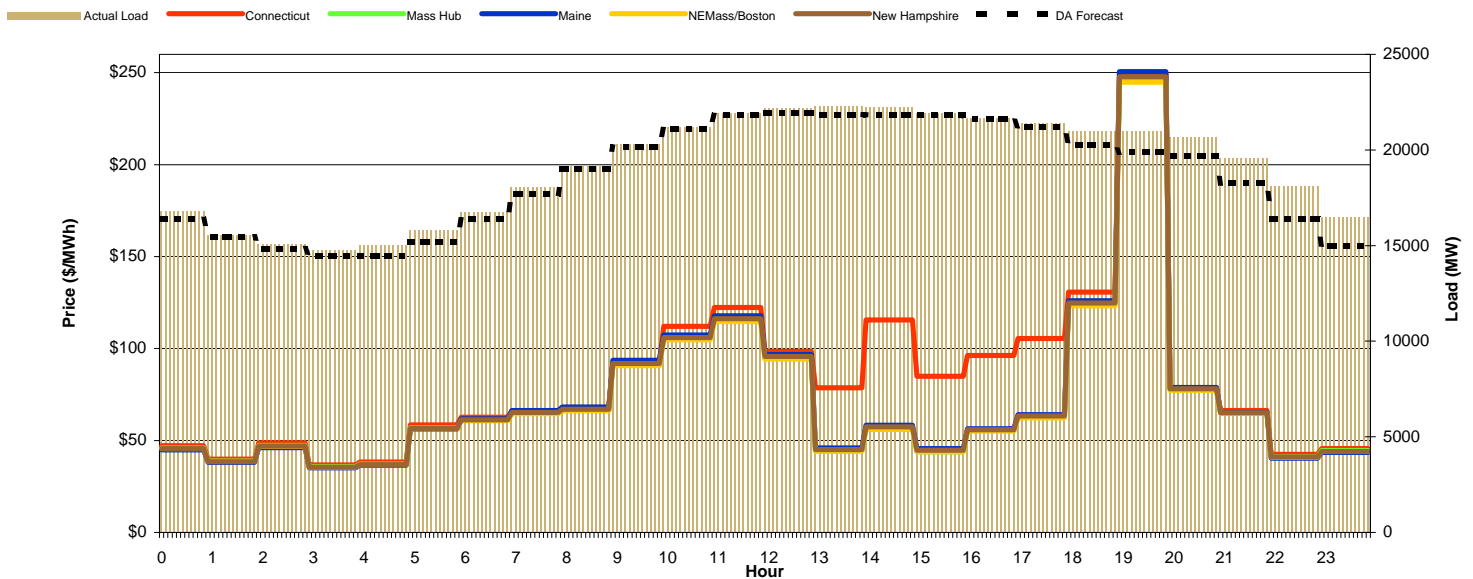




# ISO-NE Daily Report

Saturday September 04, 2010

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	37.56	35.08	33.56	31.26	30.22	29.20	30.60	34.46	37.14	46.77	49.48	49.68	49.89	51.09	50.17	49.44	49.04	49.57	47.71	49.21	43.33	48.26	38.84	35.83	41.97	46.51	All	On Pk
<b>NEMass/Boston</b>	36.79	34.57	33.09	30.77	29.91	29.18	30.60	34.44	37.09	46.09	48.50	48.61	48.82	49.76	48.83	48.62	48.58	48.57	47.23	48.53	43.14	41.69	38.08	35.48	41.12	45.41		
<b>New Hampshire</b>	37.00	34.65	33.21	30.89	30.00	29.27	30.77	34.52	37.38	46.75	49.35	49.48	49.65	50.58	49.54	49.22	49.14	49.35	47.85	49.14	43.53	41.94	38.09	35.39	41.53	45.97		
<b>Maine</b>	36.78	34.37	33.07	30.72	29.90	29.42	32.31	34.75	40.04	47.21	49.76	50.35	50.60	51.02	51.04	51.04	50.85	50.59	48.32	49.30	43.79	41.70	37.59	35.00	42.06	46.75		
<b>Mass Hub</b>	36.98	34.70	33.28	31.09	30.24	29.37	30.65	34.59	37.25	46.47	48.91	49.03	49.22	50.20	49.24	48.91	48.79	48.94	47.43	48.77	43.18	41.87	38.24	35.51	41.37	45.69		
<b>Cleared Load (GW)</b>	12.3	11.6	11.4	11.1	11.1	11.4	11.5	12.1	13.5	14.3	14.9	15.5	15.6	15.7	15.6	15.6	15.7	15.3	15.1	15.1	14.9	14.0	13.1	12.0				

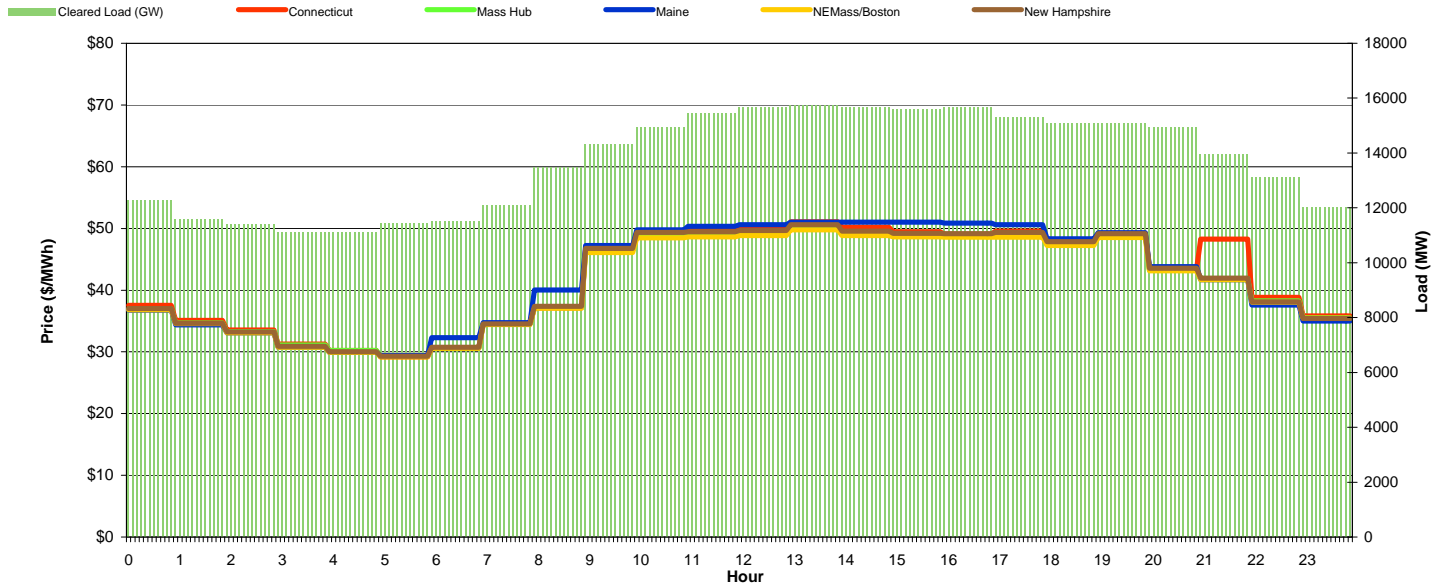

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	69.09	57.67	59.55	69.78	56.81	55.09	44.11	51.90	43.83	49.73	50.44	46.97	41.00	44.74	47.83	49.23	40.74	41.54	38.07	44.62	39.06	38.04	31.81	30.87	47.61	43.72	All	On Pk
<b>NEMass/Boston</b>	67.82	56.94	59.07	69.11	56.43	55.18	44.48	52.02	43.59	49.26	49.59	46.08	40.33	43.73	46.67	48.37	40.34	40.86	37.71	44.23	38.74	37.55	31.39	30.70	47.09	43.15		
<b>New Hampshire</b>	67.43	56.49	58.89	68.74	56.33	55.04	44.46	52.08	43.96	49.87	50.28	46.70	40.77	44.25	47.16	48.82	40.60	41.23	37.97	44.56	38.95	37.64	31.32	30.47	47.25	43.51		
<b>Maine</b>	66.63	55.77	57.74	67.23	55.07	54.10	44.03	51.93	43.99	49.95	50.17	46.71	40.74	43.93	46.98	48.89	40.53	41.00	37.71	44.38	38.70	37.17	30.73	29.71	46.82	43.34		
<b>Mass Hub</b>	68.33	57.30	59.44	69.57	56.77	55.51	44.64	52.28	43.82	49.45	49.77	46.23	40.42	43.90	46.86	48.50	40.39	40.97	37.77	44.30	38.79	37.66	31.53	30.85	47.29	43.29		
<b>DA Forecast Load (GW)</b>	15.00	14.06	13.49	13.11	12.85	13.07	13.45	14.25	15.47	16.68	17.41	17.96	18.00	17.93	17.88	17.67	17.51	17.32	17.04	17.11	16.89	15.96	14.49	13.15				
<b>Forecast Error %</b>	1.5%	2.5%	6.9%	8.4%	9.8%	9.0%	7.8%	4.0%	1.3%	0.5%	-0.2%	-2.0%	-2.5%	-3.2%	-4.3%	-4.4%	-4.5%	-4.5%	-5.4%	-5.6%	-4.6%	-4.1%	-2.5%	-2.0%				

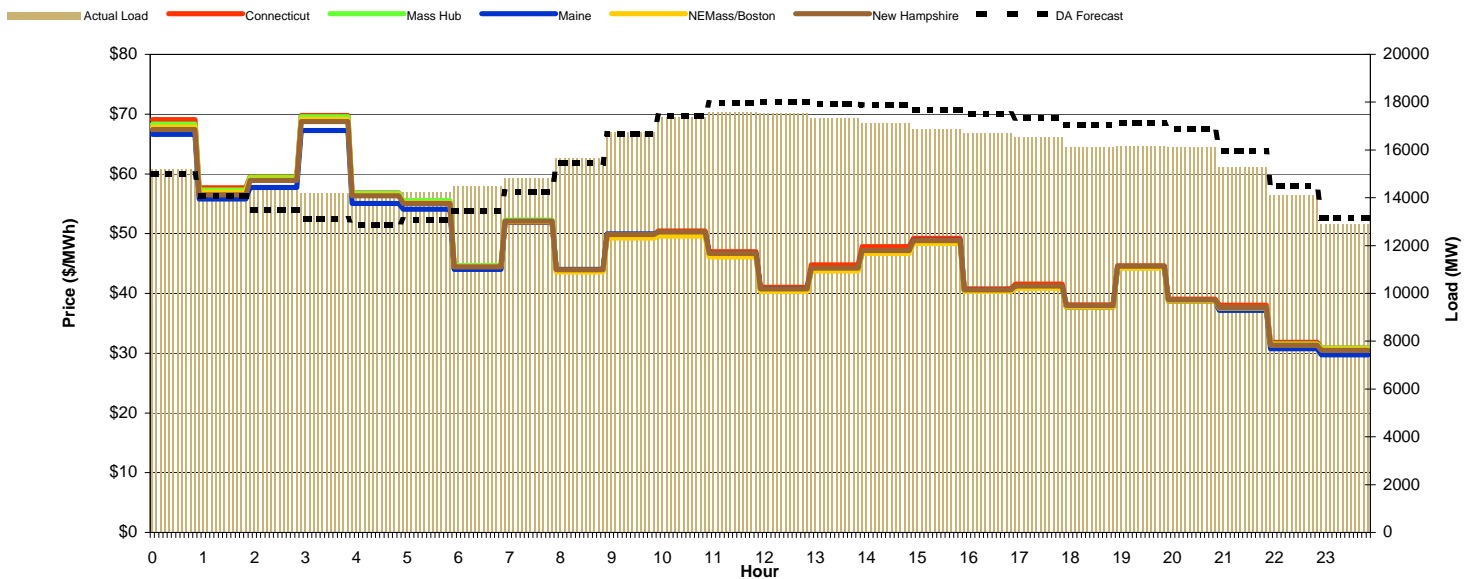




# ISO-NE Daily Report

Sunday September 05, 2010

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	34.53	30.81	29.19	28.83	28.69	28.00	26.78	28.99	34.64	34.88	37.52	38.98	38.83	43.47	42.61	50.43	52.53	52.47	53.85	55.00	54.42	44.33	37.79	34.87	39.27	43.80	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	34.49	30.87	29.24	28.93	28.78	28.19	27.06	29.27	34.52	34.64	36.96	38.15	38.17	38.34	37.25	38.71	44.84	43.04	47.03	48.82	48.78	43.01	36.82	34.44	36.68	39.90		
<b>New Hampshire</b>	34.70	30.97	29.31	28.92	28.80	28.19	27.05	29.37	34.80	34.99	37.36	38.57	38.56	38.74	37.51	39.04	45.21	43.53	47.57	49.45	49.30	43.34	36.89	34.34	36.94	40.26		
<b>Maine</b>	34.78	31.00	29.27	28.86	28.73	28.13	27.27	29.51	38.20	35.34	37.42	38.51	38.62	38.83	37.44	38.99	44.99	43.54	47.44	49.15	48.96	42.75	36.32	33.85	37.00	40.38		
<b>Mass Hub</b>	34.53	30.92	29.28	28.96	28.81	28.21	27.05	29.23	34.70	34.79	37.18	38.41	38.38	38.53	37.44	38.94	45.15	43.21	47.23	49.22	49.13	43.32	37.05	34.57	36.84	40.12		
<b>Cleared Load (GW)</b>	10.8	10.4	10.1	9.9	9.8	9.9	10.1	10.4	11.7	12.7	13.3	13.7	13.9	14.0	13.9	14.0	14.2	14.5	14.4	14.9	14.4	13.4	12.4	11.4				

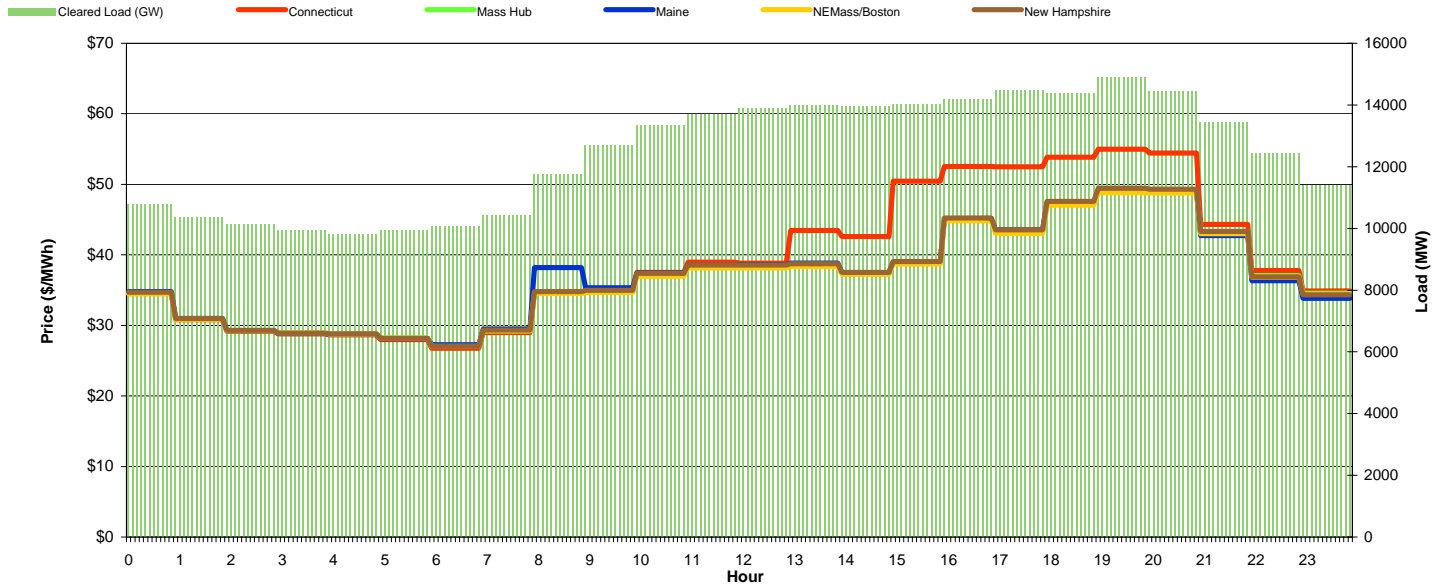

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	32.97	39.32	34.46	29.17	29.17	28.29	23.30	29.36	30.26	31.32	34.12	37.84	36.92	34.64	32.31	33.32	36.03	32.11	35.00	37.57	36.11	35.13	30.73	31.19	32.94	33.92	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	32.96	39.37	34.49	29.45	29.67	28.82	23.78	29.50	30.03	30.96	33.54	37.22	36.37	34.27	31.94	32.89	35.36	31.75	34.61	36.87	35.50	34.48	30.29	31.13	32.72	33.47		
<b>New Hampshire</b>	32.84	39.31	34.44	29.32	29.46	28.64	23.59	29.39	30.03	31.03	33.63	37.22	36.34	34.22	31.82	32.79	35.26	31.71	34.63	36.98	35.60	34.43	30.11	30.80	32.65	33.45		
<b>Maine</b>	32.13	38.27	33.63	28.63	28.72	28.06	23.16	28.92	29.42	30.54	32.86	36.23	35.30	33.39	31.10	32.07	34.43	31.03	33.80	36.12	34.85	33.45	29.18	29.86	31.88	32.67		
<b>Mass Hub</b>	33.11	39.53	34.62	29.51	29.66	28.81	23.76	29.59	30.22	31.17	33.79	37.48	36.62	34.49	32.14	33.09	35.61	31.93	34.80	37.13	35.74	34.76	30.51	31.33	32.89	33.69		
<b>DA Forecast Load (GW)</b>	12.13	11.38	10.87	10.58	10.47	10.54	10.67	11.29	12.39	13.46	14.14	14.61	14.80	14.81	14.77	14.76	14.89	15.03	14.97	15.22	15.20	14.35	13.22	12.06				
<b>Forecast Error %</b>	-2.1%	1.0%	4.5%	4.7%	4.8%	4.8%	4.4%	3.9%	-0.1%	-1.4%	-2.0%	-3.1%	-3.5%	-4.1%	-4.6%	-4.9%	-5.3%	-5.4%	-5.4%	-5.5%	-5.2%	-4.4%	-3.3%	-2.5%				

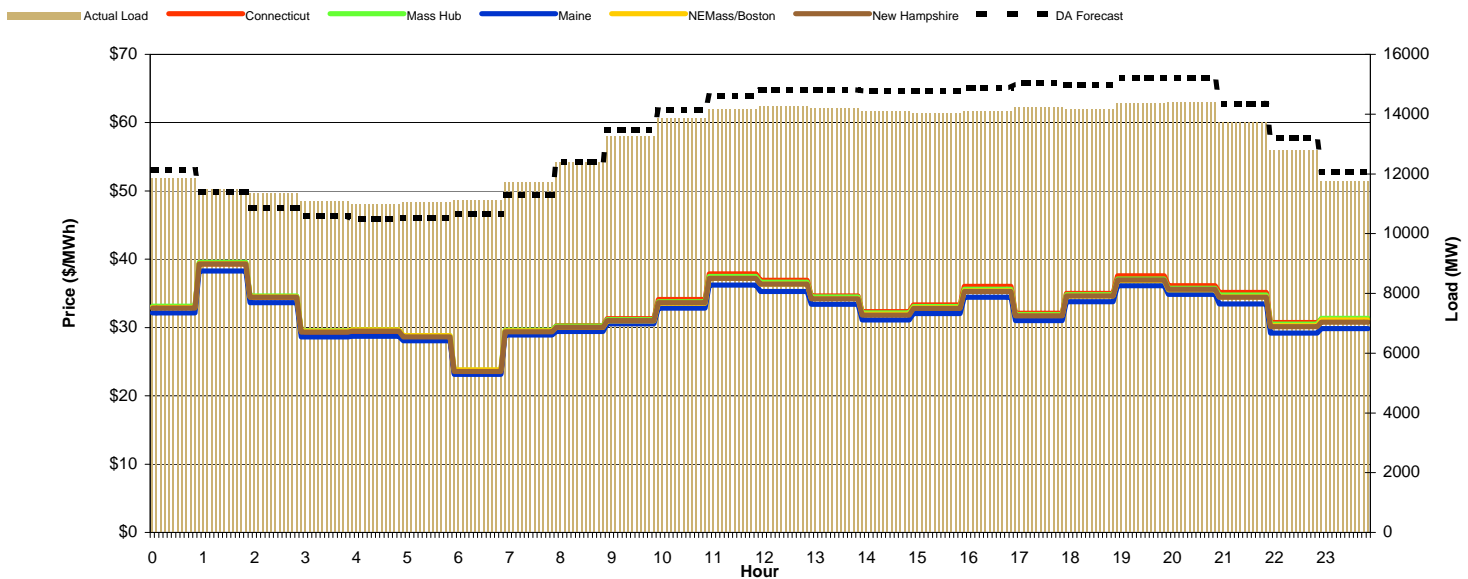




# ISO-NE Daily Report

Monday September 06, 2010

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	36.10	32.35	30.51	28.28	28.06	27.08	31.02	32.85	37.57	38.77	42.91	51.86	53.13	54.85	55.25	55.61	55.99	55.99	55.69	55.29	55.64	50.00	40.53	37.45	37.45	43.45	49.50	
<b>NEMass/Boston</b>	36.17	32.63	30.86	28.62	28.48	27.65	31.46	33.14	37.80	38.47	42.38	41.67	44.14	48.47	48.42	48.50	48.61	48.60	48.55	48.91	51.57	48.50	39.67	37.08	40.43	44.84	40.43	44.84
<b>New Hampshire</b>	35.76	32.39	30.62	28.36	28.23	27.41	31.29	32.92	37.77	38.71	42.69	42.03	44.58	49.00	48.76	48.85	49.00	49.20	49.06	49.41	52.09	48.80	39.61	36.97	40.56	45.16	40.56	45.16
<b>Maine</b>	35.26	32.07	30.36	28.07	27.96	27.28	31.29	32.74	37.76	38.79	42.54	41.76	44.38	48.84	48.61	48.54	48.87	49.07	48.94	49.16	51.70	48.02	38.70	36.59	40.30	44.90	40.30	44.90
<b>Mass Hub</b>	36.09	32.47	30.70	28.50	28.35	27.53	31.35	33.05	37.70	38.61	42.56	41.86	44.40	48.81	48.72	48.83	48.89	48.91	48.72	49.18	51.91	48.87	39.89	37.11	40.54	45.06	40.54	45.06
<b>Cleared Load (GW)</b>	10.1	9.5	9.5	9.4	9.5	9.8	9.8	10.4	11.7	12.9	13.5	13.8	14.1	14.1	14.1	14.2	14.7	14.8	14.8	15.6	14.9	13.6	12.3	11.3				

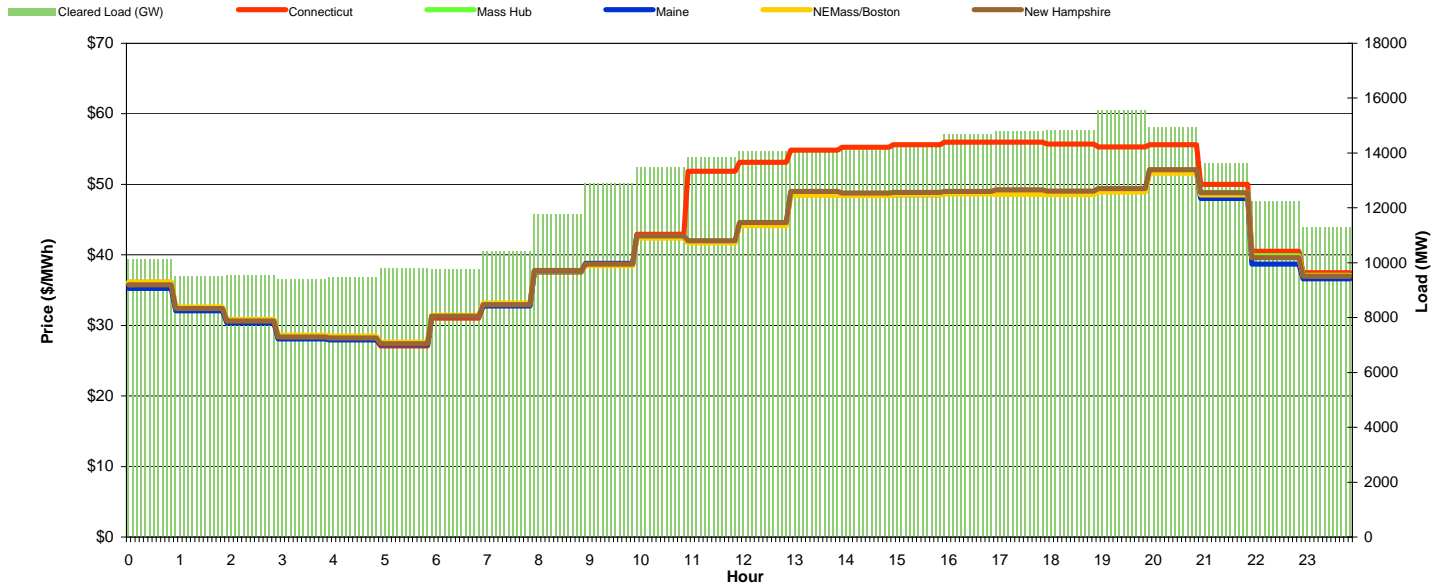

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	31.58	29.91	28.26	27.99	28.13	33.75	28.11	30.27	29.45	36.32	36.83	40.28	50.75	38.34	36.82	38.66	37.81	41.95	39.80	50.25	40.52	37.85	31.13	30.14	35.62	38.56	35.62	38.56
<b>NEMass/Boston</b>	31.84	30.49	28.99	28.77	28.92	34.66	28.89	30.61	29.69	36.43	36.69	40.15	50.46	38.09	36.50	38.26	37.42	41.48	39.58	49.73	39.68	37.10	30.58	29.84	35.62	38.28	35.62	38.28
<b>New Hampshire</b>	31.46	30.02	28.53	28.37	28.55	34.19	28.51	30.31	29.52	36.41	36.76	40.19	50.51	38.07	36.37	38.14	37.38	41.56	39.70	50.03	39.92	37.11	30.48	29.58	35.49	38.28	35.49	38.28
<b>Maine</b>	30.54	29.12	27.68	27.75	28.00	33.42	28.08	29.91	29.09	36.05	36.18	39.48	49.56	37.41	35.70	37.55	36.87	41.09	39.32	49.69	39.50	36.41	29.77	28.94	34.88	37.72	34.88	37.72
<b>Mass Hub</b>	31.95	30.45	28.91	28.69	28.82	34.54	28.78	30.56	29.65	36.45	36.80	40.30	50.69	38.26	36.66	38.44	37.58	41.65	39.71	49.93	39.94	37.34	30.78	29.95	35.70	38.42	35.70	38.42
<b>DA Forecast Load (GW)</b>	11.05	10.45	10.08	9.89	9.85	10.02	10.28	11.05	12.23	13.33	14.08	14.52	14.70	14.68	14.63	14.68	14.89	15.15	15.20	15.69	15.75	14.74	13.32	12.02				
<b>Forecast Error %</b>	-1.1%	-0.6%	2.6%	3.0%	3.7%	4.5%	4.3%	1.1%	0.9%	1.3%	1.3%	0.7%	0.4%	0.5%	0.9%	1.2%	1.5%	1.5%	0.9%	0.9%	0.8%	0.7%	0.5%	0.9%				

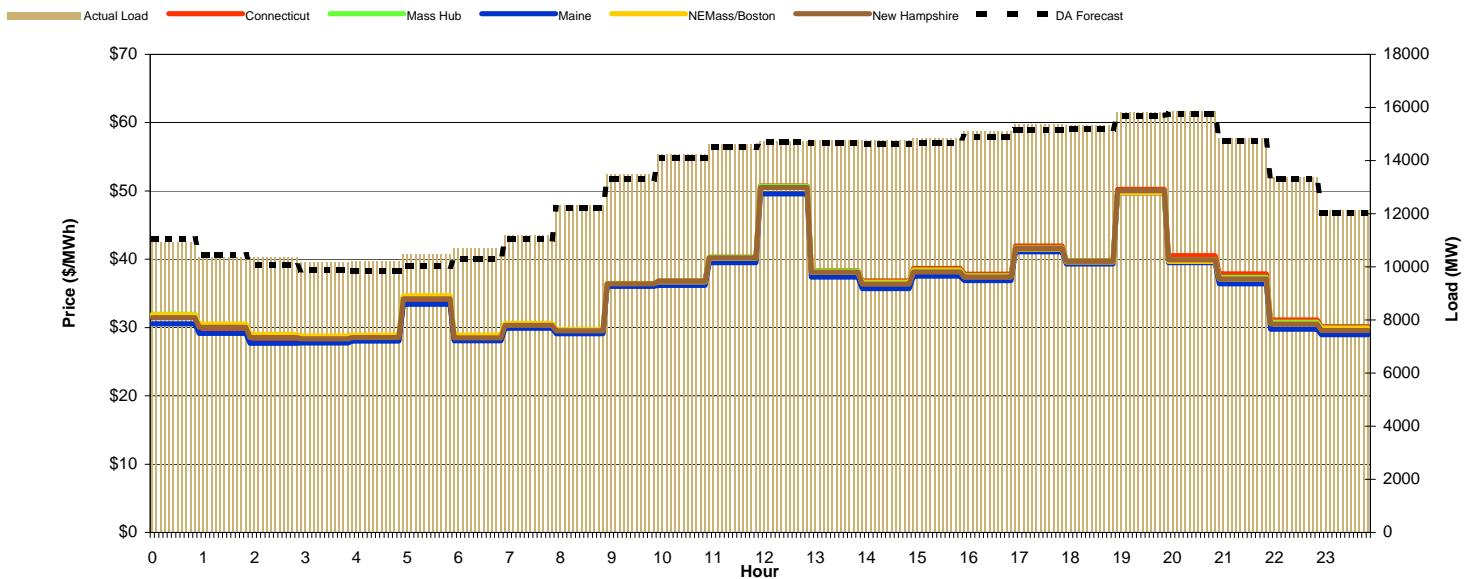




# ISO-NE Daily Report

Tuesday September 07, 2010

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$		
<b>Connecticut</b>	35.90	31.16	29.06	28.20	29.23	32.52	42.20	46.44	49.98	50.58	55.37	62.96	59.63	69.46	69.26	67.29	71.16	66.54	61.03	63.69	58.15	51.54	47.37	40.62	40.62	50.81	59.40
<b>NEMass/Boston</b>	35.71	31.15	29.01	28.12	29.18	32.77	42.21	45.27	48.58	48.81	52.85	56.62	57.42	67.00	66.85	64.76	68.07	63.83	58.49	61.35	53.05	48.89	45.50	39.90	48.97	48.97	56.71
<b>New Hampshire</b>	35.39	30.97	28.83	27.92	29.04	32.68	41.84	45.10	48.63	49.08	53.28	57.14	57.98	67.56	67.35	65.10	68.48	64.50	59.22	62.06	53.61	49.19	45.33	39.38	49.15	49.15	57.10
<b>Maine</b>	34.60	30.55	28.42	27.51	28.66	32.59	41.21	44.41	47.85	48.48	52.01	55.78	56.82	66.54	66.14	64.15	67.31	63.14	57.75	60.59	52.29	47.78	43.82	38.15	48.19	48.19	55.93
<b>Mass Hub</b>	35.85	31.26	29.11	28.22	29.27	32.84	42.31	45.78	49.20	49.46	53.64	57.48	58.17	67.89	67.64	65.59	69.00	64.66	59.24	62.17	53.80	49.60	46.11	40.08	49.52	49.52	57.46
<b>Cleared Load (GW)</b>	11.7	11.2	10.7	10.5	10.7	11.5	12.6	13.7	15.0	16.0	17.1	17.6	18.0	18.3	18.5	18.5	18.3	17.9	17.6	17.8	17.7	16.0	14.0	13.0			

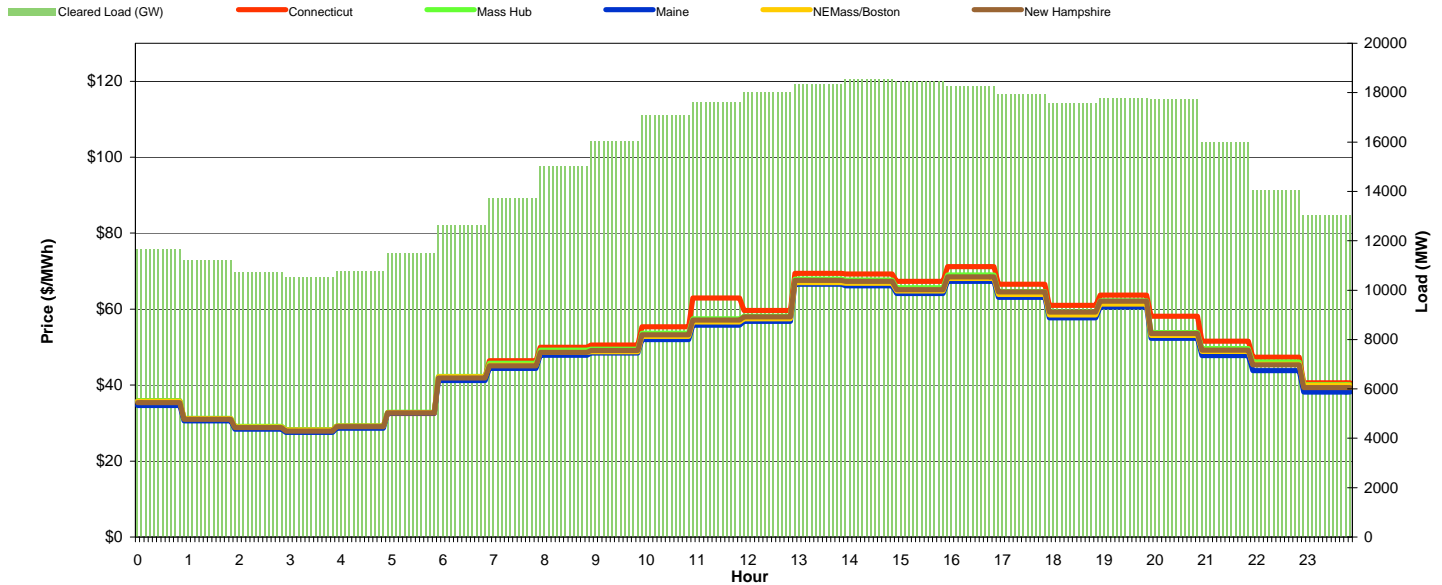

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$	
<b>Connecticut</b>	27.21	28.52	28.57	27.02	29.16	29.41	39.24	41.80	39.84	45.76	42.35	38.93	47.91	72.05	85.57	120.31	86.16	66.51	45.03	79.25	55.80	41.59	36.24	33.35	49.48	59.07
<b>NEMass/Boston</b>	26.99	28.35	28.48	27.01	29.16	29.60	39.04	40.89	38.81	44.55	40.98	37.66	46.18	69.37	82.61	116.10	83.07	64.16	43.37	76.33	53.58	39.78	34.82	32.66	48.06	57.02
<b>New Hampshire</b>	26.69	28.07	28.18	26.72	28.84	29.30	38.97	40.94	38.90	44.66	41.16	37.84	46.35	69.58	82.66	116.04	83.08	64.40	43.61	76.90	53.96	39.95	34.81	32.43	48.09	57.18
<b>Maine</b>	26.00	27.33	27.37	26.02	28.07	28.75	38.46	40.37	38.29	43.91	40.38	37.01	45.06	67.71	80.52	113.63	81.23	62.83	42.76	75.70	52.96	39.07	33.74	31.48	47.03	55.95
<b>Mass Hub</b>	27.10	28.48	28.60	27.11	29.26	29.64	39.17	41.24	39.14	44.90	41.32	37.93	46.50	69.89	83.22	116.96	83.74	64.70	43.74	76.96	54.11	40.23	35.20	32.82	48.42	57.49
<b>DA Forecast Load (GW)</b>	11.12	10.67	10.44	10.37	10.60	11.43	13.07	14.68	15.65	16.56	17.40	18.05	18.48	18.84	19.10	19.33	19.50	19.25	18.85	18.74	18.52	17.43	15.83	14.27		
<b>Forecast Error %</b>	3.9%	4.4%	4.6%	5.0%	5.4%	5.8%	5.3%	3.8%	3.2%	5.2%	1.3%	1.1%	1.8%	2.9%	3.4%	3.1%	2.3%	3.0%	2.7%	4.4%	5.0%	4.1%	3.0%	2.6%		

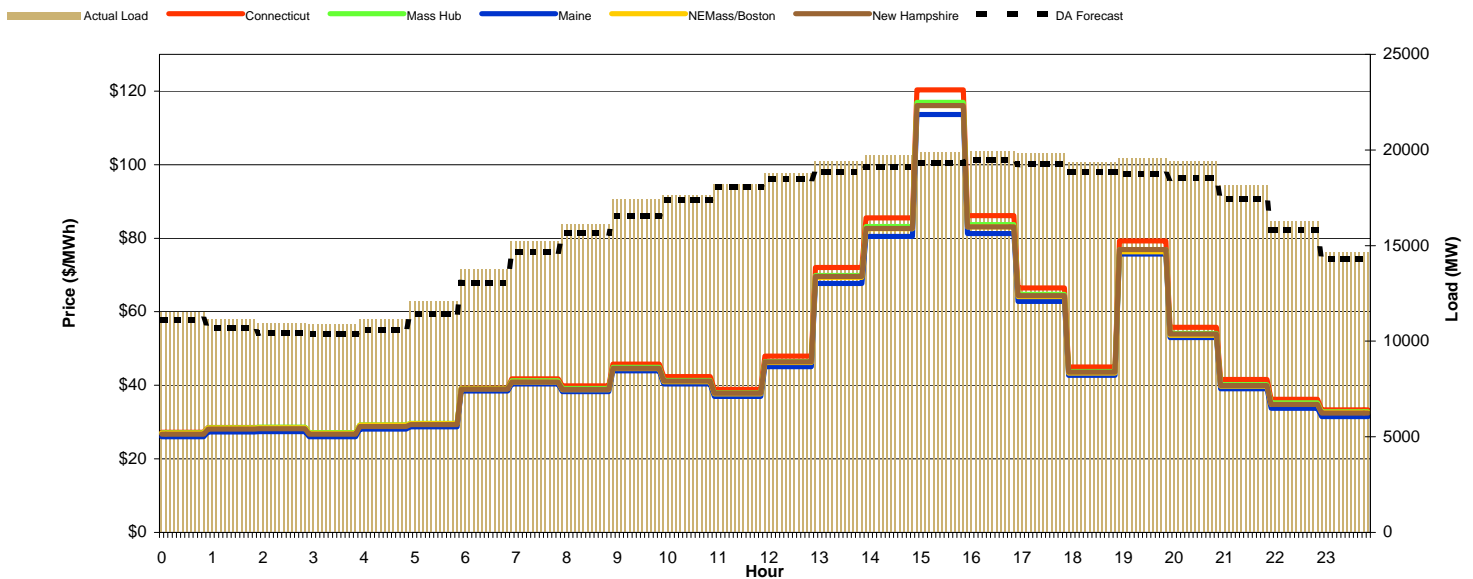




# ISO-NE Daily Report

Wednesday September 08, 2010

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	33.71	31.54	29.75	27.56	29.42	31.84	35.51	38.79	39.26	50.57	56.28	57.75	61.72	58.21	57.69	61.74	59.18	57.09	55.58	58.27	55.41	42.22	38.06	36.06	45.97	52.99	All	On Pk
NEMass/Boston	33.40	31.35	29.53	27.33	29.18	31.82	35.43	38.15	38.33	47.67	49.45	51.41	52.98	54.42	54.15	53.20	53.43	52.61	48.83	51.24	48.93	38.49	37.04	35.75	42.67	48.15	42.67	48.15
New Hampshire	33.37	31.25	29.42	27.20	29.11	31.85	35.84	38.51	38.67	48.08	50.00	52.00	53.51	54.97	54.57	53.47	53.89	53.09	49.26	51.83	49.38	38.68	37.31	35.84	42.96	48.58	42.96	48.58
Maine	32.70	30.46	28.65	26.56	28.51	31.35	35.90	38.46	41.39	47.83	49.52	51.24	52.33	54.02	53.77	52.71	53.18	52.39	48.94	51.47	48.85	38.19	37.03	35.41	42.54	48.21	42.54	48.21
Mass Hub	33.61	31.58	29.75	27.50	29.37	31.93	35.54	38.32	38.61	47.97	49.81	51.75	53.39	54.77	54.52	53.63	53.89	53.01	49.04	51.70	49.22	38.74	37.21	35.78	42.94	48.47	42.94	48.47
Cleared Load (GW)	12.4	12.0	11.6	11.3	11.4	12.2	13.9	15.1	16.4	17.0	18.1	18.6	18.7	19.1	19.3	19.0	18.7	18.5	17.9	18.3	17.6	16.4	14.1	12.5				

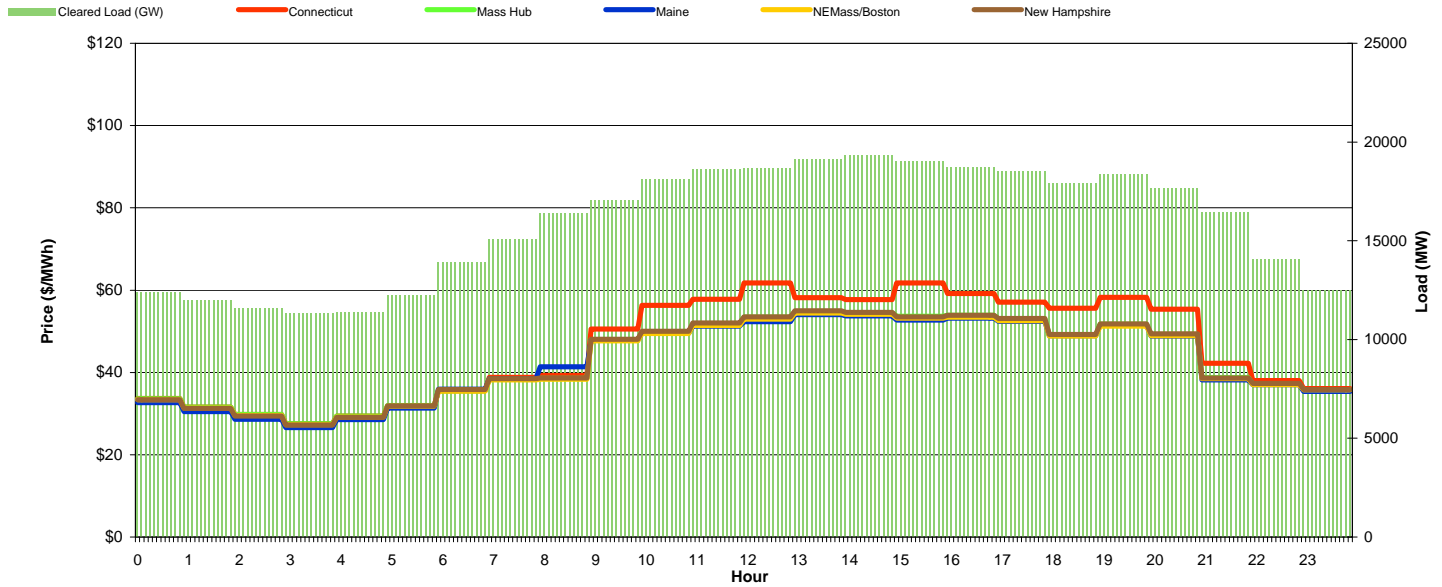

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	36.10	37.27	31.02	30.28	32.41	41.74	54.13	50.32	38.34	59.30	59.87	82.37	94.22	106.24	88.94	78.87	86.28	65.51	55.45	53.29	37.82	34.61	31.28	29.81	54.81	63.92	All	On Pk
NEMass/Boston	35.63	36.75	30.72	29.97	32.11	41.30	53.62	49.40	37.69	57.90	58.11	80.01	90.95	103.11	86.31	76.35	49.95	37.29	34.67	38.97	36.83	33.66	30.68	29.76	49.66	56.37	49.66	56.37
New Hampshire	35.37	36.52	30.50	29.76	31.95	41.30	53.85	49.71	37.91	58.24	58.49	80.28	90.92	102.92	86.00	75.98	49.78	37.27	34.88	39.38	37.14	33.78	30.80	29.73	49.69	56.47	49.69	56.47
Maine	34.50	35.56	29.78	29.02	31.24	40.53	53.25	49.25	37.69	57.41	57.51	78.51	88.39	100.32	83.93	74.41	48.52	36.31	34.32	38.60	36.24	32.77	30.14	29.12	48.64	55.27	48.64	55.27
Mass Hub	35.78	36.93	30.82	30.07	32.20	41.42	53.80	49.69	37.96	58.43	58.73	80.82	91.74	103.80	86.88	76.90	50.39	37.60	34.85	39.17	37.07	33.91	30.86	29.80	49.98	56.80	49.98	56.80
DA Forecast Load (GW)	13.28	12.49	12.09	11.86	12.07	12.96	14.65	16.15	17.15	18.10	18.84	19.39	19.59	20.05	20.20	20.03	19.85	19.45	18.90	18.84	18.31	16.84	15.11	13.37				
Forecast Error %	1.6%	2.7%	2.9%	3.6%	3.2%	3.7%	4.9%	3.8%	1.9%	0.7%	0.9%	1.0%	1.7%	1.0%	0.4%	0.5%	-0.2%	-1.4%	-2.8%	-2.6%	-2.2%	-1.7%	-1.9%	-1.2%				

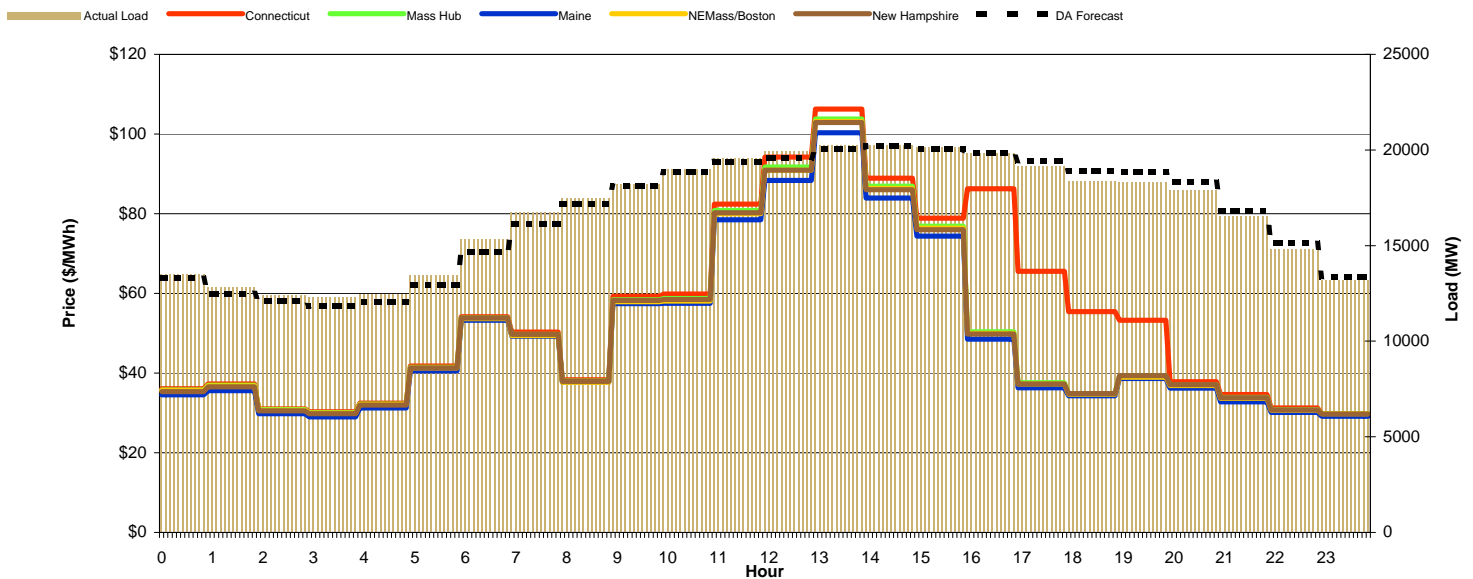






# ISO-NE Daily Report

Thursday September 09, 2010

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$				
<b>Connecticut</b>	34.24	29.56	27.05	24.92	20.77	29.65	36.04	38.85	40.65	40.68	46.22	51.90	51.46	52.82	53.78	50.92	49.95	47.95	45.87	55.37	46.00	41.25	38.28	36.29	36.29	41.27	47.00	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	34.41	29.69	27.03	24.92	20.83	29.91	35.55	37.79	39.29	39.59	44.79	49.88	49.53	50.82	51.61	48.86	48.05	46.06	40.30	51.53	43.36	39.77	36.98	35.86	39.85	44.89			
<b>New Hampshire</b>	34.59	29.83	27.17	25.05	20.94	30.11	36.08	38.20	39.57	39.95	45.13	50.24	49.80	51.03	51.75	49.04	48.28	46.33	40.62	52.04	43.75	39.93	37.10	36.00	40.11	45.17			
<b>Maine</b>	35.42	34.98	30.99	30.59	31.15	35.13	36.94	37.63	39.05	39.77	44.11	48.89	48.48	50.00	50.65	48.05	47.24	45.15	40.03	50.27	42.73	39.15	36.28	35.26	40.75	44.22			
<b>Mass Hub</b>	34.42	29.63	27.02	24.94	20.84	29.88	35.78	38.17	39.71	39.99	45.28	50.48	50.13	51.41	52.20	49.38	48.51	46.53	40.64	52.35	43.93	40.23	37.34	36.02	40.20	45.39			
<b>Cleared Load (GW)</b>	11.1	10.2	9.7	9.7	9.9	10.5	12.6	13.9	14.6	15.8	16.1	16.1	16.2	16.3	16.3	16.2	16.1	16.0	15.9	16.4	15.7	14.3	12.4	11.0					

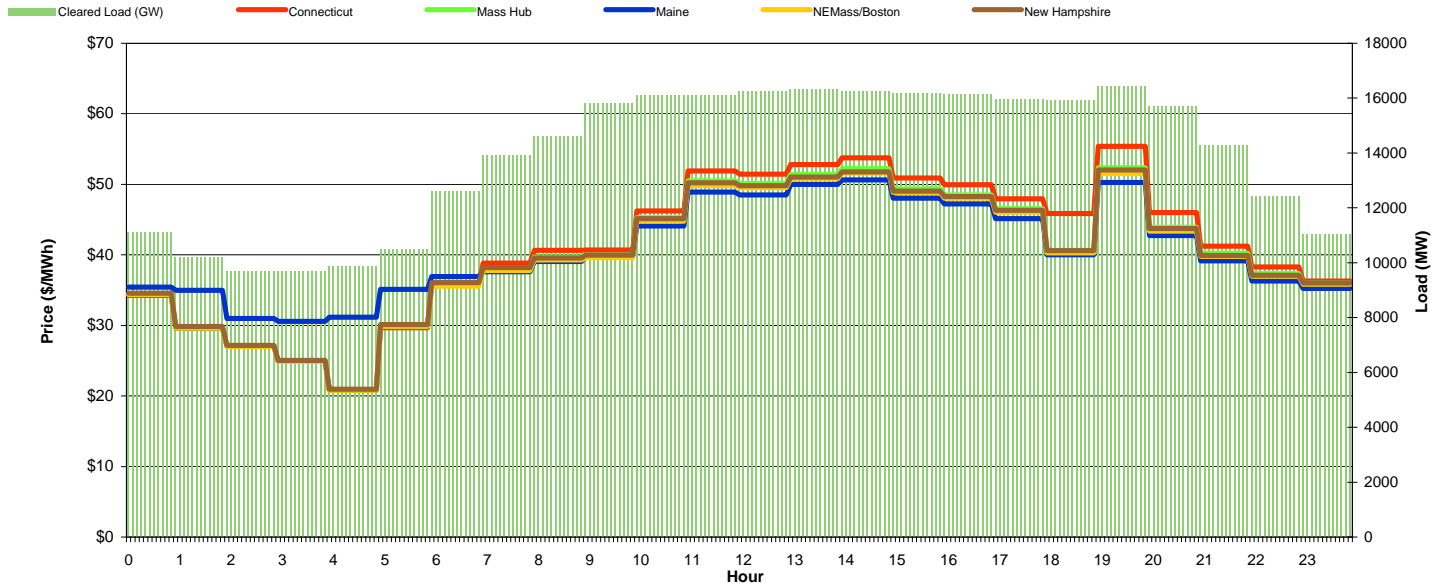

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	32.22	31.74	30.06	29.67	29.15	29.88	35.43	41.89	41.50	39.62	40.44	44.50	40.91	40.62	39.97	39.98	40.01	41.35	40.37	43.72	46.94	44.01	35.20	50.70	38.75	41.31	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	32.45	32.06	30.41	30.10	29.54	30.30	35.24	40.99	40.42	38.65	39.53	43.38	39.88	39.65	38.99	38.93	39.01	40.26	39.48	42.82	45.85	42.91	34.31	50.46	38.15	40.32		
<b>New Hampshire</b>	32.42	32.03	30.46	30.15	29.56	30.20	35.39	41.28	40.63	38.89	39.70	43.55	39.99	39.70	39.02	38.96	39.13	40.39	39.70	43.01	45.99	42.93	34.19	50.26	38.23	40.44		
<b>Maine</b>	31.81	31.40	30.13	29.94	29.28	29.91	34.94	40.56	40.05	38.42	39.13	42.80	39.32	39.20	38.38	38.27	38.61	39.83	39.42	42.60	45.31	42.03	33.26	48.59	37.63	39.82		
<b>Mass Hub</b>	32.45	32.05	30.40	30.09	29.55	30.31	35.46	41.39	40.85	39.00	39.84	43.75	40.19	39.94	39.27	39.23	39.29	40.58	39.79	43.15	46.25	43.37	34.72	50.76	38.40	40.66		
<b>DA Forecast Load (GW)</b>	12.21	11.60	11.19	11.05	11.26	12.11	13.95	15.22	15.85	16.47	16.91	17.32	17.44	17.60	17.54	17.33	17.17	17.02	16.75	17.15	16.76	15.59	14.07	12.60				
<b>Forecast Error %</b>	-1.1%	-1.3%	-1.0%	-1.0%	-1.6%	-1.6%	-3.3%	-2.8%	-1.4%	-1.6%	-1.6%	-3.0%	-3.5%	-4.1%	-4.4%	-4.4%	-4.1%	-3.8%	-2.8%	-2.5%	-1.9%	-1.6%	-1.9%	-1.7%				

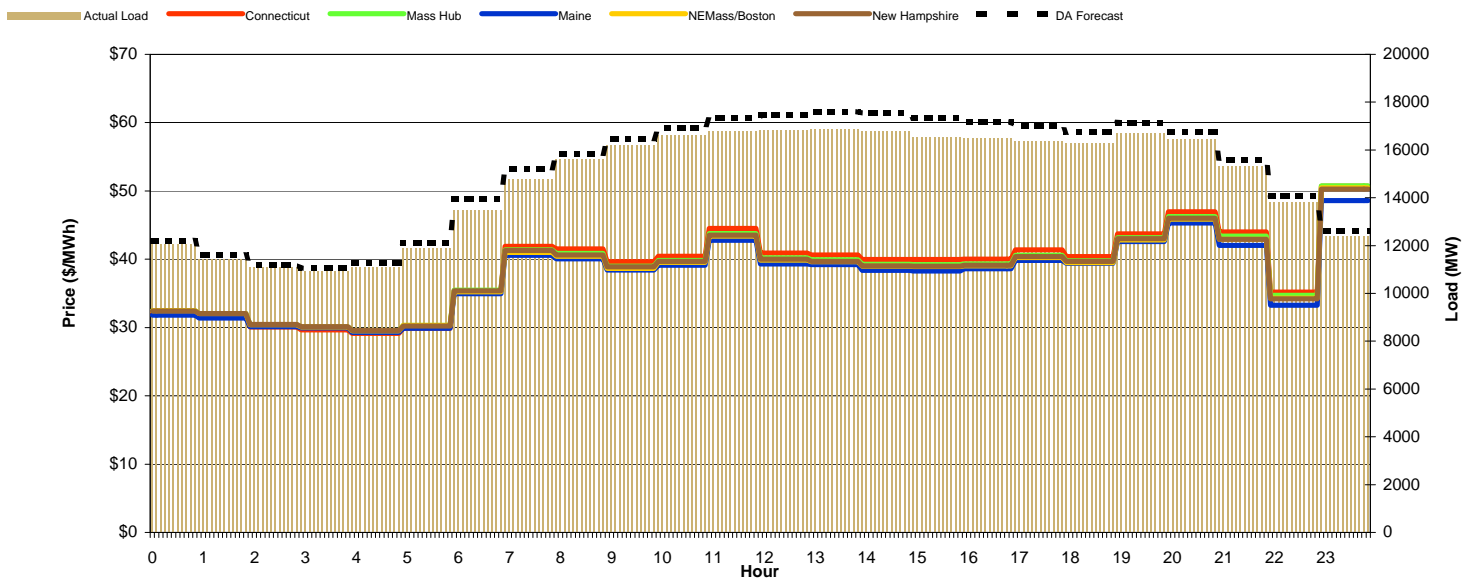




# ISO-NE Daily Report

Friday September 10, 2010

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	35.24	32.00	27.87	25.40	28.58	31.81	37.62	40.00	42.83	46.49	47.38	48.15	50.00	49.04	55.00	49.91	55.00	48.56	45.28	48.02	44.48	41.22	38.15	35.57	41.82	46.84	All	On Pk
<b>NEMass/Boston</b>	35.18	32.05	27.90	25.37	28.52	32.02	37.27	38.71	40.75	43.98	45.15	45.98	46.68	46.77	46.55	45.28	44.29	44.02	42.82	44.56	42.27	39.31	36.91	35.29	39.48	43.38		
<b>New Hampshire</b>	35.14	32.00	27.85	25.36	28.51	32.06	37.15	38.89	40.95	44.25	45.34	46.09	46.70	46.74	46.52	45.25	44.41	44.13	42.97	44.85	42.45	39.35	36.83	35.39	39.55	43.48		
<b>Maine</b>	34.28	31.12	27.26	24.87	27.84	31.51	36.27	37.94	39.83	42.88	43.67	44.15	44.65	45.13	45.00	43.55	42.82	42.78	41.50	43.42	41.09	38.25	35.99	35.54	38.39	42.04		
<b>Mass Hub</b>	35.30	32.17	28.02	25.47	28.65	32.06	37.61	39.12	41.34	44.67	45.80	46.64	47.42	47.47	47.21	46.00	45.00	44.69	43.47	45.28	42.91	39.84	37.27	35.40	39.95	44.01		
<b>Cleared Load (GW)</b>	10.5	10.1	9.7	9.7	9.6	10.3	12.3	13.3	13.9	14.4	15.1	15.4	15.3	15.6	15.4	15.3	15.3	15.1	14.6	15.4	14.6	13.2	11.8	10.6				

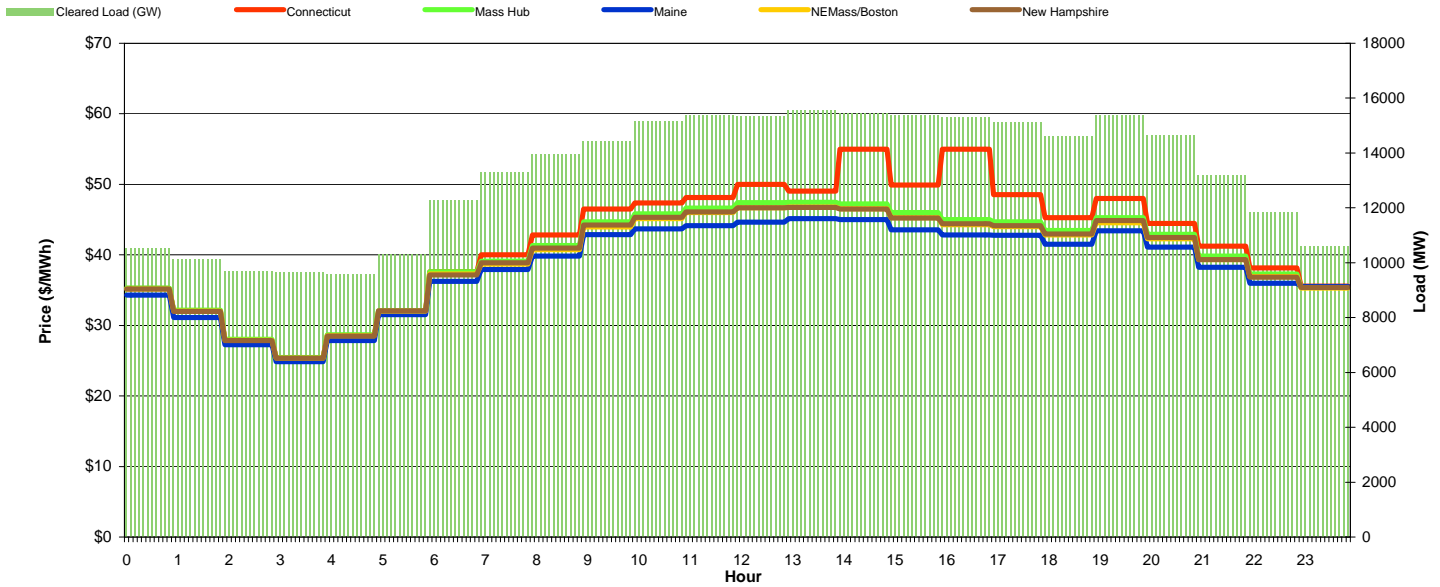

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	34.25	30.68	29.74	28.49	30.07	37.01	43.86	48.79	48.48	61.30	53.29	57.46	56.21	55.98	53.82	44.40	40.59	40.22	40.92	51.97	54.27	48.41	36.67	34.26	44.21	49.55	All	On Pk
<b>NEMass/Boston</b>	34.16	30.81	29.83	28.51	29.99	36.80	43.37	47.38	46.41	58.50	48.48	38.53	42.26	39.27	39.34	40.87	39.23	38.78	39.37	50.24	52.01	46.38	35.61	33.95	40.42	43.92		
<b>New Hampshire</b>	34.10	30.72	29.73	28.37	29.83	36.57	43.15	47.41	46.60	58.70	48.56	38.54	42.20	39.16	39.26	40.72	39.20	38.80	39.42	50.13	51.91	46.20	35.35	33.85	40.35	43.89		
<b>Maine</b>	33.09	30.00	29.02	27.56	29.04	35.60	42.09	46.14	45.44	56.91	47.18	37.34	40.78	37.95	38.42	39.45	38.13	37.61	38.28	48.65	50.00	44.42	34.38	33.43	39.20	42.57		
<b>Mass Hub</b>	34.35	30.88	29.91	28.61	30.13	37.01	43.70	47.95	47.14	59.50	49.19	38.99	42.80	39.78	39.79	41.38	39.69	39.28	39.91	50.90	52.85	47.15	36.07	34.21	40.88	44.52		
<b>DA Forecast Load (GW)</b>	11.58	10.98	10.62	10.52	10.72	11.53	13.06	14.35	15.32	15.99	16.45	16.71	16.80	16.90	16.70	16.51	16.36	16.16	15.89	16.00	15.79	14.91	13.70	12.36				
<b>Forecast Error %</b>	-1.4%	-1.2%	-0.6%	-0.6%	-0.6%	0.2%	1.1%	0.9%	-0.9%	-1.8%	-2.4%	-3.3%	-4.1%	-4.7%	-4.4%	-4.6%	-4.7%	-4.5%	-3.4%	-1.7%	-1.8%	-1.6%	-1.8%	-1.6%				

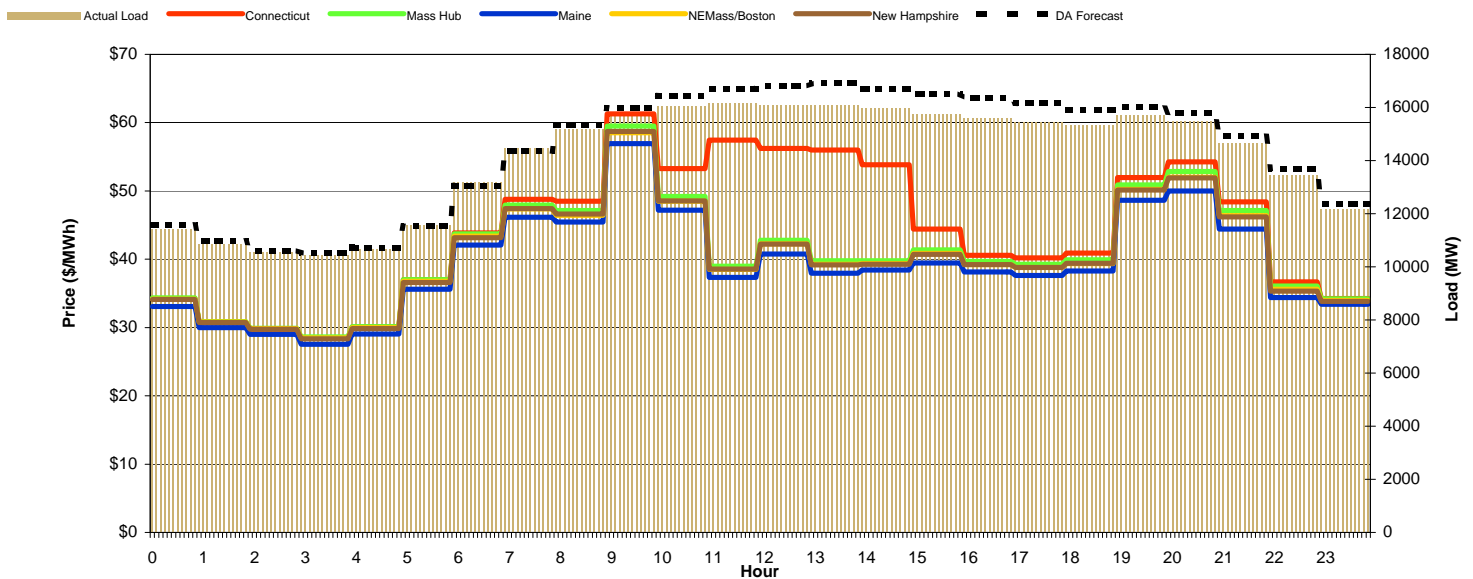




# ISO-NE Daily Report

Saturday September 11, 2010

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	36.06	35.80	31.69	30.22	30.37	30.75	33.15	34.14	35.68	40.64	44.42	44.67	43.10	44.14	45.58	45.63	45.96	40.34	41.89	52.29	46.43	36.84	37.44	34.97	39.26	42.45	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	35.93	36.03	32.05	30.57	30.66	31.15	33.50	34.01	35.43	39.82	43.49	43.56	41.98	42.84	44.13	44.21	44.67	39.45	40.92	50.87	45.12	36.38	37.20	34.98	38.71	41.51		
<b>New Hampshire</b>	36.04	36.15	32.24	30.72	30.81	31.33	33.79	34.18	35.67	40.02	43.65	43.78	42.11	42.92	44.21	44.28	44.87	39.62	41.12	51.12	45.38	36.58	37.30	35.11	38.88	41.68		
<b>Maine</b>	35.75	35.90	32.41	30.91	30.97	31.61	34.27	33.95	35.71	39.80	43.00	43.13	41.42	42.33	43.56	43.66	44.33	39.42	40.94	50.34	44.85	36.14	36.56	35.07	38.58	41.20		
<b>Mass Hub</b>	36.19	36.19	32.15	30.62	30.70	31.18	33.57	34.23	35.71	40.26	43.96	44.01	42.38	43.29	44.64	44.71	45.15	39.75	41.31	51.55	45.68	36.60	37.35	35.11	39.01	41.91		
<b>Cleared Load (GW)</b>	10.7	10.2	9.6	9.4	9.3	9.4	9.9	10.9	12.5	13.6	14.0	13.9	13.8	13.7	13.6	13.7	13.9	13.6	13.6	13.8	13.7	12.9	11.3	10.5				

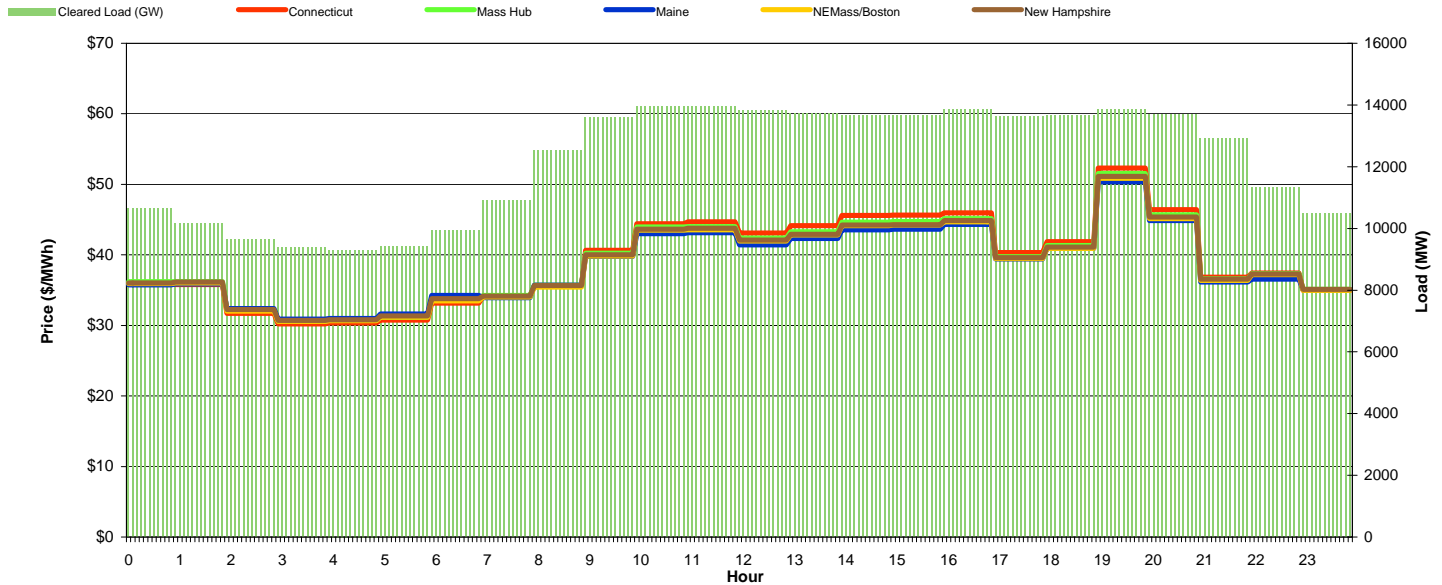

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	35.39	30.09	33.48	41.75	31.70	33.16	30.10	30.06	33.17	39.54	39.62	39.60	40.24	39.65	38.92	39.17	39.04	39.25	42.35	59.13	43.77	36.62	35.17	32.16	37.63	39.71	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	35.34	30.27	33.87	42.01	31.92	33.40	30.12	29.81	33.05	39.11	39.07	39.04	39.52	38.97	38.39	38.59	38.55	38.74	41.84	58.30	43.14	35.97	34.77	32.05	37.33	39.18		
<b>New Hampshire</b>	35.29	30.26	33.84	42.00	31.96	33.47	30.10	29.81	33.14	39.22	39.05	38.98	39.41	38.85	38.25	38.43	38.49	38.71	41.81	58.24	43.01	36.02	34.80	32.09	37.30	39.14		
<b>Maine</b>	35.15	30.16	33.94	42.09	32.03	33.67	30.24	29.88	33.26	39.13	38.64	38.39	38.79	38.48	37.90	38.11	38.26	38.43	41.57	57.85	42.58	35.64	33.99	31.78	37.08	38.81		
<b>Mass Hub</b>	35.55	30.37	33.90	42.11	31.99	33.47	30.23	29.98	33.19	39.40	39.40	39.34	39.85	39.27	38.64	38.85	38.78	39.01	42.12	58.79	43.49	36.30	35.02	32.23	37.55	39.46		
<b>DA Forecast Load (GW)</b>	11.32	10.69	10.33	10.18	10.15	10.42	11.01	11.92	13.14	14.11	14.55	14.86	14.94	14.84	14.74	14.69	14.72	14.79	14.73	14.97	14.79	14.11	13.11	11.94				
<b>Forecast Error %</b>	-0.8%	-0.6%	-0.6%	-1.1%	-0.8%	-0.6%	-1.5%	-1.0%	-1.3%	-1.9%	-1.6%	-2.5%	-2.8%	-2.5%	-2.4%	-2.1%	-1.8%	-1.8%	-1.8%	-0.4%	-0.2%	-0.8%	-1.2%	-0.9%				

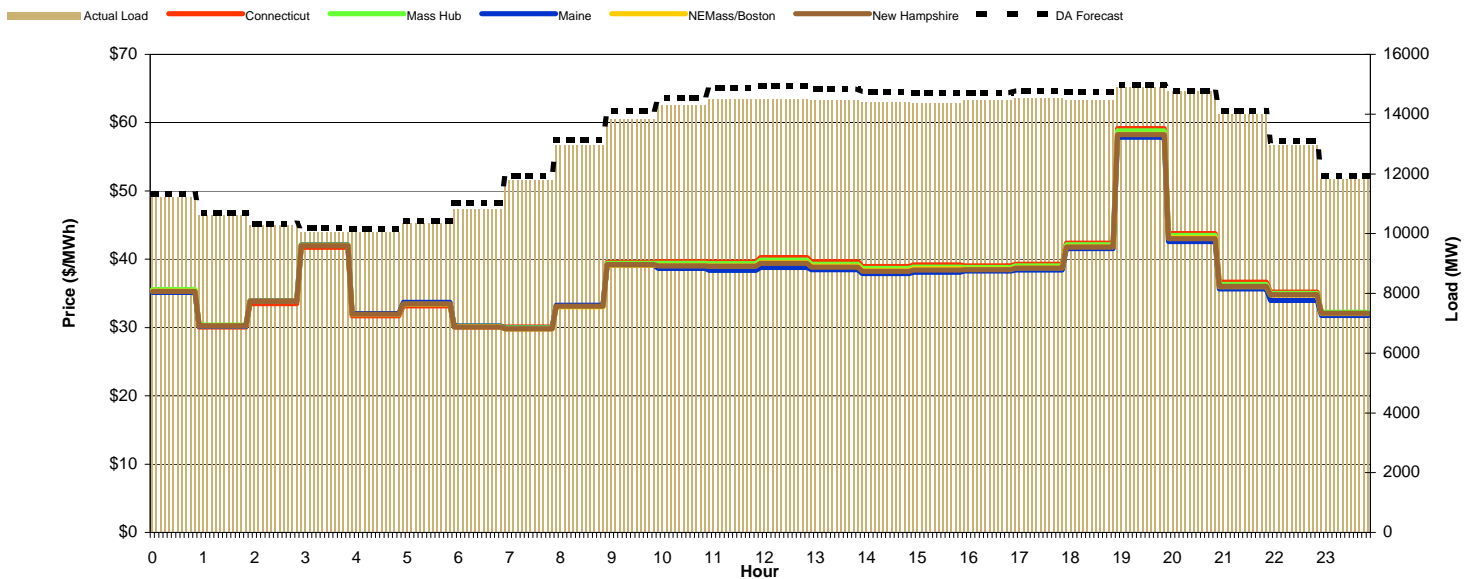




# ISO-NE Daily Report

Sunday September 12, 2010

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	32.55	31.49	28.83	27.65	28.51	28.00	28.51	28.99	32.92	35.77	35.96	38.65	38.06	38.58	36.86	36.87	37.34	39.42	43.20	57.47	44.23	38.23	35.32	34.78	35.76	38.62	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	32.78	31.90	29.25	28.06	28.86	28.43	28.92	29.20	33.17	35.39	35.52	37.94	37.33	37.75	36.16	36.16	36.71	38.49	41.93	55.62	43.00	37.35	34.87	34.78	35.40	37.91		
<b>New Hampshire</b>	33.07	32.06	29.38	28.16	29.01	28.54	29.01	29.26	33.56	35.89	35.87	38.13	37.51	37.90	36.35	36.33	36.85	38.57	42.10	55.73	43.04	37.50	34.91	34.92	35.57	38.09		
<b>Maine</b>	34.18	33.74	32.00	32.00	32.00	29.76	34.96	29.24	33.87	36.03	35.96	37.75	37.16	37.56	36.04	36.06	36.43	38.27	41.88	54.87	42.78	37.20	34.46	35.14	36.22	37.85		
<b>Mass Hub</b>	32.78	31.84	29.18	27.99	28.83	28.40	28.90	29.19	33.16	35.60	35.77	38.32	37.63	38.09	36.45	36.40	36.99	38.81	42.37	56.45	43.42	37.63	35.01	34.77	35.58	38.21		
<b>Cleared Load (GW)</b>	10.1	9.5	9.2	9.0	8.9	9.0	9.2	9.4	10.8	11.7	12.4	12.8	12.8	12.8	12.6	12.7	12.9	13.0	13.4	13.9	13.7	12.3	11.0	10.0				

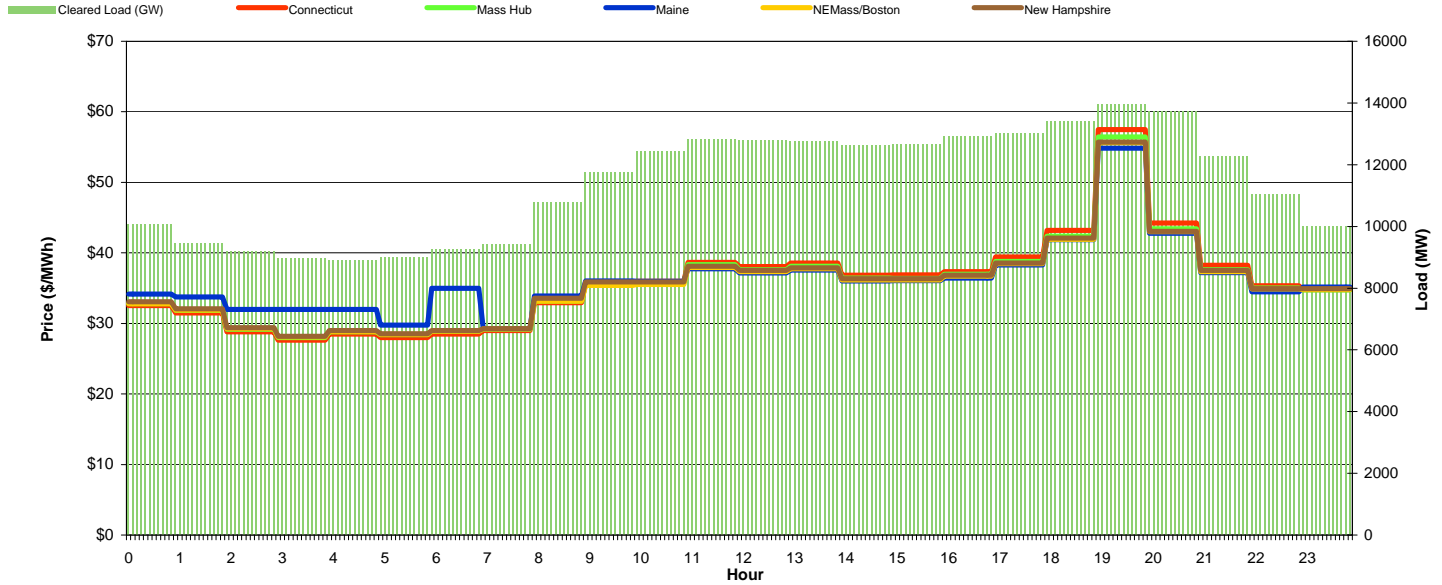

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	34.60	38.95	33.59	31.92	35.23	29.66	38.18	39.51	35.09	34.86	32.82	37.90	39.46	38.35	33.19	34.77	39.16	42.84	47.21	54.26	39.43	35.87	32.38	33.24	37.19	38.57	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	34.82	39.43	34.08	32.40	35.67	30.04	38.50	39.69	35.20	34.59	32.55	37.33	38.56	37.65	32.80	34.33	38.51	41.84	46.12	53.19	38.60	34.95	31.86	32.89	36.90	37.99		
<b>New Hampshire</b>	34.97	39.57	34.25	32.57	35.90	30.17	38.62	39.94	35.57	34.91	32.78	37.50	38.72	37.87	33.00	34.52	38.72	42.06	46.27	53.26	38.58	34.96	31.97	33.03	37.07	38.16		
<b>Maine</b>	35.50	40.27	35.20	33.53	36.98	30.84	39.20	40.17	35.95	35.05	32.88	37.24	38.17	37.96	33.21	34.72	38.80	42.26	46.24	53.14	38.29	34.49	31.49	32.99	37.27	38.13		
<b>Mass Hub</b>	34.89	39.42	34.04	32.35	35.64	30.01	38.51	39.73	35.23	34.74	32.72	37.59	38.92	37.94	32.99	34.53	38.79	42.24	46.58	53.67	38.94	35.30	32.11	33.10	37.08	38.25		
<b>DA Forecast Load (GW)</b>	10.98	10.39	10.02	9.83	9.79	9.89	10.18	10.88	12.01	12.98	13.58	13.92	14.07	14.05	13.95	14.01	14.16	14.34	14.38	14.69	14.69	13.92	12.84	11.66				
<b>Forecast Error %</b>	-0.2%	-0.2%	0.2%	0.3%	0.4%	1.2%	1.1%	0.5%	0.1%	-0.4%	-1.0%	-1.1%	-1.1%	-1.2%	-1.5%	-2.3%	-2.3%	-1.2%	0.7%	2.3%	-0.1%	-1.4%	-2.8%	-2.7%				

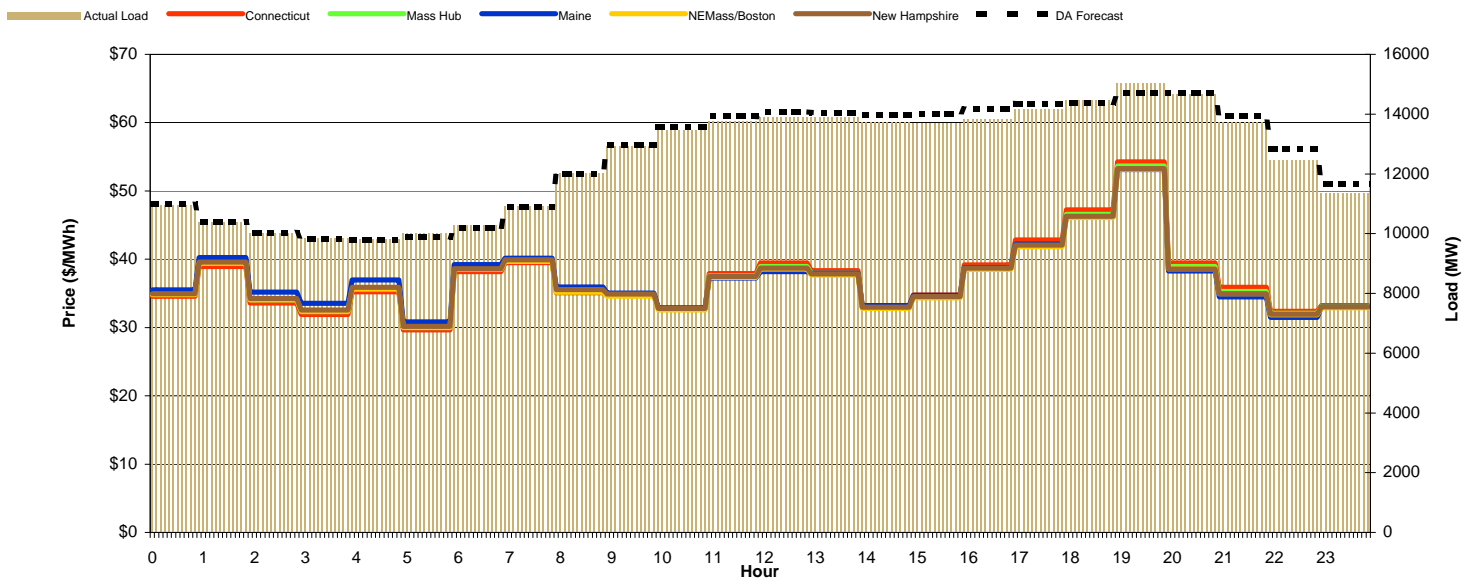




# ISO-NE Daily Report

Monday September 13, 2010

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$				
<b>Connecticut</b>	35.32	34.22	29.25	28.52	33.66	34.34	36.66	40.51	41.77	50.30	52.25	54.33	59.46	60.00	59.81	60.00	59.76	57.98	55.00	60.47	49.83	41.43	37.00	34.81	34.81	46.11	52.49	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	35.44	34.41	29.53	28.79	33.74	34.69	36.34	39.20	40.31	48.53	50.20	52.31	56.88	57.60	57.25	57.34	57.23	55.57	52.76	57.94	48.00	40.00	36.04	34.64	34.64	44.78	50.45		
<b>New Hampshire</b>	35.45	34.52	29.66	28.93	33.92	34.95	36.86	39.60	40.56	48.76	50.55	52.56	57.19	57.74	57.32	57.35	57.43	55.83	53.16	58.43	48.39	40.11	36.23	34.86	34.86	45.02	50.70		
<b>Maine</b>	35.61	34.72	29.99	29.34	34.13	35.49	36.94	38.76	39.96	47.62	49.22	50.98	55.28	56.11	55.46	55.25	55.43	54.00	51.74	56.45	47.45	39.26	35.12	37.00	37.00	44.22	49.26		
<b>Mass Hub</b>	35.47	34.46	29.54	28.81	33.82	34.68	36.59	39.69	40.84	49.15	50.81	52.91	57.59	58.32	57.94	58.04	57.89	56.29	53.40	58.76	48.59	40.46	36.34	34.82	34.82	45.22	51.06		
<b>Cleared Load (GW)</b>	10.3	9.9	9.6	9.5	9.5	10.3	12.7	13.7	14.5	15.2	15.7	15.9	15.8	16.1	16.0	15.9	15.9	15.6	15.5	15.8	15.3	14.4	13.0	11.7					

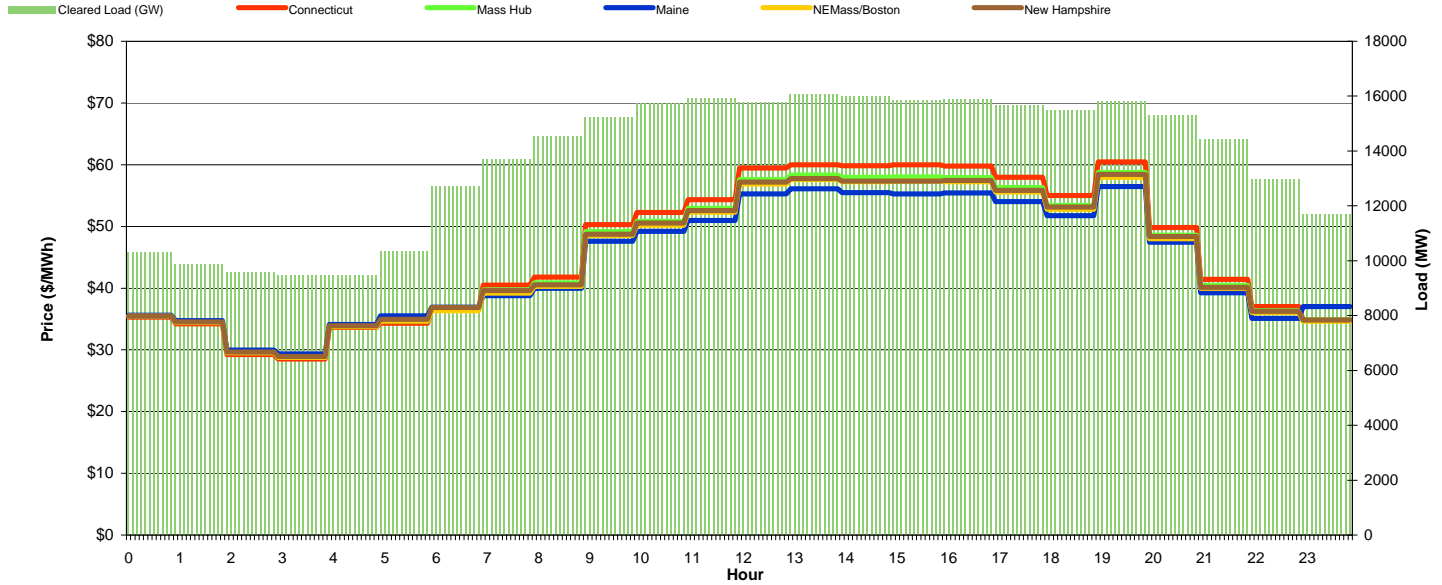

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$				
<b>Connecticut</b>	35.14	34.56	34.08	34.29	36.31	41.21	46.53	46.48	40.63	54.50	56.41	54.28	52.20	41.09	39.75	43.91	60.22	70.13	63.48	66.86	55.03	36.04	32.44	31.22	31.22	46.12	50.84	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	35.03	34.43	34.18	34.43	36.18	40.94	45.61	45.11	39.53	52.76	54.56	52.53	50.19	39.55	38.52	42.32	57.76	67.23	61.28	64.72	53.00	34.91	31.68	30.84	30.84	44.89	49.10		
<b>New Hampshire</b>	35.17	34.58	34.35	34.62	36.30	41.11	45.92	45.37	39.80	53.04	54.96	52.80	50.38	39.67	38.62	42.39	57.99	67.55	61.58	64.99	53.20	34.98	31.74	30.84	30.84	45.08	49.32		
<b>Maine</b>	35.43	34.91	34.94	35.29	36.39	41.24	45.68	44.49	39.48	52.47	54.51	52.23	49.46	39.36	38.35	41.89	56.72	66.39	60.77	64.25	52.32	34.31	30.98	30.25	30.25	44.67	48.62		
<b>Mass Hub</b>	35.19	34.59	34.27	34.50	36.34	41.15	46.02	45.66	39.97	53.39	55.21	53.14	50.85	40.05	38.90	42.81	58.53	68.18	62.03	65.45	53.70	35.32	31.95	31.01	31.01	45.34	49.70		
<b>DA Forecast Load (GW)</b>	10.69	10.20	9.97	9.95	10.23	11.13	12.79	14.23	15.10	15.75	16.23	16.45	16.50	16.63	16.58	16.52	16.53	16.47	16.28	16.44	16.26	15.19	13.71	12.26					
<b>Forecast Error %</b>	-1.3%	-0.6%	-0.3%	-0.6%	-0.5%	0.5%	2.6%	2.0%	0.2%	-1.2%	-1.8%	-2.1%	-2.3%	-2.8%	-3.0%	-3.0%	-3.0%	-2.2%	-0.9%	0.8%	-0.6%	-1.4%	-1.8%	-1.7%					

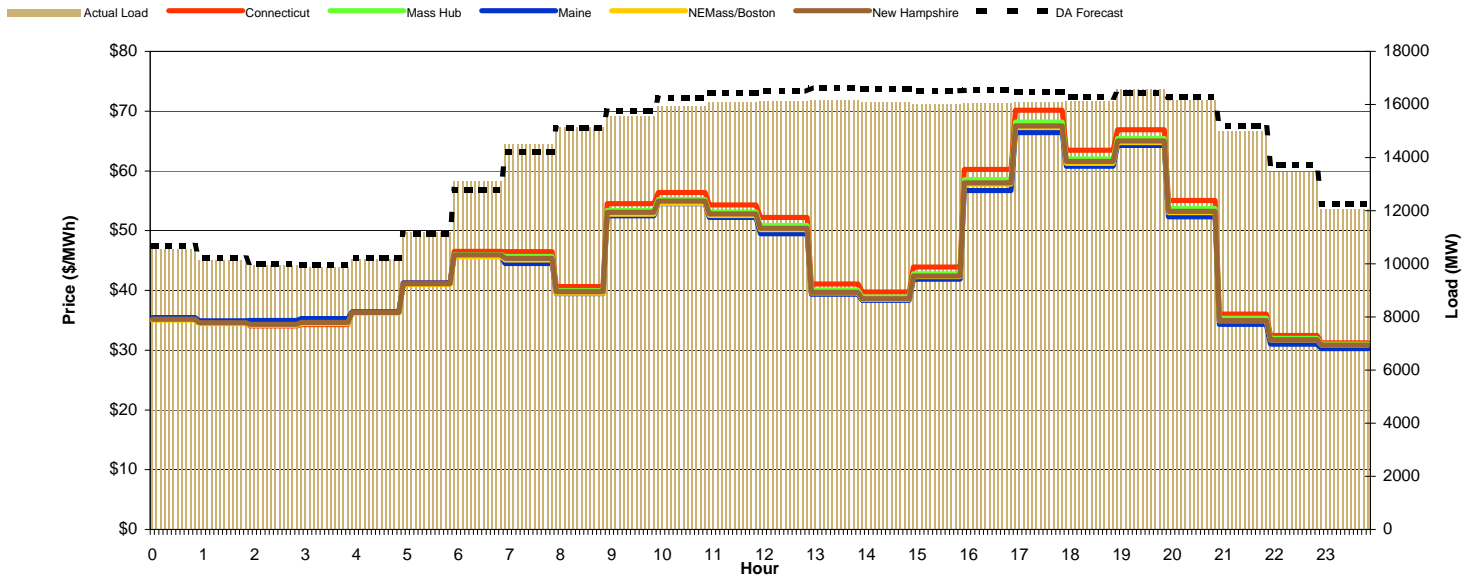




# ISO-NE Daily Report

Tuesday September 14, 2010

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$		
																										All	On Pk
Connecticut	32.15	30.41	26.25	19.81	27.15	31.07	35.00	38.09	39.85	40.71	49.48	46.25	47.94	48.35	50.30	47.93	43.03	41.24	40.65	48.09	40.93	39.48	35.68	35.43	38.97	43.63	
NEMass/Boston	32.22	30.49	26.26	19.83	27.16	31.31	34.85	36.89	38.44	39.36	47.71	44.50	46.16	46.55	48.23	45.84	41.53	39.87	39.21	46.13	39.34	38.18	35.00	35.24	37.93	42.06	
New Hampshire	32.44	30.66	26.42	19.95	27.31	31.61	35.28	37.33	38.79	39.62	47.89	44.68	46.38	46.62	48.29	45.92	41.74	40.08	39.50	46.43	39.71	38.57	35.29	35.63	38.17	42.30	
Maine	32.30	30.36	26.22	19.78	27.13	35.00	39.40	37.05	38.42	39.36	47.00	43.92	45.59	45.93	47.38	45.19	41.39	39.64	39.00	45.48	39.20	38.04	34.55	36.93	38.09	41.70	
Mass Hub	32.35	30.59	26.39	19.91	27.27	31.42	35.02	37.37	38.97	39.88	48.39	45.06	46.73	47.09	48.88	46.43	42.01	40.31	39.65	46.84	39.83	38.60	35.31	35.43	38.32	42.58	
Cleared Load (GW)	10.7	10.2	9.9	9.9	9.9	10.7	12.7	13.8	14.7	15.6	16.0	16.1	16.2	16.4	16.2	16.2	16.1	16.0	15.7	16.2	15.8	14.1	12.1	11.1			

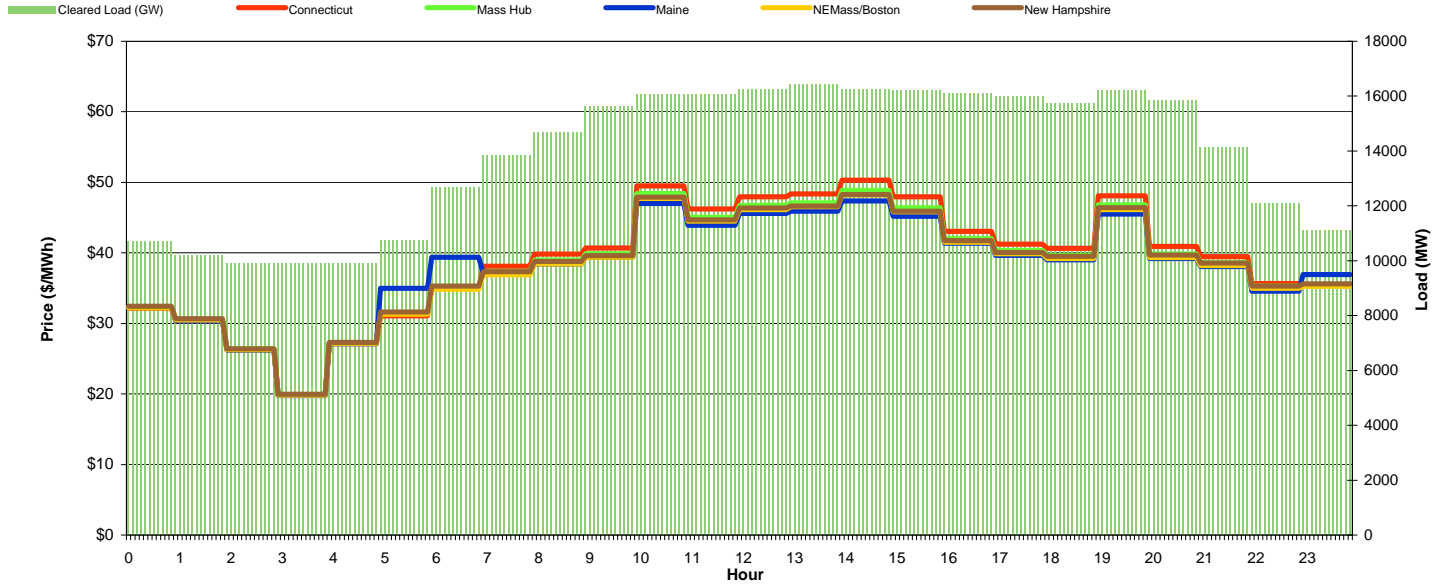

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$		
																										All	On Pk
Connecticut	32.04	32.25	30.63	30.59	31.25	30.78	33.81	42.62	40.48	44.22	56.29	60.36	59.81	62.91	63.32	57.14	44.09	41.57	40.97	48.87	40.18	39.77	36.97	35.51	43.18	48.72	
NEMass/Boston	31.93	32.24	30.61	30.59	31.25	30.75	33.34	41.42	39.19	42.70	54.28	58.25	57.62	61.93	63.35	56.45	42.54	40.30	39.70	47.53	39.06	38.44	35.89	34.92	42.26	47.42	
New Hampshire	32.04	32.45	30.80	30.79	31.49	30.96	33.82	41.97	39.63	43.08	54.64	58.59	57.90	56.82	56.39	52.40	42.59	40.45	39.97	47.83	39.31	38.67	36.12	35.11	41.83	46.65	
Maine	31.84	32.32	30.67	30.72	31.60	31.17	34.23	41.86	39.44	42.81	53.78	57.73	56.78	53.47	52.75	50.42	42.17	40.03	39.49	47.15	38.81	37.97	35.32	34.46	41.12	45.62	
Mass Hub	32.06	32.34	30.73	30.70	31.35	30.83	33.56	41.83	39.58	43.12	54.84	58.84	58.24	61.37	62.21	55.98	42.97	40.64	40.06	47.92	39.39	38.87	36.27	35.20	42.45	47.63	
DA Forecast Load (GW)	11.23	10.67	10.38	10.30	10.54	11.45	13.20	14.54	15.23	15.75	16.11	16.31	16.35	16.47	16.38	16.28	16.24	16.15	15.96	16.29	15.97	14.88	13.37	11.93			
Forecast Error %	-1.0%	-0.6%	-0.5%	-0.6%	-0.6%	-0.7%	0.1%	-0.1%	0.1%	0.3%	0.9%	1.5%	1.8%	1.3%	1.4%	1.2%	1.2%	0.9%	0.6%	1.6%	1.6%	1.0%	0.4%	0.4%			

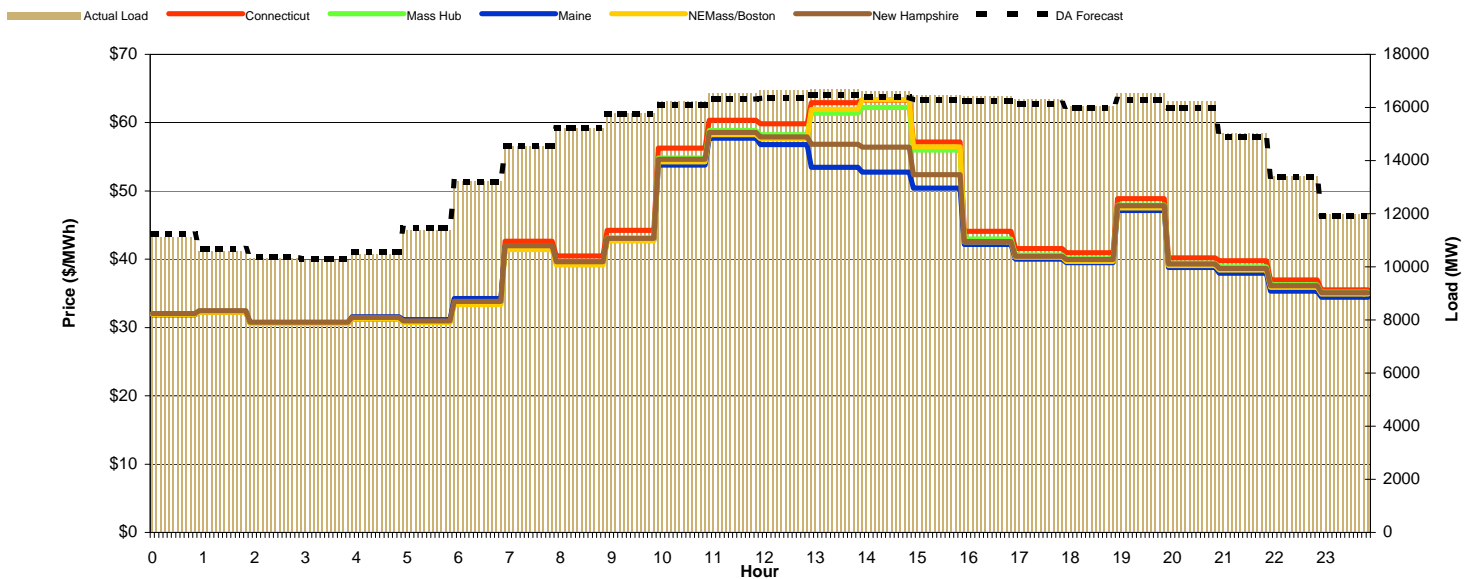




# ISO-NE Daily Report

Wednesday September 15, 2010

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	34.01	30.35	30.27	31.05	29.92	33.45	39.45	40.64	41.77	45.61	51.83	55.00	51.53	54.15	54.69	54.18	57.18	56.32	53.36	60.57	52.07	41.70	37.24	36.07	44.68	50.49	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	34.04	30.53	30.21	30.94	30.02	33.62	38.89	39.44	40.30	44.05	49.93	52.84	49.40	51.86	52.36	51.59	53.55	51.60	47.90	58.02	49.59	40.13	36.98	36.13	43.08	48.10		
<b>New Hampshire</b>	34.23	30.60	30.33	31.04	30.15	33.94	39.34	39.62	40.45	44.14	49.95	52.79	49.39	51.69	52.22	51.41	53.46	51.62	47.93	58.22	49.81	40.14	37.24	36.40	43.17	48.13		
<b>Maine</b>	33.52	30.07	29.57	30.20	29.47	33.47	38.34	38.70	39.67	43.28	48.47	51.08	47.89	50.15	50.75	49.98	51.81	49.91	46.72	56.00	48.24	39.10	36.20	35.98	42.02	46.75		
<b>Mass Hub</b>	34.18	30.64	30.35	31.08	30.13	33.75	39.30	39.94	40.79	44.65	50.57	53.56	49.99	52.53	53.09	52.25	54.35	52.56	48.80	58.98	50.39	40.65	37.15	36.20	43.58	48.77		
<b>Cleared Load (GW)</b>	10.6	10.1	9.5	9.3	9.7	10.6	12.4	13.6	14.4	15.1	15.5	15.5	15.5	15.6	15.6	15.5	15.2	15.2	15.1	15.4	15.0	14.1	11.8	10.8				

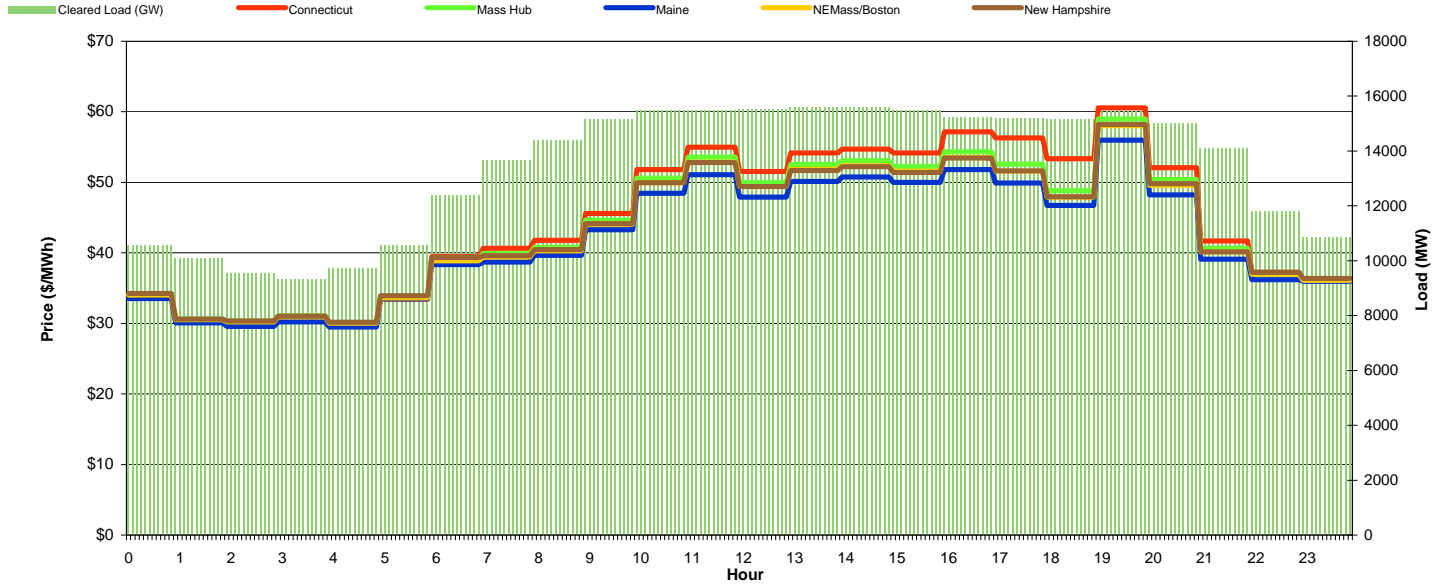

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	35.12	31.66	32.29	33.98	31.15	32.91	35.77	41.19	38.70	39.81	41.67	54.67	48.95	47.05	42.33	44.73	63.28	64.08	41.36	54.53	47.14	38.63	49.27	40.52	42.95	47.34	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	34.98	31.74	32.38	33.93	31.24	32.89	35.26	40.48	37.81	38.90	40.73	53.08	47.68	45.71	41.24	43.54	61.27	61.84	40.31	53.31	45.89	37.61	48.52	40.56	42.12	46.12		
<b>New Hampshire</b>	35.14	31.76	32.47	34.10	31.31	32.98	35.60	41.01	38.21	39.23	40.96	53.13	47.60	45.46	41.04	43.31	61.00	61.68	40.29	53.22	45.82	37.51	48.50	40.46	42.16	46.12		
<b>Maine</b>	34.67	31.36	32.13	33.68	30.99	32.74	35.45	40.72	37.86	38.88	40.36	51.83	46.58	44.33	40.26	42.47	59.12	59.88	39.48	51.68	44.26	36.10	46.49	38.88	41.26	45.02		
<b>Mass Hub</b>	35.14	31.81	32.46	34.07	31.33	33.01	35.56	40.84	38.17	39.23	41.06	53.67	48.18	46.22	41.65	43.99	62.04	62.71	40.76	53.85	46.45	38.06	48.95	40.71	42.50	46.61		
<b>DA Forecast Load (GW)</b>	11.10	10.57	10.29	10.22	10.48	11.39	13.23	14.50	15.07	15.51	15.87	16.03	16.01	16.09	16.03	15.93	15.90	15.86	15.81	16.25	15.91	14.78	13.30	11.86				
<b>Forecast Error %</b>	-1.2%	-1.5%	-1.6%	-1.7%	-2.0%	-2.0%	-2.3%	-2.3%	-2.0%	-1.9%	-1.9%	-1.8%	-1.8%	-2.0%	-2.0%	-1.8%	-1.2%	-1.0%	-1.4%	-0.5%	-0.5%	-0.4%	-1.0%	-1.1%				

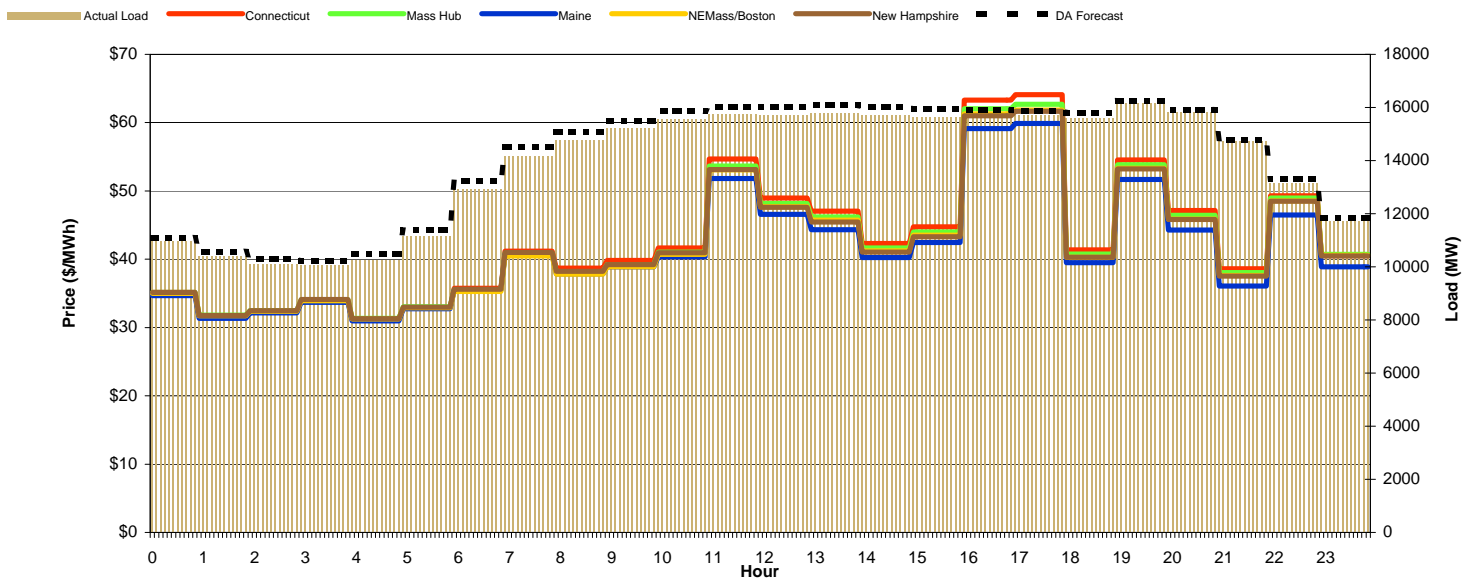




# ISO-NE Daily Report

Thursday September 16, 2010

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
																									All	On Pk		
Connecticut	37.47	33.74	31.98	32.49	33.55	36.43	43.47	44.34	48.08	50.00	53.97	56.53	59.61	58.46	58.57	59.82	59.82	57.96	58.00	62.83	57.18	47.18	40.70	39.45	48.40	54.57	48.40	54.57
NEMass/Boston	37.09	33.75	31.99	32.43	33.54	36.22	42.67	42.64	45.98	48.32	52.00	54.43	57.27	56.28	56.34	57.31	57.29	55.46	55.48	60.38	54.76	44.63	39.26	38.61	46.84	52.36	46.84	52.36
New Hampshire	37.21	33.81	32.08	32.57	33.72	36.42	42.80	42.83	46.18	48.49	52.05	54.32	57.13	56.10	56.15	57.12	57.23	55.47	55.61	60.45	54.92	44.82	39.20	38.72	46.89	52.38	46.89	52.38
Maine	36.24	33.31	31.58	32.00	33.10	35.77	42.14	41.81	44.89	47.26	50.22	52.00	54.28	54.00	54.05	55.18	55.14	53.46	53.49	57.46	52.95	43.23	37.65	38.40	45.40	50.44	45.40	50.44
Mass Hub	37.45	33.94	32.19	32.63	33.77	36.54	43.23	43.36	46.76	48.95	52.68	55.08	57.94	56.86	56.97	57.99	57.98	56.18	56.23	61.24	55.48	45.39	39.82	39.02	47.40	53.06	47.40	53.06
Cleared Load (GW)	10.0	9.5	9.3	9.1	9.3	10.3	12.2	13.4	14.0	14.8	15.1	15.2	15.2	15.2	15.0	15.0	14.8	14.8	15.2	14.6	13.6	12.0	11.1					

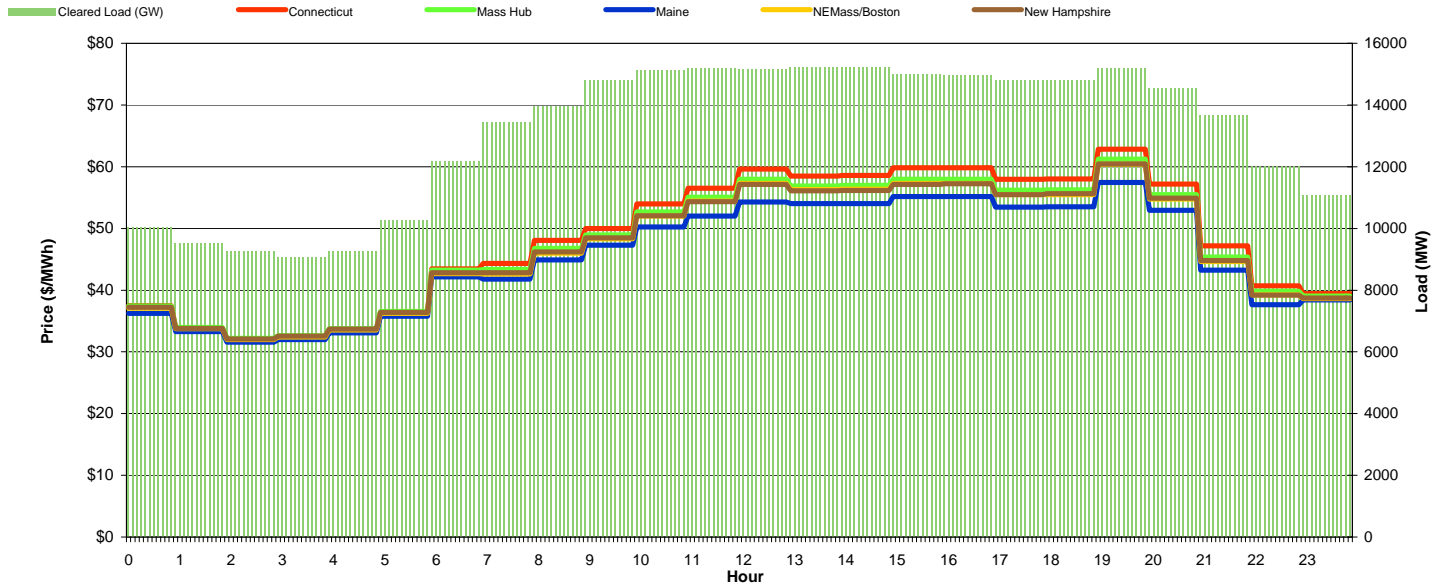

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
																									All	On Pk		
Connecticut	39.14	35.11	34.98	33.05	29.78	30.90	34.94	40.54	41.47	40.88	41.24	41.85	45.58	45.78	46.00	51.17	62.11	68.85	67.70	62.19	53.91	49.93	39.89	37.45	44.77	49.94	44.77	49.94
NEMass/Boston	39.09	35.04	34.89	32.88	29.54	30.52	34.36	39.39	40.13	39.80	40.20	40.84	44.28	44.44	44.64	49.50	59.73	66.49	65.87	60.61	52.36	47.99	38.33	36.72	43.65	48.41	43.65	48.41
New Hampshire	38.96	35.04	34.85	32.85	29.47	30.41	34.39	39.59	40.21	39.77	40.10	40.68	43.99	44.05	44.24	49.03	59.25	66.08	65.56	60.36	52.15	47.78	38.05	36.42	43.47	48.18	43.47	48.18
Maine	37.34	34.08	33.85	31.91	28.83	29.69	33.80	38.65	39.16	38.60	38.75	39.14	42.09	42.45	42.67	47.14	56.53	63.32	63.30	58.26	50.54	46.38	36.52	35.43	42.02	46.47	42.02	46.47
Mass Hub	39.35	35.31	35.16	33.15	29.80	30.83	34.75	39.93	40.70	40.27	40.62	41.26	44.78	44.96	45.16	50.12	60.63	67.47	66.70	61.35	53.07	48.78	39.00	37.11	44.18	49.05	44.18	49.05
DA Forecast Load (GW)	10.98	10.45	10.18	10.12	10.35	11.30	13.06	14.41	15.01	15.46	15.83	16.03	16.08	16.22	16.15	16.06	16.09	16.08	16.01	16.35	16.16	15.17	13.63	12.16				
Forecast Error %	-1.9%	-1.7%	-1.7%	-1.8%	-2.2%	-2.1%	-1.7%	-2.2%	-2.3%	-2.3%	-2.2%	-2.1%	-2.3%	-2.2%	-2.1%	-1.6%	0.0%	2.1%	1.3%	-0.6%	-0.8%	0.0%	1.4%					

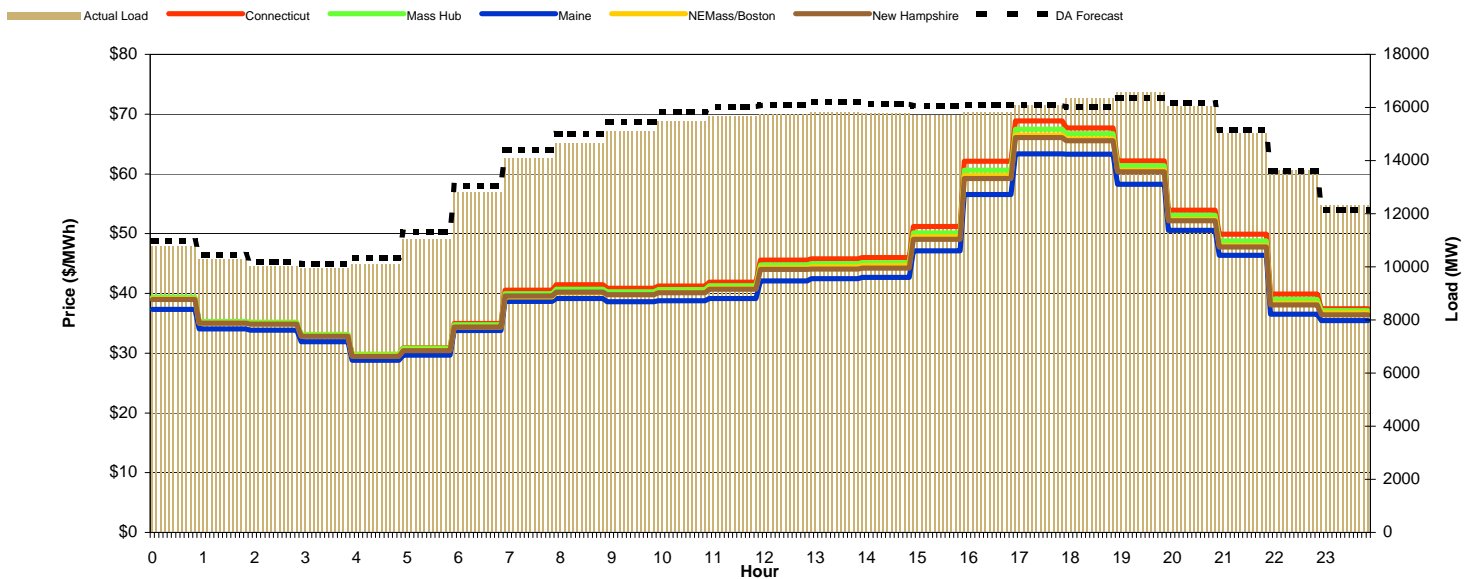






# ISO-NE Daily Report

Friday September 17, 2010

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	38.30	36.41	34.07	33.26	32.12	37.13	41.80	42.39	42.66	48.66	58.29	59.46	56.41	57.37	56.57	55.35	50.82	48.19	41.48	53.77	43.24	42.15	41.43	36.67	45.33	49.89	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	37.90	36.34	33.83	33.01	32.03	37.18	41.15	41.33	41.61	47.13	56.24	57.22	54.20	55.10	54.39	52.94	48.73	46.22	40.27	51.53	41.80	40.72	40.01	36.30	44.05	48.09		
<b>New Hampshire</b>	38.04	36.50	33.95	33.15	32.22	37.45	41.57	41.63	41.73	47.16	56.23	57.05	54.07	54.91	54.13	52.74	48.53	46.22	40.28	51.56	41.87	40.55	40.03	36.51	44.09	48.04		
<b>Maine</b>	36.75	35.59	33.17	32.34	31.59	36.68	41.67	42.38	41.19	45.87	54.29	54.59	51.91	52.87	52.25	50.95	47.26	45.00	39.68	49.93	41.00	39.69	39.58	36.59	43.03	46.78		
<b>Mass Hub</b>	38.30	36.60	34.11	33.28	32.26	37.40	41.70	41.75	42.00	47.65	56.85	57.86	54.77	55.66	54.92	53.41	49.18	46.68	40.55	52.16	42.18	41.14	40.45	36.59	44.48	48.58		
<b>Cleared Load (GW)</b>	10.8	10.2	9.6	9.5	9.8	10.5	12.7	13.8	14.5	14.9	15.0	15.1	15.0	15.1	15.1	15.0	14.9	15.1	15.0	14.9	13.3	11.8	10.7					

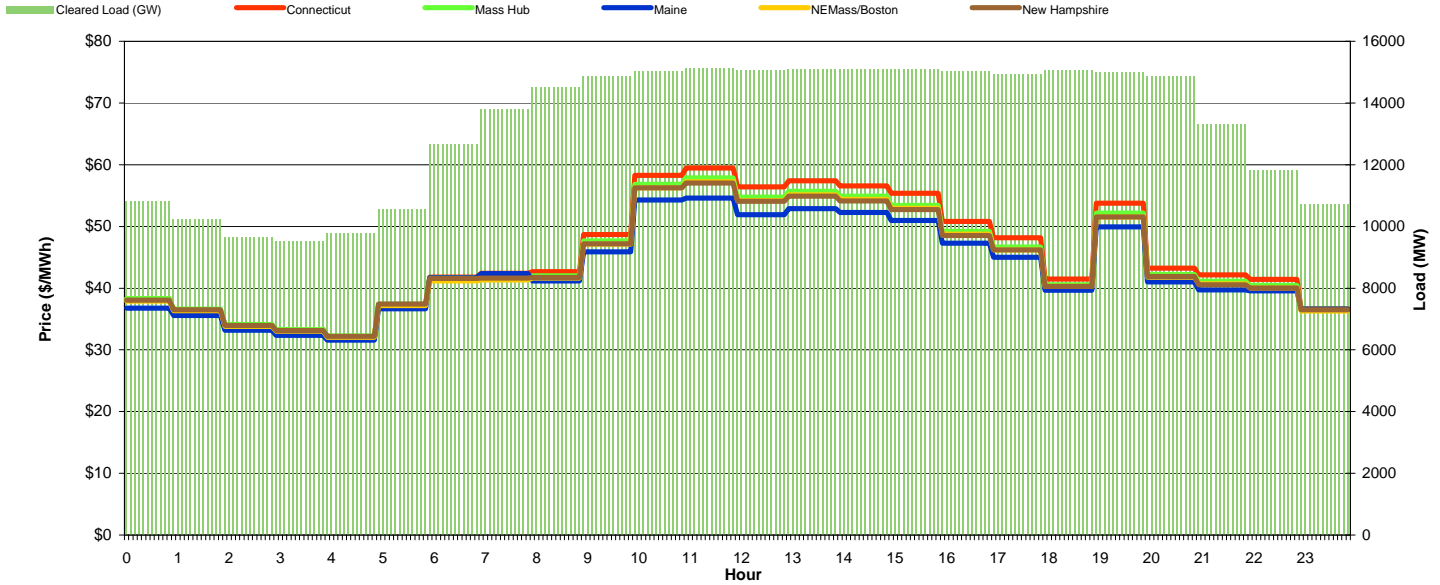

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	38.08	37.89	35.58	40.38	34.54	44.30	44.69	61.31	66.34	67.31	44.02	44.95	46.86	48.70	51.70	42.01	43.53	41.48	39.23	56.00	42.56	47.97	43.61	32.60	45.65	49.22	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	37.88	37.85	35.50	40.20	34.40	44.23	44.08	59.97	64.56	65.66	43.33	44.12	45.70	47.27	49.90	40.70	42.18	40.35	38.59	54.44	41.38	46.43	42.26	32.13	44.71	47.93		
<b>New Hampshire</b>	37.74	37.89	35.57	40.33	34.51	44.34	44.29	60.06	64.35	65.29	43.04	43.81	45.35	46.93	49.55	40.46	41.92	40.12	38.42	54.16	41.19	46.08	41.98	31.98	44.56	47.67		
<b>Maine</b>	36.95	37.47	35.18	40.02	34.21	44.03	44.12	59.57	63.27	63.95	41.99	42.84	44.06	45.57	48.26	39.83	41.23	39.38	37.82	52.94	40.46	44.94	41.18	31.97	43.80	46.71		
<b>Mass Hub</b>	38.11	38.03	35.69	40.44	34.59	44.41	44.45	60.56	65.25	66.28	43.59	44.39	46.05	47.69	50.43	41.06	42.55	40.69	38.82	54.98	41.81	47.07	42.90	32.45	45.10	48.38		
<b>DA Forecast Load (GW)</b>	11.26	10.62	10.33	10.22	10.43	11.39	13.26	14.62	15.41	15.98	16.38	16.57	16.53	16.48	16.27	16.14	16.10	15.84	15.70	16.03	15.54	14.64	13.43	12.15				
<b>Forecast Error %</b>	1.2%	2.5%	2.7%	3.2%	3.3%	2.9%	3.4%	3.7%	2.7%	1.9%	1.1%	0.1%	-0.8%	-1.2%	-1.6%	-2.4%	-2.9%	-2.2%	-2.3%	-1.9%	-1.3%	-1.3%	-1.5%	-1.7%				

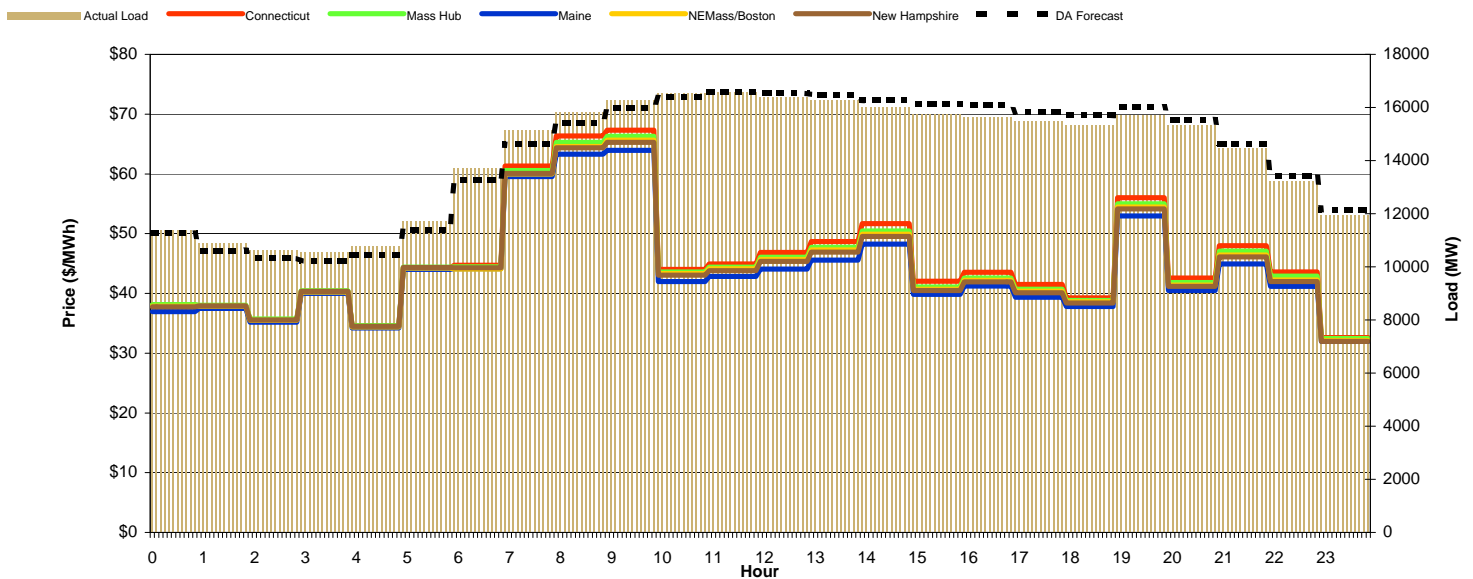




# ISO-NE Daily Report

Saturday September 18, 2010

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	38.50	32.38	31.41	29.24	29.89	31.03	31.41	36.37	43.42	51.39	51.24	53.62	52.74	49.82	48.88	48.91	50.54	61.77	60.01	59.11	59.53	45.49	39.59	37.28	44.73	50.78	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	38.50	32.50	31.44	29.38	29.97	31.18	31.60	36.08	42.11	49.32	49.32	51.45	50.67	47.86	47.00	47.18	48.93	51.05	57.89	57.80	49.12	43.96	38.64	36.97	42.91	48.02		
<b>New Hampshire</b>	38.64	32.47	31.38	29.25	29.87	31.16	31.60	36.16	41.95	49.08	49.08	51.16	50.29	47.43	46.58	46.76	48.67	50.83	57.65	57.51	48.90	43.80	38.46	37.01	42.74	47.77		
<b>Maine</b>	37.93	32.30	31.15	28.99	29.72	31.01	35.90	41.47	41.91	48.08	48.00	50.00	49.30	46.72	45.79	46.10	47.46	49.26	56.00	56.04	47.56	42.66	37.46	36.45	42.39	47.11		
<b>Mass Hub</b>	38.68	32.69	31.66	29.50	30.12	31.32	31.73	36.11	42.35	49.71	49.68	51.81	50.98	48.24	47.35	47.55	49.29	51.43	58.38	58.18	49.42	44.32	38.94	37.24	43.20	48.36		
<b>Cleared Load (GW)</b>	10.2	10.1	9.5	9.3	9.3	9.6	9.9	10.5	11.8	12.7	13.1	13.1	13.1	13.0	13.0	13.0	12.9	13.0	13.6	13.1	12.4	11.2	10.5					

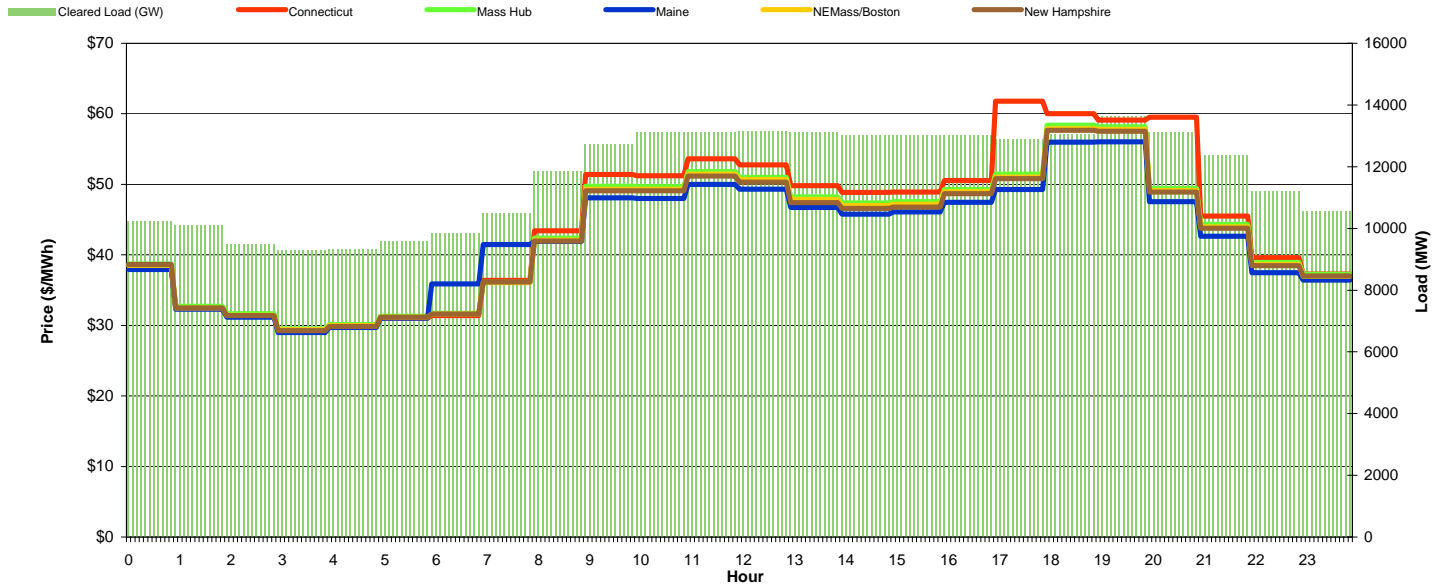

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	31.83	31.41	31.44	29.62	29.89	32.63	33.81	36.52	38.11	45.80	47.44	46.22	39.94	39.37	39.59	38.87	39.58	43.57	40.04	49.20	47.97	40.32	39.00	32.50	38.53	41.97	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	31.75	31.60	31.49	29.82	30.11	32.85	33.95	36.50	37.60	44.74	46.15	44.98	39.10	38.62	38.85	38.13	38.97	42.77	39.38	48.38	47.20	39.55	38.41	32.42	38.06	41.21		
<b>New Hampshire</b>	31.62	31.43	31.37	29.64	29.95	32.77	33.85	36.48	37.54	44.64	45.89	44.63	38.74	38.25	38.58	37.92	38.81	42.61	39.20	48.16	46.87	39.19	38.01	32.19	37.85	40.97		
<b>Maine</b>	31.62	31.54	31.46	29.80	30.14	33.05	34.03	36.64	37.69	44.46	45.22	44.03	38.32	37.95	38.14	37.56	38.35	42.14	38.89	47.65	46.19	38.17	36.99	31.68	37.57	40.52		
<b>Mass Hub</b>	31.95	31.69	31.63	29.88	30.17	32.95	34.08	36.68	37.82	45.08	46.55	45.35	39.35	38.84	39.06	38.34	39.19	43.06	39.63	48.68	47.51	39.86	38.73	32.56	38.28	41.48		
<b>DA Forecast Load (GW)</b>	11.13	10.53	10.18	10.00	10.02	10.28	10.98	11.83	13.01	13.93	14.33	14.55	14.49	14.29	14.16	14.08	14.20	14.47	14.65	14.94	14.44	13.71	12.82	11.71				
<b>Forecast Error %</b>	-1.2%	-1.3%	-1.1%	-0.8%	-0.8%	0.0%	-0.9%	-0.5%	-0.8%	-1.8%	-1.8%	-2.3%	-2.3%	-2.3%	-2.7%	-3.1%	-3.5%	-4.1%	-4.5%	-2.2%	-1.0%	-0.9%	-1.9%	-2.1%				

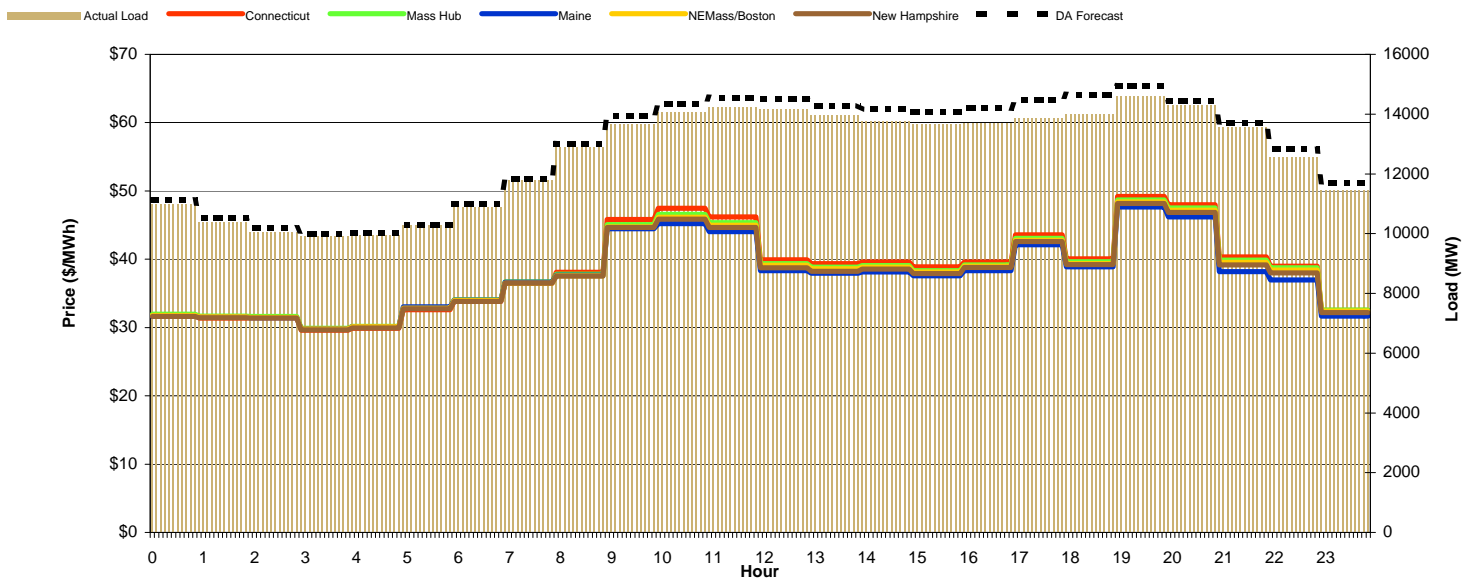




# ISO-NE Daily Report

Sunday September 19, 2010

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$				
<b>Connecticut</b>	33.93	31.78	29.88	30.08	27.87	30.21	31.15	31.53	37.19	39.87	40.56	40.87	43.95	45.65	45.88	46.74	48.56	49.55	51.04	63.81	49.11	42.75	39.84	36.74	36.14	40.36	44.81	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	33.65	31.50	29.65	29.74	27.65	30.00	31.01	31.55	36.91	39.15	39.66	39.98	43.04	44.20	44.42	45.21	47.07	47.96	49.19	61.47	47.27	41.35	38.76	36.14	39.44	43.57			
<b>New Hampshire</b>	33.75	31.49	29.58	29.68	27.63	29.97	31.03	31.54	37.23	39.26	39.59	39.90	42.83	44.09	44.36	45.12	46.98	47.97	49.27	61.58	47.26	41.25	38.68	36.25	39.43	43.56			
<b>Maine</b>	33.66	31.35	29.29	29.48	27.51	29.87	31.26	31.57	37.17	38.92	38.82	39.20	42.01	43.17	43.54	44.33	46.14	46.71	48.09	60.13	46.28	40.49	37.49	35.93	38.85	42.75			
<b>Mass Hub</b>	33.82	31.62	29.77	29.90	27.78	30.11	31.15	31.45	37.04	39.36	39.90	40.24	43.28	44.59	44.85	45.68	47.47	48.37	49.64	62.11	47.58	41.65	38.94	36.36	39.69	43.88			
<b>Cleared Load (GW)</b>	10.1	9.5	9.2	9.0	9.1	9.3	9.4	9.9	11.2	12.3	12.9	13.4	13.6	13.7	13.7	13.8	13.9	13.8	14.3	14.7	13.9	12.9	11.4	10.5					

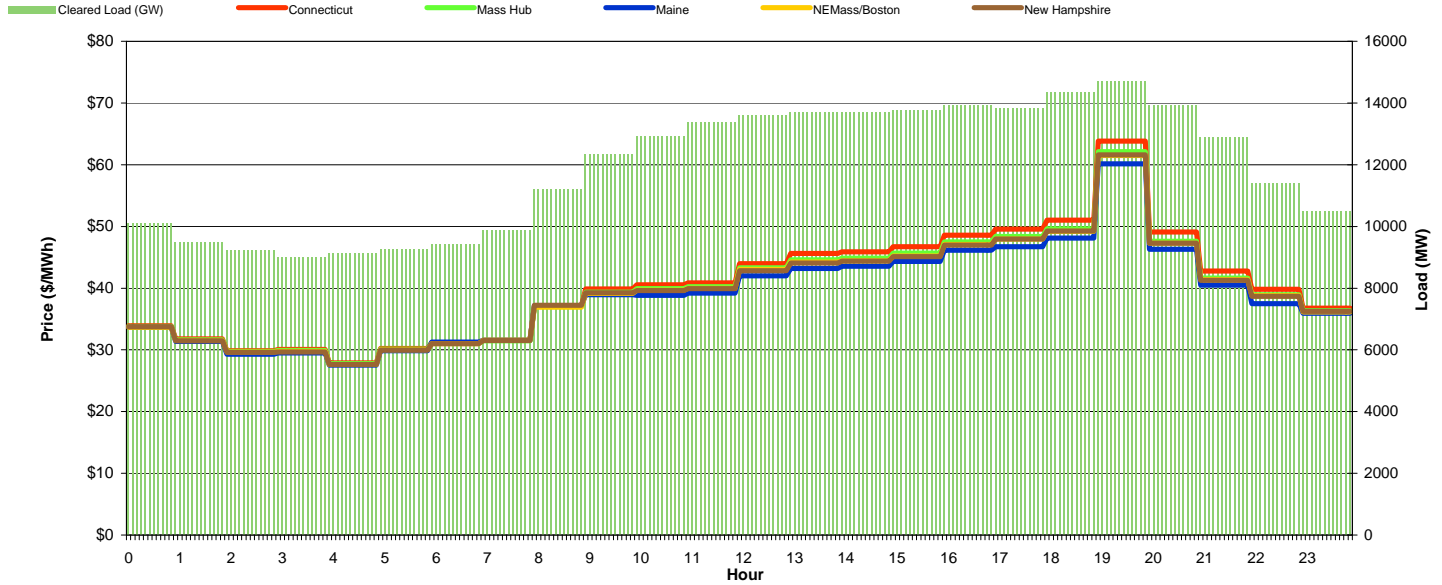

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	32.44	31.03	21.58	28.50	30.34	30.69	31.15	32.75	38.78	45.59	43.29	45.07	40.93	42.37	45.27	44.60	61.60	73.33	70.54	73.14	74.96	43.97	39.42	37.02	44.10	50.98	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	32.39	31.00	21.53	28.34	30.17	30.54	31.07	32.76	38.69	45.03	42.73	44.40	40.36	41.68	44.43	43.84	60.31	71.84	69.65	72.52	73.74	43.15	38.77	36.56	43.56	50.24		
<b>New Hampshire</b>	32.24	30.80	21.41	28.25	30.09	30.52	31.07	32.80	38.93	45.17	42.78	44.35	40.24	41.45	44.16	43.59	60.01	71.55	69.55	72.31	73.40	42.97	38.53	36.34	43.44	50.11		
<b>Maine</b>	31.91	30.44	21.21	28.10	29.99	30.48	31.22	32.96	39.27	45.19	42.62	43.79	39.65	40.87	43.55	43.34	59.54	70.90	69.40	72.22	72.71	42.56	37.87	35.74	43.15	49.78		
<b>Mass Hub</b>	32.52	31.11	21.60	28.47	30.31	30.69	31.21	32.88	38.86	45.35	43.02	44.69	40.60	41.92	44.69	44.06	60.70	72.37	70.01	72.85	74.22	43.44	39.02	36.81	43.81	50.54		
<b>DA Forecast Load (GW)</b>	10.74	10.18	9.85	9.69	9.67	9.85	10.27	10.98	12.07	13.13	13.84	14.24	14.54	14.62	14.61	14.69	14.92	15.24	15.38	15.90	15.46	14.51	13.25	11.91				
<b>Forecast Error %</b>	-1.2%	-1.1%	-1.1%	-1.1%	-1.0%	-0.8%	-1.9%	-2.1%	-1.3%	-1.8%	-2.7%	-2.6%	-2.8%	-2.7%	-2.6%	-3.0%	-2.9%	-2.1%	-0.3%	-0.5%	-0.1%	-0.8%	-1.3%	-0.7%				

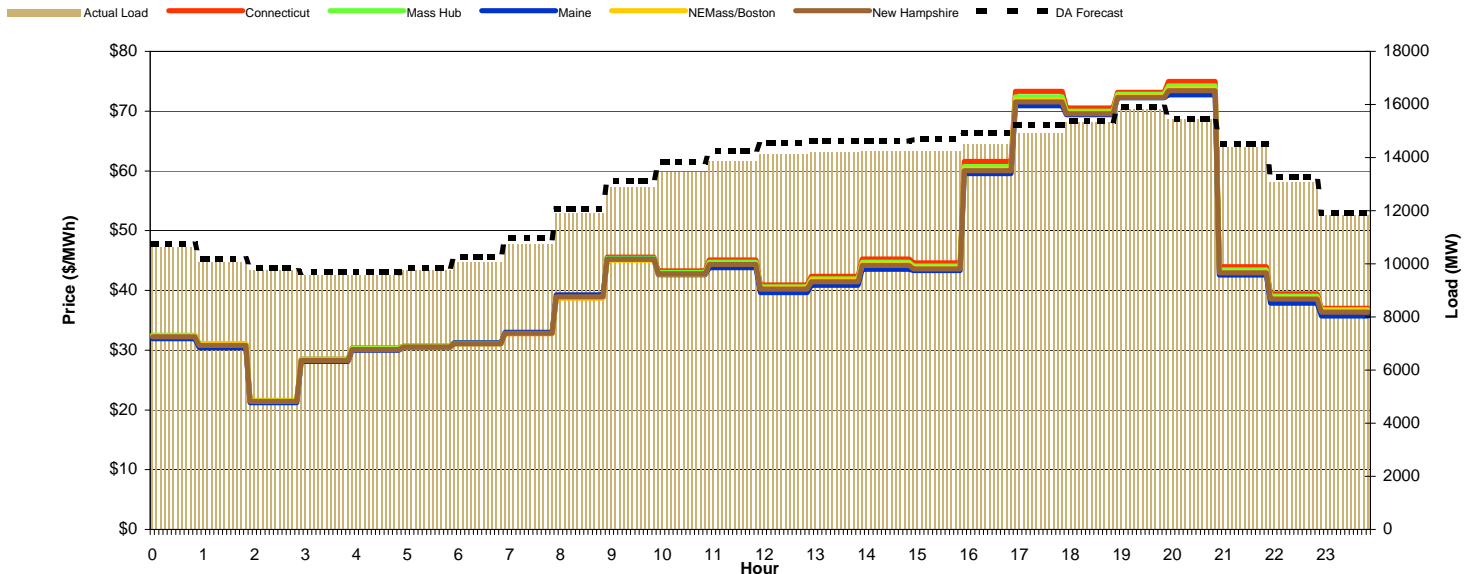




# ISO-NE Daily Report

Monday September 20, 2010

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$				
<b>Connecticut</b>	33.85	31.86	32.01	31.04	30.57	34.36	39.95	40.68	45.14	48.14	51.11	53.06	53.68	49.69	49.35	47.70	49.51	48.92	53.59	55.85	48.22	40.99	37.83	34.83	34.83	43.41	48.34	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	33.71	31.81	31.93	30.91	30.62	34.40	39.38	39.79	43.95	46.79	49.41	51.15	51.74	47.93	47.63	45.93	47.64	47.28	51.67	53.58	46.58	39.73	36.97	34.64	42.30	46.74			
<b>New Hampshire</b>	33.72	31.78	31.89	30.86	30.61	34.56	39.74	40.16	44.29	46.99	49.46	51.20	51.68	47.89	47.53	45.84	47.60	47.39	51.80	53.81	46.78	39.82	37.24	34.91	42.40	46.84			
<b>Maine</b>	33.65	31.66	31.69	30.64	30.48	34.93	41.17	41.21	43.50	45.66	47.74	49.26	49.90	46.57	46.09	44.47	46.11	45.92	50.06	52.00	45.27	38.63	36.36	35.21	41.59	45.55			
<b>Mass Hub</b>	33.91	31.98	32.13	31.07	30.75	34.64	39.78	40.04	44.32	47.15	49.79	51.50	52.01	48.24	47.92	46.15	47.88	47.60	52.14	54.17	46.89	39.99	37.07	34.82	42.58	47.05			
<b>Cleared Load (GW)</b>	10.0	9.6	9.3	9.1	9.4	10.4	12.7	13.8	14.3	14.8	15.1	15.1	15.1	14.9	14.8	14.8	14.8	15.0	15.8	14.8	13.8	11.9	10.9						

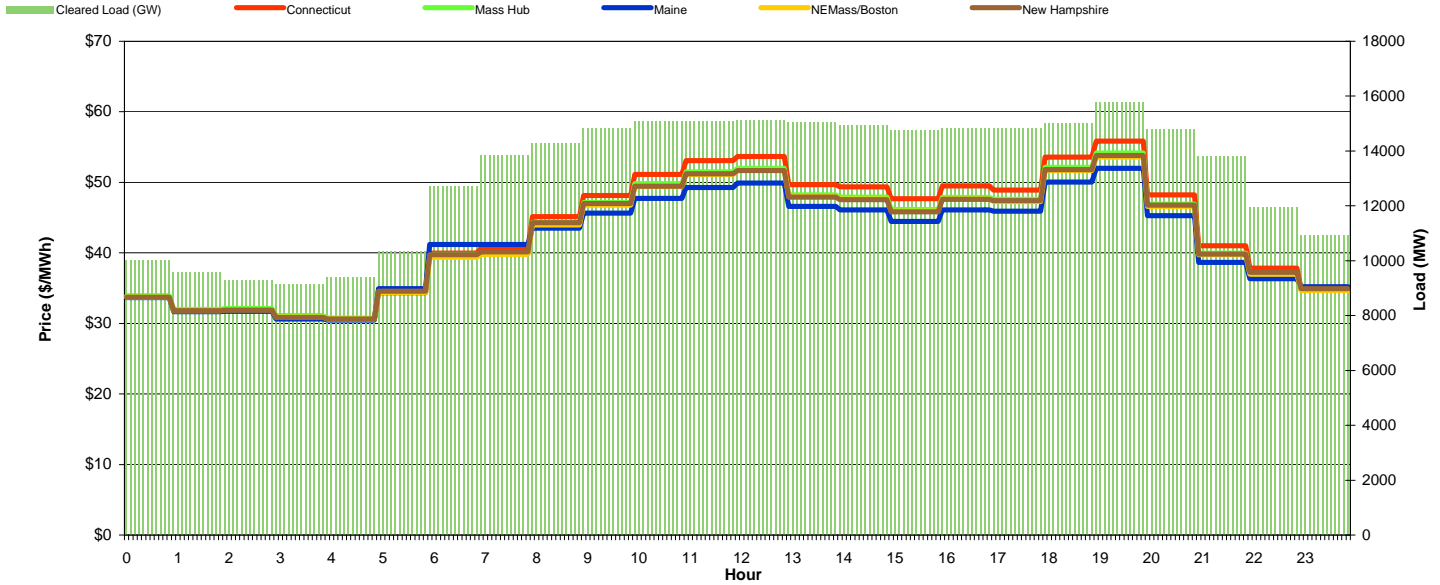

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	33.66	33.06	33.41	32.88	35.07	39.88	40.23	44.64	55.95	56.42	46.42	46.62	48.40	59.54	63.06	55.23	57.86	57.42	42.59	49.18	46.37	39.16	37.62	33.49	45.34	50.41	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	33.48	33.01	33.40	32.82	35.28	39.90	39.70	43.82	54.48	54.99	45.25	45.42	47.09	57.85	61.36	53.85	56.28	55.81	41.62	47.94	45.20	38.18	36.91	33.29	44.46	49.13		
<b>New Hampshire</b>	33.36	32.82	33.21	32.69	35.14	39.98	39.90	44.03	54.53	55.01	45.20	45.33	46.88	57.47	60.87	53.49	55.89	55.55	41.60	47.90	45.10	37.98	36.70	33.17	44.33	48.97		
<b>Maine</b>	33.19	32.61	33.10	32.59	35.11	40.35	39.82	43.71	53.41	53.86	44.50	44.46	45.74	55.80	59.22	52.23	54.43	54.04	40.91	46.88	43.73	36.54	35.09	32.08	43.48	47.78		
<b>Mass Hub</b>	33.66	33.13	33.52	32.94	35.33	40.03	39.95	44.11	54.92	55.41	45.55	45.73	47.43	58.28	61.79	54.20	56.68	56.24	41.89	48.26	45.55	38.52	37.19	33.44	44.74	49.48		
<b>DA Forecast Load (GW)</b>	10.82	10.35	10.04	9.98	10.25	11.20	13.15	14.56	15.19	15.68	16.03	16.23	16.24	16.28	16.19	16.07	16.02	16.02	16.10	16.52	16.01	14.77	13.25	11.76				
<b>Forecast Error %</b>	1.4%	1.0%	1.4%	1.2%	0.5%	0.4%	-0.6%	-2.0%	-1.8%	-1.5%	-1.0%	-1.1%	-1.0%	-1.0%	-0.9%	-0.9%	-0.8%	-0.9%	-1.7%	-0.8%	-1.0%	-1.1%	-1.3%	-0.8%				

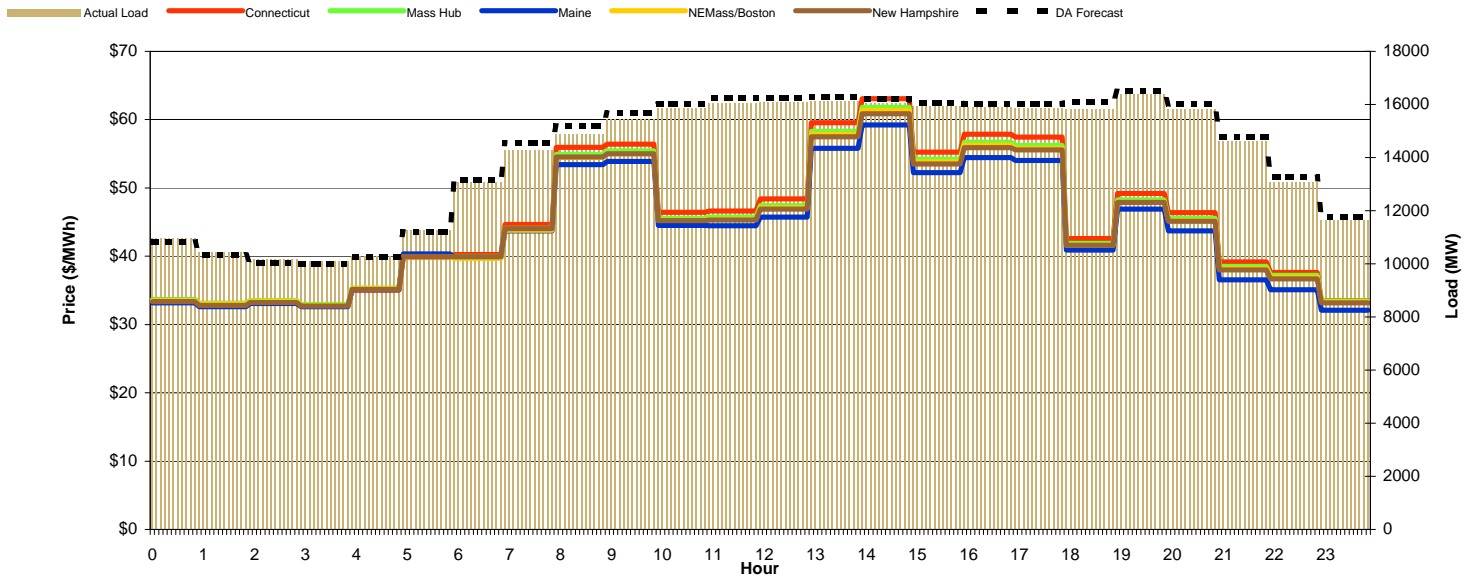




# ISO-NE Daily Report

Tuesday September 21, 2010

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$				
<b>Connecticut</b>	31.57	30.78	29.28	27.90	29.38	33.79	38.95	40.87	41.43	42.62	47.78	48.90	52.21	53.71	52.15	50.34	51.09	48.48	50.11	53.46	46.01	41.21	38.20	38.08	38.08	42.43	47.41	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	31.67	30.90	29.45	28.02	29.52	34.02	38.27	39.75	40.31	41.68	46.39	47.49	50.43	51.70	50.26	48.66	49.39	47.15	48.52	51.71	44.81	39.85	37.30	38.00	41.47	45.96			
<b>New Hampshire</b>	31.79	30.97	29.46	28.05	29.65	34.43	38.68	39.80	40.29	41.62	46.16	47.28	50.08	51.47	50.14	48.66	49.44	47.19	48.52	51.81	45.03	40.06	37.61	38.63	41.53	45.95			
<b>Maine</b>	31.32	30.48	29.00	27.65	29.26	34.88	40.00	39.52	40.08	41.38	45.26	46.24	48.70	50.00	48.85	47.36	48.13	46.00	47.42	50.49	44.19	38.91	36.31	38.03	40.81	44.93			
<b>Mass Hub</b>	31.72	30.92	29.45	28.02	29.57	34.10	38.66	40.14	40.82	42.11	46.93	47.97	51.01	52.16	50.65	49.02	49.76	47.52	48.95	52.14	45.15	40.29	37.65	38.04	41.78	46.39			
<b>Cleared Load (GW)</b>	10.1	9.5	9.2	9.1	9.3	10.3	12.3	13.4	14.2	14.8	15.3	15.5	15.5	15.4	15.3	15.3	15.3	15.2	15.4	15.6	15.1	13.8	11.8	10.7					

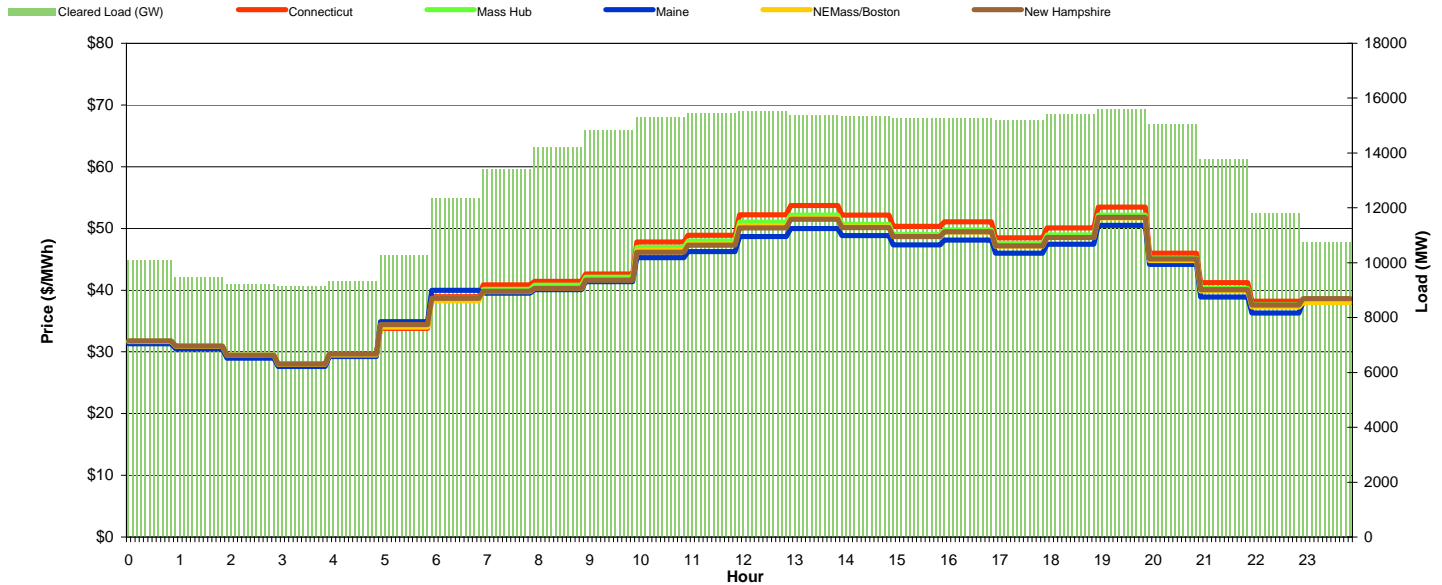

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	32.32	31.25	30.85	29.88	31.76	32.81	38.63	39.84	38.55	36.98	39.99	45.15	44.66	42.43	44.50	50.09	56.19	49.23	45.82	65.00	53.70	40.33	35.94	34.33	41.26	45.53	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	32.52	31.42	30.98	30.06	31.89	32.90	38.21	39.14	37.92	36.60	39.59	44.48	43.80	41.68	43.71	49.30	55.28	48.44	45.21	64.03	53.05	39.42	35.04	34.16	40.78	44.79		
<b>New Hampshire</b>	32.54	31.47	31.05	30.09	31.99	32.98	38.41	39.31	38.07	36.71	39.49	44.28	43.54	41.47	43.57	49.27	55.33	48.52	45.29	64.24	53.26	39.56	35.13	34.22	40.82	44.82		
<b>Maine</b>	31.58	30.58	30.22	29.25	31.28	32.52	37.98	38.51	37.26	35.90	38.48	42.70	42.08	40.17	42.09	47.43	53.49	47.16	44.09	62.52	51.57	38.12	33.46	32.87	39.64	43.44		
<b>Mass Hub</b>	32.58	31.50	31.07	30.13	32.00	33.03	38.49	39.42	38.14	36.74	39.71	44.67	44.03	41.86	43.88	49.47	55.50	48.62	45.36	64.28	53.27	39.70	35.37	34.33	40.96	45.00		
<b>DA Forecast Load (GW)</b>	10.83	10.31	10.04	9.98	10.22	11.23	13.10	14.37	14.85	15.21	15.53	15.74	15.89	15.94	15.88	15.79	15.80	15.67	15.90	16.35	15.87	14.82	13.27	11.84				
<b>Forecast Error %</b>	-1.1%	-1.1%	-1.2%	-1.5%	-1.5%	-2.1%	-1.8%	-2.1%	-1.8%	-1.7%	-2.0%	-1.5%	-1.7%	-1.4%	-1.5%	-1.1%	-0.9%	-0.2%	-1.2%	0.1%	-0.1%	-0.7%	-0.5%	-0.2%				

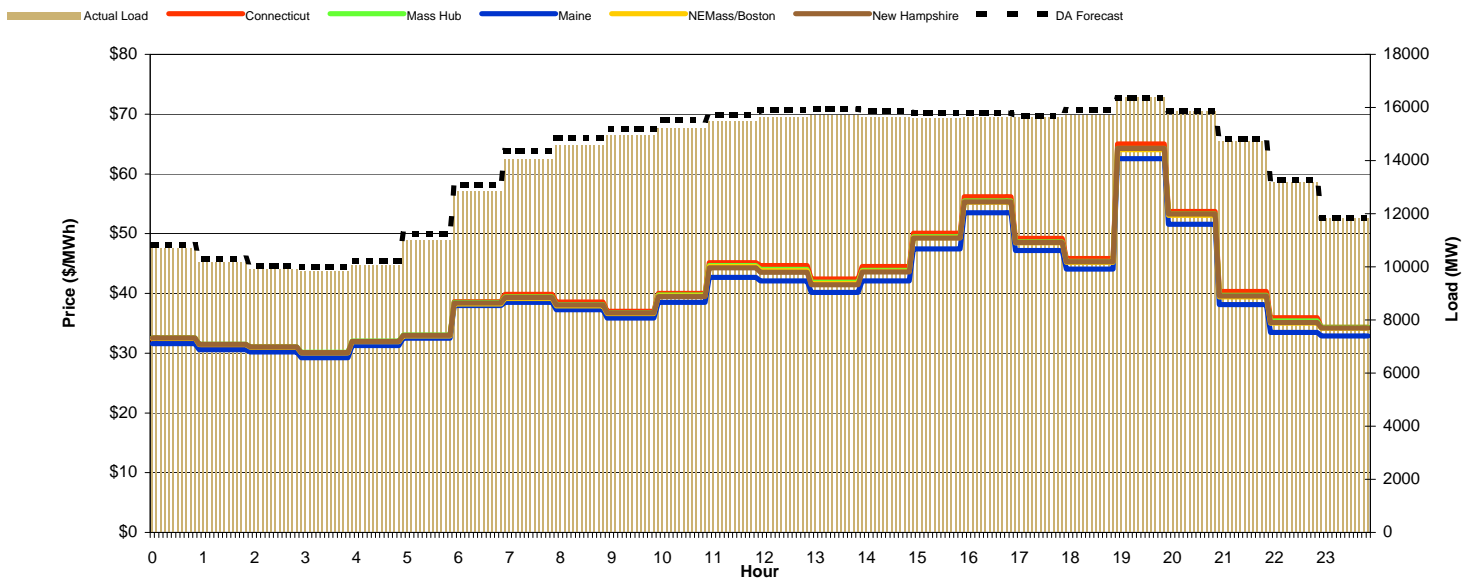




# ISO-NE Daily Report

Wednesday September 22, 2010

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$		
																										All	On Pk
Connecticut	37.17	36.49	34.97	31.42	33.87	38.05	41.04	45.00	53.00	54.11	63.00	68.34	69.69	83.77	81.41	85.00	89.42	84.87	77.19	84.05	66.01	60.98	41.72	42.00	58.44	69.22	
NEMass/Boston	37.05	36.39	35.03	31.67	34.04	37.95	40.18	43.72	44.18	51.71	52.07	55.56	56.48	70.99	72.27	65.67	67.58	59.75	58.03	60.89	54.70	47.67	40.55	40.30	49.77	56.36	
New Hampshire	37.29	36.68	35.29	31.88	34.33	38.39	40.72	44.34	45.96	52.28	53.97	57.88	58.71	73.10	73.70	68.85	71.20	63.98	61.38	64.90	56.70	49.97	40.81	40.78	51.38	58.61	
Maine	36.33	35.81	34.58	31.27	33.69	37.58	43.91	43.74	43.79	50.41	50.50	54.07	54.68	67.94	69.18	63.11	65.00	57.27	56.00	58.00	53.00	46.05	39.40	40.06	48.56	54.51	
Mass Hub	37.27	36.61	35.21	31.80	34.20	38.16	40.61	44.09	47.97	52.65	56.56	60.92	62.05	76.33	75.93	74.05	76.97	70.68	66.40	71.18	59.54	53.42	41.07	41.01	53.53	61.86	
Cleared Load (GW)	10.4	9.9	9.6	9.5	9.7	10.3	12.3	13.9	14.5	15.4	16.1	16.4	16.8	16.8	16.9	16.7	16.8	16.7	16.8	16.9	16.6	14.8	13.4	11.9			

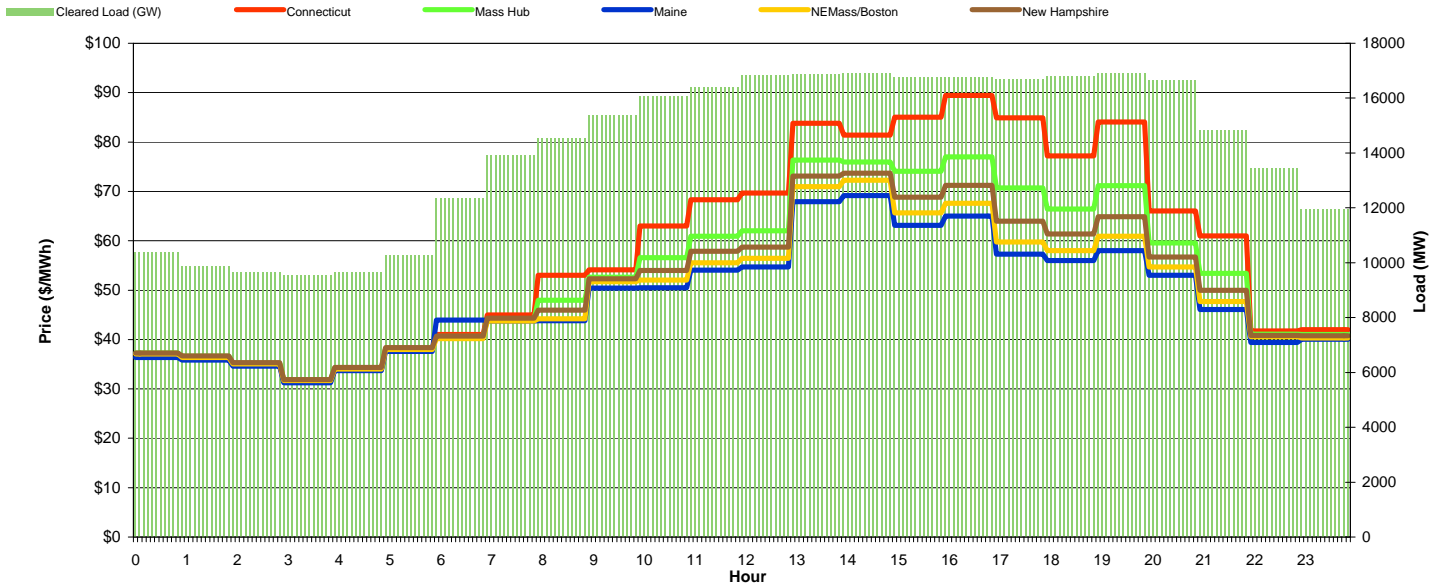

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$		
																										All	On Pk
Connecticut	34.53	32.88	31.55	29.77	30.57	34.30	38.81	43.08	46.01	45.07	43.13	43.26	43.82	71.19	71.79	67.14	74.39	70.28	78.52	71.50	51.52	54.94	48.30	40.49	49.87	57.75	
NEMass/Boston	34.68	33.01	31.78	30.06	30.85	34.46	38.43	42.37	44.88	44.10	42.05	42.25	43.00	69.51	70.10	65.58	72.39	68.02	76.29	69.91	50.29	53.70	46.98	39.25	48.91	56.34	
New Hampshire	34.73	33.08	31.84	30.05	30.85	34.63	38.87	42.77	45.16	44.28	42.20	42.33	42.95	69.32	69.93	65.32	72.11	67.95	76.34	70.01	50.33	53.53	46.95	39.27	48.95	56.34	
Maine	33.54	32.02	30.87	29.11	29.89	33.82	38.31	41.62	43.74	42.86	40.62	40.59	41.07	65.84	66.47	61.88	68.27	64.32	72.78	66.65	48.17	50.75	44.64	37.35	46.88	53.77	
Mass Hub	34.78	33.12	31.86	30.10	30.91	34.55	38.61	42.58	45.20	44.35	42.31	42.47	43.14	69.87	70.49	65.94	72.84	68.58	76.83	70.31	50.61	54.05	47.42	39.72	49.19	56.69	
DA Forecast Load (GW)	10.92	10.41	10.23	10.13	10.40	11.43	13.33	14.72	15.49	16.10	16.73	17.22	17.50	17.76	17.83	17.81	17.86	17.81	17.78	18.23	17.70	16.47	14.80	13.23			
Forecast Error %	0.1%	0.3%	-0.1%	0.1%	-0.2%	-0.6%	-0.3%	-0.8%	-1.1%	-1.1%	-1.3%	-1.8%	-1.7%	-0.7%	0.2%	0.9%	1.2%	1.0%	1.2%	1.8%	1.6%	1.5%	2.1%	2.7%			

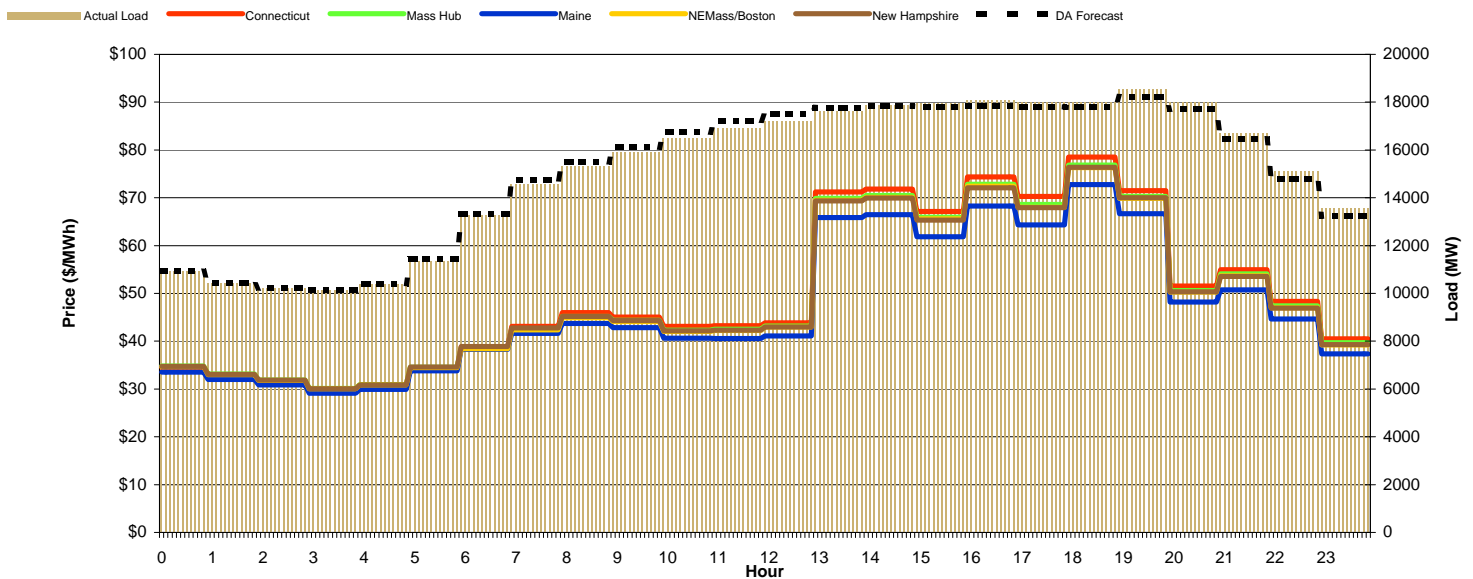




# ISO-NE Daily Report

Thursday September 23, 2010

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$		
<b>Connecticut</b>	37.01	32.35	30.23	30.00	30.92	34.15	40.67	43.42	47.50	58.05	56.18	61.61	65.78	67.56	67.46	67.00	66.40	65.65	61.58	63.00	60.00	50.00	41.24	38.40	38.40	50.67	58.90
<b>NEMass/Boston</b>	36.42	32.35	30.29	30.09	30.97	34.18	39.97	42.43	46.25	51.72	54.01	53.03	54.69	57.41	58.10	56.66	56.45	53.05	52.80	54.85	50.04	41.78	39.68	37.88	37.88	45.63	51.43
<b>New Hampshire</b>	36.71	32.58	30.43	30.22	31.17	34.57	40.54	42.73	46.55	52.00	54.25	53.23	54.78	57.56	58.15	56.67	56.50	53.20	53.05	55.21	50.41	41.98	39.83	38.31	38.31	45.86	51.63
<b>Maine</b>	36.08	32.09	29.92	29.67	30.64	36.00	40.02	41.66	45.09	49.68	52.00	51.05	52.34	55.11	55.57	54.28	53.85	50.87	50.67	52.88	48.26	40.07	38.31	38.06	38.06	44.34	49.48
<b>Mass Hub</b>	36.68	32.41	30.31	30.09	31.02	34.23	40.44	42.88	46.65	52.14	54.48	53.52	55.12	57.90	58.62	57.20	57.07	53.50	53.26	55.38	50.48	42.21	40.14	38.09	38.09	45.99	51.91
<b>Cleared Load (GW)</b>	11.3	10.6	10.1	9.9	10.2	11.0	13.3	14.3	14.7	15.2	16.1	16.5	16.5	16.7	16.5	16.4	16.4	16.2	16.3	16.6	15.6	14.5	12.5	11.4	11.4		

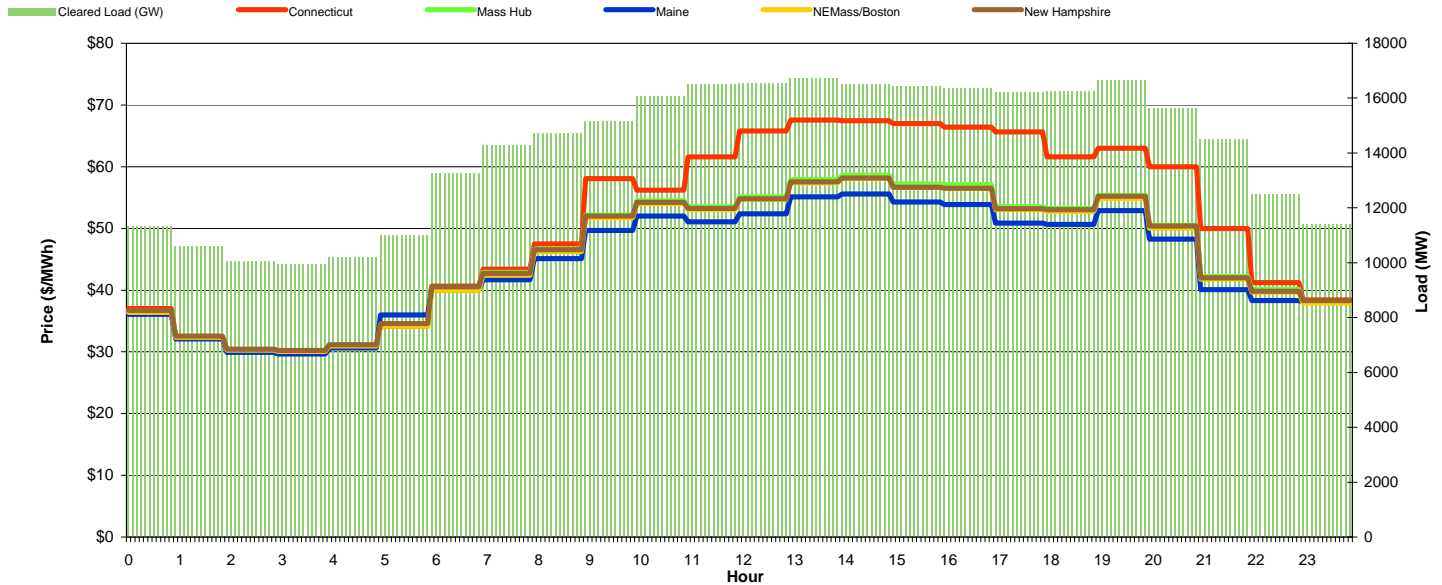

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$		
<b>Connecticut</b>	36.14	34.49	32.05	29.64	30.02	33.02	39.28	38.76	39.00	48.40	45.16	39.92	46.41	53.67	59.45	61.22	50.25	46.79	47.36	56.00	51.37	39.54	39.54	34.58	34.58	43.00	47.68
<b>NEMass/Boston</b>	35.58	34.43	32.05	29.75	30.25	33.22	39.01	38.21	38.53	47.44	44.02	39.20	45.41	52.33	56.20	47.82	43.50	41.85	46.27	54.68	50.07	38.53	36.34	34.18	34.18	41.20	45.03
<b>New Hampshire</b>	35.65	34.54	32.13	29.74	30.34	33.43	39.42	38.56	38.80	47.67	44.26	39.36	45.52	52.43	56.55	49.95	44.59	42.70	46.55	55.10	50.34	38.68	36.77	34.27	34.27	41.56	45.49
<b>Maine</b>	34.45	33.56	31.18	28.79	29.79	33.15	39.00	37.77	37.96	46.23	42.88	38.18	43.97	50.40	53.94	46.02	42.30	40.74	45.17	53.46	48.49	37.44	34.97	33.23	33.23	40.13	43.75
<b>Mass Hub</b>	35.86	34.54	32.13	29.77	30.24	33.22	39.18	38.41	38.67	47.68	44.27	39.33	45.58	52.60	57.26	53.31	46.17	43.75	46.56	55.04	50.47	38.88	37.72	34.44	34.44	41.88	45.98
<b>DA Forecast Load (GW)</b>	12.22	11.61	11.27	11.12	11.33	12.31	14.23	15.54	16.30	16.82	17.31	17.53	17.60	17.60	17.45	17.35	17.30	17.19	17.08	17.41	16.90	15.66	14.09	12.66	12.66		
<b>Forecast Error %</b>	2.3%	1.8%	1.3%	0.5%	-0.4%	-1.2%	-2.1%	-3.2%	-4.2%	-3.8%	-3.7%	-3.1%	-2.5%	-1.2%	-0.3%	-0.5%	-1.0%	-1.9%	-2.0%	-0.7%	-1.1%	-0.9%	-0.9%	-1.1%	-1.1%		

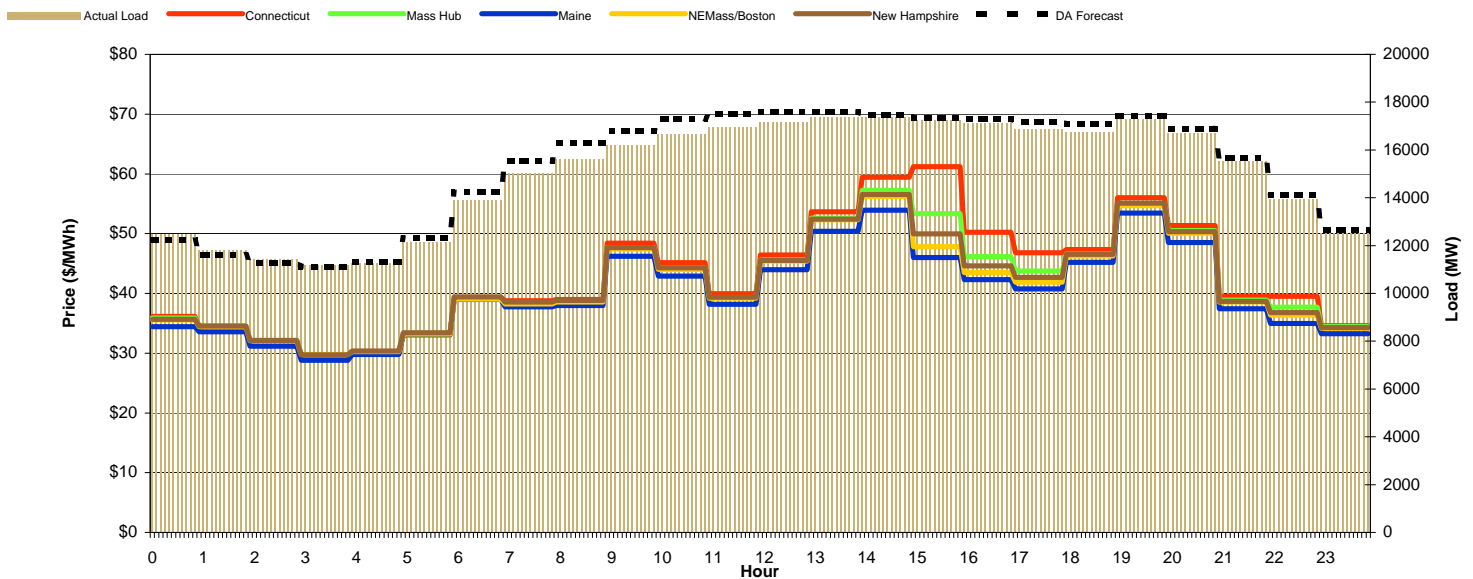




# ISO-NE Daily Report

Friday September 24, 2010

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	32.71	29.24	29.76	28.51	29.93	32.54	40.57	42.17	46.14	54.14	59.02	62.31	69.06	78.99	80.60	83.00	83.00	72.77	64.32	67.00	59.09	53.77	42.14	41.35	53.42	63.60	All	On Pk
<b>NEMass/Boston</b>	32.52	29.22	29.89	28.60	30.10	32.55	39.88	41.66	45.42	52.70	55.70	60.73	67.46	77.58	79.04	80.87	81.10	71.10	62.94	65.37	57.13	51.88	40.55	40.18	52.26	61.95		
<b>New Hampshire</b>	32.89	29.48	30.28	28.94	30.48	32.99	40.46	42.10	45.88	53.05	56.12	60.54	63.36	75.92	76.52	75.08	81.00	71.15	63.25	65.80	57.37	51.94	40.62	40.30	51.90	61.23		
<b>Maine</b>	32.34	28.96	29.63	28.22	29.71	35.39	39.73	41.31	44.84	50.66	52.87	56.92	57.12	70.00	70.00	66.78	76.99	67.39	60.35	62.84	55.20	49.56	39.00	39.48	49.39	57.61		
<b>Mass Hub</b>	32.74	29.39	30.00	28.69	30.22	32.74	40.38	42.00	45.74	53.35	57.26	63.31	68.70	78.76	80.22	82.21	82.15	72.11	68.18	67.23	57.97	52.61	41.16	40.65	53.24	63.31		
<b>Cleared Load (GW)</b>	10.6	10.2	9.8	9.8	9.9	10.7	12.4	13.8	14.6	15.1	16.1	16.9	17.2	17.2	17.1	16.9	16.7	16.6	17.4	17.3	16.2	14.6	13.6	12.0				

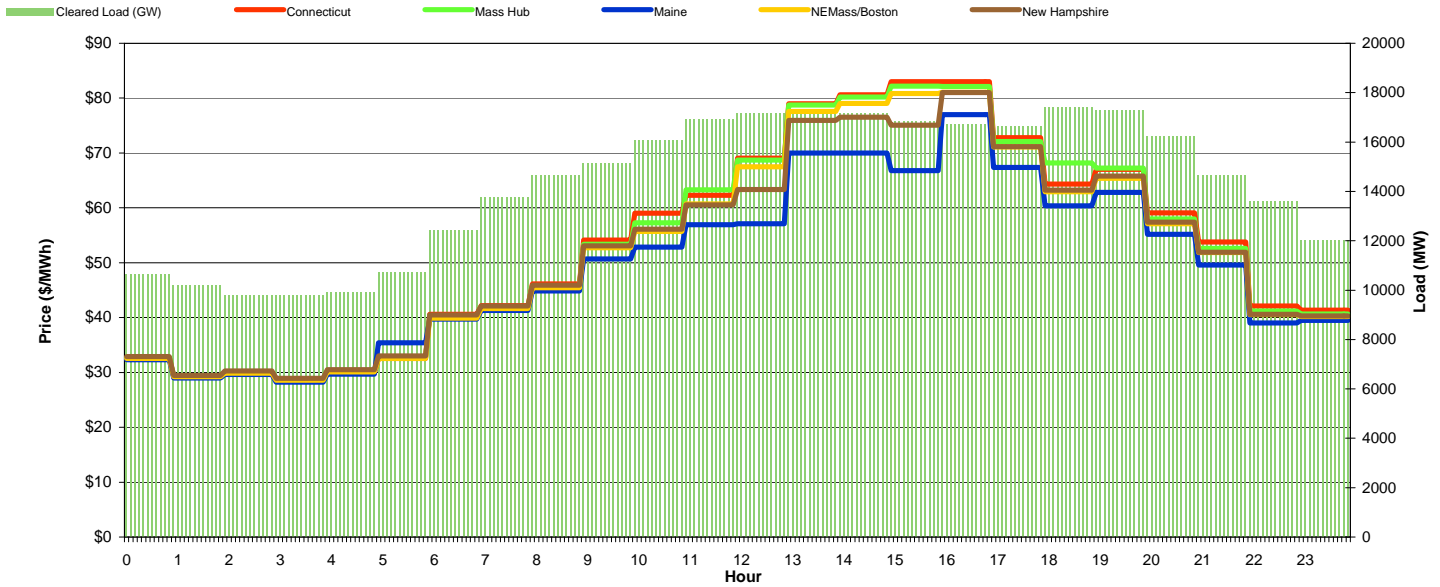

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	33.72	32.32	30.49	7.59	31.87	38.48	70.10	52.69	44.44	40.07	53.41	51.31	53.74	60.02	66.65	69.74	52.02	56.23	55.75	62.46	61.14	65.91	53.86	45.74	49.57	56.22	All	On Pk
<b>NEMass/Boston</b>	33.63	32.30	30.52	7.60	31.91	38.35	69.36	52.16	43.76	39.33	52.05	50.38	52.86	59.24	65.58	68.76	50.93	54.21	54.37	60.67	59.92	65.01	52.66	44.86	48.77	55.12		
<b>New Hampshire</b>	33.82	32.54	30.71	7.64	32.18	38.78	70.25	52.74	44.23	39.73	52.42	50.52	52.85	59.23	65.57	68.77	51.05	54.39	54.51	60.97	60.11	65.01	52.51	44.55	48.96	55.29		
<b>Maine</b>	33.24	32.00	30.30	7.52	31.84	38.77	69.61	52.01	43.78	39.34	50.95	48.71	50.78	56.87	62.63	65.78	49.09	51.64	51.77	57.74	57.44	62.21	49.92	42.15	47.34	53.17		
<b>Mass Hub</b>	33.82	32.47	30.63	7.62	32.03	38.54	69.89	52.46	43.99	39.59	52.48	50.70	53.15	59.50	65.92	69.14	51.27	54.74	54.80	61.17	60.18	65.24	53.04	45.21	49.07	55.46		
<b>DA Forecast Load (GW)</b>	11.36	10.81	10.55	10.41	10.66	11.65	13.43	14.80	15.67	16.48	17.16	17.65	18.02	18.40	18.49	18.50	18.51	18.29	17.97	18.19	17.65	16.61	15.24	13.79				
<b>Forecast Error %</b>	1.3%	1.2%	0.7%	1.0%	0.7%	0.6%	1.8%	1.6%	0.6%	-0.9%	-1.7%	-1.9%	-2.1%	-1.7%	-0.6%	-0.3%	-0.6%	-0.9%	-0.4%	0.0%	0.0%	0.1%	0.5%	1.0%				

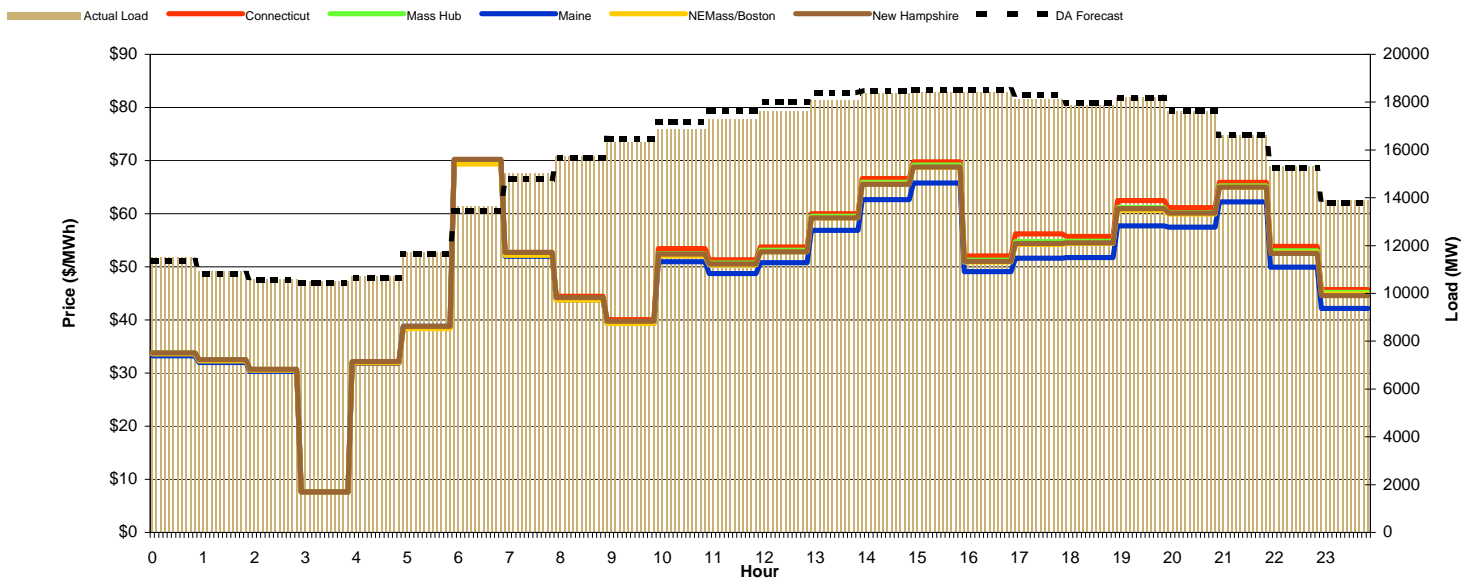






# ISO-NE Daily Report

Saturday September 25, 2010

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$		
<b>Connecticut</b>	42.83	37.03	35.97	34.03	34.06	36.12	35.90	37.63	43.57	52.74	54.48	54.70	54.68	54.47	54.30	54.42	54.63	54.50	55.82	54.75	54.22	46.47	40.31	39.03	39.03	46.53	51.36
<b>NEMass/Boston</b>	41.86	36.83	36.02	34.08	34.06	36.01	35.73	37.36	42.66	51.71	53.05	53.13	53.15	53.09	52.91	53.09	53.14	52.92	54.15	53.13	52.81	45.31	39.07	38.42	45.57	50.04	
<b>New Hampshire</b>	41.77	37.00	36.27	34.29	34.29	36.30	35.91	37.47	42.69	51.72	53.05	53.18	53.06	52.97	52.74	52.90	53.06	53.00	54.27	53.24	52.68	45.21	39.03	38.65	45.61	50.02	
<b>Maine</b>	39.67	35.83	35.07	33.15	33.09	35.13	35.21	36.68	41.40	49.35	50.27	50.53	50.45	50.67	50.66	50.94	50.88	50.76	52.13	51.19	50.40	43.50	37.77	38.82	43.90	47.97	
<b>Mass Hub</b>	42.29	37.02	36.15	34.24	34.22	36.22	35.94	37.52	42.99	52.05	53.47	53.62	53.54	53.44	53.24	53.40	53.49	53.31	54.74	53.53	53.14	45.65	39.33	38.62	45.88	50.40	
<b>Cleared Load (GW)</b>	11.6	11.1	10.7	10.3	10.1	10.4	11.0	11.7	13.1	13.8	14.4	15.0	15.0	14.9	14.8	14.9	15.0	14.7	14.9	14.9	14.1	13.2	12.1	11.3			

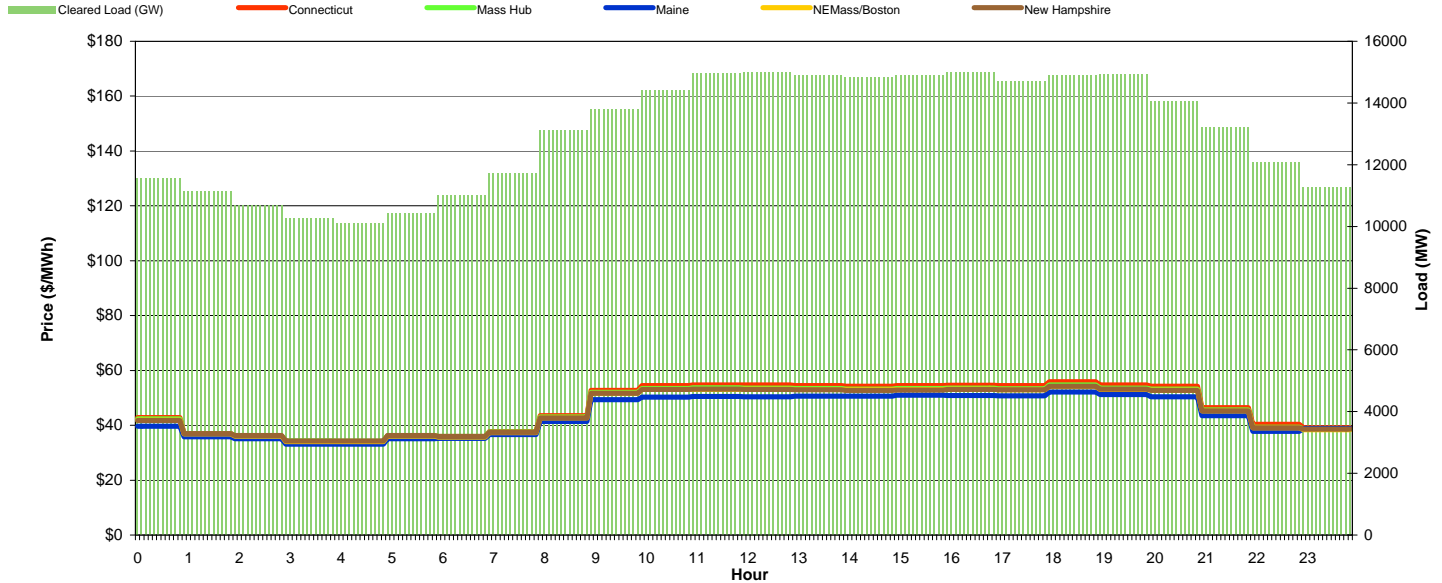

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$	
<b>Connecticut</b>	46.73	37.87	34.39	34.21	35.75	36.76	37.20	40.71	61.18	65.47	75.48	170.04	134.33	72.25	73.53	104.20	92.97	93.91	54.55	72.00	60.37	48.85	41.17	36.38	65.01	78.81
<b>NEMass/Boston</b>	45.67	37.37	34.18	34.03	35.59	36.59	36.99	40.41	59.99	64.70	74.02	166.35	131.87	71.63	72.57	102.47	90.70	91.42	52.87	70.11	58.89	47.39	39.88	35.59	63.80	77.20
<b>New Hampshire</b>	45.29	37.21	34.12	33.97	35.56	36.62	37.09	40.55	60.01	64.76	73.98	166.03	131.11	71.01	71.80	101.51	89.93	90.84	52.66	69.91	58.76	47.15	39.62	35.41	63.54	76.85
<b>Maine</b>	42.94	35.84	33.15	33.01	34.61	35.79	36.47	39.85	58.20	62.98	71.09	159.85	126.35	68.46	68.98	98.11	86.63	87.32	50.60	67.16	56.43	45.03	37.76	33.85	61.27	74.05
<b>Mass Hub</b>	46.09	37.62	34.34	34.19	35.76	36.73	37.11	40.53	60.33	64.89	74.34	167.21	132.45	71.68	72.66	102.71	91.14	91.95	53.21	70.51	59.25	47.75	40.25	35.87	64.11	77.55
<b>DA Forecast Load (GW)</b>	13.21	12.46	11.99	11.70	11.67	11.98	12.77	13.62	14.76	15.95	16.71	17.16	17.37	17.40	17.38	17.28	17.16	16.90	16.83	17.10	16.48	15.47	14.19	12.93		
<b>Forecast Error %</b>	-2.8%	-2.6%	-2.1%	-1.6%	-1.2%	-0.9%	-1.7%	-0.9%	0.6%	-0.3%	-0.5%	0.1%	0.6%	1.1%	1.1%	1.3%	1.4%	1.9%	0.7%	0.2%	0.0%	0.2%	0.3%	-0.3%		

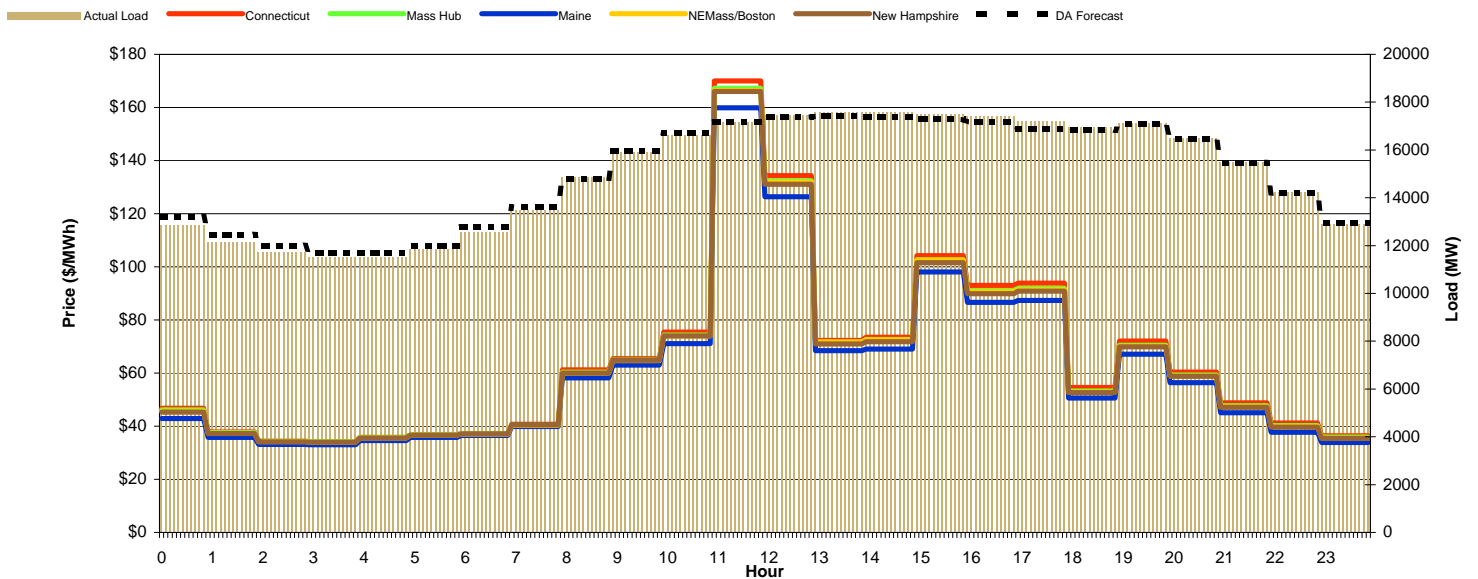




# ISO-NE Daily Report

Sunday September 26, 2010

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	36.98	35.92	32.15	30.38	30.37	30.31	33.66	34.70	37.45	38.53	38.94	41.60	40.40	39.10	38.90	38.65	38.10	40.44	54.17	54.91	49.40	39.11	37.00	36.23	36.64	41.34	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	36.70	35.84	32.25	30.40	30.45	30.51	33.77	34.60	37.06	37.84	38.03	40.40	39.38	38.28	38.03	37.86	37.35	39.33	52.58	52.86	47.64	37.87	36.40	35.94	37.97	40.34		
<b>New Hampshire</b>	37.12	36.36	32.62	30.71	30.78	30.85	34.29	35.24	37.71	38.38	38.39	40.73	39.66	38.55	38.27	38.16	37.85	39.81	53.00	53.29	47.98	38.24	36.82	36.66	38.39	40.76		
<b>Maine</b>	36.67	36.06	32.29	30.37	30.35	30.57	35.00	36.75	37.71	38.20	37.80	40.25	39.15	38.06	37.63	37.61	37.59	39.36	51.86	51.91	46.86	37.52	36.28	38.53	38.10	40.28		
<b>Mass Hub</b>	36.86	35.95	32.29	30.47	30.53	30.56	33.85	34.73	37.33	38.27	38.45	40.89	39.77	38.65	38.35	38.15	37.69	39.79	53.50	53.58	48.30	38.34	36.50	36.14	38.29	40.77		
<b>Cleared Load (GW)</b>	10.0	9.5	9.0	8.7	8.8	9.1	9.2	9.7	11.2	12.4	12.7	12.9	13.0	12.9	12.8	12.8	13.0	13.3	13.9	14.2	13.4	12.4	10.7	10.1				

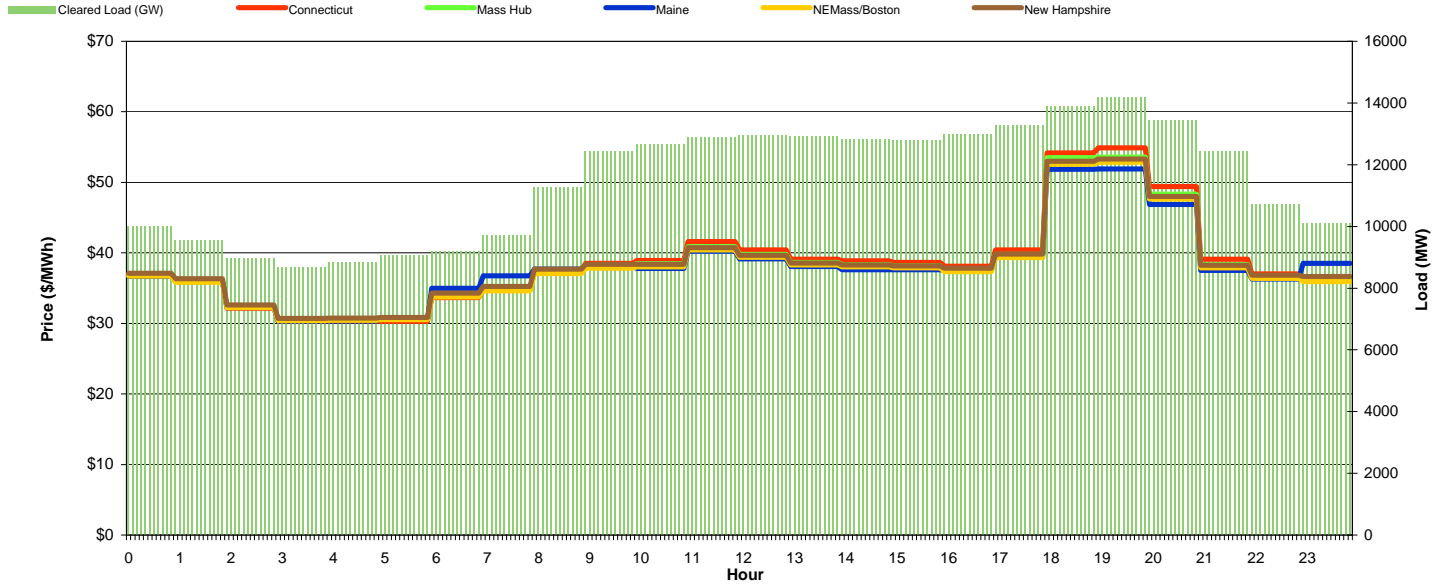

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	40.51	41.25	50.56	47.58	35.45	33.27	38.76	35.27	37.02	37.72	43.54	43.60	53.54	45.71	38.22	36.20	37.00	41.80	49.35	48.15	45.64	40.60	42.91	35.37	41.63	42.27	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	39.95	40.89	50.57	47.40	35.40	33.39	38.71	35.11	36.57	37.11	42.72	42.61	52.28	44.48	37.32	35.53	36.35	40.91	47.98	46.49	43.88	39.21	41.83	34.90	40.90	41.27		
<b>New Hampshire</b>	40.11	41.25	51.13	47.94	35.81	33.76	39.21	35.49	37.11	37.57	43.11	42.89	52.48	44.68	37.54	35.87	36.74	41.36	48.45	46.87	44.12	39.43	42.07	35.33	41.26	41.61		
<b>Maine</b>	39.74	40.82	50.58	47.40	35.53	33.58	39.18	35.16	36.89	37.30	42.54	42.24	51.15	43.68	36.77	35.38	36.26	40.80	47.88	46.00	42.95	38.48	40.71	34.50	40.65	40.89		
<b>Mass Hub</b>	40.20	41.08	50.67	47.54	35.50	33.45	38.83	35.26	36.83	37.42	43.11	43.01	52.82	45.01	37.70	35.79	36.59	41.24	48.46	47.04	44.47	39.70	42.26	35.15	41.21	41.67		
<b>DA Forecast Load (GW)</b>	11.46	10.83	10.45	10.19	10.12	10.31	10.64	11.30	12.30	13.20	13.73	14.06	14.24	14.22	14.18	14.20	14.37	14.60	14.79	15.31	14.86	13.85	12.69	11.54				
<b>Forecast Error %</b>	2.9%	2.4%	1.8%	1.4%	1.2%	0.5%	0.5%	-0.5%	0.3%	0.2%	0.2%	0.5%	0.5%	0.6%	0.1%	-0.5%	-0.1%	0.8%	2.9%	1.8%	1.0%	0.7%	0.3%	0.5%				

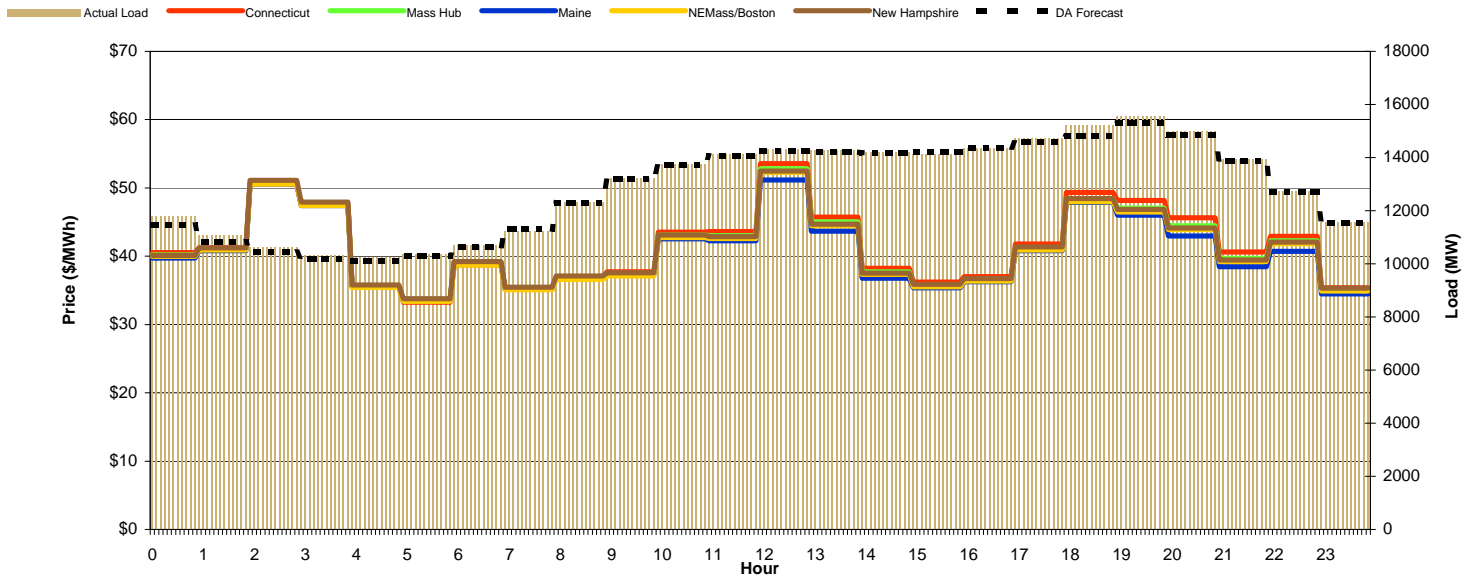




# ISO-NE Daily Report

Monday September 27, 2010

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	33.70	33.07	30.25	30.23	30.95	34.78	41.12	41.26	45.41	47.10	50.31	52.34	51.88	54.42	50.43	47.45	47.27	51.31	54.52	54.95	45.69	40.69	39.06	37.34	43.56	48.38	All	On Pk
<b>NEMass/Boston</b>	33.36	32.89	30.15	30.15	30.88	34.55	40.25	39.95	43.98	45.57	48.62	50.53	50.10	52.51	48.67	45.80	45.71	49.53	52.78	52.87	44.32	39.19	37.94	36.80	42.38	46.75	43.56	48.38
<b>New Hampshire</b>	33.96	33.41	30.60	30.60	31.37	35.35	41.06	40.77	44.67	46.20	49.10	50.99	50.53	52.94	49.01	46.15	46.08	50.01	53.31	53.46	44.76	39.53	38.31	37.38	42.90	47.24	42.90	47.24
<b>Maine</b>	33.78	33.09	30.49	30.33	31.14	38.49	42.13	42.00	43.59	44.81	47.18	48.91	48.34	50.54	47.17	44.62	44.62	48.11	51.46	51.59	43.50	38.35	36.96	37.92	42.05	45.73	42.05	45.73
<b>Mass Hub</b>	33.63	33.11	30.31	30.32	31.04	34.81	40.84	40.53	44.62	46.20	49.16	51.11	50.53	52.97	49.07	46.15	46.05	49.92	53.39	53.37	44.63	39.57	38.14	37.04	42.77	47.21	42.77	47.21
<b>Cleared Load (GW)</b>	9.7	9.5	9.2	9.2	9.4	10.1	12.4	13.2	14.0	14.6	14.8	15.0	14.9	15.0	14.8	14.7	14.8	14.9	15.4	15.6	14.8	13.5	11.9	10.8				

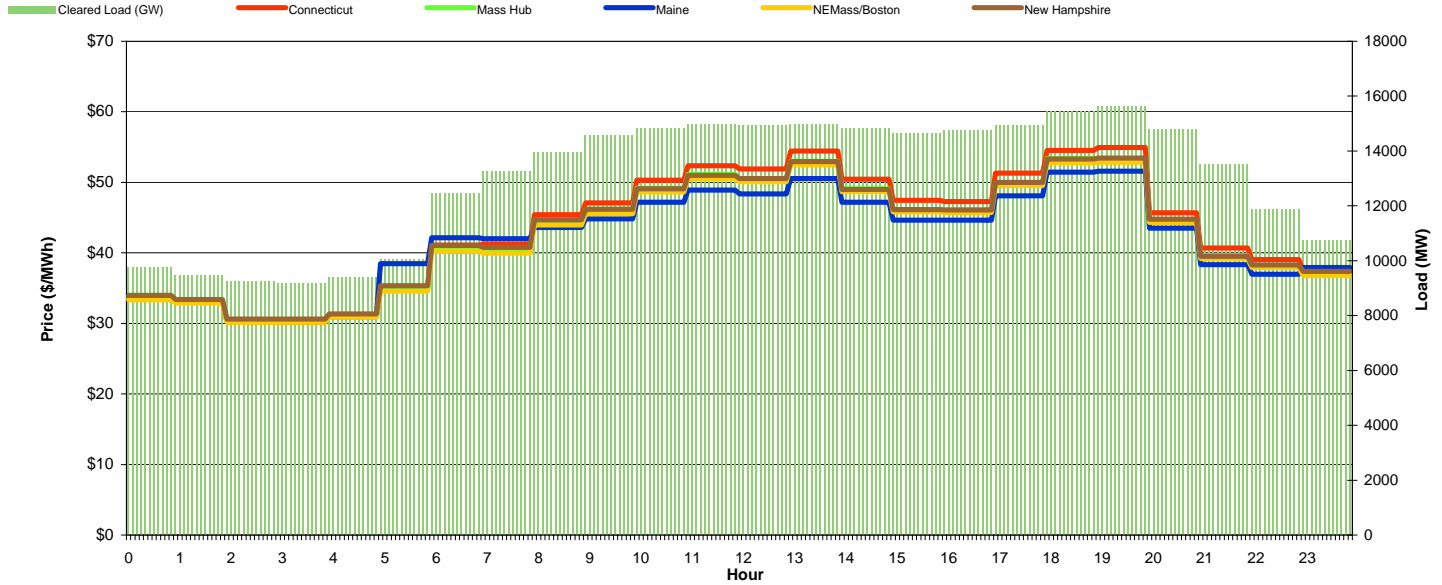

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	33.10	33.85	34.93	34.77	35.16	32.57	49.30	54.57	48.05	52.50	46.08	46.36	46.29	51.31	44.57	42.75	46.29	59.85	48.23	46.86	45.02	41.36	37.49	33.49	43.53	47.35	All	On Pk
<b>NEMass/Boston</b>	32.90	33.66	34.89	34.76	35.04	32.38	48.38	52.97	46.76	51.09	44.67	44.80	44.77	49.51	43.18	41.35	44.87	57.75	46.71	45.14	43.58	39.78	36.36	32.90	42.43	45.83	42.43	45.83
<b>New Hampshire</b>	33.36	34.09	35.38	35.25	35.46	32.85	49.12	53.74	47.36	51.71	45.26	45.34	45.32	50.09	43.67	41.75	45.32	58.41	47.31	45.68	44.03	40.09	36.65	33.21	42.94	46.36	42.94	46.36
<b>Maine</b>	32.98	33.76	35.34	35.30	35.42	33.04	48.78	53.05	46.54	50.48	44.17	43.81	43.95	48.47	42.51	40.45	43.90	56.36	45.99	44.47	42.78	38.63	35.31	32.33	41.99	45.05	41.99	45.05
<b>Mass Hub</b>	33.13	33.85	35.05	34.92	35.23	32.54	48.77	53.44	47.09	51.54	45.08	45.23	45.19	50.01	43.57	41.74	45.27	58.30	47.09	45.59	43.98	40.24	36.75	33.17	42.78	46.26	42.78	46.26
<b>DA Forecast Load (GW)</b>	10.72	10.27	10.04	10.02	10.32	11.37	13.32	14.62	15.23	15.71	16.07	16.29	16.31	16.39	16.29	16.21	16.26	16.33	16.40	16.82	16.27	15.03	13.50	12.06				
<b>Forecast Error %</b>	2.9%	3.0%	3.3%	3.0%	2.7%	-0.4%	0.2%	0.9%	0.5%	0.1%	0.2%	-0.2%	-0.4%	-1.0%	-1.3%	-1.4%	-0.8%	0.8%	2.6%	0.4%	-0.6%	-0.1%	0.2%	0.9%				

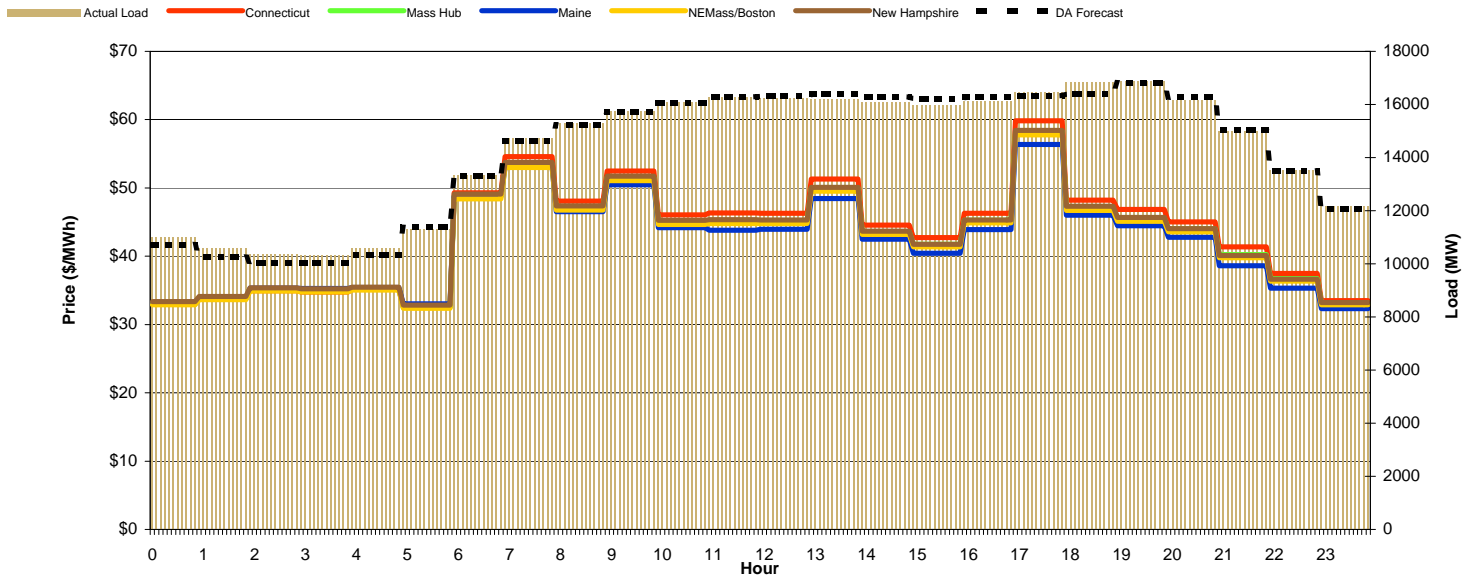




# ISO-NE Daily Report

Tuesday September 28, 2010

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	34.08	30.65	30.14	30.01	30.49	34.99	43.43	45.09	47.40	50.74	55.08	63.00	63.00	65.12	65.28	68.02	64.98	62.00	65.25	68.00	55.19	46.39	40.44	37.21	49.83	57.81	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	33.51	30.32	29.83	29.68	30.15	34.55	42.19	43.42	45.57	48.64	52.62	52.79	54.12	56.44	53.04	53.06	53.03	52.99	53.77	56.10	52.64	44.39	38.88	36.36	44.92	50.72		
<b>New Hampshire</b>	34.16	30.83	30.32	30.19	30.70	35.36	43.07	44.05	46.15	49.32	53.38	53.59	54.96	57.32	53.72	53.78	53.74	53.73	54.68	57.14	53.32	44.93	39.44	37.03	45.62	51.45		
<b>Maine</b>	33.41	30.17	29.58	29.42	30.04	34.71	42.00	42.83	44.65	47.41	50.85	50.87	52.19	54.69	51.31	51.11	51.34	51.54	52.80	55.07	51.15	43.20	38.39	38.36	44.05	49.34		
<b>Mass Hub</b>	33.77	30.51	30.00	29.92	30.38	34.84	48.00	44.05	46.15	49.26	53.35	53.64	55.00	57.11	53.77	53.91	53.83	53.81	54.50	56.81	53.19	44.81	39.12	36.74	45.69	51.39		
<b>Cleared Load (GW)</b>	10.6	10.2	10.1	9.9	10.1	11.1	13.4	14.3	14.9	15.4	15.5	15.9	16.0	16.3	16.2	16.1	16.0	16.1	16.4	16.5	15.7	14.6	13.1	12.0				

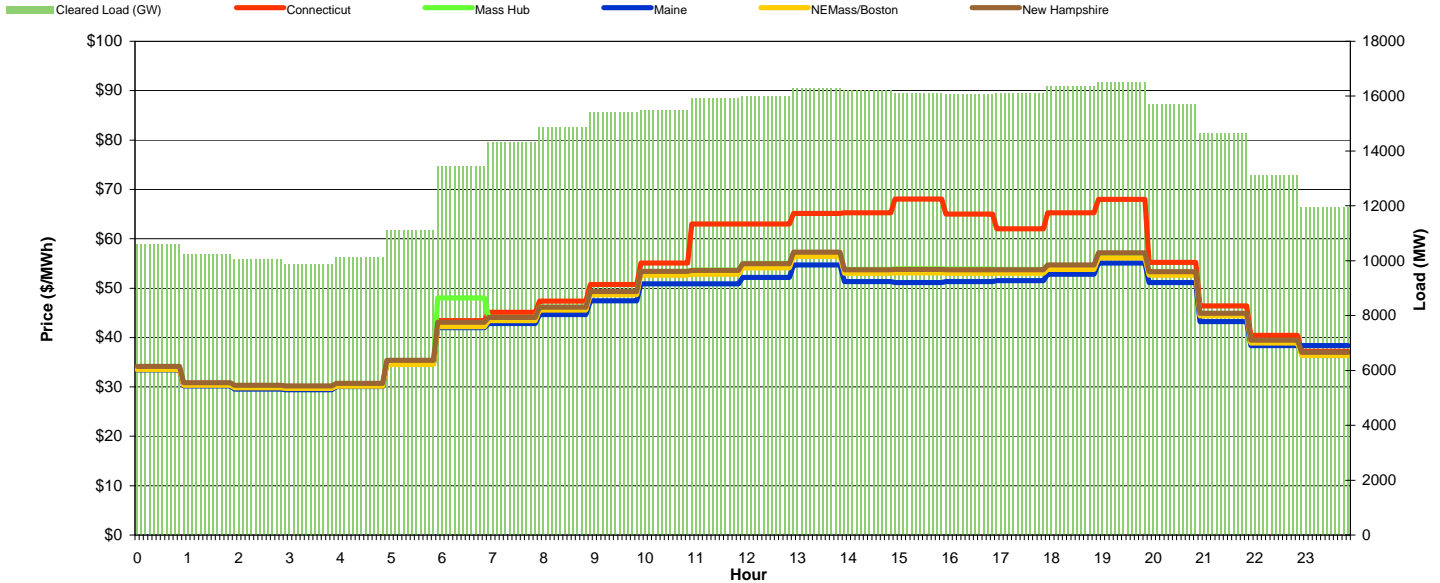

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	33.73	31.12	30.04	29.96	30.05	32.16	44.95	57.88	57.21	67.01	64.05	57.12	48.97	48.19	46.49	56.59	66.12	62.25	91.75	75.15	65.44	58.95	39.16	38.28	51.36	60.15	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	33.20	30.84	29.81	29.73	29.73	31.78	43.76	56.01	55.08	64.38	61.72	55.19	47.11	46.27	44.69	54.20	63.13	59.63	88.29	72.65	63.40	56.98	37.96	37.48	49.71	57.92		
<b>New Hampshire</b>	33.62	31.25	30.15	30.06	30.02	32.18	44.31	56.70	55.50	64.86	62.08	55.46	47.38	46.52	44.85	54.35	63.45	60.05	88.93	73.18	63.86	57.26	38.04	37.70	50.07	58.28		
<b>Maine</b>	32.82	30.51	29.40	29.31	29.30	31.68	43.08	54.69	53.33	62.13	58.95	52.43	45.09	44.32	42.65	51.43	59.79	56.99	84.56	69.52	60.63	53.88	36.04	35.84	47.85	55.40		
<b>Mass Hub</b>	33.46	31.03	29.99	29.90	29.93	31.99	44.21	56.58	55.64	65.04	62.31	55.75	47.60	46.76	45.04	54.68	63.69	60.13	88.97	73.23	63.91	57.53	38.32	37.78	50.14	58.45		
<b>DA Forecast Load (GW)</b>	11.33	10.89	10.64	10.63	10.98	12.10	14.18	15.58	16.24	16.80	17.36	17.64	17.75	17.96	17.86	17.80	17.84	17.86	18.05	18.37	17.79	16.53	14.89	13.34				
<b>Forecast Error %</b>	-0.6%	-1.1%	-1.1%	-1.4%	-2.0%	-2.2%	-1.7%	-1.1%	-0.3%	-0.1%	-0.4%	-0.4%	-0.9%	-1.7%	-1.5%	-1.6%	-1.0%	0.2%	0.7%	0.0%	-0.5%	0.1%	0.6%	1.0%				

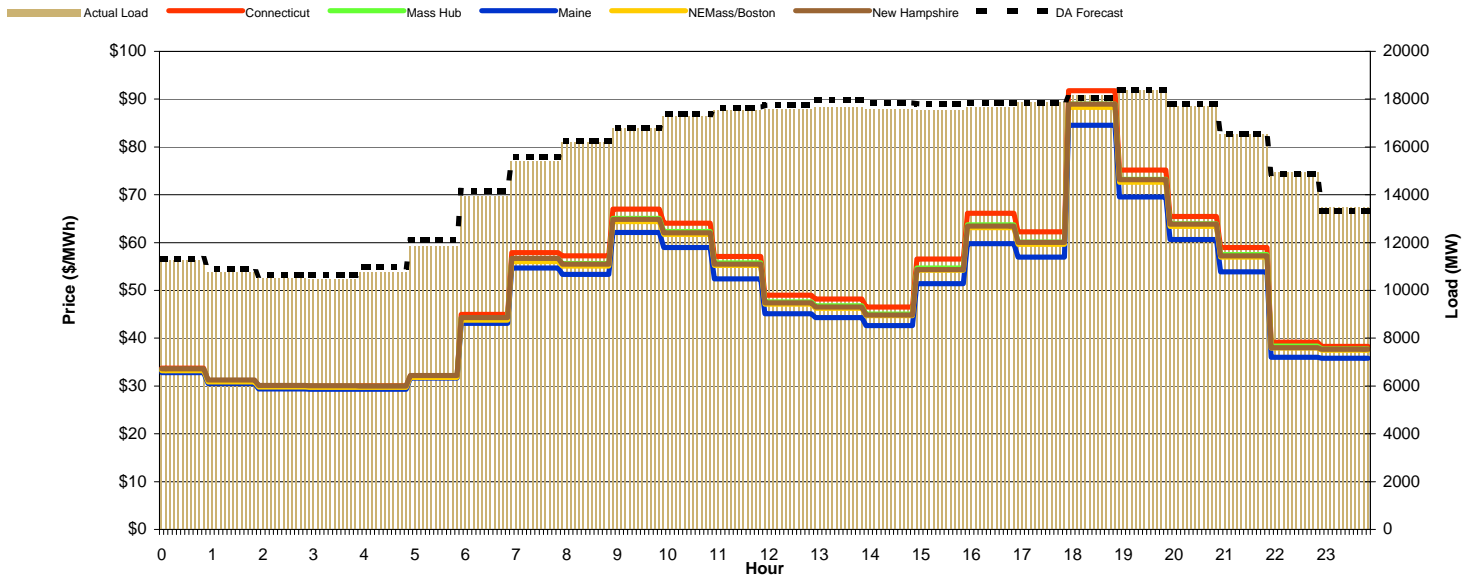




# ISO-NE Daily Report

Wednesday September 29, 2010

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$	
<b>Connecticut</b>	36.90	33.97	32.13	31.13	32.12	34.92	39.83	45.89	47.86	51.11	55.00	55.43	55.30	57.29	55.54	55.30	54.80	55.51	56.00	59.43	54.77	44.20	38.82	37.16	46.68	52.64
<b>NEMass/Boston</b>	36.31	33.65	31.89	30.94	31.90	34.68	39.01	44.40	46.25	49.38	52.80	53.04	53.06	53.06	52.90	53.03	52.85	52.82	52.83	56.97	52.64	42.70	37.50	36.50	45.05	50.39
<b>New Hampshire</b>	37.15	34.32	32.48	31.50	32.52	35.59	40.02	45.36	47.05	50.15	53.63	53.82	53.71	53.66	53.44	53.57	53.40	53.45	53.56	57.95	53.48	43.39	38.20	37.21	45.78	51.11
<b>Maine</b>	36.47	33.65	31.83	30.78	31.91	35.10	41.84	44.05	45.30	47.92	51.00	51.29	51.25	51.32	51.13	51.17	51.04	51.16	51.32	55.82	51.06	42.00	37.13	38.30	44.33	49.00
<b>Mass Hub</b>	36.66	33.93	32.13	31.18	32.15	34.96	39.55	44.93	46.71	49.84	53.42	53.59	53.59	53.56	53.34	53.57	53.37	53.40	53.32	57.56	53.14	43.02	37.73	36.79	45.48	50.88
<b>Cleared Load (GW)</b>	11.2	10.7	10.5	10.4	10.6	11.5	13.9	14.6	15.2	15.7	16.4	16.7	16.9	16.9	16.9	16.7	16.7	16.6	16.8	16.8	15.7	14.6	13.0	12.0		

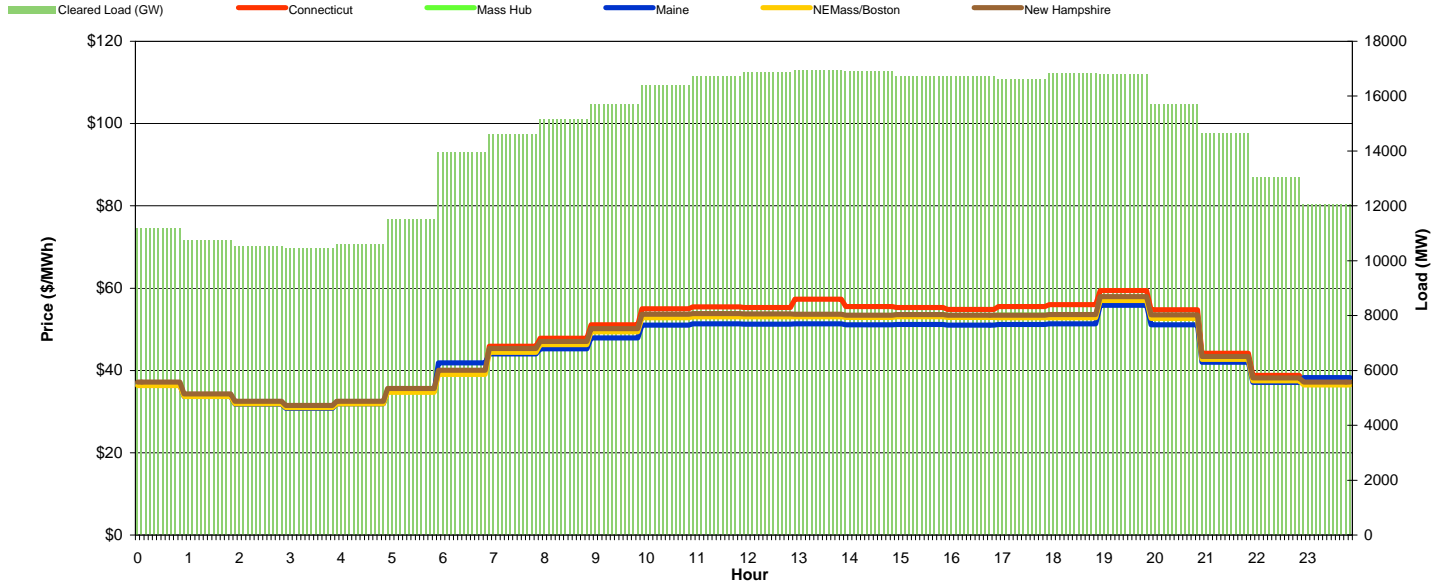

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$	
<b>Connecticut</b>	43.30	35.69	33.97	33.54	32.20	36.95	42.49	43.72	44.27	55.10	47.59	51.91	50.14	56.39	56.20	42.56	39.30	40.06	71.82	107.63	58.49	43.97	39.19	35.75	47.59	53.02
<b>NEMass/Boston</b>	42.43	35.29	33.73	33.43	32.36	36.83	41.97	42.87	43.41	53.88	46.10	50.54	48.82	54.98	54.72	41.63	38.59	39.30	70.13	105.01	57.01	43.12	38.38	35.17	46.65	51.78
<b>New Hampshire</b>	42.83	35.63	34.08	33.78	32.67	37.32	42.56	43.36	43.67	54.05	46.22	50.55	48.73	54.80	54.52	41.46	38.52	39.25	70.17	105.43	57.24	43.34	38.60	35.40	46.84	51.87
<b>Maine</b>	40.95	34.33	32.98	32.86	31.84	36.45	41.22	41.78	41.79	50.97	43.40	47.28	45.41	50.90	50.69	38.75	36.40	37.16	66.05	100.55	54.20	41.39	36.99	34.21	44.52	48.98
<b>Mass Hub</b>	42.80	35.51	33.91	33.59	32.45	36.98	42.19	43.16	43.67	54.19	46.34	50.78	49.05	55.24	54.95	41.80	38.70	39.43	70.36	105.37	57.12	43.25	38.57	35.39	46.87	52.00
<b>DA Forecast Load (GW)</b>	12.43	11.82	11.51	11.44	11.65	12.66	14.60	15.88	16.54	17.09	17.64	18.06	18.22	18.36	18.28	18.14	18.17	18.10	18.00	18.17	17.55	16.23	14.58	13.01		
<b>Forecast Error %</b>	2.4%	2.4%	1.9%	1.2%	0.7%	0.5%	-0.2%	-0.9%	-0.7%	-0.2%	-0.2%	-0.4%	-0.5%	0.0%	0.5%	0.8%	-0.2%	-1.1%	0.5%	1.6%	1.4%	1.6%	1.7%	3.1%		

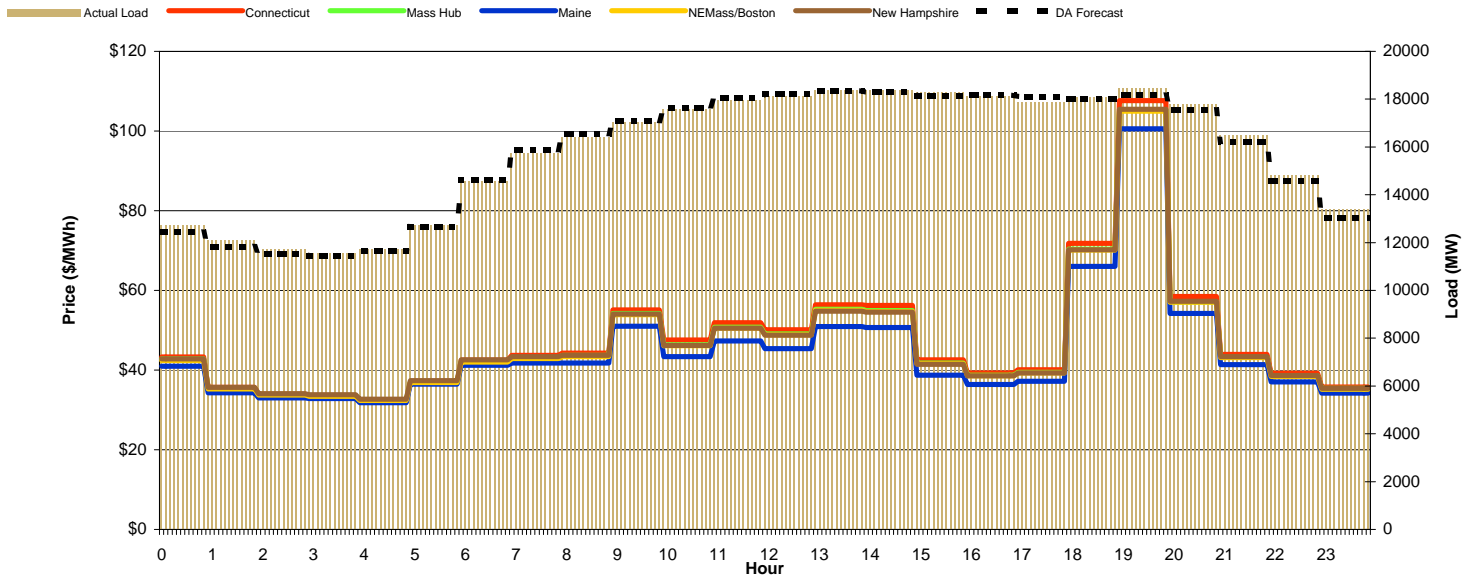




# ISO-NE Daily Report

Thursday September 30, 2010

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%

## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	34.48	31.42	30.13	29.60	30.63	34.45	41.40	45.41	48.78	52.82	57.15	62.00	64.00	67.01	64.77	64.94	64.00	61.39	65.71	66.00	55.00	43.71	40.64	37.93	49.72	57.71	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	33.93	31.05	29.87	29.26	30.33	34.06	40.17	43.71	46.85	50.66	51.98	51.43	51.42	51.51	51.23	51.06	51.05	51.55	53.43	55.13	50.68	42.17	39.11	37.29	44.12	49.56		
<b>New Hampshire</b>	34.54	31.51	30.27	29.63	30.79	34.78	41.09	44.52	47.53	51.36	52.76	52.19	52.02	52.17	51.80	51.64	51.59	52.15	54.20	56.13	51.41	42.78	39.65	38.13	44.78	50.24		
<b>Maine</b>	33.39	30.46	29.31	28.68	29.96	33.95	40.25	43.03	45.58	48.76	50.04	49.26	49.29	49.40	49.28	49.37	49.26	49.80	51.91	54.12	49.34	41.38	38.42	37.64	43.00	48.02		
<b>Mass Hub</b>	34.28	31.34	30.12	29.52	30.59	34.39	42.01	44.44	47.56	51.38	52.73	52.00	52.00	51.74	51.55	51.61	52.18	54.07	55.80	51.25	42.62	39.55	37.52	44.68	50.16			
<b>Cleared Load (GW)</b>	11.3	10.7	10.5	10.5	10.7	11.6	14.3	15.2	15.6	16.0	16.5	16.6	16.7	16.7	16.8	16.7	16.6	16.8	16.9	16.1	15.2	13.5	11.9					

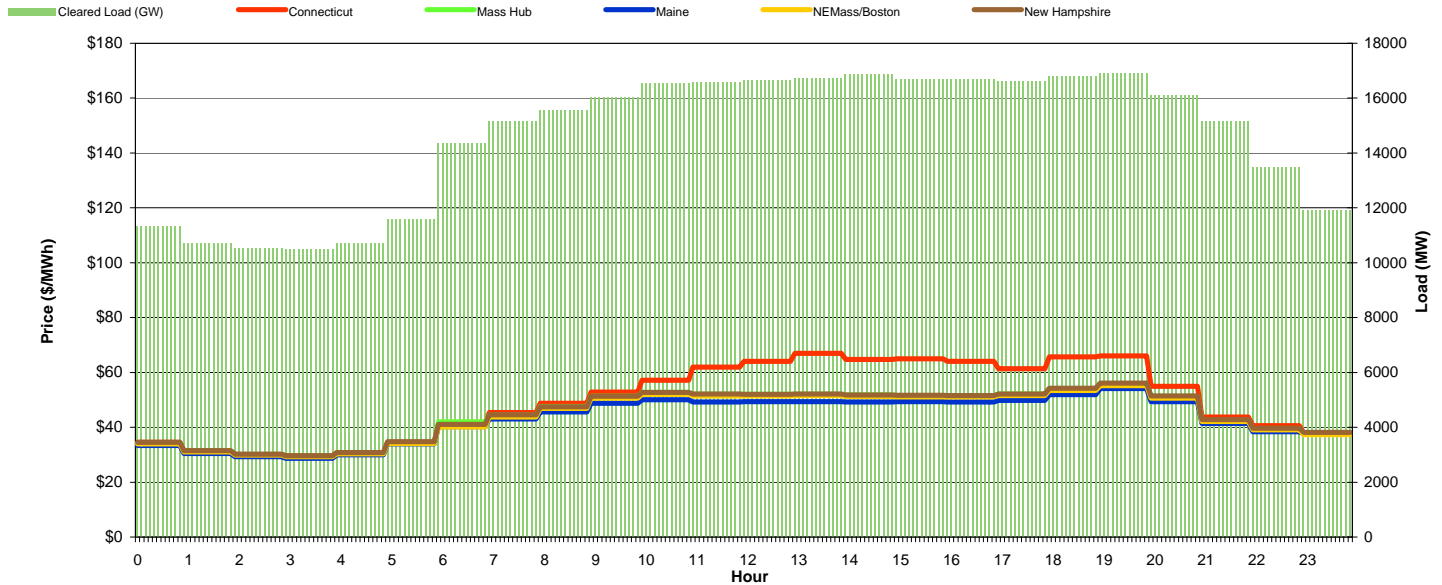

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	35.84	33.72	32.18	33.72	34.06	31.69	42.20	47.55	52.84	52.80	55.90	53.41	57.08	56.87	56.20	45.24	51.07	64.21	82.59	174.02	110.61	39.17	42.83	41.26	55.29	65.15	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	35.35	33.52	32.14	33.66	34.09	31.55	41.57	46.23	51.17	51.09	53.99	51.55	55.09	54.60	54.25	43.78	49.33	61.78	79.73	167.66	107.35	38.02	41.56	40.43	53.73	62.95		
<b>New Hampshire</b>	35.70	33.87	32.47	34.05	34.53	31.90	42.18	46.54	51.30	51.13	54.00	51.42	54.86	54.34	53.94	43.56	49.08	61.50	79.51	167.16	106.75	37.75	41.25	40.18	53.71	62.76		
<b>Maine</b>	34.56	33.02	31.84	33.47	34.09	31.20	41.25	44.68	48.77	48.52	51.28	48.73	51.79	50.98	50.63	41.20	46.41	57.63	74.63	156.86	100.52	35.54	38.99	38.25	51.04	59.20		
<b>Mass Hub</b>	35.58	33.68	32.27	33.80	34.20	31.66	41.73	46.49	51.44	51.30	54.22	51.76	55.27	54.80	54.46	43.88	49.46	62.02	79.99	168.55	107.81	38.20	41.80	40.58	53.96	63.22		
<b>DA Forecast Load (GW)</b>	12.02	11.44	11.13	11.03	11.31	12.39	14.38	15.69	16.39	17.25	17.84	18.21	18.34	18.51	18.52	18.54	18.65	18.64	18.80	18.73	18.08	16.80	15.18	13.62				
<b>Forecast Error %</b>	3.8%	3.4%	3.3%	3.3%	2.8%	2.0%	0.6%	1.5%	1.9%	0.7%	0.7%	0.6%	0.5%	0.2%	0.0%	-0.5%	-0.9%	-0.3%	1.2%	2.9%	3.5%	4.7%	5.4%	6.2%				

