




# ISO-NE Daily Report

Friday April 01, 2011

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	39.30	39.23	38.47	38.81	39.18	39.78	46.27	59.26	60.20	59.71	58.25	55.73	56.22	55.98	52.69	49.79	52.96	52.47	53.00	61.16	55.00	47.55	41.00	40.48	49.69	54.44	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	39.21	39.18	38.43	38.78	39.16	39.59	45.33	56.32	58.04	58.29	56.96	53.09	54.41	54.16	51.23	48.58	51.30	51.07	51.26	58.99	52.88	46.44	40.31	40.26	48.47	52.71		
<b>New Hampshire</b>	39.08	38.97	38.19	38.52	38.94	39.50	45.41	56.54	58.31	58.46	57.11	53.26	54.69	54.38	51.43	48.77	51.48	51.32	51.25	58.96	52.84	46.48	40.22	40.35	48.52	52.84		
<b>Maine</b>	38.71	38.46	37.65	37.95	38.41	39.18	45.00	56.09	58.00	57.65	56.17	51.76	53.28	52.81	50.16	47.43	50.16	50.20	50.08	57.38	51.74	45.47	39.27	40.58	47.65	51.73		
<b>Mass Hub</b>	39.15	39.18	38.52	38.89	39.19	39.57	45.50	56.70	58.36	58.72	57.30	53.51	54.92	54.72	51.66	48.91	51.80	51.47	51.69	59.64	53.44	46.67	40.45	40.24	48.76	53.12		
<b>Cleared Load (GW)</b>	10.6	10.4	10.2	10.1	10.4	11.1	13.1	14.7	15.0	15.1	15.2	15.2	15.0	14.8	14.5	14.4	14.4	14.7	14.9	15.5	14.8	13.8	12.9	11.5				

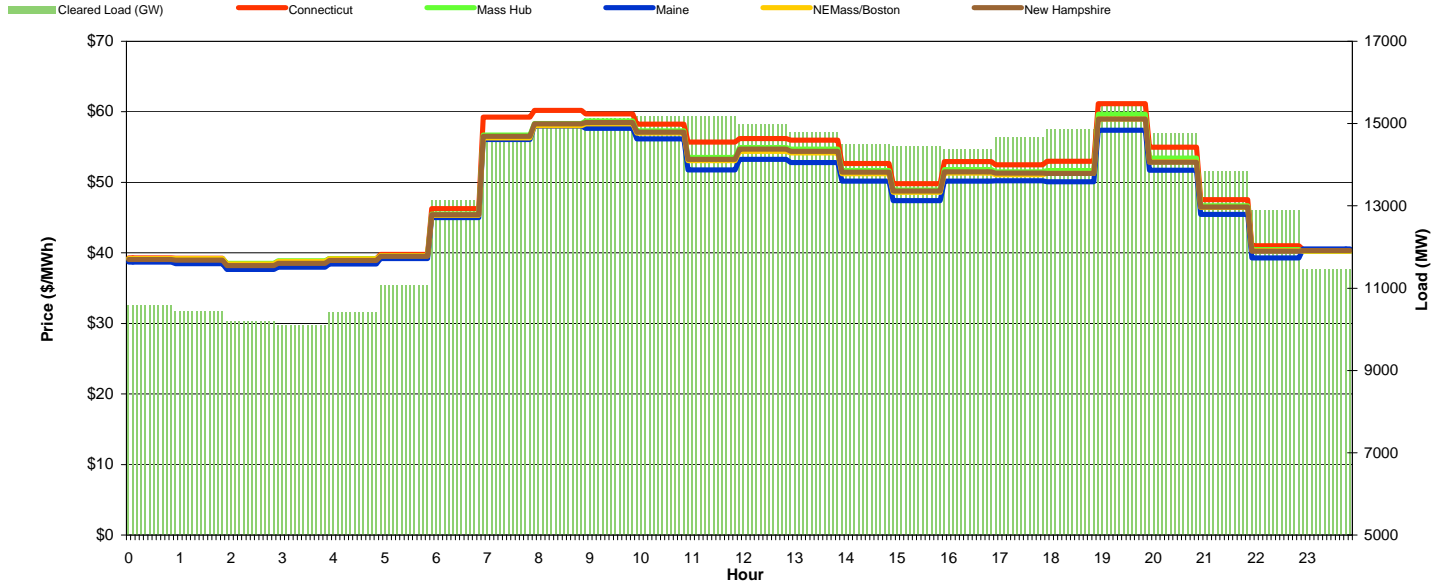

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	50.20	43.16	39.78	37.93	38.38	34.35	45.05	48.86	58.29	51.95	47.87	58.63	54.67	47.82	45.12	40.38	41.74	42.48	40.78	55.86	47.47	39.77	34.98	37.34	45.12	47.29	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	49.75	42.95	39.68	37.92	38.27	34.09	43.97	47.46	56.86	50.66	46.83	57.09	53.22	46.45	43.77	39.27	40.50	41.42	39.63	54.47	46.02	38.69	34.22	36.95	44.17	46.04		
<b>New Hampshire</b>	49.39	42.69	39.48	37.73	38.07	34.06	44.04	47.47	56.90	50.64	46.86	57.17	53.41	46.64	43.92	39.30	40.48	41.39	39.40	54.05	45.62	38.54	33.95	36.54	44.07	45.98		
<b>Maine</b>	48.88	42.43	39.35	37.71	37.91	34.17	44.14	47.50	57.52	50.61	46.68	56.43	52.90	46.26	43.44	38.71	39.76	40.81	38.72	53.16	44.69	37.97	33.30	36.05	43.71	45.53		
<b>Mass Hub</b>	49.78	42.93	39.67	37.90	38.27	34.04	44.08	47.57	56.90	50.67	46.77	57.15	53.29	46.53	43.92	39.41	40.68	41.54	39.76	54.53	46.14	38.84	34.31	36.88	44.23	46.13		
<b>DA Forecast Load (GW)</b>	11.56	11.12	10.93	10.88	11.19	12.23	14.14	15.43	15.89	16.14	16.34	16.34	16.23	16.12	15.93	15.66	15.66	15.83	15.85	16.25	15.96	15.13	13.97	12.75				
<b>Forecast Error %</b>	5.1%	4.9%	4.7%	5.1%	4.4%	1.8%	0.6%	0.3%	1.2%	1.4%	0.9%	1.0%	0.8%	0.5%	-0.3%	-0.1%	-0.3%	-0.3%	0.0%	-0.4%	-0.5%	-0.4%	-0.5%	-0.3%				

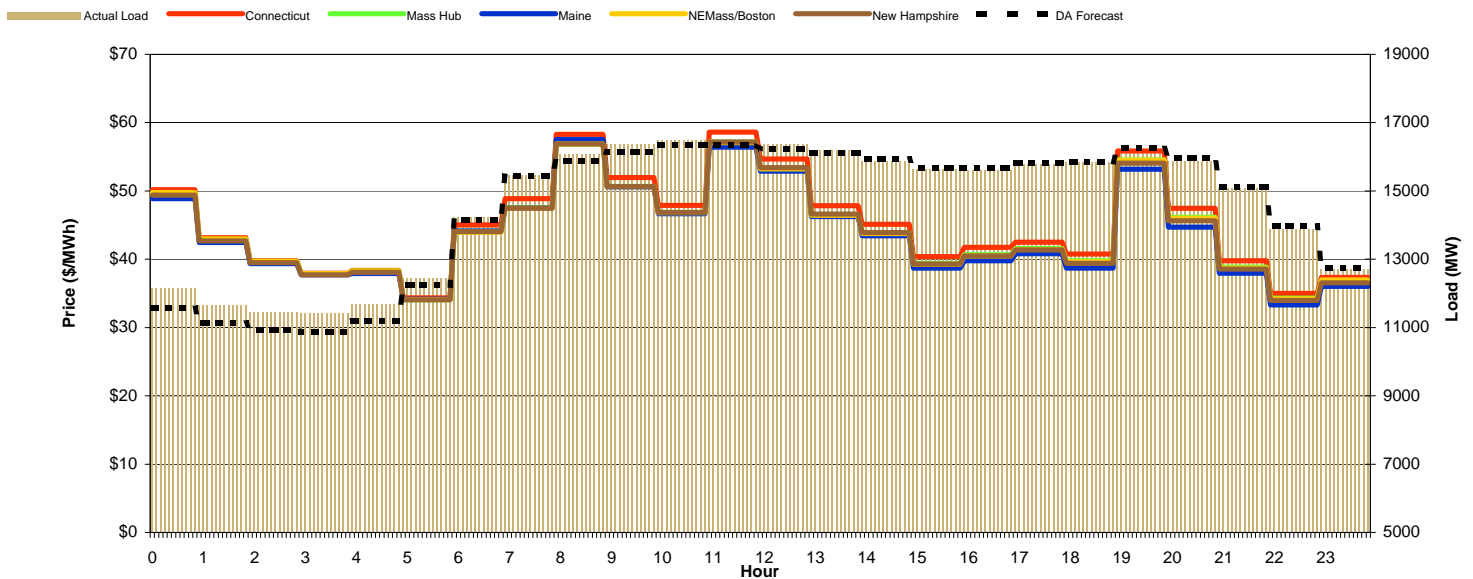




# ISO-NE Daily Report

Saturday April 02, 2011

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	40.23	39.24	39.05	39.11	39.06	39.35	39.72	39.55	41.57	47.00	48.28	47.00	46.00	43.40	42.31	39.83	40.14	39.73	41.38	54.66	49.00	44.71	43.00	41.88	42.72	44.22	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	40.34	39.36	39.28	39.39	39.29	39.32	39.65	39.36	41.59	46.61	47.85	46.57	45.52	42.91	41.85	39.22	39.37	39.30	40.88	52.87	47.40	43.39	41.97	40.69	42.25	43.54		
<b>New Hampshire</b>	40.09	39.02	38.93	38.99	38.94	39.07	39.60	39.34	41.44	46.27	47.50	46.25	45.20	42.70	41.69	39.25	39.36	39.34	40.61	52.48	47.23	43.27	41.96	40.60	42.05	43.37		
<b>Maine</b>	39.63	38.51	38.35	38.30	38.34	38.43	39.30	39.15	40.44	44.58	45.70	44.70	43.45	41.60	40.91	38.65	38.41	38.71	39.88	50.76	45.72	42.00	40.93	39.42	41.08	42.22		
<b>Mass Hub</b>	40.32	39.33	39.28	39.34	39.34	39.48	39.74	39.44	41.61	46.78	48.03	46.74	45.63	42.93	41.85	39.39	39.38	40.90	53.41	47.78	43.73	42.18	41.12	42.39	43.71			
<b>Cleared Load (GW)</b>	10.7	10.2	10.1	9.7	10.1	10.2	10.8	11.8	13.1	13.7	13.8	13.7	13.2	12.8	12.4	12.3	12.4	12.9	13.3	14.1	13.8	13.3	12.0	11.0				

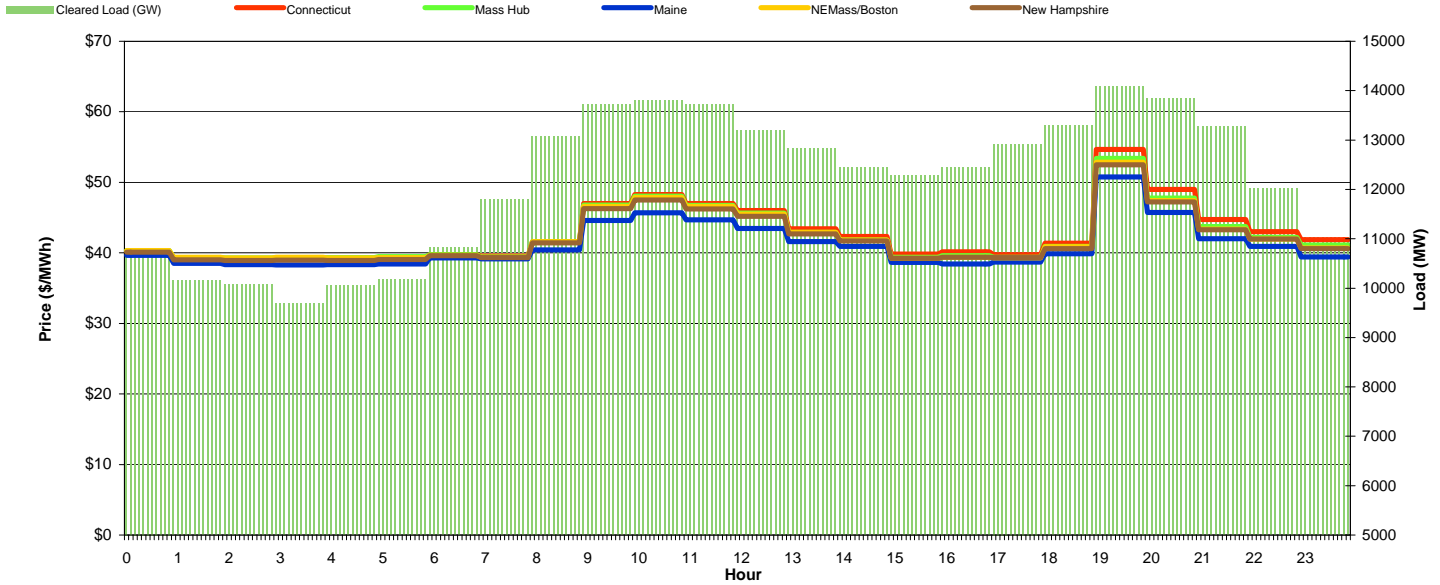

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	45.44	49.04	40.96	40.35	48.26	56.94	43.87	37.33	38.65	46.28	45.61	41.11	40.25	40.58	40.80	39.54	38.86	38.22	37.31	48.75	40.27	38.75	41.51	40.65	42.47	40.86	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	45.40	49.08	41.14	40.71	48.37	56.86	43.74	37.08	38.46	45.69	44.91	40.48	39.54	39.55	39.81	38.88	38.19	37.74	36.72	47.65	39.11	37.71	40.45	39.57	41.95	40.12		
<b>New Hampshire</b>	44.73	48.19	40.46	40.00	47.52	55.71	43.04	36.70	38.08	45.13	44.37	39.99	39.15	39.22	39.51	38.58	37.88	37.40	36.26	46.56	38.52	37.21	39.93	39.02	41.38	39.66		
<b>Maine</b>	44.20	47.44	39.85	39.45	46.60	54.51	42.33	36.25	37.23	43.61	42.93	38.70	37.83	38.05	38.79	37.96	37.14	36.64	35.56	44.90	37.37	36.25	38.95	38.02	40.44	38.64		
<b>Mass Hub</b>	45.13	48.76	40.86	40.38	48.14	56.62	43.58	36.96	38.32	45.66	44.90	40.46	39.60	39.73	39.91	38.91	38.21	37.71	36.71	47.47	39.12	37.76	40.47	39.62	41.87	40.12		
<b>DA Forecast Load (GW)</b>	11.74	11.23	10.94	10.80	10.86	11.27	11.88	12.73	13.75	14.36	14.61	14.48	14.26	13.99	13.62	13.37	13.38	13.76	14.01	14.67	14.61	14.00	13.09	12.08				
<b>Forecast Error %</b>	0.6%	0.7%	2.5%	0.3%	4.7%	2.8%	3.3%	0.7%	-0.6%	-1.0%	-1.4%	-1.2%	-1.5%	-1.8%	-1.3%	-0.9%	-0.8%	-2.0%	-2.5%	-2.1%	-0.8%	0.0%	-0.4%	0.0%				

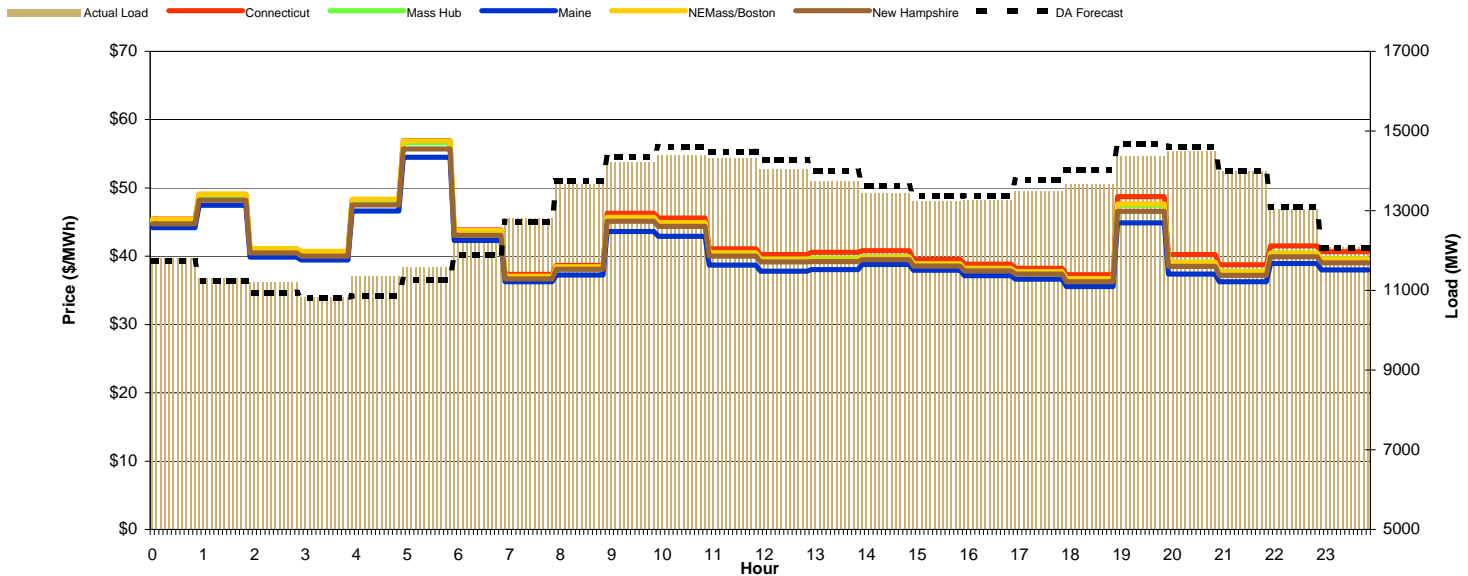




# ISO-NE Daily Report

Sunday April 03, 2011

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	40.19	39.67	39.28	38.68	38.73	39.30	39.41	39.77	40.01	40.23	42.65	43.68	44.09	41.04	40.37	40.59	40.44	42.48	42.55	55.62	54.19	44.91	42.92	40.89	42.15	43.47	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	39.29	39.05	39.12	38.59	38.63	39.15	39.23	39.40	39.27	39.31	41.45	42.41	42.79	39.94	39.33	39.40	39.41	41.33	41.49	53.82	52.03	43.18	41.59	39.69	41.20	42.26		
<b>New Hampshire</b>	38.94	38.68	38.62	38.08	38.14	38.70	38.87	39.16	39.28	39.18	41.33	42.29	42.71	39.86	39.18	39.31	39.31	41.39	41.47	53.42	51.54	43.10	41.54	39.54	40.99	42.13		
<b>Maine</b>	37.65	37.39	37.34	36.74	36.81	37.40	37.70	38.13	38.07	38.00	39.87	40.79	41.10	38.72	38.04	38.18	38.01	40.15	40.53	51.21	49.20	41.45	40.01	38.29	39.62	40.72		
<b>Mass Hub</b>	39.57	39.43	39.20	38.69	38.73	39.22	39.26	39.43	39.50	39.57	41.81	42.80	43.16	40.18	39.52	39.70	39.66	41.54	41.62	54.33	52.55	43.54	41.84	39.99	41.45	42.55		
<b>Cleared Load (GW)</b>	10.4	10.3	9.9	9.7	9.7	10.0	10.4	10.8	11.9	12.6	12.9	13.0	12.8	12.3	12.1	12.0	12.2	12.5	13.0	14.2	13.7	12.9	11.9	10.9				

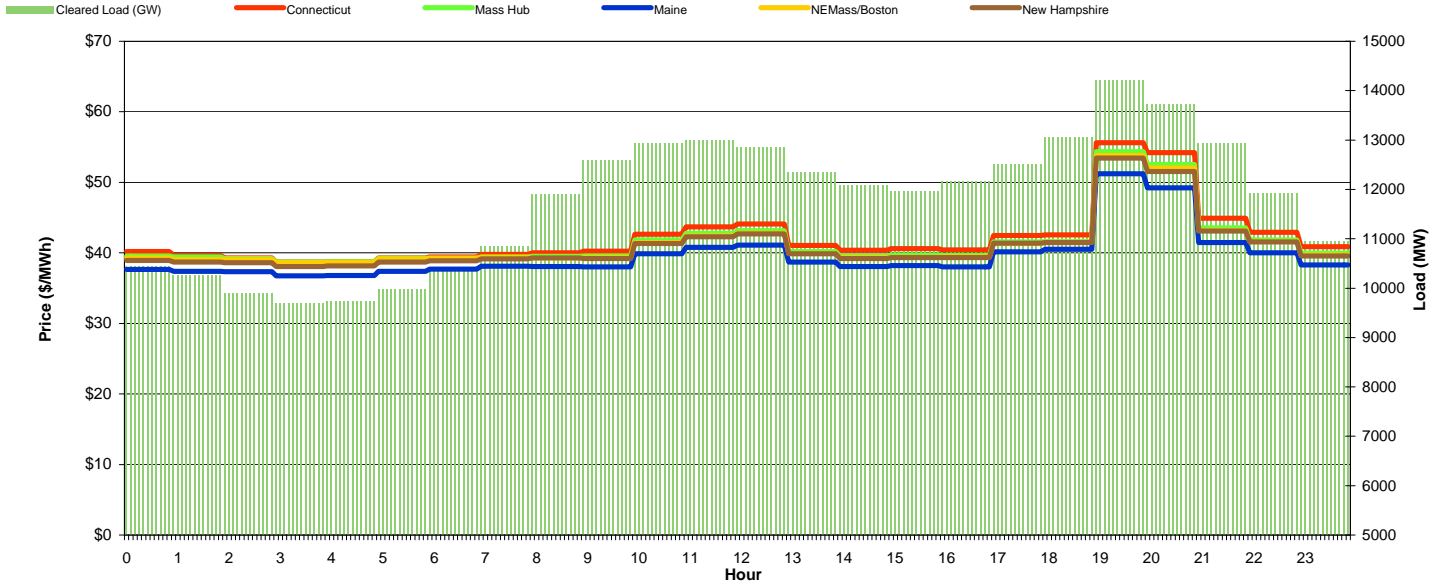

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	41.00	53.10	42.28	40.24	41.40	48.78	48.78	38.27	38.09	39.44	41.62	39.99	40.41	43.57	39.67	39.95	39.44	40.93	39.59	54.42	48.07	46.08	39.17	45.08	42.89	41.79	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	40.17	52.71	42.16	40.22	41.47	48.71	48.58	37.86	37.22	38.26	40.43	38.89	39.28	42.40	38.66	38.93	38.49	40.00	38.71	52.72	46.28	44.34	38.18	44.37	42.04	40.67		
<b>New Hampshire</b>	39.58	51.52	41.41	39.57	40.77	47.79	47.71	37.44	37.01	37.95	40.00	38.51	38.91	42.07	38.35	38.59	38.10	39.63	38.28	52.11	45.70	44.02	37.89	43.71	41.53	40.29		
<b>Maine</b>	38.54	49.41	40.26	38.58	39.88	46.25	46.45	36.72	36.26	37.26	39.18	37.63	37.93	41.15	37.65	37.93	37.19	38.71	37.54	50.48	44.11	42.80	37.18	42.44	40.48	39.36		
<b>Mass Hub</b>	40.17	52.57	42.04	40.08	41.27	48.52	48.40	37.80	37.36	38.50	40.57	39.03	39.37	42.54	38.76	39.02	38.59	40.08	38.72	52.88	46.45	44.55	38.25	44.26	42.07	40.78		
<b>DA Forecast Load (GW)</b>	11.13	10.65	10.39	10.31	10.36	10.68	11.07	11.67	12.53	13.24	13.53	13.59	13.56	13.34	13.09	12.92	13.07	13.56	13.96	14.78	14.77	13.90	12.70	11.60				
<b>Forecast Error %</b>	1.1%	3.2%	3.4%	3.0%	3.0%	2.6%	1.9%	0.4%	0.3%	-0.1%	-0.1%	0.1%	-0.4%	-0.6%	-0.6%	-0.2%	0.0%	-1.6%	-2.0%	-1.4%	0.3%	0.5%	0.5%	0.3%				

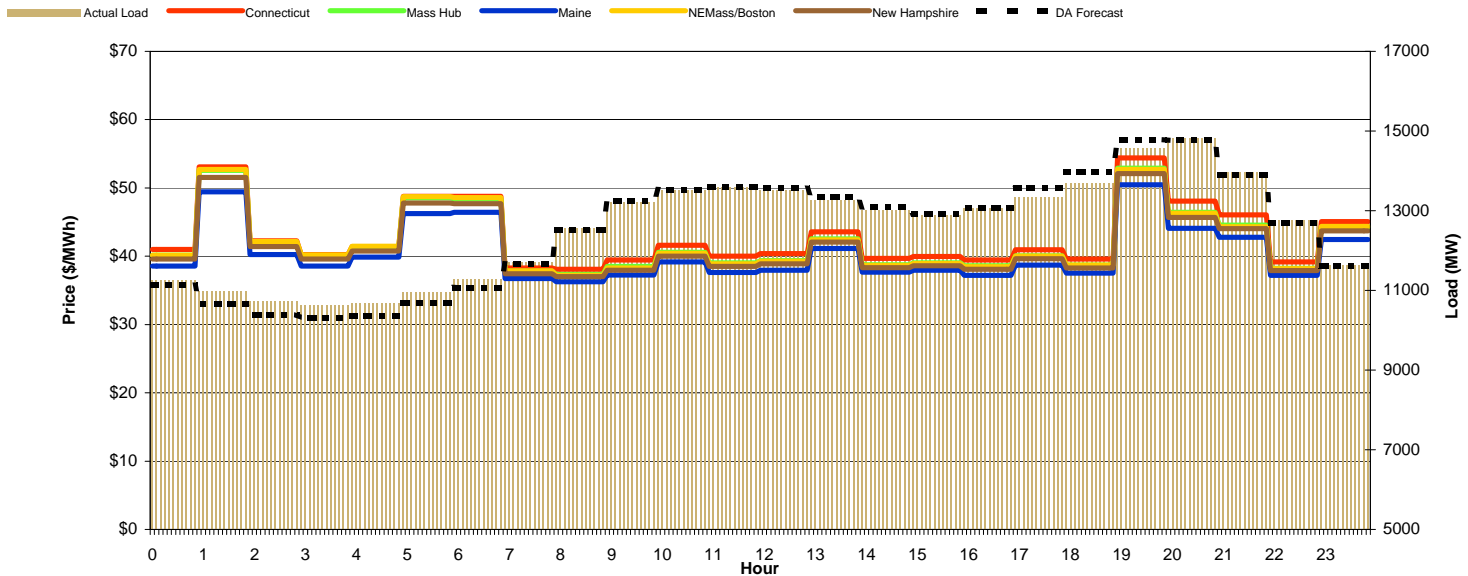




# ISO-NE Daily Report

Monday April 04, 2011

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$				
<b>Connecticut</b>	39.63	39.27	39.09	39.03	39.04	41.00	50.68	59.03	57.66	56.14	60.61	60.48	57.63	58.92	55.08	55.02	55.77	56.46	55.67	65.67	57.37	51.27	41.25	40.46	40.46	51.34	56.50	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	39.42	39.23	39.20	39.12	39.19	40.88	49.63	57.04	55.51	54.11	58.01	58.03	55.40	56.77	53.30	53.27	53.77	54.57	53.89	62.84	55.00	49.81	40.24	39.57	49.91	54.47			
<b>New Hampshire</b>	39.01	38.80	38.70	38.70	38.81	40.62	49.31	57.03	55.80	54.29	58.23	58.23	55.62	56.94	53.36	53.25	53.89	54.75	54.09	63.96	55.20	49.64	40.13	39.65	49.92	54.65			
<b>Maine</b>	37.88	37.78	37.55	37.57	37.79	39.67	47.80	55.77	54.61	53.21	56.36	55.94	53.37	54.56	51.38	51.26	51.71	52.74	52.41	61.37	53.03	47.89	39.11	39.71	48.35	52.80			
<b>Mass Hub</b>	39.34	39.16	39.11	39.05	39.07	40.70	49.80	57.48	55.96	54.52	58.58	58.65	55.93	57.34	53.68	53.61	54.19	55.00	54.20	63.53	55.57	50.03	40.38	39.71	50.19	54.92			
<b>Cleared Load (GW)</b>	10.4	10.4	10.2	10.1	10.4	11.0	12.9	14.4	14.8	15.0	14.8	14.9	14.8	14.7	14.4	14.3	14.3	14.7	14.7	15.2	15.0	13.6	12.4	11.2					

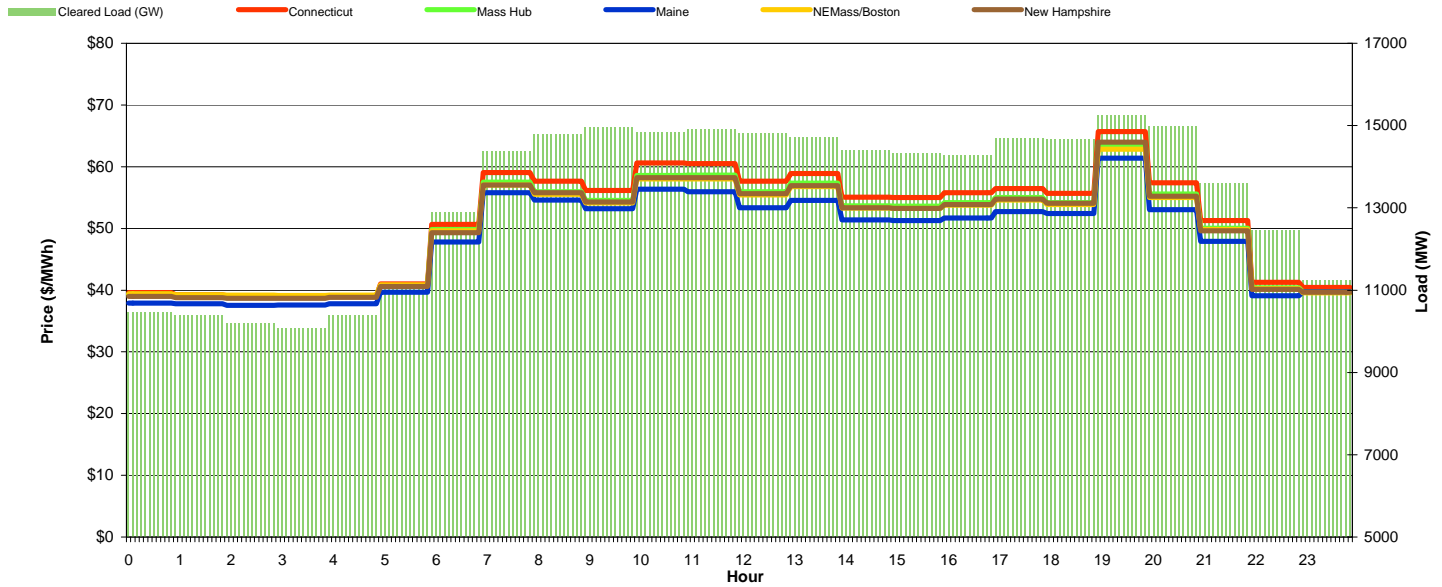

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	38.59	37.55	38.32	38.07	37.14	34.44	50.88	64.68	57.41	49.09	67.55	67.95	49.91	55.18	50.47	58.67	59.42	46.96	44.63	69.94	49.31	42.97	40.03	42.23	49.64	54.64	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	38.56	37.63	38.46	38.41	37.42	34.38	49.92	62.93	56.23	48.05	65.70	66.99	48.81	54.00	49.30	57.68	58.30	45.89	43.43	68.91	47.72	40.25	36.77	38.00	48.49	53.19		
<b>New Hampshire</b>	37.96	37.07	37.88	37.86	36.96	34.15	49.74	62.74	55.71	47.88	65.17	65.82	48.45	53.40	49.00	56.88	57.51	45.92	43.49	67.73	47.46	40.50	37.21	38.47	48.12	52.80		
<b>Maine</b>	37.24	36.51	37.27	37.45	36.78	34.30	49.54	62.81	55.50	47.89	64.47	64.72	47.40	52.24	48.04	55.60	56.18	45.20	43.02	66.61	46.50	39.56	36.32	37.67	47.45	52.00		
<b>Mass Hub</b>	38.32	37.39	38.23	38.11	37.11	34.19	49.92	62.93	55.72	47.72	65.24	65.84	48.45	53.55	49.04	57.05	57.73	45.77	43.46	67.84	47.65	41.62	38.84	41.18	48.45	53.03		
<b>DA Forecast Load (GW)</b>	10.83	10.43	10.27	10.27	10.61	11.80	13.85	15.20	15.64	15.87	16.06	16.09	16.08	16.02	15.85	15.63	15.76	16.08	16.22	16.58	16.13	14.93	13.37	12.00				
<b>Forecast Error %</b>	0.4%	2.1%	2.0%	2.1%	2.6%	1.0%	-0.6%	-0.5%	0.0%	-0.2%	0.1%	0.6%	0.0%	0.0%	0.3%	1.3%	0.8%	-0.2%	-0.9%	-1.3%	-0.3%	0.2%	3.0%	3.7%				

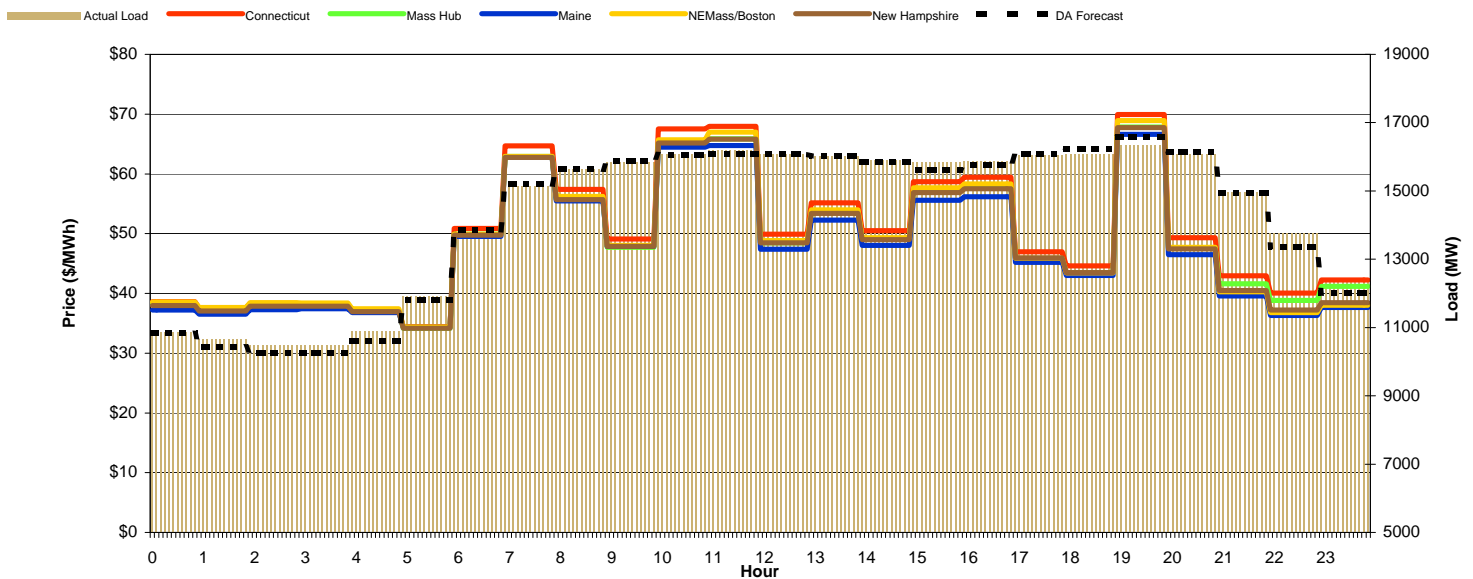




# ISO-NE Daily Report

Tuesday April 05, 2011

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$	
<b>Connecticut</b>	39.56	38.99	37.86	37.85	38.56	39.64	42.71	45.94	45.86	50.00	58.12	56.14	53.40	50.37	46.08	45.97	45.31	45.21	45.76	56.38	55.00	46.77	43.00	41.00	46.06	49.33
<b>NEMass/Boston</b>	39.19	38.86	37.79	37.81	38.54	39.32	41.85	44.62	44.31	48.13	55.97	54.00	51.22	48.33	44.29	44.34	43.73	43.73	44.35	54.18	52.37	45.03	42.18	40.33	44.77	47.55
<b>New Hampshire</b>	39.13	38.73	37.68	37.71	38.43	39.42	42.20	44.92	44.68	48.45	55.83	53.83	51.57	48.61	44.63	44.66	44.05	44.07	44.75	54.30	52.30	45.25	42.29	40.64	44.92	47.76
<b>Maine</b>	38.07	37.58	36.64	36.69	37.36	38.56	41.45	44.24	43.92	47.40	54.20	52.06	49.85	46.78	43.24	43.35	42.62	42.93	43.61	52.65	50.32	43.52	40.97	40.21	43.68	46.35
<b>Mass Hub</b>	39.35	38.97	37.89	37.88	38.62	39.43	42.16	44.96	44.64	48.56	56.33	54.38	51.70	48.77	44.68	44.67	44.08	43.99	44.59	54.73	52.91	45.42	42.28	40.48	45.06	47.92
<b>Cleared Load (GW)</b>	10.6	10.4	10.1	10.0	10.1	10.8	12.9	14.2	14.4	14.5	14.6	14.6	14.3	14.2	14.0	13.9	14.0	14.3	14.7	15.3	14.7	13.6	12.3	11.2		

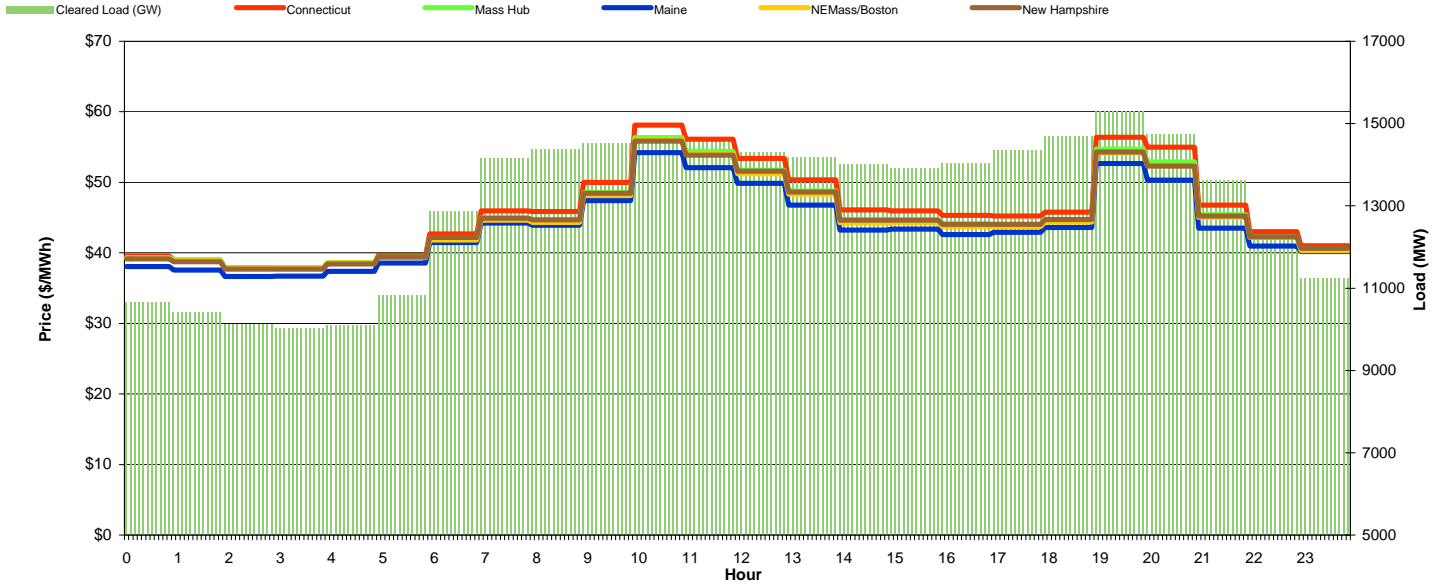

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$	
<b>Connecticut</b>	38.37	36.20	34.06	36.19	35.47	36.56	38.96	40.58	44.25	43.72	49.59	54.09	44.09	47.40	44.36	45.07	52.31	55.40	54.87	55.35	62.14	54.80	45.82	40.49	45.42	49.62
<b>NEMass/Boston</b>	38.06	36.37	34.35	36.44	35.72	36.45	38.44	39.51	42.67	42.25	47.64	51.87	42.53	45.54	42.51	43.34	49.25	53.67	52.91	54.24	59.73	53.21	44.77	39.64	44.21	47.85
<b>New Hampshire</b>	37.69	35.95	33.94	36.03	35.36	36.30	38.41	39.53	42.67	42.28	47.60	51.74	42.52	45.52	42.51	43.28	49.41	53.07	52.61	53.20	58.86	51.81	43.94	39.32	43.90	47.53
<b>Maine</b>	36.73	34.97	33.00	35.06	34.45	35.58	38.12	39.10	41.77	41.36	46.22	50.26	41.67	44.37	41.46	42.21	48.00	51.50	51.03	51.36	56.07	49.08	41.80	38.42	42.65	46.08
<b>Mass Hub</b>	38.14	36.24	34.21	36.31	35.58	36.44	38.43	39.63	42.88	42.41	47.87	52.13	42.63	45.73	42.73	43.52	50.50	53.56	53.13	53.67	59.67	52.66	44.57	39.73	44.27	47.96
<b>DA Forecast Load (GW)</b>	11.04	10.54	10.29	10.23	10.50	11.53	13.60	14.95	15.31	15.49	15.67	15.76	15.68	15.66	15.48	15.38	15.48	15.72	15.86	16.30	16.08	15.06	13.58	12.23		
<b>Forecast Error %</b>	7.5%	7.5%	8.5%	8.5%	8.1%	6.4%	-0.2%	-1.4%	-0.7%	-0.3%	-0.3%	-0.8%	-0.7%	-1.1%	-1.1%	-0.5%	0.0%	-0.3%	-0.7%	-1.0%	0.1%	0.5%	1.9%	4.0%		

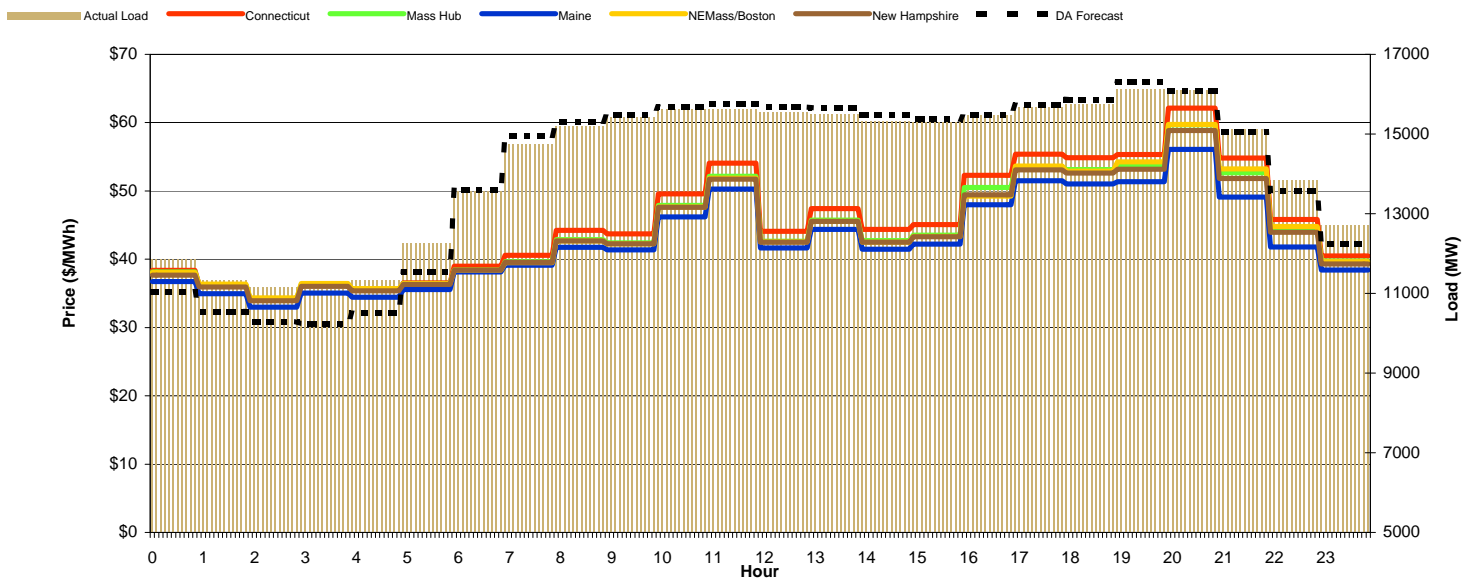




# ISO-NE Daily Report

Wednesday April 06, 2011

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	38.86	38.39	37.74	36.22	38.05	39.62	48.48	51.49	49.01	48.55	49.24	45.68	45.74	45.64	42.35	41.46	41.80	41.25	42.72	54.06	54.21	44.72	42.23	39.71	44.05	46.26	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	37.99	37.88	37.59	36.06	37.81	38.96	46.99	49.38	47.01	46.59	47.15	43.80	43.83	43.75	40.65	39.83	40.20	39.82	41.15	51.82	51.87	43.07	41.08	39.10	42.64	44.44		
<b>New Hampshire</b>	38.05	37.88	37.55	36.07	37.84	39.04	47.37	49.71	47.42	46.96	47.50	44.13	44.09	43.98	40.94	40.08	40.43	39.96	41.39	51.90	51.78	43.20	41.36	39.33	42.83	44.68		
<b>Maine</b>	37.44	37.20	36.99	35.54	37.22	38.75	47.36	48.60	46.36	45.83	46.19	42.94	42.81	42.69	39.92	39.01	39.43	39.09	40.55	50.51	50.00	42.15	40.81	39.73	41.96	43.56		
<b>Mass Hub</b>	38.25	38.13	37.76	36.26	37.97	39.21	47.46	49.76	47.28	46.84	47.41	43.99	44.05	43.96	40.83	40.00	40.37	39.91	41.22	52.09	52.16	43.25	41.17	39.22	42.86	44.64		
<b>Cleared Load (GW)</b>	10.9	10.7	10.4	10.4	10.5	11.2	13.2	13.9	14.1	14.1	14.2	14.0	14.0	13.8	13.6	13.6	13.6	13.8	14.0	14.5	14.4	13.3	11.8	10.9				

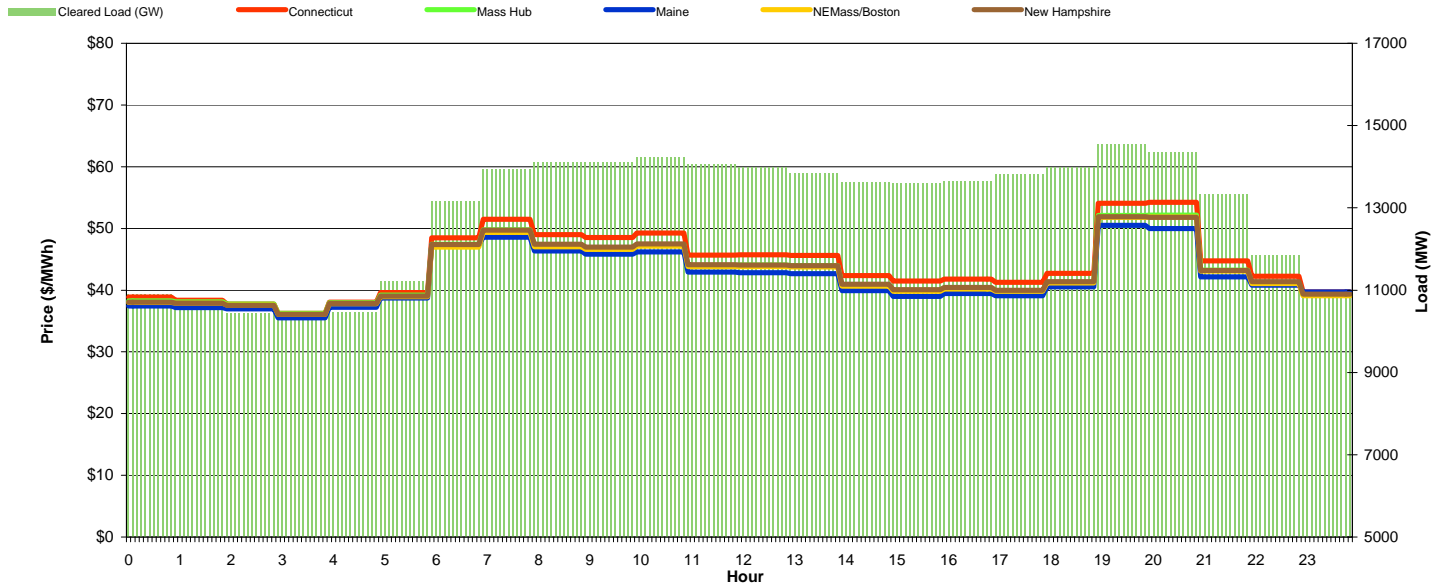

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	37.37	36.63	36.62	37.83	37.47	43.97	49.77	59.83	55.24	58.12	53.90	54.69	51.01	46.02	44.16	42.10	44.75	49.20	54.99	73.17	59.72	51.40	38.58	39.26	48.16	52.31	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	36.78	36.27	36.59	37.80	37.15	43.27	48.40	57.98	53.37	55.52	51.58	52.20	48.85	44.16	42.40	40.53	43.05	47.74	53.55	71.02	57.42	49.00	37.17	38.37	46.67	50.35		
<b>New Hampshire</b>	36.42	35.93	36.21	37.42	36.83	42.96	48.08	56.91	52.71	55.17	51.33	51.91	48.70	44.06	42.25	40.38	42.89	47.07	52.52	69.64	56.94	48.57	36.99	38.05	46.25	49.88		
<b>Maine</b>	35.72	35.12	35.41	36.66	36.12	42.58	47.90	55.53	50.97	53.12	49.55	49.85	46.91	42.70	40.93	39.19	41.57	45.46	50.73	66.90	54.80	46.51	35.73	37.11	44.88	48.15		
<b>Mass Hub</b>	36.80	36.29	36.55	37.75	37.19	43.30	48.38	57.55	53.22	55.92	51.93	52.62	49.19	44.41	42.64	40.74	43.27	47.56	53.11	70.52	57.60	49.37	37.36	38.46	46.74	50.44		
<b>DA Forecast Load (GW)</b>	11.41	11.02	10.84	10.84	11.19	12.33	14.30	15.41	15.57	15.61	15.55	15.40	15.26	15.14	14.98	14.79	14.83	15.04	15.33	16.10	15.88	15.01	13.55	12.17				
<b>Forecast Error %</b>	2.7%	4.1%	4.5%	4.5%	3.1%	0.5%	-0.9%	-0.6%	-0.5%	-0.6%	-0.4%	-0.2%	-0.7%	-0.7%	-1.1%	-0.8%	-0.3%	0.2%	0.1%	-0.6%	0.6%	0.1%	0.2%	1.9%				

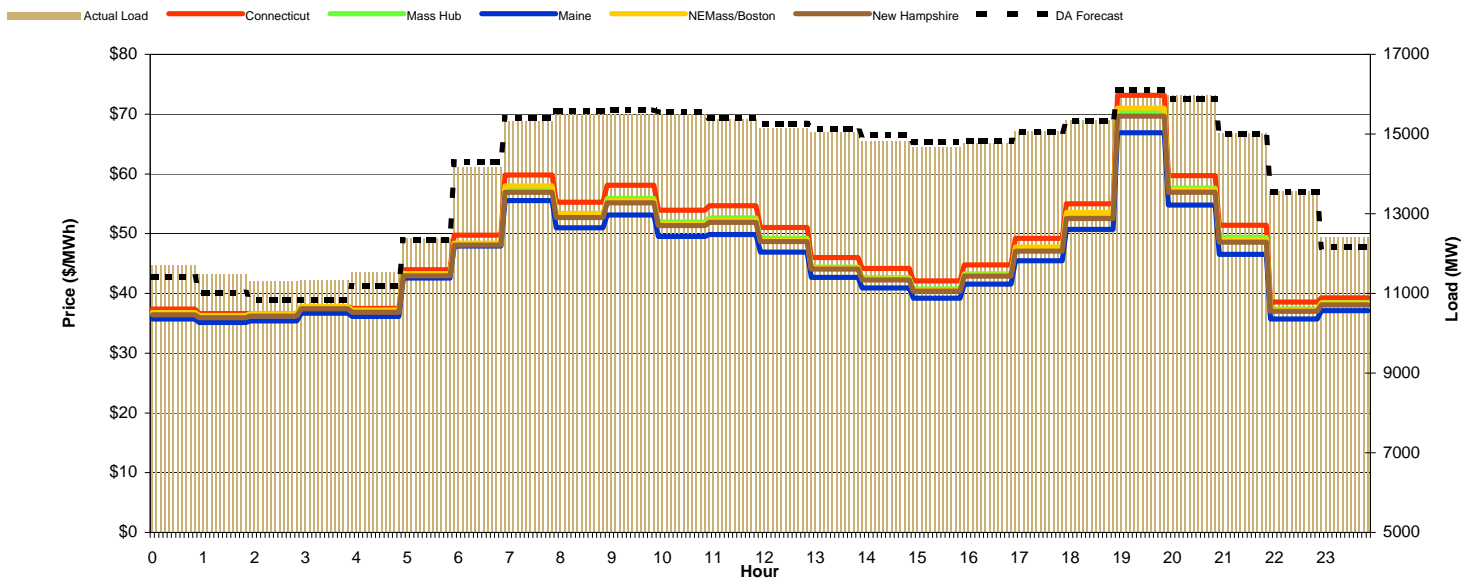




# ISO-NE Daily Report

Thursday April 07, 2011

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	40.00	39.52	38.68	38.22	38.70	40.22	46.23	57.91	51.68	52.55	52.24	52.00	49.00	47.55	46.33	46.17	45.63	46.47	47.59	61.25	60.40	46.16	43.86	40.14	47.02	50.42	All	On Pk
<b>NEMass/Boston</b>	39.33	38.83	38.00	37.86	38.06	39.64	44.46	55.58	49.73	50.20	49.86	49.48	46.59	45.45	44.27	44.20	43.79	44.39	45.42	58.47	57.95	44.25	42.40	39.46	45.32	48.25	48.06	51.80
<b>New Hampshire</b>	39.21	38.79	37.96	37.78	38.05	39.75	44.97	56.29	50.17	50.72	50.33	49.91	47.02	45.82	44.61	44.47	44.00	44.62	45.77	59.05	57.84	44.44	42.31	39.41	45.55	48.59	46.15	49.42
<b>Maine</b>	38.80	38.35	37.49	37.32	37.54	39.70	45.33	56.13	49.91	50.44	49.74	49.10	46.07	45.00	43.87	43.67	43.28	44.01	45.33	57.90	56.81	43.93	41.55	39.61	45.04	47.92	45.47	48.67
<b>Mass Hub</b>	39.44	39.00	38.21	37.95	38.20	39.68	44.91	56.00	49.96	50.57	50.23	49.91	47.00	45.83	44.63	44.53	44.03	44.66	45.73	58.78	58.20	44.53	42.66	39.52	45.59	48.58	46.42	49.68
<b>Cleared Load (GW)</b>	10.3	10.4	10.1	9.9	10.2	10.8	13.1	14.1	14.3	14.3	14.3	14.2	14.2	14.1	13.8	13.7	13.7	13.7	14.1	14.4	14.5	13.7	12.2	10.9				

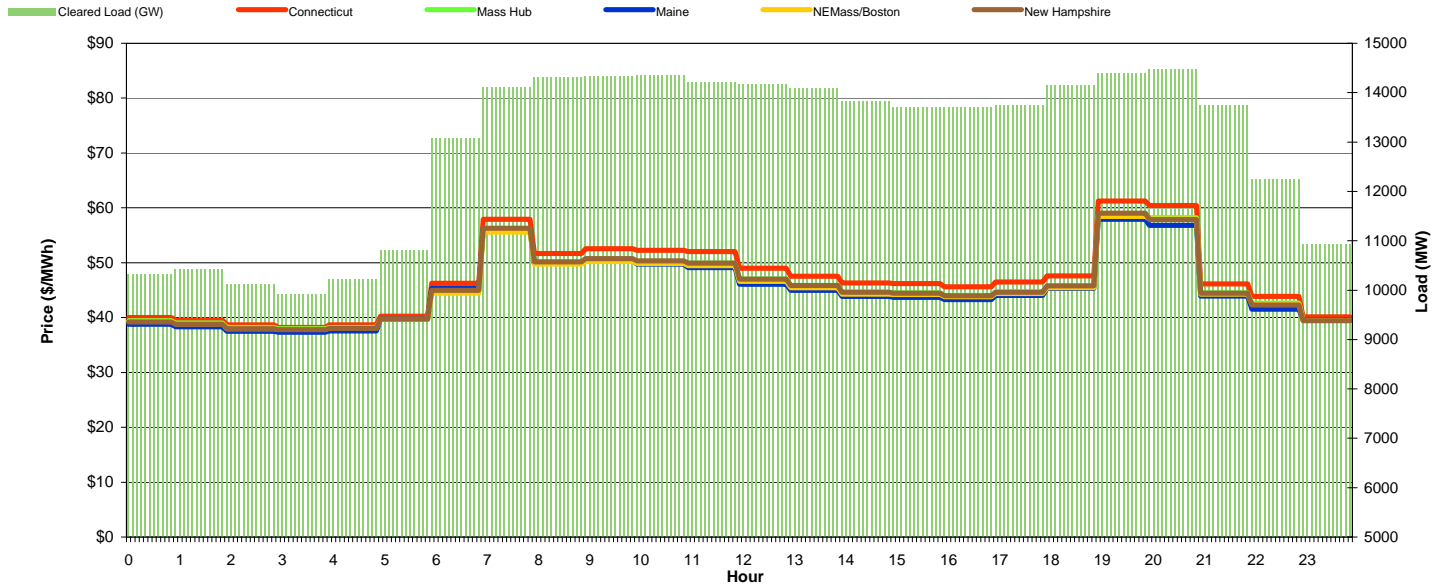

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	41.54	36.84	37.73	38.49	38.66	41.09	50.63	63.11	57.16	61.80	59.47	55.40	56.80	47.94	45.63	42.71	40.13	45.12	42.75	76.95	50.26	45.23	38.28	39.70	48.06	51.80	All	On Pk
<b>NEMass/Boston</b>	40.75	36.22	37.19	38.23	38.13	40.33	48.85	61.14	55.01	58.69	56.39	52.43	53.58	45.50	43.38	40.71	38.43	43.09	40.90	73.46	48.17	43.03	36.78	38.82	46.22	49.42	46.22	49.42
<b>New Hampshire</b>	40.46	35.91	36.88	37.91	37.89	40.20	49.03	61.00	54.95	58.84	56.48	52.50	53.63	45.51	43.37	40.69	38.37	43.05	40.94	73.54	48.20	43.03	36.68	38.57	46.15	49.42	46.15	49.42
<b>Maine</b>	39.59	35.20	36.15	37.25	37.23	39.98	48.96	61.48	54.65	57.93	55.32	51.37	52.35	44.55	42.42	39.83	37.63	42.20	40.32	72.60	47.50	42.29	36.20	38.28	45.47	48.67	45.47	48.67
<b>Mass Hub</b>	40.83	36.27	37.23	38.21	38.17	40.42	49.14	60.93	54.99	59.10	56.81	52.86	54.11	45.87	43.71	40.99	38.65	43.36	41.12	73.77	48.31	43.29	37.00	38.84	46.42	49.68	46.42	49.68
<b>DA Forecast Load (GW)</b>	11.26	10.84	10.65	10.66	11.01	12.14	14.09	15.20	15.42	15.42	15.39	15.28	15.10	14.96	14.75	14.55	14.53	14.69	14.84	15.90	15.76	14.76	13.31	11.96				
<b>Forecast Error %</b>	3.7%	3.7%	3.9%	3.6%	3.0%	1.6%	-0.2%	0.6%	0.5%	0.5%	0.8%	0.6%	0.4%	0.1%	-0.4%	-0.8%	-1.3%	-1.8%	-1.9%	-3.6%	-0.6%	0.3%	0.8%	1.0%				

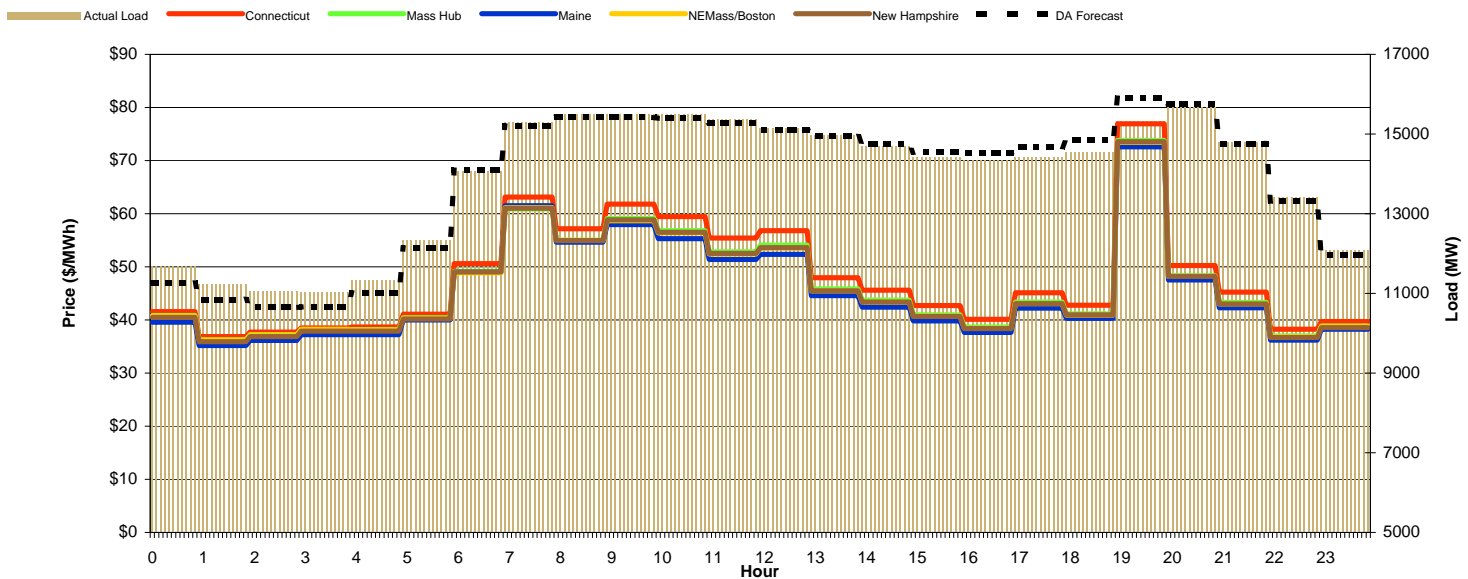




# ISO-NE Daily Report

Friday April 08, 2011

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	39.19	38.47	37.58	36.59	38.17	39.02	42.22	59.40	53.38	46.08	49.31	46.04	44.87	44.97	42.32	41.56	41.25	41.68	42.85	53.40	52.67	44.83	40.00	39.04	43.95	46.54	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	38.24	38.08	37.21	36.29	37.76	38.28	40.91	57.22	51.41	44.30	47.22	44.07	42.95	42.96	40.67	39.88	39.55	39.90	41.02	50.85	50.12	42.87	38.72	38.18	42.44	44.61	42.44	44.61
<b>New Hampshire</b>	38.28	37.97	37.09	36.21	37.71	38.38	41.24	57.32	51.84	44.80	47.73	44.55	43.34	43.34	40.94	40.15	39.81	40.11	41.25	51.15	50.35	43.11	38.79	38.31	42.66	44.91	42.66	44.91
<b>Maine</b>	37.72	37.40	36.46	35.62	37.14	38.19	41.48	57.00	51.61	44.68	47.36	44.28	42.96	42.78	40.31	39.67	39.15	39.50	40.56	50.20	49.36	42.46	38.41	38.00	42.18	44.39	42.18	44.39
<b>Mass Hub</b>	38.56	38.20	37.35	36.45	37.93	38.55	41.24	57.40	51.68	44.55	47.52	44.28	43.23	43.29	40.93	40.10	39.84	40.17	41.32	51.35	50.67	43.27	38.96	38.36	42.72	44.91	42.72	44.91
<b>Cleared Load (GW)</b>	10.6	10.5	10.3	10.4	10.4	11.4	13.1	14.0	14.4	14.5	14.4	14.1	14.0	13.9	13.5	13.3	13.4	13.5	13.8	14.4	14.4	13.5	12.4	10.9				

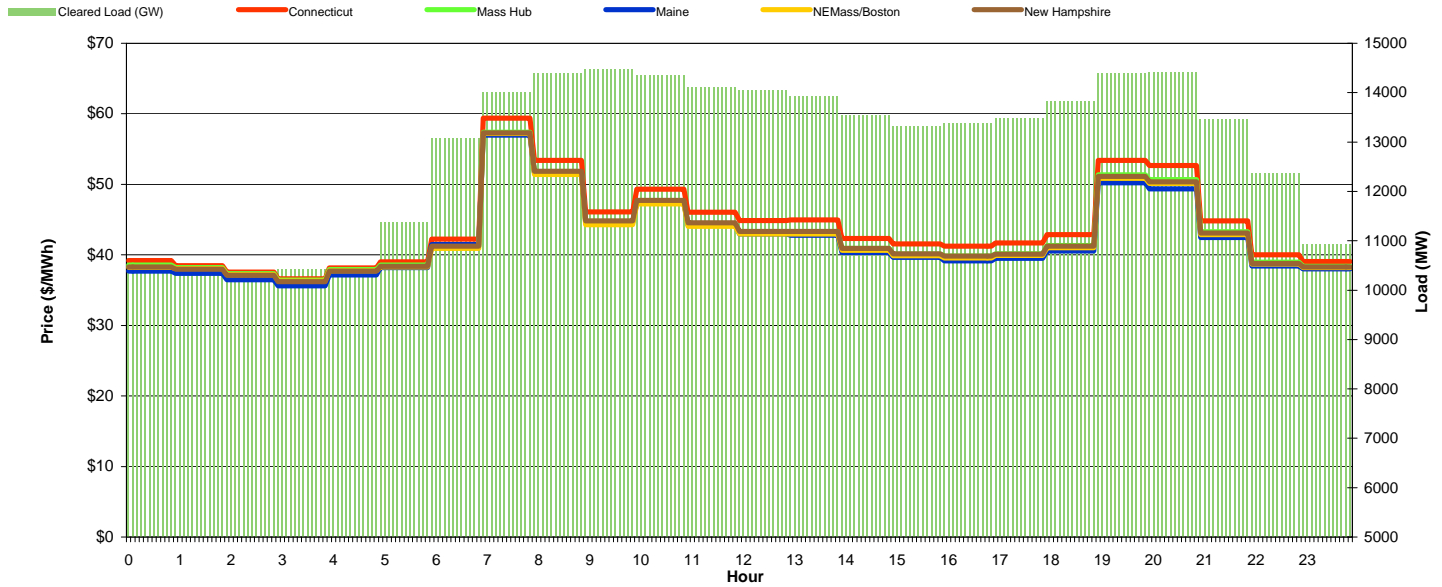

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$				
<b>Connecticut</b>	39.34	41.96	40.36	39.79	39.43	42.54	46.22	57.44	57.97	54.51	53.69	51.65	46.30	48.91	46.56	46.61	46.19	44.75	43.33	56.18	47.09	43.57	36.09	46.49	46.49	46.54	48.80	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	38.51	41.26	39.87	39.39	38.95	41.59	44.65	55.02	55.68	52.31	51.39	49.51	44.33	46.44	44.10	43.97	43.60	42.35	41.10	53.42	44.69	41.36	34.59	45.09	44.72	46.49	44.72	46.49	
<b>New Hampshire</b>	38.38	41.05	39.71	39.31	38.87	41.73	45.00	55.46	55.99	52.58	51.62	49.46	44.39	46.57	44.19	44.05	43.67	42.40	41.13	53.44	44.78	41.47	34.52	44.84	44.78	46.61	44.78	46.61	
<b>Maine</b>	37.86	40.44	39.50	39.33	39.02	42.13	45.73	56.30	56.43	52.57	51.18	48.89	43.89	45.74	43.24	43.04	42.63	41.47	40.24	52.36	43.99	40.87	34.05	43.99	44.37	46.06	44.37	46.06	
<b>Mass Hub</b>	38.58	41.33	39.87	39.40	38.96	41.73	44.84	55.28	55.85	52.52	51.64	49.55	44.49	46.82	44.47	44.41	44.03	42.74	41.43	53.80	45.05	41.69	34.83	45.17	44.94	46.79	44.94	46.79	
<b>DA Forecast Load (GW)</b>	11.20	10.78	10.63	10.59	10.93	11.99	13.93	15.14	15.36	15.48	15.50	15.36	15.17	15.01	14.76	14.53	14.48	14.46	14.50	14.96	15.00	14.16	13.04	11.86					
<b>Forecast Error %</b>	2.2%	5.5%	5.3%	7.7%	5.6%	5.8%	0.8%	-0.2%	-0.4%	-1.4%	-1.5%	-1.6%	-1.9%	-1.6%	-1.3%	-1.0%	-0.7%	-0.3%	-0.1%	0.7%	0.7%	1.9%	1.8%	1.7%					

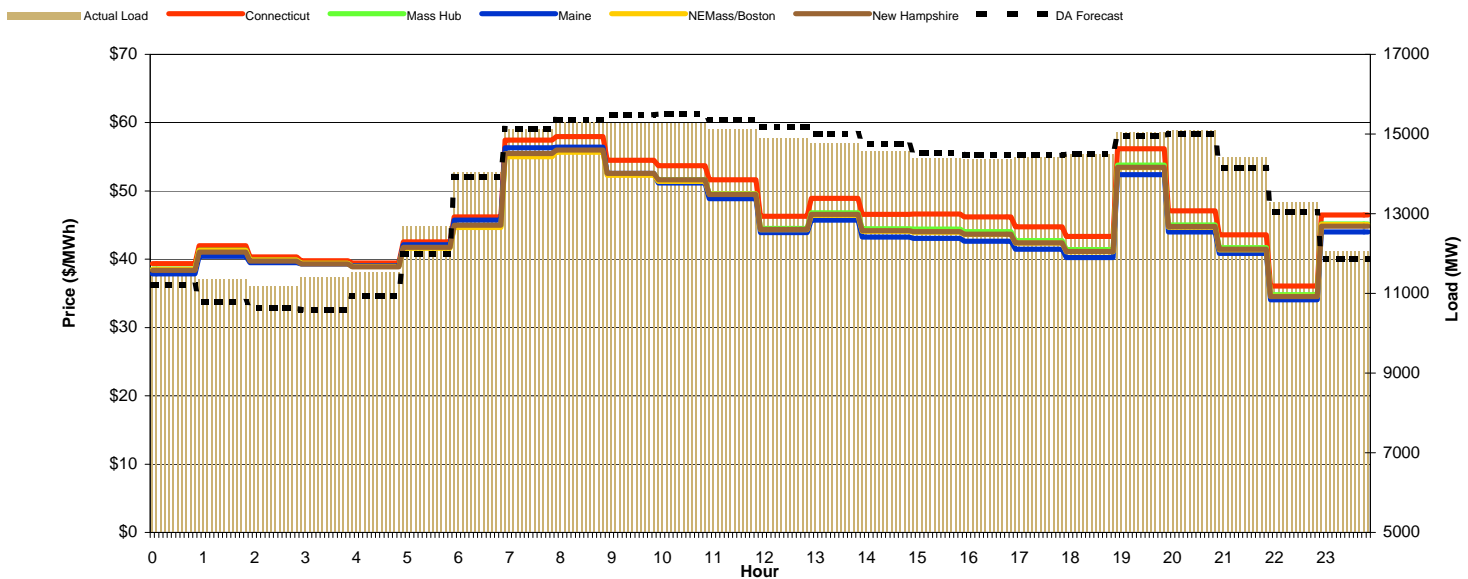






# ISO-NE Daily Report

Saturday April 09, 2011

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$	
<b>Connecticut</b>	38.64	36.41	35.22	35.06	35.14	35.96	39.53	39.97	42.87	51.04	63.59	55.15	54.00	48.00	40.90	40.96	40.66	40.10	40.45	44.58	54.05	41.99	39.18	38.00	All	On Pk
<b>NEMass/Boston</b>	38.09	35.97	35.07	34.98	35.06	35.57	38.02	38.22	40.49	47.85	50.15	47.46	42.12	40.33	38.66	38.63	38.63	38.50	38.82	42.63	51.32	40.06	38.10	37.13	40.08	42.00
<b>New Hampshire</b>	38.00	35.84	34.83	34.73	34.83	35.27	38.10	38.33	40.81	48.21	50.38	47.69	42.27	40.54	38.84	38.85	38.75	38.54	38.92	42.85	51.46	40.13	37.96	36.81	40.12	42.16
<b>Maine</b>	37.36	35.17	34.12	34.00	34.12	34.47	37.36	37.73	40.21	47.15	49.00	46.56	41.43	40.10	38.38	38.35	38.05	37.99	38.49	42.17	50.03	39.63	37.43	36.03	39.39	41.42
<b>Mass Hub</b>	38.31	36.16	35.17	35.05	35.15	35.75	38.43	38.53	41.07	48.76	51.12	48.33	42.81	40.92	39.15	39.23	39.12	38.85	39.20	43.13	52.12	40.54	38.30	37.43	40.53	42.57
<b>Cleared Load (GW)</b>	10.4	10.0	9.8	9.7	9.7	10.1	10.3	11.2	12.2	12.9	12.9	12.8	12.7	12.1	11.8	11.8	11.9	12.1	12.6	13.2	13.2	12.4	11.2	10.1		

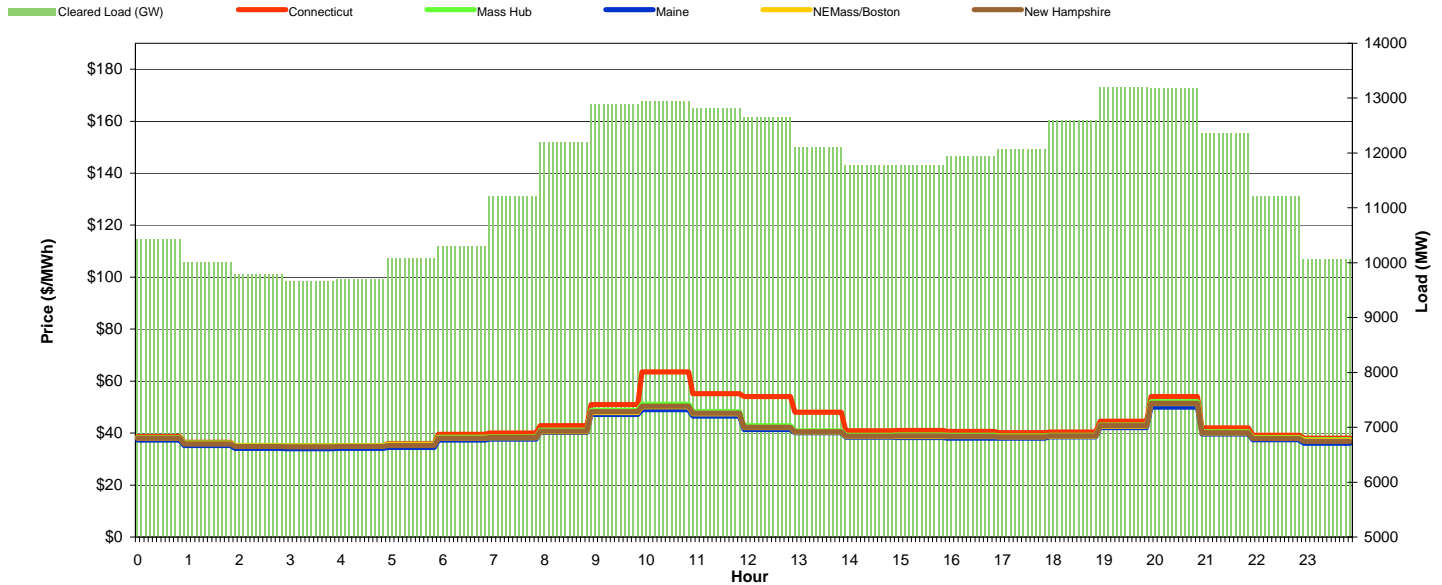

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$	
<b>Connecticut</b>	48.30	50.76	46.22	40.96	39.44	40.50	45.61	46.45	74.93	182.06	183.52	177.81	72.70	39.98	37.47	37.32	36.78	37.05	35.74	40.74	51.25	38.02	37.32	49.07	All	On Pk
<b>NEMass/Boston</b>	47.54	50.16	45.76	40.51	39.05	39.77	44.13	44.79	38.05	38.95	39.15	38.95	37.07	37.75	35.40	35.17	34.81	34.92	34.39	39.34	48.66	36.28	36.06	47.93	40.19	38.11
<b>New Hampshire</b>	47.18	49.69	45.42	40.22	38.78	39.58	44.11	44.73	38.26	39.34	39.40	39.03	37.04	37.85	35.45	35.20	34.84	35.00	34.34	39.29	48.58	36.21	35.85	47.27	40.11	38.15
<b>Maine</b>	46.25	48.55	44.68	39.76	38.54	39.38	43.94	44.10	37.86	38.26	37.65	37.15	35.82	37.26	34.85	34.54	34.14	34.39	33.84	38.65	47.32	35.50	35.14	45.72	39.30	37.28
<b>Mass Hub</b>	47.42	50.08	45.70	40.47	39.01	39.87	44.44	45.13	38.59	39.88	40.11	39.84	37.59	38.24	35.83	35.64	35.23	35.38	34.63	39.56	49.23	36.64	36.31	48.03	40.54	38.61
<b>DA Forecast Load (GW)</b>	11.07	10.57	10.30	10.22	10.32	10.74	11.36	12.28	13.21	13.81	13.95	13.81	13.56	13.25	12.98	12.83	12.91	13.11	13.33	13.76	14.10	13.41	12.46	11.42		
<b>Forecast Error %</b>	2.6%	5.3%	7.1%	7.2%	7.0%	6.8%	3.0%	2.4%	1.3%	0.0%	-0.4%	-0.7%	-1.0%	-1.2%	-1.4%	-0.5%	0.0%	-0.3%	-2.4%	-1.1%	-1.4%	-0.6%	-0.5%	-0.1%		

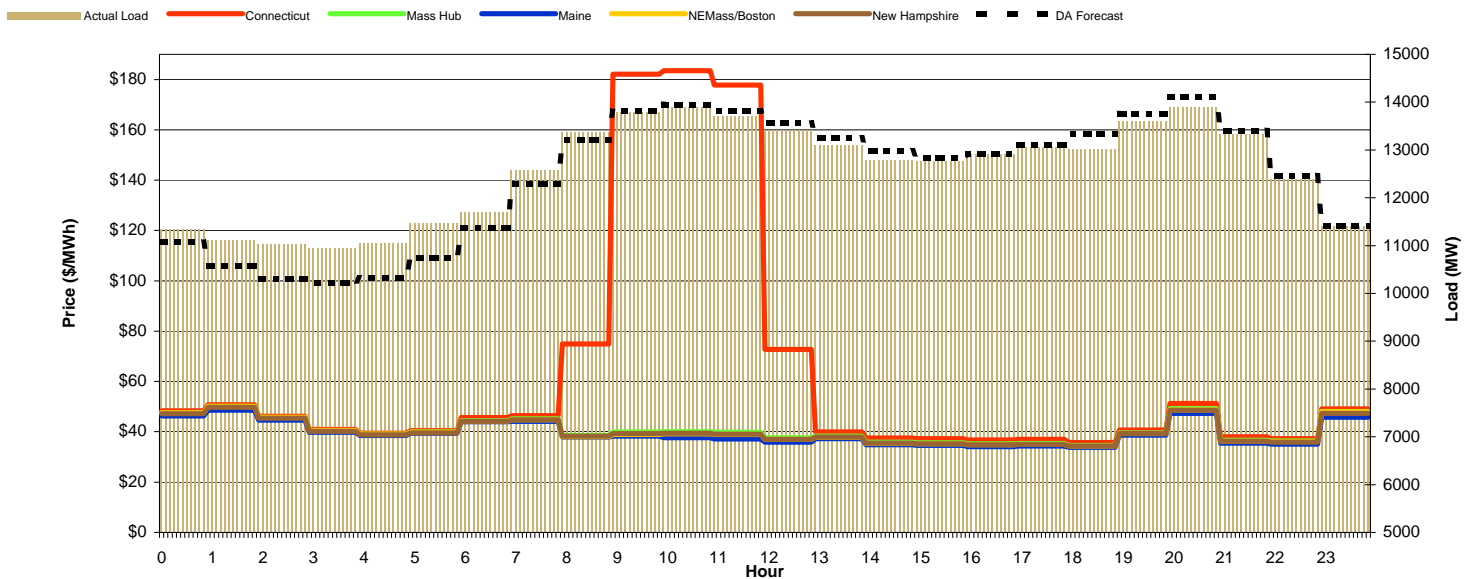




# ISO-NE Daily Report

Sunday April 10, 2011

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
	All	On Pk																										
Connecticut	37.03	36.01	34.78	34.51	34.42	34.98	37.53	38.54	39.62	43.74	45.30	46.35	46.92	46.45	45.81	40.18	41.47	43.06	42.61	53.57	52.82	42.00	39.23	38.50	41.48	44.23		
NEMass/Boston	36.45	35.69	34.46	34.34	34.26	34.61	36.99	37.98	38.60	42.16	43.62	44.65	45.26	44.76	44.07	38.57	39.65	41.11	40.56	50.79	50.04	40.08	38.11	37.87	40.20	42.50		
New Hampshire	36.03	35.13	33.93	33.82	33.75	34.14	36.47	37.57	38.51	42.21	43.70	44.65	45.19	44.75	44.04	38.65	39.88	41.33	40.73	51.01	50.13	40.10	37.80	37.39	40.04	42.52		
Maine	35.21	34.28	33.06	32.94	32.93	33.36	35.83	37.01	37.95	41.44	43.00	43.62	44.00	43.56	42.84	38.18	39.44	40.75	39.93	49.81	48.75	39.63	37.24	36.78	39.23	41.70		
Mass Hub	36.75	35.89	34.67	34.51	34.40	34.81	37.09	37.97	38.79	42.51	43.97	45.01	45.66	45.18	44.57	38.96	40.13	41.55	40.95	51.41	50.63	40.47	38.24	37.98	40.50	42.88		
Cleared Load (GW)	9.9	9.7	9.4	9.5	9.6	9.6	9.3	10.0	10.9	11.6	11.9	12.0	12.0	11.9	11.8	11.9	12.1	12.4	12.5	13.2	13.2	12.3	11.0	9.9				

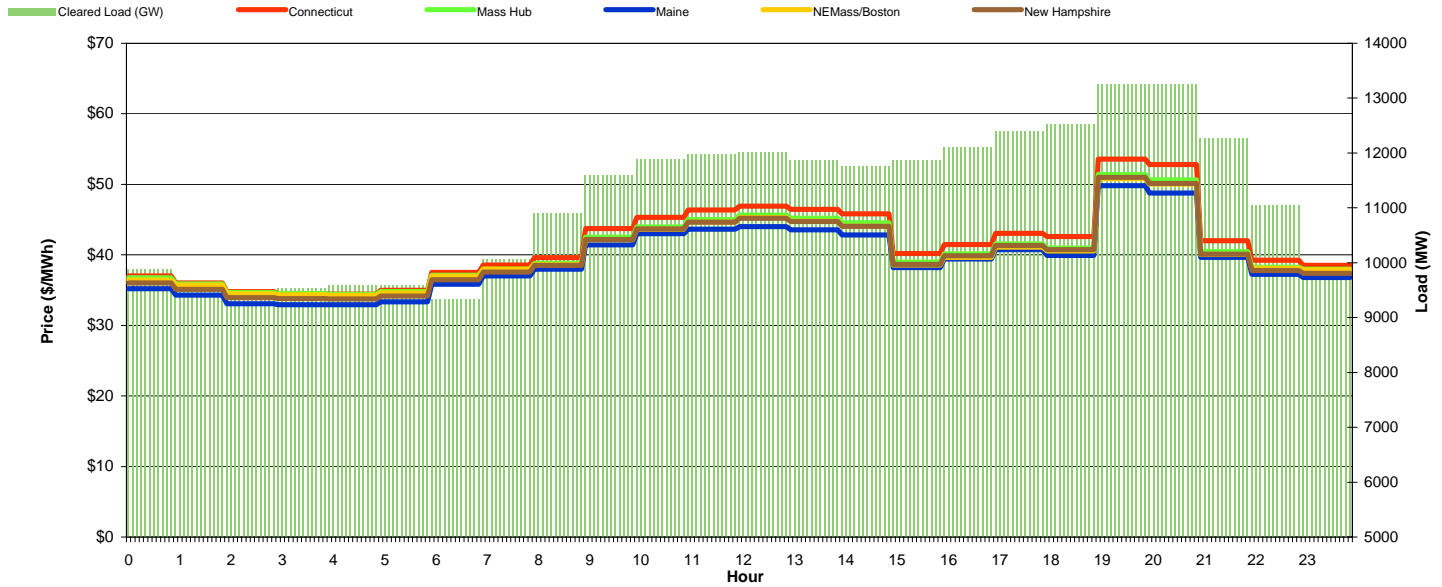

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
	All	On Pk																										
Connecticut	39.93	37.34	35.69	37.25	39.43	42.35	39.98	41.85	38.56	44.03	41.38	44.62	44.50	41.51	39.74	40.57	44.04	49.17	55.98	58.17	46.27	36.34	34.99	33.92	41.98	43.86		
NEMass/Boston	39.46	37.01	35.44	37.08	39.16	42.12	39.70	41.53	38.07	43.26	40.48	43.35	43.09	40.32	38.74	39.58	42.75	47.59	54.38	56.81	45.21	34.97	34.15	33.66	41.16	42.77		
New Hampshire	38.81	36.43	34.88	36.55	38.64	41.57	39.20	41.24	37.94	43.12	40.31	43.18	42.89	40.12	38.49	39.40	42.61	47.45	54.18	56.48	44.95	34.80	33.74	33.09	40.84	42.56		
Maine	38.15	35.96	34.49	36.22	38.33	41.34	39.23	41.41	37.84	42.78	39.65	42.16	41.60	38.90	37.40	38.53	41.46	46.08	52.77	54.68	43.63	33.97	32.89	32.22	40.07	41.61		
Mass Hub	39.40	37.02	35.47	37.12	39.22	42.14	39.62	41.46	38.09	43.34	40.63	43.64	43.44	40.60	38.97	39.81	43.08	48.00	54.81	57.08	45.30	35.22	34.25	33.60	41.30	42.98		
DA Forecast Load (GW)	10.62	10.11	9.85	9.73	9.78	10.10	10.42	11.14	12.05	12.71	13.04	13.16	13.18	13.04	12.89	12.81	13.03	13.46	13.80	14.26	14.33	13.44	12.23	11.10				
Forecast Error %	2.3%	7.1%	8.5%	11.3%	11.2%	8.5%	2.8%	3.8%	1.5%	1.0%	0.3%	0.1%	-0.3%	-0.8%	-1.1%	-0.8%	-1.2%	-1.4%	-0.3%	1.8%	0.9%	0.2%	0.8%	4.0%				

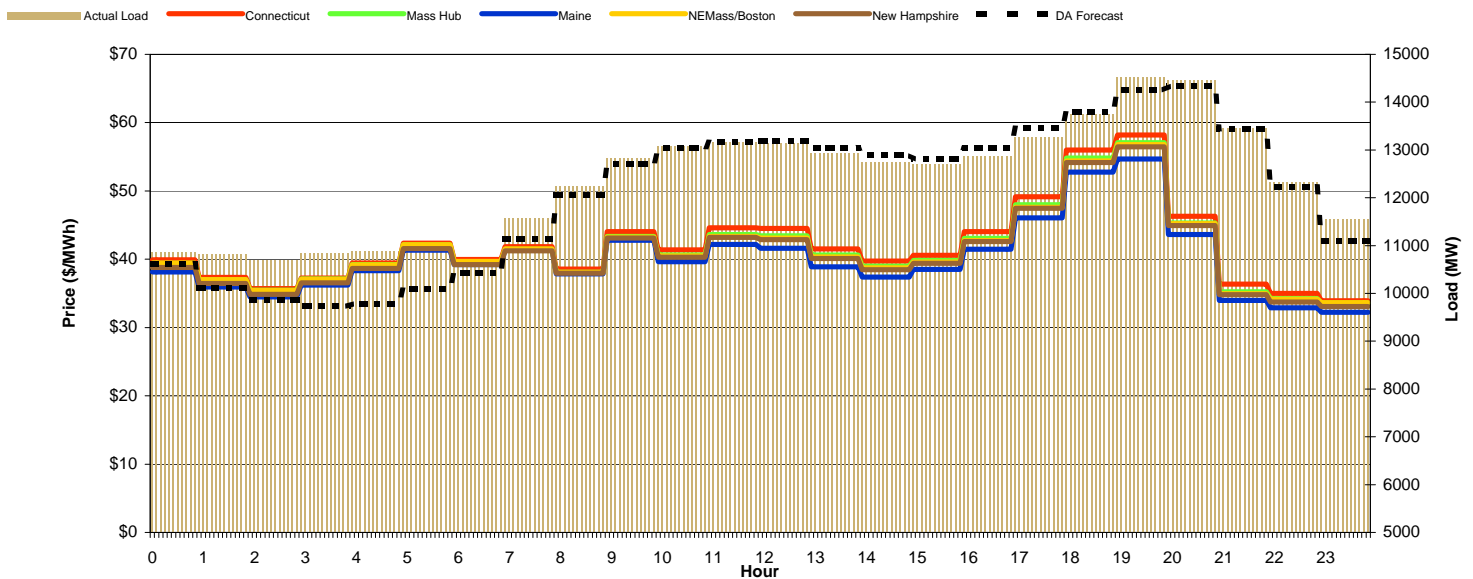




# ISO-NE Daily Report

Monday April 11, 2011

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$	
<b>Connecticut</b>	34.36	31.79	30.00	29.70	29.75	34.79	39.97	53.63	55.59	56.87	58.88	59.79	58.79	63.96	63.00	62.52	61.53	62.57	58.46	71.15	65.00	49.47	40.26	39.04	50.45	58.84
<b>NEMass/Boston</b>	34.17	31.80	29.96	29.74	29.75	34.65	38.99	51.25	53.10	54.34	56.27	57.22	56.23	61.24	60.36	59.93	58.85	59.76	55.58	67.83	61.96	46.84	38.55	38.25	48.61	56.21
<b>New Hampshire</b>	33.94	31.64	29.80	29.56	29.65	34.52	39.05	51.48	53.27	54.51	56.46	57.33	56.37	61.34	60.47	60.09	59.11	59.93	55.81	68.03	61.94	47.11	38.45	38.07	48.66	56.36
<b>Maine</b>	33.52	31.23	29.34	29.13	29.29	34.26	39.09	51.26	53.00	54.05	56.00	56.85	55.96	60.56	59.48	59.00	58.00	59.17	54.92	67.10	61.06	46.18	37.69	37.52	48.07	55.64
<b>Mass Hub</b>	34.17	31.82	30.00	29.74	29.78	34.67	39.17	51.76	53.59	54.83	56.79	57.70	56.71	61.73	60.85	60.48	59.38	60.32	56.19	68.46	62.50	47.46	38.86	38.39	48.97	56.73
<b>Cleared Load (GW)</b>	9.8	9.9	9.6	9.6	9.8	10.2	12.1	13.3	13.6	13.9	14.2	14.2	14.2	14.1	14.1	14.1	14.2	14.2	14.1	14.5	14.4	13.2	12.0	10.4		

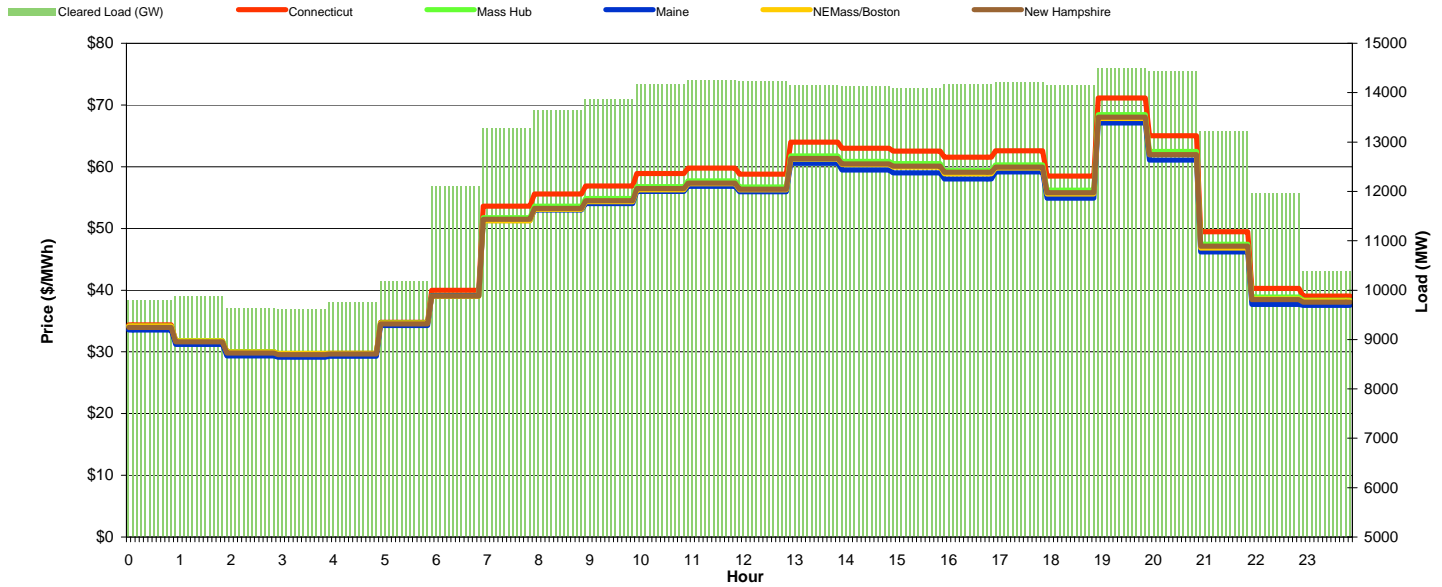

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$	
<b>Connecticut</b>	31.97	27.00	28.20	29.83	31.11	32.10	41.73	43.21	47.92	46.83	48.98	46.74	45.49	43.83	48.80	46.57	45.48	41.60	37.63	46.02	46.14	38.75	32.55	35.09	40.15	44.16
<b>NEMass/Boston</b>	31.86	27.04	28.21	29.81	31.03	32.10	40.97	41.79	46.03	45.02	47.12	44.98	43.70	42.26	47.55	45.48	44.22	40.11	36.30	44.59	44.46	37.17	31.42	34.41	39.07	42.64
<b>New Hampshire</b>	31.48	26.73	27.81	29.49	30.81	31.92	40.87	41.85	46.16	45.14	47.21	45.00	43.67	42.23	47.36	45.25	44.03	40.01	36.25	44.50	44.33	37.09	31.26	34.03	38.94	42.58
<b>Maine</b>	30.83	26.26	27.25	29.02	30.34	31.58	40.69	41.57	45.70	44.63	46.62	44.15	42.82	41.60	46.53	44.47	42.96	38.95	35.40	43.41	43.06	35.93	30.41	33.04	38.22	41.76
<b>Mass Hub</b>	31.75	26.93	28.10	29.72	30.97	31.97	40.94	41.95	46.31	45.26	47.27	45.10	43.87	42.40	47.52	45.38	44.24	40.25	36.43	44.63	44.58	37.41	31.59	34.43	39.13	42.76
<b>DA Forecast Load (GW)</b>	10.33	9.91	9.70	9.71	10.03	11.06	12.98	14.45	14.86	15.20	15.43	15.54	15.52	15.51	15.39	15.29	15.40	15.58	15.60	15.95	15.81	14.69	13.14	11.69		
<b>Forecast Error %</b>	2.8%	6.2%	6.6%	6.1%	5.6%	2.8%	-0.3%	-0.7%	-0.1%	-0.6%	-0.6%	-1.0%	-1.8%	-2.2%	-2.8%	-3.3%	-4.1%	-5.0%	-5.0%	-3.4%	-1.9%	-1.8%	-0.5%	1.4%		

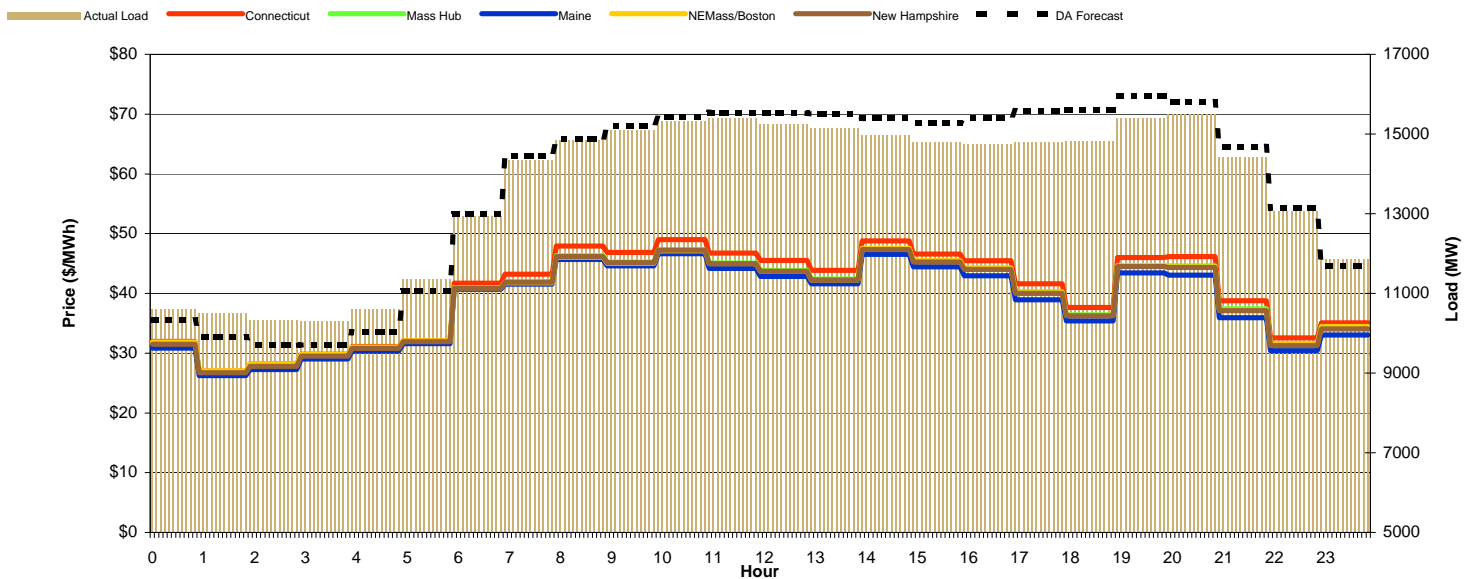




# ISO-NE Daily Report

Tuesday April 12, 2011

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	31.18	29.79	29.46	28.08	29.51	31.82	37.01	35.61	39.40	40.22	43.41	44.25	41.03	40.03	39.94	39.75	39.36	39.65	39.61	48.00	51.02	39.21	36.94	34.97	37.89	41.09	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	31.15	29.86	29.55	28.25	29.63	31.75	36.64	34.80	38.40	39.17	42.18	42.80	39.74	38.81	38.78	38.63	38.40	38.65	38.56	46.64	49.08	38.21	36.13	34.58	37.10	39.94		
<b>New Hampshire</b>	30.95	29.63	29.29	27.97	29.40	31.70	36.84	35.00	38.62	39.44	42.48	43.14	40.06	39.13	39.06	38.92	38.64	38.98	38.83	47.07	49.40	38.51	36.22	34.69	37.25	40.22		
<b>Maine</b>	30.20	28.90	28.60	27.37	28.79	31.11	36.68	34.92	38.61	39.45	42.27	42.85	39.94	39.13	39.03	38.70	38.45	38.78	38.68	46.71	48.62	38.35	35.67	34.29	36.92	40.01		
<b>Mass Hub</b>	31.24	29.93	29.58	28.21	29.60	31.82	36.82	35.05	38.63	39.38	42.46	43.15	40.05	39.10	39.06	38.93	38.63	38.89	38.81	46.94	49.45	38.49	36.38	34.78	37.31	40.21		
<b>Cleared Load (GW)</b>	10.4	10.1	9.9	9.7	10.0	10.6	12.1	13.8	14.1	14.4	14.8	14.6	14.5	14.4	14.3	14.2	14.2	14.4	14.3	15.0	14.6	13.6	12.2	11.0				

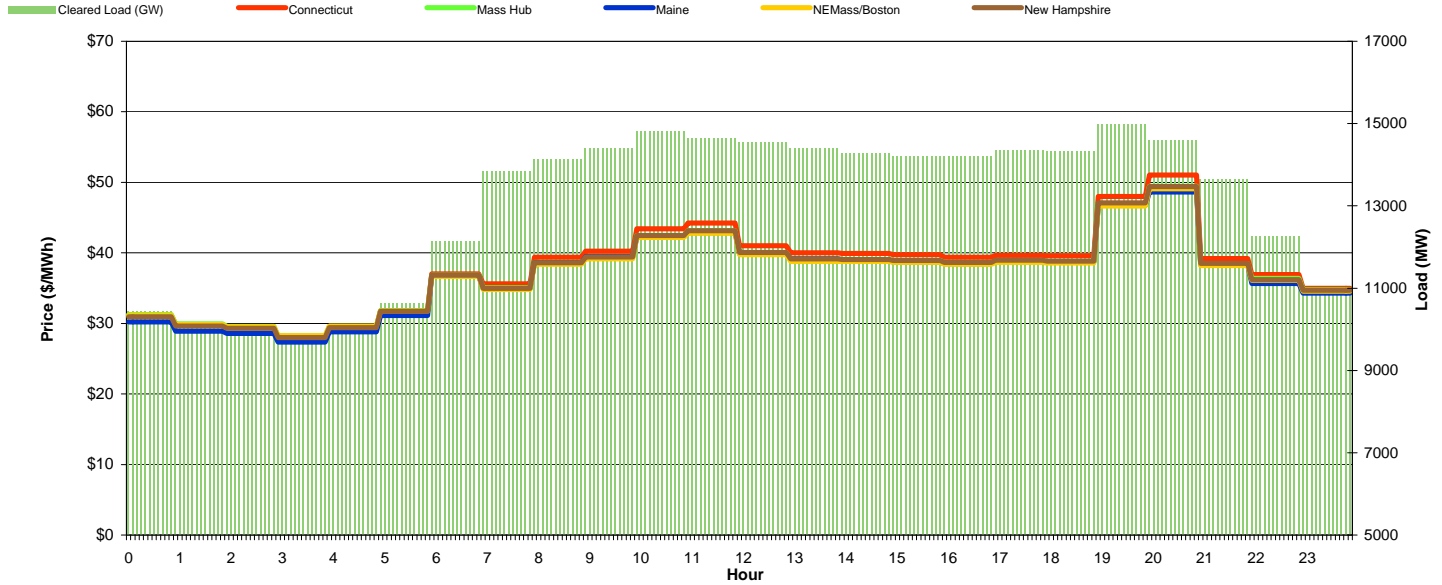

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	33.17	28.66	29.31	30.55	34.43	44.42	53.78	50.94	46.39	46.15	50.72	46.15	43.13	44.99	38.83	37.73	36.73	42.36	44.33	56.32	50.94	36.11	35.24	34.02	41.48	44.19	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	33.05	28.68	29.37	30.52	34.14	43.69	52.85	49.64	45.02	44.88	49.37	45.03	42.04	43.88	38.08	37.13	36.08	41.50	43.33	55.09	49.73	35.37	35.00	34.00	40.73	43.20		
<b>New Hampshire</b>	32.57	28.28	28.96	30.11	33.78	43.34	52.53	49.57	45.00	44.89	49.34	44.94	42.00	43.83	38.01	37.15	35.98	41.41	43.29	55.02	49.67	35.32	34.86	33.79	40.57	43.14		
<b>Maine</b>	31.59	27.49	28.22	29.34	32.97	42.17	51.80	48.88	43.95	43.77	47.98	43.79	41.01	42.75	37.10	36.23	35.03	40.32	42.07	53.55	48.52	34.64	34.43	33.37	39.62	42.13		
<b>Mass Hub</b>	32.97	28.60	29.28	30.45	34.16	43.82	52.71	49.50	45.02	44.90	49.28	44.87	41.96	43.80	37.95	37.07	36.05	41.50	43.38	55.06	49.69	35.39	34.91	33.89	40.68	43.15		
<b>DA Forecast Load (GW)</b>	10.73	10.18	9.90	9.83	10.06	11.11	13.05	14.52	15.04	15.37	15.57	15.63	15.56	15.53	15.38	15.23	15.23	15.26	15.33	15.82	15.66	14.52	13.01	11.60				
<b>Forecast Error %</b>	3.9%	7.0%	7.7%	7.6%	7.4%	3.8%	-2.1%	-2.9%	-3.0%	-3.4%	-3.5%	-3.7%	-3.8%	-3.8%	-4.0%	-4.1%	-4.0%	-3.3%	-2.8%	-2.1%	-1.6%	-0.9%	-1.0%	0.2%				

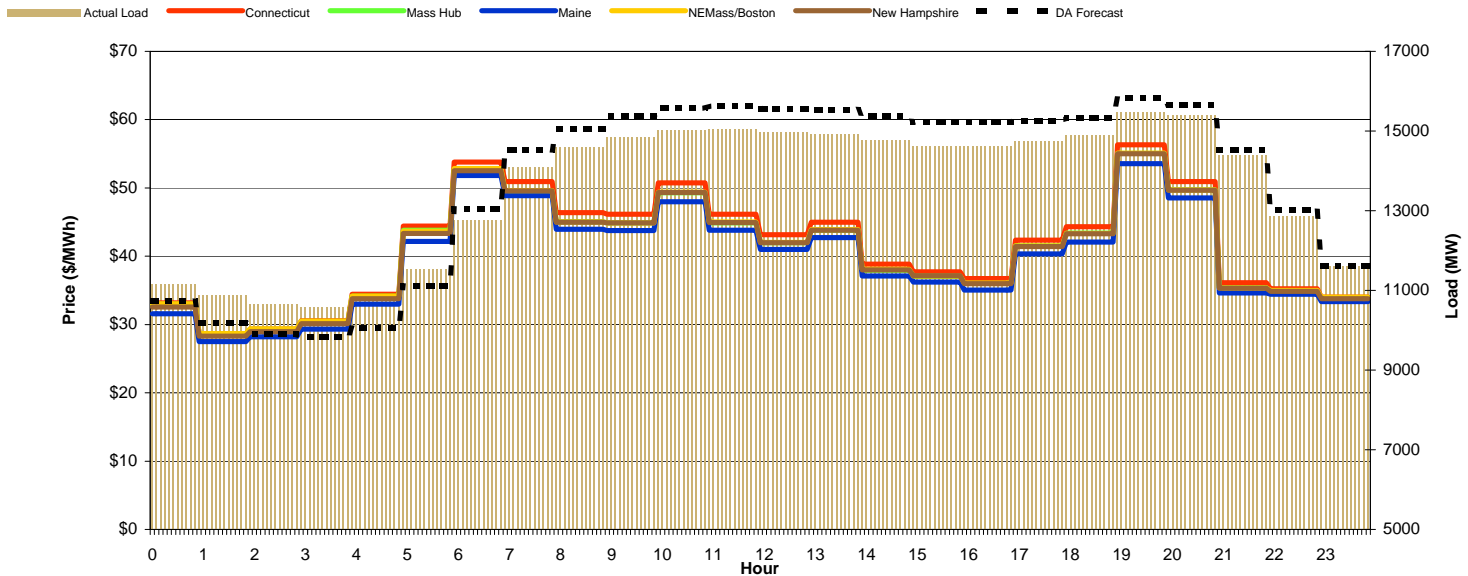




# ISO-NE Daily Report

Wednesday April 13, 2011

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	37.04	33.97	32.89	32.94	34.02	38.47	41.05	55.82	56.32	60.98	59.77	57.96	56.12	58.59	54.50	53.17	52.00	53.00	52.00	58.17	56.93	44.07	40.95	38.98	48.32	54.40	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	36.94	34.11	32.87	32.97	34.14	38.30	40.21	53.57	54.09	58.64	57.83	56.09	54.02	56.15	52.41	51.28	50.04	51.02	50.09	56.39	54.91	42.59	39.73	38.37	46.95	52.43		
<b>New Hampshire</b>	36.83	34.03	32.85	32.94	34.11	38.33	40.36	53.70	54.13	58.62	57.67	56.08	53.74	55.86	52.14	51.17	49.86	50.75	49.93	56.13	54.50	42.39	39.34	38.11	46.82	52.25		
<b>Maine</b>	36.00	33.29	32.11	32.25	33.47	37.77	39.61	52.00	51.99	55.98	55.01	54.00	51.58	53.40	50.01	49.43	47.74	48.58	47.85	54.35	52.28	40.96	38.22	37.92	45.24	50.21		
<b>Mass Hub</b>	36.90	34.02	32.92	33.01	34.05	38.26	40.35	53.91	54.37	58.89	57.90	56.20	54.17	56.49	52.70	51.54	50.30	51.20	50.29	56.46	55.04	42.80	39.83	38.46	47.09	52.63		
<b>Cleared Load (GW)</b>	9.8	9.4	9.3	9.4	9.4	10.1	12.2	13.2	13.6	13.8	14.3	14.3	14.1	13.8	13.8	13.9	13.9	13.9	13.9	14.7	14.4	13.5	12.1	10.7				

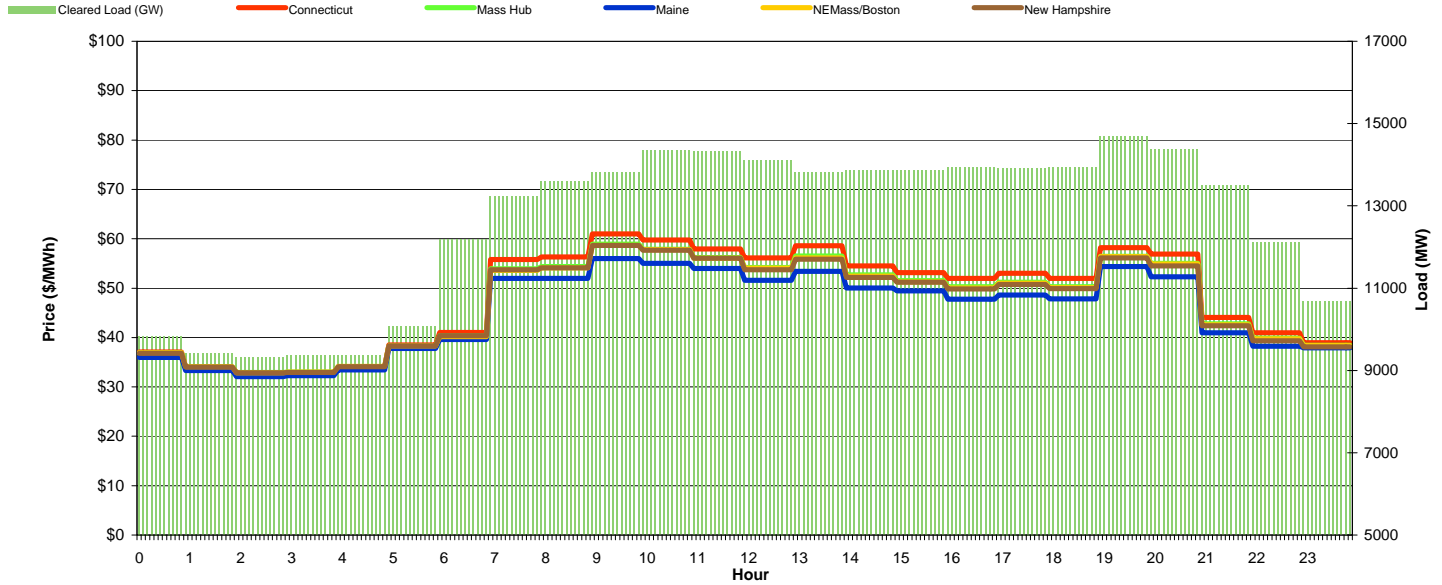

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	35.49	35.63	33.65	33.57	36.10	41.55	48.16	59.13	63.15	89.32	63.25	83.44	64.44	65.19	62.35	61.82	66.36	73.57	69.04	56.72	57.24	37.68	36.01	35.04	54.50	63.04	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	35.39	35.52	33.54	33.58	35.91	41.30	46.95	57.40	61.48	86.79	61.77	81.96	63.22	63.63	60.98	60.32	64.70	71.95	67.70	55.48	55.52	36.47	35.12	34.41	53.38	61.53		
<b>New Hampshire</b>	35.05	35.18	33.18	33.22	35.46	40.89	46.87	57.35	61.36	86.37	61.41	81.31	62.66	63.07	60.55	59.89	64.21	71.50	67.40	55.29	55.25	36.28	34.70	34.04	53.02	61.16		
<b>Maine</b>	34.49	34.59	32.58	32.66	34.72	40.28	46.31	56.34	60.12	84.45	59.83	79.09	60.87	60.99	59.09	58.43	62.39	69.62	65.75	54.00	53.60	35.18	33.52	33.52	51.77	59.58		
<b>Mass Hub</b>	35.32	35.46	33.49	33.50	35.89	41.18	47.08	57.43	61.45	86.76	61.64	81.70	62.97	63.52	60.91	60.29	64.69	71.84	67.64	55.47	55.63	36.60	35.22	34.52	53.34	61.49		
<b>DA Forecast Load (GW)</b>	10.70	10.25	10.03	10.03	10.32	11.39	13.42	14.77	15.21	15.48	15.73	15.82	15.70	15.62	15.49	15.34	15.51	15.86	15.92	16.22	15.91	14.82	13.35	11.98				
<b>Forecast Error %</b>	1.9%	4.1%	4.1%	3.6%	1.0%	-1.7%	-1.4%	-0.1%	0.7%	0.8%	1.0%	0.8%	1.1%	1.1%	0.6%	0.7%	0.7%	0.6%	0.4%	-0.3%	-0.1%	0.3%	0.2%	2.9%				

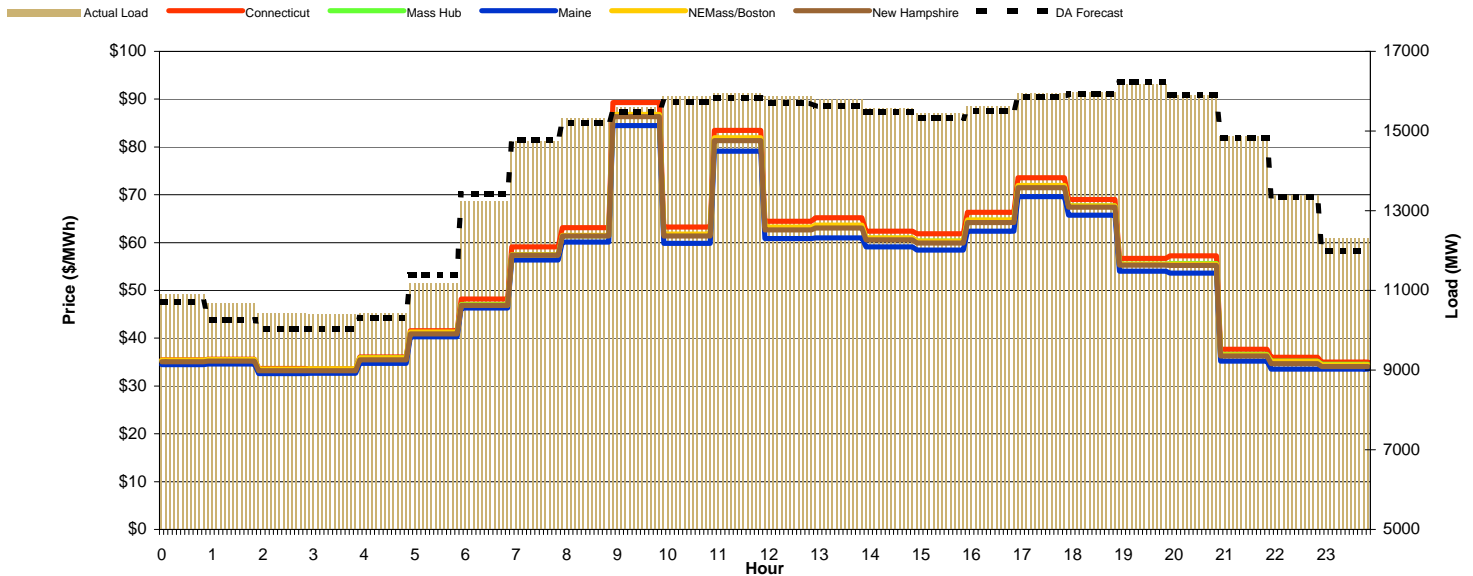




# ISO-NE Daily Report

Thursday April 14, 2011

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	36.22	36.13	35.81	35.80	35.99	38.00	41.92	44.20	44.27	44.54	46.00	45.00	41.45	42.04	40.04	39.53	39.42	39.61	39.82	48.95	52.38	40.83	38.91	36.64	40.98	42.94	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	36.07	36.09	35.71	35.78	36.00	37.95	41.21	42.82	42.85	43.12	44.40	43.45	39.99	40.61	38.70	38.35	38.33	38.45	38.67	47.32	50.56	39.53	38.00	36.38	40.01	41.57		
<b>New Hampshire</b>	35.81	35.74	35.50	35.63	35.77	37.82	41.23	43.08	43.02	43.31	44.61	43.64	40.09	40.67	38.72	38.33	38.30	38.50	38.70	47.36	50.43	39.53	37.95	36.31	40.00	41.64		
<b>Maine</b>	35.21	34.98	34.80	35.20	35.16	37.29	40.82	42.00	41.86	42.02	43.35	42.47	39.21	39.71	37.84	37.44	37.43	37.75	37.89	46.00	48.66	38.60	37.27	35.94	39.12	40.59		
<b>Mass Hub</b>	36.13	36.12	35.85	35.89	36.00	37.93	41.37	43.12	43.03	43.29	44.65	43.68	40.24	40.83	38.90	38.52	38.50	38.64	38.79	47.53	50.86	39.69	38.05	36.38	40.17	41.77		
<b>Cleared Load (GW)</b>	10.4	10.1	10.0	10.0	10.1	10.5	12.6	14.1	14.3	14.5	14.6	14.5	14.2	14.0	13.8	13.5	13.5	13.7	13.9	14.4	14.5	13.3	11.8	10.5				

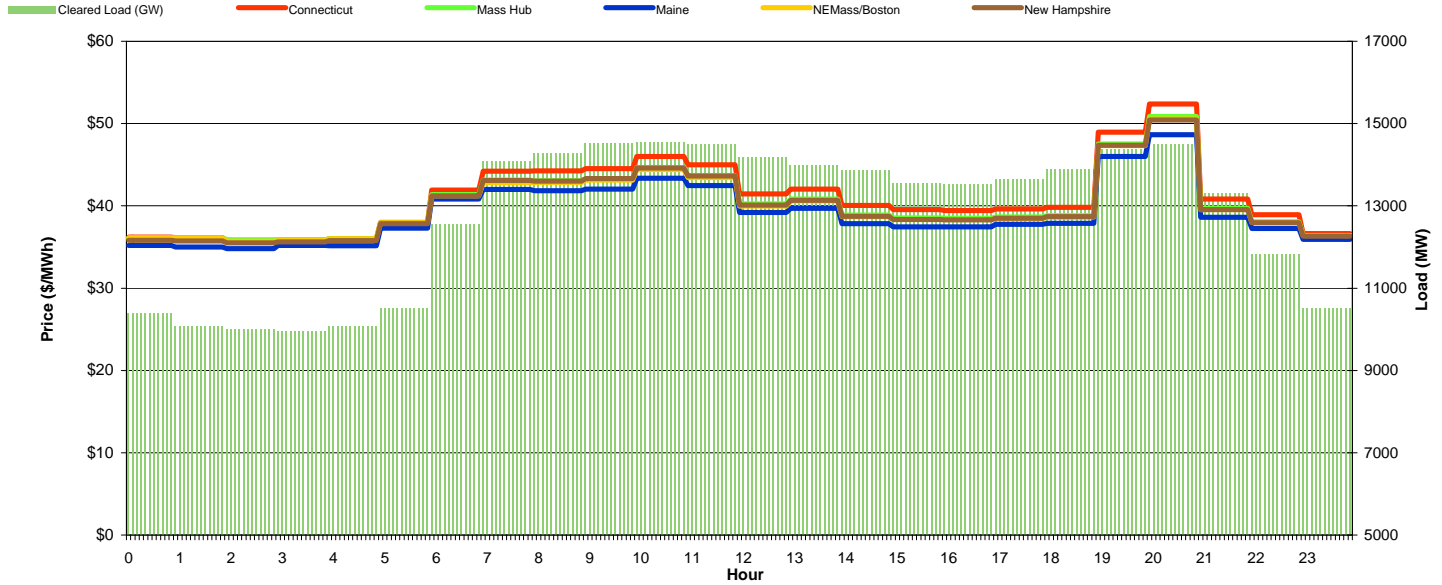

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	36.24	34.74	33.47	32.75	33.70	36.90	44.55	47.19	43.59	42.89	45.04	54.13	41.28	45.73	40.92	38.01	36.83	37.05	35.12	42.24	46.37	41.44	49.74	37.59	40.73	42.97	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	36.03	34.65	33.39	32.61	33.43	36.58	43.46	45.80	42.43	41.83	43.86	52.57	40.11	44.29	39.58	36.84	35.80	36.26	34.47	41.22	44.93	40.17	48.78	37.29	39.85	41.81		
<b>New Hampshire</b>	35.66	34.35	33.07	32.28	33.15	36.41	43.36	45.69	42.38	41.77	43.76	52.33	39.88	43.89	39.19	36.41	35.27	35.68	33.97	40.61	44.20	39.54	47.87	36.76	39.48	41.40		
<b>Maine</b>	35.11	33.81	32.48	31.67	32.60	35.94	42.61	44.44	41.19	40.66	42.49	50.36	38.59	42.24	37.52	35.00	34.04	34.39	32.86	39.23	42.09	37.87	46.09	35.91	38.30	39.94		
<b>Mass Hub</b>	36.07	34.69	33.42	32.65	33.52	36.65	43.68	45.99	42.55	41.91	43.96	52.69	40.15	44.47	39.73	36.95	35.90	36.30	34.47	41.30	45.12	40.36	48.90	37.30	39.95	41.92		
<b>DA Forecast Load (GW)</b>	11.01	10.54	10.30	10.23	10.55	11.62	13.55	14.79	15.10	15.23	15.30	15.22	15.10	15.04	14.82	14.61	14.62	14.64	14.68	15.25	15.45	14.51	13.09	11.71				
<b>Forecast Error %</b>	7.3%	7.9%	8.0%	8.3%	7.4%	4.3%	1.2%	-1.4%	-1.6%	-1.8%	-1.9%	-1.7%	-2.1%	-1.8%	-1.6%	-1.5%	-2.1%	-2.2%	-2.7%	-2.7%	-1.2%	-0.7%	-1.1%	0.1%				

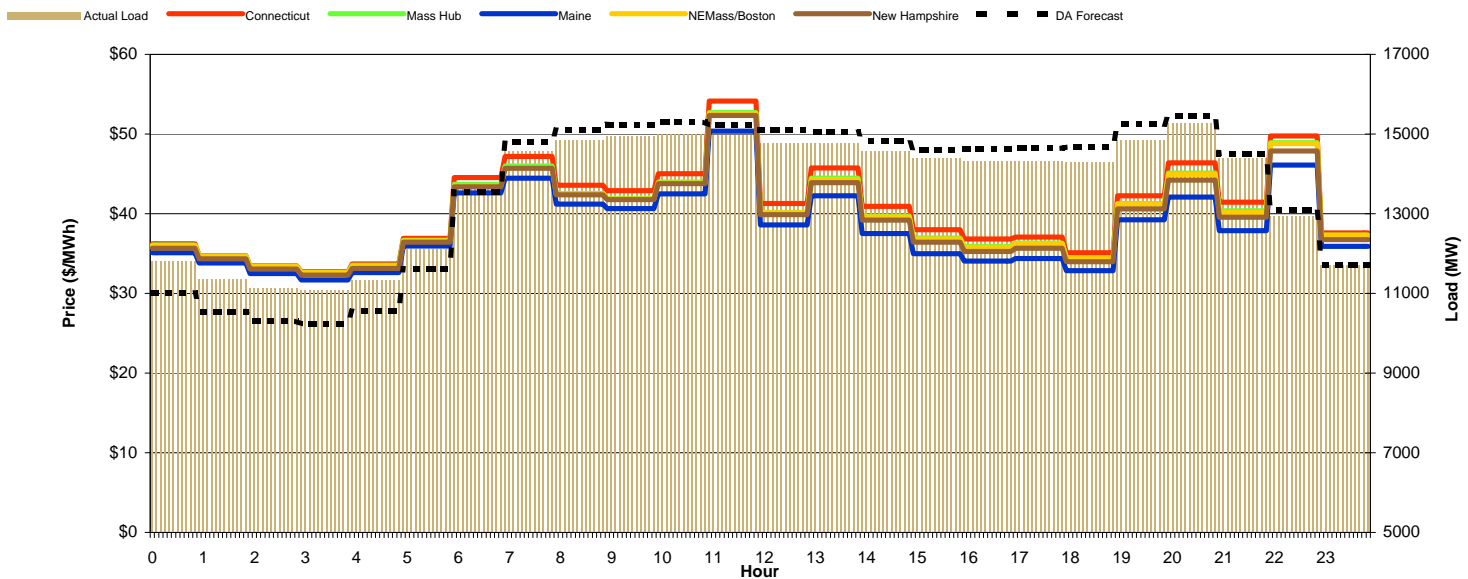




# ISO-NE Daily Report

Friday April 15, 2011

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	34.59	33.44	32.71	31.94	33.60	36.12	39.28	53.63	54.27	53.69	53.52	54.35	50.14	48.44	44.40	41.19	40.42	39.49	42.00	53.08	56.68	45.00	39.67	38.85	43.77	48.12	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	34.09	33.15	32.59	31.95	33.43	35.67	38.38	51.88	52.32	51.90	51.82	52.35	48.30	46.67	42.91	39.78	39.05	38.29	40.61	51.48	54.87	43.50	38.25	38.10	42.56	46.50		
<b>New Hampshire</b>	33.94	33.01	32.43	31.80	33.28	35.57	38.40	51.82	52.22	51.82	51.63	52.11	48.12	46.62	42.85	39.72	38.99	38.26	40.55	51.22	54.48	43.33	37.93	37.87	42.42	46.35		
<b>Maine</b>	33.46	32.56	31.99	31.37	32.92	35.10	38.33	50.87	51.27	50.82	50.39	50.96	47.00	45.61	42.12	39.13	38.38	37.83	39.98	50.04	53.10	42.37	36.93	37.25	41.66	45.43		
<b>Mass Hub</b>	34.40	33.38	32.78	32.09	33.64	35.92	38.73	52.24	52.74	52.17	52.15	52.73	48.62	47.04	43.12	39.98	39.27	38.46	40.82	51.65	55.17	43.74	38.62	38.47	42.83	46.78		
<b>Cleared Load (GW)</b>	10.6	10.3	10.2	10.2	10.4	11.0	12.7	13.7	13.8	13.8	13.9	13.7	13.5	13.4	13.3	13.1	13.1	13.2	13.4	14.0	14.0	13.3	12.2	11.0				

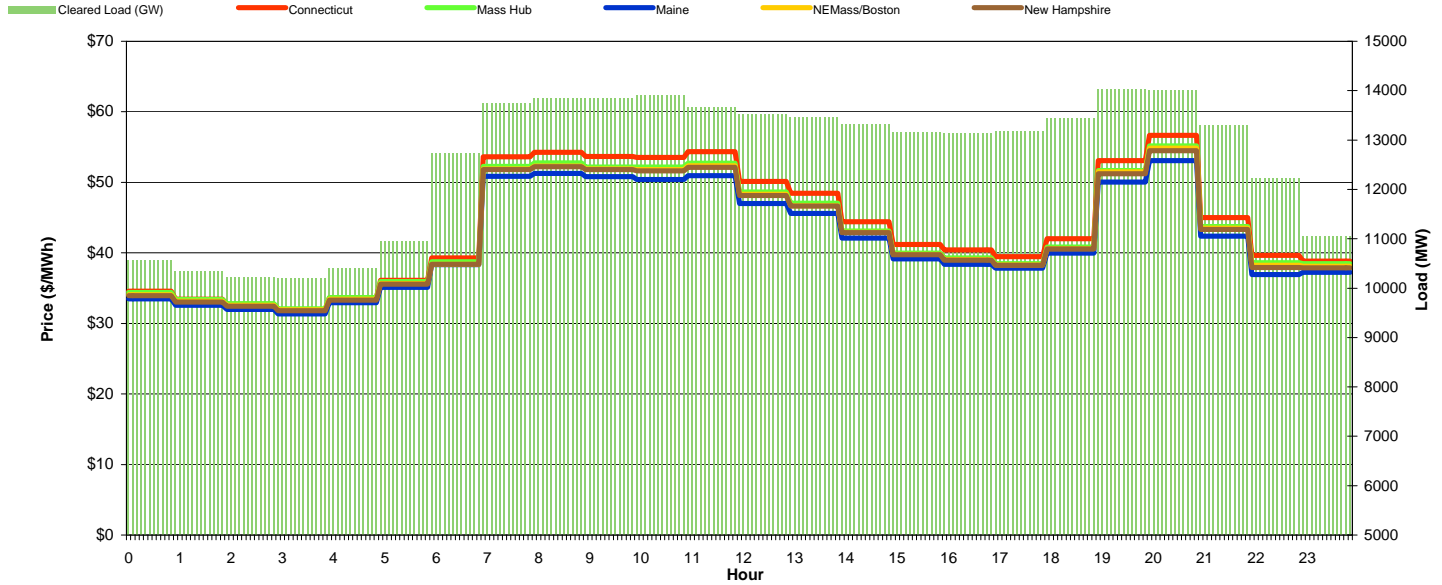

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	32.04	30.65	29.79	30.35	31.67	34.29	35.50	45.37	48.25	53.66	47.93	53.34	51.82	37.50	37.66	41.15	36.95	36.93	35.85	44.50	47.88	45.34	36.33	36.10	40.04	43.78	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	31.84	30.59	29.69	30.33	31.60	34.07	34.91	44.34	47.03	52.01	46.66	51.84	50.19	36.34	36.53	39.91	35.89	36.10	35.11	43.81	46.93	44.27	35.55	35.67	39.22	42.66		
<b>New Hampshire</b>	31.36	30.11	29.19	29.87	31.16	33.80	34.68	44.01	46.67	51.60	46.26	51.32	49.61	35.94	36.11	39.45	35.46	35.69	34.70	43.28	46.43	43.73	34.94	35.12	38.77	42.20		
<b>Maine</b>	30.52	29.27	28.34	29.23	30.56	33.55	34.77	43.77	46.19	50.95	45.72	50.50	48.53	35.27	35.39	38.69	34.78	35.10	34.15	42.78	45.97	43.14	34.24	34.69	38.17	41.57		
<b>Mass Hub</b>	31.87	30.61	29.71	30.33	31.64	34.12	34.96	44.42	47.14	52.25	46.77	51.98	50.44	36.52	36.68	40.10	36.05	36.21	35.19	43.79	46.93	44.39	35.68	35.74	39.31	42.78		
<b>DA Forecast Load (GW)</b>	11.00	10.53	10.32	10.29	10.63	11.75	13.67	14.92	15.23	15.40	15.38	15.25	15.01	14.81	14.54	14.31	14.26	14.34	14.40	14.90	15.01	14.27	13.16	11.97				
<b>Forecast Error %</b>	2.2%	6.4%	6.8%	6.9%	6.3%	0.5%	-4.3%	-3.8%	-3.1%	-3.4%	-2.8%	-2.5%	-2.5%	-2.3%	-2.2%	-2.3%	-2.7%	-2.1%	-3.3%	-2.9%	-0.9%	-0.4%	-0.2%	0.1%				

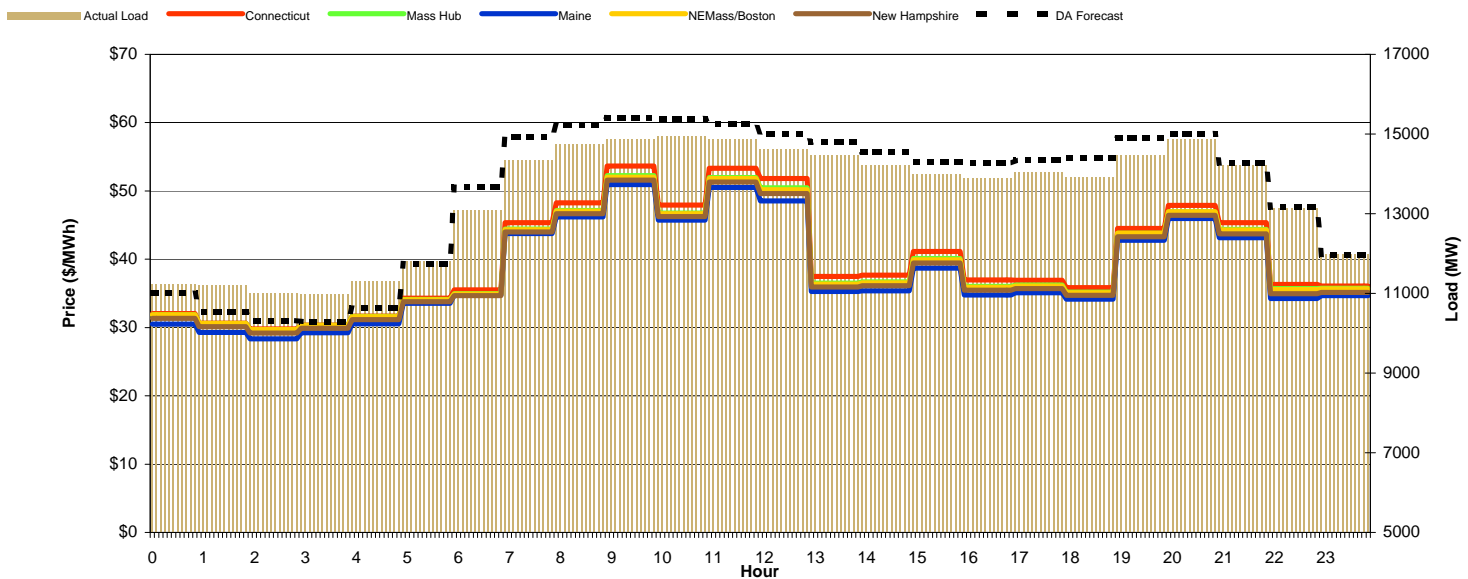




# ISO-NE Daily Report

Saturday April 16, 2011

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	37.40	36.80	35.99	35.43	35.52	36.94	35.04	39.11	40.20	47.14	48.11	46.91	42.00	39.70	37.86	37.00	37.95	39.61	39.85	51.02	53.97	39.77	39.28	38.15	40.45	42.47	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	36.94	36.32	35.47	35.05	35.16	36.61	34.96	38.34	38.97	45.43	46.39	45.20	40.49	38.39	36.71	35.94	36.85	38.38	38.60	49.19	51.73	38.44	38.33	37.71	39.40	41.09		
<b>New Hampshire</b>	36.69	36.05	35.19	34.75	34.87	36.38	34.71	38.12	38.80	45.11	46.07	44.86	40.27	38.17	36.46	35.67	36.61	38.16	38.37	48.82	51.16	38.13	38.11	37.39	39.12	40.81		
<b>Maine</b>	36.12	35.39	34.45	34.17	34.29	35.90	34.53	37.19	38.04	43.39	44.25	43.07	39.21	37.20	35.60	34.71	35.72	37.05	37.21	46.69	48.73	36.88	36.80	36.35	38.04	39.48		
<b>Mass Hub</b>	37.30	36.68	35.86	35.37	35.52	36.98	35.10	38.70	39.50	46.00	46.95	45.77	40.88	38.72	37.00	36.24	37.10	38.68	39.00	49.71	52.32	38.70	38.49	37.90	39.77	41.49		
<b>Cleared Load (GW)</b>	10.7	10.5	10.4	10.3	10.4	10.7	10.4	11.7	12.9	13.5	13.6	13.6	13.2	12.8	12.5	12.5	12.5	12.6	13.0	13.4	13.2	12.5	11.5	10.4				

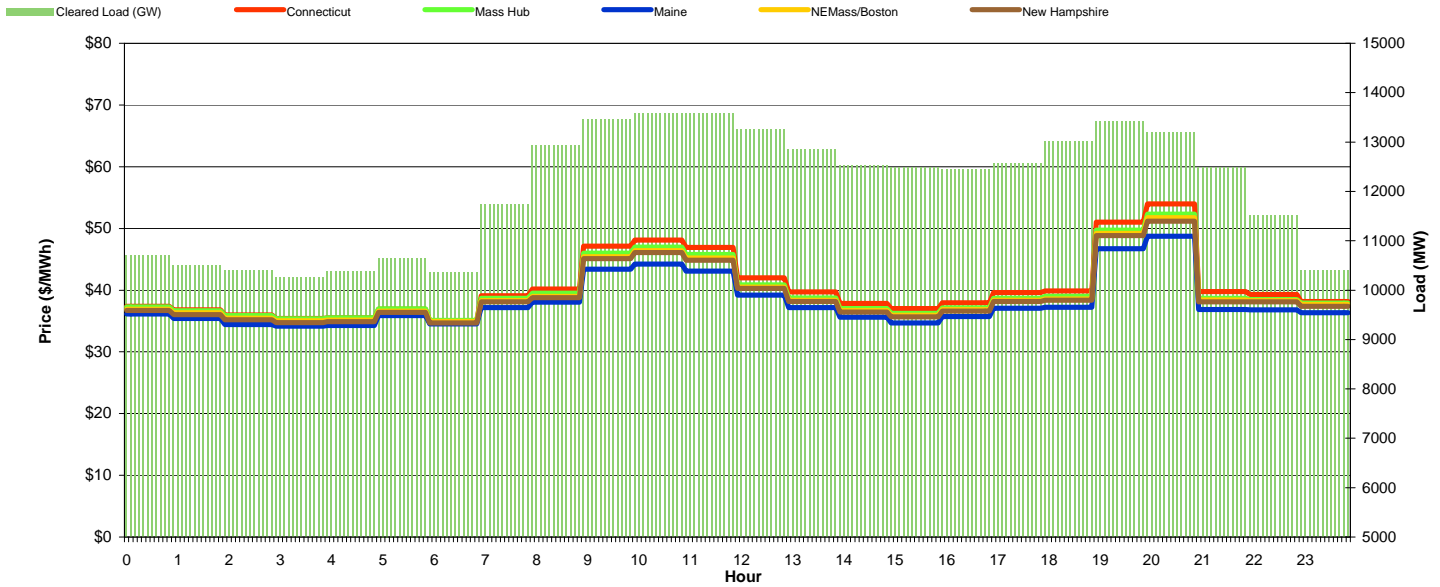

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	35.39	36.39	35.54	34.94	35.39	35.42	36.28	35.39	34.65	40.18	43.50	41.93	48.38	50.29	40.91	43.61	52.35	57.88	54.85	68.90	51.79	38.89	41.82	53.63	43.68	46.58	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	35.12	35.77	34.98	34.38	34.81	35.07	35.89	34.73	33.93	38.93	41.90	40.42	46.50	48.15	39.53	42.30	50.67	55.97	53.14	66.72	50.06	37.67	40.55	52.68	42.49	45.07		
<b>New Hampshire</b>	34.58	35.25	34.54	33.88	34.35	34.58	35.48	34.50	33.68	38.59	41.51	40.04	46.02	47.58	39.12	41.81	50.02	55.15	52.45	65.69	49.29	37.12	39.91	51.41	41.94	44.53		
<b>Maine</b>	34.14	34.68	34.03	33.42	33.76	34.23	35.23	34.06	33.33	37.76	40.32	38.91	44.53	45.97	38.05	40.57	48.37	53.19	51.03	63.42	47.26	35.93	38.15	48.44	40.78	43.18		
<b>Mass Hub</b>	35.18	36.03	35.23	34.62	35.06	35.20	36.03	34.94	34.07	39.24	42.31	40.80	46.99	48.66	39.80	42.56	51.02	56.34	53.33	66.98	50.29	37.81	40.80	52.79	42.75	45.37		
<b>DA Forecast Load (GW)</b>	11.00	10.49	10.26	10.13	10.22	10.67	11.39	12.30	13.36	13.98	14.20	14.11	13.98	13.70	13.46	13.32	13.39	13.55	13.76	14.25	14.32	13.69	12.71	11.69				
<b>Forecast Error %</b>	4.0%	8.7%	8.7%	9.4%	9.2%	5.6%	1.9%	1.9%	-0.7%	-1.2%	-1.3%	-0.4%	0.1%	1.5%	2.8%	3.8%	4.7%	6.4%	6.1%	4.3%	2.5%	2.1%	2.0%	2.0%				

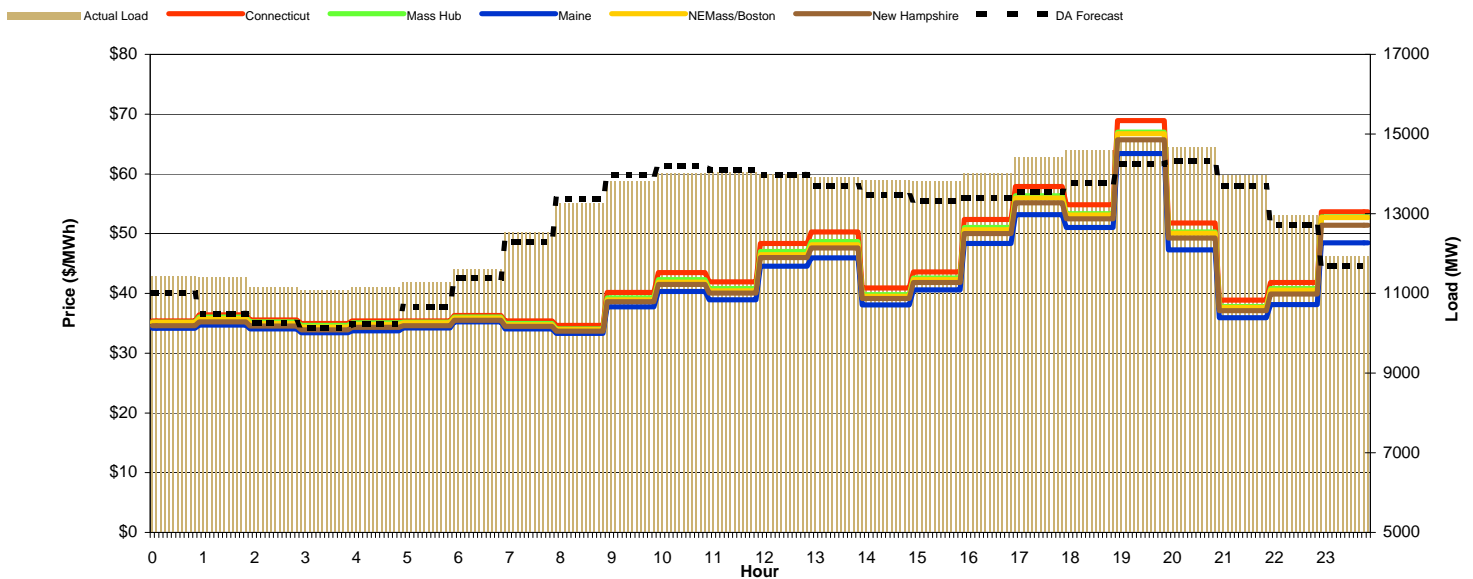






# ISO-NE Daily Report

Sunday April 17, 2011

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	34.86	32.14	31.04	31.04	31.04	31.05	31.05	34.28	39.11	42.15	41.78	41.88	39.66	38.05	35.87	35.87	37.00	39.51	40.00	53.77	56.59	40.74	38.74	35.42	38.03	40.94	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	34.50	32.16	31.00	31.00	30.96	31.13	31.13	33.81	38.24	40.94	40.46	40.52	38.32	36.93	34.91	34.97	36.04	38.43	38.70	51.88	54.44	39.20	37.78	35.08	37.19	39.72		
<b>New Hampshire</b>	33.97	31.63	30.46	30.49	30.49	30.71	30.67	33.49	37.99	40.51	40.08	40.20	37.91	36.49	34.44	34.46	35.53	37.93	38.31	51.18	53.48	38.68	37.27	34.40	36.70	39.25		
<b>Maine</b>	32.86	30.43	29.25	29.46	29.46	29.80	29.87	32.62	37.02	39.24	38.65	38.93	36.41	35.15	33.13	33.11	34.09	36.20	36.64	48.19	49.92	36.64	35.30	32.67	35.21	37.58		
<b>Mass Hub</b>	34.73	32.22	31.14	31.14	31.15	31.23	31.11	34.02	38.51	41.46	41.00	41.00	38.66	37.23	35.11	35.14	36.21	38.59	38.93	52.34	54.91	39.46	37.88	35.16	37.43	40.03		
<b>Cleared Load (GW)</b>	10.1	9.6	9.5	9.4	9.3	9.5	9.3	10.6	11.5	12.4	12.7	12.7	12.4	12.2	11.8	11.7	11.9	12.1	12.5	13.3	13.4	12.4	11.2	10.2				

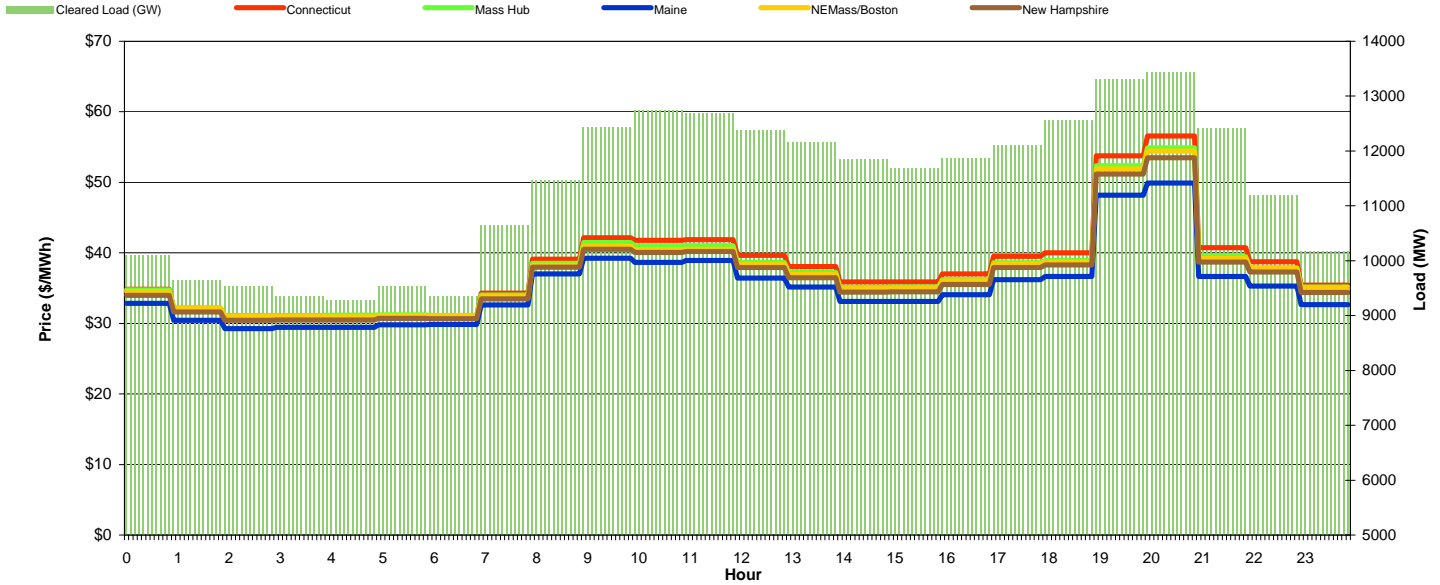

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	38.21	33.05	34.00	33.58	33.35	33.07	33.71	32.51	34.85	33.72	39.97	42.92	40.07	39.41	35.42	35.11	34.93	36.66	36.94	45.19	48.84	44.22	35.52	33.25	37.02	38.52	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	37.70	32.77	33.62	33.13	32.81	32.68	33.38	32.03	34.06	32.93	38.71	41.51	38.85	38.23	34.45	34.38	34.17	35.71	35.91	44.06	47.43	42.76	34.73	32.89	36.20	37.50		
<b>New Hampshire</b>	36.78	31.97	32.80	32.36	32.10	32.03	32.75	31.60	33.74	32.61	38.37	41.16	38.53	37.85	34.11	33.99	33.76	35.36	35.55	43.47	46.72	42.22	34.19	32.24	35.68	37.08		
<b>Maine</b>	34.87	30.28	31.05	30.70	30.44	30.54	31.45	30.61	32.87	31.81	37.38	40.09	37.61	36.75	33.31	33.26	32.90	34.49	34.62	41.89	44.78	40.62	32.70	30.72	34.41	35.98		
<b>Mass Hub</b>	37.74	32.79	33.74	33.29	33.03	32.85	33.53	32.22	34.34	33.15	39.07	41.92	39.18	38.55	34.72	34.55	34.34	35.89	36.08	44.13	47.48	43.00	34.84	32.92	36.39	37.72		
<b>DA Forecast Load (GW)</b>	10.79	10.20	9.88	9.71	9.71	9.88	10.18	10.92	11.89	12.73	13.12	13.35	13.38	13.25	13.11	13.06	13.17	13.55	13.65	14.19	14.42	13.58	12.35	11.16				
<b>Forecast Error %</b>	4.9%	9.2%	13.7%	12.2%	13.3%	13.4%	10.6%	7.3%	4.4%	0.7%	-0.1%	-0.6%	-1.3%	-2.0%	-3.0%	-3.7%	-3.9%	-4.7%	-3.9%	-3.3%	-2.1%	-1.6%	-0.3%	0.8%				

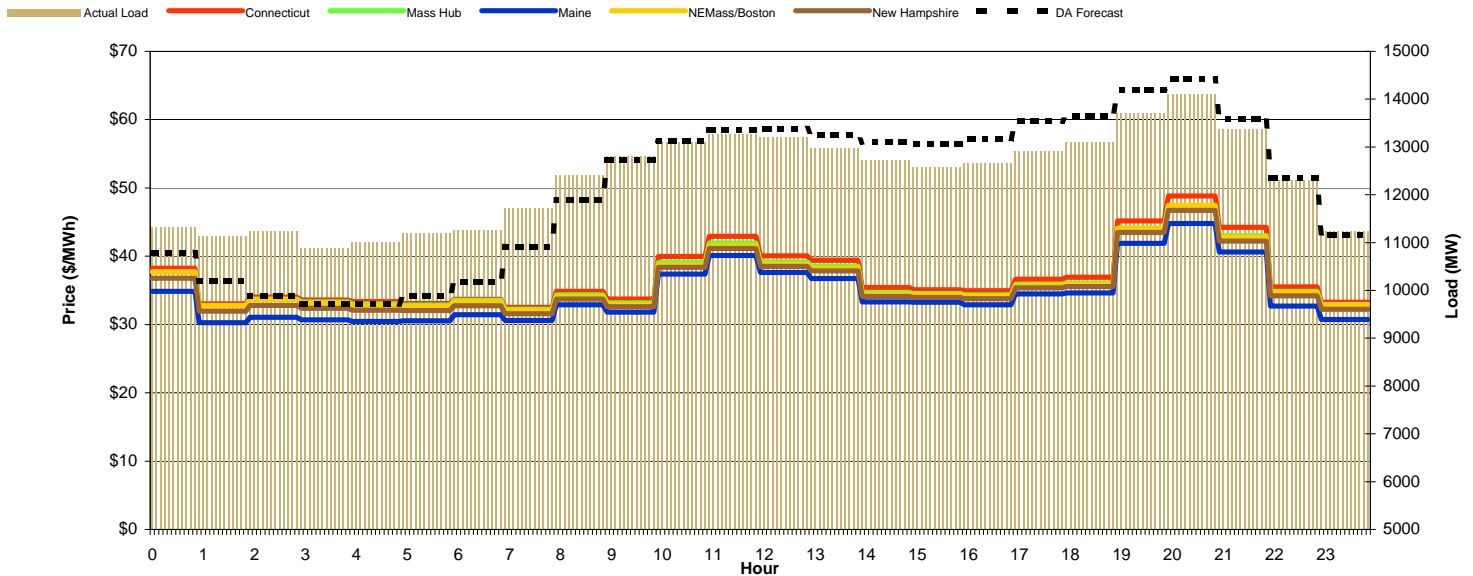




# ISO-NE Daily Report

Monday April 18, 2011

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$				
																										All	On Pk		
Connecticut	33.43	30.96	30.40	29.49	31.05	38.40	40.77	49.54	47.76	47.16	49.93	53.62	45.05	43.87	43.90	42.70	43.61	44.02	43.82	58.46	61.26	43.80	40.89	38.72	38.72	43.03	47.46		
NEMass/Boston	33.20	30.87	30.20	29.32	30.98	38.17	40.02	48.04	46.48	46.03	48.59	52.13	43.88	42.86	42.83	41.73	42.62	42.96	42.78	56.58	59.33	42.62	40.12	38.37	42.11	46.22			
New Hampshire	32.50	30.23	29.58	28.70	30.46	37.55	39.49	47.48	45.97	45.58	48.12	51.50	43.46	42.38	42.24	41.23	42.08	42.46	42.33	55.86	58.42	42.00	39.35	37.72	41.53	45.65			
Maine	30.85	28.68	28.02	27.20	29.07	36.07	38.17	45.58	44.12	43.96	46.14	49.30	41.86	40.84	40.47	39.90	40.55	40.82	40.70	53.40	55.73	40.26	37.43	36.36	39.81	43.82			
Mass Hub	33.34	30.95	30.29	29.37	31.06	38.32	40.30	48.43	46.68	46.10	48.70	52.29	44.03	42.92	42.94	41.88	42.74	43.09	42.81	56.89	59.66	42.74	40.13	38.48	42.26	46.38			
Cleared Load (GW)	10.1	9.7	9.4	9.3	9.6	10.4	12.5	13.7	13.8	13.9	14.0	13.9	13.8	13.7	13.6	13.6	13.6	13.7	13.7	14.2	14.1	13.1	11.8	10.7					

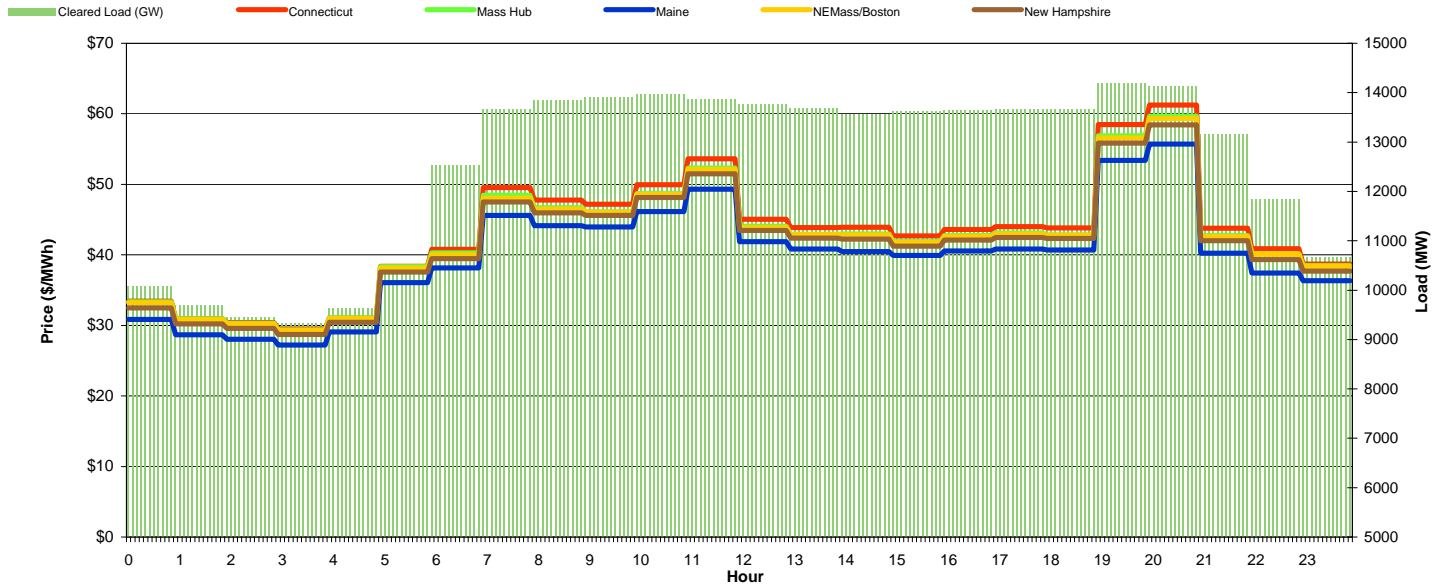

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
																										All	On Pk	
Connecticut	28.79	26.82	29.97	30.35	31.58	34.31	33.67	43.16	52.21	48.51	44.97	38.63	37.82	51.67	44.91	35.72	39.08	41.04	46.17	54.68	42.32	36.73	34.66	33.93	39.24	43.27		
NEMass/Boston	28.63	26.66	29.80	30.17	31.42	33.85	32.98	42.06	50.70	47.41	43.97	37.83	37.06	50.21	43.47	34.90	38.08	40.00	44.95	52.91	41.00	35.61	33.91	33.51	38.38	42.13		
New Hampshire	28.05	26.09	29.19	29.60	30.86	33.44	32.74	41.83	50.20	46.87	43.42	37.35	36.57	49.49	42.92	34.43	37.57	39.47	44.42	52.27	40.52	35.08	33.34	32.90	37.86	41.61		
Maine	26.90	24.89	27.91	28.44	29.75	32.58	32.24	40.98	48.62	45.50	42.45	36.33	35.68	47.80	41.42	33.53	36.46	38.09	42.90	50.31	39.20	33.73	32.16	31.74	36.65	40.32		
Mass Hub	28.63	26.68	29.82	30.20	31.43	33.99	33.09	42.27	51.00	47.58	44.07	37.87	37.10	50.44	43.75	35.01	38.22	40.16	45.14	53.20	41.16	35.82	34.04	33.52	38.51	42.30		
DA Forecast Load (GW)	10.54	10.12	9.94	9.94	10.27	11.23	12.78	14.04	14.60	14.93	15.09	15.10	15.04	14.91	14.70	14.52	14.52	14.69	14.84	15.33	15.38	14.35	12.95	11.63				
Forecast Error %	2.6%	4.2%	4.1%	3.9%	1.4%	0.2%	-3.9%	-3.6%	-2.0%	-1.5%	-1.2%	-1.4%	-2.1%	-2.2%	-2.3%	-2.2%	-1.4%	-1.3%	-1.5%	-2.0%	-2.0%	-1.5%	-1.1%	-0.9%				

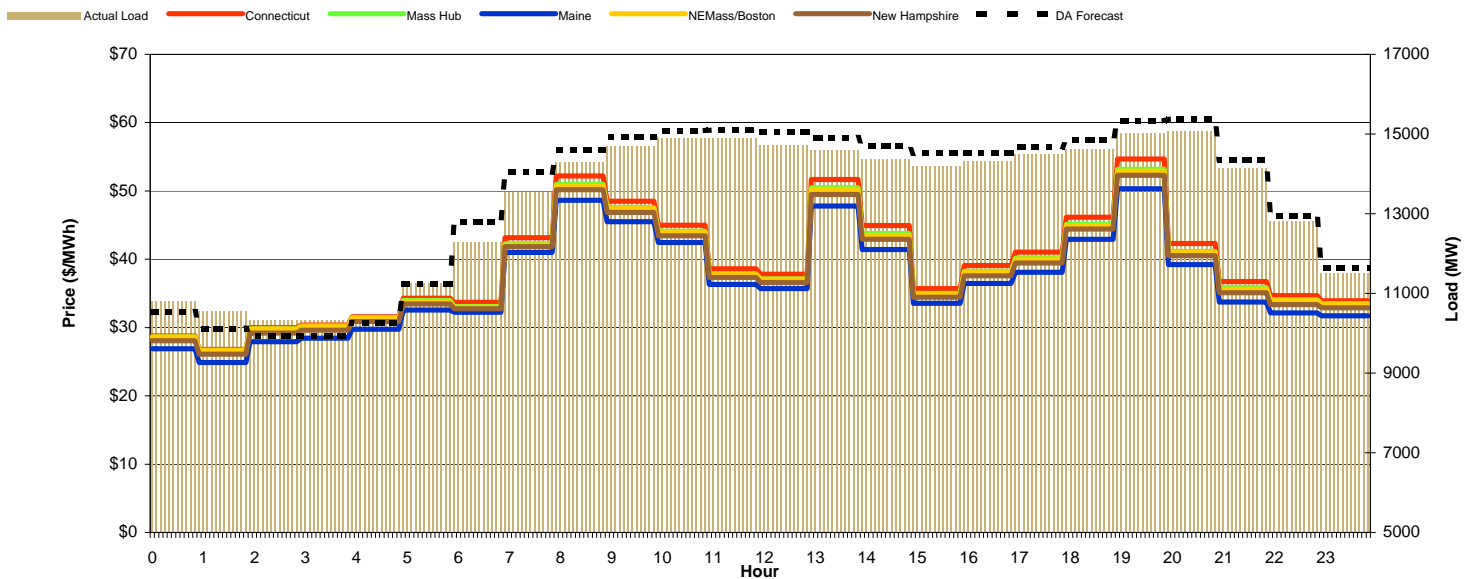




# ISO-NE Daily Report

Tuesday April 19, 2011

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	36.72	33.90	33.65	33.08	34.41	37.47	39.13	39.39	44.71	44.79	44.66	47.53	49.61	50.50	46.86	44.17	44.92	45.09	44.00	49.00	45.65	42.20	39.94	38.44	42.08	45.19	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	36.58	34.09	33.85	33.31	34.62	37.22	38.25	38.45	43.40	43.53	43.39	45.94	47.65	48.49	45.05	42.67	43.36	43.47	42.45	47.31	44.25	41.03	38.91	38.12	41.06	43.71		
<b>New Hampshire</b>	36.04	33.58	33.39	32.86	34.17	36.83	38.06	38.38	43.23	43.35	43.21	45.75	47.40	48.18	44.76	42.40	43.10	43.23	42.31	47.08	44.00	40.75	38.70	37.86	40.78	43.49		
<b>Maine</b>	35.09	32.54	32.54	32.04	33.39	35.83	37.84	37.92	42.17	42.36	42.10	44.44	45.78	46.42	43.24	41.24	41.70	41.80	40.98	45.57	42.66	39.77	37.74	37.28	39.69	42.24		
<b>Mass Hub</b>	36.69	34.01	33.78	33.27	34.56	37.29	38.49	38.54	43.54	43.63	43.49	46.21	48.00	48.87	45.42	42.97	43.63	43.77	42.71	47.53	44.40	41.18	39.07	38.20	41.22	43.94		
<b>Cleared Load (GW)</b>	9.9	9.5	9.3	9.4	9.5	10.3	12.2	13.8	14.1	14.2	14.4	14.4	14.2	14.2	14.1	14.0	13.9	14.1	14.0	14.9	14.8	13.4	12.0	10.7				

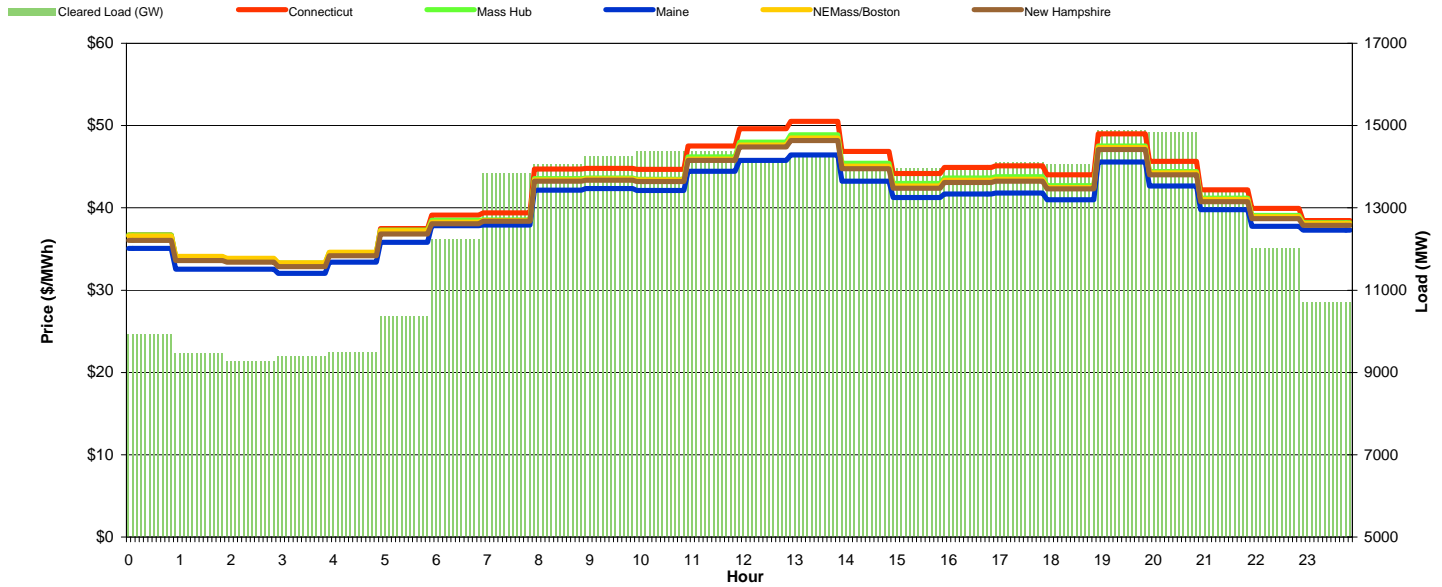

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	36.04	35.44	35.41	34.52	35.26	37.25	39.38	47.47	45.37	44.10	49.36	46.50	48.16	48.14	45.95	41.87	46.60	47.95	46.85	44.68	41.42	43.05	37.99	41.18	42.50	45.34	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	35.89	35.29	35.19	34.49	35.18	36.84	38.51	46.29	44.05	42.81	47.77	45.04	46.43	46.36	44.12	40.32	44.90	46.18	45.21	43.38	40.12	41.54	37.06	40.68	41.40	43.85		
<b>New Hampshire</b>	35.18	34.67	34.55	33.93	34.66	36.46	38.22	45.95	43.72	42.46	47.30	44.66	45.97	45.87	43.69	39.90	44.45	45.81	44.94	43.03	39.80	41.12	36.56	40.06	40.96	43.45		
<b>Maine</b>	33.81	33.37	33.47	33.05	33.93	35.83	37.83	45.07	42.62	41.32	45.60	43.26	44.40	44.17	42.02	38.39	42.68	44.15	43.66	41.80	38.61	39.62	35.34	38.61	39.69	42.04		
<b>Mass Hub</b>	35.86	35.30	35.23	34.47	35.16	36.93	38.70	46.52	44.28	43.03	48.05	45.29	46.71	46.66	44.49	40.62	45.23	46.51	45.50	43.55	40.30	41.84	37.24	40.72	41.59	44.11		
<b>DA Forecast Load (GW)</b>	10.63	10.15	9.92	9.85	10.11	11.00	12.54	13.91	14.58	15.03	15.29	15.35	15.24	15.20	15.05	14.89	14.92	15.13	15.14	15.36	15.19	14.17	12.73	11.37				
<b>Forecast Error %</b>	1.3%	2.6%	2.3%	2.6%	1.4%	-0.3%	-0.8%	-0.8%	-0.2%	-0.7%	-0.4%	-0.5%	-0.3%	-0.6%	-0.6%	-0.3%	0.2%	0.5%	1.2%	1.6%	1.7%	2.4%	3.5%	4.5%				

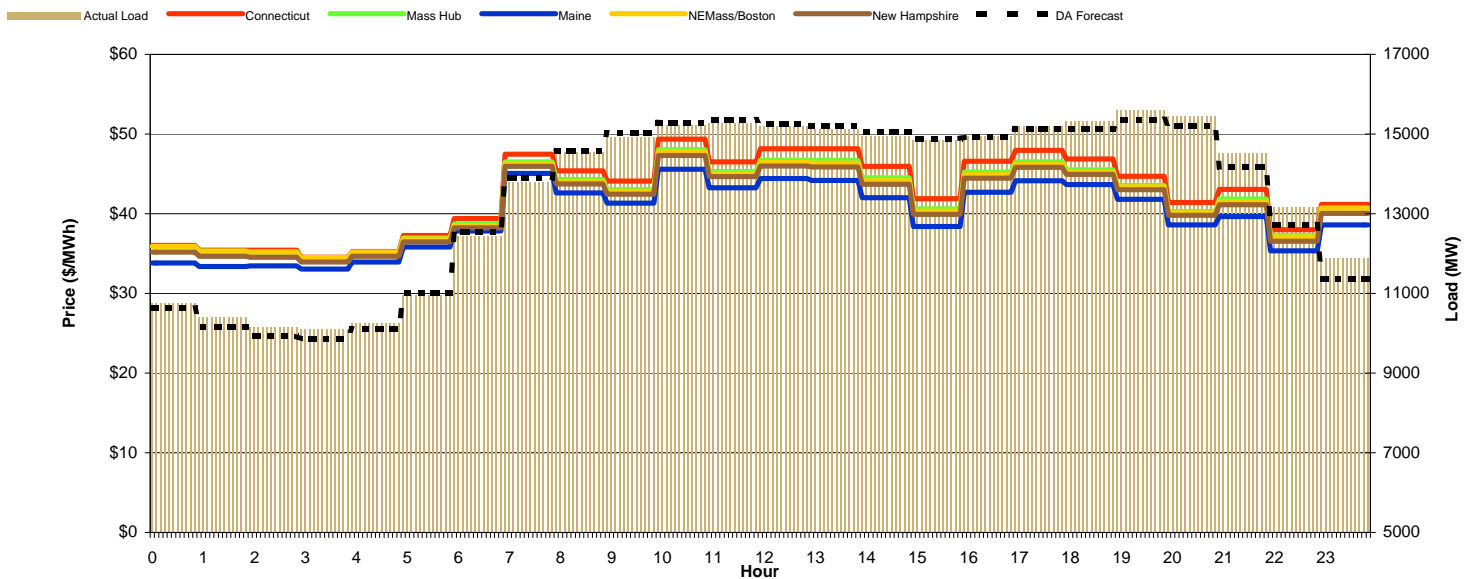




# ISO-NE Daily Report

Wednesday April 20, 2011

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	37.19	33.15	32.40	31.68	34.17	38.62	41.41	51.99	53.13	52.53	54.04	51.78	48.77	50.36	45.85	47.25	47.18	49.12	44.38	49.81	54.28	42.01	39.47	38.50	44.54	48.87	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	36.98	33.44	32.66	31.98	34.37	38.35	40.34	50.18	51.30	50.98	52.26	50.27	47.39	48.90	44.55	45.70	45.62	47.46	42.87	48.13	52.06	40.65	38.34	38.32	43.46	47.29		
<b>New Hampshire</b>	36.44	32.97	32.25	31.59	33.98	37.90	40.15	49.83	50.95	50.64	51.78	49.88	46.95	48.44	44.16	45.34	45.41	47.32	42.77	47.98	51.78	40.32	37.87	37.90	43.11	46.96		
<b>Maine</b>	35.54	32.09	31.51	30.89	33.39	37.04	39.57	48.24	49.38	49.16	50.02	48.36	45.31	46.64	42.76	43.93	44.01	45.89	41.75	46.61	50.14	39.36	37.09	37.41	41.92	45.54		
<b>Mass Hub</b>	37.07	33.33	32.61	31.92	34.28	38.36	40.71	50.46	51.51	51.08	52.42	50.41	47.45	49.01	44.71	45.91	45.85	47.72	43.01	48.30	52.39	40.78	38.45	38.38	43.59	47.47		
<b>Cleared Load (GW)</b>	10.0	9.6	9.4	9.3	9.5	10.4	12.4	13.6	13.9	14.3	14.4	14.6	14.4	14.3	14.1	13.9	13.9	14.0	13.9	14.5	14.3	13.1	11.9	10.7				

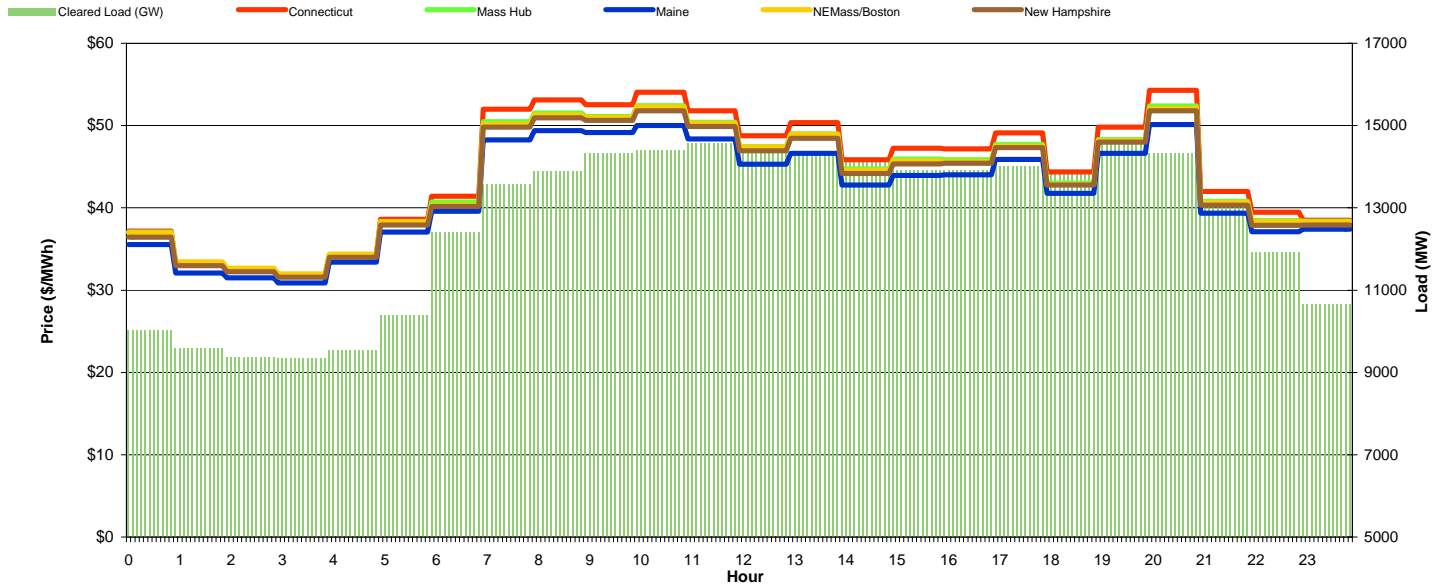

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	36.63	32.45	31.46	31.39	33.16	37.68	35.73	42.77	46.24	46.71	48.36	47.99	47.83	45.02	43.47	46.09	46.80	54.16	42.59	50.70	44.21	39.90	45.76	44.51	42.57	46.16	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	36.59	32.69	31.73	31.65	33.37	37.57	35.06	41.63	44.97	45.45	47.17	46.84	46.75	44.08	42.63	45.07	45.85	52.97	41.71	49.72	43.12	39.07	44.65	44.34	41.86	45.11		
<b>New Hampshire</b>	35.88	32.05	31.12	31.05	32.77	37.04	34.80	41.45	44.78	45.25	46.92	46.58	46.46	43.83	42.41	44.88	45.68	52.73	41.70	49.69	43.00	38.69	44.09	43.82	41.53	44.88		
<b>Maine</b>	34.51	30.97	30.17	30.15	31.91	36.29	34.56	40.79	44.03	44.43	46.02	45.75	45.64	43.10	41.91	44.45	45.39	52.44	41.77	49.92	42.99	38.26	43.42	43.43	40.93	44.39		
<b>Mass Hub</b>	36.49	32.51	31.54	31.46	33.19	37.45	35.08	41.76	45.09	45.53	47.15	46.79	46.77	44.07	42.61	45.12	45.89	53.06	41.76	49.74	43.10	39.09	44.87	44.25	41.85	45.15		
<b>DA Forecast Load (GW)</b>	10.88	10.38	10.18	10.12	10.40	11.44	13.17	14.58	15.14	15.41	15.58	15.58	15.45	15.36	15.18	14.98	15.04	15.16	15.10	15.47	15.48	14.49	13.08	11.73				
<b>Forecast Error %</b>	0.9%	0.7%	0.1%	0.2%	0.0%	-1.2%	-2.8%	-2.4%	-0.9%	0.0%	0.7%	1.1%	0.9%	0.9%	0.8%	0.6%	0.3%	-0.3%	-0.2%	-1.2%	-0.1%	0.7%	1.5%	1.8%				

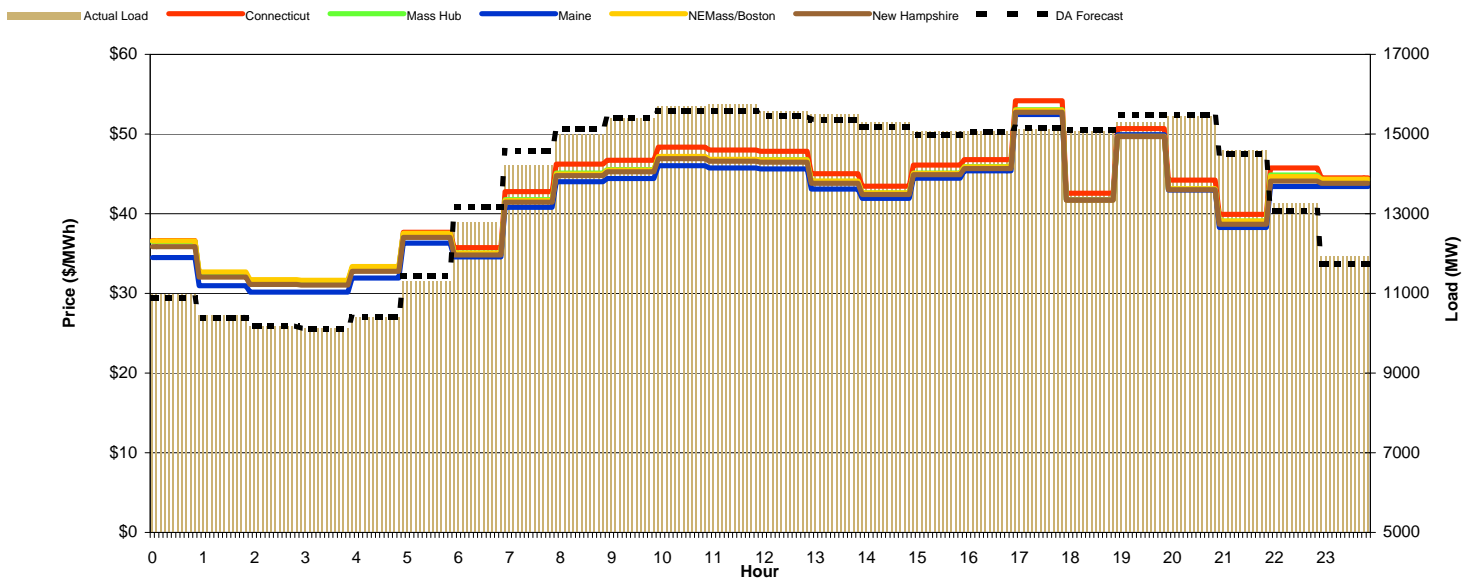




# ISO-NE Daily Report

Thursday April 21, 2011

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	36.76	34.07	33.04	32.64	33.87	38.08	41.11	46.98	48.15	49.24	49.40	47.84	46.13	44.07	44.14	42.32	42.70	41.10	43.15	49.78	53.59	44.10	40.14	38.36	42.53	45.80	All	On Pk
<b>NEMass/Boston</b>	36.93	34.39	33.50	33.06	34.26	38.19	40.40	45.97	46.98	48.06	48.10	46.69	44.92	42.92	42.94	41.30	41.59	40.21	42.04	48.48	52.01	42.83	39.10	38.19	41.79	44.63	41.65	44.73
<b>New Hampshire</b>	36.70	34.21	33.32	32.91	34.15	38.10	40.42	46.10	47.06	48.11	48.15	46.74	44.95	42.96	42.92	41.31	41.71	40.35	42.11	48.59	52.09	42.88	39.17	38.19	41.80	44.70	41.65	43.83
<b>Maine</b>	35.96	33.57	32.69	32.33	33.67	37.59	40.09	45.61	46.34	47.57	47.56	46.18	44.39	42.23	42.27	40.78	41.25	39.81	41.51	47.77	51.10	42.07	38.31	37.78	41.18	44.05	41.35	43.60
<b>Mass Hub</b>	36.84	34.29	33.35	32.94	34.08	38.09	40.66	46.09	47.08	48.13	48.15	46.66	44.91	42.92	42.88	41.24	41.59	40.14	42.02	48.48	52.15	42.94	39.17	38.17	41.79	44.66	41.32	43.91
<b>Cleared Load (GW)</b>	9.9	9.5	9.4	9.4	9.4	10.4	12.1	13.7	14.0	14.1	14.2	14.2	13.9	13.7	13.3	13.3	13.2	13.5	13.4	14.2	14.4	13.5	12.2	10.8				

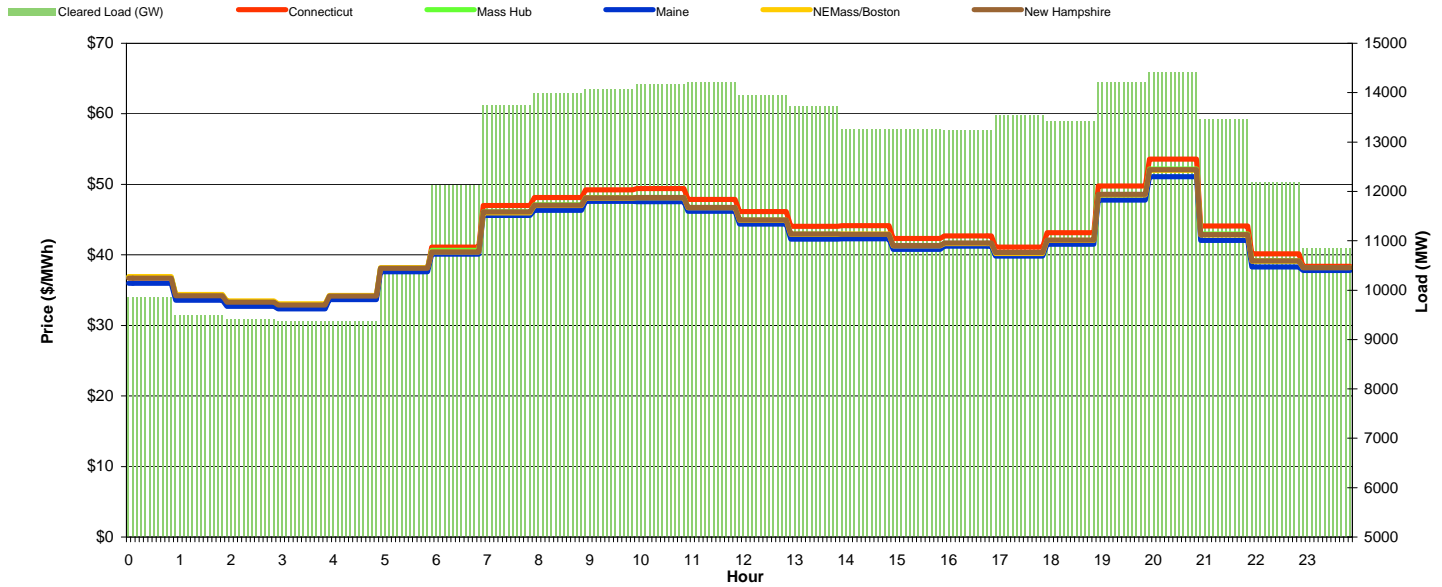

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	37.90	35.43	34.51	34.35	35.62	43.67	36.66	37.91	47.04	50.42	41.71	43.36	48.08	44.14	44.65	39.61	45.97	42.28	42.27	56.09	53.76	40.08	38.27	41.65	42.31	44.73	All	On Pk
<b>NEMass/Boston</b>	38.22	35.84	34.97	34.81	36.01	43.88	36.17	37.32	46.24	49.49	40.99	42.74	47.17	43.28	43.82	38.96	45.09	41.49	41.56	55.19	52.86	39.30	37.52	41.45	41.85	43.94	41.85	43.94
<b>New Hampshire</b>	37.61	35.37	34.56	34.41	35.63	43.52	36.13	37.31	46.16	49.47	40.90	42.56	47.04	43.24	43.72	38.86	44.97	41.39	41.44	55.03	52.77	39.15	37.26	41.10	41.65	43.83	41.65	43.83
<b>Maine</b>	36.98	34.84	33.99	33.93	35.27	43.14	36.35	37.32	45.94	49.36	40.88	42.58	47.15	43.41	43.78	38.97	44.76	40.98	40.95	54.40	52.26	38.50	36.42	40.31	41.35	43.60	41.35	43.60
<b>Mass Hub</b>	37.96	35.60	34.79	34.63	35.84	43.74	36.20	37.32	46.20	49.45	40.92	42.63	47.12	43.26	43.78	38.89	45.10	41.52	41.55	55.12	52.80	39.35	37.61	41.32	41.78	43.91	41.32	43.91
<b>DA Forecast Load (GW)</b>	10.80	10.31	10.10	10.01	10.35	11.30	12.79	14.09	14.73	14.92	14.98	14.94	14.77	14.67	14.46	14.28	14.32	14.49	14.57	15.11	15.36	14.58	13.21	11.92				
<b>Forecast Error %</b>	2.1%	2.0%	4.1%	4.3%	3.4%	1.4%	-1.1%	-1.5%	-1.7%	-0.7%	0.0%	0.4%	0.5%	0.3%	0.2%	0.0%	-0.7%	-1.3%	-1.5%	-2.4%	-0.7%	-0.2%	0.7%	0.8%				

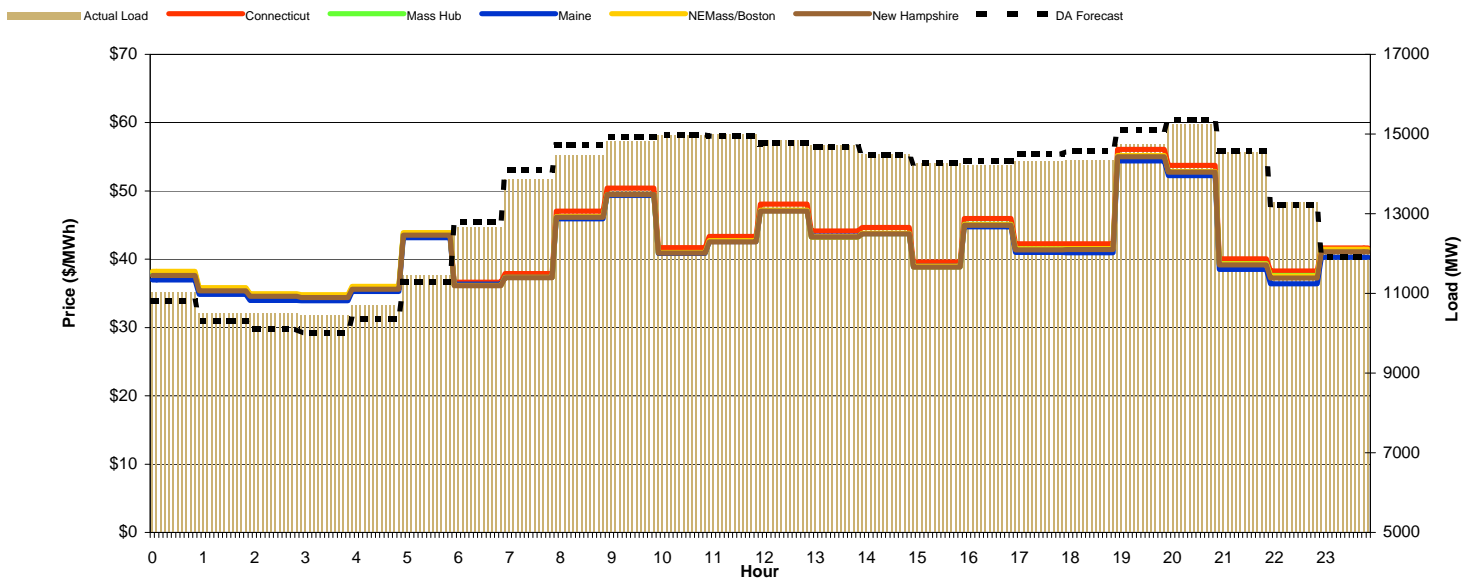




# ISO-NE Daily Report

Friday April 22, 2011

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$		
<b>Connecticut</b>	38.20	38.00	36.78	36.95	37.92	38.33	39.14	40.65	46.60	50.87	50.00	49.73	50.38	48.44	45.05	43.34	43.33	43.47	43.28	49.05	52.83	42.95	39.78	38.62	38.27	43.49	46.23
<b>NEMass/Boston</b>	38.06	38.09	36.92	37.19	38.07	38.28	38.60	39.97	45.50	49.41	48.68	48.36	48.73	46.88	43.58	41.97	41.89	41.99	41.88	47.53	51.01	41.74	38.50	38.27	42.55	44.85	
<b>New Hampshire</b>	38.21	38.09	36.90	37.11	38.07	38.46	39.02	40.56	46.22	49.99	49.21	48.93	49.17	47.35	44.03	42.38	42.31	42.45	42.33	47.95	51.36	42.09	38.62	38.42	42.88	45.31	
<b>Maine</b>	37.35	37.21	36.00	36.25	37.21	37.87	39.14	40.59	45.94	48.91	48.22	47.85	47.86	46.15	43.00	41.55	41.47	41.61	41.63	46.60	49.61	41.26	37.54	37.47	42.01	44.36	
<b>Mass Hub</b>	38.12	38.05	36.91	37.15	38.08	38.25	38.72	40.00	45.46	49.39	48.56	48.29	48.72	46.90	43.60	41.99	41.96	42.09	41.95	47.68	51.23	41.80	38.60	38.30	42.58	44.89	
<b>Cleared Load (GW)</b>	9.9	9.4	9.2	9.2	9.4	10.0	11.4	12.8	13.1	13.3	13.5	13.5	13.1	13.0	12.8	12.7	12.6	12.6	12.7	13.2	13.3	12.6	11.7	10.5			

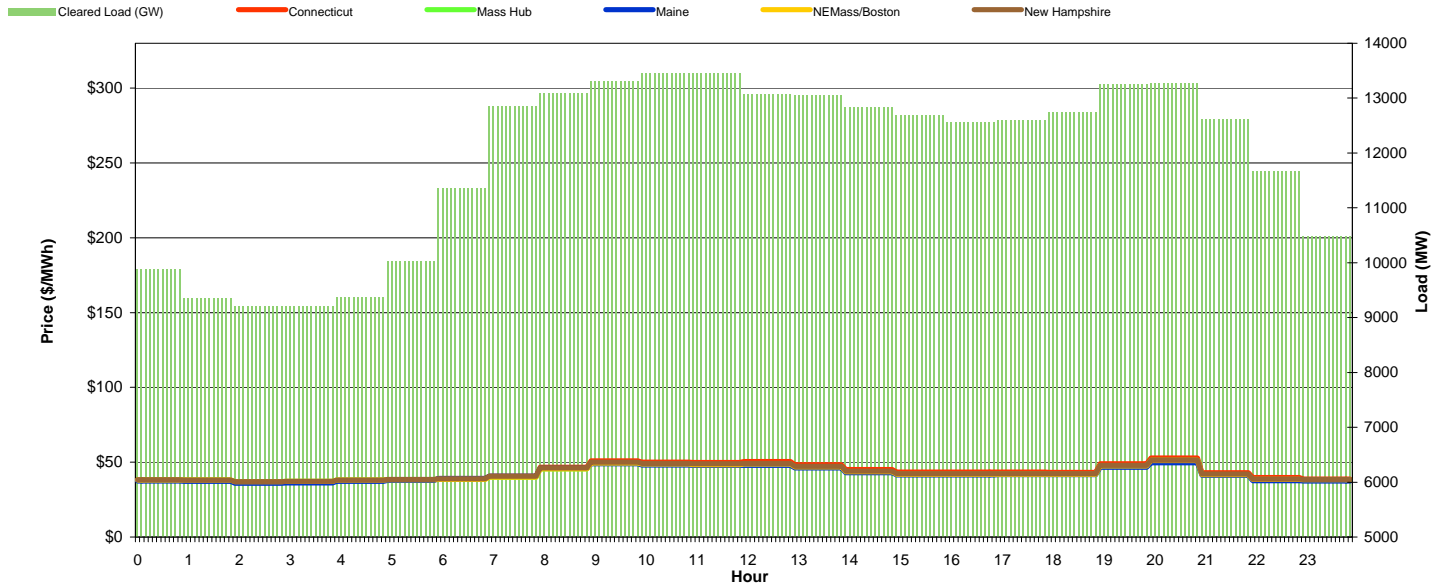

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$	
<b>Connecticut</b>	45.94	53.09	41.78	42.02	49.13	44.98	45.93	40.27	52.49	55.61	59.39	53.55	313.71	152.67	36.97	35.79	36.99	36.63	36.16	53.80	46.84	38.01	37.50	39.19	60.35	67.90
<b>NEMass/Boston</b>	45.80	53.23	41.98	42.25	49.17	44.84	45.32	39.66	52.35	54.98	58.15	52.73	321.51	156.41	37.78	36.22	36.66	35.85	35.41	52.95	46.11	37.20	36.55	39.01	60.51	68.16
<b>New Hampshire</b>	45.36	52.88	41.77	42.05	48.99	44.89	45.54	40.06	52.57	55.24	58.75	53.02	318.65	154.93	37.42	35.97	36.62	35.90	35.47	53.11	46.33	37.25	36.36	38.72	60.33	67.98
<b>Maine</b>	44.19	51.15	40.65	41.02	47.77	44.24	45.06	39.70	52.11	54.38	58.04	52.01	312.57	151.19	36.52	35.18	35.70	34.85	34.45	51.88	45.14	36.06	34.71	37.35	59.00	66.53
<b>Mass Hub</b>	45.64	52.98	41.77	42.03	48.98	44.72	45.31	39.67	51.95	54.74	58.18	52.61	315.65	153.74	37.18	35.81	36.52	35.91	35.47	52.91	46.08	37.22	36.67	38.85	60.02	67.52
<b>DA Forecast Load (GW)</b>	11.11	10.66	10.44	10.33	10.59	11.49	12.76	13.92	14.49	14.78	14.92	14.85	14.67	14.52	14.32	14.05	14.01	14.04	14.02	14.55	14.63	13.98	12.91	11.76		
<b>Forecast Error %</b>	0.3%	0.2%	0.0%	0.6%	0.5%	-0.5%	-1.8%	-2.1%	-2.1%	-1.3%	-1.1%	-1.6%	-2.2%	-2.9%	-3.4%	-3.7%	-4.0%	-3.6%	-2.9%	-3.8%	-1.8%	-1.4%	-1.0%	-1.1%		

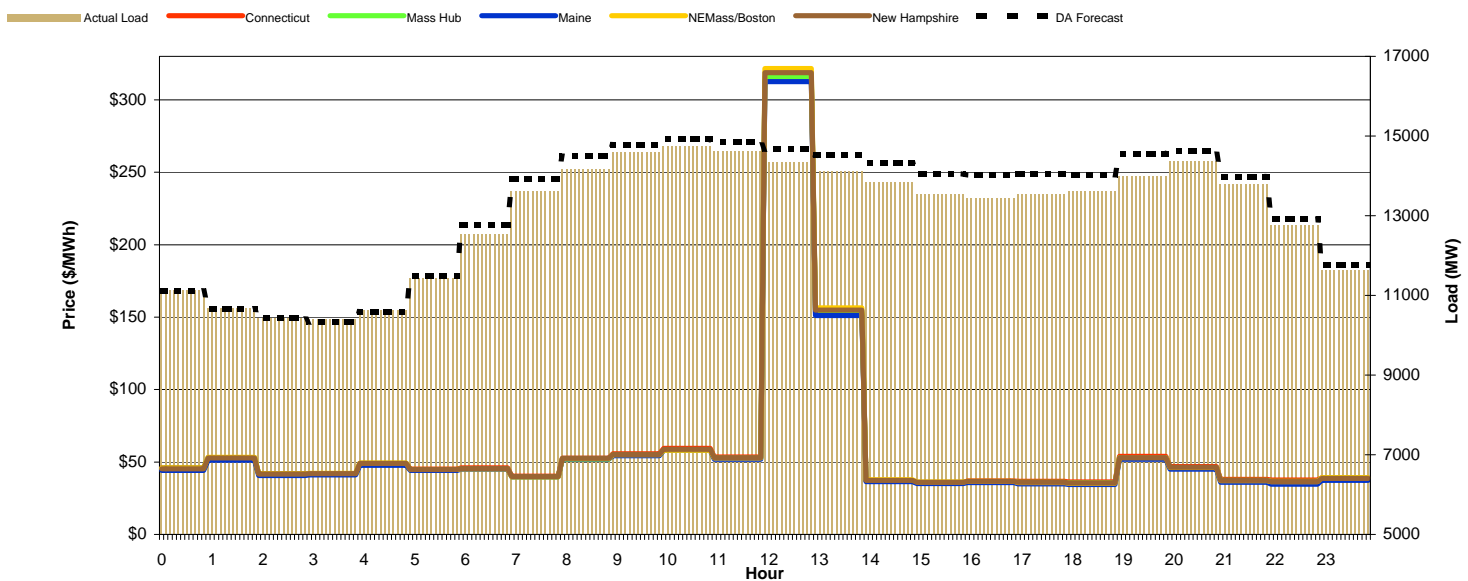




# ISO-NE Daily Report

Saturday April 23, 2011

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	38.48	38.48	38.14	37.49	38.00	38.03	39.02	39.51	43.11	50.40	54.00	56.06	53.44	47.05	43.33	43.55	43.87	46.85	44.87	57.24	57.43	43.15	39.86	39.24	44.61	47.73	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	38.11	38.21	38.06	37.56	38.08	38.06	38.65	38.57	41.89	48.78	52.07	54.25	51.62	45.44	41.98	42.19	42.46	45.34	43.32	55.27	55.35	41.64	38.66	38.63	43.51	46.18		
<b>New Hampshire</b>	38.22	38.20	37.98	37.44	37.97	38.08	38.83	38.97	42.56	49.53	52.77	54.51	51.82	45.76	42.30	42.45	42.95	45.82	43.86	55.74	55.84	42.14	38.90	38.75	43.81	46.62		
<b>Maine</b>	37.10	36.95	36.67	36.20	36.75	37.02	38.09	38.37	41.88	48.29	51.12	52.45	50.00	44.22	41.05	41.03	41.54	44.23	42.51	53.67	53.81	41.12	37.60	37.70	42.47	45.18		
<b>Mass Hub</b>	38.27	38.39	38.19	37.65	38.22	38.21	38.80	38.72	42.18	49.10	52.37	54.46	51.91	45.71	42.25	42.54	42.87	45.77	43.67	55.75	55.74	42.00	38.92	38.89	43.77	46.50		
<b>Cleared Load (GW)</b>	10.0	9.7	9.4	9.3	9.4	9.6	9.9	11.0	12.2	12.9	13.0	13.1	12.8	12.7	12.6	12.5	12.6	12.7	12.6	12.9	12.9	12.4	11.4	10.4				

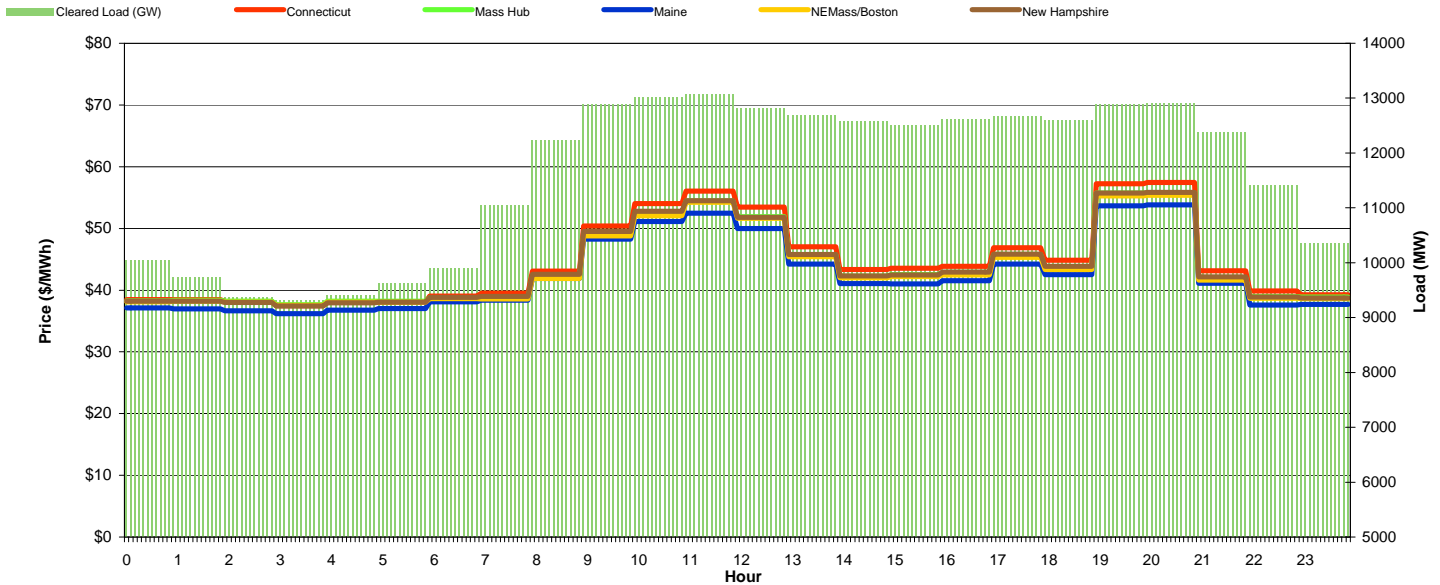

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	40.82	39.09	38.05	36.65	36.79	40.81	39.03	38.77	42.50	61.13	66.35	66.47	64.24	61.14	41.39	39.42	46.16	49.82	58.16	57.88	47.25	40.00	35.75	36.66	46.85	51.03	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	40.56	38.83	37.99	36.69	36.91	40.87	38.63	38.34	41.79	59.84	64.96	64.89	62.68	59.60	40.29	38.53	44.98	48.42	56.48	56.21	45.77	38.79	34.79	35.79	45.94	49.77		
<b>New Hampshire</b>	40.27	38.49	37.63	36.31	36.57	40.57	38.49	38.27	41.89	60.07	65.17	64.95	62.69	59.59	40.28	38.51	45.03	48.55	56.65	56.29	45.97	38.91	34.78	35.70	45.90	49.85		
<b>Maine</b>	38.63	36.76	35.99	34.79	35.15	39.13	37.38	37.32	40.69	57.81	62.10	61.20	58.90	56.19	38.23	36.70	42.81	46.08	53.88	53.30	43.95	37.29	33.20	34.28	43.82	47.48		
<b>Mass Hub</b>	40.46	38.82	37.94	36.63	36.84	40.84	38.69	38.36	41.88	59.98	65.03	65.01	62.91	59.84	40.41	38.59	45.09	48.56	56.64	56.37	45.95	38.97	34.96	35.98	46.03	49.91		
<b>DA Forecast Load (GW)</b>	10.95	10.43	10.15	10.04	10.10	10.48	11.08	12.03	13.12	13.86	14.25	14.21	14.16	13.92	13.69	13.50	13.59	13.61	13.76	14.04	14.09	13.40	12.39	11.40				
<b>Forecast Error %</b>	0.9%	3.1%	3.1%	3.1%	3.0%	2.6%	0.5%	-0.5%	-1.0%	1.0%	2.5%	4.7%	4.7%	4.6%	4.1%	3.9%	3.5%	4.2%	3.1%	2.0%	1.8%	2.4%	3.7%	4.4%				

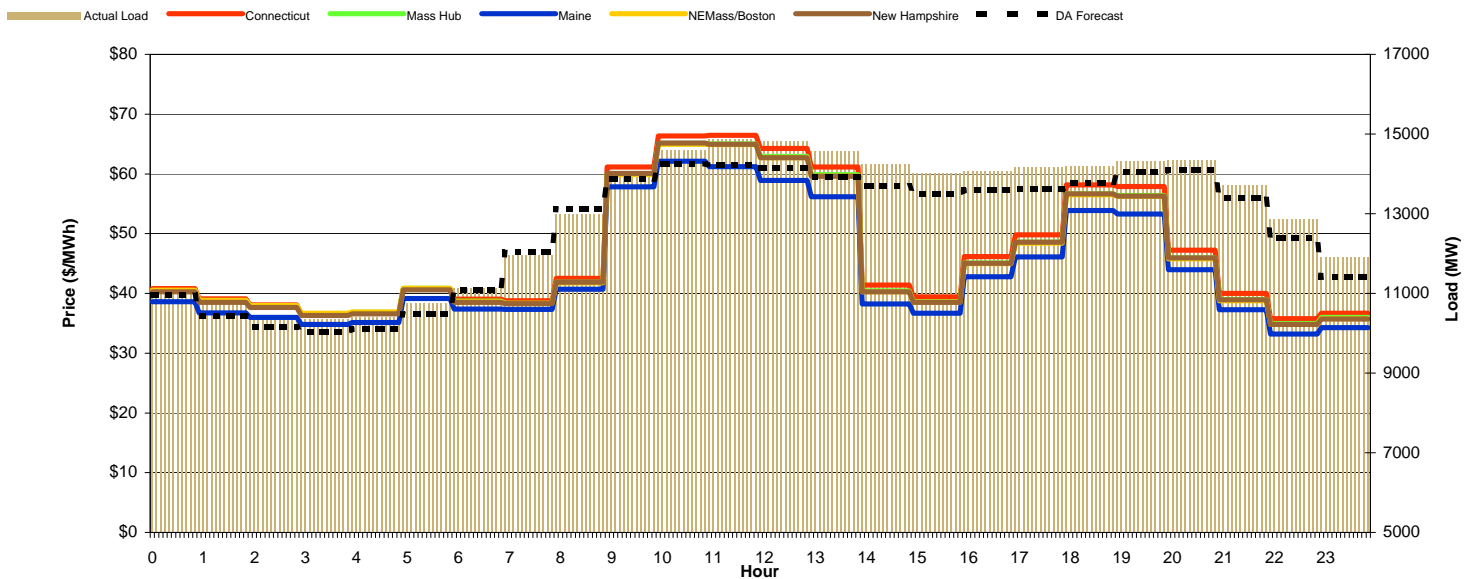




# ISO-NE Daily Report

Sunday April 24, 2011

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$	
<b>Connecticut</b>	37.96	37.00	36.29	35.04	34.58	36.02	36.30	36.32	38.41	40.00	42.48	42.11	41.97	40.00	39.29	39.30	39.19	38.85	39.12	47.63	63.05	42.19	39.35	38.29	40.03	41.83
<b>NEMass/Boston</b>	37.42	36.61	36.04	34.90	34.44	35.86	36.18	35.99	37.82	39.26	41.23	40.91	40.81	39.01	38.33	38.28	38.33	38.18	38.34	46.63	60.98	40.88	38.80	37.99	39.30	40.86
<b>New Hampshire</b>	37.53	36.62	35.96	34.82	34.36	35.78	36.21	36.11	38.09	39.59	41.79	41.47	41.32	39.39	38.69	38.70	38.74	38.60	38.77	47.10	61.36	41.35	39.22	38.32	39.58	41.27
<b>Maine</b>	36.39	35.47	34.80	33.71	33.27	34.74	35.43	35.45	37.56	39.07	41.14	40.84	40.62	38.66	38.03	38.01	38.11	38.06	38.08	45.99	59.25	40.73	38.53	37.58	38.73	40.51
<b>Mass Hub</b>	37.85	37.02	36.38	35.17	34.70	36.12	36.40	36.08	37.99	39.38	41.57	41.20	41.07	39.09	38.35	38.41	38.32	38.13	38.29	46.75	61.33	41.08	38.74	38.12	39.48	40.99
<b>Cleared Load (GW)</b>	10.0	9.8	9.5	9.5	9.5	9.5	9.6	10.5	11.4	12.0	12.2	12.3	12.3	12.0	11.4	11.3	11.2	11.6	11.9	12.9	12.8	11.9	10.9	9.8		

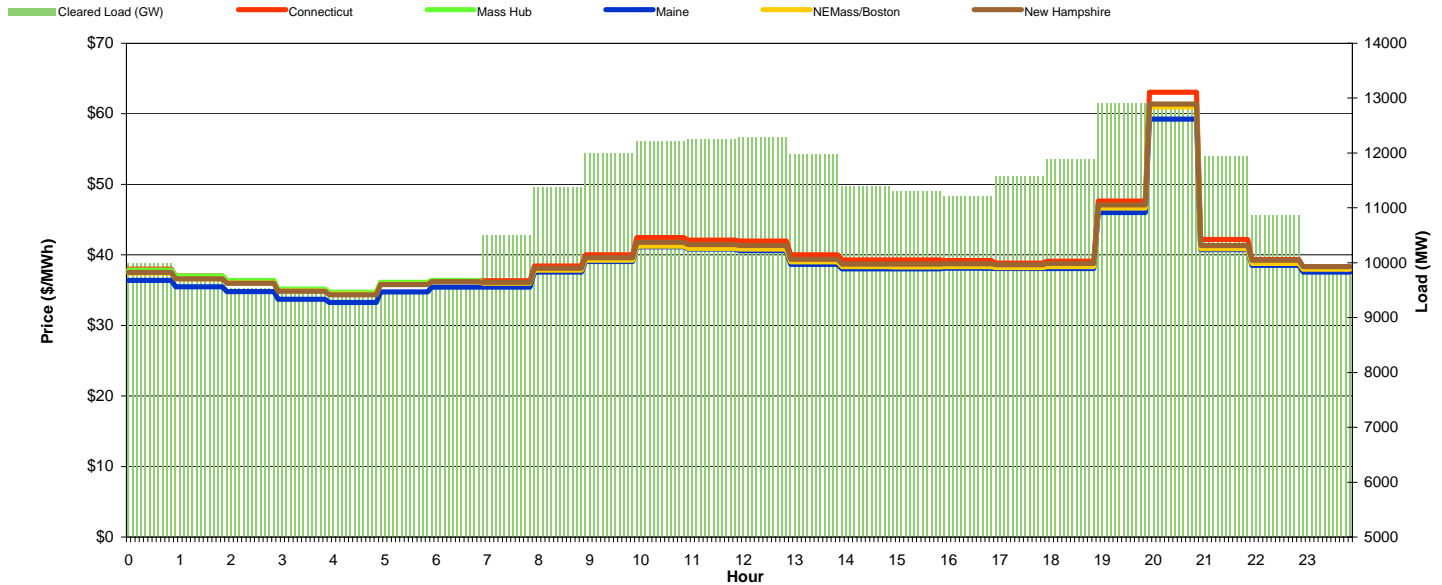

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$	
<b>Connecticut</b>	35.67	33.78	32.73	31.70	32.19	32.96	33.08	33.16	33.65	36.24	39.53	39.19	36.54	34.09	35.03	35.00	35.71	34.26	35.74	41.63	44.38	47.20	35.62	32.98	35.92	37.31
<b>NEMass/Boston</b>	35.11	33.23	32.26	31.37	31.83	32.53	32.77	32.94	33.36	35.68	38.57	38.19	35.66	33.37	34.26	34.12	34.80	33.66	34.96	40.72	43.23	45.63	34.86	32.54	35.24	36.50
<b>New Hampshire</b>	34.97	33.12	32.13	31.24	31.72	32.47	32.77	32.95	33.36	35.72	38.64	38.21	35.63	33.31	34.20	34.08	34.77	33.57	34.92	40.69	43.26	45.65	34.96	32.55	35.20	36.50
<b>Maine</b>	33.61	31.68	30.64	29.97	30.46	31.19	31.78	32.08	32.35	34.56	37.12	36.65	34.11	32.01	32.74	32.63	33.34	32.35	33.64	38.97	41.51	43.70	33.87	31.58	33.86	35.10
<b>Mass Hub</b>	35.29	33.48	32.50	31.55	32.03	32.75	32.93	33.02	33.39	35.76	38.75	38.37	35.82	33.47	34.37	34.27	34.97	33.72	35.09	40.84	43.28	45.86	34.98	32.59	35.38	36.62
<b>DA Forecast Load (GW)</b>	10.50	9.89	9.50	9.30	9.29	9.53	9.87	10.83	11.88	12.53	12.84	13.13	13.04	12.56	12.30	12.08	12.03	12.21	12.47	13.49	13.84	13.13	12.01	10.89		
<b>Forecast Error %</b>	4.9%	9.1%	12.3%	12.5%	12.4%	10.7%	6.4%	2.0%	-0.4%	-0.8%	-0.5%	-1.9%	-2.3%	-1.8%	-3.0%	-3.0%	-2.4%	-2.4%	-2.0%	-3.9%	-2.9%	-2.7%	-3.2%	-2.6%		

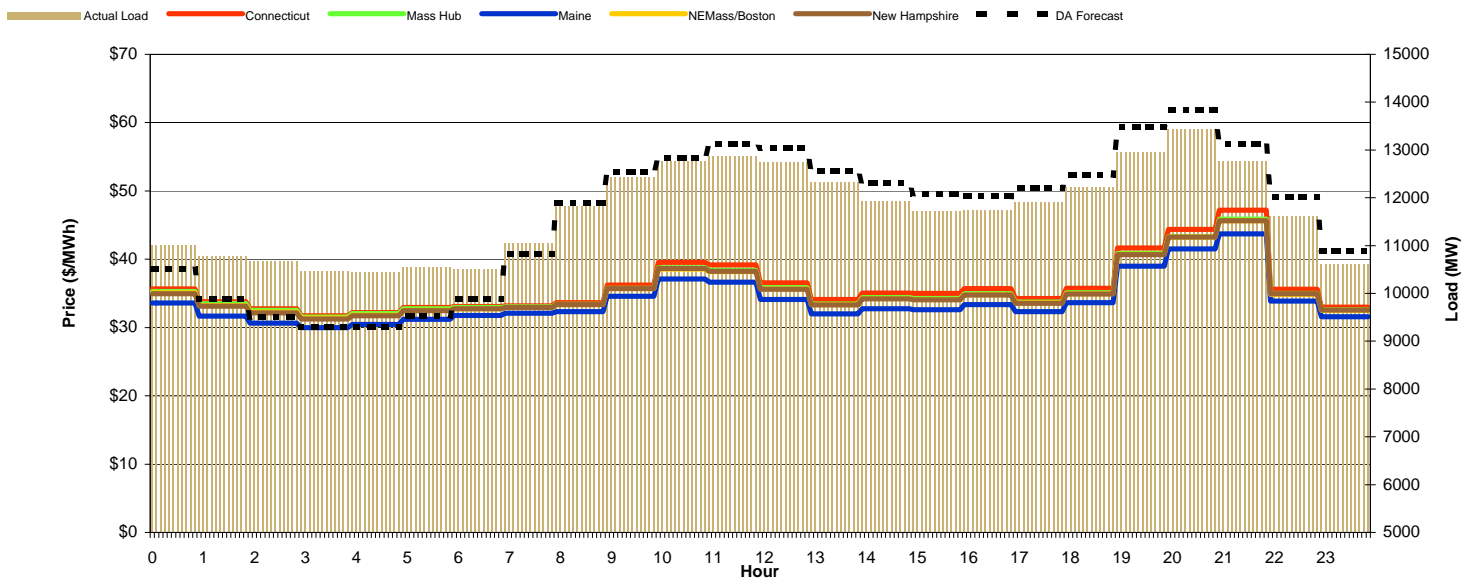






# ISO-NE Daily Report

Monday April 25, 2011

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	38.16	37.00	35.11	33.53	35.13	36.71	39.47	44.15	48.47	51.43	54.93	63.00	58.23	59.16	52.00	50.00	49.15	51.37	46.83	56.24	61.64	44.00	40.00	39.04	46.86	51.91	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	38.09	37.02	34.80	33.34	34.75	36.43	38.65	42.51	46.49	49.51	52.77	60.52	55.94	56.88	50.01	48.12	47.33	49.53	45.15	54.37	59.29	42.26	38.59	38.28	45.44	49.95		
<b>New Hampshire</b>	38.18	37.07	34.78	33.29	34.73	36.52	39.12	43.08	47.06	50.13	53.37	61.07	56.47	57.39	50.49	48.57	47.80	49.96	45.69	54.89	59.82	42.54	38.57	38.35	45.79	50.43		
<b>Maine</b>	37.27	36.14	33.92	32.48	33.95	35.92	39.10	43.06	45.91	49.03	51.74	50.00	48.00	47.00	45.82	45.00	45.00	45.00	44.59	50.92	50.35	41.23	37.39	37.34	42.76	46.25		
<b>Mass Hub</b>	38.08	37.05	35.00	33.50	34.94	36.47	38.79	42.75	46.85	49.84	53.13	60.92	56.32	57.25	50.35	48.44	47.64	49.86	45.45	54.70	59.59	42.50	38.70	38.44	45.69	50.27		
<b>Cleared Load (GW)</b>	9.1	9.0	9.1	9.1	9.3	9.6	11.4	13.0	13.4	13.7	13.8	13.9	13.8	13.8	13.6	13.6	13.6	13.7	13.7	14.1	13.9	12.8	11.4	10.1				

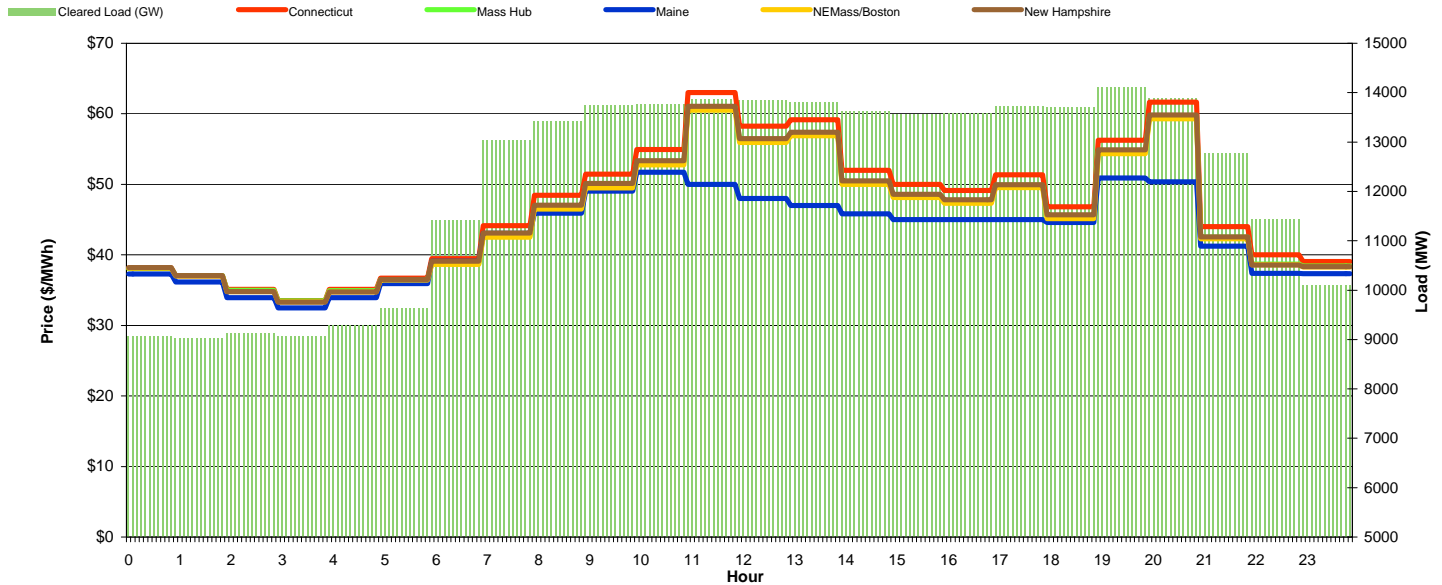

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	34.38	33.08	32.99	33.38	35.31	34.58	41.34	48.87	49.02	55.98	59.28	47.98	53.69	62.90	58.21	55.04	62.75	57.72	43.90	51.37	50.68	41.04	38.13	36.36	46.58	52.29	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	33.93	32.97	32.81	33.24	35.02	34.13	40.34	47.21	47.21	53.90	57.04	46.19	51.75	60.27	55.76	52.58	60.51	55.94	42.49	49.92	48.93	39.48	36.48	35.27	45.14	50.35		
<b>New Hampshire</b>	33.95	32.86	32.64	33.08	34.87	34.13	40.42	47.37	47.49	54.23	57.36	46.43	51.97	60.50	56.04	52.78	60.80	56.26	42.78	50.20	49.11	39.42	36.25	35.09	45.25	50.56		
<b>Maine</b>	32.95	32.01	31.81	32.34	34.21	33.76	40.30	46.89	46.94	53.31	56.05	45.38	50.58	58.58	54.52	51.32	58.63	54.32	41.70	48.99	47.81	38.14	34.64	33.76	44.12	49.24		
<b>Mass Hub</b>	34.06	33.00	32.86	33.29	35.09	34.27	40.52	47.51	47.50	54.19	57.35	46.38	51.98	60.66	56.17	53.03	60.73	56.12	42.69	50.10	49.12	39.71	36.86	35.53	45.36	50.63		
<b>DA Forecast Load (GW)</b>	10.14	9.67	9.46	9.44	9.74	10.77	12.59	13.96	14.52	14.87	15.16	15.27	15.20	15.15	14.98	14.82	14.88	15.05	15.05	15.38	15.38	14.30	12.80	11.43				
<b>Forecast Error %</b>	1.2%	2.9%	5.0%	4.2%	2.1%	-1.6%	-4.0%	-2.6%	-1.7%	-1.5%	-1.5%	-1.7%	-1.9%	-1.6%	-1.7%	-1.5%	-2.0%	-2.5%	-2.7%	-2.9%	-1.1%	-0.5%	-0.3%	-0.2%				

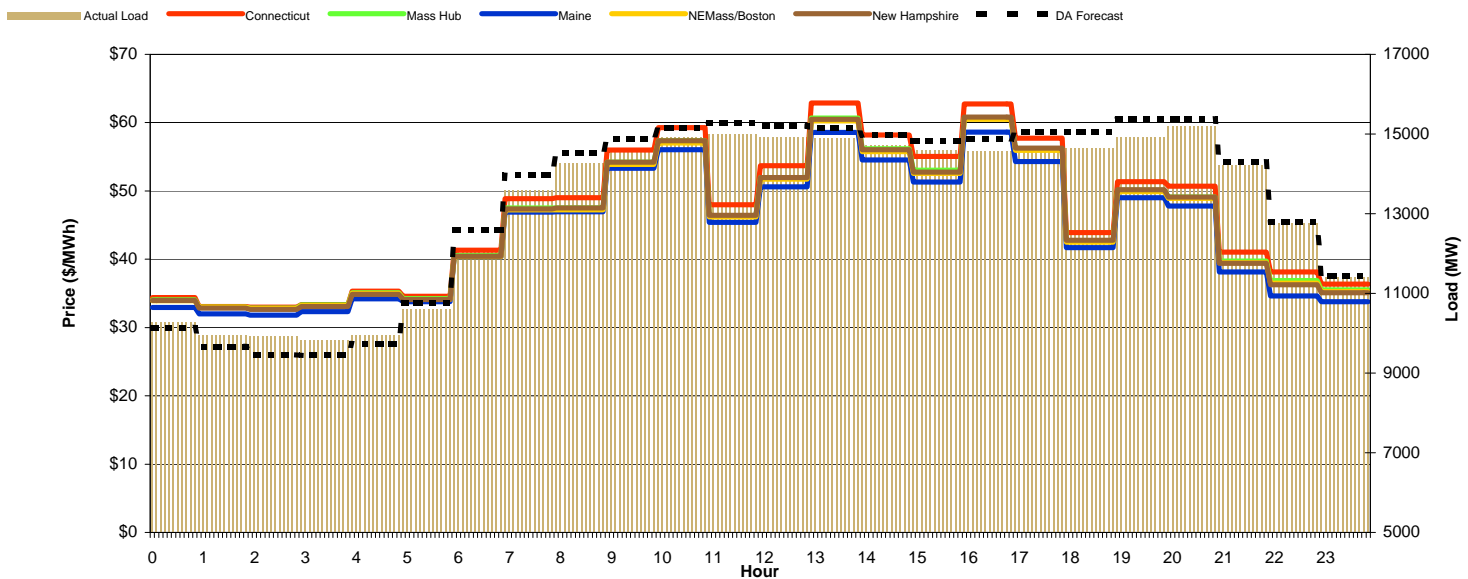




# ISO-NE Daily Report

Tuesday April 26, 2011

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$				
<b>Connecticut</b>	36.59	34.95	33.61	33.66	35.05	36.46	39.30	39.84	42.48	45.72	51.82	55.28	56.82	57.19	55.34	53.61	56.75	53.62	43.98	50.37	61.80	40.24	39.64	38.60	38.60	45.53	50.28	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	35.93	34.59	33.39	33.42	34.67	35.99	38.36	38.70	41.23	44.44	50.37	53.63	54.84	55.06	53.23	51.47	54.39	51.63	42.41	48.81	59.43	39.00	38.43	38.10	44.23	48.57			
<b>New Hampshire</b>	35.73	34.49	33.27	33.31	34.60	35.95	38.64	39.14	41.66	44.97	50.88	54.01	55.26	55.46	53.55	51.86	54.68	52.00	42.82	49.25	59.85	39.14	38.44	38.14	44.46	48.94			
<b>Maine</b>	34.65	33.60	32.38	32.40	33.73	35.06	38.41	40.98	42.17	46.87	50.00	52.60	53.70	54.00	51.96	50.09	52.85	50.61	42.06	48.52	58.55	38.36	34.73	37.60	43.58	48.00			
<b>Mass Hub</b>	36.14	34.79	33.49	33.57	34.89	36.21	38.65	38.82	41.47	44.62	50.53	53.93	55.09	55.35	53.47	51.69	54.74	51.96	42.59	48.97	59.70	39.12	38.59	38.22	44.44	48.79			
<b>Cleared Load (GW)</b>	9.5	9.5	9.2	9.2	9.5	10.0	11.8	13.3	13.9	14.2	14.3	14.6	14.3	14.2	14.0	13.8	13.8	14.0	13.9	14.3	14.0	13.4	11.8	10.4					

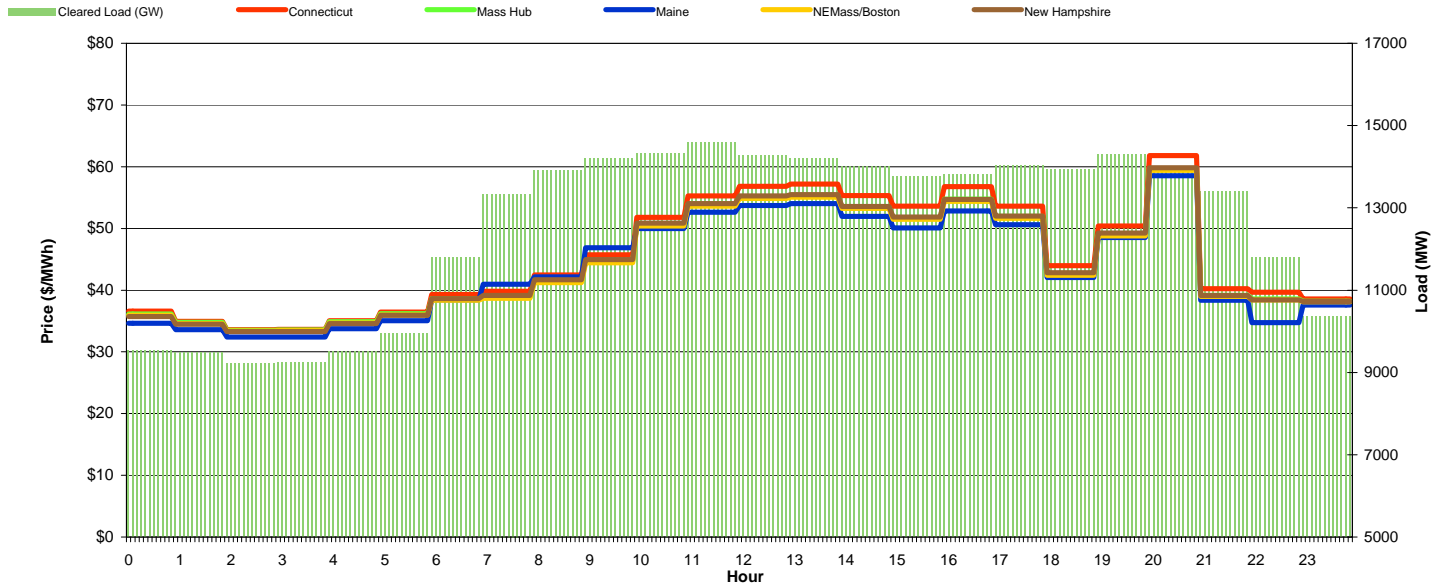

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	41.58	36.28	36.19	35.64	36.63	36.79	39.43	48.05	42.14	62.65	66.62	41.53	41.23	58.10	48.76	51.91	54.48	46.85	42.82	50.70	52.70	50.69	36.04	38.46	45.68	49.70	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	40.59	35.75	35.64	34.93	35.89	36.21	38.31	46.58	40.95	60.83	64.42	40.20	39.89	55.61	46.76	49.56	51.79	44.74	41.10	48.96	50.60	48.60	34.63	37.64	44.17	47.83		
<b>New Hampshire</b>	40.37	35.47	35.39	34.51	35.50	36.16	38.44	46.80	41.19	61.16	64.89	40.47	40.07	55.81	46.94	49.76	51.95	44.90	41.34	49.19	50.65	48.48	34.50	37.55	44.23	48.01		
<b>Maine</b>	38.91	34.43	34.32	33.60	34.64	35.52	38.14	46.19	40.53	59.99	63.79	39.78	39.27	53.83	45.64	48.50	50.39	43.75	40.58	48.31	49.03	39.76	31.25	34.12	42.68	46.29		
<b>Mass Hub</b>	40.89	35.92	35.85	35.22	36.18	36.43	38.60	46.82	41.12	61.06	64.67	40.31	40.03	56.00	47.06	49.89	52.20	45.06	41.35	49.17	50.84	48.95	34.89	37.78	44.43	48.09		
<b>DA Forecast Load (GW)</b>	10.46	9.95	9.67	9.61	9.84	10.78	12.58	14.11	14.71	15.09	15.40	15.55	15.57	15.58	15.53	15.38	15.37	15.25	14.99	15.24	15.48	14.55	12.98	11.53				
<b>Forecast Error %</b>	4.6%	5.6%	7.8%	6.2%	4.8%	3.8%	1.1%	-1.0%	-1.6%	-2.5%	-2.6%	-2.8%	-2.9%	-2.5%	-2.8%	-2.8%	-3.0%	-2.4%	-1.2%	-0.6%	-0.3%	-0.4%	0.0%	0.1%				

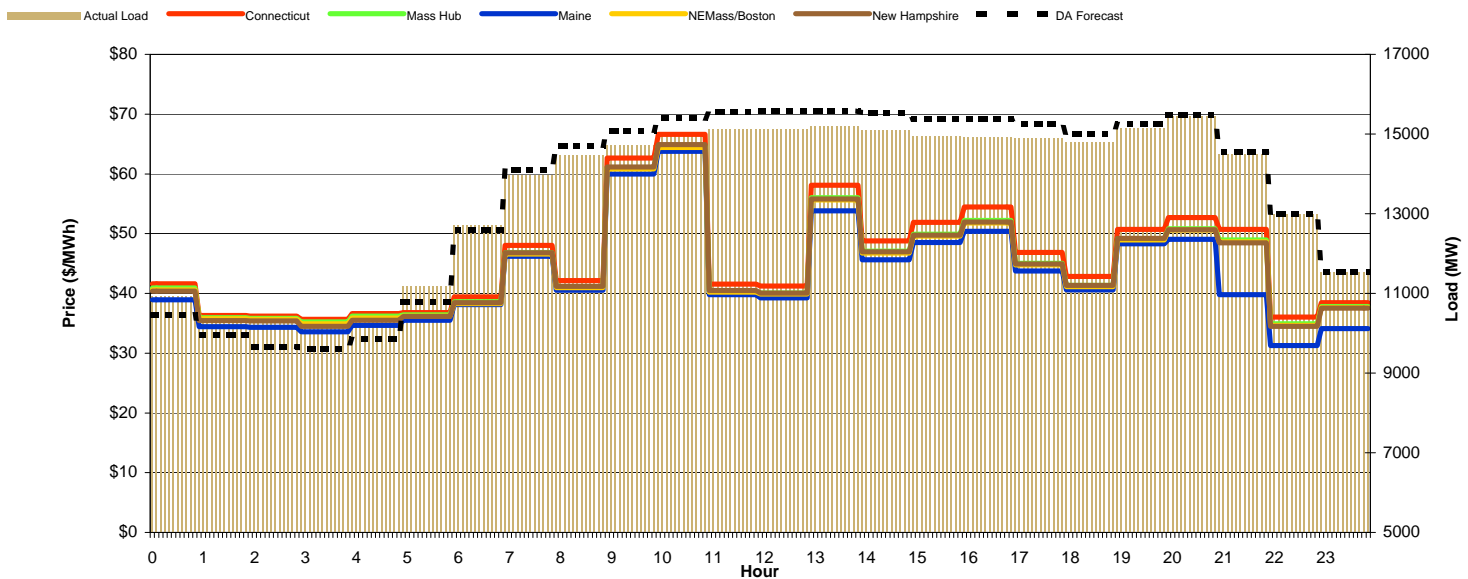




# ISO-NE Daily Report

Wednesday April 27, 2011

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	38.00	36.54	35.36	35.14	35.67	38.07	39.12	42.93	46.31	50.77	56.89	63.00	64.25	64.76	63.00	61.95	65.49	60.84	44.42	49.48	62.60	43.01	39.42	38.89	49.00	54.95	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	37.52	36.16	35.18	34.91	35.45	37.70	38.38	41.44	44.66	48.93	54.99	60.82	61.87	62.28	60.55	59.42	62.81	58.41	42.74	47.69	60.00	41.52	38.40	38.30	47.51	52.91		
<b>New Hampshire</b>	37.24	35.82	34.83	34.59	35.13	37.54	38.30	41.60	44.75	49.05	55.15	60.94	61.95	62.39	60.65	59.60	63.12	58.70	42.94	47.93	60.18	41.62	38.19	38.15	47.52	53.05		
<b>Maine</b>	32.22	32.02	31.93	32.05	32.20	36.57	37.19	39.96	41.61	46.64	49.53	47.02	47.69	42.79	41.59	41.78	41.93	41.78	40.13	44.18	45.02	38.51	28.19	39.66	39.67	42.40		
<b>Mass Hub</b>	37.70	36.32	35.29	35.05	35.58	37.84	38.56	41.69	45.00	49.21	55.20	61.10	62.19	62.61	60.92	59.82	63.25	58.87	42.97	47.94	60.38	41.71	38.45	38.42	47.75	53.21		
<b>Cleared Load (GW)</b>	9.9	9.5	9.4	9.3	9.4	10.2	11.9	13.5	13.9	14.3	14.5	14.4	14.2	14.0	13.9	13.8	13.8	13.9	13.8	14.2	14.0	13.2	11.9	10.4				

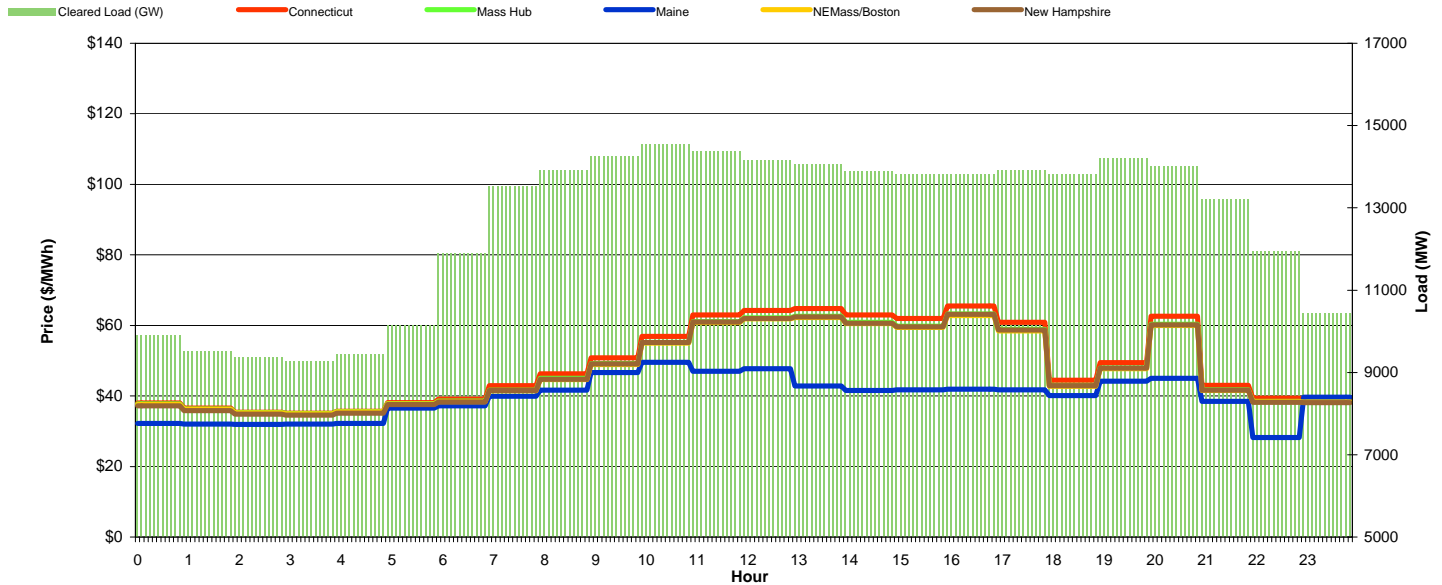

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	50.63	44.81	36.22	36.14	36.98	52.12	46.99	59.58	64.16	59.13	63.40	64.83	64.40	64.78	63.80	68.82	65.07	65.17	48.32	60.25	126.22	40.76	41.45	43.62	56.99	63.76	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	49.82	44.21	35.90	36.09	36.89	51.65	45.72	57.91	62.49	56.11	61.44	62.90	62.67	62.81	62.01	66.82	63.18	63.01	46.56	58.51	122.45	39.99	40.63	42.63	55.52	61.84		
<b>New Hampshire</b>	49.50	43.80	35.52	35.67	36.46	51.15	45.50	57.55	62.21	55.98	61.30	62.72	62.48	62.73	61.85	66.61	63.04	62.83	46.49	58.36	122.20	39.95	40.55	42.57	55.29	61.68		
<b>Maine</b>	35.01	34.84	34.45	34.34	35.33	38.72	44.36	46.35	48.79	48.61	51.54	53.29	51.68	51.30	51.39	64.41	61.23	58.56	44.86	53.52	76.60	37.67	38.11	38.78	47.24	52.37		
<b>Mass Hub</b>	49.99	44.32	35.98	36.10	36.89	51.74	45.99	58.08	62.58	56.33	61.65	63.00	62.70	62.90	62.06	66.89	63.27	63.27	46.82	58.70	122.88	40.04	40.73	42.82	55.66	61.99		
<b>DA Forecast Load (GW)</b>	10.50	9.95	9.65	9.58	9.83	10.78	12.53	14.03	14.67	15.10	15.42	15.56	15.58	15.60	15.53	15.45	15.42	15.31	14.99	15.18	15.40	14.45	12.93	11.59				
<b>Forecast Error %</b>	3.0%	5.9%	9.5%	12.0%	9.1%	3.8%	1.6%	0.5%	-0.2%	-0.9%	-0.9%	-1.0%	-0.7%	-0.2%	-0.2%	-0.4%	-0.8%	-0.5%	1.0%	2.1%	1.8%	1.6%	2.3%	2.6%				

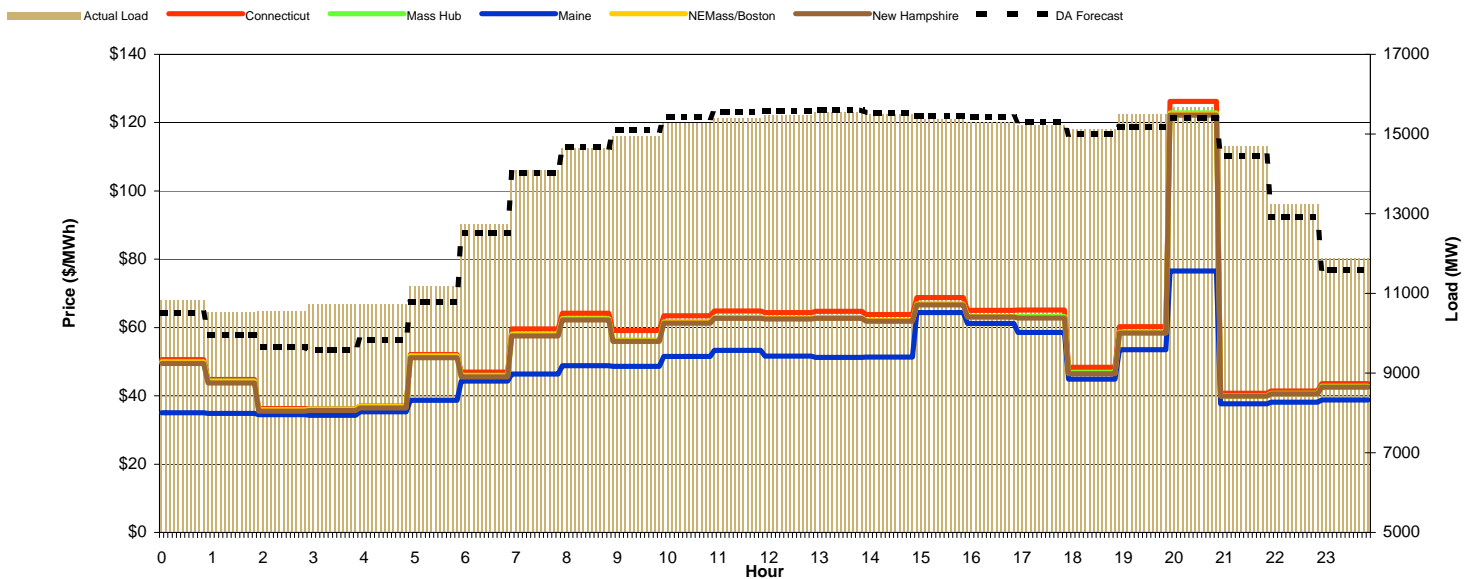




# ISO-NE Daily Report

Thursday April 28, 2011

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	38.06	37.12	36.74	35.90	36.96	38.48	39.14	55.00	57.54	61.80	66.05	62.05	63.04	65.00	60.09	59.38	58.06	58.63	52.00	57.14	56.18	45.19	39.84	38.75	38.75	50.76	57.31	
<b>NEMass/Boston</b>	37.53	36.57	36.31	35.54	36.61	38.00	38.42	53.09	55.50	59.72	63.85	60.13	61.06	62.67	58.10	57.46	56.38	56.79	49.99	55.11	54.38	43.51	38.46	38.17	49.31	55.39	49.31	55.39
<b>New Hampshire</b>	37.47	36.47	36.20	35.47	36.49	38.05	38.41	53.32	55.75	60.04	64.15	60.34	61.19	62.91	58.23	57.69	56.59	57.03	50.27	55.34	54.49	43.58	38.20	38.07	49.41	55.57	49.41	55.57
<b>Maine</b>	36.39	35.22	35.04	34.55	35.24	37.25	40.73	51.57	53.82	58.02	61.77	58.00	58.00	58.00	55.00	55.53	54.60	55.00	48.53	53.42	52.67	42.00	35.60	37.30	47.64	53.22	47.64	53.22
<b>Mass Hub</b>	37.93	36.97	36.68	35.85	36.92	38.33	38.70	53.52	55.93	60.00	64.08	60.23	61.31	63.00	58.43	57.78	56.61	57.10	50.29	55.35	54.54	43.80	38.72	38.41	49.60	55.67	49.60	55.67
<b>Cleared Load (GW)</b>	10.3	9.9	9.9	9.8	10.0	10.3	12.2	13.4	13.8	14.1	14.2	14.4	14.3	14.1	14.1	14.0	14.3	14.1	13.6	14.0	14.3	13.2	12.1	10.5				

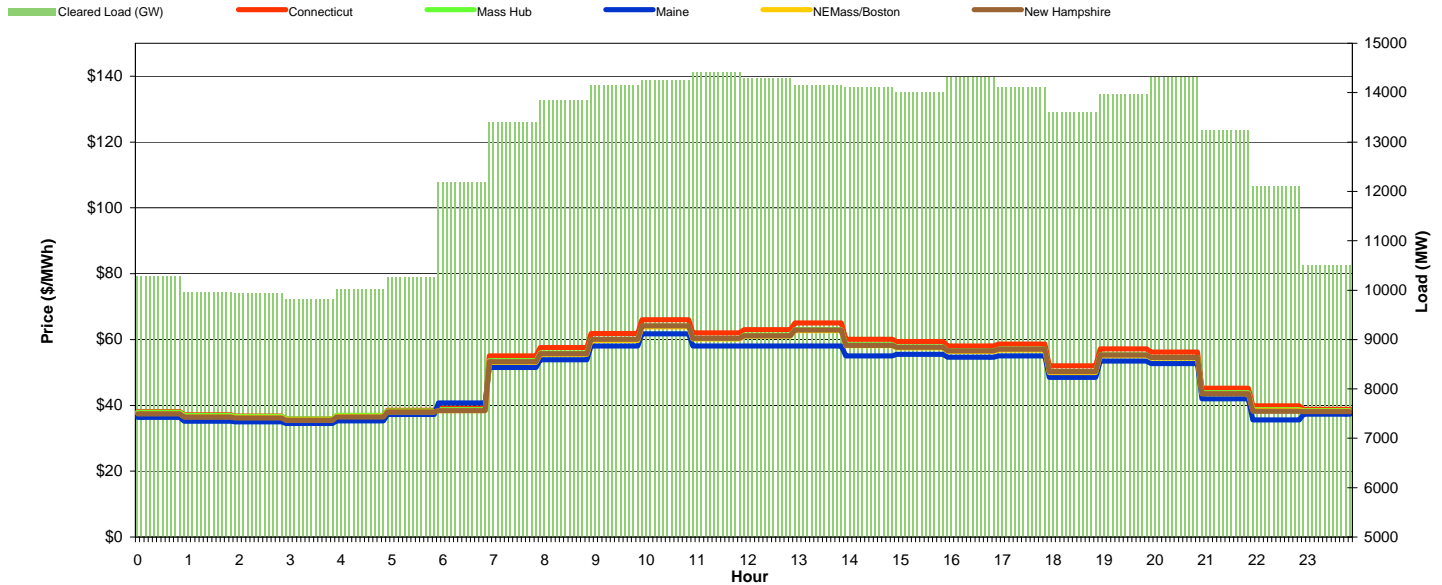

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	47.73	38.38	36.92	37.04	37.22	41.23	54.54	71.37	77.42	141.76	66.84	48.02	43.36	57.72	47.47	43.43	44.89	48.54	0.00	0.00	0.00	0.00	0.00	0.00	41.00	43.18	41.00	43.18
<b>NEMass/Boston</b>	46.95	37.83	36.50	36.68	36.93	40.81	53.44	69.98	75.99	139.37	65.84	47.03	42.52	56.15	46.18	42.29	43.87	47.19	0.00	0.00	0.00	0.00	0.00	0.00	40.23	42.28	40.23	42.28
<b>New Hampshire</b>	46.77	37.64	36.33	36.51	36.79	40.63	53.21	69.68	75.53	138.80	65.58	46.86	42.28	55.92	45.99	42.12	43.67	46.96	0.00	0.00	0.00	0.00	0.00	0.00	40.05	42.09	40.05	42.09
<b>Maine</b>	41.78	36.65	35.40	35.58	35.92	39.84	50.24	65.67	53.69	73.37	49.50	42.55	40.45	45.76	42.40	40.65	41.17	42.55	0.00	0.00	0.00	0.00	0.00	0.00	33.88	33.61	33.88	33.61
<b>Mass Hub</b>	47.18	38.07	36.74	36.93	37.17	40.97	53.70	70.12	76.01	139.39	65.86	47.09	42.50	56.23	46.26	42.37	43.89	47.31	0.00	0.00	0.00	0.00	0.00	0.00	40.32	42.31	40.32	42.31
<b>DA Forecast Load (GW)</b>	10.64	10.11	9.84	9.75	9.99	10.87	12.61	14.00	14.63	15.06	15.37	15.49	15.46	15.48	15.32	15.11	15.00	14.85	14.76	15.03	15.12	14.21	12.78	11.44				
<b>Forecast Error %</b>	6.9%	7.4%	10.9%	12.9%	12.0%	4.5%	1.9%	2.8%	2.7%	2.4%	2.2%	2.1%	1.9%	1.7%	1.9%	2.6%	3.4%	4.3%	#####	#####	#####	#####	#####	#####				

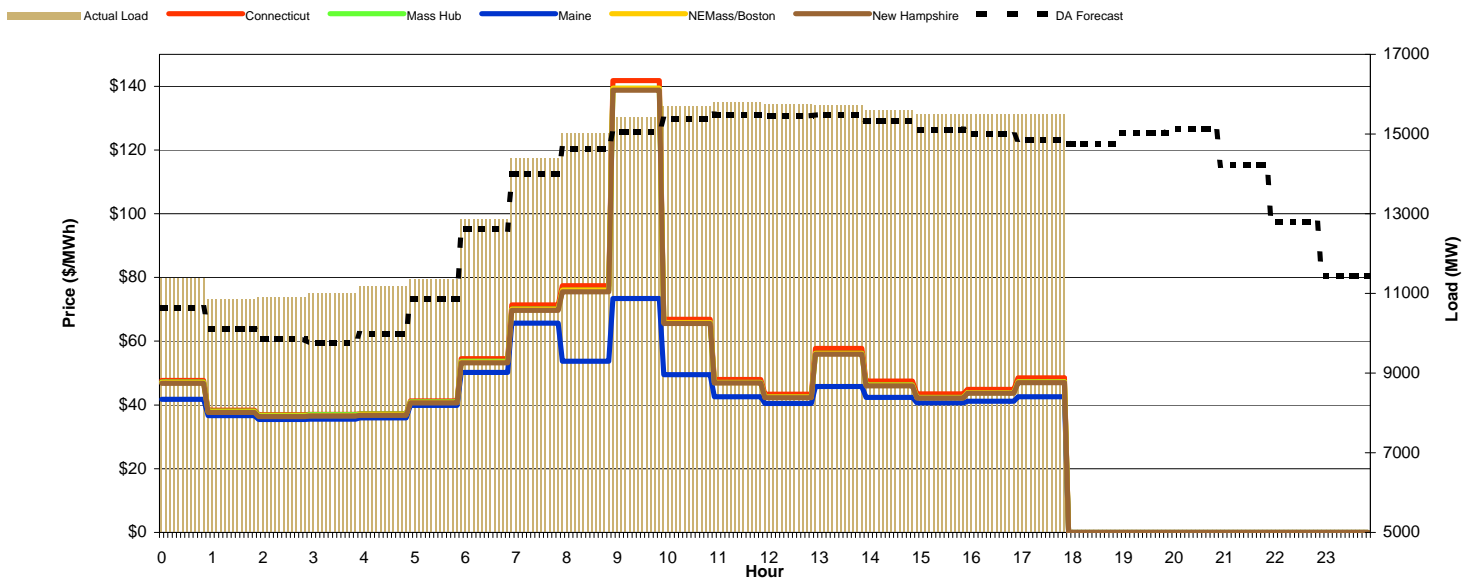




# ISO-NE Daily Report

Friday April 29, 2011

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%


## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	38.11	35.53	33.93	33.59	34.27	38.01	40.51	48.40	62.79	64.81	64.81	63.68	55.48	65.00	44.05	43.04	42.86	42.45	43.27	44.07	58.28	46.35	40.84	39.79	46.83	51.89	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	37.42	35.09	33.79	33.52	34.10	37.47	39.74	42.08	42.42	54.09	58.21	52.78	45.41	44.87	42.90	41.88	41.70	41.27	41.69	42.78	56.16	44.53	39.33	39.03	42.59	45.76		
<b>New Hampshire</b>	37.09	34.79	33.47	33.17	33.84	37.18	39.63	42.12	42.43	54.04	58.08	52.60	45.30	44.73	42.78	41.76	41.60	41.09	41.58	42.66	55.88	44.34	39.02	38.58	42.41	45.63		
<b>Maine</b>	32.47	32.19	28.21	25.03	31.15	34.15	38.94	40.80	41.01	52.00	55.00	50.52	44.12	43.50	41.86	40.86	40.78	40.18	40.67	41.73	53.97	42.94	37.50	37.44	40.29	44.22		
<b>Mass Hub</b>	37.84	35.47	34.06	33.74	34.42	37.86	40.04	42.23	42.61	54.37	58.50	53.06	45.60	45.13	43.08	42.03	41.89	41.40	41.87	42.96	56.67	44.88	39.64	39.26	42.86	46.00		
<b>Cleared Load (GW)</b>	10.6	10.3	10.0	9.9	10.1	10.8	12.0	13.4	13.5	13.7	14.0	14.1	14.1	13.8	13.7	13.7	13.6	13.4	13.2	13.9	13.8	12.7	11.7	10.6				

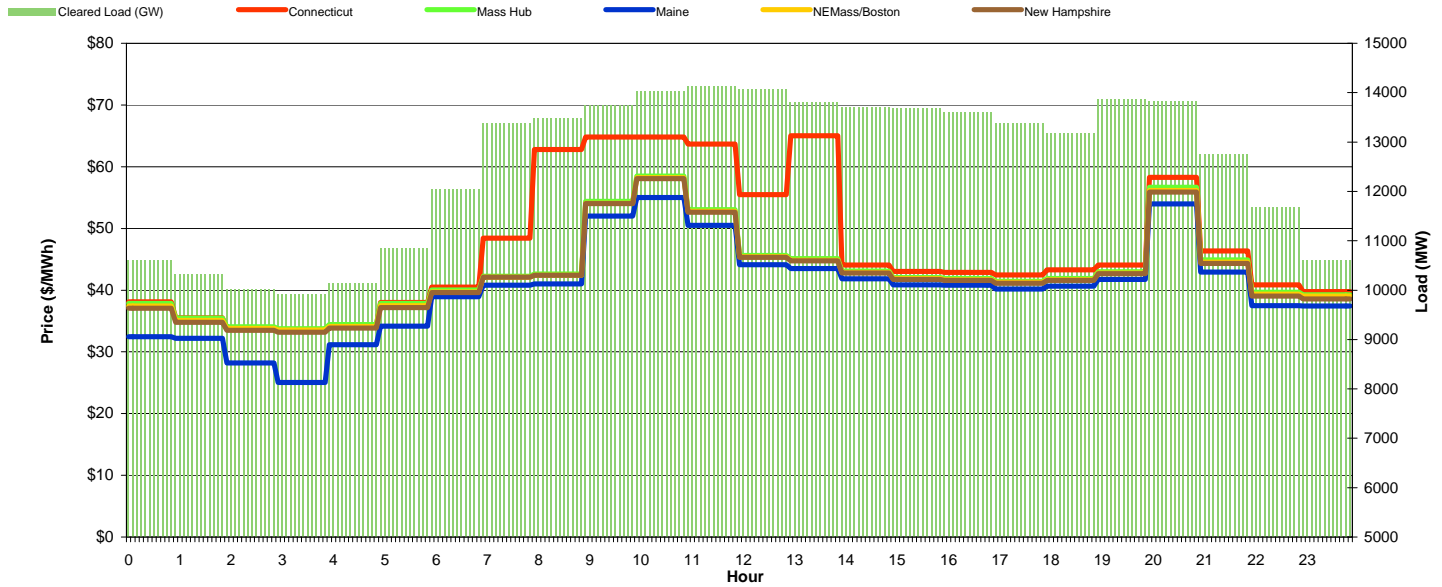

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	38.41	34.76	33.94	33.57	33.69	38.43	36.47	40.84	45.10	45.78	42.98	58.86	59.30	58.60	46.61	41.12	36.85	36.38	37.00	43.37	47.89	55.57	40.54	38.66	42.70	46.05	<b>All</b>	<b>On Pk</b>
<b>NEMass/Boston</b>	37.82	34.37	33.80	33.51	33.67	37.94	35.76	39.98	43.98	44.46	41.69	57.32	57.49	56.88	45.32	40.13	36.05	35.63	36.09	42.46	46.70	53.82	39.01	37.96	41.74	44.81		
<b>New Hampshire</b>	37.46	34.10	33.52	33.18	33.41	37.78	35.52	39.62	43.63	44.10	41.32	56.75	56.84	56.21	44.79	39.69	35.62	35.21	35.71	42.05	46.30	53.23	38.58	37.60	41.34	44.35		
<b>Maine</b>	36.20	33.17	32.64	32.15	32.66	37.07	35.15	38.69	42.11	42.55	40.20	55.08	54.76	54.16	43.31	38.44	34.43	33.81	34.30	40.78	44.99	51.33	37.16	36.60	40.07	42.88		
<b>Mass Hub</b>	38.12	34.64	33.98	33.65	33.81	38.27	36.00	40.16	44.20	44.64	41.74	57.38	57.63	56.99	45.37	40.22	36.14	35.73	36.28	42.61	46.93	54.21	39.41	38.10	41.93	44.98		
<b>DA Forecast Load (GW)</b>	10.68	10.12	9.80	9.71	9.87	10.76	12.32	13.66	14.32	14.65	14.85	14.95	14.87	14.79	14.64	14.40	14.28	14.12	13.85	14.15	14.29	13.58	12.43	11.27				
<b>Forecast Error %</b>	7.5%	7.5%	7.7%	7.3%	7.5%	6.6%	1.0%	-0.5%	-0.4%	0.1%	0.8%	0.8%	1.2%	1.6%	1.4%	1.4%	1.0%	0.5%	0.5%	-0.9%	0.7%	1.1%	1.2%	0.7%				

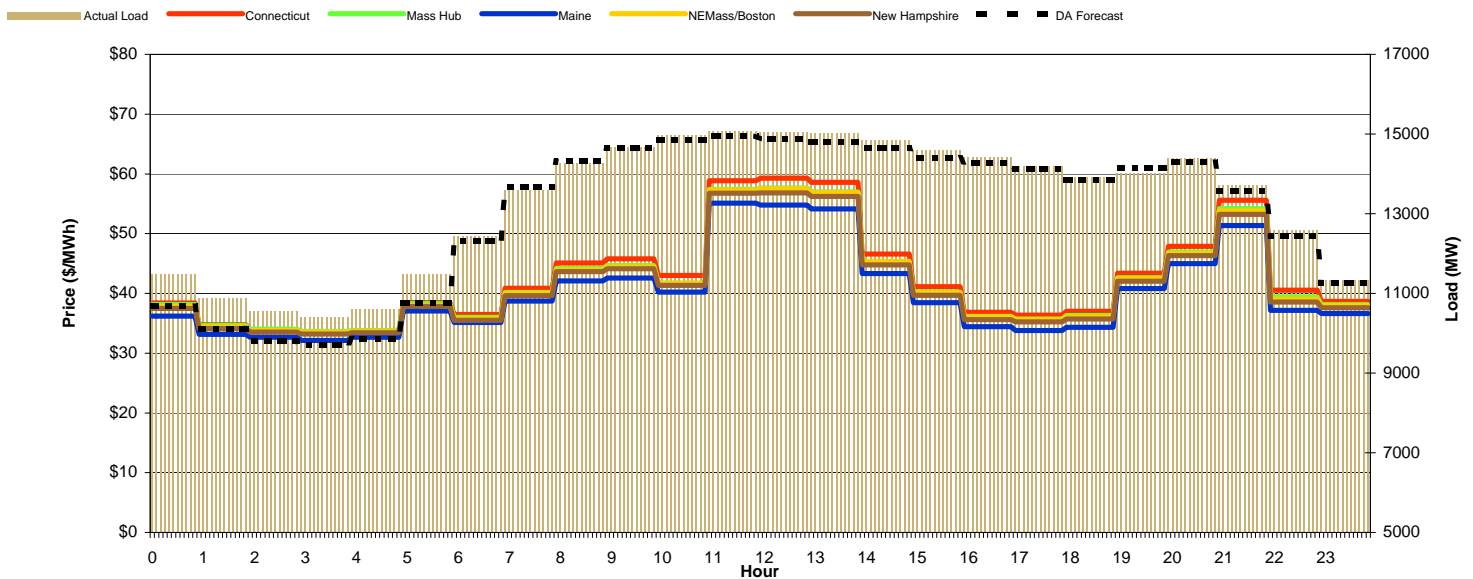




# ISO-NE Daily Report

Saturday April 30, 2011

<b>Price</b>	<=0	>=100	>=200
<b>Forecast Error %</b>	0-4.9%	5-9.9%	>=10%

## Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$				
<b>Connecticut</b>	38.35	36.74	35.40	35.02	35.37	36.42	38.31	39.75	42.58	46.00	51.33	52.72	46.10	44.07	42.89	42.68	42.90	42.97	42.93	47.14	57.46	45.35	40.85	40.66	40.66	42.67	45.48	All	On Pk
<b>NEMass/Boston</b>	38.16	36.58	35.30	34.96	35.27	36.27	38.16	39.16	41.61	44.98	50.10	51.64	45.08	42.86	41.80	41.67	41.79	41.86	41.74	46.04	56.11	43.98	39.85	39.98	41.87	44.39	41.87	44.39	
<b>New Hampshire</b>	37.64	36.11	34.90	34.56	34.88	35.85	37.79	38.95	41.27	44.66	49.53	50.71	44.48	42.27	41.28	41.12	41.52	41.64	41.51	45.81	55.47	43.58	39.44	39.66	41.44	43.95	41.44	43.95	
<b>Maine</b>	36.62	35.19	33.97	33.64	33.97	35.00	37.06	38.09	40.44	43.42	48.00	48.92	43.06	41.03	40.31	40.13	40.53	40.83	40.62	44.62	53.57	42.09	38.47	38.93	40.35	42.76	40.35	42.76	
<b>Mass Hub</b>	38.31	36.72	35.51	35.15	35.47	36.51	38.28	39.14	41.64	45.03	50.22	51.66	45.02	42.88	41.80	41.71	41.95	41.94	41.76	46.01	56.22	44.08	39.96	40.21	41.97	44.44	41.97	44.44	
<b>Cleared Load (GW)</b>	9.9	9.6	9.4	9.3	9.4	9.7	9.8	10.5	11.4	12.3	12.5	12.5	12.3	11.9	11.6	11.5	11.6	11.8	11.6	12.3	12.8	11.9	11.0	10.1					

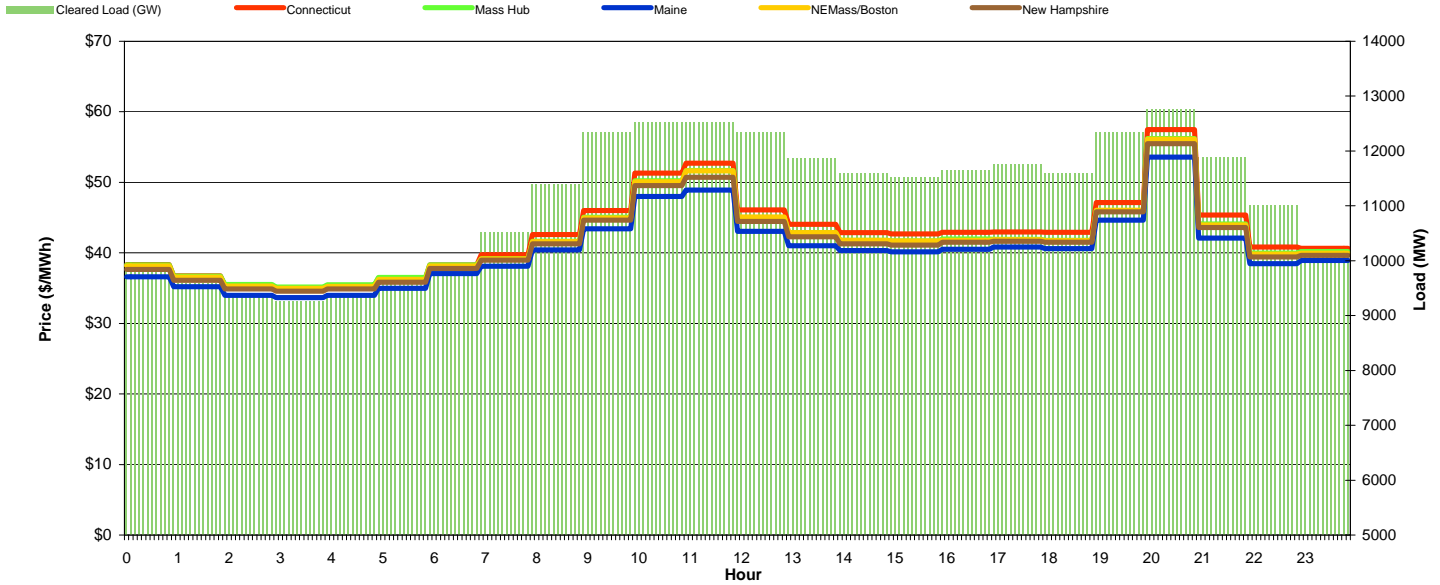

## Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
<b>Connecticut</b>	41.40	38.19	36.19	34.02	35.85	35.64	35.74	41.16	42.83	43.28	45.94	44.75	40.21	43.03	39.38	45.06	43.59	42.04	42.51	40.43	54.55	45.61	39.02	39.61	41.25	43.34	All	On Pk
<b>NEMass/Boston</b>	41.03	37.78	35.92	33.94	35.70	35.50	35.64	40.76	42.04	42.43	44.95	43.82	39.45	42.11	38.56	44.00	42.50	40.91	41.38	39.59	53.22	44.33	38.23	38.90	40.53	42.39	40.53	42.39
<b>New Hampshire</b>	40.48	37.23	35.44	33.51	35.28	35.06	35.22	40.34	41.66	41.99	44.36	43.19	38.83	41.60	38.10	43.50	42.06	40.42	40.93	39.16	52.61	43.80	37.74	38.50	40.04	41.89	40.04	41.89
<b>Maine</b>	39.40	36.18	34.64	32.76	34.54	34.23	34.73	39.88	41.22	41.13	43.19	42.14	37.84	40.57	37.23	42.54	41.19	39.23	39.82	38.25	51.05	42.45	36.88	37.69	39.12	40.91	39.12	40.91
<b>Mass Hub</b>	41.16	37.99	36.10	34.05	35.83	35.62	35.65	40.78	42.13	42.52	45.06	43.87	39.48	42.22	38.66	44.14	42.65	41.07	41.55	39.69	53.39	44.50	38.33	39.01	40.64	42.50	40.64	42.50
<b>DA Forecast Load (GW)</b>	10.36	9.86	9.55	9.39	9.43	9.80	10.26	11.28	12.36	13.03	13.24	13.21	13.03	12.73	12.54	12.40	12.46	12.58	12.64	13.01	13.44	12.92	11.98	10.97				
<b>Forecast Error %</b>	2.9%	4.8%	5.8%	7.3%	4.6%	3.3%	-0.8%	-1.6%	-1.8%	-1.8%	-1.2%	-0.6%	0.0%	0.7%	0.6%	0.8%	0.6%	0.9%	0.8%	-0.8%	0.5%	0.7%	0.6%	0.3%				

