
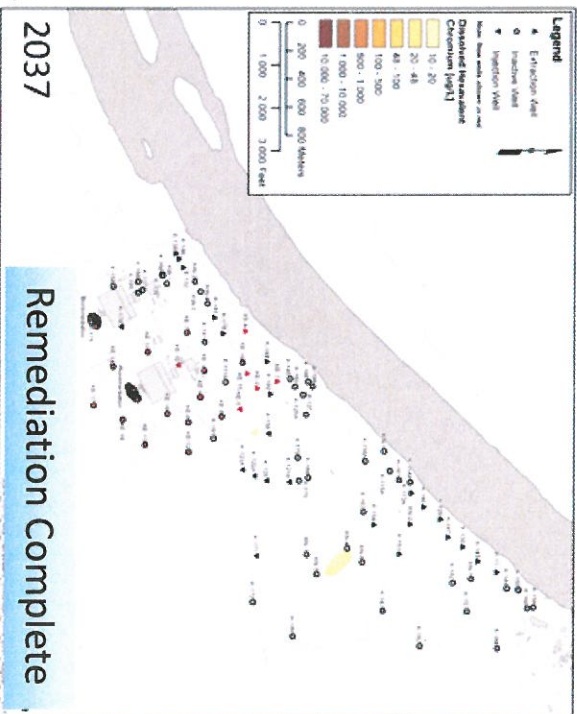
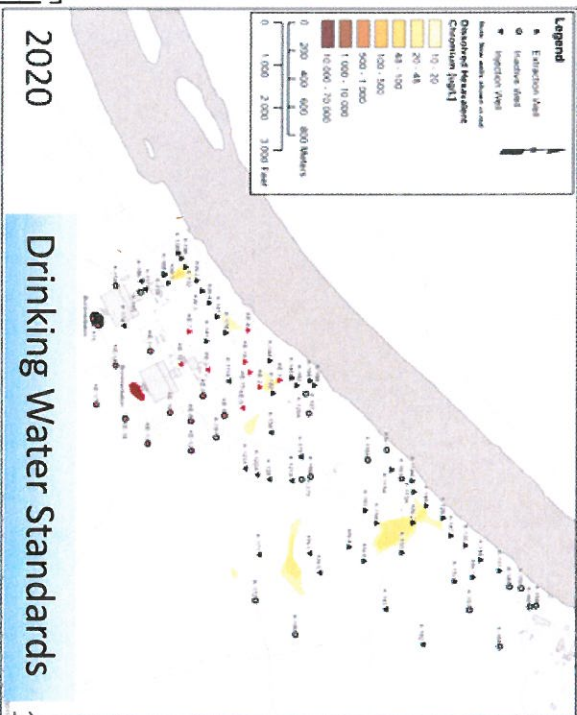
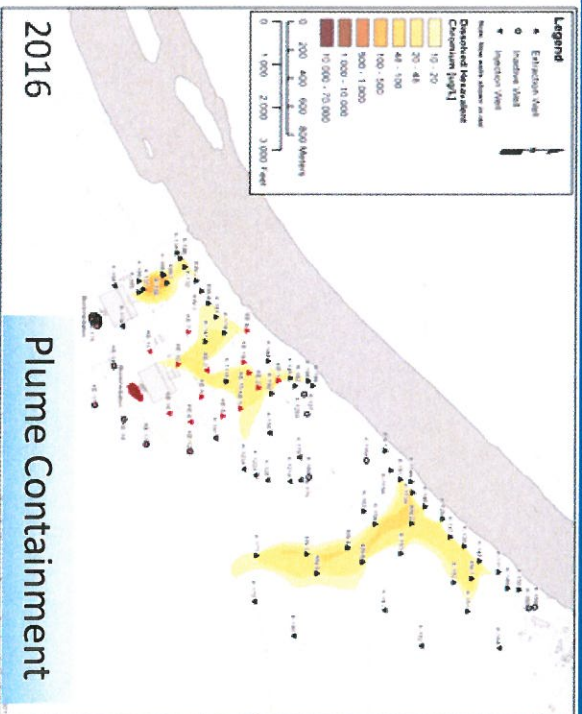


Preferred Remedy, continued

Alternative 2 – RTD & GW P&T Optimized with Other Technologies

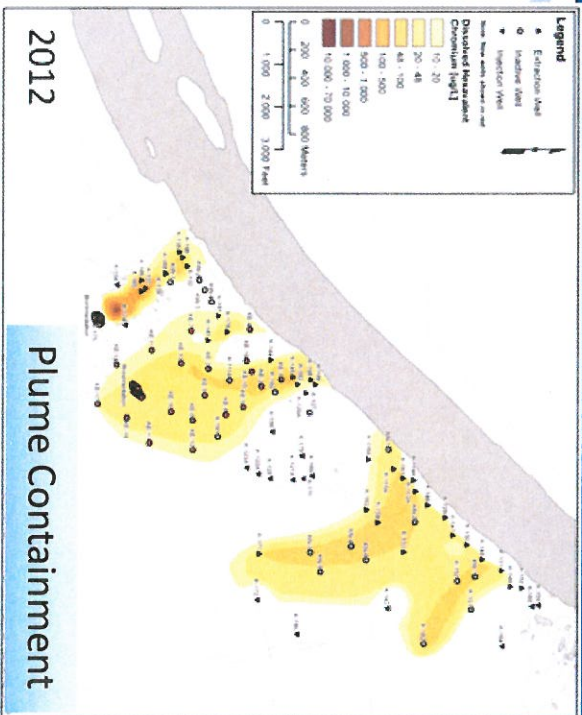

2020

Drinking Water Standards

2037

Remediation Complete