



US Army Corps
of Engineers ®
Northwestern Division


Missouri River Basin
Water Management Division

Final

AOP

2014-2015

Missouri River Mainstem System
2014-2015 Annual Operating Plan

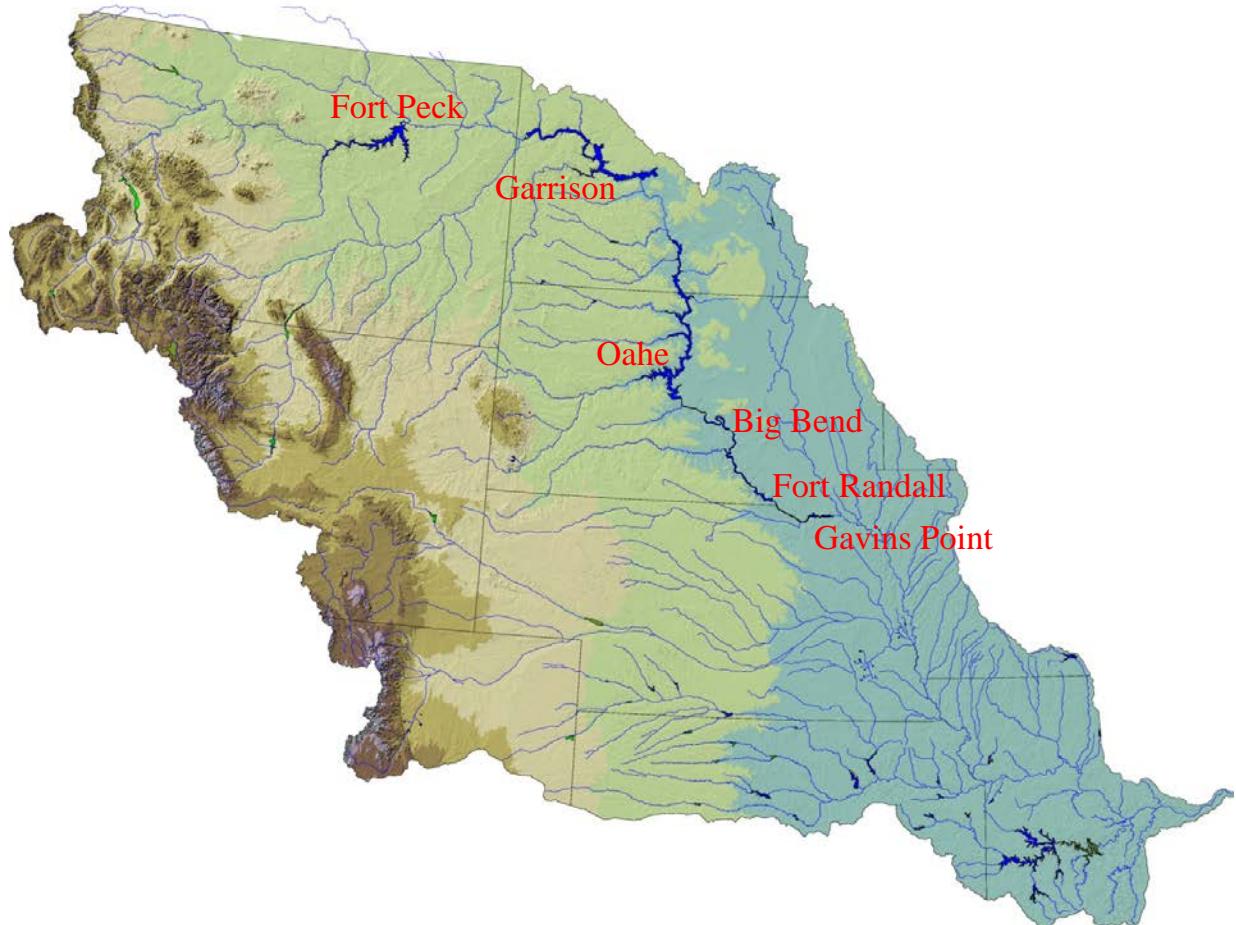

*Annual Operating Plan Process
62 Years Serving the Missouri River Basin*

December 2014



REPLY TO
ATTENTION OF

DEPARTMENT OF THE ARMY
CORPS OF ENGINEERS, NORTHWESTERN DIVISION
PO BOX 2870
PORTLAND OR 97208-2870

DEC 15 2014

Division Commander

Dear Stakeholders and Concerned Citizens:


This Annual Operating Plan (AOP) presents the Corps of Engineers' regulation of the Missouri River Mainstem Reservoir System through December 2015. The information in this AOP is based upon water management guidelines designed to meet the reservoir regulation objectives of the 2006 Missouri River Master Water Control Manual (Master Manual). Management of the reservoir system is provided by my staff at the Missouri River Basin Water Management Division, Northwestern Division, U.S. Army Corps of Engineers, located in Omaha, Nebraska.

The AOP presents plans for the regulation of the reservoir system under widely varying water supply conditions. The AOP is not intended to be a forecast for the coming year; rather the guidelines included in the Master Manual are applied to computer simulations of the reservoir system regulation assuming five statistically derived inflow scenarios based on an analysis of water supply records from 1898 to 2011. This approach provides a good range of water management simulation for dry, average, and wet conditions. The AOP provides a framework for the development of detailed monthly, weekly, and daily regulation schedules for the mainstem reservoir system's six individual dams during the upcoming year to serve its Congressionally-authorized project purposes.

A draft of this AOP was made available to the public in September 2014. Five public meetings were held across the basin in late October. As part of continued communication, monthly conference calls will be conducted by the Corps beginning in January 2015 with Federal, state, county and local officials, Tribes, emergency management officials, independent experts and the press to discuss conditions on the ground and current Corps' reservoir release plans and forecasts.

Runoff into the Missouri River basin was much above normal in 2014, refilling the reservoirs after dry conditions in 2012, and requiring evacuation of stored water. Increased releases through the fall ensured the reservoir system will have all flood storage available to begin the 2015 runoff season. We realize that the benefits provided by the reservoir system are vitally important to the Nation and the people that live and work in the Basin. We believe that the continued implementation of the Master Manual, and more specifically this AOP, will result in an appropriate balance of benefits provided to all of the people who rely on the reservoir system. Thank you for your interest in the regulation of the mainstem reservoir system.

Sincerely,



John S. Kem
Brigadier General, US Army
Division Commander

MISSOURI RIVER MAINSTEM RESERVOIR SYSTEM

Annual Operating Plan 2014 - 2015

List of Tables	ii
List of Plates.....	ii
List of Abbreviations	iii
Definition of Terms.....	iv
I. FOREWORD	1
II. BACKGROUND AND AOP PROCESS.....	2
III. MAINSTEM MASTER MANUAL AND ESA CONSULTATIONS	3
IV. ON-GOING COORDINATION, STUDIES AND REPORTS	5
V. FUTURE RUNOFF: SEPTEMBER 2014 – DECEMBER 2015	6
VI. ANNUAL OPERATING PLAN FOR 2014-2015	9
A. General.....	9
B. 2014-2015 AOP Simulations	9
C. Regulation for the Balance of 2014 Nav. Season and Fall of 2014....	12
D. Regulation Plan for Winter 2014-2015	13
E. Regulation During the 2015 Navigation Season.....	15
F. Regulation Activities for T&E Species and Fish Propagation	17
G. Regulation Activities for Historical and Cultural Properties	20
VII. SUMMARY OF RESULTS EXPECTED IN 2015	22
A. Flood Control.....	23
B. Water Supply and Water Quality Control	24
C. Irrigation.....	26
D. Navigation.....	26
E. Power	26
F. Recreation, Fish and Wildlife	28
G. Historic and Cultural Properties.....	28
H. System Storage	29
I. Summary of Water Use by Functions	30
VIII. TENTATIVE PROJECTION OF REGULATION THROUGH FEBRUARY 2021	32
A. Median Runoff.....	32

B.	Lower Quartile Runoff	37
C.	Lower Decile Runoff.....	37

TABLES

I	Upper Basic Runoff Percentages.....	6
II	Lower Basic Runoff Percentages.....	7
III	Natural and Net Runoff at Sioux City	8
IV	Navigation Service Support for the 2015 Season.....	16
V	Summary of 2014-2015 AOP Studies.....	22
VI	Peaking Capability and Sales	27
VII	Energy Generation and Sales	27
VIII	Anticipated December 31, 2015 System Storage.....	30
IX	Missouri River Mainstem System Water Use for Calendar Years 2013, 2014, and 2015 Above Sioux City, Iowa.....	31
X	Navigation Service Support, Spring Pulses, Unbalancing – AOP Extension Studies	33
XI	Median Extension Studies – Criteria Considered in the Modeling Process	34
XII	Lower Quartile Extension Studies – Criteria Considered in the Modeling Process	35
XIII	Lower Decile Extension Studies – Criteria Considered in the Modeling Process	36

PLATES

1	Missouri River Basin Map
2	Summary of Engineering Data
3	Summary of Master Manual Technical Criteria
4	System Storage and Fort Peck Elevations 2014-2015 AOP Simulation
5	Garrison and Oahe Elevations 2014-2015 AOP Simulation
6	System Storage 1953-2015
7	Gavins Point Releases 1953-2015
8	Fort Peck Elevations and Releases 1953-2015
9	Garrison Elevations and Releases 1953-2015
10	Oahe Elevations and Releases 1953-2015
11	Fort Randall Elevations and Releases 1953-2015
12	Reservoir Release and Unregulated Flow
13	System Gross Capability and Average Monthly Generation
14	Tentative Five Year Extensions of 2014-2015 AOP – System Storage, Gavins Point Regulated Flows, and System Peaking Capability
15	Tentative Five Year Extensions of 2014-2015 AOP – Fort Peck, Garrison, Oahe and Fort Randall
16	American Indian Reservations

ABBREVIATIONS

AOP	- annual operating plan
ACHP	- Advisory Council on Historic Preservation
AF	- acre-feet
B	- Billion
BiOp	- Biological Opinion
BOR	- Bureau of Reclamation
cfs	- cubic feet per second
Corps	- Corps of Engineers
CY	- calendar year (January 1 to December 31)
elev	- elevation
ESA	- Endangered Species Act
ft	- feet
FTT	- Flow-to-Target
FY	- fiscal year (October 1 to September 30)
GWh	- gigawatt hour
ISAP	- Independent Science Advisory Panel
KAF	- 1,000 acre-feet
kcfs	- 1,000 cubic feet per second
kW	- kilowatt
kWh	- kilowatt hour
MAF	- million acre-feet
MRNRC	- Missouri River Natural Resources Committee
msl	- mean sea level
MW	- megawatt
MWh	- megawatt hour
NEPA	- National Environmental Policy Act
plover	- piping plover
PA	- Programmatic Agreement
P-S MBP	- Pick-Sloan Missouri Basin Program
RCC	- Reservoir Control Center
RM	- river mile
RPA	- Reasonable and Prudent Alternative
SHPO	- State Historic Preservation Officers
SR	- Steady Release
System	- Missouri River Mainstem System
tern	- interior least tern
T&E	- Threatened and Endangered
THPO	- Tribal Historic Preservation Officers
USFWS	- United States Fish and Wildlife Service
WY	- water year
yr	- year

DEFINITION OF TERMS

Acre-foot (AF, ac-ft) is the quantity of water required to cover 1 acre to a depth of 1 foot and is equivalent to 43,560 cubic feet or 325,850 gallons.

Cubic foot per second (cfs) is the rate of discharge representing a volume of 1 cubic foot passing a given point during 1 second and is equivalent to approximately 7.48 gallons per second or 448.8 gallons per minute. The volume of water represented by a flow of 1 cubic foot per second for 24 hours is equivalent to 86,400 cubic feet, approximately 1.983 acre-feet, or 646,272 gallons.

Discharge is the volume of water (or more broadly, volume of fluid plus suspended sediment) that passes a given point within a given period of time.

Drainage area of a stream at a specific location is that area, measured in a horizontal plane, enclosed by a topographic divide from which direct surface runoff from precipitation normally drains by gravity into the river above the specified point. Figures of drainage area given herein include all closed basins, or noncontributing areas, within the area unless otherwise noted.

Drainage basin is a part of the surface of the earth that is occupied by drainage system, which consists of a surface stream or body of impounded surface water together with all tributary surface streams and bodies of impounded water.

Gaging station is a particular site on a stream, canal, lake, or reservoir where systematic observations of hydrologic data are obtained.

Runoff in inches shows the depth to which the drainage area would be covered if all the runoff for a given time period were uniformly distributed on it.

Streamflow is the discharge that occurs in a natural channel. Although the term "discharge" can be applied to the flow of a canal, the word "streamflow" uniquely describes the discharge in a surface stream course. The term "streamflow" is more general than "runoff" as streamflow may be applied to discharge whether or not it is affected by diversion or regulation.

MISSOURI RIVER MAINSTEM RESERVOIR SYSTEM

Annual Operating Plan 2014 – 2015

I. FOREWORD

This Annual Operating Plan (AOP) presents pertinent information and plans for regulating the Missouri River Mainstem Reservoir System (System) through December 2015 under widely varying water supply conditions. It provides a framework for the development of detailed monthly, weekly, and daily regulation schedules for the System's six individual projects during the coming year to serve the Congressionally authorized project purposes; to fulfill the Corps' responsibilities to Native American Tribes; and to comply with environmental laws, including the Endangered Species Act (ESA). Regulation of the System is directed by the Missouri River Basin Water Management Division, Northwestern Division, U. S. Army Corps of Engineers (Corps) located in Omaha, Nebraska. A map of the Missouri River basin is shown on *Plate 1* and the summary of engineering data for the six individual mainstem projects and System is shown on *Plate 2*.

It is important to note that the AOP is not intended to be a forecast for the coming year; rather it examines a range of potential runoff scenarios which span 80 percent of the historic record. There is still a 10 percent chance that runoff will be higher than shown in the AOP and a 10 percent chance that it will be lower. The studies included in the AOP provide an array of reservoir levels and releases that may be expected under the various runoff scenarios. Actual real-time regulation of the System is accomplished using the best information and tools available and is adjusted to respond to changing conditions on the ground. As the runoff season unfolds, there is a possibility that real-time regulation plans will indicate runoff volumes, reservoir levels and releases outside those anticipated in this report. Should that occur, the Corps will appreciably increase its communication and outreach efforts to convey that information to stakeholders throughout the basin so that other Federal, state and local agencies, Tribes, communities, and local residents can take appropriate actions.

This plan may require adjustments such as when substantial departures from expected runoff occur; to meet emergencies including short-term intrasystem adjustments to protect human health and safety, to maintain minimum river or reservoir levels to keep intakes operational during periods of extended drought, and to prevent loss of historic and cultural properties; or to meet the provisions of applicable laws, including the ESA. These adjustments would be made to the extent possible after evaluating impacts to all System uses, would generally be short-term in nature, and would continue only until the issue is resolved.

This document provides the plan for future regulation of the System. Other documents that may be of interest include the "System Description and Regulation" report dated November 2007 or the "Summary of Actual 2013 Regulation," dated July 2014. Both reports are currently available at the "Reports and Publications" link on our website at: www.nwd-mr.usace.army.mil/rcc, or you may contact the Missouri River Basin Water Management Division at 1616 Capitol Avenue, Suite 365, Omaha, Nebraska 68102-4909, phone (402) 996-3841 for copies. The "Summary of Actual 2014 Regulation" will be available at the same site in late spring or early summer of 2015.

II. BACKGROUND AND AOP PROCESS

Beginning in 1953, projected System reservoir regulation for the year ahead was developed annually as a basis for advance coordination with the various interested Federal, state, and local agencies and private citizens. Also beginning in 1953, a coordinating committee was organized to make recommendations on each upcoming year's System regulation. The Coordinating Committee on Missouri River Mainstem Reservoir Operations held meetings semiannually until 1981 and provided recommendations to the Corps. In 1982, the Committee was dissolved because it did not conform to the provisions of the Federal Advisory Committee Act. Since 1982, to continue providing a forum for public participation, one or more open public meetings are held semiannually in the spring and fall. The fall public meetings are conducted to take public input on the draft AOP, which typically is published in mid-September each year. The spring meetings are conducted to update the public on the current hydrologic conditions and projected System regulation for the remainder of the year as it relates to implementing the final AOP.

Under the terms of Stipulation 18 of the March 2004 "Programmatic Agreement for the Operation and Management of the Missouri River Main Stem System for Compliance with the National Historic Preservation Act, as amended" (PA) the Corps has agreed to consult/meet with the affected Tribes and Tribal Historic Preservation Officers (THPOs), State Historic Preservation Officers (SHPOs), the Advisory Council on Historic Preservation (AHP) and other parties on the draft AOP. The purpose of this consultation/meeting is to determine whether operational changes are likely to cause changes to the nature, location or severity of adverse effects to historic properties or to the types of historic properties affected and whether amendments to the Corps Cultural Resources Management Plans and Five-Year Plan are warranted in order to better address such effects to historic properties. During 2006 the Corps worked with the affected Tribes to establish processes for consultation on AOPs under 36 CFR Part 800, the PA, and Executive Order 13175. The process consists of a series of informational meetings with the Tribes and/or government-to-government consultation with Tribes, as requested. A letter dated September 12, 2014 was sent to

the Tribes offering consultation on the 2014-2015 AOP. Meeting times and locations of the five fall public meetings were also provided. Separate meetings will be scheduled for all Tribes requesting government-to-government consultation. All tribes, whether signatory to the PA or not, may request government-to-government consultation on this and all future AOPs. In addition, the Tribes have reserved water rights to the Missouri River and its major tributaries. In no way does this AOP attempt to define, regulate or quantify water rights or any other rights that the Tribes are entitled to by law or treaty.

The 2014 spring public meetings were held at the following locations and dates: April 8 at Kansas City, Missouri and Nebraska City, Nebraska; April 9 at Pierre, South Dakota and Bismarck, North Dakota; and April 10 at Fort Peck, Montana. A basin-wide conference call was also held on April 11. The attendees were given an update regarding the outlook for 2014 runoff and projected System regulation for the remainder of 2014. Five fall public meetings on the draft 2014-2015 AOP were held at the following locations: October 27 in Fort Peck, Montana; October 28 in Bismarck, North Dakota and Pierre, South Dakota; and October 29 in Smithville, Missouri and Council Bluffs, Iowa. In the spring of 2015, public meetings will be held to discuss the basin's hydrologic conditions and the effects those conditions are expected to have on the implementation of the final 2014-2015 AOP.

III. MAINSTEM MASTER MANUAL AND ESA CONSULTATIONS

The System is comprised of six dam and reservoir projects authorized by the Rivers and Harbors Act of 1935 and the Flood Control Act of 1944. Section 9 of the 1944 Flood Control Act authorized the System to be operated for the purposes of flood control, navigation, irrigation, hydropower, water supply, water quality control, recreation and fish and wildlife. In addition, operation of the System must also comply with other applicable Federal statutory and regulatory requirements, including the ESA. The System is regulated using guidelines published in the Master Manual. The Master Manual presents the water control plan and operational objectives for the integrated regulation of the System. Annual water management plans (Annual Operating Plans) are prepared each year, based on the water control criteria contained in the Master Manual, in order to describe potential reservoir regulation of the System for the current operating year under a variety of runoff conditions.

First published in 1960 and subsequently revised during the 1970s, the Master Manual was revised in March 2004 to include more stringent drought conservation measures. A 2000 Biological Opinion issued by the U. S. Fish and Wildlife Service (USFWS), while the Corps was revising the Master Manual, concluded that the operation and regulation of the System would jeopardize the continued existence of three endangered or threatened species: the pallid sturgeon, the interior least tern and the piping plover. In 2003 the USFWS amended the BiOp (2003 Amended BiOp) and

provided a Reasonable and Prudent Alternative (RPA) to avoid jeopardy to the endangered pallid sturgeon that included a provision for the Corps to develop a plan to implement a bimodal spring pulse from Gavins Point Dam. Working with the USFWS, Tribes, states and basin stakeholders, the Corps developed technical criteria for the bimodal spring pulse releases. In March 2006 the Master Manual was revised to include technical criteria for a spring pulse. Neither the 2004 Master Manual, nor the 2006 revisions to the Master Manual, changed the volume of storage in the System reserved for flood risk reduction or the basic principles of how that storage is regulated. The Corps does not store water in the reservoirs specifically for the endangered species and the Master Manual storage allocations were not altered to facilitate the spring pulses. In years when water is released for endangered species reservoir storage levels are not adjusted.

Current regulation of the System in accordance with the Master Manual to serve authorized project purposes is dependent on successful implementation of the 2003 Amended BiOp. Implementation of the RPA elements is accomplished through the Missouri River Recovery Program (MRRP) which includes the following elements: habitat construction including emergent sandbar habitat and shallow water habitat, flow modifications, propagation/hatchery support, research, monitoring and evaluation, and adaptive management. Simply put, the Corps must comply with environmental laws including the ESA, and the MRRP is the vehicle used to accomplish this. This AOP identifies flow modifications at Garrison, Fort Randall and Gavins Point for the benefit of the endangered interior least tern (tern) and the threatened piping plover (plover) while maintaining flood control and navigation as primary authorized purposes.

On November 30, 2011 the Missouri River Recovery Program Independent Science Advisory Panel (ISAP) released its Final Report on Spring Pulses and Adaptive Management. This report, commissioned by the Missouri River Recovery Implementation Committee (MRRIC), evaluated the Gavins Point spring pulses that have been implemented to date in regards to the biological outcomes the USFWS sought in the 2003 Amended BiOp. The ISAP concluded that spring pulses as currently implemented are not accomplishing their intended outcomes and provided recommendations towards achieving a new management paradigm for the Missouri River.

Based on this report, the Corps and USFWS, in coordination with MRRIC, have been aggressively pursuing completing the recommendations laid out by the ISAP. At the center of this effort is the development of a Missouri River Recovery Management Plan/EIS that will establish an overarching Adaptive Management process for implementation of the 2003 Amended BiOp. Accordingly, while this plan is being developed, the agencies believe it is prudent to forego a spring pulse during the 2015

Missouri River operating season and that this suspension is not likely to have an adverse effect on the listed species.

Additional information on other efforts undertaken through the MRRP to meet the requirements of the 2003 Amended BiOp can be found in the Annual Report on the Biological Opinion which can be found on the "MRRP Documents" page of the Recovery Program website at: www.moriverrecovery.org. The ISAP report is also available at this website.

IV. ON-GOING COORDINATION, STUDIES AND REPORTS

As committed to following the 2011 Flood, the Corps communicated more broadly and frequently in 2014 holding monthly conference calls from January to July with Federal, state, county and local officials, Tribes, emergency management officials, independent experts and the media to discuss conditions on the ground and the current release plans and forecasts. Two additional conference calls were held, one in June and one in September, in response to weather events. Recordings of the conference calls were made available to the public through the Corps' website. Outreach calls will be re-initiated in January 2015 or as needed if basin and/or weather conditions change dramatically.

The Corps continues to update a number of technical reports used in the regulation of the reservoir system. The "Missouri River Incremental Flows Below Gavins Point" report has been completed and is posted on the Corps' website. Additional reports include long-term runoff forecasting, which includes an analysis of the relationship of hydrologic factors as they relate to plains snowmelt, and an analysis of coefficients used in determining the upper and lower runoff values used in the monthly reservoir simulations. The Corps continues to collaborate with other Federal, state and local agencies and our field offices to improve runoff forecasts, particularly as it relates to plains snowpack. This will require a collaborative effort to improve both data collection (i.e. plains snowpack water equivalent, soil moisture and frost depth) and hydrologic modeling. A proposal for the Missouri River basin plains snow and basin condition network was prepared by subject matter experts from various Federal and State agencies. This proposal outlined timelines, costs, and agency responsibilities. The Water Management office continues to participate in a variety of regional and national climate change teams. The National Oceanic and Atmospheric Administration (NOAA) also collaborated with the Corps and other agencies on a two-part study. The first part was completed in December 2013 and was a climate attribution effort focusing on the 2011 event. The second part of the study was an assessment of the skill and reliability of predictions of seasonal climate and the ability to predict rapid transitions of cycles from wet to dry and dry to wet. This study was being finalized in December 2014. Both reports will be available at www.drought.gov on the Reports, Assessments and Outlooks page under the Regional Programs, Missouri River Basin section.

The System reservoirs are surveyed periodically (10- to 25-year intervals) to update reservoir capacities and to assess aggradation and degradation trends. The frequency of reservoir surveys was established based on historic data and reservoir size. Intervening resurveys may be conducted when conditions dictate. High flood events are the most likely causes for these additional surveys. Following the 2011 Flood, Garrison, Oahe, Big Bend, Fort Randall and Gavins Point reservoirs were surveyed. Reservoir capacity (elevation-storage) tables were updated for Garrison, Oahe, Fort Randall and Gavins Point on August 1, 2013, and adjustments to the System storage zones were noted in last year's AOP. Reservoir capacity data for Big Bend was updated on April 1, 2014. There were no additional adjustments to the System storage zones due to the implementation of the new Big Bend reservoir capacity table because of the minor storage changes.

V. FUTURE RUNOFF: SEPTEMBER 2014 - DECEMBER 2015

Runoff into the six System reservoirs is typically low and relatively stable during the August through February period. The August 1 calendar year runoff forecast is normally used as input to the basic reservoir regulation simulation (Basic) in the AOP studies for the period August 2014 through February 2015. Due to the much higher than normal runoff in August, this year's AOP studies use the September 1 reservoir elevations and calendar year runoff forecast as input to the Basic simulation. The September 1 runoff forecast for 2014 was 35.6 million acre-feet (MAF). Two other runoff scenarios based on the September 1 runoff forecast were developed for the same period. These are the Upper Basic and Lower Basic simulations. In previous AOPs, the Upper and Lower Basic simulations were based on 120 percent and 80 percent of the August through February runoff forecast, respectively. These percentages were recently revised based on an analysis of historic water supply. The adjusted Upper and Lower Basic values for each month and reach are shown as percentages in *Tables I* and *II*. The percentages shown are used for the September through February period in the AOP simulations. These percentages are also used in the regularly updated monthly reservoir simulations. The report detailing the computation of these new runoff factors will be posted to the Corps' website in 2015.

TABLE I
UPPER BASIC RUNOFF PERCENTAGES

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Fort Peck	120	120	135	145	135	145	145	130	120	120	120	120
Garrison	120	120	135	145	135	145	145	130	120	120	120	120
Oahe	140	140	150	155	155	145	140	135	135	135	135	135
Fort Randall	140	140	150	155	155	145	140	135	135	135	135	135
Gavins Point	140	140	150	155	155	145	140	135	135	135	135	135
Sioux City	140	140	150	155	155	145	140	135	135	135	135	135

TABLE II
LOWER BASIC RUNOFF PERCENTAGES

	<u>Jan</u>	<u>Feb</u>	<u>Mar</u>	<u>Apr</u>	<u>May</u>	<u>Jun</u>	<u>Jul</u>	<u>Aug</u>	<u>Sep</u>	<u>Oct</u>	<u>Nov</u>	<u>Dec</u>
Fort Peck	80	75	65	65	70	65	65	70	75	80	80	80
Garrison	80	75	65	65	70	65	65	70	75	80	80	80
Oahe	75	75	55	50	50	50	55	65	75	75	75	75
Fort Randall	75	75	55	50	50	50	55	65	75	75	75	75
Gavins Point	75	75	55	50	50	50	55	65	75	75	75	75
Sioux City	75	75	55	50	50	50	55	65	75	75	75	75

Simulations for the March 1, 2015 to February 29, 2016 time period use five statistically derived runoff scenarios based on an analysis of historic water supply. The report detailing the development of these runoff scenarios, "Runoff Volumes for Annual Operating Plan Studies", was updated in August 2013 to include five additional years of runoff data that now extends from 1898 to 2011. In addition to the five runoff scenarios, the updated analysis added two runoff scenarios, one each at the upper and lower end, to span 96 percent of the historic record. Using statistically derived runoff scenarios for the AOP provides a good range of simulation for dry, average, and wet conditions, and eliminates the need to forecast future precipitation months in advance. As noted in the second NOAA study (see Chapter IV), for the lead times and times of year of interest in the Missouri River basin, there is no useful skill and reliability of precipitation forecasts. Real-time regulation of the System is based on all available and relevant hydrometeorological information including, but not limited to observed runoff volumes, National Weather Service short and long-range outlooks, plains and mountain snow water equivalent data, observed base flows, soil moisture and frost depths.

The five statistically derived runoffs used in the AOP are identified as the Upper Decile, Upper Quartile, Median, Lower Quartile and Lower Decile runoff conditions. Upper Decile runoff (34.5 MAF) has a 1 in 10 chance of being exceeded, Upper Quartile runoff (30.6 MAF) has a 1 in 4 chance of being exceeded, and Median runoff (24.6 MAF) has a 1 in 2 chance of being exceeded. Lower Quartile runoff (19.3 MAF) has a 1 in 4 chance of the occurrence of less runoff, and Lower Decile runoff (16.1 MAF) has a 1 in 10 chance of the occurrence of less runoff. There is still a 20 percent chance that a runoff condition may occur that has not been simulated; i.e., a 10 percent chance runoff could be lower than Lower Decile and a 10 percent chance runoff could be greater than Upper Decile.

The two additional runoff volumes included in the updated "Runoff Volumes for Annual Operating Plan Studies" report are the 2 percent and 98 percent exceedance levels. Annual runoff at the 2 percent exceedance (40.1 MAF) has a 1 in 50 chance of being exceeded; the 98 percent exceedance (11.4 MAF) has a 1 in 50 chance of the occurrence of less runoff. Although these runoff volumes were not included as scenarios in this year's AOP, additional monthly studies could be performed based on

these runoff volumes, or any prior year's runoff volume and distribution, as the 2015 runoff season unfolds should the runoff forecast exceed the Upper Decile runoff scenario or be lower than the Lower Decile runoff.

The Upper Decile and Upper Quartile simulations extend from the end of the Upper Basic simulation through February 2016. Likewise, the Median simulation extends from the end of the Basic simulation, and the Lower Quartile and Lower Decile simulations extend from the end of the Lower Basic simulation through February 2016.

The estimated natural flow at Sioux City, the corresponding post-1949 water use effects, and the net flow available above Sioux City are shown in *Table III*, where water supply conditions are quantified for the period August 2014 through February 2016. The natural water supply for calendar year (CY) 2013 totaled 25.1 MAF.

TABLE III
NATURAL AND NET RUNOFF AT SIOUX CITY
(Volumes in 1,000 Acre-Feet)

	<u>Natural 1/</u>	<u>Post-1949 Depletions</u>	<u>Net 2/</u>
September 2014 through February 2015 (Basic Runoff Scenario)			
Basic	7,700	1,000	8,700
Upper Basic	9,600	1,000	10,600
Lower Basic	6,000	900	6,900
Runoff Year March 2015 through February 2016 (Statistical Analysis of Past Records)			
Upper Decile	34,500	-2,900	31,600
Upper Quartile	30,600	-2,800	27,800
Median	24,600	-2,800	21,800
Lower Quartile	19,300	-2,700	16,600
Lower Decile	16,100	-2,400	13,700

1/ The word "Natural" is used to designate runoff adjusted to the 1949 level of basin development, except that regulation and evaporation effects of the Fort Peck reservoir have also been eliminated during its period of regulation prior to 1949.

2/ The word "Net" represents the total runoff after deduction of the post-1949 irrigation, upstream storage, and other use effects.

VI. ANNUAL OPERATING PLAN FOR 2014-2015

A. General. The anticipated regulation described in this AOP is designed to meet the regulation objectives presented in the current Master Manual. While some aspects of System and individual project regulation are clearly defined by technical criteria in the Master Manual, for example navigation service level and season length, others such as minimum releases for irrigation and water supply in the reaches between the reservoirs are based on regulation experience and may be adjusted as needed to respond to changing conditions. Consideration has been given to all of the authorized project purposes, to historic and cultural resources and to the needs of threatened and endangered (T&E) species. The "System Description and Regulation" report provides a concise summary of the primary aspects of System regulation and should be referred to for further information. For ease of use, a summary of the frequently used technical criteria included in the Master Manual is presented on *Plate 3*.

The plan relies on a wealth of regulation experience. Reservoir regulation experience available for preparation of the 2014-2015 AOP includes 13 years of regulation at Fort Peck (1940) as the sole Mainstem project, plus 61 years of System experience as Fort Randall (1953), Garrison (1955), Gavins Point (1955), Oahe (1962), and Big Bend (1964) were brought progressively into System regulation. This regulation experience includes lessons learned during two major droughts of six and eight years (1987-1992 and 2000-2007) that have occurred since the System filled in 1967. It also includes the high runoff period 1993-1999 during which five of the seven years experienced runoff greater than Upper Quartile including the previous record runoff of 49.0 MAF in 1997, and the record runoff of 61.0 MAF in 2011. In addition to the long period of actual System reservoir regulation experience, many background regulation studies for the completed System are available for reference.

B. 2014-2015 AOP Simulations. Reservoir simulations for the Upper Basic, Basic, and Lower Basic runoff scenarios, which span the period of September 2014 through February 2015, are shown in the final section of this AOP as studies 1 through 3. AOP simulations for the five statistically derived runoff scenarios, which span the period of March 2015 through February 2016, are shown in the final section of this AOP as studies 4 through 8. As previously stated, the simulations use five statistically derived runoff scenarios and reflect 80 percent of the historic annual runoff volumes (between Upper Decile and Lower Decile). The simulations provide information for planning purposes on a range of future reservoir levels and release rates, and are not meant to represent a particular forecast. The simulations shown use a monthly time-step, and thus do not provide the level of detail necessary to address specific flood control regulations. Detailed routing of specific flood flows is accomplished using daily and hourly time-step models which incorporate real-time information including observed precipitation, and these situations are handled individually during real-time regulation.

The AOP studies, in summary, provide the following: the full flood control capacity of the reservoir system will be available at the start of the runoff season; use of the Exclusive Flood Control Zone is not anticipated under any of the five runoff scenarios covered in the AOP; full service flow support under all runoff scenarios to start the navigation season; full service flow support for Lower Quartile and above runoff scenarios after the July 1 System storage check and reduced flow support for Lower Decile runoff; a full length navigation season for all runoff scenarios; normal winter releases for Median runoff, minimum winter releases for Lower Quartile and Lower Decile runoff, and above normal winter releases for Upper Decile and Upper Quartile runoff; a steady release-flow to target regulation during the tern and plover nesting season for Median and below runoff and nearly steady releases for Upper Decile and Upper Quartile runoff with flood water evacuation; emphasis on Fort Peck and Oahe for a steady to rising reservoir level during the forage fish spawn; and reservoir releases and pool levels sufficient to keep all intakes operational under all runoff scenarios. Water conservation measures may be implemented if runoff conditions indicate that it would be appropriate including cycling releases from Gavins Point during the early part of the nesting season, only supporting flow targets in reaches being used by commercial navigation, and utilization of the Kansas River projects authorized for Missouri River navigation flow support. Additional details about the studies are provided in the following paragraphs. Results of the simulations are shown in *Plate 4* and *Plate 5* for the System storage and the Fort Peck, Garrison and Oahe pool elevations.

Under all runoff scenarios modeled for the AOP, the full flood control capacity of the System is available at the start of the 2015 runoff season. Although the March 1 and May 1 System storage is above the Gavins Point spring pulse precludes of 40.0 MAF, as discussed in Chapter III, spring pulses will not be conducted in 2015. The Corps will continue to work closely with the USFWS to ensure the AOP will meet the intent of the 2003 Amended BiOp and comply with the ESA.

The March 15 and July 1 System storage checks were used to determine the level of flow support for navigation and other downstream purposes as well as the navigation season length in 2015. Full service navigation flows or more are provided for Lower Quartile and above runoff throughout the navigation season. Service levels for Lower Decile start the season at full service, and drop slightly based on the July 1 System storage check (see *Plate 3*). Application of the July 1 System storage check indicated that a full length navigation season would be provided for all five runoff conditions, with the upper two runoff scenarios including a 10-day extension to the navigation season. Upper Quartile and Upper Decile simulations reach the desired 56.1 MAF System storage level on March 1, 2016. Storage is below the base of the Annual Flood Control and Multiple Use Zone for Median and lower runoff conditions.

For modeling purposes in this AOP, the Steady Release – Flow-to-Target (SR-FTT) regulation scenario for Gavins Point is shown during the 2015 tern and plover nesting season for Median and lower runoff conditions. For these simulations, the monthly average May release used in the simulations was determined by using the long-term average May release (see *Plate 3*), based on the service level, for the first third of the month, followed by the July table values for the remainder of the month to reflect a steady release regulation at the start of the nesting season. The modeled June release was set equal to the long-term average release for July (see *Plate 3*) based on the service level for the first half of the navigation season. The long-term average releases (see *Plate 3*) were used for July and August to indicate flowing to target. The Upper Decile and Upper Quartile runoff simulations follow the Master Manual, with much above normal runoff requiring release increases mid-year to evacuate flood water from the reservoirs. Although these modeled Gavins Point releases represent our best estimate of required releases during 2015, actual releases will be based on hydrologic conditions and the availability of habitat at that time. To the extent reasonably possible, measures to minimize incidental take of the protected species will be utilized. These may include not meeting flow targets in reaches without commercial navigation and utilizing the Kansas River tributary reservoirs for navigation flow support when appropriate. It may also be necessary to cycle releases for flood control regulation during the T&E species' nesting season.

The long-term average Gavins Point releases to meet target flows were used in the AOP studies for navigation support during the spring and fall months with the exception of Upper Decile and Upper Quartile. Under these runoff scenarios, releases were based on flood water evacuation. Based on the September 1 storage checks and flood evacuation criteria, modeled Gavins Point winter releases were 20,000 cfs during the 2014-2015 winter season and ranged from 12,500 cfs to 20,000 cfs during the 2015-2016 winter season depending on the runoff scenario. Gavins Point releases will be increased to meet downstream water supply requirements in critical reaches, to the extent reasonably possible, if downstream incremental runoff is low.

The Gavins Point releases shown in this and previous AOPs are estimates based on historic averages and experience. Adjustments are made as necessary in real-time based on hydrologic conditions.

Intrasystem releases are adjusted to best serve the multiple purposes of the projects with special emphasis placed on regulation for non-listed fisheries starting in early April and for T&E bird species beginning in early May and continuing through August. As part of the overall plan to rotate emphasis among the upper three reservoirs during low runoff years, Fort Peck and Oahe are scheduled to be favored during the 2015 forage fish spawn while also attempting to maintain rising water levels at Garrison. The Median, Upper Quartile, and Upper Decile simulations show that it is possible to provide steady-to-rising pool levels in each of the three large upper

reservoirs during the spring forage fish spawn period. Insufficient runoff is available in the Lower Quartile and Lower Decile simulations to keep all three reservoirs rising during the spawn period. The Garrison reservoir level declines in April and May in the Lower Quartile runoff simulations and declines in April in the Lower Decile simulation. The Lower Quartile and Lower Decile simulations show the Oahe pool nearly steady in April but dropping in May.

Intrasystem releases are also adjusted so that the upper three reservoirs are shown in a balanced condition each year on March 1, the approximate start of the runoff season. This balancing is computed based on the percent of storage in the respective Carryover Multiple Use Zone.

Actual System regulation from January 1 through August 31, 2014 and the simulated regulating plans for each project through CY 2015 using the five runoff scenarios described on Page 4 are presented on *Plate 6* through *Plate 11*, inclusive. Big Bend regulation is omitted since storage at that project is relatively constant and average monthly releases are essentially the same as those at Oahe. These plates also show, on a condensed scale, actual regulation since 1953.

Plate 12 illustrates Fort Peck, Garrison, Oahe, and Gavins Point actual releases (Regulated Flow) as well as the Missouri River flows that would have resulted if the reservoirs were not in place (Unregulated Flow) during the period January 2013 through July 2014. *Plate 13* presents past and simulated gross average monthly power generation and gross peaking capability for the System.

C. Actual Regulation for the Balance of the 2014 Navigation Season and Fall of 2014. The actual regulation of the System for the period of September through November 2014 is presented in the following paragraphs.

Fort Peck. Releases averaged about 6,000 cfs through mid-September and were then lowered to 5,000 cfs as irrigation ceased. Releases were held near that level through the end of November. The Fort Peck pool rose slowly through the end of November, ending the month at 2233.2 feet msl or 1.0 feet above the September 1 elevation of 2232.2 feet msl.

Garrison. The threatened least terns and endangered piping plovers were fledged by August 28 on the reach downstream of Garrison and hydropower peaking restrictions were discontinued at that time. Releases were maintained at 28,000 cfs through early September, and then gradually decreased during the month to 24,000 cfs. Releases ranged from 20,000 cfs to 24,000 cfs in October and the first part of November. Releases were decreased to 19,000 cfs in mid-November, and then to 16,000 cfs in late November in anticipation of the potential freeze-in at Bismarck. The Garrison pool

steadily dropped throughout the fall and ended the month of November at 1841.1 feet msl or 3.8 feet below the September 1 elevation of 1844.9 feet msl.

Oahe. The reservoir started the month of September at elevation 1615.2 feet msl. Releases averaged 38,200 cfs in September in support of navigation and to evacuate the annual flood control pool. Releases were 39,000 cfs in October and 31,300 cfs in November, respectively to accommodate the fall drawdown of the Fort Randall pool and to continue evacuation of stored water. At the end of November, the Oahe pool was at elevation 1607.9 feet msl or 7.3 feet below the September 1 elevation.

Big Bend. Releases generally parallel those from Oahe. The Big Bend pool generally fluctuates between 1420.0 feet msl and 1421.0 feet msl for weekly cycling during high power load periods.

Fort Randall. Releases averaged 44,500 cfs in September, 45,600 cfs in October, and 37,800 cfs in November to back up the releases from Gavins Point. The fall pool drawdown of Fort Randall started after Labor Day in early September and was completed in early December due to the 10-day extension of the navigation season. Releases were reduced after the navigation season ended in early December to the level required to back up Gavins Point winter releases.

Gavins Point. Releases were scheduled above full service navigation levels to evacuate water from the reservoir system through early December. A full length navigation season, plus a 10-day extension, was provided in accordance with the technical criteria for the July 1 System storage check presented in the Master Manual. In accordance with the Master Manual, during years of greater than normal water supply, the navigation season is extended as both an additional evacuation measure and to provide an increased benefit to navigation while striving to reach the base of the Annual Flood Control and Multiple Use Zone by March 1 the following season. The closing dates for the commercial navigation season ranged from December 2 at Sioux City to December 11 at the mouth near St. Louis. Releases were reduced by approximately 3,000 cfs per day beginning on December 2, working toward the target winter release. The Gavins Point pool level was raised 1.5 feet to elevation 1207.5 feet msl in the fall. The pool level will remain near that elevation during the winter months.

D. Regulation Plan for Winter 2014-2015. The regulation of the System presented in the following paragraphs is based on the previously discussed AOP simulations. Actual real-time regulation of the System is adjusted to respond to changing conditions on the ground. The latest long-term reservoir regulation forecasts, which are updated monthly, can be found on the Corps' website. The September 1 System storage check is used to determine the winter release rate from Gavins Point. A winter release of 12,000 cfs is scheduled if System storage is less than 55.0 MAF on September 1; 17,000 cfs is scheduled when System storage is above 58.0 MAF; and the release is prorated for

System storages between 55.0 and 58.0 MAF. A modification to the winter release rate from Gavins Point dam may occur when the evacuation of System flood control storage cannot be accomplished by providing a full-service navigation season with a 10-day extension of the navigation season. With an excess annual water supply, the winter season Gavins Point release may be scheduled at a rate of up to 25,000 cfs to continue to evacuate the remaining excess water in System flood control storage. Based on the studies included in this AOP, the scheduled winter System release for 2014-2015 is 20,000 cfs. It is anticipated that this year's winter release will be adequate to complete evacuation of stored flood waters and serve all downstream water intakes. Water supply is discussed in more detail in Chapter VII, Section B.

Fort Peck. Releases are expected to average 7,500 cfs in December and 8,500 cfs in January and February to serve winter power loads, draw down the lake to the base of the annual flood control pool, and to help balance System storage. The Fort Peck pool level is expected to slowly decline about 0.5 feet from elevation 2234.5 feet msl at the end of November to near elevation 2234.0 feet msl by March 1. At the beginning of March, the Fort Peck pool will be at the base of its Annual Flood Control and Multiple Use Zone.

Garrison. Releases are scheduled to be 19,500 cfs in December increasing to 24,000 cfs for January and February to serve winter power loads and to draw down the lake to the base of the annual flood control pool. Releases will be reduced, most likely in December, to prevent ice-induced flooding at the time of freeze-in and then gradually increased as river conditions permit. These temporary reductions in the releases may be scheduled to prevent exceedance of a 13-foot stage at the Missouri River at Bismarck streamgaging station. The Bismarck flood stage is 14.5 feet. Water Management staff will coordinate closely with other Federal, state and local agencies during periods of freeze-in and ice-out to reduce flood risk and ensure communities and local residents are aware of the rapidly changing conditions and are prepared to take appropriate actions. The Garrison pool level will decline 4.6 feet from elevation 1842.1 feet msl at the end of November to near elevation 1837.5 feet msl by March 1, at the base of its Annual Flood Control and Multiple Use Zone.

Oahe. Releases for the winter season will provide backup for the Fort Randall and Gavins Point releases as well as refill the recapture space available in the Fort Randall reservoir consistent with anticipated winter power loads. Monthly average releases may vary substantially with fluctuations in power loads occasioned by weather conditions but, in general, are expected to average between 22,700 cfs and 23,400 cfs. Daily and hourly releases will vary widely to best meet power loads. Peak hourly releases, as well as daily energy generation, will be constrained to prevent urban flooding in the Pierre and Fort Pierre areas if severe ice conditions develop downstream of Oahe Dam. This potential reduction is coordinated with the Western Area Power Administration (Western). The Oahe pool level is expected to slowly decline from

1607.7 feet msl at the end of November to 1607.0 feet msl at the end of December before starting to rise to 1607.5 feet msl by the beginning of March, the base of its Annual Flood Control and Multiple Use Zone.

Big Bend. The Big Bend pool level will be maintained in the normal 1420.0 feet msl to 1421.0 feet msl range during the winter.

Fort Randall. Releases will average about 19,000 cfs during the winter season to support Gavins Point winter releases. The Fort Randall pool level is expected to rise from its fall drawdown elevation of near 1337.5 feet msl at the end of November or early December to near elevation 1350.0 feet msl, the seasonal base of flood control, by March 1. However, if the plains snowpack flood potential downstream of Oahe Dam is lower than normal, the Fort Randall pool level will be raised to near 1353.0 feet msl by March 1. It is likely that a pool level as high as 1355.0 feet msl could be reached by the end of March if spring runoff has commenced. The Fort Randall pool level above the White River delta near Chamberlain, South Dakota will remain at a higher elevation than the pool level below the delta from early October through December, due to the damming effect of this delta area.

Gavins Point. Gavins Point winter releases are discussed in the first paragraph of this section. The Gavins Point pool level will be near elevation 1207.5 feet msl until late February when it will be lowered to elevation 1206.0 feet msl to create additional capacity to store spring runoff.

System storage for all runoff conditions will be at the base of the Annual Flood Control and Multiple Use Zone of 56.1 MAF by the beginning of next year's runoff season, approximately March 1, 2015.

E. Regulation During the 2015 Navigation Season. All five runoff scenarios modeled for this year's AOP follow the technical criteria presented in the current Master Manual for downstream flow support. Beginning in mid-March, Gavins Point releases will be gradually increased to provide navigation flow support at the mouth of the Missouri near St. Louis, Missouri by April 1, 2015, the normal navigation season opening date. The corresponding dates at upstream locations are Sioux City, March 23; Omaha, March 25; Nebraska City, March 26; and Kansas City, March 28. However, if during the 2015 navigation season there is no commercial navigation scheduled to use the upper reaches of the navigation channel, we will consider not providing navigation flow support in those reaches to conserve water in the System, reduce flood risk, and/or minimize incidental take of the protected species during the nesting season.

Navigation flow support for the 2015 season will be determined by actual System storage on March 15 and July 1. Runoff scenarios modeled indicate full service flow support at the start of the 2015 navigation season for all runoff conditions. Following

the July 1 System storage check, full service would be provided for Lower Quartile and above runoff scenarios. The service level would be 500 cfs below full service for Lower Decile runoff. The normal 8-month navigation season is provided for Median runoff scenarios and below as shown in *Table IV*. A 10-day extension to the navigation season is provided for the upper two runoff scenarios.

TABLE IV
NAVIGATION SERVICE SUPPORT
FOR THE 2015 SEASON

Runoff Scenario <u>(MAF)</u>	System Storage		Flow Level Above or Below Full Service <u>(cfs)</u>		Season Shortening <u>(Days)</u>	
	March 15 <u>(MAF)</u>	July 1 <u>(MAF)</u>	Spring	Summer/Fall		
U.D.	34.5	57.4	64.0	0	+19,000	0*
U.Q.	30.6	57.2	63.1	0	+12,000	0*
Med.	24.6	57.0	60.8	0	0	0
L.Q.	19.3	56.6	57.7	0	0	0
L.D.	16.1	56.5	56.5	0	-500	0

*Includes 10-day extension for Upper Quartile and Upper Decile.

As previously stated, the modeled regulation for the 2015 nesting season below Gavins Point is Steady Release – Flow-to-Target (SR-FTT). When the SR-FTT release scenario is used, the initial steady release, which has ranged from 24,000 cfs to 30,000 cfs over the last few years, will be based on hydrologic conditions and the availability of habitat at that time. Model runs included in this AOP have a Gavins Point release which is higher during the last two-thirds of May to keep birds from nesting at low elevations. Gavins Point releases will be adjusted to meet downstream targets as tributary flows recede, but ideally the initial steady release will be sufficient to meet downstream targets until the majority of the birds have nested. The purpose of this regulation is to continue to meet the project purposes while minimizing the loss of nesting T&E species. A Gavins Point peaking cycle of two days down and one day up may be used to conserve water in the upper three reservoirs, if required. Gavins Point releases for the Upper Decile and Upper Quartile runoff simulations are much above normal to evacuate flood water from the reservoirs. Releases from Garrison and Fort Randall will follow repetitive daily patterns from early May, at the beginning of the T&E species' nesting season, to the end of the nesting season in late August. In addition to the intra-day pattern, Fort Randall releases may also be cycled with two days of lower releases and one day of higher releases during the early part of the nesting season to maintain release flexibility in that reach while minimizing the potential for take. If higher daily releases are required later in the nesting season, the daily peaking pattern

may be adjusted, reduced or eliminated resulting in a steady release to avoid increased stages at downstream nesting sites.

Gavins Point releases may be quite variable during the 2015 navigation season but are expected to range from 26,000 to 51,000 cfs under the five modeled runoff scenarios. Release reductions necessary to minimize downstream flooding are not reflected in the monthly averages shown in the simulations but will be implemented as conditions warrant. Reductions in System releases to integrate the use of downstream Missouri River flow support from the designated Kansas River projects (Milford, Tuttle Creek and Perry) authorized to provide Missouri River navigation flow support have not been modeled since they are based on downstream hydrologic conditions. However, this storage will be utilized to the extent possible as a water conservation measure, or to minimize incidental take of protected species during the nesting season if conditions indicate it is prudent to do so. Simulated storages and releases for the System and individual reservoirs within the System are shown on *Plate 6* through *Plate 11*. As experienced in 2011, runoff above or below simulated levels can occur and result in releases beyond those modeled for the AOP. As previously stated, should that occur, the Corps will increase its efforts to convey that information throughout the basin so that state, Tribal, and local agencies, communities, and local residents can take appropriate action.

F. Regulation Activities for T&E Species and Fish Propagation Enhancement.

The ability to provide steady-to-rising pool levels in the upper three reservoirs in low runoff years is very dependent on the volume, timing, and distribution of runoff. The reservoir regulation simulations presented in this AOP for the Upper Decile, Upper Quartile, and Median runoff scenarios show that steady-to-rising pool levels would occur during the spring fish spawn period for the upper three reservoirs. As part of the overall plan to rotate emphasis among the upper three reservoirs during low runoff years, Fort Peck and Oahe are scheduled to be favored during the 2015 forage fish spawn if runoff is below the Median runoff scenario. The studies show that inflows are sufficient to maintain a steady-to-rising pool at Fort Peck from April through June for the Lower Quartile and Lower Decile runoff scenarios. Oahe pool levels rise slightly for April, but decline in May and June for both the Lower Quartile and Lower Decile runoff scenarios. This will be accomplished by setting releases at Fort Peck and Garrison at a level that would attempt to maintain a rising Fort Peck and Oahe pool, but no less than the minimum required for downstream water supply requirements, including irrigation. These adjustments may be restricted when the terns and plovers begin nesting in May. Garrison pool levels drop in April and May for the Lower Quartile runoff scenario, but only decline during April with the Lower Decile runoff. If drought conditions develop, emphasis during the fish spawn will be rotated among the upper three reservoirs and may also be adjusted to be opportunistic in regard to runoff potential. The upper three reservoirs will be managed to benefit forage fish to the

extent reasonably possible, while continuing to serve the other Congressionally authorized project purposes.

Fort Peck. The repetitive daily pattern of releases from Fort Peck has not been implemented since the 2004 tern and plover nesting season. This adaptive management decision was made based on data collected during previous nesting seasons. In recent years, birds in this reach have nested on available high elevation habitat, and thus were not expected to be impacted by the potential range of releases from Fort Peck during the summer. Releases during the 2015 nesting season will not be restricted by the repetitive daily pattern unless habitat conditions or nesting patterns warrant a change.

If high tributary flows enter the Missouri River below the project during the nesting season, hourly releases will generally be lowered to no less than 3,000 cfs in order to keep traditional riverine fish rearing areas continuously inundated, while helping to lower river stages at downstream nesting sites. In rare instances releases below 3,000 cfs may be scheduled for flood damage reduction. April releases are expected to be adequate for trout spawning below the project.

Maintaining a rising Fort Peck pool level will be dependent upon the daily inflow pattern to the reservoir but appears possible for all runoff scenarios.

Garrison. As in previous years, releases from Garrison will follow a repetitive daily pattern during the T&E nesting season to limit peak stages below the project for nesting birds. Releases are scheduled to be 1,000 cfs lower in July and early August than the June releases to enhance conditions for the fledging of chicks. High elevation nesting habitat is expected to be abundant below Garrison Dam during the 2015 nesting season.

During 2015, coldwater habitat in Garrison should be adequate for all runoff scenarios. Coldwater habitat will continue to be monitored during the year and adjustments will be considered if conditions warrant.

A steady-to-rising pool at Garrison during the fish spawn in April and May will be dependent upon the daily inflow pattern to the reservoir. The reservoir rises in April and May for Median and above runoff scenarios, but declines in April under both lower runoff scenarios.

Oahe. Releases in the spring and summer will back up those from Gavins Point. The pool level should be steady to rising in the spring during the fish spawn for Median and above runoff scenarios. Under the Lower Quartile and Lower Decile runoff scenarios, the Oahe pool would rise during April but decline in May, dropping 0.4 feet and 0.9 feet, respectively.

Fort Randall. To the extent reasonably possible, Fort Randall will be regulated to provide for a pool elevation near 1355.0 feet msl during the fish spawn period, provided water can be supplied from other reservoirs for downstream uses. The pool will not be drawn down below elevation 1337.5 feet msl in the fall to ensure adequate supply for water intakes. As a measure to minimize take while maintaining the flexibility to increase releases during the nesting season, hourly releases from Fort Randall will follow a repetitive daily pattern to limit peak stages below the project for nesting birds. Daily average flows may be increased every third day to preserve the capability of increasing releases later in the summer with little or no incidental take if drier downstream conditions occur. If higher daily releases are required later in the nesting season, the daily peaking pattern may be adjusted, reduced or eliminated resulting in a steady release to avoid increased stages at downstream nesting sites. Periods of zero release will be minimized to the extent reasonably possible during the nesting season given daily average releases, real-time hydrologic conditions, and System generating constraints as defined in coordination with Western.

Gavins Point. As detailed in Section III of this report, the bimodal spring pulse from Gavins Point for the benefit of the endangered pallid sturgeon will not be implemented under any runoff scenarios in 2015.

While less habitat is available than the previous few years, it is anticipated that sufficient habitat to provide for successful nesting will be available at elevations above the planned release rates for all runoff conditions. This expectation is based on experience from the previous record runoff in 1997 and from the high elevation habitat resulting from the record releases in 2011. Flows from Gavins Point Dam may follow the flow-to-target (FTT) release scenario or the steady release-flow to target (SR-FTT) scenario. The FTT scenario limits releases from Gavins Point to those needed to meet downstream targets. The actual release scenario will be evaluated when birds begin nesting in early May. If monitoring determines that nests are likely to be initiated at a lower elevation which would be inundated later in the summer, a SR-FTT release scenario may be implemented. A full description of these release scenarios can be found in the Master Manual. Actual releases will be based on hydrologic conditions and the availability of habitat at that time.

All reasonable measures to minimize the loss of nesting T&E bird species will be used. While not anticipated because of the quantity of high elevation habitat available, these measures include, but are not limited to, a relatively high initial steady release during the peak of nest initiation, the use of the three Kansas River basin reservoirs, moving nests to higher ground, and monitoring nest fledge dates to determine if delaying an increase a few days might allow threatened chicks to fledge. The location of navigation tows and river conditions at intakes would also be monitored to determine if an increase could be temporarily delayed without impact. Cycling releases every third day may be used to conserve water early in the nesting season if extremely

dry conditions develop. In addition, cycling may be used during downstream flood control regulation.

The Gavins Point pool will be regulated near 1206.0 feet msl in the spring and early summer, with minor day-to-day variations due to incremental inflows between Fort Randall and Gavins Point resulting from rainfall runoff. Several factors can limit the ability to protect nests from inundation in the upper end of the Gavins Point pool. First, because there are greater numbers of T&E bird species nesting below Gavins Point, regulation to minimize incidental take usually involves restricting Gavins Point releases, which means that the Gavins Point pool can fluctuate significantly due to increased runoff from rainfall events. Second, rainfall runoff between Fort Randall and Gavins Point can result in relatively rapid pool rises because the Gavins Point project has a smaller storage capacity than the other System reservoirs. And third, the regulation of Gavins Point for downstream flood control may necessitate immediate release reductions to reduce downstream damage. When combined, all these factors make it difficult, and sometimes impossible, to prevent inundation of nests in the upper end of the Gavins Point reservoir. However, because of the quantity of habitat expected we do not anticipate a large number of nests being inundated. The pool will be increased to elevation 1207.5 feet msl late in August when it is determined that there are no terns or plovers nesting along the reservoir.

G. Regulation Activities for Historic and Cultural Properties. As acknowledged in the 2004 Programmatic Agreement (PA) for the Operation and Management of the Missouri River Main Stem System, wave action and fluctuation in the level of the reservoirs results in erosion along the banks of the reservoirs. The Corps will work with the Tribes utilizing 36 CFR Part 800 and the PA to address the exposure of historic and cultural sites. The objective of a programmatic agreement is to deal "...with the potential adverse effects of complex projects or multiple undertakings..." The PA objective was to collaboratively develop a preservation program that would avoid, minimize and/or mitigate adverse effects along the System reservoirs. All tribes, whether signatory to the PA or not, may request government-to-government consultation on the regulation of the System and the resulting effect on historic and cultural properties and other resources. As a result of the 2011 flood event, there were impacts to cultural resources. To address impacts, the most effective and comprehensive strategy was a phased approach; site assessment/ Native American Graves Protection and Repatriation Act (NAGPRA) survey, increased law enforcement efforts, engineering design, rip rap repair, and new rip rap placement. Although condition assessments continue to be conducted for all sites affected by flooding, priority has been given to site assessments at occupation sites. Increased law enforcement will be necessary to detect or prevent, and possibly prosecute individuals for Archeological Resources Protection Act (ARPA) violations. Engineers are currently preparing designs to repair existing rip rap and design protection for any sites that were newly impacted.

Pool levels at the upper three reservoirs will likely be near normal in 2015 but will vary depending on runoff conditions. Continuing exposure of cultural sites along the shoreline is still possible. Actions to avoid, minimize or mitigate adverse impacts and expected results of the actions are covered under Chapter VII of this AOP. *Plate 16* shows the locations of the Tribal Reservations.

Fort Peck. Depending on runoff in the Missouri River basin, System regulation during 2015 could result in a Fort Peck pool elevation variation from a high of 2243 feet msl to a low of 2222 feet msl. This is based on the Upper and Lower Decile runoff scenarios (see *Plate 8* and the studies included at the end of this report). Based on a review of existing information, approximately 13 known sites could be affected during this period.

Garrison. Based on the Upper and Lower Decile runoff scenarios (see *Plate 9* and the studies included at the end of this report), Garrison pool elevations could range between 1848 and 1827 feet msl during 2015. Based on a review of existing information, approximately 53 known sites could be affected during this period.

Oahe. At the Oahe reservoir, the System regulation under the Upper and Lower Decile runoff scenarios could result in pool elevations ranging from 1616 to 1594 feet msl (see *Plate 10* and the studies included at the end of this report). Based on a review of existing information, approximately 195 known sites could be affected during this period.

Big Bend. System regulation will be adjusted to maintain the Big Bend pool level in the normal 1420 to 1421 feet msl range during 2015. Short-term increases above 1421 due to local rainfall may also occur. Based on a review of existing information, no known sites will be affected during this period.

Fort Randall. As part of the normal System regulation, the Fort Randall pool elevations will vary between 1350 and 1355 feet msl during the spring and summer of 2015. Short-term increases above 1355 feet msl due to local rainfall may occur. The annual fall drawdown of the reservoir to elevation 1337.5 feet msl will begin prior to the close of the navigation season and will be accomplished by early December. The reservoir will then be refilled during the winter to elevation 1350 feet msl. Based on a review of existing information, approximately eight known sites could be affected during this period.

Gavins Point. System regulation will be adjusted to maintain the Gavins Point pool level in the normal 1206 to 1207.5 feet msl range during 2015. Short-term increases above 1207.5 feet msl may occur due to local rainfall. Based on a review of existing information, one known site could be affected during this period.

VII. SUMMARY OF RESULTS EXPECTED IN 2015

With regulation of the System in accordance with the 2014-2015 AOP outlined in the preceding pages, the following results can be expected. *Table V* summarizes the critical decision points throughout the year for all runoff conditions.

Table V
Summary of 2014-2015 AOP Studies

Decision Points	2015 Runoff Condition				
	Upper Decile	Upper Quartile	Median	Lower Quartile	Lower Decile
March 1 System Storage March 23-31 GP Release	56.1 MAF 26.7 kcfs	56.1 MAF 26.7 kcfs	56.1 MAF 26.7 kcfs	56.1 MAF 29.8 kcfs	56.1 MAF 29.8 kcfs
March 15 System Storage Spring Service Level	57.4 MAF Full service	57.2 MAF Full service	57.0 MAF Full service	56.6 MAF Full service	56.5 MAF Full service
May 1 System Storage May Early/Late May Avg GP Release	60.1 MAF None 36.0 kcfs	59.4 MAF 28.0/31.6 kcfs 29.9 kcfs	57.8 MAF 28.0/31.6 kcfs 29.9 kcfs	56.4 MAF 31.3/34.3 kcfs 32.8 kcfs	56.1 MAF 31.3/34.3 kcfs 32.8 kcfs
Fish Spawn Rise (Apr-Jun) FTPK Pool Elev Change GARR Pool Elev Change OAHE Pool Elev Change	+7.0 feet +7.0 feet +5.0 feet	+6.2 feet +6.5 feet +4.8 feet	+4.8 feet +4.9 feet +2.3 feet	+3.5 feet +1.5 feet -0.7 feet	+1.2 feet +0.6 feet -0.8 feet
July 1 System Storage Sum-Fall Service Level (kcfs) Nav Season Length	64.0 MAF Full Service plus evac 10 Day extension	63.1 MAF Full Service plus evac 10 Day extension	60.8 MAF Full Service 0 Days shortening	57.7 MAF Full Service 0 Days shortening	56.5 MAF 0.5 kcfs blw Full Service 0 Days shortening
September 1 System Storage Winter 2015-16 GP Release	62.1 MAF 20.0 kcfs	61.5 MAF 20.0 kcfs	59.3 MAF 17.0 kcfs	55.0 MAF 12.5 kcfs	53.1 MAF 12.5 kcfs
February 29 System Storage End-Year Pool Balance Percent Pool	56.1 MAF Balanced 100%	56.1 MAF Balanced 100%	55.6 MAF Balanced 99%	50.5 MAF Balanced 85%	48.3 MAF Balanced 79%

A. Flood Control. Flood control is the only authorized project purpose that requires the availability of empty storage space rather than impounded water. Actual flood events, especially those that are a result of rainfall runoff, are difficult to predict with much advance notice; therefore, detailed routing of specific major flood flows is accomplished when floods occur. There is a recurring pattern of high-risk flood periods during each year: a season when snowmelt, ice jams, and protracted heavy rains will almost surely occur with or without generating consequent floods; and a season when these situations are less likely and the flood threat is correspondingly low. The high-risk flood season begins about March 1 and extends through the summer. As a consequence, regulation of the System throughout the fall and winter months is predicated on the achievement of a March 1 System storage level at or below the base of the Annual Flood Control and Multiple Use Zone. All runoff scenarios studied for this AOP will begin the March 1, 2015 runoff season with System storage at the desired 56.1 MAF base of the Annual Flood Control and Multiple Use Zone. Therefore, the entire System flood control storage of 16.3 MAF, (11.6 MAF in the Annual Flood Control and Multiple Use Zone and 4.7 MAF in Exclusive Flood Control Zone) will be available to store surplus runoff.

To the extent practical, the System is regulated to prevent damaging flows in the river reaches between and below the Mainstem dams. In 2015, the full capacity of the System will be available to capture a significant volume of runoff originating from the upper basin and meter it out over an extended period of time at a rate that does not contribute to flooding in the river reaches between and below the reservoirs. Additionally, the reservoir system will have the capacity to reduce releases and hold back water during periods of high runoff below the System to reduce peak stages and discharges on the lower river. The ability to significantly reduce peak stages on the lower river diminishes at locations further downstream due to the large uncontrolled drainage area and travel time from the dam.

The base of the Exclusive Flood Control Zone defines the maximum level of storage that will be accumulated for purposes other than flood control. When the Exclusive Flood Control Zone at a particular reservoir is encroached upon, the control of subsequent flood inflows becomes the dominant factor. During such periods, releases may substantially exceed the powerplant release capacity with the evacuation rate of any project dependent upon existing flood conditions, the potential for further inflows, and conditions of other reservoirs in the System. Maximum release rates at such times are based upon the Master Manual flood control criteria, the flood control status of the System, and the critical need to preserve the integrity of the dams. Detailed information regarding the adjustments of releases for flood control evacuation and downstream flood control constraints can be found in Chapter 7 of the Master Manual.

Due to release limitations imposed by the formation of downstream ice cover, a major portion of the required flood control space must be evacuated prior to the winter season. Higher releases may be made on occasions when the downstream channel conditions permit. If plains and/or mountain snowpack accumulations are much above normal during the winter of 2014-2015, and studies indicate that available storage in the Carryover Multiple Use Zone as well as the Annual Flood Control and Multiple Use Zone will be fully utilized, releases may be adjusted to the extent reasonably possible to evacuate water from the reservoir system early in the runoff season. High releases during the late winter and early spring periods may exacerbate localized flooding if coincident with plains snowmelt or spring rains, and may also contribute to significant ice jam flooding. Therefore, if higher than normal releases are indicated, local conditions will need to be closely monitored. In addition, all 2015 runoff that is stored in the flood control zones will be evacuated prior to the start of the 2016 runoff season.

B. Water Supply and Water Quality Control. Water supply problems at intakes located in the river reaches both between and below the Mainstem dams and in the reservoirs are related primarily to intake elevations or river access rather than inadequate water supply. In emergency situations, short-term adjustments to protect human health and safety would be considered to keep intakes operational.

Low reservoir levels during the 2000-2007 drought contributed to both intake access and water quality problems for intakes on Garrison and Oahe reservoirs, including several Tribal intakes. A return to more normal reservoir elevations has eliminated concern over many of these intakes. If the drought conditions return, reservoir pool levels and releases may decline renewing the potential for intake access and water quality problems at both river and reservoir intakes. Under the Lower Decile runoff scenario, minimum reservoir levels in 2015 would be at least 22 feet higher than the record lows set in the 2000-2007 drought. Although not below the critical shutdown elevations for any intake, a return to lower reservoir levels would require extra monitoring to ensure the continued operation of the intakes.

Winter releases are determined based on the September 1 System storage check. The winter season extends from December through February and flows are provided during this time to support the Congressionally authorized project purposes of hydropower production and downstream water supply and water quality. Per the Master Manual, if September 1 System storage is 55.0 MAF or less, the winter release from Gavins Point will be 12,000 cfs. Planned winter release rates of 12,000 cfs may be less than required for downstream water supply intakes without sufficient incremental tributary flows below the System. Should that occur, releases may need to be set higher to ensure that downstream water supply intakes are operable. In 2012-2013, winter releases were set at 14,000 cfs rather than 12,000 cfs due to channel degradation and low incremental tributary flows below the System. Improved tributary flows in future winters would facilitate releases reaching the target level of 12,000 cfs. While the

Master Manual indicates that the water control plan's purpose is to meet water supply requirements in river reaches downstream of the reservoirs to the extent reasonably possible, the Corps believes the minimum winter release of 12,000 cfs presented in the Master Manual represents a reasonable long-term goal for water intake operability and for owners to strive for as they make improvements to their facilities. A letter was sent to intake owners in the spring of 2013 informing them of the Master Manual criteria and encouraging them to take necessary action to ensure their intakes are able to operate at reduced release rates. Coordination with intake owners will continue prior to and during the low release periods. In addition, it may be necessary at times to temporarily increase Gavins Point releases to provide adequate downstream flows during periods when excessive river ice formation is forecast or if ice jams or blockages form which temporarily restrict flow. Based on past experiences, these events are expected to occur infrequently and be of short duration.

In order to evacuate excess water, above normal Gavins Point releases are being scheduled in the winter of 2014-2015. Releases of 20,000 cfs are shown under all runoff scenarios. As shown in *Table V*, 2015-2016 winter releases of 20,000 cfs would be made for the Upper Decile and Upper Quartile runoff scenarios, 17,000 cfs for Median, and 12,500 cfs under Lower Quartile and Lower Decile runoff scenarios. The additional 500 cfs on Lower Quartile and Lower Decile reflects how the Corps, when conditions warrant, temporarily increases Gavins Point releases during extreme cold periods to inhibit the formation of ice jams in the lower river reach.

During non-navigation open water periods in the spring and fall the Master Manual includes System releases as low as 9,000 cfs as a water conservation measure provided that enough downstream tributary flow exists to allow for continued operation of downstream water intakes. If a non-navigation year would occur in the future, summer releases (May through August) could average around 18,000 cfs from the System. However, it should be noted that System releases will be set at levels that meet the operational requirements of water intakes to the extent reasonably possible. Problems have occurred at several downstream intakes in the past, however in all cases the problems have been associated with access to the river or reservoir rather than insufficient water supply. In addition, the low summer release rate would likely result in higher water temperatures in the river, which could impact a powerplant's ability to meet their thermal discharge permits. Again, it should be noted that System releases will be set at levels that allow the downstream powerplant to meet their thermal discharge permit requirements to the extent reasonably possible. This may mean that actual System releases in the hottest part of the summer period may be set well above the 18,000 cfs level. The Corps continues to encourage intake operators between and below the mainstem dams to make necessary modifications to their intakes to allow efficient operation over the widest possible range of hydrologic conditions. While the current level of System storage should allow adequate access for all intakes during the coming year, intake operators that have experienced difficulty with access during the

past drought years should continue to make adjustments to improve access and flexibility when drought returns to the basin.

C. Irrigation. Scheduled releases from the System reservoirs will be sufficient to meet the volumes of flow required for irrigation diversions from the Missouri River. Some access problems may be experienced, however, if Lower Quartile or Lower Decile runoff conditions return. Below Fort Peck, localized dredging may once again be required in the vicinity of irrigation intakes in order to maintain access to the water if releases are low next summer. Intake access problems are the responsibility of the intake owner and the Corps will not guarantee access, only that the supply of water in the Missouri River is adequate to meet this project purpose. Fort Peck releases may be adjusted during the irrigation season to provide more consistent flows at downstream locations as tributary flows vary. Tributary irrigation water usage is fully accounted for in the estimates of water supply.

D. Navigation. The anticipated service level and season length for all runoff conditions simulated are shown in *Table V*. Service to navigation in 2015 from the beginning of the navigation season through the July 1 storage check will be at full service for all runoff scenarios. After the July 1 storage check, Lower Quartile and higher runoff scenarios indicate at least full service to navigation. The July 1 storage check indicates 500 cfs below full service for the Lower Decile runoff scenario. In addition, the Upper Decile and Upper Quartile runoff scenarios indicate a 10-day extension to the navigation season based on the July 1 storage check. Median and below runoff indicates a full length navigation season. Although the AOP simulations provide a comparison of typical flow support under varying runoff conditions, the actual rate of flow support for the 2015 navigation season will be based on actual System storage on March 15 and July 1, 2015.

E. Power. *Table VI* and *Table VII* indicate the estimated monthly System load requirements and hydropower supply of the Eastern Division, Pick-Sloan Missouri Basin Program (P-S MBP), from September 2014 through December 2015. Estimates of monthly peak demands and energy include customer requirements for firm, short-term firm, summer firm, peaking, and various other types of power sales, System losses, and the effects of diversity. Also included in the estimated requirements are deliveries of power to the Western Division, P-S MBP, to help meet its firm power commitments. Under the Median runoff scenario, annual generation in 2015 is estimated to be 9.7 million MWh, 103 percent of the 1967-2013 average.

TABLE VI
PEAKING CAPABILITY AND SALES
(1,000 kW at plant)

Estimated Committed Sales*	2014	Expected C of E Capability			Expected Bureau Capability**			Expected Total System Capability			
		U.B.	Basic	L.B.	U.B.	Basic	L.B.	U.B.	Basic	L.B.	
Sep	2012	2382	2381	2379	201	200	198	2583	2581	2577	
Oct	1876	2351	2358	2362	201	199	197	2552	2557	2559	
Nov	1984	2296	2309	2323	200	199	196	2496	2508	2519	
Dec	2115	2289	2296	2305	197	196	194	2486	2492	2499	
<u>2015</u>											
Jan	2129	2311	2315	2319	194	194	192	2505	2509	2511	
Feb	2114	2320	2320	2320	191	192	191	2511	2512	2511	
		U.D.	U.Q.	Med	L.Q.	L.D.	U.D.	U.Q.	Med	L.Q.	L.D.
Mar	2047	2342	2336	2329	2323	2322	189	189	190	190	190
Apr	1916	2362	2353	2334	2315	2312	183	183	188	189	189
May	1878	2385	2369	2338	2312	2307	185	185	193	193	193
Jun	2078	2399	2393	2372	2324	2312	199	199	199	196	197
Jul	2197	2390	2385	2367	2313	2294	201	201	201	196	196
Aug	2201	2376	2373	2355	2291	2270	199	199	199	195	194
Sep	2017	2368	2365	2342	2282	2253	201	199	200	197	195
Oct	1879	2334	2335	2319	2242	2230	201	198	200	198	195
Nov	1987	2294	2298	2284	2214	2191	199	197	199	197	194
Dec	2116	2251	2254	2248	2181	2155	197	195	196	195	192

* Estimated sales, including system reserves. Power in addition to hydro production needed for these load requirements will be obtained from other power systems by interchange or purchase.

** Total output of Canyon Ferry and 1/2 of the output of Yellowtail powerplant.

TABLE VII
ENERGY GENERATION AND SALES
 (Million kWh at plant)

Estimated Committed Sales*	2014	Expected C of E Generation			Expected Bureau Generation **			Expected Total System Generation								
		U.B.	Basic	L.B.	U.B.	Basic	L.B.	U.B.	Basic	L.B.						
Sep	738	1206	1125	1070	74	64	57	1280	1190	1127						
Oct	736	1231	1023	791	78	64	55	1309	1087	846						
Nov	803	1191	1005	795	76	63	53	1267	1068	848						
Dec	913	843	737	688	78	72	57	921	810	744						
2015																
Jan	927	782	776	739	77	73	57	859	849	796						
Feb	896	687	686	656	68	64	50	755	750	706						
		U.D.	U.Q.	Med	L.Q.	L.D.	U.D.	U.Q.	Med	L.Q.	U.D.	U.Q.	Med	L.Q.	L.D.	
Mar	813	648	653	615	654	667	75	75	71	52	52	723	728	685	707	719
Apr	767	756	689	740	855	862	101	95	67	46	46	857	784	807	901	909
May	716	1063	913	903	1004	1000	117	117	92	50	50	1180	1030	995	1054	1051
Jun	778	1262	1117	938	1000	996	114	114	105	52	52	1375	1230	1043	1052	1047
Jul	868	1452	1312	1013	1072	1055	118	117	80	51	51	1570	1429	1093	1124	1106
Aug	861	1454	1315	1050	1069	1051	97	96	71	51	51	1551	1412	1121	1121	1102
Sep	740	1348	1202	923	874	913	86	85	67	49	48	1434	1287	990	923	961
Oct	736	1241	1079	762	781	750	82	85	67	51	47	1323	1164	829	832	797
Nov	805	1217	1062	671	701	639	79	76	73	53	43	1296	1138	744	754	682
Dec	914	840	808	661	545	542	81	78	75	57	44	922	886	736	602	586
CY TOT		12750	11619	9738	9950	9870	1094	1083	904	620	592	13844	12702	10641	10570	10462

* Estimated sales including system reserves and losses. Power in addition to hydro production needed for these load requirements will be obtained from other systems by interchange or purchase.

** Total output Canyon Ferry and 1/2 output of Yellowtail powerplant.

F. Recreation, Fish and Wildlife. The regulation of the System will continue to provide recreation and fish and wildlife opportunities in the project areas and along the Missouri River as well as other benefits of a managed system. Recreation access is expected to be at near normal levels in 2015. If Lower Quartile or Lower Decile runoff were to occur in 2015, boat ramps that were lowered and low water ramps that were constructed during the two recent drought periods will provide adequate reservoir access. Special regulation adjustments incorporating specific objectives for these purposes will be made to the extent reasonably possible. Overall conditions should be favorable for the many visitors who enjoy the camping, boating, fishing, hunting, swimming, picnicking, and other recreational activities associated with the System reservoirs.

The effects of the simulated System regulation during 2015 on fish and wildlife are included in Chapter VI, Section F, entitled, "Regulation Activities for T&E Species and Fish Propagation Enhancement."

G. Historic and Cultural Properties. As mentioned in Chapter VI of this AOP, the regulation of the System during 2014 and 2015 will expose cultural sites due to erosion from the normal fluctuation of pool elevations. The Corps will work with the Tribes utilizing 36 CFR Part 800 and the PA to address the exposure of these sites. The objective of a programmatic agreement is to deal "...with the potential adverse effects of complex projects or multiple undertakings..." The PA objective was to collaboratively develop a preservation program that would avoid, minimize and/or mitigate the adverse affects of the System operation. All tribes, whether signatory to the PA or not, may request government-to-government consultation on the regulation of the System and the resulting effect on historic and cultural properties and other resources.

The planned preservation program for this AOP is outlined by multiple stipulations in the PA. One of the stipulations, or program components, is the Five-Year Plan. This plan outlines how the Corps will accomplish its responsibilities under the PA and the National Historic Preservation Act. The "Cultural Resource Program Final Five Year Plan, dated February 2012" (see <http://www.nwo.usace.army.mil/Missions/CivilWorks/CulturalResources.aspx>) is currently being implemented. The plan includes inventory, testing and evaluation, mitigation and other specific activities that will allow the Corps to avoid, minimize and/or mitigate the adverse effects to cultural sites on Corps lands within the System. Many of the actions listed in the plan are within the elevation ranges that will occur with the implementation of the Master Manual criteria in 2014 and 2015. Two critical components of the Five-Year Plan that are applicable to this AOP are monitoring and mitigation, which will be briefly discussed in the following paragraphs.

First, a collaboratively developed plan, entitled "Final Cultural Resource Monitoring Plan, dated June 2014" (see <http://www.nwo.usace.army.mil/Missions/CivilWorks/CulturalResources.aspx>) is in place. This monitoring plan outlines the sites that require monitoring and specifies a frequency for monitoring. The Corps is strategically monitoring sites, including those sites within the potential operating pool elevations, to document the effects of the implementation of the 2014-2015 AOP. Specific sites are identified in the draft Monitoring and Enforcement Plan for the monitoring team, comprised of Corps rangers and Tribal monitors, to visit and document impacts. This focused monitoring is resulting in more accurate data on the current impacts to sites along the river plus it is assisting with the identification of sites for mitigation. The most recent training for the monitoring teams was held in July 2014.

Second, mitigation or protection of sites that are being adversely impacted continues. During the reporting period for the 2013 Annual Report by the Corps on the implementation of the Programmatic Agreement, 12 sites were either completed, started, or in the design phase. The annual report is available at <http://www.nwo.usace.army.mil/Missions/CivilWorks/CulturalResources.aspx>. In addition the Corps completed a contract to develop an erosion model that will compare modeling data against actual erosion data, collected by the monitoring team, to assist in the prioritization of sites for protection. Work on the erosion model was completed in June 2011.

Results expected from the proposed monitoring and mitigation actions include more accurate horizontal and vertical data on existing cultural sites, detailed impact data, proactive protection and preservation of sites. The effects of the simulated System regulation during 2014-2015 on cultural sites are included in the Chapter VI, section G., entitled, "Regulation Activities for Historic and Cultural Properties."

H. System Storage. If the September 1, 2014 Basic runoff forecast verifies, System storage will decline to 56.5 MAF by the end of 2014. This would be 22.6 MAF higher than the record low System storage of 33.9 MAF set on February 9, 2007 and 6.4 MAF higher than the 2013 end-of-year storage of 50.1 MAF. This end-of-year storage is 3.9 MAF more than the 1967-2013 average. The lowest storage during the 1988-1992 drought was 40.8 MAF in January 1991, and the record low storage was set during the 2000-2007 drought at 33.9 MAF in February 2007. The end-of-year System storages have ranged from a maximum of 60.9 MAF in 1975, to the 2006 minimum of 34.4 MAF. Forecasted System storage on December 31, 2015 is presented in *Table VIII* for the runoff scenarios simulated.

TABLE VIII
ANTICIPATED DECEMBER 31, 2015 SYSTEM STORAGE

Water Supply Condition	Total (12/31/15)	Carryover Storage Remaining 1/	Unfilled Carryover Storage 2/	Total Change CY 2015
(Volumes in 1,000 Acre-Feet)				
Upper Decile	56,300	38,500	0	200
Upper Quartile	56,500	38,500	0	500
Median	55,800	38,200	300	-700
Lower Quartile	50,500	32,900	5,600	-6,400
Lower Decile	48,400	30,800	7,700	-8,500

1/ Net usable storage above 17.6 MAF System minimum pool level established for power, recreation, irrigation diversions, and other purposes.

2/ System base of Annual Flood Control and Multiple Use Zone containing 56.1 MAF.

I. **Summary of Water Use by Functions.** Anticipated water use in CY 2014, under the regulation plan with the Basic forecast of water supply is shown in *Table IX*. Under the reservoir regulation simulations in this AOP, estimated water use in CY 2015 also is shown in *Table IX*. Actual water use data for CY 2013 are included for information and comparison.

TABLE IX
MISSOURI RIVER MAINSTEM SYSTEM
WATER USE FOR CALENDAR YEARS 2013, 2014, AND 2015 ABOVE SIOUX CITY, IOWA
in Million Acre-Feet (MAF)

		CY 2013 Actual	CY 2014 Basic Simulation	Upper Decile	Upper Quartile	Median	Simulations for Calendar Year 2015	
							Lower Quartile	Lower Decile
Upstream Depletions	(1)							
Irrigation, Tributary Reservoir								
Evaporation & Other Uses		2.7	2.6					
Tributary Reservoir Storage Change		0.0	0.2					
Total Upstream Depletions		2.7	2.8	2.9	2.7	2.9	2.7	2.4
System Reservoir Evaporation	(2)	2.8	2.5	1.2	1.2	1.8	2.1	2.0
Sioux City Flows								
Navigation Season								
Unregulated Flood Inflows Between								
Gavins Point & Sioux City (3)		0.0	0.4					
Navigation Service Requirement (4)		13.6	16.3	16.6	16.2	16.0	16.3	16.1
Supplementary Releases								
T&E Species (5)		0.2	0.5	0.3	0.3	0.3	0.3	0.3
Flood Evacuation (6)		0.0	2.8	8.4	5.0	0.0	0.0	0.0
Non-navigation Season								
Flows		3.4	3.5	4.4	4.4	4.3	4.1	3.8
Flood Evacuation Releases (7)		0.0	0.4	0.5	0.4	0.0	0.0	0.0
System Storage Change		1.7	6.4	0.2	0.4	-0.7	-6.4	-8.5
Total		25.1	35.6	34.5	30.6	24.6	19.3	16.1
Project Releases								
Fort Peck		5.5	5.1	8.1	7.2	6.1	5.9	6.1
Garrison		13.1	16.5	21.0	19.1	15.9	15.7	17.3
Oahe		13.3	18.7	23.8	21.1	17.4	18.8	18.5
Big Bend		12.3	18.0	23.7	21.0	17.3	18.7	18.3
Fort Randall		13.9	19.4	25.1	22.1	18.0	18.0	18.5
Gavins Point		15.2	20.1	27.2	24.0	19.4	20.1	19.6

- (1) Tributary uses above the 1949 level of development including agricultural depletions and tributary storage effects.
- (2) Net evaporation is shown for 2015.
- (3) Incremental inflows to reach which exceed those usable in support of navigation at the target level, even if Gavins Point releases were held to as low as 6,000 cfs.
- (4) Estimated requirement for downstream water supply and water quality is approximately 6.0 MAF.
- (5) Increased releases required for endangered species regulation.
- (6) Includes flood control releases for flood control storage evacuation and releases used to extend the navigation season beyond the normal December 1 closing date at the mouth of the Missouri River.
- (7) Releases for flood control storage evacuation in excess of a 17,000 cfs Gavins Point release.

VIII. TENTATIVE PROJECTION OF REGULATION THROUGH FEBRUARY 2021

The 5-year extensions to the AOP (March 2016 to February 2021) have been prepared to serve as a guide for the Western Area Power Administration's marketing activities and to provide data to allow basin interests to conduct long-term planning. Three runoff conditions are modeled in the extension studies: Median, Lower Quartile, and Lower Decile.

The full 16.3 MAF of flood control capacity or more would be available at the start of each runoff season. The navigation service level and season length criteria described in *Plate 3* were applied to the extensions. The March 15 and July 1 System storage checks shown in *Plate 3* were used to determine the flow support for navigation and other downstream uses and the navigation season length. A steady release – flow-to-target (SR-FTT) regulation with cycling in May was modeled during the T&E bird species' nesting season. The Gavins Point releases to meet navigation target flows, as shown in *Plate 3* and as computed by the March 15 and July 1 System storage checks, were used prior to and following the nesting season. The September 1 System storage check was used to determine the winter System release. Navigation service support and season length, March 1 reservoir unbalancing, end of year System storage, and the winter release rate for the extensions are shown on *Table X*. The March and May spring pulses are currently on hold pending their review as discussed in Chapter III and were not included in the extension studies. The criteria considered as each year of the extensions was modeled are listed, along with the results, in *Tables XI through XIII* for the Median, Lower Quartile, and Lower Decile extension studies, respectively.

A. Median Runoff. Studies 9 through 13 present the results of simulating Median runoff (24.6 MAF) from March 2016 through February 2021. The March 1, 2016 System storage would be 55.6 MAF and would decrease to 53.5 MAF by March 1, 2021, 2.6 MAF below the desired March 1 storage of 56.1 MAF, the base of the annual flood control and multiple use pool. The navigation service level would be full service for the study period of 2016 to 2020. There would be full navigation seasons for the study period of 2016 through 2020. Winter releases would range from 17,000 cfs in the winter of 2016-2017 to 14,800 cfs in winter 2020-2021. For the entire study period, the carryover multiple use storage in Fort Peck, Garrison, and Oahe was balanced on March 1 each year.

TABLE X
NAVIGATION SERVICE SUPPORT, SPRING PULSES, UNBALANCING
AOP EXTENSION STUDIES

	2016	2017	2018	2019	2020
MEDIAN					
Annual Runoff Volume (MAF)	24.6	24.6	24.6	24.6	24.6
Spring Pulse					
March (kcfs)	N/A	N/A	N/A	N/A	N/A
May (kcfs)	N/A	N/A	N/A	N/A	N/A
Flow Level Below Full Service					
Spring (kcfs)	Full	Full	Full	Full	Full
Summer/Fall (kcfs)	Full	Full	Full	Full	Full
Season Length	8 months	8 months	8 months	8 months	8 months
Reservoir Unbalancing (ft)					
Fort Peck	0	0	0	0	0
Garrison	0	0	0	0	0
Oahe	0	0	0	0	0
Dec 31 Storage (MAF)	55.3	54.8	54.3	53.8	53.5
Winter Release (kcfs)	17.0	17.0	16.3	15.5	14.8
Special Information					
LOWER QUARTILE					
Annual Runoff Volume (MAF)	19.9	20.2	21.8	22.8	24.4
Spring Pulse					
March (kcfs)	N/A	N/A	N/A	N/A	N/A
May (kcfs)	N/A	N/A	N/A	N/A	N/A
Flow Level Below Full Service					
Spring (kcfs)	Full-3.6	Full-6.0	Full-6.0	Full-6.0	Full-6.0
Summer/Fall (kcfs)	Full-3.8	Full-5.9	Full-6.0	Full-5.8	Full-4.3
Season Length	8 mnths	8 mnths-6days	8 mnths-9days	8 mnths-5days	8 mnths
Reservoir Unbalancing (ft)					
Fort Peck	0	0	0	0	0
Garrison	0	0	0	0	0
Oahe	0	0	0	0	0
Dec 31 Storage (MAF)	47.3	46.0	46.0	46.7	48.0
Winter Release (kcfs)	12.5	12.5	12.5	12.5	12.5
LOWER DECILE					
Annual Runoff Volume (MAF)	17.1	17.5	18.5	19.3	19.5
Spring Pulse					
March (kcfs)	N/A	N/A	N/A	N/A	N/A
May (kcfs)	N/A	N/A	N/A	N/A	N/A
Flow Level Below Full Service					
Spring (kcfs)	Full-6.0	Full-6.0	Full-6.0	Full-6.0	Full-6.0
Summer/Fall (kcfs)	Full-6.0	Full-6.0	Full-6.0	Full-6.0	Full-6.0
Season Length	8 mnths-10days	8 mnths-30days	8 mnths-30days	8 mnths-30 days	8 mnths-30days
Reservoir Unbalancing (ft)					
Fort Peck	0	0	0	0	0
Garrison	0	0	0	0	0
Oahe	0	0	0	0	0
Dec 31 Storage (MAF)	44.1	41.2	39.3	38.0	37.0
Winter Release (kcfs)	12.5	12.5	12.5	12.5	12.5

* Limited by Downstream Flood-Control Limits.

N/A - The March and May Spring Pulses are currently on hold. See Chapter III for more information.

Median Extension Studies - Criteria Considered in the Modeling Process						
Study Number	Units	Criteria	2016-2017	2017-2018	2018-2019	2019-2020
March 1 Storage	MAF	40	55.6	55.1	54.6	54.1
- March Spring Pulse?	N/A		N/A	N/A	N/A	N/A
March 15 Storage	MAF	31/49/54.5	56.4	56.0	55.4	55.0
- Service Level	N/A or kcfs	No Seal/Min/Full Thresholds	Full	Full	Full	Full
- 3rd Period March GP Q	kcfs		26.7	26.7	26.7	26.7
- April Gavins Point Q	kcfs		26.7	26.7	26.7	26.7
May 1 Storage	MAF	40	57.3	56.8	56.3	55.9
- May Spring Pulse?	N/A		N/A	N/A	N/A	N/A
- Pulse Magnitude*	kcfs		N/A	N/A	N/A	N/A
- Gavins Point Cycling Qs	kcfs		28.0/31.6	28.0/31.6	28.0/31.6	28.0/31.6
- May Gavins Point Q	kcfs		29.9	29.9	29.9	29.9
- June Gavins Point Q	kcfs		31.6	31.6	31.6	31.6
July 1 Storage	MAF	50.5/57	60.3	59.8	59.2	58.8
- Service Level	N/A	Min/Full Thresholds	Full	Full	Full	Full
- July Gavins Point Q	kcfs		31.6	31.6	31.6	31.6
- Aug Gavins Point Q	kcfs		33.2	33.2	33.2	33.2
- Sept Gavins Point Q	kcfs		32.6	32.6	32.6	32.6
July 1 Storage	MAF	36.5/41&46.8/51.5	60.3	59.8	59.2	58.8
- Season Length Shortening	days	61/31&31/0 Thresholds	0	0	0	0
- Oct Gavins Point Q	kcfs		32.0	32.0	32.0	32.0
- Nov Gavins Point Q	kcfs		27.7	27.7	27.7	27.7
September 1 Storage	MAF	55/58	58.8	58.2	57.6	57.1
- Winter Gavins Point Q	kcfs	12/17 Thresholds	17.0	17.0	16.3	15.5
End-of-Year Reservoir Storage (12/31)	MAF		55.3	54.8	54.3	53.8
- Percent Full	N/A		100%	98%	97%	95%
Balance/Unbalance	N/A	Bal <2227/1827/1600 ft ms/	Balanced	Balanced	Balanced	Balanced
Fort Peck Rise 3/31-5/31	N/A		Yes	Yes	Yes	Yes
Garrison Rise 3/31-5/31	N/A		Yes	Yes	Yes	Yes
Oahe Rise 3/31-5/31	N/A		Yes	Yes	Yes	Yes
Favored Reservoir - Fish Spawn	N/A		GA	FP/OA	GA	GA

* Pulse magnitudes are the calculated magnitude per technical criteria and simulated magnitude due to the downstream flow limits

N/A - The March and May Spring Pulses are currently on hold. See Chapter III for more information.

Study Number	Units	Criteria	14	15	16	17	18
			2016-2017	2017-2018	2018-2019	2019-2020	2020-2021
March 1 Storage	MAF	40	50.5	47.4	46.1	46.2	47.0
- March Spring Pulse?	N/A		N/A	N/A	N/A	N/A	N/A
March 15 Storage	MAF	31/49/54.5	51.2	48.1	46.9	47.1	47.9
- Service Level	N/A or kcfs	No Seal/Min/Full Thresholds	Full - 3.6	Min Service	Min Service	Min Service	Min Service
- 3rd Period March GP Q	kcfs		26.2	23.8	23.8	23.8	23.8
- April Gavins Point Q	kcfs		26.2	23.8	23.8	23.8	23.8
May 1 Storage	MAF	40	51.4	48.7	47.7	48.0	49.1
- May Spring Pulse?	N/A		N/A	N/A	N/A	N/A	N/A
- Pulse Magnitude*	kcfs		N/A	N/A	N/A	N/A	N/A
- Gavins Point Cycling Qs	kcfs		27.7/30.7	25.3/28.3	25.3/28.3	25.3/28.3	25.3/28.3
- May Gavins Point Q	kcfs		29.2	26.8	26.8	26.8	26.9
- June Gavins Point Q	kcfs		30.7	28.3	28.3	28.3	28.3
July 1 Storage	MAF	50.5/57	52.9	50.6	50.1	50.7	52.3
- Service Level	N/A	Min/Full Thresholds	Full - 3.8	Full - 5.9	Min Service	Full - 5.8	Full - 4.3
- July Gavins Point Q	kcfs		30.5	28.4	28.3	28.5	30.0
- Aug Gavins Point Q	kcfs		30.2	28.1	28.0	28.2	29.7
- Sept Gavins Point Q	kcfs		29.7	27.6	27.5	27.7	29.2
July 1 Storage	MAF	36.5/41&46.8/51.5	52.9	50.6	50.1	50.7	52.3
- Season Length Shortening	days	6/1/31&31/0 Thresholds	0	6	9	5	0
- Oct Gavins Point Q	kcfs		29.3	27.2	27.1	27.3	28.8
- Nov Gavins Point Q	kcfs		24.4	18.9	17.2	19.5	23.9
September 1 Storage	MAF	55/58	50.8	48.8	48.5	49.2	50.8
- Winter Gavins Point Q	kcfs	12/17 Thresholds	12.5	12.5	12.5	12.5	12.5
End-of-Year Reservoir Storage (12/31)	MAF		47.3	46.0	46.0	46.7	48.0
- Percent Full	N/A		78%	74%	74%	76%	79%
Balance/Unbalance	N/A	Bal <2227/1827/1600 ft ms/	Balance	Balance	Balance	Balance	Balance
Fort Peck Rise 3/31-5/31	N/A		Yes	Yes	Yes	Yes	Yes
Garrison Rise 3/31-5/31	N/A		Yes	Yes	Yes	Yes	Yes
Oahe Rise 3/31-5/31	N/A		No	Yes	Yes	Yes	Yes
Favored Reservoir - Fish Spawn	N/A		GA	FP/OA	GA	FP/OA	GA

* Pulse magnitudes are the calculated magnitude per technical criteria and simulated magnitude due to the downstream flow limits

N/A - The March and May Spring Pulses are currently on hold. See Chapter III for more information.

Study Number	Units	Criteria	19	20	21	22	23
			2016-2017	2017-2018	2018-2019	2019-2020	2020-2021
March 1 Storage	MAF	40	48.3	44.1	41.3	39.4	38.2
- March Spring Pulse?	N/A		N/A	N/A	N/A	N/A	N/A
March 15 Storage	MAF	31/49/54.5	48.9	44.7	42.0	40.2	38.9
- Service Level	N/A or kcfs	No Seal/Min/Full Thresholds	Min Service				
- 3rd Period March GP Q	kcfs		23.8	23.8	23.8	23.8	23.8
- April Gavins Point Q	kcfs		23.8	23.8	23.8	23.8	23.8
May 1 Storage	MAF	40	49.1	45.0	42.4	40.7	39.5
- May Spring Pulse?	N/A		N/A	N/A	N/A	N/A	N/A
- Pulse Magnitude	kcfs		N/A	N/A	N/A	N/A	N/A
- Gavins Point Cycling Qs	kcfs		25.3/28.3	25.3/28.3	25.3/28.3	25.3/28.3	25.3/28.3
- May Gavins Point Q	kcfs		26.8	26.8	26.8	26.8	26.8
- June Gavins Point Q	kcfs		28.3	28.3	28.3	28.3	28.3
July 1 Storage	MAF	50.5/57	50.0	46.2	43.9	42.4	41.3
- Service Level	N/A	Min/Full Thresholds	Min Service				
- July Gavins Point Q	kcfs		28.3	28.3	28.3	28.3	28.3
- Aug Gavins Point Q	kcfs		28.0	28.0	28.0	28.0	28.0
- Sept Gavins Point Q	kcfs		27.5	27.5	27.5	27.5	27.5
July 1 Storage	MAF	36.5/41&46.8/51.5	50.0	46.2	43.9	42.4	41.3
- Season Length Shortening	days	61/31&31/0 Thresholds	10	30	30	30	30
- Oct Gavins Point Q	kcfs		27.1	23.9	23.9	23.9	23.9
- No Gavins Point Q	kcfs		16.7	9.0	9.0	9.0	9.0
September 1 Storage	MAF	55/58	47.2	43.4	41.2	39.8	38.7
- Winter Gavins Point Q	kcfs	12/17 Thresholds	12.5	12.5	12.5	12.5	12.5
End-of-Year Reservoir Storage (12/31)	MAF		44.1	41.2	39.3	38.0	37.0
- Percent Full	N/A		69%	61%	56%	53%	50%
Balance/Unbalance	N/A	Bal <2227/1827/1600 ft ms/	Balance	Balance	Balance	Balance	Balance
Fort Peck Rise 3/31-5/31	N/A		Yes	Yes	Yes	Yes	Yes
Garrison Rise 3/31-5/31	N/A		Yes	Yes	Yes	Yes	Yes
Oahe Rise 3/31-5/31	N/A		No	Yes	No	Yes	No
Favored Reservoir - Fish Spawn	N/A		GA	FP/OA	GA	FP/OA	GA

* Pulse magnitudes are the calculated magnitude per technical criteria and simulated magnitude due to the downstream flow limits

N/A - The March and May Spring Pulses are currently on hold. See Chapter III for more information.



B. Lower Quartile Runoff. Studies 14 through 18 show the results of Lower Quartile runoff extensions. System storage on March 1, 2016 would be 50.5 MAF and decrease to 47.0 MAF by March 1, 2021. Navigation service levels would range between 3,800 cfs below full service to minimum service for the simulation period 2016 to 2020. The navigation season is shortened 0 days in 2016, 6 days in 2017, 9 days in 2018, 5 days in 2019, and 0 days in 2020. A 12,500-cfs average winter release is shown for the entire study period. Under Lower Quartile runoff, the carryover multiple use storage in the upper three reservoirs would be balanced each March 1.

C. Lower Decile Runoff. Studies 19 through 23 show the results of Lower Decile runoff extensions. System storage would be 48.3 MAF on March 1, 2016 and gradually decrease to 38.2 MAF on March 1, 2021. Navigation service levels would be at minimum navigation service levels throughout the season for all extension years. The navigation season would be shortened 10 days in 2016 and 30 days in 2017 through 2020. The intrasystem storage is balanced each March 1 for the entire study period.

Plate 14 presents System storage, Gavins Point releases, and System peaking capability for Median, Lower Quartile, and Lower Decile runoff for the period 2016 through February 2021. Peak power, or peaking capability, is the amount of power available when all powerplants are operating at maximum.

Plate 15 presents reservoir pool elevations for Fort Peck, Garrison, Oahe, and Fort Randall for Median, Lower Quartile, and Lower Decile runoff for the period 2016 through February 2021.

This page intentionally left blank.

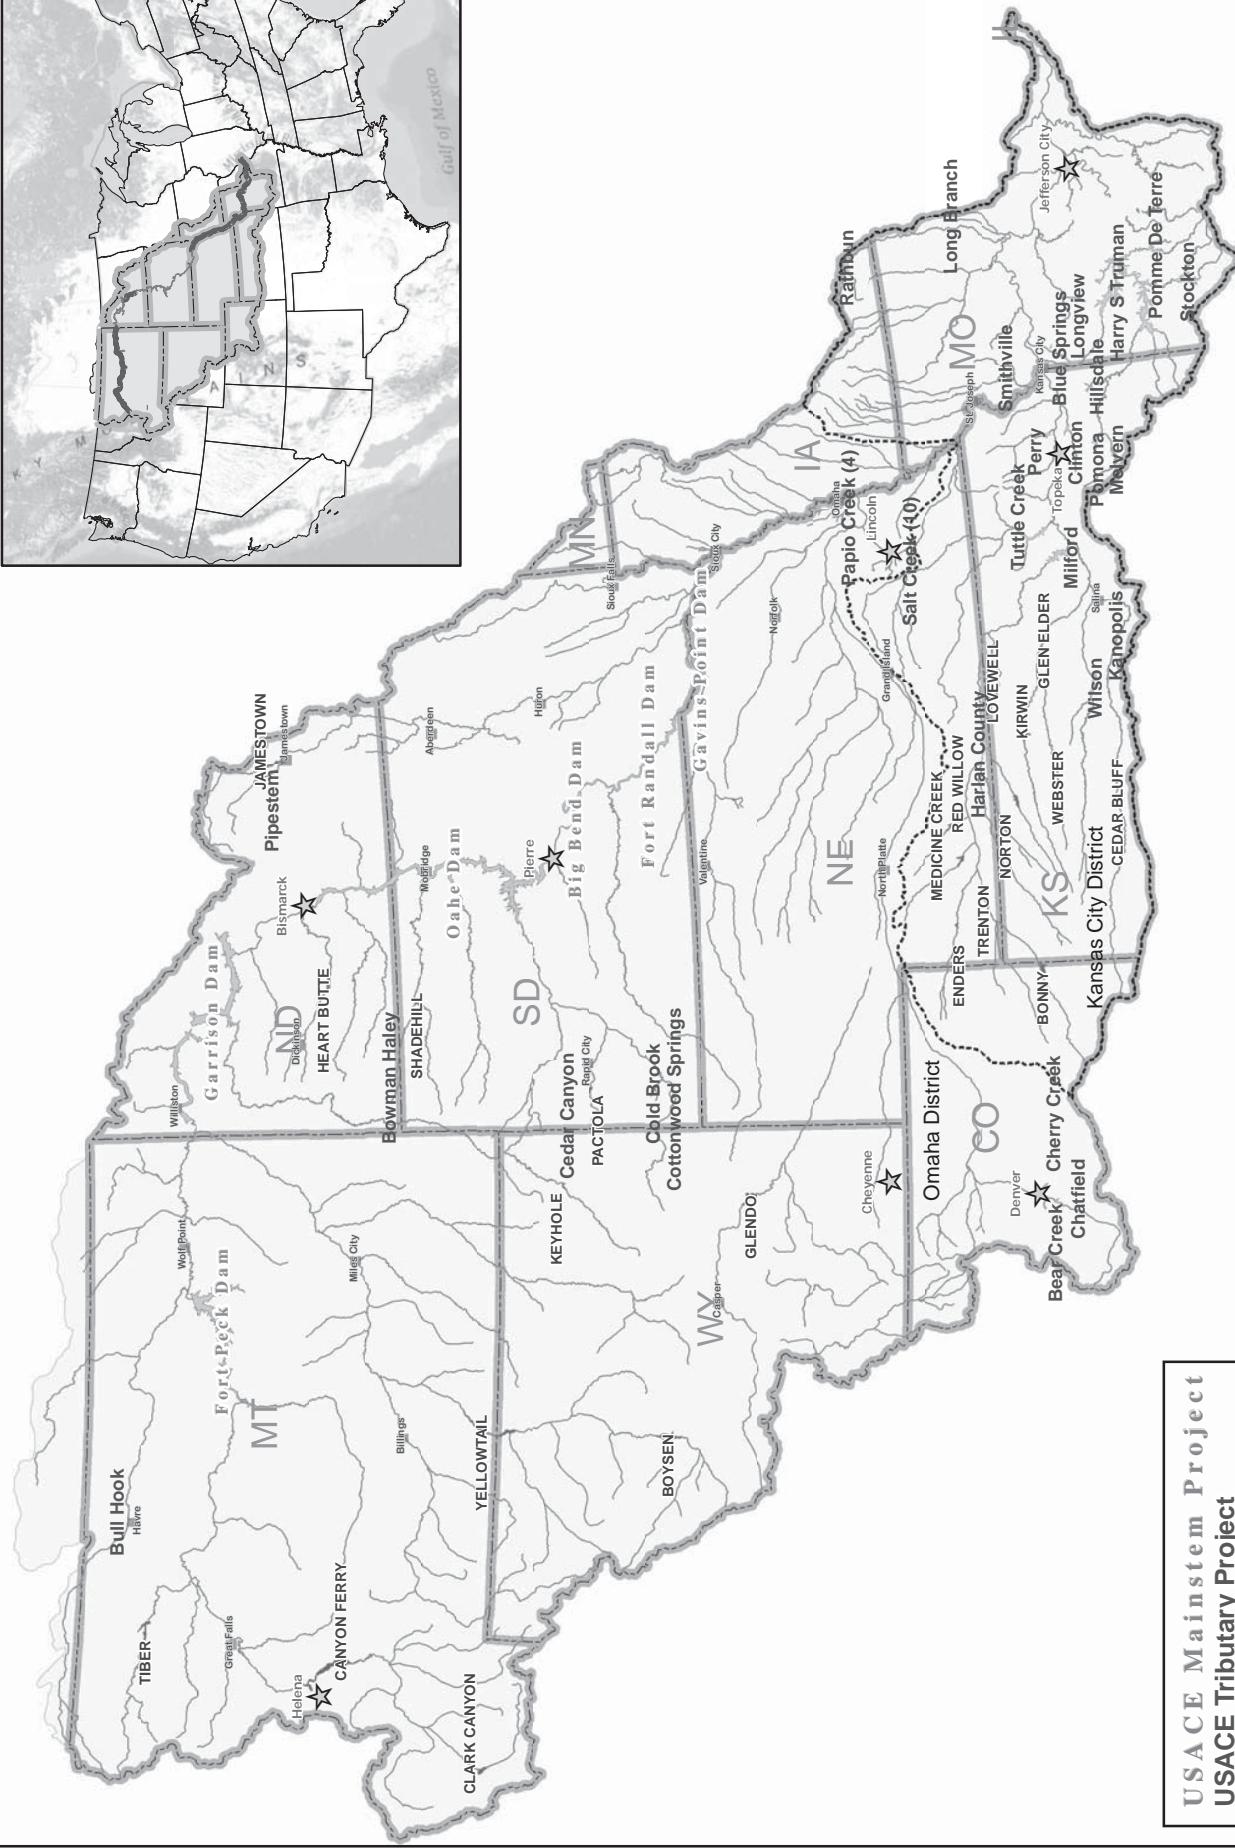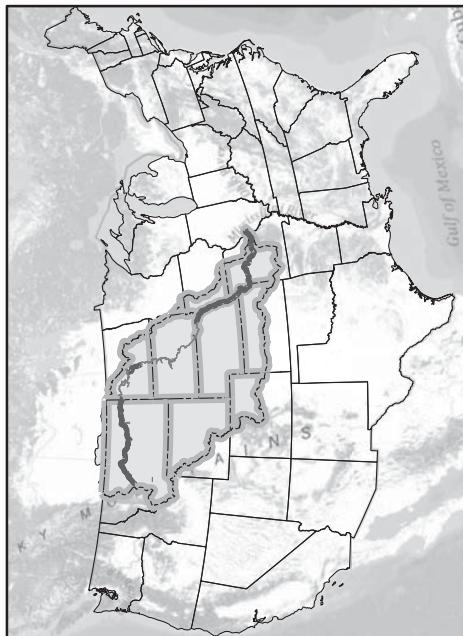

Missouri River Basin

U.S. ARMY ENGINEERS, NORTHWESTERN DIVISION
 CORPS OF ENGINEERS, OMAHA, NEBRASKA

AUGUST 2011

PLATE 1. Missouri River Basin Map.

Summary of Engineering Data -- Missouri River Mainstem System

Item No.	Subject	Fort Peck Dam - Fort Peck Lake	Garrison Dam - Lake Sakakawea	Oahe Dam - Lake Oahe	
1	Location of Dam	Near Glasgow, Montana	Near Garrison, ND	Near Pierre, SD	
2	River Mile - 1960 Mileage	Mile 1771.5	Mile 1389.9	Mile 1072.3	
3	Total & incremental drainage areas in square miles	57,500	181,400 (2)	123,900	243,490 (1) 62,090
4	Approximate length of full reservoir (in valley miles)	134, ending near Zortman, MT	178, ending near Trenton, ND	231, ending near Bismarck, ND	
5	Shoreline in miles (3)	1520 (elevation 2234)	1340 (elevation 1837.5)	2250 (elevation 1607.5)	
6	Average total & incremental inflow in cfs	10,200	25,600	15,400	28,900 3,300
7	Max. discharge of record near damsite in cfs	137,000 (June 1953)	348,000 (April 1952)	440,000 (April 1952)	
8	Construction started - calendar yr.	1933	1946	1948	
9	In operation (4) calendar yr.	1940	1955	1962	
10	<u>Dam and Embankment</u>				
11	Top of dam, elevation in feet msl	2280.5	1875	1660	
12	Length of dam in feet	21,026 (excluding spillway)	11,300 (including spillway)	9,300 (excluding spillway)	
13	Damming height in feet (5)	220	180	200	
14	Maximum height in feet (5)	250.5	210	245	
15	Max. base width, total & w/o berms in feet	3500, 2700	3400, 2050	3500, 1500	
16	Abutment formations (under dam & embankment)	Bearpaw shale and glacial fill	Fort Union clay shale	Pierre shale	
17	Type of fill	Hydraulic & rolled earth fill	Rolled earth filled	Rolled earth fill & shale berms	
18	Fill quantity, cubic yards	125,628,000	66,500,000	55,000,000 & 37,000,000	
19	Volume of concrete, cubic yards	1,200,000	1,500,000	1,045,000	
	Date of closure	24 June 1937	15 April 1953	3 August 1958	
20	<u>Spillway Data</u>				
21	Location	Right bank - remote	Left bank - adjacent	Right bank - remote	
22	Crest elevation in feet msl	2225	1825	1596.5	
23	Width (including piers) in feet	820 gated	1336 gated	456 gated	
24	No., size and type of gates	16 - 40' x 25' vertical lift gates	28 - 40' x 29' Tainter	8 - 50' x 23.5' Tainter	
25	Design discharge capacity, cfs	275,000 at elev 2253.3	827,000 at elev 1858.5	304,000 at elev 1644.4	
	Discharge capacity at maximum operating pool in cfs	230,000	660,000	80,000	
26	<u>Reservoir Data (6)</u>				
27	Max. operating pool elev. & area	2250 msl	245,000 acres	1854 msl	383,000 acres
28	Max. normal op. pool elev. & area	2246 msl	240,000 acres	1850 msl	365,000 acres
29	Base flood control elev & area	2234 msl	211,000 acres	1837.5 msl	308,000 acres
	Min. operating pool elev. & area	2160 msl	89,000 acres	1775 msl	125,000 acres
30	<u>Storage allocation & capacity</u>				
31	Exclusive flood control	2250-2246	971,000 a.f.	1854-1850	1,495,000 a.f.
32	Flood control & multiple use	2246-2234	2,704,000 a.f.	1850-1837.5	4,211,000 a.f.
33	Carryover multiple use	2234-2160	10,700,000 a.f.	1837.5-1775	12,951,000 a.f.
34	Permanent	2160-2030	4,088,000 a.f.	1775-1673	4,794,000 a.f.
35	Gross	2250-2030	18,463,000 a.f.	1854-1673	23,451,000 a.f.
36	Reservoir filling initiated	November 1937		December 1953	August 1958
37	Initially reached min. operating pool	27 May 1942		7 August 1955	3 April 1962
	Estimated annual sediment inflow	15,600 a.f.	1180 yrs.	21,600 a.f.	1080 yrs.
				17,800 a.f.	1560 yrs.
38	<u>Outlet Works Data</u>				
39	Location	Right bank	Right Bank	Right Bank	
	Number and size of conduits	2 - 24' 8" diameter (nos. 3 & 4)	1 - 26' dia. and 2 - 22' dia.	6 - 19.75' dia. upstream, 18.25' dia. downstream	
40	Length of conduits in feet (8)	No. 3 - 6,615, No. 4 - 7,240		3496 to 3659	
41	No., size, and type of service gates	1 - 28' dia. cylindrical gate 6 ports, 7.6' x 8.5' high (net opening) in each control shaft	1529 1 - 18' x 24.5' Tainter gate per conduit for fine regulation	1 - 13' x 22' per conduit, vertical lift, 4 cable suspension and 2 hydraulic suspension (fine regulation)	
42	Entrance invert elevation (msl)	2095		1425	
43	Avg. discharge capacity per conduit & total	Elev. 2250	22,500 cfs - 45,000 cfs	Elev. 1854	18,500 cfs - 111,000 cfs
44	Present tailwater elevation (ft msl)	2032-2036	5,000 - 35,000 cfs	1669-1677	15,000-60,000 cfs
45	<u>Power Facilities and Data</u>				
46	Avg. gross head available in feet (14)	194		174	
47	Number and size of conduits	No. 1-24'8" dia., No. 2-22'4" dia.	5 - 29' dia., 25' penstocks	7 - 24' dia., imbedded penstocks	
48	Length of conduits in feet (8)	No. 1 - 5,653, No. 2 - 6,355	1829	From 3,280 to 4,005	
49	Surge tanks	PH#1: 3-40' dia., PH#2: 2-65' dia.	65' dia. - 2 per penstock	70' dia., 2 per penstock	
	No., type and speed of turbines	5 Francis, PH#1-2: 128.5 rpm, 1-164 rpm , PH#2-2: 128.6 rpm	5 Francis, 90 rpm	7 Francis, 100 rpm	
50	Discharge cap. at rated head in cfs	PH#1, units 1&3 170', 2-140' 8,800 cfs, PH#2-4&5 170'-7,200 cfs	150'	41,000 cfs	185' 54,000 cfs
51	Generator nameplate rating in kW	1&3: 43,500; 2: 18,250; 4&5: 40,000	3 - 121,600, 2 - 109,250	112,290	
52	Plant capacity in kW	185,250	583,300	786,030	
53	Dependable capacity in kW (9)	181,000	388,000	534,000	
54	Avg. annual energy, million kWh (12)	1,046	2,251	2,625	
55	Initial generation, first and last unit	July 1943 - June 1961		January 1956 - October 1960	April 1962 - June 1963
56	Estimated cost September 1999 completed project (13)	\$158,428,000		\$305,274,000	\$346,521,000

Summary of Engineering Data -- Missouri River Mainstem System

	Big Bend Dam - Lake Sharpe	Fort Randall Dam - Lake Francis Case	Gavins Point Dam - Lewis & Clark Lake	Total	Item No.	Remarks	
21 miles upstream Chamberlain, SD Mile 987.4 249,330 (1)	Near Lake Andes, SD Mile 880.0 5,840 263,480 (1)	14,150 279,480 (1)	Near Yankton, SD Mile 811.1 16,000		1 2 3	(1) Includes 4,280 square miles of non-contributing areas. (2) Includes 1,350 square miles of non-contributing areas.	
80, ending near Pierre, SD	107, ending at Big Bend Dam		25, ending near Niobrara, NE	755 miles	4	(3) With pool at base of flood control. (4) Storage first available for regulation of flows. (5) Damming height is height from low water to maximum operating pool. Maximum height is from average streambed to top of dam.	
200 (elevation 1420) 28,900	540 (elevation 1350) 30,000	1,100	90 (elevation 1204.5) 32,000 2,000	5,940 miles	5 6	(6) Based on latest available storage data.	
440,000 (April 1952)	447,000 (April 1952)		480,000 (April 1952)		7	(7) River regulation is attained by flows over low-crested spillway and through turbines.	
1959	1946		1952		8	(8) Length from upstream face of outlet or to spiral case.	
1964	1953		1955		9	(9) Based on 8th year (1961) of drought drawdown (From study 8-83-1985).	
1440 10,570 (including spillway) 78 95 1200, 700	1395 10,700 (including spillway) 140 165 4300, 1250		1234 8,700 (including spillway) 45 74 850, 450	71,596 863 feet	10 11 12 13 14	(10) Affected by level of Lake Francis case. Applicable to pool at elevation 1350. (11) Spillway crest. (12) 1967-2013 Average (13) Source: Annual Report on Civil Works Activities of the Corps of Engineers. Extract Report Fiscal Year 1999. (14) Based on Study 8-83-1985	
Pierre shale & Niobrara chalk	Niobrara chalk		Niobrara chalk & Carlile shale		15		
Rolled earth, shale, chalk fill 17,000,000 540,000 24 July 1963	Rolled earth fill & chalk berms 28,000,000 & 22,000,000 961,000 20 July 1952		Rolled earth & chalk fill 7,000,000 308,000 31 July 1955	358,128,000 cu. yds 5,554,000 cu. yds.	16 17 18 19		
Left bank - adjacent 1385 376 gated 8 - 40' x 38' Tainter 390,000 at elev 1433.6 270,000	Left bank - adjacent 1346 1000 gated 21 - 40' x 29' Tainter 633,000 at elev 1379.8 508,000		Right bank - adjacent 1180 664 gated 14 - 40' x 30' Tainter 584,000 at elev 1221.4 345,000		20 21 22 23 24 25		
1423 msl 1422 msl 1420 msl 1415 msl	61,000 acres 60,000 acres 57,000 acres 50,000 acres	1375 msl 1365 msl 1350 msl 1320 msl	102,000 acres 94,000 acres 76,000 acres 36,000 acres	1210 msl 1208 msl 1204.5 msl 1204.5 msl	29,000 acres 25,000 acres 21,000 acres 21,000 acres	1,207,000 acres 1,146,000 acres 985,000 acres 437,000 acres	26 27 28 29
1423-1422 1422-1420	61,000 a.f. 118,000 a.f.	1375-1365 1365-1350	986,000 a.f. 1,306,000 a.f.	1210-1208 1208-1204.5	54,000 a.f. 79,000 a.f.	4,673,000 a.f. 11,625,000 a.f.	30 31
1420-1345 1423-1345	1,631,000 a.f. 1,810,000 a.f.	1350-1320 1320-1240 1375-1240	1,532,000 a.f. 1,469,000 a.f. 5,293,000 a.f.	1204.5-1160 1210-1160	295,000 a.f. 428,000 a.f.	38,536,000 a.f. 17,582,000 a.f. 72,416,000 a.f.	32 33 34
November 1963 25 March 1964 5,300 a.f.	January 1953 24 November 1953 340 yrs.			August 1955 22 December 1955 2,600 a.f.	160 yrs.	35 36 37	
None (7)	Left Bank 4 - 22' diameter		None (7)			38 39	
	1013 2 - 11' x 23' per conduit, vertical lift, cable suspension					40 41	
1385 (11)	1229 Elev 1375		1180 (11)			42 43	
1351-1355(10)	25,000-100,000 cfs	1228-1237	32,000 cfs - 128,000 cfs 10,000-60,000 cfs	1153-1161	15,000-60,000 cfs		44
70 None: direct intake	117 8 - 28' dia., 22' penstocks 1,074		48 None: direct intake		764 feet 55,083	45 46 47	
None 8 Fixed blade, 81.8 rpm	59' dia, 2 per alternate penstock 8 Francis, 85.7 rpm		None 3 Kaplan, 75 rpm		36 units	48 49	
67'	103,000 cfs	112'	44,500 cfs	48'	36,000 cfs	50	
3 - 67,276, 5 - 58,500 494,320 497,000 981 October 1964 - July 1966	40,000 320,000 293,000 1,726 March 1954 - January 1956		44,100 132,300 74,000 725 September 1956 - January 1957		2,501,200 kw 1,967,000 kw 9,354 million kWh July 1943 - July 1966	51 52 53 54 55	Corps of Engineers, U.S. Army Compiled by Northwestern Division
	\$107,498,000		\$199,066,000		\$49,617,000	\$1,166,404,000	Missouri River Region August 2014

Plate 3
Summary of Master Manual Technical Criteria

NAVIGATION TARGET FLOWS

<u>Location</u>	<u>Minimum Service (kcfs)</u>	<u>Full Service (kcfs)</u>
Sioux City	25	31
Omaha	25	31
Nebraska City	31	37
Kansas City	35	41

RELATION OF SYSTEM STORAGE TO NAVIGATION SERVICE LEVEL

<u>Date</u>	<u>System Storage (MAF)</u>	<u>Navigation Service Level</u>
March 15	54.5 or more	35,000 cfs (full-service)
March 15	49.0 to 31	29,000 cfs (minimum-service)
March 15	31.0 or less	No navigation service
July 1	57.0 or more	35,000 cfs (full-service)
July 1	50.5 or less	29,000 cfs (minimum-service)

RELATION OF SYSTEM STORAGE TO NAVIGATION SEASON LENGTH

<u>Date</u>	<u>System Storage (MAF)</u>	<u>Final Day of Navigation Support at Mouth of the Missouri River</u>
July 1	51.5 or more	November 30 (8-month season)
July 1	46.8 through 41.0	October 31 (7-month season)
July 1	36.5 or less	September 30 (6-month season)

RELATION OF SYSTEM WINTER RELEASE TO SYSTEM STORAGE

<u>September 1 System Storage (MAF)</u>	<u>Average Winter Release for Gavins Point</u>
58.0 or more	17,000 cfs
55.0 or less	12,000 cfs

GAVINS POINT RELEASES NEEDED TO MEET TARGET FLOWS

1950 to 1996 Data (kcfs)

		Median, Upper Quartile, Upper Decile Runoff							
		Apr	May	Jun	Jul	Aug	Sep	Oct	Nov
Full Service		26.7	28.0	27.9	31.6	33.2	32.6	32.0	31.1
Minimum Service		20.7	22.0	21.9	25.6	27.2	26.6	26.0	25.1
		Lower Quartile, Lower Decile Runoff							
Full Service		29.8	31.3	31.2	34.3	34.0	33.5	33.1	31.2
Minimum Service		23.8	25.3	25.2	28.3	28.0	27.5	27.1	25.2

RESERVOIR UNBALANCING SCHEDULE

<u>Year</u>	<u>Fort Peck</u>		<u>Garrison</u>		<u>Oahe</u>	
	<u>March 1</u>	<u>Rest of Year</u>	<u>March 1</u>	<u>Rest of Year</u>	<u>March 1</u>	<u>Rest of Year</u>
1	High	Float	Low	Hold Peak	Raise & hold during spawn	Float
2	Raise & hold during spawn	Float	High	Float	Low	Hold peak
3	Low	Hold peak	Raise & hold during spawn	Float	High	Float

Notes: **Float year:** Normal regulation, then unbalance 1 foot during low pool years or 3 feet when System storage is near 57.0 MAF on March 1.

Low year: Begin low, then hold peak the remainder of the year.

High year: Begin high, raise and hold pool during spawn, then float.

MRNRC RECOMMENDED RESERVOIR ELEVATION GUIDELINES FOR UNBALANCING

	<u>Fort Peck</u>	<u>Garrison</u>	<u>Oahe</u>
Implement unbalancing if March 1 pool is above this level.	2234 feet msl	1837.5 feet msl	1607.5 feet msl
Implement unbalancing if March 1 pool level is in this range and the pool is expected to raise more than 3 feet after March 1.	2227-2234 feet msl	1827-1837.5 feet msl	1600-1607.5 feet msl
Scheduling Criteria	Avoid pool level decline during spawn period which ranges from April 15 – May 30	Schedule after spawn period of April 20 – May 20	Schedule after spawn period of April 8 – May 15

Plate 3 (cont'd)
Summary of Master Manual Technical Criteria

**TECHNICAL CRITERIA FOR SPRING PULSES
FROM GAVINS POINT DAM**

Criteria Applicable to Both the March and May Spring Pulses

Flood Control Constraints No change from current levels

Criteria Applicable to the March Spring Pulse

Drought Preclude	40.0 MAF or below measured on March 1.
Drought Proration of Pulse Magnitude*	None, 5 kcfs added to navigation releases, but no greater than 35 kcfs.
Initiation of Pulse	Extend the stepped System release increases that precede the beginning of the navigation season.
Rate of Rise before Peak	Approximately 5 kcfs for 1 day.
Duration of Peak	Two days.
Rate of Fall after Peak	Drop over 5 days to navigation target release.

Criteria Applicable to Time Period Between the Bimodal Pulses

Release Existing Master Manual Criteria

Criteria Applicable to the May Spring Pulse

Drought Preclude	40.0 MAF or below measured on May 1.
Proration of Pulse Magnitude Based On System Storage*	Prorated from 16 kcfs based on a May 1 System Storage check; 100% at 54.5 MAF; straight line interpolation to 75% at 40.0 MAF.
Proration of Pulse Magnitude Based On Projected Runoff*	After the proration of the spring pulse magnitude for System Storage, the resultant magnitude would be further adjusted either up or down based on the May CY runoff forecast; 100% for Median; straight-line interpolation to 125% at Upper Quartile runoff; 125% for runoff above Upper Quartile; straight-line interpolation to 75% at Lower Quartile runoff; 75% for runoff below Lower Quartile.
Initiation of Pulse	Between May 1 to May 19, depending on Missouri River water temperature immediately below Gavins Point Dam. If possible, pulse will be initiated after the second daily occurrence of a 16 degree Celsius water temperature; however, the decision will be informed by the potential for 'take' of Threatened and Endangered bird species.
Rate of Rise before Peak	Approximately 6 kcfs per day.
Duration of Peak	Two days.
Rate of Fall after Peak	Approximately 30% drop over 2 days followed by a proportional reduction in releases back to the existing Master Manual criteria over an 8-day period.


Spring Pulse Downstream Flow Limits

Omaha	41,000 cfs
Nebraska City	47,000 cfs
Kansas City	71,000 cfs

* Spring pulse magnitudes will be determined by taking the difference between pre-pulse Gavins Point releases and the peak pulse Missouri River flows measured just downstream of the mouth of the James River.


System Storage

2014-2015 AOP

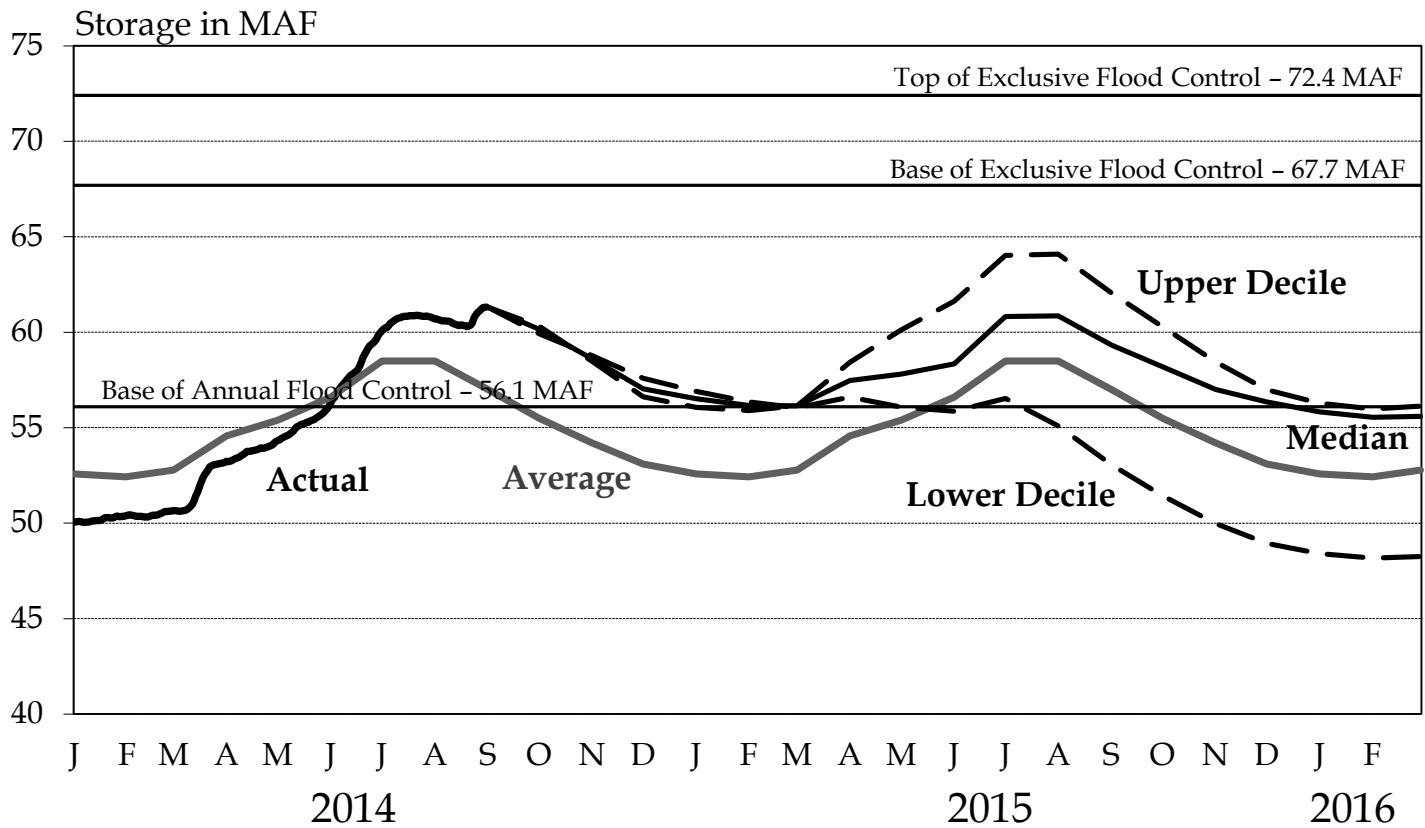


Fort Peck

2014-2015 AOP

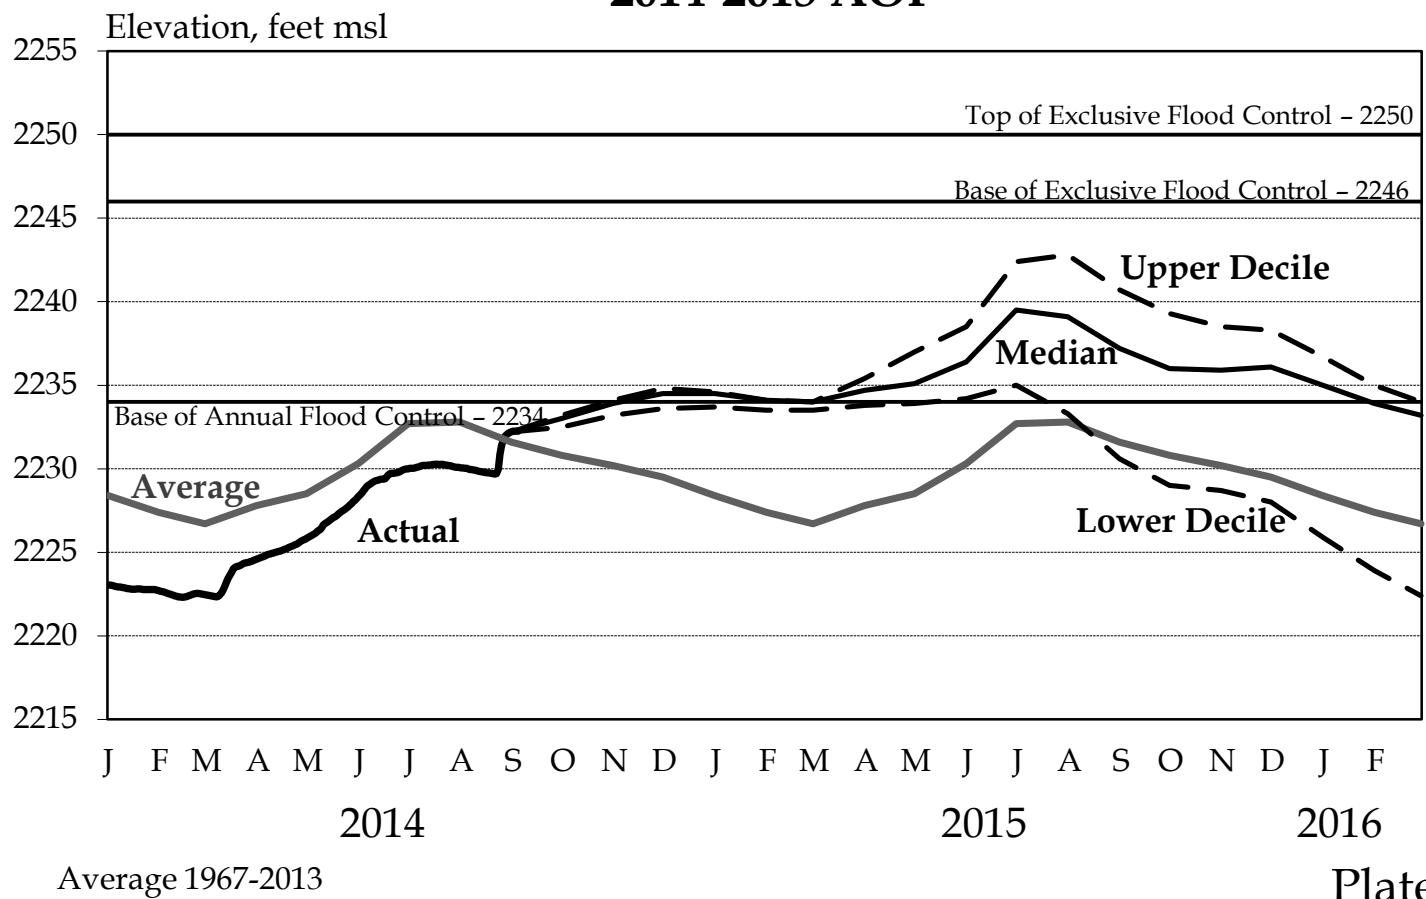


Garrison

2014-2015 AOP

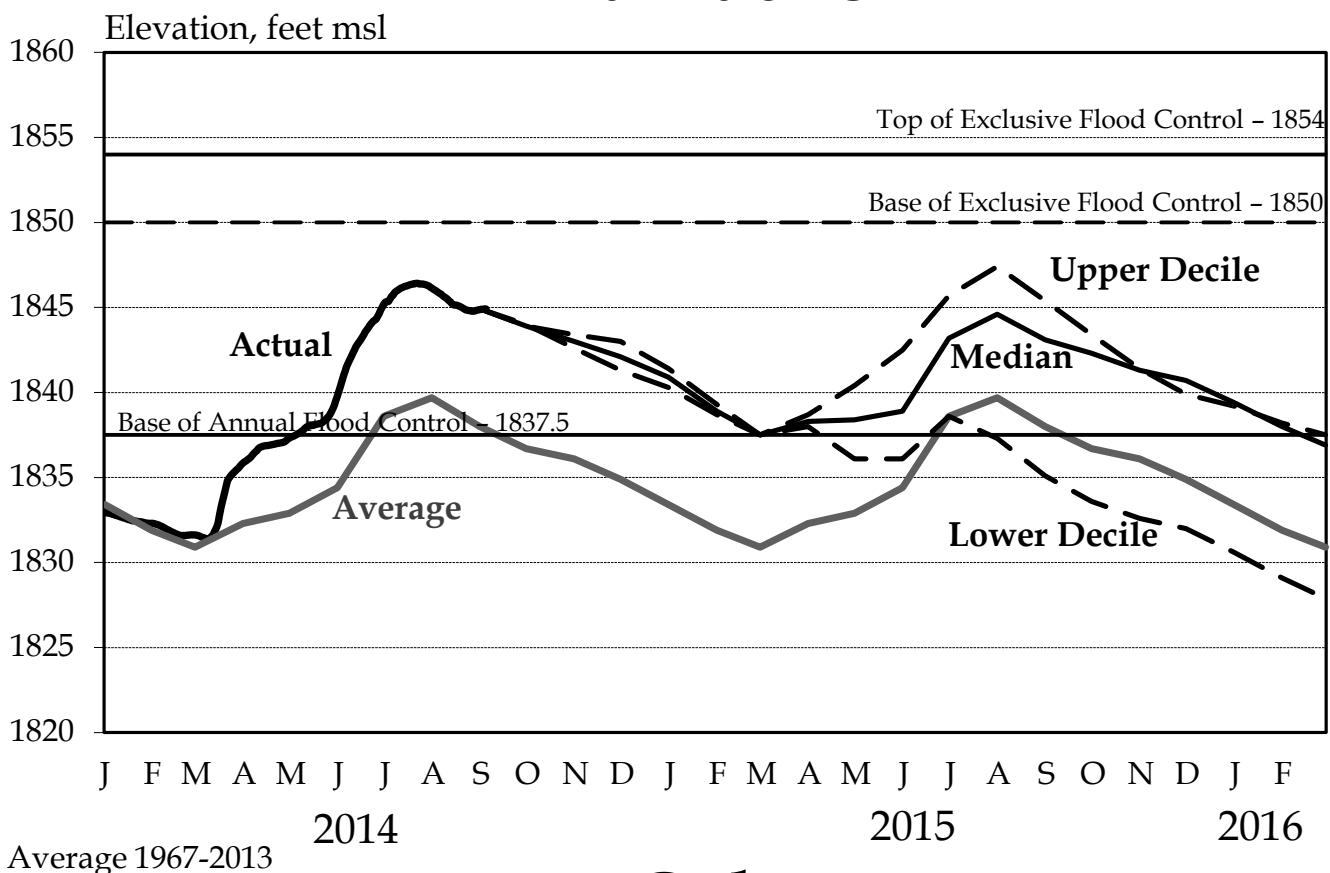


Oahe

2014-2015 AOP

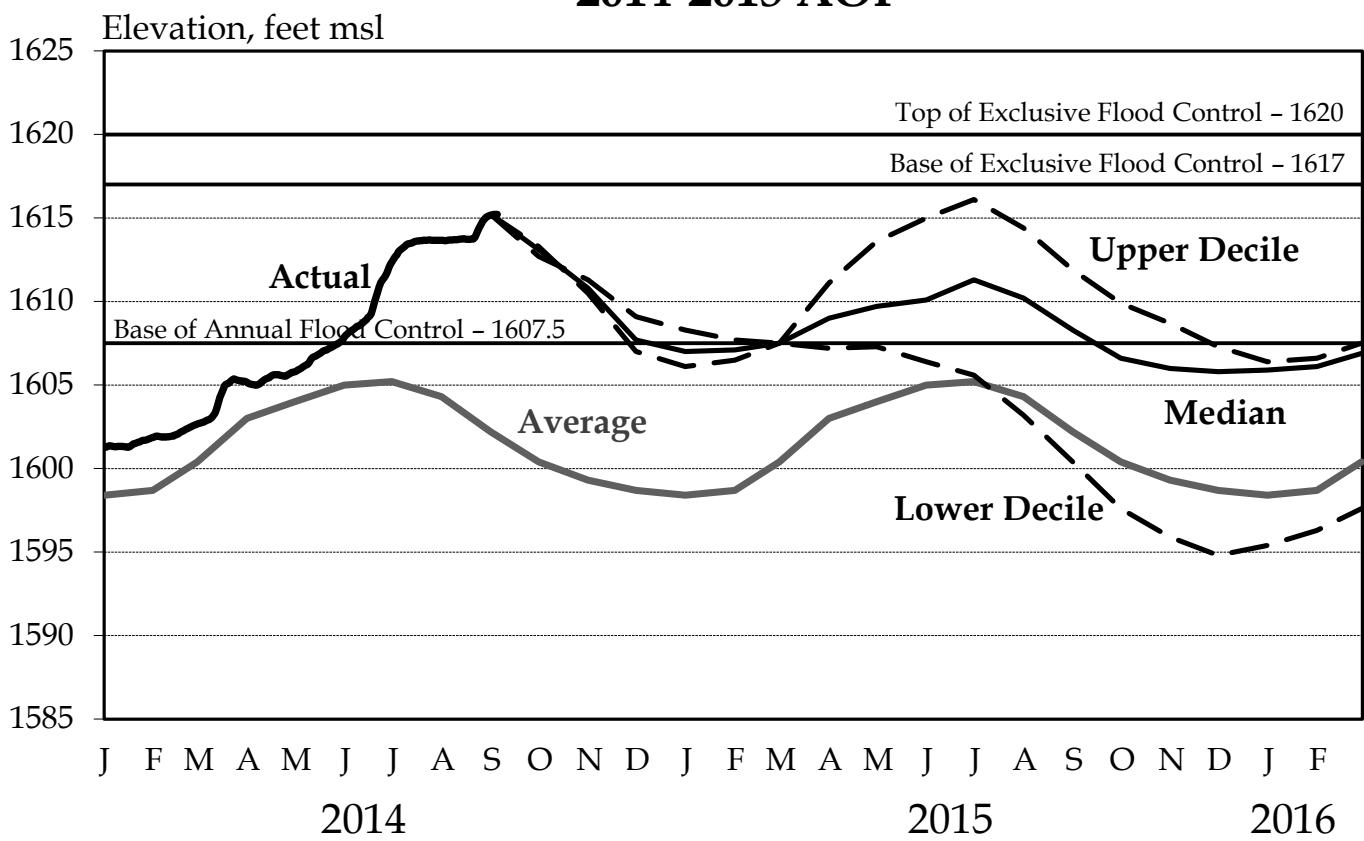


System Storage

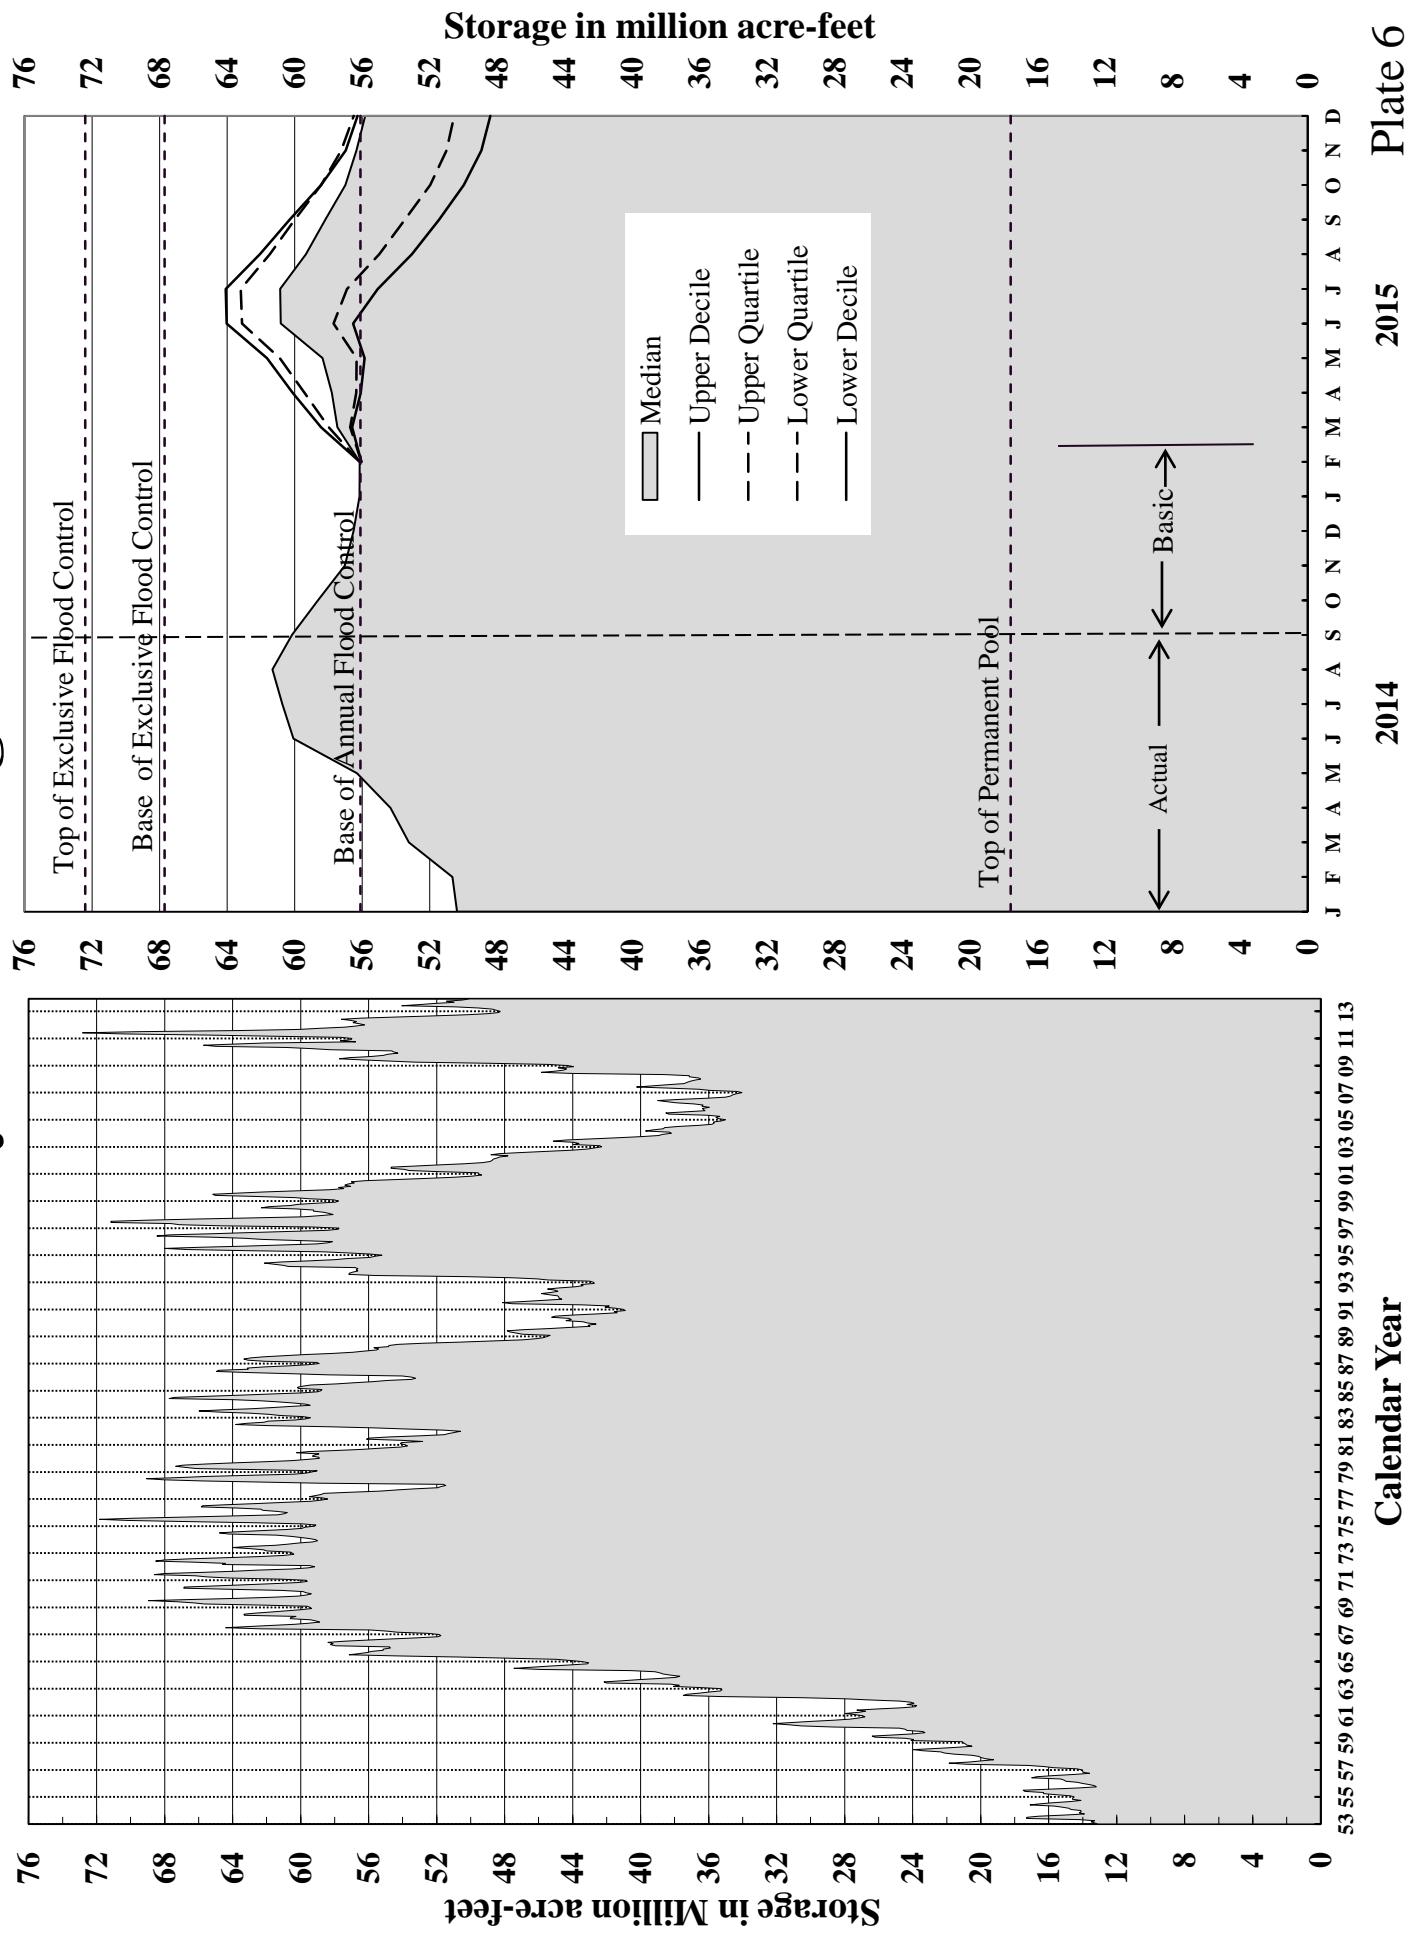

2015 Plate 6



Calendar Year

Gavins Point Releases

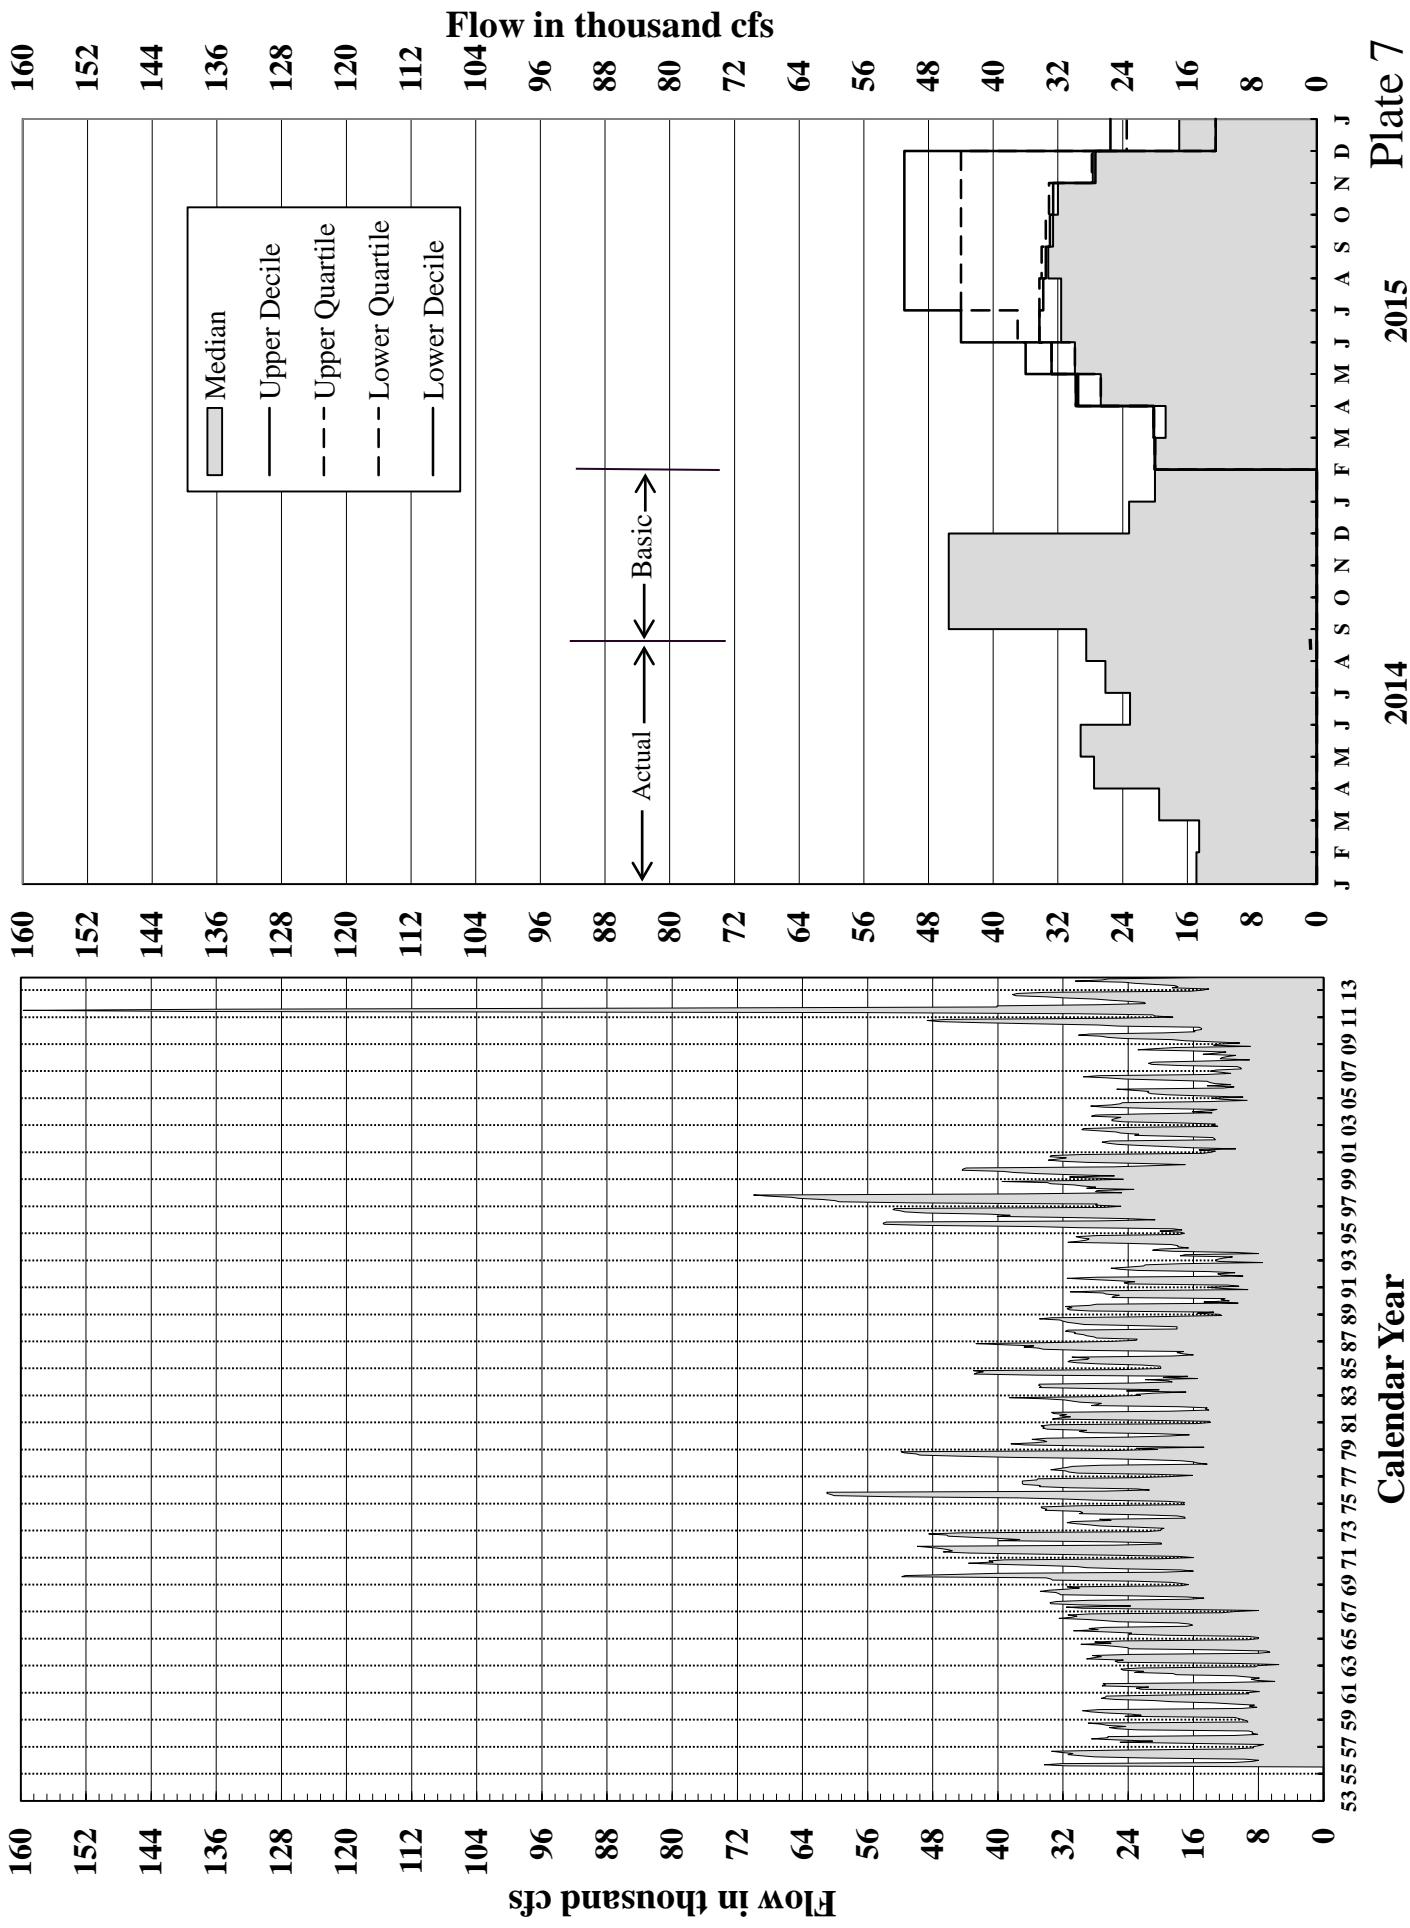



Fort Peck

Elevations and Releases

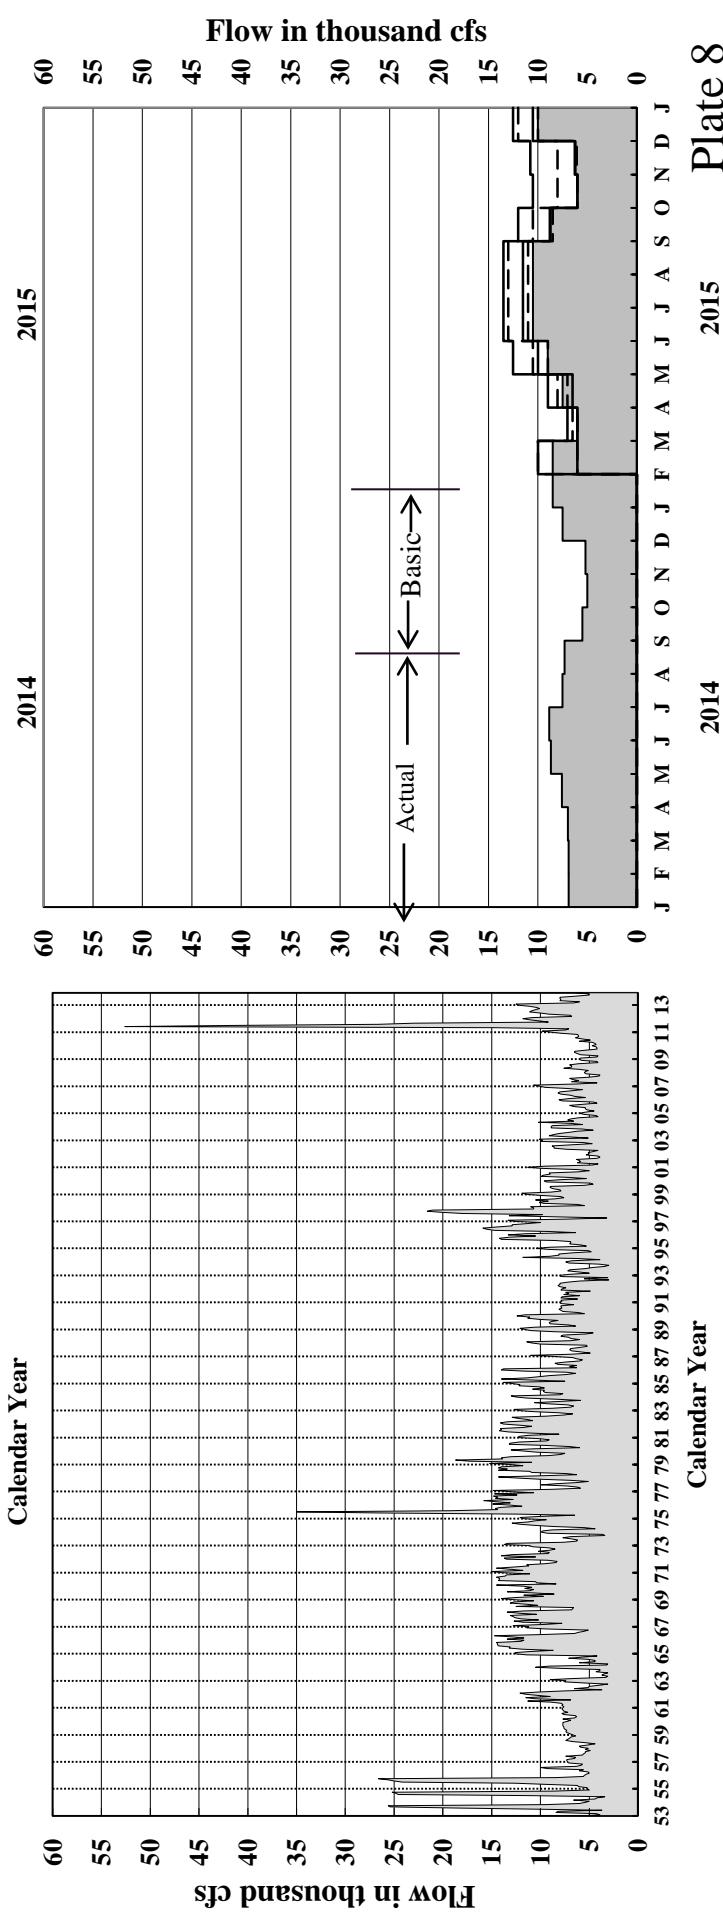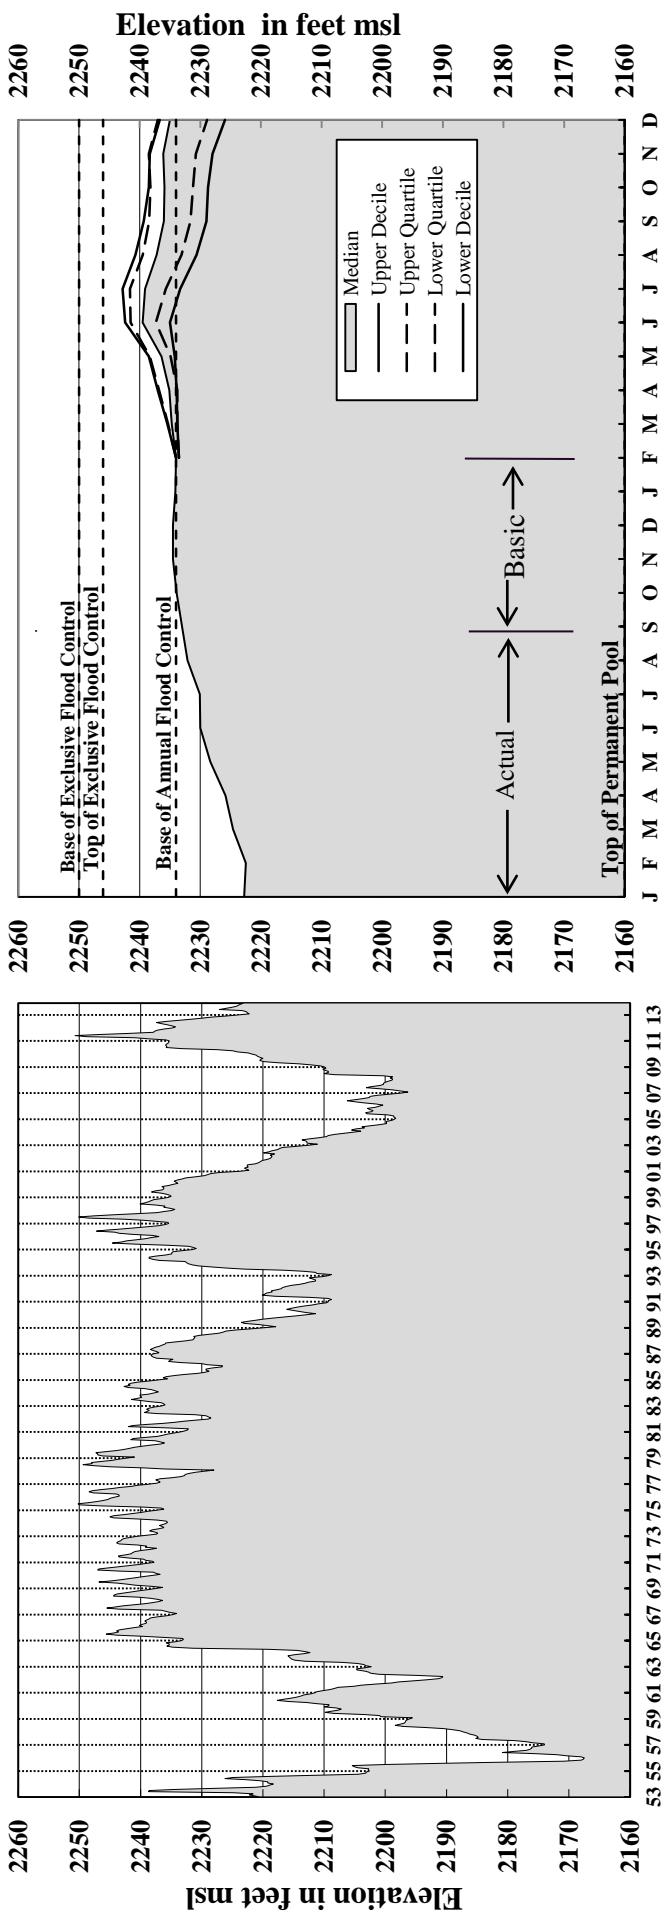

Garrison

Elevations and Releases

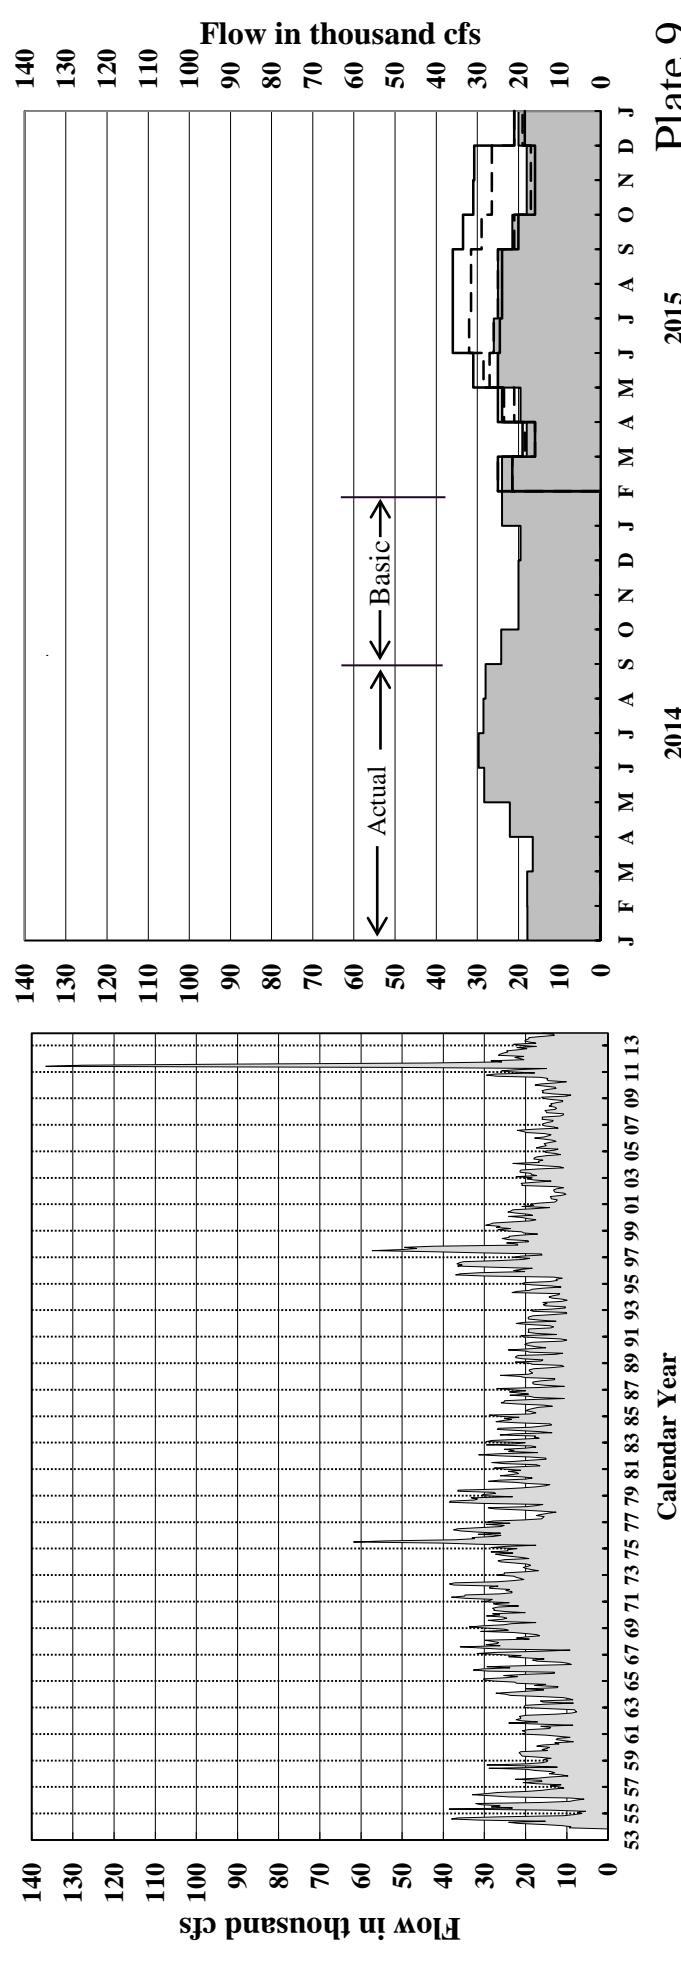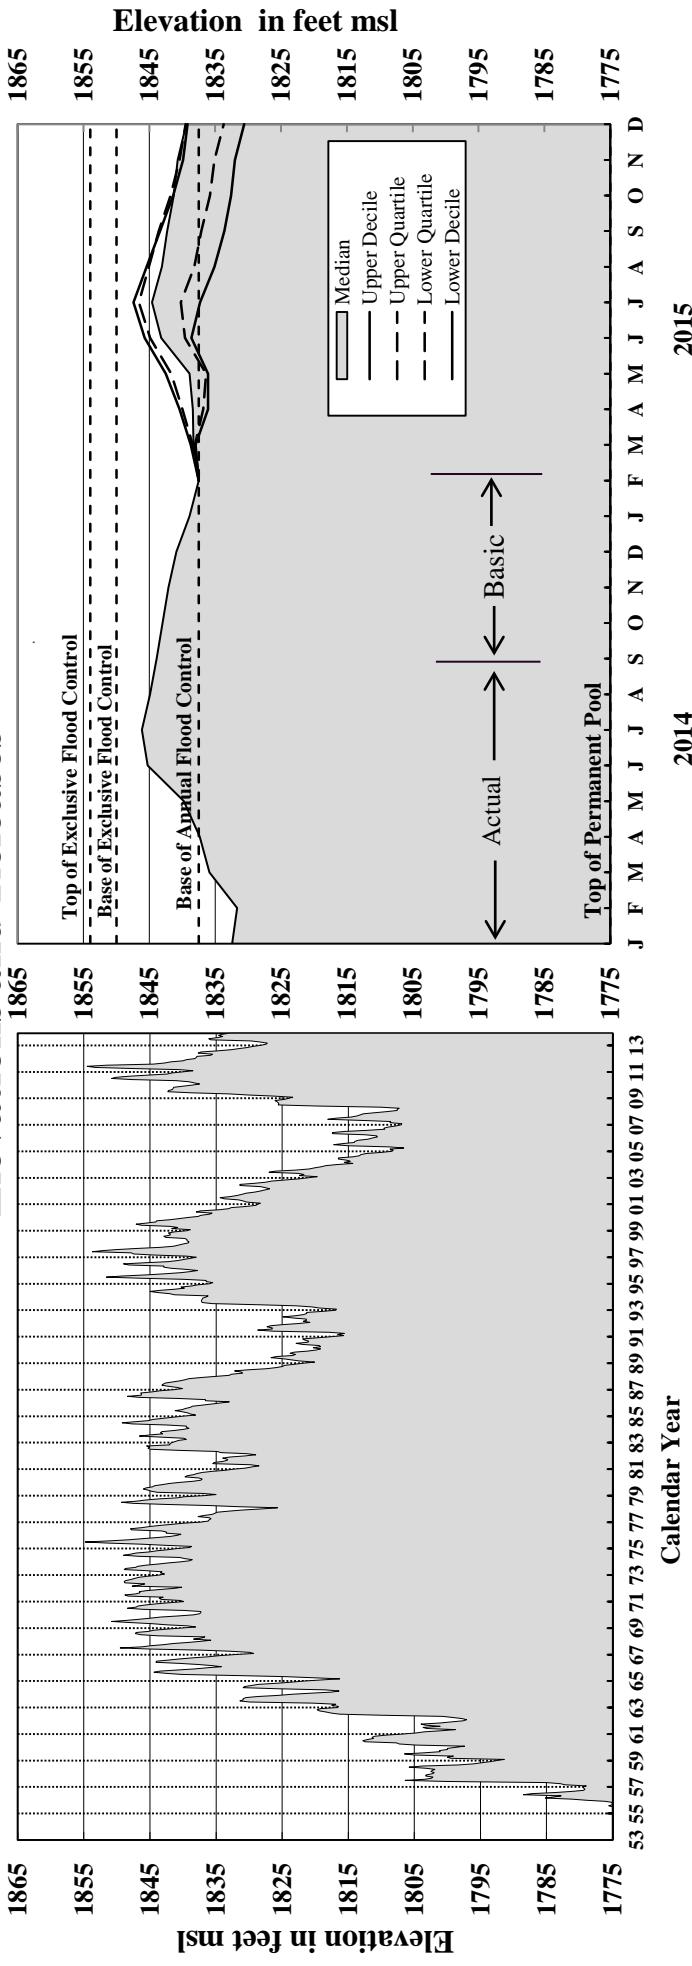

Calendar Year



2014

Plate 9

2015

Oahe

Elevations and Releases

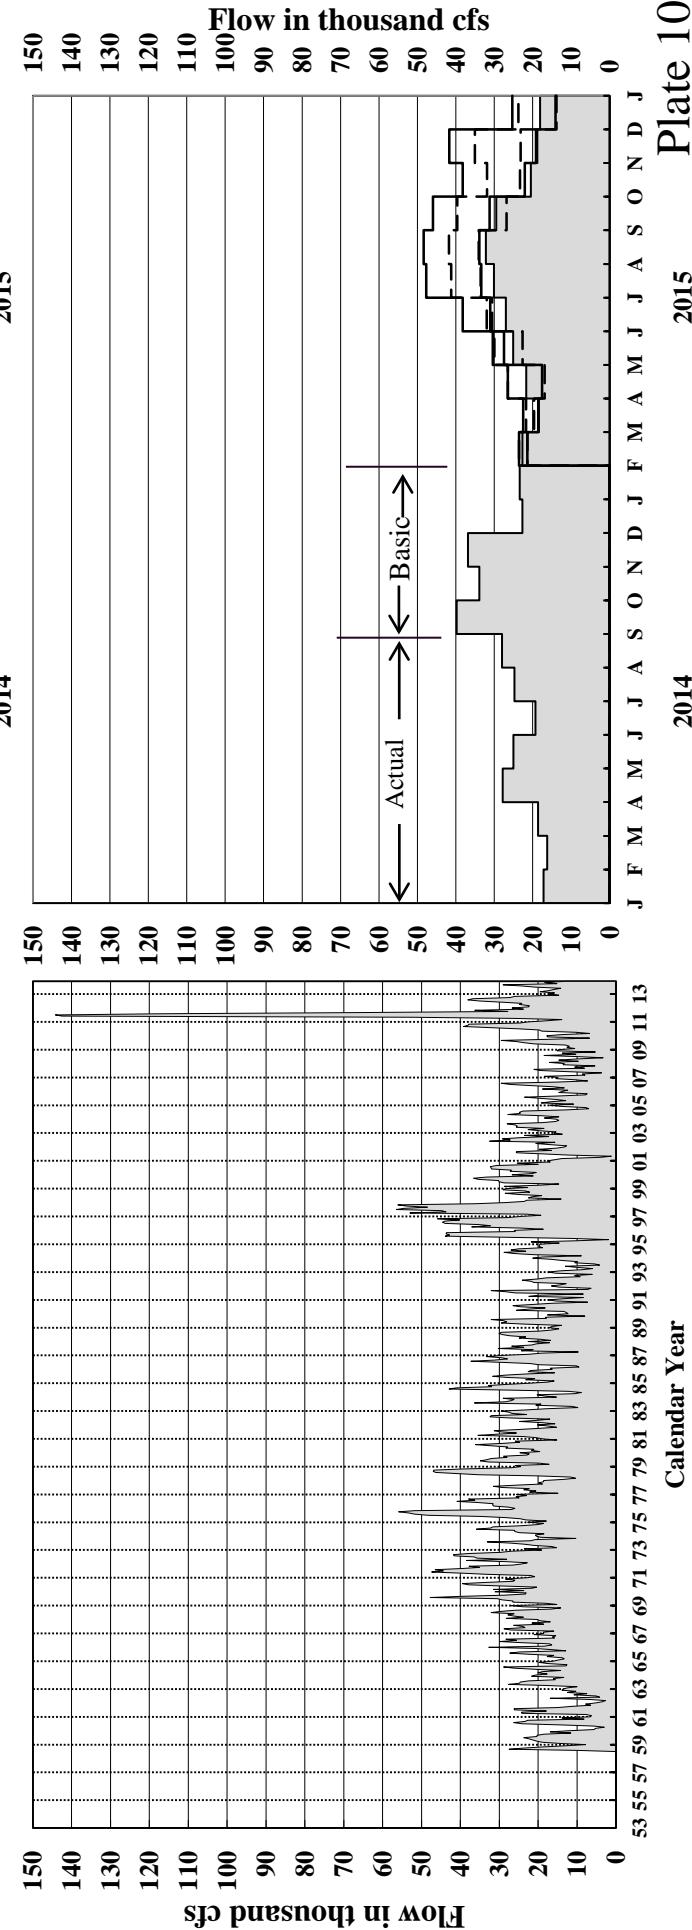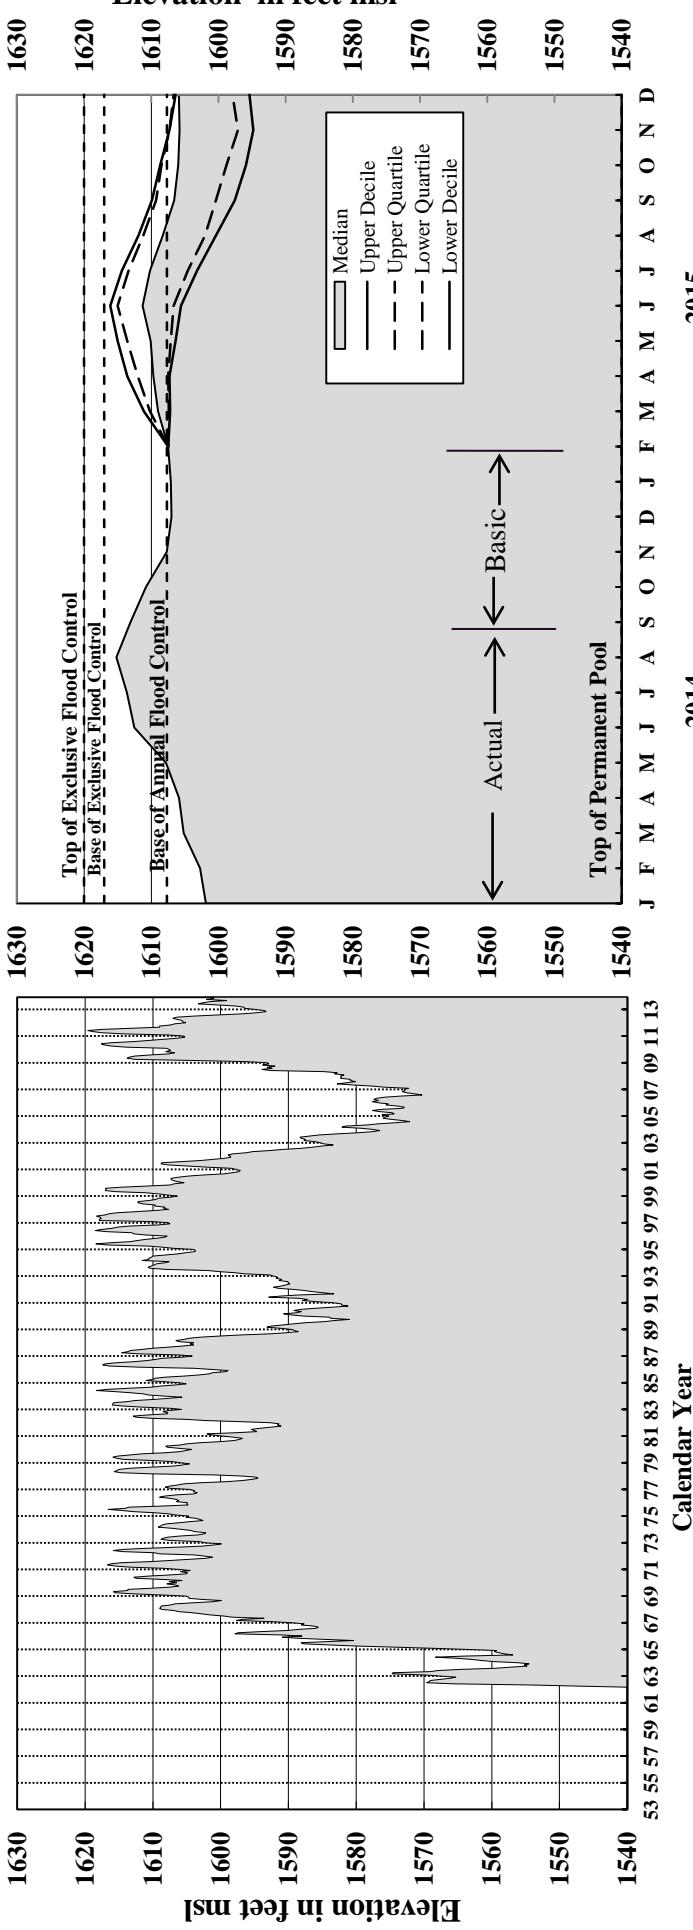

Calendar Year

2014

Plate 10

2015

Fort Randall

Elevations and Releases

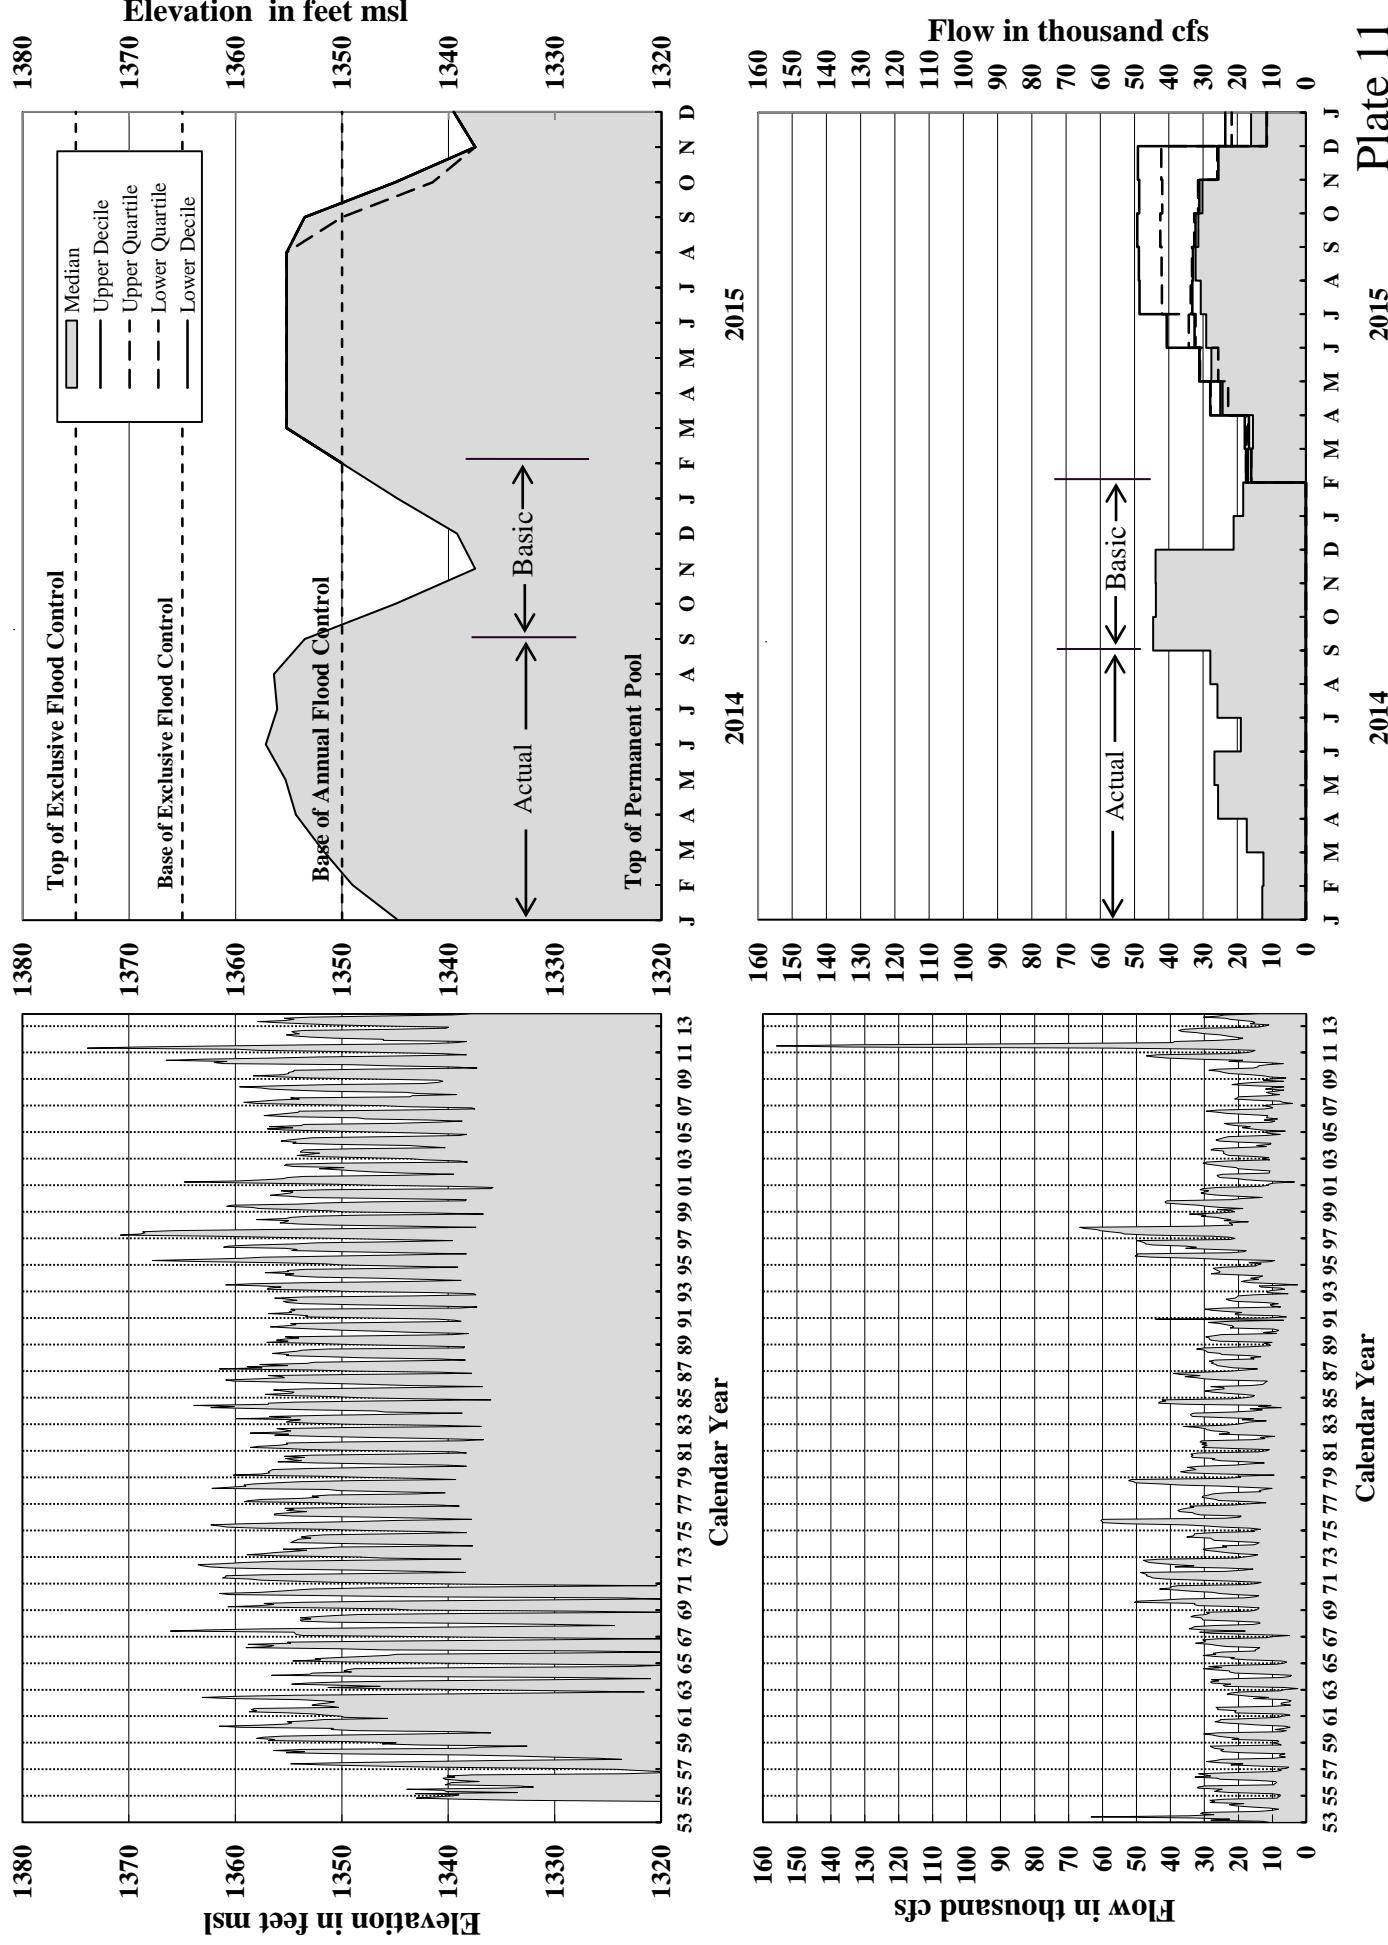


Plate 11


2015

2014


Calendar Year

Reservoir Release and Unregulated Flow


Fort Peck

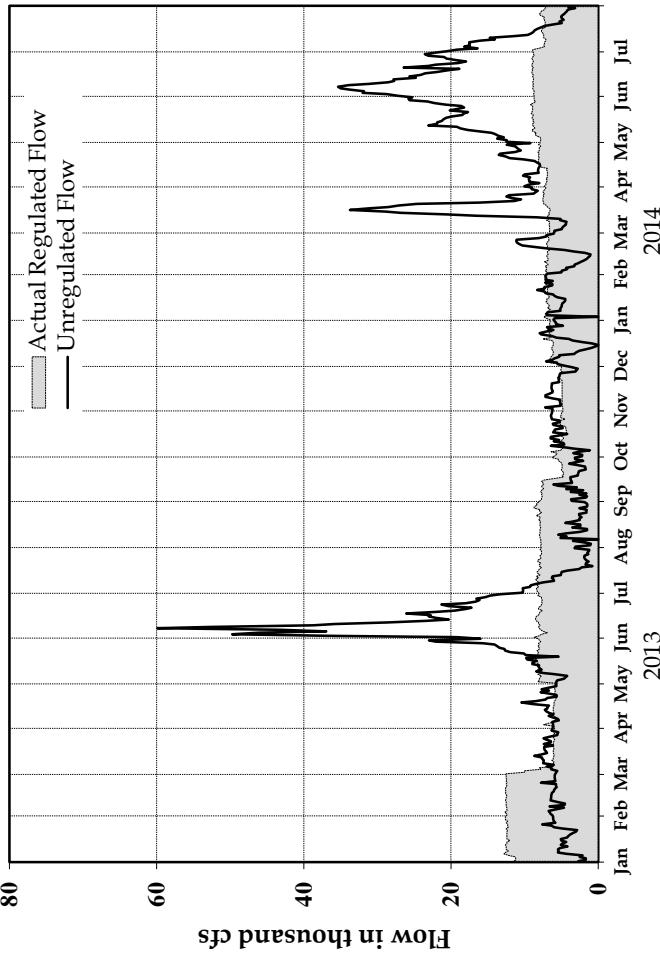


Garrison

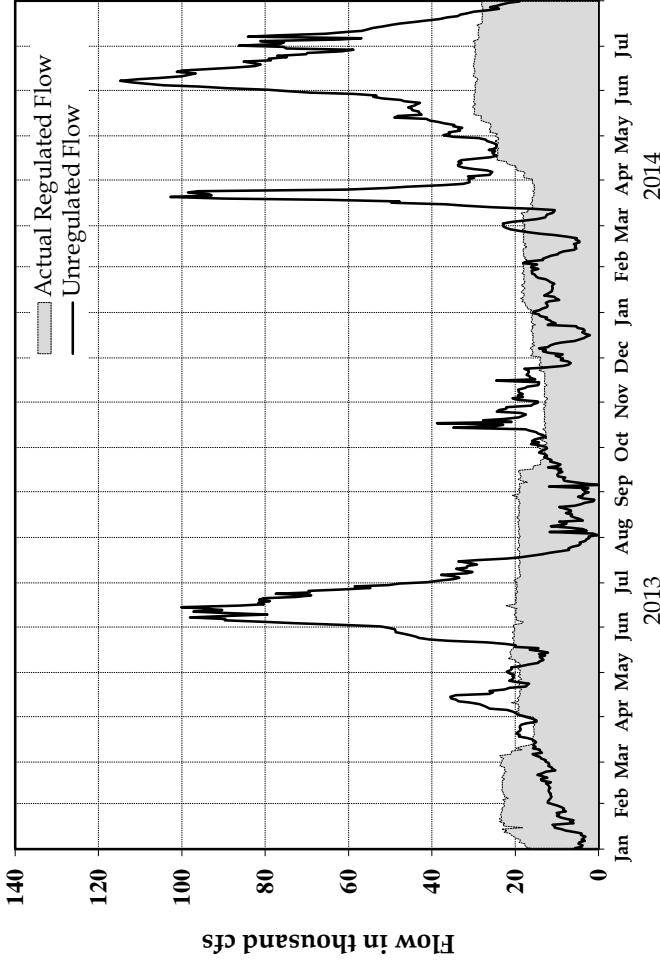


Oahe

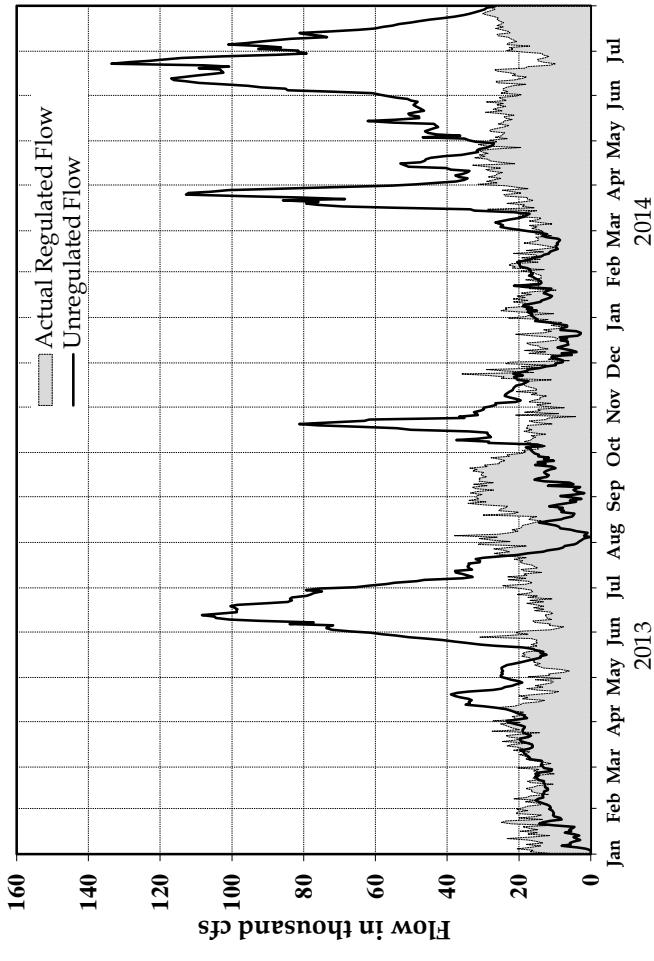




Gavins Point

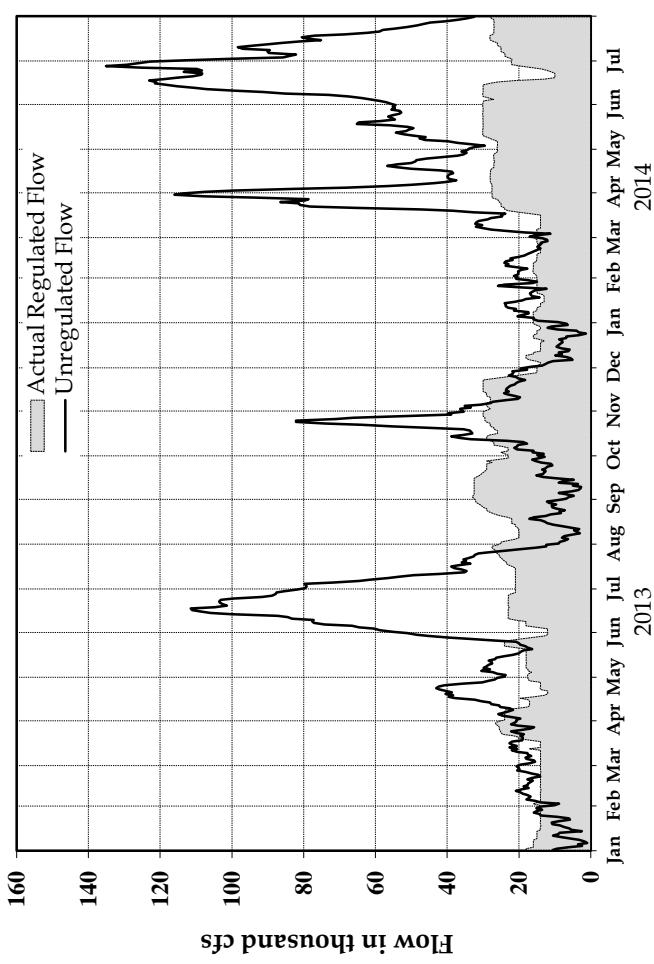


System Gross Capability and Average Monthly Generation

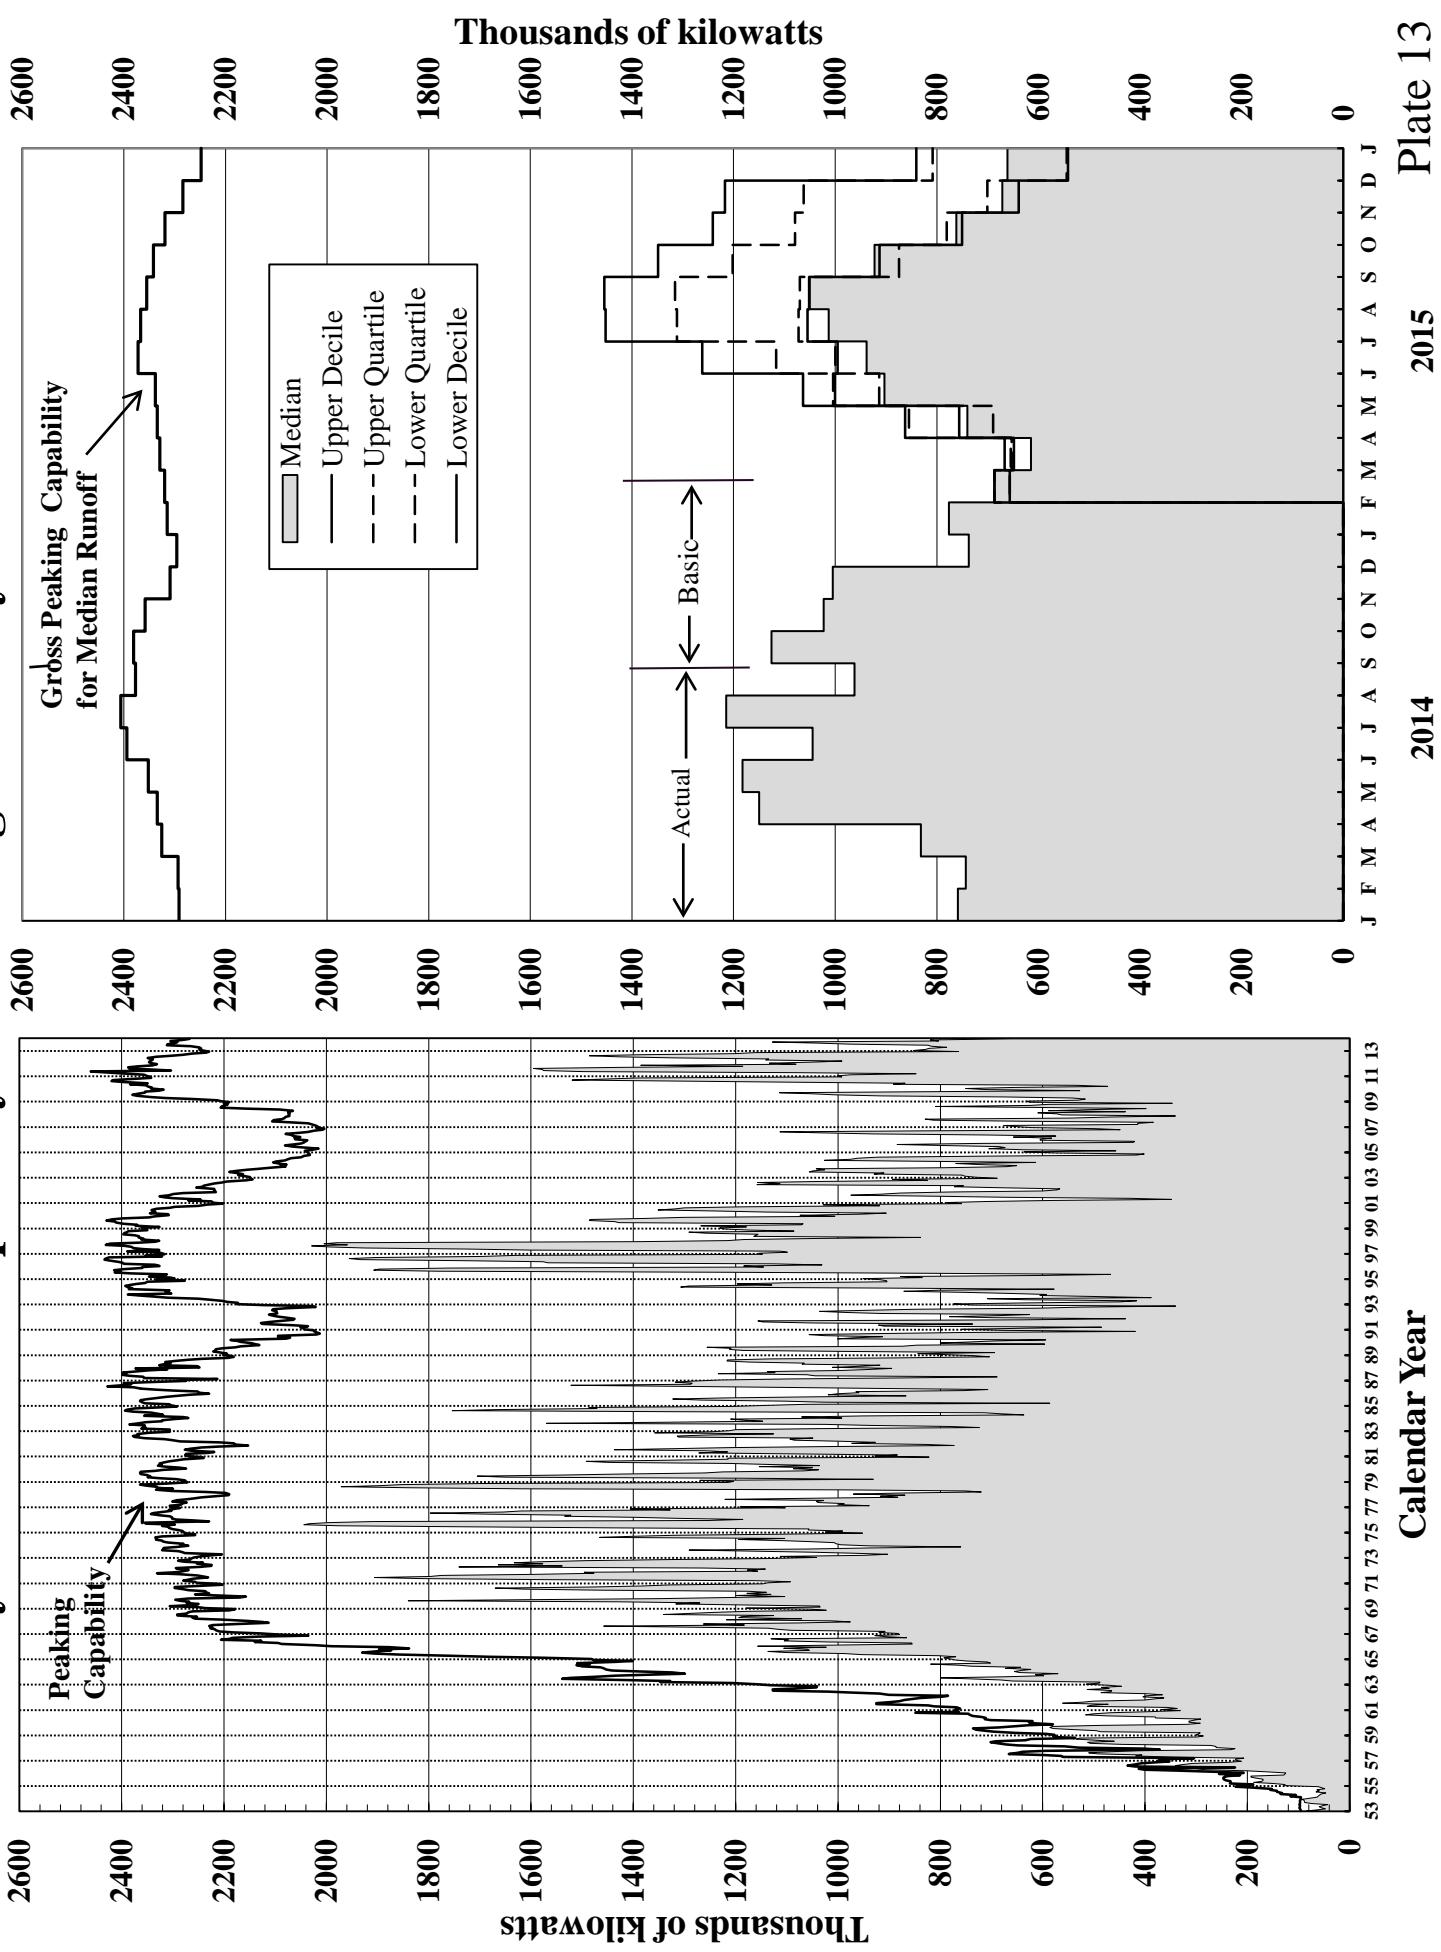

Tentative Five Year Extensions of 2014-2015 AOP

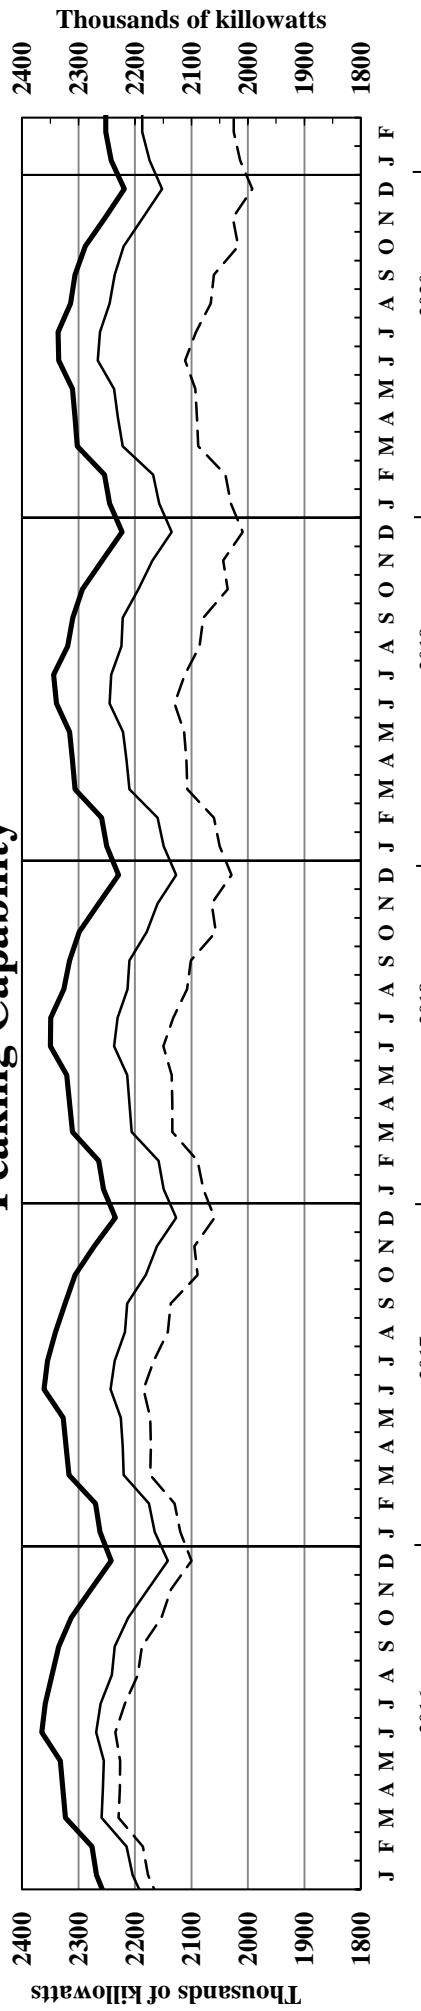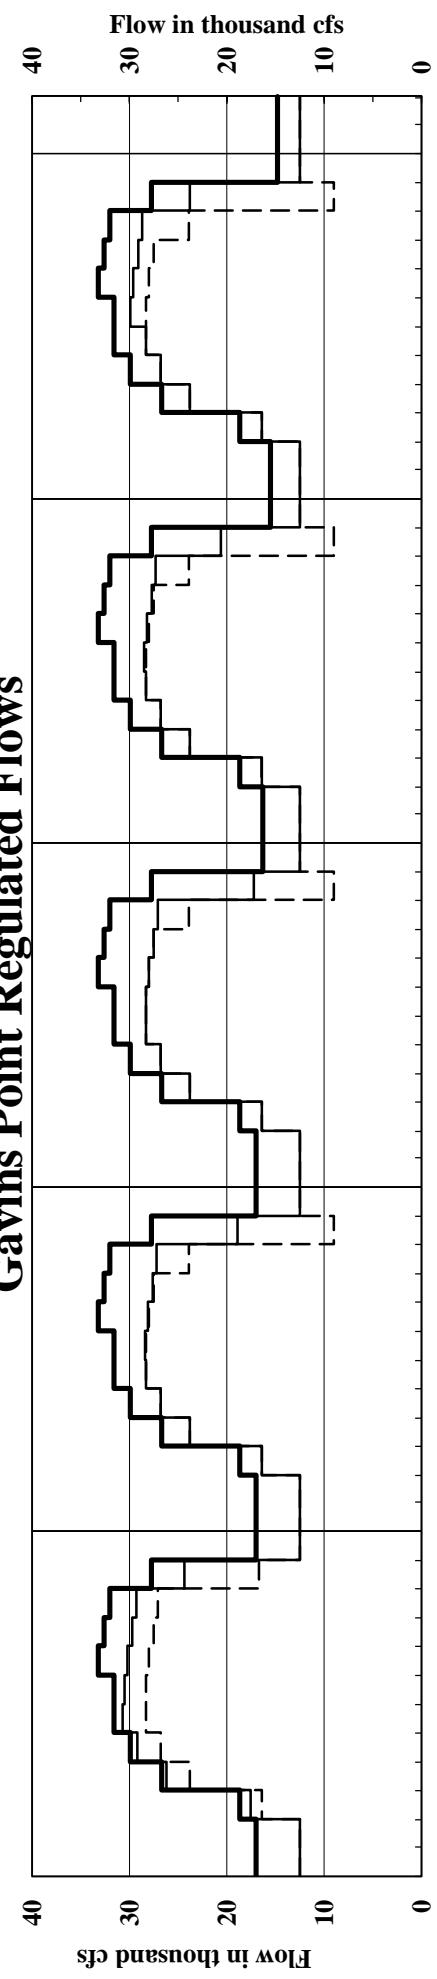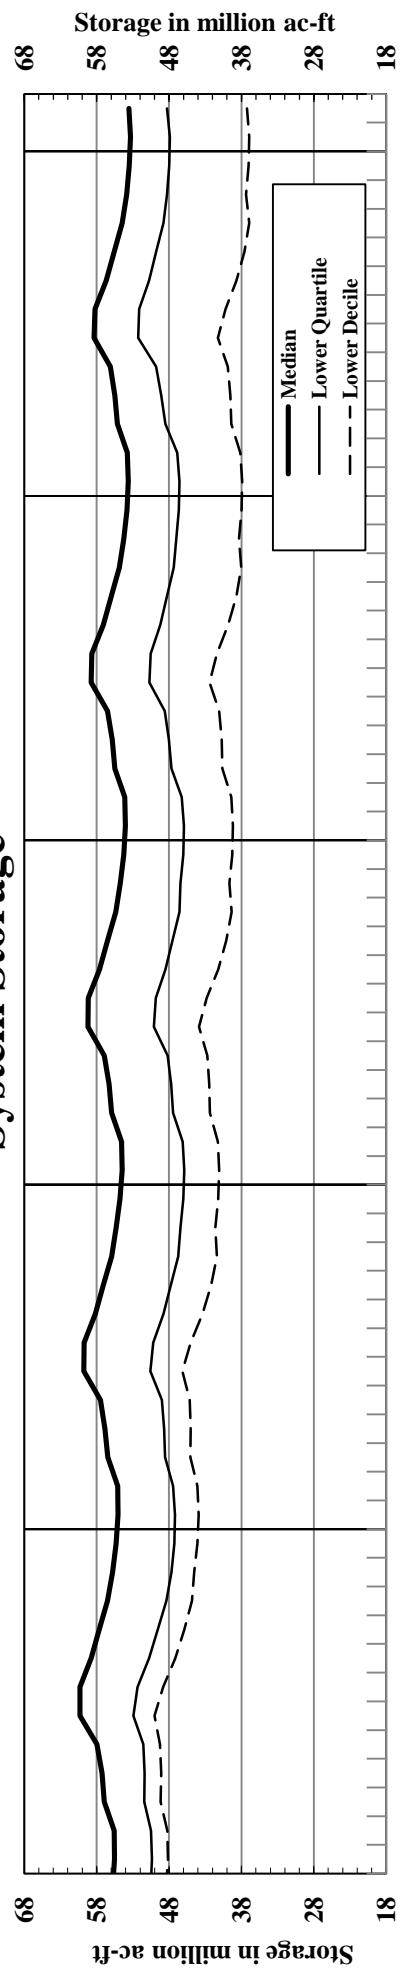


Tentative Five Year Extensions of 2014-2015 AOP

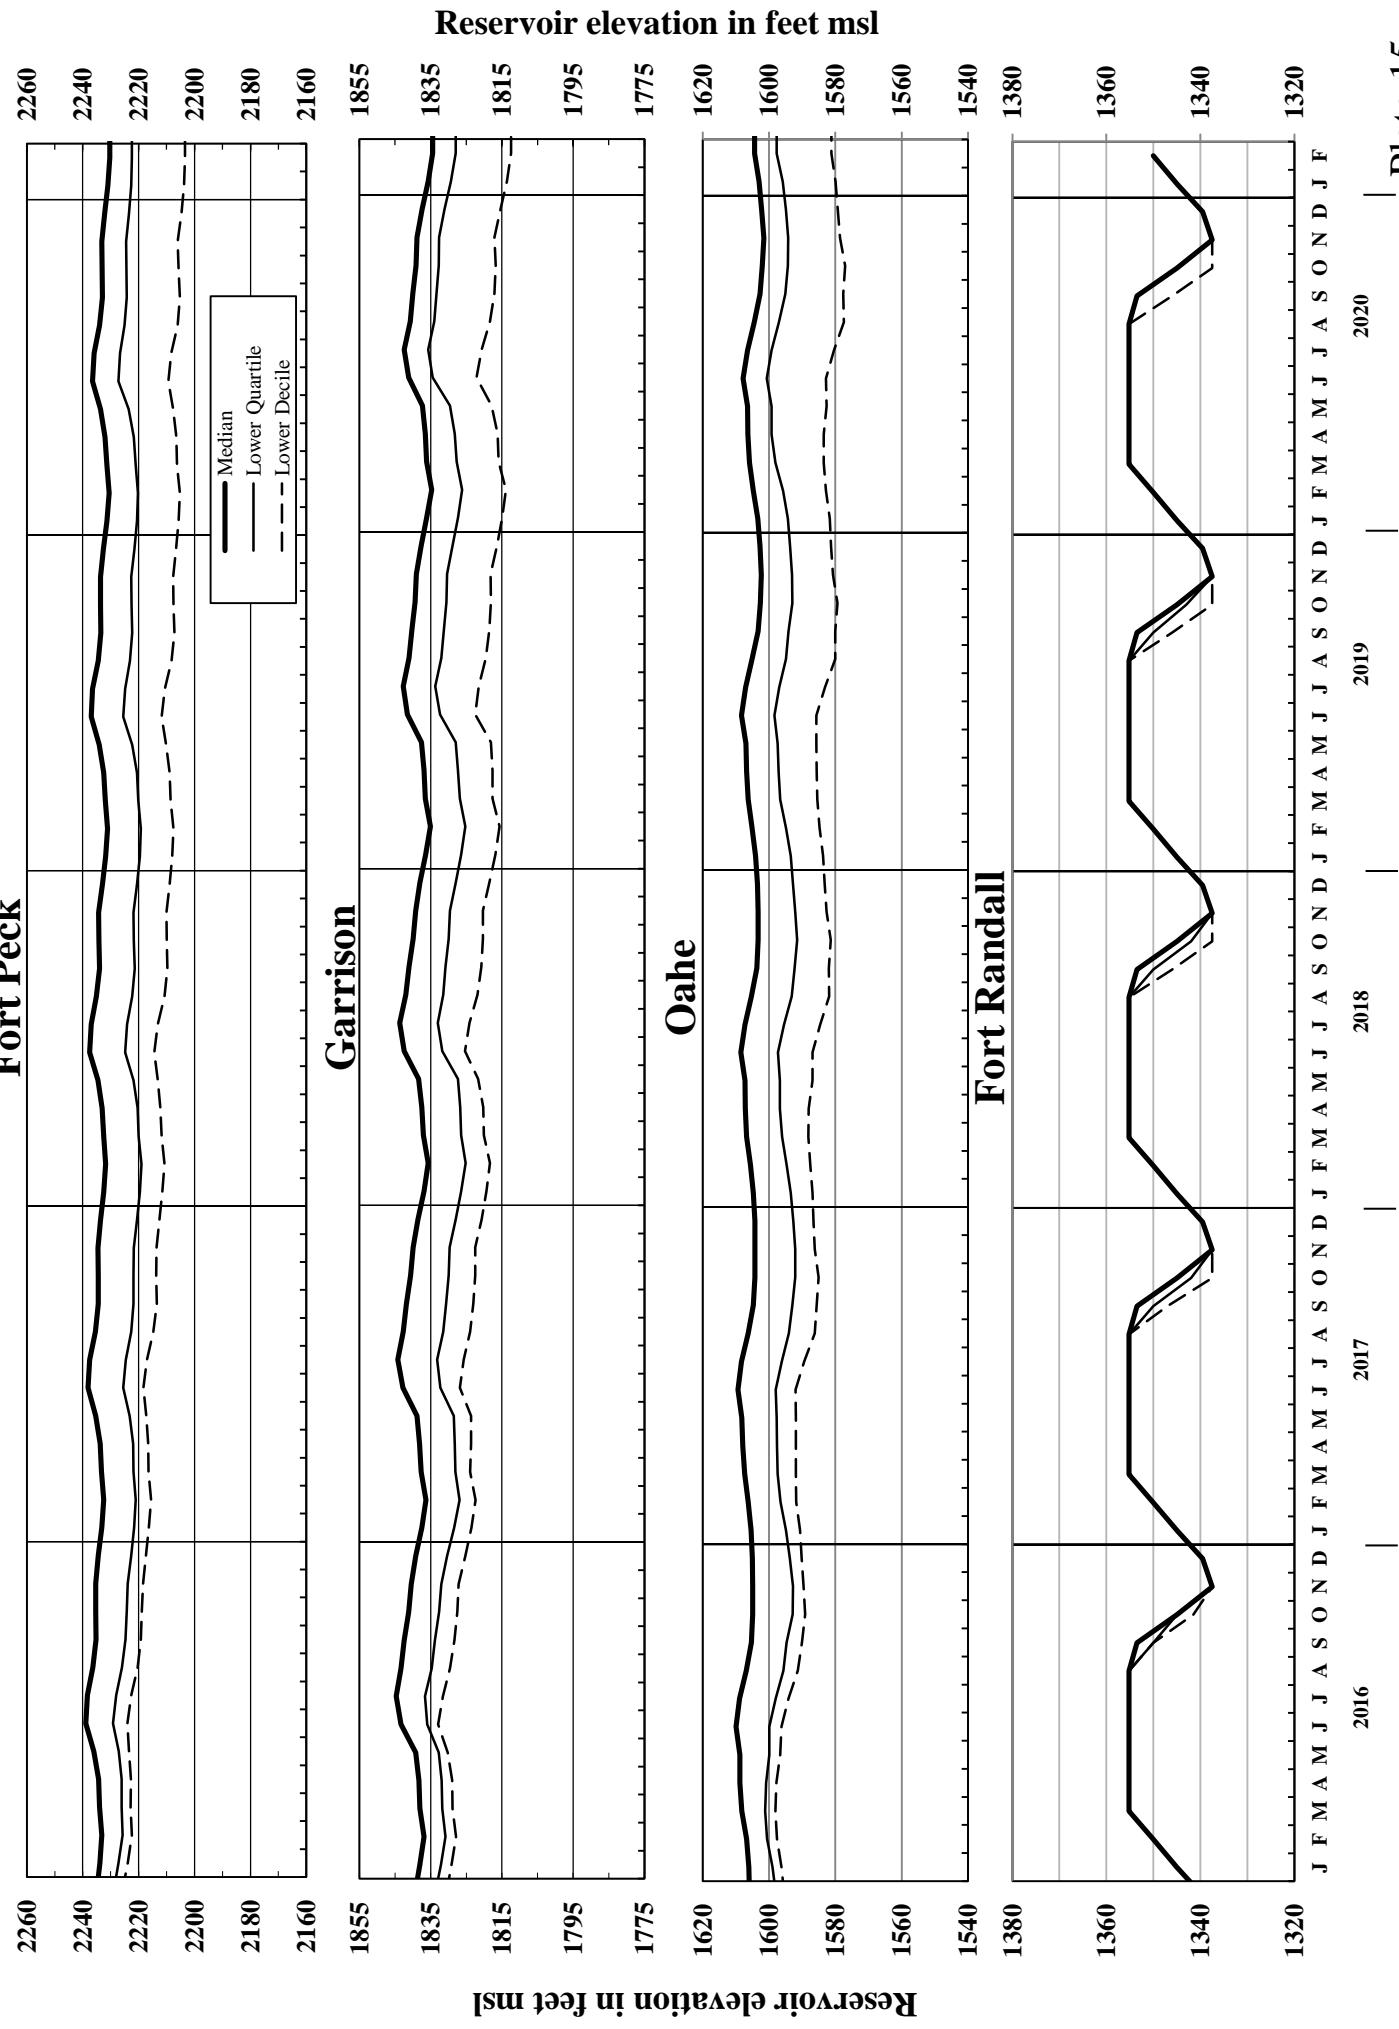

AMERICAN INDIAN RESERVATIONS

Missouri River Basin

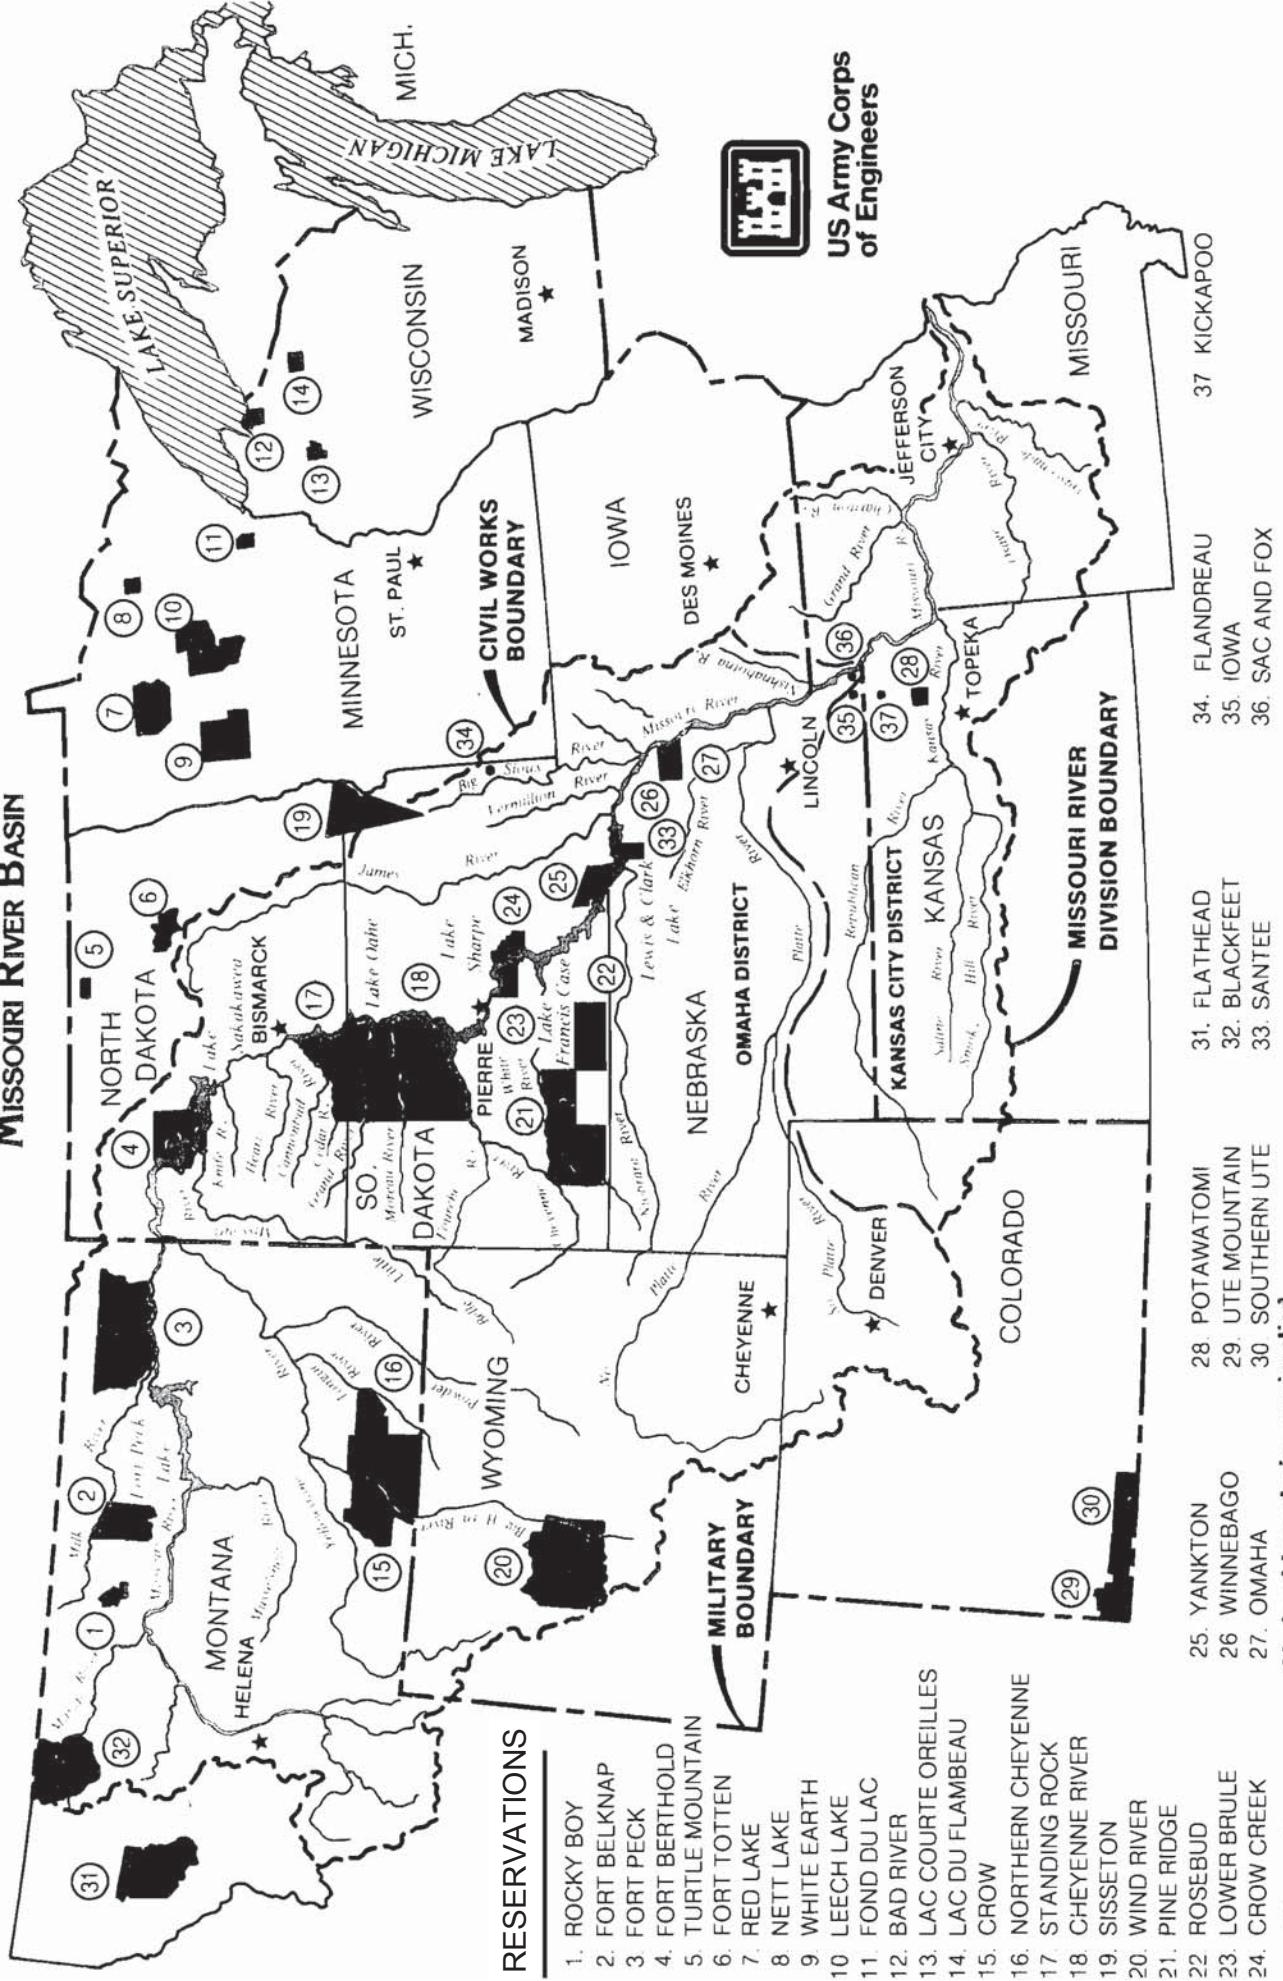

For illustrative purposes. No legal boundaries are implied.

	31AUG14	INI-SUM	30SEP	2014	15NOV	22NOV	30NOV	31DEC	31JAN	28FEB	2015
--	---------	---------	-------	------	-------	-------	-------	-------	-------	-------	------

--FORT PECK--
 NAT INFLOW 2573 500 520 245 114 131 390 312 361
 DEPLETION -539 -97 -68 -14 -6 -7 -119 -136 -92
 EVAPORATION 335 106 94 43 20 23 50 448 453
 MOD INFLOW 2777 491 494 216 101 115 459 448 453
 RELEASE 2399 327 307 149 69 90 461 523 472
 STOR CHANGE 378 164 187 67 31 25 -2 -75 -19
 STORAGE 14417. 14581 14767 14834 14866 14890 14888 14814 14795
 ELEV FTMSL 2232.2 2233.0 2233.9 2234.2 2234.4 2234.5 2234.5 2234.1 2234.0
 DISCH KCFS 7.300 5.5 5.0 5.0 5.0 5.7 7.5 8.5 8.5
 POWER
 AVE POWER MW 75 68 68 68 78 102 116 116
 PEAK POW MW 161 162 162 162 163 163 162 162
 ENERGY GWH 395.9 53.8 50.7 24.6 11.5 15.0 76.2 86.3 77.9

--GARRISON--
 NAT INFLOW 2807 750 670 230 107 123 310 262 355
 DEPLETION -664 -142 -47 -125 -58 -66 -106 -75 -45
 CHAN STOR -12 17 5 0 -7 -17 -10
 EVAPORATION 406 132 114 51 24 27 58 850 872
 REG INFLOW 5452 1104 915 452 211 246 801 1476 1333
 RELEASE 7866 1438 1230 595 278 317 1199 1476 1333
 STOR CHANGE -2414 -334 -315 -143 -67 -72 -398 -626 -461
 STORAGE 20145. 19811 19497 19354 19287 19215 18818 18192 17731
 ELEV FTMSL 1844.9 1843.9 1843.0 1842.5 1842.3 1842.1 1840.9 1838.9 1837.5
 DISCH KCFS 28.000 24.2 20.0 20.0 20.0 20.0 19.5 24.0 24.0
 POWER
 AVE POWER MW 310 256 255 255 254 247 302 299
 PEAK POW MW 499 498 493 490 487 480 473 468
 ENERGY GWH 1206.4 223.4 190.4 91.8 42.8 48.8 183.8 224.5 200.8

--OAHE--
 NAT INFLOW 809 350 170 65 30 35 52 12 95
 DEPLETION 95 30 -11 2 1 1 16 22 34
 CHAN STOR 13 14 16 0 0 0 2 -18
 EVAPORATION 407 136 115 51 23 26 56 1448 1394
 REG INFLOW 8186 1636 1311 607 284 325 1181 1448 1394
 RELEASE 10744 2369 2084 1009 506 679 1395 1441 1262
 STOR CHANGE -2558 -733 -773 -402 -222 -354 -213 7 132
 STORAGE 21222. 20489 19716 19315 19093 18739 18525 18533 18664
 ELEV FTMSL 1615.2 1613.1 1610.8 1609.5 1608.9 1607.7 1607.0 1607.1 1607.5
 DISCH KCFS 28.000 39.8 33.9 33.9 36.4 42.8 22.7 23.4 22.7
 POWER
 AVE POWER MW 528 446 442 472 551 293 302 293
 PEAK POW MW 737 725 719 715 709 705 705 708
 ENERGY GWH 1695.4 380.5 331.7 159.2 79.3 105.8 217.7 224.4 196.9

--BIG BEND--
 EVAPORATION 79 25 22 10 5 5 12
 REG INFLOW 10665 2344 2062 999 501 674 1383 1441 1262
 RELEASE 10690 2369 2062 999 501 674 1383 1441 1262
 STORAGE 1656. 1631 1631 1631 1631 1631 1631 1631 1631
 ELEV FTMSL 1420.4 1420.0 1420.0 1420.0 1420.0 1420.0 1420.0 1420.0 1420.0
 DISCH KCFS 25.300 39.8 33.5 33.6 36.1 42.5 22.5 23.4 22.7
 POWER
 AVE POWER MW 189 163 167 179 210 113 115 109
 PEAK POW MW 517 538 538 538 538 538 538 529
 ENERGY GWH 630.4 135.8 121.6 60.1 30.1 40.3 83.9 85.4 73.2

--FORT RANDALL--
 NAT INFLOW 212 80 20 5 2 3 20 28 54
 DEPLETION 19 7 1 1 0 1 3 3 3
 EVAPORATION 83 32 24 9 4 4 9
 REG INFLOW 10802 2410 2056 994 499 671 1393 1466 1313
 RELEASE 11331 2656 2696 1307 610 697 1298 1126 941
 STOR CHANGE -528 -246 -639 -313 -111 -26 95 340 372
 STORAGE 3527. 3281 2642 2328 2217 2192 2287 2627 2999
 ELEV FTMSL 1356.4 1353.5 1345.0 1340.0 1338.0 1337.5 1339.2 1344.8 1350.0
 DISCH KCFS 27.900 44.6 43.8 43.9 43.9 43.9 21.1 18.3 16.9
 POWER
 AVE POWER MW 346 326 302 289 285 154 139 135
 PEAK POW MW 350 319 296 287 285 293 319 339
 ENERGY GWH 1011.6 248.8 242.2 108.8 48.6 54.6 114.8 103.1 90.5

--GAVINS POINT--
 NAT INFLOW 652 100 110 55 26 29 100 100 132
 DEPLETION 18 -5 2 5 2 3 10 1 1
 CHAN STOR 20 -31 1 0 0 0 42 5 3
 EVAPORATION 26 8 7 3 2 2 4
 REG INFLOW 11959 2721 2798 1354 632 722 1427 1230 1076
 RELEASE 11980 2707 2798 1354 632 722 1427 1230 1111
 STOR CHANGE -21 14 -639 -313 -111 -26 95 340 372
 STORAGE 348 362 362 362 362 362 362 362 327
 ELEV FTMSL 1206.9 1207.5 1207.5 1207.5 1207.5 1207.5 1207.5 1207.5 1206.0
 DISCH KCFS 28.500 45.5 45.5 45.5 45.5 45.5 23.2 20.0 20.0
 POWER
 AVE POWER MW 115 116 116 116 116 82 71 70
 PEAK POW MW 116 116 116 116 116 117 117 114
 ENERGY GWH 412.8 83.1 86.2 41.7 19.5 22.2 60.7 52.5 47.0

--GAVINS POINT - SIOUX CITY--
 NAT INFLOW 651 160 140 65 30 35 70 50 101
 DEPLETION 93 25 11 7 3 3 14 15 15
 REGULATED FLOW AT SIOUX CITY
 KAF 12538 2842 2927 1412 659 753 1483 1265 1197
 KCFS 47.8 47.6 47.5 47.5 47.5 47.5 24.1 20.6 21.5

--TOTAL--
 NAT INFLOW 7704 1940 1630 665 310 355 942 764 1098
 DEPLETION -978 -182 -112 -124 -58 -66 -182 -170 -85
 CHAN STOR 23 0 22 0 0 -7 29 -23 3
 EVAPORATION 1336 440 377 167 77 87 188 188 188
 STORAGE 61315. 60155 58615 57824 57456 57029 56511 56158 56147
 SYSTEM POWER
 AVE POWER MW 1563 1375 1351 1379 1493 991 1043 1021
 PEAK POW MW 2381 2358 2324 2309 2298 2296 2315 2320
 ENERGY GWH 5352.5 1125.4 1022.7 486.3 231.7 286.8 737.1 776.2 686.2
 DAILY GWH 37.5 33.0 32.4 33.1 35.8 23.8 25.0 24.5

	INI-SUM	30SEP	31OCT	15NOV	22NOV	30NOV	31DEC	31JAN	28FEB
--	---------	-------	-------	-------	-------	-------	-------	-------	-------

TIME OF STUDY: 07:44:10

FULL SERV 2ND HALF / FUL NAV SEAS + 10 Day Extension
VALUES IN 1000 AF EXCEPT AS INDICATED

STUDY NO G

	31AUG14	INI-SUM	30SEP	2014	15NOV	22NOV	30NOV	31DEC	31JAN	28FEB	
	2014	31OCT									2015
--FORT PECK--											
NAT INFLOW	3087	600	624	294	137	157	468	374	433		
DEPLETION	-603	-103	-92	-30	-14	-16	-112	-143	-93		
EVAPORATION	336	106	94	43	20	23	50				
MOD INFLOW	3354	597	622	281	131	150	530	517	526		
RELEASE	2988	386	430	208	97	111	584	615	555		
STOR CHANGE	366	210	192	73	34	39	-54	-98	-29		
STORAGE	14417.	14627	14819	14892	14926	14965	14911	14813	14783		
ELEV FTMSL	2232.2	2233.2	2234.1	2234.5	2234.6	2234.8	2234.6	2234.1	2234.0		
DISCH KCFS	7.300	6.5	7.0	7.0	7.0	7.0	9.5	10.0	10.0		
POWER											
AVE POWER MW		88	95	96	96	96	130	136	136		
PEAK POW MW		162	162	163	163	163	163	162	162		
ENERGY GWH	492.4	63.5	71.0	34.4	16.1	18.4	96.5	101.2	91.4		
--GARRISON--											
NAT INFLOW	3368	900	804	276	129	147	372	314	426		
DEPLETION	-630	-123	-23	-126	-59	-67	-111	-78	-44		
CHAN STOR	-26	8	-5				-24	-5	0		
EVAPORATION	405	132	114	51	24	27	58				
REG INFLOW	6554	1285	1139	559	261	298	985	1002	1025		
RELEASE	8959	1596	1599	774	361	413	1291	1537	1388		
STOR CHANGE	-2405	-311	-460	-215	-100	-114	-306	-535	-363		
STORAGE	20145.	19834	19374	19159	19059	18945	18639	18104	17740		
ELEV FTMSL	1844.9	1844.0	1842.6	1841.9	1841.6	1841.3	1840.3	1838.7	1837.5		
DISCH KCFS	28.000	26.8	26.0	26.0	26.0	26.0	21.0	25.0	25.0		
POWER											
AVE POWER MW		344	332	330	329	329	266	313	311		
PEAK POW MW		499	494	484	483	482	478	472	468		
ENERGY GWH	1371.2	247.7	246.7	118.7	55.3	63.1	197.5	233.2	208.9		
--OAHE--											
NAT INFLOW	1099	473	230	88	41	47	70	17	133		
DEPLETION	95	30	-11	2	1	1	16	22	34		
CHAN STOR	11	4	3	0	0	0	20	-16			
EVAPORATION	406	136	115	50	23	26	55				
REG INFLOW	9568	1907	1727	809	378	433	1310	1516	1487		
RELEASE	12127	2551	2664	1285	634	826	1598	1382	1187		
STOR CHANGE	-2559	-644	-936	-476	-256	-394	-288	134	301		
STORAGE	21222.	20578	19642	19167	18910	18517	18229	18363	18663		
ELEV FTMSL	1615.2	1613.3	1610.5	1609.1	1608.3	1607.0	1606.1	1606.5	1607.5		
DISCH KCFS	28.000	42.9	43.3	43.2	45.7	52.1	26.0	22.5	21.4		
POWER											
AVE POWER MW		569	568	560	589	653	333	288	275		
PEAK POW MW		738	724	716	712	705	700	703	708		
ENERGY GWH	1905.8	409.6	422.8	201.7	98.9	125.3	248.1	214.4	185.0		
--BIG BEND--											
EVAPORATION	79	25	22	10	5	5	12				
REG INFLOW	12048	2525	2642	1275	630	821	1587	1382	1187		
RELEASE	12073	2550	2642	1275	630	821	1587	1382	1187		
STORAGE	1656.	1631	1631	1631	1631	1631	1631	1631	1631		
ELEV FTMSL	1420.4	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0		
DISCH KCFS	25.300	42.9	43.0	42.8	45.4	51.7	25.8	22.5	21.4		
POWER											
AVE POWER MW		203	208	212	224	254	129	110	102		
PEAK POW MW		517	538	538	538	538	538	538	529		
ENERGY GWH	710.8	146.2	155.0	76.3	37.6	48.9	96.0	82.0	68.9		
--FORT RANDALL--											
NAT INFLOW	291	108	27	7	3	4	27	39	76		
DEPLETION	19	7	1	1	0	1	3	3	3		
EVAPORATION	83	32	24	9	4	4	9				
REG INFLOW	12265	2620	2643	1272	629	819	1605	1418	1260		
RELEASE	12794	2866	3283	1585	740	845	1510	1078	888		
STOR CHANGE	-529	-246	-639	-313	-111	-26	94	340	372		
STORAGE	3527.	3281	2642	2328	2217	2191	2286	2626	2998		
ELEV FTMSL	1356.4	1353.5	1345.0	1340.0	1338.0	1337.5	1339.2	1344.7	1350.0		
DISCH KCFS	27.900	48.2	53.4	53.3	53.3	53.3	24.6	17.5	16.0		
POWER											
AVE POWER MW		355	335	306	290	285	179	133	127		
PEAK POW MW		350	318	295	286	283	293	318	339		
ENERGY GWH	1036.6	255.7	249.5	110.3	48.8	54.6	133.3	98.8	85.4		
--GAVINS POINT--											
NAT INFLOW	893	135	149	75	35	40	135	140	185		
DEPLETION	18	-5	2	5	2	3	10	1			
CHAN STOR	22	-38	-10	0	0	0	53	13	3		
EVAPORATION	26	8	7	3	2	2	4				
REG INFLOW	13665	2959	3413	1651	771	881	1685	1230	1076		
RELEASE	13686	2945	3413	1651	771	881	1685	1230	1111		
STOR CHANGE	-21	14	-313	-111	-26	-26	94		-35		
STORAGE	348	362	362	362	362	362	362	362	327		
ELEV FTMSL	1206.9	1207.5	1207.5	1207.5	1207.5	1207.5	1207.5	1207.5	1206.0		
DISCH KCFS	28.500	49.5	55.5	55.5	55.5	55.5	27.4	20.0	20.0		
POWER											
AVE POWER MW		115	115	115	115	115	96	71	70		
PEAK POW MW		116	115	115	115	115	117	117	114		
ENERGY GWH	421.9	82.8	85.5	41.4	19.3	22.1	71.4	52.5	47.0		
--GAVINS POINT - SIOUX CITY--											
NAT INFLOW	887	216	189	88	41	47	95	70	141		
DEPLETION	93	25	11	7	3	3	14	15	15		
REGULATED FLOW AT SIOUX CITY	KAF	14480	3136	3591	1733	809	924	1766	1285	1237	
	KCFS	52.7	58.4	58.2	58.2	58.2	28.7	20.9	22.3		
--TOTAL--											
NAT INFLOW	9625	2432	2023	828	386	441	1167	954	1394		
DEPLETION	-1008	-169	-112	-141	-66	-75	-180	-180	-85		
CHAN STOR	9	-26	-11	0	0	-1	52	-8	3		
EVAPORATION	1334	440	377	166	77	87	187				
STORAGE	61315.	60313	58469	57539	57106	56611	56057	55898	56143		
SYSTEM POWER											
AVE POWER MW		1674	1654	1619	1643	1731	1133	1051	1022		
PEAK POW MW		2382	2351	2310	2296	2286	2289	2311	2320		
ENERGY GWH		5938.7	1205.6	1230.5	582.8	276.0	332.4	842.8	782.2	686.5	
DAILY GWH		40.2	39.7	38.9	39.4	41.5	27.2	25.2	24.5		
INI-SUM	30SEP	31OCT	15NOV	22NOV	30NOV	31DEC	31JAN	28FEB			

	31AUG14	INI-SUM	30SEP	2014	15NOV	22NOV	30NOV	31DEC	31JAN	28FEB	2015

--FORT PECK--

NAT INFLOW	2016	375	416	196	91	105	312	250	271	
DEPLETION	-488	-109	-92	-26	-12	-14	-83	-89	-63	
EVAPORATION	333	106	93	42	20	23	49			
MOD INFLOW	2171	378	415	180	84	96	346	339	334	
RELEASE	1900	315	277	134	62	71	338	369	333	
STOR CHANGE	271	63	138	46	21	24	8	-30	1	
STORAGE	14417.	14480	14618	14664	14685	14709	14717	14687	14688	
ELEV FTMSL	2232.2	2232.5	2233.2	2233.4	2233.5	2233.6	2233.7	2233.5	2233.5	
DISCH KCFS	7.300	5.3	4.5	4.5	4.5	4.5	5.5	6.0	6.0	
POWER										
AVE POWER MW		72	61	61	61	61	75	82	82	
PEAK POW MW		161	162	162	162	162	162	162	162	
ENERGY GWH	313.2	51.8	45.6	22.1	10.3	11.8	55.8	60.8	54.9	

--GARRISON--

NAT INFLOW	2191	563	536	184	86	98	248	210	266	
DEPLETION	-657	-177	-58	-118	-55	-63	-91	-59	-36	
CHAN STOR	12	19	8				-10	-5		
EVAPORATION	408	132	114	52	24	27	59			
REG INFLOW	4352	942	764	384	179	205	609	633	635	
RELEASE	6757	1280	922	446	208	246	1138	1322	1194	
STOR CHANGE	-2405	-338	-158	-62	-29	-41	-529	-689	-559	
STORAGE	20145.	19807	19649	19587	19558	19517	18988	18299	17740	
ELEV FTMSL	18449.4	1843.9	1843.4	1843.2	1843.1	1843.0	1841.4	1839.3	1837.5	
DISCH KCFS	28.000	21.5	15.0	15.0	15.0	15.5	18.5	21.5	21.5	
POWER										
AVE POWER MW		277	193	192	192	198	235	271	268	
PEAK POW MW		499	498	498	498	498	482	475	468	
ENERGY GWH	1039.6	199.1	143.4	69.3	32.3	38.1	175.2	202.0	180.3	

--OAHE--

NAT INFLOW	608	263	128	49	23	26	39	9	71	
DEPLETION	95	30	-11	2	1	1	16	22	34	
CHAN STOR	22	24	24			-2	-12	-12	0	
EVAPORATION	410	136	115	51	24	27	57			
REG INFLOW	6883	1401	970	442	207	242	1092	1297	1231	
RELEASE	9437	2261	1455	712	366	520	1338	1475	1309	
STOR CHANGE	-2554	-860	-485	-270	-160	-278	-247	-178	-77	
STORAGE	21222.	20362	19877	19607	19448	19170	18923	18745	18668	
ELEV FTMSL	1615.2	1612.7	1611.3	1610.4	1610.0	1609.1	1608.3	1607.7	1607.5	
DISCH KCFS	28.000	38.0	23.7	23.9	26.4	32.8	21.8	24.0	23.6	
POWER										
AVE POWER MW		504	312	314	345	426	283	310	304	
PEAK POW MW		735	728	723	721	716	712	709	708	
ENERGY GWH	1494.1	363.1	232.4	113.1	58.0	81.8	210.4	231.0	204.5	

--BIG BEND--

EVAPORATION	79	25	22	10	5	5	12			
REG INFLOW	9358	2236	1433	702	362	515	1327	1475	1309	
RELEASE	9383	2261	1433	702	362	515	1327	1475	1309	
STORAGE	1656.	1631	1631	1631	1631	1631	1631	1631	1631	
ELEV FTMSL	1420.4	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	
DISCH KCFS	25.300	38.0	23.3	23.6	26.1	32.4	21.6	24.0	23.6	
POWER										
AVE POWER MW		180	114	118	130	162	108	118	113	
PEAK POW MW		517	538	538	538	538	538	538	529	
ENERGY GWH	553.8	129.6	84.9	42.5	21.9	31.0	80.5	87.5	75.8	

--FORT RANDALL--

NAT INFLOW	160	60	15	4	2	2	15	21	41	
DEPLETION	19	7	1	1	0	1	3	3	3	
EVAPORATION	83	32	24	9	4	4	9			
REG INFLOW	9442	2282	1423	696	359	512	1331	1493	1347	
RELEASE	9970	2528	2062	1009	470	538	1235	1153	975	
STOR CHANGE	-528	-246	-639	-313	-111	-26	96	340	372	
STORAGE	3527.	3281	2642	2329	2218	2192	2287	2627	2999	
ELEV FTMSL	1356.4	1353.5	1345.0	1340.0	1338.0	1337.5	1339.2	1344.8	1350.0	
DISCH KCFS	27.900	42.5	33.5	33.9	33.9	33.9	20.1	18.8	17.5	
POWER										
AVE POWER MW		338	268	255	247	244	147	142	139	
PEAK POW MW		350	319	296	287	285	293	319	339	
ENERGY GWH	931.6	243.1	199.4	91.9	41.5	46.9	109.4	105.6	93.7	

--GAVINS POINT--

NAT INFLOW	490	75	83	42	19	22	75	75	99	
DEPLETION	18	-5	2	5	2	3	10	1		
CHAN STOR	19	-27	17	-1	0	0	26	2	2	
EVAPORATION	26	8	7	3	2	2	4			
REG INFLOW	10435	2573	2152	1041	486	555	1322	1230	1076	
RELEASE	10456	2559	2152	1041	486	555	1322	1230	1111	
STOR CHANGE	-21	14	-639	-313	-111	-26	96	340	372	
STORAGE	348	362	362	362	362	362	362	362	327	
ELEV FTMSL	1206.9	1207.5	1207.5	1207.5	1207.5	1207.5	1207.5	1207.5	1206.0	
DISCH KCFS	28.500	43.0	35.0	35.0	35.0	35.0	21.5	20.0	20.0	
POWER										
AVE POWER MW		116	115	115	115	115	76	71	70	
PEAK POW MW		116	117	117	117	117	117	117	114	
ENERGY GWH	407.3	83.2	85.5	41.4	19.3	22.1	56.3	52.5	47.0	

--GAVINS POINT - SIOUX CITY--

NAT INFLOW	490	120	105	49	23	26	53	38	76	
DEPLETION	93	25	11	7	3	3	14	15		
REGULATED FLOW AT SIOUX CITY	KAF	10853	2654	2246	1084	506	578	1361	1253	1172
	KCFS	44.6	36.5	36.4	36.4	36.4	22.1	20.4	21.1	
SYSTEM POWER										
AVE POWER MW		1486	1063	1056	1091	1207	924	994	977	
PEAK POW MW		2379	2362	2335	2323	2317	2305	2319	2320	
ENERGY GWH		4739.5	1069.9	791.2	380.2	183.3	231.7	687.6	739.4	656.2
DAILY GWH		35.7	25.5	25.3	26.2	29.0	22.2	23.9	23.4	
INI-SUM	30SEP	31OCT	15NOV	22NOV	30NOV	31DEC	31JAN	28FEB		

DATE OF STUDY: 3Dec2014

2014-2015 AOP UPPER DECILE RUNOFF

99001 9901 9901 PAGE 1

TIME OF STUDY: 07:44:27

STUDY NO 4

	28FEB15	INI-SUM	15MAR	2015	31MAR	30APR	31MAY	30JUN	31JUL	31AUG	30SEP	31OCT	15NOV	22NOV	2016	30NOV	31DEC	31JAN	29FEB
	VALUES IN 1000 AF EXCEPT AS INDICATED																STUDY NO 4		
--FORT PECK--																			
NAT INFLOW	9450	341	159	205	825	1400	2355	1205	440	385	480	288	134	153	350	310	420		
DEPLETION	609	-17	-8	-10	-40	295	663	274	5	-103	-63	-21	-10	-11	-109	-136	-101		
EVAPORATION	327							22	70	87	75	18	8	9	38				
MOD INFLOW	8514	358	167	215	865	1105	1692	909	365	401	468	290	135	155	421	446	521		
RELEASE	8515	208	97	125	536	769	803	830	830	715	646	312	146	182	769	799	748		
STOR CHANGE	-2	150	70	90	329	336	889	79	-465	-314	-177	-22	-10	-28	-348	-353	-227		
STORAGE	14783.	14933	15003	15093	15423	15759	16648	16726	16261	15947	15770	15748	15738	15710	15362	15009	14782		
ELEV FTMSL	2234.0	2234.7	2235.0	2235.4	2237.0	2238.5	2242.4	2242.8	2240.7	2239.3	2238.5	2238.4	2238.4	2238.3	2236.7	2235.0	2234.0		
DISCH KCFS	10.000	7.0	7.0	7.0	9.0	12.5	13.5	13.5	13.5	12.0	10.5	10.5	10.5	11.5	12.5	13.0	13.0		
POWER																			
AVE POWER MW		96	96	96	123	165	167	168	168	163	144	144	144	144	144	165	165	164	163
PEAK POW MW		163	163	163	164	165	168	169	167	166	166	165	165	165	165	164	163	162	
ENERGY GWH	1341.3	34.4	16.1	20.7	88.9	122.7	120.1	125.3	124.8	117.7	107.3	51.8	24.2	30.0	122.6	121.7	113.1		
--GARRISON--																			
NAT INFLOW	14000	530	247	318	1355	1840	3460	2715	835	570	645	248	116	132	260	315	415		
DEPLETION	1049	7	3	4	-103	-6	1015	695	101	-132	-12	-128	-60	-68	-117	-89	-62		
CHAN STOR	-30	30			-20	-34	-10			14	15		-10	-10	-10	-5			
EVAPORATION	373							26	81	99	85	20	9	10	43				
REG INFLOW	21064	761	341	439	1974	2580	3239	2825	1483	1332	1233	668	312	362	1093	1198	1225		
RELEASE	21068	565	264	339	1428	1906	2142	2214	2214	1994	1906	922	430	476	1291	1537	1438		
STOR CHANGE	-4	196	77	100	546	674	1096	611	-730	-662	-674	-255	-119	-114	-198	-339	-213		
STORAGE	17740.	17936	18014	18113	18659	19333	20430	21041	20310	19648	18974	18720	18601	18487	18289	17950	17737		
ELEV FTMSL	1837.5	1838.1	1838.4	1838.7	1840.4	1842.5	1845.7	1847.4	1845.4	1843.4	1841.4	1840.6	1840.2	1839.9	1838.2	1837.5			
DISCH KCFS	25.000	19.0	19.0	19.0	24.0	31.0	36.0	36.0	36.0	33.5	31.0	31.0	31.0	31.0	30.0	21.0	25.0		
POWER																			
AVE POWER MW		237	237	238	301	392	452	459	459	427	393	391	390	377	264	312	310		
PEAK POW MW		470	471	473	479	493	500	502	500	498	482	480	478	477	475	471	468		
ENERGY GWH	3215.7	85.2	39.8	51.3	216.8	291.5	325.7	341.7	341.3	307.2	292.1	140.8	65.5	72.3	196.3	232.1	216.0		
--OAHE--																			
NAT INFLOW	3900	569	265	341	510	390	710	310	125	185	145	118	55	63	15	10	90		
DEPLETION	734	25	12	15	51	75	157	190	128	31	-12	1	0	1	13	19	29		
CHAN STOR	3	24			-19	-26	-18			9	10		4	36	-16				
EVAPORATION	368							26	80	98	83	20	9	10	42				
REG INFLOW	23870	1133	518	665	1868	2195	2677	2307	2130	2060	1990	1019	476	532	1287	1512	1499		
RELEASE	23873	523	282	338	1046	1694	2272	2935	2977	2735	2349	1155	573	757	1554	1460	1223		
STOR CHANGE	-4	610	236	327	822	502	405	-628	-846	-675	-359	-136	-98	-225	-266	52	276		
STORAGE	18663.	19273	19509	19837	20659	21161	21565	20937	20091	19416	19057	18921	18823	18598	18332	18384	18660		
ELEV FTMSL	1607.5	1609.4	1610.1	1611.1	1613.6	1615.0	1616.1	1614.4	1611.9	1609.9	1608.7	1608.3	1608.0	1607.3	1606.4	1606.6	1607.5		
DISCH KCFS	21.370	17.6	20.3	18.9	17.6	27.5	38.2	47.7	48.4	46.0	38.2	38.8	41.3	47.7	25.3	23.7	21.3		
POWER																			
AVE POWER MW		228	265	249	233	367	511	634	634	599	495	501	532	608	325	305	274		
PEAK POW MW		718	722	727	739	747	753	744	731	720	714	712	711	707	702	703	708		
ENERGY GWH	3777.9	82.3	44.5	53.7	167.7	273.3	367.8	471.5	471.8	431.4	368.4	180.4	89.3	116.7	241.6	226.7	190.7		
--BIG BEND--																			
EVAPORATION	72							5	15	19	17	4	2	2	9				
REG INFLOW	23801	523	282	338	1046	1694	2272	2931	2962	2716	2333	1151	572	755	1545	1460	1223		
RELEASE	23801	523	282	338	1046	1694	2272	2931	2962	2716	2333	1151	572	755	1545	1460	1223		
STORAGE	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631		
ELEV FTMSL	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0		
DISCH KCFS	21.370	17.6	20.3	18.9	17.6	27.5	38.2	47.7	48.4	46.0	37.9	38.7	41.2	47.6	25.1	23.7	21.3		
POWER																			
AVE POWER MW		83	95	89	82	129	179	223	225	216	184	192	204	234	126	116	102		
PEAK POW MW		517	509	509	509	509	509	509	517	538	538	538	538	538	538	538	538	529	
ENERGY GWH	1374.1	30.0	16.0	19.1	59.3	95.9	128.6	165.8	167.5	155.4	137.2	69.0	34.2	45.0	93.5	86.5	71.0		
--FORT RANDALL--																			
NAT INFLOW	1500	150	70	90	440	230	155	80	70	100	40				15		60		
DEPLETION	80	1	1	1	4	9	12	18	15	7	1	1	0	1	3	3	3		
EVAPORATION	80							6	19	24	18	4	2	2	7				
REG INFLOW	25143	672	351	427	1482	1915	2415	2987	2998	2786	2353	1146	570	752	1553	1457	1280		
RELEASE	25140	388	207	427	1482	1915	2415	2987	2998	2930	2992	1459	681	778	1444	1116	921		
STOR CHANGE	3	283	144	144	0	0	0	0	0	-144	-639	-313	-111	-26	109	341	359		
STORAGE	2998.	3281	3425	3425	3425	3425	3425	3425	3425	3281	2642	2329	2218	2192	2301	2642	3001		
ELEV FTMSL	1350.0	1353.5	1355.2	1355.2	1355.2	1355.2	1355.2	1355.2	1355.2	1345.0	1340.0	1338.0	1337.5	1345.0	1350.0	1350.0			
DISCH KCFS	15.987	13.1	14.9	23.9	24.9	31.1	40.6	48.6	48.8	49.2	48.7	49.0	49.0	23.5	18.1	16.0			
POWER																			
AVE POWER MW		108	126	202	210	262	331	356	356	353	336	307	291	286	172	138	128		
PEAK POW MW		350	356	356	356	356	356	356	356	350	319	296	287	284	294	320	339		
ENERGY GWH	2255.3	38.9	21.1	43.7	151.4	194.9	238.0	264.8	264.8	254.2	250.1	110.7	48.9	54.8	127.7	102.5	88.8		
--GAVINS POINT--																			
NAT INFLOW	2250	111	52	67	280	330	245	205	165	130	150	65	30	35	90	105	190		
DEPLETION	114	0	0	5	19	24	39												

DATE OF STUDY: 3Dec2014										2014-2015 AOP UPPER QUARTILE RUNOFF										
TIME OF STUDY: 07:44:10										VALUES IN 1000 AF EXCEPT AS INDICATED										
28FEB15			INI-SUM	15MAR	2015	31MAR	30APR	31MAY	30JUN	31JUL	31AUG	30SEP	31OCT	15NOV	22NOV	2016	30NOV	31DEC	31JAN	29FEB
--FORT PECK--																				
NAT INFLOW	8650	310	144	186	755	1285	2155	1105	405	350	440	263	123	140	320	285	385			
DEPLETION	552	-17	-8	-10	-46	308	656	275	-5	-114	-86	-27	-13	-14	-114	-136	-97			
EVAPORATION	325							22	69	85	74	18	8	9	39					
MOD INFLOW	7773	327	152	196	801	977	1499	808	341	379	452	272	127	145	395	421	482			
RELEASE	7773	193	90	116	476	646	774	799	799	626	492	238	111	127	738	799	748			
CHAN STOR	-1	133	62	80	325	331	725	9	-458	-248	-40	34	16	18	-342	-378	-266			
STOR CHANGE	14783.	14917	14979	15059	15384	15715	16441	16449	15991	15743	15703	15737	15753	15771	15428	15050	14784			
ELEV FTMSL	2234.0	2234.6	2234.9	2235.3	2236.8	2238.3	2241.5	2241.6	2239.5	2238.4	2238.2	2238.4	2238.5	2238.5	2237.0	2235.2	2234.0			
DISCH KCFS	10.000	6.5	6.5	6.5	8.0	10.5	13.0	13.0	13.0	10.5	8.0	8.0	8.0	8.0	12.0	13.0	13.0			
POWER																				
AVE POWER MW		89	89	89	110	144	166	168	167	144	110	110	110	111	162	164	163			
PEAK POW MW		163	163	163	164	165	168	168	166	165	165	165	165	166	164	163	162			
ENERGY GWH	1241.6	32.0	14.9	19.2	79.0	106.8	119.9	124.8	124.2	104.0	82.2	39.8	18.6	21.2	120.2	121.8	113.2			
--GARRISON--																				
NAT INFLOW	12750	482	225	289	1230	1675	3200	2475	760	520	555	215	100	115	235	295	380			
DEPLETION	1003	7	3	4	-71	-14	995	691	78	-153	-51	-125	-58	-67	-108	-77	-51			
CHAN STOR	-30	35	0	0	-15	-25	-24		24	24	0	0	0	0	-39	-10				
EVAPORATION	373							25	80	99	85	20	9	11	43					
REG INFLOW	19117	703	312	401	1762	2310	2954	2558	1401	1223	1037	558	261	298	999	1162	1179			
RELEASE	19116	550	257	330	1250	1752	1904	1937	1937	1726	1629	788	368	421	1291	1537	1438			
STOR CHANGE	1	152	55	71	513	558	1050	621	-536	-502	-592	-230	-107	-123	-292	-376	-259			
STORAGE	17740.	17893	17948	18018	18531	19089	20139	20760	20224	19722	19129	18899	18791	18669	18376	18001	17741			
ELEV FTMSL	1837.5	1838.0	1838.2	1838.4	1840.0	1841.7	1844.9	1846.6	1845.1	1843.6	1841.8	1841.1	1840.8	1840.4	1839.5	1838.3	1837.5			
DISCH KCFS	25.000	18.5	18.5	18.5	21.0	28.5	32.0	31.5	31.5	29.0	26.5	26.5	26.5	26.5	21.0	25.0	25.0			
POWER																				
AVE POWER MW		230	231	231	263	360	407	406	406	372	337	335	335	334	265	312	310			
PEAK POW MW		470	471	471	477	484	499	501	500	499	484	481	480	479	476	471	468			
ENERGY GWH	2930.9	82.9	38.8	49.9	189.6	267.6	293.1	302.1	302.3	267.5	250.7	120.7	56.3	64.2	196.9	232.5	216.1			
--OAHE--																				
NAT INFLOW	3200	457	213	274	430	310	640	250	95	150	120	95	44	51	-10	80				
DEPLETION	734	25	12	15	51	75	157	190	128	31	-12	1	0	1	13	19	29			
CHAN STOR	2	26		-10	-28	-13	2	2	9	10				22		-16				
EVAPORATION	365							26	79	97	83	19	9	10	42					
REG INFLOW	21219	1009	459	590	1619	1959	2374	1973	1825	1758	1689	863	403	460	1248	1502	1489			
RELEASE	21219	555	296	357	1005	1397	1904	2535	2571	2358	1964	954	480	650	1456	1479	1259			
STOR CHANGE	1	454	162	233	614	562	470	-562	-746	-601	-275	-91	-77	-189	-207	24	230			
STORAGE	18663.	19117	19280	19513	20127	20689	21159	20597	19851	19250	18975	18884	18807	18618	18411	18434	18664			
ELEV FTMSL	1607.5	1608.9	1609.4	1610.2	1612.0	1613.6	1615.0	1613.4	1611.2	1609.3	1608.5	1608.2	1607.9	1607.3	1606.7	1606.7	1607.5			
DISCH KCFS	21.370	18.7	21.3	20.0	16.9	22.7	32.0	41.2	41.8	39.6	31.9	32.1	34.6	40.9	23.7	24.0	21.9			
POWER																				
AVE POWER MW		242	278	261	222	301	426	547	550	516	414	414	446	526	305	309	282			
PEAK POW MW		715	718	722	731	740	747	739	727	718	713	711	710	707	703	704	708			
ENERGY GWH	3354.9	87.1	46.7	56.4	160.2	224.2	306.9	407.1	408.9	371.6	308.0	149.2	74.9	100.9	226.7	229.8	196.3			
--BIG BEND--																				
EVAPORATION	72							5	15	19	17	4	2	2	9					
REG INFLOW	21147	555	296	357	1005	1397	1904	2530	2556	2340	1947	950	478	648	1447	1479	1259			
RELEASE	21147	555	296	357	1005	1397	1904	2530	2556	2340	1947	950	478	648	1447	1479	1259			
STORAGE	1631.	1631.	1631.	1631.	1631.	1631.	1631.	1631.	1631.	1631.	1631.	1631.	1631.	1631.	1631.	1631.	1631.	1631.		
ELEV FTMSL	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0		
DISCH KCFS	21.370	18.7	21.3	20.0	16.9	22.7	32.0	41.1	41.6	39.3	31.7	31.9	34.4	40.8	23.5	24.0	21.9			
POWER																				
AVE POWER MW		88	100	94	79	106	150	192	192	194	186	154	159	171	202	118	118	105		
PEAK POW MW		517	509	509	509	509	509	509	509	517	538	538	538	538	538	538	538	538	529	
ENERGY GWH	1222.5	31.8	16.8	20.2	56.9	79.1	107.8	143.2	144.7	134.0	114.9	57.2	28.7	38.8	87.7	87.6	73.0			
--FORT RANDALL--																				
NAT INFLOW	1200	123	58	74	350	185	140	75	65	75	10	-3	-1	-1	5	-5	50			
DEPLETION	80	1	1	1	4	9	12	18	15	7	1	0	1	1	3	2	3	3		
EVAPORATION	80							6	19	24	18	4	2	2	7					
REG INFLOW	22188	677	353	430	1351	1573	2032	2581	2587	2384	1938	943	475	644	1444	1471	1306			
RELEASE	22184	393	209	430	1351	1573	2032	2581	2587	2528	2577	1256	586	670	1335	1130	947			
STOR CHANGE	3	283	144	0	0	0	0	0	0	-144	-639	-313	-111	-26	109	341	359			
STORAGE	2998.	3281	3425	3425	3425	3425	3425	3425	3425	3281	2642	2329	2218	2192	2301	2642	3001			
ELEV FTMSL	1350.0	1353.5	1355.2	1355.2	1355.2	1355.2	1355.2	1355.2	1355.2	1355.2	1345.0	1340.0	1338.0	1337.5	1339.5	1345.0	1350.0			
DISCH KCFS	15.987	13.2	15.1	24.1	22.7	25.6	34.2	42.0	42.2	42.5	41.9	42.2	42.2	42.2	21.7	18.4	16.5			
POWER																				
AVE POWER MW		109	127	203	192	216	287	336	337	336	319	297	284	280	159	139	131			
PEAK POW MW		350	356	356	356	356	356	356	356	356	319	2								

	28FEB15	INI-SUM	15MAR	2015	31MAR	30APR	31MAY	30JUN	31JUL	31AUG	30SEP	31OCT	15NOV	22NOV	2016	30NOV	31DEC	31JAN	29FEB
	VALUES IN 1000 AF EXCEPT AS INDICATED																		
--FORT PECK--																			
NAT INFLOW	7200	227	106	136	560	1145	1830	840	365	290	385	205	96	109	295	260	350		
DEPLETION	505	-22	-10	-13	34	308	517	274	33	-75	-56	-42	-20	-22	-131	-155	-115		
EVAPORATION	462							29	89	111	96	43	20	23	50				
MOD INFLOW	6233	249	116	149	526	837	1313	537	243	254	345	204	95	109	376	415	465		
RELEASE	6404	179	83	107	446	553	625	646	646	518	369	179	83	106	615	646	604		
STOR CHANGE	-171	71	33	42	80	284	688	-108	-403	-264	-24	25	12	2	-239	-231	-139		
STORAGE	14795.	14865	14898	14941	15020	15304	15992	15884	15481	15218	15194	15219	15230	15232	14993	14763	14624		
ELEV FTMSL	2234.0	2234.4	2234.5	2234.7	2235.1	2236.4	2239.5	2239.1	2237.2	2236.0	2235.9	2236.0	2236.1	2236.1	2235.0	2233.9	2233.2		
DISCH KCFS	8.500	6.0	6.0	6.0	7.5	9.0	10.5	10.5	10.5	8.7	6.0	6.0	6.0	6.0	6.7	10.0	10.5	10.5	
POWER																			
AVE POWER MW		82	82	82	103	123	144	144	144	120	82	82	92	137	142	142	142		
PEAK POW MW		162	163	163	163	164	166	166	165	164	164	164	164	163	162	162	162		
ENERGY GWH	1058.7	29.5	13.8	17.7	73.8	91.7	103.5	107.4	107.0	86.1	61.3	29.7	13.8	17.7	101.6	105.6	98.5		
--GARRISON--																			
NAT INFLOW	10900	479	223	287	780	1300	3120	2100	580	480	445	180	84	96	180	255	310		
DEPLETION	1082	6	3	4	15	153	799	672	114	-147	-44	-130	-60	-69	-110	-74	-50		
CHAN STOR	-20	25			-15	-15	-15			17	26		-7	-32	-5				
EVAPORATION	534							33	104	129	112	50	23	27	57				
REG INFLOW	15668	676	304	391	1196	1686	2931	2041	1008	1033	773	438	204	238	816	970	964		
RELEASE	15851	536	250	321	1160	1537	1547	1537	1537	1280	1107	536	250	286	1230	1414	1323		
STOR CHANGE	-183	141	54	69	36	148	1384	504	-529	-247	-334	-98	-45	-48	-414	-445	-359		
STORAGE	17731.	17872	17926	17995	18031	18179	19563	20067	19537	19290	18956	18859	18813	18766	18351	17907	17548		
ELEV FTMSL	1837.5	1837.9	1838.1	1838.3	1838.4	1838.9	1843.2	1844.6	1843.1	1842.3	1841.3	1841.0	1840.9	1840.7	1839.4	1838.0	1836.9		
DISCH KCFS	24.000	18.0	18.0	18.0	19.5	25.0	26.0	25.0	25.0	21.5	18.0	18.0	18.0	20.0	23.0				
POWER																			
AVE POWER MW		224	224	225	243	312	329	320	320	274	229	228	228	228	252	287	285		
PEAK POW MW		470	470	471	472	473	498	499	498	490	482	480	480	475	470	466			
ENERGY GWH	2418.4	80.7	37.7	48.5	175.3	232.2	236.6	238.1	238.1	197.3	170.1	82.0	38.3	43.7	187.7	213.8	198.4		
--OAHE--																			
NAT INFLOW	2300	259	121	155	405	220	625	170	70	95	45	45	21	24	-15	-10	70		
DEPLETION	734	25	12	15	51	75	157	190	128	31	-12	1	0	1	13	19	29		
CHAN STOR	4	24			-6	-21	-4		4	14	14			-8	-12				
EVAPORATION	507						32	100	122	105	47	22	25	54					
REG INFLOW	16915	794	359	462	1508	1661	2011	1489	1380	1236	1073	533	249	284	1139	1373	1364		
RELEASE	17113	464	307	360	1293	1543	1609	1849	1983	1754	1263	587	309	227	1113	1315	1137		
STOR CHANGE	-199	329	52	101	216	118	402	-360	-603	-518	-190	-54	-61	57	26	58	227		
STORAGE	18664.	18994	19046	19148	19363	19481	19884	19523	18920	18402	18212	18158	18097	18154	18181	18239	18466		
ELEV FTMSL	1607.5	1608.5	1608.7	1609.0	1609.7	1610.1	1611.3	1610.2	1608.3	1606.6	1606.0	1605.8	1605.6	1605.8	1606.1	1606.8			
DISCH KCFS	22.727	15.6	22.1	20.2	21.7	25.1	27.0	30.1	29.5	29.1	20.5	19.4	14.0	14.3	18.1	21.4	19.8		
POWER																			
AVE POWER MW		202	287	263	283	328	354	394	419	380	264	253	285	183	232	274	254		
PEAK POW MW		713	714	716	720	721	728	722	712	703	700	699	698	699	700	704			
ENERGY GWH	2681.7	72.9	48.2	56.7	203.9	243.7	255.1	292.9	311.5	273.3	196.2	91.0	47.8	35.2	172.6	203.8	176.8		
--BIG BEND--																			
EVAPORATION	105						6	20	25	22	10	5	5	12					
REG INFLOW	17008	464	307	360	1293	1543	1609	1843	1963	1729	1241	577	305	222	1101	1315	1137		
RELEASE	17008	464	307	360	1293	1543	1609	1843	1963	1729	1241	577	305	222	1101	1315	1137		
STORAGE	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631		
ELEV FTMSL	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0		
DISCH KCFS	22.727	15.6	22.1	20.2	21.7	25.1	27.0	30.0	31.9	29.1	20.2	19.4	21.9	21.4	21.4	21.4	21.4		
POWER																			
AVE POWER MW		74	103	95	102	117	127	140	149	138	99	97	110	70	90	105	95		
PEAK POW MW		517	509	509	509	509	509	509	509	517	538	538	538	538	538	538	538		
ENERGY GWH	982.5	26.6	17.4	20.4	73.2	87.4	91.1	104.4	111.1	99.1	73.7	35.1	18.5	13.5	67.0	78.0	66.0		
--FORT RANDALL--																			
NAT INFLOW	900	121	56	73	160	165	135	70	60	35	-5	-2	-3		-10	45			
DEPLETION	80	1	1	1	4	9	12	18	15	7	1	0	1	3	3				
EVAPORATION	116						8	25	31	24	9	4	4	9					
REG INFLOW	17713	584	362	432	1449	1699	1732	1887	1982	1725	1216	562	298	215	1089	1302	1179		
RELEASE	17711	301	218	432	1449	1699	1732	1887	1982	1869	1855	875	409	241	980	961	820		
STOR CHANGE	2	282	144	0	0	0	0	0	0	-144	-639	-313	-111	-26	108	341	359		
STORAGE	2999.	3281	3425	3425	3425	3425	3425	3425	3425	3281	2642	2329	2218	2192	2300	2641	3000		
ELEV FTMSL	1350.0	1353.5	1355.2	1355.2	1355.2	1355.2	1355.2	1355.2	1355.2	1355.2	1345.0	1340.0	1338.0	1337.5	1339.5	1345.0	1350.0		
DISCH KCFS	16.947	10.1	15.7	24.2	24.2	24.3	27.6	29.1	30.7	32.2	31.4	30.2	29.4	29.5	15.2	15.6	14.3		
POWER																			
AVE POWER MW		84	133	204	206	233	245	258	271	262	242	222	215	111	117	119	114		
PEAK POW MW		350	356	356	356	356	356	356	356	350	319	296	287	285	294	320	339		
ENERGY GWH	781.1	17.6	10.7	19.7	65.6	74.9	75.3	77.8	80.9	78.3	80.6	38.3	17.9	12.5	44.7	44.7	41.5		
--GAVINS POINT--																			
NAT INFLOW	1500	102	47	61	145	165	175	100	90	95	120	58	27	31	80	85	120		
DEPLETION	114	0	0	5	19	24</													

DATE OF STUDY: 18Nov2014

2014-2015 AOP LOWER QUARTILE RUNOFF

99001 9901 9901 PAGE 1

TIME OF STUDY: 09:32:39

STUDY NO 7

	28FEB15	INI-SUM	15MAR	2015	31MAR	30APR	31MAY	30JUN	31JUL	31AUG	30SEP	31OCT	15NOV	22NOV	2016	30NOV	31DEC	31JAN	29FEB
--FORT PECK--																			
NAT INFLOW	5950	201	94	120	460	945	1510	645	290	240	320	168	78	89	240	240	310		
DEPLETION	434	-8	-4	-5	40	159	345	279	50	-74	-78	-18	-8	-9	-83	-89	-63		
EVAPORATION	549							35	107	132	114	51	24	27	59				
MOD INFLOW	4967	209	98	125	420	786	1165	331	133	182	284	134	62	71	264	329	373		
RELEASE	6506	179	83	107	417	553	655	676	676	505	369	179	83	100	615	676	633		
STOR CHANGE	-1539	31	14	18	3	233	510	-345	-543	-323	-85	-45	-21	-29	-351	-347	-260		
STORAGE	14688.	14718	14733	14751	14754	14987	15498	15153	14609	14286	14201	14156	14135	14106	13756	13409	13149		
ELEV FTMSL	2233.5	2233.7	2233.7	2233.8	2233.8	2234.9	2237.3	2235.7	2233.1	2231.6	2231.2	2230.9	2230.8	2230.7	2228.9	2227.2	2225.8		
DISCH KCFS	6.000	6.0	6.0	6.0	7.0	9.0	11.0	11.0	11.0	8.5	6.0	6.0	6.0	6.3	10.0	11.0	11.0		
POWER																			
AVE POWER MW		82	82	82	95	123	149	149	148	115	81	81	85	134	144	143			
PEAK POW MW		162	162	162	162	163	165	163	162	160	160	160	160	160	159	157	156		
ENERGY GWH	1058.0	29.4	13.7	17.7	68.7	91.3	107.1	110.8	109.9	82.9	60.4	29.2	13.6	16.3	99.8	107.2	99.7		
--GARRISON--																			
NAT INFLOW	9150	404	189	242	640	1150	2600	1700	475	395	395	160	75	85	150	210	280		
DEPLETION	1081	13	6	8	37	146	716	603	124	-128	-19	-121	-56	-65	-90	-55	-38		
CHAN STOR	-50			-10	-20	-20				25	25		-3	-37	-10				
EVAPORATION	624							39	122	151	130	58	27	31	66				
REG INFLOW	13900	570	266	342	1010	1538	2519	1734	905	902	678	401	187	216	752	931	951		
RELEASE	15879	476	222	286	1398	1660	1547	1537	1253	1045	506	236	270	1168	1414	1323			
STOR CHANGE	-1979	94	44	56	-389	-123	971	197	-632	-351	-367	-104	-49	-54	-417	-483	-372		
STORAGE	17740.	17834	17878	17934	17545	17422	18394	18591	17958	17608	17240	17136	17087	17034	16617	16134	15762		
ELEV FTMSL	1837.5	1837.8	1837.9	1838.1	1836.8	1836.4	1839.6	1840.2	1838.2	1837.0	1835.8	1835.5	1835.1	1833.7	1832.1	1830.8			
DISCH KCFS	21.500	16.0	16.0	16.0	23.5	27.0	26.0	25.0	25.0	21.1	17.0	17.0	17.0	19.0	23.0				
POWER																			
AVE POWER MW		199	200	200	291	332	323	314	313	261	210	209	209	209	232	277	274		
PEAK POW MW		469	470	470	466	464	476	478	471	466	462	461	460	459	454	448	443		
ENERGY GWH	2368.8	71.7	33.5	43.1	209.7	247.7	232.5	233.7	232.8	188.3	156.3	75.3	35.1	40.0	172.3	206.1	190.9		
--OAHE--																			
NAT INFLOW	1350	177	82	106	285	130	315	110	50	55	15	13	6	7	-35	-15	50		
DEPLETION	734	25	12	15	51	75	157	190	128	31	-12	1	0	1	13	19	29		
CHAN STOR	-6	22	0	0	-30	-14	4	4	17	17			-9	-18					
EVAPORATION	575					37	114	140	119	52	24	28	61						
REG INFLOW	15914	650	293	377	1603	1701	1709	1424	1346	1153	971	465	217	248	1051	1363	1344		
RELEASE	17958	516	373	448	1577	1846	1820	2069	2096	1592	1658	663	259	235	849	1058	899		
STOR CHANGE	-2044	134	-80	-71	26	-145	-110	-645	-751	-439	-687	-198	-42	13	202	304	445		
STORAGE	18668.	18801	18721	18650	18675	18531	18420	17775	17025	16586	15899	15701	15659	15672	15874	16178	16624		
ELEV FTMSL	1607.5	1607.9	1607.7	1607.4	1607.5	1607.1	1606.7	1604.6	1602.0	1600.4	1598.0	1597.2	1597.1	1597.9	1599.0	1600.6			
DISCH KCFS	23.560	17.4	26.9	25.1	26.5	30.0	30.6	33.6	34.1	26.8	27.0	22.3	18.7	14.8	13.8	17.2	15.6		
POWER																			
AVE POWER MW		225	347	324	342	386	392	428	428	333	332	272	228	181	169	212	194		
PEAK POW MW		710	709	707	708	705	704	692	679	671	658	654	653	654	657	663	671		
ENERGY GWH	2738.6	80.9	58.3	69.9	246.0	287.3	282.5	318.7	318.7	239.9	247.1	98.0	38.3	34.8	125.8	157.6	134.9		
--BIG BEND--																			
EVAPORATION	131							8	25	31	28	12	6	7	14				
REG INFLOW	17827	516	373	448	1577	1846	1820	2061	2071	1561	1630	650	253	229	834	1058	899		
RELEASE	17827	516	373	448	1577	1846	1820	2061	2071	1561	1630	650	253	229	834	1058	899		
STORAGE	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631		
ELEV FTMSL	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0		
DISCH KCFS	23.560	17.4	26.9	25.1	26.5	30.0	30.6	33.5	33.7	26.2	26.5	21.9	18.2	14.4	13.6	17.2	15.6		
POWER																			
AVE POWER MW		82	126	117	124	140	143	157	158	126	130	109	92	73	68	85	75		
PEAK POW MW		517	509	509	509	509	509	509	529	538	538	538	538	538	538	538	538		
ENERGY GWH	1028.5	29.6	21.1	25.4	89.3	104.5	103.0	116.7	117.3	90.4	96.5	39.3	15.4	14.0	51.0	62.9	52.2		
--FORT RANDALL--																			
NAT INFLOW	450	77	36	46	80	65	110	35	25	-20	-8	-4	-4	-10	-20	40			
DEPLETION	80	1	1	1	4	9	12	18	15	7	1	0	1	3	3	3			
EVAPORATION	142								32	38	29	12	5	5	12				
REG INFLOW	18056	592	409	494	1653	1902	1918	2068	2050	1516	1580	630	244	219	810	1035	936		
RELEASE	18054	310	265	494	1653	1902	1918	2068	2050	1940	1939	884	414	245	701	694	577		
STOR CHANGE	2	282	144	0	0	0	0	0	0	-424	-359	-254	-170	-26	109	341	359		
STORAGE	2999.	3281	3425	3425	3425	3425	3425	3425	3425	3001	2642	2388	2218	2192	2301	2642	3001		
ELEV FTMSL	1350.0	1353.5	1355.2	1355.2	1355.2	1355.2	1355.2	1355.2	1355.2	1350.0	1345.0	1341.0	1338.0	1337.5	1339.5	1345.0	1350.0		
DISCH KCFS	17.547	10.4	19.1	27.7	27.8	30.9	32.2	33.6	33.3	32.6	31.5	29.7	29.8	15.4	11.4	11.3	10.0		
POWER																			
AVE POWER MW		86	160	233	234	260	271	283	280	268	249	225	219	113	84	86	80		
PEAK POW MW		350	356	356	356	356	356	356	356	339	319	301	287	285	294	319	339		
ENERGY GWH	1784.6	31.1	27.0	50.3	168.6	193.6	195.1	210.3	208.4	193.2	185.0	81.1	36.8	21.7	62.5	64.1	55.8		
--GAVINS POINT--																			
NAT INFLOW	1300	92	43	55	125	140	150	85	70	80	105	50	23	27	75	75	105		
DEPLETION	114	0	0	5	19	24	39	10	5	2	5	2	3	10	1	1			
CHAN STOR	13	14	-17	-16	0	-6	-2	-3	1	1	2	3	0	27					

DATE OF STUDY: 18 Nov 2014

2014-2015 AOP LOWER DECILE RUNOFF

99001 9901 9901 PAGE 1

TIME OF STUDY: 10:06:34

STUDY NO 8

28FEB15		2015		VALUES IN 1000 AF EXCEPT AS INDICATED														2016	
	INI-SUM	15MAR	22MAR	31MAR	30APR	31MAY	30JUN	31JUL	31AUG	30SEP	31OCT	15NOV	22NOV	30NOV	31DEC	31JAN	29FEB		
--FORT PECK--																			
NAT INFLOW	5300	194	90	116	440	850	1180	595	260	230	310	145	68	77	220	230	295		
DEPLETION	206	-9	-4	-6	34	153	339	201	20	-112	-98	-28	-13	-15	-79	-98	-79		
EVAPORATION	532							34	104	128	111	50	23	26	57				
MOD INFLOW	4562	203	95	122	406	697	841	360	136	214	297	123	58	66	242	328	374		
RELEASE	6748	179	83	107	387	615	684	707	707	522	369	179	83	111	646	707	661		
STOR CHANGE	-2186	24	11	15	19	82	157	-347	-571	-308	-72	-55	-26	-45	-403	-379	-287		
STORAGE	14688.	14712	14723	14738	14757	14839	14969	14649	14078	13770	13698	13643	13617	13572	13168	12789	12502		
ELEV FTMSL	2233.5	2233.6	2233.7	2233.8	2233.9	2234.2	2235.0	2233.3	2230.6	2229.0	2228.7	2228.4	2228.2	2228.0	2225.9	2223.9	2222.4		
DISCH KCFS	6.000	6.0	6.0	6.0	6.5	10.0	11.5	11.5	8.8	6.0	6.0	7.0	7.0	10.5	11.5	11.5	11.5		
POWER																			
AVE POWER MW		82	82	82	89	136	154	153	152	118	81	80	80	94	138	147	146		
PEAK POW MW	162	162	162	162	162	163	163	162	160	159	158	158	158	158	156	154	153		
ENERGY GWH	1082.8	29.4	13.7	17.7	63.8	101.1	110.6	114.0	113.0	85.0	59.9	29.0	13.5	18.0	102.9	109.5	101.5		
--GARRISON--																			
NAT INFLOW	7400	382	178	229	580	1100	2165	935	325	215	385	150	70	80	140	195	270		
DEPLETION	955	13	6	8	37	146	615	535	102	-144	-34	-110	-51	-58	-65	-29	-16		
CHAN STOR	-55			-5	-35	-15				27	28			-10	-36	-10			
EVAPORATION	598							38	117	144	124	56	26	30	64				
REG INFLOW	12539	548	256	329	925	1534	2219	1069	813	765	692	382	178	210	751	921	947		
RELEASE	15302	476	222	286	1488	1537	1458	1476	1476	1192	984	476	222	254	1138	1353	1265		
STOR CHANGE	-2763	72	33	43	-563	-3	761	-407	-663	-427	-292	-94	-44	-44	-386	-432	-318		
STORAGE	17740.	17812	17846	17889	17326	17323	18084	17677	17015	16587	16295	16202	16158	16114	15728	15296	14978		
ELEV FTMSL	1837.5	1837.7	1837.8	1838.0	1836.1	1836.1	1838.6	1837.3	1835.1	1833.6	1832.6	1832.3	1832.1	1830.0	1830.6	1829.1	1827.9		
DISCH KCFS	21.500	16.0	16.0	16.0	25.0	24.5	24.0	24.0	20.0	16.0	16.0	18.5	22.0						
POWER																			
AVE POWER MW		199	199	200	309	307	303	298	295	244	194	193	193	192	221	260	258		
PEAK POW MW	469	469	470	463	463	472	467	459	454	450	449	449	448	443	437	433			
ENERGY GWH	2254.6	71.7	33.5	43.1	222.3	228.4	218.4	221.9	219.5	175.6	144.2	69.5	32.4	37.0	164.5	193.4	179.3		
--OAHE--																			
NAT INFLOW	1150	169	79	102	200	110	305	105	40	45	5	8	4	4	-45	-20	40		
DEPLETION	734	25	12	15	51	75	157	190	128	31	-12	1	0	1	13	19	29		
CHAN STOR	-2	22	0	0	-36		2	2		17	18		0	0	-11	-16			
EVAPORATION	557							36	111	135	114	51	24	27	58				
REG INFLOW	15158	643	290	372	1601	1572	1608	1356	1276	1088	904	432	202	231	1010	1298	1276		
RELEASE	18012	539	383	461	1576	1871	1850	2052	2086	1854	1359	594	313	233	864	1068	909		
STOR CHANGE	-2854	104	-94	-89	24	-299	-242	-696	-809	-766	-454	-162	-112	-3	146	230	368		
STORAGE	18668.	18771	18678	18589	18613	18314	18073	17377	16568	15801	15347	15185	15073	15071	15216	15446	15814		
ELEV FTMSL	1607.5	1607.8	1607.5	1607.2	1607.3	1606.4	1605.6	1603.2	1600.4	1597.6	1595.9	1595.3	1594.8	1594.8	1595.4	1596.3	1597.6		
DISCH KCFS	23.560	18.1	27.6	25.8	26.5	30.4	31.1	33.4	33.9	31.2	22.1	20.0	22.6	14.7	14.1	17.4	15.8		
POWER																			
AVE POWER MW		234	356	333	341	390	397	422	423	383	269	242	272	177	170	211	193		
PEAK POW MW	710	708	706	707	702	698	685	670	656	648	645	642	642	645	650	656	656		
ENERGY GWH	2726.0	84.4	59.9	71.9	245.6	290.4	285.7	313.9	314.5	275.5	200.0	87.0	45.7	34.1	126.4	156.8	134.2		
--BIG BEND--																			
EVAPORATION	131							8	25	31	28	12	6	7	14				
REG INFLOW	17881	539	383	461	1576	1871	1850	2044	2061	1822	1331	582	307	227	850	1068	909		
RELEASE	17881	539	383	461	1576	1871	1850	2044	2061	1822	1331	582	307	227	850	1068	909		
STORAGE	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631		
ELEV FTMSL	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0		
DISCH KCFS	23.560	18.1	27.6	25.8	26.5	30.4	31.1	33.2	33.5	30.6	21.6	19.5	22.1	14.3	13.8	17.4	15.8		
POWER																			
AVE POWER MW		86	129	121	124	142	145	156	157	145	106	98	111	72	70	85	76		
PEAK POW MW	517	509	509	509	509	509	509	509	509	517	538	538	538	538	538	538	529		
ENERGY GWH	1030.5	30.9	21.7	26.1	89.3	106.0	104.7	115.7	116.7	104.5	78.9	35.3	18.7	13.8	51.9	63.5	52.8		
--FORT RANDALL--																			
NAT INFLOW	350	68	32	41	85	50	95	25	15	-5	-25	-10	-5	-5	-20	-25	35		
DEPLETION	80	1	1	1	4	9	12	18	15	7	1	1	0	1	3	3	3		
EVAPORATION	145							10	32	39	31	12	5	5	12				
REG INFLOW	18007	605	414	501	1657	1912	1933	2041	2029	1771	1275	559	298	216	815	1040	941		
RELEASE	18005	323	270	501	1657	1912	1933	2041	2029	1915	1914	872	409	242	706	699	582		
STOR CHANGE	2	282	144	0	0	0	0	0	0	0	-144	-639	-313	-111	-26	109	341	359	
STORAGE	2999.	3281	3245	3425	3425	3425	3425	3425	3425	3281	2642	2329	2218	2192	2301	2642	3001		
ELEV FTMSL	1350.0	1353.5	1355.2	1355.2	1355.2	1355.2	1355.2	1355.2	1355.2	1353.5	1345.0	1340.0	1338.0	1337.5	1339.5	1345.0	1350.0		
DISCH KCFS	17.547	10.9	19.5	28.1	27.9	31.1	32.5	33.2	33.0	32.2	31.1	29.4	15.3	11.5	11.4	10.1			
POWER																			
AVE POWER MW		90	164	236	235	262	273	279	277	269	249	221	215	111	85	87	81		
PEAK POW MW	350	356	356	356	356	356	356	356	356	350	319	296	287	285	294	319	339		
ENERGY GWH	1785.1	32.4	27.5	51.1	169.0	194.7	196.6	207.5	206.4	193.5	185.3	79.6	36.2	21.4	63.0	64.6	56.3		
--GAVINS POINT--																			
NAT INFLOW	1200	80	37	48	120	130	135	80	60	75	100	48	22	25	70	70	100		
DEPLETION	114	0	0	5	19	24	39	10	-5	2	5	2	2	3	10	1	2		
CHAN STOR	13	13	-17	-16	0	-6	-3	-1	0	2	3	0	26	5	7	0	2		
EVAPORATION	42							2	8	10	9	4	2	5					
REG INFLOW	19062	417	291	533	1773	2017	2041	2078	2072	1987	2005	913	426	289	769	769	684		
RELEASE	19062	417	291	533	1773	2017	2041	2078	2060	1964	2005	913	426	289	769	769	719		
STOR CHANGE	2	282	144	0	0	0	0	0	0	12	23				-35				
STORAGE	327.	327	327	327	327	327	327	327	327	339	362	362	362	362	362	362	327		
ELEV FTMSL	1206.0	1206.0	1206.0	1206.0	1206.0	1206.0	1206.0	1206.0	1206.5	1207.5	1207.5	1207.5	1207.5	1207.5	1207.5	1207.5	1206.0		
DISCH KCFS	20.000	14.0	21.0	29.8	29.8	32.8	34.3	33.8	33.3	33.0	32.6	30.7	18.2	12.5	12.5	12.5	12.5		
POWER																			
AVE POWER MW		49	72	100	100	107	111	109	109	110	110	105	105	64	44	44	44		
PEAK POW MW	114	114	114																

	28FEB16	INI-SUM	15MAR	2016	31MAR	30APR	31MAY	30JUN	31JUL	31AUG	30SEP	31OCT	15NOV	22NOV	2017	30NOV	31DEC	31JAN	28FEB
	VALUES IN 1000 AF EXCEPT AS INDICATED																		
--FORT PECK--																			
NAT INFLOW	7200	227	106	136	560	1145	1830	840	365	290	385	205	96	109	295	260	350		
DEPLETION	503	-29	-13	-17	44	274	552	269	30	-85	-102	-29	-14	-15	-128	-141	-93		
EVAPORATION	458								28	88	110	96	43	20	23	50			
MOD INFLOW	6239	256	119	154	516	871	1278	543	247	265	391	191	89	102	373	401	443		
RELEASE	6378	179	83	107	446	492	655	676	676	505	369	179	83	116	584	646	583		
STOR CHANGE	-140	78	36	46	70	379	623	-134	-430	-239	23	12	-6	-14	-211	-245	-140		
STORAGE	14624.	14701	14737	14784	14854	15233	15856	15722	15293	15053	15076	15088	15094	15080	14869	14624	14484		
ELEV FTMSL	2233.2	2233.6	2233.8	2234.0	2234.3	2236.1	2238.9	2238.3	2236.4	2235.2	2235.4	2235.4	2235.4	2235.4	2234.4	2234.4	2232.5		
DISCH KCFS	10.500	6.0	6.0	6.0	7.5	8.0	11.0	11.0	11.0	8.5	6.0	6.0	6.0	6.0	9.5	10.5	10.5		
POWER																			
AVE POWER MW		82	82	82	102	109	150	150	149	116	82	82	100	130	142	141			
PEAK POW MW		162	162	162	162	164	166	165	164	163	163	163	163	162	162	161			
ENERGY GWH	1050.8	29.4	13.7	17.7	73.7	81.4	107.7	111.7	111.2	83.7	61.2	29.6	13.8	19.2	96.5	105.4	94.9		
--GARRISON--																			
NAT INFLOW	10900	479	223	287	780	1300	3120	2100	580	480	445	180	84	96	180	255	310		
DEPLETION	1065	7	3	4	-9	84	872	705	115	-147	-44	-134	-63	-71	-118	-84	-55		
CHAN STOR	0	45		-15	-5	-30				24	24			-13	-22	-10			
EVAPORATION	534								33	104	129	112	50	23	26	57			
REG INFLOW	15679	696	304	390	1220	1703	2873	2039	1037	1027	770	443	207	244	804	975	948		
RELEASE	15851	506	236	303	1131	1414	1547	1537	1537	1308	1168	565	295	1230	1476	1333			
STOR CHANGE	-172	190	68	87	90	289	1326	501	-500	-282	-398	-123	-57	-51	-426	-501	-385		
STORAGE	17548.	17738	17805	17892	17982	18271	19597	20098	19598	19316	18919	18796	18739	18688	18262	17761	17376		
ELEV FTMSL	1836.9	1837.5	1837.7	1838.0	1838.3	1839.2	1843.3	1844.7	1843.3	1842.4	1841.2	1840.8	1840.6	1840.5	1839.2	1837.5	1836.3		
DISCH KCFS	23.000	17.0	17.0	17.0	19.0	23.0	26.0	25.0	25.0	22.0	19.0	19.0	19.0	18.6	20.0	24.0			
POWER																			
AVE POWER MW		211	212	212	237	287	329	320	320	280	241	240	240	235	252	299	296		
PEAK POW MW		468	469	470	471	474	498	499	498	491	481	480	479	474	468	464			
ENERGY GWH	2417.1	76.0	35.5	45.8	170.6	213.8	236.7	238.2	238.2	201.7	179.5	86.5	40.4	45.1	187.4	222.5	199.2		
--OAHE--																			
NAT INFLOW	2300	259	121	155	405	220	625	170	70	95	45	45	21	24	-15	-10	70		
DEPLETION	747	25	12	15	51	76	160	195	131	31	-13	1	0	1	13	19	30		
CHAN STOR	-4	24		-8	-16	-12		4		12	12			2	-6	-16			
EVAPORATION	496								32	97	119	103	46	22	25	54			
REG INFLOW	16904	764	345	444	1477	1543	2000	1485	1379	1265	1136	563	263	296	1142	1430	1373		
RELEASE	17083	468	306	360	1293	1543	1609	1849	1983	1754	1263	587	309	227	1113	1315	1103		
STOR CHANGE	-179	296	39	83	184	0	391	-365	-604	-489	-127	-24	-46	69	29	116	269		
STORAGE	18466.	18761	18800	18883	19067	19067	19458	19094	18490	18001	17874	17850	17804	17872	17902	18017	18287		
ELEV FTMSL	1606.8	1607.8	1607.9	1608.2	1608.8	1608.8	1610.0	1608.9	1606.9	1605.3	1604.9	1604.8	1604.7	1604.9	1605.4	1606.3			
DISCH KCFS	19.772	15.7	22.1	20.2	21.7	25.1	27.0	30.1	32.2	29.5	20.5	19.7	22.3	14.3	18.1	21.4	19.9		
POWER																			
AVE POWER MW		203	285	262	282	326	352	391	416	377	262	251	283	182	231	273	254		
PEAK POW MW		709	710	711	715	715	721	715	705	696	694	694	693	694	695	697	701		
ENERGY GWH	2661.5	73.2	47.9	56.5	203.0	242.4	253.4	291.0	309.3	271.3	194.9	90.5	47.6	35.0	171.7	202.9	170.9		
--BIG BEND--																			
EVAPORATION	105							6	20	25	22	10	5	5	12				
REG INFLOW	16978	468	306	360	1293	1543	1609	1843	1963	1729	1241	577	305	222	1101	1315	1103		
RELEASE	16978	468	306	360	1293	1543	1609	1843	1963	1729	1241	577	305	222	1101	1315	1103		
STORAGE	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631		
ELEV FTMSL	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0		
DISCH KCFS	19.772	15.7	22.1	20.2	21.7	25.1	27.0	30.0	31.9	29.1	20.2	19.4	21.0	17.9	21.4	19.9			
POWER																			
AVE POWER MW		75	103	95	102	117	127	140	149	138	99	97	110	70	90	105	95		
PEAK POW MW		517	509	509	509	509	509	509	517	538	538	538	538	538	538	538	538		
ENERGY GWH	980.7	26.8	17.4	20.4	73.2	87.4	91.1	104.4	111.1	99.1	73.7	35.1	18.5	13.5	67.0	78.0	64.0		
--FORT RANDALL--																			
NAT INFLOW	900	121	56	73	160	165	135	70	60	35		-5	-2	-3	-10	45			
DEPLETION	80	1	1	1	4	9	12	18	15	7	1	1	0	1	3	3			
EVAPORATION	116							8	25	31	24	9	4	4	9				
REG INFLOW	17682	588	362	432	1449	1699	1732	1887	1982	1725	1216	562	298	215	1089	1302	1145		
RELEASE	17682	307	218	432	1449	1699	1732	1887	1982	1869	1855	875	409	241	980	961	786		
STOR CHANGE	0	281	144	0	0	0	0	0	0	-144	-639	-313	-111	-26	108	341	359		
STORAGE	3000.	3281	3425	3425	3425	3425	3425	3425	3425	3281	2642	2329	2218	2192	2300	2641	3000		
ELEV FTMSL	1350.0	1353.5	1355.2	1355.2	1355.2	1355.2	1355.2	1355.2	1355.2	1355.2	1345.0	1340.0	1338.0	1337.5	1339.5	1345.0	1350.0		
DISCH KCFS	14.261	10.3	15.7	24.2	24.2	24.3	27.6	29.7	30.7	32.2	31.4	30.2	29.4	29.5	15.2	15.6	14.2		
POWER																			
AVE POWER MW		85	132	204	206	233	245	258	271	262	242	222	215	111	117	119	113		
PEAK POW MW		350	356	356	356	356	356	356	356	350	319	296	287	285	294	320	339		
ENERGY GWH	1746.4	30.8	22.3	44.2	148.1	173.3	176.5	192.1	201.7	188.9	179.7	79.9	36.2	21.3	87.2	88.4	75.9		
--GAVINS POINT--																			
NAT INFLOW	1500	102	47	61	145	165	175	100	90	95	1								

	28FEB17	INI-SUM	15MAR	2017	31MAR	30APR	31MAY	30JUN	31JUL	31AUG	30SEP	31OCT	15NOV	22NOV	2018	30NOV	31DEC	31JAN	28FEB
	VALUES IN 1000 AF EXCEPT AS INDICATED																	STUDY NO 10	
--FORT PECK--																			
NAT INFLOW	7200	227	106	136	560	1145	1830	840	365	290	385	205	96	109	295	260	350		
DEPLETION	520	-26	-12	-15	13	285	578	276	33	-86	-104	-30	-14	-16	-129	-141	-93		
EVAPORATION	454							28	88	109	95	43	20	23	49				
MOD INFLOW	6226	253	118	152	547	860	1252	536	244	267	394	192	89	102	375	401	443		
RELEASE	6383	179	83	107	446	523	655	676	676	499	369	179	83	95	584	646	583		
STOR CHANGE	-157	75	35	45	101	337	597	-140	-432	-232	25	13	6	7	-210	-245	-140		
STORAGE	14484.	14559	14593	14638	14739	15076	15674	15533	15101	14869	14895	14908	14914	14921	14711	14467	14326		
ELEV FTMSL	2232.5	2232.9	2233.1	2233.3	2233.8	2235.4	2238.1	2235.7	2235.5	2234.4	2234.5	2234.6	2234.6	2234.6	2233.6	2232.5	2231.8		
DISCH KCFS	10.500	6.0	6.0	6.0	7.5	8.5	11.0	11.0	11.0	8.4	6.0	6.0	6.0	6.0	9.5	10.5	10.5		
POWER																			
AVE POWER MW		82	82	82	102	116	149	150	149	115	82	82	82	82	129	141	141		
PEAK POW MW		161	162	162	162	163	165	165	163	163	163	163	163	163	162	161	161		
ENERGY GWH	1048.7	29.4	13.7	17.6	73.5	86.3	107.3	111.4	110.8	82.5	61.0	29.5	13.8	15.7	96.3	105.1	94.6		
--GARRISON--																			
NAT INFLOW	10900	479	223	287	780	1300	3120	2100	580	480	445	180	84	96	180	255	310		
DEPLETION	1101	2	1	1	-20	88	899	741	121	-150	-48	-138	-64	-73	-119	-85	-55		
CHAN STOR	0	45			-15	-10	-25			25	23				-34	-10			
EVAPORATION	530							33	103	128	111	50	23	26	56				
REG INFLOW	15652	701	306	393	1231	1725	2851	2003	1032	1026	774	446	208	238	792	976	948		
RELEASE	15840	476	222	286	1101	1506	1547	1537	1311	1168	565	264	281	1230	1476	1333			
STOR CHANGE	-188	225	84	108	131	218	1304	466	-505	-285	-394	-119	-55	-43	-500	-385			
STORAGE	17376.	17600	17684	17792	18141	19445	19910	19405	19120	18726	18607	18552	18509	18072	17572	17187			
ELEV FTMSL	1836.3	1837.0	1837.3	1837.7	1838.1	1838.8	1842.8	1844.2	1842.7	1841.8	1840.6	1840.2	1840.1	1839.9	1838.6	1836.9	1835.7		
DISCH KCFS	24.000	16.0	16.0	16.0	18.5	24.5	26.0	25.0	25.0	22.0	19.0	19.0	19.0	17.7	20.0	24.0			
POWER																			
AVE POWER MW		198	199	199	230	305	328	319	319	280	240	240	240	240	251	298	295		
PEAK POW MW		466	467	469	470	473	498	499	495	484	479	478	478	477	472	466	461		
ENERGY GWH	2409.2	71.3	33.4	43.0	165.9	227.2	236.5	237.6	237.5	201.5	178.9	86.5	40.3	42.9	18.7	22.1	19.6	198.4	
--OAHE--																			
NAT INFLOW	2300	259	121	155	405	220	625	170	70	95	45	45	21	24	-15	-10	70		
DEPLETION	760	25	12	15	52	77	163	199	134	32	-13	1	0	0	14	19	30		
CHAN STOR	0	32	0	0	-10	-24	-6	4	12	12	12	12	5	5	-9	-16			
EVAPORATION	491							31	96	118	101	46	21	24	53				
REG INFLOW	16889	742	331	426	1444	1626	2003	1481	1377	1268	1137	564	263	286	1138	1430	1373		
RELEASE	17083	468	306	360	1293	1543	1609	1849	1983	1754	1263	587	309	227	1113	1315	1103		
STOR CHANGE	-194	274	25	65	151	183	394	-368	-606	-486	-126	-23	-46	59	25	116	269		
STORAGE	18287.	18561	18586	18651	18802	18885	19279	18911	18305	17819	17693	17670	17624	17683	17708	17824	18093		
ELEV FTMSL	1606.3	1607.2	1607.2	1607.4	1607.9	1608.2	1609.4	1608.3	1606.3	1604.7	1604.3	1604.2	1604.1	1604.3	1604.3	1604.7	1605.6		
DISCH KCFS	19.868	15.7	22.1	20.2	21.7	25.1	27.0	30.1	32.2	29.5	20.5	19.7	22.3	14.3	18.1	21.4	19.9		
POWER																			
AVE POWER MW		203	284	261	281	325	351	390	414	376	261	250	282	182	230	272	253		
PEAK POW MW		706	706	707	710	711	718	712	702	693	691	690	690	691	691	693	698		
ENERGY GWH	2652.6	73.0	47.8	56.3	202.2	241.5	252.7	290.1	308.3	270.4	194.2	90.2	47.4	34.9	171.1	202.2	170.3		
--BIG BEND--																			
EVAPORATION	105							6	20	25	22	10	5	5	12				
REG INFLOW	16978	468	306	360	1293	1543	1609	1843	1963	1729	1241	577	305	222	1101	1315	1103		
RELEASE	16978	468	306	360	1293	1543	1609	1843	1963	1729	1241	577	305	222	1101	1315	1103		
STORAGE	1631.	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631		
ELEV FTMSL	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0		
DISCH KCFS	19.868	15.7	22.1	20.2	21.7	25.1	27.0	30.0	31.9	29.1	20.2	19.4	21.9	17.9	21.4	19.9	19.9		
POWER																			
AVE POWER MW		75	103	95	102	117	127	140	149	138	99	97	110	70	90	105	95		
PEAK POW MW		517	509	509	509	509	509	509	517	538	538	538	538	538	538	538	538		
ENERGY GWH	980.8	26.8	17.4	20.4	73.2	87.4	91.1	104.4	111.1	99.1	73.7	35.1	18.5	13.5	67.0	78.0	64.0		
--FORT RANDALL--																			
NAT INFLOW	900	121	56	73	160	165	135	70	60	35	-5	-2	-3		-10	45			
DEPLETION	80	1	1	1	4	9	12	18	15	7	1	0	1	3	3				
EVAPORATION	116							8	25	31	24	9	4	4	9				
REG INFLOW	17682	588	362	432	1449	1699	1732	1887	1982	1725	1216	562	298	215	1089	1302	1145		
RELEASE	17682	307	218	432	1449	1699	1732	1887	1982	1869	1855	875	409	241	980	961	786		
STOR CHANGE	0	281	144	0	0	0	0	0	0	-144	-639	-313	-111	-26	108	341	359		
STORAGE	3000.	3281	3425	3425	3425	3425	3425	3425	3425	3281	2642	2329	2218	2192	2300	2641	3000		
ELEV FTMSL	1350.0	1353.5	1355.2	1355.2	1355.2	1355.2	1355.2	1355.2	1355.2	1355.2	1345.0	1340.0	1338.0	1337.5	1339.5	1345.0	1350.0		
DISCH KCFS	14.160	10.3	15.7	24.2	24.3	27.6	29.7	30.7	32.2	31.4	30.2	29.4	29.5	15.2	15.9	15.6	14.2		
POWER																			
AVE POWER MW		86	132	204	206	233	245	258	271	262	242	222	215	111	117	119	113		
PEAK POW MW		350	356	356	356	356	356	356	356	350	319	296	287	285	294	320	339		
ENERGY GWH	1746.4	30.8	22.3	44.2	148.1	173.3	176.5	192.1	201.7	188.9	179.7	79.9	36.2	21.3	87.2	88.4	75.9		
--GAVINS POINT--																			
NAT INFLOW	1500	102	47	61	145	165	175	100	90	95	120	58	27	31	80	85	120		
DEPLETION	114	0	0	5	19	24	39	10	-5	2	5	2	3	10	1	1			

DATE OF STUDY: 17 Nov 2014

2014-2015 AOP MEDIAN RUNOFF

99001 9901 4 PAGE 1

TIME OF STUDY: 15:55:41

STUDY NO 11

28FEB18		2018		VALUES IN 1000 AF EXCEPT AS INDICATED													2019	
INI-SUM	15MAR	22MAR	31MAR	30APR	31MAY	30JUN	31JUL	31AUG	30SEP	31OCT	15NOV	22NOV	30NOV	31DEC	31JAN	28FEB		
--FORT PECK--																		
NAT INFLOW	7200	227	106	136	560	1145	1830	840	365	290	385	205	96	109	295	260	350	
DEPLETION	531	-26	-12	-15	13	286	582	283	38	-87	-106	-31	-14	-16	-129	-142	-93	
EVAPORATION	453							28	87	108	94	43	20	23	49			
MOD INFLOW	6216	253	118	152	547	859	1248	529	240	269	397	193	90	103	375	402	443	
RELEASE	6344	179	83	107	417	553	625	646	646	488	369	179	83	95	646	646	583	
STOR CHANGE	-127	75	35	45	130	306	623	-116	-406	-220	28	14	7	8	-271	-244	-140	
STORAGE	14326.	14401	14436	14481	14611	14917	15540	15423	15018	14798	14825	14839	14846	14854	14583	14339	14199	
ELEV FTMSL	2231.8	2232.1	2232.3	2232.5	2233.1	2234.6	2237.5	2237.0	2235.1	2234.0	2234.2	2234.3	2234.3	2233.0	2231.8	2231.1		
DISCH KCFS	10.500	6.0	6.0	6.0	7.0	9.0	10.5	10.5	10.5	8.2	6.0	6.0	6.0	6.0	10.5	10.5		
POWER																		
AVE POWER MW		81	81	81	95	123	143	143	143	112	82	82	82	82	142	141	141	
PEAK POW MW		161	161	161	162	163	165	164	163	162	162	162	162	162	161	161	160	
ENERGY GWH	1041.3	29.3	13.7	17.6	68.5	91.2	102.8	106.7	106.2	80.7	60.9	29.5	13.8	15.7	105.4	104.9	94.4	
--GARRISON--																		
NAT INFLOW	10900	479	223	287	780	1300	3120	2100	580	480	445	180	84	96	180	255	310	
DEPLETION	1117	2	1	1	-20	88	909	757	126	-153	-53	-141	-66	-75	-120	-85	-55	
CHAN STOR	0	45			-10	-20	-15			22	22				-44			
EVAPORATION	525							32	102	127	110	49	23	26	56			
REG INFLOW	15601	700	306	393	1207	1746	2821	1956	997	1017	779	450	210	240	846	986	948	
RELEASE	15757	476	222	286	1071	1445	1547	1537	1309	1168	565	264	290	1230	1476	1333		
STOR CHANGE	-155	224	84	107	136	301	1274	419	540	-293	-389	-115	-53	-50	-384	-490	-385	
STORAGE	17187.	17412	17495	17603	17738	18039	19312	19731	19191	18999	18509	18395	18341	18291	17907	17417	17032	
ELEV FTMSL	1835.7	1836.4	1836.7	1837.0	1837.5	1838.4	1842.4	1843.7	1842.0	1841.1	1839.9	1839.6	1839.4	1839.2	1838.0	1836.4	1835.1	
DISCH KCFS	24.000	16.0	16.0	16.0	18.0	23.5	26.0	25.0	25.0	22.0	19.0	19.0	19.0	18.3	20.0	24.0	24.0	
POWER																		
AVE POWER MW		197	198	198	223	292	328	319	318	279	240	239	239	230	250	297	294	
PEAK POW MW		464	465	466	468	472	492	499	486	481	477	476	475	475	470	464	459	
ENERGY GWH	2389.5	71.1	33.3	42.9	160.9	217.4	235.9	237.0	236.8	200.6	178.7	86.2	40.1	44.2	186.0	220.9	197.7	
--OAHE--																		
NAT INFLOW	2300	259	121	155	405	220	625	170	70	95	45	45	21	24	-15	-10	70	
DEPLETION	777	26	12	15	52	79	166	204	137	33	-13	1	0	0	14	20	31	
CHAN STOR	0	32	0	0	-8	-22	-10	4		12	12		3	-7	-17			
EVAPORATION	484							31	95	116	100	45	21	24	52			
REG INFLOW	16796	742	331	426	1416	1564	1996	1476	1376	1267	1139	565	264	293	1141	1429	1372	
RELEASE	16957	468	306	360	1293	1543	1609	1849	1983	1754	1263	587	309	227	1069	1272	1065	
STOR CHANGE	-160	274	25	65	123	21	387	-373	-607	-487	-124	-46	66	73	157	307		
STORAGE	18093.	18367	18392	18497	18580	18601	18988	18616	18008	17522	17397	17375	17329	17395	17468	17626	17933	
ELEV FTMSL	1605.6	1606.5	1606.6	1606.8	1607.2	1607.3	1608.5	1607.3	1605.3	1603.7	1603.3	1603.2	1603.0	1603.3	1603.5	1604.1	1605.1	
DISCH KCFS	19.868	15.7	22.1	20.2	21.7	25.1	27.0	30.0	31.9	29.1	20.2	19.4	14.0	17.2	20.7	19.2		
POWER																		
AVE POWER MW		202	283	260	280	323	349	388	412	373	260	249	281	181	220	262	244	
PEAK POW MW		703	703	704	706	707	713	707	509	517	538	538	538	538	538	690	695	
ENERGY GWH	2621.1	72.7	47.6	56.1	201.5	240.5	251.5	288.8	306.7	268.9	193.1	89.7	47.2	34.7	163.5	194.8	163.9	
--BIG BEND--								6	20	25	22	10	5	5	12			
EVAPORATION	105																	
REG INFLOW	16852	468	306	360	1293	1543	1609	1843	1963	1729	1241	577	305	222	1057	1272	1065	
RELEASE	16852	468	306	360	1293	1543	1609	1843	1963	1729	1241	577	305	222	1057	1272	1065	
STORAGE	1631.	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	
ELEV FTMSL	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	
DISCH KCFS	19.868	15.7	22.1	20.2	21.7	25.1	27.0	30.0	31.9	29.1	20.2	19.4	14.0	17.2	20.7	19.2		
POWER																		
AVE POWER MW		75	103	95	102	117	127	140	149	138	97	110	70	87	101	92		
PEAK POW MW		517	509	509	509	509	509	509	509	517	538	538	538	538	538	538	529	
ENERGY GWH	973.3	26.8	17.4	20.4	73.2	87.4	91.1	104.4	111.1	99.1	73.7	35.1	18.5	13.5	64.4	75.5	61.8	
--FORT RANDALL--																		
NAT INFLOW	900	121	56	73	160	165	135	70	60	35	-5	-2	-3	-10	45			
DEPLETION	80	1	1	1	4	9	12	18	15	7	1	0	1	3	3	3	3	
EVAPORATION	116							8	25	31	24	9	4	9				
REG INFLOW	17556	588	362	432	1449	1699	1732	1887	1982	1725	1216	562	298	215	1044	1259	1107	
RELEASE	17556	307	218	432	1449	1699	1732	1887	1982	1869	1855	875	409	241	936	918	748	
STOR CHANGE	0	281	144	0	0	0	0	0	0	-144	-639	-313	-111	-26	108	341	359	
STORAGE	3000.	3281	3425	3425	3425	3425	3425	3425	3425	3281	2642	2329	2218	2192	2300	2641	3000	
ELEV FTMSL	1350.0	1353.5	1355.2	1355.2	1355.2	1355.2	1355.2	1355.2	1355.2	1355.2	1345.0	1340.0	1338.0	1337.5	1339.5	1345.0	1350.0	
DISCH KCFS	14.160	10.3	15.7	24.2	24.3	27.6	29.1	30.7	32.2	31.4	30.2	29.4	29.5	15.2	15.2	14.9	13.5	
POWER																		
AVE POWER MW		86	132	204	206	233	245	258	271	262	242	222	215	111	112	114	107	
PEAK POW MW		350	356	356	356	356	356	356	356	350	319	296	287	285	294	320	339	
ENERGY GWH	1734.9	30.8	22.3	44.2	148.1	173.3	176.5	192.1	201.7	188.9	179.7	79.9	36.2	21.3	83.3	84.5	72.2	
--GAVINS POINT--																		
NAT INFLOW	1500	102	47	61	145	165	175	100	90	95	120	58	27	31	80	85	120	
DEPLETION	114	0	0	0	5	19	24	39	10	-5	2	5	2	3	10	1	3	
CHAN STOR	0	7	-10	-16	0	-6	-3	-3	-2	2	1	0	26	0	0	1	3	
EVAPORATION	34							2	6	8	7	3	2	2	4			
REG INFLOW	18909	417	255	477	1588	1839	1880	1943	2053	1963	1968	925	432	294	1002	1002	870	
RELEASE	18909	417	255	477	1588	1839	1880	1943	2041	1940	1968	925	432	294	1002	1002	905	
STOR CHANGE	327.	327	327	327	327	327	327	327	339	362	362	362	362	362	362	362	327	
STORAGE	327.	327	327	327	327	327	327	327	339	362	362	362	362	362	362	362	327	
ELEV FTMSL	1206.0	1206.0	1206.0	1206.0	1206.0	1206.0	1206.0	1206.0	1206.5	1207.5	1207.5	1207.5	1207.5	1207.5	1207.5	1207.5	1206.0	
DISCH KCFS	17.000	14.0	18.4	26.7	26.7	29.9	31.6	31.6	33.2	32.6	32.0	31.1	18.5	16.3	16.3	16.3	16.3	
POWER																		
AVE POWER MW		49	64	91	91	101	105	105	109	109	108	106	65	58	58	57		
PEAK POW MW		114	114	114	114</td													

	28FEB19	INI-SUM	15MAR	2019	31MAR	30APR	31MAY	30JUN	31JUL	31AUG	30SEP	31OCT	15NOV	22NOV	2020	30NOV	31DEC	31JAN	29FEB
	VALUES IN 1000 AF EXCEPT AS INDICATED																STUDY NO 12		
--FORT PECK--																			
NAT INFLOW	7200	227	106	136	560	1145	1830	840	365	290	385	205	96	109	295	260	350		
DEPLETION	539	-26	-12	-15	13	286	586	291	43	-86	-106	-31	-14	-16	-129	-141	-104		
EVAPORATION	450							28	87	108	94	43	20	23	49				
MOD INFLOW	6211	253	118	152	547	859	1244	521	235	268	397	193	90	103	375	401	454		
RELEASE	6313	179	83	107	417	523	625	646	646	490	369	179	83	103	615	646	604		
STOR CHANGE	-102	75	35	45	130	336	619	-124	-410	-222	28	14	7	0	-240	-245	-150		
STORAGE	14199.	14274	14308	14353	14484	14820	15439	15315	14904	14682	14711	14725	14732	14732	14492	14247	14097		
ELEV FTMSL	2231.1	2231.5	2231.7	2231.9	2232.5	2234.1	2237.0	2236.5	2234.5	2233.5	2233.6	2233.7	2233.7	2233.7	2233.6	2231.4	2230.6		
DISCH KCFS	10.500	6.0	6.0	6.0	7.0	8.5	10.5	10.5	10.5	8.2	6.0	6.0	6.0	6.0	6.5	10.0	10.5	10.5	
POWER																			
AVE POWER MW		81	81	81	95	116	143	143	143	112	82	82	89	136	141	140			
PEAK POW MW		160	161	161	161	162	164	164	163	162	162	162	162	161	160	160			
ENERGY GWH	1035.1	29.2	13.7	17.6	68.4	86.0	102.6	106.5	106.0	80.8	60.8	29.4	13.7	17.0	100.9	104.7	97.6		
--GARRISON--																			
NAT INFLOW	10900	479	223	287	780	1300	3120	2100	580	480	445	180	84	96	180	255	310		
DEPLETION	1130	3	1	2	-20	88	919	773	132	-156	-57	-144	-67	-77	-121	-85	-61		
CHAN STOR	0	45		-10	-15	-20				22	22			-5	-34	-5			
EVAPORATION	520							32	101	126	109	49	23	26	56				
REG INFLOW	15562	700	305	393	1207	1720	2806	1941	992	1023	784	454	212	245	826	981	975		
RELEASE	15686	476	222	286	1101	1505	1547	1537	1270	1076	521	243	278	1230	1476	1381			
STOR CHANGE	-124	224	83	107	106	213	1259	403	-545	-248	-292	-67	-31	-33	-404	-495	-406		
STORAGE	17032.	17256	17339	17446	17552	17765	19024	19427	18883	18635	18343	18276	18245	18213	17809	17314	16908		
ELEV FTMSL	1835.1	1835.9	1836.2	1836.5	1836.9	1837.6	1841.5	1842.7	1841.1	1840.3	1839.4	1839.2	1839.1	1839.0	1837.7	1836.1	1834.7		
DISCH KCFS	24.000	16.0	16.0	16.0	18.5	24.5	26.0	25.0	25.0	21.3	17.5	17.5	17.5	20.0	24.0	24.0	24.0		
POWER																			
AVE POWER MW		197	197	198	229	303	326	317	317	270	221	220	220	220	250	296	294		
PEAK POW MW		462	463	465	466	468	483	495	481	478	475	474	474	474	469	463	458		
ENERGY GWH	2370.5	70.8	33.2	42.7	164.7	225.5	234.7	235.9	235.6	194.3	164.3	79.2	36.9	42.2	185.7	220.5	204.3		
--OAHE--																			
NAT INFLOW	2300	259	121	155	405	220	625	170	70	95	45	45	21	24	-15	-10	70		
DEPLETION	789	26	12	15	53	80	169	208	141	33	-14	1	0	0	14	20	31		
CHAN STOR	0	33	0	0	-10	-24	-6	4	15	16				-10	-17				
EVAPORATION	481							31	94	116	99	45	21	24	52				
REG INFLOW	16717	742	331	426	1443	1622	1997	1473	1372	1232	1052	520	243	278	1139	1429	1420		
RELEASE	16845	470	306	360	1293	1543	1609	1849	1983	1754	1263	587	309	227	1018	1223	1051		
STOR CHANGE	-128	272	25	65	150	180	388	-377	-611	-522	-211	-66	51	120	206	368			
STORAGE	17933.	18205	18230	18295	18445	18525	18913	18536	17926	17403	17192	17125	17059	17110	17230	17437	17805		
ELEV FTMSL	1605.1	1606.0	1606.1	1606.3	1606.8	1607.0	1608.3	1607.1	1605.1	1603.1	1602.6	1602.3	1602.1	1602.3	1603.4	1604.7			
DISCH KCFS	19.168	15.8	22.1	20.2	21.7	25.1	27.0	30.1	32.2	29.5	20.5	19.7	22.3	14.3	16.6	19.9	18.3		
POWER																			
AVE POWER MW		202	282	259	279	323	349	388	412	373	259	248	279	180	208	251	232		
PEAK POW MW		700	700	701	704	705	712	706	695	686	682	681	679	680	682	686	693		
ENERGY GWH	2597.6	72.7	47.5	55.9	200.9	240.0	251.2	288.4	306.3	268.4	192.6	89.3	46.9	34.5	155.1	186.6	161.3		
--BIG BEND--																			
EVAPORATION	105							6	20	25	22	10	5	5	12				
REG INFLOW	16740	470	306	360	1293	1543	1609	1843	1963	1729	1241	577	305	222	1006	1223	1051		
RELEASE	16740	470	306	360	1293	1543	1609	1843	1963	1729	1241	577	305	222	1006	1223	1051		
STORAGE	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631		
ELEV FTMSL	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0		
DISCH KCFS	19.168	15.8	22.1	20.2	21.7	25.1	27.0	30.0	31.9	29.1	20.2	19.4	21.0	16.4	19.9	18.3			
POWER																			
AVE POWER MW		75	103	95	102	117	127	140	149	138	99	97	110	70	82	98	88		
PEAK POW MW		517	509	509	509	509	509	509	517	538	538	538	538	538	538	538	538		
ENERGY GWH	966.7	26.9	17.3	20.4	73.2	87.4	91.1	104.4	111.1	99.1	73.7	35.1	18.5	13.5	61.3	72.6	61.0		
--FORT RANDALL--																			
NAT INFLOW	900	121	56	73	160	165	135	70	60	35		-5	-2	-3		-10	45		
DEPLETION	80	1	1	1	4	9	12	18	15	7	1	1	0	1	3	3	3		
EVAPORATION	116							8	25	31	24	9	4	4	9				
REG INFLOW	17444	589	362	432	1449	1699	1732	1887	1982	1725	1216	562	298	215	994	1210	1093		
RELEASE	17444	308	218	432	1449	1699	1732	1887	1982	1869	1855	875	409	241	885	869	734		
STOR CHANGE	0	281	144	0	0	0	0	0	0	-144	-639	-313	-111	-26	109	341	359		
STORAGE	3000.	3281	3425	3425	3425	3425	3425	3425	3425	3281	2642	2329	2218	2192	2301	2642	3001		
ELEV FTMSL	1350.0	1353.5	1355.2	1355.2	1355.2	1355.2	1355.2	1355.2	1355.2	1355.2	1345.0	1340.0	1338.0	1337.5	1339.5	1345.0	1350.0		
DISCH KCFS	13.460	10.4	15.7	24.2	24.2	24.3	26.7	29.6	30.1	30.2	29.4	29.5	15.2	14.4	14.1	12.8			
POWER																			
AVE POWER MW		86	132	204	206	233	245	258	271	262	242	222	215	111	106	108	102		
PEAK POW MW		350	356	356	356	356	356	356	356	350	319	296	287	285	294	320	339		
ENERGY GWH	1724.8	30.9	22.2	44.2	148.1	173.3	176.5	192.1	201.7	188.9	179.7	79.9	36.2	21.3	78.8	80.0	70.9		
--GAVINS POINT--																			
NAT INFLOW	1500	102	47	61	145	165	175	100	90	95	120	58	27	31	80	85	120		
DEPLETION	114	0	0	5	19	24	39	10	-5	2</									

	28FEB20	INI-SUM	15MAR	2020	31MAR	30APR	31MAY	30JUN	31JUL	31AUG	30SEP	31OCT	15NOV	22NOV	2021	30NOV	31DEC	31JAN	28FEB
VALUES IN 1000 AF EXCEPT AS INDICATED																			
--FORT PECK--																			
NAT INFLOW	7200	227	106	136	560	1145	1830	840	365	290	385	205	96	109	295	260	350		
DEPLETION	555	-25	-12	-15	13	287	590	298	46	-87	-109	-32	-15	-17	-131	-143	-94		
EVAPORATION	447							28	86	107	93	42	20	23	49				
MOD INFLOW	6198	253	118	152	547	858	1240	514	233	270	401	194	91	104	377	403	444		
RELEASE	6267	179	83	107	417	523	625	646	646	496	369	179	83	103	584	646	583		
STOR CHANGE	-70	74	35	44	130	335	615	-131	-413	-227	32	16	7	0	-207	-243	-139		
STORAGE	14097.	14171	14206	14250	14381	14716	15331	15200	14787	14561	14592	14608	14616	14616	14409	14167	14027		
ELEV FTMSL	2230.6	2231.0	2231.2	2231.4	2232.0	2233.7	2236.5	2235.9	2234.0	2232.9	2233.1	2233.1	2233.2	2233.2	2232.2	2231.0	2230.3		
DISCH KCFS	10.500	6.0	6.0	6.0	7.0	8.5	10.5	10.5	10.5	8.3	6.0	6.0	6.0	6.0	9.5	10.5	10.5		
POWER																			
AVE POWER MW		81	81	81	95	115	142	143	142	114	82	82	82	88	129	141	140		
PEAK POW MW		160	160	160	161	162	164	164	162	161	162	162	162	162	161	160	160		
ENERGY GWH	1026.3	29.2	13.6	17.5	68.3	85.9	102.5	106.3	105.8	81.7	60.7	29.4	13.7	17.0	95.9	104.6	94.2		
--GARRISON--																			
NAT INFLOW	10900	479	223	287	780	1300	3120	2100	580	480	445	180	84	96	180	255	310		
DEPLETION	1146	3	2	2	-19	88	930	789	137	-159	-62	-149	-69	-79	-124	-87	-57		
CHAN STOR	0	45			-10	-15	-20			21	23		-5	-30	-10				
EVAPORATION	518							32	101	125	108	48	23	26	55				
REG INFLOW	15504	699	305	392	1206	1720	2795	1925	988	1031	791	459	214	248	803	978	950		
RELEASE	15584	476	222	286	1101	1476	1547	1537	1537	1263	1076	521	243	262	1230	1476	1333		
STOR CHANGE	-81	223	83	107	105	244	1248	388	-549	-231	-285	-62	-29	-14	-427	-498	-383		
STORAGE	16908.	17132	17215	17321	17426	17670	18918	19305	18756	18525	18240	18178	18149	18135	17708	17210	16827		
ELEV FTMSL	1834.7	1835.5	1835.8	1836.1	1836.5	1837.3	1841.2	1842.4	1840.7	1840.0	1839.1	1838.9	1838.8	1838.8	1837.4	1835.7	1834.4		
DISCH KCFS	24.000	16.0	16.0	16.0	18.5	24.0	26.0	25.0	25.0	21.2	17.5	17.5	17.5	16.5	20.0	24.0	24.0		
POWER																			
AVE POWER MW		196	197	197	228	296	325	316	316	268	220	220	219	207	249	296	293		
PEAK POW MW		461	462	463	464	467	482	490	479	477	474	473	473	473	468	462	457		
ENERGY GWH	2350.8	70.6	33.1	42.6	164.3	220.4	234.3	235.4	235.3	192.9	163.9	79.1	36.9	39.7	185.4	220.0	196.9		
--OAHE--																			
NAT INFLOW	2300	259	121	155	405	220	625	170	70	95	45	45	21	24	-15	-10	70		
DEPLETION	802	26	12	16	53	81	172	212	144	34	-14	1	0	0	14	20	31		
CHAN STOR	0	33	0	0	-10	-22	-8	4	16	16	16	16	4	4	-15				
EVAPORATION	477							30	93	115	99	44	21	24	51				
REG INFLOW	16606	742	331	425	1443	1593	1992	1469	1370	1224	1052	521	243	266	1135	1429	1372		
RELEASE	16688	471	306	360	1293	1543	1609	1849	1983	1754	1263	587	309	227	974	1180	981		
STOR CHANGE	-83	271	25	65	150	150	383	-380	-613	-530	-211	-66	39	161	249	391			
STORAGE	17805.	18076	18101	18165	18315	18365	18748	18368	17755	17225	17014	16948	16882	16921	17082	17332	17722		
ELEV FTMSL	1604.7	1605.6	1605.6	1605.9	1606.4	1606.5	1607.8	1606.5	1604.5	1602.7	1602.0	1601.7	1601.5	1601.6	1602.2	1603.0	1604.4		
DISCH KCFS	18.272	15.8	22.0	20.2	21.7	25.1	27.0	30.1	32.2	29.5	20.5	19.7	22.3	14.3	15.8	19.2	17.7		
POWER																			
AVE POWER MW		202	282	258	278	322	348	386	410	372	258	247	278	179	199	241	224		
PEAK POW MW		698	698	699	702	703	709	703	692	682	678	677	676	677	680	684	691		
ENERGY GWH	2566.6	72.8	47.3	55.8	200.5	239.4	250.5	287.5	305.3	267.6	191.9	89.0	46.8	34.4	147.9	179.6	150.4		
--BIG BEND--																			
EVAPORATION	105							6	20	25	22	10	5	5	12				
REG INFLOW	16583	471	306	360	1293	1543	1609	1843	1963	1729	1241	577	305	222	962	1180	981		
RELEASE	16583	471	306	360	1293	1543	1609	1843	1963	1729	1241	577	305	222	962	1180	981		
STORAGE	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631		
ELEV FTMSL	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0		
DISCH KCFS	18.272	15.8	22.0	20.2	21.7	25.1	27.0	30.0	31.9	29.1	20.2	19.4	21.0	15.6	19.2	17.7	17.7		
POWER																			
AVE POWER MW		75	103	95	102	117	127	140	149	138	99	97	110	70	79	94	85		
PEAK POW MW		517	509	509	509	509	509	509	517	538	538	538	538	538	538	538	538		
ENERGY GWH	957.5	27.0	17.3	20.4	73.2	87.4	91.1	104.4	111.1	99.1	73.7	35.1	18.5	13.5	58.7	70.0	57.0		
--FORT RANDALL--																			
NAT INFLOW	900	121	56	73	160	165	135	70	60	35		-5	-2	-3	-10	45			
DEPLETION	80	1	1	1	4	9	12	18	15	7	1	0	1	3	3	3			
EVAPORATION	116							8	25	31	24	9	4	4	9				
REG INFLOW	17288	590	362	432	1449	1699	1732	1887	1982	1725	1216	562	298	215	950	1167	1023		
RELEASE	17288	310	218	432	1449	1699	1732	1887	1982	1869	1855	875	409	241	841	826	664		
STOR CHANGE	0	280	144					0	0	-144	-639	-313	-111	-26	109	341	359		
STORAGE	3001.	3281	3425	3425	3425	3425	3425	3425	3425	3281	2642	2329	2218	2192	2301	2642	3001		
ELEV FTMSL	1350.0	1353.5	1355.2	1355.2	1355.2	1355.2	1355.2	1355.2	1355.2	1345.0	1340.0	1338.0	1337.5	1339.5	1345.0	1350.0	1350.0		
DISCH KCFS	12.761	10.4	15.7	24.2	24.2	24.3	26.7	29.6	30.7	32.2	31.4	30.2	29.4	29.5	15.2	13.7	13.4		
POWER																			
AVE POWER MW		86	132	204	206	233	245	258	271	262	242	222	215	111	101	102	96		
PEAK POW MW		350	356	356	356	356	356	356	356	350	319	296	287	285	294	319	339		
ENERGY GWH	763.1	17.6	10.7	19.7	65.6	74.9	75.3	77.8	80.9	78.3	80.6	38.3	17.9	12.5	39.0	39.0	35.0		
--GAVINS POINT--																			
NAT INFLOW	1500	102	47	61	145	165	175	100	90	95	120	58	27	31	80	85	120		

VALUES IN 1000 AF EXCEPT AS INDICATED															2017			
28FEB16			2016			2015			2014			2013			2012			
INI-SUM	15MAR	22MAR	31MAR	30APR	31MAY	30JUN	31JUL	31AUG	30SEP	31OCT	15NOV	22NOV	30NOV	31DEC	31JAN	28FEB		
--FORT PECK--																		
NAT INFLOW	6100	206	96	123	472	969	1548	661	297	246	329	172	80	91	246	246	318	
DEPLETION	519	0	0	0	5	242	569	283	18	-100	-79	-17	-8	-9	-136	-148	-103	
EVAPORATION	504							32	98	121	105	47	22	25	54			
MOD INFLOW	5077	205	96	123	467	727	979	346	181	225	303	141	66	75	328	394	421	
RELEASE	5965	179	83	107	476	523	565	584	584	464	369	179	83	103	553	584	528	
STOR CHANGE	-888	27	12	16	-9	204	414	-238	-403	-239	-66	-38	-18	-28	-226	-190	-107	
STORAGE	13149.	13175	13188	13204	13195	13399	13813	13575	13172	12933	12867	12829	12811	12783	12558	12386	12261	
ELEV FTMSL	2225.8	2226.0	2226.0	2226.1	2226.1	2227.1	2229.2	2228.0	2226.0	2224.7	2224.3	2224.1	2224.0	2223.9	2222.7	2221.6	2221.0	
DISCH KCFS	11.000	6.0	6.0	6.0	8.0	8.5	9.5	9.5	7.8	6.0	6.0	6.0	6.0	6.5	9.0	9.5	9.5	
POWER																		
AVE POWER MW		80	80	80	106	113	127	127	127	103	79	79	79	86	118	124	124	
PEAK POW MW		156	156	156	156	157	159	158	156	155	155	155	154	154	153	152	151	
ENERGY GWH	956.0	28.7	13.4	17.2	76.6	84.2	91.5	94.7	94.2	74.5	59.1	28.6	13.3	16.5	88.0	92.4	83.2	
--GARRISON--																		
NAT INFLOW	9365	414	193	248	655	1177	2661	1740	486	403	404	164	77	87	154	215	287	
DEPLETION	1165	14	7	8	31	164	832	681	105	-153	-41	-130	-61	-69	-106	-71	-46	
CHAN STOR	15	51		-20	-5	-10				17	18		-5	-25		-5		
EVAPORATION	596							37	116	144	124	56	26	30	64			
REG INFLOW	13583	629	270	347	1080	1531	2384	1606	849	893	708	417	195	225	724	865	861	
RELEASE	14657	476	222	286	1012	1291	1428	1414	1414	1182	1045	506	236	254	1199	1414	1277	
STOR CHANGE	-1074	153	48	61	68	239	956	192	-556	-289	-337	-89	-41	-29	-475	-549	-417	
STORAGE	15762.	15915	15963	16024	16092	16331	17287	17479	16914	16625	16288	16199	16157	16129	15654	15105	14688	
ELEV FTMSL	1830.8	1831.3	1831.5	1831.7	1831.9	1832.7	1836.0	1836.6	1834.7	1833.8	1832.6	1832.3	1832.1	1832.0	1830.4	1828.4	1826.9	
DISCH KCFS	23.000	16.0	16.0	16.0	17.0	21.0	24.0	23.0	23.0	19.9	17.0	17.0	17.0	16.0	19.5	23.0		
POWER																		
AVE POWER MW		191	192	192	204	252	292	283	282	242	206	205	205	192	233	271	268	
PEAK POW MW		445	446	447	448	451	463	465	458	454	450	449	448	442	435	429		
ENERGY GWH	2134.0	68.8	32.2	41.4	146.9	187.7	210.0	210.6	209.8	174.0	153.1	73.7	34.4	37.0	173.2	201.4	179.9	
--OAHE--																		
NAT INFLOW	1445	189	88	113	305	139	337	118	54	58	15	14	6	7	-37	-16	54	
DEPLETION	747	25	12	15	51	76	160	195	131	31	-13	1	0	1	13	19	30	
CHAN STOR	0	30	0	0	-4	-17	-13	4		14	13		5	-16		0		
EVAPORATION	529							34	104	127	110	49	23	26	57			
REG INFLOW	14825	670	299	384	1261	1337	1592	1308	1234	1096	977	469	219	239	1076	1363	1301	
RELEASE	15932	457	329	376	1352	1616	1591	1830	1859	1365	1425	549	206	198	852	1058	868	
STOR CHANGE	-1107	213	-30	8	-91	-278	1	522	-626	-449	-80	13	41	224	305	434		
STORAGE	16624.	16837	16807	16815	16724	16446	16446	15924	15298	15029	14581	14501	14514	14555	14778	15083	15517	
ELEV FTMSL	1600.6	1601.3	1601.2	1601.2	1600.9	1599.9	1599.9	1598.0	1595.7	1594.7	1592.9	1592.6	1592.6	1592.8	1593.7	1594.9	1596.5	
DISCH KCFS	15.623	15.3	23.7	21.1	22.7	26.3	26.7	29.6	29.8	30.2	22.9	23.2	18.5	14.8	12.5	13.9	17.2	
POWER																		
AVE POWER MW		192	296	263	283	326	331	366	367	277	220	177	149	166	207	189		
PEAK POW MW		675	675	675	673	668	668	658	647	642	633	631	632	632	637	643	651	
ENERGY GWH	2353.1	69.0	49.6	56.8	203.9	242.5	238.1	272.1	273.2	199.2	206.4	79.2	29.7	28.6	123.5	154.0	127.3	
--BIG BEND--																		
EVAPORATION	131							8	25	31	28	12	6	7	14			
REG INFLOW	15801	457	329	376	1352	1616	1591	1822	1835	1334	1398	537	200	192	838	1058	868	
RELEASE	15801	457	329	376	1352	1616	1591	1822	1835	1334	1398	537	200	192	838	1058	868	
STORAGE	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	
ELEV FTMSL	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	
DISCH KCFS	15.623	15.3	23.7	21.1	22.7	26.3	26.7	29.6	29.8	29.5	22.4	18.0	14.4	12.1	13.6	17.2	15.6	
POWER																		
AVE POWER MW		73	111	99	106	123	125	139	140	107	111	90	73	61	69	85	75	
PEAK POW MW		517	509	509	509	509	509	509	509	529	538	538	538	538	538	538	538	529
ENERGY GWH	912.5	26.2	18.6	21.3	76.6	91.5	90.1	103.2	103.9	77.3	82.9	32.5	12.2	11.7	51.2	62.9	50.4	
--FORT RANDALL--																		
NAT INFLOW	494	85	40	51	88	71	121	38	27		-22	-8	-4	-4	-11	-22	44	
DEPLETION	80	1	1	1	4	9	12	18	15	7	1	0	1	3	3	3	3	
EVAPORATION	142							10	32	38	29	12	5	5	12			
REG INFLOW	16073	540	368	427	1436	1678	1700	1832	1815	1289	1346	516	191	182	812	1033	909	
RELEASE	16073	260	224	427	1436	1678	1700	1832	1815	1713	1705	770	361	208	703	692	550	
STOR CHANGE	0	280	144	0	0	0	0	0	0	-424	-359	-254	-170	-26	109	341	359	
STORAGE	3001.	3281	3425	3425	3425	3425	3425	3425	3425	3001	2642	2388	2218	2192	2301	2642	3001	
ELEV FTMSL	1350.0	1353.5	1355.2	1355.2	1355.2	1355.2	1355.2	1355.2	1355.2	1350.0	1345.0	1341.0	1338.0	1337.5	1339.5	1345.0	1350.0	
DISCH KCFS	10.025	8.7	16.1	23.9	24.1	27.3	28.6	29.8	29.5	28.8	27.7	25.9	26.0	26.0	11.4	11.3	9.9	
POWER																		
AVE POWER MW		73	136	202	204	230	241	251	249	237	219	197	192	96	84	86	79	
PEAK POW MW		350	356	356	356	356	356	356	356	339	319	301	287	285	294	319	339	
ENERGY GWH	1590.5	26.1	22.9	43.6	146.8	171.1	173.3	186.6	184.9	170.9	163.0	70.8	32.2	18.4	62.8	63.9	53.2	
--GAVINS POINT--																		
NAT INFLOW	1326	94	44	56	128	143	153	87	71	81	106	51	24	27	77	77	107	
DEPLETION	114	0	0	5	19	24	39	10	-5	2	1	5	2	3	10	1	15	
CHAN STOR	-1	2	-14	-15	0	-6	-2	1	1									

DATE OF STUDY: 18Nov2014

2014-2015 AOP LOWER QUARTILE RUNOFF

99001 9901 9901 PAGE 1

TIME OF STUDY: 09:32:39

STUDY NO 15

	28FEB17	INI-SUM	15MAR	2017	31MAR	30APR	31MAY	30JUN	31JUL	31AUG	30SEP	31OCT	15NOV	22NOV	2018	30NOV	31DEC	31JAN	28FEB
--FORT PECK--																			
NAT INFLOW	6174	209	97	125	477	981	1567	669	301	249	331	174	81	93	249	249	322		
DEPLETION	487	-33	-15	-20	21	271	588	265	-3	-126	-110	-31	-14	-16	-103	-114	-73		
EVAPORATION	489							30	94	117	102	46	22	25	53				
MOD INFLOW	5198	242	113	145	456	710	979	374	210	258	339	158	74	84	299	363	395		
RELEASE	5569	179	83	107	417	492	536	553	553	431	338	164	76	95	492	553	500		
STOR CHANGE	-371	63	29	38	39	218	443	-180	-344	-173	1	-5	-2	-11	-193	-190	-105		
STORAGE	12261.	122324	12353	12391	12430	12649	13092	12912	12569	12396	12397	12392	12389	12378	12185	11995	11890		
ELEV FTMSL	2221.0	2221.4	2221.6	2221.8	2222.0	2223.2	2225.5	2224.6	2222.7	2221.8	2221.8	2221.8	2221.8	2221.7	2220.6	2219.6	2219.0		
DISCH KCFS	9.500	6.0	6.0	6.0	7.0	8.0	9.0	9.0	9.0	7.2	5.5	5.5	5.5	6.0	8.0	9.0	9.0		
POWER																			
AVE POWER MW		78	78	78	92	105	119	119	118	95	72	72	72	78	104	117	116		
PEAK POW MW		152	152	152	152	154	156	155	153	152	152	152	152	152	151	150	149		
ENERGY GWH	881.9	28.2	13.2	17.0	65.9	78.0	85.5	88.7	88.1	68.2	53.6	25.9	12.1	15.1	77.5	86.8	78.1		
--GARRISON--																			
NAT INFLOW	9470	418	195	251	662	1190	2691	1760	492	409	409	166	77	88	155	217	290		
DEPLETION	1053	8	4	5	21	150	799	698	111	-156	-45	-140	-65	-74	-120	-85	-58		
CHAN STOR	5	36		-10	-10	-10				18	18		-5	-21	-10				
EVAPORATION	576							35	111	139	120	54	25	29	62				
REG INFLOW	13415	625	275	353	1047	1522	2417	1580	823	875	690	414	193	224	684	845	848		
RELEASE	13865	446	208	268	1012	1445	1339	1322	1322	1085	922	446	208	246	1138	1291	1166		
STOR CHANGE	-450	179	66	85	36	77	1078	258	-499	-211	-233	-32	-15	-22	-453	-446	-318		
STORAGE	14688.	14866	14933	15018	15054	15130	16208	16467	15968	15757	15524	15492	15478	15456	15002	14556	14238		
ELEV FTMSL	1826.9	1827.5	1827.8	1828.1	1828.5	1832.3	1833.2	1831.5	1830.7	1829.9	1829.8	1829.7	1829.7	1828.0	1826.4	1825.2			
DISCH KCFS	23.000	15.0	15.0	15.0	17.0	23.5	22.5	21.5	21.5	18.2	15.0	15.0	15.0	18.5	21.0				
POWER																			
AVE POWER MW		175	175	176	199	275	267	259	258	218	179	178	178	184	218	244	242		
PEAK POW MW		432	432	434	434	435	449	452	446	443	440	440	440	439	433	427	423		
ENERGY GWH	1979.5	63.0	29.5	38.0	143.4	204.4	192.0	192.6	192.1	156.8	132.8	64.1	29.9	35.3	161.9	181.5	162.4		
--OAHE--																			
NAT INFLOW	1494	196	91	117	315	144	349	122	55	61	17	14	7	7	-39	-17	55		
DEPLETION	760	25	12	15	52	77	163	199	134	32	-13	1	0	0	14	19	30		
CHAN STOR	9	36	0	-9	-29	4	4	4	15	15		-2	-14	-12					
EVAPORATION	520							33	101	125	108	48	23	26	56				
REG INFLOW	14088	652	288	370	1266	1483	1529	1217	1142	1004	859	411	192	225	1014	1244	1191		
RELEASE	14553	452	295	330	1205	1463	1442	1698	1727	1239	1102	500	188	123	865	1059	865		
STOR CHANGE	-465	200	-7	40	61	20	87	-482	-585	-235	-243	-88	4	102	149	185	327		
STORAGE	15517.	15717	15710	15750	15811	15832	15919	15437	14852	14617	14374	14286	14290	14391	14540	14725	15052		
ELEV FTMSL	1596.5	1597.3	1597.2	1597.4	1597.6	1597.7	1598.0	1596.2	1594.0	1593.0	1592.1	1591.7	1592.1	1592.7	1593.5	1594.7			
DISCH KCFS	15.624	15.2	21.2	18.5	20.2	23.8	24.2	27.5	27.7	20.8	17.5	16.4	13.1	7.4	13.8	17.2	15.6		
POWER																			
AVE POWER MW		185	259	226	248	291	297	336	338	249	213	199	161	93	168	206	187		
PEAK POW MW		655	654	655	656	657	658	649	638	634	629	627	627	629	632	636	642		
ENERGY GWH	2127.1	66.8	43.5	48.8	178.2	216.4	213.5	250.1	251.5	179.3	158.8	71.7	27.1	17.8	124.7	153.1	125.8		
--BIG BEND--																			
EVAPORATION	131							8	25	31	28	12	6	7	14				
REG INFLOW	14422	452	295	330	1205	1463	1442	1691	1702	1208	1075	487	183	117	851	1059	865		
RELEASE	14422	452	295	330	1205	1463	1442	1691	1702	1208	1075	487	183	117	851	1059	865		
STORAGE	1631.	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631		
ELEV FTMSL	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0		
DISCH KCFS	15.624	15.2	21.2	18.5	20.2	23.8	24.2	27.5	27.7	20.3	17.5	16.4	13.1	7.4	13.8	17.2	15.6		
POWER																			
AVE POWER MW		72	99	87	95	111	113	129	130	97	87	82	66	37	70	85	75		
PEAK POW MW		517	509	509	509	509	509	509	529	538	538	538	538	538	538	538	538		
ENERGY GWH	834.2	25.9	16.7	18.7	68.2	82.9	81.7	95.7	96.4	70.1	64.8	29.7	11.2	7.2	51.9	62.9	50.2		
--FORT RANDALL--																			
NAT INFLOW	517	89	42	53	92	75	126	40	29		-24	-9	-4	-5	-11	-23	46		
DEPLETION	80	1	1	1	4	9	12	18	15	7	1	0	1	3	3	3			
EVAPORATION	139							10	32	38	28	11	4	5	12				
REG INFLOW	14720	540	335	383	1293	1529	1556	1703	1685	1163	1021	467	174	107	824	1033	908		
RELEASE	14720	259	191	383	1293	1529	1556	1703	1685	1587	1574	707	191	107	715	692	549		
STOR CHANGE	0	280	144	0	0	0	0	0	0	-424	-552	-240	-17	0	109	341	359		
STORAGE	3001.	3281	3425	3425	3425	3425	3425	3425	3425	3001	2449	2209	2192	2192	2301	2642	3001		
ELEV FTMSL	1350.0	1353.5	1355.2	1355.2	1355.2	1355.2	1355.2	1355.2	1355.2	1350.0	1342.0	1337.8	1337.5	1337.5	1339.5	1345.0	1350.0		
DISCH KCFS	9.898	8.7	13.8	21.4	21.7	24.9	26.2	27.7	28.4	26.7	27.2	25.3	13.7	6.8	11.6	11.3	9.9		
POWER																			
AVE POWER MW		72	116	181	184	210	221	233	231	220	200	176	100	50	86	86	79		
PEAK POW MW		350	356	356	356	356	356	356	356	339	305	286	285	285	294	319	339		
ENERGY GWH	1455.5	26.1	19.6	39.2	132.3	156.2	158.9	173.7	171.9	158.5	148.7	63.3	16.9	9.5	63.8	63.9	53.1		
--GAVINS POINT--																			
NAT INFLOW	1338	95	44	5															

DATE OF STUDY: 18Nov2014

2014-2015 AOP LOWER QUARTILE RUNOFF

99001 9901 9901 PAGE 1

TIME OF STUDY: 09:32:39

STUDY NO 16

	28FEB18	INI-SUM	15MAR	2018	31MAR	30APR	31MAY	30JUN	31JUL	31AUG	30SEP	31OCT	15NOV	22NOV	2019	30NOV	31DEC	31JAN	28FEB
--FORT PECK--																			
NAT INFLOW	6560	222	103	133	507	1042	1665	711	320	264	353	184	86	98	265	265	342		
DEPLETION	531	-16	-8	-10	21	272	592	272	1	-127	-112	-31	-14	-17	-104	-115	-73		
EVAPORATION	488							30	94	117	102	46	22	25	53				
MOD INFLOW	5541	238	111	143	486	770	1073	409	225	274	363	169	79	90	316	380	415		
RELEASE	5511	149	69	89	417	492	536	553	553	441	307	149	69	79	553	553	500		
STOR CHANGE	30	89	42	54	69	278	537	-144	-328	-167	56	20	9	11	-238	-173	-85		
STORAGE	11890.	11979	12021	12074	12144	12422	12959	12815	12487	12320	12376	12396	12405	12416	12178	12005	11920		
ELEV FTMSL	2219.0	2219.5	2219.7	2220.0	2220.4	2221.9	2224.8	2224.1	2222.3	2221.4	2221.7	2221.8	2221.9	2220.6	2219.6	2219.2			
DISCH KCFS	9.000	5.0	5.0	5.0	7.0	8.0	9.0	9.0	9.0	7.4	5.0	5.0	5.0	5.0	9.0	9.0	9.0		
POWER																			
AVE POWER MW		65	65	65	91	104	118	119	118	97	65	65	66	117	117	116			
PEAK POW MW		150	150	150	151	152	155	154	153	152	152	152	152	151	150	149			
ENERGY GWH	870.5	23.3	10.9	14.0	65.4	77.5	85.2	88.4	88.0	69.8	48.7	23.6	11.0	12.6	87.2	86.8	78.1		
--GARRISON--																			
NAT INFLOW	10016	442	206	265	701	1259	2846	1861	520	432	432	175	82	93	164	230	307		
DEPLETION	1116	2	1	1	11	194	836	714	116	-159	-50	-143	-67	-76	-121	-85	-59		
CHAN STOR	0	42	0	0	-21	-10	-10			16	25		0	0	-41				
EVAPORATION	576							35	111	139	120	54	25	29	62				
REG INFLOW	13835	631	275	353	1086	1547	2535	1665	846	909	694	413	193	220	735	868	866		
RELEASE	13799	446	208	268	1012	1383	1309	1291	1291	1089	953	461	215	246	1168	1291	1166		
STOR CHANGE	36	184	66	85	74	163	1226	374	-445	-179	-259	-49	-23	-26	-433	-423	-300		
STORAGE	14238.	14422	14488	14574	14648	14811	16037	16411	15966	15786	15527	15478	15456	15430	14997	14574	14274		
ELEV FTMSL	1825.2	1825.9	1826.1	1826.4	1826.7	1827.3	1831.7	1833.0	1831.5	1830.8	1829.9	1829.7	1829.6	1828.0	1826.4	1825.3			
DISCH KCFS	21.000	15.0	15.0	15.0	17.0	22.5	22.0	21.0	21.0	18.3	15.5	15.5	15.5	19.0	21.0				
POWER																			
AVE POWER MW		173	174	174	197	261	259	252	252	218	184	184	184	184	223	244	242		
PEAK POW MW		426	426	428	429	431	447	452	446	444	440	440	439	439	428	428	423		
ENERGY GWH	1963.9	62.3	29.1	37.5	141.9	194.1	186.7	187.7	187.7	157.3	137.2	66.2	30.9	35.2	166.1	181.5	162.5		
--OAHE--																			
NAT INFLOW	1767	231	108	139	373	170	412	144	65	72	21	17	8	9	-46	-20	65		
DEPLETION	777	26	12	15	52	79	166	204	137	33	-13	1	0	0	14	20	31		
CHAN STOR	0	27	0	-9	-24	2	4	4	12	13					-16	-9			
EVAPORATION	516							32	100	124	107	48	23	26	56				
REG INFLOW	14273	679	304	391	1324	1450	1557	1203	1119	1017	893	429	200	229	1036	1242	1200		
RELEASE	14236	426	282	315	1176	1438	1402	1678	1710	1229	1096	486	89	137	863	1061	849		
STOR CHANGE	37	254	22	77	148	12	155	-475	-591	-213	-203	-57	111	91	173	181	152		
STORAGE	15052.	15305	15327	15404	15552	15564	15719	15244	14653	14441	14238	14180	14292	14383	14556	14737	15089		
ELEV FTMSL	1594.7	1595.7	1595.8	1596.1	1596.7	1597.3	1595.5	1595.3	1593.2	1592.3	1591.5	1591.3	1591.7	1592.1	1592.8	1593.5	1594.9		
DISCH KCFS	15.569	14.3	20.3	17.6	19.8	23.4	23.6	27.2	27.8	20.7	17.8	16.3	6.4	8.6	14.0	17.3	15.3		
POWER																			
AVE POWER MW		173	246	214	240	284	287	331	333	246	212	193	76	103	167	206	184		
PEAK POW MW		647	647	649	652	652	655	646	634	630	626	625	627	629	632	636	643		
ENERGY GWH	2073.0	62.3	41.4	46.2	172.9	211.5	206.6	246.1	248.0	177.1	157.4	69.6	12.8	19.8	124.4	153.4	123.5		
--BIG BEND--																			
EVAPORATION	131							8	25	31	28	12	6	7	14				
REG INFLOW	14105	426	282	315	1176	1438	1402	1670	1685	1198	1068	474	83	131	848	1061	849		
RELEASE	14105	426	282	315	1176	1438	1402	1670	1685	1198	1068	474	83	131	848	1061	849		
STORAGE	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631		
ELEV FTMSL	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0		
DISCH KCFS	15.569	14.3	20.3	17.6	19.8	23.4	23.6	27.2	27.8	20.1	17.4	15.9	6.0	8.2	13.8	17.3	15.3		
POWER																			
AVE POWER MW		68	95	82	93	109	110	127	128	97	87	80	30	42	70	85	73		
PEAK POW MW		517	509	509	509	509	509	509	509	529	538	538	538	538	538	538	538		
ENERGY GWH	815.7	24.4	16.0	17.8	66.6	81.4	79.4	94.6	95.4	69.5	64.4	28.9	5.1	8.0	51.8	63.1	49.3		
--FORT RANDALL--																			
NAT INFLOW	645	111	52	66	115	93	158	50	36	-29	-11	-5	-6	-14	-29	57			
DEPLETION	80	1	1	1	4	9	12	18	15	7	1	0	1	3	3	3			
EVAPORATION	139							10	32	38	28	11	5	5	12				
REG INFLOW	14531	535	333	380	1287	1522	1548	1692	1675	1153	1010	451	74	119	819	1029	903		
RELEASE	14531	255	189	380	1287	1522	1548	1692	1675	1577	1562	682	100	119	710	688	544		
STOR CHANGE	0	280	144	0	-15	-1	-6	-2	0	0	-424	-552	-231	-26	0	109	341	359	
STORAGE	3001.	3281	3425	3425	3425	3425	3425	3425	3425	3001	2449	2218	2192	2192	2301	2642	3001		
ELEV FTMSL	1350.0	1353.5	1355.2	1355.2	1355.2	1355.2	1355.2	1355.2	1355.2	1350.0	1342.0	1338.0	1337.5	1337.5	1339.5	1345.0	1350.0		
DISCH KCFS	9.879	8.6	13.6	21.3	21.6	26.0	27.5	27.2	26.5	25.4	22.9	7.2	11.5	11.5	12.5	12.5	12.5		
POWER																			
AVE POWER MW		71	115	180	183	209	220	232	230	219	198	170	53	55	85	85	78		
PEAK POW MW		350	356	356	356	356	356	356	356	339	305	287	285	285	294	319	339		
ENERGY GWH	1438.0	25.6	19.4	38.9	131.7	155.5	158.1	172.6	170.9	157.6	147.6	61.2	8.9	10.6	63.3	63.5	52.6		
--GAVINS POINT--																			

TIME OF STUDY: 09:32:39

STUDY NO 17

	28FEB19	INI-SUM	15MAR	2019	31MAR	30APR	31MAY	30JUN	31JUL	31AUG	30SEP	31OCT	15NOV	22NOV	2020	30NOV	31DEC	31JAN	29FEB
--FORT PECK--																			
NAT INFLOW	6794	229	107	138	525	1079	1724	736	331	275	365	192	89	102	274	274	354		
DEPLETION	541	-16	-8	-10	21	273	596	280	6	-126	-112	-31	-14	-17	-104	-114	-83		
EVAPORATION	492							30	94	118	103	47	22	25	54				
MOD INFLOW	5761	246	115	147	504	806	1128	426	231	283	374	176	82	94	324	388	437		
RELEASE	5556	164	76	98	417	492	536	553	431	338	164	76	95	492	553	518			
STOR CHANGE	205	82	38	49	87	314	592	-128	-323	-147	36	12	6	-1	-168	-165	-81		
STORAGE	11920.	12002	12040	12090	12177	12491	13084	12956	12633	12486	12522	12535	12540	12539	12371	12206	12125		
ELEV FTMSL	2219.2	2219.6	2219.8	2220.1	2220.6	2222.3	2225.5	2224.8	2223.1	2222.3	2222.5	2222.6	2222.6	2221.7	2220.7	2220.3			
DISCH KCFS	9.000	5.5	5.5	5.5	7.0	8.0	9.0	9.0	9.0	7.2	5.5	5.5	6.0	8.0	9.0	9.0			
POWER																			
AVE POWER MW		71	71	71	91	104	119	119	95	72	72	79	105	117	117				
PEAK POW MW		150	150	150	151	153	156	155	153	153	153	153	153	152	151	151			
ENERGY GWH	880.3	25.6	12.0	15.4	65.5	77.6	85.4	88.7	88.2	68.4	53.7	26.0	12.1	15.1	77.9	87.2	81.3		
--GARRISON--																			
NAT INFLOW	10343	457	213	274	723	1300	2939	1922	537	447	446	181	84	97	170	237	316		
DEPLETION	1125	3	1	2	28	188	840	724	116	-168	-61	-145	-67	-77	-118	-81	-60		
CHAN STOR	0	37			-16	-10	-10			18	18		-5	-20	-10				
EVAPORATION	580							36	112	140	121	55	25	29	63				
REG INFLOW	14194	654	288	370	1096	1594	2624	1716	862	924	742	435	203	235	697	861	894		
RELEASE	13946	446	208	268	952	1383	1369	1353	1353	1125	953	461	215	254	1107	1291	1208		
STOR CHANGE	247	208	80	103	144	210	1256	363	-491	-201	-211	-27	-12	-19	-410	-430	-314		
STORAGE	14274.	14482	14562	14664	14808	15018	16274	16637	16147	15945	15734	15707	15695	15676	15266	14836	14521		
ELEV FTMSL	1825.3	1826.1	1826.4	1826.8	1827.3	1828.1	1832.5	1833.8	1832.1	1831.4	1830.7	1830.6	1830.5	1830.5	1829.0	1827.4	1826.2		
DISCH KCFS	21.000	15.0	15.0	15.0	16.0	22.5	23.0	22.0	22.0	18.9	15.5	15.5	15.5	16.0	18.0	21.0			
POWER																			
AVE POWER MW		173	174	174	186	262	272	266	265	226	185	185	185	190	213	246	243		
PEAK POW MW		426	427	429	431	434	450	455	448	446	443	443	442	437	431	427			
ENERGY GWH	1994.7	62.3	29.2	37.6	134.1	194.9	196.1	197.6	197.3	163.1	137.8	66.5	31.0	36.6	158.4	182.7	169.4		
--OAHE--																			
NAT INFLOW	1949	255	119	153	412	188	455	159	72	79	22	18	8	10	-51	-22	72		
DEPLETION	789	26	12	15	53	80	169	208	141	33	-14	1	0	0	20	31			
CHAN STOR	0	27	0	-4	-29	-2	4		14	16		-2	-9	-14					
EVAPORATION	525							33	102	126	109	49	23	26	57				
REG INFLOW	14581	703	315	405	1307	1463	1652	1275	1182	1059	895	430	201	235	975	1236	1249		
RELEASE	14326	408	274	304	1158	1421	1377	1682	1715	1239	1171	532	137	118	865	1063	863		
STOR CHANGE	255	295	41	101	149	42	275	-407	-534	-180	-275	-102	63	117	111	173	386		
STORAGE	15089.	15384	15425	15526	15675	15717	15992	15585	15051	14871	14596	14494	14557	14675	14785	14958	15344		
ELEV FTMSL	1594.9	1596.0	1596.2	1596.6	1597.1	1597.3	1598.3	1596.8	1594.9	1594.0	1592.9	1592.5	1592.8	1593.3	1593.7	1594.4	1595.9		
DISCH KCFS	15.280	13.7	19.8	17.0	19.5	23.1	23.1	27.2	27.5	20.8	19.0	17.4	9.9	7.4	14.1	17.3	15.0		
POWER																			
AVE POWER MW		166	240	207	237	282	283	334	337	250	228	213	118	89	169	208	181		
PEAK POW MW		648	649	651	654	655	660	652	642	639	631	631	632	635	640	648			
ENERGY GWH	2097.3	59.9	40.3	44.8	170.7	209.6	203.9	248.3	250.7	180.2	169.5	76.7	19.8	17.0	125.4	154.4	126.2		
--BIG BEND--																			
EVAPORATION	131							8	25	31	28	12	6	7	14				
REG INFLOW	14195	408	274	304	1158	1421	1377	1674	1691	1208	1143	519	131	111	850	1063	863		
RELEASE	14195	408	274	304	1158	1421	1377	1674	1691	1208	1143	519	131	111	850	1063	863		
STORAGE	1631.	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631		
ELEV FTMSL	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0		
DISCH KCFS	15.280	13.7	19.8	17.0	19.5	23.1	23.1	27.2	27.5	20.3	18.6	17.4	9.5	7.0	13.8	17.3	15.0		
POWER																			
AVE POWER MW		65	92	80	91	108	108	127	129	97	92	88	48	35	70	85	72		
PEAK POW MW		517	509	509	509	509	509	509	529	538	538	538	538	538	538	538	529		
ENERGY GWH	821.0	23.4	15.5	17.2	65.6	80.5	78.0	94.8	95.7	70.1	68.5	31.6	8.0	6.8	51.9	63.2	50.1		
--FORT RANDALL--																			
NAT INFLOW	731	126	59	75	130	106	179	57	41	-1	-33	-12	-6	-6	-16	-33	65		
DEPLETION	80	1	1	1	4	9	12	18	15	7	1	0	1	3	3	3	3		
EVAPORATION	140							10	32	38	28	11	5	5	12				
REG INFLOW	14705	533	332	379	1284	1518	1544	1703	1685	1162	1081	495	121	99	819	1027	925		
RELEASE	14705	252	188	379	1284	1518	1544	1703	1685	1162	1081	495	121	99	710	686	566		
STOR CHANGE	0	280	144	0	0	0	0	0	0	-424	-490	-211	-108	0	109	341	359		
STORAGE	3001.	3281	3425	3425	3425	3425	3425	3425	3425	3001	2511	2300	2192	2192	2301	2642	3001		
ELEV FTMSL	1350.0	1353.5	1355.2	1355.2	1355.2	1355.2	1355.2	1355.2	1355.2	1350.0	1343.0	1339.5	1337.5	1337.5	1339.5	1345.0	1350.0		
DISCH KCFS	9.789	8.5	13.6	21.2	21.6	24.7	26.0	27.7	27.4	26.7	25.5	23.7	16.5	11.5	11.2	9.8			
POWER																			
AVE POWER MW		70	115	179	182	208	219	233	231	220	200	178	121	46	85	79			
PEAK POW MW		350	356	356	356	356	356	356	356	339	310	294	285	285	294	319	339		
ENERGY GWH	1455.2	25.4	19.2	38.8	131.4	155.1	157.7	173.7	171.9	158.4	149.0	64.0	20.3	8.8	63.4	63.3	54.7		
--GAVINS POINT--																			
NAT INFLOW	1440	102	47	61	138	155	166	94	78	89	117	56	26	30	83	83	116		
DEPLETION	114	0	0	5	19	24	39	10	-5	2	1	5	2	3	10	1	1		
CHAN STOR	-1	3	-10	-15	-1	-6	-2	-3	1	1									

DATE OF STUDY: 18Nov2014

2014-2015 AOP LOWER QUARTILE RUNOFF

99001 9901 9901 PAGE 1

TIME OF STUDY: 09:32:39

STUDY NO 18

	28FEB20	INI-SUM	15MAR	2020	31MAR	30APR	31MAY	30JUN	31JUL	31AUG	30SEP	31OCT	15NOV	22NOV	2021	30NOV	31DEC	31JAN	28FEB
--FORT PECK--																			
NAT INFLOW	7156	242	113	145	553	1137	1816	776	349	289	384	201	94	107	289	289	373	373	
DEPLETION	554	-16	-8	-10	21	274	600	286	9	-127	-115	-33	-15	-17	-105	-116	-74	-74	
EVAPORATION	503							31	97	120	105	48	22	25	55				
MOD INFLOW	6099	258	120	155	532	863	1216	459	243	296	394	186	87	99	339	405	447		
RELEASE	5699	179	83	107	417	523	536	553	553	446	369	179	83	95	523	553	500		
STOR CHANGE	401	79	37	48	115	340	680	-94	-310	-151	25	7	3	4	-183	-148	-53		
STORAGE	12125.	12205	12242	12289	12405	12745	13426	13331	13021	12871	12896	12903	12907	12911	12727	12579	12526		
ELEV FTMSL	2220.3	2220.7	2220.9	2221.2	2221.8	2223.7	2227.3	2226.8	2225.2	2224.4	2224.5	2224.5	2224.5	2224.6	2223.6	2222.8	2222.5		
DISCH KCFS	9.000	6.0	6.0	6.0	7.0	8.5	9.0	9.0	9.0	7.5	6.0	6.0	6.0	6.0	8.5	9.0	9.0		
POWER																			
AVE POWER MW		78	78	78	91	111	119	120	120	99	79	79	79	79	112	118	118		
PEAK POW MW		151	151	152	152	154	157	157	156	155	155	155	155	155	154	153	153		
ENERGY GWH	909.4	28.1	13.1	16.9	65.8	82.9	85.9	89.2	88.9	71.5	59.1	28.6	13.3	15.3	83.4	88.0	79.3		
--GARRISON--																			
NAT INFLOW	10840	479	223	287	758	1362	3080	2014	563	468	468	190	88	101	178	249	332		
DEPLETION	1148	5	2	3	17	193	859	740	121	-171	-65	-149	-69	-79	-121	-83	-56		
CHAN STOR	0	31			-10	-15	-5			15	15				-25		-5		
EVAPORATION	595							36	115	143	124	56	26	30	64				
REG INFLOW	14796	683	304	391	1147	1676	2751	1791	880	957	793	461	215	246	732	880	888		
RELEASE	14313	461	215	277	1012	1291	1398	1383	1383	1155	984	476	222	254	1168	1383	1250		
STOR CHANGE	483	222	89	114	136	385	1353	407	-503	-197	-191	-15	-7	-8	-436	-503	-362		
STORAGE	14521.	14743	14832	14946	15082	15467	16820	17227	16724	16527	16336	16321	16313	16305	15869	15366	15004		
ELEV FTMSL	1826.2	1827.1	1827.4	1827.8	1828.3	1829.7	1834.4	1834.1	1833.4	1834.1	1832.8	1832.7	1832.7	1832.7	1831.1	1829.3	1828.0		
DISCH KCFS	21.000	15.5	15.5	15.5	17.0	21.0	23.5	22.5	22.5	19.4	16.0	16.0	16.0	16.0	19.0	22.5	22.5		
POWER																			
AVE POWER MW		180	181	181	199	247	281	275	275	235	194	193	193	193	228	266	264		
PEAK POW MW		430	431	433	434	440	457	462	456	453	451	451	450	450	445	438	433		
ENERGY GWH	2070.5	64.8	30.4	39.1	143.3	183.7	202.6	204.5	204.3	169.5	144.1	69.6	32.5	37.1	169.5	198.2	177.2		
--OAHE--																			
NAT INFLOW	2260	296	138	177	477	218	527	184	84	92	25	21	10	11	-59	-25	84		
DEPLETION	802	26	12	16	53	81	172	212	144	34	-14	1	0	0	14	20	31		
CHAN STOR	-6	25			-7	-17	-11	4		14	15		0	0	-14	-16			
EVAPORATION	538							34	106	129	111	50	23	27	58				
REG INFLOW	15227	755	341	438	1429	1411	1743	1325	1218	1097	927	447	209	238	1024	1323	1303		
RELEASE	14729	378	261	286	1125	1394	1335	1762	1798	1606	1118	534	199	194	853	1066	820		
STOR CHANGE	498	377	80	152	304	17	407	-437	-580	-509	-191	9	44	44	171	256	483		
STORAGE	15344.	15721	15802	15954	16258	16275	16682	16245	15665	15156	14966	14878	14888	14932	15103	15359	15842		
ELEV FTMSL	1595.9	1597.3	1597.6	1598.2	1599.3	1599.3	1600.8	1599.2	1597.1	1595.1	1594.4	1594.1	1594.1	1594.9	1594.9	1595.9	1597.7		
DISCH KCFS	14.996	12.7	18.8	16.0	18.9	22.7	22.4	28.5	28.8	26.5	17.7	17.5	13.9	12.2	13.9	17.3	14.8		
POWER																			
AVE POWER MW		155	229	197	233	280	278	354	358	327	219	216	173	147	167	210	180		
PEAK POW MW		655	656	659	664	665	672	664	654	644	640	639	639	640	643	648	657		
ENERGY GWH	2177.5	55.8	38.6	42.5	167.6	208.1	200.3	263.6	266.1	235.2	163.0	77.7	29.0	28.2	124.5	156.1	121.0		
--BIG BEND--																			
EVAPORATION	131							8	25	31	28	12	6	7	14				
REG INFLOW	14598	378	261	286	1125	1394	1335	1754	1773	1574	1090	522	193	187	839	1066	820		
RELEASE	14598	378	261	286	1125	1394	1335	1754	1773	1574	1090	522	193	187	839	1066	820		
STORAGE	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631		
ELEV FTMSL	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0		
DISCH KCFS	14.996	12.7	18.8	16.0	18.9	22.7	22.4	28.5	28.8	26.5	17.7	17.5	13.9	12.2	13.9	17.3	14.8		
POWER																			
AVE POWER MW		60	88	75	88	106	105	134	135	125	87	88	70	60	69	85	71		
PEAK POW MW		517	509	509	509	509	509	509	509	517	538	538	538	538	538	538	538	529	
ENERGY GWH	842.9	21.7	14.8	16.2	63.7	79.0	75.6	99.4	100.4	90.3	64.8	31.6	11.8	11.5	51.2	63.4	47.6		
--FORT RANDALL--																			
NAT INFLOW	880	151	71	91	157	127	215	68	49		-39	-15	-7	-8	-20	-39	78		
DEPLETION	80	1	1	1	4	9	12	18	15	7	1	0	1	3		3			
EVAPORATION	145							10	32	39	31	12	5	5	12				
REG INFLOW	15253	528	330	376	1278	1512	1538	1794	1775	1528	1020	495	181	174	804	1024	895		
RELEASE	15253	248	186	376	1278	1512	1538	1794	1775	1672	1659	749	351	200	695	683	536		
STOR CHANGE	0	280	144	0	0	0	0	0	0	-144	-639	-254	-170	-26	109	341	359		
STORAGE	3001.	3281	3425	3425	3425	3425	3425	3425	3425	3281	2642	2388	2218	2192	2301	2642	3001		
ELEV FTMSL	1350.0	1353.5	1355.2	1355.2	1355.2	1355.2	1355.2	1355.2	1355.2	1355.2	1345.0	1341.0	1338.0	1337.5	1339.5	1345.0	1350.0		
DISCH KCFS	9.832	8.3	13.4	21.1	21.5	24.6	25.9	29.2	28.9	28.1	27.0	25.2	25.3	25.3	12.6	11.3	11.1		
POWER																			
AVE POWER MW		69	113	178	182	208	218	246	243	235	216	191	186	92	83	85	77		
PEAK POW MW		350	356	356	356	356	356	356	356	350	319	301	287	285	294	319	339	339	
ENERGY GWH	1513.9	24.9	19.1	38.5	130.8	154.5	157.1	182.9	180.9	169.3	161.1	68.9	31.3	17.7	62.0	63.			

	28FEB16	INI-SUM	15MAR	2016	31MAR	30APR	31MAY	30JUN	31JUL	31AUG	30SEP	31OCT	15NOV	22NOV	2017	30NOV	31DEC	31JAN	28FEB
	VALUES IN 1000 AF EXCEPT AS INDICATED																STUDY NO 19		
--FORT PECK--																			
NAT INFLOW	5518	202	94	121	458	885	1228	619	271	240	323	151	70	81	229	239	307		
DEPLETION	703	-8	-4	-5	51	302	602	281	32	-105	-94	-24	-11	-13	-107	-115	-79		
EVAPORATION	479							30	92	115	100	45	21	24	52				
MOD INFLOW	4336	210	98	126	407	583	626	308	147	230	317	130	61	69	284	354	386		
RELEASE	5545	164	76	98	417	461	536	553	447	369	179	83	95	461	553	500			
STOR CHANGE	-1209	46	22	28	-10	122	90	-245	-407	-217	-52	-49	-23	-26	-177	-199	-114		
STORAGE	12502.	12548	12570	12598	12588	12710	12800	12555	12148	11932	11880	11831	11808	11783	11606	11406	11292		
ELEV FTMSL	2222.4	2222.6	2222.7	2222.9	2222.8	2223.5	2224.0	2222.7	2220.4	2219.2	2218.9	2218.7	2218.5	2218.4	2217.4	2216.3	2215.6		
DISCH KCFS	11.500	5.5	5.5	5.5	7.0	7.5	9.0	9.0	9.0	7.5	6.0	6.0	6.0	7.5	9.0	9.0	9.0		
POWER																			
AVE POWER MW		72	72	72	92	99	119	118	117	97	78	77	77	96	115	114			
PEAK POW MW		153	153	153	153	154	154	153	151	150	149	149	149	148	146	145			
ENERGY GWH	871.5	26.0	12.1	15.6	66.2	73.4	85.3	88.0	87.3	70.0	57.7	27.9	13.0	14.9	71.7	85.5	76.9		
--GARRISON--																			
NAT INFLOW	7937	410	191	246	622	1180	2322	1003	349	230	413	161	75	86	150	209	290		
DEPLETION	1250	25	12	15	47	129	830	679	116	-142	-23	-125	-58	-67	-93	-59	-36		
CHAN STOR	26	62		-15	-5	-15					15	16			-16	-16			
EVAPORATION	561								35	109	135	117	53	24	28	60			
REG INFLOW	11696	610	256	329	976	1507	2012	842	677	699	704	412	192	220	629	806	826		
RELEASE	13160	446	208	268	952	1168	1250	1230	1230	1044	922	446	208	251	1138	1261	1139		
STOR CHANGE	-1463	164	48	61	24	339	763	-387	-553	-345	-219	-34	-16	-31	-509	-455	-313		
STORAGE	14978.	15142	15189	15251	15275	15613	16376	15988	15436	15091	14872	14838	14822	14791	14282	13827	13514		
ELEV FTMSL	1827.9	1828.5	1828.7	1828.9	1829.0	1830.2	1832.9	1831.6	1829.6	1828.3	1827.5	1827.4	1827.4	1827.2	1825.3	1823.6	1822.4		
DISCH KCFS	22.000	15.0	15.0	15.0	16.0	19.0	21.0	20.0	20.0	17.5	15.0	15.0	15.0	15.8	20.5				
POWER																			
AVE POWER MW		176	177	177	189	225	251	240	238	207	176	175	175	184	214	234	232		
PEAK POW MW		435	436	437	437	442	451	446	439	435	432	431	431	424	417	413			
ENERGY GWH	1866.4	63.4	29.7	38.2	135.8	167.0	180.7	178.7	176.8	148.7	130.8	63.1	29.4	35.4	159.2	174.0	155.6		
--OAHE--																			
NAT INFLOW	1213	179	83	107	211	116	322	111	42	47	5	8	4	4	-47	-21	42		
DEPLETION	747	25	12	15	51	76	160	195	131	31	-13	1	0	1	13	19	30		
CHAN STOR	6	31		0	-4	-13	-9	4		12	12			-4	-13	-9			
EVAPORATION	504							32	98	121	105	47	22	25	55				
REG INFLOW	13128	631	280	360	1108	1195	1403	1118	1043	950	848	406	190	225	1010	1211	1151		
RELEASE	14636	481	308	347	1209	1494	1481	1711	1744	1243	1075	492	85	142	867	1067	891		
STOR CHANGE	-1508	150	-28	13	-101	-299	-78	-592	-701	-293	-227	-86	104	83	143	144	260		
STORAGE	15814.	15964	15936	15949	15847	15548	15471	14878	14177	13884	13657	13571	13676	13759	13901	14046	14305		
ELEV FTMSL	1597.6	1598.2	1598.1	1598.1	1597.8	1596.6	1596.3	1594.1	1591.3	1590.1	1589.1	1588.8	1589.6	1589.2	1590.2	1591.8	1591.8		
DISCH KCFS	15.797	16.2	22.2	19.4	20.3	24.3	24.9	27.8	28.4	20.9	17.5	16.5	6.2	9.0	14.1	17.4	16.0		
POWER																			
AVE POWER MW		198	272	239	249	296	302	335	337	246	205	193	72	105	166	204	190		
PEAK POW MW		659	659	659	657	651	650	639	625	619	614	613	615	617	619	622	628		
ENERGY GWH	2119.4	71.4	45.6	51.5	179.3	220.4	217.5	249.3	250.6	177.0	152.3	69.5	12.1	20.2	123.3	152.0	127.5		
--BIG BEND--																			
EVAPORATION	131							8	25	31	28	12	6	7	14				
REG INFLOW	14505	481	308	347	1209	1494	1481	1703	1719	1211	1047	479	80	135	853	1067	891		
RELEASE	14505	481	308	347	1209	1494	1481	1703	1719	1211	1047	479	80	135	853	1067	891		
STORAGE	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631		
ELEV FTMSL	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0		
DISCH KCFS	15.797	16.2	22.2	19.4	20.3	24.3	24.9	27.7	28.0	20.4	17.0	16.1	5.7	8.5	13.9	17.4	16.0		
POWER																			
AVE POWER MW		77	104	91	95	114	116	130	131	98	85	81	29	43	70	85	77		
PEAK POW MW		517	509	509	509	509	509	509	529	538	538	538	538	538	538	538	538		
ENERGY GWH	838.7	27.6	17.4	19.7	68.5	84.6	83.9	96.4	97.4	70.3	63.3	29.2	4.9	8.3	52.1	63.5	51.7		
--FORT RANDALL--																			
NAT INFLOW	380	74	34	44	92	54	103	27	16	-5	-27	-11	-5	-6	-22	-27	38		
DEPLETION	80	1	1	1	4	9	12	18	15	7	1	1	0	1	3	3	3		
EVAPORATION	139							10	32	38	28	10	4	5	12				
REG INFLOW	14666	553	341	390	1297	1539	1572	1702	1689	1162	991	457	71	124	816	1037	926		
RELEASE	14666	272	197	390	1297	1539	1572	1702	1689	1586	1572	668	88	124	719	697	554		
STOR CHANGE	0	280	144	0	0	0	0	0	0	-424	-581	-211	-17	0	97	340	372		
STORAGE	3001.	3281	3425	3425	3425	3425	3425	3425	3425	3001	2420	2209	2192	2192	2289	2629	3001		
ELEV FTMSL	1350.0	1353.5	1355.2	1355.2	1355.2	1355.2	1355.2	1355.2	1355.2	1350.0	1341.5	1337.8	1337.5	1337.5	1339.3	1344.8	1350.0		
DISCH KCFS	10.112	9.2	14.2	21.9	21.8	23.8	23.8	26.8	28.3	28.3	27.5	27.1	24.0	9.8	9.0	12.5	12.5		
POWER																			
AVE POWER MW		76	120	185	184	211	223	233	232	220	199	166	46	57	86	86	80		
PEAK POW MW		350	356	356	356	356	356	356	356	339	303	286	285	285	293	319	339		
ENERGY GWH	1450.8	27.4	20.2	39.9	132.7	157.2	160.4	173.6	172.3	158.4	148.2	59.8	7.8	11.0	64.0	64.2	53.5		
--GAVINS POINT--																			
NAT INFLOW	1236	82	38	49	124	134	139	82	62	77	103	49	23	26	72	72	103		
DEPLETION	114	0	0	5	19	24	39	10	-5	2	5	2	3	10	1	1	1		
CHAN STOR	-1	2	-10	-15	0	-6	-3	-2	0	2									

DATE OF STUDY: 18Nov2014

2014-2015 AOP LOWER DECILE RUNOFF

99001 9901 9901 PAGE 1

TIME OF STUDY: 10:06:34

STUDY NO 20

	VALUES IN 1000 AF EXCEPT AS INDICATED																	
	28FEB17			2017			2018			2018			2018			2018		
	INI-SUM	15MAR	22MAR	31MAR	30APR	31MAY	30JUN	31JUL	31AUG	30SEP	31OCT	15NOV	22NOV	30NOV	31DEC	31JAN	28FEB	
--FORT PECK--																		
NAT INFLOW	5601	205	95	123	465	898	1247	629	275	243	328	153	71	82	232	243	312	
DEPLETION	523	-21	-10	-12	41	277	533	279	27	-112	-99	-34	-16	-18	-117	-124	-71	
EVAPORATION	454							28	88	109	95	43	20	23	49			
MOD INFLOW	4624	226	105	135	424	621	714	322	160	246	332	144	67	77	300	367	383	
RELEASE	5436	149	69	89	417	492	536	553	553	447	307	149	69	90	461	553	500	
STOR CHANGE	-812	77	36	46	7	129	178	-232	-393	-201	25	-5	-2	-14	-162	-186	-117	
STORAGE	11292.	11369	11405	11451	11458	11588	11766	11534	11141	10941	10966	10961	10959	10945	10784	10597	10481	
ELEV FTMSL	2215.6	2216.0	2216.3	2216.5	2216.6	2217.3	2218.3	2217.0	2214.7	2213.5	2213.7	2213.7	2213.6	2212.6	2211.5	2210.8		
DISCH KCFS	9.000	5.0	5.0	5.0	7.0	8.0	9.0	9.0	9.0	7.5	5.0	5.0	5.7	7.5	9.0	9.0		
POWER																		
AVE POWER MW		64	64	64	89	102	115	115	114	95	63	63	72	94	112	112		
PEAK POW MW		146	146	147	147	147	149	147	144	143	143	143	143	142	141	140		
ENERGY GWH	832.9	22.9	10.7	13.8	64.4	76.1	83.1	85.8	85.1	68.2	46.9	22.7	10.6	13.8	70.1	83.5	75.1	
--GARRISON--																		
NAT INFLOW	8154	422	197	253	639	1212	2386	1030	358	236	424	166	77	88	154	215	298	
DEPLETION	1110	14	7	8	31	198	799	667	109	-157	-52	-137	-64	-73	-112	-76	-52	
CHAN STOR	0	42	0	0	-21	-11	-11			16	26	0	-7	-19	-16			
EVAPORATION	526							33	102	127	110	50	23	26	57			
REG INFLOW	11953	599	260	334	1004	1495	2112	884	701	729	700	402	187	218	651	828	850	
RELEASE	12935	387	180	232	1071	1476	1309	1168	1168	963	830	402	187	230	1107	1168	1055	
STOR CHANGE	-982	212	79	102	-68	20	803	-285	-468	-234	-130	0	-12	-455	-340	-205		
STORAGE	13514.	13726	13805	13907	13839	13859	14662	14377	13910	13675	13545	13545	13533	13078	12738	12533		
ELEV FTMSL	1822.4	1823.2	1823.5	1823.9	1823.7	1823.7	1826.8	1825.7	1823.9	1823.0	1822.5	1822.5	1822.5	1820.7	1819.3	1818.4		
DISCH KCFS	20.500	13.0	13.0	13.0	18.0	24.0	22.0	19.0	19.0	16.2	13.5	13.5	14.5	18.0	19.0	19.0		
POWER																		
AVE POWER MW		147	148	148	205	272	252	220	217	184	153	153	153	164	202	210	209	
PEAK POW MW		416	417	418	417	418	429	425	418	415	413	413	413	406	406	401	398	
ENERGY GWH	1771.4	53.1	24.9	32.0	147.4	202.3	181.5	163.3	161.8	132.5	113.8	55.0	25.6	31.5	150.0	156.5	140.3	
--OAHE--																		
NAT INFLOW	1239	182	85	109	215	118	329	113	44	49	5	8	4	4	-48	-22	43	
DEPLETION	760	25	12	15	52	77	163	199	134	32	-13	1	0	14	19	30		
CHAN STOR	7	35	0	0	-23	-28	9	14	14	14	13	-5	-17	-5				
EVAPORATION	480							30	93	114	99	45	21	24	53			
REG INFLOW	12941	579	254	326	1211	1489	1484	1066	986	880	762	364	170	205	975	1122	1068	
RELEASE	13952	477	306	345	1205	1491	1475	1709	1743	1021	863	232	124	139	866	1067	889	
STOR CHANGE	-1011	102	-52	-18	6	-2	10	-643	-758	-141	-101	132	46	66	108	155	180	
STORAGE	14305.	14407	14355	14337	14342	14340	14350	13707	12949	12808	12708	12840	12886	12951	13060	13115	13295	
ELEV FTMSL	1591.8	1592.2	1592.0	1591.9	1591.9	1592.0	1592.0	1589.4	1586.2	1585.6	1585.1	1585.7	1585.9	1586.2	1586.6	1586.9	1587.6	
DISCH KCFS	16.038	16.0	22.1	19.3	20.3	24.3	24.8	27.7	27.9	17.2	14.0	7.8	8.9	8.4	14.1	17.4	16.0	
POWER																		
AVE POWER MW		191	262	229	240	287	293	326	327	197	161	89	103	101	162	200	185	
PEAK POW MW		630	629	628	628	628	628	615	599	596	593	596	597	599	601	603	607	
ENERGY GWH	1969.8	68.6	43.9	49.5	172.9	213.6	211.2	242.7	243.5	141.6	119.5	32.2	17.3	19.4	120.7	148.8	124.3	
--BIG BEND--																		
EVAPORATION	131							8	25	31	28	12	6	7	14			
REG INFLOW	13821	477	306	345	1205	1491	1475	1701	1718	989	835	220	118	133	852	1067	889	
RELEASE	13821	477	306	345	1205	1491	1475	1701	1718	989	835	220	118	133	852	1067	889	
STORAGE	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	
ELEV FTMSL	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	
DISCH KCFS	16.038	16.0	22.1	19.3	20.3	24.3	24.8	27.7	27.9	16.6	13.6	7.4	8.5	8.4	13.9	17.4	16.0	
POWER																		
AVE POWER MW		76	103	90	95	114	116	129	131	81	69	37	43	42	70	85	77	
PEAK POW MW		517	509	509	509	509	509	509	509	538	538	538	538	538	538	538	538	529
ENERGY GWH	799.5	27.4	17.3	19.5	68.3	84.5	83.5	96.3	97.3	58.4	51.0	13.5	7.3	8.1	52.0	63.5	51.6	
--FORT RANDALL--																		
NAT INFLOW	393	76	35	46	95	56	107	28	17	-6	-28	-11	-5	-6	-22	-28	39	
DEPLETION	80	1	1	1	4	9	12	18	15	7	1	1	0	1	3	3	3	
EVAPORATION	134							10	32	36	25	10	4	5	12			
REG INFLOW	13999	552	341	389	1296	1538	1570	1701	1689	940	780	199	108	121	815	1036	925	
RELEASE	13999	272	197	389	1296	1538	1570	1701	1689	1585	1369	199	108	121	718	696	553	
STOR CHANGE	0	280	144	0	0	0	0	0	0	-645	-588	0	0	0	97	340	372	
STORAGE	3001.	3281	3425	3425	3425	3425	3425	3425	3425	2780	2192	2192	2192	2192	2289	2629	3001	
ELEV FTMSL	1350.0	1353.5	1355.2	1355.2	1355.2	1355.2	1355.2	1355.2	1355.2	1347.0	1337.5	1337.5	1337.5	1337.5	1337.5	1339.3	1344.8	1350.0
DISCH KCFS	9.970	9.1	14.2	21.8	21.8	28.6	28.3	28.3	28.3	27.5	26.6	6.7	7.8	7.6	11.7	11.3	10.0	
POWER																		
AVE POWER MW		76	120	184	184	211	223	233	232	217	168	49	57	56	86	86	80	
PEAK POW MW		350	356	356	356	356	356	356	356	328	284	285	285	285	293	319	339	
ENERGY GWH	1384.2	27.3	20.1	39.9	132.7	157.1	160.2	173.5	172.3	156.3	125.3	17.6	9.6	10.7	64.0	64.1	53.4	
--GAVINS POINT--																		
NAT INFLOW	1249	83	39	50	125	135	141	83	62	78	104	50	23	26	73	73	104	
DEPLETION	114	0	0	5	19	24	39	10	-5	2	5	2	3	10	1	1	3	
CHAN STOR	-1	2	-10	-15	0	-6	-3	-2	0	2	8	29						

	28FEB18	INI-SUM	15MAR	2018	31MAR	30APR	31MAY	30JUN	31JUL	31AUG	30SEP	31OCT	15NOV	22NOV	2019	30NOV	31DEC	31JAN	28FEB
VALUES IN 1000 AF EXCEPT AS INDICATED																			
--FORT PECK--																			
NAT INFLOW	5800	212	99	127	482	930	1291	651	285	251	339	159	74	85	241	252	323		
DEPLETION	530	-18	-8	-11	32	274	549	286	31	-114	-102	-36	-17	-19	-119	-126	-73		
EVAPORATION	436							27	84	104	91	41	19	22	47				
MOD INFLOW	4834	230	107	138	450	656	742	338	170	261	350	153	71	82	313	378	396		
RELEASE	5371	149	69	89	387	492	536	553	447	307	149	69	83	492	523	472			
STOR CHANGE	-537	81	38	49	63	164	206	-215	-384	-187	43	4	-1	-179	-145	-76			
STORAGE	10481.	10562	10600	10648	10711	10875	11082	10866	10483	10296	10339	10343	10345	10344	10164	10020	9944		
ELEV FTMSL	2210.8	2211.3	2211.5	2211.8	2212.2	2213.2	2214.4	2213.1	2210.8	2209.7	2209.9	2210.0	2210.0	2208.9	2208.0	2207.5			
DISCH KCFS	9.000	5.0	5.0	5.0	6.5	8.0	9.0	9.0	7.5	5.0	5.0	5.0	5.2	8.0	8.5	8.5			
POWER																			
AVE POWER MW		62	62	62	81	100	113	113	112	93	62	62	64	99	104	104			
PEAK POW MW		141	141	141	142	143	144	143	140	139	139	139	139	138	137	136			
ENERGY GWH	807.5	22.4	10.5	13.5	58.5	74.5	81.5	84.2	83.5	67.0	46.1	22.3	10.4	12.4	73.3	77.5	69.8		
--GARRISON--																			
NAT INFLOW	8704	450	210	270	682	1294	2546	1100	382	253	453	177	82	94	165	229	318		
DEPLETION	1064	6	3	4	28	205	816	678	105	-168	-59	-145	-67	-77	-121	-84	-60		
CHAN STOR	6	43	0	0	-16	-16	-11			16	27	0	-2	-30	-5				
EVAPORATION	514							32	100	123	107	48	23	26	55				
REG INFLOW	12502	635	276	355	1025	1565	2255	943	731	761	739	422	197	226	693	830	850		
RELEASE	13152	417	194	250	1012	1168	1309	1291	1291	1043	861	417	194	227	1138	1230	1111		
STOR CHANGE	-650	219	82	105	13	397	946	-348	-560	-283	-121	5	2	-1	-445	-399	-261		
STORAGE	12533.	12751	12833	12938	12951	13348	14294	13946	13385	13103	12981	12986	12989	12988	12543	12143	11883		
ELEV FTMSL	1818.4	1819.3	1819.7	1820.1	1820.2	1821.7	1825.4	1824.1	1821.9	1820.8	1820.3	1820.3	1820.3	1818.5	1816.8	1815.7			
DISCH KCFS	19.000	14.0	14.0	14.0	17.0	19.0	22.0	21.0	21.0	17.5	14.0	14.0	14.3	18.5	20.0	20.0			
POWER																			
AVE POWER MW		154	155	155	189	212	249	240	237	196	156	156	156	159	204	218	216		
PEAK POW MW		402	403	404	405	410	424	419	411	407	405	405	405	398	392	388			
ENERGY GWH	1772.0	55.6	26.0	33.6	135.9	157.4	179.4	178.5	176.4	141.2	116.2	56.1	26.2	30.6	151.8	162.0	144.9		
--OAHE--																			
NAT INFLOW	1301	192	89	115	226	124	345	119	45	52	6	9	4	5	-51	-23	45		
DEPLETION	777	26	12	15	52	79	166	204	137	33	-13	1	0	14	20	31			
CHAN STOR	-4	24		-14	-10	-15		5	18	18			-2	-21	-8	0			
EVAPORATION	454							29	87	108	94	43	20	23	50				
REG INFLOW	13218	607	272	349	1171	1204	1473	1183	1112	972	804	382	178	207	1001	1179	1125		
RELEASE	13889	469	302	340	1194	1482	1464	1705	1740	949	932	232	124	139	866	1067	883		
STOR CHANGE	-671	138	30	9	-23	-278	10	-522	-628	23	-128	149	54	67	135	112	242		
STORAGE	13295.	13432	13402	13411	13389	13110	13120	12598	11970	11992	11864	12014	12067	12135	12269	12382	12624		
ELEV FTMSL	1587.6	1588.2	1588.1	1588.1	1588.0	1586.9	1586.9	1584.6	1581.9	1582.0	1581.4	1582.1	1582.3	1582.6	1583.2	1583.7	1584.8		
DISCH KCFS	16.002	15.8	21.8	19.0	20.1	24.1	24.6	27.6	27.9	15.4	14.7	8.5	8.4	13.9	17.4	15.9			
POWER																			
AVE POWER MW		183	252	221	233	278	283	316	318	179	170	88	101	99	159	196	181		
PEAK POW MW		610	609	609	609	603	603	591	576	577	574	577	579	580	583	586	592		
ENERGY GWH	1914.2	65.9	42.4	47.8	167.6	207.0	203.7	235.4	236.7	128.7	126.2	31.6	16.9	19.0	118.2	145.9	121.3		
--BIG BEND--																			
EVAPORATION	131							8	25	31	28	12	6	7	14				
REG INFLOW	13758	469	302	340	1194	1482	1464	1697	1715	918	904	220	118	133	852	1067	883		
RELEASE	13758	469	302	340	1194	1482	1464	1697	1715	918	904	220	118	133	852	1067	883		
STORAGE	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631		
ELEV FTMSL	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0		
DISCH KCFS	16.002	15.8	21.8	19.0	20.1	24.1	24.6	27.6	27.9	15.4	14.7	8.5	8.4	13.9	17.4	15.9			
POWER																			
AVE POWER MW		75	102	89	94	113	115	129	131	76	74	38	43	42	70	85	76		
PEAK POW MW		517	509	509	509	509	509	509	538	538	538	538	538	538	538	538	529		
ENERGY GWH	796.2	26.9	17.1	19.3	67.6	83.9	82.9	96.1	97.1	54.4	55.2	13.5	7.3	8.2	52.0	63.5	51.2		
--FORT RANDALL--																			
NAT INFLOW	424	82	38	49	103	61	115	30	18	-7	-30	-12	-6	-6	-24	-30	42		
DEPLETION	80	1	1	1	4	9	12	18	15	7	1	0	1	3	3	3			
EVAPORATION	133							10	32	36	25	10	4	5	12				
REG INFLOW	13969	550	340	389	1293	1534	1567	1699	1687	868	848	198	108	121	813	1034	922		
RELEASE	13969	270	196	389	1293	1534	1567	1699	1687	1583	1367	198	108	121	716	694	550		
STOR CHANGE	0	280	144	342	3425	3425	3425	3425	3425	3425	2710	2192	2192	2192	2289	2629	3001		
STORAGE	3001.	3281	3425	3425	3425	3425	3425	3425	3425	3425	2710	2192	2192	2192	2289	2629	3001		
ELEV FTMSL	1350.0	1353.5	1355.2	1355.2	1355.2	1355.2	1355.2	1355.2	1355.2	1355.2	1346.0	1337.5	1337.5	1337.5	1337.5	1339.3	1344.8		
DISCH KCFS	9.952	9.1	14.1	21.8	21.7	21.1	24.9	26.3	27.6	27.4	26.6	22.2	7.8	7.6	11.6	11.3	9.9		
POWER																			
AVE POWER MW		75	119	184	184	211	222	233	231	216	167	49	57	56	86	86	79		
PEAK POW MW		350	356	356	356	356	356	356	324	284	285	285	285	293	319	339	339		
ENERGY GWH	1380.1	27.1	20.0	39.8	132.3	156.7	159.9	173.3	172.1	155.5	124.6	17.6	9.6	10.7	63.8	64.0	53.2		
--GAVINS POINT--																			
NAT INFLOW	1279	85	40	51	128	139	144	85	64	80	106	50	23	27	75	75	107		
DEPLETION	114	0	0	5	19	24	39	10	-5	2	5	2	3	10	1	1			
CHAN STOR	-1	2	-10	-15	0	-6	-3	-2	0	2	8	29	-2	0	-7	1	3		
EVAPORATION	42							2	8	10	9	4	2	5					
REG INFLOW	15091	357	226	425	1416	1648	1684	1740	1734	1659	1470	268	125	143	769	769	659		
RELEASE	15091	357	226	425	1416	1648	1684	1740	1732	1636	14								

	28FEB19	INI-SUM	15MAR	2019	31MAR	30APR	31MAY	30JUN	31JUL	31AUG	30SEP	31OCT	15NOV	22NOV	2020	30NOV	31DEC	31JAN	29FEB
--FORT PECK--																			
NAT INFLOW	5950	217	101	130	494	954	1325	668	292	258	348	163	76	87	247	258	331		
DEPLETION	540	-18	-8	-11	32	275	554	293	36	-114	-104	-35	-16	-19	-120	-126	-79		
EVAPORATION	426							26	82	102	89	40	19	21	46				
MOD INFLOW	4984	235	110	141	462	679	771	349	174	270	363	158	74	84	321	384	410		
RELEASE	5344	149	69	89	417	461	506	553	553	437	307	149	69	79	492	523	489		
STOR CHANGE	-359	86	40	52	45	218	265	-205	-379	-167	56	5	4	5	-171	-139	-79		
STORAGE	9944.	10030	10070	10122	10168	10385	10651	10446	10067	9899	9955	9964	9969	9973	9802	9663	9585		
ELEV FTMSL	2207.5	2208.0	2208.3	2208.6	2208.9	2210.2	2211.8	2210.6	2208.2	2207.2	2207.5	2207.6	2207.6	2207.7	2206.6	2205.7	2205.2		
DISCH KCFS	8.500	5.0	5.0	5.0	7.0	7.5	8.5	9.0	9.0	7.3	5.0	5.0	5.0	5.0	8.0	8.5	8.5		
POWER																			
AVE POWER MW		61	61	61	86	93	106	112	111	90	61	61	61	61	97	103	103		
PEAK POW MW		137	137	138	138	139	141	140	137	136	136	136	136	136	134	134	134		
ENERGY GWH	793.0	22.1	10.3	13.3	62.0	68.8	76.0	83.2	82.5	64.7	45.5	22.0	10.3	11.8	72.5	76.6	71.4		
--GARRISON--																			
NAT INFLOW	9150	473	221	284	717	1360	2677	1156	402	266	476	186	87	99	173	241	334		
DEPLETION	1130	3	1	2	43	220	837	703	120	-162	-64	-149	-69	-79	-123	-86	-67		
CHAN STOR	0	38	0	0	-22	-5	-11	-5	18	25	0	0	0	0	-32	-5			
EVAPORATION	500							31	97	120	104	47	22	25	54				
REG INFLOW	12864	657	289	371	1069	1596	2335	970	739	763	769	436	203	232	702	844	890		
RELEASE	13298	417	194	250	1071	1476	1250	1230	1230	1014	861	417	194	238	1138	1199	1122		
STOR CHANGE	-434	240	94	121	-2	120	1085	-260	-491	-250	-92	19	9	-6	-436	-355	-232		
STORAGE	11883.	12123	12217	12338	12336	12456	13542	13282	12791	12540	12446	12467	12476	12471	12035	11680	11449		
ELEV FTMSL	1815.7	1816.7	1817.1	1817.6	1817.6	1818.1	1822.5	1821.5	1819.5	1818.5	1818.1	1818.2	1818.2	1818.2	1818.4	1819.9	1813.9		
DISCH KCFS	20.000	14.0	14.0	14.0	18.0	24.0	21.0	20.0	20.0	17.0	14.0	14.0	15.0	18.5	19.5	19.5			
POWER																			
AVE POWER MW		152	152	153	196	261	233	224	222	188	154	154	154	165	201	209	207		
PEAK POW MW		392	394	395	395	397	413	409	402	398	397	397	397	397	391	385	382		
ENERGY GWH	1760.3	54.6	25.6	33.0	141.3	194.3	167.6	166.9	165.5	135.0	114.4	55.3	25.8	31.6	149.6	155.7	144.4		
--OAHE--																			
NAT INFLOW	1350	199	93	119	235	129	358	123	47	52	6	9	4	5	-53	-23	47		
DEPLETION	789	26	12	15	53	80	169	208	141	33	-14	1	0	0	14	20	31		
CHAN STOR	3	30	-20	-30	-30	15	5	5	15	16	16	1	-5	-18	-5				
EVAPORATION	441							28	85	105	91	41	19	22	49				
REG INFLOW	13421	620	275	354	1233	1495	1453	1122	1051	943	805	384	179	215	1004	1151	1138		
RELEASE	13869	463	301	336	1186	1477	1455	1701	1738	947	931	232	124	139	867	1068	904		
STOR CHANGE	-447	157	-26	18	47	-18	-1	-579	-688	-4	-125	152	55	76	136	83	234		
STORAGE	12624.	12781	12755	12773	12820	12838	12837	12258	11570	11566	11441	11593	11647	11723	11859	11942	12176		
ELEV FTMSL	1584.8	1585.4	1585.3	1585.4	1585.6	1585.7	1585.7	1583.1	1580.0	1580.0	1579.4	1580.1	1580.4	1580.7	1581.3	1582.8			
DISCH KCFS	15.893	15.5	21.7	18.8	19.9	24.0	24.4	27.5	27.9	28.3	15.9	15.1	7.8	8.9	14.1	17.4	15.7		
POWER																			
AVE POWER MW		178	247	215	228	274	279	313	315	176	167	86	99	98	157	194	176		
PEAK POW MW		595	595	595	596	596	596	583	566	566	563	567	568	570	574	576	581		
ENERGY GWH	1890.3	63.9	41.6	46.5	164.0	204.1	201.0	233.0	234.1	126.9	124.5	31.1	16.7	18.8	117.1	144.4	122.8		
--BIG BEND--																			
EVAPORATION	131							8	25	31	28	12	6	7	14				
REG INFLOW	13737	463	301	336	1186	1477	1455	1693	1713	916	903	219	118	133	853	1068	904		
RELEASE	13737	463	301	336	1186	1477	1455	1693	1713	916	903	219	118	133	853	1068	904		
STORAGE	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631		
ELEV FTMSL	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0		
DISCH KCFS	15.893	15.5	21.7	18.8	19.9	24.0	24.4	27.5	27.9	28.3	15.4	14.7	8.5	8.4	13.9	17.4	15.7		
POWER																			
AVE POWER MW		74	101	88	93	112	114	129	130	75	74	37	43	42	70	85	75		
PEAK POW MW		517	509	509	509	509	509	509	509	538	538	538	538	538	538	538	538		
ENERGY GWH	795.1	26.5	17.0	19.0	67.2	83.7	82.4	95.9	97.0	54.3	55.1	13.5	7.3	8.1	52.1	63.5	52.5		
--FORT RANDALL--																			
NAT INFLOW	450	87	41	52	109	64	122	32	19	-6	-31	-13	-6	-7	-26	-32	45		
DEPLETION	80	1	1	1	4	9	12	18	15	7	1	1	0	1	3	3			
EVAPORATION	133							10	32	36	25	10	4	5	12				
REG INFLOW	13974	548	341	387	1291	1532	1565	1697	1686	867	846	197	107	120	812	1033	946		
RELEASE	13974	268	197	387	1291	1532	1565	1697	1686	1582	1364	197	107	120	715	693	574		
STOR CHANGE	0	280	144	0	0	0	0	0	0	-715	-518	0	0	0	97	340	372		
STORAGE	3001.	3281	3425	3425	3425	3425	3425	3425	3425	2710	2192	2192	2192	2192	2289	2629	3001		
ELEV FTMSL	1350.0	1353.5	1355.2	1355.2	1355.2	1355.2	1355.2	1355.2	1355.2	1346.0	1337.5	1337.5	1337.5	1337.5	1339.3	1344.8	1350.0		
DISCH KCFS	9.897	9.0	14.2	21.7	21.7	24.9	26.3	27.6	27.4	26.6	22.2	7.7	7.6	11.6	11.3	10.0			
POWER																			
AVE POWER MW		75	120	184	184	210	222	233	231	216	167	49	57	55	86	86	80		
PEAK POW MW		350	356	356	356	356	356	356	356	324	284	285	285	285	293	319	339		
ENERGY GWH	1380.6	26.9	20.1	39.7	132.1	156.5	159.7	173.1	172.0	155.4	124.4	17.5	9.5	10.6	63.7	63.9	55.5		
--GAVINS POINT--																			
NAT INFLOW	1300	87	40	52	130	141	146	87	65	81	108	52	24	27	76	76	108		
DEPLETION	114																		

	28FEB20	INI-SUM	15MAR	2020	31MAR	30APR	31MAY	30JUN	31JUL	31AUG	30SEP	31OCT	15NOV	22NOV	2021	30NOV	31DEC	31JAN	28FEB
VALUES IN 1000 AF EXCEPT AS INDICATED																			
--FORT PECK--																			
NAT INFLOW	6000	219	102	131	498	962	1336	674	294	260	352	164	77	87	249	260	334		
DEPLETION	556	-16	-8	-10	32	276	558	300	40	-116	-106	-37	-17	-19	-121	-127	-73		
EVAPORATION	387							26	80	99	87	25	12	13	45				
MOD INFLOW	5057	236	110	141	466	686	778	348	174	277	371	176	82	94	325	387	407		
RELEASE	5330	149	69	89	446	492	506	523	523	406	307	149	69	84	523	523	472		
STOR CHANGE	-273		87	41	52	20	194	272	-174	-349	-130	64	27	13	10	-198	-136	-65	
STORAGE	9585.	9671	9712	9764	9784	9978	10250	10076	9727	9598	9661	9688	9701	9710	9512	9377	9312		
ELEV FTMSL	2205.2	2205.8	2206.0	2206.3	2206.5	2207.7	2209.4	2208.3	2206.1	2205.3	2205.7	2205.9	2205.9	2206.0	2204.7	2203.8	2203.4		
DISCH KCFS	8.500	5.0	5.0	5.0	7.5	8.0	8.5	8.5	8.5	6.8	5.0	5.0	5.0	5.3	8.5	8.5	8.5		
POWER																			
AVE POWER MW		61	61	61	91	97	104	104	104	83	61	61	61	64	103	102	102		
PEAK POW MW		134	135	135	135	137	138	137	135	134	134	134	135	135	133	132	132		
ENERGY GWH	782.6	21.8	10.2	13.1	65.6	72.5	75.1	77.7	77.1	59.5	45.1	21.8	10.2	12.4	76.3	75.9	68.3		
--GARRISON--																			
NAT INFLOW	9222	477	222	286	723	1371	2698	1165	405	268	480	187	87	100	174	243	336		
DEPLETION	1148	3	1	2	44	221	847	719	125	-165	-69	-153	-71	-81	-126	-87	-62		
CHAN STOR	0	38	0	0	-27	-5	-5			18	20	0	-3	-35					
EVAPORATION	458							31	96	118	102	29	14	16	53				
REG INFLOW	12946	661	290	373	1098	1636	2351	938	707	739	774	459	214	246	735	853	870		
RELEASE	13277	417	194	250	1012	1230	1309	1291	1291	1043	861	417	194	232	1138	1261	1139		
STOR CHANGE	-331	244	96	123	87	407	1042	-353	-584	-304	-87	43	20	15	-403	-408	-268		
STORAGE	11449.	11693	11789	11912	11999	12406	13448	13095	12510	12206	12119	12162	12182	12196	11794	11386	11118		
ELEV FTMSL	1813.9	1814.9	1815.3	1815.9	1816.2	1817.9	1822.1	1820.7	1818.4	1817.1	1816.7	1816.9	1817.0	1817.1	1815.4	1813.6	1812.4		
DISCH KCFS	19.500	14.0	14.0	14.0	17.0	20.0	22.0	21.0	21.0	17.5	14.0	14.0	14.0	14.6	18.5	20.5	20.5		
POWER																			
AVE POWER MW		150	150	151	183	217	243	235	232	191	152	152	152	159	200	218	216		
PEAK POW MW		385	387	389	390	397	412	407	398	393	392	393	393	393	387	381	376		
ENERGY GWH	17444.6	53.8	25.3	32.6	132.0	161.3	175.1	174.5	172.3	137.7	113.3	54.8	25.6	30.5	148.5	162.3	145.0		
--OAHE--																			
NAT INFLOW	1381	203	95	122	240	132	366	126	48	55	6	9	4	5	-54	-24	48		
DEPLETION	802	26	12	16	53	81	172	212	144	34	-14	1	0	0	14	20	31		
CHAN STOR	-4	28		-15	-15	-10	-10	5		18	19	19	19	19	-3	-20	-10		
EVAPORATION	394							27	81	100	87	25	12	14	47				
REG INFLOW	13458	621	277	356	1184	1266	1493	1183	1114	982	812	400	187	219	1002	1206	1156		
RELEASE	13799	459	298	334	1181	1474	1450	1700	1737	946	931	222	119	134	869	1069	877		
STOR CHANGE	-341	163	-21	22	3	-208	43	-516	-624	36	-119	178	67	86	133	137	279		
STORAGE	12176.	12239	12318	12340	12343	12134	12178	11661	11038	11074	10955	11133	11201	11286	11420	11557	11836		
ELEV FTMSL	1582.8	1583.5	1583.4	1583.5	1583.5	1582.6	1582.8	1580.4	1577.4	1577.6	1577.0	1577.9	1578.2	1578.6	1579.3	1579.9	1581.2		
DISCH KCFS	15.709	15.4	21.4	18.7	19.8	24.0	24.4	27.5	27.8	15.9	15.1	7.4	8.6	8.4	14.1	17.4	15.8		
POWER																			
AVE POWER MW		174	242	212	224	270	273	308	309	173	165	81	94	93	156	192	175		
PEAK POW MW		585	584	585	585	580	581	569	553	554	551	555	557	559	563	566	573		
ENERGY GWH	1853.9	62.7	40.6	45.7	161.4	200.6	196.8	229.0	230.2	124.9	122.7	29.3	15.8	17.8	115.7	142.8	117.9		
--BIG BEND--																			
EVAPORATION	122							8	25	31	28	8	4	4	14				
REG INFLOW	13677	459	298	334	1181	1474	1450	1692	1712	915	903	214	116	130	854	1069	877		
RELEASE	13677	459	298	334	1181	1474	1450	1692	1712	915	903	214	116	130	854	1069	877		
STORAGE	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631	1631		
ELEV FTMSL	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0	1420.0		
DISCH KCFS	15.709	15.4	21.4	18.7	19.8	24.0	24.4	27.5	27.8	15.4	14.7	7.2	8.3	8.2	13.9	17.4	15.8		
POWER																			
AVE POWER MW		73	100	88	93	112	114	129	130	75	74	36	42	41	70	85	76		
PEAK POW MW		517	509	509	509	509	509	509	509	538	538	538	538	538	538	538	538	529	
ENERGY GWH	791.6	26.3	16.9	18.9	66.9	83.5	82.1	95.8	97.0	54.2	55.1	13.1	7.1	8.0	52.2	63.6	50.9		
--FORT RANDALL--																			
NAT INFLOW	465	90	42	54	113	66	126	33	20	-6	-32	-14	-6	-7	-27	-33	46		
DEPLETION	80	1	1	1	4	9	12	18	15	7	1	1	0	1	3	3	3		
EVAPORATION	126							10	32	36	25	6	3	3	12				
REG INFLOW	13936	548	339	387	1290	1531	1564	1697	1686	866	845	194	106	119	812	1033	920		
RELEASE	13936	268	195	387	1290	1531	1564	1697	1686	1581	1364	194	106	119	715	693	548		
STOR CHANGE	0	280	144	0	0	0	0	0	0	-715	-518	0	0	0	97	340	372		
STORAGE	3001.	3281	3425	3425	3425	3425	3425	3425	3425	2710	2192	2192	2192	2192	2289	2629	3001		
ELEV FTMSL	1350.0	1353.5	1355.2	1355.2	1355.2	1355.2	1355.2	1355.2	1355.2	1346.0	1337.5	1337.5	1337.5	1337.5	1337.5	1339.3	1344.8	1350.0	
DISCH KCFS	9.972	9.0	14.0	21.7	21.7	24.9	26.3	27.6	27.4	26.6	22.2	6.5	7.6	7.5	11.6	11.3	9.9		
POWER																			
AVE POWER MW		75	119	184	183	210	222	233	231	216	167	48	56	55	86	86	79		
PEAK POW MW		350	356	356	356	356	356	356	356	324	284	285	285	285	293	319	339		
ENERGY GWH	1376.9	26.9	19.9	39.6	132.0	156.4	159.6	173.1	172.0	155.3	124.3	17.2	9.4	10.5	63.7	63.9	53.0		
--GAVINS POINT--																			
NAT INFLOW	1309	87	41	52	131	142	147	87	65	82	109	53	25	28	76	76	109		
DEPLETION	114	0	0	5	19	24	39	10	-5	2	5	2	3	10	1	1	3		
CHAN STOR	-1	2	-10	-15	0	-6	-3	2	0	2	8	29	-2						