


B3 Cabinet
 AC Power Drop
 FS 405L
 P328M

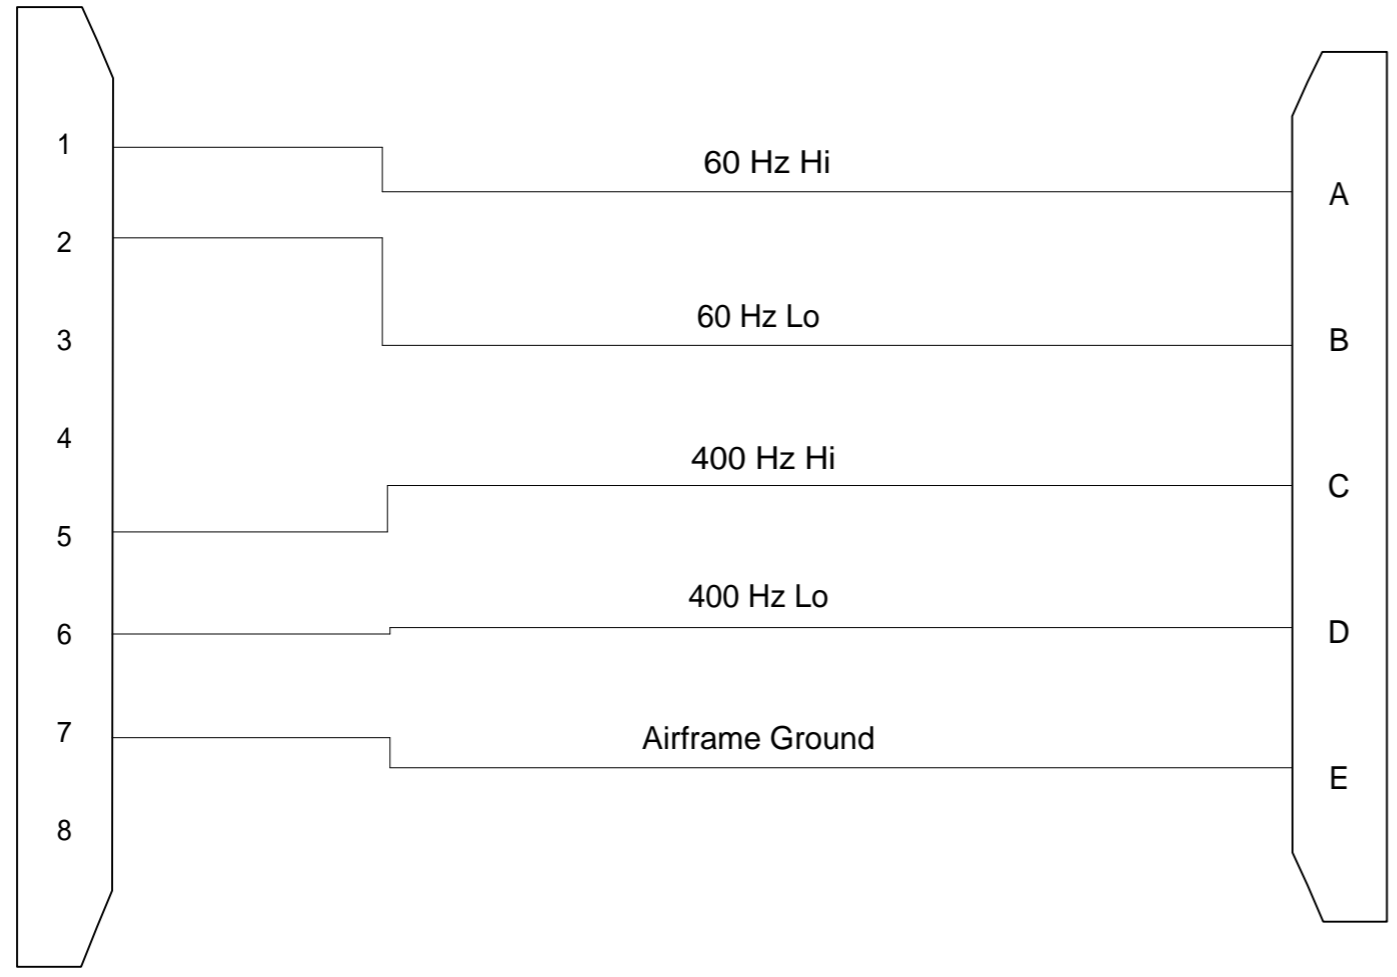

WLOPC Instrument
 Mounted in B3 Cabinet

3.5 Amps 400 Hz
 1 Amp 60 Hz Bus ???

Located:
 B3 Cabinet
 Aisle Face
 Forward Side
 28" High

M83723/76W1808N

M85049/52-1-18W SR

MS3476W14-5S

M85049/52-1-14W SR

Notes:

- AWG 16 Wires
- 50 Inches Long
- 60 Hz to Either Bus 1B or 2 Depending on Load Analysis (Bus 1B Shown)

BY	NAME	DATE	NATIONAL OCEANIC AND ATMOSPHERIC ADMINISTRATION AIRCRAFT OPERATIONS CENTER HANGAR 5, MACDILL AFB, FLORIDA 33621			
DRAWN	TML	5/05/06	TITLE WLOPC Power Cord B3 Cabinet Ozone '06			
CHECKED			CODE/IDENT NO.	SIZE	DWGNO.	REV.
STRESS						XXXXXXXXXX
PROJECTS			SCALE	NONE	filename.dxf	SHEET 1 OF 1
PROJECTS						
APPROVED						
REF						