




ISO-NE Daily Report

Wednesday February 01, 2012

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	24.67	23.15	22.01	21.89	22.16	24.97	27.13	28.23	28.31	28.25	28.18	28.30	28.08	27.23	27.05	26.27	28.23	39.60	33.96	31.35	28.29	28.08	26.06	24.30	27.32	29.09	All	On Pk
NEMass/Boston	24.62	23.05	21.90	21.74	22.17	24.99	26.70	27.60	27.59	27.60	27.63	27.62	27.40	26.58	26.54	25.86	27.63	38.67	32.96	30.50	27.62	27.57	25.88	24.46	26.87	28.45		
New Hampshire	24.18	22.71	21.55	21.39	21.82	24.77	26.69	27.51	27.45	27.45	27.45	27.47	27.33	26.54	26.42	25.78	27.51	38.44	32.75	30.40	27.48	27.49	25.73	24.08	26.68	28.33		
Maine	23.69	22.17	21.00	20.84	21.36	24.68	26.59	27.36	27.35	27.36	27.13	27.15	26.67	26.10	25.99	25.43	27.30	37.90	32.40	30.09	27.12	27.01	25.19	23.59	26.31	27.97		
Mass Hub	24.64	23.07	21.91	21.78	22.15	24.96	27.02	27.96	27.95	27.94	27.90	27.93	27.76	26.92	26.82	26.08	27.89	39.06	33.30	30.82	27.87	27.78	26.02	24.44	27.08	28.75		
Cleared Load (GW)	10.7	10.4	10.2	10.2	10.5	11.1	14.1	15.1	15.0	15.1	15.4	15.3	15.1	15.0	14.6	14.7	15.4	16.7	16.4	16.1	15.5	14.1	12.8	11.6				

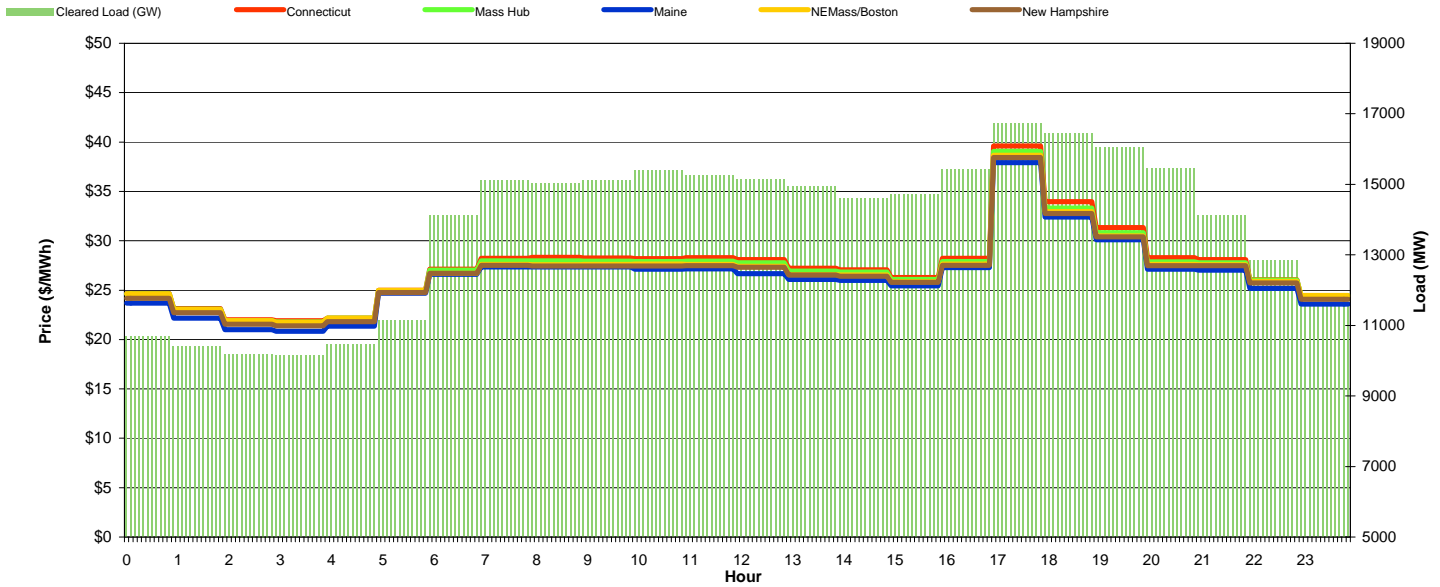

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	20.65	22.64	23.33	24.52	21.85	20.80	25.10	28.60	26.90	24.03	24.40	25.51	28.64	29.27	24.29	22.30	22.15	28.32	35.18	36.31	28.55	26.12	24.17	21.81	25.64	27.17	All	On Pk
NEMass/Boston	20.65	22.66	23.45	24.71	22.04	20.93	25.16	28.43	26.71	23.86	24.14	25.11	28.18	28.87	24.00	22.09	21.94	28.10	34.70	35.52	27.94	25.78	24.14	22.13	25.47	26.84		
New Hampshire	20.23	22.29	23.14	24.43	21.76	20.74	24.99	28.29	26.58	23.76	24.08	25.08	28.21	28.89	24.03	22.06	21.83	27.95	34.49	35.29	27.80	25.80	24.07	21.89	25.32	26.76		
Maine	19.70	21.77	22.74	24.09	21.53	20.66	24.92	28.15	26.67	23.76	24.07	25.03	27.97	28.61	23.93	21.89	21.77	27.87	34.30	34.85	27.51	25.76	24.06	21.76	25.14	26.64		
Mass Hub	20.67	22.70	23.46	24.70	22.02	20.94	25.19	28.54	26.84	23.96	24.26	25.28	28.37	29.05	24.13	22.18	22.02	28.18	34.85	35.77	28.15	25.94	24.21	22.07	25.56	26.98		
DA Forecast Load (GW)	11.88	11.36	11.20	11.17	11.52	12.69	14.76	15.78	15.90	15.92	15.95	15.83	15.63	15.55	15.39	15.32	15.79	17.00	17.20	16.91	16.24	15.14	13.75	12.44				
Forecast Error %	0.2%	1.6%	1.0%	1.2%	1.2%	-0.2%	-2.1%	-0.4%	-0.5%	-0.9%	-0.6%	0.1%	0.4%	-0.2%	-1.2%	-1.9%	-2.2%	-1.1%	-0.7%	-1.4%	-1.3%	-1.1%	-1.5%	0.0%				

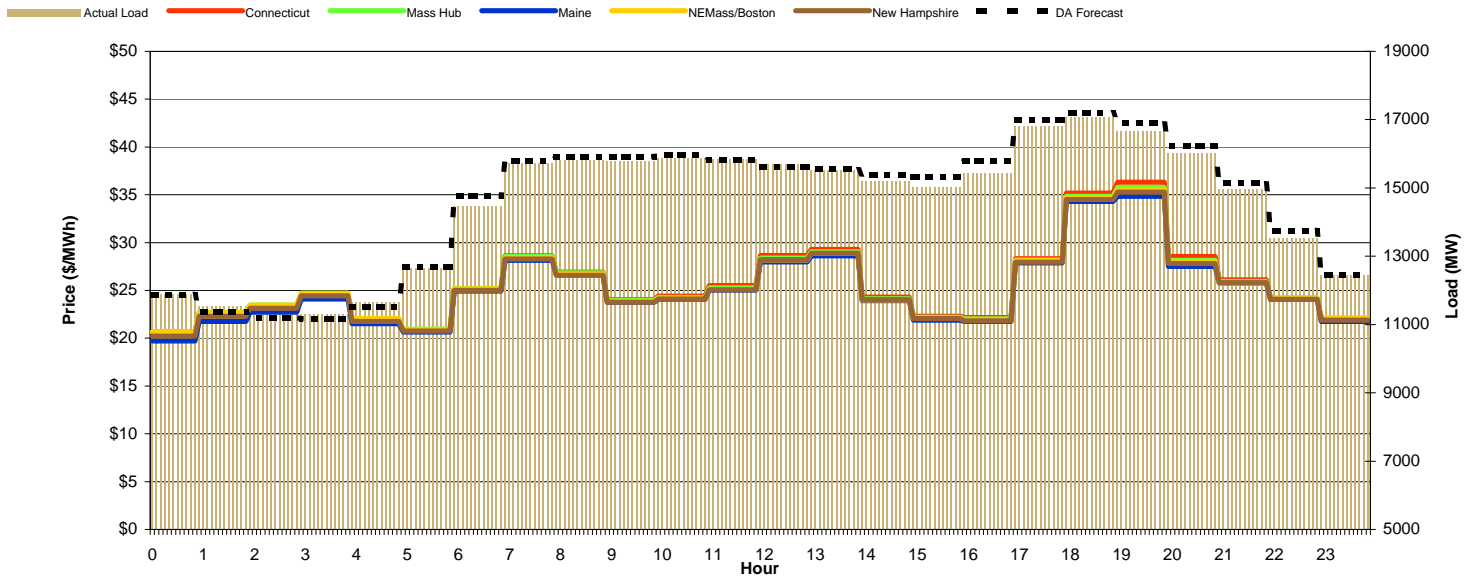




ISO-NE Daily Report

Thursday February 02, 2012

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	21.98	21.90	21.01	20.44	21.15	25.27	27.96	30.15	28.38	28.09	28.08	28.21	28.31	28.26	28.09	28.20	29.77	42.85	38.09	34.48	30.19	27.99	27.72	25.63	28.01	30.43	All	On Pk
NEMass/Boston	21.94	21.72	20.83	20.35	21.20	25.30	27.47	29.39	27.68	27.53	27.55	27.55	27.53	27.54	27.50	27.62	29.10	42.07	37.13	33.69	29.37	27.62	27.59	25.34	27.53	29.78		
New Hampshire	21.51	21.39	20.51	20.02	20.87	25.06	27.59	29.47	27.68	27.52	27.50	27.46	27.54	27.51	27.43	27.58	29.08	41.77	36.92	33.61	29.33	27.64	27.43	25.06	27.40	29.72		
Maine	20.90	20.74	19.82	19.38	20.45	24.95	27.79	29.54	27.83	27.71	27.64	27.41	27.32	27.26	27.17	27.55	29.25	41.68	36.94	33.88	29.35	27.71	27.08	24.55	27.25	29.71		
Mass Hub	21.96	21.81	20.93	20.40	21.19	25.34	27.78	29.79	28.02	27.81	27.76	27.79	27.82	27.80	27.71	27.82	29.38	42.39	37.44	33.96	29.69	27.81	27.73	25.52	27.74	30.05		
Cleared Load (GW)	11.0	10.7	10.7	10.9	10.9	11.6	14.3	15.2	15.2	15.2	15.2	15.2	15.1	14.9	14.6	14.7	15.6	17.0	16.6	16.4	15.8	14.5	13.2	12.0				

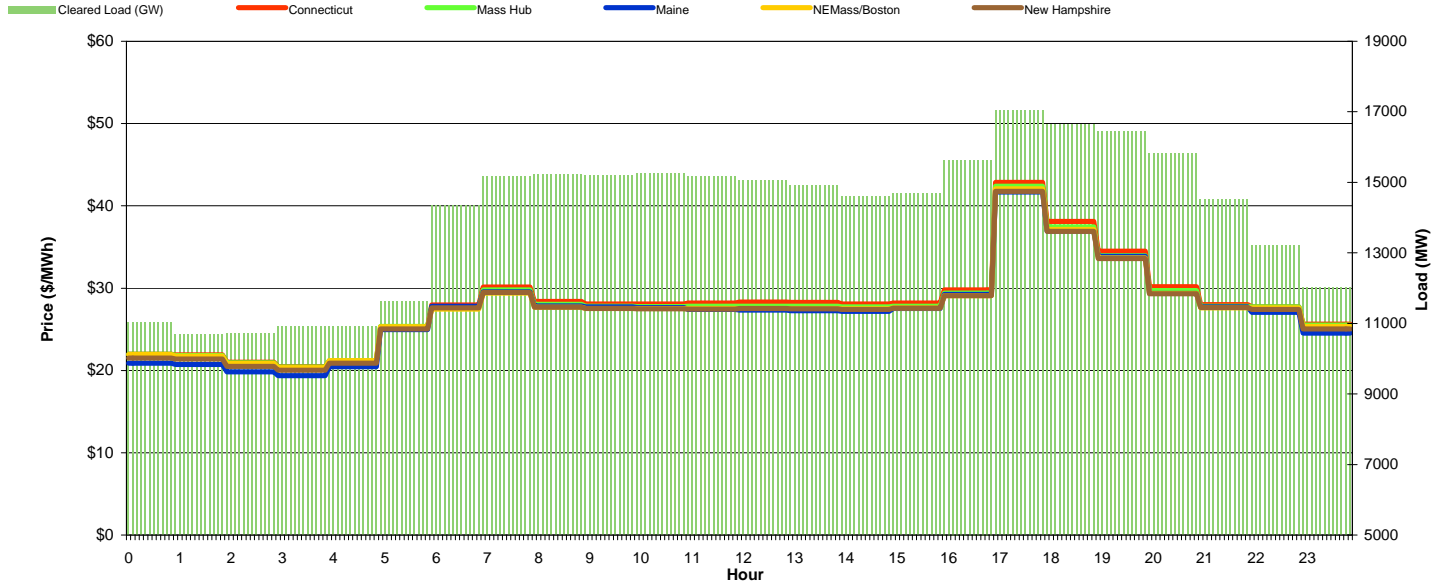

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	21.40	24.32	22.86	22.79	21.80	17.73	27.31	28.06	26.71	26.80	28.65	28.86	30.06	31.82	33.16	28.67	32.79	52.63	47.28	34.78	31.53	28.32	31.49	32.31	29.67	32.60	All	On Pk
NEMass/Boston	21.61	24.42	22.91	22.92	21.91	17.79	27.20	27.66	26.21	26.39	28.15	28.31	29.49	31.22	32.65	28.20	32.29	51.92	46.48	34.13	30.88	27.83	31.47	32.84	29.37	32.08		
New Hampshire	21.32	24.13	22.65	22.68	21.67	17.66	27.14	27.65	26.18	26.33	28.09	28.23	29.51	31.22	32.60	28.12	32.14	51.61	46.29	34.05	30.84	27.90	31.36	32.47	29.24	32.01		
Maine	21.08	23.80	22.38	22.44	21.59	17.58	27.17	27.54	26.19	26.47	28.30	28.38	29.53	31.26	32.60	27.95	32.16	51.91	46.49	34.28	30.99	28.14	31.66	32.66	29.27	32.12		
Mass Hub	21.57	24.43	22.94	22.93	21.91	17.81	27.26	27.81	26.42	26.56	28.33	28.50	29.70	31.45	32.86	28.38	32.47	52.04	46.61	34.26	31.07	27.99	31.51	32.66	29.48	32.25		
DA Forecast Load (GW)	11.57	11.21	11.00	11.03	11.42	12.59	14.59	15.75	15.94	15.99	16.11	16.08	15.88	15.78	15.69	15.74	16.37	17.64	17.85	17.51	16.81	15.72	14.29	13.00				
Forecast Error %	1.7%	1.7%	2.4%	3.7%	1.5%	0.0%	-1.6%	-1.2%	-1.0%	-0.3%	-0.2%	0.2%	1.0%	1.4%	1.6%	2.1%	2.3%	1.0%	0.3%	0.1%	0.5%	0.8%	0.8%	0.7%				

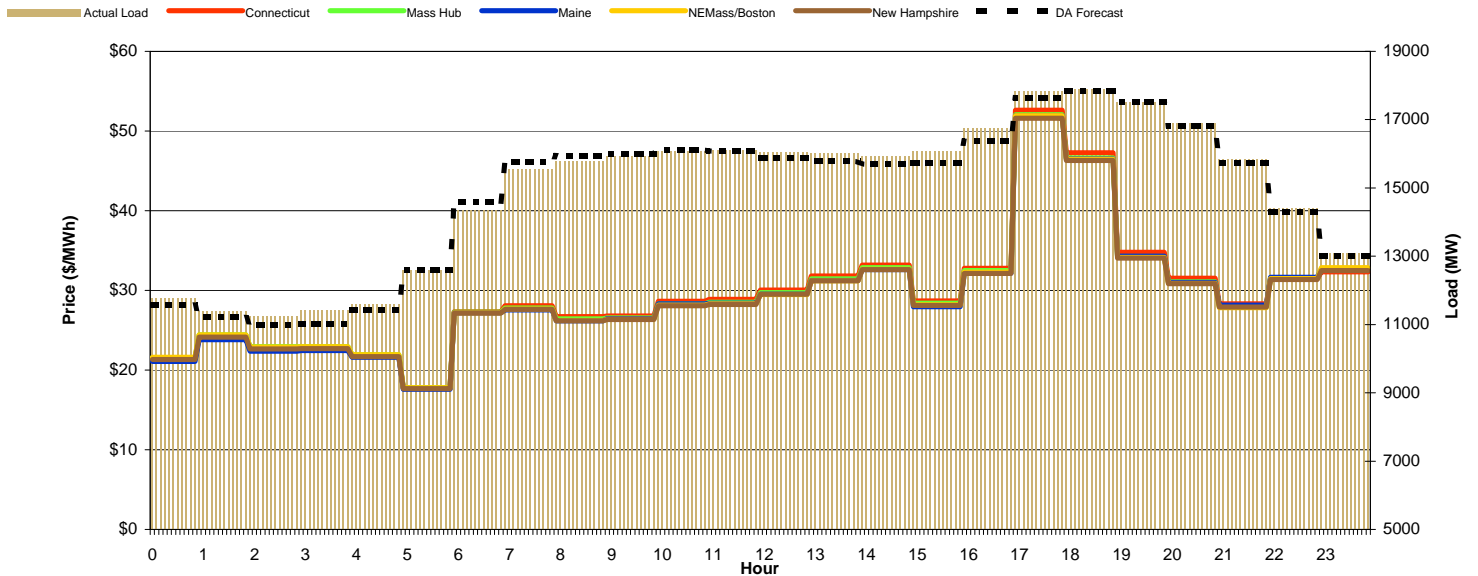




ISO-NE Daily Report

Friday February 03, 2012

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	27.99	25.57	25.08	24.25	25.63	27.86	32.06	34.82	32.41	32.26	32.30	32.41	31.75	31.45	29.40	29.29	32.66	40.70	38.00	35.94	32.88	29.74	30.11	28.98	30.98	32.88	All	On Pk
NEMass/Boston	28.25	26.09	25.45	24.65	26.12	28.23	31.35	33.80	31.47	31.47	31.47	31.52	30.93	30.78	28.96	28.88	31.95	40.06	37.10	35.09	32.00	29.29	29.84	28.88	30.57	32.16		
New Hampshire	28.06	25.83	25.25	24.37	25.91	28.10	31.38	33.77	31.48	31.47	31.48	31.47	30.96	30.70	28.86	28.81	31.84	39.78	36.88	34.84	31.83	29.23	29.85	28.83	30.46	32.08		
Maine	31.00	28.15	25.50	24.58	29.36	32.20	31.64	33.82	31.81	31.81	31.79	31.71	31.07	30.77	28.95	28.94	32.01	39.85	36.86	34.83	31.87	29.46	35.00	29.59	31.36	32.53		
Mass Hub	28.30	26.00	25.42	24.55	26.05	28.23	31.79	34.04	31.66	31.66	31.66	31.66	31.02	31.03	29.16	29.05	32.16	40.43	37.42	35.47	32.16	29.53	30.05	29.05	30.73	32.39		
Cleared Load (GW)	11.8	11.4	11.1	11.1	11.4	12.4	15.0	15.3	15.2	15.2	15.2	15.0	14.7	14.8	14.7	14.7	15.3	16.9	16.5	16.1	15.0	14.3	13.3	12.3				

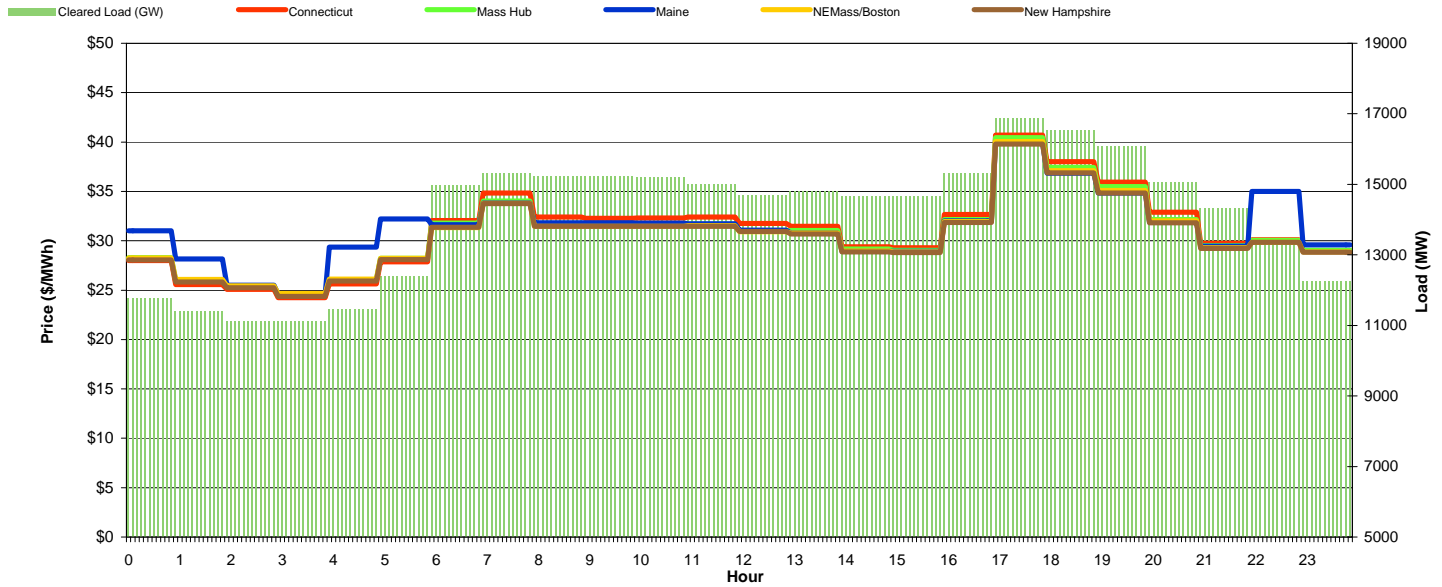

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	25.15	23.05	22.86	22.92	23.25	25.11	28.74	31.99	34.08	30.69	32.10	31.32	29.52	29.06	27.24	27.08	28.62	31.23	32.71	32.18	33.88	28.78	26.16	24.78	28.44	30.42	All	On Pk
NEMass/Boston	25.62	23.47	23.23	23.27	23.58	25.25	28.54	31.48	33.39	30.13	31.54	30.73	29.11	28.73	27.07	26.91	28.32	31.10	32.32	31.70	33.08	28.17	25.95	24.75	28.23	29.98		
New Hampshire	25.29	23.19	22.98	23.01	23.30	24.98	28.44	31.40	33.27	30.05	31.46	30.65	29.03	28.65	26.97	26.79	28.14	30.85	32.10	31.56	32.95	28.14	25.91	24.61	28.07	29.87		
Maine	25.47	23.32	23.09	23.12	23.35	25.02	28.51	31.30	33.29	30.12	31.54	30.82	29.07	28.68	27.04	26.80	28.27	31.04	32.24	31.68	32.84	28.22	26.07	24.77	28.15	29.94		
Mass Hub	25.45	23.34	23.12	23.16	23.48	25.22	28.63	31.68	33.68	30.38	31.78	30.97	29.28	28.87	27.14	26.98	28.45	31.14	32.42	31.86	33.37	28.41	26.06	24.81	28.32	30.15		
DA Forecast Load (GW)	12.09	11.71	11.56	11.58	11.96	13.10	15.13	16.13	16.29	16.21	16.12	15.97	15.72	15.53	15.25	15.16	15.73	17.00	17.36	16.98	16.34	15.50	14.36	13.19				
Forecast Error %	1.2%	2.1%	2.6%	2.6%	1.3%	0.0%	0.6%	1.4%	1.3%	1.6%	2.0%	1.9%	1.6%	1.5%	1.8%	1.8%	0.7%	0.6%	0.1%	-0.3%	0.2%	0.3%	0.3%	-0.1%				

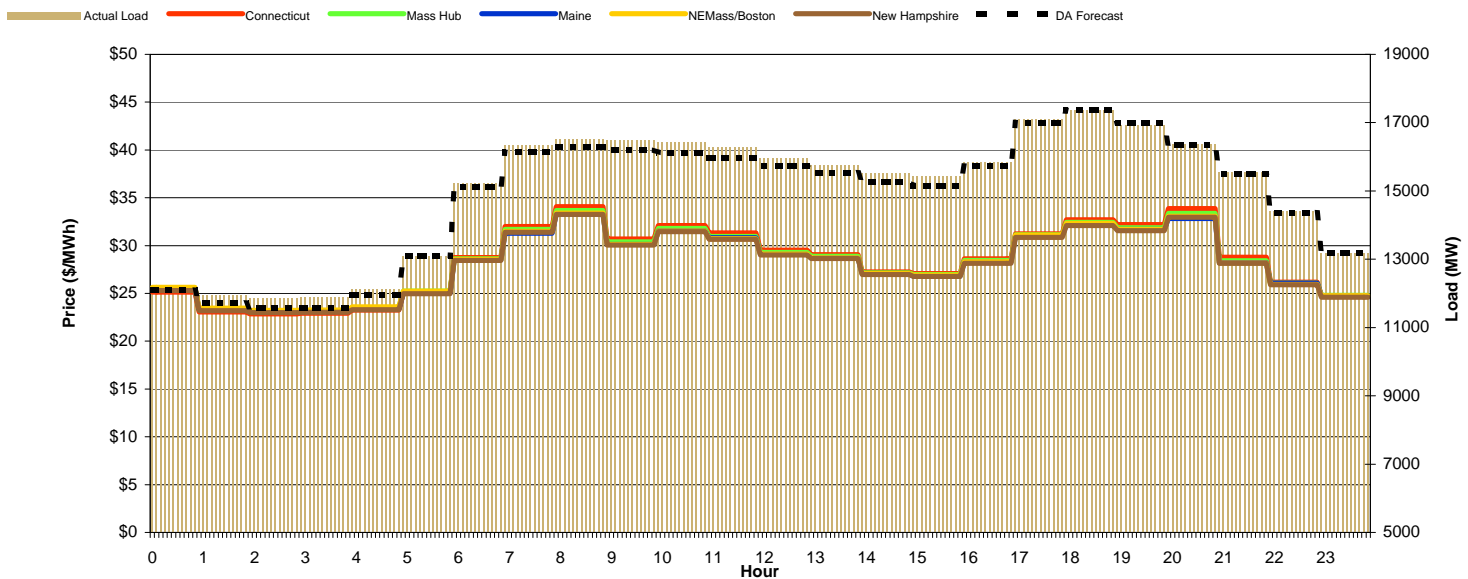




ISO-NE Daily Report

Saturday February 04, 2012

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	27.11	26.93	24.73	25.00	25.14	25.61	26.08	28.89	30.35	32.13	32.62	32.43	31.76	30.31	28.45	28.26	31.21	39.93	43.25	36.38	33.86	31.77	31.12	29.69	30.54	32.67	All	On Pk
NEMass/Boston	27.48	27.48	25.16	25.41	25.56	25.95	26.15	28.51	29.78	31.22	31.72	31.55	31.00	29.71	27.95	27.78	30.49	39.01	42.16	35.29	32.90	31.01	30.51	29.47	30.14	31.91		
New Hampshire	27.21	27.13	24.81	25.07	25.25	25.73	25.87	28.30	29.60	30.99	31.47	31.33	30.80	29.45	27.71	27.53	30.28	38.60	41.62	34.97	32.59	30.68	30.11	29.05	29.84	31.63		
Maine	27.59	27.46	25.01	25.34	25.55	26.06	26.16	28.54	29.55	30.86	31.40	31.18	30.79	29.47	27.77	27.58	30.11	38.35	41.19	34.74	32.26	30.54	29.86	29.12	29.85	31.51		
Mass Hub	27.56	27.46	25.16	25.44	25.63	26.03	26.45	28.79	30.22	31.78	32.27	32.05	31.37	29.96	28.20	27.98	30.85	39.55	42.81	35.88	33.37	31.42	30.94	29.82	30.46	32.34		
Cleared Load (GW)	11.7	11.2	10.9	11.0	11.1	11.4	12.1	12.9	14.0	14.5	14.6	14.4	14.0	13.6	13.3	13.3	14.2	15.9	15.9	15.4	14.8	14.2	13.4	12.5				

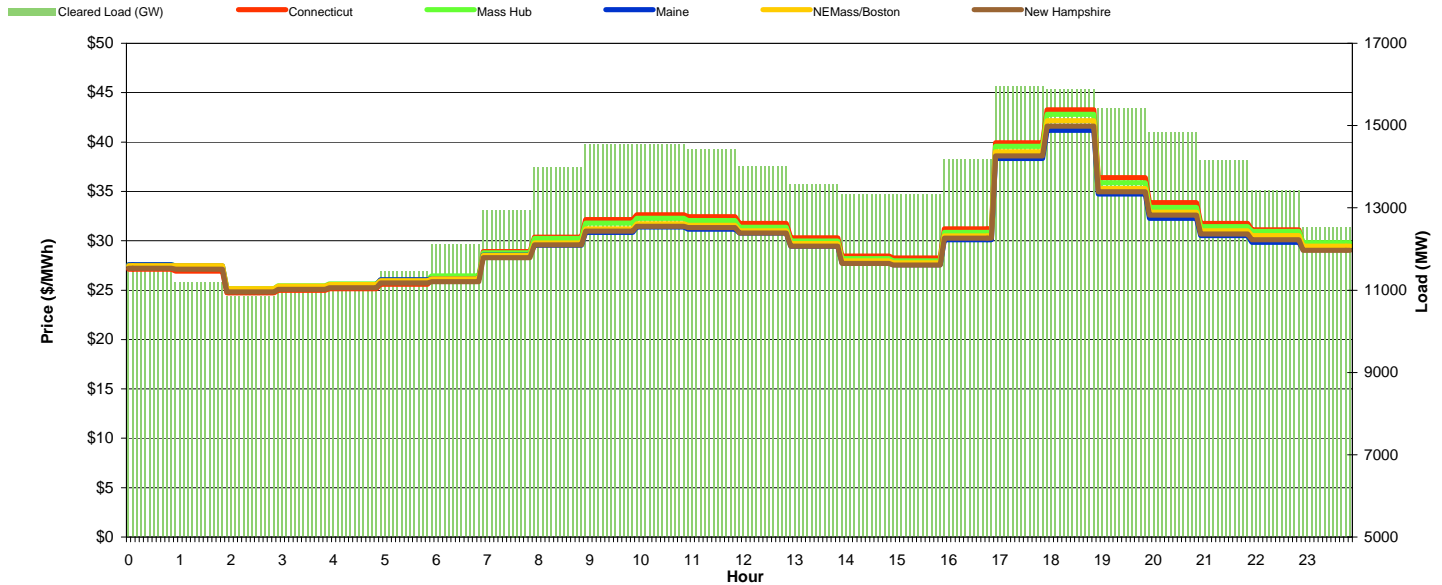

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	25.27	27.72	24.85	24.34	25.06	24.93	25.97	28.60	29.93	27.80	29.94	30.18	30.20	28.22	27.25	27.98	28.89	34.13	30.08	30.22	38.72	31.98	27.19	25.66	28.55	30.08	All	On Pk
NEMass/Boston	25.56	28.33	25.39	24.80	25.51	25.23	26.25	28.60	29.61	27.41	29.37	29.65	29.72	27.91	26.95	27.64	28.52	33.81	29.81	29.84	37.94	31.41	26.90	25.70	28.41	29.69		
New Hampshire	25.31	28.04	25.07	24.48	25.17	24.85	25.87	28.28	29.38	27.19	29.13	29.44	29.54	27.68	26.73	27.42	28.30	33.52	29.57	29.63	37.61	31.21	26.58	25.35	28.14	29.45		
Maine	25.48	28.26	25.30	24.75	25.45	24.97	26.05	28.44	29.35	27.20	28.97	29.25	29.41	27.56	26.64	27.31	28.05	33.39	29.47	29.51	37.07	31.05	26.37	25.26	28.11	29.32		
Mass Hub	25.55	28.23	25.30	24.77	25.49	25.25	26.23	28.68	29.84	27.66	29.71	29.98	30.01	28.10	27.13	27.83	28.75	34.11	30.01	30.08	38.38	31.75	27.10	25.80	28.57	29.95		
DA Forecast Load (GW)	12.23	11.74	11.52	11.47	11.56	12.02	12.83	13.61	14.46	15.08	15.06	15.02	14.70	14.38	14.13	14.12	14.83	16.26	16.54	16.17	15.51	14.79	13.87	12.95				
Forecast Error %	-0.2%	-0.6%	-1.2%	0.5%	0.5%	0.0%	-2.1%	-1.8%	-1.4%	-1.9%	-0.4%	-0.8%	-0.4%	-0.1%	0.1%	0.2%	-1.1%	-1.0%	-0.4%	-0.5%	0.8%	1.3%	1.4%	1.1%				

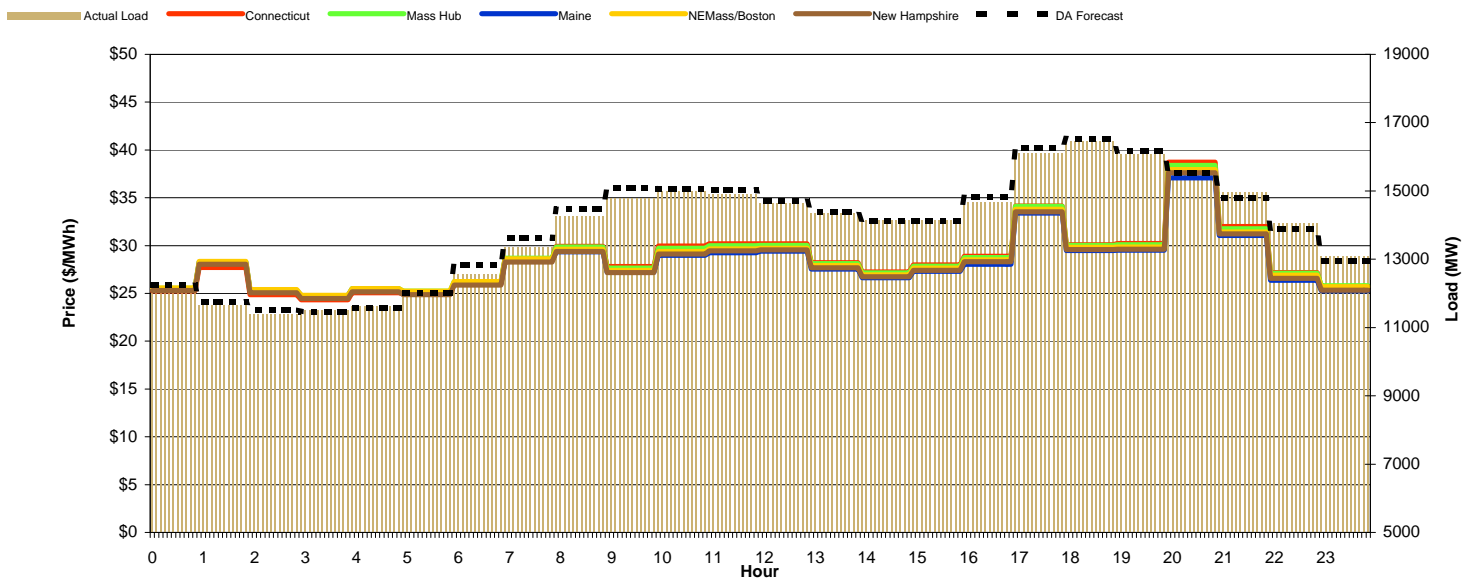




ISO-NE Daily Report

Sunday February 05, 2012

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	27.38	27.45	26.32	26.28	26.23	26.47	26.61	28.35	30.10	29.79	29.76	30.12	29.89	29.20	28.46	29.37	31.80	43.40	37.44	34.07	31.80	31.16	30.43	29.55	30.06	31.57	All	On Pk
NEMass/Boston	27.43	27.43	26.40	26.43	26.40	26.62	26.70	28.21	29.62	29.20	29.18	29.49	29.22	28.57	28.04	28.78	30.95	42.47	36.43	33.12	31.04	30.43	30.04	29.63	29.66	30.92		
New Hampshire	27.17	27.22	26.18	26.14	26.13	26.35	26.46	28.11	29.40	29.05	28.97	29.33	29.15	28.39	27.85	28.53	30.79	42.14	36.09	32.72	30.74	30.12	29.97	29.36	29.43	30.71		
Maine	27.36	27.35	26.28	26.26	26.27	26.58	26.72	28.50	29.44	29.17	29.12	29.36	29.30	28.51	28.02	28.63	30.59	41.78	35.81	32.40	30.45	29.87	30.00	29.53	29.47	30.68		
Mass Hub	27.65	27.68	26.64	26.65	26.61	26.82	26.81	28.45	30.05	29.67	29.55	29.90	29.59	28.89	28.27	29.03	31.37	43.11	36.91	33.56	31.41	30.80	30.38	29.87	29.99	31.31		
Cleared Load (GW)	11.8	11.6	11.3	11.3	11.4	11.4	11.6	12.1	13.4	14.0	14.0	14.0	13.8	13.3	13.1	13.1	14.1	15.8	15.4	14.9	14.5	13.8	12.9	11.9				

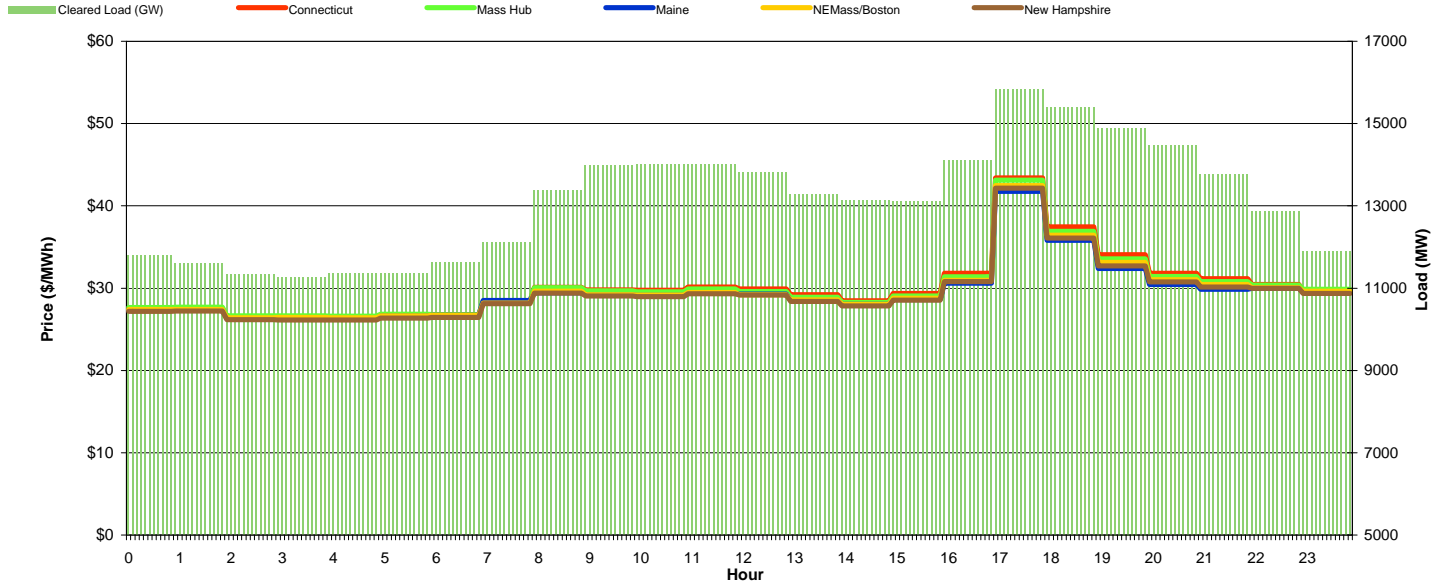

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	26.39	26.59	26.09	25.11	25.44	26.32	32.08	29.15	28.77	31.20	36.02	37.20	37.65	34.45	28.77	30.50	39.27	54.08	36.85	33.27	37.70	29.65	33.93	37.00	32.65	34.90	All	On Pk
NEMass/Boston	26.65	26.79	26.19	25.29	25.64	26.57	32.21	29.14	28.63	30.91	35.63	36.77	37.37	34.00	28.56	30.33	38.84	53.79	36.51	32.86	37.27	29.40	33.67	37.44	32.52	34.61		
New Hampshire	26.30	26.51	25.95	25.02	25.38	26.30	31.92	28.93	28.40	30.68	35.36	36.48	37.06	33.73	28.35	30.12	38.53	53.37	36.25	32.54	36.74	29.02	33.23	36.89	32.21	34.30		
Maine	26.26	26.43	25.88	25.06	25.44	26.43	32.00	29.16	28.35	30.70	35.30	36.33	36.99	33.62	28.36	30.15	38.19	53.28	36.04	32.28	36.13	28.76	32.68	36.66	32.10	34.15		
Mass Hub	26.71	26.88	26.33	25.40	25.75	26.66	32.34	29.26	28.77	31.11	35.88	37.02	37.58	34.25	28.72	30.49	39.12	54.11	36.79	33.10	37.52	29.56	33.83	37.42	32.69	34.82		
DA Forecast Load (GW)	12.23	11.74	11.51	11.44	11.53	11.81	12.42	12.99	13.76	14.33	14.99	15.06	14.97	14.74	14.55	14.62	15.32	16.88	16.66	16.08	15.60	14.82	13.97	12.85				
Forecast Error %	0.7%	3.2%	5.6%	5.8%	5.5%	3.7%	1.0%	1.7%	2.7%	2.9%	0.0%	0.2%	0.4%	0.6%	0.8%	0.8%	0.1%	-0.9%	-0.4%	-2.1%	-1.7%	-0.8%	1.6%	1.8%				

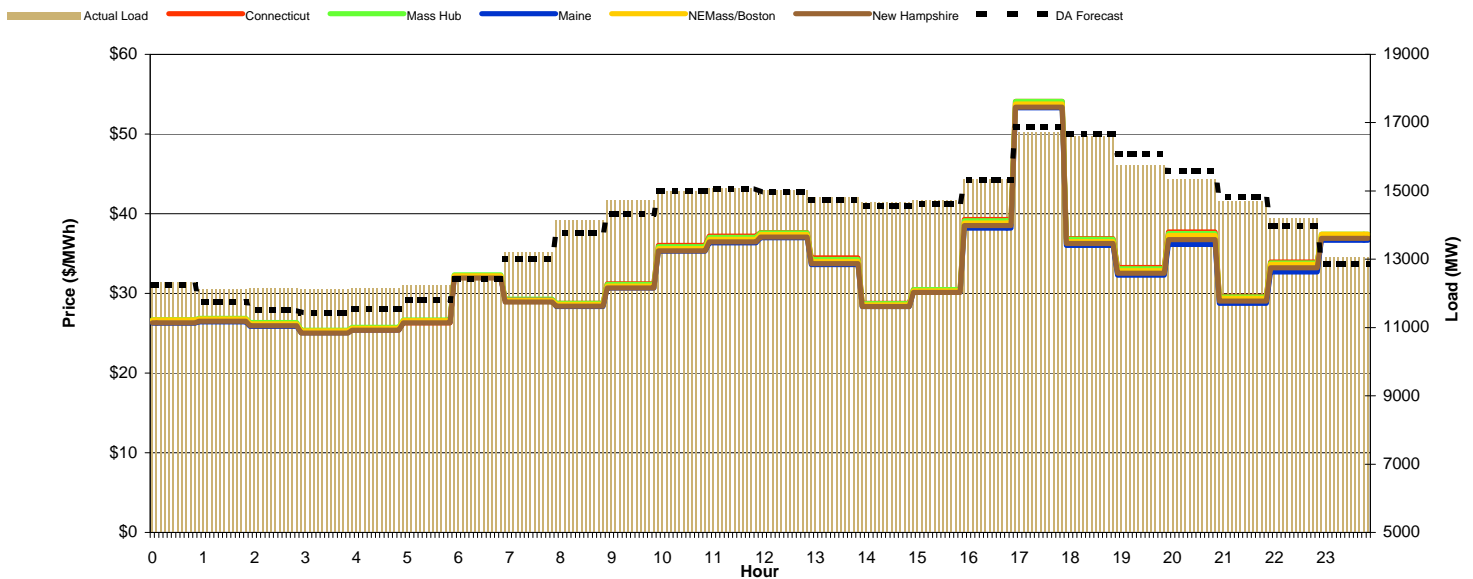




ISO-NE Daily Report

Monday February 06, 2012

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	30.84	30.75	30.50	27.78	28.28	31.65	47.03	42.11	33.83	33.43	33.42	33.42	31.43	30.54	29.41	28.99	31.07	50.64	44.14	40.13	34.83	31.03	31.32	31.13	34.07	34.98	All	On Pk
NEMass/Boston	30.86	30.91	30.81	28.08	28.47	31.53	46.97	40.85	32.80	32.57	32.54	32.55	30.62	29.72	28.66	28.41	30.46	49.85	43.24	39.23	33.89	30.40	30.65	30.91	33.54	34.15		
New Hampshire	30.47	30.46	30.32	27.62	27.97	31.01	46.30	40.53	32.59	32.34	32.37	32.39	30.53	29.66	28.53	28.30	30.36	49.36	42.72	38.83	33.64	30.29	30.38	30.38	33.22	33.93		
Maine	30.61	30.53	30.39	27.76	28.11	31.19	46.34	40.06	32.54	32.30	32.28	32.25	30.41	29.52	28.38	28.25	30.27	48.90	42.37	38.52	33.35	31.00	30.25	30.33	33.16	33.79		
Mass Hub	31.03	31.03	30.91	28.14	28.57	31.66	47.21	41.59	33.25	33.00	33.00	32.99	30.98	30.08	29.00	28.71	30.76	50.49	43.72	39.74	34.31	30.67	30.92	31.09	33.87	34.58		
Cleared Load (GW)	11.3	10.8	10.7	10.7	11.1	12.0	14.2	15.1	15.2	15.2	15.3	15.1	14.7	14.5	14.3	14.3	14.9	16.3	16.1	15.9	15.1	13.9	12.6	11.6				

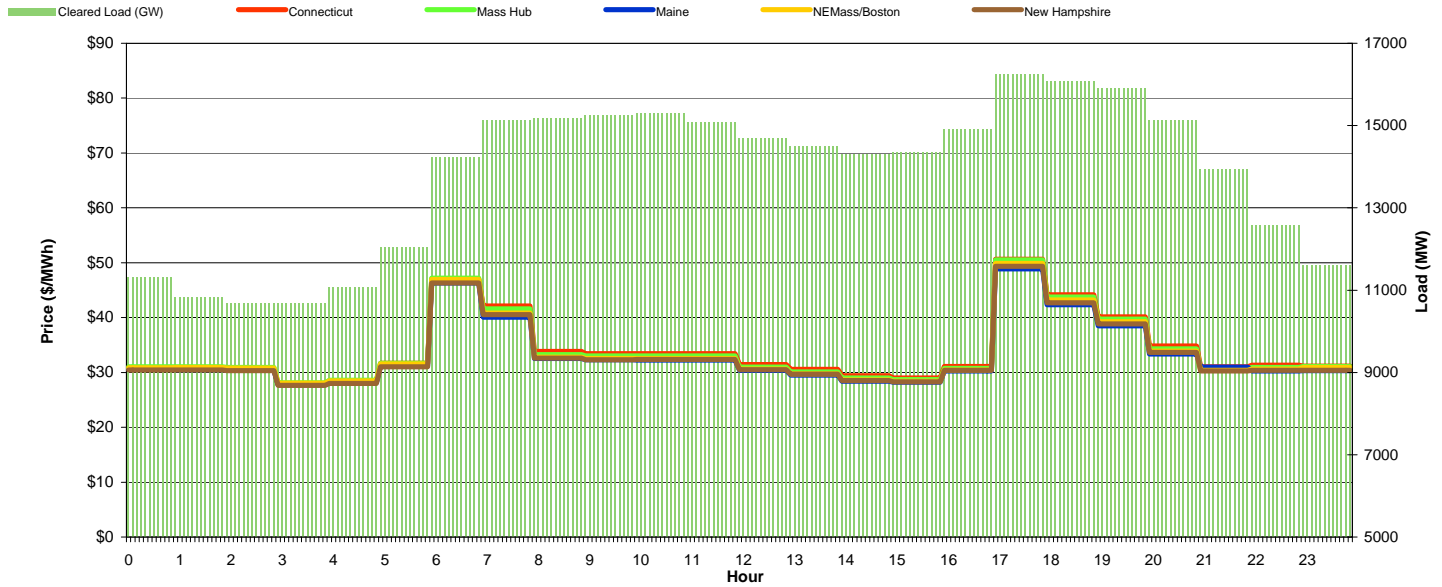

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	35.25	31.02	38.33	28.87	28.11	22.10	38.80	38.22	41.75	38.35	30.70	29.65	35.02	33.98	27.99	26.57	27.97	52.64	79.69	43.36	31.30	26.34	26.53	23.56	34.84	36.88	All	On Pk
NEMass/Boston	35.64	31.41	38.86	29.21	28.52	22.40	38.78	37.74	41.15	38.09	30.23	29.21	34.55	33.50	27.73	26.48	27.95	52.69	80.07	42.98	30.87	26.08	26.15	23.32	34.73	36.59		
New Hampshire	34.98	30.89	38.16	28.71	28.04	22.06	38.30	37.18	40.60	37.55	29.92	28.94	34.22	33.17	27.48	26.20	27.62	51.86	78.60	42.41	30.54	25.80	25.72	22.78	34.24	36.11		
Maine	34.67	30.64	38.12	28.79	28.19	22.17	38.37	36.90	40.23	37.38	29.76	28.65	33.68	32.63	27.10	25.94	27.39	51.38	77.58	41.90	29.95	25.25	24.93	21.82	33.89	35.67		
Mass Hub	35.63	31.40	38.84	29.21	28.51	22.39	38.84	37.90	41.41	38.23	30.47	29.45	34.79	33.74	27.87	26.57	28.03	52.86	80.26	43.24	31.12	26.23	26.32	23.45	34.87	36.78		
DA Forecast Load (GW)	12.05	11.67	11.56	11.58	11.96	13.16	15.25	16.36	16.39	16.31	16.22	16.02	15.72	15.53	15.29	15.27	15.88	17.30	17.70	17.37	16.66	15.51	14.05	12.74				
Forecast Error %	0.9%	0.4%	0.0%	0.1%	1.8%	-0.2%	-1.1%	-1.2%	-0.5%	-0.5%	-0.2%	0.1%	0.2%	0.1%	-0.2%	-1.0%	-2.2%	-1.6%	-1.0%	-1.5%	-1.7%	-1.8%	0.0%	0.9%				

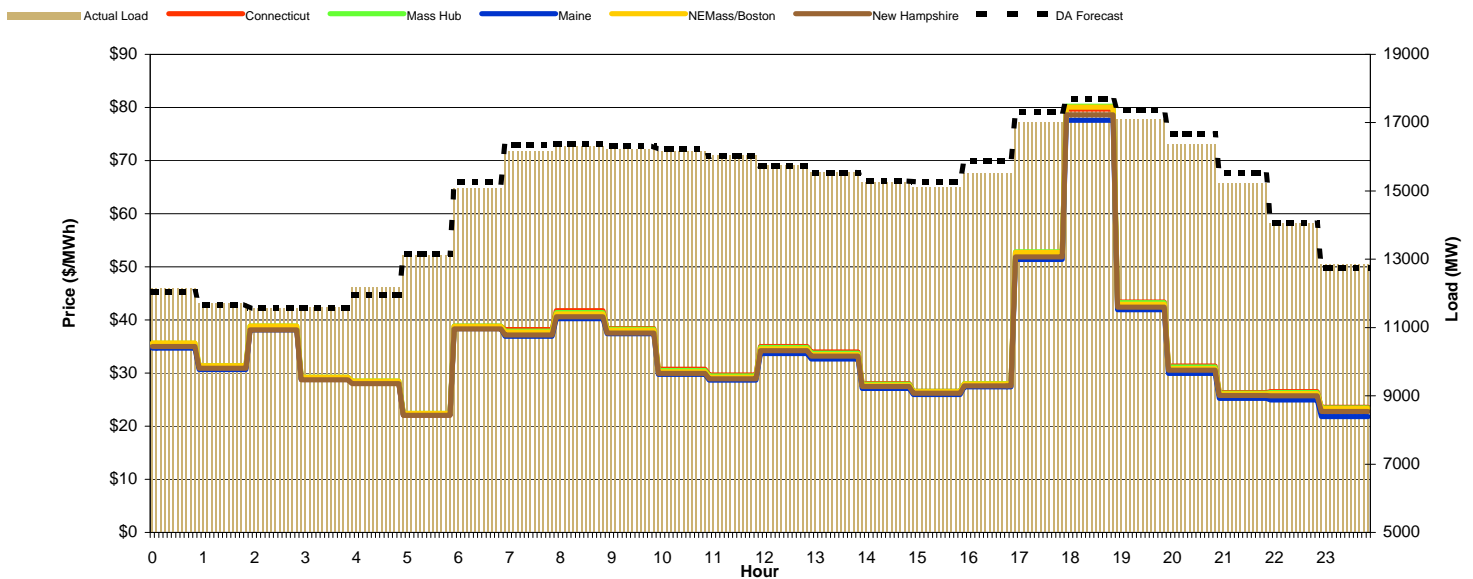




ISO-NE Daily Report

Tuesday February 07, 2012

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	28.84	28.62	28.58	26.70	27.28	28.61	30.44	30.87	30.96	30.88	30.82	30.88	30.97	30.03	28.77	28.16	29.94	46.04	43.47	39.34	36.03	31.01	29.51	29.10	31.49	32.98	All	On Pk
NEMass/Boston	29.06	28.78	28.71	26.76	27.35	28.84	30.91	30.53	30.54	30.53	30.54	30.53	29.65	28.46	27.93	29.73	45.88	43.14	39.01	35.39	30.95	29.91	30.00	31.40	32.70	31.40	32.70	
New Hampshire	28.72	28.50	28.41	26.50	27.10	28.61	30.80	30.43	30.40	30.42	30.41	30.41	30.44	29.61	28.41	27.88	29.68	45.53	42.84	38.77	35.30	31.06	29.68	29.67	31.23	32.58	31.23	32.58
Maine	28.79	28.43	28.35	26.47	27.16	28.78	31.05	30.71	30.67	30.78	30.74	30.70	30.57	29.72	28.62	28.03	29.89	45.66	42.88	38.87	35.29	31.37	29.89	31.74	31.47	32.77	31.47	32.77
Mass Hub	29.18	28.95	28.80	26.66	27.16	28.66	31.10	30.90	30.84	30.81	30.76	30.78	30.80	29.90	28.65	28.13	29.93	46.29	43.48	39.37	35.72	31.24	30.08	29.98	31.59	32.98	31.59	32.98
Cleared Load (GW)	11.4	11.3	11.1	10.8	11.1	11.4	14.4	15.4	15.2	15.3	15.3	15.2	15.0	14.8	14.6	14.7	15.3	16.8	16.5	16.2	15.6	14.7	13.5	12.3				

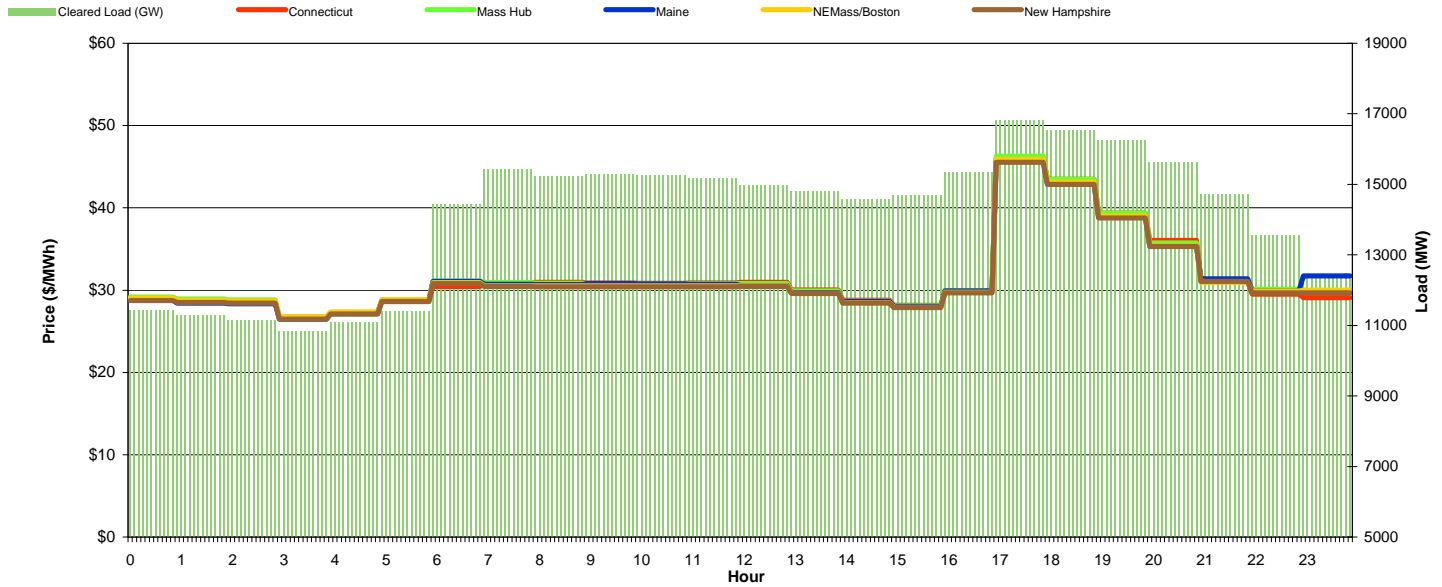

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	23.98	26.12	26.90	26.58	26.27	26.01	26.27	28.87	29.15	28.99	28.79	28.75	30.28	29.71	28.64	28.14	28.45	38.37	31.89	33.00	32.39	28.93	27.48	26.35	28.76	30.11	All	On Pk
NEMass/Boston	23.87	26.00	26.73	26.36	26.20	26.20	26.38	28.69	28.95	28.82	28.62	28.56	30.01	29.40	28.35	27.91	28.44	38.50	31.90	32.90	31.96	28.62	27.51	26.49	28.64	29.95	28.64	29.95
New Hampshire	23.33	25.52	26.28	25.92	25.71	25.82	26.08	28.40	28.68	28.54	28.33	28.23	29.75	29.20	28.13	27.70	28.20	38.18	31.67	32.70	31.82	28.52	27.24	26.07	28.33	29.71	28.33	29.71
Maine	22.37	24.53	25.24	24.88	24.73	25.35	25.84	28.19	28.49	28.29	28.04	27.76	29.14	28.52	27.44	27.11	27.88	37.77	31.19	32.26	31.17	27.98	26.69	25.19	27.75	29.25	27.75	29.25
Mass Hub	24.00	26.16	26.91	26.55	26.35	26.26	26.45	28.84	29.10	28.96	28.76	28.71	30.18	29.58	28.52	28.05	28.52	38.60	32.00	33.06	32.20	28.76	27.58	26.54	28.78	30.09	28.78	30.09
DA Forecast Load (GW)	11.82	11.44	11.30	11.35	11.72	12.88	14.94	16.03	16.11	16.05	16.04	15.96	15.71	15.59	15.48	15.52	16.26	17.50	17.79	17.50	16.85	15.79	14.38	13.12				
Forecast Error %	4.0%	5.8%	5.5%	7.0%	5.5%	0.2%	-1.7%	-1.5%	-1.1%	-0.7%	-0.6%	-0.3%	1.1%	1.8%	1.3%	0.9%	-1.5%	-1.3%	-0.4%	-0.8%	-0.5%	-0.5%	0.8%	3.0%				

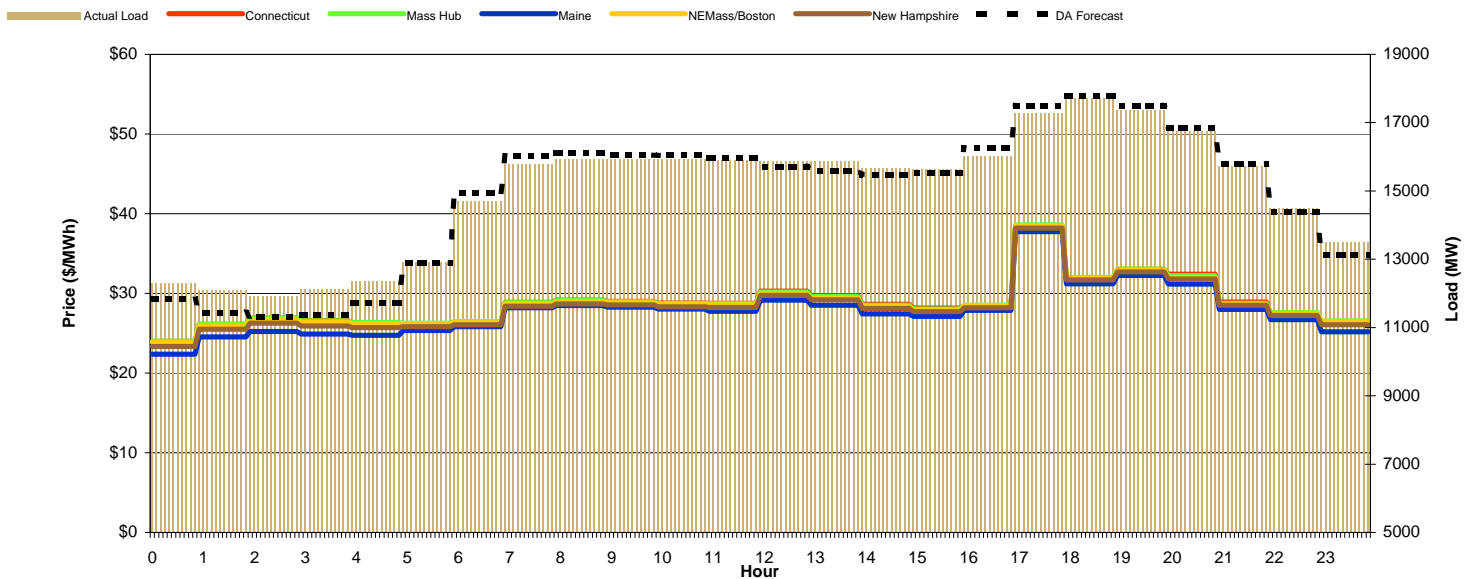




ISO-NE Daily Report

Wednesday February 08, 2012

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$	
Connecticut	29.82	29.42	29.42	29.58	29.43	31.20	37.85	45.28	40.86	39.31	37.59	37.31	36.60	35.27	32.93	32.45	37.00	52.93	52.40	42.57	38.48	34.03	33.15	34.00	36.62	39.26
NEMass/Boston	30.02	29.65	29.55	29.64	29.71	31.59	37.70	44.94	40.47	38.85	37.14	37.03	36.30	35.10	32.87	32.34	36.67	53.06	51.62	42.21	37.84	33.83	33.46	34.13	36.49	38.98
New Hampshire	29.58	29.23	29.14	29.20	29.30	31.31	37.68	44.03	39.50	37.96	36.33	36.09	35.40	34.23	32.17	31.73	35.87	51.32	51.30	42.00	37.68	33.91	33.20	33.72	35.91	38.30
Maine	29.23	28.87	28.71	28.77	29.06	31.45	38.00	43.63	39.56	38.15	36.52	36.14	34.99	33.90	32.02	31.75	35.73	50.54	51.18	42.02	37.47	33.78	32.88	33.64	35.75	38.14
Mass Hub	30.15	29.81	29.71	29.81	29.82	31.68	38.05	45.20	40.63	38.89	37.12	36.88	36.26	35.20	32.87	32.31	36.83	53.48	52.16	42.80	38.46	34.16	33.69	34.33	36.68	39.18
Cleared Load (GW)	12.2	11.9	12.0	12.3	12.1	12.7	15.1	15.6	15.6	15.5	15.4	15.2	15.1	15.1	14.9	14.8	15.6	16.9	16.8	16.6	16.0	14.7	13.6	12.3		

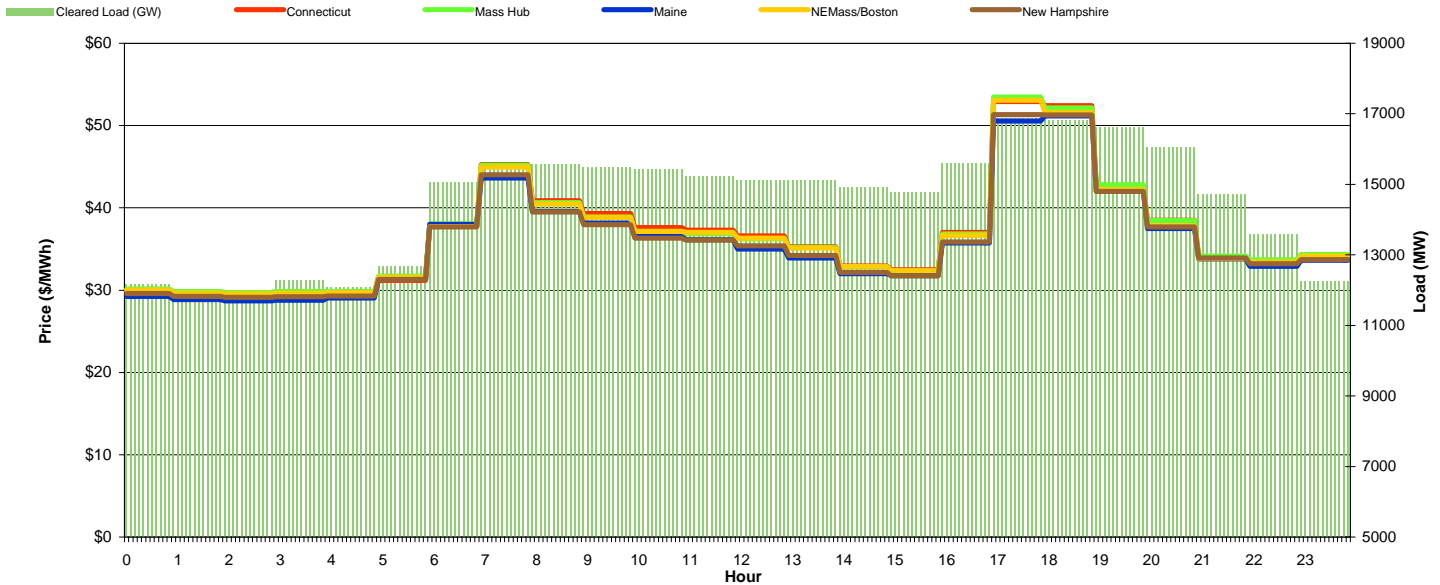

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$	
Connecticut	28.07	27.81	26.77	26.48	28.32	29.81	43.80	42.01	35.83	33.98	35.78	34.08	39.21	34.74	32.92	34.67	37.30	46.00	49.30	43.60	36.19	32.50	36.05	26.33	35.06	37.76
NEMass/Boston	28.06	27.82	26.70	26.42	28.42	30.21	44.02	41.84	35.51	33.89	35.41	34.00	38.86	34.47	32.88	34.33	36.78	45.79	48.73	43.11	35.75	32.20	35.98	26.49	34.90	37.47
New Hampshire	27.60	27.39	26.32	26.02	28.02	29.85	43.53	41.53	35.07	33.24	34.68	33.21	37.99	33.77	32.05	33.56	35.97	44.57	47.44	42.11	34.88	31.61	35.66	26.08	34.26	36.71
Maine	26.80	26.67	25.51	25.26	27.52	29.67	43.11	41.11	34.91	33.29	34.51	33.05	37.64	33.57	31.63	33.14	35.48	43.97	46.58	41.43	34.13	30.95	34.84	25.47	33.76	36.26
Mass Hub	28.15	27.92	26.82	26.54	28.49	30.16	44.02	41.94	35.63	33.89	35.52	34.00	38.89	34.49	32.82	34.35	36.85	45.75	48.76	43.18	35.84	32.27	36.10	26.50	34.95	37.52
DA Forecast Load (GW)	12.38	12.05	11.93	12.02	12.48	13.73	15.89	16.88	16.99	16.89	16.76	16.62	16.35	16.17	16.01	15.96	16.63	17.91	18.31	17.92	17.18	16.03	14.56	13.21		
Forecast Error %	4.0%	4.4%	6.4%	6.8%	2.3%	-1.3%	-2.5%	-1.6%	-1.4%	-1.3%	-1.1%	-1.3%	-1.3%	-1.0%	-0.9%	0.1%	-0.1%	0.0%	-0.8%	-1.0%	-0.7%	-0.5%	-0.9%	-0.7%		

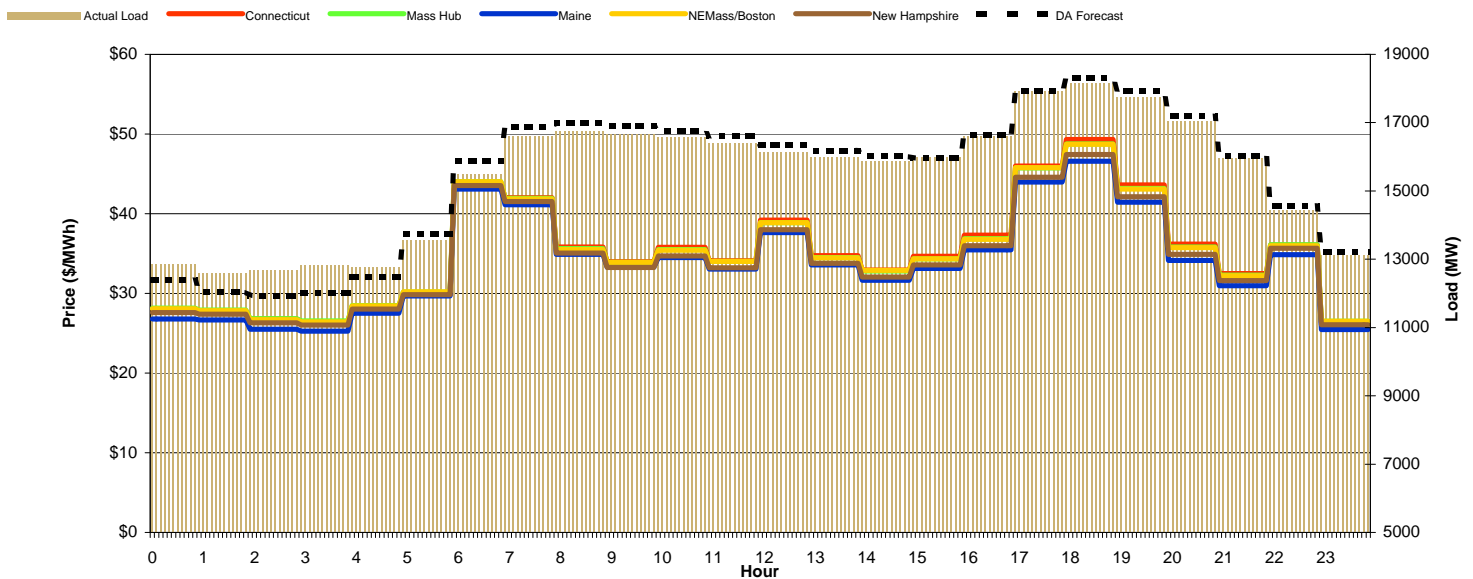




ISO-NE Daily Report

Thursday February 09, 2012

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$	
Connecticut	30.48	30.52	28.93	28.76	28.71	30.88	33.74	40.42	37.02	35.26	33.82	33.58	32.74	31.00	29.96	30.30	32.04	49.35	48.11	39.40	35.37	32.19	31.84	30.76	33.97	35.78
NEMass/Boston	30.86	30.81	29.31	29.15	29.23	31.16	33.46	40.10	36.68	35.07	33.64	33.46	32.60	30.88	29.90	30.27	31.94	49.17	47.46	38.96	34.71	32.05	31.65	31.02	33.90	35.53
New Hampshire	30.36	30.42	28.93	28.76	28.86	30.91	33.36	39.03	35.76	34.19	32.90	32.59	31.68	29.97	29.01	29.42	31.18	47.74	47.05	38.63	34.56	32.02	31.36	30.43	33.30	34.82
Maine	30.13	30.26	28.80	28.68	28.80	37.00	33.55	38.98	36.00	34.39	33.21	32.60	31.43	29.73	28.79	29.33	31.24	47.65	47.07	38.80	34.56	32.01	30.99	29.96	33.50	34.80
Mass Hub	30.90	30.90	29.39	29.20	29.30	31.15	33.73	40.29	36.79	35.09	33.66	33.40	32.51	30.78	29.81	30.14	31.87	48.88	47.66	39.06	34.86	32.16	31.60	31.07	33.93	35.54
Cleared Load (GW)	11.5	11.3	11.4	11.5	11.6	12.2	14.9	15.4	15.3	15.4	15.4	15.1	15.1	14.7	14.6	14.5	14.9	16.1	16.1	15.8	15.2	14.1	12.6	11.9		

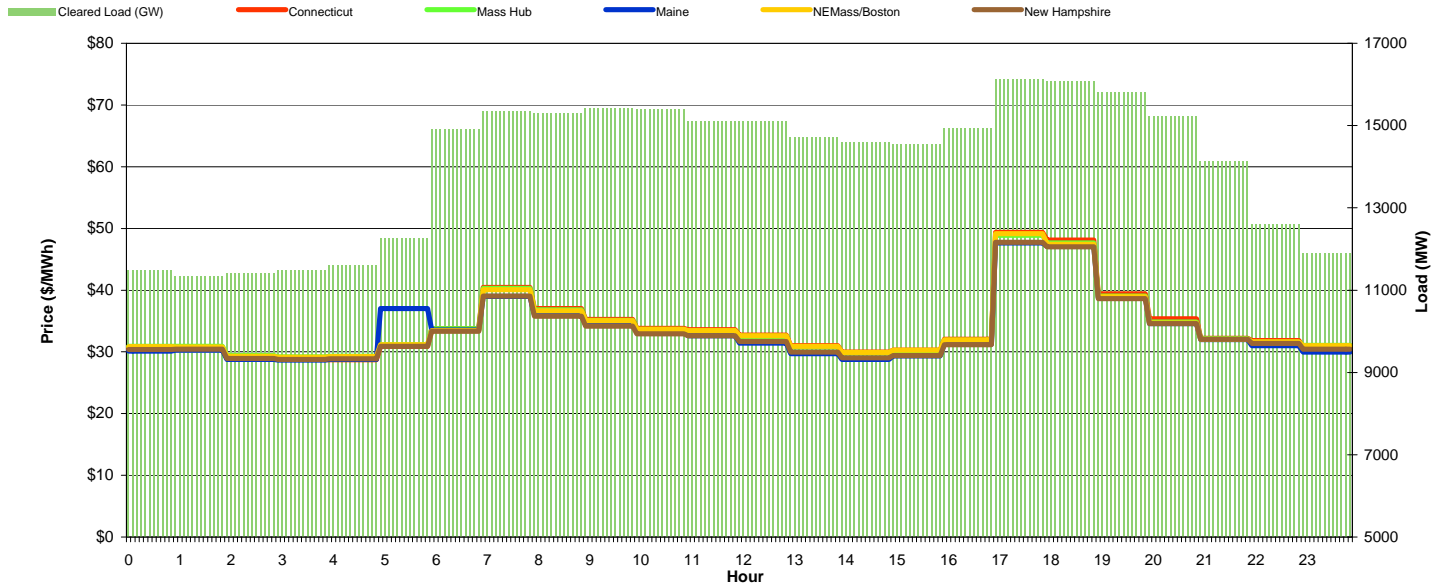

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$	
Connecticut	28.00	26.05	24.93	24.88	26.03	29.76	40.23	40.19	32.93	37.62	32.68	33.73	30.30	30.36	29.68	29.99	32.63	67.62	51.89	40.71	41.86	42.86	31.68	23.83	34.60	37.92
NEMass/Boston	28.33	26.29	25.17	25.16	26.47	30.04	40.16	39.83	32.55	37.53	32.37	33.59	30.29	30.32	29.74	30.00	32.61	67.52	51.86	40.24	41.10	42.12	31.66	24.05	34.54	37.71
New Hampshire	27.84	25.85	24.79	24.79	26.11	29.75	39.42	38.76	31.87	36.49	31.61	32.80	29.47	29.49	28.88	29.17	31.75	65.41	50.28	39.82	40.74	41.97	31.49	23.73	33.85	36.88
Maine	27.09	25.24	24.25	24.44	26.00	29.93	39.46	38.61	31.96	36.18	31.44	32.60	29.12	29.04	28.46	28.88	31.50	64.76	49.76	39.63	40.24	41.78	31.43	23.53	33.56	36.59
Mass Hub	28.33	26.33	25.21	25.19	26.46	30.04	40.15	39.79	32.56	37.47	32.39	33.54	30.18	30.21	29.61	29.87	32.48	67.19	51.64	40.36	41.28	42.28	31.67	23.98	34.51	37.66
DA Forecast Load (GW)	12.36	11.94	11.69	11.69	12.07	13.25	15.39	16.47	16.43	16.32	16.21	16.04	15.75	15.56	15.38	15.38	16.01	17.38	17.70	17.37	16.73	15.70	14.32	13.02		
Forecast Error %	2.4%	3.2%	5.7%	5.7%	5.1%	1.6%	-1.0%	-1.4%	-0.9%	-0.8%	-0.8%	-0.8%	-0.7%	-0.5%	-0.9%	-1.3%	-2.7%	-2.5%	-0.8%	-0.8%	-0.2%	0.0%	-0.1%	2.0%		

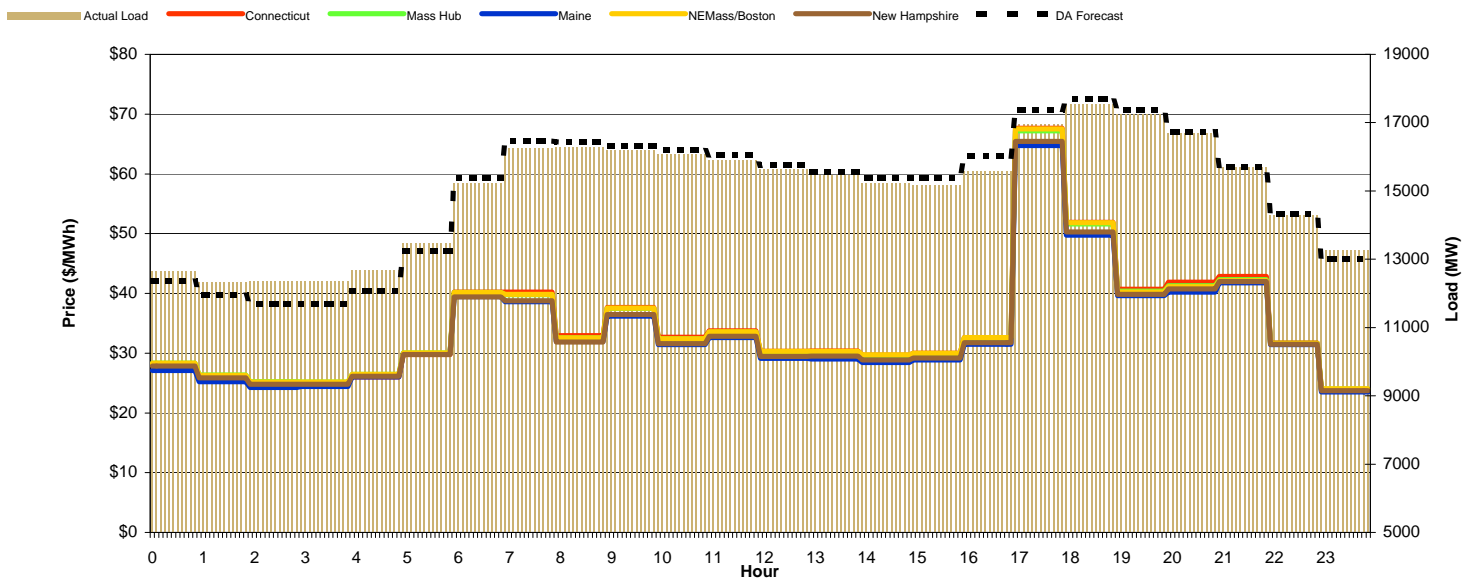




ISO-NE Daily Report

Friday February 10, 2012

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	26.35	26.11	26.13	24.95	26.25	29.13	33.65	36.71	32.95	32.88	32.72	33.56	30.95	30.77	27.44	27.40	30.28	37.46	39.87	33.02	32.24	29.26	28.42	30.44	30.79	32.25	All	On Pk
NEMass/Boston	26.65	26.26	26.17	24.98	26.56	29.46	33.22	35.73	32.17	32.18	32.00	32.87	30.39	30.11	26.96	26.99	29.88	36.85	38.62	32.20	31.38	28.90	28.20	30.37	30.38	31.59		
New Hampshire	26.18	25.83	25.80	24.59	26.23	29.21	33.06	35.66	32.19	32.18	32.00	32.68	30.23	29.92	26.76	26.77	29.69	36.53	38.17	32.04	31.39	28.87	27.94	29.97	30.16	31.44		
Maine	25.81	25.41	25.39	24.15	26.04	29.39	33.26	35.63	32.58	32.43	32.19	32.36	29.95	29.53	26.45	26.54	29.44	35.94	37.08	31.89	31.08	28.47	27.28	29.45	29.91	31.18		
Mass Hub	26.62	26.28	26.20	25.00	26.58	29.36	33.62	36.21	32.49	32.49	32.28	33.08	30.58	30.31	27.13	27.11	29.99	37.19	39.02	32.47	31.67	29.10	28.36	30.45	30.57	31.84		
Cleared Load (GW)	11.6	11.4	11.3	11.4	11.7	11.8	14.9	15.3	15.2	15.3	15.2	14.9	14.7	14.5	14.3	14.3	14.8	16.3	15.9	15.7	15.1	14.1	13.0	11.8				

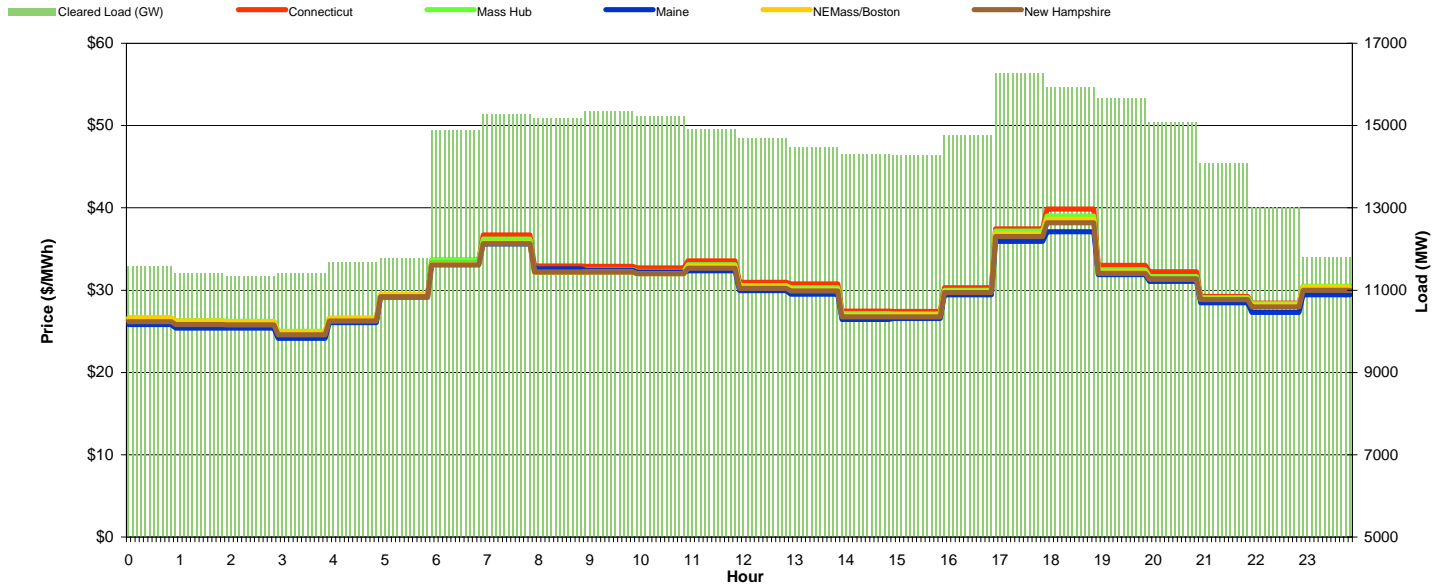

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	27.64	27.28	27.52	28.92	28.00	30.64	38.03	45.72	38.89	35.24	34.94	34.41	30.42	29.76	29.58	29.80	31.32	37.27	35.35	32.39	29.52	32.94	29.04	29.06	32.24	33.54	All	On Pk
NEMass/Boston	28.13	27.77	28.01	29.45	28.55	31.00	37.41	44.43	37.87	34.47	34.16	33.76	30.07	29.32	29.16	29.41	30.96	36.90	34.72	31.66	28.88	32.48	28.90	29.44	31.95	32.95		
New Hampshire	27.71	27.40	27.67	29.18	28.25	30.77	37.22	44.23	37.72	34.37	34.10	33.60	29.85	29.09	28.92	29.14	30.67	36.56	34.45	31.50	28.75	32.40	28.73	29.07	31.72	32.76		
Maine	27.61	27.28	27.63	29.24	28.36	30.96	37.21	44.07	37.74	34.37	34.15	33.40	29.63	28.73	28.52	28.81	30.47	36.49	34.28	31.27	28.37	31.92	28.11	28.48	31.55	32.52		
Mass Hub	28.02	27.70	27.94	29.37	28.46	30.95	37.59	44.72	38.10	34.67	34.39	33.93	30.15	29.41	29.26	29.50	31.01	37.00	34.86	31.88	29.09	32.61	28.89	29.36	32.04	33.09		
DA Forecast Load (GW)	12.08	11.60	11.42	11.45	11.78	12.91	14.75	15.71	15.91	15.90	15.84	15.70	15.46	15.25	15.01	14.95	15.49	16.47	16.87	16.47	15.88	15.05	13.93	12.82				
Forecast Error %	4.6%	8.3%	8.9%	8.8%	7.0%	2.0%	2.6%	3.5%	2.3%	1.3%	1.0%	0.5%	0.0%	0.2%	0.4%	0.2%	-0.8%	0.7%	0.0%	-0.4%	-0.5%	-0.4%	-0.6%	0.9%				

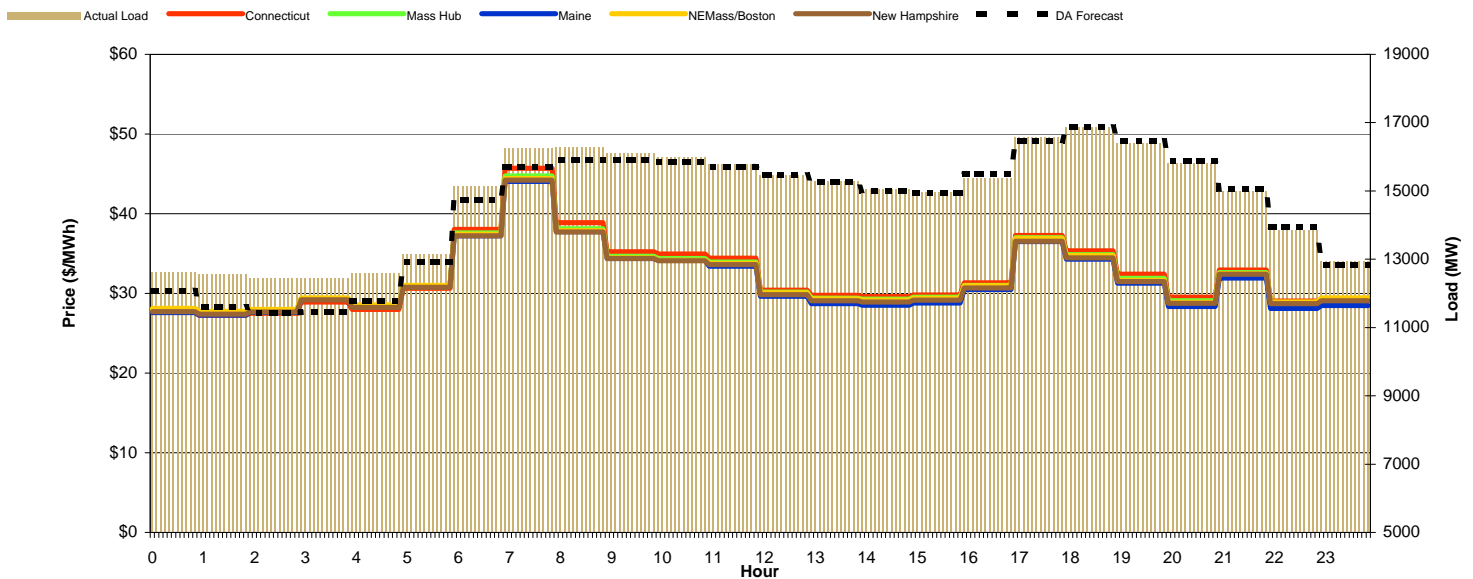




ISO-NE Daily Report

Saturday February 11, 2012

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	32.53	27.75	28.35	26.77	27.63	31.02	32.41	36.55	34.94	40.89	43.00	40.07	41.98	40.54	37.41	37.33	37.27	57.00	60.85	46.91	41.07	41.51	41.17	38.29	38.47	42.41	All	On Pk
NEMass/Boston	32.36	27.74	28.32	26.71	27.59	30.95	32.33	36.69	35.02	40.24	42.02	39.10	41.05	39.89	36.98	36.98	36.84	55.85	59.47	45.71	39.96	40.32	40.31	38.17	37.94	41.65		
New Hampshire	31.86	27.30	27.82	26.31	27.13	30.48	31.96	36.23	34.80	40.20	42.04	39.12	40.93	39.67	36.76	36.73	36.78	55.53	59.09	45.46	39.81	39.93	39.64	37.51	37.63	41.42		
Maine	31.45	26.95	27.43	25.93	26.79	30.19	31.96	36.51	35.19	40.49	42.12	39.23	40.71	39.57	36.77	36.67	36.93	55.24	58.61	45.14	39.26	39.00	38.68	36.89	37.40	41.26		
Mass Hub	32.46	27.90	28.47	26.91	27.74	31.15	32.19	36.86	35.43	40.87	42.69	39.37	41.74	40.41	37.43	37.41	37.27	56.69	60.38	46.34	40.57	40.98	40.76	38.41	38.35	42.20		
Cleared Load (GW)	11.1	11.1	11.1	11.0	11.1	11.2	11.4	12.5	14.0	14.5	14.6	14.2	14.5	13.9	13.9	13.9	14.6	16.2	16.1	15.6	15.0	14.3	13.2	12.4				

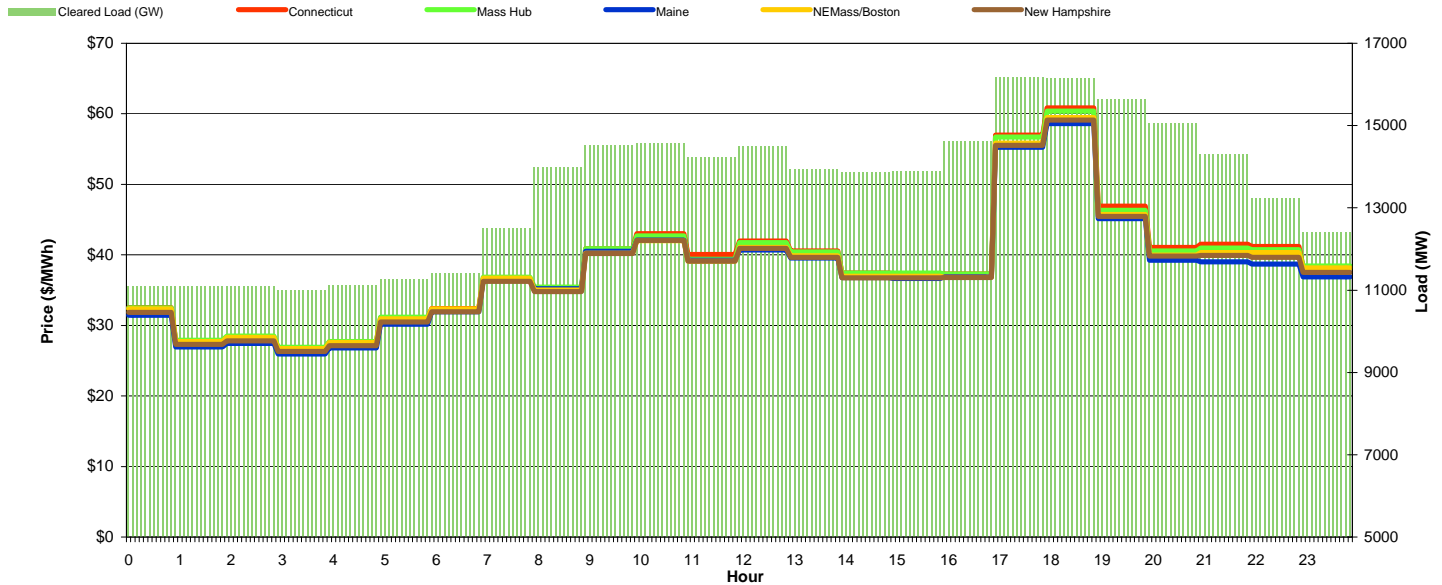

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$				
Connecticut	31.17	29.80	23.34	4.98	11.67	29.75	30.69	22.14	26.13	37.67	43.25	43.23	39.63	38.44	33.79	30.25	36.23	40.44	40.29	37.49	30.51	33.04	22.17	27.36	30.98	34.67	All	On Pk	
NEMass/Boston	31.44	30.01	23.50	5.03	11.82	30.07	30.95	22.23	26.31	37.31	42.36	42.45	39.10	38.13	33.70	30.14	35.98	39.92	39.63	36.86	30.16	32.53	21.98	27.38	30.79	34.30			
New Hampshire	30.96	29.54	23.11	4.95	11.64	29.58	30.47	22.02	26.13	37.17	42.29	42.33	38.92	37.82	33.36	29.83	35.65	39.55	39.32	36.55	29.77	32.04	21.55	26.81	30.47	34.02			
Maine	30.38	29.04	22.72	4.88	11.52	29.46	30.57	22.22	26.38	37.36	42.26	42.22	38.94	37.88	33.44	29.86	35.53	39.36	39.05	36.15	29.14	31.25	20.91	26.14	30.28	33.87			
Mass Hub	31.48	30.11	23.57	5.04	11.84	30.12	30.99	22.28	26.31	37.50	42.71	42.77	39.35	38.27	33.75	30.20	36.08	40.08	39.85	37.06	30.23	32.68	22.04	27.36	30.90	34.45			
DA Forecast Load (GW)	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
Forecast Error %	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!		

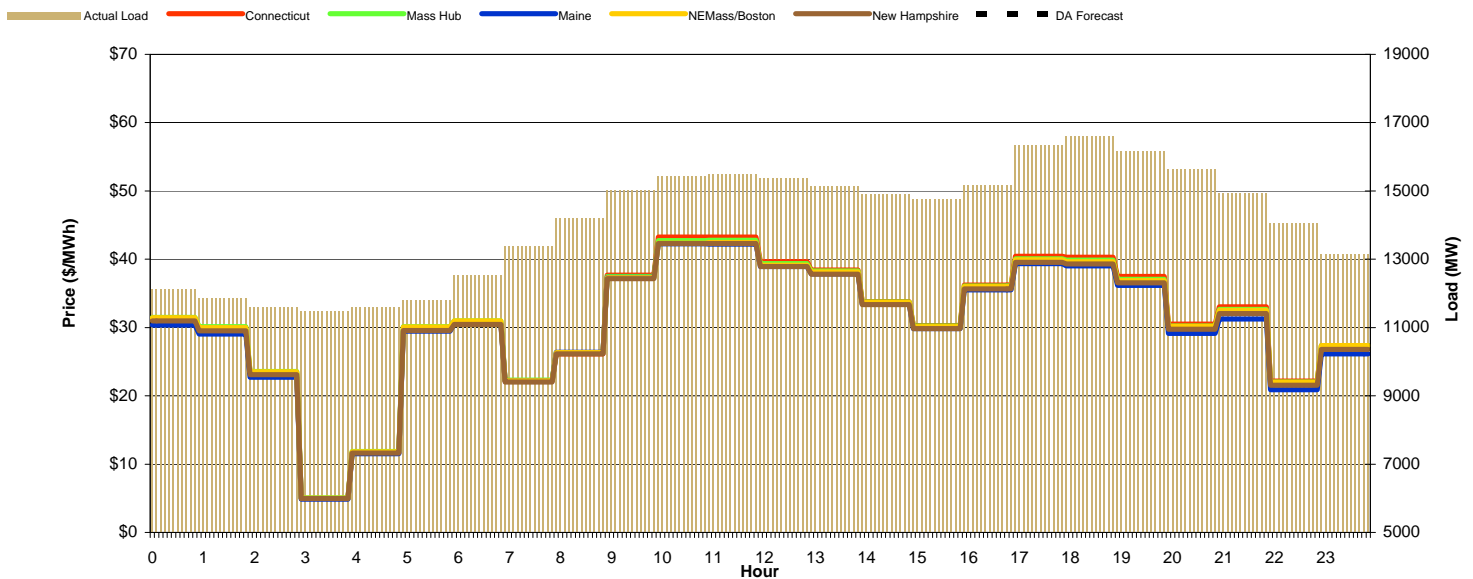




ISO-NE Daily Report

Sunday February 12, 2012

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	39.05	32.22	30.40	30.27	30.36	31.89	35.23	37.62	41.59	43.97	43.81	43.26	40.94	36.37	31.85	32.94	35.22	58.44	62.66	47.34	45.73	41.57	38.27	33.90	39.37	42.60	All	On Pk
NEMass/Boston	38.54	32.19	30.47	30.35	30.42	31.98	35.38	37.76	41.05	42.86	42.39	42.00	39.84	35.45	31.05	32.21	34.83	57.56	61.34	46.27	44.56	40.91	38.73	34.44	38.86	41.80		
New Hampshire	38.03	31.63	29.88	29.78	29.85	31.39	34.90	37.24	40.78	42.76	42.32	41.90	39.82	35.34	30.96	32.13	34.82	57.13	60.56	45.92	44.29	40.33	38.08	33.73	38.48	41.52		
Maine	37.46	31.17	29.42	29.32	29.42	31.01	34.74	37.22	40.92	42.86	42.00	41.55	39.41	35.01	30.76	32.16	34.94	56.52	59.26	45.06	43.42	39.00	37.39	33.12	38.05	41.09		
Mass Hub	38.79	32.33	30.60	30.49	30.53	32.04	35.43	37.78	41.45	43.55	43.13	42.64	40.40	35.88	31.44	32.58	35.14	58.27	62.14	46.86	45.25	41.33	38.83	34.46	39.22	42.29		
Cleared Load (GW)	12.0	11.6	11.7	11.8	11.8	11.7	12.4	13.0	14.3	14.8	14.8	14.7	14.6	14.3	14.2	14.2	15.0	17.0	17.1	16.4	15.9	14.9	13.9	13.0				

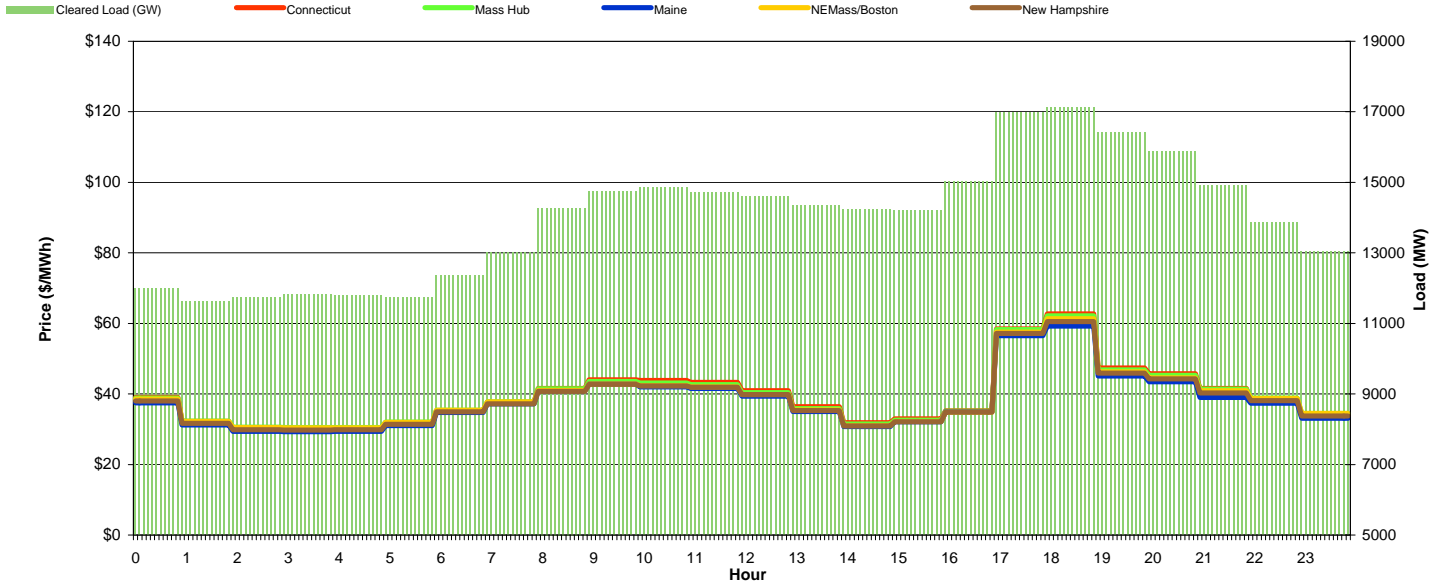

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$				
Connecticut	28.37	23.81	26.99	27.69	33.40	34.47	34.20	25.56	39.96	41.74	41.63	40.80	38.90	39.09	36.49	36.25	39.92	78.89	129.15	105.66	62.69	39.78	36.03	29.13	44.61	52.03	All	On Pk	
NEMass/Boston	28.20	23.90	27.09	27.71	33.44	34.69	34.39	25.65	39.69	41.01	40.51	39.59	37.93	38.29	35.89	35.94	39.70	78.68	129.19	105.05	61.70	39.15	36.13	29.55	44.29	51.51			
New Hampshire	27.72	23.45	26.58	27.15	32.78	34.08	33.85	25.41	39.51	40.89	40.37	39.46	37.69	38.00	35.58	35.67	39.45	77.58	127.00	103.55	60.78	38.64	35.51	28.85	43.73	50.94			
Maine	27.13	22.93	25.97	26.54	32.11	33.78	33.72	25.45	39.68	41.06	40.12	39.17	37.13	37.26	34.91	35.28	38.96	75.83	124.17	101.32	59.02	37.33	34.59	28.00	42.98	50.08			
Mass Hub	28.24	23.88	27.09	27.74	33.47	34.64	34.32	25.62	39.78	41.27	40.89	40.01	38.27	38.57	36.11	36.09	39.84	78.82	129.23	105.34	62.06	39.41	36.15	29.45	44.43	51.72			
DA Forecast Load (GW)	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
Forecast Error %	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!		

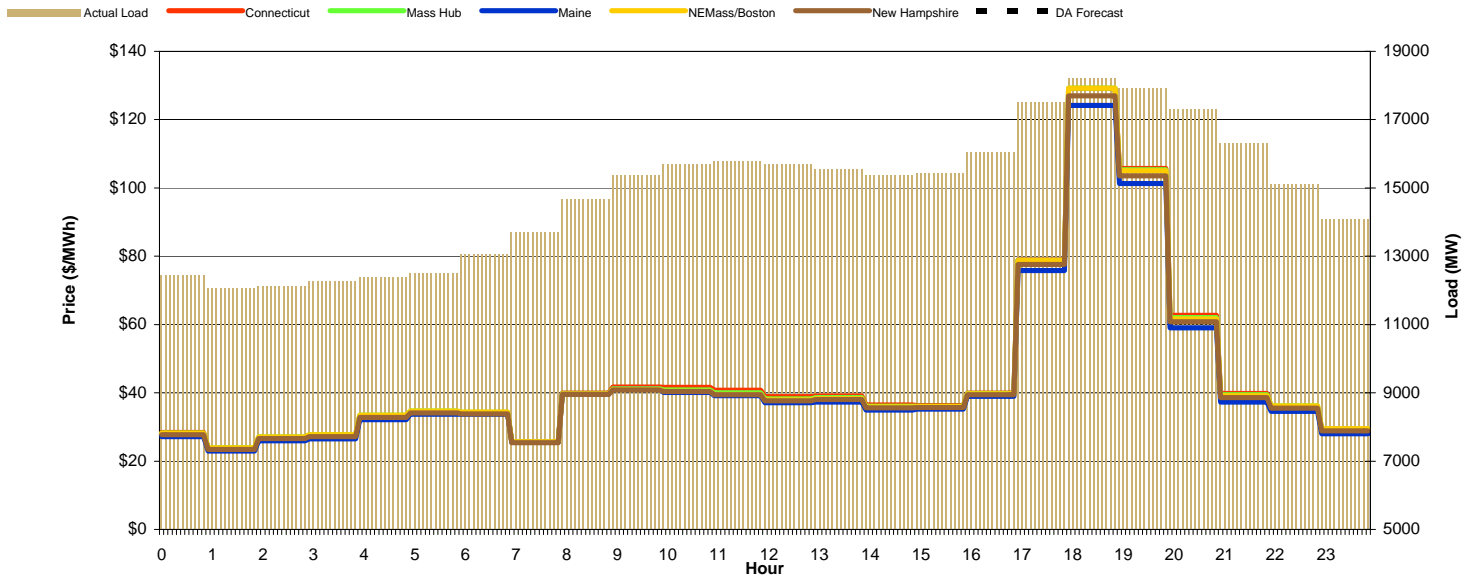




ISO-NE Daily Report

Monday February 13, 2012

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	34.08	32.91	33.22	31.74	34.70	41.13	53.70	60.01	49.87	53.00	43.10	42.22	38.35	35.39	33.30	33.76	35.11	65.08	69.79	56.67	46.48	41.11	41.01	34.52	43.34	46.52	All	On Pk
NEMass/Boston	34.38	33.17	33.45	31.95	35.06	41.18	52.79	58.62	49.13	52.04	42.34	41.49	37.82	34.97	32.72	33.24	34.84	64.55	68.62	55.57	46.00	40.22	40.50	34.85	42.90	45.79		
New Hampshire	33.43	32.26	32.58	31.18	34.20	40.59	52.41	57.91	48.77	51.79	42.38	41.49	37.75	34.84	32.60	33.13	34.80	64.11	68.09	55.40	46.04	40.09	39.82	34.07	42.49	45.56		
Maine	32.46	31.27	31.55	30.31	33.32	40.15	51.95	56.82	48.48	51.41	42.21	41.13	37.44	34.52	32.22	32.93	34.82	63.97	67.18	55.00	45.95	39.56	38.60	33.25	41.94	45.14		
Mass Hub	34.52	33.26	33.60	32.12	35.25	41.55	53.86	59.78	49.97	52.77	42.76	41.86	38.10	35.21	33.01	33.51	35.00	65.00	69.19	56.05	46.37	40.63	40.84	34.85	43.29	46.25		
Cleared Load (GW)	12.2	12.1	12.1	12.0	12.7	13.6	15.9	17.0	17.0	16.8	16.0	15.9	15.5	15.4	15.0	15.1	15.7	17.5	17.4	16.8	16.3	15.1	13.5	12.6				

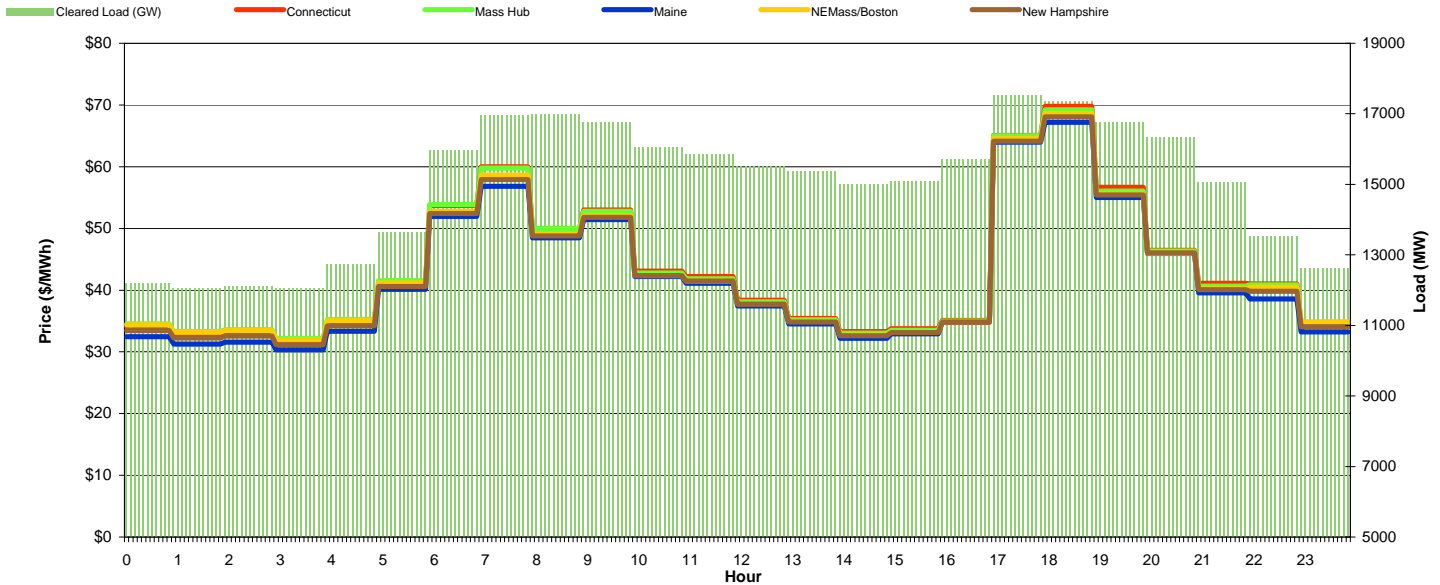

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	34.18	33.65	32.50	32.67	27.10	29.41	40.45	43.14	40.50	43.12	45.81	40.95	38.52	35.51	31.97	28.81	29.67	36.75	42.73	44.83	40.20	34.31	28.06	33.37	36.18	37.81	All	On Pk
NEMass/Boston	34.59	33.98	32.85	33.00	27.47	29.93	40.63	42.78	40.16	42.67	44.90	40.30	38.18	35.35	31.88	28.83	29.81	36.79	42.25	44.32	39.86	34.22	28.48	34.05	36.14	37.55		
New Hampshire	33.69	33.12	32.07	32.26	26.91	29.56	40.24	42.44	39.92	42.49	44.70	40.11	37.88	34.97	31.45	28.40	29.38	36.27	41.94	43.94	39.58	33.75	27.88	33.30	35.68	37.19		
Maine	32.52	32.03	30.96	31.28	26.34	29.38	39.83	42.09	39.89	42.10	43.58	38.90	36.84	34.01	30.77	27.82	28.85	35.82	41.49	43.21	38.86	32.86	27.19	32.50	34.96	36.52		
Mass Hub	34.55	33.98	32.86	33.02	27.45	29.90	40.63	42.94	40.34	42.89	45.29	40.61	38.40	35.48	31.96	28.88	29.82	36.77	42.41	44.54	40.06	34.30	28.40	33.92	36.23	37.69		
DA Forecast Load (GW)	13.05	12.67	12.59	12.67	13.07	14.32	16.42	17.55	17.61	17.52	17.42	17.25	16.90	16.64	16.38	16.33	16.92	18.25	18.72	18.34	17.63	16.47	15.00	13.69				
Forecast Error %	3.1%	3.4%	4.8%	4.2%	3.9%	3.0%	-1.9%	-2.1%	-1.9%	-2.0%	-1.9%	-1.9%	-1.8%	-1.8%	-2.1%	-2.6%	-3.9%	-3.7%	-2.7%	-2.5%	-2.0%	-1.4%	-1.5%	-1.7%				

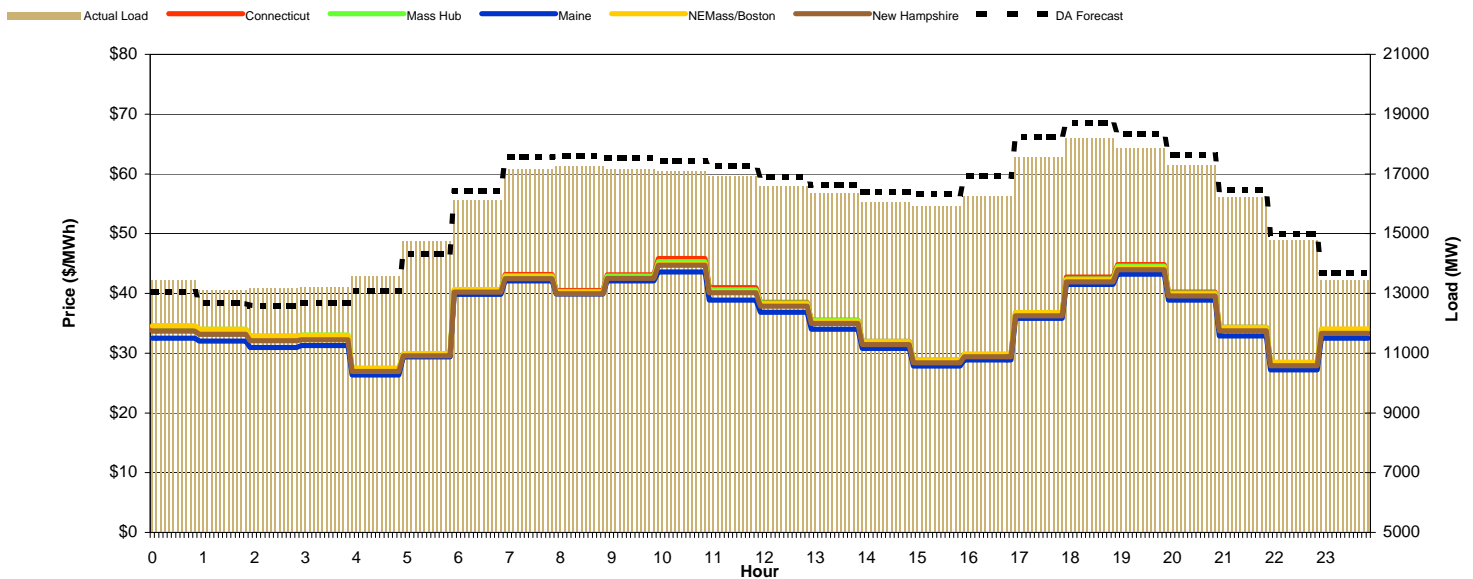




ISO-NE Daily Report

Tuesday February 14, 2012

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$				
Connecticut	30.56	25.30	27.05	25.74	28.04	31.25	34.56	35.58	33.78	34.38	35.02	35.17	35.00	33.18	31.76	29.04	31.65	41.79	42.90	37.00	32.07	28.27	28.88	30.58	31.80	32.44	34.09	All	On Pk
NEMass/Boston	30.52	25.39	27.09	25.76	28.17	31.03	34.18	34.65	32.94	33.40	33.97	34.05	33.77	31.95	30.71	28.04	30.70	41.07	41.75	35.87	30.96	27.82	28.48	31.01	31.80	33.13	33.12		
New Hampshire	29.93	24.96	26.61	25.35	27.71	30.85	34.15	34.70	32.98	33.44	34.00	34.04	33.80	31.90	30.65	28.11	30.74	41.04	41.63	35.90	31.01	27.84	28.17	30.43	31.66	33.12	33.12		
Maine	29.20	24.37	26.00	24.87	27.27	30.86	34.34	34.75	32.91	33.25	33.51	33.18	33.07	31.00	29.98	27.57	30.39	40.78	41.00	35.69	30.63	27.58	27.63	29.90	31.24	32.68	33.59		
Mass Hub	30.66	25.52	27.20	25.89	28.21	31.18	34.56	35.13	33.32	33.80	34.51	34.60	34.35	32.52	31.23	28.50	31.17	41.63	42.31	36.30	31.36	28.07	28.70	30.95	32.15	33.59	33.59		
Cleared Load (GW)	11.7	11.4	11.5	11.4	11.5	12.4	14.9	15.6	15.4	15.4	15.5	15.5	15.2	15.1	14.9	15.1	15.6	17.1	16.9	16.4	15.8	14.6	13.2	11.8					

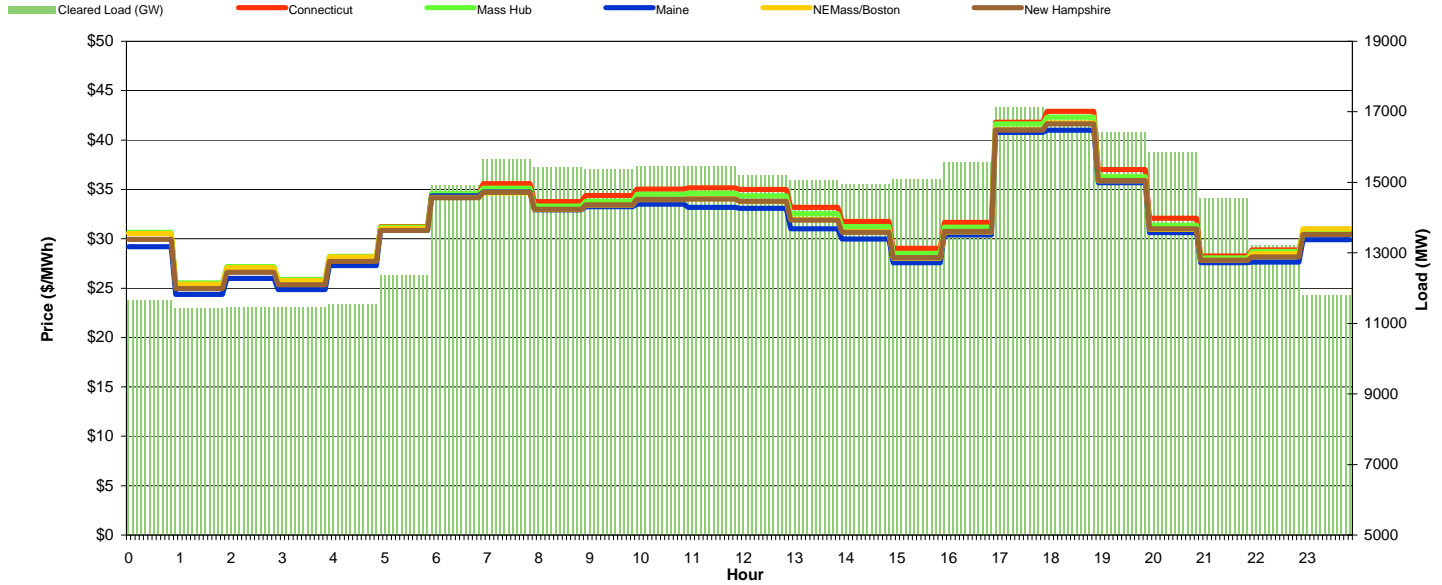

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	24.44	22.24	25.63	27.82	28.11	32.79	37.58	38.22	36.79	43.56	37.06	33.59	31.99	30.41	27.57	27.83	28.04	36.67	40.49	42.22	30.21	25.77	25.99	25.89	31.70	33.53	All	On Pk
NEMass/Boston	24.69	22.37	25.69	27.83	28.21	32.81	37.33	37.57	36.04	42.37	36.11	32.74	31.09	29.55	26.92	27.26	27.49	36.33	39.68	41.02	29.31	25.31	25.65	25.99	31.22	32.78		
New Hampshire	24.20	21.96	25.26	27.42	27.80	32.55	37.26	37.53	36.03	42.44	36.18	32.77	31.09	29.54	26.85	27.25	27.45	36.19	39.56	40.94	29.22	25.12	25.29	25.55	31.06	32.72		
Maine	23.73	21.50	24.89	27.14	27.61	32.80	37.57	37.58	35.85	42.08	35.85	32.27	30.54	28.94	26.33	26.90	27.16	35.98	39.31	40.62	28.82	24.72	24.75	25.17	30.75	32.36		
Mass Hub	24.66	22.37	25.73	27.89	28.24	32.86	37.49	37.82	36.33	42.81	36.45	33.05	31.40	29.84	27.11	27.42	27.64	36.47	39.94	41.41	29.62	25.48	25.82	26.00	31.41	33.04		
DA Forecast Load (GW)	12.82	12.36	12.14	12.11	12.46	13.62	15.61	16.59	16.65	16.58	16.51	16.34	16.10	15.97	15.77	15.86	16.42	17.73	18.05	17.60	16.87	15.75	14.30	12.99				
Forecast Error %	-1.6%	0.3%	0.4%	1.0%	-0.6%	-2.0%	-1.2%	-0.6%	-0.5%	-0.5%	-0.2%	0.0%	0.2%	0.2%	0.2%	-0.9%	-2.4%	-2.8%	-1.6%	-1.4%	-1.1%	-0.7%	0.9%	-0.1%				

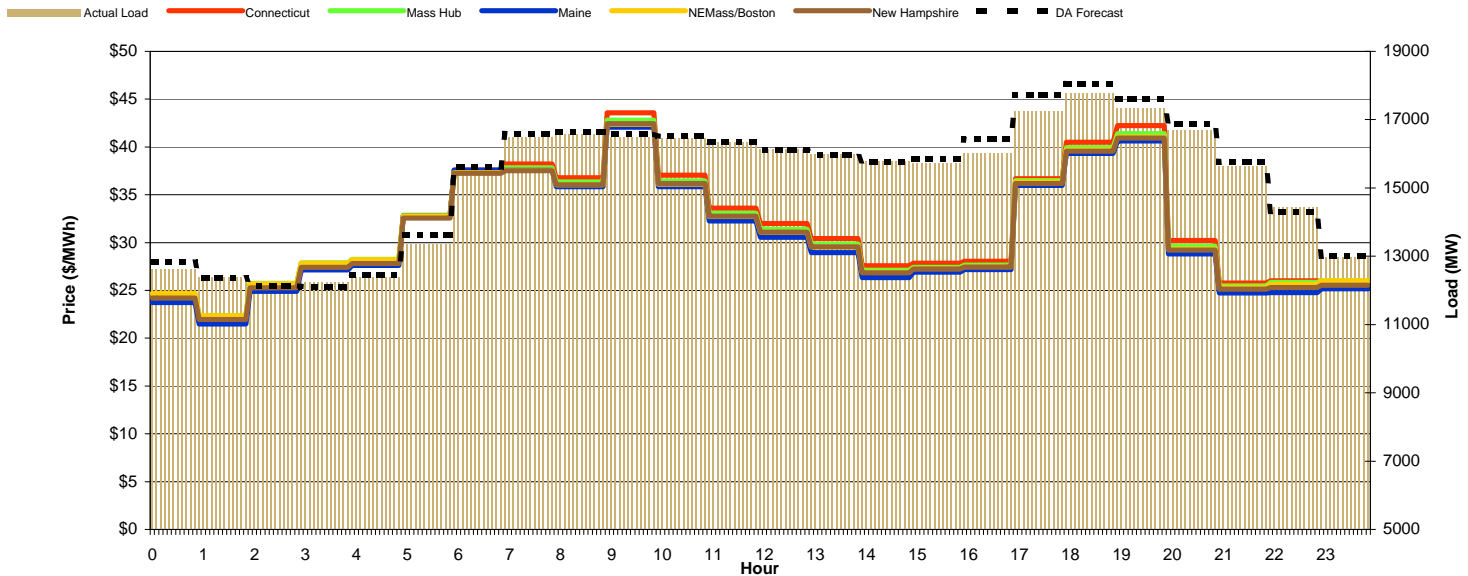




ISO-NE Daily Report

Wednesday February 15, 2012

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
																										All	On Pk	
Connecticut	26.57	24.42	23.71	23.86	25.20	28.00	33.54	35.88	36.94	37.25	35.08	33.62	32.08	29.78	27.32	26.89	31.73	41.67	43.13	35.70	33.45	29.03	29.94	27.61	31.35	33.72		
NEMass/Boston	26.58	24.39	23.59	23.68	25.26	27.96	32.73	34.75	35.59	35.83	33.73	32.44	31.01	28.67	26.38	26.03	30.58	40.15	41.47	34.14	32.04	28.18	29.32	27.72	30.51	32.52		
New Hampshire	26.30	24.13	23.38	23.48	25.02	27.64	32.77	34.76	35.45	35.66	33.63	32.22	30.83	28.51	26.26	25.92	30.50	39.93	41.32	34.15	31.99	28.05	28.98	27.32	30.34	32.39		
Maine	26.42	24.11	23.41	23.54	25.23	82.56	40.00	34.92	35.31	35.30	33.43	31.76	30.20	27.81	25.69	25.53	30.12	39.54	40.78	33.76	31.53	27.41	28.64	27.01	32.67	31.98		
Mass Hub	26.70	24.41	23.66	23.82	25.32	28.15	33.06	35.11	36.12	36.43	34.16	32.96	31.49	29.12	26.79	26.35	30.88	40.88	42.16	34.58	32.66	28.76	29.77	27.97	30.89	33.01		
Cleared Load (GW)	11.3	11.1	11.0	11.1	11.3	11.8	14.1	14.7	14.8	14.9	14.8	14.9	14.9	14.7	14.6	14.4	14.7	16.2	16.0	15.5	15.3	14.3	13.0	11.9				

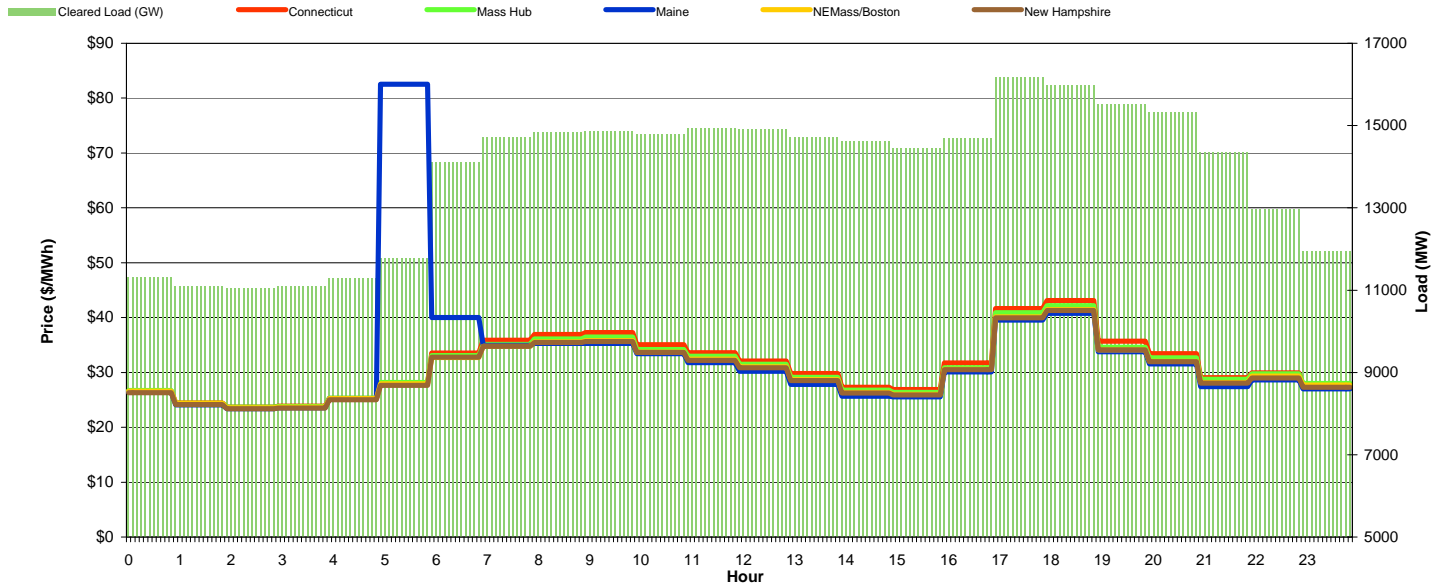

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
																										All	On Pk	
Connecticut	28.86	25.89	24.31	23.68	23.36	27.19	37.93	34.95	43.11	44.08	42.06	33.47	31.40	31.62	32.14	32.96	40.72	41.10	37.95	31.64	25.51	23.59	25.56	32.28	34.87			
NEMass/Boston	28.97	25.87	24.40	23.70	23.41	27.24	37.35	34.36	42.01	42.79	40.79	32.60	30.69	30.67	31.17	31.97	39.71	40.09	36.84	30.57	24.88	23.23	25.63	31.65	33.94			
New Hampshire	28.59	25.61	24.14	23.45	23.14	27.02	37.26	34.23	41.78	42.53	40.52	32.33	30.41	30.38	30.37	30.93	31.77	39.35	39.72	36.49	30.28	24.56	22.88	25.23	31.37	33.66		
Maine	28.60	25.61	24.17	23.54	23.37	27.56	37.99	34.45	41.81	42.24	39.86	31.62	29.56	29.34	29.39	30.15	31.04	38.71	39.11	35.72	29.45	23.84	22.56	24.97	31.03	33.05		
Mass Hub	28.97	25.93	24.44	23.76	23.45	27.30	37.60	34.59	42.41	43.26	41.35	33.11	31.12	31.18	31.17	31.68	32.49	40.28	40.65	37.45	31.11	25.18	23.43	25.76	31.99	34.40		
DA Forecast Load (GW)	12.08	11.64	11.44	11.43	11.78	12.89	14.90	15.96	16.07	16.03	15.99	15.89	15.67	15.55	15.38	15.34	15.80	17.02	17.44	17.06	16.41	15.34	13.94	12.66				
Forecast Error %	0.1%	1.8%	4.0%	3.9%	1.2%	-1.1%	-1.2%	-0.4%	0.4%	0.9%	1.5%	1.8%	2.0%	2.0%	2.1%	1.9%	0.9%	0.4%	0.7%	0.6%	0.5%	1.2%	2.6%	2.5%				

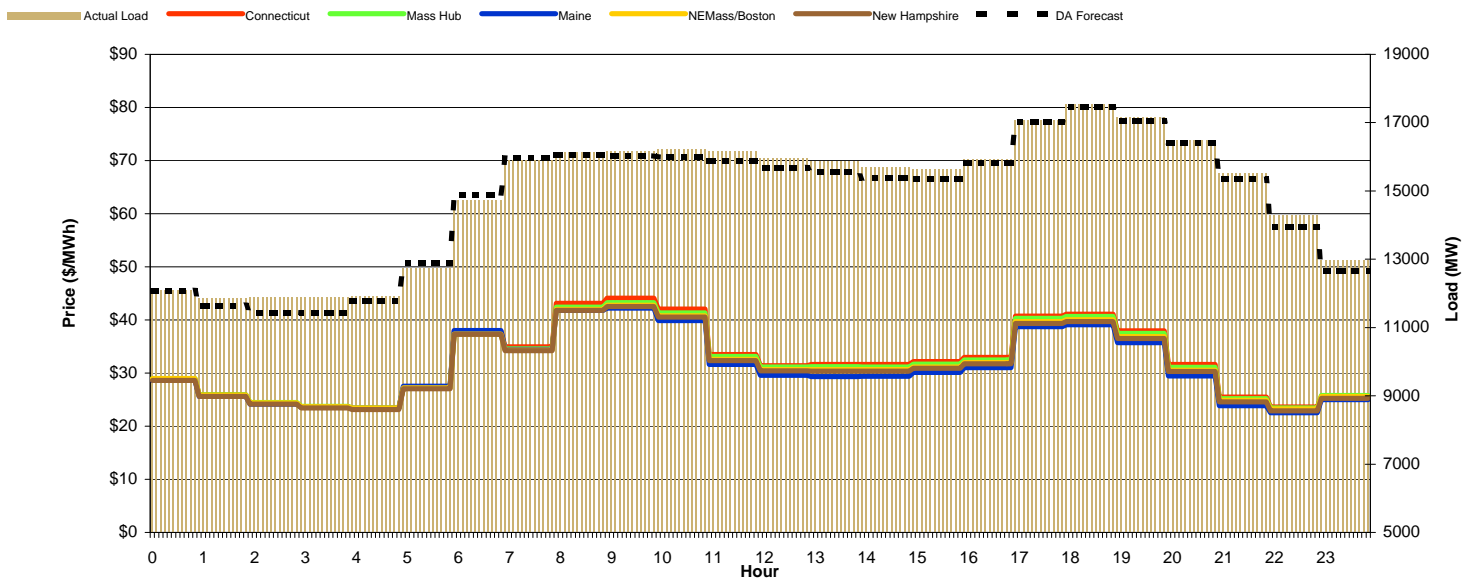




ISO-NE Daily Report

Thursday February 16, 2012

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$	
Connecticut	25.70	24.85	23.93	23.96	24.03	26.53	31.89	32.74	33.72	31.85	29.83	30.96	30.21	28.85	26.54	28.58	32.00	44.70	44.00	38.00	30.67	26.60	24.27	26.27	30.03	32.10
NEMass/Boston	25.43	24.62	23.69	23.64	23.84	26.51	31.42	32.11	32.74	31.01	28.93	29.86	29.14	27.83	25.62	27.67	30.91	43.31	42.35	36.52	29.50	25.76	24.16	26.21	29.28	31.09
New Hampshire	25.07	24.33	23.38	23.34	23.55	26.30	31.34	32.05	32.57	30.85	28.78	29.71	29.04	27.70	25.52	27.58	30.79	43.04	41.97	36.36	29.32	25.79	24.04	25.96	29.10	30.94
Maine	24.86	24.07	23.05	23.10	23.31	26.54	31.53	32.46	32.67	30.83	28.55	29.24	28.53	27.11	25.01	27.19	30.34	42.42	41.24	35.97	28.85	25.40	24.14	25.98	28.85	30.62
Mass Hub	25.74	24.94	23.97	23.96	24.13	26.75	32.09	32.80	33.43	31.66	29.49	30.54	29.82	28.43	26.19	28.32	31.64	44.29	43.29	37.30	30.14	26.24	24.38	26.42	29.83	31.75
Cleared Load (GW)	11.5	11.4	11.3	11.3	11.6	12.1	14.6	15.5	15.3	15.4	15.3	15.2	15.1	15.0	14.8	14.9	15.4	16.2	16.1	15.7	15.4	14.3	13.1	11.8		

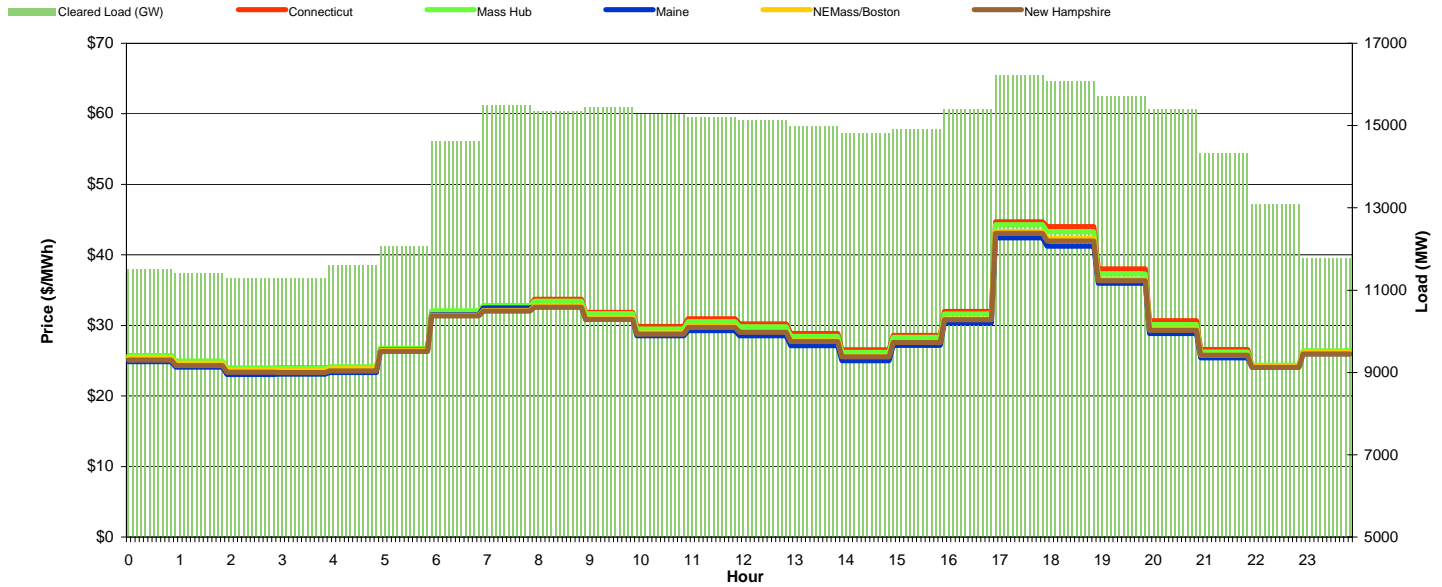

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$	
Connecticut	26.86	24.65	24.19	24.21	25.33	25.72	25.62	29.85	29.71	28.93	29.57	31.50	30.94	30.72	30.01	31.35	40.04	62.71	43.71	53.19	33.73	29.87	29.16	35.25	32.37	35.31
NEMass/Boston	26.64	24.41	24.05	24.07	25.29	25.71	25.48	29.67	29.24	28.44	29.00	30.66	30.12	29.85	29.14	30.43	38.75	61.54	43.05	52.04	32.78	29.15	29.11	36.16	31.87	34.56
New Hampshire	26.24	24.09	23.71	23.74	24.93	25.41	25.32	29.53	28.99	28.19	28.78	30.47	29.94	29.63	28.90	30.26	38.65	61.58	43.20	52.17	32.87	29.26	29.12	36.03	31.71	34.47
Maine	25.95	23.75	23.34	23.42	24.72	25.34	25.39	29.72	28.78	27.88	28.30	29.62	29.02	28.74	28.07	29.51	37.79	61.47	43.05	51.95	32.52	28.82	28.86	36.55	31.36	34.01
Mass Hub	26.89	24.65	24.26	24.28	25.48	25.93	25.70	29.92	29.56	28.76	29.34	31.11	30.56	30.30	29.57	30.89	39.39	62.22	43.50	52.66	33.26	29.53	29.28	36.04	32.21	34.99
DA Forecast Load (GW)	11.84	11.46	11.31	11.34	11.73	12.94	15.02	16.01	16.14	16.07	16.04	15.93	15.70	15.67	15.58	15.54	16.03	17.14	17.53	17.15	16.41	15.36	13.97	12.65		
Forecast Error %	4.7%	4.8%	4.7%	4.7%	4.3%	3.1%	-0.8%	-0.6%	-0.6%	0.1%	0.2%	0.4%	1.2%	1.4%	1.3%	1.8%	1.9%	1.5%	0.9%	0.7%	1.2%	1.1%	0.9%	1.0%		

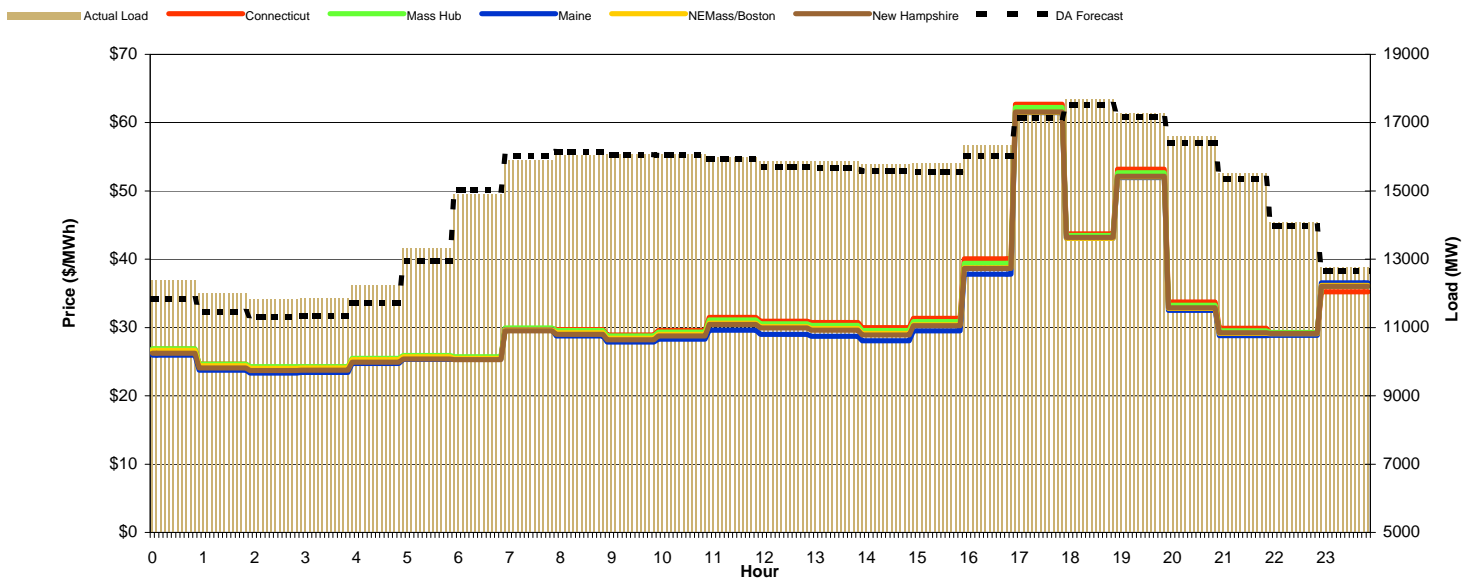




ISO-NE Daily Report

Friday February 17, 2012

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	24.20	22.73	22.53	22.11	22.09	24.24	28.97	27.32	30.44	32.97	32.15	31.98	31.28	29.27	25.64	25.86	26.41	37.86	41.59	35.35	30.24	28.56	29.00	30.86	28.90	31.00	All	On Pk
NEMass/Boston	24.08	22.53	22.31	21.96	21.95	24.31	28.64	26.52	29.22	31.41	30.63	30.50	29.89	27.97	24.59	24.82	25.52	36.58	39.83	33.90	28.89	27.83	28.76	30.96	28.07	29.80		
New Hampshire	23.74	22.22	22.01	21.61	21.65	24.04	28.42	26.44	29.02	31.18	30.46	30.26	29.64	27.77	24.43	24.70	25.34	36.11	39.28	33.41	28.51	27.50	28.52	30.40	27.78	29.54		
Maine	23.71	22.11	21.89	21.51	21.60	27.00	28.44	26.44	28.65	30.50	29.72	29.37	28.66	26.79	23.73	24.06	24.86	35.26	38.13	32.61	27.77	26.86	28.48	30.04	27.42	28.87		
Mass Hub	24.26	22.50	22.50	22.11	22.10	24.38	29.24	27.18	29.98	32.16	31.29	31.25	30.72	28.73	25.14	25.38	26.04	37.40	40.66	34.70	29.64	28.16	28.76	31.26	28.56	30.45		
Cleared Load (GW)	11.0	10.5	10.6	10.7	11.0	11.4	13.7	14.9	15.0	14.8	14.8	14.8	14.9	14.7	14.4	14.4	14.8	15.9	15.8	15.5	15.1	13.4	12.1	11.6				

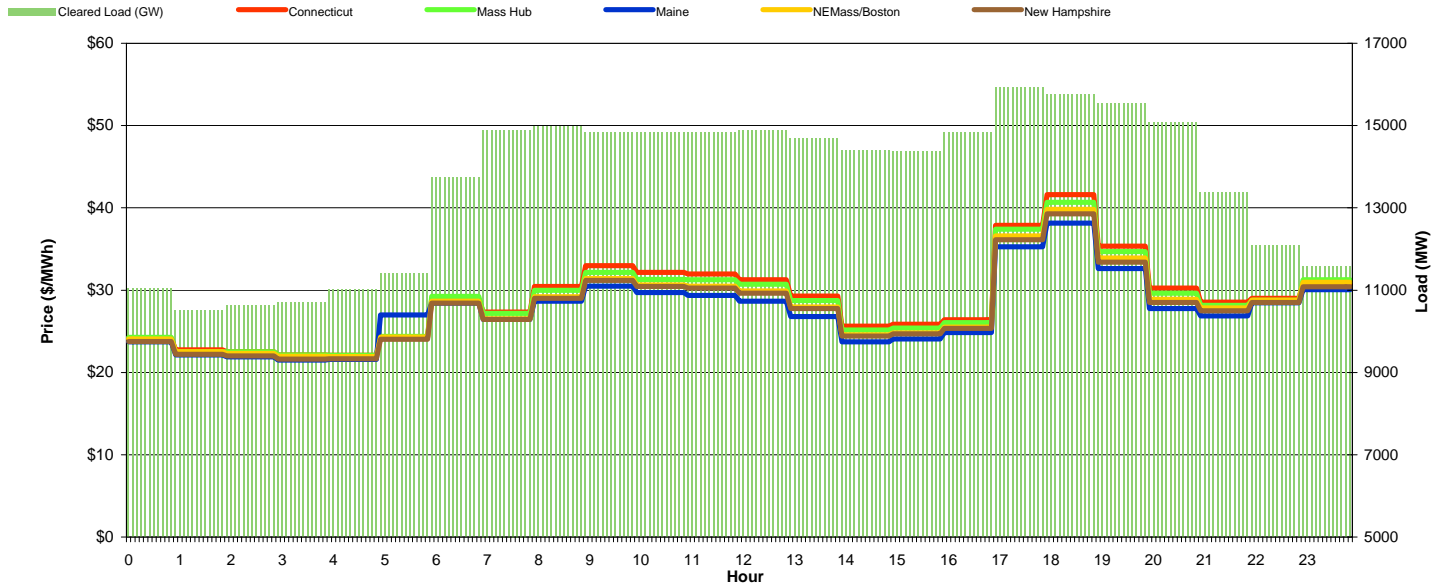

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	44.54	30.52	31.47	32.44	32.86	24.61	31.88	30.22	36.32	41.23	35.36	30.24	29.02	28.56	26.59	26.24	26.31	36.55	35.67	30.80	30.68	28.31	32.66	32.16	31.89	31.55	All	On Pk
NEMass/Boston	45.24	30.89	31.76	32.91	33.38	24.95	32.03	29.93	35.57	40.17	34.51	29.63	28.47	28.07	26.25	25.94	26.13	36.21	35.24	30.21	29.89	27.61	32.41	32.42	31.66	31.02		
New Hampshire	45.05	30.83	31.71	32.83	33.31	24.93	32.04	29.96	35.59	40.11	34.46	29.49	28.35	27.99	26.16	25.84	25.93	35.98	35.07	30.00	29.67	27.50	32.36	32.18	31.56	30.90		
Maine	45.61	31.11	31.90	33.15	33.74	25.34	32.10	29.99	35.59	39.75	34.12	28.74	27.64	27.36	25.61	25.32	25.53	35.47	34.57	29.24	28.64	26.50	31.69	31.71	31.27	30.36		
Mass Hub	45.17	30.91	31.85	32.97	33.43	25.01	32.25	30.25	36.10	40.85	35.04	30.04	28.83	28.40	26.51	26.18	26.34	36.57	35.61	30.63	30.36	28.03	32.70	32.52	31.94	31.40		
DA Forecast Load (GW)	11.67	11.24	11.02	11.00	11.32	12.39	14.26	15.41	15.68	15.83	15.90	15.86	15.62	15.44	15.23	15.13	15.44	16.29	16.72	16.29	15.71	14.89	13.81	12.69				
Forecast Error %	1.8%	2.6%	4.6%	5.0%	3.6%	1.7%	-0.7%	-0.2%	0.2%	-0.2%	-0.3%	-0.9%	-1.1%	-1.1%	-1.4%	-1.9%	-2.4%	-1.3%	-0.5%	-0.4%	-0.1%	0.4%	0.4%	0.1%				

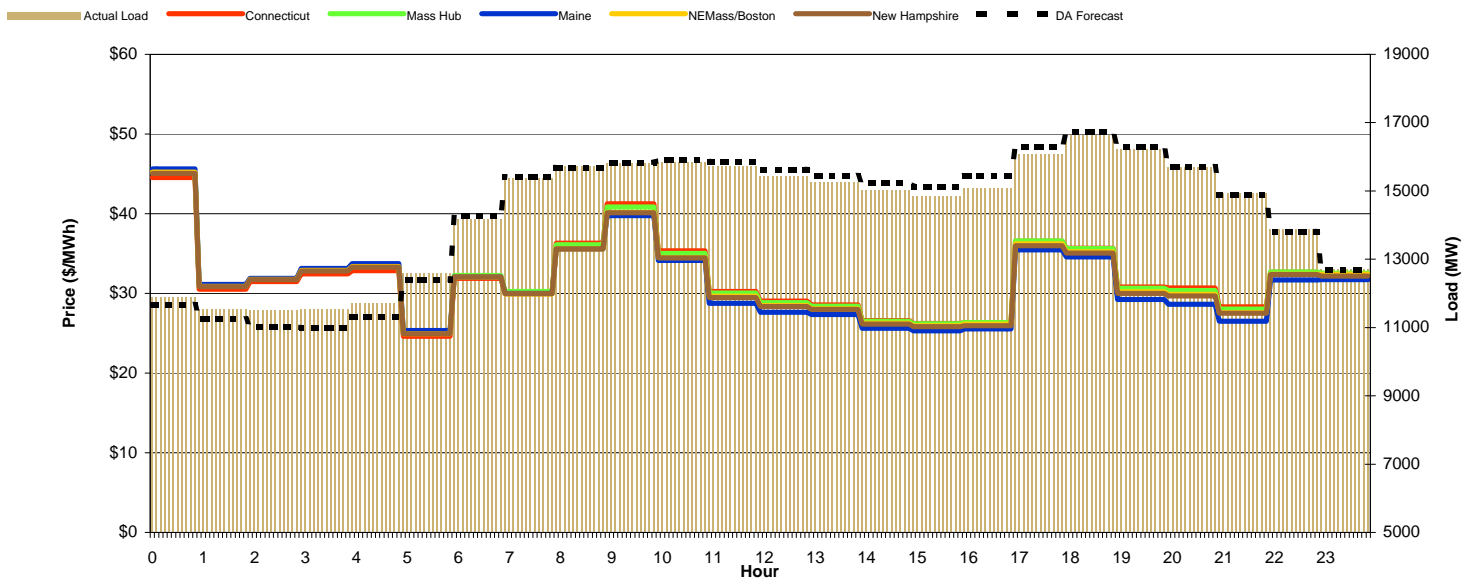




ISO-NE Daily Report

Saturday February 18, 2012

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$				
Connecticut	28.40	28.03	28.56	27.20	27.50	27.79	27.60	27.96	29.20	30.93	31.69	31.50	29.96	28.11	26.92	27.06	30.15	38.18	42.22	34.81	32.86	30.94	30.75	29.63	29.63	30.33	31.45	All	On Pk
NEMass/Boston	28.54	28.13	28.64	27.45	27.70	27.90	27.75	26.84	28.88	30.32	30.96	30.75	29.39	27.70	26.50	26.68	29.61	37.42	41.24	34.14	32.05	30.39	29.49	29.74	29.93	30.77			
New Hampshire	28.50	28.13	28.59	27.40	27.67	27.88	27.82	26.96	28.91	30.21	30.83	30.59	29.28	27.57	26.37	26.57	29.49	37.32	40.97	33.96	31.94	30.37	29.50	29.79	29.86	30.68			
Maine	28.47	27.94	28.16	27.04	27.34	27.66	27.74	27.25	28.93	29.48	29.91	29.55	28.50	26.81	25.63	25.86	28.91	36.28	39.75	32.98	31.00	29.54	28.93	29.80	29.31	29.96			
Mass Hub	28.68	28.33	28.80	27.49	27.75	27.98	27.78	26.73	29.01	30.54	31.21	30.98	29.55	27.78	26.60	26.77	29.73	37.73	41.63	34.42	32.30	30.55	29.49	29.89	30.07	30.94			
Cleared Load (GW)	11.3	11.1	11.0	10.9	10.9	11.1	11.5	12.3	13.4	13.9	14.0	13.8	13.5	13.1	12.9	13.0	13.6	15.0	15.3	14.9	14.2	13.4	12.4	11.4					

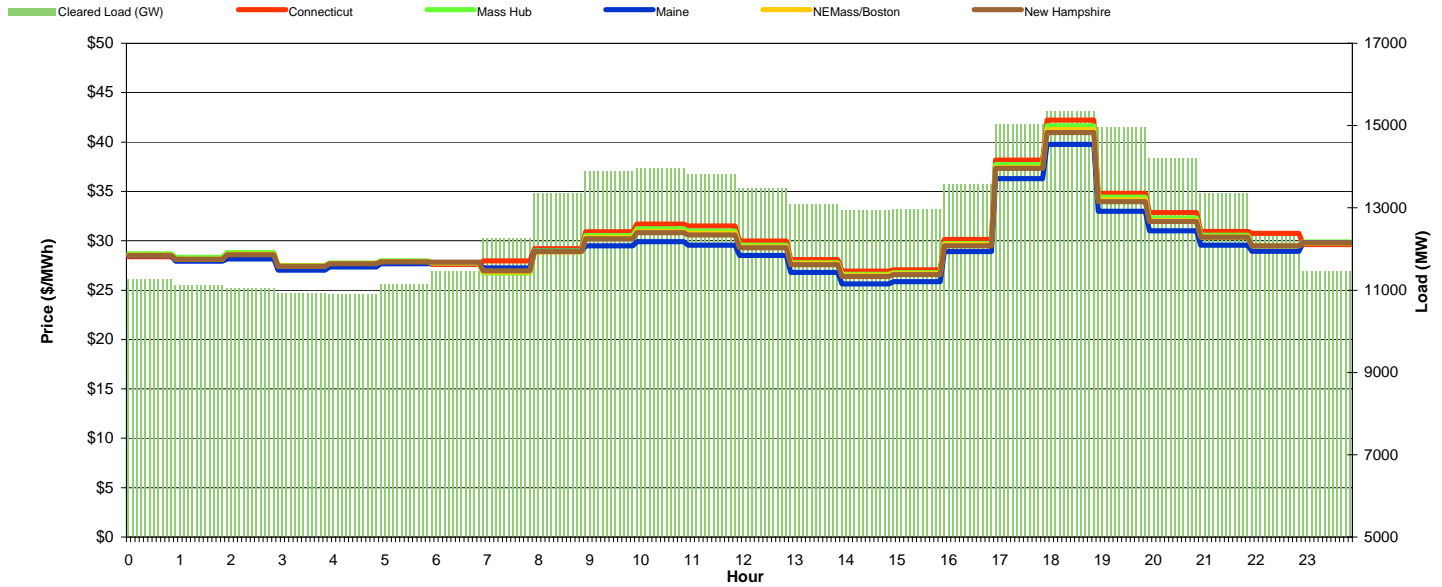

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	24.17	23.48	24.10	23.75	24.34	25.40	24.42	27.93	30.49	31.02	30.99	29.90	28.38	25.80	26.67	26.51	28.60	31.59	30.71	28.43	28.64	29.41	24.32	25.95	27.29	28.71	All	On Pk
NEMass/Boston	24.74	23.91	24.50	24.08	24.66	25.64	24.70	27.97	30.26	30.60	30.48	29.49	28.08	25.67	26.47	26.32	28.34	31.37	30.42	28.26	28.24	28.96	24.21	26.18	27.23	28.45		
New Hampshire	24.47	23.71	24.33	23.93	24.52	25.54	24.69	28.07	30.37	30.64	30.51	29.47	28.06	25.61	26.43	26.31	28.36	31.41	30.44	28.22	28.19	28.96	24.17	26.09	27.19	28.45		
Maine	24.24	23.45	24.03	23.57	24.25	25.40	24.75	28.21	30.27	29.96	29.77	28.69	27.31	24.93	25.74	25.69	27.80	30.74	29.80	27.46	27.15	27.86	23.37	25.51	26.66	27.80		
Mass Hub	24.70	23.93	24.56	24.13	24.67	25.67	24.70	28.02	30.38	30.76	30.63	29.57	28.12	25.67	26.49	26.34	28.37	31.38	30.44	28.23	28.29	29.04	24.21	26.08	27.27	28.50		
DA Forecast Load (GW)	11.88	11.42	11.17	11.10	11.23	11.71	12.50	13.25	14.12	14.59	14.63	14.52	14.25	13.95	13.74	13.75	14.30	15.42	15.91	15.54	15.02	14.31	13.41	12.45				
Forecast Error %	1.6%	3.8%	6.6%	6.4%	4.5%	2.3%	-0.9%	-0.6%	-1.1%	-0.8%	0.0%	0.2%	0.1%	-0.2%	-0.3%	-0.3%	-1.3%	-1.0%	-0.6%	-0.9%	-0.6%	-0.4%	-0.3%	0.2%				

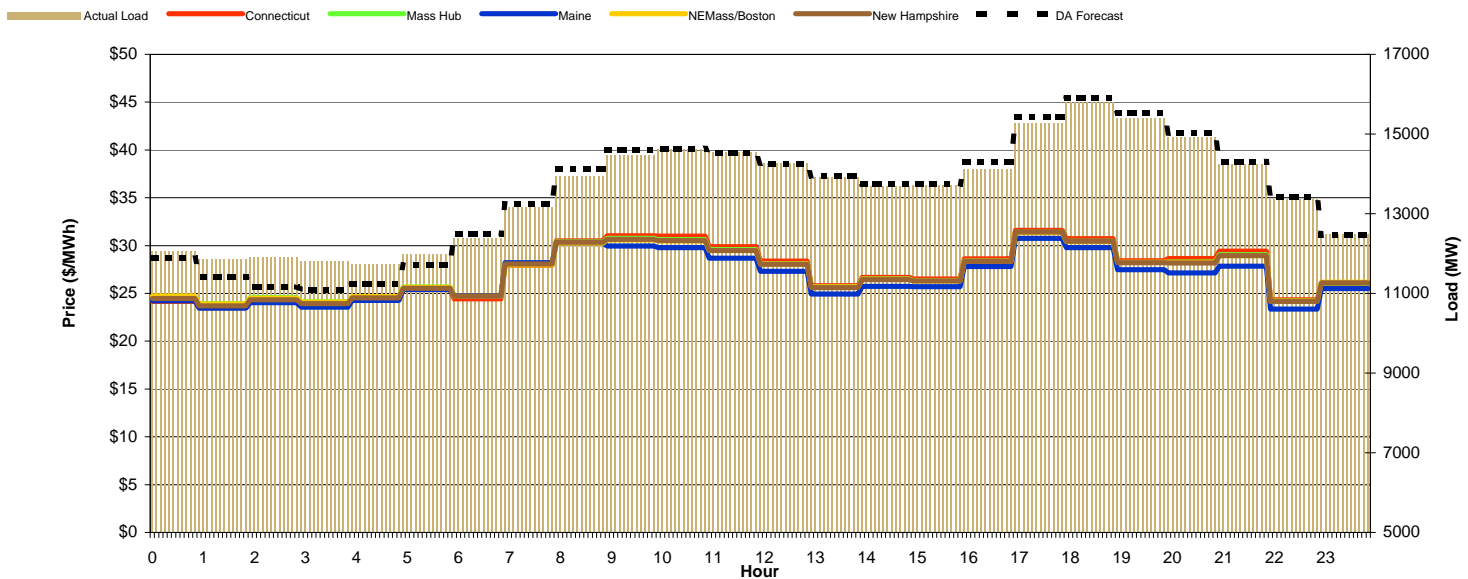




ISO-NE Daily Report

Sunday February 19, 2012

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	26.80	25.20	25.10	24.83	24.99	25.18	26.09	20.70	22.68	27.44	28.74	28.89	29.02	28.88	28.19	28.46	28.06	32.30	43.60	36.67	31.72	31.16	28.80	25.83	28.31	29.71	All	On Pk
NEMass/Boston	26.78	25.20	25.28	24.91	25.11	25.18	25.98	20.39	22.40	26.73	27.89	27.94	28.09	27.98	27.34	27.60	27.62	31.80	42.66	35.92	30.86	30.30	28.35	25.92	27.84	28.99	28.33	24.67
New Hampshire	26.90	25.33	25.35	25.01	25.17	25.31	26.21	20.51	22.47	26.82	27.99	28.05	28.21	28.05	27.41	27.71	27.71	31.94	42.80	35.95	30.93	30.41	28.46	25.94	27.94	29.09	28.33	24.67
Maine	26.86	25.20	25.23	24.80	24.98	25.17	26.11	20.23	22.31	26.41	27.49	27.52	27.69	27.53	26.90	27.29	27.39	31.79	42.45	35.38	30.51	30.15	28.27	25.90	27.65	28.71	28.33	24.67
Mass Hub	26.88	25.35	25.33	25.01	25.17	25.33	26.15	20.52	22.53	27.07	28.25	28.33	28.43	28.28	27.66	27.91	27.79	32.14	43.26	36.38	31.24	30.72	28.63	26.05	28.10	29.32	28.33	24.67
Cleared Load (GW)	11.3	10.8	10.6	10.7	10.8	10.9	11.2	12.0	13.0	13.5	13.7	13.7	13.6	13.4	13.1	13.2	14.0	15.8	16.1	15.7	14.9	13.9	13.0	12.0				

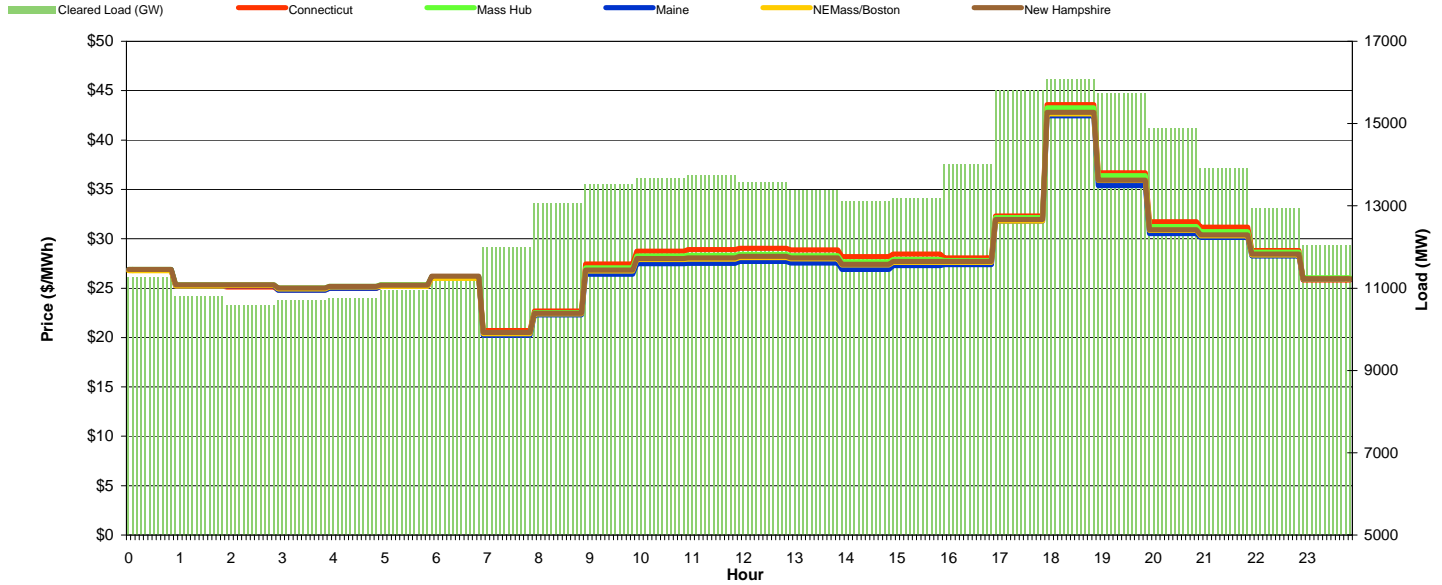

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	26.98	24.70	24.38	23.95	24.14	24.16	22.07	23.52	23.84	24.38	25.56	26.44	25.46	24.02	21.70	21.34	22.16	25.59	26.88	26.00	26.89	24.98	26.02	23.83	24.54	24.67	All	On Pk
NEMass/Boston	27.02	24.65	24.37	23.95	24.12	24.07	21.75	22.98	23.26	23.67	24.78	25.57	24.67	23.28	21.12	20.88	21.66	25.17	26.37	25.56	26.28	24.42	25.68	23.87	24.13	24.08	24.54	24.67
New Hampshire	26.97	24.63	24.37	23.96	24.12	24.04	21.76	23.07	23.36	23.69	24.81	25.60	24.71	23.28	21.09	20.89	21.65	25.19	26.45	25.57	26.30	24.42	25.51	23.70	24.13	24.10	24.54	24.10
Maine	26.59	24.33	24.01	23.61	23.78	23.73	21.25	22.38	22.88	23.15	24.12	24.80	23.97	22.58	20.49	20.33	21.00	24.65	25.91	24.93	25.61	23.97	25.10	23.40	23.61	23.49	23.85	24.25
Mass Hub	27.00	24.66	24.38	23.97	24.14	24.10	21.86	23.16	23.44	23.88	25.02	25.83	24.91	23.49	21.26	20.99	21.78	25.27	26.49	25.69	26.46	24.59	25.78	23.85	24.25	24.25	23.85	24.25
DA Forecast Load (GW)	11.68	11.22	11.03	10.95	11.04	11.42	11.97	12.53	13.38	13.93	13.99	14.08	14.00	13.80	13.65	13.72	14.38	15.71	16.29	16.00	15.52	14.63	13.52	12.53				
Forecast Error %	0.9%	2.1%	1.8%	3.6%	2.9%	0.9%	0.2%	0.5%	0.1%	-1.2%	-0.3%	-0.8%	-1.0%	-1.4%	-2.1%	-2.9%	-4.2%	-4.1%	-2.1%	-2.3%	-2.4%	-1.7%	-1.0%	-0.7%				

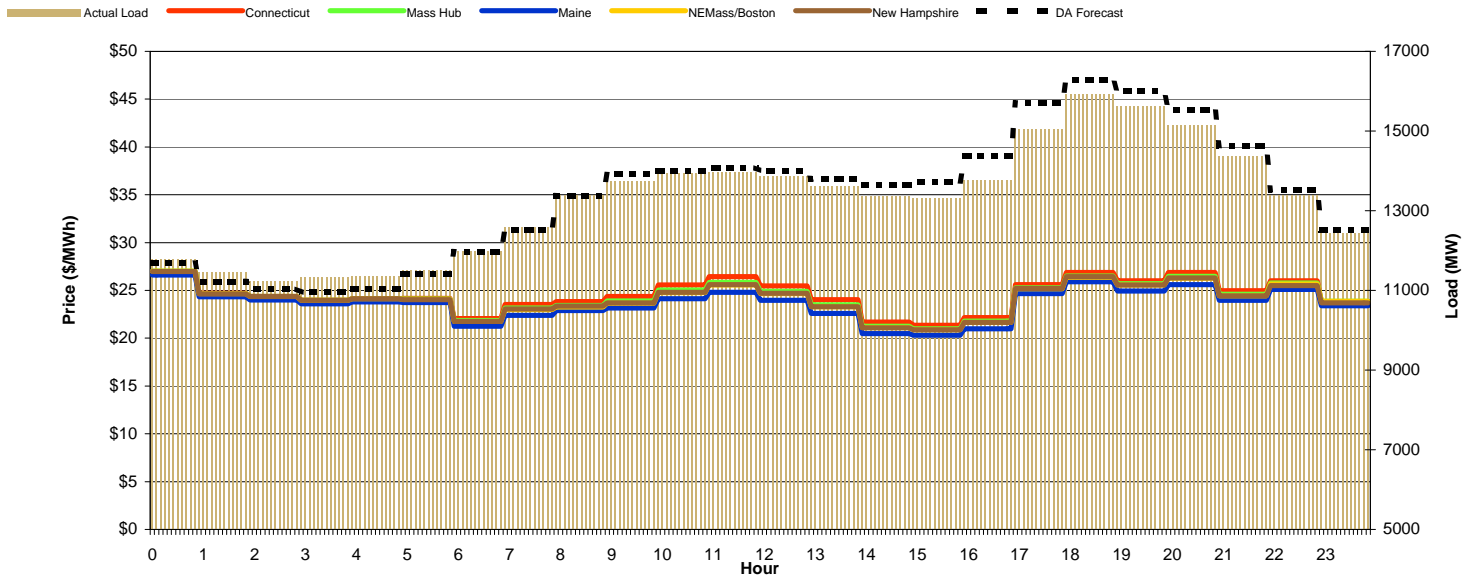




ISO-NE Daily Report

Monday February 20, 2012

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	26.46	23.16	23.15	23.16	23.10	28.74	30.91	31.95	33.89	36.06	37.13	36.00	33.54	33.00	32.43	31.49	33.24	54.15	65.00	47.37	40.09	32.55	31.06	30.77	34.10	38.06	All	On Pk
NEMass/Boston	26.61	23.26	23.22	23.20	23.30	29.17	30.84	31.55	33.05	33.69	34.47	32.69	32.79	32.19	31.68	30.85	30.88	41.05	45.15	37.73	32.67	31.81	30.69	30.70	31.39	33.93		
New Hampshire	26.55	23.23	23.18	23.17	23.28	29.27	31.04	31.81	33.16	33.75	34.52	32.77	32.83	32.22	31.67	30.93	31.02	41.12	45.17	37.75	32.71	31.89	30.78	30.87	31.45	34.01		
Maine	26.44	23.17	23.01	22.99	23.25	29.64	31.34	32.22	33.11	33.52	34.00	32.16	32.12	31.39	30.85	30.37	30.62	40.70	44.69	37.14	32.40	31.14	30.80	30.77	31.16	33.58		
Mass Hub	26.63	23.30	23.26	23.26	23.31	29.13	31.03	31.83	33.41	33.83	34.57	32.62	33.03	32.46	31.88	31.02	30.81	39.58	42.82	36.86	32.13	32.13	30.88	30.82	31.28	33.74		
Cleared Load (GW)	11.3	11.1	11.0	10.9	11.3	11.8	13.6	14.6	14.9	15.2	15.3	15.1	15.0	14.7	14.4	14.5	15.2	16.4	16.6	16.1	15.6	14.6	13.3	12.2				

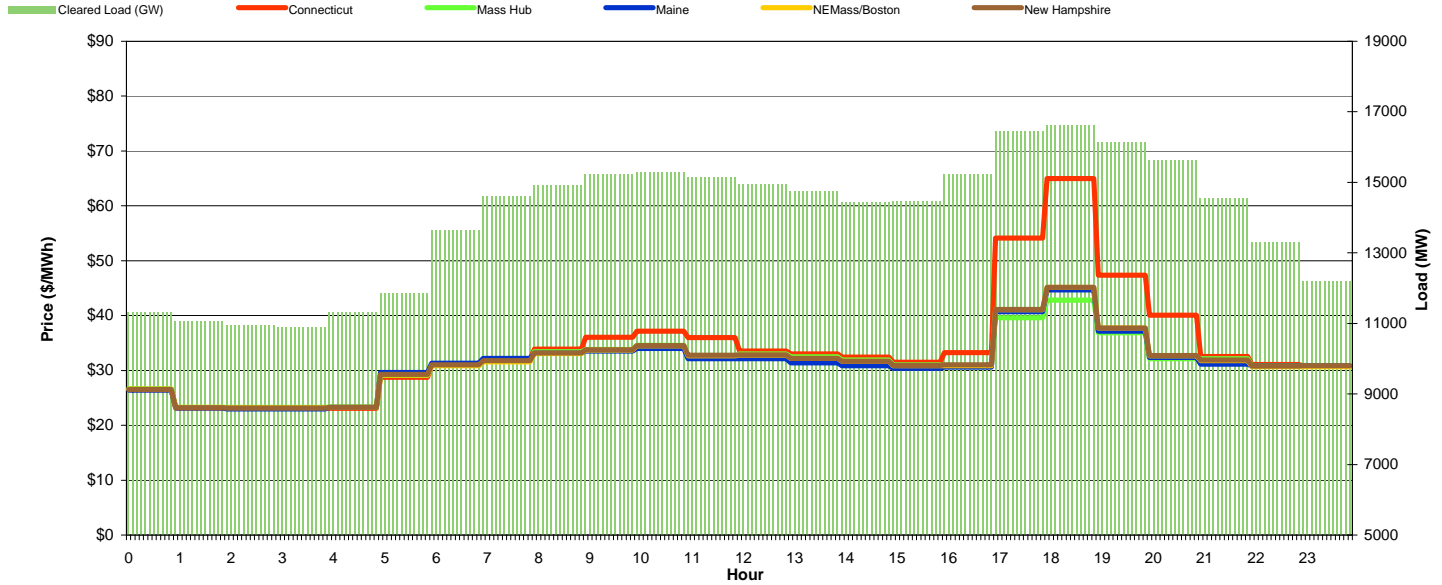

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	23.43	22.54	22.43	22.37	22.78	23.11	23.94	26.19	28.45	29.79	34.55	31.47	28.43	28.33	27.84	26.99	27.02	36.40	35.21	35.08	32.33	27.74	33.82	36.87	28.63	30.60	All	On Pk
NEMass/Boston	23.47	22.56	22.41	22.37	22.79	23.01	23.83	25.94	27.92	29.12	33.57	30.59	27.81	27.70	27.16	26.38	26.49	35.54	34.38	34.09	31.31	26.99	33.32	36.79	28.15	29.89		
New Hampshire	23.32	22.43	22.28	22.26	22.68	22.95	23.91	26.08	28.02	29.20	33.69	30.72	27.86	27.73	27.18	26.41	26.44	35.59	34.44	34.15	31.32	26.92	32.99	36.46	28.13	29.92		
Maine	23.22	22.32	21.96	21.93	22.44	22.86	23.94	26.10	27.92	28.86	33.20	30.04	27.23	27.11	26.54	25.86	25.79	34.95	33.77	33.28	30.45	25.94	32.13	36.18	27.67	29.32		
Mass Hub	23.44	22.56	22.42	22.38	22.81	23.06	23.87	26.01	28.07	29.31	33.84	30.83	27.98	27.88	27.34	26.54	26.61	35.72	34.49	34.31	31.55	27.18	33.43	36.69	28.26	30.07		
DA Forecast Load (GW)	11.47	11.15	11.05	11.00	11.41	12.30	13.77	14.74	15.39	15.78	15.82	15.72	15.54	15.11	14.88	14.84	15.37	16.64	17.42	16.97	16.31	15.27	14.01	12.85				
Forecast Error %	3.1%	4.0%	3.7%	4.4%	3.1%	2.1%	-1.6%	-2.2%	-1.2%	-0.7%	0.4%	0.7%	0.3%	1.3%	1.3%	1.1%	0.4%	0.5%	0.7%	1.0%	1.1%	1.6%	1.6%	1.4%				

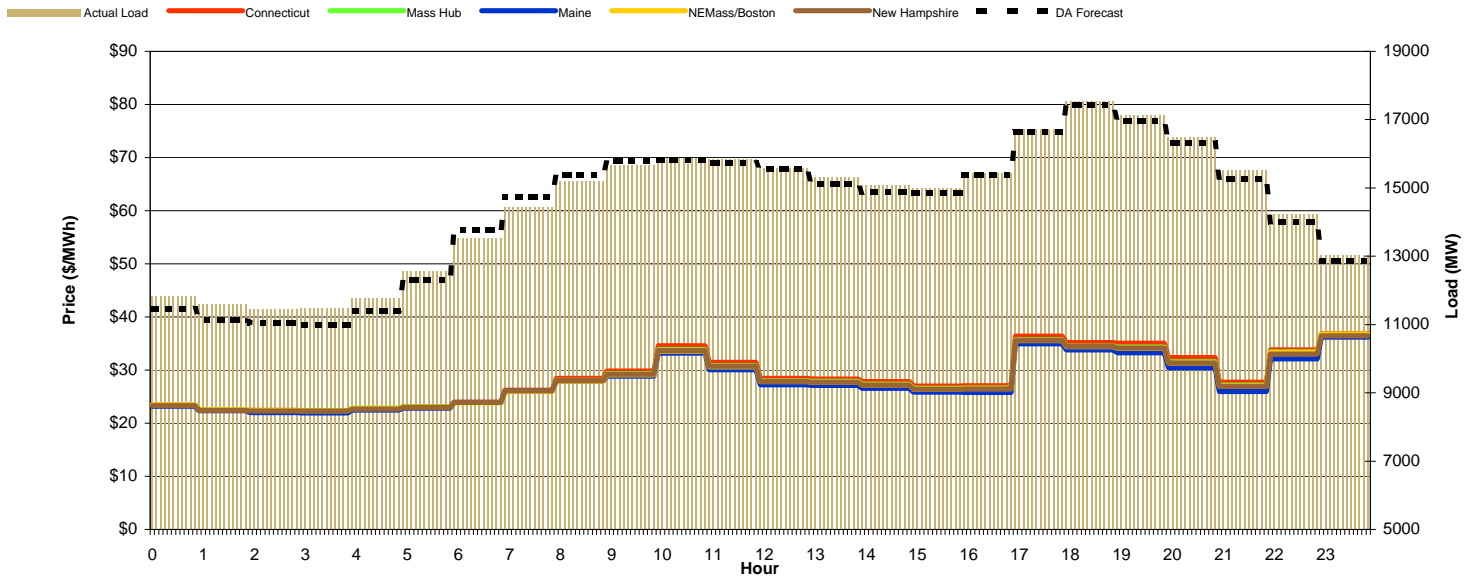




ISO-NE Daily Report

Tuesday February 21, 2012

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$	
Connecticut	29.08	27.83	27.38	28.05	28.55	29.65	32.02	38.37	35.69	32.89	31.97	33.03	32.26	31.56	31.00	30.32	32.11	43.31	46.69	37.07	33.90	31.10	30.72	29.44	32.67	34.50
NEMass/Boston	29.40	28.21	27.77	28.36	28.99	29.92	31.61	36.79	34.15	32.41	31.57	32.51	31.58	30.95	30.52	29.86	30.78	41.15	45.92	36.41	33.25	30.76	30.64	29.81	32.22	33.70
New Hampshire	29.28	28.14	27.67	28.26	28.95	30.08	31.88	36.87	34.18	32.44	31.56	32.59	31.62	30.93	30.48	29.86	30.93	41.33	46.07	36.53	33.24	30.82	30.87	29.86	32.27	33.77
Maine	29.05	28.00	27.40	27.91	28.90	32.98	32.10	36.50	34.00	32.30	31.27	32.05	30.79	30.05	29.64	29.14	30.69	41.00	45.26	36.00	32.72	30.33	31.00	29.87	32.04	33.30
Mass Hub	29.33	28.18	27.73	28.35	28.92	29.93	31.88	37.12	34.35	32.59	31.72	32.72	31.82	31.14	30.58	29.97	30.75	41.11	46.24	36.63	33.46	30.90	30.70	29.68	32.33	33.86
Cleared Load (GW)	11.2	11.1	10.9	10.9	11.2	12.0	14.5	15.1	15.2	15.3	15.3	15.1	14.7	14.6	14.2	14.2	14.8	16.6	16.7	16.0	15.4	14.0	12.7	11.6		

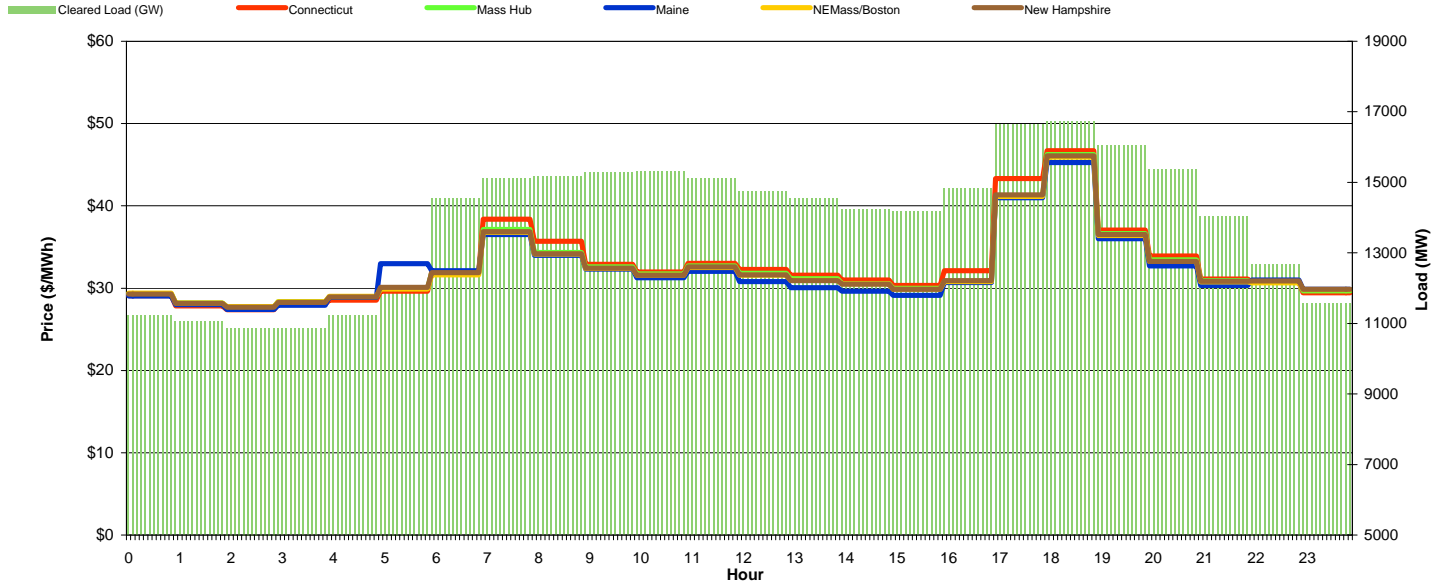

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$	
Connecticut	27.69	23.69	28.22	32.28	31.26	42.61	31.31	38.97	39.77	41.10	32.52	30.74	31.49	30.61	30.34	29.44	29.62	43.85	40.55	42.24	35.26	26.74	30.42	34.39	33.55	34.60
NEMass/Boston	27.81	23.88	28.36	32.26	31.50	43.02	31.09	38.50	39.22	40.59	32.19	30.50	30.99	30.06	29.78	28.95	29.17	37.92	40.41	41.77	34.71	26.49	30.30	34.80	33.09	33.85
New Hampshire	27.58	23.71	28.22	32.12	31.40	43.06	31.41	38.81	39.42	40.75	32.31	30.68	31.13	30.18	29.88	29.03	29.31	38.01	40.41	41.73	34.68	26.47	30.36	34.67	33.14	33.95
Maine	27.34	23.59	28.07	31.85	31.40	43.63	31.63	38.83	39.53	40.74	32.31	30.66	30.89	29.86	29.59	28.85	29.35	38.00	40.29	41.05	34.07	26.02	30.19	34.78	33.02	33.76
Mass Hub	27.70	23.78	28.30	32.23	31.37	42.76	31.10	38.58	39.33	40.69	32.26	30.53	31.08	30.17	29.89	29.04	29.24	37.90	40.23	41.75	34.79	26.53	30.30	34.58	33.09	33.89
DA Forecast Load (GW)	12.18	11.79	11.65	11.70	12.10	13.27	14.90	15.87	16.03	15.98	15.97	15.88	15.65	15.51	15.32	15.29	15.77	16.92	17.47	17.07	16.36	15.28	13.86	12.59		
Forecast Error %	0.8%	0.8%	2.6%	3.3%	0.8%	-0.3%	0.0%	0.6%	1.6%	1.8%	1.7%	1.3%	1.1%	1.1%	1.7%	1.8%	1.3%	1.5%	1.4%	0.9%	0.7%	0.8%	1.0%	1.0%		

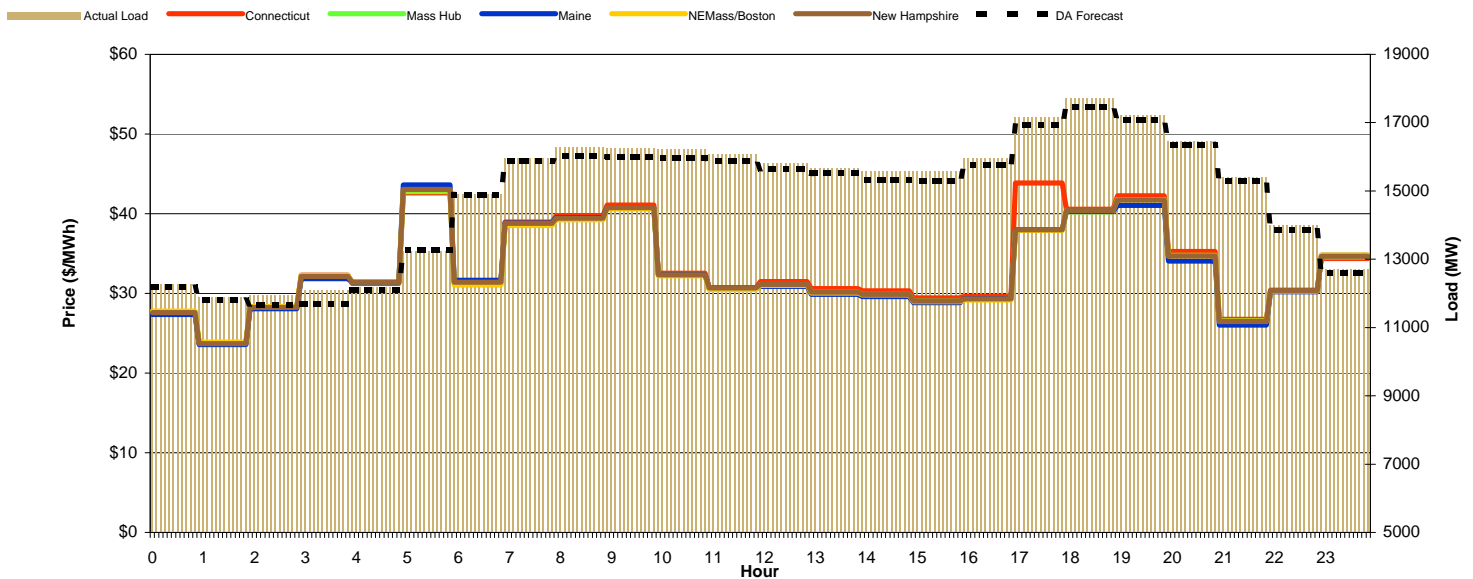




ISO-NE Daily Report

Wednesday February 22, 2012

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	26.31	25.21	25.26	25.32	25.35	26.95	31.06	35.27	33.94	31.72	31.86	28.89	28.83	28.03	26.90	26.50	28.58	40.29	41.05	37.21	30.19	28.33	27.43	26.98	29.89	31.56	All	On Pk
NEMass/Boston	26.41	25.33	25.35	25.37	25.45	27.00	30.85	34.78	33.41	31.22	31.30	28.37	28.32	27.47	26.40	26.04	28.06	39.91	40.56	36.40	29.53	27.89	27.37	27.26	29.59	31.06		
New Hampshire	26.31	25.20	25.24	25.26	25.36	27.12	30.99	34.96	33.61	31.38	31.48	28.51	28.45	27.59	26.53	26.17	28.28	40.04	40.62	36.43	29.58	28.06	27.48	27.18	29.66	31.20		
Maine	26.40	25.23	25.25	25.28	25.43	29.51	31.03	34.87	33.52	31.01	30.96	27.88	28.00	27.00	26.07	25.81	28.03	39.55	39.90	35.49	28.96	27.66	27.57	27.27	29.49	30.77		
Mass Hub	26.34	25.30	25.37	25.39	25.44	26.97	31.10	35.05	33.66	31.46	31.54	28.59	28.55	27.68	26.60	26.22	28.22	40.08	40.74	36.66	29.79	28.13	27.42	27.17	29.73	31.27		
Cleared Load (GW)	10.8	10.5	10.5	10.4	10.7	11.4	13.9	14.5	14.8	14.9	14.8	14.9	14.7	14.4	14.3	14.2	14.8	15.9	16.2	15.5	15.2	13.9	12.5	11.4				

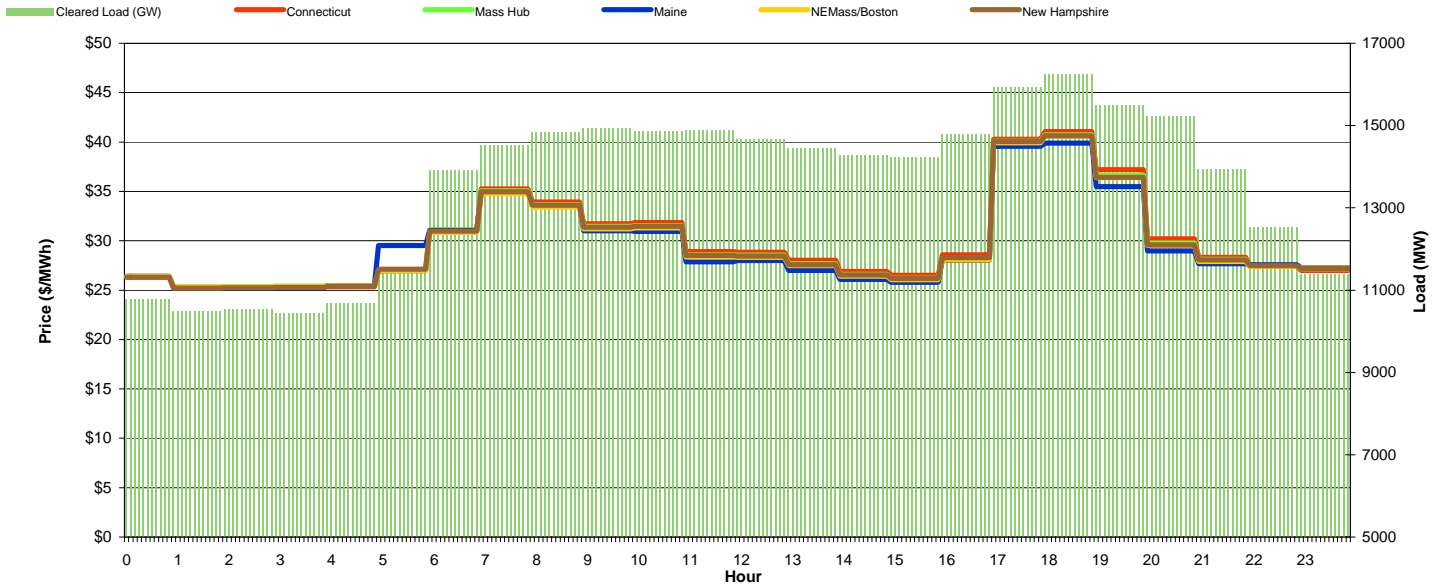

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	32.41	27.20	25.14	25.03	25.27	25.53	25.67	26.27	27.99	31.37	32.49	30.39	24.78	24.56	23.79	22.83	23.60	24.92	25.79	27.60	25.41	24.31	23.66	23.28	26.22	26.24	All	On Pk
NEMass/Boston	32.67	27.35	25.31	25.18	25.45	25.67	25.62	26.09	27.74	31.05	32.08	30.01	24.53	24.30	23.56	22.58	23.38	24.85	25.63	27.16	24.90	23.83	23.42	23.36	26.07	25.94		
New Hampshire	32.47	27.25	25.20	25.08	25.32	25.60	25.69	26.19	27.88	31.29	32.34	30.25	24.68	24.45	23.67	22.67	23.50	25.00	25.82	27.28	24.90	23.75	23.29	23.07	26.11	26.06		
Maine	32.38	27.09	25.09	25.01	25.38	25.76	25.66	26.05	27.77	31.21	32.12	30.02	24.53	24.26	23.51	22.51	23.47	25.14	25.97	27.12	24.48	23.42	23.36	23.25	26.02	25.93		
Mass Hub	32.55	27.30	25.27	25.15	25.40	25.64	25.62	26.12	27.78	31.13	32.18	30.10	24.57	24.32	23.56	22.58	23.36	24.74	25.55	27.21	24.99	23.92	23.46	23.31	26.08	25.97		
DA Forecast Load (GW)	11.79	11.33	11.12	11.12	11.44	12.58	14.58	15.65	15.78	15.77	15.78	15.64	15.38	15.27	15.08	15.00	15.43	16.54	17.05	16.71	16.04	14.97	13.59	12.33				
Forecast Error %	1.7%	2.8%	4.0%	4.5%	2.8%	0.4%	-3.8%	-4.0%	-2.3%	-2.0%	-1.9%	-1.4%	-1.3%	-1.5%	-1.7%	-2.3%	-3.4%	-3.3%	-1.7%	-2.0%	-1.7%	-1.0%	-0.6%	-0.7%				

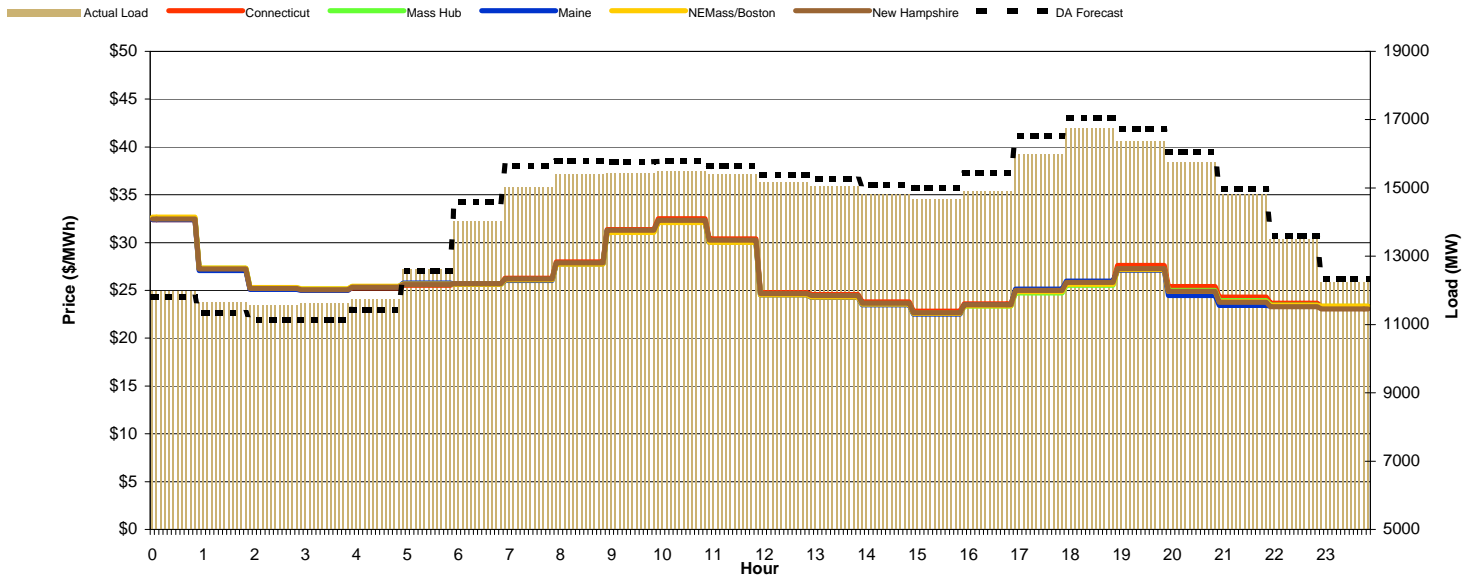




ISO-NE Daily Report

Thursday February 23, 2012

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	26.04	23.63	23.15	23.14	24.17	26.68	27.79	27.47	28.35	28.04	29.51	30.58	26.95	26.55	26.83	26.63	27.63	39.51	43.58	39.65	31.91	27.64	26.50	25.96	28.66	30.46	All	On Pk
NEMass/Boston	25.02	23.51	22.96	22.95	24.13	25.91	27.38	26.72	27.40	26.62	28.49	29.57	26.02	25.69	26.04	25.87	26.79	38.36	42.03	38.49	31.00	27.00	26.19	25.99	27.92	29.52		
New Hampshire	24.75	23.26	22.72	22.74	23.82	25.62	27.00	26.40	27.06	26.40	28.19	29.19	25.72	25.63	25.92	25.76	26.73	38.03	41.58	38.14	30.82	27.06	26.10	25.78	27.68	29.30		
Maine	25.19	23.54	22.94	23.02	24.21	25.89	26.63	26.40	26.97	26.20	27.84	28.76	25.30	25.09	25.37	25.31	26.25	37.26	40.59	37.17	30.17	26.92	25.61	25.58	27.43	28.83		
Mass Hub	24.93	23.54	23.04	23.02	24.14	25.68	27.61	27.04	27.77	26.90	28.91	30.00	26.37	26.00	26.32	26.15	27.06	38.65	42.30	38.88	31.36	27.29	26.36	26.03	28.14	29.84		
Cleared Load (GW)	10.7	10.4	10.3	10.3	10.4	10.9	13.5	14.7	14.9	15.1	15.1	14.9	14.7	14.5	14.2	14.2	14.7	16.1	16.0	15.2	14.9	14.0	12.8	11.7				

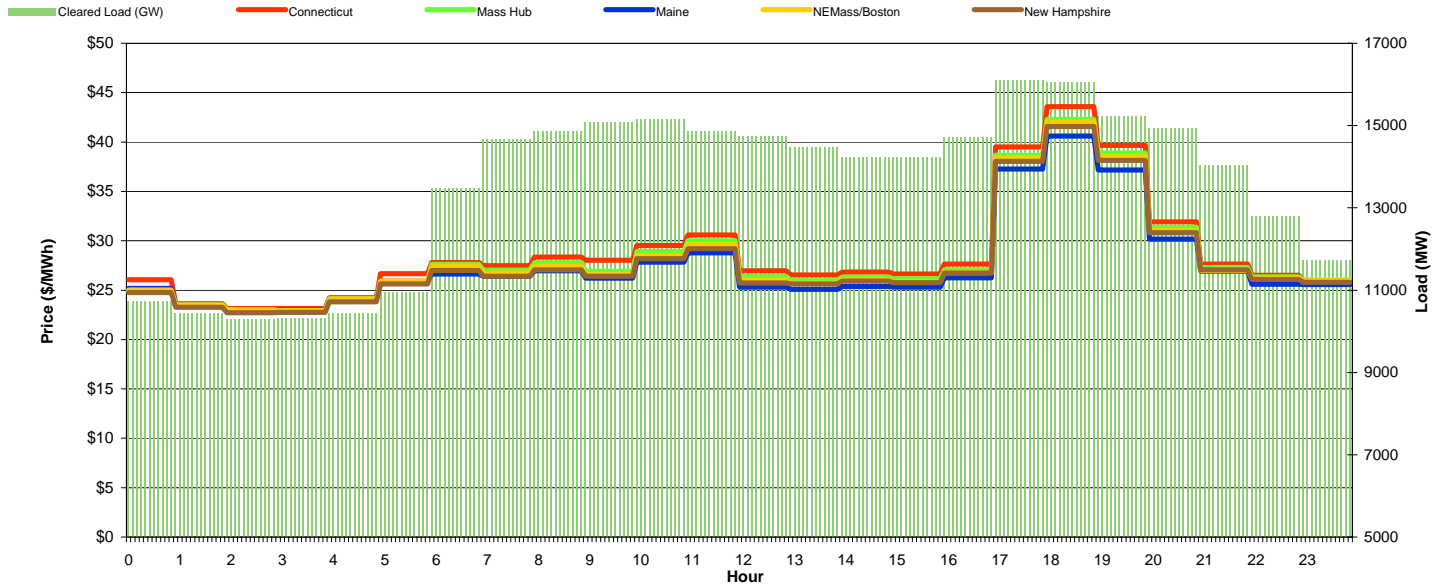

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	25.56	23.07	22.73	23.02	24.52	24.54	22.90	23.83	25.47	28.32	26.30	25.53	26.11	24.98	23.82	22.88	23.55	29.50	30.18	30.52	25.81	23.88	21.99	22.11	25.05	25.79	All	On Pk
NEMass/Boston	25.56	23.01	22.63	22.91	24.49	24.42	22.59	23.43	24.97	27.56	25.59	24.87	25.36	24.27	23.19	22.27	22.99	28.94	29.48	29.69	25.12	23.27	21.65	22.09	24.60	25.17		
New Hampshire	25.24	22.76	22.38	22.67	24.21	24.12	22.37	23.19	24.73	27.35	25.39	24.64	25.03	23.88	22.82	21.93	22.64	28.45	28.99	29.17	24.71	22.84	21.21	21.58	24.26	24.81		
Maine	25.48	22.94	22.45	22.81	24.47	24.13	22.19	23.21	24.72	27.16	25.15	24.32	24.48	23.12	22.24	21.45	22.27	28.09	28.48	28.55	24.02	22.18	20.63	21.14	23.99	24.38		
Mass Hub	25.55	23.03	22.69	22.96	24.51	24.49	22.69	23.56	25.13	27.81	25.82	25.09	25.61	24.50	23.39	22.45	23.14	29.11	29.70	29.96	25.35	23.47	21.76	22.10	24.74	25.37		
DA Forecast Load (GW)	11.48	11.03	10.79	10.74	11.03	12.13	13.80	14.89	15.14	15.25	15.35	15.37	15.20	15.11	15.14	15.10	15.39	16.45	17.00	16.68	16.04	15.04	13.64	12.39				
Forecast Error %	1.1%	1.4%	3.4%	2.6%	1.0%	-0.5%	-1.1%	-1.9%	-0.1%	0.9%	0.8%	0.5%	0.7%	0.1%	-1.2%	-2.3%	-2.8%	-3.0%	-1.3%	-1.2%	-1.1%	-0.6%	0.0%	0.4%				

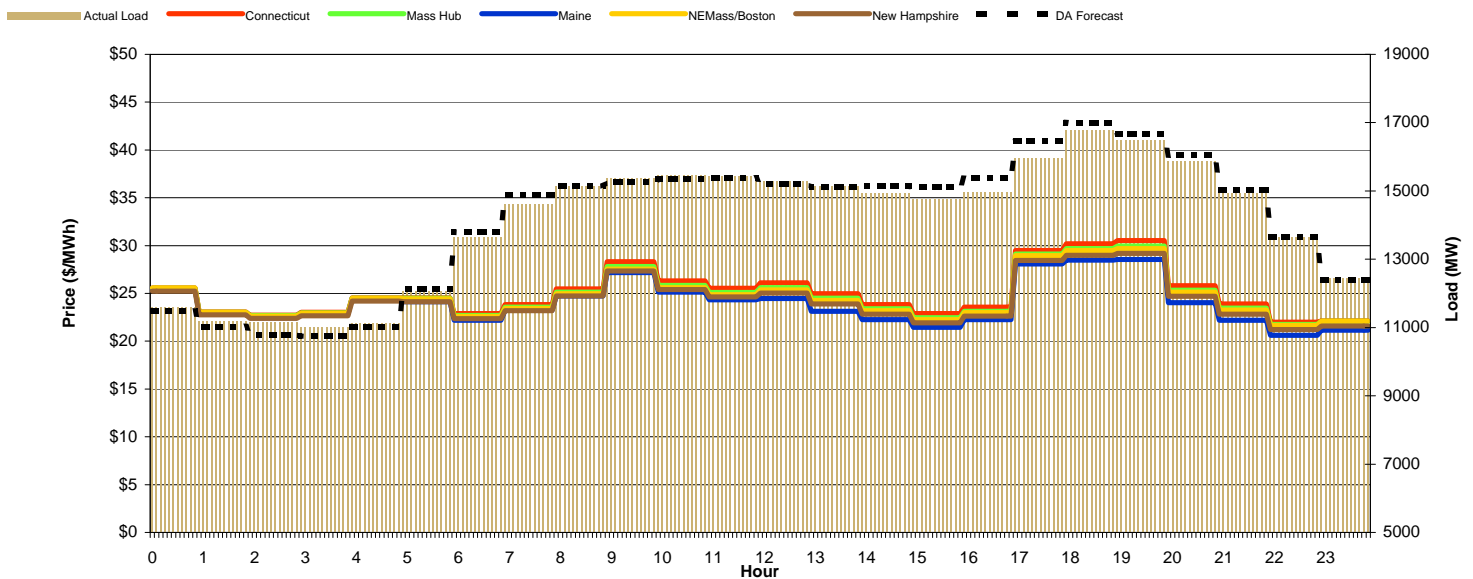




ISO-NE Daily Report

Friday February 24, 2012

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	22.39	21.89	19.97	19.86	20.21	22.46	27.63	27.73	32.02	29.39	32.21	32.78	32.02	29.90	27.55	27.38	29.17	33.43	34.41	27.54	27.61	25.49	25.83	24.87	27.24	29.65	All	On Pk
NEMass/Boston	22.39	21.98	20.04	19.93	20.35	22.55	27.48	27.22	31.33	28.57	31.30	31.73	30.96	28.87	26.62	26.48	28.24	32.87	32.93	26.84	27.03	24.86	24.42	24.88	26.66	28.77		
New Hampshire	21.94	21.67	19.74	19.64	20.07	22.17	27.46	27.08	31.18	28.26	30.99	31.51	30.63	28.55	26.42	26.30	27.99	32.42	32.52	26.52	26.85	24.68	24.09	24.46	26.38	28.50		
Maine	21.79	21.43	19.52	19.44	19.91	22.20	27.97	27.42	31.60	28.11	30.70	31.11	30.06	28.00	26.05	25.99	27.79	32.22	32.36	26.37	26.71	24.33	23.70	24.37	26.21	28.28		
Mass Hub	22.44	22.01	20.06	19.95	20.36	22.61	27.65	27.53	31.65	28.97	31.74	32.18	31.47	29.36	27.00	26.86	28.68	33.33	32.99	27.08	27.25	25.11	24.28	24.93	26.90	29.09		
Cleared Load (GW)	11.3	10.8	10.6	10.6	10.9	11.9	13.5	14.6	14.9	15.3	15.3	15.0	15.1	14.9	14.5	14.5	14.9	16.3	16.1	15.8	15.0	13.8	12.8	11.8				

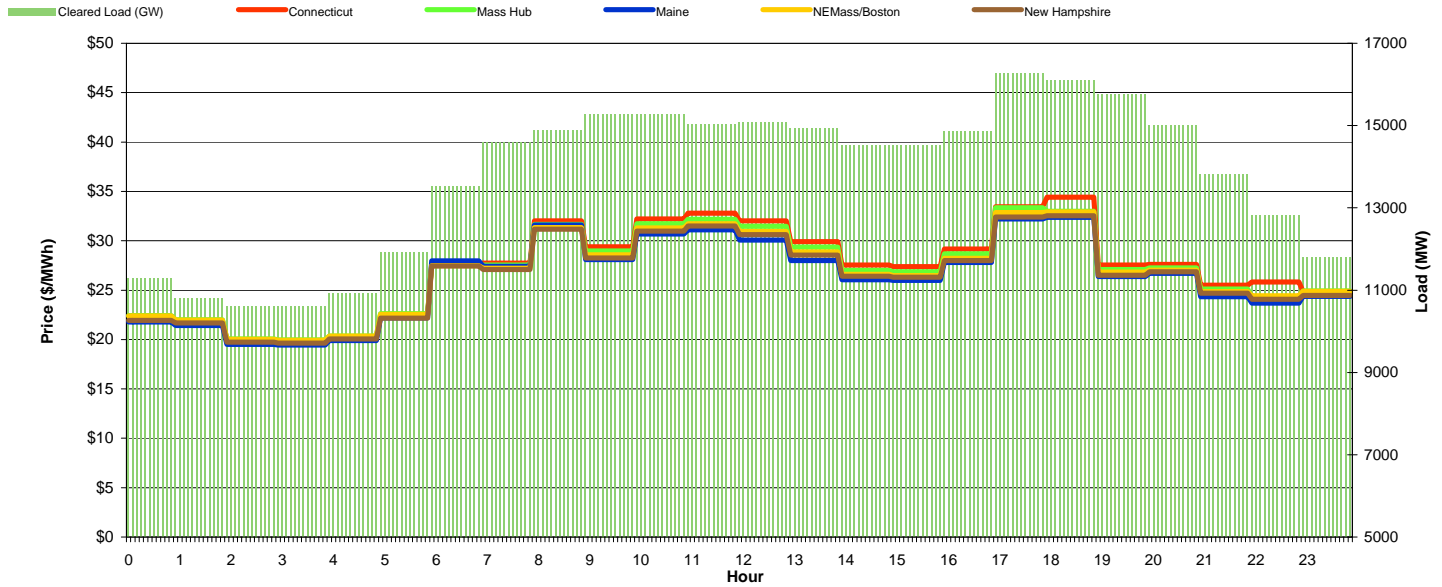

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	23.39	20.19	19.90	19.89	20.28	23.58	23.91	26.25	32.90	36.00	38.52	34.50	32.01	32.31	29.56	35.88	43.61	27.23	27.45	25.18	24.62	23.82	22.13	27.78	30.86	All	On Pk	
NEMass/Boston	23.36	20.23	19.89	19.85	20.30	23.51	23.46	23.50	25.63	31.87	34.75	37.10	33.20	30.90	31.12	28.56	34.63	42.55	26.74	26.84	24.58	24.00	23.38	21.98	27.16	29.96		
New Hampshire	22.84	19.87	19.59	19.56	20.00	23.19	23.21	23.23	25.38	31.51	34.31	36.61	32.77	30.52	30.77	28.28	34.21	41.84	26.27	26.37	24.20	23.64	22.92	21.49	26.77	29.55		
Maine	22.40	19.38	18.99	18.86	19.63	22.95	23.16	23.18	25.29	31.03	33.67	35.89	32.05	29.91	30.12	27.75	33.49	41.12	25.88	25.82	23.70	22.90	22.33	21.09	26.28	29.01		
Mass Hub	23.40	20.26	19.94	19.90	20.33	23.57	23.56	23.68	25.87	32.24	35.18	37.58	33.64	31.28	31.51	28.85	34.97	42.85	26.86	27.00	24.76	24.19	23.52	22.06	27.38	29.01		
DA Forecast Load (GW)	11.58	11.18	10.92	10.91	11.24	12.33	14.02	15.19	15.67	15.83	15.97	16.00	15.87	15.69	15.52	15.43	15.75	16.61	17.05	16.42	15.68	14.83	13.77	12.64				
Forecast Error %	2.7%	2.5%	4.8%	4.9%	2.9%	0.7%	-1.7%	-1.2%	0.7%	2.1%	3.0%	3.3%	3.4%	4.3%	4.7%	4.9%	4.4%	3.0%	1.1%	1.5%	1.9%	1.8%	1.3%	0.9%				

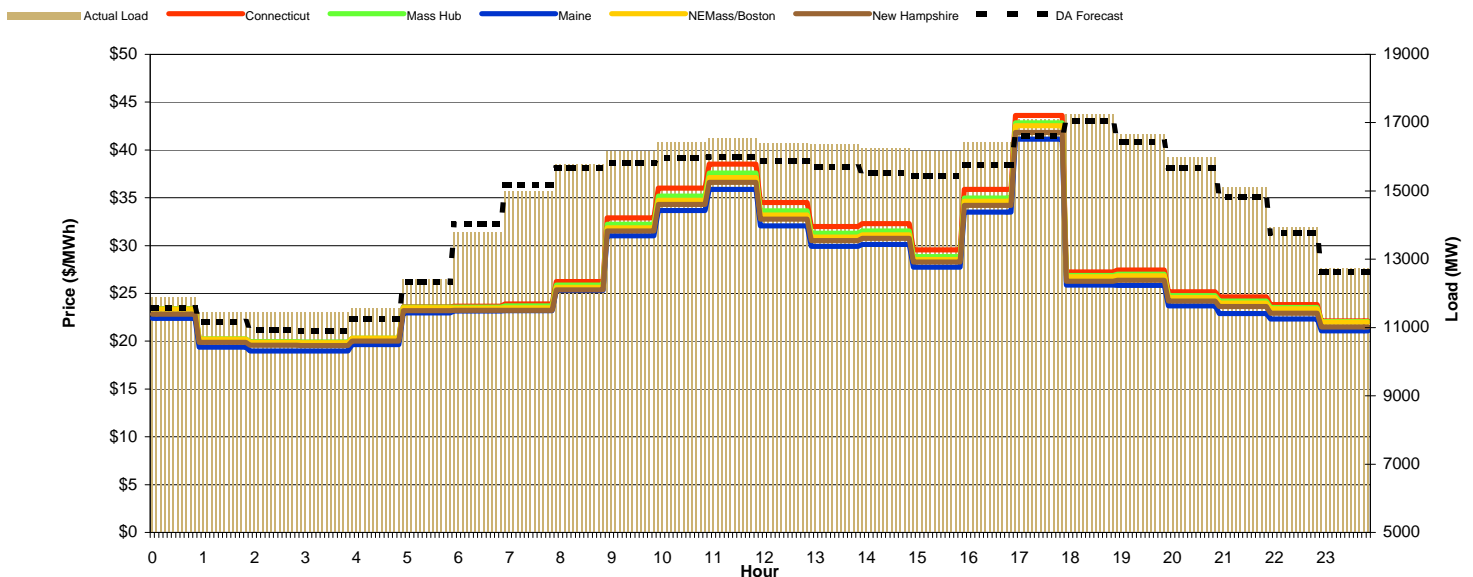




ISO-NE Daily Report

Saturday February 25, 2012

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$		
																										All	On Pk
Connecticut	24.84	22.25	22.20	21.86	22.32	23.66	23.89	25.24	24.53	30.09	29.00	30.00	27.00	24.72	24.02	23.75	23.93	26.03	36.71	28.74	27.57	25.57	24.85	26.44	26.44	25.80	26.98
NEMass/Boston	23.99	21.99	21.91	21.64	21.99	22.91	23.03	23.85	22.50	24.28	24.80	23.35	22.88	21.86	21.82	21.71	23.19	25.47	35.68	27.95	26.81	24.80	23.38	24.93	24.03	24.65	
New Hampshire	23.56	21.55	21.45	21.25	21.55	22.47	22.60	23.57	22.39	24.21	24.69	23.27	22.76	21.72	21.65	21.56	23.07	25.40	35.50	27.79	26.77	24.65	23.24	24.60	23.80	24.52	
Maine	23.31	21.29	21.22	21.04	21.39	22.30	22.48	23.45	22.24	23.79	24.32	22.71	22.31	21.46	21.33	21.25	22.88	25.28	35.22	27.54	26.68	24.47	22.98	24.17	23.55	24.24	
Mass Hub	24.02	22.07	21.99	21.73	22.10	22.94	22.94	23.71	22.44	23.06	24.12	21.83	22.13	21.50	21.71	21.61	23.49	25.83	36.17	28.34	27.17	25.16	23.33	24.99	23.93	24.48	
Cleared Load (GW)	11.1	10.6	10.3	10.2	10.3	10.7	11.2	12.1	13.5	13.9	14.1	13.8	13.7	13.4	13.0	13.1	13.7	15.2	15.4	15.1	14.8	14.0	13.2	12.0			

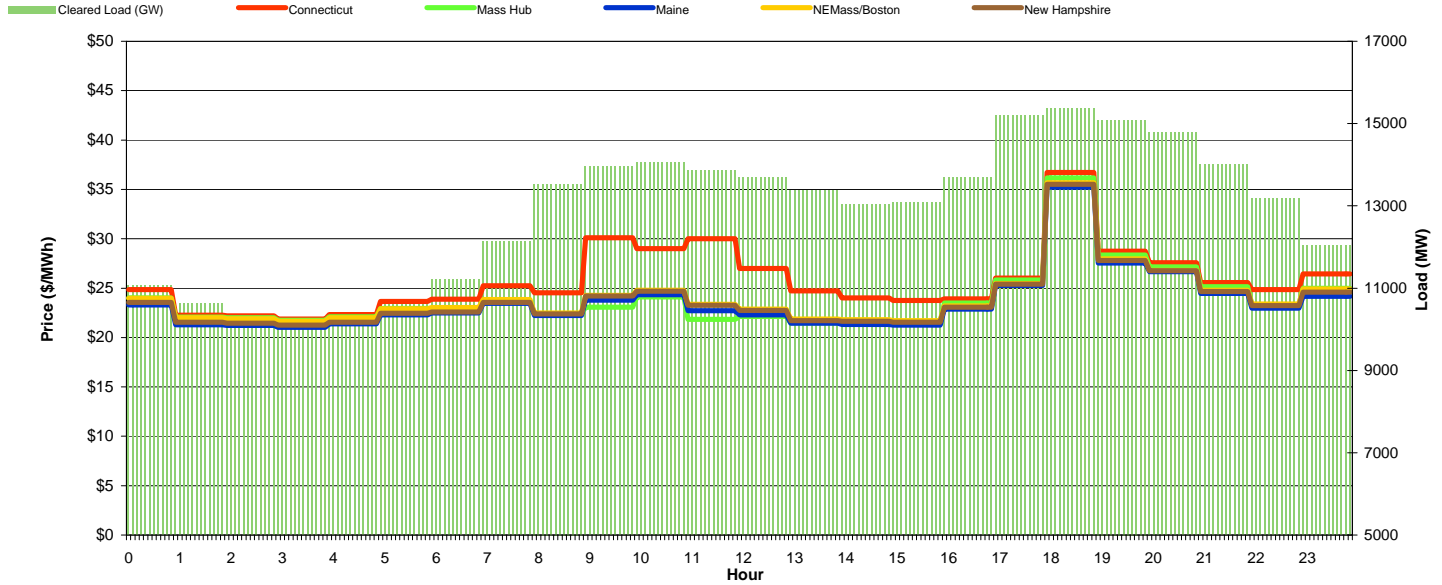

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$		
																										All	On Pk
Connecticut	22.22	22.00	21.79	20.79	20.91	27.48	23.34	22.50	21.97	22.99	22.55	22.15	22.82	24.86	23.71	23.09	23.12	27.27	29.16	29.93	28.10	23.63	21.72	19.94	23.67	24.35	
NEMass/Boston	21.87	21.69	21.48	20.54	20.68	27.08	22.93	21.98	21.45	22.36	21.87	21.60	22.35	24.09	22.95	22.41	22.45	26.56	28.26	29.01	27.05	22.81	21.19	19.49	23.09	23.65	
New Hampshire	21.43	21.27	21.04	20.11	20.23	26.53	22.47	21.65	21.18	22.08	21.52	21.26	21.51	23.73	22.50	21.95	21.99	26.04	27.80	28.52	26.67	22.37	20.77	19.04	22.65	23.22	
Maine	20.98	20.86	20.66	19.77	19.92	26.23	22.09	21.20	20.70	21.49	20.81	20.58	20.84	23.22	21.99	21.45	21.48	25.39	27.10	27.84	26.06	21.75	20.22	18.42	22.13	22.63	
Mass Hub	22.00	21.78	21.57	20.62	20.75	27.19	23.04	22.13	21.60	22.56	22.08	21.77	22.56	24.38	23.23	22.66	22.69	26.83	28.57	29.35	27.42	23.12	21.42	19.71	23.29	23.90	
DA Forecast Load (GW)	11.87	11.36	11.12	11.05	11.17	11.60	12.27	13.04	14.10	14.71	14.60	14.54	14.34	14.03	13.83	13.83	14.30	15.50	16.15	15.58	15.17	14.57	13.79	12.87			
Forecast Error %	0.0%	-0.3%	-0.7%	-1.0%	-1.1%	-1.1%	-1.7%	-2.2%	-3.0%	-2.3%	0.8%	1.4%	1.7%	2.1%	2.3%	1.8%	0.9%	-0.3%	0.5%	2.1%	1.8%	1.5%	0.4%	0.3%			

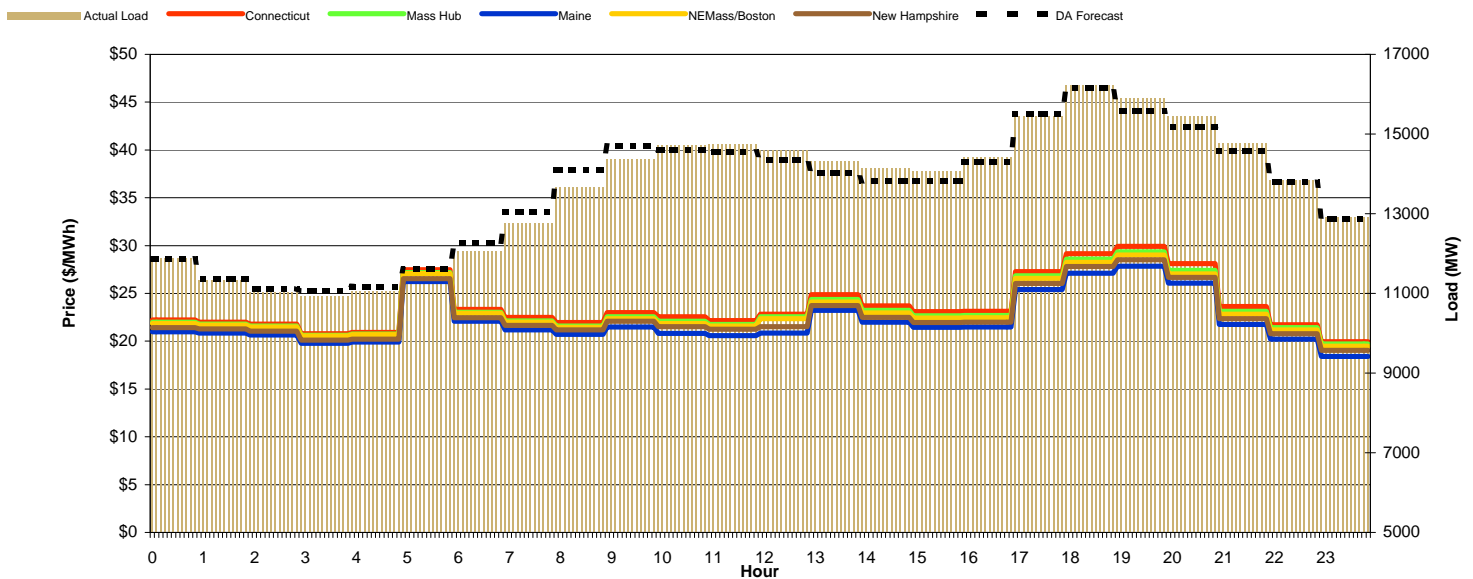




ISO-NE Daily Report

Sunday February 26, 2012

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$	
Connecticut	28.09	26.76	23.73	23.77	23.78	24.71	27.00	24.22	26.82	27.73	28.33	28.00	27.08	25.78	24.88	24.72	24.06	30.26	40.02	32.31	29.04	26.81	24.75	27.76	All	On Pk
NEMass/Boston	24.81	23.60	22.73	22.27	22.46	23.49	23.98	23.49	25.48	26.28	26.40	26.39	25.46	24.43	23.61	23.43	23.15	28.92	38.33	30.99	27.58	25.77	23.81	23.62	25.44	26.47
New Hampshire	24.47	23.25	22.21	21.76	21.97	23.00	23.60	23.06	25.09	25.90	26.07	26.05	25.09	24.05	23.26	23.08	22.79	28.65	37.84	30.64	27.29	25.42	23.53	23.07	25.05	26.11
Maine	24.04	22.84	21.75	21.30	21.45	22.56	23.13	22.55	24.53	25.17	25.31	25.29	24.24	23.33	22.62	22.45	22.18	28.15	37.20	30.03	26.96	24.91	23.03	22.43	24.48	25.50
Mass Hub	24.32	23.03	22.81	22.16	22.44	23.54	23.58	23.79	26.04	26.84	26.87	26.96	25.95	24.88	24.03	23.84	23.50	29.31	38.89	31.50	27.95	26.24	24.18	22.59	25.64	26.92
Cleared Load (GW)	11.6	11.2	10.9	10.8	11.0	11.3	11.6	12.2	13.2	13.7	13.8	13.8	13.5	13.2	13.0	13.1	13.7	15.2	15.7	15.2	15.0	14.1	13.2	12.0		

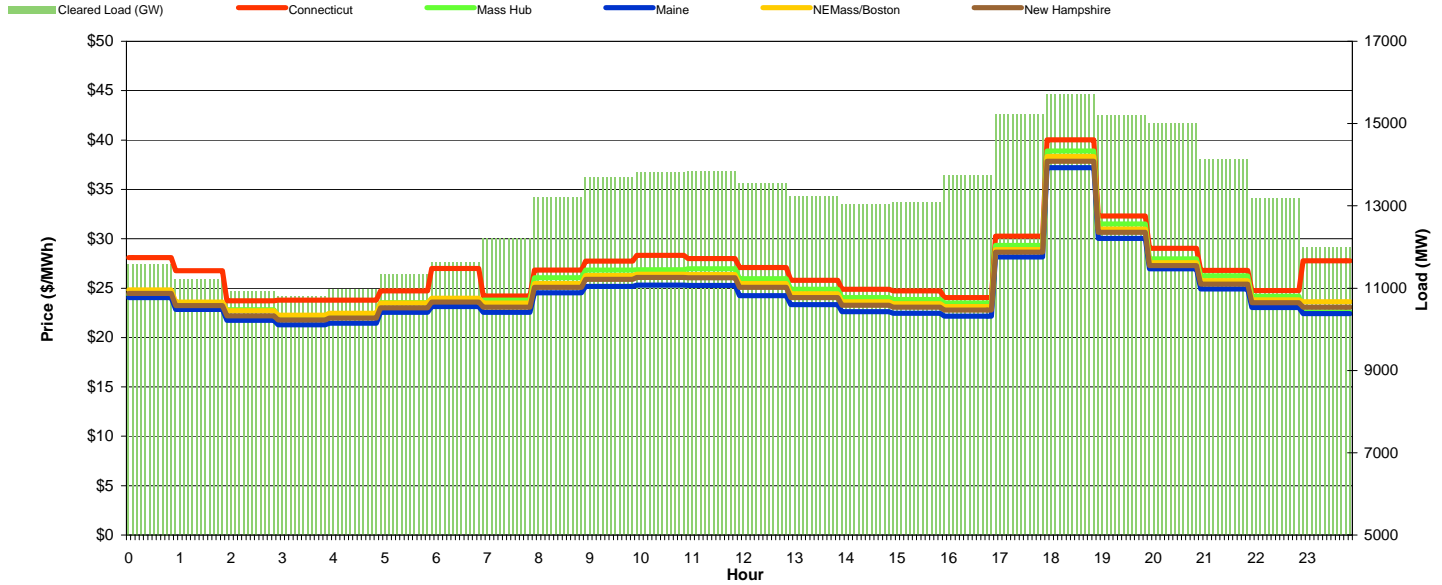

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$	
Connecticut	23.02	22.85	22.25	22.42	22.27	22.46	22.51	19.07	24.03	25.18	25.97	26.59	26.07	24.98	24.35	23.26	24.05	29.24	37.93	34.88	29.38	25.34	22.85	21.45	All	On Pk
NEMass/Boston	22.33	22.28	21.73	21.86	21.77	21.93	21.97	18.47	23.03	23.99	24.64	25.31	24.78	23.85	23.31	22.37	23.17	28.28	36.54	33.40	28.25	24.28	22.08	21.05	24.19	25.36
New Hampshire	21.77	21.68	21.18	21.31	21.22	21.34	21.35	18.01	22.55	23.53	24.21	24.85	24.35	23.45	22.88	21.90	22.69	27.83	35.84	32.76	27.77	23.87	21.65	20.59	23.69	24.88
Maine	21.15	21.13	20.56	20.68	20.62	20.74	20.67	17.32	21.85	22.66	23.32	23.92	23.36	22.64	22.11	21.12	21.90	27.09	34.56	31.57	26.96	23.06	20.87	19.83	22.90	24.02
Mass Hub	22.62	22.53	21.96	22.10	22.00	22.17	22.21	18.71	23.43	24.44	25.12	25.77	25.23	24.21	23.64	22.66	23.46	28.62	37.00	33.87	28.63	24.64	22.35	21.23	24.53	25.74
DA Forecast Load (GW)	12.08	11.61	11.44	11.37	11.49	11.79	12.26	12.81	13.72	14.25	14.44	14.40	14.29	13.99	13.77	13.78	14.42	15.73	16.40	16.10	15.63	14.81	13.71	12.68		
Forecast Error %	0.7%	1.0%	2.0%	1.3%	0.1%	0.3%	0.0%	0.3%	-0.4%	0.0%	0.4%	1.4%	1.6%	1.8%	1.4%	0.9%	-0.6%	-1.5%	1.7%	1.8%	1.4%	0.7%	0.5%	0.5%		

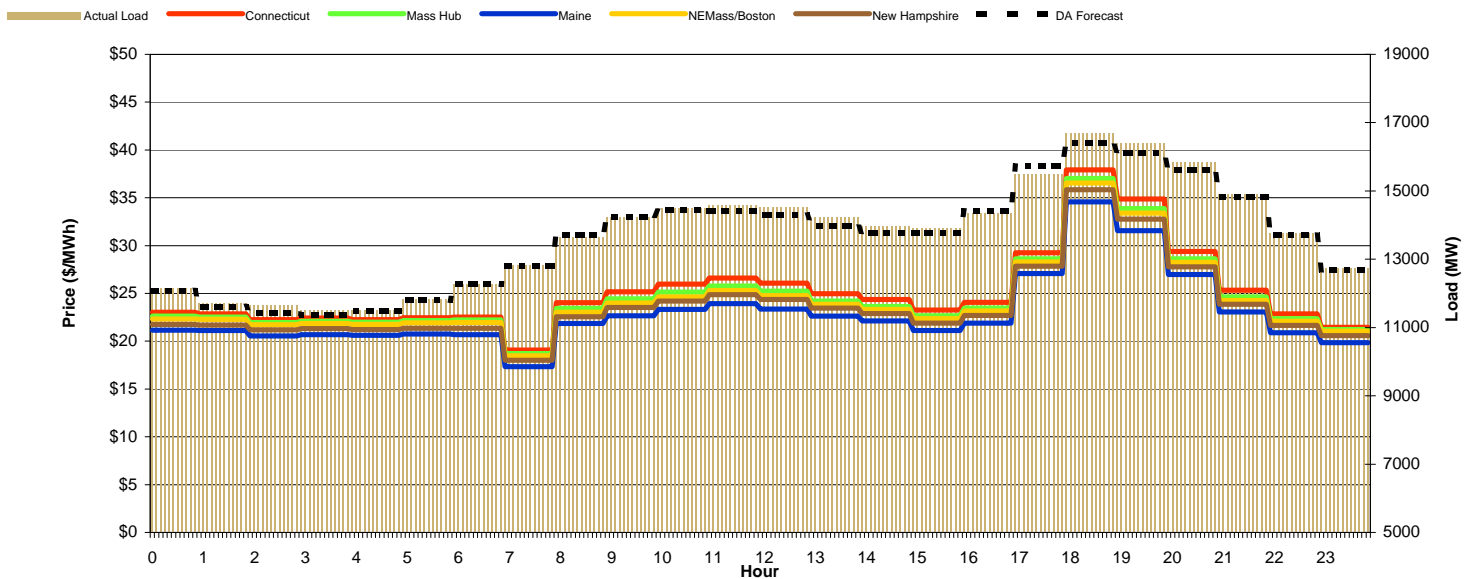




ISO-NE Daily Report

Monday February 27, 2012

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	24.38	23.82	23.84	23.72	24.45	27.92	28.27	32.83	32.99	34.00	34.50	33.13	31.58	28.85	28.02	28.31	29.24	40.67	43.23	40.63	32.27	28.67	27.13	25.20	30.32	32.88	All	On Pk
NEMass/Boston	22.87	22.38	22.30	22.22	22.89	25.89	27.75	31.89	32.04	32.88	33.30	32.00	30.45	27.67	26.83	27.36	28.18	39.65	41.54	38.97	31.23	28.00	26.52	24.38	29.13	31.78		
New Hampshire	22.42	21.97	21.91	21.77	22.52	25.64	27.66	31.73	31.84	32.76	33.20	31.87	30.30	27.54	26.70	27.27	28.15	39.45	41.29	38.72	31.02	27.98	26.39	24.05	28.92	31.64		
Maine	21.97	21.48	21.47	21.37	22.13	25.56	28.06	32.07	32.11	32.76	33.33	31.80	30.16	27.33	26.59	27.21	28.24	39.79	41.82	38.93	31.13	28.23	26.25	23.86	28.90	31.73		
Mass Hub	23.00	22.50	22.36	22.24	22.96	25.97	28.07	32.29	32.43	33.26	33.70	32.37	30.85	28.02	27.13	27.73	28.47	40.00	41.68	39.20	31.59	28.29	26.81	24.50	29.39	32.11		
Cleared Load (GW)	11.3	11.2	11.0	11.0	11.4	12.0	14.3	15.0	15.0	14.8	14.8	14.7	14.6	14.5	14.4	14.3	14.6	15.8	16.0	15.5	15.0	13.9	12.8	12.0				

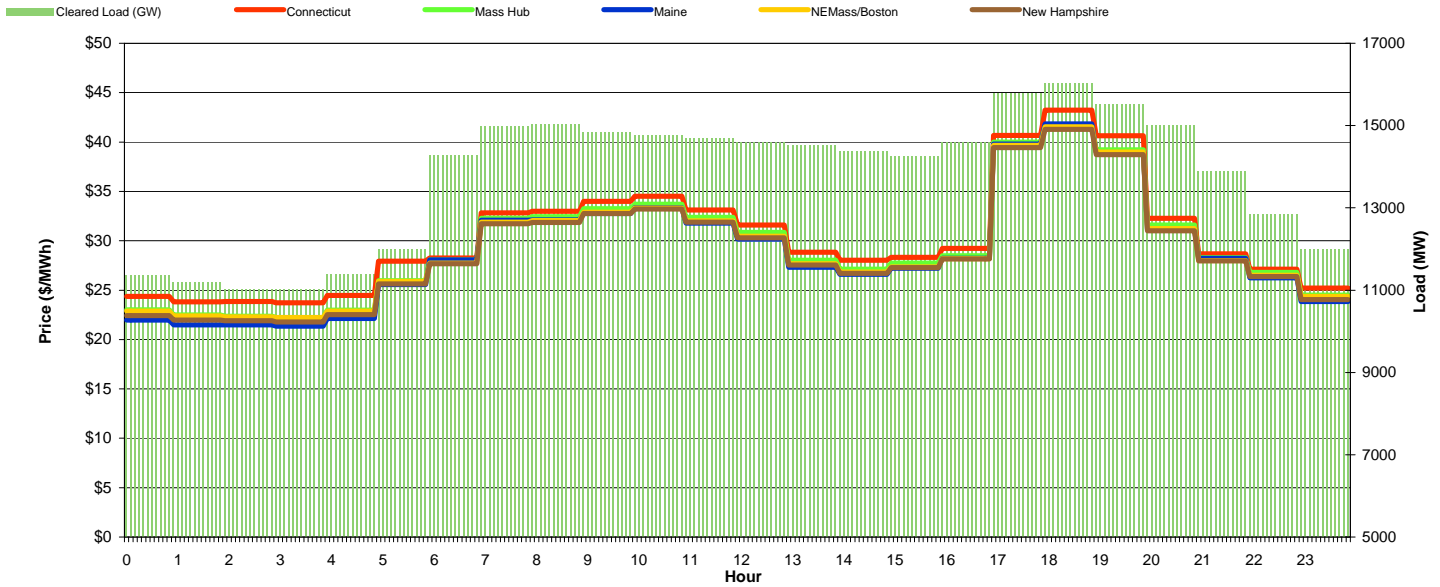

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	22.32	22.48	22.40	22.03	25.84	36.62	31.95	37.96	31.54	38.25	30.03	27.87	29.67	28.07	27.75	27.15	31.53	43.74	32.96	29.21	28.51	26.21	24.88	23.63	29.28	30.96	All	On Pk
NEMass/Boston	21.68	21.88	21.76	21.41	25.07	35.65	31.27	36.95	30.77	37.14	29.29	27.27	28.94	27.38	27.16	26.59	30.83	43.04	32.60	28.77	27.84	25.65	24.61	23.71	28.64	30.30		
New Hampshire	21.21	21.46	21.39	21.03	24.72	35.38	31.08	36.68	30.62	37.06	29.29	27.30	28.97	27.43	27.20	26.60	30.83	42.79	32.33	28.59	27.71	25.61	24.38	23.35	28.46	30.21		
Maine	20.54	20.77	20.86	20.51	24.30	35.29	31.44	37.02	31.00	37.25	29.65	27.73	29.38	27.87	27.65	27.03	31.30	43.35	32.79	28.96	28.01	26.05	24.53	23.48	28.62	30.60		
Mass Hub	21.95	22.13	22.03	21.66	25.41	36.12	31.54	37.27	31.03	37.52	29.54	27.47	29.19	27.61	27.37	26.79	31.05	43.25	32.72	28.92	28.05	25.85	24.74	23.70	28.87	30.52		
DA Forecast Load (GW)	12.00	11.61	11.51	11.57	11.98	13.17	15.11	16.17	16.31	16.25	16.22	16.09	15.83	15.64	15.38	15.29	15.72	16.89	17.49	17.01	16.34	15.24	13.77	12.50				
Forecast Error %	0.8%	2.5%	2.5%	2.4%	3.3%	2.2%	-0.4%	-0.6%	-0.6%	-0.6%	-0.9%	-0.8%	-0.4%	-0.3%	0.2%	0.6%	0.6%	-0.2%	0.1%	0.2%	-0.3%	-0.4%	0.1%	0.1%				

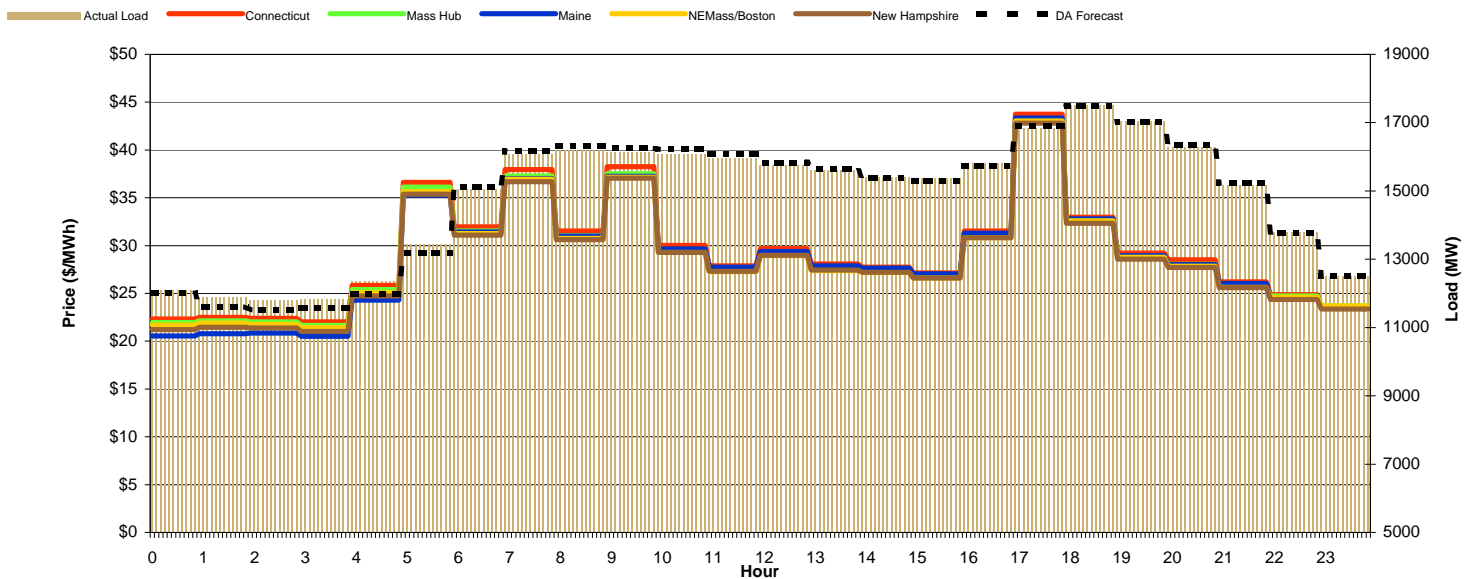




ISO-NE Daily Report

Tuesday February 28, 2012

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%


Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	26.43	27.15	27.18	25.88	26.08	28.76	28.25	31.15	30.30	28.91	29.91	28.57	28.09	26.80	25.07	25.15	28.23	30.08	40.02	35.32	29.99	29.00	27.29	27.45	28.79	29.62	All	On Pk
NEMass/Boston	25.63	26.91	26.93	25.70	26.08	27.83	27.91	30.55	29.66	28.23	29.15	27.85	27.35	26.12	24.36	24.54	27.57	29.68	39.41	34.65	29.31	28.76	26.44	27.55	28.26	28.98		
New Hampshire	25.12	26.36	26.42	25.19	25.57	27.54	27.83	30.37	29.48	27.98	28.92	27.60	27.09	25.86	24.13	24.36	27.40	29.47	38.91	34.30	29.05	28.70	26.14	27.07	27.95	28.74		
Maine	24.91	25.95	25.93	24.83	25.50	27.87	28.17	30.51	29.55	27.98	28.68	27.23	26.74	25.55	23.84	24.23	27.31	29.64	38.96	34.34	29.01	28.79	25.98	26.91	27.85	28.65		
Mass Hub	25.58	27.10	27.12	25.86	26.18	27.83	28.17	30.98	30.03	28.62	29.57	28.25	27.74	26.49	24.62	24.82	27.86	29.94	39.85	35.02	29.68	29.01	26.27	27.63	28.51	29.30		
Cleared Load (GW)	11.1	11.1	10.9	10.9	11.0	11.7	14.2	15.1	15.1	15.2	15.2	15.2	15.0	14.9	14.7	14.7	14.9	16.5	16.9	16.5	15.8	14.4	13.2	12.0				

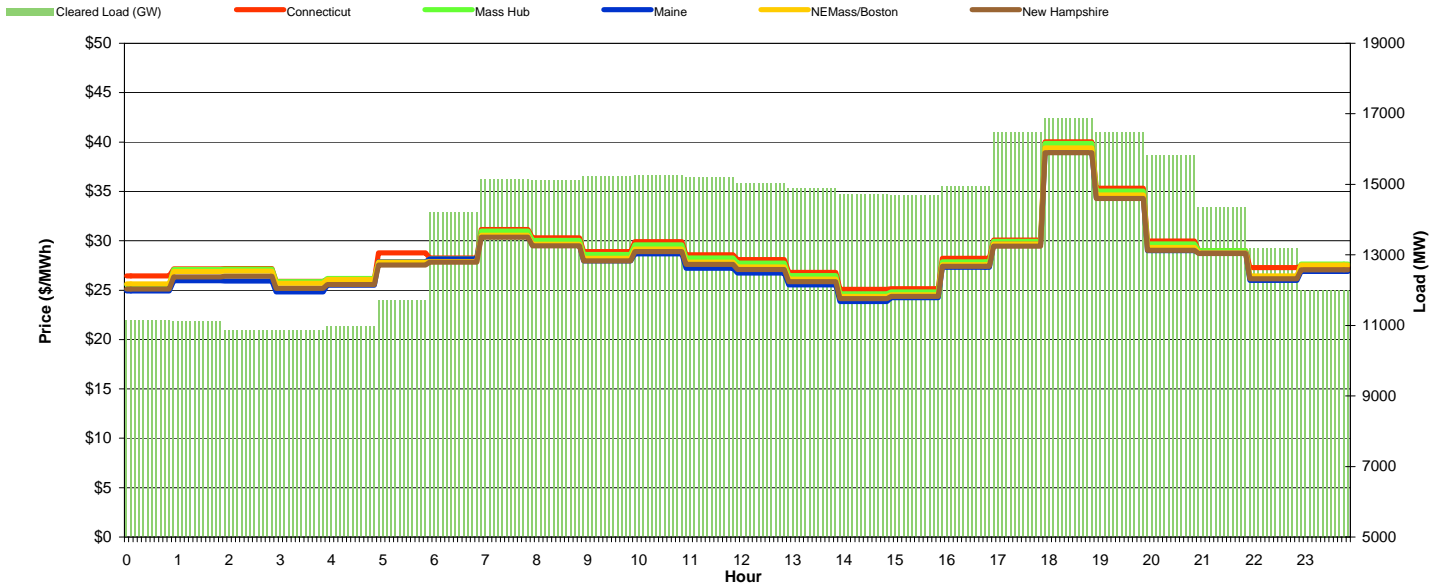

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	24.47	21.55	21.72	21.56	21.79	22.57	24.88	25.79	26.11	25.72	26.14	26.33	24.84	24.67	23.53	22.88	23.65	23.18	27.20	28.75	28.67	25.01	23.10	21.81	24.41	25.35	All	On Pk
NEMass/Boston	24.36	21.39	21.57	21.39	21.70	22.41	24.70	25.53	25.74	25.35	25.68	25.85	24.44	24.29	23.12	22.48	23.35	23.17	26.96	28.46	28.18	24.71	22.88	21.84	24.15	25.01		
New Hampshire	23.98	21.03	21.25	21.08	21.38	22.19	24.50	25.26	25.51	25.10	25.49	25.68	24.16	24.02	22.81	22.18	23.11	22.94	26.79	28.29	28.02	24.58	22.62	21.45	23.89	24.79		
Maine	24.10	20.95	20.99	21.01	21.39	22.48	24.72	25.45	25.68	25.21	25.39	25.57	23.86	23.70	22.38	21.81	23.00	23.18	27.18	28.62	28.25	24.54	22.39	21.14	23.87	24.76		
Mass Hub	24.43	21.47	21.67	21.48	21.76	22.47	24.77	25.63	25.88	25.49	25.90	26.11	24.65	24.43	23.25	22.58	23.43	23.15	27.02	28.54	28.33	24.80	22.95	21.83	24.25	25.13		
DA Forecast Load (GW)	11.65	11.32	11.23	11.24	11.62	12.81	14.73	15.72	15.91	15.92	15.95	15.90	15.69	15.57	15.41	15.38	15.82	16.91	17.55	17.24	16.60	15.55	14.14	12.87				
Forecast Error %	2.1%	3.5%	2.6%	2.6%	0.4%	-1.8%	-3.1%	-2.7%	-2.6%	-2.2%	-2.4%	-2.8%	-2.8%	-2.8%	-3.2%	-3.6%	-4.4%	-4.4%	-1.6%	-1.1%	-1.0%	-1.1%	-1.0%	-1.2%				

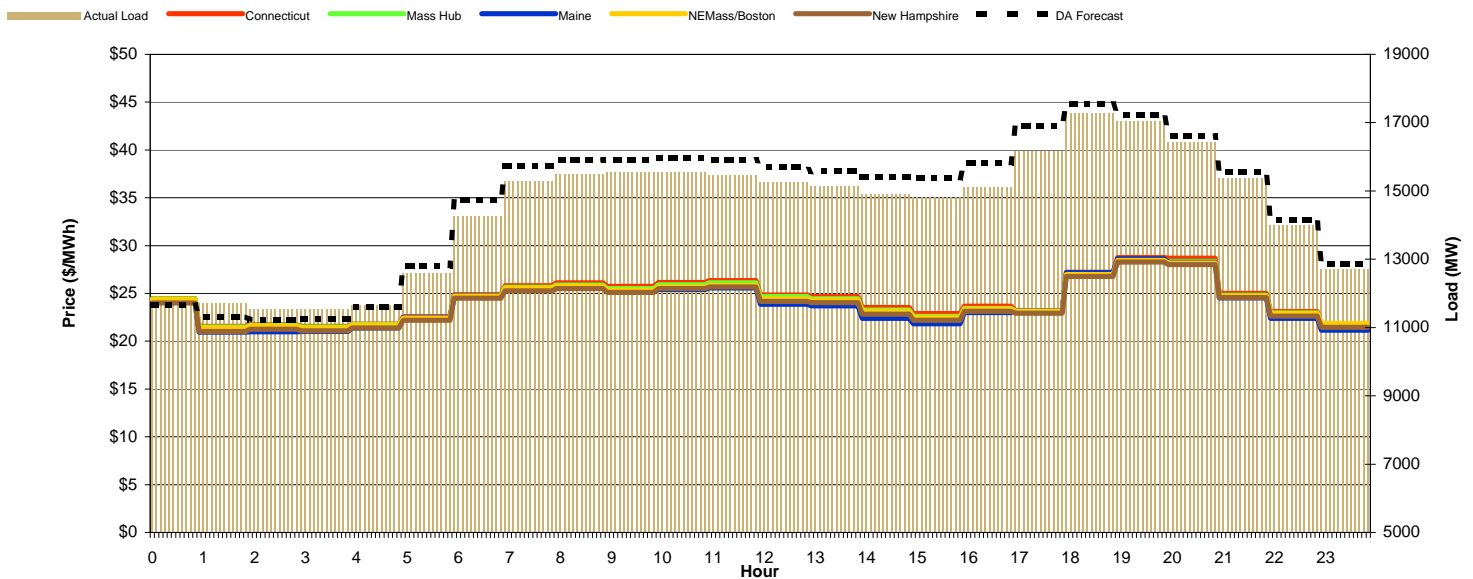




ISO-NE Daily Report

Wednesday February 29, 2012

Price	<=0	>=100	>=200
Forecast Error %	0-4.9%	5-9.9%	>=10%

Day-Ahead Prices and Cleared Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	23.83	23.32	23.27	22.74	23.26	26.49	27.04	27.42	27.77	28.21	29.35	27.90	28.61	29.50	28.48	27.64	29.46	41.18	39.88	30.70	28.41	27.06	26.29	26.90	28.11	29.87	All	On Pk
NEMass/Boston	23.47	23.02	23.01	22.48	23.20	25.24	26.78	26.87	26.95	27.57	28.56	27.25	27.76	28.58	27.41	26.54	28.59	40.30	38.12	30.03	27.57	26.67	26.15	26.00	27.42	29.06		
New Hampshire	22.90	22.51	22.52	22.02	22.79	25.13	26.91	26.90	26.88	27.53	28.50	27.15	27.61	28.42	27.31	26.53	28.59	39.95	37.76	29.87	27.40	26.71	25.97	25.76	27.23	28.94		
Maine	22.57	22.15	22.07	21.73	22.67	25.36	27.52	27.20	27.17	27.87	28.46	27.00	27.32	27.99	26.86	26.28	28.44	40.07	38.09	30.20	27.37	27.35	26.37	26.04	27.26	29.00		
Mass Hub	23.48	23.12	23.14	22.60	23.25	25.16	26.99	27.09	27.16	27.84	28.92	27.57	28.09	29.00	27.82	26.87	29.00	40.74	38.18	30.28	27.81	26.85	26.24	25.96	27.63	29.34		
Cleared Load (GW)	11.3	11.1	11.0	11.0	11.1	12.2	14.1	15.1	15.5	15.5	15.6	15.6	15.6	15.8	15.6	15.4	15.9	17.0	17.0	16.5	15.7	14.3	13.0	11.9				

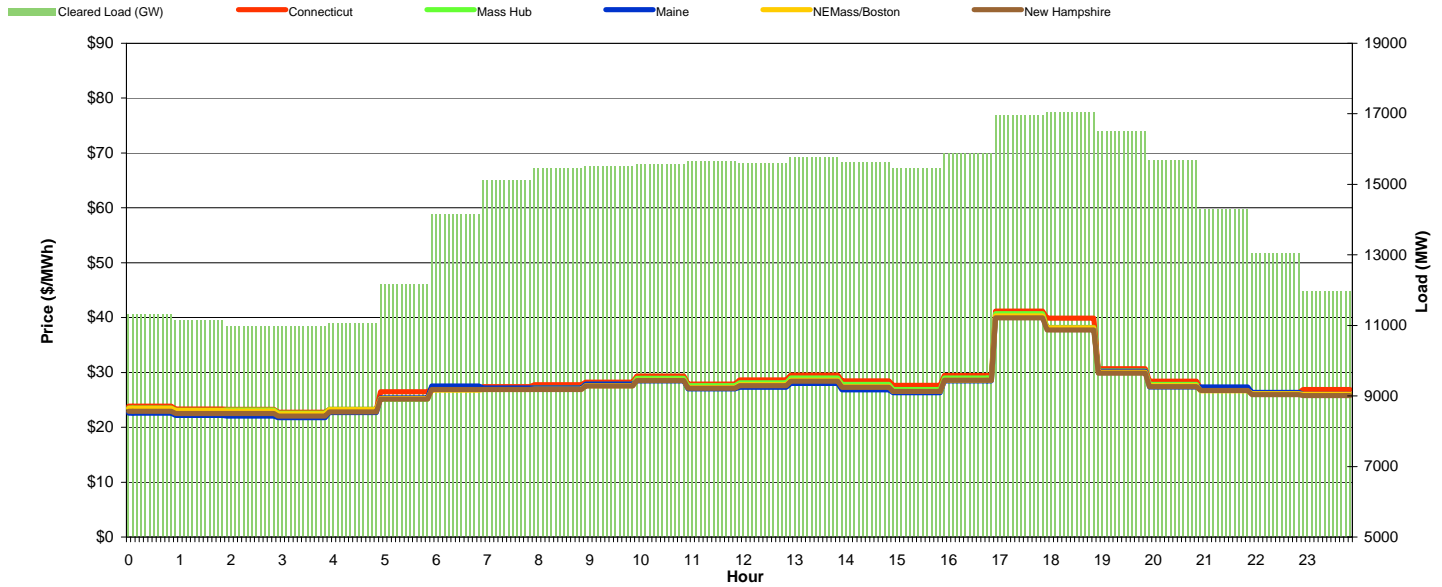

Preliminary Real-Time Prices with Forecasted and Actual System Load

Hour Ending:	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	Avg. Hr \$			
Connecticut	24.66	24.98	24.25	24.36	25.65	35.25	34.04	25.11	25.34	26.09	35.98	36.73	28.56	29.45	30.26	37.11	39.26	79.89	53.74	44.56	33.18	26.98	25.41	38.31	33.71	36.10	All	On Pk
NEMass/Boston	24.56	24.80	24.07	24.20	25.62	34.99	33.65	24.74	25.01	25.70	34.91	35.82	27.90	28.69	29.45	36.01	38.21	78.88	53.38	43.98	32.47	26.57	25.29	38.52	33.23	35.44		
New Hampshire	24.08	24.37	23.67	23.83	25.29	34.73	33.61	24.68	24.96	25.65	34.99	35.78	27.80	28.57	29.32	35.78	37.86	77.87	52.76	43.48	32.08	26.38	25.02	37.79	32.93	35.19		
Maine	23.73	24.04	23.36	23.70	25.40	35.18	34.16	25.12	25.44	26.00	35.03	35.75	27.60	28.23	28.98	35.22	37.51	78.35	53.11	43.47	31.58	26.29	25.17	37.81	32.93	35.18		
Mass Hub	24.57	24.86	24.14	24.26	25.61	35.03	33.73	24.82	25.08	25.78	35.20	36.05	28.06	28.88	29.63	36.26	38.44	78.91	53.33	44.01	32.62	26.66	25.29	38.39	33.32	35.56		
DA Forecast Load (GW)	12.08	11.65	11.44	11.42	11.77	12.91	14.85	15.94	16.16	16.29	16.34	16.34	16.20	16.10	16.00	16.01	16.51	17.49	17.94	17.45	16.70	15.58	14.15	12.86				
Forecast Error %	-1.3%	0.4%	1.3%	1.2%	-1.0%	-1.6%	-2.0%	-1.8%	-1.5%	-1.4%	-0.9%	-0.3%	0.5%	2.1%	2.7%	3.0%	2.4%	2.1%	2.2%	2.3%	2.0%	1.5%	1.5%	1.6%				

