

## **Southeast Natural Gas Region**

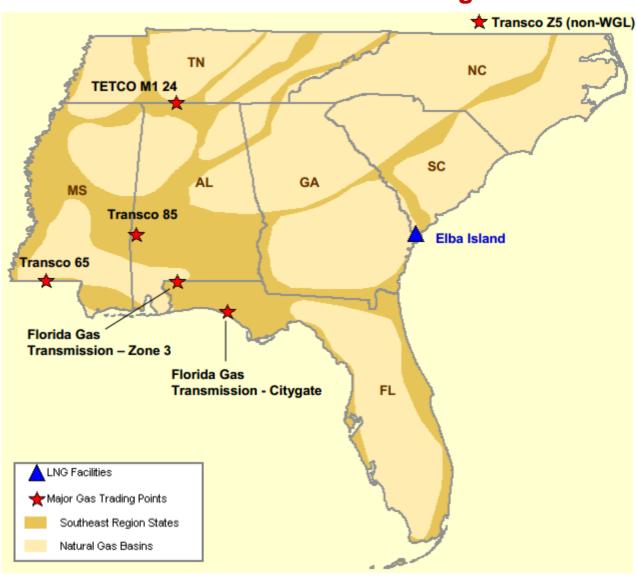


# **Southeast Day-Ahead Prices Averaged Annually/Seasonally**

	Average Day					
	Ahead Prices			Transco	Transco	
	(\$/MMBtu)	FGT Z3	Tetco-M1	St 65	Zone 5	<b>Henry Hub</b>
2013	Annual	3.77	3.66	3.71	4.07	3.72
	Summer	3.83	3.68	3.74	3.95	3.76
	Winter 2013/2014	4.62	4.61	4.60	12.42	4.61
2014	Annual	4.34	4.28	4.30	7.50	4.32
	Summer	4.21	4.12	4.16	4.17	4.18
	Winter 2014/2015	3.21	3.14	3.19	5.40	3.21
2015	Annual	2.62	2.53	2.58	3.53	2.60
	Summer	2.69	2.58	2.65	2.72	2.67
	Winter 2015/2016	1.99	1.91	1.95	2.28	1.97
16 YTD	Annual	2.34	2.27	2.30	2.10	2.34
	Summer	2.51	2.43	2.46	1.96	2.51
2016	Winter 2016/2017					

Notes:

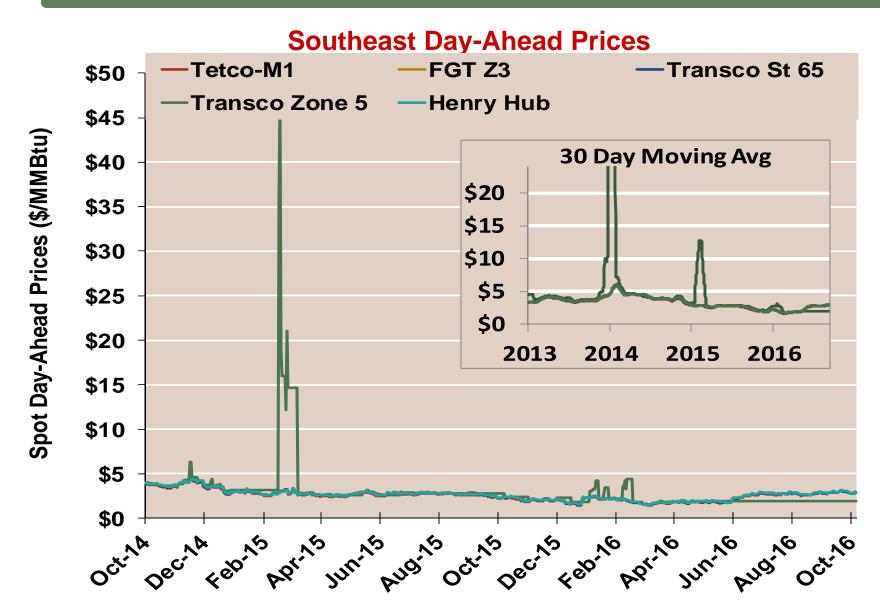


#### **Southeast Day-Ahead Basis**

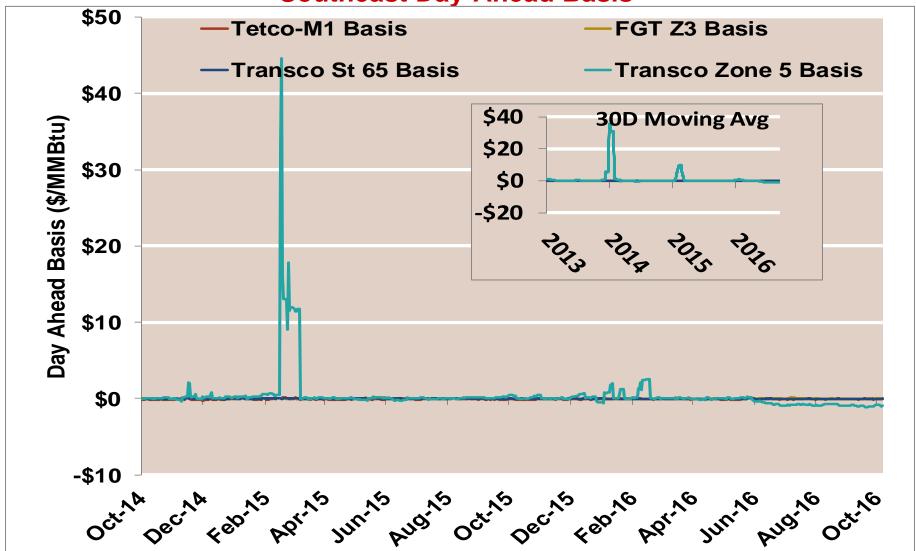

Notes:

## **Southeast Basis to Henry Hub Averaged Monthly**

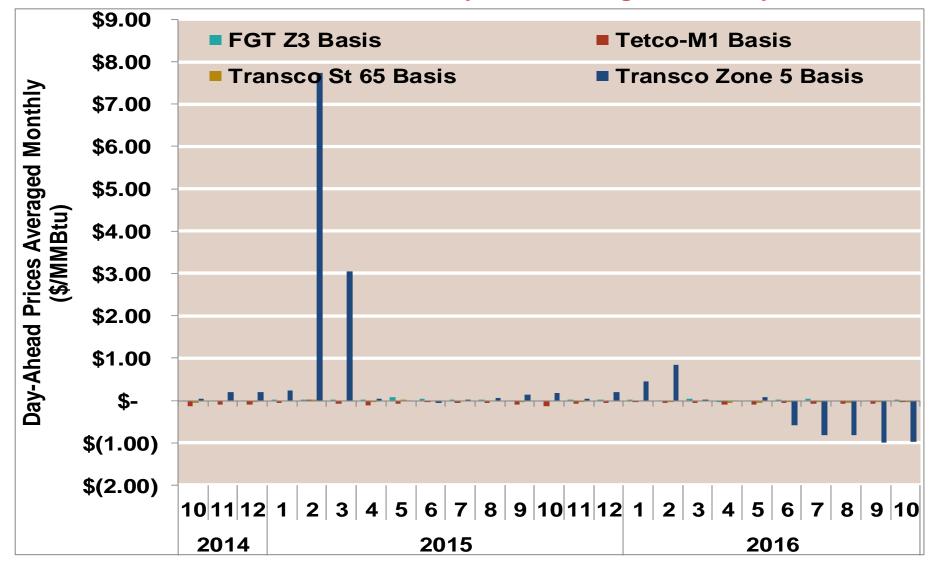


Notes:

Source: Derived from ICE data

Updated Oct-2016

2046


### **Daily Southeast Natural Gas Demand All Sectors**

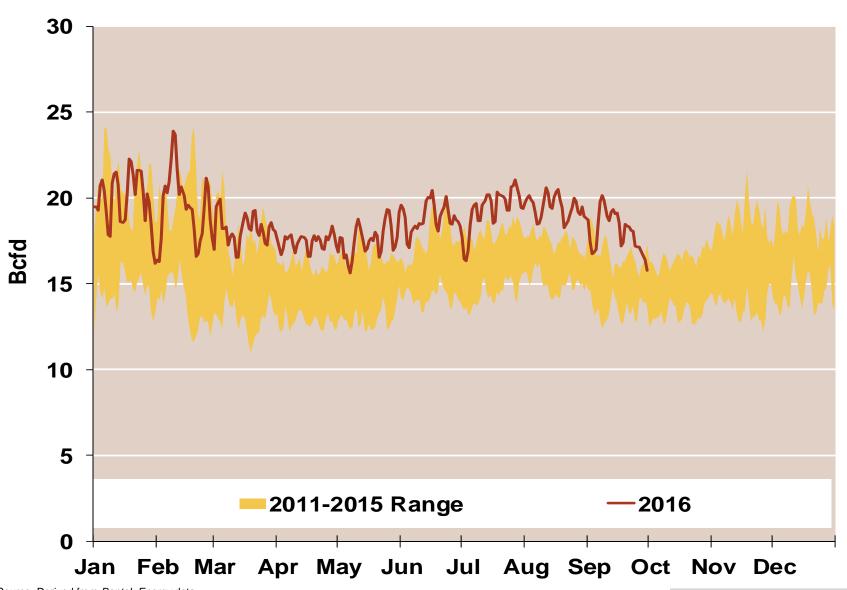

Source: Derived from Bentek Energy data

Updated: September 2016

### **Southeast Natural Gas Consumption for Power Generation**

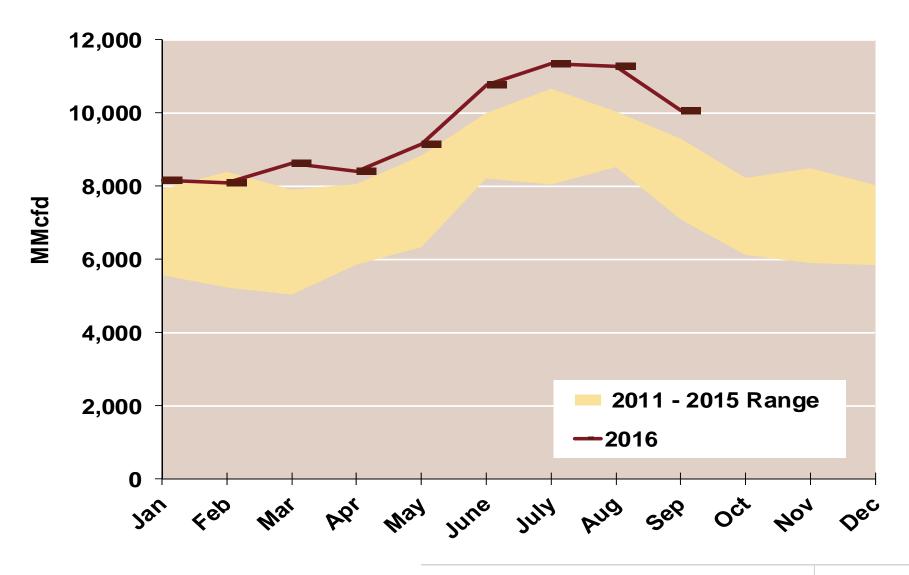

Source: Derived from Bentek Energy data

Updated:

September 2016